


Fire alarm system sequence of Operation for Tower

- 110, 116 York St
- 137, 141 George St
- 325 Dalhousie St

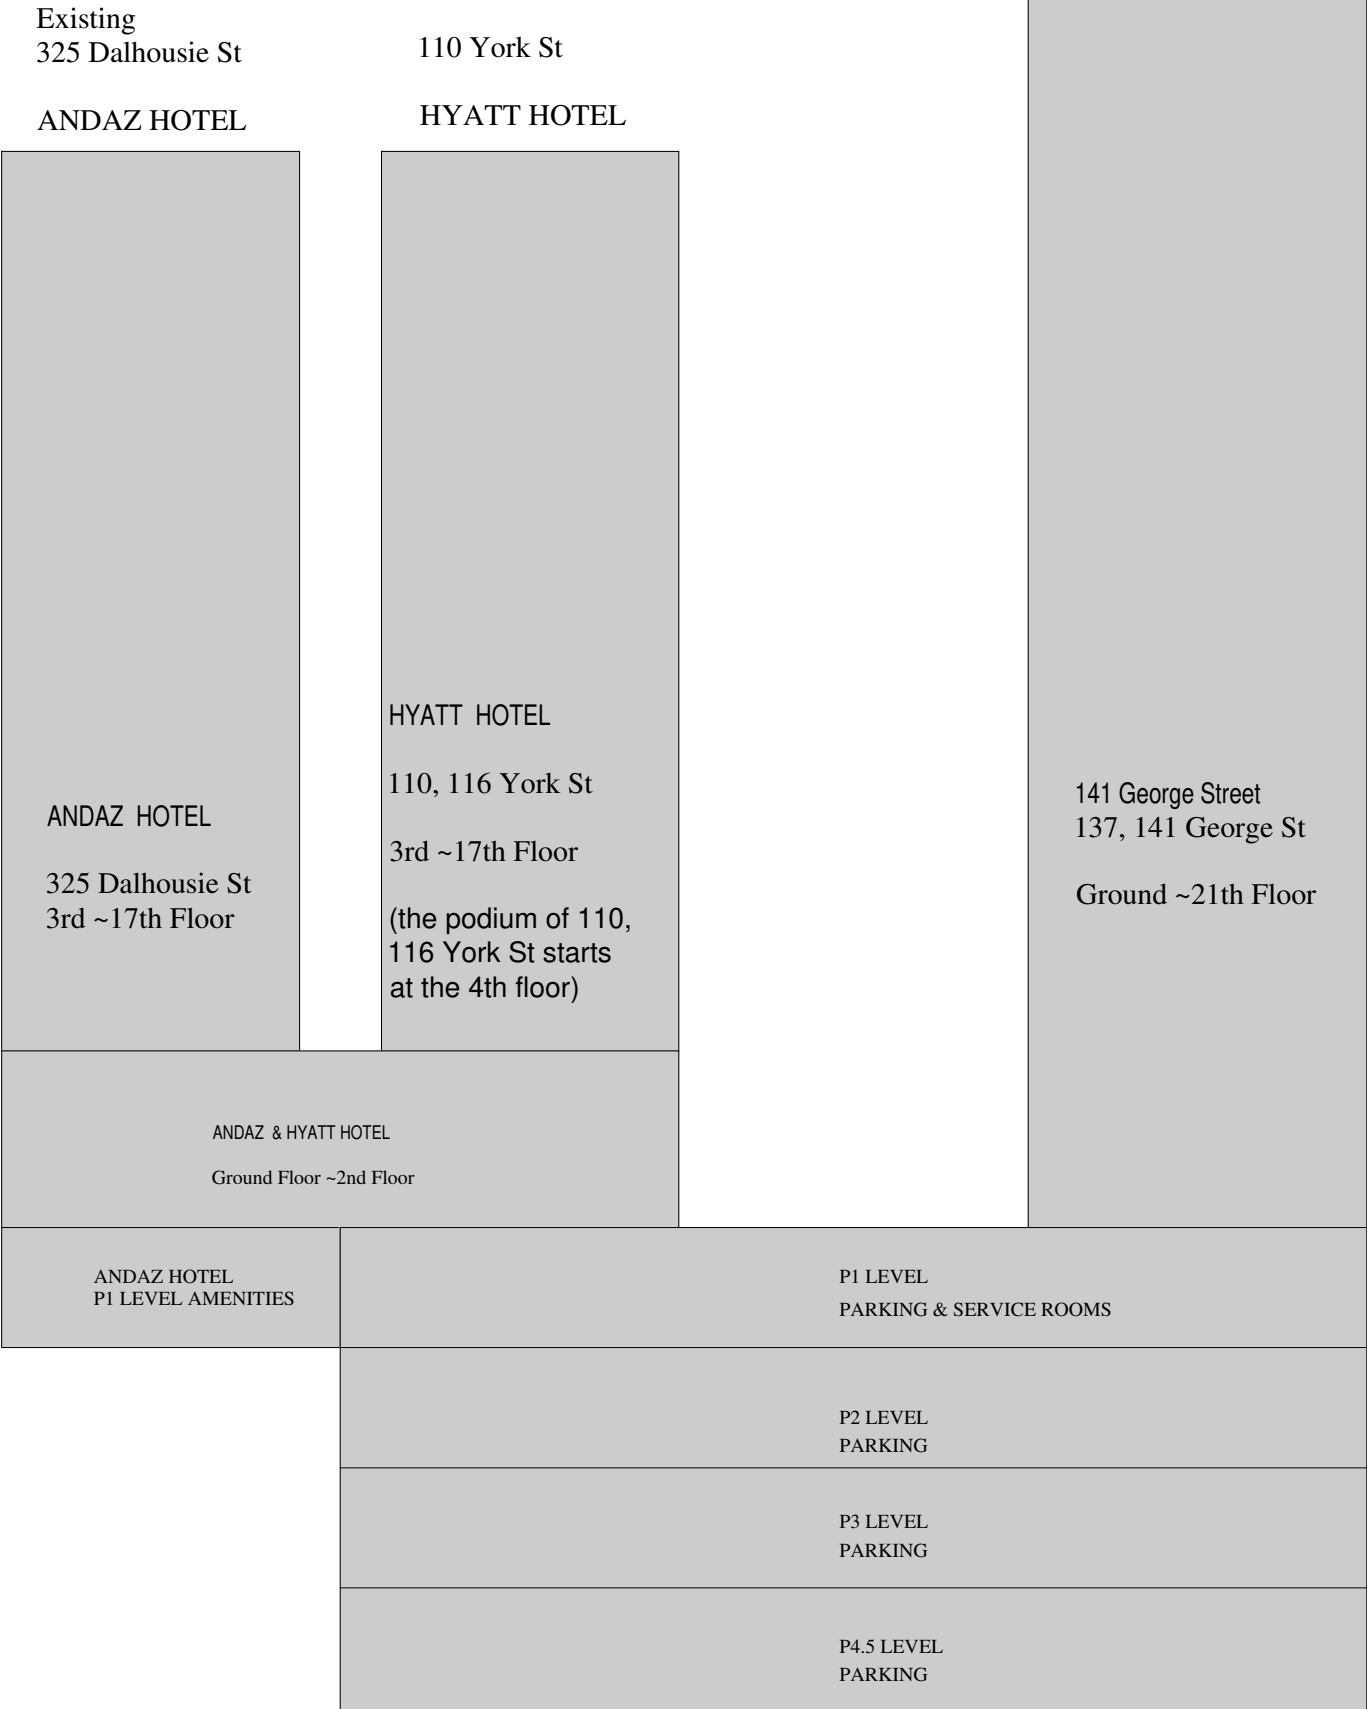

EVENTS LOCATION	Scenario 1:			Scenario 2:		
	actuation of pullstation/ smoke detector/ sprinkler on any Parking Level	after 5 minutes with no intervention	after another 5 minutes or forced alarm through key or 2nd device	actuation of pullstation/ smoke detector/ sprinkler on Ground/2nd Floor 325 dalhousie and 110 york street including 325 Dalhousie P1	after 5 minutes with no intervention	after another 5 minutes or forced alarm through key or 2nd device
parking levels P1-P4.5	alert signals sound throughout	alarm signals sound -EVAC	alarm signals sound - continue EVAC	alert signals sound throughout	alarm signals sound -EVAC	alarm signals sound - continue EVAC
325 Dalhousie and 110 York street Common ground and second floor including P1 of 325 Dalhousie	Alert signals sound - Hotel suites will silence after 1 minute, corridor to remain on	alarm signals sound -EVAC	alarm signals sound - continue EVAC	alert signals sound thoroughout and at Dalhousie and York Hotel office area Fire alarm annunciator panels	alarm signals sound -EVAC	alarm signals sound - continue EVAC
325 Dahousie street 3rd to PH	Alert signals sound - Hotel suites will silence after 1 minute, corridor to remain on	alarm signals sound -EVAC	alarm signals sound - continue EVAC	Alert signals sound - Hotel suites will silence after 1 minute, corridor to remain on	alarm signals sound -EVAC	alarm signals sound - continue EVAC
110 York street 3rd to PH	Alert signals sound - Hotel suites will silence after 1 minute, corridor to remain on	alarm signals sound -EVAC	alarm signals sound - continue EVAC	Alert signals sound - Hotel suites will silence after 1 minute, corridor to remain on	alarm signals sound -EVAC	alarm signals sound - continue EVAC
141 George street ground to PH	Alert signal sound throughout; suites will silence after 1 minute, corridor to remain on	alarm signals sound -EVAC	alarm signals sound - continue EVAC	no sound- has a signal device (NOTIFICATION) in 141 George St Tower CACF room shows Dalhousie and York street Tower at the Alarm status.	no sound- has a signal device (NOTIFICATION) in 141 George St Tower CACF room shows Dalhousie and York street Tower at the Alarm status.	sno sound- has a signal device (NOTIFICATION) in 141 George St Tower CACF room shows Dalhousie and York street Tower at the Alarm status.

EVENTS LOCATION	Scenario 3:			Scenario 4:		
	actuation of pullstation/ smoke detector/ sprinkler on 325 dahousie street 3rd to ph	after 5 minutes with no intervention	after another 5 minutes or forced alarm through key or 2nd device	actuation of pullstation/ smoke detector/ sprinkler on 110 york street 3rd to ph	after 5 minutes with no intervention	after another 5 minutes or forced alarm through key or 2nd device
Parking levels P1-P4.5	no sound- the 110 York St is staffed around the clock and has a signal device (NOTIFICATION) in Hotel office that shows 325 Dalhousie St Tower the Alarm status.	should the 110 York Hotel Staff determine that EVAC is not required, they may ignore the alarm from Dalhousie Tower.	Using a pro-programmed voice announcement "Attention, Attention. The fire alarm has been activated in Dalhousie Andaz Hotel Building. The fire department has been notified. Please do not go to Dalhousie Tower in alarm "	alert signals sound throughout	alarm signals sound -EVAC	alarm signals sound - continue EVAC
325 Dalhousie and 110 York street Common ground and second floor including P1 of 325 Dalhousie	Alert signal sound throughout; alert signals sound at Dalhousie and York Hotel office area Fire alarm annunciator panels	alarm signals sound - EVAC	alarm signals sound- Continue EVAC	alert signals sound thoroughout at Dalhousie and York Hotel office area Fire alarm annunciator panels	alarm signals sound - EVAC	alarm signals sound - continue EVAC
325 Dahousie street 3rd to PH	Alert signal sound throughout; alarm signal to sound in the initiating fire zone in this hotel; suites will silence after 1 minute, corridor to remain on	alarm signals sound - EVAC	alarm signals sound- Continue EVAC	no sound- the 325 Dalhousie is staffed around the clock and has a signal device (NOTIFICATION) in Hotel office that shows 110 York St Tower the Alarm status.	Alert signals sound - Hotel suites will silence after 1 minute, corridor to remain on	should the Staff determine that EVAC is not required, they may ignore the alarm from 110 York street Tower.
110 York street 3rd to PH	no sound- the 110 York St is staffed around the clock and has a signal device (NOTIFICATION) in Hotel office that shows 325 Dalhousie St Tower the Alarm status.	Alert signals sound - Hotel suites will silence after 1 minute, corridor to remain on	should the York Staff determine that EVAC is not required, they may ignore the alarm from 325 Dalhousie street Tower.	Alert signal sound throughout; alarm signal to sound in the initiating fire zone in this hotel; suites will silence after 1 minute, corridor to remain on	alarm signals sound - EVAC	alarm signals sound- Continue EVAC
141 George street ground to PH	no sound- 141 George St CACF room fire alarm control panel has a signal device (NOTIFICATION) shows 325 Dalhousie St Tower the Alarm status.	no sound- 141 George St CACF room fire alarm control panel has a signal device (NOTIFICATION) shows 325 Dalhousie St Tower the Alarm status.	no sound- 141 George St CACF room fire alarm control panel has a signal device (NOTIFICATION) shows 325 Dalhousie St Tower the Alarm status.	no sound- has a signal device (NOTIFICATION) in 141 George St Tower CACF room shows 110 York street Tower at the Alarm status.	no sound- has a signal device (NOTIFICATION) in 141 George St Tower CACF room shows 110 York street Tower at the Alarm status.	no sound- has a signal device (NOTIFICATION) in 141 George St Tower CACF room shows 110 York street Tower at the Alarm status.

EVENTS LOCATION	Scenario 3:			Scenario 4:		
	actuation of pullstation/ smoke detector/ sprinkler on 325 dahousie street 3rd to ph	after 5 minutes with no intervention	after another 5 minutes or forced alarm through key or 2nd device	actuation of pullstation/ smoke detector/ sprinkler on 110 york street 3rd to ph	after 5 minutes with no intervention	after another 5 minutes or forced alarm through key or 2nd device
Parking levels P1-P4.5	no sound- the 110 York St is staffed around the clock and has a signal device (NOTIFICATION) in Hotel office that shows 325 Dalhousie St Tower the Alarm status.	should the 110 York Hotel Staff determine that EVAC is not required, they may ignore the alarm from Dalhousie Tower.	Using a pro-programmed voice announcement "Attention, Attention. The fire alarm has been activated in Dalhousie Andaz Hotel Building. The fire department has been notified. Please do not go to Dalhousie Tower in alarm "	alert signals sound throughout	alarm signals sound -EVAC	alarm signals sound - continue EVAC
325 Dalhousie and 110 York street Common ground and second floor including P1 of 325 Dalhousie	Alert signal sound throughout; alert signals sound at Dalhousie and York Hotel office area Fire alarm annunciator panels	alarm signals sound - EVAC	alarm signals sound- Continue EVAC	alert signals sound thoroughout at Dalhousie and York Hotel office area Fire alarm annunciator panels	alarm signals sound - EVAC	alarm signals sound - continue EVAC
325 Dahousie street 3rd to PH	Alert signal sound throughout; alarm signal to sound in the initiating fire zone in this hotel; suites will silence after 1 minute, corridor to remain on	alarm signals sound - EVAC	alarm signals sound- Continue EVAC	no sound- the 325 Dalhousie is staffed around the clock and has a signal device (NOTIFICATION) in Hotel office that shows 110 York St Tower the Alarm status.	Alert signals sound - Hotel suites will silence after 1 minute, corridor to remain on	should the Staff determine that EVAC is not required, they may ignore the alarm from 110 York street Tower.
110 York street 3rd to PH	no sound- the 110 York St is staffed around the clock and has a signal device (NOTIFICATION) in Hotel office that shows 325 Dalhousie St Tower the Alarm status.	Alert signals sound - Hotel suites will silence after 1 minute, corridor to remain on	should the York Staff determine that EVAC is not required, they may ignore the alarm from 325 Dalhousie street Tower.	Alert signal sound throughout; alarm signal to sound in the initiating fire zone in this hotel; suites will silence after 1 minute, corridor to remain on	alarm signals sound - EVAC	alarm signals sound- Continue EVAC
141 George street ground to PH	no sound- 141 George St CACF room fire alarm control panel has a signal device (NOTIFICATION) shows 325 Dalhousie St Tower the Alarm status.	no sound- 141 George St CACF room fire alarm control panel has a signal device (NOTIFICATION) shows 325 Dalhousie St Tower the Alarm status.	no sound- 141 George St CACF room fire alarm control panel has a signal device (NOTIFICATION) shows 325 Dalhousie St Tower the Alarm status.	no sound- has a signal device (NOTIFICATION) in 141 George St Tower CACF room shows 110 York street Tower at the Alarm status.	no sound- has a signal device (NOTIFICATION) in 141 George St Tower CACF room shows 110 York street Tower at the Alarm status.	no sound- has a signal device (NOTIFICATION) in 141 George St Tower CACF room shows 110 York street Tower at the Alarm status.