

**FUNCTIONAL SERVICING AND
STORMWATER MANAGEMENT
REPORT**

FOR

**FORMASIAN DEVELOPMENT CORP.
1919 MAPLE GROVE ROAD**

CITY OF OTTAWA

PROJECT NO.: 16-861

OCTOBER 2020 – REV 3
© DSEL

**FUNCTIONAL SERVICING AND STORMWATER MANAGEMENT
REPORT
FOR
1919 MAPLE GROVE ROAD
FORMASIAN DEVELOPMENT CORP.**

TABLE OF CONTENTS

1.0	INTRODUCTION	1
1.1	Existing Conditions	2
1.2	Required Permits / Approvals	2
1.3	Pre-consultation.....	3
2.0	GUIDELINES, PREVIOUS STUDIES AND REPORTS.....	4
2.1	Existing Studies, Guidelines, and Reports.....	4
3.0	WATER SUPPLY SERVICING	6
3.1	Existing Water Supply Services.....	6
3.2	Water Supply Servicing Design	6
3.3	Water Supply Conclusion	8
4.0	WASTEWATER SERVICING.....	9
4.1	Existing Wastewater Services	9
4.2	Wastewater Design	10
4.3	Wastewater Servicing Conclusions	11
5.0	STORMWATER MANAGEMENT	12
5.1	Existing Stormwater Services	12
5.2	Post-development Stormwater Management Target	13
5.3	Proposed Stormwater Management System	13
5.4	Stormwater Servicing Conclusions	14
6.0	CONCLUSION AND RECOMMENDATIONS	15

FIGURES

Figure 1 Site Location

TABLES

Table 1 Water Supply Design Criteria
Table 2 Summary of Anticipated Water Demand and
Boundary Conditions
Table 3 Summary of Existing Peak Wastewater Flow
Table 4 Wastewater Design Criteria
Table 5 Summary of Anticipated Peak Wastewater Flow
Table 6 Stormwater Flow Rate Summary

APPENDICES

Appendix A Pre-Consultation Notes
Appendix B Water Supply
Appendix C Wastewater Collection
Appendix D Stormwater Management
Drawings / Figures Proposed Site Plan

**FUNCTIONAL SERVICING AND STORMWATER MANAGEMENT
REPORT
FOR
1919 MAPLE GROVE ROAD**

OCTOBER 2020 – REV 3

**CITY OF OTTAWA
PROJECT NO.: 16-861**

1.0 INTRODUCTION

David Schaeffer Engineering Limited (DSEL) has been retained by Formasian Development Corp. to prepare a Functional Servicing and Stormwater Management report in support of the application Plan of Subdivision at 1919 Maple Grove Road.

The subject property is located within the City of Ottawa urban boundary, in the Stittsville ward. As illustrated in **Figure 1**, the subject property is located north of the Maple Grove Road and Johnwoods Street intersection. Comprised of a single parcel of land, the subject property measures approximately **6.73 ha** and is zoned Development Reserve (DR). The subject site is within the Kanata West Master Servicing Study (**KWMSS**) and was contemplated as residential lands, as shown by **FIG. 2.1** located in **Drawings/Figures**.



Figure 1: Site Location

The proposed Plan of Subdivision would allow for the development of six 4-storey residential buildings in two blocks, seventy-two home lots and six municipal right-of-ways. The development contemplates **18** townhome lots; **44** semi-detached lots; and **450** apartment units. The development contemplates above ground parking and underground parking with access from Maple Grove Road and to the adjacent developments. A copy of the conceptual site plan and associated site statistics prepared by 110 Architects is included in ***Drawings/Figures***.

The objective of this report is to provide sufficient detail to demonstrate that the proposed subdivision is supported by existing municipal services as outlined by the ***KWMSS***.

1.1 Existing Conditions

The existing site is predominantly vacant and vegetated parcel of land. There is a single detached residence on the South side of the parcel. The elevations range between 106.49 m and 107.31 m with a grade change of 0.82 m from the Northeast to the Southwest corner of the property.

Sewer and watermain mapping collected from the City of Ottawa indicate that the following services exist across the property frontages within the adjacent municipal right-of-ways:

Maple Grove Road:

- 305 mm diameter PVC watermain;
- 200 mm diameter PVC sanitary sewer tributary to the Kanata West Pump Station;
- 375 mm diameter PVC sanitary sewer tributary to the Kanata West Pump Station;
- 375 mm diameter PVC storm sewer tributary to the Kanata West Stormwater Pond 4;
- 2100 mm diameter concrete storm sewer tributary to the Kanata West Stormwater Pond 4.

1.2 Required Permits / Approvals

The contemplated development is subject to the Plan of Subdivision process for creation of the lots, road opening approval process for the municipal streets and site plan control approval process for the multi-unit buildings.

The contemplated development proposes new right-of-ways complete with sanitary and storm sewers and as a result the Ministry of the Environment, Conservation and Parks (MECP) requires an Environment Compliance Application (ECA) to be submitted under the Transfer of Review process.

As indicated by the Geotechnical Investigation (**Geotechnical Report**) prepared by Paterson Group, a temporary MECP permit to take water (PTTW) may be required if more than 400,000 L/day of ground and/or surface water is required to be pumped during construction. A minimum of 4-5 months should be allotted to complete the PTTW process under the MECP's jurisdiction. Further inspection is to be completed at the detailed design stage.

As indicated by the **Geotechnical Report**, if 50,000 L/day to 400,000 L/day of ground and/or surface water is required to be pumped during construction, it is required to register on the Environmental Activity and Sector Registry (EASR). A minimum of 2-4 weeks should be allotted to complete the EASR process. Further inspection is to be completed at the detailed design stage.

It is noted that an existing drainage feature crosses the subject site. Based on a previous development along Maple Grove, existing drainage that was previously tributary to the drainage feature has been redirected towards the municipal sewers. The Mississippi Valley Conservation Authority (**MVCA**) has been contacted to confirm that approvals will not be required to decommission the drainage feature, however this coordination is still in progress. Approvals are not anticipated for the following as the swale is not a significant drainage feature for the following reasons:

- Given that the site tributary to the swale located on the 1919 Maple Grove Drive property has been redeveloped and no longer utilizes the swale, the swale no longer conveys flow from multiple parcels.
- The significant drainage feature is located on the adjacent property, 195 Huntmar Drive, North of the 1919 Maple Grove Drive development and as such a headwater study has been included as part of D01-01-16-0015 application.

1.3 Pre-consultation

Pre-consultation correspondence, along with the servicing guidelines checklist, is located in **Appendix A**.

2.0 GUIDELINES, PREVIOUS STUDIES AND REPORTS

2.1 Existing Studies, Guidelines, and Reports

The following studies were utilized in the preparation of this report:

- **Ottawa Sewer Design Guidelines,**
City of Ottawa, *SDG002*, October 2012.
(City Standards)
 - **Technical Bulletin ISTB-2018-01**
City of Ottawa, March 21, 2018.
(ISTB-2018-01)
 - **Technical Bulletin ISTB-2018-04**
City of Ottawa, June 27, 2018.
(ISTB-2018-04)
- **Ottawa Design Guidelines – Water Distribution,**
City of Ottawa, July 2010.
(Water Supply Guidelines)
 - **Technical Bulletin ISD-2010-2**
City of Ottawa, December 15, 2010.
(ISD-2010-2)
 - **Technical Bulletin ISDTB-2014-02**
City of Ottawa, May 27, 2014.
(ISDTB-2014-02)
 - **Technical Bulletin ISDTB-2018-02**
City of Ottawa, March 21, 2018.
(ISDTB-2018-02)
- **Design Guidelines for Sewage Works,**
Ministry of the Environment, 2008.
(MOE Design Guidelines)
- **Stormwater Planning and Design Manual,**
Ministry of the Environment, March 2003.
(SWMP Design Manual)
- **Ontario Building Code Compendium,**
Ministry of Municipal Affairs and Housing Building Development Branch,
January 1, 2010 Update.
(OBC)

- **Kanata West Master Servicing Study,**
Stantec Consulting Ltd., June 16, 2006.
(KWMSS)

- **Kanata West Pump Station Flow Development Background,**
Stantec Consulting Ltd., June 12, 2012.
(KWPS Memo)

- **Geotechnical Investigation,**
Paterson Group, July 20, 2018.
(Geotechnical Report)

3.0 WATER SUPPLY SERVICING

3.1 Existing Water Supply Services

The subject property lies within the City of Ottawa 3W pressure zone, as shown by the Pressure Zone map included in **Appendix B**. Based on available City mapping, a 305 mm watermain exists within the Maple Grove Road right-of-way.

The **KWMSS** contemplated the site to be serviced via the 305 mm diameter watermain within the Maple Grove Road right-of-way, as shown by the *Watermain Final Concept* drawing (**WM-1**) included in **Appendix B**.

3.2 Water Supply Servicing Design

It is anticipated that the contemplated development would be serviced from an internal watermain network with a connection to the existing 305 mm watermain within the Maple Grove Road right-of-way. A conceptual Watermain Servicing Plan (**Drawing 4**) is included in **Drawings/Figures**.

In accordance with City of Ottawa technical bulletin ISDTB-2014-02, redundant service connections will be required due to an estimated design flow of greater than **50 m³/day**. To provide a looped connection, it is anticipated connections to the adjacent development will be made. In the scenario where adjacent development is unavailable, a second connection to the existing watermain within Maple Grove Road will be made. Based on coordination with City staff, it is anticipated that a third future connection will be provided via the Phase 2, 195 Huntmar Drive Development as noted in the correspondence included within **Appendix B**.

Based on the **Water Supply Guidelines**, 49 single dwelling units on a permanent basis and 75 single dwelling units on a temporary basis are permitted on a dead-end watermain should the Sub-division be constructed in phases, noting that the above conditions rely on the available water pressure supplied to the development. In addition, the looped connection must be provided within two years.

Table 1 summarizes the **Water Supply Guidelines** employed in the preparation of the preliminary water demand estimate.

Table 1
Water Supply Design Criteria

Design Parameter	Value
Residential Townhomes/Semi-Detached	2.7 P/unit
Residential 1 Bedroom Apartment	1.4 P/unit
Residential 2 Bedroom Apartment	2.1 P/unit
Residential Average Daily Demand	280 L/d/P
Residential Maximum Daily Demand	2.5 x Average Daily *
Residential Maximum Hourly	5.5 x Average Daily *
Minimum Watermain Size	150mm diameter
Minimum Depth of Cover	2.4m from top of watermain to finished grade
During normal operating conditions desired operating pressure is within	350kPa and 480kPa
During normal operating conditions pressure must not drop below	275kPa
During normal operating conditions pressure must not exceed	552kPa
During fire flow operating pressure must not drop below	140kPa

*Daily average based on Appendix 4-A from **Water Supply Guidelines**
 ** Residential Max. Daily and Max. Hourly peaking factors per MOE Guidelines for Drinking-Water Systems Table 3-3 for 0 to 500 persons.
 -Table updated to reflect ISD-2010-2

Table 2 summarizes the anticipated water supply demand and boundary conditions for the two proposed connection to the 305 mm diameter watermain within Maple Grove Drive, based on the **Water Supply Guidelines**.

Table 2
Summary of Anticipated Water Demand and Boundary Conditions

Design Parameter	Anticipated Demand ¹ (L/min)	Boundary Condition ² Connection 1 (m H ₂ O / kPa)	Boundary Condition ² Connection 2 (m H ₂ O / kPa)
Average Daily Demand	185.9	53.0 / 519.9	52.9 / 518.9
Max Day + Fire Flow	464.7 + 19,000 = 19,464.7	39.3 / 385.5	39.1 / 383.6
Peak Hour	1022.4	48.7 / 477.7	48.6 / 476.8

1) Water demand calculation per **Water Supply Guidelines**. See **Appendix B** for detailed calculations.
 Boundary conditions supplied by the City of Ottawa for the demands indicated in the correspondence; assumed ground elevation 107.9 m at Connection 1 and 108m at Connection 2. See **Appendix B**.

Fire flow requirements are to be determined in accordance with City of Ottawa **Water Supply Guidelines** and the Ontario Building Code.

Fire flow requirements were estimated per City of Ottawa Technical Bulletin **ISTB-2018-02**. The following parameters were assumed:

- Type of construction - Ordinary Construction;
- Occupancy type – Limited Combustibility;

- Sprinkler Protection – Supervised Sprinklered System (Apartment and Retirement Residence) and Non-Sprinklered System (Townhomes).

The above assumptions result in an estimated fire flow of approximately **19,000 L/min**, noting that actual building materials selected will affect the estimated flow. A certified fire protection system specialist shall be employed to design the building fire suppression system(s) and confirm the actual fire flow demand.

Section 6.5.1 of the **KWMSS** summarizes the estimated fire flow requirements used in sizing the trunk infrastructure. Residential and Mixed Use/Commercial development assumed a fire flow requirement of **6,000 L/min** and **13,000 L/min** respectively, in the design of the future watermain network. Based on the **KWMSS**, the residual pressure of the Stittsville Tank under a fire flow of **13,000 L/min** remains above 45 psi (310 kPa).

The City of Ottawa was contacted to obtain boundary conditions associated with the estimated water demand as indicated in the boundary request correspondence included in **Appendix B**.

The City provided both the anticipated minimum and maximum water pressures, as well as, the estimated water pressure during fire flow demand for the demands as indicated by the correspondence in **Appendix B**. The minimum and maximum pressures fall within the required range identified in **Table 1**.

Detailed design of the site watermain infrastructure will ensure that pressures are respected within the City ranges.

3.3 Water Supply Conclusion

The City provided both the anticipated minimum and maximum water pressures, as well as the estimated water pressure during fire flow demand for the demands as indicated by the correspondence in **Appendix B**. The minimum and maximum pressures fall within the required range identified in **Table 1**.

It is anticipated that the contemplated development would be serviced from an internal watermain network with a looped connection to the existing 305 mm watermain within the Maple Grove Road right-of-way and to the adjacent development. Detailed design of the site watermain infrastructure will ensure that pressures are respected within the City's required ranges.

The proposed water supply design conforms to all relevant City Guidelines and Policies.

4.0 WASTEWATER SERVICING

4.1 Existing Wastewater Services

The subject site lies within the Kanata West Pump Station catchment area, as shown by the *Preferred Waste-Water Option* drawing (**S-1**) included in **Appendix C**. Based on available City mapping, a 375 mm diameter sanitary sewer exists within the Maple Grove Road right-of-way. A 600 mm diameter sanitary sewer is located downstream of the subject site near the Maple Grove Road and Montserrat Street intersection.

Sanitary capacity for the site is outlined by the **KWMSS**. *Section 4.3* of the **KWMSS** discusses overall sanitary services for the Kanata West lands, which includes the site. The site falls within the **20.03 ha** area 26, as shown by the *Preferred Waste-Water Option* drawing (**S-1**) and was contemplated to outlet to a 600 mm diameter sanitary sewer within Maple Grove Road. The **KWMSS** sanitary drainage plan and the corresponding Sanitary Sewer Calculation Sheet for the ultimate sanitary sewers are included in **Appendix C**.

Based on the land use plan from the **KWMSS**, the site has been identified as a residential area. *Section 4.4* of the **KWMSS** outlines the design criteria used to size the ultimate sanitary infrastructure servicing the site; residential areas assumed a flow rate of **350 L/Person/Day**. Refer to the extracted from section 4.4 of **KWMSS** included in **Appendix C** for further information regarding the design criteria utilized.

Stantec has prepared a report outlining the design criteria and associated catchment areas to be supported by the Kanata West Pump Station. As shown by the **KWMSS Drainage Allocations** prepared by Stantec included in **Appendix C**, the subject site is to be serviced via the Kanata West Pump Station. Refer to the Kanata West Pump Station Flow Development Background Memorandum (**KWPS Memo**) for further details.

Table 3 demonstrates the existing peak flow from the existing residence. See **Appendix C** for associated calculations.

Table 3
Summary of Existing Peak Wastewater Flow

Design Parameter	Total Flow (L/s)
Estimated Average Dry Weather Flow	0.35
Estimated Peak Dry Weather Flow	0.39
Estimated Peak Wet Weather Flow	2.27

Based on the site area of **20.03 ha**, specified by drawing **S-1** included in **Appendix C**, **23.70 L/s** of flow has been allotted to the development lands. As the subject site in a 6.73 portion of the area outlined within the **KWMSS**, the allotted flow rate for the development is estimated at **8.0 L/s**.

4.2 Wastewater Design

It is anticipated that the contemplated development will connect to the existing 375 mm sanitary sewer within the Maple Grove Road right-of-way in the vicinity of the Johnwoods Street and Maple Grove Road intersection. A conceptual Sanitary Servicing Plan (**Drawing 3**) is included in **Drawings/Figures**.

Table 4 summarizes the **City Standards** employed in the design of the preliminary wastewater sewer system. Design criteria for the Maple Grove Trunk Sewer calculation was extracted from section 4.4 of **KWMSS** and is included in **Appendix C**.

Table 4
Wastewater Design Criteria

Design Parameter	Value
Single Family Home (Existing)	3.4 P/unit
Residential Townhomes	2.7 P/unit
Residential 1 Bedroom Apartment	1.4 P/unit
Residential 2 Bedroom Apartment	2.1 P/unit
Average Daily Demand	280 L/d/per
Peaking Factor	Harmon's Peaking Factor. Max 4.0, Min 2.0 Harmon Correction Factor 0.8
Infiltration and Inflow Allowance	0.33 L/s/ha
Sanitary sewers are to be sized employing the Manning's Equation	$Q = \frac{1}{n} AR^{2/3} S^{1/2}$
Minimum Sewer Size	200 mm diameter
Minimum Manning's 'n'	0.013
Minimum Depth of Cover	2.5m from crown of sewer to grade
Minimum Full Flowing Velocity	0.6m/s
Maximum Full Flowing Velocity	3.0m/s
<i>Extracted from Sections 4 and 6 of the City of Ottawa Sewer Design Guidelines, October 2012.</i>	

Table 5 demonstrates the anticipated peak flow from the contemplated development. See **Appendix C** for associated calculations.

Table 5
Summary of Anticipated Peak Wastewater Flow

Design Parameter	Total Flow (L/s)
Estimated Average Dry Weather Flow	3.43
Estimated Peak Dry Weather Flow	10.41
Estimated Peak Wet Weather Flow	12.29

The estimated peak wet weather sanitary flow, based on the concept plan provided in **Drawings/Figures**, is **12.29 L/s**. As a result, there is a proposed **4.29 L/s** increase in

peak wet weather sanitary flow from the contemplated development. See **Appendix C** for associated calculations.

As part of the Maple Grove Reconstruction, a sanitary analysis was conducted and is outlined by the *Sanitary Drainage Plan* prepared by David Schaeffer Engineering Ltd. (Project No. 10-451) dated July 2011.

Based on the sanitary analysis, the controlling section of the local sewer system is located at the intersection of Maple Grove Road and Santolina Street (section 105A-106A) with an available residual capacity of **32.0 L/s**. The Sanitary Drainage Plan and associated calculation sheet are included in **Appendix C**.

The analysis above indicates that sufficient capacity is available in the local sewers to accommodate the estimated **4.29 L/s** increase in peak wet weather sanitary flow from the contemplated development.

4.3 Wastewater Servicing Conclusions

Contemplated by the **KWPS Memo** prepared by Stantec Consulting Ltd., the site lies within the Kanata West Pump Station collection area.

Based on the sanitary analysis prepared by David Schaeffer Engineering Ltd. in support of the Maple Grove road reconstruction, sufficient capacity is available in the local sewers to accommodate the anticipated **12.29 L/s** peak wet weather flow from the contemplated development.

The proposed wastewater design conforms to all relevant **City Standards**.

5.0 STORMWATER MANAGEMENT

5.1 Existing Stormwater Services

Stormwater runoff from the subject property is tributary to the City of Ottawa sewer system and is located within the Carp River sub-watershed. As such, approvals for proposed development are under the approval authority of the City of Ottawa.

Flows that influence the watershed in which the subject property is located are further reviewed by the principal authority. The subject property is located within the Carp River watershed, and is therefore subject to review by the MVCA.

The **KWMSS** contemplated the site to be serviced via a 1950 mm diameter storm sewer running within the Maple Grove Road right-of-way, as shown by the *Model Schematic Storm Drainage Major System (ST-MJ)* drawing located in **Appendix D**. The ultimate outlet of the storm sewers servicing the site is the **KWMSS** stormwater management facility Pond 4, constructed in 2015.

Minor system storm sewer criteria for the site is outlined by *Storm Drainage Plan* prepared by David Schaeffer Engineering Ltd. (Project No. 12-644) in support of the Pond 4 construction, where the site is located within the 17.39ha of Area A6 (A-1).

Major system flow is discussed in *Section 5.10* of the **KWMSS**. As shown by **ST-MJ** included in **Drawings/Figures**, the site is included in drainage area A-1. This drainage area is surrounded by arterial roads on two sides; per City standards, no overland flow is permitted to cross arterial roads during a 100-year event. Therefore, A-1 is required to contain the 100-year storm onsite. Storage methods anticipated are discussed in section **5.3**.

As indicated by the **KWMSS**, the subject site is to meet a target infiltration rate of 104 mm/yr and 73 mm/yr for areas with moderate and low recharge, respectively. To meet these infiltration rates, the following best management practices (BMP's) are recommended:

- Subsurface Infiltration;
- Biofilters;
- Wet ponds; and
- Dry ponds.

Low Impact Development (**LIDs**) methodologies, will be determined during the detailed design phase of the site. A water balance may be required during detailed design to assess the functionality of the LID system.

5.2 Post-development Stormwater Management Target

Stormwater management requirements for the proposed development were contemplated within the **KWMSS** and within the **KWMSS** Pond 4 design prepared by David Schaeffer Engineering Ltd., where the proposed development is required to:

- Meet an allowable release rate based on a Rational Method Coefficient of 0.60, employing the City of Ottawa IDF parameters for a 5-year storm with a time of concentration equal to 15 minutes;
- Attenuate all storms up to and including the City of Ottawa 100-year design event on site. Sufficient volume to contain 100-year event onsite is required;
- Onsite quality controls are not anticipated as the site is tributary to Pond 4 per the **KWMSS** where quality will be provided.

Based on the above, the allowable release rate for the proposed development is **937.1 L/s**.

5.3 Proposed Stormwater Management System

It is contemplated that the stormwater outlet from the proposed development will be to the 2100 mm diameter storm sewer within Maple Grove Road, as shown by **ST-MJ** located in **Appendix D**. A conceptual Storm Servicing Plan (**Drawing 2**) is included in **Drawings/Figures**.

To meet the stormwater objectives the proposed development may contain a combination of roof top flow attenuation along with surface and subsurface storage.

Table 6 summarizes post-development flow rates. The following storage requirement estimate assumes that approximately 10% of the development area will be directed to the outlet without flow attenuation. The c-value for the development was estimated as 0.65 which is standard for a typical development. These areas will be compensated for in areas with flow attenuation controls.

Table 6
Stormwater Flow Rate Summary

Control Area	5-Year Release Rate (L/s)	5-Year Storage (m ³)	100-Year Release Rate (L/s)	100-Year Storage (m ³)
Unattenuated Areas	127	0	271	0
Attenuated Areas	312	547	666	1168
Total	439	547	937	1168

It is anticipated that approximately **1,168 m³** of storage will be required on site to attenuate flow to the established release rate of **937.1 L/s**; storage calculations are contained within **Appendix D**.

Actual storage volumes will need to be confirmed at the detailed design stage based on a number of factors, including grading constraints.

In accordance with Section 5.6 of the **KWMSS**, a water balance may need to be prepared during detail design to determine the optimal **LIDs** for the specific development. **LIDs** are to be designed and constructed in accordance with the MECP's SWM Planning and Design Manual (March 2003). Please refer to **Contemplated Storm Servicing Plan** included in the **Drawing and Figures** folder for contemplated **LID** locations.

5.4 Stormwater Servicing Conclusions

Post development stormwater runoff will be required to be restricted to the allowable target release rate for storm events up to and including the 100-year storm in accordance with the *Storm Drainage Plan* prepared by David Schaeffer Engineering Ltd. (Project No. 12-644) in support of the Pond 4 construction. The post-development allowable release rate was calculated as **937.1 L/s**, it is estimated that **1,168 m³** of storage will be required to meet this release rate.

Onsite quality controls are not anticipated as the outlet to the site is the Pond 4 per the **KWMSS**.

The proposed stormwater design conforms to all relevant **City Standards** and Policies for approval.

6.0 CONCLUSION AND RECOMMENDATIONS

David Schaeffer Engineering Ltd. (DSEL) has been retained by Formasian Development Corp. to prepare a Functional Servicing and Stormwater Management report in support of the application for Sub-division at 1919 Maple Grove Road. The preceding report outlines the following:

- Based on boundary conditions provided by the City, the existing municipal water infrastructure is capable of providing the contemplated development with water within the City's required pressure range;
- The FUS method for estimating fire flow indicated **19,000 L/min** is required for the contemplated development;
- The contemplated development is anticipated to have a peak wet weather flow of **12.29 L/s**. Based on the sanitary analysis conducted, the existing municipal sewer infrastructure has sufficient capacity to support the development;
- Post development stormwater runoff will be required to be restricted to the allowable target release rate for storm events up to and including the 100-year storm, in accordance with the *Storm Drainage Plan* prepared by David Schaeffer Engineering Ltd. (Project No. 12-644) in support of the Pond 4 construction. As a result, the post-development allowable release rate was calculated as **937.1 L/s**;
- It is contemplated that stormwater objectives may be met through storm water retention via roof top, surface and subsurface storage. It is anticipated that **1,168 m³** of onsite storage will be required to attenuate flow to the established release rate above;
- Onsite quality controls are not anticipated as the site is tributary to the Pond 4 per the **KWMSS** where quality controls will be provided;
- The Ministry of the Environment, Conservation and Parks (MECP) requires an Environmental Compliance Application (ECA) for new storm and sanitary sewers within the future municipal right-of-ways.

Prepared by,
David Schaeffer Engineering Ltd.



Per: Charlotte M. Kelly, EIT.

Prepared by,
David Schaeffer Engineering Ltd.



Per: Alison J. Gosling, P.Eng.

APPENDIX A

Pre-Consultation

DEVELOPMENT SERVICING STUDY CHECKLIST

16-861

09/08/2019

4.1 General Content	
<input type="checkbox"/>	Executive Summary (for larger reports only). N/A
<input checked="" type="checkbox"/>	Date and revision number of the report. Report Cover Sheet
<input checked="" type="checkbox"/>	Location map and plan showing municipal address, boundary, and layout of proposed development. Drawings/Figures
<input checked="" type="checkbox"/>	Plan showing the site and location of all existing services. Figure 1
<input checked="" type="checkbox"/>	Development statistics, land use, density, adherence to zoning and official plan, and reference to applicable subwatershed and watershed plans that provide context to applicable subwatershed and watershed plans that provide context to which individual developments must adhere. Section 1.0
<input checked="" type="checkbox"/>	Summary of Pre-consultation Meetings with City and other approval agencies. Section 1.3
<input checked="" type="checkbox"/>	Reference and confirm conformance to higher level studies and reports (Master Servicing Studies, Environmental Assessments, Community Design Plans), or in the case where it is not in conformance, the proponent must provide justification and develop a defensible design criteria. Section 2.1
<input checked="" type="checkbox"/>	Statement of objectives and servicing criteria. Section 1.0
<input checked="" type="checkbox"/>	Identification of existing and proposed infrastructure available in the immediate area. Sections 1.1, 3.1, 4.1, 5.1
<input type="checkbox"/>	Identification of Environmentally Significant Areas, watercourses and Municipal Drains potentially impacted by the proposed development (Reference can be made to the Natural Heritage Studies, if available). N/A
<input type="checkbox"/>	Concept level master grading plan to confirm existing and proposed grades in the development. This is required to confirm the feasibility of proposed stormwater management and drainage, soil removal and fill constraints, and potential impacts to neighbouring properties. This is also required to confirm that the proposed grading will not impede existing major system flow paths. N/A
<input type="checkbox"/>	Identification of potential impacts of proposed piped services on private services (such as wells and septic fields on adjacent lands) and mitigation required to address potential impacts. N/A
<input type="checkbox"/>	Proposed phasing of the development, if applicable. N/A
<input checked="" type="checkbox"/>	Reference to geotechnical studies and recommendations concerning servicing. Section 2.1
<input checked="" type="checkbox"/>	All preliminary and formal site plan submissions should have the following information: -Metric scale -North arrow (including construction North) -Key plan -Name and contact information of applicant and property owner -Property limits including bearings and dimensions -Existing and proposed structures and parking areas -Easements, road widening and rights-of-way -Adjacent street names Drawings/Figures
4.2 Development Servicing Report: Water	
<input type="checkbox"/>	Confirm consistency with Master Servicing Study, if available N/A
<input checked="" type="checkbox"/>	Availability of public infrastructure to service proposed development Section 3.1
<input checked="" type="checkbox"/>	Identification of system constraints Section 3.1
<input checked="" type="checkbox"/>	Identify boundary conditions Section 3.2
<input checked="" type="checkbox"/>	Confirmation of adequate domestic supply and pressure Section 3.2, 3.3

<input checked="" type="checkbox"/>	Confirmation of adequate fire flow protection and confirmation that fire flow is calculated as per the Fire Underwriter’s Survey. Output should show available fire flow at locations throughout the development.	Section 3.2
<input type="checkbox"/>	Provide a check of high pressures. If pressure is found to be high, an assessment is required to confirm the application of pressure reducing valves.	N/A
<input type="checkbox"/>	Definition of phasing constraints. Hydraulic modeling is required to confirm servicing for all defined phases of the project including the ultimate design	N/A
<input type="checkbox"/>	Address reliability requirements such as appropriate location of shut-off valves	N/A
<input type="checkbox"/>	Check on the necessity of a pressure zone boundary modification	N/A
<input checked="" type="checkbox"/>	Reference to water supply analysis to show that major infrastructure is capable of delivering sufficient water for the proposed land use. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure range	Section 3.2, 3.3
<input type="checkbox"/>	Description of the proposed water distribution network, including locations of proposed connections to the existing system, provisions for necessary looping, and appurtenances (valves, pressure reducing valves, valve chambers, and fire hydrants) including special metering provisions.	N/A
<input type="checkbox"/>	Description of off-site required feeder mains, booster pumping stations, and other water infrastructure that will be ultimately required to service proposed development, including financing, interim facilities, and timing of implementation.	N/A
<input checked="" type="checkbox"/>	Confirmation that water demands are calculated based on the City of Ottawa Design Guidelines.	Section 3.2
<input type="checkbox"/>	Provision of a model schematic showing the boundary conditions locations, streets, parcels, and building locations for reference.	N/A

4.3 Development Servicing Report: Wastewater

<input checked="" type="checkbox"/>	Summary of proposed design criteria (Note: Wet-weather flow criteria should not deviate from the City of Ottawa Sewer Design Guidelines. Monitored flow data from relatively new infrastructure cannot be used to justify capacity requirements for proposed infrastructure).	Section 4.2
<input type="checkbox"/>	Confirm consistency with Master Servicing Study and/or justifications for deviations.	N/A
<input type="checkbox"/>	Consideration of local conditions that may contribute to extraneous flows that are higher than the recommended flows in the guidelines. This includes groundwater and soil conditions, and age and condition of sewers.	N/A
<input checked="" type="checkbox"/>	Description of existing sanitary sewer available for discharge of wastewater from proposed development.	Section 4.1
<input checked="" type="checkbox"/>	Verify available capacity in downstream sanitary sewer and/or identification of upgrades necessary to service the proposed development. (Reference can be made to previously completed Master Servicing Study if applicable)	Section 4.2
<input checked="" type="checkbox"/>	Calculations related to dry-weather and wet-weather flow rates from the development in standard MOE sanitary sewer design table (Appendix ‘C’) format.	Section 4.2, Appendix C
<input checked="" type="checkbox"/>	Description of proposed sewer network including sewers, pumping stations, and forcemains.	Section 4.2
<input type="checkbox"/>	Discussion of previously identified environmental constraints and impact on servicing (environmental constraints are related to limitations imposed on the development in order to preserve the physical condition of watercourses, vegetation, soil cover, as well as protecting against water quantity and quality).	N/A

<input type="checkbox"/>	Pumping stations: impacts of proposed development on existing pumping stations or requirements for new pumping station to service development.	N/A
<input type="checkbox"/>	Forcemain capacity in terms of operational redundancy, surge pressure and maximum flow velocity.	N/A
<input type="checkbox"/>	Identification and implementation of the emergency overflow from sanitary pumping stations in relation to the hydraulic grade line to protect against basement flooding.	N/A
<input type="checkbox"/>	Special considerations such as contamination, corrosive environment etc.	N/A

4.4 Development Servicing Report: Stormwater Checklist

<input checked="" type="checkbox"/>	Description of drainage outlets and downstream constraints including legality of outlets (i.e. municipal drain, right-of-way, watercourse, or private property)	Section 5.1
<input checked="" type="checkbox"/>	Analysis of available capacity in existing public infrastructure.	Section 5.1, Appendix D
<input checked="" type="checkbox"/>	A drawing showing the subject lands, its surroundings, the receiving watercourse, existing drainage patterns, and proposed drainage pattern.	Drawings/Figures
<input checked="" type="checkbox"/>	Water quantity control objective (e.g. controlling post-development peak flows to pre-development level for storm events ranging from the 2 or 5 year event (dependent on the receiving sewer design) to 100 year return period); if other objectives are being applied, a rationale must be included with reference to hydrologic analyses of the potentially affected subwatersheds, taking into account long-term cumulative effects.	Section 5.2
<input checked="" type="checkbox"/>	Water Quality control objective (basic, normal or enhanced level of protection based on the sensitivities of the receiving watercourse) and storage requirements.	Section 5.2
<input checked="" type="checkbox"/>	Description of the stormwater management concept with facility locations and descriptions with references and supporting information	Section 5.2
<input type="checkbox"/>	Set-back from private sewage disposal systems.	N/A
<input type="checkbox"/>	Watercourse and hazard lands setbacks.	N/A
<input checked="" type="checkbox"/>	Record of pre-consultation with the Ontario Ministry of Environment and the Conservation Authority that has jurisdiction on the affected watershed.	Appendix A
<input type="checkbox"/>	Confirm consistency with sub-watershed and Master Servicing Study, if applicable study exists.	N/A
<input checked="" type="checkbox"/>	Storage requirements (complete with calculations) and conveyance capacity for minor events (1:5 year return period) and major events (1:100 year return period).	Section 5.3
<input type="checkbox"/>	Identification of watercourses within the proposed development and how watercourses will be protected, or, if necessary, altered by the proposed development with applicable approvals.	N/A
<input checked="" type="checkbox"/>	Calculate pre and post development peak flow rates including a description of existing site conditions and proposed impervious areas and drainage catchments in comparison to existing conditions.	Section 5.1, 5.3
<input type="checkbox"/>	Any proposed diversion of drainage catchment areas from one outlet to another.	N/A
<input type="checkbox"/>	Proposed minor and major systems including locations and sizes of stormwater trunk sewers, and stormwater management facilities.	N/A
<input type="checkbox"/>	If quantity control is not proposed, demonstration that downstream system has adequate capacity for the post-development flows up to and including the 100-year return period storm event.	N/A
<input type="checkbox"/>	Identification of potential impacts to receiving watercourses	N/A
<input type="checkbox"/>	Identification of municipal drains and related approval requirements.	N/A

<input checked="" type="checkbox"/>	Descriptions of how the conveyance and storage capacity will be achieved for the development.	Section 5.3
<input type="checkbox"/>	100 year flood levels and major flow routing to protect proposed development from flooding for establishing minimum building elevations (MBE) and overall grading.	N/A
<input type="checkbox"/>	Inclusion of hydraulic analysis including hydraulic grade line elevations.	N/A
<input checked="" type="checkbox"/>	Description of approach to erosion and sediment control during construction for the protection of receiving watercourse or drainage corridors.	N/A
<input type="checkbox"/>	Identification of floodplains – proponent to obtain relevant floodplain information from the appropriate Conservation Authority. The proponent may be required to delineate floodplain elevations to the satisfaction of the Conservation Authority if such information is not available or if information does not match current conditions.	N/A
<input type="checkbox"/>	Identification of fill constraints related to floodplain and geotechnical investigation.	N/A

4.5 Approval and Permit Requirements: Checklist

<input checked="" type="checkbox"/>	Conservation Authority as the designated approval agency for modification of floodplain, potential impact on fish habitat, proposed works in or adjacent to a watercourse, cut/fill permits and Approval under Lakes and Rivers Improvement Act. The Conservation Authority is not the approval authority for the Lakes and Rivers Improvement ct. Where there are Conservation Authority regulations in place, approval under the Lakes and Rivers Improvement Act is not required, except in cases of dams as defined in the Act.	Section 5.1
<input type="checkbox"/>	Application for Certificate of Approval (CofA) under the Ontario Water Resources Act.	N/A
<input type="checkbox"/>	Changes to Municipal Drains.	N/A
<input type="checkbox"/>	Other permits (National Capital Commission, Parks Canada, Public Works and Government Services Canada, Ministry of Transportation etc.)	N/A

4.6 Conclusion Checklist

<input checked="" type="checkbox"/>	Clearly stated conclusions and recommendations	Section 7.0
<input type="checkbox"/>	Comments received from review agencies including the City of Ottawa and information on how the comments were addressed. Final sign-off from the responsible reviewing agency.	
<input type="checkbox"/>	All draft and final reports shall be signed and stamped by a professional Engineer registered in Ontario	

Charlotte Kelly

From: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Sent: June 25, 2020 4:37 PM
To: Charlotte Kelly
Cc: Alison Gosling
Subject: RE: 1919 Maple Grove Road - Boundary Condition Request
Attachments: FW: 1919 Maple Grove Road - Boundary Condition Request

Hi Kelly,

Please see attached email for the boundary conditions.

If you have any questions, please let me know.

Thanks,

Santhosh

From: Charlotte Kelly <CKelly@dsel.ca>
Sent: June 19, 2020 9:01 AM
To: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Cc: Alison Gosling <AGosling@dsel.ca>
Subject: 1919 Maple Grove Road - Boundary Condition Request

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Good Morning Santhosh,

We would like to kindly request updated boundary conditions for the contemplated development at 1919 Maple Grove Road development using the following anticipated development demands:

1. Location of Service / Street Number: 1919 Maple Grove Road
2. Type of development and the amount of fire flow required for the contemplated development:
 - Type of development: The contemplated development includes 62 townhomes/semi-detached units and 450 residential units.
 - Contemplated Connections:
 - Dual Connection to the 305 mm diameter watermain within Maple Grove Road
 - Fire demand based on Technical Bulletin ISTB-2018-02 has been used to estimate a max fire demand of **19,000 L/min**. Refer to the attached for detailed calculations.

Demand	L/min	L/s
Avg. Daily	185.9	3.10
Max Day	464.7	7.75
Peak Hour	1022.4	17.04



Please let us know if you have any questions.

Thank-you,

Charlotte Kelly, E.I.T.
Junior Engineering Designer

DSEL

david schaeffer engineering ltd.

120 Iber Road, Unit 103
Stittsville, ON K2S 1E9

phone: (613) 836-0856 ext.511

email: ckelly@dse.ca

This email, including any attachments, is for the sole use of the intended recipient(s) and may contain private, confidential, and privileged information. Any unauthorized review, use, disclosure, or distribution is prohibited. If you are not the intended recipient, or if this information has been inappropriately forwarded to you, please contact the sender by reply email and destroy all copies of the original.

,

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

APPENDIX B

Water Supply

Water Demand Design Flows per Unit Count
City of Ottawa - Water Distribution Guidelines, July 2010



Domestic Demand

Type of Housing	Per / Unit	Units	Pop
Single Family	3.4		0
Semi-detached	2.7	18	49
Townhouse	2.7	44	119
Apartment			0
Bachelor	1.4		0
1 Bedroom	1.4	225	315
2 Bedroom	2.1	225	473
3 Bedroom	3.1		0
Average	1.8		0

	Pop	Avg. Daily		Max Day		Peak Hour	
		m ³ /d	L/min	m ³ /d	L/min	m ³ /d	L/min
Total Domestic Demand	956	267.7	185.9	669.2	464.7	1472.2	1022.4

Institutional / Commercial / Industrial Demand

Property Type	Unit Rate	Units	Avg. Daily		Max Day		Peak Hour	
			m ³ /d	L/min	m ³ /d	L/min	m ³ /d	L/min
Commercial floor space	2.5 L/m ² /d		0.00	0.0	0.0	0.0	0.0	0.0
Office	75 L/9.3m ² /d		0.00	0.0	0.0	0.0	0.0	0.0
Industrial - Light	35,000 L/gross ha/d		0.00	0.0	0.0	0.0	0.0	0.0
Industrial - Heavy	55,000 L/gross ha/d		0.00	0.0	0.0	0.0	0.0	0.0
Total I/CI Demand			0.0	0.0	0.0	0.0	0.0	0.0
Total Demand			267.7	185.9	669.2	464.7	1472.2	1022.4

Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999



Fire Flow Required

SOUTH EAST NW APARTMENT BUILDING

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min Where F is the fire flow, C is the Type of construction and A is the Total floor area

Type of Construction:

Ordinary Construction

C 1 Type of Construction Coefficient per FUS Part II, Section 1
A 17052.0 m² Total floor area based on FUS Part II section 1

Fire Flow 28728.3 L/min
29000.0 L/min rounded to the nearest 1,000 L/min

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow 24650.0 L/min

3. Reduction for Sprinkler Protection

Sprinklered - Supervised -50%

Reduction -12325 L/min

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Ordinary - Unprotected Openings	20.1m-30m	31	4	124	10%	
S Ordinary - Unprotected Openings	20.1m-30m	14	3	42	7%	
E Ordinary - Unprotected Openings	20.1m-30m	60	4	240	10%	
W Ordinary - Unprotected Openings	>45m	21	4	84	0%	
	% Increase					27% value not to exceed 75%

Increase 6655.5 L/min

Lw = Length of the Exposed Wall

Ha = number of storeys of the adjacent structure (maximum 5 stories)

LH = Length-height factor of exposed wall. Value rounded up.

EC = Exposure Charge

Total Fire Flow

Fire Flow 18980.5 L/min fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
19000.0 L/min rounded to the nearest 1,000 L/min

Notes:

-Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.

-Calculations based on Fire Underwriters Survey - Part II



Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999

Fire Flow Required

NORTH WEST SW APARTMENT BUILDING

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min Where *F* is the fire flow, *C* is the Type of construction and *A* is the Total floor area

Type of Construction:

Ordinary Construction

C	1	Type of Construction Coefficient per FUS Part II, Section 1
A	9976.0	m ² Total floor area based on FUS Part II section 1

Fire Flow	21973.6 L/min
	22000.0 L/min rounded to the nearest 1,000 L/min

Adjustments

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow	18700.0 L/min
------------------	----------------------

3. Reduction for Sprinkler Protection

Sprinklered - Supervised -50%

Reduction	-9350 L/min
------------------	--------------------

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Ordinary - Unprotected Openings	10.1m-20m		31	4	124	15%
S Ordinary - Unprotected Openings	20.1m-30m		16	3	48	7%
E Ordinary - Unprotected Openings	10.1m-20m		150	3	450	15%
W Ordinary - Unprotected Openings	20.1m-30m		60	4	240	10%
	% Increase					47% value not to exceed 75%

Increase	8789.0 L/min
-----------------	---------------------

Lw = Length of the Exposed Wall
 Ha = number of storeys of the adjacent structure (maximum 5 stories)
 LH = Length-height factor of exposed wall. Value rounded up.
 EC = Exposure Charge

Total Fire Flow

Fire Flow	18139.0 L/min	fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
	18000.0 L/min	rounded to the nearest 1,000 L/min

- Notes:**
 -Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.
 -Calculations based on Fire Underwriters Survey - Part II

Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999



Fire Flow Required

NORTH WEST CENTRAL APARTMENT BUILDING

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min Where F is the fire flow, C is the Type of construction and A is the Total floor area

Type of Construction:

Ordinary Construction

C 1 Type of Construction Coefficient per FUS Part II, Section 1
A 5760.0 m² Total floor area based on FUS Part II section 1

Fire Flow 16696.8 L/min
17000.0 L/min rounded to the nearest 1,000 L/min

Adjustments

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow 14450.0 L/min

3. Reduction for Sprinkler Protection

Sprinklered - Supervised -50%

Reduction -7225 L/min

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Ordinary - Unprotected Openings	>45m		0	0	0	0%
S Ordinary - Unprotected Openings	20.1m-30m		31	4	124	10%
E Ordinary - Unprotected Openings	10.1m-20m		90	3	270	15%
W Ordinary - Unprotected Openings	20.1m-30m		60	4	240	10%
	% Increase					35% value not to exceed 75%

Increase 5057.5 L/min

Lw = Length of the Exposed Wall

Ha = number of storeys of the adjacent structure (maximum 5 stories)

LH = Length-height factor of exposed wall. Value rounded up.

EC = Exposure Charge

Total Fire Flow

Fire Flow 12282.5 L/min fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
12000.0 L/min rounded to the nearest 1,000 L/min

Notes:

-Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.

-Calculations based on Fire Underwriters Survey - Part II



Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999

Fire Flow Required

SOUTH WEST CENTRAL APARTMENT BUILDING

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min Where *F* is the fire flow, *C* is the Type of construction and *A* is the Total floor area

Type of Construction:

Ordinary Construction

C	1	Type of Construction Coefficient per FUS Part II, Section 1
A	4168.0	m ² Total floor area based on FUS Part II section 1

Fire Flow	14203.2 L/min
	14000.0 L/min rounded to the nearest 1,000 L/min

Adjustments

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow	11900.0 L/min
------------------	----------------------

3. Reduction for Sprinkler Protection

Sprinklered - Supervised -50%

Reduction	-5950 L/min
------------------	--------------------

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Ordinary - Unprotected Openings	>45m		0	0	0	0%
S Ordinary - Unprotected Openings	20.1m-30m		31	4	124	10%
E Ordinary - Unprotected Openings	10.1m-20m		90	3	270	15%
W Ordinary - Unprotected Openings	20.1m-30m		60	4	240	10%
	% Increase					35% value not to exceed 75%

Increase	4165.0 L/min
-----------------	---------------------

Lw = Length of the Exposed Wall
Ha = number of storeys of the adjacent structure (maximum 5 stories)
LH = Length-height factor of exposed wall. Value rounded up.
EC = Exposure Charge

Total Fire Flow

Fire Flow	10115.0 L/min	fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
	10000.0 L/min	rounded to the nearest 1,000 L/min

- Notes:**
 -Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.
 -Calculations based on Fire Underwriters Survey - Part II



Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999

Fire Flow Required

NORTH EAST CENTRAL APARTMENT BUILDING

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min Where *F* is the fire flow, *C* is the Type of construction and *A* is the Total floor area

Type of Construction:

Ordinary Construction

C	1	Type of Construction Coefficient per FUS Part II, Section 1
A	4168.0	m ² Total floor area based on FUS Part II section 1

Fire Flow	14203.2 L/min
	14000.0 L/min rounded to the nearest 1,000 L/min

Adjustments

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow	11900.0 L/min
------------------	----------------------

3. Reduction for Sprinkler Protection

Sprinklered - Supervised -50%

Reduction	-5950 L/min
------------------	--------------------

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Ordinary - Unprotected Openings	>45m	0	0	0	0	0%
S Ordinary - Unprotected Openings	20.1m-30m	31	4	124	10%	
E Ordinary - Unprotected Openings	10.1m-20m	90	3	270	15%	
W Ordinary - Unprotected Openings	20.1m-30m	60	4	240	10%	
	% Increase					35% value not to exceed 75%

Increase	4165.0 L/min
-----------------	---------------------

Lw = Length of the Exposed Wall
 Ha = number of storeys of the adjacent structure (maximum 5 stories)
 LH = Length-height factor of exposed wall. Value rounded up.
 EC = Exposure Charge

Total Fire Flow

Fire Flow	10115.0 L/min	fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
	10000.0 L/min	rounded to the nearest 1,000 L/min

- Notes:**
 -Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.
 -Calculations based on Fire Underwriters Survey - Part II

Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999



Fire Flow Required

SOUTH EAST CENTRAL APARTMENT BUILDING

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min Where F is the fire flow, C is the Type of construction and A is the Total floor area

Type of Construction:

Ordinary Construction

C 1 Type of Construction Coefficient per FUS Part II, Section 1
A 5760.0 m² Total floor area based on FUS Part II section 1

Fire Flow 16696.8 L/min
17000.0 L/min rounded to the nearest 1,000 L/min

Adjustments

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow 14450.0 L/min

3. Reduction for Sprinkler Protection

Sprinklered - Supervised -50%

Reduction -7225 L/min

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Ordinary - Unprotected Openings	>45m	0	0	0	0	0%
S Ordinary - Unprotected Openings	20.1m-30m	31	4	124	10%	
E Ordinary - Unprotected Openings	10.1m-20m	90	3	270	15%	
W Ordinary - Unprotected Openings	20.1m-30m	60	4	240	10%	
	% Increase					35% value not to exceed 75%

Increase 5057.5 L/min

Lw = Length of the Exposed Wall

Ha = number of storeys of the adjacent structure (maximum 5 stories)

LH = Length-height factor of exposed wall. Value rounded up.

EC = Exposure Charge

Total Fire Flow

Fire Flow 12282.5 L/min fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
12000.0 L/min rounded to the nearest 1,000 L/min

Notes:

-Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.

-Calculations based on Fire Underwriters Survey - Part II

Boundary Conditions Unit Conversion

Connection1:

	Height (m)	Elevation (m)	m H ₂ O	PSI	kPa
Avg. DD	160.9	107.9	53.0	75.4	519.9
Fire Flow	147.2	107.9	39.3	55.9	385.5
Peak Hour	156.6	107.9	48.7	69.3	477.7

Connection 2:

	Height (m)	Elevation (m)	m H ₂ O	PSI	kPa
Avg. DD	160.9	108	52.9	75.3	518.9
Fire Flow	147.1	108	39.1	55.6	383.6
Peak Hour	156.6	108	48.6	69.1	476.8


Charlotte Kelly

From: Bougadis, John <John.Bougadis@ottawa.ca>
Sent: June 25, 2020 4:14 PM
To: Kuruvilla, Santhosh
Cc: Simard, Lyndsey
Subject: FW: 1919 Maple Grove Road - Boundary Condition Request
Attachments: 1919 Maple Grove Road_Boundary Conditions_24 June2020.docx

Hi Santhosh,

See attached. Comments:

- The City expects a future third connection from Phase 2 of 195 Huntmar (see below).
- The FUS calc is based on an apartment unit. The email from DSEL below states townhomes and semi-detached units (see highlighted text in email below).
- An isolation valve between connection 1 and 2 is required.

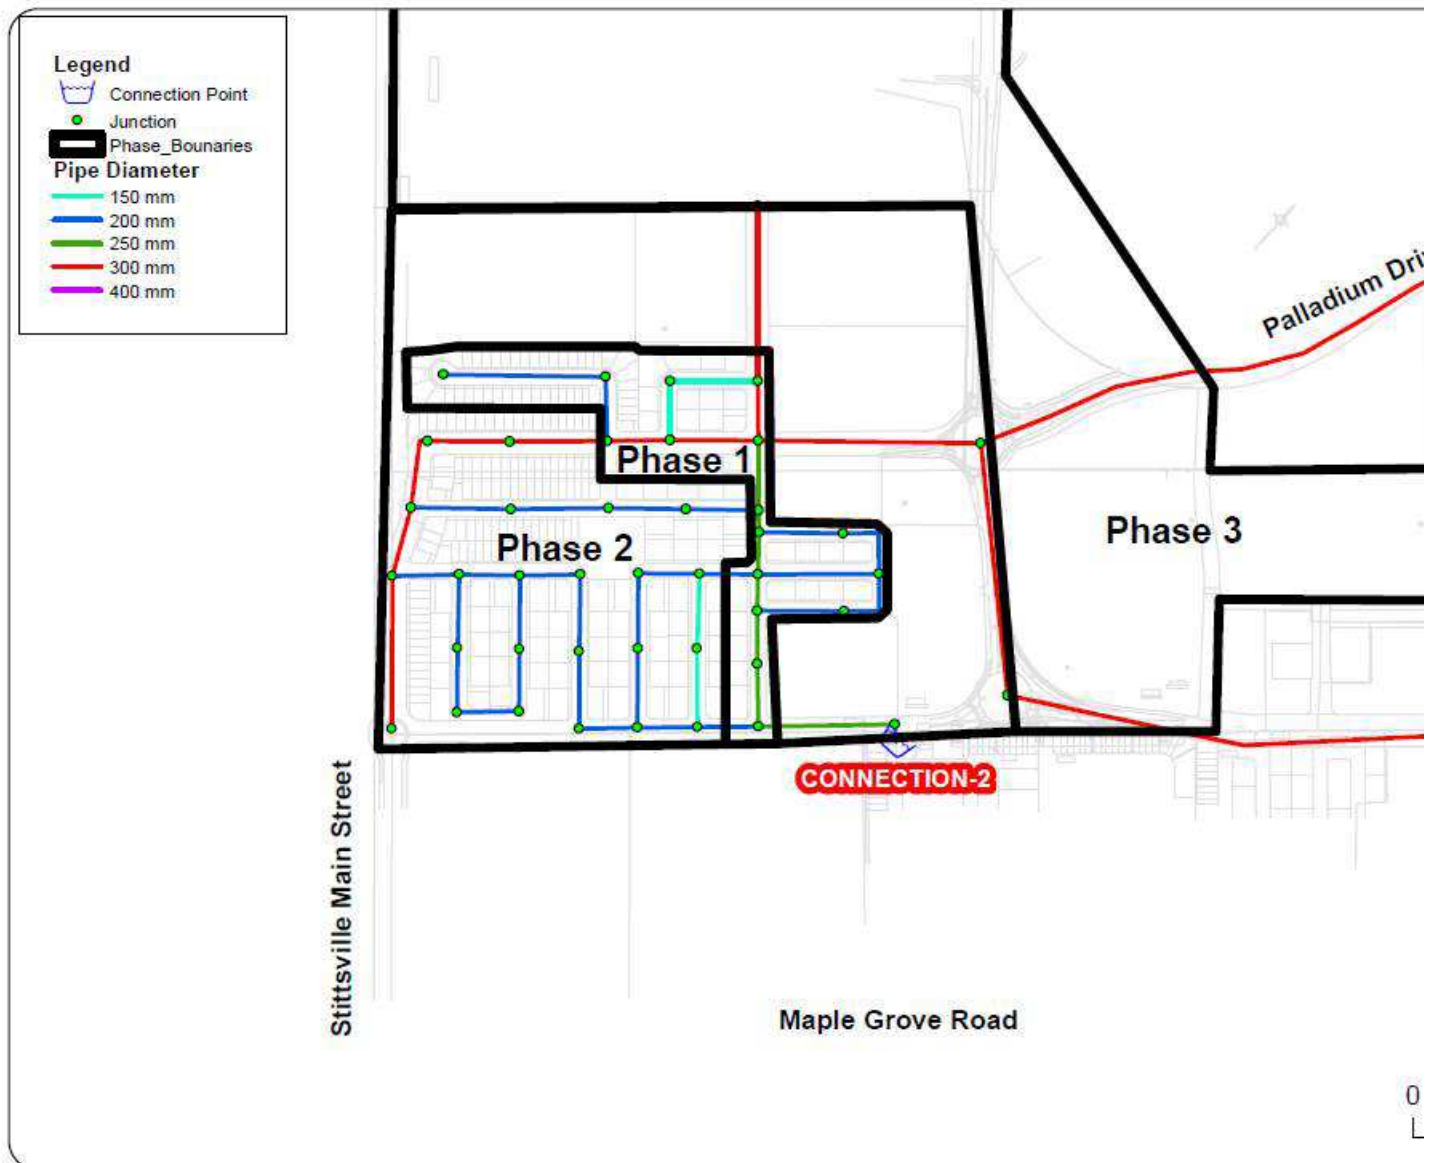

John
x14990

From: Simard, Lyndsey <lyndsey.simard@ottawa.ca>
Sent: June 24, 2020 12:25
To: Bougadis, John <John.Bougadis@ottawa.ca>
Subject: RE: 1919 Maple Grove Road - Boundary Condition Request

Hi John,

Please find the attached boundary conditions.

Cheers,

Lyndsey

From: Bougadis, John <John.Bougadis@ottawa.ca>
Sent: June 19, 2020 10:12
To: Simard, Lyndsey <lyndsey.simard@ottawa.ca>
Subject: FW: 1919 Maple Grove Road - Boundary Condition Request

John
x14990

From: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Sent: June 19, 2020 10:03
To: Bougadis, John <John.Bougadis@ottawa.ca>
Subject: FW: 1919 Maple Grove Road - Boundary Condition Request

Good morning John,

Please provide the boundary conditions for the subject application.

Thanks,

Santhosh

From: Charlotte Kelly <CKelly@dsel.ca>
Sent: June 19, 2020 9:01 AM
To: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Cc: Alison Gosling <AGosling@dsel.ca>
Subject: 1919 Maple Grove Road - Boundary Condition Request

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Good Morning Santhosh,

We would like to kindly request updated boundary conditions for the contemplated development at 1919 Maple Grove Road development using the following anticipated development demands:

1. Location of Service / Street Number: 1919 Maple Grove Road
2. Type of development and the amount of fire flow required for the contemplated development:
 - Type of development: The contemplated development includes 62 townhomes/semi-detached units and 450 residential units.
 - Contemplated Connections:
 - Dual Connection to the 305 mm diameter watermain within Maple Grove Road
 - Fire demand based on Technical Bulletin ISTB-2018-02 has been used to estimate a max fire demand of **19,000 L/min**. Refer to the attached for detailed calculations.

Demand	L/min	L/s
Avg. Daily	185.9	3.10
Max Day	464.7	7.75
Peak Hour	1022.4	17.04



Please let us know if you have any questions.

Thank-you,

Charlotte Kelly, E.I.T.
Junior Engineering Designer

DSEL

david schaeffer engineering ltd.

120 Iber Road, Unit 103
Stittsville, ON K2S 1E9

phone: (613) 836-0856 ext.511

email: ckelly@dse.ca

This email, including any attachments, is for the sole use of the intended recipient(s) and may contain private, confidential, and privileged information. Any unauthorized review, use, disclosure, or distribution is prohibited. If you are not the intended recipient, or if this information has been inappropriately forwarded to you, please contact the sender by reply email and destroy all copies of the original.

Boundary Conditions 1919 Maple Grove Road

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	186	3.10
Maximum Daily Demand	465	7.75
Peak Hour	1,022	17.04
Fire Flow Demand #1	19,020	317.00

Location



Results

Connection 1 – Maple Grove Rd.

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	160.9	75.4
Peak Hour	156.6	69.2
Max Day plus Fire 1	147.2	55.8

¹ Ground Elevation = 107.9 m

Connection 2 – Maple Grove Rd.

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	160.9	75.2
Peak Hour	156.6	69.0
Max Day plus Fire 1	147.1	55.5

¹ Ground Elevation = 108.0 m

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

Watermain Final Concept
Kanata West Master Servicing Study



Stantec Consulting Ltd.
 1505 Laperriere Avenue
 Ottawa ON Canada
 K1Z 7T1
 Tel. 613.722.4420
 Fax. 613.722.2799
 www.stantec.com

Stantec

Copyright Reserved

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec Consulting Ltd. without delay.
 The Copyrights to all designs and drawings are the property of Stantec Consulting Ltd. Reproduction or use for other than that authorized by Stantec Consulting Ltd. is forbidden.

Legend

- KANATA-WEST CONCEPT PLAN BOUNDARY
- EXISTING WATERMAIN
- - - EXISTING 610mm WATERMAIN TO BE UPGRADED TO 914mm
- - - EXISTING 610mm WATERMAIN TO BE UPGRADED TO 762mm
- PROPOSED 610mm DIA. WATERMAIN
- PROPOSED 406mm DIA. WATERMAIN
- PROPOSED 305mm DIA. WATERMAIN
- PROPOSED 203mm DIA. WATERMAIN

Notes

INTERNAL WATERMAIN SIZE ARE EXPECTED TO VARY FROM 152mm TO 305mm.

CCCL/IBI
CONSULTANTS

5	REVISED FOR DEC.21/05 SUBMISSION	GBU	SJP	DEC.21/05
4	REVISED AS PER CITY COMMENTS (Sept.16/05)	GBU	MAF	OCT.28/05
3	REVISED WATER DISTRIBUTION NETWORK	GBU	S.J.P.	AUG. 09/05
2	REVISED POND 1 AREA	IBI	MAF	JUNE 09/05
1	REVISED LOTTING FOR TARTAN AND MATTAMY	ECB	SJP	JAN.18/05
Revision		By	Appd.	Date

File Name:	Des.	Chk'd.	Dgn.	Date
------------	------	--------	------	------

Seals

Client/Project

Kanata West Concept Plan
 Master Servicing Study

Ottawa, Ontario

Title

Watermain
 Final Concept

Project No.
 00400406



Drawing No.

Sheet 2 of 7

Revision

WM-1


2 of 7

5



M:\Projects\00400406\00400406_01\00400406_01.dwg (Plot: 03.dwg)
 2005-12-16 09:09:40 1/8" plot

CITY OF OTTAWA - WATER DISTRIBUTION SYSTEM

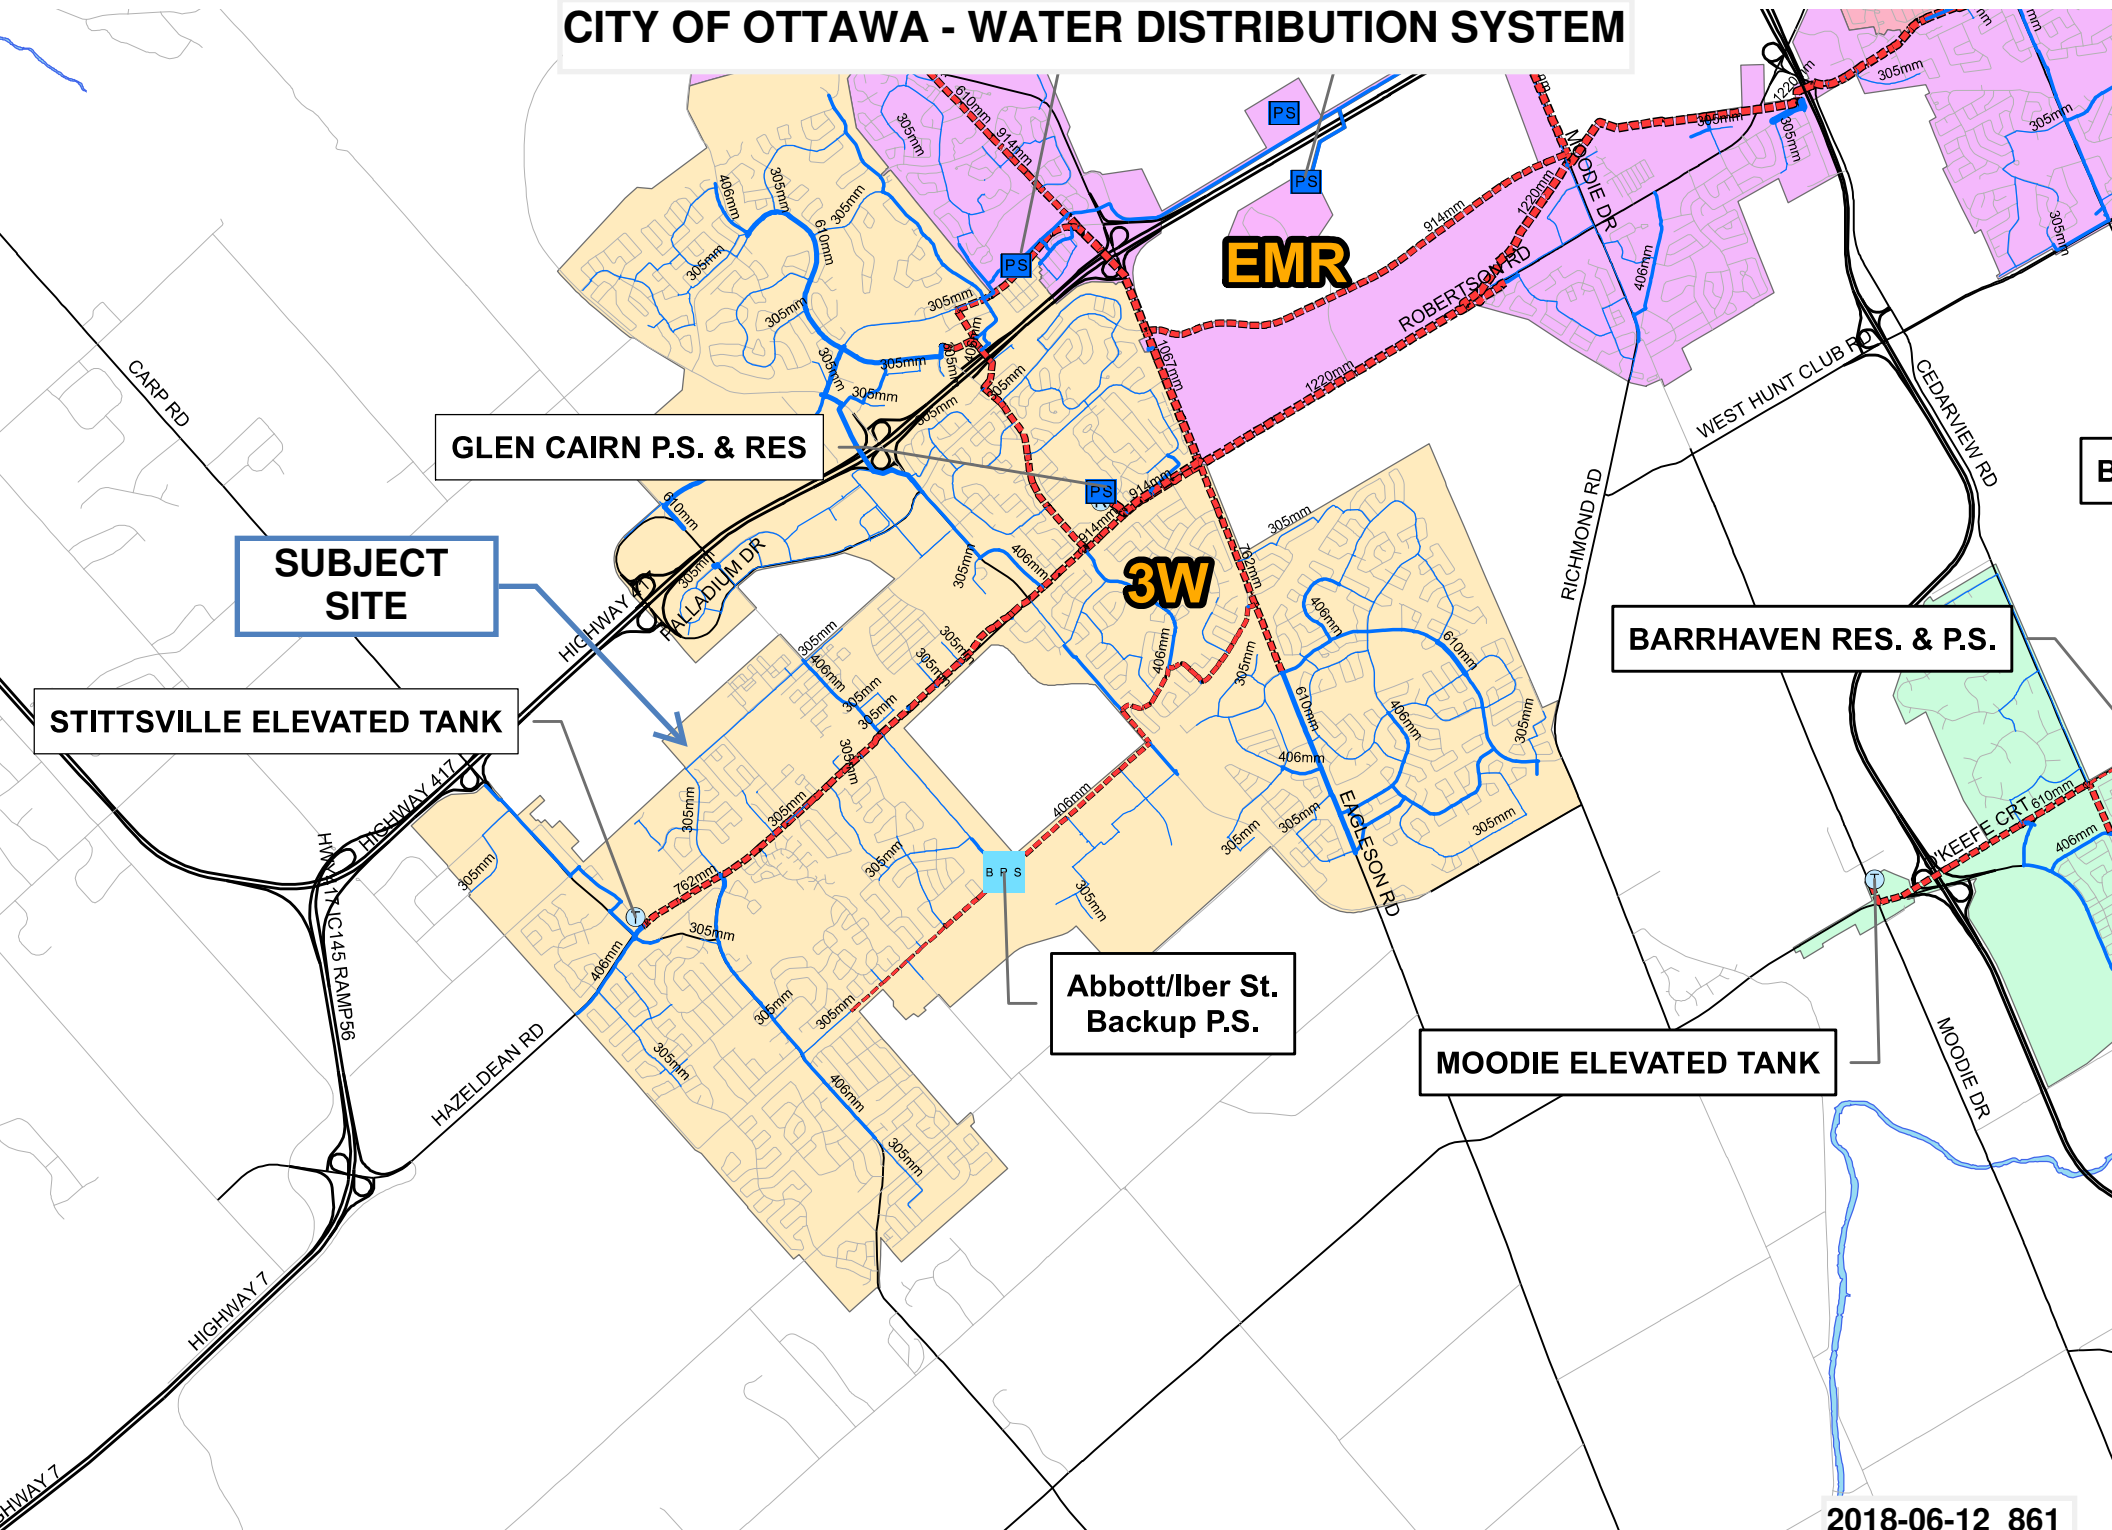

APPENDIX C

Wastewater Collection

Wastewater Design Flows per Unit Count
City of Ottawa Sewer Design Guidelines, 2004



Site Area 6.730 ha

Extraneous Flow Allowances

Infiltration / Inflow (Dry)	0.34 L/s
Infiltration / Inflow (Wet)	1.88 L/s
Infiltration / Inflow (Total)	2.22 L/s

Domestic Contributions

Unit Type	Unit Rate	Units	Pop
Single Family	3.4	1	4
Semi-detached and duplex	2.7		0
Townhouse	2.7		0
Stacked Townhouse	2.3		0
Apartment			
Bachelor	1.4		0
1 Bedroom	1.4		0
2 Bedroom	2.1		0
3 Bedroom	3.1		0
Average	1.8		0

Total Pop 4

Average Domestic Flow 0.01 L/s

Peaking Factor 3.76

Peak Domestic Flow 0.05 L/s

Institutional / Commercial / Industrial Contributions

Property Type	Unit Rate	No. of Units	Avg Wastewater (L/s)
Commercial floor space*	5 L/m ² /d		0.00
Hospitals	900 L/bed/d		0.00
School	70 L/student/d		0.00
Industrial - Light**	35,000 L/gross ha/d		0.00
Industrial - Heavy**	55,000 L/gross ha/d		0.00

Average I/C/I Flow 0.00

Peak Institutional / Commercial Flow 0.00

Peak Industrial Flow** 0.00

Peak I/C/I Flow 0.00

* assuming a 12 hour commercial operation

** peak industrial flow per City of Ottawa Sewer Design Guidelines Appendix 4B

Total Estimated Average Dry Weather Flow Rate	0.35 L/s
Total Estimated Peak Dry Weather Flow Rate	0.39 L/s
Total Estimated Peak Wet Weather Flow Rate	2.27 L/s

Wastewater Design Flows per Unit Count
City of Ottawa Sewer Design Guidelines, 2004



Site Area 6.730 ha

Extraneous Flow Allowances

Infiltration / Inflow (Dry)	0.34 L/s
Infiltration / Inflow (Wet)	1.88 L/s
Infiltration / Inflow (Total)	2.22 L/s

Domestic Contributions

Unit Type	Unit Rate	Units	Pop
Single Family	3.4		0
Semi-detached and duplex	2.7	18	49
Townhouse	2.7	44	119
Stacked Townhouse	2.3		0
Apartment			
Bachelor	1.4		0
1 Bedroom	1.4	225	315
2 Bedroom	2.1	225	473
3 Bedroom	3.1		0
Average	1.8		0

Total Pop 956

Average Domestic Flow 3.10 L/s

Peaking Factor 3.25

Peak Domestic Flow 10.07 L/s

Institutional / Commercial / Industrial Contributions

Property Type	Unit Rate	No. of Units	Avg Wastewater (L/s)
Commercial floor space*	5 L/m ² /d		0.00
Hospitals	900 L/bed/d		0.00
School	70 L/student/d		0.00
Industrial - Light**	35,000 L/gross ha/d		0.00
Industrial - Heavy**	55,000 L/gross ha/d		0.00

Average I/C/I Flow 0.00

Peak Institutional / Commercial Flow 0.00

Peak Industrial Flow** 0.00

Peak I/C/I Flow 0.00

* assuming a 12 hour commercial operation

** peak industrial flow per City of Ottawa Sewer Design Guidelines Appendix 4B

Total Estimated Average Dry Weather Flow Rate	3.43 L/s
Total Estimated Peak Dry Weather Flow Rate	10.41 L/s
Total Estimated Peak Wet Weather Flow Rate	12.29 L/s

SANITARY SEWER CALCULATION SHEET

CLIENT: **Formasian Development Corp.**
 LOCATION: **1919 Maple Grove Road**
 FILE REF: **16-861**
 DATE: **11-Aug-20**

DESIGN PARAMETERS

Avg. Daily Flow Res.	280 L/p/d	Peak Fact. Res. Per Harmons: Min = 2.0, Max =4.0	Infiltration / Inflow	0.33 L/s/ha	
Avg. Daily Flow Comm	28,000 L/ha/d	Peak Fact. Comm.	1.5	Min. Pipe Velocity	0.60 m/s full flowing
Avg. Daily Flow Instit.	28,000 L/ha/d	Peak Fact. Instit.	1.5	Max. Pipe Velocity	3.00 m/s full flowing
Avg. Daily Flow Indust.	35,000 L/ha/d	Peak Fact. Indust. per MOE graph		Mannings N	0.013



Area ID	Location		Residential Area and Population									Commercial		Institutional		Industrial		Infiltration				Pipe Data									
	Up	Down	Area	Number of Units				Pop.	Cumulative		Peak	Q _{res}	Area	Accu.	Area	Accu.	Area	Accu.	Q _{CHH}	Total	Accu.	Infiltration	Total	DIA	Slope	Length	A _{hydraulic}	R	Velocity	Q _{cap}	Q / Q full
			(ha)	Singles	Semi's	Town's	Apt's	Area	Pop.	Fact.	(-)	(L/s)	(ha)	(ha)	(ha)	(ha)	(ha)	(ha)	(L/s)	(ha)	(ha)	(L/s)	(L/s)	(mm)	(%)	(m)	(m ²)	(m)	(m/s)	(L/s)	(-)
Hazeldean/Huntmar Trunk Sewer	11	12	113.140	1881				6395.0	113.140	6395.0	3.14	65.16	33.50	33.50		0.00	3.44	3.44	31.9	164.210	164.210	45.979	143.01	675	0.40	775.0	0.358	0.169	1.55	554.8	0.26
Maple Grove Road Trunk Sewer	12	10	33.730	939				3193.0	146.870	9588.0	2.97	92.37	10.89	44.39		0.00	17.61	21.05	55.6	62.230	226.440	63.403	211.36	750	0.20	950.0	0.442	0.188	1.13	497.9	0.42
Maple Grove Road Trunk Sewer	10	10A	36.130	899				3057.0	183.000	12645.0	2.85	116.91		44.39		0.00	12.15	33.20	65.4	48.280	274.720	76.922	259.26	825	0.20	1000.0	0.535	0.206	1.20	641.9	0.40
Carp River Trunk Sewer	13	10A	38.720	1162				3951.0	38.720	3951.0	3.34	42.74		44.39		0.00	20.24	53.44	81.8	58.960	58.960	16.509	141.08	600	0.25	1000.0	0.283	0.150	1.09	307.0	0.46
		10A						0.0	0.000	0.0	4.00	0.00	0.75	0.75		0.00		0.00	0.7	0.750	0.750	0.210	0.86	250	0.35	100.0	0.049	0.063	0.72	35.2	0.02
	10A	KWPS						0.0	0.000	0.0	4.00	0.00		0.00		0.00		0.00	0.0		334.430	93.640	755.57	1050	0.20	30.0	0.866	0.263	1.47	1273.7	0.59

SANITARY SEWER CALCULATION SHEET

CLIENT: **Formasian Development Corp.**
 LOCATION: **1919 Maple Grove Road**
 FILE REF: **16-861**
 DATE: **12-Jun-18**

DESIGN PARAMETERS



Avg. Daily Flow Res.	350 L/p/d	Peak Fact Res. Per Harmon: Min = 2.0, Max =4.0	Infiltration / Inflow	0.28 L/s/ha	
Avg. Daily Flow Comm	50,000 L/ha/d	Peak Fact. Comm.	1.5	Min. Pipe Velocity	0.60 m/s full flowing
Avg. Daily Flow Instit.	50,000 L/ha/d	Peak Fact. Instit.	1.5	Max. Pipe Velocity	3.00 m/s full flowing
Avg. Daily Flow Indust.	35,000 L/ha/d	Peak Fact. Indust. per MOE graph		Mannings N	0.013



Location			Residential Area and Population										Commercial				Institutional		Industrial		Infiltration				Pipe Data								
Area ID	Up	Down	Area	Number of Units by type				Pop.	Cumulative	Peak.	Q _{res}	Area	Accu.	Area	Accu.	Area	Accu.	Q _{C+I}	Total	Accu.	Infiltration	Total	DIA	Slope	Length	A _{hydraulic}	R	Velocity	Q _{cap}	Q / Q full	Q _{res}		
			(ha)	Singles	Semi's	Town's	Apt's		(ha)	Pop.	Fact.	(-)	(L/s)	(ha)	(ha)	(ha)	(ha)	(ha)	(ha)	(L/s)	(ha)	(ha)	(L/s)	(L/s)	(mm)	(%)	(m)	(m ²)	(m)	(m/s)	(L/s)	(-)	(L/s)
Maple Grove																																	
Road Trunk Sewer	9	10	102.660	2823				9598.0	102.660	9598.0	2.97	115.57			0.00		0.00	0.0	102.660	102.660	28.745	144.31	600	0.40	775.0	0.283	0.150	1.37	388.3	0.37	244.0		
	10	10A	220.460	4881				16595.0	323.120	26193.0	2.54	269.03	45.14	45.14	0.00	53.44	53.44	82.5	333.170	435.830	122.032	473.54	825	0.20	1000.0	0.535	0.206	1.20	641.9	0.74	168.4		
	10A	KWPS						0.0	323.120	26193.0	2.54	269.03	45.14		0.00		53.44	82.5	0.000	435.830	122.032	473.54	1050	0.20	30.0	0.866	0.263	1.41	1221.2	0.39	747.7		

Preferred Waste-Water Master Servicing Study

Kanata West Master Servicing Study

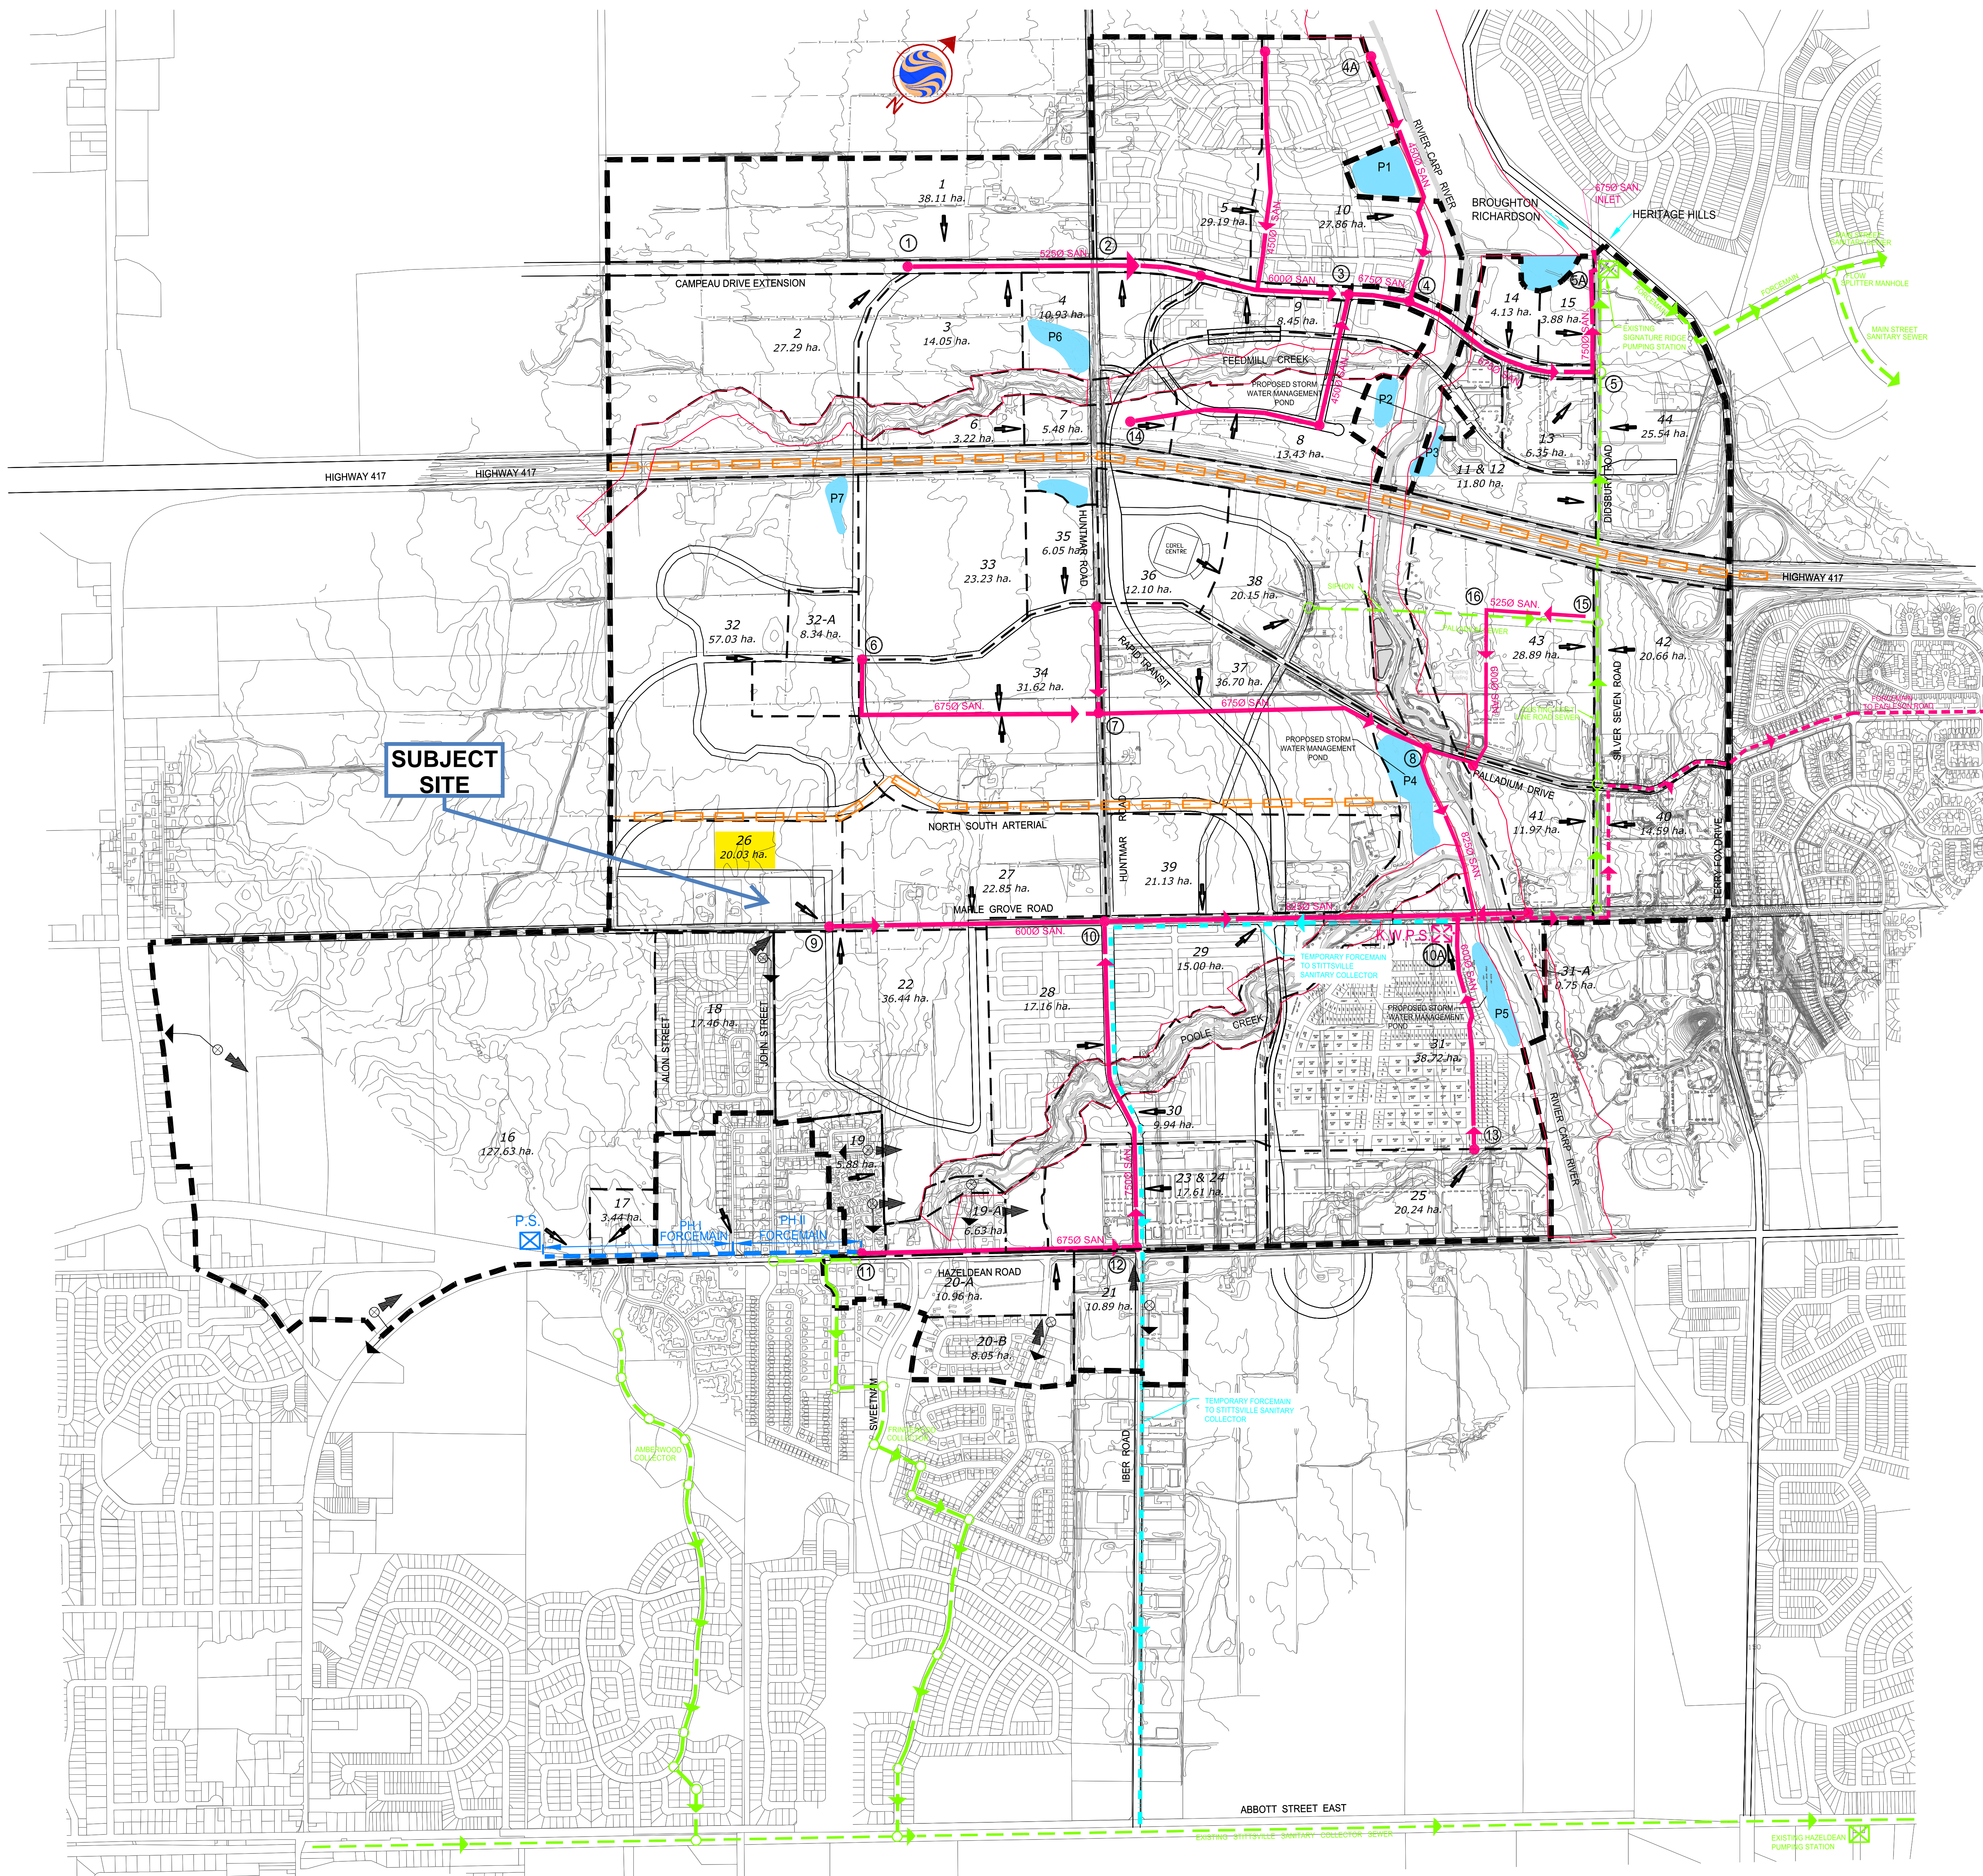

Stantec Consulting Ltd.
1505 Laperriere Avenue
Ottawa ON Canada
K1Z 7T1
Tel. 613.722.4420
Fax. 613.722.2799
www.stantec.com

Stantec

Copyright Reserved
The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec Consulting Ltd. without delay.
The Copyrights to all designs and drawings are the property of Stantec Consulting Ltd. Reproduction or use for other than that authorized by Stantec Consulting Ltd. is forbidden.



1770 WOODBINE DR., OTTAWA (613)225-1311

Legend

- ULTIMATE MAJOR DRAINAGE LIMIT
- SUBCATCHMENT AREAS
- PROPOSED TRUNK SEWER
- PROPOSED FORCEMAIN
- TEMPORARY FORCEMAIN
- PROPOSED STITTSVILLE PUMPING STATION AND FORCEMAIN
- EXISTING TRUNK SEWER
- MAJOR DRAINAGE SPLIT
- NODES
- EXISTING PUMPING STATION AND FORCEMAIN (TO BE DECOMMISSIONED)
- INPUT POINT AND AREA IN HECTARES
- EXISTING PUMPING STATION GRAVITY OUTLET

5	REVISED FOR DEC.21/05 SUBMISSION	G.B.U.	S.J.P.	05/12/21	
4	REVISED TRUNK SEWER FROM 16 TO KWPS	R.W.W.	R.W.W.	05/10/05	
3	ARROWS FOR EXIST. PUMP STATIONS ADDED	R.W.W.	R.W.W.	05/08/09	
2	REPORT JUNE 2005	R.W.W.	R.W.W.	05/06/07	
1	REPORT APR. 2005	R.W.W.	R.W.W.	05/04/20	
Revision		By	Appd.	Date	
File Name:		Dwn.	Chkd.	Degn.	Date


Client/Project
**Kanata West Concept Plan
Master Servicing Study**
Ottawa, Ontario
Title
**Preferred Waste-Water
Option**

Project No. 60400406
Drawing No. Sheet Revision
Scale 1:7500
Scale bar: 0, 75, 225, 375m

A:\04-024\Kanata West\04000406\Master Servicing\Drawings\05010406-04-27\Main_Kanata West_Dwg_S-1-04-06.dwg
 Last Modified By: s.jones Date: Sep 27, 2006 8:37:00am

KWMSS Drainage Allocations

Stantec Consulting Ltd.

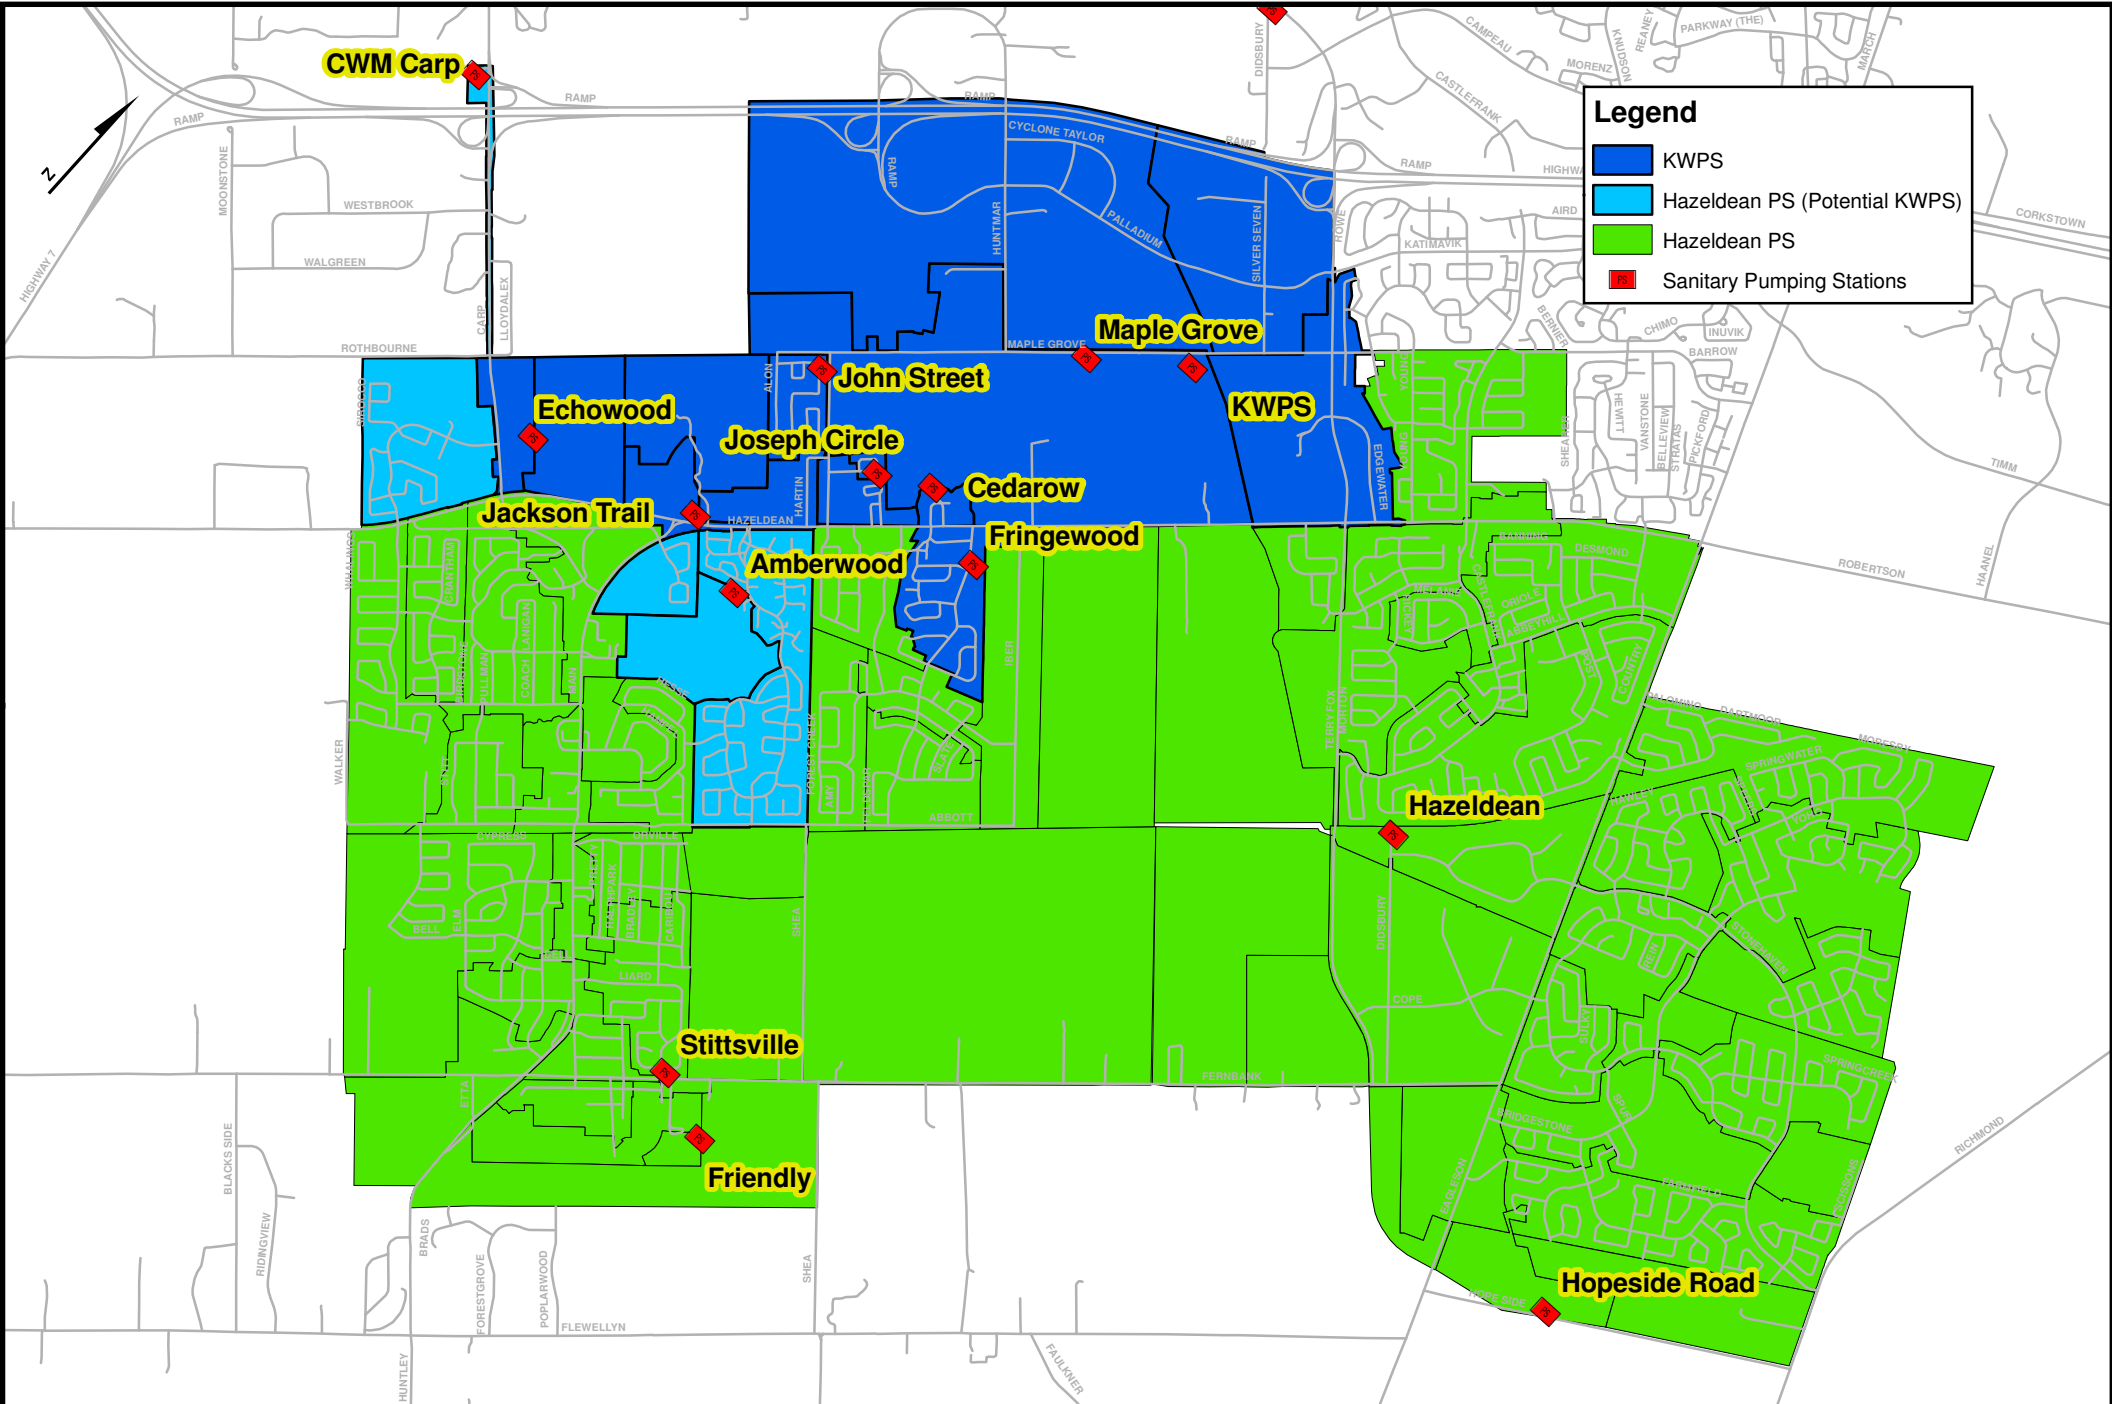


Legend

- KWPS
- Hazeldean PS (Potential KWPS)
- Hazeldean PS
- 25 Sanitary Pumping Stations




1:40,000




Client/Project City of Ottawa
WUCWC (1634-01026)
Figure No. 2
Title KWMSS Drainage Allocations

Sanitary Drainage Plan (Project No. 10-451)
Reconstruction of Maple Grove Road

David Schaeffer Engineering

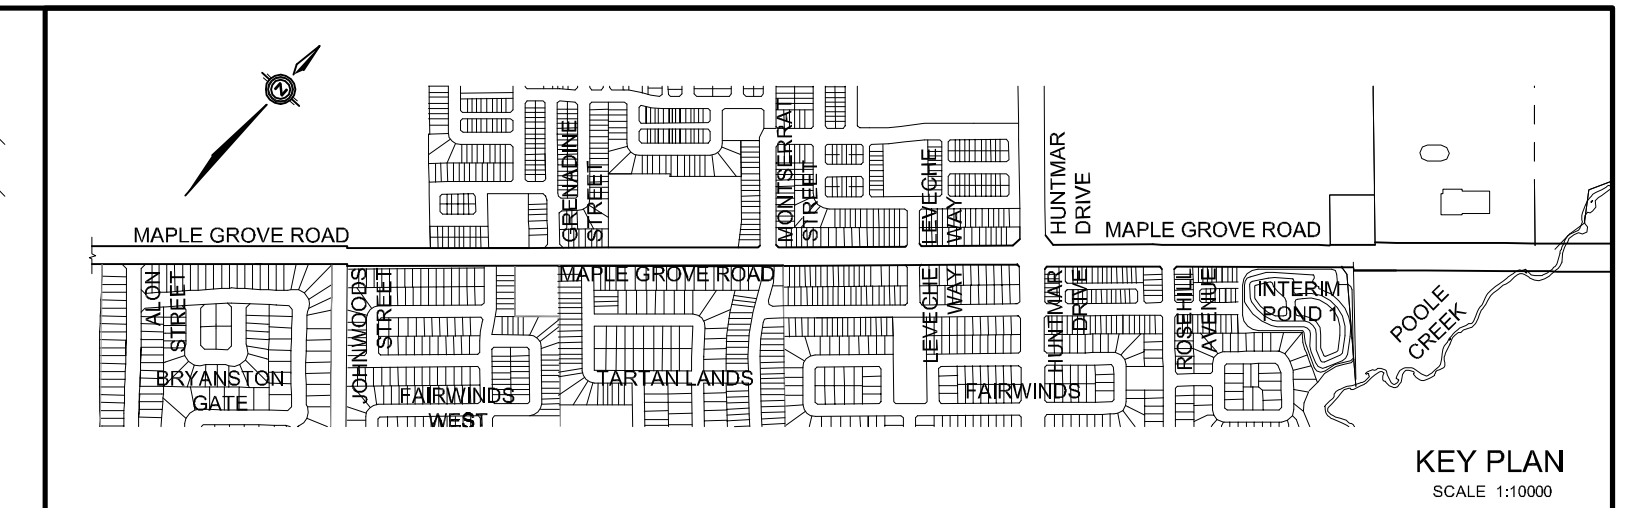

SUBJECT SITE

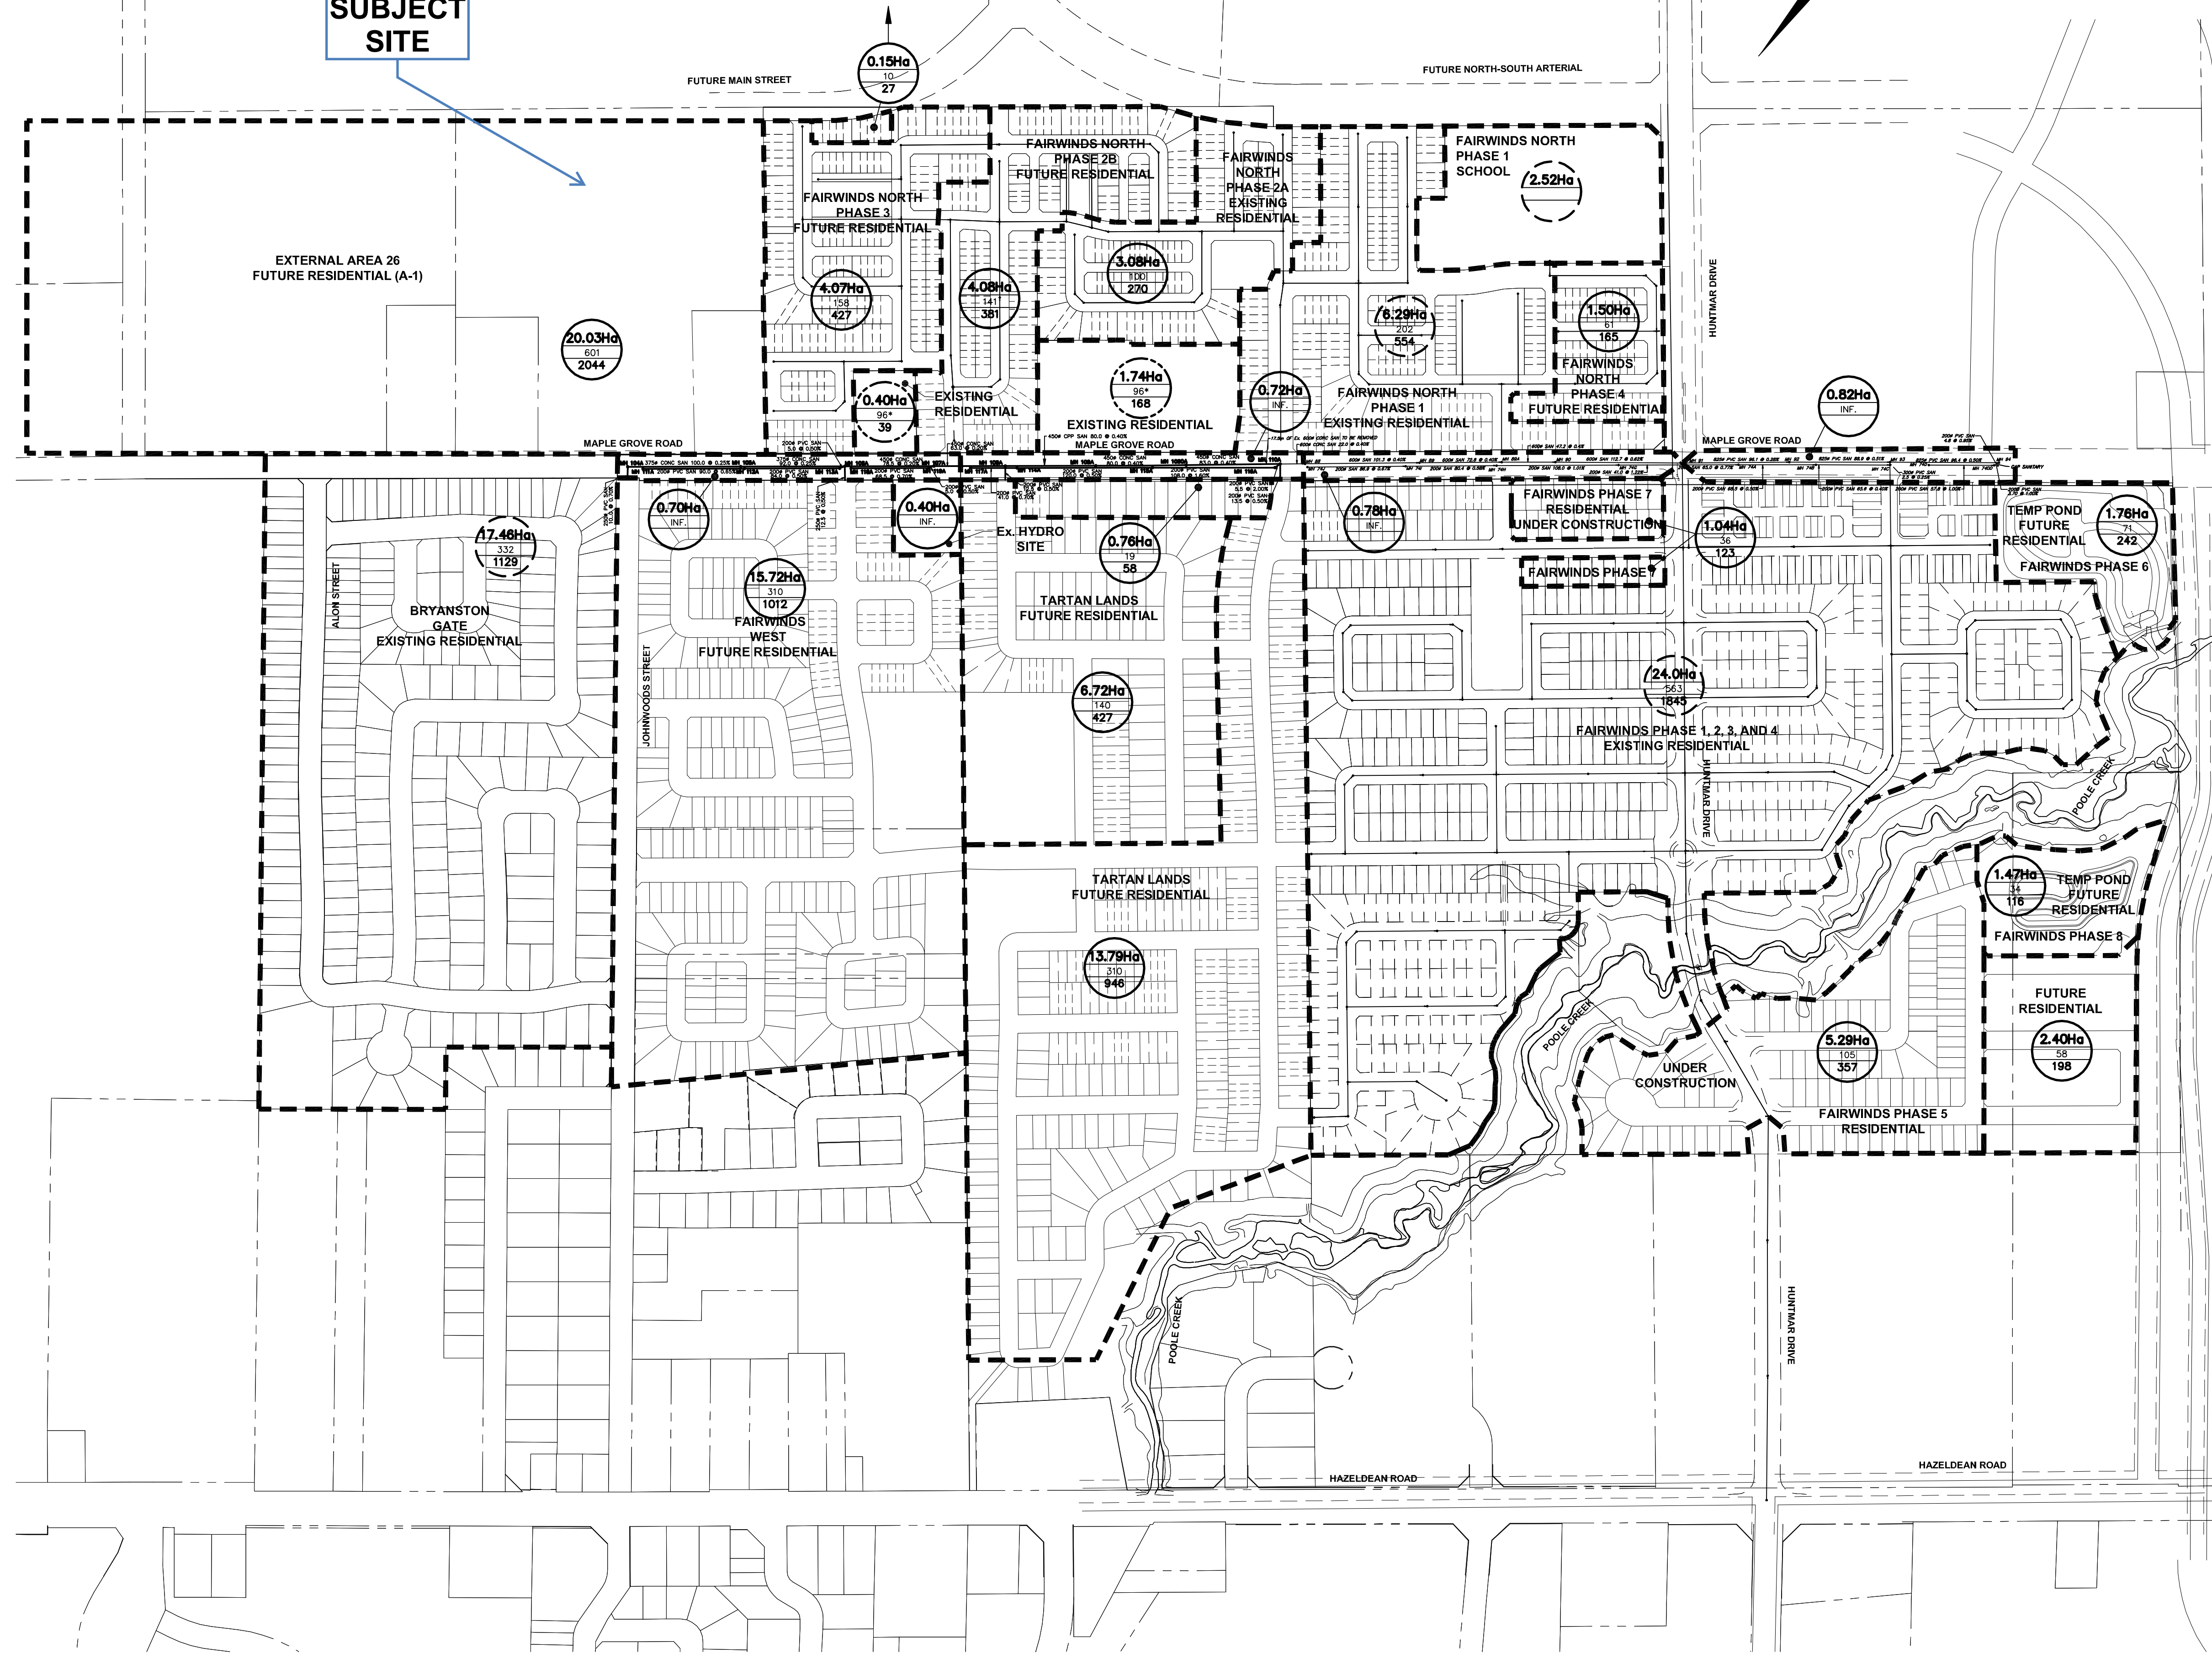

LEGEND

	0.82Ha 29 111	DRAINAGE AREA IN HECTARES UNIT NUMBER POPULATION (3.4 PERSON PER UNIT FOR SINGLE HOUSE), (2.7 PERSON PER UNIT FOR TOWNHOUSE).
	0.40Ha 96 39	EXISTING DRAINAGE AREA IN HECTARES DENSITY (PERSONS PER HA) POPULATION
	0.82Ha 111	EXTERNAL DRAINAGE AREA IN HECTARES POPULATION
		SANITARY SEWER TRIBUTARY BOUNDARY
		SANITARY TRIBUTARY SUB-CATCHMENT BOUNDARY

TOPOGRAPHIC INFORMATION
 TOPOGRAPHIC INFORMATION PROVIDED BY J.D. BARNES LIMITED,
 PROJECT No. 05-10-459-02, SURVEY DATED JULY 6, 2011 AND
 PROJECT No. 0X-10-628-02, SURVEY DATED NOVEMBER 27, 2008 AND
 PROJECT No. 06-10-561-01-00, SURVEY DATED FEBRUARY 24, 2008 AND
 PROJECT No. 06-10-628-00, SURVEY DATED MARCH 29, 2007.

TOPOGRAPHIC INFORMATION PROVIDED BY STANTEC CONSULTING LIMITED AND
 WEBSTER & SIMMONDS SURVEYING LIMITED, FILE No. 161610660-111
 RECEIVED ON DECEMBER 1, 2006.

LEGAL INFORMATION
 CALCULATED R-PLAN PROVIDED BY J.D. BARNES LIMITED,
 PROJECT No. 07-10-820-00, SURVEY DATED MAY 30, 2012.

BENCH MARK No. 0011988U502
 TOWNSHIP: TRITTSVILLE
 CONCRETE CULVERT ALONG HAZELDEAN ROAD, 1.3 KM NE OF ROAD INTERSECTION WITH MAIN ST NORTH, BRASS
 CAP SET ON TOP OF CONC CULVERT, SOUTH SIDE OF THE ROAD, 30 CM WEST OF EASTERLY EXTREMITY, 30 CM
 NORTH OF THE SOUTH FACE, SLIGHTLY BELOW ROAD LEVEL.
 ELEVATION = 106.039 m

No.	BY	DATE	DESCRIPTION	BY
5	Z.L.	13-01-04	REVISED SANITARY BETWEEN MH'S 105A-107A, 112A-106A, 115A-116A, 118A-119A	
4	Z.L.	12-05-31	4th SUBMISSION	
3	Z.L.	12-04-13	3rd SUBMISSION	
2	Z.L.	12-02-14	2nd SUBMISSION	
1	Z.L.	11-08-02	1st SUBMISSION	



PROJECT No. 10-451

SANITARY DRAINAGE PLAN
 © DSEL

MATTAMY (FAIRWINDS NORTH) LIMITED
 RECONSTRUCTION OF MAPLE GROVE ROAD

DSEL
 david schaeffer engineering ltd
 120 Ilex Road, Unit 203
 Stittsville, ON K2S 1E9
 Tel. (613) 836-0856
 Fax. (613) 836-7163
 www.DSEL.ca


DRAWN BY: W.L./C.M.	CHECKED BY: K.M.	DRAWING NO.	SHEET NO.
DESIGNED BY: K.M.	CHECKED BY: Z.L.		6
SCALE: 1:3000	DATE: JULY 2011		

SANITARY SEWER CALCULATION SHEET



Manning's n=0.013

LOCATION			RESIDENTIAL AREA AND POPULATION						COMM		INDUST		INSTIT		C+H		INFILTRATION				PIPE							
STREET	FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE		PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL.		
						AREA (ha)	POP.																			(FULL) (m/s)	(ACT.) (m/s)	
MAPLE GROVE ROAD																												
			20.03	601	2044	20.03	2044										20.03	20.03										
	104A	105A	17.46	332	1129	37.49	3173	3.42	43.96								17.46	37.49	10.497	54.46	100.0	375	0.25	87.67	0.62	0.79	0.83	
	105A	106A	0.70	0	0	38.19	3173	3.42	43.96								0.70	38.19	10.693	54.65	101.0	375	0.25	87.67	0.62	0.79	0.83	
			0.40		39	38.59	3212										0.40	38.59										
			0.40	0	0	38.99	3212										0.40	38.99										
	106A	107A	15.72	310	1012	54.71	4224	3.31	56.64								15.72	54.71	15.319	71.96	70.0	450	0.20	127.50	0.56	0.80	0.82	
	107A	108A	0.72	0	0	55.43	4224	3.31	56.64								0.72	55.43	15.520	72.16	63.0	450	0.20	127.50	0.57	0.80	0.82	
	108A	109A	6.72	140	427	62.15	4651	3.27	61.61								6.72	62.15	17.402	79.01	80.0	450	0.40	180.32	0.44	1.13	1.09	
	109A	1090A	1.74		168	63.89	4819	3.26	63.64								1.74	63.89	17.889	81.53	80.0	450	0.40	180.32	0.45	1.13	1.10	
	1090A	110A				63.89	4819	3.26	63.64								0.00	63.89	17.889	81.53	83.0	450	0.40	180.32	0.45	1.13	1.10	
			0.76	19	58	64.65	4877										0.76	64.65										
	110A	Ex. 88	13.79	310	946	78.44	5823	3.18	75.01								13.79	77.68	21.750	96.76	22.0	600	0.40	388.33	0.25	1.37	1.14	
	Ex. 88	Ex. 89	0.78	0	0	79.22	5823	3.18	75.01								0.78	78.46	21.969	96.98	101.3	600	0.40	388.33	0.25	1.37	1.14	
			4.07	158	427	83.29	6250										4.07	82.53										
			4.08	141	381	87.37	6631										4.08	86.61										
			3.08	100	270	90.45	6901										3.08	89.69										
			2.52			92.97	6901																					
			6.29	202	554	99.26	7455										6.29	95.98										
	Ex. 89	Ex. 89A	1.50	61	165	100.76	7620	3.07	94.76								1.50	97.48	27.294	122.05	72.8	600	0.40	388.33	0.31	1.37	1.21	
	Ex. 89A	Ex. 90				100.76	7620	3.07	94.76								0.00	97.48	27.294	122.05	47.2	600	0.40	388.33	0.31	1.37	1.21	
	Ex. 90	Ex. 91				100.76	7620	3.07	94.76								0.00	97.48	27.294	122.05	112.7	600	0.62	483.47	0.25	1.71	1.42	
			0.82	0	0	101.58	7620										0.82	98.30										
			1.04	36	123	102.62	7743										1.04	98.52										
			1.76	71	242	104.38	7985										1.76	100.28										
			24.00	563	1845	128.38	9830										24.00	124.28										
			2.40	58	198	130.78	10028										2.40	126.68										
			5.29	105	357	136.07	10385										5.29	131.97										
	Ex. 91	Ex. 92	1.47	34	116	137.54	10501	2.93	124.64								1.47	133.44	37.363	162.00	96.1	825	0.28	759.56	0.21	1.42	1.12	
	Ex. 92	Ex. 93				137.54	10501	2.93	124.64								0.00	133.44	37.363	162.00	88.9	825	0.51	1025.11	0.16	1.92	1.39	
	Ex. 93	Ex. 94				137.54	10501	2.93	124.64								0.00	133.44	37.363	162.00	96.4	825	0.50	1015.01	0.16	1.90	1.39	

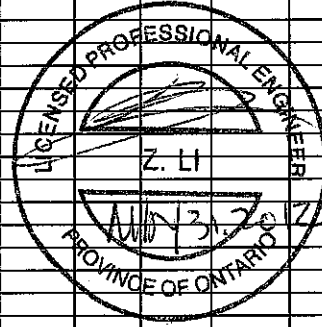

DESIGN PARAMETERS				Designed: K.M.				PROJECT: RECONSTRUCTION OF MAPLE GROVE ROAD							
Average Daily Flow = 350 l/p/day				Industrial Peak Factor = as per MOE Graph				Checked: Z.L.				LOCATION: City of Ottawa			
Commercial/Institution Flow = 50000 L/ha/da				Extraneous Flow = 0.280 L/s/ha				Dwg. Reference: Sanitary Drainage Plan, Dwg. No. 6				File Ref: 10-451			
Industrial Flow = 35000 L/ha/da				Minimum Velocity = 0.760 m/s				Date: May, 2012				Sheet No. 1 of 1			
Max Res. Peak Factor = 4.00				Manning's n = 0.013											
Commercial/Institution peak Factor = 1.50				Townhouse coeff= 2.7											
				Single house coeff= 3.4											

Economy (E) 25%

The reconstruction of the Signature Ridge Pumping Station is significantly more than the costs to upgrade the existing station.

Caring and Healthy Community (CHC) 25%

In terms of the impact on the Community, there are no significant differences between the two alternatives.

Natural Environment (NE) 14%

There are no significant differences between the two options with respect to impacts to the natural environment. Both alternatives require the construction of an emergency overflow to the Carp River. Impacts to surface water quality as a result of potential station overflows during an emergency situation are not expected to occur. Should an overflow occur for either alternative, the impacts would be mitigated by a SWM pond. Increases in CO₂ emissions as a result of the use of diesel generators during power failures or maintenance procedures will be negligible and are similar in both alternatives.

4.2.6.3 Selection of Preferred Signature Ridge Pumping Station Alternative

Based on the above evaluation, the Signature Ridge Pumping Station Alternative I, station upgrade, is selected as the preferred alternative. This alternative maximizes the use of existing infrastructure and offers the most flexibility in phasing of the works with the least amount of capital expenditure or impacts.

4.2.6.4 Summary

The preferred alternatives selected for the wastewater outlet, the internal servicing system, the temporary forcemain, the trunk sewer alignment, and the Signature Ridge Pumping Station have been used to develop a comprehensive wastewater servicing plan for the KWCP. This servicing plan is discussed in future detail in the following section of this report.


4.3 Preferred Sanitary Sewer Servicing Plan

Section 4.2 has detailed the selection of preferred alternatives for the major infrastructure required to provide sanitary sewer service to the KWCP. These preferred alternatives have been used to develop a Master Sanitary Servicing Plan for the area. This plan is illustrated on **Drawing S-1** (appended to this report). The major features of this plan are:

- (i.) An upgraded Signature Ridge Pumping Station (SRPS) to service all the KWCP lands north of the Queensway, the existing urban area north of the Queensway currently proposed to drain to the SRPS, and the Broughton/Richardson Interstitial lands. A spreadsheet detailing the exact areas and flows tributary to the SRPS is included in **Figure 4.2-1**.

The 400 l/sec peak flow capacity identified in **Figure 4.2-1** for the upgraded SRPS, is consistent with the findings of the R.V. Anderson Report titled "Signature Ridge Pumping Station Upgrades Feasibility Study".

SIGNATURE RIDGE PUMPING STATION LOCATION LOCATION

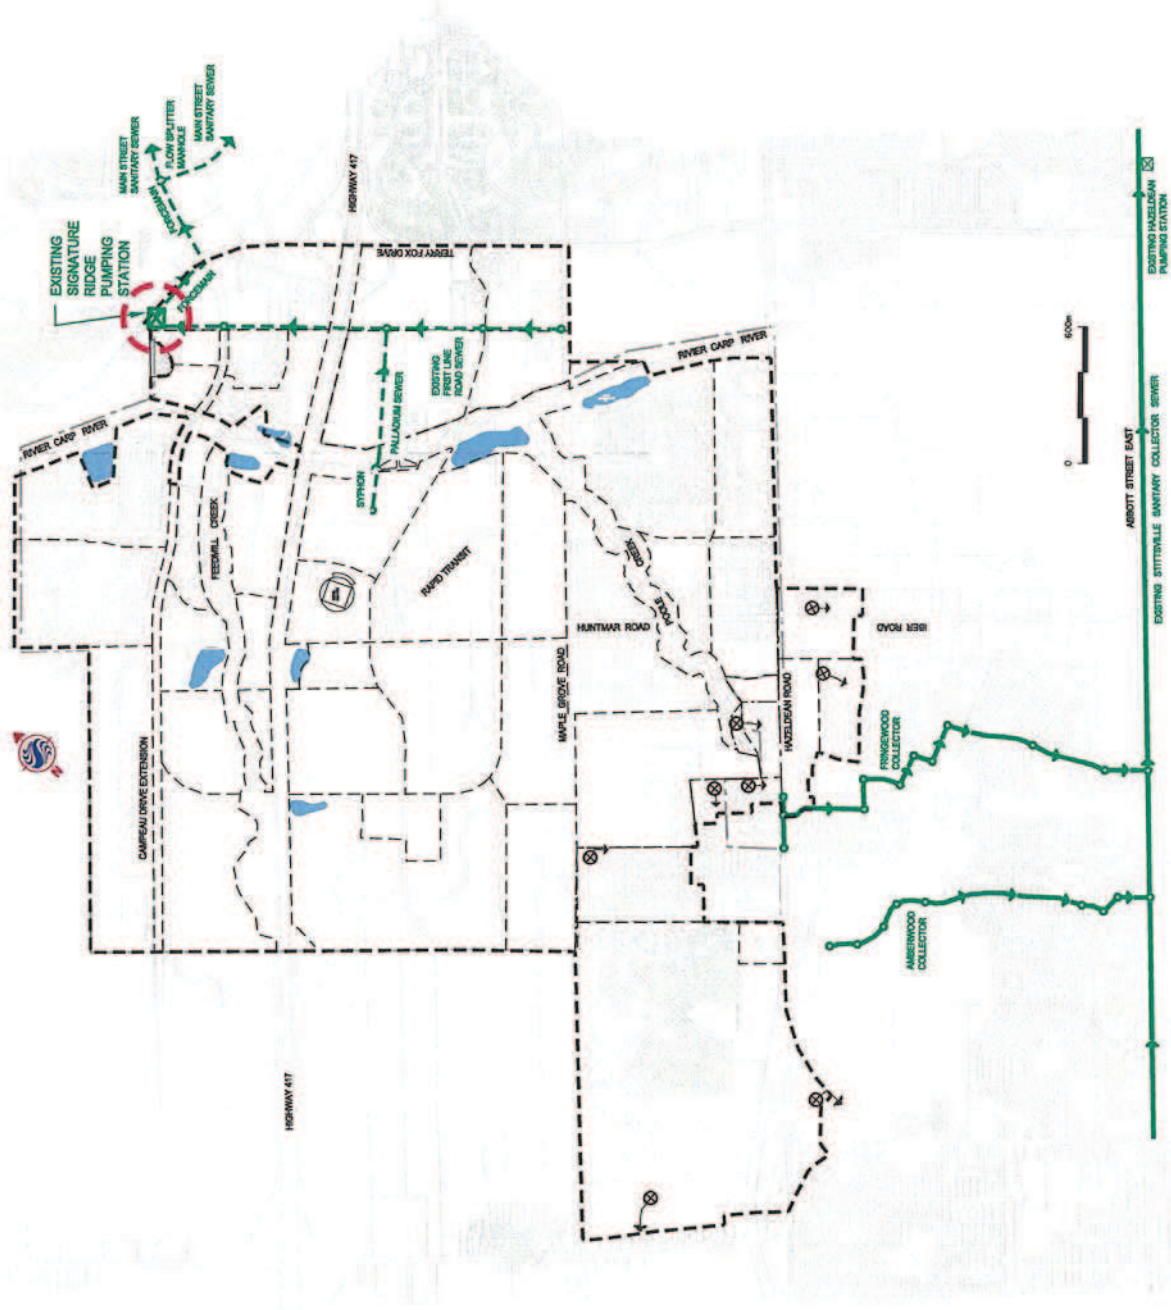

- Legend:**
- Ultimate Drainage Limit
 - Existing Stittsville Sewer
 - - - Existing Trunk Sewer
 - ⊗ Existing Pumping Station and Forcemain (To be Decommissioned)

MAY 2006



FIG. 4.1-9

TABLE 4.1-6

Kanata West Wastewater - Temporary Forcemain/Trunk Sewer/Signature Ridge Alternatives



Criteria	Indicators	Weighting	Rationale for Relative Weights		Signature Ridge PS Alternative	
			Upgrade	Rebuild	Upgrade	Rebuild
CONSTRUCTABILITY/FUNCTIONALITY						
CO1.1	Potential for encountering poor soils and/or elevated groundwater conditions.	36%	24	16	3	1
CO1.2	Extent of works required.	7%	4	1	4	1
CO1.3	Amount of maintenance intensive infrastructure required.	7%	3	3	3	3
CO1.4	Impact of construction on development timing.	6%	4	2	4	2
CO1.5	Ease of property acquisition. (Depends on status of lands and adjacent lands, i.e. vacant, leased or owner occupied)	4%	5	2	5	2
CO1.6	Proximity of a storm sewer, SWM or other surface water for emergency overflow	2%	3	3	3	3
CO1.7	Ease of accommodating potential changes in servicing plans.	6%	2	4	2	4
		5%				
ECONOMY						
E1	Potential to Use Combined Services Corridor	25%	19	12	3	3
E2	Use of existing capacity	6%	5	2	5	2
E3	Pumping requirements	5%	3	3	3	3
E4	Estimated cost of construction.	4%	3	3	3	3
E5	Impact on Agriculture	2%	5	1	5	1
E6	Capital Cost	6%				
CARING AND HEALTHY COMMUNITIES						
C3	Affects areas of residence, institutions or businesses.	25%	12	9	4	4
C4	Disruption to Existing Community	6%	4	3	4	3
C9	Compatibility with Planned Land Use and Infrastructure (Kanata West Roadwork Environmental Study Report and Storm Sewer and Watermain Needs).	11%	4	2	4	2
NATURAL ENVIRONMENT						
N1	Loss of natural area due to installation of works.	3%	14	14	3	3
N3	Potential impact on fish habitat due to installation of works.	3%	3	3	3	3
N4	Potential impact on water quality in the Carp River resulting from rare emergency overflows to the SWM pond due to pump station failure.	3%	3	3	3	3
N5	Difference in carbon dioxide emissions resulting from occasional use of diesel generator.	1%	2	2	2	2
N6	Disruption to greenspace and trees.	5%	3	3	3	3
Total Score						
Ranking			3,600	2,480	1	2
Estimated Capital Cost (in \$million)			1	1	1	4

Evaluation Ranking
 1 - High or Negative Impact
 2 - Moderate or No Impact
 3 - Low or Positive Impact

Description of Alternatives
 Signature Ridge PS Alternative 1 - Rebuild
 Signature Ridge PS Alternative II - Upgrade

The Signature Ridge Pumping Station is currently not equipped with catastrophic failure protection in the form of a gravity overflow. A hydraulic analysis of the proposed sewer system was therefore completed to evaluate the potential for providing a gravity overflow. This analysis demonstrates that catastrophic protection can be provided by gravity. The analysis is included in **Appendix 4.2** and demonstrates that overflows to the existing stormwater management pond on First Line Road and to Pond I can provide the necessary level of protection.

- (ii.) A single new pumping station and forcemain located south of Maple Grove Road and west of the Carp River.

This new pumping station ultimately services all the KWCP south of Highway 417, the lands south of the 417 originally tributary to the SRPS, and the lands in the Village of Stittsville, along Hazeldean Road which are currently unserviceable by gravity to the Stittsville Sanitary Sewer System. This new pumping station has also been designed to accommodate the decommissioning of up to eight small public and private pumping stations along Hazeldean Road without deepening the Kanata West system. **Figure 4.2-1** details the exact areas and flows from Stittsville which will ultimately be tributary to the new pumping station. The areas are also illustrated on **Drawing S-1**.

Figures 4.2-3 and 4.2-4 illustrate a conceptual layout and cross-section for the new pumping station and **Appendix 4.3** details the conceptual design of the pumping station.

The new pumping station will temporarily outlet to the Stittsville Collector Sewer via a temporary forcemain in Huntmar Road and Iber Road. This temporary forcemain is designed to accommodate a flow of 190 l/sec (approximately 3,000 units). The temporary outlet will be located entirely within a public right-of-way. The single 405 mm diameter forcemain used for the initial outlet can be kept in service for long-term use as an emergency back up outlet. Rationale on the availability of capacity in the Stittsville Collector Sewer is attached as **Appendix 4.1**.

The permanent outlet for the new pumping station consists of a forcemain leading from the pumping station to the Glen Cairn Collector Sewer east of Eagleson Road. The preferred route for this forcemain is along Maple Grove Road to Silver Seven Road; along the east side of Silver Seven Road, in an easement, in the undeveloped lands between Maple Grove Road and Palladium Drive; easterly along Palladium Drive to Katimavik Road; and easterly along the north side of Katimavik Road, in the corridor for the unbuilt westbound lanes of Katimavik Road, to Eagleson Road and the Glen Cairn Collector Sewer. The location of the new pumping station is in close proximity to Stormwater Management Ponds 4 and 5. This provides catastrophic failure protection to the new pumping station in the form of a gravity overflow. The hydraulic analysis of this overflow system is attached as **Appendix 4.2**.

The preferred sanitary sewer system also includes a gravity sewer, which collects flow from several minor internal sanitary sewers and directs this flow to the new pumping station location. As illustrated on **Drawing S-1** this minor collector sewer runs parallel to the west side of the Carp River corridor between Maple Grove Road and Palladium Drive, crossing under the Carp River by boring beneath the river. The sewer extends northerly to intercept flows from Silver Seven Road and diverts them from the Signature Ridge Pumping Station. The inclusion of this north south sewer is a key element in eliminating the need for double pumping within Kanata

STREET	LOCATION		RESIDENTIAL (population based criteria...ICI simultaneous peaking)										EMPLOYMENT/RETAIL/BUSINESS PARK/OPEN SPACES				INFILTRATION				PROPOSED SEWER								
	FROM MH	TO MH	TOTAL AREA (Ha)	APPLIC AREA (Ha)	UNITS/Ha	TOTAL UNITS	INDIV	POPULATION	PEAK FACTOR	PEAK FLOW (l/s)	APPLIC AREA (Ha)	ACCUM AREA (Ha)	TOTAL AREA (Ha)	FLOW RATE (l/ha/d)	INDIV (l/s)	ACCUM (l/s)	PEAK FLOW (l/s)	INDIV	CUMUL	TOTAL CUMUL	PEAK FLOW (l/s)	TOTAL FLOW (l/s)	CAPACITY (l/s)	VELOCITY (ft/d)	LGTH. (m)	PIPE (mm)	GRADE %	AVAIL. CAP. (%)	
Campaign Drive Trunk Sewer	1	2	0.00																										
			0.00	Area 1 (PBP)							0.00	0.00		35000	0.00	0.00	0.00	0.00	0.00										
			0.00	Area 2 (PBP)							0.00	0.00		35000	0.00	0.00	0.00	0.00	0.00										
			0.00	Area 3 Ext Employment							0.00	0.00		50000	0.00	0.00	0.00	0.00	0.00										
			0.00	Area 4 HP Employment							0.00	0.00		50000	0.00	0.00	0.00	0.00	0.00										
	2	3	29.19	Area 5 Residential		19	555	1664	3.65	24.58	0.00	0.00	0.00	50000	0.00	0.00	29.19	29.19	29.19	8.17	32.75	286.61	0.98	700.0	600	0.20	88.57%		
			0.00	Area 6 Ext Employment							0.00	0.00		50000	0.00	0.00	0.00	0.00	0.00										
			0.00	Area 7 HP Employment							0.00	0.00		50000	0.00	0.00	0.00	0.00	0.00										
	3	4	27.86	Area 8 Ext Employment		19	529	1588	3.65	24.58	0.00	0.00	0.00	50000	0.00	0.00	29.19	29.19	29.19	8.17	32.75	200.67	0.91	920.0	450	0.25	100.00%		
			0.00	Area 9 HP Employment							0.00	0.00		50000	0.00	0.00	0.00	0.00	0.00										
	4A	4	27.86	Area 10 Residential		19	529	1588	3.65	24.58	0.00	0.00	0.00	50000	0.00	0.00	29.19	29.19	29.19	8.17	32.75	148.74	0.90	150.0	675	0.20	83.68%		
			4.13	Area 11 Mixed Use		50	88	263	3.38	48.17	2.37	2.37	123.33	35000	1.44	1.44	61.18	61.18	61.18	17.13	66.74	34.00	0.67	750.0	450	0.25	7.76%		
			6.05	Area 12 HP Employment							6.05	6.05		30000	3.15	3.15	30.00	30.00	30.00	30.00	30.00								
			20.15	Area 13 (Corel Centre)							20.15	26.20	26.20	14400	5.04	8.19	8.19	20.15	26.20	26.20	7.34	45.52							
			14.59	Area 14 Ext Employment							14.59	14.59		35000	8.87	8.87	14.59	14.59	14.59	7.34	45.52								
			11.97	Area 15 Employment							11.97	26.56		35000	7.27	16.14	11.97	11.97	26.56	7.34	45.52								
			20.66	Area 16 Employment							20.66	47.22		35000	12.55	28.69	20.66	20.66	47.22	7.34	45.52								
			28.89	Area 17 Employment							28.89	76.11		35000	17.55	46.25	28.89	28.89	76.11	7.34	45.52								
	15	5A	102.31	Area 18 Community Retail							102.31	108.66		35000	3.86	58.29	102.31	102.31	108.66	58.65	115.08	100.21	0.88	694.0	375	0.30	32.59%		
			6.35	Area 19 Community Retail							6.35	108.66		35000	3.86	58.29	6.35	6.35	108.66	58.65	115.08	203.90	1.24	230.0	450	0.47	44.59%		
			11.80	Area 20 Mixed Use							11.80	115.45		35000	4.12	62.42	11.80	11.80	115.45	63.73	137.96	203.90	1.24	420.0	450	0.47	32.34%		
			3.88	Area 21 Community Retail							3.88	119.33		35000	2.36	64.77	3.88	3.88	119.33	63.73	137.96	318.43	1.14	300.0	750	0.20	55.56%		
			25.54	Area 22							25.54	144.87		35000	15.52	81.73	25.54	25.54	144.87	63.73	137.96								
			149.88	Area 23							149.88	144.87		35000	15.52	81.73	149.88	149.88	144.87	63.73	137.96								
			90.20	Area 24 Residential							90.20	4.88		50000	4.24	4.24	90.20	90.20	4.88	95.08	26.62								
			4.88	Area 25 Non-Residential							4.88	4.88		50000	4.24	4.24	4.88	4.88	95.08	26.62	65.00								
			306.14								306.14	152.12					306.14	306.14	152.12	115.72	394.02	625.68	1.37	30.0	750	0.29	37.03%		
			154.03								154.03	152.12					154.03	154.03	152.12	115.72	394.02	625.68	1.37	30.0	750	0.29	37.03%		
			127.33								127.33	152.12					127.33	127.33	152.12	115.72	394.02	625.68	1.37	30.0	750	0.29	37.03%		
			9409								9409	152.12					9409	9409	152.12	115.72	394.02	625.68	1.37	30.0	750	0.29	37.03%		
			3136								3136	152.12					3136	3136	152.12	115.72	394.02	625.68	1.37	30.0	750	0.29	37.03%		
			154.03								154.03	152.12					154.03	154.03	152.12	115.72	394.02	625.68	1.37	30.0	750	0.29	37.03%		
			306.14								306.14	152.12					306.14	306.14	152.12	115.72	394.02	625.68	1.37	30.0	750	0.29	37.03%		


Note: Sewer from node 5 to SRPS is existing and is to be replaced.

Average Daily Per capita Flow Rate = 350 l/cap/d
 Infiltration Allowance Flow Rate = 0.28 l/see/ha
 Residential Peaking Factor = 1+(14/(4+(P-0.5))) P=Pop. in 1000's, Max of 4
 Population density per unit = 3.00
 P.F. For Employment/Retail/Business Park = 1.50
 Mixed Use Assumed: 15% Community Retail, 42.5% Business Park and 42.5% Residential



FIG. 4.2-2


CONCEPTUAL
PUMPING STATION
SITE PLAN

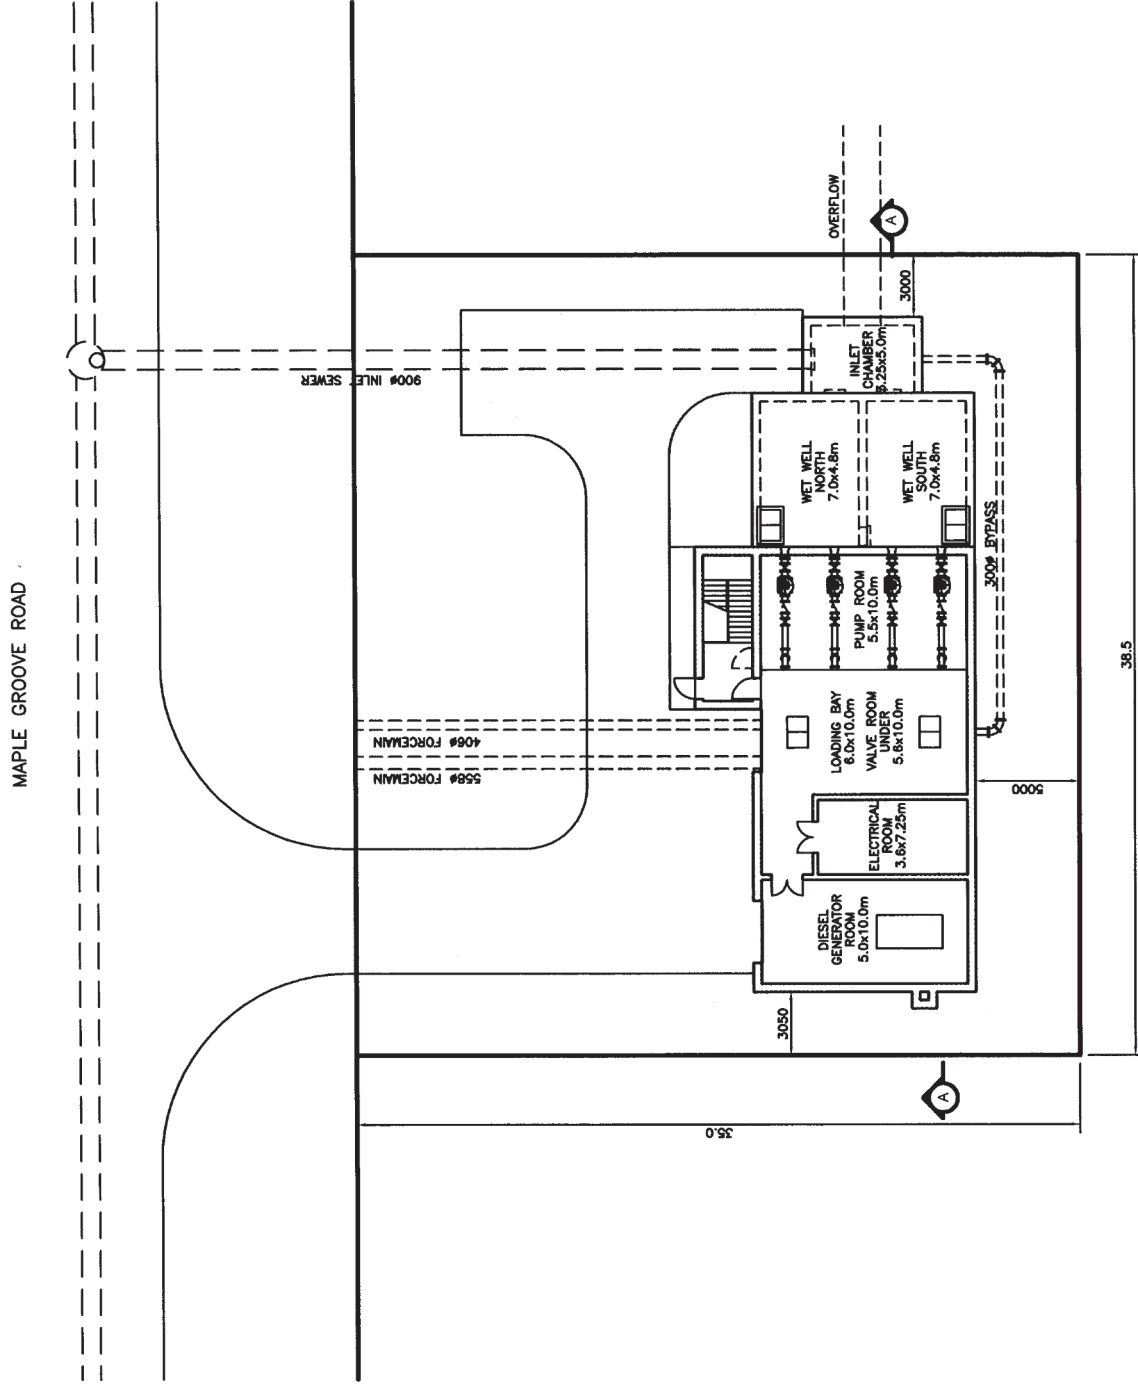

MAY 2006

FIG. 4.2-3

CONCEPTUAL
PUMPING STATION
SECTION

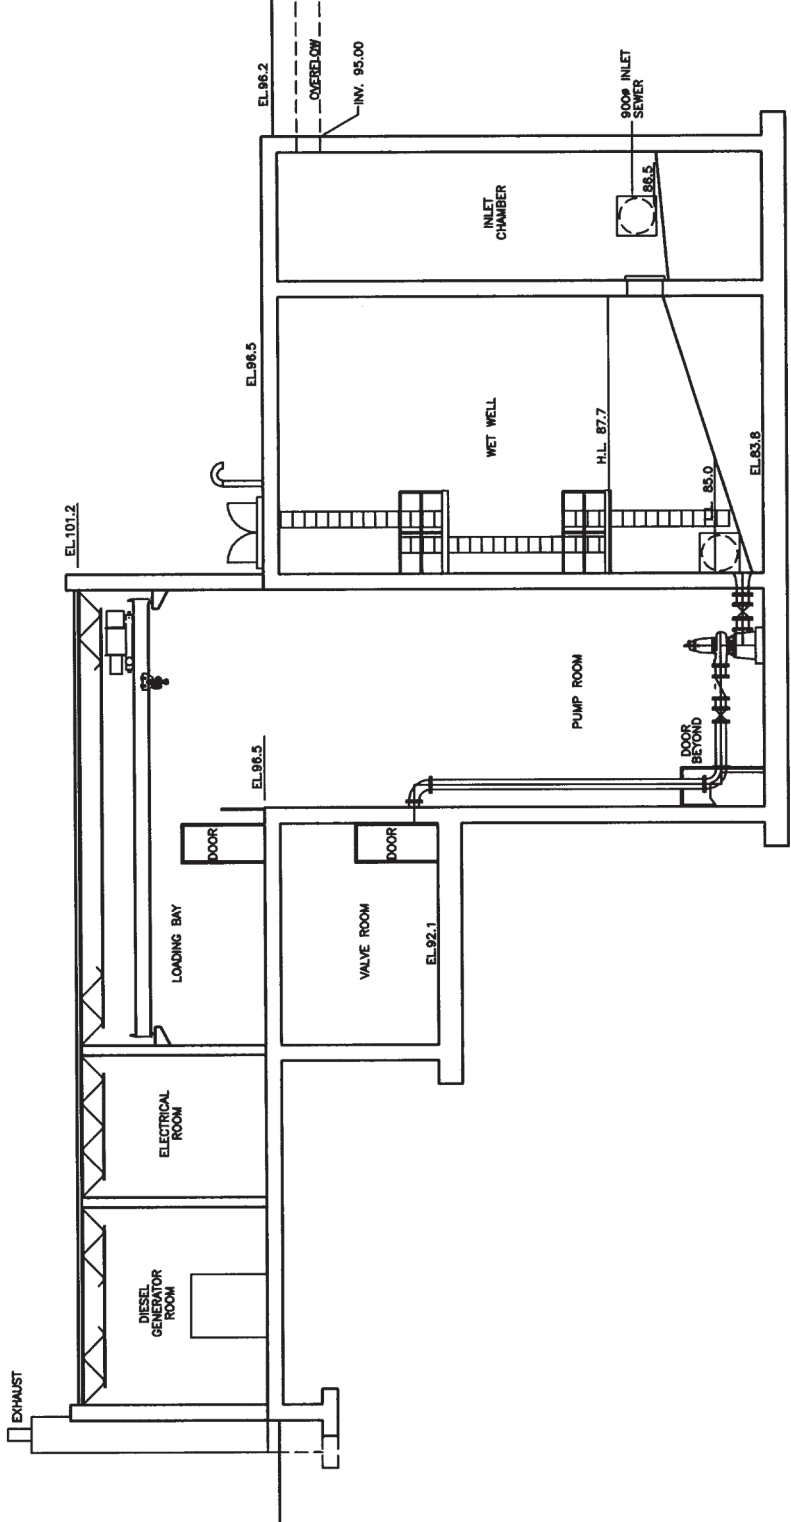

MAY 2006

FIG. 4.2-4



West. The alignment of this minor collector sewer in a north-south direct along the east limit of the development area also allows the internal sanitary sewer system to parallel the storm sewer system throughout the development area. This is a critical element in providing a coordinated and cost effective servicing scheme, which can accommodate the phased development of the KWCP over several years. The location of this sewer also facilitates the decommissioning of the Palladium Siphon and avoids placing this sewer in an area of significant fill. It also places the sewer in a designated corridor that can be graded to provide a minimum of 1.5 meters of freeboard between the 1:100 year flood level of the Carp River and the top of the covers in the access chambers. All pond outlets to the Carp River are above the 1:100 year flood plain, as well as the water elevations associated with the historical storm events analyzed in the Flood Characterization and Flood Level Analysis, prepared on CH2MHill. A designated corridor width of 20 meters is recommended for this sewer between Maple Grove Road and Palladium Drive.

Drawing S-1 also illustrates the overall major sanitary sewer system for the entire KWCP including tributary areas, pipe sizes, external pumping stations, which are to be decommissioned, and the proposed outlet location for these existing systems.

A profile of the trunk sanitary sewer system is included in the appendices of this report. These profiles illustrate the proposed elevation of the sanitary sewers relative to the storm sewers demonstrating the coordinated design of these two systems.

4.4 Design Criteria

The following City of Ottawa design guidelines were used in the preparation of the sanitary sewer analysis provided in this report:

Residential Average Daily Flow Rate	350 L/P Day
Residential Peak Factor	Modified Harmon Formula
Business Park Flow Rates	35,000 L/Ha/Day
Employment Area Flow Rate	50,000 L/Ha/Day
Business Park / Employment Peak Factor	1.5
Infiltration Rate	0.28 L/Sec/Day

4.5 Construction Phasing

It is anticipated that the build out of the KWCP will take many years. The high capital cost of the associated infrastructure dictates that a phased construction approach will be required. Servicing studies completed previously for the area have provided the framework for the phased construction of the wastewater system, which included the use of residual capacity in the existing sanitary sewer system in Stittsville. The following is a brief description of the proposed construction phasing plan, which builds on previous studies, incorporates recent construction proposals for the developers group, and incorporates additional, detailed analysis of the existing Stittsville sanitary system.

Figure 4.2-5 illustrates the area identified as Phase I in terms of wastewater servicing. Area "A" includes the area, which will be tributary to the Signature Ridge Pumping Station in the short term. This drainage area ultimately requires the expansion of the Signature Ridge Pumping Station to 400 l/sec, assumes that the lands south of Highway 417 currently draining to this pumping station will continue to do so in the short term, and that these lands will build out. This scheme also accommodates build out of the Broughton/Richardson and Interstitial Lands as part of Phase I (see **Figure 4.2-2** for details of this analysis). A regular flow monitoring program

1.0 Introduction

1.1 BACKGROUND

The Kanata West Pumping Station (KWPS) will serve as the primary pumping facility providing wastewater servicing for the Kanata West Concept Plan (KWCP) development.

Located between Stittsville and Kanata, the KWCP is a major component of urban growth in the western portion of the City of Ottawa. The development is being planned as a mixed-use community that will include a population of approximately 17,000 persons in 6,300 households, 24,000 jobs and approximately 1 million square metres of commercial space. The approved KWCP includes the transportation network and servicing infrastructure required to support the identified land use plan. This includes a rapid transit corridor, a number of primary arterial roads, minor arterial roads, major collector roads, water, sewers, stormwater management and watercourse corridors.

The Kanata West Pump Station and Forcemains will provide sanitary servicing for Kanata West south of Hwy 417 and adjacent areas in Stittsville. The KWPS will convey wastewater from the pumping station to the existing Glen Cairn Trunk Sewer on Eagleson Road. The pumping station location and general operational requirements were specified in the *Kanata West Pump Station and Forcemains Functional Design Report* (Stantec, August 8, 2012) which built on the *Kanata West Concept Plan – Master Servicing Study* (Stantec/CCL IBI Group, 2006) and the *Kanata West Master Servicing Study Update 2010* (Stantec/CCL IBI Group, 2010).

The preliminary design was not advanced after completion of the functional design confirmation until the land for the preferred pump station site was secured and the ultimate station inflow was confirmed in April 2013. Key differences between the functional design and preliminary design are summarized in **Section 2.2**.

1.2 SCOPE OF WORK AND PURPOSE OF REPORT

The purpose of this report and the associated drawings is to present the preliminary design of the KWPS and forcemains including, but not limited to, the following.

- Detail the civil, architectural, process, electrical and instrumentation requirements and preliminary design layout for the KWPS;
- Provide a preliminary process control philosophy for operation and phasing of the pump station;
- Develop preliminary forcemain plan and profile drawings showing the preferred alignment, Carp River crossing, Watts Creek crossing, and major intersection crossings;

- Detail the proposed construction staging and construction impact mitigation measures;
- Provide preliminary geotechnical and hydrogeological recommendations/considerations and their impact on structural design and construction methods;
- Provide an opinion of probable capital construction and operation and maintenance costs for construction of the proposed works;
- Provide a preliminary construction schedule for completion of the proposed works.

1.3 RELATED DOCUMENTS AND REPORTS

The following documents and reports were reviewed during the KWPS preliminary design:

- *Kanata West Pump Station and Forcemains Functional Design Report* (Stantec, August 8, 2012)
- *Kanata West Concept Plan – Master Servicing Study* (Delcan/Stantec/CCL IBI Group, 2006)
- *Kanata West Master Servicing Study Update 2010* (Delcan/Stantec/CCL IBI Group, 2010)
- *Implementation Plan Kanata West Development Area* (Declan, July, 2010)
- *West Urban Community Technical Memorandum* (Stantec, June 28, 2012)
- *West Urban Community – Wastewater Collection System Master Servicing Plan - Study* (R.V. Anderson Limited/Stantec, July 2012)
- *Fernbank Community Sanitary Trunk Sewer Design Report* (Novatech, November 14, 2011)
- *Kanata West Transportation Master Plan Update and Amendment 2010* (Delcan, July 12, 2012)
- *Carp River Restoration Plan – Widening Alternatives* (Greenland, May, 2010)
- *City of Ottawa Sewer Design Guidelines* (City of Ottawa, October 2012)
- *Design Guidelines for Sewage Works 2008* (Ministry of the Environment, 2008)
- *West End Odour and Corrosion Master Plan* (Stantec/OCTC, March, 2004)

2.0 Pumping Station Drainage Area and Design Flows

2.1 CATCHMENT AREA AND DESIGN FLOWS

A technical memorandum titled *Kanata West Pump Station Flow Development Background* (Stantec, June 28, 2012) outlines the KWPS flow projections and associated catchment areas, which is included in **Appendix H**.

The KWPS is expected to receive flows from a large portion of the western community development area. These flows will include diverted flows from the Stittsville and/or Fernbank Trunk Sewers. The exact timing of flow diversions from the Stittsville and/or Fernbank trunk sewers is not known at this time. **Figure 2-1** identifies the catchment area for the KWPS.

Since the firm capacity of the station will not be reached until 2031, incoming flows will increase in various phases as summarized below. The phases noted below are based on inflow to the station (not time/years) and are intended to aide City Operations with operational changes to suit increasing flow conditions over the life of the PS. The Phases represent specific flow thresholds at which point operational changes will be required at the pump station for efficient operation.

- **Phase 1:** Immediately following pump station startup, flow is diverted from the existing temporary Fairwinds (Mattamy) pump station located on Maple Grove Rd. to the KWPS (Average Dry Weather Flow: 50L/s; Peak Wet Weather Flow: 134L/s).
- **Phase 2 & 3:** Flow from development growth and diverted flows from the Stittsville and/or Fernbank trunk sewers (Average Dry Weather Flow: 238L/s to 258L/s; Peak Wet Weather Flow: 715L/s to 760L/s). These phases will require operational control modifications at the KWPS, which are described in further detail later in this report.
- **Phase 4:** Ultimate peak inflow to the KWPS from development growth in the catchment areas (Average Dry Weather Flow: 417L/s; Peak Wet Weather Flow: 1250/s).

KANATA WEST PUMPING STATION AND FORCEMAINS

Pumping Station Drainage Area and Design Flows

October 9, 2013

Table 2-1 below summarizes the influent peak and average flows to the KWPS. The ultimate flows (2031 conditions) are extracted from the *Kanata West Pump Station and Force mains Functional Design Report (Stantec, August 8, 2012)* and the *West Urban community Sanitary Sewer Servicing Technical Memorandum (Stantec, May 4, 2012)*.

Table 2-1: Station Design Flows

	Pumping Capacity (L/s)	Average Flow (L/s)
Phase 1 (Post KWPS Startup)	525	50
Phase 2	715	238
Phase 3	760	253
Phase 4 (Ultimate)	1250	417

Phase 1 average flow is based on existing data from the Mattamy/Fairwinds PS. Phase 2-4 average flow is based on a factor of 0.33 of the pumping capacity.

Since the exact timing of the phases described above are not known, the preliminary design must account for the station’s ability to handle a range of flow conditions. This would allow future development to be accommodated in a cost effective manner to suit projected flows for ultimate conditions without the need for equipment upgrades or reconstruction at great expense. Further details with respect to station operation during the phases are provided later in this report. The phases described above are based on influent flow rates to the station. Permanent inflow monitoring at the station will be used to determine when changes to station operation (i.e. increased setpoints, two wet well operation, etc.) will be implemented.

The KWPS will discharge to the Glen Cairn trunk sewer on Eagleson Road. The capacity of the Glen Cairn trunk sewer to accept the additional flow from the KWPS was reviewed as part of the *West Urban Community – Wastewater Collection System Master Servicing Plan - Study (R.V. Anderson Limited, July 2012)*. The timing for when connection to the Glen Cairn trunk sewer would be permitted will need to be reviewed with the City during the detailed design.

It is our understanding that the downstream Tri-Township Collector, which the Glen Cairn Trunk Sewer discharges to, is currently nearing its conveyance capacity. Construction of the North Kanata Trunk (NKT) must be completed prior KWPS startup to ensure adequate capacity is provided within the Tri-Township Collector.

2.2 KEY DIFFERENCES FROM FUNCTIONAL DESIGN TO PRELIMINARY DESIGN


There were several major changes from the functional design to the preliminary design. The key changes and associated notes are summarized below:

KANATA WEST PUMPING STATION AND FORCEMAINS

Pumping Station Drainage Area and Design Flows

October 9, 2013


- **Pump Station Location:** The PS was moved from the previously identified land parcel as the parcel was determined to be of insufficient size. Additionally, the parcel was located within an area sought after for SWF Pond #5. The new PS site is located west of the SWF Pond #5 and immediately south of Maple Grove Road.
- **Wet Well Elevation:** The elevation was lowered, as requested by City Operations during the functional design TAC meeting, to prevent any backwater impact by the wet well on the incoming sewer. The wet well was lowered by 3.4m.
- **Inlet Flow Monitoring:** Permanent inflow monitoring was included as requested by City Operations during the functional design TAC meeting to track growth in the catchment area and to monitor incoming flows. This will allow for operational modifications (and potential upgrades) as inflows increase.
- **Geotechnical Information:** The preliminary results of the geotechnical investigation found difficult ground and ground water conditions at the PS. Consequently, the opinion of probable cost now includes additional works including rock anchors, piles, watertight shoring (i.e. sheet piling, secant walls, or slurry walls), increased groundwater control systems and unsatisfactory soil disposal. .
- **Wet Well Shape:** A circular wet well is proposed within this preliminary design versus the rectangular shape previously proposed. This is proposed to reduce cost and risk during construction as a result of the poor ground conditions. An analysis between rectangular and circular arrangement will be completed at the detailed design stage.

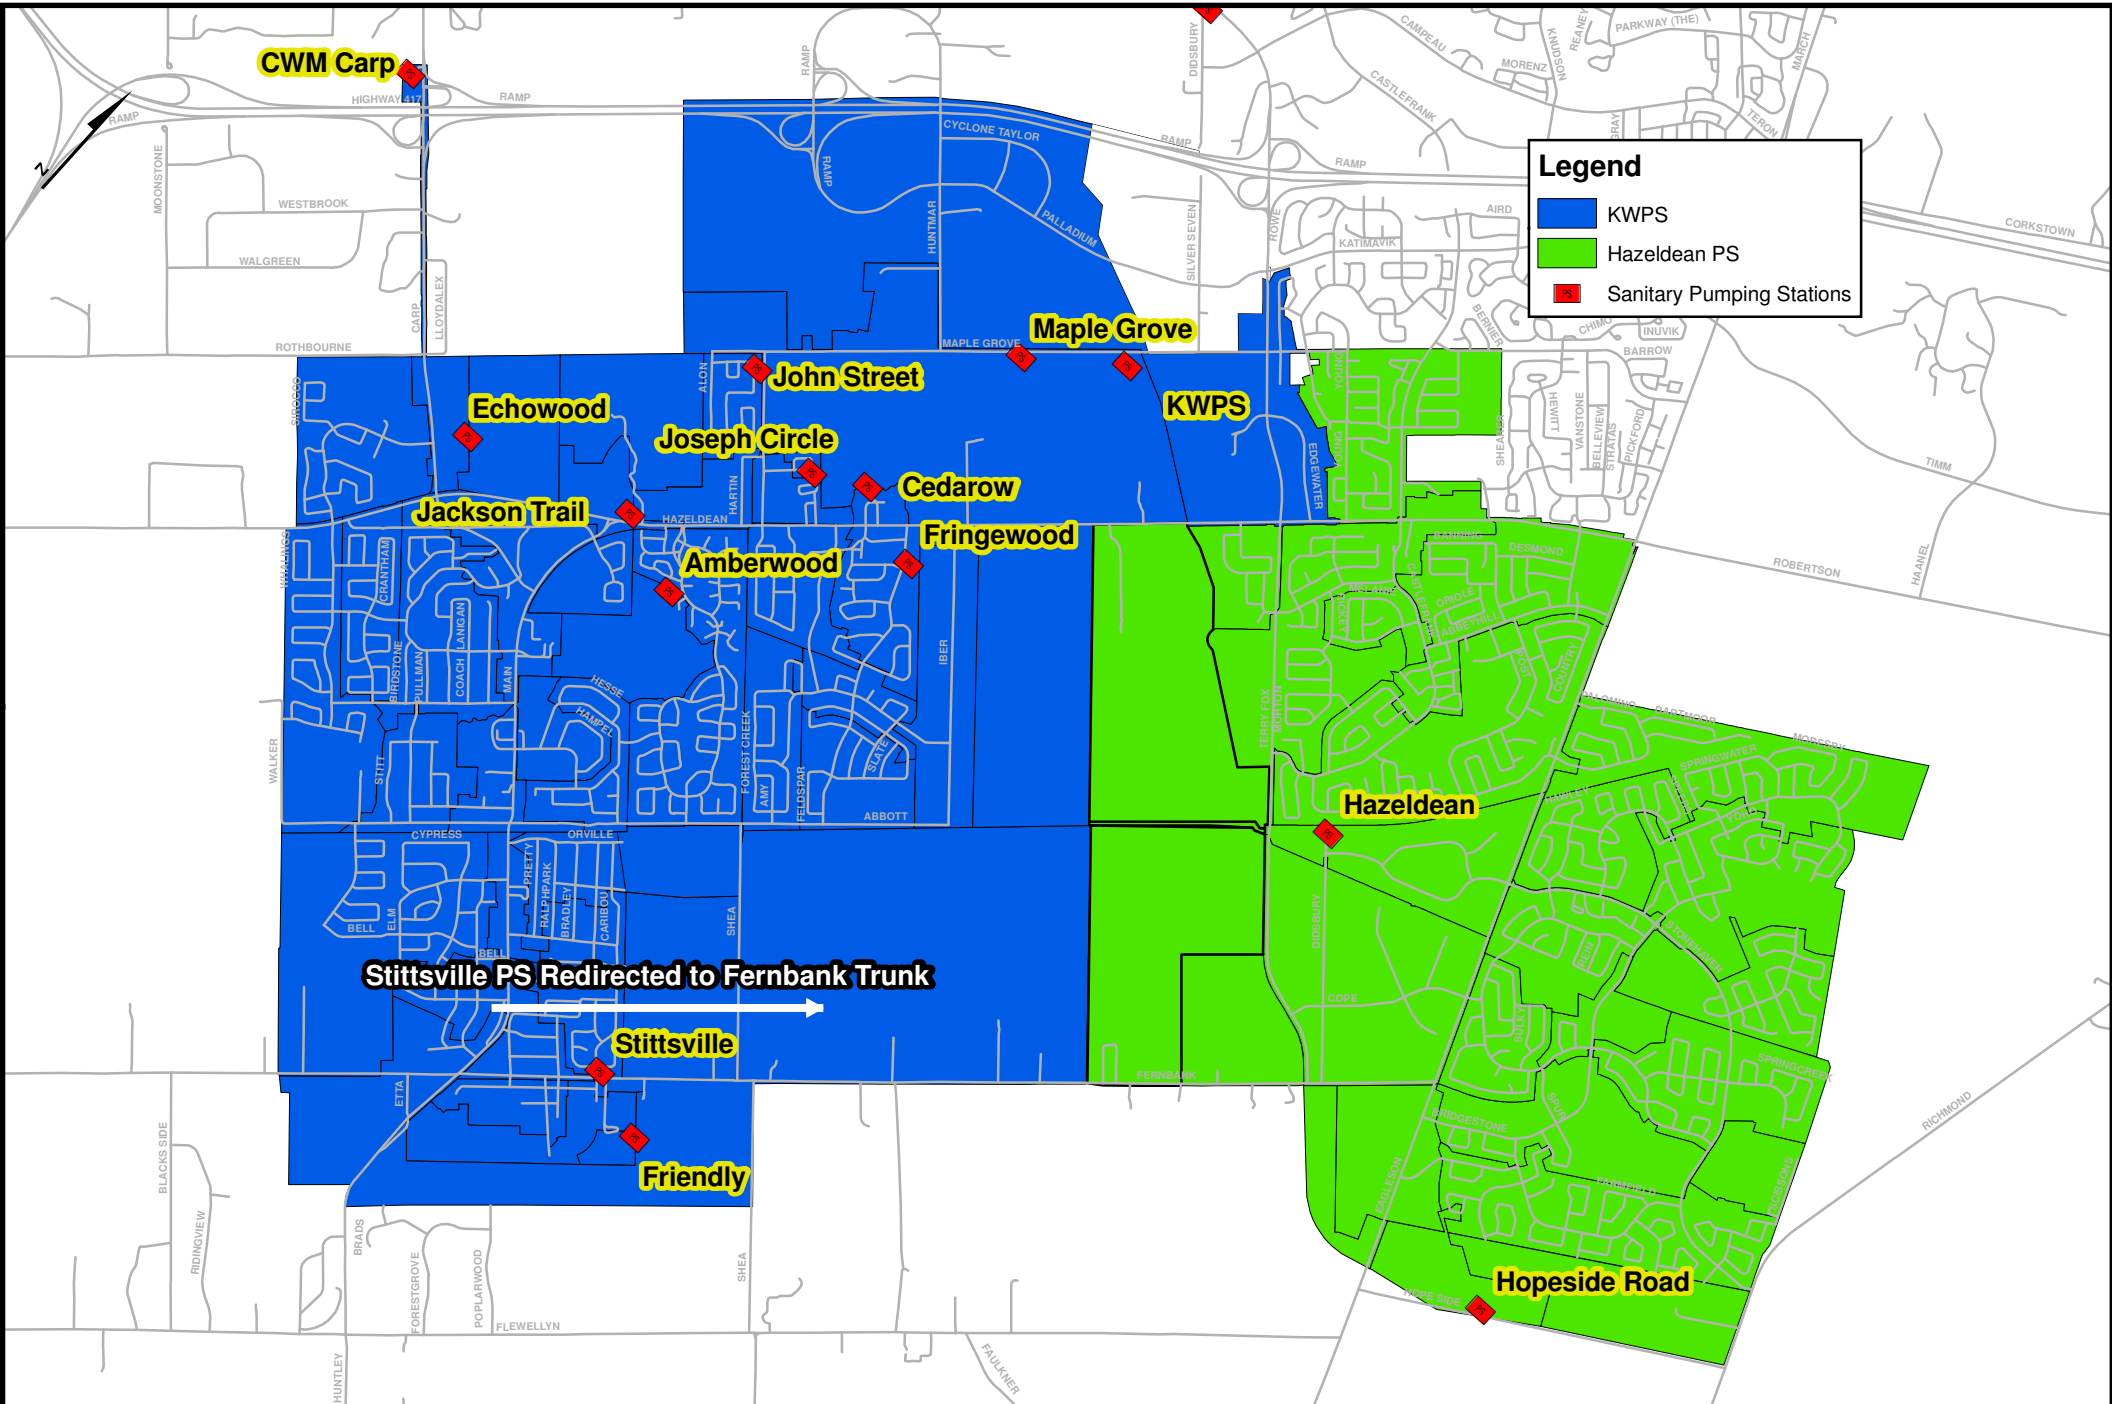

Legend

- KWPS
- Hazeldean PS
- Sanitary Pumping Stations

Stittville PS Redirected to Fernbank Trunk



3.0 Pumping Station and Forcemain Process Design

3.1 DESIGN CONSTRAINTS

The following major design constraints were identified during the preliminary design process:

- The inlet sewer elevation at the MH upstream of the KWPS on Maple Grove (coming from the west) will be E.L 86.78m as set out in the *Kanata West Master Servicing Study Update 2010* (KWMSS);
- The 100 year water level within the adjacent stormwater management pond (Pond #5) is E.L 94.94m as identified in the *KWMSS Update 2010*;
- The pump station and supporting infrastructure must be contained within the allocated property parcel previously agreed to with the Kanata West Owner's Group (KWO) following completion of the Functional Design by Stantec in 2012;
- Emergency overflow must be in place prior to startup of the KWPS as identified in the *KWMSS Update 2010*; and
- The forcemain alignment and depth along Maple Grove Road at the crossing of the Carp River must be designed to accommodate the future Maple Grove road expansion identified in the *Kanata West Transportation Master Plan Update and Amendment* (Delcan, July 2012).

3.2 DESIGN CRITERIA

The following design criteria have been taken into consideration for the preliminary design of the pumping station and associated works:

- Design should comply with requirements of the *City of Ottawa Sewer Design Guidelines and MOE Design Guidelines for Sewage Works (2008)*;
- Equipment and station operation should be as simple as possible to minimize the risk of controller, equipment or Operator error/failure during operation in addition to incorporation of an emergency overflow and redundancy features (i.e. dual forcemains, split wet wells, etc.);
- The design should minimize the impact of construction activities and station operation on the natural heritage features and landscaping;
- The capital and operation/maintenance costs should be minimized while respecting operational and design constraints/criteria;

KANATA WEST PUMPING STATION AND FORCEMAINS

Pumping Station and Forcemain Process Design

October 9, 2013

- The pump station should be able to operate under a wide range of flow conditions as outlined in **Section 2.0** with minimal operator effort required and minimal to no equipment upgrades/construction;
- Minimize the potential for odour production and corrosion as a result of pump station and forcemain operation; and
- The pumping station and site should be designed to blend in with the future surrounding community both functionally and aesthetically.

3.3 INLET SEWER

Inflow to the KWPS will be conveyed by an inlet sewer connecting the sewer along Maple Grove Road to the KWPS. Details regarding the Maple Grove sewer are provided in **Section 4.1**. A 1200mmØ sewer is proposed from a MH on the Maple Grove sewer to the KWPS. The inlet sewer’s elevation is dictated by the proposed elevation of the future 825mmØ SAN sewer along Maple Grove east of the KWPS site. The proposed elevation of the sewer in question is E.L 86.78m as indicated on various drawings provided by the City of Ottawa, correspondence with the City of Ottawa during the preliminary design process, and the *KWMSS*.

The inlet sewer hydraulic details are summarized in **Table 3-1**. Additional details regarding the all KWPS pipe sizing is provided in **Appendix B**.

Table 3-1: Inlet Sewer Details

Sewer Location	Details
Inlet Sewer from SAMH#2 (Maple Grove Road) to KWPS	1200mmØ @ 0.20%
	SAMH#2 Invert E.L 86.78m
	Inlet Chamber Invert E.L 86.64m
	Freeflow Capacity = 1744L/s

Permanent inflow monitoring is proposed on the inlet sewer upstream of the KWPS. The flow monitoring system will be housed within a precast chamber on the inlet sewer within the station property.

3.4 PUMPING STATION TYPE SELECTION

The recommended pump station type, based on the recommendation of the *City of Ottawa Sewer Design Guidelines, Section 7.2.2.2* for a station with flows greater than 450L/s and a wet well depth greater than 12m, is a dry pit/wet well with submersible pumps in the dry pit.

In order to improve the City’s ability to service the pump station once in operation, it is recommended to have two (2) fully separated wet wells. The pump station will be provided with redundant bar screening channels, with one dedicated to each wet well.

4.0 Pumping Station and Forcemain Civil Design

4.1 MAPLE GROVE SEWER

A new sewer is proposed along Maple Grove Road to convey wastewater from the existing Mattamy/Fairwinds pumping station west of Poole Creek to the KWPS. This sewer will intercept and convey flow currently being directed to the Fairwinds PS as well as future flows diverted from the Stittsville/Fernbank diversion sewer.

The proposed sewer will connect to a previously installed SAMH located immediately west of Poole Creek. An 825mmØ sewer is proposed from the existing SAMH, below Poole Creek to a proposed SAMH#1 east of Poole Creek. SAMH#1 is proposed to be equipped with a stub for the future connection of the Stittsville/Fernbank diversion sewer. From SAMH#1 to a proposed SAMH#2 (on Maple Grove Road immediately north of the KWPS), the pipe is proposed to be 1050mmØ in order to convey the additional future flows from the diversion sewer to the KWPS.

SAMH#2 will be the junction point for the new 1050mmØ sewer coming from the west along Maple Grove and the future 825mmØ SAN coming from the east along Maple Grove. . The proposed elevation of the future 825mmØ SAN is E.L 86.78m at SAMH#2. As such an external drop is proposed on the west side of SAMH#2 for the 1050mmØ sewer.

Based on discussions with a local Contractor, when the 825mmØ was installed on Maple Grove from Fairwinds PS to Poole Creek, the Contractor encountered very poor soil conditions. The soil/groundwater conditions were such that the Contractor ultimately had to install pre-stressed concrete cylinder pipe (PCCP) versus standard reinforced concrete sewer pipe to resist buckling at the joints and uplift during trench installation. Therefore at this preliminary design stage, it is proposed to use similar pipe.

4.1.1 Poole Creek Crossing

In order to cross below Poole Creek, a 70m trenchless installation is proposed. The most suitable trenchless method for the sewer installation will be dependent on the results of the geotechnical investigation currently being completed for this area.

4.2 PUMP STATION

4.2.1 Site Grading

The pumping station will be located immediately west of the future SWF Pond #5 on Maple Grove Rd.

The top of the wet wells and buildings are proposed to be located a minimum of 1.2m above the 100 year flood (E.L 94.94m within Pond #5 as identified in the *KWMSS Update 2010*).

One Team. Infinite Solutions.

10.0 Approvals and Permitting

10.1 MINISTRY OF THE ENVIRONMENT

10.1.1 Environmental Compliance Approval

An Environmental Compliance Approval (ECA) will be required for the new KWPS (Sewage and Air/Noise) and for the new Maple Grove Sewer (Sewage). The following stages are proposed with respect to obtaining an Environmental Compliance Approval (ECA) for the new KWPS:

- A pre-consultation meeting with the regional MOE office will be held following completion of the preliminary design.
- During the 90% detailed design stage, the ECA application(s) will be submitted and will confirm the final scope of works.

10.1.2 Permit to Take Water (PTTW)

It is anticipated that a PTTW (or potentially multiple PTTWs) will be required for construction of the KWPS, Maple Grove sewer and forcemains. PTTW applications will be completed, following the City's requirements, during the 90% design stage and submitted on behalf of the City of Ottawa. The MOE will issue a draft PTTW(s) in the name of the City, which will be transferred to the Contractor(s) upon commencement of construction.

10.2 MISSISSIPPI VALLEY CONSERVATION AUTHORITY (MVCA) REQUIREMENTS AND APPROVALS

A pre-consultation meeting will be held with the MVCA following completion of the preliminary design to determine the necessary approvals and installation methods for the Poole Creek, Carp River and Watts Creek crossings.

10.3 SITE PLAN CONTROL AND BUILDING PERMIT

A Building Permit will be required since this is a new structure. Coordination with the City of Ottawa and submission of the Building Permit application will be completed during the detailed design stage.

Site Plan Approval would typically be required where the new works includes construction of a new building structure greater than 200m² and construction of a new paved parking area. In the case of the KWPS, it will likely be exempt as it is a City project, however following completion of the preliminary design, the City Site Plan Approvals group will be contacted to confirm. During the 90% detailed design stage, a pre-consultation meeting will be held with City of Ottawa staff to ensure that the proposed design conforms to the Site Plan Approval requirements, even if exempt.

APPENDIX D

Stormwater Management

Stormwater - Proposed Development
City of Ottawa Sewer Design Guidelines, 2012

Target Flow Rate

Area	6.73 ha
C	0.60 Rational Method runoff coefficient
t _c	15.0 min
5-year	
i	83.6 mm/hr
Q	937.2 L/s

Estimated Post Development Peak Flow from Unattenuated Areas

Total Area	0.67 ha
C	0.65 Rational Method runoff coefficient

t _c (min)	5-year					100-year				
	i (mm/hr)	Q _{actual} (L/s)	Q _{release} (L/s)	Q _{stored} (L/s)	V _{stored} (m ³)	i (mm/hr)	Q _{actual} (L/s)	Q _{release} (L/s)	Q _{stored} (L/s)	V _{stored} (m ³)
10.0	104.2	126.6	126.6	0.0	0.0	178.6	271.2	271.2	0.0	0.0

Note:

C value for the 100-year storm is increased by 25%, to a maximum of 1.0 per Ottawa Sewer Design Guidelines (5.4.5.2.1)

Estimated Post Development Peak Flow from Attenuated Areas

Total Area	6.06 ha
C	0.65 Rational Method runoff coefficient

t _c (min)	5-year					100-year				
	i (mm/hr)	Q _{actual} (L/s)	Q _{release} (L/s)	Q _{stored} (L/s)	V _{stored} (m ³)	i (mm/hr)	Q _{actual} (L/s)	Q _{release} (L/s)	Q _{stored} (L/s)	V _{stored} (m ³)
10	104.2	1139.5	310.9	828.6	497.1	178.6	2441.0	666.0	1774.9	1065.0
15	83.6	913.8	311.6	602.2	542.0	142.9	1953.4	666.0	1287.4	1158.7
20	70.3	768.3	312.1	456.2	547.5	120.0	1639.8	666.0	973.7	1168.5
25	60.9	666.0	312.4	353.5	530.3	103.8	1419.6	666.0	753.6	1130.4
30	53.9	589.8	312.8	277.0	498.6	91.9	1255.9	666.0	589.9	1061.7
35	48.5	530.6	313.0	217.6	456.9	82.6	1128.9	666.0	462.9	972.0
40	44.2	483.2	313.3	169.9	407.8	75.1	1027.3	666.0	361.2	867.0
45	40.6	444.3	313.5	130.8	353.2	69.1	943.9	666.0	277.9	750.4
50	37.7	411.8	313.7	98.1	294.3	64.0	874.3	666.0	208.3	624.8
55	35.1	384.1	313.9	70.2	231.8	59.6	815.1	666.0	149.1	491.9
60	32.9	360.3	314.0	46.2	166.5	55.9	764.1	666.0	98.1	353.1
65	31.0	339.5	314.2	25.3	98.8	52.6	719.7	666.0	53.7	209.3
70	29.4	321.2	314.3	6.9	29.0	49.8	680.6	666.0	14.6	61.4
75	27.9	305.0	314.4	0.0	0.0	47.3	646.0	666.0	0.0	0.0
80	26.6	290.5	314.6	0.0	0.0	45.0	615.0	666.0	0.0	0.0
85	25.4	277.4	314.7	0.0	0.0	43.0	587.2	666.0	0.0	0.0
90	24.3	265.6	314.8	0.0	0.0	41.1	562.0	666.0	0.0	0.0
95	23.3	254.9	314.9	0.0	0.0	39.4	539.1	666.0	0.0	0.0
100	22.4	245.0	315.0	0.0	0.0	37.9	518.1	666.0	0.0	0.0
105	21.6	236.0	315.1	0.0	0.0	36.5	498.9	666.0	0.0	0.0
110	20.8	227.7	315.2	0.0	0.0	35.2	481.2	666.0	0.0	0.0

Note:

C value for the 100-year storm is increased by 25%, to a maximum of 1.0 per Ottawa Sewer Design Guidelines (5.4.5.2.1)

5-year Q_{attenuated}	312.05 L/s	100-year Q_{attenuated}	666.02 L/s
5-year Max. Storage Required	547.5 m³	100-year Max. Storage Required	1168.5 m³


Summary of Release Rates and Storage Volumes

Control Area	5-Year Release Rate (L/s)	5-Year Storage (m ³)	100-Year Release Rate (L/s)	100-Year Storage (m ³)
Unattenuated Areas	127	0	271	0
Attenuated Areas	312	547	666	1168
Total	439	547	937	1168

Area ID	Area (ha)	C (-)	Indiv AxC	Acc AxC	T _c (min)	I (mm/hr)	Q (L/s)	Sewer Data								
								DIA (mm)	Slope (%)	Length (m)	A _{hydraulic} (m ²)	R (m)	Velocity (m/s)	Qcap (L/s)	Time Flow (min)	Q / Q full (-)
A1	2.020	0.65	1.31	1.31	10.0	104.2	380.0	675	0.25	146	0.358	0.169	1.17	420.3	2.1	0.90
A2	0.178	0.65	0.12	1.43	12.1	94.4	374.6	675	0.25	56	0.358	0.169	1.17	420.3	0.8	0.89
					12.9											
A3	2.405	0.65	1.56	1.56	10.0	104.2	452.3	750	0.20	138	0.442	0.188	1.13	497.9	2.0	0.91
A4	0.128	0.65	0.08	1.65	12.0	94.5	432.2	750	0.20	11	0.442	0.188	1.13	497.9	0.2	0.87
A5	0.071	0.65	0.05	1.69	12.2	93.8	441.1	750	0.20	22.5	0.442	0.188	1.13	497.9	0.3	0.89
A6	0.112	0.65	0.07	1.76	12.5	92.5	453.3	750	0.20	40	0.442	0.188	1.13	497.9	0.6	0.91
					13.1											
A7	0.860	0.65	0.56	3.75	13.1	90.1	939.6	900	0.30	101	0.636	0.225	1.56	991.5	1.1	0.95
					14.2											
A8	0.444	0.65	0.29	0.29	10.0	104.2	83.5	375	0.25	101	0.110	0.094	0.79	87.7	2.1	0.95
			0.00	0.29	12.1	94.2	75.5	375	0.25	40	0.110	0.094	0.79	87.7	0.8	0.86
					13.0											
A9	0.460	0.65	0.30	4.34	14.2	86.2	1039.3	900	0.40	36	0.636	0.225	1.80	1144.9	0.3	0.91
					14.5											

Storage Drainage Major System (ST-MJ)

Kanata West Master Servicing Study




Stantec Consulting Ltd.
1505 Laperriere Avenue
Ottawa ON Canada
K1Z 7T1
Tel. 613.722.4420
Fax. 613.722.2799
www.stantec.com

Stantec

Copyright Reserved
The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec Consulting Ltd. without delay.
The Copyrights to all designs and drawings are the property of Stantec Consulting Ltd. Reproduction or use for other than that authorized by Stantec Consulting Ltd. is forbidden.

Legend

	KANATA-WEST CONCEPT PLAN BOUNDARY
	POND DRAINAGE BOUNDARY
	STORM SEWER DRAINAGE LIMIT
	OVERLAND FLOW DIRECTION
	OVERLAND FLOW SEGMENT NUMBER

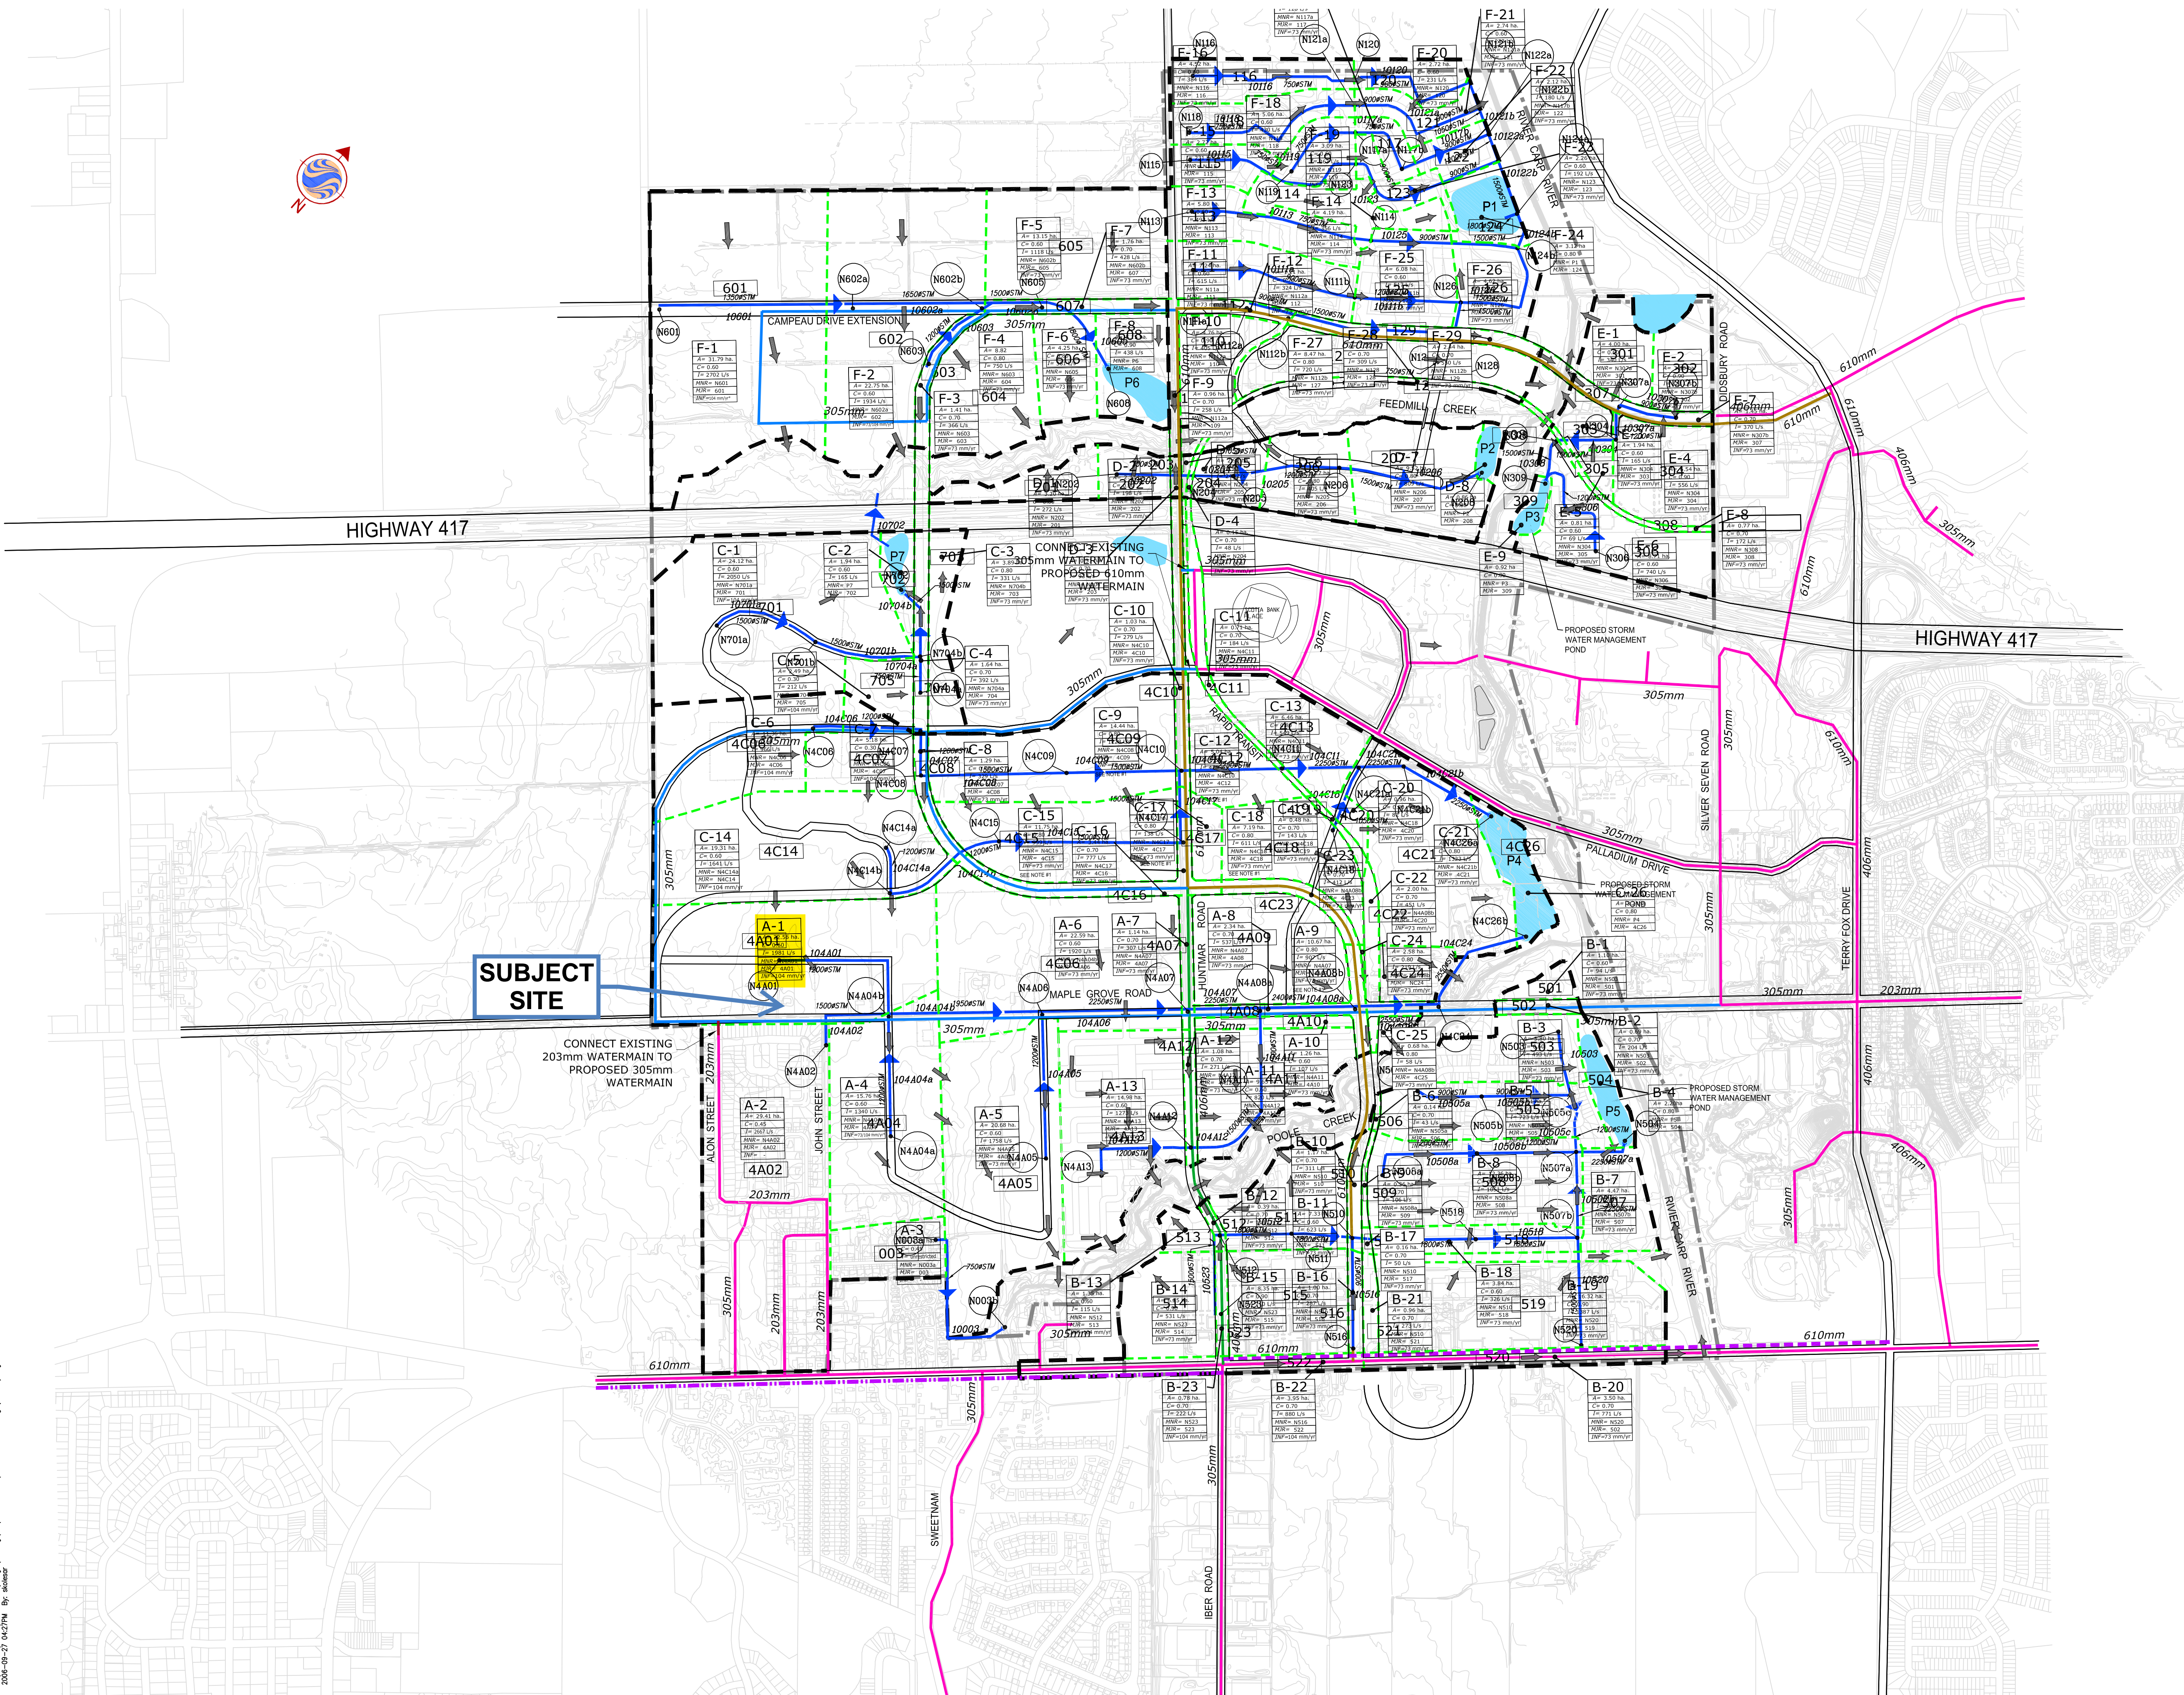

2	REVISED FOR DEC.21/05 SUBMISSION	GBU	SJP	DEC.21/05
1	REVISED AS PER CITY COMMENTS (Sept.16/05)	GBU	MAF	OCT.28/05
Revision		By	Appd.	Date
File Name: 160400406		LTM	MAF	MAF
		Dwn.	Chkd.	Dsgn.
Seals				

Client/Project
**Kanata West Concept Plan
Master Servicing Study**

Ottawa, Ontario



Title
**MODEL SCHEMATIC
STORM DRAINAGE MAJOR SYSTEM**

Project No. 60400406	Scale 0 75 225 375m 1:7500
Drawing No. ST-MJ	Sheet 5 of 7
	Revision 2

X:\01-404\0406\Design\Working\03_2006-09-27\160400406-Servicing (Final).C.dwg
 2006-09-27 16:27:46 By: maddox

***Storm Drainage Plan
Kanata West Pond 4***

David Schaeffer Engineering Ltd.

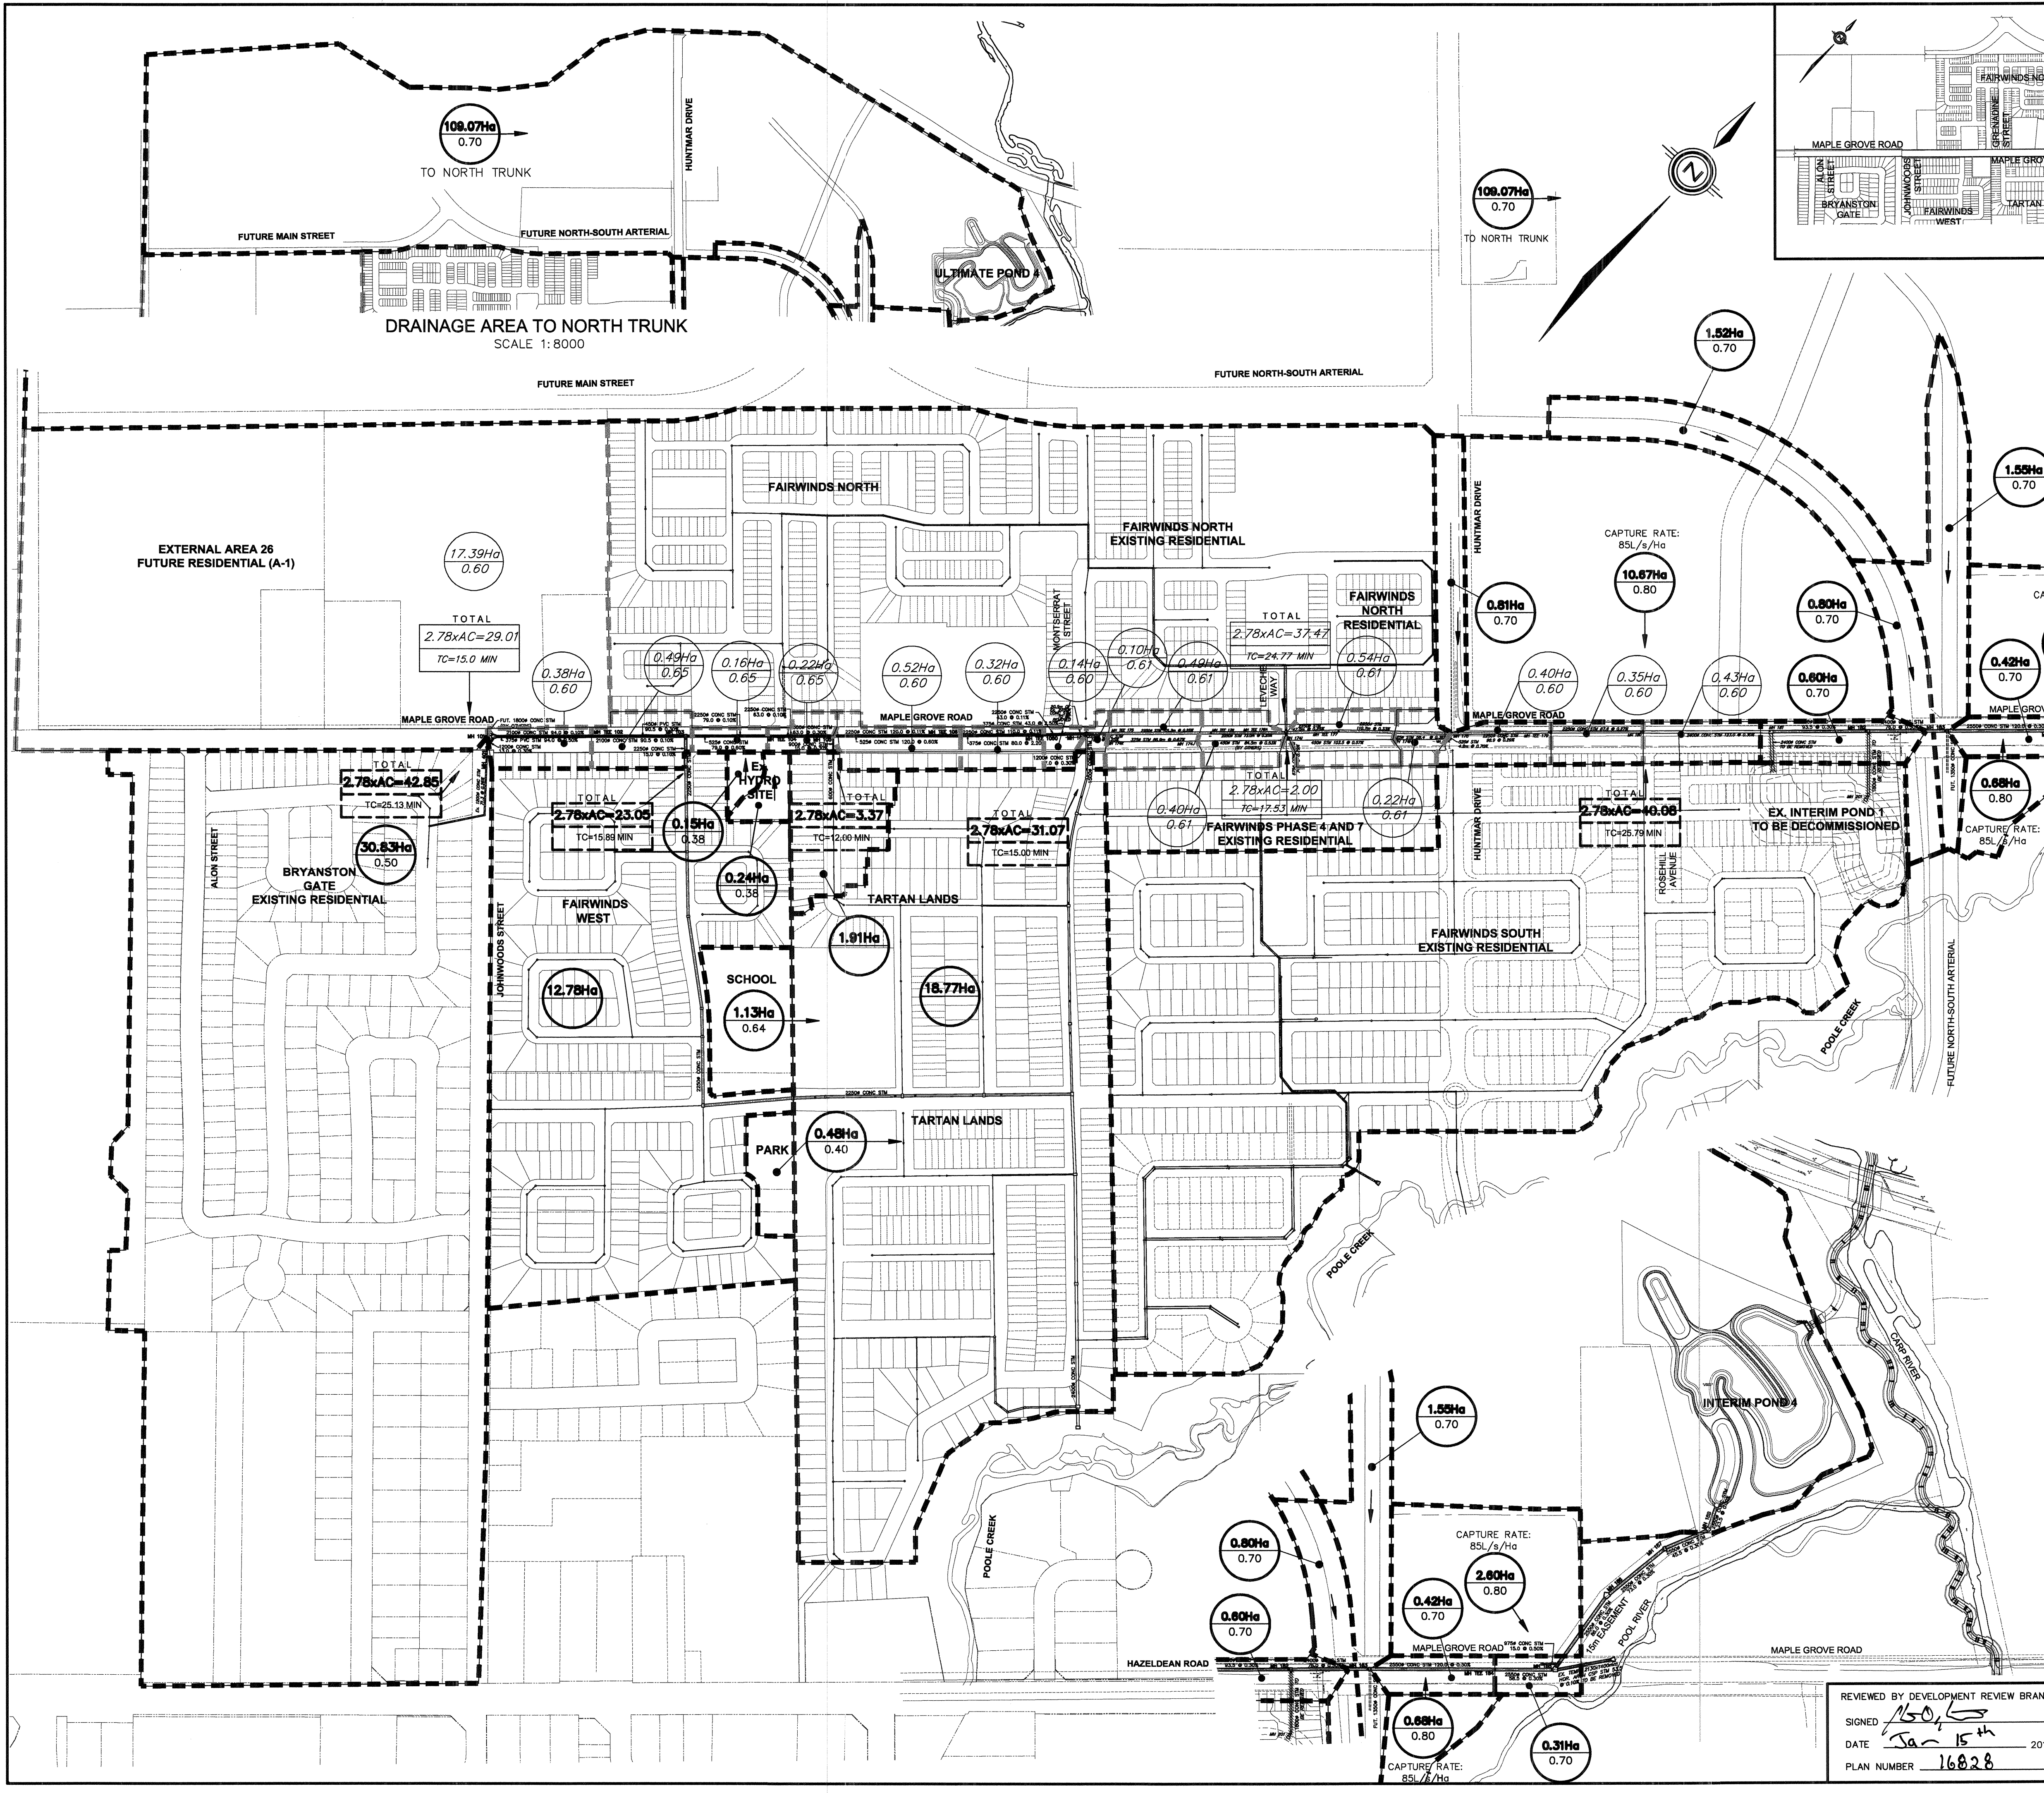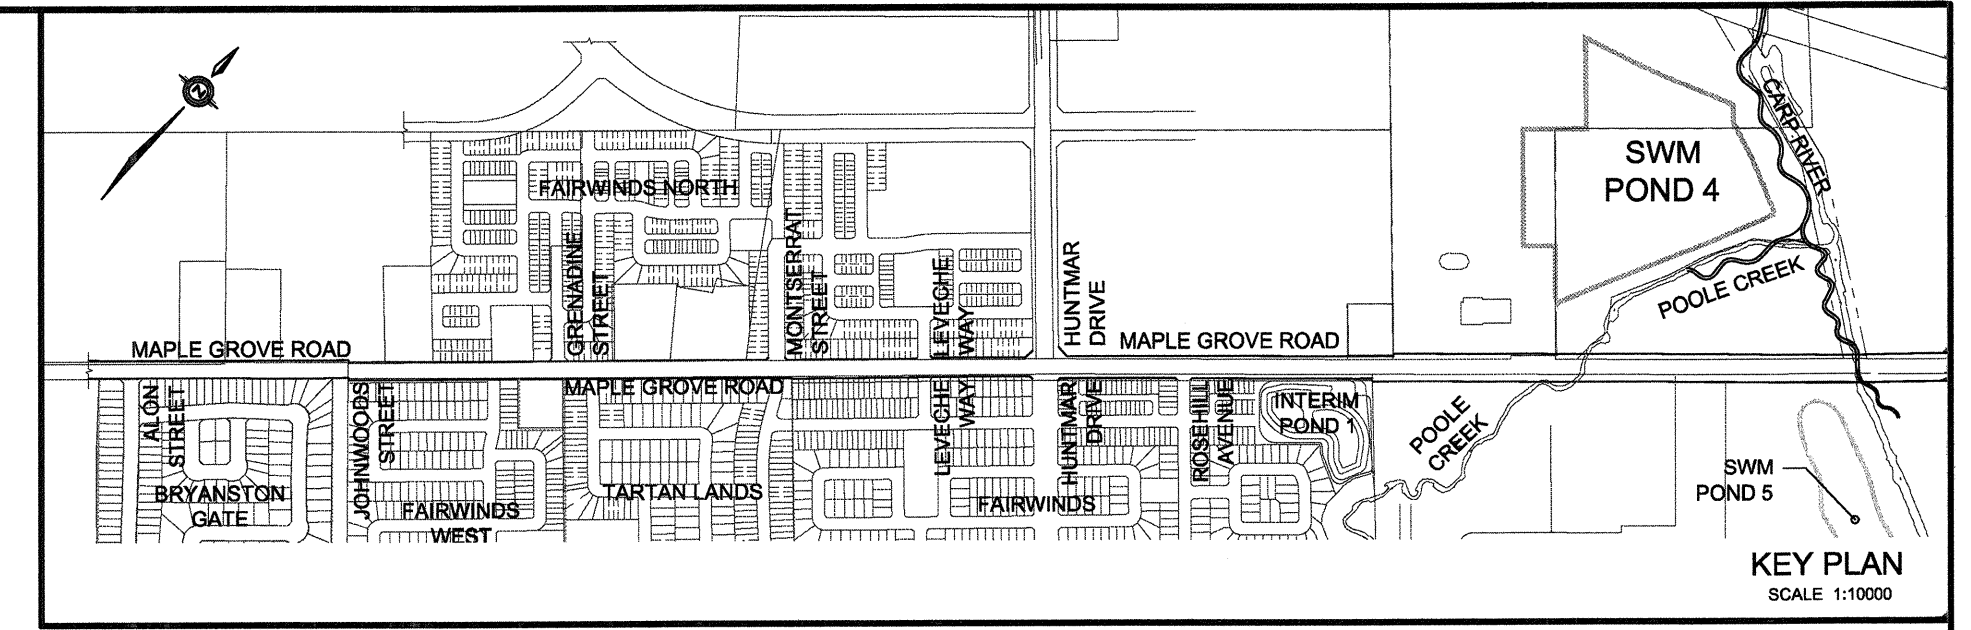

DRAINAGE AREA TO NORTH TRUNK
SCALE 1:8000

- LEGEND**
- DRAINAGE AREA IN HECTARES RUN-OFF COEFFICIENT (UPDATED AND NEW)
 - DRAINAGE AREA IN HECTARES (APPROVED FROM RECONSTRUCTION OF MAPLE GROVE ROAD, PROJECT# 10-451) RUN-OFF COEFFICIENT
 - STORM SEWER TRIBUTARY BOUNDARY
 - STORM SEWER TRIBUTARY BOUNDARY (APPROVED FROM RECONSTRUCTION OF MAPLE GROVE ROAD, PROJECT# 10-451)


TOPOGRAPHIC INFORMATION
TOPOGRAPHIC INFORMATION PROVIDED BY AECOM, RECEIVED ON JANUARY 29, 2013.

LEGAL INFORMATION
CALCULATED DRAFT PLAN PROVIDED BY J.D. BARNES LIMITED, PROJECT No. 05-10-439-05, DATED FEBRUARY 19, 2013.

BENCH MARK No. 0011988U502
TOWNSHIP: STITTSVILLE
CONCRETE CULVERT ALONG HAZELDEAN ROAD, 1.3 KM NE OF ROAD INTERSECTION WITH MAIN ST NORTH. BRASS CAP SET ON TOP OF CONC CULVERT, SOUTH SIDE OF THE ROAD, 30 CM WEST OF EASTERLY EXTREMITY, 30 CM NORTH OF THE SOUTH FACE, SLIGHTLY BELOW ROAD LEVEL.
ELEVATION = 108.659 m

No.	BY	DATE	DESCRIPTION	BY
7	Z.L.	14-12-15	REVISED AS PER FLUVIAL DESIGN	
6	Z.L.	14-11-14	REVISED AS PER CITY'S COMMENTS	
5	Z.L.	14-09-24	REVISED AS PER CITY'S COMMENTS	
4	Z.L.	14-08-20	3rd SUBMISSION	
3	Z.L.	14-06-04	2nd SUBMISSION	
2	Z.L.	14-03-05	1st RE-SUBMISSION	
1	Z.L.	13-08-09	1st SUBMISSION	

Ottawa CITY OF OTTAWA

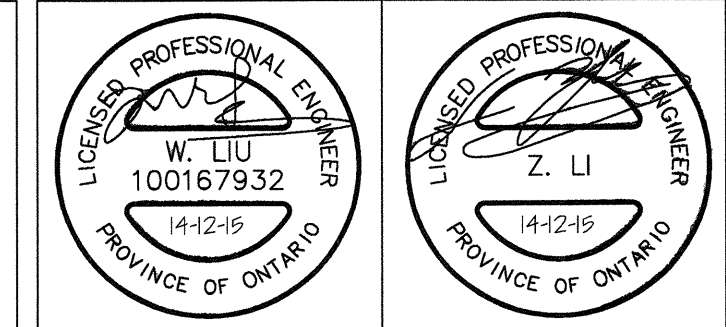

PROJECT No. 12-644

STORM DRAINAGE PLAN © DSEL

mattamy HOMES

POND 4 KANATA WEST


DSEL
david schaeffer engineering ltd

120 Iker Road, Unit 203
Sittsville, ON K2S 1E9
Tel: (613) 836-0886
Fax: (613) 836-7103
www.DSEL.ca

DRAWN BY: W.L./V.	CHECKED BY: K.M.	DRAWING NO.	SHEET NO.
DESIGNED BY: K.M.	CHECKED BY: Z.L.		2C
SCALE: 1:3000	DATE: MAY 2013		

REVIEWED BY DEVELOPMENT REVIEW BRANCH

SIGNED: *[Signature]*
DATE: Jan 15th 2015
PLAN NUMBER: 16828

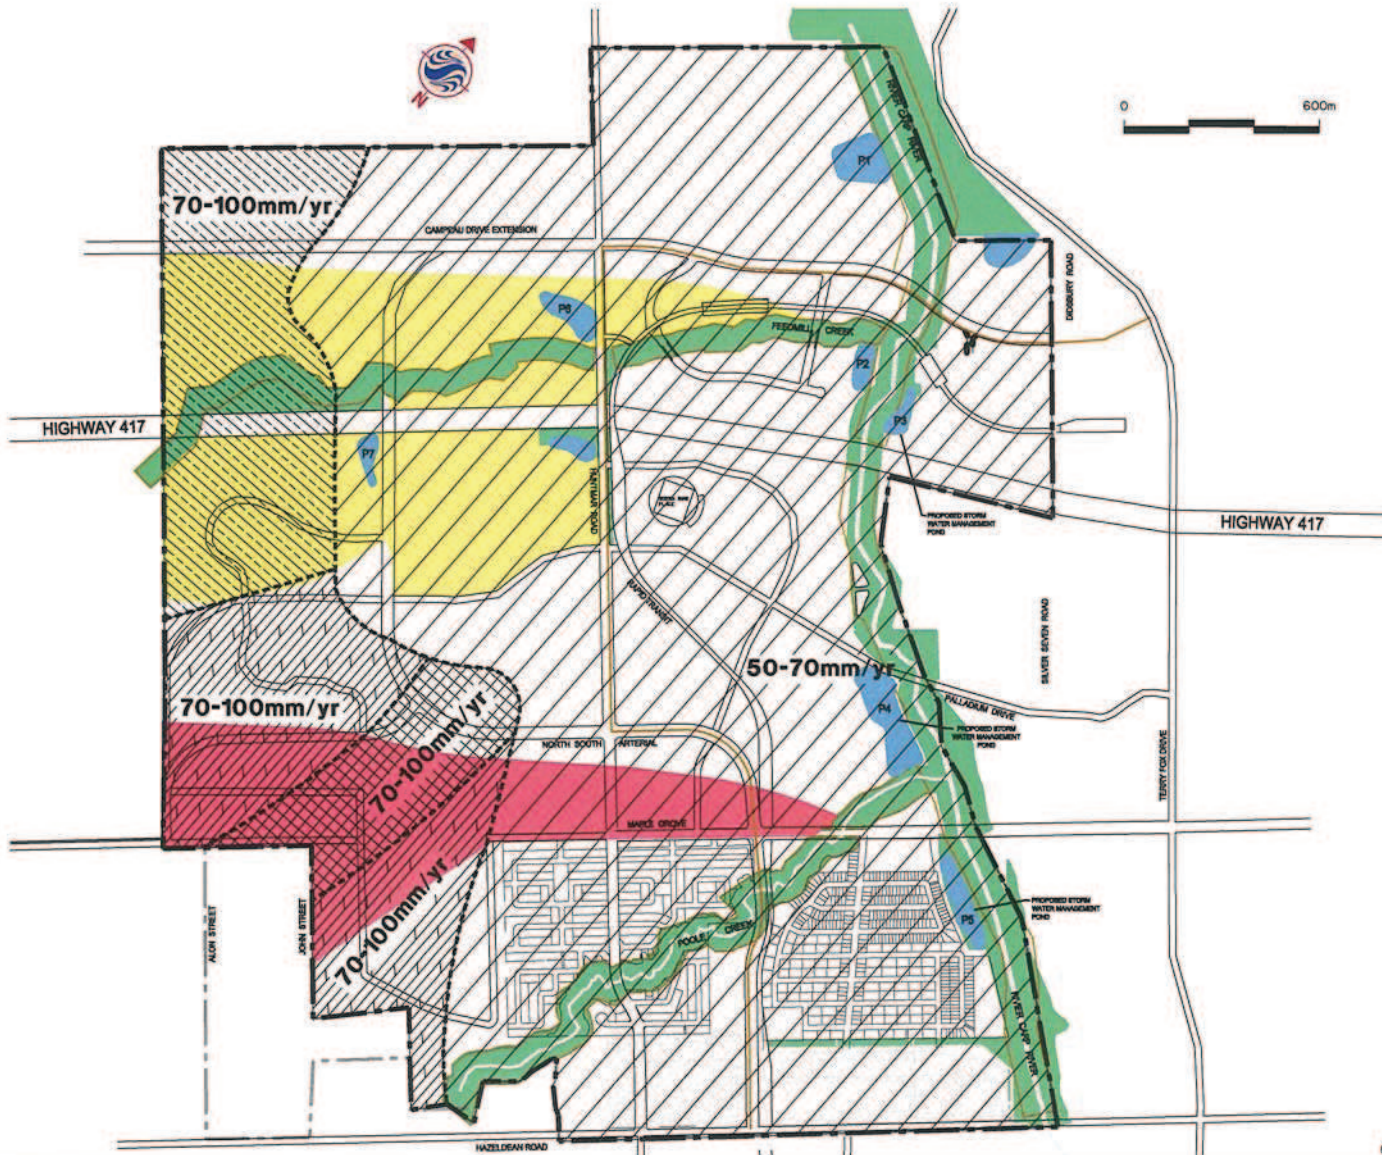

INFILTRATION TARGETS

SOIL TYPE	RECHARGE	
	FINE SAND	MODERATE
	PALEOZOIC BEDROCK	MODERATE
	TILL	MODERATE
	CLAY	LOW

- Kanata-West Concept Plan Boundary
- Area Tributary To Feedmill Creek (Existing Conditions)
- Area Tributary To Maple Grove Ditch System and Poole Creek (Existing Conditions)
- OPEN SPACE

NOTE:
 SOIL TYPES AND RECHARGE POTENTIAL FROM CARP RIVER WATERSHED/SUBWATERSHED STUDY BY ROBINSON CONSULTANTS INC. 2004.
 TARGET INFILTRATION RATES OBTAINED FROM ENVIRONMENTAL FACT SHEETS FROM 2004 REPORT.



CCCL/IBI
 CONSULTANTS LIMITED

MAY 2006

60400405

FIG. 5.4

DRAWINGS / FIGURES


Site Population Estimate







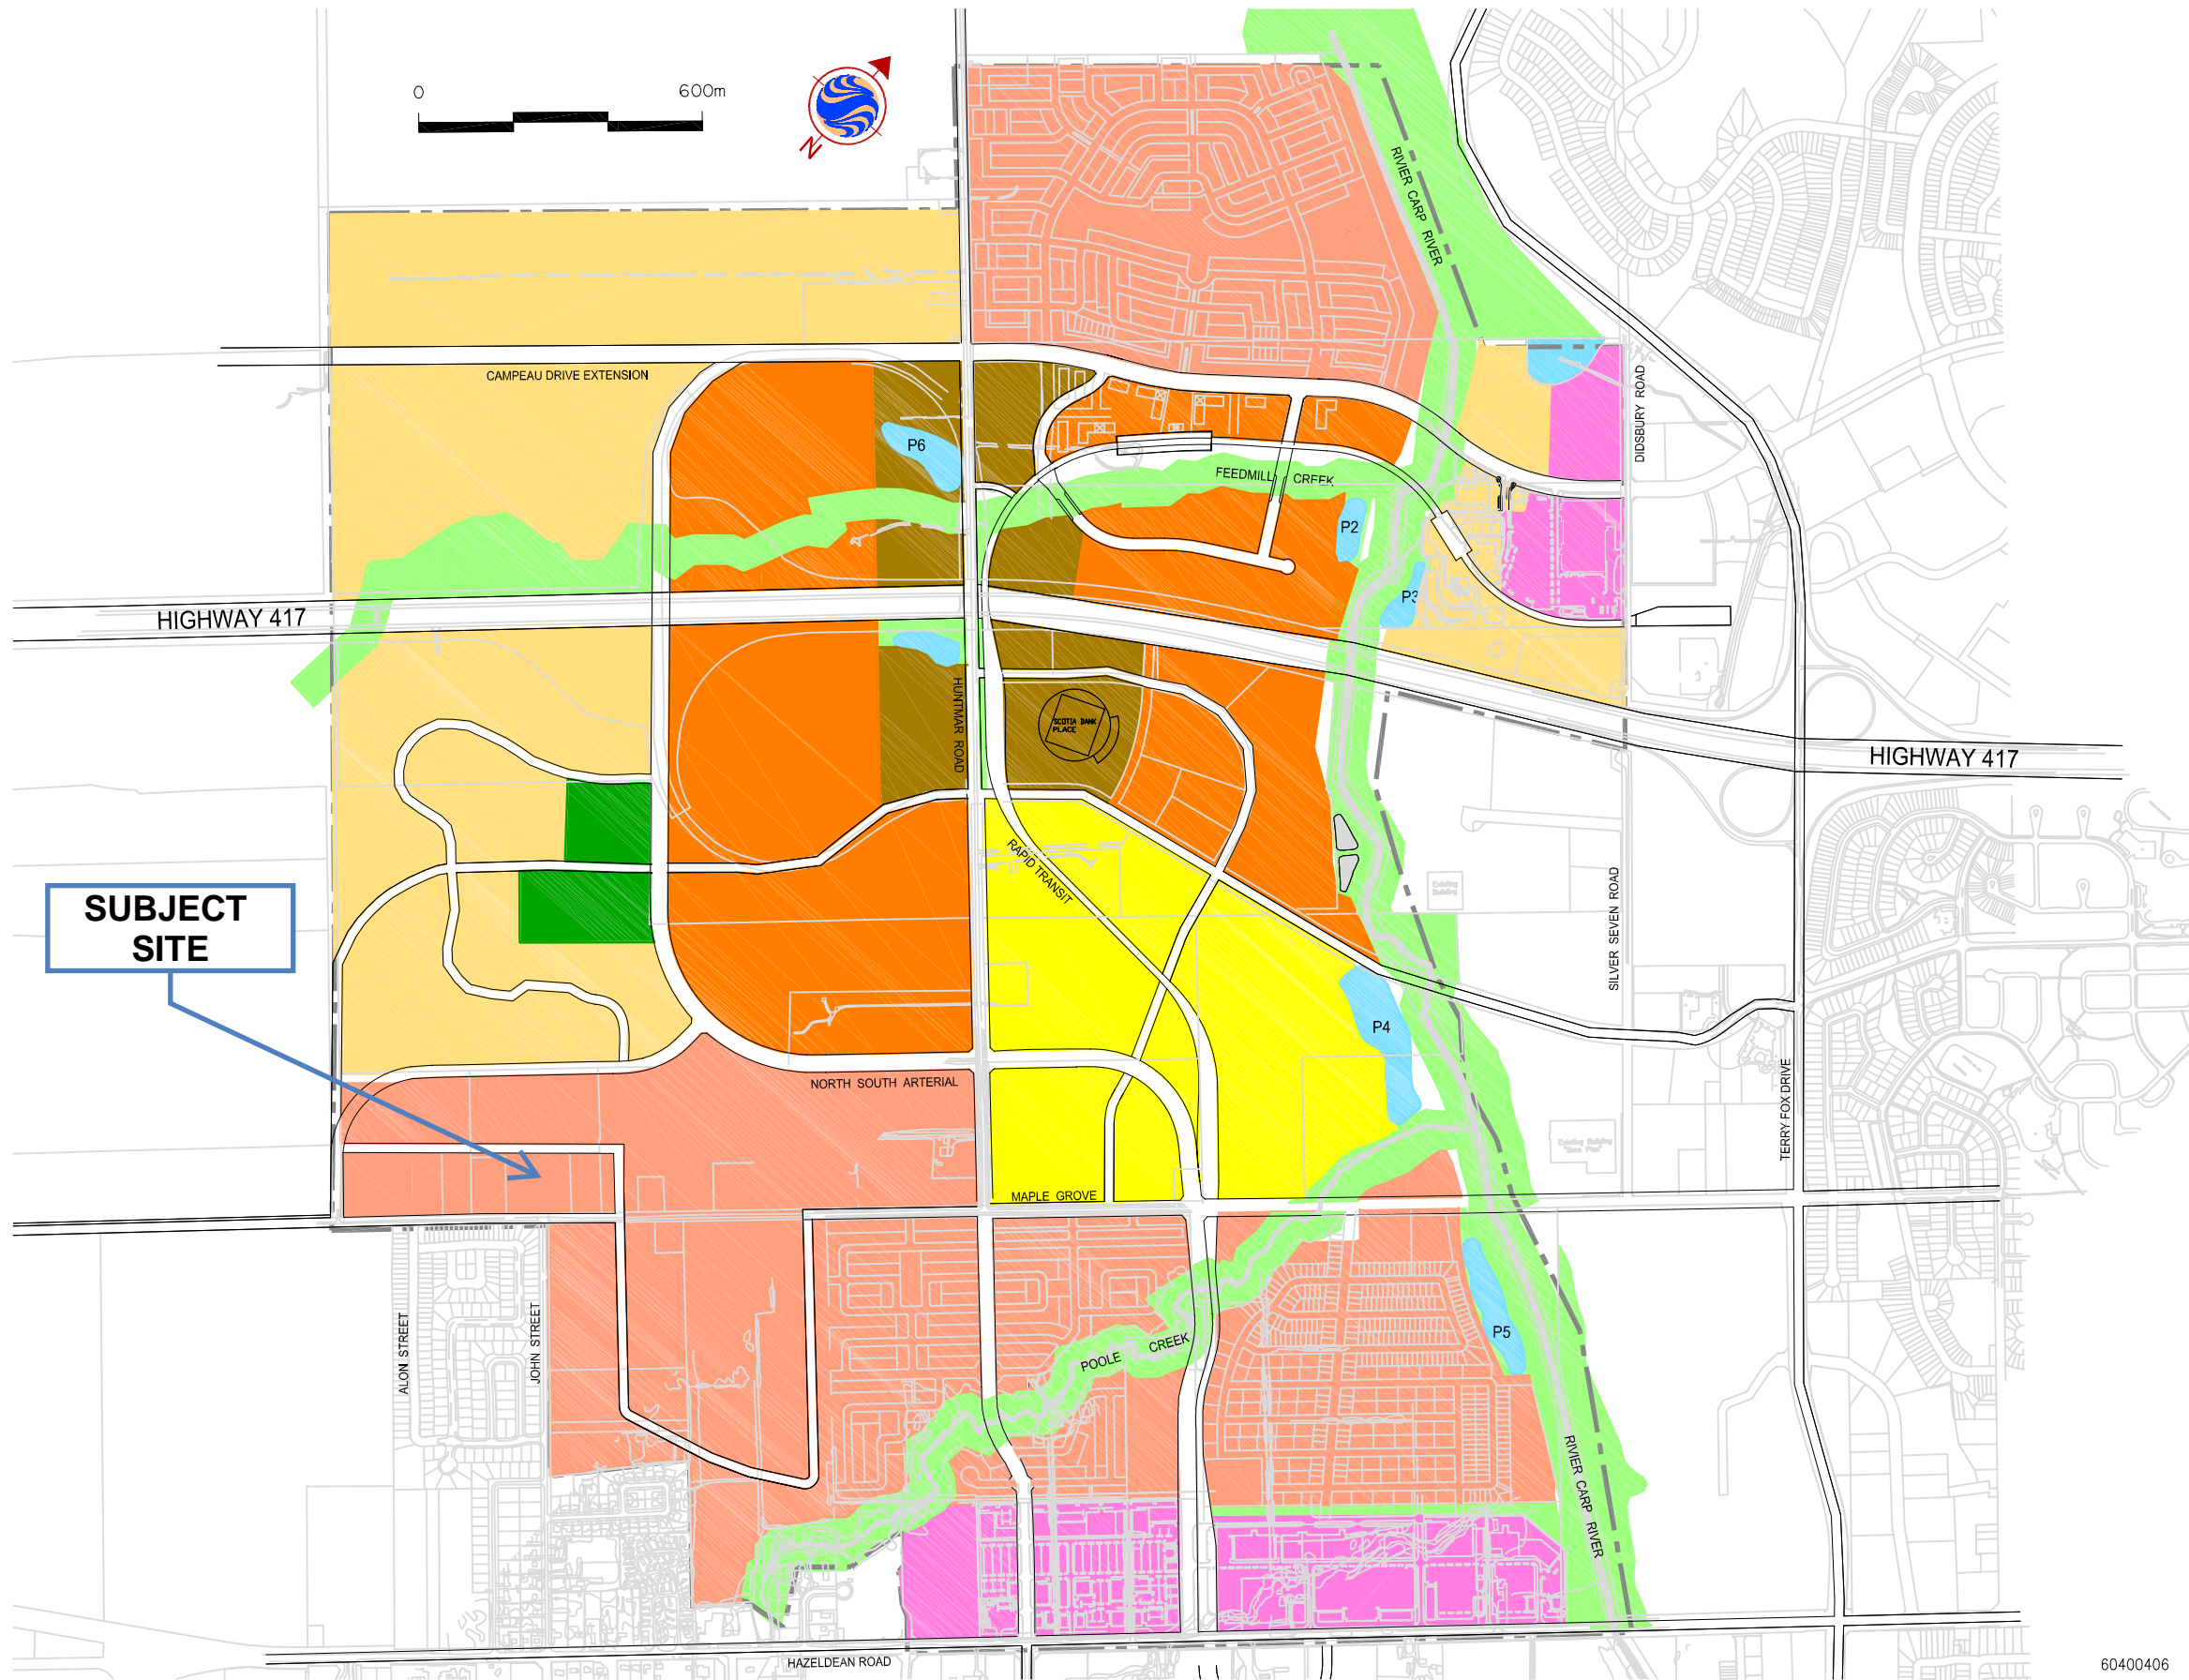


Phase	Building Types	Gross Building Area	Gross Floor Area	Storeys	bedrooms	p/unit	number of units	number of occupants
1	Town Houses			3	2	2.7	4	11
2	Town Houses			3	2	2.7	14	38
3	Semidetached and town homes			3	3	3.4	24	82
4	Semidetached			3	3	3.4	20	68
5	Apartment Buildings	4964	19856	4	1	1.4	95	133
					2	2.1	95	200
6	Apartment Buildings	6757	27028	4	1	1.4	130	182
					2	2.1	130	273
Total								987

Kanata West Land Use (FIG. 2.1)

Kanata West Master Servicing Study

LAND USE PLAN




-  Kanata-West Concept Plan Boundary
-  PRESTIGE BUSINESS PARK
-  OPEN SPACE
-  COMMUNITY RETAIL
-  DISTRICT PARK
-  RESIDENTIAL
-  MIXED USE
-  HIGH PROFILE EMPLOYMENT
-  EXTENSIVE EMPLOYMENT

60400406



MAY 2006

FIG. 2.1

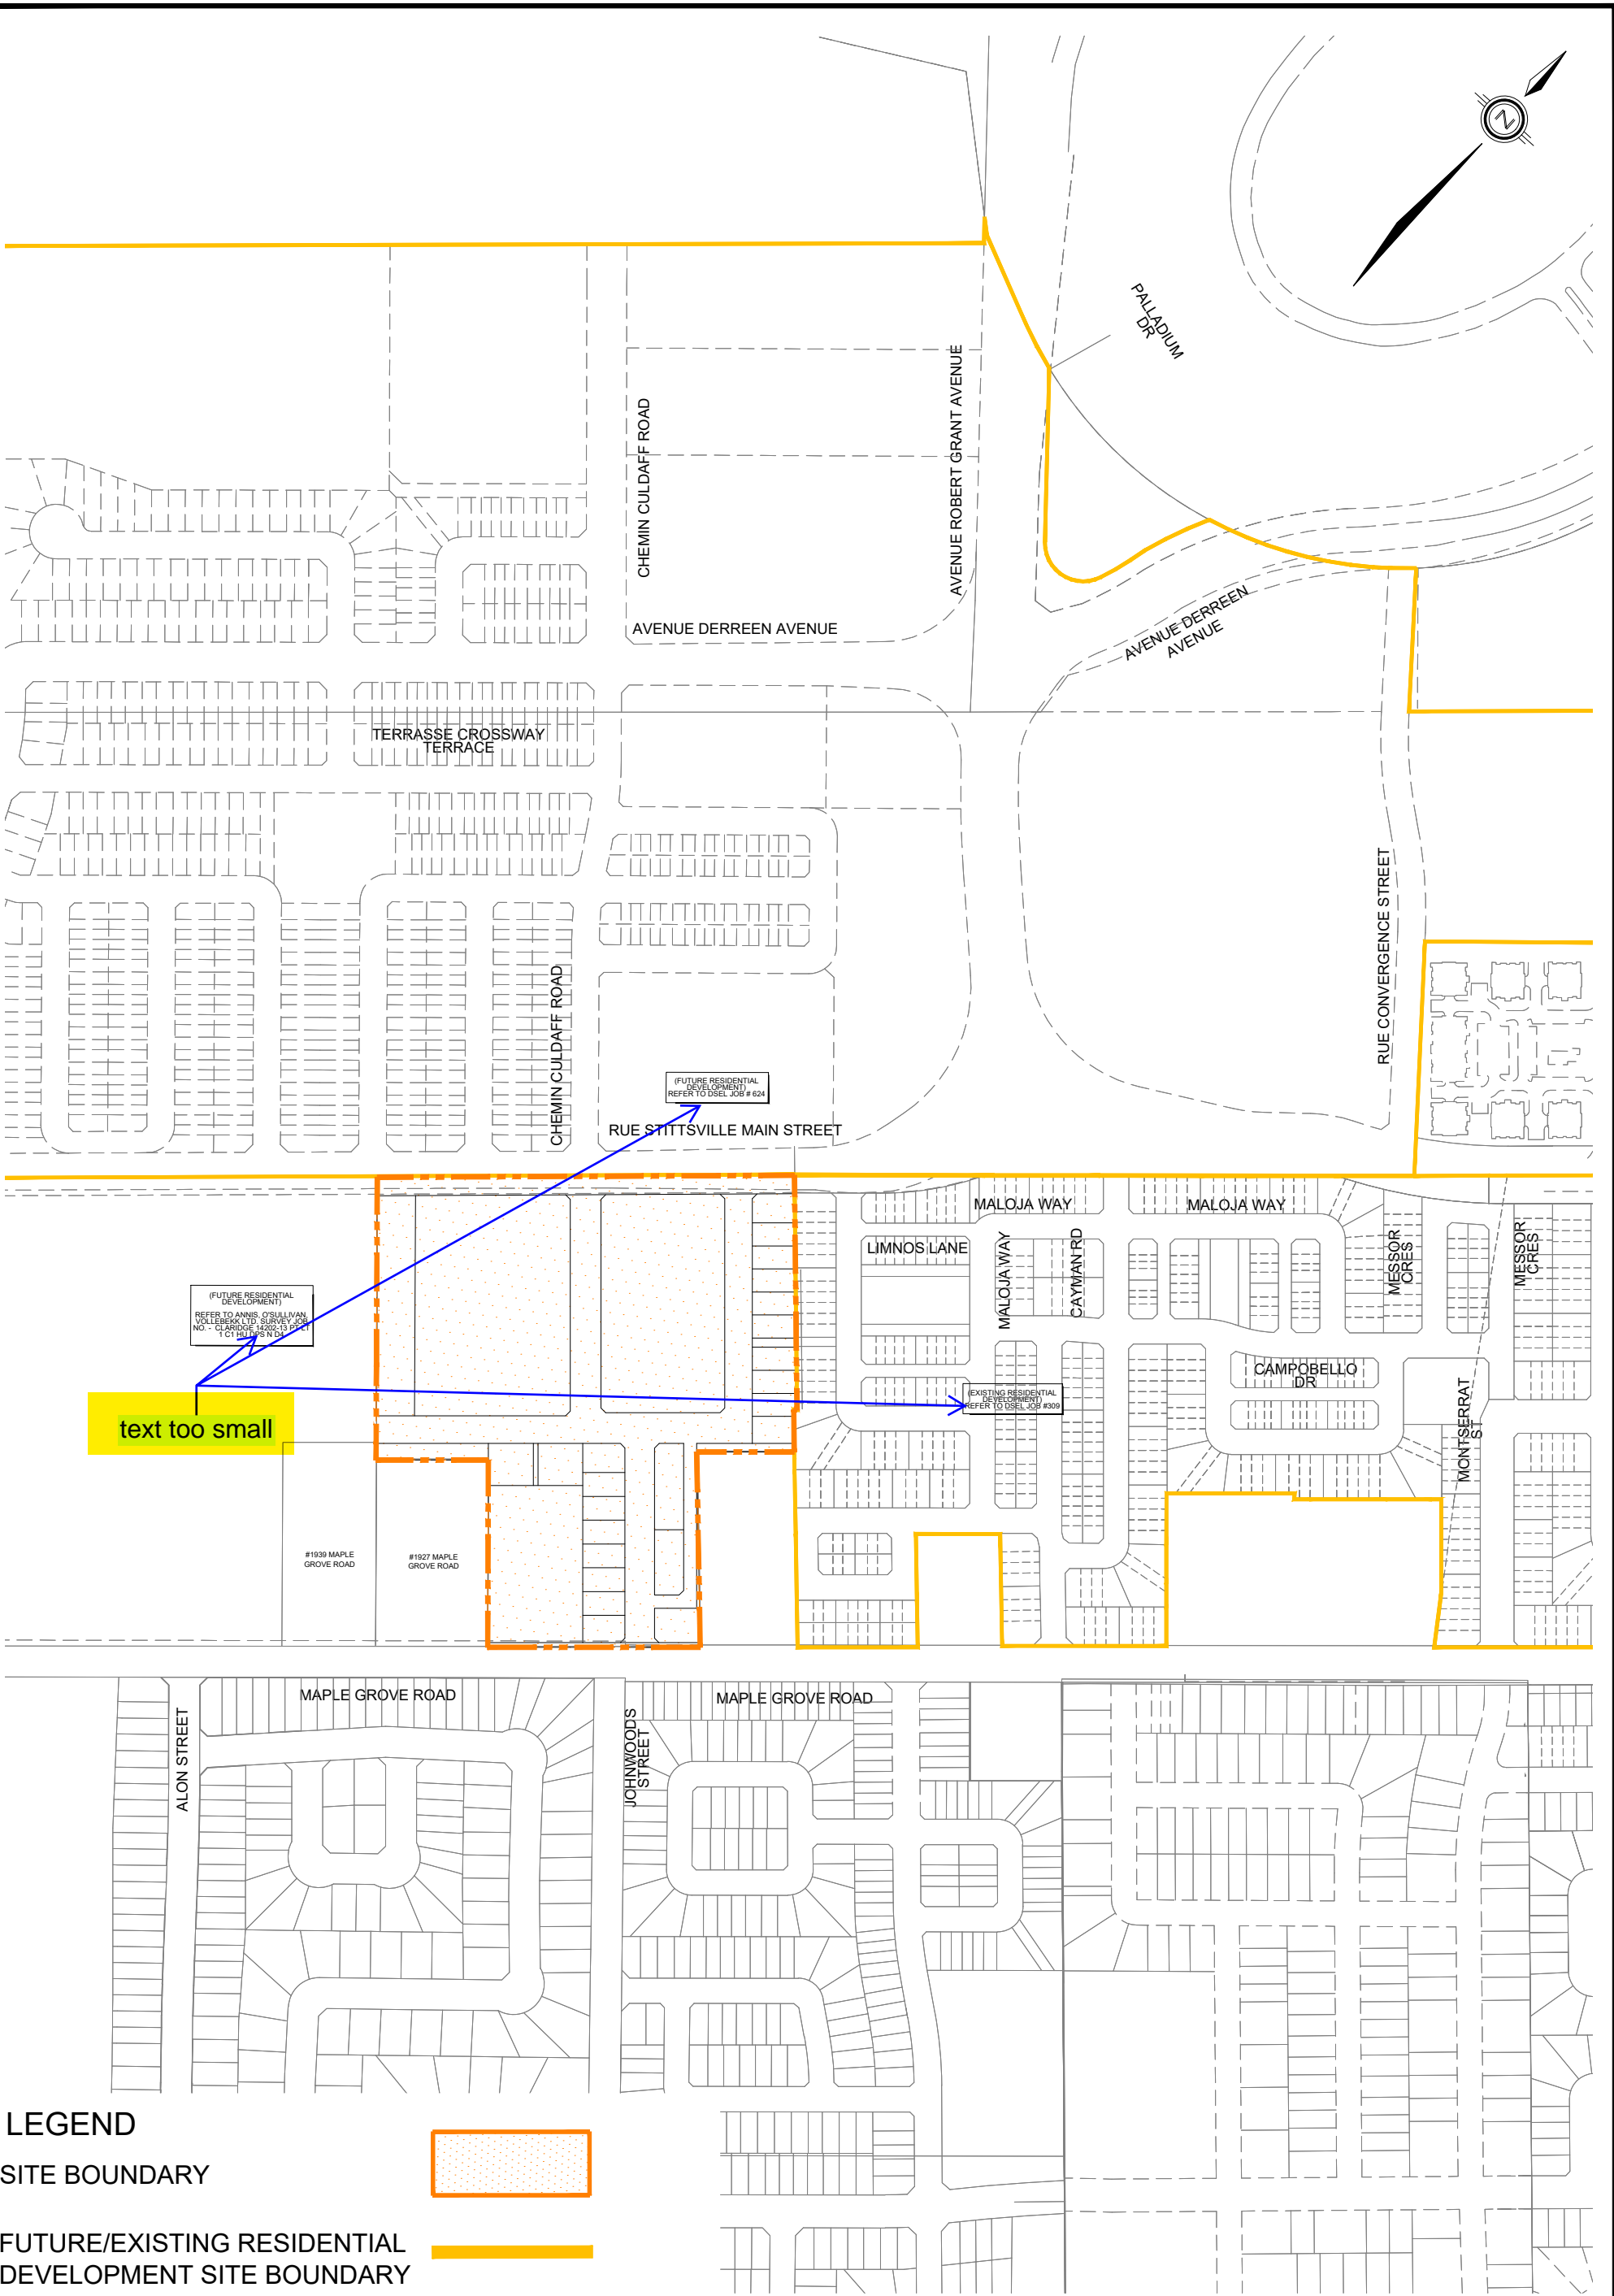


text too small

(FUTURE RESIDENTIAL DEVELOPMENT)
REFER TO ANNIS O'SULLIVAN
VOLLEBEK LTD SURVEY JOB
NO. - CLARIDGE 14502-13 P. 14
1 C1 BUILDINGS N.D.

(EXISTING RESIDENTIAL DEVELOPMENT)
REFER TO USEL JOB #309

LEGEND

SITE BOUNDARY



FUTURE/EXISTING RESIDENTIAL DEVELOPMENT SITE BOUNDARY





120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

FORMASIAM 1919 MAPLE GROVE
CITY OF OTTAWA

KEY PLAN

SCALE:	1:4000	PROJECT No.:	16-861
DATE:	JULY 2020	FIGURE:	1

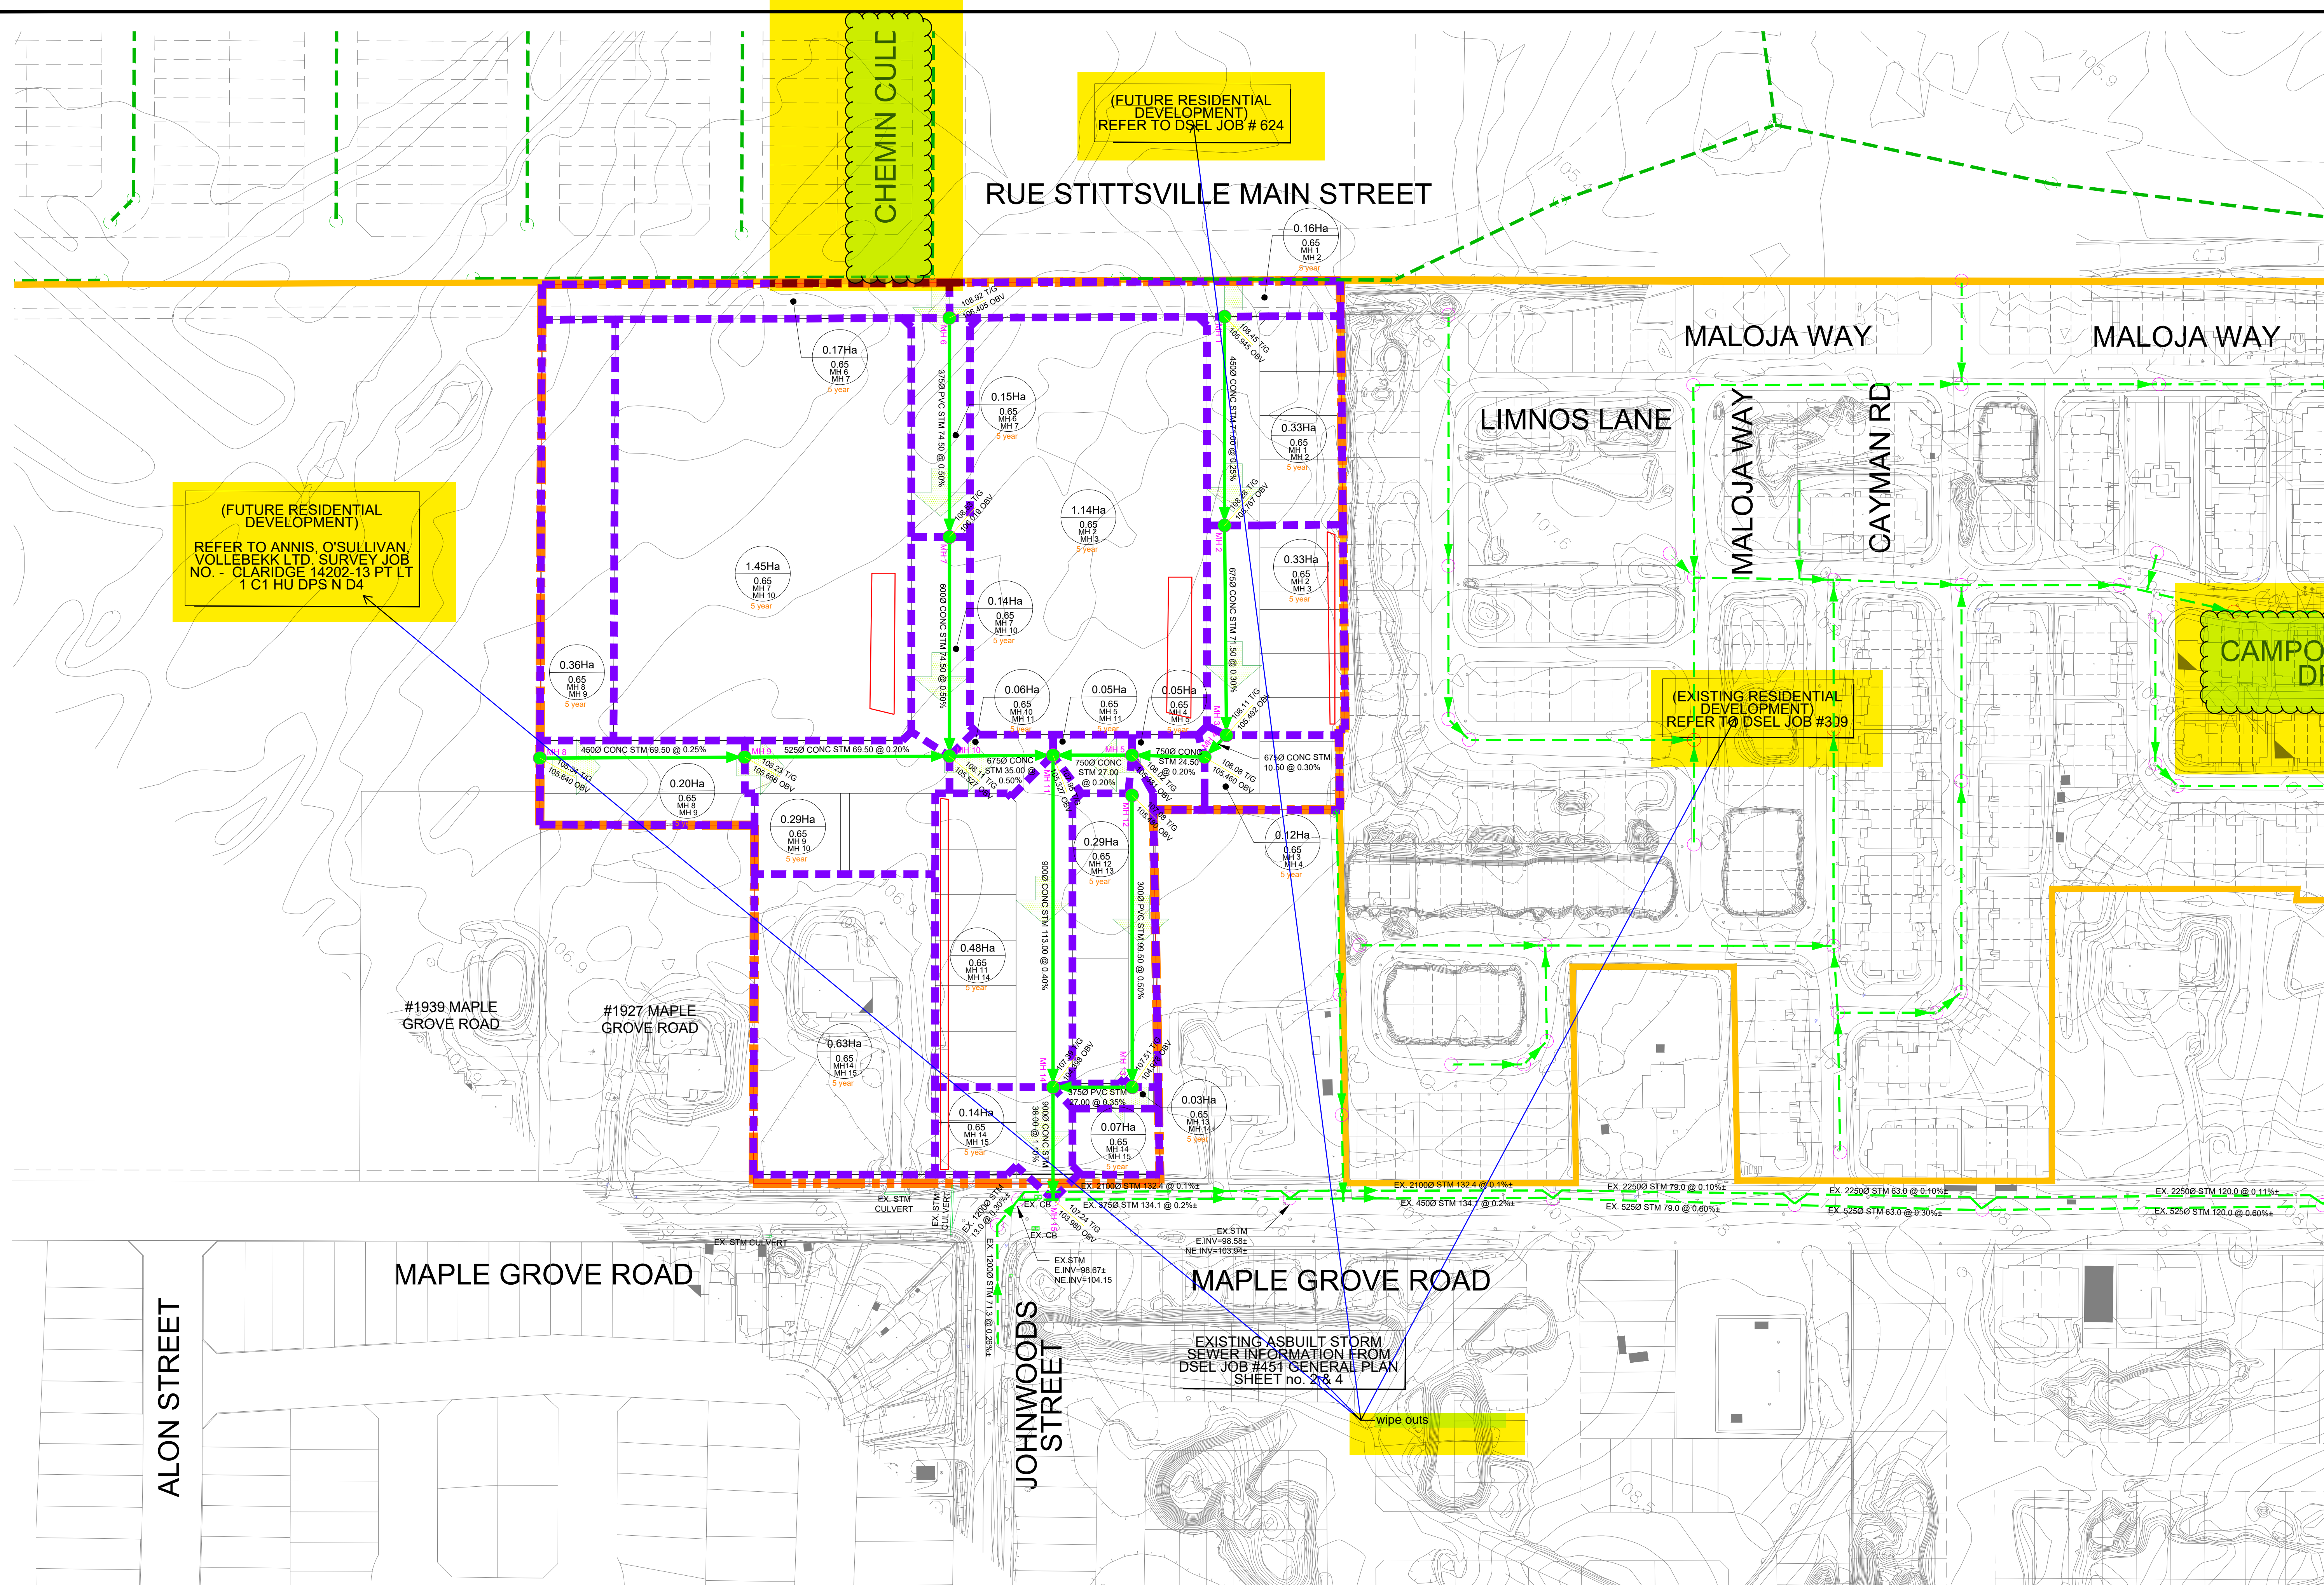

(FUTURE RESIDENTIAL DEVELOPMENT)
REFER TO ANNIS, O'SULLIVAN, VOLLEBEKK LTD. SURVEY JOB NO. - CLARIDGE 14202-13 PT LT 1 C1 HU DPS N D4

(FUTURE RESIDENTIAL DEVELOPMENT)
REFER TO DSEL JOB # 624

CAMPO DF

EXISTING ASBUILT STORM SEWER INFORMATION FROM DSEL JOB #451 GENERAL PLAN SHEET no. 2 & 4

wipe outs


LEGEND

- SUBJECT LANDS
- STORM TRUNK
- - - EXISTING STORM SEWER
- - - FUTURE STORM SEWER
- - - STORM DRAINAGE AREA
- - - EXISTING STORM DRAINAGE AREA
- ↓ OVERLAND FLOW ROUTE
- PROPOSED STORM MANHOLE
- TOP OF GRATE
- PROPOSED STORM OBVERT
- EXISTING STORM MANHOLE
- FUTURE STORM MANHOLE
- 6.07Ha
0.65 MH 150
MH 153
5-YEAR
- STORM DRAINAGE AREA
- RUN-OFF COEFFICIENT
- UPSTREAM MH
- DOWNSTREAM MH
- STORM FREQUENCY

DSEL
david schaeffer engineering ltd
120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel: (613) 836-8856
Fax: (613) 836-7183
www.DSEL.ca

FORMASIAM 1919
MAPLE GROVE
CITY OF OTTAWA

STORM SERVICING PLAN	
SCALE: 1:1000	PROJECT No.: 16-861
DATE: JULY 2020	DRAWING: 2

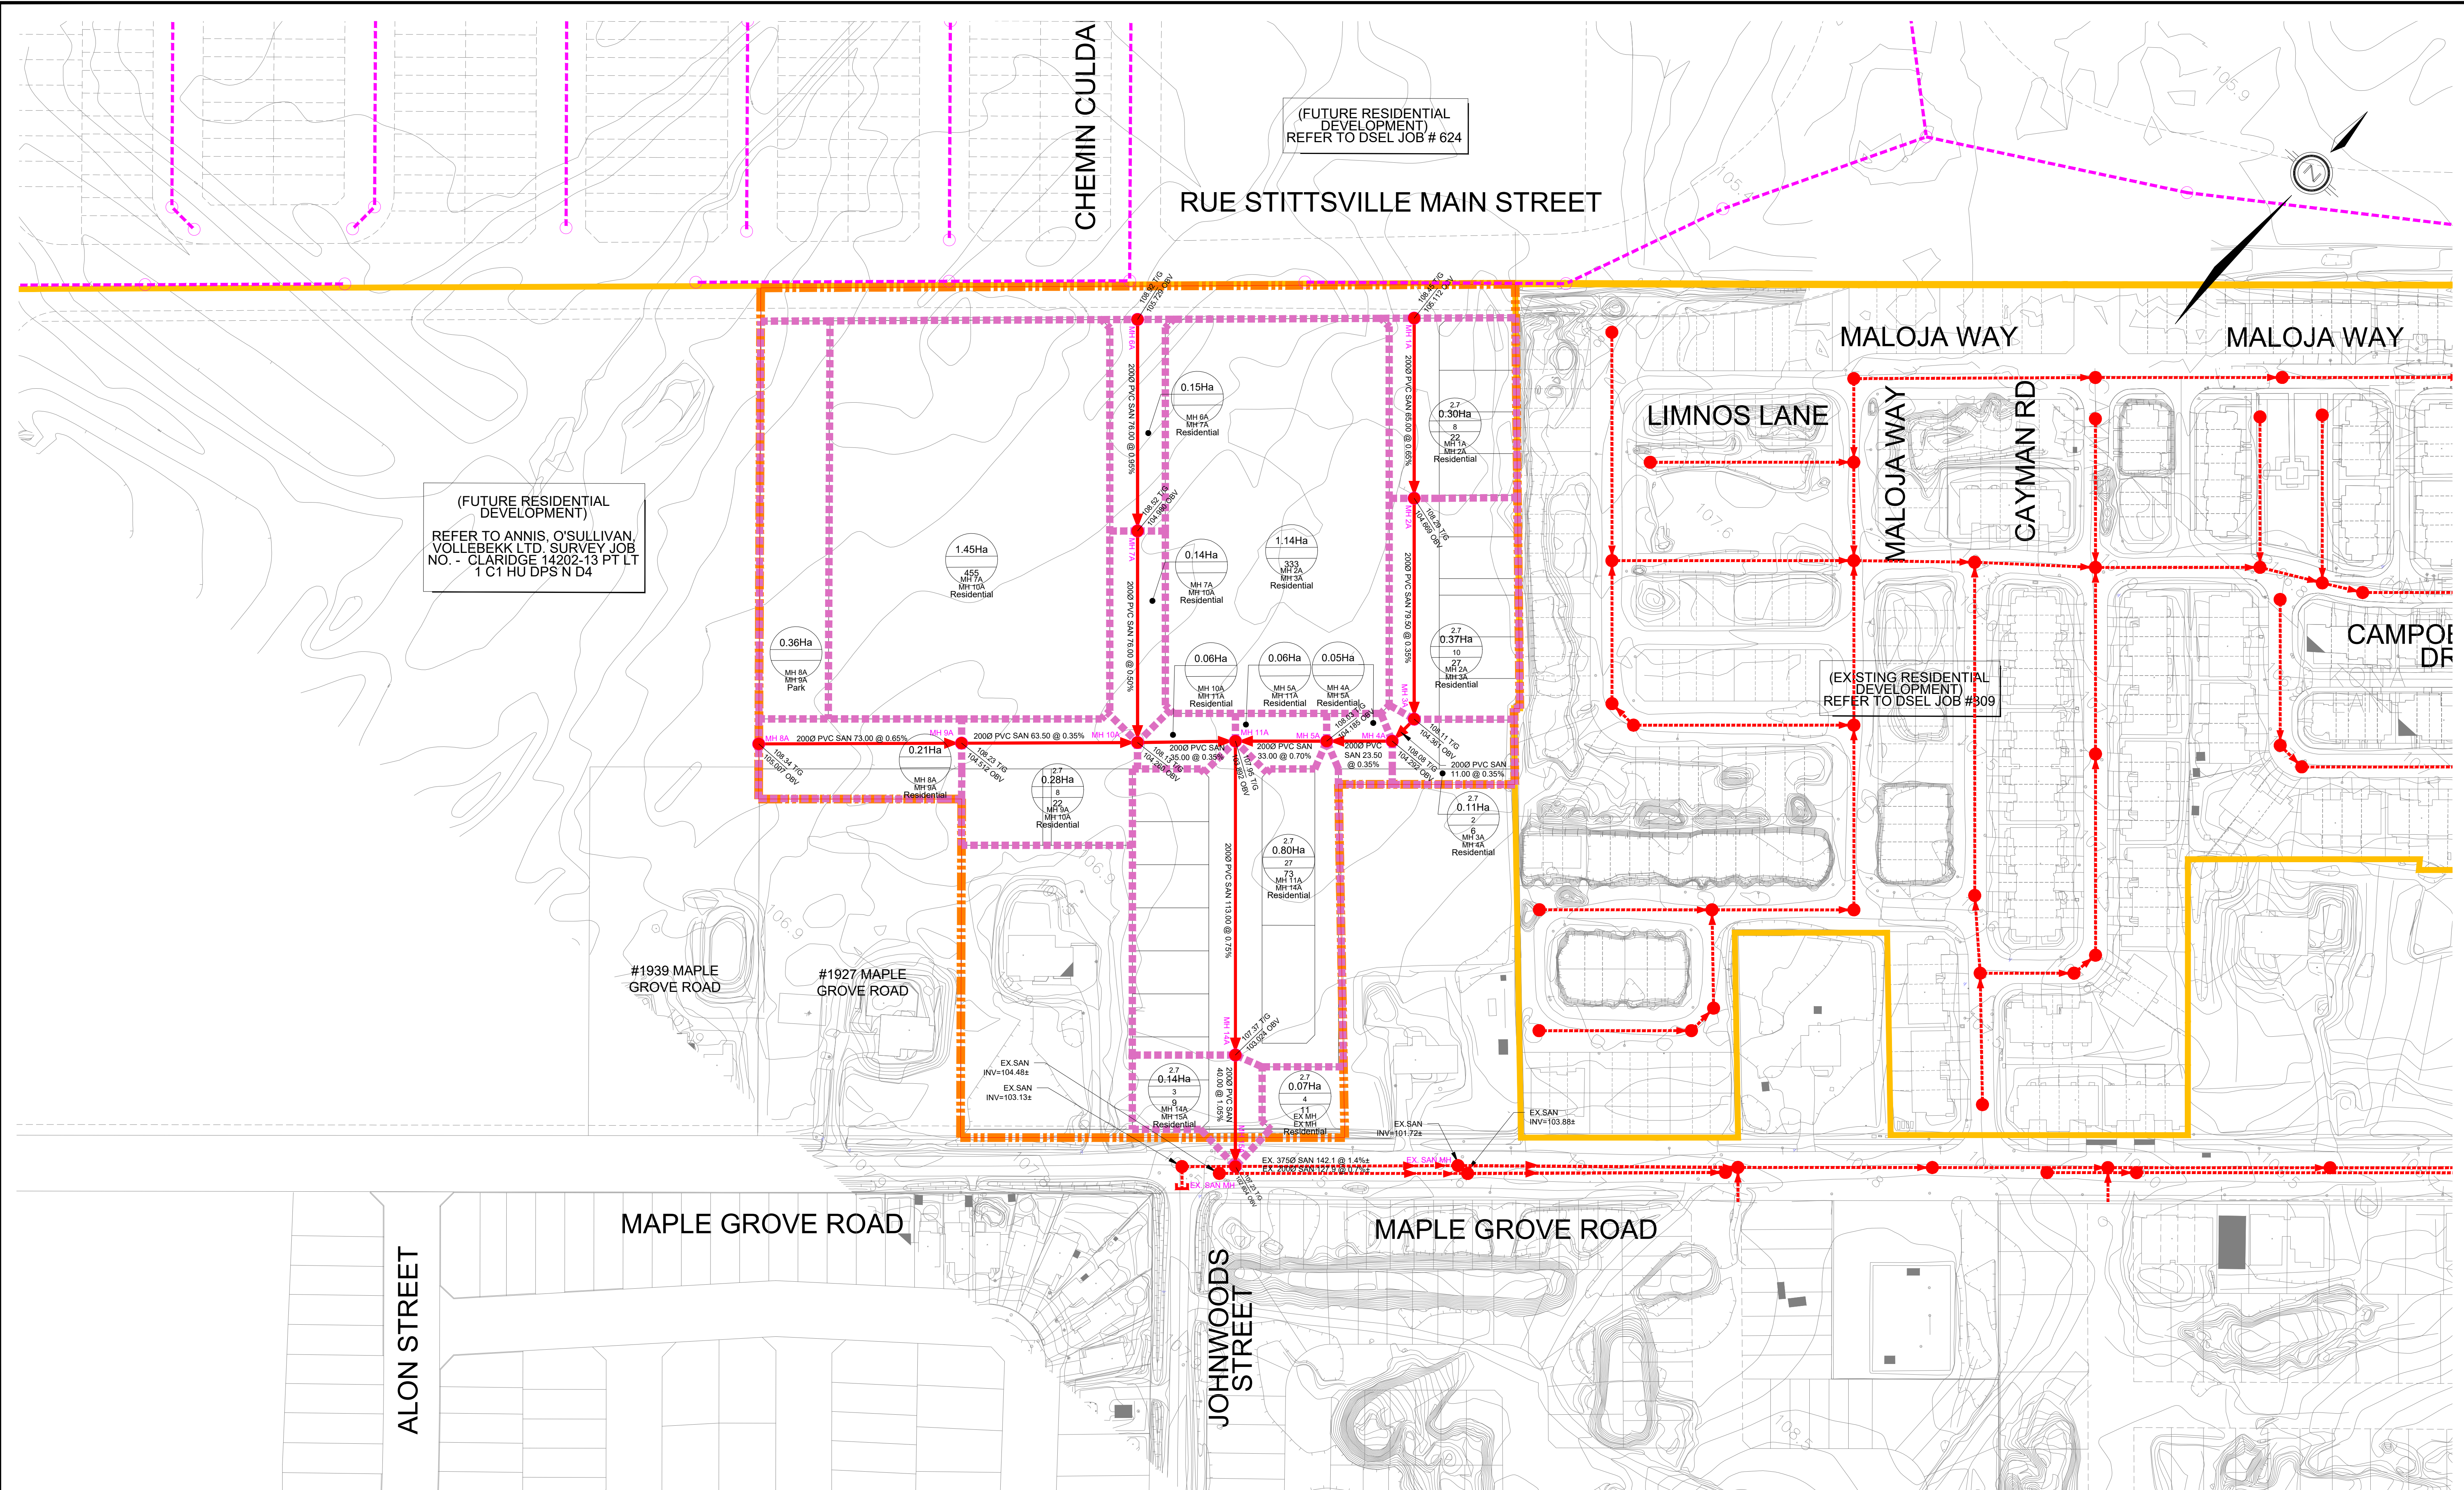

(FUTURE RESIDENTIAL DEVELOPMENT)
 REFER TO ANNIS, O'SULLIVAN, VOLLEBEKK LTD. SURVEY JOB NO. - CLARIDGE 14202-13 PT LT 1 C1 HU DPS N D4

(FUTURE RESIDENTIAL DEVELOPMENT)
 REFER TO DSEL JOB # 624


(EXISTING RESIDENTIAL DEVELOPMENT)
 REFER TO DSEL JOB #309

- LEGEND**
- SUBJECT LANDS
 - SANITARY TRUNK
 - EXISTING SANITARY SEWER
 - - - - FUTURE SANITARY SEWER
 - - - - SANITARY DRAINAGE AREA
 - - - - EXTERNAL SANITARY DRAINAGE AREA
 - SANITARY MANHOLE
 - FUTURE SANITARY MANHOLE

- POPULATION PER UNIT
- SANITARY DRAINAGE AREA
- NUMBER OF UNITS
- TOTAL POPULATION
- UPSTREAM MANHOLE
- DOWNSTREAM MANHOLE
- TRIB TYPE

TOP OF GRATE
 PROPOSED SANITARY OBVERT

<p>DSEL david schaeffer engineering ltd 120 Iker Road, Unit 103 Stittsville, Ontario, K2S 1E9 Tel: (613) 836-8856 Fax: (613) 836-7183 www.DSEL.ca</p>	FORMASIAM 1919 MAPLE GROVE CITY OF OTTAWA	SANITARY SERVICING PLAN	
	SCALE: 1:1000 DATE: JULY 2020	PROJECT No.: 16-861 DRAWING: 3	

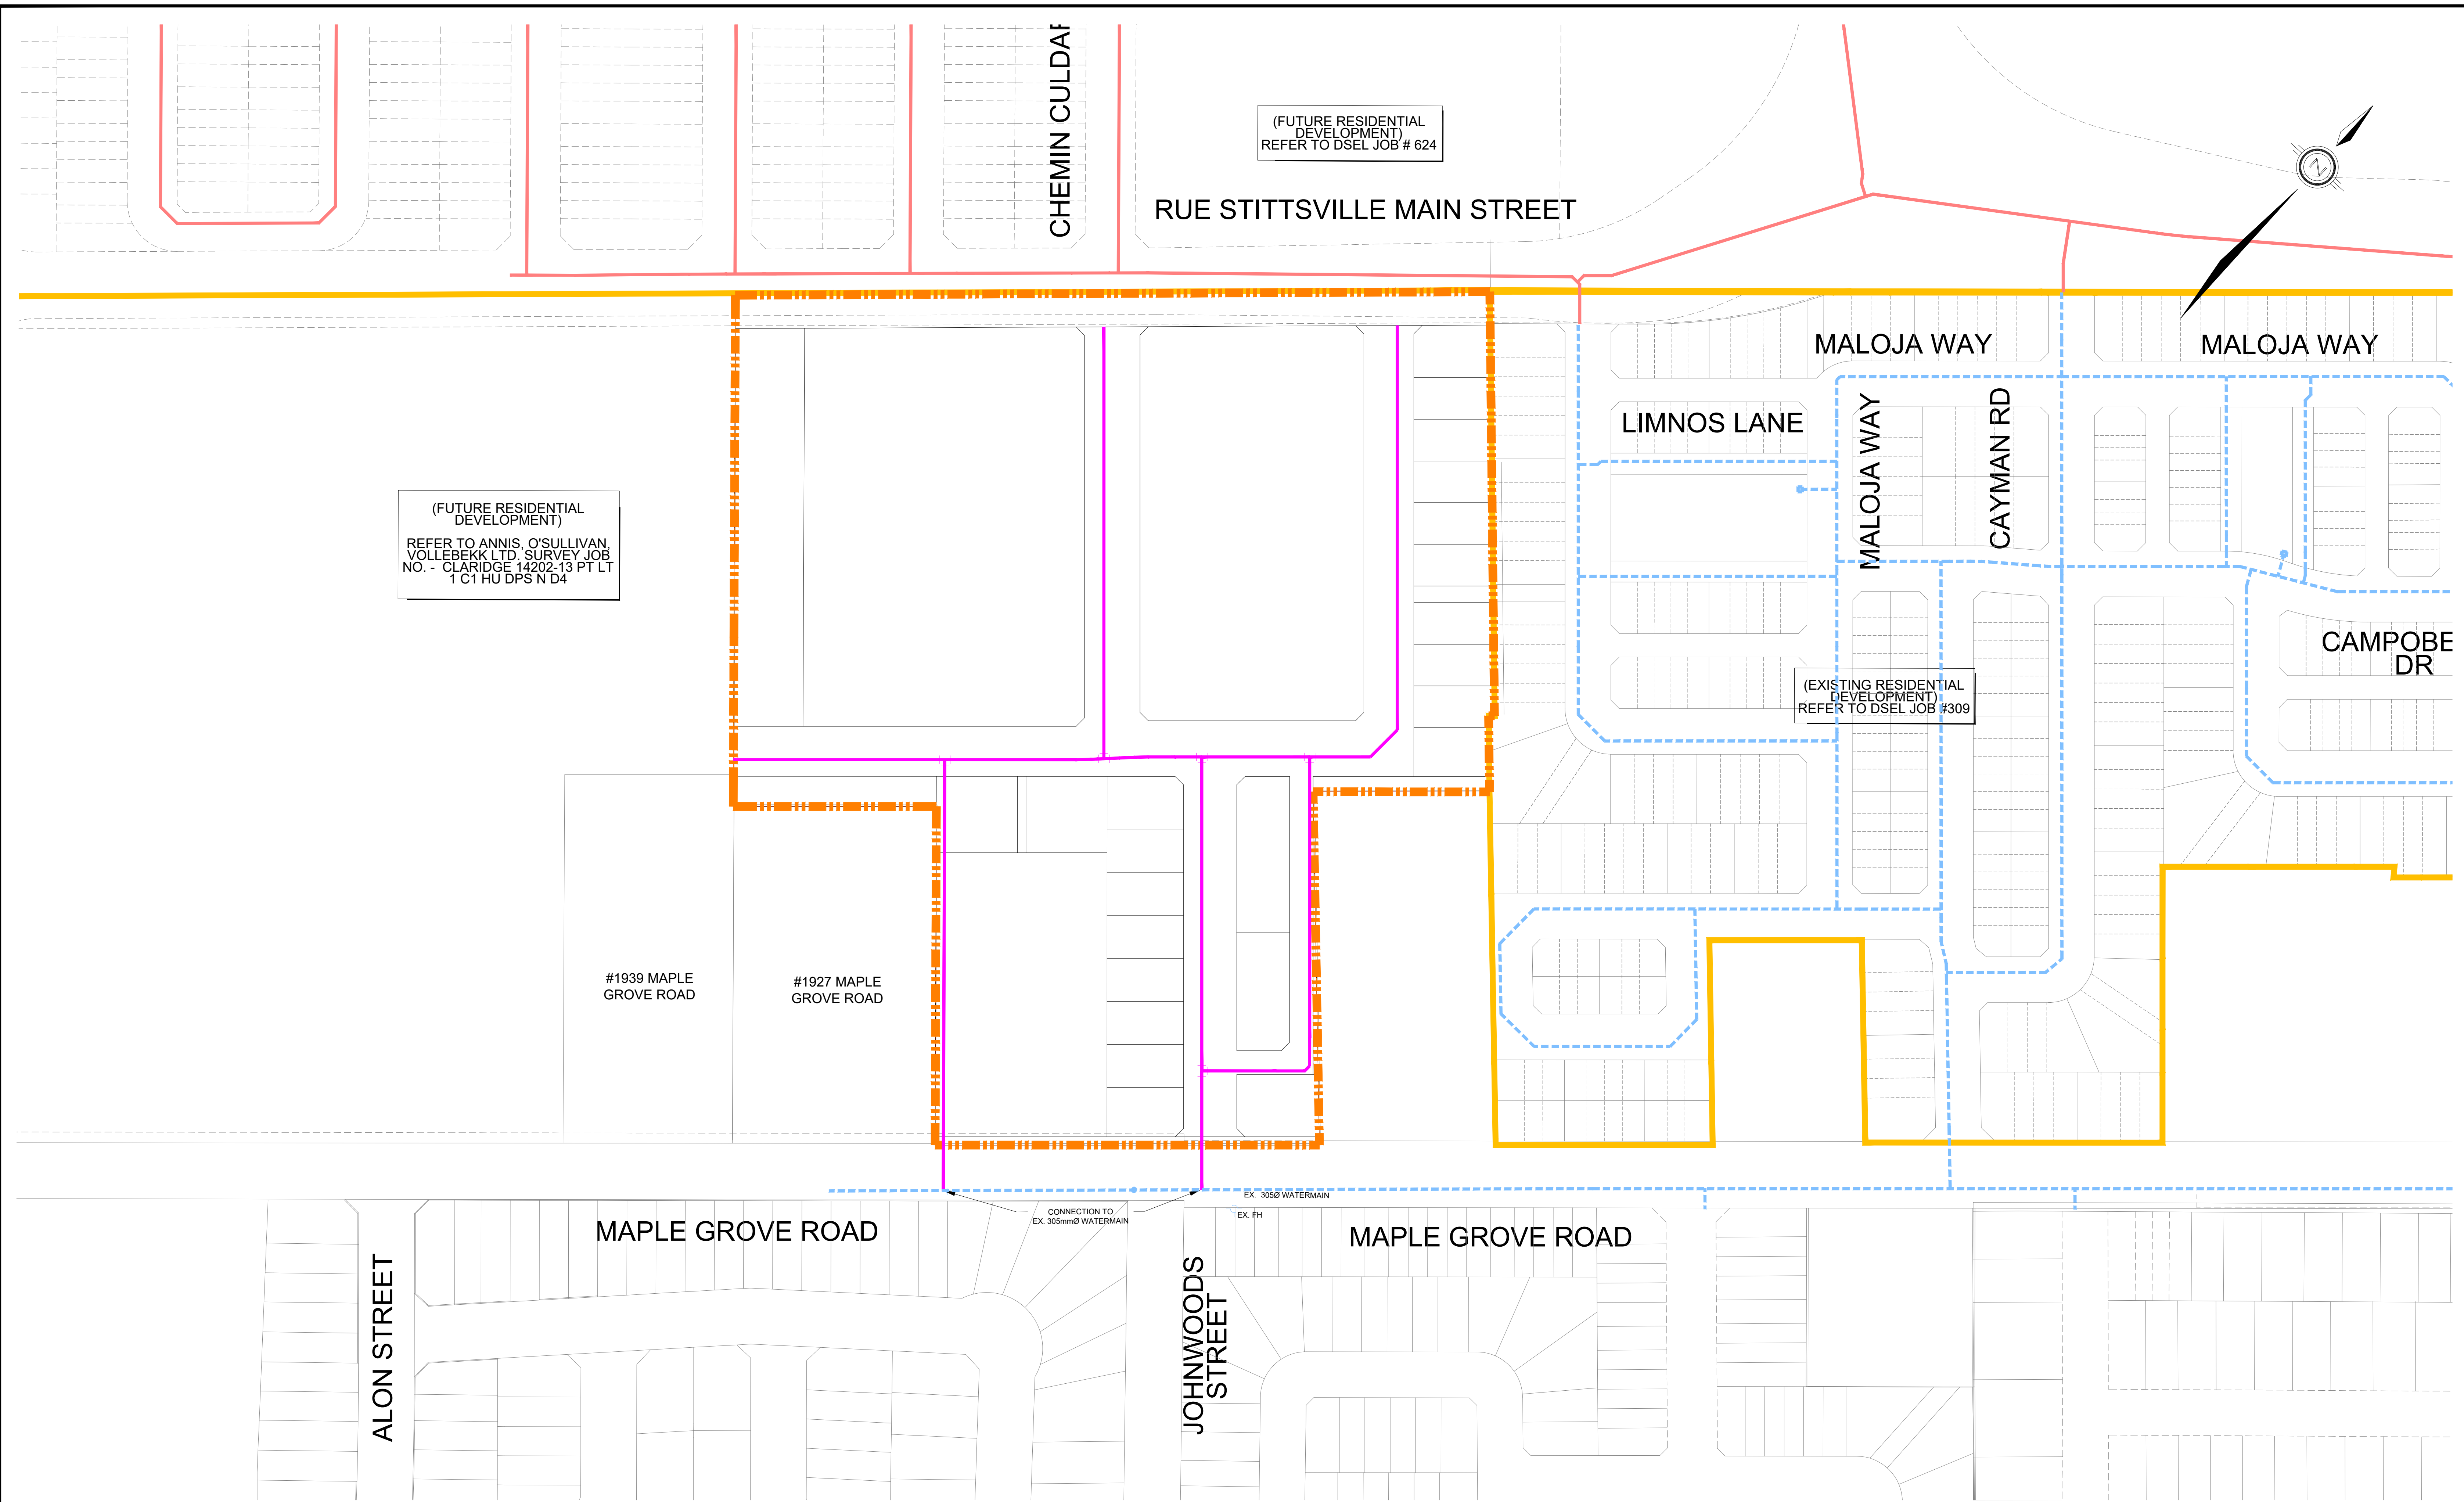


- LEGEND**
- - - - - SUBJECT LANDS
 - PROPOSED LOCAL WATERMAIN
 - - - - - EXISTING WATERMAIN
 - FUTURE WATERMAIN BY OTHERS
 - ┌ PLUG

DSEL
 david schaeffer engineering ltd
 120 Iber Road, Unit 103
 Stittsville, Ontario, K2S 1E9
 Tel: (613) 836-8856
 Fax: (613) 836-7183
 www.DSEL.ca

FORMASIAM 1919
 MAPLE GROVE
 CITY OF OTTAWA

WATERMAIN SERVICING PLAN			
SCALE:	1:1000	PROJECT No.:	16-861
DATE:	JULY 2020	DRAWING:	4

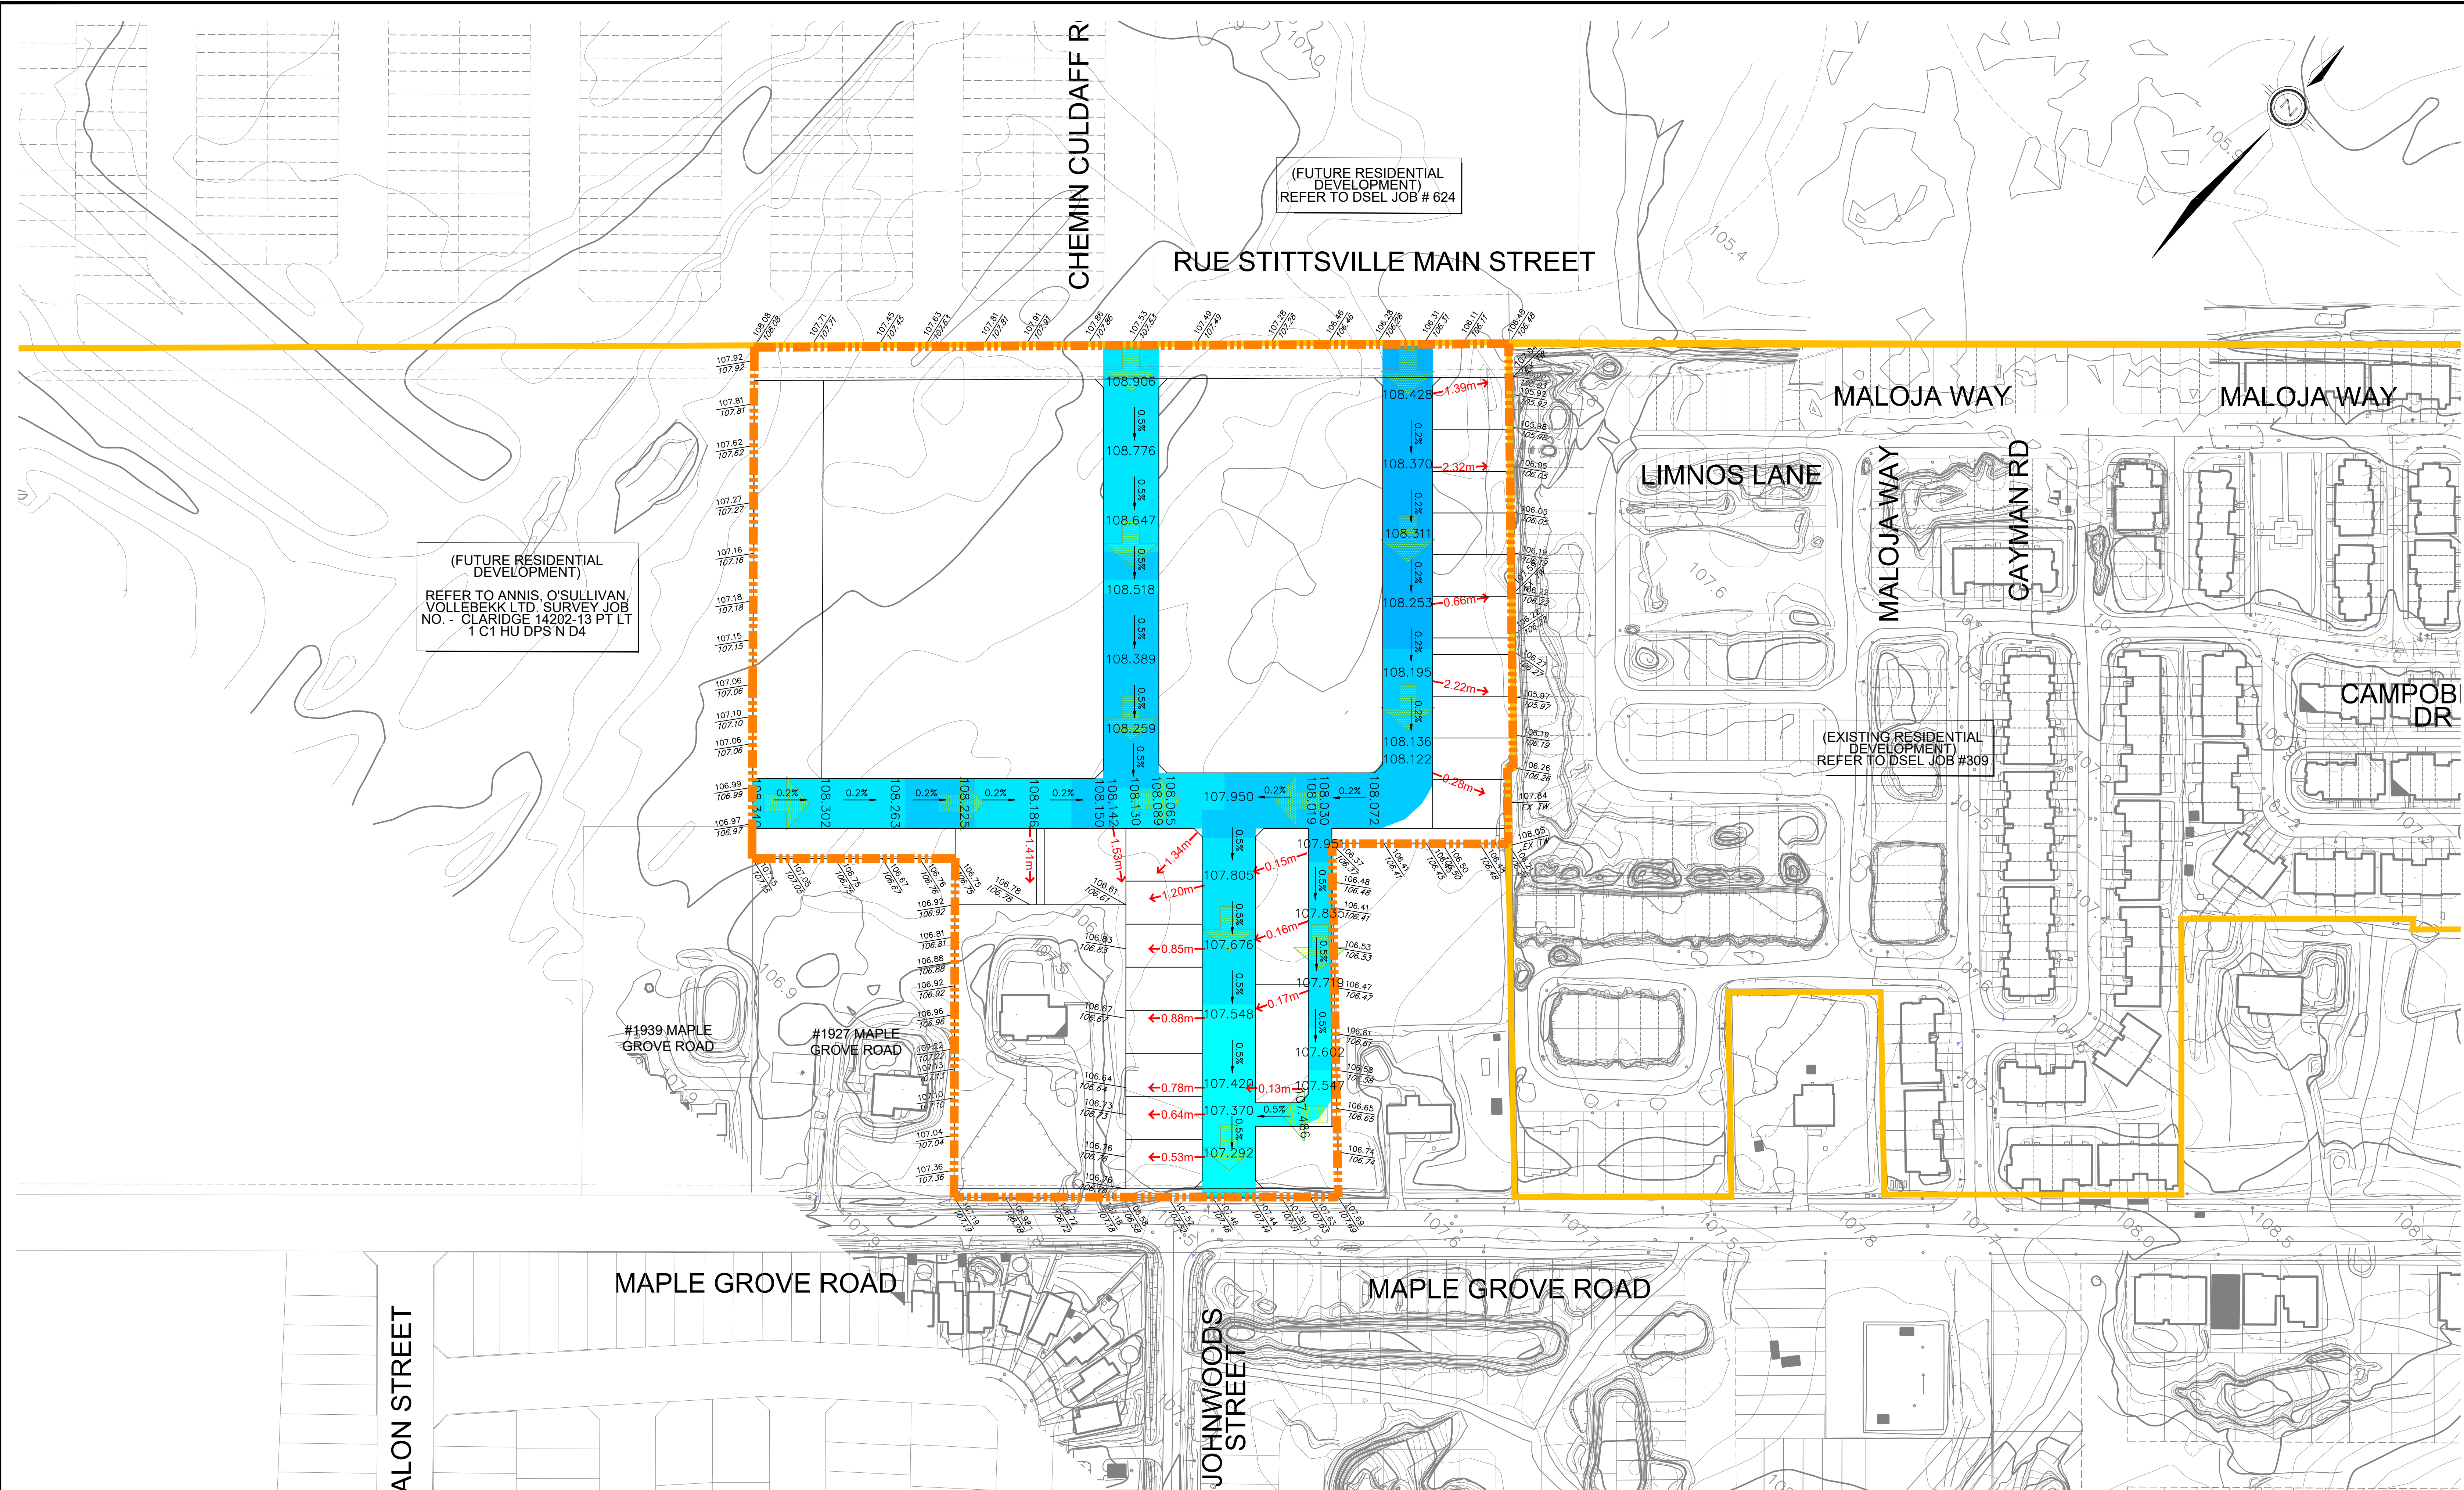

(FUTURE RESIDENTIAL DEVELOPMENT)
 REFER TO ANNIS, O'SULLIVAN,
 VOLLEBEKK LTD. SURVEY JOB
 NO. - CLARIDGE 14202-13 PT LT
 1 C1 HU DPS N D4

(FUTURE RESIDENTIAL DEVELOPMENT)
 REFER TO DSEL JOB # 624

(EXISTING RESIDENTIAL DEVELOPMENT)
 REFER TO DSEL JOB #309

LEGEND

- SUBJECT LANDS
- STORM OVERLAND FLOW ARROW
- PROPOSED CENTERLINE ELEVATION

192.85

PROPOSED ELEVATION
 EXISTING ELEVATION
 EXISTING CONTOUR ELEVATION
 FUTURE CENTERLINE ELEVATION

193.50
 193.50
 244.50
 [192.85]

CUT-FILL DEPTH ALONG CENTER LINE:

CUT DEPTH (m)		FILL DEPTH (m)	
0 - 0.5		0 - 0.5	
0.5 - 1.0		0.5 - 1.0	
1.0 - 1.5		1.0 - 1.5	
1.5 - 2.0		1.5 - 2.0	
2.0 - 2.5		2.0 - 2.5	
2.5 - 3.0			
3.0 - 3.5			
3.5 - 4.0			
4.0 - 4.5			
> 4.5			

DSEL
 david schaeffer engineering ltd
 120 Iker Road, Unit 103
 Stittsville, Ontario, K2S 1E9
 Tel: (613) 836-8856
 Fax: (613) 836-7183
 www.DSEL.ca

FORMASIAM 1919
 MAPLE GROVE
 CITY OF OTTAWA

GRADING PLAN

SCALE:	1:1000	PROJECT No.:	16-861
DATE:	JULY 2020	DRAWING:	5

APPENDIX A

Pre-Consultation

DEVELOPMENT SERVICING STUDY CHECKLIST

16-861

09/08/2019

4.1 General Content		
<input type="checkbox"/>	Executive Summary (for larger reports only).	N/A
<input checked="" type="checkbox"/>	Date and revision number of the report.	Report Cover Sheet
<input checked="" type="checkbox"/>	Location map and plan showing municipal address, boundary, and layout of proposed development.	Drawings/Figures
<input checked="" type="checkbox"/>	Plan showing the site and location of all existing services.	Figure 1
<input checked="" type="checkbox"/>	Development statistics, land use, density, adherence to zoning and official plan, and reference to applicable subwatershed and watershed plans that provide context to applicable subwatershed and watershed plans that provide context to which individual developments must adhere.	Section 1.0
<input checked="" type="checkbox"/>	Summary of Pre-consultation Meetings with City and other approval agencies.	Section 1.3
<input checked="" type="checkbox"/>	Reference and confirm conformance to higher level studies and reports (Master Servicing Studies, Environmental Assessments, Community Design Plans), or in the case where it is not in conformance, the proponent must provide justification and develop a defensible design criteria.	Section 2.1
<input checked="" type="checkbox"/>	Statement of objectives and servicing criteria.	Section 1.0
<input checked="" type="checkbox"/>	Identification of existing and proposed infrastructure available in the immediate area.	Sections 1.1, 3.1, 4.1, 5.1
<input type="checkbox"/>	Identification of Environmentally Significant Areas, watercourses and Municipal Drains potentially impacted by the proposed development (Reference can be made to the Natural Heritage Studies, if available).	N/A
<input type="checkbox"/>	Concept level master grading plan to confirm existing and proposed grades in the development. This is required to confirm the feasibility of proposed stormwater management and drainage, soil removal and fill constraints, and potential impacts to neighbouring properties. This is also required to confirm that the proposed grading will not impede existing major system flow paths.	N/A
<input type="checkbox"/>	Identification of potential impacts of proposed piped services on private services (such as wells and septic fields on adjacent lands) and mitigation required to address potential impacts.	N/A
<input type="checkbox"/>	Proposed phasing of the development, if applicable.	N/A
<input checked="" type="checkbox"/>	Reference to geotechnical studies and recommendations concerning servicing.	Section 2.1
<input checked="" type="checkbox"/>	All preliminary and formal site plan submissions should have the following information: -Metric scale -North arrow (including construction North) -Key plan -Name and contact information of applicant and property owner -Property limits including bearings and dimensions -Existing and proposed structures and parking areas -Easements, road widening and rights-of-way -Adjacent street names	Drawings/Figures
4.2 Development Servicing Report: Water		
<input type="checkbox"/>	Confirm consistency with Master Servicing Study, if available	N/A
<input checked="" type="checkbox"/>	Availability of public infrastructure to service proposed development	Section 3.1
<input checked="" type="checkbox"/>	Identification of system constraints	Section 3.1
<input checked="" type="checkbox"/>	Identify boundary conditions	Section 3.2
<input checked="" type="checkbox"/>	Confirmation of adequate domestic supply and pressure	Section 3.2, 3.3

<input checked="" type="checkbox"/>	Confirmation of adequate fire flow protection and confirmation that fire flow is calculated as per the Fire Underwriter's Survey. Output should show available fire flow at locations throughout the development.	Section 3.2
<input type="checkbox"/>	Provide a check of high pressures. If pressure is found to be high, an assessment is required to confirm the application of pressure reducing valves.	N/A
<input type="checkbox"/>	Definition of phasing constraints. Hydraulic modeling is required to confirm servicing for all defined phases of the project including the ultimate design	N/A
<input type="checkbox"/>	Address reliability requirements such as appropriate location of shut-off valves	N/A
<input type="checkbox"/>	Check on the necessity of a pressure zone boundary modification	N/A
<input checked="" type="checkbox"/>	Reference to water supply analysis to show that major infrastructure is capable of delivering sufficient water for the proposed land use. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure range	Section 3.2, 3.3
<input type="checkbox"/>	Description of the proposed water distribution network, including locations of proposed connections to the existing system, provisions for necessary looping, and appurtenances (valves, pressure reducing valves, valve chambers, and fire hydrants) including special metering provisions.	N/A
<input type="checkbox"/>	Description of off-site required feeder mains, booster pumping stations, and other water infrastructure that will be ultimately required to service proposed development, including financing, interim facilities, and timing of implementation.	N/A
<input checked="" type="checkbox"/>	Confirmation that water demands are calculated based on the City of Ottawa Design Guidelines.	Section 3.2
<input type="checkbox"/>	Provision of a model schematic showing the boundary conditions locations, streets, parcels, and building locations for reference.	N/A

4.3 Development Servicing Report: Wastewater

<input checked="" type="checkbox"/>	Summary of proposed design criteria (Note: Wet-weather flow criteria should not deviate from the City of Ottawa Sewer Design Guidelines. Monitored flow data from relatively new infrastructure cannot be used to justify capacity requirements for proposed infrastructure).	Section 4.2
<input type="checkbox"/>	Confirm consistency with Master Servicing Study and/or justifications for deviations.	N/A
<input type="checkbox"/>	Consideration of local conditions that may contribute to extraneous flows that are higher than the recommended flows in the guidelines. This includes groundwater and soil conditions, and age and condition of sewers.	N/A
<input checked="" type="checkbox"/>	Description of existing sanitary sewer available for discharge of wastewater from proposed development.	Section 4.1
<input checked="" type="checkbox"/>	Verify available capacity in downstream sanitary sewer and/or identification of upgrades necessary to service the proposed development. (Reference can be made to previously completed Master Servicing Study if applicable)	Section 4.2
<input checked="" type="checkbox"/>	Calculations related to dry-weather and wet-weather flow rates from the development in standard MOE sanitary sewer design table (Appendix 'C') format.	Section 4.2, Appendix C
<input checked="" type="checkbox"/>	Description of proposed sewer network including sewers, pumping stations, and forcemains.	Section 4.2
<input type="checkbox"/>	Discussion of previously identified environmental constraints and impact on servicing (environmental constraints are related to limitations imposed on the development in order to preserve the physical condition of watercourses, vegetation, soil cover, as well as protecting against water quantity and quality).	N/A

<input type="checkbox"/>	Pumping stations: impacts of proposed development on existing pumping stations or requirements for new pumping station to service development.	N/A
<input type="checkbox"/>	Forcemain capacity in terms of operational redundancy, surge pressure and maximum flow velocity.	N/A
<input type="checkbox"/>	Identification and implementation of the emergency overflow from sanitary pumping stations in relation to the hydraulic grade line to protect against basement flooding.	N/A
<input type="checkbox"/>	Special considerations such as contamination, corrosive environment etc.	N/A

4.4 Development Servicing Report: Stormwater Checklist

<input checked="" type="checkbox"/>	Description of drainage outlets and downstream constraints including legality of outlets (i.e. municipal drain, right-of-way, watercourse, or private property)	Section 5.1
<input checked="" type="checkbox"/>	Analysis of available capacity in existing public infrastructure.	Section 5.1, Appendix D
<input checked="" type="checkbox"/>	A drawing showing the subject lands, its surroundings, the receiving watercourse, existing drainage patterns, and proposed drainage pattern.	Drawings/Figures
<input checked="" type="checkbox"/>	Water quantity control objective (e.g. controlling post-development peak flows to pre-development level for storm events ranging from the 2 or 5 year event (dependent on the receiving sewer design) to 100 year return period); if other objectives are being applied, a rationale must be included with reference to hydrologic analyses of the potentially affected subwatersheds, taking into account long-term cumulative effects.	Section 5.2
<input checked="" type="checkbox"/>	Water Quality control objective (basic, normal or enhanced level of protection based on the sensitivities of the receiving watercourse) and storage requirements.	Section 5.2
<input checked="" type="checkbox"/>	Description of the stormwater management concept with facility locations and descriptions with references and supporting information	Section 5.2
<input type="checkbox"/>	Set-back from private sewage disposal systems.	N/A
<input type="checkbox"/>	Watercourse and hazard lands setbacks.	N/A
<input checked="" type="checkbox"/>	Record of pre-consultation with the Ontario Ministry of Environment and the Conservation Authority that has jurisdiction on the affected watershed.	Appendix A
<input type="checkbox"/>	Confirm consistency with sub-watershed and Master Servicing Study, if applicable study exists.	N/A
<input checked="" type="checkbox"/>	Storage requirements (complete with calculations) and conveyance capacity for minor events (1:5 year return period) and major events (1:100 year return period).	Section 5.3
<input type="checkbox"/>	Identification of watercourses within the proposed development and how watercourses will be protected, or, if necessary, altered by the proposed development with applicable approvals.	N/A
<input checked="" type="checkbox"/>	Calculate pre and post development peak flow rates including a description of existing site conditions and proposed impervious areas and drainage catchments in comparison to existing conditions.	Section 5.1, 5.3
<input type="checkbox"/>	Any proposed diversion of drainage catchment areas from one outlet to another.	N/A
<input type="checkbox"/>	Proposed minor and major systems including locations and sizes of stormwater trunk sewers, and stormwater management facilities.	N/A
<input type="checkbox"/>	If quantity control is not proposed, demonstration that downstream system has adequate capacity for the post-development flows up to and including the 100-year return period storm event.	N/A
<input type="checkbox"/>	Identification of potential impacts to receiving watercourses	N/A
<input type="checkbox"/>	Identification of municipal drains and related approval requirements.	N/A

<input checked="" type="checkbox"/>	Descriptions of how the conveyance and storage capacity will be achieved for the development.	Section 5.3
<input type="checkbox"/>	100 year flood levels and major flow routing to protect proposed development from flooding for establishing minimum building elevations (MBE) and overall grading.	N/A
<input type="checkbox"/>	Inclusion of hydraulic analysis including hydraulic grade line elevations.	N/A
<input checked="" type="checkbox"/>	Description of approach to erosion and sediment control during construction for the protection of receiving watercourse or drainage corridors.	N/A
<input type="checkbox"/>	Identification of floodplains – proponent to obtain relevant floodplain information from the appropriate Conservation Authority. The proponent may be required to delineate floodplain elevations to the satisfaction of the Conservation Authority if such information is not available or if information does not match current conditions.	N/A
<input type="checkbox"/>	Identification of fill constraints related to floodplain and geotechnical investigation.	N/A

4.5 Approval and Permit Requirements: Checklist

<input checked="" type="checkbox"/>	Conservation Authority as the designated approval agency for modification of floodplain, potential impact on fish habitat, proposed works in or adjacent to a watercourse, cut/fill permits and Approval under Lakes and Rivers Improvement Act. The Conservation Authority is not the approval authority for the Lakes and Rivers Improvement ct. Where there are Conservation Authority regulations in place, approval under the Lakes and Rivers Improvement Act is not required, except in cases of dams as defined in the Act.	Section 5.1
<input type="checkbox"/>	Application for Certificate of Approval (CofA) under the Ontario Water Resources Act.	N/A
<input type="checkbox"/>	Changes to Municipal Drains.	N/A
<input type="checkbox"/>	Other permits (National Capital Commission, Parks Canada, Public Works and Government Services Canada, Ministry of Transportation etc.)	N/A

4.6 Conclusion Checklist

<input checked="" type="checkbox"/>	Clearly stated conclusions and recommendations	Section 7.0
<input type="checkbox"/>	Comments received from review agencies including the City of Ottawa and information on how the comments were addressed. Final sign-off from the responsible reviewing agency.	
<input type="checkbox"/>	All draft and final reports shall be signed and stamped by a professional Engineer registered in Ontario	

Charlotte Kelly

From: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Sent: June 25, 2020 4:37 PM
To: Charlotte Kelly
Cc: Alison Gosling
Subject: RE: 1919 Maple Grove Road - Boundary Condition Request
Attachments: FW: 1919 Maple Grove Road - Boundary Condition Request

Hi Kelly,

Please see attached email for the boundary conditions.

If you have any questions, please let me know.

Thanks,

Santhosh

From: Charlotte Kelly <CKelly@dsel.ca>
Sent: June 19, 2020 9:01 AM
To: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Cc: Alison Gosling <AGosling@dsel.ca>
Subject: 1919 Maple Grove Road - Boundary Condition Request

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Good Morning Santhosh,

We would like to kindly request updated boundary conditions for the contemplated development at 1919 Maple Grove Road development using the following anticipated development demands:

1. Location of Service / Street Number: 1919 Maple Grove Road
2. Type of development and the amount of fire flow required for the contemplated development:
 - Type of development: The contemplated development includes 62 townhomes/semi-detached units and 450 residential units.
 - Contemplated Connections:
 - Dual Connection to the 305 mm diameter watermain within Maple Grove Road
 - Fire demand based on Technical Bulletin ISTB-2018-02 has been used to estimate a max fire demand of **19,000 L/min**. Refer to the attached for detailed calculations.

Demand	L/min	L/s
Avg. Daily	185.9	3.10
Max Day	464.7	7.75
Peak Hour	1022.4	17.04



Please let us know if you have any questions.

Thank-you,

Charlotte Kelly, E.I.T.
Junior Engineering Designer

DSEL

david schaeffer engineering ltd.

120 Iber Road, Unit 103
Stittsville, ON K2S 1E9

phone: (613) 836-0856 ext.511

email: ckelly@dse.ca

This email, including any attachments, is for the sole use of the intended recipient(s) and may contain private, confidential, and privileged information. Any unauthorized review, use, disclosure, or distribution is prohibited. If you are not the intended recipient, or if this information has been inappropriately forwarded to you, please contact the sender by reply email and destroy all copies of the original.

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

APPENDIX B

Water Supply

Water Demand Design Flows per Unit Count
City of Ottawa - Water Distribution Guidelines, July 2010



Domestic Demand

Type of Housing	Per / Unit	Units	Pop
Single Family	3.4		0
Semi-detached	2.7	18	49
Townhouse	2.7	44	119
Apartment			0
Bachelor	1.4		0
1 Bedroom	1.4	225	315
2 Bedroom	2.1	225	473
3 Bedroom	3.1		0
Average	1.8		0

	Pop	Avg. Daily		Max Day		Peak Hour	
		m ³ /d	L/min	m ³ /d	L/min	m ³ /d	L/min
Total Domestic Demand	956	267.7	185.9	669.2	464.7	1472.2	1022.4

Institutional / Commercial / Industrial Demand

Property Type	Unit Rate	Units	Avg. Daily		Max Day		Peak Hour	
			m ³ /d	L/min	m ³ /d	L/min	m ³ /d	L/min
Commercial floor space	2.5 L/m ² /d		0.00	0.0	0.0	0.0	0.0	0.0
Office	75 L/9.3m ² /d		0.00	0.0	0.0	0.0	0.0	0.0
Industrial - Light	35,000 L/gross ha/d		0.00	0.0	0.0	0.0	0.0	0.0
Industrial - Heavy	55,000 L/gross ha/d		0.00	0.0	0.0	0.0	0.0	0.0
Total I/CI Demand			0.0	0.0	0.0	0.0	0.0	0.0
Total Demand			267.7	185.9	669.2	464.7	1472.2	1022.4

Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999



Fire Flow Required

SOUTH EAST NW APARTMENT BUILDING

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min Where F is the fire flow, C is the Type of construction and A is the Total floor area

Type of Construction:

Ordinary Construction

C 1 Type of Construction Coefficient per FUS Part II, Section 1
A 17052.0 m² Total floor area based on FUS Part II section 1

Fire Flow 28728.3 L/min
29000.0 L/min rounded to the nearest 1,000 L/min

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow 24650.0 L/min

3. Reduction for Sprinkler Protection

Sprinklered - Supervised -50%

Reduction -12325 L/min

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Ordinary - Unprotected Openings	20.1m-30m	31	4	124	10%	
S Ordinary - Unprotected Openings	20.1m-30m	14	3	42	7%	
E Ordinary - Unprotected Openings	20.1m-30m	60	4	240	10%	
W Ordinary - Unprotected Openings	>45m	21	4	84	0%	
	% Increase					27% value not to exceed 75%

Increase 6655.5 L/min

Lw = Length of the Exposed Wall

Ha = number of storeys of the adjacent structure (maximum 5 stories)

LH = Length-height factor of exposed wall. Value rounded up.

EC = Exposure Charge

Total Fire Flow

Fire Flow 18980.5 L/min fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
19000.0 L/min rounded to the nearest 1,000 L/min

Notes:

-Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.

-Calculations based on Fire Underwriters Survey - Part II



Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999

Fire Flow Required

NORTH WEST SW APARTMENT BUILDING

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min Where *F* is the fire flow, *C* is the Type of construction and *A* is the Total floor area

Type of Construction:

Ordinary Construction

C	1	Type of Construction Coefficient per FUS Part II, Section 1
A	9976.0	m ² Total floor area based on FUS Part II section 1

Fire Flow	21973.6 L/min
	22000.0 L/min rounded to the nearest 1,000 L/min

Adjustments

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow	18700.0 L/min
------------------	----------------------

3. Reduction for Sprinkler Protection

Sprinklered - Supervised -50%

Reduction	-9350 L/min
------------------	--------------------

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Ordinary - Unprotected Openings	10.1m-20m		31	4	124	15%
S Ordinary - Unprotected Openings	20.1m-30m		16	3	48	7%
E Ordinary - Unprotected Openings	10.1m-20m	150		3	450	15%
W Ordinary - Unprotected Openings	20.1m-30m	60		4	240	10%
	% Increase					47% value not to exceed 75%

Increase	8789.0 L/min
-----------------	---------------------

Lw = Length of the Exposed Wall
 Ha = number of storeys of the adjacent structure (maximum 5 stories)
 LH = Length-height factor of exposed wall. Value rounded up.
 EC = Exposure Charge

Total Fire Flow

Fire Flow	18139.0 L/min	fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
	18000.0 L/min	rounded to the nearest 1,000 L/min

- Notes:**
 -Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.
 -Calculations based on Fire Underwriters Survey - Part II



Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999

Fire Flow Required

NORTH WEST CENTRAL APARTMENT BUILDING

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min Where *F* is the fire flow, *C* is the Type of construction and *A* is the Total floor area

Type of Construction:

Ordinary Construction

C	1	Type of Construction Coefficient per FUS Part II, Section 1
A	5760.0	m ² Total floor area based on FUS Part II section 1

Fire Flow	16696.8 L/min
	17000.0 L/min rounded to the nearest 1,000 L/min

Adjustments

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow	14450.0 L/min
------------------	----------------------

3. Reduction for Sprinkler Protection

Sprinklered - Supervised -50%

Reduction	-7225 L/min
------------------	--------------------

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Ordinary - Unprotected Openings	>45m		0	0	0	0%
S Ordinary - Unprotected Openings	20.1m-30m		31	4	124	10%
E Ordinary - Unprotected Openings	10.1m-20m		90	3	270	15%
W Ordinary - Unprotected Openings	20.1m-30m		60	4	240	10%
	% Increase					35% value not to exceed 75%

Increase	5057.5 L/min
-----------------	---------------------

Lw = Length of the Exposed Wall
Ha = number of storeys of the adjacent structure (maximum 5 stories)
LH = Length-height factor of exposed wall. Value rounded up.
EC = Exposure Charge

Total Fire Flow

Fire Flow	12282.5 L/min	fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
	12000.0 L/min	rounded to the nearest 1,000 L/min

Notes:
-Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.
-Calculations based on Fire Underwriters Survey - Part II



Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999

Fire Flow Required

SOUTH WEST CENTRAL APARTMENT BUILDING

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min Where *F* is the fire flow, *C* is the Type of construction and *A* is the Total floor area

Type of Construction:

Ordinary Construction

C	1	Type of Construction Coefficient per FUS Part II, Section 1
A	4168.0	m ² Total floor area based on FUS Part II section 1

Fire Flow	14203.2 L/min
	14000.0 L/min rounded to the nearest 1,000 L/min

Adjustments

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow	11900.0 L/min
------------------	----------------------

3. Reduction for Sprinkler Protection

Sprinklered - Supervised -50%

Reduction	-5950 L/min
------------------	--------------------

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Ordinary - Unprotected Openings	>45m		0	0	0	0%
S Ordinary - Unprotected Openings	20.1m-30m		31	4	124	10%
E Ordinary - Unprotected Openings	10.1m-20m		90	3	270	15%
W Ordinary - Unprotected Openings	20.1m-30m		60	4	240	10%
	% Increase					35% value not to exceed 75%

Increase	4165.0 L/min
-----------------	---------------------

Lw = Length of the Exposed Wall
Ha = number of storeys of the adjacent structure (maximum 5 stories)
LH = Length-height factor of exposed wall. Value rounded up.
EC = Exposure Charge

Total Fire Flow

Fire Flow	10115.0 L/min	fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
	10000.0 L/min	rounded to the nearest 1,000 L/min

- Notes:**
 -Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.
 -Calculations based on Fire Underwriters Survey - Part II



Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999

Fire Flow Required

NORTH EAST CENTRAL APARTMENT BUILDING

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min Where *F* is the fire flow, *C* is the Type of construction and *A* is the Total floor area

Type of Construction:

Ordinary Construction

C	1	Type of Construction Coefficient per FUS Part II, Section 1
A	4168.0	m ² Total floor area based on FUS Part II section 1

Fire Flow	14203.2 L/min
	14000.0 L/min rounded to the nearest 1,000 L/min

Adjustments

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow	11900.0 L/min
------------------	----------------------

3. Reduction for Sprinkler Protection

Sprinklered - Supervised -50%

Reduction	-5950 L/min
------------------	--------------------

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Ordinary - Unprotected Openings	>45m		0	0	0	0%
S Ordinary - Unprotected Openings	20.1m-30m		31	4	124	10%
E Ordinary - Unprotected Openings	10.1m-20m		90	3	270	15%
W Ordinary - Unprotected Openings	20.1m-30m		60	4	240	10%
	% Increase					35% value not to exceed 75%

Increase	4165.0 L/min
-----------------	---------------------

Lw = Length of the Exposed Wall
 Ha = number of storeys of the adjacent structure (maximum 5 stories)
 LH = Length-height factor of exposed wall. Value rounded up.
 EC = Exposure Charge

Total Fire Flow

Fire Flow	10115.0 L/min	fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
	10000.0 L/min	rounded to the nearest 1,000 L/min

- Notes:**
 -Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.
 -Calculations based on Fire Underwriters Survey - Part II

Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999



Fire Flow Required

SOUTH EAST CENTRAL APARTMENT BUILDING

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min Where F is the fire flow, C is the Type of construction and A is the Total floor area

Type of Construction:

Ordinary Construction

C 1 Type of Construction Coefficient per FUS Part II, Section 1
A 5760.0 m² Total floor area based on FUS Part II section 1

Fire Flow 16696.8 L/min
17000.0 L/min rounded to the nearest 1,000 L/min

Adjustments

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow 14450.0 L/min

3. Reduction for Sprinkler Protection

Sprinklered - Supervised -50%

Reduction -7225 L/min

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Ordinary - Unprotected Openings	>45m		0	0	0	0%
S Ordinary - Unprotected Openings	20.1m-30m		31	4	124	10%
E Ordinary - Unprotected Openings	10.1m-20m		90	3	270	15%
W Ordinary - Unprotected Openings	20.1m-30m		60	4	240	10%
	% Increase					35% value not to exceed 75%

Increase 5057.5 L/min

Lw = Length of the Exposed Wall

Ha = number of storeys of the adjacent structure (maximum 5 stories)

LH = Length-height factor of exposed wall. Value rounded up.

EC = Exposure Charge

Total Fire Flow

Fire Flow 12282.5 L/min fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
12000.0 L/min rounded to the nearest 1,000 L/min

Notes:

-Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.

-Calculations based on Fire Underwriters Survey - Part II

Boundary Conditions Unit Conversion

Connection1:

	Height (m)	Elevation (m)	m H ₂ O	PSI	kPa
Avg. DD	160.9	107.9	53.0	75.4	519.9
Fire Flow	147.2	107.9	39.3	55.9	385.5
Peak Hour	156.6	107.9	48.7	69.3	477.7

Connection 2:

	Height (m)	Elevation (m)	m H ₂ O	PSI	kPa
Avg. DD	160.9	108	52.9	75.3	518.9
Fire Flow	147.1	108	39.1	55.6	383.6
Peak Hour	156.6	108	48.6	69.1	476.8


Charlotte Kelly

From: Bougadis, John <John.Bougadis@ottawa.ca>
Sent: June 25, 2020 4:14 PM
To: Kuruvilla, Santhosh
Cc: Simard, Lyndsey
Subject: FW: 1919 Maple Grove Road - Boundary Condition Request
Attachments: 1919 Maple Grove Road_Boundary Conditions_24 June2020.docx

Hi Santhosh,

See attached. Comments:

- The City expects a future third connection from Phase 2 of 195 Huntmar (see below).
- The FUS calc is based on an apartment unit. The email from DSEL below states townhomes and semi-detached units (see highlighted text in email below).
- An isolation valve between connection 1 and 2 is required.

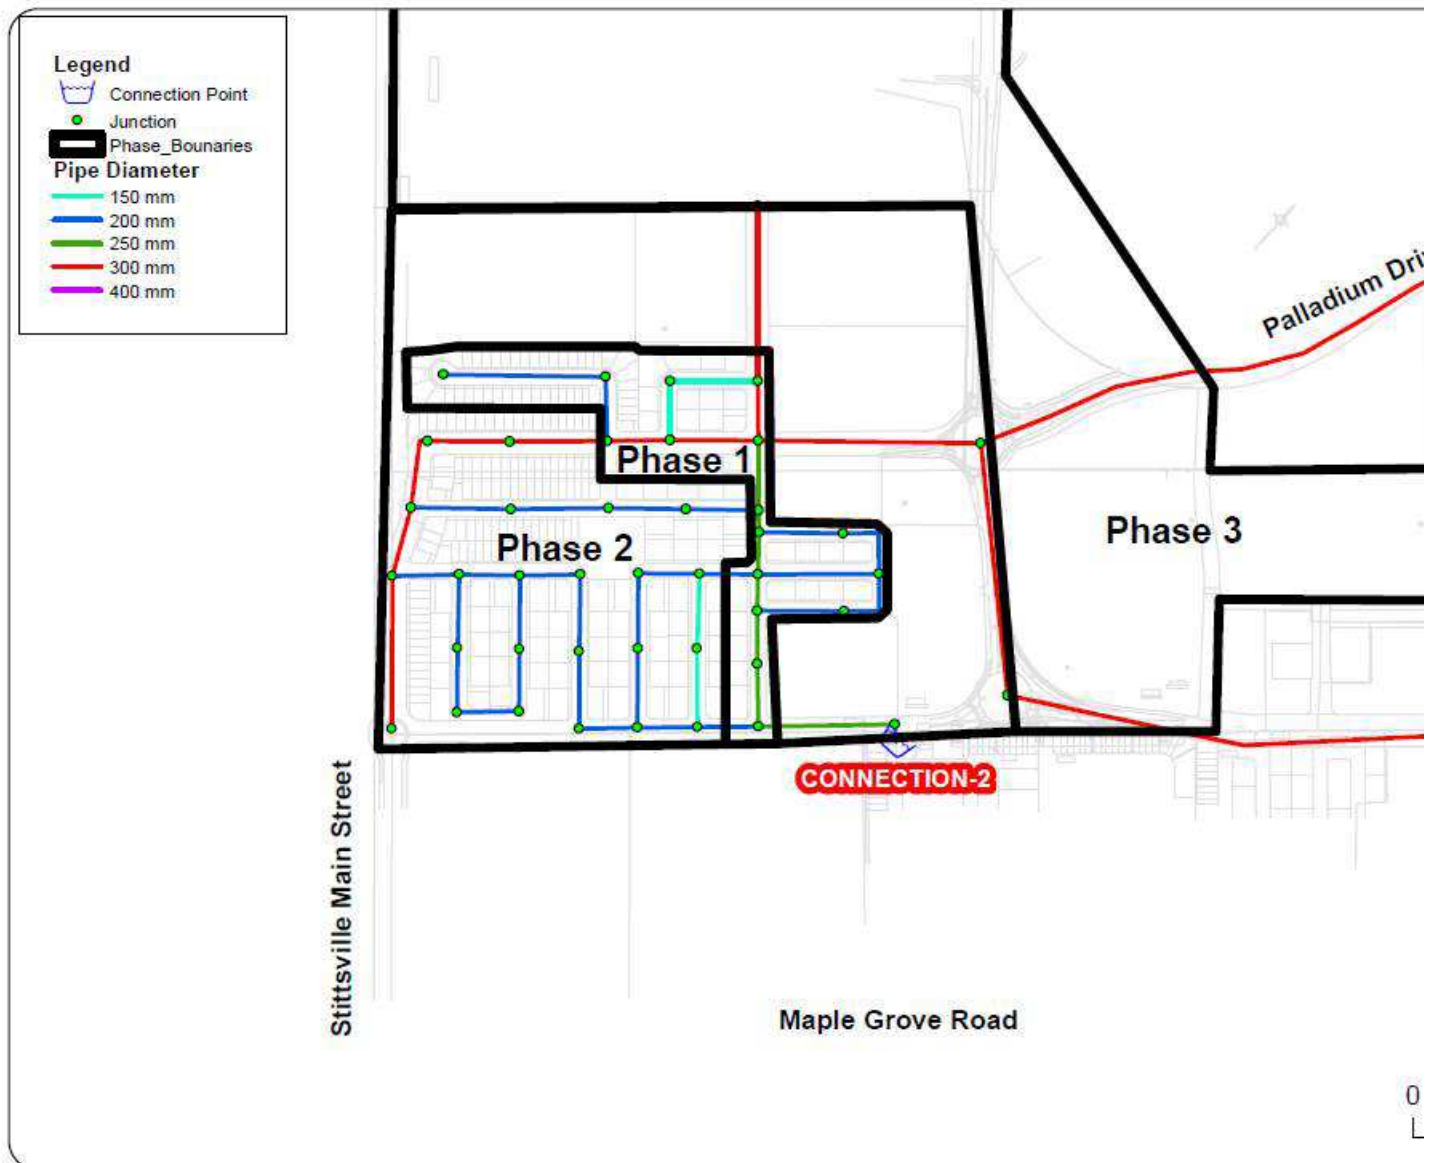

John
x14990

From: Simard, Lyndsey <lyndsey.simard@ottawa.ca>
Sent: June 24, 2020 12:25
To: Bougadis, John <John.Bougadis@ottawa.ca>
Subject: RE: 1919 Maple Grove Road - Boundary Condition Request

Hi John,

Please find the attached boundary conditions.

Cheers,

Lyndsey

From: Bougadis, John <John.Bougadis@ottawa.ca>
Sent: June 19, 2020 10:12
To: Simard, Lyndsey <lyndsey.simard@ottawa.ca>
Subject: FW: 1919 Maple Grove Road - Boundary Condition Request

John
x14990

From: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Sent: June 19, 2020 10:03
To: Bougadis, John <John.Bougadis@ottawa.ca>
Subject: FW: 1919 Maple Grove Road - Boundary Condition Request

Good morning John,

Please provide the boundary conditions for the subject application.

Thanks,

Santhosh

From: Charlotte Kelly <CKelly@dsel.ca>
Sent: June 19, 2020 9:01 AM
To: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Cc: Alison Gosling <AGosling@dsel.ca>
Subject: 1919 Maple Grove Road - Boundary Condition Request

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Good Morning Santhosh,

We would like to kindly request updated boundary conditions for the contemplated development at 1919 Maple Grove Road development using the following anticipated development demands:

1. Location of Service / Street Number: 1919 Maple Grove Road
2. Type of development and the amount of fire flow required for the contemplated development:
 - Type of development: The contemplated development includes 62 townhomes/semi-detached units and 450 residential units.
 - Contemplated Connections:
 - Dual Connection to the 305 mm diameter watermain within Maple Grove Road
 - Fire demand based on Technical Bulletin ISTB-2018-02 has been used to estimate a max fire demand of **19,000 L/min**. Refer to the attached for detailed calculations.

Demand	L/min	L/s
Avg. Daily	185.9	3.10
Max Day	464.7	7.75
Peak Hour	1022.4	17.04



Please let us know if you have any questions.

Thank-you,

Charlotte Kelly, E.I.T.
Junior Engineering Designer

DSEL

david schaeffer engineering ltd.

120 Iber Road, Unit 103
Stittsville, ON K2S 1E9

phone: (613) 836-0856 ext.511

email: ckelly@dse.ca

This email, including any attachments, is for the sole use of the intended recipient(s) and may contain private, confidential, and privileged information. Any unauthorized review, use, disclosure, or distribution is prohibited. If you are not the intended recipient, or if this information has been inappropriately forwarded to you, please contact the sender by reply email and destroy all copies of the original.

Boundary Conditions 1919 Maple Grove Road

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	186	3.10
Maximum Daily Demand	465	7.75
Peak Hour	1,022	17.04
Fire Flow Demand #1	19,020	317.00

Location



Results

Connection 1 – Maple Grove Rd.

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	160.9	75.4
Peak Hour	156.6	69.2
Max Day plus Fire 1	147.2	55.8

¹ Ground Elevation = 107.9 m

Connection 2 – Maple Grove Rd.

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	160.9	75.2
Peak Hour	156.6	69.0
Max Day plus Fire 1	147.1	55.5

¹ Ground Elevation = 108.0 m

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

Watermain Final Concept
Kanata West Master Servicing Study



Stantec Consulting Ltd.
 1505 Laperriere Avenue
 Ottawa, ON Canada
 K1Z 7T1
 Tel. 613.722.4420
 Fax. 613.722.2799
 www.stantec.com

Stantec

Copyright Reserved

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec Consulting Ltd. without delay.
 The Copyrights to all designs and drawings are the property of Stantec Consulting Ltd. Reproduction or use for other than that authorized by Stantec Consulting Ltd. is forbidden.

Legend

- KANATA-WEST CONCEPT PLAN BOUNDARY
- EXISTING WATERMAIN
- - - EXISTING 610mm WATERMAIN TO BE UPGRADED TO 914mm
- - - EXISTING 610mm WATERMAIN TO BE UPGRADED TO 762mm
- PROPOSED 610mm DIA. WATERMAIN
- PROPOSED 406mm DIA. WATERMAIN
- PROPOSED 305mm DIA. WATERMAIN
- PROPOSED 203mm DIA. WATERMAIN

Notes

INTERNAL WATERMAIN SIZE ARE EXPECTED TO VARY FROM 152mm TO 305mm.



5	REVISED FOR DEC.21/05 SUBMISSION	GBU	SJP	DEC.21/05
4	REVISED AS PER CITY COMMENTS (Sept.16/05)	GBU	MAF	OCT.28/05
3	REVISED WATER DISTRIBUTION NETWORK	GBU	S.J.P.	AUG.09/05
2	REVISED POND 1 AREA	BE	MAF	JUNE.09/05
1	REVISED LOTTING FOR TARIAN AND MATTAMY	ECB	SJP	JAN.18/05
Revision		By	Appd.	Date

File Name:	Des.	Chk'd.	Dgn.	Date
------------	------	--------	------	------

Seals

Client/Project

Kanata West Concept Plan
 Master Servicing Study

Ottawa, Ontario

Title

Watermain
 Final Concept


Project No.	Scale	0	75	225	375m
80400406	1:7500				
Drawing No.	Sheet	Revision			

WM-1 2 of 7 5



M:\Projects\80400406\80400406.dwg (Sheet) 1:7500 05/11/05 10:00 AM
 2005-11-10 10:00 AM

CITY OF OTTAWA - WATER DISTRIBUTION SYSTEM

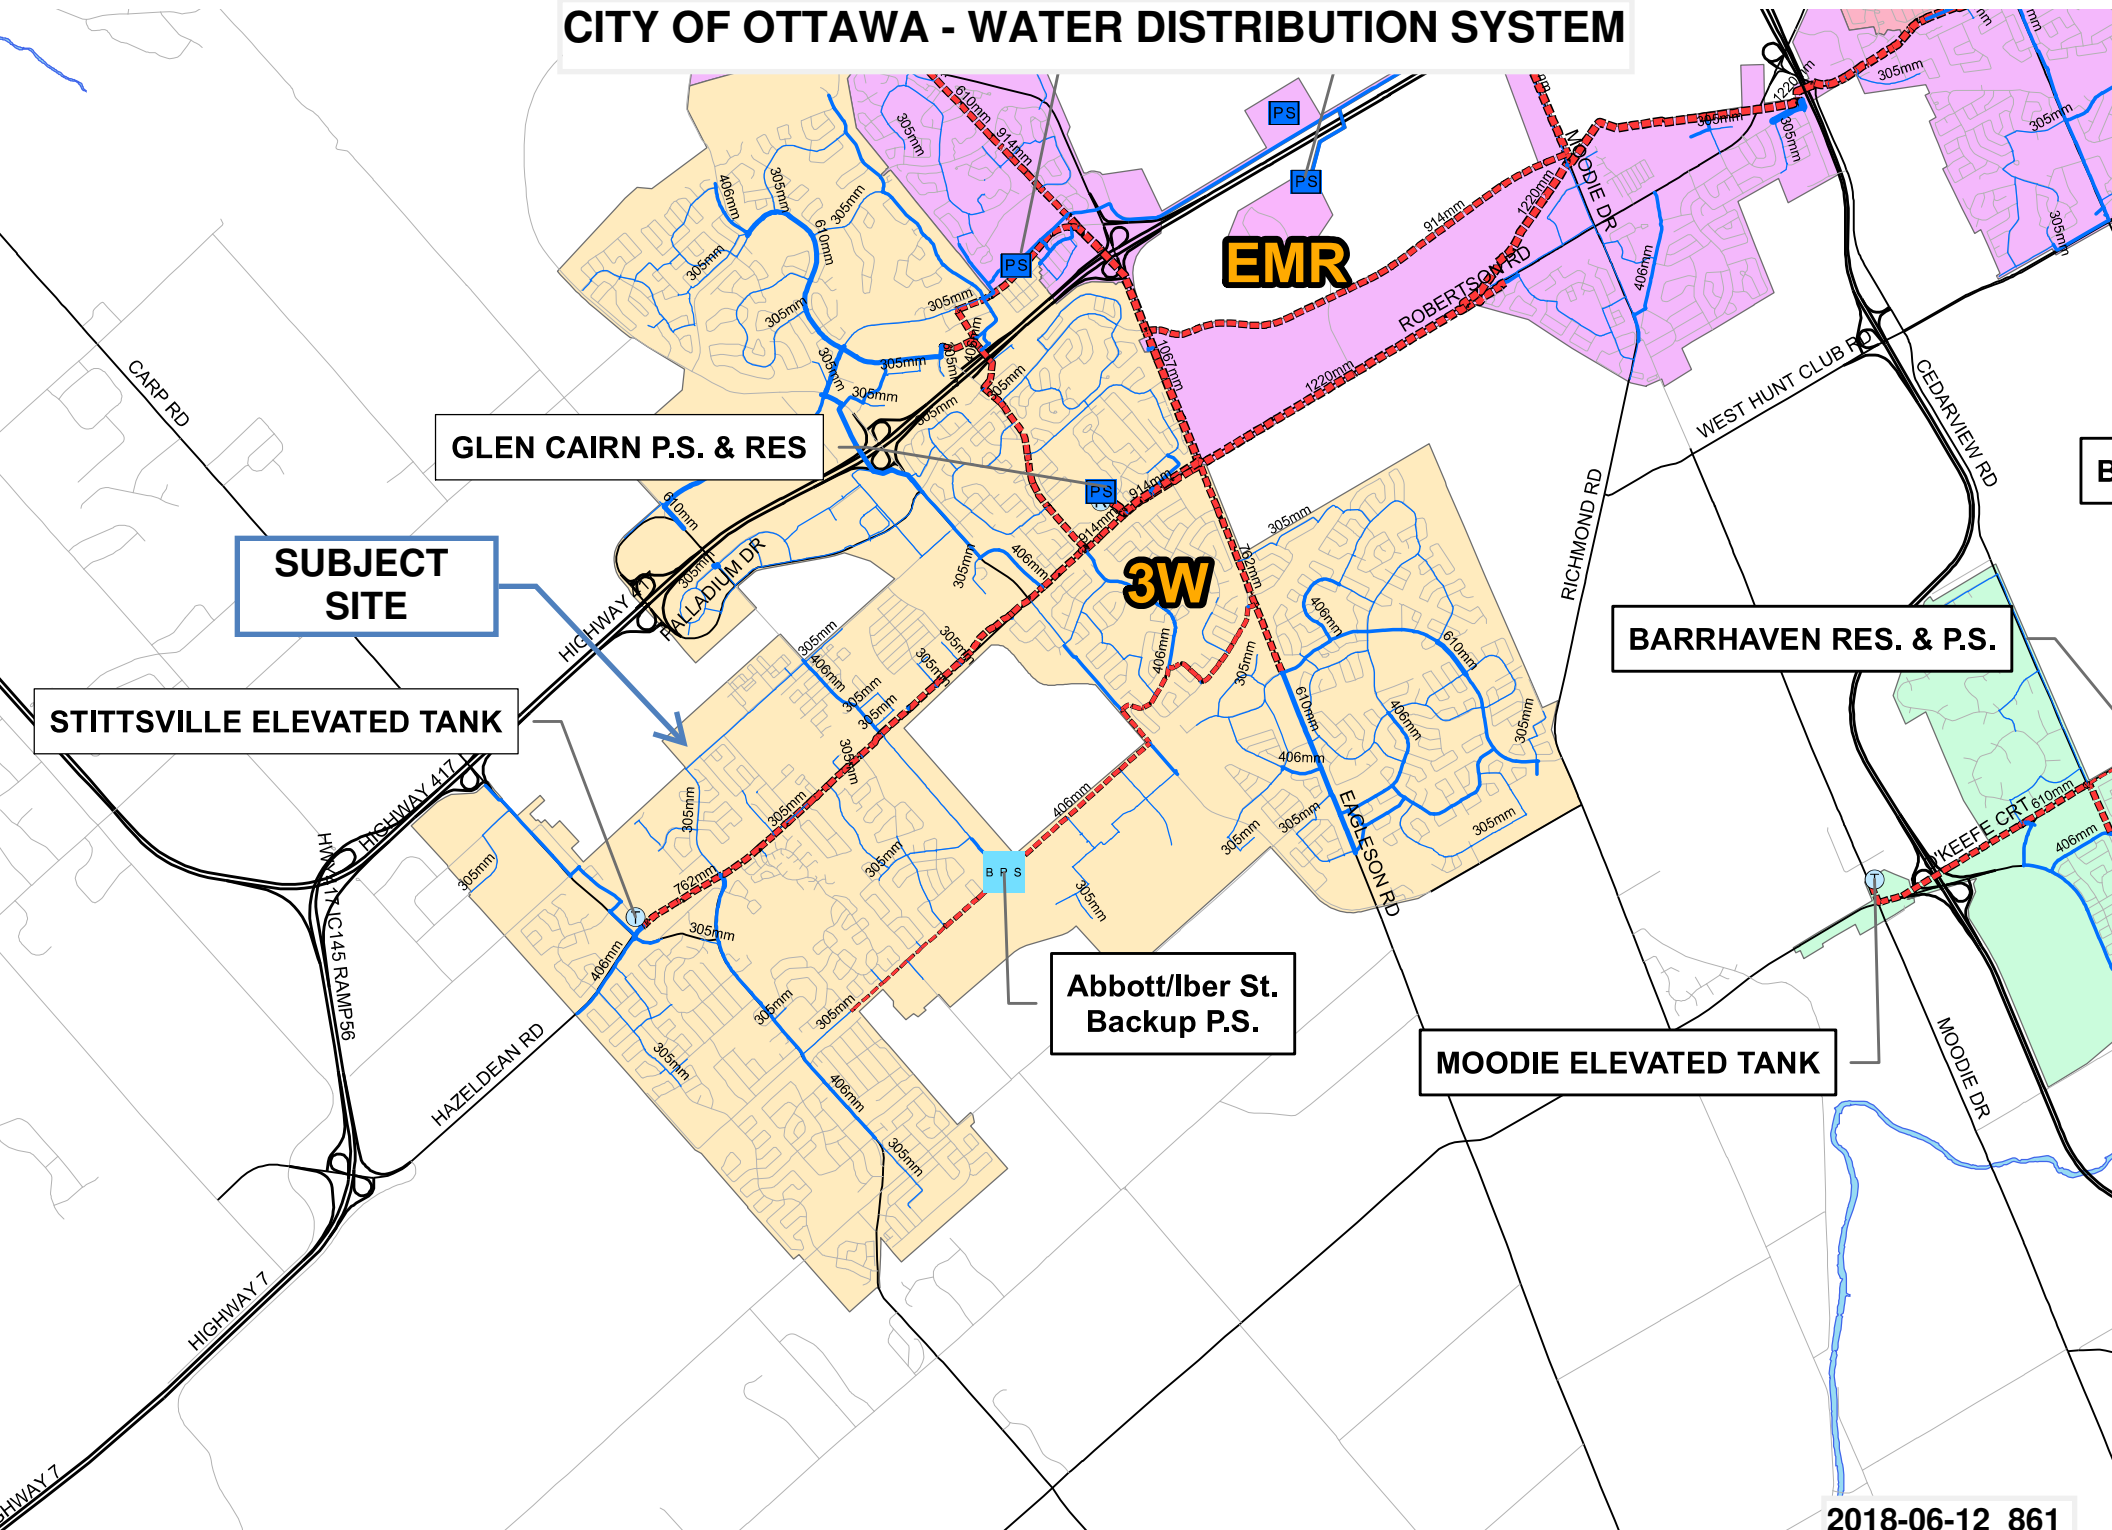

APPENDIX C

Wastewater Collection

Wastewater Design Flows per Unit Count
City of Ottawa Sewer Design Guidelines, 2004



Site Area 6.730 ha

Extraneous Flow Allowances

Infiltration / Inflow (Dry)	0.34 L/s
Infiltration / Inflow (Wet)	1.88 L/s
Infiltration / Inflow (Total)	2.22 L/s

Domestic Contributions

Unit Type	Unit Rate	Units	Pop
Single Family	3.4	1	4
Semi-detached and duplex	2.7		0
Townhouse	2.7		0
Stacked Townhouse	2.3		0
Apartment			
Bachelor	1.4		0
1 Bedroom	1.4		0
2 Bedroom	2.1		0
3 Bedroom	3.1		0
Average	1.8		0

Total Pop 4

Average Domestic Flow 0.01 L/s

Peaking Factor 3.76

Peak Domestic Flow 0.05 L/s

Institutional / Commercial / Industrial Contributions

Property Type	Unit Rate	No. of Units	Avg Wastewater (L/s)
Commercial floor space*	5 L/m ² /d		0.00
Hospitals	900 L/bed/d		0.00
School	70 L/student/d		0.00
Industrial - Light**	35,000 L/gross ha/d		0.00
Industrial - Heavy**	55,000 L/gross ha/d		0.00

Average I/C/I Flow 0.00

Peak Institutional / Commercial Flow 0.00

Peak Industrial Flow** 0.00

Peak I/C/I Flow 0.00

* assuming a 12 hour commercial operation

** peak industrial flow per City of Ottawa Sewer Design Guidelines Appendix 4B

Total Estimated Average Dry Weather Flow Rate	0.35 L/s
Total Estimated Peak Dry Weather Flow Rate	0.39 L/s
Total Estimated Peak Wet Weather Flow Rate	2.27 L/s

Wastewater Design Flows per Unit Count
City of Ottawa Sewer Design Guidelines, 2004



Site Area 6.730 ha

Extraneous Flow Allowances

Infiltration / Inflow (Dry)	0.34 L/s
Infiltration / Inflow (Wet)	1.88 L/s
Infiltration / Inflow (Total)	2.22 L/s

Domestic Contributions

Unit Type	Unit Rate	Units	Pop
Single Family	3.4		0
Semi-detached and duplex	2.7	18	49
Townhouse	2.7	44	119
Stacked Townhouse	2.3		0
Apartment			
Bachelor	1.4		0
1 Bedroom	1.4	225	315
2 Bedroom	2.1	225	473
3 Bedroom	3.1		0
Average	1.8		0

Total Pop 956

Average Domestic Flow 3.10 L/s

Peaking Factor 3.25

Peak Domestic Flow 10.07 L/s

Institutional / Commercial / Industrial Contributions

Property Type	Unit Rate	No. of Units	Avg Wastewater (L/s)
Commercial floor space*	5 L/m ² /d		0.00
Hospitals	900 L/bed/d		0.00
School	70 L/student/d		0.00
Industrial - Light**	35,000 L/gross ha/d		0.00
Industrial - Heavy**	55,000 L/gross ha/d		0.00

Average I/C/I Flow 0.00

Peak Institutional / Commercial Flow 0.00

Peak Industrial Flow** 0.00

Peak I/C/I Flow 0.00

* assuming a 12 hour commercial operation

** peak industrial flow per City of Ottawa Sewer Design Guidelines Appendix 4B

Total Estimated Average Dry Weather Flow Rate	3.43 L/s
Total Estimated Peak Dry Weather Flow Rate	10.41 L/s
Total Estimated Peak Wet Weather Flow Rate	12.29 L/s

SANITARY SEWER CALCULATION SHEET

CLIENT: **Formasian Development Corp.**
 LOCATION: **1919 Maple Grove Road**
 FILE REF: **16-861**
 DATE: **11-Aug-20**

DESIGN PARAMETERS

Avg. Daily Flow Res.	280 L/p/d	Peak Fact. Res. Per Harmons: Min = 2.0, Max =4.0	Infiltration / Inflow	0.33 L/s/ha	
Avg. Daily Flow Comm	28,000 L/ha/d	Peak Fact. Comm.	1.5	Min. Pipe Velocity	0.60 m/s full flowing
Avg. Daily Flow Instit.	28,000 L/ha/d	Peak Fact. Instit.	1.5	Max. Pipe Velocity	3.00 m/s full flowing
Avg. Daily Flow Indust.	35,000 L/ha/d	Peak Fact. Indust. per MOE graph		Mannings N	0.013



Area ID	Location		Residential Area and Population									Commercial		Institutional		Industrial		Infiltration				Pipe Data									
	Up	Down	Area	Number of Units				Pop.	Cumulative		Peak	Q _{res}	Area	Accu.	Area	Accu.	Area	Accu.	Q _{CHH}	Total	Accu.	Infiltration	Total	DIA	Slope	Length	A _{hydraulic}	R	Velocity	Q _{cap}	Q / Q full
			(ha)	Singles	Semi's	Town's	Apt's	Area	Pop.	Fact.	(-)	(L/s)	(ha)	(ha)	(ha)	(ha)	(ha)	(ha)	(L/s)	(ha)	(ha)	(L/s)	(L/s)	(mm)	(%)	(m)	(m ²)	(m)	(m/s)	(L/s)	(-)
Hazeldean/Huntmar Trunk Sewer	11	12	113.140	1881				6395.0	113.140	6395.0	3.14	65.16	33.50	33.50		0.00	3.44	3.44	31.9	164.210	164.210	45.979	143.01	675	0.40	775.0	0.358	0.169	1.55	554.8	0.26
Maple Grove Road Trunk Sewer	12	10	33.730	939				3193.0	146.870	9588.0	2.97	92.37	10.89	44.39		0.00	17.61	21.05	55.6	62.230	226.440	63.403	211.36	750	0.20	950.0	0.442	0.188	1.13	497.9	0.42
Maple Grove Road Trunk Sewer	10	10A	36.130	899				3057.0	183.000	12645.0	2.85	116.91		44.39		0.00	12.15	33.20	65.4	48.280	274.720	76.922	259.26	825	0.20	1000.0	0.535	0.206	1.20	641.9	0.40
Carp River Trunk Sewer	13	10A	38.720	1162				3951.0	38.720	3951.0	3.34	42.74		44.39		0.00	20.24	53.44	81.8	58.960	58.960	16.509	141.08	600	0.25	1000.0	0.283	0.150	1.09	307.0	0.46
		10A						0.0	0.000	0.0	4.00	0.00	0.75	0.75		0.00		0.00	0.7	0.750	0.750	0.210	0.86	250	0.35	100.0	0.049	0.063	0.72	35.2	0.02
	10A	KWPS						0.0	0.000	0.0	4.00	0.00		0.00		0.00		0.00	0.0		334.430	93.640	755.57	1050	0.20	30.0	0.866	0.263	1.47	1273.7	0.59

SANITARY SEWER CALCULATION SHEET

CLIENT: **Formasian Development Corp.**
 LOCATION: **1919 Maple Grove Road**
 FILE REF: **16-861**
 DATE: **12-Jun-18**

DESIGN PARAMETERS



Avg. Daily Flow Res.	350 L/p/d	Peak Fact Res. Per Harmon: Min = 2.0, Max =4.0	Infiltration / Inflow	0.28 L/s/ha	
Avg. Daily Flow Comm	50,000 L/ha/d	Peak Fact. Comm.	1.5	Min. Pipe Velocity	0.60 m/s full flowing
Avg. Daily Flow Instit.	50,000 L/ha/d	Peak Fact. Instit.	1.5	Max. Pipe Velocity	3.00 m/s full flowing
Avg. Daily Flow Indust.	35,000 L/ha/d	Peak Fact. Indust. per MOE graph		Mannings N	0.013



Location			Residential Area and Population										Commercial				Institutional		Industrial		Infiltration				Pipe Data						
Area ID	Up	Down	Area	Number of Units by type				Pop.	Cumulative	Peak.	Q _{res}	Area	Accu.	Area	Accu.	Area	Accu.	Q _{C+I}	Total	Accu.	Infiltration	Total	DIA	Slope	Length	A _{hydraulic}	R	Velocity	Q _{cap}	Q / Q full	Q _{res}
			(ha)	Singles	Semi's	Town's	Apt's		(ha)	Pop.	Fact.	(-)	(L/s)	(ha)	(ha)	(ha)	(ha)	(L/s)	(ha)	(ha)	(L/s)	(L/s)	(mm)	(%)	(m)	(m ²)	(m)	(m/s)	(L/s)	(-)	(L/s)
Maple Grove																															
Road Trunk Sewer	9	10	102.660	2823				9598.0	102.660	9598.0	2.97	115.57		0.00		0.00	0.0	102.660	102.660	28.745	144.31	600	0.40	775.0	0.283	0.150	1.37	388.3	0.37	244.0	
	10	10A	220.460	4881				16595.0	323.120	26193.0	2.54	269.03	45.14	45.14		0.00	53.44	82.5	333.170	435.830	122.032	473.54	825	0.20	1000.0	0.535	0.206	1.20	641.9	0.74	168.4
	10A	KWPS						0.0	323.120	26193.0	2.54	269.03	45.14		0.00	53.44	82.5	0.000	435.830	122.032	473.54	1050	0.20	30.0	0.866	0.263	1.41	1221.2	0.39	747.7	

Preferred Waste-Water Master Servicing Study

Kanata West Master Servicing Study

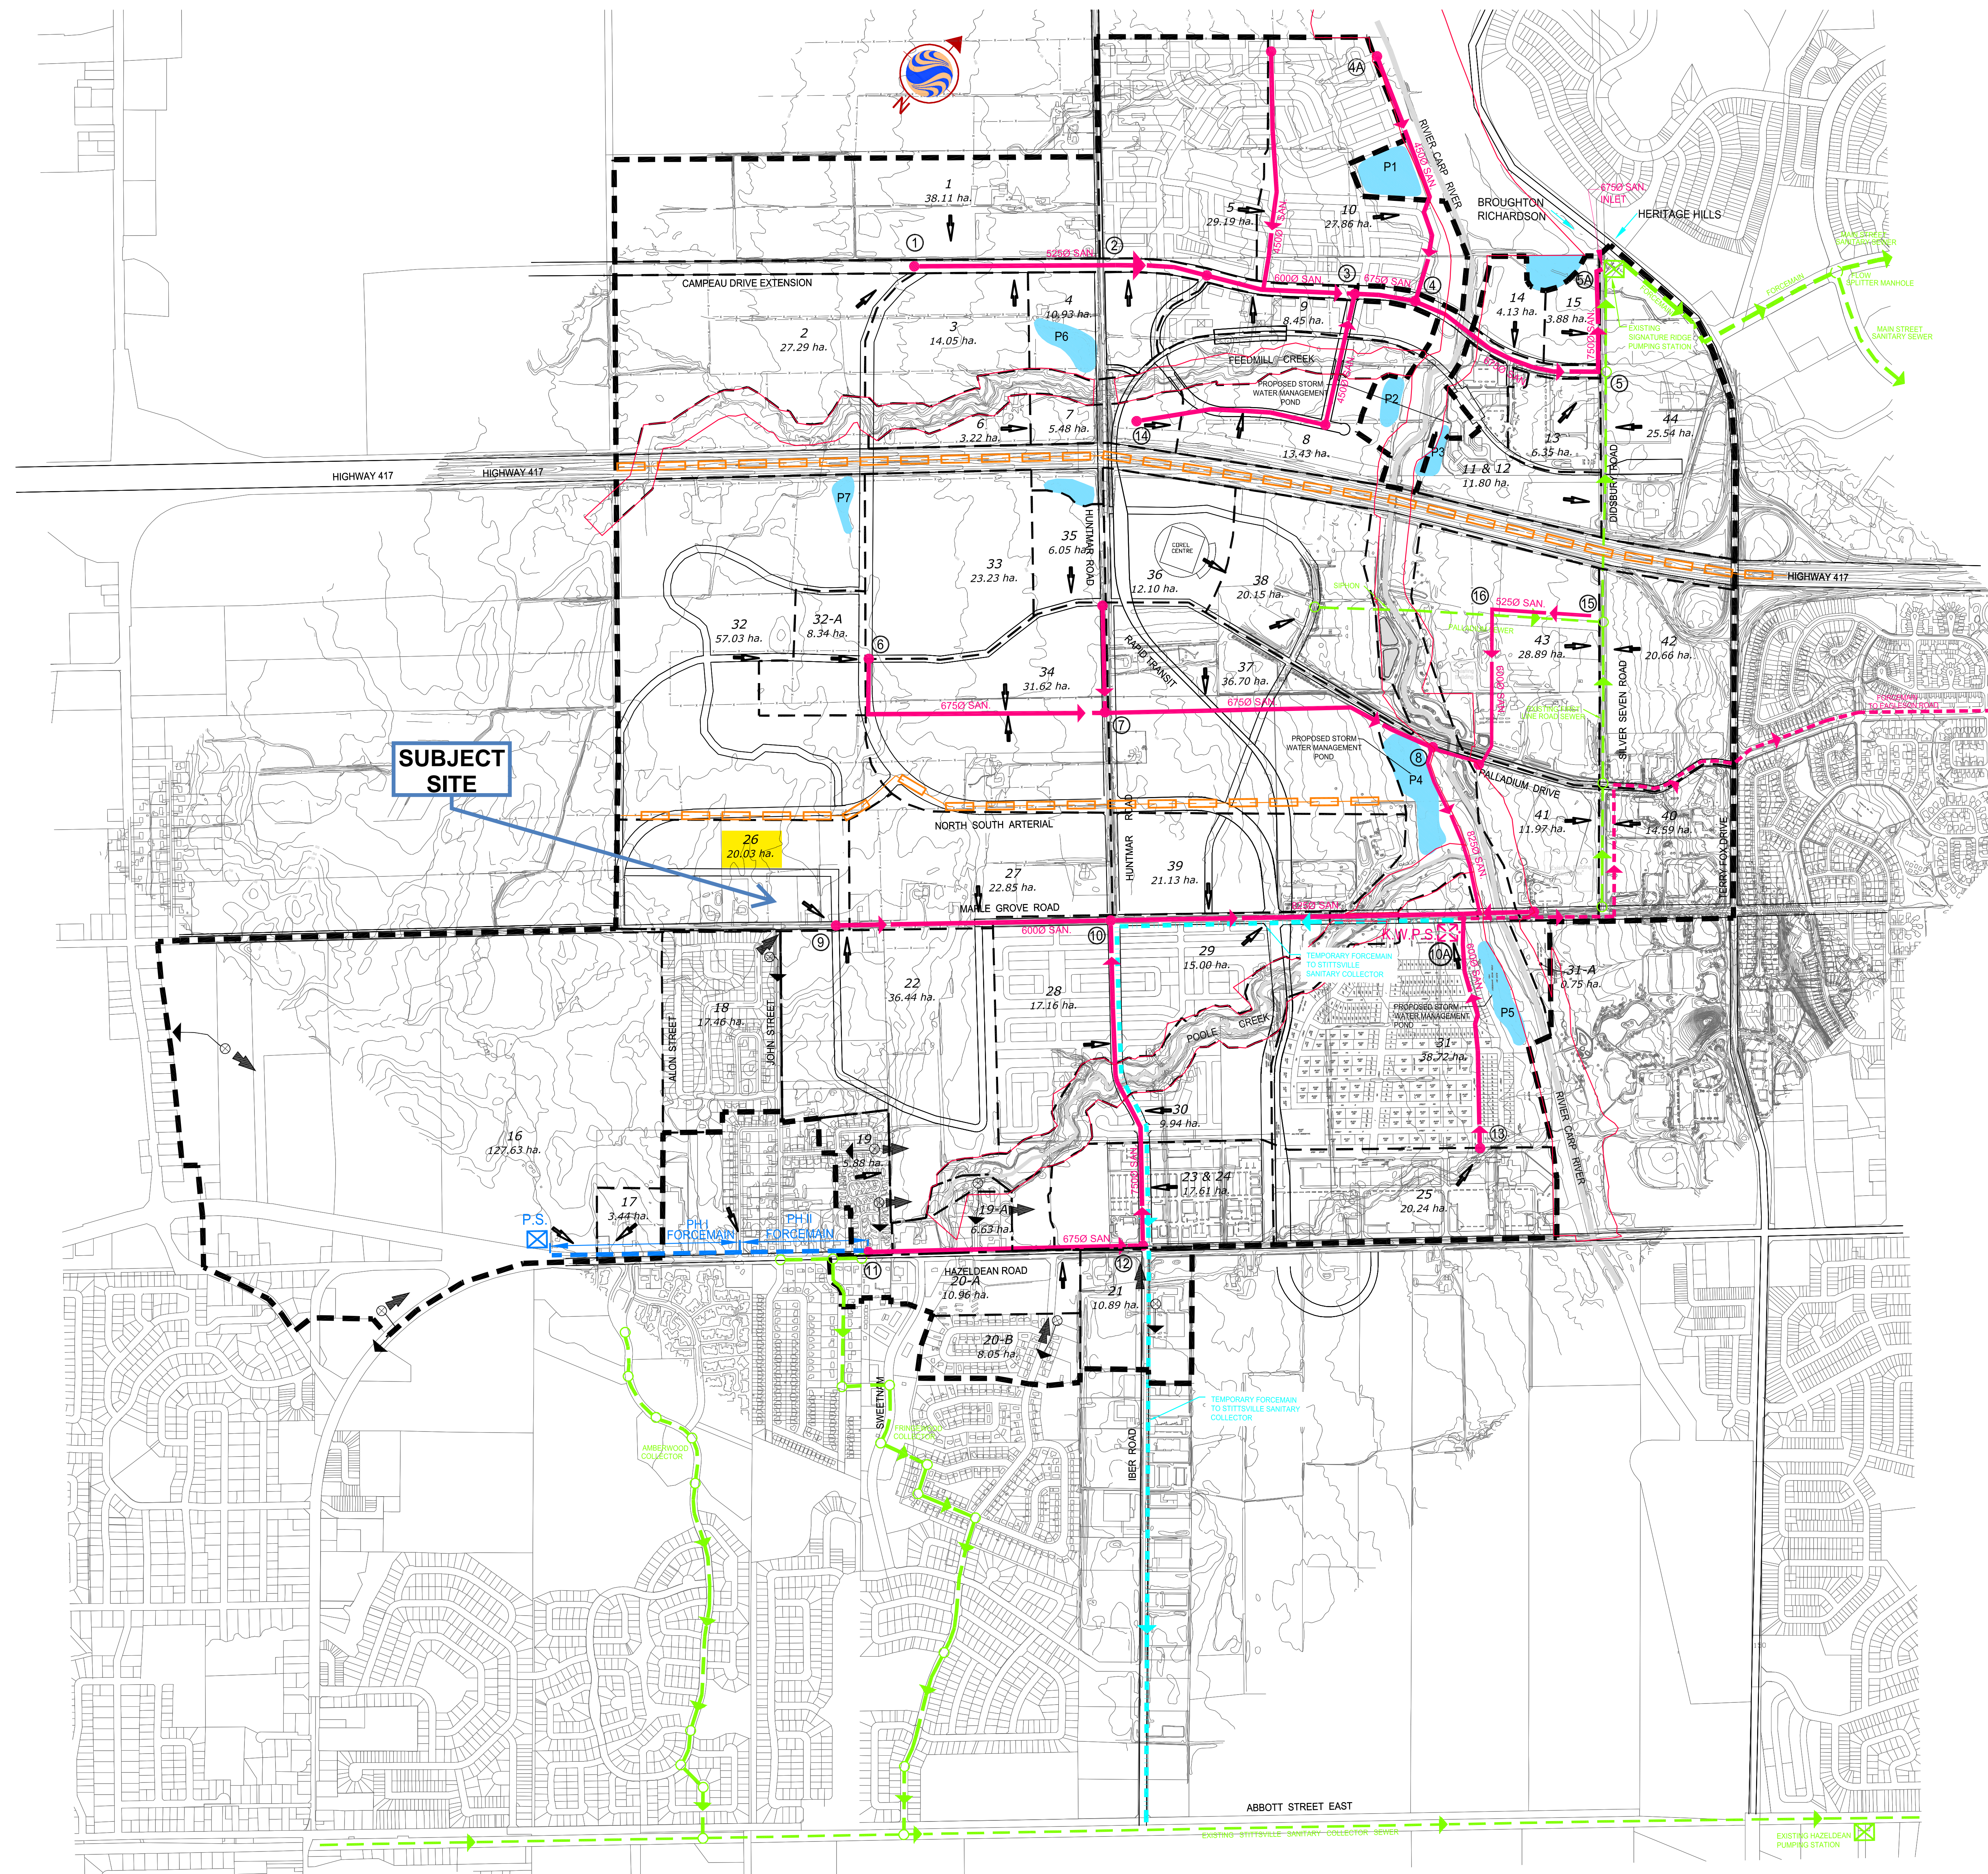

Stantec Consulting Ltd.
1505 Laperriere Avenue
Ottawa ON Canada
K1Z 7T1
Tel. 613.722.4420
Fax. 613.722.2799
www.stantec.com

Stantec

Copyright Reserved
The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec Consulting Ltd. without delay.
The Copyrights to all designs and drawings are the property of Stantec Consulting Ltd. Reproduction or use for other than that authorized by Stantec Consulting Ltd. is forbidden.



1770 WOODWARD DR., OTTAWA (613)225-1511

Legend

- ULTIMATE MAJOR DRAINAGE LIMIT
- SUBCATCHMENT AREAS
- PROPOSED TRUNK SEWER
- PROPOSED FORCEMAIN
- TEMPORARY FORCEMAIN
- PROPOSED STITTSVILLE PUMPING STATION AND FORCEMAIN
- EXISTING TRUNK SEWER
- MAJOR DRAINAGE SPLIT
- NODES
- EXISTING PUMPING STATION AND FORCEMAIN (TO BE DECOMMISSIONED)
- INPUT POINT AND AREA IN HECTARES
- EXISTING PUMPING STATION GRAVITY OUTLET

5	REVISED FOR DEC 21/05 SUBMISSION	G.B.U.	S.J.P.	05/12/21
4	REVISED TRUNK SEWER FROM 16 TO KWPS	R.W.W.	R.W.W.	05/10/05
3	ARROWS FOR EXIST. PUMP STATIONS ADDED	R.W.W.	R.W.W.	05/08/09
2	REPORT JUNE 2005	R.W.W.	R.W.W.	05/06/07
1	REPORT APR. 2005	R.W.W.	R.W.W.	05/04/20
Revision		By	Appd.	Date

File Name: _____ Dwn. Chkd. Degrn. Date

Seats

Client/Project

Kanata West Concept Plan
Master Servicing Study

Ottawa, Ontario

Title

Preferred Waste-Water
Option

Project No. 60400406 Scale 1:7500 Sheet 7 of 7

Drawing No. _____ Sheet _____ Revision _____

S-I


7 of 7

5

A:\04-024\Kanata West\040406\Map\040406\040406-04-21\Map_Kanata West_Dwg_5-1-04-06.dwg
 Last Saved By: s.j.p. Date: Sep 27, 2006 - 8:17am

KWMSS Drainage Allocations

Stantec Consulting Ltd.

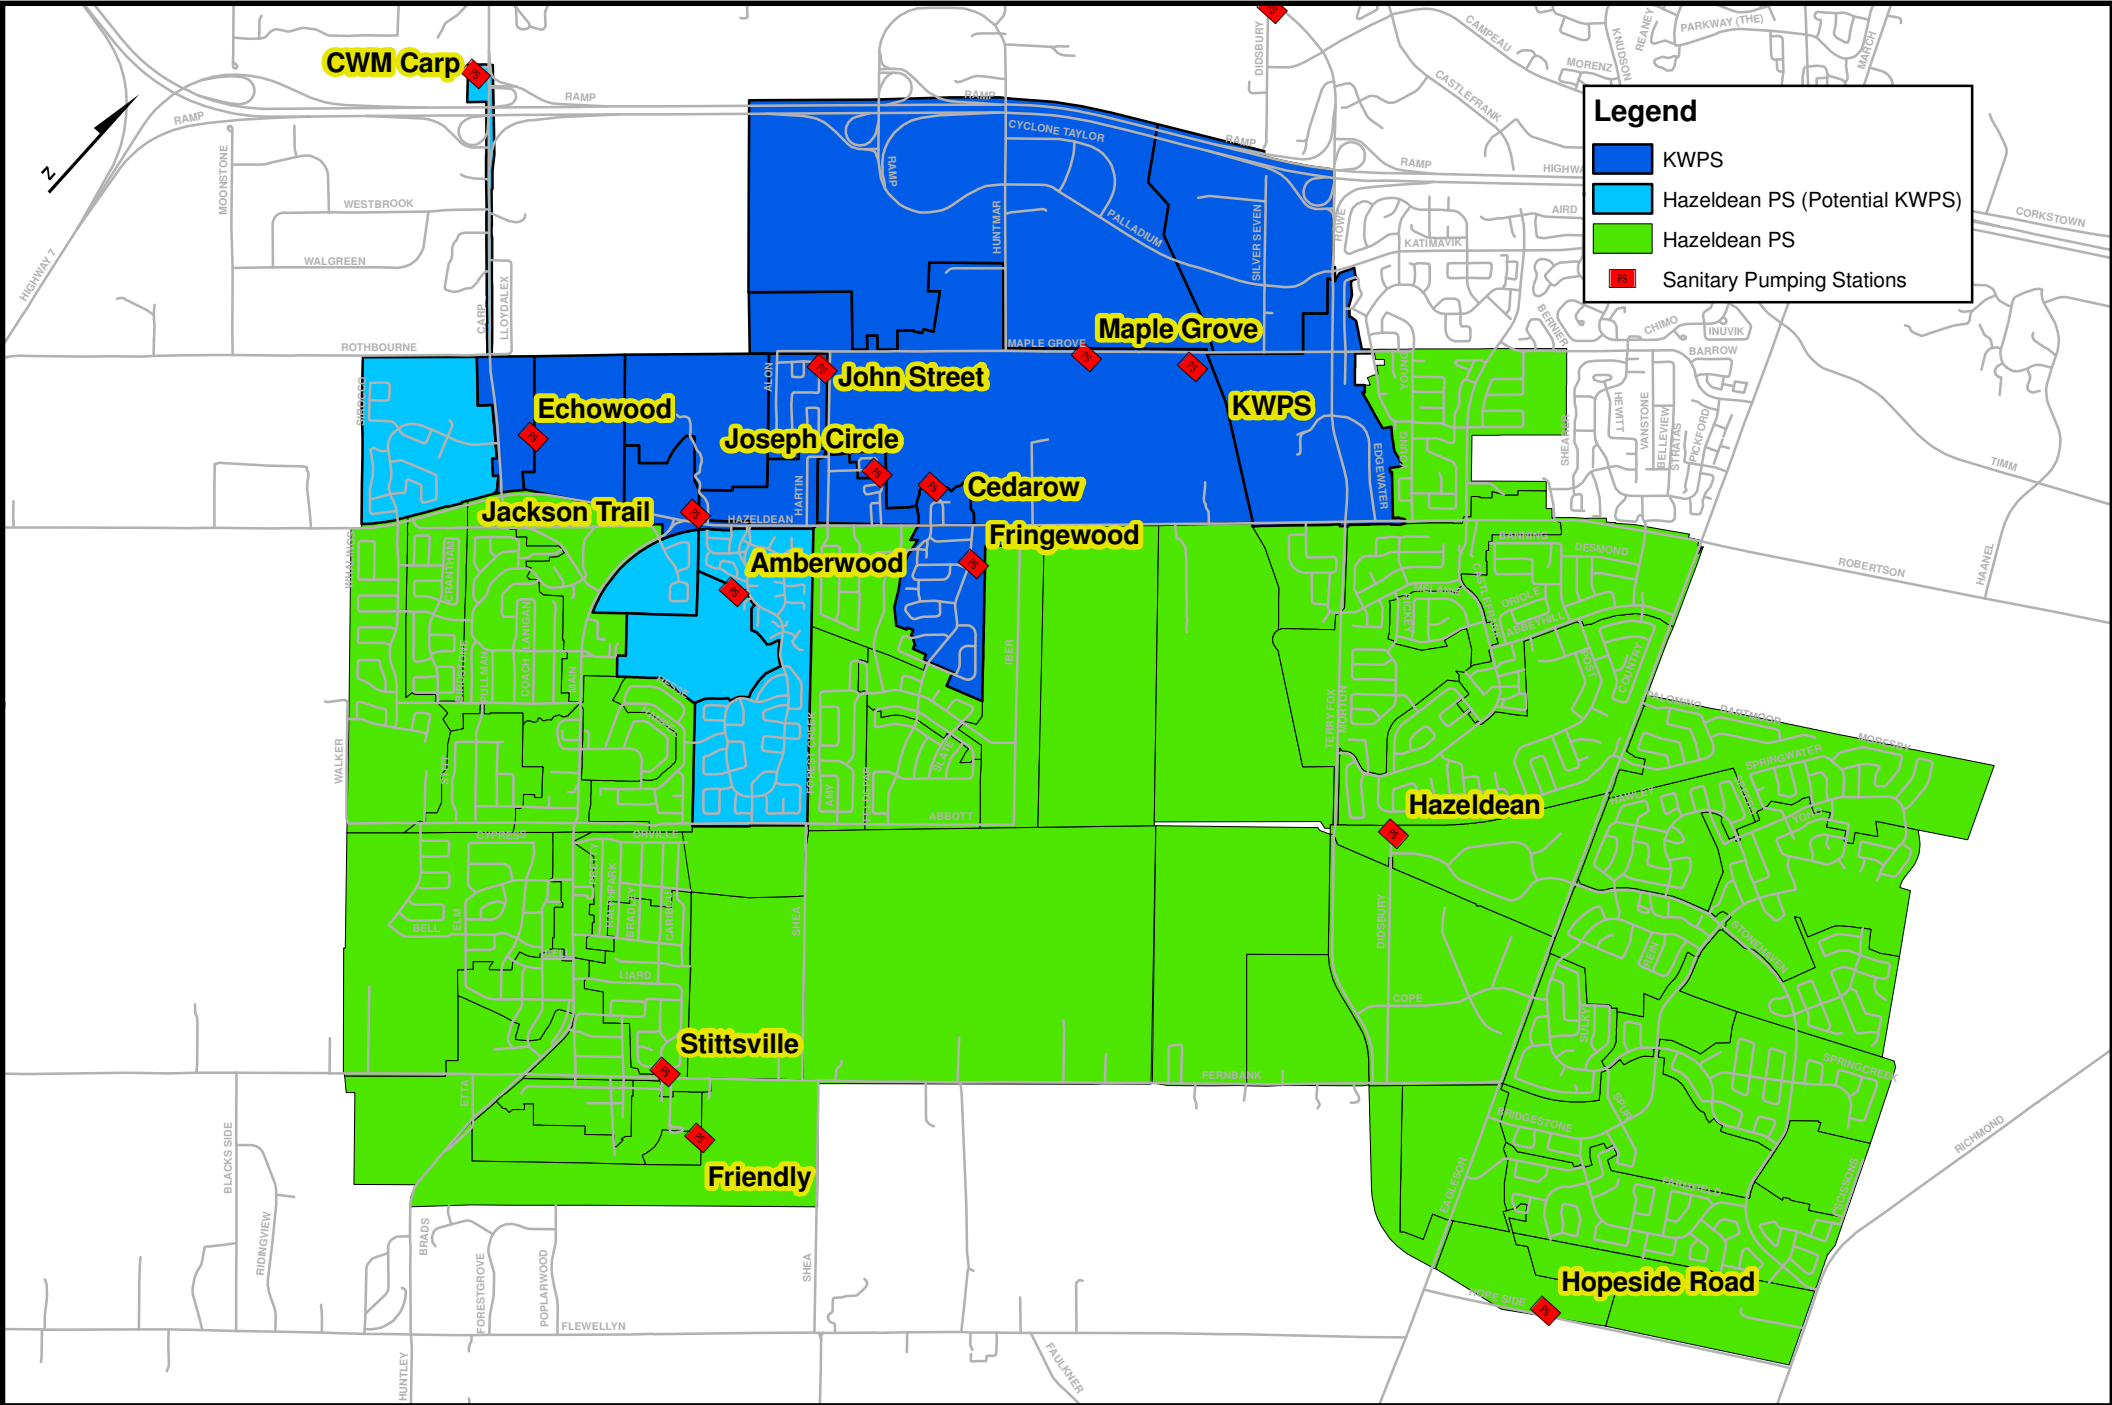


Legend

- KWPS
- Hazeldean PS (Potential KWPS)
- Hazeldean PS
- 25 Sanitary Pumping Stations




1:40,000




Client/Project City of Ottawa
WUCWC (1634-01026)
Figure No. 2
Title KWMSS Drainage Allocations

***Sanitary Drainage Plan (Project No. 10-451)
Reconstruction of Maple Grove Road***

David Schaeffer Engineering

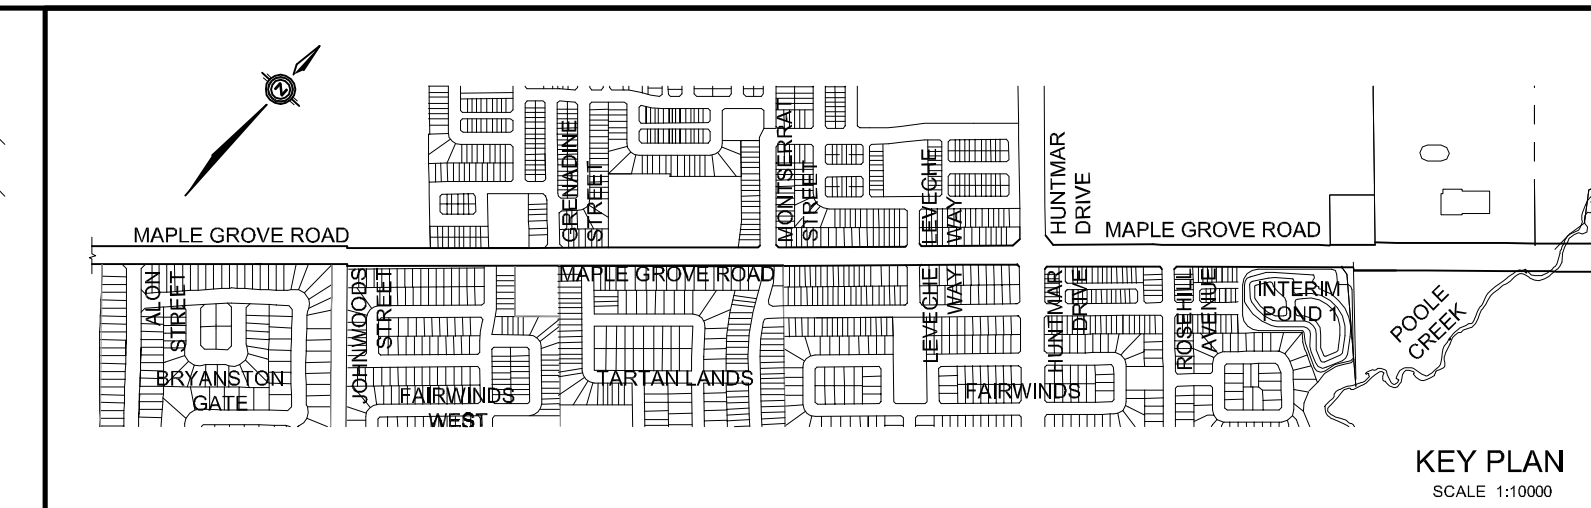

SUBJECT SITE

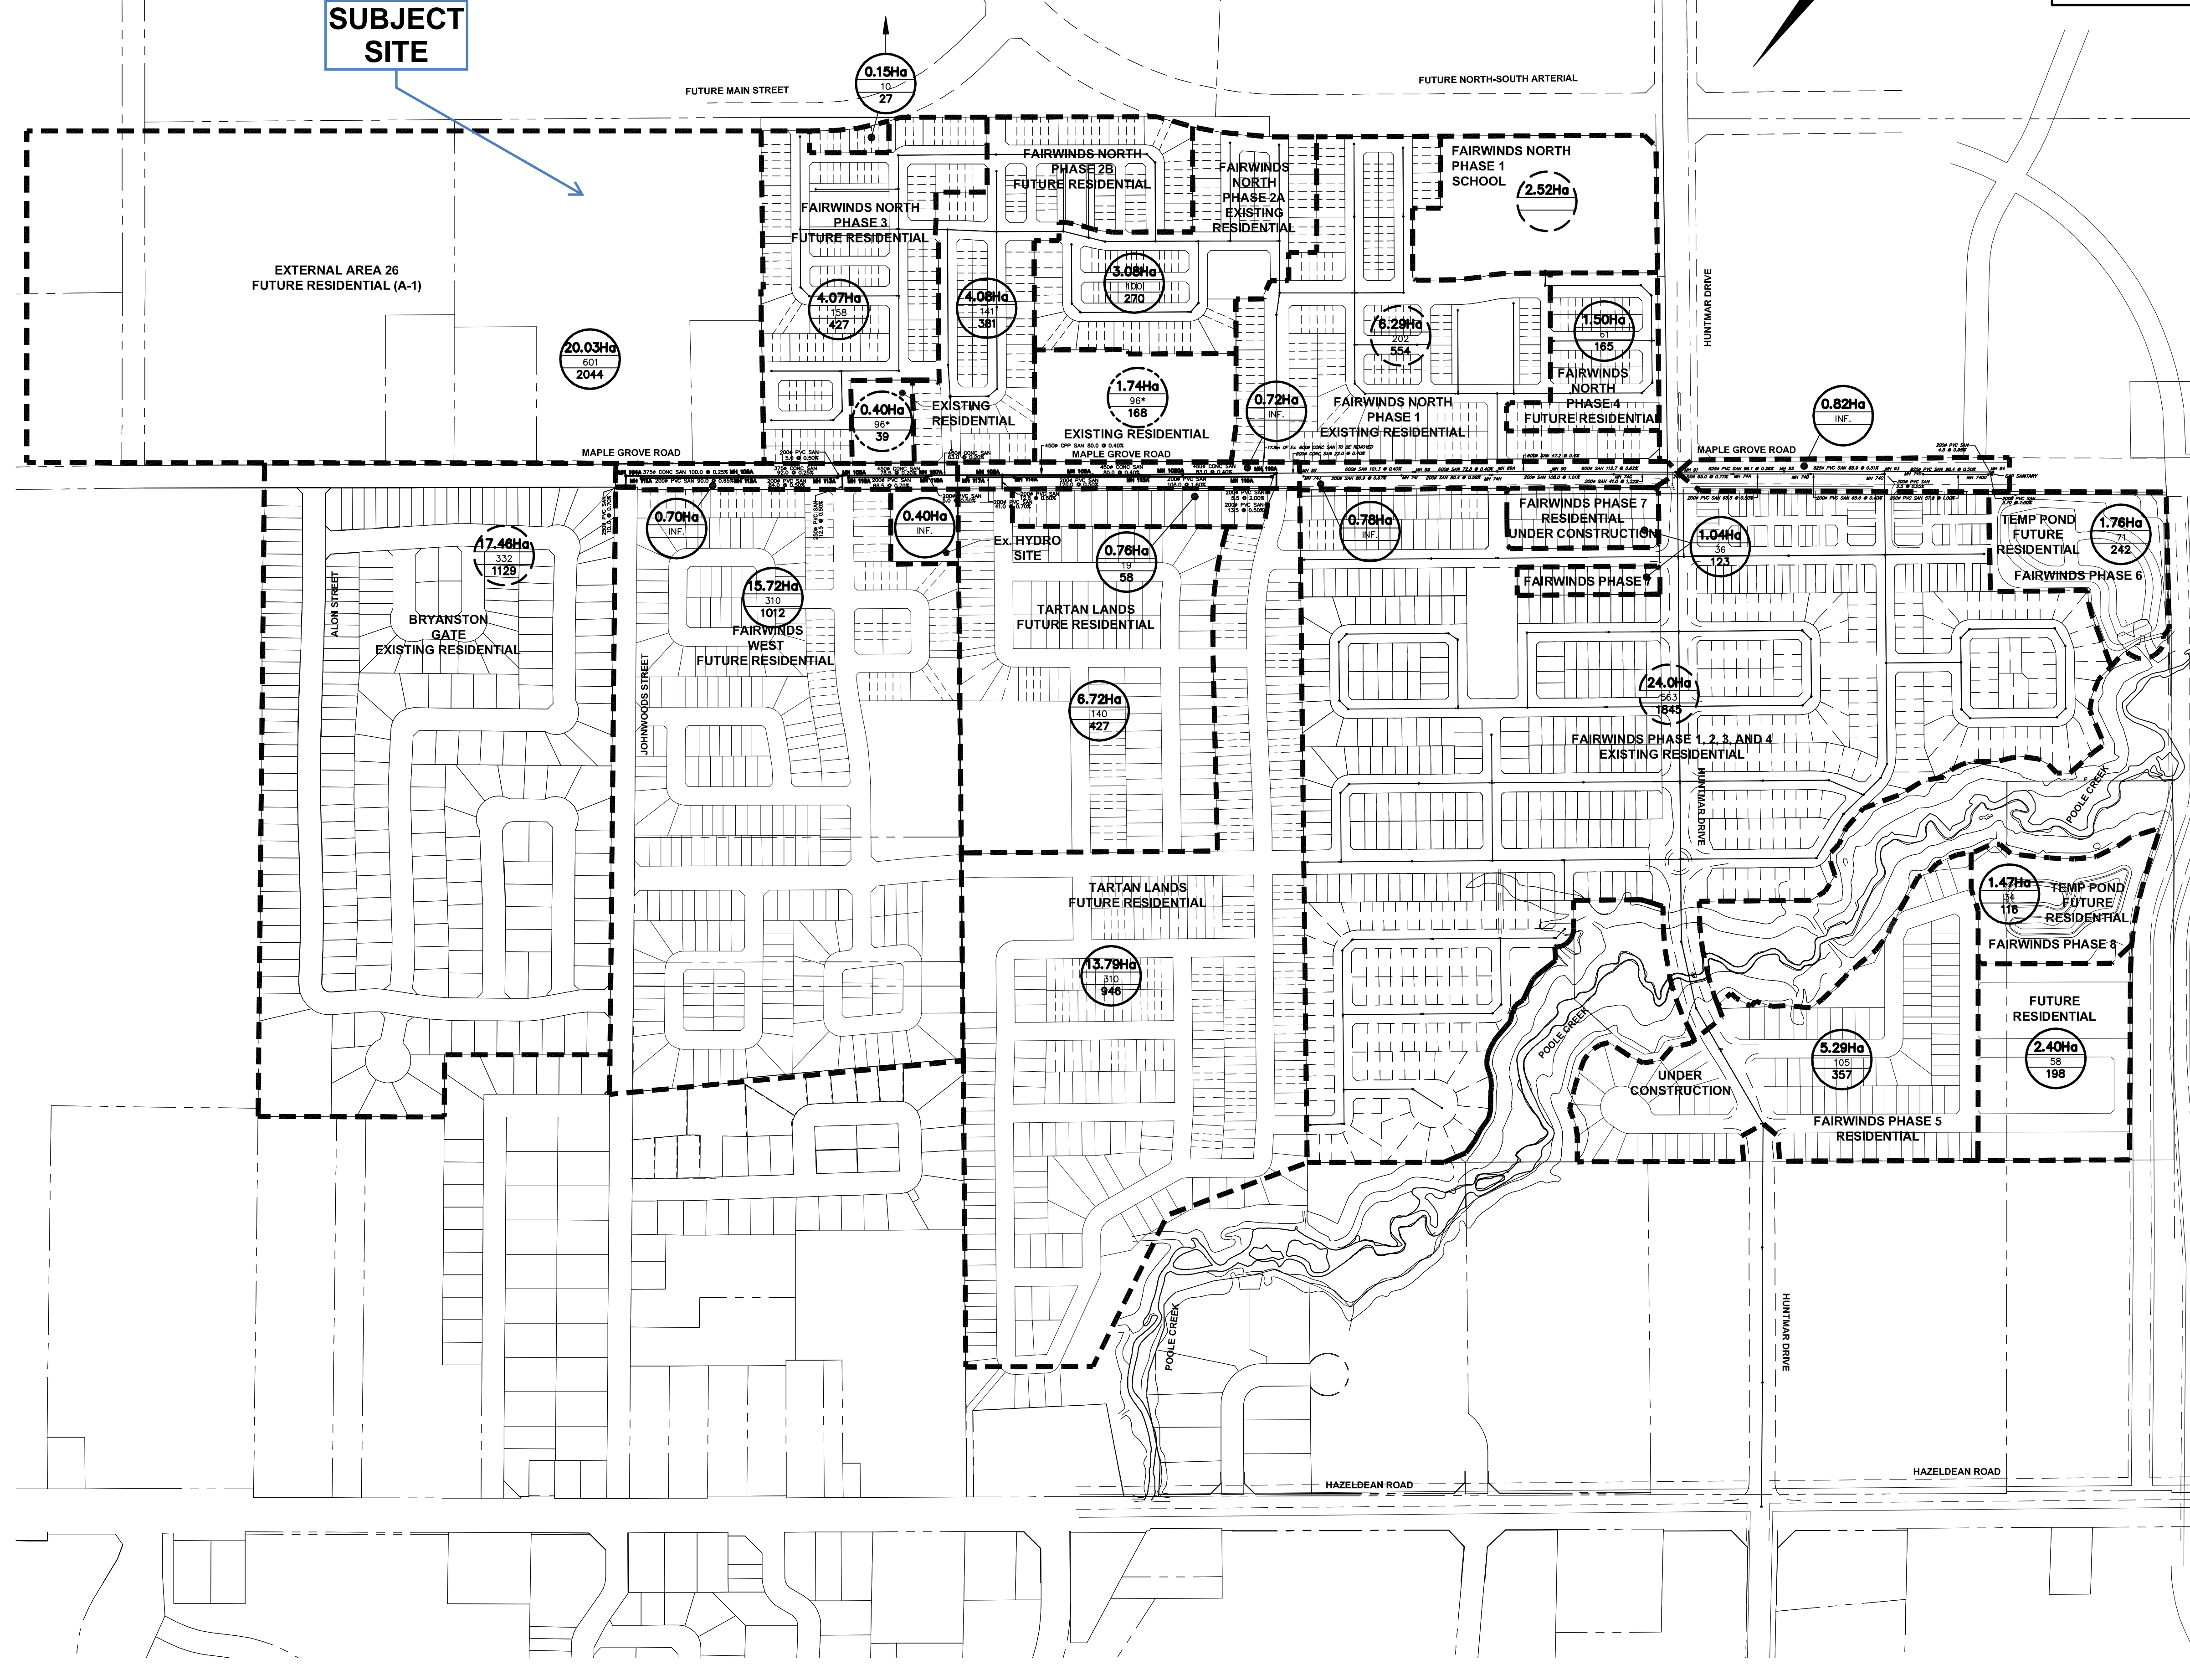

LEGEND

	0.82Ha 29 111	DRAINAGE AREA IN HECTARES UNIT NUMBER POPULATION (3.4 PERSON PER UNIT FOR SINGLE HOUSE), (2.7 PERSON PER UNIT FOR TOWNHOUSE).
	0.40Ha 96* 39	EXISTING DRAINAGE AREA IN HECTARES DENSITY (PERSONS PER HA) POPULATION
	0.82Ha 111	EXTERNAL DRAINAGE AREA IN HECTARES POPULATION
		SANITARY SEWER TRIBUTARY BOUNDARY
		SANITARY TRIBUTARY SUB-CATCHMENT BOUNDARY

TOPOGRAPHIC INFORMATION
 TOPOGRAPHIC INFORMATION PROVIDED BY J.D. BARNES LIMITED,
 PROJECT No. 05-10-459-02, SURVEY DATED JULY 6, 2011 AND
 PROJECT No. 0X-10-628-02, SURVEY DATED NOVEMBER 27, 2008 AND
 PROJECT No. 06-10-561-01-00, SURVEY DATED FEBRUARY 24, 2008 AND
 PROJECT No. 06-10-628-00, SURVEY DATED MARCH 29, 2007.

TOPOGRAPHIC INFORMATION PROVIDED BY STANTEC CONSULTING LIMITED AND
 WEBSTER & SIMMONS SURVEYING LIMITED, FILE No. 161610660-111
 RECEIVED ON DECEMBER 1, 2006.

LEGAL INFORMATION
 CALCULATED R-PLAN PROVIDED BY J.D. BARNES LIMITED,
 PROJECT No. 07-10-820-00, SURVEY DATED MAY 30, 2012.

BENCH MARK No. 0011988U502
 TOWNSHIP: TRITTSVILLE
 CONCRETE CULVERT ALONG HAZELDEAN ROAD, 1.3 KM NE OF ROAD INTERSECTION WITH MAIN ST NORTH, BRASS
 CAP SET ON TOP OF CONC CULVERT, SOUTH SIDE OF THE ROAD, 30 CM WEST OF EASTERLY EXTREMITY, 30 CM
 NORTH OF THE SOUTH FACE, SLIGHTLY BELOW ROAD LEVEL.
 ELEVATION = 106.039 m

No.	BY	DATE	DESCRIPTION	BY
5	Z.L.	13-01-04	REVISED SANITARY BETWEEN MH'S 105A-107A, 112A-106A, 115A-116A, 118A-119A	
4	Z.L.	12-05-31	SUBMISSION	
3	Z.L.	12-04-13	4th SUBMISSION	
2	Z.L.	12-02-14	3rd SUBMISSION	
1	Z.L.	11-08-02	2nd SUBMISSION	
1	Z.L.	11-08-02	1st SUBMISSION	



PROJECT No. 10-451

SANITARY DRAINAGE PLAN
 © DSEL

MATTAMY (FAIRWINDS NORTH) LIMITED
 RECONSTRUCTION OF MAPLE GROVE ROAD

DSEL
 david schaeffer engineering ltd

130 Ibis Road, Unit 203
 Stittsville, ON K2S 1E9
 Tel. (613) 836-0856
 Fax. (613) 836-7163
 www.DSEL.ca


DRAWN BY: W.L./C.M.	CHECKED BY: K.M.	DRAWING NO.	SHEET NO.
DESIGNED BY: K.M.	CHECKED BY: Z.L.		6
SCALE: 1:3000	DATE: JULY 2011		

SANITARY SEWER CALCULATION SHEET



Manning's n=0.013

LOCATION			RESIDENTIAL AREA AND POPULATION						COMM		INDUST		INSTIT		C+H		INFILTRATION				PIPE							
STREET	FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE		PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL.		
						AREA (ha)	POP.																			(FULL) (m/s)	(ACT.) (m/s)	
MAPLE GROVE ROAD																												
			20.03	601	2044	20.03	2044										20.03	20.03										
	104A	105A	17.46	332	1129	37.49	3173	3.42	43.96								17.46	37.49	10.497	54.46	100.0	375	0.25	87.67	0.62	0.79	0.83	
	105A	106A	0.70	0	0	38.19	3173	3.42	43.96								0.70	38.19	10.693	54.65	101.0	375	0.25	87.67	0.62	0.79	0.83	
			0.40		39	38.59	3212										0.40	38.59										
			0.40	0	0	38.99	3212										0.40	38.99										
	106A	107A	15.72	310	1012	54.71	4224	3.31	56.64								15.72	54.71	15.319	71.96	70.0	450	0.20	127.50	0.56	0.80	0.82	
	107A	108A	0.72	0	0	55.43	4224	3.31	56.64								0.72	55.43	15.520	72.16	63.0	450	0.20	127.50	0.57	0.80	0.82	
	108A	109A	6.72	140	427	62.15	4651	3.27	61.61								6.72	62.15	17.402	79.01	80.0	450	0.40	180.32	0.44	1.13	1.09	
	109A	1090A	1.74		168	63.89	4819	3.26	63.64								1.74	63.89	17.889	81.53	80.0	450	0.40	180.32	0.45	1.13	1.10	
	1090A	110A				63.89	4819	3.26	63.64								0.00	63.89	17.889	81.53	83.0	450	0.40	180.32	0.45	1.13	1.10	
			0.76	19	58	64.65	4877										0.76	64.65										
	110A	Ex. 88	13.79	310	946	78.44	5823	3.18	75.01								13.79	77.68	21.750	96.76	22.0	600	0.40	388.33	0.25	1.37	1.14	
	Ex. 88	Ex. 89	0.78	0	0	79.22	5823	3.18	75.01								0.78	78.46	21.969	96.98	101.3	600	0.40	388.33	0.25	1.37	1.14	
			4.07	158	427	83.29	6250										4.07	82.53										
			4.08	141	381	87.37	6631										4.08	86.61										
			3.08	100	270	90.45	6901										3.08	89.69										
			2.52			92.97	6901																					
			6.29	202	554	99.26	7455										6.29	95.98										
	Ex. 89	Ex. 89A	1.50	61	165	100.76	7620	3.07	94.76								1.50	97.48	27.294	122.05	72.8	600	0.40	388.33	0.31	1.37	1.21	
	Ex. 89A	Ex. 90				100.76	7620	3.07	94.76								0.00	97.48	27.294	122.05	47.2	600	0.40	388.33	0.31	1.37	1.21	
	Ex. 90	Ex. 91				100.76	7620	3.07	94.76								0.00	97.48	27.294	122.05	112.7	600	0.62	483.47	0.25	1.71	1.42	
			0.82	0	0	101.58	7620										0.82	98.30										
			1.04	36	123	102.62	7743										1.04	98.52										
			1.76	71	242	104.38	7985										1.76	100.28										
			24.00	563	1845	128.38	9830										24.00	124.28										
			2.40	58	198	130.78	10028										2.40	126.68										
			5.29	105	357	136.07	10385										5.29	131.97										
	Ex. 91	Ex. 92	1.47	34	116	137.54	10501	2.93	124.64								1.47	133.44	37.363	162.00	96.1	825	0.28	759.56	0.21	1.42	1.12	
	Ex. 92	Ex. 93				137.54	10501	2.93	124.64								0.00	133.44	37.363	162.00	88.9	825	0.51	1025.11	0.16	1.92	1.39	
	Ex. 93	Ex. 94				137.54	10501	2.93	124.64								0.00	133.44	37.363	162.00	96.4	825	0.50	1015.01	0.16	1.90	1.39	

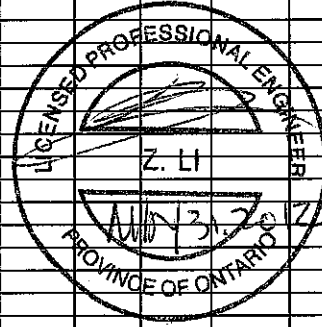

DESIGN PARAMETERS				Designed: K.M.				PROJECT: RECONSTRUCTION OF MAPLE GROVE ROAD							
Average Daily Flow = 350 l/p/day				Industrial Peak Factor = as per MOE Graph				Checked: Z.L.				LOCATION: City of Ottawa			
Commercial/Institution Flow = 50000 L/ha/da				Extraneous Flow = 0.280 L/s/ha				Dwg. Reference: Sanitary Drainage Plan, Dwg. No. 6				File Ref: 10-451			
Industrial Flow = 35000 L/ha/da				Minimum Velocity = 0.760 m/s				Date: May, 2012				Sheet No. 1 of 1			
Max Res. Peak Factor = 4.00				Manning's n = 0.013											
Commercial/Institution peak Factor = 1.50				Townhouse coeff= 2.7											
				Single house coeff= 3.4											

Economy (E) 25%

The reconstruction of the Signature Ridge Pumping Station is significantly more than the costs to upgrade the existing station.

Caring and Healthy Community (CHC) 25%

In terms of the impact on the Community, there are no significant differences between the two alternatives.

Natural Environment (NE) 14%

There are no significant differences between the two options with respect to impacts to the natural environment. Both alternatives require the construction of an emergency overflow to the Carp River. Impacts to surface water quality as a result of potential station overflows during an emergency situation are not expected to occur. Should an overflow occur for either alternative, the impacts would be mitigated by a SWM pond. Increases in CO₂ emissions as a result of the use of diesel generators during power failures or maintenance procedures will be negligible and are similar in both alternatives.

4.2.6.3 Selection of Preferred Signature Ridge Pumping Station Alternative

Based on the above evaluation, the Signature Ridge Pumping Station Alternative I, station upgrade, is selected as the preferred alternative. This alternative maximizes the use of existing infrastructure and offers the most flexibility in phasing of the works with the least amount of capital expenditure or impacts.

4.2.6.4 Summary

The preferred alternatives selected for the wastewater outlet, the internal servicing system, the temporary forcemain, the trunk sewer alignment, and the Signature Ridge Pumping Station have been used to develop a comprehensive wastewater servicing plan for the KWCP. This servicing plan is discussed in future detail in the following section of this report.


4.3 Preferred Sanitary Sewer Servicing Plan

Section 4.2 has detailed the selection of preferred alternatives for the major infrastructure required to provide sanitary sewer service to the KWCP. These preferred alternatives have been used to develop a Master Sanitary Servicing Plan for the area. This plan is illustrated on **Drawing S-1** (appended to this report). The major features of this plan are:

- (i.) An upgraded Signature Ridge Pumping Station (SRPS) to service all the KWCP lands north of the Queensway, the existing urban area north of the Queensway currently proposed to drain to the SRPS, and the Broughton/Richardson Interstitial lands. A spreadsheet detailing the exact areas and flows tributary to the SRPS is included in **Figure 4.2-1**.

The 400 l/sec peak flow capacity identified in **Figure 4.2-1** for the upgraded SRPS, is consistent with the findings of the R.V. Anderson Report titled "Signature Ridge Pumping Station Upgrades Feasibility Study".

SIGNATURE RIDGE PUMPING STATION LOCATION LOCATION

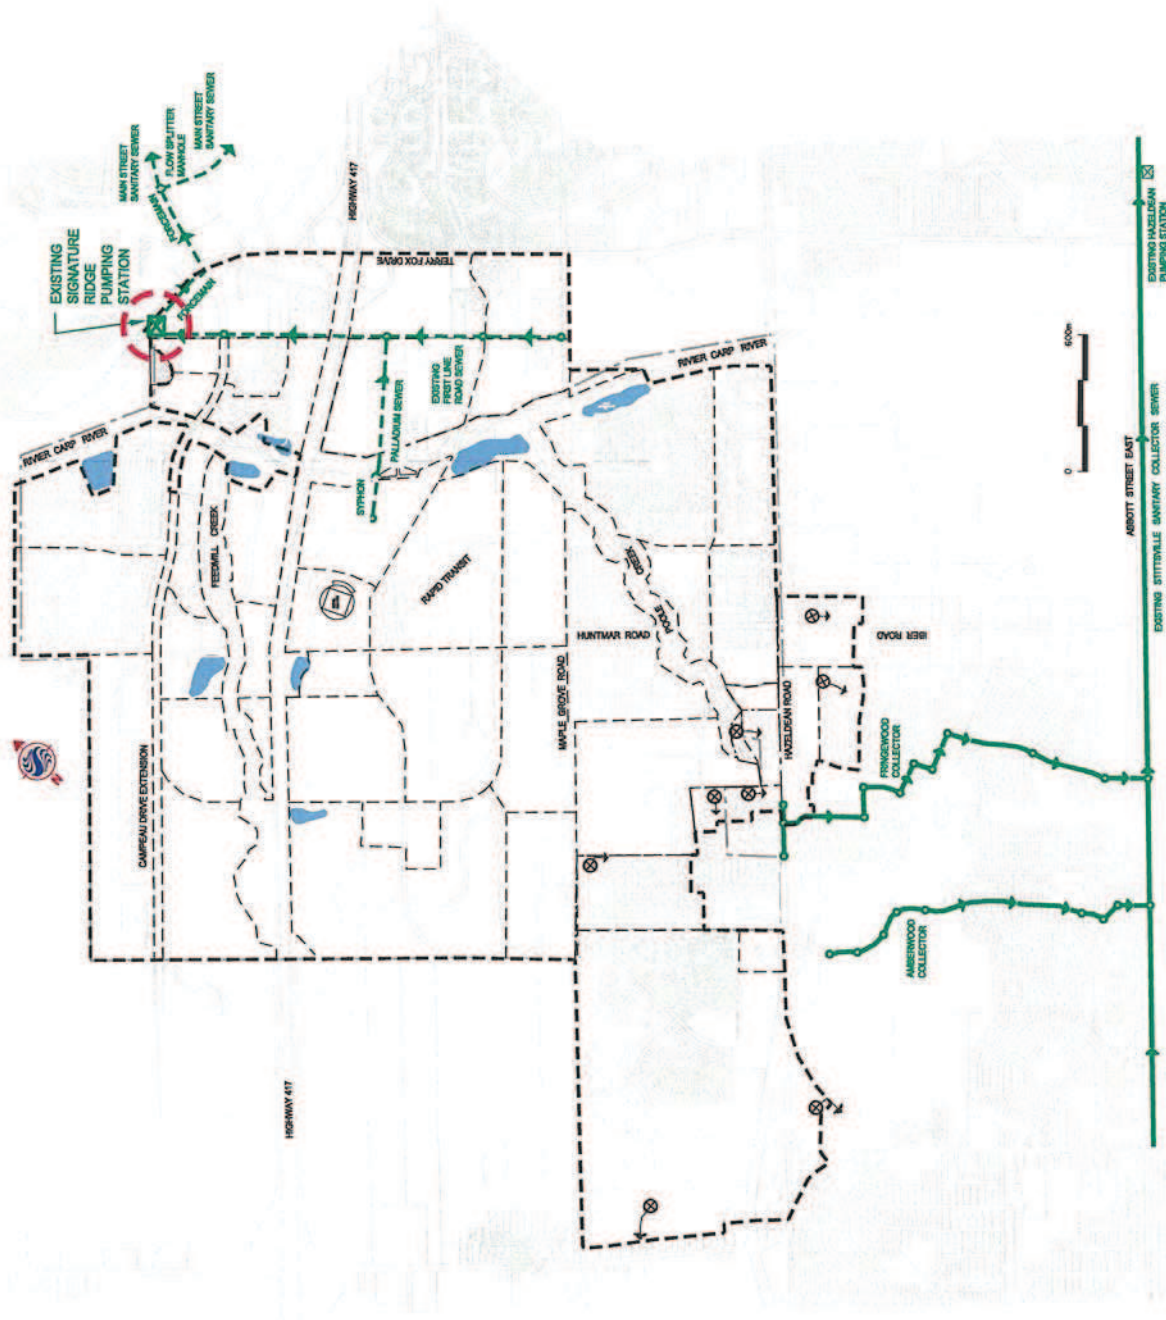

- Legend:**
- Ultimate Drainage Limit
 - Existing Sittitvale Sewer
 - - - Existing Trunk Sewer
 - ⊗ Existing Pumping Station and Forcemain (To be Decommissioned)

MAY 2006



FIG. 4.1-9

TABLE 4.1-6

Kanata West Wastewater - Temporary Forcemain/Trunk Sewer/Signature Ridge Alternatives



Criteria	Indicators	Weighting	Rationale for Relative Weights		Signature Ridge PS Alternative	
			Upgrade	Rebuild	Upgrade	Rebuild
CONSTRUCTABILITY/FUNCTIONALITY						
CO1.1	Potential for encountering poor soils and/or elevated groundwater conditions.	36%	24	16	3	1
CO1.2	Extent of works required.	7%	4	1	4	1
CO1.3	Amount of maintenance intensive infrastructure required.	7%	3	3	3	3
CO1.4	Impact of construction on development timing.	6%	4	2	4	2
CO1.5	Ease of property acquisition. (Depends on status of lands and adjacent lands, i.e. vacant, leased or owner occupied)	4%	5	2	5	2
CO1.6	Proximity of a storm sewer, SWM or other surface water for emergency overflow	2%	3	3	3	3
CO1.7	Ease of accommodating potential changes in servicing plans.	6%	2	4	2	4
		5%				
ECONOMY						
E1	Potential to Use Combined Services Corridor	25%	19	12	3	3
E2	Use of existing capacity	6%	5	2	5	2
E3	Pumping requirements	5%	3	3	3	3
E4	Estimated cost of construction.	4%	3	3	3	3
E5	Impact on Agriculture	2%	5	1	5	1
E6	Capital Cost	6%				
CARING AND HEALTHY COMMUNITIES						
C3	Affects areas of residence, institutions or businesses.	25%	12	9	4	4
C4	Disruption to Existing Community	6%	4	3	4	3
C9	Compatibility with Planned Land Use and Infrastructure (Kanata West Roadwork Environmental Study Report and Storm Sewer and Watermain Needs).	11%	4	2	4	2
NATURAL ENVIRONMENT						
N1	Loss of natural area due to installation of works.	3%	14	14	3	3
N3	Potential impact on fish habitat due to installation of works.	3%	3	3	3	3
N4	Potential impact on water quality in the Carp River resulting from rate emergency overflows to the SWM pond due to pump station failure.	3%	3	3	3	3
N5	Difference in carbon dioxide emissions resulting from occasional use of diesel generator.	1%	2	2	2	2
N6	Disruption to greenspace and trees.	5%	3	3	3	3
Total Score						
Ranking		100%	3,600	2,480	1	2
Estimated Capital Cost (in \$million)			1	1	1	4

Evaluation Ranking
 1 - High or Negative Impact
 2 - Moderate or No Impact
 3 - Low or Positive Impact

Description of Alternatives
 Signature Ridge PS Alternative 1 - Rebuild
 Signature Ridge PS Alternative II - Upgrade

The Signature Ridge Pumping Station is currently not equipped with catastrophic failure protection in the form of a gravity overflow. A hydraulic analysis of the proposed sewer system was therefore completed to evaluate the potential for providing a gravity overflow. This analysis demonstrates that catastrophic protection can be provided by gravity. The analysis is included in **Appendix 4.2** and demonstrates that overflows to the existing stormwater management pond on First Line Road and to Pond I can provide the necessary level of protection.

- (ii.) A single new pumping station and forcemain located south of Maple Grove Road and west of the Carp River.

This new pumping station ultimately services all the KWCP south of Highway 417, the lands south of the 417 originally tributary to the SRPS, and the lands in the Village of Stittsville, along Hazeldean Road which are currently unserviceable by gravity to the Stittsville Sanitary Sewer System. This new pumping station has also been designed to accommodate the decommissioning of up to eight small public and private pumping stations along Hazeldean Road without deepening the Kanata West system. **Figure 4.2-1** details the exact areas and flows from Stittsville which will ultimately be tributary to the new pumping station. The areas are also illustrated on **Drawing S-1**.

Figures 4.2-3 and 4.2-4 illustrate a conceptual layout and cross-section for the new pumping station and **Appendix 4.3** details the conceptual design of the pumping station.

The new pumping station will temporarily outlet to the Stittsville Collector Sewer via a temporary forcemain in Huntmar Road and Iber Road. This temporary forcemain is designed to accommodate a flow of 190 l/sec (approximately 3,000 units). The temporary outlet will be located entirely within a public right-of-way. The single 405 mm diameter forcemain used for the initial outlet can be kept in service for long-term use as an emergency back up outlet. Rationale on the availability of capacity in the Stittsville Collector Sewer is attached as **Appendix 4.1**.

The permanent outlet for the new pumping station consists of a forcemain leading from the pumping station to the Glen Cairn Collector Sewer east of Eagleson Road. The preferred route for this forcemain is along Maple Grove Road to Silver Seven Road; along the east side of Silver Seven Road, in an easement, in the undeveloped lands between Maple Grove Road and Palladium Drive; easterly along Palladium Drive to Katimavik Road; and easterly along the north side of Katimavik Road, in the corridor for the unbuilt westbound lanes of Katimavik Road, to Eagleson Road and the Glen Cairn Collector Sewer. The location of the new pumping station is in close proximity to Stormwater Management Ponds 4 and 5. This provides catastrophic failure protection to the new pumping station in the form of a gravity overflow. The hydraulic analysis of this overflow system is attached as **Appendix 4.2**.

The preferred sanitary sewer system also includes a gravity sewer, which collects flow from several minor internal sanitary sewers and directs this flow to the new pumping station location. As illustrated on **Drawing S-1** this minor collector sewer runs parallel to the west side of the Carp River corridor between Maple Grove Road and Palladium Drive, crossing under the Carp River by boring beneath the river. The sewer extends northerly to intercept flows from Silver Seven Road and diverts them from the Signature Ridge Pumping Station. The inclusion of this north south sewer is a key element in eliminating the need for double pumping within Kanata

SANITARY SEWER DESIGN SHEET
 PROJECT: Kanata West Servicing Study
 LOCATION: CITY OF OTTAWA

STREET	LOCATION		TOTAL AREA (Ha)	RESIDENTIAL			EMPLOYMENT/RETAIL/BUSINESS PARK/OPEN SPACES			INFILTRATION			TOTAL FLOW			PROPOSED SEWER									
	FROM MH	TO MH		APPLIC AREA (Ha)	UNITS/Ha	TOTAL UNITS	INDIV POPULATION	PEAK FACTOR	PEAK FLOW (l/s)	APPLIC AREA (Ha)	ACCUM AREA (Ha)	TOTAL AREA (Ha)	FLOW RATE (l/ha/d)	INDIV (l/s)	ACCUM (l/s)	PEAK FLOW (l/s)	INDIV CUMUL	TOTAL CUMUL	PEAK FLOW (l/s)	CAPACITY (l/s)	VELOCITY (ft/d)	LGTH. (m)	PIPE (mm)	GRADE %	AVAIL. CAP. (%)
Campaign Drive Trunk Sewer	1	2	0.00																						
			0.00																						
			0.00																						
			0.00																						
			29.19	19	555	1664	3.65	24.58	0.00	0.00	0.00	0.00	0.00	0.00	0.00	29.19	29.19	8.17	286.61	0.98	700.0	600	0.20	88.57%	
			0.00																						
			0.00																						
			0.00																						
			27.86	19	529	1588	3.66	24.58	0.00	0.00	0.00	0.00	0.00	0.00	0.00	29.19	29.19	8.17	286.61	0.91	920.0	450	0.25	100.00%	
			4.13	50	88	263	3.38	48.17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	29.19	29.19	8.17	286.61	0.90	150.0	675	0.20	83.68%	
			6.05																						
			20.15																						
			14.59																						
			11.97																						
			20.66																						
			28.89																						
			102.31																						
			6.35																						
			11.80																						
			3.88																						
			25.54																						
			149.88																						
			90.20																						
			4.88																						
			306.14																						
			154.03																						
			127.33																						
			9409																						
			85.97																						
			306.14																						
			115.72																						
			394.02																						
			625.68																						
			1.37																						
			30.0																						
			750																						
			0.29																						
			37.03%																						

Note: Sewer from node 5 to SRPS is existing and is to be replaced.


Revision No. 1: April 11, 2005
 Revision No. 2: April 20, 2005
 Revision No. 3: June 07, 2005
 Revision No. 4: Oct. 14, 2005
 Revision No. 5: Feb. 15, 2005

Average Daily Per capita Flow Rate = 350 l/cap/d
 Infiltration Allowance Flow Rate = 0.28 l/see/ha
 Residential Peaking Factor = $1 + (14 / (4 + (P - 0.5)))$; P = Pop. in 1000's, Max of 4
 Population density per unit = 3.00
 P.F. For Employment/Retail/Business Park = 1.50
 Mixed Use Assumed: 15% Community Retail, 42.5% Business Park and 42.5% Residential



FIG. 4.2-2


CONCEPTUAL
PUMPING STATION
SITE PLAN

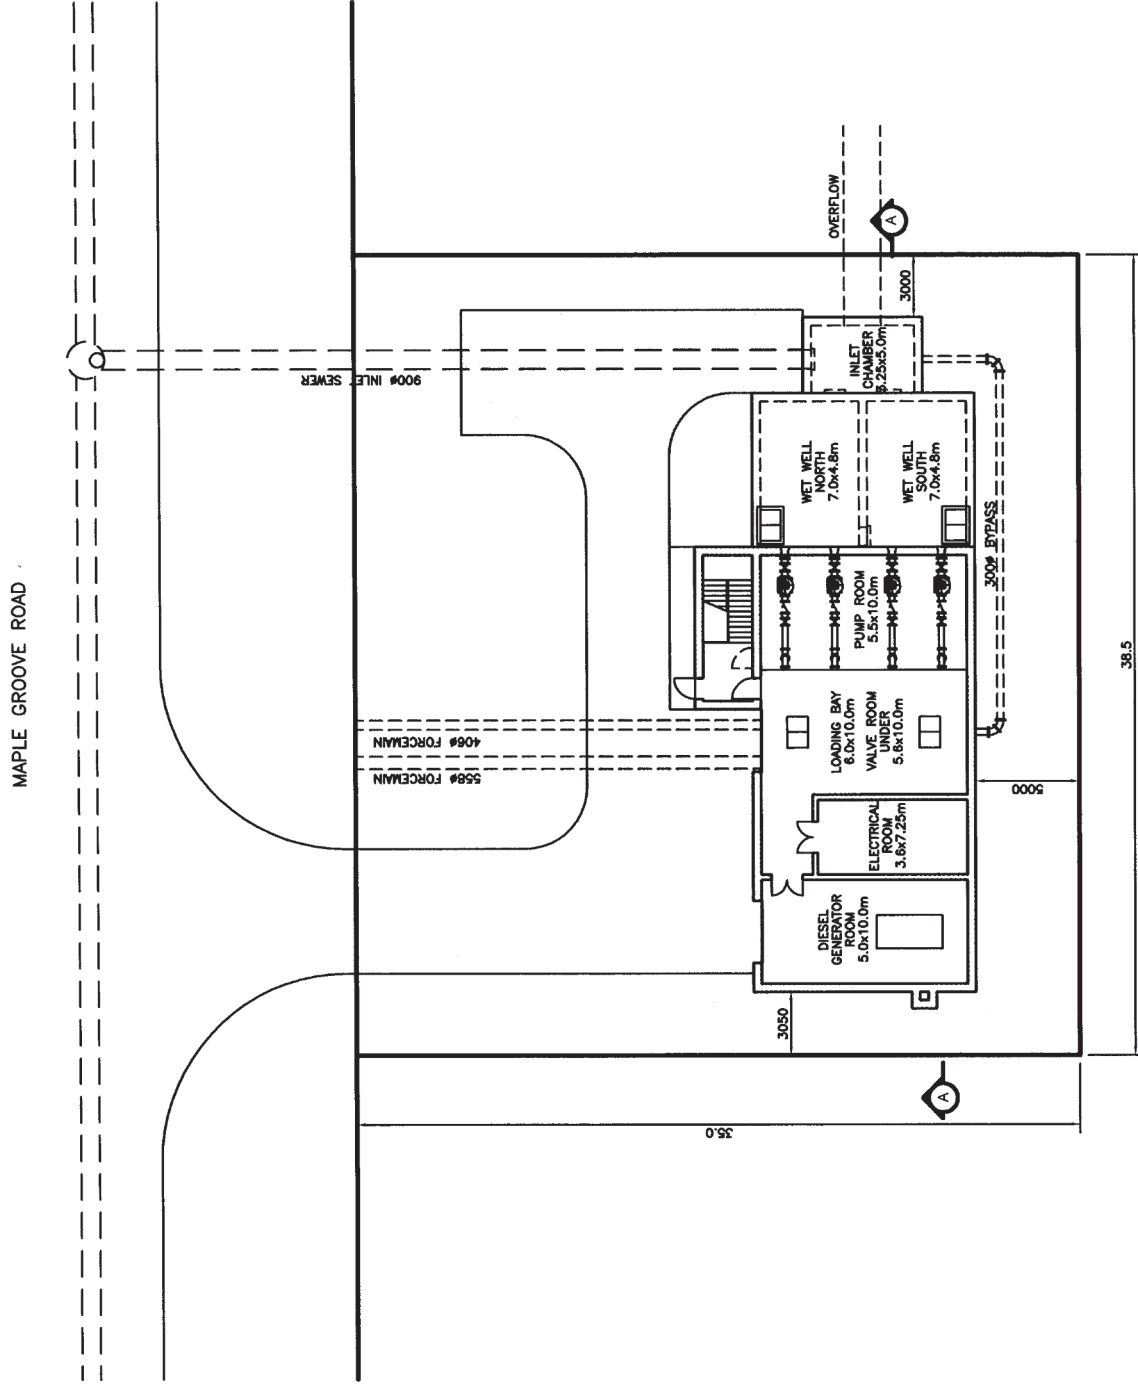

MAY 2006

FIG. 4.2-3

CONCEPTUAL
PUMPING STATION
SECTION

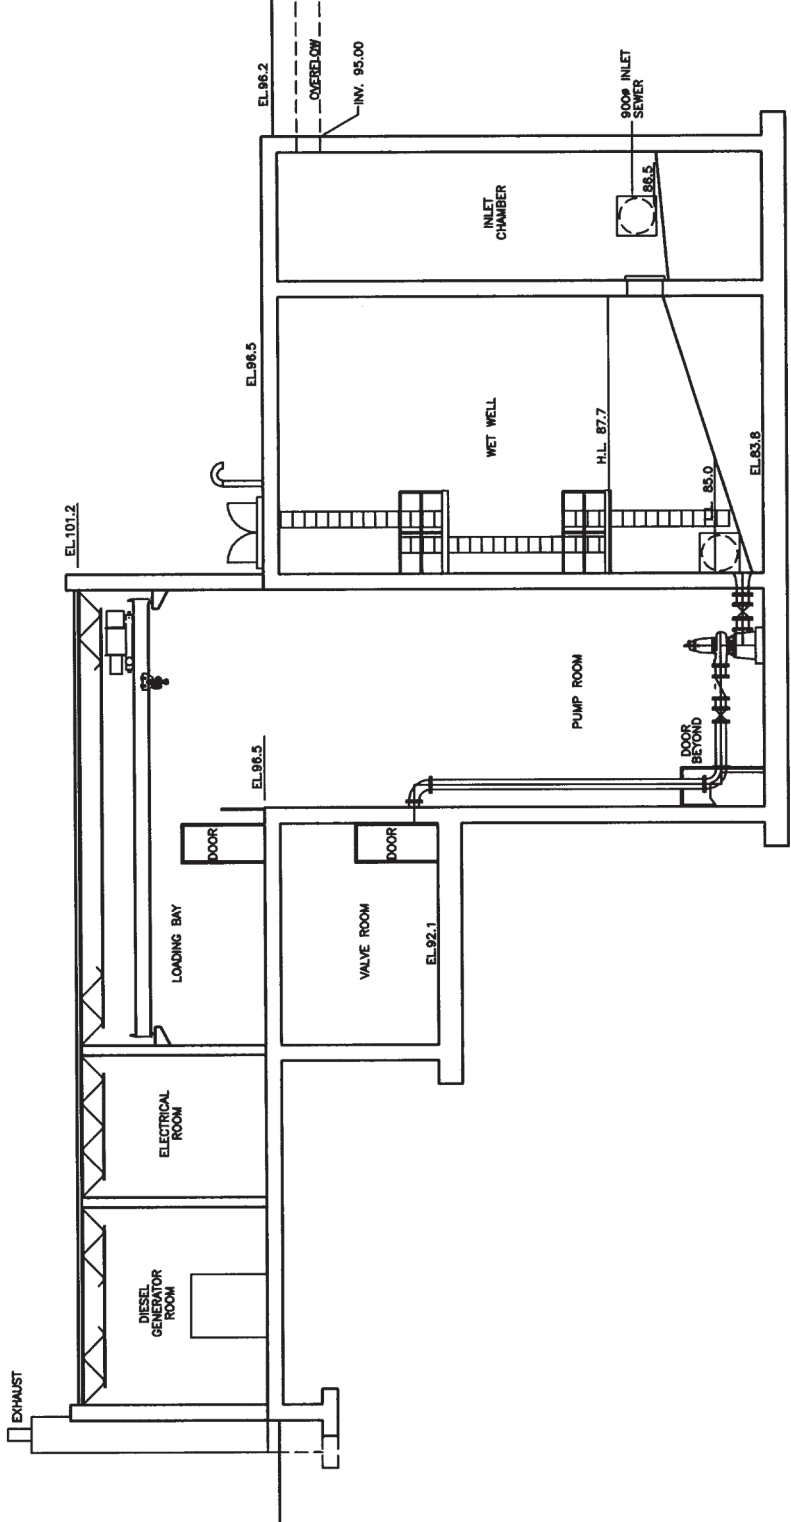

MAY 2006

FIG. 4.2-4



West. The alignment of this minor collector sewer in a north-south direct along the east limit of the development area also allows the internal sanitary sewer system to parallel the storm sewer system throughout the development area. This is a critical element in providing a coordinated and cost effective servicing scheme, which can accommodate the phased development of the KWCP over several years. The location of this sewer also facilitates the decommissioning of the Palladium Siphon and avoids placing this sewer in an area of significant fill. It also places the sewer in a designated corridor that can be graded to provide a minimum of 1.5 meters of freeboard between the 1:100 year flood level of the Carp River and the top of the covers in the access chambers. All pond outlets to the Carp River are above the 1:100 year flood plain, as well as the water elevations associated with the historical storm events analyzed in the Flood Characterization and Flood Level Analysis, prepared on CH2MHill. A designated corridor width of 20 meters is recommended for this sewer between Maple Grove Road and Palladium Drive.

Drawing S-1 also illustrates the overall major sanitary sewer system for the entire KWCP including tributary areas, pipe sizes, external pumping stations, which are to be decommissioned, and the proposed outlet location for these existing systems.

A profile of the trunk sanitary sewer system is included in the appendices of this report. These profiles illustrate the proposed elevation of the sanitary sewers relative to the storm sewers demonstrating the coordinated design of these two systems.

4.4 Design Criteria

The following City of Ottawa design guidelines were used in the preparation of the sanitary sewer analysis provided in this report:

Residential Average Daily Flow Rate	350 L/P Day
Residential Peak Factor	Modified Harmon Formula
Business Park Flow Rates	35,000 L/Ha/Day
Employment Area Flow Rate	50,000 L/Ha/Day
Business Park / Employment Peak Factor	1.5
Infiltration Rate	0.28 L/Sec/Day

4.5 Construction Phasing

It is anticipated that the build out of the KWCP will take many years. The high capital cost of the associated infrastructure dictates that a phased construction approach will be required. Servicing studies completed previously for the area have provided the framework for the phased construction of the wastewater system, which included the use of residual capacity in the existing sanitary sewer system in Stittsville. The following is a brief description of the proposed construction phasing plan, which builds on previous studies, incorporates recent construction proposals for the developers group, and incorporates additional, detailed analysis of the existing Stittsville sanitary system.

Figure 4.2-5 illustrates the area identified as Phase I in terms of wastewater servicing. Area "A" includes the area, which will be tributary to the Signature Ridge Pumping Station in the short term. This drainage area ultimately requires the expansion of the Signature Ridge Pumping Station to 400 l/sec, assumes that the lands south of Highway 417 currently draining to this pumping station will continue to do so in the short term, and that these lands will build out. This scheme also accommodates build out of the Broughton/Richardson and Interstitial Lands as part of Phase I (see **Figure 4.2-2** for details of this analysis). A regular flow monitoring program

1.0 Introduction

1.1 BACKGROUND

The Kanata West Pumping Station (KWPS) will serve as the primary pumping facility providing wastewater servicing for the Kanata West Concept Plan (KWCP) development.

Located between Stittsville and Kanata, the KWCP is a major component of urban growth in the western portion of the City of Ottawa. The development is being planned as a mixed-use community that will include a population of approximately 17,000 persons in 6,300 households, 24,000 jobs and approximately 1 million square metres of commercial space. The approved KWCP includes the transportation network and servicing infrastructure required to support the identified land use plan. This includes a rapid transit corridor, a number of primary arterial roads, minor arterial roads, major collector roads, water, sewers, stormwater management and watercourse corridors.

The Kanata West Pump Station and Forcemains will provide sanitary servicing for Kanata West south of Hwy 417 and adjacent areas in Stittsville. The KWPS will convey wastewater from the pumping station to the existing Glen Cairn Trunk Sewer on Eagleson Road. The pumping station location and general operational requirements were specified in the *Kanata West Pump Station and Forcemains Functional Design Report* (Stantec, August 8, 2012) which built on the *Kanata West Concept Plan – Master Servicing Study* (Stantec/CCL IBI Group, 2006) and the *Kanata West Master Servicing Study Update 2010* (Stantec/CCL IBI Group, 2010).

The preliminary design was not advanced after completion of the functional design confirmation until the land for the preferred pump station site was secured and the ultimate station inflow was confirmed in April 2013. Key differences between the functional design and preliminary design are summarized in **Section 2.2**.

1.2 SCOPE OF WORK AND PURPOSE OF REPORT

The purpose of this report and the associated drawings is to present the preliminary design of the KWPS and forcemains including, but not limited to, the following.

- Detail the civil, architectural, process, electrical and instrumentation requirements and preliminary design layout for the KWPS;
- Provide a preliminary process control philosophy for operation and phasing of the pump station;
- Develop preliminary forcemain plan and profile drawings showing the preferred alignment, Carp River crossing, Watts Creek crossing, and major intersection crossings;

- Detail the proposed construction staging and construction impact mitigation measures;
- Provide preliminary geotechnical and hydrogeological recommendations/considerations and their impact on structural design and construction methods;
- Provide an opinion of probable capital construction and operation and maintenance costs for construction of the proposed works;
- Provide a preliminary construction schedule for completion of the proposed works.

1.3 RELATED DOCUMENTS AND REPORTS

The following documents and reports were reviewed during the KWPS preliminary design:

- *Kanata West Pump Station and Forcemains Functional Design Report* (Stantec, August 8, 2012)
- *Kanata West Concept Plan – Master Servicing Study* (Delcan/Stantec/CCL IBI Group, 2006)
- *Kanata West Master Servicing Study Update 2010* (Delcan/Stantec/CCL IBI Group, 2010)
- *Implementation Plan Kanata West Development Area* (Declan, July, 2010)
- *West Urban Community Technical Memorandum* (Stantec, June 28, 2012)
- *West Urban Community – Wastewater Collection System Master Servicing Plan - Study* (R.V. Anderson Limited/Stantec, July 2012)
- *Fernbank Community Sanitary Trunk Sewer Design Report* (Novatech, November 14, 2011)
- *Kanata West Transportation Master Plan Update and Amendment 2010* (Delcan, July 12, 2012)
- *Carp River Restoration Plan – Widening Alternatives* (Greenland, May, 2010)
- *City of Ottawa Sewer Design Guidelines* (City of Ottawa, October 2012)
- *Design Guidelines for Sewage Works 2008* (Ministry of the Environment, 2008)
- *West End Odour and Corrosion Master Plan* (Stantec/OCTC, March, 2004)

2.0 Pumping Station Drainage Area and Design Flows

2.1 CATCHMENT AREA AND DESIGN FLOWS

A technical memorandum titled *Kanata West Pump Station Flow Development Background* (Stantec, June 28, 2012) outlines the KWPS flow projections and associated catchment areas, which is included in **Appendix H**.

The KWPS is expected to receive flows from a large portion of the western community development area. These flows will include diverted flows from the Stittsville and/or Fernbank Trunk Sewers. The exact timing of flow diversions from the Stittsville and/or Fernbank trunk sewers is not known at this time. **Figure 2-1** identifies the catchment area for the KWPS.

Since the firm capacity of the station will not be reached until 2031, incoming flows will increase in various phases as summarized below. The phases noted below are based on inflow to the station (not time/years) and are intended to aide City Operations with operational changes to suit increasing flow conditions over the life of the PS. The Phases represent specific flow thresholds at which point operational changes will be required at the pump station for efficient operation.

- **Phase 1:** Immediately following pump station startup, flow is diverted from the existing temporary Fairwinds (Mattamy) pump station located on Maple Grove Rd. to the KWPS (Average Dry Weather Flow: 50L/s; Peak Wet Weather Flow: 134L/s).
- **Phase 2 & 3:** Flow from development growth and diverted flows from the Stittsville and/or Fernbank trunk sewers (Average Dry Weather Flow: 238L/s to 258L/s; Peak Wet Weather Flow: 715L/s to 760L/s). These phases will require operational control modifications at the KWPS, which are described in further detail later in this report.
- **Phase 4:** Ultimate peak inflow to the KWPS from development growth in the catchment areas (Average Dry Weather Flow: 417L/s; Peak Wet Weather Flow: 1250/s).

KANATA WEST PUMPING STATION AND FORCEMAINS

Pumping Station Drainage Area and Design Flows

October 9, 2013

Table 2-1 below summarizes the influent peak and average flows to the KWPS. The ultimate flows (2031 conditions) are extracted from the *Kanata West Pump Station and Force mains Functional Design Report (Stantec, August 8, 2012)* and the *West Urban community Sanitary Sewer Servicing Technical Memorandum (Stantec, May 4, 2012)*.

Table 2-1: Station Design Flows

	Pumping Capacity (L/s)	Average Flow (L/s)
Phase 1 (Post KWPS Startup)	525	50
Phase 2	715	238
Phase 3	760	253
Phase 4 (Ultimate)	1250	417

Phase 1 average flow is based on existing data from the Mattamy/Fairwinds PS. Phase 2-4 average flow is based on a factor of 0.33 of the pumping capacity.

Since the exact timing of the phases described above are not known, the preliminary design must account for the station’s ability to handle a range of flow conditions. This would allow future development to be accommodated in a cost effective manner to suit projected flows for ultimate conditions without the need for equipment upgrades or reconstruction at great expense. Further details with respect to station operation during the phases are provided later in this report. The phases described above are based on influent flow rates to the station. Permanent inflow monitoring at the station will be used to determine when changes to station operation (i.e. increased setpoints, two wet well operation, etc.) will be implemented.

The KWPS will discharge to the Glen Cairn trunk sewer on Eagleson Road. The capacity of the Glen Cairn trunk sewer to accept the additional flow from the KWPS was reviewed as part of the *West Urban Community – Wastewater Collection System Master Servicing Plan - Study (R.V. Anderson Limited, July 2012)*. The timing for when connection to the Glen Cairn trunk sewer would be permitted will need to be reviewed with the City during the detailed design.

It is our understanding that the downstream Tri-Township Collector, which the Glen Cairn Trunk Sewer discharges to, is currently nearing its conveyance capacity. Construction of the North Kanata Trunk (NKT) must be completed prior KWPS startup to ensure adequate capacity is provided within the Tri-Township Collector.

2.2 KEY DIFFERENCES FROM FUNCTIONAL DESIGN TO PRELIMINARY DESIGN


There were several major changes from the functional design to the preliminary design. The key changes and associated notes are summarized below:

KANATA WEST PUMPING STATION AND FORCEMAINS

Pumping Station Drainage Area and Design Flows

October 9, 2013


- **Pump Station Location:** The PS was moved from the previously identified land parcel as the parcel was determined to be of insufficient size. Additionally, the parcel was located within an area sought after for SWF Pond #5. The new PS site is located west of the SWF Pond #5 and immediately south of Maple Grove Road.
- **Wet Well Elevation:** The elevation was lowered, as requested by City Operations during the functional design TAC meeting, to prevent any backwater impact by the wet well on the incoming sewer. The wet well was lowered by 3.4m.
- **Inlet Flow Monitoring:** Permanent inflow monitoring was included as requested by City Operations during the functional design TAC meeting to track growth in the catchment area and to monitor incoming flows. This will allow for operational modifications (and potential upgrades) as inflows increase.
- **Geotechnical Information:** The preliminary results of the geotechnical investigation found difficult ground and ground water conditions at the PS. Consequently, the opinion of probable cost now includes additional works including rock anchors, piles, watertight shoring (i.e. sheet piling, secant walls, or slurry walls), increased groundwater control systems and unsatisfactory soil disposal. .
- **Wet Well Shape:** A circular wet well is proposed within this preliminary design versus the rectangular shape previously proposed. This is proposed to reduce cost and risk during construction as a result of the poor ground conditions. An analysis between rectangular and circular arrangement will be completed at the detailed design stage.

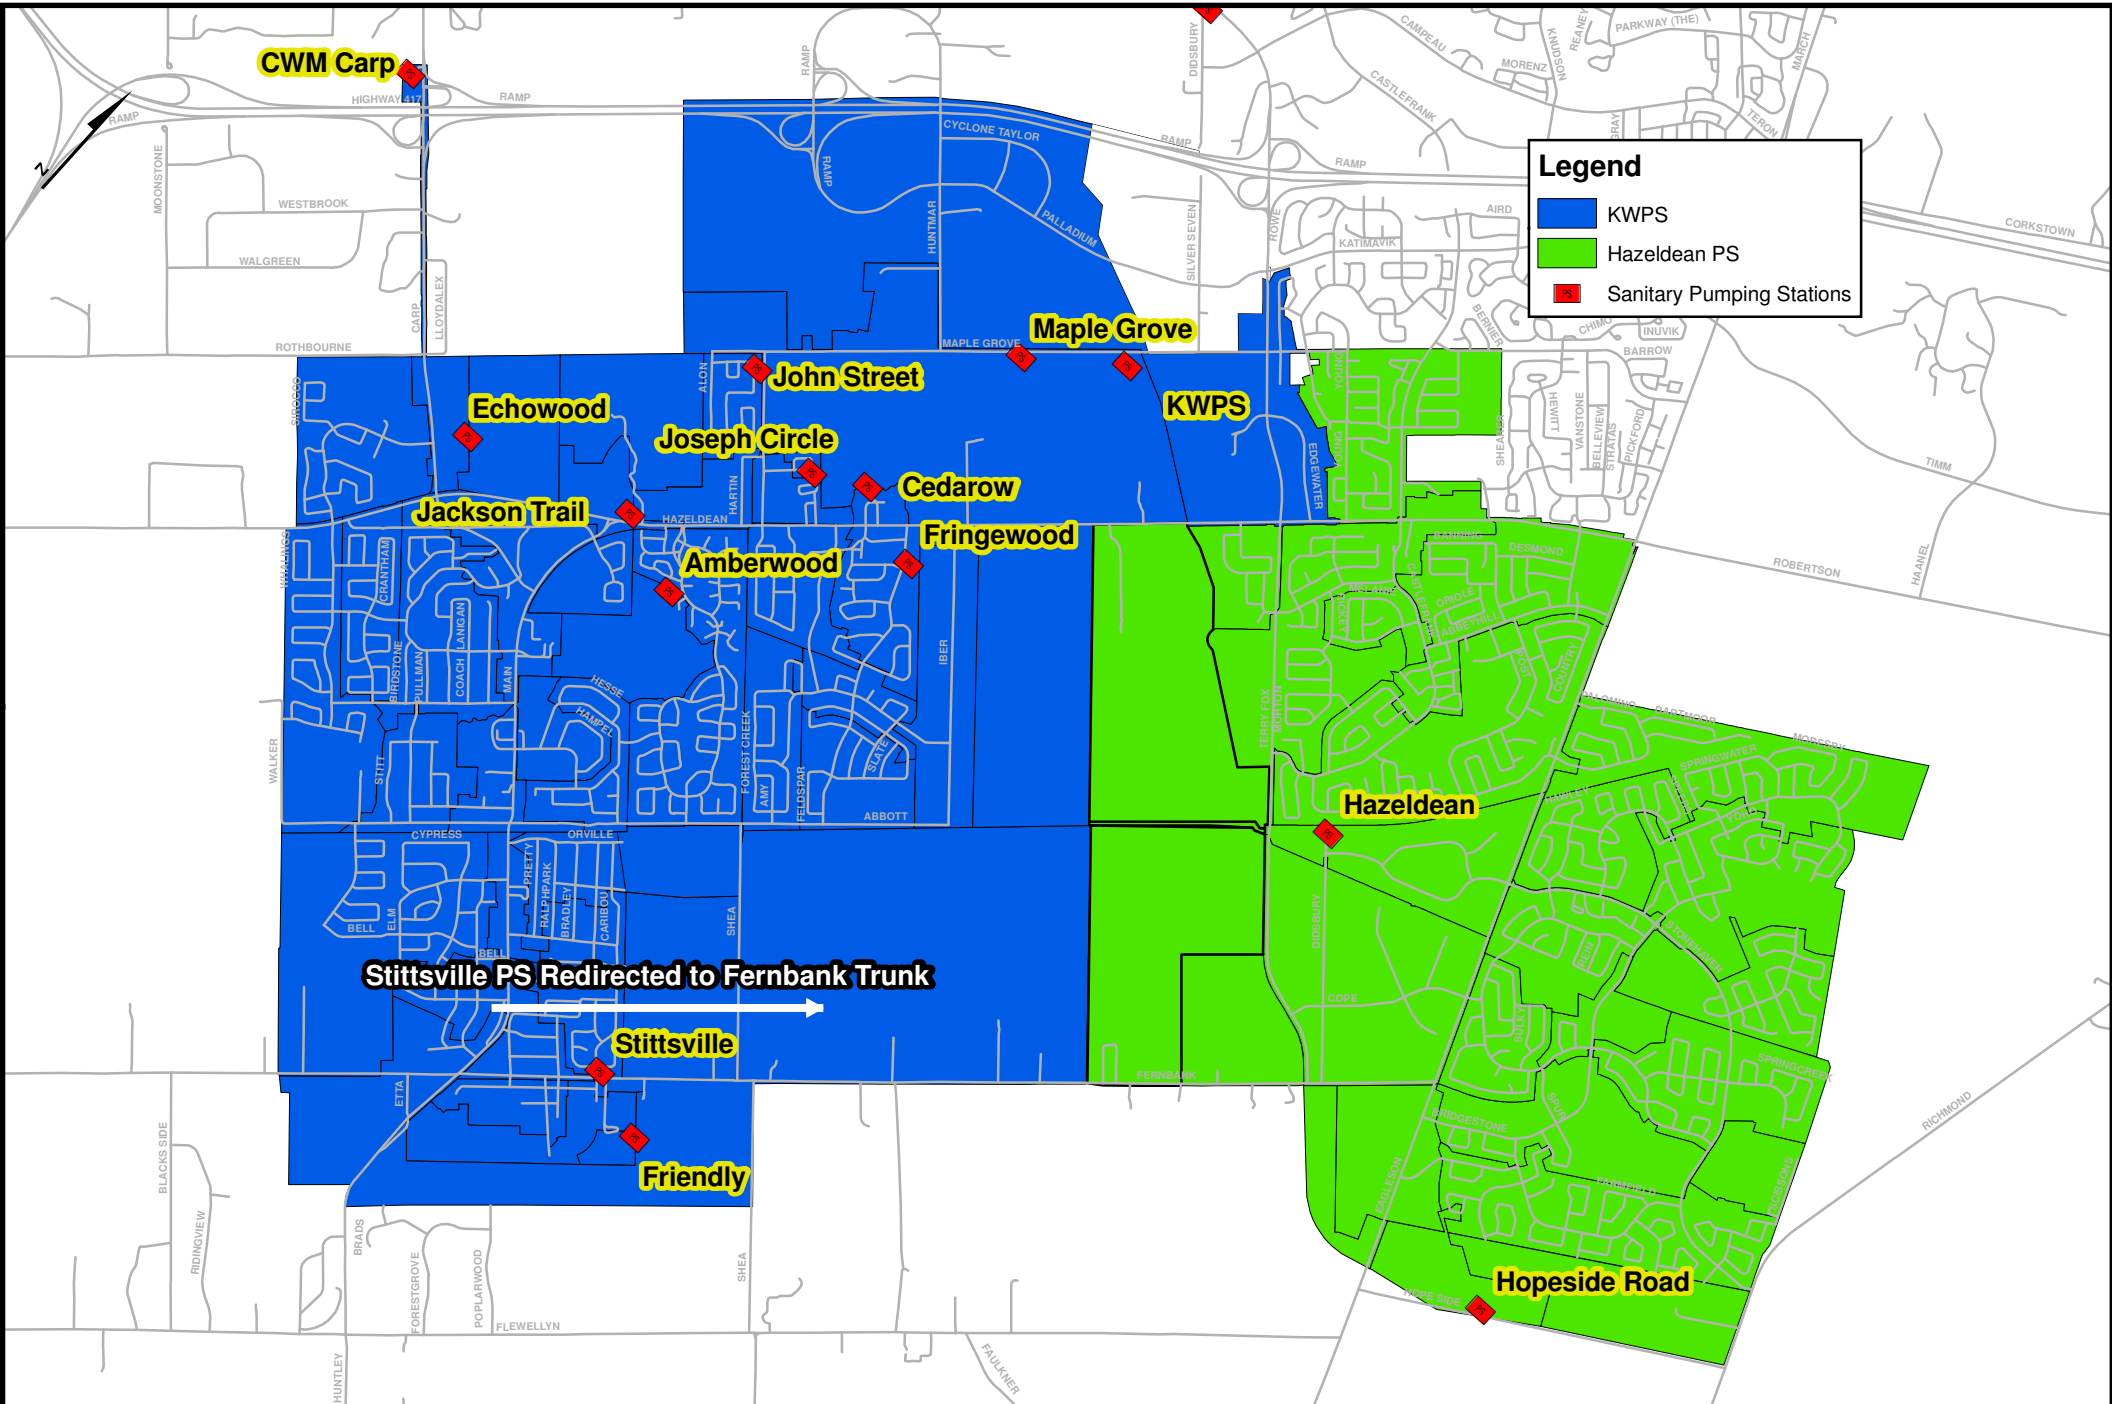

Legend

- KWPS
- Hazeldean PS
- Sanitary Pumping Stations

Stittville PS Redirected to Fernbank Trunk



3.0 Pumping Station and Forcemain Process Design

3.1 DESIGN CONSTRAINTS

The following major design constraints were identified during the preliminary design process:

- The inlet sewer elevation at the MH upstream of the KWPS on Maple Grove (coming from the west) will be E.L 86.78m as set out in the *Kanata West Master Servicing Study Update 2010* (KWMSS);
- The 100 year water level within the adjacent stormwater management pond (Pond #5) is E.L 94.94m as identified in the *KWMSS Update 2010*;
- The pump station and supporting infrastructure must be contained within the allocated property parcel previously agreed to with the Kanata West Owner's Group (KWO) following completion of the Functional Design by Stantec in 2012;
- Emergency overflow must be in place prior to startup of the KWPS as identified in the *KWMSS Update 2010*; and
- The forcemain alignment and depth along Maple Grove Road at the crossing of the Carp River must be designed to accommodate the future Maple Grove road expansion identified in the *Kanata West Transportation Master Plan Update and Amendment* (Delcan, July 2012).

3.2 DESIGN CRITERIA

The following design criteria have been taken into consideration for the preliminary design of the pumping station and associated works:

- Design should comply with requirements of the *City of Ottawa Sewer Design Guidelines and MOE Design Guidelines for Sewage Works (2008)*;
- Equipment and station operation should be as simple as possible to minimize the risk of controller, equipment or Operator error/failure during operation in addition to incorporation of an emergency overflow and redundancy features (i.e. dual forcemains, split wet wells, etc.);
- The design should minimize the impact of construction activities and station operation on the natural heritage features and landscaping;
- The capital and operation/maintenance costs should be minimized while respecting operational and design constraints/criteria;

KANATA WEST PUMPING STATION AND FORCEMAINS

Pumping Station and Forcemain Process Design

October 9, 2013

- The pump station should be able to operate under a wide range of flow conditions as outlined in **Section 2.0** with minimal operator effort required and minimal to no equipment upgrades/construction;
- Minimize the potential for odour production and corrosion as a result of pump station and forcemain operation; and
- The pumping station and site should be designed to blend in with the future surrounding community both functionally and aesthetically.

3.3 INLET SEWER

Inflow to the KWPS will be conveyed by an inlet sewer connecting the sewer along Maple Grove Road to the KWPS. Details regarding the Maple Grove sewer are provided in **Section 4.1**. A 1200mmØ sewer is proposed from a MH on the Maple Grove sewer to the KWPS. The inlet sewer’s elevation is dictated by the proposed elevation of the future 825mmØ SAN sewer along Maple Grove east of the KWPS site. The proposed elevation of the sewer in question is E.L 86.78m as indicated on various drawings provided by the City of Ottawa, correspondence with the City of Ottawa during the preliminary design process, and the *KWMSS*.

The inlet sewer hydraulic details are summarized in **Table 3-1**. Additional details regarding the all KWPS pipe sizing is provided in **Appendix B**.

Table 3-1: Inlet Sewer Details

Sewer Location	Details
Inlet Sewer from SAMH#2 (Maple Grove Road) to KWPS	1200mmØ @ 0.20%
	SAMH#2 Invert E.L 86.78m
	Inlet Chamber Invert E.L 86.64m
	Freeflow Capacity = 1744L/s

Permanent inflow monitoring is proposed on the inlet sewer upstream of the KWPS. The flow monitoring system will be housed within a precast chamber on the inlet sewer within the station property.

3.4 PUMPING STATION TYPE SELECTION

The recommended pump station type, based on the recommendation of the *City of Ottawa Sewer Design Guidelines, Section 7.2.2.2* for a station with flows greater than 450L/s and a wet well depth greater than 12m, is a dry pit/wet well with submersible pumps in the dry pit.

In order to improve the City’s ability to service the pump station once in operation, it is recommended to have two (2) fully separated wet wells. The pump station will be provided with redundant bar screening channels, with one dedicated to each wet well.

4.0 Pumping Station and Forcemain Civil Design

4.1 MAPLE GROVE SEWER

A new sewer is proposed along Maple Grove Road to convey wastewater from the existing Mattamy/Fairwinds pumping station west of Poole Creek to the KWPS. This sewer will intercept and convey flow currently being directed to the Fairwinds PS as well as future flows diverted from the Stittsville/Fernbank diversion sewer.

The proposed sewer will connect to a previously installed SAMH located immediately west of Poole Creek. An 825mmØ sewer is proposed from the existing SAMH, below Poole Creek to a proposed SAMH#1 east of Poole Creek. SAMH#1 is proposed to be equipped with a stub for the future connection of the Stittsville/Fernbank diversion sewer. From SAMH#1 to a proposed SAMH#2 (on Maple Grove Road immediately north of the KWPS), the pipe is proposed to be 1050mmØ in order to convey the additional future flows from the diversion sewer to the KWPS.

SAMH#2 will be the junction point for the new 1050mmØ sewer coming from the west along Maple Grove and the future 825mmØ SAN coming from the east along Maple Grove. . The proposed elevation of the future 825mmØ SAN is E.L 86.78m at SAMH#2. As such an external drop is proposed on the west side of SAMH#2 for the 1050mmØ sewer.

Based on discussions with a local Contractor, when the 825mmØ was installed on Maple Grove from Fairwinds PS to Poole Creek, the Contractor encountered very poor soil conditions. The soil/groundwater conditions were such that the Contractor ultimately had to install pre-stressed concrete cylinder pipe (PCCP) versus standard reinforced concrete sewer pipe to resist buckling at the joints and uplift during trench installation. Therefore at this preliminary design stage, it is proposed to use similar pipe.

4.1.1 Poole Creek Crossing

In order to cross below Poole Creek, a 70m trenchless installation is proposed. The most suitable trenchless method for the sewer installation will be dependent on the results of the geotechnical investigation currently being completed for this area.

4.2 PUMP STATION

4.2.1 Site Grading

The pumping station will be located immediately west of the future SWF Pond #5 on Maple Grove Rd.

The top of the wet wells and buildings are proposed to be located a minimum of 1.2m above the 100 year flood (E.L 94.94m within Pond #5 as identified in the *KWMSS Update 2010*).

One Team. Infinite Solutions.

10.0 Approvals and Permitting

10.1 MINISTRY OF THE ENVIRONMENT

10.1.1 Environmental Compliance Approval

An Environmental Compliance Approval (ECA) will be required for the new KWPS (Sewage and Air/Noise) and for the new Maple Grove Sewer (Sewage). The following stages are proposed with respect to obtaining an Environmental Compliance Approval (ECA) for the new KWPS:

- A pre-consultation meeting with the regional MOE office will be held following completion of the preliminary design.
- During the 90% detailed design stage, the ECA application(s) will be submitted and will confirm the final scope of works.

10.1.2 Permit to Take Water (PTTW)

It is anticipated that a PTTW (or potentially multiple PTTWs) will be required for construction of the KWPS, Maple Grove sewer and forcemains. PTTW applications will be completed, following the City's requirements, during the 90% design stage and submitted on behalf of the City of Ottawa. The MOE will issue a draft PTTW(s) in the name of the City, which will be transferred to the Contractor(s) upon commencement of construction.

10.2 MISSISSIPPI VALLEY CONSERVATION AUTHORITY (MVCA) REQUIREMENTS AND APPROVALS

A pre-consultation meeting will be held with the MVCA following completion of the preliminary design to determine the necessary approvals and installation methods for the Poole Creek, Carp River and Watts Creek crossings.

10.3 SITE PLAN CONTROL AND BUILDING PERMIT

A Building Permit will be required since this is a new structure. Coordination with the City of Ottawa and submission of the Building Permit application will be completed during the detailed design stage.

Site Plan Approval would typically be required where the new works includes construction of a new building structure greater than 200m² and construction of a new paved parking area. In the case of the KWPS, it will likely be exempt as it is a City project, however following completion of the preliminary design, the City Site Plan Approvals group will be contacted to confirm. During the 90% detailed design stage, a pre-consultation meeting will be held with City of Ottawa staff to ensure that the proposed design conforms to the Site Plan Approval requirements, even if exempt.

APPENDIX D

Stormwater Management

Stormwater - Proposed Development
City of Ottawa Sewer Design Guidelines, 2012



Target Flow Rate

Area 6.73 ha
C 0.60 Rational Method runoff coefficient
 t_c 15.0 min

5-year
 i 83.6 mm/hr
Q 937.2 L/s

Estimated Post Development Peak Flow from Unattenuated Areas

Total Area 0.67 ha
C 0.65 Rational Method runoff coefficient

t _c (min)	5-year					100-year				
	i (mm/hr)	Q _{actual} (L/s)	Q _{release} (L/s)	Q _{stored} (L/s)	V _{stored} (m ³)	i (mm/hr)	Q _{actual} (L/s)	Q _{release} (L/s)	Q _{stored} (L/s)	V _{stored} (m ³)
10.0	104.2	126.6	126.6	0.0	0.0	178.6	271.2	271.2	0.0	0.0

Note:

C value for the 100-year storm is increased by 25%, to a maximum of 1.0 per Ottawa Sewer Design Guidelines (5.4.5.2.1)

Estimated Post Development Peak Flow from Attenuated Areas

Total Area 6.06 ha
C 0.65 Rational Method runoff coefficient

t _c (min)	5-year					100-year				
	i (mm/hr)	Q _{actual} (L/s)	Q _{release} (L/s)	Q _{stored} (L/s)	V _{stored} (m ³)	i (mm/hr)	Q _{actual} (L/s)	Q _{release} (L/s)	Q _{stored} (L/s)	V _{stored} (m ³)
10	104.2	1139.5	310.9	828.6	497.1	178.6	2441.0	666.0	1774.9	1065.0
15	83.6	913.8	311.6	602.2	542.0	142.9	1953.4	666.0	1287.4	1158.7
20	70.3	768.3	312.1	456.2	547.5	120.0	1639.8	666.0	973.7	1168.5
25	60.9	666.0	312.4	353.5	530.3	103.8	1419.6	666.0	753.6	1130.4
30	53.9	589.8	312.8	277.0	498.6	91.9	1255.9	666.0	589.9	1061.7
35	48.5	530.6	313.0	217.6	456.9	82.6	1128.9	666.0	462.9	972.0
40	44.2	483.2	313.3	169.9	407.8	75.1	1027.3	666.0	361.2	867.0
45	40.6	444.3	313.5	130.8	353.2	69.1	943.9	666.0	277.9	750.4
50	37.7	411.8	313.7	98.1	294.3	64.0	874.3	666.0	208.3	624.8
55	35.1	384.1	313.9	70.2	231.8	59.6	815.1	666.0	149.1	491.9
60	32.9	360.3	314.0	46.2	166.5	55.9	764.1	666.0	98.1	353.1
65	31.0	339.5	314.2	25.3	98.8	52.6	719.7	666.0	53.7	209.3
70	29.4	321.2	314.3	6.9	29.0	49.8	680.6	666.0	14.6	61.4
75	27.9	305.0	314.4	0.0	0.0	47.3	646.0	666.0	0.0	0.0
80	26.6	290.5	314.6	0.0	0.0	45.0	615.0	666.0	0.0	0.0
85	25.4	277.4	314.7	0.0	0.0	43.0	587.2	666.0	0.0	0.0
90	24.3	265.6	314.8	0.0	0.0	41.1	562.0	666.0	0.0	0.0
95	23.3	254.9	314.9	0.0	0.0	39.4	539.1	666.0	0.0	0.0
100	22.4	245.0	315.0	0.0	0.0	37.9	518.1	666.0	0.0	0.0
105	21.6	236.0	315.1	0.0	0.0	36.5	498.9	666.0	0.0	0.0
110	20.8	227.7	315.2	0.0	0.0	35.2	481.2	666.0	0.0	0.0

Note:

C value for the 100-year storm is increased by 25%, to a maximum of 1.0 per Ottawa Sewer Design Guidelines (5.4.5.2.1)

5-year Q_{attenuated}	312.05 L/s	100-year Q_{attenuated}	666.02 L/s
5-year Max. Storage Required	547.5 m³	100-year Max. Storage Required	1168.5 m³


Summary of Release Rates and Storage Volumes

Control Area	5-Year Release Rate (L/s)	5-Year Storage (m ³)	100-Year Release Rate (L/s)	100-Year Storage (m ³)
Unattenuated Areas	127	0	271	0
Attenuated Areas	312	547	666	1168
Total	439	547	937	1168

Area ID	Area (ha)	C (-)	Indiv AxC	Acc AxC	T _c (min)	I (mm/hr)	Q (L/s)	Sewer Data								
								DIA (mm)	Slope (%)	Length (m)	A _{hydraulic} (m ²)	R (m)	Velocity (m/s)	Qcap (L/s)	Time Flow (min)	Q / Q full (-)
A1	2.020	0.65	1.31	1.31	10.0	104.2	380.0	675	0.25	146	0.358	0.169	1.17	420.3	2.1	0.90
A2	0.178	0.65	0.12	1.43	12.1	94.4	374.6	675	0.25	56	0.358	0.169	1.17	420.3	0.8	0.89
					12.9											
A3	2.405	0.65	1.56	1.56	10.0	104.2	452.3	750	0.20	138	0.442	0.188	1.13	497.9	2.0	0.91
A4	0.128	0.65	0.08	1.65	12.0	94.5	432.2	750	0.20	11	0.442	0.188	1.13	497.9	0.2	0.87
A5	0.071	0.65	0.05	1.69	12.2	93.8	441.1	750	0.20	22.5	0.442	0.188	1.13	497.9	0.3	0.89
A6	0.112	0.65	0.07	1.76	12.5	92.5	453.3	750	0.20	40	0.442	0.188	1.13	497.9	0.6	0.91
					13.1											
A7	0.860	0.65	0.56	3.75	13.1	90.1	939.6	900	0.30	101	0.636	0.225	1.56	991.5	1.1	0.95
					14.2											
A8	0.444	0.65	0.29	0.29	10.0	104.2	83.5	375	0.25	101	0.110	0.094	0.79	87.7	2.1	0.95
			0.00	0.29	12.1	94.2	75.5	375	0.25	40	0.110	0.094	0.79	87.7	0.8	0.86
					13.0											
A9	0.460	0.65	0.30	4.34	14.2	86.2	1039.3	900	0.40	36	0.636	0.225	1.80	1144.9	0.3	0.91
					14.5											

Storage Drainage Major System (ST-MJ)

Kanata West Master Servicing Study




Stantec Consulting Ltd.
1505 Laperriere Avenue
Ottawa ON Canada
K1Z 7T1
Tel. 613.722.4420
Fax. 613.722.2799
www.stantec.com

Stantec

Copyright Reserved
The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec Consulting Ltd. without delay.
The Copyrights to all designs and drawings are the property of Stantec Consulting Ltd. Reproduction or use for other than that authorized by Stantec Consulting Ltd. is forbidden.

Legend

	KANATA-WEST CONCEPT PLAN BOUNDARY
	POND DRAINAGE BOUNDARY
	STORM SEWER DRAINAGE LIMIT
	OVERLAND FLOW DIRECTION
	OVERLAND FLOW SEGMENT NUMBER

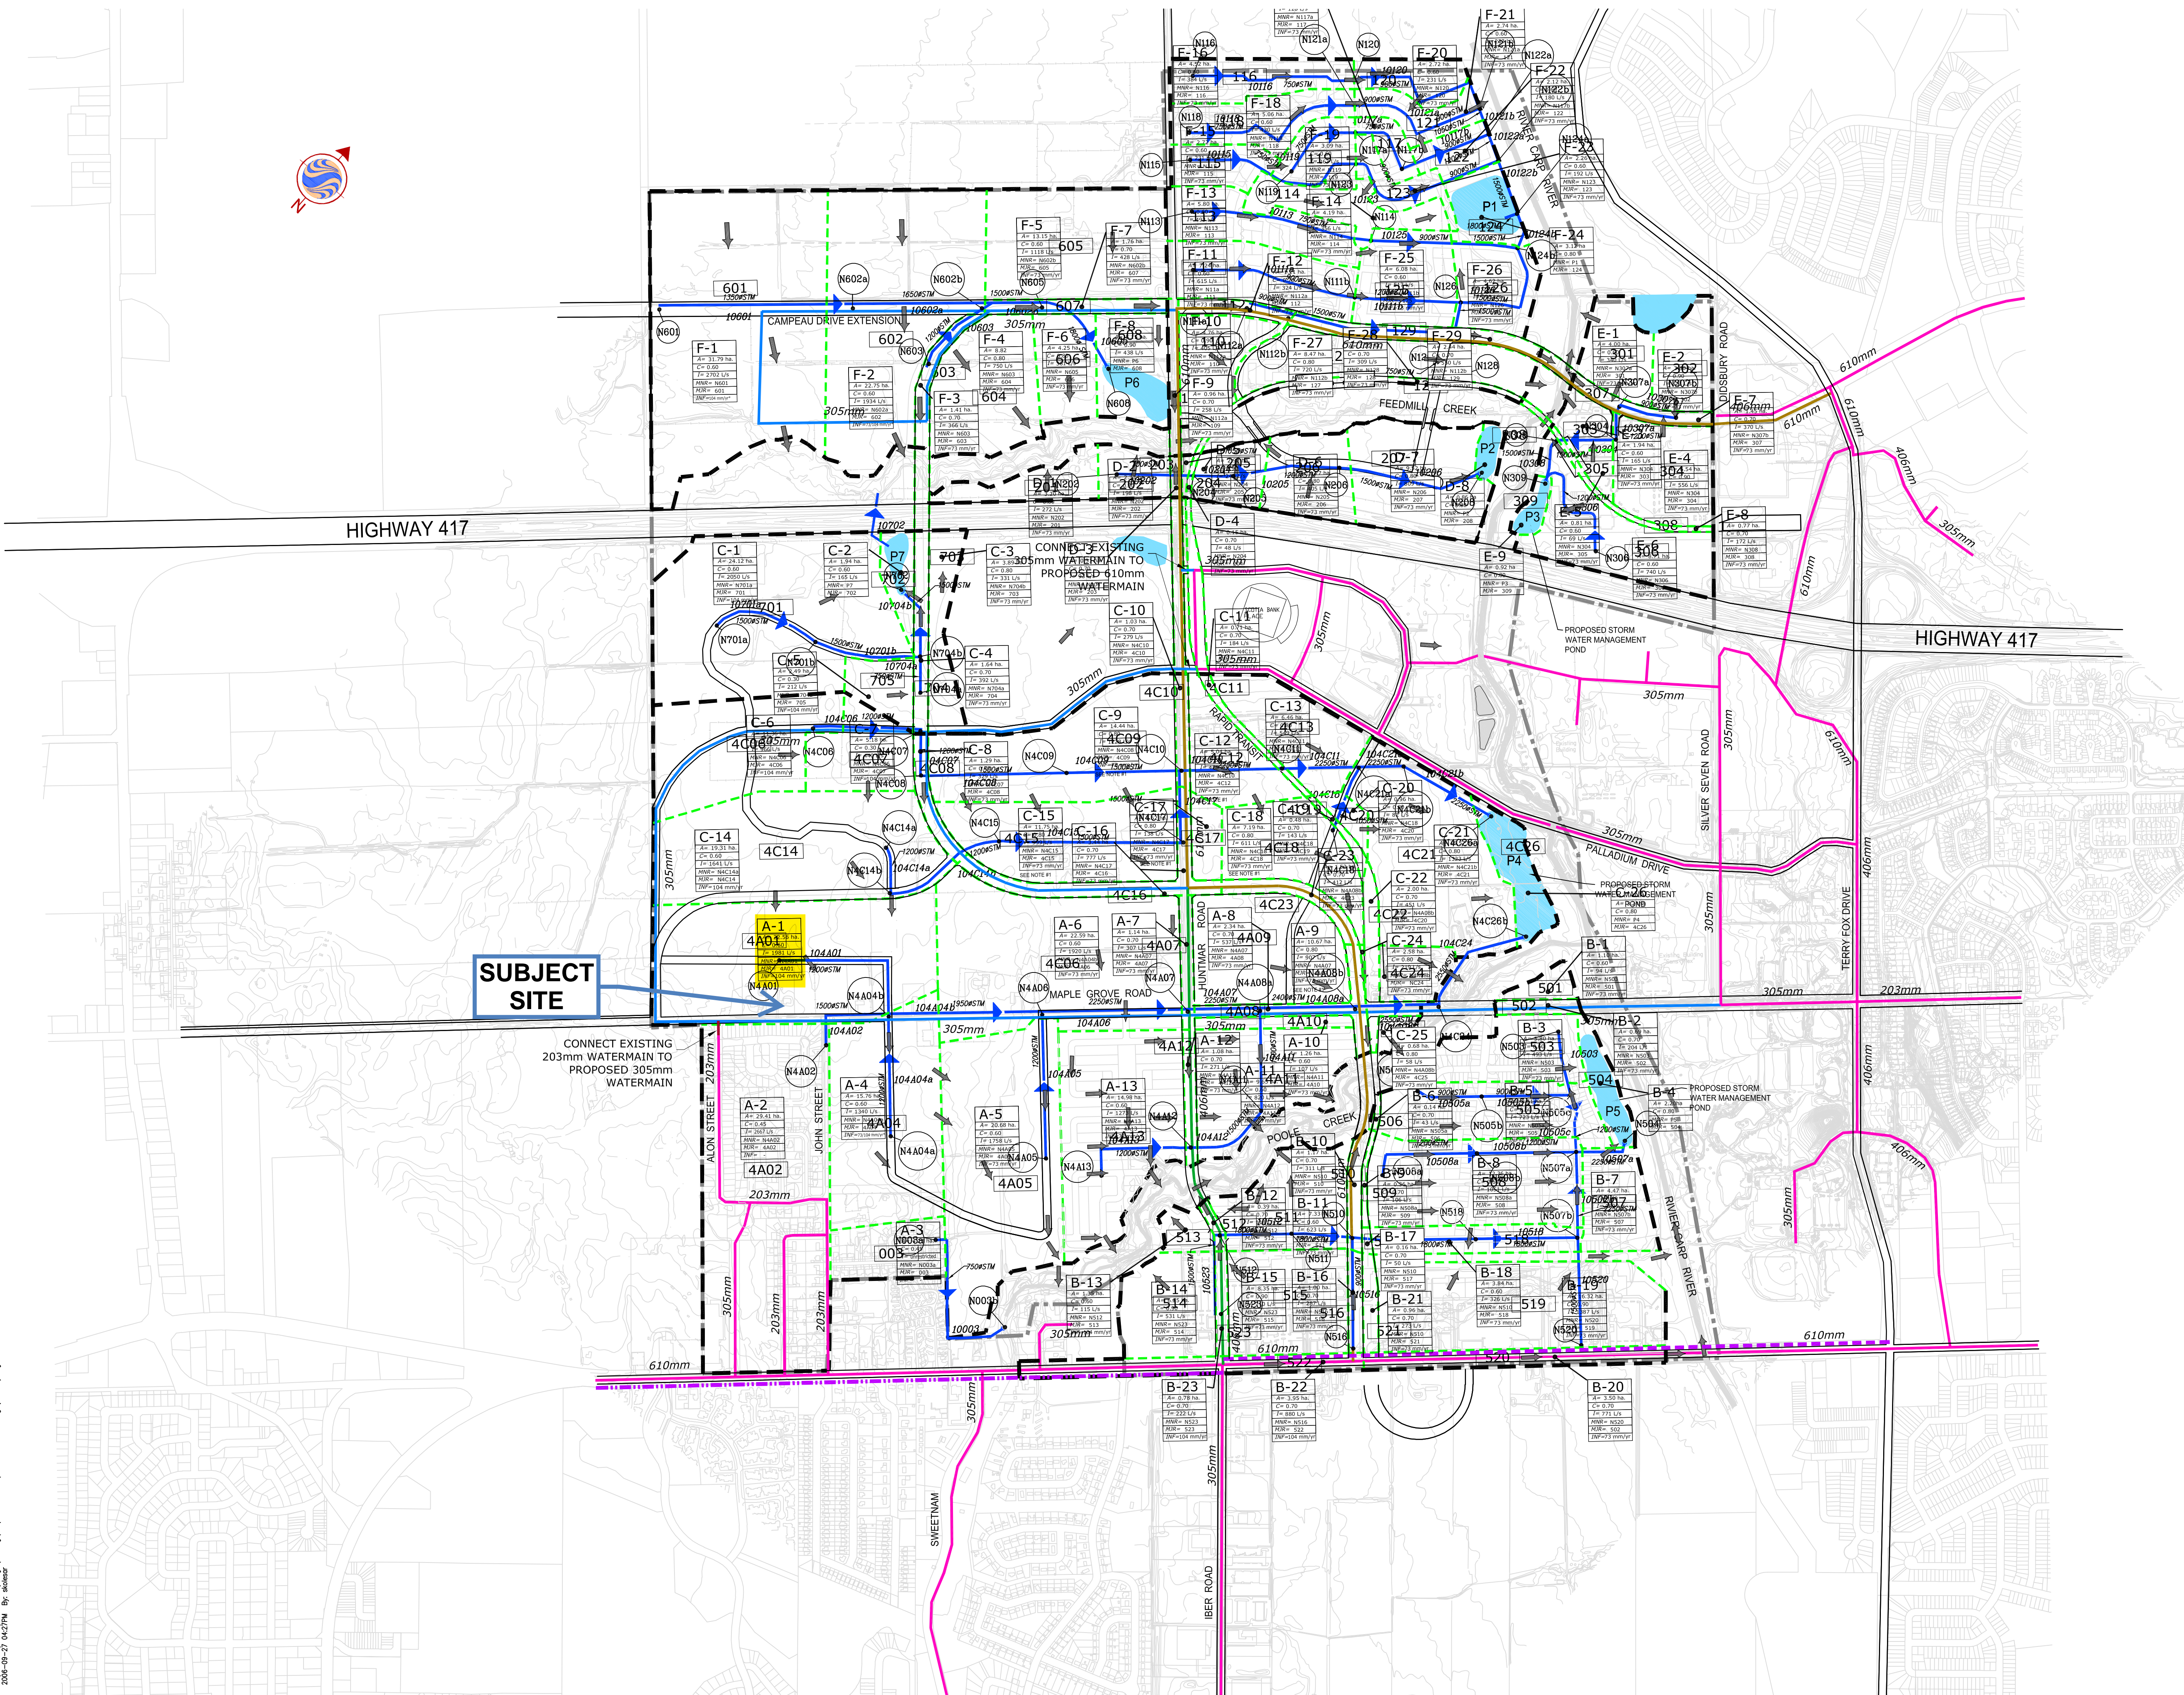

2	REVISED FOR DEC.21/05 SUBMISSION	GBU	SJP	DEC.21/05
1	REVISED AS PER CITY COMMENTS (Sept.16/05)	GBU	MAF	OCT.28/05
Revision		By	Appd.	Date
File Name: 160400406		LTM	MAF	MAF
		Dwn.	Chkd.	Dsgn.
Seals				

Client/Project
**Kanata West Concept Plan
Master Servicing Study**

Ottawa, Ontario



Title
**MODEL SCHEMATIC
STORM DRAINAGE MAJOR SYSTEM**

Project No. 60400406	Scale 0 75 225 375m 1:7500
Drawing No. ST-MJ	Sheet 5 of 7
	Revision 2

X:\01-404\0406\Design\Working\03_2006-09-27\160400406-Servicing (Final).dwg
 2006-09-27 16:27:46 By: [unreadable]

***Storm Drainage Plan
Kanata West Pond 4***

David Schaeffer Engineering Ltd.

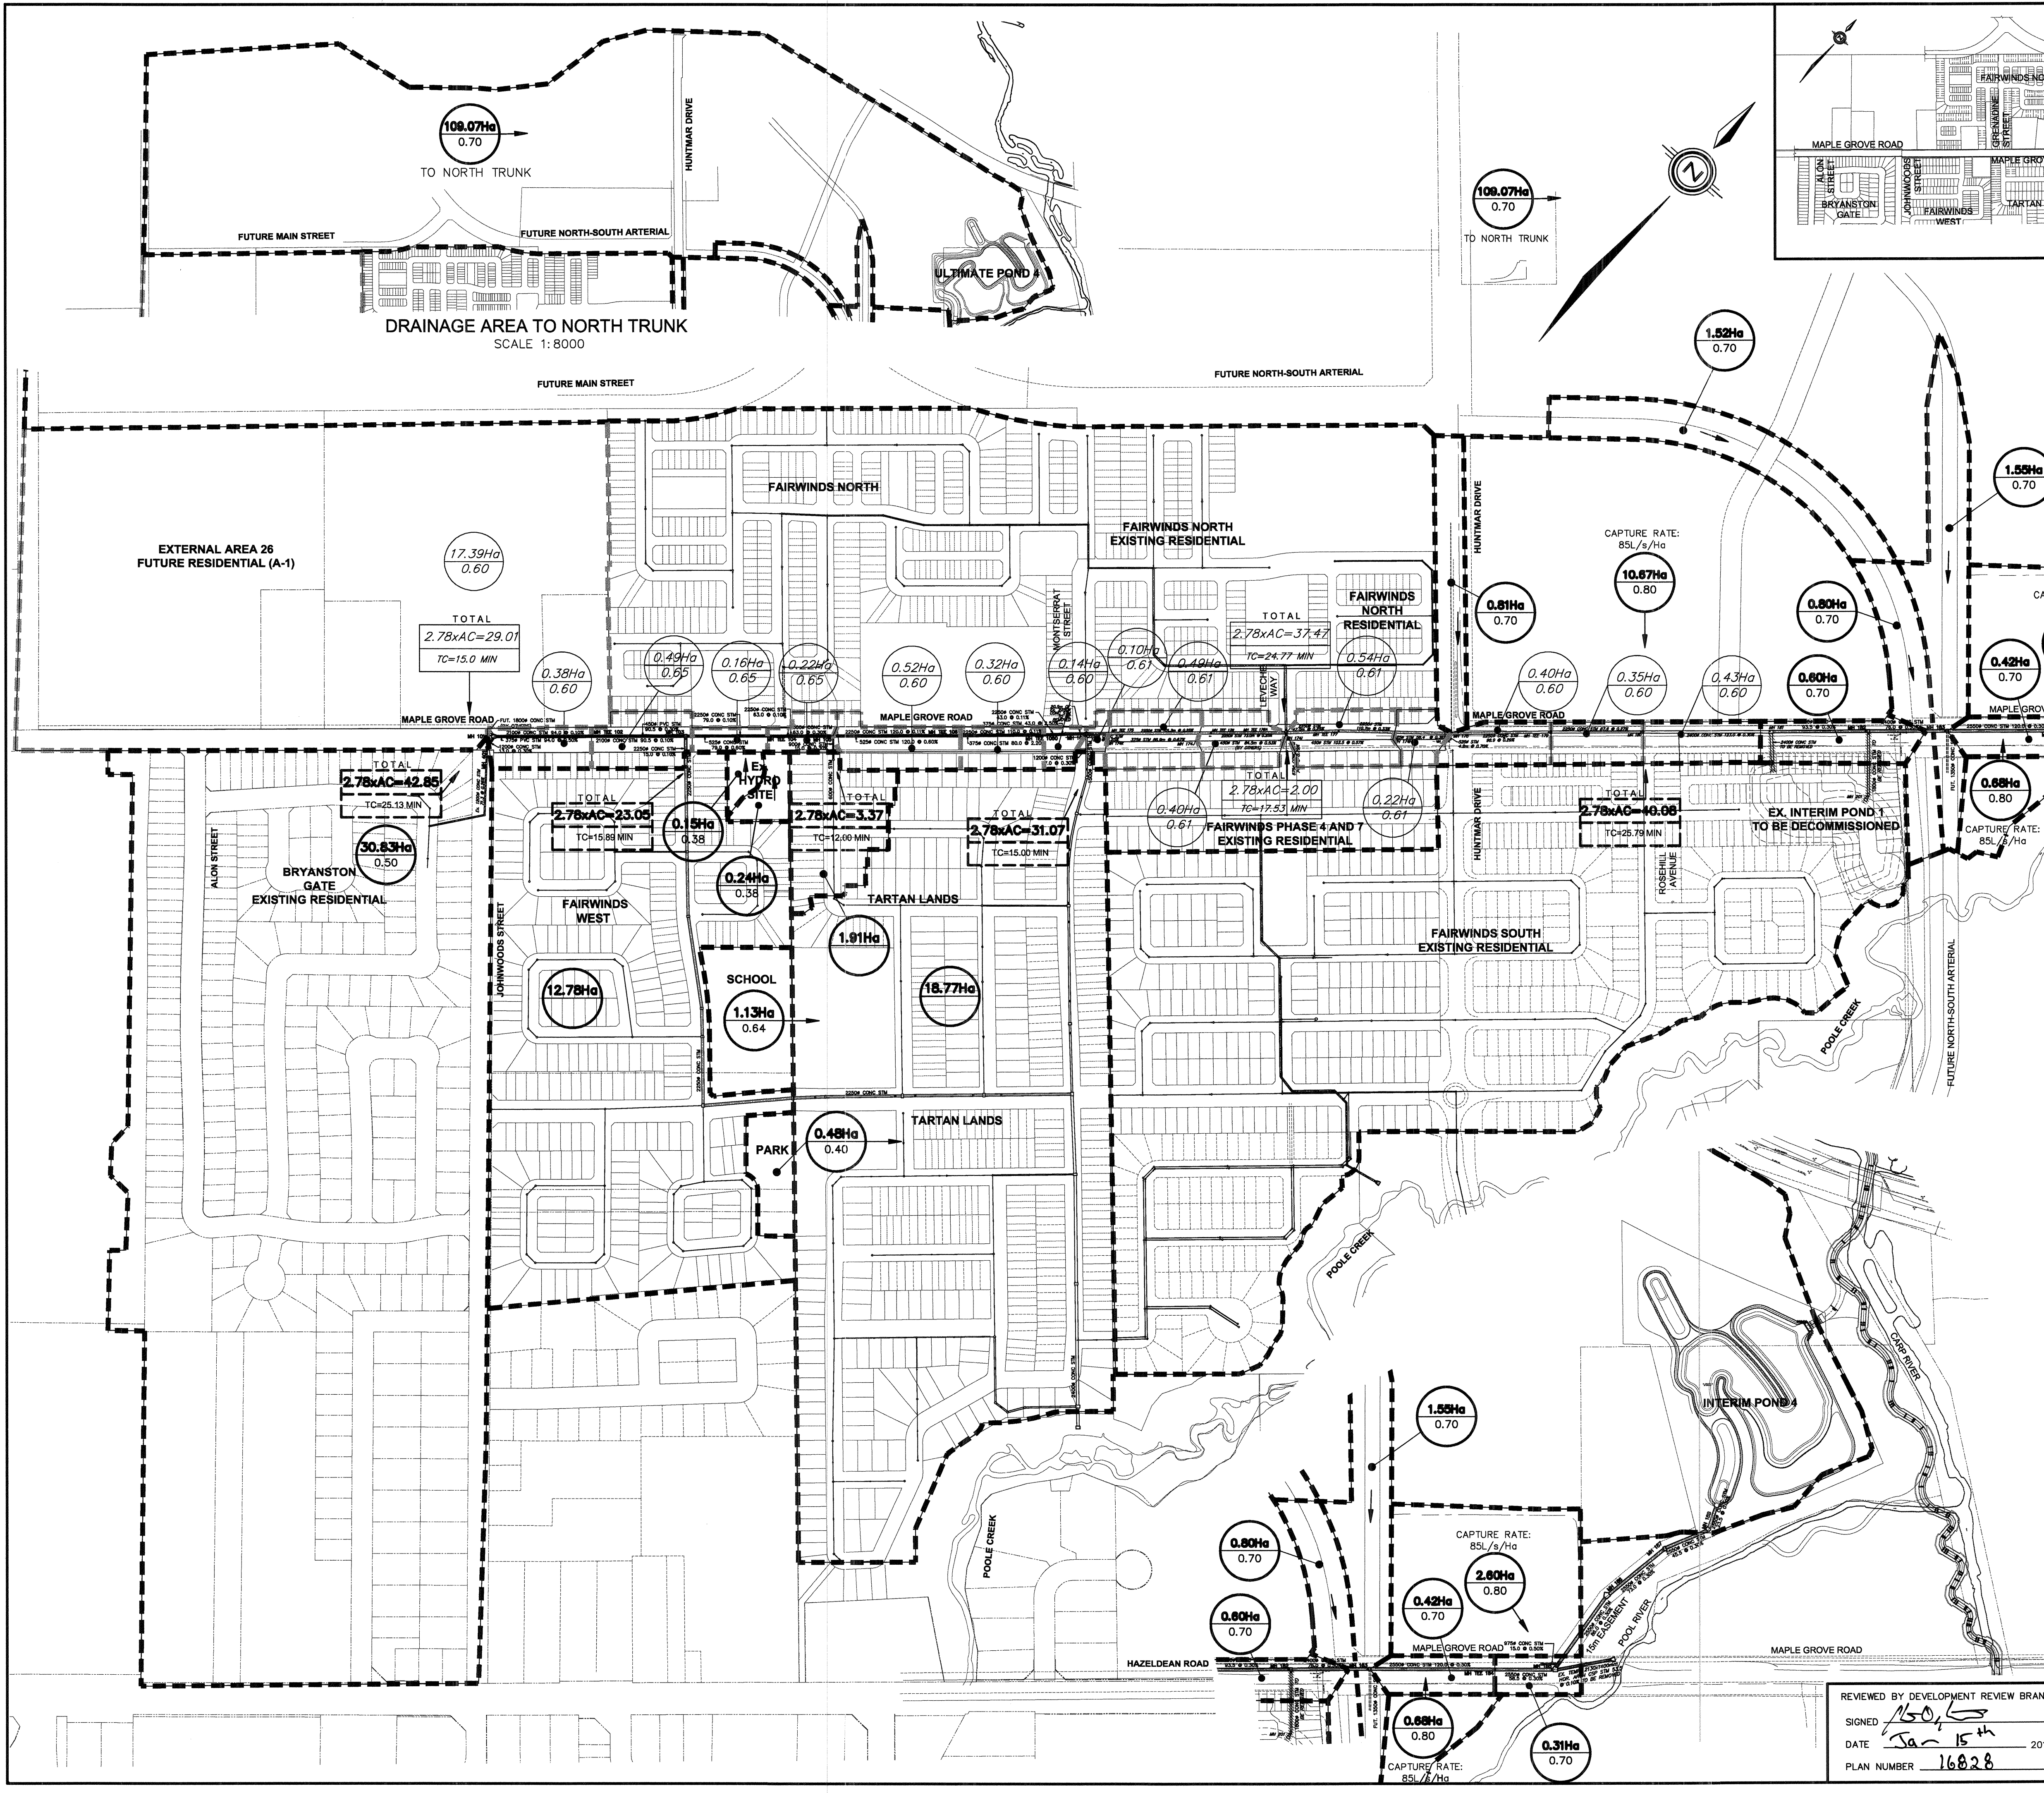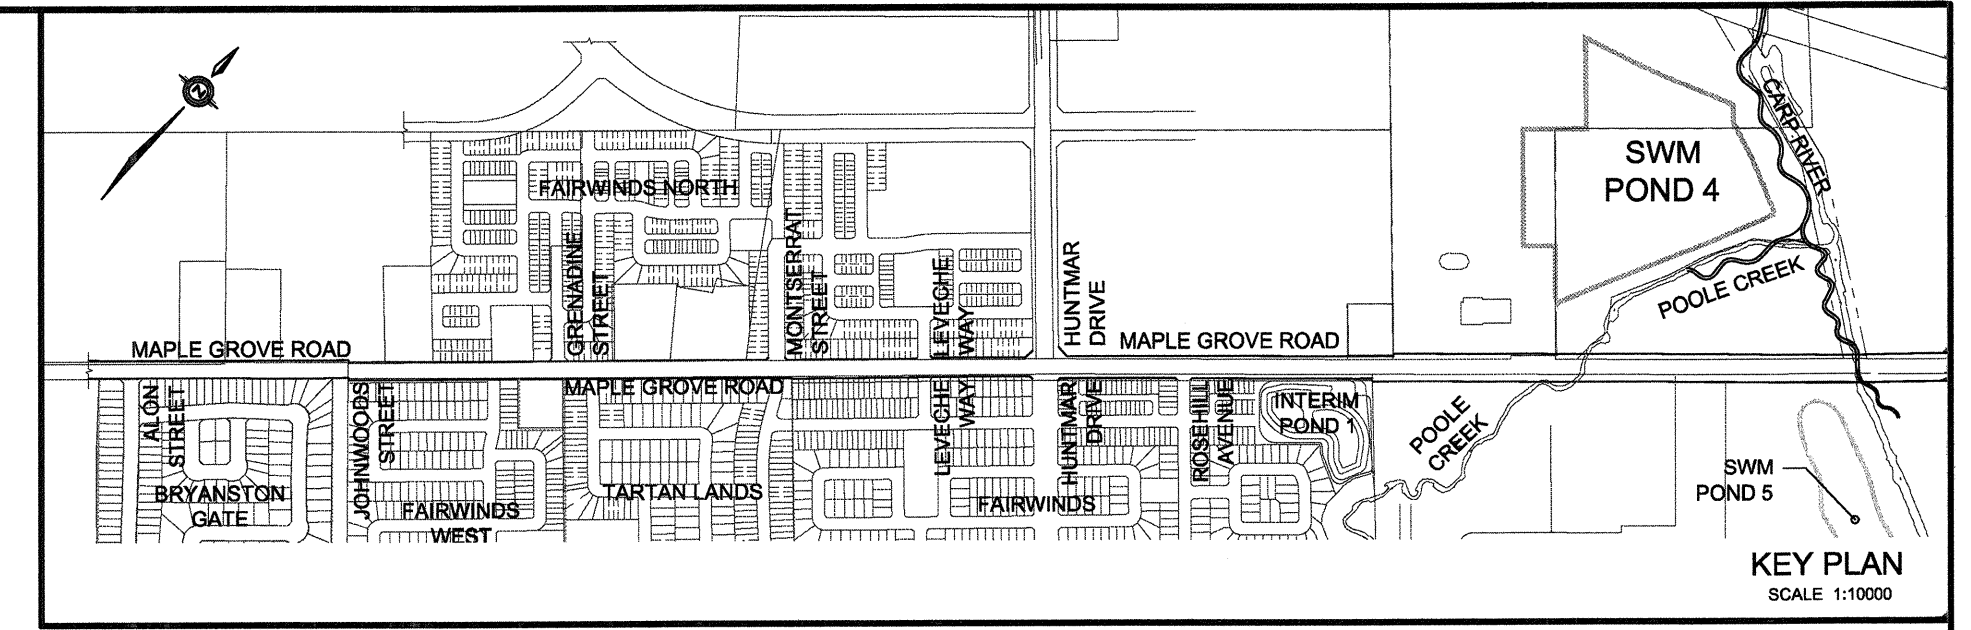

LEGEND

- DRAINAGE AREA IN HECTARES RUN-OFF COEFFICIENT (UPDATED AND NEW)
- DRAINAGE AREA IN HECTARES (APPROVED FROM RECONSTRUCTION OF MAPLE GROVE ROAD, PROJECT# 10-451) RUN-OFF COEFFICIENT
- STORM SEWER TRIBUTARY BOUNDARY
- STORM SEWER TRIBUTARY BOUNDARY (APPROVED FROM RECONSTRUCTION OF MAPLE GROVE ROAD, PROJECT# 10-451)


TOPOGRAPHIC INFORMATION
 TOPOGRAPHIC INFORMATION PROVIDED BY AECOM, RECEIVED ON JANUARY 29, 2013.

LEGAL INFORMATION
 CALCULATED DRAFT PLAN PROVIDED BY J.D. BARNES LIMITED, PROJECT No. 05-10-439-05, DATED FEBRUARY 19, 2013.

BENCH MARK No. 0011988U502
 TOWNSHIP: STITTSVILLE
 CONCRETE CULVERT ALONG HAZELDEAN ROAD, 1.3 KM NE OF ROAD INTERSECTION WITH MAIN ST NORTH. BRASS CAP SET ON TOP OF CONC CULVERT, SOUTH SIDE OF THE ROAD, 30 CM WEST OF EASTERLY EXTREMITY, 30 CM NORTH OF THE SOUTH FACE, SLIGHTLY BELOW ROAD LEVEL.
 ELEVATION = 108.659 m

No.	BY	DATE	DESCRIPTION	BY
7	Z.L.	14-12-15	REVISED AS PER FLUVIAL DESIGN	
6	Z.L.	14-11-14	REVISED AS PER CITY'S COMMENTS	
5	Z.L.	14-09-24	REVISED AS PER CITY'S COMMENTS	
4	Z.L.	14-08-20	3rd SUBMISSION	
3	Z.L.	14-06-04	2nd SUBMISSION	
2	Z.L.	14-03-05	1st RE-SUBMISSION	
1	Z.L.	13-08-09	1st SUBMISSION	

Ottawa CITY OF OTTAWA

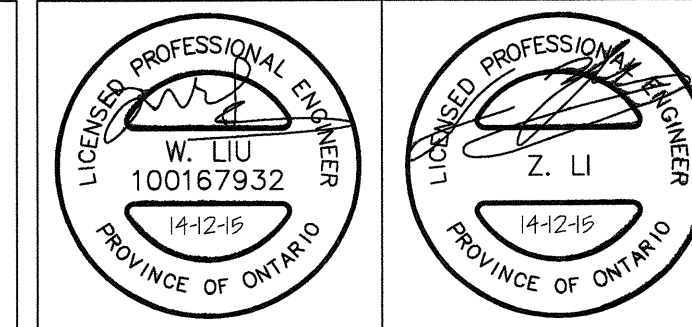

PROJECT No. 12-644

STORM DRAINAGE PLAN © DSEL

mattamy HOMES

POND 4 KANATA WEST

DSEL
 david schaeffer engineering ltd

120 Iker Road, Unit 203
 Stittsville, ON K2S 1E9
 Tel: (613) 836-0886
 Fax: (613) 836-7103
 www.DSEL.ca


DRAWN BY: W.L./V.	CHECKED BY: K.M.	DRAWING NO.	SHEET NO.
DESIGNED BY: K.M.	CHECKED BY: Z.L.		2C
SCALE: 1:3000	DATE: MAY 2013		

REVIEWED BY DEVELOPMENT REVIEW BRANCH

SIGNED:

DATE: Jan 15th 2015

PLAN NUMBER: 16828

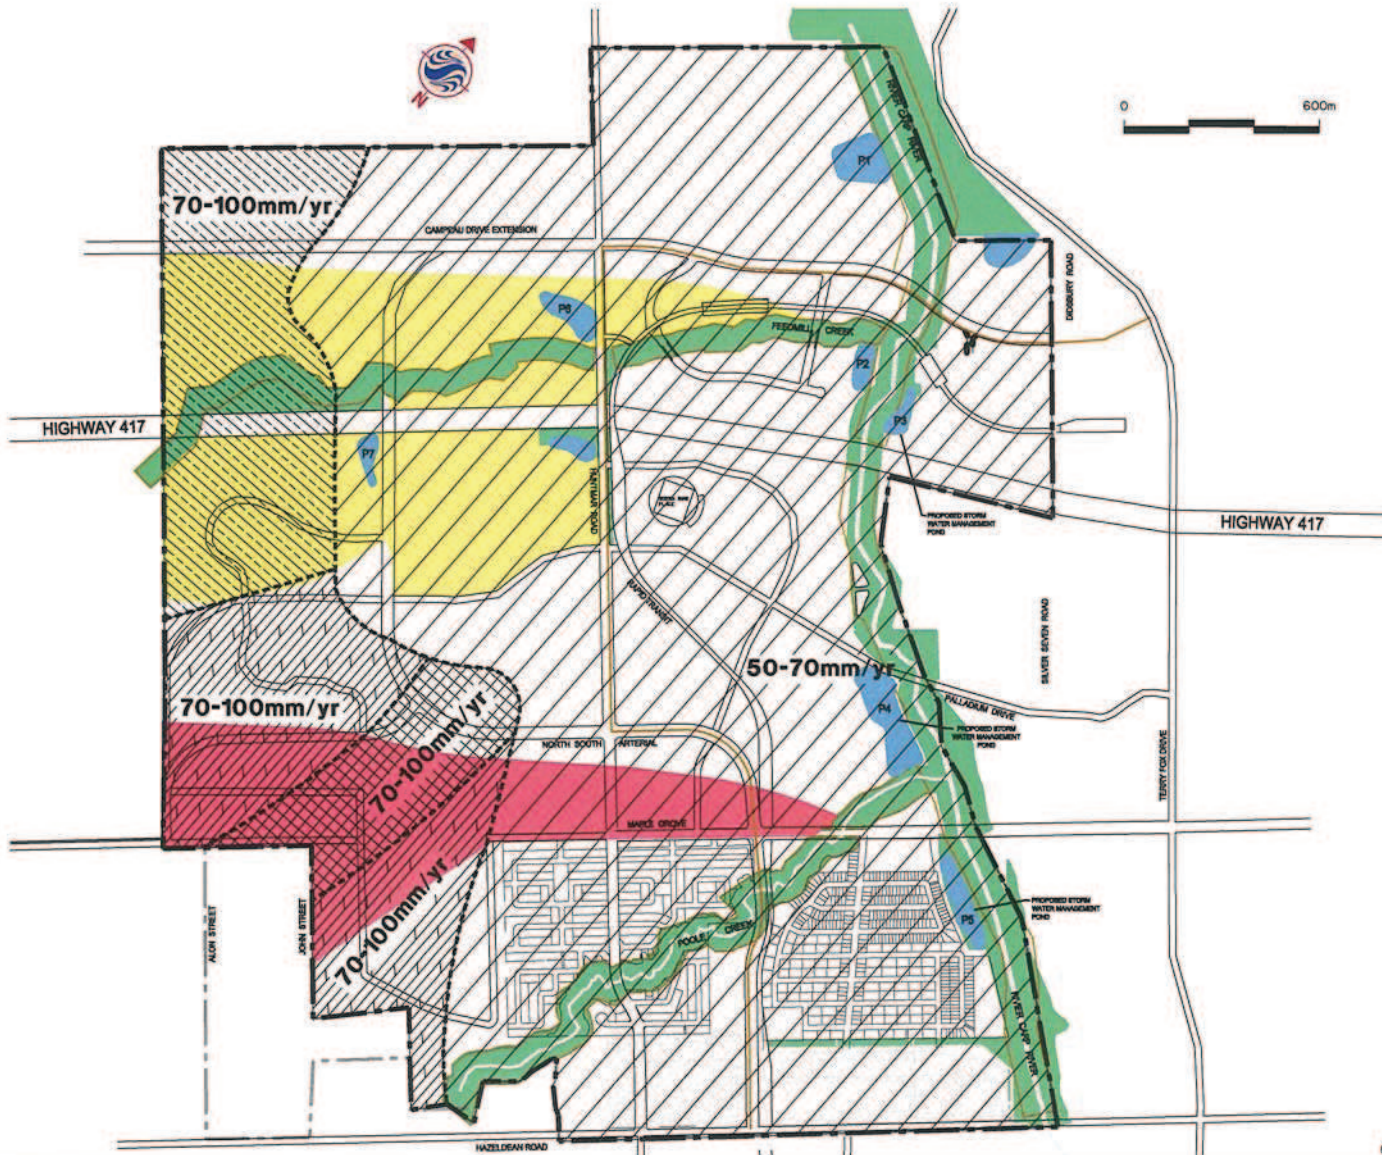

INFILTRATION TARGETS

SOIL TYPE	RECHARGE	
	FINE SAND	MODERATE
	PALEOZOIC BEDROCK	MODERATE
	TILL	MODERATE
	CLAY	LOW

- Kanata-West Concept Plan Boundary
- Area Tributary To Feedmill Creek (Existing Conditions)
- Area Tributary To Maple Grove Ditch System and Poole Creek (Existing Conditions)
- OPEN SPACE

NOTE:
 SOIL TYPES AND RECHARGE POTENTIAL FROM CARP RIVER WATERSHED/SUBWATERSHED STUDY BY ROBINSON CONSULTANTS INC. 2004.
 TARGET INFILTRATION RATES OBTAINED FROM ENVIRONMENTAL FACT SHEETS FROM 2004 REPORT.



CCCL/IBI
 CONSULTANTS LIMITED

MAY 2006

60400405

FIG. 5.4

DRAWINGS / FIGURES


Site Population Estimate







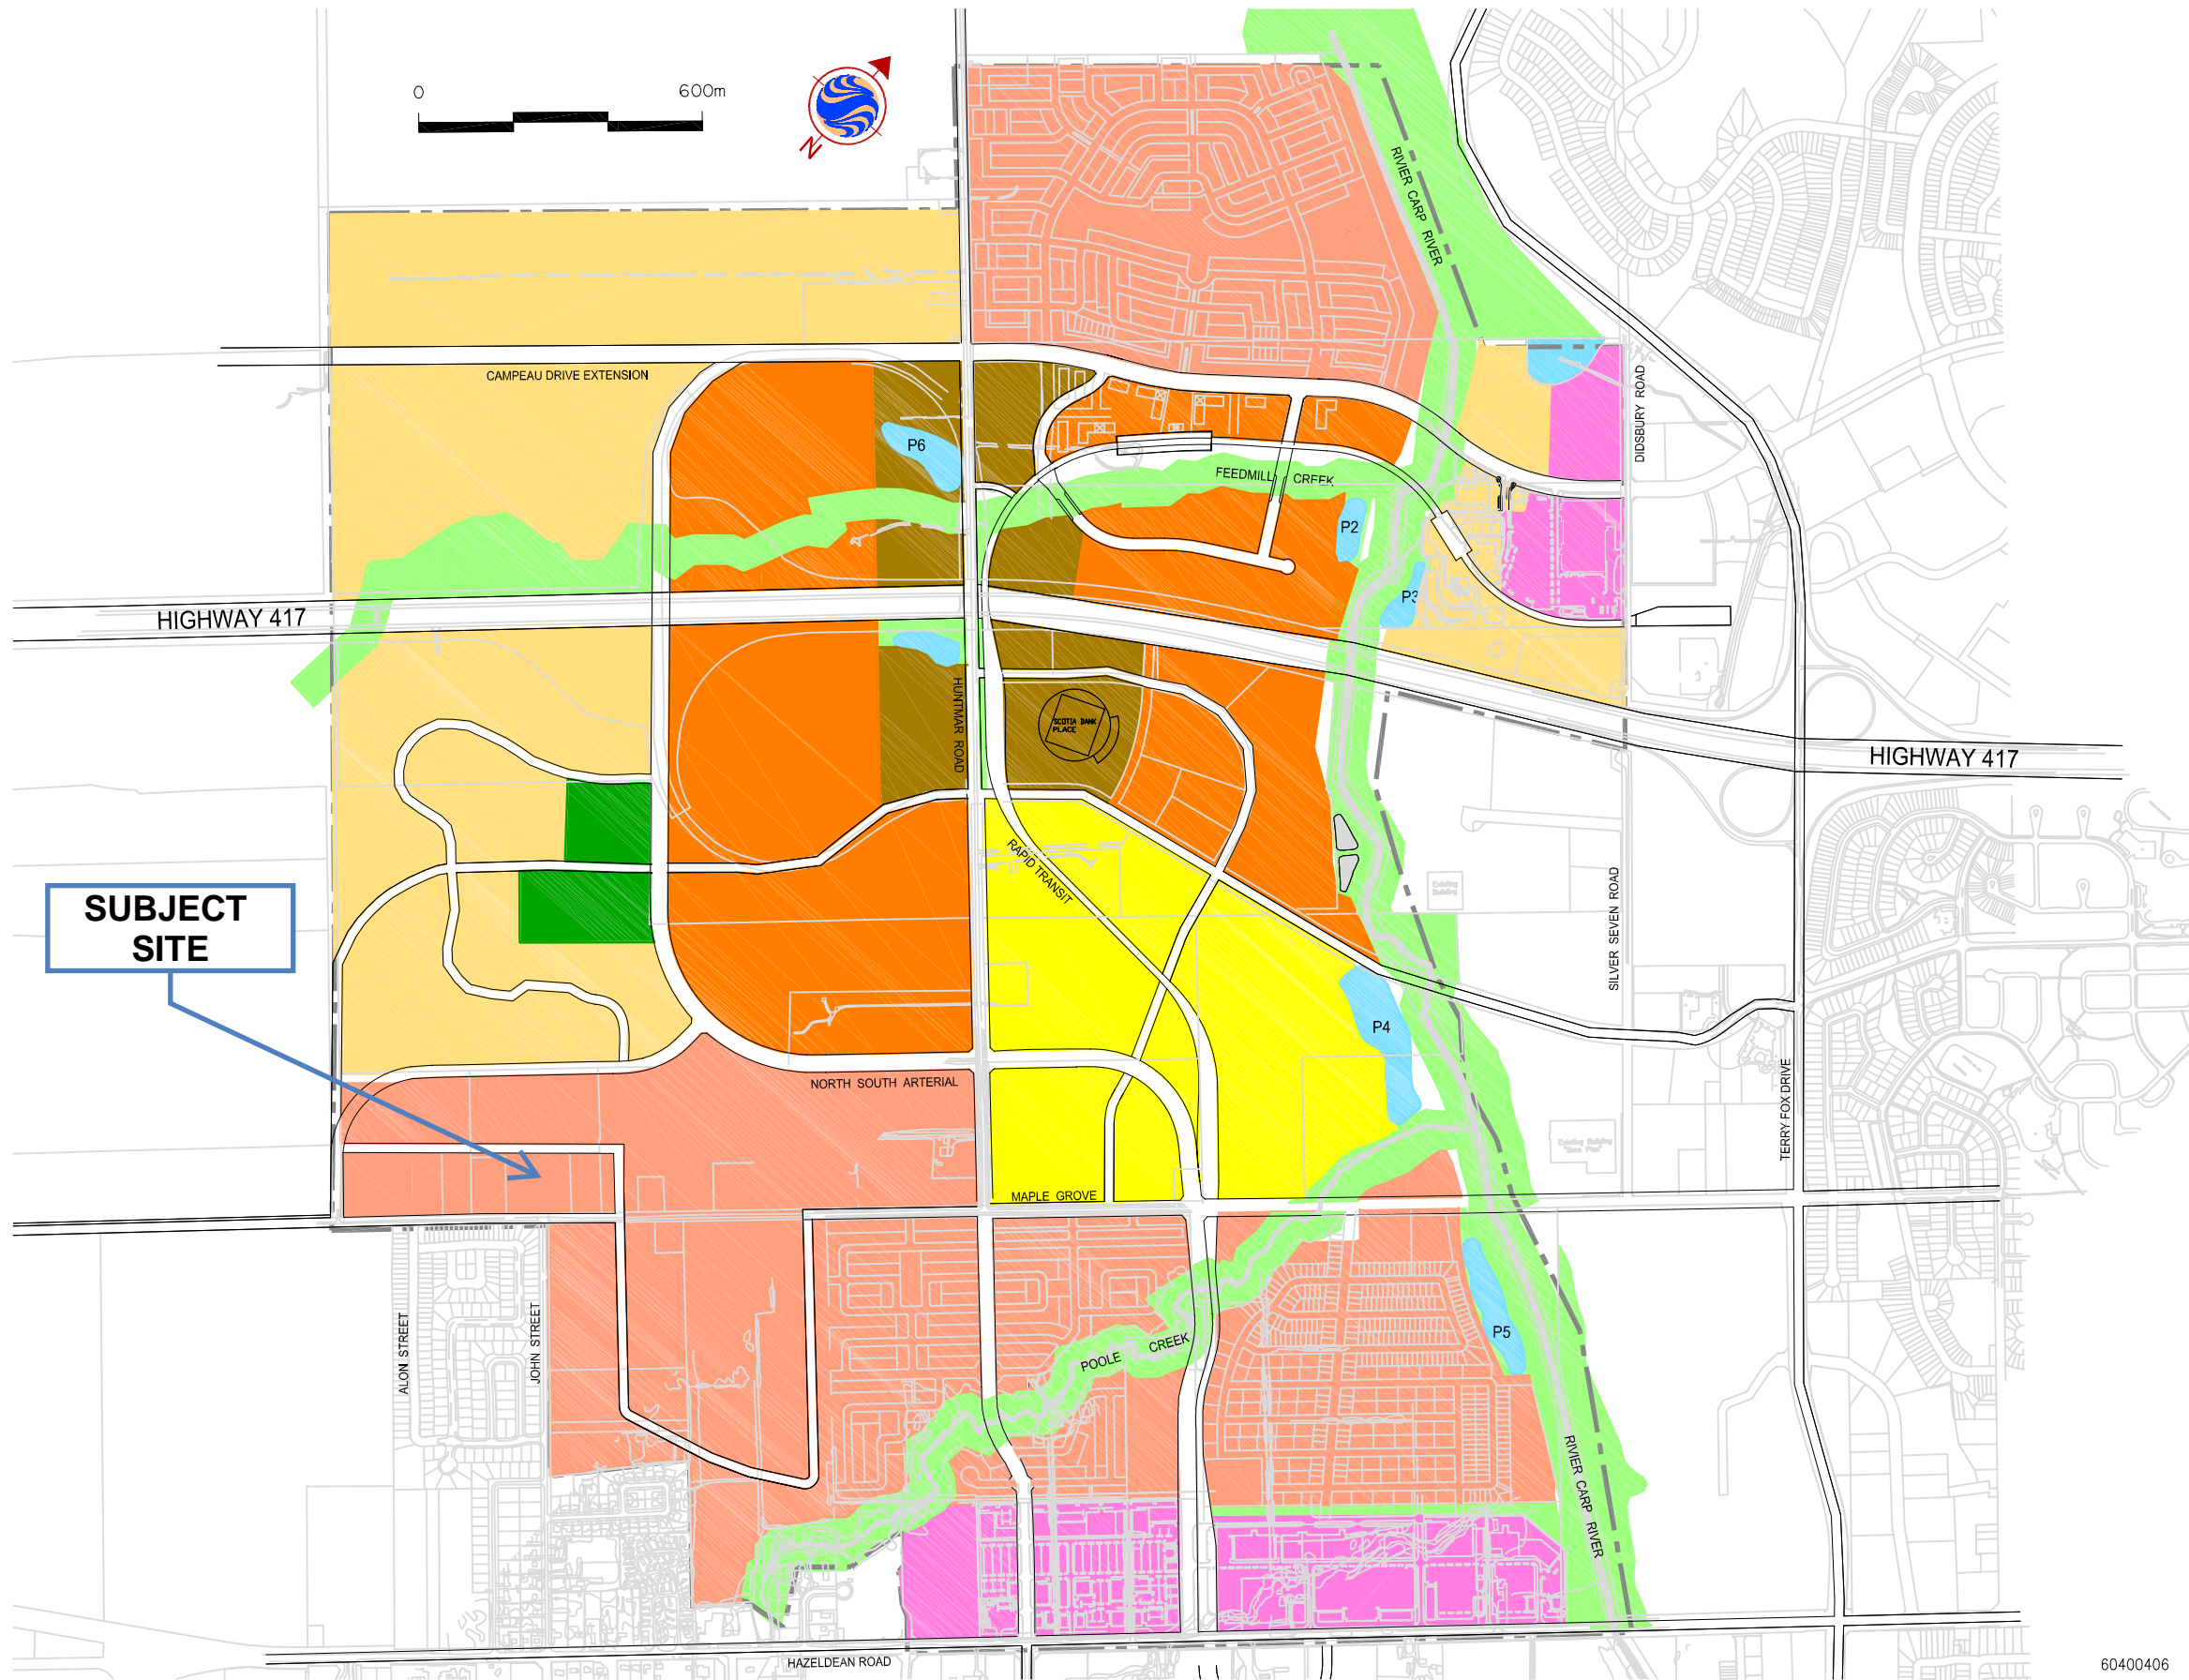


Phase	Building Types	Gross Building Area	Gross Floor Area	Storeys	bedrooms	p/unit	number of units	number of occupants
1	Town Houses			3	2	2.7	4	11
2	Town Houses			3	2	2.7	14	38
3	Semidetached and town homes			3	3	3.4	24	82
4	Semidetached			3	3	3.4	20	68
5	Apartment Buildings	4964	19856	4	1	1.4	95	133
					2	2.1	95	200
6	Apartment Buildings	6757	27028	4	1	1.4	130	182
					2	2.1	130	273
Total								987

Kanata West Land Use (FIG. 2.1)

Kanata West Master Servicing Study

LAND USE PLAN





-  Kanata-West Concept Plan Boundary
-  PRESTIGE BUSINESS PARK
-  OPEN SPACE
-  COMMUNITY RETAIL
-  DISTRICT PARK
-  RESIDENTIAL
-  MIXED USE
-  HIGH PROFILE EMPLOYMENT
-  EXTENSIVE EMPLOYMENT

60400406




MAY 2006

FIG. 2.1

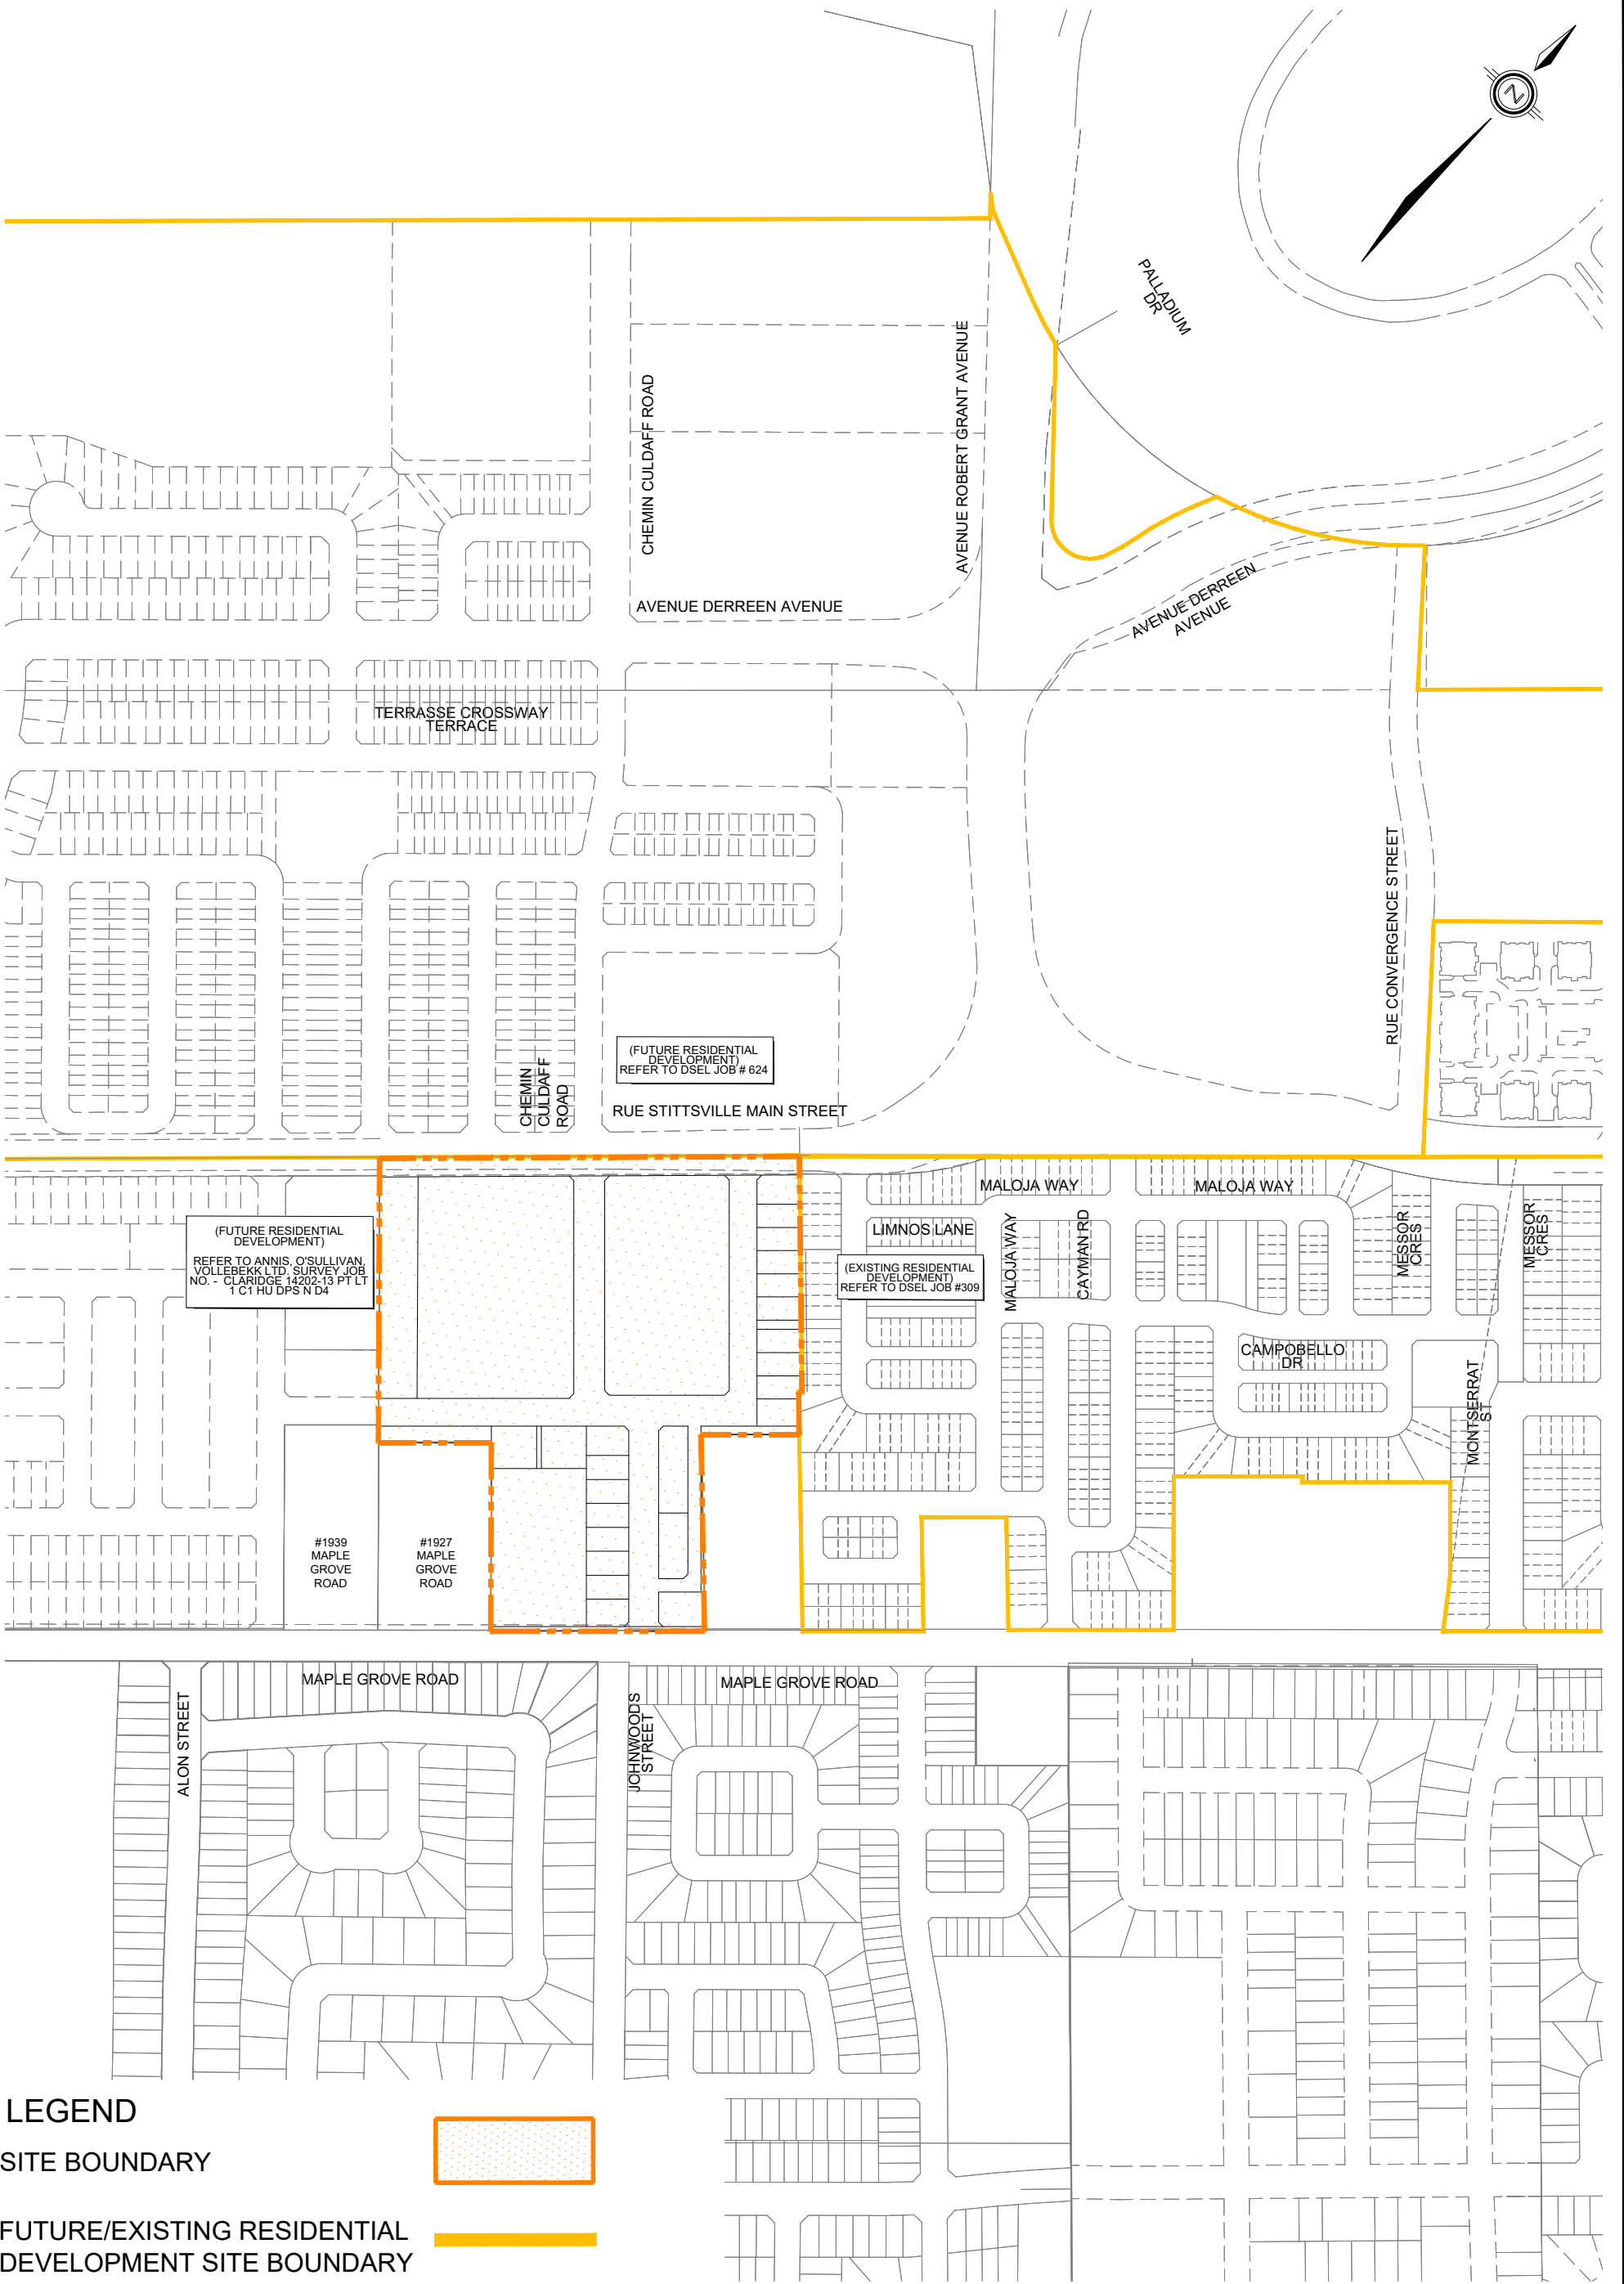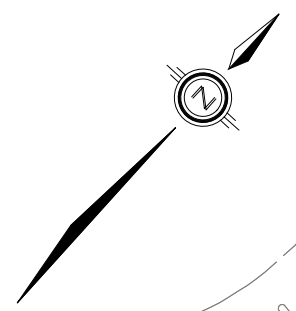

LEGEND

SITE BOUNDARY



FUTURE/EXISTING RESIDENTIAL DEVELOPMENT SITE BOUNDARY





120 Iber Road, Unit 103
 Stittsville, Ontario, K2S 1E9
 Tel. (613) 836-0856
 Fax. (613) 836-7183
 www.DSEL.ca

FORMASIAM 1919 MAPLE GROVE
 CITY OF OTTAWA

KEY PLAN

SCALE:	1:4000	PROJECT No.:	16-861
DATE:	AUGUST 2020	FIGURE:	1

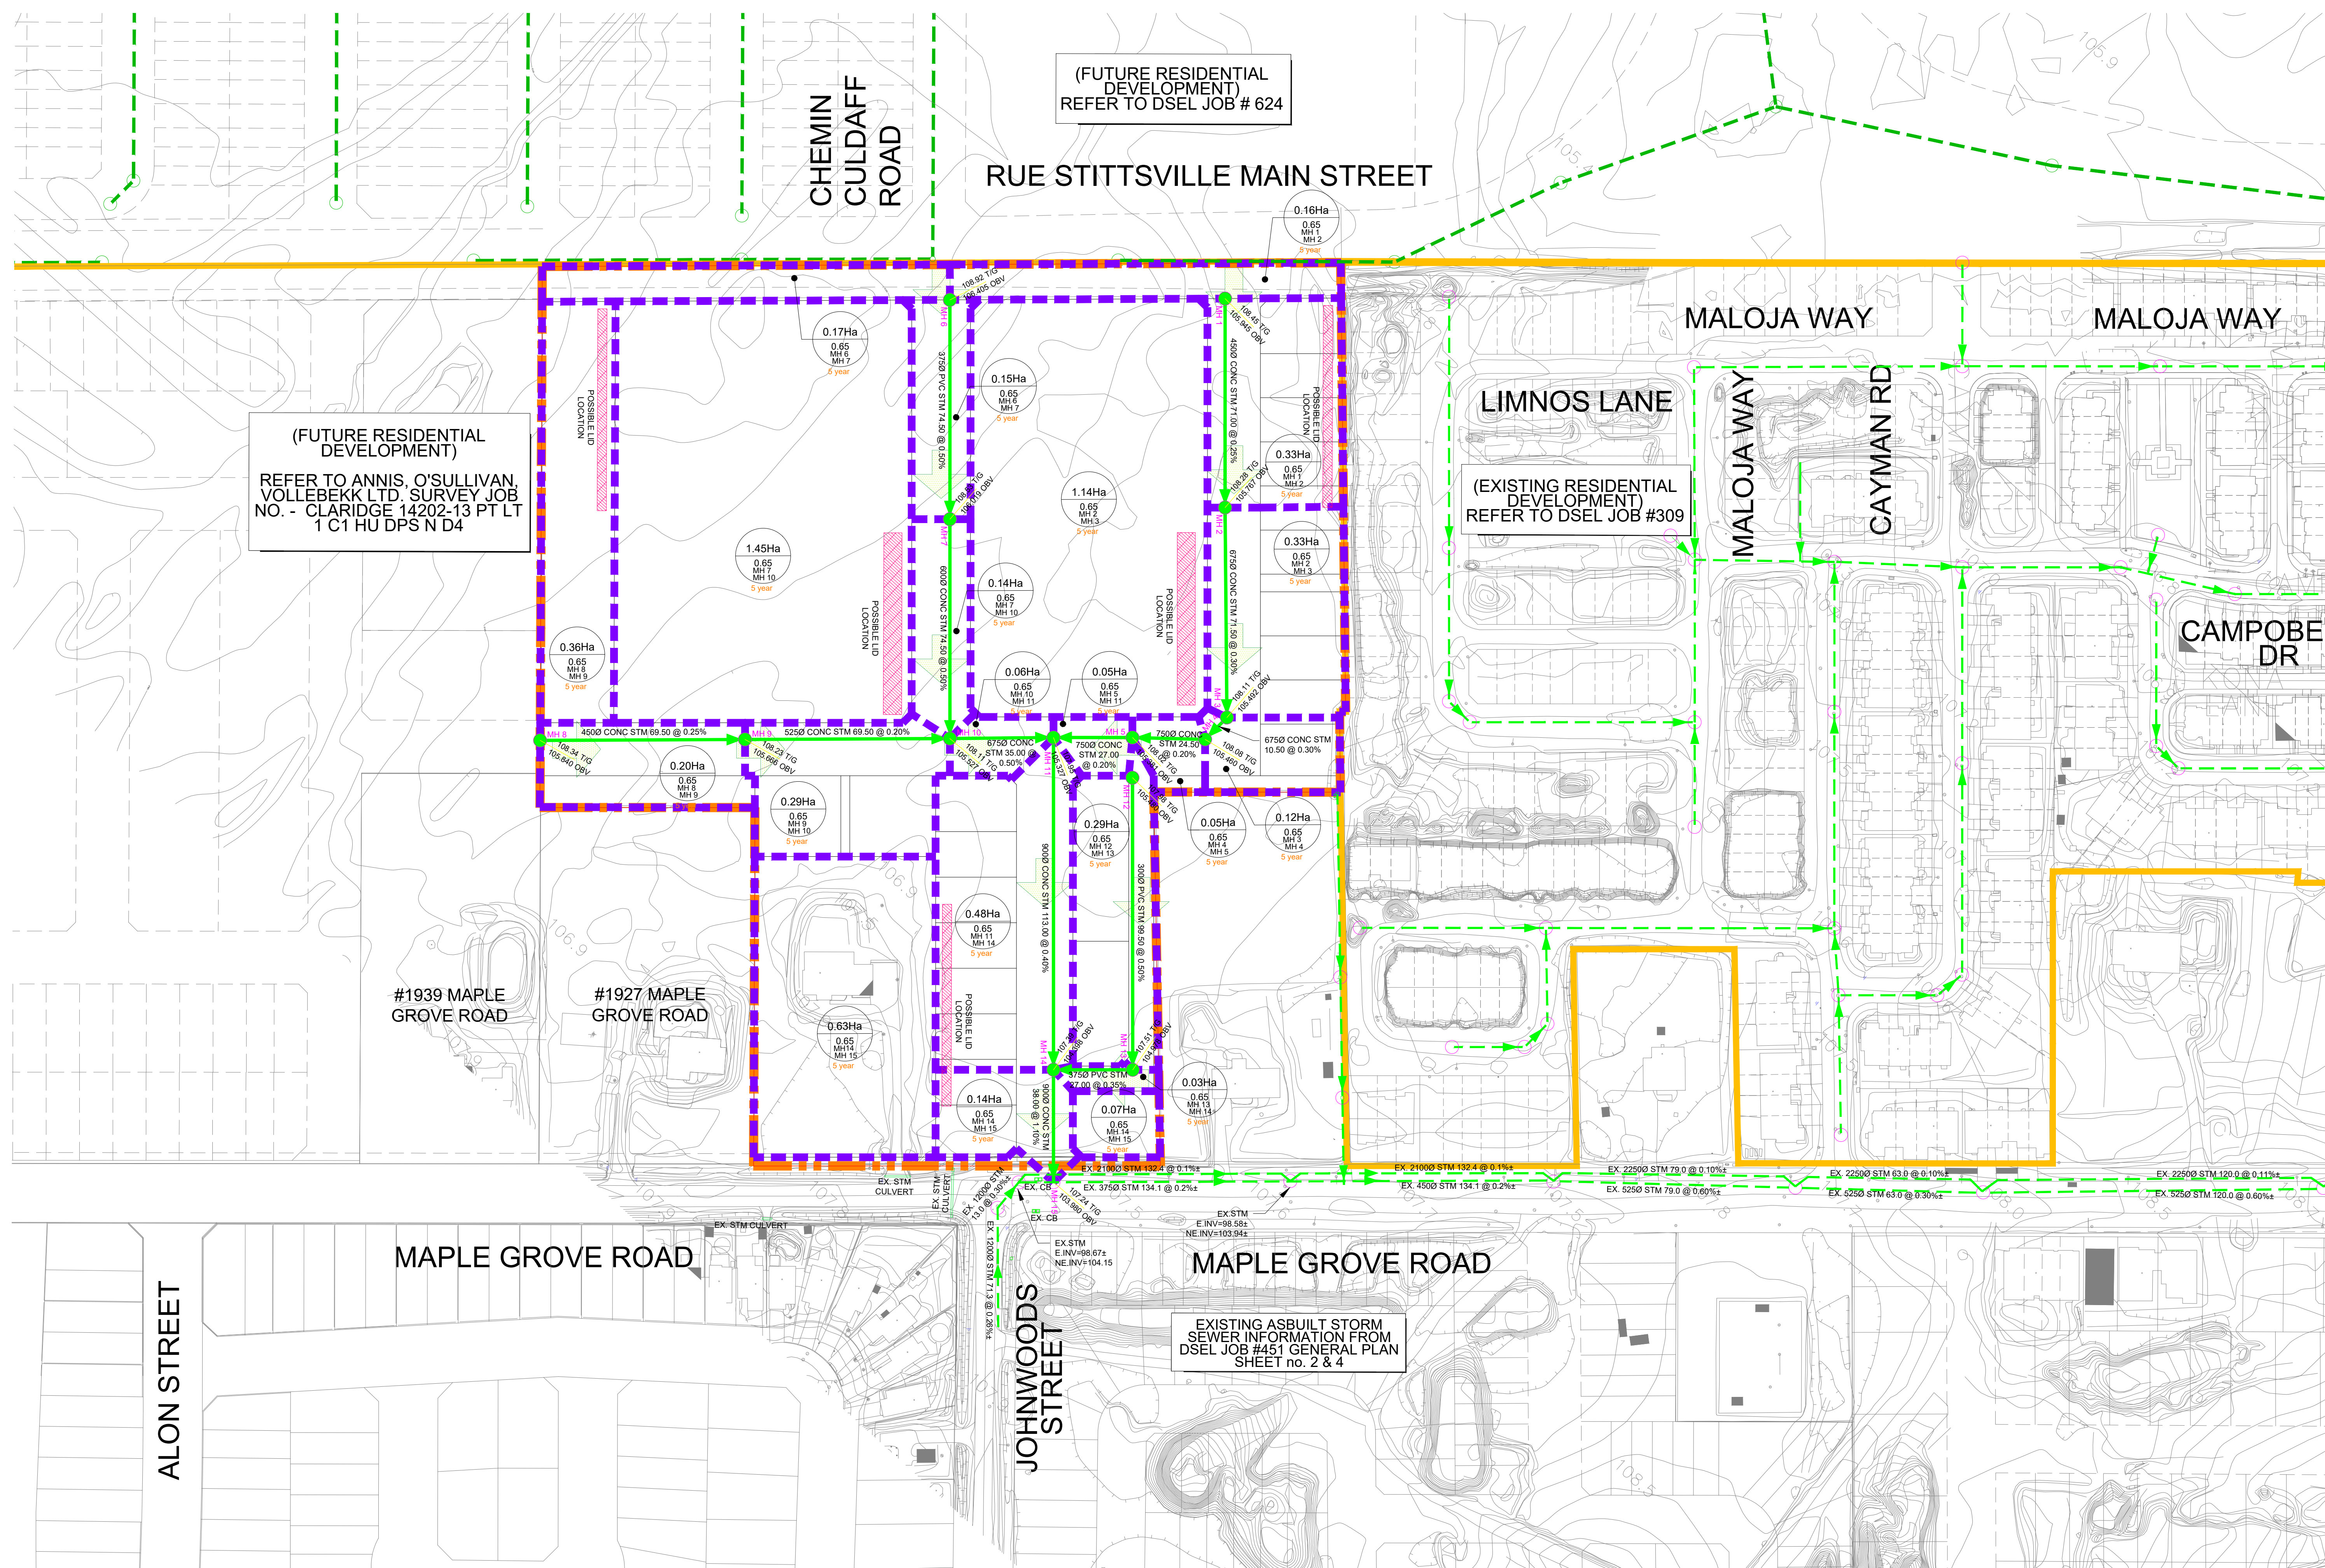


LEGEND

- SUBJECT LANDS
- STORM DRAINAGE AREA
- STORM TRUNK
- EXISTING STORM SEWER
- - - FUTURE STORM SEWER
- EXISTING STORM DRAINAGE AREA
- ↓ OVERLAND FLOW ROUTE
- PROPOSED STORM MANHOLE
- TOP OF GRATE
- PROPOSED STORM OBVERT
- EXISTING STORM MANHOLE
- FUTURE STORM MANHOLE
- 6.07Ha
0.65 MH 150
MH 153 STORM DRAINAGE AREA
- 5-YEAR RUN-OFF COEFFICIENT
- 5-YEAR UPSTREAM MH
- 5-YEAR DOWNSTREAM MH
- 5-YEAR STORM FREQUENCY

DSEL
david schaeffer engineering ltd
120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel: (613) 836-8856
Fax: (613) 836-7183
www.DSEL.ca

FORMASIAM 1919
MAPLE GROVE
CITY OF OTTAWA

STORM SERVICING PLAN	
SCALE: 1:1000	PROJECT No.: 16-861
DATE: AUGUST 2020	DRAWING: 2

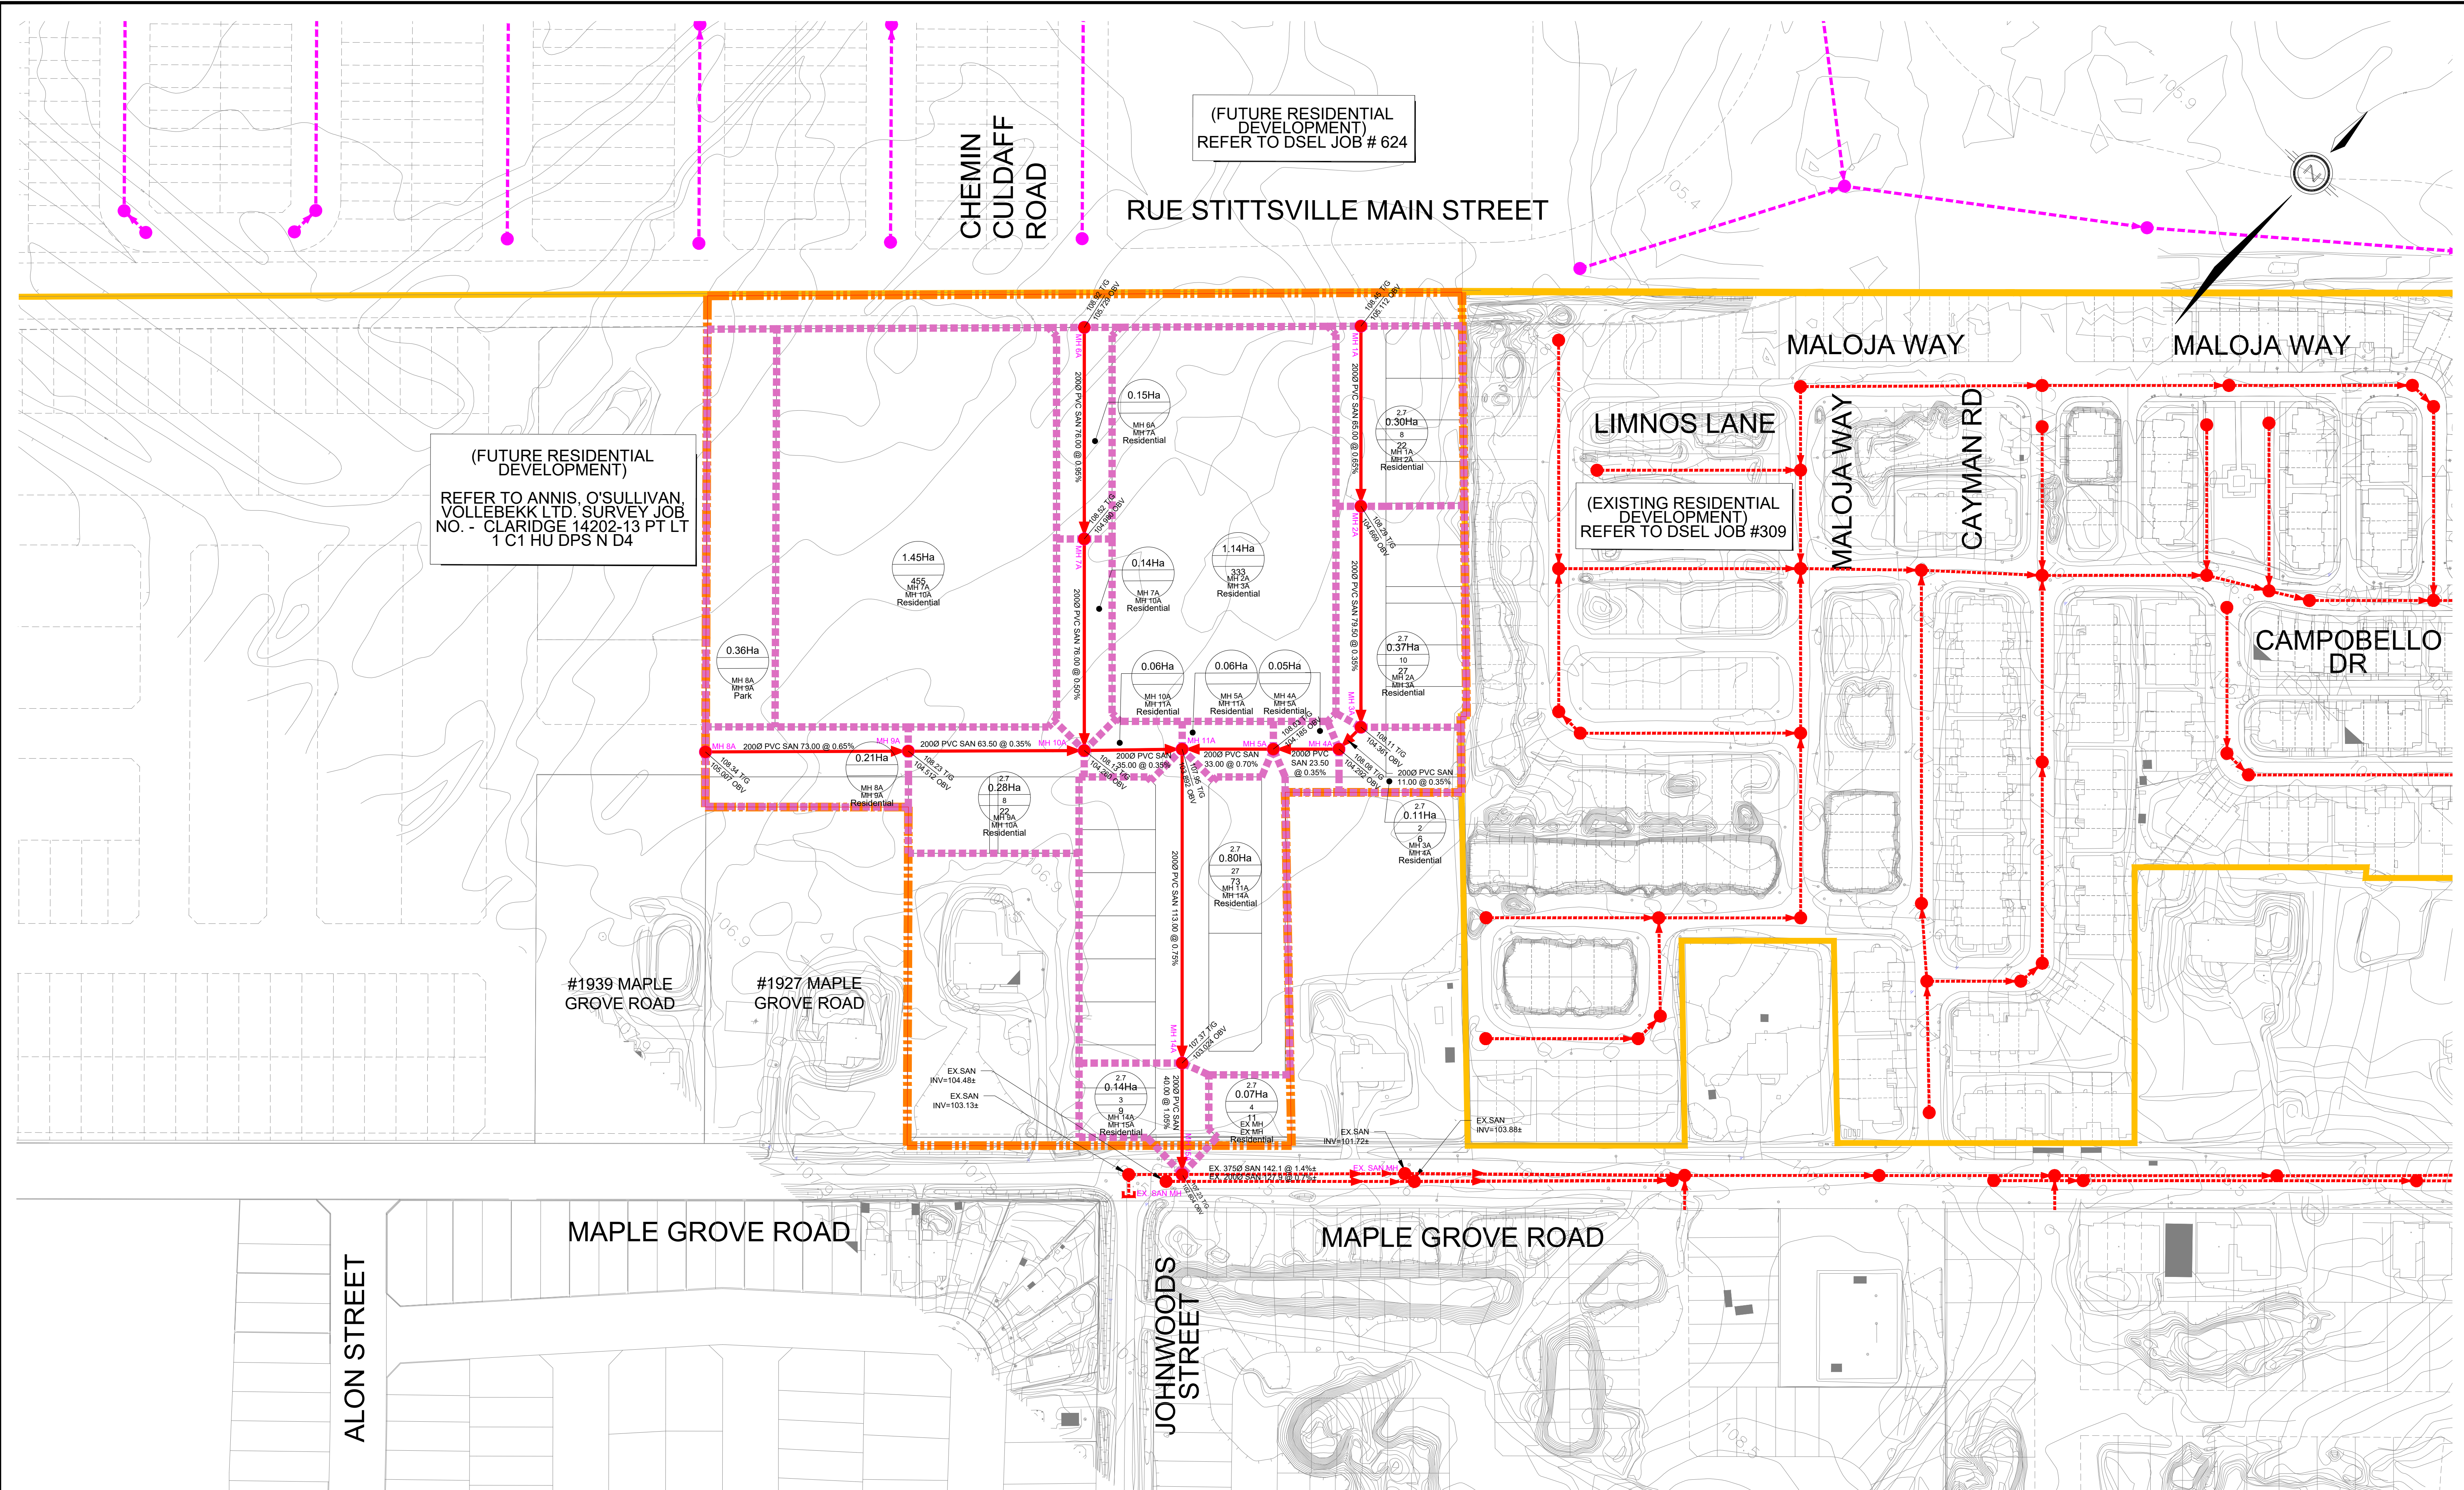

(FUTURE RESIDENTIAL DEVELOPMENT)
 REFER TO ANNIS, O'SULLIVAN,
 VOLLEBEKK LTD. SURVEY JOB
 NO. - CLARIDGE 14202-13 PT LT
 1 C1 HU DPS N D4

(FUTURE RESIDENTIAL DEVELOPMENT)
 REFER TO DSEL JOB # 624

(EXISTING RESIDENTIAL DEVELOPMENT)
 REFER TO DSEL JOB #309

- LEGEND**
- ▬▬▬▬ SUBJECT LANDS
 - ▬▬▬▬ SANITARY TRUNK
 - - - - - EXISTING SANITARY SEWER
 - - - - - FUTURE SANITARY SEWER
 - ▬▬▬▬ SANITARY DRAINAGE AREA
 - ▬▬▬▬ EXTERNAL SANITARY DRAINAGE AREA
 - SANITARY MANHOLE
 - FUTURE SANITARY MANHOLE


- POPULATION PER UNIT
- SANITARY DRAINAGE AREA
- NUMBER OF UNITS
- TOTAL POPULATION
- UPSTREAM MANHOLE
- DOWNSTREAM MANHOLE
- TRIB TYPE
- TOP OF GRATE
- PROPOSED SANITARY OBVERT

DSEL
 david schaeffer engineering ltd
 120 Ibor Road, Unit 103
 Stittsville, Ontario, K2S 1E9
 Tel: (613) 836-8556
 Fax: (613) 836-7183
 www.DSEL.ca

FORMASIAM 1919
 MAPLE GROVE
 CITY OF OTTAWA

SANITARY SERVICING PLAN


SCALE:	1:1000	PROJECT No.:	16-861
DATE:	AUGUST 2020	DRAWING:	3

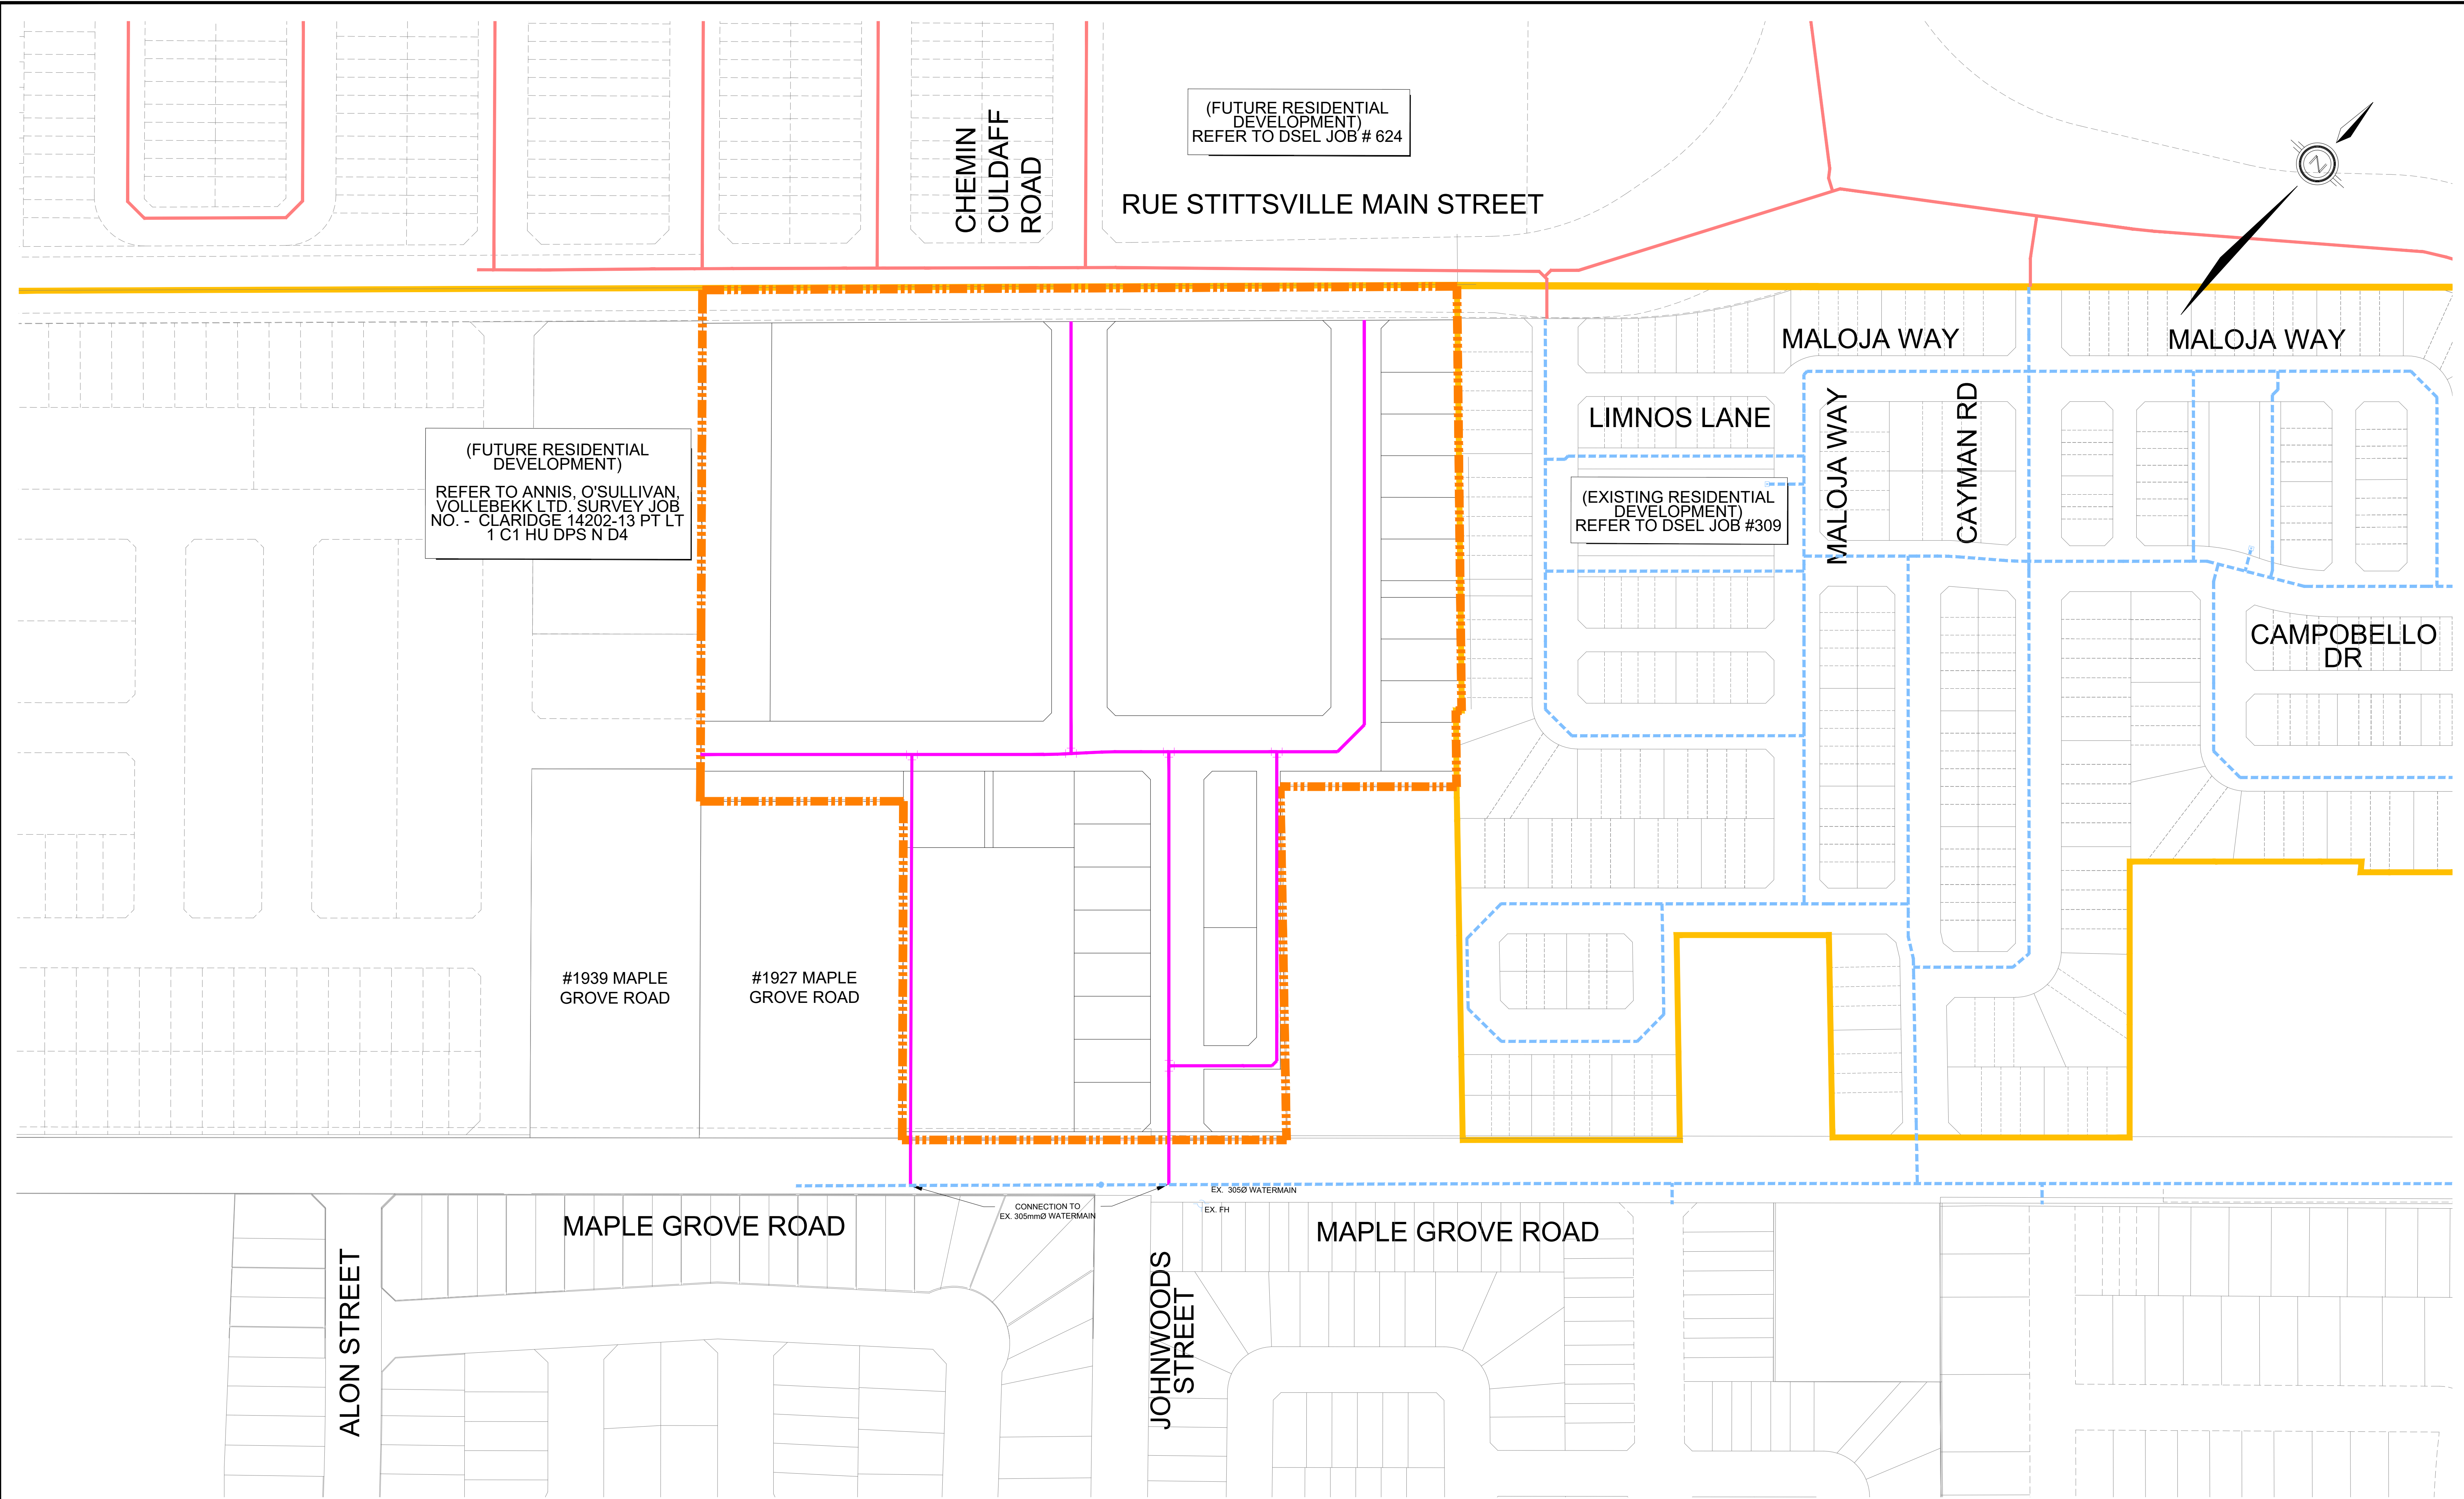

- LEGEND**
- ▬▬▬▬▬▬ SUBJECT LANDS
 - ▬▬▬▬▬▬ PROPOSED LOCAL WATERMAIN
 - - - - - EXISTING WATERMAIN
 - ▬▬▬▬▬▬ FUTURE WATERMAIN BY OTHERS
 - PLUG

DSEL
 david schaeffer engineering ltd
 120 Iber Road, Unit 103
 Stittsville, Ontario, K2S 1E9
 Tel: (613) 836-8856
 Fax: (613) 836-7183
 www.DSEL.ca

FORMASIAM 1919 MAPLE GROVE CITY OF OTTAWA	WATERMAIN SERVICING PLAN		
	SCALE: 1:1000	PROJECT No.: 16-861	
DATE: AUGUST 2020	DRAWING: 4		

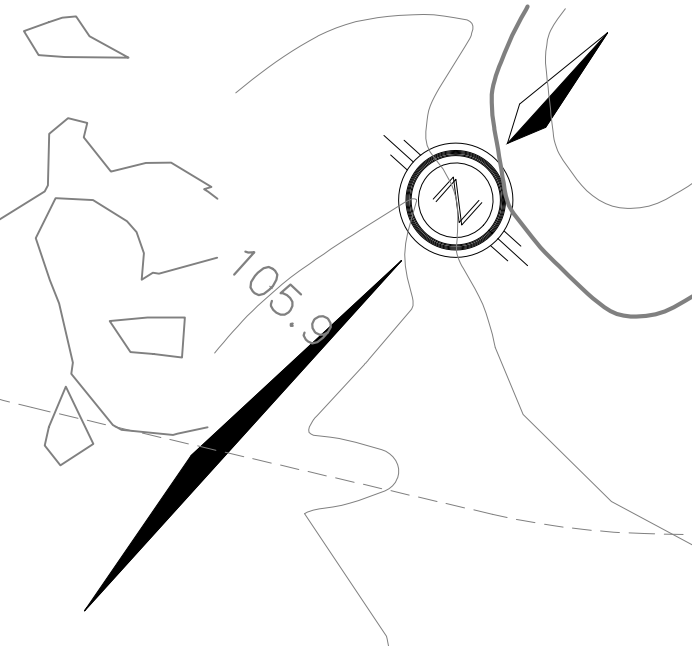

(FUTURE RESIDENTIAL DEVELOPMENT)
REFER TO DSEL JOB # 624

(FUTURE RESIDENTIAL DEVELOPMENT)
REFER TO ANNIS, O'SULLIVAN,
VOLLEBEKK LTD. SURVEY JOB
NO. - CLARIDGE 14202-13 PT LT
1 C1 HU DPS N D4

LIMNOS LANE

(EXISTING RESIDENTIAL DEVELOPMENT)
REFER TO DSEL JOB #309

#1939 MAPLE GROVE ROAD

#1927 MAPLE GROVE ROAD

MAPLE GROVE ROAD

MAPLE GROVE ROAD

JOHNWOODS STREET

ALON STREET

LEGEND

- SUBJECT LANDS
- STORM OVERLAND FLOW ARROW
- PROPOSED CENTERLINE ELEVATION

193.50
193.50
244.50
192.85

PROPOSED ELEVATION
EXISTING ELEVATION
EXISTING CONTOUR ELEVATION
FUTURE CENTERLINE ELEVATION

CUT-FILL DEPTH ALONG CENTER LINE:

CUT DEPTH (m)		FILL DEPTH (m)	
0 - 0.5		0 - 0.5	
0.5 - 1.0		0.5 - 1.0	
1.0 - 1.5		1.0 - 1.5	
1.5 - 2.0		1.5 - 2.0	
2.0 - 2.5		2.0 - 2.5	
2.5 - 3.0			
3.0 - 3.5			
3.5 - 4.0			
4.0 - 4.5			
> 4.5			

DSEL
david schaeffer engineering ltd
120 Iker Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel: (613) 836-8856
Fax: (613) 836-7183
www.DSEL.ca

FORMASIAM 1919
MAPLE GROVE
CITY OF OTTAWA

GRADING PLAN

SCALE:	1:1000	PROJECT No.:	16-861
DATE:	AUGUST 2020	DRAWING:	5