


TITLE FRAME: 709mm x 534mm City of Ottawa 2009

Novatech File No. 115075

M:\2015\115075\CAD\Design\115075_PP.dwg, PPI(019), Dec 12, 2016 - 5:54pm, ddufau

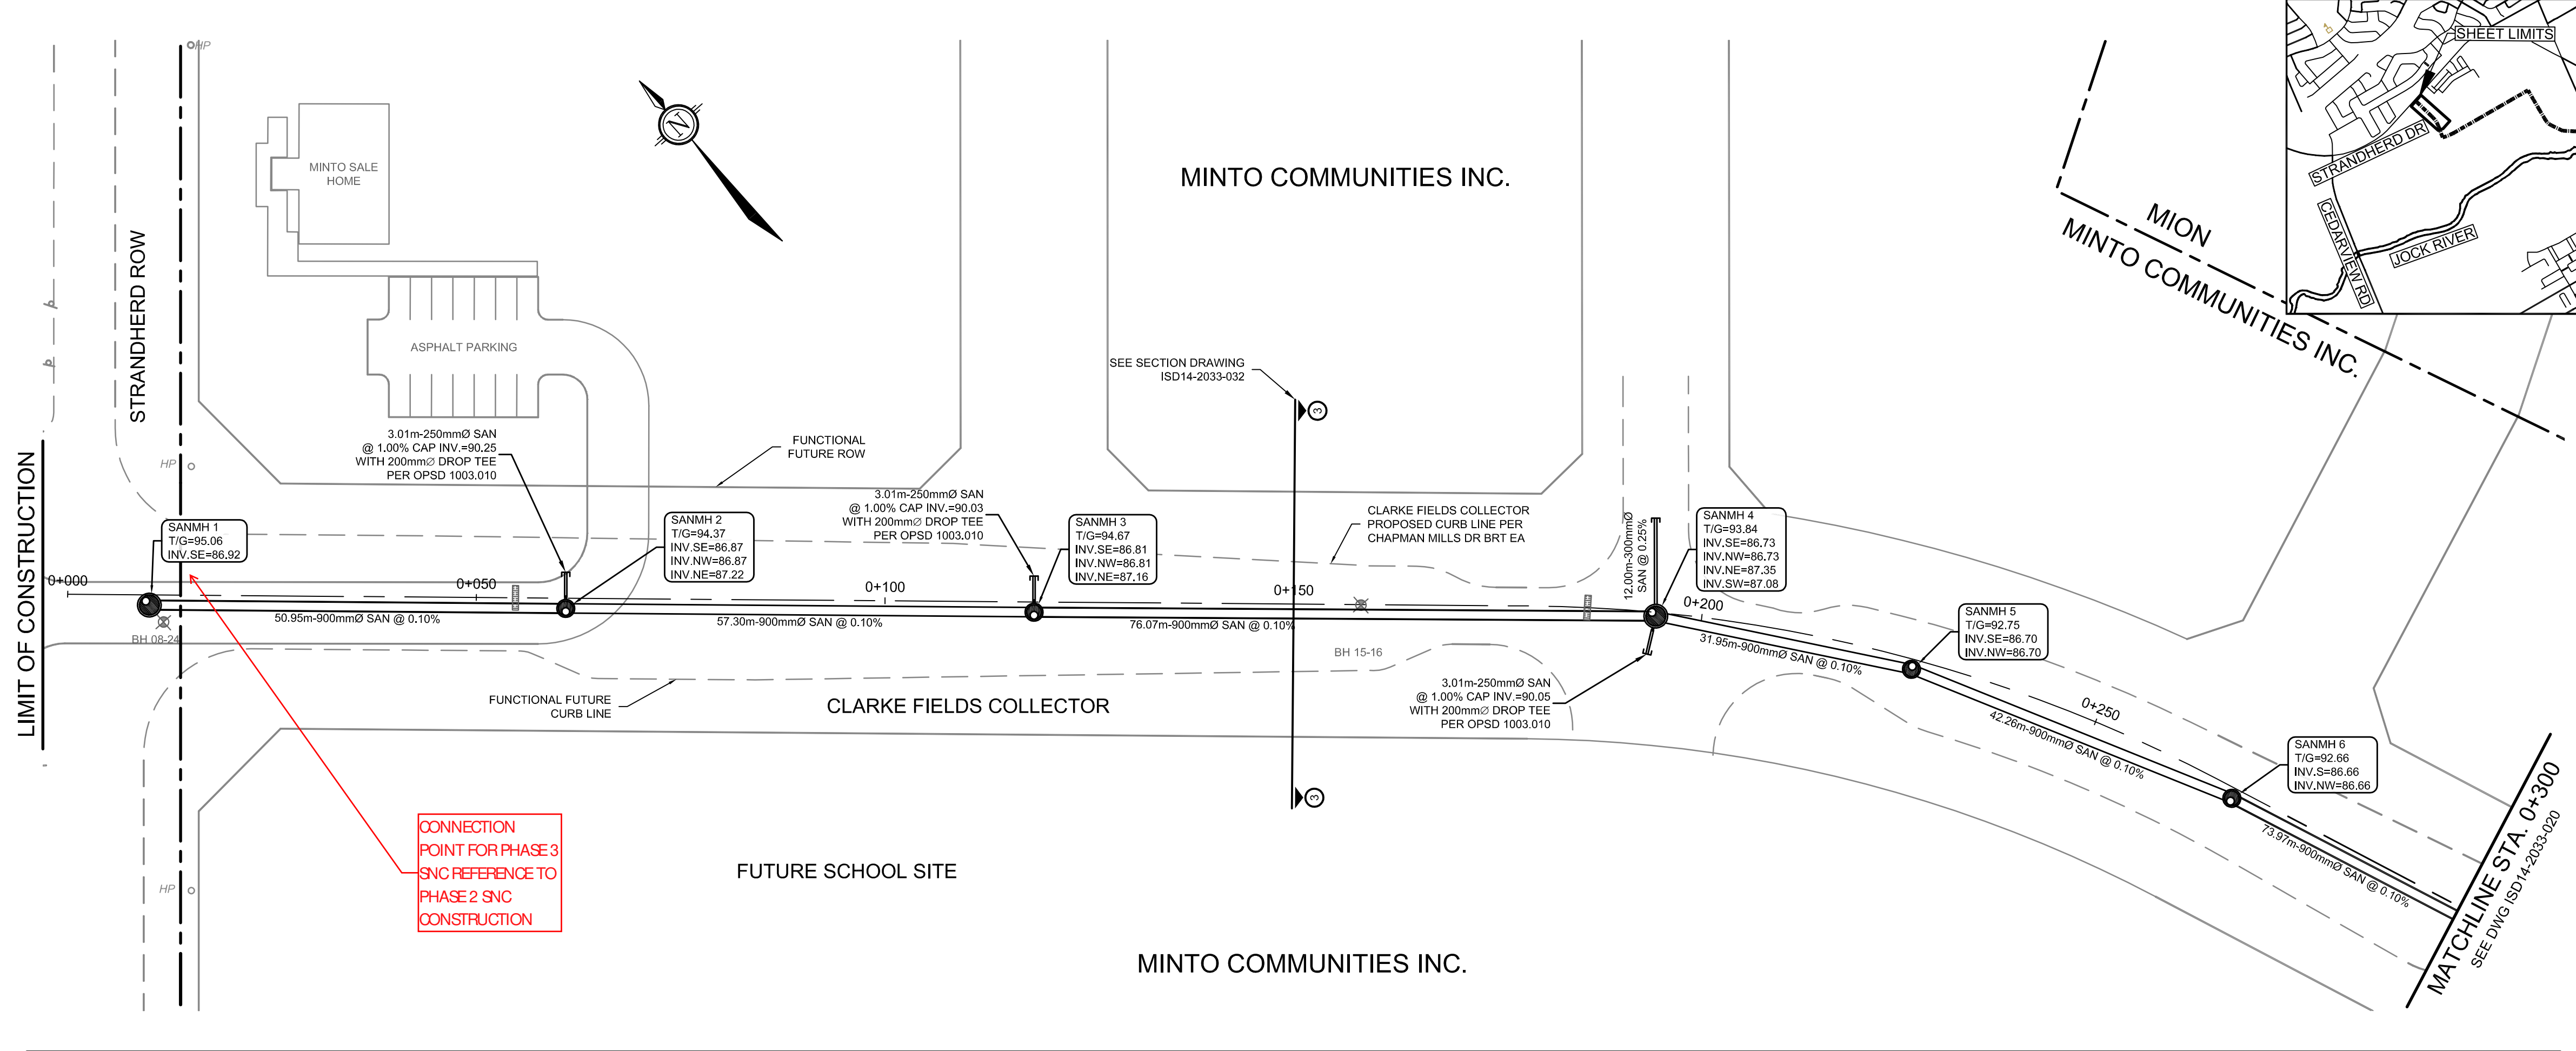

CITY OF OTTAWA
SOUTH NEPEAN COLLECTOR (SNC)
SEWER PHASE 2 - STRANDHERD DRIVE
TO JOCKVALE ROAD

PLAN AND PROFILE
STA. 0+000 TO 0+300

Contract No. **ISD14-2033** Dwg. No. **019**
 Sheet 19 of 51

Asset No. _____
 Asset Group **ISD**

Wayne Newell, P.Eng. General Manager
 Jonathan Knoyle, P.Eng. Senior Engineer

NOVATECH
 Engineers, Planners & Landscape Architects
 Suite 202, 240 Michael Coopers Drive
 Kanata, Ontario, Canada, K2M 1P6
 Telephone: (613) 254-9643
 Facsimile: (613) 254-5867
 Email: novatech@novatech-eng.com

PROFESSIONAL ENGINEER
M.A. BISSETT
 PROVINCE OF ONTARIO

Scale: HORIZONTAL 1:500
 VERTICAL 1:100

NOTE: The location of utilities is approximate only, the exact location should be determined by consulting the municipal authorities and utility companies concerned. The contractor shall prove the location of utilities and shall be responsible for adequate protection from damage.

No.	Description	By	Date (dd/mm/yy)
1.	ISSUED FOR PRELIMINARY DESIGN CIRCULATION	ERD	21/12/15
2.	CHANGES TO ORIENTATION ACROSS KB SWM FACILITY	ERD	16/02/16
3.	ISSUED FOR PRELIMINARY DESIGN REPORT	ERD	02/03/16
4.	ISSUED FOR FINAL DESIGN CIRCULATION	ERD	29/04/16
5.	ISSUED FOR MOECC ECA APPLICATION	ERD	26/05/16
6.	ISSUED FOR TENDER	ERD	20/06/16
7.	ISSUED FOR CONSTRUCTION	ERD	30/08/16
8.	SEWER ALIGNMENT SHIFT ON GREENBANK	ERD	16/09/16
9.	REVISED PER MION SERVICING	ERD	08/12/16

LEGEND

EXISTING ITEMS	PROPOSED ITEMS
WATERMAIN	SANITARY SEWER
WATERMAIN VALVE	SANITARY MH & LID
STORM SEWER	CULVERT
STORM MH	FUTURE STRUCTURE T/G ADJUSTMENT
CATCH BASIN & LEAD	
CULVERT	
STORM STRUCTURE	
SANITARY SEWER	
SANITARY MH	

- NOTES:**
- CONCRETE PRESSURE PIPE SHALL BE AWWA C301 (L) CL-16. FITTING SHALL BE DESIGNED TO THE SAME CRITERIA AS THE ADJACENT PIPE.
 - CONTRACTOR TO PROVIDE PIPE CLASS CALCULATIONS, AS PER AWWA C304 (DESIGN OF PRESTRESSED CONCRETE CYLINDER PIPE), BY THE PIPE MANUFACTURER, SIGNED AND SEALED BY A PROFESSIONAL ENGINEER LICENSED IN THE PROVINCE OF ONTARIO.
 - PIPE EMBEDMENT SHALL BE AS PER CITY OF OTTAWA DETAIL S6. SAND MAY BE USED AS PIPE COVER MATERIAL ABOVE THE SPRINGLINE.
 - A CLOTH DIAPER APPROVED BY THE PIPE MANUFACTURE SHALL BE PLACED AROUND EACH EXTERIOR JOINT RECESS AND FASTENED IN PLACE WITH EITHER WIRE OR STEEL STRAPPING STITCHED INTO ITS EDGES.
 - THE JOINT SHALL BE FILLED WITH MORTAR IN ONCE CONTINUOUS OPERATION AND PATTED OR MANIPULATED TO SETTLE THE MORTAR AND EXPEL AND ENTRAPPED AIR.
 - INTERIOR JOINTS SHALL BE FILLED WITH MORTAR AFTER BACKFILLING AND FINISHED SMOOTH WITH A TROWEL. CEMENT USED SHALL MEET THE REQUIREMENTS OF TYPE HS CEMENT (HIGH-SULPHATE-RESISTANCE), OR APPROVED EQUIVALENT.
 - THE INTERIOR OF THE JOINTS SHALL BE PROTECTED FROM CORROSION WITH EPOXY AND ZINC COATING APPLIED DURING FABRICATION.
 - THE INTERIOR STRUCTURAL CONCRETE CORE SHALL BE MANUFACTURED WITH TYPE HS CEMENT (HIGH-SULPHATE-RESISTANCE), OR APPROVED EQUIVALENT.
 - SEE MANHOLE DETAIL DRAWINGS ISD14-2033-36 TO ISD14-2033-45 FOR ADDITIONAL DETAILS

MAINTENANCE HOLE DATA						
MH ID	STATION	OFFSET	STRUCTURE	COVER	T/G ELEV.	LOW. INV.
1	0+010.00	1.25R	OPSD 701.013	S24/S25	95.06	86.92
2	0+060.95	1.25R	OPSD 701.012	S24/S25	94.37	86.87
3	0+118.25	1.25R	OPSD 701.012	S24/S25	94.67	86.81
4	0+194.38	0.46R	OPSD 701.013	S24/S25	93.84	86.73
5	0+226.51	1.25R	OPSD 701.012	S24/S25	92.75	86.70
6	0+269.14	1.25R	OPSD 701.012	S24/S25	92.66	86.66

SANITARY SEWER PIPE DATA			
CONNECTED STRUCTURES & INVERTS	DIA (mm)	LENGTH (m)	MATERIAL
SANMH 1 = 86.92 SANMH 2 = 86.87	900	50.95	AWWA C-301 (L)
SANMH 2 = 86.87 SANMH 3 = 86.81	900	57.30	AWWA C-301 (L)
SANMH 3 = 86.81 SANMH 4 = 86.73	900	76.07	AWWA C-301 (L)
SANMH 4 = 86.73 SANMH 5 = 86.70	900	31.95	AWWA C-301 (L)
SANMH 5 = 86.70 SANMH 6 = 86.66	900	42.26	AWWA C-301 (L)
SANMH 6 = 86.66 SANMH 7 = 86.59	900	73.97	AWWA C-301 (L)

STATION	EXISTING ELEVATION	CHAINAGE	PIPE DIA	LENGTH	INVERT ELEVATION	COVER	T/G ELEVATION	LOW. INV.
0+000	83.47	0+000	900mm	50.95m	86.92	1.25R	95.06	86.92
0+050	82.75	0+050	900mm	57.30m	86.87	1.25R	94.37	86.87
0+100	82.74	0+100	900mm	76.07m	86.81	1.25R	94.67	86.81
0+150	82.59	0+150	900mm	31.95m	86.73	0.46R	93.84	86.73
0+200	82.50	0+200	900mm	42.26m	86.70	1.25R	92.75	86.70
0+250	82.38	0+250	900mm	73.97m	86.66	1.25R	92.66	86.66
0+300	82.29	0+300						