

**PEDESTRIAN LEVEL
WIND STUDY**

1400 Bank Street
Ottawa, Ontario

Report: 21-282-PLW



October 28, 2021

PREPARED FOR

SerCo Realty Group
200-9 Capella Court
Ottawa, ON K2E 8A7

PREPARED BY

David Huitema, M.Eng., Junior Wind Scientist
Steven Hall, M.A.Sc., P.Eng., Senior Wind Engineer

EXECUTIVE SUMMARY

This report describes a pedestrian level wind (PLW) study undertaken to satisfy the requirements for Official Plan Amendment and Zoning By-Law Amendment application submissions for the proposed residential development located at 1400 Bank Street in Ottawa, Ontario (hereinafter referred to as “subject site” or “proposed development”). Our mandate within this study is to investigate pedestrian wind comfort and safety within and surrounding the subject site, and to identify any areas where wind conditions may interfere with certain pedestrian activities so that mitigation measures may be considered, where required.

The study involves simulation of wind speeds for selected wind directions in a three-dimensional (3D) computer model using the computational fluid dynamics (CFD) technique, combined with meteorological data integration, to assess pedestrian wind comfort and safety within and surrounding the subject site according to City of Ottawa wind comfort and safety criteria. The results and recommendations derived from these considerations are detailed in the main body of the report (Section 5), illustrated in Figures 3A-5B, and summarized as follows:

- 1) All grade-level areas within and surrounding the subject site are predicted to be acceptable for the intended pedestrian uses throughout the year. Specifically, wind conditions over the surrounding sidewalks and walkways, transit stops, parking lots, and building access points, are considered acceptable for the intended pedestrian uses throughout the year. The only exception is as follows:
 - a. In the vicinity of the nearby transit stop along Bélanger Avenue, conditions are predicted to be suitable for mix of standing and strolling during the spring and winter. Since the majority of the space near the transit stop is suitable for standing, and since pedestrians are free to relocate to these calmer locations in the vicinity of the transit stop during periods of strong wind activity, the noted conditions may be considered satisfactory.
- 2) To extend sitting conditions over the full amenity terrace at Level 17, it is recommended that a tall wind barrier, typically glazed and rising at least 1.8 m above the walking surface, be installed around the perimeter of the terrace in place of typical height guards. In-board barriers may also be required within the southwest corner of the terrace. Mitigation strategies will be developed and confirmed in collaboration with the design team for the future Site Plan Control application.



- 3) Within the context of typical weather patterns, which exclude anomalous localized storm events such as tornadoes and downbursts, no pedestrian areas within and surrounding the subject site were found to experience conditions that could be considered dangerous.



TABLE OF CONTENTS

1. INTRODUCTION1

2. TERMS OF REFERENCE1

3. OBJECTIVES.....2

4. METHODOLOGY.....3

4.1 Computer-Based Context Modelling..... 3

4.2 Wind Speed Measurements 4

4.3 Historical Wind Speed and Direction Data..... 4

4.4 Pedestrian Comfort and Safety Criteria – City of Ottawa 6

5. RESULTS AND DISCUSSION8

5.1 Wind Comfort Conditions – Grade Level..... 9

5.2 Wind Comfort Conditions – Common Amenity Terrace..... 9

5.3 Wind Safety 10

5.4 Applicability of Results 10

6. CONCLUSIONS AND RECOMMENDATIONS.....10

FIGURES

APPENDICES

Appendix A – Simulation of the Atmospheric Boundary Layer



1. INTRODUCTION

Gradient Wind Engineering Inc. (Gradient Wind) was retained by SerCo Realty Group to undertake a pedestrian level wind (PLW) study to satisfy the requirements for Official Plan Amendment and Zoning By-Law Amendment application submissions for the proposed residential development located at 1400 Bank Street in Ottawa, Ontario (hereinafter referred to as “subject site” or “proposed development”). Our mandate within this study is to investigate pedestrian wind comfort and safety within and surrounding the subject site, and to identify areas where wind conditions may interfere with certain pedestrian activities so that mitigation measures may be considered, where required.

Our work is based on industry standard computer simulations using the computational fluid dynamics (CFD) technique and data analysis procedures, City of Ottawa wind comfort and safety criteria, architectural drawings prepared by Figurr Architects Collective, in September 2021, surrounding street layouts and existing and approved future building massing information obtained from the City of Ottawa, as well as recent satellite imagery.

2. TERMS OF REFERENCE

The subject site is located on the northeast corner of a trapezoidal parcel of land bounded by Bélanger Avenue to the north, Bank Street to the east, Rockingham Avenue to the south, and Clementine Boulevard to the west. The proposed development comprises a trapezoidal 16-storey residential building with two underground parking levels and a mechanical penthouse.



Architectural Rendering, Northwest Perspective (Courtesy of Figurr Architects)

Above two levels of below grade parking, the ground floor of the proposed development comprises a residential lobby and commercial lobby at the northeast corner, commercial spaces along the east elevation, and shared building support spaces throughout the remainder of the level. Access to the underground parking is provided from Bélanger Avenue via a ramp along the west elevation. Level 2 includes office space along the east elevation and residential units along the west elevation. Level 3

provides amenity space along the east elevation and residential units along the west elevation. The remaining levels from 4 through 16 are reserved for residential occupancy. There are setbacks in the floorplate from the east elevation on Levels 3 and 7, and a setback from the west elevation on Level 10. The Mechanical Penthouse Level (Level 17) steps back from the south elevation to accommodate an amenity terrace.

The near-field surroundings (defined as an area within 200 m of the subject site) include a mix of mid- and high-rise massing from the west-northwest clockwise to the north-northwest, and a mix of mostly low- and mid-rise massing for the remaining compass directions. The far-field surroundings (defined as an area beyond the near-field but within a 2-kilometre (km) radius of the subject site) are characterized by a mix of mostly low- and mid-rise buildings with isolated taller buildings for all compass directions. Notably, the Rideau River flows southwest to northeast approximately 750 m to the northwest.

Key areas under consideration include the public sidewalks adjacent to the subject site, building access points, and the common amenity terraces serving the proposed development. Figure 1 illustrates the subject site and surrounding context, while Figures 2A-2D illustrate the computational model used to conduct the study.

3. OBJECTIVES

The principal objectives of this study are to (i) determine pedestrian level wind comfort and safety conditions at key areas within and surrounding the development site; (ii) identify areas where wind conditions may interfere with the intended uses of outdoor spaces; and (iii) recommend suitable mitigation measures, where required.

4. METHODOLOGY

The approach followed to quantify pedestrian wind conditions over the site is based on CFD simulations of wind speeds across the study site within a virtual environment, meteorological analysis of the Ottawa area wind climate, and synthesis of computational data with City of Ottawa wind comfort and safety criteria¹. The following sections describe the analysis procedures, including a discussion of the noted pedestrian wind criteria.

4.1 Computer-Based Context Modelling

A computer based PLW study was performed to determine the influence of the wind environment on pedestrian comfort over the proposed development site. Pedestrian comfort predictions, based on the mechanical effects of wind, were determined by combining measured wind speed data from CFD simulations with statistical weather data obtained from Ottawa Macdonald-Cartier International Airport. The general concept and approach to CFD modelling is to represent building and topographic details in the immediate vicinity of the study site on the surrounding model, and to create suitable atmospheric wind profiles at the model boundary. The wind profiles are designed to have similar mean and turbulent wind properties consistent with actual site exposures.

An industry standard practice is to omit trees, vegetation, and other existing and planned landscape elements from the model due to the difficulty of providing accurate seasonal representation of vegetation. The omission of trees and other landscaping elements produces slightly more conservative (i.e., windier) wind speed values.

¹ City of Ottawa Terms of References: Wind Analysis
https://documents.ottawa.ca/sites/default/files/torwindanalysis_en.pdf

4.2 Wind Speed Measurements

The PLW analysis was performed by simulating wind flows and gathering velocity data over a CFD model of the site for 12 wind directions. The CFD simulation model was centered on the study building, complete with surrounding massing within a radius of approximately 480 m.


Mean and peak wind speed data obtained over the study site for each wind direction were interpolated to 36 wind directions at 10° intervals, representing the full compass azimuth. Measured wind speeds approximately 1.5 m above local grade and the common amenity terrace were referenced to the wind speed at gradient height to generate mean and peak velocity ratios, which were used to calculate full-scale values. Gradient height represents the theoretical depth of the boundary layer of the earth's atmosphere, above which the mean wind speed remains constant. Further details of the wind flow simulation technique are presented in Appendix A.

4.3 Historical Wind Speed and Direction Data

A statistical model for winds in Ottawa was developed from approximately 40 years of hourly meteorological wind data recorded at Ottawa Macdonald-Cartier International Airport and obtained from Environment and Climate Change Canada. Wind speed and direction data were analyzed for each month of the year to determine the statistically prominent wind directions and corresponding speeds, and to characterize similarities between monthly weather patterns.

The statistical model of the Ottawa area wind climate, which indicates the directional character of local winds on a seasonal basis, is illustrated on the following page. The plots illustrate seasonal distribution of measured wind speeds and directions in kilometers per hour (km/h). Probabilities of occurrence of different wind speeds are represented as stacked polar bars in sixteen azimuth divisions. The radial direction represents the percentage of time for various wind speed ranges per wind direction during the measurement period. The preferred wind speeds and directions can be identified by the longer length of the bars. For Ottawa, the most common winds occur for westerly wind directions, followed by those from the east, while the most common wind speeds are below 36 km/h. The directional preference and relative magnitude of wind speed changes somewhat from season to season.

SEASONAL DISTRIBUTION OF WIND OTTAWA MACDONALD-CARTIER INTERNATIONAL AIRPORT

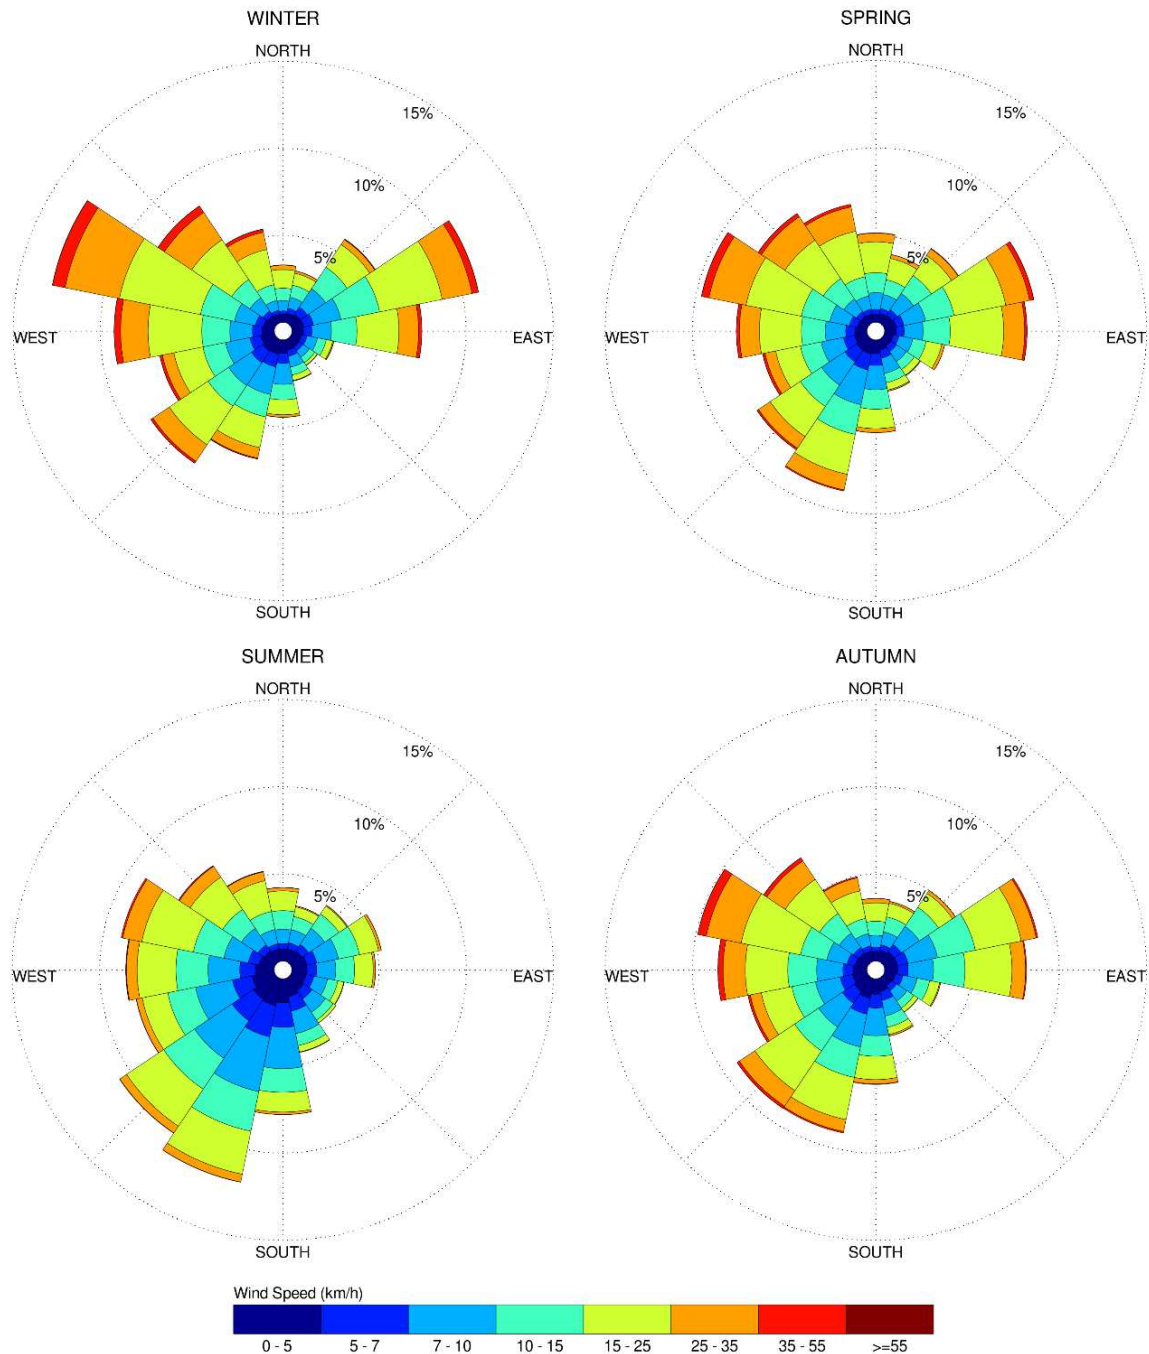

Notes:

1. Radial distances indicate percentage of time of wind events.
2. Wind speeds are mean hourly in km/h, measured at 10 m above the ground.

4.4 Pedestrian Comfort and Safety Criteria – City of Ottawa

Pedestrian comfort and safety criteria are based on the mechanical effects of wind without consideration of other meteorological conditions (i.e., temperature, relative humidity). The comfort criteria assume that pedestrians are appropriately dressed for a specified outdoor activity during any given season. Five pedestrian comfort classes are based on 20% non-exceedance mean wind speed ranges, which include (1) Sitting; (2) Standing; (3) Strolling; (4) Walking; and (5) Uncomfortable. More specifically, the comfort classes and associated mean wind speed ranges are summarized as follows:

- 1) **Sitting:** Mean wind speeds no greater than 10 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 16 km/h.
- 2) **Standing:** Mean wind speeds no greater than 14 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 22 km/h.
- 3) **Strolling:** Mean wind speeds no greater than 17 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 27 km/h.
- 4) **Walking:** Mean wind speeds no greater than 20 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 32 km/h.
- 5) **Uncomfortable:** Uncomfortable conditions are characterized by predicted values that fall below the 80% target for walking. Brisk walking and exercise, such as jogging, would be acceptable for moderate excesses of this criterion.

The pedestrian safety wind speed criterion is based on the approximate threshold that would cause a vulnerable member of the population to fall. A 0.1% exceedance gust wind speed of 90 km/h is classified as dangerous. The gust speeds, and equivalent mean speeds, are selected based on 'The Beaufort Scale', presented on the following page, which describes the effects of forces produced by varying wind speed levels on objects. Gust speeds are included because pedestrians tend to be more sensitive to wind gusts than to steady winds for lower wind speed ranges. For strong winds approaching dangerous levels, this effect is less important because the mean wind can also create problems for pedestrians.

THE BEAUFORT SCALE

Number	Description	Gust Wind Speed (km/h)	Description
2	Light Breeze	9-17	Wind felt on faces
3	Gentle Breeze	18-29	Leaves and small twigs in constant motion; wind extends light flags
4	Moderate Breeze	30-42	Wind raises dust and loose paper; small branches are moved
5	Fresh Breeze	43-57	Small trees in leaf begin to sway
6	Strong Breeze	58-74	Large branches in motion; Whistling heard in electrical wires; umbrellas used with difficulty
7	Moderate Gale	75-92	Whole trees in motion; inconvenient walking against wind
8	Gale	93-111	Breaks twigs off trees; generally impedes progress

Experience and research on people’s perception of mechanical wind effects has shown that if the wind speed levels are exceeded for more than 20% of the time, the activity level would be judged to be uncomfortable by most people. For instance, if a mean wind speed of 10 km/h were exceeded for more than 20% of the time most pedestrians would judge that location to be too windy for sitting. Similarly, if mean wind speed of 20 km/h at a location were exceeded for more than 20% of the time, walking or less vigorous activities would be considered uncomfortable. As these criteria are based on subjective reactions of a population to wind forces, their application is partly based on experience and judgment.

Once the pedestrian wind speed predictions have been established throughout the site, the assessment of pedestrian comfort involves determining the suitability of the predicted wind conditions for discrete regions within and surrounding the subject site. This step involves comparing the predicted comfort classes to the desired comfort classes, which are dictated by the location type for each region (i.e., a sidewalk, building entrance, amenity space, or other). An overview of common pedestrian location types and their desired comfort classes are summarized on the following page.

DESIRED PEDESTRIAN COMFORT CLASSES FOR VARIOUS LOCATION TYPES

Location Types	Desired Comfort Classes
Primary Building Entrance	Standing
Secondary Building Access Point	Standing / Strolling / Walking
Primary Public Sidewalk	Strolling / Walking
Secondary Public Sidewalk / Bicycle Path	Walking
Outdoor Amenity Space	Sitting / Standing / Strolling
Café / Patio / Bench / Garden	Sitting
Transit Stop	Sitting / Standing
Public Park / Plaza	Standing / Strolling
Garage / Service Entrance	Walking
Parking Lot	Strolling / Walking
Vehicular Drop-Off Zone	Standing / Strolling / Walking

5. RESULTS AND DISCUSSION

The following discussion of predicted pedestrian wind conditions is accompanied by Figures 3A-3D illustrating seasonal wind comfort conditions at grade level, as well as by Figures 4A-4D illustrating seasonal wind conditions over the common amenity terrace serving the proposed development. Conditions are presented as continuous contours of wind comfort within and surrounding the subject site. The colour contours indicate predicted regions of the various comfort classes noted in Section 4.4. Conditions suitable for sitting are represented by the colour blue, standing by green, strolling by yellow, and walking by orange; uncomfortable conditions are represented by the colour magenta.

Wind conditions over the amenity terrace are also reported for the typical use period, which is defined as May to October, inclusive. Figure 5A illustrates wind comfort conditions during this period, consistent with the comfort classes in Section 4.4, while Figure 5B illustrates contours indicating the percentage of time the noted areas are predicted to be suitable for sitting. Pedestrian conditions are summarized in the following pages for each area of interest.

5.1 Wind Comfort Conditions – Grade Level

The sidewalks and walkways adjacent to the proposed development, including the Bank Street and Bélanger Avenue sidewalks, are predicted to be suitable for a mix of sitting and standing during the summer season, becoming suitable for a mix of mostly standing and strolling during the spring and autumn, and suitable for a mix of strolling and walking during the winter, with the walking conditions being located along the Bélanger Avenue sidewalk. The noted wind conditions are considered acceptable according to the City of Ottawa wind criteria.

In the vicinity of the nearby transit stop along Bank Street, conditions are predicted to be suitable for sitting during the summer, becoming suitable for standing throughout the remainder of the year. The noted conditions are considered acceptable according to the City of Ottawa wind criteria.

In the vicinity of the nearby transit stop along Bélanger Avenue, conditions are predicted to be suitable for a mix of sitting and standing during the summer, becoming suitable for standing during the autumn, and suitable for a mix of standing and strolling during the spring and winter. Since the majority of the space near the transit stop is suitable for standing, and since pedestrians are free to relocate to these calmer locations in the vicinity of the transit stop during periods of strong wind activity, the noted conditions may be considered satisfactory.

Owing to the protection of the building façades, conditions in the vicinity of the building access points serving the proposed development, as well as those serving the adjacent existing buildings, are predicted to be suitable for sitting during the summer, becoming suitable for standing, or better, throughout the remainder of the year. The noted wind conditions are considered acceptable according to the City of Ottawa wind criteria in Section 4.4.

5.2 Wind Comfort Conditions – Common Amenity Terrace

Wind conditions within the common amenity terrace serving Level 17 are predicted to be suitable for a mix of sitting and standing during the typical use period as illustrated in Figure 5A. Specifically, conditions over the majority of the terrace are predicted to be suitable for sitting at least 75% of the time, with an isolated region near the southwest corner of the terrace predicted to be suitable for sitting at least 65% of the time, where the target for seating areas is 80% of the time. To extend sitting conditions over the

full terrace, it is recommended that a tall wind barrier, typically glazed and rising at least 1.8 m above the walking surface, be installed around the perimeter of the terrace in place of typical height guards. In-board barriers may also be required within the southwest corner of the terrace.

5.3 Wind Safety

Within the context of typical weather patterns, which exclude anomalous localized storm events such as tornadoes and downbursts, no pedestrian areas within and surrounding the subject site were found to experience conditions that could be considered dangerous, as defined in Section 4.4.

5.4 Applicability of Results

Wind conditions over surrounding sidewalks beyond the subject site, as well as at nearby primary building entrances, will be acceptable for their intended pedestrian uses during each seasonal period upon the introduction of the subject site. Pedestrian wind comfort and safety have been quantified for the specific configuration of existing and foreseeable construction around the study site. Future changes (i.e., construction or demolition) of these surroundings may cause changes to the wind effects in two ways, namely: (i) changes beyond the immediate vicinity of the site would alter the wind profile approaching the site; and (ii) development in proximity to the site would cause changes to local flow patterns. For example, development in urban centres generally creates reduction in the mean wind speeds and localized increases in the gustiness of the wind.

Regarding primary and secondary building access points, wind conditions predicted in this study are only applicable to pedestrian comfort and safety. As such, the results should not be construed to indicate wind loading on doors and associated hardware.

6. CONCLUSIONS AND RECOMMENDATIONS

A complete summary of the predicted wind conditions is provided in Section 5 and illustrated in Figures 3A-5B. Based on computer simulations using the CFD technique, meteorological data analysis of the Ottawa wind climate, City of Ottawa wind comfort and safety criteria, and experience with numerous similar developments, the study concludes the following:

- 1) All grade-level areas within and surrounding the subject site are predicted to be acceptable for the intended pedestrian uses throughout the year. Specifically, wind conditions over the surrounding sidewalks and walkways, transit stops, parking lots, and building access points, are considered acceptable for the intended pedestrian uses throughout the year. The only exception is as follows:
 - a. In the vicinity of the nearby transit stop along Bélanger Avenue, conditions are predicted to be suitable for mix of standing and strolling during the spring and winter. Since the majority of the space near the transit stop is suitable for standing, and since pedestrians are free to relocate to these calmer locations in the vicinity of the transit stop during periods of strong wind activity, the noted conditions may be considered satisfactory.
- 2) To extend sitting conditions over the full amenity terrace at Level 17, it is recommended that a tall wind barrier, typically glazed and rising at least 1.8 m above the walking surface, be installed around the perimeter of the terrace in place of typical height guards. In-board barriers may also be required within the southwest corner of the terrace. Mitigation strategies will be developed and confirmed in collaboration with the design team for the future Site Plan Control application.
- 3) Within the context of typical weather patterns, which exclude anomalous localized storm events such as tornadoes and downbursts, no pedestrian areas within and surrounding the subject site were found to experience conditions that could be considered dangerous.

Sincerely,

Gradient Wind Engineering Inc.




David Huitema, M.Eng.
Junior Wind Scientist



Steven Hall, M.A.Sc., P.Eng.
Senior Wind Engineer



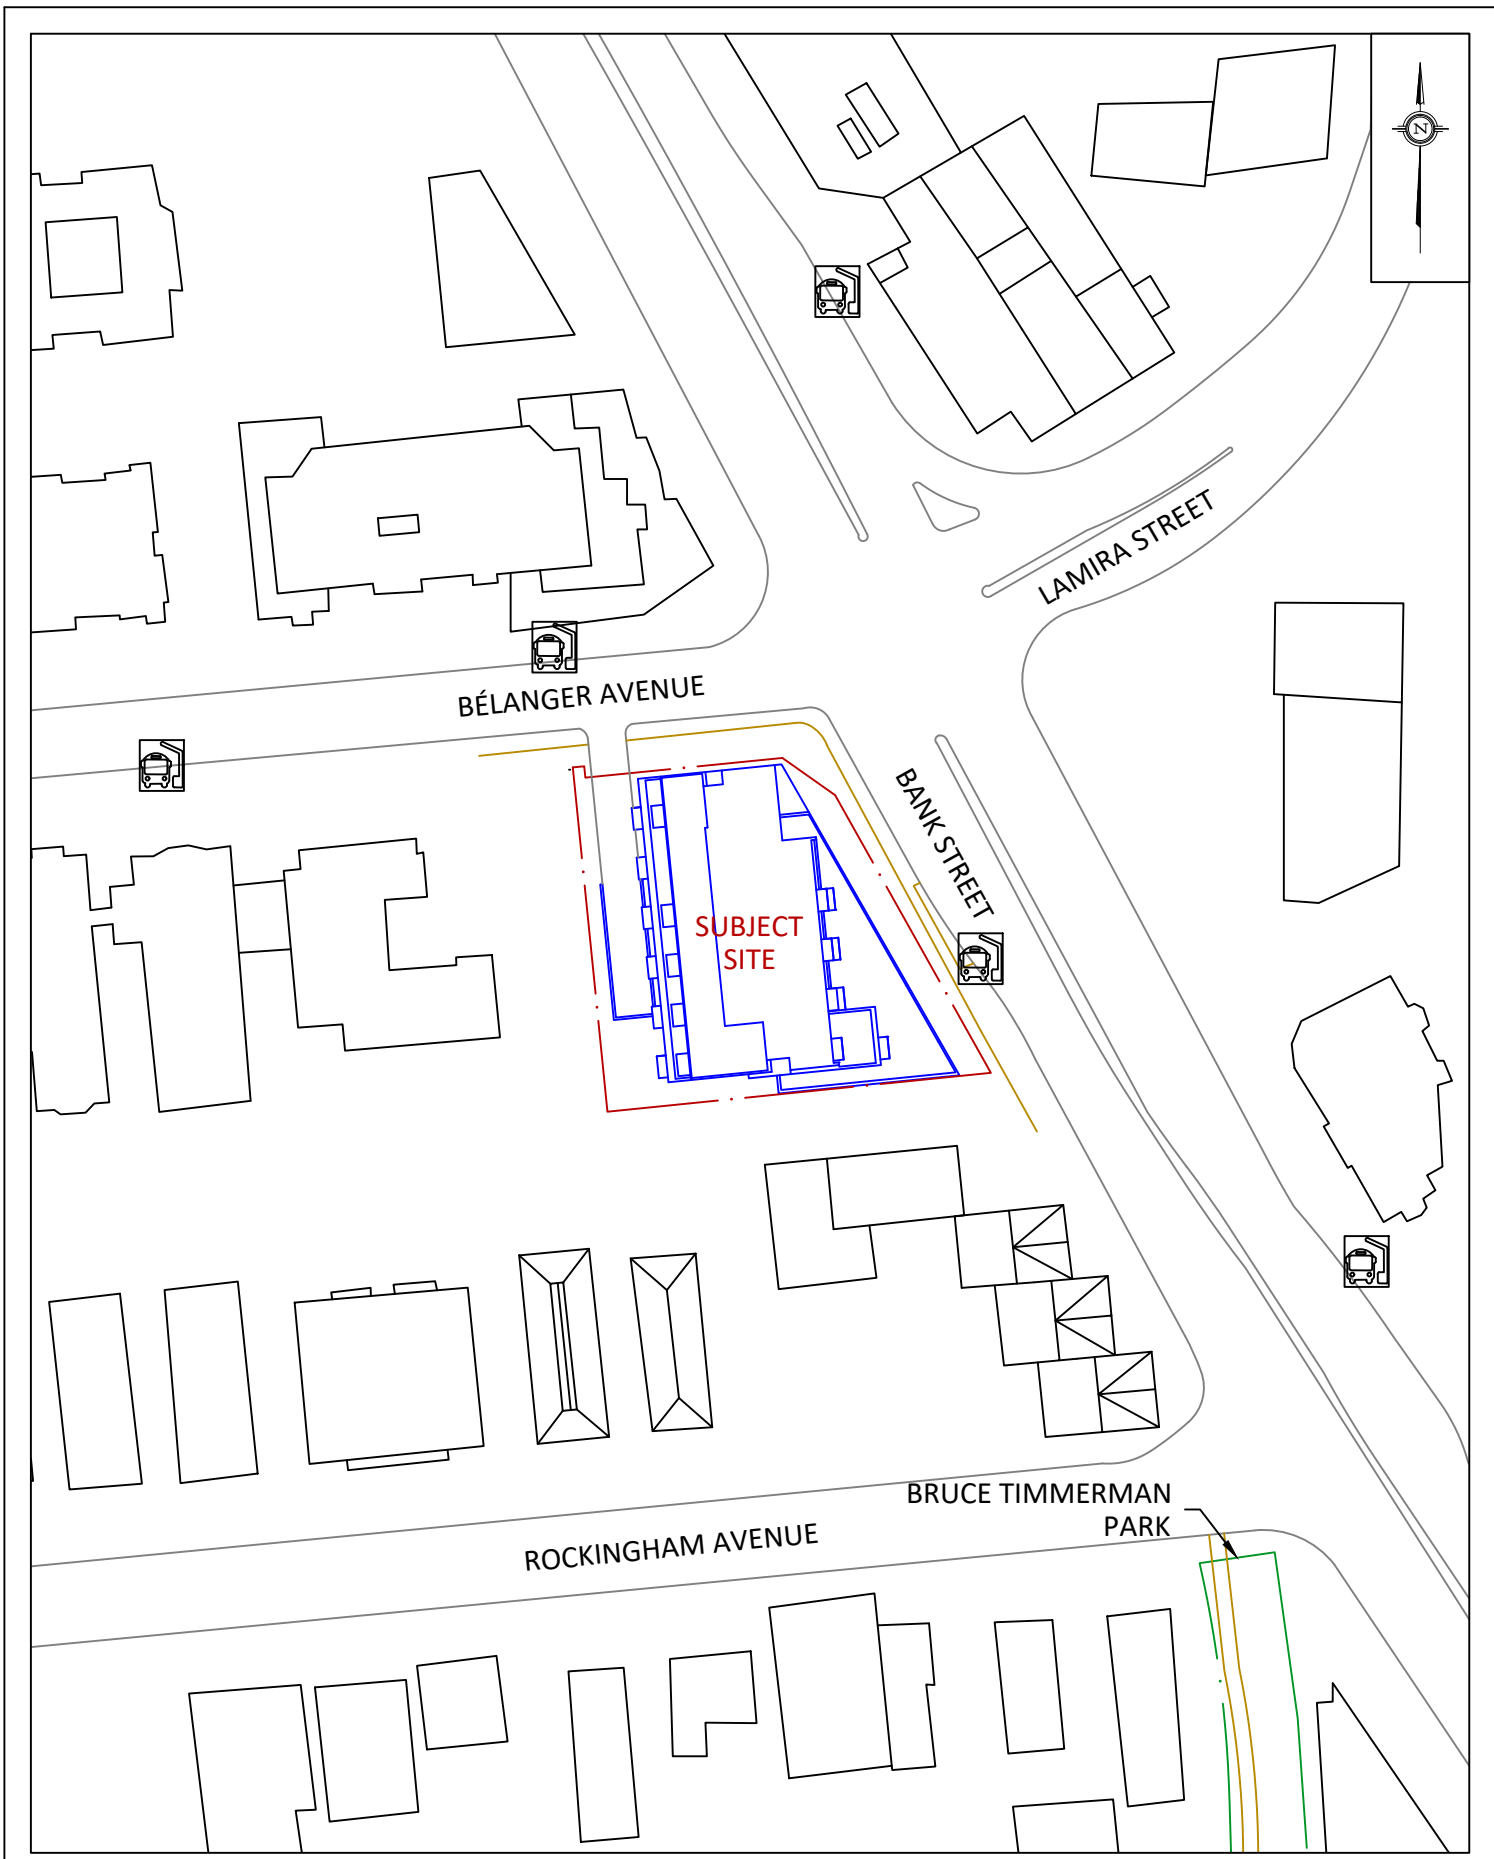

GRADIENTWIND ENGINEERS & SCIENTISTS 127 WALGREEN ROAD, OTTAWA, ON 613 836 0934 • GRADIENTWIND.COM	PROJECT	1400 BANK STREET, OTTAWA PEDESTRIAN LEVEL WIND STUDY		DESCRIPTION	FIGURE 1: SITE PLAN AND SURROUNDING CONTEXT
	SCALE	1:1000	DRAWING NO.	21-282-PLW-1	
	DATE	OCTOBER 27, 2021	DRAWN BY	N.M.P.	

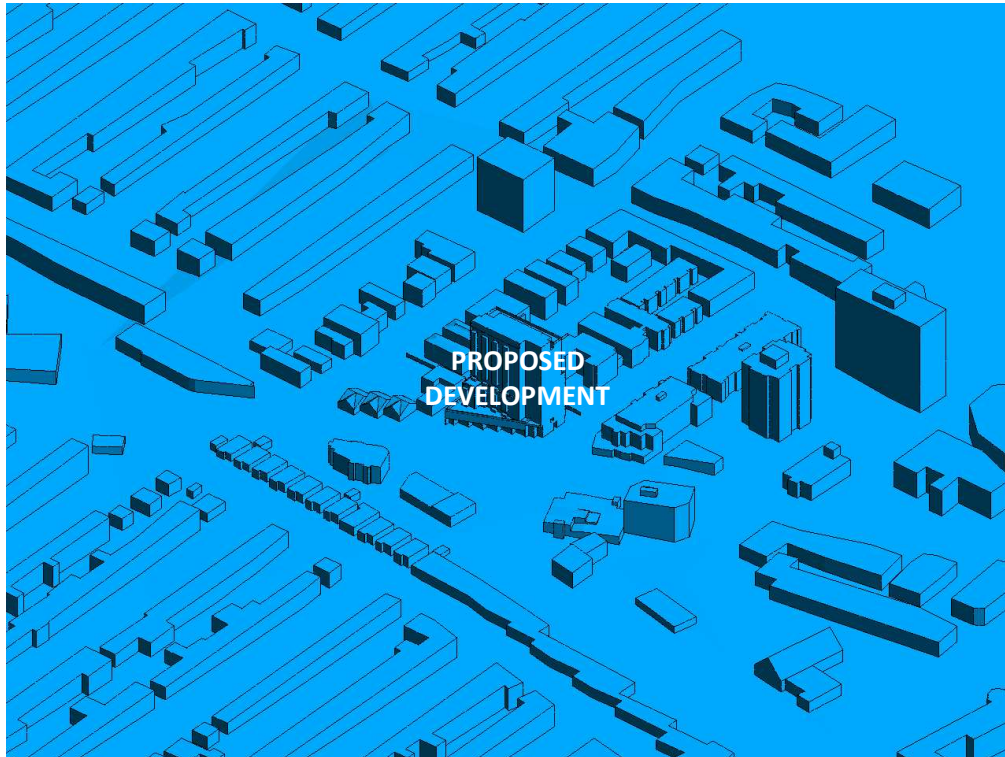


FIGURE 2A: COMPUTATIONAL MODEL, NORTHEAST PERSPECTIVE

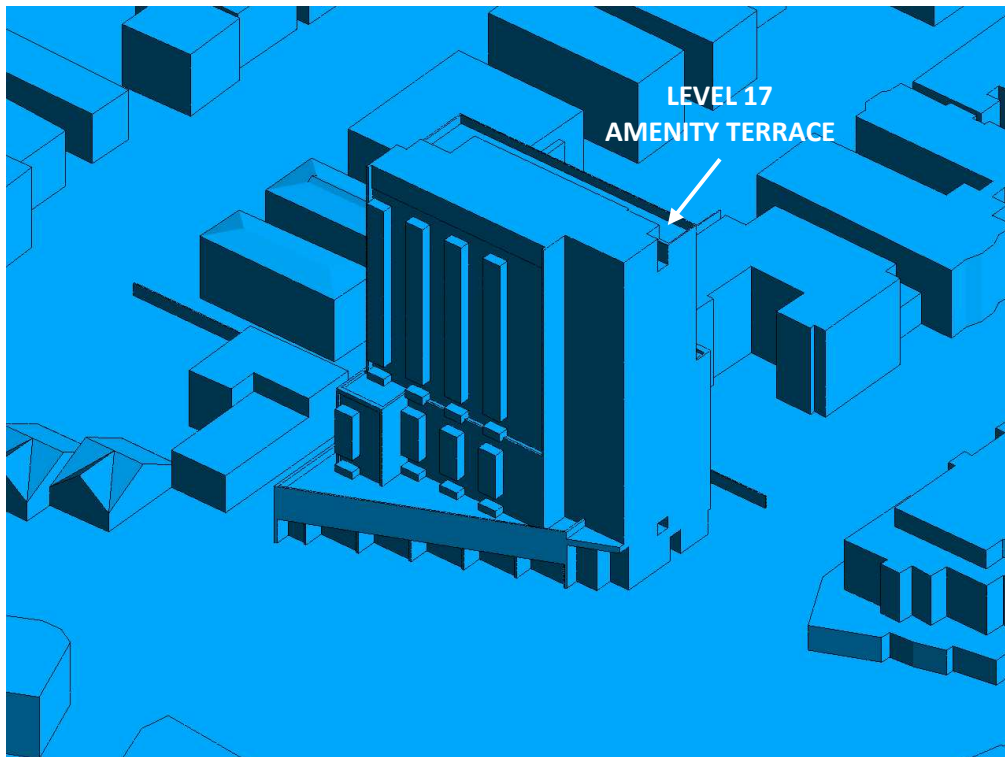


FIGURE 2B: CLOSE UP OF FIGURE 2A



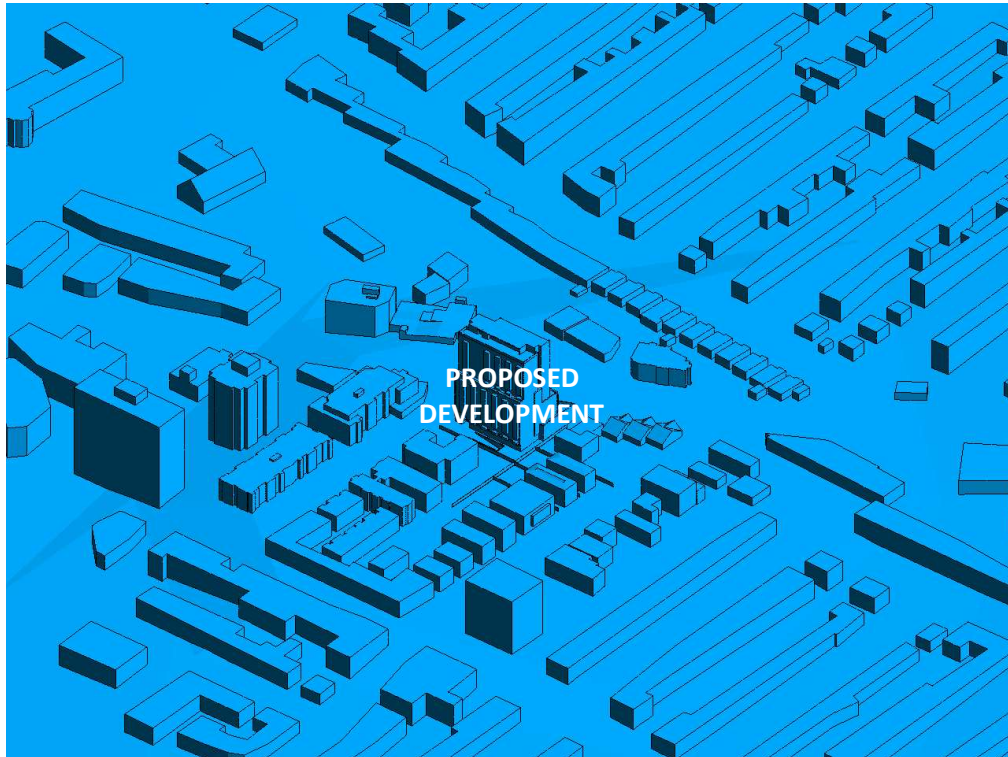


FIGURE 2C: COMPUTATIONAL MODEL, SOUTHWEST PERSPECTIVE

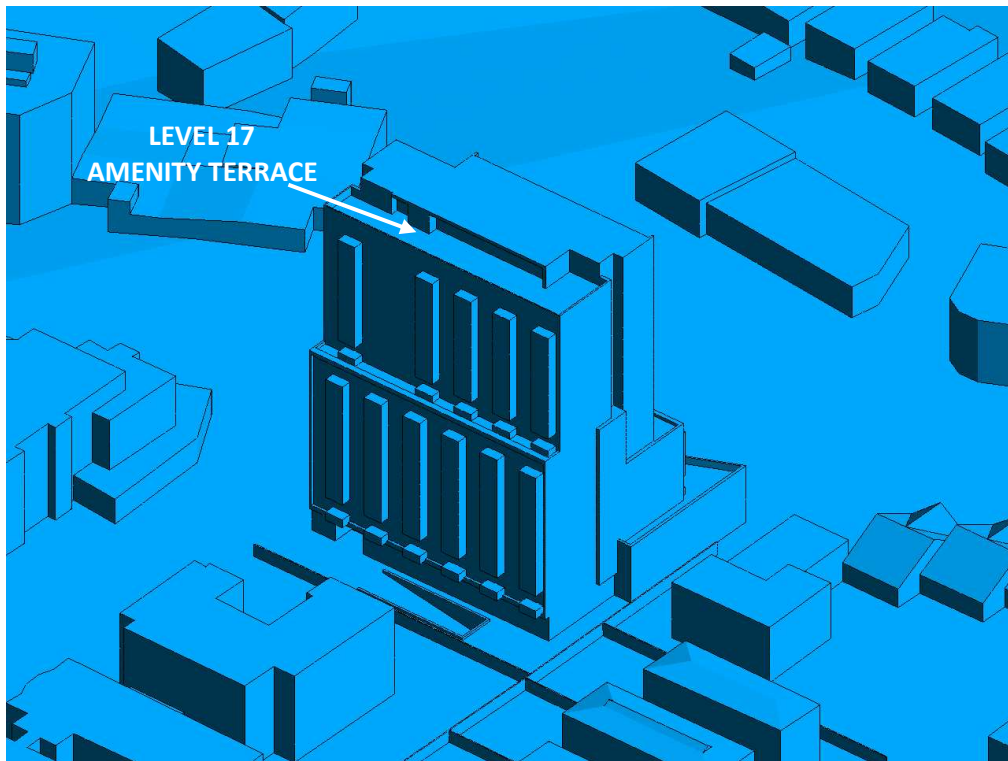


FIGURE 2D: CLOSE UP OF FIGURE 2C



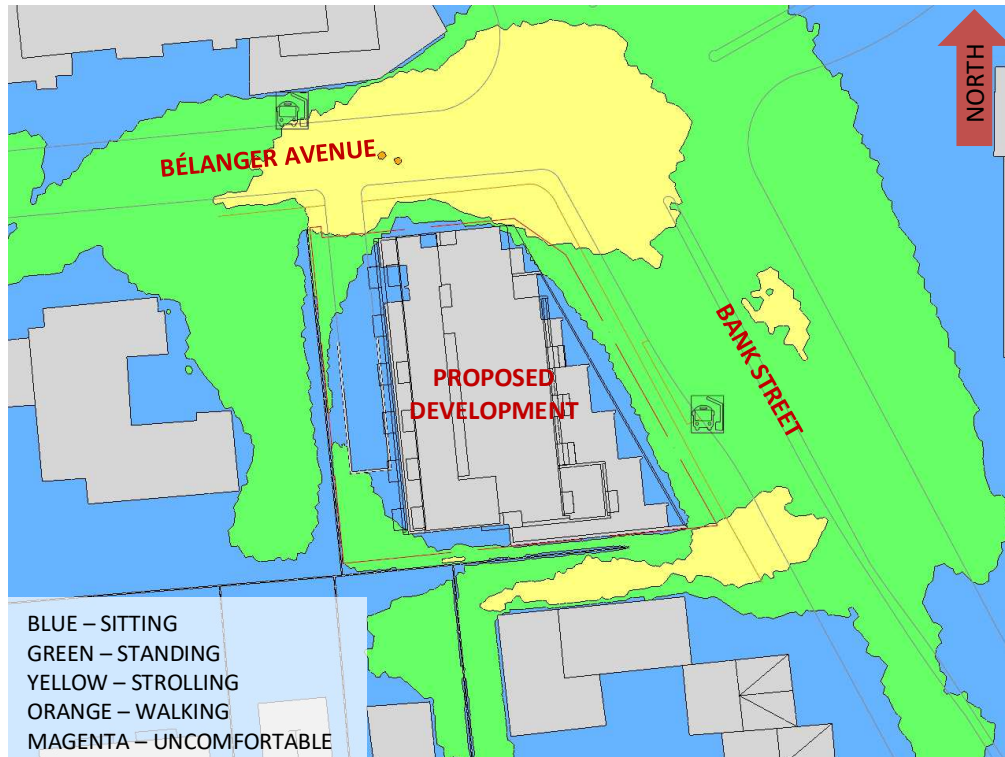


FIGURE 3A: SPRING – WIND COMFORT, GRADE LEVEL

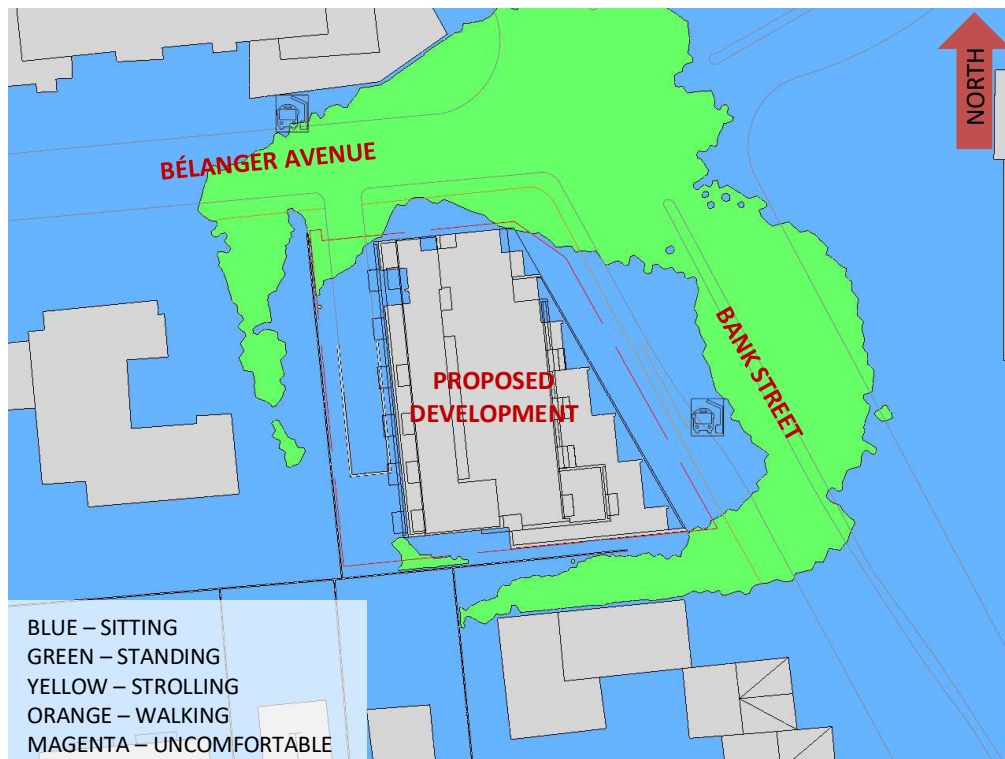


FIGURE 3B: SUMMER – WIND COMFORT, GRADE LEVEL



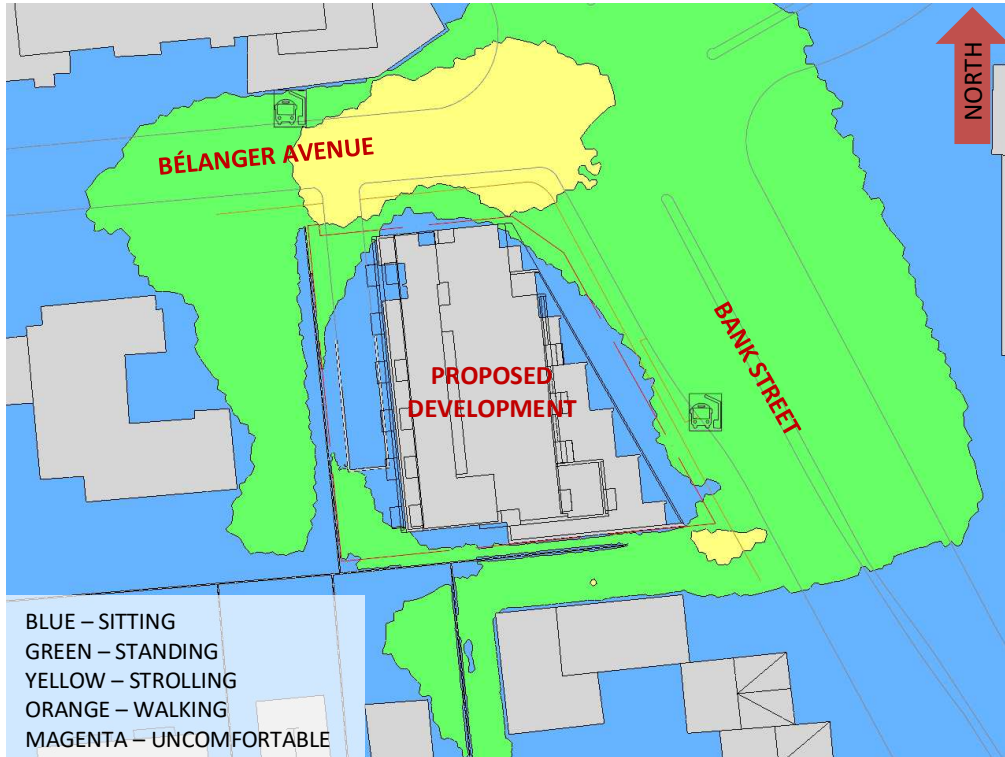


FIGURE 3C: AUTUMN – WIND COMFORT, GRADE LEVEL

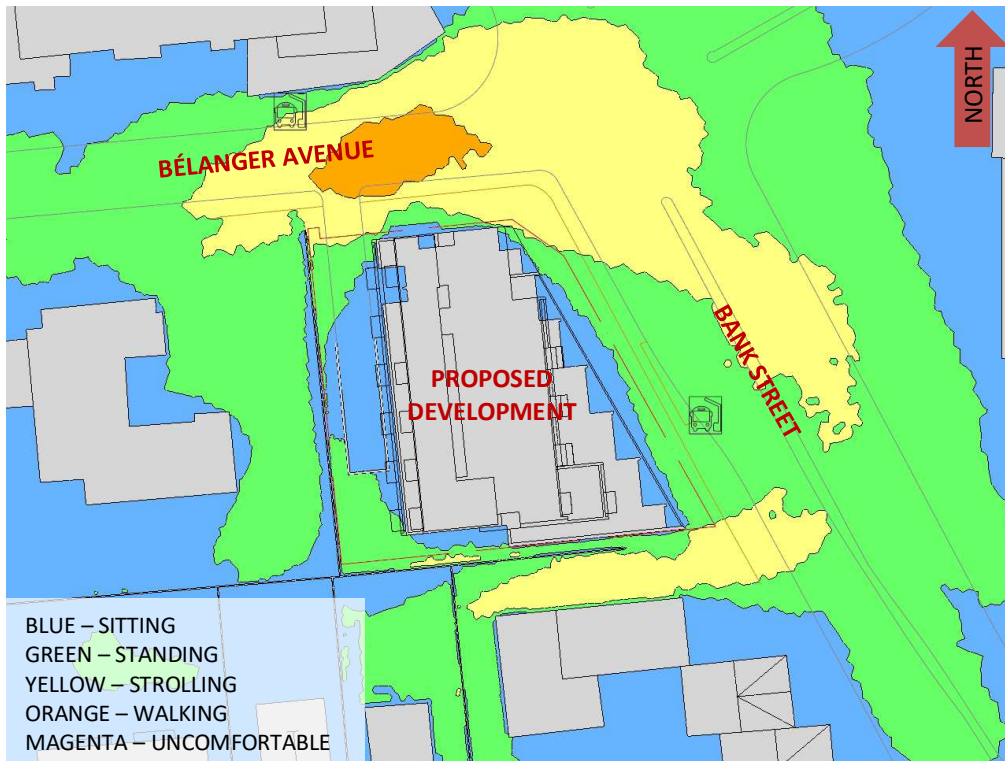


FIGURE 3D: WINTER – WIND COMFORT, GRADE LEVEL





FIGURE 4A: SPRING – WIND COMFORT, LEVEL 17 AMENITY TERRACE

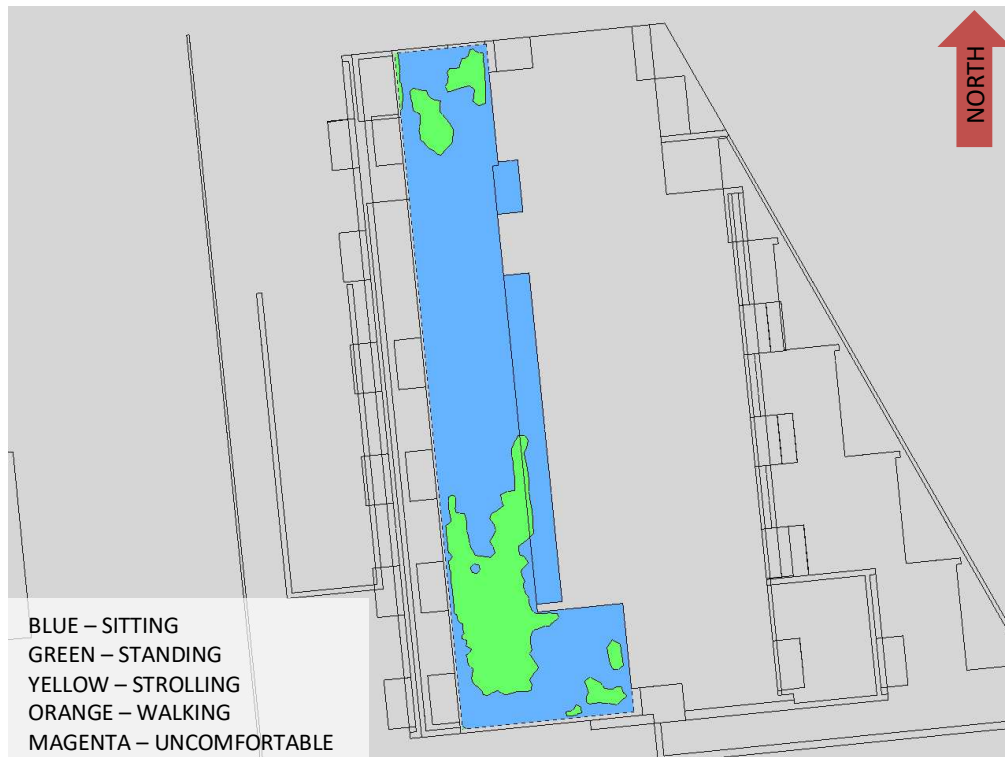


FIGURE 4B: SUMMER – WIND COMFORT, LEVEL 17 AMENITY TERRACE

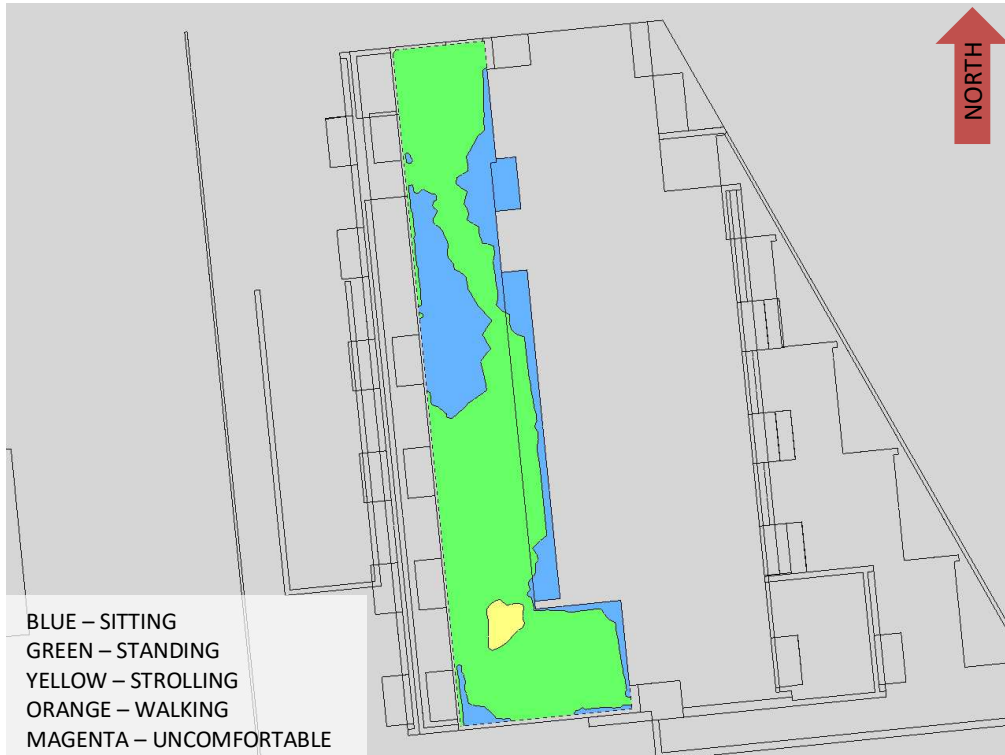


FIGURE 4C: AUTUMN – WIND COMFORT, LEVEL 17 AMENITY TERRACE



FIGURE 4D: WINTER – WIND COMFORT, LEVEL 17 AMENITY TERRACE

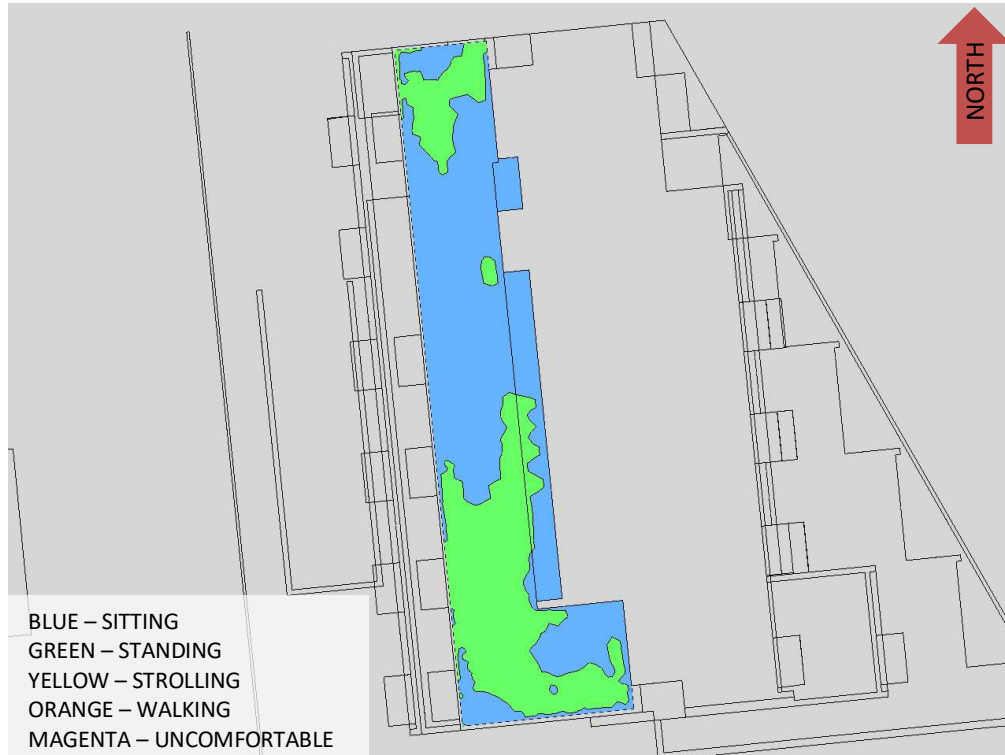


FIGURE 5A: TYPICAL USE PERIOD – WIND COMFORT, LEVEL 17 AMENITY TERRACE


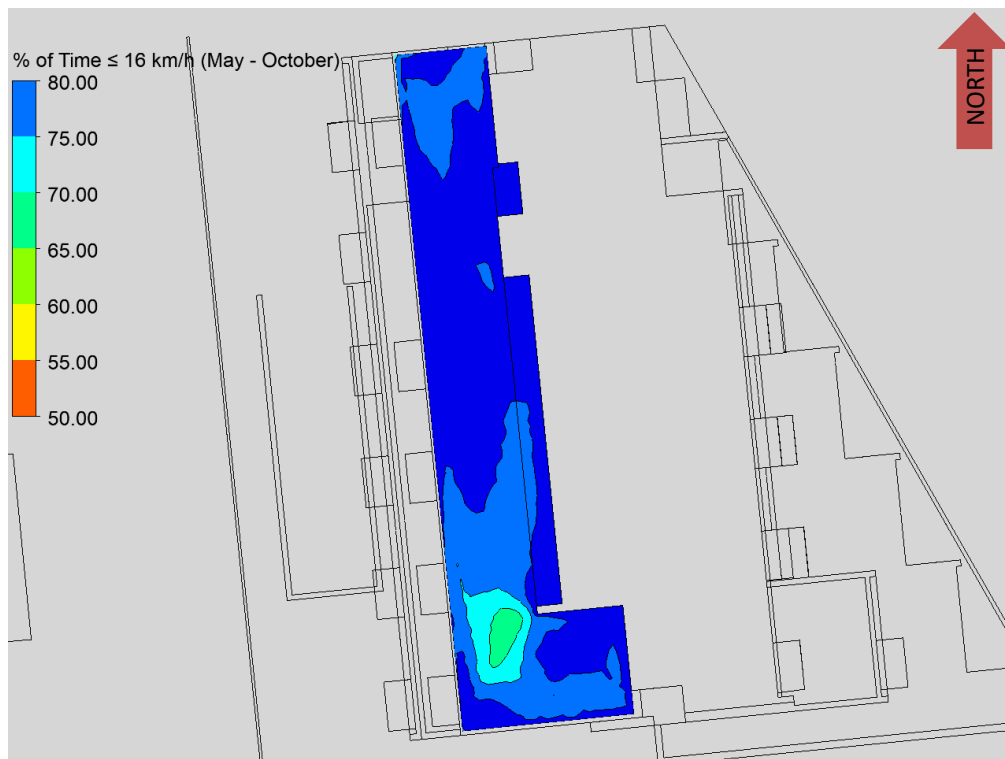


FIGURE 5B: TYPICAL USE PERIOD – % OF TIME SUITABLE FOR SITTING, AMENITY TERRACE



GRADIENTWIND

ENGINEERS & SCIENTISTS

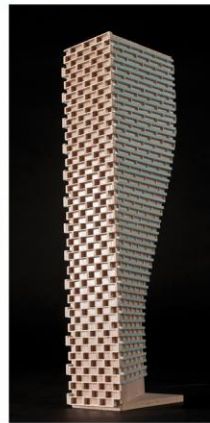

APPENDIX A

SIMULATION OF THE ATMOSPHERIC BOUNDARY LAYER

SIMULATION OF THE ATMOSPHERIC BOUNDARY LAYER

The atmospheric boundary layer (ABL) is defined by the velocity and turbulence profiles according to industry standard practices. The mean wind profile can be represented, to a good approximation, by a power law relation, Equation (1), giving height above ground versus wind speed (1), (2).

$$U = U_g \left(\frac{Z}{Z_g} \right)^\alpha \quad \text{Equation (1)}$$

where, U = mean wind speed, U_g = gradient wind speed, Z = height above ground, Z_g = depth of the boundary layer (gradient height), and α is the power law exponent.

For the model, U_g is set to 6.5 metres per second (m/s), which approximately corresponds to the 60% mean wind speed for Ottawa based on historical climate data and statistical analyses. When the results are normalized by this velocity, they are relatively insensitive to the selection of gradient wind speed.

Z_g is set to 540 m. The selection of gradient height is relatively unimportant, so long as it exceeds the building heights surrounding the subject site. The value has been selected to correspond to our physical wind tunnel reference value.

α is determined based on the upstream exposure of the far-field surroundings (i.e., the area that it not captured within the simulation model).

Table 1 presents the values of α used in this study, while Table 2 presents several reference values of α . When the upstream exposure of the far-field surroundings is a mixture of multiple types of terrain, the α values are a weighted average with terrain that is closer to the subject site given greater weight.

TABLE 1: UPSTREAM EXPOSURE (ALPHA VALUE) VS TRUE WIND DIRECTION

Wind Direction (Degrees True)	Alpha Value (α)
0	0.24
49	0.24
74	0.24
103	0.23
167	0.23
197	0.22
217	0.22
237	0.23
262	0.22
282	0.23
301	0.24
324	0.25

TABLE 2: DEFINITION OF UPSTREAM EXPOSURE (ALPHA VALUE)

Upstream Exposure Type	Alpha Value (α)
Open Water	0.14-0.15
Open Field	0.16-0.19
Light Suburban	0.21-0.24
Heavy Suburban	0.24-0.27
Light Urban	0.28-0.30
Heavy Urban	0.31-0.33

The turbulence model in the computational fluid dynamics (CFD) simulations is a two-equation shear-stress transport (SST) model, and thus the ABL turbulence profile requires that two parameters be defined at the inlet of the domain. The turbulence profile is defined following the recommendations of the Architectural Institute of Japan for flat terrain (3).

$$I(Z) = \begin{cases} 0.1 \left(\frac{Z}{Z_g} \right)^{-\alpha-0.05}, & Z > 10 \text{ m} \\ 0.1 \left(\frac{10}{Z_g} \right)^{-\alpha-0.05}, & Z \leq 10 \text{ m} \end{cases} \quad \text{Equation (2)}$$

$$L_t(Z) = \begin{cases} 100 \text{ m} \sqrt{\frac{Z}{30}}, & Z > 30 \text{ m} \\ 100 \text{ m}, & Z \leq 30 \text{ m} \end{cases} \quad \text{Equation (3)}$$

where, I = turbulence intensity, L_t = turbulence length scale, Z = height above ground, and α is the power law exponent used for the velocity profile in Equation (1).

Boundary conditions on all other domain boundaries are defined as follows: the ground is a no-slip surface; the side walls of the domain have a symmetry boundary condition; the top of the domain has a specified shear, which maintains a constant wind speed at gradient height; and the outlet has a static pressure boundary condition.

REFERENCES

- [1] P. Arya, "Chapter 10: Near-neutral Boundary Layers," in *Introduction to Micrometeorology*, San Diego, California, Academic Press, 2001.
- [2] S. A. Hsu, E. A. Meindl and D. B. Gilhousen, "Determining the Power-Law Wind Profile Exponent under Near-neutral Stability Conditions at Sea," vol. 33, no. 6, 1994.
- [3] Y. Tamura, H. Kawai, Y. Uematsu, K. Kondo and T. Okhuma, "Revision of AIJ Recommendations for Wind Loads on Buildings," in *The International Wind Engineering Symposium, IWES 2003*, Taiwan, 2003.