

APPROVED BY CITY FORESTRY STAFF PRIOR TO THE COMMENCEMENT OF WORK. 5. IF THE FENCED TREE PROTECTION AREA MUST BE REDUCED TO FACILITATE CONSTRUCTION, MITIGATION MEASURES MUST BE PRESCRIBED BY AN ARBORIST AND APPROVED BY CITY FORESTRY STAFF. THESE MAY INCLUDE THE PLACEMENT OF PLYWOOD, WOOD

6 TREE PROTECTION FENCE L.1 / SCALE NTS

GENERAL NOTES:

CONSTRUCTION

UNDERGROUND SERVICES.

ARCHITECT PRIOR TO EXCAVATION.

9.1. BUILDING FOUNDATIONS - 7.5M

9.4. UNDERGROUND INFRASTRUCTURE - 2.0M

EXISTING TREE LIST

KEY QTY. BOTANICAL NAME

AC 1 Amelanchier canadensis

5 Hosta 'Guacamole

___x ___x ___x ___x

└─x──x──x──x

TREE PROTECTION REQUIREMENTS:

PLAN VIEW - NTS

CRZ IS TO BE MEASURED FROM

HE OUTSIDE EDGE OF THE TREE BASE

PROTECTION SIGNAGE AS PER

CITY STANDARD

38 Hemerocallis 'Pandora's Box'

9 Hemerocallis 'Stella D'Oro'

Sa 1 Spiraea x arguta

PERENNIALS/ GRASSES

Acer negundo

Acer negundo

Ulmus americana

Thuja occidentalis 'Fastigiata'

Ah 10 *Hydrangea arborescens* 'Annabelle' Annabelle Hydrangea

12. STAKING OF TREES SHALL ONLY BE PERFORMED IF NECESSARY.

9.2. SIDEWALKS - 1.5M

9.3. PUBLIC STREETS - 2.5M

3. THE CONTRACTOR IS TO REINSTATE ALL AREAS AND ITEMS DAMAGED AS A RESULT OF CONSTRUCTION ACTIVITY.

4. THE CONTRACTOR IS TO COMPLY WITH ALL PERTINENT CODES AND BY-LAWS.

9. MINIMUM DISTANCES FOR SELECTED DECIDUOUS TREES ARE AS FOLLOWS:

11. REMOVE ALL PROTECTIVE WRAPPING FROM TREE TRUNKS AFTER INSTALLATION.

6. THE LANDSCAPE ARCHITECT IS NOT RESPONSIBLE FOR SUBSURFACE CONDITIONS.

10. ALL TREES WITHIN 1M OF UNDERGROUND UTILITY TRENCHES ARE TO BE EXCAVATED BY HAND.

13. ENSURE THAT MULCH IS PULLED BACK A MINIMUM DISTANCE OF 75MM FROM BASE OF TREE TRUNK.

COMMON NAME

Sugar Maple

Manitoba Maple

Manitoba Maple

Pyramidal Cedar

American Elm

COMMON NAME

Garland Spirea

Guacamole Hosta

Stella D'Oro Day Lily

SOIL AND ROOT DISTURBANCE NOT PERMITTED

FOR THE SITE.(E.G. TREE CONSERVATION REPORT, TREE DISCLOSURE REPORT, ETC). THE PLAN AND CONSTRUCTED FENCING MUST BE

BE INSTALLED SURROUNDING THE CRITICAL ROOT ZONE AND REMAIN IN PLACE UNTIL THE WORK IS COMPLETE.

- ENSURE THAT EXHAUST FUMES FROM ALL EQUIPMENT ARE NOT DIRECTED TOWARD ANY TREE CANOPY.

2. UNLESS PLANS ARE APPROVED BY CITY FORESTRY STAFF, FOR WORK WITHIN THE CRZ:

- DO NOT PLACE ANY MATERIAL OR EQUIPMENT INCLUDING OUTHOUSES;

- DO NOT DAMAGE THE ROOT SYSTEM, TRUNK, OR BUNCHES OR ANY TREE;

- DO NOT EXTEND HARD SURFACE OR SIGNIFICANTLY CHANGE LANDSCAPING

- DO NOT ATTACH ANY SIGNS, NOTICES OR POSTERS TO ANY TREE;

- DO NOT RAISE OR LOWER THE EXISTING GRADE;

- TUNNEL OR BORE WHEN DIGGING;

MINIMISE DAMAGE TO EXISTING ROOTS. (SEE DETAIL)

TREE PROTECTION

TREE TRUNK

SIZE

150mm dbh

330mm dbh

150mm dbh

430mm dbh

SIZE

3 gal pot

800 mm Spr.

gallon pot

150mm pot

300-510mm dbh

QTY. KEY SIZE

CONDITION

FAIR-GOOD


GOOD

GOOD

CONDITION

BY-LAWS:

THE URBAN AREA,

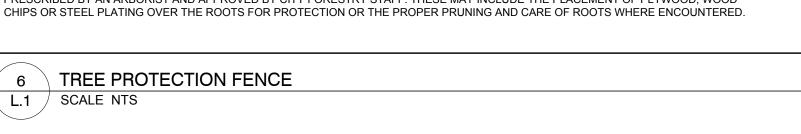

AS PER SECTION 75 OF THE

'TREE PROTECTION BY-LAW'

MITIGATION MEASURES WILL

PLYWOOD, WOOD CHIPS OR

STEEL PLATING OVER THE

THEY ARE ENCOUNTERED.

INCLUDE 'THE PLACEMENT OF

ROOTS; THE PROPER PRUNING

AND CARE FOR ROOTS WHERE

AREA IN RED TO EXCAVATED BY

EXISTING TREES ON—

REMAIN

L.1 / SCALE 1:100

ADJACENT PRIVATE

PROPERTY AND CITY TO

PROJECT NORTH

PRAWING NO.