

**PEDESTRIAN LEVEL  
WIND STUDY**

Baseline Tower Phase 4-6  
Ottawa, Ontario

Report: 21-424-PLW-2023



April 26, 2023

PREPARED FOR

Brigil

98, rue Lois

Gatineau, QC J8Y 3R7

PREPARED BY

Sunny Kang, B.A.S., Project Coordinator

Daniel Davalos, M.E.Sc., Junior Wind Scientist

Justin Ferraro, P.Eng., Principal

## EXECUTIVE SUMMARY

This report describes a pedestrian level wind (PLW) study undertaken to satisfy Site Plan Control application requirements for the proposed multi-phased development, referred to as “Baseline Tower Phase 4-6”, located at the intersection of Baseline Road and Sandcastle Drive in Ottawa, Ontario (hereinafter referred to as “subject site” or “proposed development”). Our mandate within this study is to investigate pedestrian wind conditions within and surrounding the subject site, and to identify areas where wind conditions may interfere with certain pedestrian activities so that mitigation measures may be considered, where required.

The study involves simulation of wind speeds for selected wind directions in a three-dimensional (3D) computer model using the computational fluid dynamics (CFD) technique, combined with meteorological data integration, to assess pedestrian wind conditions within and surrounding the subject site according to City of Ottawa wind comfort and safety criteria. The results and recommendations derived from these considerations are detailed in the main body of the report (Section 5), illustrated in Figures 3A-10, and summarized as follows:

- 1) All grade-level areas within and surrounding the subject site are predicted to experience conditions that are considered acceptable for the intended pedestrian uses throughout the year. Specifically, conditions over surrounding sidewalks, transit stops, existing eastern laneway, surface parking, existing parking lots, proposed laneways and drop-off area, and in the vicinity of building access points, are considered acceptable. Exceptions are as follows:
  - a. Wind conditions during the typical use period over the public park are predicted to be suitable for sitting to the north and near the southeast corner with standing conditions throughout the remainder of the area, and conditions during the same period over the semi-public plaza are predicted to be suitable for sitting to the south and at the northwest corner with standing conditions throughout the remainder of the area.
  - b. Notably, the 4 m landscaping buffer included in the provided site plan along the west perimeter of the public park, which could not be implemented in the simulation model (that is, clusters of dense trees), as described in Section 4.1, will help to improve wind



comfort conditions. Comfort levels over the noted areas may be further improved by implementing landscaping features such as wind screens or coniferous plantings in dense arrangements around sensitive areas.

- c. The extent of the mitigation measures is dependent on the programming of the area. An appropriate mitigation strategy will be developed in collaboration with the building and landscape architects as the design of the proposed development progresses.
- 2) The common amenity terraces serving the proposed development were modelled with 1.8-m-tall wind screens along their full perimeters. Wind comfort conditions and recommendations regarding further mitigation, if required, are described as follows:
- a. **Phase 4, Level 2 Daycare Playground Terrace:** With the noted wind mitigation, wind comfort conditions are predicted to be suitable for sitting throughout the year. The noted conditions are considered acceptable.
  - b. **Phases 5 and 6, Level 7 Common Amenity Terrace:** With the noted wind mitigation, and as illustrated in Figure 10, wind comfort conditions during the typical use period are predicted to be suitable for sitting close to the tower elevations and standing throughout the remainder of the area, with an isolated region suitable for strolling to the north of Phase 5.
  - c. To improve comfort levels within the Level 7 amenity terrace serving Phases 5 and 6, it is recommended to include taller wind screens along the full perimeter of the terrace. Specifically, 2.4-m-tall wind screens, glazed and solid, are recommended. Additionally, mitigation inboard of the perimeter, which could take the form of 1.8-m-tall wind screens or clusters of coniferous trees located around sensitive areas, and canopies located above designated seating areas, are recommended to further improved wind comfort conditions within the terrace.
  - d. The extent of the mitigation measures is dependent on the programming of the area. An appropriate mitigation strategy will be developed in collaboration with the building and landscape architects as the design of the proposed development progresses.

- 3) The foregoing statements and conclusions apply to common weather systems, during which no dangerous wind conditions, as defined in Section 4.4, are expected anywhere over the subject site. During extreme weather events, (for example, thunderstorms, tornadoes, and downbursts), pedestrian safety is the main concern. However, these events are generally short-lived and infrequent and there is often sufficient warning for pedestrians to take appropriate cover.

**Addendum:** The PLW study was completed with the architectural drawings prepared by NEUF architect(e)s in March 2023. Updated drawings were distributed to the consultant team in April 2023. While there are no changes to the overall massing of the proposed multi-phase development, the updated drawings include secondary building access points at the ground floor along all elevations of the buildings serving Phases 5 and 6, and along the north, east, and west elevations of the building serving Phase 4. Also, the podium shared by Phases 5 and 6 is now 4 storeys, maintaining the same height compared to the 6-storey podium considered in the previous design (that is, approximately 19 m high).

The results and recommendations provided in this study remain representative of the current architectural design, inclusive of the secondary building access points, where wind conditions are predicted to be suitable for the intended pedestrian uses throughout the year.



**TABLE OF CONTENTS**

**1. INTRODUCTION ..... 1**

**2. TERMS OF REFERENCE ..... 1**

**3. OBJECTIVES ..... 2**

**4. METHODOLOGY..... 3**

**4.1 Computer-Based Context Modelling .....3**

**4.2 Wind Speed Measurements.....4**

**4.3 Historical Wind Speed and Direction Data .....4**

**4.4 Pedestrian Wind Comfort and Safety Criteria – City of Ottawa.....6**

**5. RESULTS AND DISCUSSION ..... 8**

**5.1 Wind Comfort Conditions – Ground Floor .....9**

**5.2 Wind Comfort Conditions – Daycare Playground and Common Amenity Terraces .....12**

**5.3 Wind Safety .....13**

**5.4 Applicability of Results .....13**

**6. CONCLUSIONS AND RECOMMENDATIONS ..... 13**

**FIGURES**

**APPENDICES**

**Appendix A – Simulation of the Atmospheric Boundary Layer**



## **1. INTRODUCTION**

Gradient Wind Engineering Inc. (Gradient Wind) was retained by Brigil to undertake a pedestrian level wind (PLW) study to satisfy Site Plan Control application requirements for the proposed multi-building development, referred to as “Baseline Tower Phase 4-6”, located at the intersection of Baseline Road and Sandcastle Drive in Ottawa, Ontario (hereinafter referred to as “subject site” or “proposed development”). Our mandate within this study is to investigate pedestrian wind conditions within and surrounding the subject site, and to identify areas where wind conditions may interfere with certain pedestrian activities so that mitigation measures may be considered, where required.

Our work is based on industry standard computer simulations using the computational fluid dynamics (CFD) technique and data analysis procedures, City of Ottawa wind comfort and safety criteria, architectural drawings prepared by NEUF architect(e)s, in March 2023, surrounding street layouts and existing and approved future building massing information obtained from the City of Ottawa, as well as recent satellite imagery.

## **2. TERMS OF REFERENCE**

The subject site is located at southeast intersection of Baseline Road and Sandcastle Drive in Ottawa, on a parcel of land to the immediate west of Baseline Tower Phases 1-3. The proposed development comprises three phases, Phases 4, 5, and 6, situated south, central, and north of the subject site, respectively. East-west laneways extend from Sandcastle Drive to meet an existing laneway along the east elevation of the subject site extending from Baseline Road. Surface parking is provided along the eastern laneway and access to shared below-grade parking levels is provided by parking ramps at the southeast corner and to the north of Phase 4 and 5, respectively, via the noted internal laneways. All buildings are topped with a mechanical penthouse (MPH).

Phase 4 comprises a nominally rectangular nine-storey building. At the ground floor, a main entrance is situated to the north. The building steps back from the south elevation at Level 2 to accommodate private terraces and a daycare playground terrace at the southeast and southwest corners, respectively. The building steps back from all elevations at Level 5.



Phase 5 comprises a near rectangular 28-storey building, inclusive of a six-storey podium comprising a nominally 'C'-shaped planform, with its long axis-oriented along Sandcastle Drive. The podium levels (excluding the ground floor) are shared with Phase 6 which comprises a near rectangular 32-storey building. A main entrance is situated to the east of Phase 5 and a semi-public plaza, and a public park are provided at the southeast and southwest corners. A main entrance is situated to the south of the Phase 6 and a drop-off area is provided to the east. Phases 5 and 6 share an amenity terrace at the podium roof level.

The near-field surroundings, defined as an area within 200-metres (m) of the subject site, include low-rise residential dwellings from the west clockwise to the north, mid-rise office buildings from the northeast clockwise to the east, low-rise residential dwellings from the east clockwise to the south, and two high-rise residential buildings to the southwest. Notably, the Baseline Tower Phase 1-3 development is currently under construction to the immediate east of the subject site. The far-field surroundings, defined as an area beyond the near-field but within a 2-kilometre (km) radius of the subject site, are characterized primarily by low-rise massing with isolated mid- and high-rise buildings in all compass directions, and open exposures (fields and green spaces) from the southeast clockwise to the northwest.

Site plans for the proposed and existing massing scenarios are illustrated in Figures 1A and 1B, while Figures 2A-2H illustrate the computational models used to conduct the study. The existing massing scenario includes the existing massing and any changes which have been approved by the City of Ottawa.

### **3. OBJECTIVES**

The principal objectives of this study are to (i) determine pedestrian level wind conditions at key areas within and surrounding the development site; (ii) identify areas where wind conditions may interfere with the intended uses of outdoor spaces; and (iii) recommend suitable mitigation measures, where required.

## **4. METHODOLOGY**

The approach followed to quantify pedestrian wind conditions over the site is based on CFD simulations of wind speeds across the study site within a virtual environment, meteorological analysis of the Ottawa area wind climate, and synthesis of computational data with City of Ottawa wind comfort and safety criteria<sup>1</sup>. The following sections describe the analysis procedures, including a discussion of the noted pedestrian wind criteria.

### **4.1 Computer-Based Context Modelling**

A computer based PLW study was performed to determine the influence of the wind environment on pedestrian comfort over the proposed development site. Pedestrian comfort predictions, based on the mechanical effects of wind, were determined by combining measured wind speed data from CFD simulations with statistical weather data obtained from Ottawa Macdonald-Cartier International Airport. The general concept and approach to CFD modelling is to represent building and topographic details in the immediate vicinity of the study site on the surrounding model, and to create suitable atmospheric wind profiles at the model boundary. The wind profiles are designed to have similar mean and turbulent wind properties consistent with actual site exposures.

An industry standard practice is to omit trees, vegetation, and other existing and planned landscape elements from the model due to the difficulty of providing accurate seasonal representation of vegetation. The omission of trees and other landscaping elements produces slightly stronger wind speeds.

---

<sup>1</sup> City of Ottawa Terms of References: Wind Analysis  
[https://documents.ottawa.ca/sites/default/files/torwindanalysis\\_en.pdf](https://documents.ottawa.ca/sites/default/files/torwindanalysis_en.pdf)



## 4.2 Wind Speed Measurements

The PLW analysis was performed by simulating wind flows and gathering velocity data over a CFD model of the site for 12 wind directions. The CFD simulation model was centered on the study building, complete with surrounding massing within a radius of 540 m. The process was performed for two context massing scenarios, as noted in Section 2.


Mean and peak wind speed data obtained over the study site for each wind direction were interpolated to 36 wind directions at 10° intervals, representing the full compass azimuth. Measured wind speeds approximately 1.5 m above local grade and the daycare playground and common amenity terraces were referenced to the wind speed at gradient height to generate mean and peak velocity ratios, which were used to calculate full-scale values. Gradient height represents the theoretical depth of the boundary layer of the earth's atmosphere, above which the mean wind speed remains constant. Further details of the wind flow simulation technique are presented in Appendix A.

## 4.3 Historical Wind Speed and Direction Data

A statistical model for winds in Ottawa was developed from approximately 40 years of hourly meteorological wind data recorded at Ottawa Macdonald-Cartier International Airport and obtained from Environment and Climate Change Canada. Wind speed and direction data were analyzed for each month of the year to determine the statistically prominent wind directions and corresponding speeds, and to characterize similarities between monthly weather patterns.

The statistical model of the Ottawa area wind climate, which indicates the directional character of local winds on a seasonal basis, is illustrated on the following page. The plots illustrate seasonal distribution of measured wind speeds and directions in kilometers per hour (km/h). Probabilities of occurrence of different wind speeds are represented as stacked polar bars in sixteen azimuth divisions. The radial direction represents the percentage of time for various wind speed ranges per wind direction during the measurement period. The prominent wind speeds and directions can be identified by the longer length of the bars. For Ottawa, the most common winds occur for westerly wind directions, followed by those from the east, while the most common wind speeds are below 36 km/h. The directional prominence and relative magnitude of wind speed changes somewhat from season to season.

## SEASONAL DISTRIBUTION OF WIND OTTAWA MACDONALD-CARTIER INTERNATIONAL AIRPORT

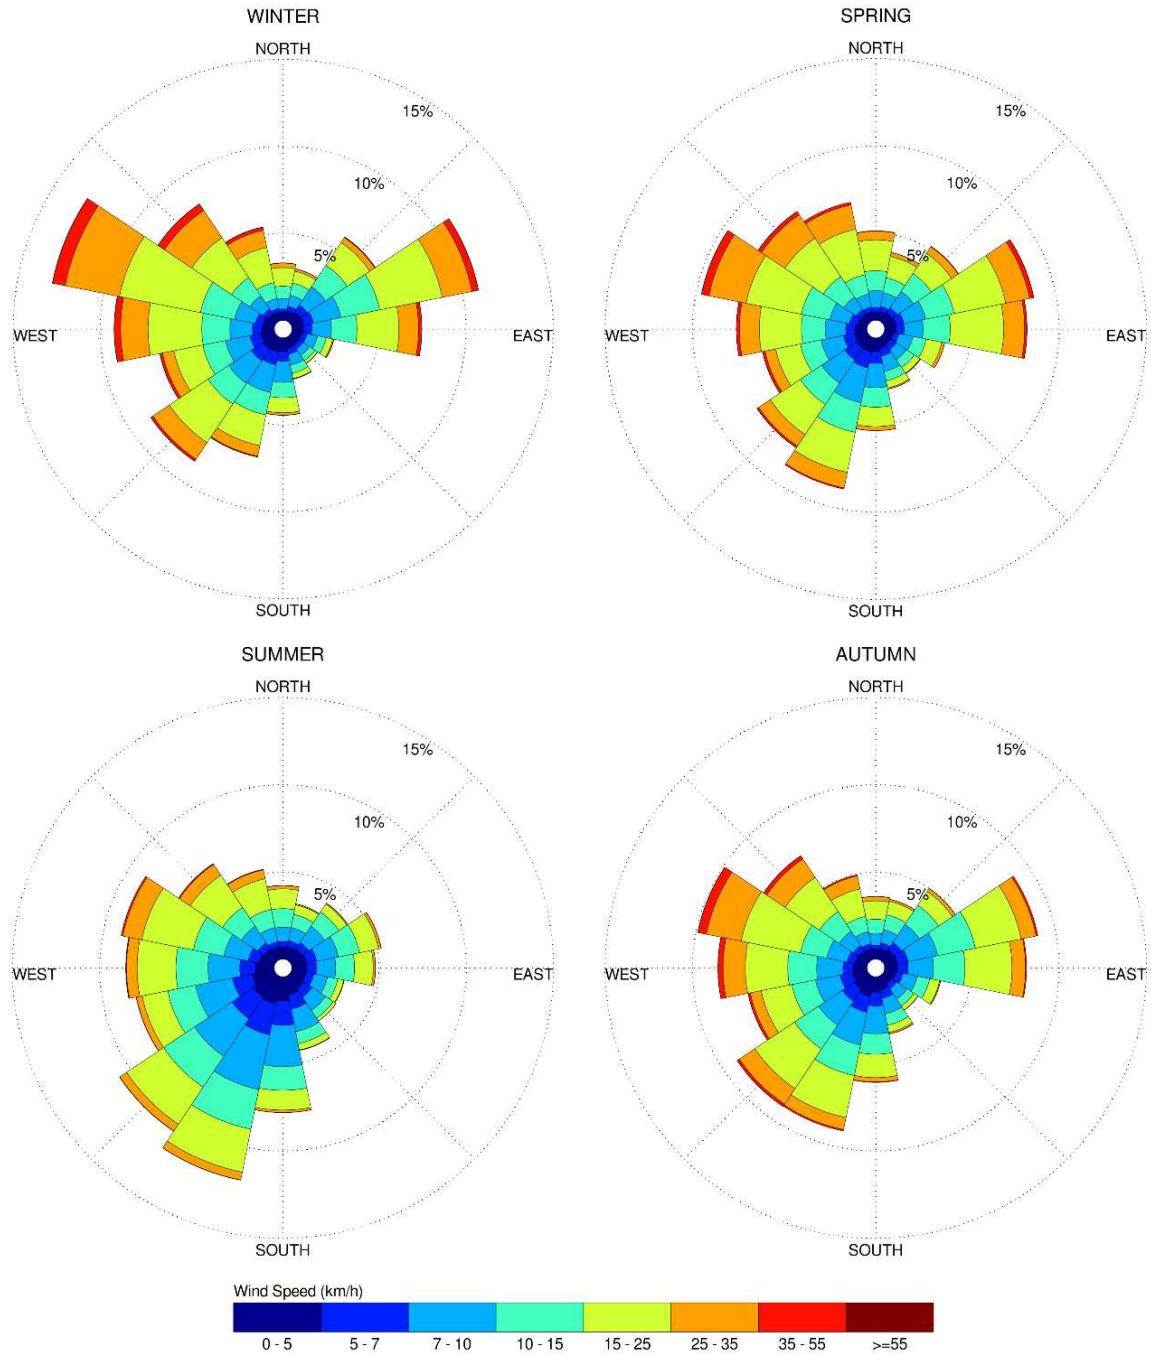

### Notes:

1. Radial distances indicate percentage of time of wind events.
2. Wind speeds are mean hourly in km/h, measured at 10 m above the ground.

#### 4.4 Pedestrian Wind Comfort and Safety Criteria – City of Ottawa

Pedestrian comfort and safety criteria are based on the mechanical effects of wind without consideration of other meteorological conditions (that is, temperature, relative humidity). The comfort criteria assume that pedestrians are appropriately dressed for a specified outdoor activity during any given season. Five pedestrian comfort classes are based on 20% non-exceedance mean wind speed ranges, which include (1) Sitting; (2) Standing; (3) Strolling; (4) Walking; and (5) Uncomfortable. More specifically, the comfort classes and associated mean wind speed ranges are summarized as follows:

- 1) **Sitting:** Mean wind speeds no greater than 10 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 16 km/h.
- 2) **Standing:** Mean wind speeds no greater than 14 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 22 km/h.
- 3) **Strolling:** Mean wind speeds no greater than 17 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 27 km/h.
- 4) **Walking:** Mean wind speeds no greater than 20 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 32 km/h.
- 5) **Uncomfortable:** Uncomfortable conditions are characterized by predicted values that fall below the 80% target for walking. Brisk walking and exercise, such as jogging, would be acceptable for moderate excesses of this criterion.

The pedestrian safety wind speed criterion is based on the approximate threshold that would cause a vulnerable member of the population to fall. A 0.1% exceedance gust wind speed of 90 km/h is classified as dangerous. The gust speeds, and equivalent mean speeds, are selected based on ‘The Beaufort Scale’, presented on the following page, which describes the effects of forces produced by varying wind speed levels on objects. Gust speeds are included because pedestrians tend to be more sensitive to wind gusts than to steady winds for lower wind speed ranges. For strong winds approaching dangerous levels, this effect is less important because the mean wind can also create problems for pedestrians.

## THE BEAUFORT SCALE

Number	Description	Gust Wind Speed (km/h)	Description
2	Light Breeze	9-17	Wind felt on faces
3	Gentle Breeze	18-29	Leaves and small twigs in constant motion; wind extends light flags
4	Moderate Breeze	30-42	Wind raises dust and loose paper; small branches are moved
5	Fresh Breeze	43-57	Small trees in leaf begin to sway
6	Strong Breeze	58-74	Large branches in motion; Whistling heard in electrical wires; umbrellas used with difficulty
7	Moderate Gale	75-92	Whole trees in motion; inconvenient walking against wind
8	Gale	93-111	Breaks twigs off trees; generally impedes progress

Experience and research on people’s perception of mechanical wind effects has shown that if the wind speed levels are exceeded for more than 20% of the time, the activity level would be judged to be uncomfortable by most people. For instance, if a mean wind speed of 10 km/h (equivalent gust wind speed of approximately 16 km/h) were exceeded for more than 20% of the time most pedestrians would judge that location to be too windy for sitting. Similarly, if mean wind speed of 20 km/h (equivalent gust wind speed of approximately 32 km/h) at a location were exceeded for more than 20% of the time, walking or less vigorous activities would be considered uncomfortable. As these criteria are based on subjective reactions of a population to wind forces, their application is partly based on experience and judgment.

Once the pedestrian wind speed predictions have been established throughout the site, the assessment of pedestrian comfort involves determining the suitability of the predicted wind conditions for discrete regions within and surrounding the subject site. This step involves comparing the predicted comfort classes to the desired comfort classes, which are dictated by the location type for each region (that is, a sidewalk, building entrance, amenity space, or other). An overview of common pedestrian location types and their typical windiest desired comfort classes are summarized on the following page. Depending on the programming of a space, the desired comfort class may differ from this table.

**DESIRED PEDESTRIAN COMFORT CLASSES FOR VARIOUS LOCATION TYPES**

Location Types	Desired Comfort Classes
Primary Building Entrance	Standing
Secondary Building Access Point	Walking
Public Sidewalk / Bicycle Path	Walking
Outdoor Amenity Space	Sitting / Standing
Café / Patio / Bench / Garden	Sitting / Standing
Transit Stop (Without Shelter)	Standing
Transit Stop (With Shelter)	Walking
Public Park / Plaza	Sitting / Standing
Garage / Service Entrance	Walking
Parking Lot	Walking
Vehicular Drop-Off Zone	Walking

## 5. RESULTS AND DISCUSSION

The following discussion of the predicted pedestrian wind conditions for the subject site is accompanied by Figures 3A-6B, illustrating wind conditions at grade level for the proposed and existing massing scenarios, and by Figures 8A-8D and 9A-9D, illustrating wind conditions over the daycare playground terrace serving Phase 4 at Level 2 and the common amenity terrace serving Phases 5 and 6 at Level 7, respectively. Conditions are presented as continuous contours of wind comfort throughout the subject site and correspond to the comfort classes noted in Section 4.4. Wind conditions suitable for sitting are represented by the colour blue, standing by green, strolling by yellow, and walking by orange; uncomfortable conditions are represented by the colour magenta.

Conditions are also reported for the typical use period, which is defined as May to October, inclusive. Figures 7 and 10 illustrate wind comfort conditions at grade and over the Level 7 common amenity terrace serving Phases 5 and 6, respectively, consistent with the comfort classes in Section 4.4. The details of these conditions are summarized in the following pages for each area of interest.

## 5.1 Wind Comfort Conditions – Ground Floor

**Sidewalks and Transit Stops along Baseline Road:** Following the introduction of the proposed development, wind comfort conditions over the public sidewalks along Baseline Road are predicted to be suitable for a mix of sitting and standing during the summer, becoming suitable for strolling, or better, throughout the remainder of the year. Conditions within the nearby transit stop to the north of Baseline Road are predicted to be suitable for sitting during the summer, becoming suitable for standing throughout the remainder of the year. Conditions within the nearby transit stop to the south of Baseline Road, which includes a typical shelter, are predicted to be suitable for standing during the summer and autumn, becoming suitable for a mix of standing and strolling during the spring, and suitable for strolling during the winter. The noted conditions are considered acceptable.

Conditions over the sidewalks along Baseline Road with the existing massing are predicted to be suitable for sitting during the summer, becoming suitable for a mix of sitting and standing throughout the remainder of the year. Conditions within the nearby transit stop to the north of Baseline Road are predicted to be suitable for sitting during the summer, becoming suitable for standing throughout the remainder of the year, while conditions within the nearby transit stop to the south of Baseline Road are predicted to be suitable for sitting throughout the year. While the introduction of the proposed development produces windier conditions in comparison to existing conditions, wind comfort conditions are nevertheless considered acceptable.

**Existing Surface Parking along Laneway East of Subject Site:** Following the introduction of the proposed development, wind comfort conditions over the existing laneway shared with Baseline Tower Phase 1-3, inclusive of surface parking, along the east elevation of the subject site are predicted to be suitable for a mix of sitting and standing during the summer, becoming suitable for strolling, or better, during the spring and autumn, and suitable for walking, or better, during the winter. The noted conditions are considered acceptable.

Conditions over noted laneway and surface parking with the existing massing are predicted to be suitable mostly for sitting during the summer, becoming suitable for a mix of sitting and standing with isolated regions suitable for strolling throughout the remainder of the year. While the introduction of the proposed

development produces windier conditions in comparison to existing conditions, wind comfort conditions are nevertheless considered acceptable.

**Existing Parking Lot East of Subject Site:** Following the introduction of the proposed development, wind comfort conditions over the parking lot situated in between Phase 2 and 3 to the east of the subject site are predicted to be suitable mostly for sitting during the summer, becoming suitable for a mix of sitting and standing throughout the remainder of the year. The noted conditions are considered acceptable.

Conditions over the noted parking lot with the existing massing are predicted to be suitable for a mix of sitting and standing during the summer, becoming suitable for strolling, or better, during the spring and autumn, and suitable for walking, or better, during the winter. Notably, the introduction of the proposed development is predicted to improve comfort levels over the noted area, in comparison to existing conditions.

**Existing Parking Lots South, Southwest, and West of Subject Site:** Prior to the introduction of the proposed development, wind comfort conditions over the parking lots situated to the south, southwest, and west of the subject site are predicted to be suitable for sitting during the summer, becoming suitable for a mix of sitting and standing throughout the remainder of the year. The noted conditions remain unchanged following the introduction of the proposed development. As such, wind conditions with the proposed development are considered acceptable.

**Sidewalks along Sandcastle Drive:** Following the introduction of the proposed development, wind comfort conditions over the public sidewalks along Sandcastle Drive are predicted to be suitable for a mix of sitting and standing during the summer, becoming suitable mostly for standing during the autumn, and suitable for a mix of standing and strolling during the winter and spring.

Conditions over the sidewalks along Sandcastle Drive with the existing massing are predicted to be suitable for sitting during the summer, becoming suitable for a mix of sitting and standing throughout the remainder of the year. While the introduction of the proposed development produces windier conditions in comparison to existing conditions, wind comfort conditions are nevertheless considered acceptable.

**Public Park and Semi-Public Plaza South of Phase 5:** As illustrated in Figure 7, wind comfort conditions during the typical use period over the public park to the southwest of Phase 5 are predicted to be suitable





for sitting to the north and near the southeast corner with standing conditions throughout the remainder of the area. Within the windier areas, conditions are predicted to be suitable for sitting for at least 70% of the time during the same period, where the target is 80% to achieve the sitting comfort class.

Wind comfort conditions during the typical use period over semi-public plaza to the southeast of Phase 5, as illustrated in Figure 7, are predicted to be suitable for sitting to the south and at the northwest corner with standing conditions throughout the remainder of the area. Within the windier areas, conditions are predicted to be suitable for sitting for at least 65% of the time during the same period, where the target is 80% to achieve the sitting comfort class. Notably, the 4 m landscaping buffer included in the provided site plan<sup>2</sup> along the west perimeter of the public park, which could not be implemented in the simulation model (that is, clusters of dense trees), as described in Section 4.1, will help to improve wind comfort conditions. Comfort levels over the noted areas may be further improved by implementing landscaping features such as wind screens or coniferous plantings in dense arrangements around sensitive areas.

The extent of the mitigation measures is dependent on the programming of the areas. An appropriate mitigation strategy will be developed in collaboration with the building and landscape architects as the design of the proposed development progresses.

**Proposed Laneways and Drop-off Area:** Wind comfort conditions over the laneway situated in between Phases 4 and 5 are predicted to be suitable for a mix of sitting and standing during the spring, summer, and autumn, becoming suitable for standing during the winter. Conditions over the laneway situated in between Phases 5 and 6 are predicted to be suitable for a mix of sitting and standing during the summer, becoming suitable for a mix of standing and strolling during the spring and autumn, and suitable for a mix of standing, strolling, and walking during the winter. Conditions over the drop-off area provided to the east of Phase 6 are predicted to be suitable for standing during the summer, becoming suitable for a mix of standing and strolling during the autumn, and suitable for strolling during the winter and spring. The noted conditions are considered acceptable.

**Building Access:** Wind comfort conditions in the vicinity of the primary building entrance serving Phase 4 are predicted to be suitable for sitting during the summer and autumn, becoming suitable for standing during the winter and spring. Conditions in the vicinity of the primary building entrance serving Phase 5

---

<sup>2</sup> NEUF architect(e)s, 'Site Plan' [March 22, 2023]





are predicted to be suitable for sitting during the summer, becoming suitable for standing throughout the remainder of the year. Conditions in the vicinity of the primary building entrance serving Phase 6 are predicted to be suitable for sitting throughout the year. The noted conditions are considered acceptable.

## 5.2 Wind Comfort Conditions – Daycare Playground and Common Amenity Terraces

The proposed development is served by a common amenity terrace atop the podium of Phases 5 and 6 at Level 7, and by a daycare playground terrace at Level 2 to the southwest of Phase 4. The noted terraces were modelled with 1.8-m-tall wind screens along their full perimeters. Wind comfort conditions within the noted areas, and recommendations regarding further mitigation, if required, are described as follows:

**Phase 4, Level 2 Daycare Playground Terrace:** With the noted wind mitigation, wind comfort conditions within the daycare playground terrace serving Phase 4 at Level 2 are predicted to be suitable for sitting throughout the year. The noted conditions are considered acceptable.

**Phases 5 and 6, Level 7 Common Amenity Terrace:** With the noted wind mitigation, and as illustrated in Figure 10, wind comfort conditions during the typical use period within the common amenity terrace serving Phases 5 and 6 at Level 7 are predicted to be suitable for sitting close to the tower elevations and standing throughout the remainder of the area, with an isolated region suitable for strolling to the north of Phase 5.

To improve comfort levels within the Level 7 amenity terrace serving Phases 5 and 6, it is recommended to include taller wind screens along the full perimeter of the terrace. Specifically, 2.4-m-tall wind screens, glazed and solid, are recommended. Additionally, mitigation inboard of the perimeter, which could take the form of 1.8-m-tall wind screens or clusters of coniferous trees located around sensitive areas, and canopies located above designated seating areas, are recommended to further improved wind comfort conditions within the terrace.

The extent of the mitigation measures is dependent on the programming of the terrace. An appropriate mitigation strategy will be developed in collaboration with the building and landscape architects as the design of the proposed development progresses.

### 5.3 Wind Safety

Within the context of typical weather patterns, which exclude anomalous localized storm events such as tornadoes and downbursts, no pedestrian areas within or surrounding the subject site are expected to experience conditions that could be considered dangerous, as defined in Section 4.4.

### 5.4 Applicability of Results

Pedestrian wind comfort and safety have been quantified for the specific configuration of existing and foreseeable construction around the subject site. Future changes (that is, construction or demolition) of these surroundings may cause changes to the wind effects in two ways, namely: (i) changes beyond the immediate vicinity of the subject site would alter the wind profile approaching the subject site; and (ii) development in proximity to the subject site would cause changes to local flow patterns.

## 6. CONCLUSIONS AND RECOMMENDATIONS

A complete summary of the predicted wind conditions is provided in Section 5 and illustrated in Figures 3A-10. Based on computer simulations using the CFD technique, meteorological data analysis of the Ottawa wind climate, City of Ottawa wind comfort and safety criteria, and experience with numerous similar developments, the study concludes the following:

- 1) All grade-level areas within and surrounding the subject site are predicted to experience conditions that are considered acceptable for the intended pedestrian uses throughout the year. Specifically, conditions over surrounding sidewalks, transit stops, existing eastern laneway, surface parking, existing parking lots, proposed laneways and drop-off area, and in the vicinity of building access points, are considered acceptable. Exceptions are as follows:
  - a. Wind conditions during the typical use period over the public park are predicted to be suitable for sitting to the north and near the southeast corner with standing conditions throughout the remainder of the area, and conditions during the same period over the semi-public plaza are predicted to be suitable for sitting to the south and at the northwest corner with standing conditions throughout the remainder of the area.

- b. Notably, the 4 m landscaping buffer included in the provided site plan along the west perimeter of the public park, which could not be implemented in the simulation model (that is, clusters of dense trees), as described in Section 4.1, will help to improve wind comfort conditions. Comfort levels over the noted areas may be further improved by implementing landscaping features such as wind screens or coniferous plantings in dense arrangements around sensitive areas.
  - c. The extent of the mitigation measures is dependent on the programming of the area. An appropriate mitigation strategy will be developed in collaboration with the building and landscape architects as the design of the proposed development progresses.
- 2) The common amenity terraces serving the proposed development were modelled with 1.8-m-tall wind screens along their full perimeters. Wind comfort conditions and recommendations regarding further mitigation, if required, are described as follows:
- a. **Phase 4, Level 2 Daycare Playground Terrace:** With the noted wind mitigation, wind comfort conditions are predicted to be suitable for sitting throughout the year. The noted conditions are considered acceptable.
  - b. **Phases 5 and 6, Level 7 Common Amenity Terrace:** With the noted wind mitigation, and as illustrated in Figure 10, wind comfort conditions during the typical use period are predicted to be suitable for sitting close to the tower elevations and standing throughout the remainder of the area, with an isolated region suitable for strolling to the north of Phase 5.
  - c. To improve comfort levels within the Level 7 amenity terrace serving Phases 5 and 6, it is recommended to include taller wind screens along the full perimeter of the terrace. Specifically, 2.4-m-tall wind screens, glazed and solid, are recommended. Additionally, mitigation inboard of the perimeter, which could take the form of 1.8-m-tall wind screens or clusters of coniferous trees located around sensitive areas, and canopies located above designated seating areas, are recommended to further improved wind comfort conditions within the terrace.

- d. The extent of the mitigation measures is dependent on the programming of the area. An appropriate mitigation strategy will be developed in collaboration with the building and landscape architects as the design of the proposed development progresses.
- 3) The foregoing statements and conclusions apply to common weather systems, during which no dangerous wind conditions, as defined in Section 4.4, are expected anywhere over the subject site. During extreme weather events, (for example, thunderstorms, tornadoes, and downbursts), pedestrian safety is the main concern. However, these events are generally short-lived and infrequent and there is often sufficient warning for pedestrians to take appropriate cover.

Sincerely,

***Gradient Wind Engineering Inc.***




Daniel Davalos, MEng.  
Junior Wind Scientist




Sunny Kang, B.A.S.  
Project Coordinator



Justin Ferraro, P.Eng.  
Principal

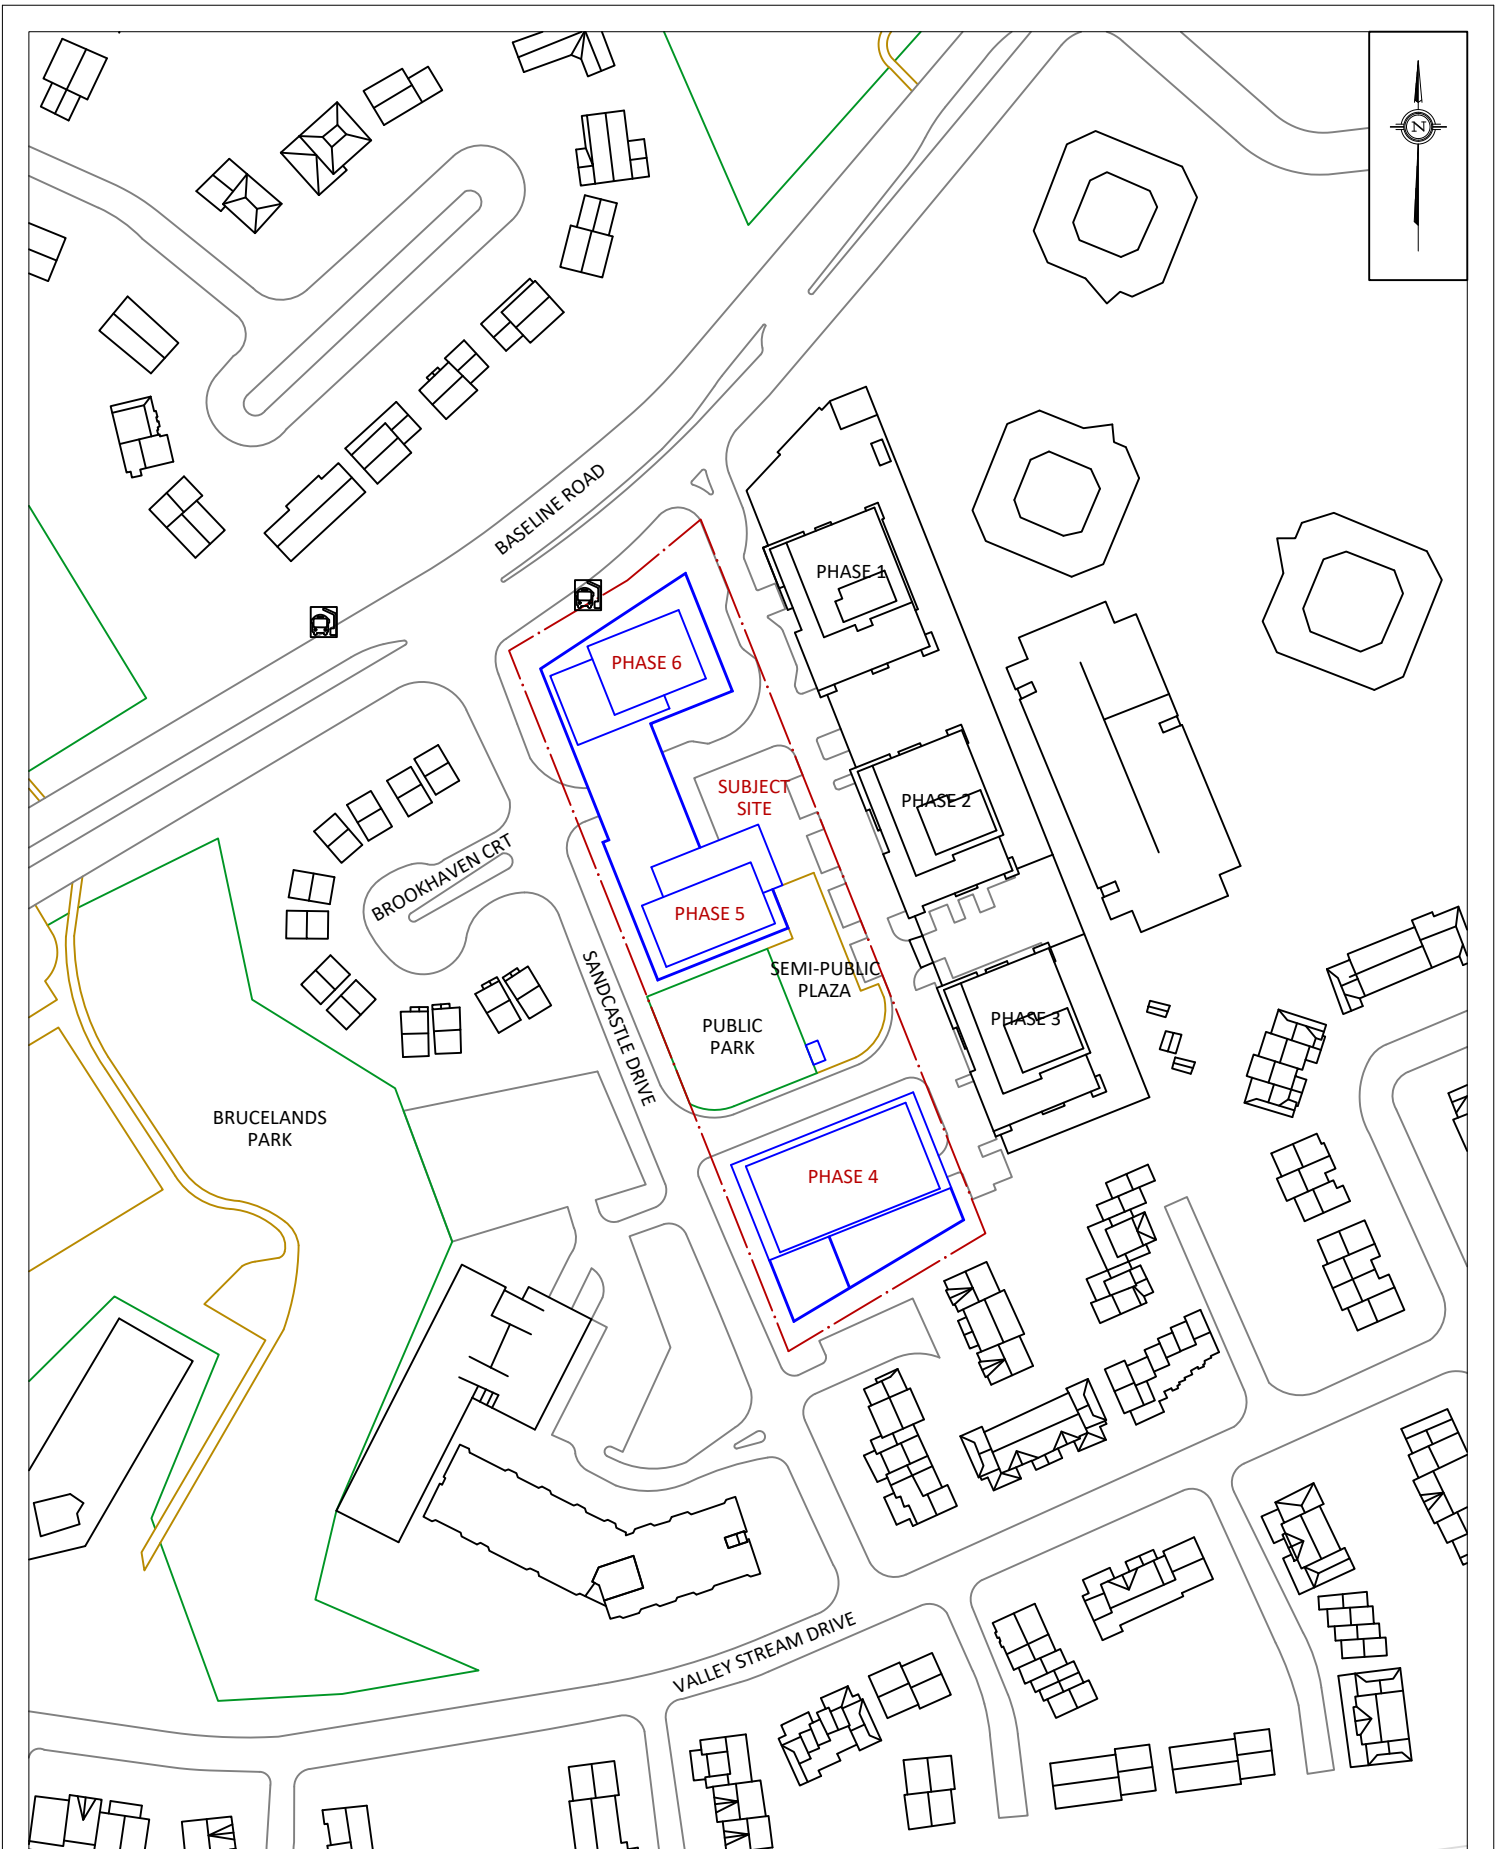


<b>GRADIENTWIND</b> ENGINEERS & SCIENTISTS 127 WALGREEN ROAD, OTTAWA, ON 613 836 0934 • GRADIENTWIND.COM	PROJECT	BASELINE TOWER PHASE 4-6, OTTAWA PEDESTRIAN LEVEL WIND STUDY		DESCRIPTION	FIGURE 1A: PROPOSED SITE PLAN AND SURROUNDING CONTEXT
	SCALE	1:2000	DRAWING NO.	21-424-PLW-2023-1A	
	DATE	APRIL 17, 2023	DRAWN BY	S.K.	

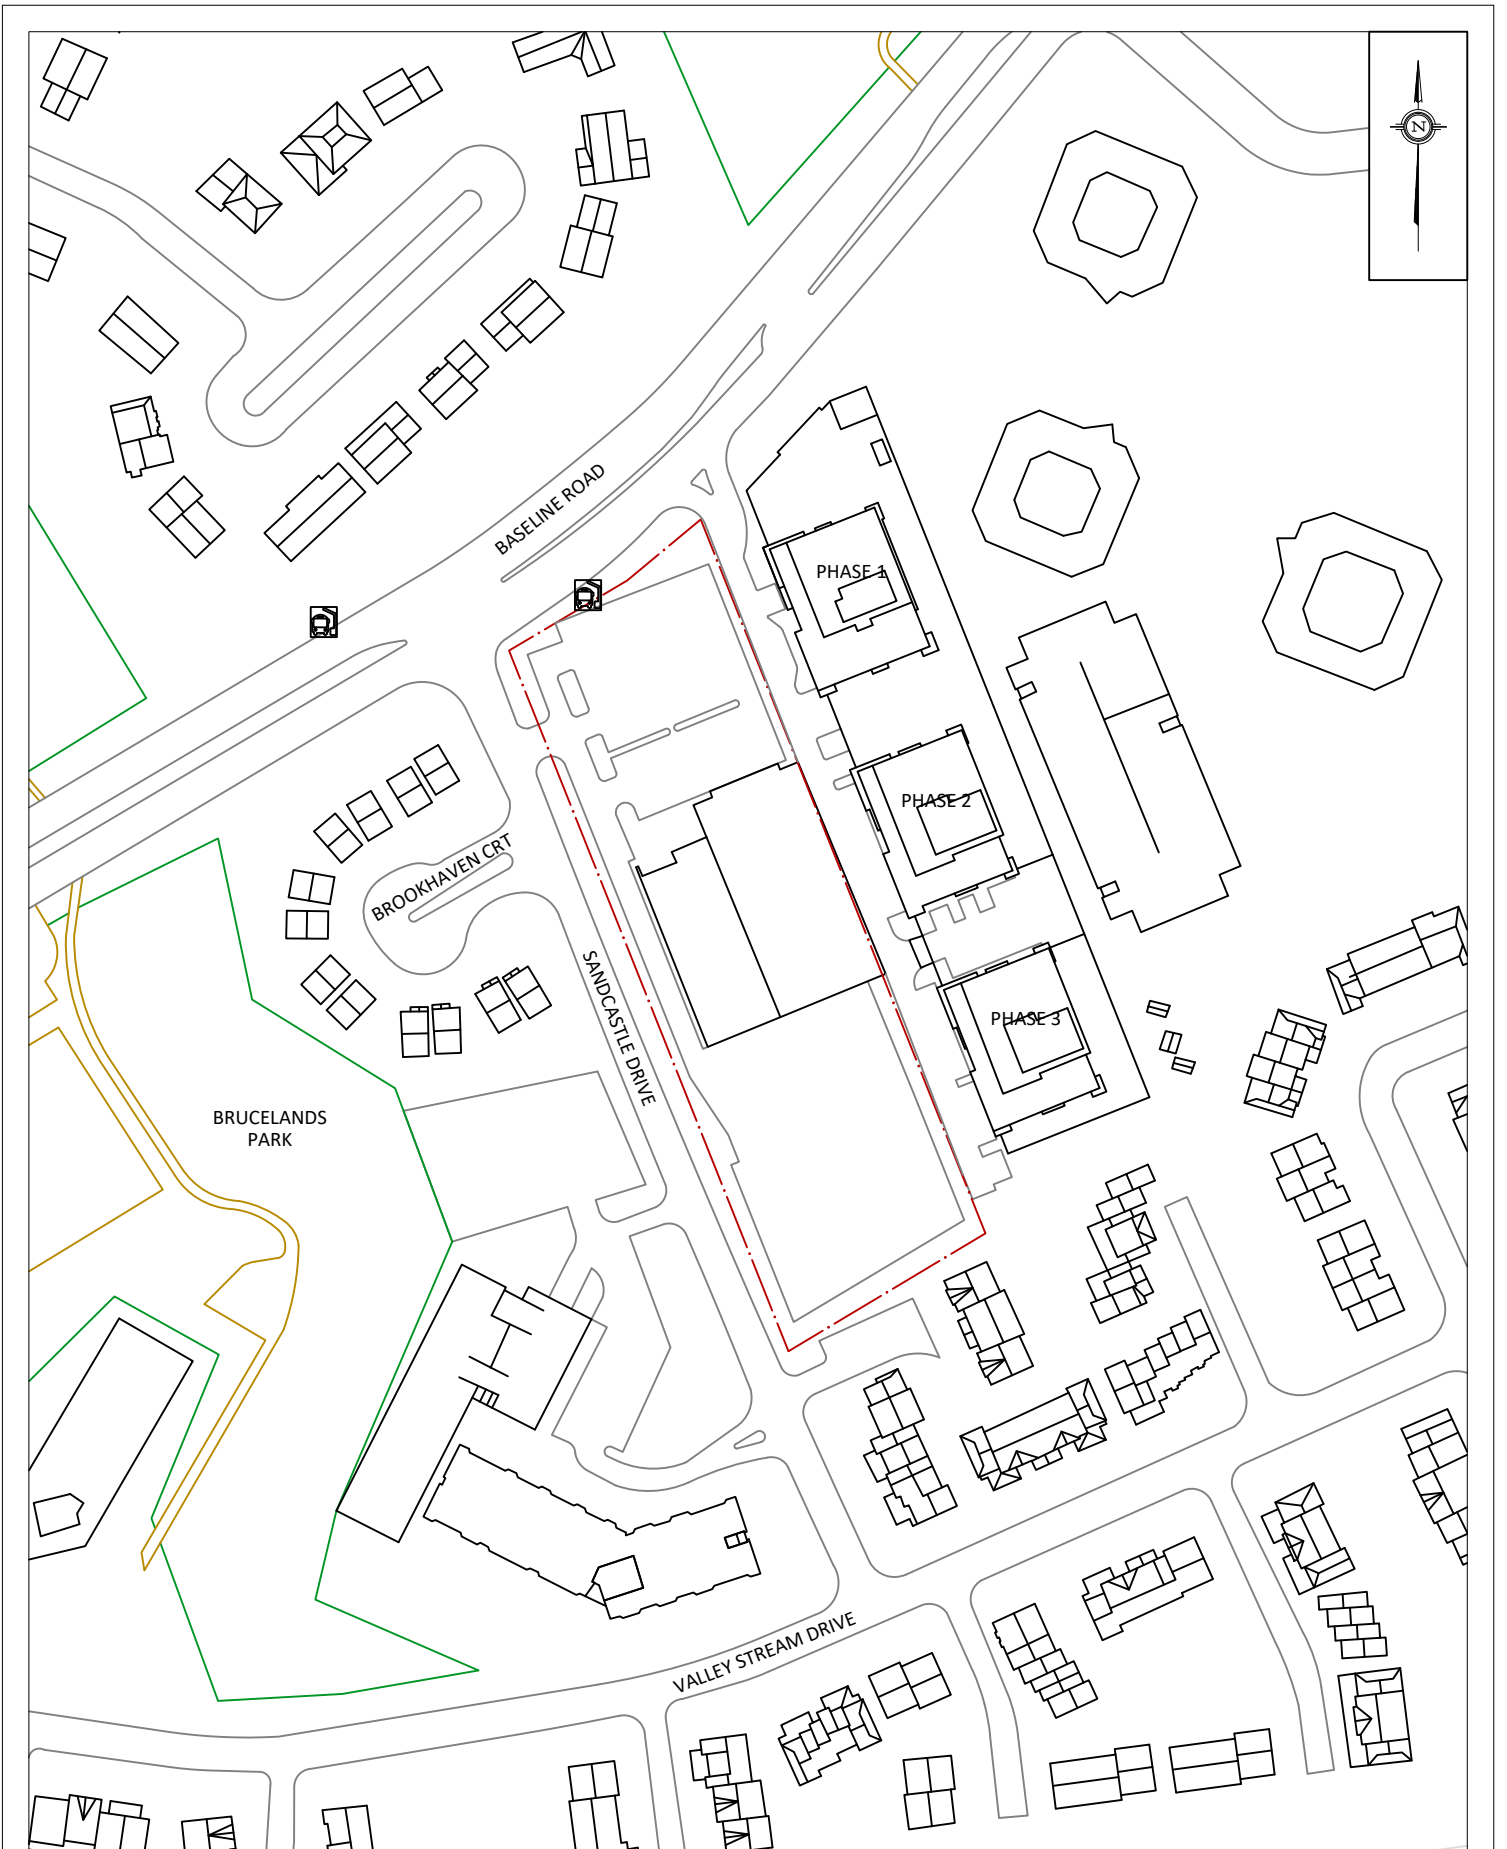


<b>GRADIENTWIND</b> ENGINEERS & SCIENTISTS 127 WALGREEN ROAD, OTTAWA, ON 613 836 0934 • GRADIENTWIND.COM	PROJECT	BASELINE TOWER PHASE 4-6, OTTAWA PEDESTRIAN LEVEL WIND STUDY		DESCRIPTION	FIGURE 1B: EXISTING SITE PLAN AND SURROUNDING CONTEXT
	SCALE	1:2000	DRAWING NO.	21-424-PLW-2023-1B	
	DATE	APRIL 17, 2023	DRAWN BY	S.K.	



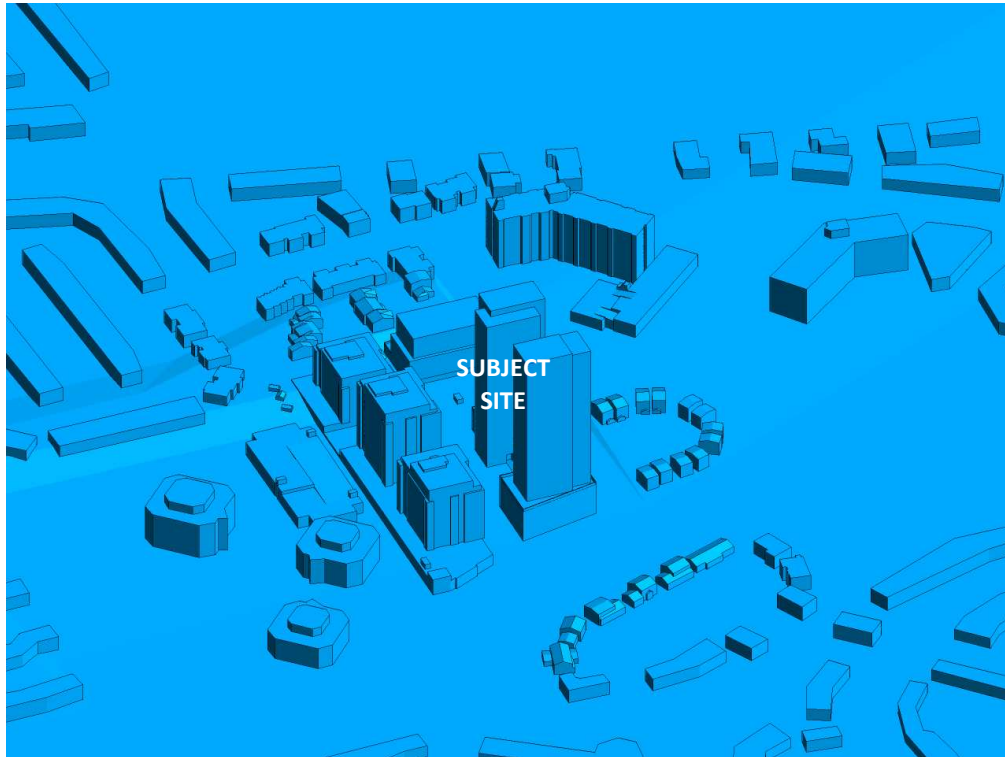


**FIGURE 2A: COMPUTATIONAL MODEL, PROPOSED MASSING, NORTH PERSPECTIVE**

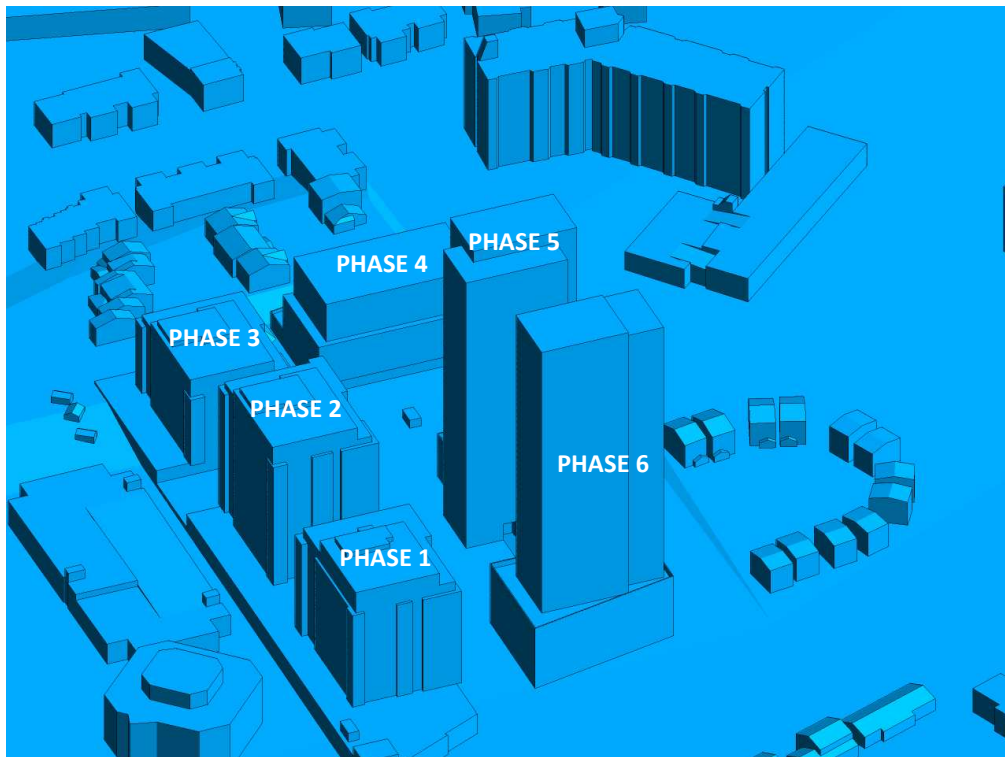


**FIGURE 2B: CLOSE UP OF FIGURE 2A**



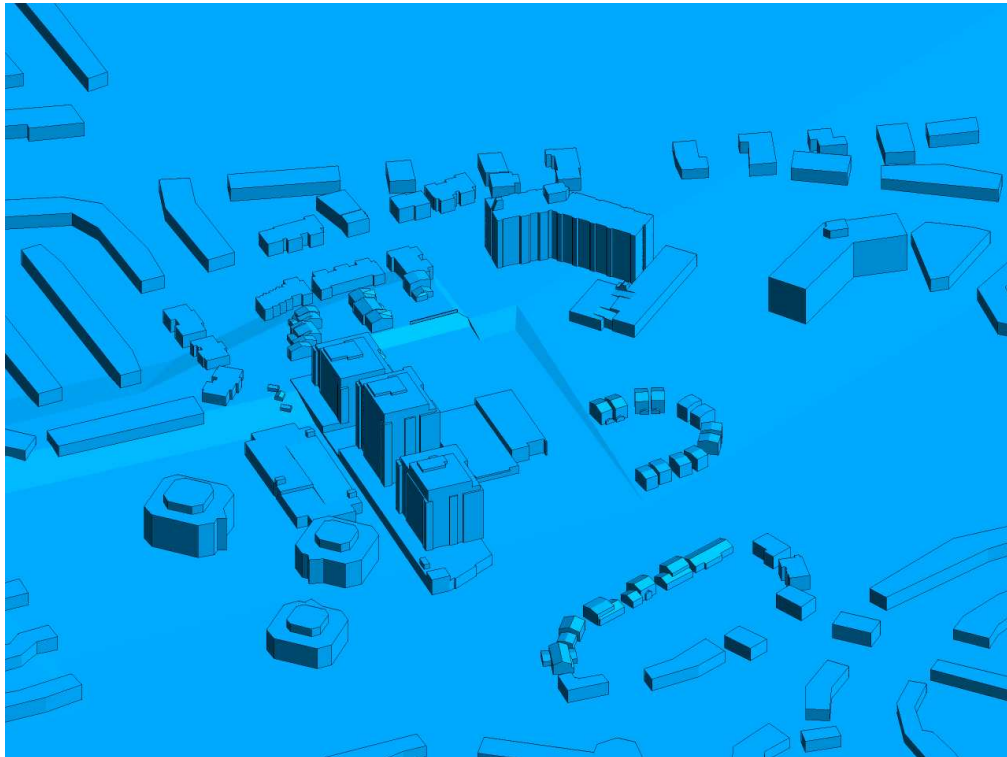


**FIGURE 2C: COMPUTATIONAL MODEL, EXISTING MASSING, NORTH PERSPECTIVE**

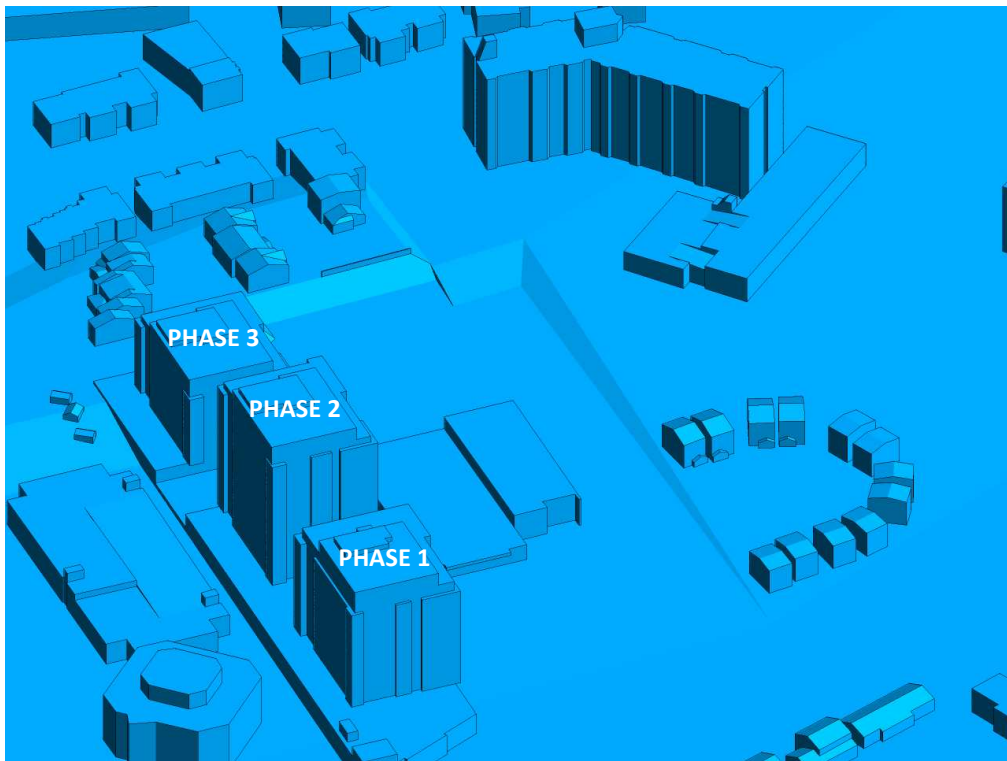


**FIGURE 2D: CLOSE UP OF FIGURE 2C**





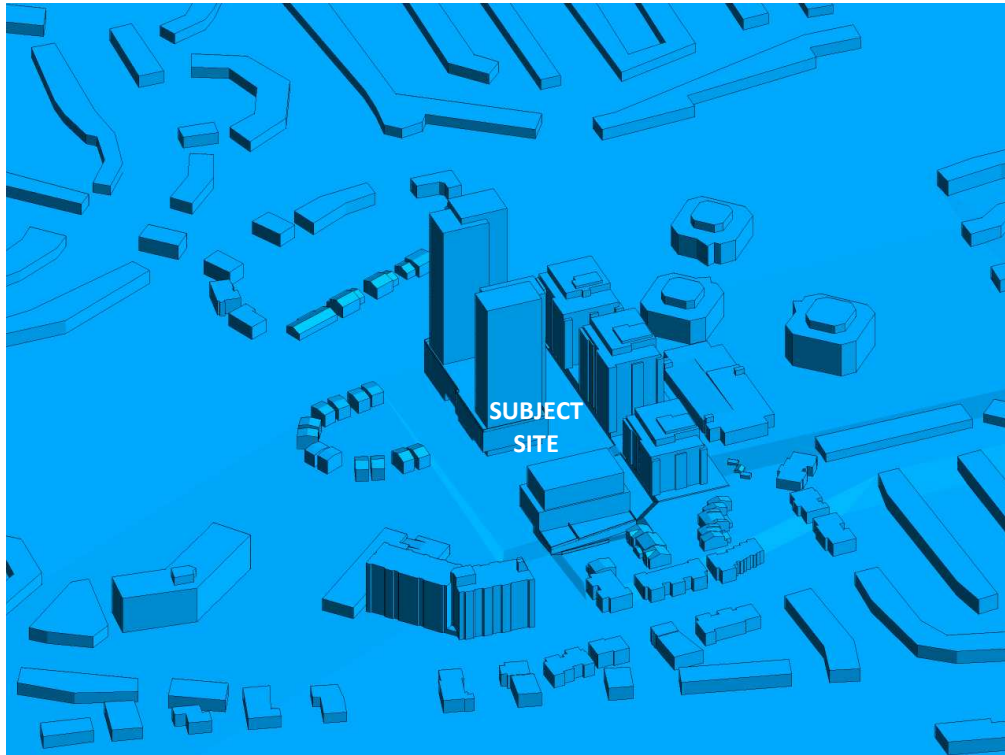


**FIGURE 2E: COMPUTATIONAL MODEL, PROPOSED MASSING, SOUTH PERSPECTIVE**

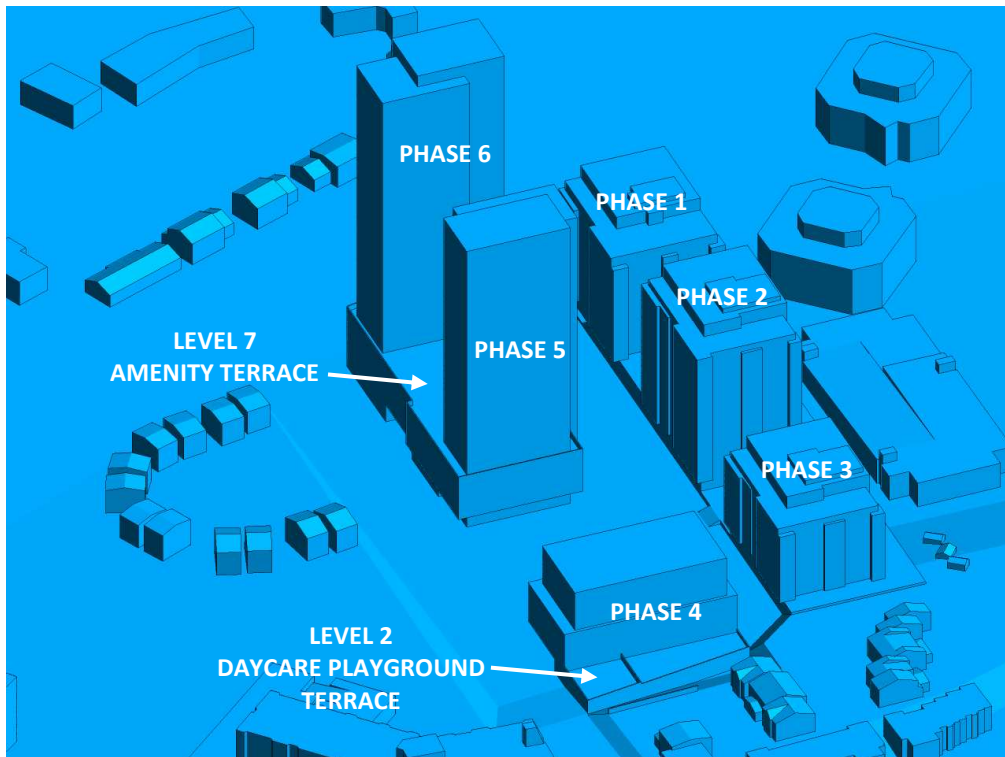


**FIGURE 2F: CLOSE UP OF FIGURE 2E**



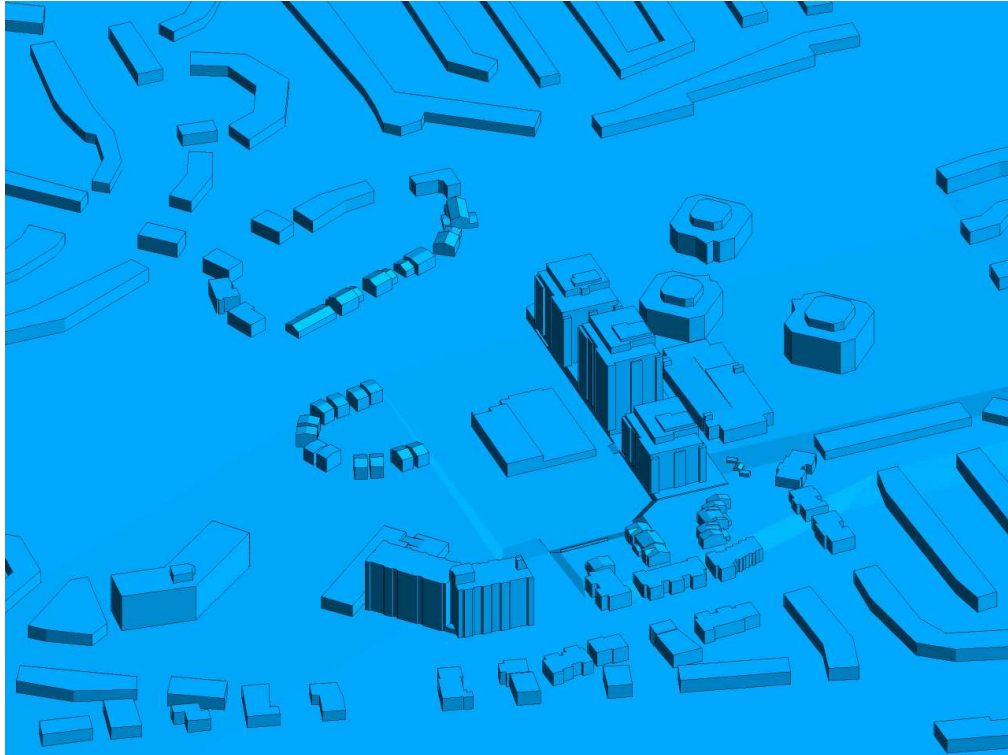


**FIGURE 2G: COMPUTATIONAL MODEL, EXISTING MASSING, SOUTH PERSPECTIVE**

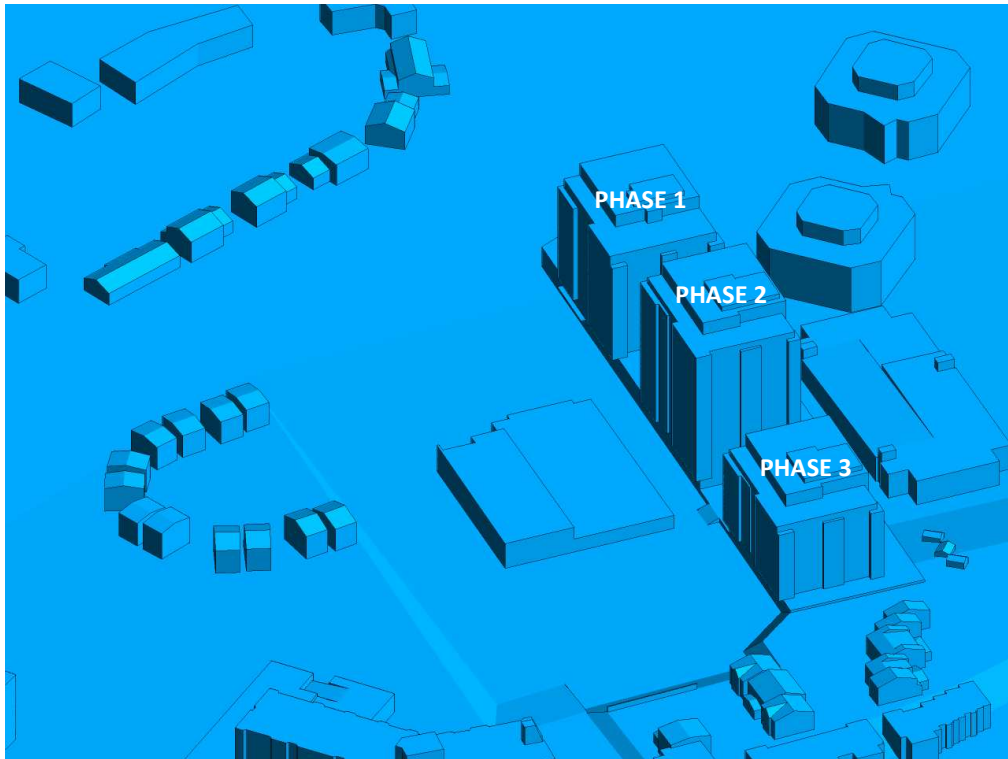


**FIGURE 2H: CLOSE UP OF FIGURE 2G**



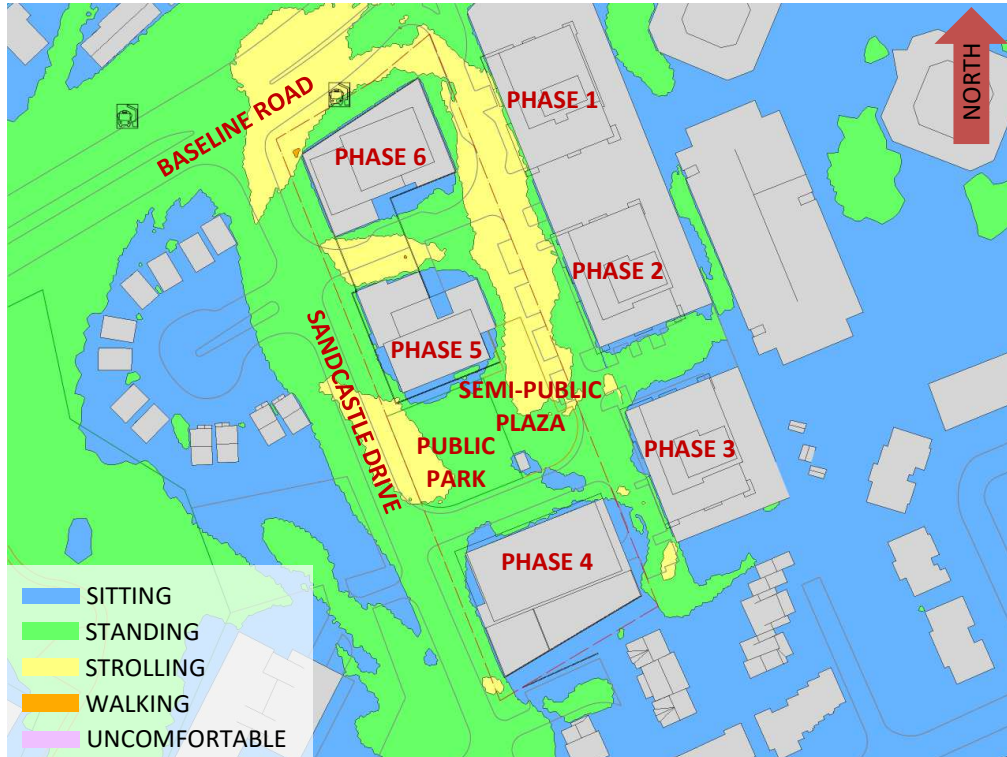


**FIGURE 3A: SPRING – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING**

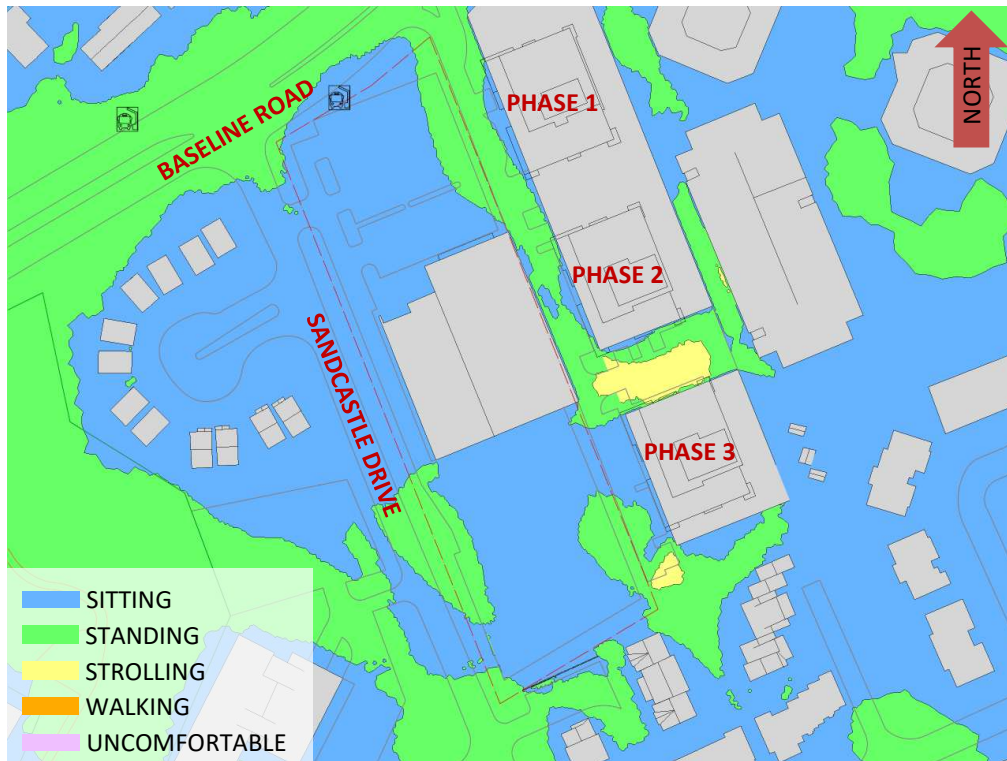


**FIGURE 3B: SPRING – WIND COMFORT, GRADE LEVEL – EXISTING MASSING**





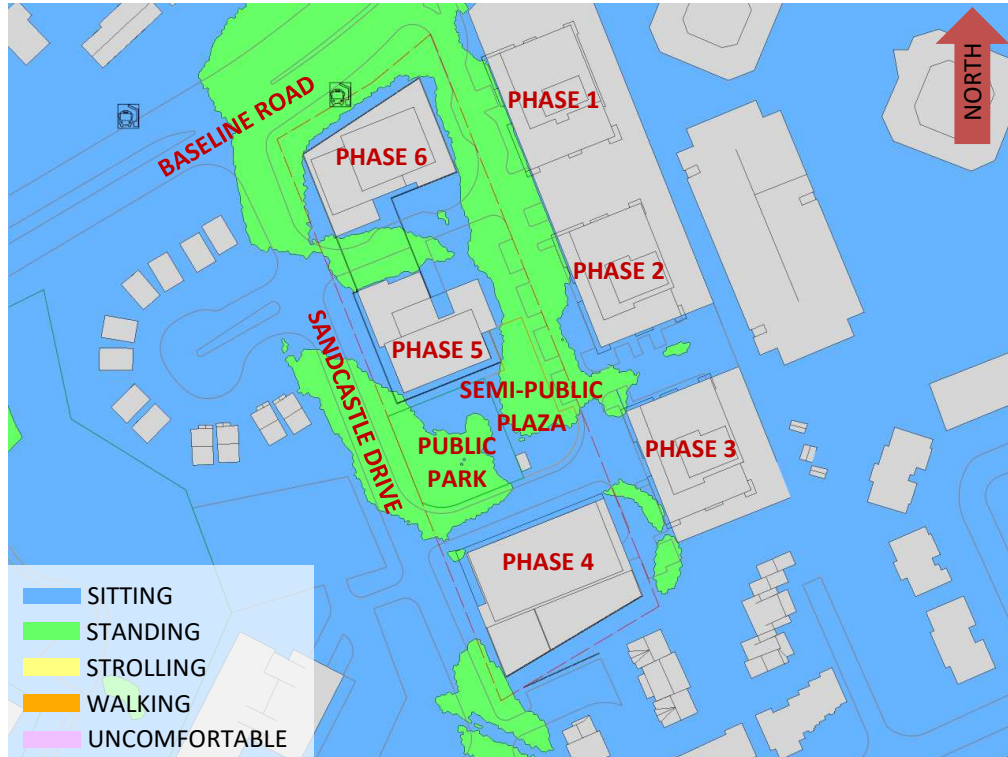

**FIGURE 4A: SUMMER – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING**

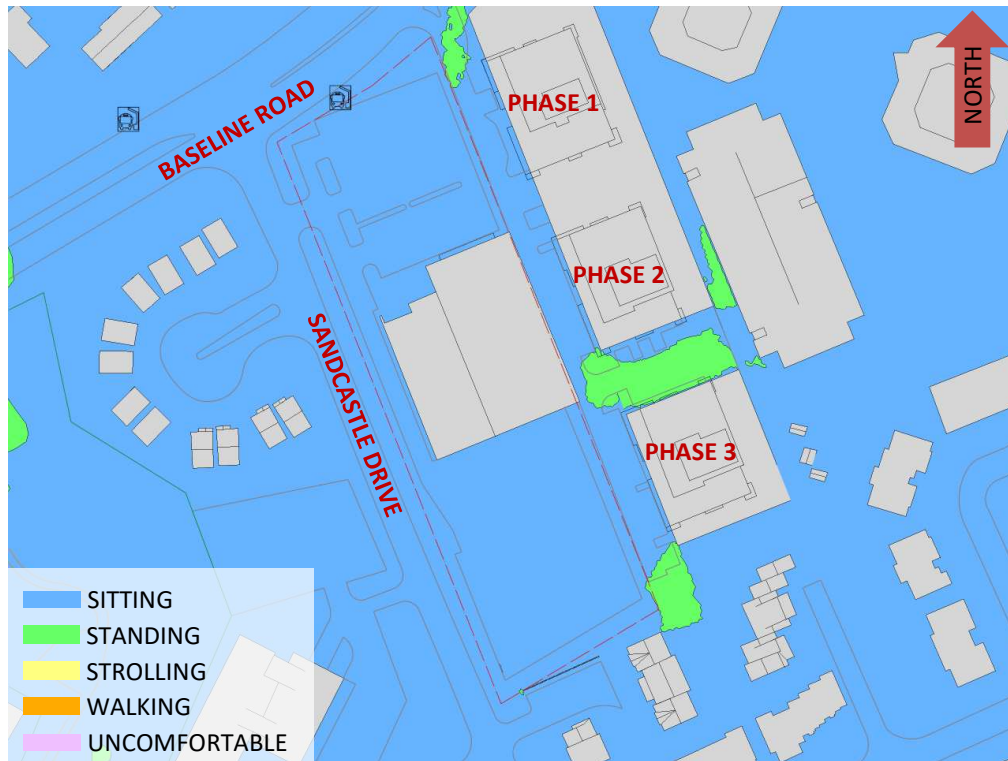

**FIGURE 4B: SUMMER – WIND COMFORT, GRADE LEVEL – EXISTING MASSING**



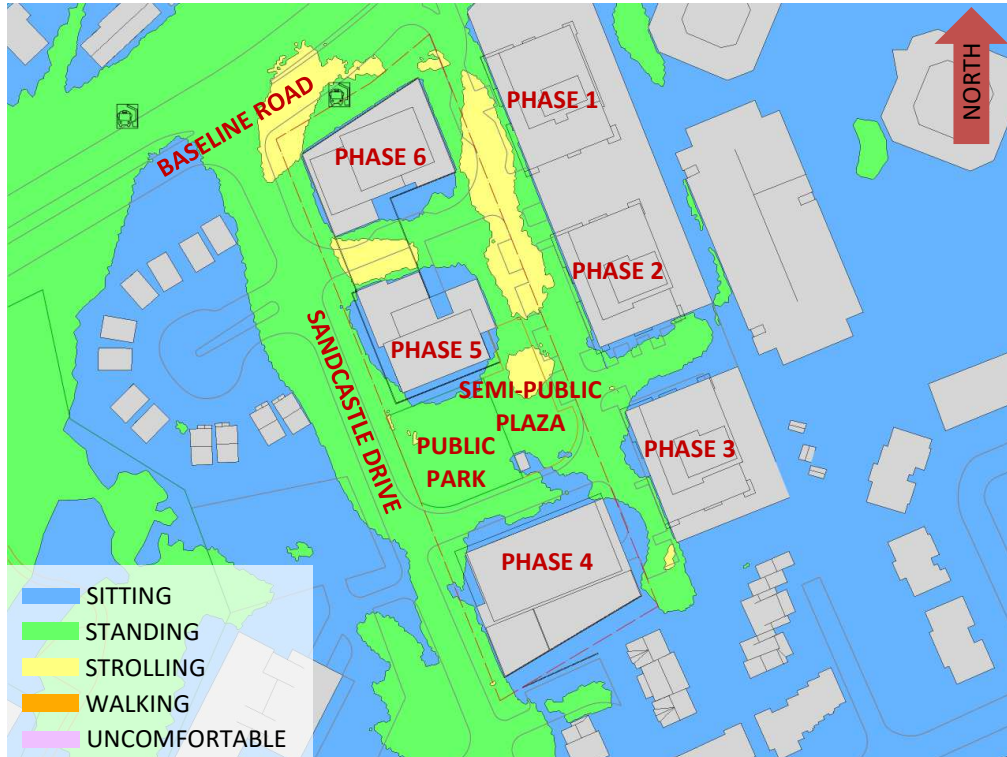


FIGURE 5A: AUTUMN – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING


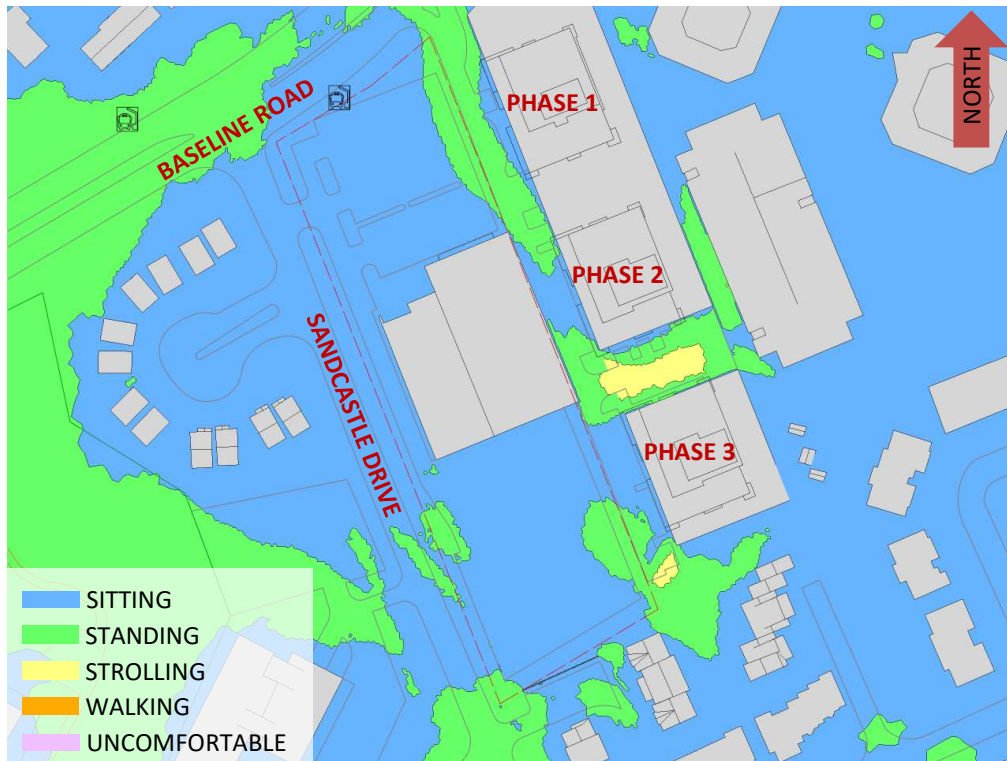



FIGURE 5B: AUTUMN – WIND COMFORT, GRADE LEVEL – EXISTING MASSING





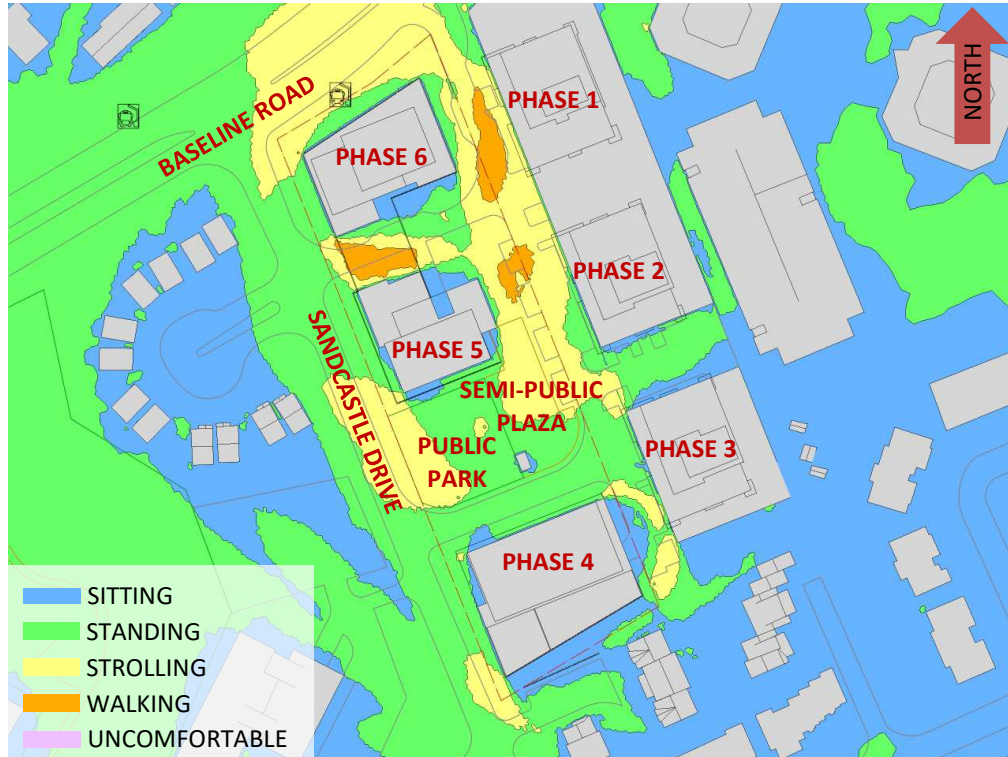


**FIGURE 6A: WINTER – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING**

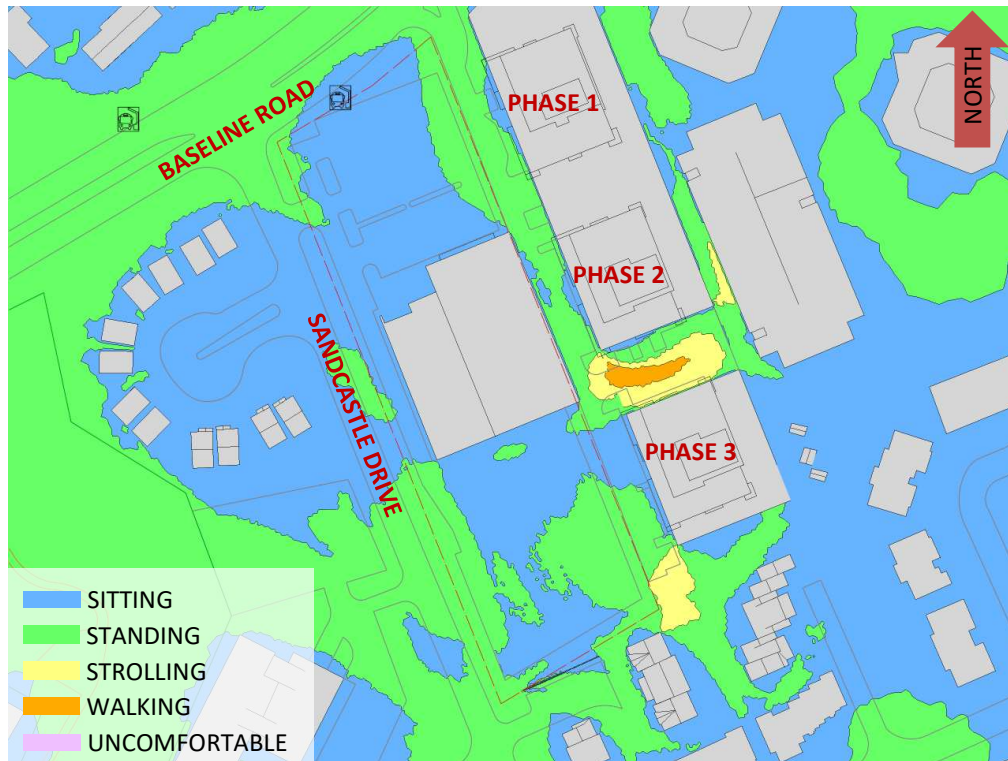

**FIGURE 6B: WINTER – WIND COMFORT, GRADE LEVEL – EXISTING MASSING**



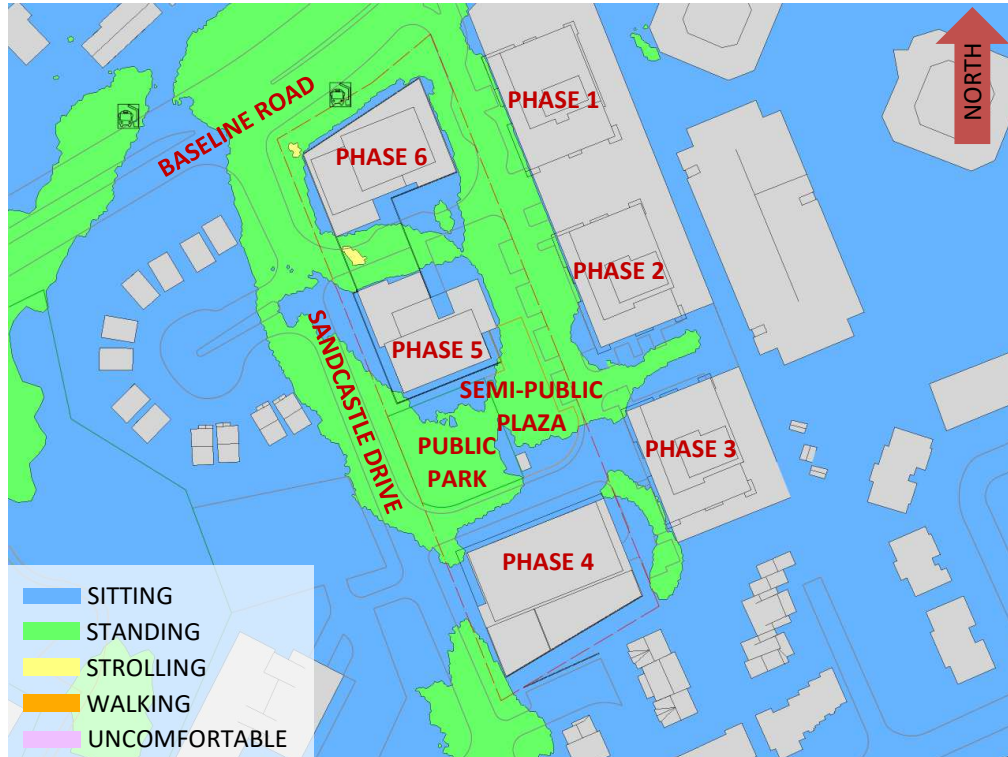

**FIGURE 7: TYPICAL USE PERIOD – WIND COMFORT, GRADE LEVEL**





**FIGURE 8A: SPRING – WIND COMFORT, LEVEL 2 DAYCARE PLAYGROUND TERRACE**



**FIGURE 8B: SUMMER – WIND COMFORT, LEVEL 2 DAYCARE PLAYGROUND TERRACE**






**FIGURE 8C: AUTUMN – WIND COMFORT, LEVEL 2 DAYCARE PLAYGROUND TERRACE**




**FIGURE 8D: WINTER – WIND COMFORT, LEVEL 2 DAYCARE PLAYGROUND TERRACE**



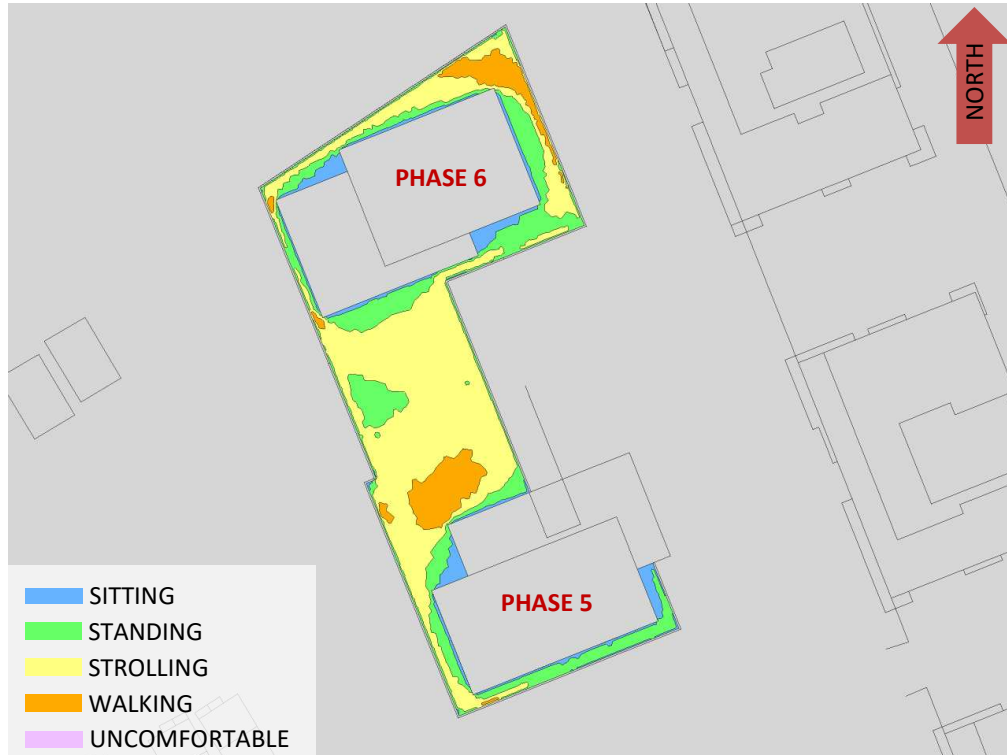


**FIGURE 9A: SPRING – WIND COMFORT, LEVEL 7 COMMON AMENITY TERRACE**

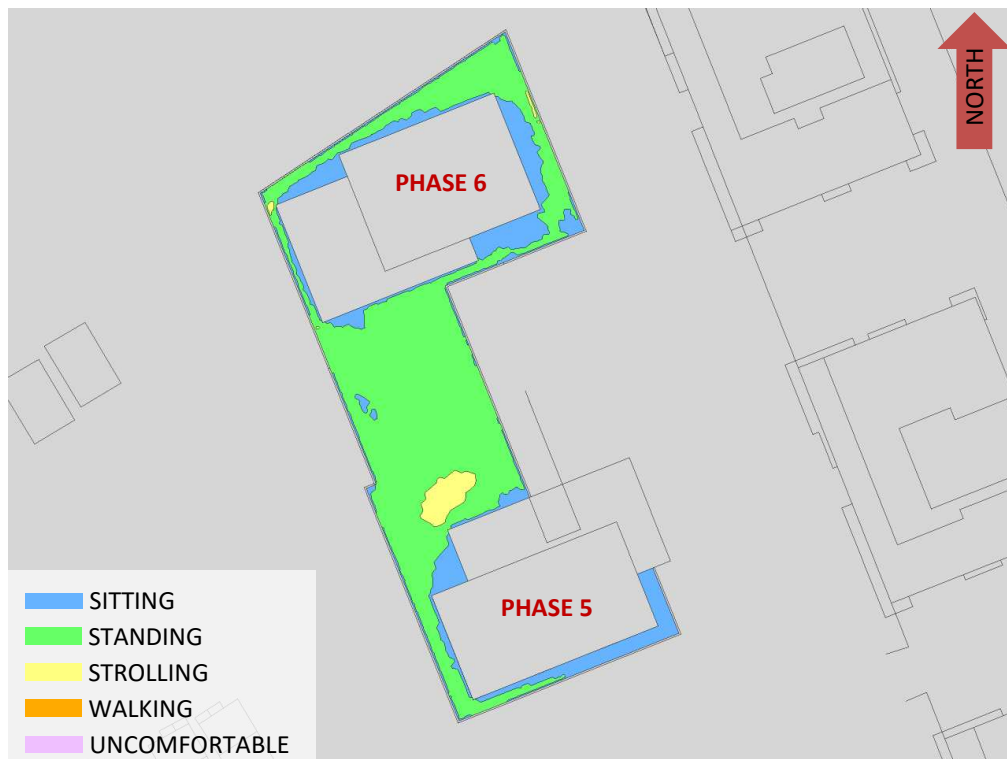


**FIGURE 9B: SUMMER – WIND COMFORT, LEVEL 7 COMMON AMENITY TERRACE**




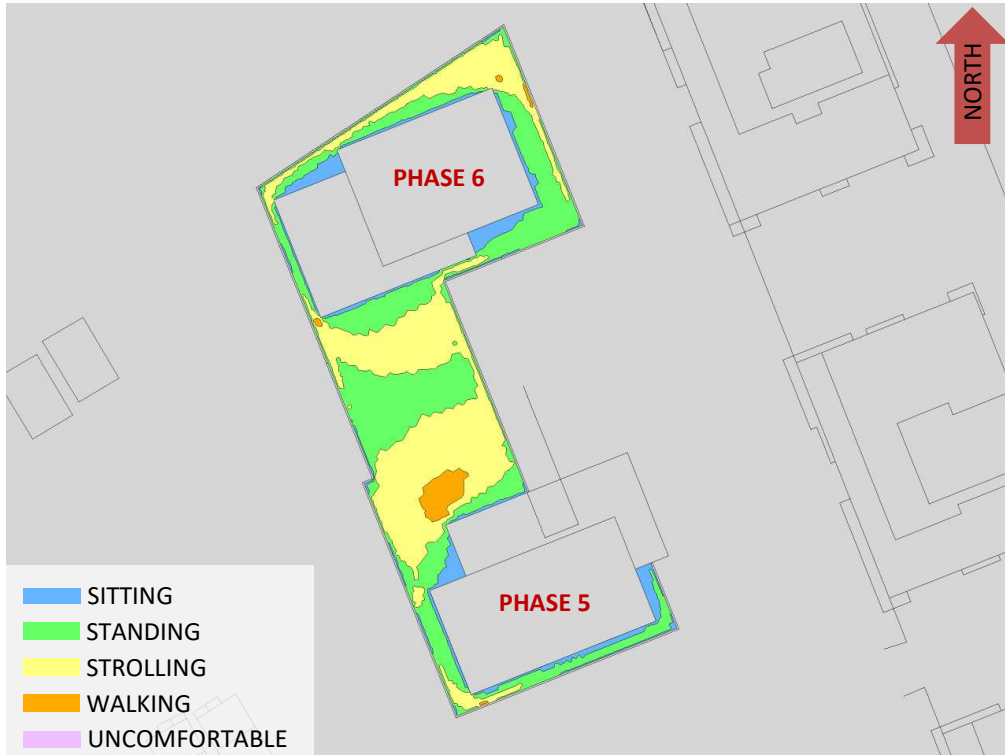

**FIGURE 9C: AUTUMN – WIND COMFORT, LEVEL 7 COMMON AMENITY TERRACE**

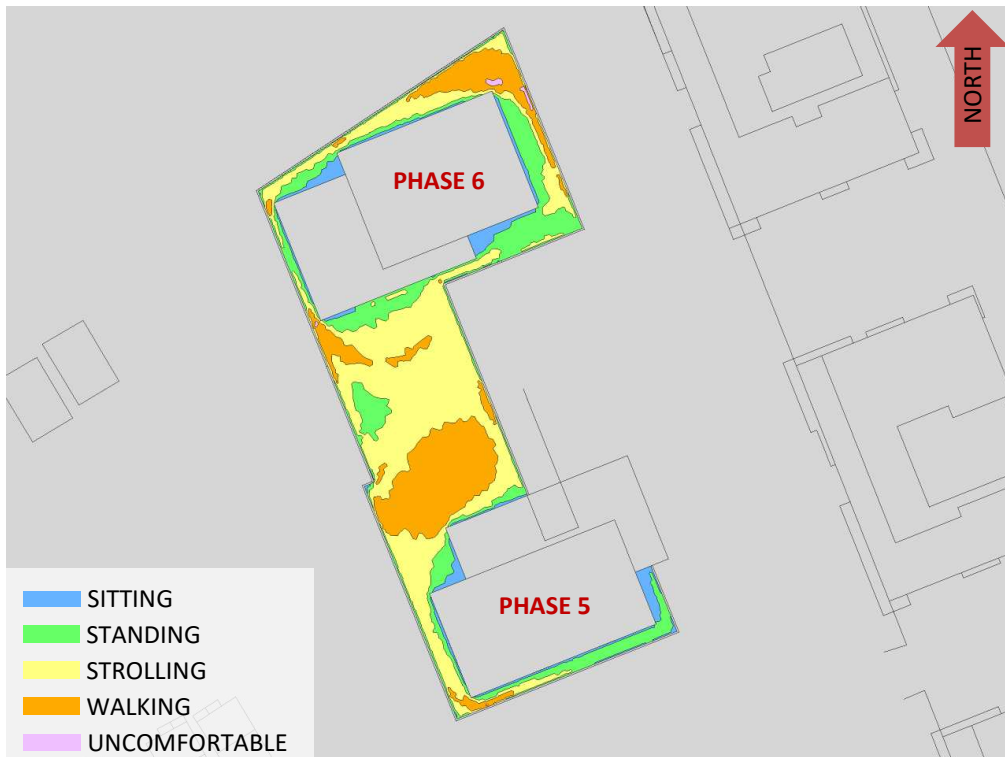

**FIGURE 9D: WINTER – WIND COMFORT, LEVEL 7 COMMON AMENITY TERRACE**

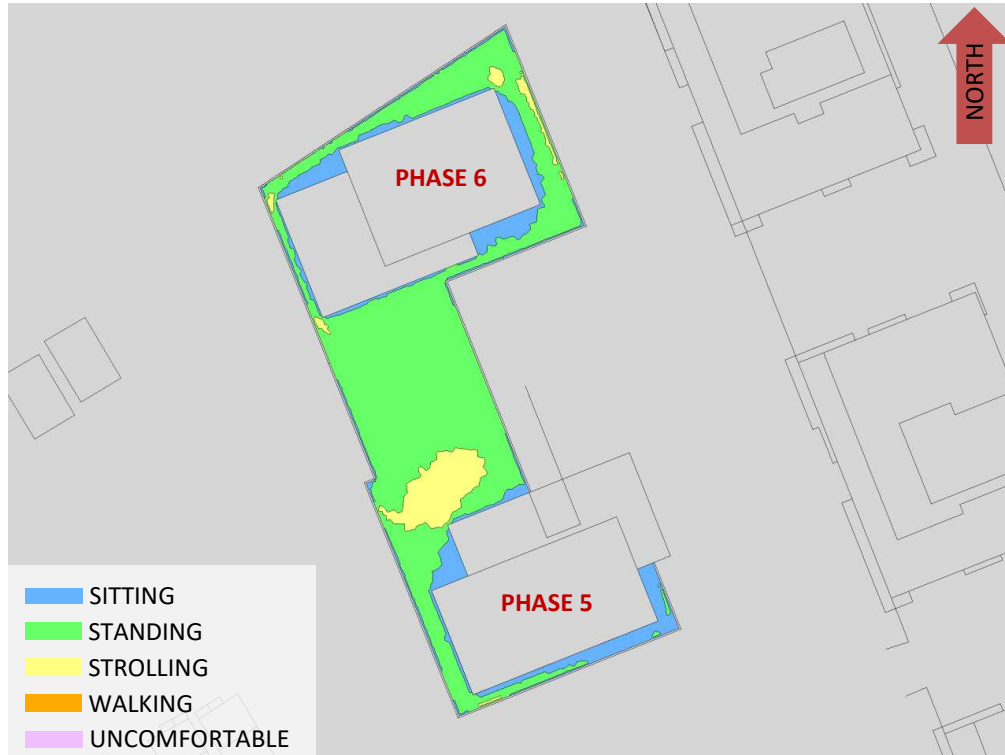


**FIGURE 10: TYPICAL USE PERIOD – LEVEL 7 COMMON AMENITY TERRACE**



# GRADIENTWIND

ENGINEERS & SCIENTISTS

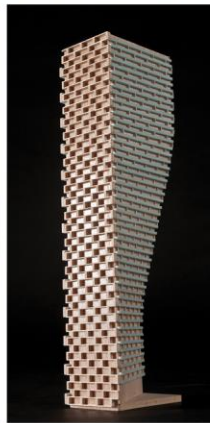

## APPENDIX A

### SIMULATION OF THE ATMOSPHERIC BOUNDARY LAYER

## **SIMULATION OF THE ATMOSPHERIC BOUNDARY LAYER**

The atmospheric boundary layer (ABL) is defined by the velocity and turbulence profiles according to industry standard practices. The mean wind profile can be represented, to a good approximation, by a power law relation, Equation (1), giving height above ground versus wind speed (1), (2).

$$U = U_g \left( \frac{Z}{Z_g} \right)^\alpha \quad \text{Equation (1)}$$

where,  $U$  = mean wind speed,  $U_g$  = gradient wind speed,  $Z$  = height above ground,  $Z_g$  = depth of the boundary layer (gradient height), and  $\alpha$  is the power law exponent.

For the model,  $U_g$  is set to 6.5 metres per second, which approximately corresponds to the 60% mean wind speed for Ottawa based on historical climate data and statistical analyses. When the results are normalized by this velocity, they are relatively insensitive to the selection of gradient wind speed.

$Z_g$  is set to 540 m. The selection of gradient height is relatively unimportant, so long as it exceeds the building heights surrounding the subject site. The value has been selected to correspond to our physical wind tunnel reference value.

$\alpha$  is determined based on the upstream exposure of the far-field surroundings (that is, the area that it not captured within the simulation model).

Table 1 presents the values of  $\alpha$  used in this study, while Table 2 presents several reference values of  $\alpha$ . When the upstream exposure of the far-field surroundings is a mixture of multiple types of terrain, the  $\alpha$  values are a weighted average with terrain that is closer to the subject site given greater weight.

**TABLE 1: UPSTREAM EXPOSURE (ALPHA VALUE) VS TRUE WIND DIRECTION**

Wind Direction (Degrees True)	Alpha Value ( $\alpha$ )
0	0.25
49	0.25
74	0.24
103	0.24
167	0.20
197	0.18
217	0.19
237	0.21
262	0.20
282	0.20
301	0.21
324	0.21

**TABLE 2: DEFINITION OF UPSTREAM EXPOSURE (ALPHA VALUE)**

Upstream Exposure Type	Alpha Value ( $\alpha$ )
Open Water	0.14-0.15
Open Field	0.16-0.19
Light Suburban	0.21-0.24
Heavy Suburban	0.24-0.27
Light Urban	0.28-0.30
Heavy Urban	0.31-0.33

The turbulence model in the computational fluid dynamics (CFD) simulations is a two-equation shear-stress transport (SST) model, and thus the ABL turbulence profile requires that two parameters be defined at the inlet of the domain. The turbulence profile is defined following the recommendations of the Architectural Institute of Japan for flat terrain (3).

$$I(Z) = \begin{cases} 0.1 \left( \frac{Z}{Z_g} \right)^{-\alpha-0.05}, & Z > 10 \text{ m} \\ 0.1 \left( \frac{10}{Z_g} \right)^{-\alpha-0.05}, & Z \leq 10 \text{ m} \end{cases} \quad \text{Equation (2)}$$

$$L_t(Z) = \begin{cases} 100 \text{ m} \sqrt{\frac{Z}{30}}, & Z > 30 \text{ m} \\ 100 \text{ m}, & Z \leq 30 \text{ m} \end{cases} \quad \text{Equation (3)}$$

where,  $I$  = turbulence intensity,  $L_t$  = turbulence length scale,  $Z$  = height above ground, and  $\alpha$  is the power law exponent used for the velocity profile in Equation (1).

Boundary conditions on all other domain boundaries are defined as follows: the ground is a no-slip surface; the side walls of the domain have a symmetry boundary condition; the top of the domain has a specified shear, which maintains a constant wind speed at gradient height; and the outlet has a static pressure boundary condition.



## REFERENCES

- [1] P. Arya, "Chapter 10: Near-neutral Boundary Layers," in *Introduction to Micrometeorology*, San Diego, California, Academic Press, 2001.
- [2] S. A. Hsu, E. A. Meindl and D. B. Gilhousen, "Determining the Power-Law Wind Profile Exponent under Near-neutral Stability Conditions at Sea," vol. 33, no. 6, 1994.
- [3] Y. Tamura, H. Kawai, Y. Uematsu, K. Kondo and T. Okhuma, "Revision of AIJ Recommendations for Wind Loads on Buildings," in *The International Wind Engineering Symposium, IWES 2003*, Taiwan, 2003.