


### Copyright Reserved

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay.  
The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

### Legend

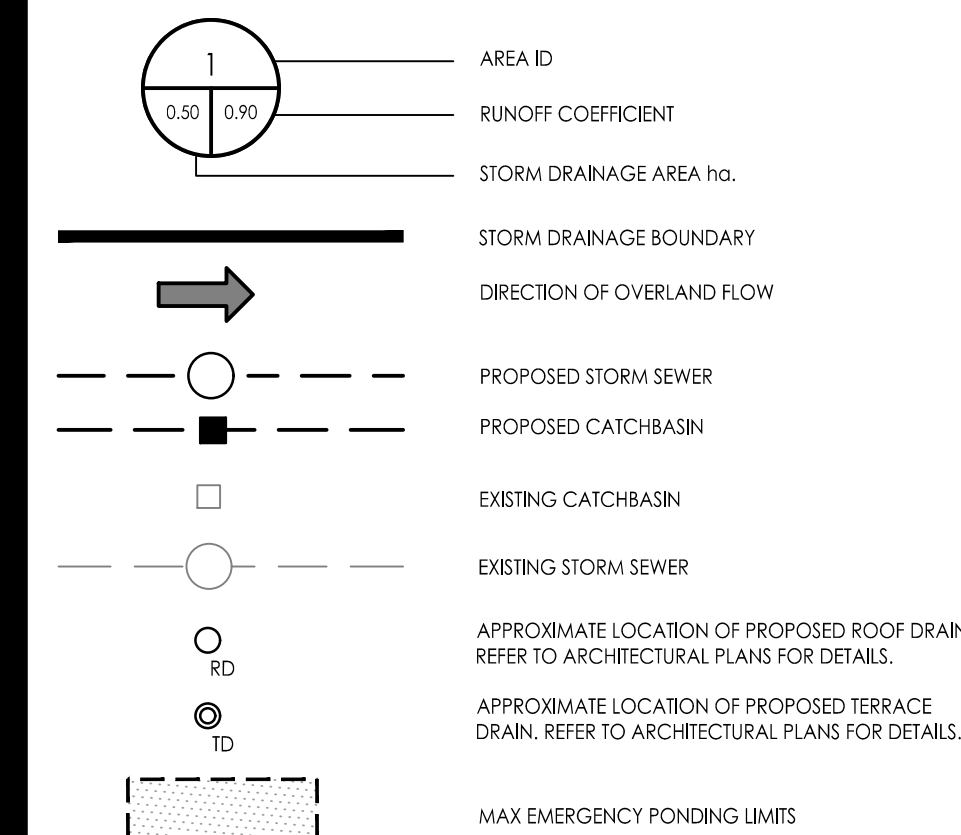

### Notes

- 1. REQUIRED CISTERN VOLUME 10m<sup>3</sup>

4	REVISED ROAD GEOMETRY	WJ	DT	24.09.18
3	REVISED PER CITY COMMENTS	WJ	DT	24.08.13
2	REVISED PER CITY COMMENTS	WJ	DT	24.05.27
1	ISSUED FOR REVIEW	TM	DT	23.06.12

Revision By Appd. YY.MM.DD

File Name: 160401784 DB.dwg TM KK TM 23.03.15  
Dwn. Chkd. Dgn. YY.MM.DD

### Permit-Seal



### Client/Project

Project1 Studio


47 BEECHWOOD AVENUE

OTTAWA, ONTARIO, CANADA

### Title

STORM DRAINAGE PLAN

Project No.  
1604001786



Drawing No.

Sheet


Revision

SD-1

5 of 6

4

PLAN # 19043

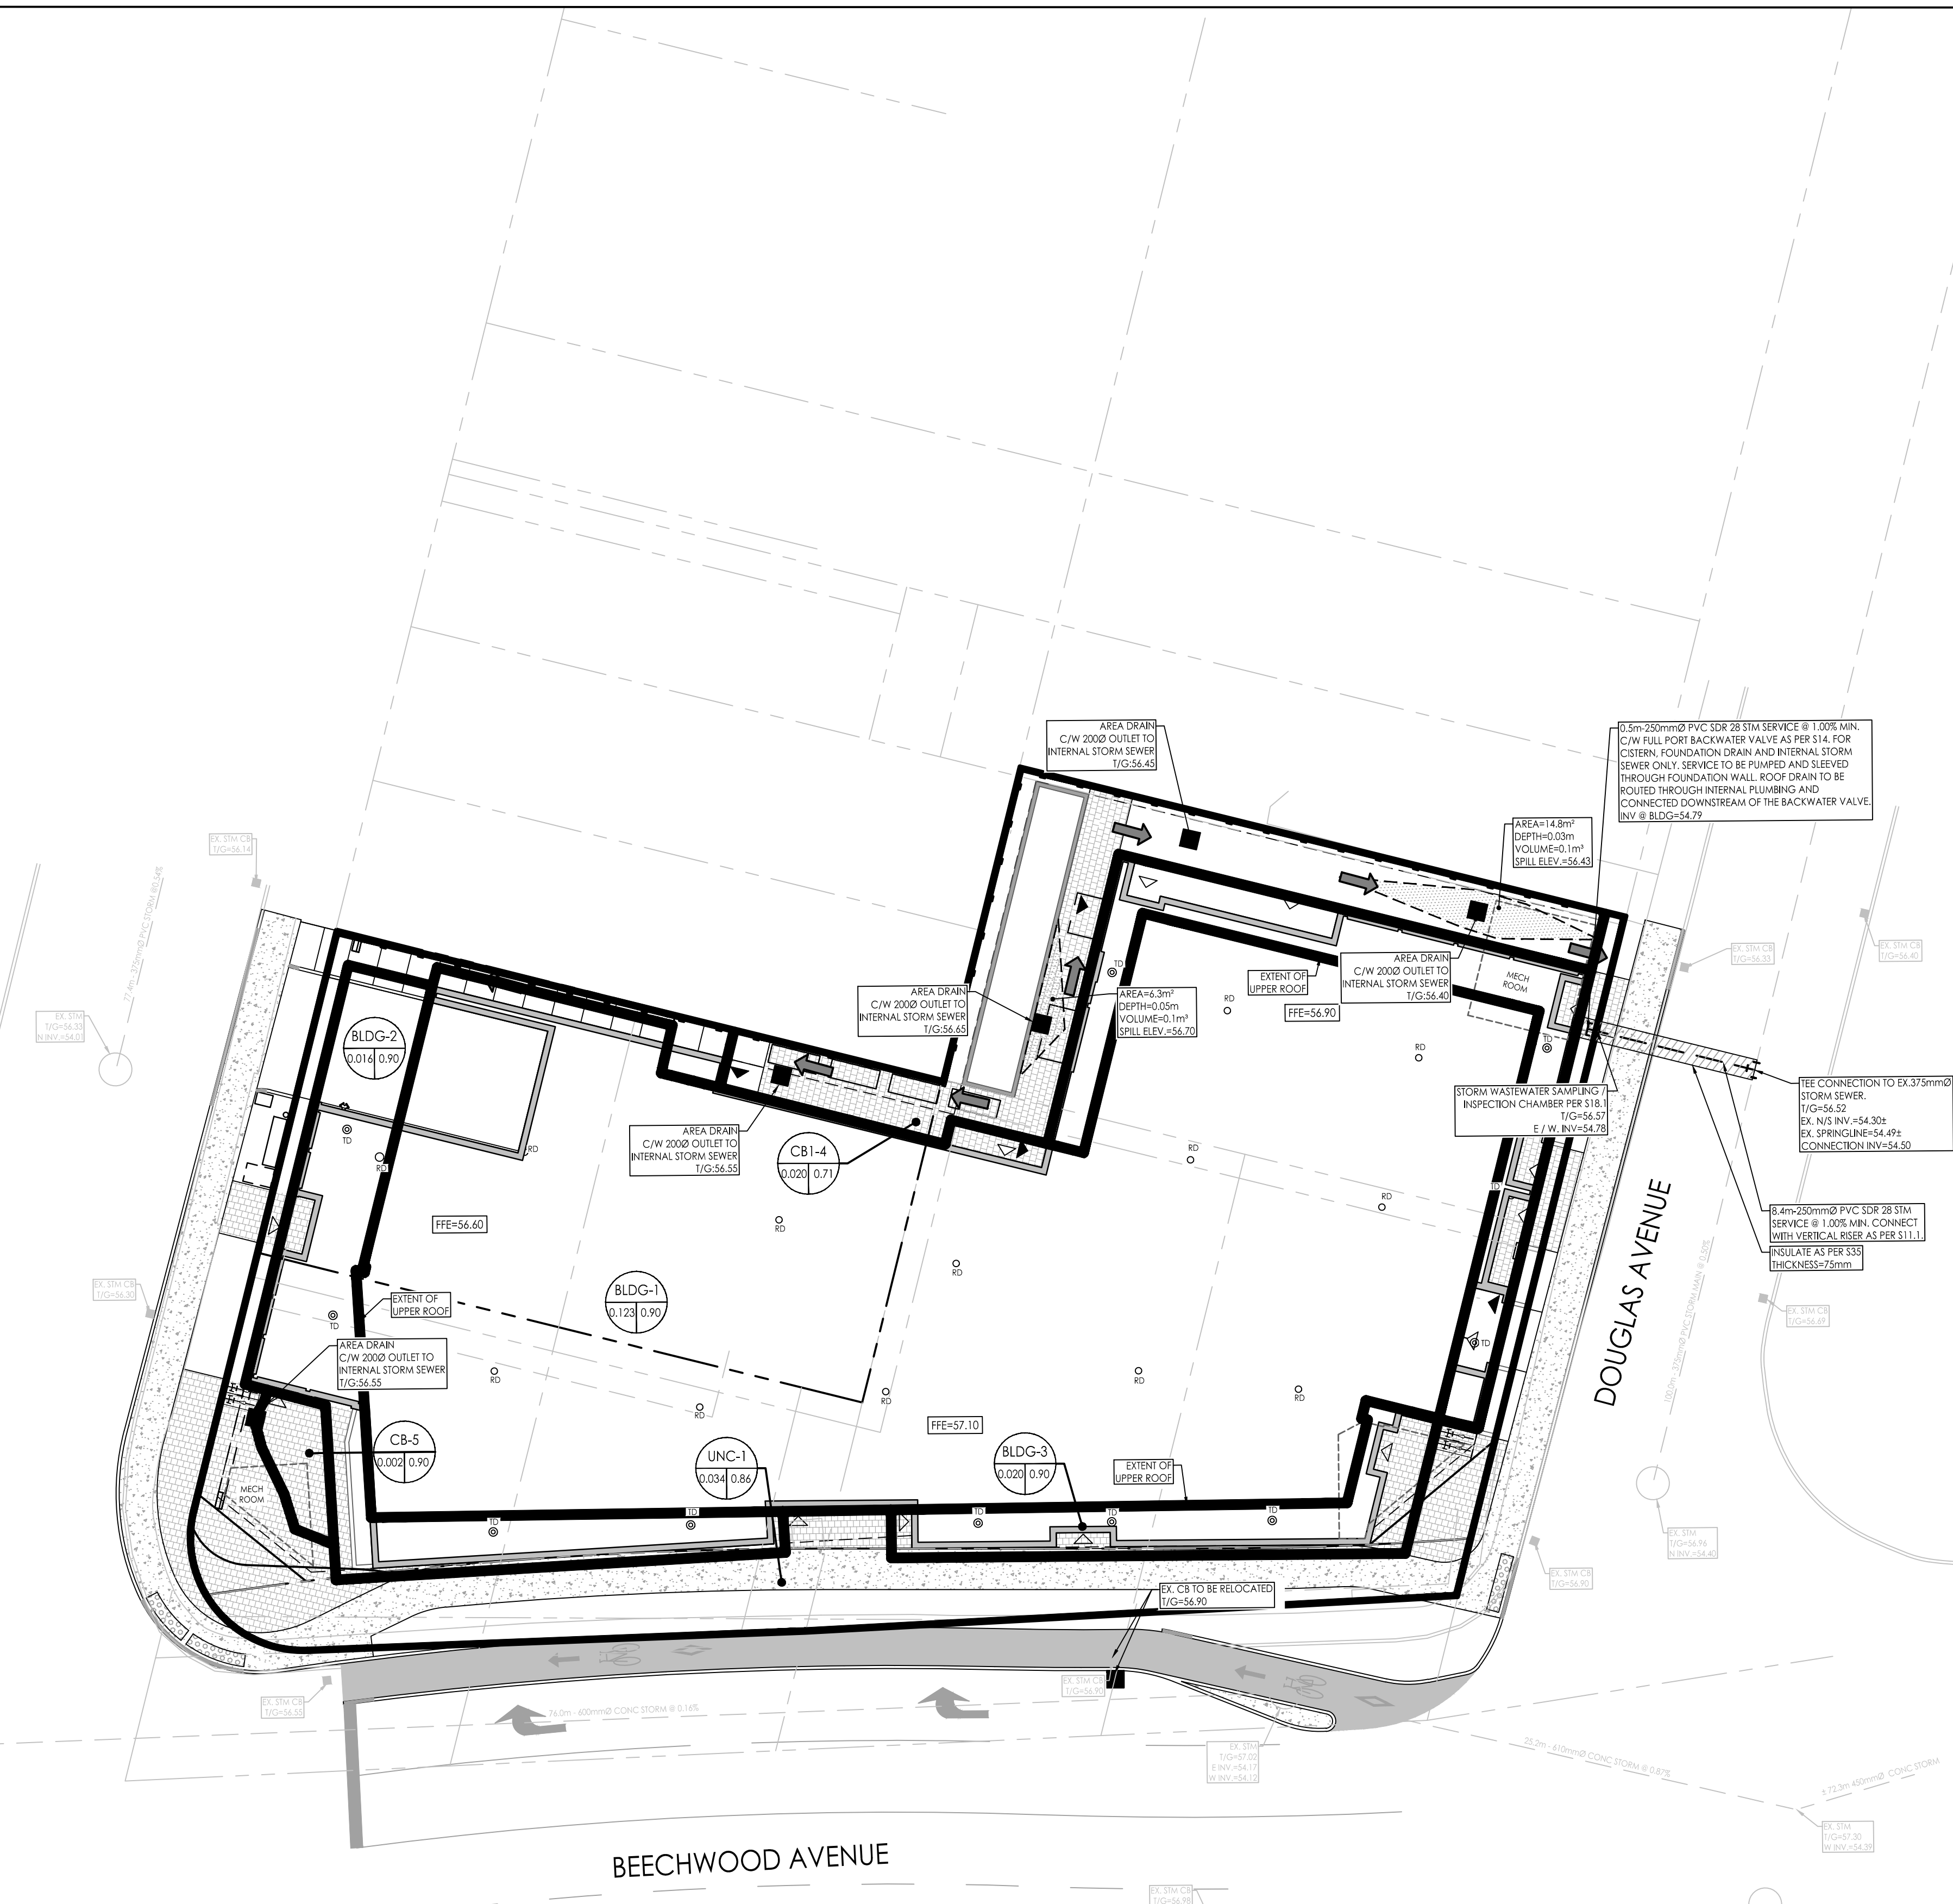

PROPOSED 3 STOREY APARTMENT BUILDING  
FF=VARIES (REFER TO GRADING PLAN)  
P1 PARKING=53.25  
USF=152.48

REFER TO ARCHITECTURAL PLANS FOR TOF ELEVATIONS. TOF TO REMAIN MIN. 0.15m ABOVE FINISHED GRADE.

MAX 100-YR ROOF RELEASE RATE = 10.8 L/s  
TOTAL PEAK FLOW TO CISTERN = 27.7 L/s  
MAX 100-YR CISTERN RELEASE RATE = 12.2 L/s  
CISTERN VOLUME REQUIRED = 10 m<sup>3</sup>

SUMP PUMP REQUIRED TO DISCHARGE INTERNAL STORM SEWER AND FOUNDATION DRAIN. SUMP PUMP REQUIRED FOR PARKADE LEVEL 1. REFER TO MECHANICAL DRAWINGS FOR DETAILS.

PROPOSED BUILDING TO BE EQUIPPED WITH PRESSURE REDUCING VALVES AS PER THE ONTARIO BUILDING CODE.

SCHEDULE OF ROOF RELEASE RATES						
DRAINAGE AREA ID	DRAIN TYPE	# DRAINS	2YR HEAD (m)	100 YEAR HEAD (m)	2YR RELEASE RATE (L/s)	100 YEAR RELEASE RATE (L/s)
BLDG	WATTS R1 00 ACCUTROL (23% OPEN)	12	0.08	0.14	8.8	10.8

X:\Projects\160401784\Design\storm.dwg (160401784 DB.dwg) 2024/09/18 11:50 AM by: jstevens