



OWNER:
 NIVO DEVELOPMENTS INC.
 255 MICHAEL COMPLAND DRIVE
 OTTAWA, ONTARIO, K2M 0M5
 613-224-6200



SECTION SWALE
 AS PER CITY OF
 OTTAWA DRAWING S29
 N.T.S.

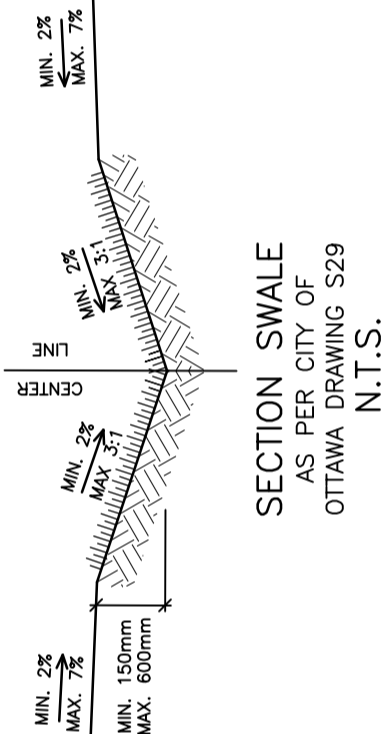


SUB-DRAIN
 (CONNECT TO STORM MANHOLE OR CATCH BASIN)
 N.T.S.

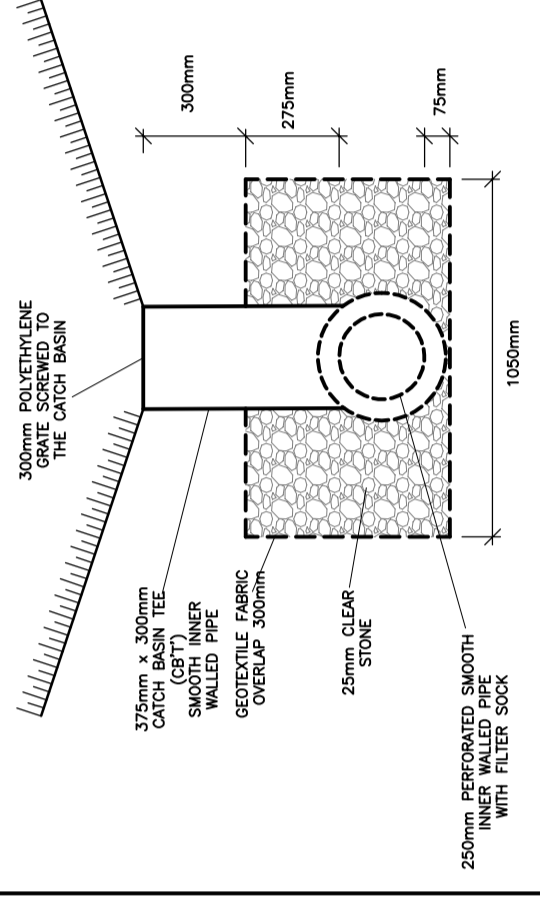

SUB-DRAIN
 (CONNECT TO STORM MANHOLE OR CATCH BASIN)
 N.T.S.

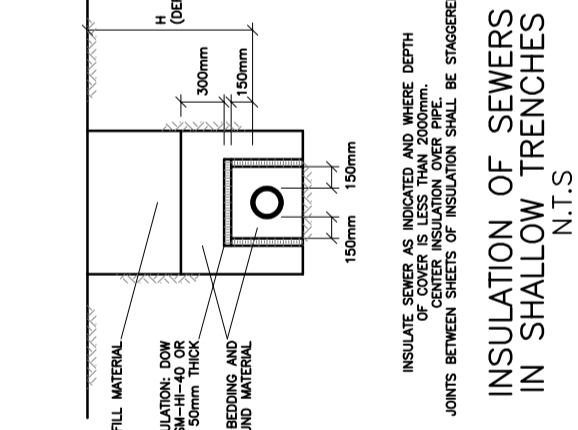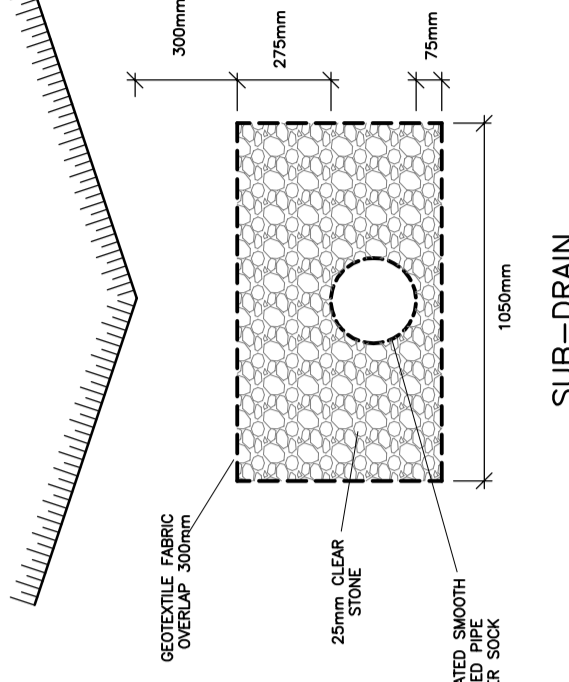


INSULATION OF SEWERS
 IN SHALLOW TRENCHES
 N.T.S.

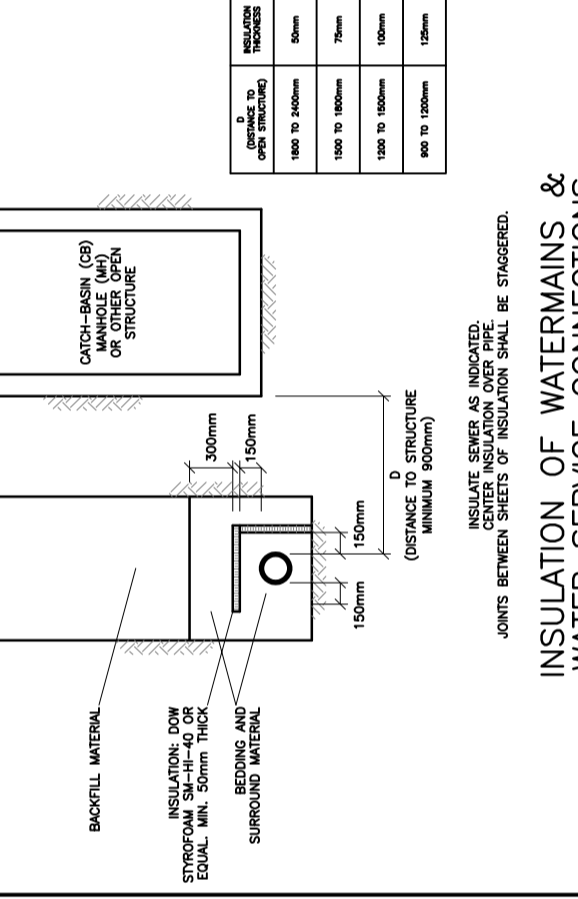


INSULATION OF WATERMAINS &
 WATER SERVICE CONNECTIONS
 AT OPEN STRUCTURES
 AS PER CITY OF OTTAWA DRAWING NO. W23
 N.T.S.

INSULATION OF SEWERS
 IN SHALLOW TRENCHES
 N.T.S.

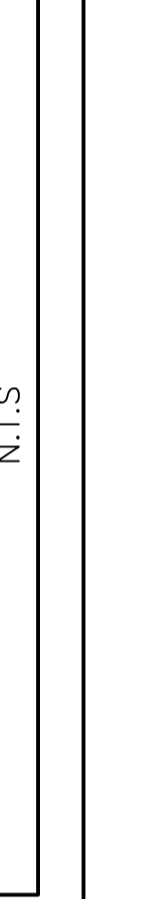


INSULATION OF SEWERS
 IN SHALLOW TRENCHES
 N.T.S.

INSULATION OF SEWERS
 IN SHALLOW TRENCHES
 N.T.S.

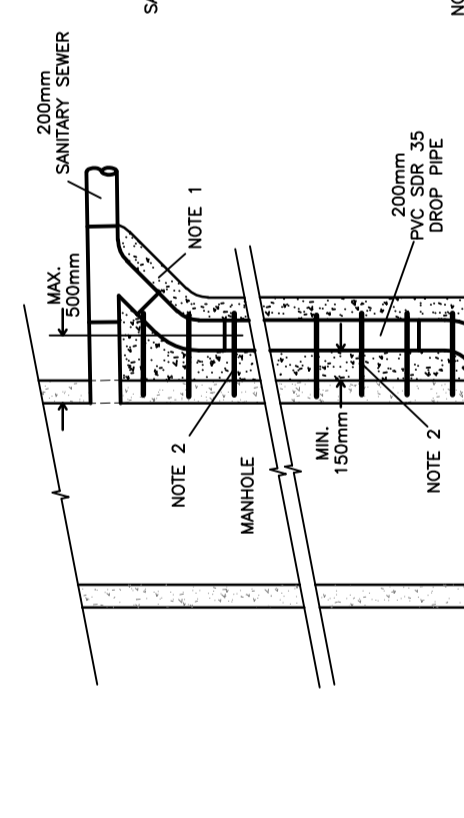

DROP PIPE STRUCTURE
 AT MANHOLE MH-SA.6
 N.T.S.

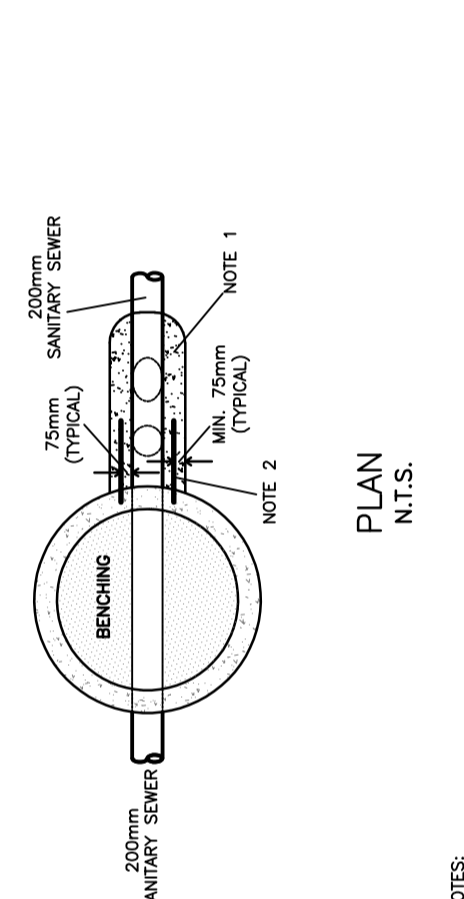


DROP PIPE STRUCTURE
 AT MANHOLE MH-SA.6
 N.T.S.

OVERFLOW DROP PIPE
 AT MANHOLE CB/MH-4
 N.T.S.



OVERFLOW DROP PIPE
 AT MANHOLE CB/MH-4
 N.T.S.

OVERFLOW DROP PIPE
 AT MANHOLE CB/MH-10
 N.T.S.

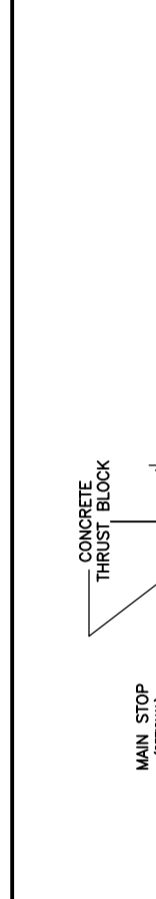

OVERFLOW DROP PIPE
 AT MANHOLE CB/MH-10
 N.T.S.

KEY PLAN



No.	DATE	REVISION
1	JUN 14-19	PRELIMINARY
2	AUG 9-19	ISSUED FOR APPROVAL
3	SEP 27-19	RE-ISSUED FOR APPROVAL
4	MAY 5-20	ISSUED FOR COORDINATION
5	JUN 18-20	RE-ISSUED FOR APPROVAL
6	NOV 16-20	RE-ISSUED FOR APPROVAL
7	MAR 15-21	RE-ISSUED FOR APPROVAL
8	MAY 20-21	RE-ISSUED FOR APPROVAL
9	MAY 31-21	RE-ISSUED FOR APPROVAL


D. B. GRAY ENGINEERING INC.
 700 Long Point Circle
 Ottawa, Ontario
 4gray@dbgrayengineering.com
 613-425-8044

PROPOSED
 RESIDENTIAL DEVELOPMENT
 1164-1166 HIGHCROFT DR.
 MANOTICK, ONTARIO

DETAILS
 Drawing Title


Engineer's Seal
 D.B. GRAY
 700 LONG POINT CIRCLE
 OTTAWA, ONTARIO
 K1L 1S5
 613-425-8044
 180335
 DRAWING No. C-8
 of 14
 NOT VALID UNLESS
 SIGNED & DATED

STORMWATER CISTERN 1 SECTION
 MACGREGOR 18,600 LITRE (4,100 GALLON)
 CONCRETE TANK
 INTERIOR DIMENSIONS: 4.975m (L) x 2.390m (W) x 1.860m (D)
 N.T.S.

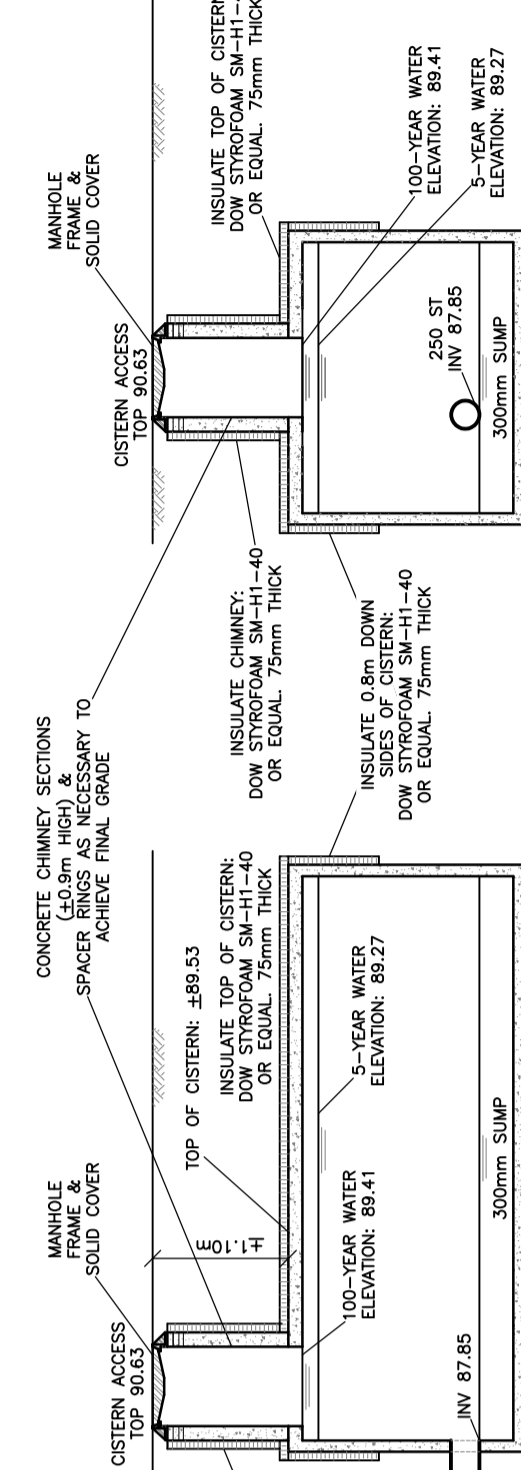


SIMPS SHALL BE CLEANED PERIODICALLY
 AT LEAST ONCE PER YEAR IN THE SPRING

STORMWATER CISTERN 2 SECTION
 MACGREGOR 41,300 LITRE (9,000 GALLON)
 CONCRETE TANK
 INTERIOR DIMENSIONS: 5.795m (L) x 2.750m (W) x 2.855m (D)
 N.T.S.

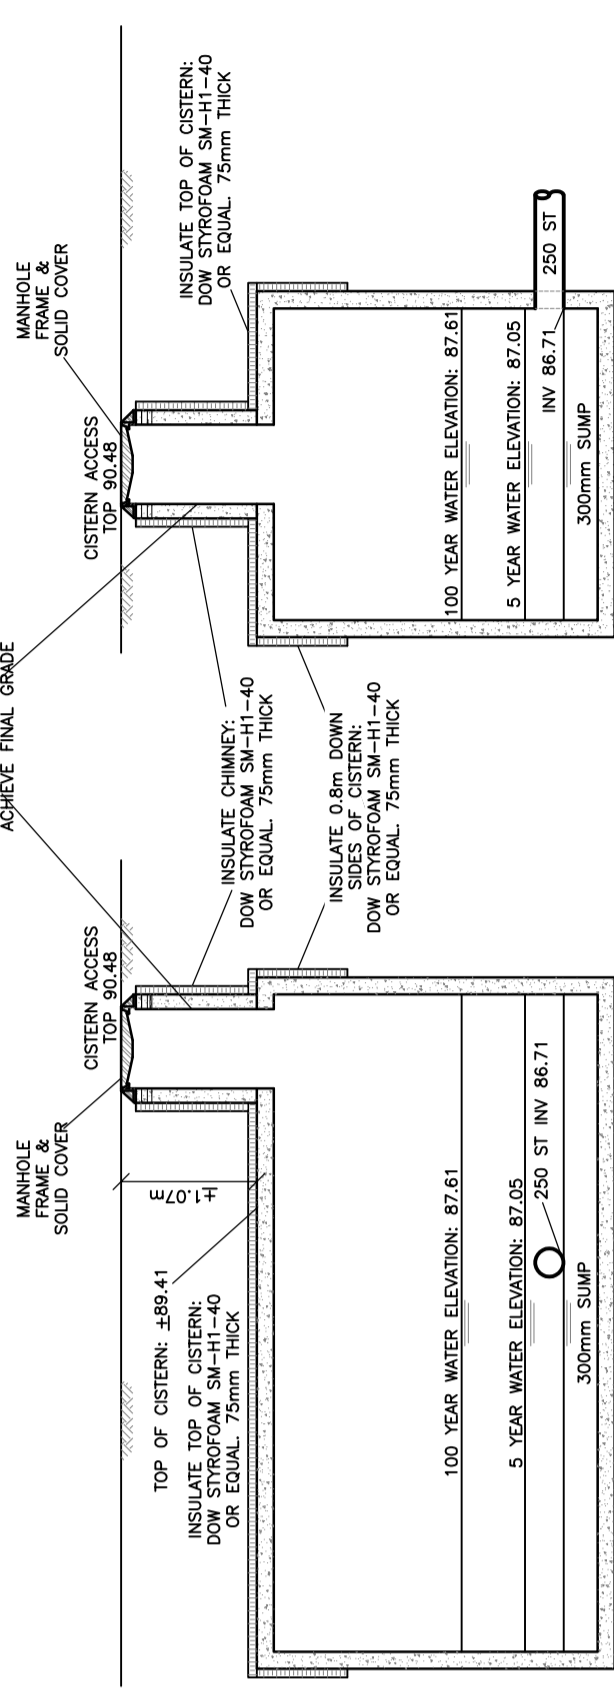


SIMPS SHALL BE CLEANED PERIODICALLY
 AT LEAST ONCE PER YEAR IN THE SPRING

STORMWATER CISTERN 3 SECTION
 MACGREGOR 41,300 LITRE (9,000 GALLON)
 CONCRETE TANK
 INTERIOR DIMENSIONS: 5.795m (L) x 2.750m (W) x 2.855m (D)
 N.T.S.

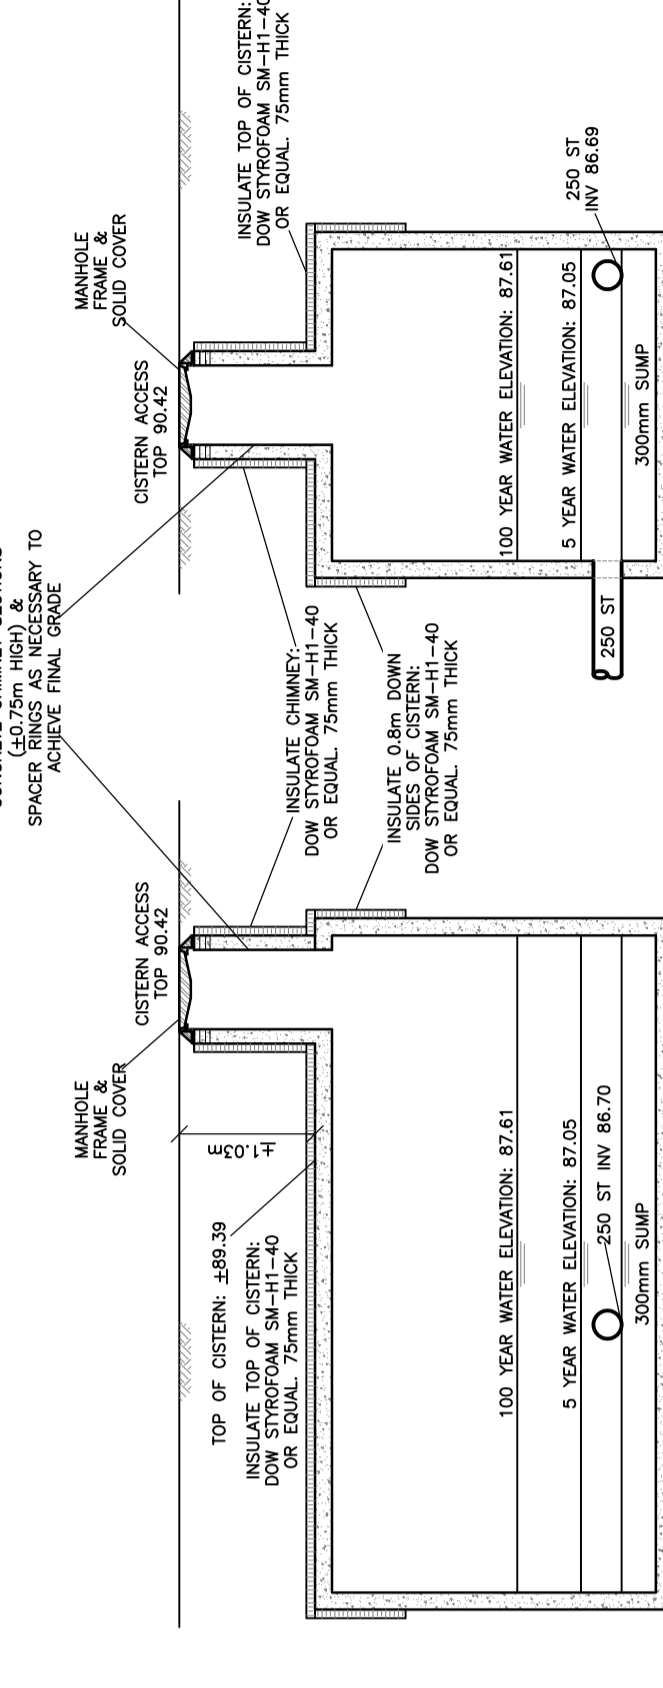

SIMPS SHALL BE CLEANED PERIODICALLY
 AT LEAST ONCE PER YEAR IN THE SPRING

CONCRETE THRUST BLOCKS
 MODIFIED CITY OF OTTAWA DRAWING W95.3 FOR 200mm
 WATERMAIN AND SOILS HAVING A BEARING CAPACITY OF 90kPa

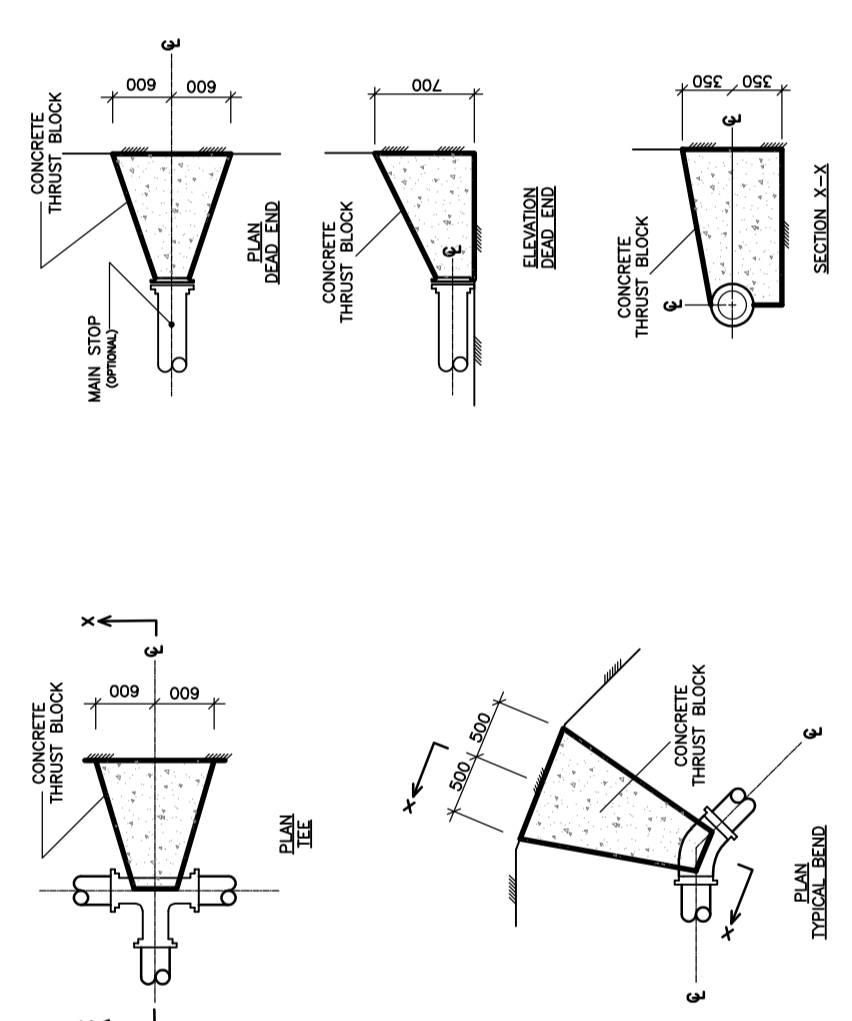

1. CONCRETE SHALL BE PLACED TO WITHIN 50mm OF FACE OF THE BELL.
2. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN.
3. THRUST BLOCKS SHALL BE PLACED TO WITHIN 50mm OF THE FACE OF THE BELL.
4. THRUST BLOCKS SHALL BE PLACED TO WITHIN 50mm OF THE FACE OF THE BELL.
5. THE THRUST BLOCK SHALL BE PLACED AGAINST UNDISTURBED SOIL AT THE BOTTOM AND SIDE OF THE BELL. WHERE IT IS NOT POSSIBLE THE THRUST BLOCK SHALL BE PLACED TO WITHIN 50mm OF THE FACE OF THE BELL.
6. EXCEPT FOR THE ADDITION OF WATER, CONCRETE FOR THRUST BLOCKS SHALL COME FROM THE SAME BATCH AND BE PLACED AT THE SAME TIME AND PLACE AS THE BELL.
7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING THE BEARING CAPACITY OF THE SOILS AND AGGREGATE ETC. BY THE CONTRACTOR FOR THE PURPOSE OF DESIGNING CONCRETE THRUST BLOCKS/ANCHORS SHALL NOT BE ACCEPTED.