



REPORT
10113-5.2.2

NORTH AMERICAN
5705 HAZELDEAN ROAD COMMERCIAL SITE
PHASE 1 & 2
SITE SERVICING BRIEF
SPA D07-12-19-0168



Prepared for North American Development Group
by IBI Group

Updated May 15, 2020

Table of Contents

1	INTRODUCTION	1
2	WATER SUPPLY	2
2.1	Existing Conditions	2
2.2	Design Criteria	2
2.2.1	Water Demands	2
2.2.2	System Pressure.....	2
2.2.3	Fire Flow Rates.....	3
2.2.4	Boundary Conditions.....	3
2.2.5	Hydraulic Model	3
2.3	Proposed Water Plan.....	3
2.3.1	Modeling Results.....	3
2.3.2	Watermain Layout.....	4
3	STORMWATER.....	5
3.1	Stormwater Management	5
3.2	Storm Sewers	5
4	WASTEWATER OUTLET	9
5	SEDIMENT & EROSION CONTROL PLAN	12
6	GEOTECHNICAL	14
7	RECOMMENDATION.....	15

List of Figures

- 1 Key Plan
- 2 Google Map

Table of Contents (continued)

List of Appendices

- Appendix A:**
- A100 Master Site Plan
 - C-104 Phase 1 & 2 General Plan
 - C-105 Details Plan Phase 1 & 2
 - Watermain Boundary Condition
 - Watermain Demand Calculation Sheet
 - FUS Fire Flow Calculation
 - Watermain Model Schematic and Results
 - Builder Sprinkler Declaration from Architect
- Appendix B:**
- C-500B Storm Tributary Area Plan Phase 1 & 2
 - C-802 Phase 1 & 2 ICD Plan
 - C-402 Ponding Plan Phase 1 & 2
 - Modified Rational Method design sheets Phase 1 & 2
 - RD-100 & Accutrol Weir Roof Drain
 - Storm sewer design sheets Phase 1 & 2
 - ICD design sheets Phase 1 & 2
 - ADS Stormtech Storage Chambers
 - Mechanical and Structural Declaration for Roof Drains
- Appendix C:**
- C-501B Sanitary Tributary Area Plan Phase 1 & 2
 - Sanitary sewer design sheet Phase 1 & 2
- Appendix D:**
- C-920 Sediment & Erosion Plan Phase 1 & 2
 - Paterson Group Report
 - C-202 Phase 1 & 2 Grading Plan
 - Geotechnical Engineer Memo – Phase 1 & 2 Grading Review
 - Figure 5.4 KWDA MSP
 - MVCA email

1 INTRODUCTION

This servicing brief outlines the proposed municipal site servicing for Phase 1 & 2 of an 8.46 Ha commercial site located on the north side of Hazeldean Road and east of Huntmar Drive as shown on Figure 1.

The subject lands are located within the Kanata West Development Area (KWDA) and therefore are subject to the requirements of the KWDA Master Servicing Reports. Since the first site plan approval in 2010, this brief has been a living document updated to support the various steps of detail design by demonstrating the proposed development can be serviced by the existing municipal infrastructure in accordance with the current City standards and the KWDA Master servicing requirements for water supply, stormwater and wastewater.

The development is a community shopping centre with a mixture of attached and free standing buildings. The total commercial gross floor area for Phases 1 and 2 when fully completed will be approximately 20,007 sm (216,095 sq. ft.), see Master Site Plan A100 in **Appendix A**.

The previous Site Plan Approval D07-12-14-0032 amended the original site plan by adding two buildings, BLDG 1 and BLDG 2 of 1040m² and 385m² respectively. PAD E was refined to a smaller foot print (from 262 m² to 251 m²).

To address market demands and tenant requirements, the owner is submitting for Site Plan Approval amendment for CRU B-2a (1434 m²) which will replace two previously planned Box stores, Box B and Box C (1990 m² each). In addition, the Owner is applying for approval of PAD B, which has been slightly adjusted from 627 m² to 675 m², and Box D remains unchanged at 2323 m². These adjustments are the subject of this report update. The Master Site Plan A100 in **Appendix A** highlights the location of these buildings. Technical changes, or areas of specific concern to the amendment has been shown in ***bold italics***.

2 WATER SUPPLY

2.1 Existing Conditions

The KWDA Master Servicing Report outlined the proposed trunk watermain within the neighbourhood, see drawing WM-1 of that report. As part of the construction of Huntmar Drive, the proposed 400Ømm watermain was installed and is currently operational.

Phase 1 & 2 of the North American commercial development connects to the Huntmar Road watermain at two locations, with 305 Ømm watermain. These connections create a looped 305 Ømm watermain within Phase 1 & 2. The looping will provide the desired fire protection and offer redundancy within the network. See Drawing C-104 in **Appendix A** for watermain locations. The remainder of the watermain within Phase 1 & 2 of the development are 200 mm in diameter. Water services to the various buildings range from 152 mm to 50 mm in diameter, depending on projected requirement for domestic supply and/or sprinklers. The water services for Pad B and Box D were previously installed and no adjustment is required as part of this SPA amendment. The conversion of Box B/C to CRU B-2a will require a connection to and an extension of the existing water service.

Drawing C-104 illustrates the watermain works for Phase 1 & Phase 2 and Drawing C-105 contains notes and watermain schedules for Phases 1 and 2.

2.2 Design Criteria

2.2.1 Water Demands

Water demands for the commercial buildings in the North American development are based on Table 4.2 of the Ottawa Design Guidelines – Water Distribution. The rate for shopping centers of 2,500 liters per 1000 square meters floor space per day is used. A watermain demand calculation sheet is included in **Appendix A** and the total water demands are summarized as follows:

- Average Day 0.73 L/s
- Maximum Day 1.08 L/s
- Peak Hour 1.95 L/s

2.2.2 System Pressure

The 2010 City of Ottawa Water Distribution Guidelines state that the preferred practice for design of a new distribution system is to have normal operating pressures range between 345 kPa (50 psi) and 552 kPa (80 psi) under maximum daily flow conditions. Other pressure criteria identified in the guidelines are as follows:

Minimum Pressure	Minimum system pressure under peak hour demand conditions shall not be less than 276 kPa (40 psi)
Fire Flow	During the period of maximum day demand, the system pressure shall not be less than 140 kPa (20 psi) during a fire flow event.

Maximum Pressure Maximum pressure at any point in the distribution system shall not exceed 689 kPa (100 psi). In accordance with the Ontario Building/Plumbing Code, the maximum pressure should not exceed 552 kPa (80 psi). Pressure reduction controls may be required for buildings where it is not possible/feasible to maintain the system pressure below 552 kPa.

2.2.3 Fire Flow Rates

Fire flow demands have been calculated using the Fire Underwriters Survey (FUS) method. For the large building, Box A, a fire flow demand of 15,000 L/min (250 L/s) has been calculated while a demand of 11,700 L/min (195 L/s) has been calculated for Block D and E. It is proposed to use a demand of 250 L/s for all buildings in the development except for Box D and E which will use the 195 L/s flow.

2.2.4 Boundary Conditions

The City of Ottawa has provided hydraulic boundary conditions at Huntmar Road. A copy of the boundary condition is included in **Appendix A** and summarized as follows:

	HUNTMAR ROAD
Max HGL (Basic Day)	161.6 m
Peak Hour	156.5 m
Max Day + Fire (250 L/s Fire Flow)	155.0 m

2.2.5 Hydraulic Model

A computer model for the North American development has been developed using the H2O MAP version 6.0 program produced by MWH Soft Inc. The boundary condition, water demands and fire flow demands are all incorporated in the model.

2.3 Proposed Water Plan

2.3.1 Modeling Results

The hydraulic model was run under basic day, maximum day with fire flows and under peak hour conditions. Water pipes are sized to provide sufficient pressure and to deliver the required fire flows.

Results of the hydraulic model are included in **Appendix A** and summarized as follows:

<u>Scenario</u>	<u>Results</u>
Basic Day (Max HGL) Pressure Range	567.9 to 588.0 kPa
Peak Hour Pressure Range	517.9 to 537.9 kPa
Max Day + 250 L/s Fire Flow Minimum Flow	182.0 L/s

A comparison of the results and design criteria is summarized as follows:

Maximum Pressure	All nodes have pressures exceeding 552 kPa (80 psi) which require pressure reducing control at the building units. The highest pressure is below the maximum allowable value of 689 kPa (100 psi).
Minimum Pressure	All nodes in the model exceed the minimum value of 276 kPa (40 psi).
Fire Flow	Under the fire flow analysis node 40 adjacent to Box D and E has a design fire flow of 182.0 L/s which is marginally under the calculated demand of 195 L/s. Node 40 is a fire hydrant built on a long hydrant lead. Box D and E are also protected by a hydrant at node 34 which has a design fire flow of 338.9 L/s. All other nodes have design flows in excess of the 250 L/s requirement.
Water Age	A water age analysis has been completed under basic day conditions and using the boundary condition at Huntmar road as the origin. The age analysis was run for an eight day period (192 hours) and results are shown in Appendix A, please note that nodes 40 and 70 are fire hydrant nodes and have no water demand. For Pad E and Bldg 2 at node 48 the water age is 66.8 hours or 2.8 days. The actual water age will be the water age at the boundary condition plus the 2.8 days calculated. As the main on Huntmar Drive is a large feeder main it is expected the actual water age will be less than 3 days giving a water age at node 40 less than 6 days which meets the City criteria allowing a maximum water age of 8 days. The longest water age in the model is 72.8 hours (3.0 days) at node 34.

2.3.2 Watermain Layout

The watermain layout for the North American development is shown on Drawing C-104.

3 STORMWATER

3.1 Stormwater Management

The total North American site area is 10.02 Ha, with 8.46 Ha east of Huntmar Drive (Phases 1 and 2) and 1.56 Ha west of Huntmar Drive (future Phase). In accordance with the KWDA MSP the west portion of the site was proposed to outlet to the existing Huntmar Drive storm sewer, which outlets to the existing Levanto Circle trunk storm sewer which discharges to Pond 5 as per KWDA Master Servicing Report. The KWDA MSP also identified the east portion of the North American site outletting to Huntmar Drive and discharging to Pond 5 as noted above. However, during detail design of Phase 1, it has noted excessive grade raise would be required to service the site by gravity to the Huntmar Drive storm sewer. The approved solution was to route the storm sewer for the east portion of the site to Levanto Circle trunk storm sewer through a servicing block, which discharges to Pond 5 as per the KWDA Master Servicing Plan. This route has been coordinated with the adjacent developer, see approved plan and profile drawing 15 from DSEL for Mattamy's Phase 5A for details on the storm sewer within the servicing block, and DSEL Design Brief for Fairwinds Phase 5A (4th submission dated November 13, 2009). These sewers have been constructed and are operational. All drainage directed to these sewers is restricted to a maximum release rate of 85 L/s/ha, which is in accordance with the Master Servicing Report for the KWDA.

3.2 Storm Sewers

The proposed stormwater system is a minor-major storm drainage system, where the minor system is comprised of storm sewers sized to accommodate the City of Ottawa 1:5 year design event. The major system is overland flow routing.

As per the KWDA Master Servicing Plan, the development must limit flow to the storm trunk sewer to 85 L/s/ha during a 1:5 year rainfall event to provide flood protection for downstream property. In order to control flow into the downstream sewers to meet this criteria, Inlet Control Devices (ICD) and roof drain restrictors are proposed. These flow control devices will restrict flow into the minor system and to the downstream storm sewers, to a maximum of 85 L/s/ha, or 709.41 L/s for the 8.346 Ha tributary to the Levanto Circle trunk storm sewer for Phase 1 & 2.

The KWDA MSP identified the major storm route for these lands to discharge to Huntmar Drive. As noted earlier, the MSP did not appreciate the volume of fill required to meet this requirement for Phase 1 & 2. Phase 1 & 2 will be designed to accommodate the 100 year event with zero over flow off site, however, should a major event in excess of the 1:100 year event occur, runoff which exceeds the available spare storage would be routed along the parking lot and internal roads to Hazeldean Creek. Figure C-500B in **Appendix B** also illustrates the proposed major storm routing for the site system.

The site plan amendment for proposed CRU B-2a or the subtle adjustment of PAD B does not alter the previously approved major storm routing.

Phase 1 & 2 Minor System

As per the KWDA Master Servicing Plan, the development must limit flow to the storm trunk sewer to 85 L/s/ha during a 1:5 year rainfall event to provide flood protection for downstream in property. In order to control flow into the downstream sewers to meet this criteria, Inlet Control Devices (ICD) are proposed. Drawing C-500B identifies the storm tributary areas and Drawing C-802 illustrates the ICD's for the various inlets and roof drains for Phase 1 & 2. These ICD's restrict flow

into the minor system resulting in ponding as illustrated on Drawing C-402. The modified rational method was used to determine the volume of storage required to capture the 100 year event while limiting the accumulated flow to the downstream storm sewers to a maximum of 85L/s/Ha. For the 8.346 Ha area tributary to the storm sewer, the total allowable flow is 709.41 L/s.

Roof drainage will be restricted to the specified rate for each roof. Detail design of the roof system and flow restrictions is to be completed by the mechanical engineer as part of the building permit works. Roof drain restrictors such as the Watts RD-100 with adjustable Accutrol Weir will be employed to control the runoff from each roof. A copy of RD-100 and weir is included in **Appendix B**.

Approximately 0.05 Ha of grassed side yard (between box A and boulevard, and Pad A and boulevard) will shed uncontrolled runoff to the existing Huntmar Road storm sewer. As this storm sewer is tributary to the sites outlet trunk sewer, the net allowable from the site shall be reduced by 85 L/s/Ha x 0.05 Ha, or 4.25 L/s. To this end the maximum allowable flow from the Phase 1 & 2 onsite sewers is 709.41 L/s – 4.25 L/s = 705.16 L/s.

Based on the proposed ICD's, a total of 705 L/s is being allowed into the system, while a maximum of 2755.81 m³ of 100year storm storage has been provided as summarized in the table below. The modified rational method analysis is included in **Appendix B** along with the above noted drawings. It can be noted that on site surface storage (roof top, and surface), fully attenuates the 100 year event with zero overflow off site.

The storm sewer design sheets and ICD design sheet for Phase 1 & 2, are also located in **Appendix B** demonstrates the storm sewers have been sized to accommodate the 1:5 year event as per City and MOE requirements

Storm sewers were previously constructed along the frontages of CRU B-2a, Box D and Pad B and service laterals were to be extended from the service stubs to the building. CRU B-2a is a smaller building footprint than the previously intended box stores (Box B and C). The previously constructed services laterals for Box C will be abandoned, and the previously installed services for Box B will be extended to the proposed CRU B-2a. Box D and PAD B will use the previously installed services laterals.

ICD #	TRIB AREA HA	FLOW (L/s)	100 YR. STORAGE (m ³)	5 YR. STORAGE (m ³)
1	0.34	21	154.82	52.03
2	0.097	13	1.35	1.35
3	0.055	13	2.05	2.05
4	0.083	10	0	0
5	0.332	35	118.70	42.38
6	0.149	21	1.87	1.87
7A	0.054	5	0	0
7D	0.028	5	0	0
8A	0.234	18.5	92.29	31.47
8B	0.090	10	23.70	9.19
9	0.12	21	1.87	1.87
11	0.173	18	12.90	9.53
12	0.204	21	82.51	32.17

ICD #	TRIB AREA HA	FLOW (L/s)	100 YR. STORAGE (m ³)	5 YR. STORAGE (m ³)
14	0.272	21	123.67	45.45
15	1.034	43	441.23	193.64
16	0.105	29	18.53	12.96
17	0.709	82	203.43	65.52
18	0.183	21	26.00	9.78
19	0.077	29	29.63	7.96
20	0.64	48	249.78	96.12
21	0.191	10	15.97	15.97
21A	0.027	5	5.17	1.77
22	0.172	12	30.00	21.93
23	0.141	21	46.87	8.62
23B	0.143	9	53.59 +22.00 u/g	21.33 +22.00 u/g
23C	0.218	9	55.82 +22.00 u/g	21.37 +22.00 u/g
24	0.122	35	40.82	1.14
24A	0.020	3	7.44	1.81
25	0.182	27	33.11	8.61
25A	0.028	2	12.12	3.87
26	0.062	5	17.33	7.48
Box A	0.3260	16	125.90	50.55
Box D	0.232	10	93.90	38.35
Box E	0.426	20	167.22	67.56
CRU A	0.12	3.5	55.25	23.49
CRU B-1	0.083	2	40.47	17.47
CRU B-2	0.092	2	46.22	20.10
CRU B-2a	0.149	4	70.36	30.12
PAD A	0.157	4	75.31	32.37
PAD B	0.062	3	24.07	9.68
PAD C	0.062	3	24.07	9.68
PAD D	0.045	3	15.40	5.89
PAD E	0.0251	2	7.94	2.93
PAD F	0.0416	3	13.76	5.19
PAD G	0.049	3	17.37	6.74
BLDG 1	0.1040	2	54.09	23.71
BLDG 2	0.0385	2	14.56	5.80
TOTAL	8.297	705.0	2,792.46	1,124.87
	AVERAGE	84.97 L/Ha	336.56 m³/Ha	135.58 m³/Ha

With regards to the previously approved report (file D07-12-14-0102 and D07-12-14-0032), the table below lists the areas impacted by the proposed change. The table also lists new areas and provides

the respective 100 year flow and storage values. The net change in flow is -1.5 L/s which as noted above results in a total flow from the site of 705 L/s.

**100 YR STORAGE & FLOW COMPARISON –
 PREVIOUS REPORT (D07-12-14-0102 and D07-12-14-0032) vs. REVISED REPORT**

PREVIOUS				REVISED			
AREA ID	AREA (m ²)	FLOW (L/s)	STORAGE (m ³)	AREA ID	AREA (m ²)	FLOW (L/s)	STORAGE (m ³)
BOX B	1951	8	80.35	CRU B-3	1490	4	70.36
BOX C	1961	8	80.91	BOX D	2320	10	93.90
BOX D	2320	10	93.90	PAD B	620	3	24.07
PAD B	610	3	23.54				
Subtotal: Roofs	6842	29	280.7	Subtotal: Roofs	4730	17	188.33
17	681	82	203.43	17	709	82	203.43
22	1016	12	30.00	22	1720	12	30.00
23	1570	21	56.25	23	1410	21	46.87
23C	260	3	45.26	23B	1430	9	53.59 +22.00 u/g
23D	240	3	42.60	23C	2180	9	55.82 +22.00 u/g
24	2060	35	51.08	24	1220	35	40.82
Subtotal: Parking Lot	5827	156	747.82	Subtotal: Parking Lot	8669	168	447.53
TOTAL	12669	185	1028.52	TOTAL	13399	185	663.71

Previous Report (D07-12-14-0032), Total Flow 706.5 L/s (100 yr)

Revised Report, Total Flow 705 L/s (100 yr)

Area 23B and 23C each have a 22m ADS SC-740 storage system incorporated upstream of the CB in order to provide stormwater retention to limit overflow from the site. Details of the system of provided in **Appendix B**.

A rooftop storage declaration letter, signed by Mechanical and Structural Engineer has been provided in **Appendix B**.

4 WASTEWATER OUTLET

The KWDA Master Servicing Report describes the sanitary servicing strategy for the neighbourhood, see Figure S-1 in the KWDA Master Servicing Report. This study identified a 750Ømm sewer to be constructed within Huntmar Drive, this sewer was constructed as part of the Huntmar Drive works and is currently operational.

The KWDA Master Servicing Report used the standard design flow of 50,000 L/Ha/day as noted in section 4.4.1.2 of the City of Ottawa design guidelines (at that time) to establish the anticipated wastewater flow rate for the proposed development. Based on the limits of Phase 1 & 2 and average design flow of 50,000 L/Ha/day as per the City Guidelines infiltration allowance of 0.28 L/s/Ha, and peak factor of 1.5, the anticipated flow for Phase 1 & 2 of this site is as follows:

Commercial Flow = 8.46 Ha @ 50,000 L/Ha/d = 4.89 L/s

Commercial Peak Factor = 1.5

Peak Flow = 1.5 x 4.89 L/s = 7.335 L/s

Extraneous Flow = 8.45 Ha x 0.28 L/s/Ha = 2.366 L/s

Total Flow = 7.335 L/s + 2.366 L/s = 9.701 L/s

Thus the total peak sanitary flow from Phase 1 & 2 of the North American site used in the design of the downstream sewers was 9.701 L/s.

The sanitary tributary area Drawing C-501B and sanitary sewer design sheet for Phase 1 & 2 are included in **Appendix C**. The sanitary sewer system has been designed in accordance with current City and MOE guidelines. Due to the grade constraints and the existing elevation of the sanitary trunk sewer, the private onsite sewers have an actual velocity of less than the recommended 0.6 m/s self clean velocity. The owner recognizes this and accepts the additional maintenance associated with the proposed sewers.

Based on the proposed usages and City guideline Appendix 4-A Daily Flow for Various Establishments, the following estimates the total sanitary peak flow for phase 1 & 2:

SHOPPING CENTRE RETAIL

BUILDING	FLOOR AREA (SM)
Box A	3287.2
Box E	4180.5
CRU A	1203.2
CRU B1/B2	1699.7
PAD A	1567.2
PAD G	478.4
PAD F	416.3
CRU B-2a	1434.3
BOX D	2322.5
BLDG 1	1040.5
PAD B	675.3
PAD C	627
PAD D	464.5
TOTAL	19,366.6

The above are shopping center retail stores which City of Ottawa sewer guideline Appendix 4-A notes as 5 L/d per sm.

$$19,366.5 \times 5 \text{ L/d per sm} = 96,832.5 \text{ L/d} \times 1.5 \text{ Peak Factor} = \mathbf{1.68 \text{ L/s}}$$

DRIVE-THRU RESTAURANT

BUILDINGS	SEATS
BLD 2	144
Subtotal Seats	144
PAD E	44
Subtotal Seats	44
Total Seats	188

The above are drive-thru restaurants which Appendix 4-A notes as 125 L/d per seat

$$188 \times 125 \text{ L/d per seat} = 23,500 \text{ L/d} \times 1.5 \text{ Peak Factor} = \mathbf{0.41 \text{ L/s}}$$

Phase 1 & 2 area is 8.46 Ha, extraneous flow rate of 0.33 L/s/Ha

$$8.46 \text{ Ha} \times 0.33 \text{ L/s/Ha} = \mathbf{2.79 \text{ L/s}}$$

$$\text{Total Peak Flow} = \text{retail flow} + \text{drive thru flow} + \text{extraneous flow} = 1.68 + 0.41 + 2.79 = \mathbf{4.88 \text{ L/s}}$$

The total peak sanitary flow when calculated using a usage basis is 4.88 L/s. This is less than the total when using the original design criteria when sizing the downstream sewers which was previously noted as 9.70 L/s.

The above demonstrated that the modification to CRU B-2a and the Pad B does not negatively impact the downstream capacity previously approved for this site. (Box D remains unchanged from original SPA).

Sanitary mains exist along the internal roads abutting CRU B-2a, Box D and PAD B, as illustrated in drawing C-104. Previously constructed service lateral for Box B will be extended to service CRU B-3. Service lateral for Box C will be abandoned. Service laterals previously constructed for PAD B and BOX D are adequate without modification.

5 SEDIMENT & EROSION CONTROL PLAN

The majority of the site has been developed, the sediment and erosion control measures noted within this section deal with the construction of services and parking lot for proposed CRU B-3, PAD B and BOX D.

During construction, existing stream and conveyance system can be exposed to significant sediment loadings. Although construction techniques to reduce unnecessary construction sediment loadings. These will include:

- groundwater in trench will be pumped into a filter mechanism prior to release to the environment;
- seepage barriers will be constructed in any temporary drainage ditches;
- filter cloths will remain on open surface structure such as manholes and catchbasins until structures are commissioned and put into use
- workzone perimeter siltation protection involving a sandbag dyke wrapped in filter cloth, placed at the base of the construction hoarding fence

During construction of municipal services, any trench dewatering using pumps will be discharged into a filter trap made up of geotextile filters and straw bales similar in design to the OPSD 219.240 Dewatering Trap. These will be constructed in a bowl shape with fabric forming the bottom and the straw bales forming the sides. Any pumped groundwater will be filtered prior to release to the existing surface runoff. The contractor will inspect and maintain the filters as needed including sediment removal and disposal and material replacement as needed.

In order to reduce sediment loading to the adjacent lands via overland flow, custom seepage barriers will be installed along the construction limits. All seepage barriers will be inspected and maintained as needed.

All catchbasins, and to a lesser degree manholes, convey surface water to sewers. However, until the surrounding surface has been completed these structures will be covered to prevent sediment from entering the minor storm sewer system. Until the parking lots are asphalted and curbed, all catchbasins and manholes will be constructed with a geotextile filter fabric located between the structure frame and cover. These will stay in place and be maintained during construction of services and the buildings until it is appropriate to remove same.

During construction of any development both imported and native soils are stockpiled. Mitigative measures such as silt fencing and silt bag and proper management (stockpiling within areas with sediment control measures) to prevent these materials entering the sewer system is needed.

During construction of the deeper municipal services, water, sewers and service connections, imported granular bedding materials are temporarily stockpiled on site. These materials are however quickly used up and the works proposed are within the seepage barriers.

Contamination of the environment as a result of stock piling of imported construction materials is generally not a concern. These materials are quickly used and in mitigative measures stated previously, such as and filter fabric in catchbasins and manholes help to manage these concerns.

Parking lot granular materials are not typically stockpiled on site. They are immediately placed in the parking lot and have little opportunity of contamination. Lot grading sometimes generates stockpiles of native materials. However, this is only a temporary event since the materials are quickly moved off site.

IBI GROUP – REPORT
NORTH AMERICAN
5705 HAZELDEAN ROAD COMMERCIAL SITE
PHASE 1&2
SITE SERVICING BRIEF
SPA D07-12-19-0168
Prepared for: North American Development Group

The sediment and erosion control plan for Phase 1 & 2 pertaining to CRU B-2a, Box D and Pad B is provided as Drawing C-920 in **Appendix D**.

6 GEOTECHNICAL

Jacques Whitford Ltd. prepared two geotechnical reports (ONO11763) dated November 1, 2004, and ONO11739 dated June 23, 2004 for the subject lands. Paterson Group prepared an updated report dated May 25, 2016 to reflect the proposed revised site plan. A copy of the Paterson report has been provided in **Appendix D**. The report provides recommendations for various site servicing and building construction issues. The recommendations impacting site servicing include, but are not limited to the following, see report for details:

- Permissible grade raise: 1.2m.
- Pavement Structure: The following is the recommended pavement structure.

PAVEMENT STRUCTURE	THICKNESS (mm)	
	CAR PARK AREA	ACCESS LANE & HEAVY TRUCK PARKING (FIRE ROUTE)
Superpave 12.5	50	40
Superpave 19.0		50
Granular "A"	150	150
Granular "B" Type II	300	400

The proposed grading Plan for Phase 1 & 2 C-202 is included in **Appendix D**. The grading plan was prepared with a view to limit grade raise to 1.2m or less.

Infiltration targets for the proposed site were outlined in the KWDA MSP. As indicated in Figure 5.4 of the MSS, attached in **Appendix D**, the soil type within the proposed development area is characterized as clay with low recharge potential. The infiltration target for the area, as identified within the MSP is 50-70mm/year. Phase 1 & 2 consists of approximately 84600m² of development, the site is primarily comprised of impervious parking lot and roof surfaces. Pervious areas are provided where possible throughout the site.

In consultation with the MVCA, an infiltration strategy for the site was developed; see approval email from Doug Nuttall in **Appendix D**. The strategy included three sources: natural infiltration from rainfall (20mm/yr), infiltration from irrigation system (20 mm/yr), and infiltration from a dry well supplied by roof runoff. CRU B1/2&2a roofs which total 3134m² will provide 9.2 mm/yr for a total of 49.2 mm/yr, which is slightly less than the guideline of 50 to 70 mm/yr.

The location of "dry well" areas which will capture rainfall runoff and retain the water to allow infiltration into the clay subgrade is illustrated on the Grading Plan C-202.


7 RECOMMENDATION

This brief has demonstrated the proposed site plan can be serviced by the existing municipal services, and all existing municipal services have sufficient capacity to accommodate the proposed development. The construction of parking lots, sanitary, storm, and water services to service the proposed CRU B-3, Pad B, Box D can be completed in conformance with the City of Ottawa and MOE standards.

Adherence to the sediment and erosion control plan during construction will minimize harmful impacts on downstream systems.

Prepared by:

IBI GROUP




Demetrius Yannouloupoulos, P. Eng.
Director, Office Lead

Ryan Magladry, C.E.T.
Project Manager

APPENDIX A

- A100 Master Site Plan
- C-104 Phase 1 & 2 General Plan
- C-105 Details Plan Phase 1 & 2
- Watermain Boundary Condition
- Watermain Demand Calculation Sheet
- FUS Fire Flow Calculation
- Water model Schematic and Results
- Architect Letter Regarding new Buildings to be Sprinklered with Basic System

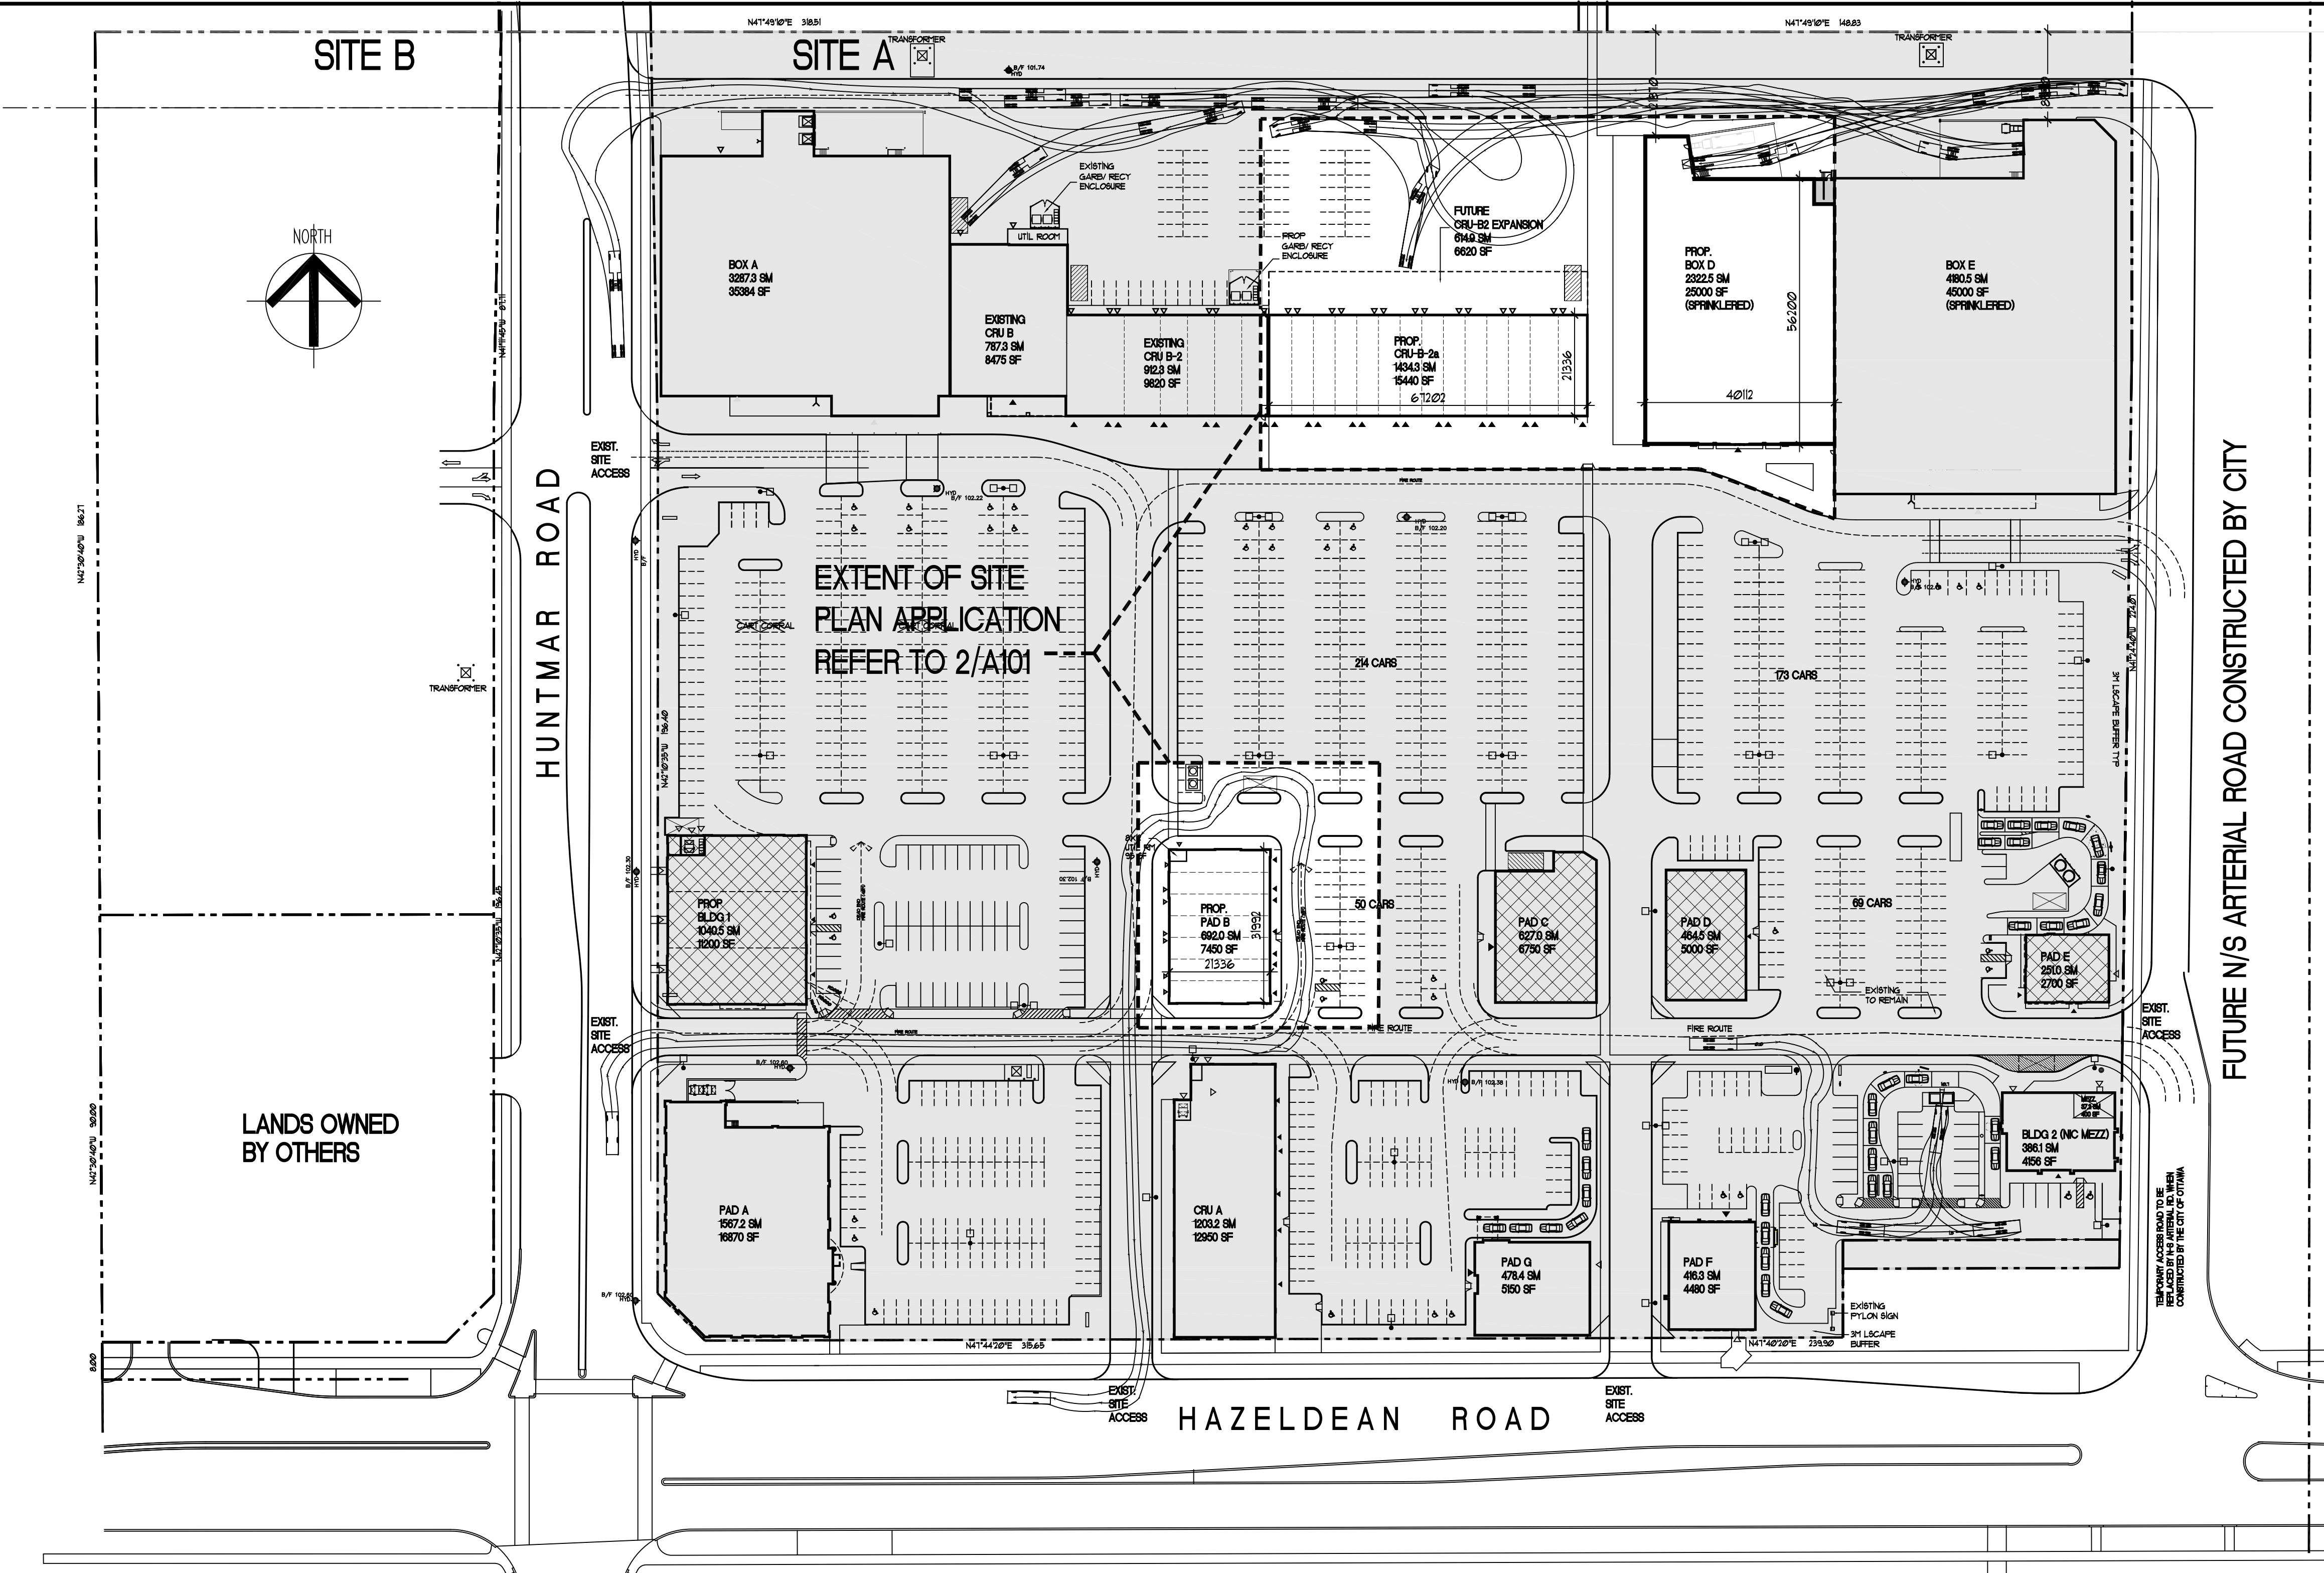

SITE A
 SITE AREA 84596.5 SM 20.9 ACRES
 (EXCL. ROAD AND LScape DEDICATION)
 COVERAGE 23.7%
 (20033 SM)

LOT FRONTAGE 298.605 M
 BUILDING FRONTAGE 111930 M
 % OF BUILDING FRONTAGE 40%

EXISTING

BOX A	3287.3 SM	35384 SF
BOX E	4180.5 SM	45000 SF
PAD A	1567.2 SM	16870 SF
CRU A	1203.2 SM	12950 SF
PAD G	478.4 SM	5150 SF
PAD F	416.3 SM	4480 SF
CRU B/B-2	1699.7 SM	18295 SF
BLDG 2	386.1 SM	4156 SF
-MEZZ	419 SM	450 SF
SUB-TOTAL	13260.6 SM	142735 SF

SPA APPROVED (MASTER PLAN)

PAD B	AREA BELOW	
PAD C	627.0 SM	6750 SF
PAD D	464.5 SM	5000 SF
PAD E	251.0 SM	2700 SF
BOX D	AREA BELOW	
BLDG 1	1040.5 SM	11200 SF
SUB-TOTAL	2383.0 SM	25650 SF

PROPOSED

BOX D	2322.5 SM	25000 SF
PAD B	692.0 SM	7450 SF
CRU B-2a	1434.3 SM	15440 SF
SUB-TOTAL	4448.8 SM	47890 SF
TOTAL	20092.4 SM	216275 SF

PARKING

REQ'D	3.4/100 SM	683 CARS
PROVIDED	5.35/100 SM	1076 CARS
		5,1000 SF

BIKE PARKING

REQ'D	31 SPACES
PROVIDED	31 SPACES

SNOW TO BE REMOVED AND STORED OF SITE.

SURVEY INFO TAKEN FROM:
 TOPOGRAPHIC SURVEY OF
 PART OF LOTS 21 & 28
 CONCESSION 12
 NOW CITY OF OTTAWA

PREPARED BY:
 FIREBALL, NONFAT &
 WOODLAND LIMITED
 ONTARIO LAND SURVEYORS

NO.	BY	DATE	ISSUED
1	AB	03NOV08	FOR SPA
2	AB	12JUN09	FOR SPA
3	AB	14DEC09	FOR SPA
4	AB	25MAR10	FOR SPA
5	CIA	01APR10	FOR SPA
6	AB	28JUL10	FOR SPA
7	AB	09AUG11	REVISED CRU A
8	AB	7DEC11	FOR SPA
9	AB	24FEB12	FOR SPA
10	AB	14NOV12	FOR SPA
11	AB	8JAN13	FOR SPA
12	AB	13MAY13	FOR SPA
13	AB	15MAY14	FOR SPA
14	AB	9.SEP.14	FOR SPA
15	AB	27.OCT.14	EXPANSION
16	AB	3.MAR.16	BLDG 1 AND 2
17	AB	7.JUL.17	SPA
18	AB	8.SEP.17	SPA
19	AB	3.NOV.17	SPA
20	AB	9.SEP.19	SPA
21	AB	XXX.19	SPA


VERIFY ALL DIMENSIONS AND CONDITIONS AT THE JOB
 DO NOT SCALE PRINTS
 PLANS AND SPECIFICATIONS ARE THE PROPERTY OF THE ARCHITECT AND MUST BE RETURNED AT COMPLETION OF THE WORK OR UPON REQUEST

THIS DRAWING MUST NOT BE USED FOR CONSTRUCTION UNLESS APPROVED AT RIGHT

APPROVED: _____
 DATE: _____

AM7 (1446)		I	II	PROVIDED
		ZONING MECHANISMS	PROVISIONS	
(a)	Minimum lot area		600 sm	84596.5 sm
(b)	Minimum lot width		18 m	+/- 273 m
(c)	Minimum front yard and corner side yard setback	(i) non residential or mixed use buildings	No Minimum	0 m
		(ii) residential use building	3 m	n/a
(d)	Minimum interior side yard setback	(i) abutting a residential zone	7.5 m	n/a
		(ii) other cases	No Minimum	n/a
(e)	Minimum rear yard setback		10 m	18.53 m
(f)	Maximum building height	within 20 m of a residential zone	11 m	10.5 m (box e)
		(ii) other cases	15 m	10.5 m (box e)
(g)	N/A			
(h)	Maximum FSI	AM7	none	
(i)	Minimum req'd with of a landscape buffer of a parking lot	a)abutting a street	3 m	3 m
		b)not abutting a street	3 m	10 m adj to residential zone
Coverage		Max permitted 50 %		23.7 %
Street frontage	If lot is 90 m in width or wider	30 %		40 %
Parking	MIN 3.4/100 SM GLA	683 SPACES		1076 SPACES
Loading (3.5m x 7.0m)		MIN 2		10
Bicycle parking	1/250sm gfa Retail	CRU-B2		10 spaces
		Box D		16 spaces
		Pad B		5 spaces
		Total		31 spaces

1 SITE PLAN
 SCALE 1:800

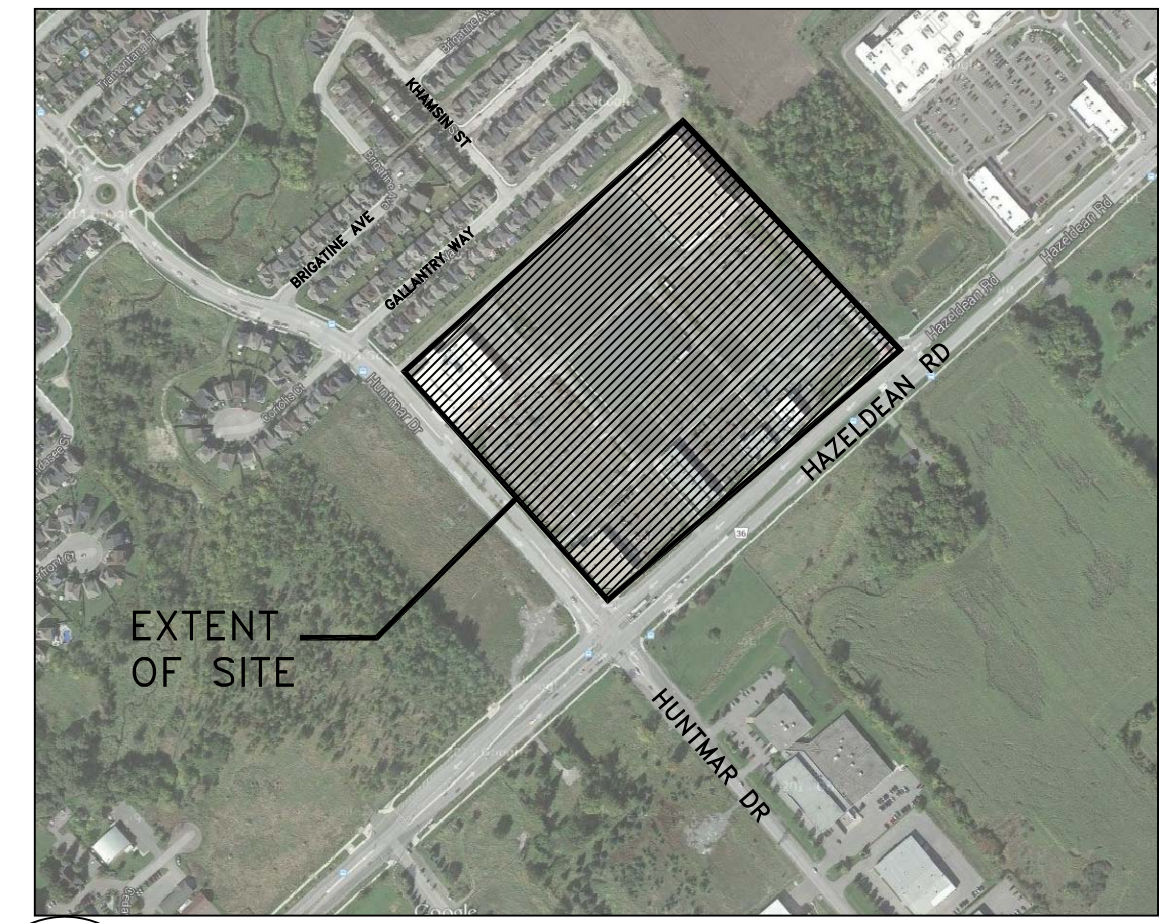

2 INSET MAP
 SCALE N.T.S.

LEGEND

- CONCRETE
- SPA APPROVED
- SPA APPROVED NOT CONSTRUCTED
- PROPERTY LINE
- EXIST. CONC. CURB
- PROP. CONC. CURB
- EXIST. PARKING
- PROP. PARKING
- FIRE ROUTE
- MAIN ENTRANCES TO BUILDING (EXACT LOCATION SUBJECT TO TENANT LAYOUT)
- SIDE/ REAR DOOR LOCATION
- CONC. BOLLARD (REF TO DETAIL)
- FIRE HYDRANT
- LIGHT STANDARD AS PER ELEC. DWGS
- BIKE PARKING AS PER LANDSCAPE DWGS

SCOLER LEE BORENSTEIN + ASSOCIATES ARCHITECTS INC.
 SITE 900, 60 ST. CLAIR AVE. E TEL: (416) 362-7763
 TORONTO, ONTARIO M4T 1N6 FAX: (416) 362-8519

PROJECT
 COMMUNITY RETAIL DEVELOPMENT
 5705 HAZELDEAN ROAD
 WEST KANATA, ONTARIO





DRAWING TITLE
 MASTER PLAN

DRAWN	JL	FOLO
CHECKED	AB	03007
DATE	JAN 16	DWG. NO.
SCALE	AS NOTED	A100

X-REFS:
 R-14

DRAWINGS REVISED: _____ LAST UPDATED: _____

- REMOVALS**
- 1 SAW CUT AND REMOVE EXISTING BARRIER CURB. REINSTATE WITH DEPRESSED BARRIER CURB AS PER CITY STANDARD SCL1.
 - 2 SAW CUT EXISTING ASPHALT AND REINSTATE ROADWAY TO MATCH EXISTING STRUCTURE AS PER CITY STANDARD R10.
 - 3 SAW CUT EXISTING BARRIER CURB AND REINSTATE BARRIER CURB AND MEDIAN TO MATCH EXISTING.
 - 4 REMOVE EXISTING CURB INLET AND CB AND INSTALL CATCH BASIN AS PER CITY STANDARD S2.
 - 5 SAWCUT EXISTING BARRIER CURB. REMOVED EXISTING MEDIAN. EXCAVATE AND INSTALL GRANULAR ROAD BASE TO MATCH EXISTING. INSTALL NEW BARRIER CURB FOR MEDIAN. REINSTATE ASPHALT TO MATCH EXISTING. COMPLETE WITH STEP JOINT.
 - 6 REMOVED EXISTING CURB INLET CB FRAME AND COVER AND REPLACE WITH STANDARD CB FRAME AND COVER.
 - 7 REMOVED EXISTING HYDRANT, BLANK LEAD AT MAIN AS PER CITY STANDARDS.
 - 8 ADJUST MH TO NEW FINISH GRADE.

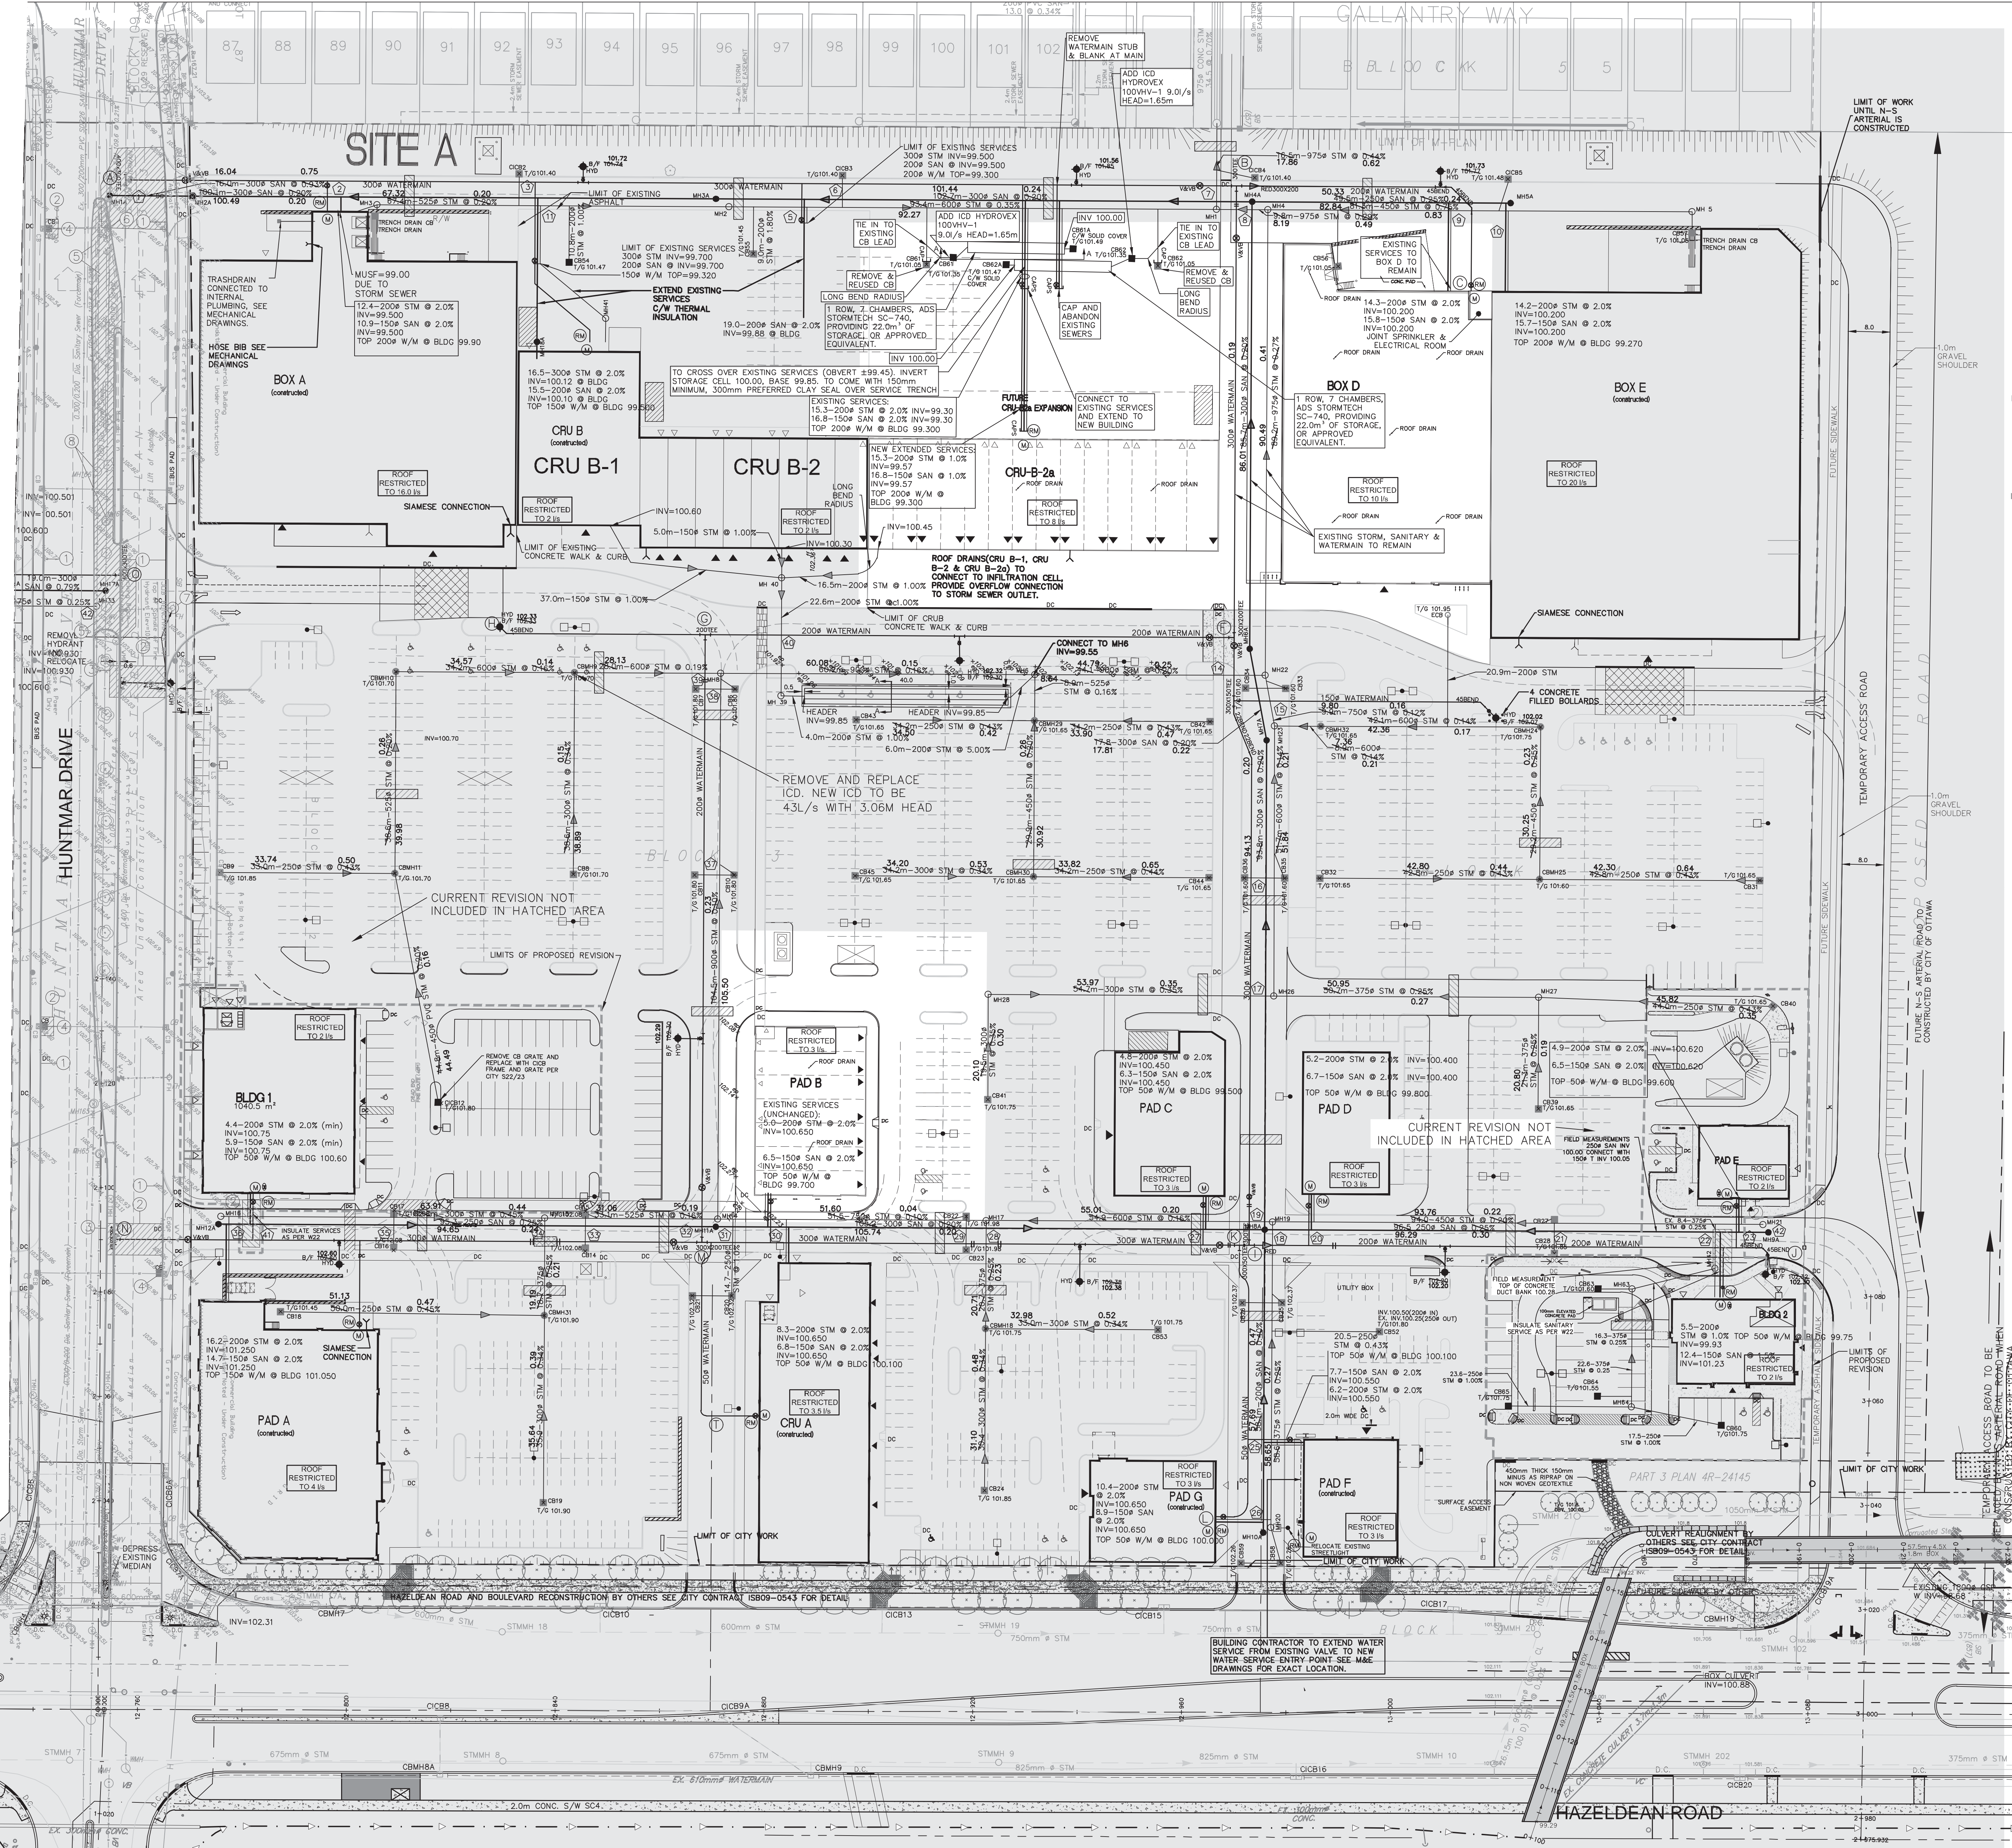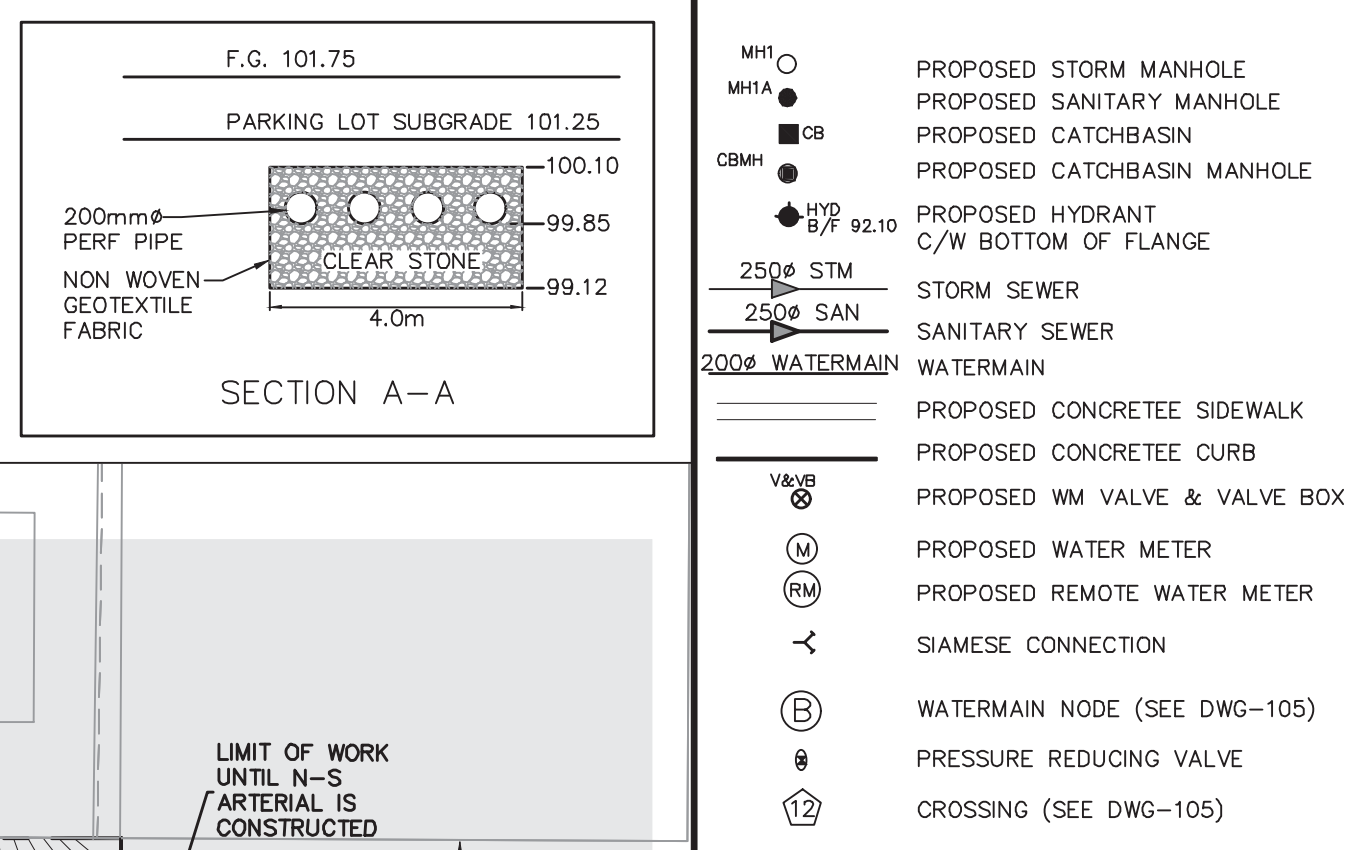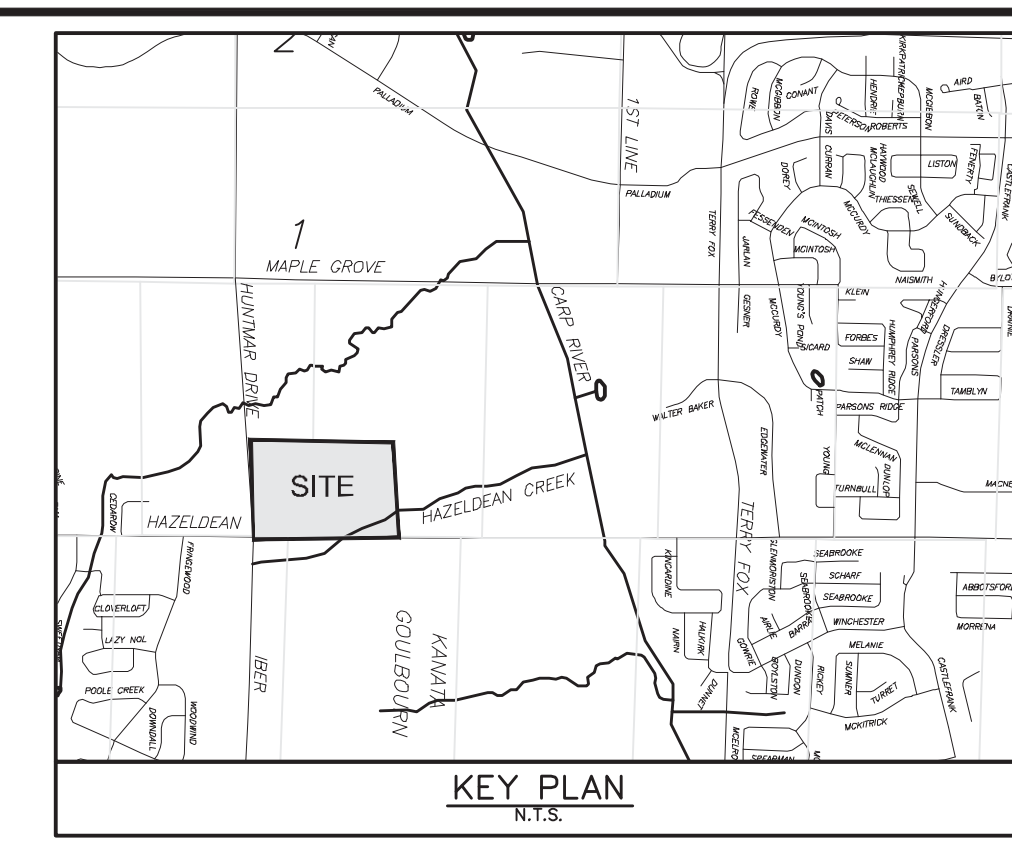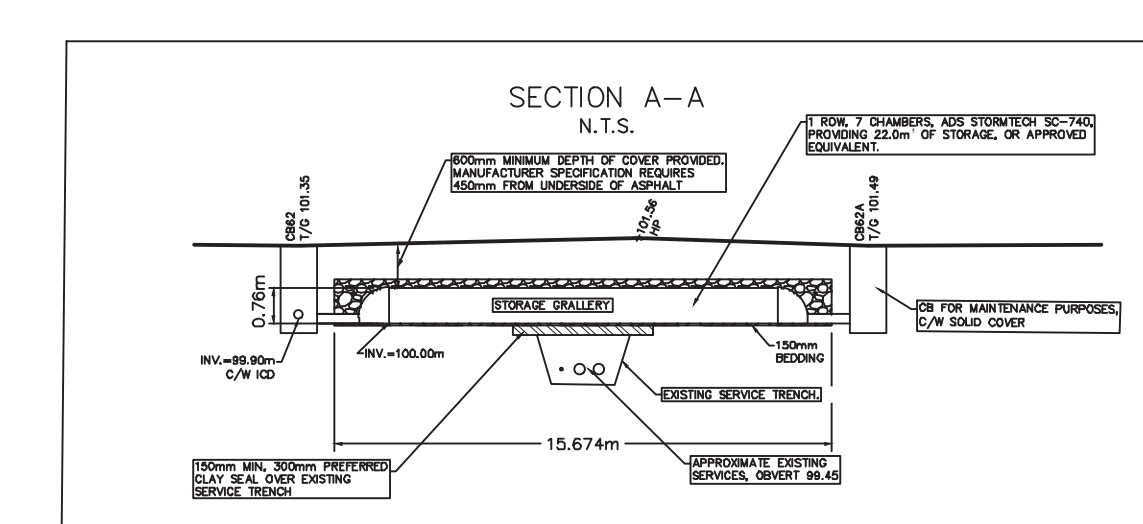

NOTE:


SEE DRAWING C-105 FOR NOTES AND DETAILS ON MH SCHEDULES, WATERMAIN SCHEDULE AND CB SCHEDULE.

No.	REVISIONS	By	Date
35	REVISED STORAGE CELLS PER	DOY	20.05.15
34	REVISED AS PER CITY	DOY	20.04.30
33	REVISED AS PER CITY	DOY	20.03.27
32	REVISED AS PER CITY	DOY	19.12.20
31	REVISED SPA CRU B-3, PAD	DOY	19.08.29
30	SANITARY OUTLET OVER	DOY	18.07.09
29	FIELD ADJUST MH2 AND	DOY	18.06.08
28	SANITARY CONSTRUCTION	DOY	18.04.08
27	ISSUED FOR TENDER	DOY	18.01.15
26	REVISED AS PER CITY COMMENTS	DOY	17.11.23
25	ISSUED FOR SPA	DOY	17.11.02
24	REVISED AS PER SITE PLAN	DOY	17.09.08
23	REVISED AS PER SITE PLAN	DOY	17.07.07
22	REVISED AS PER CITY COMMENTS	DOY	17.06.23
21	REVISED BLD 2 & PAD E	DOY	17.02.14
20	REVISED AS PER CITY COMMENTS	DOY	16.08.02
19	SPA BLDG 1 & 2	DOY	16.03.07
18	ISSUED FOR REVIEW	DOY	16.02.21
17	REVISED BLDG 1 & 2	DOY	16.01.21
16	ASBUILT	DOY	15.01.19
15	REVISED AS PER SITE PLAN	DOY	14.11.03
14	SPA	DOY	14.09.09
13	REVISED AS PER SITE PLAN	DOY	14.08.08
12	REVISED AS PER CITY	DOY	14.07.31
11	REVISED DOLLAR & CRUB	DOY	14.06.03
10	REVISED WATER SERVICE FOR	DOY	13.02.28
9	ISSUED FOR PAD F TENDER	DOY	13.02.14
8	REVISED FOR PAD F	DOY	12.11.16
7	REVISED FOR PAD F	DOY	12.08.01
6	ADD INFILTRATION CELL	DOY	12.06.23
5	REVISED SPRINKLER ROOM	DOY	12.03.09
4	REVISED PER CITY COMMENTS	DOY	12.02.23
3	REVISED FOR BOX E	DOY	11.02.26
2	REVISED SITE PLAN PH1 & PH2	DOY	11.11.24
1	ISSUED FOR APPROVAL	DOY	11.10.27

NORTH AMERICAN DEVELOPMENT GROUP

IBI GROUP
 333 Preston Street
 Tower 1, Suite 400
 Ottawa, Ontario
 Canada K1S 3M4
 Tel: (613)225-1311
 Fax: (613)225-9868

Project Title
5705 HAZELDEAN ROAD
OTTAWA, ONT.

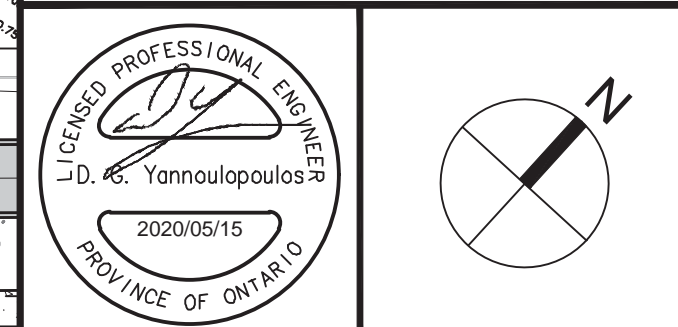

GENERAL PLAN OF SERVICES
PHASE 1 & 2

Scale: 1:500

Design	Date
D.G.Y.	OCTOBER 2011
Drawn	Checked
E.H.	D.G.Y.
Project No.	Drawing No.
10113	C-104

Lance Erion

From: Fraser, Mark <Mark.Fraser@ottawa.ca>
Sent: Monday, August 29, 2016 8:19 AM
To: Lance Erion
Cc: Demetrius Yannoulopoulos
Subject: RE: North American Hazeldean & Huntmar Commercial Site
Attachments: CCS_FUSfireflow_2016-08-15.pdf; CCSwater_demand2016-08-12.pdf; Node ID's.pdf; Boundary condition.pdf; BC at 5705 Hazeldean Road.docx

Hi Lance,

Please find attached/below water distribution network boundary conditions for hydraulic analysis as requested based on the provided anticipated water demands and fire flow requirement.

Proposed Water Demands and Fire Flow Requirement:

Proposed Development Location: 5705 Hazeldean Road

Average Daily Demand = 0.73L/s

Max Daily Demand = 1.08 L/s

Peak Hour Demand = 1.95 L/s

Fire Flow = 250 L/s

City of Ottawa Boundary Conditions:

Specified Service Connection Point: Huntmar Drive [Connection 1]

Max HGL = 161.6m

PKHR = 156.5m

MXDY+Fire = 155.0m



Please refer to City of Ottawa, *Ottawa Design Guidelines – Water Distribution*, First Edition, July 2010, WDG001 Clause 4.2.2 for watermain pressure and demand objectives.

Please note that hydraulic modelling software is anticipated. Please include an electronic version of the modelling file with the Site Servicing Report resubmission for review.

These boundary conditions are for current conditions and are based on computer model simulation.

Disclaimer: *The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.*

If you have any questions please let me know.

Regards,

Mark Fraser

Junior Infrastructure Engineer, Suburban Services



City of Ottawa | Ville d'Ottawa
Planning, Infrastructure and Economic Development Department
110 Laurier Avenue West, 4th Floor, Ottawa ON, K1P 1J1
[Tel:613.580.2424](tel:613.580.2424) ext. 27791
Fax: 613-580-2576
Mail: Code 01-14
Email: Mark.Fraser@ottawa.ca

*Please consider your environmental responsibility before printing this e-mail

This message, including any document or file attached, is intended only for the addressee and may contain privileged and /or confidential information. Any person is strictly prohibited from reading, using, disclosing or copying this message. If you received this message in error, please notify the sender and delete the message. Thank you.

From: Lance Erion [<mailto:lerion@IBIGroup.com>]
Sent: August 12, 2016 11:56 AM
To: Fraser, Mark
Cc: Demetrius Yannoulopoulos
Subject: North American Hazeldean & Huntmar Commercial Site

We are requesting an update to the attached watermain boundary condition for the commercial site at Hazeldean and Huntmar roads, the calculated water demands are as follows:

Average Day	0.73 l/s
Max Day	1.08
Peak Hour	1.95

A fire flow rate of 250 l/s was used in the analysis.

Regards

Lance Erion P.Eng

Associate
email lerion@IBIGroup.com web www.ibigroup.com

IBI GROUP



IBI GROUP
333 PRESTON STREET
OTTAWA, ON
K1S 5N4

WATERMAIN DEMAND CALCULATION SHEET

PROJECT : NORTH AMERICAN
LOCATION : CITY OF OTTAWA

FILE: 10113.5.7
DATE: 2016-08-29
DESIGN: LE
PAGE: 1 OF 1

NODE	RESIDENTIAL						NON-RESIDENTIAL			AVERAGE DAILY DEMAND (l/s)			MAXIMUM DAILY DEMAND (l/s)			MAXIMUM HOURLY DEMAND (l/s)			FIRE DEMAND (l/s)
	UNITS				GROSS RES. (Ha)	POP'N	COM (m ²)	IND (Ha)	INS (Ha)	Res.	Non-res.	Total	Res.	Non-res.	Total	Res.	Non-res.	Total	
	SF	SD	TH	APT															
28						0	3,287			0.00	0.10	0.10	0.00	0.14	0.14	0.00	0.26	0.26	250
30						0	7,813			0.00	0.23	0.23	0.00	0.34	0.34	0.00	0.61	0.61	250
32						0	2,323			0.00	0.07	0.07	0.00	0.10	0.10	0.00	0.18	0.18	250
34						0	4,181			0.00	0.12	0.12	0.00	0.18	0.18	0.00	0.33	0.33	250
42						0	1,092			0.00	0.03	0.03	0.00	0.05	0.05	0.00	0.09	0.09	250
48						0	705			0.00	0.02	0.02	0.00	0.03	0.03	0.00	0.06	0.06	195
54						0	1,830			0.00	0.05	0.05	0.00	0.08	0.08	0.00	0.14	0.14	250
56						0	2,608			0.00	0.08	0.08	0.00	0.11	0.11	0.00	0.20	0.20	250
68						0	1,051			0.00	0.03	0.03	0.00	0.05	0.05	0.00	0.08	0.08	250
TOTALS	0	0	0	0	0	0	24889	0.00	0.00	0.00	0.73	0.73	0.00	1.08	1.08	0.00	1.95	1.95	

ASSUMPTIONS

RESIDENTIAL DENSITIES	AVERAGE DAILY DEMAND	MAXIMUM DAILY DEMAND	MAXIMUM HOURLY DEMAND	FIRE DEMANDS
- Single Family (SF) 3.4 p/p/u	- Residential 450 l/cap/day	- Residential 1.125 l/cap/day	- Residential 2.475 l/cap/day	- SF 100 l/s
- Semi Detached (SD) 2.7 p/p/u	- Commercial 2,500 l/(1000m ² /d)	- Commercial 3,750 l/(1000m ² /d)	- Commercial 6,750 l/(1000m ² /d)	- SD 125 l/s
- Townhouse (TH) 2.7 p/p/u	- Industrial 20,000 l/ha/day	- Industrial 30,000 l/ha/day	- Industrial 54,000 l/ha/day	- TH 125 l/s
- Apartment (APT) 1.8 p/p/u	- Institutional 15,000 l/ha/day	- Institutional 22,500 l/ha/day	- Institutional 40,500 l/ha/day	- APT 170 l/s
				- ICI 250 l/s

Fire Flow Requirement from Fire Underwriters Survey

North American - Box A,B,C CRU B-1,B-2

Building Floor Area 9,400 m²

Fire Flow

$$F = 220C\sqrt{A}$$

C	0.8	C =	1.5 wood frame
A	9,400 m ²		1.0 ordinary
F	17,064 l/min		0.8 non-combustible
use	17,000 l/min		0.6 fire-resistive

Occupancy Adjustment

Use	0%	-25% non-combustible
		-15% limited combustible
		0% combustible
		+15% free burning
		+25% rapid burning
Adjustment	0 l/min	
Fire flow	17,000 l/min	

Sprinkler Adjustment

Use	-30%	-30% system conforming to NFPA 13
		-50% complete automatic system
Adjustment	-5100 l/min	

Exposure Adjustment

Building Face	Separation	Charge	Separation	Charge
			0 to 3m	+25%
			3.1 to 10m	+20%
			10.1 to 20m	+15%
north	36	5%	20.1 to 30m	+10%
east	12	15%	30.1 to 45m	+5%
south	90	0%		
west	> 45	0%		

Total 20%

Adjustment 3,400 l/min

Required Fire Flow

Total adjustments	-1,700 l/min
Fire flow	15,300 l/min
Use	15,000 l/min
	250.0 l/s

Fire Flow Requirement from Fire Underwriters Survey

North American - Box D and E
 Building Floor Area 5,800 m²

Fire Flow

$$F = 220C\sqrt{A}$$

C	0.8	C =	1.5 wood frame
A	5,800 m ²		1.0 ordinary
F	13,404 l/min		0.8 non-combustible
use	13,000 l/min		0.6 fire-resistive

Occupancy Adjustment

Use	0%	-25% non-combustible
		-15% limited combustible
		0% combustible
		+15% free burning
		+25% rapid burning
Adjustment	0 l/min	
Fire flow	13,000 l/min	

Sprinkler Adjustment

Use	-30%	-30% system conforming to NFPA 13
		-50% complete automatic system
Adjustment	-3900 l/min	

Exposure Adjustment

Building Face	Separation	Charge	Separation	Charge
			0 to 3m	+25%
			3.1 to 10m	+20%
			10.1 to 20m	+15%
north	36	5%	20.1 to 30m	+10%
east	> 45	0%	30.1 to 45m	+5%
south	> 45	0%		
west	12	15%		


Total 20%

Adjustment 2,600 l/min


Required Fire Flow

Total adjustments	-1,300 l/min
Fire flow	11,700 l/min
Use	11,700 l/min
	195.0 l/s


Pipe Sizes and Node ID's

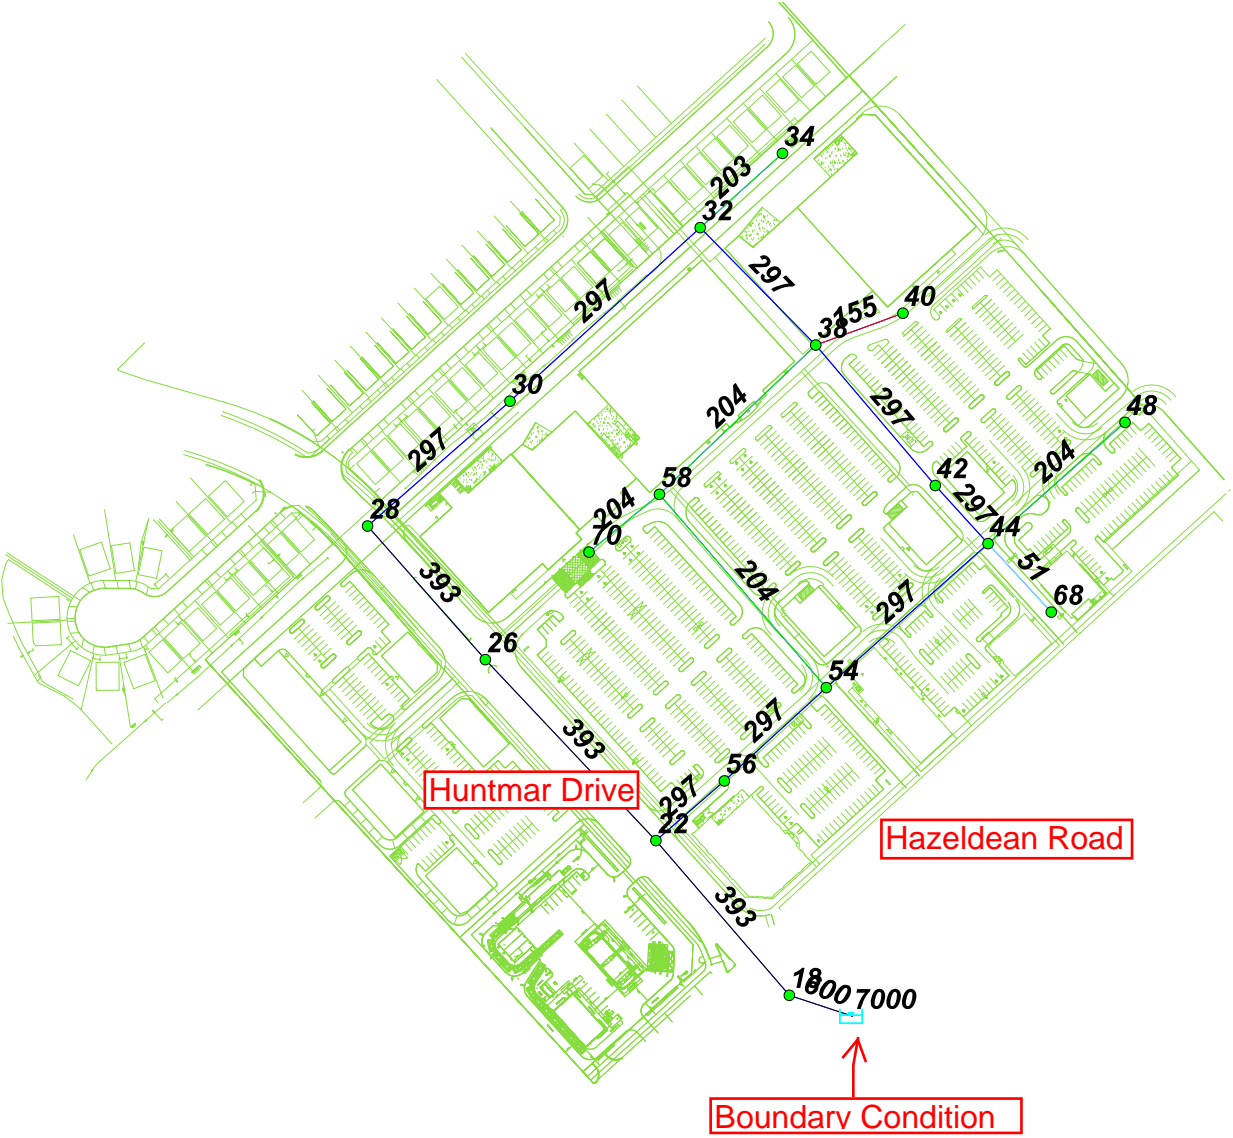


Basic Day (Max HGL) HGL 161.6m - Pressures kPa

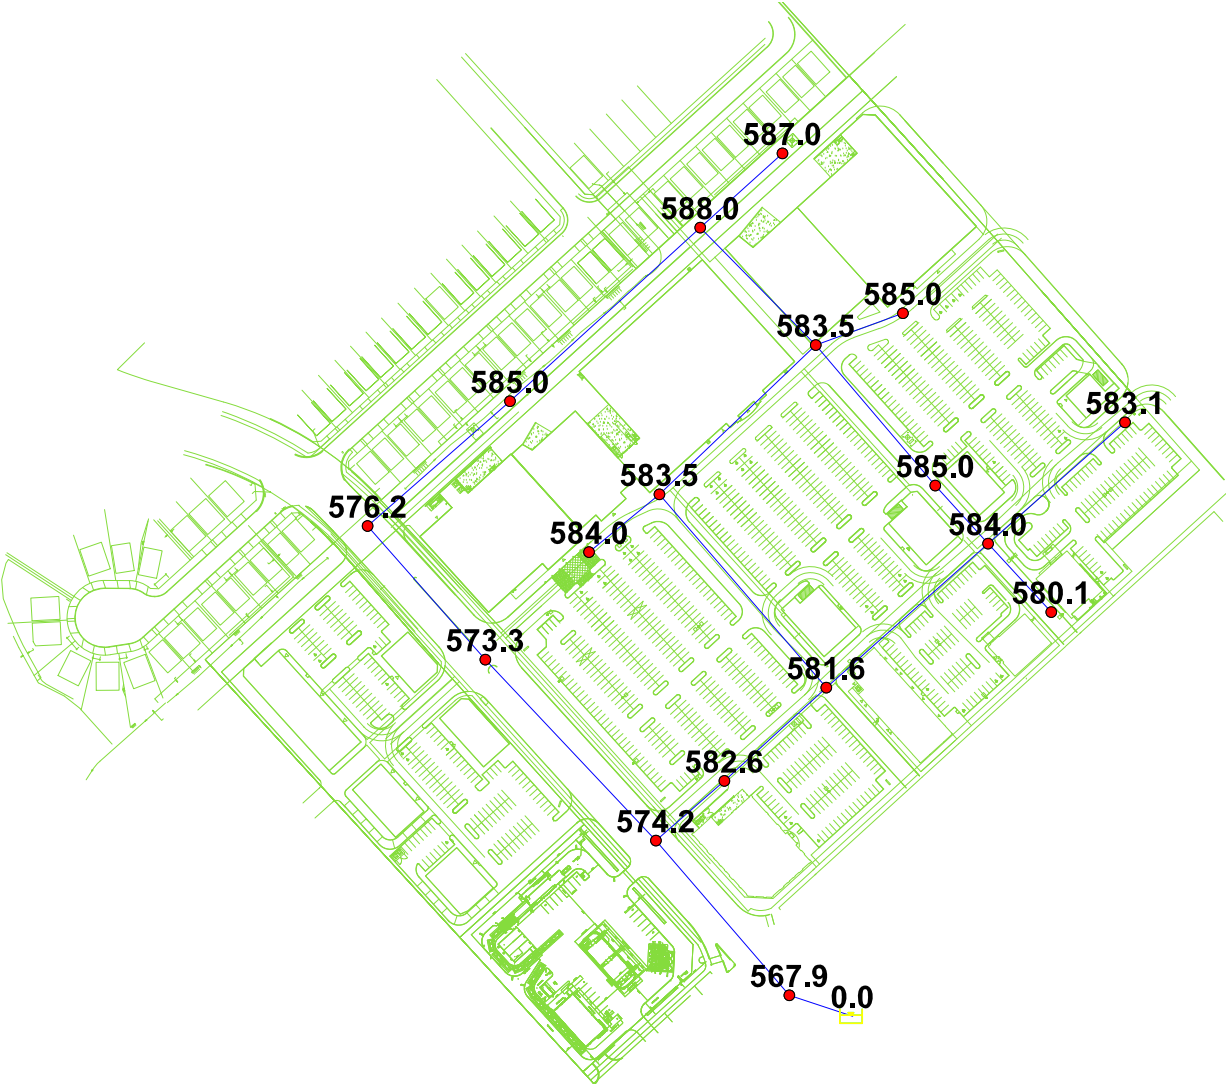


Peak Hour HGL 156.5m - Pressures kPa

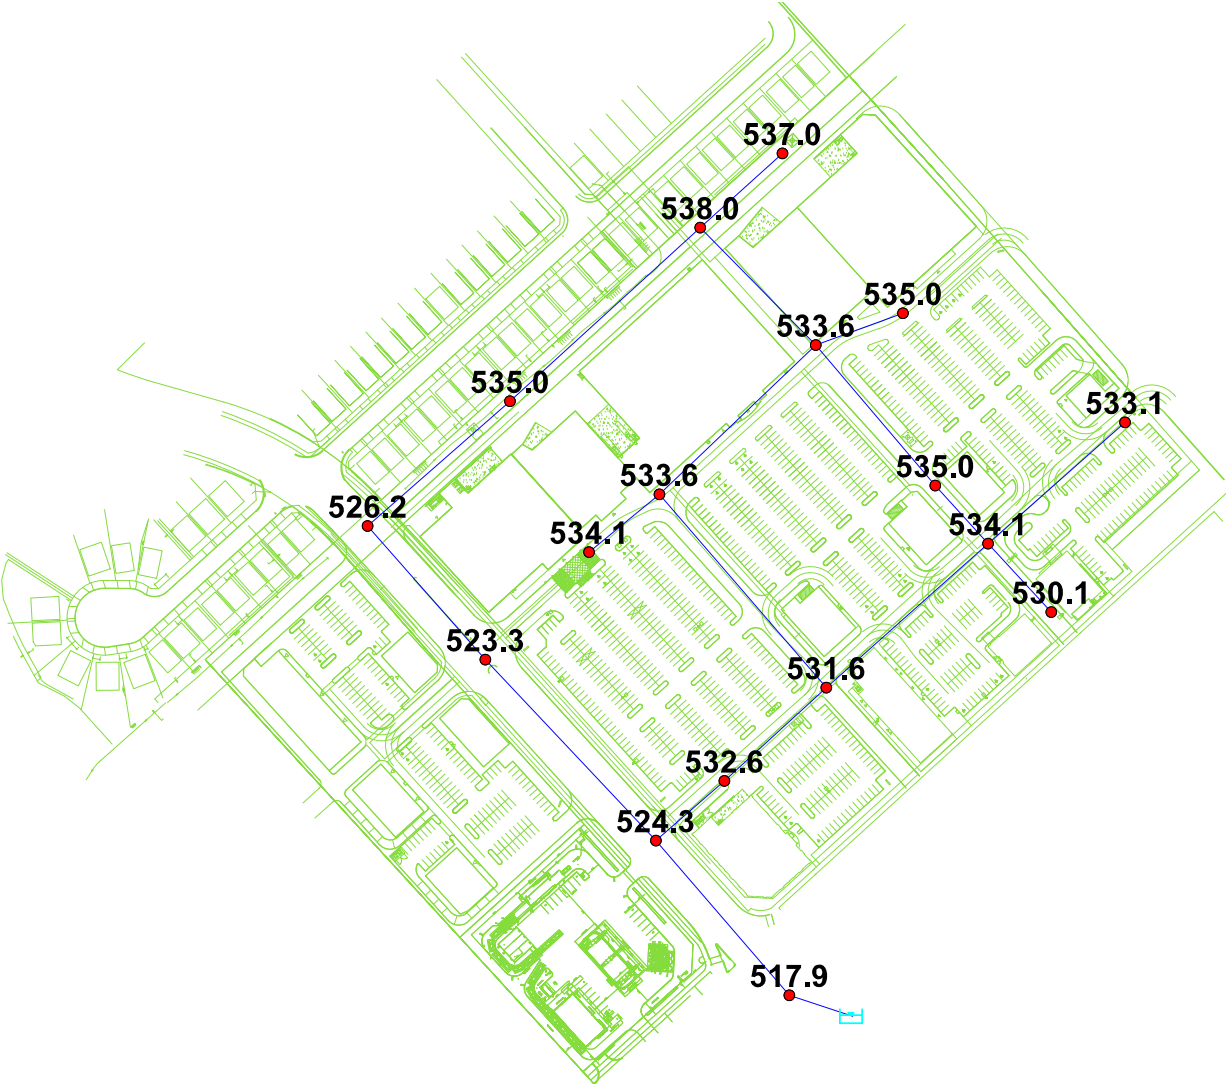



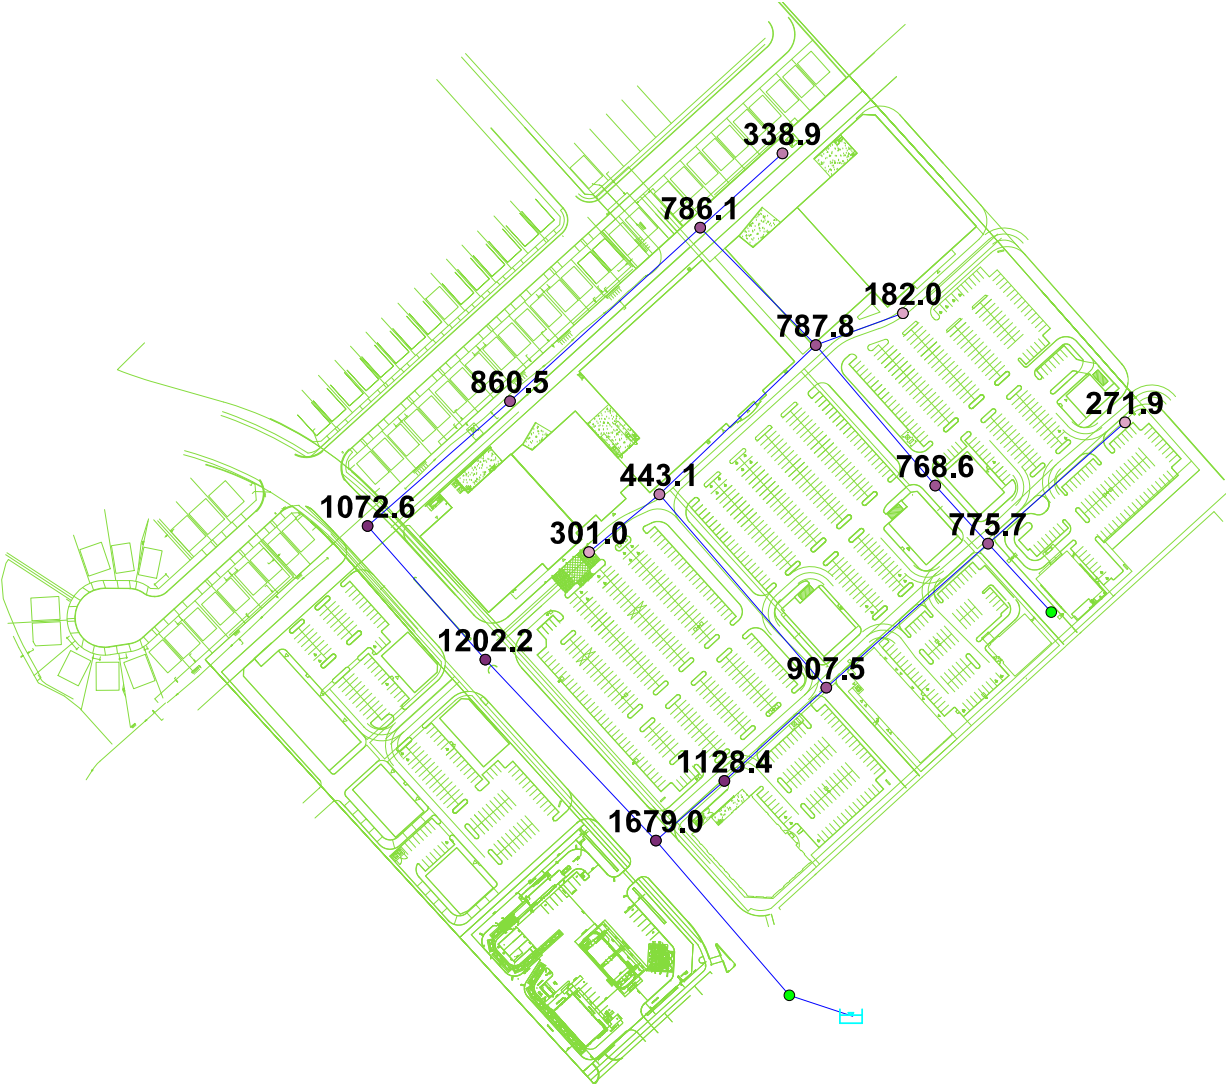



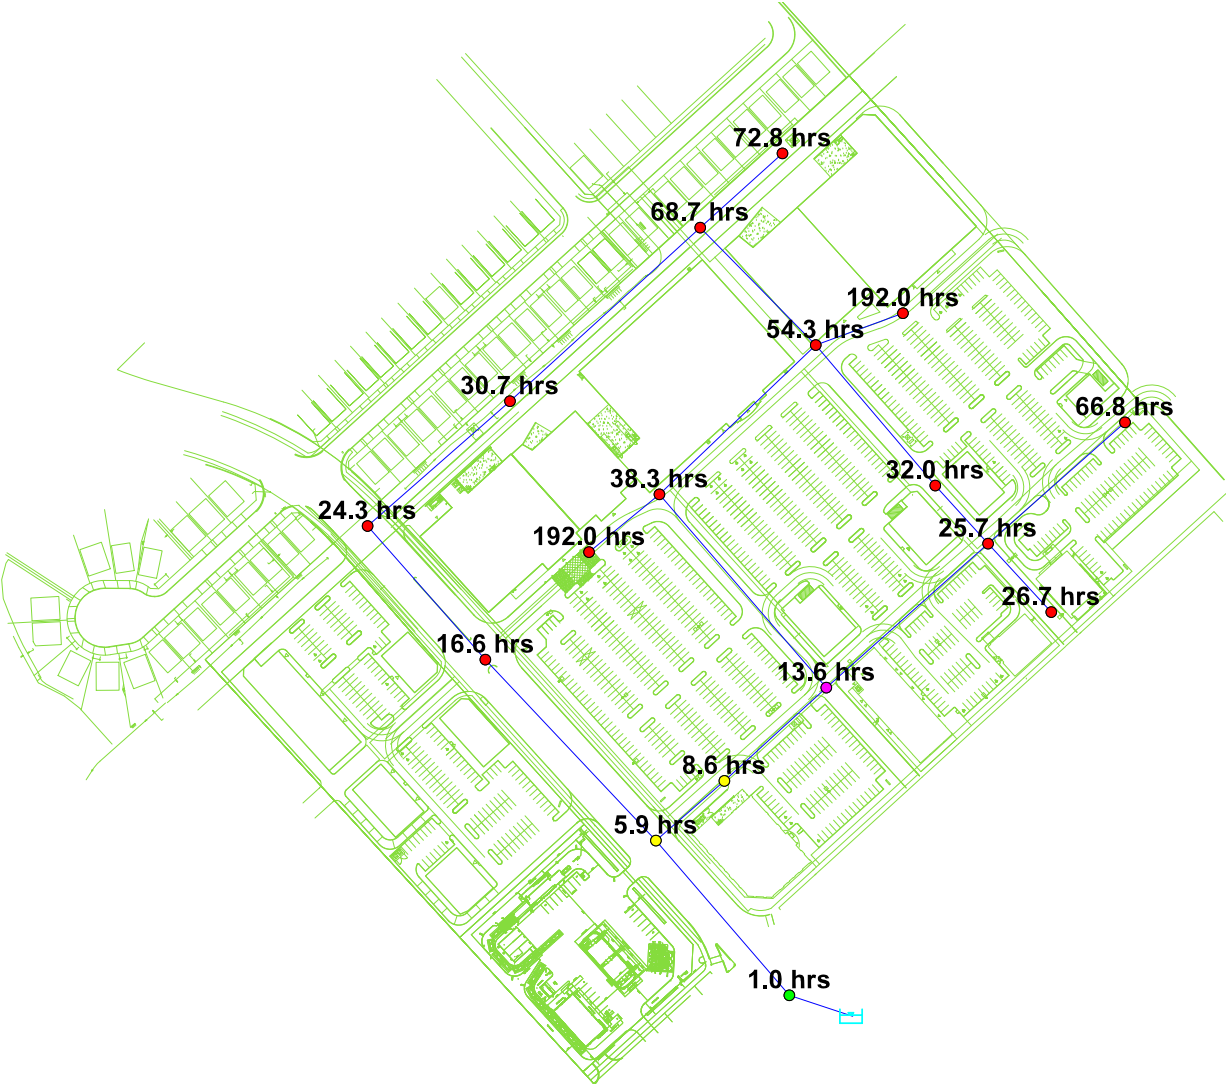










Max Day + Fire HGL 155.0m - Design Fireflows l/s




















Basic Day HGL 161.6m - Water Age



Basic Day (Max HGL) HGL 161.6m - Junction Report

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (kPa)
1		18	0.00	103.65	161.60	567.86
2		22	0.00	103.00	161.60	574.23
3		26	0.00	103.10	161.60	573.25
4		28	0.10	102.80	161.60	576.19
5		30	0.23	101.90	161.60	585.01
6		32	0.07	101.60	161.60	587.95
7		34	0.12	101.70	161.60	586.97
8		38	0.00	102.05	161.60	583.54
9		40	0.00	101.90	161.60	585.01
10		42	0.03	101.90	161.60	585.01
11		44	0.00	102.00	161.60	584.03
12		48	0.02	102.10	161.60	583.05
13		54	0.05	102.25	161.60	581.58
14		56	0.05	102.15	161.60	582.56
15		58	0.00	102.05	161.60	583.54
16		68	0.03	102.40	161.60	580.10
17		70	0.00	102.00	161.60	584.03

Peak Hour HGL 156.5m - Junction Report

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (kPa)
1		18	0.00	103.65	156.50	517.89
2		22	0.00	103.00	156.50	524.26
3		26	0.00	103.10	156.50	523.28
4		28	0.26	102.80	156.50	526.22
5		30	0.61	101.90	156.50	535.03
6		32	0.18	101.60	156.50	537.97
7		34	0.33	101.70	156.50	536.99
8		38	0.00	102.05	156.50	533.56
9		40	0.00	101.90	156.50	535.03
10		42	0.09	101.90	156.50	535.03
11		44	0.00	102.00	156.50	534.05
12		48	0.06	102.10	156.50	533.07
13		54	0.14	102.25	156.50	531.60
14		56	0.20	102.15	156.50	532.59
15		58	0.00	102.05	156.50	533.56
16		68	0.08	102.40	156.49	530.09
17		70	0.00	102.00	156.50	534.05

Basic Day Water Age HGL 161.6m - Junction Report


	ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (kPa)	Water Age (hrs)
1	18	0.00	103.65	161.60	567.86	1.00
2	22	0.00	103.00	161.60	574.23	5.86
3	26	0.00	103.10	161.60	573.25	16.63
4	28	0.10	102.80	161.60	576.19	24.34
5	30	0.23	101.90	161.60	585.01	30.66
6	32	0.07	101.60	161.60	587.95	68.65
7	34	0.12	101.70	161.60	586.97	72.75
8	38	0.00	102.05	161.60	583.54	54.33
9	40	0.00	101.90	161.60	585.01	192.00
10	42	0.03	101.90	161.60	585.01	32.02
11	44	0.00	102.00	161.60	584.03	25.75
12	48	0.02	102.10	161.60	583.05	66.82
13	54	0.05	102.25	161.60	581.58	13.56
14	56	0.05	102.15	161.60	582.56	8.61
15	58	0.00	102.05	161.60	583.54	38.32
16	68	0.03	102.40	161.60	580.10	26.75
17	70	0.00	102.00	161.60	584.03	192.00

Max Day + Fire HGL 155.0m - Fireflow Design Report

		ID	Total Demand (L/s)	Critical Node 1 ID	Critical Node 1 Pressure (kPa)	Critical Node 1 Head (m)	Adjusted Fire-Flow (L/s)	Available Flow @Hydrant (L/s)	Critical Node 2 ID	Critical Node 2 Pressure (kPa)	Critical Node 2 Head (m)	Adjusted Available Flow (L/s)	Design Flow (L/s)
1	■	22	250.00	26	497.67	153.79	1,679.03	1,681.37	26	139.01	117.19	1,679.02	1,679.02
2	■	26	250.00	26	488.36	152.94	1,202.17	1,202.14	26	139.98	117.38	1,202.16	1,202.16
3	■	28	250.14	28	486.35	152.43	1,072.58	1,072.56	28	139.97	117.08	1,072.58	1,072.58
4	■	30	250.34	30	481.60	151.05	860.59	860.52	30	139.97	116.18	860.53	860.53
5	■	32	250.10	34	476.31	150.21	786.15	787.23	34	138.99	115.78	786.15	786.15
6	■	34	250.18	34	304.33	132.76	338.90	338.90	34	139.96	115.98	338.90	338.90
7	■	38	250.00	38	473.50	150.37	787.82	787.81	38	139.97	116.33	787.82	787.82
8	■	40	195.00	40	88.12	110.89	181.99	182.00	40	139.96	116.18	182.00	181.99
9	■	42	250.05	42	472.67	150.14	768.60	768.60	42	139.97	116.18	768.60	768.60
10	■	44	250.00	48	471.77	150.14	775.73	776.80	48	138.99	116.18	775.73	775.73
11	■	48	250.03	48	194.44	121.94	271.94	271.93	48	139.96	116.38	271.93	271.93
12	■	54	250.08	54	482.15	151.45	907.45	907.44	54	139.97	116.53	907.45	907.45
13	■	56	250.11	56	494.59	152.62	1,128.41	1,128.39	56	139.98	116.43	1,128.41	1,128.41
14	■	58	250.00	58	387.52	141.60	443.13	443.13	58	139.96	116.33	443.13	443.13
15	■	70	250.00	70	250.30	127.54	300.99	300.99	70	139.96	116.28	300.99	300.99

Peak Hour HGL 156.5m - Pipe Report

	ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/km)
1	23	26	28	88.02	393.00	120.00	1.04	0.01	0.0000	0.000
2	25	28	30	93.58	297.00	120.00	0.78	0.01	0.0000	0.000
3	27	32	30	127.33	297.00	120.00	-0.17	0.00	0.00	0.00
4	29	34	32	54.72	203.00	110.00	-0.33	0.01	0.0000	0.00
5	35	40	38	45.88	155.00	100.00	0.00	0.00	0.00	0.00
6	37	38	42	91.22	297.00	120.00	-0.22	0.00	0.0000	0.000
7	39	42	44	38.75	297.00	120.00	-0.31	0.00	0.00	0.00
8	51	54	56	68.26	297.00	120.00	-0.71	0.01	0.0000	0.000
9	53	56	22	44.95	297.00	120.00	-0.91	0.01	0.0000	0.00
10	67	44	68	46.11	51.00	100.00	0.08	0.04	0.00	0.11
11	69	7000	18	1.00	600.00	120.00	1.95	0.01	0.00	0.00
12	73	38	32	81.43	297.00	120.00	0.34	0.00	0.00	0.00
13	75	58	54	126.28	204.00	110.00	-0.12	0.00	0.0000	0.000
14	77	38	58	106.92	204.00	110.00	-0.12	0.00	0.0000	0.000
15	79	58	70	44.94	204.00	110.00	0.00	0.00	0.00	0.00
16	81	48	44	90.48	204.00	110.00	-0.06	0.00	0.00	0.00
17	83	18	22	101.02	393.00	120.00	1.95	0.02	0.0000	0.000
18	85	22	26	122.92	393.00	120.00	1.04	0.01	0.0000	0.000
19	87	44	54	107.07	297.00	120.00	-0.45	0.01	0.0000	0.000



SCOLER LEE
BORENSTEIN
+ ASSOCIATES
ARCHITECTS INC.

60 ST. CLAIR AVENUE EAST
SUITE 900
TORONTO, ONTARIO
M4T 1N5
TEL: (416) 362-7753
FAX: (416) 362-8519

March 23, 2020

City of Ottawa
101 Centrepont Drive
Ottawa, Ontario
K2G 5K7

**RE: 5705 Hazeldean Road
Kanata, Ontario
SPA # D07-12-19-0168**

Dear Sir:

A basic sprinkler system will be provided for Proposed Cru-B-2A and Proposed Box D. Design and details to be implemented at Building Permit stages.

Yours truly

Allan Borenstein
Architect

ONTARIO ASSOCIATION
OF
ARCHITECTS

ALLAN MICHAEL BORENSTEIN
LICENCE
7172

APPENDIX B

- Modified Rational Method design sheets Phase 1 & 2
- DSEL Figure 1
- DSEL email
- DSEL Figure 2
- C-500B Storm Tributary Area Plan Phase 1 & 2
- Storm sewer design sheets Phase 1 & 2
- C-802 Phase 1 & 2 ICD Plan
- C-402 Ponding Plan Phase 1 & 2
- RD-100 & Accutrol Weir Roof Drain
- ICD design sheets Phase 1 & 2
- ADS Stormtech underground storage system
- Mechanical and Structural Rooftop Storage Declaration

STORM SEWER CALCULATION SHEET (RATIONAL METHOD)



Manning 0.013 Return Frequency = 5 years

Location	LOCATION From Node To Node		AREA (Ha)												FLOW					SEWER DATA										
			R= 0.25		R= 0.48		R= 0.6		R= 0.66		R= 0.67		R= 0.72		R= 0.9		Indiv. 2.78 AC	Accum. 2.78 AC	Time of Conc.	Rainfall Intensity	Peak Flow Q (l/s)	DIA. (mm) (actual)	DIA. (mm) (nominal)	TYPE	SLOPE (%)	LENGTH (m)	CAPACITY (l/s)	VELOCITY (m/s)	TIME OF FLOW (min.)	RATIO Q/Q full
			A	No.	A	No.	A	No.	A	No.	A	No.	A	No.	A	No.														
CORIOLIS COURT (Ph.5A)																														
	13	14			0.19	1																								
	14	114			0.17	3A																								
	114	Ex. 167																												
To GALLANTRY WAY, Pipe Ex. 167 - 115																														
HUNTMAR DRIVE																														
	164	165						0.11	25			0.74	22	2.06	2.06	20.00	70.25	144	525	525	CONC	0.27	89.5	223	1.03	1.44	0.65			
	165	166						0.55	26			0.94	23	3.38	5.43	21.44	67.23	365	975	975	CONC	0.26	120.0	1143	1.53	1.31	0.32			
From West of Commercial Block																														
	166	167						0.48	27			0.64	24	2.50	17.86	22.75	64.74	1156	1050	1050	CONC	0.20	102.6	1221	1.41	1.21	0.95			
To GALLANTRY WAY, Pipe Ex. 167 - 115																														
GALLANTRY WAY (Ph.5A)																														
Contribution From CORIOLIS COURT, 114 - Ex. 167																														
														1.38	1.38	17.20														
From Huntmar Drive, 164 - 167																														
														17.86	19.24	23.96														
	Ex. 167	115												0.00	19.24	23.96	62.60	1205	1050	1050	CONC	0.25	20.0	1365	1.58	0.21	0.88			
	115	15								0.16	16			0.32	19.56	24.18	62.24	1218	1200	1200	CONC	0.15	75.5	1510	1.34	0.94	0.81			
	15	16								0.47	17			0.94	20.50	25.12	60.71	1245	1200	1200	CONC	0.15	88.0	1510	1.34	1.10	0.82			
To KHAMSIN STREET, Pipe 16-18																														
Contribution From Future Phase 5B, GALLANTRY WAY																														
														0.82	0.82	16.29														
Contribution From Storm Easement, Pipe CBMH - 8																														
	8	16			0.28	18								21.64	22.46	18.33														
To KHAMSIN STREET, Pipe 16 - 18																														
														0.55	23.02	18.33	74.15	1707	975	975	CONC	0.80	31.5	2004	2.68	0.20	0.85			
															23.02	18.52														
PARK (Block 112)																														
	Cont MH 1	pipe	0.19	6A										0.13	0.13	15.00	83.56	11	300	300	PVC	0.50	8.5	68	0.97	0.15	0.16			
To BRIGATINE AVENUE, Pipe 4 - 5																														
KHAMSIN STREET (Ph.5A)																														
Contribution From GALLANTRY WAY, Pipe 15 - 16																														
														20.50	20.50	26.22														
Contribution From GALLANTRY WAY, Pipe 8 - 16																														
	16	18			0.33	31								23.02	43.52	18.52														
Contribution From Future Phase 5B, GALLANTRY WAY																														
	18	19			0.39	30				0.08	19			0.60	44.12	26.22	59.02	2604	1650	1650	CONC	0.15	66.5	3530	1.65	0.67	0.74			
Contribution From Future Phase 5B, BRIGATINE HEIGHTS																														
	18	19								0.18	20			1.11	45.23	17.07														
	19	20								0.17	21			0.88	46.11	26.89	58.04	2676	1650	1650	CONC	0.15	62.5	3530	1.65	0.63	0.76			
	19	20								0.17	21			0.72	46.84	17.21														
	19	20								0.17	21			0.34	47.18	27.52	57.15	2696	1650	1650	CONC	0.15	56.5	3530	1.65	0.57	0.76			
To BRIGATINE AVENUE, Pipe 20 - 21																														
														47.18	28.09															

Definitions:
 Q = 2.78 AIR, where
 Q = Peak Flow in Litres per second (L/s)
 A = Areas in hectares (ha)
 I = Rainfall Intensity (mm/h)
 R = Runoff Coefficient



Notes:
 1) Ottawa Rainfall-Intensity Curve
 2) Min. Velocity = 0.76 m/sec

Designed:	K.M.	PROJECT:	FAIRWINDS SUBDIVISION PHASES 5A, 8
Checked:	Z.L.	LOCATION:	City of Ottawa
Dwg. Reference:	Storm Drainage Plan, Dwg No.7-7A	File Ref:	07-308
		Date:	December, 2009
		Sheet No.	1 of 2

STORM SEWER CALCULATION SHEET (RATIONAL METHOD)



Manning 0.013 Return Frequency = 5 years


LOCATION			AREA (Ha)										FLOW					SEWER DATA												
Location	From Node	To Node	R= 0.25		R= 0.48		R= 0.6		R= 0.66		R= 0.67		R= 0.72		R= 0.8		Indiv. 2.78 AC	Accum. 2.78 AC	Time of Conc.	Rainfall Intensity	Peak Flow Q (l/s)	DIA. (mm) (actual)	DIA. (mm) (nominal)	TYPE	SLOPE (%)	LENGTH (m)	CAPACITY (l/s)	VELOCITY (m/s)	TIME OF FLOW (min.)	RATIO Q/Q full
			A	No.	A	No.	A	No.	A	No.	A	No.	A	No.	A	No.														
BRIGATINE AVENUE (Ph.5A)																														
	1	2											0.13	4			0.26	0.26	15.00	83.56	22	300	300	PVC	0.35	62.5	57	0.81	1.29	0.38
	2	3			0.07	6							0.28	5			0.65	0.91	16.29	79.62	73	450	450	PVC	0.30	70.0	156	0.98	1.19	0.47
	3	4			0.32	15							0.05	7			0.53	1.44	17.48	76.33	110	450	450	PVC	0.40	8.0	180	1.13	0.12	0.61
Contribution From BLOCK 112 (Park), Pipe Cont MH 1 - pipe																														
													0.11	9			0.22	1.79												
	4	5			0.18	14							0.15	8			0.54	2.33	17.59	76.02	177	525	525	CONC	0.50	93.5	304	1.40	1.11	0.58
	5	6											0.02	10			0.04	2.37	18.70	73.23	174	600	600	CONC	0.50	14.5	434	1.54	0.16	0.40
	6	7			0.19	13							0.10	11			0.45	2.83	18.86	72.86	206	600	600	CONC	0.60	43.5	476	1.68	0.43	0.43
	7	20											0.20	12			0.40	3.23	19.29	71.85	232	600	600	CONC	2.50	19.5	971	3.43	0.09	0.24
Contribution From KHAMSIN STREET, Pipe 19 - 20																														
	20	21															47.18	50.40	28.09											
To Pond, Pipe 21 - 22																														
																	0.00	50.40	28.09	56.37	2841	1650	1650	CONC	0.20	20.5	4076	1.91	0.18	0.70
STORM SEWER EASEMENT																														
From External																														
	CBMH	8			0.17	18A											8.56	29	21.64	21.64	18.10									
To GALLANTRY WAY, Pipe 8 - 16																														
																	0.00	21.64	18.10	74.72	1617	975	975	CONC	0.70	34.5	1875	2.51	0.23	0.86



Definitions:
 Q = 2.78 AI_R, where
 Q = Peak Flow in Litres per second (L/s)
 A = Areas in hectares (ha)
 I = Rainfall Intensity (mm/h)
 R = Runoff Coefficient

Notes:
 1) Ottawa Rainfall-Intensity Curve
 2) Min. Velocity = 0.76 m/sec

Designed:	K.M.	PROJECT:	FAIRWINDS SUBDIVISION PHASES 5A, 8	
Checked:	Z.L.	LOCATION:	City of Ottawa	
Dwg. Reference:	Storm Drainage Plan, Dwg No.7-7A	File Ref:	07-308	Date: December, 2009
				Sheet No. 2 of 2

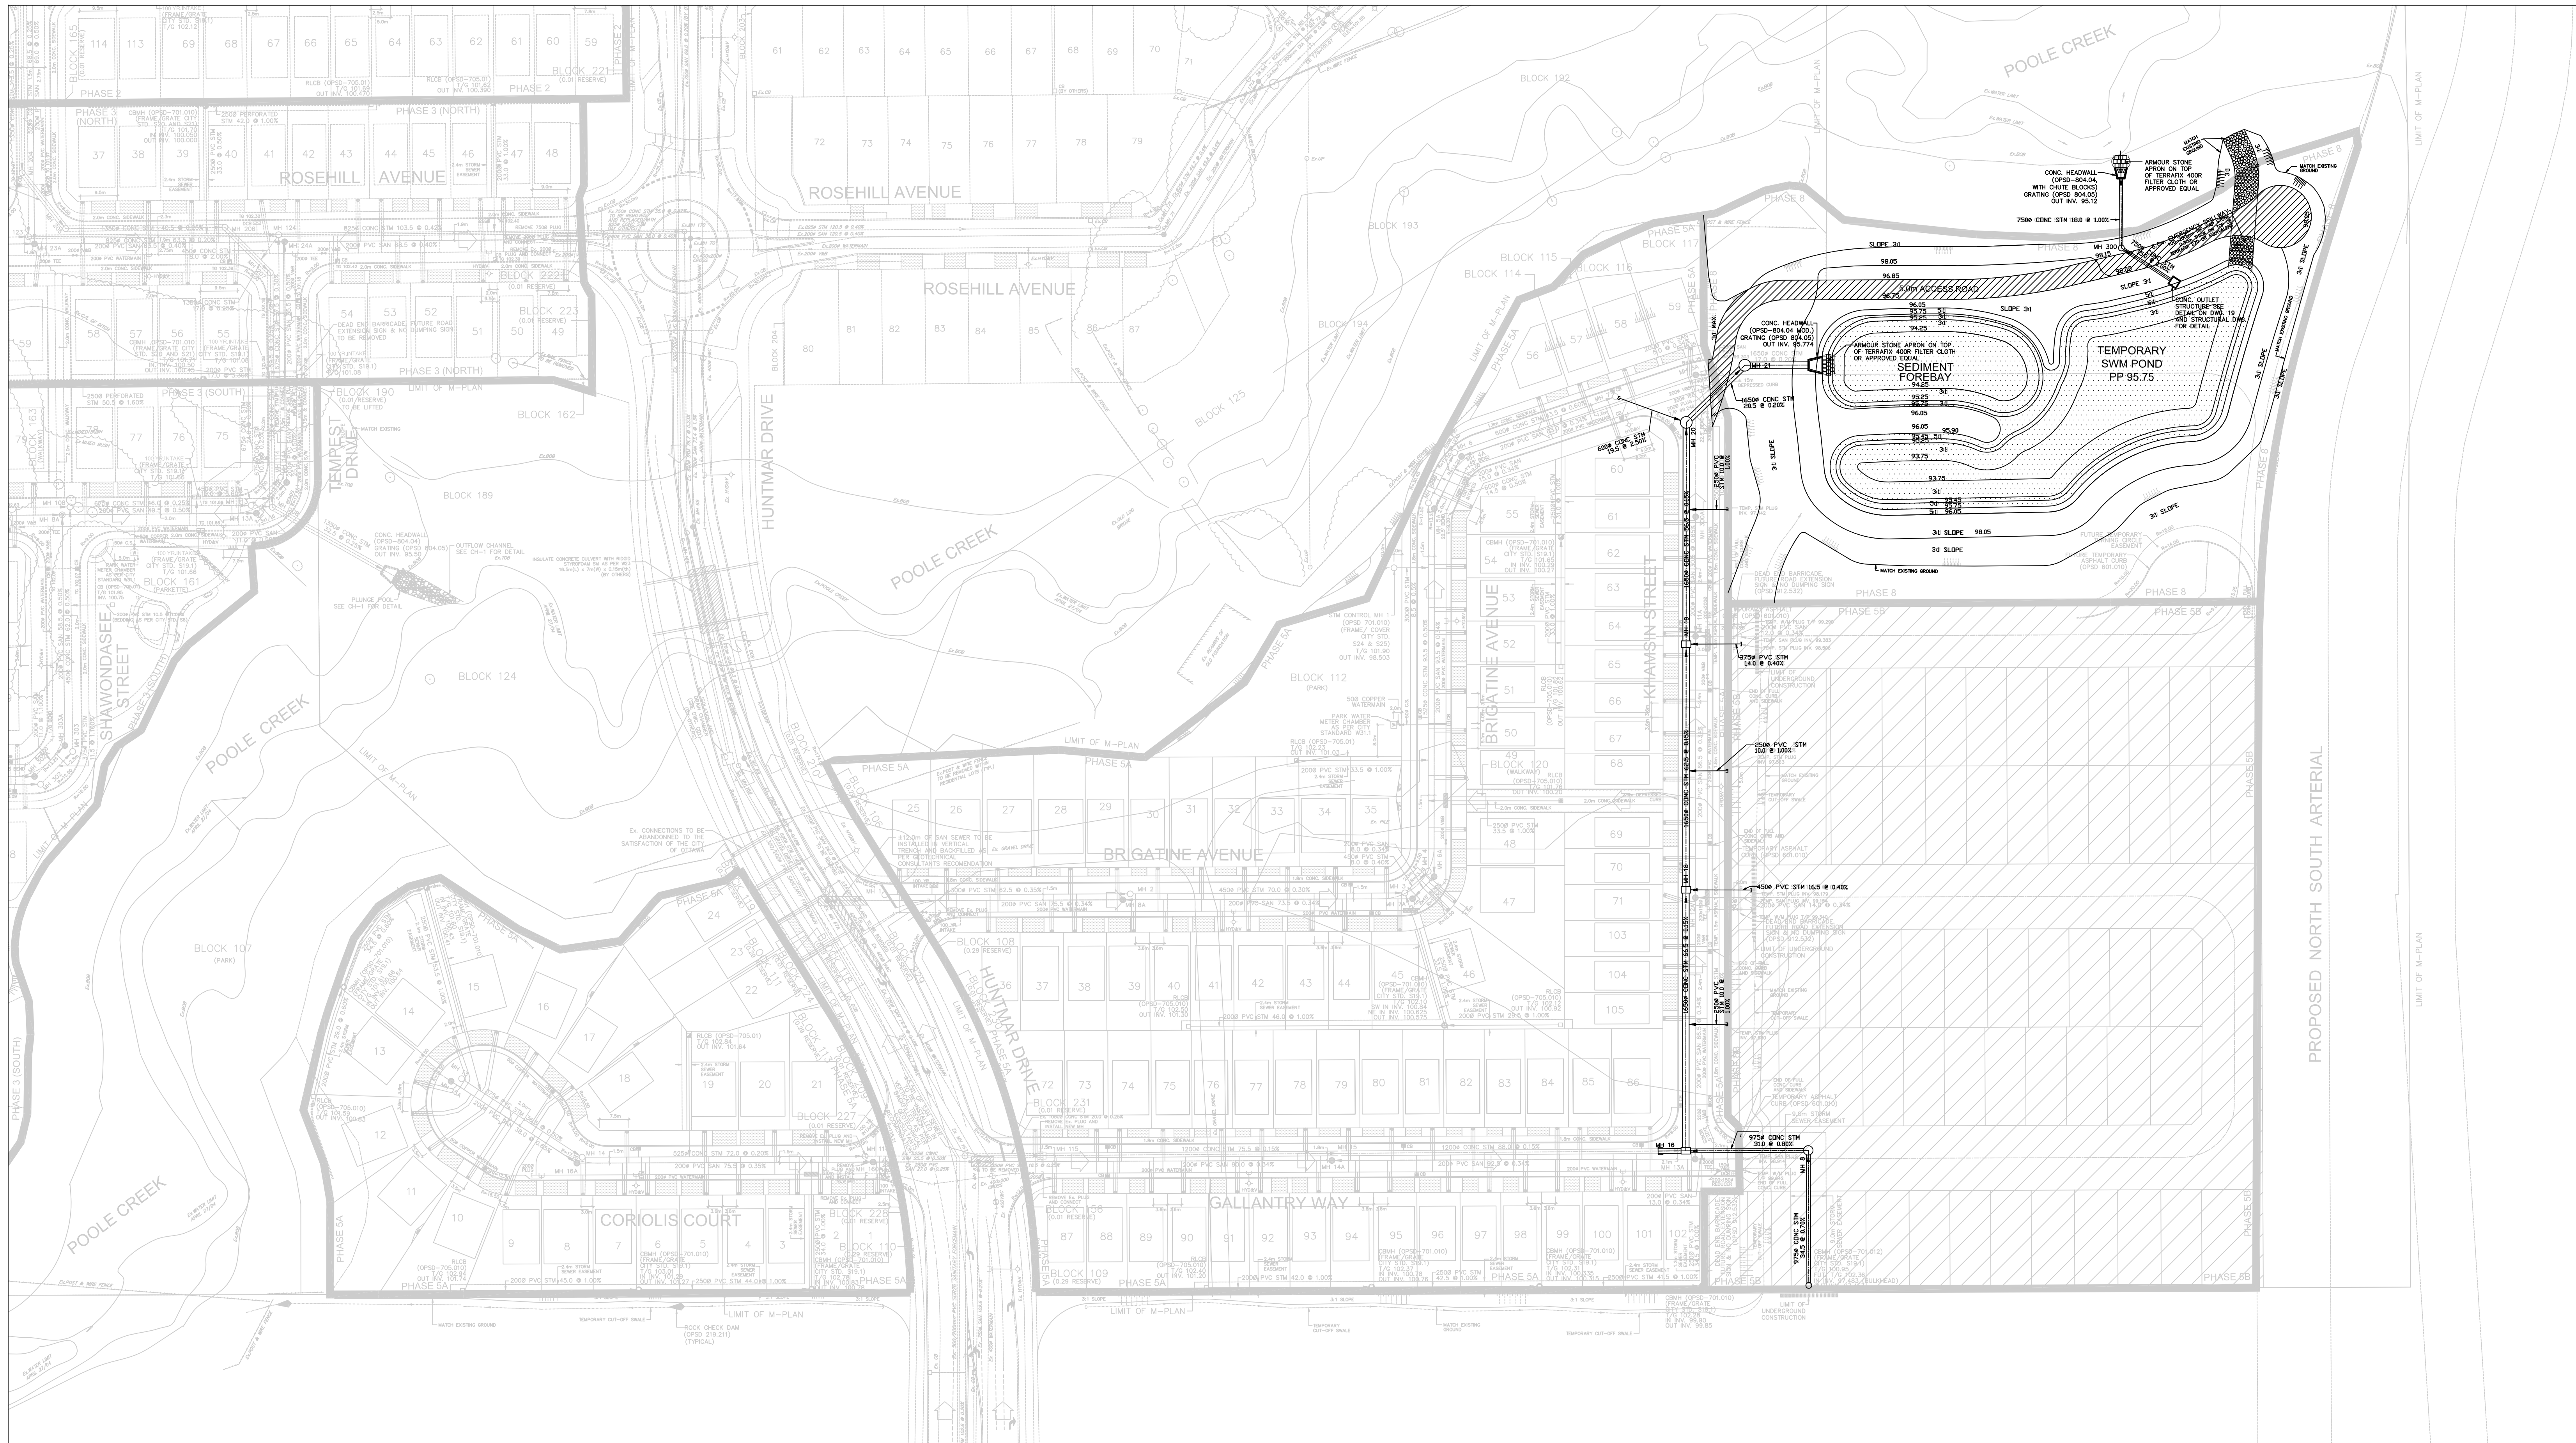

120 Iber Road, Unit 203
 Stittsville, Ontario, K2S 1E9
 Tel. (613) 836-0856
 Fax. (613) 836-7183
 www.DSEL.ca

FAIRWINDS - PHASE 5A AND 8
STORM TRUNK SEWER AND POND

CITY OF OTTAWA

PROJECT No.: 308

May 2010

DRAWN BY: SK

Scale = 1:750

FIGURE - 1

Demetrius Yannoulopoulos

From: Jennifer Ailey <jailey@dsel.ca>
Sent: Friday, December 09, 2011 3:29 PM
To: Demetrius Yannoulopoulos
Subject: North American - Fairwinds Temporary Pond
Attachments: Figure 2.pdf; 10113Base08-104_Rev2_11-11-24.pdf

<<...>> <<...>>

Hi Demetrius,

As requested, I have looked at the Stormwater Management Report and Pond Design Brief for Fairwinds Phases 5A and 5B (JFSA, October 2009). Please see attached from this report Figure 2, which shows that Commercial Area (COM5), representing the North American Commercial Lands shown on your current site plan.

This email confirms that those North American Lands are serviced by the Fairwinds Phase 5A Temporary Stormwater Management Pond. Please let me know if you require anything further.

Jen

Jennifer Ailey, P.Eng.
Senior Design Engineer

DSEL

david schaeffer engineering ltd.

120 Iber Road, Unit 203
Stittsville, ON K2S 1E9

Phone: (613) 836-0856 ext. 226

Fax: (613) 836-7183

Cell: (613) 222-6476

Email: jailey@dsel.ca

This email, including any attachments, is for the sole use of the intended recipient(s) and may contain private, confidential, and privileged information. Any unauthorized review, use, disclosure, or distribution is prohibited. If you are not the intended recipient, or if this information has been inappropriately forwarded to you, please contact the sender by reply email and destroy all copies of the original.



J.F. Sabourin & Associates Inc.
 WATER RESOURCES AND ENVIRONMENTAL CONSULTANTS
 OTTAWA (613) 836-3884
 GATINEAU (819) 243-6858

CLIENT :

DSEL
 david schaeffer engineering ltd
 120 IBER ROAD, SUITE 205
 OTTAWA, ONTARIO, K2S 1E3
 (613) 836-0856


LEGEND :

- LIMITS OF SUBDIVISION
- MAJOR SYSTEM CATCHMENT BOUNDARY
- MAJOR SYSTEM FLOW DIRECTION

FIRST DIRECTION OF EXCESS MAJOR SYSTEM FLOW AT LOW POINT

- SUB-CATCHMENT ID
- SUB-CATCHMENT AREA
- TOTAL IMPERVIOUSNESS

SCALE :








Fairwinds Phases 5A and 5B
 Proposed Major System

FIGURE 2

DRAWING REF.
 677-08\Update 4 (200910)\Design\CAD\
 JFSA Figures.dwg

	DRAWN: LP
	VERIFIED: JFS
	APPROVED: JFS
DATE	PROJECT No.
Oct/09	677-08

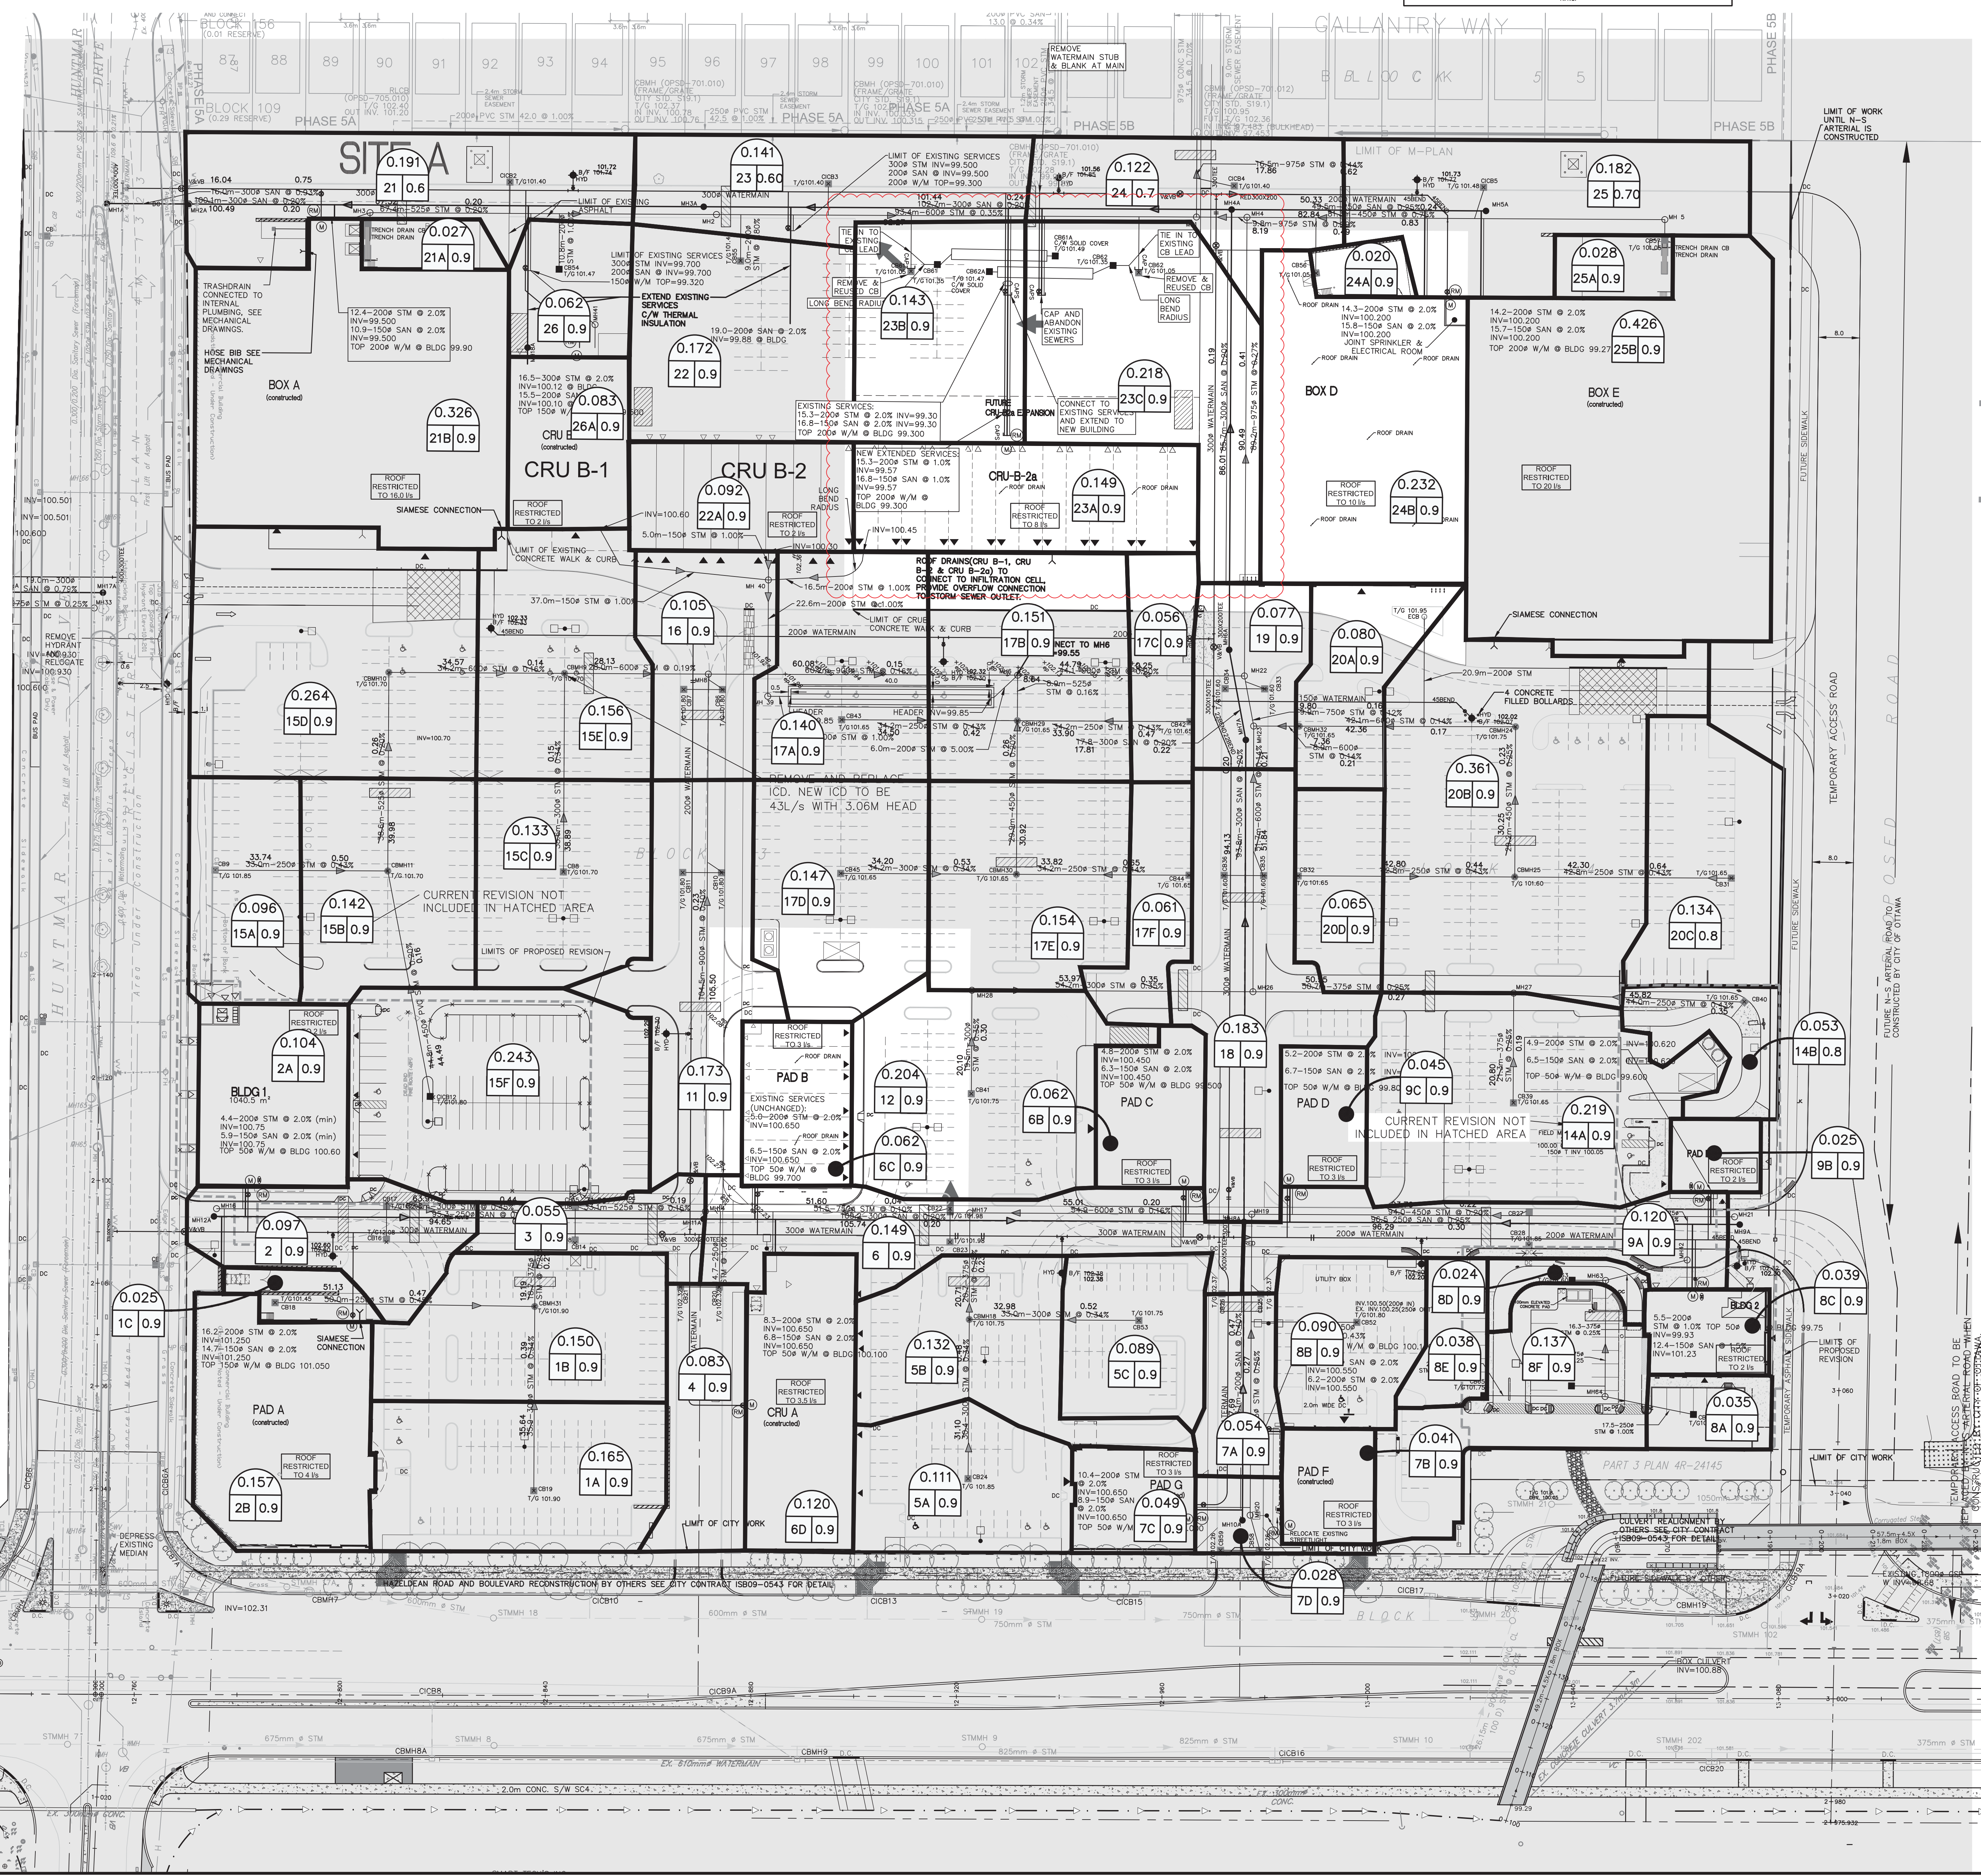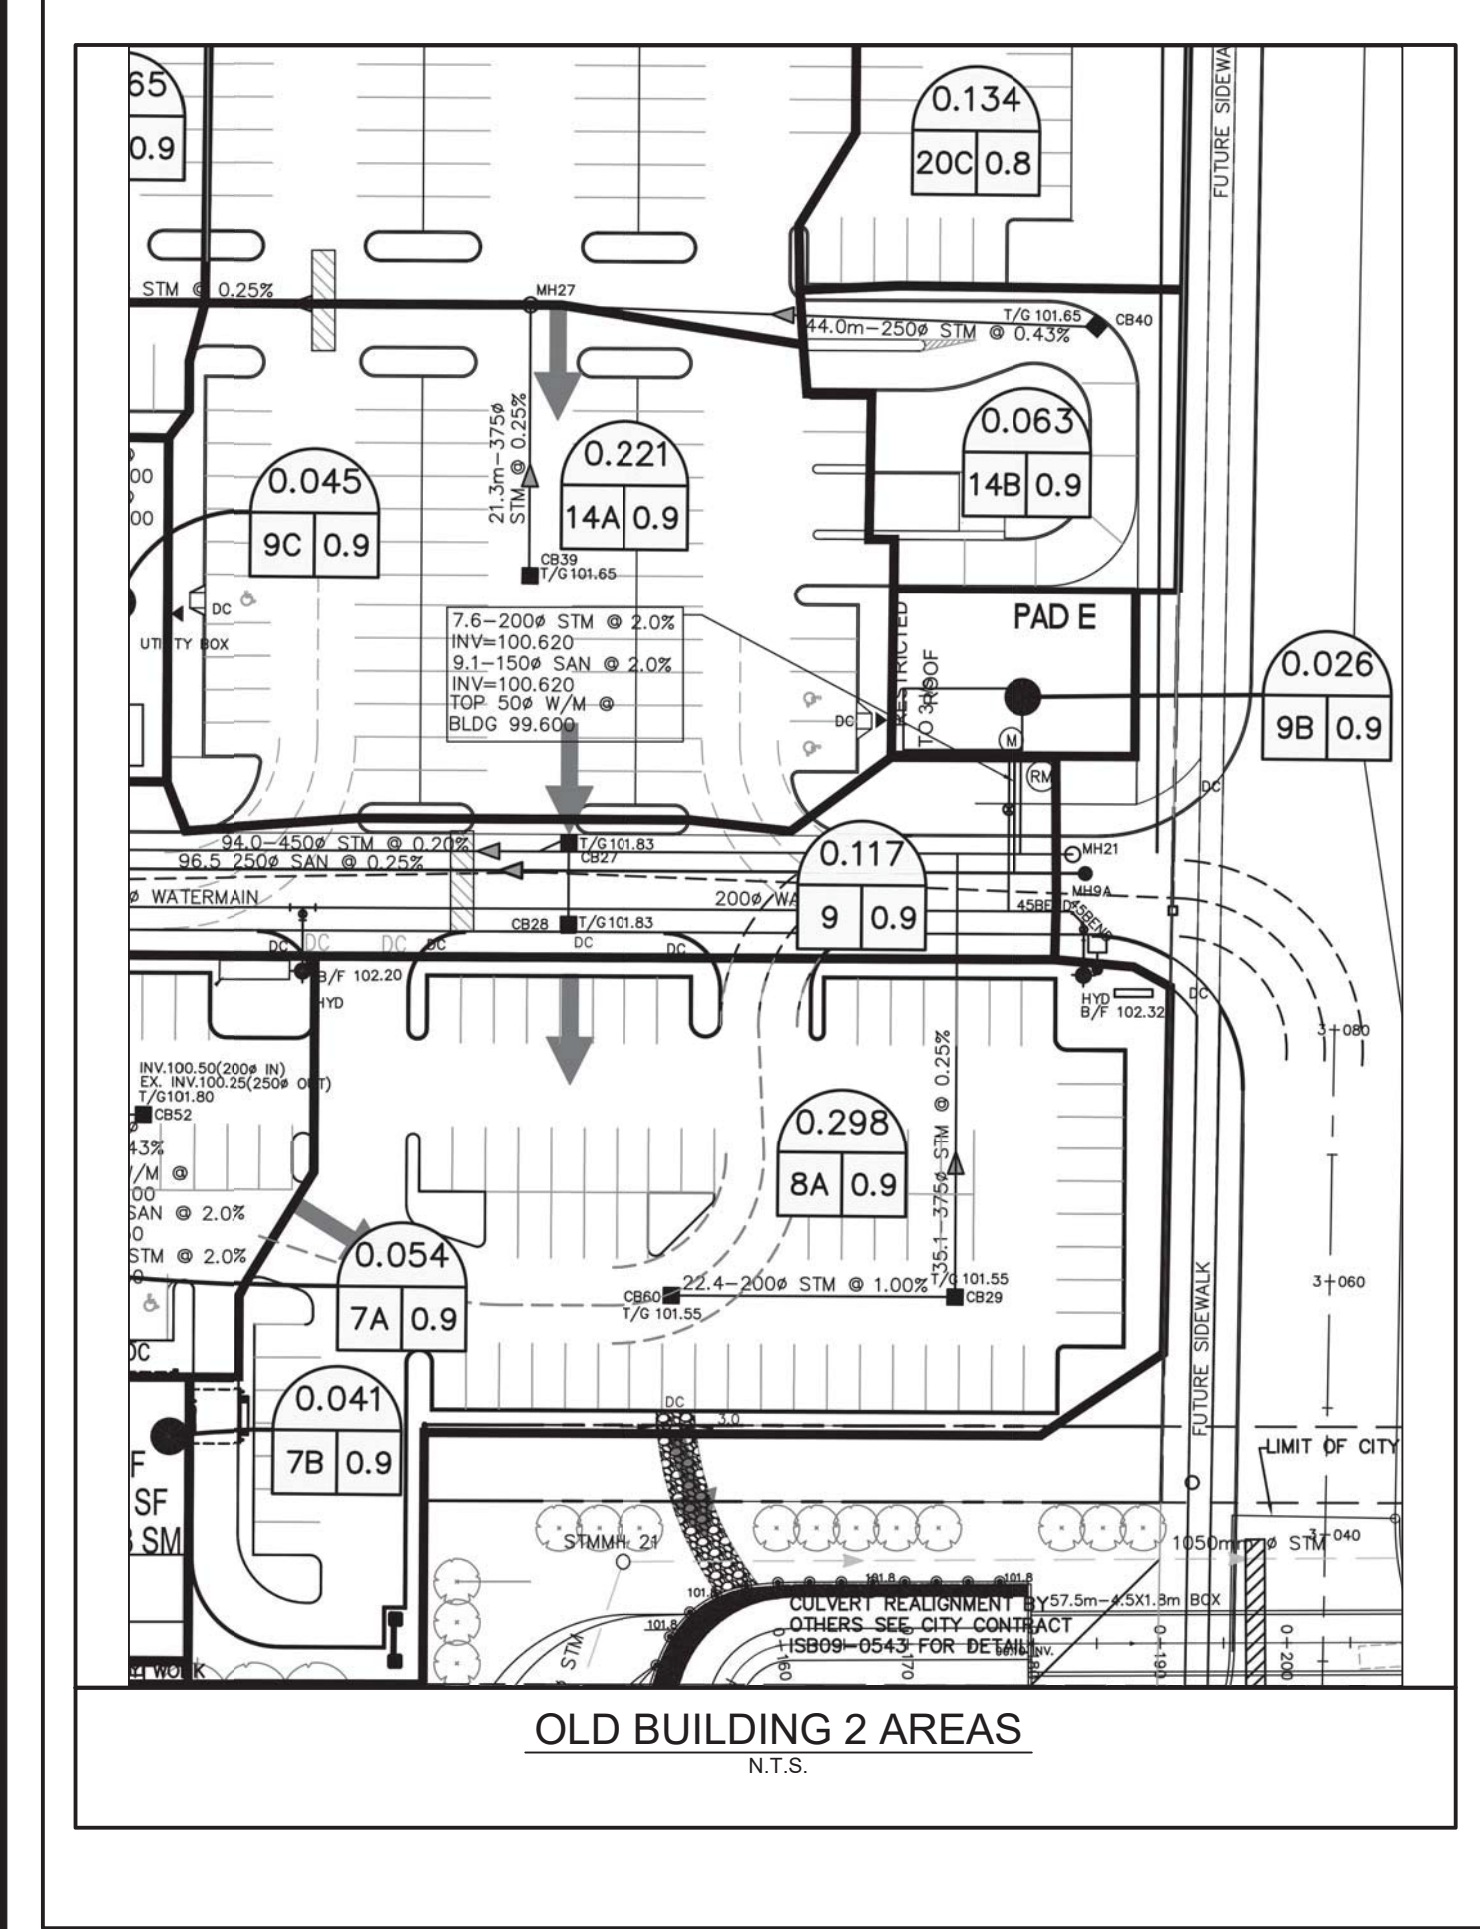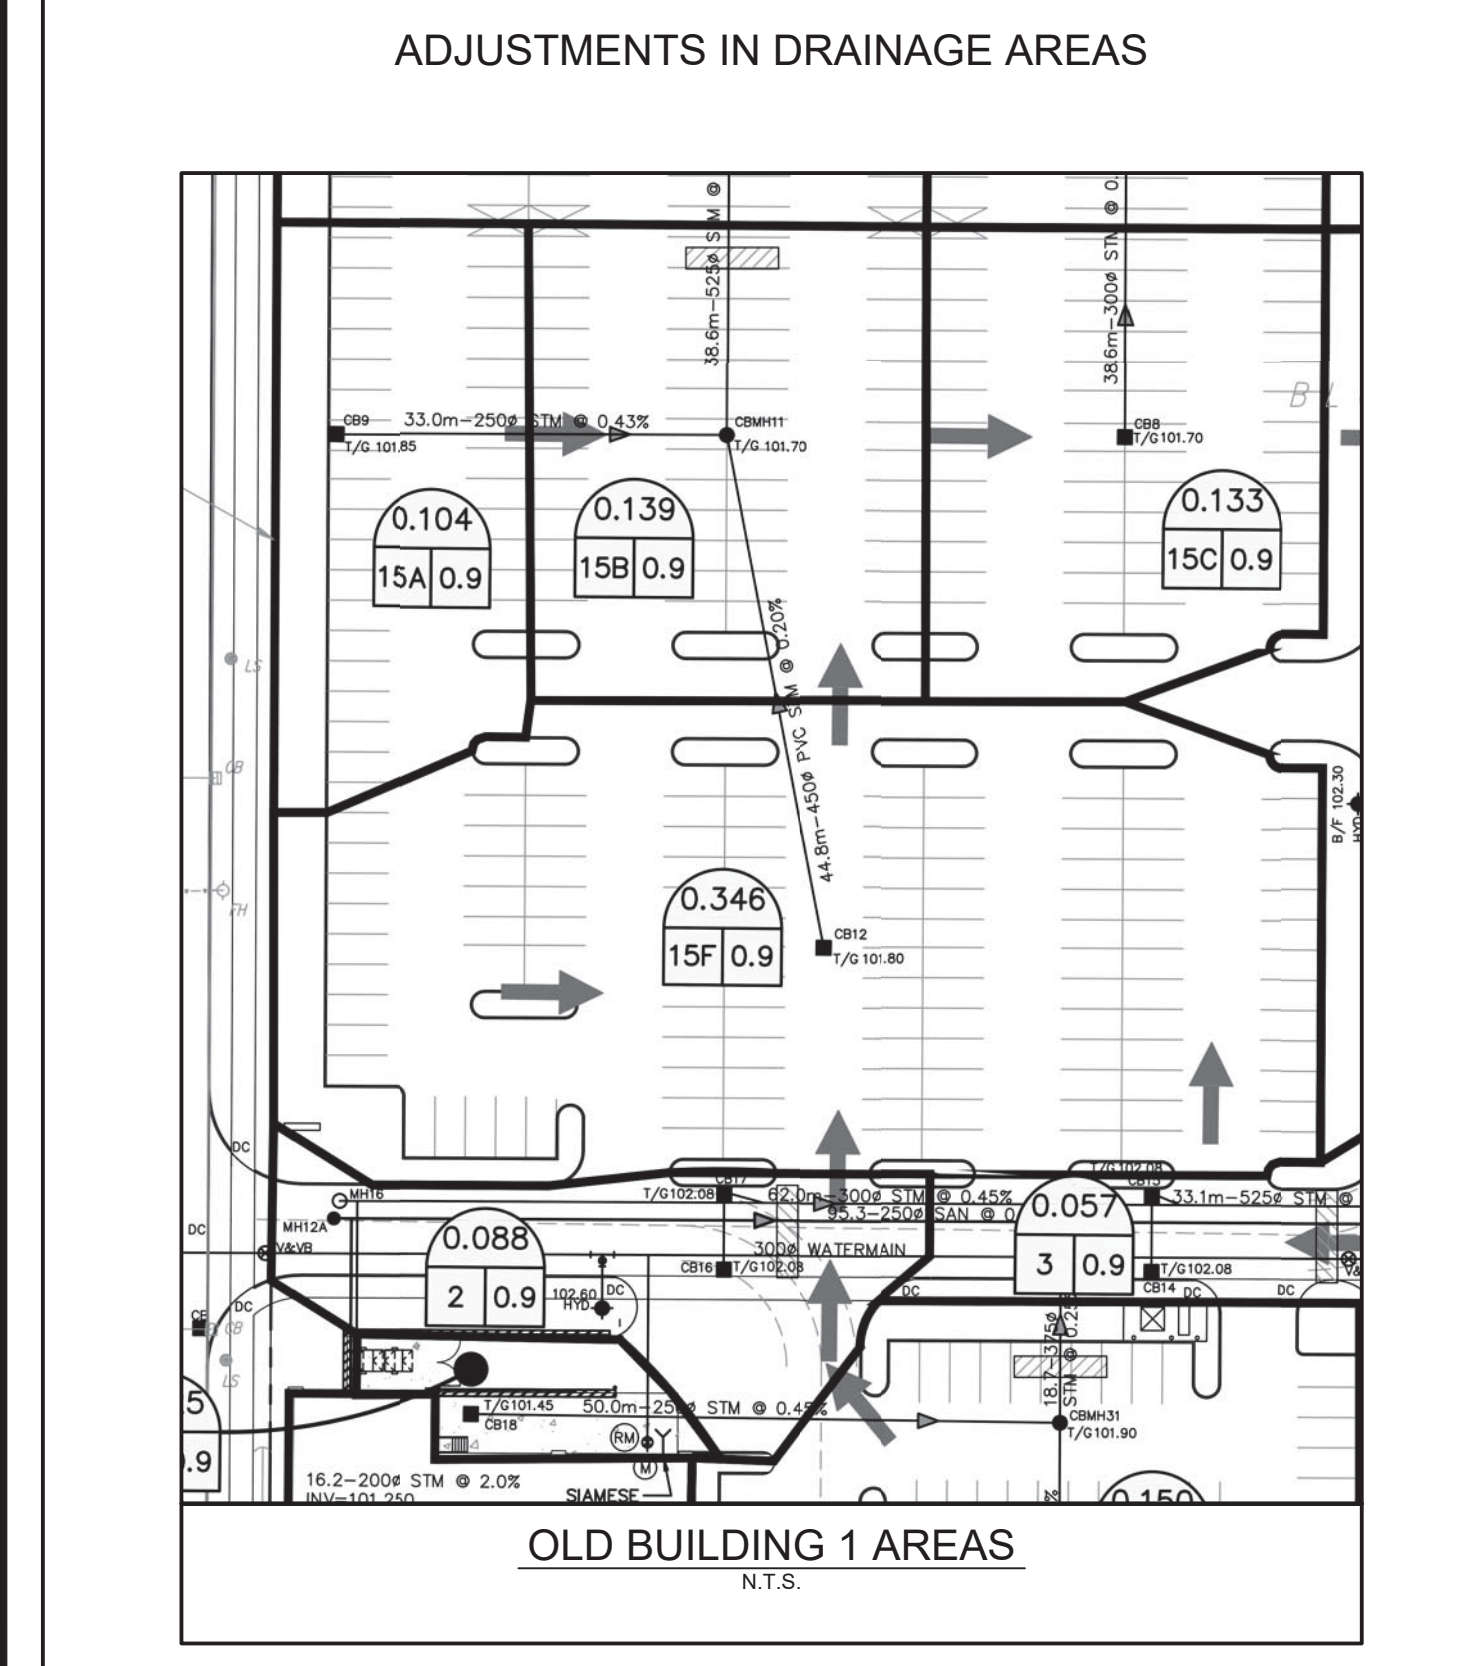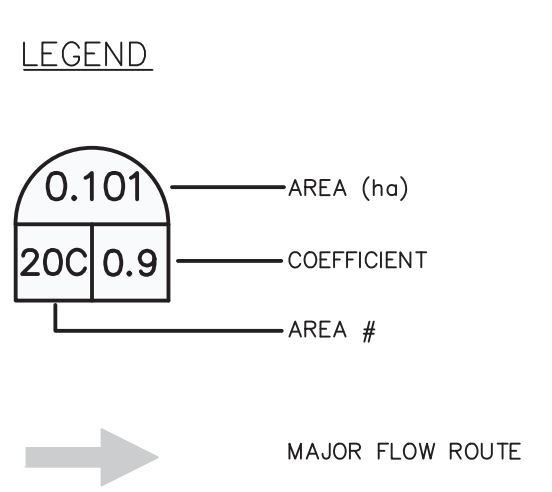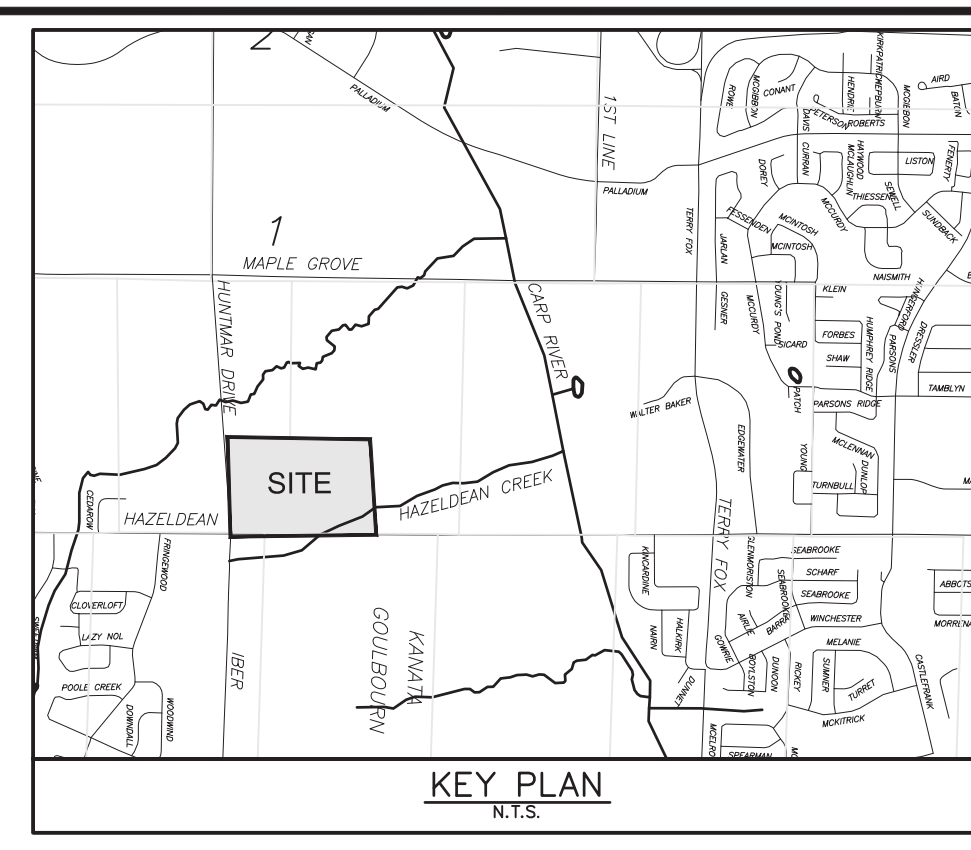


No.	REVISIONS	By	Date
24	REVISED STORAGE CELLS PER	DOY	20-05-15
23	REVISED AS PER CITY	DOY	20-04-30
22	REVISED AS PER CITY	DOY	20-03-37
21	REVISED AS PER CITY	DOY	19-12-20
20	REVISED AS PER CITY	DOY	19-08-29
19	ISSUED FOR CONSTRUCTION	DOY	18-04-06
18	ISSUED FOR TENDER	DOY	18-01-15
17	REVISED AS PER CITY COMMENTS	DOY	17-11-23
16	ISSUED FOR SPA	DOY	17-11-02
15	REVISED AS PER SITE PLAN	DOY	17-07-07
14	REVISED AS PER CITY COMMENTS	DOY	17-06-23
13	REVISED BLD 2 & PAD E	DOY	17-02-14
12	REVISED AS PER CITY COMMENTS	DOY	16-08-03
11	SPA BLDG 1 & 2	DOY	16-03-07
10	REVISED AS PER SITE PLAN	DOY	14-11-03
9	SPA	DOY	14-09-09
8	REVISED AS PER SITE PLAN	DOY	14-08-08
7	REVISED AS PER CITY COMMENTS	DOY	14-07-31
6	REVISED DOLLAR & CRUB	DOY	14-06-03
5	REVISED FOR PAD F	DOY	13-11-16
4	REVISED SPRINKLER ROOM BOX	DOY	12-03-09
3	REVISED PER CITY COMMENTS AND PAD	DOY	12-02-22
2	REVISED SITE PLAN PH1 & PH2	DOY	11-11-24
1	ISSUED FOR APPROVAL	DOY	11-10-27

NORTH AMERICAN DEVELOPMENT GROUP

IBI GROUP
333 Preston Street
Tower 1, Suite 400
Ottawa, Ontario
Canada K1S 0M4
Tel: (613) 225-1311
Fax: (613) 225-9868

Project Title
5705 HAZELDEAN ROAD
OTTAWA, ONT.

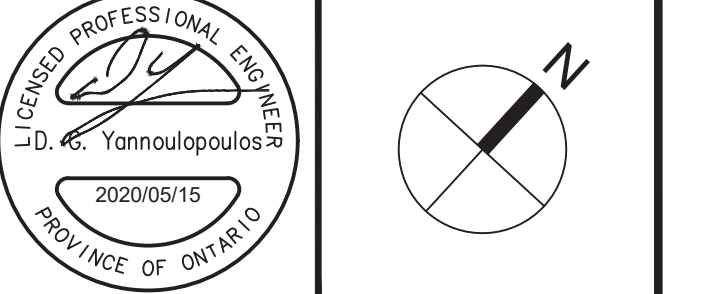

Drawing Title
STORM TRIBUTARY AREAS PHASE 1 & 2

Scale
1:500

Design: D.G.Y. Date: OCTOBER 2011
Drawn: E.H. Checked: D.G.Y.
Project No: 10113 Drawing No: C-500B



IBI Group
333 Preston Street - Suite 400
Ottawa, Ontario
K1S 5N4

CRU B-1, CRU B-2, Box B roofs directed to infiltration chamber

CRU B-1 CRU B-2 revised October 2014

BUILDINGS 1&2, Pad E revised Feb 2017

BUILDINGS Pad B, and CRU expansion revised April 2019

All sewers are existing, only minor modifications to trib areas to reflect adjustment in buildings

Phase 1 & 2 STORM SEWER DESIGN SHEET

PROJECT: HUNTMAR PLAZA
LOCATION: CITY OF OTTAWA
CLIENT: NORTH AMERICAN

LOCATION				AREA (Ha)									RATIONAL DESIGN FLOW						SEWER DATA							
STREET	AREA	FROM MH	TO MH	C= 0.30	C= 0.50	C= 0.60	C= 0.70	C= 0.80	C= 0.90	INDIV. 2.78AC	ACCUM. 2.78AC	INLET (min.)	TIME IN PIPE	TOTAL (min.)	I (mm/Hr)	PEAK FLOW (L/s)	FIXED FLOW (L/s)	DESIGN FLOW (L/s)	CAP. (L/s)	LENGTH (M)	PIPE (mm)	SLOPE (%)	VEL. (M/s)	AVAIL. CAP. (L/s) (%)		
East Parking Lot	14A	CB 39	27						0.219	0.55	0.55	10.00	0.44	10.44	104.19	57.31		57.31	91.44	21.3	375	0.25	0.802	34.13	37.33%	
East Parking Lot		27	26							0.00	0.67	10.91	1.05	11.97	99.61	66.74		66.74	91.44	50.7	375	0.25	0.802	24.70	27.01%	
East Parking Lot	12	CB 41	28						0.204	0.51	0.51	10.00	0.40	10.40	104.19	53.14		53.14	59.69	19.5	300	0.35	0.818	6.55	10.97%	
East Parking Lot		28	26							0.00	0.51	10.40	1.12	11.51	102.14	52.09		52.09	59.69	54.7	300	0.35	0.818	7.59	12.72%	
East Parking Lot	18	26	23						0.183	0.46	1.64	11.97	1.05	13.02	94.84	155.53		155.53	239.62	51.7	600	0.14	0.821	84.09	35.09%	
East Parking Lot	19	23	22						0.077	0.19	3.43	13.02	0.19	13.20	90.56	310.63		310.63	402.22	9.9	750	0.12	0.882	91.59	22.77%	
East Parking Lot		22	4							0.00	14.24	23.90	0.94	24.85	62.71	892.95	6.00	898.95	1,214.63	89.2	975	0.27	1.576	315.68	25.99%	
East Parking Lot	24A,24B,25,25A,25B	5	4				0.182		0.706	2.12	2.12	10.00	0.86	10.86	104.19	220.89		220.89	257.59	81.3	450	0.75	1.569	36.70	14.25%	
East Parking Lot		4	1							0.00	16.36	24.85	0.10	24.95	61.14	1,000.33	6.00	1006.33	1,259.33	9.8	975	0.29	1.634	253.00	20.09%	
East Parking Lot	21,21A,21B,26	3	2			0.191			0.415	1.36	1.36	10.00	1.25	11.25	104.19	141.70		141.70	200.67	67.4	525	0.20	0.898	58.96	29.38%	
East Parking Lot	22, 23, 23B,23C	2	1			0.141			0.533	1.57	2.93	11.25	1.20	12.45	98.02	287.20		287.20	378.84	93.4	600	0.35	1.298	91.64	24.19%	
East Parking Lot	24	1	OUT				0.122			0.24	19.53	24.95	0.14	25.08	60.98	1,191.02	6.00	1197.02	1,550.65	16.5	975	0.44	2.012	353.64	22.81%	
Designed:	DY		Revised as per SPA April 2019 BUILDINGS 1&2, Pad E CRU B-1/B-2 revision #2 CRU B-1/B-2 revision Pad F revised									Apr 2019 Feb 2017 October 2014 July 2014 Nov 2012			Q = 2.78AIC, where: Q = Peak Flow in Litres per Second (l/s) A = Area in Hectares (ha.) I = Rainfall Intensity in Millimeters per Hour (mm/hr) [I=998.071/(TC+6.053)0.814]						Mannings Coefficient (n) = 0.013					
Checked:			Box C roof directed to infiltration cell 2nd submission Ph 2 to City									June 2012 Feb 27, 2012														
Dwg. Reference:	10113		Revision			Date			Sheet No:																	
			File Ref: 10113 - 5.7.1			Date: 2011-04-19			1 of 1																	



Ponding Data			
Pond ID#	area (m ²)	depth (m)	volume (m ³)
1A	481.00	0.25	40.08
1B	814.00	0.25	67.83
1C	201.00	0.70	46.90
2A	36.00	0.07	0.84
2B	22.00	0.07	0.51
3A	38.00	0.07	0.89
3B	50.00	0.07	1.17
5A	468.00	0.30	46.80
5B	383.00	0.30	38.30
5C	336.00	0.30	33.60
6A	40.00	0.07	0.93
6B	40.00	0.07	0.93

Ponding Data			
Pond ID#	area (m ²)	depth (m)	volume (m ³)
8A	794.17	0.30	79.42
8B	284.43	0.25	23.70
8C	127.03	0.25	10.59
8D	68.25	0.10	2.28
9A	40.00	0.07	0.93
9B	40.00	0.07	0.93
11A	150.00	0.15	7.50
11B	108.00	0.15	5.40
12	990.13	0.25	82.51
14A	1343.36	0.25	111.95
14B	140.66	0.25	11.72
15A	296.00	0.15	14.80
15B	1000.00	0.30	100.00
15C	1055.00	0.30	105.50
15D	1000.00	0.30	100.00


Ponding Data			
Pond ID#	area (m ²)	depth (m)	volume (m ³)
15E	900.00	0.30	90.00
15F	463.98	0.20	30.93
16A	166.37	0.15	8.32
16B	204.14	0.15	10.21
17A	481.30	0.20	32.09
17B	397.16	0.20	26.48
17C	278.03	0.20	18.54
17D	739.91	0.20	49.33
17E	785.48	0.20	52.37
17F	369.62	0.20	24.64
18A	156.00	0.25	13.00
18B	156.00	0.25	13.00

Ponding Data			
Pond ID#	area (m ²)	depth (m)	volume (m ³)
19A	155.56	0.25	12.96
19B	187.08	0.25	15.59
20A	217.96	0.20	14.53
20D	468.54	0.20	31.24
20B	2029.44	0.25	169.12
20C	523.33	0.20	34.89
21	191.58	0.25	15.97
21A	60.88	0.23	4.67
22	360.00	0.25	30.00
23	562.42	0.25	46.87
23B	535.86	0.30	53.59
23C	558.21	0.30	55.82

Ponding Data			
Pond ID#	area (m ²)	depth (m)	volume (m ³)
24	489.88	0.25	40.82
24A	74.40	0.30	7.44
25	584.32	0.17	33.11
25A	121.23	0.30	12.12
26	226.00	0.23	17.33

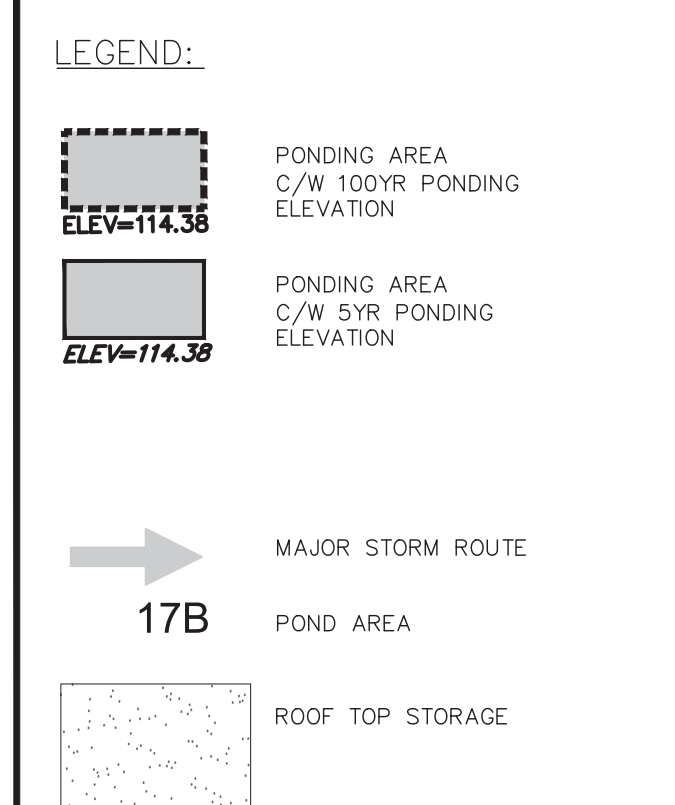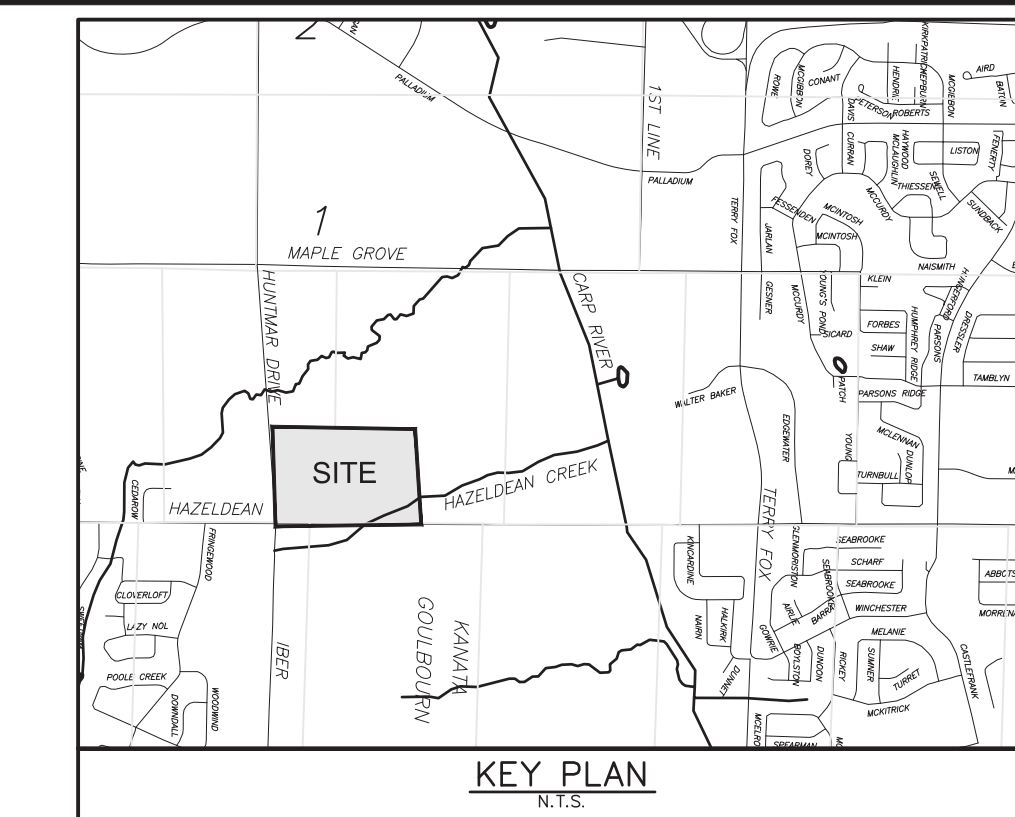

5 Year Ponding Data			
Pond ID#	area (m ²)	depth (m)	volume (m ³)
1A	277.44	0.17	15.72
1B	453.56	0.17	25.70
1C	51.30	0.62	10.60
2A	36.00	0.07	0.84
2B	22.00	0.07	0.51
3A	38.00	0.07	0.89
3B	50.00	0.07	1.17
5A	228.04	0.24	18.24
5B	245.31	0.24	19.62
5C	96.65	0.14	4.51
6A	40.00	0.07	0.93
6B	40.00	0.07	0.93
8A	438.40	0.20	29.23
8B	153.16	0.18	9.19
8C	44.91	0.15	2.25
9A	40.00	0.07	0.93
9B	40.00	0.07	0.93
11A	134.63	0.13	5.83
11B	85.33	0.13	3.70
12	536.13	0.18	32.17
14A	665.69	0.18	39.94
14B	91.87	0.18	5.51
15A	62.14	0.22	1.45
15B	644.98	0.22	47.30
15C	696.50	0.22	51.08
15D	538.48	0.22	39.49
15E	603.30	0.22	44.24
15F	253.74	0.12	10.15
16A	135.45	0.13	5.87
16B	163.52	0.13	7.09
17A	220.60	0.15	11.03
17B	188.99	0.15	9.45
17C	111.16	0.15	5.56
17D	358.98	0.15	17.95
17E	350.76	0.15	17.54
17F	173.44	0.15	8.67
18A	115.03	0.14	5.37
18B	94.54	0.14	4.41
19A	66.62	0.14	3.11
19B	80.81	0.14	3.77
20A	88.84	0.13	3.31
20B	1184.13	0.18	71.05
20C	278.87	0.13	12.08
20D	210.89	0.13	9.14
21	191.58	0.25	15.97
21A	35.32	0.15	1.77
22	286.07	0.23	21.93
23	172.34	0.15	8.62
23B	304.74	0.21	21.33
23C	305.35	0.21	21.37
24	49.05	0.07	1.14
24A	33.91	0.16	1.81
25	234.71	0.11	8.61
25A	58.10	0.20	3.87
26	132.00	0.17	7.48

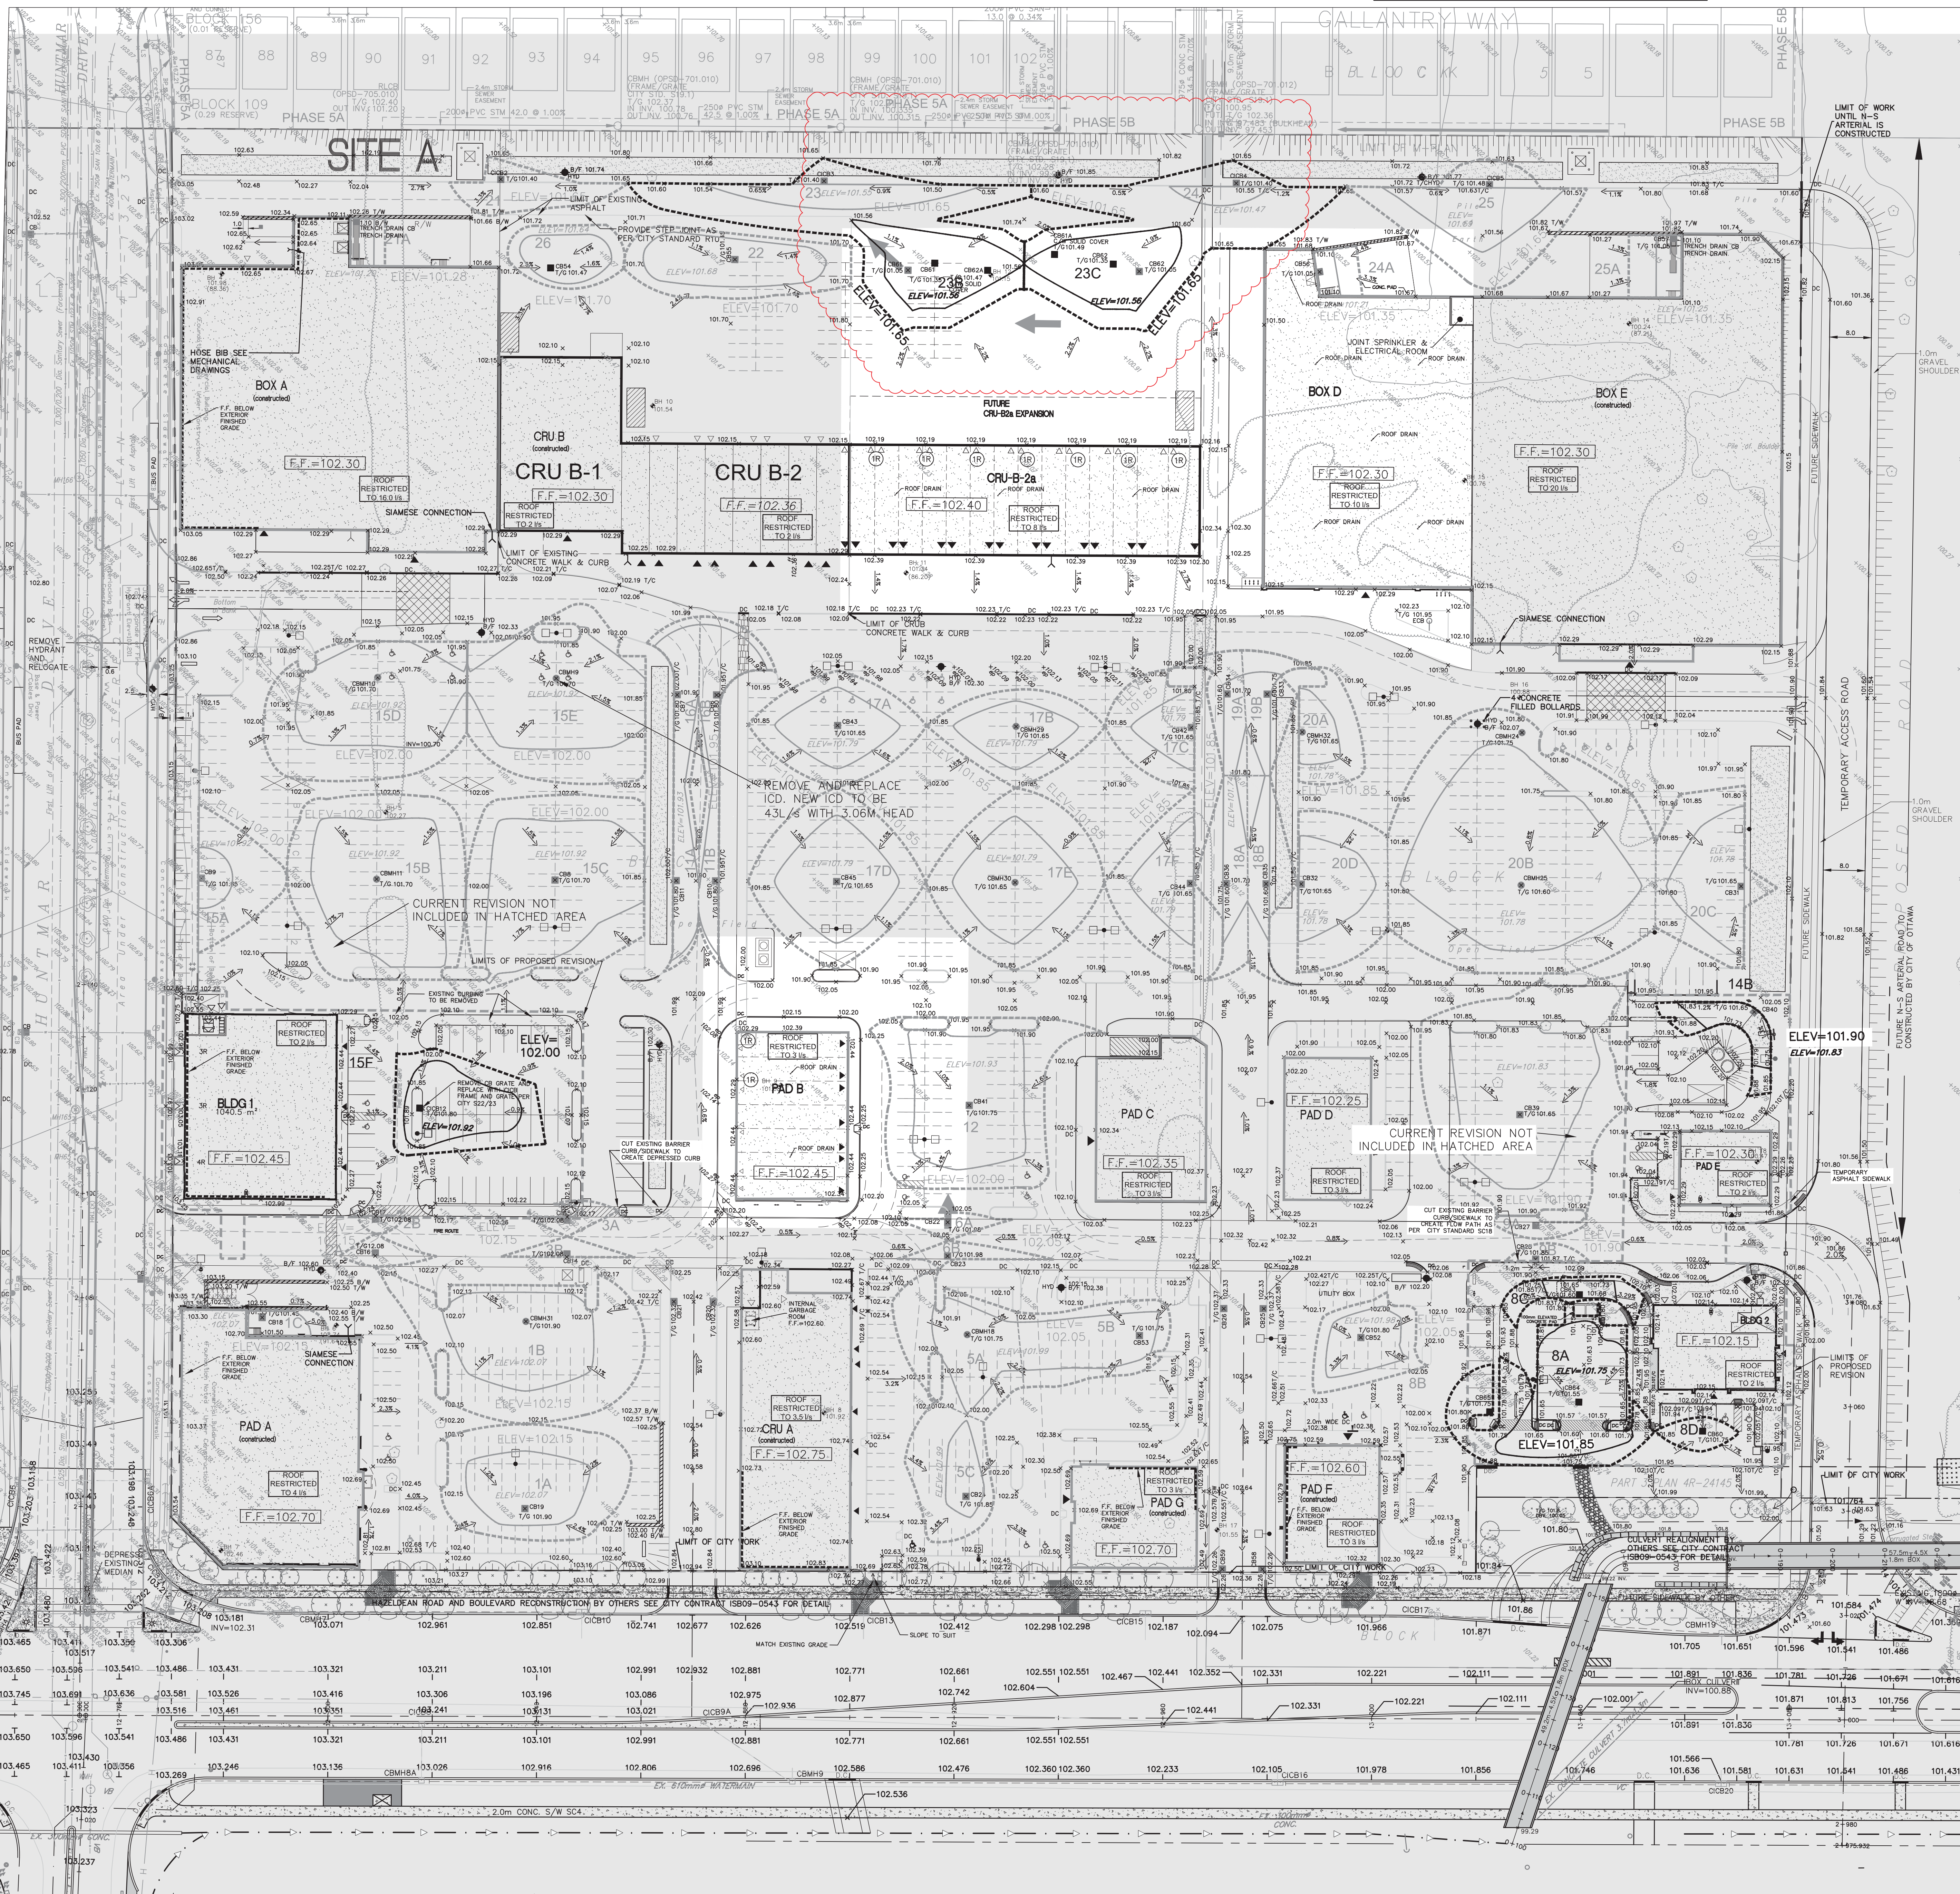

No.	REVISIONS	By	Date
24	REVISED 'STORAGE' CELLS PER	DCY	20.05.15
23	REVISED AS PER CITY COMMENTS	DCY	20.04.30
22	REVISED AS PER CITY COMMENTS	DCY	20.03.27
21	REVISED AS PER CITY COMMENTS	DCY	19.12.20
20	REVISED SPA CRU B-3, PAD B, BOX D	DCY	19.08.29
19	ISSUED FOR CONSTRUCTION	DCY	18.04.06
18	ISSUED FOR TENDER	DCY	18.01.15
17	REVISED AS PER CITY COMMENTS	DCY	17.11.23
16	ISSUED FOR SPA	DCY	17.11.02
15	REVISED AS PER SITE PLAN	DCY	17.07.07
14	REVISED AS PER CITY COMMENTS	DCY	17.06.23
13	REVISED BLD 2 & PAD E	DCY	17.02.14
12	REVISED AS PER CITY COMMENTS	DCY	16.08.02
11	SPA BLDG 1 & 2	DCY	16.03.07
10	REVISED AS PER SITE PLAN	DCY	14.11.03
9	SPA	DCY	14.09.09
8	REVISED AS PER SITE PLAN	DCY	14.08.08
7	REVISED AS PER CITY COMMENTS	DCY	14.07.31
6	REVISED DOLLAR & CRU B	DCY	14.06.03
5	REVISED FOR PAD F	DCY	12.11.16
4	REVISED SPRINKLER ROOM	DCY	12.03.09
3	REVISED PER CITY COMMENTS AND PAD E	DCY	12.02.22
2	REVISED SITE PLAN PH1 & PH2	DCY	11.11.24
1	ISSUED FOR APPROVAL	DCY	11.10.27

NORTH AMERICAN DEVELOPMENT GROUP

333 Preston Street
Tower 1, Suite 400
Ottawa, Ontario
Canada K1S 5N4
Tel: (613) 225-1311
Fax: (613) 225-9868

Project Title: **NORTH AMERICAN HAZELDEAN & HUNTMAR OTTAWA, ONT.**




IBI GROUP

Professional Engineer
No. 20200015
Province of Ontario


PONDING PLAN PHASE 1 & 2

Scale: 1:500

Design	D.G.Y.	Date	OCTOBER 2011
Drawn	E.H.	Checked	D.G.Y.
Project No.	10113	Drawing No.	C-402

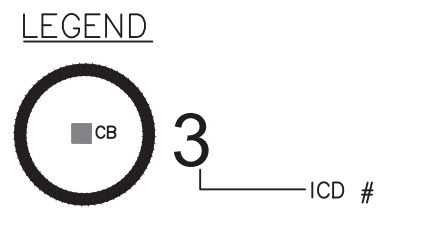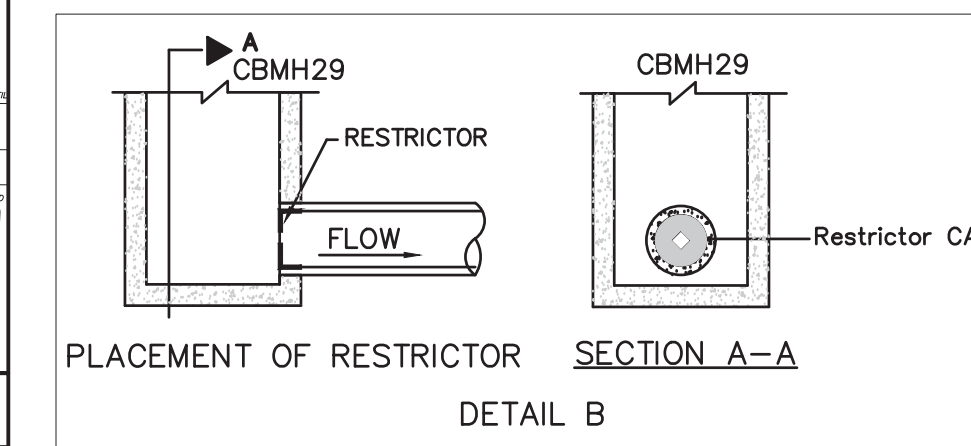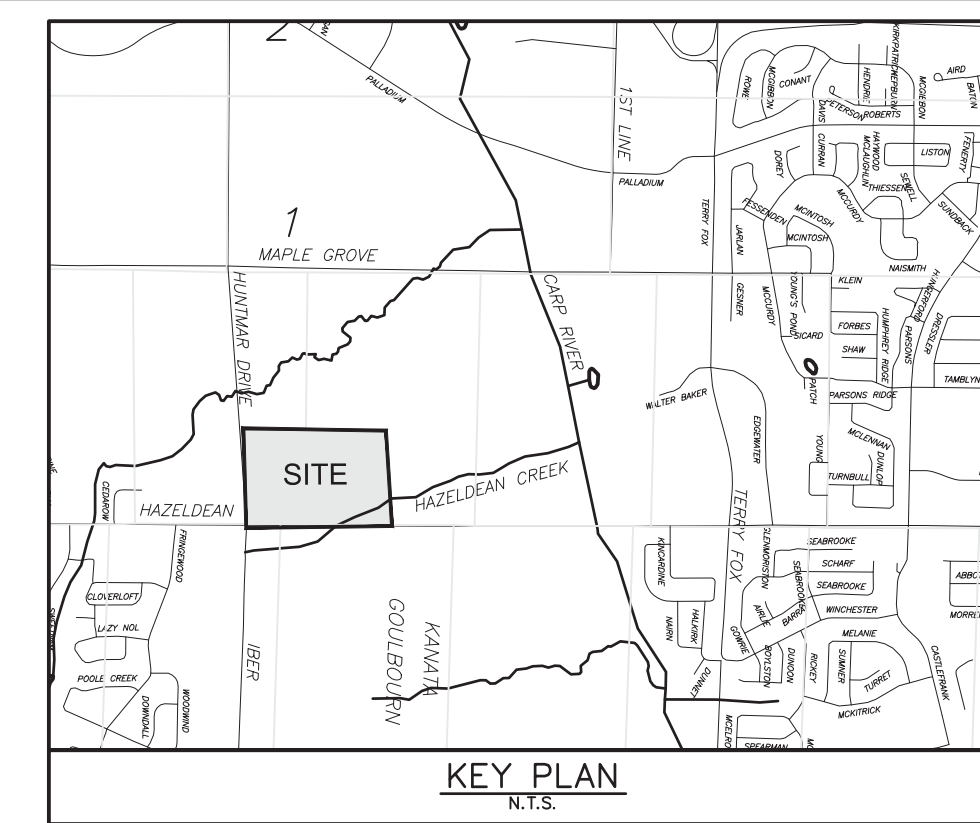

ICD#	ICD TYPE
1	HYDROVEX 125MM
2	21.0 I/P @ 2.57M HEAD
3	HYDROVEX 100MM
4	11.0 I/P @ 1.50M HEAD
5	HYDROVEX 100MM
6	11.0 I/P @ 1.50M HEAD
7	HYDROVEX 100MM
8	11.0 I/P @ 1.50M HEAD
9	HYDROVEX 100MM
10	11.0 I/P @ 1.50M HEAD
11	HYDROVEX 100MM
12	11.0 I/P @ 1.50M HEAD
13	HYDROVEX 100MM
14	11.0 I/P @ 1.50M HEAD
15	HYDROVEX 100MM
16	11.0 I/P @ 1.50M HEAD
17	HYDROVEX 100MM
18	11.0 I/P @ 1.50M HEAD
19	HYDROVEX 100MM
20	11.0 I/P @ 1.50M HEAD
21	HYDROVEX 100MM
22	11.0 I/P @ 1.50M HEAD
23	HYDROVEX 100MM
24	11.0 I/P @ 1.50M HEAD
25	HYDROVEX 100MM
26	11.0 I/P @ 1.50M HEAD

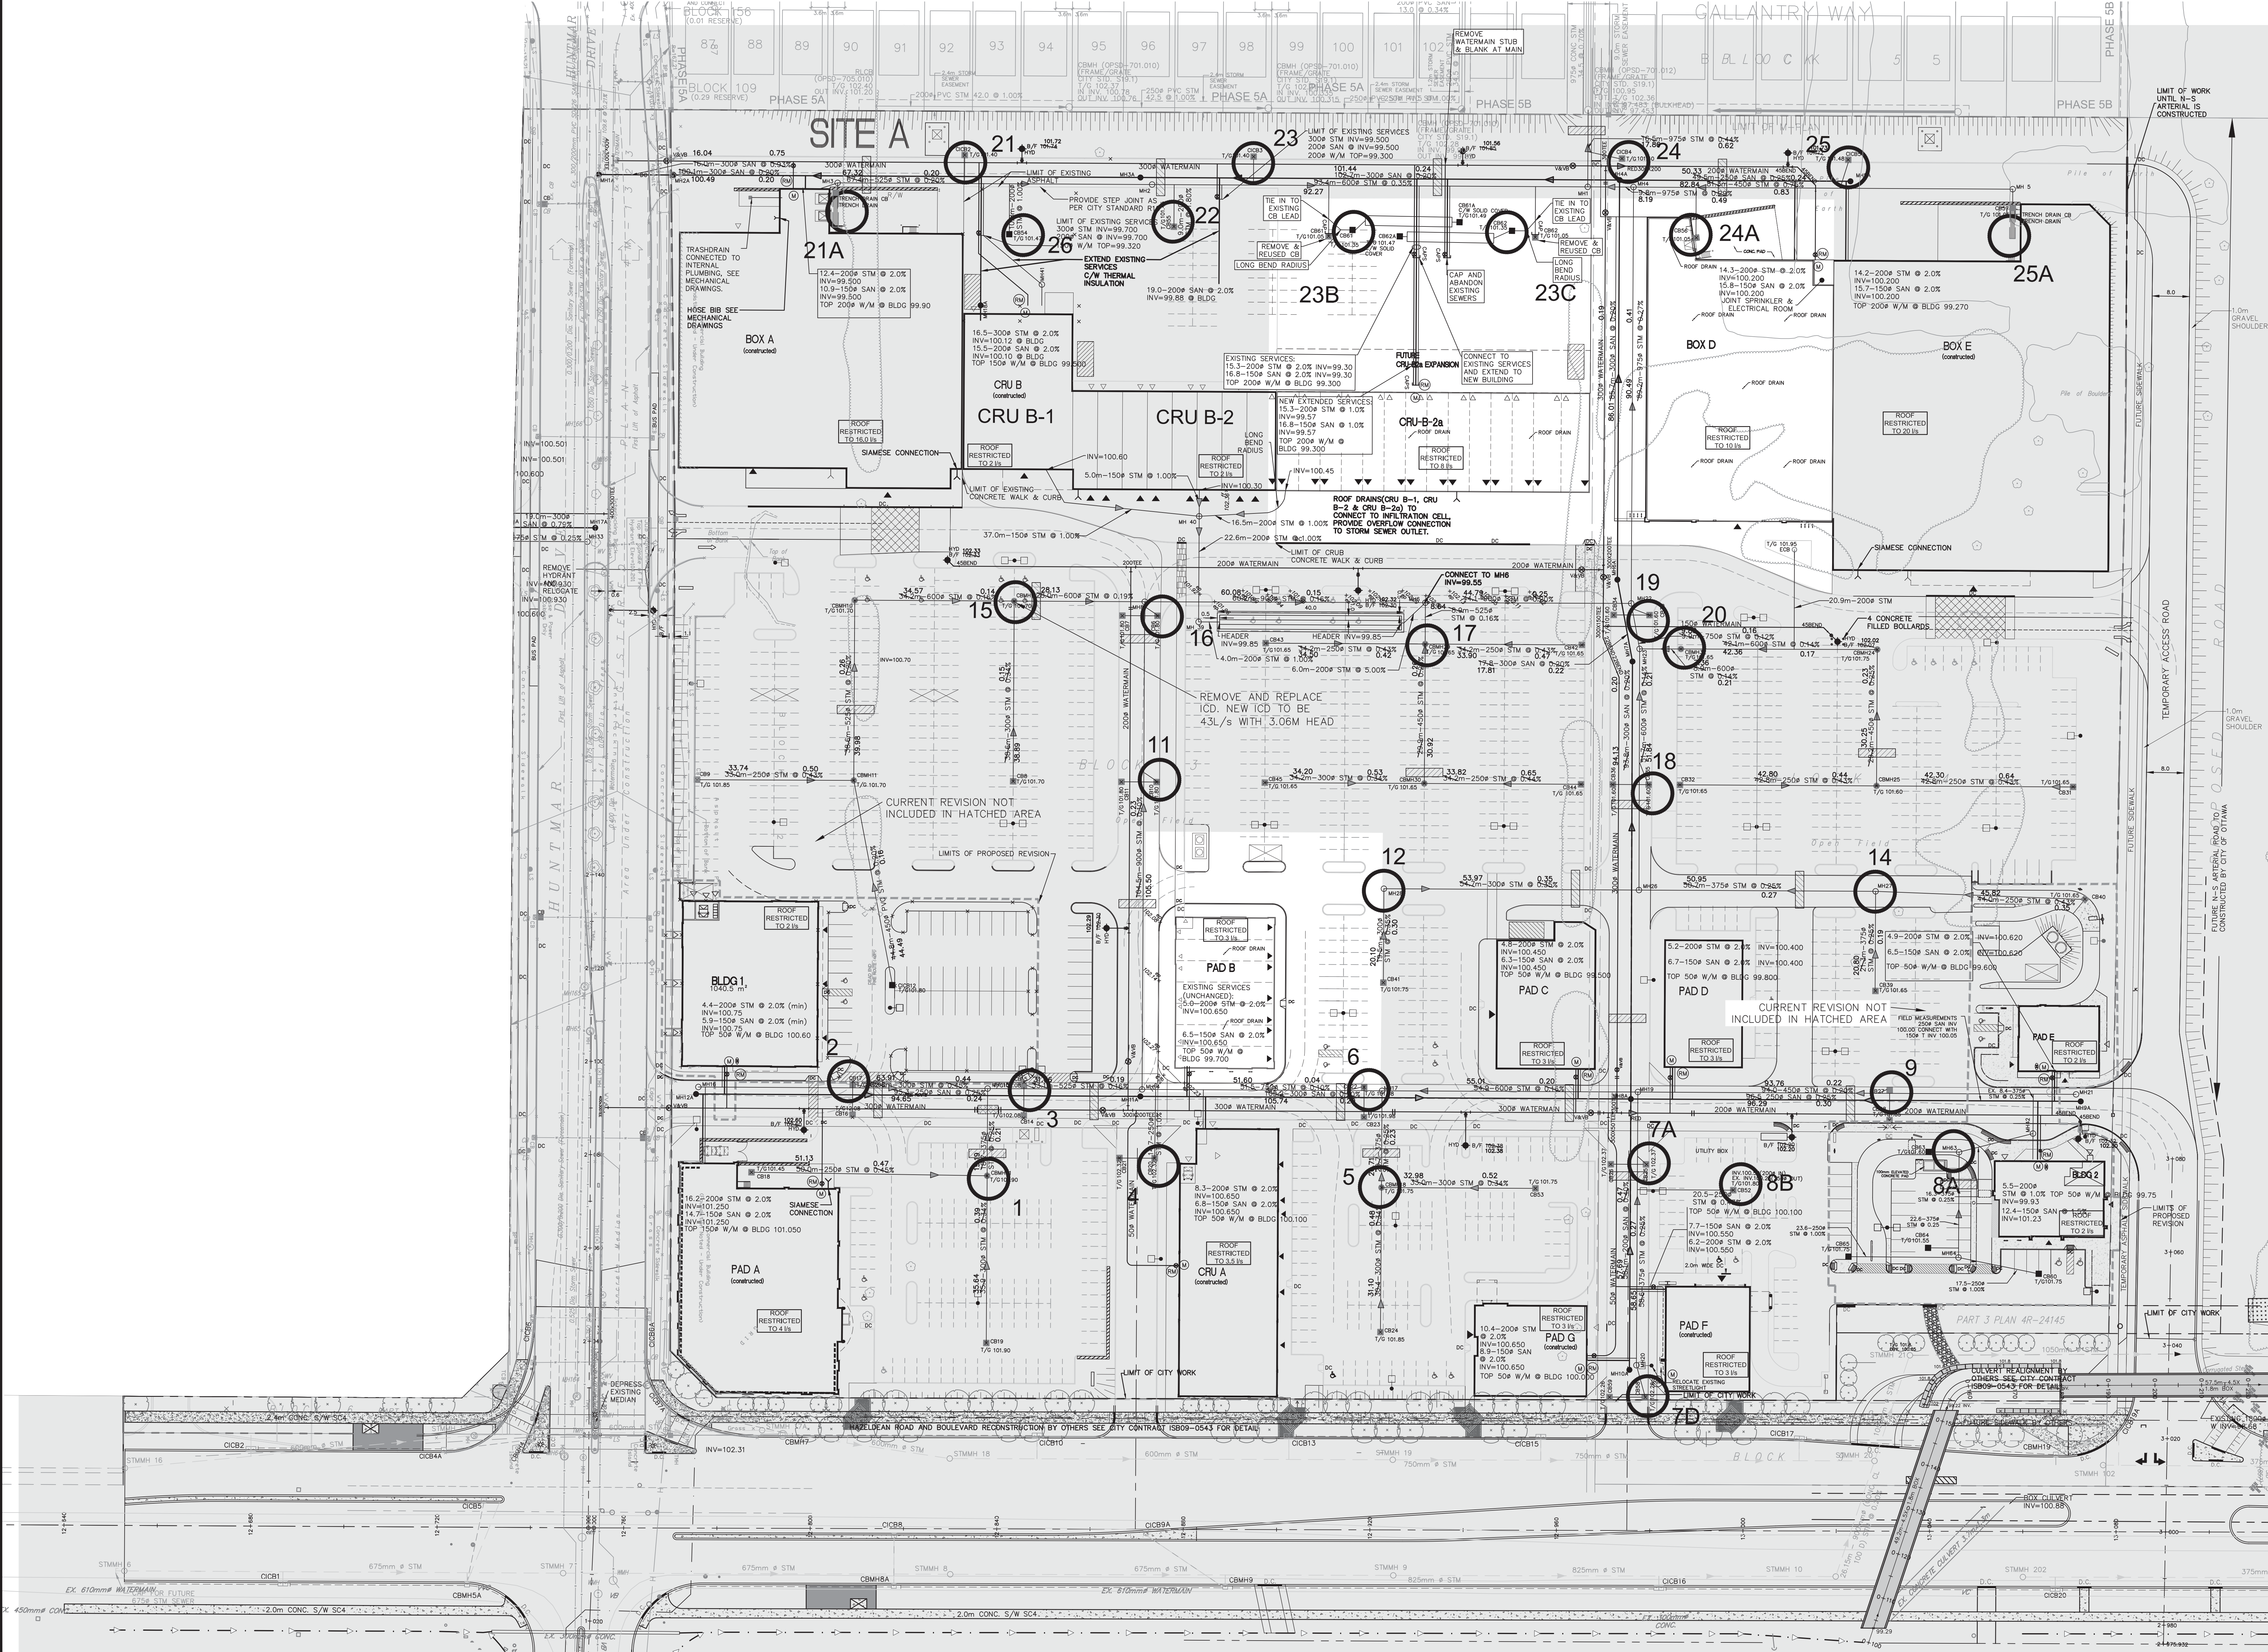

No.	REVISIONS	By	Date
25	REVISED STORAGE CELLS PER	DOY	20:05:15
24	REVISED AS PER CITY	DOY	20:04:30
23	REVISED AS PER CITY	DOY	20:03:37
22	REVISED AS PER CITY	DOY	19:12:20
21	ISSUED FOR CONSTRUCTION	DOY	19:08:29
20	ISSUED FOR TENDER	DOY	18:04:06
19	ISSUED FOR SPA	DOY	18:01:15
18	REVISED AS PER CITY COMMENTS	DOY	17:11:23
17	ISSUED FOR SPA	DOY	17:11:02
16	REVISED AS PER SITE PLAN	DOY	17:07:07
15	REVISED AS PER CITY COMMENTS	DOY	17:06:23
14	REVISED BLD 2 & PAD E	DOY	17:02:14
13	REVISED AS PER CITY COMMENTS	DOY	16:08:02
12	SPA BLD 1 & 2	DOY	16:03:07
11	REVISED AS PER SITE PLAN	DOY	14:11:03
10	SPA	DOY	14:09:09
9	REVISED AS PER SITE PLAN	DOY	14:06:08
8	REVISED AS PER CITY COMMENTS	DOY	14:07:31
7	REVISED DOLLAR & CRUB	DOY	14:06:03
6	REVISED FOR PAD F	DOY	12:11:16
5	REVISED SPRINKLER ROOM	DOY	12:03:09
4	REVISED PER CITY COMMENTS AND PAD	DOY	12:02:32
3	REVISED FOR BOX E	DOY	12:01:28
2	REVISED SITE PLAN PH1 & PH2	DOY	11:11:24
1	ISSUED FOR APPROVAL	DOY	11:10:27

NORTH AMERICAN DEVELOPMENT GROUP

IBI GROUP
 333 Preston Street
 Tower 1, Suite 400
 Ottawa, Ontario
 Canada K1S 5M4
 Tel: (613)225-1311
 Fax: (613)225-9868

Project Title
5705 HAZELDEAN ROAD
OTTAWA, ONT.

ICD PLAN
 PHASE 1 & 2

Scale
 1:500

Design
 D.G.Y. Date
 OCTOBER 2011

Drawn
 E.H. Checked
 D.G.Y.

Project No.
 10113 Drawing No.
 C-802



RD-100

**Large Capacity
Roof Drain**

Tag: _____


Components:



SPECIFICATION: Watts Drainage Products RD-100 epoxy coated cast iron roof drain with deep sump, wide serrated flashing flange, flashing clamp device with integral gravel stop and self-locking polyethylene (standard) dome strainer.

Order Code: RD-100-____-____-____

Ex. RD-102P-K

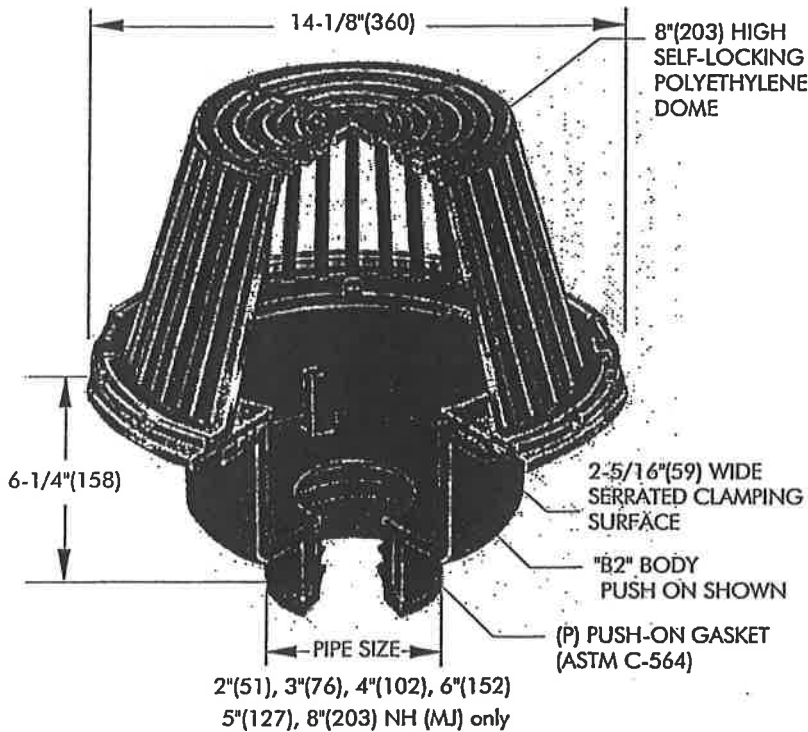

Size	Description	
2	2"(51) Pipe Size	<input type="checkbox"/>
3	3"(76) Pipe Size	<input type="checkbox"/>
4	4"(102) Pipe Size	<input type="checkbox"/>
5	5"(127) Pipe Size	<input type="checkbox"/>
6	6"(152) Pipe Size	<input type="checkbox"/>
8	8"(203) Pipe Size	<input type="checkbox"/>

Code	Description	
NH	No Hub (MJ)	<input type="checkbox"/>
P	Push On	<input type="checkbox"/>
T	Threaded Outlet	<input type="checkbox"/>
X	Inside Caulk	<input type="checkbox"/>

Code	Description	
-A	Accutrol weir (specify # 1-6 slots)	<input type="checkbox"/>
-B	Sump Receiver Flange	<input type="checkbox"/>
-BED	Sump Receiver, Adj Ext., Deck Clamp	<input type="checkbox"/>
-C	Secondary Membrane Clamp	<input type="checkbox"/>
-D	Underdeck Clamp	<input type="checkbox"/>
-E	Adjustable Extension	<input type="checkbox"/>
-GSS	Stainless Steel Ballast Guard	<input type="checkbox"/>
-H	Adj. to 6" IRMA Ballast Guard	<input type="checkbox"/>
-K	Ductile Iron Dome	<input type="checkbox"/>
-K80	Aluminum Dome	<input type="checkbox"/>
-L	Vandal Proof Dome	<input type="checkbox"/>
-R	2" High External Water Dam	<input type="checkbox"/>
-SO	Side Outlet**	<input type="checkbox"/>
-V	Fixed Extension (1-1/2", 2", 3", 4")	<input type="checkbox"/>
-W	Adj. Water Level Regulator	<input type="checkbox"/>
-W-1	Waterproofing Flange	<input type="checkbox"/>
-Z	Extended Integral Wide Flange	<input type="checkbox"/>
-5	Sediment Bucket	<input type="checkbox"/>
-12	Galvanized Dome	<input type="checkbox"/>
-13	All Galvanized	<input type="checkbox"/>
-83	Mesh Covered Dome	<input type="checkbox"/>
-113M	Special Epoxy from 3M Range	<input type="checkbox"/>

Code	Description	
-60	PVC Body w/Socket Outlet	<input type="checkbox"/>
-61	ABS Body w/Socket Outlet	<input type="checkbox"/>

** Side Outlet (-SO) option only available in 2"(51), 3"(76), 4"(102) pipe sizes. Underdeck Clamp (-BED and -D options) are not available when -SO is selected.

Job Name _____ Contractor _____

Job Location _____ Contractor's P.O. No. _____

Engineer _____ Representative _____

WATTS Drainage reserves the right to modify or change product design or construction without prior notice and without incurring any obligation to make similar changes and modifications to products previously or subsequently sold. See your WATTS Drainage representative for any clarification. Dimensions are subject to manufacturing tolerances.



CANADA: 5435 North Service Road, Burlington, ON, L7L 5H7 TEL: 905-332-6718 TOLL-FREE: 1-888-208-8927 Website: www.wattsdrainage.ca





Adjustable Accutrol Weir

Tag: _____

Adjustable Flow Control
for Roof Drains

ADJUSTABLE ACCUTROL (for Large Sump Roof Drains only)

For more flexibility in controlling flow with heads deeper than 2", Watts Drainage offers the Adjustable Accutrol. The Adjustable Accutrol Weir is designed with a single parabolic opening that can be covered to restrict flow above 2" of head to less than 5 gpm per inch, up to 6" of head. To adjust the flow rate for depths over 2" of head, set the slot in the adjustable upper cone according to the flow rate required. Refer to Table 1 below.

Note: Flow rates are directly proportional to the amount of weir opening that is exposed.

EXAMPLE:

For example, if the adjustable upper cone is set to cover 1/2 of the weir opening, flow rates above 2" of head will be restricted to 2-1/2 gpm per inch of head.

Therefore, at 3" of head, the flow rate through the Accutrol Weir that has 1/2 the slot exposed will be:
[5 gpm(per inch of head) x 2 inches of head] + 2-1/2 gpm(for the third inch of head) = 12-1/2 gpm.

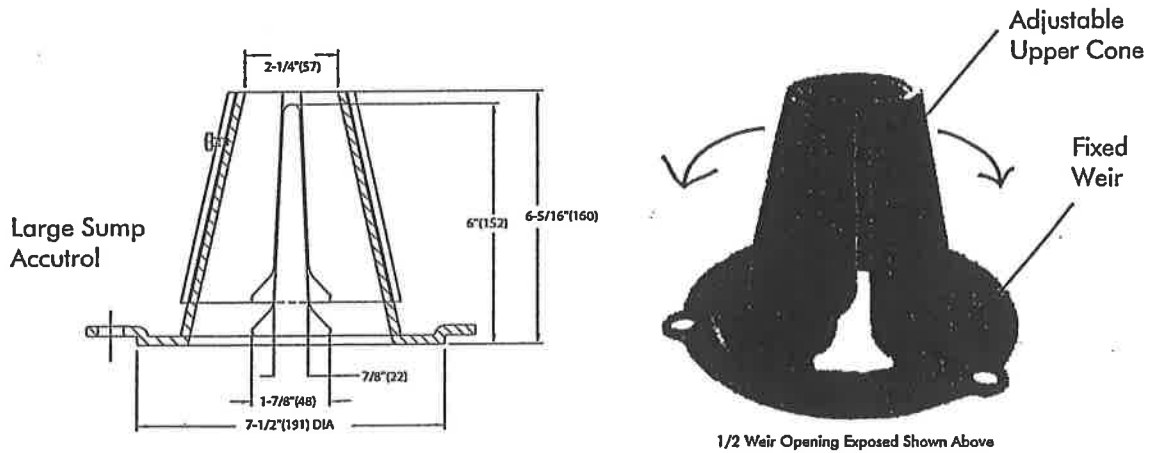


TABLE 1. Adjustable Accutrol Flow Rate Settings

Weir Opening Exposed	Head of Water					
	1"	2"	3"	4"	5"	6"
	Flow Rate (gallons per minute)					
Fully Exposed	5	10	15	20	25	30
3/4	5	10	13.75	17.5	21.25	25
1/2	5	10	12.5	15	17.5	20
1/4	5	10	11.25	12.5	13.75	15
Closed	5	10	10	10	10	10

Job Name _____ Contractor _____

Job Location _____ Contractor's P.O. No. _____

Engineer _____ Representative _____

WATTS Drainage reserves the right to modify or change product design or construction without prior notice and without incurring any obligation to make similar changes and modifications to products previously or subsequently sold. See your WATTS Drainage representative for any clarification. Dimensions are subject to manufacturing tolerances.



CANADA: 5435 North Service Road, Burlington, ON, L7L 5H7 TEL: 905-332-6718 TOLL-FREE: 1-888-208-8927 Website: www.wattsdrainage.ca





IBI
333 Preston St
OTTAWA, ONTARIO
K1S 5N4

ONSITE SWM 5yr design
PROJECT: HUNTMAR PLAZA
CITY OF OTTAWA
DEVELOPER : NORTH AMERICAN

PAGE:
JOB #: 10113
DATE: 10/30/2014
DESIGN: DY
Rev#5 BLD 1&2, Pad E

LANDS EAST OF HUNTMAR DR Phase 1 & 2, 5yr design

MAXIMUM ALLOWABLE FLOW - Flow Restricted to 85 l/s/Ha

Time of concentration = 10 minutes

Area (ha) =	8.297
C Average =	0.88

Intensity - 5 year event storm

10 min Tc	$i_{5yr} = 998.071 / (T + 6.053)^{0.814} =$	104.2	mm/hr
-----------	---------------------------------------------	-------	-------

Unrestricted Flowrate (Q5)

10 min Tc	$Q_{pre-devo} = 2.78 * A * Cw^i =$	2114.94	l/s
-----------	------------------------------------	---------	-----

Restricted Flowrate (Q5)

10 min Tc	$Q = 85 \text{ l/s/Ha}$	705.26	l/s
-----------	-------------------------	--------	-----

Intensity - 100 year event storm

10 min Tc	$i_{100yr} = 1735.688 / (T + 6.014)^{0.82} =$	178.6	mm/hr
-----------	-----------------------------------------------	-------	-------

Unrestricted Flowrate (Q100)

10 min Tc	$Q_{post-devo} = 2.78 * A * Cw^i =$	3624.44	l/s
-----------	-------------------------------------	---------	-----

Restricted Flowrate (Q5)

10 min Tc	$Q = 85 \text{ l/s/Ha}$	705.26	l/s
-----------	-------------------------	--------	-----

STORM WATER MANAGEMENT - Post-Development Controlled

(5 year post-development with 100yr inlets)

ROOF AREA # Box A (21B)

3260 sm
5 -YR FLOW
Qp (l/s)

Area(ha)=	0.3260	STORMWATER MANAGEMENT Qm =				16.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
20	70.3	57.3	16.00	41.3	49.56	
22	66.1	54.0	16.00	38.0	50.10	
24	62.5	51.0	16.00	35.0	50.42	
26	59.3	48.4	16.00	32.4	50.55	<=== Required volume for roof storage
28	56.5	46.1	16.00	30.1	50.53	
30	53.9	44.0	16.00	28.0	50.38	
32	51.6	42.1	16.00	26.1	50.10	
34	49.5	40.4	16.00	24.4	49.73	
36	47.6	38.8	16.00	22.8	49.26	
38	45.8	37.4	16.00	21.4	48.71	
40	44.2	36.0	16.00	20.0	48.09	
42	42.7	34.8	16.00	18.8	47.41	

Req. Storage volume 50.55 m3
Average depth 0.016 m

ROOF AREA # CRU B-3 (23A)
1490 sm
5 -YR FLOW
Qp (l/s)

Updated March 2019

Area(ha)=	0.1490	STORMWATER MANAGEMENT Qm =				4.00 l/s
Cw =	0.90					
Tc		Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i				
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
42	42.7	15.9	4.00	11.9	30.02	
44	41.3	15.4	4.00	11.4	30.08	
46	40.0	14.9	4.00	10.9	30.11	
48	38.8	14.5	4.00	10.5	30.12	
50	37.7	14.0	4.00	10.0	30.11	
52	36.6	13.6	4.00	9.6	30.08	
54	35.6	13.3	4.00	9.3	30.04	
56	34.7	12.9	4.00	8.9	29.98	
58	33.8	12.6	4.00	8.6	29.90	
60	32.9	12.3	4.00	8.3	29.81	
62	32.2	12.0	4.00	8.0	29.71	
64	31.4	11.7	4.00	7.7	29.60	

<=== Required volume for roof storage

Req. Storage volume 30.12 m3
Average depth 0.020 m

ROOF AREA -- OBSOLETE --
0 sm
5 -YR FLOW
Qp (l/s)

Updated March 2019

Area(ha)=	0.0000	STORMWATER MANAGEMENT Qm =				0.00 l/s
Cw =	0.00					
Tc		Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i				
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
26	59.0	0.0	0.00	0.0	0.00	
28	56.5	0.0	0.00	0.0	0.00	
30	53.9	0.0	0.00	0.0	0.00	
32	51.6	0.0	0.00	0.0	0.00	
34	49.5	0.0	0.00	0.0	0.00	
36	47.6	0.0	0.00	0.0	0.00	
38	45.8	0.0	0.00	0.0	0.00	
40	44.2	0.0	0.00	0.0	0.00	
42	42.7	0.0	0.00	0.0	0.00	
44	41.3	0.0	0.00	0.0	0.00	
46	40.0	0.0	0.00	0.0	0.00	
48	38.8	0.0	0.00	0.0	0.00	

<=== Required volume for roof storage

Req. Storage volume 0.00 m3
Average depth #DIV/0! m

ROOF AREA # Box D (24B)
2320 sm
5 -YR FLOW
Qp (l/s)

Area(ha)=	0.2320	STORMWATER MANAGEMENT Qm =				10.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
24	62.5	36.3	10.00	26.3	37.88	
26	59.3	34.4	10.00	24.4	38.14	
28	56.5	32.8	10.00	22.8	38.29	
30	53.9	31.3	10.00	21.3	38.35	
32	51.6	30.0	10.00	20.0	38.32	
34	49.5	28.7	10.00	18.7	38.22	
36	47.6	27.6	10.00	17.6	38.05	
38	45.8	26.6	10.00	16.6	37.83	
40	44.2	25.6	10.00	15.6	37.55	
42	42.7	24.8	10.00	14.8	37.23	
44	41.3	24.0	10.00	14.0	36.87	
46	40.0	23.2	10.00	13.2	36.47	

<=== Required volume for roof storage

Req. Storage volume 38.35 m3
Average depth 0.017 m

ROOF AREA # Box E (25B)
4260 sm
5 -YR FLOW
Qp (l/s)

Area(ha)=	0.4260	STORMWATER MANAGEMENT Qm =				20.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
22	66.1	70.5	20.00	50.5	66.66	
24	62.5	66.7	20.00	46.7	67.19	
26	59.3	63.3	20.00	43.3	67.47	
28	56.5	60.2	20.00	40.2	67.56	
30	53.9	57.5	20.00	37.5	67.46	
32	51.6	55.0	20.00	35.0	67.21	
34	49.5	52.8	20.00	32.8	66.83	
36	47.6	50.7	20.00	30.7	66.33	
38	45.8	48.8	20.00	28.8	65.73	
40	44.2	47.1	20.00	27.1	65.03	
42	42.7	45.5	20.00	25.5	64.24	
44	41.3	44.0	20.00	24.0	63.38	

<=== Required volume for roof storage

Req. Storage volume 67.56 m3
Average depth 0.016 m

ROOF AREA # CRU A (6D)
1200 sm
5 -YR FLOW
Qp (l/s)

Area(ha)=	0.1200	STORMWATER MANAGEMENT Qm =				3.50 l/s
Cw =	0.90					
Tc		Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i				
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
39	45.0	13.5	3.50	10.0	23.41	
41	43.4	13.0	3.50	9.5	23.46	
43	42.0	12.6	3.50	9.1	23.48	
45	40.6	12.2	3.50	8.7	23.49	
47	39.4	11.8	3.50	8.3	23.47	
49	38.2	11.5	3.50	8.0	23.44	
51	37.1	11.1	3.50	7.6	23.39	
53	36.1	10.8	3.50	7.3	23.33	
55	35.1	10.5	3.50	7.0	23.25	
57	34.2	10.3	3.50	6.8	23.16	
59	33.4	10.0	3.50	6.5	23.06	
61	32.5	9.8	3.50	6.3	22.95	

<=== Required volume for roof storage

Req. Storage volume 23.49 m3
Average depth 0.020 m

ROOF AREA # CRU B-2 (22A)
920 sm
5 -YR FLOW
Qp (l/s)

Area(ha)=	0.0920	STORMWATER MANAGEMENT Qm =				2.00 l/s
Cw =	0.90					
Tc		Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i				
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
52	36.6	8.4	2.00	6.4	20.04	
54	35.6	8.2	2.00	6.2	20.07	
56	34.7	8.0	2.00	6.0	20.09	
58	33.8	7.8	2.00	5.8	20.10	
60	32.9	7.6	2.00	5.6	20.10	
62	32.2	7.4	2.00	5.4	20.09	
64	31.4	7.2	2.00	5.2	20.08	
66	30.7	7.1	2.00	5.1	20.06	
68	30.0	6.9	2.00	4.9	20.03	
70	29.4	6.8	2.00	4.8	20.00	
72	28.8	6.6	2.00	4.6	19.96	
74	28.2	6.5	2.00	4.5	19.91	

<=== Required volume for roof storage

Req. Storage volume 20.10 m3
Average depth 0.022 m

ROOF AREA # CRU B-1 (26A)
830 sm
5 -YR FLOW
Qp (l/s)

Area(ha)=	0.0830	STORMWATER MANAGEMENT Qm =				2.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
45	40.6	8.4	2.00	6.4	17.38	
47	39.4	8.2	2.00	6.2	17.42	
49	38.2	7.9	2.00	5.9	17.45	
51	37.1	7.7	2.00	5.7	17.47	<=== Required volume for roof storage
53	36.1	7.5	2.00	5.5	17.47	
55	35.1	7.3	2.00	5.3	17.47	
57	34.2	7.1	2.00	5.1	17.46	
59	33.4	6.9	2.00	4.9	17.44	
61	32.5	6.8	2.00	4.8	17.41	
63	31.8	6.6	2.00	4.6	17.38	
65	31.0	6.4	2.00	4.4	17.34	
67	30.4	6.3	2.00	4.3	17.30	

Req. Storage volume 17.47 m3
Average depth 0.021 m

ROOF AREA # Pad A (2B)
1570 sm
5 -YR FLOW
Qp (l/s)

Area(ha)=	0.1570	STORMWATER MANAGEMENT Qm =				4.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
45	40.6	16.0	4.00	12.0	32.29	
47	39.4	15.5	4.00	11.5	32.34	
49	38.2	15.0	4.00	11.0	32.37	
51	37.1	14.6	4.00	10.6	32.37	<=== Required volume for roof storage
53	36.1	14.2	4.00	10.2	32.36	
55	35.1	13.8	4.00	9.8	32.33	
57	34.2	13.4	4.00	9.4	32.28	
59	33.4	13.1	4.00	9.1	32.22	
61	32.5	12.8	4.00	8.8	32.15	
63	31.8	12.5	4.00	8.5	32.06	
65	31.0	12.2	4.00	8.2	31.96	
67	30.4	11.9	4.00	7.9	31.85	

Req. Storage volume 32.37 m3
Average depth 0.021 m

ROOF AREA # Pad B (6C)
620 sm
5 -YR FLOW
Qp (l/s)

Updated March 2019

Area(ha)=	0.0620	STORMWATER MANAGEMENT Qm =				3.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
20	70.3	10.9	3.00	7.9	9.48	
22	66.1	10.3	3.00	7.3	9.58	
24	62.5	9.7	3.00	6.7	9.65	
26	59.3	9.2	3.00	6.2	9.68	
28	56.5	8.8	3.00	5.8	9.68	
30	53.9	8.4	3.00	5.4	9.66	
32	51.6	8.0	3.00	5.0	9.61	
34	49.5	7.7	3.00	4.7	9.54	
36	47.6	7.4	3.00	4.4	9.46	
38	45.8	7.1	3.00	4.1	9.36	
40	44.2	6.9	3.00	3.9	9.25	
42	42.7	6.6	3.00	3.6	9.12	

<=== Required volume for roof storage

Req. Storage volume **9.68** m3
Average depth **0.016** m

ROOF AREA # Pad C (6B)
620 sm
5 -YR FLOW
Qp (l/s)

Area(ha)=	0.0620	STORMWATER MANAGEMENT Qm =				3.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
20	70.3	10.9	3.00	7.9	9.48	
22	66.1	10.3	3.00	7.3	9.58	
24	62.5	9.7	3.00	6.7	9.65	
26	59.3	9.2	3.00	6.2	9.68	
28	56.5	8.8	3.00	5.8	9.68	
30	53.9	8.4	3.00	5.4	9.66	
32	51.6	8.0	3.00	5.0	9.61	
34	49.5	7.7	3.00	4.7	9.54	
36	47.6	7.4	3.00	4.4	9.46	
38	45.8	7.1	3.00	4.1	9.36	
40	44.2	6.9	3.00	3.9	9.25	
42	42.7	6.6	3.00	3.6	9.12	

<=== Required volume for roof storage

Req. Storage volume **9.68** m3
Average depth **0.016** m

ROOF AREA # Pad D (9C)
450 sm
5 -YR FLOW
Qp (l/s)

Area(ha)=	0.0450	STORMWATER MANAGEMENT Qm =				3.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
14	86.9	9.8	3.00	6.8	5.70	
16	80.5	9.1	3.00	6.1	5.82	
18	75.0	8.4	3.00	5.4	5.88	
20	70.3	7.9	3.00	4.9	5.89	
22	66.1	7.4	3.00	4.4	5.87	
24	62.5	7.0	3.00	4.0	5.82	
26	59.3	6.7	3.00	3.7	5.74	
28	56.5	6.4	3.00	3.4	5.65	
30	53.9	6.1	3.00	3.1	5.53	
32	51.6	5.8	3.00	2.8	5.40	

<=== Required volume for roof storage

Req. Storage volume **5.89** m3
Average depth **0.013** m

ROOF AREA # Pad E (9B)
251 sm
5 -YR FLOW
Qp (l/s)

Updated March 2019

Area(ha)=	0.0251	STORMWATER MANAGEMENT Qm =				2.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
10	104.2	6.5	2.00	4.5	2.73	
12	94.7	5.9	2.00	3.9	2.84	
14	86.9	5.5	2.00	3.5	2.91	
16	80.5	5.1	2.00	3.1	2.93	
18	75.0	4.7	2.00	2.7	2.92	
20	70.3	4.4	2.00	2.4	2.89	
22	66.1	4.2	2.00	2.2	2.84	
24	62.5	3.9	2.00	1.9	2.78	
26	59.3	3.7	2.00	1.7	2.69	

<=== Required volume for roof storage

Req. Storage volume **2.93** m3
Average depth **0.012** m

ROOF AREA # Pad F (7B)
416 sm
5 -YR FLOW
Qp (l/s)

Updated Nov/2012

Area(ha)=	0.0416	STORMWATER MANAGEMENT Qm =				3.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
13	90.6	9.4	3.00	6.4	5.02	
15	83.6	8.7	3.00	5.7	5.13	
17	77.6	8.1	3.00	5.1	5.18	
19	72.5	7.5	3.00	4.5	5.19	<=== Required volume for roof storage
21	68.1	7.1	3.00	4.1	5.15	
23	64.3	6.7	3.00	3.7	5.09	
25	60.9	6.3	3.00	3.3	5.01	
27	57.9	6.0	3.00	3.0	4.90	
29	55.2	5.7	3.00	2.7	4.77	
31	52.7	5.5	3.00	2.5	4.63	

Req. Storage volume **5.19** m3
Average depth **0.012** m

ROOF AREA # Pad G (7C)
490 sm
5 -YR FLOW
Qp (l/s)

Area(ha)=	0.0490	STORMWATER MANAGEMENT Qm =				3.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
16	80.5	9.9	3.00	6.9	6.59	
18	75.0	9.2	3.00	6.2	6.69	
20	70.3	8.6	3.00	5.6	6.74	
22	66.1	8.1	3.00	5.1	6.74	<=== Required volume for roof storage
24	62.5	7.7	3.00	4.7	6.72	
26	59.3	7.3	3.00	4.3	6.67	
28	56.5	6.9	3.00	3.9	6.60	
30	53.9	6.6	3.00	3.6	6.50	
32	51.6	6.3	3.00	3.3	6.39	
34	49.5	6.1	3.00	3.1	6.26	
36	47.6	5.8	3.00	2.8	6.12	
38	45.8	5.6	3.00	2.6	5.97	

Req. Storage volume **6.74** m3
Average depth **0.014** m

ROOF AREA BLDG 1 (2A)
1040 sm
5 -YR FLOW
Qp (l/s)

Updated Feb 2017

Area(ha)=	0.1040	STORMWATER MANAGEMENT Qm =				2.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
60	32.9	8.6	2.00	6.6	23.66	
62	32.2	8.4	2.00	6.4	23.68	
64	31.4	8.2	2.00	6.2	23.70	
66	30.7	8.0	2.00	6.0	23.71	
68	30.0	7.8	2.00	5.8	23.71	
70	29.4	7.6	2.00	5.6	23.70	
72	28.8	7.5	2.00	5.5	23.69	
74	28.2	7.3	2.00	5.3	23.67	
76	27.6	7.2	2.00	5.2	23.64	
78	27.1	7.0	2.00	5.0	23.61	

<=== Required volume for roof storage

Req. Storage volume **23.71** m3
Average depth **0.023** m

ROOF AREA BLDG 2 (8C)
385 sm
5 -YR FLOW
Qp (l/s)

Updated Feb 2017

Area(ha)=	0.0385	STORMWATER MANAGEMENT Qm =				2.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
20	70.3	6.8	2.00	4.8	5.72	
22	66.1	6.4	2.00	4.4	5.77	
24	62.5	6.0	2.00	4.0	5.80	
26	59.3	5.7	2.00	3.7	5.80	
28	56.5	5.4	2.00	3.4	5.78	
30	53.9	5.2	2.00	3.2	5.75	
32	51.6	5.0	2.00	3.0	5.70	
34	49.5	4.8	2.00	2.8	5.65	
36	47.6	4.6	2.00	2.6	5.58	
38	45.8	4.4	2.00	2.4	5.50	
40	44.2	4.3	2.00	2.3	5.41	
42	42.7	4.1	2.00	2.1	5.32	

<=== Required volume for roof storage

Req. Storage volume **5.80** m3
Average depth **0.015** m

PARKING LOT Area #1 (1A, B, C)	
3400 sm	
5 -YR FLOW	
Qp (l/s)	

Flow restricted to 21 l/s

Area(ha)=	0.3400	STORMWATER MANAGEMENT Qm = 21.00 l/s			
Cw =	0.90				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
14	86.9	74.0	21.00	53.0	44.48
16	80.5	68.4	21.00	47.4	45.55
18	75.0	63.8	21.00	42.8	46.20
20	70.3	59.8	21.00	38.8	46.51
22	66.1	56.3	21.00	35.3	46.56
24	62.5	53.2	21.00	32.2	46.37
26	59.3	50.5	21.00	29.5	45.99
28	56.5	48.1	21.00	27.1	45.46
30	53.9	45.9	21.00	24.9	44.78
32	51.6	43.9	21.00	22.9	43.97
33	50.5	43.0	21.00	22.0	43.53

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
18	1.45	0.52
19	1.50	0.54
Total:		1.06

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CBMH31 - CB18	50.00	0.25	2.45
CBMH31 - CB19	35.90	0.30	2.54
Total:			4.99

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
31	2.17	2.45
Total:		2.45

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
1A	277.44	0.17	15.72
1B	453.56	0.17	25.70
1C	51.30	0.62	10.60
Total:			52.03

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 2 3.01
 Total Storage required 49.57
 Total Surface Storage provided 52.03

ICD use Hydrovex 125VHV 21l/s @ 2.77m head, or approved equal

PARKING LOT Area #2
970 sm
5 -YR FLOW
Qp (l/s)

Updated March 2016

Flow restricted to 13 l/s

Area(ha)=	0.0970	STORMWATER MANAGEMENT Qm = 13.00 l/s			
Cw =	0.90				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
7.5	119.6	29.0	13.00	16.0	7.21
8	116.1	28.2	13.00	15.2	7.29
8.5	112.9	27.4	13.00	14.4	7.34
9	109.8	26.6	13.00	13.6	7.37
9.5	106.9	25.9	13.00	12.9	7.38
10	104.2	25.3	13.00	12.3	7.37
10.5	101.6	24.7	13.00	11.7	7.35
11	99.2	24.1	13.00	11.1	7.31
11.5	96.9	23.5	13.00	10.5	7.25
12	94.7	23.0	13.00	10.0	7.19
12.5	92.6	22.5	13.00	9.5	7.11

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
17	1.67	0.60
16	1.25	0.45
Total:		1.05

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB16 - CB17	6.00	0.20	0.19
Total:			0.19

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
2A	36.00	0.07	0.84
2B	22.00	0.07	0.51
Total:			1.35

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 7.38
Total Surface Storage provided 1.35
Overflow to area 1 3.01
Overflow to area 15 3.01

ICD use Hydrovex 100VHV 13l/s @ 1.62m head, or approved equal

PARKING LOT Area #3
550 sm
5 -YR FLOW
Qp (l/s)

Updated March 2016

Flow restricted to 13 l/s

Area(ha)=	0.0550	STORMWATER MANAGEMENT Qm =				13.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
3	166.1	22.9	13.00	9.9	1.77	
3.5	159.0	21.9	13.00	8.9	1.86	
4	152.5	21.0	13.00	8.0	1.92	
4.5	146.6	20.2	13.00	7.2	1.94	
5	141.2	19.4	13.00	6.4	1.93	
5.5	136.2	18.7	13.00	5.7	1.89	
6	131.6	18.1	13.00	5.1	1.84	
6.5	127.3	17.5	13.00	4.5	1.76	
7	123.3	17.0	13.00	4.0	1.67	
7.5	119.6	16.5	13.00	3.5	1.56	
8	116.1	16.0	13.00	3.0	1.43	

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
14	1.30	0.47
15	1.65	0.59
Total:		1.06

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB14 - CB15	6.00	0.20	0.19
Total:			0.19

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
3A	38.00	0.07	0.89
3B	50.00	0.07	1.17
Total:			2.05

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 4 **3.50**
Total Storage required **5.43**
Total Surface Storage provided **2.05**
Overflow to area 15 **3.38**

ICD use Hydrovex 100VHV 13l/s @ 1.50m head, or approved equal

PARKING LOT Area #4
830 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 10 l/s

Area(ha)=	0.0830	STORMWATER MANAGEMENT Qm = 10.00 l/s			
Cw =	0.90				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
8	116.1	24.1	10.00	14.1	6.77
9	109.8	22.8	10.00	12.8	6.91
10	104.2	21.6	10.00	11.6	6.98
11	99.2	20.6	10.00	10.6	7.00
12	94.7	19.7	10.00	9.7	6.96
13	90.6	18.8	10.00	8.8	6.88
14	86.9	18.1	10.00	8.1	6.76
15	83.6	17.4	10.00	7.4	6.62
16	80.5	16.7	10.00	6.7	6.44
17	77.6	16.1	10.00	6.1	6.24
18	75.0	15.6	10.00	5.6	6.01

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
20	1.60	0.58
21	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB21 - CB20	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
Total:			0.00

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 7.00
Total Surface Storage provided 0.00
Overflow to area 3 3.50
Overflow to area 6 3.50

ICD use Hydrovex 100VHV 10l/s @ 1.48m head, or approved equal

PARKING LOT Area #5 (5A, B, C)	
3320 sm	
5 -YR FLOW	
Qp (l/s)	

Flow restricted to 35 l/s

Area(ha)=	0.3320	STORMWATER MANAGEMENT Qm = 35.00 l/s			
Cw =	0.90				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
4	152.5	126.7	35.00	91.7	22.00
6	131.6	109.3	35.00	74.3	26.74
8	116.1	96.5	35.00	61.5	29.50
10	104.2	86.5	35.00	51.5	30.93
12	94.7	78.7	35.00	43.7	31.44
14	86.9	72.2	35.00	37.2	31.26
16	80.5	66.8	35.00	31.8	30.56
18	75.0	62.3	35.00	27.3	29.46
20	70.3	58.4	35.00	23.4	28.03
22	66.1	54.9	35.00	19.9	26.33
23	64.3	53.4	35.00	18.4	25.39

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
24	1.50	0.54
53	1.55	0.56
Total:		1.10

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB24 - CBMH18	30.40	0.30	2.15
CB53 - CBMH18	33.00	0.30	2.33
Total:			4.48

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
18	2.07	2.34
Total:		2.34

PARKING LOT STORAGE

AREA #	AREA (SM)	Depth (m)	Storage (m3)
5A	228.04	0.24	18.24
5B	245.31	0.24	19.62
5C	96.65	0.14	4.51
Total:			42.38

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 6 7.61
 Total Storage required 39.05
 Total Surface Storage provided 42.38

ICD use Hydrovex 150VHV 35l/s @ 2.73m head, or approved equal

PARKING LOT Area #6
1490 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 21 l/s

Area(ha)=	0.1490	STORMWATER MANAGEMENT Qm = 21.00 l/s			
Cw =	0.90				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
6	131.6	49.0	21.00	28.0	10.10
7	123.3	46.0	21.00	25.0	10.49
8	116.1	43.3	21.00	22.3	10.70
9	109.8	40.9	21.00	19.9	10.76
10	104.2	38.8	21.00	17.8	10.71
11	99.2	37.0	21.00	16.0	10.55
12	94.7	35.3	21.00	14.3	10.30
13	90.6	33.8	21.00	12.8	9.97
14	86.9	32.4	21.00	11.4	9.58
15	83.6	31.1	21.00	10.1	9.13
16	80.5	30.0	21.00	9.0	8.64

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
22	1.60	0.58
23	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB23 - CB22	6.00	0.20	0.19
Total:			0.19

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA (SM)	Depth (m)	Storage (m3)
6A	40.00	0.07	0.93
6B	40.00	0.07	0.93
Total:			1.87

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 7A	2.83
Overflow from area 4	3.50
Total Storage required	17.09
Total Surface Storage provided	1.87
Overflow to area 5	7.61
Overflow to area 12	7.61

ICD use Iplex Type A or approved equal

PARKING LOT Area #7A
540 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 5 l/s

Area(ha)=	0.0540	STORMWATER MANAGEMENT Qm = 5.00 l/s			
Cw =	0.90				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
11	99.2	13.4	5.00	8.4	5.55
12	94.7	12.8	5.00	7.8	5.61
13	90.6	12.2	5.00	7.2	5.65
14	86.9	11.7	5.00	6.7	5.67
15	83.6	11.3	5.00	6.3	5.66
16	80.5	10.9	5.00	5.9	5.64
17	77.6	10.5	5.00	5.5	5.60
18	75.0	10.1	5.00	5.1	5.54
19	72.5	9.8	5.00	4.8	5.47
20	70.3	9.5	5.00	4.5	5.39
21	68.1	9.2	5.00	4.2	5.30

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
25	1.60	0.58
26	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB26 - CB25	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
Total:			0.00

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 5.67
Total Surface Storage provided 0.00
Overflow to area 9 2.83
Overflow to area 6 2.83

ICD use Hydrovex 75VHV 5l/s @ 1.41m head, or approved equal

PARKING LOT Area #7D
280 sm
5 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 5 l/s

Area(ha)=	0.0280	STORMWATER MANAGEMENT Qm =				5.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
4	152.5	10.7	5.00	5.7	1.36	
5	141.2	9.9	5.00	4.9	1.47	
6	131.6	9.2	5.00	4.2	1.52	
7	123.3	8.6	5.00	3.6	1.53	<=== Required volume for storage on-site
8	116.1	8.1	5.00	3.1	1.50	
9	109.8	7.7	5.00	2.7	1.45	
10	104.2	7.3	5.00	2.3	1.38	
11	99.2	6.9	5.00	1.9	1.29	
12	94.7	6.6	5.00	1.6	1.18	
13	90.6	6.3	5.00	1.3	1.05	
14	86.9	6.1	5.00	1.1	0.92	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
58	1.60	0.58
59	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB26 - CB25	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
Total:			0.00

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 1.53
Total Surface Storage provided 0.00
Overflow to Hazeldean Road 1.53

ICD use Hydrovex 75VHV 5l/s @ 1.48m head, or approved equal

PARKING LOT Area #8 (A,D,E&F)
2340 sm
5 -YR FLOW
Qp (l/s)

Updated Feb 2017

Flow restricted to 18.5 l/s

Area(ha)=	0.2340	STORMWATER MANAGEMENT Qm = 18.50 l/s			
Cw =	0.90				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
8	116.1	68.0	18.50	49.5	23.75
10	104.2	61.0	18.50	42.5	25.50
12	94.7	55.4	18.50	36.9	26.60
14	86.9	50.9	18.50	32.4	27.21
16	80.5	47.1	18.50	28.6	27.46
18	75.0	43.9	18.50	25.4	27.42
20	70.3	41.1	18.50	22.6	27.16
22	66.1	38.7	18.50	20.2	26.70
24	62.5	36.6	18.50	18.1	26.09
26	59.3	34.7	18.50	16.2	25.34
27	57.9	33.9	18.50	15.4	24.93

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
60	1.73	0.62
61	1.81	0.65
62	1.91	0.69
63	2.01	0.72
Total:		2.69

IN-LINE STORAGE (Pipe)

Pipe storage				
Structure to Structure	Length	Dia	Storage	
	(m)	(m)	(m3)	
CB60 to CB62	24.00	0.25	1.18	
CB61 to CB62	17.10	0.25	0.84	
CB62 to CB63	22.60	0.38	2.50	
Total:			4.51	

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
8A	438.40	0.20	29.23
8C	44.90	0.15	2.25
Total:			31.47

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 9A 3.85
 Total Storage required 31.31
 Total Surface Storage provided 31.47

ICD use Ipx Tempst 18.5 l/s at 2.25m head or approved equal

PARKING LOT Area #8B
900 sm
5 -YR FLOW
Qp (l/s)

Updated Nov/2012

Flow restricted to 10 l/s

Area(ha)=	0.0900	STORMWATER MANAGEMENT Qm =				10.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
6	131.6	29.6	10.00	19.6	7.07	
8	116.1	26.1	10.00	16.1	7.75	
10	104.2	23.5	10.00	13.5	8.08	
12	94.7	21.3	10.00	11.3	8.15	
14	86.9	19.6	10.00	9.6	8.04	
16	80.5	18.1	10.00	8.1	7.79	
18	75.0	16.9	10.00	6.9	7.43	
20	70.3	15.8	10.00	5.8	6.98	
22	66.1	14.9	10.00	4.9	6.46	
24	62.5	14.1	10.00	4.1	5.88	
25	60.9	13.7	10.00	3.7	5.57	

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
52	1.45	0.52
Total:		0.52

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
8B	153.16	0.18	9.19
Total:			9.19

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 8.15
Total Surface Storage provided 9.19

ICD use Hydrovex 100VHV 10l/s @ 1.55m head, or approved equal

PARKING LOT Area #9A
1200 sm
5 -YR FLOW
Qp (l/s)

Updated Feb 2017

Flow restricted to 21 l/s

Area(ha)=	0.1200	STORMWATER MANAGEMENT Qm =				21.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
4	152.5	45.8	21.00	24.8	5.95	
5	141.2	42.4	21.00	21.4	6.42	
6	131.6	39.5	21.00	18.5	6.66	
7	123.3	37.0	21.00	16.0	6.73	<=== Required volume for storage on-site
8	116.1	34.9	21.00	13.9	6.65	
9	109.8	33.0	21.00	12.0	6.46	
10	104.2	31.3	21.00	10.3	6.17	
11	99.2	29.8	21.00	8.8	5.80	
12	94.7	28.4	21.00	7.4	5.35	
13	90.6	27.2	21.00	6.2	4.84	
14	86.9	26.1	21.00	5.1	4.28	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
27	1.65	0.59
28	1.30	0.47
Total:		1.06

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB28 - CB27	6.00	0.20	0.19
Total:			0.19

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
9A	40.00	0.07	0.93
9B	40.00	0.07	0.93
Total:			1.87

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 7A **2.83**
Total Storage required **9.56**
Total Surface Storage provided **1.87**
Overflow to area 8A **3.85**
Overflow to area 14 **3.85**

ICD use Ipx Type A or approved equal

PARKING LOT Area #11
1730 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 18 l/s

Area(ha)=	0.1730	STORMWATER MANAGEMENT Qm =				18.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
10	104.2	45.1	18.00	27.1	16.26	
11	99.2	42.9	18.00	24.9	16.46	
12	94.7	41.0	18.00	23.0	16.55	
13	90.6	39.2	18.00	21.2	16.56	<=== Required volume for storage on-site
14	86.9	37.6	18.00	19.6	16.49	
15	83.6	36.2	18.00	18.2	16.35	
16	80.5	34.8	18.00	16.8	16.15	
17	77.6	33.6	18.00	15.6	15.90	
18	75.0	32.5	18.00	14.5	15.61	
19	72.5	31.4	18.00	13.4	15.27	
20	70.3	30.4	18.00	12.4	14.89	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
10	1.60	0.58
11	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB11 - CB10	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
11A	134.63	0.13	5.83
11B	85.33	0.13	3.70
Total:			9.53

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 16.56
Total Surface Storage provided 9.53
Overflow to area 16 7.03

ICD use Hydrovex 125VHV 18l/s @ 1.63m head, or approved equal

PARKING LOT Area #12
2040 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 21 l/s

Area(ha)=	0.2040	STORMWATER MANAGEMENT Qm =				21.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
4	152.5	77.8	21.00	56.8	13.64	
6	131.6	67.2	21.00	46.2	16.62	
8	116.1	59.3	21.00	38.3	18.37	
10	104.2	53.2	21.00	32.2	19.31	
12	94.7	48.3	21.00	27.3	19.68	<=== Required volume for storage on-site
14	86.9	44.4	21.00	23.4	19.63	
16	80.5	41.1	21.00	20.1	19.26	
18	75.0	38.3	21.00	17.3	18.65	
20	70.3	35.9	21.00	14.9	17.83	
22	66.1	33.8	21.00	12.8	16.85	
23	64.3	32.8	21.00	11.8	16.30	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
41	1.50	0.54
Total:		0.54

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB41 - 28	19.50	0.30	1.38
Total:			1.38

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
28	2.56	2.89
Total:		2.89

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
12	536.13	0.18	32.17
Total:			32.17

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 6 7.61
 Total Storage required 27.29
 Total Surface Storage provided 32.17

ICD use Ipx Type A or approved equal

PARKING LOT Area #14 (14A,B)
2720 sm
5 -YR FLOW
Qp (l/s)

Updated Feb 2017

Flow restricted to 21 l/s

Area(ha)=	0.2720	STORMWATER MANAGEMENT Qm =				21.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
10	104.2	70.9	21.00	49.9	29.94	
12	94.7	64.4	21.00	43.4	31.28	
14	86.9	59.2	21.00	38.2	32.06	
16	80.5	54.8	21.00	33.8	32.41	
18	75.0	51.0	21.00	30.0	32.42	<=== Required volume for storage on-site
20	70.3	47.8	21.00	26.8	32.17	
22	66.1	45.0	21.00	24.0	31.70	
24	62.5	42.6	21.00	21.6	31.05	
26	59.3	40.4	21.00	19.4	30.24	
28	56.5	38.4	21.00	17.4	29.31	
29	55.2	37.6	21.00	16.6	28.80	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
39	1.57	0.57
40	1.45	0.52
Total:		1.09

IN-LINE STORAGE (Pipe)

Pipe storage				
Structure to Structure	Length	Dia	Storage	
	(m)	(m)	(m3)	
CB40 - 27	44.00	0.25	2.16	
CB39 - 27	21.30	0.38	2.35	
Total:			4.51	

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
27	2.57	2.90
Total:		2.90

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
14A	665.69	0.18	39.94
14B	91.87	0.18	5.51
Total:			45.45

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 9A **3.85**
Total Storage required **36.27**
Total Surface Storage provided **45.45**

ICD use Hydrovex 125VHV 21l/s @ 2.87m head, or approved equal

PARKING LOT Area #15 (15A,B,C,D,E,F)

Updated Feb 2017

10340 sm					
5 -YR FLOW		Flow restricted to 43 l/s			
Qp (l/s)					
Area(ha)=	1.0340	STORMWATER MANAGEMENT Qm = 43.00 l/s			
Cw =	0.90				
Tc		Qp	Qm	Qp-Qm	Volume
Variable	i	2.78 x Area x c x i			
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
24	62.5	161.8	43.00	118.8	171.07
26	59.3	153.5	43.00	110.5	172.43
28	56.5	146.1	43.00	103.1	173.29
30	53.9	139.5	43.00	96.5	173.73
32	51.6	133.5	43.00	90.5	173.79
34	49.5	128.1	43.00	85.1	173.53
36	47.6	123.1	43.00	80.1	172.98
38	45.8	118.5	43.00	75.5	172.17
40	44.2	114.3	43.00	71.3	171.14
42	42.7	110.4	43.00	67.4	169.90
43	42.0	108.6	43.00	65.6	169.21

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
8	1.50	0.54
9	1.60	0.58
12	1.65	0.59
Total:		1.71

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CBMH9 - CBMH10	34.20	0.60	9.67
CBMH10 - CBMH11	38.60	0.53	8.36
CB8 - CBMH11	38.60	0.30	2.73
CB9 - CBMH11	33.00	0.25	1.62
CB12 - CBMH11	44.80	0.45	7.13
Total:			29.50

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
9	2.42	2.73
10 (1.5 dia)	2.35	4.15
11	2.14	2.42
Total:		9.31

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
15A	62.14	0.07	1.45
15B	644.08	0.22	47.23
15C	696.50	0.22	51.08
15D	538.48	0.22	39.49
15E	603.30	0.22	44.24
15F	253.73	0.12	10.15
Total:			193.64

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 2 3.01
Overflow from area 3 3.38
Total Storage required 180.18
Total Surface Storage provided 193.64

ICD use IPEX TEMPEST 43l/s @ 3.06m head, or approved equal

PARKING LOT Area #16
1050 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 29 l/s

Area(ha)=	0.1050	STORMWATER MANAGEMENT Qm = 29.00 l/s			
Cw =	0.90				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
0.5	216.1	56.8	29.00	27.8	0.83
1.5	192.5	50.6	29.00	21.6	1.94
2.5	173.9	45.7	29.00	16.7	2.50
3.5	159.0	41.8	29.00	12.8	2.68
4.5	146.6	38.5	29.00	9.5	2.57
5.5	136.2	35.8	29.00	6.8	2.24
6.5	127.3	33.4	29.00	4.4	1.73
7.5	119.6	31.4	29.00	2.4	1.09
8.5	112.9	29.6	29.00	0.6	0.33
9.5	106.9	28.1	29.00	-0.9	-0.52
10.5	101.6	26.7	29.00	-2.3	-1.45

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
6	1.60	0.58
7	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB6 - CB7	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA (SM)	Depth (m)	Storage (m3)
16A	135.45	0.13	5.87
16B	163.52	0.13	7.09
Total:			12.96

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 11 7.03
 Total Storage required 9.71
 Total Surface Storage provided 12.96

ICD use Hydrovex 150VHV 29l/s @ 1.62m head, or approved equal

PARKING LOT Area #17 (17A,B,C,D,E,F)	
7090 sm	
5 -YR FLOW	
Qp (l/s)	

Updated March 2019

Flow restricted to 82 l/s

Area(ha)=	0.7090	STORMWATER MANAGEMENT Qm = 82.00 l/s			
Cw =	0.90				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
3	166.1	294.6	82.00	212.6	38.27
5	141.2	250.4	82.00	168.4	50.53
7	123.3	218.7	82.00	136.7	57.43
9	109.8	194.8	82.00	112.8	60.89
11	99.2	176.0	82.00	94.0	62.01
13	90.6	160.8	82.00	78.8	61.44
15	83.6	148.2	82.00	66.2	59.60
17	77.6	137.7	82.00	55.7	56.78
19	72.5	128.7	82.00	46.7	53.19
21	68.1	120.9	82.00	38.9	48.96
22	66.1	117.3	82.00	35.3	46.65

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
42	1.47	0.53
43	1.45	0.52
44	1.45	0.52
45	1.50	0.54
Total:		2.11

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB42 - CBMH29	34.20	0.25	1.68
CB 43 - CBMH29	34.20	0.25	1.68
CBMH29 - CBMH30	38.90	0.45	6.19
CB44 - CBMH30	34.20	0.25	1.68
CB45 - CBMH30	34.20	0.30	2.42
Total:			13.64

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
29	2.50	2.83
30	2.34	2.64
Total:		5.47

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
17A	220.60	0.14	10.29
17B	188.99	0.14	8.82
17C	111.16	0.14	5.19
17D	358.98	0.14	16.75
17E	350.76	0.14	16.37
17F	173.44	0.14	8.09
Total:			65.52

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 62.01
Total Surface Storage provided 65.52

ICD use Hydrovex 250VHV 82l/s @ 2.97m head, or approved equal

PARKING LOT Area #18
1830 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 21 l/s

Area(ha)=	0.1830	STORMWATER MANAGEMENT Qm = 21.00 l/s			
Cw =	0.90				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
8	116.1	53.2	21.00	32.2	15.44
9	109.8	50.3	21.00	29.3	15.81
10	104.2	47.7	21.00	26.7	16.02
11	99.2	45.4	21.00	24.4	16.11
12	94.7	43.4	21.00	22.4	16.10
13	90.6	41.5	21.00	20.5	15.99
14	86.9	39.8	21.00	18.8	15.80
15	83.6	38.3	21.00	17.3	15.53
16	80.5	36.8	21.00	15.8	15.21
17	77.6	35.5	21.00	14.5	14.82
18	75.0	34.3	21.00	13.3	14.39

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
35	1.60	0.58
36	1.30	0.47
Total:		1.04

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB36 - CB35	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
18A	115.03	0.14	5.37
18B	94.54	0.14	4.41
Total:			9.78

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 16.11
Total Surface Storage provided 9.78
overflow to 19 6.33

ICD use Ipx Type A or approved equal

PARKING LOT Area #19
770 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 29 l/s

Area(ha)=	0.0770	STORMWATER MANAGEMENT Qm = 29.00 l/s			
Cw =	0.90				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
0.25	223.0	43.0	29.00	14.0	0.21
0.75	209.6	40.4	29.00	11.4	0.51
1.25	197.8	38.1	29.00	9.1	0.68
1.75	187.4	36.1	29.00	7.1	0.75
2.25	178.2	34.3	29.00	5.3	0.72
2.75	169.9	32.7	29.00	3.7	0.62
3.25	162.4	31.3	29.00	2.3	0.45
3.75	155.7	30.0	29.00	1.0	0.22
4.25	149.5	28.8	29.00	-0.2	-0.05
4.75	143.8	27.7	29.00	-1.3	-0.37
5.25	138.6	26.7	29.00	-2.3	-0.72

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
33	1.60	0.58
34	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB34 - CB33	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA (SM)	Depth (m)	Storage (m3)
19A	66.62	0.14	3.11
19B	80.81	0.14	3.77
Total:			6.88

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

overflow from 18 6.33
Total Storage required 7.08
Total Storage provided 7.96

ICD use Hydrovex 150VHV 29l/s @ 1.72m head, or approved equal

PARKING LOT Area #20 (20A,B,C,D)	
6400 sm	
5 -YR FLOW	
Qp (l/s)	

Updated March 2019

Flow restricted to 48 l/s

Area(ha)=	0.6400	STORMWATER MANAGEMENT Qm = 48.00 l/s			
Cw =	0.90				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
9	109.8	175.8	48.00	127.8	69.02
11	99.2	158.8	48.00	110.8	73.15
13	90.6	145.1	48.00	97.1	75.76
15	83.6	133.8	48.00	85.8	77.22
17	77.6	124.3	48.00	76.3	77.80
19	72.5	116.1	48.00	68.1	77.67
21	68.1	109.1	48.00	61.1	76.98
23	64.3	102.9	48.00	54.9	75.82
25	60.9	97.5	48.00	49.5	74.27
27	57.9	92.7	48.00	44.7	72.38
28	56.5	90.5	48.00	42.5	71.33

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
31	1.45	0.52
32	1.45	0.52
Total:		0.52

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CBMH32 - CBMH24	42.10	0.60	11.90
CBMH24 - CBMH25	39.00	0.45	6.20
CB32 - CBMH25	42.80	0.25	2.10
CB31 - CBMH25	42.80	0.25	2.10
Total:			22.31

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
24	2.59	2.93
25 (1.5m dia)	2.30	4.06
32	2.71	3.06
Total:		10.05

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
20A	88.84	0.13	3.85
20B	1184.13	0.18	71.05
20C	278.87	0.13	12.08
20D	210.89	0.13	9.14
Total:			96.12

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 77.80
Total Surface Storage provided 96.12

ICD use Hydrovex 200VHV 48l/s @ 3.14m head, or approved equal

PARKING LOT Area #21
1910 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 10 l/s

Area(ha)=	0.1910	STORMWATER MANAGEMENT Qm =				10.00 l/s
Cw =	0.60					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
14	86.9	27.7	10.00	17.7	14.86	
15	83.6	26.6	10.00	16.6	14.96	
16	80.5	25.6	10.00	15.6	15.01	
17	77.6	24.7	10.00	14.7	15.02	<=== Required volume for storage on-site
18	75.0	23.9	10.00	13.9	15.00	
19	72.5	23.1	10.00	13.1	14.94	
20	70.3	22.4	10.00	12.4	14.86	
21	68.1	21.7	10.00	11.7	14.75	
22	66.1	21.1	10.00	11.1	14.62	
23	64.3	20.5	10.00	10.5	14.46	
24	62.5	19.9	10.00	9.9	14.29	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
2	1.40	0.50
Total:		0.50

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
21	191.58	0.25	15.97
Total:			15.97

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 15.02
Total Surface Storage provided 15.97

ICD use Hydrovex 100VHV 10l/s @ 1.65m head, or approved equal

PARKING LOT Area #21A
270 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 5 l/s

Area(ha)=	0.0270	STORMWATER MANAGEMENT Qm =				5.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
4	152.5	10.3	5.00	5.3	1.27	
5	141.2	9.5	5.00	4.5	1.36	
6	131.6	8.9	5.00	3.9	1.40	
7	123.3	8.3	5.00	3.3	1.40	<=== Required volume for storage on-site
8	116.1	7.8	5.00	2.8	1.37	
9	109.8	7.4	5.00	2.4	1.31	
10	104.2	7.0	5.00	2.0	1.22	
11	99.2	6.7	5.00	1.7	1.12	
12	94.7	6.4	5.00	1.4	1.01	
13	90.6	6.1	5.00	1.1	0.88	
14	86.9	5.9	5.00	0.9	0.73	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
1	1.40	0.50
Total:		0.50

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA (SM)	Depth (m)	Storage (m3)
21A	35.32	0.15	1.77
Total:			1.77

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 1.40
Total Surface Storage provided 1.77

ICD use Hydrovex 75VHV 5l/s @ 1.45m head, or approved equal

PARKING LOT Area #22
1720 sm
5 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 12 l/s

Area(ha)=	0.1720	STORMWATER MANAGEMENT Qm =				12.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
16	80.5	34.6	12.00	22.6	21.72	
17	77.6	33.4	12.00	21.4	21.83	
18	75.0	32.3	12.00	20.3	21.88	
19	72.5	31.2	12.00	19.2	21.90	<=== Required volume for storage on-site
20	70.3	30.2	12.00	18.2	21.88	
21	68.1	29.3	12.00	17.3	21.82	
22	66.1	28.5	12.00	16.5	21.73	
23	64.3	27.7	12.00	15.7	21.62	
24	62.5	26.9	12.00	14.9	21.48	
25	60.9	26.2	12.00	14.2	21.31	
26	59.3	25.5	12.00	13.5	21.12	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
55	1.26	0.45
Total:		0.45

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
22	286.07	0.23	21.93
Total:			21.93

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 21.90
Total Surface Storage provided 21.93

ICD use Hydrovex 100VHV 12l/s @ 1.57m head, or approved equal

PARKING LOT Area #23
1410 sm
5 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 21 l/s

Area(ha)=	0.1410	STORMWATER MANAGEMENT Qm =				21.00 l/s
Cw =	0.60					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
2	182.7	43.0	21.00	22.0	2.64	
3	166.1	39.1	21.00	18.1	3.25	
4	152.5	35.9	21.00	14.9	3.57	
5	141.2	33.2	21.00	12.2	3.66	<=== Required volume for storage on-site
6	131.6	30.9	21.00	9.9	3.58	
7	123.3	29.0	21.00	8.0	3.36	
8	116.1	27.3	21.00	6.3	3.03	
9	109.8	25.8	21.00	4.8	2.60	
10	104.2	24.5	21.00	3.5	2.10	
11	99.2	23.3	21.00	2.3	1.54	
12	94.7	22.3	21.00	1.3	0.92	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
3		
Total:		0.00

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA (SM)	Depth (m)	Storage (m3)
23	172.34	0.15	8.62
Total:			8.62

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow form 23B **1.09**
Total Storage required **4.75**
Total Surface Storage provided **8.62**

ICD IPEX type A, or approved equal

PARKING LOT Area #23B
1430 sm
5 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 9 l/s

Area(ha)=	0.1430	STORMWATER MANAGEMENT Qm =				4.50 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
38	45.8	16.4	4.50	11.9	27.11	
39	45.0	16.1	4.50	11.6	27.13	
40	44.2	15.8	4.50	11.3	27.14	
41	43.4	15.5	4.50	11.0	27.14	
42	42.7	15.3	4.50	10.8	27.14	
43	42.0	15.0	4.50	10.5	27.13	
44	41.3	14.8	4.50	10.3	27.12	
45	40.6	14.5	4.50	10.0	27.10	
46	40.0	14.3	4.50	9.8	27.07	
47	39.4	14.1	4.50	9.6	27.04	
48	38.8	13.9	4.50	9.4	27.00	

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
61	1.26	0.45
Total:		0.45

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Oversized Subdrains	0.00	0.45	0.00
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
ADS (17m3 provided, 15.47min)		15.47
Total:		15.47

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
23B	304.74	0.21	21.33
Total:			21.33

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from 23C 11.20
Total Storage required 38.35
Total Surface Storage provided 37.26
Overflow to 23 1.09

ICD use Hydrovex 100VHV-1 9l/s @ 1.65m head (pond 101.65, ICD invert 99.90 (CL 100.00)), or approved equal

PARKING LOT Area #23C
2180 sm
5 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 9 l/s

Area(ha)=	0.2180	STORMWATER MANAGEMENT Qm =				4.50 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
59	33.4	18.2	4.50	13.7	48.47	
60	32.9	18.0	4.50	13.5	48.49	
61	32.5	17.8	4.50	13.3	48.50	
62	32.2	17.5	4.50	13.0	48.50	
63	31.8	17.3	4.50	12.8	48.50	
64	31.4	17.1	4.50	12.6	48.49	
65	31.0	16.9	4.50	12.4	48.49	
66	30.7	16.7	4.50	12.2	48.47	
67	30.4	16.6	4.50	12.1	48.46	
68	30.0	16.4	4.50	11.9	48.44	
69	29.7	16.2	4.50	11.7	48.41	

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
62	1.26	0.45
Total:		0.45

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Oversized Subdrains	0.00	0.45	0.00
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
ADS (17m3 provided, 15.47min)		15.47
Total:		15.47

PARKING LOT STORAGE

AREA #	AREA (SM)	Depth (m)	Storage (m3)
23C	305.35	0.21	21.37
Total:			21.37

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 48.50
Total Surface Storage provided 37.30
Overflow to 23B 11.20

ICD use Hydrovex 100VHV-1 9l/s @ 1.65m head (pond 101.65, ICD invert 99.90 (CL 100.00)), or approved equal

PARKING LOT Area #24
1220 sm
5 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 35 l/s

Area(ha)=	0.1220	STORMWATER MANAGEMENT Qm = 35.00 l/s			
Cw =	0.70				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
-1	267.0	63.4	35.00	28.4	-1.70
0	230.5	54.7	35.00	19.7	0.00
1	203.5	48.3	35.00	13.3	0.80
2	182.7	43.4	35.00	8.4	1.00
3	166.1	39.4	35.00	4.4	0.80
4	152.5	36.2	35.00	1.2	0.29
5	141.2	33.5	35.00	-1.5	-0.44
6	131.6	31.2	35.00	-3.8	-1.36
7	123.3	29.3	35.00	-5.7	-2.41
8	116.1	27.6	35.00	-7.4	-3.57
9	109.8	26.1	35.00	-8.9	-4.82

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
4	1.53	0.55
Total:		0.55

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
24	160.19	0.13	6.94
Total:			6.94

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from 23 0.00
Total Storage required 1.00
Total Surface Storage provided 6.94

ICD use Hydrovex 150VHV 35l/s @ 1.68m head, or approved equal

PARKING LOT Area #24A
200 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 3 l/s

Area(ha)=	0.0200	STORMWATER MANAGEMENT Qm =				3.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
6	131.6	6.6	3.00	3.6	1.29	
7	123.3	6.2	3.00	3.2	1.33	
8	116.1	5.8	3.00	2.8	1.35	
9	109.8	5.5	3.00	2.5	1.35	<=== Required volume for storage on-site
10	104.2	5.2	3.00	2.2	1.33	
11	99.2	5.0	3.00	2.0	1.30	
12	94.7	4.7	3.00	1.7	1.25	
13	90.6	4.5	3.00	1.5	1.20	
14	86.9	4.4	3.00	1.4	1.13	
15	83.6	4.2	3.00	1.2	1.06	
16	80.5	4.0	3.00	1.0	0.99	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
56	1.24	0.45
Total:		0.45

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
23C	33.91	0.16	1.81
Total:			1.81

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 1.35
Total Surface Storage provided 1.81

ICD use Hydrovex 50VHV 3l/s @ 1.44m head, or approved equal

PARKING LOT Area #25
1820 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 27 l/s

Area(ha)=	0.1820	STORMWATER MANAGEMENT Qm = 27.00 l/s			
Cw =	0.70				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
3	166.1	58.8	27.00	31.8	5.73
4	152.5	54.0	27.00	27.0	6.48
5	141.2	50.0	27.00	23.0	6.90
6	131.6	46.6	27.00	19.6	7.06
7	123.3	43.7	27.00	16.7	7.00
8	116.1	41.1	27.00	14.1	6.78
9	109.8	38.9	27.00	11.9	6.42
10	104.2	36.9	27.00	9.9	5.94
11	99.2	35.1	27.00	8.1	5.37
12	94.7	33.5	27.00	6.5	4.71
13	90.6	32.1	27.00	5.1	3.98

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
5	1.60	0.58
Total:		0.58

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
25	234.71	0.11	8.61
Total:			8.61

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 7.06
Total Surface Storage provided 8.61

ICD use Hydrovex 150VHV 27l/s @ 1.60m head, or approved equal

PARKING LOT Area #25A
280 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 2 l/s

Area(ha)=	0.0280	STORMWATER MANAGEMENT Qm =				2.00 l/s
Cw =	0.90					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
14	86.9	6.1	2.00	4.1	3.44	
15	83.6	5.9	2.00	3.9	3.47	
16	80.5	5.6	2.00	3.6	3.49	
17	77.6	5.4	2.00	3.4	3.51	<=== Required volume for storage on-site
18	75.0	5.3	2.00	3.3	3.51	
19	72.5	5.1	2.00	3.1	3.51	
20	70.3	4.9	2.00	2.9	3.51	
21	68.1	4.8	2.00	2.8	3.49	
22	66.1	4.6	2.00	2.6	3.48	
23	64.3	4.5	2.00	2.5	3.46	
24	62.5	4.4	3.00	1.4	1.99	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
57	1.22	0.44
Total:		0.44

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
25A	58.10	0.20	3.87
Total:			3.87

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 3.51
Total Surface Storage provided 3.87

ICD use Hydrovex 50VHV 2l/s @ 1.42m head, or approved equal

PARKING LOT Area #26
620 sm
5 -YR FLOW
Qp (l/s)

Flow restricted to 5 l/s

Area(ha)=	0.0620	STORMWATER MANAGEMENT Qm =				5.00 l/s
Cw =	0.90					
Tc		Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i				
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
13	90.6	14.1	5.00	9.1	7.07	
14	86.9	13.5	5.00	8.5	7.13	
15	83.6	13.0	5.00	8.0	7.17	
16	80.5	12.5	5.00	7.5	7.18	<=== Required volume for storage on-site
17	77.6	12.0	5.00	7.0	7.18	
18	75.0	11.6	5.00	6.6	7.16	
19	72.5	11.3	5.00	6.3	7.13	
20	70.3	10.9	5.00	5.9	7.08	
21	68.1	10.6	5.00	5.6	7.02	
22	66.1	10.3	5.00	5.3	6.94	
23	64.3	10.0	5.00	5.0	6.86	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
54	1.34	0.48
Total:		0.48

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
26	132.00	0.17	7.48
Total:			7.48

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 7.18
Total Surface Storage provided 7.48

ICD use Hydrovex 75VHV 5l/s @ 1.55m head, or approved equal

Phase 1 & 2 SUMMARY

Total Flow from Roofs=	82.50 l/s
Total Roof Area =	2.012 Ha
Average roof flow =	41.00 l/s/Ha
Volume Stored on Roofs	349.61 cm
Total Roof Storage rate	173.75 cm/Ha
Total flow from parking lot =	613.50 l/s
Total parking Lot area =	6.285 Ha
Average parking lot flow =	97.61 l/s/Ha
Volume Stored on Parking lot	766.87 cm
Total Parking lot Storage rate	122.02 cm/Ha
Total flow	696.00 l/s
Total area	8.297 Ha
Average flow	83.88 l/s/Ha
Volume Stored	1116.49 cm
Total Storage rate	134.56 cm/Ha



IBI
333 Preston St
OTTAWA, ONTARIO
K1S 5N4

ONSITE SWM 100yr design
PROJECT: HUNTMAR PLAZA
CITY OF OTTAWA
DEVELOPER : NORTH AMERICAN

PAGE:
JOB #: 10113
DATE: 2019-03
DESIGN: DY
Rev#6 Box D, Pad B, CRU B-3

LANDS EAST OF HUNTMAR DR Phase 1 & 2, 100 yr design

MAXIMUM ALLOWABLE FLOW - Flow Restricted to 85 l/s/Ha

Time of concentration = 10 minutes

Area (ha) =	8.297
C Average =	0.88

Intensity - 5 year event storm

10 min Tc	$i_{5yr} = 998.071 / (T + 6.053)^{0.814} =$	104.2	mm/hr
-----------	---------------------------------------------	-------	-------

Unrestricted Flowrate (Q5)

10 min Tc	$Q_{pre-devo} = 2.78 * A * Cw^i =$	2114.94	l/s
-----------	------------------------------------	---------	-----

Restricted Flowrate (Q5)

10 min Tc	$Q = 85 \text{ l/s/Ha}$	705.26	l/s
-----------	-------------------------	--------	-----

Intensity - 100 year event storm

10 min Tc	$i_{100yr} = 1735.688 / (T + 6.014)^{0.82} =$	178.6	mm/hr
-----------	-----------------------------------------------	-------	-------

Unrestricted Flowrate (Q100)

10 min Tc	$Q_{post-devo} = 2.78 * A * Cw^i =$	3624.44	l/s
-----------	-------------------------------------	---------	-----

Restricted Flowrate (Q5)

10 min Tc	$Q = 85 \text{ l/s/Ha}$	705.26	l/s
-----------	-------------------------	--------	-----

STORM WATER MANAGEMENT - Post-Development Controlled

(100 year post-development to 85 l/sec/Ha)

ROOF AREA # Box A (21B)

3260 sm
100 -YR FLOW
Qp (l/s)

Area(ha)=	0.3260	STORMWATER MANAGEMENT Qm =				16.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
42	72.6	65.8	16.00	49.8	125.41	
44	70.2	63.6	16.00	47.6	125.67	
46	68.0	61.6	16.00	45.6	125.83	
48	65.9	59.7	16.00	43.7	125.90	<=== Required volume for roof storage
50	64.0	58.0	16.00	42.0	125.88	
52	62.1	56.3	16.00	40.3	125.79	
54	60.4	54.8	16.00	38.8	125.62	
56	58.8	53.3	16.00	37.3	125.40	
58	57.3	52.0	16.00	36.0	125.11	
60	55.9	50.7	16.00	34.7	124.76	
62	54.5	49.4	16.00	33.4	124.37	
64	53.3	48.3	16.00	32.3	123.92	

Req. Storage volume 125.90 m3
Average depth 0.039 m

ROOF AREA # CRU B-3 (23A)
1490 sm
100 -YR FLOW
Qp (l/s)

Updated March 2019

Area(ha)=	0.1490	STORMWATER MANAGEMENT Qm =				4.00 l/s
Cw =	1.00					
Tc		Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i				
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
81	44.6	18.5	4.00	14.5	70.28	
83	43.7	18.1	4.00	14.1	70.32	
85	43.0	17.8	4.00	13.8	70.34	
87	42.2	17.5	4.00	13.5	70.36	
89	41.5	17.2	4.00	13.2	70.36	
91	40.8	16.9	4.00	12.9	70.35	
93	40.1	16.6	4.00	12.6	70.33	
95	39.4	16.3	4.00	12.3	70.31	
97	38.8	16.1	4.00	12.1	70.27	
99	38.2	15.8	4.00	11.8	70.23	
101	37.6	15.6	4.00	11.6	70.17	
103	37.0	15.3	4.00	11.3	70.11	

<=== Required volume for roof storage

Req. Storage volume **70.36** m3
Average depth **0.047** m

ROOF AREA # --OBSOLETE--
0 sm
100 -YR FLOW
Qp (l/s)

Updated March 2019

Area(ha)=	0.0000	STORMWATER MANAGEMENT Qm =				0.00 l/s
Cw =	0.00					
Tc		Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i				
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
0	398.6	0.0	0.00	0.0	0.00	
2	315.0	0.0	0.00	0.0	0.00	
4	263.4	0.0	0.00	0.0	0.00	
6	223.5	0.0	0.00	0.0	0.00	
8	189.2	0.0	0.00	0.0	0.00	
10	178.6	0.0	0.00	0.0	0.00	
12	162.1	0.0	0.00	0.0	0.00	
14	148.7	0.0	0.00	0.0	0.00	
16	137.5	0.0	0.00	0.0	0.00	
18	128.1	0.0	0.00	0.0	0.00	
20	120.0	0.0	0.00	0.0	0.00	
22	112.9	0.0	0.00	0.0	0.00	

<=== Required volume for roof storage

Req. Storage volume **0.00** m3
Average depth **#DIV/0!** m

ROOF AREA # Box D (24B)
2320 sm
100 -YR FLOW
Qp (l/s)

Area(ha)=	0.2320	STORMWATER MANAGEMENT Qm =				10.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
50	64.0	41.2	10.00	31.2	93.74	
52	62.1	40.1	10.00	30.1	93.84	
54	60.4	39.0	10.00	29.0	93.89	
56	58.8	37.9	10.00	27.9	93.90	
58	57.3	37.0	10.00	27.0	93.86	
60	55.9	36.0	10.00	26.0	93.78	
62	54.5	35.2	10.00	25.2	93.66	
64	53.3	34.4	10.00	24.4	93.51	
66	52.0	33.6	10.00	23.6	93.33	
68	50.9	32.8	10.00	22.8	93.11	
70	49.8	32.1	10.00	22.1	92.87	
72	48.7	31.4	10.00	21.4	92.60	

<=== Required volume for roof storage

Req. Storage volume 93.90 m3
Average depth 0.040 m

ROOF AREA # Box E (25B)
4260 sm
100 -YR FLOW
Qp (l/s)

Area(ha)=	0.4260	STORMWATER MANAGEMENT Qm =				20.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
44	70.2	83.1	20.00	63.1	166.62	
46	68.0	80.5	20.00	60.5	166.93	
48	65.9	78.0	20.00	58.0	167.13	
50	64.0	75.7	20.00	55.7	167.22	
52	62.1	73.6	20.00	53.6	167.21	
54	60.4	71.6	20.00	51.6	167.10	
56	58.8	69.7	20.00	49.7	166.91	
58	57.3	67.9	20.00	47.9	166.64	
60	55.9	66.2	20.00	46.2	166.30	
62	54.5	64.6	20.00	44.6	165.89	
64	53.3	63.1	20.00	43.1	165.42	
66	52.0	61.6	20.00	41.6	164.88	

<=== Required volume for roof storage

Req. Storage volume 167.22 m3
Average depth 0.039 m

ROOF AREA # CRU A (6D)
1200 sm
100 -YR FLOW
Qp (l/s)

Area(ha)=	0.1200	STORMWATER MANAGEMENT Qm =				3.50 l/s
Cw =	1.00					
Tc		Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i				
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
75	47.3	15.8	3.50	12.3	55.19	
77	46.3	15.5	3.50	12.0	55.22	
79	45.4	15.2	3.50	11.7	55.24	
81	44.6	14.9	3.50	11.4	55.25	
83	43.7	14.6	3.50	11.1	55.24	
85	43.0	14.3	3.50	10.8	55.23	
87	42.2	14.1	3.50	10.6	55.21	
89	41.5	13.8	3.50	10.3	55.18	
91	40.8	13.6	3.50	10.1	55.14	
93	40.1	13.4	3.50	9.9	55.09	
95	39.4	13.2	3.50	9.7	55.04	
97	38.8	12.9	3.50	9.4	54.97	

<=== Required volume for roof storage

Req. Storage volume 55.25 m3
Average depth 0.046 m

ROOF AREA # CRU B-2 (22A)
920 sm
100 -YR FLOW
Qp (l/s)

Updated March 2019

Area(ha)=	0.0920	STORMWATER MANAGEMENT Qm =				2.00 l/s
Cw =	1.00					
Tc		Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i				
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
102	37.3	9.5	2.00	7.5	46.19	
104	36.8	9.4	2.00	7.4	46.20	
106	36.2	9.3	2.00	7.3	46.21	
108	35.7	9.1	2.00	7.1	46.22	
110	35.2	9.0	2.00	7.0	46.22	
112	34.7	8.9	2.00	6.9	46.22	
114	34.2	8.8	2.00	6.8	46.21	
116	33.8	8.6	2.00	6.6	46.21	
118	33.3	8.5	2.00	6.5	46.19	
120	32.9	8.4	2.00	6.4	46.17	
122	32.5	8.3	2.00	6.3	46.15	
124	32.1	8.2	2.00	6.2	46.13	

<=== Required volume for roof storage

Req. Storage volume 46.22 m3
Average depth 0.050 m

ROOF AREA # CRU B-1 (26A)
830 sm
100 -YR FLOW
Qp (l/s)

Area(ha)=	0.0830	STORMWATER MANAGEMENT Qm =				2.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
92	40.4	9.3	2.00	7.3	40.44	
94	39.8	9.2	2.00	7.2	40.46	
96	39.1	9.0	2.00	7.0	40.47	
98	38.5	8.9	2.00	6.9	40.47	
100	37.9	8.7	2.00	6.7	40.47	
102	37.3	8.6	2.00	6.6	40.47	
104	36.8	8.5	2.00	6.5	40.46	
106	36.2	8.4	2.00	6.4	40.45	
108	35.7	8.2	2.00	6.2	40.43	
110	35.2	8.1	2.00	6.1	40.41	
112	34.7	8.0	2.00	6.0	40.38	
114	34.2	7.9	2.00	5.9	40.36	

<=== Required volume for roof storage

Req. Storage volume 40.47 m3
Average depth 0.049 m

ROOF AREA # Pad A (2B)
1570 sm
100 -YR FLOW
Qp (l/s)

Area(ha)=	0.1570	STORMWATER MANAGEMENT Qm =				4.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
89	41.5	18.1	4.00	14.1	75.28	
91	40.8	17.8	4.00	13.8	75.30	
93	40.1	17.5	4.00	13.5	75.31	
95	39.4	17.2	4.00	13.2	75.31	
97	38.8	16.9	4.00	12.9	75.29	
99	38.2	16.7	4.00	12.7	75.27	
101	37.6	16.4	4.00	12.4	75.24	
103	37.0	16.2	4.00	12.2	75.20	
105	36.5	15.9	4.00	11.9	75.16	
107	36.0	15.7	4.00	11.7	75.10	
109	35.5	15.5	4.00	11.5	75.04	
111	35.0	15.3	4.00	11.3	74.97	

<=== Required volume for roof storage

Req. Storage volume 75.31 m3
Average depth 0.048 m

ROOF AREA # Pad B (6C)
620 sm
100 -YR FLOW
Qp (l/s)

Updated March 2019

Area(ha)=	0.0620	STORMWATER MANAGEMENT Qm =				3.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
43	71.4	12.3	3.00	9.3	23.99	
45	69.1	11.9	3.00	8.9	24.03	
47	66.9	11.5	3.00	8.5	24.06	
49	64.9	11.2	3.00	8.2	24.07	
51	63.0	10.9	3.00	7.9	24.06	
53	61.3	10.6	3.00	7.6	24.05	
55	59.6	10.3	3.00	7.3	24.01	
57	58.1	10.0	3.00	7.0	23.97	
59	56.6	9.8	3.00	6.8	23.91	
61	55.2	9.5	3.00	6.5	23.85	
63	53.9	9.3	3.00	6.3	23.77	
65	52.6	9.1	3.00	6.1	23.69	

<=== Required volume for roof storage

Req. Storage volume 24.07 m3
Average depth 0.039 m

ROOF AREA # Pad C (6B)
620 sm
100 -YR FLOW
Qp (l/s)

Area(ha)=	0.0620	STORMWATER MANAGEMENT Qm =				3.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
43	71.4	12.3	3.00	9.3	23.99	
45	69.1	11.9	3.00	8.9	24.03	
47	66.9	11.5	3.00	8.5	24.06	
49	64.9	11.2	3.00	8.2	24.07	
51	63.0	10.9	3.00	7.9	24.06	
53	61.3	10.6	3.00	7.6	24.05	
55	59.6	10.3	3.00	7.3	24.01	
57	58.1	10.0	3.00	7.0	23.97	
59	56.6	9.8	3.00	6.8	23.91	
61	55.2	9.5	3.00	6.5	23.85	
63	53.9	9.3	3.00	6.3	23.77	
65	52.6	9.1	3.00	6.1	23.69	

<=== Required volume for roof storage

Req. Storage volume 24.07 m3
Average depth 0.039 m

ROOF AREA # Pad D (9C)
450 sm
100 -YR FLOW
Qp (l/s)

Area(ha)=	0.0450	STORMWATER MANAGEMENT Qm =				3.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
31	89.8	11.2	3.00	8.2	15.32	
33	86.0	10.8	3.00	7.8	15.37	
35	82.6	10.3	3.00	7.3	15.39	
37	79.4	9.9	3.00	6.9	15.40	
39	76.5	9.6	3.00	6.6	15.38	
41	73.8	9.2	3.00	6.2	15.34	
43	71.4	8.9	3.00	5.9	15.29	
45	69.1	8.6	3.00	5.6	15.22	
47	66.9	8.4	3.00	5.4	15.14	
49	64.9	8.1	3.00	5.1	15.05	

<=== Required volume for roof storage

Req. Storage volume 15.40 m3
Average depth 0.034 m

ROOF AREA # Pad E (9B)
251 sm
100 -YR FLOW
Qp (l/s)

Updated Feb 2017

Area(ha)=	0.0251	STORMWATER MANAGEMENT Qm =				2.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
25	103.8	7.2	2.00	5.2	7.87	
27	98.7	6.9	2.00	4.9	7.91	
29	94.0	6.6	2.00	4.6	7.93	
31	89.8	6.3	2.00	4.3	7.94	
33	86.0	6.0	2.00	4.0	7.93	
35	82.6	5.8	2.00	3.8	7.90	
37	79.4	5.5	2.00	3.5	7.86	
39	76.5	5.3	2.00	3.3	7.81	
41	73.8	5.2	2.00	3.2	7.75	

<=== Required volume for roof storage

Req. Storage volume 7.94 m3
Average depth 0.032 m

ROOF AREA # Pad F (7B)
416 sm
100 -YR FLOW
Qp (l/s)

Updated Nov/2012

Area(ha)=	0.0416	STORMWATER MANAGEMENT Qm =				3.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
27	98.7	11.4	3.00	8.4	13.62	
29	94.0	10.9	3.00	7.9	13.70	
31	89.8	10.4	3.00	7.4	13.74	
33	86.0	9.9	3.00	6.9	13.76	<=== Required volume for roof storage
35	82.6	9.6	3.00	6.6	13.76	
37	79.4	9.2	3.00	6.2	13.73	
39	76.5	8.8	3.00	5.8	13.69	
41	73.8	8.5	3.00	5.5	13.62	
43	71.4	8.3	3.00	5.3	13.55	
45	69.1	8.0	3.00	5.0	13.46	

Req. Storage volume 13.76 m3
Average depth 0.033 m

ROOF AREA # Pad G (7C)
490 sm
100 -YR FLOW
Qp (l/s)

Area(ha)=	0.0490	STORMWATER MANAGEMENT Qm =				3.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
33	86.0	11.7	3.00	8.7	17.26	
35	82.6	11.2	3.00	8.2	17.32	
37	79.4	10.8	3.00	7.8	17.36	
39	76.5	10.4	3.00	7.4	17.37	<=== Required volume for roof storage
41	73.8	10.1	3.00	7.1	17.36	
43	71.4	9.7	3.00	6.7	17.34	
45	69.1	9.4	3.00	6.4	17.30	
47	66.9	9.1	3.00	6.1	17.24	
49	64.9	8.8	3.00	5.8	17.17	
51	63.0	8.6	3.00	5.6	17.09	
53	61.3	8.3	3.00	5.3	17.00	
55	59.6	8.1	3.00	5.1	16.90	

Req. Storage volume 17.37 m3
Average depth 0.035 m

ROOF AREA BLDG 1 (2A)
1040 sm
100 -YR FLOW
Qp (l/s)

Updated Feb 2017

Area(ha)=	0.1040	STORMWATER MANAGEMENT Qm =				2.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
117	33.6	9.7	2.00	7.7	54.06	
119	33.1	9.6	2.00	7.6	54.07	
121	32.7	9.4	2.00	7.4	54.08	
123	32.3	9.3	2.00	7.3	54.09	
125	31.9	9.2	2.00	7.2	54.09	
127	31.5	9.1	2.00	7.1	54.09	
129	31.1	9.0	2.00	7.0	54.08	
131	30.7	8.9	2.00	6.9	54.08	
133	30.4	8.8	2.00	6.8	54.06	
135	30.0	8.7	2.00	6.7	54.05	

<=== Required volume for roof storage

Req. Storage volume **54.09** m3
Average depth **0.052** m

ROOF AREA BLDG 2 (8C)
385 sm
100 -YR FLOW
Qp (l/s)

Updated March 2019

Area(ha)=	0.0385	STORMWATER MANAGEMENT Qm =				2.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
40	75.1	8.0	2.00	6.0	14.50	
42	72.6	7.8	2.00	5.8	14.53	
44	70.2	7.5	2.00	5.5	14.55	
46	68.0	7.3	2.00	5.3	14.56	
48	65.9	7.1	2.00	5.1	14.55	
50	64.0	6.8	2.00	4.8	14.54	
52	62.1	6.7	2.00	4.7	14.51	
54	60.4	6.5	2.00	4.5	14.48	
56	58.8	6.3	2.00	4.3	14.44	
58	57.3	6.1	2.00	4.1	14.39	
60	55.9	6.0	2.00	4.0	14.34	
62	54.5	5.8	2.00	3.8	14.28	

<=== Required volume for roof storage

Req. Storage volume **14.56** m3
Average depth **0.038** m

PARKING LOT Area #1 (1A,B,C)
3400 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 21 l/s

Area(ha)=	0.3400	STORMWATER MANAGEMENT Qm = 21.00 l/s			
Cw =	1.00				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
31	89.8	84.9	21.00	63.9	118.86
33	86.0	81.3	21.00	60.3	119.43
35	82.6	78.1	21.00	57.1	119.81
37	79.4	75.1	21.00	54.1	120.02
39	76.5	72.3	21.00	51.3	120.09
41	73.8	69.8	21.00	48.8	120.01
43	71.4	67.4	21.00	46.4	119.82
45	69.1	65.3	21.00	44.3	119.52
47	66.9	63.2	21.00	42.2	119.12
49	64.9	61.3	21.00	40.3	118.63
50	64.0	60.4	21.00	39.4	118.35

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
18	1.45	0.52
19	1.50	0.54
Total:		1.06

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CBMH31 - CB18	50.00	0.25	2.45
CBMH31 - CB19	35.90	0.30	2.54
Total:			4.99

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
31	2.17	2.45
Total:		2.45

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
1A	481.00	0.25	40.08
1B	814.00	0.25	67.83
1C	201.00	0.70	46.90
Total:			154.82

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 2 10.96
Total Storage required 131.04
Total Surface Storage provided 154.82

ICD use Hydrovex 125VHV 21l/s @ 2.77m head, or approved equal

PARKING LOT Area #2
970 sm
100 -YR FLOW
Qp (l/s)

Updated March/2012

Flow restricted to 13 l/s

Area(ha)=	0.0970	STORMWATER MANAGEMENT Qm =				13.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
16.5	135.0	36.4	13.00	23.4	23.18	
17	132.6	35.8	13.00	22.8	23.22	
17.5	130.3	35.1	13.00	22.1	23.25	
18	128.1	34.5	13.00	21.5	23.26	
18.5	125.9	34.0	13.00	21.0	23.27	
19	123.9	33.4	13.00	20.4	23.26	
19.5	121.9	32.9	13.00	19.9	23.24	
20	120.0	32.3	13.00	19.3	23.21	
20.5	118.1	31.8	13.00	18.8	23.18	
21	116.3	31.4	13.00	18.4	23.13	
21.5	114.6	30.9	13.00	17.9	23.08	

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
17	1.67	0.60
16	1.25	0.45
Total:		1.05

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB16 - CB17	6.00	0.20	0.19
Total:			0.19

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
2A	36.00	0.07	0.84
2B	22.00	0.07	0.51
Total:			1.35

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 23.27
Total Surface Storage provided 1.35
Overflow to area 1 10.96
Overflow to area 15F 10.96

ICD use Hydrovex 100VHV 13l/s @ 1.62m head, or approved equal

PARKING LOT Area #3
550 sm
100 -YR FLOW
Qp (l/s)

Updated March/2012

Flow restricted to 13 l/s

Area(ha)=	0.0550	STORMWATER MANAGEMENT Qm =				13.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
9	188.3	28.8	13.00	15.8	8.52	
9.5	183.3	28.0	13.00	15.0	8.56	
10	178.6	27.3	13.00	14.3	8.58	
10.5	174.1	26.6	13.00	13.6	8.58	<=== Required volume for storage on-site
11	169.9	26.0	13.00	13.0	8.57	
11.5	165.9	25.4	13.00	12.4	8.53	
12	162.1	24.8	13.00	11.8	8.49	
12.5	158.5	24.2	13.00	11.2	8.43	
13	155.1	23.7	13.00	10.7	8.36	
13.5	151.8	23.2	13.00	10.2	8.28	
14	148.7	22.7	13.00	9.7	8.18	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
14	1.30	0.47
15	1.65	0.59
Total:		1.06

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB14 - CB15	6.00	0.20	0.19
Total:			0.19

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA (SM)	Depth (m)	Storage (m3)
3A	38.00	0.07	0.89
3B	50.00	0.07	1.17
Total:			2.05

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 4 **10.61**
Total Storage required **19.19**
Total Surface Storage provided **2.05**
Overflow to area 15F **17.13**

ICD use Hydrovex 100VHV 13l/s @ 1.50m head, or approved equal

PARKING LOT Area #4
830 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 10 l/s

Area(ha)=	0.0830	STORMWATER MANAGEMENT Qm = 10.00 l/s			
Cw =	1.00				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
17	132.6	30.6	10.00	20.6	21.01
18	128.1	29.6	10.00	19.6	21.12
19	123.9	28.6	10.00	18.6	21.18
20	120.0	27.7	10.00	17.7	21.21
21	116.3	26.8	10.00	16.8	21.21
22	112.9	26.0	10.00	16.0	21.18
23	109.7	25.3	10.00	15.3	21.12
24	106.7	24.6	10.00	14.6	21.04
25	103.8	24.0	10.00	14.0	20.94
26	101.2	23.3	10.00	13.3	20.82
27	98.7	22.8	10.00	12.8	20.68

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
20	1.60	0.58
21	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB21 - CB20	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
Total:			0.00

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 21.21
Total Surface Storage provided 0.00
Overflow to area 3 10.61
Overflow to area 6 10.61

ICD use Hydrovex 100VHV 10l/s @ 1.48m head, or approved equal

PARKING LOT Area #5 (5A,B,C)
3320 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 35 l/s

Area(ha)=	0.3320	STORMWATER MANAGEMENT Qm = 35.00 l/s			
Cw =	1.00				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
15	142.9	131.9	35.00	96.9	87.20
17	132.6	122.4	35.00	87.4	89.16
19	123.9	114.3	35.00	79.3	90.43
21	116.3	107.3	35.00	72.3	91.15
23	109.7	101.2	35.00	66.2	91.40
25	103.8	95.8	35.00	60.8	91.27
27	98.7	91.1	35.00	56.1	90.82
29	94.0	86.8	35.00	51.8	90.08
31	89.8	82.9	35.00	47.9	89.11
33	86.0	79.4	35.00	44.4	87.92
34	84.3	77.8	35.00	42.8	87.26

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
24	1.50	0.54
53	1.55	0.56
Total:		1.10

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB24 - CBMH18	30.40	0.30	2.15
CB53 - CBMH18	33.00	0.30	2.33
Total:			4.48

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
18	2.07	2.34
Total:		2.34

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
5A	468.00	0.30	46.80
5B	383.00	0.30	38.30
5C	336.00	0.30	33.60
Total:			118.70

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 6 25.65
Total Storage required 117.05
Total Surface Storage provided 118.70

ICD use Hydrovex 150VHV 35l/s @ 2.73m head, or approved equal

PARKING LOT Area #6
1490 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 21 l/s

Area(ha)=	0.1490	STORMWATER MANAGEMENT Qm = 21.00 l/s			
Cw =	1.00				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
15	142.9	59.2	21.00	38.2	34.37
16	137.5	57.0	21.00	36.0	34.54
17	132.6	54.9	21.00	33.9	34.62
18	128.1	53.1	21.00	32.1	34.62
19	123.9	51.3	21.00	30.3	34.55
20	120.0	49.7	21.00	28.7	34.42
21	116.3	48.2	21.00	27.2	34.24
22	112.9	46.8	21.00	25.8	34.00
23	109.7	45.4	21.00	24.4	33.72
24	106.7	44.2	21.00	23.2	33.39
25	103.8	43.0	21.00	22.0	33.02

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
22	1.60	0.58
23	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB23 - CB22	6.00	0.20	0.19
Total:			0.19

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
6A	40.00	0.07	0.93
6B	40.00	0.07	0.93
Total:			1.87

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 7A	7.95
Overflow from area 4	10.61
Total Storage required	53.17
Total Surface Storage provided	1.87
Overflow to area 5	25.65
Overflow to area 12	25.65

ICD use Iplex Type A or approved equal

PARKING LOT Area #7A
540 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 5 l/s

Area(ha)=	0.0540	STORMWATER MANAGEMENT Qm = 5.00 l/s			
Cw =	1.00				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
23	109.7	16.5	5.00	11.5	15.82
24	106.7	16.0	5.00	11.0	15.86
25	103.8	15.6	5.00	10.6	15.88
26	101.2	15.2	5.00	10.2	15.89
27	98.7	14.8	5.00	9.8	15.89
28	96.3	14.5	5.00	9.5	15.88
29	94.0	14.1	5.00	9.1	15.86
30	91.9	13.8	5.00	8.8	15.82
31	89.8	13.5	5.00	8.5	15.78
32	87.9	13.2	5.00	8.2	15.73
33	86.0	12.9	5.00	7.9	15.67

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
25	1.60	0.58
26	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB26 - CB25	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
Total:			0.00

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 15.89
Total Surface Storage provided 0.00
Overflow to area 9 7.95
Overflow to area 6 7.95

ICD use Hydrovex 75VHV 5l/s @ 1.41m head, or approved equal

PARKING LOT Area #7D
280 sm
100 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 5 l/s

Area(ha)=	0.0280	STORMWATER MANAGEMENT Qm =				5.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
11	169.9	13.2	5.00	8.2	5.43	
12	162.1	12.6	5.00	7.6	5.49	
13	155.1	12.1	5.00	7.1	5.52	
14	148.7	11.6	5.00	6.6	5.52	<=== Required volume for storage on-site
15	142.9	11.1	5.00	6.1	5.51	
16	137.5	10.7	5.00	5.7	5.48	
17	132.6	10.3	5.00	5.3	5.43	
18	128.1	10.0	5.00	5.0	5.37	
19	123.9	9.6	5.00	4.6	5.29	
20	120.0	9.3	5.00	4.3	5.20	
21	116.3	9.1	5.00	4.1	5.11	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
58	1.60	0.58
59	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB26 - CB25	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
Total:			0.00

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 5.52
Total Surface Storage provided 0.00
Overflow to Hazeldean Road 5.52

ICD use Hydrovex 75VHV 5l/s @ 1.48m head, or approved equal

PARKING LOT Area #8 (A,D,E&F)
2340 sm
100 -YR FLOW
Qp (l/s)

Updated Feb 2017

Flow restricted to 18.5 l/s

Area(ha)=	0.2340	STORMWATER MANAGEMENT Qm = 18.50 l/s			
Cw =	1.00				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
23	109.7	71.4	18.50	52.9	72.93
25	103.8	67.6	18.50	49.1	73.58
27	98.7	64.2	18.50	45.7	74.00
29	94.0	61.2	18.50	42.7	74.23
31	89.8	58.4	18.50	39.9	74.28
33	86.0	56.0	18.50	37.5	74.18
35	82.6	53.7	18.50	35.2	73.96
37	79.4	51.7	18.50	33.2	73.62
39	76.5	49.8	18.50	31.3	73.18
41	73.8	48.0	18.50	29.5	72.64
42	72.6	47.2	18.50	28.7	72.34

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
60	1.73	0.62
61	1.81	0.65
62	1.91	0.69
63	2.01	0.72
Total:		2.69

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB60 to CB62	24.00	0.25	1.18
CB61 to CB62	17.10	0.25	0.84
CB62 to CB63	22.60	0.38	2.50
Total:			4.51

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
8A	794.30	0.30	79.42
8C	127.00	0.25	10.59
8D	68.25	0.10	2.28
Total:			92.29

Overflow from area 8B 0.38
Overflow from area 9 15.06
Overflow from area 14 0.00
Total Storage required 89.72
Total Surface Storage provided 92.29

ICD use Ipex TEMPEST 18.5l/s @ 2.25m head or approved equal

PARKING LOT Area #8B
900 sm
100 -YR FLOW
Qp (l/s)

Updated Nov/2012

Flow restricted to 10 l/s

Area(ha)=	0.0900	STORMWATER MANAGEMENT Qm =				10.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
16	137.5	34.4	10.00	24.4	23.44	
18	128.1	32.0	10.00	22.0	23.81	
20	120.0	30.0	10.00	20.0	24.01	
22	112.9	28.2	10.00	18.2	24.08	<=== Required volume for storage on-site
24	106.7	26.7	10.00	16.7	24.03	
26	101.2	25.3	10.00	15.3	23.89	
28	96.3	24.1	10.00	14.1	23.67	
30	91.9	23.0	10.00	13.0	23.37	
32	87.9	22.0	10.00	12.0	23.02	
34	84.3	21.1	10.00	11.1	22.61	
35	82.6	20.7	10.00	10.7	22.39	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
52	1.45	0.52
Total:		0.52

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
8B	284.43	0.25	23.70
Total:			23.70

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 24.08
Total Surface Storage provided 23.70
Overflow to area 8A 0.38

ICD use Hydrovex 100VHV 10l/s @ 1.55m head, or approved equal

PARKING LOT Area #9A
1200 sm
100 -YR FLOW
Qp (l/s)

Updated Feb 2017

Flow restricted to 21 l/s

Area(ha)=	0.1200	STORMWATER MANAGEMENT Qm =				21.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
11	169.9	56.7	21.00	35.7	23.55	
12	162.1	54.1	21.00	33.1	23.82	
13	155.1	51.7	21.00	30.7	23.98	
14	148.7	49.6	21.00	28.6	24.04	<=== Required volume for storage on-site
15	142.9	47.7	21.00	26.7	24.00	
16	137.5	45.9	21.00	24.9	23.89	
17	132.6	44.2	21.00	23.2	23.71	
18	128.1	42.7	21.00	21.7	23.47	
19	123.9	41.3	21.00	20.3	23.17	
20	120.0	40.0	21.00	19.0	22.82	
21	116.3	38.8	21.00	17.8	22.42	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
27	1.65	0.59
28	1.30	0.47
Total:		1.06

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB28 - CB27	6.00	0.20	0.19
Total:			0.19

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
9A	40.00	0.07	0.93
9B	40.00	0.07	0.93
Total:			1.87

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 7A **7.95**
Total Storage required **31.98**
Total Surface Storage provided **1.87**
Overflow to area 8A **15.06**
Overflow to area 14 **15.06**

ICD use IpeX Type A or approved equal

PARKING LOT Area #11
1730 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 18 l/s

Area(ha)=	0.1730	STORMWATER MANAGEMENT Qm =				18.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
21	116.3	55.9	18.00	37.9	47.79	
22	112.9	54.3	18.00	36.3	47.90	
23	109.7	52.8	18.00	34.8	47.96	
24	106.7	51.3	18.00	33.3	47.96	<=== Required volume for storage on-site
25	103.8	49.9	18.00	31.9	47.92	
26	101.2	48.7	18.00	30.7	47.83	
27	98.7	47.4	18.00	29.4	47.71	
28	96.3	46.3	18.00	28.3	47.55	
29	94.0	45.2	18.00	27.2	47.35	
30	91.9	44.2	18.00	26.2	47.13	
31	89.8	43.2	18.00	25.2	46.88	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
10	1.60	0.58
11	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB11 - CB10	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
11A	150.00	0.15	7.50
11B	108.00	0.15	5.40
Total:			12.90

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 47.96
Total Surface Storage provided 12.90
Overflow to area 16 35.06

ICD use Hydrovex 125VHV 18l/s @ 1.63m head, or approved equal

PARKING LOT Area #12
2040 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 21 l/s

Area(ha)=	0.2040	STORMWATER MANAGEMENT Qm =				21.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
16	137.5	78.0	21.00	57.0	54.73	
18	128.1	72.6	21.00	51.6	55.77	
20	120.0	68.0	21.00	47.0	56.43	
22	112.9	64.0	21.00	43.0	56.78	
24	106.7	60.5	21.00	39.5	56.88	
26	101.2	57.4	21.00	36.4	56.75	
28	96.3	54.6	21.00	33.6	56.45	
30	91.9	52.1	21.00	31.1	55.98	
32	87.9	49.8	21.00	28.8	55.38	
34	84.3	47.8	21.00	26.8	54.65	
35	82.6	46.8	21.00	25.8	54.25	

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
41	1.50	0.54
Total:		0.54

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB41 - 28	19.50	0.30	1.38
Total:			1.38

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
28	2.56	2.89
Total:		2.89

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
12	990.13	0.25	82.51
Total:			82.51

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 6 25.65
 Total Storage required 82.53
 Total Surface Storage provided 82.51

ICD use Ipx Type A or approved equal

PARKING LOT Area #14 (14A,B)
2720 sm
100 -YR FLOW
Qp (l/s)

Updated Feb 2017

Flow restricted to 21 l/s

Area(ha)=	0.2720	STORMWATER MANAGEMENT Qm =				21.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
25	103.8	78.5	21.00	57.5	86.29	
27	98.7	74.6	21.00	53.6	86.84	
29	94.0	71.1	21.00	50.1	87.16	
31	89.8	67.9	21.00	46.9	87.28	
33	86.0	65.1	21.00	44.1	87.23	<=== Required volume for storage on-site
35	82.6	62.4	21.00	41.4	87.03	
37	79.4	60.1	21.00	39.1	86.69	
39	76.5	57.9	21.00	36.9	86.24	
41	73.8	55.8	21.00	34.8	85.68	
43	71.4	54.0	21.00	33.0	85.02	
44	70.2	53.1	21.00	32.1	84.66	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
39	1.57	0.57
40	1.45	0.52
Total:		1.09

IN-LINE STORAGE (Pipe)

Pipe storage				
Structure to Structure	Length	Dia	Storage	
	(m)	(m)	(m3)	
CB40 - 27	44.00	0.25	2.16	
CB39 - 27	21.30	0.38	2.35	
Total:			4.51	

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
27	2.57	2.90
Total:		2.90

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
14A	1343.36	0.25	111.95
14B	140.66	0.25	11.72
Total:			123.67

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 9 15.06
Total Storage required 102.29
Total Surface Storage provided 123.67

ICD use Hydrovex 125VHV 21l/s @ 2.87m head, or approved equal

PARKING LOT Area #15 (15A,B,C,D,E,F)

Updated March/2012

10340 sm	
100 -YR FLOW	
Qp (l/s)	

Flow restricted to 43 l/s

Area(ha)=	1.0340	STORMWATER MANAGEMENT Qm =				43.00 l/s
Cw =	1.00					
Tc		Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i				
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
54	60.4	173.7	43.00	130.7	423.56	
56	58.8	169.1	43.00	126.1	423.76	
58	57.3	164.8	43.00	121.8	423.78	
60	55.9	160.7	43.00	117.7	423.61	
62	54.5	156.8	43.00	113.8	423.28	<=== Required volume for storage on-site
64	53.3	153.1	43.00	110.1	422.80	
66	52.0	149.6	43.00	106.6	422.17	
68	50.9	146.3	43.00	103.3	421.40	
70	49.8	143.1	43.00	100.1	420.51	
72	48.7	140.1	43.00	97.1	419.50	
73	48.2	138.6	43.00	95.6	418.95	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
	1.50	0.54
	1.60	0.58
Total:		1.12

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CBMH9 - CBMH10	34.20	0.60	9.67
CBMH10 - CBMH11	38.60	0.53	8.36
CB8 - CBMH11	38.60	0.30	2.73
CB9 - CBMH11	33.00	0.25	1.62
Total:			22.37

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
	2.42	2.73
	2.35	4.15
	2.14	2.42
Total:		9.31

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
15A	296.00	0.15	14.80
15B	1000.00	0.30	100.00
15C	1055.00	0.30	105.50
15D	1000.00	0.30	100.00
15E	900.00	0.30	90.00
15F	463.98	0.20	30.93
Total:			441.23

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 2	10.96
Overflow from area 3	17.13
Total Storage required	440.42
Total Storage provided	441.23

ICD use IPEX TEMPEST 43l/s @ 3.06m head, or approved equal

PARKING LOT Area #16
1050 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 29 l/s

Area(ha)=	0.1050	STORMWATER MANAGEMENT Qm = 29.00 l/s			
Cw =	1.00				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
6	226.0	66.0	29.00	37.0	13.31
7	211.7	61.8	29.00	32.8	13.77
8	199.2	58.1	29.00	29.1	13.99
9	188.3	55.0	29.00	26.0	14.01
10	178.6	52.1	29.00	23.1	13.87
11	169.9	49.6	29.00	20.6	13.59
12	162.1	47.3	29.00	18.3	13.20
13	155.1	45.3	29.00	16.3	12.70
14	148.7	43.4	29.00	14.4	12.11
15	142.9	41.7	29.00	12.7	11.44
16	137.5	40.2	29.00	11.2	10.70

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
6	1.60	0.58
7	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB6 - CB7	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
16A	166.37	0.15	8.32
16B	204.14	0.15	10.21
Total:			18.53

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 15 **0.00**
Overflow from area 11 **35.06**
Total Storage required **49.07**
Total Surface Storage provided **18.53**
Overflow to area 17 **30.55**

ICD use Hydrovex 150VHV 29l/s @ 1.62m head, or approved equal

PARKING LOT Area #17 (17 C,D,E,F)
7090 sm
100 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 82 l/s

Area(ha)=	0.7090	STORMWATER MANAGEMENT Qm =				82.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
13	155.1	305.7	82.00	223.7	174.50	
15	142.9	281.6	82.00	199.6	179.68	
17	132.6	261.4	82.00	179.4	183.00	
19	123.9	244.1	82.00	162.1	184.85	
21	116.3	229.2	82.00	147.2	185.50	<=== Required volume for storage on-site
23	109.7	216.2	82.00	134.2	185.17	
25	103.8	204.7	82.00	122.7	184.03	
27	98.7	194.5	82.00	112.5	182.19	
29	94.0	185.3	82.00	103.3	179.75	
31	89.8	177.1	82.00	95.1	176.80	
32	87.9	173.2	82.00	91.2	175.15	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
42	1.47	0.53
43	1.45	0.52
44	1.45	0.52
45	1.50	0.54
Total:		2.11

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB42 - CBMH29	34.20	0.25	1.68
CB 43 - CBMH29	34.20	0.25	1.68
CBMH29 - CBMH30	38.90	0.45	6.19
CB44 - CBMH30	34.20	0.25	1.68
CB45 - CBMH30	34.20	0.30	2.42
Total:			13.64

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
29	2.50	2.83
30	2.34	2.64
Total:		5.47

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
17A	481.30	0.20	32.09
17B	397.16	0.20	26.48
17C	278.03	0.20	18.54
17D	739.91	0.20	49.33
17E	785.48	0.20	52.37
17F	369.62	0.20	24.64
Total:			203.43

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 16 30.55
Total Storage required 216.05
Total Surface Storage provided 203.43
Overflow to area 19 12.62

ICD use Hydrovex 250VHV 82l/s @ 2.97m head, or approved equal

PARKING LOT Area #18
1830 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 21 l/s

Area(ha)=	0.1830	STORMWATER MANAGEMENT Qm = 21.00 l/s			
Cw =	1.00				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
18	128.1	65.2	21.00	44.2	47.69
19	123.9	63.0	21.00	42.0	47.90
20	120.0	61.0	21.00	40.0	48.03
21	116.3	59.2	21.00	38.2	48.09
22	112.9	57.4	21.00	36.4	48.08
23	109.7	55.8	21.00	34.8	48.02
24	106.7	54.3	21.00	33.3	47.91
25	103.8	52.8	21.00	31.8	47.75
26	101.2	51.5	21.00	30.5	47.54
27	98.7	50.2	21.00	29.2	47.29
28	96.3	49.0	21.00	28.0	47.00

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
35	1.60	0.58
36	1.30	0.47
Total:		1.04

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB36 - CB35	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA (SM)	Depth (m)	Storage (m3)
18A	156.00	0.25	13.00
18B	156.00	0.25	13.00
Total:			26.00

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 48.09
Total Surface Storage provided 26.00
Overflow to area 19 22.09

ICD use IpeX Type A or approved equal

PARKING LOT Area #19
770 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 29 l/s

Area(ha)=	0.0770	STORMWATER MANAGEMENT Qm = 29.00 l/s			
Cw =	1.00				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
3	286.0	61.2	29.00	32.2	5.80
4	262.4	56.2	29.00	27.2	6.52
5	242.7	52.0	29.00	23.0	6.89
6	226.0	48.4	29.00	19.4	6.98
7	211.7	45.3	29.00	16.3	6.85
8	199.2	42.6	29.00	13.6	6.55
9	188.3	40.3	29.00	11.3	6.10
10	178.6	38.2	29.00	9.2	5.53
11	169.9	36.4	29.00	7.4	4.86
12	162.1	34.7	29.00	5.7	4.11
13	155.1	33.2	29.00	4.2	3.28

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
33	1.60	0.58
34	1.40	0.50
Total:		1.08

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CB34 - CB33	8.00	0.20	0.25
Total:			0.25

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
19A	155.56	0.25	12.96
19B	187.08	0.25	15.59
Total:			28.55

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 18	22.09
Overflow from area 17	12.62
Total Storage required	41.68
Total Storage provided	29.63
Overflow to area 20	12.05

ICD use Hydrovex 150VHV 29l/s @ 1.72m head, or approved equal

PARKING LOT Area #20 (20A,B,C,D)
6400 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 48 l/s

Area(ha)=	0.6400	STORMWATER MANAGEMENT Qm = 48.00 l/s			
Cw =	1.00				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
25	103.8	184.8	48.00	136.8	205.15
27	98.7	175.5	48.00	127.5	206.61
29	94.0	167.3	48.00	119.3	207.53
31	89.8	159.8	48.00	111.8	207.99
33	86.0	153.1	48.00	105.1	208.04
35	82.6	146.9	48.00	98.9	207.74
37	79.4	141.3	48.00	93.3	207.12
39	76.5	136.1	48.00	88.1	206.22
41	73.8	131.4	48.00	83.4	205.07
43	71.4	127.0	48.00	79.0	203.69
44	70.2	124.9	48.00	76.9	202.92

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
31	1.45	0.52
32	1.45	0.52
Total:		0.52

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
CBMH32 - CBMH24	42.10	0.60	11.90
CBMH24 - CBMH25	39.00	0.45	6.20
CB32 - CBMH25	42.80	0.25	2.10
CB31 - CBMH25	42.80	0.25	2.10
Total:			22.31

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
24	2.59	2.93
25 (1.5m dia)	2.30	4.06
32	2.71	3.06
Total:		10.05

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
20A	217.96	0.20	14.53
20B	2029.44	0.25	169.12
20C	523.33	0.20	34.89
20D	468.54	0.20	31.24
Total:			249.78

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 19 12.05
Total Storage required 220.09
Total Surface Storage provided 249.78

ICD use Hydrovex 200VHV 48l/s @ 3.14m head, or approved equal

PARKING LOT Area #21
1910 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 10 l/s

Area(ha)=	0.1910	STORMWATER MANAGEMENT Qm =				10.00 l/s
Cw =	0.75					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
32	87.9	35.0	10.00	25.0	48.00	
33	86.0	34.3	10.00	24.3	48.04	
34	84.3	33.6	10.00	23.6	48.06	
35	82.6	32.9	10.00	22.9	48.06	<=== Required volume for storage on-site
36	81.0	32.2	10.00	22.2	48.04	
37	79.4	31.6	10.00	21.6	48.01	
38	77.9	31.0	10.00	21.0	47.96	
39	76.5	30.5	10.00	20.5	47.90	
40	75.1	29.9	10.00	19.9	47.82	
41	73.8	29.4	10.00	19.4	47.73	
42	72.6	28.9	10.00	18.9	47.63	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
2	1.40	0.50
Total:		0.50

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
21	191.58	0.25	15.97
Total:			15.97

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 48.06
Total Surface Storage provided 15.97
Overflow to Area 23 32.09

ICD use Hydrovex 100VHV 10l/s @ 1.65m head, or approved equal

PARKING LOT Area #21A
270 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 5 l/s

Area(ha)=	0.0270	STORMWATER MANAGEMENT Qm =				5.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
10	178.6	13.4	5.00	8.4	5.04	
11	169.9	12.8	5.00	7.8	5.12	
12	162.1	12.2	5.00	7.2	5.16	
13	155.1	11.6	5.00	6.6	5.18	<=== Required volume for storage on-site
14	148.7	11.2	5.00	6.2	5.18	
15	142.9	10.7	5.00	5.7	5.15	
16	137.5	10.3	5.00	5.3	5.11	
17	132.6	10.0	5.00	5.0	5.05	
18	128.1	9.6	5.00	4.6	4.98	
19	123.9	9.3	5.00	4.3	4.90	
20	120.0	9.0	5.00	4.0	4.80	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
1	1.40	0.50
Total:		0.50

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA (SM)	Depth (m)	Storage (m3)
21A	60.88	0.23	4.67
Total:			4.67

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 5.18
Total Storage provided 5.17

ICD use Hydrovex 75VHV 5l/s @ 1.45m head, or approved equal

PARKING LOT Area #22
1720 sm
100 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 12 l/s

Area(ha)=	0.1720	STORMWATER MANAGEMENT Qm = 12.00 l/s			
Cw =	1.00				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
31	89.8	43.0	12.00	31.0	57.57
32	87.9	42.0	12.00	30.0	57.64
33	86.0	41.1	12.00	29.1	57.69
34	84.3	40.3	12.00	28.3	57.72
35	82.6	39.5	12.00	27.5	57.72
36	81.0	38.7	12.00	26.7	57.70
37	79.4	38.0	12.00	26.0	57.66
38	77.9	37.3	12.00	25.3	57.60
39	76.5	36.6	12.00	24.6	57.53
40	75.1	35.9	12.00	23.9	57.44
41	73.8	35.3	12.00	23.3	57.33

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
55	1.26	0.45
Total:		0.45

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
22	360.00	0.25	30.00
Total:			30.00

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from Area 26 **2.18**
Total Storage required **59.89**
Total Storage provided **30.00**

ICD use Hydrovex 100VHV 12l/s @ 1.57m head, or approved equal

PARKING LOT Area #23
1410 sm
100 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 21 l/s

Area(ha)=	0.1410	STORMWATER MANAGEMENT Qm =				21.00 l/s
Cw =	0.75					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
9	188.3	55.3	21.00	34.3	18.55	
10	178.6	52.5	21.00	31.5	18.90	
11	169.9	50.0	21.00	29.0	19.11	
12	162.1	47.7	21.00	26.7	19.20	<=== Required volume for storage on-site
13	155.1	45.6	21.00	24.6	19.19	
14	148.7	43.7	21.00	22.7	19.09	
15	142.9	42.0	21.00	21.0	18.91	
16	137.5	40.4	21.00	19.4	18.66	
17	132.6	39.0	21.00	18.0	18.35	
18	128.1	37.7	21.00	16.7	17.99	
19	123.9	36.4	21.00	15.4	17.57	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
3	1.40	0.50
Total:		0.50

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
23	562.42	0.25	46.87
Total:			46.87

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from Area 21 32.09
Overflow from Area 23B 22.03
Total Storage required 73.32
Total Surface Storage provided 46.87
Overflow to Area 24 26.46

ICD IPEX type A, or approved equal

PARKING LOT Area #23B
1430 sm
100 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 9 l/s

Area(ha)=	0.1430	STORMWATER MANAGEMENT Qm =				4.50 l/s
Cw =	1.00					
Tc		Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i				
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
73	48.2	19.2	4.50	14.7	64.28	
74	47.7	19.0	4.50	14.5	64.28	
75	47.3	18.8	4.50	14.3	64.29	
76	46.8	18.6	4.50	14.1	64.29	<=== Required volume for storage on-site
77	46.3	18.4	4.50	13.9	64.28	
78	45.9	18.2	4.50	13.7	64.28	
79	45.4	18.1	4.50	13.6	64.27	
80	45.0	17.9	4.50	13.4	64.25	
81	44.6	17.7	4.50	13.2	64.23	
82	44.2	17.6	4.50	13.1	64.21	
83	43.7	17.4	4.50	12.9	64.19	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
	Total:	0.00

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Oversized Subdrains	0.00	0.45	0.00
	Total:		0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
ADS (22m3 provided)		22.00
	Total:	22.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
23B	535.86	0.30	53.59
	Total:		53.59

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 23C	33.33
Total Storage required	97.62
Total Storage provided	75.59
Overflow to Area 23	22.03

ICD use Hydrovex 100VHV-1 9l/s @ 1.65m head (pond 101.65, ICD invert 99.90 (CL 100.00)), or approved equal

PARKING LOT Area #23C
2180 sm
100 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 9 l/s

Area(ha)=	0.2180	STORMWATER MANAGEMENT Qm =			4.50 l/s
Cw =	1.00				
Tc	Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i	(l/s)	(l/s)	(m3)
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
113	34.5	20.9	4.50	16.4	111.14
114	34.2	20.7	4.50	16.2	111.14
115	34.0	20.6	4.50	16.1	111.15
116	33.8	20.5	4.50	16.0	111.15
117	33.6	20.3	4.50	15.8	111.15
118	33.3	20.2	4.50	15.7	111.15
119	33.1	20.1	4.50	15.6	111.14
120	32.9	19.9	4.50	15.4	111.14
121	32.7	19.8	4.50	15.3	111.13
122	32.5	19.7	4.50	15.2	111.12
123	32.3	19.6	4.50	15.1	111.10

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
	Total:	0.00

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Oversized Subdrains	0.00	0.45	0.00
	Total:		0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
ADS (22m3 provided)		22.00
	Total:	22.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
23C	558.21	0.30	55.82
	Total:		55.82

Total Storage required 111.15
Total Storage provided 77.82
Overflow to Area 23B 33.33

ICD use Hydrovex 100VHV-1 9l/s @ 1.65m head (pond 101.65, ICD invert 99.90 (CL 100.00)), or approved equal

PARKING LOT Area #24
1220 sm
100 -YR FLOW
Qp (l/s)

Updated March 2019

Flow restricted to 35 l/s

Area(ha)=	0.1220	STORMWATER MANAGEMENT Qm = 35.00 l/s			
Cw =	0.88				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
4	262.4	78.3	35.00	43.3	10.40
5	242.7	72.4	35.00	37.4	11.23
6	226.0	67.5	35.00	32.5	11.68
7	211.7	63.2	35.00	28.2	11.83
8	199.2	59.5	35.00	24.5	11.74
9	188.3	56.2	35.00	21.2	11.44
10	178.6	53.3	35.00	18.3	10.98
11	169.9	50.7	35.00	15.7	10.37
12	162.1	48.4	35.00	13.4	9.64
13	155.1	46.3	35.00	11.3	8.81
14	148.7	44.4	35.00	9.4	7.89

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
4	1.53	0.55
Total:		0.55

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Subdrains	6.00	0.25	0.29
Total:			0.29

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
24	489.88	0.25	40.82
Total:			40.82

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Overflow from area 23	26.46
Overflow from area 25	0.00
Total Storage required	38.29
Total Surface Storage provided	41.67
Overflow offsite	-3.38

ICD use Hydrovex 150VHV 35l/s @ 1.68m head, or approved equal

PARKING LOT Area #24A
200 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 3 l/s

Area(ha)=	0.0200	STORMWATER MANAGEMENT Qm =				3.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
13	155.1	8.6	3.00	5.6	4.39	
14	148.7	8.3	3.00	5.3	4.43	
15	142.9	7.9	3.00	4.9	4.45	
16	137.5	7.6	3.00	4.6	4.46	<=== Required volume for storage on-site
17	132.6	7.4	3.00	4.4	4.46	
18	128.1	7.1	3.00	4.1	4.45	
19	123.9	6.9	3.00	3.9	4.43	
20	120.0	6.7	3.00	3.7	4.40	
21	116.3	6.5	3.00	3.5	4.37	
22	112.9	6.3	3.00	3.3	4.32	
23	109.7	6.1	3.00	3.1	4.28	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
56	1.24	0.45
Total:		0.45

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
23C	74.40	0.30	7.44
Total:			7.44

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 4.46
Total Surface Storage provided 7.44

ICD use Hydrovex 50VHV 3l/s @ 1.44m head, or approved equal

PARKING LOT Area #25
1820 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 27 l/s

Area(ha)=	0.1820	STORMWATER MANAGEMENT Qm = 27.00 l/s			
Cw =	0.87				
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)
12	162.1	71.4	27.00	44.4	31.95
13	155.1	68.3	27.00	41.3	32.20
14	148.7	65.5	27.00	38.5	32.31
15	142.9	62.9	27.00	35.9	32.31
16	137.5	60.5	27.00	33.5	32.21
17	132.6	58.4	27.00	31.4	32.01
18	128.1	56.4	27.00	29.4	31.73
19	123.9	54.5	27.00	27.5	31.38
20	120.0	52.8	27.00	25.8	30.96
21	116.3	51.2	27.00	24.2	30.48
22	112.9	49.7	27.00	22.7	29.95

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
5	1.60	0.58
Total:		0.58

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA (SM)	Depth (m)	Storage (m3)
25	584.32	0.17	33.11
Total:			33.11

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 32.31
Total Surface Storage provided 33.11

ICD use Hydrovex 150VHV 27l/s @ 1.60m head, or approved equal

PARKING LOT Area #25A
280 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 2 l/s

Area(ha)=	0.0280	STORMWATER MANAGEMENT Qm =				2.00 l/s
Cw =	1.00					
Tc Variable	i	Qp 2.78 x Area x c x i	Qm	Qp-Qm	Volume	
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
30	91.9	7.2	2.00	5.2	9.27	
31	89.8	7.0	2.00	5.0	9.29	
32	87.9	6.8	2.00	4.8	9.29	
33	86.0	6.7	2.00	4.7	9.30	<=== Required volume for storage on-site
34	84.3	6.6	2.00	4.6	9.30	
35	82.6	6.4	2.00	4.4	9.30	
36	81.0	6.3	2.00	4.3	9.29	
37	79.4	6.2	2.00	4.2	9.28	
38	77.9	6.1	2.00	4.1	9.27	
39	76.5	6.0	2.00	4.0	9.26	
40	75.1	5.8	3.00	2.8	6.84	

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
57	1.22	0.44
Total:		0.44

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
25A	121.23	0.30	12.12
Total:			12.12

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 9.30
Total Surface Storage provided 12.12

ICD use Hydrovex 50VHV 2l/s @ 1.42m head, or approved equal

PARKING LOT Area #26
620 sm
100 -YR FLOW
Qp (l/s)

Flow restricted to 5 l/s

Area(ha)=	0.0620	STORMWATER MANAGEMENT Qm =				5.00 l/s
Cw =	1.00					
Tc		Qp	Qm	Qp-Qm	Volume	
Variable	i	2.78 x Area x c x i				
(min)	(mm/hour)	(l/s)	(l/s)	(l/s)	(m3)	
27	98.7	17.0	5.00	12.0	19.45	
28	96.3	16.6	5.00	11.6	19.48	
29	94.0	16.2	5.00	11.2	19.50	
30	91.9	15.8	5.00	10.8	19.50	
31	89.8	15.5	5.00	10.5	19.50	
32	87.9	15.1	5.00	10.1	19.48	
33	86.0	14.8	5.00	9.8	19.46	
34	84.3	14.5	5.00	9.5	19.43	
35	82.6	14.2	5.00	9.2	19.39	
36	81.0	14.0	5.00	9.0	19.34	
37	79.4	13.7	5.00	8.7	19.29	

<=== Required volume for storage on-site

IN-LINE STORAGE (Structure)

0.6m X 0.6m CB		
0.36 m3/m	Height	Storage
	(m)	(m3)
54	1.34	0.48
Total:		0.48

IN-LINE STORAGE (Pipe)

Pipe storage			
Structure to Structure	Length	Dia	Storage
	(m)	(m)	(m3)
Total:			0.00

IN-LINE STORAGE (Structure)

1.2mDia CBMH's		
1.13 m3/m	Height	Storage
	(m)	(m3)
Total:		0.00

PARKING LOT STORAGE 100y Maximum available

AREA #	AREA	Depth	Storage
	(SM)	(m)	(m3)
26	226.00	0.23	17.33
Total:			17.33

CBMH height for storage equals top of grate to invert less 0.64m to account for flat top and iron frame/grate

Total Storage required 19.50
Total Surface Storage provided 17.33
Overflow to area 22 2.18

ICD use Hydrovex 75VHV 5l/s @ 1.55m head, or approved equal

Phase 1 & 2 SUMMARY

Total Flow from Roofs=	82.50 l/s
Total Roof Area =	2.012 Ha
Average roof flow =	41.00 l/s/Ha
Volume Stored on Roofs	845.86 cm
Total Roof Storage rate	420.37 cm/Ha
Total flow from parking lot =	613.50 l/s
Total parking Lot area =	6.285 Ha
Average parking lot flow =	97.61 l/s/Ha
Volume Stored on Parking lot	1947.40 cm
Total Parking lot Storage rate	309.85 cm/Ha
Total flow	696.00 l/s
Total area	8.297 Ha
Average flow	83.88 l/s/Ha
Volume Stored	2793.27 cm
Total Storage rate	336.65 cm/Ha



SiteASSIST™
by StormTech
FOR STORMTECH
INSTRUCTIONS,
DOWNLOAD THE
INSTALLATION APP



Hazeldean Storage @ 23B, & 23C

Ottawa

STORMTECH CHAMBER SPECIFICATIONS

1. CHAMBERS SHALL BE STORMTECH SC-740, SC-310, OR APPROVED EQUAL.
2. CHAMBERS SHALL BE MANUFACTURED FROM VIRGIN POLYPROPYLENE OR POLYETHYLENE RESINS.
3. CHAMBER ROWS SHALL PROVIDE CONTINUOUS, UNOBSTRUCTED INTERNAL SPACE WITH NO INTERNAL SUPPORT PANELS THAT WOULD IMPEDE FLOW OR LIMIT ACCESS FOR INSPECTION.
4. THE STRUCTURAL DESIGN OF THE CHAMBERS, THE STRUCTURAL BACKFILL, AND THE INSTALLATION REQUIREMENTS SHALL ENSURE THAT THE LOAD FACTORS SPECIFIED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET FOR: 1) LONG-DURATION DEAD LOADS AND 2) SHORT-DURATION LIVE LOADS, BASED ON THE AASHTO DESIGN TRUCK WITH CONSIDERATION FOR IMPACT AND MULTIPLE VEHICLE PRESENCES.
5. CHAMBERS SHALL MEET ASTM F2922 (POLYETHYLENE) OR ASTM F2418 (POLYPROPYLENE), "STANDARD SPECIFICATION FOR THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
6. CHAMBERS SHALL BE DESIGNED AND ALLOWABLE LOADS DETERMINED IN ACCORDANCE WITH ASTM F2787, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
7. ONLY CHAMBERS THAT ARE APPROVED BY THE SITE DESIGN ENGINEER WILL BE ALLOWED. THE CHAMBER MANUFACTURER SHALL SUBMIT THE FOLLOWING UPON REQUEST TO THE SITE DESIGN ENGINEER FOR APPROVAL BEFORE DELIVERING CHAMBERS TO THE PROJECT SITE:
 - a. A STRUCTURAL EVALUATION SEALED BY A REGISTERED PROFESSIONAL ENGINEER THAT DEMONSTRATES THAT THE SAFETY FACTORS ARE GREATER THAN OR EQUAL TO 1.95 FOR DEAD LOAD AND 1.75 FOR LIVE LOAD, THE MINIMUM REQUIRED BY ASTM F2787 AND BY AASHTO FOR THERMOPLASTIC PIPE.
 - b. A STRUCTURAL EVALUATION SEALED BY A REGISTERED PROFESSIONAL ENGINEER THAT DEMONSTRATES THAT THE LOAD FACTORS SPECIFIED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET. THE 50 YEAR CREEP MODULUS DATA SPECIFIED IN ASTM F2418 OR ASTM F2922 MUST BE USED AS PART OF THE AASHTO STRUCTURAL EVALUATION TO VERIFY LONG-TERM PERFORMANCE.
 - c. STRUCTURAL CROSS SECTION DETAIL ON WHICH THE STRUCTURAL EVALUATION IS BASED.
8. CHAMBERS AND END CAPS SHALL BE PRODUCED AT AN ISO 9001 CERTIFIED MANUFACTURING FACILITY.

IMPORTANT - NOTES FOR THE BIDDING AND INSTALLATION OF THE SC-310/SC-740 SYSTEM

1. STORMTECH SC-310 & SC-740 CHAMBERS SHALL NOT BE INSTALLED UNTIL THE MANUFACTURER'S REPRESENTATIVE HAS COMPLETED A PRE-CONSTRUCTION MEETING WITH THE INSTALLERS.
2. STORMTECH SC-310 & SC-740 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH SC-310/SC-740/SC-780 CONSTRUCTION GUIDE".
3. CHAMBERS ARE NOT TO BE BACKFILLED WITH A DOZER OR AN EXCAVATOR SITUATED OVER THE CHAMBERS.

STORMTECH RECOMMENDS 3 BACKFILL METHODS:
 - STONESHOOTER LOCATED OFF THE CHAMBER BED.
 - BACKFILL AS ROWS ARE BUILT USING AN EXCAVATOR ON THE FOUNDATION STONE OR SUBGRADE.
 - BACKFILL FROM OUTSIDE THE EXCAVATION USING A LONG BOOM HOE OR EXCAVATOR.
4. THE FOUNDATION STONE SHALL BE LEVELED AND COMPACTED PRIOR TO PLACING CHAMBERS.
5. JOINTS BETWEEN CHAMBERS SHALL BE PROPERLY SEATED PRIOR TO PLACING STONE.
6. MAINTAIN MINIMUM - 6" (150 mm) SPACING BETWEEN THE CHAMBER ROWS.
7. EMBEDMENT STONE SURROUNDING CHAMBERS MUST BE A CLEAN, CRUSHED, ANGULAR STONE 3/4-2" (20-50 mm).
8. THE CONTRACTOR MUST REPORT ANY DISCREPANCIES WITH CHAMBER FOUNDATION MATERIALS BEARING CAPACITIES TO THE SITE DESIGN ENGINEER.
9. ADS RECOMMENDS THE USE OF "FLEXSTORM CATCH IT" INSERTS DURING CONSTRUCTION FOR ALL INLETS TO PROTECT THE SUBSURFACE STORMWATER MANAGEMENT SYSTEM FROM CONSTRUCTION SITE RUNOFF.

NOTES FOR CONSTRUCTION EQUIPMENT

1. STORMTECH SC-310 & SC-740 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH SC-310/SC-740/DC-780 CONSTRUCTION GUIDE".
2. THE USE OF CONSTRUCTION EQUIPMENT OVER SC-310 & SC-740 CHAMBERS IS LIMITED:
 - NO EQUIPMENT IS ALLOWED ON BARE CHAMBERS.
 - NO RUBBER Tired LOADERS, DUMP TRUCKS, OR EXCAVATORS ARE ALLOWED UNTIL PROPER FILL DEPTHS ARE REACHED IN ACCORDANCE WITH THE "STORMTECH SC-310/SC-740/DC-780 CONSTRUCTION GUIDE".
 - WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT CAN BE FOUND IN THE "STORMTECH SC-310/SC-740/DC-780 CONSTRUCTION GUIDE".
3. FULL 36" (900 mm) OF STABILIZED COVER MATERIALS OVER THE CHAMBERS IS REQUIRED FOR DUMP TRUCK TRAVEL OR DUMPING.


USE OF A DOZER TO PUSH EMBEDMENT STONE BETWEEN THE ROWS OF CHAMBERS MAY CAUSE DAMAGE TO THE CHAMBERS AND IS NOT AN ACCEPTABLE BACKFILL METHOD. ANY CHAMBERS DAMAGED BY THE "DUMP AND PUSH" METHOD ARE NOT COVERED UNDER THE STORMTECH STANDARD WARRANTY.

CONTACT STORMTECH AT 1-888-892-2694 WITH ANY QUESTIONS ON INSTALLATION REQUIREMENTS OR WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT.

CONCEPTUAL LAYOUT

(7) STORMTECH SC-740 CHAMBERS
 (2) STORMTECH SC-740 END CAPS
 INSTALLED WITH 152 mm COVER STONE, 152 mm BASE STONE, 40% STONE VOID
INSTALLED SYSTEM VOLUME: 22 m³
 AREA OF SYSTEM: 39 m²
 PERIMETER OF SYSTEM: 41 m

COMPUTER GENERATED CONCEPTUAL LAYOUT - NOT FOR CONSTRUCTION

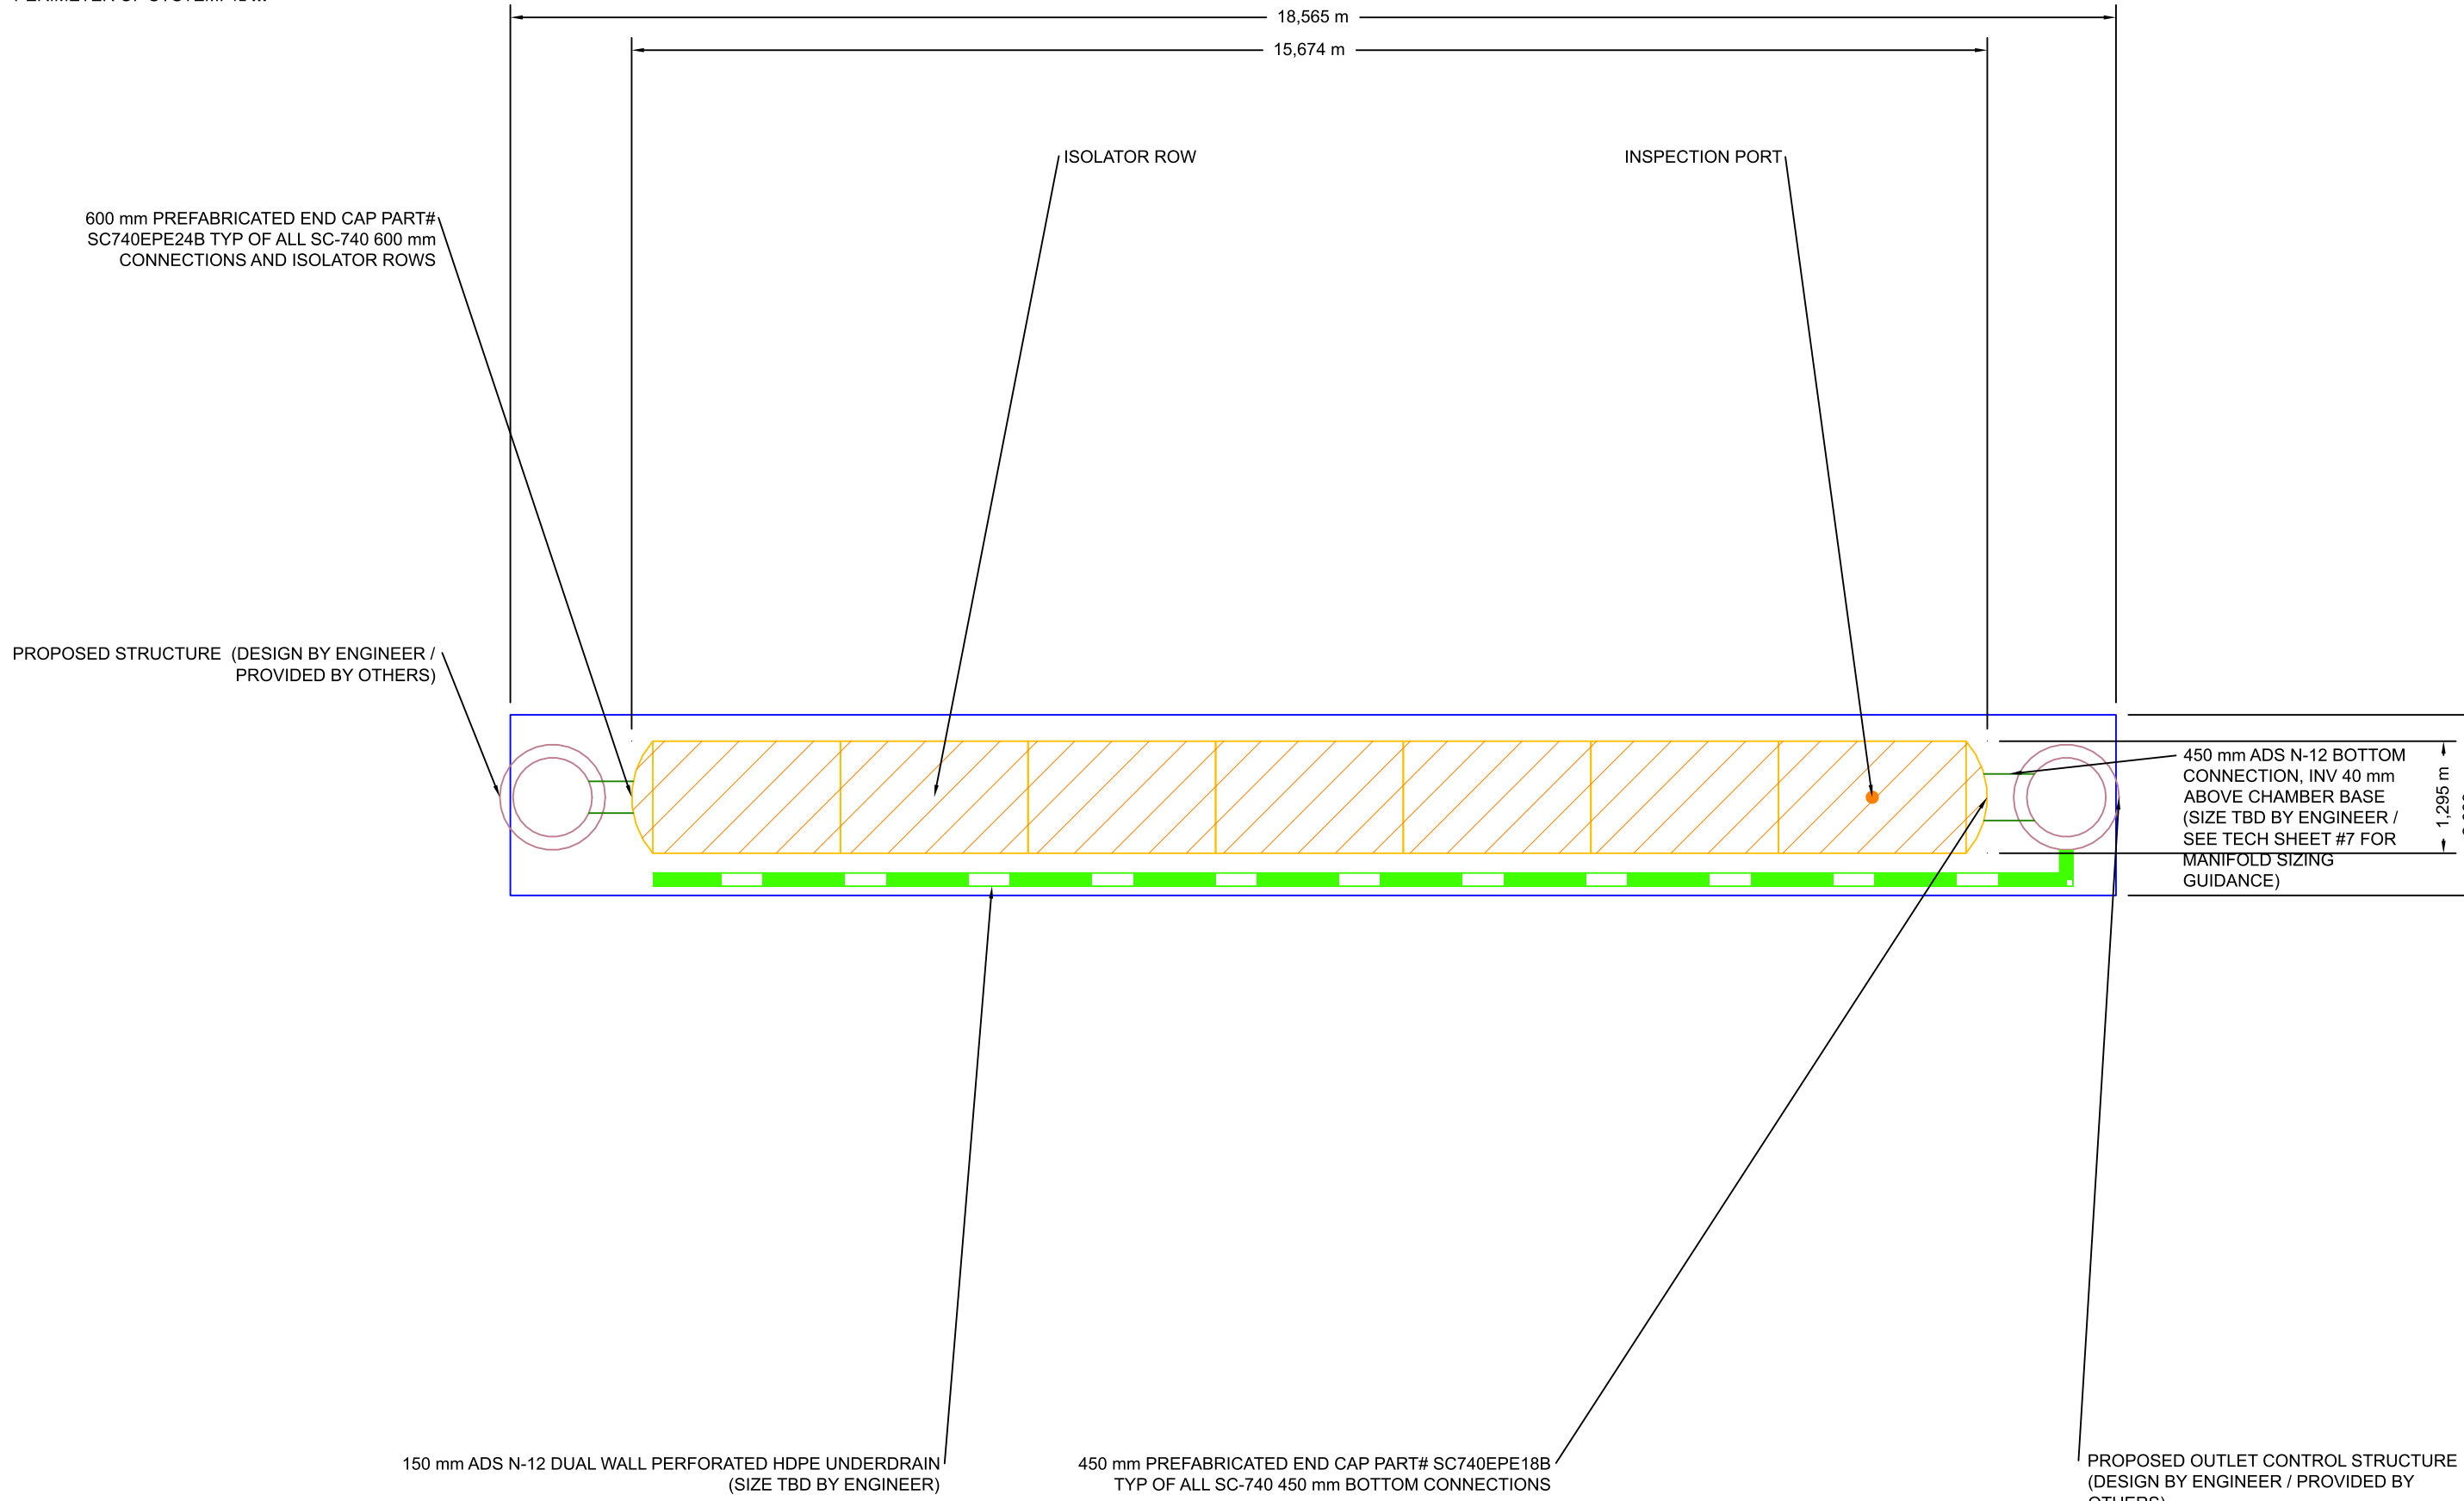

Hazeldean Storage @ 23B, & 23C	
Ottawa	
DATE: 01/13/2020	DRAWN: RM
PROJECT #: Tool	CHECKED: ---

REV	DRW	CHK	DESCRIPTION

StormTech
 Detention - Retention - Water Quality
 70 INWOOD ROAD, SUITE 3 | ROCKY HILL, CT | 06067
 860-529-8188 | 868-892-2694 | WWW.STORMTECH.COM

ADS
 ADVANCED DRAINAGE SYSTEMS, INC.
 4640 TRUEMAN BLVD
 HILLIARD, OH 43026
 1-800-733-7473

NOT TO SCALE


THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

ACCEPTABLE FILL MATERIALS: STORMTECH SC-740 CHAMBER SYSTEMS

MATERIAL LOCATION	DESCRIPTION	AASHTO MATERIAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
D	FINAL FILL: FILL MATERIAL FOR LAYER 'D' STARTS FROM THE TOP OF THE 'C' LAYER TO THE BOTTOM OF FLEXIBLE PAVEMENT OR UNPAVED FINISHED GRADE ABOVE. NOTE THAT PAVEMENT SUBBASE MAY BE PART OF THE 'D' LAYER	N/A	PREPARE PER SITE DESIGN ENGINEER'S PLANS. PAVED INSTALLATIONS MAY HAVE STRINGENT MATERIAL AND PREPARATION REQUIREMENTS.
C	INITIAL FILL: FILL MATERIAL FOR LAYER 'C' STARTS FROM THE TOP OF THE EMBEDMENT STONE ('B' LAYER) TO 18" (450 mm) ABOVE THE TOP OF THE CHAMBER. NOTE THAT PAVEMENT SUBBASE MAY BE A PART OF THE 'C' LAYER.	AASHTO M145 ¹ A-1, A-2-4, A-3 OR AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57, 6, 67, 68, 7, 78, 8, 89, 9, 10	BEGIN COMPACTIONS AFTER 12" (300 mm) OF MATERIAL OVER THE CHAMBERS IS REACHED. COMPACT ADDITIONAL LAYERS IN 6" (150 mm) MAX LIFTS TO A MIN. 95% PROCTOR DENSITY FOR WELL GRADED MATERIAL AND 95% RELATIVE DENSITY FOR PROCESSED AGGREGATE MATERIALS. ROLLER GROSS VEHICLE WEIGHT NOT TO EXCEED 12,000 lbs (53 kN). DYNAMIC FORCE NOT TO EXCEED 20,000 lbs (89 kN).
B	EMBEDMENT STONE: FILL SURROUNDING THE CHAMBERS FROM THE FOUNDATION STONE ('A' LAYER) TO THE 'C' LAYER ABOVE.	AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57	NO COMPACTION REQUIRED.
A	FOUNDATION STONE: FILL BELOW CHAMBERS FROM THE SUBGRADE UP TO THE FOOT (BOTTOM) OF THE CHAMBER.	AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57	PLATE COMPACT OR ROLL TO ACHIEVE A FLAT SURFACE. ^{2 3}

PLEASE NOTE:

- THE LISTED AASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE CLEAN, CRUSHED, ANGULAR. FOR EXAMPLE, A SPECIFICATION FOR #4 STONE WOULD STATE: "CLEAN, CRUSHED, ANGULAR NO. 4 (AASHTO M43) STONE".
- STORMTECH COMPACTION REQUIREMENTS ARE MET FOR 'A' LOCATION MATERIALS WHEN PLACED AND COMPACTED IN 6" (150 mm) (MAX) LIFTS USING TWO FULL COVERAGES WITH A VIBRATORY COMPACTOR.
- WHERE INFILTRATION SURFACES MAY BE COMPROMISED BY COMPACTION, FOR STANDARD DESIGN LOAD CONDITIONS, A FLAT SURFACE MAY BE ACHIEVED BY RAKING OR DRAGGING WITHOUT COMPACTION EQUIPMENT. FOR SPECIAL LOAD DESIGNS, CONTACT STORMTECH FOR COMPACTION REQUIREMENTS.

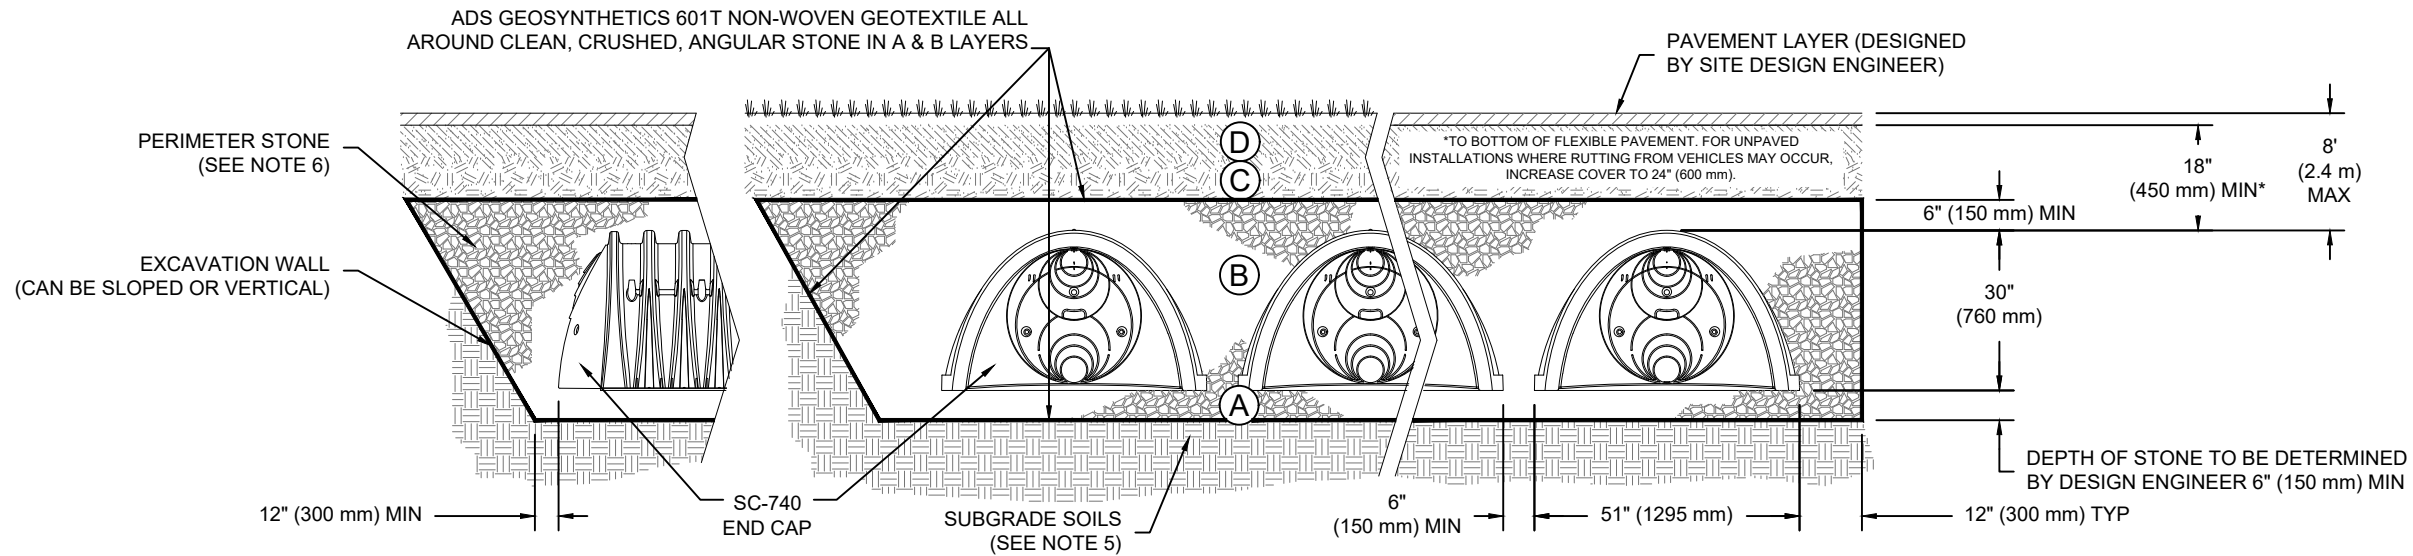


NOTES:

- SC-740 CHAMBERS SHALL CONFORM TO THE REQUIREMENTS OF ASTM F2418 "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS", OR ASTM F2922 "STANDARD SPECIFICATION FOR POLYETHYLENE (PE) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
- SC-740 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
- "ACCEPTABLE FILL MATERIALS" TABLE ABOVE PROVIDES MATERIAL LOCATIONS, DESCRIPTIONS, GRADATIONS, AND COMPACTION REQUIREMENTS FOR FOUNDATION, EMBEDMENT, AND FILL MATERIALS.
- THE "SITE DESIGN ENGINEER" REFERS TO THE ENGINEER RESPONSIBLE FOR THE DESIGN AND LAYOUT OF THE STORMTECH CHAMBERS FOR THIS PROJECT.
- THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR ASSESSING THE BEARING RESISTANCE (ALLOWABLE BEARING CAPACITY) OF THE SUBGRADE SOILS AND THE DEPTH OF FOUNDATION STONE WITH CONSIDERATION FOR THE RANGE OF EXPECTED SOIL MOISTURE CONDITIONS.
- PERIMETER STONE MUST BE EXTENDED HORIZONTALLY TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.
- ONCE LAYER 'C' IS PLACED, ANY SOIL/MATERIAL CAN BE PLACED IN LAYER 'D' UP TO THE FINISHED GRADE. MOST PAVEMENT SUBBASE SOILS CAN BE USED TO REPLACE THE MATERIAL REQUIREMENTS OF LAYER 'C' OR 'D' AT THE SITE DESIGN ENGINEER'S DISCRETION.


Hazledean Storage @ 23B, & 23C
 Ottawa
 DATE: 01/13/2020
 DRAWN: RM
 PROJECT #: Tool
 CHECKED: ---

REV	DRW	CHK	DESCRIPTION


StormTech
 Determination Retention Water Quality
 70 INWOOD ROAD, SUITE 3 | ROCKY HILL | CT | 06867
 860-525-8188 | 888-892-2694 | WWW.STORMTECH.COM


ADS
 ADVANCED DRAINAGE SYSTEMS, INC.
 4640 TRUEMAN BLVD
 HILLIARD, OH 43026
 1-800-733-7473

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

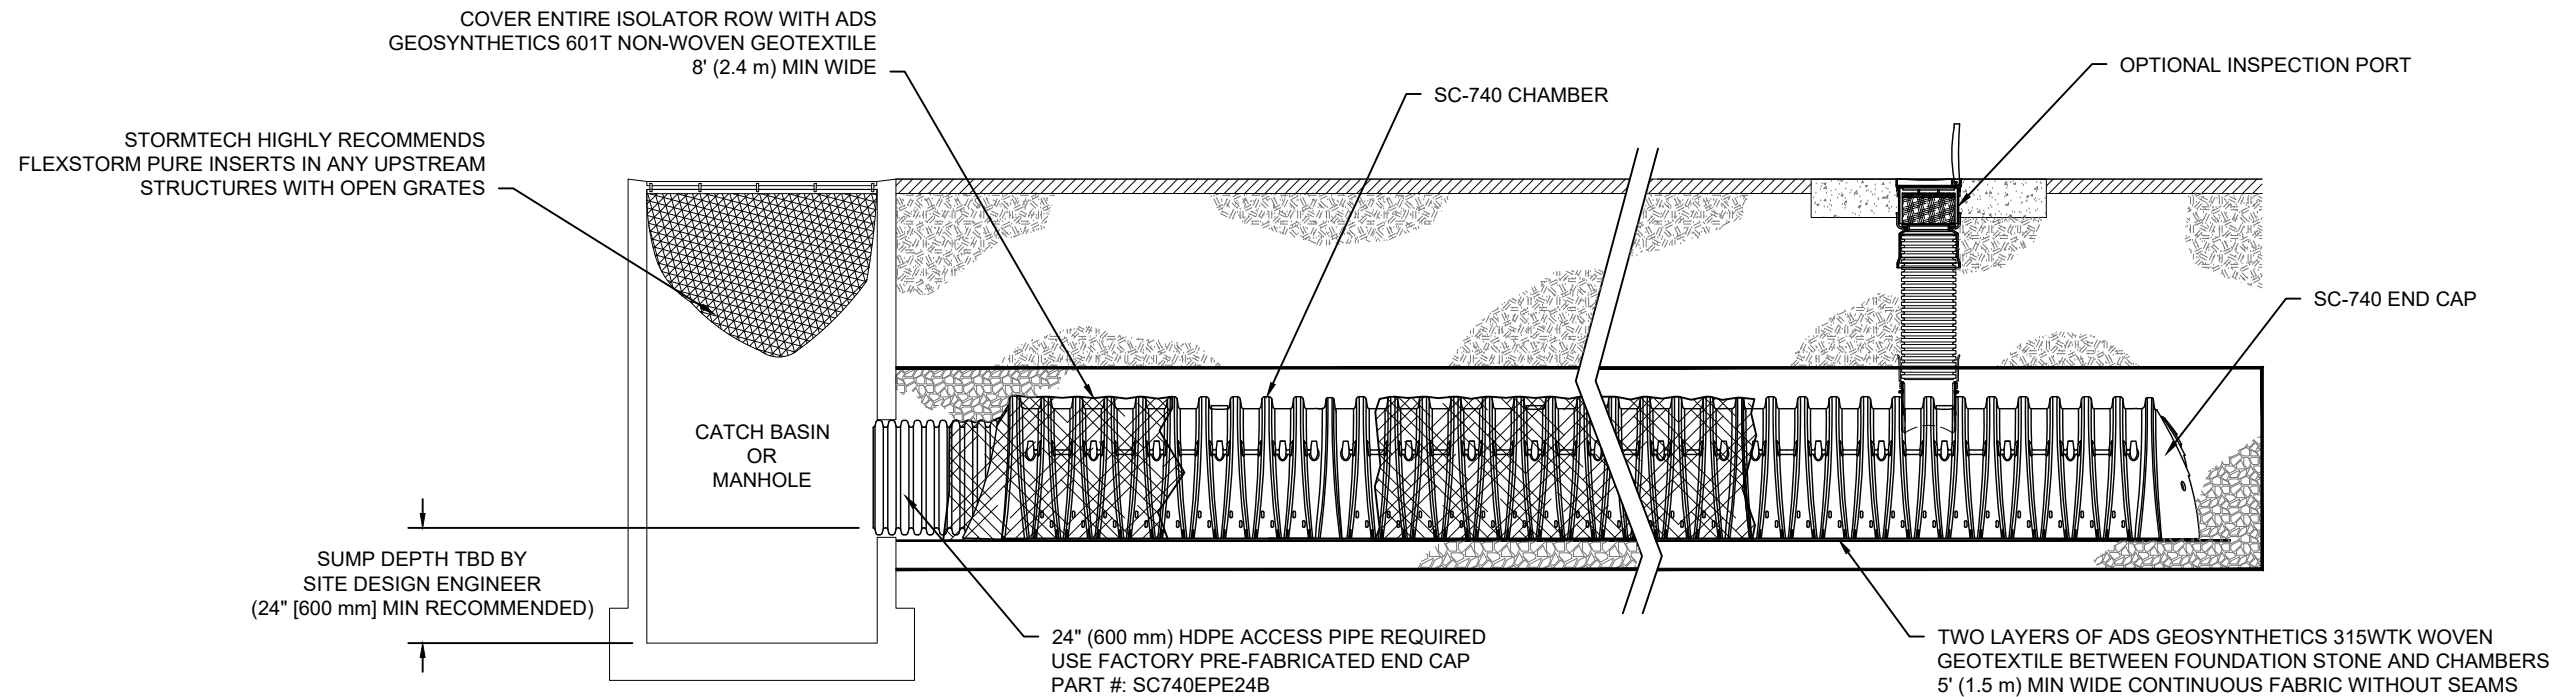


SC-740 ISOLATOR ROW DETAIL
NTS

INSPECTION & MAINTENANCE

- STEP 1) INSPECT ISOLATOR ROW FOR SEDIMENT
- A. INSPECTION PORTS (IF PRESENT)
 - A.1. REMOVE/OPEN LID ON NYLOPLAST INLINE DRAIN
 - A.2. REMOVE AND CLEAN FLEXSTORM FILTER IF INSTALLED
 - A.3. USING A FLASHLIGHT AND STADIA ROD, MEASURE DEPTH OF SEDIMENT AND RECORD ON MAINTENANCE LOG
 - A.4. LOWER A CAMERA INTO ISOLATOR ROW FOR VISUAL INSPECTION OF SEDIMENT LEVELS (OPTIONAL)
 - A.5. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
 - B. ALL ISOLATOR ROWS
 - B.1. REMOVE COVER FROM STRUCTURE AT UPSTREAM END OF ISOLATOR ROW
 - B.2. USING A FLASHLIGHT, INSPECT DOWN THE ISOLATOR ROW THROUGH OUTLET PIPE
 - i) MIRRORS ON POLES OR CAMERAS MAY BE USED TO AVOID A CONFINED SPACE ENTRY
 - ii) FOLLOW OSHA REGULATIONS FOR CONFINED SPACE ENTRY IF ENTERING MANHOLE
 - B.3. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
- STEP 2) CLEAN OUT ISOLATOR ROW USING THE JETVAC PROCESS
- A. A FIXED CULVERT CLEANING NOZZLE WITH REAR FACING SPREAD OF 45" (1.1 m) OR MORE IS PREFERRED
 - B. APPLY MULTIPLE PASSES OF JETVAC UNTIL BACKFLUSH WATER IS CLEAN
 - C. VACUUM STRUCTURE SUMP AS REQUIRED
- STEP 3) REPLACE ALL COVERS, GRATES, FILTERS, AND LIDS; RECORD OBSERVATIONS AND ACTIONS.
- STEP 4) INSPECT AND CLEAN BASINS AND MANHOLES UPSTREAM OF THE STORMTECH SYSTEM.

NOTES

1. INSPECT EVERY 6 MONTHS DURING THE FIRST YEAR OF OPERATION. ADJUST THE INSPECTION INTERVAL BASED ON PREVIOUS OBSERVATIONS OF SEDIMENT ACCUMULATION AND HIGH WATER ELEVATIONS.
2. CONDUCT JETTING AND VACTORING ANNUALLY OR WHEN INSPECTION SHOWS THAT MAINTENANCE IS NECESSARY.

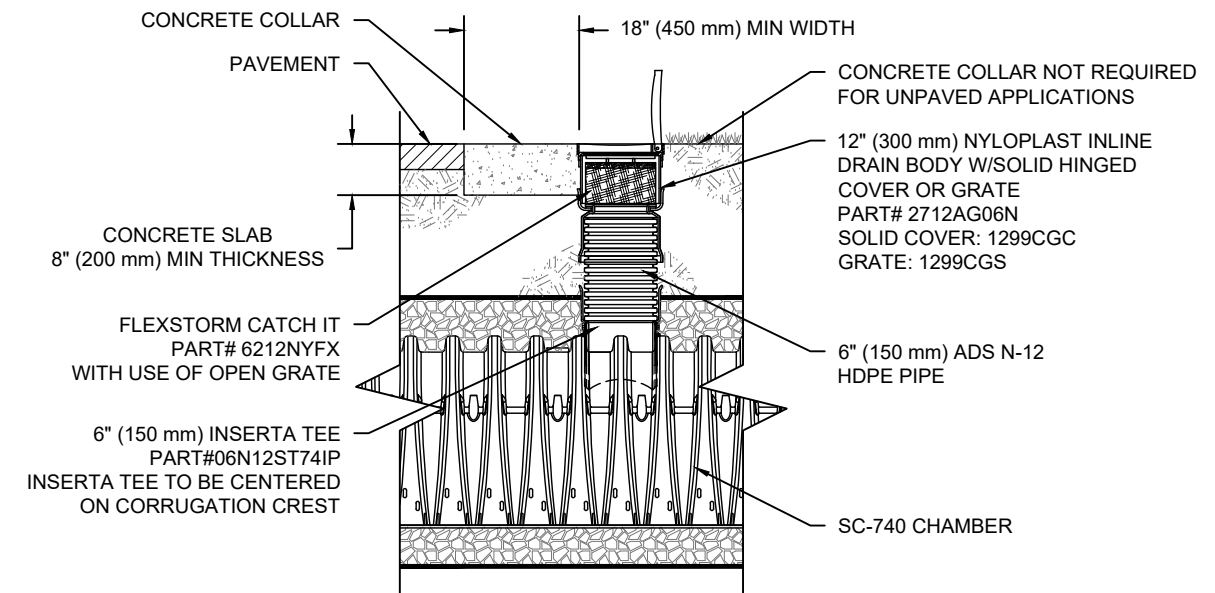


SC-740 6" INSPECTION PORT DETAIL
NTS

Hazeldean Storage @ 23B, & 23C	
Ottawa	
DATE: 01/13/2020	DRAWN: RM
PROJECT #: Tool	CHECKED: ---

REV	DRW	CHK	DESCRIPTION



StormTech
Determination. Retention. Water Quality.
 70 INWOOD ROAD, SUITE 3 | ROCKY HILL, CT | 06067
 860-525-8188 | 888-892-2694 | WWW.STORMTECH.COM




ADS
ADVANCED DRAINAGE SYSTEMS, INC.
 4640 TRUEMAN BLVD
 HILLIARD, OH 43026
 1-800-733-7473

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.


UNDERDRAIN DETAIL

NTS

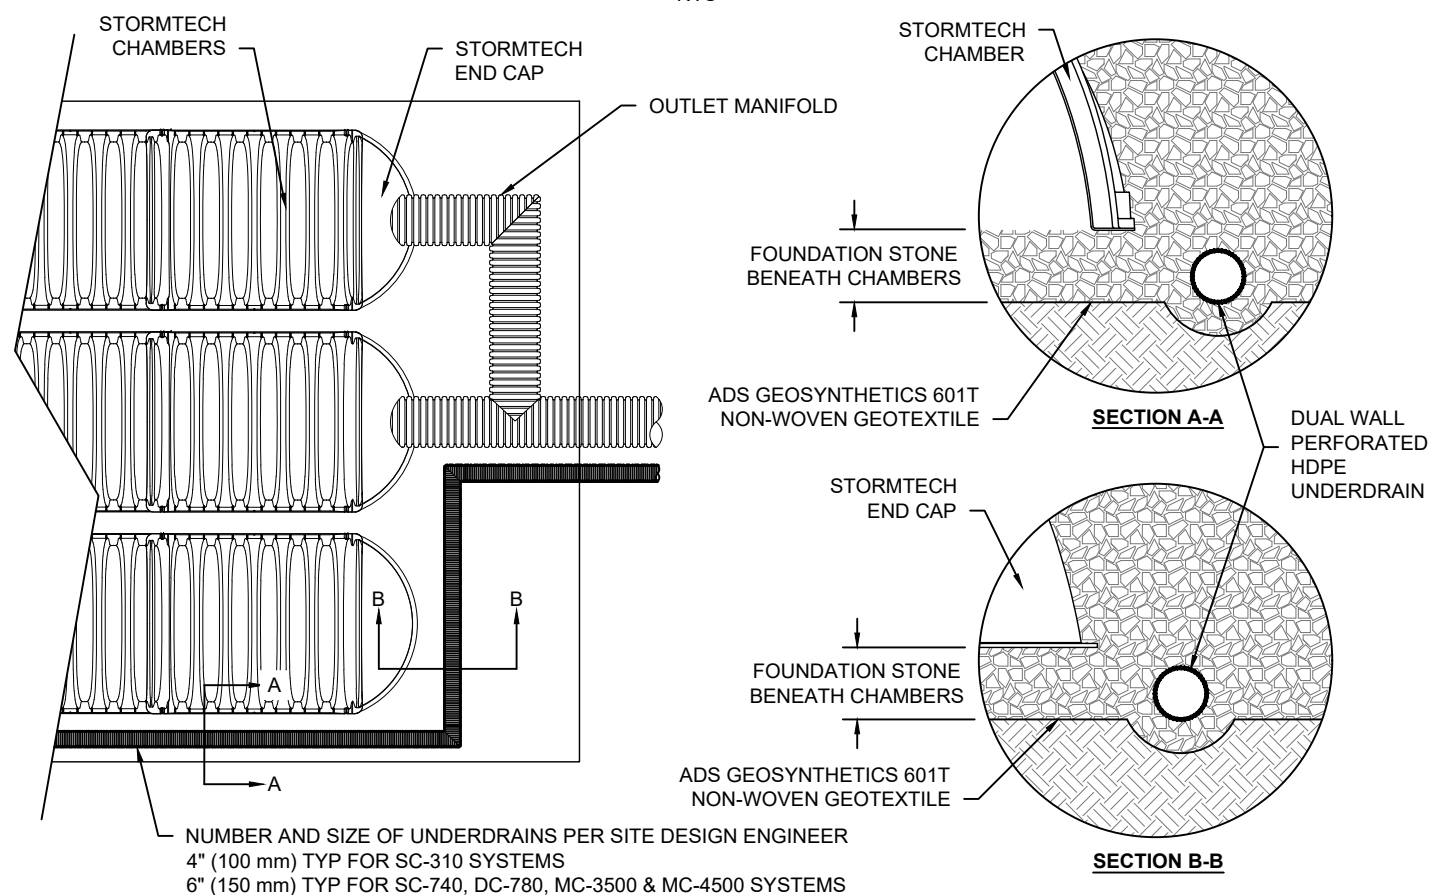

INSERTA TEE DETAIL

NTS

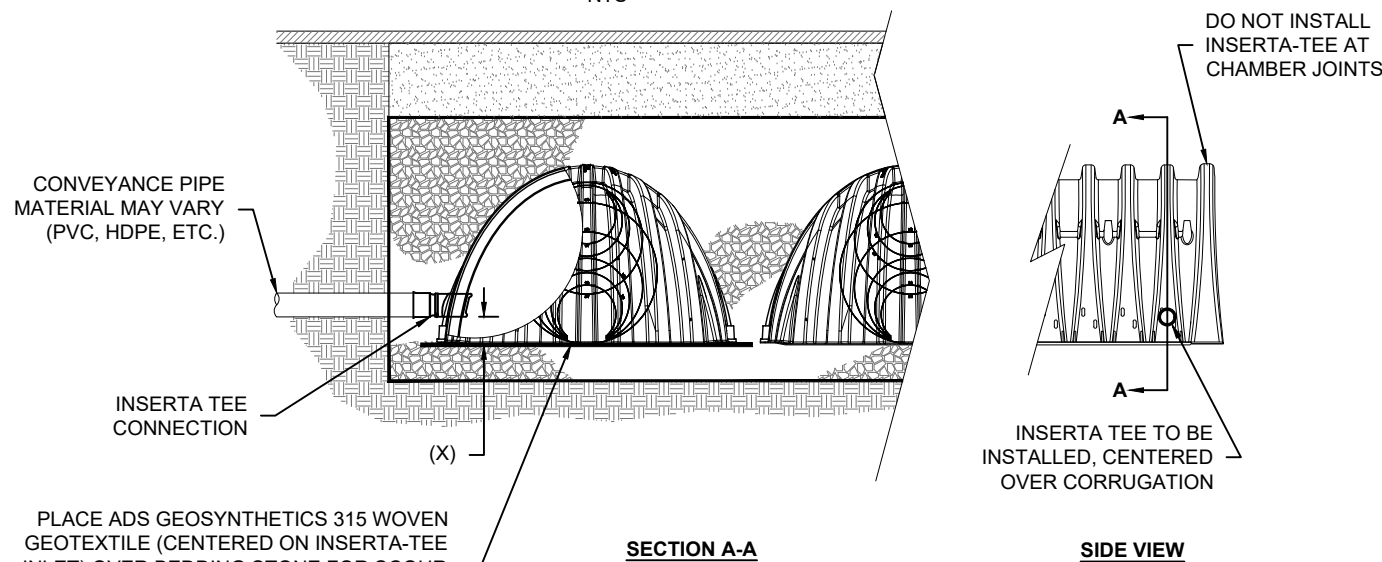


CHAMBER	MAX DIAMETER OF INSERTA TEE	HEIGHT FROM BASE OF CHAMBER (X)
SC-310	6" (150 mm)	4" (100 mm)
SC-740	10" (250 mm)	4" (100 mm)
DC-780	10" (250 mm)	4" (100 mm)
MC-3500	12" (300 mm)	6" (150 mm)
MC-4500	12" (300 mm)	8" (200 mm)

INSERTA TEE FITTINGS AVAILABLE FOR SDR 26, SDR 35, SCH 40 IPS GASKETED & SOLVENT WELD, N-12, HP STORM, C-900 OR DUCTILE IRON

NOTE:
 PART NUMBERS WILL VARY BASED ON INLET PIPE MATERIALS. CONTACT STORMTECH FOR MORE INFORMATION.

SC-740 TECHNICAL SPECIFICATION


NTS

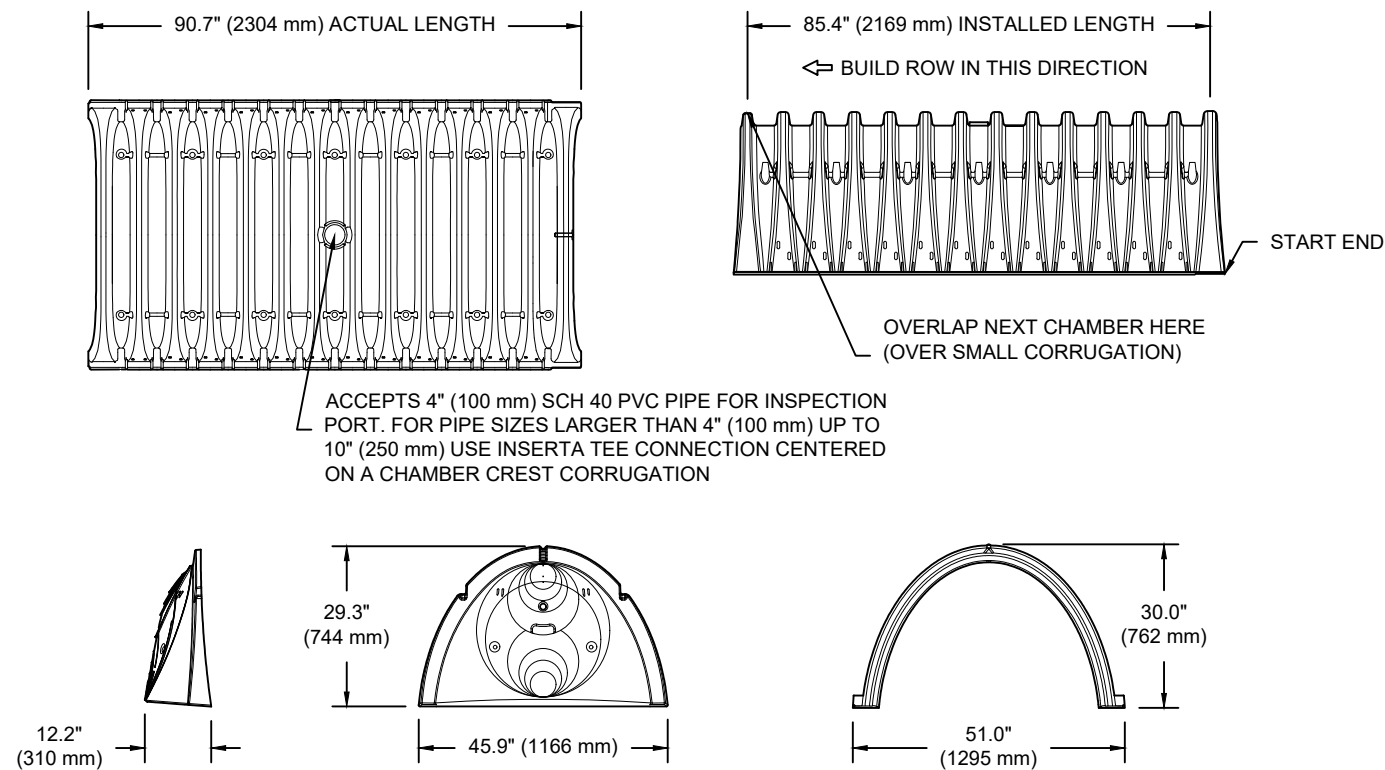

NOMINAL CHAMBER SPECIFICATIONS

SIZE (W X H X INSTALLED LENGTH)	51.0" X 30.0" X 85.4"	(1295 mm X 762 mm X 2169 mm)
CHAMBER STORAGE	45.9 CUBIC FEET	(1.30 m ³)
MINIMUM INSTALLED STORAGE*	74.9 CUBIC FEET	(2.12 m ³)
WEIGHT	75.0 lbs.	(33.6 kg)

*ASSUMES 6" (152 mm) STONE ABOVE, BELOW, AND BETWEEN CHAMBERS

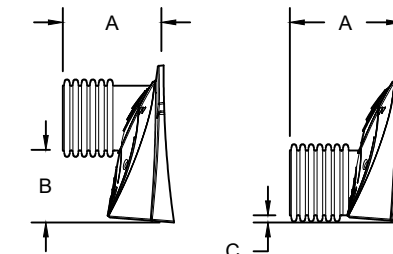

PART #	STUB	A	B	C
SC740EPE06T / SC740EPE06TPC	6" (150 mm)	10.9" (277 mm)	18.5" (470 mm)	---
SC740EPE06B / SC740EPE06BPC	---	---	---	0.5" (13 mm)
SC740EPE08T / SC740EPE08TPC	8" (200 mm)	12.2" (310 mm)	16.5" (419 mm)	---
SC740EPE08B / SC740EPE08BPC	---	---	---	0.6" (15 mm)
SC740EPE10T / SC740EPE10TPC	10" (250 mm)	13.4" (340 mm)	14.5" (368 mm)	---
SC740EPE10B / SC740EPE10BPC	---	---	---	0.7" (18 mm)
SC740EPE12T / SC740EPE12TPC	12" (300 mm)	14.7" (373 mm)	12.5" (318 mm)	---
SC740EPE12B / SC740EPE12BPC	---	---	---	1.2" (30 mm)
SC740EPE15T / SC740EPE15TPC	15" (375 mm)	18.4" (467 mm)	9.0" (229 mm)	---
SC740EPE15B / SC740EPE15BPC	---	---	---	1.3" (33 mm)
SC740EPE18T / SC740EPE18TPC	18" (450 mm)	19.7" (500 mm)	5.0" (127 mm)	---
SC740EPE18B / SC740EPE18BPC	---	---	---	1.6" (41 mm)
SC740EPE24B*	24" (600 mm)	18.5" (470 mm)	---	0.1" (3 mm)

ALL STUBS, EXCEPT FOR THE SC740EPE24B ARE PLACED AT BOTTOM OF END CAP SUCH THAT THE OUTSIDE DIAMETER OF THE STUB IS FLUSH WITH THE BOTTOM OF THE END CAP. FOR ADDITIONAL INFORMATION CONTACT STORMTECH AT 1-888-892-2694.

* FOR THE SC740EPE24B THE 24" (600 mm) STUB LIES BELOW THE BOTTOM OF THE END CAP APPROXIMATELY 1.75" (44 mm). BACKFILL MATERIAL SHOULD BE REMOVED FROM BELOW THE N-12 STUB SO THAT THE FITTING SITS LEVEL.

NOTE: ALL DIMENSIONS ARE NOMINAL

Hazledean Storage @ 23B, & 23C
 Ottawa

DATE: 01/13/2020
 DRAWN: RM
 PROJECT #: Tool
 CHECKED: ---

REV	DRW	CHK	DESCRIPTION

StormTech
 Detention/Retention/Water Quality

70 INWOOD ROAD, SUITE 3 | ROCKY HILL, CT | 06867
 860-525-8188 | 888-892-2694 | WWW.STORMTECH.COM

ADS
 ADVANCED DRAINAGE SYSTEMS, INC.

4640 TRUJMAN BLVD
 HILLIARD, OH 43026
 1-800-733-7473

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

FLOW CONTROL ROOF DRAINAGE DECLARATION

THIS FORM TO BE COMPLETED BY THE MECHANICAL AND STRUCTURAL ENGINEERS RESPONSIBLE FOR DESIGN

Permit Application No.

Project Name:

The shoppers at Fairwinds

Building Location:

5705 Hazeldean Rd Stittsville Ontario

Municipality:

The roof drainage system has been designed in accordance with the following criteria: (please check one of the following).

M1.

Conventionally drained roof (no flow control roof drains used).

M2.

Flow control roof drains meeting the following conditions have been incorporated in this design:

- (a) the maximum drain down time does not exceed 24h,
- (b) one or more scuppers are installed so that the maximum depth of water on the roof cannot exceed 150mm,
- (c) drains are located not more than 15m from the edge of roof and not more than 30m from adjacent drains, and
- (d) there is at least one drain for each 900sq.m.

M3.

A flow control drainage system that does not meet the minimum drainage criteria described in M2 has been incorporated in this design.

PROFESSIONAL SEAL APPLIED BY:

Practitioner's Name: Dusan Pristach

Firm: Inviro Engineered Systems Ltd.

Phone#: 416-491-4455

City: Toronto Province: ON



Mechanical Engineer's Seal

S1.

The design parameters incorporated into the overall structural design are consistent with the information provided by the Mechanical Engineer in M2. Loads due to rain are not considered to act simultaneously with loads due to snow as per Sentence 4.1.7.3 (3) OBC.

S2.

The structure has been designed incorporating the additional structural loading due to rain acting simultaneously with the snow load. The design parameters are consistent with the control flow drainage system designed by the mechanical engineer.

PROFESSIONAL SEAL APPLIED BY:

Practitioner's Name:

LEONARD KALISHENKO

Firm:

LEONARD KALISHENKO & ASSOCIATES LTD

Phone#:

416-665-7165

City:

TORONTO

Province:

ONTARIO



Structural Engineer's Seal

APPENDIX C

- Mattamy Letter and Figure
- C-501B Sanitary Tributary Area Plan Phase 1 & 2
- Sanitary sewer design sheet Phase 1 & 2



Mattamy Homes Limited
Ottawa Division

50 Hines Road, Suite 100, Ottawa, ON K2K 2M5
T (613) 831-4115
www.mattamyhomes.com

June 27, 2017

Mark Fraser
Development Review Services
City of Ottawa
110 Laurier Avenue West, 4th Floor
Ottawa, ON, K1P 1J1

Dear Mr. Fraser,

Re: Fairwinds Temporary Pumping Station

Please accept this letter as confirmation that North American previously purchased 14l/s of capacity at the temporary Mattamy Pump Station on Maple Grove, for Phases 1 and 2 of their development. This letter also confirms that this capacity remains available for North American's use. Note that this 14 l/s is part of the current 92 l/s capacity of the temporary Mattamy Pump Station.

We understand that North American has loaned 1 l/s of their capacity for the Keg Stie Plan (lands previously owned by North American), this will reduce the available capacity for North American's use to 13 l/s for their lands.

If you have any questions, please call the undersigned at (613) 831-5156.



Sincerely,

A handwritten signature in black ink, appearing to read "Kris Haynes", with a long horizontal line extending to the right.

Kris Haynes
Land Development Manager
Kris.Haynes@mattamycorp.com

Cc: Demetrius Yannouloupoulos


z:\projects\07-309 fairwinds north phase 1 and 2\design_phase2\c detailed design\c 2 drawings\c 2.1 cod drawings\c 2.1.3 sanitary_figures\2013-02-13_tpd_134ha\2013-02-13_tps_134.5ha.dwg

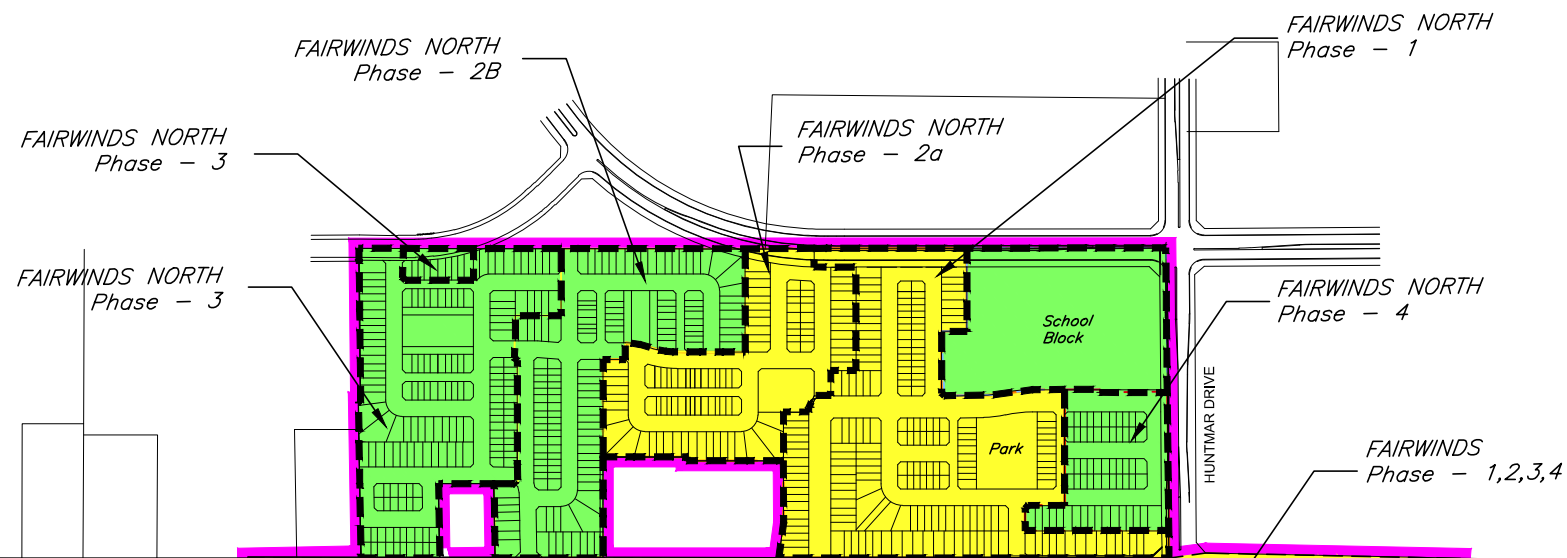

LEGEND:

PEAK FLOW RATE OF 38 L/S BASED ON 2011 MONITORING DATA (SUBJECT TO REVIEW AND APPROVAL OF CITY OF OTTAWA)		37.40 901 2792	DRAINAGE AREA IN HECTARES UNIT NUMBER POPULATION (3.4 PERSON PER SINGLE UNIT FOR SINGLE HOUSE) (2.7 PERSON PER UNIT FOR TOWNHOUSE)
PEAK FLOW RATE BASED ON THEORETICAL 96.5 L/S		56.24 1293 3940	DRAINAGE AREA IN HECTARES UNIT NUMBER POPULATION (3.4 PERSON PER SINGLE UNIT FOR SINGLE HOUSE) (2.7 PERSON PER UNIT FOR TOWNHOUSE)

26.67ha COMMERCIAL

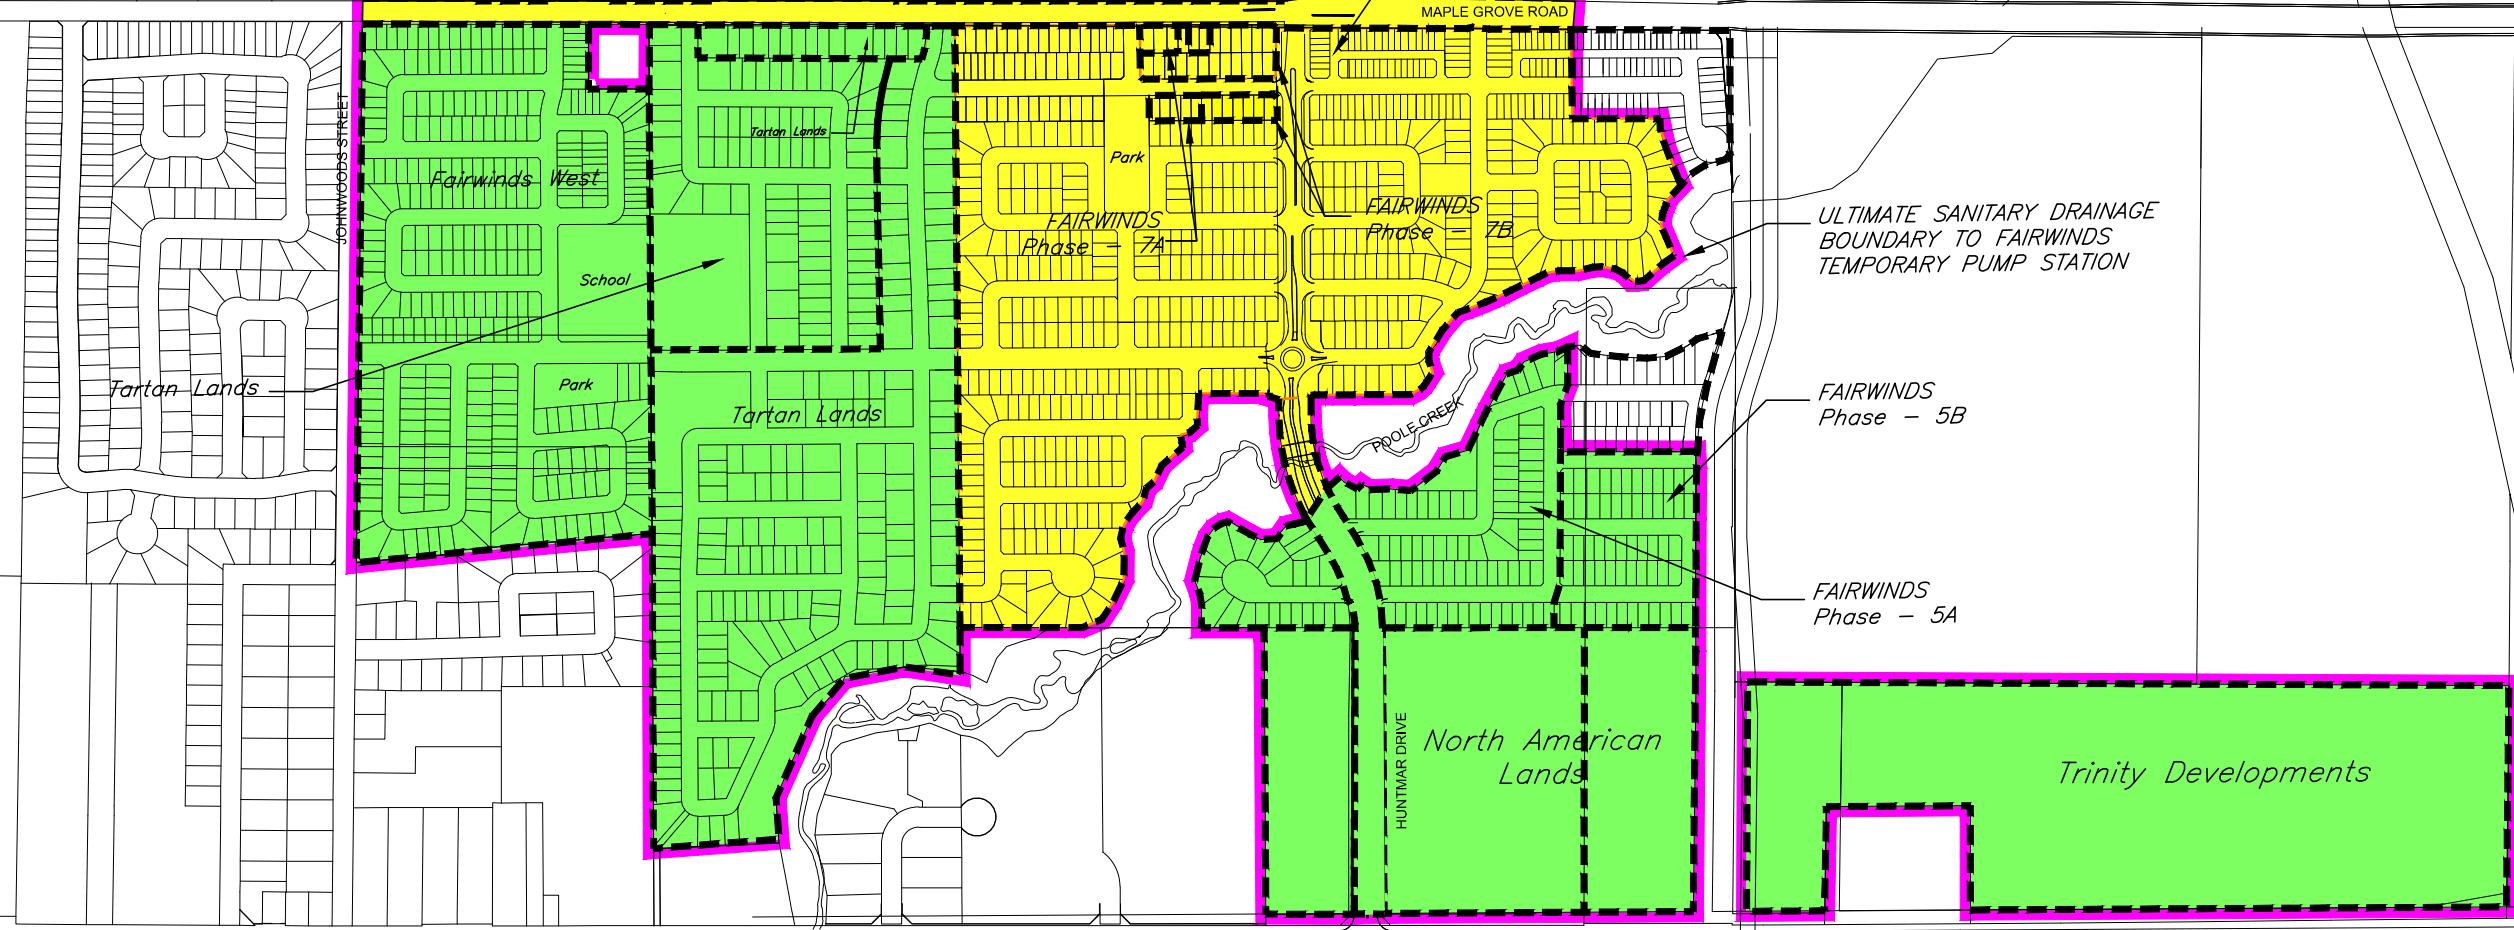

ULTIMATE SANITARY DRAINAGE BOUNDARY TO FAIRWINDS TEMPORARY PUMP STATION




120 Iber Road, Unit 203
 Stittsville, Ontario, K2S 1E9
 Tel. (613) 836-0856
 Fax (613) 836-7183
 www.DSEL.ca


**MATTAMY FAIRWINDS
 TEMPORARY PUMP STATION
 ALLOCATION PLAN**

DATE:	FEBRUARY 13, 2013
SCALE:	1 : 7500
PROJECT No.:	309
FIGURE	1

Sanitary Sewer Design Sheet													
Project:		451B		Where: Population (P)									
Location:		Fairwinds Subdivision		Correlation Factor = K = 1									
Revision Date:		13-Feb-13		Average Daily per capita flow Rate = 0.35 (m ³ /d cap)									
Revised By:		J. Ailey (DSEL)		People per unit = 3.4/single and 2.7/town									
				Infiltration Flow = 0.28 L/s/ha									
LOCATION													
Street	Area (Ha)	Cumulative Area (Ha)	Singles	Towns	Units	Population	Cumulative Units	Cumulative Population	Peak Factor	Sewage Flow (L/s)	Infiltration Flow (L/s)	Total Flow (L/s)	Cumulative Flow (L/s)
Existing Development - End of 2011													
Fairwinds Phase 1, 2, 3, 4	24.00	24.0	463	100	563	1845	563	1845					
Fairwinds Phase 7	1.04	25.0	36	0	36	123	599	1968					
Fairwinds North Phase 1	6.29	31.3	11	191	202	554	801	2522					
Fairwinds North Phase 2A	3.08	34.4	0	100	100	270	901	2792					
Infiltration Maple Grove Road	3.02	37.4	0	0	0	0	901	2792					
Monitored Flow Data*												38.0	
Fairwinds Phase 5A	5.29	5.3	105	0	105	357	105	357	3.12	4.52	1.48	6.00	6.0
Fairwinds Phase 5B	2.40	7.7	58	0	58	198	163	555	3.12	2.50	0.67	3.18	9.2
Fairwinds North Phase 2B	4.08	11.8	0	141	141	381	304	936	3.12	4.82	1.14	5.96	15.1
Fairwinds North Phase 3	4.22	16.0	0	168	168	454	472	1390	3.12	5.74	1.18	6.93	22.1
Fairwinds North Phase 4	1.50	17.5	0	61	61	165	533	1555	3.12	2.09	0.42	2.51	24.6
Fairwinds North School Block	2.52	20.01								2.19	0.71	2.89	27.5
North American Phase 1										5.70		5.7	5.7
North American Phase 2										8.30		8.3	14.0
Trinity										13.00		13.0	27.0
Fairwinds West	15.72	35.73	249	61	310	1012	843	2567	3.12	12.80	4.40	17.2	71.7
Tartan Lands	20.51	56.24	225	225	450	1373	1293	3940	3.12	17.37	5.74	23.1	94.8
TPS 134.5 L/s Upgrade Total							2194	6732	3.12				132.8
Fairwinds Phase 6 (Pond)	1.70	1.7	71	0	71	241	2265	6973	3.10	3.03	0.48	3.5	3.5
Fairwinds Phase 8 (Pond)	1.20	2.9	34	0	34	116	2299	7089	3.10	1.45	0.34	1.8	5.3
Notes:													
Peak factors calculated based on total population tributary to the TPS per allocation phase as follows:													
Peak Factor for 134.5 L/s based on population of 6732													
Peak Factor for remaining allocation based on population of 7062													
Tartan unit count provided by IBI - 470 units assuming 50% singles, 25% semi-detached and 25% towns. Average of 3.05 persons / unit.													
*Monitored flows based on flow monitoring results submitted to the MOE up to and including the year 2011. Allocation of monitored flows to the pump station will be subject to approval from the City of Ottawa.													

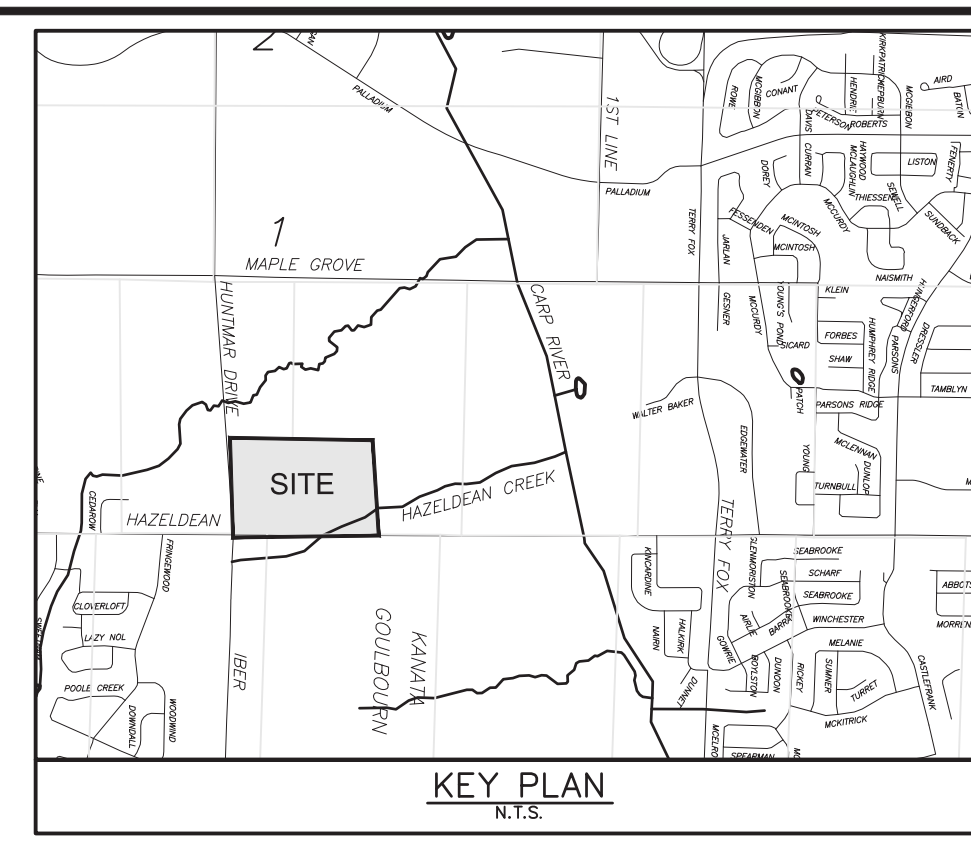

LEGEND
 18C AREA ID NUMBER
 0.65 AREA (ha)

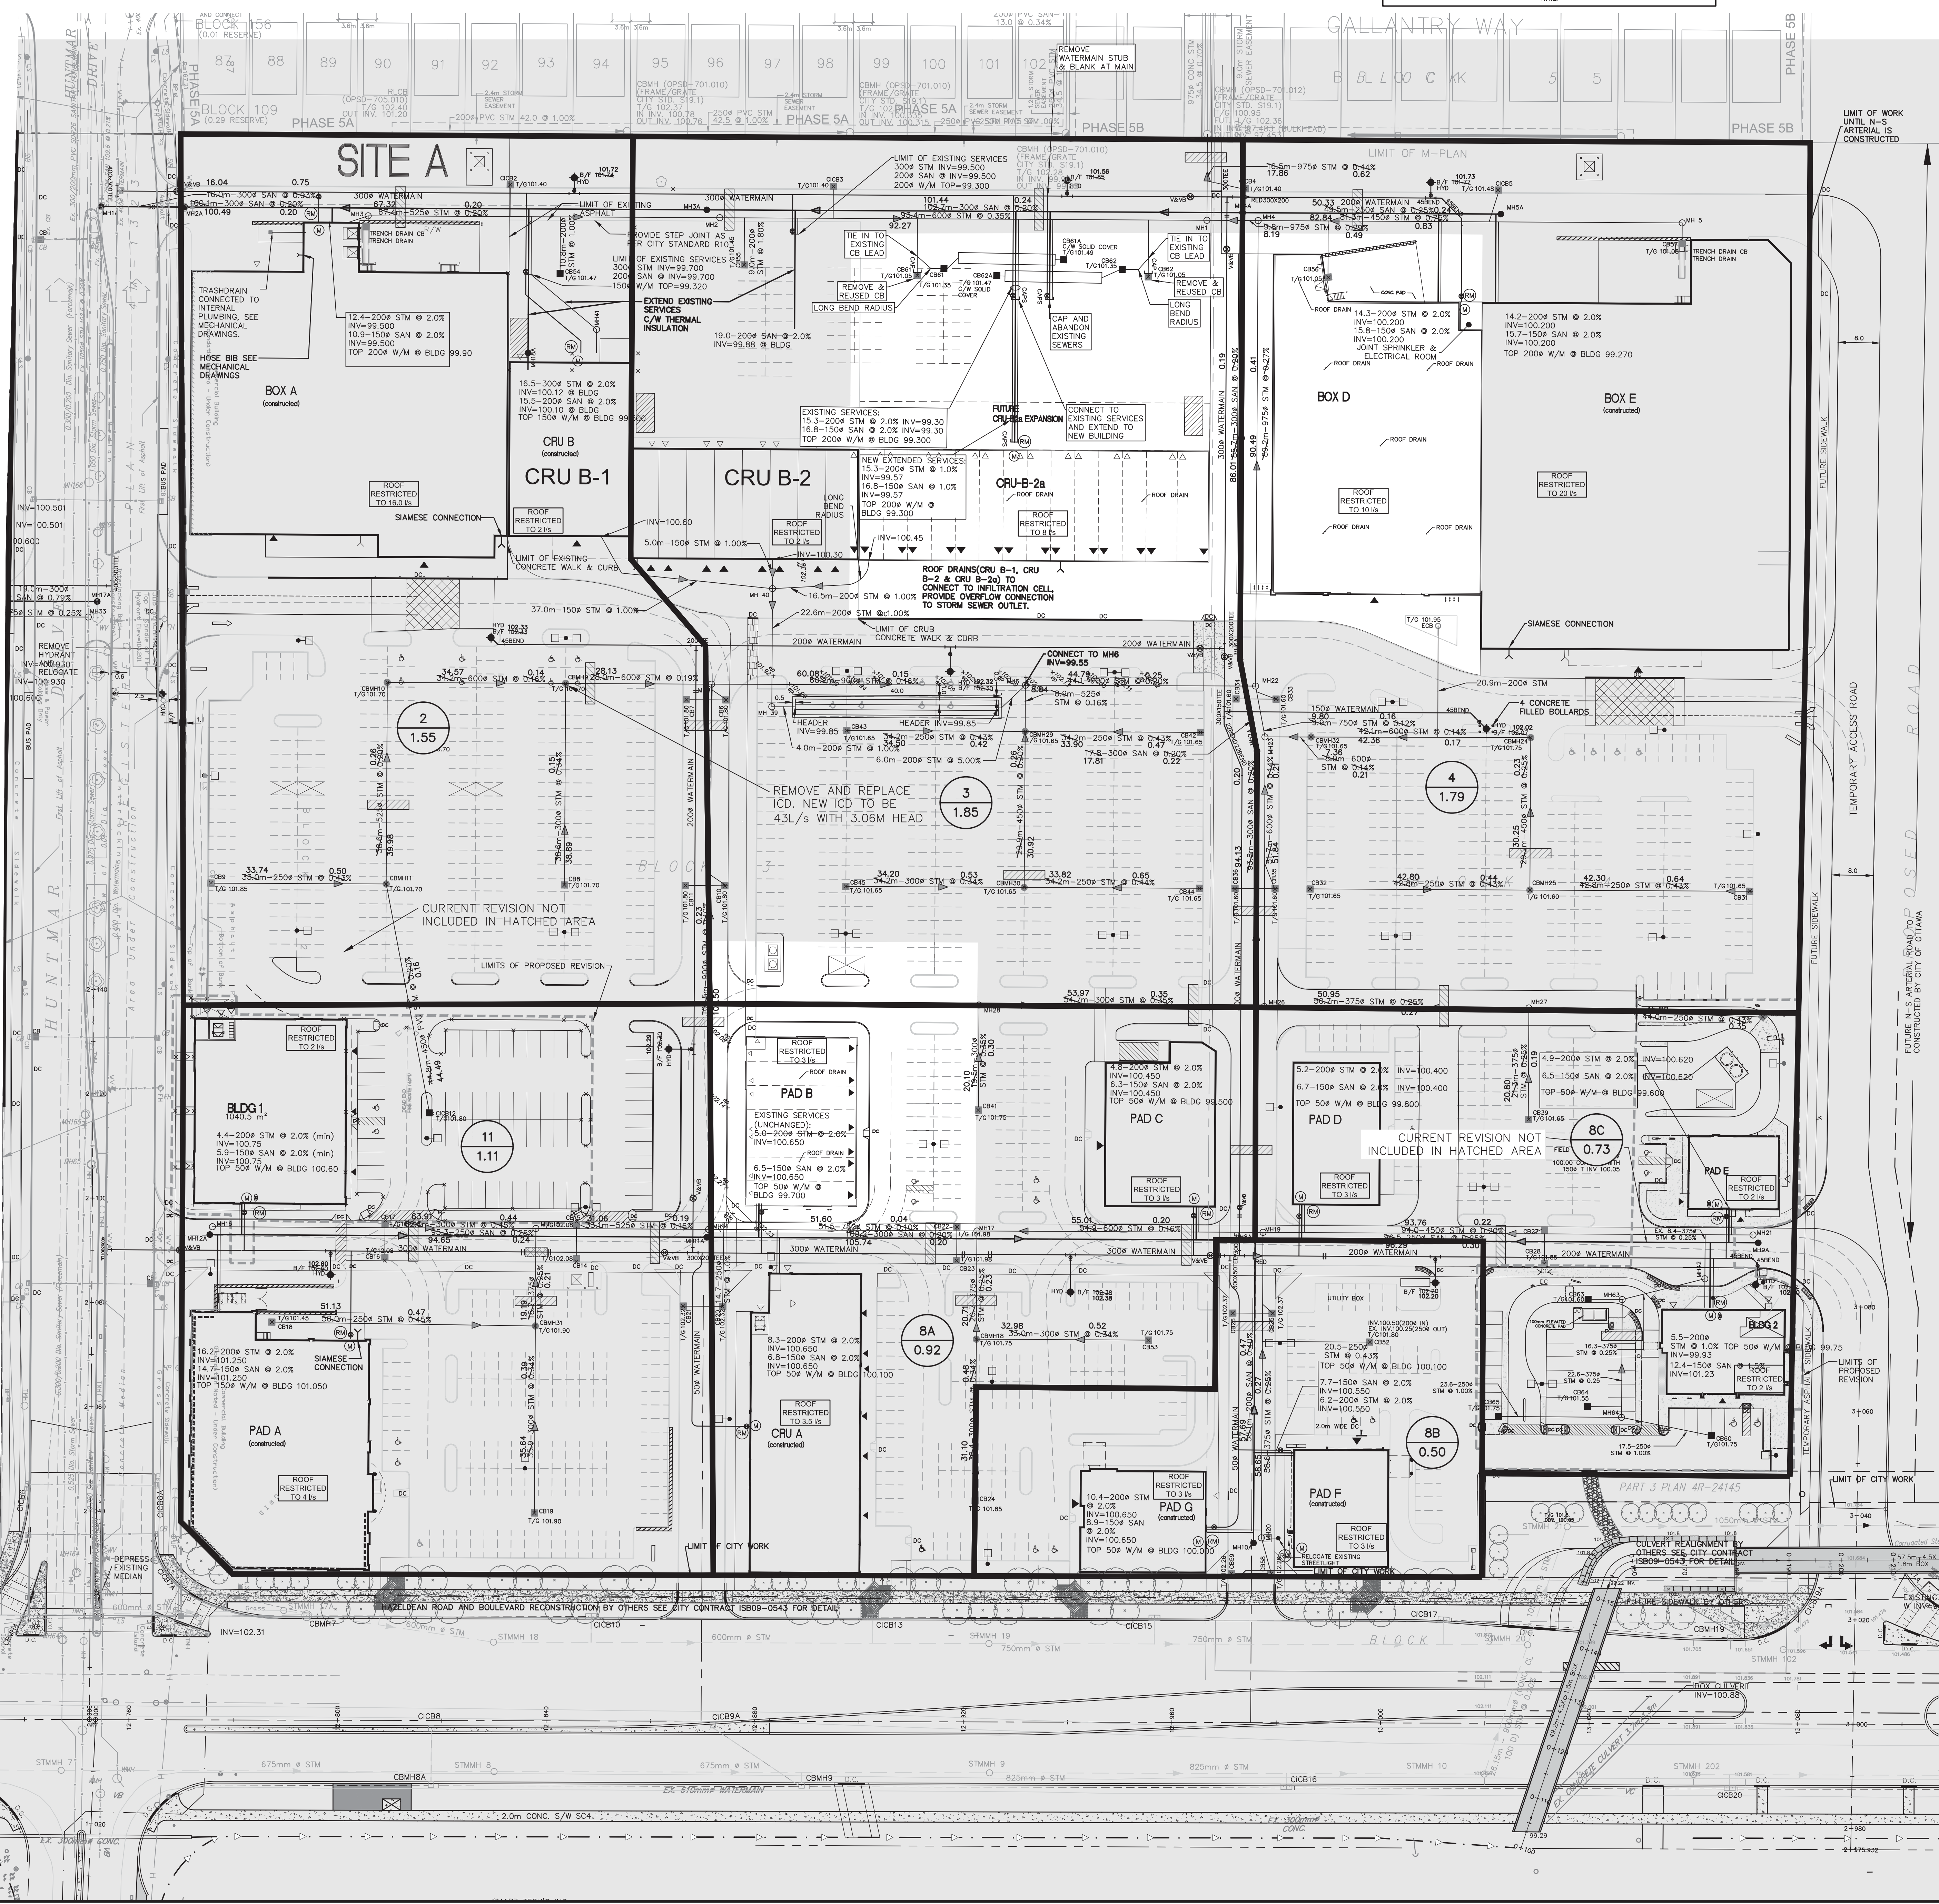


No.	REVISIONS	By	Date
23	REVISED STORAGE CELLS PER	DOY	20:05:15
22	REVISED AS PER CITY	DOY	20:04:30
21	COMMENTS	DOY	20:03:37
20	REVISED AS PER CITY	DOY	19:22:30
19	COMMENTS	DOY	19:20:39
18	REVISED SPA CRU B-3, PAD	DOY	19:08:39
17	ISSUED FOR CONSTRUCTION	DOY	18:04:06
16	ISSUED FOR TENDER	DOY	18:01:15
15	REVISED AS PER CITY COMMENTS	DOY	17:11:23
14	REVISED AS PER SITE PLAN	DOY	17:07:07
13	REVISED AS PER CITY COMMENTS	DOY	17:06:33
12	REVISED BLD 2 & PAD E	DOY	17:02:14
11	REVISED AS PER CITY COMMENTS	DOY	16:08:02
10	SPA BLD 1 & 2	DOY	16:03:07
9	REVISED AS PER SITE PLAN	DOY	14:11:03
8	SPA	DOY	14:09:09
7	REVISED AS PER SITE PLAN	DOY	14:08:08
6	REVISED AS PER CITY	DOY	14:07:31
5	REVISED DOLLAR & CRUB	DOY	14:06:03
4	REVISED FOR PAD F	DOY	12:11:16
3	REVISED SPRINKLER ROOM	DOY	12:03:09
2	REVISED SITE PLAN PH1 & PH2	DOY	11:11:24
1	ISSUED FOR APPROVAL	DOY	11:10:27

NORTH AMERICAN DEVELOPMENT GROUP

IBI GROUP
 333 Preston Street
 Tower 1, Suite 400
 Ottawa, Ontario
 Canada K1S 0M4
 Tel: (613)225-1311
 Fax: (613)225-9868

Project Title
**NORTH AMERICAN
 HAZELDEAN & HUNTMAR
 OTTAWA, ONT.**

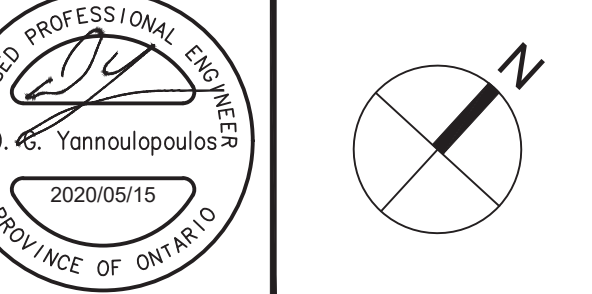

Drawing Title
**SANITARY TRIBUTARY
 AREAS
 PHASE 1 & 2**

Scale
 1:500

Design	Date
D.G.Y.	OCTOBER 2011
Drawn	Checked
E.H.	D.G.Y.
Project No.	Drawing No.
10113	C-501B



IBI
333 Preston Street, Suite 400
OTTAWA, ONTARIO
K1S 5N4

Phase 1 & 2 SANITARY SEWER DESIGN SHEET

PROJECT : Huntmar & Hazeldean
CITY OF OTTAWA

DEVELOPER : North American

All sewers are existing

PAGE: 1 OF 1
JOB #: 10113
DATE: Mar 2019
DESIGN: DY

LOCATION			SITE AREA		DESIGN FLOW				EXISTING SEWERS						
Area	FROM MH	TO MH	IND. Area (Ha)	CUMUL. Area (Ha)	PEAK FACT.	DESIGN FLOW (l/s)	INFILT FLOW (l/s)	PEAK FLOW (l/s)	CAPACITY l/s	VELOCITY (full)		PIPE (mm)	GRADE %	VELOCITY AVAIL.	
										m/s	LGTH. (m)			m/s	CAP. (%)
EAST OF HUNTMAR															
11	12A	11A	1.11	1.11	1.50	0.64	0.31	1.27	31.01	0.61	95.3	250	0.25	0.30	95.89%
8A	11A	8A	0.92	2.03	1.50	1.17	0.57	2.33	45.09	0.62	105.2	300	0.20	0.33	94.83%
8B	10A	8A	0.50	0.50	1.50	0.29	0.14	0.57	21.63	0.67	58.1	200	0.40	0.29	97.35%
8C	9A	8A	0.73	0.73	1.50	0.42	0.20	0.84	31.01	0.61	96.5	250	0.25	0.27	97.30%
	8A	7A	0.00	3.26	1.50	1.89	0.91	3.74	45.09	0.62	93.8	300	0.20	0.37	91.70%
	7A	6A	0.00	3.26	1.50	1.89	0.91	3.74	45.09	0.62	17.8	300	0.20	0.37	91.70%
	6A	4A	0.00	3.26	1.50	1.89	0.91	3.74	45.09	0.62	85.7	300	0.20	0.37	91.70%
4	5A	4A	1.79	1.79	1.50	1.04	0.50	2.06	31.01	0.61	49.5	250	0.25	0.35	93.37%
3	4A	3A	1.85	6.90	1.50	3.99	1.93	7.92	45.09	0.62	102.7	300	0.20	0.46	82.43%
2	3A	2A	1.55	8.45	1.50	4.89	2.37	9.70	45.09	0.62	100.1	300	0.20	0.50	78.49%
	2A	1A	0.00	8.45	1.50	4.89	2.37	9.70	97.26	1.33	16.0	300	0.93	0.85	90.03%

Q = average daily flow (commercial lands) 50000 l/d/Ha
M = Commercial Peaking Factor = 1.5
I = Unit of peak extraneous flow 0.28 l/s/Ha
Q(p) = Peak commercial flow (l/s)
Q(i) = Peak extraneous (infiltration) flow (l/s)



SPECIFY

Coeff. of friction (n) = 0.013

REV. # : 1, Dec, 2011
REV. # : 2, FEB, 2012
REV. # : 3, June, 2014 adjust areas 6 & 7 (CRU B-1/B-2)
REV. # : 4, Aug, 2016 revise area numbers
REV. # : 5, March, 2019 SPA

APPENDIX D

- C-920 Sediment & Erosion Plan Phase 1 & 2
- Paterson Group Report
- C-202 Phase 1 & 2 Grading Plan
- Geotechnical Engineer Memo – Phase 1 & 2 Grading Review
- Figure 5.4 KWDA MSP
- MVCA email

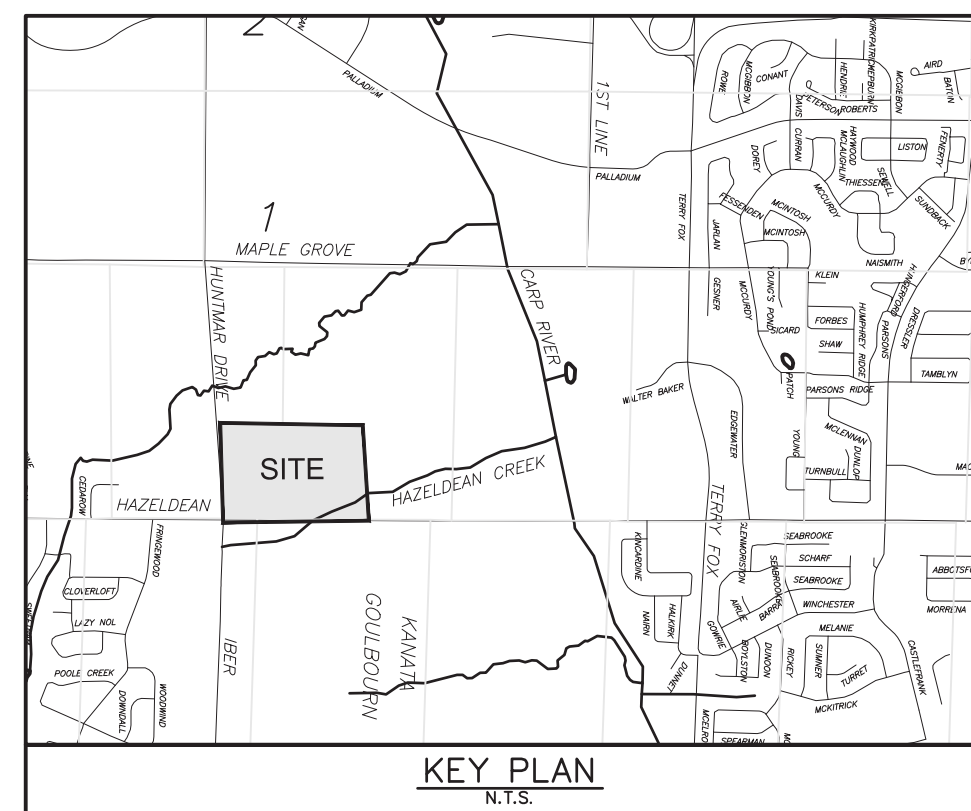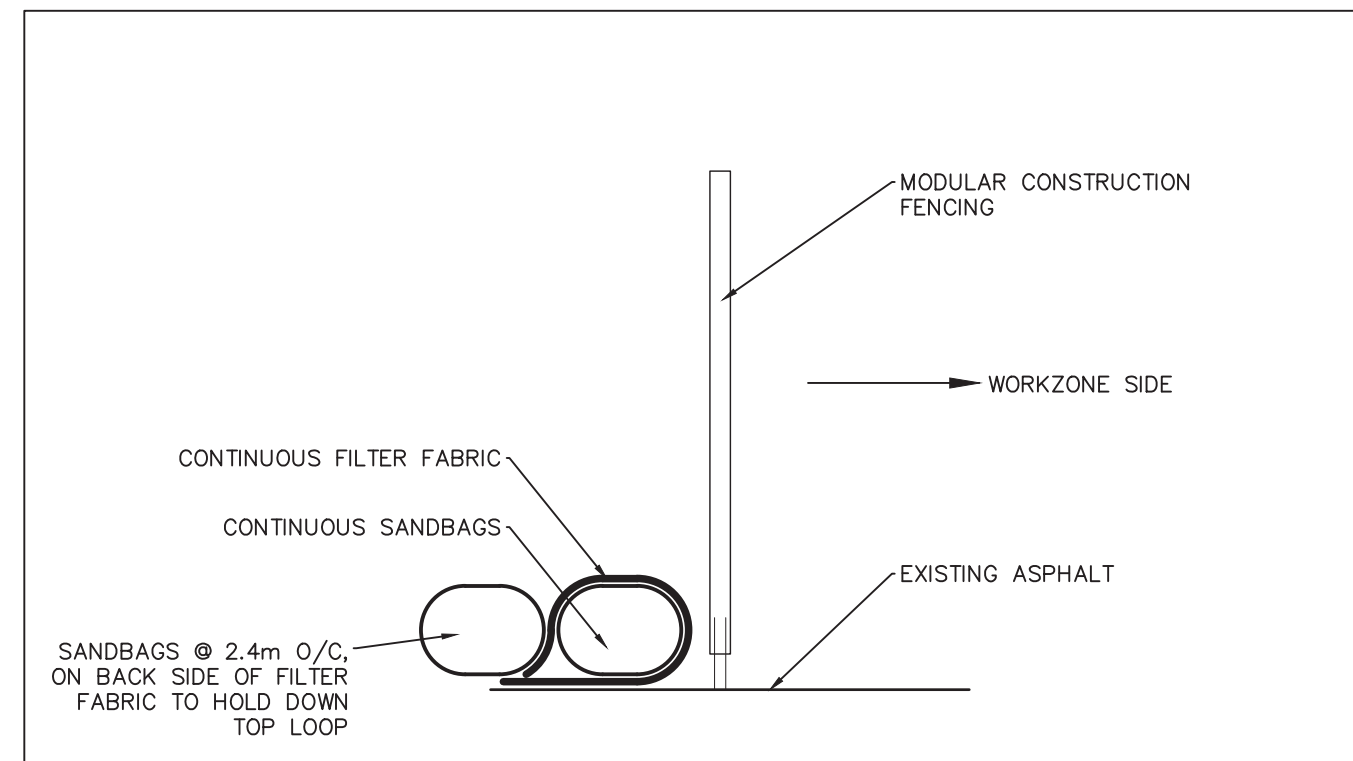

- LEGEND**
- LIGHT DUTY SILT FENCE AS PER OPSD 219.110
 - LIGHT DUTY STRAW BALE BARRIER AS PER OPSD 219.100
 - SILT BAG OR APPROVED EQUAL IN EXISTING CCB OR CB
 - PERIMETER CONSTRUCTION FENCING C/W CONTINUOUS SEDIMENT CONTROL CONSISTING OF SANDBAGS WRAPPED IN FILTER FABRIC


SEDIMENT AND EROSION CONTROL NOTES:

6.1 CONTRACTOR TO IMPLEMENT EROSION AND SEDIMENT CONTROL MEASURES AS IDENTIFIED IN THE EROSION AND SEDIMENT CONTROL PLAN TO THE SATISFACTION OF THE CITY OF OTTAWA. PRIOR TO UNDERTAKING ANY SITE ALTERATIONS (FILLING, GRADING, REMOVAL OF VEGETATION, ETC.), DURING ALL PHASES OF THE SITE PREPARATION AND CONSTRUCTION THE MEASURES ARE TO BE MAINTAINED TO THE SATISFACTION OF THE ENGINEER AND CITY OF OTTAWA. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY AN APPLICABLE REGULATORY AGENCY.

6.2 ANY GROUND WATER PUMPING IS LIMITED TO 10 000L/D, AND SHALL BE DISCHARGED IN TO AN APPROVED FILTER MECHANISM PRIOR TO RELEASE TO THE ENVIRONMENT.


6.3 SEEPAGE BARRIERS WILL BE CONSTRUCTED IN ANY TEMPORARY DRAINAGE DITCH.

6.4 FILTER CLOTHS WILL BE PLACED ON OPEN INFRASTRUCTURES SUCH AS MANHOLE AND CATCH BASIN UNTIL STRUCTURES ARE COMMISSIONED AND PUT IN USE.

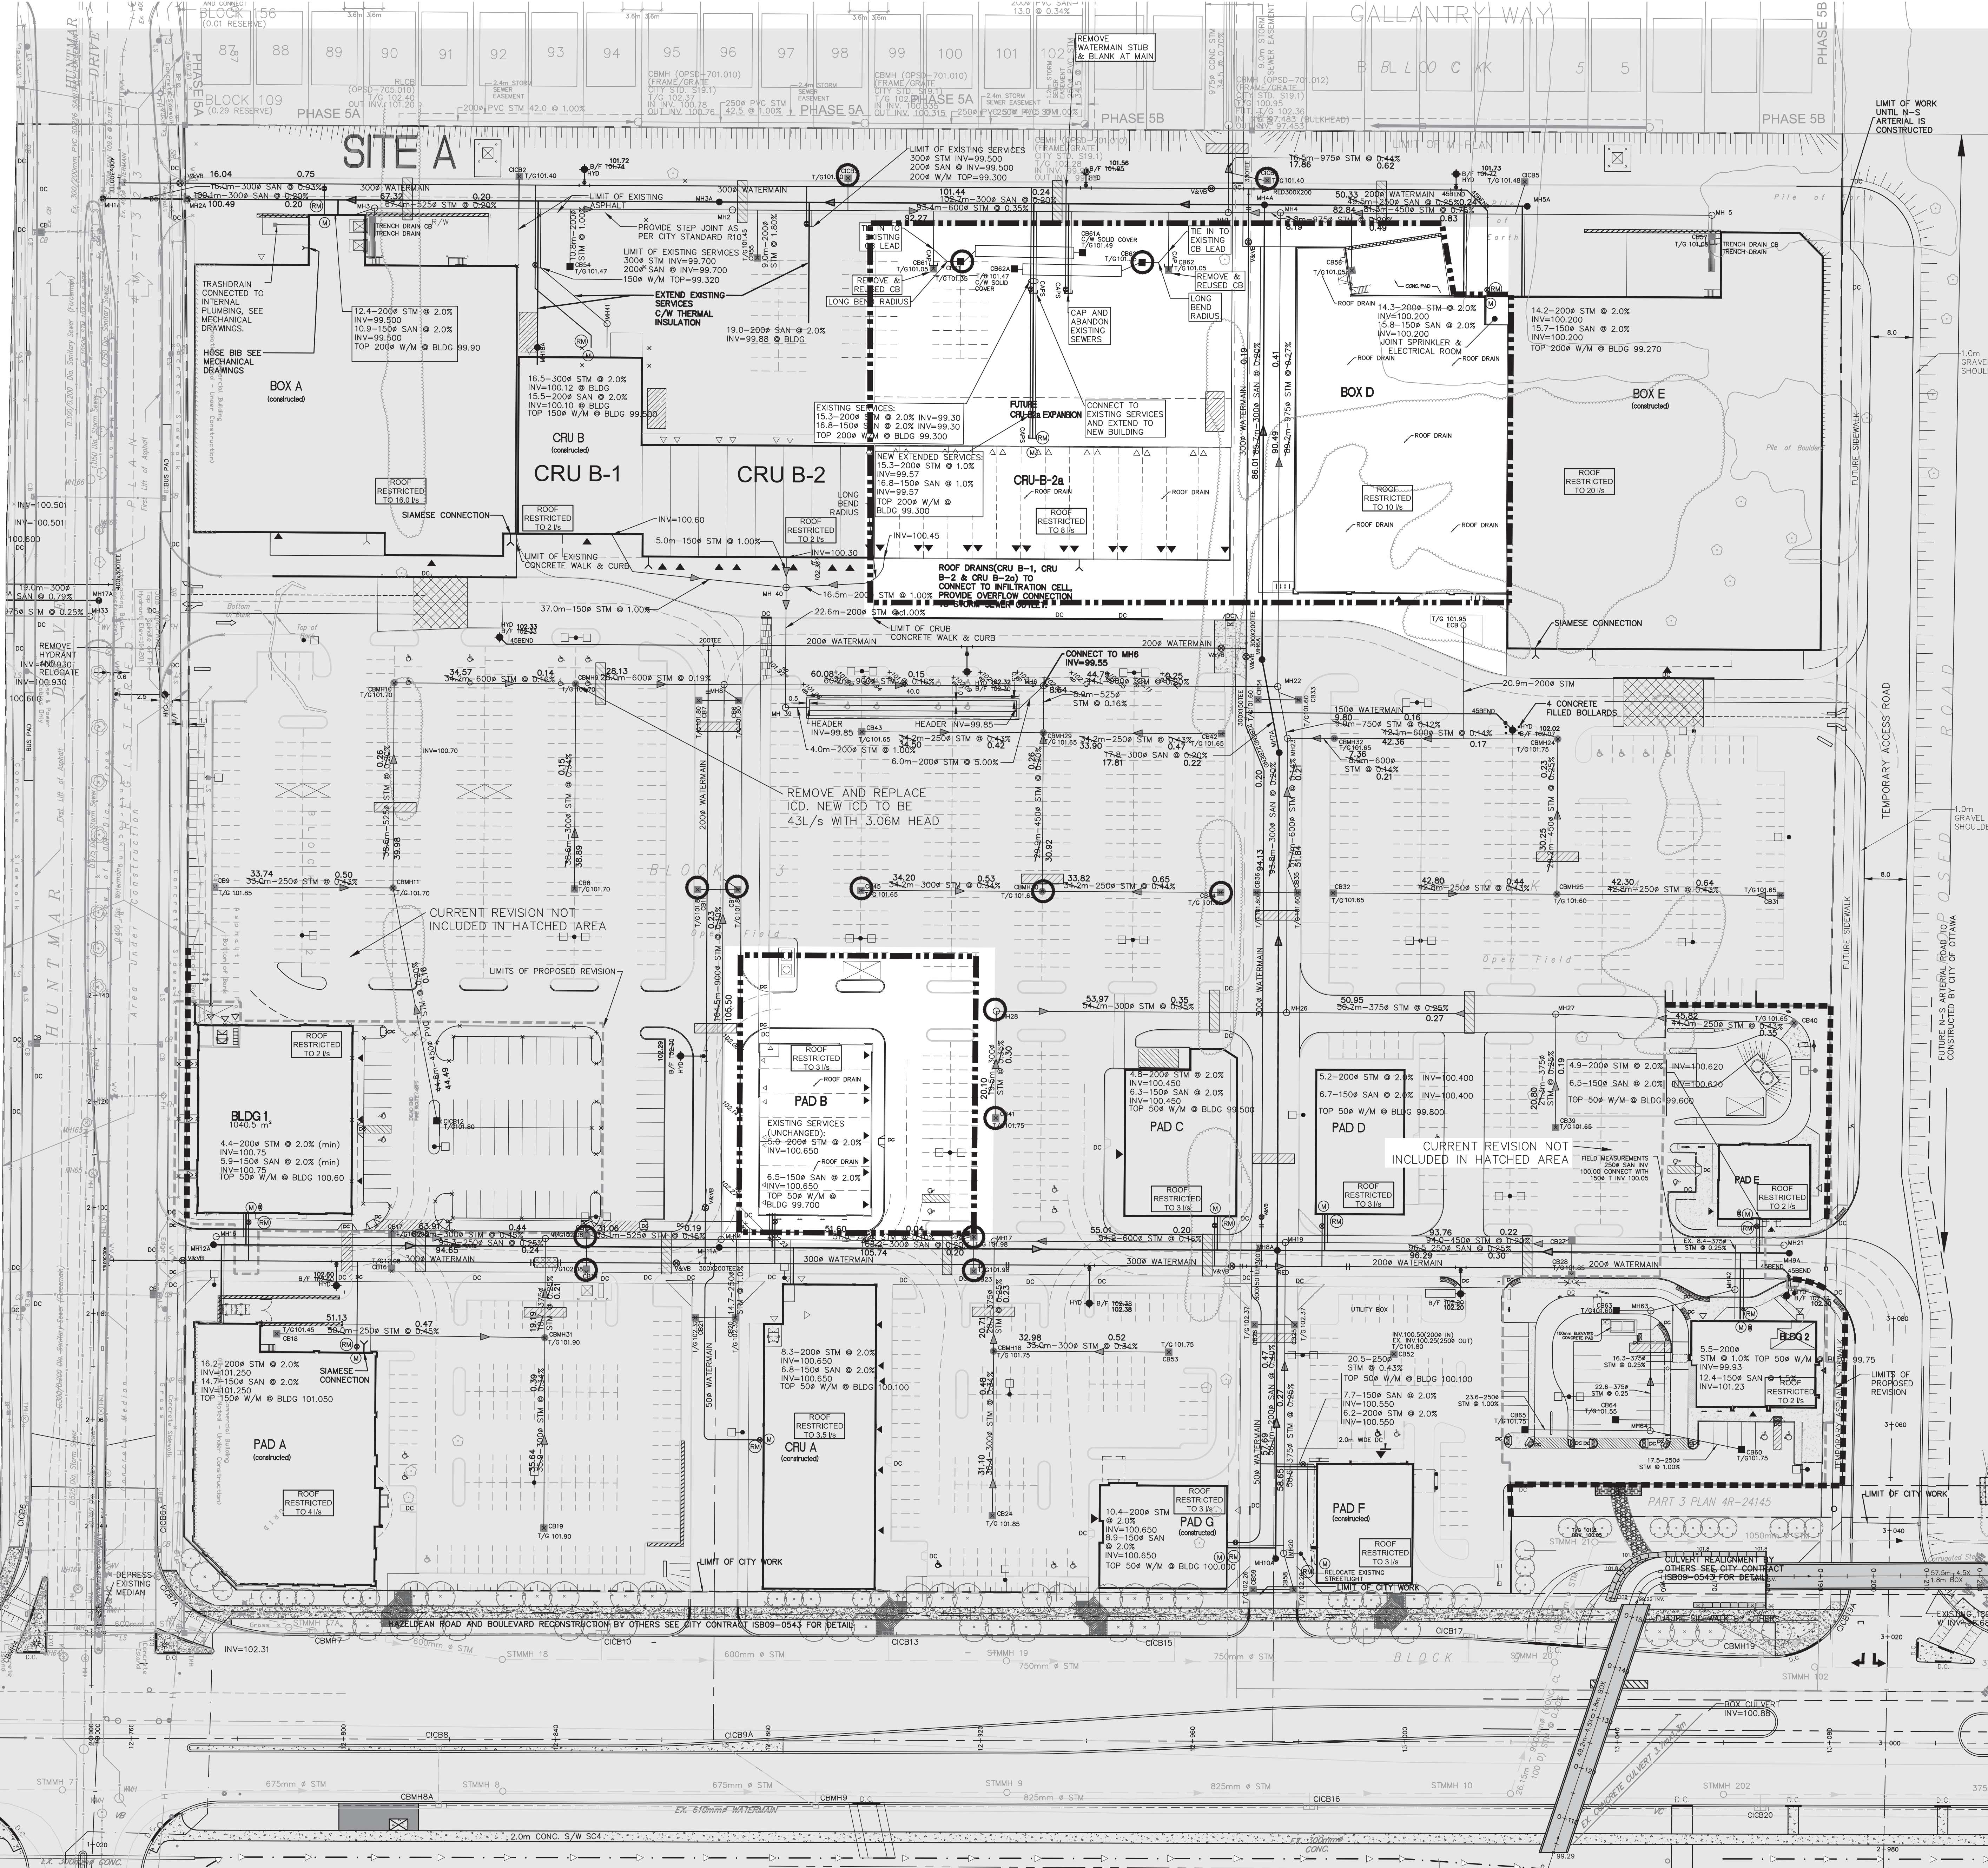


No.	REVISIONS	By	Date
23	REVISED STORAGE CELLS PER		DOY 20-05-15
22	REVISED AS PER CITY		DOY 20-04-30
21	COMMENTS		DOY 20-03-37
20	REVISED AS PER CITY		DOY 19-12-20
19	COMMENTS		DOY 19-08-29
18	ISSUED FOR CONSTRUCTION		DOY 18-04-08
17	ISSUED FOR TENDER		DOY 18-01-15
16	REVISED AS PER CITY COMMENTS		DOY 17-11-23
15	ISSUED FOR SPA		DOY 17-11-02
14	REVISED AS PER SITE PLAN		DOY 17-07-07
13	REVISED AS PER CITY COMMENTS		DOY 17-06-23
12	REVISED BLD 2 & PAD E		DOY 17-02-14
11	REVISED AS PER CITY COMMENTS		DOY 16-08-02
10	SPA BLDG 1 & 2		DOY 16-03-07
9	REVISED AS PER SITE PLAN		DOY 14-11-03
8	SPA		DOY 14-09-09
7	REVISED AS PER SITE PLAN		DOY 14-08-08
6	REVISED AS PER CITY COMMENTS		DOY 14-07-31
5	REVISED DOLLAR & CRUB		DOY 14-06-03
4	REVISED FOR PAD F		DOY 12-11-16
3	REVISED SPRINKLER ROOM		DOY 12-03-09
2	REVISED PER CITY COMMENTS AND PAD E		DOY 12-02-22
1	ISSUED FOR REVIEW		DOY 11-04-19

NORTH AMERICAN DEVELOPMENT GROUP

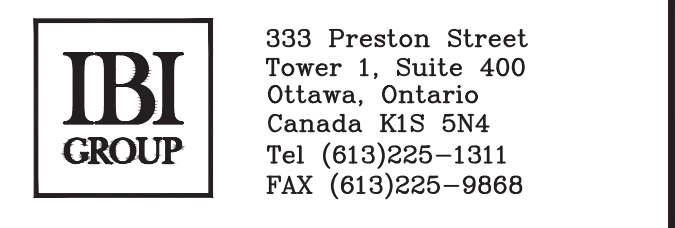

333 Preston Street
Tower 1, Suite 400
Ottawa, Ontario
Canada K1S 5M4
Tel: (613) 225-1311
Fax: (613) 225-9868

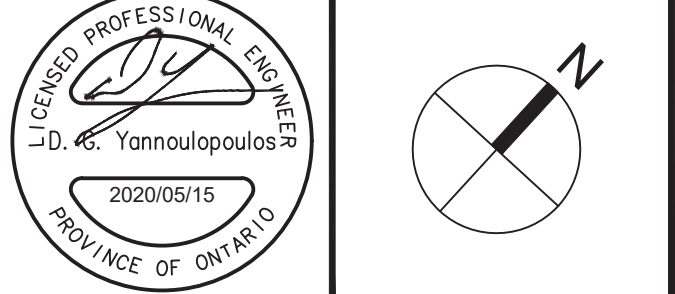

SEDIMENT AND EROSION CONTROL PLAN
PHASE 1 & 2

Scale	1:500
Design	D.G.Y. Date: OCTOBER 2008
Drawn	L.R. Checked: D.G.Y.
Project No.	10113
Drawing No.	C-920

Geotechnical
Engineering

Environmental
Engineering

Hydrogeology

Geological
Engineering

Materials Testing

Building Science

Archaeological
Services

Geotechnical Investigation

Proposed Commercial Development
5707 Hazeldean Road
Ottawa, Ontario

Prepared For

North American (Goulbourne)
Limited Partnership

Paterson Group Inc.

Consulting Engineers
154 Colonnade Road South
Ottawa (Nepean), Ontario
Canada K2E 7J5

Tel: (613) 226-7381
Fax: (613) 226-6344
www.patersongroup.ca

June 28, 2017

Report: PG1899-2 Revision 1

Table of Contents		Page
1.0	Introduction	1
2.0	Proposed Development	1
3.0	Method of Investigation	
	3.1 Field Investigation	2
	3.2 Field Survey	3
	3.3 Laboratory Testing	3
	3.4 Analytical Testing	3
4.0	Observations	
	4.1 Surface Conditions	4
	4.2 Subsurface Profile	4
	4.3 Groundwater	5
5.0	Discussion	
	5.1 Geotechnical Assessment	7
	5.2 Site Grading and Preparation	7
	5.3 Foundation Design	8
	5.4 Design for Earthquakes	10
	5.5 Slab-on-Grade Construction	11
	5.6 Pavement Design	11
6.0	Design and Construction Precautions	
	6.1 Foundation Drainage and Backfill	13
	6.2 Protection Against Frost Action	13
	6.3 Excavation Side Slopes	13
	6.4 Pipe Bedding and Backfill	14
	6.5 Groundwater Control	15
	6.6 Winter Construction	15
	6.7 Corrosion Potential and Sulphate	16
	6.8 Landscaping Considerations	16
7.0	Recommendations	18
8.0	Statement of Limitations	19

Appendices

- Appendix 1** Soil Profile and Test Data Sheets
 Symbols and Terms
 Consolidation Testing Results
 Atterberg Limit Testing Results
- Appendix 2** Figure 1 - Key Plan
 Drawing PG1899-2 - Test Hole Location Plan

1.0 Introduction

Paterson Group (Paterson) was commissioned by North American (Goulbourne) Limited Partnership (North American) to conduct a geotechnical investigation for the commercial development located at the northeast corner of the intersection of Huntmar Drive and Hazeldean Road (5707 Hazeldean Road), in the City of Ottawa, Ontario (refer to Figure 1 - Key Plan in Appendix 2).

The objectives of the current investigation were to:

- Determine the subsoil and groundwater conditions at this site by means of boreholes.
- Provide geotechnical recommendations for the design of the proposed development including construction considerations which may affect the design.

The following report has been prepared specifically and solely for the aforementioned project which is described herein. It contains our findings and includes geotechnical recommendations pertaining to the design and construction of the subject developments as they are understood at the time of writing this report.

2.0 Proposed Development

It is understood that the current phase of the commercial development will consist of several buildings of slab on grade construction. Associated access lanes, parking and landscaped areas are also anticipated.

3.0 Method of Investigation

3.1 Field Investigation

The field program for the current investigation was carried on April 26, 2016. At that time, six (6) boreholes were extended to a maximum depth of 6.4 m. A previous investigation was carried between July 7 and 13, 2009. At that time, eighteen (18) boreholes were extended to a maximum depth of 9.8 m. The test hole locations were distributed across the subject site in a manner to provide general coverage of the proposed buildings. The borehole locations were selected and located in the field by Paterson. The test hole locations are shown on Drawing PG1899-2 - Test Hole Location Plan included in Appendix 2.

The boreholes were put down using a track-mounted auger drill rig operated by a crew of two. All fieldwork was conducted under the full-time supervision of personnel from Paterson's geotechnical division under the direction of a senior engineer. The testing procedure consisted of augering to the required depths at the selected locations and sampling the overburden.

Sampling and In Situ Testing

Soil samples were collected from the boreholes using a 50 mm diameter split-spoon (SS) sampler, using 73 mm diameter thin walled (TW) Shelby tubes in conjunction with a piston sampler, or the auger flights. All soil samples were visually inspected and initially classified on site. The split-spoon samples were placed in sealed plastic bags and the Shelby tubes were sealed at both ends on site. All samples were transported to our laboratory for further examination and classification. The depths at which the split-spoon, Shelby tube, and auger samples were recovered from the test holes are shown as SS, TW, and AU, respectively, on the Soil Profile and Test Data sheets presented in Appendix 1.

The Standard Penetration Test (SPT) was conducted in conjunction with the recovery of the split-spoon samples. The SPT results are recorded as "N" values on the Soil Profile and Test Data sheets. The "N" value is the number of blows required to drive the split-spoon sampler 300 mm into the soil after a 150 mm initial penetration using a 63.5 kg hammer falling from a height of 760 mm.

Undrained shear strength testing was carried out in cohesive soils using a field vane apparatus.

The subsurface conditions observed in the test holes were recorded in detail in the field. The soil profiles are presented on the Soil Profile and Test Data sheets in Appendix 1 of this report.

Groundwater

A flexible standpipe was installed in all boreholes, except BHs 3, 5 and 16, to permit monitoring of the groundwater levels subsequent to the completion of the sampling program.

3.2 Field Survey

The test hole locations for the current investigation were determined in the field by Paterson personnel with consideration of existing site features. It should be noted that the ground surface elevations at the borehole locations are referenced to a temporary benchmark (TBM), consisting of the top of a fire hydrant located northeast of CRU A. A geodetic elevation of 102.38 m was provided for the TBM. The borehole locations for the previous investigation were surveyed by Fairhall, Moffatt & Woodland Limited. The locations and ground surface elevation at the borehole locations are presented on Drawing PG1899-2 - Test Hole Location Plan in Appendix 2.

3.3 Laboratory Testing

All soil samples recovered from the subject site were examined in our laboratory to review the results of the field logging.

All samples will be stored in the laboratory for a period of one month after issuance of this report. The samples will then be discarded unless otherwise directed.

3.4 Analytical Testing

One (1) soil sample was submitted for analytical testing to assess the corrosion potential for exposed ferrous metals and the potential of sulphate attacks against subsurface concrete structures. The sample was submitted to determine the concentration of sulphate and chloride, the resistivity and the pH of the samples. The results are presented in Appendix 1 and are discussed further in Subsection 6.7.

4.0 Observations

4.1 Surface Conditions

The ground surface at the subject site currently consists of asphaltic concrete and or granular fill, with several commercial buildings constructed during the previous development phases of the subject site. The ground surface at the subject site is relatively flat gradually slopes downward to the south. The subject site is approximately at grade with Huntmar Road and Hazeldean Road.

4.2 Subsurface Profile

Generally, the soil profile at the test holes consists of asphaltic concrete and/or granular fill, such as crushed stone and/or silty sand with gravel and cobbles. Very stiff to stiff brown silty clay crust was encountered below the abovenoted fill layers followed by a firm grey silty clay layer. Practical refusal to dynamic cone penetration testing was completed at BHs 4, 6, 11 and 14, at depths varying between 11 and 15 m. Reference should be made to the Soil Profile and Test Data sheets in Appendix 1 for specific details of the soil profile encountered at each test hole location.

Based on available geological mapping, the subject site consists of interbedded dolostone and limestone of the Gull River formation to depth ranging between 3 to 15 m.

Silty Clay

Two (2) samples of silty clay were subjected to unidimensional consolidation (oedometer) testing. The test results are presented in Subsection 5.3 and the Consolidation Test sheets in Appendix 1. The consolidation test results indicate that the silty clay is overconsolidated with overconsolidation ratios (OCR) for the tested samples varying between 1.9 and 2.1. The OCR is the ratio of the preconsolidation pressure to the effective pressure at the sample depth. This is further discussed in Subsection 5.3.

One (1) silty clay sample was submitted for Atterberg Limits testing. The tested material was classified as inorganic clays of low plasticity (CL). The results are summarized in Table 1 and presented on the Atterberg Limits results sheet in Appendix 1.

Table 1 - Summary of Atterberg Limits Tests					
Sample	Moisture Content %	Liquid Limit %	Plastic Limit %	Plasticity Index %	Classification
BH 11 TW 2	41.6	30	18	12	CL

4.3 Groundwater

The measured groundwater levels at the borehole locations are presented in Table 2. It should be noted that groundwater readings could be influenced by surface water infiltrating the backfilled boreholes. The groundwater level can also be estimated based on moisture levels and colour of the recovered soil samples. Based on these observations at the borehole locations, the permanent groundwater table is expected to be between 3 and 4 m depth. It should be noted that groundwater levels are subject to seasonal fluctuations. Therefore, the groundwater level could vary at the time of construction.

Table 2 Summary of Groundwater Level Readings				
Test Hole Number	Ground Elevation, m	Groundwater Levels, m		Recording Date
		Depth	Elevation	
BH1-16	102.08	1.92	100.16	May 3, 2016
BH2-16	102.11	3.62	98.49	May 3, 2016
BH3-16	102.04	2.91	99.13	May 3, 2016
BH4-16	101.83	Dry	n/a	May 3, 2016
BH5-16	101.50	2.20	99.30	May 3, 2016
BH6-16	101.75	3.19	98.56	May 3, 2016
PG1988-1R - February 24, 2012				
BH 1	102.81	1.76	101.05	July 16, 2009
BH 2	102.55	2.28	100.27	July 16, 2009
BH 4	101.98	2.51	99.47	July 16, 2009
BH 6	102.74	1.93	100.81	July 16, 2009
BH 7	102.46	2.03	100.43	July 16, 2009
BH 8	101.92	1.50	100.42	July 16, 2009
BH 9	101.68	1.52	100.16	July 16, 2009

Table 2 Summary of Groundwater Level Readings (continued)				
Test Hole Number	Ground Elevation, m	Groundwater Levels, m		Recording Date
		Depth	Elevation	
BH 10	101.54	1.55	99.99	July 16, 2009
BH 11	101.34	1.40	99.94	July 16, 2009
BH 12	101.15	1.42	99.73	July 16, 2009
BH 13	100.95	0.60	100.35	July 16, 2009
BH 14	100.24	0.52	99.72	July 16, 2009
BH 15	100.76	1.61	99.15	July 16, 2009
BH 17	101.55	1.27	100.28	July 16, 2009
BH 18	100.47	1.58	98.89	July 16, 2009

Note:

The ground surface elevations are referenced to a temporary benchmark (TBM), consisting of the top of a fire hydrant to be located northeast of CRU A. A geodetic elevation of 102.38 m was provided for the TBM.

5.0 Discussions

5.1 Geotechnical Assessment

From a geotechnical perspective, the subject site is considered suitable for the proposed commercial development. It is anticipated that all structures will be founded on conventional shallow footings placed on the undisturbed, stiff to very stiff silty clay. However, due to the presence of a silty clay layer, the proposed development will be subjected to grade raise restrictions.

Our permissible grade raise recommendations are discussed in Subsection 5.3. If higher than permissible grade raises are required, preloading with or without a surcharge, lightweight fill and/or other measures should be investigated to reduce the risks of unacceptable long-term post construction total and differential settlements.

The above and other considerations are further discussed in the following sections.

5.2 Site Grading and Preparation

Stripping Depth

Topsoil, deleterious fill, such as those containing organic materials, and construction debris should be stripped from under any buildings and other settlement sensitive structures.

Fill Placement

Fill used for grading beneath the building areas should consist, unless otherwise specified, of clean imported granular fill, such as Ontario Provincial Standard Specifications (OPSS) Granular A or Granular B Type II. This material should be tested and approved prior to delivery to the site. The fill should be placed in lifts no greater than 300 mm thick and compacted using suitable compaction equipment for the lift thickness. Fill placed beneath the buildings and paved areas should be compacted to at least 98% of its standard Proctor maximum dry density (SPMDD).

Non-specified existing fill along with site-excavated soil can be used as general landscaping fill where settlement of the ground surface is of minor concern. These materials should be spread in thin lifts and at least compacted by the tracks of the spreading equipment to minimize voids. If these materials are to be used to build up the subgrade level for areas to be paved, they should be compacted in thin lifts to a minimum density of 95% of their respective SPMDD.

Non-specified existing fill and site-excavated soils are not suitable for use as backfill against foundation walls unless a composite drainage blanket connected to a perimeter drainage system is provided.

5.3 Foundation Design

Strip footings, up to 3 m wide, and pad footings, up to 5 m wide, placed on an undisturbed, stiff silty clay bearing surface can be designed using a bearing resistance value at serviceability limit states (SLS) of **150 kPa** and a factored bearing resistance value at ultimate limit states (ULS) of **225 kPa**. A geotechnical resistance factor of 0.5 was applied to the bearing resistance value at ULS.

An undisturbed soil bearing surface consists of one from which all topsoil and deleterious materials, such as loose, frozen or disturbed soil, have been removed, in the dry, prior to the placement of concrete for footings.

Footings founded on the silty clay will experience up to 25 mm of total settlement and 15 mm of differential settlement.

Lateral Support

The bearing medium under footing supported structures is required to be provided with adequate lateral support with respect to excavations and different foundation levels. Adequate lateral support is provided to very stiff to stiff silty clay above groundwater table when a plane extending down and out from the bottom edge of the footing at a minimum of 1.5H:1V passes only through in situ soil of the same or higher capacity as the bearing medium soil.

Settlement/Grade Raise

Consideration must be given to potential settlements which could occur due to the presence of the silty clay deposit and the combined loads from the proposed footings, any groundwater lowering effects, and grade raise fill. The foundation loads to be considered for the settlement case are the continuously applied loads which consist of the unfactored dead loads and the portion of the unfactored live load that is considered to be continuously applied.

Generally, the potential long term settlement is evaluated based on the compressibility characteristics of the silty clay. These characteristics are estimated in the laboratory by conducting unidimensional consolidation tests on undisturbed soil samples collected using Shelby tubes in conjunction with a piston sampler. Two (2) site specific consolidation tests are being carried out for this project. The results of the consolidation tests are included in Appendix 1 to the present report.

Value p'_c is the preconsolidation pressure of the sample and p'_o is the effective overburden pressure. The difference between these values is the available preconsolidation. The increase in stress on the soil due to the cumulative effects of the fill surcharge, the footing pressures, the slab loadings and the lowering of the groundwater should not exceed the available preconsolidation if unacceptable settlements are to be avoided.

The values C_{cr} and C_c are the recompression and compression indices, respectively, and are a measure of the compressibility of the soil due to stress increases below and above the preconsolidation pressures. The higher values for the C_c , as compared to the C_{cr} , illustrate the increased settlement potential above, as compared to below, the preconsolidation pressure.

It should be noted that the values of p'_c , p'_o , C_{cr} and C_c are determined using standard engineering practices and are estimates only. In addition, natural variations within the soil deposit would also affect the results. Furthermore, the p'_o parameter is directly influenced by the groundwater level. While the groundwater levels were measured at the time of the fieldwork, the levels vary with time and this has an impact on the available preconsolidation. Lowering the groundwater level increases the p'_o and therefore reduces the available preconsolidation. Unacceptable settlements could be induced by a significant lowering of the groundwater level. The p'_o values for the consolidation tests carried out for the present investigation are based on the long term groundwater level being 0.5 m above the bottom of the silty clay crust. The level of the groundwater level is based on the colour and undrained shear strength profile of the silty clay.

For design purposes, the total and differential settlements associated with the combination of grade raises and footing loading conditions using the bearing resistance values are estimated to be 25 and 20 mm, respectively. A post-development groundwater lowering of 0.5 m was assumed.

Table 3							
Summary of Consolidation Test Results							
Borehole No.	Sample	Depth (m)	p'_c (kPa)	p'_o (kPa)	C_{cr}	C_c	Q (*)
BH 11	TW 2	4.99	148	70	0.013	0.674	A
BH 18	TW 4	5.07	126	65	0.013	0.466	A
* - Q - Quality assessment of sample - G: Good A: Acceptable P: Likely disturbed							

To reduce potential long term liabilities, consideration should be given to provide means to reduce long term groundwater lowering (e.g. clay dykes, restriction on planting around the structures, etc). It should be noted that building on silty clay deposits increases the likelihood of building movements and therefore of cracking. The use of steel reinforcement in foundations placed at key structural locations will tend to reduce foundation cracking as compared to unreinforced foundations.

Based on our laboratory and field testing results, a permissible grade raise restriction of 1.2 m is recommended for the subject site.

If higher grade raises and/or higher loading conditions are required, post construction settlements can be reduced by several methods. The following options can be considered:

- preloading and surcharging
- lightweight fill (LWF)

5.4 Design for Earthquakes

The site class for seismic site response is a **Class D** for the foundations considered. The soils underlying the subject site are not susceptible to liquefaction. Reference should be made to the latest revision of the Ontario Building Code 2012 (OBC 2012; Table 4.1.8.4 A) for a full discussion of the earthquake design requirements.

5.5 Slab-on-Grade Construction

With the removal of the topsoil layer and fill containing organic matter, within the footprint of the proposed building, the native soil surface will be considered to be an acceptable subgrade on which to commence backfilling for floor slab construction.

Any soft areas should be removed and backfilled with appropriate backfill material prior to placing any fill. OPSS Granular B Type II, with a maximum particle size of 50 mm, are recommended for backfilling below the floor slab. It is recommended that the upper 200 mm of sub-floor fill consists of OPSS Granular A crushed stone for slab on grade construction. All backfill material within the footprint of the proposed building should be placed in maximum 300 mm thick loose layers and compacted to at least 98% of its SPMDD.

5.6 Pavement Design

For design purposes, the pavement structures presented in the following tables could be used for the design of car only parking areas and access lanes.

Table 4 - Recommended Pavement Structure Car Only Parking Areas	
Thickness mm	Material Description
50	WEAR COURSE - Superpave 12.5 Asphaltic Concrete
150	BASE - OPSS Granular A Crushed Stone
300	SUBBASE - OPSS Granular B Type II
SUBGRADE - Either in situ soil, fill or OPSS Granular B Type I or II material placed over in situ soil or fill.	

Table 5 - Recommended Pavement Structure Access Lanes, Fire Routes and Heavy Truck Parking Areas	
Thickness mm	Material Description
40	WEAR COURSE - Superpave 12.5 Asphaltic Concrete
50	BINDER COURSE - Superpave 19.0 Asphaltic Concrete
150	BASE - OPSS Granular A Crushed Stone
400	SUBBASE - OPSS Granular B Type II
SUBGRADE - Either in situ soil, fill or OPSS Granular B Type I or II material placed over in situ soil, or fill.	

Minimum Performance Graded (PG) 58-34 asphalt cement should be used for this project.

If soft spots develop in the subgrade during compaction or due to construction traffic, the affected areas should be excavated and replaced with OPSS Granular B Type I or II material. Weak subgrade conditions may be experienced over service trench fill materials.

The pavement granular base and subbase should be placed in maximum 300 mm thick lifts and compacted to a minimum of 100% of the material’s SPMDD using suitable vibratory equipment.

Pavement Structure Drainage

Satisfactory performance of the pavement structure is largely dependent on keeping the contact zone between the subgrade material and the base stone in a dry condition. Failure to provide adequate drainage under conditions of heavy wheel loading can result in the fine subgrade soil being pumped into the voids in the stone subbase, thereby reducing its load carrying capacity.

In areas where silty clay is encountered at subgrade, consideration should be given to installing subdrains during the pavement construction as per City of Ottawa standards. The subdrain inverts should be approximately 300 mm below subgrade level. The subgrade surface should be crowned to promote water flow to the drainage lines.

6.0 Design and Construction Precautions

6.1 Foundation Drainage and Backfill

It is recommended that a perimeter foundation drainage system be provided for the proposed structures. The system should consist of a 100 mm to 150 mm diameter perforated corrugated plastic pipe, surrounded on all sides by 150 mm of 10 mm clear crushed stone, placed at the footing level around the exterior perimeter of the structure. The pipe should have a positive outlet, such as a gravity connection to the storm sewer or sump pit.

Backfill against the exterior sides of the foundation walls should consist of free-draining non frost susceptible granular materials. The greater part of the site excavated materials will be frost susceptible and, as such, are not recommended for re-use as backfill against the foundation walls, unless used in conjunction with a drainage geocomposite, such as Miradrain G100N or Delta Drain 6000, connected to the perimeter foundation drainage system. Imported granular materials, such as clean sand or OPSS Granular B Type I granular material, should otherwise be used for this purpose.

6.2 Protection Against Frost Action

Perimeter footings of heated structures are required to be insulated against the deleterious effects of frost action. A minimum of 1.5 m of soil cover alone, or a minimum of 0.6 m of soil cover, in conjunction with foundation insulation, should be provided in this regard.

Exterior unheated footings, such as those for isolated exterior piers, are more prone to deleterious movement associated with frost action than the exterior walls of the structure proper and require additional protection, such as soil cover of 2.1 m or a combination of soil cover and foundation insulation.

6.3 Excavation Side Slopes

The side slopes of excavations in the soil and fill overburden materials should either be cut back at acceptable slopes or should be retained by shoring systems from the start of the excavation until the structure is backfilled. It is assumed that sufficient room will be available for the greater part of the excavation to be undertaken by open-cut methods (i.e. unsupported excavations).

The excavation side slopes above the groundwater level extending to a maximum depth of 3 m should be cut back at 1H:1V or flatter. The flatter slope is required for excavation below groundwater level. The subsoil at this site is considered to be mainly Type 2 soil according to the Occupational Health and Safety Act and Regulations for Construction Projects.

Excavated soil should not be stockpiled directly at the top of excavations and heavy equipment should be kept away from the excavation sides.

Slopes in excess of 3 m in height should be periodically inspected by the geotechnical consultant in order to detect if the slopes are exhibiting signs of distress.

It is recommended that a trench box be used at all times to protect personnel working in trenches with steep or vertical side walls.

6.4 Pipe Bedding and Backfill

The pipe bedding for sewer and water pipes should consist of at least 150 mm of OPSS Granular A material. Where the bedding is located within the firm grey silty clay, the thickness of the bedding material should be increased to a minimum of 300 mm. The material should be placed in maximum 300 mm thick lifts and compacted to a minimum of 95% of its SPMDD. The bedding material should extend at least to the spring line of the pipe.

The cover material, which should consist of OPSS Granular A, should extend from the spring line of the pipe to at least 300 mm above the obvert of the pipe. The material should be placed in maximum 300 mm thick lifts and compacted to a minimum of 95% of its SPMDD.

It should generally be possible to re-use the moist (not wet) brown silty clay above the cover material if the excavation and filling operations are carried out in dry weather conditions. Wet silty clay materials will be difficult to re-use, as the high water contents make compacting impractical without an extensive drying period.

Where hard surface areas are considered above the trench backfill, the trench backfill material within the frost zone (about 1.8 m below finished grade) should match the soils exposed at the trench walls to minimize differential frost heaving. The trench backfill should be placed in maximum 300 mm thick loose lifts and compacted to a minimum of 95% of the material's SPMDD.

To reduce long-term lowering of the groundwater level at this site, clay seals should be provided in the service trenches. The seals should be at least 1.5 m long and should extend from trench wall to trench wall. Generally, the seals should extend from the frost line and fully penetrate the bedding, subbedding and cover material. The barriers should consist of relatively dry and compactable brown silty clay placed in maximum 225 mm thick loose layers and compacted to a minimum of 95% of the material's SPMDD. The clay seals should be placed at the site boundaries and at strategic locations at no more than 60 m intervals in the service trenches.

6.5 Groundwater Control

The groundwater infiltration into the excavations should be low and controllable with open sumps. Pumping from open sumps should be sufficient to control the groundwater influx through the sides of shallow excavations. The contractor should be prepared to direct water away from all bearing surfaces and subgrades, regardless of the source, to prevent disturbance to the founding medium.

A temporary MOE permit to take water (PTTW) may be required for this project if more than 50,000 L/day is to be pumped during the construction phase. A minimum of 4 to 5 months should be allowed for completion of the application and issuance of the permit by the MOE.

6.6 Winter Construction

The subsoil conditions at this site mostly consist of frost susceptible materials. In presence of water and freezing conditions ice could form within the soil mass. Heaving and settlement upon thawing could occur. Precautions should be taken if winter construction is considered for this project.

In the event of construction during below zero temperatures, the founding stratum should be protected from freezing temperatures by the use of straw, propane heaters and tarpaulins or other suitable means. In this regard, the base of the excavations should be insulated from sub-zero temperatures immediately upon exposure and until such time as heat is adequately supplied to the building and the footings are protected with sufficient soil cover to prevent freezing at founding level.

The trench excavations should be carried out in a manner that will avoid the introduction of frozen materials into the trenches. As well, pavement construction is difficult during winter. The subgrade consists of frost susceptible soils which will experience total and differential frost heaving as the work takes place. In addition, the introduction of frost, snow or ice into the pavement materials, which is difficult to avoid, could adversely affect the performance of the pavement structure. Additional information could be provided, if required.

6.7 Corrosion Potential and Sulphate

The analytical testing results are presented in Table 6 along with industry standards for the applicable threshold values. These results are indicative that Type 10 Portland cement (Type GU, or normal cement) would be appropriate for this site.

Table 6 - Corrosion Potential			
Parameter	Laboratory Results	Threshold	Commentary
	BH6 SS2		
Chloride	66 µg/g	Chloride content less than 400 mg/g	Negligible concern
pH	7.5	pH value less than 5.0	Neutral Soil
Resistivity	21.8 ohm.m	Resistivity greater than 1,500 ohm.cm	Moderate Corrosion Potential
Sulphate	251 µg/g	Sulphate value greater than 1 mg/g	Negligible Concern

6.8 Landscaping Considerations

The proposed development is located in a moderate sensitivity area with respect to tree plantings over a silty clay deposit. It is recommended that trees placed within 4 m of the foundation wall should consist of low water demanding trees with shallow roots systems that extend less than 1.5 m below ground surface. Trees placed greater than 4 m from the foundation wall may consist of typical street trees, which are typically moderate water demand species with roots extending to a maximum depth of 2 m below ground surface.

It is well documented in the literature, and is our experience, that fast-growing trees located near buildings founded on cohesive soils that shrink on drying can result in long-term differential settlements of the structures. Tree varieties that have the most pronounced effect on foundations are seen to consist of poplars, willows and some maples (i.e. Manitoba Maples) and, as such, they should not be considered in the landscaping design.

7.0 Recommendations

It is recommended that the following be carried out once the master plan and site development are determined:

- Review master grading plan from a geotechnical perspective, once available.
- Review detailed grading plan(s) from a geotechnical perspective.
- Observation of all bearing surfaces prior to the placement of concrete.
- Periodic observation of the condition of unsupported excavation side slopes in excess of 3 m in height, if applicable.
- Observation of all subgrades prior to backfilling and follow-up field density tests to ensure that the specified level of compaction has been achieved.
- Sampling and testing of the bituminous concrete including mix design reviews.

A report confirming that these works have been conducted in general accordance with our recommendations could be issued upon request, following the completion of a satisfactory material testing and observation program by the geotechnical consultant.

8.0 Statement of Limitations

The recommendations made in this report are in accordance with our present understanding of the project. The client should be aware that any information pertaining to soils and all test hole logs are furnished as a matter of general information only and test hole descriptions or logs are not to be interpreted as descriptive of conditions at locations other than those of the test holes.

The recommendations provided herein should only be used by the design professionals associated with this project. They are not intended for contractors bidding on or undertaking the work.

The present report applies only to the project described in this document. Use of this report for purposes other than those described herein or by person(s) other than North American (Goulbourne) Limited Partnership Limited or their agent(s) are not authorized without review by this firm for the applicability of our recommendations to the altered use of the report.

Paterson Group Inc.

Faisal I. Abou-Seido, P.Eng.



David J. Gilbert, P.Eng.



Report Distribution:

- North American (Goulbourne) Limited Partnership Limited (3 copies)
- Paterson Group (1 copy)

APPENDIX 1

SOIL PROFILE AND TEST DATA SHEETS

SYMBOLS AND TERMS

CONSOLIDATION TESTING RESULTS

ATTERBERG LIMIT TESTING RESULTS

ANALYTICAL TESTING RESULTS

DATUM TBM - Top spindle of fire hydrant. Geodetic elevation = 102.38m.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH 1-16**

BORINGS BY CME 55 Power Auger

DATE April 26, 2016

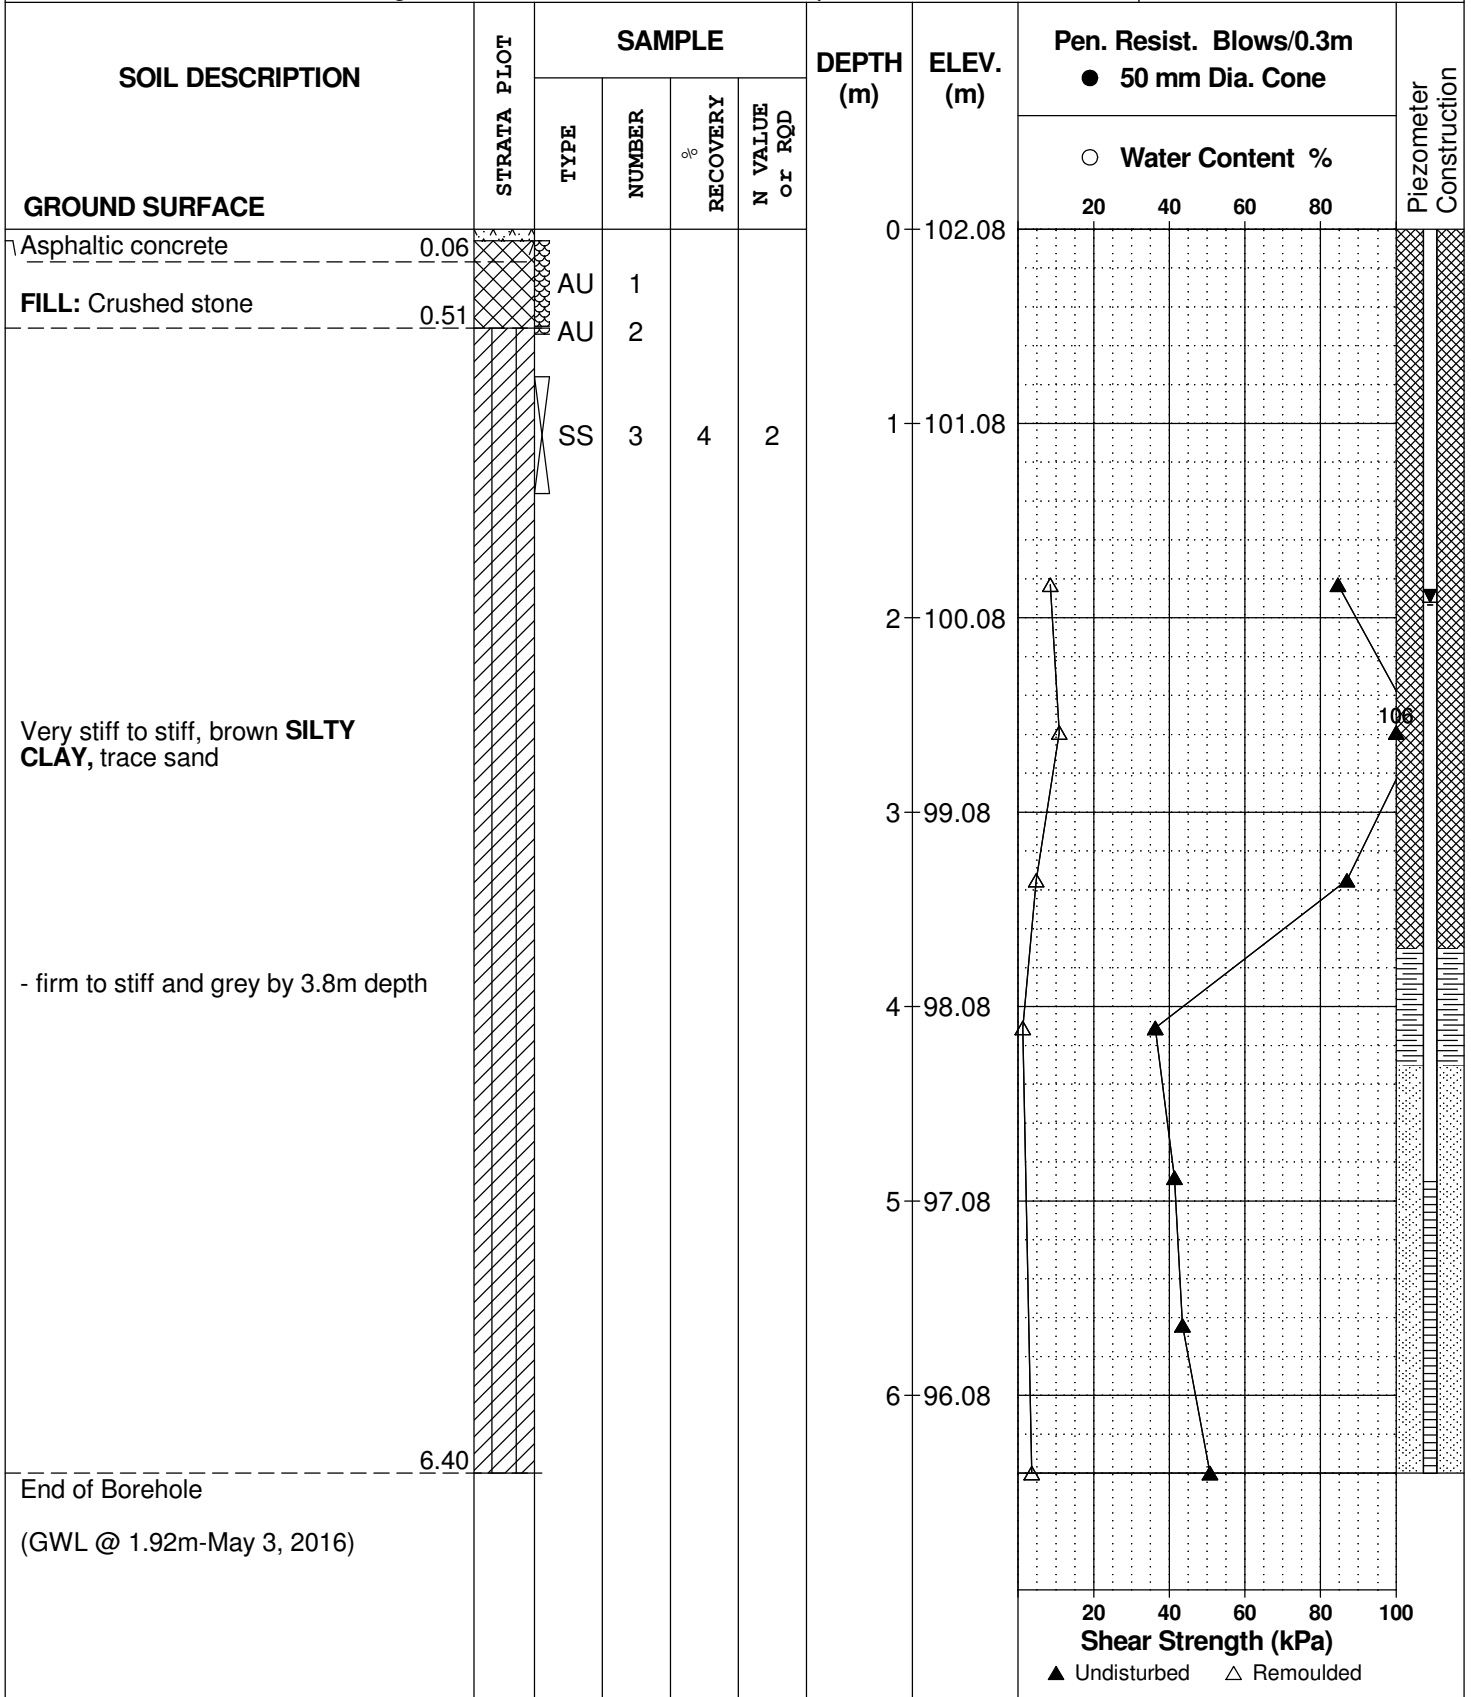

DATUM TBM - Top spindle of fire hydrant. Geodetic elevation = 102.38m.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH 2-16**

BORINGS BY CME 55 Power Auger

DATE April 26, 2016

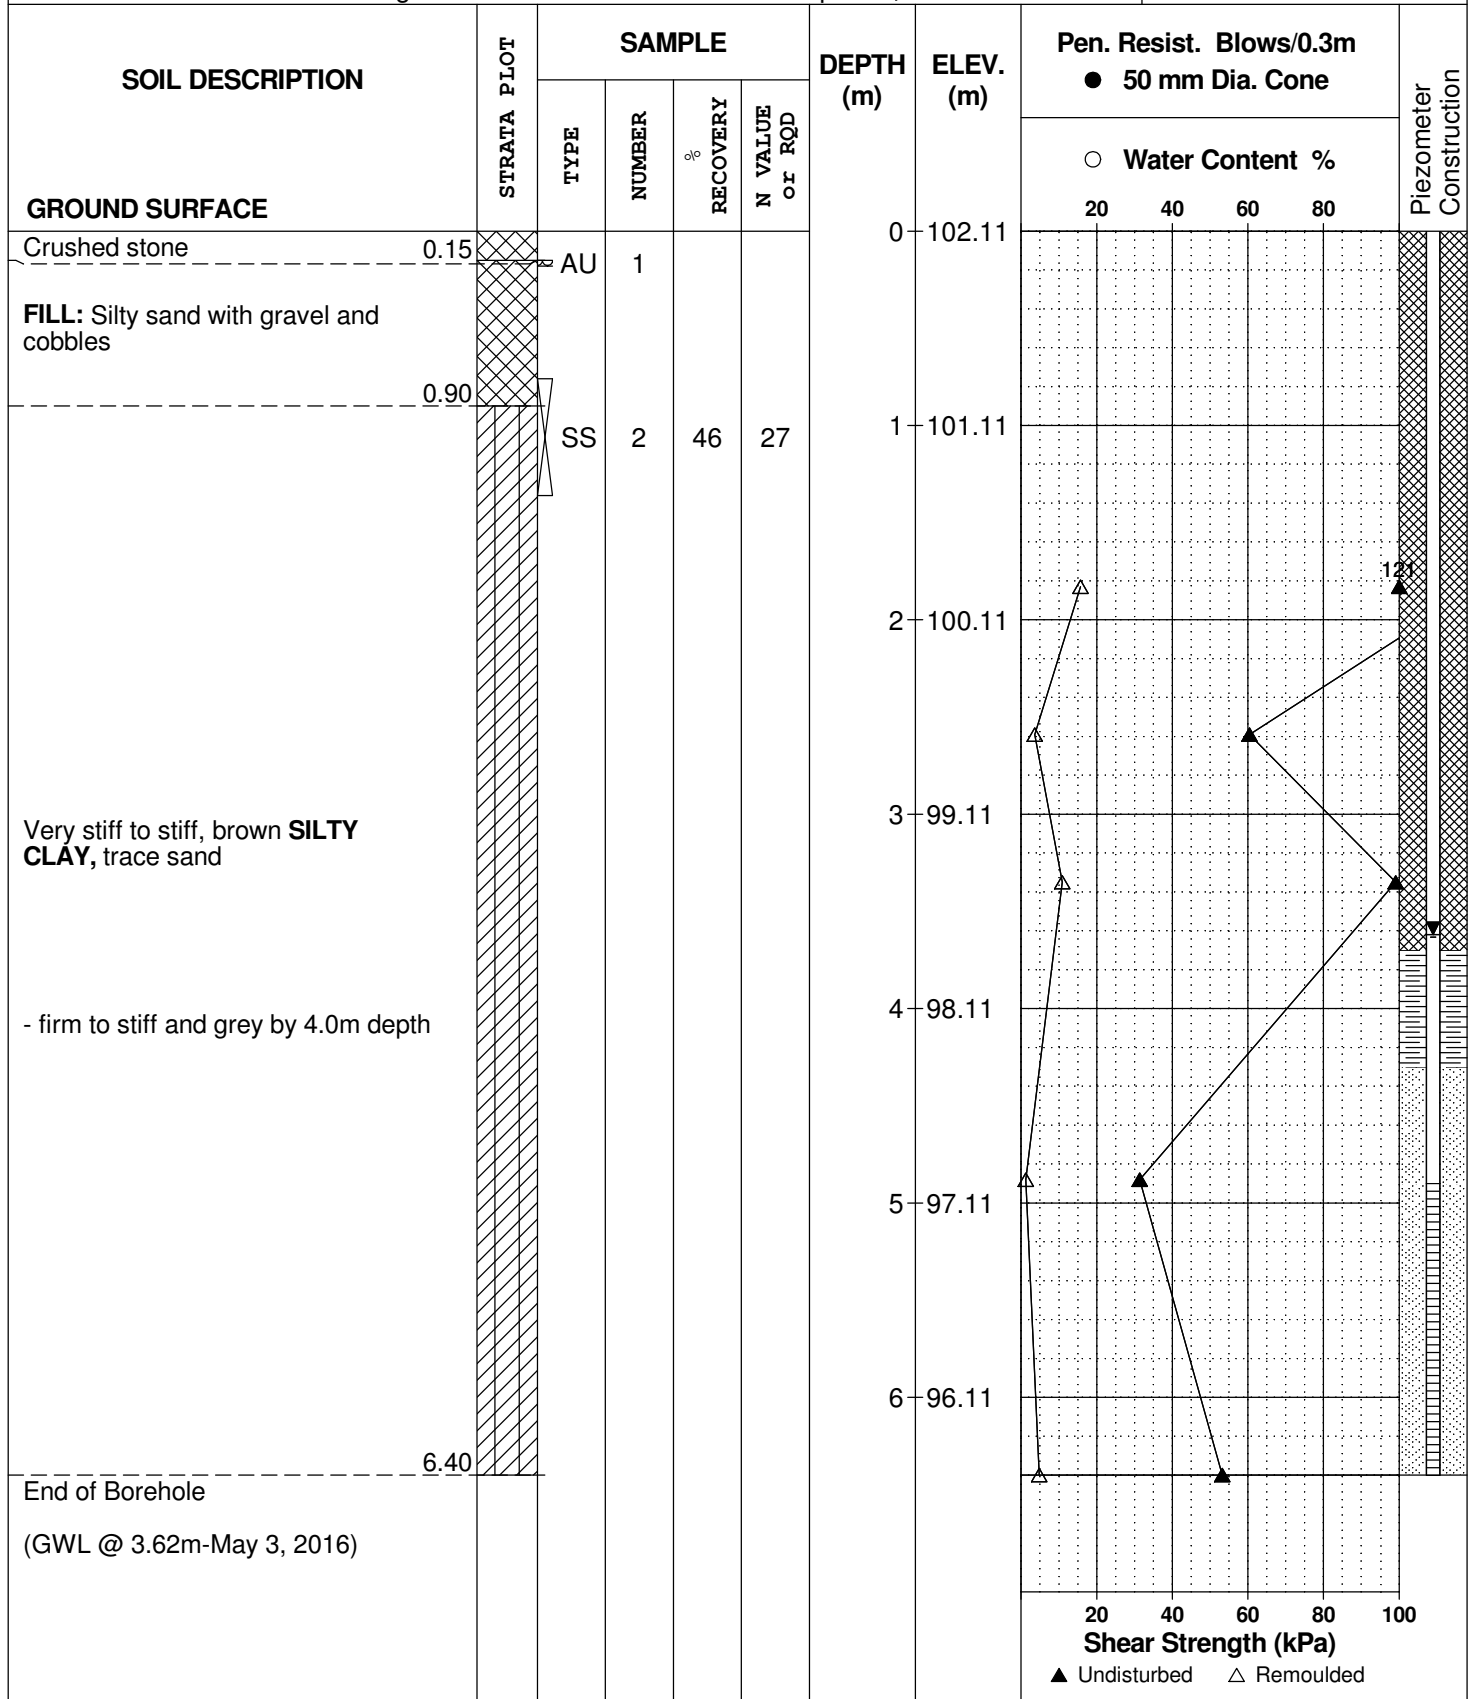

DATUM TBM - Top spindle of fire hydrant. Geodetic elevation = 102.38m.


REMARKS

BORINGS BY CME 55 Power Auger

DATE April 26, 2016

FILE NO. **PG1899**

HOLE NO. **BH 3-16**

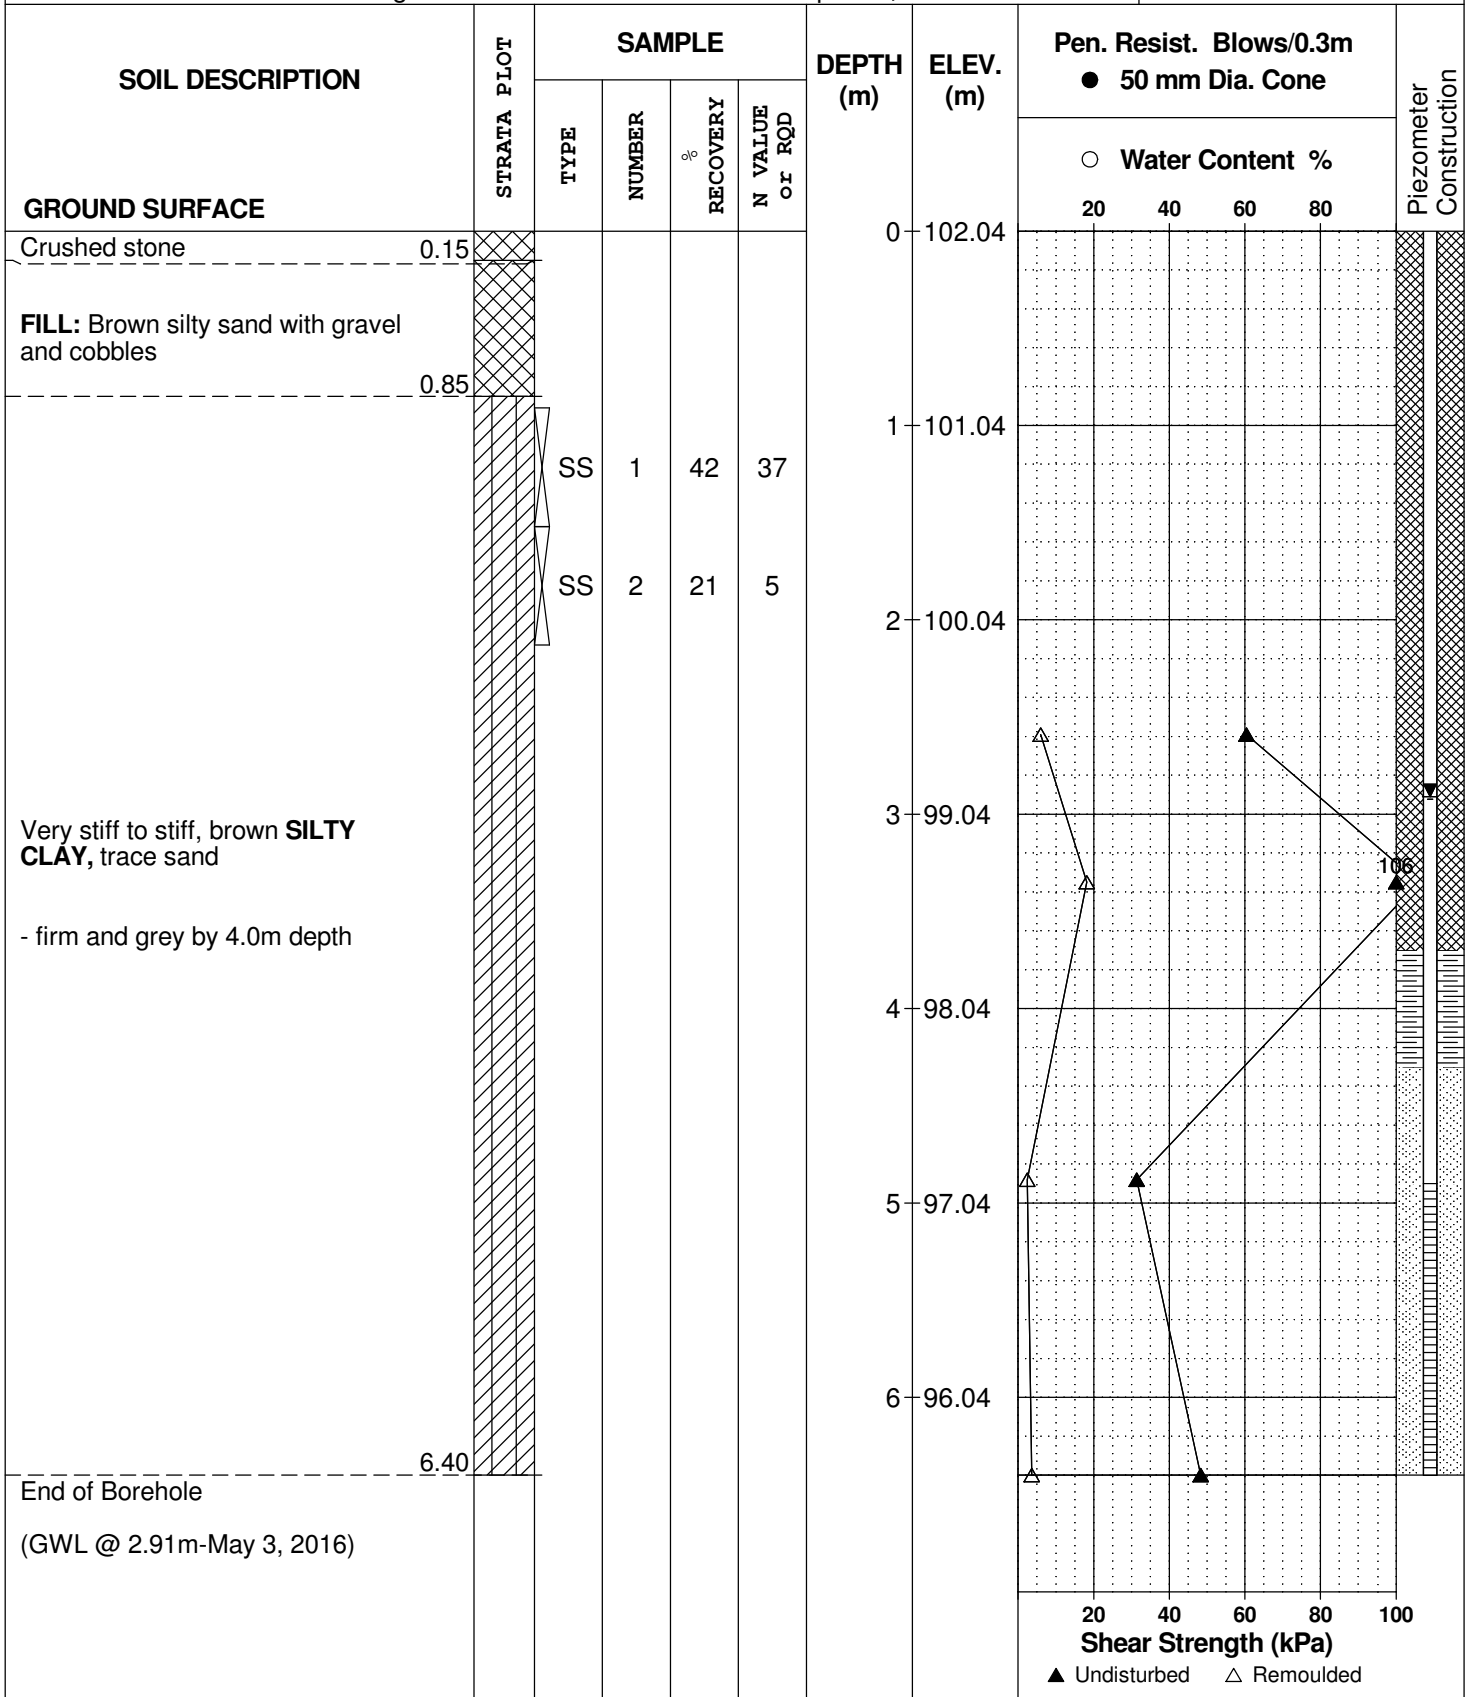

DATUM TBM - Top spindle of fire hydrant. Geodetic elevation = 102.38m.


REMARKS

BORINGS BY CME 55 Power Auger

DATE April 26, 2016

FILE NO. **PG1899**

HOLE NO. **BH 4-16**

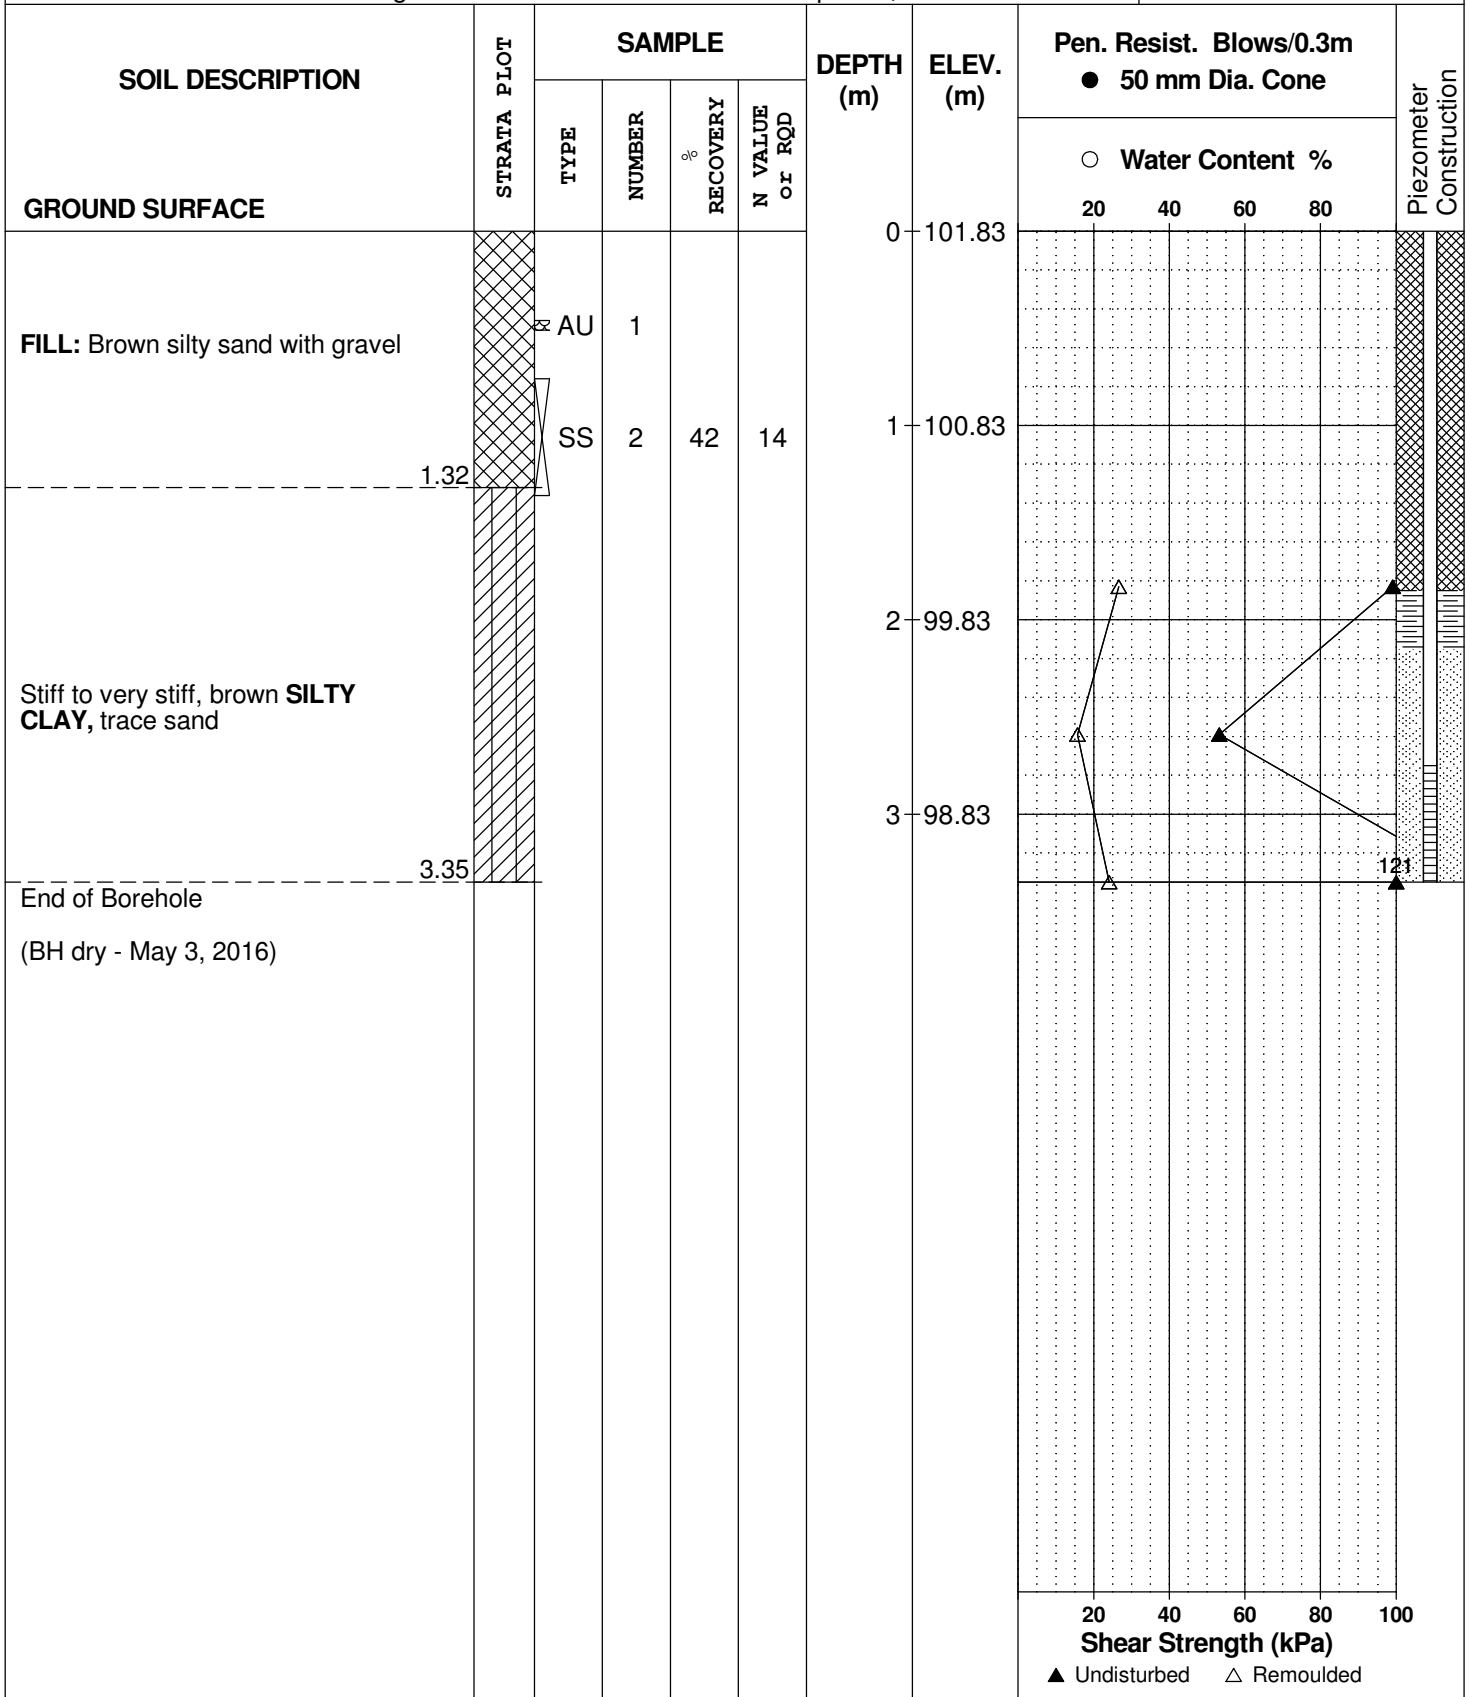

DATUM TBM - Top spindle of fire hydrant. Geodetic elevation = 102.38m.


REMARKS

BORINGS BY CME 55 Power Auger

DATE April 26, 2016

FILE NO. **PG1899**

HOLE NO. **BH 5-16**

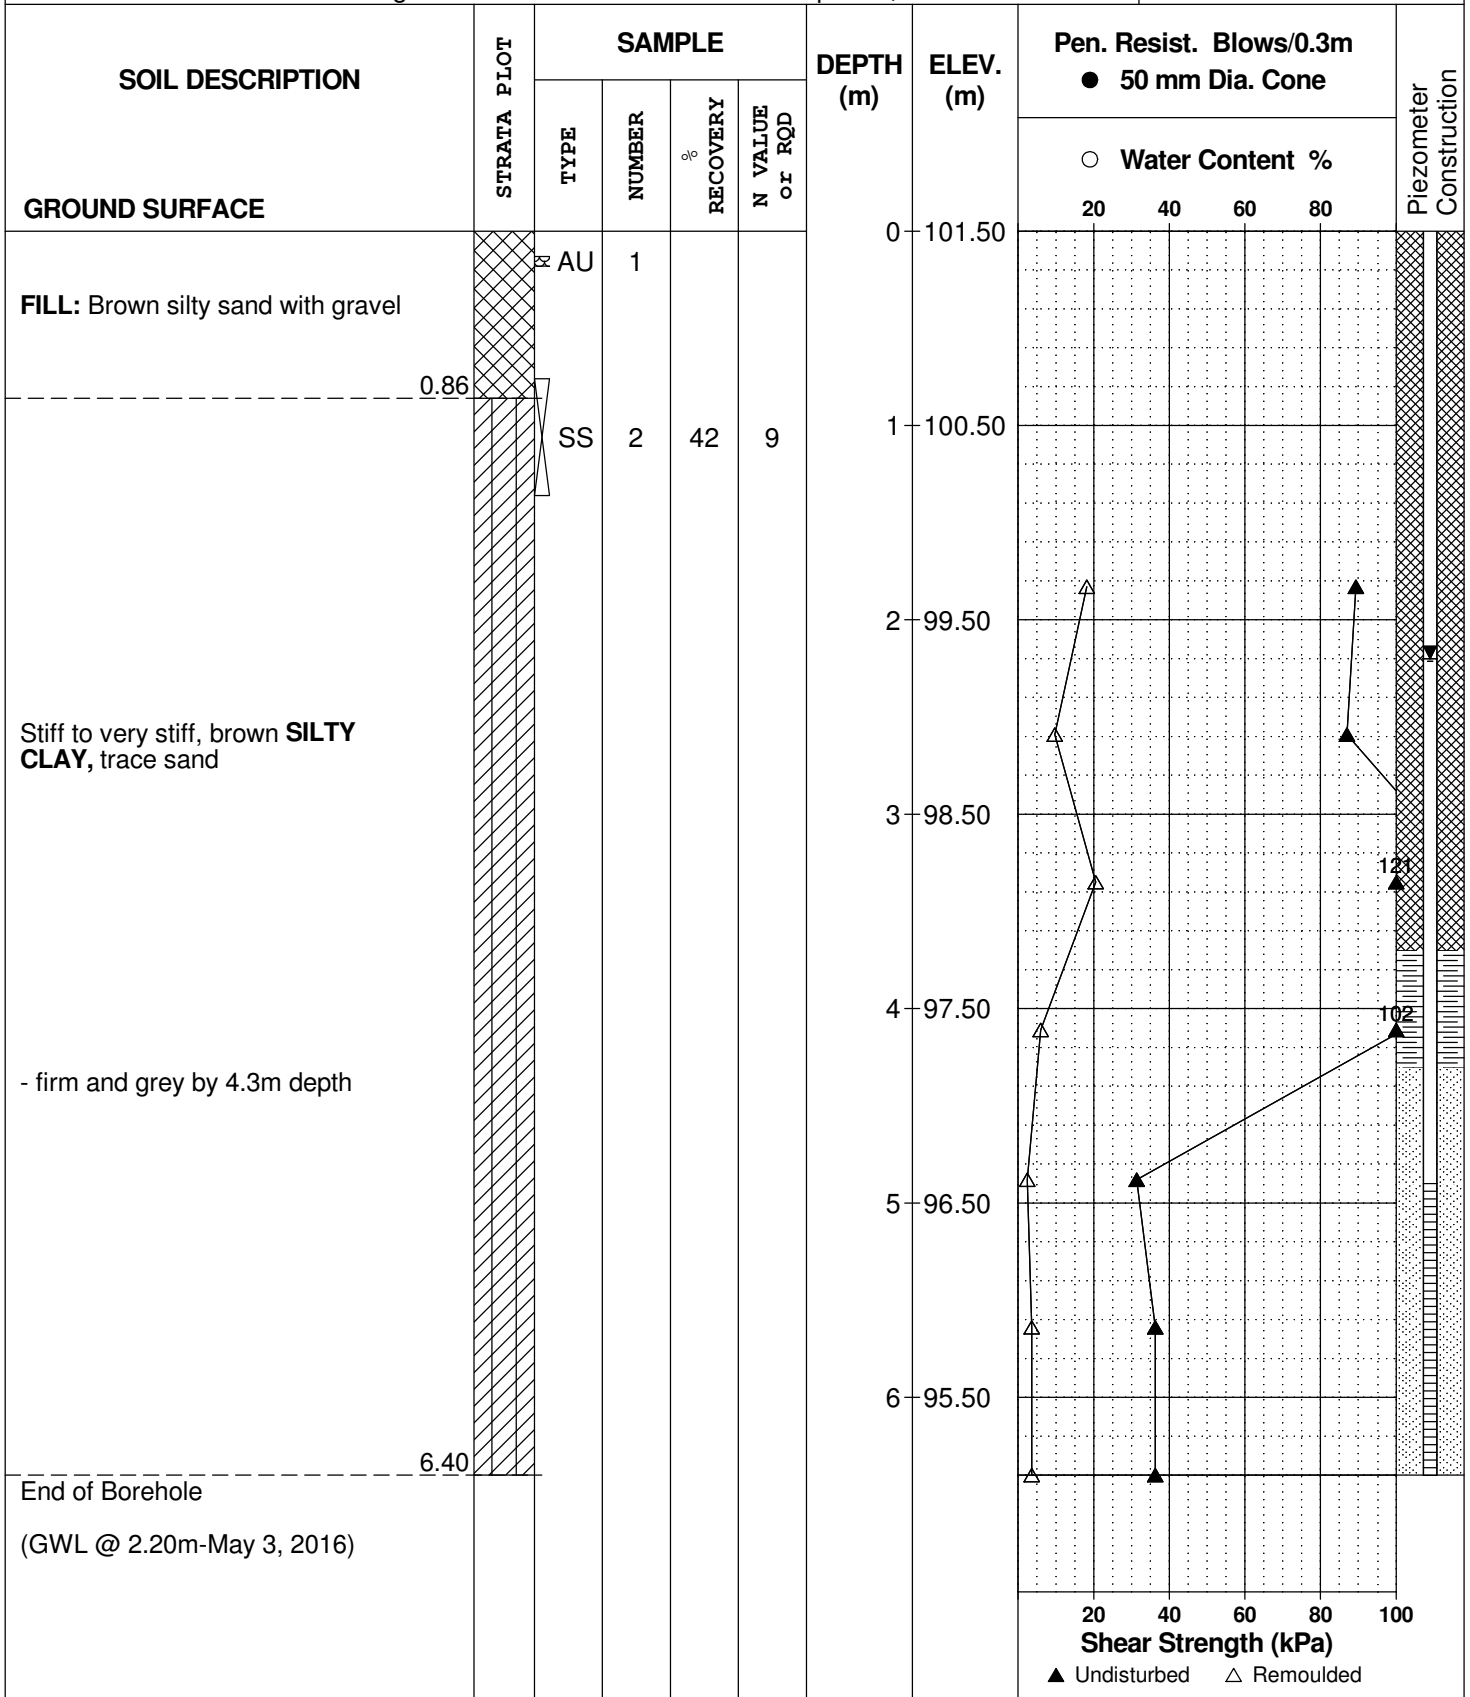

DATUM TBM - Top spindle of fire hydrant. Geodetic elevation = 102.38m.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH 6-16**

BORINGS BY CME 55 Power Auger

DATE April 26, 2016

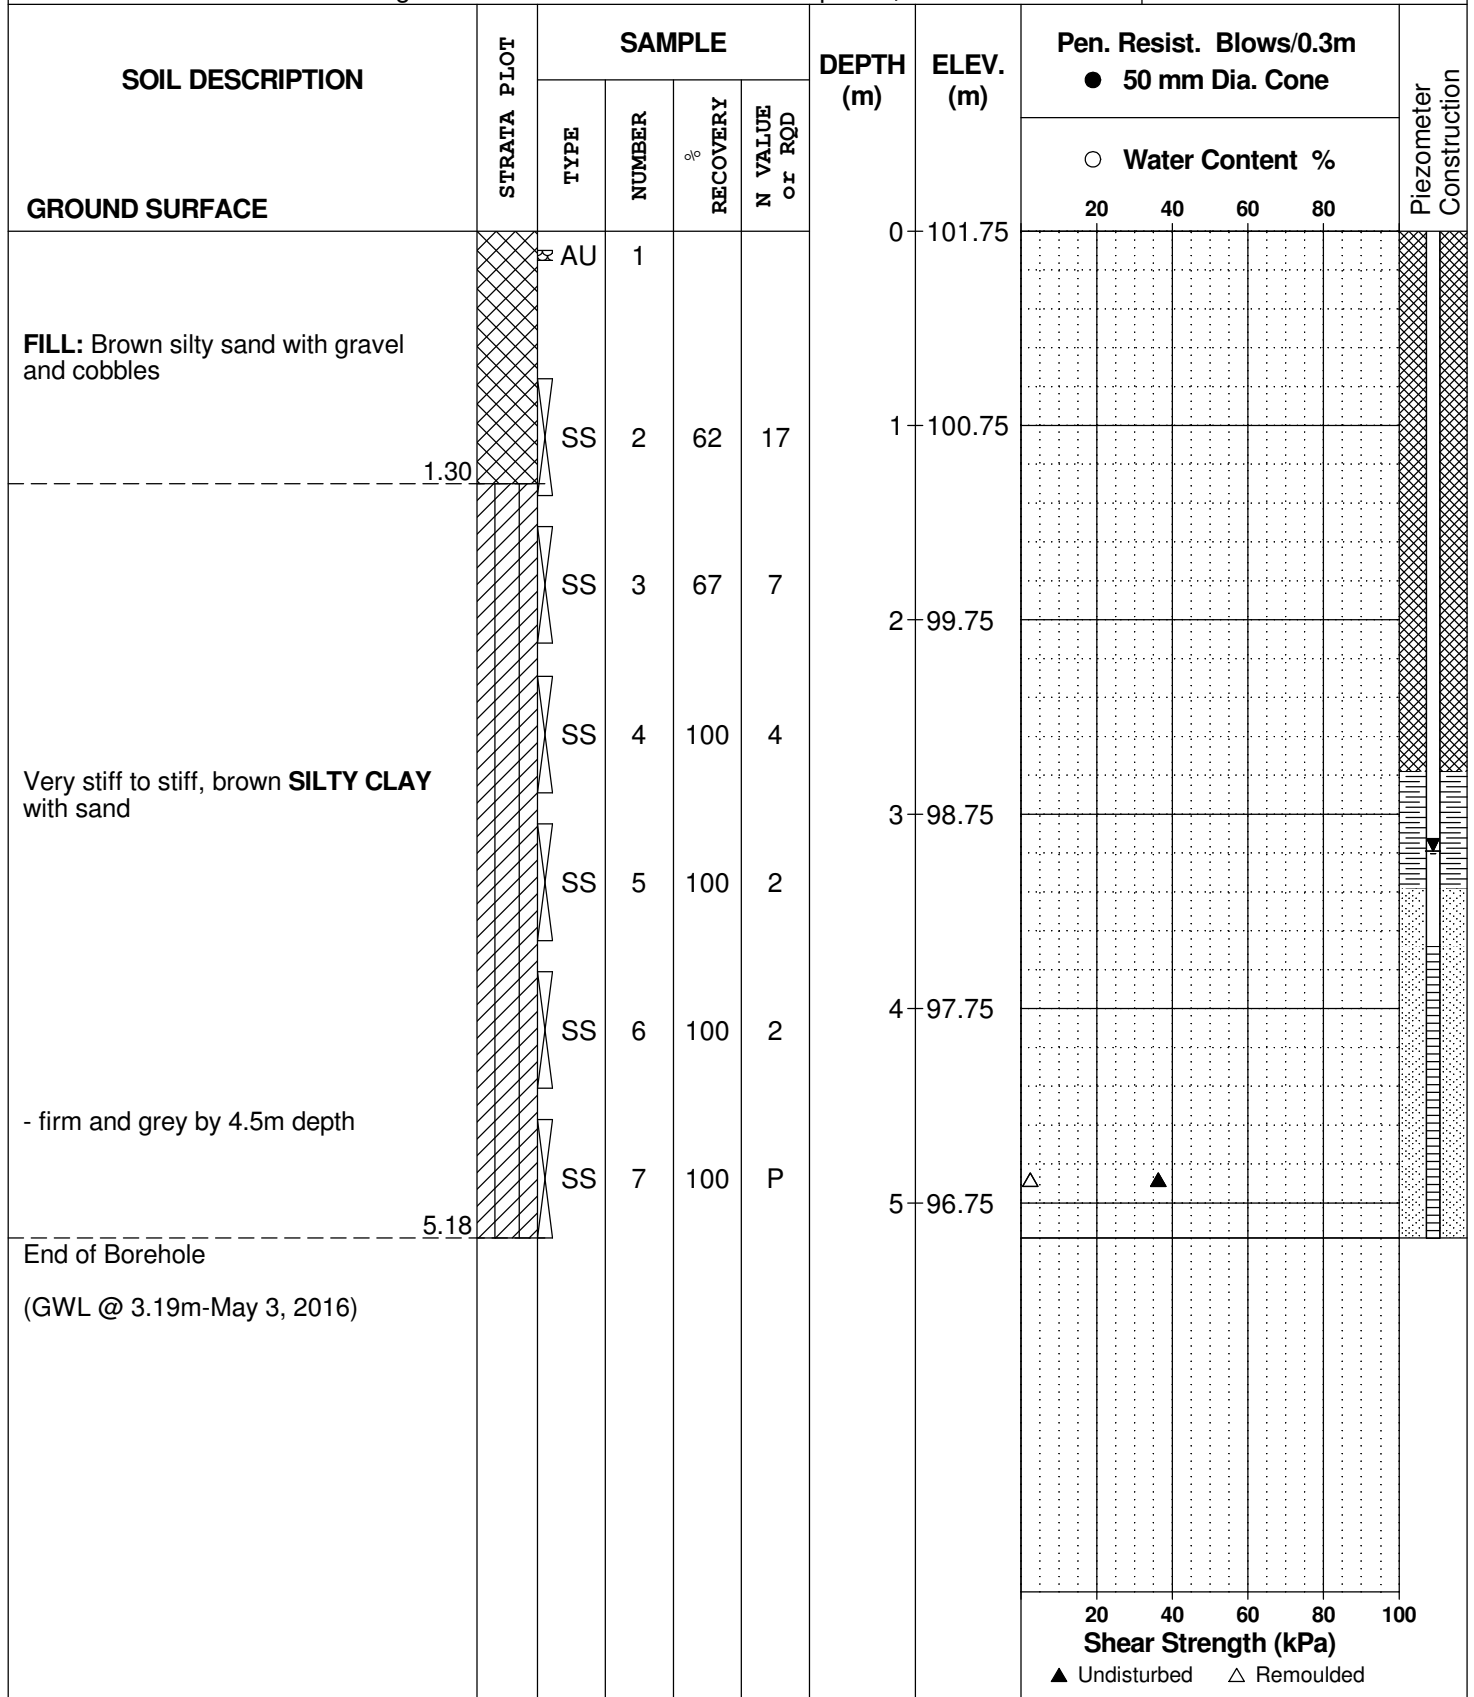

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH 1**

BORINGS BY CME 55 Power Auger

DATE 13 July 2009

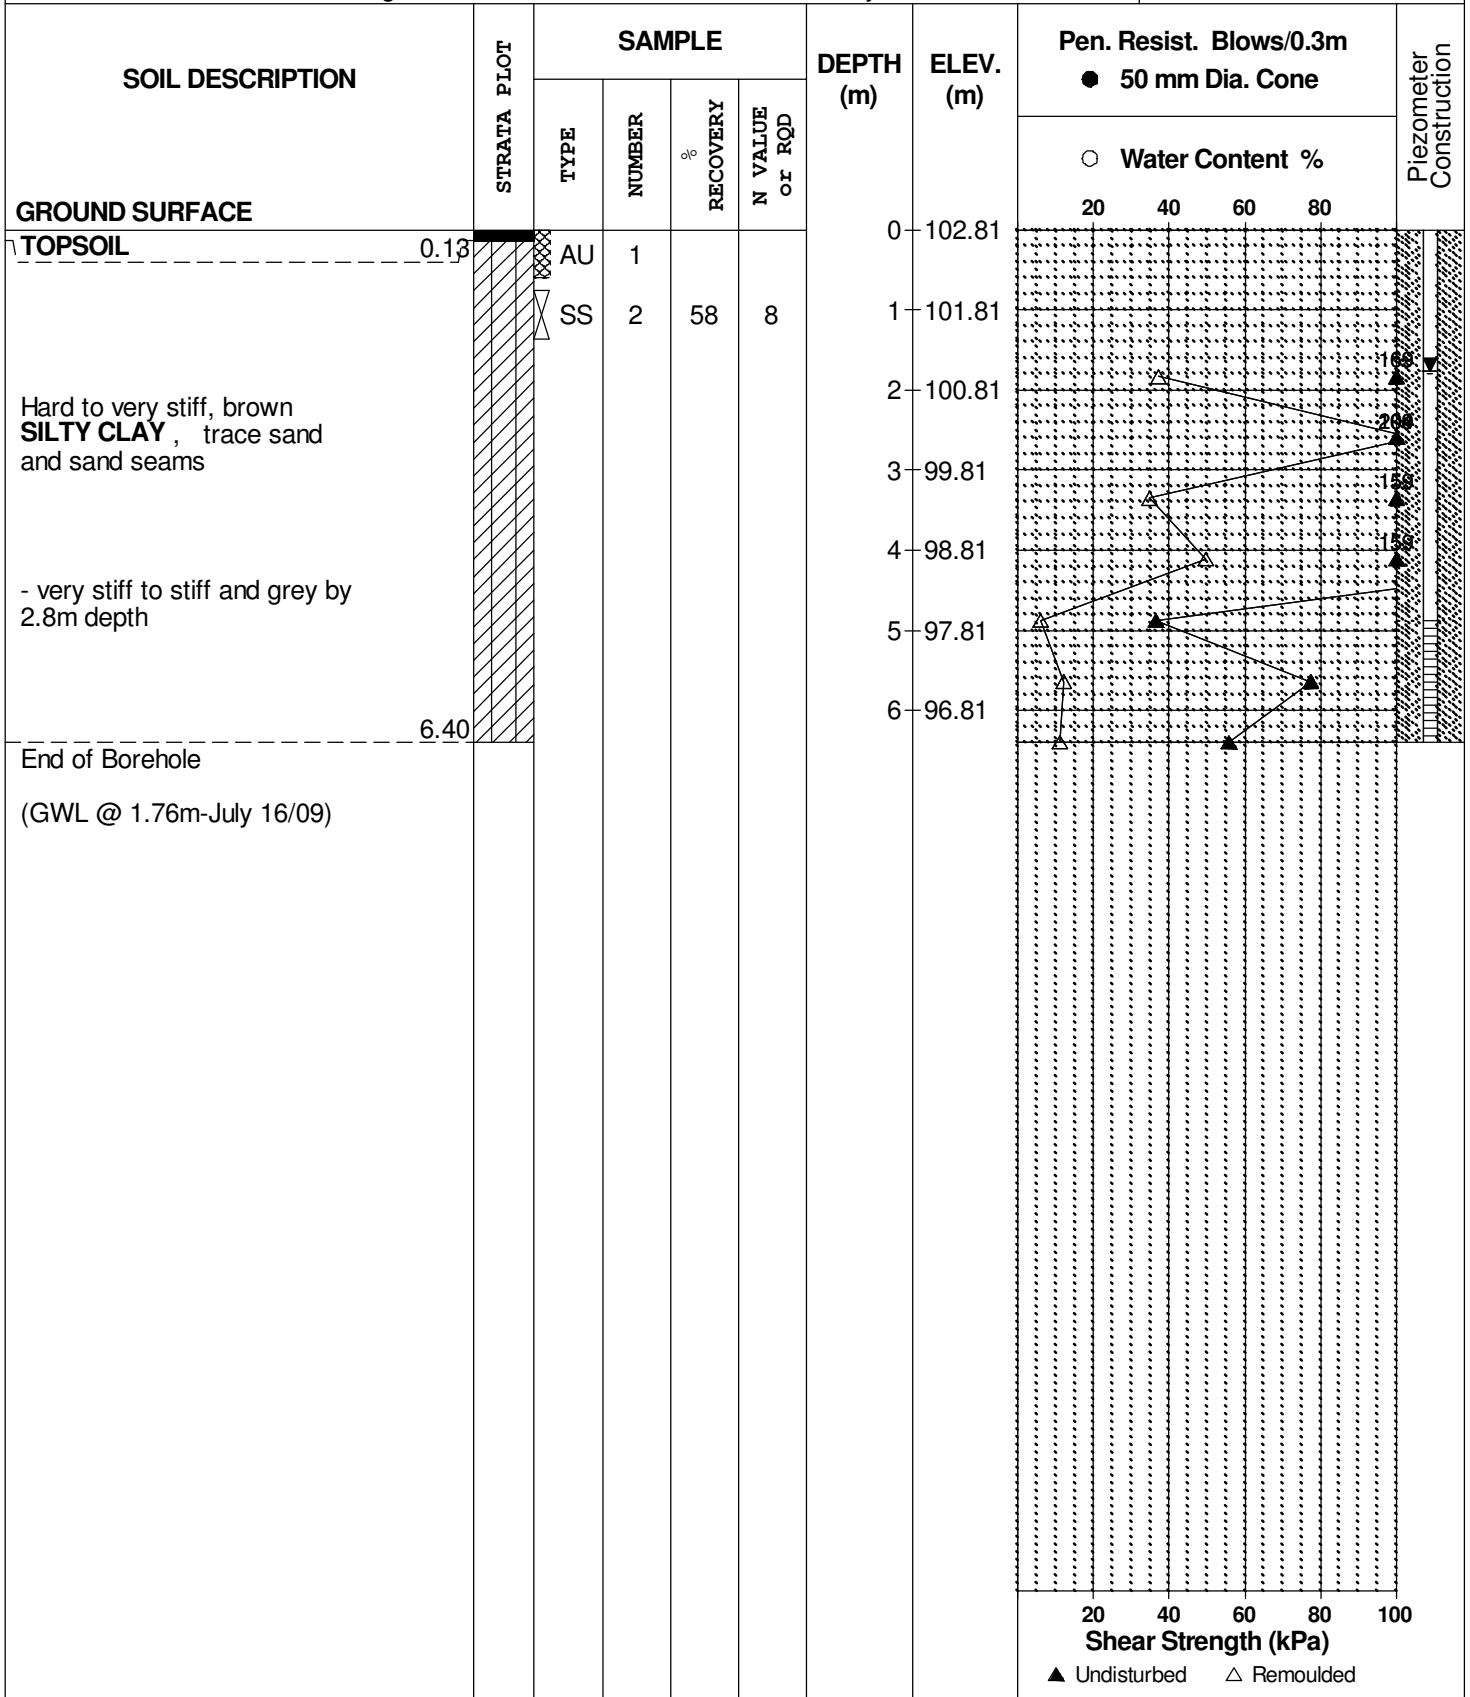

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH 2**

BORINGS BY CME 55 Power Auger

DATE 13 July 2009

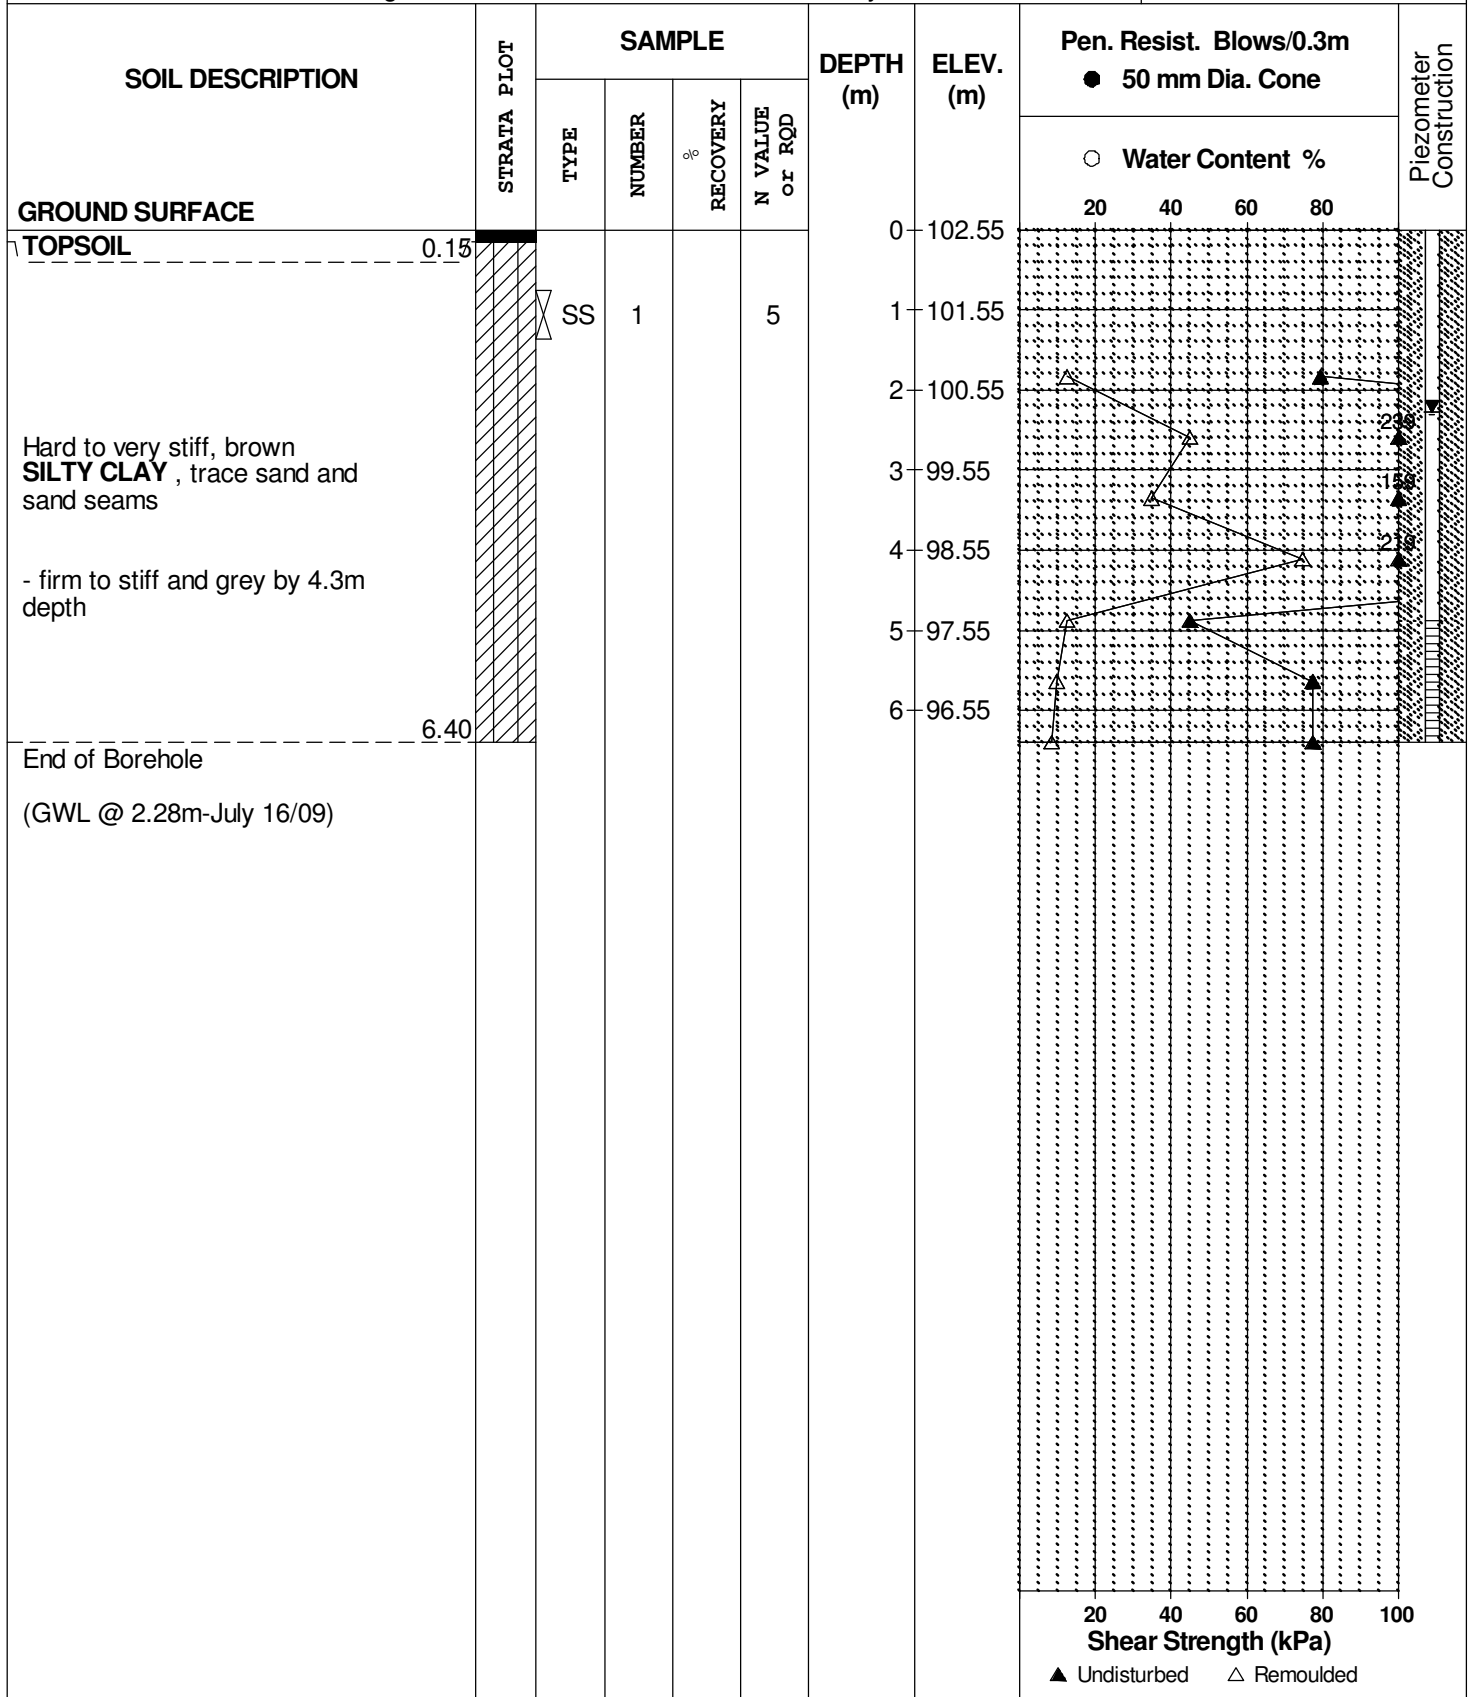

SOIL PROFILE AND TEST DATA

Geotechnical Investigation
Proposed Commercial Development-Hazeldean Road
Ottawa, Ontario

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH 3**

BORINGS BY CME 55 Power Auger

DATE 13 July 2009

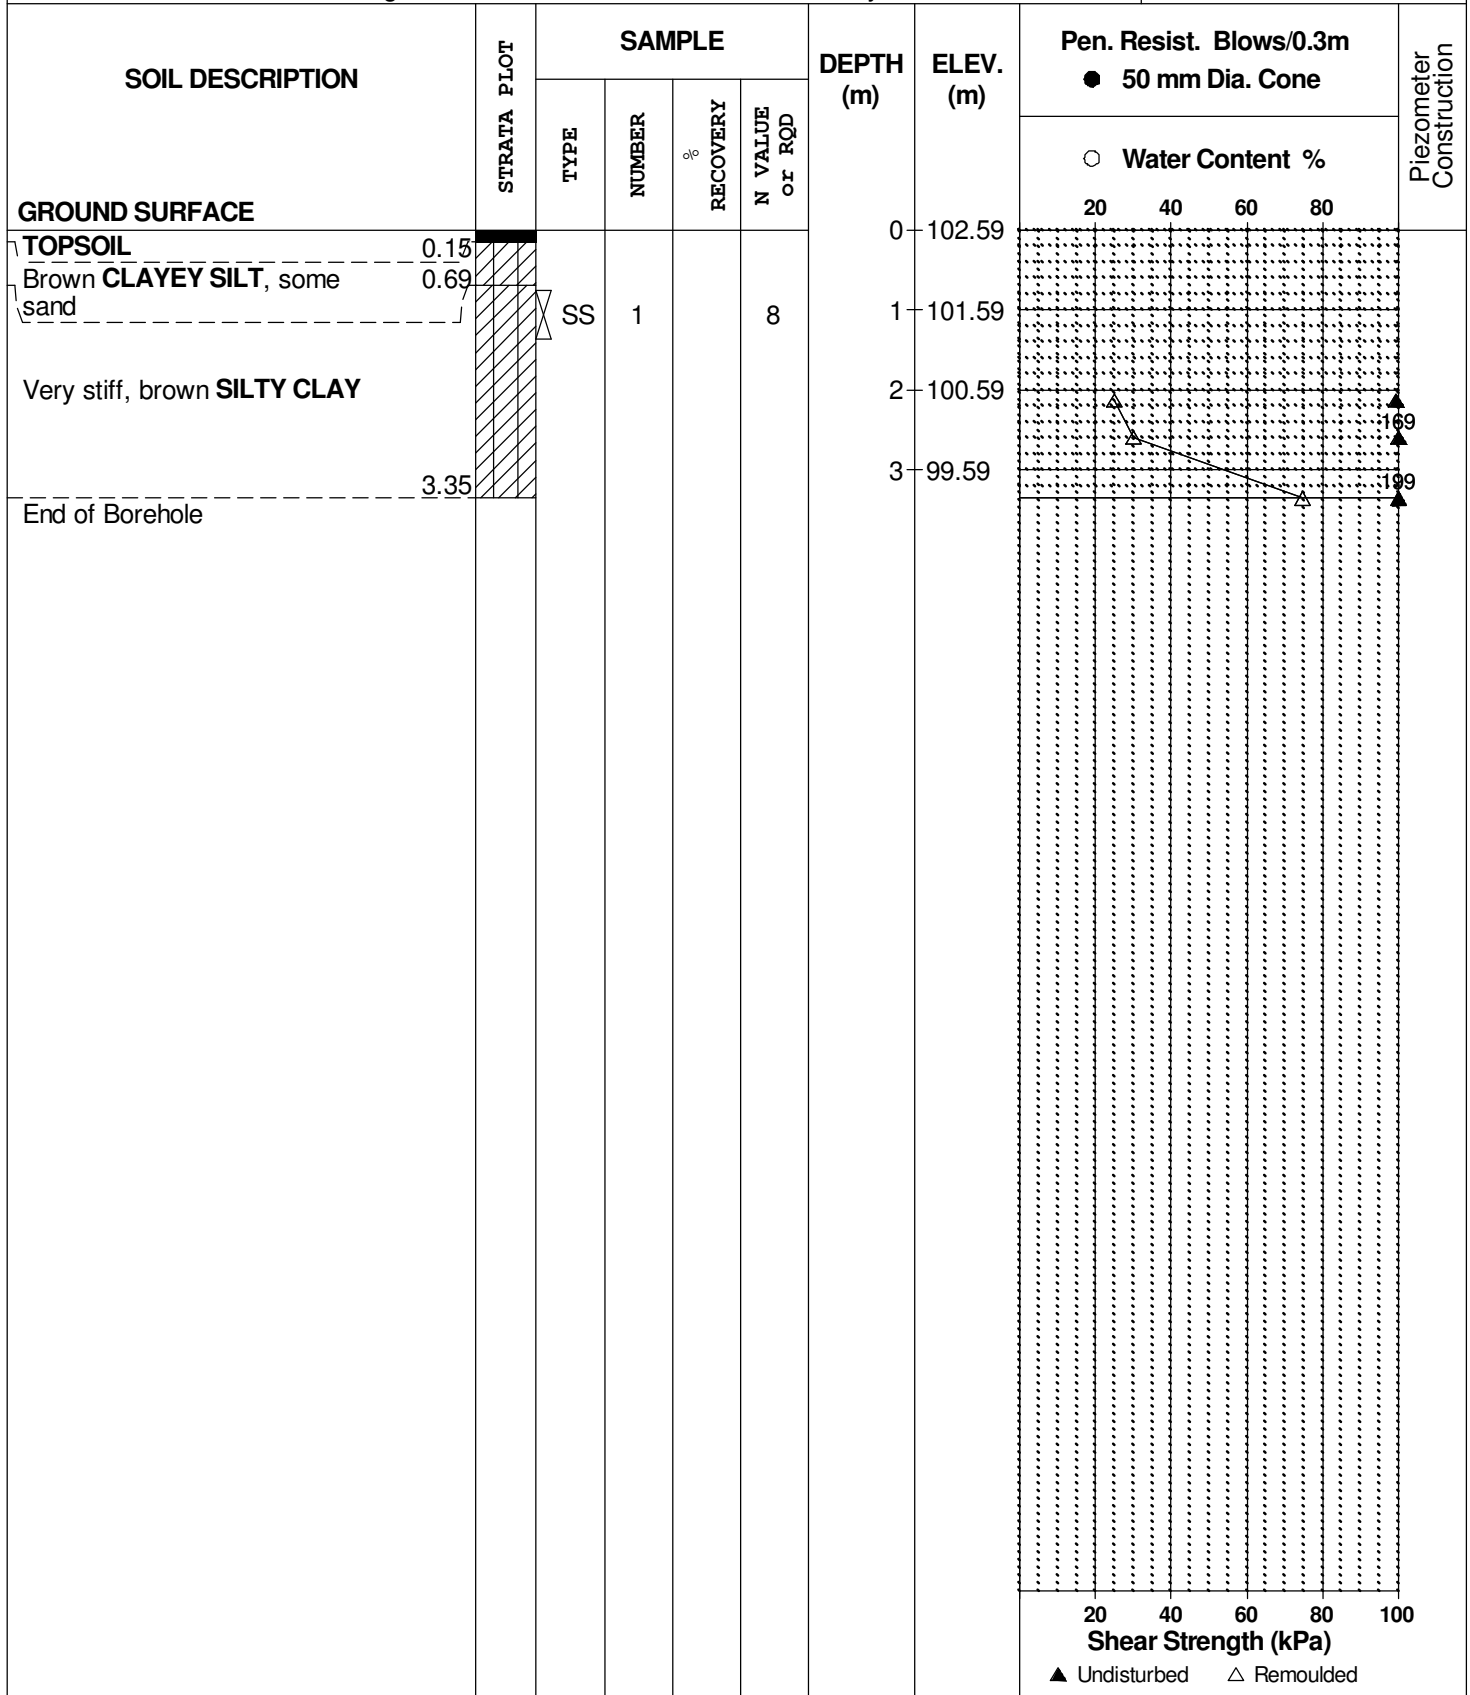

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH 4**

BORINGS BY CME 55 Power Auger

DATE 8 July 2009

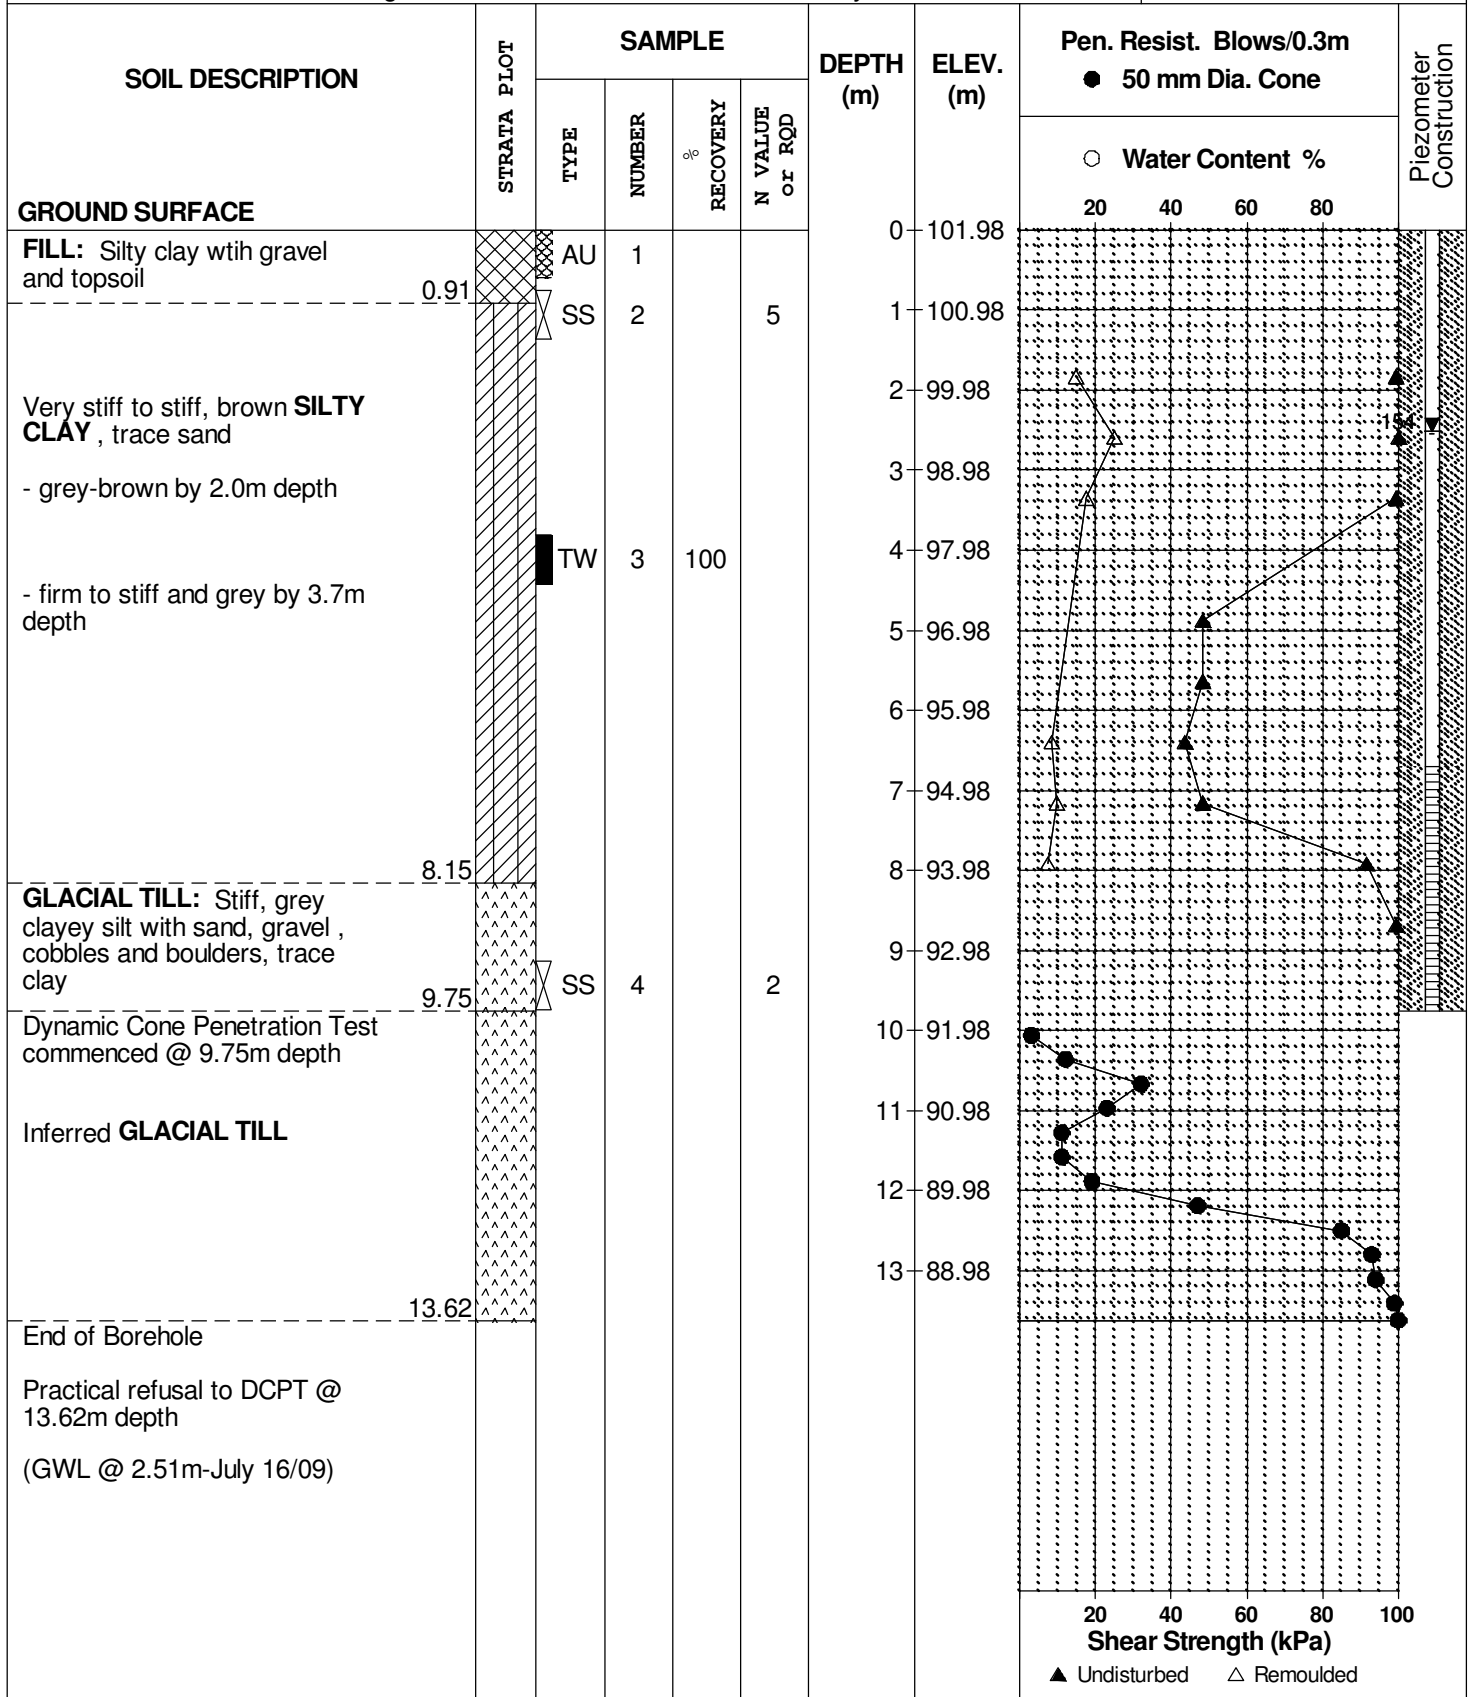

SOIL PROFILE AND TEST DATA

Geotechnical Investigation
Proposed Commercial Development-Hazeldean Road
Ottawa, Ontario

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH 5**

BORINGS BY CME 55 Power Auger

DATE 7 July 2009

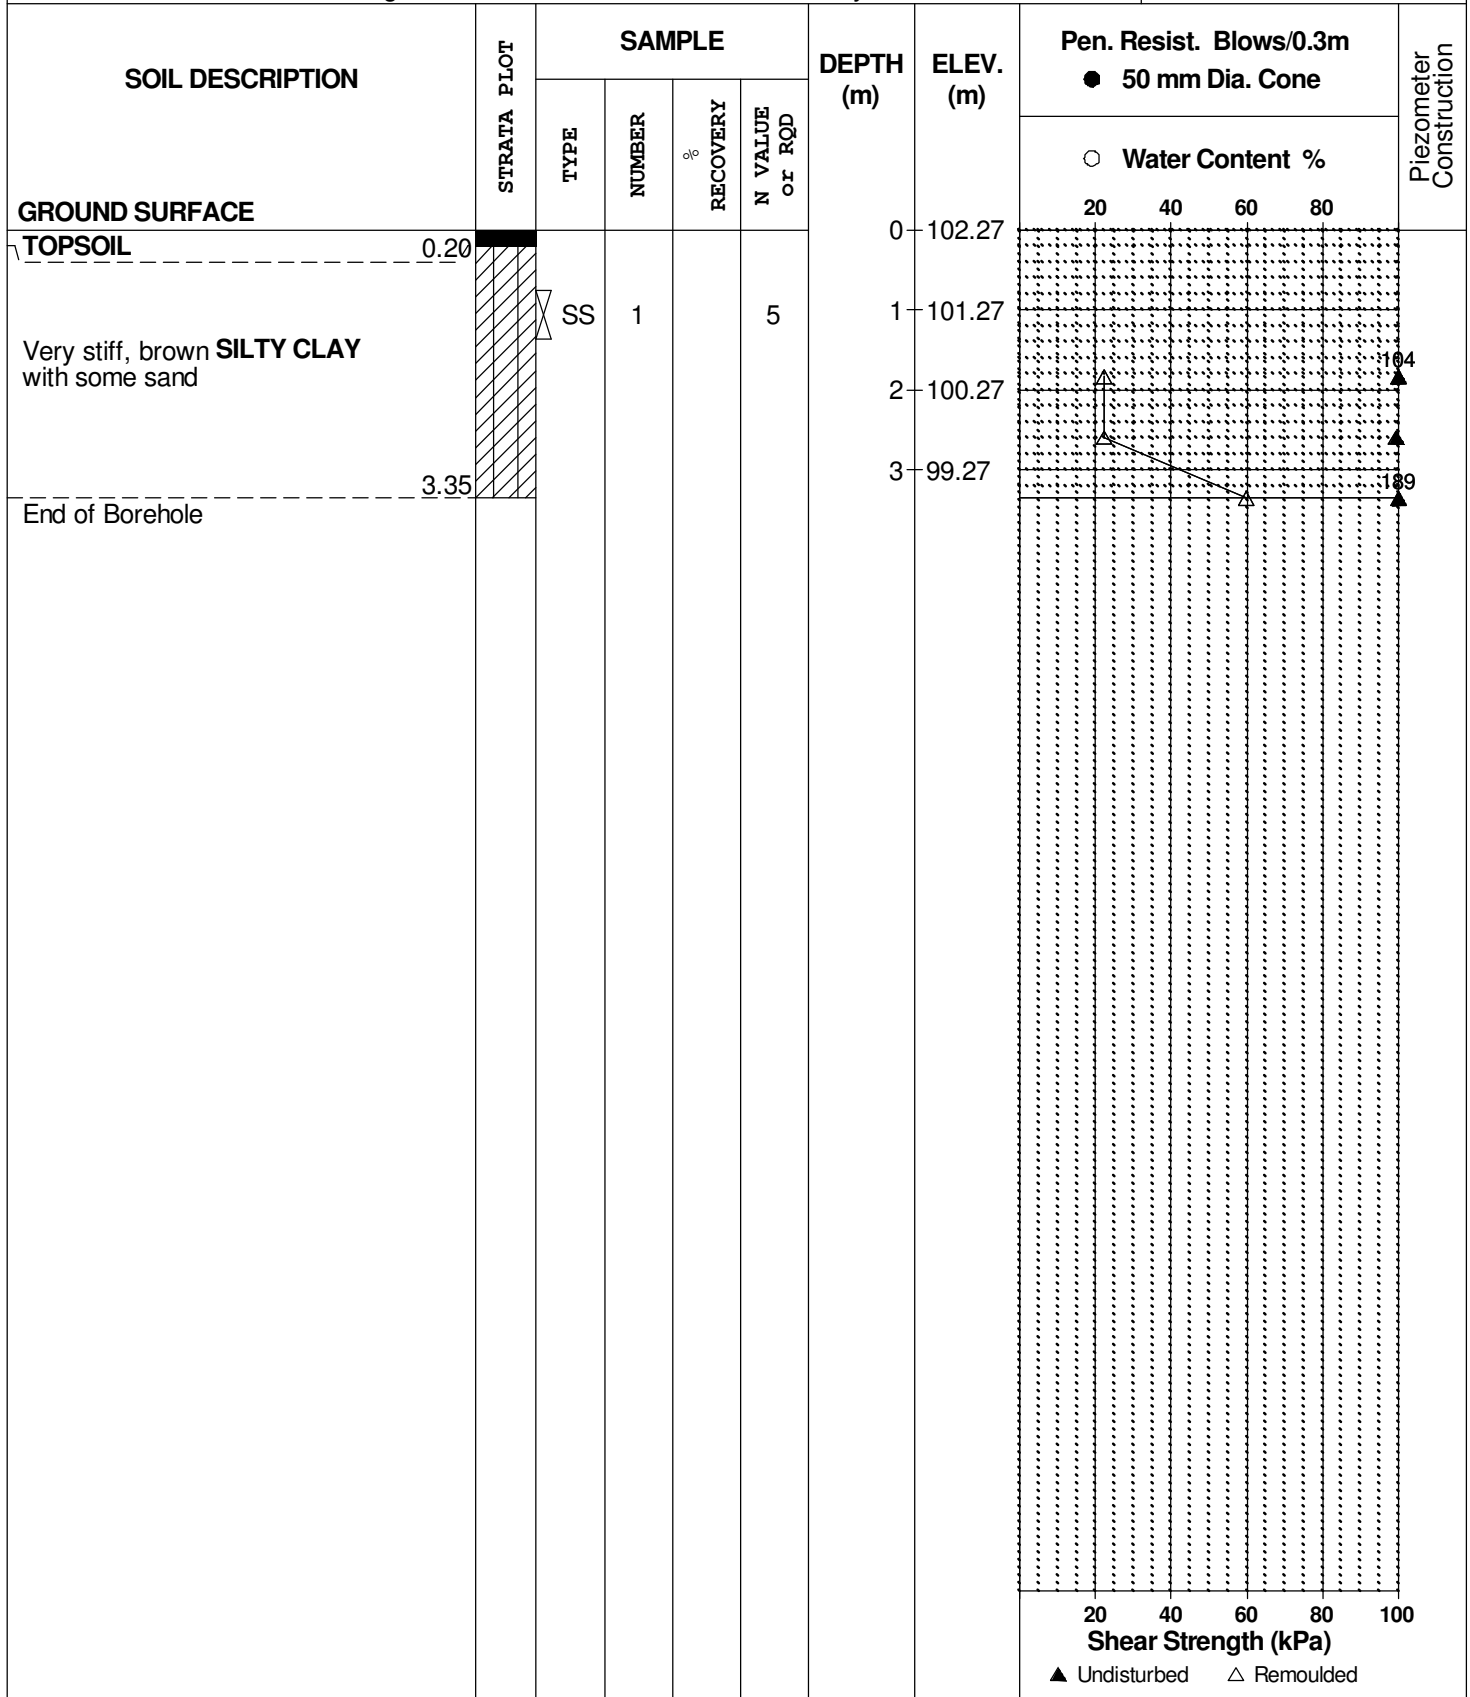

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH 6**

BORINGS BY CME 55 Power Auger

DATE 7 July 2009

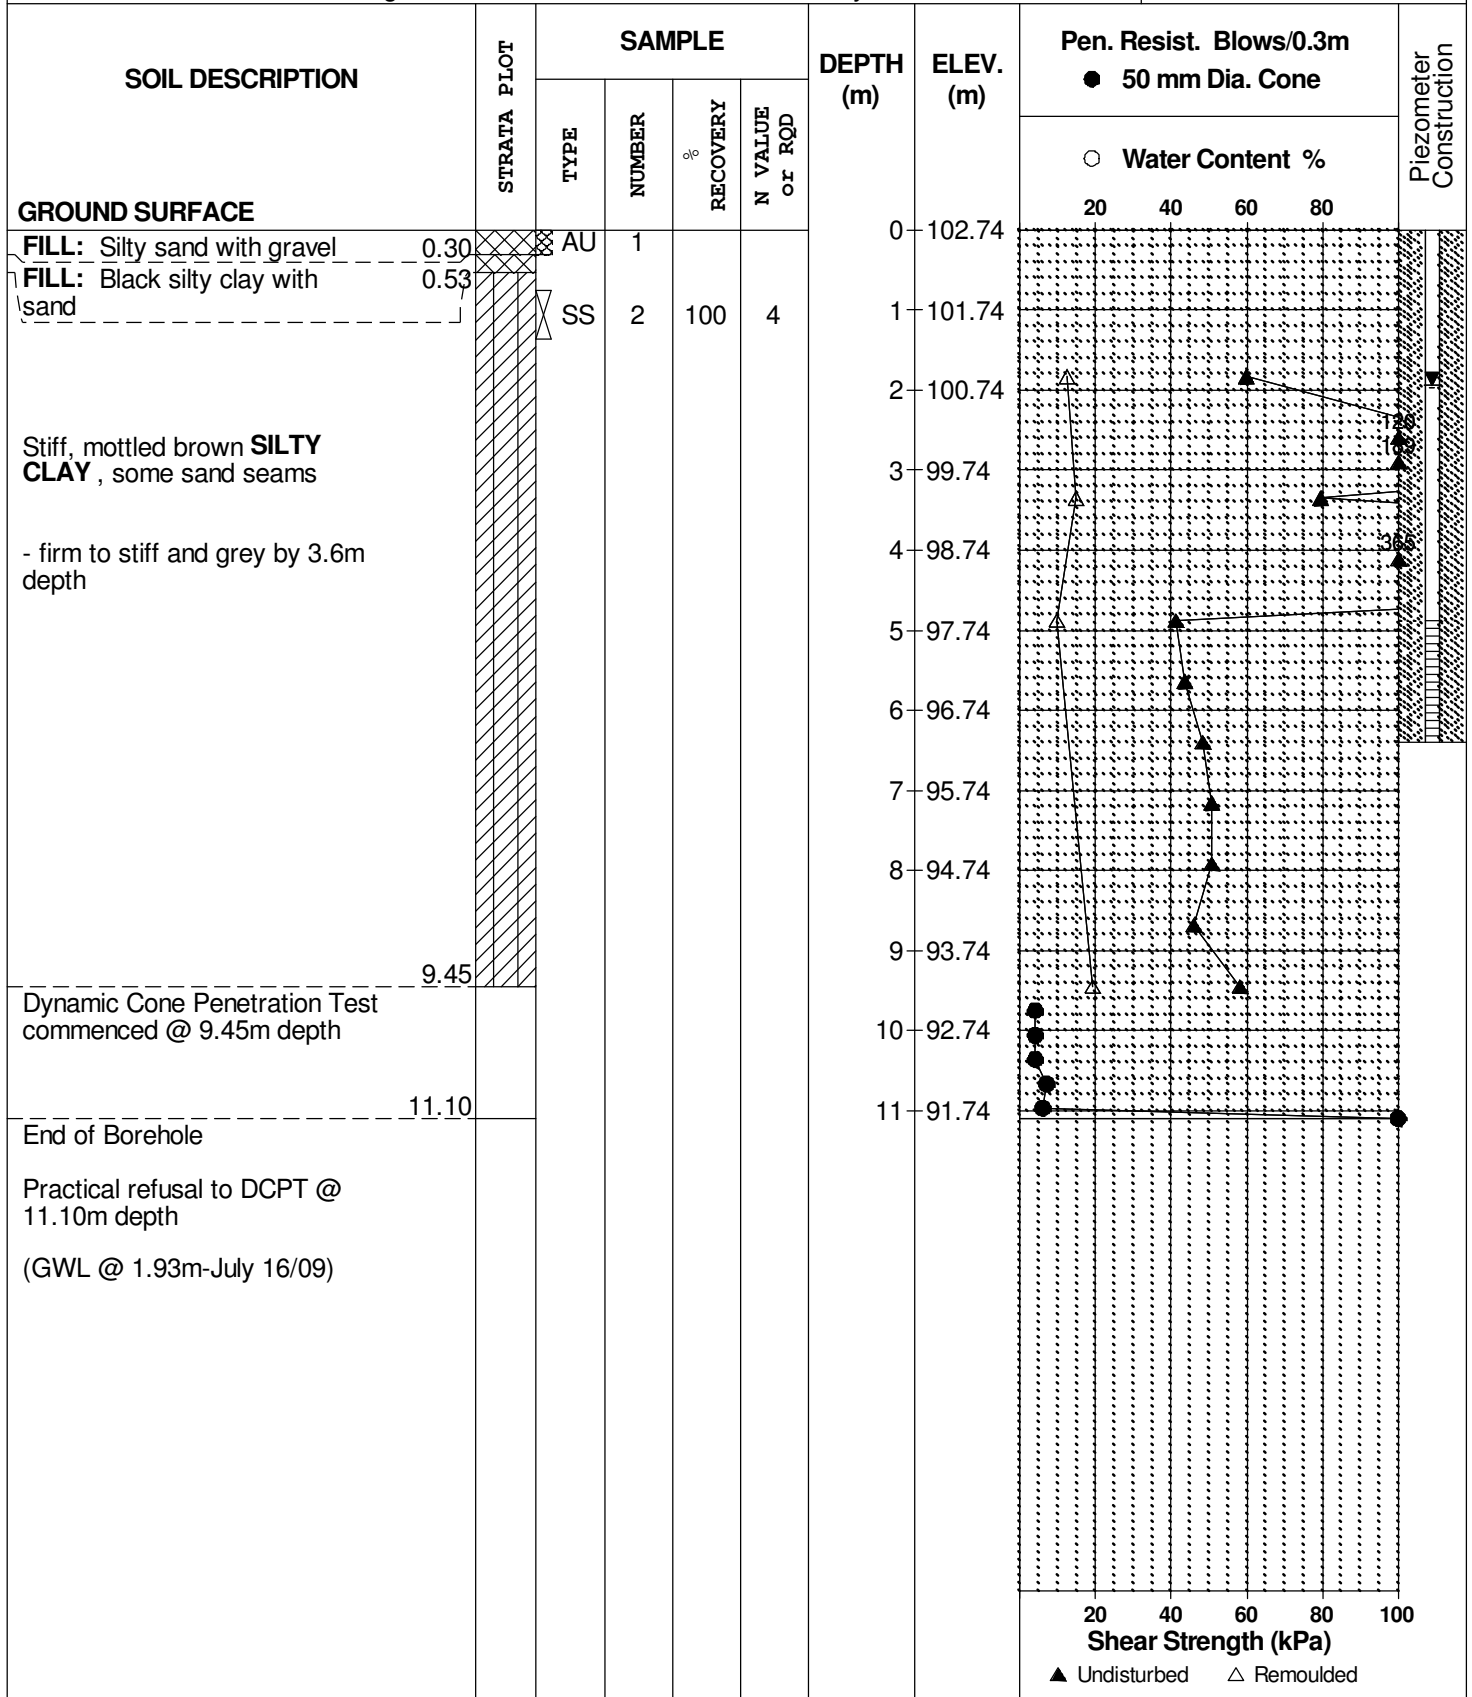

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH 7**

BORINGS BY CME 55 Power Auger

DATE 7 July 2009

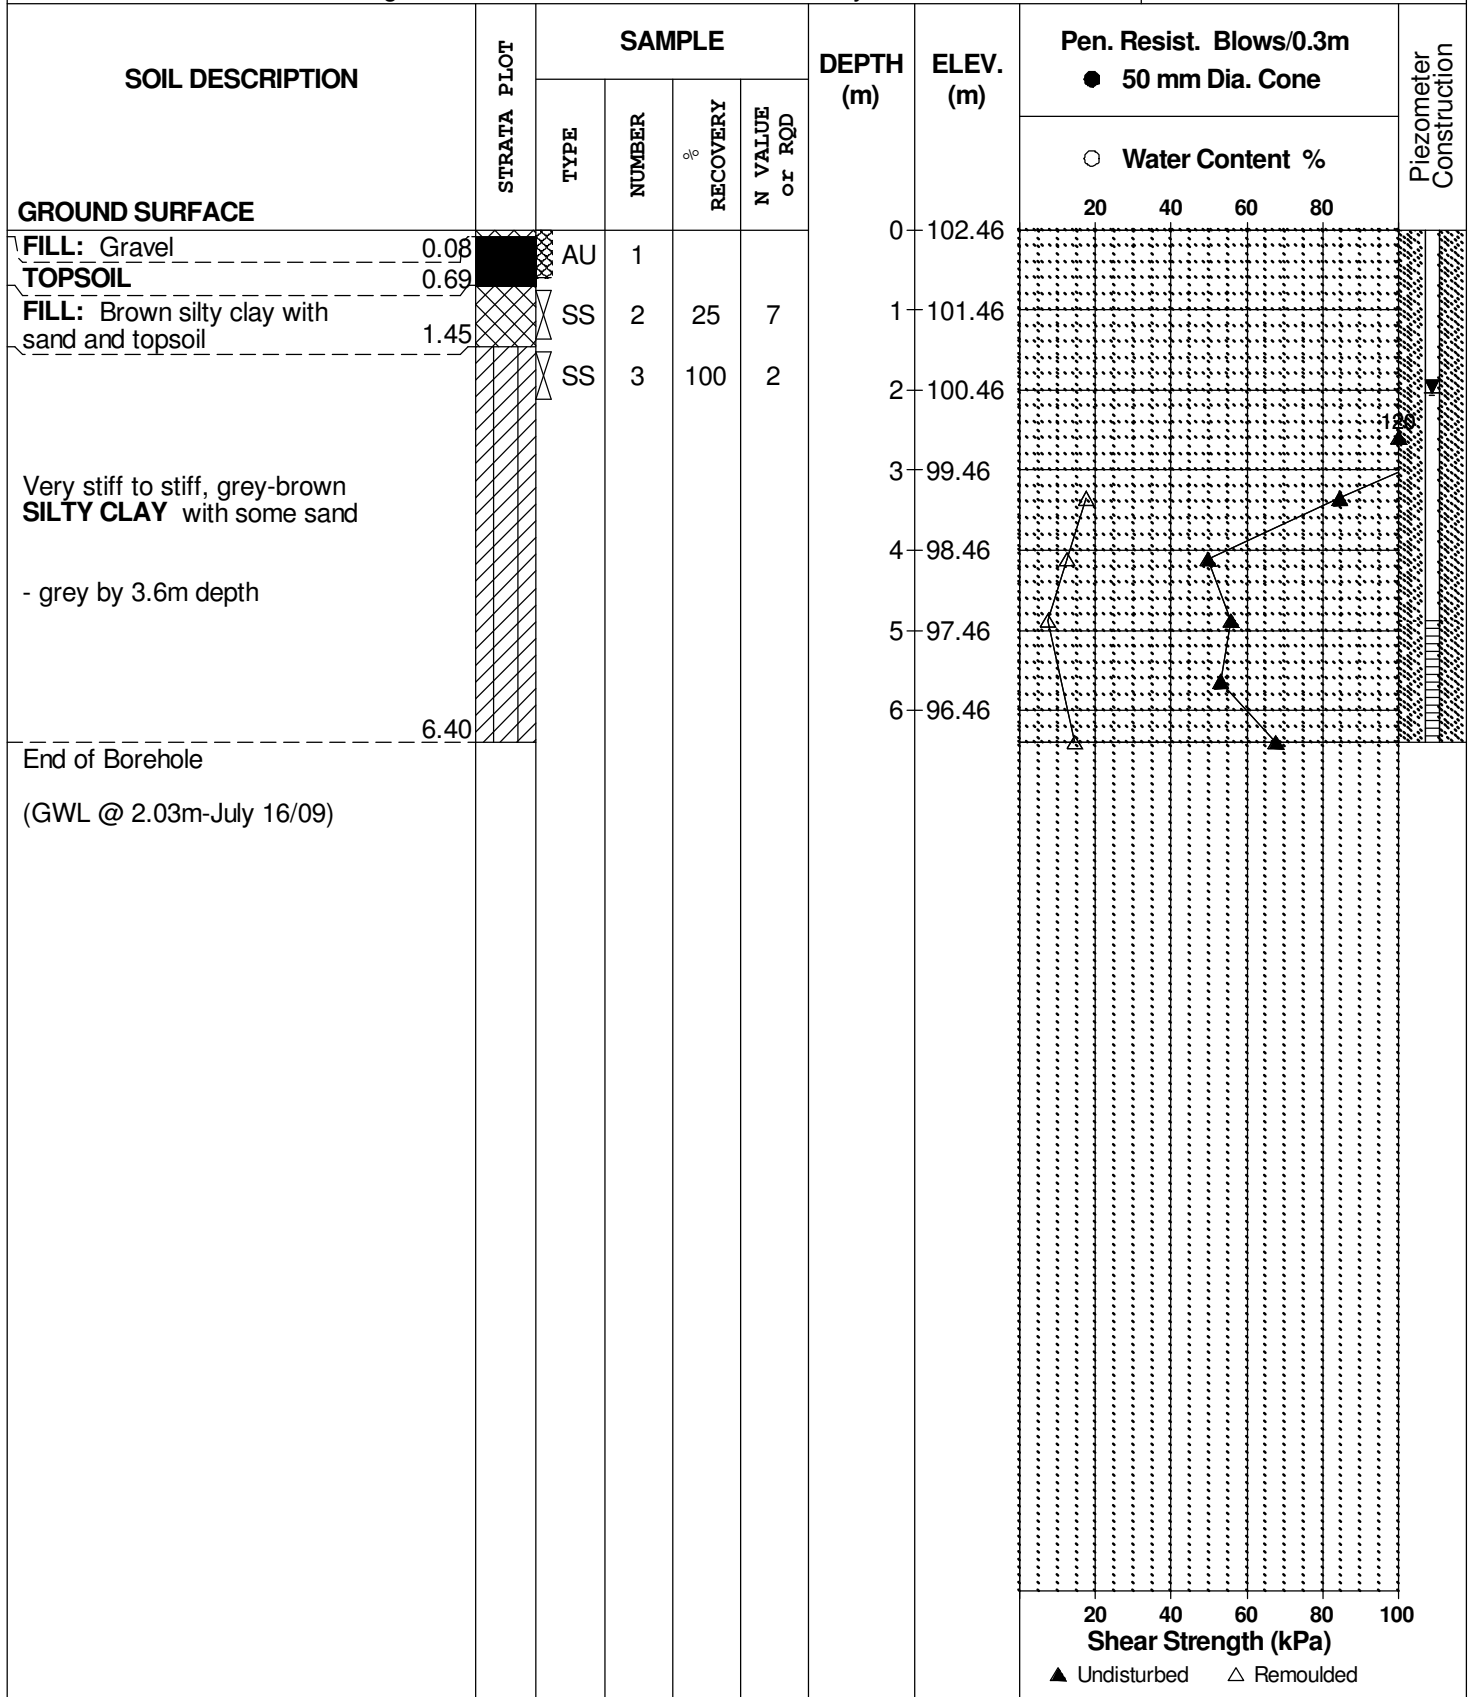

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH 8**

BORINGS BY CME 55 Power Auger

DATE 9 July 2009

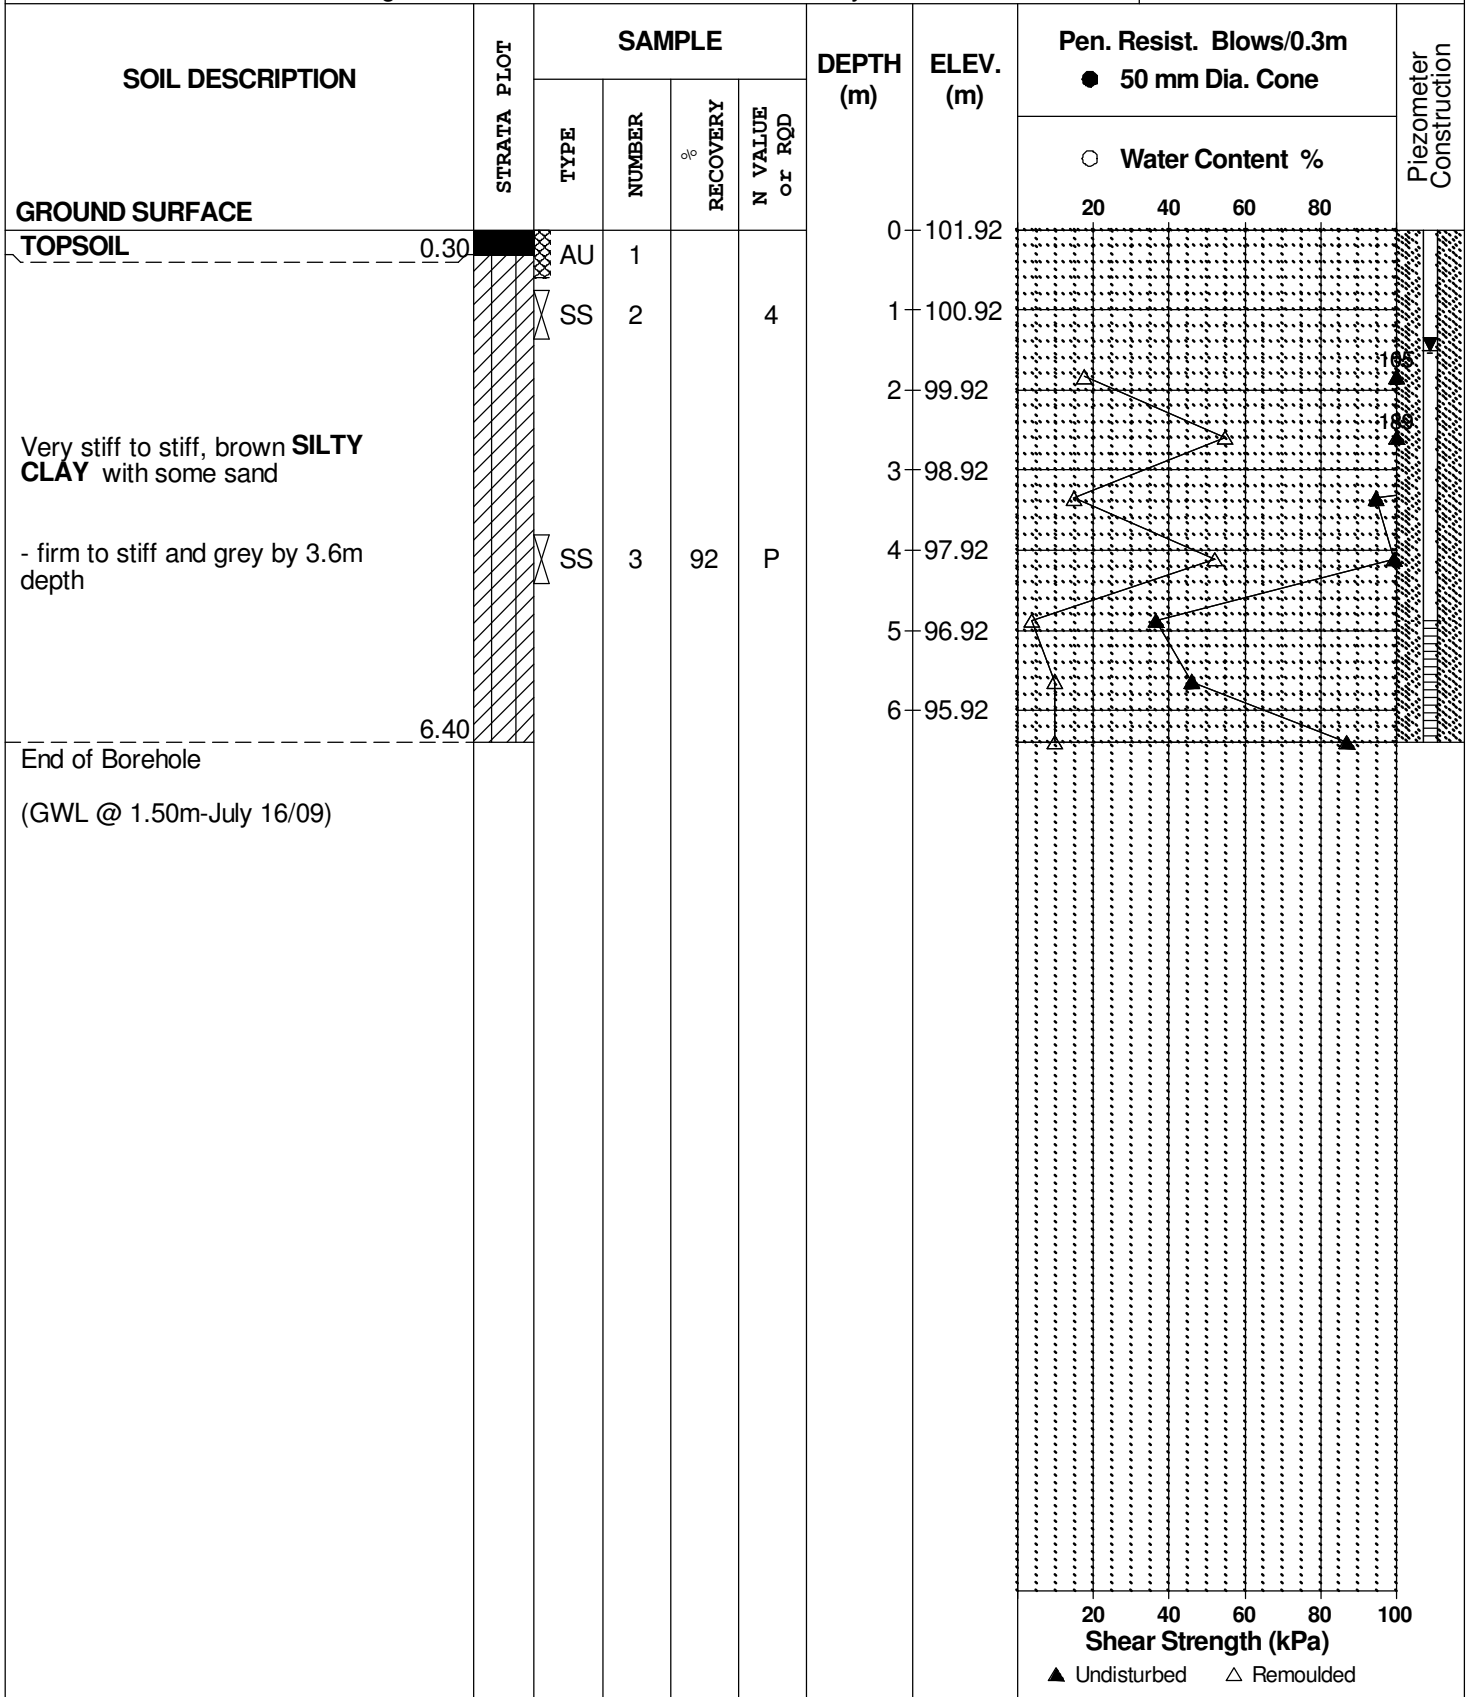

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH 9**

BORINGS BY CME 55 Power Auger

DATE 9 July 2009

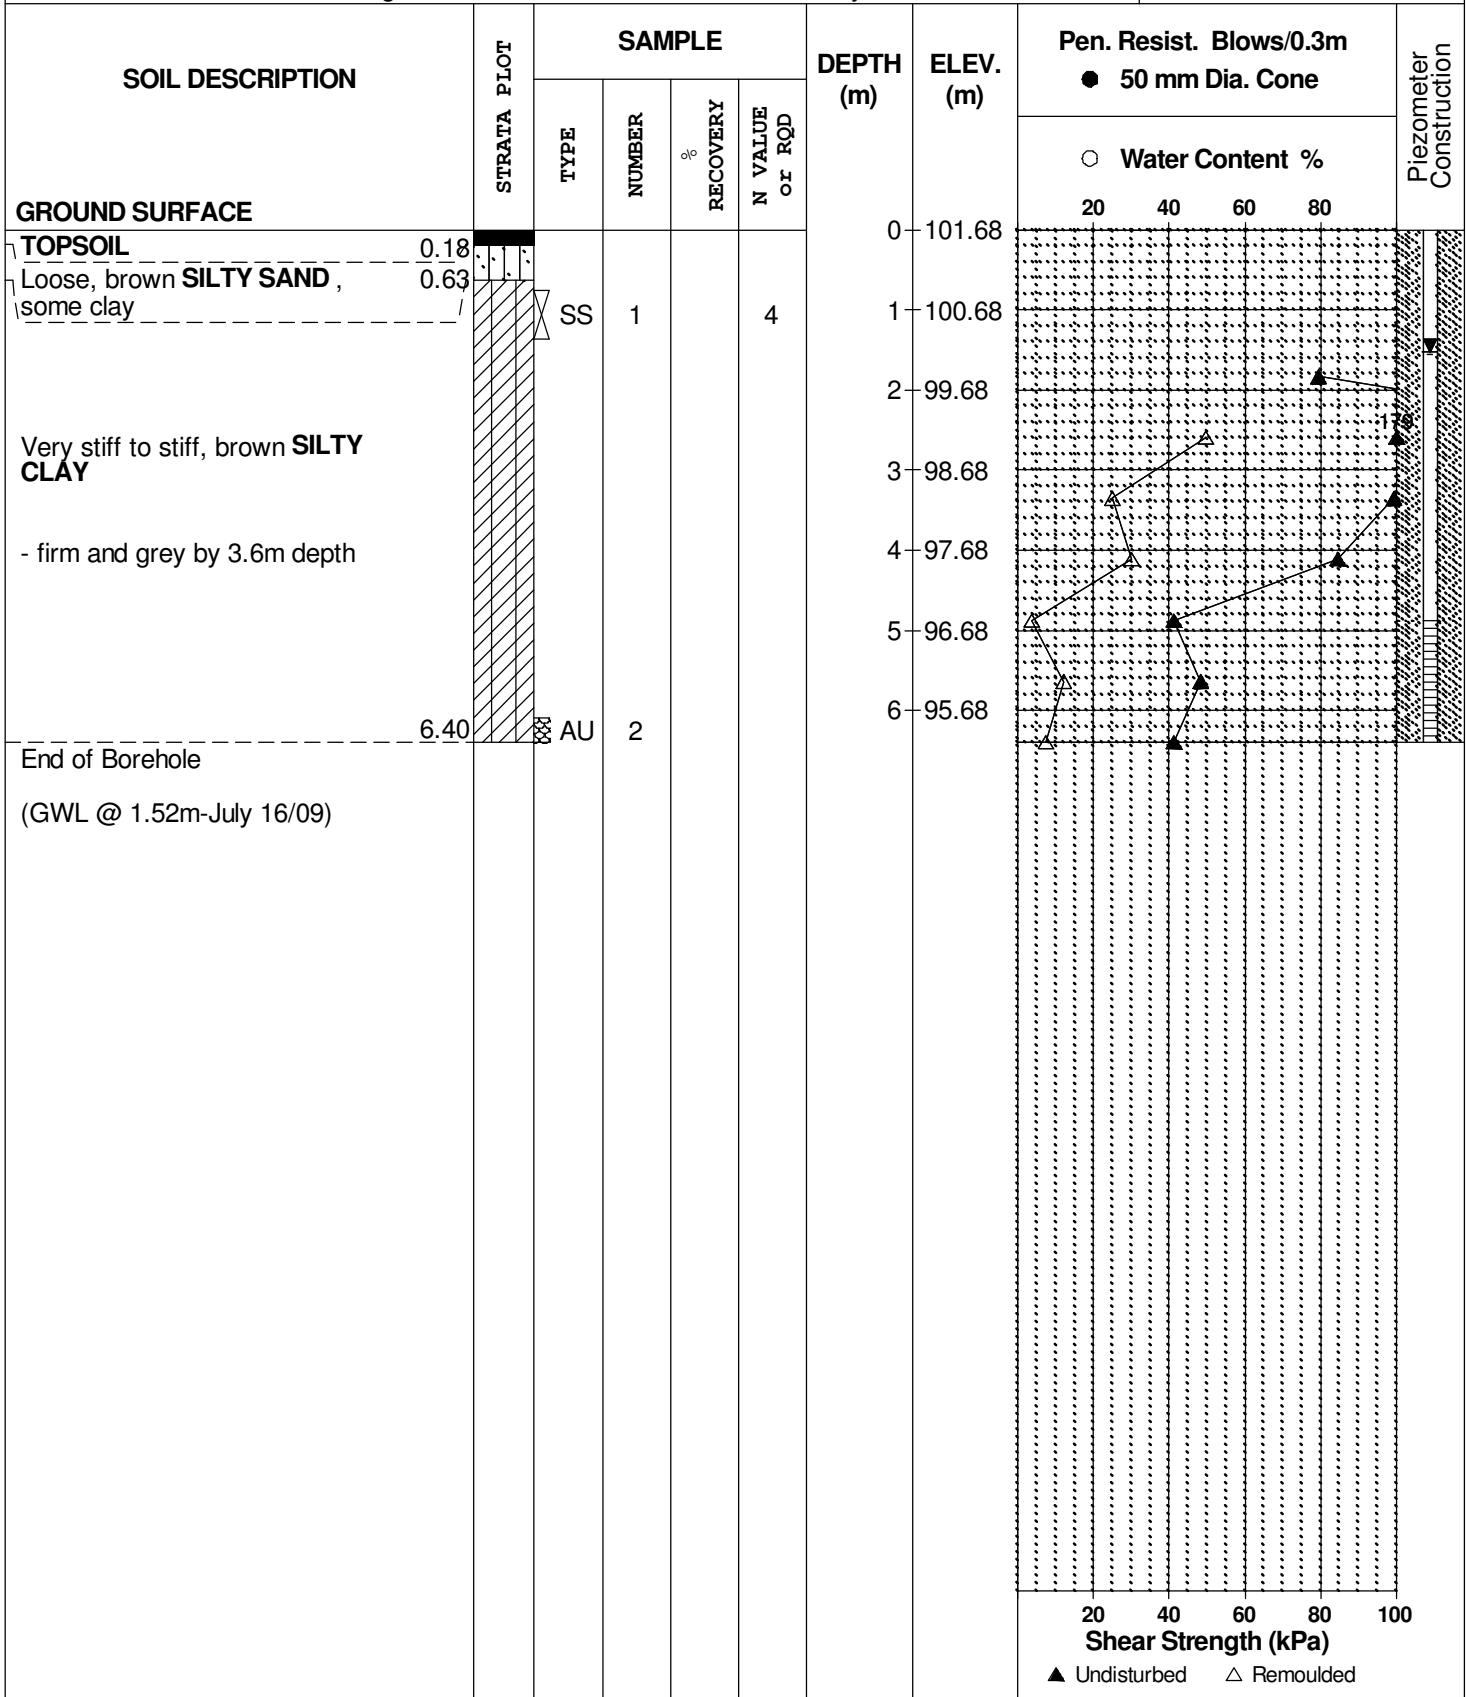

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH10**

BORINGS BY CME 55 Power Auger

DATE 8 July 2009

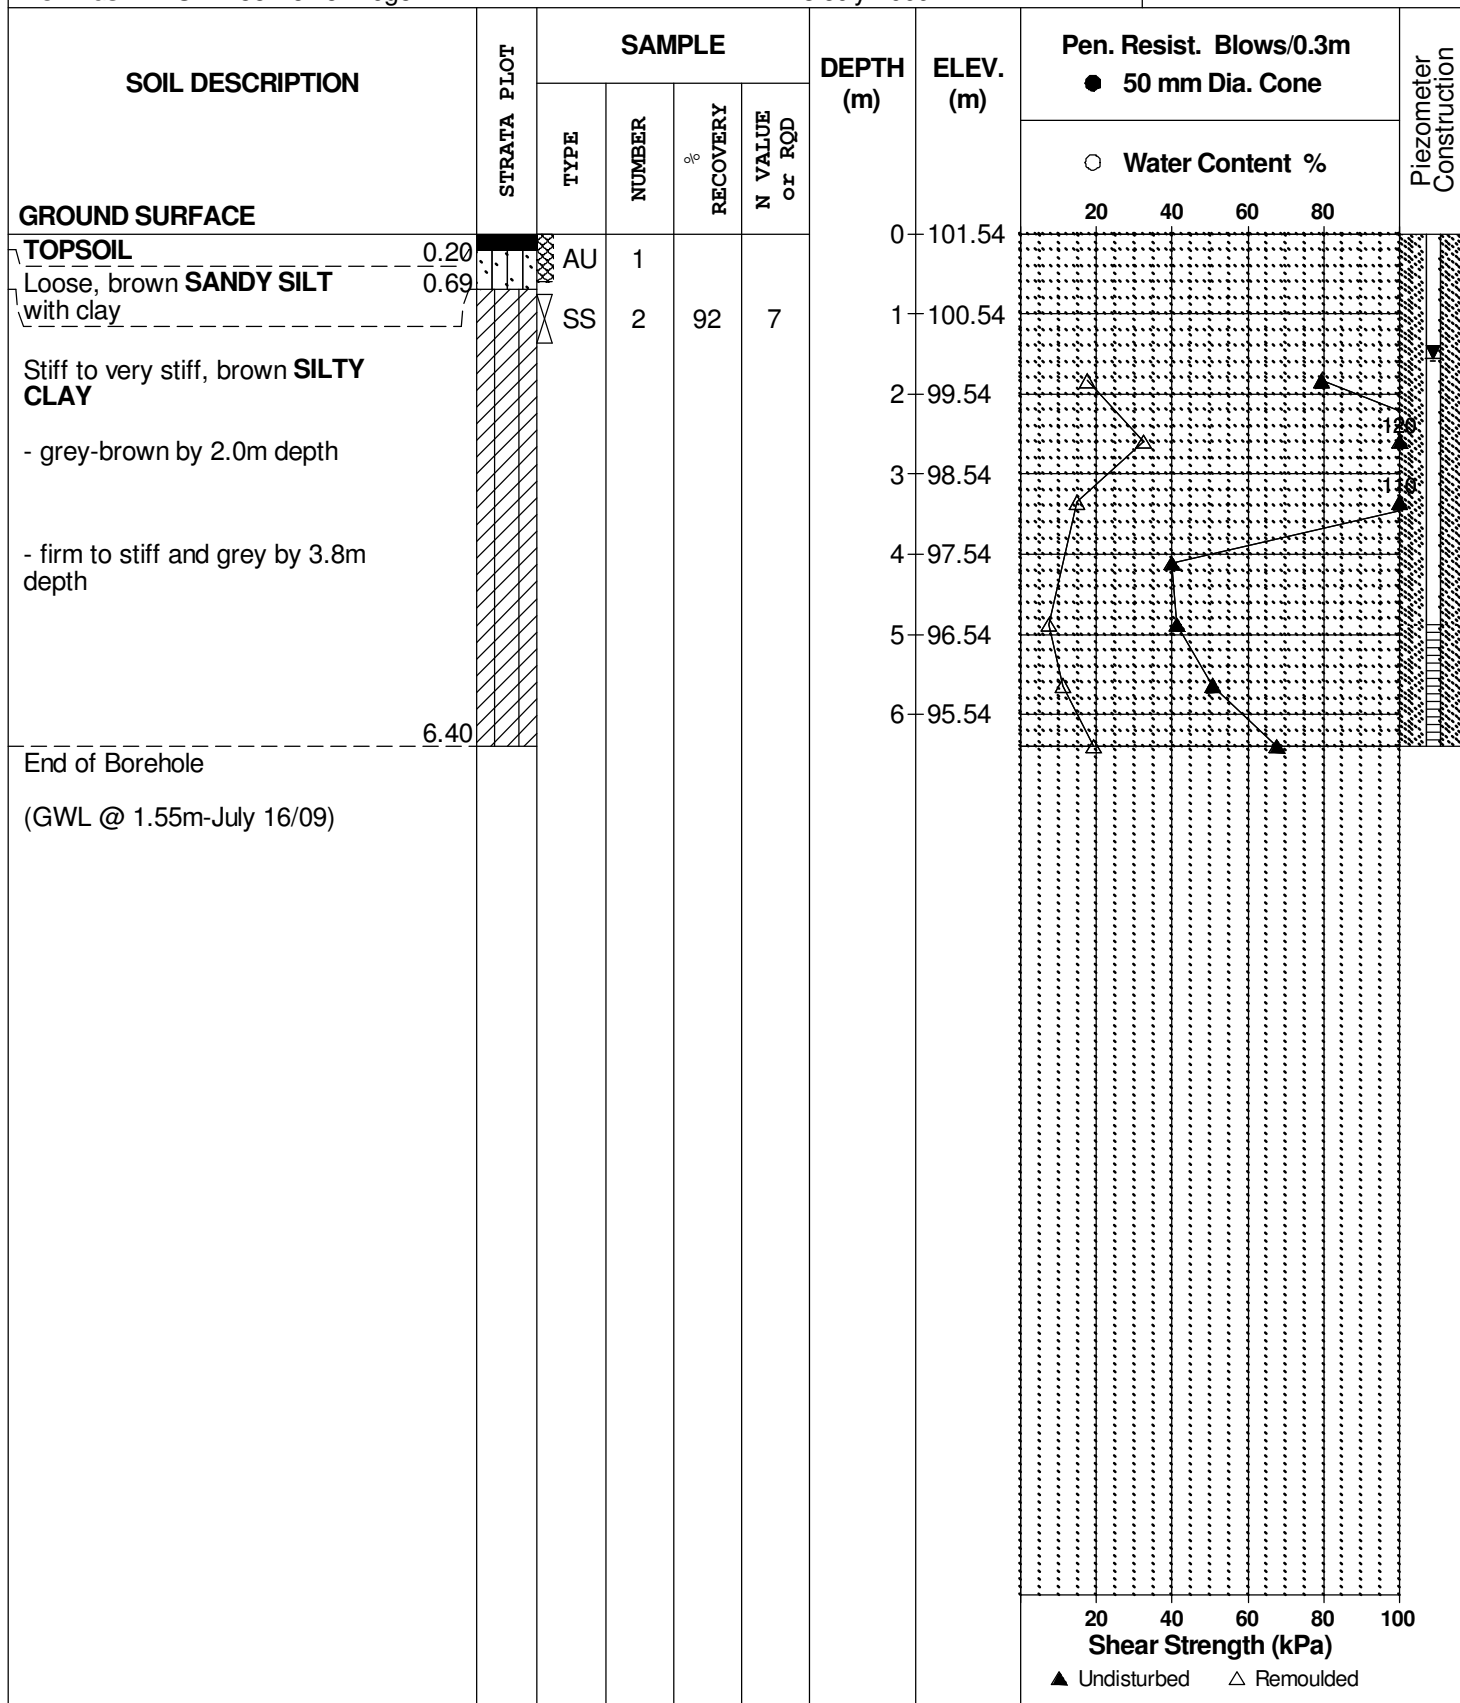

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH11**

BORINGS BY CME 55 Power Auger

DATE 8 July 2009

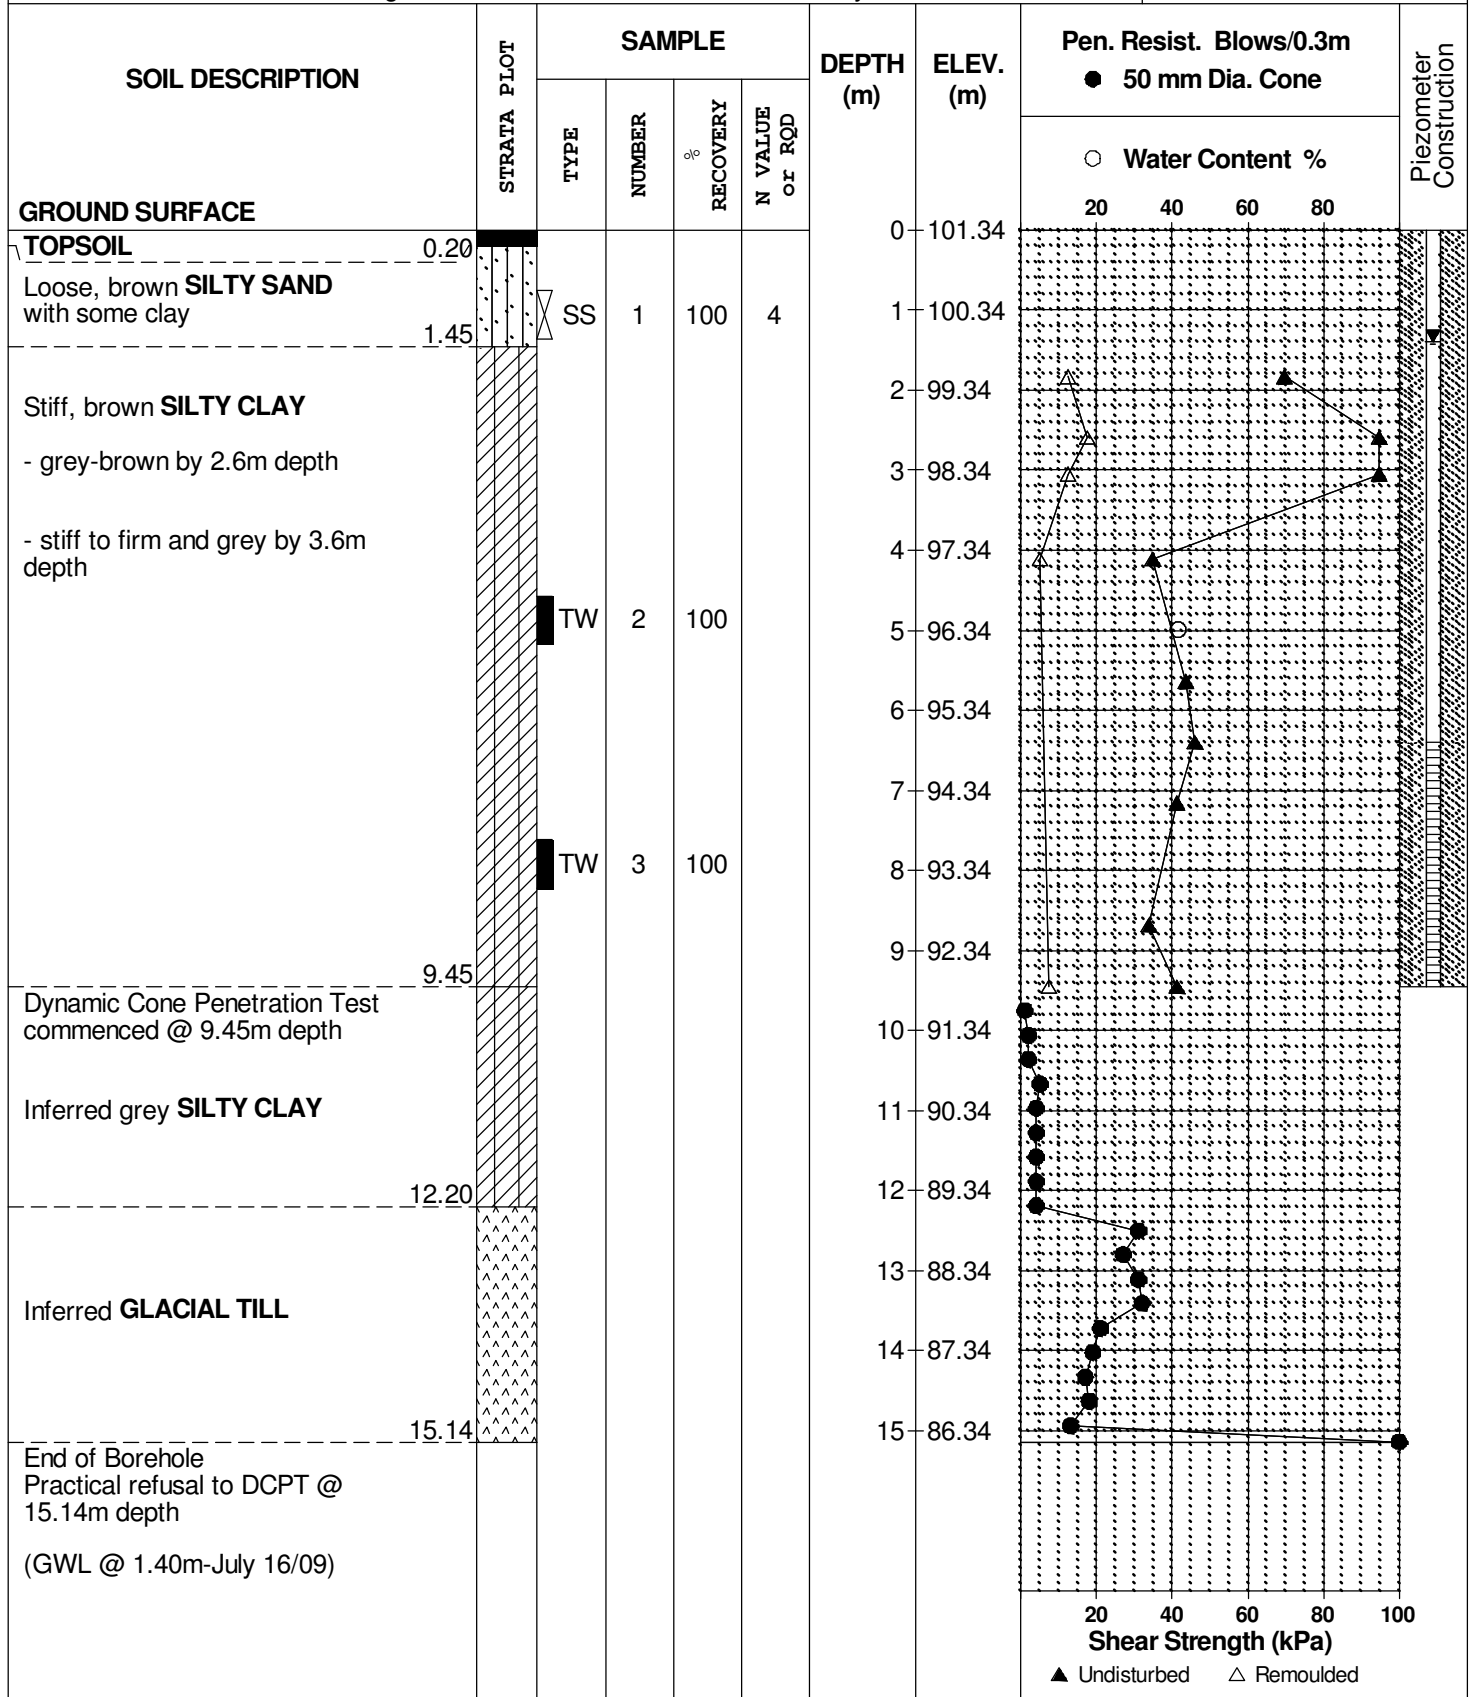

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH12**

BORINGS BY CME 55 Power Auger

DATE 8 July 2009

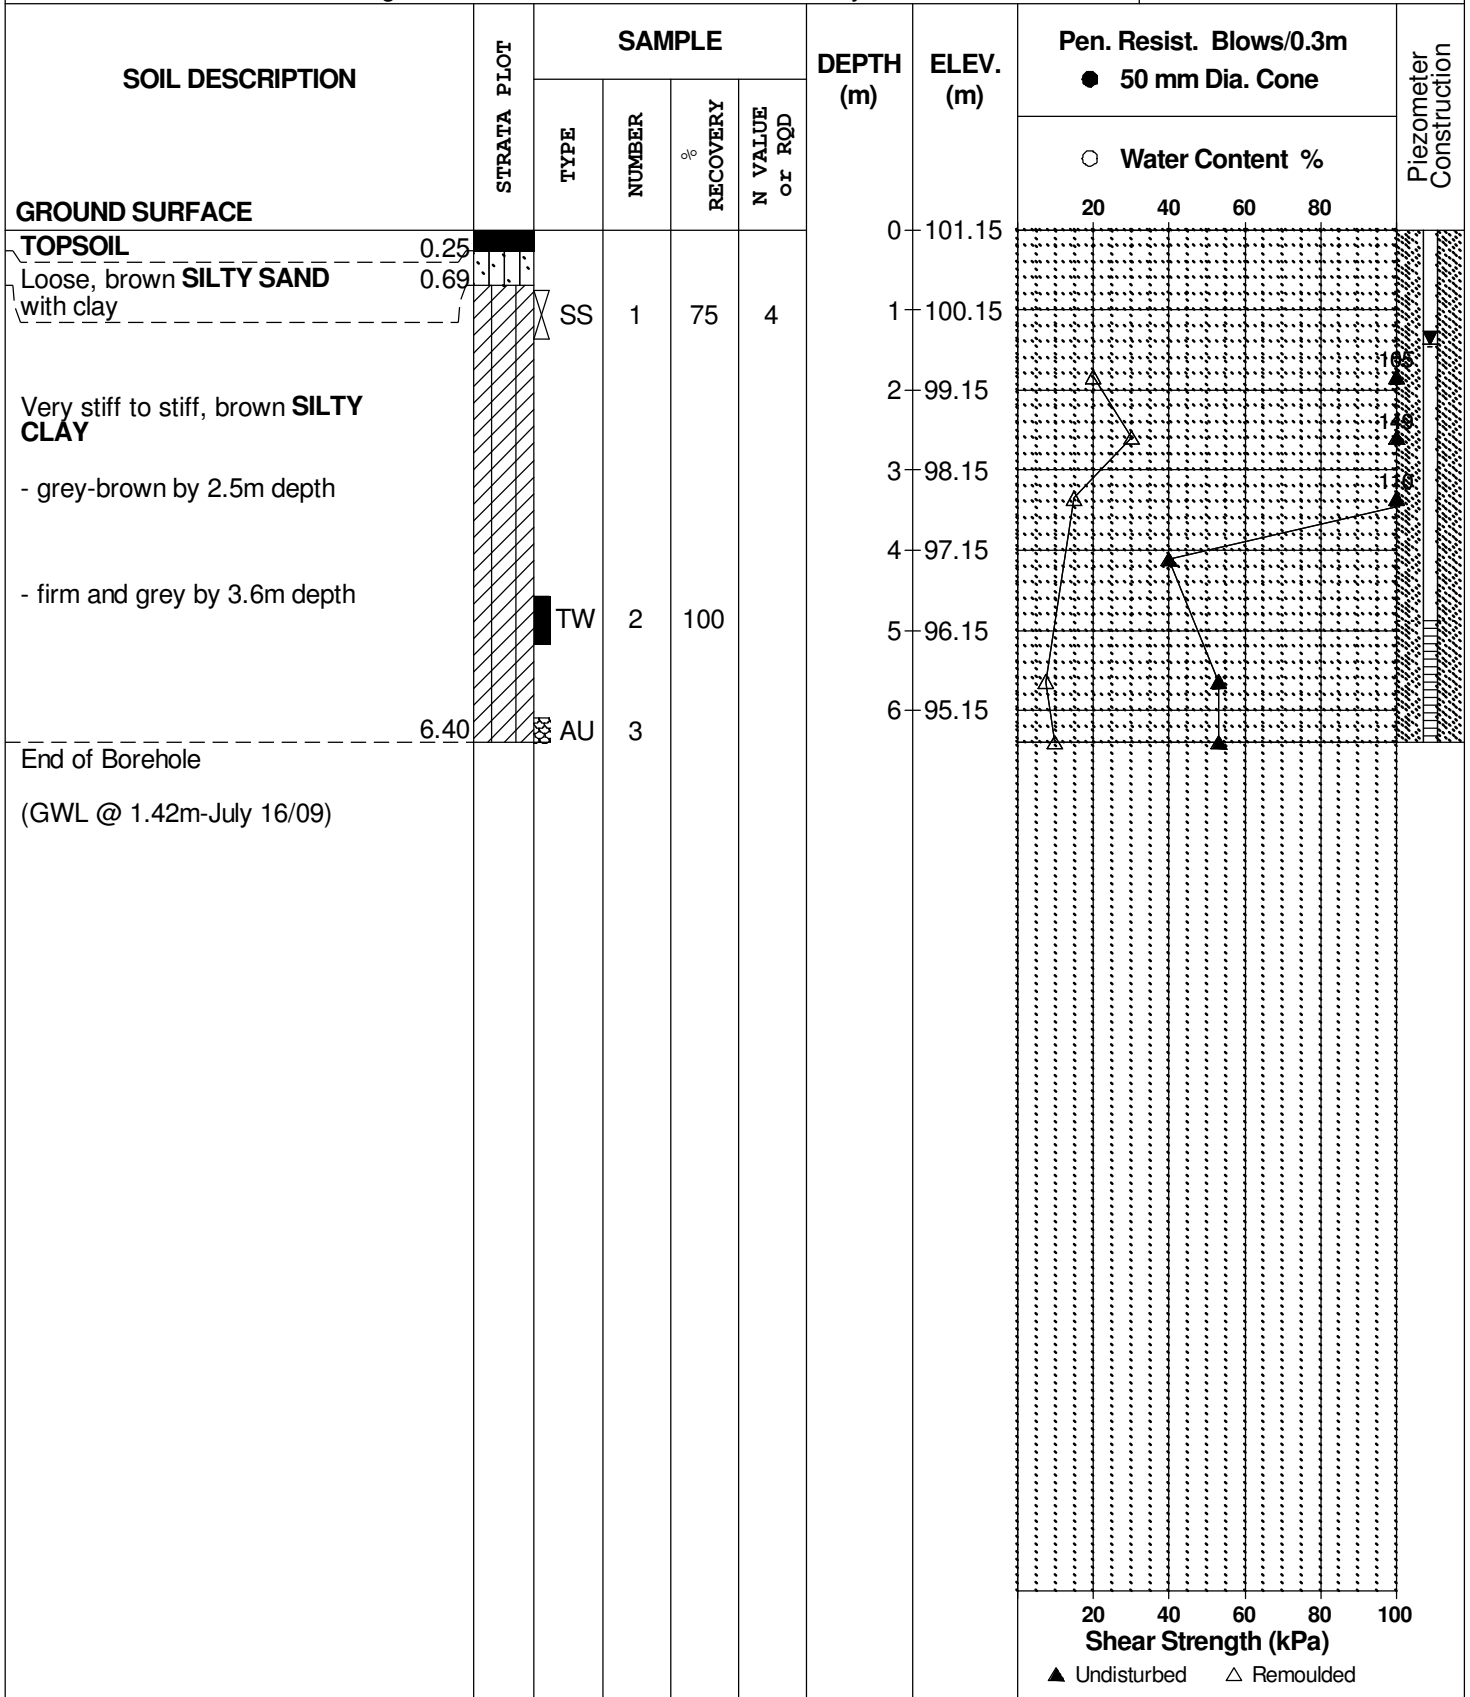

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


REMARKS

BORINGS BY CME 55 Power Auger

DATE 10 July 2009

FILE NO. **PG1899**

HOLE NO. **BH13**

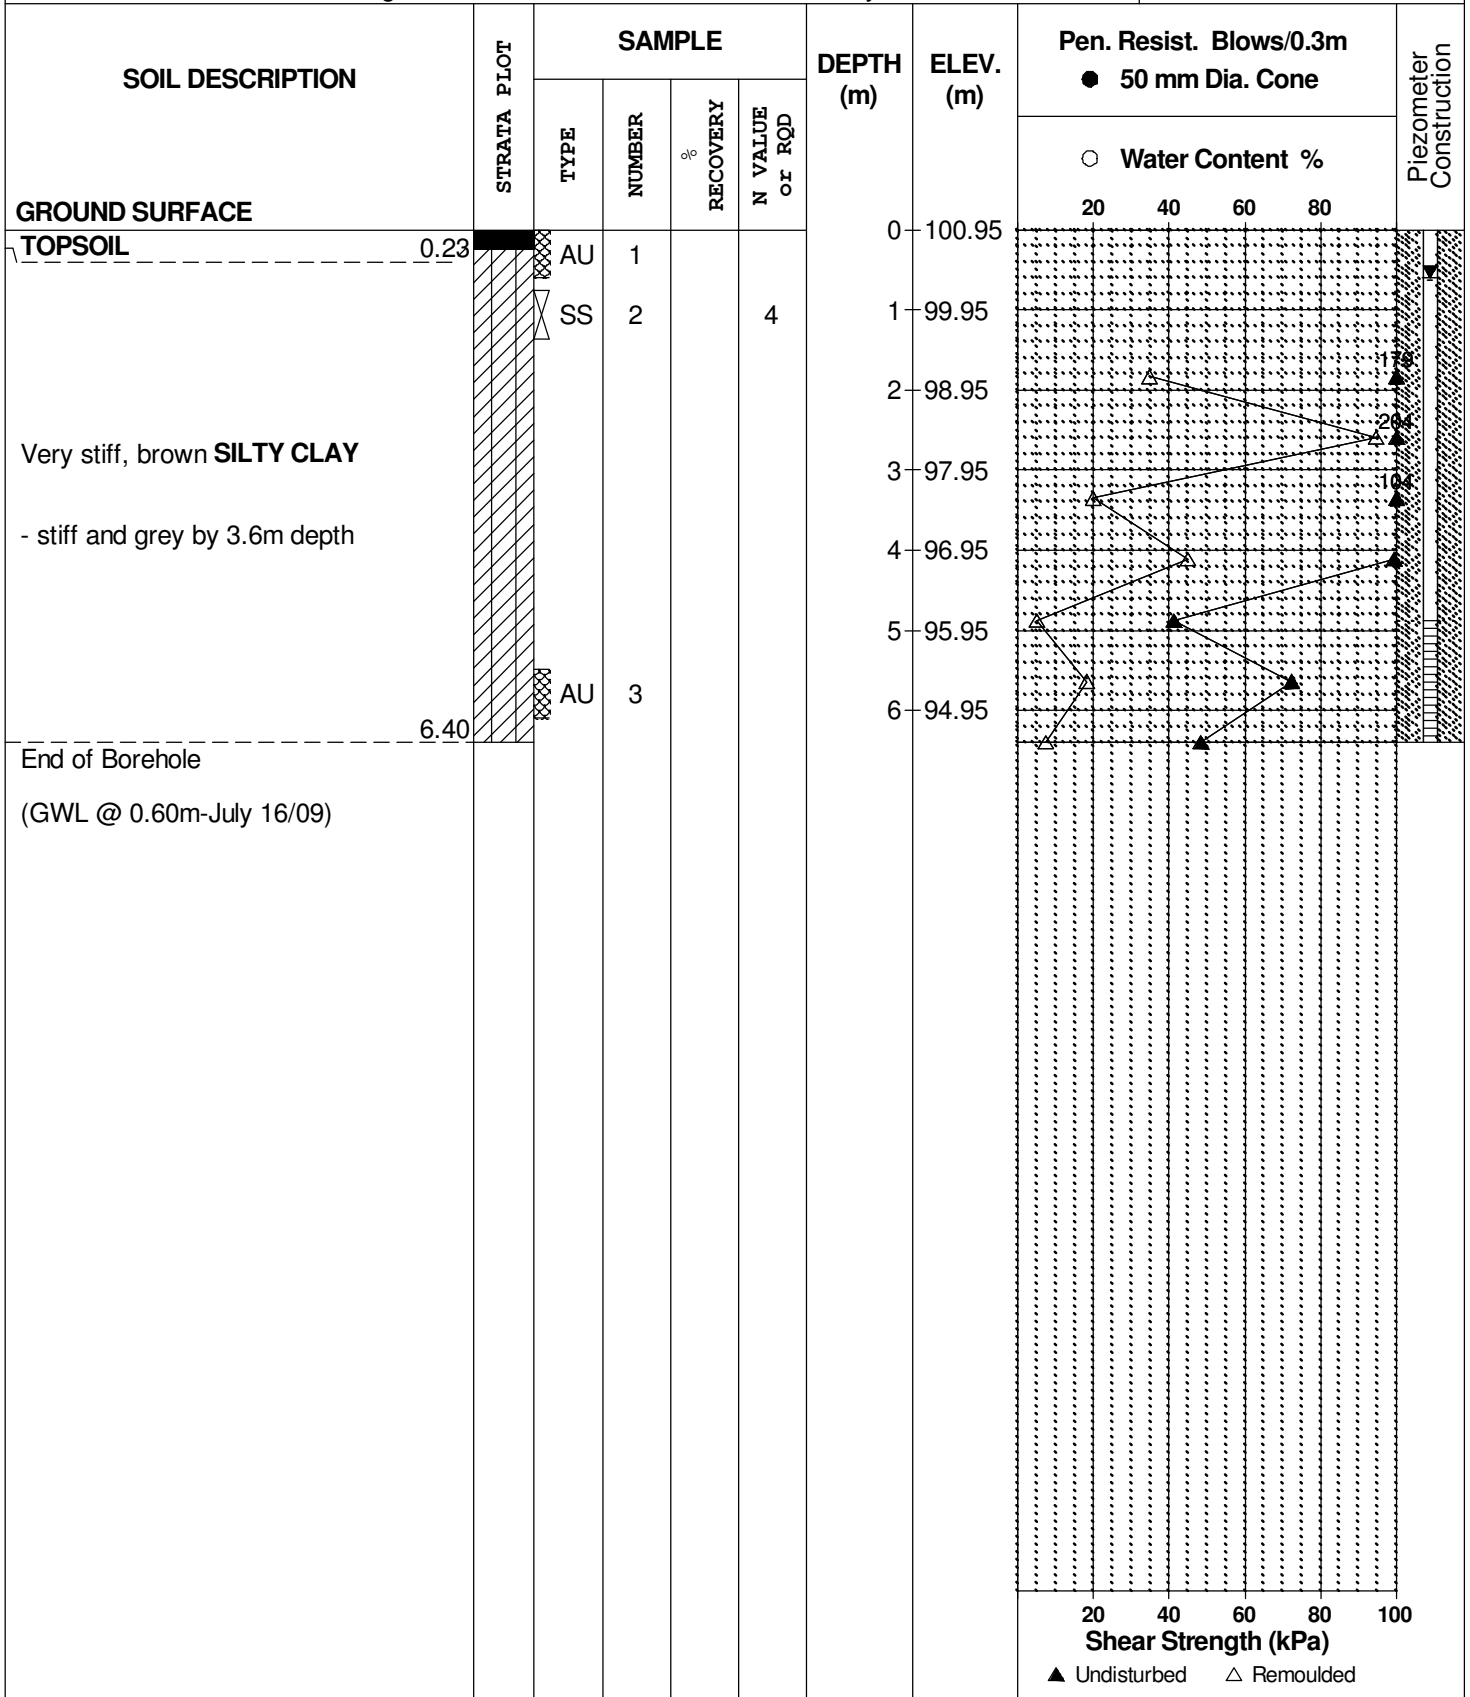

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH14**

BORINGS BY CME 55 Power Auger

DATE 10 July 2009

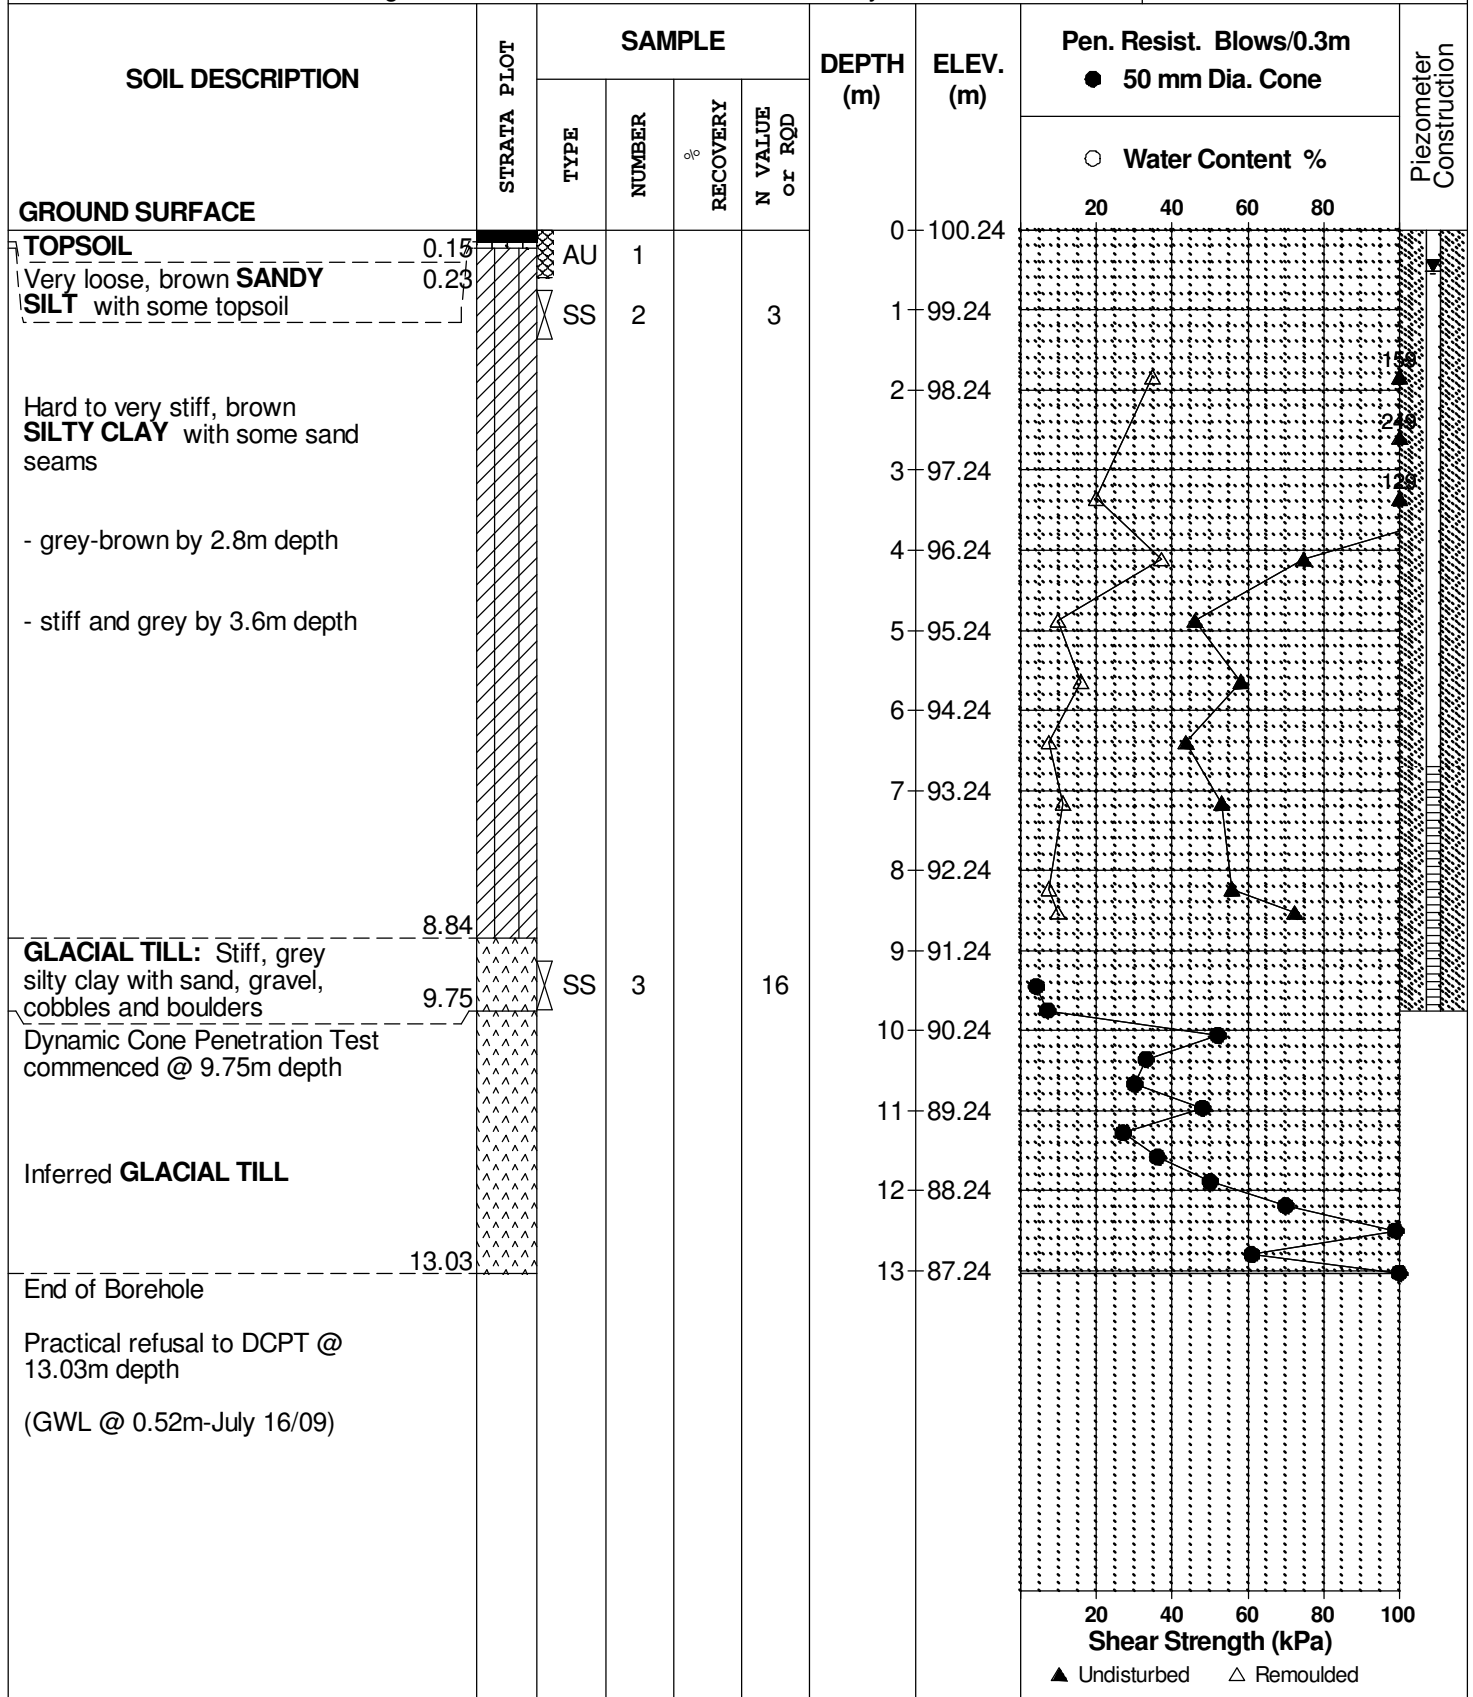

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH15**

BORINGS BY CME 55 Power Auger

DATE 10 July 2009

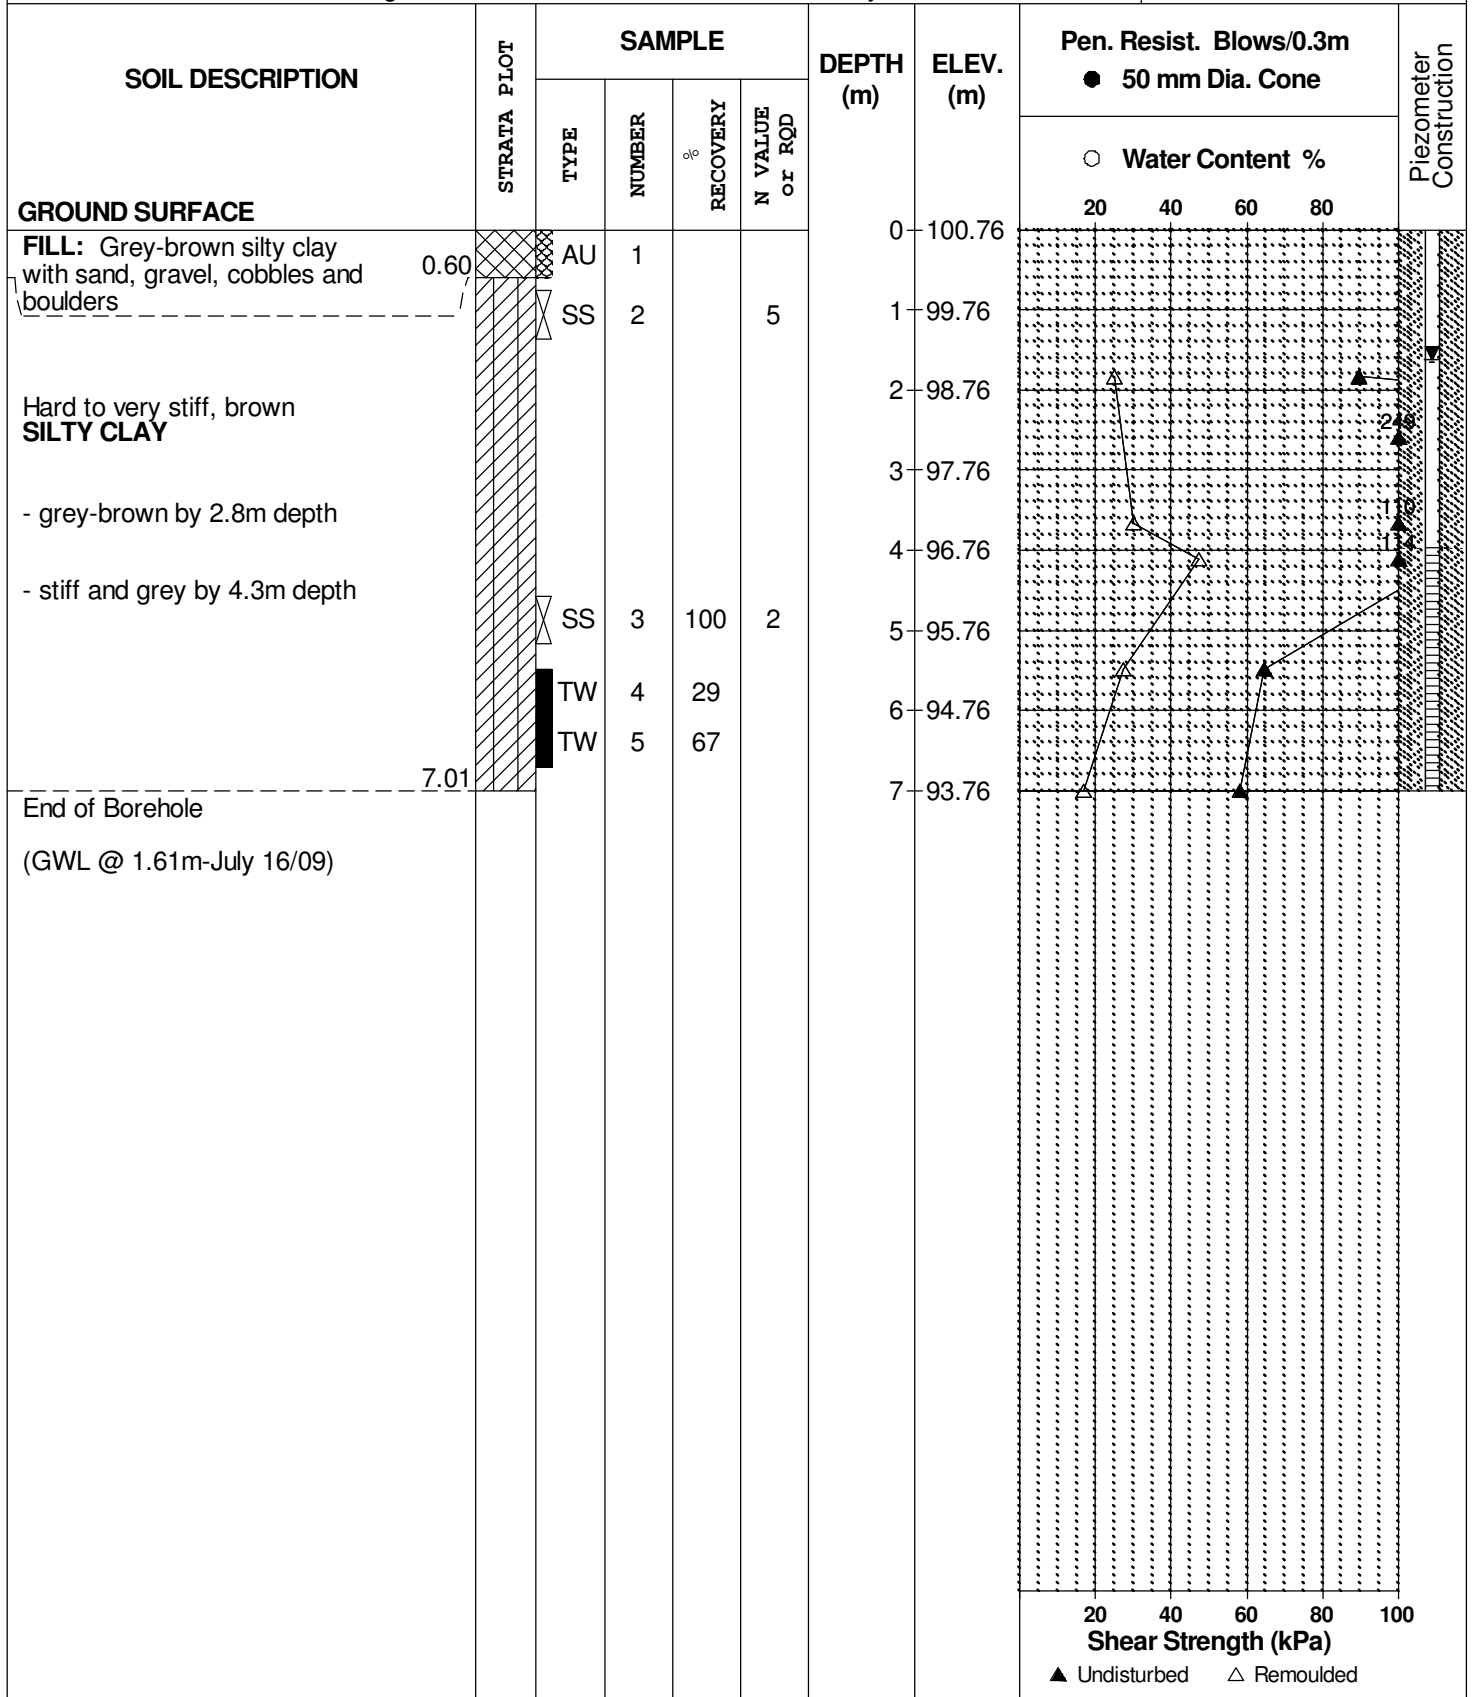

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH16**

BORINGS BY CME 55 Power Auger

DATE 9 July 2009

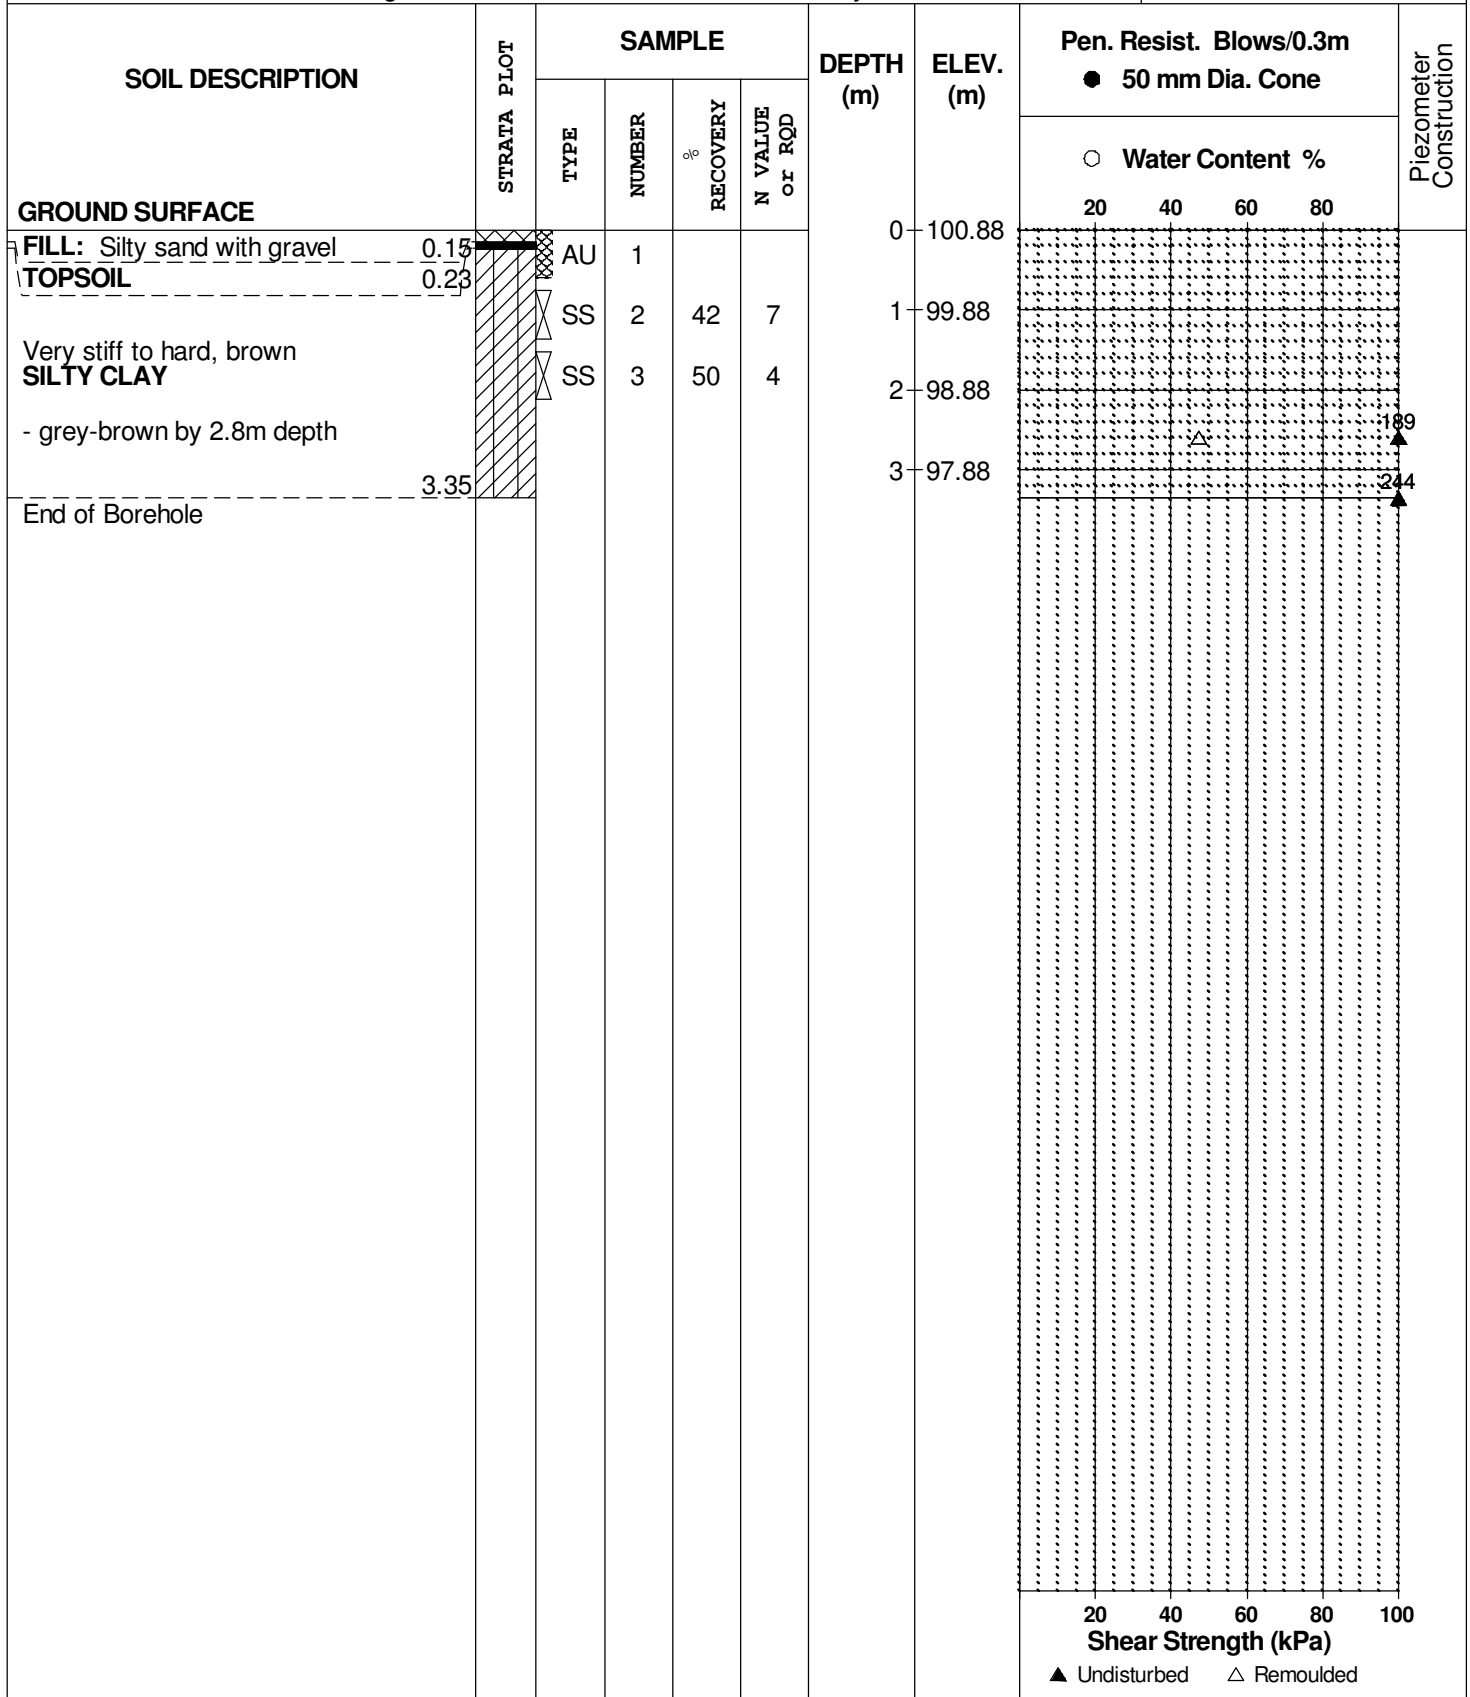

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH17**

BORINGS BY CME 55 Power Auger

DATE 9 July 2009

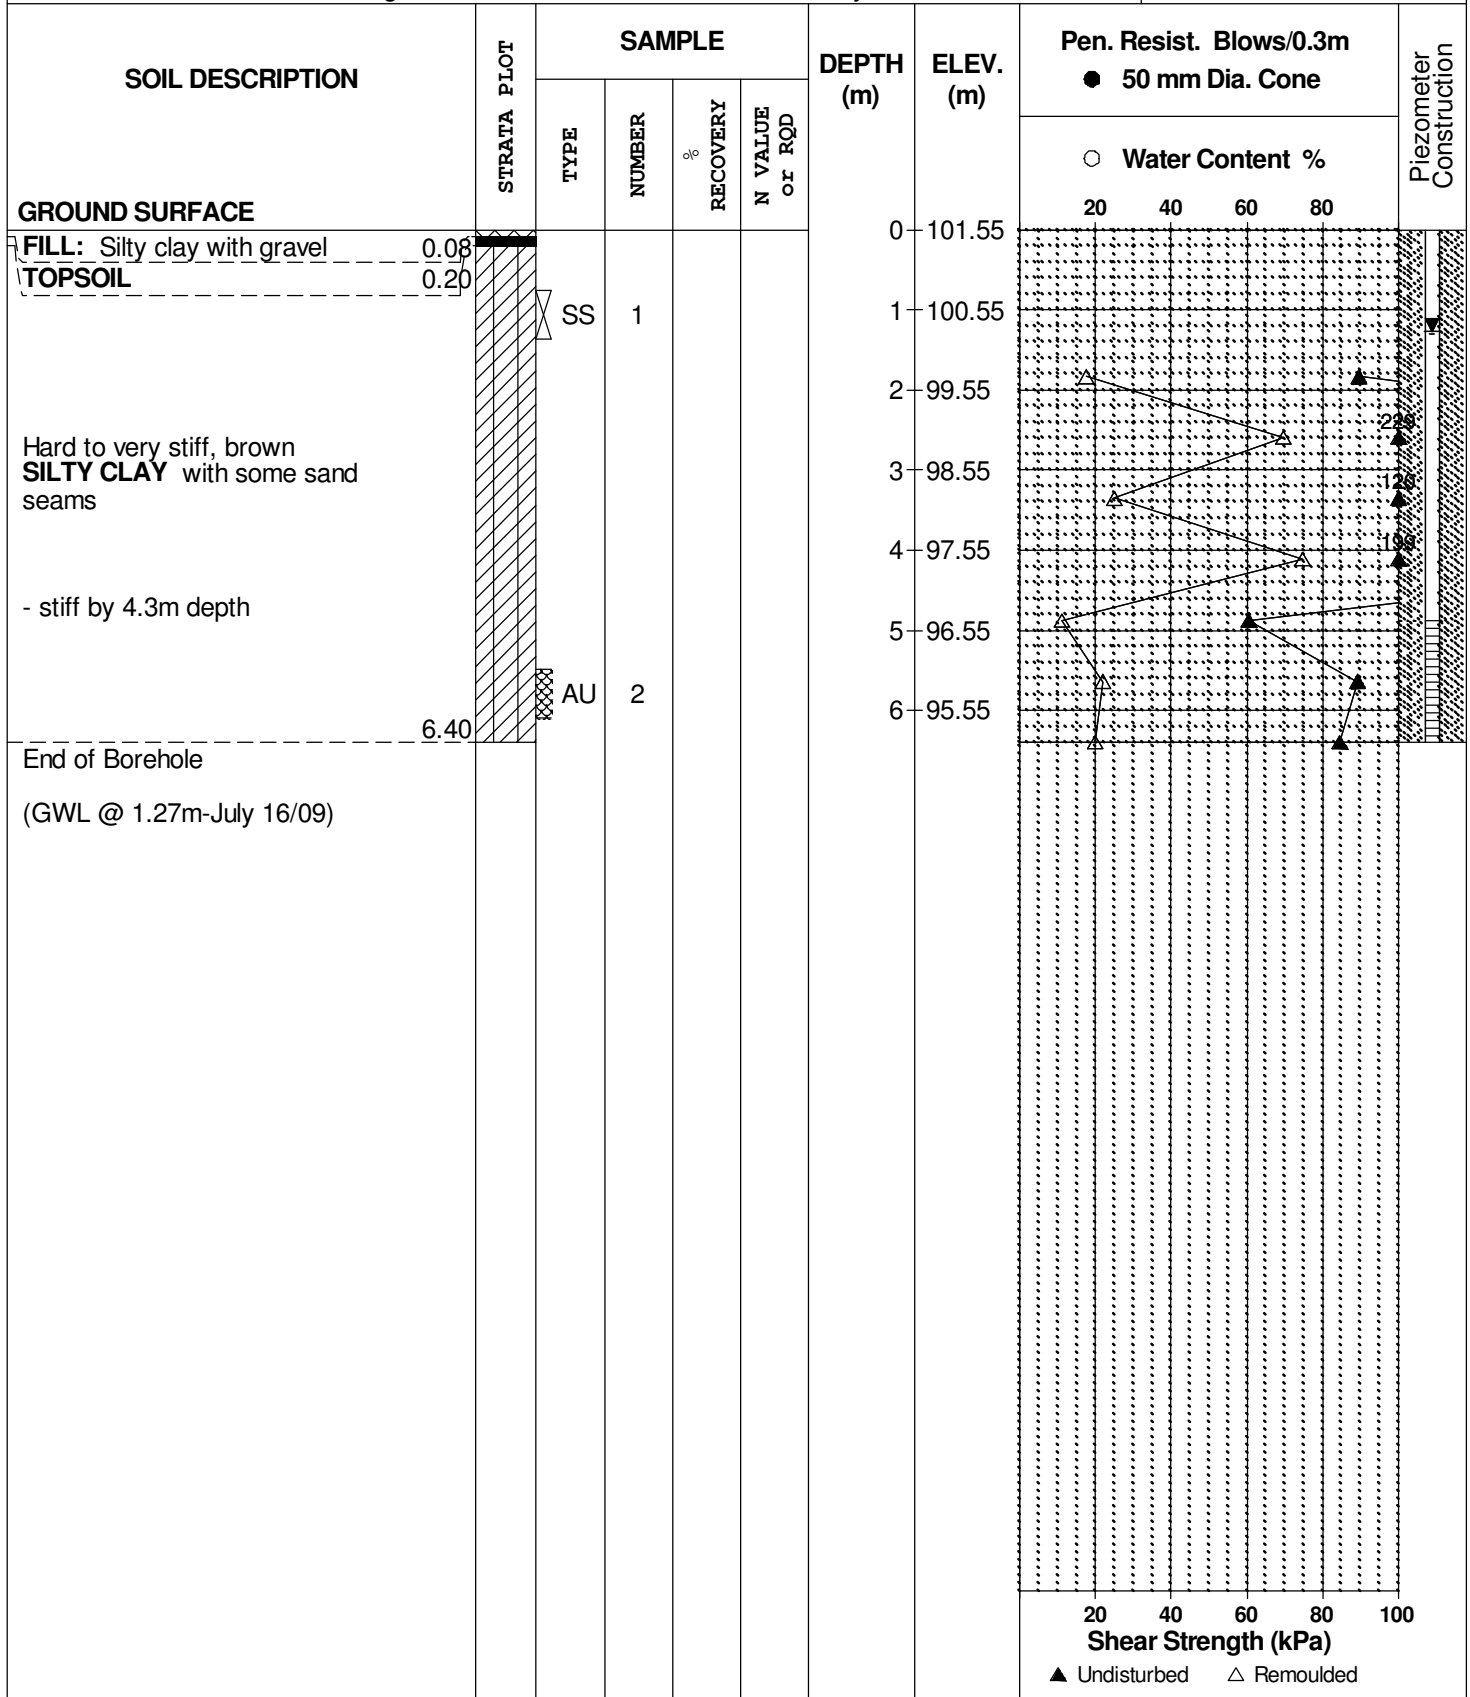

DATUM Ground surface elevations provided by Fairhall, Moffatt & Woodland Ltd.


FILE NO. **PG1899**

REMARKS

HOLE NO. **BH18**

BORINGS BY CME 55 Power Auger

DATE 13 July 2009

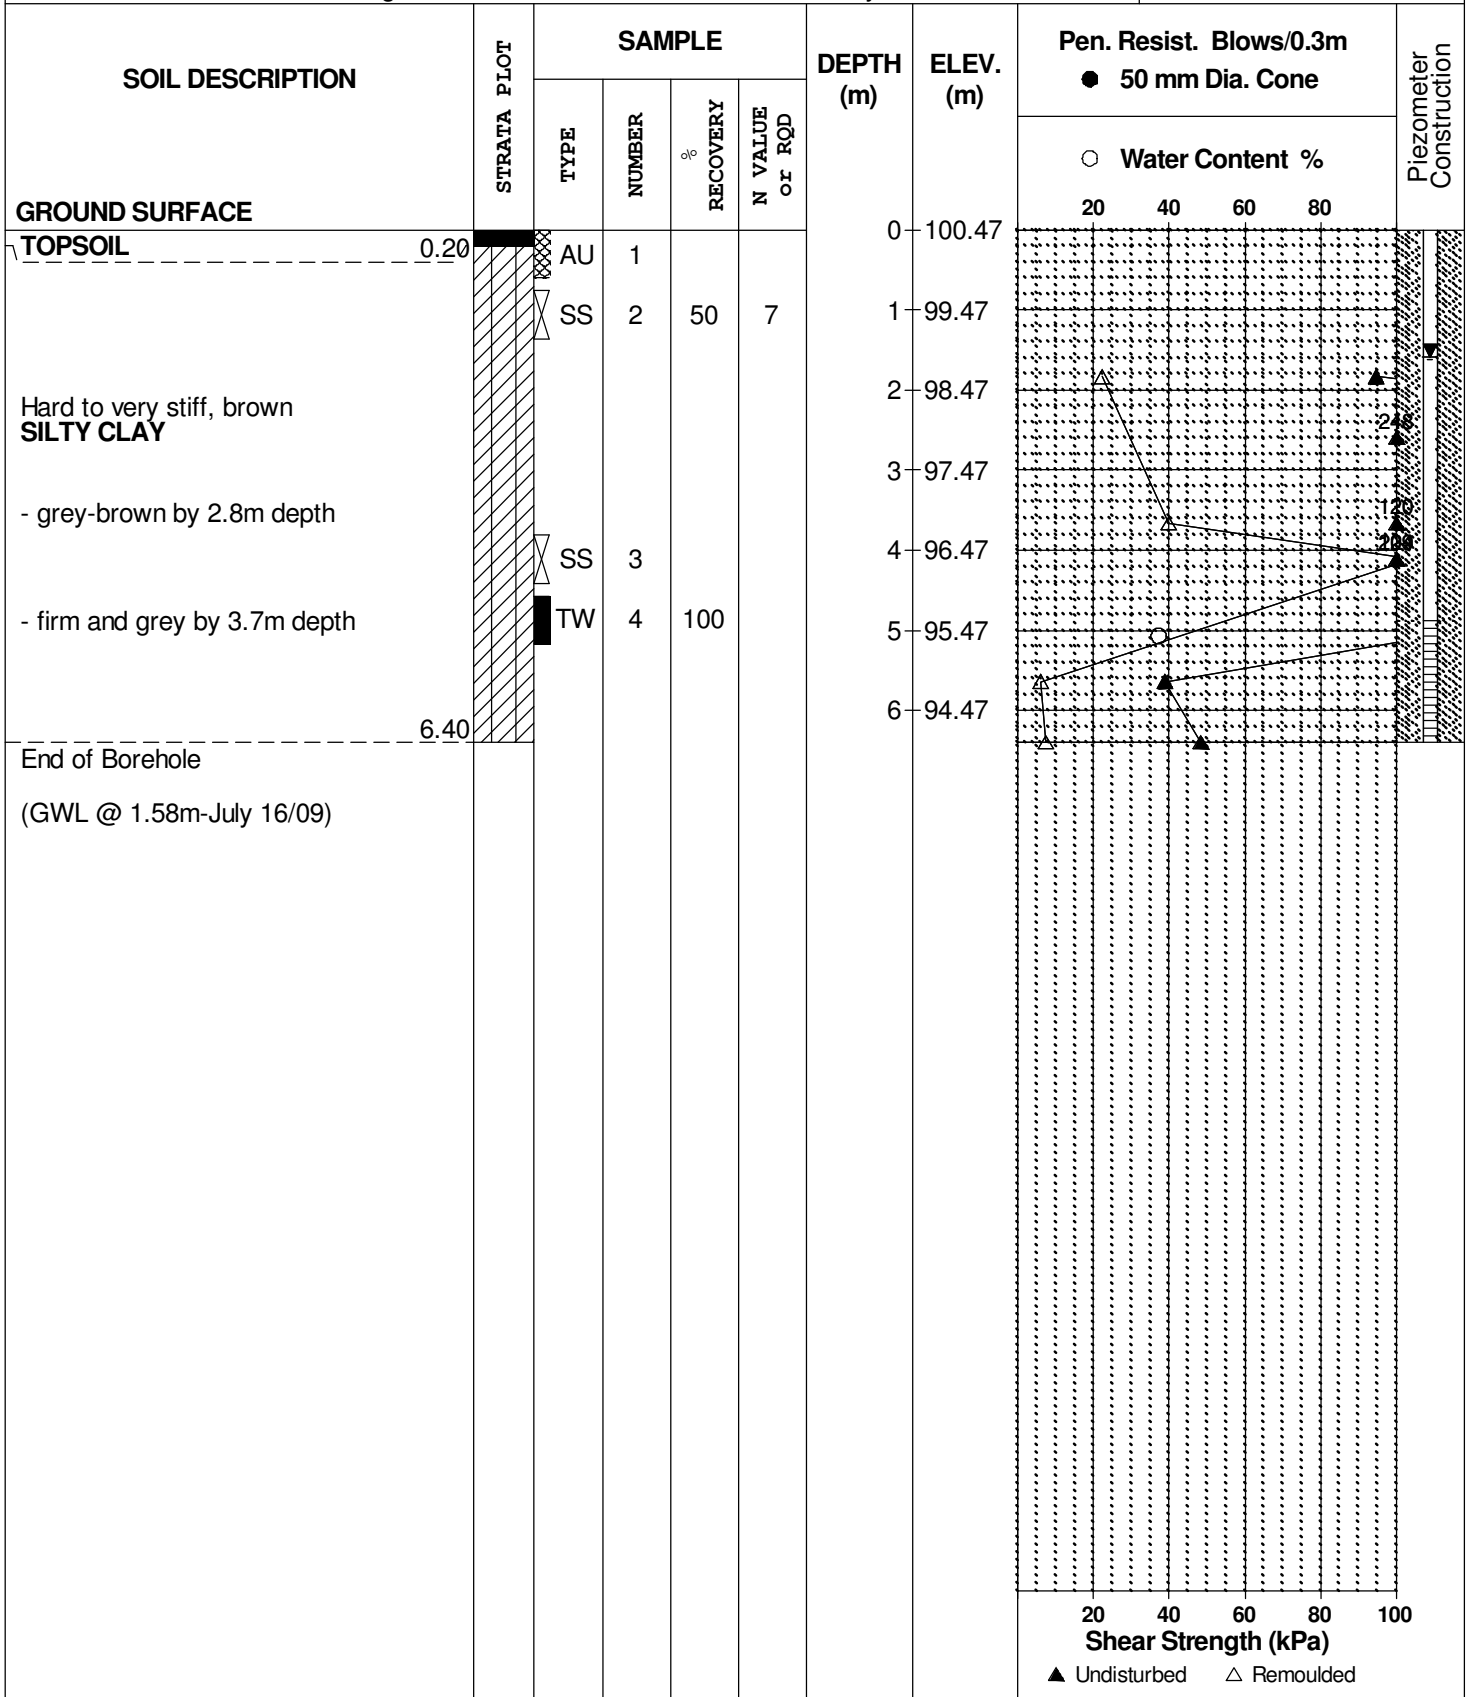

SYMBOLS AND TERMS

SOIL DESCRIPTION

Behavioural properties, such as structure and strength, take precedence over particle gradation in describing soils. Terminology describing soil structure are as follows:

Desiccated	-	having visible signs of weathering by oxidation of clay minerals, shrinkage cracks, etc.
Fissured	-	having cracks, and hence a blocky structure.
Varved	-	composed of regular alternating layers of silt and clay.
Stratified	-	composed of alternating layers of different soil types, e.g. silt and sand or silt and clay.
Well-Graded	-	Having wide range in grain sizes and substantial amounts of all intermediate particle sizes (see Grain Size Distribution).
Uniformly-Graded	-	Predominantly of one grain size (see Grain Size Distribution).

The standard terminology to describe the strength of cohesionless soils is the relative density, usually inferred from the results of the Standard Penetration Test (SPT) 'N' value. The SPT N value is the number of blows of a 63.5 kg hammer, falling 760 mm, required to drive a 51 mm O.D. split spoon sampler 300 mm into the soil after an initial penetration of 150 mm.

Relative Density	'N' Value	Relative Density %
Very Loose	<4	<15
Loose	4-10	15-35
Compact	10-30	35-65
Dense	30-50	65-85
Very Dense	>50	>85

The standard terminology to describe the strength of cohesive soils is the consistency, which is based on the undisturbed undrained shear strength as measured by the in situ or laboratory vane tests, penetrometer tests, unconfined compression tests, or occasionally by Standard Penetration Tests.

Consistency	Undrained Shear Strength (kPa)	'N' Value
Very Soft	<12	<2
Soft	12-25	2-4
Firm	25-50	4-8
Stiff	50-100	8-15
Very Stiff	100-200	15-30
Hard	>200	>30

SYMBOLS AND TERMS (continued)

SOIL DESCRIPTION (continued)

Cohesive soils can also be classified according to their "sensitivity". The sensitivity is the ratio between the undisturbed undrained shear strength and the remoulded undrained shear strength of the soil.

Terminology used for describing soil strata based upon texture, or the proportion of individual particle sizes present is provided on the Textural Soil Classification Chart at the end of this information package.

ROCK DESCRIPTION

The structural description of the bedrock mass is based on the Rock Quality Designation (RQD).

The RQD classification is based on a modified core recovery percentage in which all pieces of sound core over 100 mm long are counted as recovery. The smaller pieces are considered to be a result of closely-spaced discontinuities (resulting from shearing, jointing, faulting, or weathering) in the rock mass and are not counted. RQD is ideally determined from NXL size core. However, it can be used on smaller core sizes, such as BX, if the bulk of the fractures caused by drilling stresses (called "mechanical breaks") are easily distinguishable from the normal in situ fractures.

RQD %	ROCK QUALITY
90-100	Excellent, intact, very sound
75-90	Good, massive, moderately jointed or sound
50-75	Fair, blocky and seamy, fractured
25-50	Poor, shattered and very seamy or blocky, severely fractured
0-25	Very poor, crushed, very severely fractured

SAMPLE TYPES

SS	-	Split spoon sample (obtained in conjunction with the performing of the Standard Penetration Test (SPT))
TW	-	Thin wall tube or Shelby tube
PS	-	Piston sample
AU	-	Auger sample or bulk sample
WS	-	Wash sample
RC	-	Rock core sample (Core bit size AXT, BXL, etc.). Rock core samples are obtained with the use of standard diamond drilling bits.

SYMBOLS AND TERMS (continued)

GRAIN SIZE DISTRIBUTION

MC%	-	Natural moisture content or water content of sample, %
LL	-	Liquid Limit, % (water content above which soil behaves as a liquid)
PL	-	Plastic limit, % (water content above which soil behaves plastically)
PI	-	Plasticity index, % (difference between LL and PL)
Dxx	-	Grain size which xx% of the soil, by weight, is of finer grain sizes These grain size descriptions are not used below 0.075 mm grain size
D10	-	Grain size at which 10% of the soil is finer (effective grain size)
D60	-	Grain size at which 60% of the soil is finer
Cc	-	Concavity coefficient = $(D_{30})^2 / (D_{10} \times D_{60})$
Cu	-	Uniformity coefficient = D_{60} / D_{10}

Cc and Cu are used to assess the grading of sands and gravels:

Well-graded gravels have: $1 < Cc < 3$ and $Cu > 4$

Well-graded sands have: $1 < Cc < 3$ and $Cu > 6$

Sands and gravels not meeting the above requirements are poorly-graded or uniformly-graded.

Cc and Cu are not applicable for the description of soils with more than 10% silt and clay (more than 10% finer than 0.075 mm or the #200 sieve)

CONSOLIDATION TEST

p'_o	-	Present effective overburden pressure at sample depth
p'_c	-	Preconsolidation pressure of (maximum past pressure on) sample
Ccr	-	Recompression index (in effect at pressures below p'_c)
Cc	-	Compression index (in effect at pressures above p'_c)
OC Ratio		Overconsolidation ratio = p'_c / p'_o
Void Ratio		Initial sample void ratio = volume of voids / volume of solids
Wo	-	Initial water content (at start of consolidation test)

PERMEABILITY TEST


k	-	Coefficient of permeability or hydraulic conductivity is a measure of the ability of water to flow through the sample. The value of k is measured at a specified unit weight for (remoulded) cohesionless soil samples, because its value will vary with the unit weight or density of the sample during the test.
---	---	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

SYMBOLS AND TERMS (continued)


STRATA PLOT




Topsoil




Asphalt




Fill




Peat




Sand




Silty Sand




Silt




Sandy Silt



Clay




Silty Clay




Clayey Silty Sand



Glacial Till




Shale




Bedrock


MONITORING WELL AND PIEZOMETER CONSTRUCTION

MONITORING WELL CONSTRUCTION

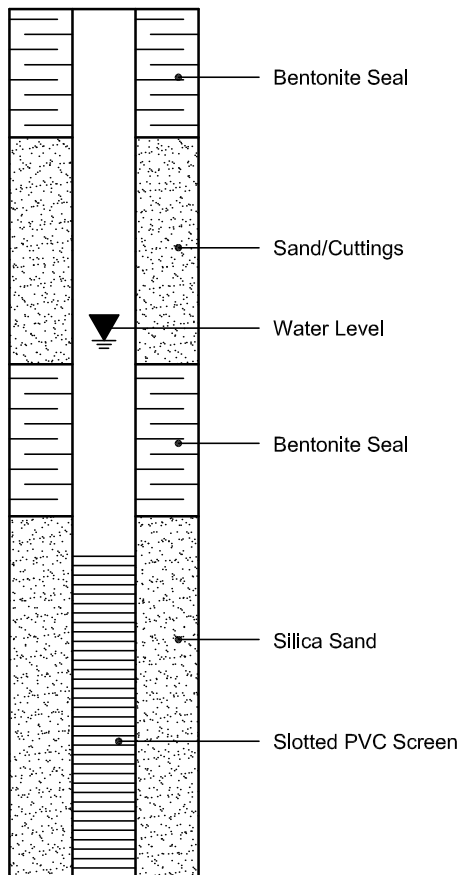

PIEZOMETER CONSTRUCTION

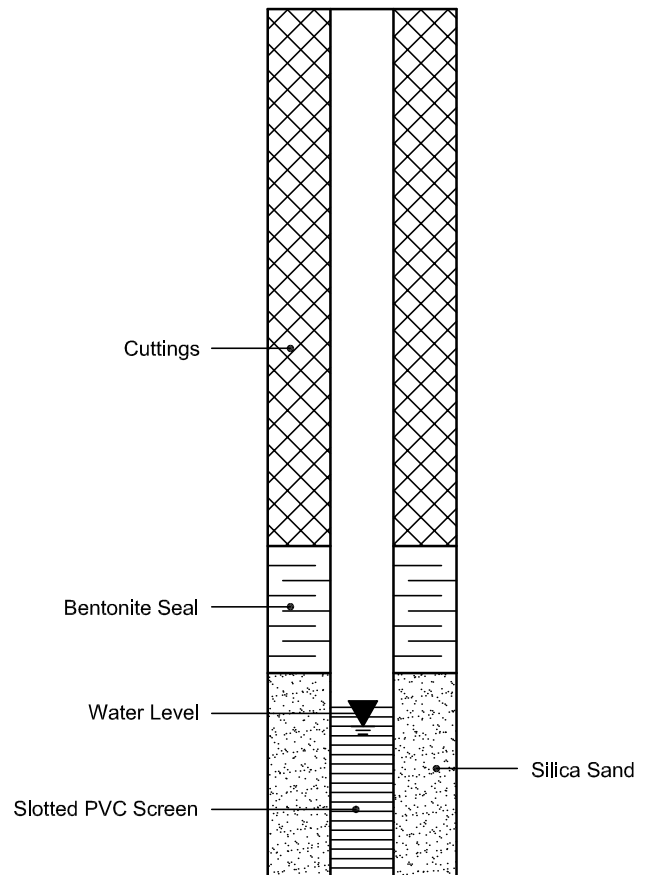

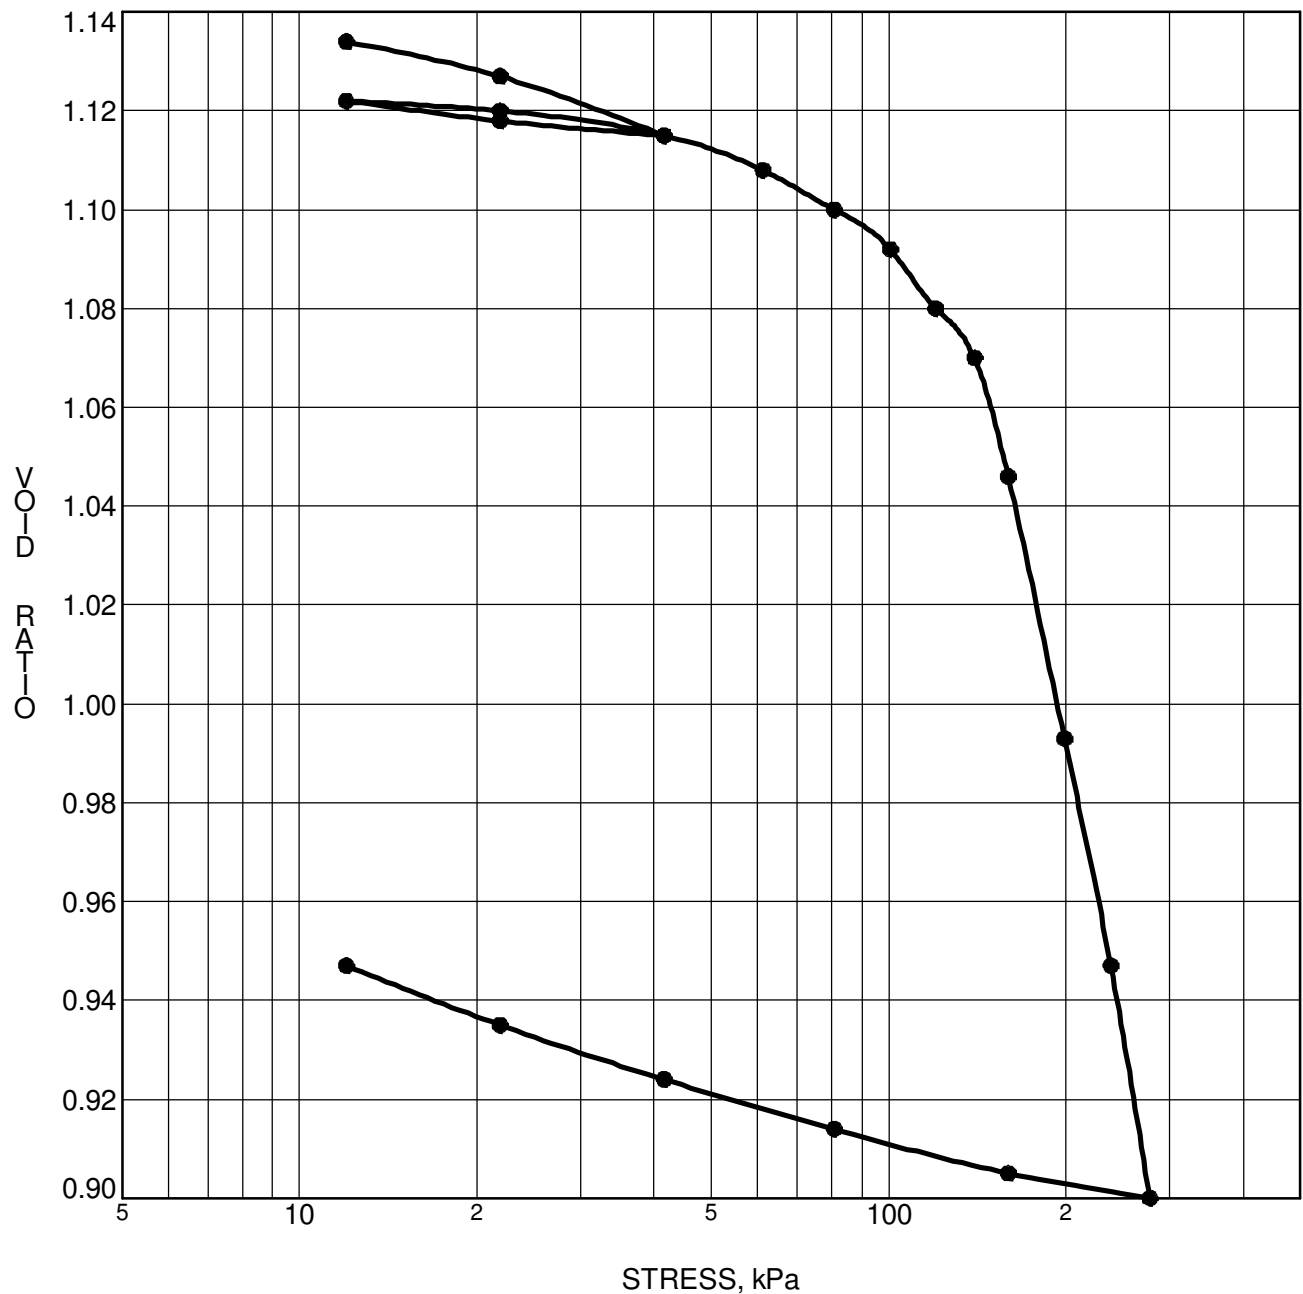


CONSOLIDATION TEST DATA SUMMARY					
Borehole No.	BH11	p'_o	70 kPa	C_{cr}	0.013
Sample No.	TW 2	p'_c	148 kPa	C_c	0.674
Sample Depth	4.99 m	OC Ratio	2.1	W_o	41.6 %
Sample Elev.	96.35 m	Void Ratio	1.143	Unit Wt.	17.7 kN/m³

CLIENT Centrecorp Management Services Limited
 PROJECT Geotechnical Investigation - Proposed Commercial Development-Hazeldean Road

FILE NO. PG1899
 DATE 07/17/2009

paterongroup Consulting Engineers
 154 Colonnade Road South, Ottawa, Ontario K2E 7J5

CONSOLIDATION TEST

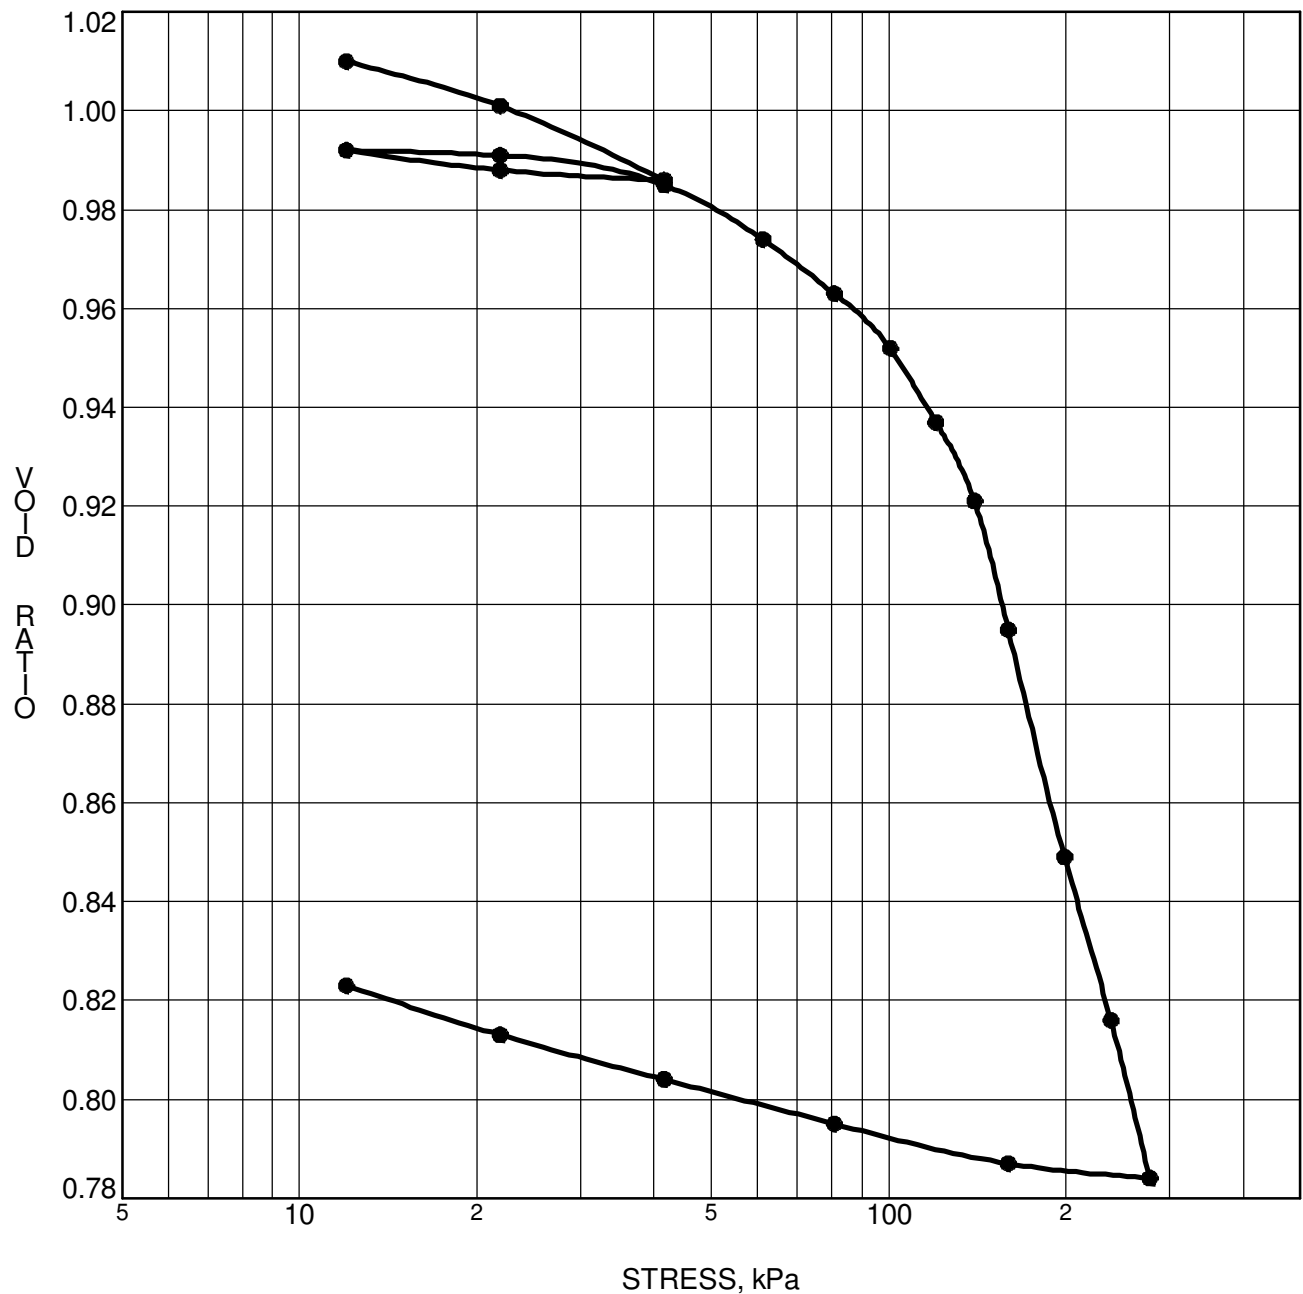


CONSOLIDATION TEST DATA SUMMARY					
Borehole No.	BH18	p'_o	65 kPa	C_{cr}	0.013
Sample No.	TW 4	p'_c	126 kPa	C_c	0.466
Sample Depth	5.07 m	OC Ratio	1.9	W_o	37.2 %
Sample Elev.	95.40 m	Void Ratio	1.024	Unit Wt.	18.2 kN/m³

CLIENT Centrecorp Management Services Limited
 PROJECT Geotechnical Investigation - Proposed Commercial Development-Hazeldean Road

FILE NO. PG1899
 DATE 07/17/2009

paterosongroup Consulting Engineers
 154 Colonnade Road South, Ottawa, Ontario K2E 7J5

CONSOLIDATION TEST

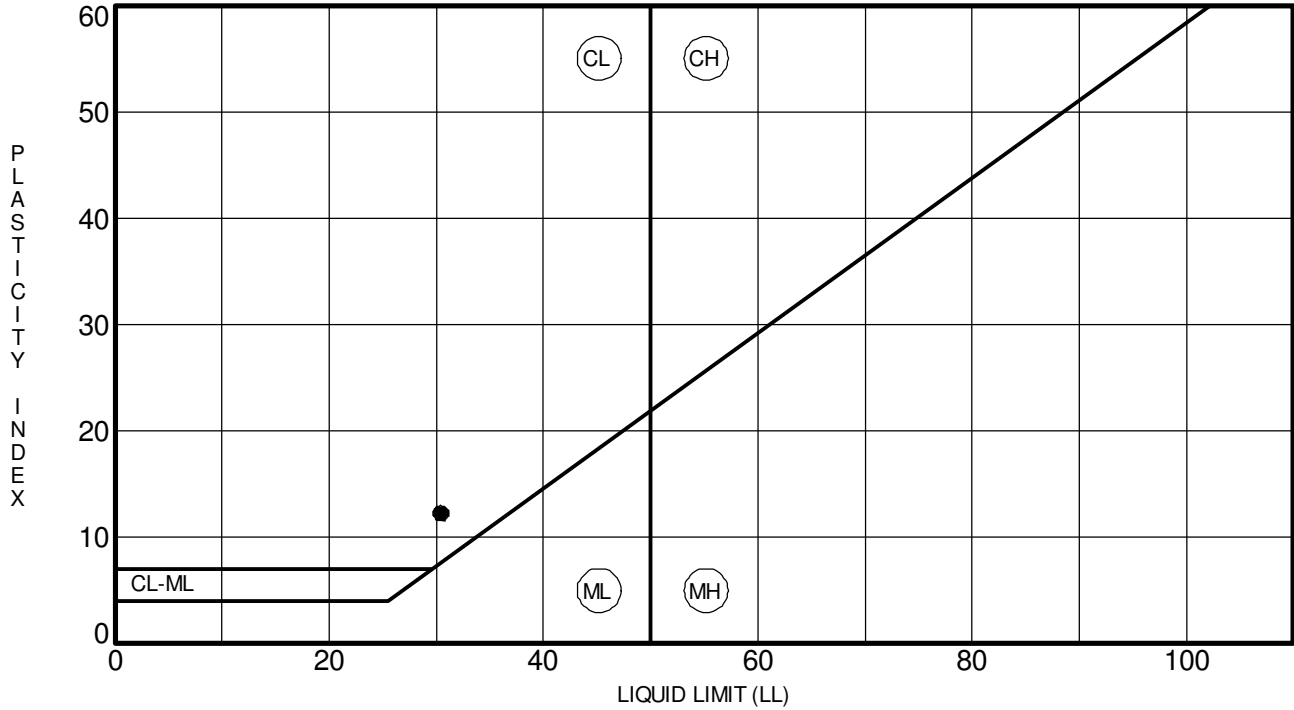

Specimen Identification	LL	PL	PI	Fines	Classification
● BH11	30	18	12		CL-Inorganic clays of low plasticity (TW 2)

CLIENT Centrecorp Management Services Limited
 PROJECT Geotechnical Investigation - Proposed Commercial Development-Hazeldean Road

FILE NO. PG1899
 DATE 8 Jul 09

Certificate of Analysis
 Client: Paterson Group Consulting Engineers
 Client PO: 17631

Report Date: 16-May-2016

Order Date: 10-May-2016

Project Description: PG1899

Client ID:	BH6-SS2	-	-	-
Sample Date:	26-Apr-16	-	-	-
Sample ID:	1620196-01	-	-	-
MDL/Units	Soil	-	-	-

Physical Characteristics

% Solids	0.1 % by Wt.	75.5	-	-	-
----------	--------------	------	---	---	---

General Inorganics

pH	0.05 pH Units	7.50	-	-	-
Resistivity	0.10 Ohm.m	21.8	-	-	-

Anions

Chloride	5 ug/g dry	66	-	-	-
Sulphate	5 ug/g dry	251	-	-	-

APPENDIX 2

FIGURE 1 - KEY PLAN

DRAWING PG1899-2 - TEST HOLE LOCATION PLAN


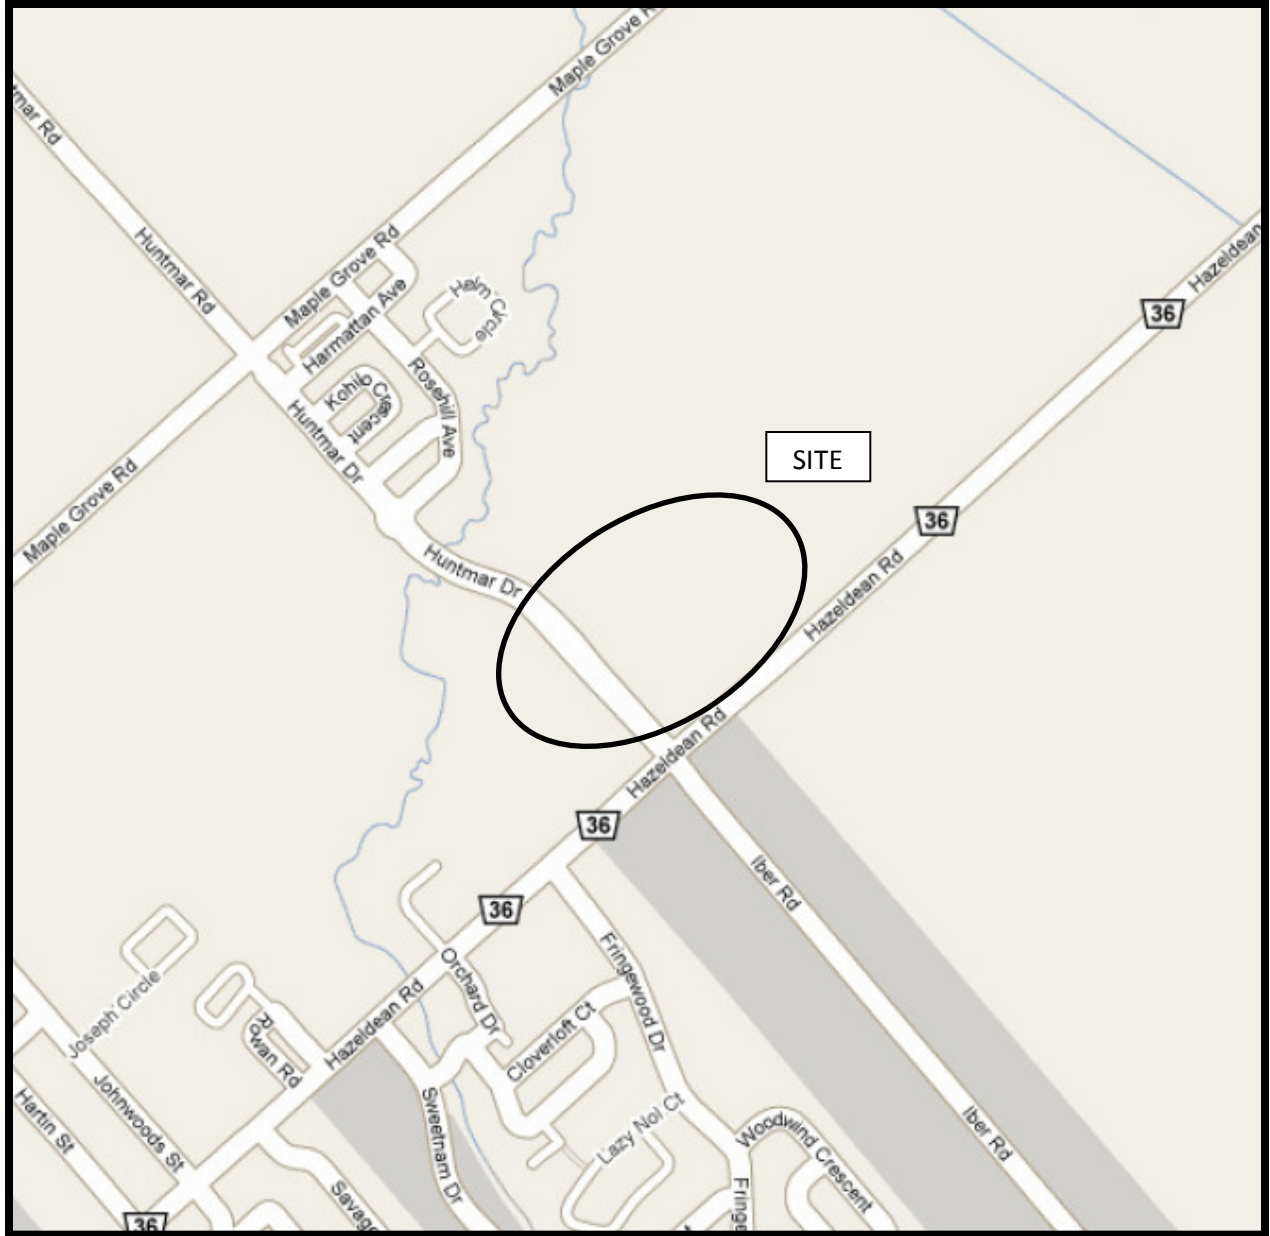


FIGURE 1
KEY PLAN

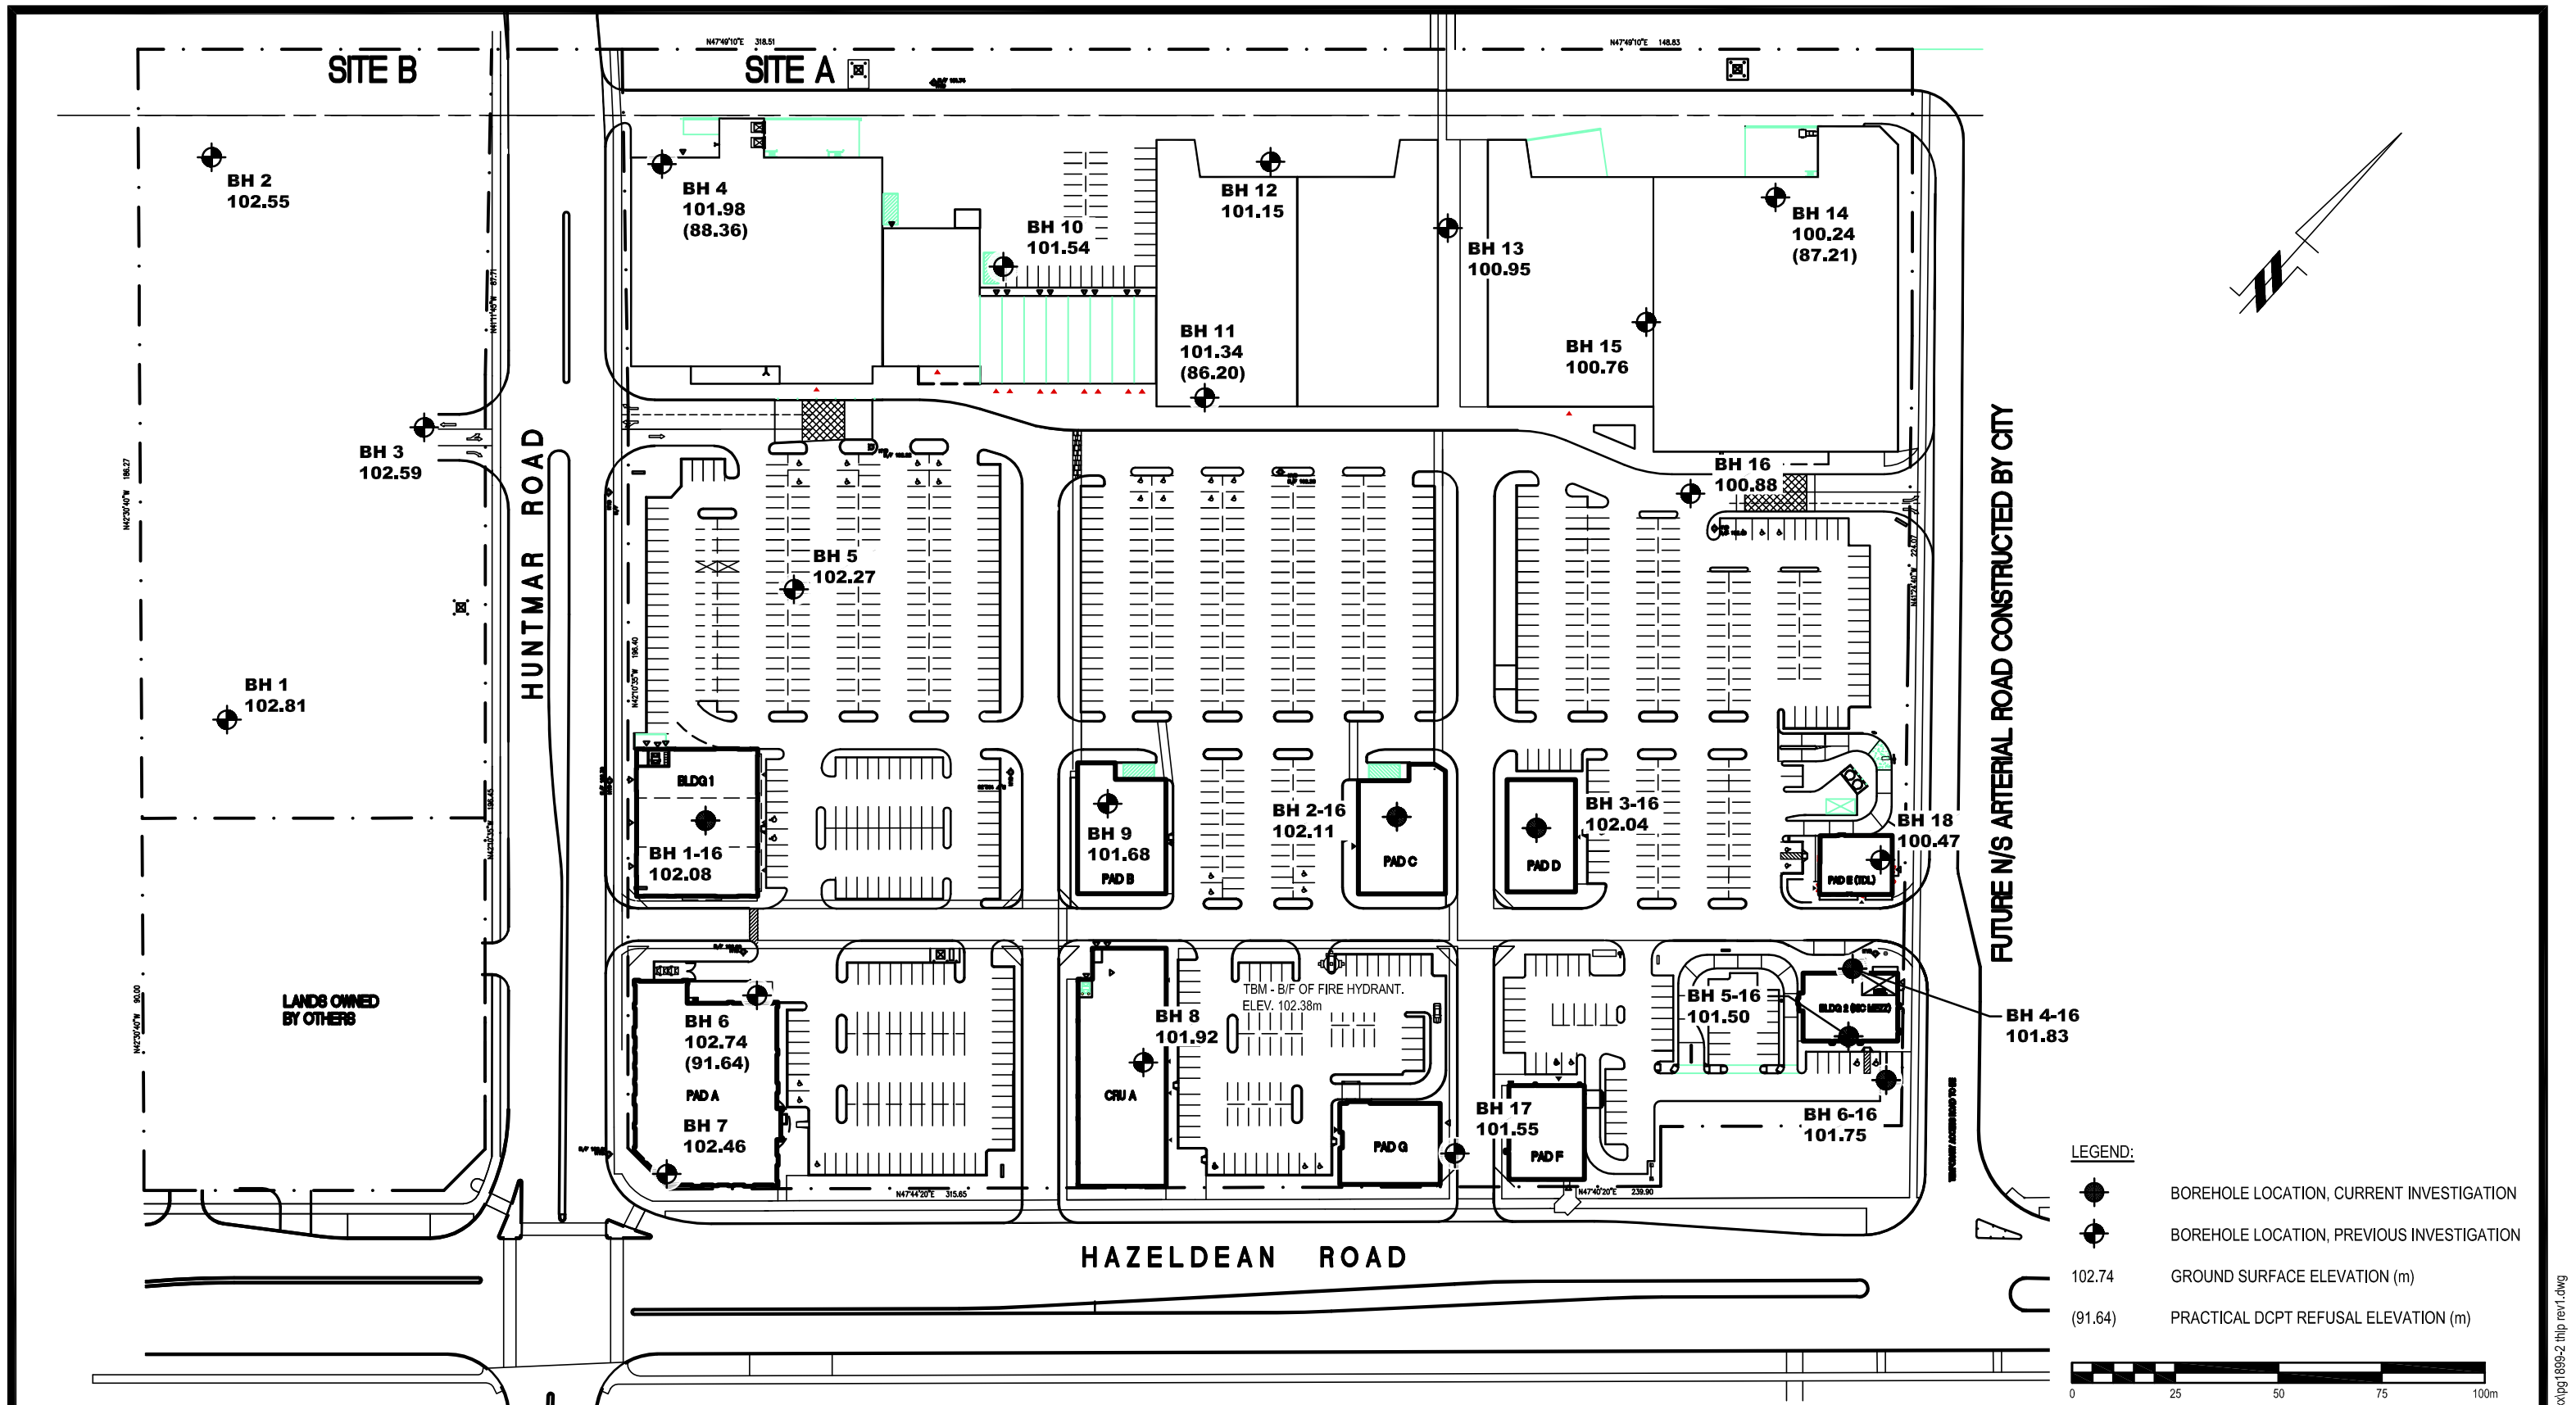

patersongroup
consulting engineers

154 Colonnade Road South
Ottawa, Ontario K2E 7J5
Tel: (613) 226-7381 Fax: (613) 226-6344

NO.	REVISIONS	DATE	INITIAL
0	BASE PLAN UPDATED	28/09/2017	DJG


NORTH AMERICAN (GOULBOURNE) LIMITED PARTNERSHIP
GEOTECHNICAL INVESTIGATION
PROP. COMMERCIAL DEVELOPMENT - HAZELDEAN ROAD

OTTAWA, ONTARIO


Title: **TEST HOLE LOCATION PLAN**

Scale:	1:1500	Date:	05/2016
Drawn by:	MPG	Report No.:	PG1899
Checked by:	FA	Dwg. No.:	PG1899-2
Approved by:	DJG	Revision No.:	1

p:\autocad drawings\geotechnical\pg1899-2\1899-2.thp rev1.dwg

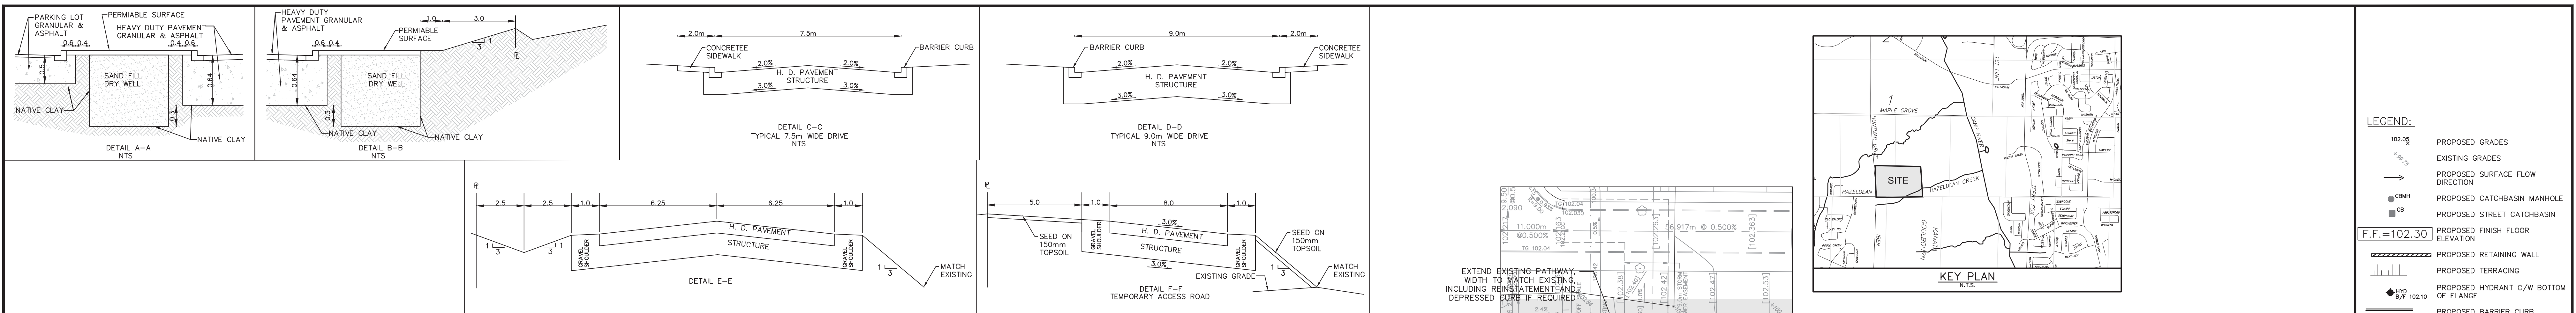

- LEGEND:**
- PROPOSED GRADES
 - EXISTING SURFACE
 - PROPOSED SURFACE FLOW DIRECTION
 - PROPOSED CATCHBASIN MANHOLE
 - PROPOSED STREET CATCHBASIN
 - PROPOSED FINISH FLOOR ELEVATION
 - PROPOSED RETAINING WALL
 - PROPOSED TERRACING
 - PROPOSED HYDRANT C/W BOTTOM OF FLANGE
 - PROPOSED BARRIER CURB
 - MAJOR STORM AND FLOW
- PAVEMENT STRUCTURE**
- HEAVY DUTY AREAS
40mm H.L.S. ASPHALT SUPERPAVE 12.5
50mm H.L.S. ASPHALT SUPERPAVE 10.0
150mm GRANULAR A
400mm GRAN B TYPE II
 - CAR PARK AREAS
50mm H.L.S. ASPHALT SUPERPAVE 12.5
150mm GRANULAR A
300mm GRAN B TYPE II
 - CONCRETE PAD
 - INFILTRATION DRY WELL
 - BORE HOLE LOCATION AND ELEVATION
SEE GEOTECHNICAL REPORT FOR DETAILS
 - CONCRETE SIDEWALK
 - AS-BUILT PICK UP

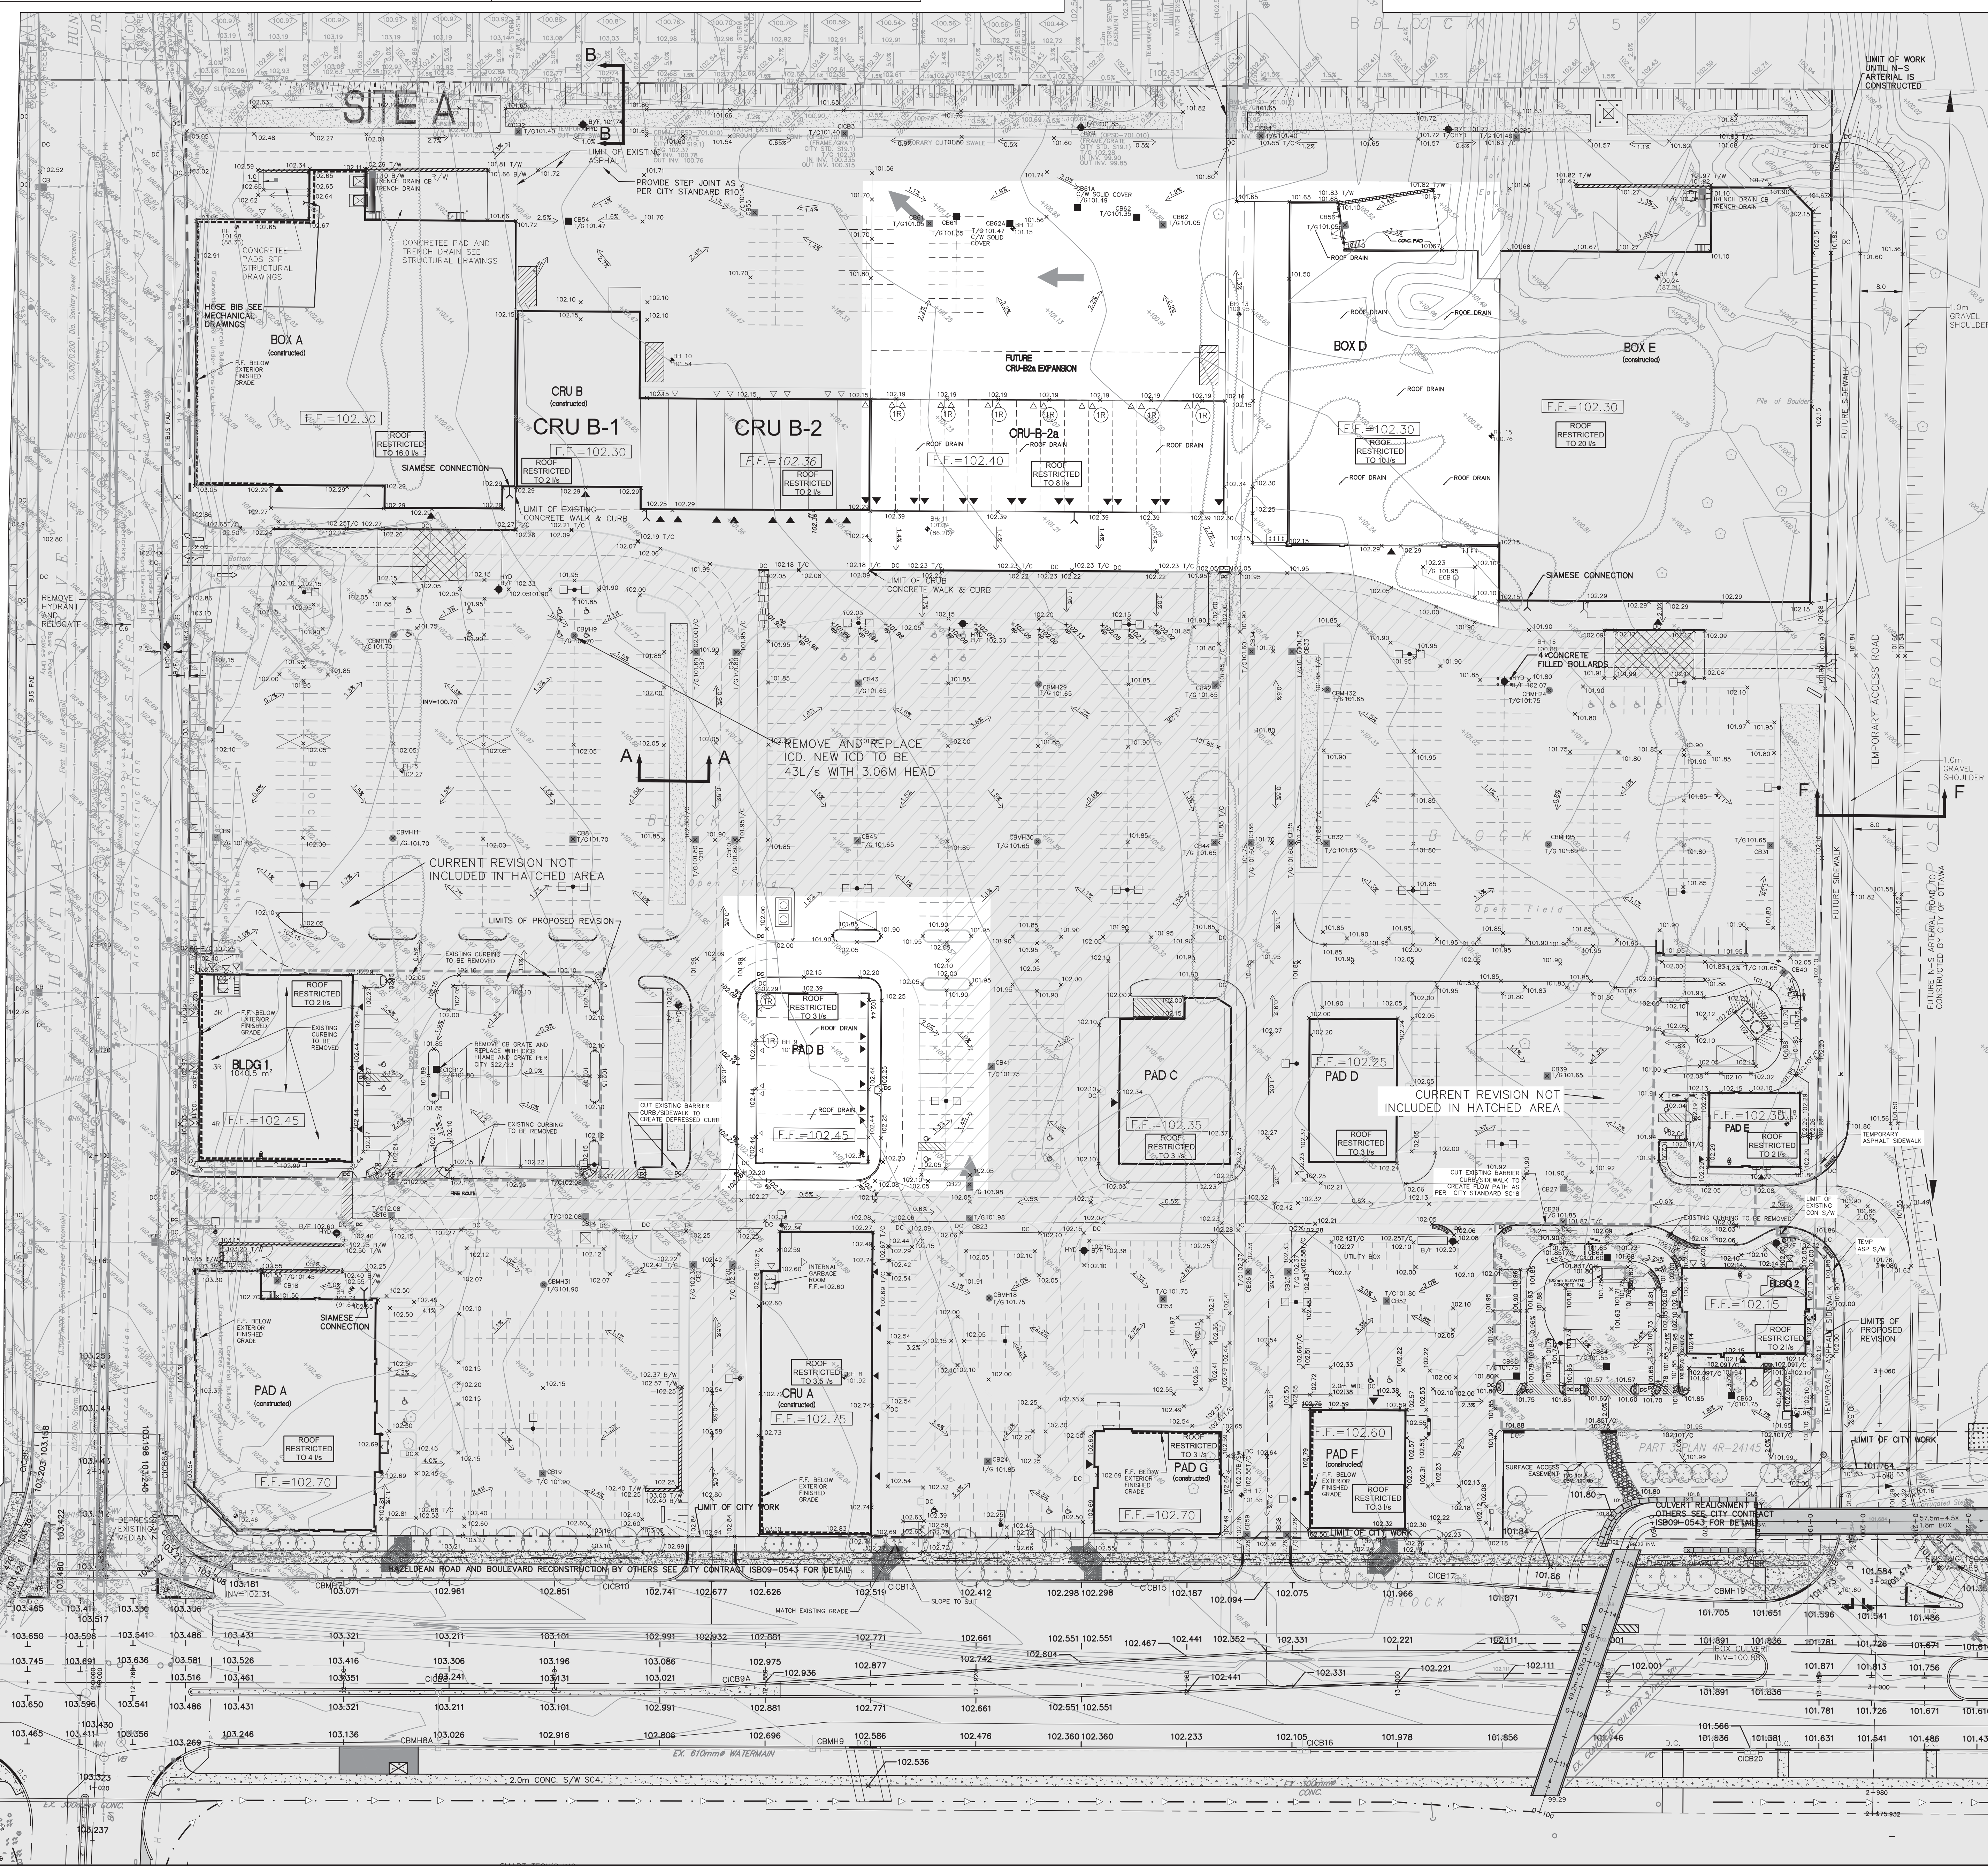


No.	REVISIONS	By	Date
30	REVISED STORAGE CELLS PER CLIENT REQUEST	DCY	20-05-15
29	REVISED AS PER CITY COMMENTS	DCY	20-04-30
28	REVISED AS PER CITY COMMENTS	DCY	20-03-27
19	REVISED AS PER CITY COMMENTS	DCY	19-12-20
27	COMMENTS	DCY	19-08-29
26	BLDG 2 & PAD E	DCY	18-08-18
25	REVISED REAR DOOR GRADES PER ARCHITECT	DCY	18-08-18
24	ISSUED FOR CONSTRUCTION BLDG 2	DCY	18-04-06
23	ISSUED FOR TENDER	DCY	18-01-15
22	REVISED AS PER CITY COMMENTS	DCY	17-11-23
21	ISSUED FOR SPA	DCY	17-09-08
20	REVISED AS PER SITE PLAN	DCY	17-07-07
19	REVISED AS PER CITY COMMENTS	DCY	17-07-07
18	REVISED BLD 2 & PAD E	DCY	17-06-23
17	REVISED AS PER CITY COMMENTS	DCY	17-02-14
16	REVISED AS PER CITY COMMENTS	DCY	16-08-05
15	SPA BLDG 1 & 2	DCY	16-03-07
14	REVISED BLDG 1 & 2	DCY	16-01-21
13	REVISED AS PER SITE PLAN	DCY	14-11-03
12	SPA	DCY	14-09-09
11	REVISED AS PER SITE PLAN	DCY	14-07-31
10	REVISED AS PER CITY COMMENTS	DCY	14-06-03
9	REVISED DOLLAR & CRUB	DCY	14-06-03
8	ISSUED FOR PAD F TENDER	DCY	13-02-14
7	REVISED FOR PAD F	DCY	12-08-11
6	REVISED FOR PAD F	DCY	12-08-11
5	REVISED SPRINKLER ROOM	DCY	12-03-09
4	BOX E PER CITY COMMENTS AND PAD E	DCY	12-02-22
3	REVISED FOR BOX E	DCY	12-01-28
2	REVISED SITE PLAN PH1 & PH2	DCY	11-11-24
1	ISSUED FOR APPROVAL	DCY	11-10-27

NORTH AMERICAN DEVELOPMENT GROUP

IBI GROUP
333 Preston Street
Tower 1, Suite 400
Ottawa, Ontario
Canada K1S 5N4
Tel (613) 225-1311
FAX (613) 225-9868

Project Title
5705 HAZELDEAN ROAD
OTTAWA, ONT.

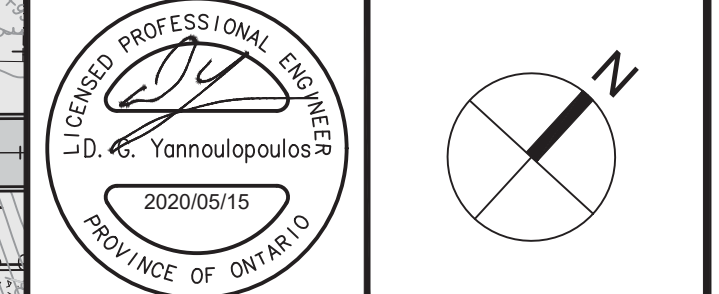

Drawing Title
GRADING PLAN
PHASE 1 & 2

Scale: 1:500

Design	D.G.Y.	Date	OCTOBER 2011
Drawn	E.H.	Checked	D.G.Y.
Project No.	10113	Drawing No.	C-202

to: IBI Group - **Mr. Ryan Magladry**- rmagladry@ibigroup.com
re: Grading Plan Review
Proposed North American Commercial Development - Phase 1 and 2
Hazeldean Road - Ottawa
date: April 8, 2019
file: PG1899-MEMO.05 Rev.01

Further to your request and authorization, Paterson Group (Paterson) reviewed the following grading plan prepared by IBI Group for the aforementioned commercial development:

- Grading Plan - Drawing No. C-202 - Project 10113 - Revision 26 dated March 29, 2019.

The present memo should be read in conjunction with our Report PG1899-2 dated May 25, 2016. Based on our permissible grade raise recommendations for the subject site, the reviewed grading plan is considered to be acceptable from a geotechnical perspective.

We trust that this information satisfies your immediate requirements.

Paterson Group Inc.



Faisal I. Abou-Seido, P.Eng.




David J. Gilbert, P.Eng.

Paterson Group Inc.





Head Office and Laboratory
154 Colonnade Road South
Ottawa - Ontario - K2E 7J5
Tel: (613) 226-7381 Fax: (613) 226-6344

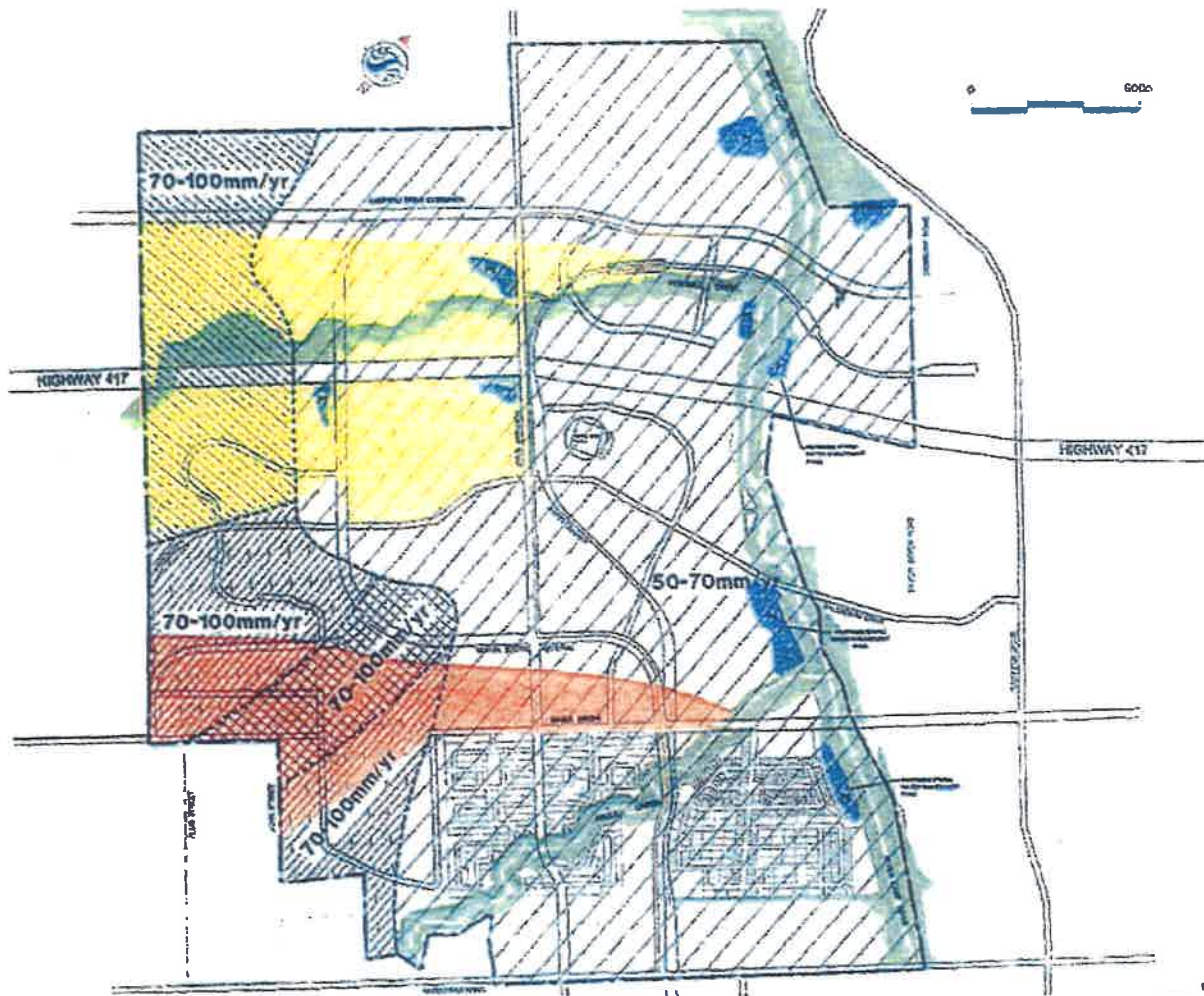Northern Office and Laboratory
63 Gibson Street
North Bay - Ontario - P1B 8Z4
Tel: (705) 472-5331 Fax: (705) 472-2334

St. Lawrence Office
993 Princess Street
Kingston - Ontario - K7L 1H3
Tel: (613) 542-7381



INFILTRATION TARGETS

SOIL TYPE	RECHARGE
	FINE SAND MODERATE
	PALEOZOIC BEDROCK MODERATE
	TILL MODERATE
	CLAY LOW

-  Kanata-West Concept Plan Boundary
-  Area Tributary To Feedmill Creek (Existing Conditions)
-  Area Tributary To Maple Grove Ditch System and Poole Creek (Existing Conditions)
-  OPEN SPACE

NOTE:
 SOIL TYPES AND RECHARGE POTENTIAL FROM CARP RIVER WATERSHED/SUBWATERSHED STUDY BY ROBINSON CONSULTANTS INC. 2004.
 TARGET INFILTRATION RATES OBTAINED FROM ENVIRONMENTAL FACT SHEETS FROM 2004 REPORT.



CCCL/IBI

MAY 2006

FIG. 5.4

Demetrius Yannoulopoulos

From: Doug Nuttall <dnuttall@mvc.on.ca>
Sent: Friday, June 22, 2012 9:10 AM
To: Demetrius Yannoulopoulos
Cc: sean.moore@ottawa.ca
Subject: RE: Infiltration augmentation

Sorry about the delay;

MVC is satisfied with this approach. It is reasonable to expect that there will be sufficient infiltration from this facility to supplement the infiltration that will come from the sand beds and irrigation. It would be very interesting to monitor the water flowing into and out of such a facility, and I would ask the consultant, on behalf of the client, if MVC would be able to install monitoring in MH 35? Ideally, we should be monitoring flows in and out of the facility – thus it would be easier for us if the outlet was directed to CBMH 29, rather than directly to the pipe. There should be lots of grade to make that work.

Douglas Nuttall, P.Eng.
Water Resources Engineer
Mississippi Valley Conservation

From: Demetrius Yannoulopoulos
Sent: Tuesday, June 19, 2012 10:03 AM
To: 'Doug Nuttall'
Subject:

Hi Doug

As discussed yesterday, we propose to add a drywell in front of Box C, within in the parking lot area. The drywell will be a clear stone facility 4m wide by 40m long, and 0.73m clear depth from bottom of perforated pipe. The drywell has a total volume of 116.6m³, with 30% voids in the clear stone there is 35m³ of storage available. Rainfall from the 5992 m² roof of Box C will supply the drywell, the roof of Box C has flow restrictors limiting the outflow to 25l/s. The dry well is set up such that if the volume of runoff from the roof exceeds the storage capacity of the dry well excess runoff is discharged to the storm sewer, see attached PDF illustrating the proposed drywell.

Rainfall data (see attached) indicates for the months of March up to and including November, 40 days of 5mm or more rain occurred, and for the same period 22 days of 10mm or more rain occurred. Assuming 80% of rainfall is collected by the roof drains the following volume of rainfall is collected and discharged into the drywell:

5mm, at 80% = 4mm, for 5992m² roof = 23.96m³, for 40 events = 958.72m³

10mm, at 80%= 8mm (less 4mm from above) = 4mm for 5992m² roof = 23.96m³, for 22 events = 527.29m³

These events provide a approximately of 1486m³ of rainfall for use by the drywell.

For the 84,600m² site, this will add approximately 17.56mm/yr of infiltration.

As we had previously discussed the sand well will provide approximately 20mm/yr of infiltration with natural rainfall, and the irrigation system will also supplement with an additional 20mm/yr.

Combining these three the site will have approximately 57mm/yr of infiltration which falls within the 50 to 70mm/yr target for this area.

As you are aware the City is asking us to provide CA acceptance of the infiltration approach. If you are in agreement with the above, it would be greatly appreciated if you could forward me an email indicating MVCA acceptance of the infiltration approach.

If you have any questions, please call or email.

Thx

Demetrius

Demetrius Yannoulopoulos P.Eng.
Associate Director

IBI Group
400-333 Preston Street
Ottawa ON K1S 5N4 Canada

tel 613 225 1311 ext 590

fax 613 225 9868

cell 613 447 0504

email dyannoulopoulos@IBIGroup.com

web www.ibigroup.com

NOTE: This e-mail message and attachments may contain privileged and confidential information. If you have received this message in error, please immediately notify the sender and delete this e-mail message.

NOTE: Ce courriel peut contenir de l'information privilégiée et confidentielle. Si vous avez reçu ce message par erreur, veuillez le mentionner immédiatement à l'expéditeur et effacer ce courriel.