


**NOTES:**

1. PROVIDE AND INSTALL PUMP CONTROL PANEL, FLOW LEVEL SWITCH AND SET ALARM LEVELS AS INDICATED.
2. SET OFF SWITCH TO ALLOW PUMP SUCTION TO REMAIN UNDER WATER AT ALL TIMES OR PUMP MAY BECOME AIR-LOCKED.
3. SET ON SWITCH TO ALLOW PUMP TO OPERATE A MINIMUM OF 2 MINUTES PER CYCLE.
4. PUMP MAXIMUM DISCHARGE RATE TO STORM MAIN SHALL BE RESTRICTED BY FLOW CONTROL DEVICE AND NOT EXCEED LIMIT DEFINED BY CIVIL ENGINEERING.
5. BUILDING BAS SHALL MONITOR PUMP OPERATION AND ALL ALARM LEVELS. REFER TO SEQUENCE OF OPERATION OF BAS SYSTEM FOR DETAIL.
6. REFER TO ARCHITECTURAL DRAWINGS FOR STORM CISTERN CONSTRUCTION. MINIMUM SIZE: 57.4 SQ.M.

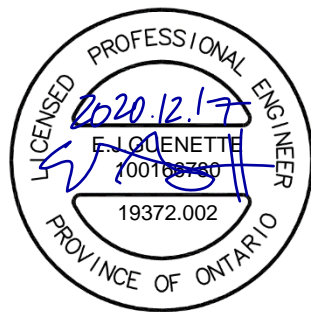

PROJECT NAME: 473 Albert Building Refurbishment			ISSUED FOR: SPA
DRAWING TITLE: PART PLAN OF Cistern Detail			DRAWING NO: MSK-01
DATE: 2020-12-11	PROJECT NO: 19372.002	SCALE: NTS	PART OF DWG:- REVISION No.: R1