

# 593 LAURIER AVENUE WEST

OTTAWA, ON

**PEDESTRIAN WIND ASSESSMENT**

PROJECT #1903548

JULY 9, 2020



## **SUBMITTED TO**

**Denis Michaud**

Chief Executive Officer

[denis@henryinvestments.ca](mailto:denis@henryinvestments.ca)

**Henry Investments**

Ottawa, ON

T: 613.816.8886

M: 613.402.2855

## **SUBMITTED BY**

**Saba Saneinejad, Ph.D.**

Senior Technical Coordinator / Associate Principal

[Saba.Saneinejad@rwdi.com](mailto:Saba.Saneinejad@rwdi.com)

**John Alberico, M.Sc., CCEP, WELL AP**

Senior Project Manager / Principal

[John.Alberico@rwdi.com](mailto:John.Alberico@rwdi.com)

## **RWDI**

600 Southgate Drive

Guelph, ON N1G 4P6

T: 519.823.1311

F: 519.823.1316

# 1. INTRODUCTION



Rowan Williams Davies & Irwin Inc. (RWDI) was retained by Henry Investments to assess the pedestrian wind conditions for the proposed development at 593 Laurier Ave. W. in Ottawa, ON (see Image 1).

This Preliminary Wind Analysis was completed in support of the Site Plan Approval application for the City of Ottawa as required under the City's Terms of Reference - Wind Analysis. The assessment was based on the following:

- a review of regional long-term meteorological data for Ottawa;
- design drawings received from Henry Investments on July 2, 2020;
- wind-tunnel studies undertaken by RWDI for similar projects in the Ottawa Area;
- our engineering judgement and knowledge of wind flows around buildings<sup>1-3</sup>; and
- use of 3D software developed by RWDI (Windestimator<sup>2</sup>) for estimating the potential wind conditions around generalized building forms.

This approach provides an estimation of potential wind conditions. Conceptual wind control measures to improve wind comfort are recommended, where necessary. To quantify these conditions or refine any conceptual mitigation measures, physical scale-model tests in a boundary-layer wind tunnel would be required.

Note that other wind issues such as those related to wind loads, door operability, air quality, snow drifting, etc., are not considered in the scope of this assessment.

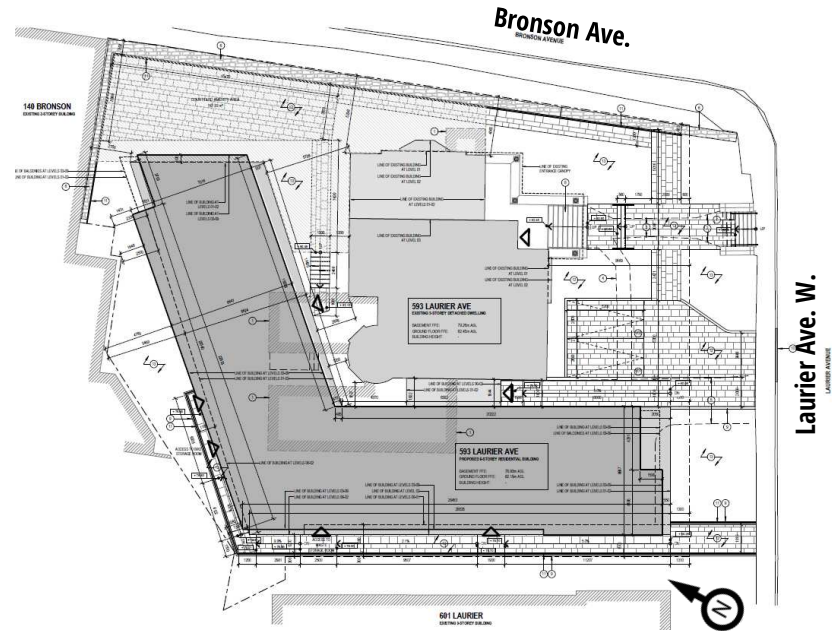


Image 1: Site Plan

1. H. Wu and F. Kriksic (2012). "Designing for Pedestrian Comfort in Response to Local Climate", *Journal of Wind Engineering and Industrial Aerodynamics*, vol.104-106, pp.397-407.
2. H. Wu, C.J. Williams, H.A. Baker and W.F. Waechter (2004), "Knowledge-based Desk-Top Analysis of Pedestrian Wind Conditions", *ASCE Structure Congress 2004*, Nashville, Tennessee.
3. C.J. Williams, H. Wu, W.F. Waechter and H.A. Baker (1999), "Experience with Remedial Solutions to Control Pedestrian Wind Problems", *10th International Conference on Wind Engineering*, Copenhagen, Denmark.

## 2. BUILDING AND SITE INFORMATION



The proposed development is located at the northwest corner of the intersection of Laurier Ave. W. and Bronson Ave. in Ottawa, ON (see Image 2). The site is currently occupied by a 3-storey detached house, most of which will remain on site, while smaller portion to the north and west will be demolished.

The site is generally surrounded by high-rise buildings to the north through east through southeast, and by a mixture of low to mid-rise buildings and grassed lands in other directions (see Image 2). The Ottawa River is located approximately 700 m to

the north and Downtown Ottawa is located approximately 1 km to the northeast.

The proposed development consists of addition of a new 9-storey building to the west and north of the existing 3-storey building on site (see Images 1 and 3).

Public pedestrian areas on and around the development include the building entrances, sidewalks, and a terrace at the roof level.



Image 2: Aerial View of the Existing Site and its Surrounding  
(Courtesy of Google™ earth)



Image 3: 3D Rendering of the Proposed Development (View from Southeast)

### 3. METEOROLOGICAL DATA




Meteorological data from the Ottawa Macdonald-Cartier International Airport for the period from 1985 to 2015 were used as a reference for wind conditions in the area. Wind data from other stations in the Ottawa area were also reviewed and it was deemed that the data set from the airport were most applicable.

This airport is located approximately 11 km to the south of the project site. Local wind speeds and directions are affected by the nearby Ottawa River because there is the potential for winds to accelerate along the river valley, resulting in increased wind activity on site. This exposure is taken into account in the subsequent pedestrian wind analysis.

The distributions of wind frequency and directionality for four seasons are shown in Image 4. When all winds are considered, winds from the west-northwest, east-northeast and southwest directions are predominant for all seasons.

Strong winds of a mean speed greater than 30 km/h measured at the airport (red and yellow bands) occur most often in the winter and least often in the summer. Strong winds from the west-northwest and east-northeast are prevalent throughout the year. Winds from these directions potentially could be the source of uncomfortable or even unsafe wind conditions, depending upon the site exposure or development design.

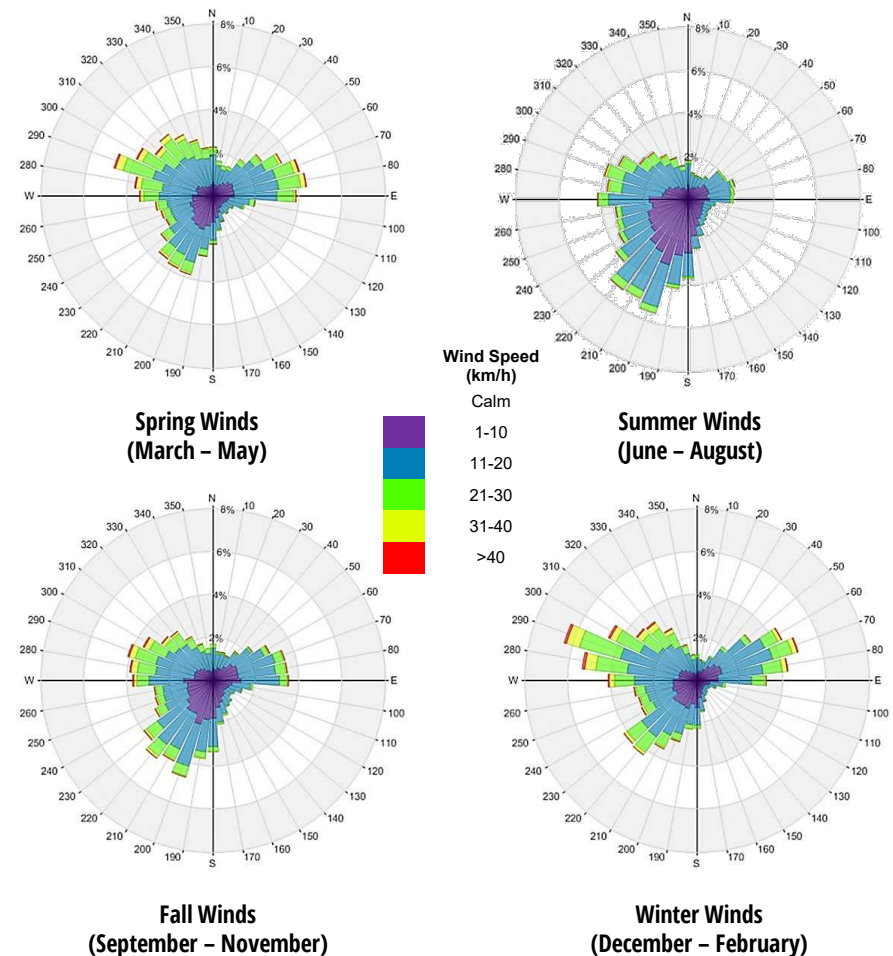

**Image 4: Directional Distribution of Winds Recorded at Ottawa Macdonald-Cartier International Airport (1985 to 2015)**

## 4. PEDESTRIAN WIND CRITERIA



The RWDI pedestrian wind criteria are used in the current study. These criteria have been developed by RWDI through research and consulting practice since 1974. They have also been widely accepted by municipal authorities, building designers and city planning communities including the City of Ottawa. The criteria are as follows:

### Pedestrian Safety

Pedestrian safety is associated with excessive gust wind speeds that can adversely affect a pedestrian's balance and footing. If strong winds that can affect a person's balance (**90 km/h**) occur more than 0.1% of the time or 9 hours per year, the wind conditions are considered severe.

### Pedestrian Comfort

Wind comfort can be categorized by typical pedestrian activities:

**Sitting ( $\leq 10$  km/h):** Calm or light breezes desired for outdoor seating areas where one can read a paper without having it blown away.

**Standing ( $\leq 14$  km/h):** Gentle breezes suitable for main building entrances and bus stops.

**Strolling ( $\leq 17$  km/h):** Moderate winds that would be appropriate for window shopping and strolling along a downtown street, plaza or park.

**Walking ( $\leq 20$  km/h):** Relatively high speeds that can be tolerated if one's objective is to walk, run or cycle without lingering.

**Uncomfortable:** None of the comfort categories are met.

Wind conditions are considered suitable for sitting, standing or walking if the associated mean wind speeds are expected for at least four out of five days (80% of the time). Wind control measures are typically required at locations where winds are rated as uncomfortable or they exceed the wind safety criterion.

Note that these wind speeds are assessed at the pedestrian height (i.e., 1.5 m above grade or the concerned floor level), typically lower than those recorded in the airport (10 m height and open terrain).

These criteria for wind forces represent average wind tolerance. They are sometimes subjective and regional differences in wind climate and thermal conditions as well as variations in age, health, clothing, etc. can also affect people's perception of the wind climate.

For the proposed development, wind speeds comfortable for strolling or walking are appropriate for sidewalks; wind speeds comfortable for standing are required for building entrances, where pedestrians may linger; and lower wind speeds comfortable for sitting are desired for outdoor amenity area in the summer when these areas will be used most often.




## 5. PEDESTRIAN WIND CONDITIONS



### 5.1 Background

Predicting wind speeds and occurrence frequencies is complicated. It involves building geometry, orientation, position and height of surrounding buildings, upstream terrain and the local wind climate. Over the years, RWDI has conducted thousands of wind-tunnel model studies regarding pedestrian wind conditions around buildings, yielding a broad knowledge base. This knowledge has been incorporated into RWDI's proprietary software that allows, in many situations, for a qualitative, screening-level numerical estimation of pedestrian wind conditions without wind tunnel testing.

The proposed building is taller than its immediate surroundings in the direction of the prevailing northwesterly, southwesterly and northeasterly winds and therefore is exposed to those winds. In such a case, buildings tend to intercept the stronger winds at higher elevations and redirect them to the ground level. Such a downwashing flow (see Image 5a) is the main cause for increased wind activity around tall buildings at the grade level. When oblique winds are deflected down by a building, a localized increase in the wind activity can be expected around the exposed building corner at pedestrian level (see Image 5b). If these building/wind combinations occur for prevailing winds, there is a greater potential for increased wind activity. Detailed discussions on the potential wind comfort conditions at key pedestrian areas are provided in the Sections 5.2 to 5.4.

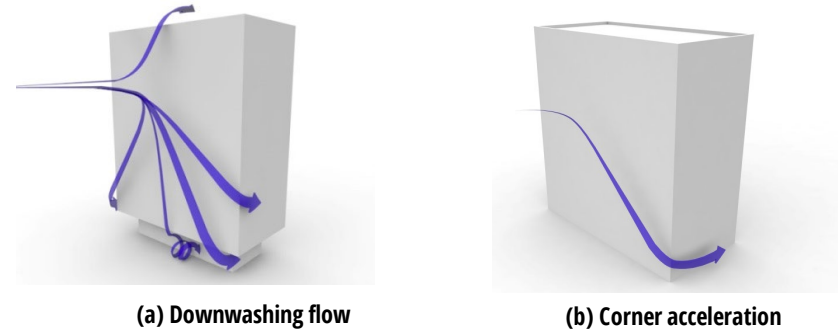

**Image 5: Typical Wind Flows Around Taller Buildings**

## 5. PEDESTRIAN WIND CONDITIONS



### 5.2 Sidewalks

The tall and dense buildings to the east of the site (as seen in Image 2) are expected to provide protection at the site from strong easterly and northeasterly winds. The proposed development has a large setback at grade from the sidewalks of Laurier Ave. W., which will help to reduce wind accelerations along the sidewalks of Laurier Ave. W. Wind conditions along the sidewalks of Laurier Ave. W. expected to be comfortable for standing or strolling throughout the year, which are considered appropriate for the pedestrians using the sidewalks.

The sidewalks along Bronson Ave. are generally protected from the prevailing northwesterly winds by the building massing itself. Wind conditions are predicted to be suitable for standing or strolling throughout the year. However, acceleration of the northwesterly and northeasterly winds down the north and east facades of the building and around the northeast building corner could result in a region with slightly high wind speeds in this area. Even with these higher winds, conditions are predicted to be comfortable for walking at the sidewalks of Bronson Ave. close to the northeast corner of the building, during the windier spring and winter seasons. These conditions are considered appropriate for sidewalks.

### 5.3 Entrances

The main entrances are located along the south (marked as A1 and A2 in Image 6). Other side entrances are marked as A3 through A5 in Image 6.

Entrances A1 and A2 are recessed and located on the south side of the building so they are well protected from the prevailing northwesterly winds by the new building itself. Wind conditions suitable for standing are predicted at these two entrances throughout the year, which are appropriate for main entrances.

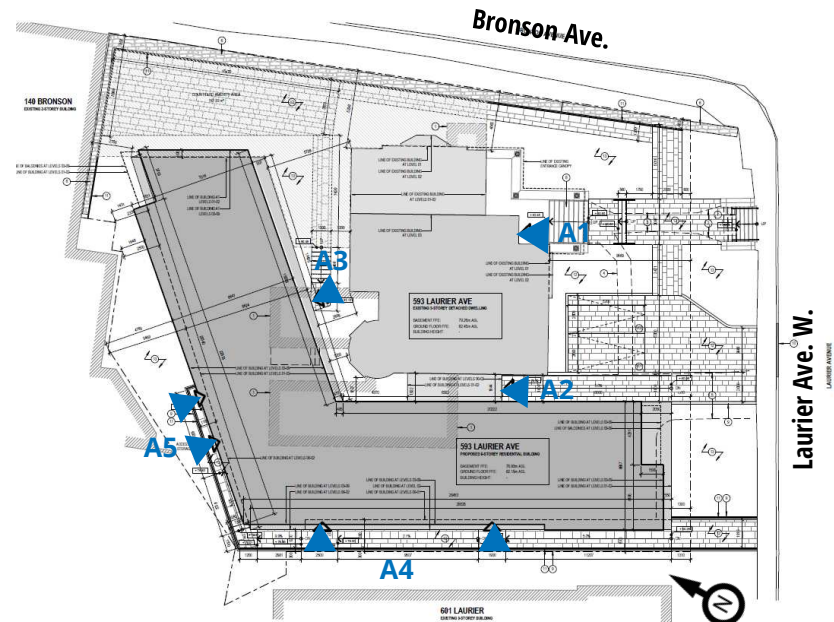


Image 6: Site Plan Showing the Building Entrances

## 5. PEDESTRIAN WIND CONDITIONS



### 5.3 Entrances (continued)

Calm and acceptable wind conditions are predicted at entrance A3 as it is located in a wind protected area.

Slightly higher wind speeds are expected at entrances A4 and A5 due to their exposure to the prevailing westerly winds. Wind conditions are predicted to be comfortable for standing during the summer and fall, and strolling during the spring and winter. If these two entrances are not frequently used, the predicted conditions are considered appropriate. However, if these entrances are to be used frequently, the wind conditions in the spring and winter can be improved by recessing the entrances into the façades, or installing windscreens on the both sides of the entrances with canopies overhead. Examples of these wind mitigation measures are shown in Image 7.



**Image 7: Examples of Wind Control Features for Entrances A4 and A5**



# 5. PEDESTRIAN WIND CONDITIONS



## 5.4 Rooftop Terraces

The rooftop terraces (see Image 8) are exposed to the easterly, westerly and southwesterly winds. Wind speeds at the terraces are expected to be comfortable for standing or strolling during the summer when the area will be used most often. These wind conditions are considered higher than desired for terraces.

Lower wind speeds on the terrace can be achieved by installing tall guardrails around the perimeters that are at least 2m tall. Additionally, hard or soft landscaping elements such as planters and trellises can be placed around or over sitting areas, respectively, to provide localized wind protection. Examples of these wind mitigation measures are shown in Image 9.



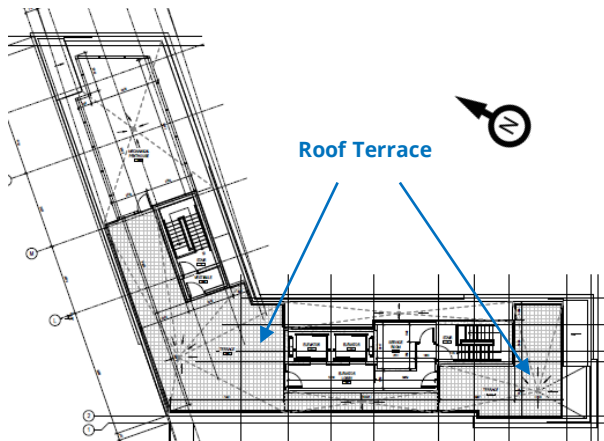


Image 8: Roof Plan

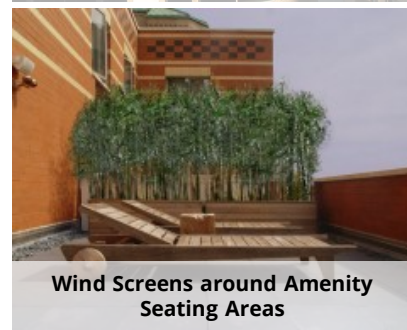

Wind Screens / Guardrails around Rooftop Terraces

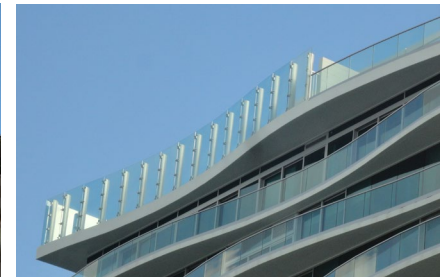

Wind Screens around Amenity Seating Areas



Trellis above Seating Areas

Image 9: Examples of Wind Control Features for the Outdoor Rooftop Terraces

## 6. SUMMARY

RWDI completed a Preliminary Wind Analysis for the proposed 593 Laurier Ave. W. development in Ottawa, ON in support of the SPA submission.

The wind assessment was based on the local wind climate, surrounding buildings, our past experience with wind tunnel testing of similar buildings, and screening-level 3D modelling of wind flows around the development.

The proposed development includes several positive design features such as setback at the grade from Laurier Ave. W. and the recessed main entrances. Wind conditions are expected to be suitable for the intended usage along the sidewalks and at the two main entrances and the side entrance along the south side of the east wing of the tower throughout the year.

Higher winds are predicted at the side entrances along the north and west sides of the new tower during the spring and winter, and at the rooftop terraces during the summer.

Conceptual wind mitigation measures to improve wind conditions at the two side entrances, and the rooftop terraces are discussed, and photograph examples are provided for reference.

## 7. APPLICABILITY OF RESULTS



In the event of any significant changes to the design, construction or operation of the building or addition of surroundings in the future, RWDI could provide an assessment of their impact on the pedestrian wind conditions discussed in this report. It is the responsibility of others to contact RWDI to initiate this process.