

Geotechnical  
Engineering

Environmental  
Engineering

Hydrogeology

Geological  
Engineering

Materials Testing

Building Science

Archaeological Services

**Geotechnical Investigation**  
Proposed Multi-Storey Building  
1050 & 1060 Bank Street  
Ottawa, Ontario

Prepared For

Beaumont & Fine Investments

**Paterson Group Inc.**

Consulting Engineers  
154 Colonnade Road South  
Ottawa (Nepean), Ontario  
Canada K2E 7J5

Tel: (613) 226-7381  
Fax: (613) 226-6344  
[www.patersongroup.ca](http://www.patersongroup.ca)

April 8, 2020

Report PG4506-1  
Revision 1

## Table of Contents

	<b>Page</b>
<b>1.0 Introduction</b> .....	<b>1</b>
<b>2.0 Proposed Development</b> .....	<b>1</b>
<b>3.0 Method of Investigation</b>	
3.1 Field Investigation .....	2
3.2 Field Survey .....	3
3.3 Laboratory Testing .....	3
3.4 Analytical Testing .....	3
<b>4.0 Observations</b>	
4.1 Surface Conditions .....	4
4.2 Subsurface Profile .....	4
4.3 Groundwater .....	4
<b>5.0 Discussion</b>	
5.1 Geotechnical Assessment .....	6
5.2 Site Grading and Preparation .....	6
5.3 Foundation Design .....	7
5.4 Design for Earthquakes .....	8
5.5 Basement Slab Construction .....	8
5.6 Basement Wall .....	8
5.7 Pavement Structure .....	10
<b>6.0 Design and Construction Precautions</b>	
6.1 Foundation Drainage and Backfill .....	11
6.2 Protection of Footings Against Frost Action .....	11
6.3 Excavation Side Slopes .....	12
6.4 Pipe Bedding and Backfill .....	14
6.5 Groundwater Control .....	14
6.6 Winter Construction .....	15
6.7 Corrosion Potential and Sulphate .....	15
<b>7.0 Recommendations</b> .....	<b>16</b>
<b>8.0 Statement of Limitations</b> .....	<b>17</b>

## **Appendices**

**Appendix 1**      Soil Profile and Test Data Sheets  
                         Symbols and Terms  
                         Analytical Testing Results

**Appendix 2**      Figure 1 - Key Plan  
                         Drawing PG4506-1R1 - Test Hole Location Plan

## 1.0 Introduction

Paterson Group (Paterson) was commissioned by Beaumont & Fine Investments to undertake a geotechnical investigation for a proposed multi-storey building to be located at 1050 & 1060 Bank Street in the City of Ottawa, Ontario (refer to Figure 1 - Key Plan in Appendix 2).

The objectives of the current investigation were to:

- ❑ Determine the subsurface soil and groundwater conditions by means of boreholes.
- ❑ Provide geotechnical recommendations for the design of the proposed building including construction considerations which may affect the design.

The following report has been prepared specifically and solely for the aforementioned project which is described herein. This report contains the findings and recommendations pertaining to the design and construction of the subject development as understood at the time of writing this report.

Investigating the presence or potential presence of contamination on the subject property was not part of the scope of work for this geotechnical investigation.

## 2.0 Proposed Development

It is understood that the proposed development will consist of a multi-story, mixed-use building with one level of underground parking. Further, the proposed development will have sidewalks surrounding the proposed building to the north, east, and south, and an asphalt-paved access lane at the rear of the building to the west.

## **3.0 Method of Investigation**

### **3.1 Field Investigation**

#### **Field Program**

The field program for the current investigation was carried out from May 1 to 4, 2018 and from December 2 to 4, 2019. A total of 10 boreholes were drilled to a maximum depth of 15.2 m below the existing ground surface. The test hole locations were selected in a manner to provide general coverage of the subject site.

The boreholes were advanced with a truck-mounted auger drill rig operated by a two-person crew. All fieldwork was conducted under the full-time supervision of Paterson personnel under the direction of a senior engineer. The drilling procedure consisted of augering to the required depths at the selected locations, sampling and testing the overburden.

The borehole locations are presented on Drawing PG4506-1R1- Test Hole Location Plan appended to this report.

#### **Sampling and In Situ Testing**

Soil samples were recovered with a 50 mm diameter split-spoon sampler or from the auger flights. The split-spoon and auger samples were classified on site, placed in sealed plastic bags, and transported to the laboratory for further review. The depths at which the split-spoon and auger samples were recovered from the boreholes are shown as SS and AU, respectively, on the Soil Profile and Test Data sheets in Appendix 1.

The Standard Penetration Test (SPT) was conducted in conjunction with the recovery of the split-spoon samples. The SPT results are recorded as “N” values on the Soil Profile and Test Data sheets and is the number of blows required to drive the split-spoon sampler 300 mm into the soil after a 150 mm initial penetration using a 63.5 kg hammer falling from a height of 760 mm.

Subsurface conditions observed in the test holes were recorded in detail in the field. Reference should be made to the Soil Profile and Test Data sheets presented in Appendix 1 for specific details of the soil profile encountered at the test hole locations.

## **Groundwater**

Monitoring wells, consisting of 50 mm diameter rigid PVC standpipes, were installed in select boreholes to permit monitoring of the groundwater levels subsequent to the completion of the current field program.

## **Sample Storage**

All samples will be stored in the laboratory for a period of one month after issuance of this report unless we are otherwise directed.

## **3.2 Field Survey**

The test hole locations for the current geotechnical investigation were selected, determined in the field and surveyed by Paterson personnel. The ground surface elevation at each borehole location was referenced to a temporary benchmark (TBM), consisting of the top spindle of a fire hydrant located at the northwest corner of the subject site with a geodetic elevation of 73.22 m.

The ground surface elevation and location of each borehole, as well as the location of the TBM is presented on the attached Drawing PG4506-1R1 - Test Hole Location Plan.

## **3.3 Laboratory Testing**

Soil samples recovered from the subject site were visually examined in our laboratory to review the results of the field logging.

## **3.4 Analytical Testing**

One (1) soil sample was submitted for analytical testing to assess the corrosion potential for exposed ferrous metals and the potential of sulphate attacks against subsurface concrete structures. The sample was submitted to determine the concentration of sulphate and chloride, the resistivity and the pH of the sample. The results are presented in Appendix 1 and are discussed further in Subsection 6.7.

## **4.0 Observations**

### **4.1 Surface Conditions**

The subject site is consists of 2 contiguous properties, 1050 and 1060 Bank Street. The property at 1050 Bank Street is currently occupied by a 1 storey commercial building which occupies the western half of the site. The remainder of the site consists of an asphalt surfaced parking lot with landscaped margins.

The property at 1060 Bank Street consists of a single storey commercial building which occupies the central portion of the western half of the property. The remainder of the site consists of an asphalt surfaced parking lot with landscaped margins.

The site is bordered to the north by Aylmer Avenue, to the east by Bank Street, to the south by Euclid Avenue and to the west by existing residential properties. The ground surface across the site is relatively level.

### **4.2 Subsurface Profile**

The subsurface profile at the borehole locations consists of a pavement structure underlain by a fill layer to approximately 0.4 to 2.6 m depth. The fill was generally observed to consist of a loose, brown sand with some silt, gravel, and asphalt.

The fill was underlain by a compact to very dense silty sand deposit across the subject site. The silty sand deposit was interbedded with compact to very dense sandy silt layers within the southern half of the subject site. The interbedded silty sand to sandy silt deposit extended to the bottom of all boreholes at a maximum depth of 15.2 m, with the exception of boreholes BH 3-19 and BH 7-19 which were terminated in a very dense gravel with sand deposit at depths of 14.9 m and 14.3 m respectively. Specific details of the soil profile at each test hole location are presented on the Soil Profile and Test Data sheets in Appendix 1.

Based on available geological mapping, the subject site is located in an area where the bedrock consists of interbedded limestone and shale of the Verulam formation.

### **4.3 Groundwater**

Groundwater levels were measured in the monitoring wells installed in the boreholes upon completion of the sampling program. The groundwater level readings at each borehole location are presented in Table 1.

<b>Table 1 - Summary of Groundwater Level Readings</b>				
<b>Borehole Number</b>	<b>Ground Elevation (m)</b>	<b>Groundwater Levels</b>		<b>Recording Date</b>
		<b>Depth (m)</b>	<b>Elevation (m)</b>	
BH 1	71.50	11.39	60.11	May 15, 2018
BH 2	71.55	11.75	59.80	May 15, 2018
BH 3	71.50	11.73	59.77	May 15, 2018
BH 1-19	71.57	12.26	59.31	December 11, 2019
BH 2-19	71.48	12.27	59.21	December 11, 2019
BH 3-19	71.46	12.30	59.16	December 11, 2019
BH 6-19	71.62	12.32	59.30	December 11, 2019

**Note:** Ground surface elevations at borehole locations were referenced to a TBM, consisting of the top spindle of a fire hydrant located at the northwest corner of the subject property, with a geodetic elevation of 73.22 m.

Based on these observations, it is estimated that the long-term groundwater table can be expected at approximately 11 to 12 m depth. However, it should be noted that groundwater levels are subject to seasonal fluctuations. Therefore, the groundwater level could vary at the time of construction.



## **5.0 Discussion**

### **5.1 Geotechnical Assessment**

From a geotechnical perspective, the subject site is considered satisfactory for the proposed development. It is anticipated that the proposed building will be founded on conventional spread footings placed on a bearing surface consisting of undisturbed, compact to dense silty sand or sandy silt.

The above and other considerations are further discussed in the following sections.

### **5.2 Site Grading and Preparation**

#### **Stripping Depth**

Asphalt, topsoil and deleterious fill, such as those containing organic materials, should be stripped from within the building footprint, paved areas, pipe bedding and other settlement sensitive structures.

It is anticipated that the existing fill layer, free of deleterious material and significant amounts of organics, can be left in place below the proposed paved access lanes. However, it is recommended that the existing fill layer be proof-rolled using heavy vibratory equipment and approved by the geotechnical consultant at the time of construction. Any poor performing areas noted during the proof-rolling operation should be removed and replaced with approved granular fill, such as Granular A or B Type II material.

Existing foundation walls and other construction debris should be entirely removed from within the building perimeter.

#### **Fill Placement**

Fill placed for grading beneath the building area should consist, unless otherwise specified, of clean imported granular fill, such as Ontario Provincial Standard Specifications (OPSS) Granular A or Granular B Type II. The fill material should be tested and approved prior to delivery to the site. The fill should be placed in maximum 300 mm thick lifts and compacted to 98% of the material's standard Proctor maximum dry density (SPMDD).

Non-specified existing fill along with site-excavated soil can be used as general landscaping fill where settlement of the ground surface is of minor concern. These materials should be spread in thin lifts and at least compacted by the tracks of the spreading equipment to minimize voids. If these materials are to be used to build up the subgrade level for areas to be paved, they should be compacted in thin lifts to a minimum density of 95% of their respective SPMDD. Non-specified existing fill and site excavated soils are not suitable for use as backfill against foundation walls or below settlement sensitive structures, such as concrete sidewalks and exterior concrete entrance areas.

## **5.3 Foundation Design**

### **Conventional Shallow Footings**

Footings placed on an undisturbed, compact to dense silty sand or sandy silt bearing surface can be designed using a bearing resistance value at serviceability limit states (SLS) of **250 kPa** and a factored bearing resistance value at ultimate limit states (ULS) of **400 kPa**. A geotechnical resistance factor of 0.5 was applied to the reported bearing resistance value at ULS. Proof rolling should be carried out for any soils at footing level which are noted to be in a loose state. Any soft or loose areas noted during proof rolling should be removed and replaced with an engineered fill pad. Footings placed over an engineered fill pad can be designed using the abovenoted bearing resistance values.

Footings designed using the above-noted bearing resistance values at SLS will be subjected to potential post-construction total and differential settlements of 25 and 20 mm, respectively.

An undisturbed soil bearing surface consists of one from which all topsoil and deleterious materials, such as loose, frozen or disturbed soil, whether in situ or not, have been removed, in the dry, prior to the placement of concrete for footings.

### **Lateral Support**

The bearing medium under footing-supported structures is required to be provided with adequate lateral support with respect to excavations and different foundation levels. Adequate lateral support is provided to a compact sand and engineered fill bearing medium above the water table when a plane extending down and out from the bottom edge of the footing at a minimum of 1.5H:1V passes only through in-situ soil or engineered fill of the same or higher capacity as the soil.

## 5.4 Design for Earthquakes

The site class for seismic site response can be taken as **Class D**. If a higher seismic site class is required (Class C), a site specific shear wave velocity test may be completed to accurately determine the applicable seismic site classification for foundation design of the proposed building, as presented in Table 4.1.8.4.A of the Ontario Building Code (OBC) 2012.

Due to the relative density of the sand and the depth of the long term groundwater level, soils underlying the site are not susceptible to liquefaction. Reference should be made to the latest revision of the OBC 2012 for a full discussion of the earthquake design requirements.

## 5.5 Basement Slab Construction

With the removal of all topsoil and/or fill, containing significant amounts of organic or deleterious materials within the footprint of the proposed buildings, the native soil will be considered to be an acceptable subgrade surface on which to commence backfilling for floor slab construction.

Any soft areas should be removed and backfilled with appropriate backfill material. OPSS Granular B Type II is recommended for backfilling below the floor slab. All backfill materials within the footprint of the proposed building should be placed in maximum 300 mm loose lifts and compacted to at least 98% of the material's SPMDD.

It is also recommended that the upper 200 mm of sub-floor fill consist of 19 mm clear crushed stone below the basement floor slab.

Where the garage level will consist of a flexible asphaltic pavement structure, refer to the recommendations stipulated in Subsection 5.7 of this report.

## 5.6 Basement Wall

There are several combinations of backfill materials and retained soils that could be applicable for the basement walls of the subject structure. However, the conditions can be well-represented by assuming the retained soil consists of a material with an angle of internal friction of 30 degrees and a dry unit weight of  $20 \text{ kN/m}^3$ . The applicable effective unit weight of the retained soil can be estimated as  $13 \text{ kN/m}^3$ , where applicable. A hydrostatic pressure should be added to the total static earth pressure when calculating the effective unit weight.

## Lateral Earth Pressures

The static horizontal earth pressure ( $P_o$ ) can be calculated by a triangular earth pressure distribution equal to  $K_o \cdot \gamma \cdot H$  where:

$K_o$  = at-rest earth pressure coefficient of the applicable retained soil, 0.5

$\gamma$  = unit weight of fill of the applicable retained soil ( $\text{kN/m}^3$ )

$H$  = height of the wall (m)

An additional pressure having a magnitude equal to  $K_o \cdot q$  and acting on the entire wall height should be incorporated into the diagram for any surcharge loading,  $q$  (kPa), that may be placed at ground surface adjacent to the wall. The surcharge pressure will only be applicable for static analyses and should not be calculated with the seismic loading case.

Actual earth pressures could be higher than the “at-rest” case if care is not exercised during the compaction of the backfill materials to stay at least 0.3 m away from the walls with the compaction equipment.

## Seismic Earth Pressures

The total seismic force ( $P_{AE}$ ) includes both the earth force component ( $P_o$ ) and the seismic component ( $\Delta P_{AE}$ ).

The seismic earth force ( $\Delta P_{AE}$ ) could be calculated using  $0.375 \cdot a_c \cdot \gamma \cdot H^2/g$  where:

$a_c = (1.45 - a_{max}/g) a_{max}$

$\gamma$  = unit weight of fill of the applicable retained soil ( $\text{kN/m}^3$ )

$H$  = height of the wall (m)

$g$  = gravity,  $9.81 \text{ m/s}^2$

The peak ground acceleration, ( $a_{max}$ ), for the Ottawa area is  $0.32g$  according to OBC 2012. The vertical seismic coefficient is assumed to be zero.

The earth force component ( $P_o$ ) under seismic conditions could be calculated using  $P_o = 0.5 K_o \gamma H^2$ , where  $K_o = 0.5$  for the soil conditions presented above.

The total earth force ( $P_{AE}$ ) is considered to act at a height,  $h$  (m), from the base of the wall, where:

$$h = \{P_o \cdot (H/3) + \Delta P_{AE} \cdot (0.6 \cdot H)\} / P_{AE}$$

The earth forces calculated are unfactored. For the ULS case, the earth loads should be factored as live loads, as per OBC 2012.

## 5.7 Pavement Structure

For design purposes, the pavement structures presented in the following tables could be used for the design of car only parking areas and access lanes within the parking garage.

<b>Table 2 - Recommended Pavement Structure - Car Only Parking Areas</b>	
<b>Thickness mm</b>	<b>Material Description</b>
50	<b>Wear Course</b> - HL-3 or Superpave 12.5 Asphaltic Concrete
150	<b>BASE</b> - OPSS Granular A Crushed Stone
300	<b>SUBBASE</b> - OPSS Granular B Type II
<b>SUBGRADE</b> - Either fill, in situ soil, select subgrade material or OPSS Granular B Type I or II material placed over in situ soil or fill	

<b>Table 3 - Recommended Pavement Structure - Access Lanes and Heavy Truck Parking Areas</b>	
<b>Thickness mm</b>	<b>Material Description</b>
40	<b>Wear Course</b> - HL-3 or Superpave 12.5 Asphaltic Concrete
50	<b>Binder Course</b> - HL-8 or Superpave 19.0 Asphaltic Concrete
150	<b>BASE</b> - OPSS Granular A Crushed Stone
450	<b>SUBBASE</b> - OPSS Granular B Type II
<b>SUBGRADE</b> - Either fill, in situ soil, select subgrade material or OPSS Granular B Type I or II material placed over in situ soil or fill	

Minimum Performance Graded (PG) 58-34 asphalt cement should be used for this project. If soft spots develop in the subgrade during compaction or due to construction traffic, the affected areas should be excavated and replaced with OPSS Granular B Type II material. The pavement granular base and subbase should be placed in maximum 300 mm thick lifts and compacted to a minimum of 99% of the material's SPMDD using suitable vibratory equipment.

## **6.0 Design and Construction Precautions**

### **6.1 Foundation Drainage and Backfill**

#### **Foundation Drainage**

A perimeter foundation drainage system is recommended to be provided for the proposed building. The system should consist of a 150 mm diameter perforated corrugated plastic pipe, surrounded on all sides by 150 mm of 19 mm clear crushed stone, placed at the footing level around the exterior perimeter of the structure. The pipe should have a positive outlet, such as a gravity connection to the storm sewer.

#### **Foundation Backfill**

Backfill against the exterior sides of the foundation walls should consist of free-draining, non frost susceptible granular materials. Imported granular materials, such as clean sand or OPSS Granular B Type I granular material, should be used for this purpose. The greater part of the site excavated materials will be frost susceptible and, as such, are not recommended for re-use as backfill against the foundation walls, unless used in conjunction with a composite drainage blanket, such as Miradrain G100N or Delta Drain 6000.

#### **Concrete Sidewalks Adjacent to Building(s)**

To avoid differential settlements within the proposed sidewalks adjacent to the proposed building, it is recommended that the upper 600 mm of backfill placed below the concrete sidewalks to consist of free draining, non-frost susceptible material such as Granular A or Granular B Type II, instead of site excavated material which, in most cases, is considered frost susceptible. The granular material should be placed in maximum 300 mm thick loose lifts and compacted to 95% of the material's SPMDD using suitable compaction equipment. The subgrade material should be shaped to promote positive drainage towards the building's perimeter drainage pipe.

### **6.2 Protection of Footings Against Frost Action**

Perimeter footings of heated structures are required to be insulated against the deleterious effects of frost action. A minimum of 1.5 m of soil cover alone, or a minimum of 0.6 m of soil cover in conjunction with adequate foundation insulation, should be provided.

Exterior unheated footings, such as those for isolated exterior piers, are more prone to deleterious movement associated with frost action than the exterior walls of the heated structure and require additional protection. Soil cover of 2.1 m or an equivalent combination of soil cover and foundation insulation should be provided.

### **6.3 Excavation Side Slopes**

The temporary excavation side slopes anticipated should either be excavated to acceptable slopes or retained by shoring systems from the beginning of the excavation until the structure is backfilled.

#### **Temporary Side Slopes**

The excavation side slopes above the groundwater level extending to a maximum depth of 3 m should be cut back at 1H:1V or flatter. The flatter slope is required for excavation below groundwater level. The subsurface soil is considered to be mainly a Type 2 and 3 soil according to the Occupational Health and Safety Act and Regulations for Construction Projects.

Excavated soil should not be stockpiled directly at the top of excavations and heavy equipment should maintain safe working distance from the excavation sides.

Slopes in excess of 3 m in height should be periodically inspected by the geotechnical consultant in order to detect if the slopes are exhibiting signs of distress.

A trench box is recommended to protect personnel working in trenches with steep or vertical sides. Services are expected to be installed by “cut and cover” methods and excavations should not remain open for extended periods of time.

#### **Temporary Shoring**

The shoring requirements will depend on the depth of the excavation, the proximity of the adjacent structures and the elevation of the adjacent building foundations and underground services. It is expected that a shoring contractor will be responsible for the design and installation of the shoring system based on information provided by the contractor’s engineers, including the geotechnical consultant.

For preliminary design purposes, the temporary system may consist of a soldier pile and lagging system or interlocking steel sheet piling. Any additional loading due to street traffic, construction equipment, adjacent structures and facilities, etc., should be added to the earth pressures described below. These systems can be cantilevered, anchored or braced. Earth pressures acting on the shoring system may be calculated using the parameters provided in Table 4.

<b>Table 4 - Soil Parameters</b>	
<b>Parameters</b>	<b>Values</b>
Active Earth Pressure Coefficient ( $K_a$ )	0.33
Passive Earth Pressure Coefficient ( $K_p$ )	3
At-Rest Earth Pressure Coefficient ( $K_o$ )	0.5
Unit Weight ( $\gamma$ ), kN/m <sup>3</sup>	20
Submerged Unit Weight( $\gamma$ ), kN/m <sup>3</sup>	13

### **Soldier Pile and Lagging System**

The active earth pressure acting on a soldier pile and lagging shoring system can be calculated using a rectangular earth pressure distribution with a maximum pressure of  $0.65 \cdot K \cdot \gamma \cdot H$  for strutted or anchored shoring, or a triangular earth pressure distribution with a maximum value of  $K \cdot \gamma \cdot H$  for a cantilever shoring system. H is the height of the excavation.

The active earth pressure should be used where wall movements are permissible while the at-rest pressure should be used if no movement is permissible.

The total unit weight should be used above the groundwater level while the submerged unit weight should be used below the groundwater level.

The hydrostatic groundwater pressure should be added to the earth pressure distribution wherever the submerged unit weights are used for earth pressure calculations should the level on the groundwater not be lowered below the bottom of the excavation. If the groundwater level is lowered, the total unit weight for the soil should be used full weight, with no hydrostatic groundwater pressure component.



## **Damage to Adjacent Structures**

There is a possibility of disturbance to adjacent subsoil which may cause damage to adjacent structures due to the installation of the temporary shoring system. The sole responsibility of any damage caused by the installation of the temporary shoring system will be with the shoring contractor. The geotechnical engineering consultant will not be liable for any damages arising from the temporary shoring installation and will be indemnified by the owner and shoring contractor.

## **6.4 Pipe Bedding and Backfill**

Bedding and backfill materials should be in accordance with the most recent Material Specifications & Standard Detail Drawings from the Department of Public Works and Services, Infrastructure Services Branch of the City of Ottawa.

A minimum of 150 mm of OPSS Granular A should be placed for bedding for sewer or water pipes when placed on soil subgrade. The bedding should extend to the spring line of the pipe. Cover material, from the spring line to a minimum of 300 mm above the obvert of the pipe should consist of OPSS Granular A (concrete or PSM PVC pipes) or sand (concrete pipe). The bedding and cover materials should be placed in maximum 225 mm thick lifts and compacted to 98% of the material's SPMDD.

Where hard surface areas are considered above the trench backfill, the trench backfill material within the frost zone (about 1.8 m below finished grade) should match the soils exposed at the trench walls to reduce the potential for differential frost heaving. The trench backfill should be placed in maximum 300 mm thick loose lifts and compacted to a minimum of 95% of the SPMDD.

## **6.5 Groundwater Control**

It is anticipated that groundwater infiltration into the excavations should be low through the sides of the excavation and controllable using open sumps. Pumping from open sumps should be sufficient to control the groundwater influx through the sides of shallow excavations. The contractor should be prepared to direct water away from all bearing surfaces and subgrades, regardless of the source, to prevent disturbance to the founding medium.

A temporary Ministry of the Environment and Climate Change (MOECC) permit to take water (PTTW) may be required for this project if more than 400,000 L/day of ground and/or surface water is to be pumped during the construction phase. A minimum 4 to 5 months should be allowed for completion of the PTTW application package and issuance of the permit by the MOECC.

For typical ground or surface water volumes, being pumped during the construction phase, between 50,000 to 400,000 L/day, it is required to register on the Environmental Activity and Sector Registry (EASR). A minimum of two to four weeks should be allotted for completion of the EASR registration and the Water Taking and Discharge Plan to be prepared by a Qualified Person as stipulated under O.Reg. 63/16. If a project qualifies for a PTTW based upon anticipated conditions, an EASR will not be allowed as a temporary dewatering measure while awaiting the MOECC review of the PTTW application.

## **6.6 Winter Construction**

Precautions must be taken if winter construction is considered for this project.

The subsurface conditions mostly consist of frost susceptible materials. In the presence of water and freezing conditions ice could form within the soil mass. Heaving and settlement upon thawing could occur.

In the event of construction during below zero temperatures, the founding stratum should be protected from freezing temperatures by the installation of straw, propane heaters and tarpaulins or other suitable means. The base of the excavations should be insulated from sub-zero temperatures immediately upon exposure and until such time as heat is adequately supplied to the building and the footings are protected with sufficient soil cover to prevent freezing at founding level.

The trench excavations and pavement construction are also difficult activities to complete during freezing conditions without introducing frost in the subgrade or in the excavation walls and bottoms. Precautions should be taken if such activities are to be carried out during freezing conditions.

## **6.7 Corrosion Potential and Sulphate**

The results of analytical testing show that the sulphate content is less than 0.1%. This result is indicative that Type 10 Portland cement (normal cement) would be appropriate for this site. The chloride content and the pH of the sample indicate that they are not significant factors in creating a corrosive environment for exposed ferrous metals at this site, whereas the resistivity is indicative of an aggressive corrosive environment.

## 7.0 Recommendations

For the foundation design data provided herein to be applicable that a materials testing and observation services program is required to be completed. The following aspects be performed by the geotechnical consultant:

- Observation of all bearing surfaces prior to the placement of concrete.
- Sampling and testing of the concrete and fill materials.
- Observation of the placement of the foundation insulation, if applicable.
- Periodic observation of the condition of unsupported excavation side slopes in excess of 3 m in height, if applicable.
- Observation of all subgrades prior to backfilling.
- Field density tests to determine the level of compaction achieved.
- Sampling and testing of the bituminous concrete including mix design reviews.

A report confirming the construction has been conducted in general accordance with the recommendations could be issued, upon request, following the completion of a satisfactory materials testing and observation program by the geotechnical consultant.

## 8.0 Statement of Limitations

The recommendations provided are in accordance with the present understanding of the project. Paterson requests permission to review the recommendations when the drawings and specifications are completed.

A soils investigation of this nature is a limited sampling of a site. Should any conditions at the site be encountered which differ from those at the test locations, Paterson requests immediate notification to permit reassessment of our recommendations.

The recommendations provided herein should only be used by the design professionals associated with this project. They are not intended for contractors bidding on or undertaking the work. The latter should evaluate the factual information provided in this report and determine the suitability and completeness for their intended construction schedule and methods. Additional testing may be required for their purposes.

The present report applies only to the project described in this document. Use of this report for purposes other than those described herein or by person(s) other than Beaumont & Fine Investments or their agents is not authorized without review by Paterson for the applicability of our recommendations to the alternative use of the report.

### Paterson Group Inc.



Kevin A. Pickard, EIT



Scott S. Dennis, P.Eng.

### Report Distribution

- Beaumont & Fine Investments (3 copies)
- Paterson Group (1 copy)

# **APPENDIX 1**

**SOIL PROFILE AND TEST DATA SHEETS**

**SYMBOLS AND TERMS**

**ANALYTICAL TESTING RESULTS**

DATUM Geodetic

REMARKS

BORINGS BY CME 55 Power Auger

DATE December 2, 2019

FILE NO. **PG4506**

HOLE NO. **BH 1-19**

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction	
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %					
								20	40	60	80		
<b>GROUND SURFACE</b>													
Asphaltic concrete	0.08	AU	1			0	71.57						
FILL: Brown sand, trace gravel	0.76												
FILL: Brown sandy silt	1.52	SS	2	71	7	1	70.57						
Compact, brown <b>SAND</b>  - trace silt from 2.3 to 3.8m depth		SS	3	83	14	2	69.57						
		SS	4	83	14	3	68.57						
		SS	5	92	18	4	67.57						
		SS	6	75	16	5	66.57						
		SS	7	58	17	6	65.57						
		SS	8	75	25	7	64.57						
		SS	9	79	30	8	63.57						
		SS	10	75	24	9	62.57						
Compact, brown <b>SANDY SILT</b> , some gravel, trace clay, cobbles and boulders	7.32	SS	11	79	21	10	61.57						
	8.69	SS	12	92	76	11	60.57						
Compact, brown <b>SAND</b> , some gravel, trace cobbles, boulders		SS	13	71	22	12	59.57						
	10.26	SS	14	67	62	13	58.57						
Very dense, brown <b>SANDY SILT</b>	10.67	SS	15	67	50+	14	57.57						
Very dense, brown <b>SILTY SAND</b> , some gravel, trace cobbles and boulders		SS	16	100	50+	15							
		SS	17	81	50+	16							
		SS	18	0	50+	17							
		AU	19			18							
End of Borehole	14.63					19							
(GWL @ 12.26m - Dec. 11, 2019)													

20 40 60 80 100  
**Shear Strength (kPa)**  
▲ Undisturbed    △ Remoulded

DATUM Geodetic

REMARKS


BORINGS BY CME 55 Power Auger

DATE December 2, 2019

FILE NO. **PG4506**

HOLE NO. **BH 2-19**

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %				
								20	40	60	80	
<b>GROUND SURFACE</b>												
Asphaltic concrete FILL: Brown sand	0.08 0.76	AU	1			0	71.48					
Compact, brown SAND	1.52	SS	2	92	16	1	70.48					
Compact, brown SANDY SILT	2.29	SS	3	75	16	2	69.48					
Loose to compact, brown SILTY SAND	3.81	SS	4	83	9	3	68.48					
		SS	5	71	19							
		SS	6	75	16	4	67.48					
Compact, brown SANDY SILT	4.67	SS	7	79	13	5	66.48					
Compact, brown SAND - some gravel by 5.8m depth	7.98	SS	8	83	23	6	65.48					
		SS	9	75	23							
		SS	10	67	25	7	64.48					
		SS	11	75	19	8	63.48					
Compact, brown SANDY SILT, trace gravel	8.38	SS	12	100	50+	8	63.48					
Very dense, brown SAND, some gravel	14.63	SS	13	0	50+	9	62.48					
		SS	14	67	50+	10	61.48					
		SS	15	100	58	11	60.48					
		SS	16	9	50+	12	59.48					
		SS	17	71	50+	13	58.48					
End of Borehole (GWL @ 12.27m - Dec. 11, 2019)		AU	18			14	57.48					



DATUM Geodetic

REMARKS

BORINGS BY CME 55 Power Auger

DATE December 3, 2019

FILE NO. **PG4506**

HOLE NO. **BH 3-19**

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction	
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %					
								20	40	60	80		
<b>GROUND SURFACE</b>													
Asphaltic concrete	0.06	⊗	AU	1		0	71.46						
FILL: Brown sand, some gravel	0.76	⊗	SS	2	50	3	1	70.46					
FILL: Brown sand, some silt, trace gravel	1.52	⊗	SS	3	42	13	2	69.46					
Compact, brown SAND, some silt	2.29	⊗	SS	4	54	29	3	68.46					
Compact, brown SILT with sand	3.05	⊗	SS	5	71	19	4	67.46					
Compact, brown SAND, some silt	3.81	⊗	SS	6	79	19	5	66.46					
Compact, brown SILT, some sand	4.57	⊗	SS	7	71	20	6	65.46					
Compact, brown SAND		⊗	SS	8	79	22	7	64.46					
		⊗	SS	9	62	21	8	63.46					
	- some gravel by 6.9m depth		SS	10	71	26	9	62.46					
		7.62	⊗	SS	11	70	50+	10	61.46				
Very dense, brown SILT with clay, some sand and gravel	8.38	⊗	SS	12	80	50+	11	60.46					
Very dense, brown SAND, some gravel		⊗	SS	13	50	50+	12	59.46					
		⊗	SS	14	62	35	13	58.46					
	- trace cobbles and boulders by 9.1m depth		SS	15	83	53	14	57.46					
			SS	16	73	50+	15						
			SS	17	76	50+	16						
Very dense GRAVEL with sand	12.95	⊗	SS	18	53	50+	17						
		⊗	SS	19	46	55	18						
End of Borehole (GWL @ 12.30m - Dec. 11, 2019)	14.94												

20 40 60 80 100  
Shear Strength (kPa)  
▲ Undisturbed    △ Remoulded



DATUM Geodetic

REMARKS

BORINGS BY CME 55 Power Auger

DATE December 3, 2019

FILE NO. **PG4506**

HOLE NO. **BH 4-19**

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			20	40	60	80	
<b>GROUND SURFACE</b>												
Asphaltic concrete	0.05	AU	1			0	71.46					
<b>FILL:</b> Brown sand	1.52	SS	2	54	7	1	70.46					
Loose, brown <b>SANDY SILT</b>	2.29	SS	3	71	9	2	69.46					
Compact, brown <b>SAND</b>		SS	4	67	10	3	68.46					
- with silt by 3.0m depth		SS	5	58	13	4	67.46					
Compact, brown <b>SANDY SILT</b>	3.81	SS	6	67	16	4	67.46					
Compact, brown <b>SAND</b>	4.27											
End of Borehole	4.42											

20 40 60 80 100  
**Shear Strength (kPa)**  
▲ Undisturbed    △ Remoulded

DATUM Geodetic

REMARKS


BORINGS BY CME 55 Power Auger

DATE December 3, 2019

FILE NO. **PG4506**

HOLE NO. **BH 5-19**

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %				
GROUND SURFACE								20	40	60	80	
Asphaltic concrete	0.06	AU	1			0	71.51					
FILL: Brown sand, trace gravel	[Cross-hatched pattern]	SS	2	50	9	1	70.51					
		SS	3	4	6	2	69.51					
		SS	4	50	3	3	68.51					
Very loose to compact, brown SAND, trace silt	[Dotted pattern]	SS	5	62	3	3	68.51					
		SS	6	79	12	4	67.51					
End of Borehole	4.42											



DATUM Geodetic

REMARKS

BORINGS BY CME 55 Power Auger

DATE December 4, 2019

FILE NO. **PG4506**

HOLE NO. **BH 6-19**

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction	
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %					
								20	40	60	80		
<b>GROUND SURFACE</b>													
Asphaltic concrete	0.08	⊗	AU	1		0	71.62						
FILL: Brown sand, some gravel	0.41	⊗	SS	2	71	10	1	70.62					
Compact, brown <b>SAND</b>		⊗	SS	3	75	16	2	69.62					
		⊗	SS	4	83	14	3	68.62					
		⊗	SS	5	71	15	4	67.62					
		⊗	SS	6	83	14	5	66.62					
Compact, brown <b>SAND</b> with silt	3.15	⊗	SS	7	79	19	6	65.62					
Compact, brown <b>SILT</b> with sand	4.06	⊗	SS	8	75	18	7	64.62					
Compact, brown <b>SAND</b> , trace gravel	4.22	⊗	SS	9	70	79	8	63.62					
		⊗	SS	10	71	14	9	62.62					
		⊗	SS	11	62	21	10	61.62					
		⊗	SS	12	83	34	11	60.62					
Compact to very dense, brown <b>SILT</b> with clay, some sand and gravel	7.62	⊗	SS	13	100	50+	12	59.62					
- trace cobbles and boulders by 9.9md epth		⊗	SS	14	50	50+	13	58.62					
Very dense, brown <b>SAND</b>	10.77	⊗	SS	15	88	51	14	57.62					
	11.43	⊗	SS	16	62	49	15	56.62					
Very dense, brown <b>SAND</b> , some gravel, trace cobbles and boulders		⊗	SS	17	89	50+	16						
- gravel increasing with depth	12.95	⊗	SS	18	67	68	17						
Very dense, brown <b>SILTY SAND</b> with gravel, trace cobbles and boulders		⊗	SS	19	90	50+	18						
		⊗	SS	20	0	50+	19						
End of Borehole	15.24	⊗	AU	21			20						
(GWL @ 12.32m - Dec. 11, 2019)													

20 40 60 80 100  
Shear Strength (kPa)  
▲ Undisturbed    △ Remoulded

DATUM Geodetic

REMARKS

BORINGS BY CME 55 Power Auger

DATE December 4, 2019

FILE NO. **PG4506**

HOLE NO. **BH 7-19**

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %				
								20	40	60	80	
<b>GROUND SURFACE</b>												
Asphaltic concrete	0.09	AU	1			0	71.47					
<b>FILL:</b> Brown sand with gravel												
- trace gravel by 0.3m depth	1.52	SS	2	58	3	1	70.47					
<b>FILL:</b> Brown sand												
	2.29	SS	3	67	3	2	69.47					
Compact, brown <b>SAND</b> , some silt		SS	4	92	12	3	68.47					
	3.81	SS	5	88	18	4	67.47					
Compact, brown <b>SAND</b>		SS	6	88	20	5	66.47					
		SS	7	58	21	6	65.47					
		SS	8	75	17	7	64.47					
		SS	9	71	18	8	63.47					
		SS	10	79	24	9	62.47					
- trace gravel, cobbles and boulders by 7.6m depth	8.76	SS	11	46	30	10	61.47					
Dark brown <b>SILTY CLAY</b> with sand and gravel		SS	12	50	11	11	60.47					
		SS	13	42	23	12	59.47					
- trace cobbles and boulders by 9.9m depth	10.67	SS	14	100	50+	13	58.47					
Very dense, brown <b>SAND</b> , trace gravel, cobbles, boulders	11.43	SS	15	67	46	14	57.47					
Compact to very dense, brown <b>SAND</b> with gravel		SS	16	33	29	15						
	13.00	SS	17	89	50+	16						
Very dense, brown <b>GRAVEL</b> with sand		SS	18	54	50	17						
	14.33	SS	19	83	93	18						
End of Borehole						19						

20 40 60 80 100  
**Shear Strength (kPa)**  
▲ Undisturbed    △ Remoulded

**DATUM** TBM - Top spindle of fire hydrant located in front of 1063 Bank Street. Geodetic elevation = 73.22m.

**REMARKS**

**BORINGS BY** CME 55 Power Auger

**DATE** May 1, 2018

**FILE NO.**  
**PG4506**

**HOLE NO.**  
**BH 1**

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction	
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %					
								20	40	60	80		
<b>GROUND SURFACE</b>						0	71.50						
50mm Asphaltic concrete over crushed stone with silt and sand	0.60	AU	1										
<b>FILL:</b> Brown sand, some silt, gravel and asphalt	2.44	SS	2	33	8	1	70.50						
		SS	3	50	4	2	69.50						
Compact to dense, brown <b>SAND</b> , trace silt		SS	4	50	14	3	68.50						
		SS	5	92	12	4	67.50						
		SS	6	92	22	5	66.50						
		SS	7	92	54	6	65.50						
		SS	8	92	45	7	64.50						
		SS	9	83	45	8	63.50						
		SS	10	75	41	9	62.50						
		SS	11	83	29	10	61.50						
		SS	12	100	40	11	60.50						
Dense, brown <b>SILTY FINE SAND</b> , trace clay and gravel	8.38	SS	13	89	50+	12	59.50						
Very dense, brown <b>SANDY SILT</b> , some clay, gravel and cobbles	9.14	SS	14	75	50+	13	58.50						
		SS	15	75	61	14	57.50						
Very dense, brown <b>SAND</b> , some gravel	10.67	SS	16	82	50+	15	60.50						
		SS	17	100	50+	16	59.50						
		SS	17	100	50+	17	58.50						
End of Borehole (GWL @ 11.39m-May 15, 2018)	14.63					18	57.50						

20 40 60 80 100  
**Shear Strength (kPa)**  
▲ Undisturbed    △ Remoulded

**DATUM** TBM - Top spindle of fire hydrant located in front of 1063 Bank Street. Geodetic elevation = 73.22m.

**REMARKS**

**BORINGS BY** CME 55 Power Auger

**DATE** May 2, 2018

**FILE NO.**  
**PG4506**

**HOLE NO.**  
**BH 2**

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction	
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %					
								20	40	60	80		
<b>GROUND SURFACE</b>						0	71.55						
50mm Asphaltic concrete over crushed stone with silt and sand <b>FILL:</b> Brown sand, some gravel, asphalt, trace silt	0.46	AU	1			1	70.55						
Very loose, brown <b>FINE SAND</b> , trace silt, gravel, cobbles	1.37	SS	2	92	4	2	69.55						
Compact to dense, brown <b>SAND</b>  - some gravel and cobbles, trace clay by 6.1m depth	2.13	SS	3	67	3	3	68.55						
		SS	4	100	10	4	67.55						
		SS	5	92	21	5	66.55						
		SS	6	75	29	6	65.55						
		SS	7	75	27	7	64.55						
		SS	8	83	25	8	63.55						
		SS	9	75	40	9	62.55						
		SS	10	58	38	10	61.55						
		SS	11	83	27	11	60.55						
		SS	12	67	19	12	59.55						
Compact to very dense, brown <b>SILTY SAND</b> , some gravel, trace clay, cobbles and boulders	7.77	SS	13	88	50+	13	58.55						
		SS	14	50	50+	14	57.55						
		SS	15	83	36	15	56.55						
Dense to very dense, brown <b>SAND</b> , some gravel	10.67	SS	16	80	50+	16	55.55						
		SS	17	67	50+	17	54.55						
						18	53.55						
End of Borehole  (GWL @ 11.75m-May 15, 2018)	14.63					19	52.55						

20 40 60 80 100  
**Shear Strength (kPa)**  
▲ Undisturbed    △ Remoulded

**DATUM** TBM - Top spindle of fire hydrant located in front of 1063 Bank Street. Geodetic elevation = 73.22m.

**REMARKS**

**BORINGS BY** CME 55 Power Auger

**DATE** May 4, 2018

**FILE NO.**  
**PG4506**

**HOLE NO.**  
**BH 3**

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction	
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %					
								20	40	60	80		
<b>GROUND SURFACE</b>						0	71.50						
50mm Asphaltic concrete over crushed stone with silt and sand	0.46	AU	1										
<b>FILL:</b> Brown sandy silt, some gravel and asphalt		SS	2	54	9	1	70.50						
	1.98	SS	3	75	5	2	69.50						
Compact to very dense, brown <b>SAND</b> , trace silt		SS	4	58	23	3	68.50						
		SS	5	75	34	4	67.50						
		SS	6	58	47	5	66.50						
		SS	7	58	40	6	65.50						
		SS	8	58	41	7	64.50						
		SS	9	83	54	8	63.50						
		SS	10	75	56	9	62.50						
		SS	11	58	75	10	61.50						
		SS	12	67	53	11	60.50						
	Very dense, brown <b>SAND</b> , some silt, clay and gravel	9.75	SS	13	75	43	12	59.50					
	10.67	SS	14	83	47	13	58.50						
Dense, brown <b>SAND</b>													
End of Borehole	13.72												
Practical refusal to augering at 13.72m depth (GWL @ 11.73m-May 15, 2018)													

20 40 60 80 100  
**Shear Strength (kPa)**  
▲ Undisturbed    △ Remoulded

# SYMBOLS AND TERMS

## SOIL DESCRIPTION

Behavioural properties, such as structure and strength, take precedence over particle gradation in describing soils. Terminology describing soil structure are as follows:

Desiccated	-	having visible signs of weathering by oxidation of clay minerals, shrinkage cracks, etc.
Fissured	-	having cracks, and hence a blocky structure.
Varved	-	composed of regular alternating layers of silt and clay.
Stratified	-	composed of alternating layers of different soil types, e.g. silt and sand or silt and clay.
Well-Graded	-	Having wide range in grain sizes and substantial amounts of all intermediate particle sizes (see Grain Size Distribution).
Uniformly-Graded	-	Predominantly of one grain size (see Grain Size Distribution).

The standard terminology to describe the relative strength of cohesionless soils is the compactness condition, usually inferred from the results of the Standard Penetration Test (SPT) 'N' value. The SPT N value is the number of blows of a 63.5 kg hammer, falling 760 mm, required to drive a 51 mm O.D. split spoon sampler 300 mm into the soil after an initial penetration of 150 mm. An SPT N value of "P" denotes that the split-spoon sampler was pushed 300 mm into the soil without the use of a falling hammer.

Compactness Condition	'N' Value	Relative Density %
Very Loose	<4	<15
Loose	4-10	15-35
Compact	10-30	35-65
Dense	30-50	65-85
Very Dense	>50	>85

The standard terminology to describe the strength of cohesive soils is the consistency, which is based on the undisturbed undrained shear strength as measured by the in situ or laboratory shear vane tests, unconfined compression tests, or occasionally by the Standard Penetration Test (SPT). Note that the typical correlations of undrained shear strength to SPT N value (tabulated below) tend to underestimate the consistency for sensitive silty clays, so Paterson reviews the applicable split spoon samples in the laboratory to provide a more representative consistency value based on tactile examination.

Consistency	Undrained Shear Strength (kPa)	'N' Value
Very Soft	<12	<2
Soft	12-25	2-4
Firm	25-50	4-8
Stiff	50-100	8-15
Very Stiff	100-200	15-30
Hard	>200	>30



## SYMBOLS AND TERMS (continued)

### SOIL DESCRIPTION (continued)

Cohesive soils can also be classified according to their “sensitivity”. The sensitivity,  $S_t$ , is the ratio between the undisturbed undrained shear strength and the remoulded undrained shear strength of the soil. The classes of sensitivity may be defined as follows:

Low Sensitivity:	$S_t < 2$
Medium Sensitivity:	$2 < S_t < 4$
Sensitive:	$4 < S_t < 8$
Extra Sensitive:	$8 < S_t < 16$
Quick Clay:	$S_t > 16$

### ROCK DESCRIPTION

The structural description of the bedrock mass is based on the Rock Quality Designation (RQD).

The RQD classification is based on a modified core recovery percentage in which all pieces of sound core over 100 mm long are counted as recovery. The smaller pieces are considered to be a result of closely-spaced discontinuities (resulting from shearing, jointing, faulting, or weathering) in the rock mass and are not counted. RQD is ideally determined from NQ or larger size core. However, it can be used on smaller core sizes, such as BQ, if the bulk of the fractures caused by drilling stresses (called “mechanical breaks”) are easily distinguishable from the normal in situ fractures.

RQD %	ROCK QUALITY
90-100	Excellent, intact, very sound
75-90	Good, massive, moderately jointed or sound
50-75	Fair, blocky and seamy, fractured
25-50	Poor, shattered and very seamy or blocky, severely fractured
0-25	Very poor, crushed, very severely fractured

### SAMPLE TYPES

SS	-	Split spoon sample (obtained in conjunction with the performing of the Standard Penetration Test (SPT))
TW	-	Thin wall tube or Shelby tube, generally recovered using a piston sampler
G	-	"Grab" sample from test pit or surface materials
AU	-	Auger sample or bulk sample
WS	-	Wash sample
RC	-	Rock core sample (Core bit size BQ, NQ, HQ, etc.). Rock core samples are obtained with the use of standard diamond drilling bits.

## SYMBOLS AND TERMS (continued)

### PLASTICITY LIMITS AND GRAIN SIZE DISTRIBUTION

WC%	-	Natural water content or water content of sample, %
LL	-	Liquid Limit, % (water content above which soil behaves as a liquid)
PL	-	Plastic Limit, % (water content above which soil behaves plastically)
PI	-	Plasticity Index, % (difference between LL and PL)
D <sub>xx</sub>	-	Grain size at which xx% of the soil, by weight, is of finer grain sizes These grain size descriptions are not used below 0.075 mm grain size
D <sub>10</sub>	-	Grain size at which 10% of the soil is finer (effective grain size)
D <sub>60</sub>	-	Grain size at which 60% of the soil is finer
C <sub>c</sub>	-	Concavity coefficient = $(D_{30})^2 / (D_{10} \times D_{60})$
C <sub>u</sub>	-	Uniformity coefficient = $D_{60} / D_{10}$

C<sub>c</sub> and C<sub>u</sub> are used to assess the grading of sands and gravels:

Well-graded gravels have:  $1 < C_c < 3$  and  $C_u > 4$

Well-graded sands have:  $1 < C_c < 3$  and  $C_u > 6$

Sands and gravels not meeting the above requirements are poorly-graded or uniformly-graded.

C<sub>c</sub> and C<sub>u</sub> are not applicable for the description of soils with more than 10% silt and clay (more than 10% finer than 0.075 mm or the #200 sieve)

### CONSOLIDATION TEST

p' <sub>o</sub>	-	Present effective overburden pressure at sample depth
p' <sub>c</sub>	-	Preconsolidation pressure of (maximum past pressure on) sample
C <sub>cr</sub>	-	Recompression index (in effect at pressures below p' <sub>c</sub> )
C <sub>c</sub>	-	Compression index (in effect at pressures above p' <sub>c</sub> )
OC Ratio		Overconsolidation ratio = $p'_c / p'_o$
Void Ratio		Initial sample void ratio = volume of voids / volume of solids
W <sub>o</sub>	-	Initial water content (at start of consolidation test)

### PERMEABILITY TEST


k	-	Coefficient of permeability or hydraulic conductivity is a measure of the ability of water to flow through the sample. The value of k is measured at a specified unit weight for (remoulded) cohesionless soil samples, because its value will vary with the unit weight or density of the sample during the test.
---	---	--

## SYMBOLS AND TERMS (continued)


### STRATA PLOT



Topsoil




Asphalt




Fill




Peat




Sand




Silty Sand




Silt



Sandy Silt



Clay




Silty Clay




Clayey Silty Sand



Glacial Till




Shale




Bedrock

### MONITORING WELL AND PIEZOMETER CONSTRUCTION

#### MONITORING WELL CONSTRUCTION

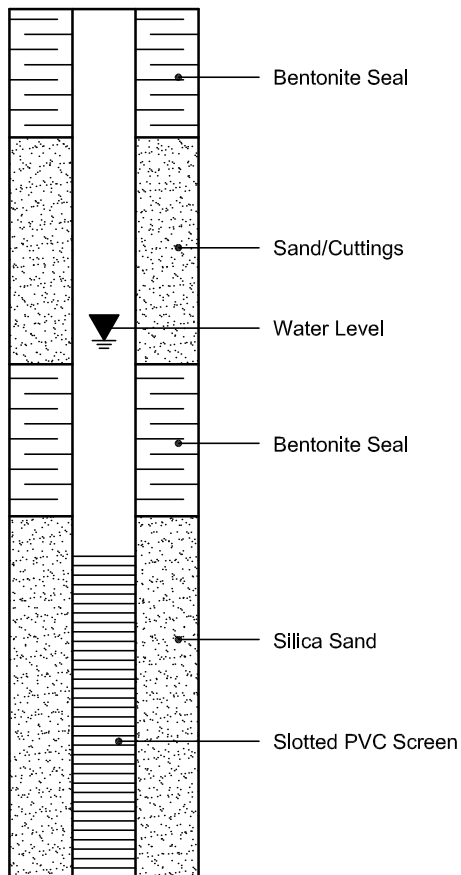

#### PIEZOMETER CONSTRUCTION

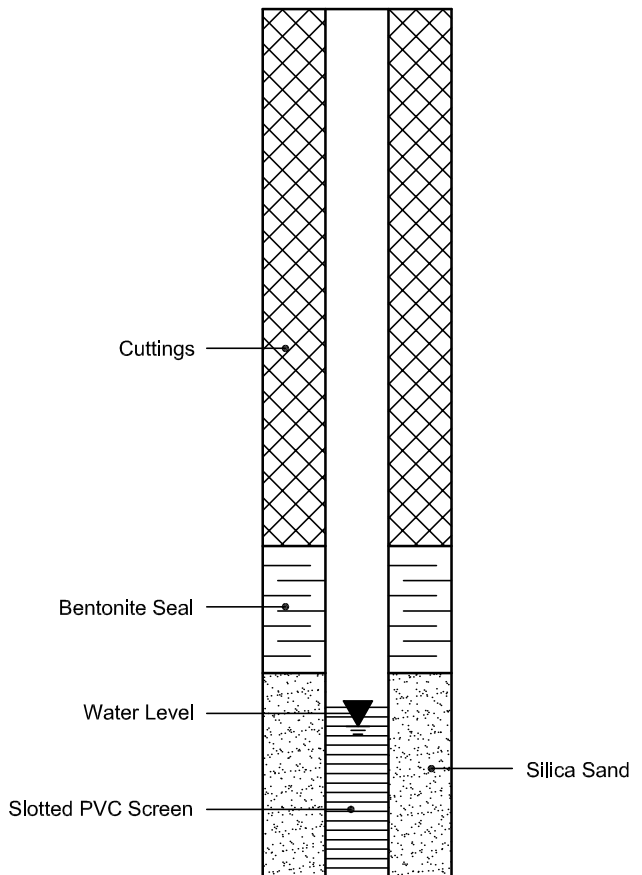

Certificate of Analysis  
 Client: Paterson Group Consulting Engineers  
 Client PO: 24194

Report Date: 04-Jul-2018

Order Date: 28-Jun-2018

Project Description: PG4506

<b>Client ID:</b>	BH1-SS4	-	-	-
<b>Sample Date:</b>	05/01/2018 09:00	-	-	-
<b>Sample ID:</b>	1826552-01	-	-	-
<b>MDL/Units</b>	Soil	-	-	-

**Physical Characteristics**

% Solids	0.1 % by Wt.	89.8	-	-	-
----------	--------------	------	---	---	---

**General Inorganics**

pH	0.05 pH Units	7.70	-	-	-
Resistivity	0.10 Ohm.m	22.1	-	-	-


**Anions**

Chloride	5 ug/g dry	202 [1]	-	-	-
Sulphate	5 ug/g dry	53 [1]	-	-	-

# **APPENDIX 2**

**FIGURE 1 - KEY PLAN**

**DRAWING PG4506-1R1 - TEST HOLE LOCATION PLAN**

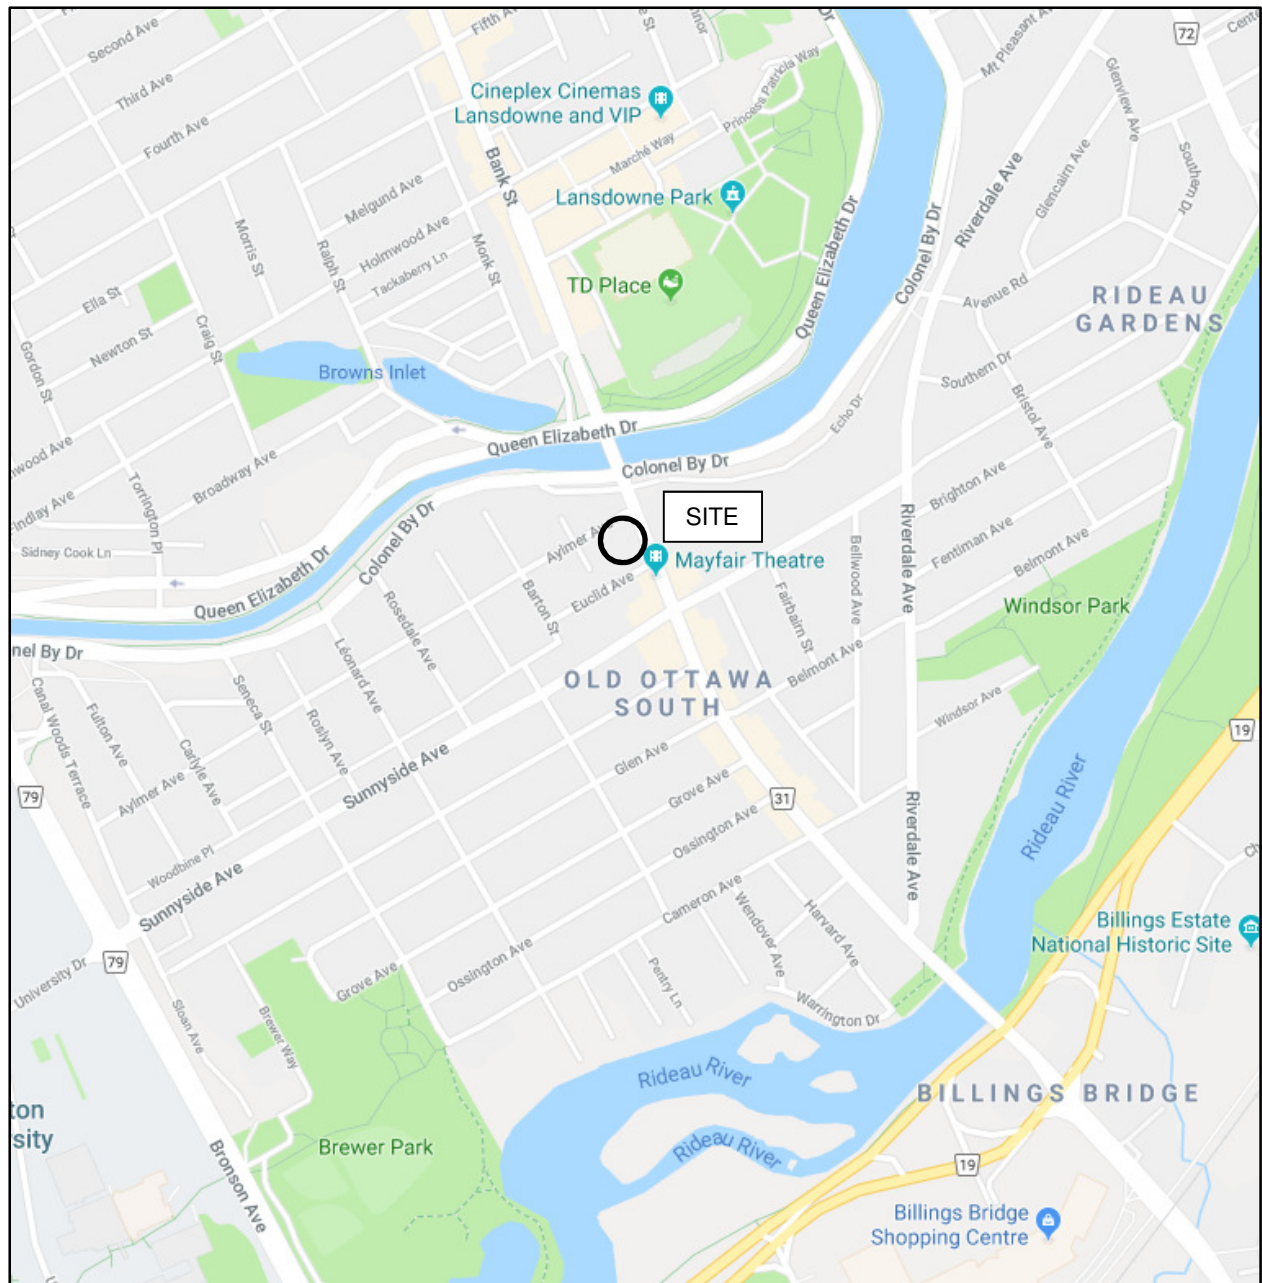


# FIGURE 1

## KEY PLAN

ALYMER AVENUE

BANK STREET

EUCLID AVENUE

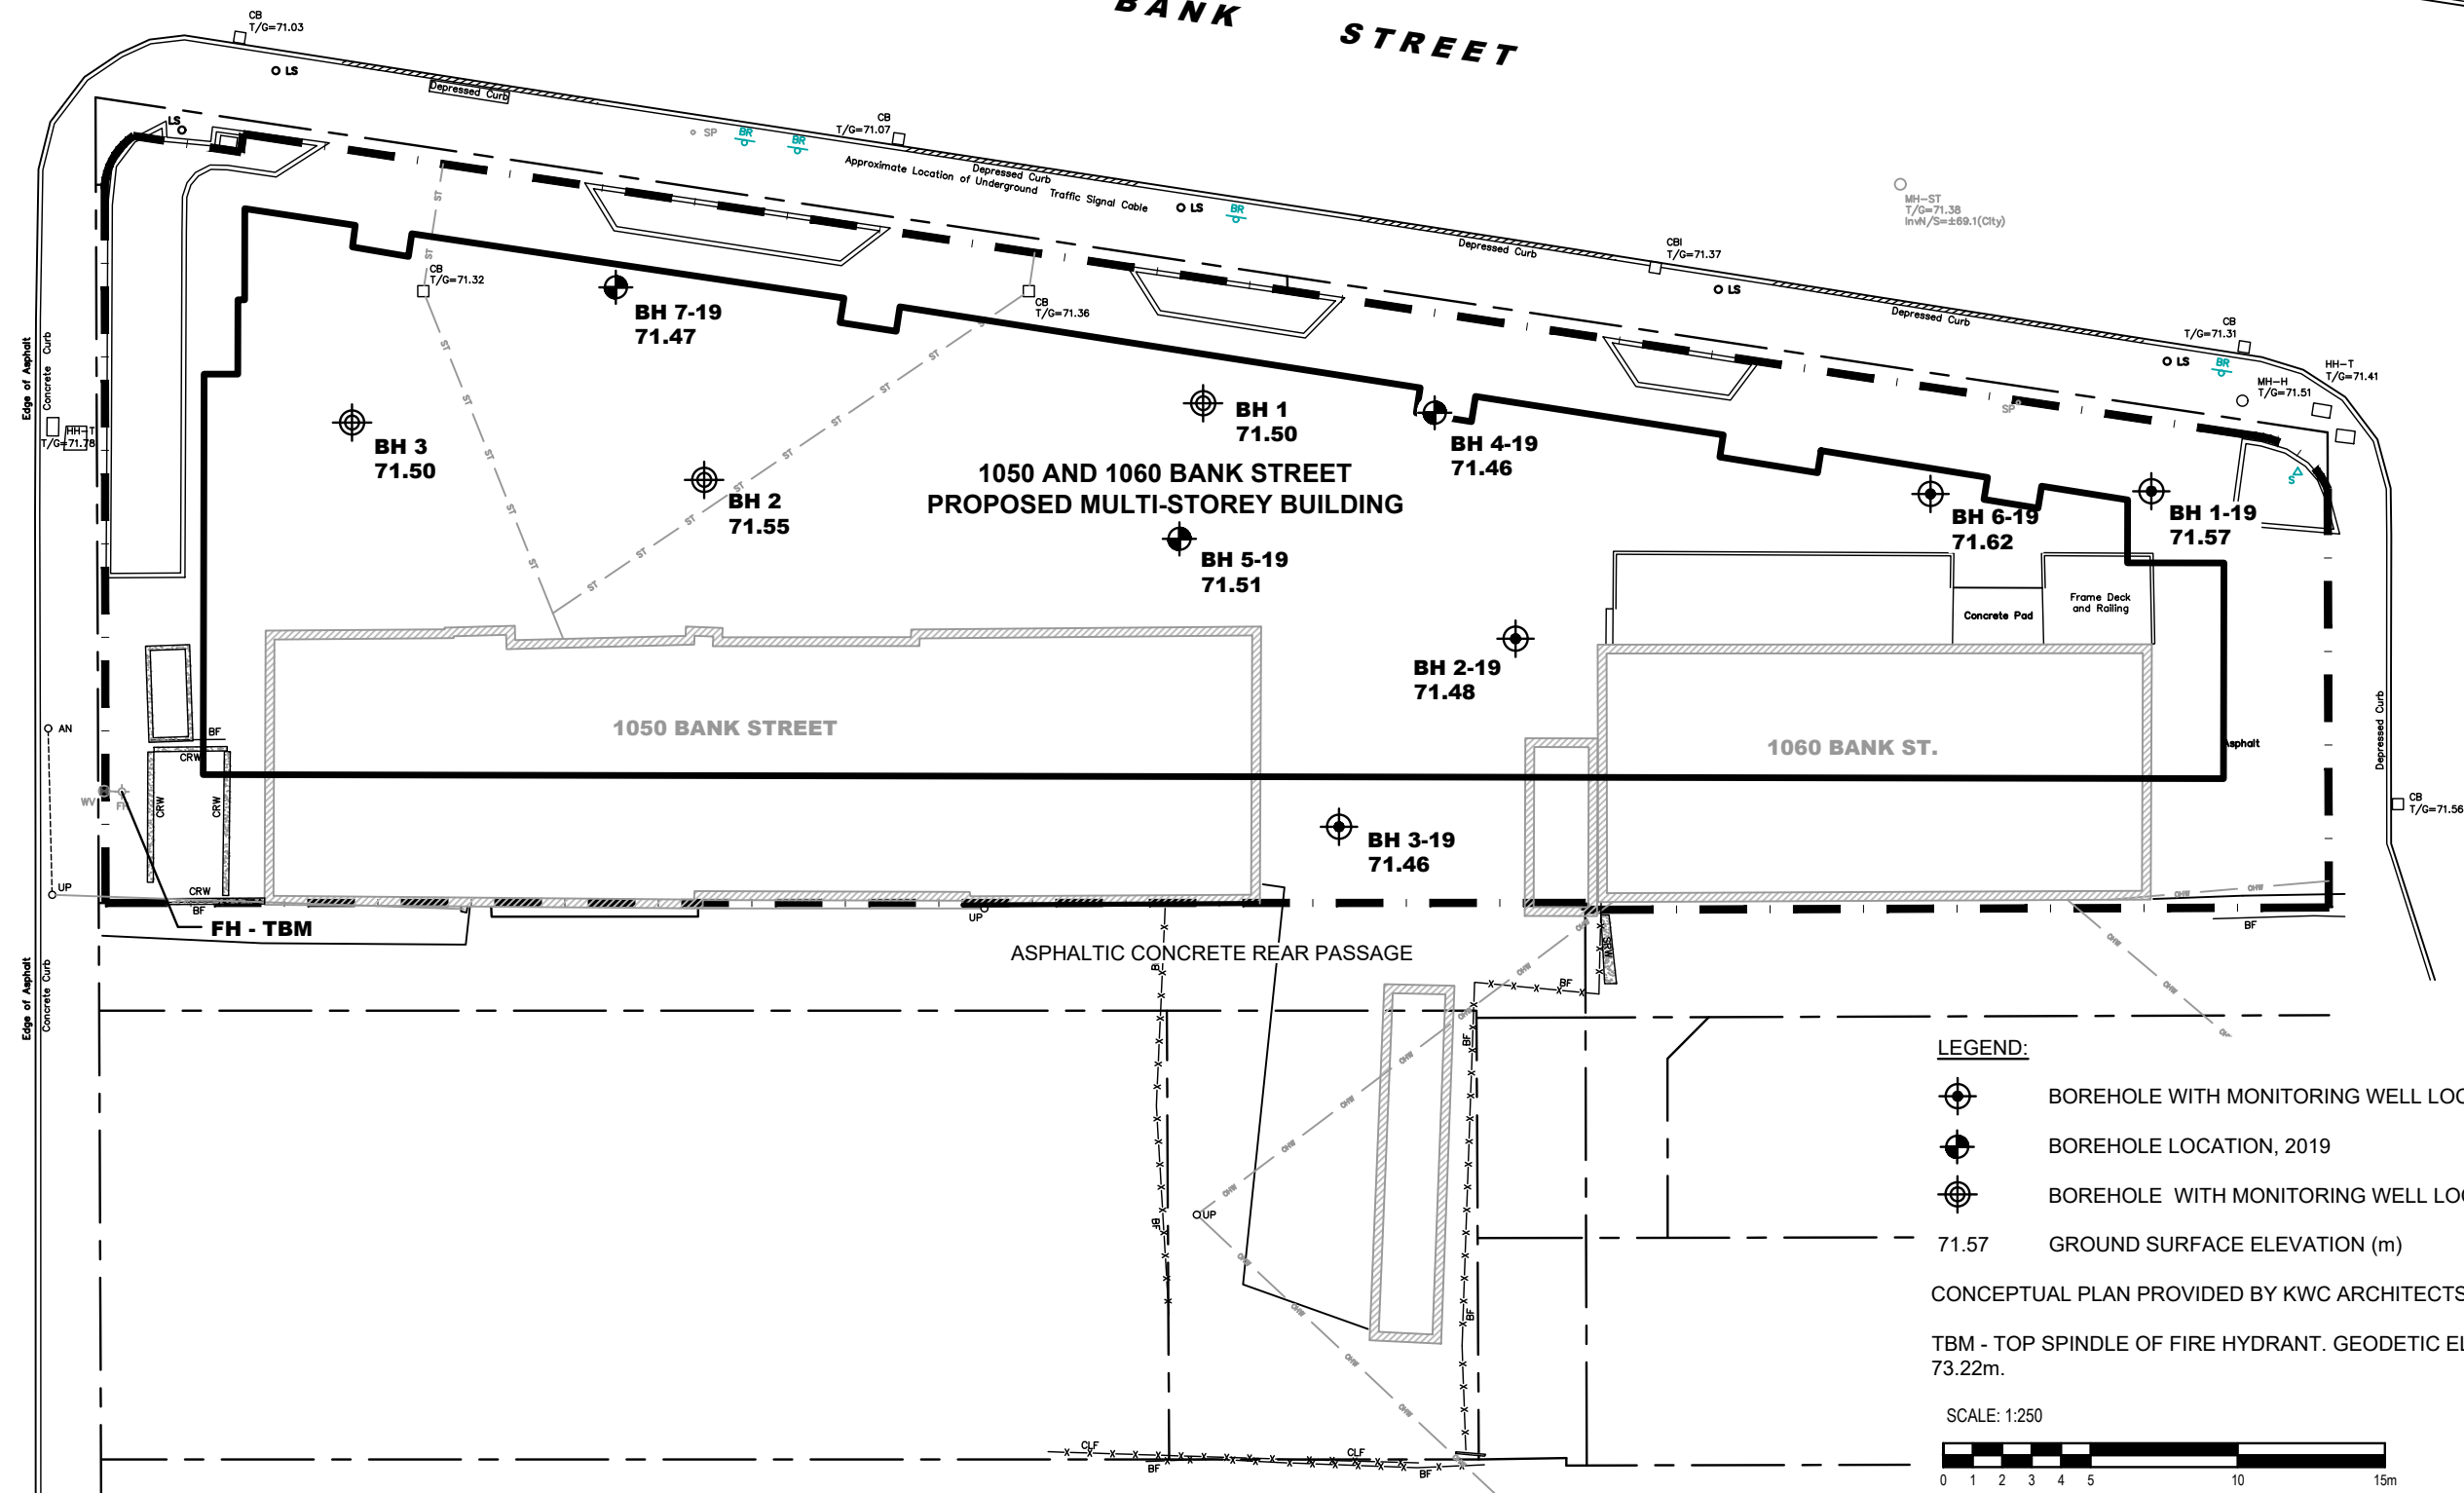

- LEGEND:**
- BOREHOLE WITH MONITORING WELL LOCATION, 2019
  - BOREHOLE LOCATION, 2019
  - BOREHOLE WITH MONITORING WELL LOCATION, 2018
  - 71.57 GROUND SURFACE ELEVATION (m)

CONCEPTUAL PLAN PROVIDED BY KWC ARCHITECTS INC.  
 TBM - TOP SPINDLE OF FIRE HYDRANT. GEODETIC ELEVATION = 73.22m.



**patersongroup**  
 consulting engineers

154 Colonnade Road South  
 Ottawa, Ontario K2E 7J5  
 Tel: (613) 226-7381 Fax: (613) 226-6344

NO.	REVISIONS	DATE	INITIAL
1	UPDATED WITH NEW CONCEPTUAL PLAN	06/04/2020	SD

BEAUMONT AND FINE INVESTMENTS  
 GEOTECHNICAL INVESTIGATION  
 PROPOSED MULTI-STOREY BUILDING  
 1050 AND 1060 BANK STREET  
 OTTAWA, ONTARIO

Title: **TEST HOLE LOCATION PLAN**

Scale:	1:250	Date:	06/2018
Drawn by:	MPG	Report No.:	PG4506-1
Checked by:	KP	Dwg. No.:	<b>PG4506-1</b>
Approved by:	SD	Revision No.:	1