


GRADIENTWIND

ENGINEERS & SCIENTISTS

PEDESTRIAN LEVEL WIND STUDY

327 Richmond Road
Ottawa, Ontario

Report: 20-053-PLW

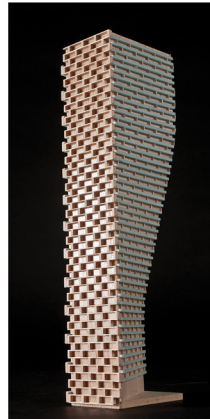

May 14, 2020

PREPARED FOR

Richmond Churchill Limited Partnership
485 Bank Street, Suite 207
Ottawa, ON K2P 1Z2

PREPARED BY

Sacha Ruzzante, MAsc., Junior Wind Scientist
Justin Ferraro, P.Eng., Principal

EXECUTIVE SUMMARY

This report describes a pedestrian level wind (PLW) study to satisfy the requirements for a joint zoning by-law amendment and site plan control application submission for a proposed development located at 327 Richmond Road in Ottawa, Ontario (hereinafter referred to as “subject site”). Our mandate within this study is to investigate pedestrian wind comfort and safety within and surrounding the subject site, and to identify any areas where wind conditions may interfere with certain pedestrian activities so that mitigation measures may be considered, as required.

The study involves simulation of wind speeds for selected wind directions in a three-dimensional (3D) computer model using the computational fluid dynamics (CFD) technique, combined with meteorological data integration, to assess pedestrian wind comfort and safety within and surrounding the subject site according to City of Ottawa wind comfort and safety criteria. The results and recommendations derived from these considerations are detailed in the main body of the report (Section 5), illustrated in Figures 3A-5B, and summarized as follows:

- 1) Conditions around the subject site at grade level, including along sidewalks and walkways, within the courtyard at the north of the building, along the loading aisle, at the bus stop to the immediate west of the building, and in the immediate vicinity of all building entrances, will be acceptable for their intended uses throughout the year.
- 2) Wind conditions within the common amenity terrace at Level 10 will be mostly suitable for sitting during the summer. A small area (less than 5% of the terrace) will be suitable for standing. We recommend that these conditions be considered acceptable.
- 3) Within the context of typical weather patterns, which exclude anomalous localized storm events such as tornadoes and downbursts, no pedestrian areas surrounding the subject site at grade level or within the common amenity terrace were found to experience conditions that could be considered uncomfortable or dangerous.
- 4) Regarding primary and secondary building access points, wind conditions predicted in this study are only applicable to pedestrian comfort and safety. As such, the results should not be construed to indicate wind loading on doors and associated hardware.



TABLE OF CONTENTS

1. INTRODUCTION 1

2. TERMS OF REFERENCE 1

3. OBJECTIVES 2

4. METHODOLOGY..... 3

4.1 Computer-Based Context Modelling 3

4.2 Wind Speed Measurements 3

4.3 Meteorological Data Analysis..... 4

4.4 Pedestrian Comfort and Safety Criteria – City of Ottawa 6

5. RESULTS AND DISCUSSION 8

5.1 Wind Comfort Conditions – Grade Level..... 8

5.2 Wind Comfort Conditions – Common Amenity Terrace 9

5.3 Applicability of Results..... 10

6. CONCLUSIONS AND RECOMMENDATIONS..... 10

FIGURES

APPENDICES

Appendix A – Simulation of the Atmospheric Boundary Layer



1. INTRODUCTION

Gradient Wind Engineering Inc. (Gradient Wind) was retained by Richmond Churchill Limited Partnership to undertake a pedestrian level wind (PLW) study to satisfy the requirements for a joint zoning by-law amendment and site plan control application submission for a proposed development located at 327 Richmond Road in Ottawa, Ontario (hereinafter referred to as “subject site”). Our mandate within this study is to investigate pedestrian wind comfort and safety within and surrounding the subject site, and to identify any areas where wind conditions may interfere with certain pedestrian activities so that mitigation measures may be considered, as required.

Our work is based on industry standard computer simulations using the computational fluid dynamics (CFD) technique and data analysis procedures, City of Ottawa wind comfort and safety criteria, architectural drawings provided by Hobin Architecture Inc. in March 2020, surrounding street layouts and existing and approved future building massing information obtained from the City of Ottawa, as well as recent satellite imagery via Google Earth Pro.

2. TERMS OF REFERENCE

The subject site is located at 327 Richmond Road in Ottawa on a parcel of land bordered by Richmond Road to the south, Churchill Avenue North to the west, Winona Avenue to the east, and Whitby Avenue to the north.

The proposed development comprises a 9-storey (plus mechanical penthouse) building, with a ‘C’-shaped planform at grade encircling a courtyard at the north end of the subject site. At grade, the entrance at the southwest corner is recessed, creating an overhang. A patio is located at the southwest corner. The ground floor comprises a mixed-use lobby, access to the underground parking from the northwest corner, a loading/move-in bay, a mailroom, and retail space. Levels 2 and above comprise residential units. At the second level, the building steps



*Rendering, Southwest Perspective
(Courtesy of Hobin Architecture)*



back from the west elevation, as well as from the south wall of the courtyard, revealing private terraces. The building steps back again from the south and east elevations at Level 4, and from the east side of the north elevation at Levels 5, 6, and 7. At Level 8 the building steps back from all sides. A common amenity terrace is located on Level 10.

The primary residential entrance is located at the southwest corner, while retail entrances are located along the east, south, and west elevations. Entrances are also located from within the courtyard. Patio/café space is planned within the courtyard and at the southeast corner of the building. A bus stop is located near the southwest corner of the building, on the east side of Churchill Avenue North.

The near-field surroundings (defined as an area within a radius of 200 metres (m) of the subject site) comprise low-rise residential and commercial buildings in all directions. The far-field surroundings (defined as an area beyond the near-field but within a 5 kilometer (km) radius of the subject site) contribute primarily suburban wind exposures, with isolated taller buildings to the west, north and northeast. The Ottawa Experimental Farm to the southeast and the Ottawa River from the west clockwise to the northeast serve to create slightly more open exposures from these directions.

Key areas under consideration for pedestrian wind comfort include surrounding sidewalks, walkways, building access points, and nearby transit stops. Figure 1 illustrates the subject site and surrounding context, while Figures 2A-2D illustrate the computational model used to conduct the study.

3. OBJECTIVES

The principal objectives of this study are to (i) determine pedestrian level wind comfort and safety conditions at key areas within and surrounding the development site; (ii) identify areas where wind conditions may interfere with the intended uses of outdoor spaces; and (iii) recommend suitable mitigation measures, where required.

4. METHODOLOGY

The approach followed to quantify pedestrian wind conditions over the site is based on CFD simulations of wind speeds across the study site within a virtual environment, meteorological analysis of the Ottawa area wind climate, and synthesis of computational data with City of Ottawa wind comfort and safety criteria¹. The following sections describe the analysis procedures, including a discussion of the noted pedestrian wind criteria.

4.1 Computer-Based Context Modelling

A computer based PLW study was performed to determine the influence of the wind environment on pedestrian comfort over the proposed development site. Pedestrian comfort predictions, based on the mechanical effects of wind, were determined by combining measured wind speed data from CFD simulations with statistical weather data obtained from Ottawa Macdonald-Cartier International Airport.

The general concept and approach to CFD modelling is to represent building and topographic details in the immediate vicinity of the study site on the surrounding model, and to create suitable atmospheric wind profiles at the model boundary. The wind profiles are designed to have similar mean and turbulent wind properties consistent with actual site exposures.

An industry standard practice is to omit trees, vegetation, and other existing and planned landscape elements from the model due to the difficulty of providing accurate seasonal representation of vegetation. The omission of trees and other landscaping elements produces slightly more conservative (i.e., windier) wind speed values.

4.2 Wind Speed Measurements

The PLW analysis was performed by simulating wind flows and gathering velocity data over a CFD model of the site for 12 wind directions. The CFD simulation model was centered on the study building, complete with surrounding massing within a diameter of approximately 820 m. Mean and peak wind speed data obtained over the study site for each wind direction were interpolated to 36 wind directions at 10° intervals, representing the full compass azimuth. Measured wind speeds approximately 1.5 m above local

¹ City of Ottawa Terms of References: Wind Analysis
https://documents.ottawa.ca/sites/default/files/torwindanalysis_en.pdf


grade and the rooftop amenity terraces were referenced to the wind speed at gradient height to generate mean and peak velocity ratios, which were used to calculate full-scale values. Gradient height represents the theoretical depth of the boundary layer of the earth's atmosphere, above which the mean wind speed remains constant. Further details of the wind flow simulation technique are presented in Appendix A.

4.3 Meteorological Data Analysis

A statistical model for winds in Ottawa was developed from approximately 40 years of hourly meteorological wind data recorded at Ottawa Macdonald-Cartier International Airport and obtained from Environment and Climate Change Canada. Wind speed and direction data were analyzed for each month of the year in order to determine the statistically prominent wind directions and corresponding speeds, and to characterize similarities between monthly weather patterns. Based on this portion of analysis, the four seasons are represented by grouping data from consecutive months based on similarity of weather patterns, and not according to the traditional calendar method. The winter season is defined as December-March, spring as April-May, summer as June-September, and autumn as October-November.

The statistical model of the Ottawa area wind climate, which indicates the directional character of local winds on a seasonal basis, is illustrated on the following page. The plots illustrate seasonal distribution of measured wind speeds and directions in kilometers per hour (km/h). Probabilities of occurrence of different wind speeds are represented as stacked polar bars in sixteen azimuth divisions. The radial direction represents the percentage of time for various wind speed ranges per wind direction during the measurement period. The preferred wind speeds and directions can be identified by the longer length of the bars. For Ottawa, the most common winds occur for westerly wind directions, followed by those from the east, while the most common wind speeds are below 36 km/h. The directional preference and relative magnitude of wind speed changes somewhat from season to season.

SEASONAL DISTRIBUTION OF WIND OTTAWA MACDONALD-CARTIER INTERNATIONAL AIRPORT

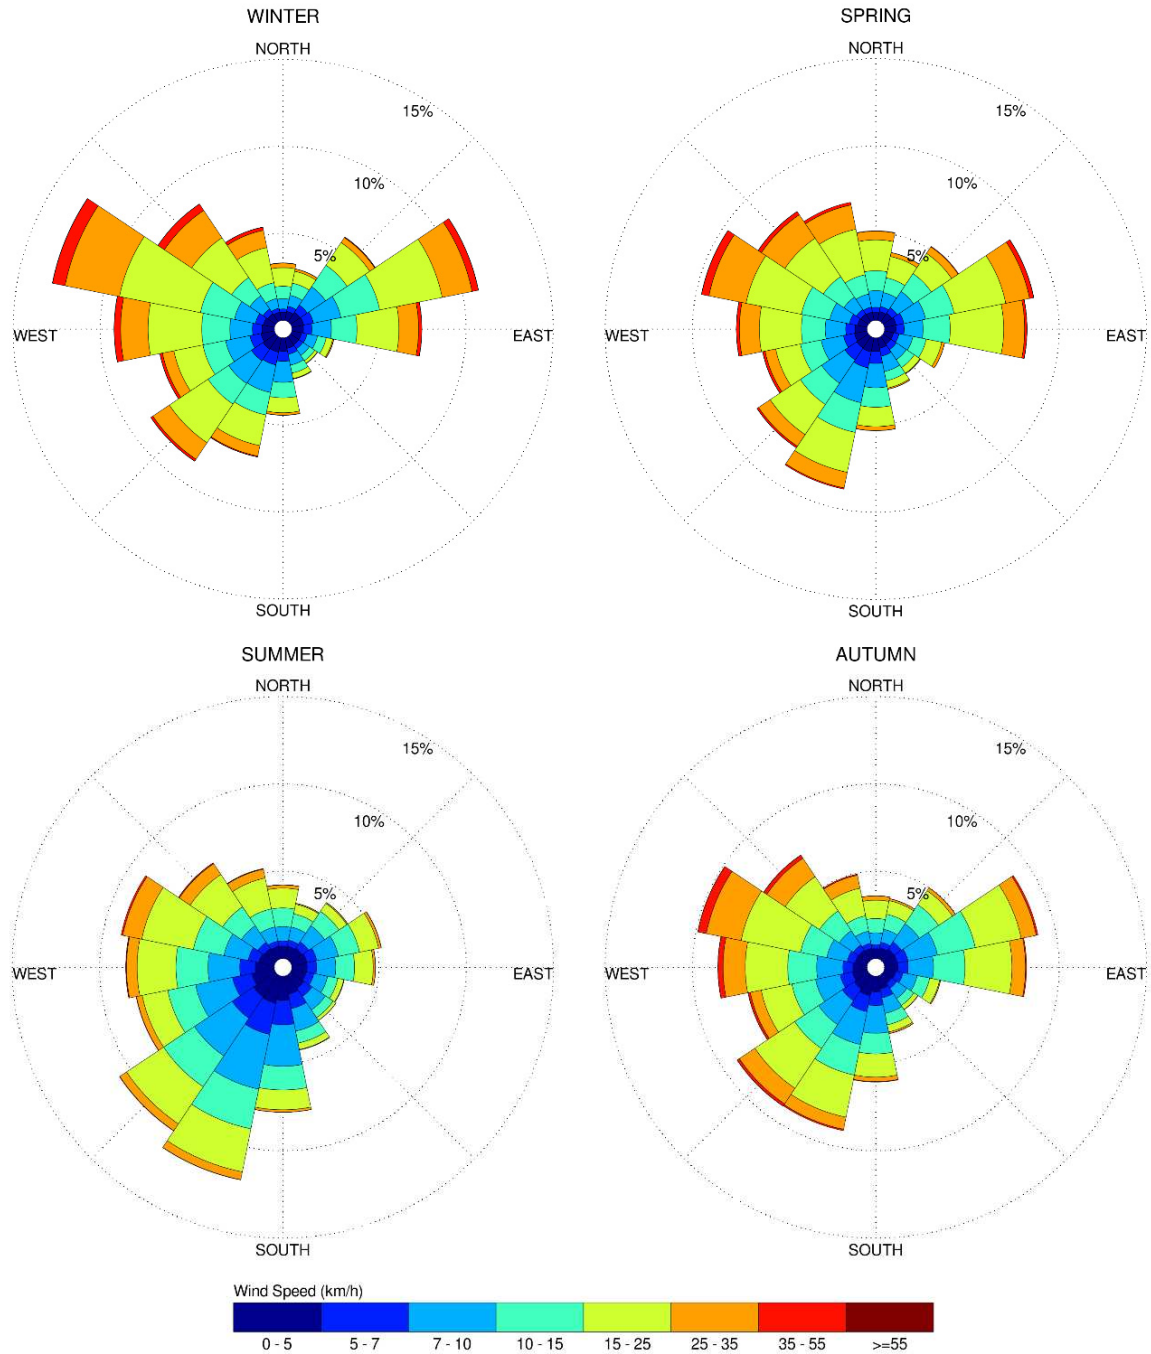

Notes:

1. Radial distances indicate percentage of time of wind events.
2. Wind speeds are mean hourly in km/h, measured at 10 m above the ground.

4.4 Pedestrian Comfort and Safety Criteria – City of Ottawa

Pedestrian comfort and safety criteria are based on the mechanical effects of wind without consideration of other meteorological conditions (i.e., temperature, relative humidity). The comfort criteria assume that pedestrians are appropriately dressed for a specified outdoor activity during any given season. Five pedestrian comfort classes are based on 80% non-exceedance mean wind speed ranges, which include (1) Sitting; (2) Standing; (3) Strolling; (4) Walking; and (5) Uncomfortable. More specifically, the comfort classes and associated mean wind speed ranges are summarized as follows:

- 1) **Sitting:** Mean wind speeds no greater than 10 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 16 km/h.
- 2) **Standing:** Mean wind speeds no greater than 14 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 22 km/h.
- 3) **Strolling:** Mean wind speeds no greater than 17 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 27 km/h.
- 4) **Walking:** Mean wind speeds no greater than 20 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 32 km/h.
- 5) **Uncomfortable:** Uncomfortable conditions are characterized by predicted values that fall below the 80% target for walking. Brisk walking and exercise, such as jogging, would be acceptable for moderate excesses of this criterion.

The pedestrian safety wind speed criterion is based on the approximate threshold that would cause a vulnerable member of the population to fall. A 0.1% exceedance gust wind speed of 90 km/h is classified as dangerous. The gust speeds, and equivalent mean speeds, are selected based on ‘The Beaufort Scale’, presented on the following page, which describes the effects of forces produced by varying wind speed levels on objects. Gust speeds are included because pedestrians tend to be more sensitive to wind gusts than to steady winds for lower wind speed ranges. For strong winds approaching dangerous levels, this effect is less important because the mean wind can also create problems for pedestrians. The mean gust speed ranges are selected based on ‘The Beaufort Scale’, which describes the effect of forces produced by varying wind speeds on levels on objects.

THE BEAUFORT SCALE

Number	Description	Wind Speed (km/h)	Description
2	Light Breeze	6-11	Wind felt on faces
3	Gentle Breeze	12-19	Leaves and small twigs in constant motion; Wind extends light flags
4	Moderate Breeze	20-28	Wind raises dust and loose paper; Small branches are moved
5	Fresh Breeze	29-38	Small trees in leaf begin to sway
6	Strong Breeze	39-49	Large branches in motion; Whistling heard in electrical wires; Umbrellas used with difficulty
7	Moderate Gale	50-61	Whole trees in motion; Inconvenient walking against wind
8	Gale	62-74	Breaks twigs off trees; Generally impedes progress

Experience and research on people’s perception of mechanical wind effects has shown that if the wind speed levels are exceeded for more than 80% of the time, the activity level would be judged to be uncomfortable by most people. For instance, if a mean wind speed of 10 km/h (gust equivalent mean wind speed of 16 km/h) was exceeded for more than 20% of the time most pedestrians would judge that location to be too windy for sitting. Similarly, if mean wind speed of 20 km/h (gust equivalent mean wind speed of 32 km/h) at a location were exceeded for more than 20% of the time, walking or less vigorous activities would be considered uncomfortable. As most of these criteria are based on subjective reactions of a population to wind forces, their application is partly based on experience and judgment.

Once the pedestrian wind speed predictions have been established at tested locations, the assessment of pedestrian comfort involves determining the suitability of the predicted wind conditions for their associated spaces. This step involves comparing the predicted comfort class to the desired comfort class, which is dictated by the location type represented by the sensor (i.e., a sidewalk, building entrance, amenity space, or other). An overview of common pedestrian location types and their desired comfort classes are summarized on the following page.

DESIRED PEDESTRIAN COMFORT CLASSES FOR VARIOUS LOCATION TYPES

Location Types	Desired Comfort Classes
Primary Building Entrance	Standing
Secondary Building Access Point	Walking
Primary Public Sidewalk	Strolling / Walking
Secondary Public Sidewalk / Bicycle Path	Walking
Outdoor Amenity Space	Sitting / Standing / Strolling
Café / Patio / Bench / Garden	Sitting
Transit Stop	Sitting / Standing
Public Park / Plaza	Standing / Strolling
Garage / Service Entrance	Walking
Parking Lot	Strolling / Walking
Vehicular Drop-Off Zone	Standing / Strolling / Walking

5. RESULTS AND DISCUSSION

The following discussion of predicted pedestrian wind conditions is accompanied by Figures 3A-3D (following the main text) illustrating the seasonal wind conditions at grade level, and Figures 4A-4D illustrating the seasonal wind conditions within the common amenity terraces. The colour contours indicate various comfort classes predicted for certain regions. Wind conditions comfortable for sitting or more sedentary activities are represented by the colour green, standing are represented by yellow, strolling by orange, walking by blue, while uncomfortable conditions are represented by the colour magenta. Pedestrian wind comfort is summarized below for each area of interest. In addition, Figures 5A and 5B illustrate the percentage of time the areas at grade and within the elevated amenity terraces, respectively, will be suitable for sitting during the summer season.

5.1 Wind Comfort Conditions – Grade Level

Sidewalks Surrounding Subject Site: The sidewalks on the east, west, and south sides of the building will be mostly suitable for sitting during the summer, with small areas near the southwest corner of the building predicted to be suitable for standing. During the colder seasons, the sidewalks will be suitable for a mix of sitting and standing, with standing conditions predicted near the building corners and calmer



conditions near the centre of the east, south and west façades. These conditions are considered acceptable according to the comfort criteria in Section 4.4.

Courtyard Amenity Area: The courtyard amenity area within the subject site will be suitable for sitting during throughout the year, which is acceptable.

Grade Level Patio, Southwest Corner: The patio at the southwest corner of the subject site will be suitable for sitting during the summer, becoming suitable for a mix of sitting and standing during the remaining seasons. These conditions are considered acceptable.

Bus Stop: The bus stop to the west of the subject site will be suitable for sitting during the spring, summer, and autumn, and suitable for a mix of sitting and standing during the winter. These conditions are considered acceptable.

Loading Aisle, Northeast of Site: The loading aisle will be suitable for sitting during the spring, summer, and autumn, and suitable for a mix of sitting and standing during the winter. These conditions are considered acceptable.

Building Entrances: All building entrances will be suitable for sitting year-round, which is acceptable.

5.2 Wind Comfort Conditions – Common Amenity Terrace

Level 10 Terrace: Wind conditions within the common amenity terrace will be suitable for sitting during the summer season, with a small area (less than 5% of the terrace area) at the southeast corner suitable for standing. Figure 5B illustrates that this area will be suitable for sitting at least 75% of the time during the summer season. During the autumn, the terrace will be suitable for a mix of sitting and standing, while small areas will develop conditions suitable for strolling during the remaining colder months of the year.

Given that over 95% of the terrace area will be suitable for sitting during the summer, we recommend that these conditions be considered acceptable. If calmer conditions are desired, or if sitting conditions are desired to extend into the late spring and early autumn months, we recommend installing 1.5 m tall wind barriers around the perimeter of the terrace, in place of standard height guardrails.

5.3 Applicability of Results


Pedestrian wind comfort and safety have been quantified for the specific configuration of existing and foreseeable construction around the subject site. Future changes (i.e., construction or demolition) of these surroundings may cause changes to the wind effects in two ways, namely: (i) changes beyond the immediate vicinity of the site would alter the wind profile approaching the site; and (ii) development in proximity to the site would cause changes to local flow patterns. More specifically, development in built-up areas generally creates reduction in the mean wind and localized increases in the gustiness of the wind, which often results in improved wind comfort levels.

Regarding primary and secondary building access points, wind conditions predicted in this study are only applicable to pedestrian comfort and safety. As such, the results should not be construed to indicate wind loading on doors and associated hardware.

6. CONCLUSIONS AND RECOMMENDATIONS

A complete summary of the predicted wind comfort and safety conditions is provided in Section 5 and illustrated in Figures 3A-5B. Based on computer simulations using the CFD technique, meteorological data analysis of the Ottawa wind climate, City of Ottawa wind comfort and safety criteria, and experience with similar developments in Ottawa, we conclude the following:

- 1) Conditions around the subject site at grade level, including along sidewalks and walkways, within the courtyard at the north of the building, along the loading aisle, at the bus stop to the immediate west of the building, and in the immediate vicinity of all building entrances, will be acceptable for their intended uses throughout the year.
- 2) Wind conditions within the common amenity terrace at Level 10 will be mostly suitable for sitting during the summer. A small area (less than 5% of the terrace) will be suitable for standing. We recommend that these conditions be considered acceptable.
- 3) Within the context of typical weather patterns, which exclude anomalous localized storm events such as tornadoes and downbursts, no pedestrian areas surrounding the subject site at grade level or within the common amenity terrace were found to experience conditions that could be considered uncomfortable or dangerous.




GRADIENTWIND
ENGINEERS & SCIENTISTS

This concludes our pedestrian level wind study and report.

Sincerely,


Gradient Wind Engineering Inc.




Sacha Ruzzante, MAsc.
Junior Wind Scientist



Justin Ferraro, P.Eng.
Principal



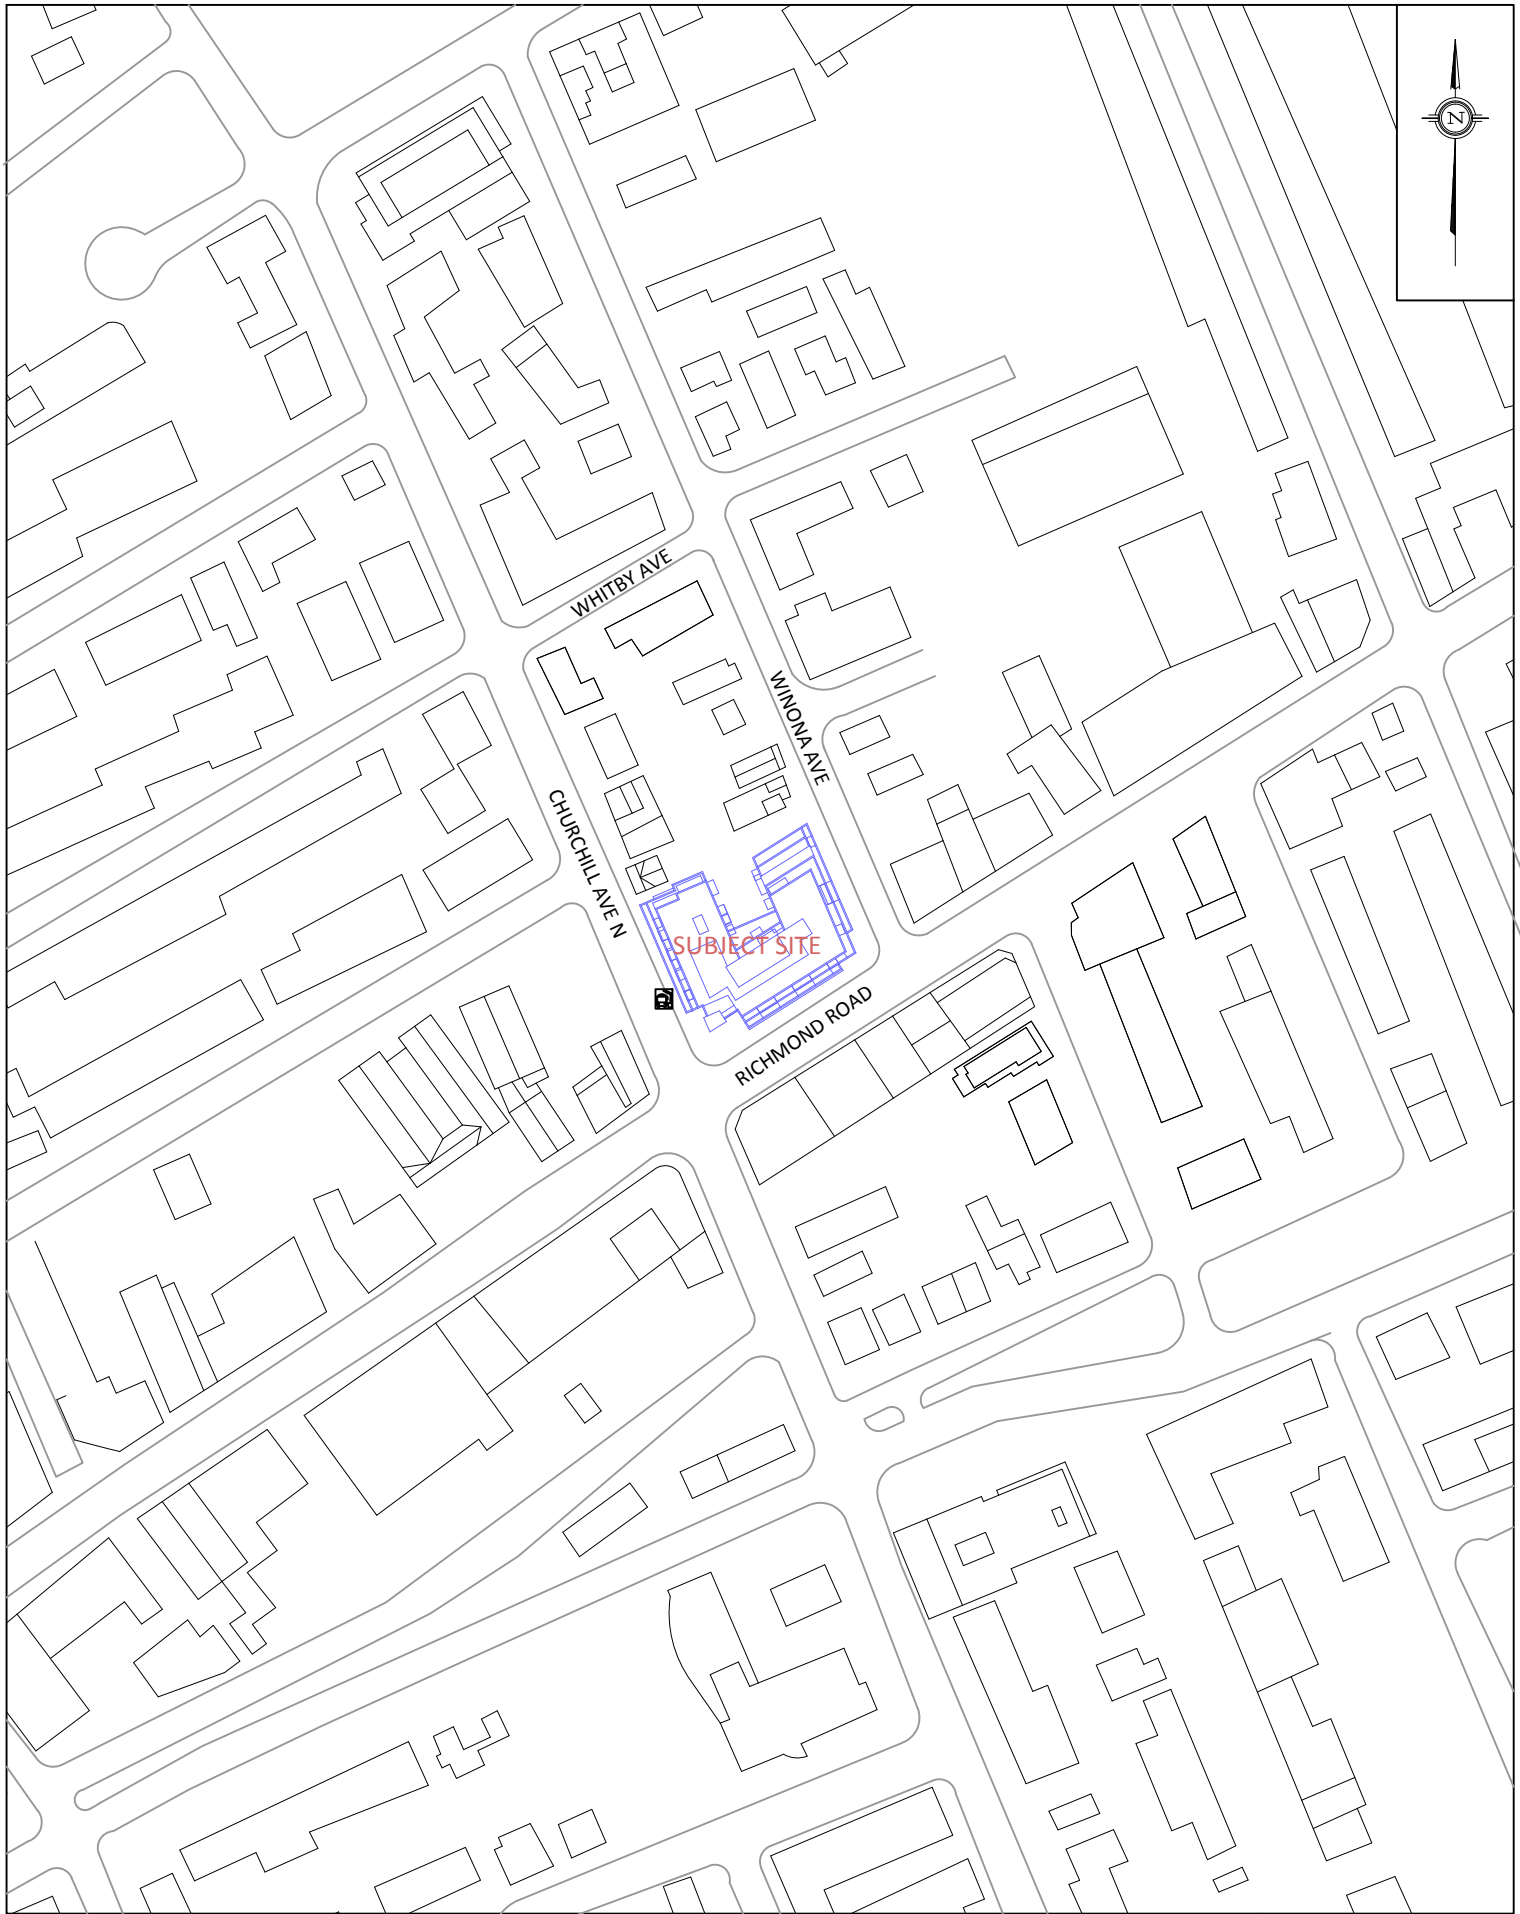

PROJECT	327 RICHMOND ROAD, OTTAWA PEDESTRIAN LEVEL WIND STUDY	
SCALE	1:2500	DRAWING NO. 20-053-PLW-1
DATE	MAY 14, 2020	DRAWN BY S.R.

DESCRIPTION	FIGURE 1: SITE PLAN AND SURROUNDING CONTEXT
-------------	--



FIGURE 2A: COMPUTATIONAL MODEL, NORTH PERSPECTIVE

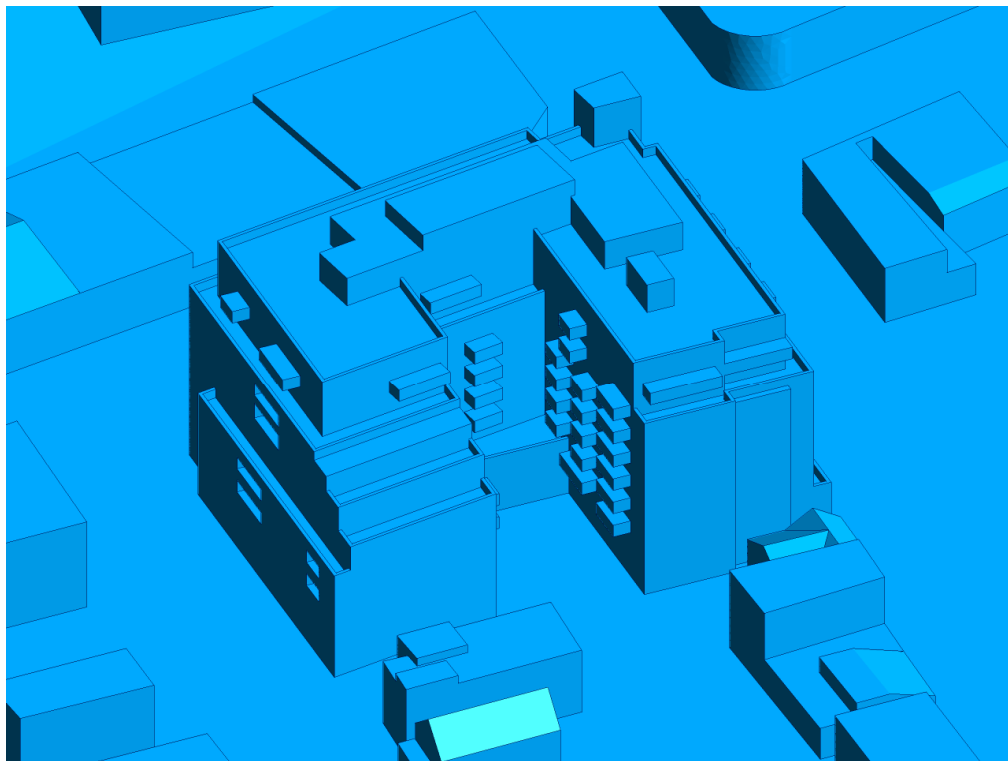


FIGURE 2B: CLOSE UP OF FIGURE 2A



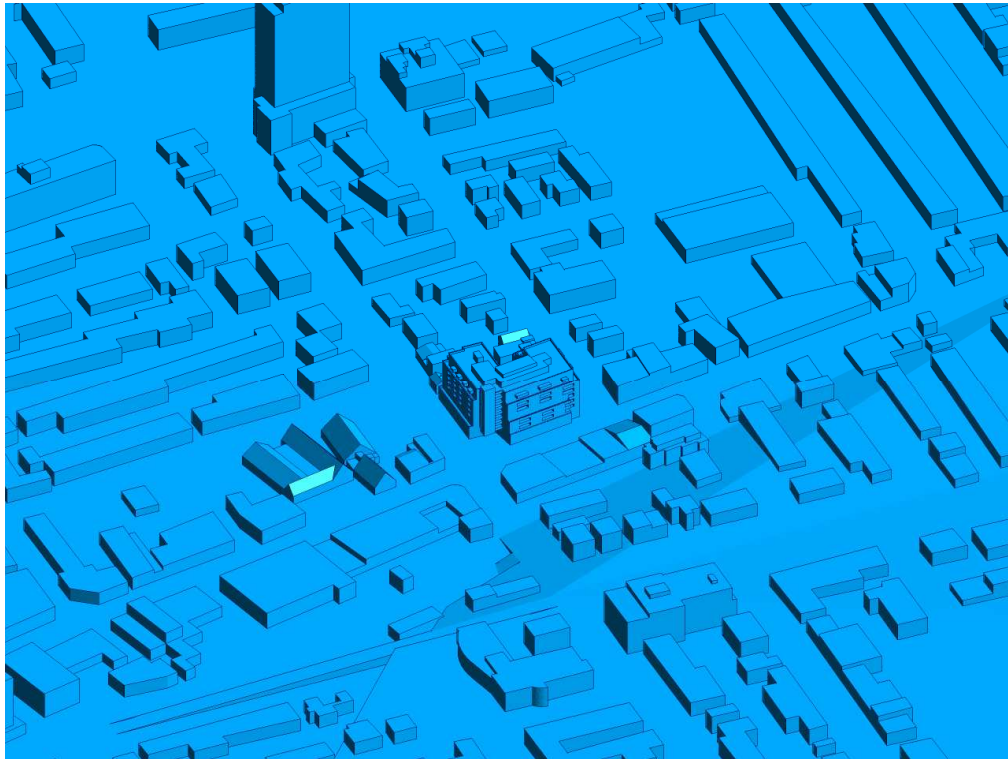


FIGURE 2C: COMPUTATIONAL MODEL, SOUTHWEST PERSPECTIVE

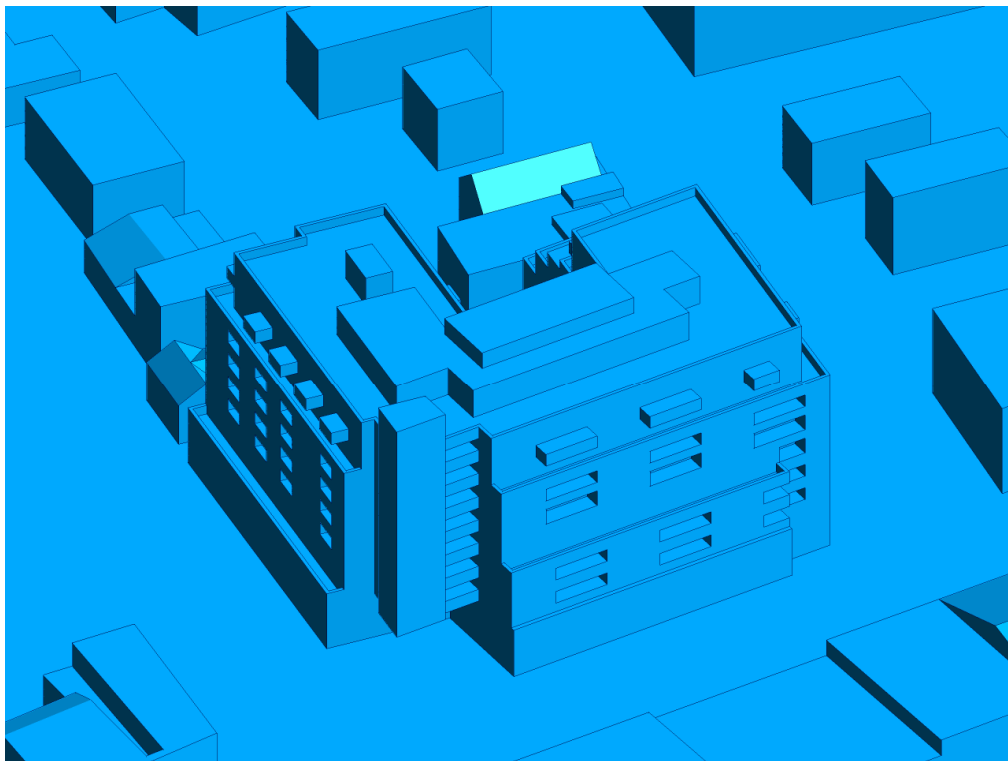


FIGURE 2D: CLOSE UP OF FIGURE 2C





FIGURE 3A: SPRING – WIND CONDITIONS AT GRADE LEVEL



FIGURE 3B: SUMMER – WIND CONDITIONS AT GRADE LEVEL





FIGURE 3C: AUTUMN – WIND CONDITIONS AT GRADE LEVEL

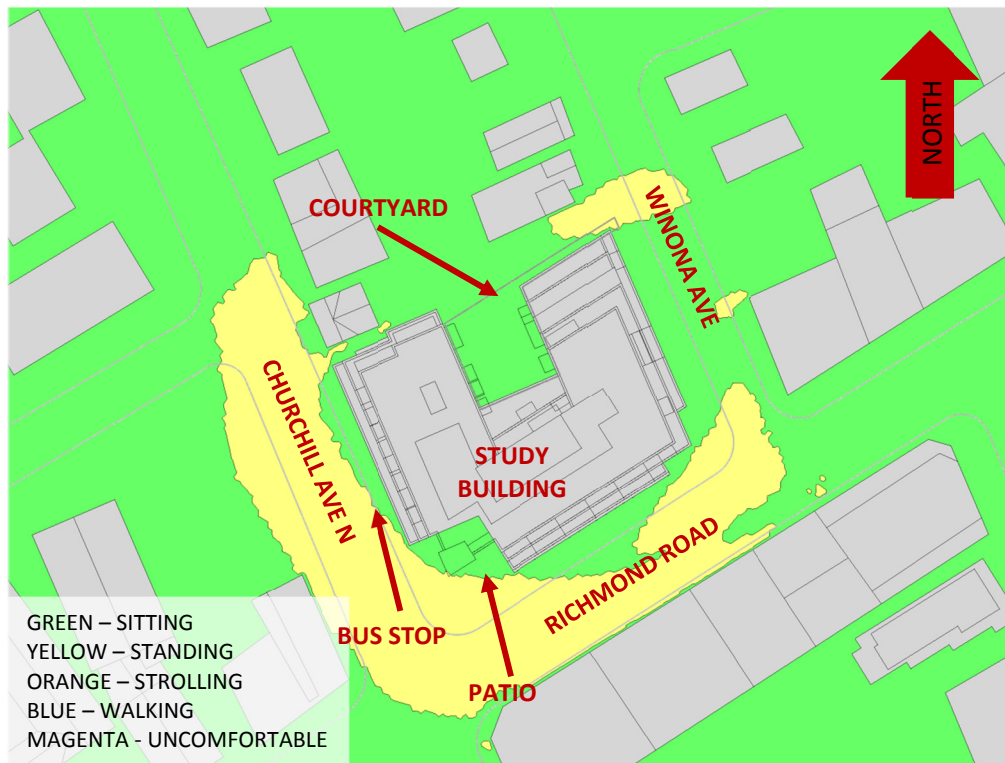


FIGURE 3D: WINTER – WIND CONDITIONS AT GRADE LEVEL





FIGURE 4A: SPRING – WIND CONDITIONS WITHIN COMMON AMENITY TERRACES



FIGURE 4B: SUMMER – WIND CONDITIONS WITHIN COMMON AMENITY TERRACES



FIGURE 4C: AUTUMN – WIND CONDITIONS WITHIN COMMON AMENITY TERRACES



FIGURE 4D: WINTER – WIND CONDITIONS WITHIN COMMON AMENITY TERRACES

GRADIENTWIND

ENGINEERS & SCIENTISTS

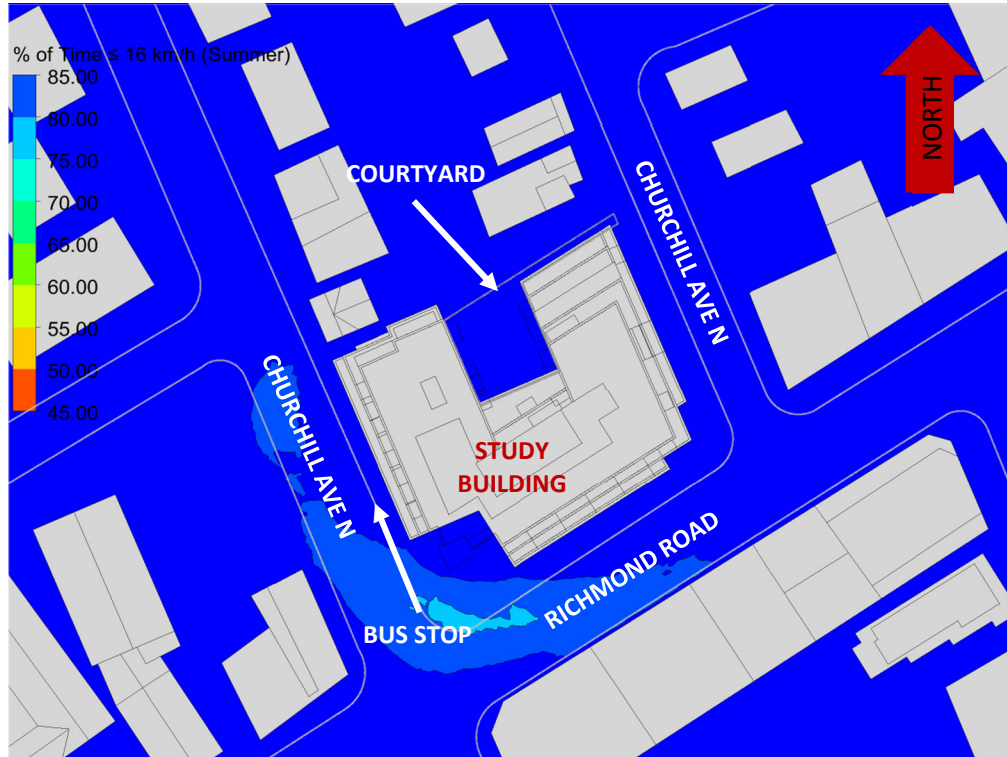


FIGURE 5A: SUMMER – PERCENTAGE OF TIME SUITABLE FOR SITTING (GRADE)


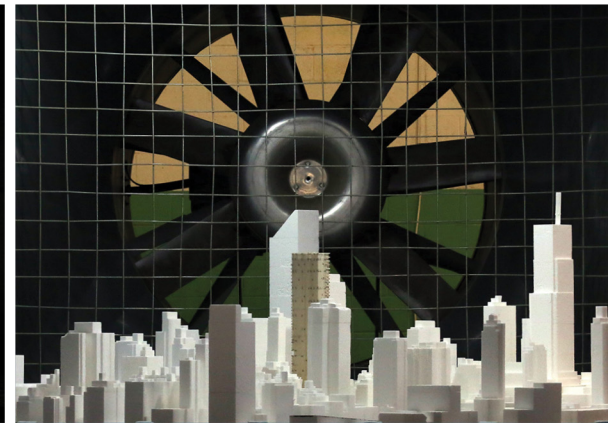


FIGURE 5B: SUMMER – PERCENTAGE OF TIME SUITABLE FOR SITTING (TERRACES)



GRADIENTWIND

ENGINEERS & SCIENTISTS

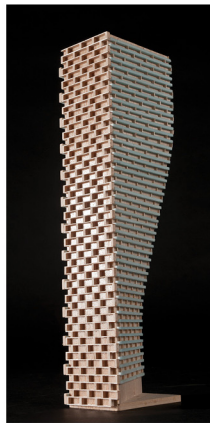

APPENDIX A

SIMULATION OF THE ATMOSPHERIC BOUNDARY LAYER

SIMULATION OF THE ATMOSPHERIC BOUNDARY LAYER

The atmospheric boundary layer (ABL) is defined by the velocity and turbulence profiles according to industry standard practices. The mean wind profile can be represented, to a good approximation, by a power law relation, Equation (1), giving height above ground versus wind speed [1], [2].

$$U = U_g \left(\frac{Z}{Z_g} \right)^\alpha \quad \text{Equation (1)}$$

where, U = mean wind speed, U_g = gradient wind speed, Z = height above ground, Z_g = depth of the boundary layer (gradient height), and α is the power law exponent.

For the model, U_g is set to 6.5 metres per second (m/s), which approximately corresponds to the 60% mean wind speed for Ottawa based on historical climate data and statistical analyses. When the results are normalized by this velocity, they are relatively insensitive to the selection of gradient wind speed.

Z_g is set to 540 m. The selection of gradient height is relatively unimportant, so long as it exceeds the building heights surrounding the subject site. The value has been selected to correspond to our physical wind tunnel reference value.

α is determined based on the upstream exposure of the far-field surroundings (i.e., the area that it not captured within the simulation model).

Table 1 presents the values of α used in this study, while Table 2 presents several reference values of α . When the upstream exposure of the far-field surroundings is a mixture of multiple types of terrain, the α values are a weighted average with terrain that is closer to the subject site given greater weight.

TABLE 1: UPSTREAM EXPOSURE (ALPHA VALUE) VS TRUE WIND DIRECTION

Wind Direction (° True)	Alpha (α) Value
0	0.21
49	0.24
74	0.24
103	0.22
167	0.24
197	0.24
217	0.24
237	0.21
262	0.19
282	0.20
302	0.21
324	0.21

TABLE 2: DEFINITION OF UPSTREAM EXPOSURE (ALPHA VALUE)

Upstream Exposure Type	α
Open Water	0.14-0.15
Open Field	0.16-0.19
Light Suburban	0.21-0.24
Heavy Suburban	0.24-0.27
Light Urban	0.28-0.30
Heavy Urban	0.31-0.33

The turbulence model in the computational fluid dynamics (CFD) simulations is a two-equation shear-stress transport (SST) model, and thus the ABL turbulence profile requires that two parameters be defined at the inlet of the domain. The turbulence profile is defined following the recommendations of the Architectural Institute of Japan for flat terrain [3].

$$I(Z) = \begin{cases} 0.1 \left(\frac{Z}{Z_g} \right)^{-\alpha-0.05}, & Z > 10 \text{ m} \\ 0.1 \left(\frac{10}{Z_g} \right)^{-\alpha-0.05}, & Z \leq 10 \text{ m} \end{cases} \quad \text{Equation (2)}$$

$$L_t(Z) = \begin{cases} 100 \text{ m} \sqrt{\frac{Z}{30}}, & Z > 30 \text{ m} \\ 100 \text{ m}, & Z \leq 30 \text{ m} \end{cases} \quad \text{Equation (3)}$$

where, I = turbulence intensity, L_t = turbulence length scale, Z = height above ground, and α is the power law exponent used for the velocity profile in Equation (1).

Boundary conditions on all other domain boundaries are defined as follows: the ground is a no-slip surface; the side walls of the domain have a symmetry boundary condition; the top of the domain has a specified shear, which maintains a constant wind speed at gradient height; and the outlet has a static pressure boundary condition.

REFERENCES

- [1] P. Arya, "Chapter 10: Near-neutral Boundary Layers," in *Introduction to Micrometeorology*, San Diego, California, Academic Press, 2001.
- [2] S. A. Hsu, E. A. Meindl and D. B. Gilhousen, "Determining the Power-Law Wind Profile Exponent under Near-neutral Stability Conditions at Sea," vol. 33, no. 6, 1994.
- [3] Y. Tamura, H. Kawai, Y. Uematsu, K. Kondo and T. Okhuma, "Revision of AIJ Recommendations for Wind Loads on Buildings," in *The International Wind Engineering Symposium, IWES 2003*, Taiwan, 2003.