



Stormwater Management and Servicing Report

Apartment Building
700 Coronation Avenue
Ottawa, Ontario

Prepared for:

MJ Asset Management Ltd
533 Gilmour St
Ottawa, ON, K1R 5L3

Attention: Mr. Mark Farrell

LRL File No.: 200463

October 2nd, 2020
Rev 1 October 30th, 2020
Rev 2 November 13th, 2020



TABLE OF CONTENTS

1	INTRODUCTION AND SITE DESCRIPTION.....	1
2	EXISTING SITE AND DRAINAGE DESCRIPTION.....	2
3	SCOPE OF WORK.....	2
4	REGULATORY APPROVALS.....	3
5	WATER SUPPLY AND FIRE PROTECTION.....	3
5.1	Existing Water Supply Services and Fire Hydrant Coverage.....	3
5.2	Water Supply Servicing Design	3
6	SANITARY SERVICE.....	5
6.1	Existing Sanitary Sewer Services.....	5
6.2	Sanitary Sewer Servicing Design	6
7	STORMWATER MANAGEMENT	6
7.1	Existing Stormwater Infrastructure	6
7.2	Design Criteria	6
7.2.1	Water Quality.....	6
7.2.2	Water Quantity	6
7.3	Method of Analysis	7
7.4	Proposed Stormwater Quantity Controls.....	7
8	EROSION AND SEDIMENT CONTROL.....	9
9	CONCLUSION.....	9
10	REPORT CONDITIONS AND LIMITATIONS.....	10



APPENDICES

Appendix A	Pre-consultation / Correspondence
Appendix B	Water Supply Calculations
Appendix C	Wastewater Collection Calculation
Appendix D	Stormwater Management Calculations LMF ICD Curves Tempest Inlet Control Devices Technical Manual Watts Roof Drain Specification
Appendix E	Civil Engineering Drawings
Drawings/Figures	Proposed Site Plan Legal Survey As-built

LIST OF TABLES

Table 1: City of Ottawa Design Guidelines Design Parameters.....	3
Table 2: Development Residential Population Estimate	4
Table 3: Summary of Boundary Conditions	4
Table 4: Fire Protection Summary Table	5
Table 5: Drainage Areas	8
Table 6: Stormwater Release Rate & Storage Volume Summary (100 Year).....	9

LIST OF FIGURES

Figure 1 – Arial View of Proposed Development	1
--	----------



1 INTRODUCTION AND SITE DESCRIPTION

LRL Associates Ltd. was retained by MJ Asset Management Ltd to complete a Stormwater Management Analysis and Servicing Brief for a proposed four (4) storey residential building addition located at 700 Coronation Avenue in Ottawa, Ontario. The legal description of the property is Part Block F (part 1 and 4 Plan 5R-7688) registered plan **605**, City of Ottawa. Under the Zoning By-law 2008-250 the site is zoned R4N (Residential Fourth Density Zone).



Figure 1: Aerial View of Proposed Development

The subject site at 700 Coronation Avenue has approximately 56 metres of frontage along Coronation Avenue and a maximum depth of approximately 67 metres. The west property line has greater depth than east property line (measured at 51 metres) and the overall lot area is **0.34 ha**.

The topographic survey of the subject property was completed by Farley, Smith & Denis Surveying Ltd. (Ontario Land Surveyors). The established site benchmark with elevation 75.18 is located at the northeastern corner of the site at the bottom lid of the light standard, refer to the **Legal Survey** included in **Drawings/Figures**.

The development proposes a new four (4) storey residential building addition on the west side of the subject site consisting of (35) units. Underground parking is also proposed to accommodate total parking demand for the proposed and existing building.

This report has been prepared in consideration of the terms and conditions noted above and with the civil drawings prepared for the new development. Should there be any changes in the design



features, which may relate to the stormwater considerations, LRL Associates Ltd. should be advised to review the report recommendations.

2 EXISTING SITE AND DRAINAGE DESCRIPTION

The subject site measures **0.34 ha** and currently consists of a three (3) storey residential rental apartment building composed of 30 units on the east side of subject site. The west side of the subject site consists of a paved surface parking lot, with access provided from Coronation Avenue, and landscaping around the perimeter of the site. Elevations of existing site range between 74.12 m at north to 75.20 m at the south side of the site.

Sewer and watermain mapping, along with as-built information collected from the City of Ottawa indicate the following existing infrastructure located within the adjacent right-of-way:

Coronation Avenue:

- 305 mm diameter PVC watermain
- 229 mm diameter concrete sanitary sewer
- 675 mm diameter concrete storm sewer

There are no storm sewers currently existing across the subject site's frontage along Coronation Avenue right-of-way.

3 SCOPE OF WORK

As per applicable guidelines, the scope of work includes the following:

Stormwater management

- Calculate the allowable stormwater release rate.
- Calculate the anticipated post-development stormwater release rates.
- Demonstrate how the target quantity objectives will be achieved.

Water services

- Calculate the expected water supply demand at average and peak conditions.
- Calculate the required fire flow as per the Fire Underwriters Survey (FUS) method.
- Confirm the adequacy of water supply and pressure during peak flow and fire flow.
- Describe the proposed water distribution network and connection to the existing system.

Sanitary services

- Describe the existing sanitary sewers available to receive wastewater from the building.
- Calculate peak flow rates from the development.
- Describe the proposed sanitary sewer system.
- Review impact of increased sanitary flow on downstream sanitary sewer.



4 REGULATORY APPROVALS

An MECP Environmental Compliance Approval is expected to be required for extension of the existing storm sewer within Coronation Avenue right-of-way. A Permit to Take Water is not anticipated to be required for pumping requirements for sewer installation. The Rideau Valley Conservation Authority will need to be consulted in order to obtain municipal approval for site development. No other approval requirements from other regulatory agencies are anticipated.

5 WATER SUPPLY AND FIRE PROTECTION

5.1 Existing Water Supply Services and Fire Hydrant Coverage

The subject property lies within the City of Ottawa 1E water distribution network pressure zone. An existing 305 mm dia. watermain exists across the subject site within the Coronation Avenue right-of-way.

5.2 Water Supply Servicing Design

The subject property is proposed to be serviced via 150 mm diameter service lateral connected to the 305 mm watermain located within Coronation Avenue. Refer to Site Servicing Plan C.401 in **Appendix E** for servicing layout.

Table 1 below summarizes the City of Ottawa Design Guidelines design parameters employed in the preparation of the water demand estimate.

Table 1: City of Ottawa Design Guidelines Design Parameters

Design Parameter	Value
Residential Bachelor / 1 Bedroom Apartment	1.4 P/unit
Residential 2 Bedroom Apartment	2.1 P/unit
Average Daily Demand	280 L/d/per
Minimum Depth of Cover	2.4 m from top of watermain to finished grade
Desired operating pressure range during normal operating conditions	350 kPa and 480 kPa
During normal operating conditions pressure must not drop below	275 kPa
During normal operating conditions pressure shall not exceed	552 kPa
During fire flow operating conditions pressure must not drop below	140 kPa

**Table updated to reflect technical Bulletin ISDTB-2018-02*

Based on the interior layout and architectural floor plans, it was determined that the building will house twenty (20) studio/1-bedroom apartments, and fifteen (15) 2-bedroom units. Based on the City of Ottawa Design guidelines for population projection, this translates to approximately 59.5 residents. **Table 2** below summarizes the proposed development as interpreted using table 4.1 of the City of Ottawa Design Guidelines.



Table 2: Development Residential Population Estimate

Proposed Unit type	Persons Per Unit	Number of Units	Population
Studio/1 Bedroom	1.4	20	28
2 Bedroom Apartment	2.1	15	31.5
Total Residential Population			59.5

The required water supply requirements for the residential units in proposed building have been calculated using the following formula:

Where:

$$Q = (q \times P \times M)$$

q = average water consumption (L/capita/day)

P = design population (capita)

M = Peak factor

Using a calculated Maximum Day Factor and Peak Hour factor of 7.2 and 10.8 respectively as per Table 3-3 in the *MOE Design Guidelines*, anticipated demands were calculated as follows:

- Average daily domestic water demand is **0.19** L/s,
- Maximum daily demand is **1.38** L/s, and
- Maximum hourly is **14.84** L/s.

Refer to **Appendix B** for water demand calculations.

The City of Ottawa was contacted to obtain boundary conditions associated with the estimated water demand, as indicated in the boundary request correspondence included in **Appendix B**. **Table 3** below summarizes boundary conditions for the proposed development.

Table 3: Summary of Anticipated Demands and Boundary Conditions

Design Parameter	Anticipated Demand (L/min)	Boundary Conditions @ Coronation Avenue* (m H ₂ O / kPa)
Average Daily Demand	11.4	118.9 / 441.0
Max Day + Fire Flow (per FUS)	82.8 + 7,000	105.9 / 313.4
Peak Hour	890.4	107.5 / 329.1
*Assumed Ground elevation at connection point = 73.95 m. Water demand calculation per City of Ottawa Water Design guidelines. See Appendix B for details.		

As indicated in Table 3, pressures in all scenarios exceed the minimum required pressure thresholds stated in Table 1 as per City of Ottawa Design Guidelines. Refer to **Appendix B** for Boundary Conditions.



The estimated fire flow for the proposed buildings was calculated in accordance with *ISTB-2018-02*. The following parameters were provided by the Architect, see **Appendix A** for collaborating correspondence:

- Type of construction – Ordinary Construction;
- Occupancy type – Limited Combustibility; and
- Sprinkler Protection – Fully Supervised Sprinkler System.

The estimated fire flow demand was estimated to be **7,000 L/min**, see **Appendix B** for details.

There are three (3) existing fire hydrants within 75m radius from the proposed building that are available to provide the required fire flow demands of 7,000 L/min. Refer to **Appendix B** for fire hydrant locations. **Table 4** below summarizes the aggregate fire flow of the contributing hydrants in close proximity to the proposed development based on Table 18.5.4.3 of *ISTB-2018-02*.

Table 4: Fire Protection Summary Table

Building	Fire Flow Demand (L/min)	Fire Hydrants(s) within 75m	Available Combined Fire Flow (L/min)
Proposed 4 Storey Building	7,000	3	(3 x 5678) = 17,034

The total available fire flow from contributing hydrants is equal to **17,034 L/min** which is sufficient to provide adequate fire flow for the proposed development. A certified fire protection system specialist will need to be employed to design the building’s fire suppression system and confirm the actual fire flow demand.

The proposed water supply design conforms to all relevant City Guidelines and Policies.

6 SANITARY SERVICE

6.1 Existing Sanitary Sewer Services

There is an existing 229 mm dia. sanitary sewer within Coronation Avenue across the subject site. The wastewater flow is ultimately conveyed to the Rideau River Collector trunk sewer. The post development total flow from the proposed development was calculated to be **0.88 L/s**; **0.77 L/s** of which is a result of proposed residential population and the remaining **0.11 L/s** represents contributing infiltration flow from the site. Refer to **Appendix C** for further information on the calculated sanitary flows.

Based on existing as-built, refer to **Drawings/Figures** for as-built information, the existing 229 mm dia. sanitary sewer within Coronation Avenue is sloped at 0.40% and is calculated to have a maximum capacity of **29.76 L/s**. The proposed increase in total wastewater flow of **0.77 L/s**



represents approximately 2.6% of existing maximum capacity. Therefore, it is anticipated that the existing local sewer network has sufficient capacity to accommodate the proposed development.

6.2 Sanitary Sewer Servicing Design

The proposed development will be serviced via a 150 mm dia. sanitary service lateral which will connect to the existing 229 mm dia. sanitary sewer located within Coronation Avenue. Refer to LRL drawing C.401 for the proposed sanitary servicing.

The parameters used to calculate the anticipated sanitary flows are: residential average population per unit of 1.4 person for single units and 2.1 persons for two-bedroom units, a residential daily demand of 280 L/p/day, a residential peaking factor of 4.0 and a total infiltration rate of 0.33 L/s/ha. Based on these parameters and the total site area of 0.34 ha, the total anticipated sanitary flow was estimated to be **0.88 L/s**, resulting in an increase of **0.77 L/s** in total wastewater flow. Refer to **Appendix C** for the site sanitary sewer design sheet.

7 STORMWATER MANAGEMENT

7.1 Existing Stormwater Infrastructure

Stormwater runoff from the subject property is tributary to the City of Ottawa sewer system as such, approvals for the proposed development within this area are under the approval authority of the City of Ottawa.

In pre-development conditions, the stormwater runoff would flow uncontrolled overland to the north side of the site towards Coronation Avenue right-of-way. There is an existing 675 mm diameter storm sewer within Coronation Avenue that terminates 80 m west of the site at the intersection of Coronation Avenue and Botsford Street. Refer to **Appendix D** for pre- and post-development watershed information.

7.2 Design Criteria

The stormwater management criteria for this development are based on the pre-consultation with City of Ottawa officials, the City of Ottawa Sewer Design Guidelines 2012 (City standards), including all succeeding technical bulletins, as well as the Ministry of the Environment's Stormwater Planning and Design Manual, 2003 (SWMP Manual).

7.2.1 Water Quality

The subject property lies within the Lower Rideau River sub-watershed and is therefore subject to review by the Rideau Valley Conservation Authority (RVCA). It was determined that no further treatment is required for stormwater runoff from the proposed development. Correspondence with RVCA is included in **Appendix A**.

7.2.2 Water Quantity

Based on pre-consultation with the City, correspondence included in **Appendix A**, the following stormwater management requirements were identified for the subject site:



- Meet an allowable release rate based on the existing Rational Method with a runoff coefficient no greater than 0.50, employing the City of Ottawa IDF parameters for a 2-year storm with a calculated time of concentration equal to or greater than 10 minutes; and
- Attenuate all storms up to and including the City of Ottawa 100-year storm event on site.

The allowable release rate for the subject site was calculated to be **20.92 L/s**. Refer to **Appendix D** for calculations.

7.3 Method of Analysis

The Modified Rational Method has been used to calculate the runoff rate from the site to quantify the detention storage required for quantity control of the development. Refer to **Appendix D** for storage calculations.

7.4 Proposed Stormwater Quantity Controls

The proposed stormwater management quantity control for this development will be accomplished using a flow restrictor in the storm sewer, as well as roof drains restricting the flow leaving the rooftop. Storage required as a result of quantity control will be accomplished through a combination of rooftop storage and surface storage in the parking lot.

A 300 mm diameter storm sewer extension is proposed along Coronation Avenue right-of way to extend municipal sewer to the subject site. The subject property is proposed to be serviced via a 250 mm diameter storm sewer that would outlet to the 300 mm diameter municipal storm sewer extension within Coronation Avenue. The proposed site storm sewer and stormwater management system are shown on drawing C.401 and detailed calculations, including the design sheet, can be found in **Appendix D**.

The existing site is delineated by catchments EWS-01 & EWS-02 which currently drain uncontrolled towards the front of the property. EWS-02 is out of scope of this proposed development and as such only EWS-01 watershed was analyzed. Refer to Pre-Development Watershed Plan C701 included in **Appendix E**.

The site has been analyzed and post development watersheds have been allocated. Watershed WS-01 (0.040ha), consisting of grass and a portion of the paved drive aisle, will flow uncontrolled. A portion of the runoff will surface drain to the Coronation Avenue right-of-way and west neighboring parcel, while the remainder will be collected via a trench drain at the end of the underground garage ramp and conveyed downstream of the proposed ICD at the CBMH 200. Refer to grading plan C301 and servicing plan C401.

Overland flow within watershed WS-03 (0.092ha) will be captured by area drains over the underground garage. Runoff would be conveyed in the building internal mechanical system and outlet to CBMH 200. An IPEX Tempest LMF 50mm diameter ICD is proposed at CBMH 200 to restrict collected runoff, refer to **Appendix D** for details. Grading proposed will provide positive overland drainage to the proposed storm water collection and control systems.



Runoff from the roof, delineated by Watershed WS-02 (0.065ha), will be captured by the proposed roof drains. Stormwater captured on the rooftop will be controlled by the roof drains, and conveyed to the storm sewer network, downstream of the ICD at CBMH 200, refer to C401 included in **Appendix E** for connection points.

Table 5 below summarizes post-development drainage areas. Calculations are included in **Appendix D**.

Table 5: Drainage Areas

Drainage Area Name	Area (ha)	Weighted Runoff Coefficient	100 Year Weighted Runoff Coefficient (25% increase)
WS-01 (un-controlled)	0.040	0.57	0.71
WS-02 (controlled)	0.065	0.90	1.00
WS-03 (controlled)	0.092	0.58	0.73

Rooftop detention of stormwater is provided with outlet control through six (6) proposed roof drains. The building's rooftop was analysed and divided into six (6) ponding areas, each of which drains to one (1) roof drain which restricts the discharge rate to **0.63 L/s**. Therefore, the total proposed release rate from the roof is **3.79 L/s**. The roof drain flow control device has been selected to provide a flow rate of 0.315 L/s at a maximum flow depth of 0.15 m. Proposed roof drains are to be Watts RD-100-A with a **closed** weir opening. See **Appendix D** for more information about the selected roof drain and flow restrictor.

The total available roof storage (m^3) has been calculated using the following formula:

$$V = \left(\frac{D_{Sl} * A_{Eff}}{3} \right)$$

Where:

V = available (provided) rooftop storage (m^3)

D_{Sl} = ponding depth at roof drain (m)

A_{Eff} = effective roof area (m^2)

Based on the equation above, it was calculated that **25.50 m^3** of rooftop storage is available in the 100-year event. For additional details on the calculations for available area of rooftop storage, refer to **Appendix D**.

All overland stormwater captured will ultimately be conveyed, via underground storm sewers, to the proposed City storm sewer extension within Coronation Avenue at a maximum release rate of **20.92 L/s** (calculated controlled and uncontrolled flow).



Table 6 below summarize the release rates and storage volumes required to meet the allowable release rate of **20.92 L/s** for 100-year flow rates.

Table 6: Stormwater Release Rate & Storage Volume Summary (100 Year)

Catchment Area	Drainage Area (ha)	100-year Release Rate (L/s)	100-Year Required Storage (m ³)	Total Available Storage (m ³)
WS-01 (Un-controlled)	0.040	13.89	0	0
WS-02 (Roof Controlled)	0.065	3.79	23.40	25.50
WS-03 (Controlled)	0.092	3.25	25.90	27.60
TOTAL	0.196	20.92	49.31	53.10

It is calculated that a total of **49.31 m³** of storage will be required to attenuate flows to the allowable release rate of **20.92 L/s**. The project runoff exceeding the allowable release rate will be stored on-site via rooftop ponding at the building rooftop and surface parking lot storage. The 100-year maximum ponding extents can be found on drawing “C601 – Stormwater Management Plan” of **Appendix E**.

8 EROSION AND SEDIMENT CONTROL

During construction, erosion and sediment controls will be provided primarily via a sediment control fence to be erected along the perimeter of the site where runoff has the potential of leaving the site. Inlet sediment control devices are also to be provided in any catch basin and/or manholes in and around the site that may be impacted by the site construction. Construction and maintenance requirements for erosion and sediment controls are to comply with Ontario Provincial Standard Specification OPSS 577. Refer to LRL Associates drawing C.101 for erosion and sediment control details.

9 CONCLUSION

This Stormwater Management and Servicing Report for the development proposed at 700 Coronation Avenue presents the rationale and details for the servicing requirements for the subject property.

In accordance with the report objectives, the servicing requirements for the development are summarized below:



Water Service

- The maximum required fire flow was calculated at **7,000.0 L/min** using the FUS method.
- There are three (3) existing fire hydrants available to service the proposed development which will provide a combined fire flow of **17,034 L/min** to the site.
- The new development/expansion will be serviced with a new 150 mm Φ water service to be connected to the existing 305mm Φ watermain within Coronation Avenue.
- Boundary conditions received from the City of Ottawa indicate that sufficient pressure is available to service the proposed site.

Sanitary Service

- The anticipated increase in sanitary flow from the proposed development is **0.77 L/s**.
- The proposed development will be serviced by a 150 mm diameter sanitary service that connects to the existing 230mm dia. sanitary sewer within Coronation Avenue.

Stormwater Management

- Stormwater quality control are not required as per consultation with RVCA.
- The storm water release rates from the proposed development will meet calculated allowable release rate of **20.92 L/s**.
- Stormwater quantity control objectives will be met through on-site storm water ponding on the roof and parking lot surface storage.

10 REPORT CONDITIONS AND LIMITATIONS

The report conclusions are applicable only to this specific project described in the preceding pages. Any changes, modifications or additions will require a subsequent review by LRL Associates Ltd. to ensure the compatibility with the recommendations contained in this document. If you have any questions or comments, please contact the undersigned.

Prepared by:

LRL Associates Ltd.



Mohan Basnet, P. Eng.
Civil Engineer

A handwritten signature in black ink that reads "Amr Salem".

Amr Salem
Civil Designer



APPENDIX A
Pre-consultation / Correspondence



DEVELOPMENT SERVICING STUDY CHECKLIST

Project #: 200463

2020-10-01

4.1 General Content

Executive Summary (for larger reports only).	N/A
Date and revision number of the report.	Report Cover Hseet
Location map and plan showing municipal address, boundary, and layout of proposed development.	Drawings/Figures
Plan showing the site and location of all existing services.	Figure 1
Development statistics, land use, density, adherence to zoning and official plan, and reference to applicable subwatershed and watershed plans that provide context to which individual developments must adhere.	Section 1.0
Summary of Pre-consultation Meetings with City and other approval agencies.	Section 4.0 & Appendix A
Reference and confirm conformance to higher level studies and reports (Master Servicing Studies, Environmental Assessments, Community Design Plans), or in the case where it is not in conformance, the proponent must provide justification and develop a defensible design criteria.	Section 5.1, 6.1, 7.1
Statement of objectives and servicing criteria.	Section 1.0
Identification of existing and proposed infrastructure available in the immediate area.	Section 5.1, 6.1, 7.1
Identification of Environmentally Significant Areas, watercourses and Municipal Drains potentially impacted by the proposed development (Reference can be made to the Natural Heritage Studies, if available).	Section 7.0
Concept level master grading plan to confirm existing and proposed grades in the development. This is required to confirm the feasibility of proposed stormwater management and drainage, soil removal and fill constraints, and potential impacts to neighbouring properties. This is also required to confirm that the proposed grading will not impede existing major system flow paths.	C301

Identification of potential impacts of proposed piped services on private services (such as wells and septic fields on adjacent lands) and mitigation required to address potential impacts. N/A

Proposed phasing of the development, if applicable. N/A

Reference to geotechnical studies and recommendations concerning servicing. C401

All preliminary and formal site plan submissions should have the following information:

- Metric scale

- North arrow (including construction North)

- Key plan

- Name and contact information of applicant and property owner C401

- Property limits including bearings and dimensions

- Existing and proposed structures and parking areas

- Easements, road widening and rights-of-way

- Adjacent street names

4.2 Development Servicing Report: Water

Confirm consistency with Master Servicing Study, if available N/A

Availability of public infrastructure to service proposed development Section 5.1

Identification of system constraints Section 5.1

Identify boundary conditions Section 5.2

Confirmation of adequate domestic supply and pressure Section 5.2

Confirmation of adequate fire flow protection and confirmation that fire flow is calculated as per the Fire Underwriter's Survey. Output should show available fire flow at locations throughout the development. Section 5.2

Provide a check of high pressures. If pressure is found to be high, an assessment is required to confirm the application of pressure reducing valves.	Section 5.2
Definition of phasing constraints. Hydraulic modeling is required to confirm servicing for all defined phases of the project including the ultimate design	N/A
Address reliability requirements such as appropriate location of shut-off valves	N/A
Check on the necessity of a pressure zone boundary modification.	N/A
Reference to water supply analysis to show that major infrastructure is capable of delivering sufficient water for the proposed land use. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure range	Section 5.2
Description of the proposed water distribution network, including locations of proposed connections to the existing system, provisions for necessary looping, and appurtenances (valves, pressure reducing valves, valve chambers, and fire hydrants) including special metering provisions.	Section 5.2
Description of off -site required feeder mains, booster pumping stations, and other water infrastructure that will be ultimately required to service proposed development, including financing, interim facilities, and timing of implementation.	N/A
Confirmation that water demands are calculated based on the City of Ottawa Design Guidelines.	Section 5.2
Provision of a model schematic showing the boundary conditions locations, streets, parcels, and building locations for reference.	N/A

4.3 Development Servicing Report: Wastewater

Summary of proposed design criteria (Note: Wet-weather flow criteria should not deviate from the City of Ottawa Sewer Design Guidelines. Monitored flow data from relatively new infrastructure cannot be used to justify capacity requirements for proposed infrastructure).	Section 6.2
Confirm consistency with Master Servicing Study and/or justifications for deviations.	N/A

Consideration of local conditions that may contribute to extraneous flows that are higher than the recommended flows in the guidelines. This includes groundwater and soil conditions, and age and condition of sewers.	N.A
Description of existing sanitary sewer available for discharge of wastewater from proposed development.	Section 6.1
Verify available capacity in downstream sanitary sewer and/or identification of upgrades necessary to service the proposed development. (Reference can be made to previously completed Master Servicing Study if applicable)	Section 6.2
Calculations related to dry-weather and wet-weather flow rates from the development in standard MOE sanitary sewer design table (Appendix 'C') format.	Section 6.2 Appendix C
Description of proposed sewer network including sewers, pumping stations, and forcemains.	Section 6.2
Discussion of previously identified environmental constraints and impact on servicing (environmental constraints are related to limitations imposed on the development in order to preserve the physical condition of watercourses, vegetation, soil cover, as well as protecting against water quantity and quality).	N/A
Pumping stations: impacts of proposed development on existing pumping stations or requirements for new pumping station to service development.	Section 6.1
Forcemain capacity in terms of operational redundancy, surge pressure and maximum flow velocity.	N/A
Identification and implementation of the emergency overflow from sanitary pumping stations in relation to the hydraulic grade line to protect against basement flooding.	N/A
Special considerations such as contamination, corrosive environment etc.	N/A

4.4 Development Servicing Report: Stormwater Checklist

Description of drainage outlets and downstream constraints including legality of outlets (i.e. municipal drain, right-of-way, watercourse, or private property)	Section 7.1
---	-------------

Analysis of available capacity in existing public infrastructure.	N/A
A drawing showing the subject lands, its surroundings, the receiving watercourse, existing drainage patterns, and proposed drainage pattern.	N/A
Water quantity control objective (e.g. controlling post-development peak flows to pre-development level for storm events ranging from the 2 or 5 year event (dependent on the receiving sewer design) to 100 year return period); if other objectives are being applied, a rationale must be included with reference to hydrologic analyses of the potentially affected subwatersheds, taking into account long-term cumulative effects.	Section 7.2.2
Water Quality control objective (basic, normal or enhanced level of protection based on the sensitivities of the receiving watercourse) and storage requirements.	Section 7.2.1
Description of the stormwater management concept with facility locations and descriptions with references and supporting information.	Section 7.4
Set-back from private sewage disposal systems.	N/A
Watercourse and hazard lands setbacks.	N/A
Record of pre-consultation with the Ontario Ministry of Environment and the Conservation Authority that has jurisdiction on the affected watershed.	N/A
Confirm consistency with sub-watershed and Master Servicing Study, if applicable study exists.	N/A
Storage requirements (complete with calculations) and conveyance capacity for minor events (1:5 year return period) and major events (1:100 year return period).	Section 7.4
Identification of watercourses within the proposed development and how watercourses will be protected, or, if necessary, altered by the proposed development with applicable approvals.	N/A
Calculate pre and post development peak flow rates including a description of existing site conditions and proposed impervious areas and drainage catchments in comparison to existing conditions.	Section 7.4 Appendix D

Any proposed diversion of drainage catchment areas from one outlet to another.	N/A
Proposed minor and major systems including locations and sizes of stormwater trunk sewers, and stormwater management facilities.	Appendix D
If quantity control is not proposed, demonstration that downstream system has adequate capacity for the post-development flows up to and including the 100 year return period storm event.	N/A
Identification of potential impacts to receiving watercourses Identification of municipal drains and related approval requirements.	N/A
Descriptions of how the conveyance and storage capacity will be achieved for the development.	Section 7.4
100 year flood levels and major flow routing to protect proposed development from flooding for establishing minimum building elevations (MBE) and overall grading.	NA
Inclusion of hydraulic analysis including hydraulic grade line elevations.	N/A
Description of approach to erosion and sediment control during construction for the protection of receiving watercourse or drainage corridors.	Section 8.0
Identification of floodplains – proponent to obtain relevant floodplain information from the appropriate Conservation Authority. The proponent may be required to delineate floodplain elevations to the satisfaction of the Conservation Authority if such information is not available or if information does not match current conditions.	N/A
Identification of fill constraints related to floodplain and geotechnical investigation	N/A

4.5 Approval and Permit Requirements: Checklist

Conservation Authority as the designated approval agency for modification of floodplain, potential impact on fish habitat, proposed works in or adjacent to a watercourse, cut/fill permits and Approval under Lakes and Rivers Improvement Act. The Conservation Authority is not the approval authority for the Lakes and Rivers Improvement Act. Where there are Conservation Authority regulations in place, approval under the Lakes and Rivers Improvement Act is not required, except in cases of dams as defined in the Act.

N/A

Application for Certificate of Approval (CofA) under the Ontario Water Resources Act.

N/A

Changes to Municipal Drains.

N/A

Other permits (National Capital Commission, Parks Canada, Public Works and Government Services Canada, Ministry of Transportation etc.)

N/A

4.6 Conclusion Checklist

Clearly stated conclusions and recommendations

Section 9.0

Comments received from review agencies including the City of Ottawa and information on how the comments were addressed. Final sign-off from the responsible reviewing agency.

Noted

All draft and final reports shall be signed and stamped by a professional Engineer registered in Ontario

Noted

Amr Salem

From: Laurie Bouchard <bouchard@project1studio.ca>
Sent: September 8, 2020 12:10 PM
To: Amr Salem; Maxime Longtin
Cc: Ryan Koolwine
Subject: FW: 2004 - 700 Coronation Plans
Attachments: 700 Coronation Ave (proj#200463) - Boundary Conditions

Follow Up Flag: Follow up
Flag Status: Flagged

Good morning Amr,

- Unit count:
 - o Studio: 4 units
 - o 1-bed: 16 units
 - o 2-bed: 15 units

- Total gross floor area:

LEVEL	AREA (m2)
P1	1536.19
01	598.34
02	602.31
03	600.10
04	575.10
TOTAL	3912.04

- sprinklers are automatic. I'm not sure what you mean by "fully supervised". Sprinklers will be electrically supervised as per OBC 3.2.4.10.(3).

3.2.4.10. Electrical Supervision

(1) Electrical supervision shall be provided for a fire alarm system.

(2) If a fire alarm system in a *building* is required by Sentence 3.2.4.9.(1) to have an annunciator, each valve controlling water supplies in a standpipe system, except for hose valves, shall be equipped with an electrically supervised switch for transmitting a trouble signal to the annunciator in the event of movement of the valve handle.

(3) If a fire alarm system is installed in a *building*, an automatic sprinkler system shall be electrically supervised to indicate a supervisory signal on the *building* fire alarm system annunciator for each of the following,

(a) movement of a valve handle that controls the supply of water to sprinklers,

(b) loss of excess water pressure required to prevent false alarms in a wet pipe system,

(c) loss of air pressure in a dry pipe system,

(d) loss of air pressure in a pressure tank,

(e) a significant change in water level in any water storage container used for firefighting purposes,

(f) loss of power to any automatically starting fire pump, and

(g) a temperature approaching the freezing point in any dry pipe valve enclosure or water storage container used for firefighting purposes.

- Based on the provided fire flow guide, the building will be Class 2 ordinary construction with 1-hour rated exterior walls.

Amr Salem

From: Jamie Batchelor <jamie.batchelor@rvca.ca>
Sent: September 11, 2020 1:43 PM
To: Amr Salem
Cc: Maxime Longtin; Mohan Basnet
Subject: RE: (LRL#200463) - 700 Coronation Ave - SWM Quality Objectives

Follow Up Flag: Follow up
Flag Status: Flagged

Good Afternoon Amr,

Based on the distance from the downstream outlet and the reduction of surface parking spaces to 6 surface parking spaces, we would accept that no additional onsite water quality treatment is required.

Jamie Batchelor, MCIP, RPP
Planner, ext. 1191
jamie.batchelor@rvca.ca



3889 Rideau Valley Drive
PO Box 599, Manotick ON K4M 1A5
T 613-692-3571 | 1-800-267-3504 F 613-692-0831 | www.rvca.ca

This message may contain information that is privileged or confidential and is intended to be for the use of the individual(s) or entity n may contain confidential or personal information which may be subject to the provisions of the *Municipal Freedom of Information & Access Act*. If you are not the intended recipient of this e-mail, any use, review, revision, retransmission, distribution, dissemination, copying, printing, taking of any action in reliance upon this e-mail, is strictly prohibited. If you have received this e-mail in error, please contact the sender and any copy of the e-mail and any printout thereof, immediately. Your cooperation is appreciated.

From: Amr Salem <asalem@lrl.ca>
Sent: Thursday, September 10, 2020 4:09 PM
To: Jamie Batchelor <jamie.batchelor@rvca.ca>
Cc: Maxime Longtin <mlongtin@lrl.ca>; Mohan Basnet <mbasnet@lrl.ca>
Subject: (LRL#200463) - 700 Coronation Ave - SWM Quality Objectives

Hello Jamie,

I wanted to consult with you regarding a residential development we are working on located at 700 coronation Ave.

Existing runoff from the site drains into municipal sewer along Coronation Avenue and travels approx. 2.3 km before discharging into the Rideau River.

Site area currently consists of an existing residential building and a large paved area for surface parking (approx. 32 surface parking spaces).

The development proposes a residential 4-storey building along side the existing apartment building. It is proposed to reduce existing surface parking lot to 6 surface parking spots only, with underground parking garage to accommodate both buildings. The site will be landscape with stormwater coming primarily from rooftop and landscaped rear yard and paved area in between buildings. Refer to draft site plan attached for reference.

Please provide your input about quality controls that may be required for this site.



Thank you,



LRL

ENGINEERING | INGÉNIERIE

E asalem@lrl.ca

W www.lrl.ca

Amr Salem

Civil Designer

LRL Associates Ltd.

5430 Canotek Road
Ottawa, Ontario K1J 9G2

T (613) 842-3434 or (877) 632-5664 ext 248

F (613) 842-4338

*We care deeply, so let us know how we did by completing our [Customer Satisfaction Survey](#).
Nous nous soucions profondément de votre opinion, nous vous invitons donc à nous faire savoir
si nous avons satisfait vos attentes en remplissant notre [sondage sur la satisfaction de la clientèle](#)*



Amr Salem

From: Sharif, Golam <sharif.sharif@ottawa.ca>
Sent: September 11, 2020 10:29 AM
To: Amr Salem
Cc: Maxime Longtin; Mohan Basnet
Subject: RE: (LRL#200463) - 700 Coronation Ave SPC - SWM Targets

Follow Up Flag: Follow up
Flag Status: Flagged

Good Morning Amr,

The SWM sewer on Botsford street is build 1954, therefore as per the guideline it will be control to 2 year storm. I do not have any record of that report being approved. Thanks.

sharif

From: Amr Salem <asalem@lrl.ca>
Sent: September 10, 2020 3:44 PM
To: Sharif, Golam <sharif.sharif@ottawa.ca>
Cc: Maxime Longtin <mlongtin@lrl.ca>; Mohan Basnet <mbasnet@lrl.ca>
Subject: (LRL#200463) - 700 Coronation Ave SPC - SWM Targets

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

I'm looking to confirm the required SWM objectives for the proposed development at 700 Coronation Avenue.

Based on the pre consult notes attached, it states that

- Estimate allowable release rate based on a $C=0.5$, with a T_c greater than or equal to 10 minutes, employing the City of Ottawa IDF parameters for a **2-year storm**.

However, the previous SWM report prepared by *RV Anderson* for the subject site on *Nov 2012*, see attached, states that peak flow is to be controlled to the **5-year storm**.

Can you please confirm SWM objectives and if previous SWM report/design was approved for this site?

Thank you,

Amr Salem
Civil Designer



LRL Associates Ltd.

5430 Canotek Road
Ottawa, Ontario K1J 9G2

T (613) 842-3434 or (877) 632-5664 ext 248

F (613) 842-4338

E asalem@lrl.ca

W www.lrl.ca

We care deeply, so let us know how we did by completing our [Customer Satisfaction Survey](#).

Nous nous soucions profondément de votre opinion, nous vous invitons donc à nous faire savoir si nous avons satisfait vos attentes en remplissant notre [sondage sur la satisfaction de la clientèle](#)




This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

APPENDIX B
Water Supply Calculations



City of Ottawa - Water Distribution System Facilities & Feeder mains

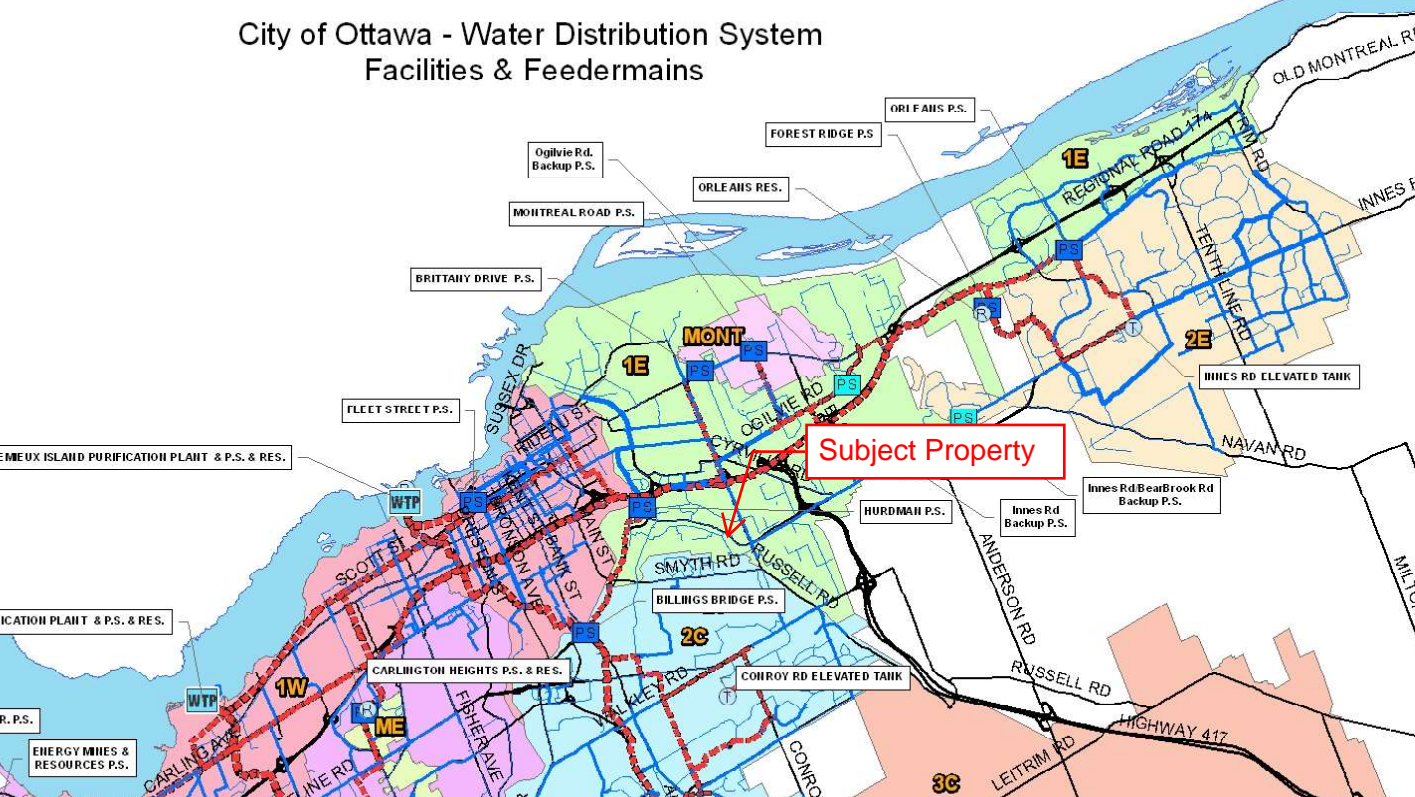

Subject Property

ORLEANS P.S.

FOREST RIDGE P.S.

Ogilvie Rd.
Backup P.S.

ORLEANS RES.

MONTREAL ROAD P.S.

1E

INNES RD ELEVATED TANK

BRITANNY DRIVE P.S.

MONT

NAVAN RD

FLEET STREET P.S.

EMMEUX ISLAND PURIFICATION PLANT & P.S. & RES.

WTP

Subject Property

Innes Rd BearBrook Rd
Backup P.S.

HURDMAN P.S.

Innes Rd
Backup P.S.

ICATION PLANT & P.S. & RES.

SMYTH RD

BILLINGS BRIDGE P.S.

ANDERSON RD

RUSSELL RD

CARLINGTON HEIGHTS P.S. & RES.

CONROY RD ELEVATED TANK

HIGHWAY 47

R. P.S.

ENERGY MINES & RESOURCES P.S.

CARLING AVE

INE RD

FISHER AVE

KEY RD

CONROY

3C

LEITRIM RD

MIL...



Water Supply Calculations for Proposed Building

LRL File No. 200463
 Date September 9, 2020
 Prepared by Amr Salem

Residential Demand based on the City of Ottawa Design Guidelines-Water Distribution, 2010

Unit Type	Persons Per Unit	Number of Units	Population
Studio / 1 Bedroom Apartment	1.4	20	28.0
2 Bedroom Apartment	2.1	15	31.5
Total		35	59.5

Average Water Consumption Rate	280 L/c/d		
Average Day Demand	16,660 L/d	0.19 L/s	
Maximum Day Factor	7.2	(MOE Table 3-3)	
Maximum Daily Demand	119,173 L/d	1.38 L/s	
Peak Hour Factor	10.8	(MOE Table 3-3)	
Maximum Hour Demand	1,281,777 L/d	14.84 L/s	

Water Service Pipe Sizing

Q = VA

Where: V = velocity
 A = area of pipe
 Q = flow rate

Assuming a maximum velocity of 1.8m/s, the diameter of pipe is calculated as:

Minimum pipe diameter (d) = $(4Q/\pi V)^{1/2}$
 = 0.102 m
 = 102 mm

Proposed pipe diameter (d) = 150 mm
 = 6 Inches



TOTAL Water Supply Calculations for Proposed Building + Existing Building

LRL File No. 200463
 Date September 9, 2020
 Prepared by Amr Salem

Residential Demand based on the City of Ottawa Design Guidelines-Water Distribution, 2010

Unit Type	Persons Per Unit	Number of Units	Population
Average Apartment Unit (<i>Existing BLDG</i>)	1.8	30	54.0
Studio / 1 Bedroom Apartment	1.4	20	28.0
2 Bedroom Apartment	2.1	15	31.5
	Total	65	113.5

Average Water Consumption Rate	280 L/c/d		
Average Day Demand	31,780 L/d	0.37 L/s	
Maximum Day Factor	5.4	(MOE Table 3-3)	
Maximum Daily Demand	172,875 L/d	2.00 L/s	
Peak Hour Factor	8.2	(MOE Table 3-3)	
Maximum Hour Demand	1,410,339 L/d	16.32 L/s	



Fire Flow Calculations

LRL File No. 200463
 Date September 9, 2020
 Method Fire Underwriters Survey (FUS)
 Prepared by Amr Salem

Step	Task	Term	Options	Multiplier	Choose:	Value	Unit	Fire Flow	
Structural Framing Material									
1	Choose frame used for building	Coefficient C related to the type of construction	Wood Frame	1.5	Ordinary Construction	1			
			Ordinary Construction	1.0					
			Non-combustible construction	0.8					
			Fire resistive construction <2 hrs	0.7					
			Fire resistive construction >2 hrs	0.6					
Floor Space Area (A)									
2			Total area			2,376	m ²		
3	Obtain fire flow before reductions	Required fire flow	$\text{Fire Flow} = 220 \times C \times A^{0.5}$					L/min	10,723
Reductions or surcharge due to factors affecting burning									
4	Choose combustibility of contents	Occupancy hazard reduction or surcharge	Non-combustible	-25%	Limited combustible	-15%	L/min	9,115	
			Limited combustible	-15%					
			Combustible	0%					
			Free burning	15%					
			Rapid burning	25%					
5	Choose reduction for sprinklers	Sprinkler reduction	Full automatic sprinklers	-30%	True	-30%	L/min	4,557	
			Water supply is standard for both the system and fire department hose lines	-10%	True	-10%			
			Fully supervised system	-10%	True	-10%			
6	Choose separation	Exposure distance between units	North side	>30m	0%		L/min	6,836	
			East side	3.1 to 10m	20%				
			South side	10.1 to 20m	15%				
			West side	10.1 to 20m	15%	50%			
Net required fire flow									
7	Obtain fire flow, duration, and volume					Minimum required fire flow rate (rounded to nearest 1000)	L/min	7,000	
						Minimum required fire flow rate	L/s	116.7	
						Required duration of fire flow	hr	2	

Amr Salem

From: Sharif, Golam <sharif.sharif@ottawa.ca>
Sent: September 11, 2020 10:36 AM
To: Amr Salem
Subject: RE: (LRL# 200463) 700 Coronation Avenue - Boundary Conditions Request
Attachments: 700 Coronation September 2020.pdf

Follow Up Flag: Follow up
Flag Status: Flagged

Hi Amr,

Here are the BC condition:

The following are boundary conditions, HGL, for hydraulic analysis at 700 Coronation Avenue (zone 1E) assumed to be connected to the 305mm on Coronation (see attached PDF for location).

Minimum HGL = 107.5m

Maximum HGL = 118.9m

MaxDay + Fire Flow (116.7 L/s) = 105.9m

These are for current conditions and are based on computer model simulation.

Disclaimer: The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation.

Thanks,

Sharif

From: Amr Salem <asalem@lrl.ca>
Sent: September 09, 2020 10:58 AM
To: sharif.golam@ottawa.ca; Sharif, Golam <sharif.sharif@ottawa.ca>
Cc: Mohan Basnet <mbasnet@lrl.ca>; Maxime Longtin <mlongtin@lrl.ca>
Subject: (LRL# 200463) 700 Coronation Avenue - Boundary Conditions Request


CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Good afternoon Sharif,

We would like to kindly request boundary conditions for the proposed development at 700 Coronation Ave using the following proposed development demands:

- Location of Service / Street Number: **700 Coronation Ave**
- Type of development: a **additional** single 4-storey residential building consisting of a total of 35 units with underground parking. Find Site Plan attached for reference.
- Proposed Connection Point: a single connection the 300mm watermain along Coronation Ave ROW.

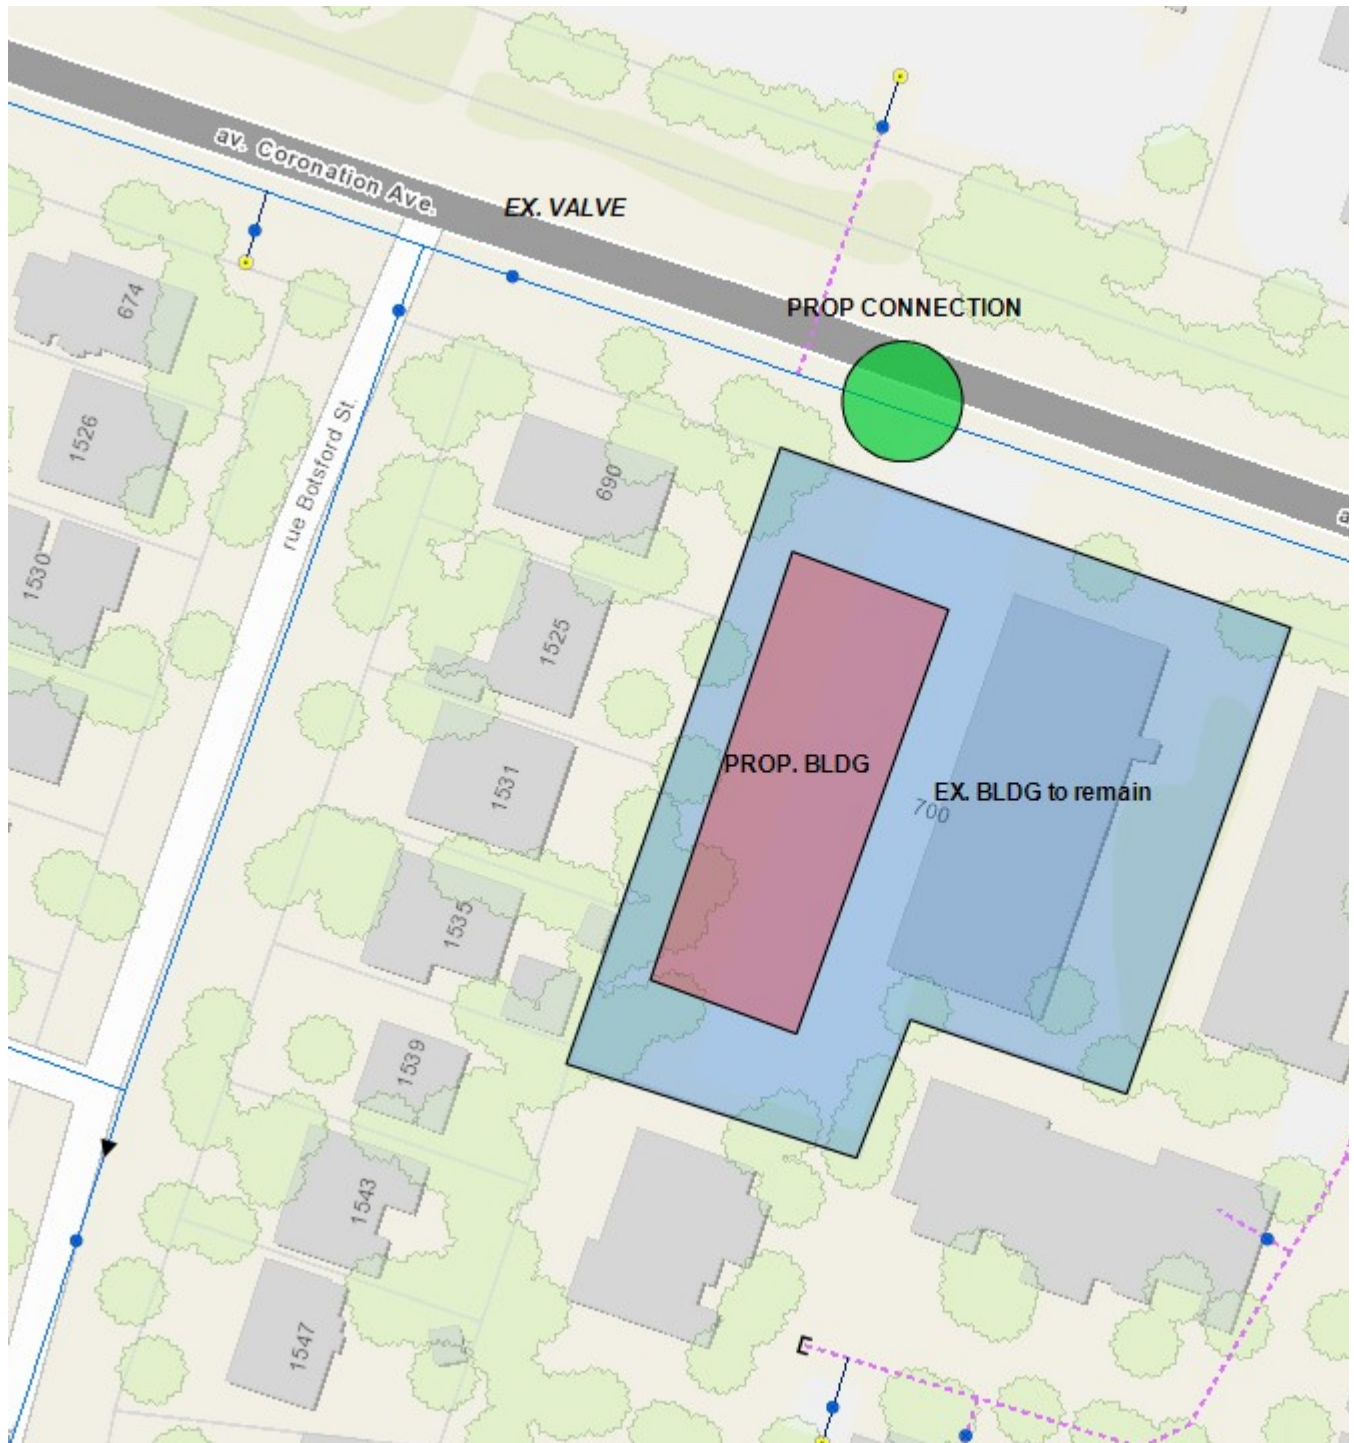

- Please provide pressures for the following water demand scenarios required for the subject site (proposed bldg + existing bldg.):

	L/min	L/s
TOTAL Avg. Daily	22.2	0.37
TOTAL Max Day + FUS	120.0 + 7,000	2.00 + 116.7
TOTAL Peak Hour	979.2	16.32

Please feel free to contact me if you have any questions.

Thank you,



Amr Salem
Civil Designer
LRL Associates Ltd.

5430 Canotek Road
Ottawa, Ontario K1J 9G2

T (613) 842-3434 or (877) 632-5664 ext 248

F (613) 842-4338

E asalem@lrl.ca

W www.lrl.ca

We care deeply, so let us know how we did by completing our [Customer Satisfaction Survey](#).



Nous nous soucions profondément de votre opinion, nous vous invitons donc à nous faire savoir si nous avons satisfait vos attentes en remplissant notre [sondage sur la satisfaction de la clientèle](#)



This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

Boundary Conditons at 700 Coronation Avenue

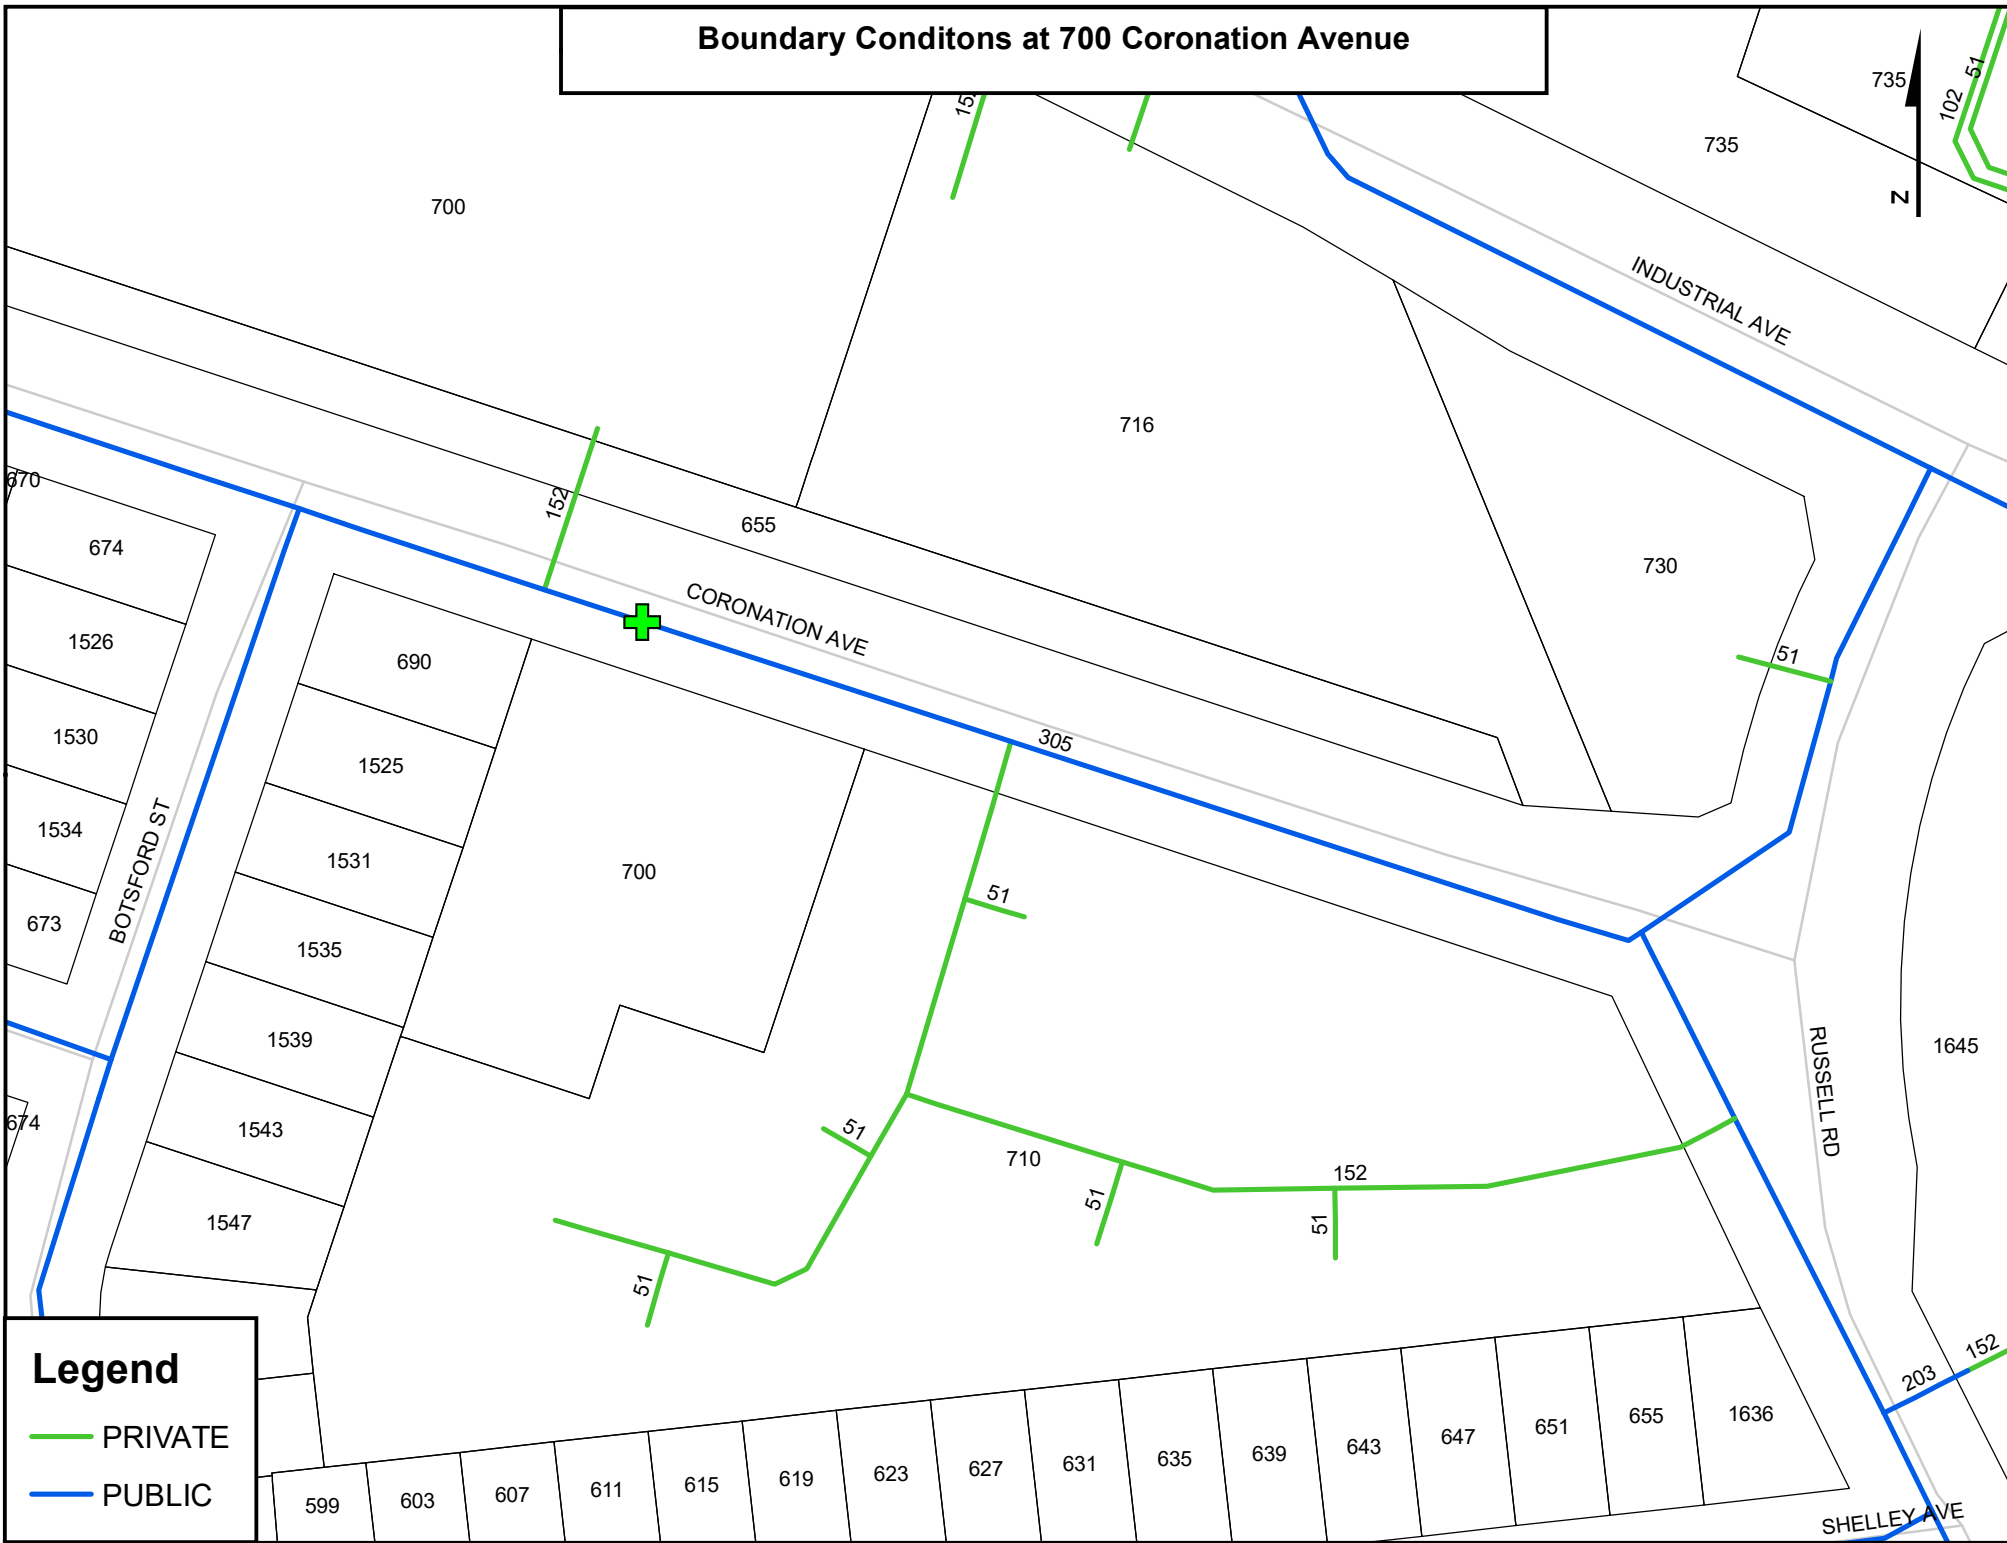


Legend


- PRIVATE
- PUBLIC

FIRE HYDRANT LOCATIONS

700 Coronation Avenue

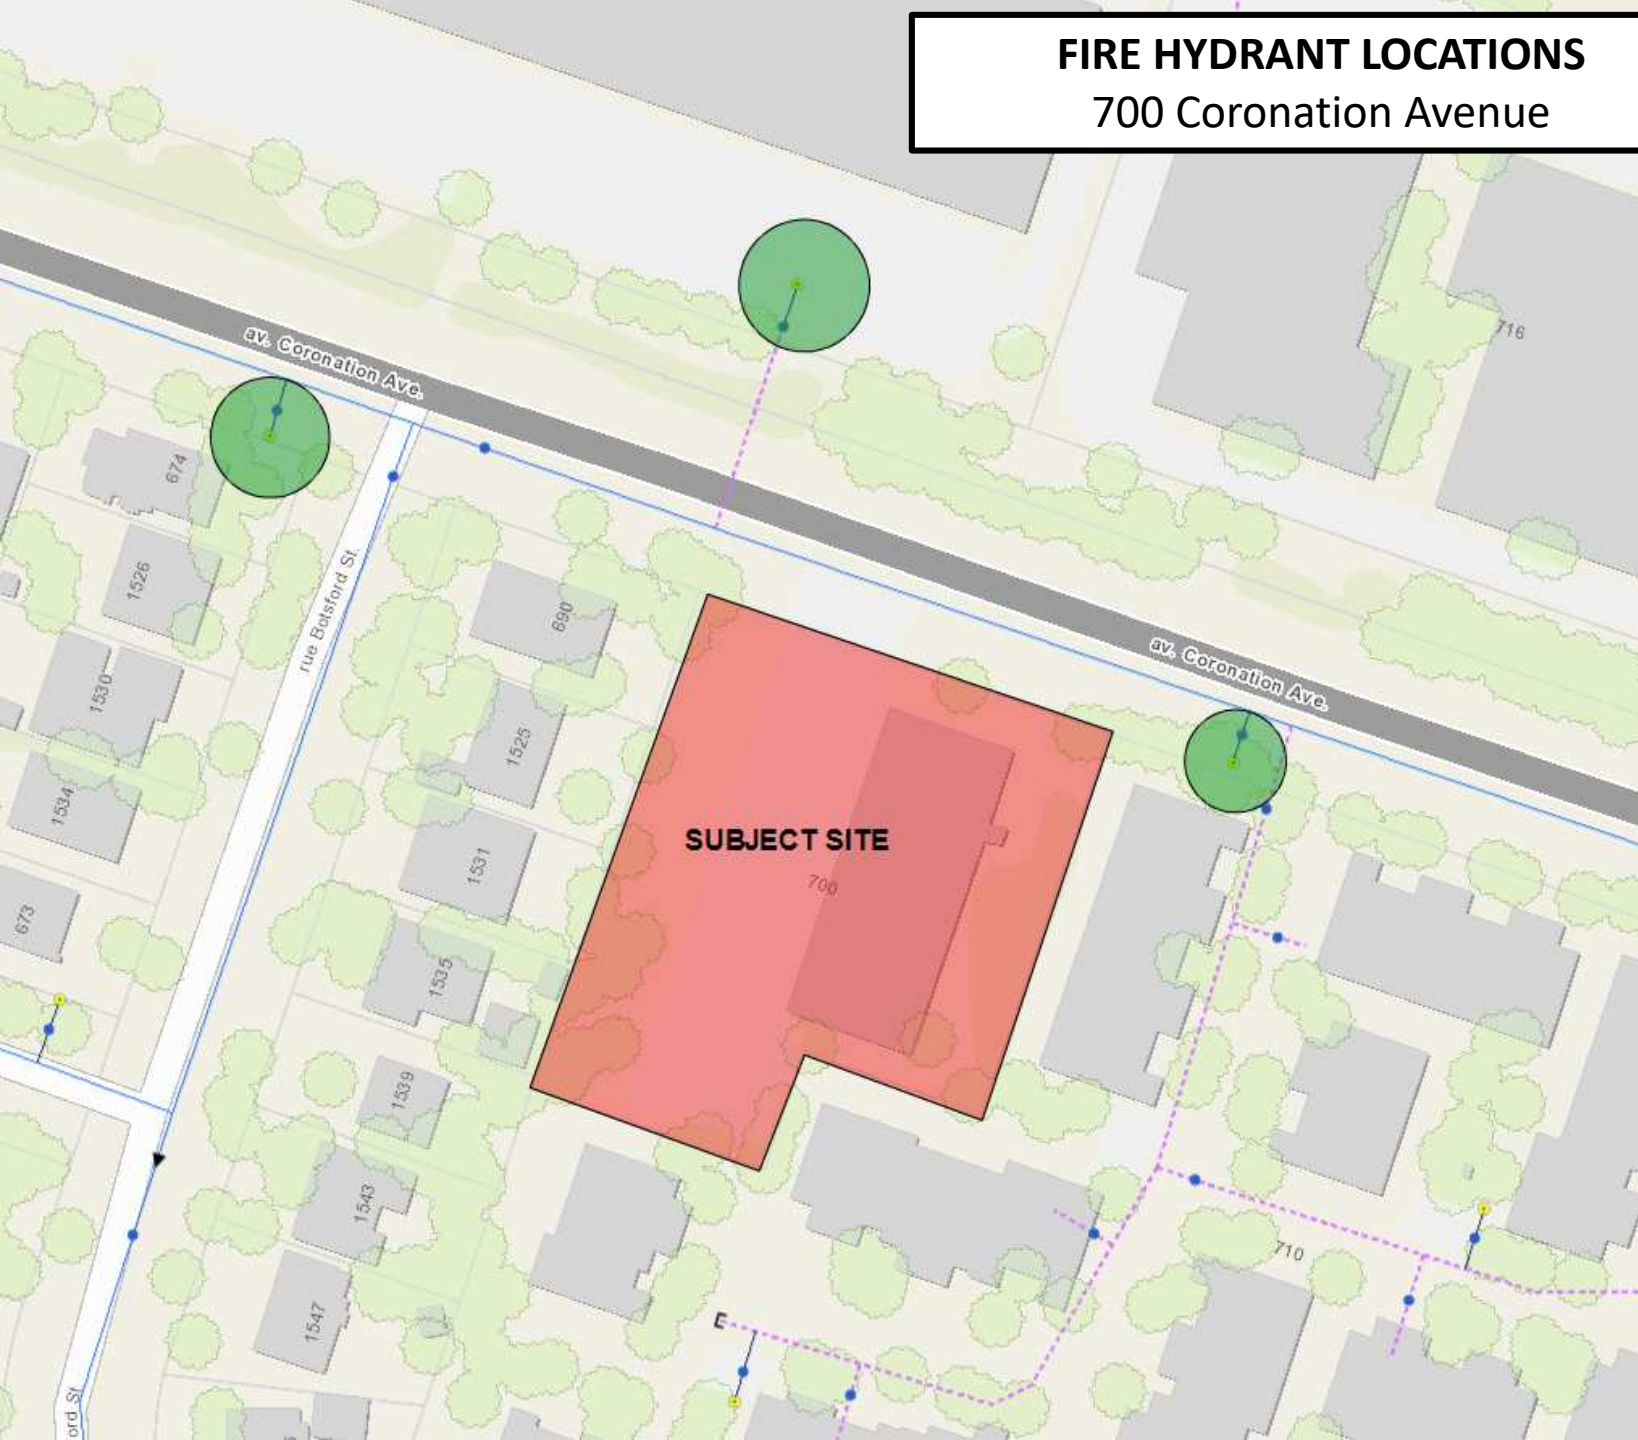

LEGEND



Fire Hydrants within 75 m

Table 18.5.4.3 Maximum fire flow hydrant capacity

Distance to buildings ^a		Maximum capacity ^b	
(ft)	(m)	(gpm)	(L/min)
≤ 250	≤ 76	1500	5678
> 250 and ≤ 500	> 76 and ≤ 152	1000	3785
> 500 and ≤ 1000	> 152 and ≤ 305	750	2839

^a Measured in accordance with 18.5.1.4 and 18.5.1.5.

^b Minimum 20 psi (139.9 kPa) residual pressure.

APPENDIX C

Wastewater Collection Calculations



Sewer Distribution Map City of Ottawa

MONTREAL RD.
COLLECTOR

McARTHUR ROAD
COLLECTOR

CYRVILLE RD.
COLLECTOR

MAXIME
TRUNK

RIDEAU RIVER
INTERCEPTOR


LEES AVENUE
STORM WATER &
LEACHATE FACILITY
(S-2473)

SPRINGHURST AVE.
SEWER & OUTFALL

CLEGG STREET
SEWER & OUTFALL

RIDEAU RIVER
COLLECTOR

Subject Property

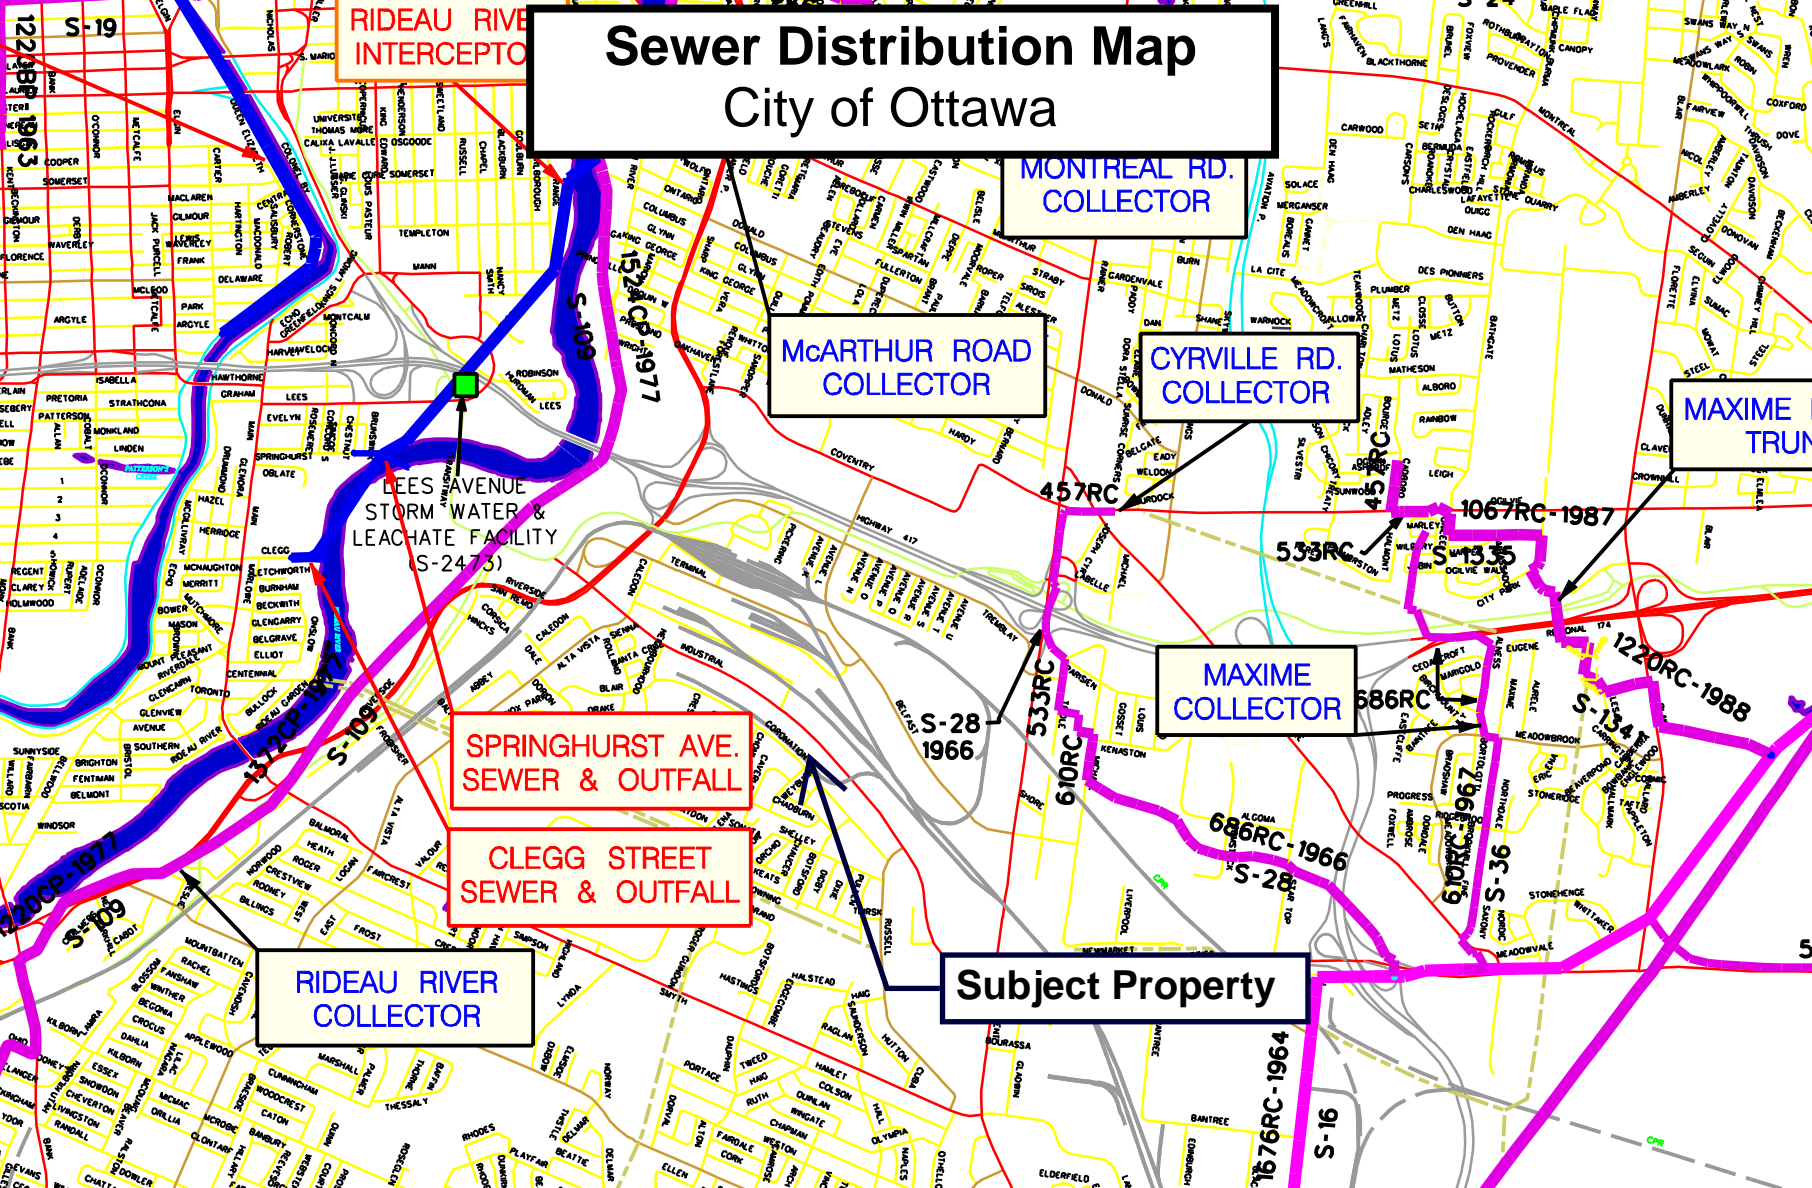



LRL File No. 200463
Project: Apartment Building
Location: 700 Coronation Avenue
Date: October 1, 2020

Sanitary Design Parameters

Average Daily Flow = 280 L/p/day
 Commercial & Institutional Flow = 50000 L/ha/day
 Light Industrial Flow = 35000 L/ha/day
 Heavy Industrial Flow = 55000 L/ha/day
 Maximum Residential Peak Factor = 4.0
 Commercial & Institutional Peak Factor = 1.5

Industrial Peak Factor = as per Appendix 4-B = 7
 Extraneous Flow = 0.33L/s/gross ha

Pipe Design Parameters

Minimum Velocity = 0.60 m/s
 Manning's n = 0.013

LOCATION			RESIDENTIAL AREA AND POPULATION					COMMERCIAL		INDUSTRIAL			INSTITUTIONAL		C+I+I	INFILTRATION			TOTAL FLOW	PIPE						
STREET	FROM MH	TO MH	AREA (Ha)	POP.	CUMMULATIVE		PEAK FACT.	PEAK FLOW (l/s)	AREA (Ha)	ACCU. AREA (Ha)	AREA (Ha)	ACCU. AREA (Ha)	PEAK FACT.	AREA (Ha)	ACCU. AREA (Ha)	PEAK FLOW (l/s)	TOTAL AREA (Ha)	ACCU. AREA (Ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	LENGTH (m)	DIA. (mm)	SLOPE (%)	MATERIAL	CAP. (FULL) (l/s)	VEL. (FULL) (m/s)
					AREA (Ha)	POP.																				
SITE	PROP. BLDG	EX. SAN	0.341	59.5	0.34	59.5	4.0	0.77	0.000	0.000	0.00	0.00	7.0	0.0	0.0	0.00	0.34	0.34	0.11	0.88	15.0	150	1.00%	PVC	15.23	0.86

NOTES	Existing inverts and slopes are estimated. They are to be confirmed on-site.													Designed:		PROJECT: Apartment Building												
														Checked:		LOCATION: 700 Coronation Avenue												
														Dwg. Reference:		File Ref.:			Date:			Sheet No.						
														C.401		200463			2020-10-01			1 of 1						

APPENDIX D
Stormwater Management Calculations
LMF ICD Curves
Tempest Inlet Control Devices Technical Manual
Watts Roof Drain Specification



LRL Associates Ltd.
Storm Watershed Summary



LRL File No. 200463
Project: Apartment Building
Location: 700 Coronation Avenue
Date: October 1, 2020
Designed: Amr Salem
Drawing Reference: C701/C702

Pre-Development Catchments

WATERSHED	C = 0.2	C = 0.80	C = 0.90	Total Area (m ²)	Total Area (ha)	Combined C
EWS-01	879.0	0.0	1080.0	1959.0	0.196	0.59
TOTAL	879.0	0.0	1080.0	1959.0	0.196	0.59

Post-Development Catchments

WATERSHED	C = 0.20	C = 0.80	C = 0.90	Total Area (m ²)	Total Area (ha)	Combined C
WS-01 (UNCONTROLLED)	188.0	0.0	207.0	395.0	0.040	0.57
WS-02 (CONTROLLED)	0.0	0.0	648.0	648.0	0.065	0.90
WS-03 (CONTROLLED)	414.0	0.0	502.0	916.0	0.092	0.58
TOTAL	602.0	0.0	1357.0	1959.0	0.196	0.68



L.R. File No: 200443
 Project: New 4 Storey Building
 Location: 750 Connaught Ave
 Date: October 1, 2020
 Author: Adam
 Drawing Ref.: C.601

Stormwater Management
 Design Sheet

Ruoff Equation

$Q = 2.78CA(L+K)$
 C = Ruoff coefficient
 L = Partial Impervious (mm/hr) = $A/(T+ C)^2$
 A = Area (ha)
 T = Time of concentration (min)

Pre-development Stormwater Management

$I_p = 752.95 / (T + 6.16)^{0.58}$ a = 1725.951 b = 0.81 c = 6.199

C = 0.50 max of 0.5 as per City of Ottawa
 L = 76.9 mm/hr
 T = 10 min
 Total Area = 0.336 ha

Allowable Release Rate = 26.33 L/s

Post-development Stormwater Management

			15% _{max}	30% _{max}
Controlled	Total Area (a)	0.1959	ha	16%
	WQ-02 (Flow)	0.585	ha	0.80
Un-controlled	Total Un-controlled (a)	0.136	ha	10%
	WQ-01	0.040	ha	0.57
Total Un-controlled (a)		0.040	ha	0.67

Post-development Stormwater Management (Precipitation WQ-01)

100 Year Storm Event:

$I_{100} = 1725.688 / (T + 6.16)^{0.58}$ a = 1725.688 b = 0.820 c = 6.514

Time (min)	Intensity (mm/hr)	Uncontrolled Runoff (L/s)	Controlled Release Rate Constant (L/s)	Total Release Rate (L/s)
10	170.6	18.00	5.00	18.00

Post-development Stormwater Management (WQ-02)

100 Year Storm Event:

$I_{100} = 1725.688 / (T + 6.16)^{0.58}$ a = 1725.688 b = 0.820 c = 6.514

Time (min)	Intensity (mm/hr)	Storage Required		Controlled Release Rate Constant (L/s)	Uncontrolled Runoff (L/s)	Total Release Rate (L/s)
		Controlled Runoff (L/s)	Storage Volume (m³)			
10	170.6	0.00	0.00	5.00	0.00	5.00
15	162.9	20.26	20.27	3.25	0.00	3.25
20	159.0	22.62	22.64	3.25	0.00	3.25
25	156.8	19.49	24.62	3.25	0.00	3.25
30	155.2	17.02	24.68	3.25	0.00	3.25
35	154.1	15.24	23.40	3.25	0.00	3.25
40	153.3	13.85	22.77	3.25	0.00	3.25
45	152.7	12.82	22.87	3.25	0.00	3.25
50	152.2	12.02	22.69	3.25	0.00	3.25
60	150.9	10.38	22.69	3.25	0.00	3.25
70	149.8	9.20	22.71	3.25	0.00	3.25
80	148.9	8.30	24.54	3.25	0.00	3.25
90	148.1	7.60	22.71	3.25	0.00	3.25
100	147.3	7.04	22.77	3.25	0.00	3.25
110	146.6	6.59	21.78	3.25	0.00	3.25
120	146.0	6.21	20.62	3.25	0.00	3.25

Total Storage Required = 25.90 m³
 Available surface Storage = 27.80 m³ refer to LRL Plan C.601

Peak Control Design (100)	3.25	L/s
Design	1.62	m

Post-development Stormwater Management (WQ-02 On Road)

100 Year Storm Event:

$I_{100} = 1725.688 / (T + 6.16)^{0.58}$ a = 1725.688 b = 0.820 c = 6.514

Time (min)	Intensity (mm/hr)	Storage Required		Controlled Release Rate Constant (L/s)	Uncontrolled Runoff (L/s)	Total Release Rate (L/s)
		Controlled Runoff (L/s)	Storage Volume (m³)			
10	170.6	0.00	0.00	5.00	0.00	5.00
15	162.9	20.27	20.27	3.25	0.00	3.25
20	159.0	22.64	22.64	3.25	0.00	3.25
25	156.8	19.49	24.62	3.25	0.00	3.25
30	155.2	17.02	24.68	3.25	0.00	3.25
35	154.1	15.24	23.40	3.25	0.00	3.25
40	153.3	13.85	22.77	3.25	0.00	3.25
45	152.7	12.82	22.87	3.25	0.00	3.25
50	152.2	12.02	22.69	3.25	0.00	3.25
60	150.9	10.38	22.69	3.25	0.00	3.25
70	149.8	9.20	22.71	3.25	0.00	3.25
80	148.9	8.30	24.54	3.25	0.00	3.25
90	148.1	7.60	22.71	3.25	0.00	3.25
100	147.3	7.04	22.77	3.25	0.00	3.25
110	146.6	6.59	21.78	3.25	0.00	3.25
120	146.0	6.21	20.62	3.25	0.00	3.25



$V = (1/2)(W^2) \cdot H/3$

Summary of Roof Storage

Maximum Required Roof Storage (100 Year) = 23.40 m³
 Waste Roof Drain Discharge = 0.0242 L/min
 Proposed Peak = 150 mm *An emergency overflow scupper is provided above this height.
 Control Roof Drain = 0.23 L/s
 Number of Roof Drains = 6
 Total Flow from Roof Drains = 3.78 L/s
 Available Roof Surface = 605 m²
 Effective Roof Surface = 484 m² 80 % of total roof surface
 Available Roof Storage = 23.50 m³
 Roof Drain Model = Waste Roof Drain with Adjustable Flow Setting (WQ-100-A-AD-100-Open-Closed)

Total Storage Required = 23.40 m³
 Available Roof Storage = 23.50 m³ refer to LRL Plan C.601

Summary of Release Rates and Storage Volumes

Catchment Area (ha)	100-year Return Rate (mm)	100-Year Required Storage (m³)	Total Available Storage (m³)
WQ-01	0.80	1	25
WQ-02 (Roof Control)	0.02	3.70	27.80
WQ-02	0.02	3.25	27.80
TOTAL	0.82	24.95	48.31

LRL Associates Ltd.
Storm Design Sheet



LRL File No. 200463
Project: Apartment Building
Location: 700 Coronation Avenue
Date: October 30, 2020
Designed: Amr Salem
Drawing Reference: C.401

Storm Design Parameters

Rational Method $Q = 2.78CIA$

Q = Peak flow in litres per second (L/s)
 A = Drainage area in hectares (ha)
 C = Runoff coefficient
 I = Rainfall intensity (mm/hr)

Runoff Coefficient (C)
 Grass 0.20
 Gravel 0.80
 Asphalt / rooftop 0.90


Ottawa Macdonald-Cartier International Airport IDF curve
 equation (2 year event, intensity in mm/hr)
 $I_2 = 732.95 / (Td + 6.199)^{0.81}$
 Min. velocity = 0.80 m/s
 Manning's "n" = 0.013

LOCATION			AREA (ha)			FLOW						STORM SEWER							
WATERSHED / STREET	From MH	To MH	C = 0.20	C = 0.80	C = 0.90	Indiv. 2.78AC	Accum. 2.78AC	Time of Conc. (min.)	Rainfall Intensity (mm/hr)	Peak Flow Q (L/s)	Controlled Flow Q (L/s)	Pipe Diameter (mm)	Type	Slope (%)	Length (m)	Capacity Full (L/s)	Velocity Full (m/s)	Time of Flow (min.)	Ratio (Q/Q _{FULL})
WS-03	BLDG	CBMH 200	0.041	0.000	0.050	0.149	0.15	10.00	76.8	11.41	3.25	250	PVC	1.00%	1.9	59.5	1.21	0.03	0.19
WS-02 & WS-01	CBMH 200	EX. STM	0.000	0.000	0.021	0.052	0.20	10.03	76.7	15.37	10.99	250	PVC	1.00%	21.0	59.5	1.21	0.29	0.26
Municipal Storm Sewer Extension	STM MH 01	EX. STM MH	0.00	0.00	0.00	0.000	0.20	10.32	75.6	15.16	10.99	300	PVC	0.50%	82.7	68.4	0.97	1.42	0.22

*Total controlled flow includes captured fre-flowing flows from trench drain

TEMPEST LMF flow curves

ICD @ CBMH 200

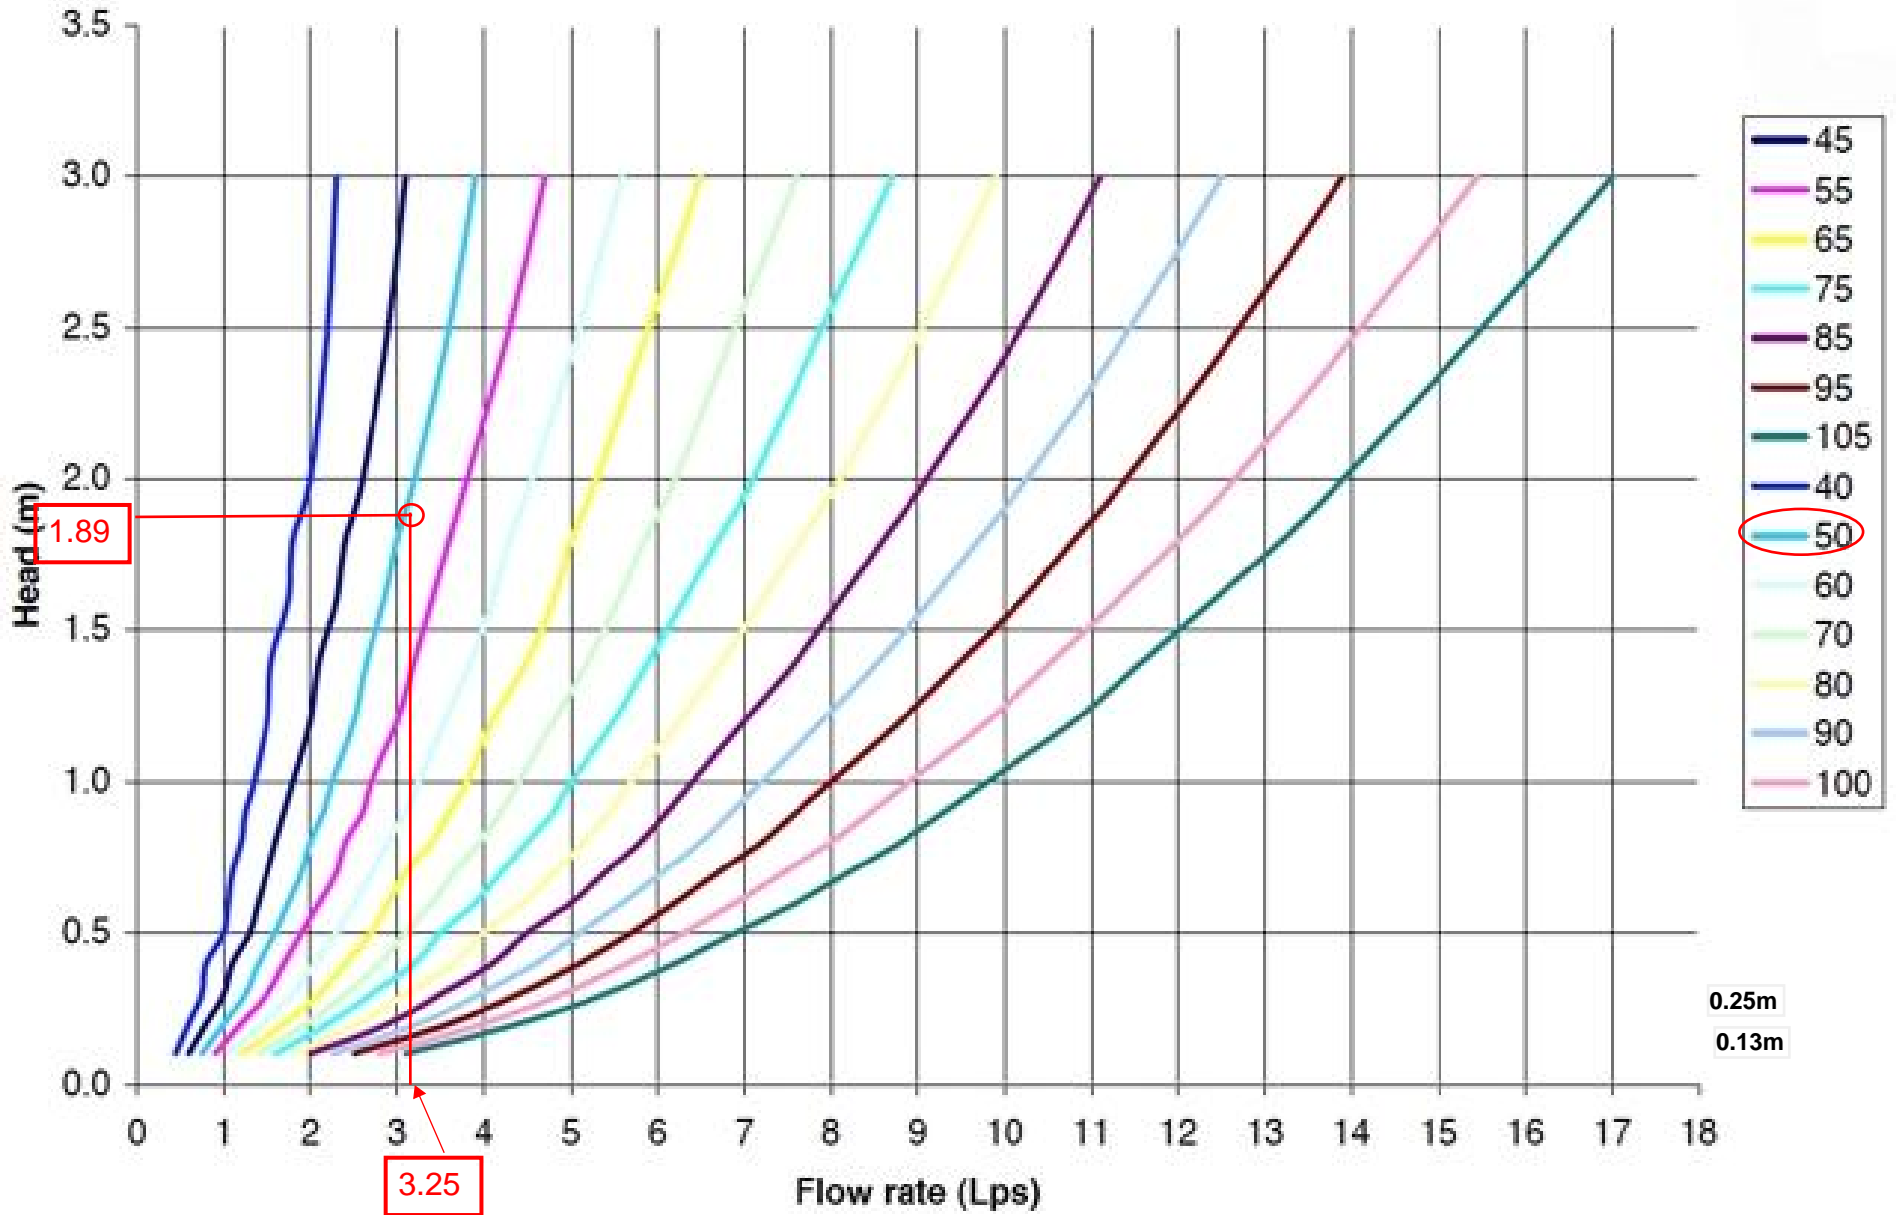

0.25m
0.13m

Volume III: TEMPEST INLET CONTROL DEVICES

Municipal Technical
Manual Series



SECOND EDITION

LMF (Low to Medium Flow) ICD

HF (High Flow) ICD

MHF (Medium to High Flow) ICD



IPEX

by aliaxis

IPEX Tempest™ Inlet Control Devices


Municipal Technical Manual Series

Vol. I, 2nd Edition

© 2018 by IPEX. All rights reserved. No part of this book may be used or reproduced in any manner whatsoever without prior written permission.

For information contact: IPEX, Marketing,
1425 North Service Road East, Oakville, Ontario, Canada, L6H 1A7

The information contained here within is based on current information and product design at the time of publication and is subject to change without notification. IPEX does not guarantee or warranty the accuracy, suitability for particular applications, or results to be obtained therefrom.

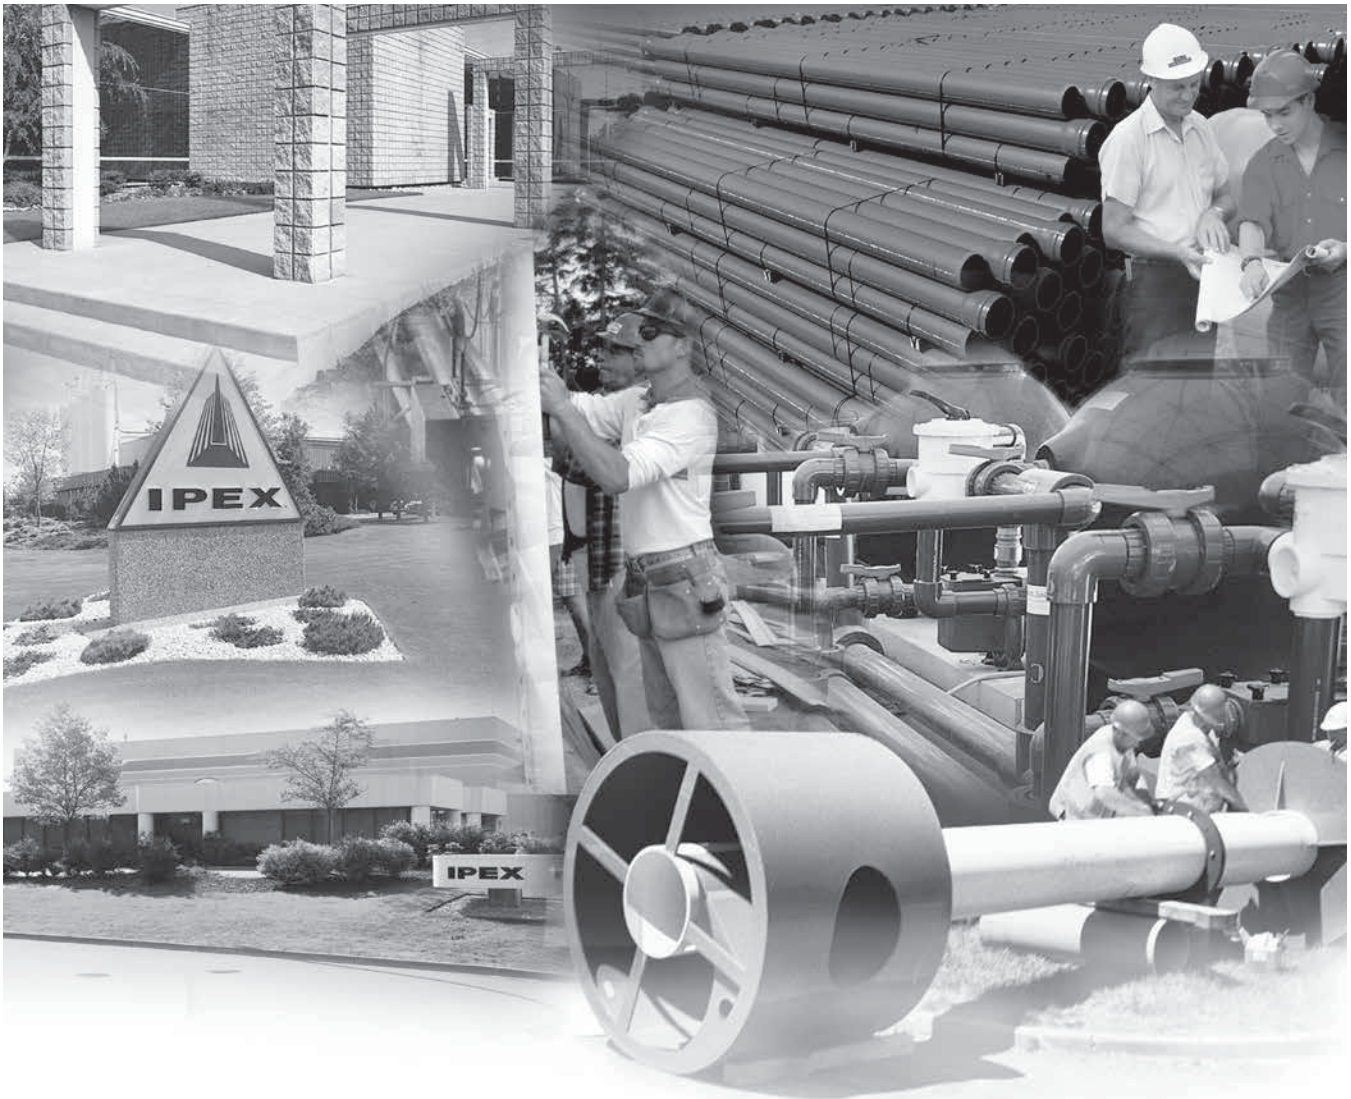

ABOUT IPEX

At IPEX, we have been manufacturing non-metallic pipe and fittings since 1951. We formulate our own compounds and maintain strict quality control during production. Our products are made available for customers thanks to a network of regional stocking locations throughout North America. We offer a wide variety of systems including complete lines of piping, fittings, valves and custom-fabricated items.

More importantly, we are committed to meeting our customers' needs. As a leader in the plastic piping industry, IPEX continually develops new products, modernizes manufacturing facilities and acquires innovative process technology. In addition, our staff take pride in their work, making available to customers their extensive thermoplastic knowledge and field experience. IPEX personnel are committed to improving the safety, reliability and performance of thermoplastic materials. We are involved in several standards committees and are members of and/or comply with the organizations listed on this page.

For specific details about any IPEX product, contact our customer service department.

CONTENTS

TEMPEST INLET CONTROL DEVICES Technical Manual

About IPEX

Section One:	Product Information: TEMPEST Low, Medium Flow (LMF) ICD	
	Purpose	4
	Product Description	4
	Product Function	4
	Product Construction	4
	Product Applications	4
	Chart 1: LMF 14 Preset Flow Curves	5
	Chart 2: LMF Flow Vs. ICD Alternatives	5
	Product Installation	
	Instructions to assemble a TEMPEST LMF ICD into a square catch basin:	6
	Instructions to assemble a TEMPEST LMF ICD into a round catch basin:	6
	Product Technical Specification	
	General	7
	Materials	7
	Dimensioning	7
	Installation	7
Section Two:	Product Information: TEMPEST High Flow (HF) & Medium, High Flow (MHF) ICD	
	Product Description	8
	Product Function	8
	Product Construction	8
	Product Applications	8
	Chart 3: HF & MHF Preset Flow Curves	9
	Product Installation	
	Instructions to assemble a TEMPEST HF or MHF ICD into a square catch basin:	10
	Instructions to assemble a TEMPEST HF or MHF ICD into a round catch basin:	10
	Instructions to assemble a TEMPEST HF Sump into a square or round catch basin: ...	11
	Product Technical Specification	
	General	11
	Materials	11
	Dimensioning	11
	Installation	11

PRODUCT INFORMATION: TEMPEST LOW, MEDIUM FLOW (LMF) ICD

Purpose

To control the amount of storm water runoff entering a sewer system by allowing a specified flow volume out of a catch basin or manhole at a specified head. This approach conserves pipe capacity so that catch basins downstream do not become uncontrollably surcharged, which can lead to basement floods, flash floods and combined sewer overflows.

Product Description

Our LMF ICD is designed to accommodate catch basins or manholes with sewer outlet pipes 6" in diameter and larger. Any storm sewer larger than 12" may require custom modification. However, IPEX can custom build a TEMPEST device to accommodate virtually any storm sewer size.

Available in 14 preset flow curves, the LMF ICD has the ability to provide flow rates: 2lps – 17lps (31gpm – 270gpm)

Product Function

The LMF ICD vortex flow action allows the LMF ICD to provide a narrower flow curve using a larger orifice than a conventional orifice plate ICD, making it less likely to clog. When comparing flows at the same head level, the LMF ICD has the ability to restrict more flow than a conventional ICD during a rain event, preserving greater sewer capacity.

Product Construction

Constructed from durable PVC, the LMF ICD is light weight 8.9 Kg (19.7 lbs).

Product Applications

Will accommodate both square and round applications:

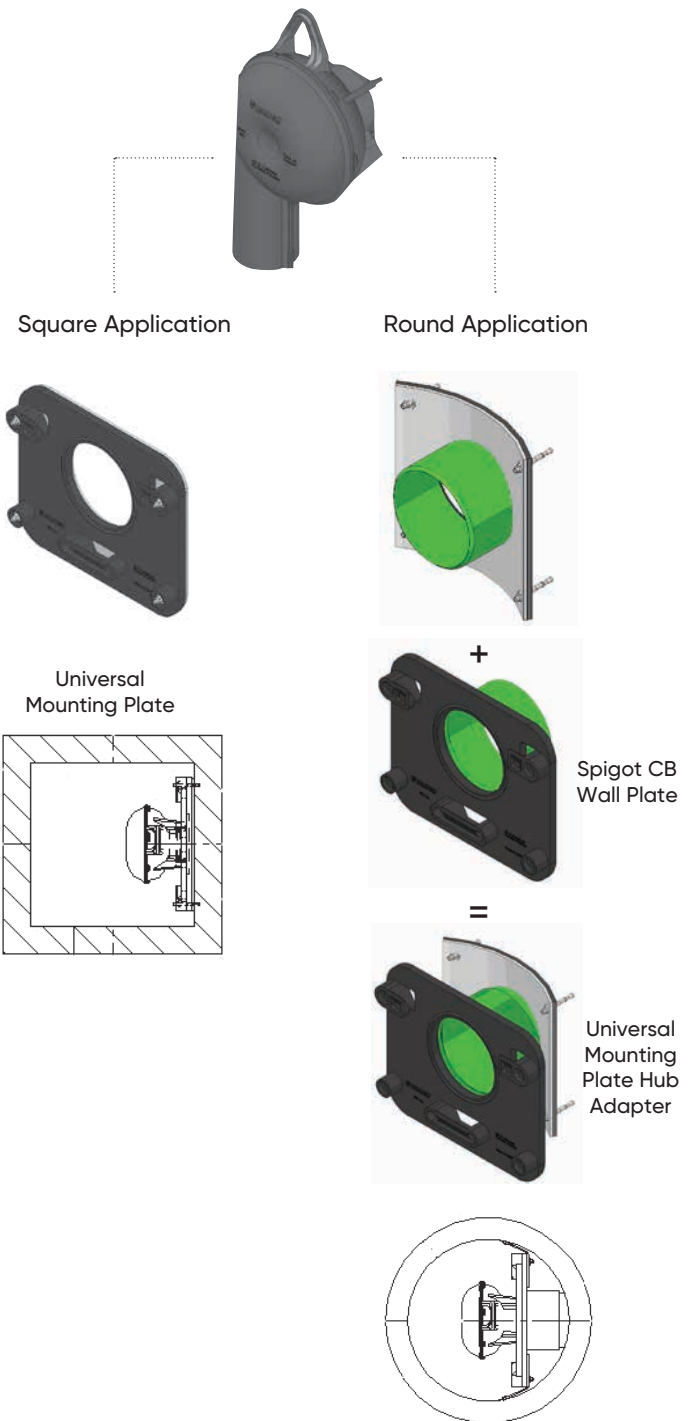


Chart 1: LMF 14 Preset Flow Curves


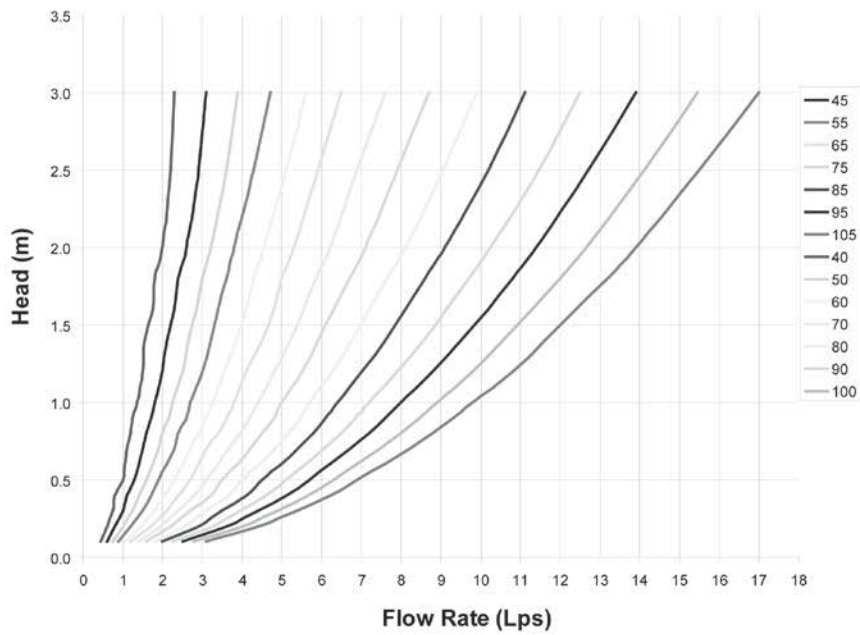


Chart 2: LMF Flow vs. ICD Alternatives

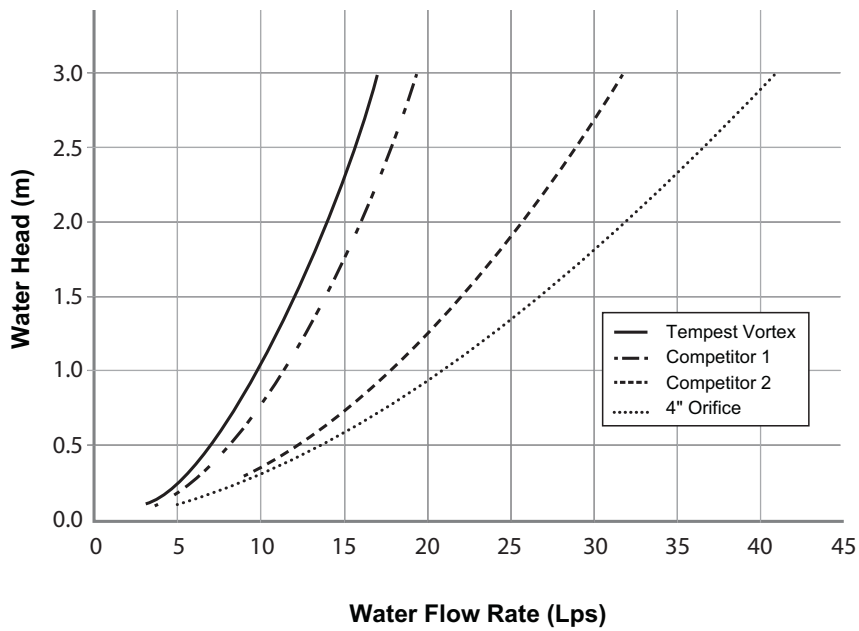

PRODUCT INSTALLATION

Instructions to assemble a TEMPEST LMF ICD into a Square Catch Basin:

STEPS:

1. Materials and tooling verification:
 - Tooling: impact drill, 3/8" concrete bit, torque wrench for 9/16" nut, hand hammer, level, and marker.
 - Material: (4) concrete anchor 3/8 x 3-1/2, (4) washers, (4) nuts, universal mounting plate, ICD device.
2. Use the mounting wall plate to locate and mark the hole (4) pattern on the catch basin wall. You should use a level to ensure that the plate is at the horizontal.
3. Use an impact drill with a 3/8" concrete bit to make the four holes at a minimum of 1-1/2" depth up to 2-1/2". Clean the concrete dust from the holes.
4. Install the anchors (4) in the holes by using a hammer. Thread the nuts on the top of the anchors to protect the threads when you hit the anchors with the hammer. Remove the nuts from the ends of the anchors.
5. Install the universal mounting plate on the anchors and screw the 4 nuts in place with a maximum torque of 40 N.m (30 lbf-ft). There should be no gap between the wall mounting plate and the catch basin wall.
6. From the ground above using a reach bar, lower the ICD device by hooking the end of the reach bar to the handle of the ICD device. Align the triangular plate portion into the mounting wall plate. Push down the device to be sure it has centered in to the universal mounting plate and has created a seal.



WARNING

- Verify that the outlet pipe doesn't protrude into the catch basin. If it does, cut down the pipe flush to the catch basin wall.
- Call your IPEX representative for more information or if you have any questions about our products.

Instructions to assemble a TEMPEST LMF ICD into a Round Catch Basin:

STEPS:

1. Materials and tooling verification.
 - Tooling: impact drill, 3/8" concrete bit, torque wrench for 9/16" nut, hand hammer, level and marker.
 - Material: (4) concrete anchor 3/8 x 3-1/2, (4) washers and (4) nuts, spigot CB wall plate, universal mounting plate hub adapter, ICD device.
2. Use the spigot catch basin wall plate to locate and mark the hole (4) pattern on the catch basin wall. You should use a level to ensure that the plate is at the horizontal.
3. Use an impact drill with a 3/8" concrete bit to make the four holes at a depth between 1-1/2" to 2-1/2". Clean the concrete dust from the holes.
4. Install the anchors (4) in the holes by using a hammer. Thread the nuts on the top of the anchors to protect the threads when you hit the anchors with the hammer. Remove the nuts from the ends of the anchors.
5. Install the CB spigot wall plate on the anchors and screw the 4 nuts in place with a maximum torque of 40 N.m (30 lbf-ft). There should be no gap between the spigot wall plate and the catch basin wall.
6. Apply solvent cement on the hub of the universal mounting plate, hub adapter and the spigot of the CB wall plate, then slide the hub over the spigot. Make sure the universal mounting plate is at the horizontal and its hub is completely inserted onto the spigot. Normally, the corners of the universal mounting plate hub adapter should touch the catch basin wall.
7. From ground above using a reach bar, lower the ICD device by hooking the end of the reach bar to the handle of the ICD device. Align the triangular plate portion into the mounting wall plate. Push down the device to be sure it has centered in to the mounting plate and has created a seal.



WARNING

- Verify that the outlet pipe doesn't protrude into the catch basin. If it does, cut back the pipe flush to the catch basin wall.
- The solvent cement which is used in this installation is to be approved for PVC.
- The solvent cement should not be used below 0°C (32°F) or in a high humidity environment. Refer to the IPEX solvent cement guide to confirm the required curing time or visit the IPEX Online Solvent Cement Training Course available at ipexna.com.
- Call your IPEX representative for more information or if you have any questions about our products.

PRODUCT TECHNICAL SPECIFICATION

General

Inlet control devices (ICD's) are designed to provide flow control at a specified rate for a given water head level and also provide odour and floatable control. All ICD's will be IPEX Tempest or approved equal.

All devices shall be removable from a universal mounting plate. An operator from street level using only a T-bar with a hook will be able to retrieve the device while leaving the universal mounting plate secured to the catch basin wall face. The removal of the TEMPEST devices listed above must not require any unbolting or special manipulation or any special tools.

High Flow (HF) Sump devices will consist of a removable threaded cap which can be accessible from street level with out entry into the catchbasin (CB). The removal of the threaded cap shall not require any special tools other than the operator's hand.

ICD's shall have no moving parts.

Materials

ICD's are to be manufactured from Polyvinyl Chloride (PVC) or Polyurethane material, designed to be durable enough to withstand multiple freeze-thaw cycles and exposure to harsh elements.

The inner ring seal will be manufactured using a Buna or Nitrile material with hardness between Duro 50 and Duro 70.

The wall seal is to be comprised of a 3/8" thick Neoprene Closed Cell Sponge gasket which is attached to the back of the wall plate.

All hardware will be made from 304 stainless steel.

Dimensioning

The Low Medium Flow (LMF), High Flow (HF) and the High Flow (HF) Sump shall allow for a minimum outlet pipe diameter of 200mm with a 600mm deep Catch Basin sump.

Installation

Contractor shall be responsible for securing, supporting and connecting the ICD's to the existing influent pipe and catchbasin/manhole structure as specified and designed by the Engineer.

PRODUCT INFORMATION: TEMPEST HF & MHF ICD

Product Description

Our HF, HF Sump and MHF ICD's are designed to accommodate catch basins or manholes with sewer outlet pipes 6" in diameter or larger. Any storm sewer larger than 12" may require custom modification. However, IPEX can custom build a TEMPEST device to accommodate virtually any storm sewer size.

Available in 5 preset flow curves, these ICDs have the ability to provide constant flow rates: 9lps (143 gpm) and greater

Product Function

TEMPEST HF (High Flow): designed to manage moderate to higher flows 15 L/s (240 gpm) or greater and prevent the propagation of odour and floatables. With this device, the cross-sectional area of the device is larger than the orifice diameter and has been designed to limit head losses. The HF ICD can also be ordered without flow control when only odour and floatable control is required.



TEMPEST HF (High Flow) Sump: The height of a sewer outlet pipe in a catch basin is not always conveniently located. At times it may be located very close to the catch basin floor, not providing enough sump for one of the other TEMPEST ICDs with universal back plate to be installed. In these applications, the HF Sump is offered. The HF Sump offers the same features and benefits as the HF ICD; however, is designed to raise the outlet in a square or round catch basin structure. When installed, the HF sump is fixed in place and not easily removed. Any required service to the device is performed through a clean-out located in the top of the device which can be often accessed from ground level.



TEMPEST MHF (Medium to High Flow): The MHF plate or plug is designed to control flow rates 9 L/s (143 gpm) or greater. It is not designed to prevent the propagation of odour and floatables.




Product Construction

The HF, HF Sump and MHF ICDs are built to be light weight at a maximum weight of 6.8 Kg (14.6 lbs).


Product Applications

The HF and MHF ICD's are available to accommodate both square and round applications:

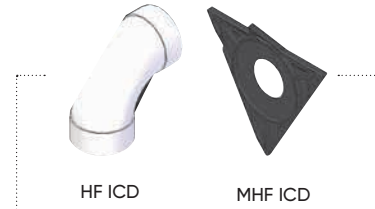


Square Application

Universal Mounting Plate



Round Application

Spigot CB Wall Plate




Universal Mounting Plate Hub Adapter




+


=



The HF Sump is available to accommodate low to no sump applications in both square and round catch basins:

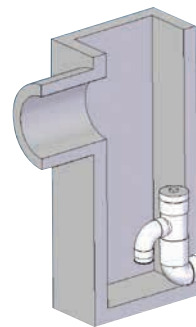


Square Catch Basin

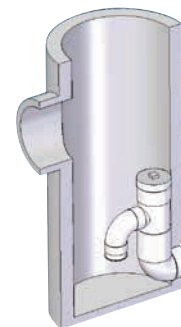

Round Catch Basin

Chart 3: HF & MHF Preset Flow Curves

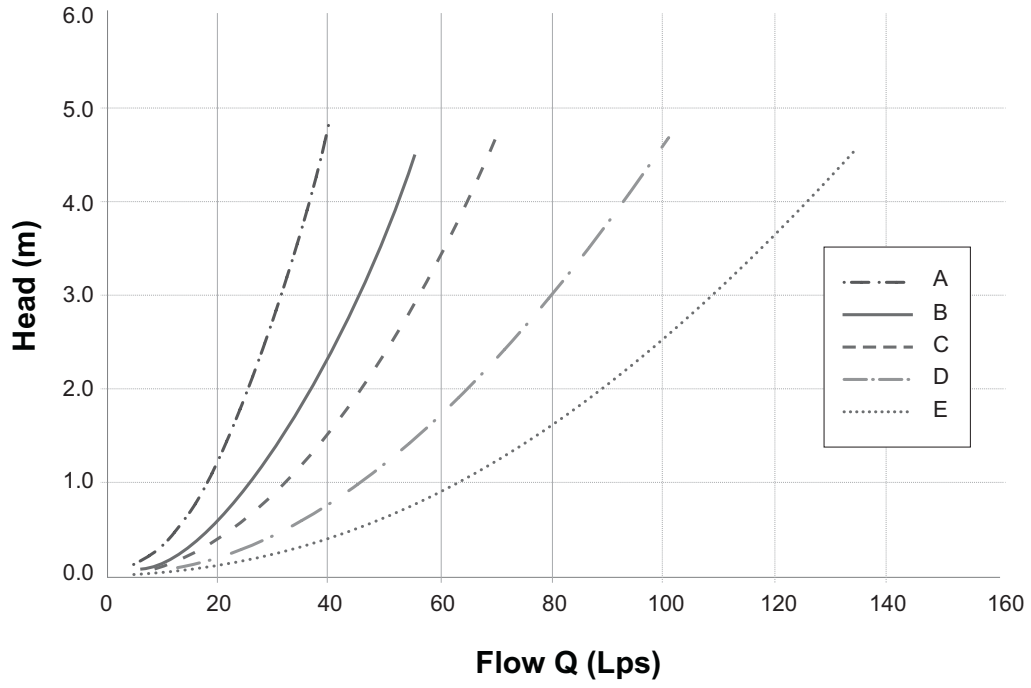

PRODUCT INSTALLATION

Instructions to assemble a TEMPEST HF or MHF ICD into a Square Catch Basin:

1. Materials and tooling verification:
 - Tooling: impact drill, 3/8" concrete bit, torque wrench for 9/16" nut, hand hammer, level, and marker.
 - Material: (4) concrete anchor 3/8 x 3-1/2, (4) washers, (4) nuts, universal mounting plate, ICD device
2. Use the mounting wall plate to locate and mark the hole (4) pattern on the catch basin wall. You should use a level to ensure that the plate is at the horizontal.
3. Use an impact drill with a 3/8" concrete bit to make the four holes at a minimum of 1-1/2" depth up to 2-1/2". Clean the concrete dust from the holes.
4. Install the anchors (4) in the holes by using a hammer. Thread the nuts on the top of the anchors to protect the threads when you hit the anchors with the hammer. Remove the nuts from the ends of the anchors.
5. Install the universal wall mounting plate on the anchors and screw the 4 nuts in place with a maximum torque of 40 N.m (30 lbf-ft). There should be no gap between the wall mounting plate and the catch basin wall.
6. From the ground above using a reach bar, lower the device by hooking the end of the reach bar to the handle of the ICD device. Align the triangular plate portion into the mounting wall plate. Push down the device to be sure it has centered in to the universal wall mounting plate and has created a seal.



WARNING

- Verify that the outlet pipe doesn't protrude into the catch basin. If it does, cut down the pipe flush to the catch basin wall.
- Call your IPEX representative for more information or if you have any questions about our products.

Instructions to assemble a TEMPEST HF or MHF ICD into a Round Catch Basin:

STEPS:

1. Materials and tooling verification.
 - Tooling: impact drill, 3/8" concrete bit, torque wrench for 9/16" nut, hand hammer, level and marker.
 - Material: (4) concrete anchor 3/8 x 3-1/2, (4) washers and (4) nuts, spigot CB wall plate, universal mounting plate hub adapter, ICD device.
2. Use the round catch basin spigot adaptor to locate and mark the hole (4) pattern on the catch basin wall. You should use a level to ensure that the plate is at the horizontal.
3. Use an impact drill with a 3/8" concrete bit to make the four holes at a depth between 1-1/2" to 2-1/2". Clean the concrete dust from the holes.
4. Install the anchors (4) in the holes by using a hammer. Thread the nuts on the top of the anchors to protect the threads when you hit the anchors with the hammer. Remove the nuts from the ends of the anchors.
5. Install the spigot CB wall plate on the anchors and screw the 4 nuts in place with a maximum torque of 40 N.m (30 lbf-ft). There should be no gap between the spigot CB wall plate and the catch basin wall.
6. Put solvent cement on the hub of the universal mounting plate, hub adapter and the spigot of the CB wall plate, then slide the hub over the spigot. Make sure the universal mounting plate is at the horizontal and its hub is completely inserted onto the spigot. Normally, the corners of the hub adapter should touch the catch basin wall.
7. From ground above using a reach bar, lower the device by hooking the end of the reach bar to the handle of the ICD device. Align the triangular plate portion into the mounting wall plate. Push down the device to be sure it has centered in to the wall mounting plate and has created a seal.



WARNING

- Verify that the outlet pipe doesn't protrude into the catch basin. If it does, cut down the pipe flush to the catch basin wall.
- The solvent cement which is used in this installation is to be approved for PVC.
- The solvent cement should not be used below 0°C (32°F) or in a high humidity environment. Refer to the IPEX solvent cement guide to confirm the required curing time or visit the IPEX Online Solvent Cement Training Course available at www.ipexinc.com.
- Call your IPEX representative for more information or if you have any questions about our products.

Instructions to assemble a TEMPEST HF Sump into a Square or Round Catch Basin:

STEPS:

1. Materials and tooling verification:
 - Tooling: impact drill, 3/8" concrete bit, torque wrench for 9/16" nut, hand hammer, level, mastic tape and metal strapping
 - Material: (2) concrete anchor 3/8 x 3-1/2, (2) washers, (2) nuts, HF Sump pieces (2).
2. Apply solvent cement to the spigot end of the top half of the sump. Apply solvent cement to the hub of the bottom half of the sump. Insert the spigot of the top half of the sump into the hub of the bottom half of the sump.
3. Install the 8" spigot of the device into the outlet pipe. Use the mastic tape to seal the device spigot into the outlet pipe. You should use a level to be sure that the fitting is standing at the vertical.
4. Use an impact drill with a 3/8" concrete bit to make a series of 2 holes along each side of the body throat. The depth of the hole should be between 1-1/2" to 2-1/2". Clean the concrete dust from the 2 holes.
5. Install the anchors (2) in the holes by using a hammer. Put the nuts on the top of the anchors to protect the threads when you hit the anchors. Remove the nuts from the ends of the anchors.
6. Cut the metal strapping to length and connect each end of the strapping to the anchors. Screw the nuts in place with a maximum torque of 40 N.m (30 lbf-ft). The device should be completely flush with the catch basin wall.



WARNING

- Verify that the outlet pipe doesn't protrude into the catch basin. If it does, cut down the pipe flush to the catch basin wall.
- The solvent cement which is used in this installation is to be approved for PVC.
- The solvent cement should not be used below 0°C (32°F) or in a high humidity environment. Refer to the IPEX solvent cement guide to confirm the required curing time or visit the IPEX Online Solvent Cement Training Course available at www.ipexinc.com.
- Call your IPEX representative for more information or if you have any questions about our products.

PRODUCT TECHNICAL SPECIFICATION

General

Inlet control devices (ICD's) are designed to provide flow control at a specified rate for a given water head level and also provide odour and floatable control where specified. All ICD's will be IPEX Tempest or approved equal.

All devices shall be removable from a universal mounting plate. An operator from street level using only a T-bar with a hook shall be able to retrieve the device while leaving the universal mounting plate secured to the catch basin wall face. The removal of the TEMPEST devices listed above shall not require any unbolting or special manipulation or any special tools.

High Flow (HF) Sump devices shall consist of a removable threaded cap which can be accessible from street level with out entry into the catchbasin (CB). The removal of the threaded cap shall not require any special tools other than the operator's hand.

ICD's shall have no moving parts.

Materials

ICD's are to be manufactured from Polyvinyl Chloride (PVC) or Polyurethane material, designed to be durable enough to withstand multiple freeze-thaw cycles and exposure to harsh elements.

The inner ring seal will be manufactured using a Buna or Nitrile material with hardness between Duro 50 and Duro 70.

The wall seal is to be comprised of a 3/8" thick Neoprene Closed Cell Sponge gasket which is attached to the back of the wall plate.

All hardware will be made from 304 stainless steel.

Dimensioning

The Low Medium Flow (LMF), High Flow (HF) and the High Flow (HF) Sump shall allow for a minimum outlet pipe diameter of 200mm with a 600mm deep Catch Basin sump.

Installation

Contractor shall be responsible for securing, supporting and connecting the ICD's to the existing influent pipe and catchbasin/manhole structure as specified and designed by the Engineer.

NOTES

SALES AND CUSTOMER SERVICE

IPEX Inc.

Toll Free: (866) 473-9462

ipexna.com

About the IPEX Group of Companies

As leading suppliers of thermoplastic piping systems, the IPEX Group of Companies provides our customers with some of the largest and most comprehensive product lines. All IPEX products are backed by more than 50 years of experience. With state-of-the-art manufacturing facilities and distribution centers across North America, we have established a reputation for product innovation, quality, end-user focus and performance.

Markets served by IPEX group products are:

- Electrical systems
- Telecommunications and utility piping systems
- PVC, CPVC, PP, ABS, PEX, FR-PVDF and PE pipe and fittings (1/4" to 48")
- Industrial process piping systems
- Municipal pressure and gravity piping systems
- Plumbing and mechanical piping systems
- PE Electrofusion systems for gas and water
- Industrial, plumbing and electrical cements
- Irrigation systems

Products manufactured by IPEX Inc.

Tempest™ is a trademark of IPEX Branding Inc.

This literature is published in good faith and is believed to be reliable. However it does not represent and/or warrant in any manner the information and suggestions contained in this brochure. Data presented is the result of laboratory tests and field experience.

A policy of ongoing product improvement is maintained. This may result in modifications of features and/or specifications without notice.



ADJUSTABLE ACCUTROL (for Large Sump Roof Drains only)


For more flexibility in controlling flow with heads deeper than 2", Watts Drainage offers the Adjustable Accutrol. The Adjustable Accutrol Weir is designed with a single parabolic opening that can be covered to restrict flow above 2" of head to less than 5 gpm per inch, up to 6" of head. To adjust the flow rate for depths over 2" of head, set the slot in the adjustable upper cone according to the flow rate required. Refer to Table 1 below.

Note: Flow rates are directly proportional to the amount of weir opening that is exposed.

EXAMPLE:

For example, if the adjustable upper cone is set to cover 1/2 of the weir opening, flow rates above 2" of head will be restricted to 2-1/2 gpm per inch of head.

Therefore, at 3" of head, the flow rate through the Accutrol Weir that has 1/2 the slot exposed will be:
 [5 gpm(per inch of head) x 2 inches of head] + 2-1/2 gpm(for the third inch of head) = 12-1/2 gpm.

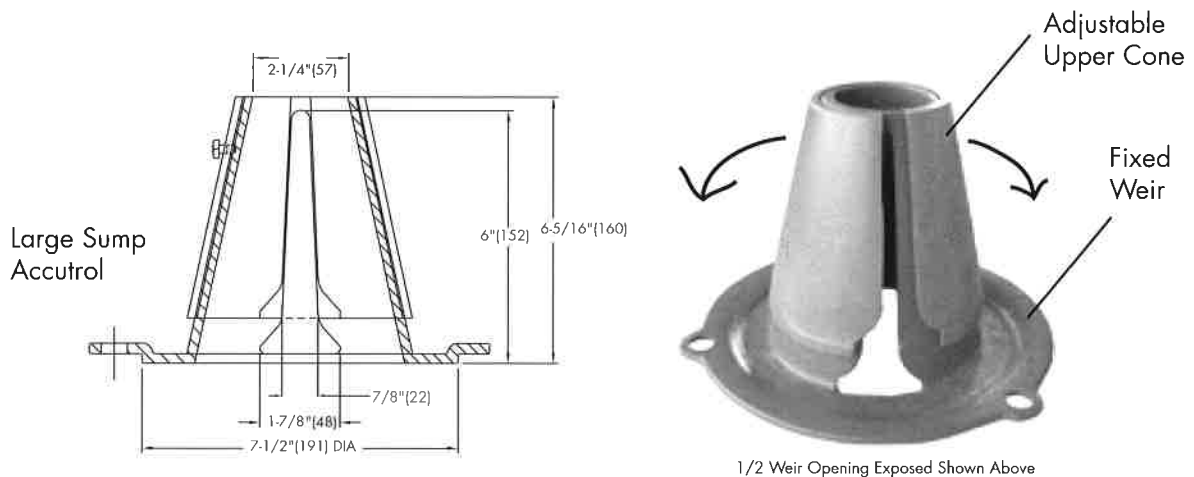
TABLE 1. Adjustable Accutrol Flow Rate Settings


Weir Opening Exposed	Head of Water					
	1"	2"	3"	4"	5"	6"
Flow Rate (gallons per minute)						
Fully Exposed	5	10	15	20	25	30
3/4	5	10	13.75	17.5	21.25	25
1/2	5	10	12.5	15	17.5	20
1/4	5	10	11.25	12.5	13.75	15
Closed	5	10	10	10	10	10

Job Name _____ Model No. _____
 Job Location _____ Contractor _____
 Engineer _____ Representative _____


ACCUTROL WEIR FLOW CONTROL

SPECIFICATION: Watts Drainage Products epoxy coated cast iron Accutrol Weir is designed with parabolic openings which limit the flow of rain water off a roof. Each weir slot controls flow to 5 gpm per inch of head to a maximum of 30 gpm at 6" head (for large sump), 25 gpm at 5" head (for small sump). The Accutrol Weir is secured to the flashing clamp of the roof drain. The Accutrol Weir is available with 1 to 4 slots for the large sump drain and up to 3 slots for the small sump drain.

For Large Sump Roof Drains Specify the "-A" option and number of slots required. (ie. "RD-100-A2" for two slot weir)
For Small Sump Roof Drains Specify the "-A" option and number of slots required. (ie. "RD-200-A1" for one slot weir)

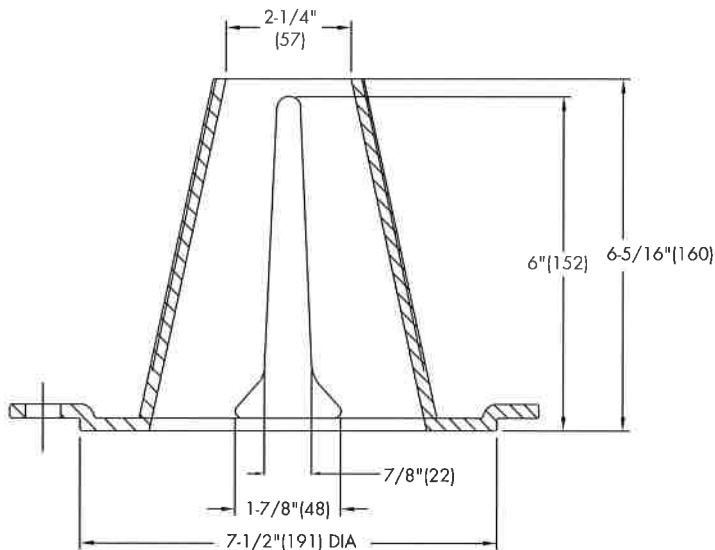

LARGE SUMP ACCUTROL WEIR

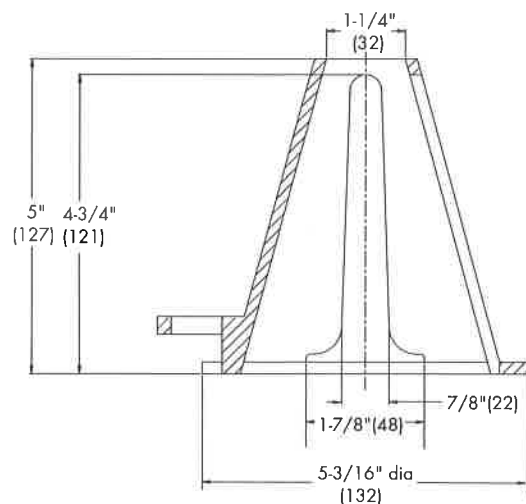

SMALL SUMP ACCUTROL WEIR

Job Name _____ Model No. _____

Job Location _____ Contractor _____

Engineer _____ Representative _____



WATTS Drainage reserves the right to modify or change product design or construction without prior notice and without incurring any obligation to make similar changes and modifications to products previously or subsequently sold. See your WATTS Drainage representative for any clarification. Dimensions are subject to manufacturing tolerances.






Specification Drainage Products

CANADA: 5435 North Service Road, Burlington, ON, L7L 5H7 TEL: 905-332-6718 TOLL-FREE: 1-888-208-8927 Website: www.wattscanada.ca

APPENDIX E
Civil Engineering Drawings



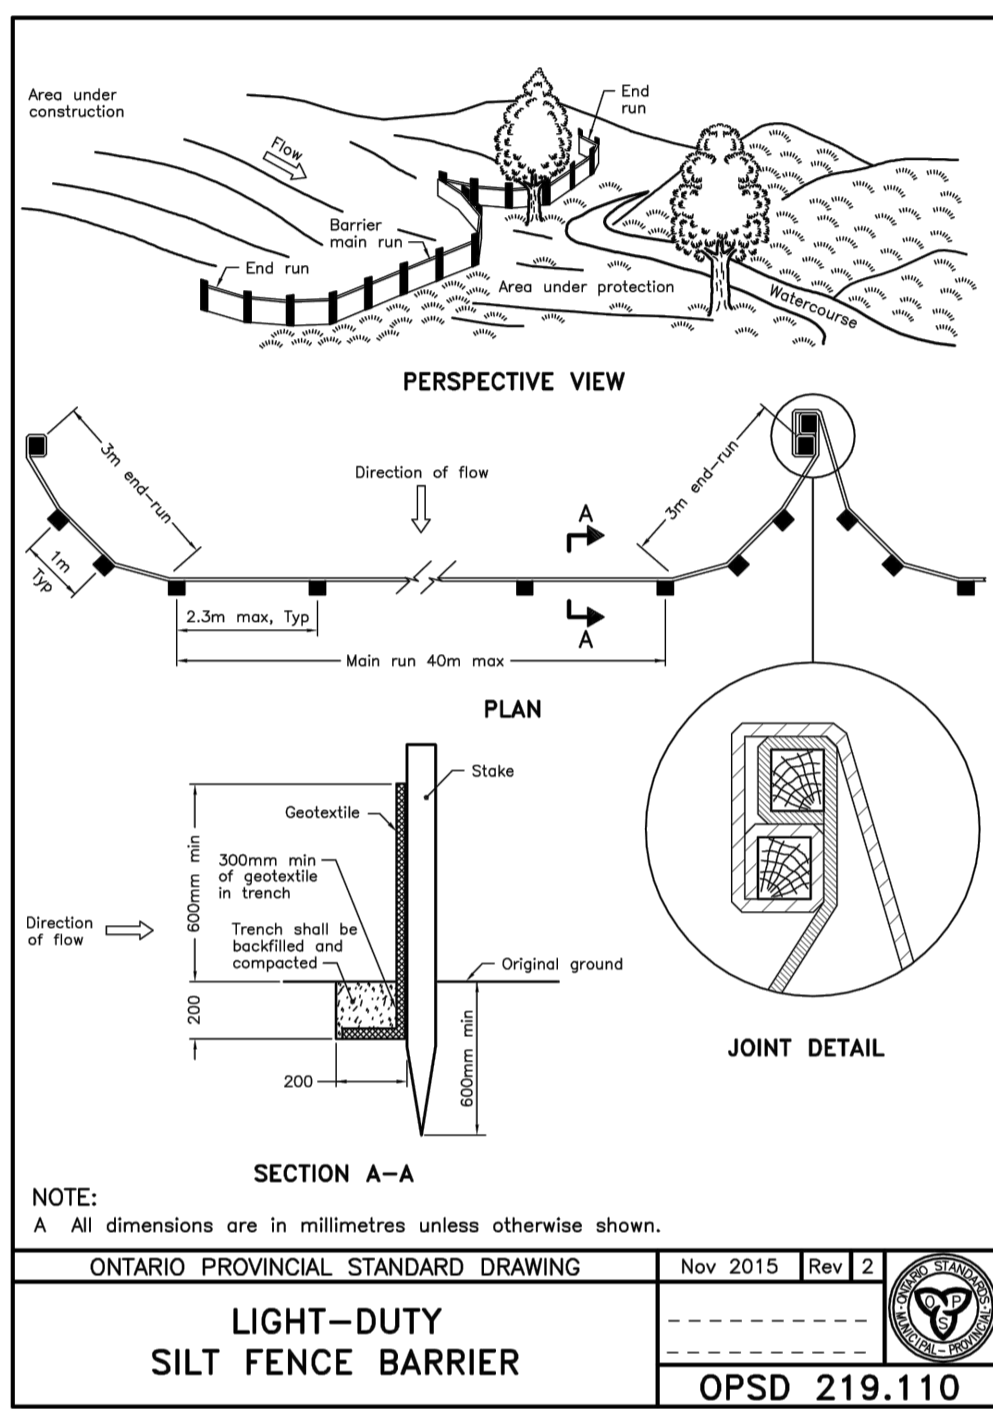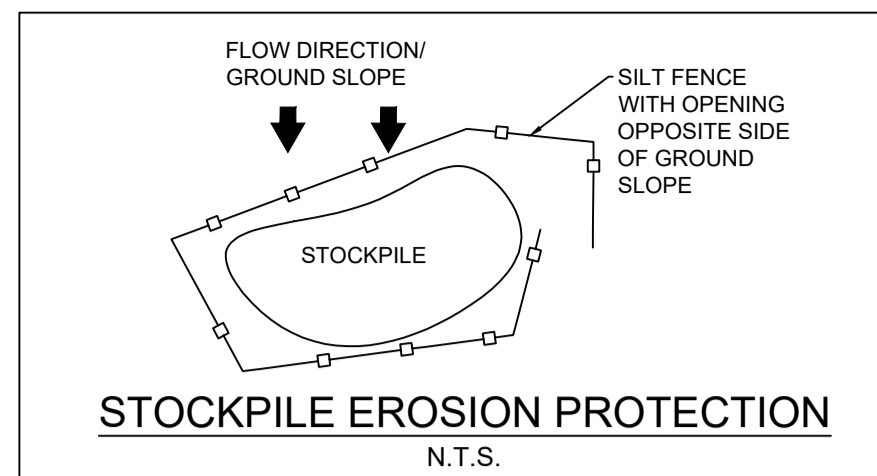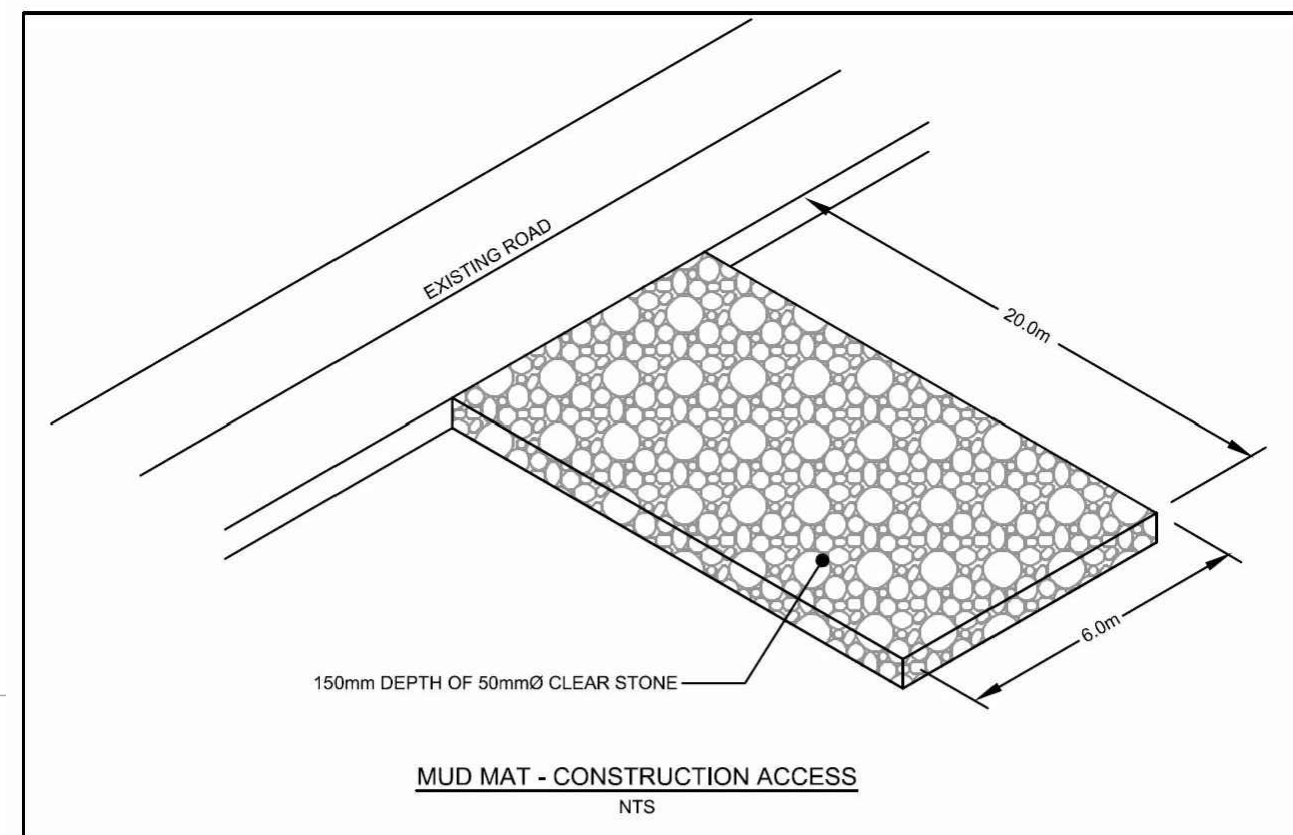

EROSION AND SEDIMENT CONTROL MEASURES:

** CONTRACTOR IS RESPONSIBLE FOR ALL INSTALLATION, MONITORING, REPAIR AND REMOVAL OF ALL EROSION AND SEDIMENT CONTROL FEATURES **

1. PRIOR TO START OF CONSTRUCTION:


- PRIOR TO THE REMOVAL OF ANY VEGETATIVE COVER, MOVING OF SOIL AND CONSTRUCTION:
- INSTALL SILT FENCE IMMEDIATELY DOWNSTREAM FROM AREAS TO BE DISTURBED (SEE PLAN FOR LOCATION)
- INSTALL GEOSOCK INSERTS WITH AN OVERFLOW IN ALL THE DOWNSTREAM CATCHBASINS AND MANHOLES
- INSTALL SILTSACK FILTERS IN ALL CONCRETE CATCH BASIN STRUCTURES
- INSPECT MEASURES IMMEDIATELY AFTER INSTALLATION.

2. DURING CONSTRUCTION:

- WORK TO BE DONE IN THE VICINITY OF MAJOR WATERWAYS TO BE CARRIED OUT FROM JULY TO SEPTEMBER ONLY.
- MINIMIZE THE EXTENT OF DISTURBED AREAS AND THE DURATION OF EXPOSURE.
- PROTECT DISTURBED AREAS FROM RUNOFF.
- PROVIDE TEMPORARY COVER SUCH AS SEEDING OR MULCHING IF DISTURBED AREA WILL NOT BE REHABILITATED WITHIN 30 DAYS.
- INSPECT SILT FENCES, FILTER CLOTHS AND CATCH BASIN SUMPS WEEKLY AND AFTER EVERY MAJOR STORM EVENT. CLEAN AND REPAIR WHEN NECESSARY.
- CONSTRUCT SWALES AS PER DETAIL.
- PLAN TO BE REVIEWED AND REVISED AS REQUIRED DURING CONSTRUCTION
- EROSION CONTROL FENCING TO BE ALSO INSTALLED AROUND THE BASE OF ALL STOCKPILES
- DO NOT LOCATE TOPSOIL PILES AND EXCAVATION MATERIAL CLOSER THAN 2.5m FROM ANY PAVED SURFACE, OR ONE WHICH IS TO BE PAVED BEFORE THE PILE IS REMOVED. ALL TOPSOIL PILES ARE TO BE SEEDDED IF THEY ARE TO REMAIN ON SITE LONG ENOUGH FOR SEEDS TO GROW (LONGER THAN 30 DAYS).
- CONTROL WIND-BLOWN DUST OFF SITE TO ACCEPTABLE LEVELS BY SEEDING TOPSOIL PILES AND OTHER AREAS TEMPORARILY (PROVIDE WATERING AS REQUIRED).
- ALL EROSION CONTROL STRUCTURE TO REMAIN IN PLACE UNTIL ALL DISTURBED GROUND SURFACES HAVE BEEN STABILIZED EITHER BY PAVING OR RESTORATION OF VEGETATIVE GROUND COVER.
- NO ALTERNATE METHODS OF EROSION PROTECTION SHALL BE PERMITTED UNLESS APPROVED BY THIS CONSULTING ENGINEER AND THE CITY DEPARTMENT OF PUBLIC WORKS.
- CONTRACTOR RESPONSIBLE FOR CITY ROADWAY AND SIDEWALK TO BE CLEANED OF ALL SEDIMENT FROM VEHICULAR TRACKING ETC. AT THE END OF EACH WORK DAY.
- PROVIDE GRAVEL ENTRANCE WHEREVER EQUIPMENT LEAVES THE SITE TO PREVENT MUD TRACKING ONTO PAVED SURFACES. GRAVEL BED SHALL BE A MINIMUM OF 15m LONG, 4M WIDE AND 0.3m DEEP AND SHALL CONSIST OF COARSE (50mm CRUSHED-RUN LIMESTONE) MATERIAL. MAINTAIN GRAVEL ENTRANCE IN CLEAN CONDITION.
- DURING WET CONDITIONS, TIRES OF ALL VEHICLES/EQUIPMENT LEAVING THE SITE ARE TO BE SCRAPPED.
- ANY MUD/MATERIAL TRACKED ONTO THE ROADWAY SHALL BE REMOVED IMMEDIATELY BY HAND OR RUBBER TIRE LOADER.
- TAKE ALL NECESSARY STEPS TO PREVENT BUILDING MATERIAL, CONSTRUCTION DEBRIS OR WASTE BEING SPILLED OR TRACKED ONTO ADJUTING PROPERTIES OR PUBLIC STREETS DURING CONSTRUCTION AND PROCEED IMMEDIATELY TO CLEAN UP ANY AREAS SO AFFECTED.


3. AFTER CONSTRUCTION:

- PROVIDE PERMANENT COVER CONSISTING OF TOPSOIL AND SEED TO DISTURBED AREAS.
- REMOVE STRAW BALE FLOW CHECK DAMS, SILT FENCES AND FILTER CLOTHS ON CATCH BASINS AND MANHOLE COVERS
- AFTER DISTURBED AREAS HAVE BEEN REHABILITATED AND STABILIZED.
- INSPECT AND CLEAN CATCH BASIN SUMPS AND STORM SEWERS.

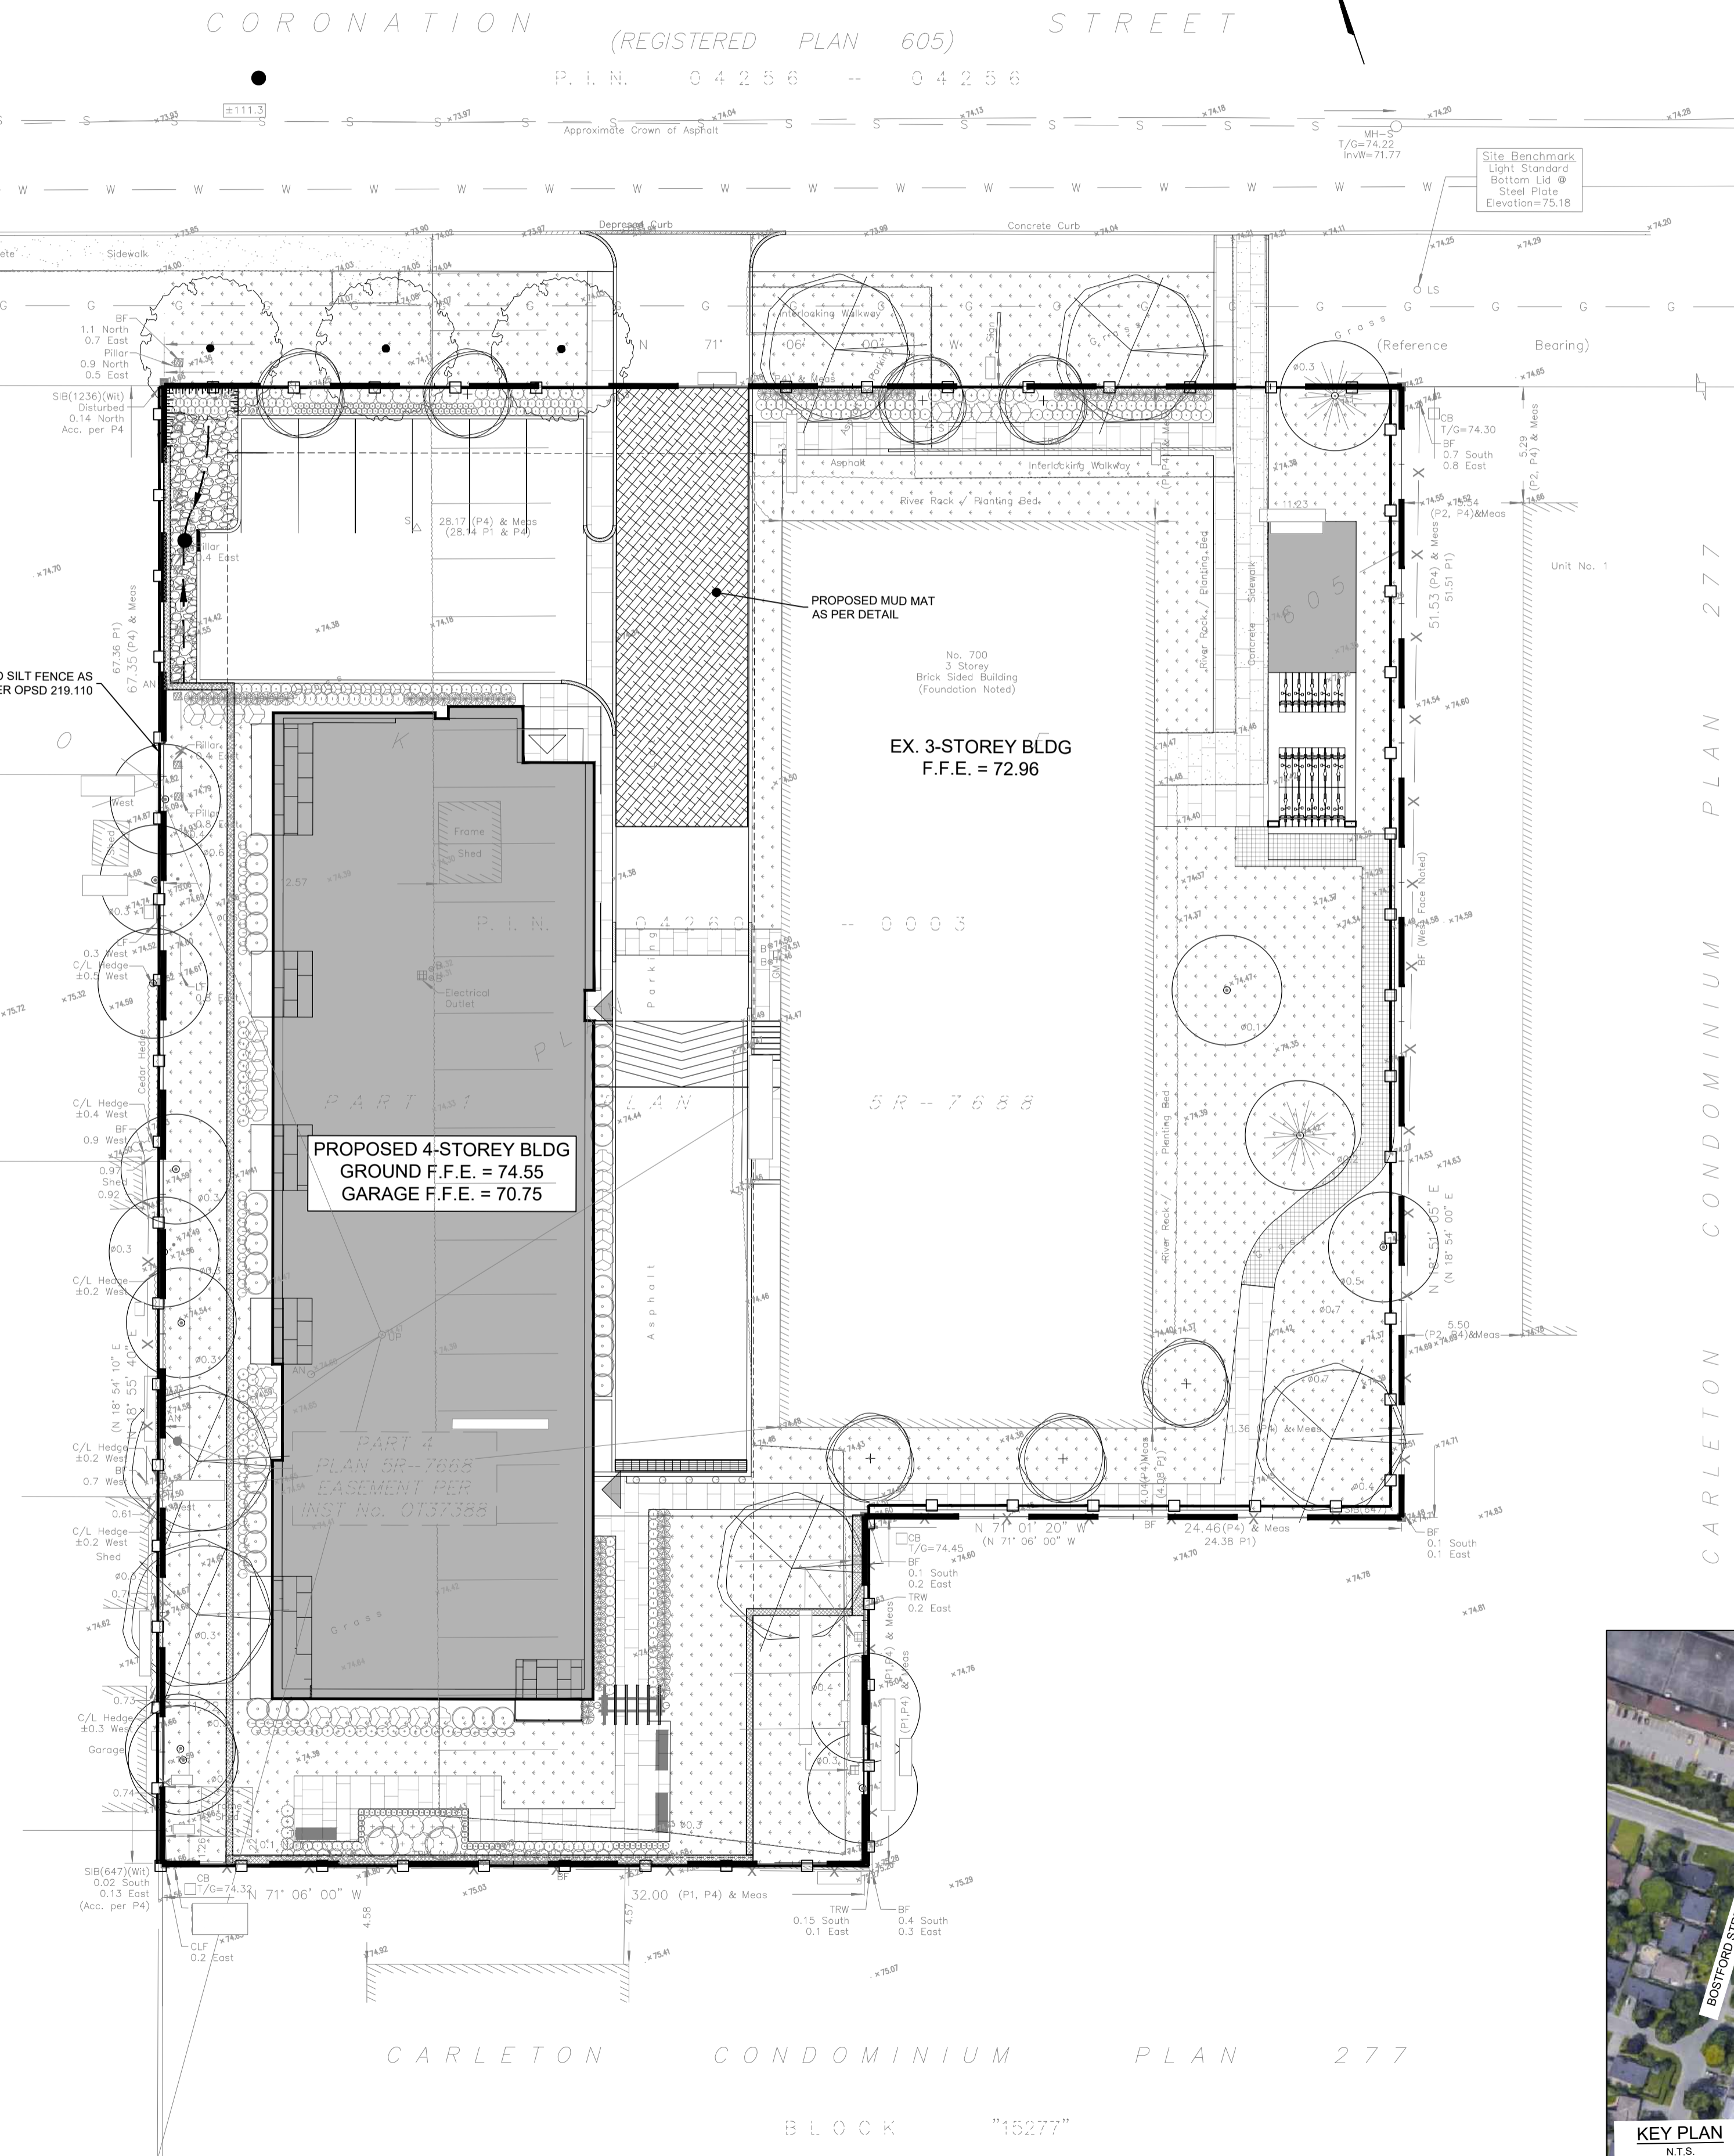

LEGEND:

	EXISTING PROPERTY LINE TO REMAIN
	PROPOSED CURB
	PROPOSED DEPRESSED CURB
	PROPOSED TERRACING (3:1 MIN.)
	PROPOSED SILT FENCE AS PER OPSD 219.110
	PROPOSED FENCE
	PROPOSED DOOR ENTRANCE/EXIT
	PROPOSED GRASS AREA (100mm TOP SOIL & SOD)
	PROPOSED CONCRETE FEATURES/SLAB
	PROPOSED HEAVY DUTY ASPHALT
	PROPOSED LIGHT DUTY ASPHALT
	PROPOSED RIP RAP
	PROPOSED ELEVATION
	PROPOSED HIGH POINT ELEVATION
	PROPOSED SWALE ELEVATION
	PROPOSED BOTTOM OF CURB / ASPHALT ELEVATION
	PROPOSED TOP OF CURB ELEVATION
	MATCH INTO EXISTING ELEVATION
	EXISTING ELEVATION
	PROPOSED OVERLAND MAJOR FLOW ROUTE
	PROPOSED 100mm PERFORATED SUBDRAIN
	PROPOSED STORM SEWER
	PROPOSED SANITARY SEWER
	PROPOSED WATERMAIN
	EXISTING STORM SEWER
	EXISTING SANITARY SEWER
	EXISTING WATERMAIN
	EXISTING GAS LINE
	EXISTING MANHOLE
	EXISTING CATCHBASIN
	PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
	PROPOSED MANHOLE
	PROPOSED CURB STOP
	PROPOSED PIPE INSULATION
	PROPOSED 100 YEAR HIGH WATER LEVEL
	STORM WATERSHED EXTENT
	WATERSHED NAME
	RUNOFF COEFFICIENT
	AREA IN HECTARES

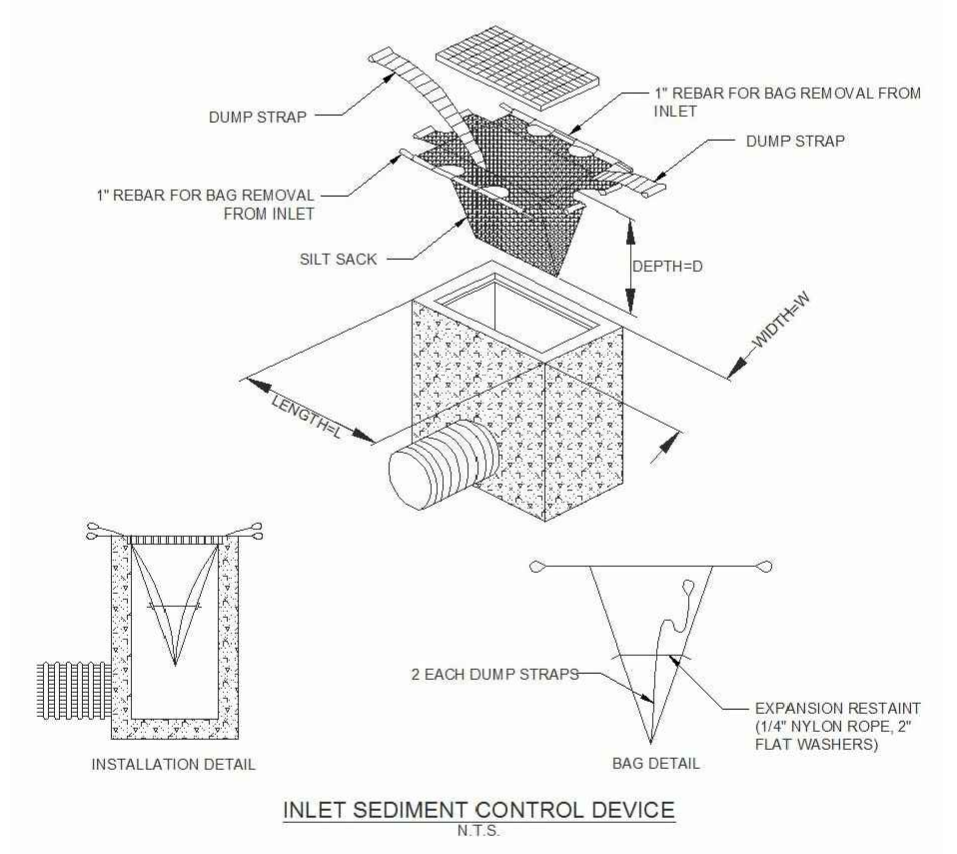

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS IF REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONTRACTOR AGREES THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR AGREES THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THERE OF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MARKS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS AN ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK AND THE BID PRICE. CLAIMS FOR DAMAGES OR COSTS ARISING DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO THESE DRAWINGS, PLANS, SPECIFICATIONS, OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY IRL ASSOCIATES LTD. (IRL) WITHOUT OBTAINING IRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST IRL AND TO RELEASE IRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD IRL FREE FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO IRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF IRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH IRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION, DEPTH AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.


CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT. THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR ANY OTHER FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE IN RESPECT OF ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

SCALE: 1:200
3.0m 1.5 0 3.0 6.0m

SCALE: 1:150

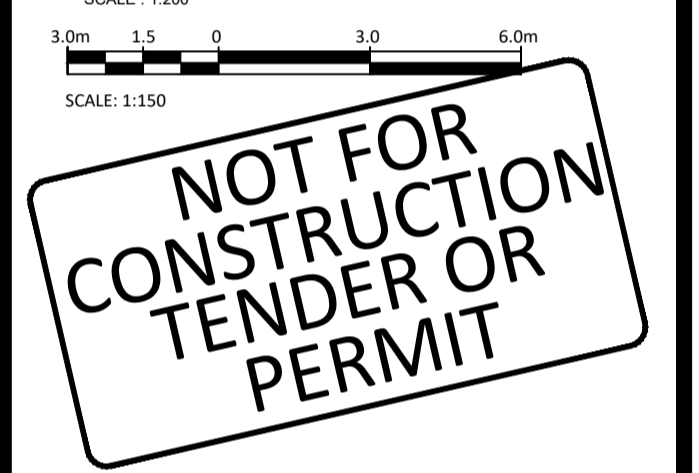

No.	REVISIONS	BY	DATE
03	ISSUED FOR MUNICIPAL APPROVAL	A.S.	13 NOV 2020
02	ISSUED FOR MUNICIPAL APPROVAL	A.S.	30 OCT 2020
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	02 OCT 2020



NOT AUTHENTIC UNLESS SIGNED AND DATED.

LRJ
ENGINEERING | INGÉNIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: **MARK FARRELL**
533 Gilmour Street,
Ottawa ON K1R 5L3

DESIGNED BY: A.S. DRAWN BY: A.S. APPROVED BY: M.H.

PROJECT: **700 CORONATION AVENUE**
PROPOSED 4-STOREY BUILDING ADDITION


DRAWING TITLE: **EROSION AND SEDIMENT CONTROL PLAN**

PROJECT NO.: **200463**
DATE: **SEPTEMBER 2020**



GENERAL GRADING NOTES:

- ANY MODIFICATIONS IN ELEVATION BETWEEN THE SURVEY AND CONSTRUCTION THAT WILL AFFECT THE PROJECT ARE TO BE COMMUNICATED WITH THE ENGINEER PRIOR TO START OF CONSTRUCTION
- PRIOR TO START OF ANY WORK ON SITE, THE CONTRACTOR IS RESPONSIBLE TO FIELD VERIFY EXISTING GRADES AND ENSURE OVERLAND DRAINAGE IS FEASIBLE WITH ACTUAL SITE CONDITIONS
- ANY DISCREPANCIES ARE TO BE COMMUNICATED WITH THE ENGINEER PRIOR TO CONSTRUCTION.
- ALL RETAINING WALLS EXCEEDING 0.6m IN HEIGHT ARE TO BE INSTALLED WITH PROTECTIVE RAILING OR FENCE.
- ALL RETAINING WALLS EXCEEDING 1.0m IN HEIGHT ARE TO BE DESIGNED BY A PROFESSIONAL STRUCTURAL ENGINEER.

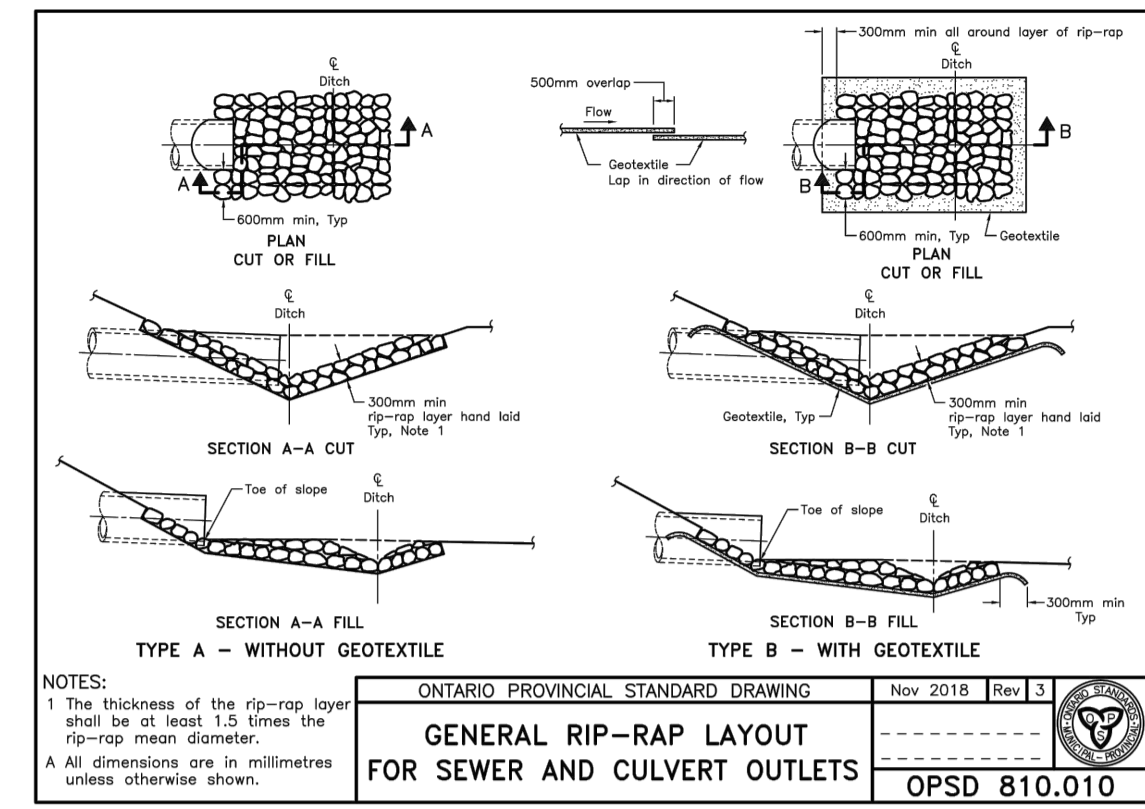

LEGEND:

- EXISTING PROPERTY LINE TO REMAIN
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MIN.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED FENCE
- PROPOSED DOOR ENTRANCE/EIT
- PROPOSED GRASS AREA (100mm TOP SOIL & SOD)
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY DUTY ASPHALT
- PROPOSED LIGHT DUTY ASPHALT
- PROPOSED RIP RAP
- PROPOSED ELEVATION
- PROPOSED HIGH POINT ELEVATION
- PROPOSED SWALE ELEVATION
- PROPOSED BOTTOM OF CURB / ASPHALT ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- PROPOSED 100mmØ PERFORATED SUBDRAIN
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- EXISTING STORM SEWER
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- EXISTING GAS LINE
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED MANHOLE
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS IF REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THERE OF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTALS OF BIDS TO PERFORM THIS WORK IS A ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:
IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRI ASSOCIATES LTD. (LRI) WITHOUT OBTAINING LRI'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRI AND TO RELEASE LRI FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRI FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

GENERAL NOTES:
EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

SCALE: 1:200

NOT FOR CONSTRUCTION TENDER OR PERMIT

No.	REVISIONS	BY	DATE
03	ISSUED FOR MUNICIPAL APPROVAL	A.S.	13 NOV 2020
02	ISSUED FOR MUNICIPAL APPROVAL	A.S.	30 OCT 2020
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	02 OCT 2020



NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lri.ca | (613) 842-3434

CLIENT: **MARK FARRELL**
533 Gilmour Street,
Ottawa ON K1R 5L3


DESIGNED BY: A.S. DRAWN BY: A.S. APPROVED BY: M.H.


PROJECT: **700 CORONATION AVENUE PROPOSED 4-STORY BUILDING ADDITION**

DRAWING TITLE: **GRADING AND DRAINAGE PLAN**

PROJECT NO: **200463**
DATE: **SEPTEMBER 2020**

C301

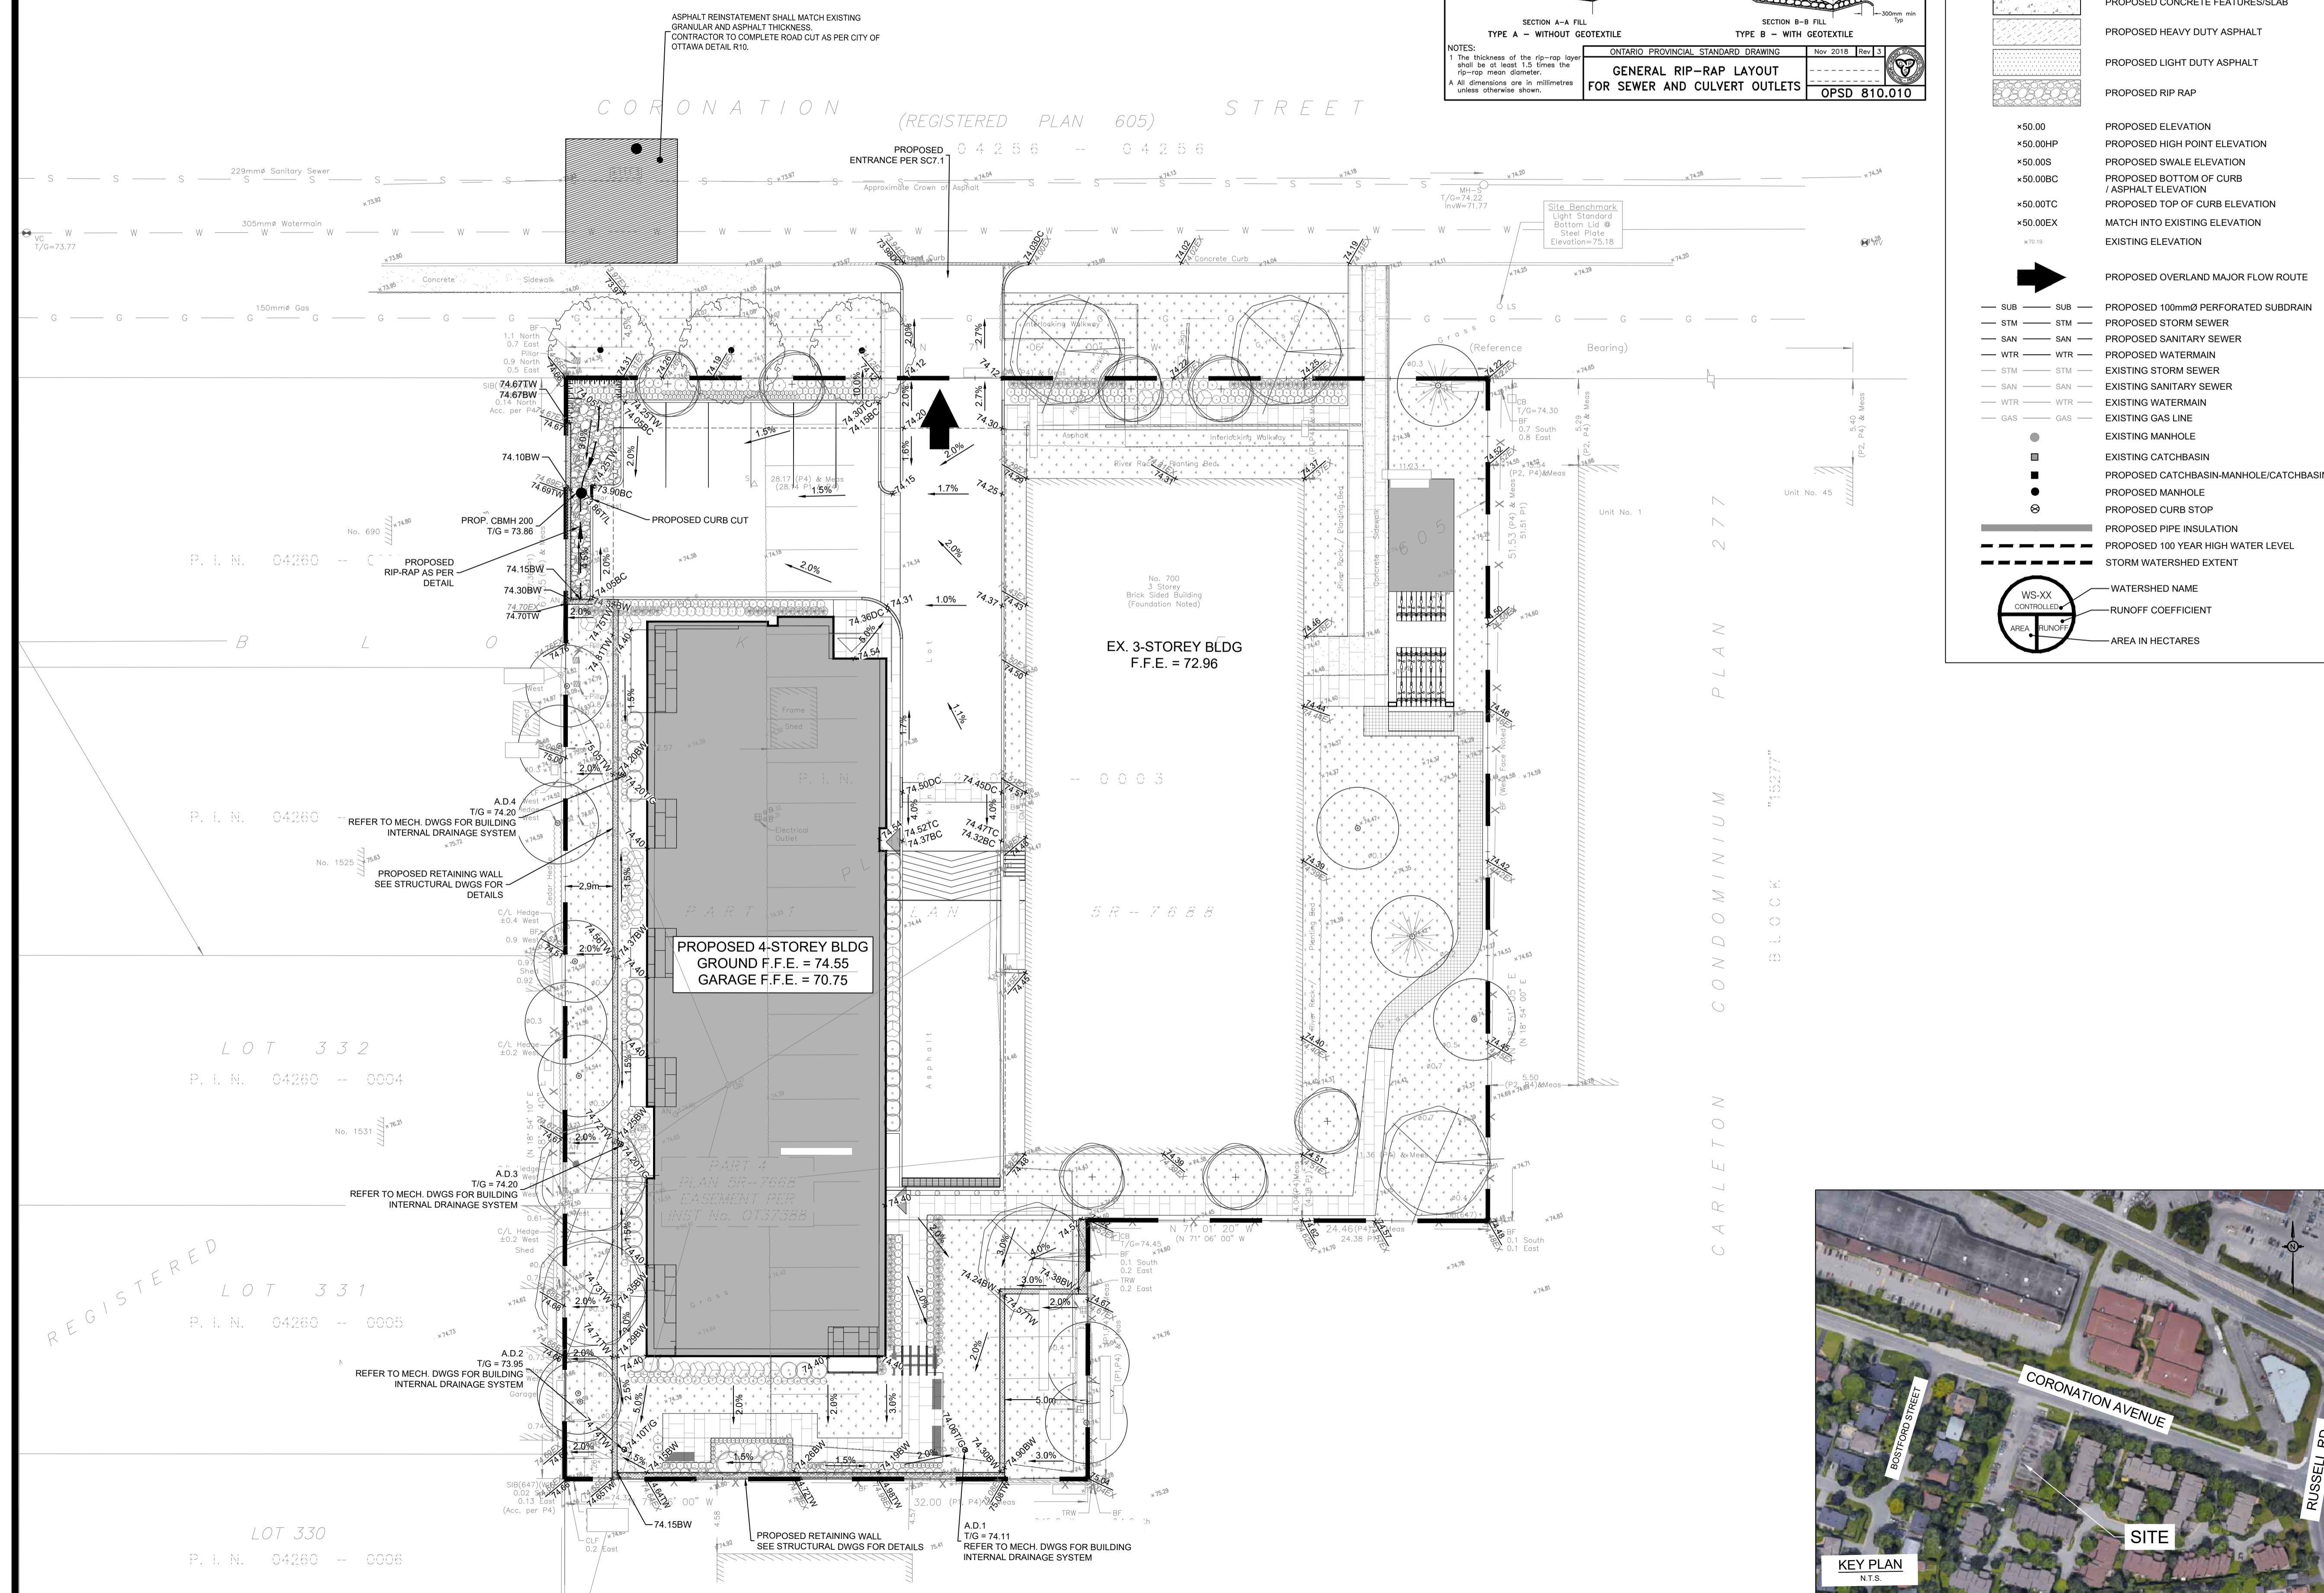

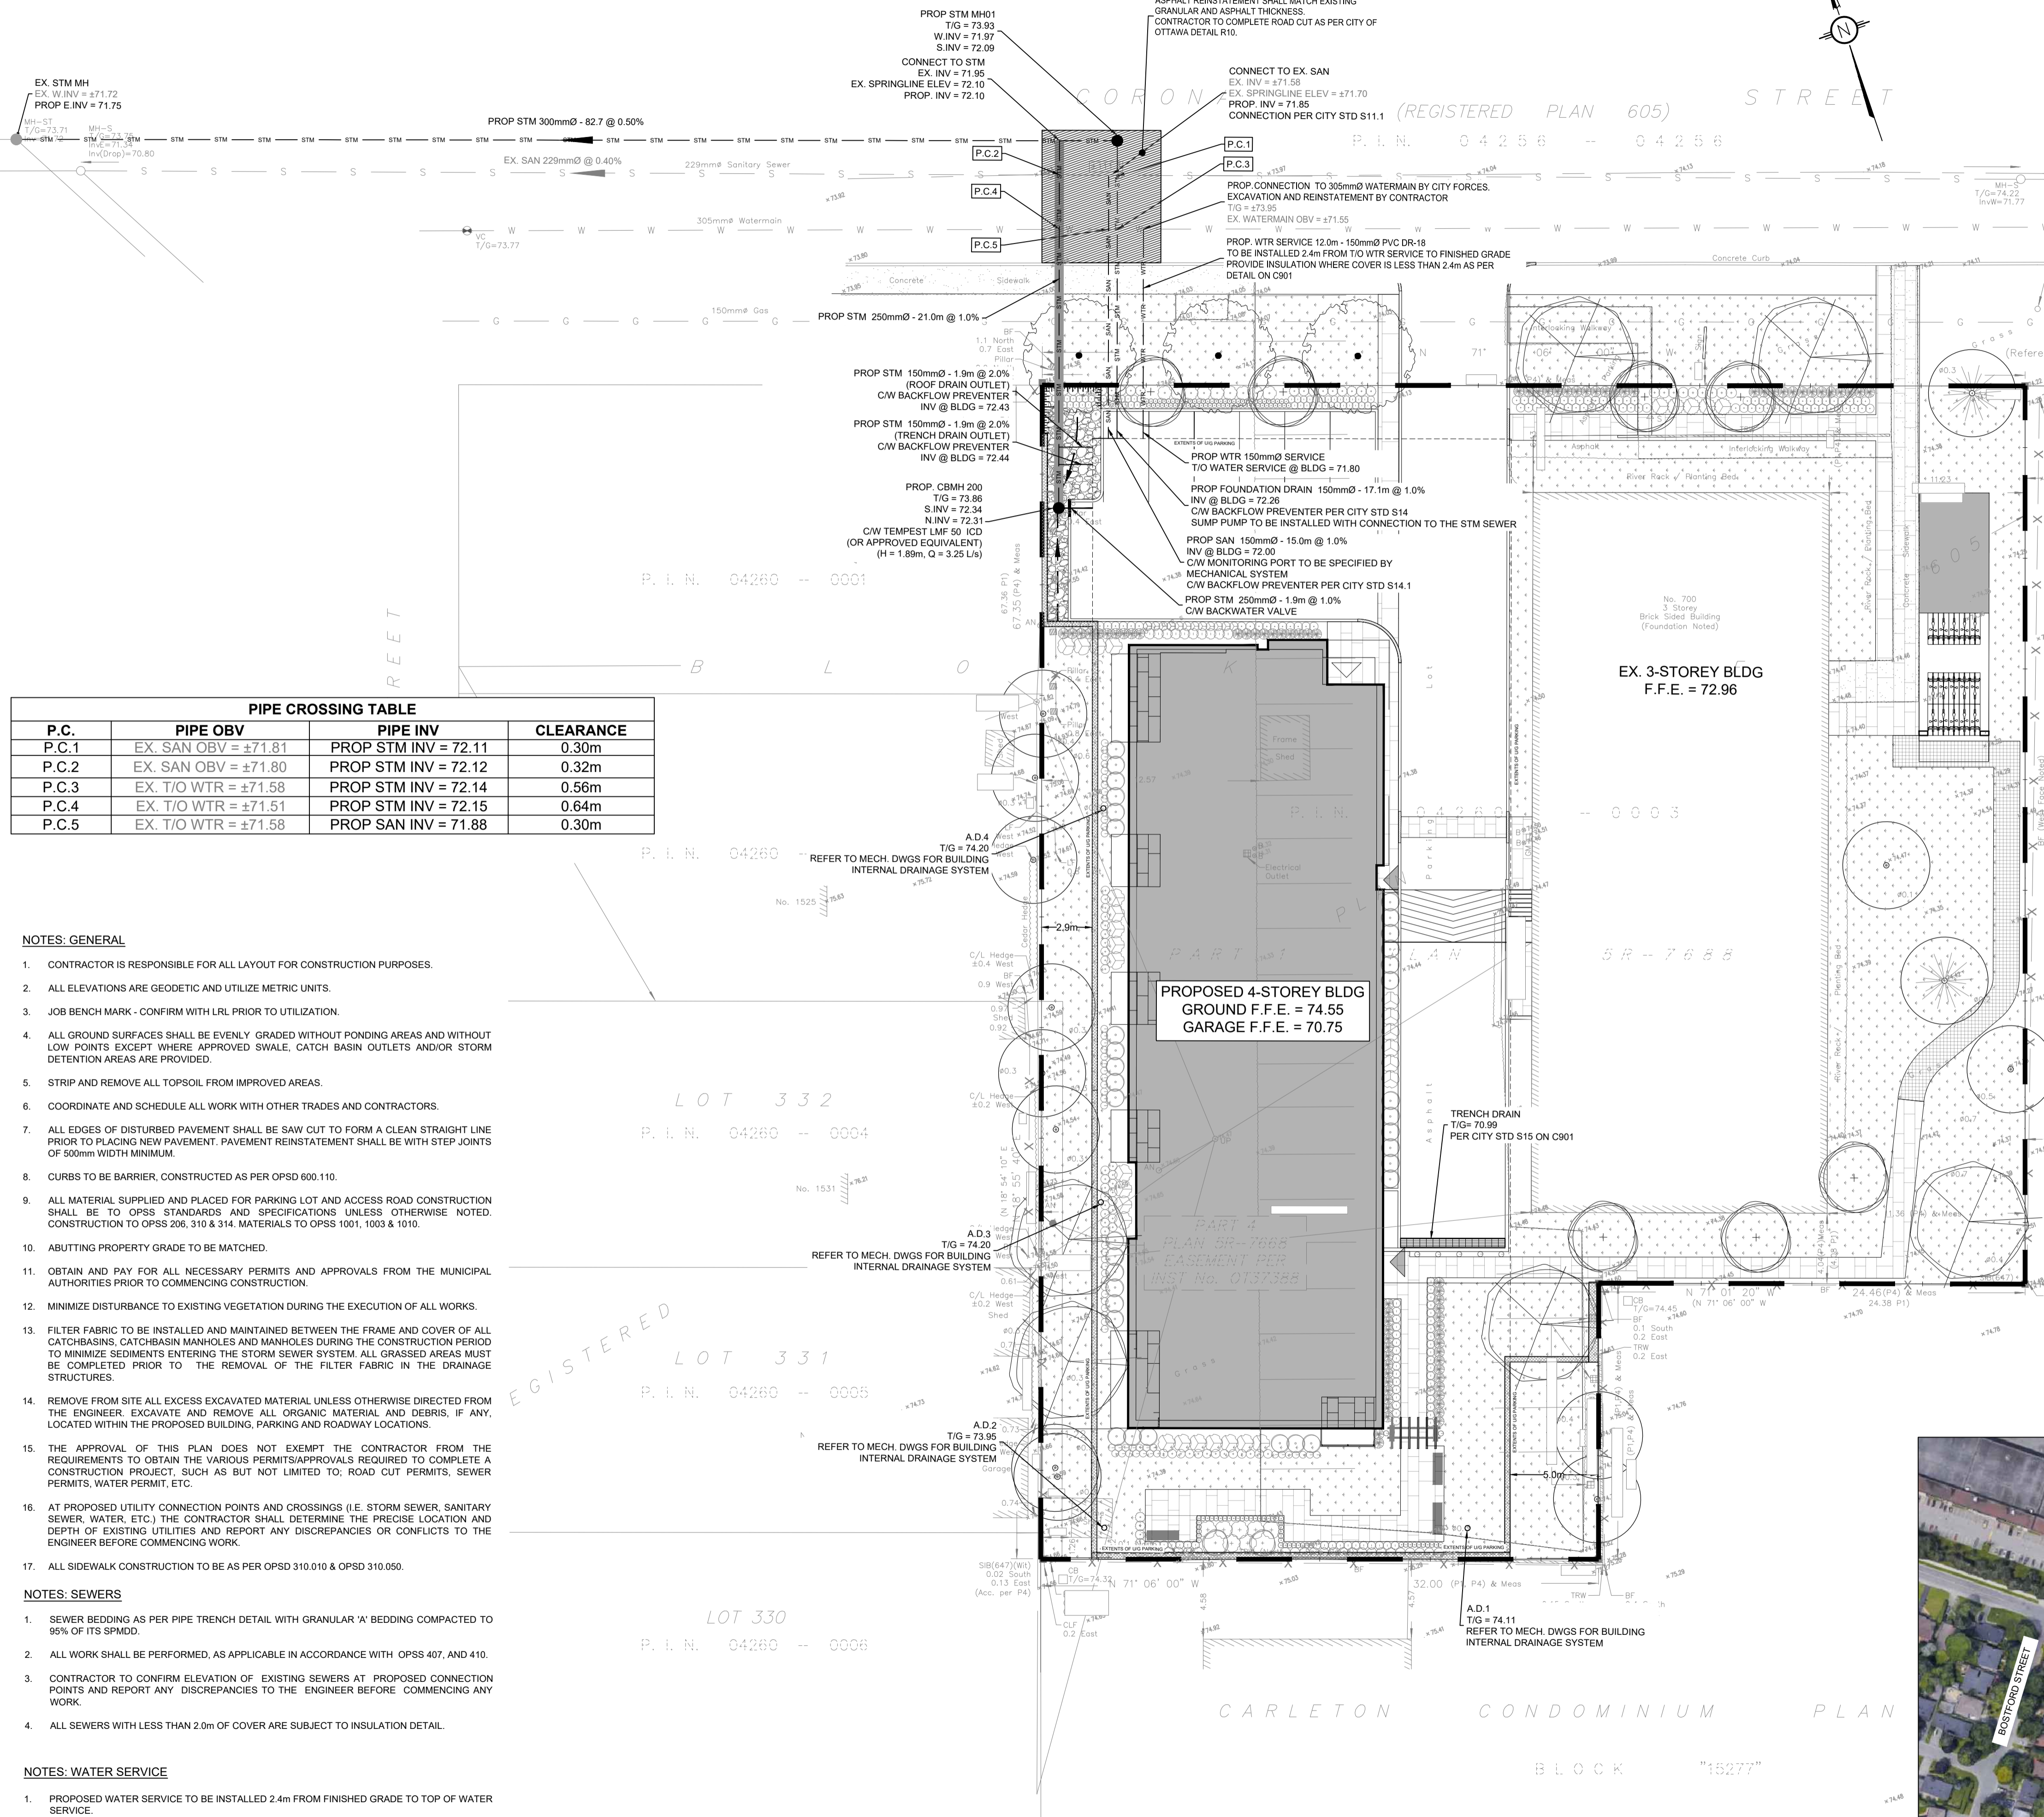

PIPE CROSSING TABLE			
P.C.	PIPE OBV	PIPE INV	CLEARANCE
P.C.1	EX. SAN OBV = ±71.81	PROP STM INV = 72.11	0.30m
P.C.2	EX. SAN OBV = ±71.80	PROP STM INV = 72.12	0.32m
P.C.3	EX. T/O WTR = ±71.58	PROP STM INV = 72.14	0.56m
P.C.4	EX. T/O WTR = ±71.51	PROP STM INV = 72.15	0.64m
P.C.5	EX. T/O WTR = ±71.58	PROP SAN INV = 71.88	0.30m

- NOTES: GENERAL**
- CONTRACTOR IS RESPONSIBLE FOR ALL LAYOUT FOR CONSTRUCTION PURPOSES.
 - ALL ELEVATIONS ARE GEODETIC AND UTILIZE METRIC UNITS.
 - JOB BENCH MARK - CONFIRM WITH LRL PRIOR TO UTILIZATION.
 - ALL GROUND SURFACES SHALL BE EVENLY GRADED WITHOUT PONDING AREAS AND WITHOUT LOW POINTS EXCEPT WHERE APPROVED SWALE, CATCH BASIN OUTLETS AND/OR STORM DETENTION AREAS ARE PROVIDED.
 - STRIP AND REMOVE ALL TOPSOIL FROM IMPROVED AREAS.
 - COORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
 - ALL EDGES OF DISTURBED PAVEMENT SHALL BE SAW CUT TO FORM A CLEAN STRAIGHT LINE PRIOR TO PLACING NEW PAVEMENT. PAVEMENT REINSTATEMENT SHALL BE WITH STEP JOINTS OF 500mm WIDTH MINIMUM.
 - CURBS TO BE BARRIER, CONSTRUCTED AS PER OPSD 600.110.
 - ALL MATERIAL SUPPLIED AND PLACED FOR PARKING LOT AND ACCESS ROAD CONSTRUCTION SHALL BE TO OPSD STANDARDS AND SPECIFICATIONS UNLESS OTHERWISE NOTED. CONSTRUCTION TO OPSD 206, 310 & 314. MATERIALS TO OPSD 1001, 1003 & 1010.
 - ABUTTING PROPERTY GRADE TO BE MATCHED.
 - OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE MUNICIPAL AUTHORITIES PRIOR TO COMMENCING CONSTRUCTION.
 - MINIMIZE DISTURBANCE TO EXISTING VEGETATION DURING THE EXECUTION OF ALL WORKS.
 - FILTER FABRIC TO BE INSTALLED AND MAINTAINED BETWEEN THE FRAME AND COVER OF ALL CATCHBASINS, CATCHBASIN MANHOLES AND MANHOLES DURING THE CONSTRUCTION PERIOD TO MINIMIZE SEDIMENTS ENTERING THE STORM SEWER SYSTEM. ALL GRASSED AREAS MUST BE COMPLETED PRIOR TO THE REMOVAL OF THE FILTER FABRIC IN THE DRAINAGE STRUCTURES.
 - REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL UNLESS OTHERWISE DIRECTED FROM THE ENGINEER. EXCAVATE AND REMOVE ALL ORGANIC MATERIAL AND DEBRIS, IF ANY, LOCATED WITHIN THE PROPOSED BUILDING, PARKING AND ROADWAY LOCATIONS.
 - THE APPROVAL OF THIS PLAN DOES NOT EXEMPT THE CONTRACTOR FROM THE REQUIREMENTS TO OBTAIN THE VARIOUS PERMITS/APPROVALS REQUIRED TO COMPLETE A CONSTRUCTION PROJECT, SUCH AS BUT NOT LIMITED TO: ROAD CUT PERMITS, SEWER PERMITS, WATER PERMIT, ETC.
 - AT PROPOSED UTILITY CONNECTION POINTS AND CROSSINGS (I.E. STORM SEWER, SANITARY SEWER, WATER, ETC.) THE CONTRACTOR SHALL DETERMINE THE PRECISE LOCATION AND DEPTH OF EXISTING UTILITIES AND REPORT ANY DISCREPANCIES OR CONFLICTS TO THE ENGINEER BEFORE COMMENCING WORK.
 - ALL SIDEWALK CONSTRUCTION TO BE AS PER OPSD 310.010 & OPSD 310.050.
- NOTES: SEWERS**
- SEWER BEDDING AS PER PIPE TRENCH DETAIL WITH GRANULAR 'A' BEDDING COMPACTED TO 95% OF ITS SPMD.
 - ALL WORK SHALL BE PERFORMED, AS APPLICABLE IN ACCORDANCE WITH OPSD 407, AND 410.
 - CONTRACTOR TO CONFIRM ELEVATION OF EXISTING SEWERS AT PROPOSED CONNECTION POINTS AND REPORT ANY DISCREPANCIES TO THE ENGINEER BEFORE COMMENCING ANY WORK.
 - ALL SEWERS WITH LESS THAN 2.0m OF COVER ARE SUBJECT TO INSULATION DETAIL.
- NOTES: WATER SERVICE**
- PROPOSED WATER SERVICE TO BE INSTALLED 2.4m FROM FINISHED GRADE TO TOP OF WATER SERVICE.

LEGEND:

- EXISTING PROPERTY LINE TO REMAIN
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3.1 MIN.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED FENCE
- PROPOSED DOOR ENTRANCE/EXIT
- PROPOSED GRASS AREA (100mm TOP SOIL & SOD)
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY DUTY ASPHALT
- PROPOSED LIGHT DUTY ASPHALT
- PROPOSED RIP RAP
- PROPOSED ELEVATION
- PROPOSED HIGH POINT ELEVATION
- PROPOSED SWALE ELEVATION
- PROPOSED BOTTOM OF CURB / ASPHALT ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- PROPOSED 100mmØ PERFORATED SUBDRAIN
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- EXISTING STORM SEWER
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- EXISTING GAS LINE
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED MANHOLE
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE, BUT NOT LIMITED TO, THE DRAWING, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDUMS, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS IF REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAIL SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO CONSTRUCT THIS WORK IS AN ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY ASSOCIATES LTD. (L)R WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE BEGINNING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES OR AMBIGUITIES ON CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

SCALE: 1:200

NOT FOR CONSTRUCTION TENDER OR PERMIT

No.	REVISIONS	BY	DATE
03	ISSUED FOR MUNICIPAL APPROVAL	A.S.	13 NOV 2020
02	APPROVAL	A.S.	30 OCT 2020
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	02 OCT 2020



NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ ENGINEERING | INGENIERIE

5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: **MARK FARRELL**
533 Gilmour Street,
Ottawa ON K1R 5L3

DESIGNED BY: A.S. DRAWN BY: A.S. APPROVED BY: M.H.

PROJECT: **700 CORONATION AVENUE PROPOSED 4-STORY BUILDING ADDITION**

DRAWING TITLE: **SERVICING PLAN**


PROJECT NO.: 200463
DATE: SEPTEMBER 2020

C401



CORONATION (REGISTERED PLAN 605) STREET

P. I. N. 04258 -- 04258

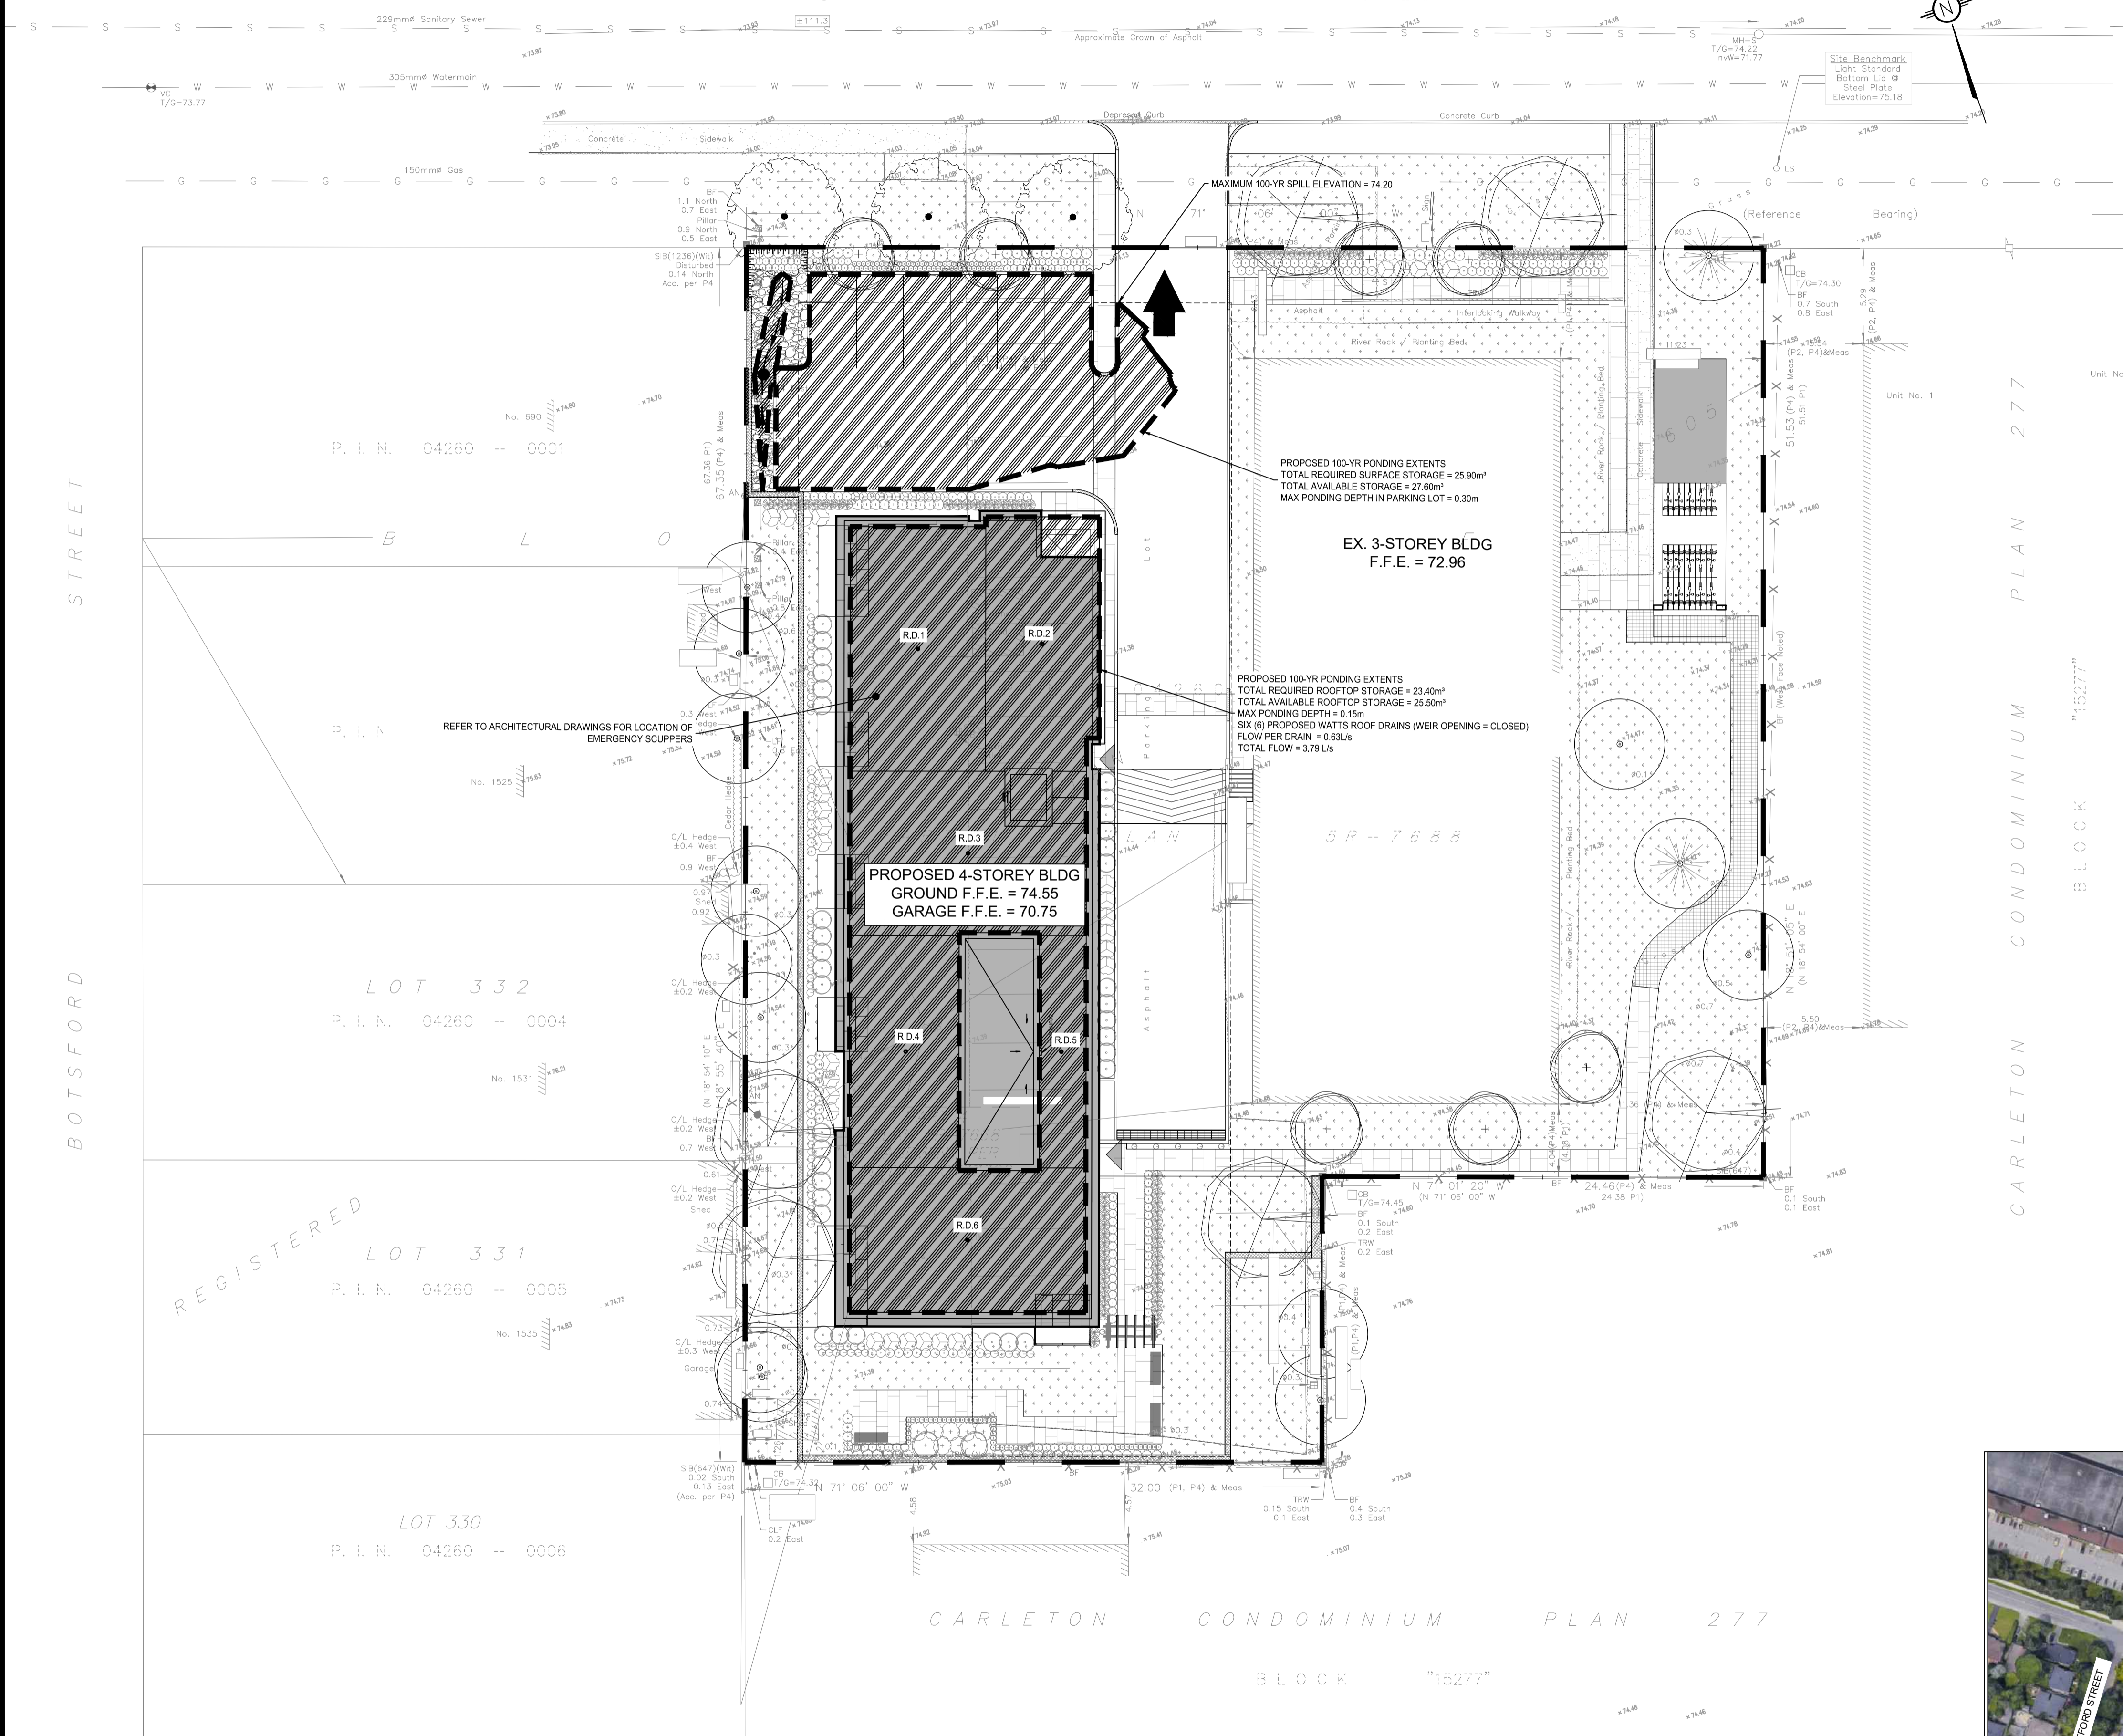

LEGEND:

- EXISTING PROPERTY LINE TO REMAIN
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MIN.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED FENCE
- PROPOSED DOOR ENTRANCE/EIT
- PROPOSED GRASS AREA (10mm TOP SOIL & SOD)
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY DUTY ASPHALT
- PROPOSED LIGHT DUTY ASPHALT
- PROPOSED RIP RAP
- PROPOSED ELEVATION
- PROPOSED HIGH POINT ELEVATION
- PROPOSED SWALE ELEVATION
- PROPOSED BOTTOM OF CURB / ASPHALT ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- PROPOSED 100mmØ PERFORATED SUBDRAIN
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- EXISTING STORM SEWER
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- EXISTING GAS LINE
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED MANHOLE
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE USE AND INTENT OF THE DRAWING. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITY. THESE DRAWINGS ARE COMPLEMENTARY AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS REQUIRED BY ALL WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAIL AS SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITY. THESE DRAWINGS ARE COMPLEMENTARY AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS REQUIRED BY ALL WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAIL AS SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS A KNOWLEDGEABLE ACCEPTANCE OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK AND THE BID. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRI ASSOCIATES LTD. (LRI) WITHOUT OBTAINING LRI'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRI AND TO RELEASE LRI FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRI FROM ANY DAMAGES, LIABILITIES OR COST, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRI'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRI AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRI AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

SCALE: 1:200

NOT FOR CONSTRUCTION TENDER OR PERMIT

No.	REVISIONS	BY	DATE
03	ISSUED FOR MUNICIPAL APPROVAL	A.S.	13 NOV 2020
02	ISSUED FOR MUNICIPAL APPROVAL	A.S.	30 OCT 2020
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	02 OCT 2020



NOT AUTHENTIC UNLESS SIGNED AND DATED



LRJ
ENGINEERING | INGÉNIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lri.ca | (613) 842-3434

CLIENT: **MARK FARRELL**
533 Gilmour Street,
Ottawa ON K1R 5L3

DESIGNED BY: A.S. DRAWN BY: A.S. APPROVED BY: M.H.

PROJECT: **700 CORONATION AVENUE
PROPOSED 4-STOREY BUILDING ADDITION**


DRAWING TITLE: **STORMWATER MANAGEMENT PLAN**

PROJECT NO: 200463
DATE: SEPTEMBER 2020



KEY PLAN
N.T.S.

C601

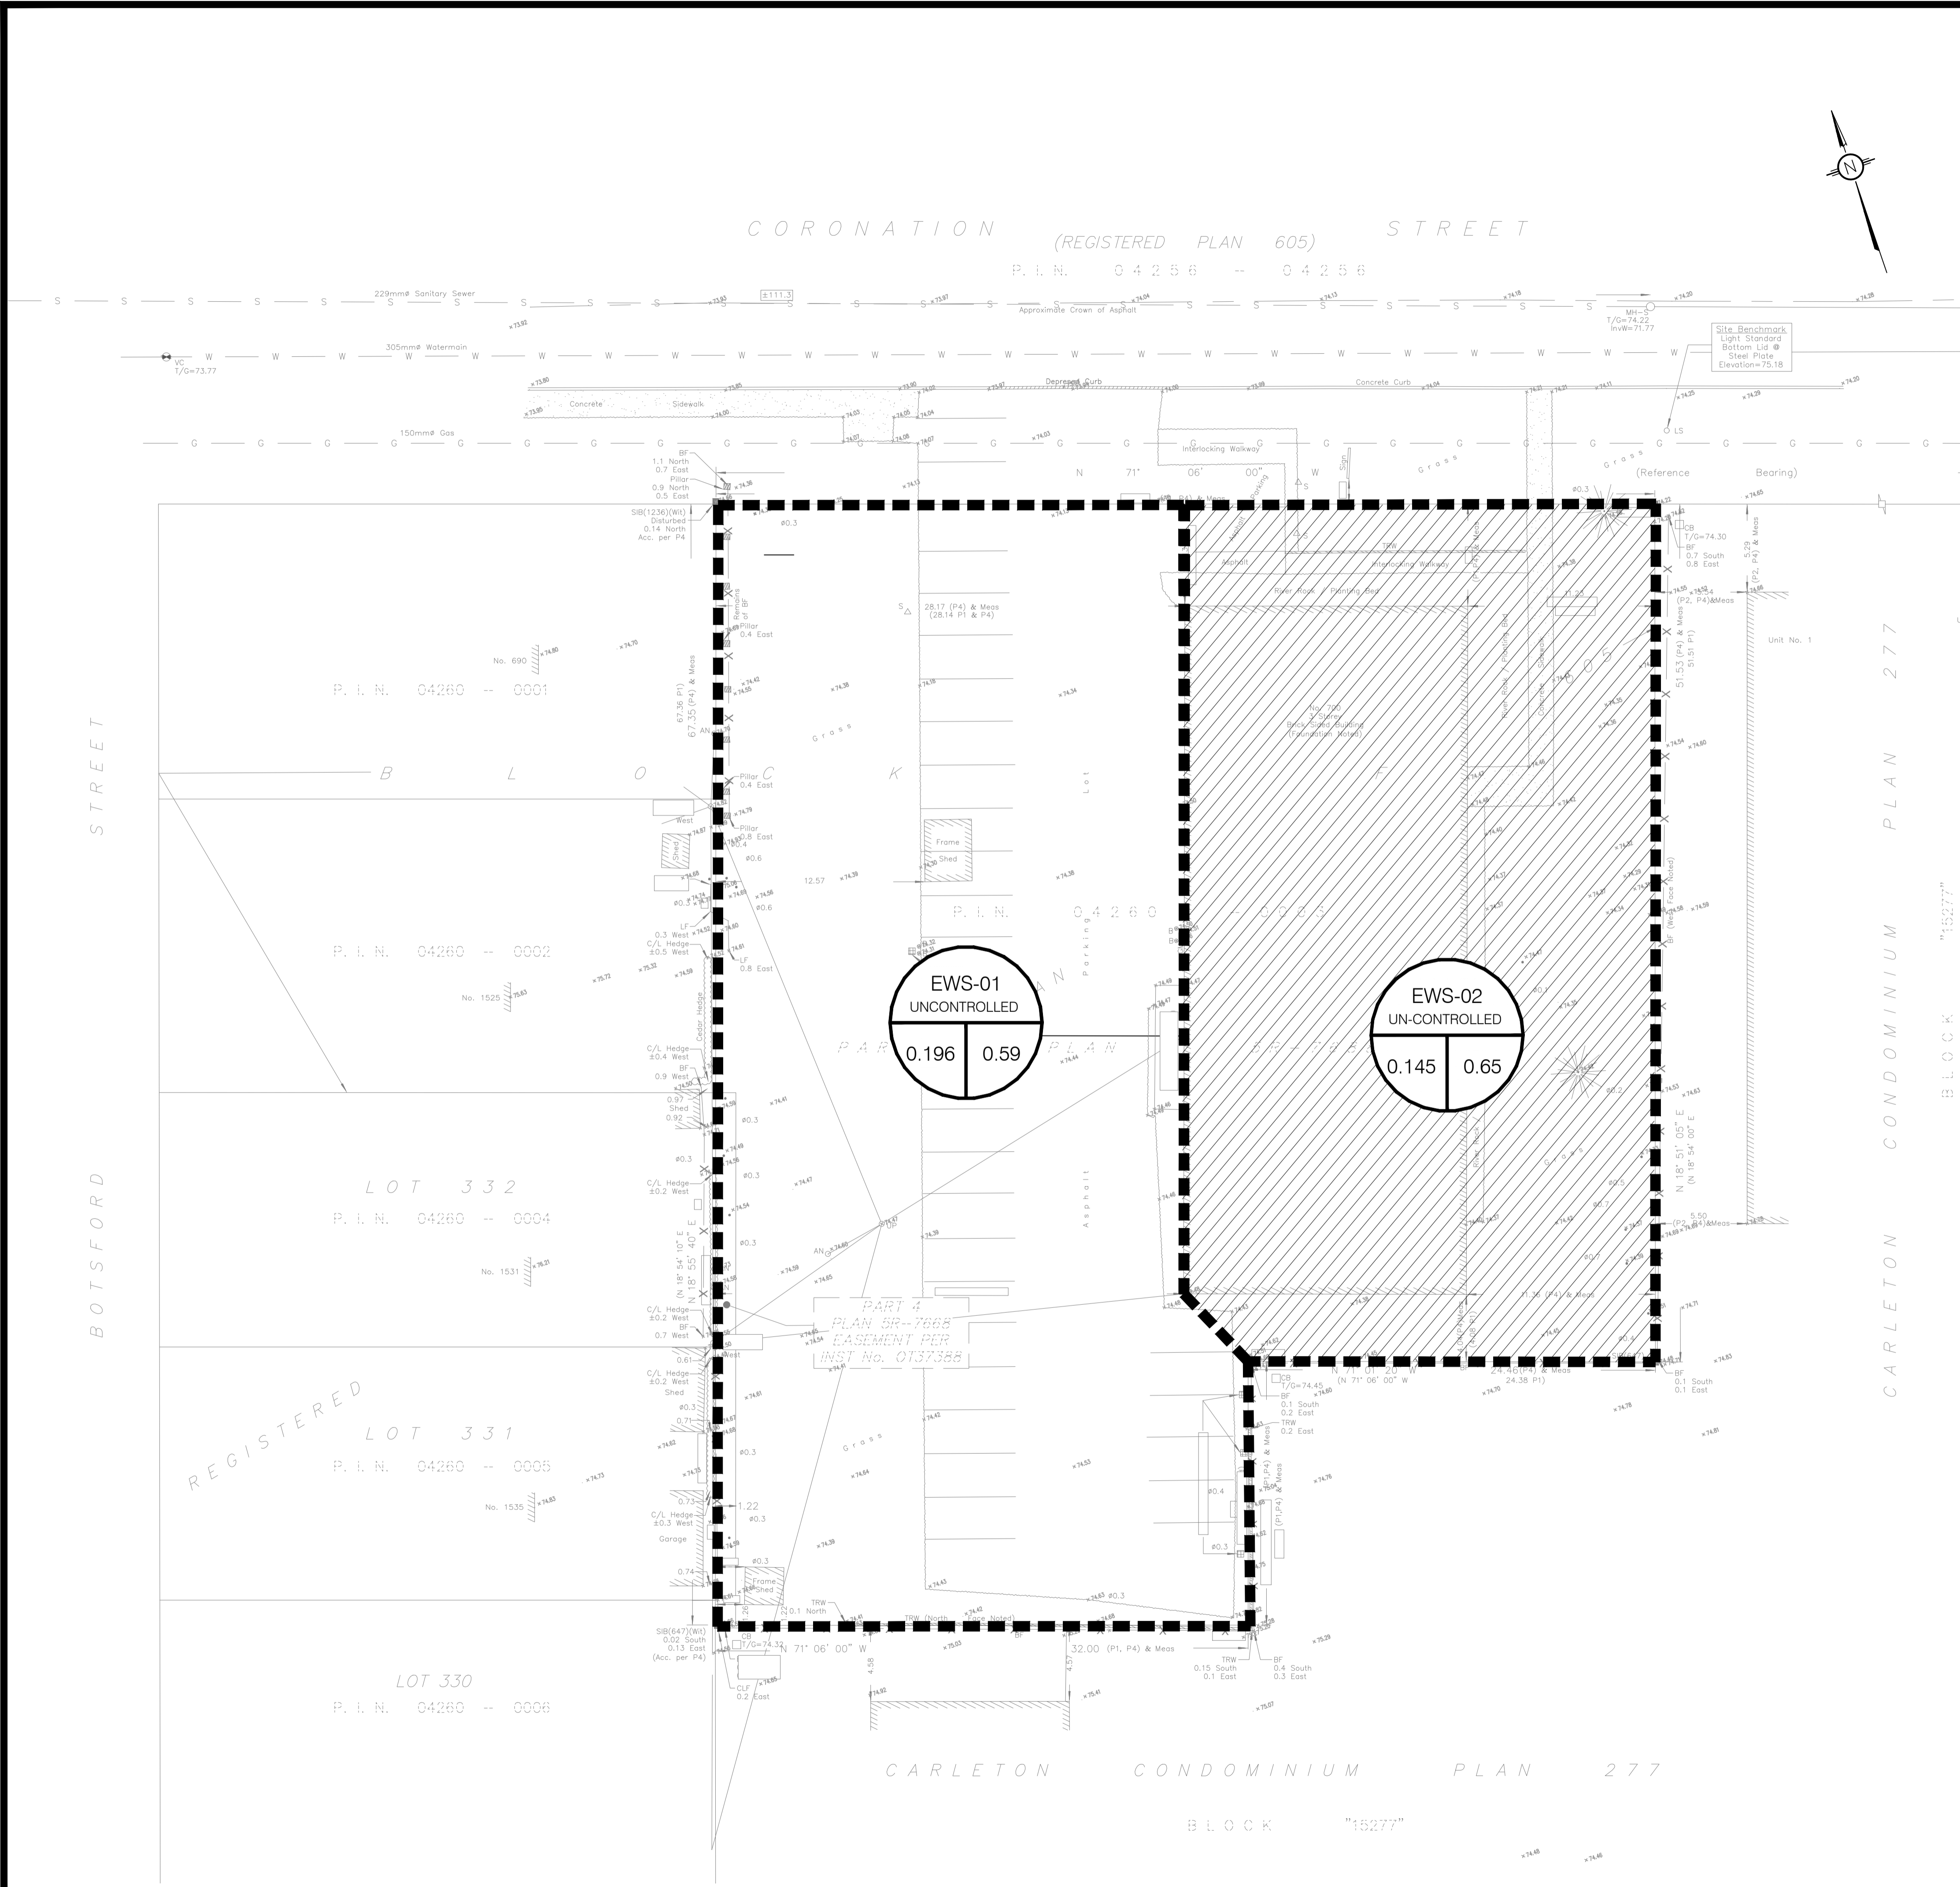

LEGEND:

- EXISTING PROPERTY LINE TO REMAIN
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MIN.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED FENCE
- PROPOSED DOOR ENTRANCE/EIT
- PROPOSED GRASS AREA (100mm TOP SOIL & SOD)
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY DUTY ASPHALT
- PROPOSED LIGHT DUTY ASPHALT
- PROPOSED RIP RAP
- PROPOSED ELEVATION
- PROPOSED HIGH POINT ELEVATION
- PROPOSED SWALE ELEVATION
- PROPOSED BOTTOM OF CURB / ASPHALT ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- PROPOSED 100mmØ PERFORATED SUBDRAIN
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- EXISTING STORM SEWER
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- EXISTING GAS LINE
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED MANHOLE
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 100 YEAR HIGH WATER LEVEL STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THERE OF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS A KNOWLEDGEABLE ACCEPTANCE OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT THEREBY REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

SCALE: 1:200

NOT FOR CONSTRUCTION TENDER OR PERMIT

No.	REVISIONS	BY	DATE
03	ISSUED FOR MUNICIPAL APPROVAL	A.S.	13 NOV 2020
02	ISSUED FOR MUNICIPAL APPROVAL	A.S.	30 OCT 2020
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	02 OCT 2020

NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
ENGINEERING | INGÉNIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: **MARK FARRELL**
533 Gilmour Street,
Ottawa ON K1R 5L3


DESIGNED BY: A.S. DRAWN BY: A.S. APPROVED BY: M.H.

PROJECT: **700 CORONATION AVENUE
PROPOSED 4-STORY BUILDING ADDITION**

DRAWING TITLE: **PRE-DEVELOPMENT
WATERSHED PLAN**

PROJECT NO.: 200463
DATE: SEPTEMBER 2020

C701

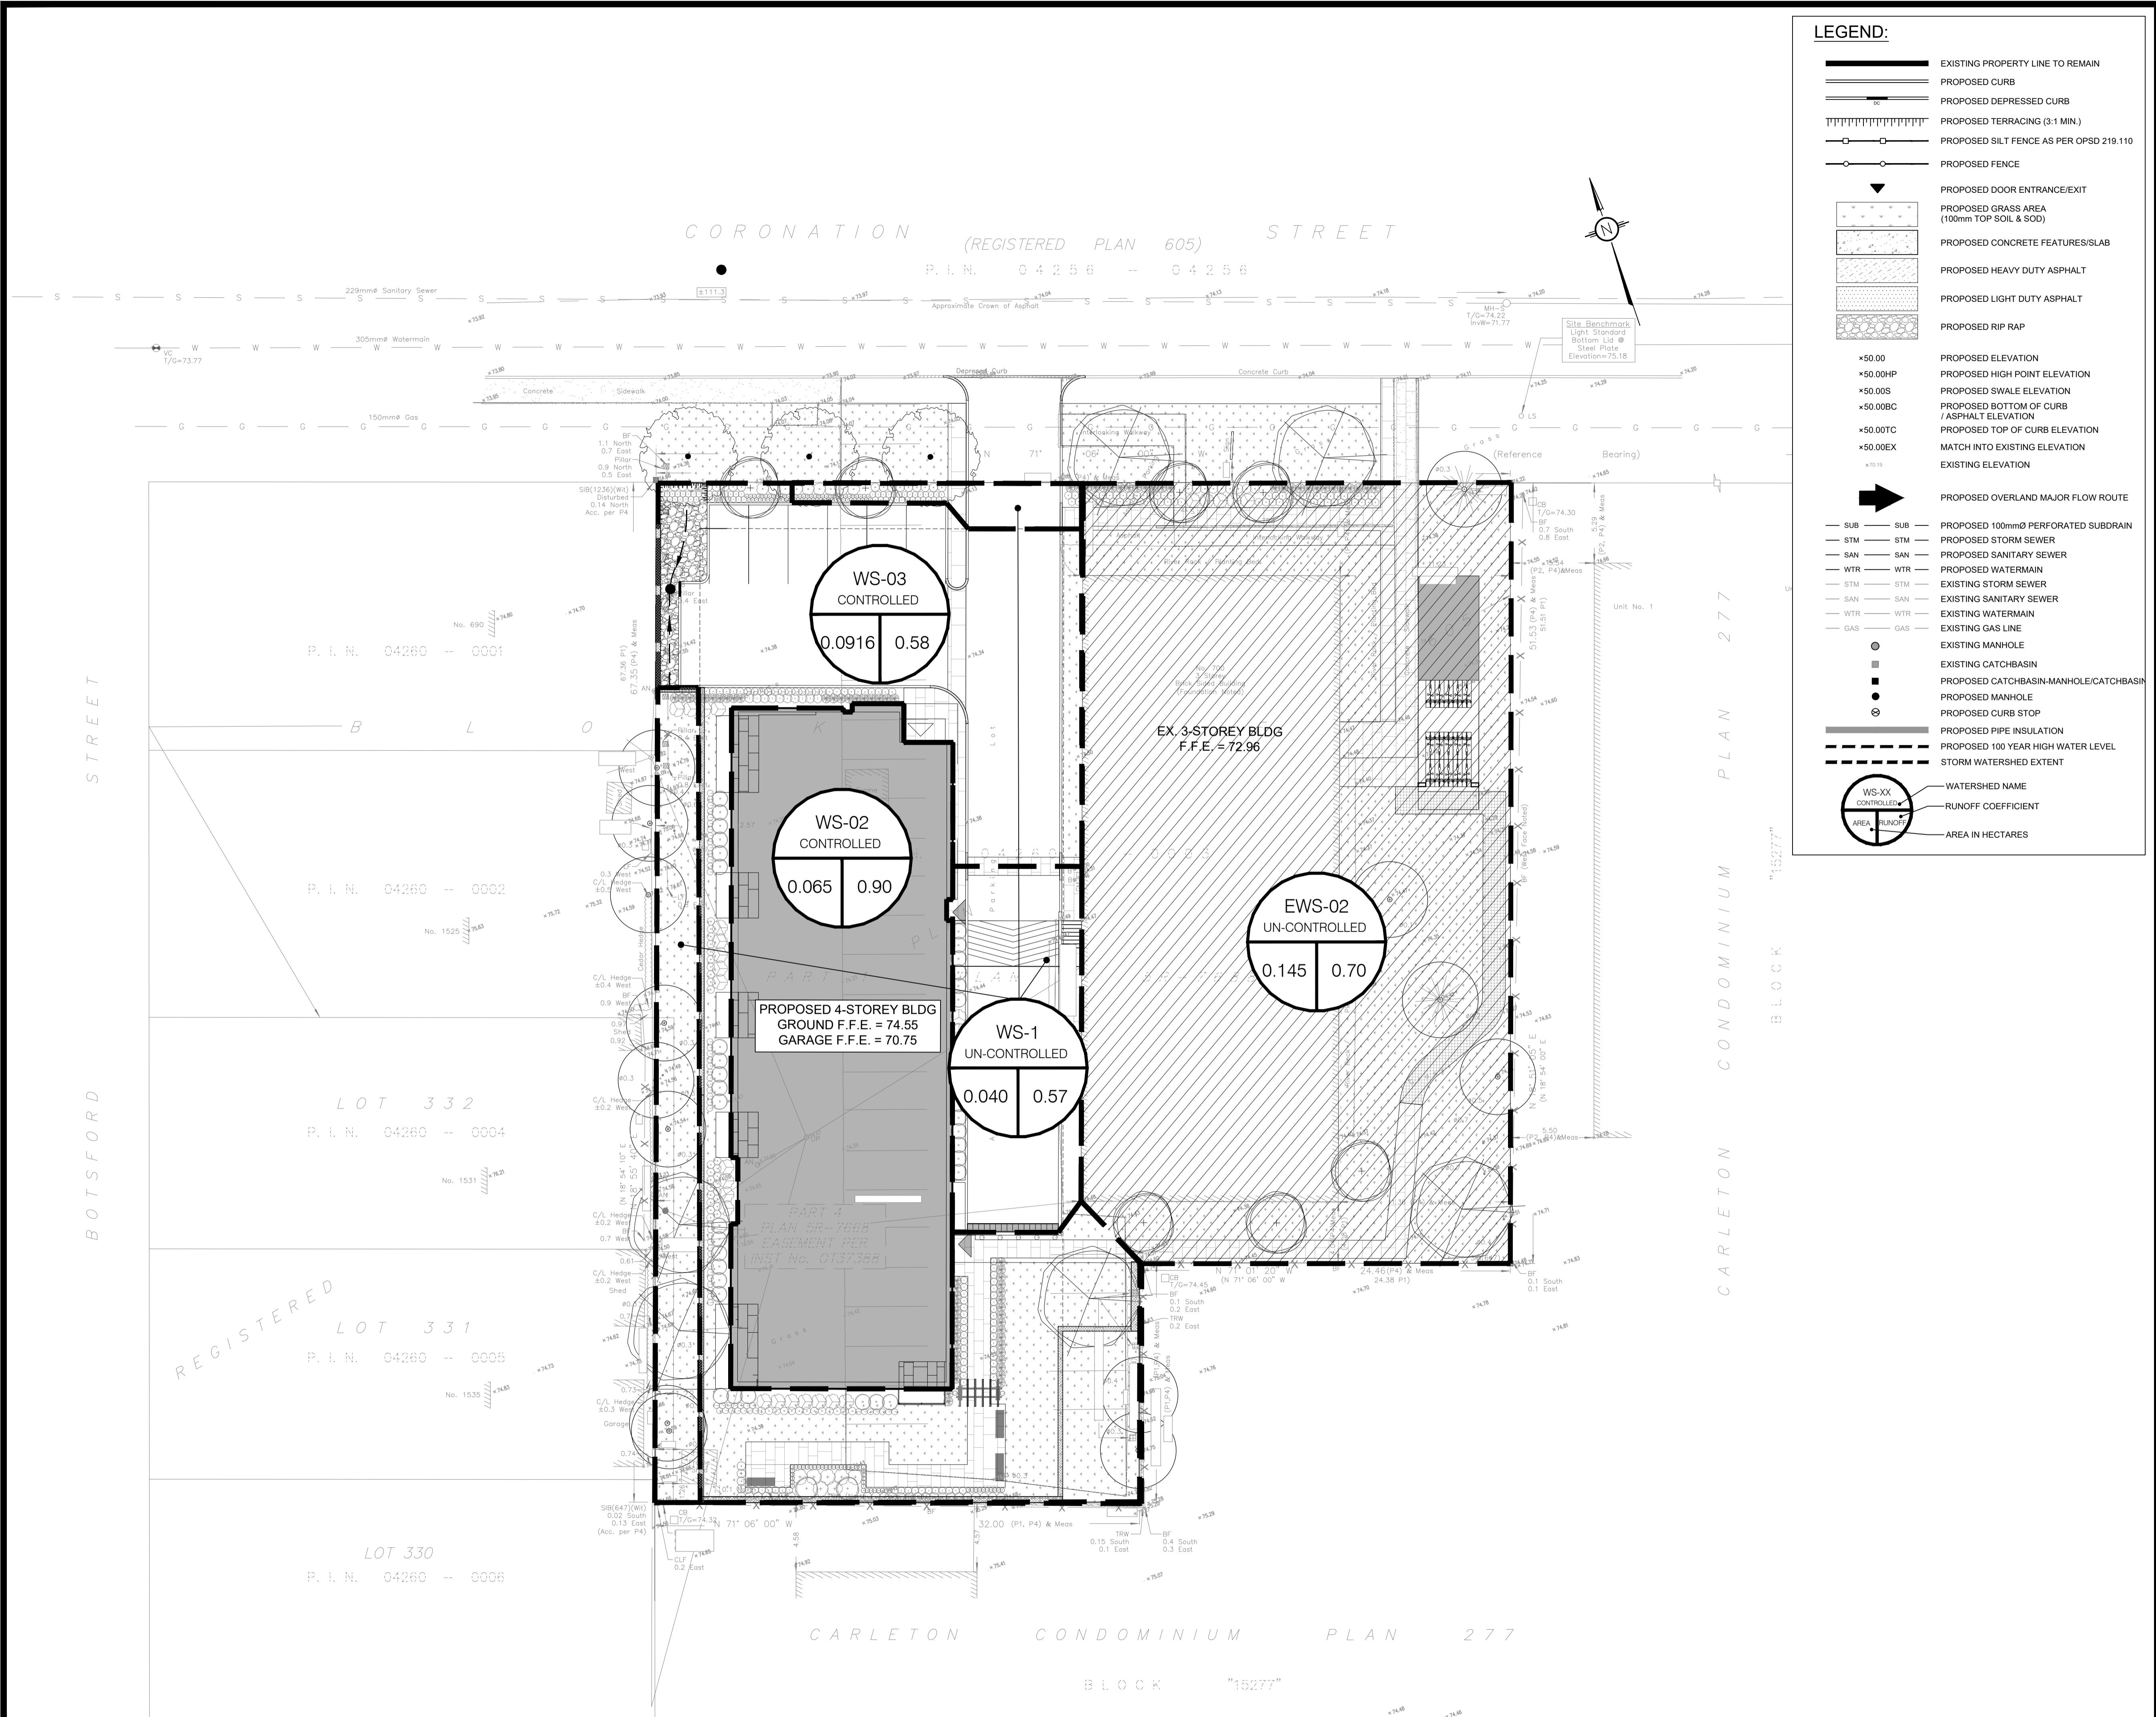

LEGEND:

- EXISTING PROPERTY LINE TO REMAIN
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MIN.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED FENCE
- PROPOSED DOOR ENTRANCE/EXIT
- PROPOSED GRASS AREA (100mm TOP SOIL & SOD)
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY DUTY ASPHALT
- PROPOSED LIGHT DUTY ASPHALT
- PROPOSED RIP RAP
- PROPOSED ELEVATION +50.00
- PROPOSED HIGH POINT ELEVATION +50.00HP
- PROPOSED SLOPE +50.00S
- PROPOSED BOTTOM OF CURB / ASPHALT ELEVATION +50.00BC
- PROPOSED TOP OF CURB ELEVATION +50.00TC
- MATCH INTO EXISTING ELEVATION +50.00EX
- EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- PROPOSED 100mmØ PERFORATED SUBDRAIN SUB
- PROPOSED STORM SEWER STM
- PROPOSED SANITARY SEWER SAN
- PROPOSED WATERMAIN WTR
- EXISTING STORM SEWER STM
- EXISTING SANITARY SEWER SAN
- EXISTING WATERMAIN WTR
- EXISTING GAS LINE GAS
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED MANHOLE
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME WS-XX CONTROLLED
- RUNOFF COEFFICIENT AREA RUNOFF
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE USE AND INTENT OF THE DRAWING. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITY AND FOR OBTAINING ALL NECESSARY INFORMATION FROM THE LOCAL AUTHORITY AND FOR OBTAINING ALL NECESSARY INFORMATION FROM THE LOCAL AUTHORITY AND FOR OBTAINING ALL NECESSARY INFORMATION FROM THE LOCAL AUTHORITY.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTALS OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORT, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COSTS OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

SCALE: 1:200

NOT FOR CONSTRUCTION TENDER OR PERMIT

No.	REVISIONS	BY	DATE
03	ISSUED FOR MUNICIPAL APPROVAL	A.S.	13 NOV 2020
02	ISSUED FOR MUNICIPAL APPROVAL	A.S.	30 OCT 2020
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	02 OCT 2020



NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
ENGINEERING | INGÉNIÉRIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: **MARK FARRELL**
533 Gilmour Street,
Ottawa ON K1R 5L3

DESIGNED BY: A.S. DRAWN BY: A.S. APPROVED BY: M.H.


PROJECT: **700 CORONATION AVENUE
PROPOSED 4-STORY BUILDING ADDITION**

DRAWING TITLE: **POST-DEVELOPMENT
WATERSHED PLAN**


PROJECT NO: **200463**

DATE: **SEPTEMBER 2020**

C702

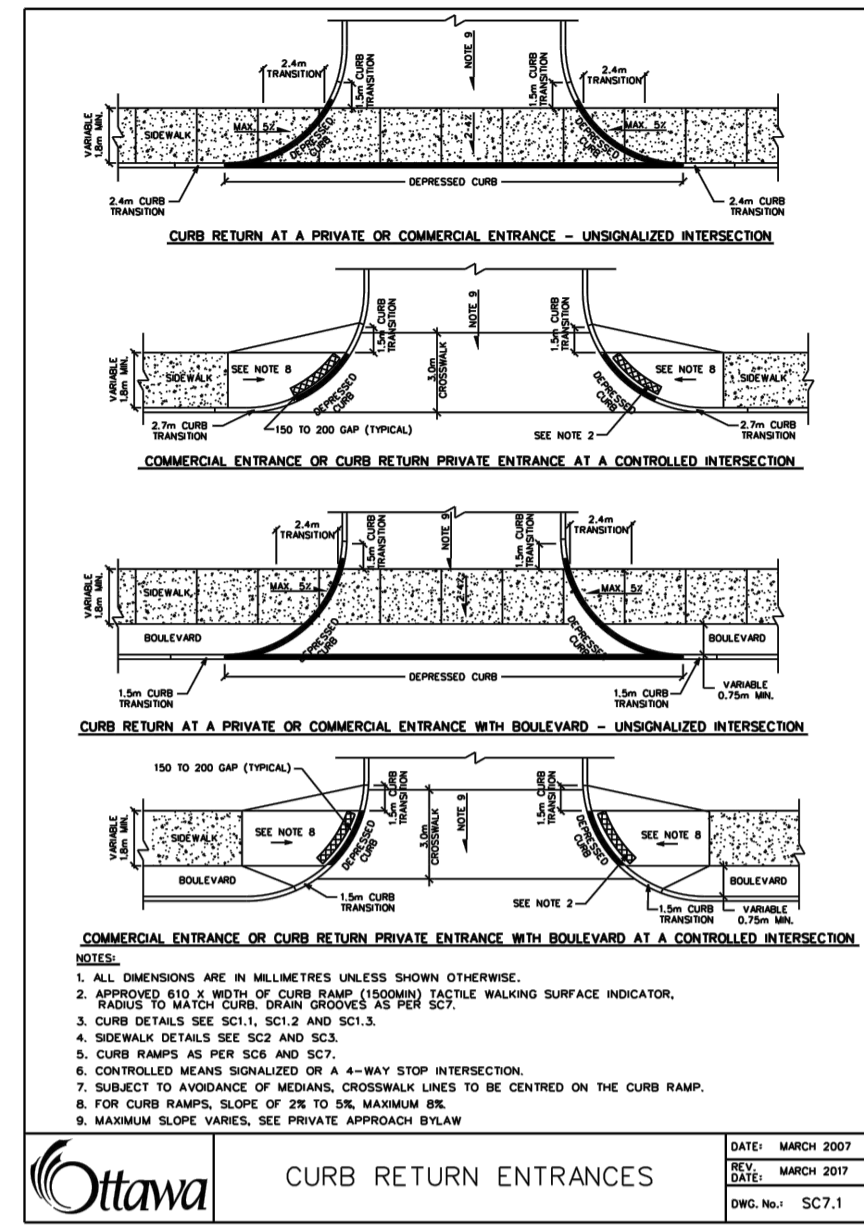


Ottawa CURB RETURN ENTRANCES
 DATE: MARCH 2007
 DATE: MARCH 2007
 Dwg. No.: SC7.1

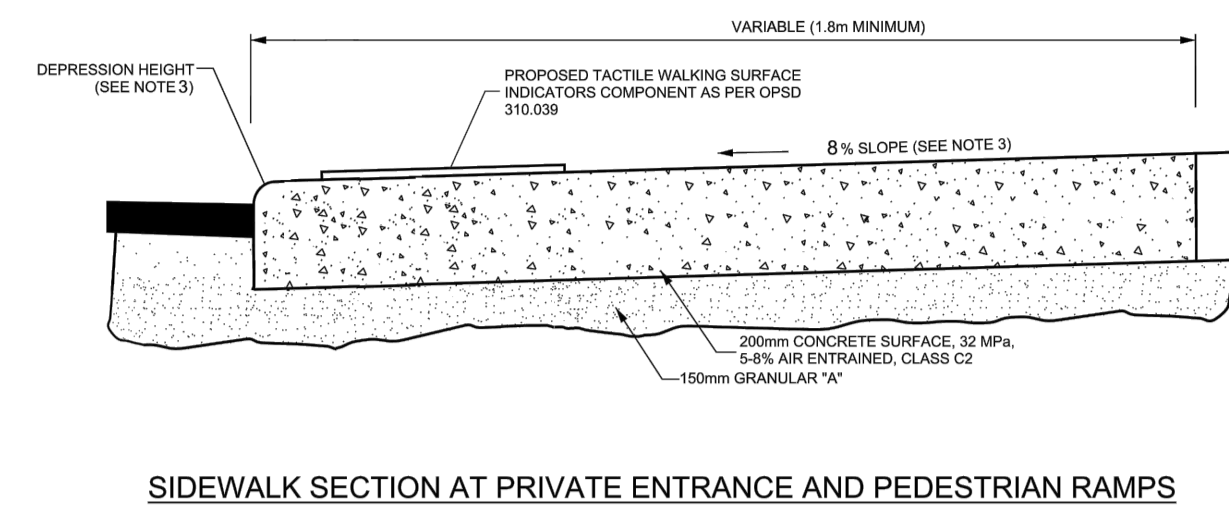


SIDEWALK SECTION AT PRIVATE ENTRANCE AND PEDESTRIAN RAMP


- NOTES:
1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
 2. FOR CURB RAMPS, SLOPE OF 2% TO 5%, MAXIMUM 8%.
 3. DEPRESSION HEIGHT TO 6 mm

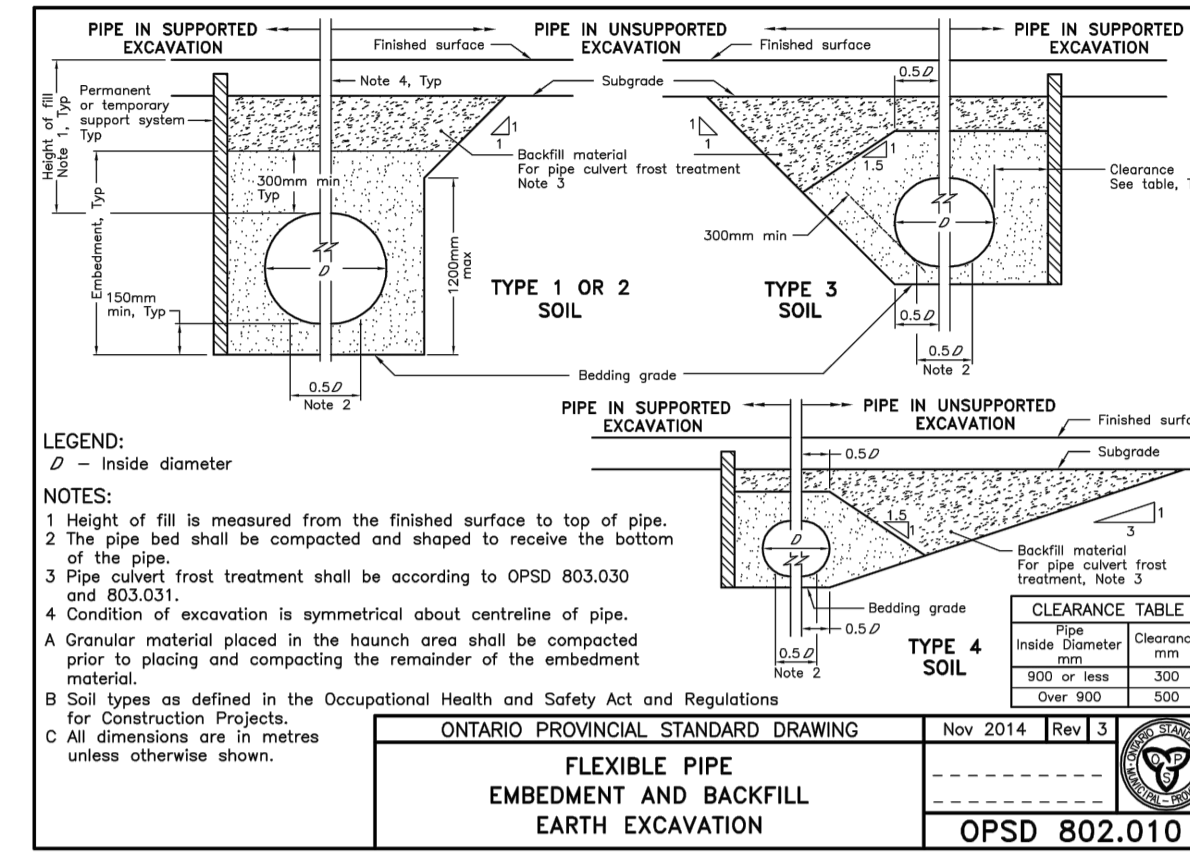


Ottawa FLEXIBLE PIPE EMBEDMENT AND BACKFILL EARTH EXCAVATION
 DATE: NOV 2014
 DATE: NOV 2014
 Dwg. No.: OPSD 802.010

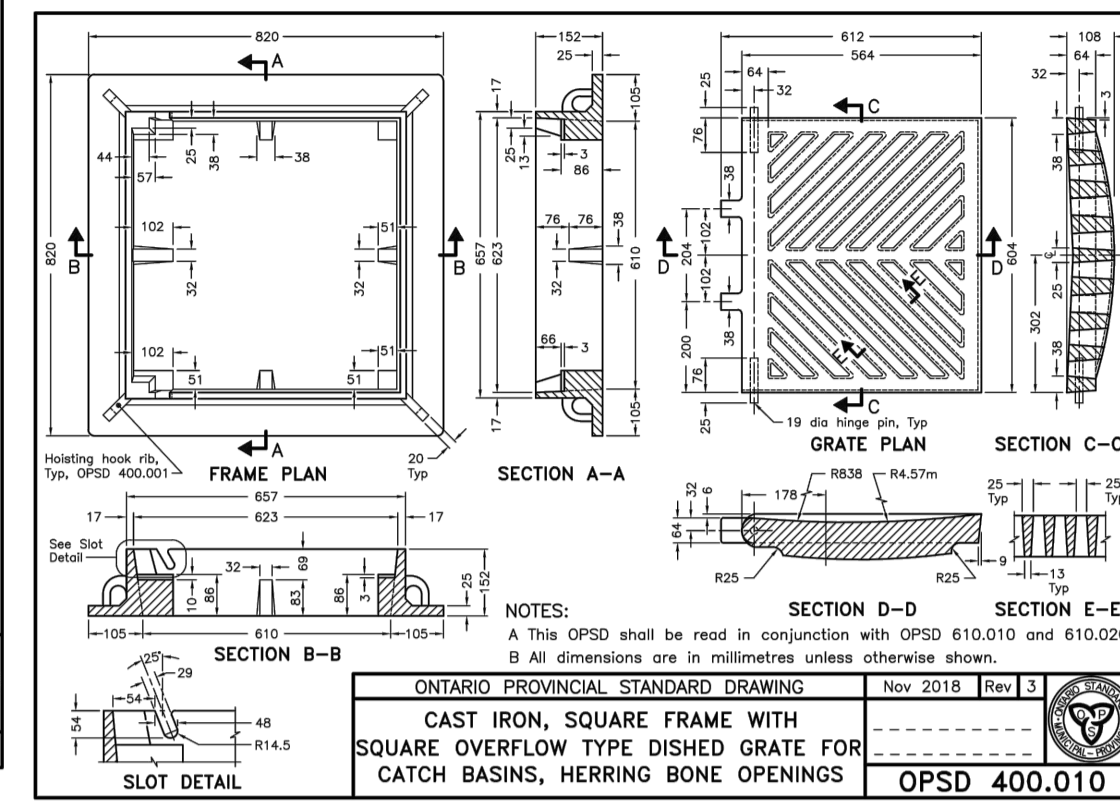


Ottawa CAST IRON, SQUARE FRAME WITH SQUARE OVERFLOW TYPE DISH GRATE FOR CATCH BASINS, HERRING BONE OPENINGS
 DATE: NOV 2018
 DATE: NOV 2018
 Dwg. No.: OPSD 400.010

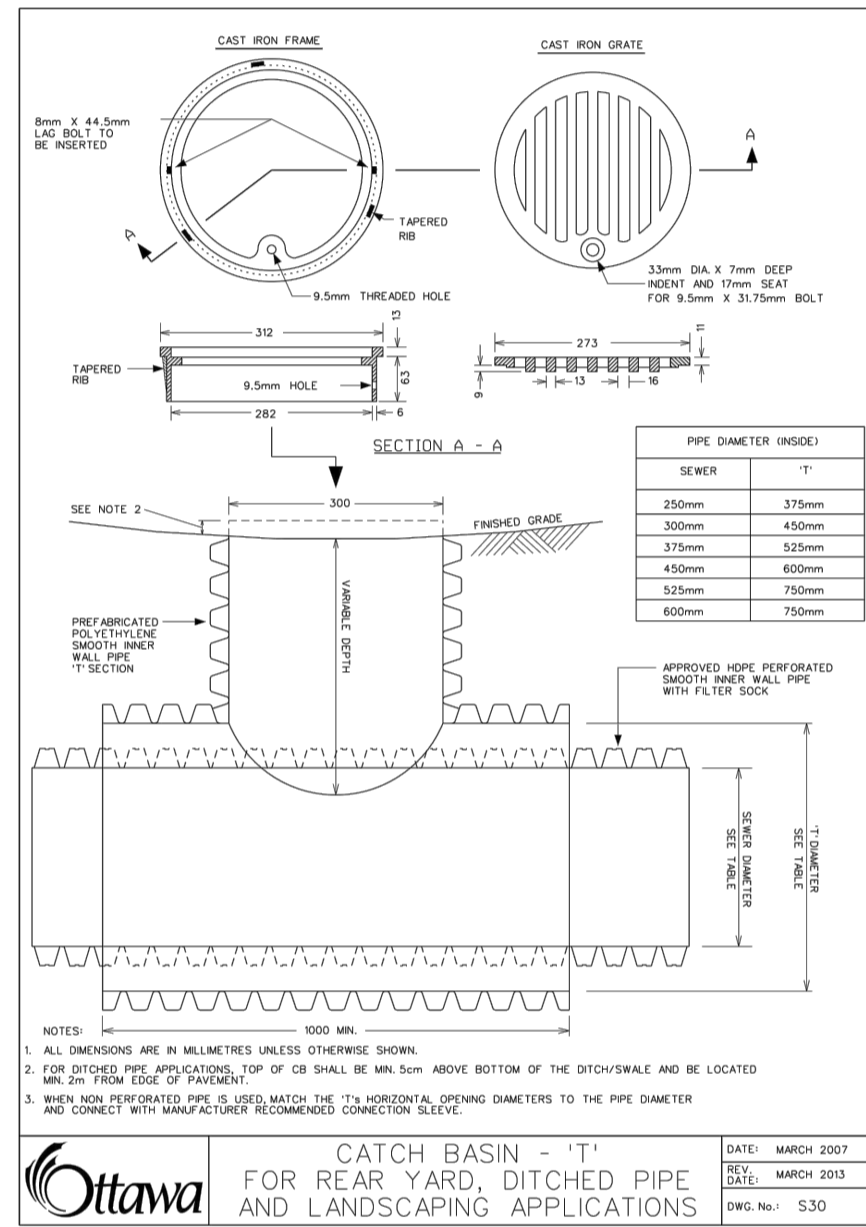


Ottawa CATCH BASIN MAINTENANCE HOLE COVER (MODIFIED OPSD-401.020)
 DATE: MARCH 2007
 DATE: MARCH 2003
 Dwg. No.: S30

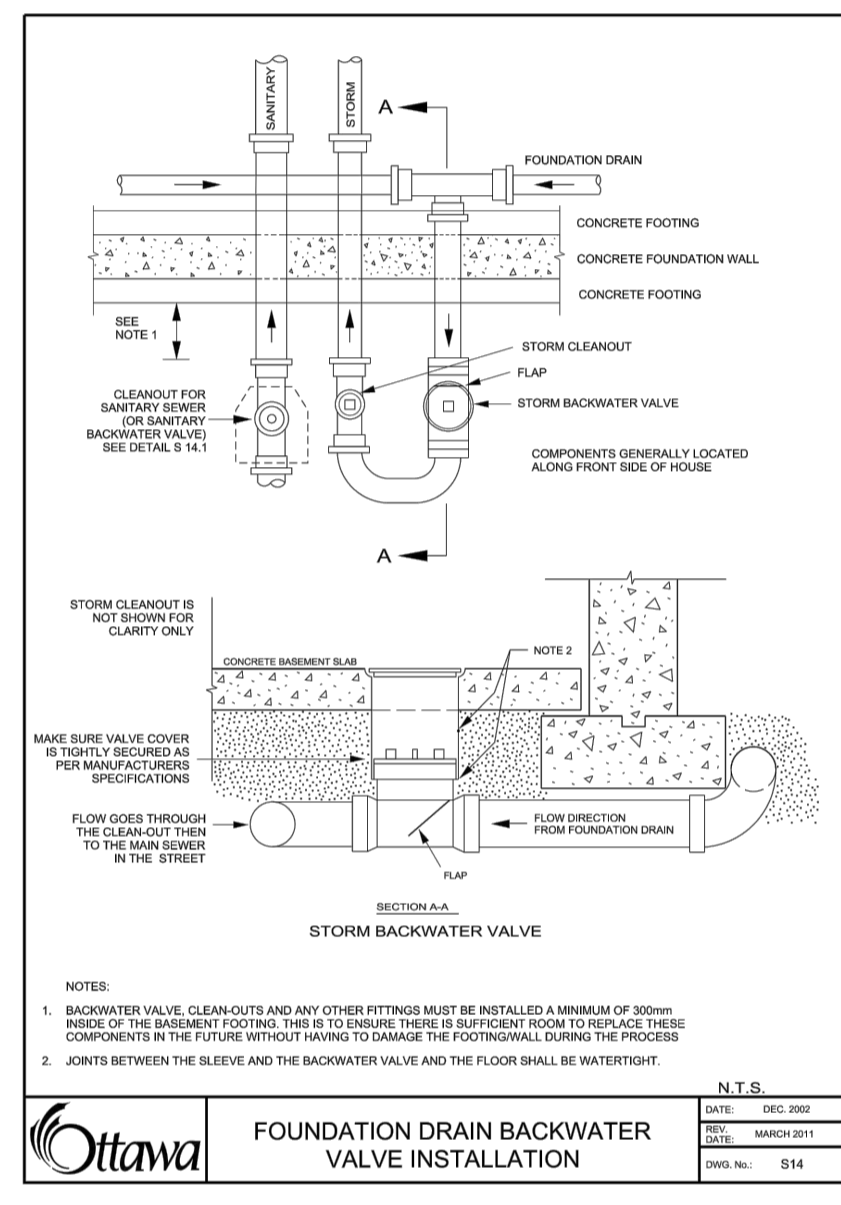


Ottawa FOUNDATION DRAIN BACKWATER VALVE INSTALLATION
 DATE: NOV 2012
 DATE: NOV 2012
 Dwg. No.: S14

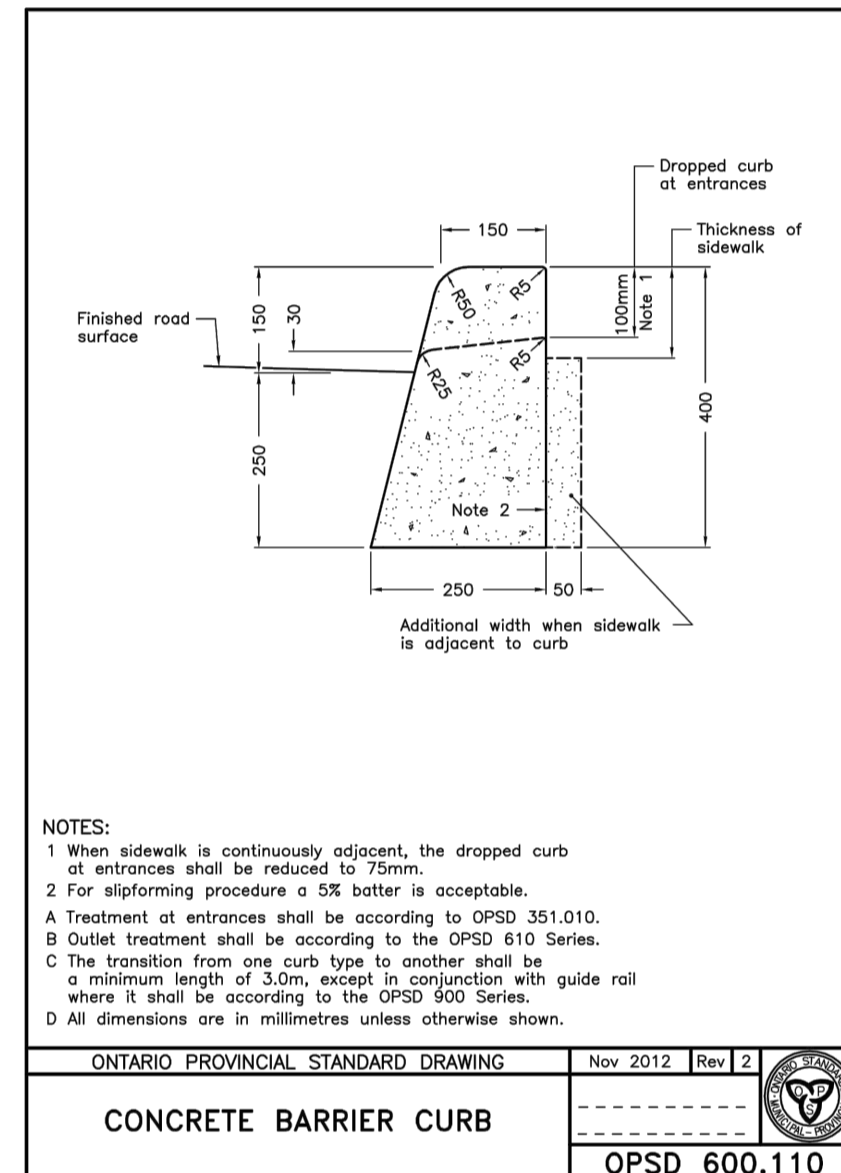


Ottawa CONCRETE BARRIER CURB
 DATE: NOV 2012
 DATE: NOV 2012
 Dwg. No.: OPSD 600.110

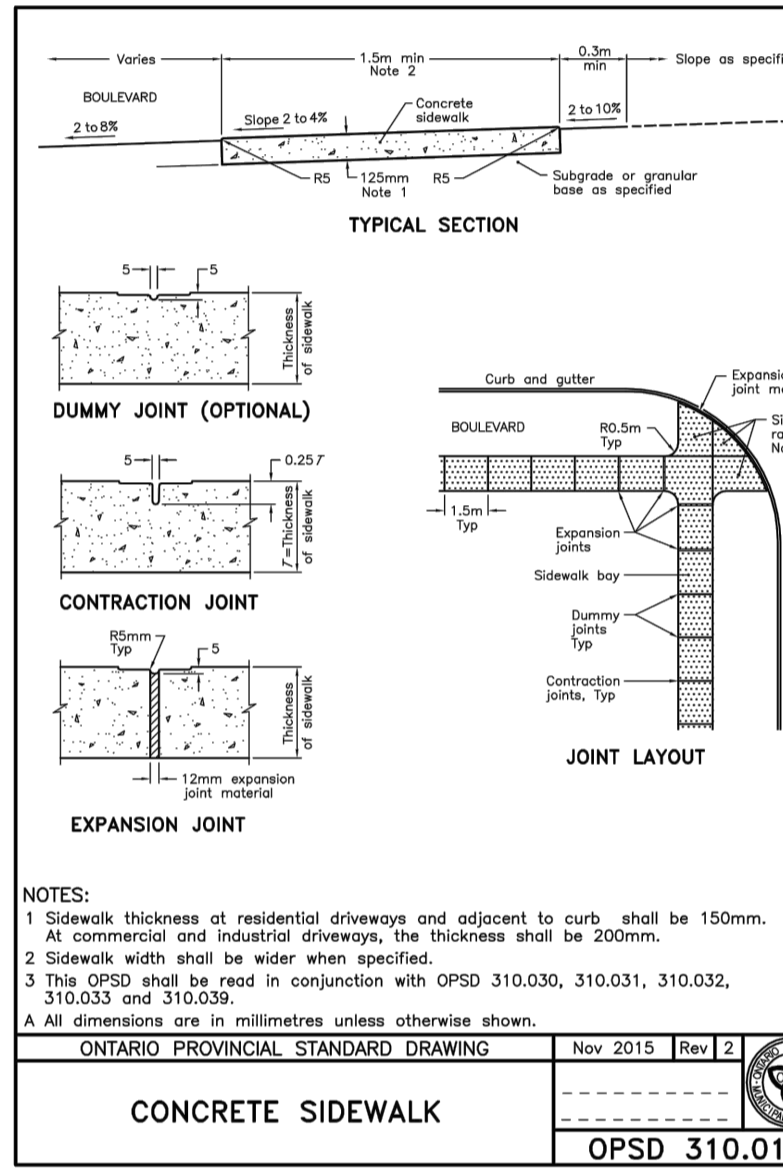


Ottawa CONCRETE SIDEWALK
 DATE: NOV 2015
 DATE: NOV 2015
 Dwg. No.: OPSD 310.010

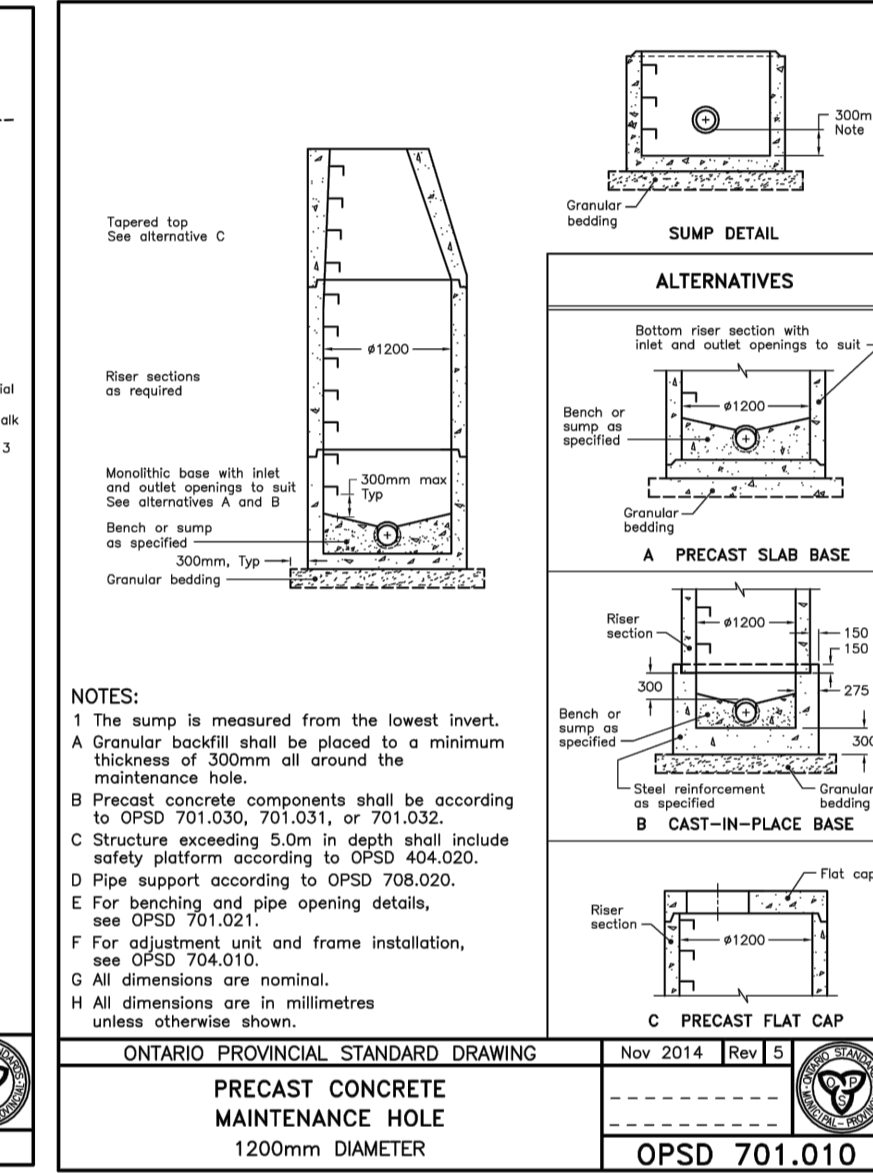


Ottawa PRECAST CONCRETE MAINTENANCE HOLE 1200mm DIAMETER
 DATE: NOV 2014
 DATE: NOV 2014
 Dwg. No.: OPSD 701.010

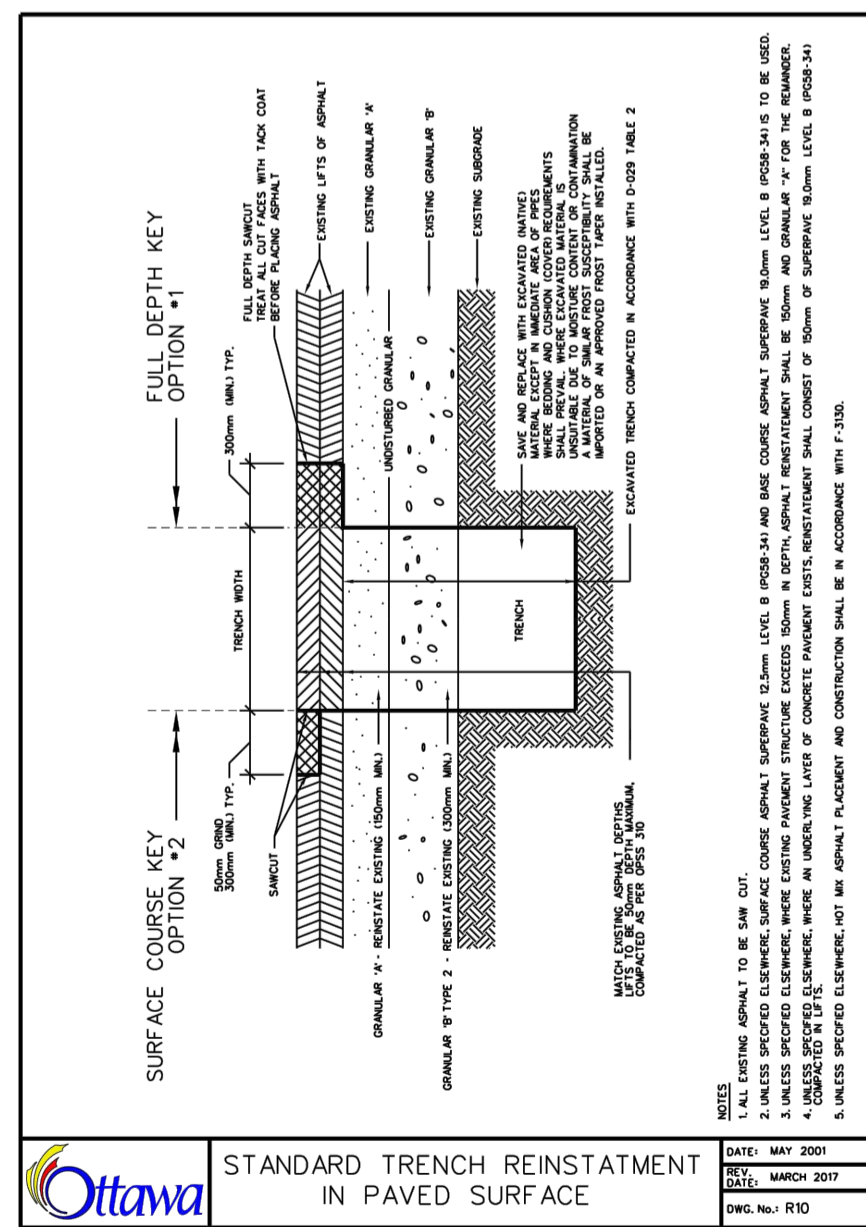


Ottawa STANDARD TRENCH REINSTATEMENT IN PAVED SURFACE
 DATE: MAY 2001
 DATE: MARCH 2007
 DATE: MARCH 2007
 Dwg. No.: PSD

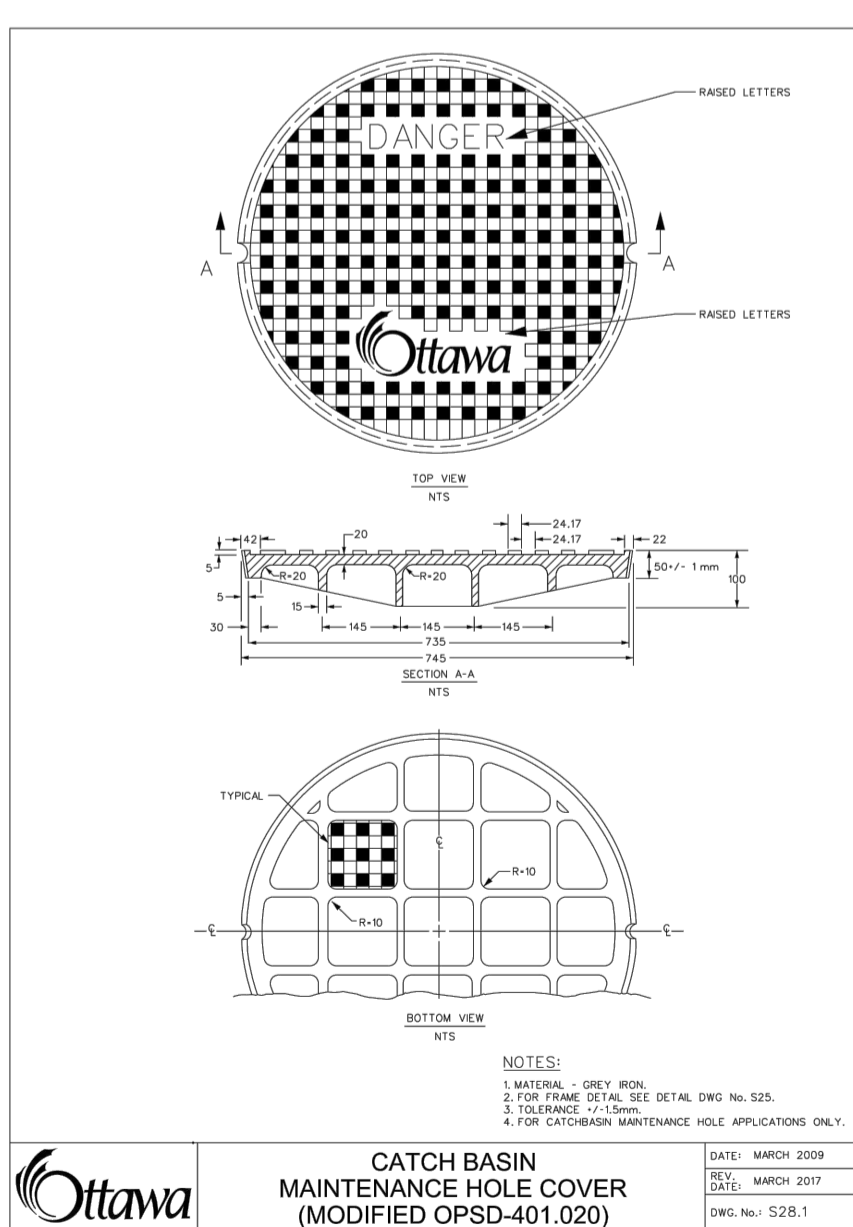


Ottawa CATCH BASIN MAINTENANCE HOLE COVER (MODIFIED OPSD-401.020)
 DATE: MARCH 2007
 DATE: MARCH 2007
 DATE: MARCH 2007
 Dwg. No.: S26.1

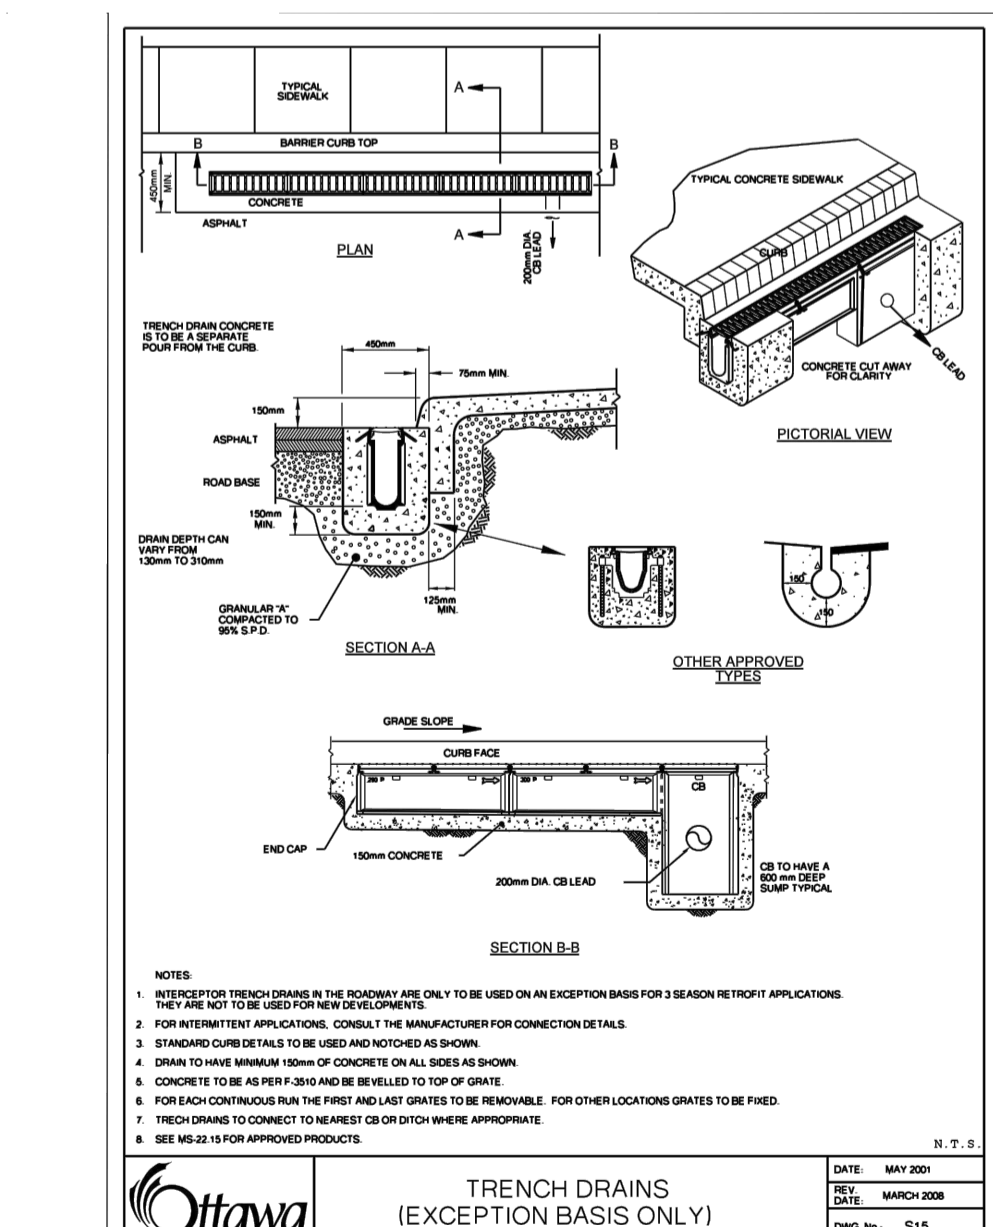

Ottawa TRENCH DRAINS (EXCEPTION BASIS ONLY)
 DATE: MAY 2001
 DATE: MARCH 2007
 DATE: MARCH 2007
 Dwg. No.: S15

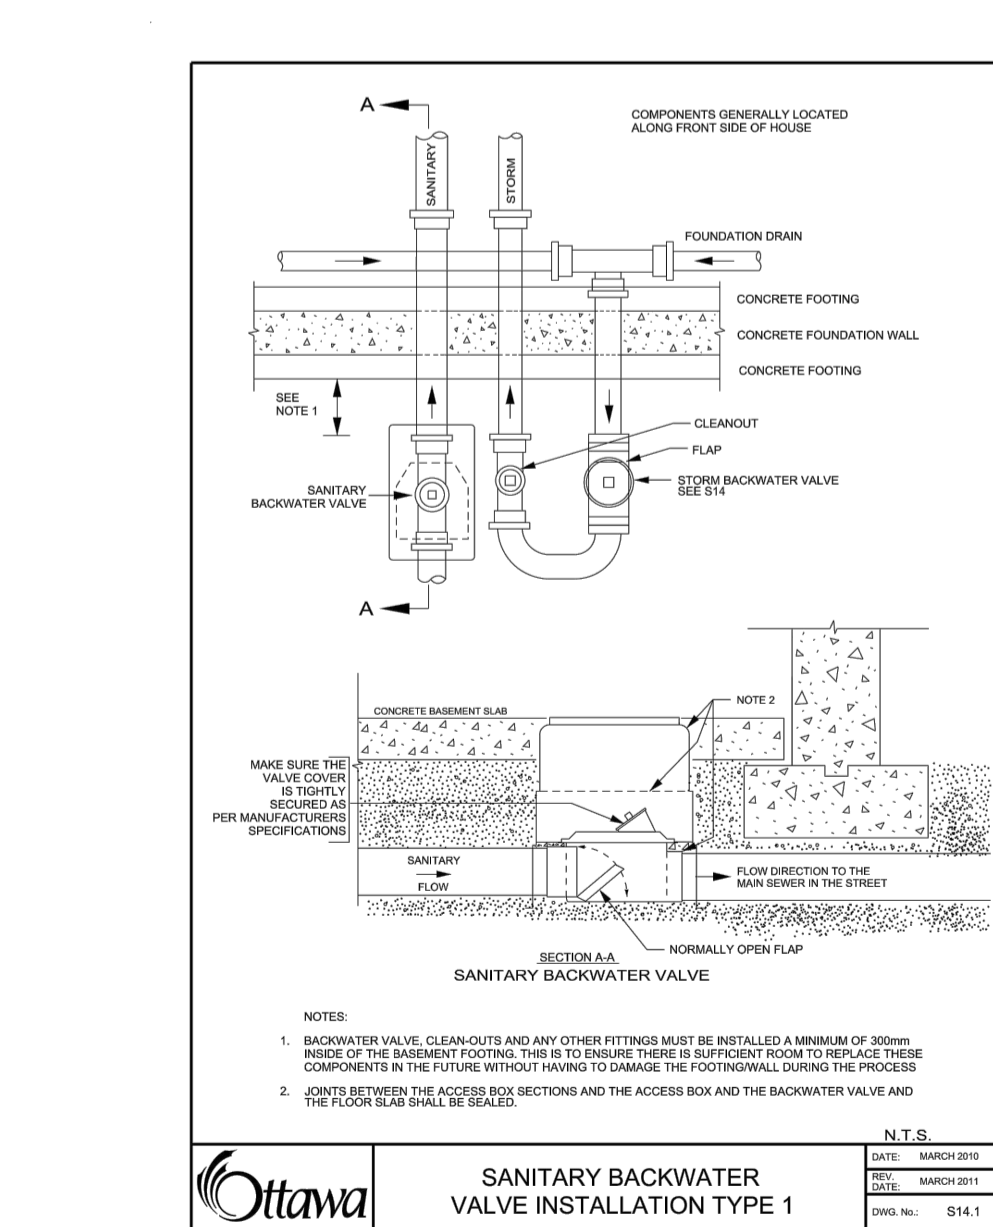

Ottawa SANITARY BACKWATER VALVE INSTALLATION TYPE 1
 DATE: MARCH 2001
 DATE: MARCH 2001
 DATE: MARCH 2001
 Dwg. No.: S14

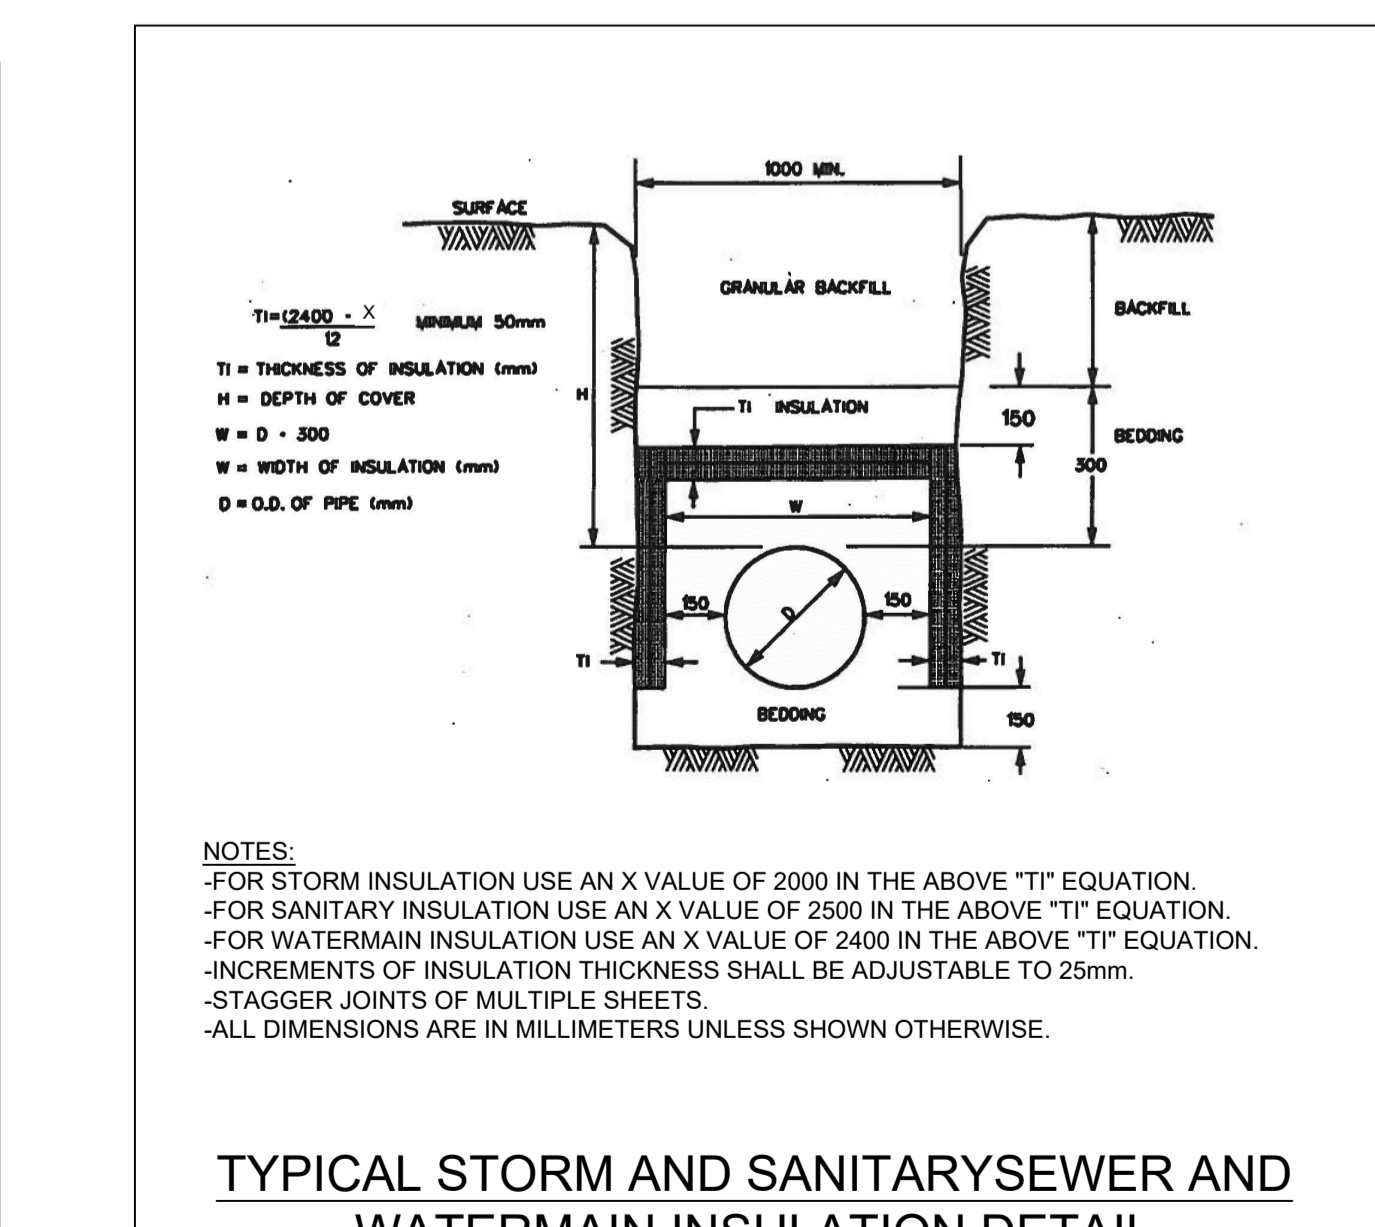

Ottawa TYPICAL STORM AND SANITARYSEWER AND WATERMAIN INSULATION DETAIL (N.T.S.)
 DATE: MARCH 2001
 DATE: MARCH 2001
 DATE: MARCH 2001
 Dwg. No.: S14

USE AND INTERPRETATION OF DRAWINGS
 GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE USE AND INTENT OF THE DRAWING. THE CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE BEGINNING WORK.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS NOTIFIED THE CITY (FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS).

AS INSTRUMENTS OF SERVICE AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTIFYING.

UNAUTHORIZED CHANGES:
 IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS, OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COST, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:
 EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE BEGINNING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND CONDITIONS. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTIFYING.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

ISSUED FOR MUNICIPAL APPROVAL: 13 NOV 2020
 APPROVAL FOR MUNICIPAL APPROVAL: 30 OCT 2020
 ISSUED FOR MUNICIPAL APPROVAL: 02 OCT 2020

NO. REVISIONS BY DATE

NOT AUTHENTIC UNLESS SIGNED AND DATED

REGISTERED PROFESSIONAL ENGINEER
 M. BASNET
 100501996
 2020/11/13
 PROVINCE OF ONTARIO

CLIENT: MARK FARRELL
 533 Gilmour Street,
 Ottawa ON K1R 5L3

DESIGNED BY: A.S.
 DRAWN BY: A.S.
 APPROVED BY: M.H.

PROJECT: 700 CORONATION AVENUE
 PROPOSED 4-STORY BUILDING ADDITION

DRAWING TITLE: CONSTRUCTION DETAIL PLAN



PROJECT NO.: 200463
 DATE: SEPTEMBER 2020

C901

DRAWINGS/FIGURES

**Proposed Site Plan
Legal Survey
As-builts**



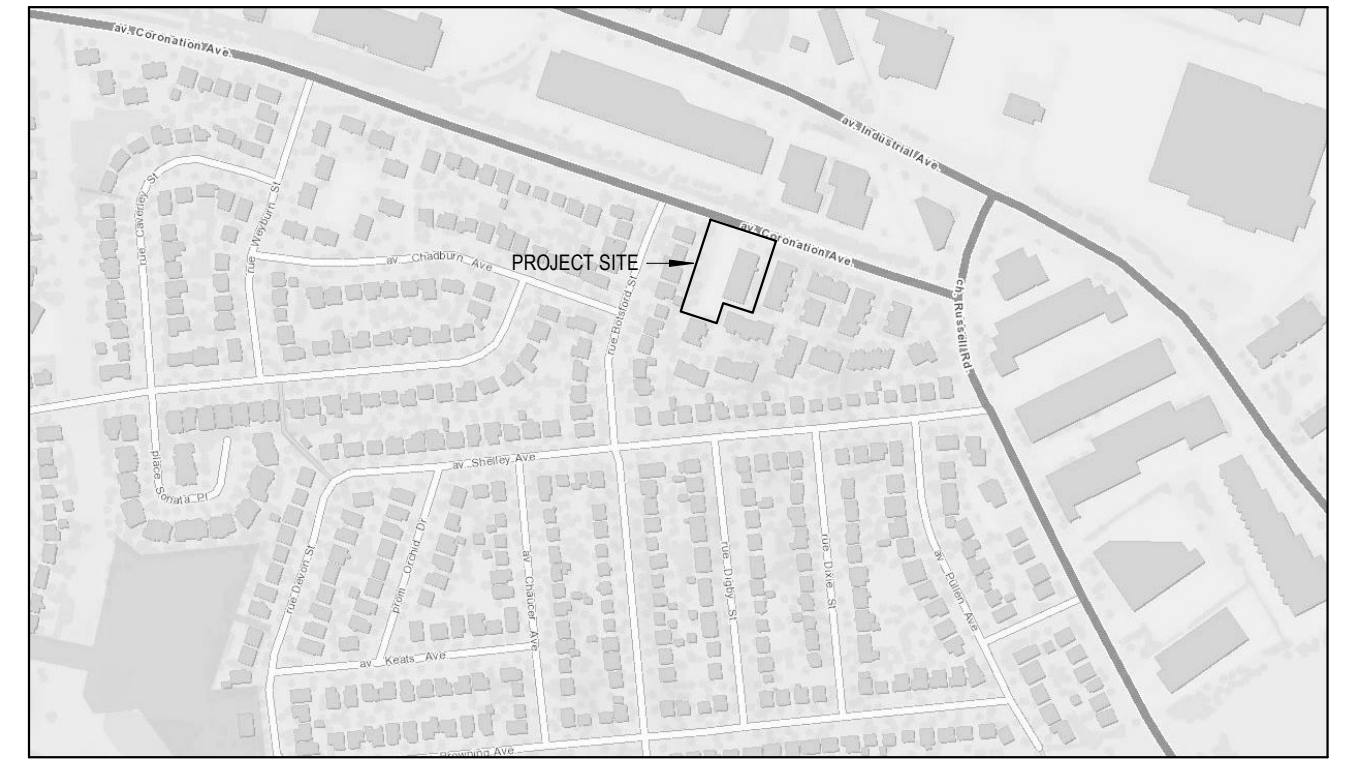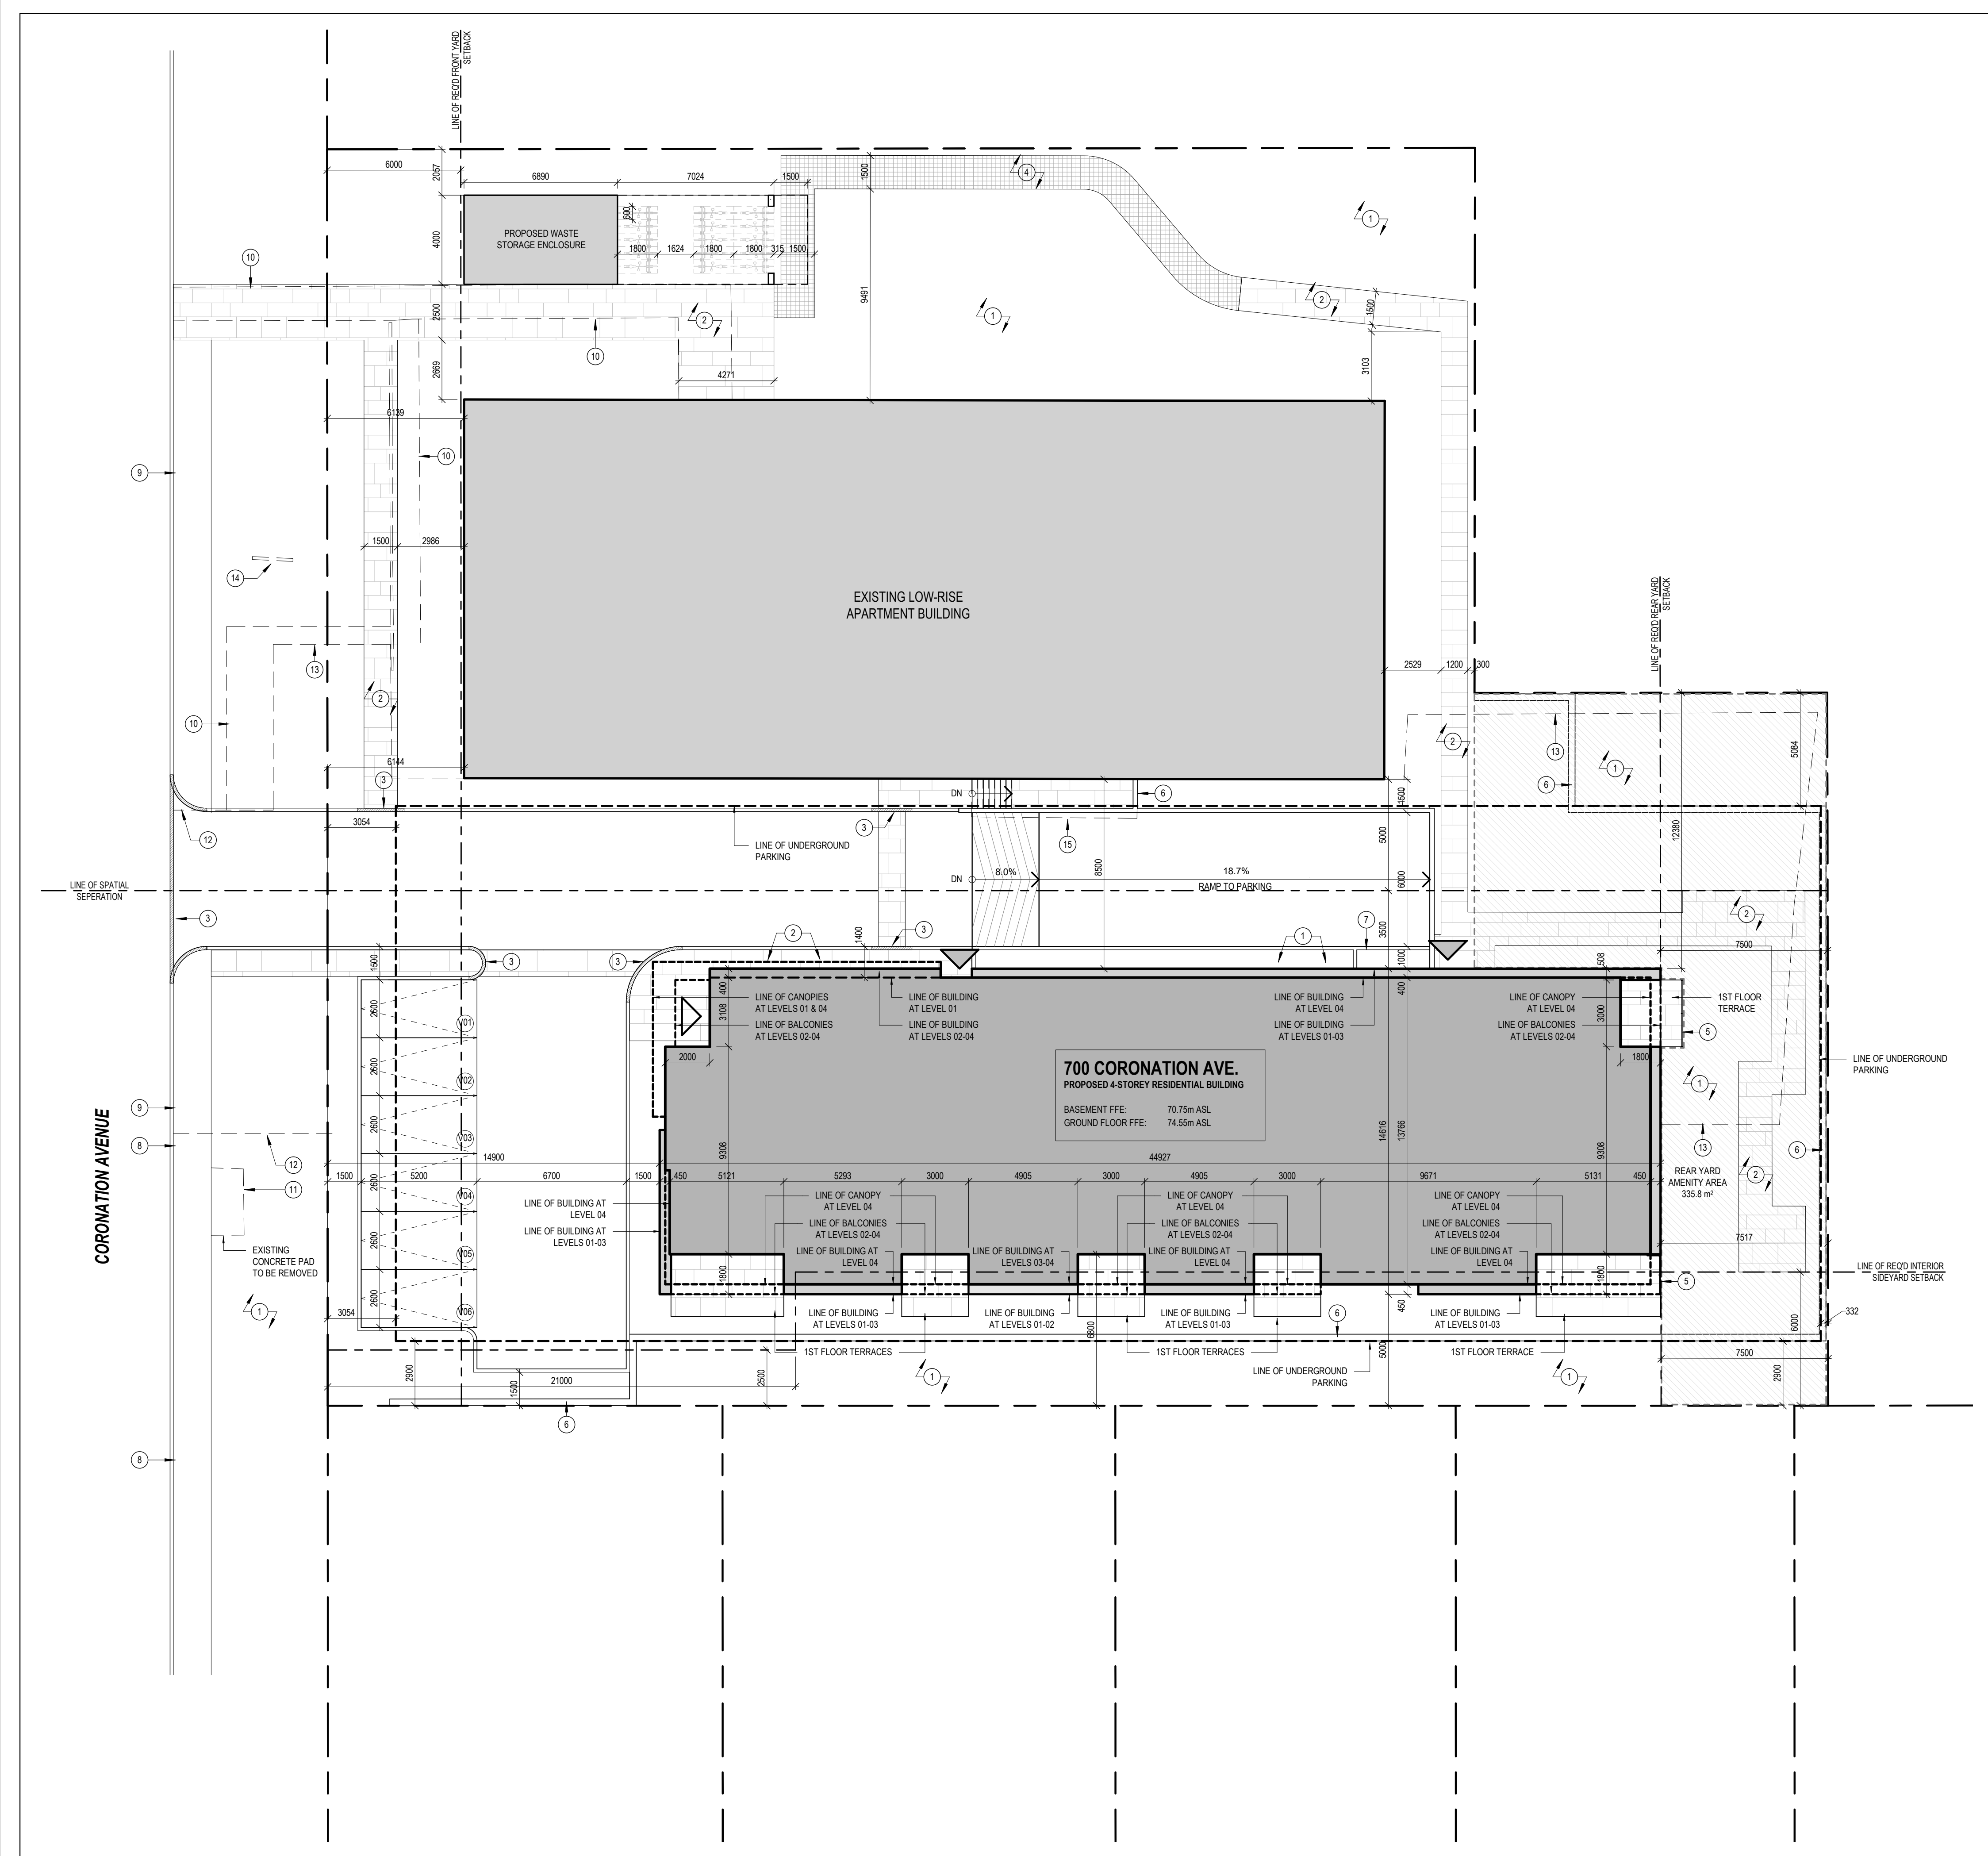

2 LOCATION PLAN
SP-01 SCALE: 1 : 3

TOPOGRAPHIC PLAN SURVEY OF
PART OF BLOCK F
REGISTERED PLAN 605
CITY OF OTTAWA
FARLEY, SMITH & DENIS SURVEYING LTD. 2020

3 SURVEY INFO
SP-01 SCALE: 1 : 1

- SITE PLAN SYMBOLS LEGEND**
- BUILDING ENTRANCE
 - BUILDING EXIT
 - LS LIGHT STANDARD

4 SYMBOLS LEGEND
SP-01 SCALE: 1 : 1

- 1 SOFT LANDSCAPING (REFER TO LANDSCAPE)
- 2 INTERLOCKED CONCRETE PAVERS (REFER TO LANDSCAPE)
- 3 DEPRESSED CURB
- 4 PERMEABLE PAVERS (REFER TO LANDSCAPE)
- 5 PRIVACY SCREEN
- 6 RETAINING WALL
- 7 AREA WELL
- 8 EXISTING SIDEWALK
- 9 NEW CONCRETE SIDEWALK
- 10 EXISTING CONCRETE PAVERS TO BE REMOVED
- 11 EXISTING CONCRETE PAD TO BE REMOVED
- 12 EXISTING ASPHALT DRIVE AISLE TO BE REMOVED
- 13 EXISTING ASPHALT PARKING LOT TO BE REMOVED
- 14 EXISTING SIGNAGE TO BE REMOVED
- 15 EXISTING EXIT ENCLOSURE TO BE DEMOLISHED

KEYNOTE LEGEND
SP-01 SCALE: N.T.S.

STATISTICS AND ZONING INFORMATION

ZONING DESIGNATION: R4N

Dwelling Units: 35

BICYCLE PARKING CALCULATION
As per Table 111A

Required Parking: 18 spaces
0.5sp/Dwelling unit (111A)(i))

Total Parking Provided: 19 spaces

PARKING CALCULATION
As per Section 107 & Section 102

Parking Space Rate Area: Area B

NEW BUILDING

Residential Units: 35 units
Required Parking: 18 spaces
0.5 spaces/unit

Visitor Parking:
Required Parking: 7 spaces
0.2 spaces/unit
Parking Provided: 7 spaces

EXISTING BUILDING

Residential Units: 30 spaces
Required Parking: 15 spaces
0.5 spaces/unit
Parking Provided: 15 spaces

Visitor Parking:
Required Parking: 6 spaces
0.2 spaces/unit
Parking Provided: 7 spaces

Parking Provided: 40 spaces
(13 at Rideshed Length)

Total Required Parking: 46 spaces
Total Parking Provided: 47 spaces

AMENITY AREA CALCULATION
As per Table 137

Total Amenity Area Req'd: 282m²
15m²/unit for first 8
6m²/unit for 9 to 35

Communal Area Required: 141m²
Communal Area Provided: 167m²

Private Amenity Provided: 176m²

Total Amenity Area Provided: 343m²

GENERAL ARCHITECTURAL NOTES:

- This drawing is the property of the Architect and may not be reproduced or used without the expressed consent of the Architect.
- Drawings are not to be scaled. The Contractor is responsible for checking and verifying all levels and dimensions and shall report all discrepancies to the Architect and obtain clarification prior to commencing work.
- Upon notice in writing, the Architect will provide written/graphic clarification or supplementary information regarding the intent of the Contract Documents.
- The Architectural drawings are to be read in conjunction with all other Contract Documents including Project Manuals and the Structural, Mechanical and Electrical Drawings.
- Positions of exposed or finished Mechanical or Electrical devices, fittings and fixtures are indicated on the Architectural Drawings. Locations shown on the Architectural Drawings shall govern over Mechanical and Electrical Drawings. Mechanical and Electrical items not clearly located will be located as directed by the Architect.
- These documents are not to be used for construction unless specifically noted for such purpose.

4 ISSUED FOR SITE PLAN CONTROL	2020-11-13
3 ISSUED FOR COORDINATION	2020-09-18
2 ISSUED FOR COORDINATION	2020-09-04
1 ISSUED FOR COORDINATION	2020-06-23

ISSUE RECORD



project1 studio
Project1 Studio Incorporated
[613.884.9339 | email@project1studio.ca]

700 Coronation Avenue
700 Coronation Avenue
Ottawa, ON

PROJ	SCALE	DRAWN	REVIEWED
2004	NOTED	IB/LB	RMK

SITE PLAN

SP-01

1 SITE PLAN
SP-01 SCALE: 1 : 150

CORONATION (REGISTERED PLAN 605) STREET


P. I. N. 04256 -- 04256

TOPOGRAPHIC PLAN OF SURVEY OF

PART OF BLOCK F REGISTERED PLAN 605 CITY OF OTTAWA

FARLEY, SMITH & DENIS SURVEYING LTD. 2020

Scale 1: 200



Metric Note

Distances and coordinates on this plan are in metres and can be converted to feet by dividing by 0.3048.

Bearing Note

Bearings are astronomic and are referred to the Southerly limit of Coronation Street having a bearing of N 71° 06' 00" W as shown on Plan SR-7688.

Elevation Notes


- 1. Elevations shown are geodetic and are referred to Geodetic Datum CGVD-1928 :1978.
2. It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.

Utility Notes

- 1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
2. Only visible surface utilities were located.
3. Underground utility data derived from City of Ottawa utility sheet reference: F-1-c & 14012.
4. Sanitary and storm sewer grades and inverts were derived from: Field measurement.
5. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

Notes & Legend

Table with 2 columns: Symbol and Description. Includes symbols for Survey Monument Planted, Survey Monument Found, Short Standard Iron Bar, etc.

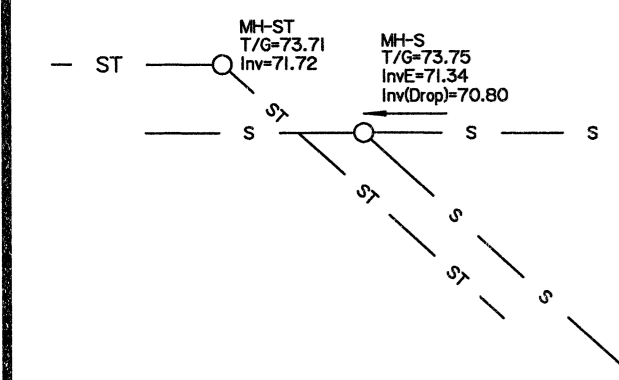


BOTS FORD STREET

CARLETON CONDOMINIUM PLAN 277

CARLETON CONDOMINIUM PLAN 277

BLOCK "15277"

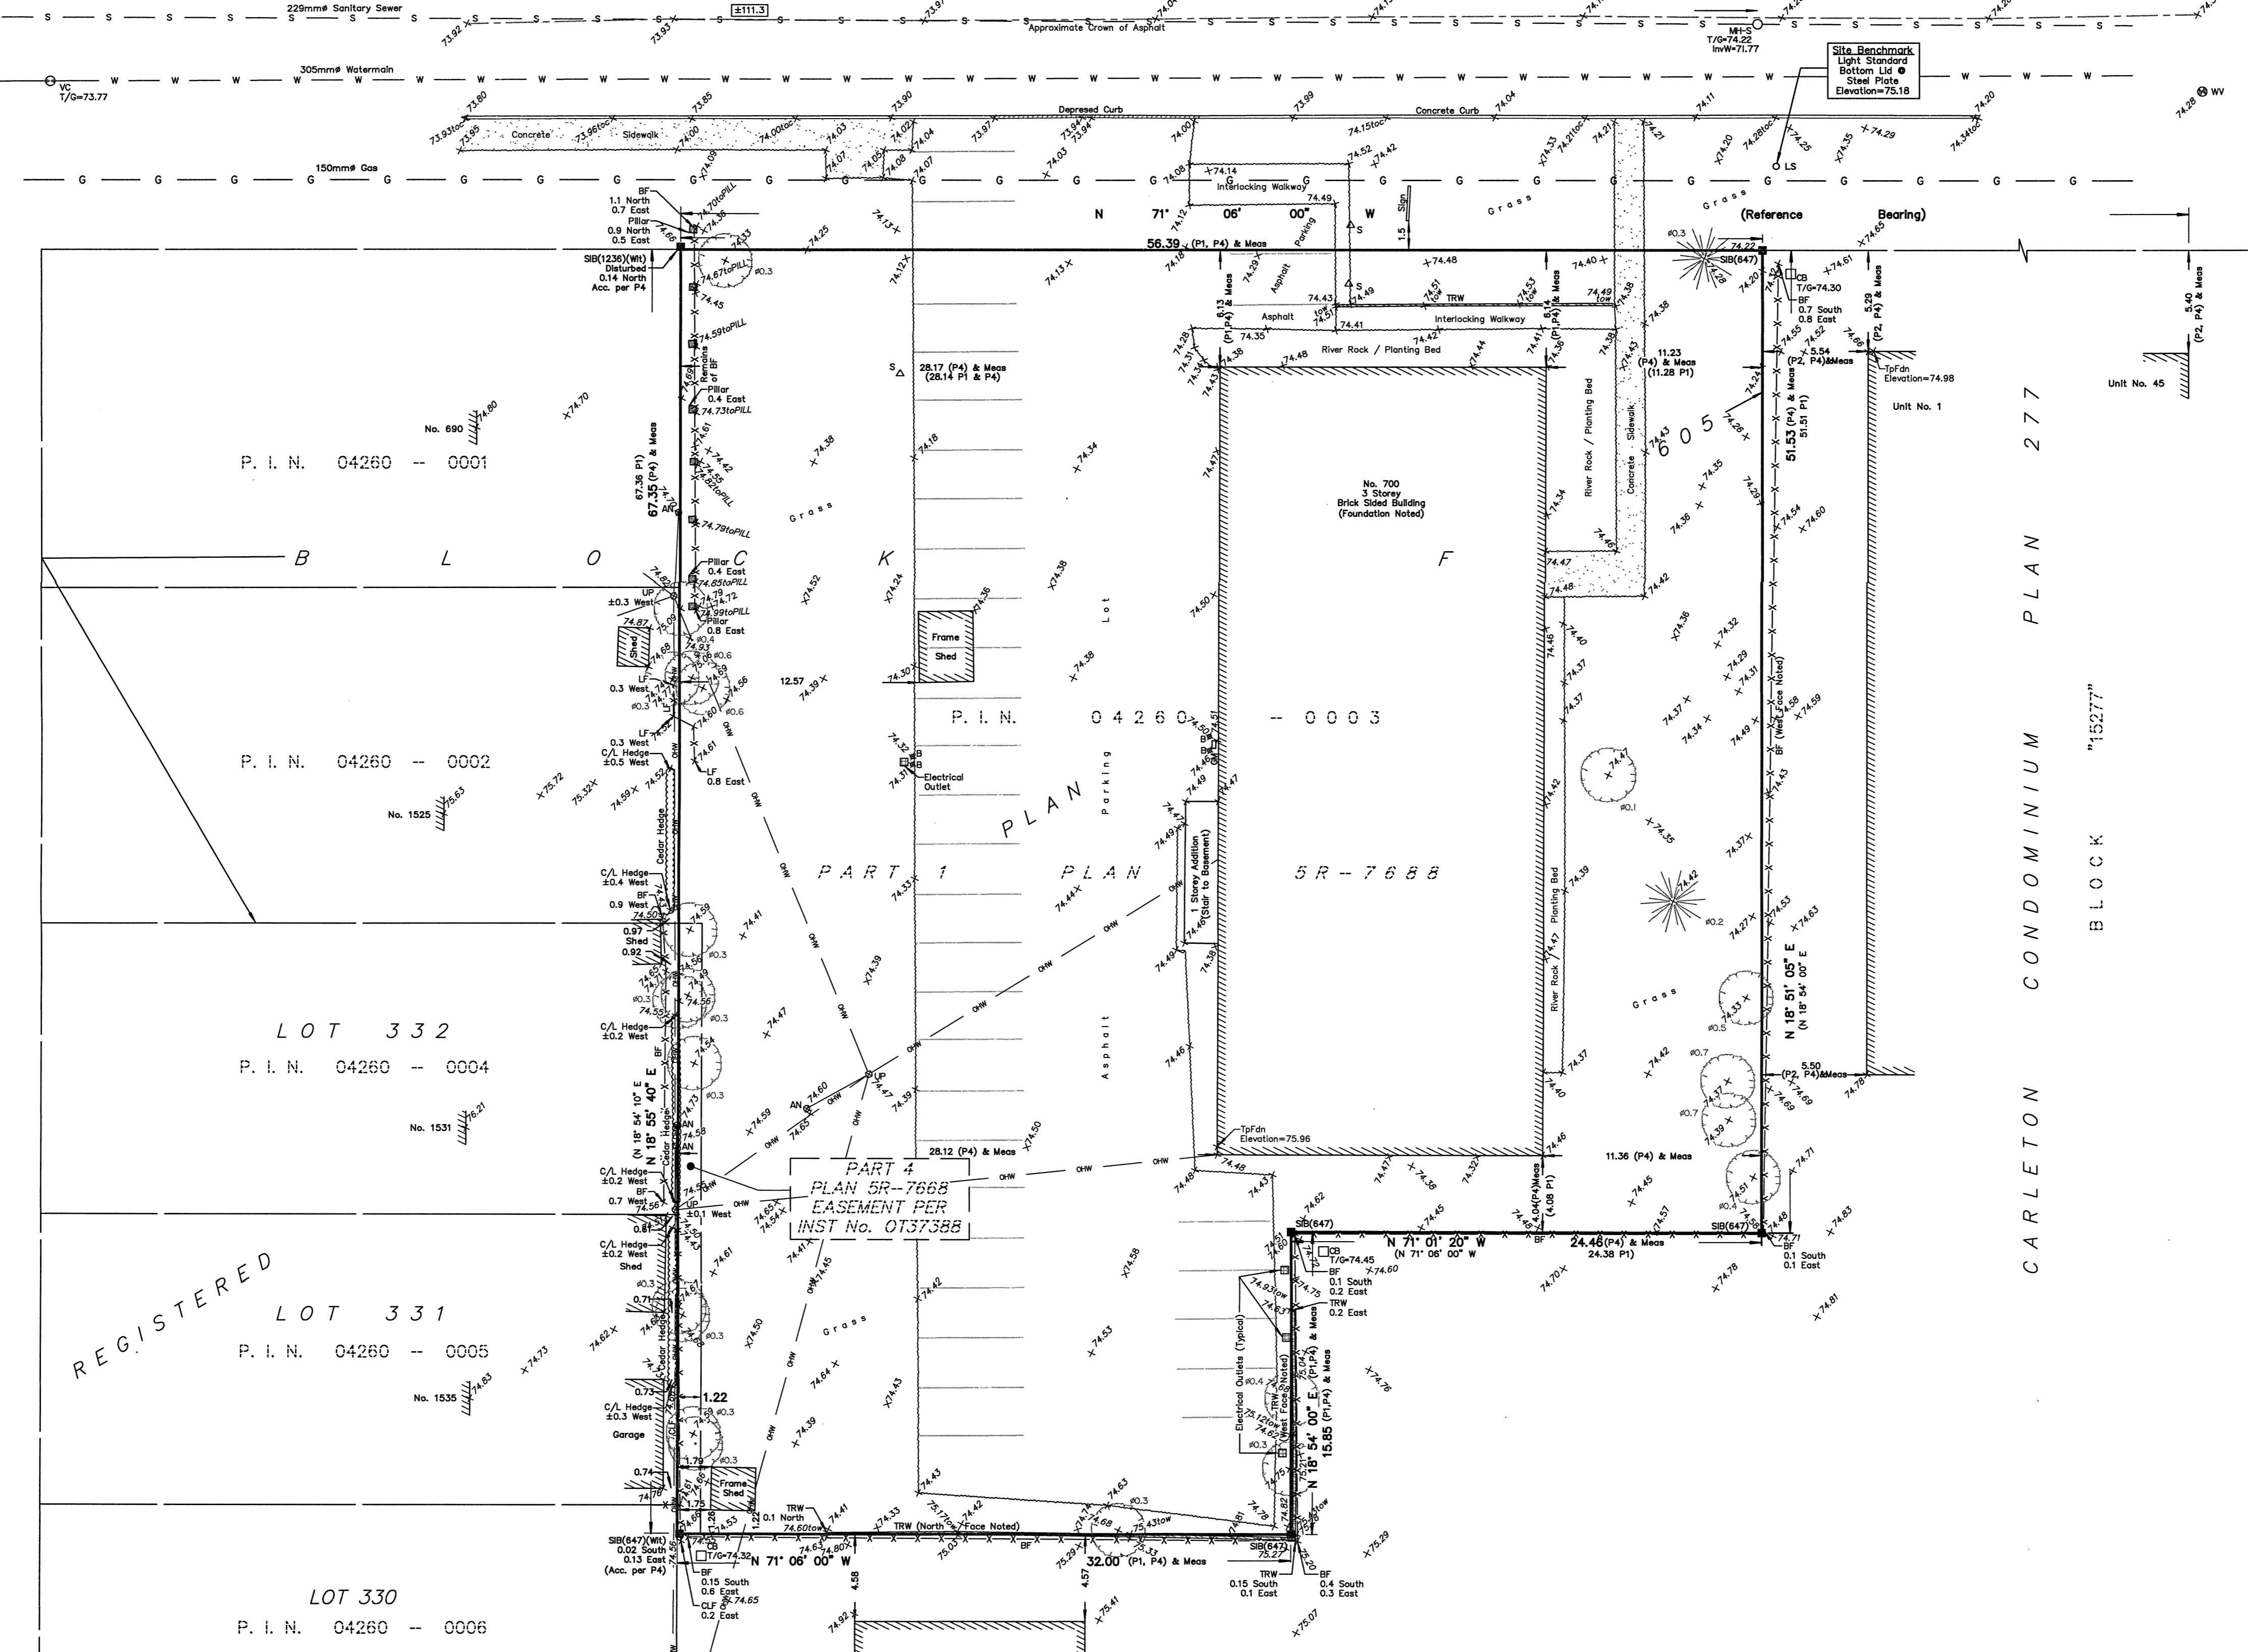


Surveyor's Certificate section with signature of Daniel Robinson, date Sept 1/20, and stamp of Farley, Smith & Denis Surveying Ltd.

WARNING: NO PERSON MAY COPY, REPRODUCE, DISTRIBUTE OR ALTER THIS PLAN IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF FARLEY, SMITH & DENIS SURVEYING LTD.

FARLEY, SMITH & DENIS SURVEYING LTD. CANADA LAND SURVEYORS

190 COLONNADE ROAD, OTTAWA, ONTARIO K2E 7J5 TEL. (613) 727-8226 FAX. (613) 727-1826

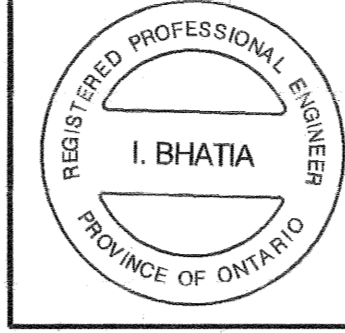

NO.	REVISIONS	BY	DATE
1	ISSUED FOR TENDER	DBS	17 DEC 02
2	ISSUED FOR CONSTRUCTION	DBS	13 APR 03
3	TRAFFIC CALMING ALTERATIONS	DBS	25 JUL 03
4	PROFILE RAISED BOTS. TO RUSS.		
5	AS CONSTRUCTED	JKH	6 DEC 07

NOTE:
The location of the utilities is approximate only, the exact location should be determined by consulting the municipal authorities and utility companies concerned.
The contractor shall prove the location of utilities and shall be responsible for adequate protection from damage

CORONATION AVENUE REHABILITATION
NEIGHBOURHOOD WAY TO RUSSELL ROAD


GRADING AND DRAINAGE / WATERMAIN LAYOUT IX
STA 3+350 TO STA 3+500

CONTRACT NO. ISB03 - 5001
DWG. NO. 5001-22
SHEET 22 OF 36
Date: April 2003
Scale: HORIZONTAL 1:250
VERTICAL 1:50

R. G. HEWITT, P.ENG. Director Infrastructure Services
W. BENNETT, P.ENG. Manager Construction Services - East


Dwn: DBS Ckcd: DBS Des: DBS Ckcd: BS

14012

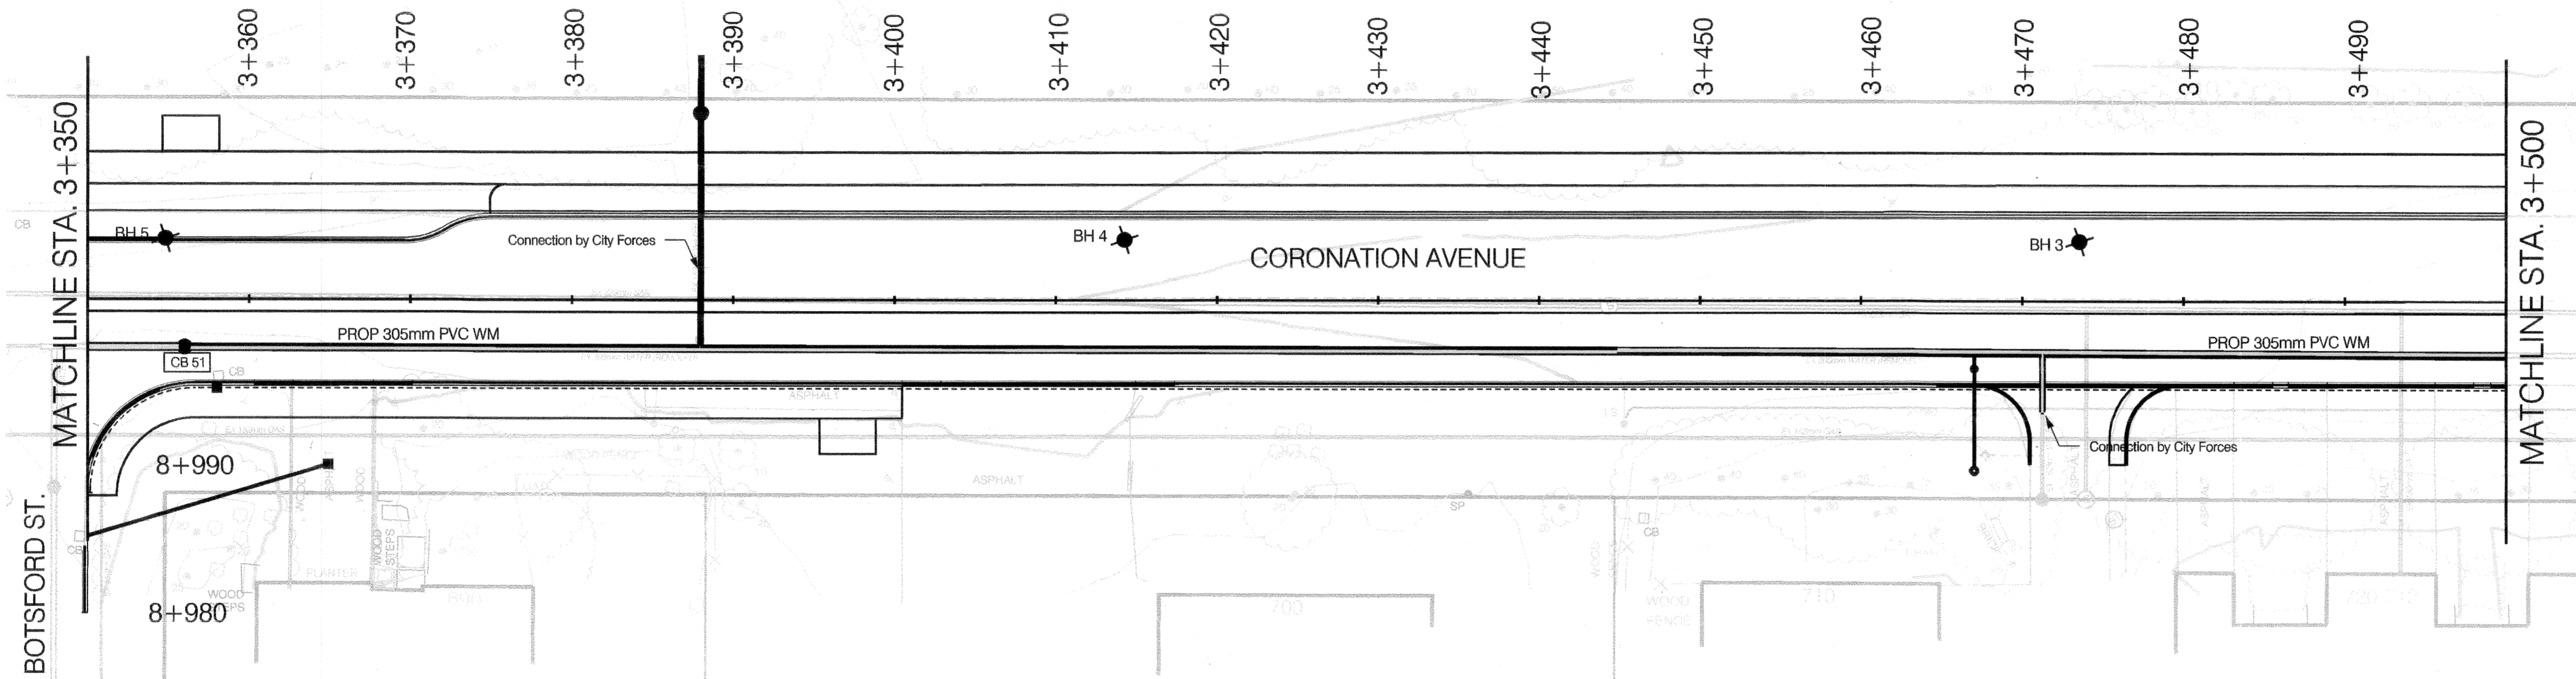

CATCH BASIN DATA						
NO.	STATION	OFFSET	DETAIL	STRUCTURE	ELEVATION	
					T&G	LOW IN V
EXCB51	3+358.103	x 3x RT	S24	Existing	73.851	72.471
CB51	3+358.000	5.19 RT	S3	Existing	73.851	72.471

OFFSETS ARE FROM CENTRE LINE TO FACE OF CURB FOR CURB INLET C.B.
TOP OF GRATE ELEVATIONS ARE REFERENCED TO THE TOP OF CURB FOR CURB INLET C.B.

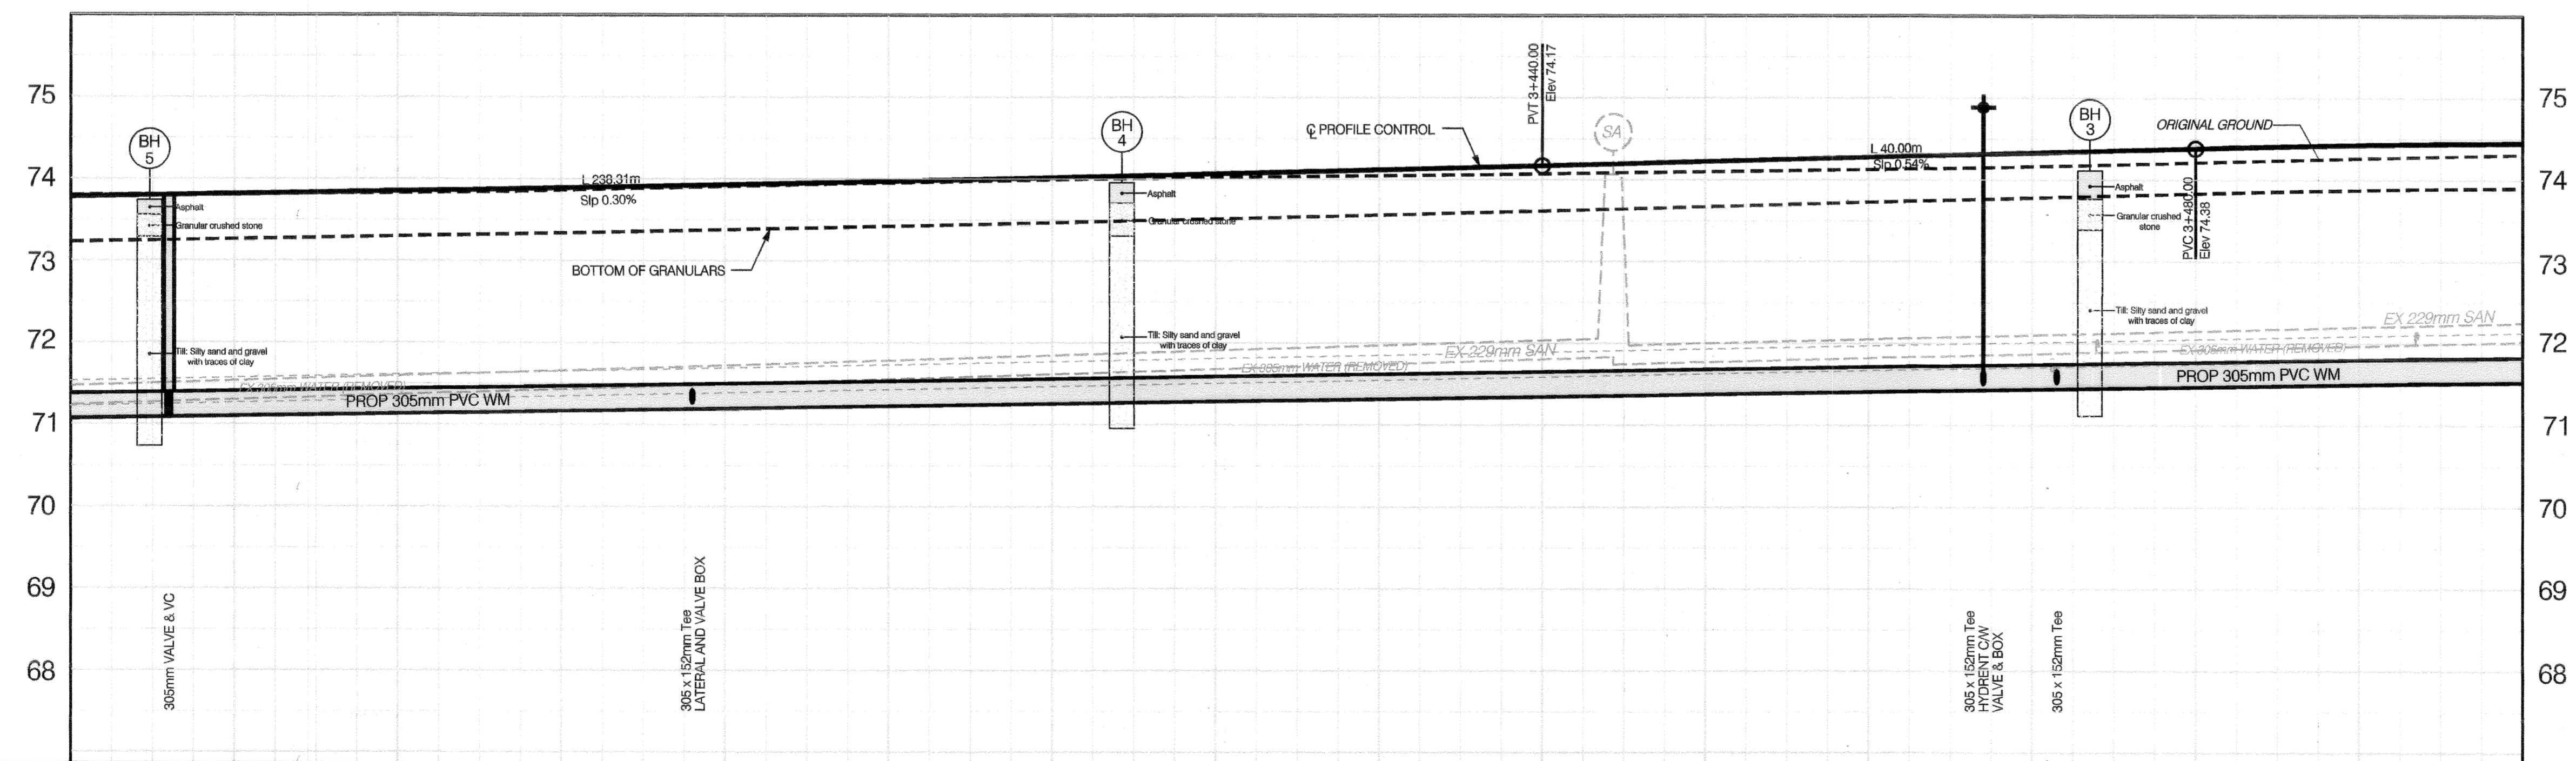

- WATERMAIN NOTES**
- 1 - ALL WATERMAIN MATERIALS AND CONSTRUCTION METHODS SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE CITY STANDARD SPECIFICATIONS AND STANDARD DRAWINGS.
 - 2 - ALL CONNECTIONS OF NEW WM TO EXIST. WM AND ALL BLANKINGS OF EXIST. MAINS AND SERVICES SHALL BE PERFORMED BY CITY FORCES. THE CONTRACTOR SHALL PROVIDE EXCAVATION, BACKFILL AND REINSTATEMENT.
 - 3 - RESTRAINING RINGS AND THRUST BLOCKING SHALL BE UTILIZED ON ALL BENDS, TEES AND PLUGS IN ACCORDANCE WITH THE LATEST EDITION OF THE CITY STANDARD SPECIFICATIONS AND STANDARD DRAWINGS. TYPICAL SOIL BEARING CAPACITY RANGES FROM 100 TO 199 kPa.
 - 4 - A MINIMUM 2M SEPARATION IS REQUIRED BETWEEN ALL NEW WATER SERVICES AND CATCHBASINS OR OPEN STRUCTURES AND SHALL BE INSULATED PER CITY SPECIFICATION WSD-23 AS APPLICABLE.
 - 5 - A MINIMUM 2M SEPARATION IS REQUIRED BETWEEN ALL NEW HYDRANTS AND CATCHBASINS OR OPEN STRUCTURES AND SHALL BE INSULATED PER CITY SPECIFICATION WSD-23 AS APPLICABLE.
 - 6 - THE CONTRACTOR SHALL BE RESPONSIBLE TO DETERMINE VIA EXCAVATION THE EXACT LOCATION AND ELEVATION OF THE EXISTING WATERMANS AS REQUIRED FOR ALL CONNECTIONS, RELOCATIONS AND BLANKING.

DWG. FRAME 750mm x 532mm FMOC-06093.WG

STATION	3+350	3+355	3+360	3+370	3+380	3+390	3+400	3+410	3+420	3+430	3+440	3+450	3+460	3+470	3+480	3+490	3+500
Q PROFILE	73.778	73.813	73.849	73.887	73.928	73.971	74.016	74.064	74.114	74.167	74.221	74.274	74.328	74.382	74.424	74.446	
EXISTING SURFACE	73.798	73.812	73.825	73.839	73.852	73.865	73.878	73.891	73.904	73.917	73.930	73.943	73.956	73.969	73.982	73.995	
PROPOSED TOP OF WATERMAIN	71.376	71.407	71.437	71.468	71.498	71.529	71.559	71.589	71.619	71.649	71.679	71.709	71.739	71.769	71.799	71.829	

EARTH EXCAVATION	986 m3
EARTH FILL	150 m3

14012