

Maritime-Ontario
8800 Campeau Drive
Kanata West Business Park
Servicing and Stormwater
Management Report

Prepared For:

Maritime-Ontario Freight Lines Limited

Prepared By:

Robinson Land Development

Project No. 20027
December 2020
Revised August 2021

TABLE OF CONTENTS

LEGAL NOTIFICATION	I
1.0 INTRODUCTION	1
2.0 EXISTING CONDITIONS	1
3.0 DEVELOPMENT PROPOSAL	2
4.0 WATER SERVICING	2
4.1 Boundary Conditions	2
4.2 Fire Protection	2
4.3 Hydraulic Model Results	3
5.0 SANITARY SERVICING	3
5.1 Design Criteria	3
5.2 Proposed Design	4
6.0 STORM SERVICING	4
7.0 STORMWATER MANAGEMENT DESIGN	5
7.1 Design Criteria	5
7.2 Minor System	5
7.3 Release Rates	6
7.4 Major System/ Quantity Control	7
7.5 Infiltration	9
7.6 Hydraulic Grade Line (HGL) Analysis	12
7.7 Quality Control	13
8.0 EROSION AND SEDIMENT CONTROL	13
9.0 CONCLUSIONS	14

LIST OF FIGURES

Figure 1	Key Plan	Following Page 1
Figure 2	General Plan of Services	Following Page 2

LIST OF TABLES

Table 1	Boundary Conditions	Page 2
Table 2	Hydraulic Model Results	Page 3
Table 3	Drainage Area Design Parameters	Page 6
Table 4	Summary of Release Rates	Page 7
Table 5	Summary of 100 Year Storage Volumes	Page 8

LIST OF APPENDICES

Appendix A	Pre-Consultation Notes <i>KWBP Figure 6 – Draft Plan</i> (prepared by IBI Group) <i>KWBP General Plan of Services</i> (prepared by IBI Group) <i>KWBP Campeau Drive from STA 19+780 to STA 20+110</i> (prepared by IBI Group) <i>KWBP Upper Canada Street from Campeau Drive to STA 0+410</i> (prepared by IBI Group)
Appendix B	Site Plan (prepared by McRobie Architects) Servicing Plans (DWG. 20027-S1, S2) Grading Plans (DWG. 20027-GR1, GR2, GR3) Erosion and Sediment Control Plan (DWG. 20027-ESC1) Notes & Details (DWG. 20027-N1) Existing Conditions and Removals Plan (DWG. 20027-R1)

TABLE OF CONTENTS CONTINUED

Appendix C	<i>KWBP Figure 4 – Water Distribution Plan</i> (prepared by IBI Group) Boundary Conditions Boundary Condition Model FUS Long Form Water Model Outputs Watermain Design Sheet
Appendix D	<i>KWBP Figure 5 – Wastewater Plan</i> (prepared by IBI Group) <i>KWBP Sanitary Drainage Area Plan</i> (prepared by IBI Group) <i>KWBP Sanitary Sewer Design Sheet</i> (prepared by IBI Group) Sanitary Sewer Design Sheet
Appendix E	<i>KWBP Storm Sewer Design Sheet</i> (prepared by IBI Group) <i>KWBP Figure 8 – Proposed Storm Sewer Plan</i> (prepared by IBI Group) <i>KWBP Storm Drainage Area Plan</i> (prepared by IBI Group) <i>KWBP Table 4.2 - Drainage Area Parameters</i> (prepared by IBI Group) <i>KWBP SWMHYMO Schematic</i> (prepared by IBI Group) <i>KWBP Table 4.10 – Summary of Hydraulic Grade Line</i> (prepared by IBI Group) <i>Aquafor Beech Report Excerpts</i> Geotechnical Correspondence <i>KWBP Figure 2 – Post-Development SWM Drainage Boundaries Overall Site</i> (prepared by IBI Group)
Appendix F	Storm Sewer Design Sheet Storm Drainage Area Plan (DWG. 20027-STM1) Flow Control Roof Drainage Declaration Roof Flow Correspondence Figure 3 – Roof Drainage Area Plan Infiltration Gallery Storm Sewer Design Sheet Runoff Coefficient Calculations Free Flow Calculations ICD Calculations Storage Volume Tables HGL Computation Sheet

LEGAL NOTIFICATION

This report was prepared by Robinson Land Development for the account of **Maritime-Ontario Freight Lines Limited**.

Any use which a third party makes of this report, or any reliance on or decisions to be made based on it, are the responsibility of such third parties. **Robinson Land Development** accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions based on this project

1.0 INTRODUCTION

Robinson Land Development have been retained by Maritime-Ontario Freight Lines Limited to prepare a servicing and stormwater management design for a proposed development located at 8800 Campeau Drive within the Kanata West Business Park (KWBP). The subject site is proposed to be developed into a distribution warehouse and associated parking lot. The property is located north of Campeau Drive and west of Upper Canada Street (refer to **Figure 1 – Key Plan** following page 1).

The subject site is located within the Phase 5 limits of the KWBP. Servicing and stormwater management requirements for Phase 5 have been updated and outlined in the report titled *Design Brief, Kanata West Business Park – Phase 5, 425 Huntmar Drive*, prepared by IBI Group, dated October 2019 (herein referred to as the *IBI Report*). This report will detail the proposed means of servicing the site and provide details on how to meet the stormwater management requirements outlined in the *IBI Report*.

Pre-consultation notes from the City of Ottawa have been provided in **Appendix A** for reference.

2.0 EXISTING CONDITIONS

The 7.04 hectare subject site is zoned Business Park Industrial Zone (IP13[2166]-h) and is currently undeveloped. The site is bounded by Mineral Extraction Zone (ME) land to the west (existing quarry), Agricultural Zone (AG) land to the north, an undeveloped industrial parcel and Upper Canada Street to the east and Campeau Drive to the south.

The subject site is contained within Block 37, 38 and 39 of the KWBP Master Plan. The KWBP – Phase 5 area includes the construction of Upper Canada Street (from Campeau Drive to Palladium Drive) and the registration of the blocks adjacent to the proposed roadway (i.e. the subject site). As part of the Phase 5 registration, previous Blocks 37, 38 and 39 have been compiled into a single parcel, currently referred to as Block 7 (refer to *Figure 6 – Draft Plan*, prepared by IBI Group, in **Appendix A**).

Municipal infrastructure has been installed within the Campeau Drive right-of-way, adjacent to the subject site, as follows:


- 250 mm diameter watermain
- 250 mm diameter sanitary sewer
- 1050 mm diameter to 1200 mm diameter storm sewers

Municipal infrastructure has been installed within the Upper Canada Street right-of-way, adjacent to the subject site, as follows:

- 250 mm diameter watermain
- 250 mm diameter sanitary sewer
- 1500 mm diameter to 1650 mm diameter storm sewers

Refer to following KWBP – Phase 5 design drawings, prepared by IBI Group, in **Appendix A** for more details:

- *General Plan of Services, Drawing No. 100*
- *Campeau Drive from STA 19+780 to STA 20+110, Drawing No. 101*
- *Upper Canada Street from Campeau Drive to STA 0+410, Drawing No. 109*

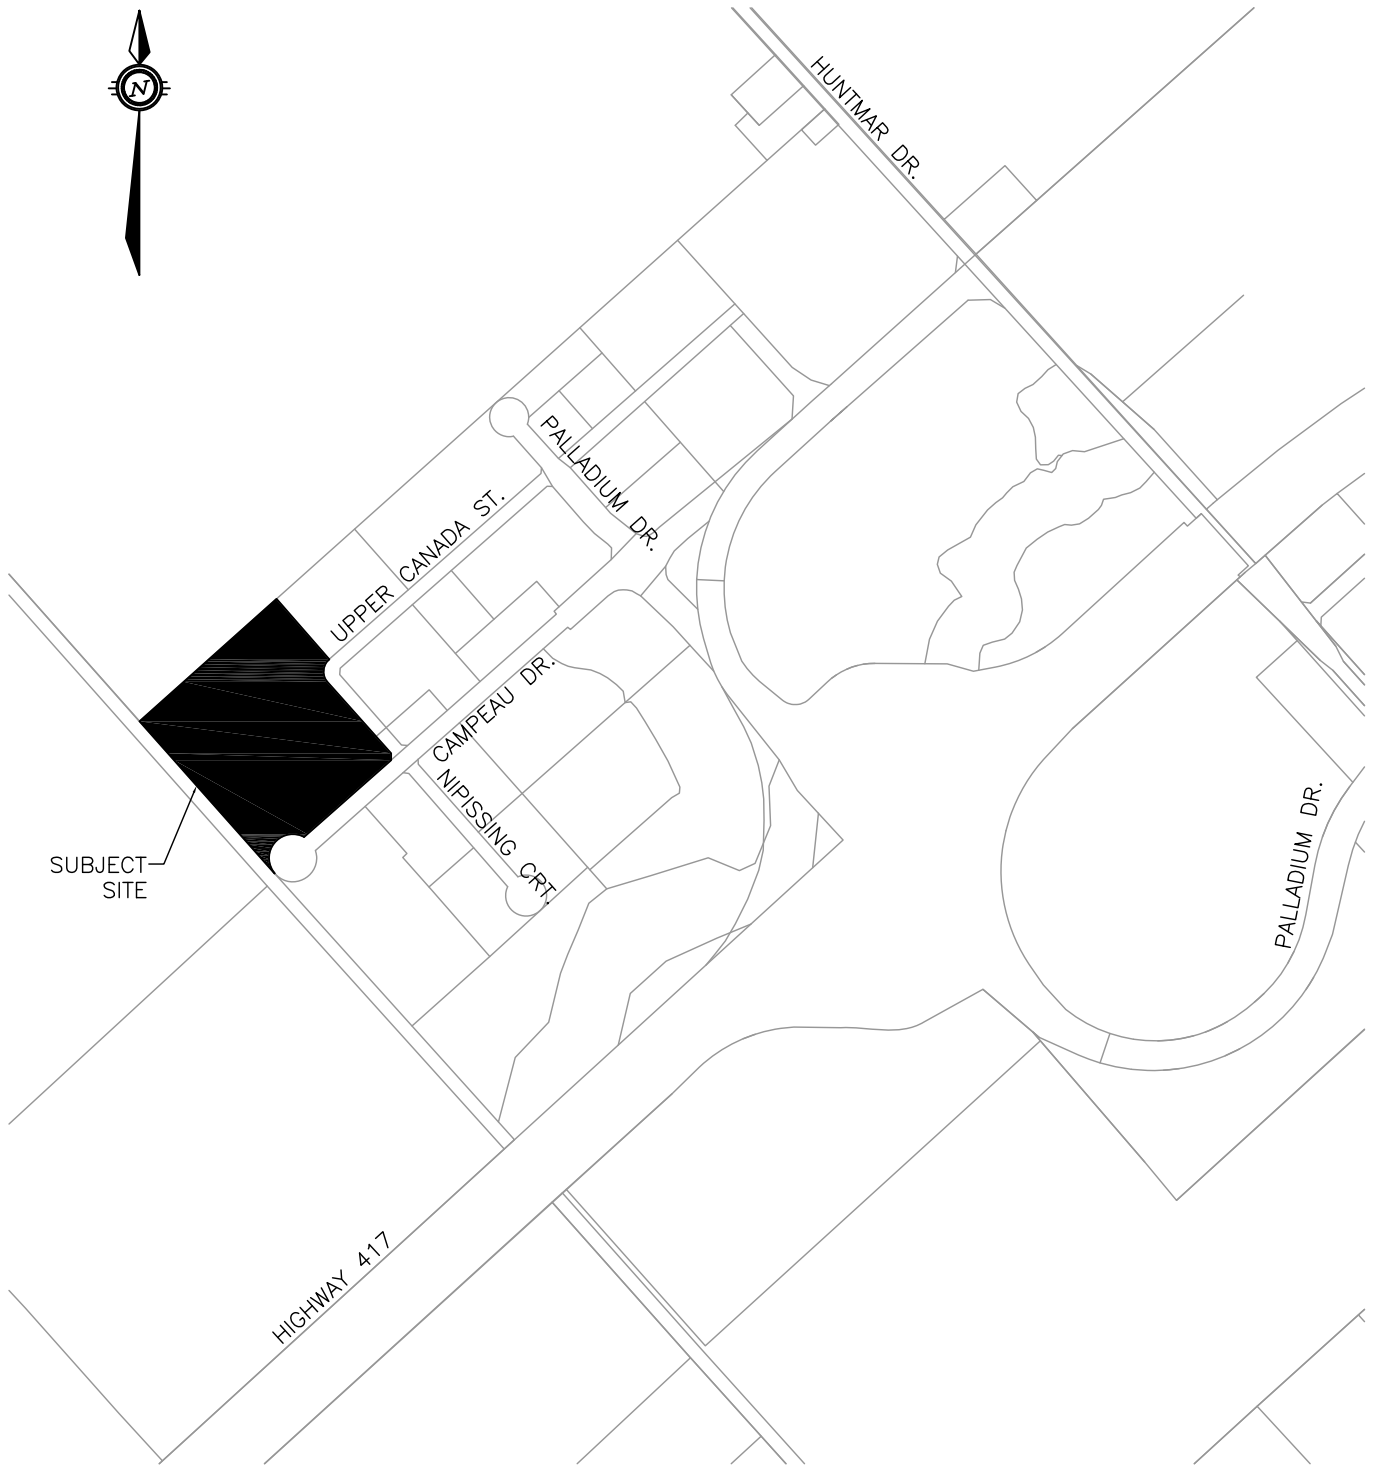

SUBJECT SITE

Robinson
Land Development

scale	N.T.S.	8800 CAMPEAU DRIVE, KWBP	project no.
date	01/11/20		20027
drawn by	BLM	KEY PLAN	FIG 1.0

3.0 DEVELOPMENT PROPOSAL

The Owner is proposing to develop the subject site into a distribution warehouse and associated parking lot. The proposed building will include approximately 60,000 square feet of warehouse space and an additional 18,720 square feet of office space. The proposed parking lot will include an area for 134 office staff parking spaces, accessed via an entrance connection to Campeau Drive. A secondary entrance connection will provide access to the portion of the parking lot designated for 59 'day cab' tractor parking spaces. A third four lane entrance connection will provide access to the warehouse building. Refer to the Site Plan, prepared by McRobie Architects, in **Appendix B** for more details.

The proposed development will be provided with new water and sanitary services and also include a new storm sewer system to control the site's stormwater to the requirements outlined in the *IBI Report* (refer to **Figure 2 – General Plan of Services** following page 2).

4.0 WATER SERVICING

The subject site will receive water supply via a 200 mm diameter watermain connection to the existing 250 mm diameter watermain on Campeau Drive. An existing 250 mm diameter watermain is also available along Upper Canada Street. Refer to *Figure 4 – Proposed Water Distribution Plan*, prepared by IBI Group for Phase 5 of the KWBP in **Appendix C**. In accordance with the *IBI Report* and City of Ottawa design guidelines, the following watermain design criteria have been utilized for the subject site:

- Minimum Pressure During Peak Hour 276 kPa (40 psi)
- Minimum Pressure During Maximum Day Plus Fire 140 kPa (20 psi)
- Maximum Pressure in Unoccupied Areas 689 kPa (100 psi)
- Maximum Pressure in Occupied Areas 552 kPa (80 psi)

4.1 Boundary Conditions



The City of Ottawa provided boundary conditions for the subject site at the proposed connection to the existing 250 mm diameter watermain on Campeau Drive (refer to **Appendix C**). The boundary conditions have been summarized in **Table 1** below:

Table 1 – Boundary Conditions

Demand Scenario	Head (m)	Pressure (psi)
Maximum HGL	161.4	80.2
Peak Hour	156.3	72.9
Max Day Plus Fire	122.6	25.1

4.2 Fire Protection

Two existing hydrants are available on the north-west side of Campeau Drive across the frontage of the subject site. The existing hydrant located approximately 50 metres south-west of Upper Canada Street will be required to be relocated as part of the proposed development works as the hydrant is in conflict with the proposed entrance connection to Campeau Drive. Two existing hydrants are also available on the north-east side of Upper Canada Street, adjacent to the eastern property boundary of the site.

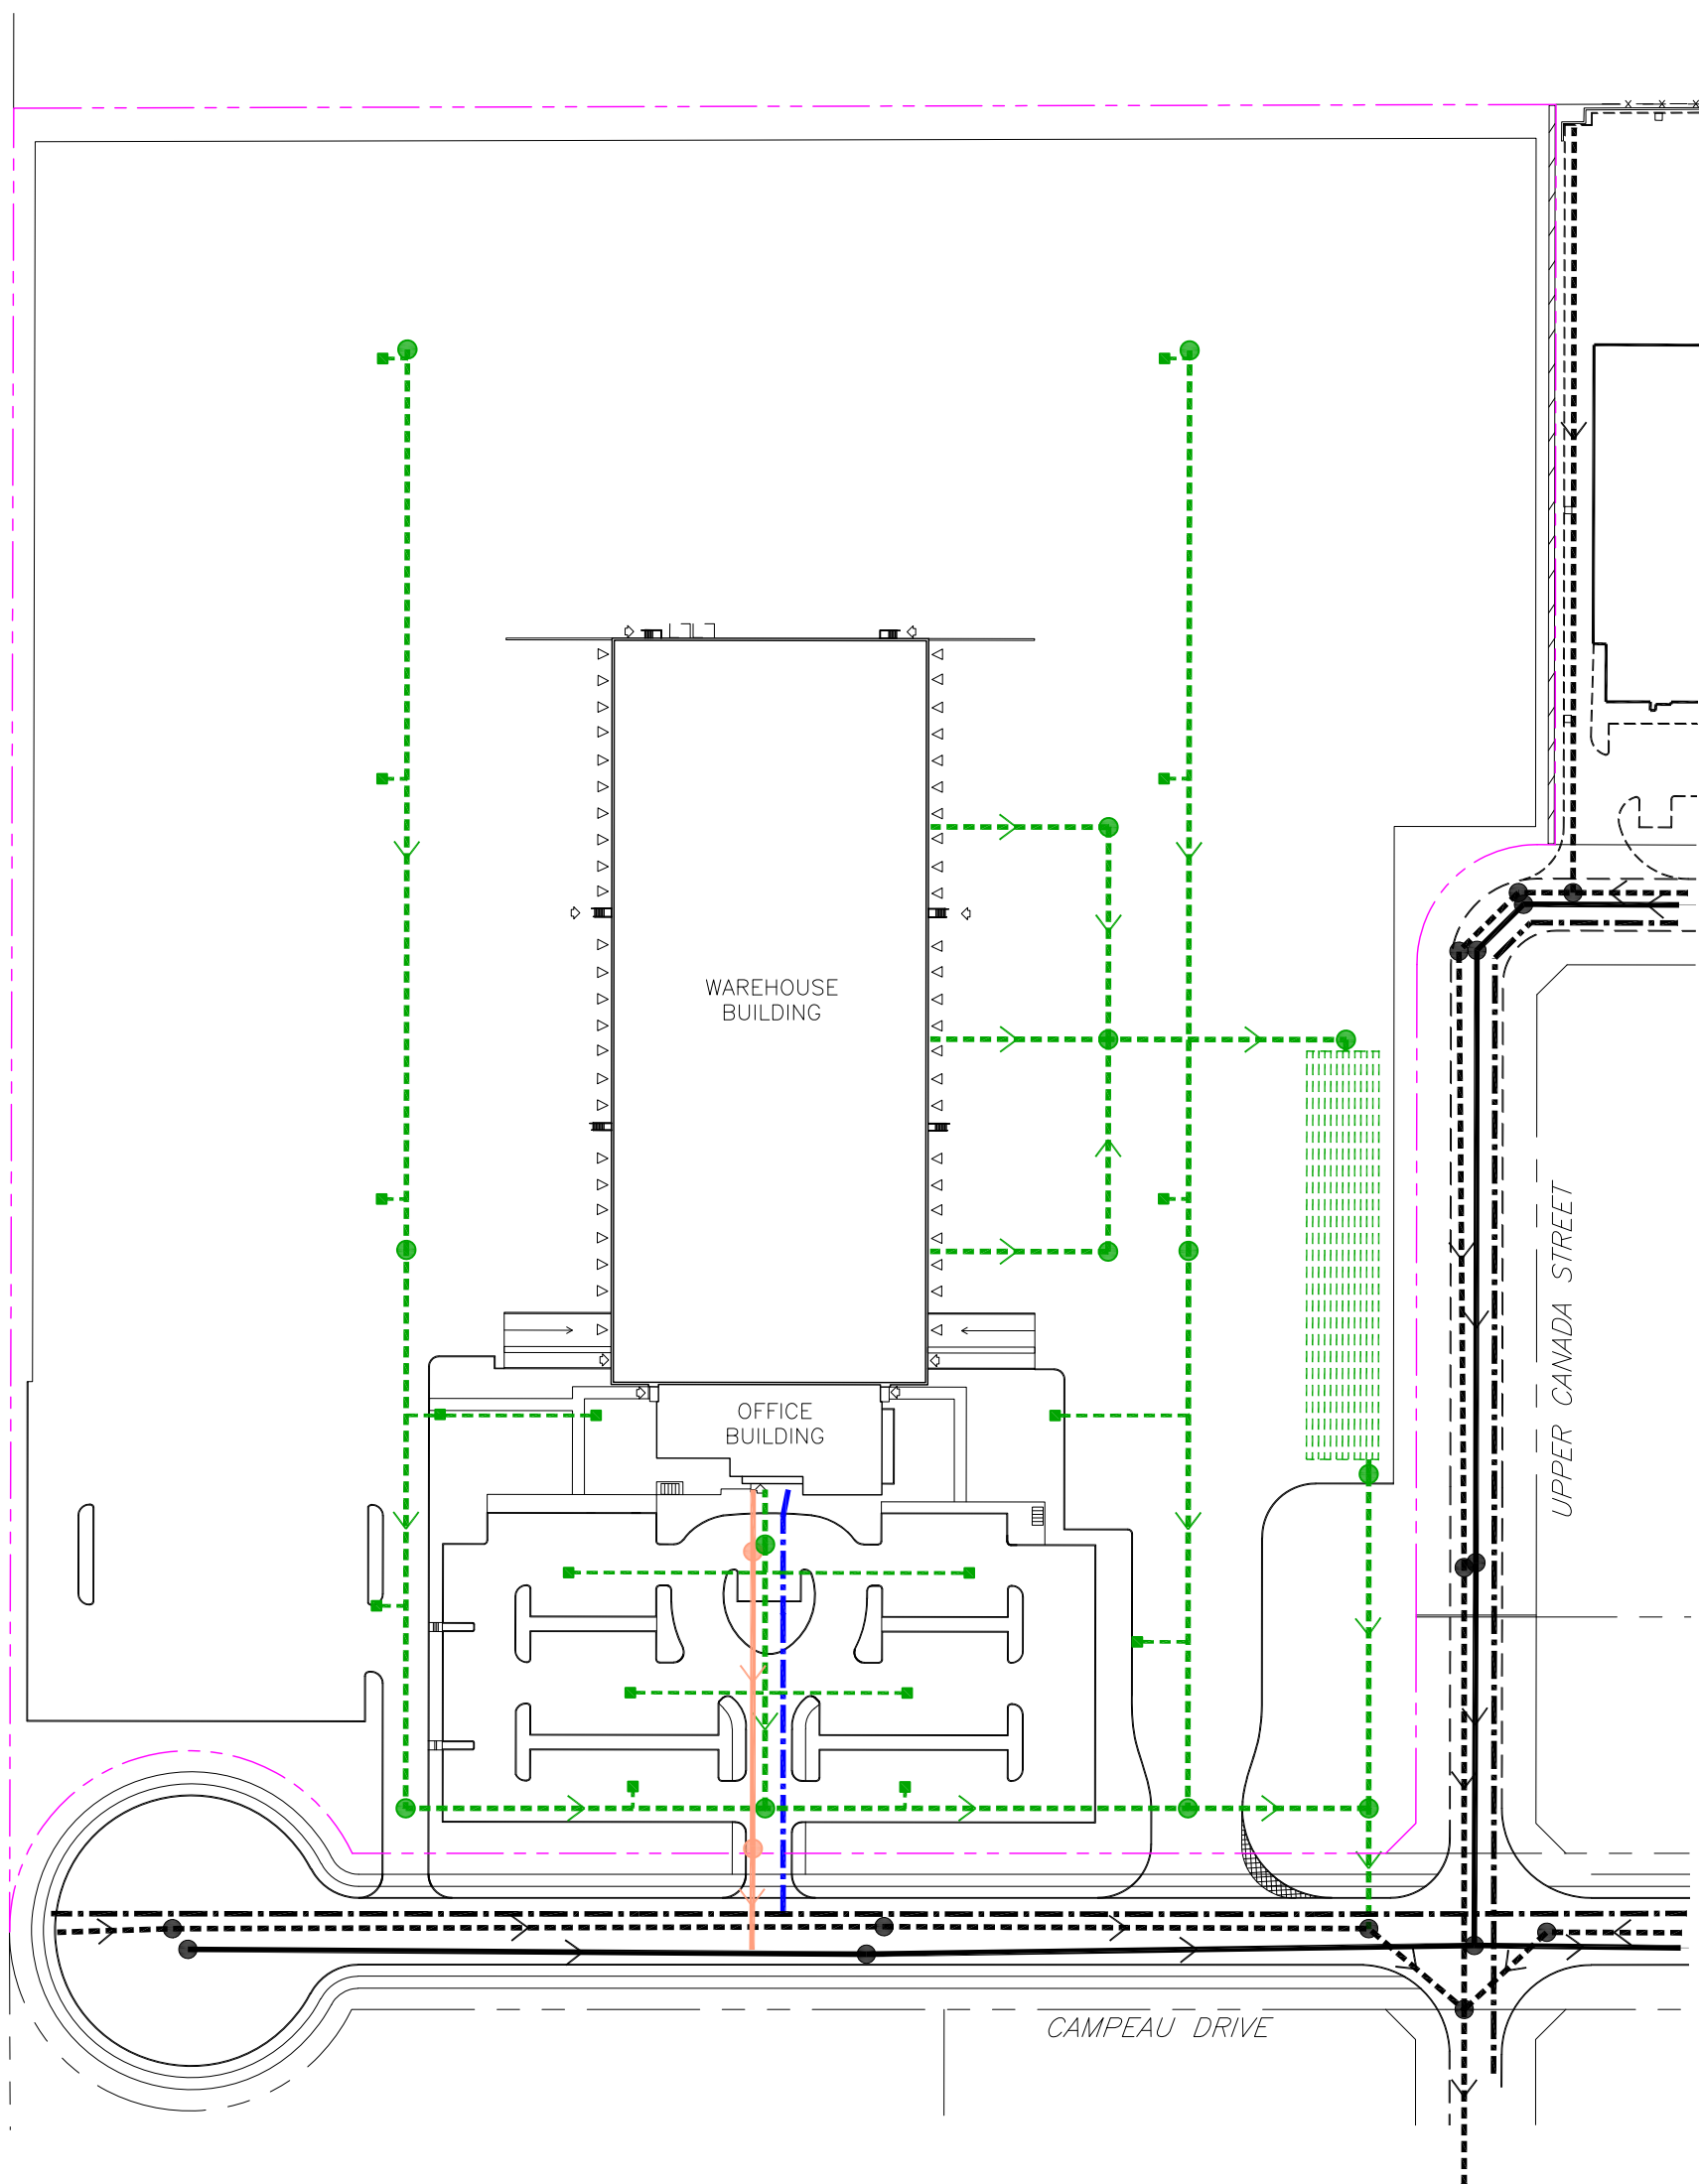

LEGEND

- - - - - PROPERTY BOUNDARY
- - - - - PROPOSED STORM SYSTEM
- — — — — PROPOSED SANITARY SYSTEM
- - - - - PROPOSED WATER SYSTEM
- - - - - EXISTING STORM SYSTEM
- — — — — EXISTING SANITARY SYSTEM
- - - - - EXISTING WATER SYSTEM

<h2 style="margin: 0;">Robinson</h2> <h3 style="margin: 0;">Land Development</h3>		
scale N.T.S.	MARITIME—ONTARIO, KWBP	project no. 20027
date 27/05/21	GENERAL PLAN OF SERVICES	
drawn by BLM	FIG 2	

Fire protection for the subject site will be provided by a proposed on-site hydrant which will receive water supply via the proposed 200 mm diameter watermain connection to the existing 250 mm diameter watermain on Campeau Drive. The proposed hydrant will be located within a landscaped island to the front of the main entrance, within 45 metres of the proposed siamese connection for the building.

The required fire flow for the subject site was calculated using the Fire Underwriter's Survey (FUS) long form (refer to **Appendix C**). Based on the building construction, occupancy and ground floor area, the required fire flow is 8,000 Lpm (133 L/s).

4.3 Hydraulic Model Results

The hydraulic model results for Maximum HGL, Peak Hour and Maximum Day + FF have been calculated and summarized in **Table 2** below.

Table 2 – Hydraulic Model Results

Criteria	Boundary Conditions – Head (m)	Modelling Results (psi or Lpm)	Allowable Pressure Range
Peak Hour	156.3	68.5	40 – 80 psi
Max Pressure	161.4	75.8	< 80 psi
Max Day + Fire	122.6	11,556	@ 20 psi

As indicated in **Table 2** above, it has been demonstrated that the subject site can be adequately serviced for both domestic and fire flow demands. Refer to the hydraulic model outputs provided in **Appendix C**.

As noted in *Section 2.4* of the *IBI Report*, pressure reducing valves will be required for all buildings located in Phase 5 of the KWBP since the calculated pressures were expected to be greater than 80 psi (552 kPa). However, as indicated in **Table 2** above, the modelled maximum pressure condition for the subject site has been calculated to be 75.8 psi and therefore a pressure reducing valve (PRV) will not be required.

5.0 SANITARY SERVICING

5.1 Design Criteria

Sanitary flows from the KWBP are conveyed east via the Campeau Drive sanitary sewer system before ultimately being conveyed to the Signature Ridge Pump Station (SRPS) north of Highway 417. Refer to *Figure 5 – Wastewater Plan*, prepared by IBI Group, in **Appendix D**. The municipal sanitary sewer system for Phase 5 of the KWBP has been designed (by IBI Group) based on recommendations from the following reports:

- Kanata West Master Servicing Study (KWMSS), 2006
- City of Ottawa Sewer Design Guidelines, 2012
- Ministry of the Environment Design Guidelines for Sewage Works, 2008
- City of Ottawa Technical Bulletin ISTB-2018-01

The subject site (i.e. Block 7) has been identified as light industrial land use on the *Sanitary Drainage Area Plan*, prepared by IBI Group for the KWBP, provided in **Appendix D**. In keeping with the sanitary sewer design criteria outlined in *Section 3.3* of the *IBI Report*, the following design parameters have been implemented for the subject site:

- Light Industrial Flow: 28,000 L/ha/d

- Peaking Factor: 4.5 (MOE Chart – City of Ottawa Appendix 4-B.1)
- Infiltration Allowance: 0.33 L/s/ha
- Minimum Velocity: 0.60 m/s
- Maximum Velocity: 3.0 m/s

As noted in the *IBI Report*, the Phase 5 lands have been designed to outlet to the existing 300 mm diameter sanitary sewer on Campeau Drive, west of the Palladium Drive roundabout. The sanitary flows to be generated from Block 7 (formerly Block 37, 38, 39) have been allocated within pipe run MH151A to MH150A on Upper Canada Street as noted on the *Sanitary Sewer Design Sheet*, prepared by IBI Group, provided in **Appendix D**.

5.2 Proposed Design

The *IBI Report* has allocated sanitary flows from the subject site within the 250 mm diameter sanitary sewer on Upper Canada Street, however, it is proposed to outlet sanitary flows to the existing 250 mm diameter sanitary sewer on Campeau Drive for the following reasons:

- The orientation of the proposed building and site layout (i.e. main building entrance facing Campeau Drive and entrance connections via Campeau Drive) facilitate a straight-line connection from the building mechanical room to the existing sewer on Campeau Drive.
- In order to maintain a common sewer trench (water, sanitary and storm) and single road cut (for water and sanitary connections), the proposed sanitary sewer outlet must also be to Campeau Drive.

Sanitary flows generated from the subject site will be conveyed by a proposed 200 mm diameter sanitary sewer system to the existing 250 mm diameter sanitary sewer on Campeau Drive (between EXMH99A and EXMH100A). Using the parameters noted above, the peak sanitary design flow for the site has been calculated to be 12.59 L/s. The existing pipe runs on Campeau Drive, EX99A to EX100A and EX100A to EX101A, will have 31.82 L/s and 42.38 L/s of excess capacity respectively after the addition of 12.59 L/s of sanitary flow from the subject site. Therefore, the existing 250 mm diameter sanitary sewer on Campeau Drive (upstream of Upper Canada Street) will have adequate capacity to convey the peak sanitary design flows from the subject site. The proposed sanitary sewers have been designed in accordance with current City of Ottawa standards and in keeping with the design criteria outlined in the *IBI Report*. Refer to the sanitary sewer design sheet in **Appendix D** for more details.

6.0 STORM SERVICING

Storm drainage from the subject site (i.e. Block 37, 38, 39) has been allocated within the existing 1200 mm diameter storm sewer on Campeau Drive, downstream of EXMH101, as indicated on the *storm sewer design sheet*, prepared by IBI Group, provided in **Appendix E**. The existing 1200 mm diameter storm sewer on Campeau Drive conveys stormwater south on Nipissing Court, before being conveyed to the Pond 6 West Facility and ultimately discharging into Feedmill Creek. Refer to *Figure 8 – Proposed Storm Sewer Plan*, prepared by IBI Group, in **Appendix E**. Stormwater runoff from the subject site will be captured by surface inlet grates and conveyed via the proposed on-site storm sewer system to EXMH101 on Campeau Drive. The on-site storm sewers range from 250 mm to 900 mm in diameter and have been designed to convey the full 5 year peak flow and be within the acceptable full flow velocity range of 0.80 m/s to 3.0 m/s in accordance with City of Ottawa standards and the *IBI Report*. Refer to the storm sewer design sheet and Storm Drainage Area Plan (DWG. 20027-STM1) in **Appendix F** for more details.

A secondary storm sewer system is proposed to convey drainage from the roof area to a proposed infiltration gallery (refer to **Section 7.5 - Infiltration**) located within the parking lot. The secondary storm sewer system has been designed to have capacity to convey the roof flows provided by the Mechanical Engineer (refer to roof flow correspondence in **Appendix F**). In the event that infiltration into the surrounding soil is not being achieved (i.e. fine sediment accumulation or abnormally high groundwater table), stormwater would bypass through the infiltration gallery via the proposed storm pipes and outlet to the storm sewer system at downstream STMMH 200 without impacting any on-site infrastructure. In the event of a blockage within the infiltration gallery, a 375 mm diameter overflow/ bypass pipe has also been provided above the top of the storage media. The overflow/ bypass pipe has been designed to have capacity to convey the fixed flow from the roof area and would convey drainage directly from STMMH 303 to STMMH 304 if a blockage were to occur. The proposed 900 mm diameter storm sewer downstream of STMMH 200 has been designed to have capacity to convey the full 5 year peak storm from the roof area, however, full to partial infiltration is expected to occur. Refer to **Figure 3 – Roof Drainage Area Plan** and the infiltration gallery storm sewer design sheet in **Appendix F** for more details.

7.0 STORMWATER MANAGEMENT DESIGN

7.1 Design Criteria

A dual drainage design, minor and major system, has been utilized for the KWBP. The *IBI Report* provides updated stormwater management design criteria for the Phase 5 portion of the development. The design criteria were prepared in accordance with current City of Ottawa Design Guidelines and with the following overarching reports prepared for the KWBP:

- Kanata West Master Servicing Study (KWMSS), prepared by Stantec and CCI/IBI Group, dated 2006.
- Kanata West Business Park Stormwater Management Report and Pond 6 West Design Brief, prepared by IBI Group, dated November 2015.
- Addendum Report: Kanata West Business Park Stormwater Management Report and Pond 6 East Design Brief, prepared by IBI Group, dated November 2015.

7.2 Minor System

Stormwater runoff from the subject site, which is captured by the proposed on-site storm sewer system, will be conveyed to EXMH101 on Campeau Drive. The minor system design of the KWBP conveys the drainage south via the existing storm sewer system on Nipissing Court, to the Pond 6 West Facility and ultimately to Feedmill Creek. The minor system capture for the proposed blocks tributary to the Pond 6 West Facility is based on the 5 year, 3 hour Chicago simulated flow in accordance with the overarching reports for the KWBP. The subject site (denoted as Area 101A on the *Storm Drainage Area Plan*, prepared by IBI Group, provided in **Appendix E**) has been allocated the following minor system design parameters:

Table 3 – Drainage Area Design Parameters

Area ID	Area (ha)	Minor System Capture (L/s)	Required Storage Volume (m ³)
101A	7.03	1230	780

Notes:

1. Subject site is denoted as Area 101A on the *Storm Drainage Area Plan*, prepared by IBI Group, in **Appendix E**.
2. Parameters as per *Table 4.2* of the *IBI Report*, provided in **Appendix E**.

In accordance with the design criteria outlined in the *IBI Report*, the minor system from the subject site must be restricted to a rate of 1230 L/s for all events up to and including the 100 design storm. In order to control the site’s runoff to less than the allowable release rate of 1230 L/s, inlet control devices (ICDs) are proposed to be installed within the outlets of the on-site catch basins. Refer to **Section 7.3 – Release Rates** for more details.

7.3 Release Rates

As noted above, runoff from the subject site must be controlled to a rate of 1230 L/s for all storm events up to and including the 100 year design storm in accordance with the *IBI Report*. In order to control the site’s runoff, inlet control devices (ICDs) are proposed to be installed within the outlets of the on-site catch basins. The ICDs have been sized based on the 100 year head (measured from the 100 year ponding elevation to the centreline of orifice elevation) and an allowable outflow. Refer to the ICD calculations in **Appendix F** for more details.

Drainage from the roof areas will be collected by multiple roof drains and conveyed by the internal building plumbing to the secondary storm sewer system (refer to **Section 6.0 – Storm Servicing**) to the proposed infiltration gallery (refer to **Section 7.5 – Infiltration**) located in the parking lot area. The mechanical design has utilized a conventional drained roof with no flow controls, therefore, the building roofs have been analyzed as free flow areas. Refer to the Flow Control Roof Drainage Declaration in **Appendix F**.

Areas of the subject site which cannot be captured by the on-site storm sewer system will flow “uncontrolled” off-site during storm events. Drainage will be conveyed “uncontrolled” to Campeau Drive, Upper Canada Street, to the north and to the west. These free flow areas must be accounted for in the overall release rate for the site. Select drainage areas must be “overcontrolled” in order to compensate for the “uncontrolled” areas. As a result, surface ponding will occur during the 2 year design event for some drainage areas. The areas where 2 year surface ponding will occur have been limited to areas subject transport truck traffic. A summary of the on-site release rates for the 100 year design event has been provided in **Table 4** below:

Table 4 – Summary of Release Rates

Drainage Area	100 Year Release Rate (L/s)
STM1	120.0
STM2	60.0
STM3	80.0
STM4	60.0
STM5	120.0
STM6	60.0
STM7	30.0
STM8	25.0
STM9	55.0
STM10	30.0
STM11	25.0
STM12	40.0
STM13	30.0
STM14	25.0
STM15 + STM16	20.0
STM17	20.0
STM18 (ROOF 1)	28.2 ^{*1}
STM19 (ROOF 2)	325.3 ^{*1}
FF1 (CAMPEAU)	23.2
FF2 (UPPER CANADA)	16.4
FF3 (NORTH)	17.7
FF4 (WEST)	14.7
Total =	1225.5
Allowable^{*2} =	1230.0
Δ =	4.5

Notes:

1. Roof areas are assumed to be free flow.
2. Allowable release rate as per *IBI Report*.

As noted in **Table 4** above, the 100 year outflow from the subject site of 1225.5 L/s is less than the allowable rate of 1230 L/s and therefore has been designed in keeping with the *IBI Report*.

7.4 Major System/ Quantity Control

Overland flow from the majority of the KWBP is conveyed from west to east, ultimately to Huntmar Drive (refer to the *SWMHYMO Schematic*, prepared by IBI Group, in **Appendix E**). For the subject site (drainage area 101A), overland flow from the individual on-site ponding areas will cascade south-east, via the parking lot and entrance connections, to Campeau Drive and ultimately to Huntmar Drive. The on-site major system has been designed to pond stormwater to a maximum depth of 0.30 metres before “overtopping” in accordance with City

of Ottawa design standards. A minimum freeboard of 0.30 metres has been provided between the spillover elevations and the adjacent building finished floor elevation.

In accordance with the *IBI Report*, individual blocks within the KWBP are to provide on-site quantity storage control for up to and including the 100 year design storm event (in excess of the allowable release rate of 1230 L/s for the subject site). The *IBI Report* has allocated a required storage volume of 780 m³ for the subject site (refer to **Table 3** above). Required storage volumes have been calculated for each individual drainage area based on the allowable release rates noted in **Table 4** above. A summary of the required and provided 100 year storage volumes for the on-site drainage areas have been provided in **Table 5** below.

Table 5 – Summary of 100 Year Storage Volumes

Drainage Area	100 Year Required Storage Volume (m ³)	100 Year Provided Storage Volume (m ³)
STM1	216.2	232.6
STM2	182.7	200.8
STM3	172.5	184.7
STM4	104.8	109.4
STM5	241.9	243.6
STM6	180.0	180.2
STM7	198.3	200.5
STM8	79.6	86.7
STM9	2.8	3.7
STM10	15.7	16.6
STM11	15.1	15.7
STM12	4.3	4.6
STM13	15.7	16.6
STM14	13.4	15.7
STM15 + STM16	0.0 ^{*4}	0.0 ^{*4}
STM17	0.0 ^{*4}	0.0 ^{*4}
STM17 (ROOF 1)	0.0	0.0
STM18 (ROOF 2)	0.0	0.0
FF1 (CAMPEAU)	0.0	0.0
FF2 (UPPER CANADA)	0.0	0.0
FF3 (EAST)	0.0	0.0
FF4 (NORTH)	0.0	0.0
FF5 (WEST)	0.0	0.0
Total =	780.0^{*1}	1511.4

Notes:

1. Required storage volume of 780 m³ as per *IBI Report*.
2. Provide storage volumes calculated using Civil3D by Autodesk.
3. Provided storage volumes include surface storage only (i.e. no pipe storage).
4. Areas experience no surface ponding during the 100 year event, therefore, no provided surface storage has been considered although surface storage is available.

As noted in **Table 5** above, adequate on-site quantity control has been provided for all storm events up to and including the 100 year design storm in keeping with the *IBI Report*. Refer to the storage volume tables provided in **Appendix F** for more details. The outflows from the drainage areas within the landscape areas (STM15, STM16, STM17) have been optimized to eliminate surface ponding for all storm events up to and including the 100 year design storm. Although surface storage will not be required for these drainage areas (for events up to and including the 100 year design storm), quantity storage volume is available as noted on the storage volume tables provided in **Appendix F**.

7.5 Infiltration

The Carp River Watershed/Subwatershed Study (CRWS) provided water balance calculations and outlined infiltration targets within the subwatershed area from the stormwater management perspective, based on soil characteristics. Following the CRWS, infiltration targets for the Kanata West development were established within the KWMSS. That study indicated that a range of 70 to 100 mm/year of runoff be infiltrated from the western portion of the KWBP site. The KWMSS also indicated that post development infiltration rates are to be increased by 25% above these pre-development rates to compensate for areas (i.e. roadway corridors) that cannot provide infiltration. In keeping with the *IBI Report* and overarching reports for the KWBP, each block will be required to provide engineered infiltration measures (such as infiltration galleries fed by roof drains) to achieve the required infiltration rates as outlined within the KWMSS. For the subject site, a target infiltration range of 87.5 mm/year to 125 mm/year is required (i.e. 70 to 100 mm/year + 25%).

Drainage from the roof areas will be captured by multiple roof drains (designed by Mechanical Engineer with no flow controls, refer to Flow Control Roof Drainage Declaration in **Appendix E**) and conveyed via the secondary storm sewer system to a proposed infiltration gallery located within the parking lot. The proposed infiltration gallery has been designed using guidelines from the *Low Impact Development Stormwater Management Planning and Design Guide* (herein referred to as the *LID Manual*). The proposed infiltration gallery has also been sized to have capacity to detain roof drainage for the 95th percentile storm event for the Ottawa area. Rainfall data has been referenced from the report titled *Runoff Volume Control Targets for Ontario Final Report*, prepared by Aquafor Beech Ltd. and Earthfx Inc. for the Ministry of the Environment & Climate Change (currently known as the Ministry of the Environment, Conservation and Parks), dated October 2016 (herein referred to as the *Aquafor Beech Report*).

Required Storage Volume:

95th Percentile Daily Volume = 0.0279 m (Aquafor Beech Report Table 3.16, **Appendix E**)

Roof Area = 7,126.82 m²

Required Storage Volume = (0.0279 m) x (7,126.82 m²) = **198.84 m³**

Provided Storage Volume:

Infiltration Gallery Bottom Area = 897.0 m² (69.0 m length x 13.0 m width)

Infiltration Gallery Depth = 0.60 m (measured from header invert to gallery bottom)

Infiltration Gallery Storage Media Porosity = 0.40 (50 mm diameter clear stone)

Provided Storage Volume = (897.0 m²) x (0.6 m) x (0.40) = **215.3 m³**

As calculated above, the proposed infiltration gallery has been designed to provide 215.3 m³ of storage volume which is greater than the 95th percentile daily rainfall volume for the Ottawa area.

Infiltration Target:

Target Infiltration Rate = 87.5 mm/yr to 125 mm/yr

Average Annual Precipitation = 0.925 to 0.950 m (Aquafor Beech Report Figure 3.41, **Appendix E**)

Roof Area = 7,126.82 m²

Site Area = 70,353.28 m²

Maximum Average Annual Precipitation = (0.95 m) x (7,126.82 m²) = 6,770.48 m³

Maximum Average Site Infiltration Rate = (6,770.48 m³) / (70,353.28 m²) x 1000 = 96.2 mm/yr

Maximum Effective Site Infiltration Rate = (96.2 mm/yr) x (0.95) = **91.39 mm/yr**

Minimum Average Annual Precipitation = (0.925 m) x (7,126.82 m²) = 6,592.31 m³

Minimum Average Site Infiltration Rate = (6,592.31 m³) / (70,353.28 m²) x 1000 = 93.70 mm/yr

Minimum Effective Site Infiltration Rate = (93.70 mm/yr) x (0.95) = **89.02 mm/yr**

Based on precipitation data from the *Aquafor Beech Report* and site parameters (i.e. total site and roof areas), the minimum effective site infiltration rate has been calculated to be 89.02 mm/year which is within the acceptable range outlined in the *IBI Report* and overarching studies for the area. It should be noted that the infiltration rate calculations for the subject site only consider roof drainage (in keeping with the *IBI Report*) and do not account for the approximately 0.85 hectares of pervious area where natural infiltration of runoff at source will occur.

Section 4.4 of the *LID Manual* states that the maximum allowable depth of a stone reservoir can be calculated using the following equation:

$$d_{\max} = i * t / V_r$$

where:

d_{\max} = maximum stone reservoir depth (mm)

i = infiltration rate for native soils (mm/hr)

V_r = void ratio (0.4 for clear stone)

t = time to drain (48 hrs recommended)

Based on the findings of the Geotechnical Investigation prepared by Paterson Group (Table 6 – Estimated Percolation Rates), the native soil percolation time (T) for the subject site has been field verified to be 6 to 10 mins/cm. Refer to relevant percolation rate and borehole information provided in **Appendix E**. The infiltration rate can then be calculated as the inverse of the percolation time (i.e. infiltration rate = 1/T).

6 mins/cm x (1/ 60 mins/hr) x (1/ 10 mm/cm) = 0.01 hr/mm

10 mins/cm x (1/ 60 mins/hr) x (1/ 10 mm/cm) = 0.017 hr/mm

Infiltration Rate_{max} = 1 / 0.01 = 100 mm/hr

Infiltration Rate_{min} = 1 / 0.017 = 60 mm/hr

Infiltration Rate_{avg} = 80 mm/hr

To account for potential reductions in soil permeability a safety correction factor must be incorporated to determine the design infiltration rate to be used in calculations. Since the soil profile is continuous at the location of the proposed infiltration gallery, a safety correction factor of 2.5 is applicable (source: wiki.sustainabletechnologies.ca/infiltration).

$$\text{Design Infiltration Rate} = 80 / 2.5 = \mathbf{32 \text{ mm/hr}}$$

$$d_{\text{max}} = (32 \text{ mm/hr}) \times (48 \text{ hrs}) / 0.40 = 3840 \text{ mm} = \mathbf{3.84 \text{ m}}$$

The proposed infiltration gallery depth of 0.6 m is less than the maximum allowable depth of 3.84 m calculated using the equation from the *LID Manual*. For applications with an underdrain, the maximum depth is measured below the invert of the underdrain pipe.

Section 4.4 of the *LID Manual* also states that the required footprint surface area of a stone reservoir can be calculated using the following equation:

$$A_f = \text{WQV} / (d * V_r)$$

where:

A_f = footprint surface area (m^2)

WQV = water quality volume (m^3)

d = stone reservoir depth (m)

V_r = void ratio (0.40 for clear stone)

$$A = (198.84 \text{ m}^3) / (0.6 \text{ m} \times 0.40) = \mathbf{828.5 \text{ m}^2}$$

The proposed infiltration gallery footprint area of 897.0 m^2 is more than the required footprint area of 828.5 m^2 calculated using the equation from the *LID Manual*. To be conservative, infiltration through the gallery bottom has only been considered, however, lateral infiltration through the sides is expected to occur. Based on the calculations above, it can be concluded that the infiltration gallery has been designed in accordance with the *LID Manual* for depth and footprint area.

Groundwater:

For optimal performance of infiltration practices, a minimum separation of 1.0 metre between the bottom of the infiltration facility and the seasonal high groundwater table is desired. As detailed in the Geotechnical Investigation and Geotechnical Response to City Comments Memorandums (prepared by Paterson Group and provided in **Appendix E**), the groundwater levels were measured periodically throughout spring months at the on-site monitoring well constructed at BH 1-21 as well as within the piezometers installed in the other on-site boreholes. The seasonally high groundwater was generally encountered at elevations ranging from 105.20 to 106.00 m. It is anticipated that the elevated groundwater levels observed within the boreholes have been influenced by surface water collected within the adjacent drainage ditch which runs along the western limit of the subject site. Based on the observed colour and consistency of the recovered soil samples, the long-term groundwater table is anticipated to be located at an approximate elevation of 104.00 to 104.50 m. However, it is expected that hardscaping and development of the subject will result in further lowering of the groundwater table. The introduction of hardscaping will limit the amount of surface water contributing to the current elevated groundwater level and the presence of granular bedding below the proposed service pipes will provide an outlet for perched water. The seasonally high and long-term groundwater elevations are expected to be lowered to at or near the lowest service pipe invert

elevations (approximately 102.00 m). This groundwater lowering condition has been observed at several developed blocks within the KWBP in areas of similar soil conditions. The bottom of the proposed infiltration facility is set at an elevation of 103.54 m, which is greater than 1.0 metre from the expected lowered seasonally high groundwater elevation of 102.00 m (refer to Geotechnical Response to City Comments Memorandums in **Appendix E**). Therefore, sufficient separation between the bottom of the storage media and the groundwater table will be provided in keeping with current infiltration design standards. It should be noted that the function of an infiltration gallery may be limited during seasonal high groundwater conditions, however, the infiltration practice is still feasible during the remainder of the year when groundwater levels are lower.

Overflow/ Bypass

In the event that infiltration into the surrounding soil is not being achieved (i.e. fine sediment accumulation or abnormally high groundwater table), stormwater would bypass through the infiltration gallery via the proposed storm pipes and outlet to the storm sewer system at downstream STMMH 200 without impacting any on-site infrastructure. In the event of a blockage within the infiltration gallery, a 375 mm diameter overflow/ bypass pipe has been provided above the top of the storage media. The overflow/ bypass pipe has also been designed to have capacity to convey the fixed flow from the roof area and would convey drainage directly from STMMH 303 to STMMH 304 if a blockage were to occur (refer to the infiltration gallery storm sewer design sheet in **Appendix F**). As previously noted in **Section 6.0**, the storm sewer downstream of STMMH 200 has been designed to have capacity to convey the full 5 year peak flow from the roof area in the event that an overflow does occur.

Bedrock

Based on the available geological mapping, bedrock is expected at a depth of 5 m to 15 m below the existing ground surface. In addition, practical refusal to dynamic cone penetration testing was encountered in boreholes BH 2-21 and BH 1 (2014) at geodetic elevations of 98.46 and 97.38 m, respectively. Given that the bottom of the proposed infiltration facility is set at an elevation of 103.54 m, over 1.0 metre separation to bedrock will be provided in accordance with design standards. Refer to Geotechnical Response to City Comments Memorandum in **Appendix E**.

The overall design of the infiltration gallery as it relates to the design infiltration rate, factor of safety and site constraints should be reviewed by the Geotechnical Consultant prior to construction.

7.6 Hydraulic Grade Line (HGL) Analysis

As noted in *Section 4.6* of the *IBI Report*, the hydraulic grade line (HGL) within the storm sewers of the KWBP is dictated by water levels in Feedmill Creek and water levels in the Pond 6 West and Pond 6 East facilities. A summary of the 100 year HGL analysis for the KWBP – Phase 5 has been provided in *Table 4.10* of the *IBI Report* (refer to **Appendix E**). Due to the permanent water level within the Pond 6 West and Pond 6 East Facilities, some of the storm sewers within the KWBP will be partially submerged, which includes the outlet for the subject site (i.e. existing storm sewer on Campeau Drive downstream of EXMH101). To account for this, the *IBI Report* has analysed the submerged sewers within the KWBP system with a 25% sediment accumulation. Refer to *Section 4.6.3* of the *IBI Report* for more details.

An HGL analysis has been prepared for the proposed on-site storm sewer system based on a connection to EXMH101 on Campeau Drive at a 100 year HGL elevation of 103.57 m (modelled by IBI Group using 100 year 12 hour SCS storm event). The HGL analysis determined that the HGL would remain below the top of grate/cover elevations of the on-site

storm manholes and catch basins. The HGL will be contained within the storm sewer between STMMH 208 to STMMH 201 and therefore is not of concern for the proposed building service connection. The overflow outlet from the infiltration gallery, downstream of STMMH 304, will connect to STMMH 200 above the HGL elevation and therefore is not expected to impact the performance of the infiltration practices. Refer to the HGL computation sheet in **Appendix F** for more details.

In the event that the on-site storm sewers are surcharged, stormwater runoff will be conveyed to a proper outlet (i.e. Campeau Drive right-of-way) via the major overland flow route (refer to **Section 7.4**) without impacting the on-site building or neighbouring properties.

7.7 Quality Control

The Pond 6 West Facility is located at the western edge of the KWBP, north of Feedmill Creek. The facility provides water quality (and quantity) control for the development west of Palladium Drive (refer to *Figure 2 – Post-Development SWM Drainage Boundaries Overall Site*, prepared by IBI Group, in **Appendix E**). The facility discharges to Feedmill Creek in accordance with the *Kanata West Business Park Stormwater Management Report and Pond 6 West Design Brief*, prepared by IBI Group. Additional on-site quality control is not required for the subject site as the minor storm system is tributary to the Pond 6 West Facility.

8.0 EROSION AND SEDIMENT CONTROL

Prior to construction and until vegetation has been re-established in disturbed areas, erosion and sediment control measures must be implemented to mitigate the impact on receiving watercourses and existing infrastructure. The following erosion and sediment control (ESC) measures have been proposed for the subject site:

- Limiting the extent of exposed soils at any given time.
- Erosion and sediment control measures shall be maintained until vegetation has been re-established in all disturbed areas. Re-vegetate disturbed areas in accordance with approved Landscape Plan as soon as possible.
- Stockpile soil away (15 metres or greater) from watercourses, drainage features and top of steep slopes.
- Installation of silt sacks between frame and cover on all proposed and existing catch basins and open cover storm manholes until construction is completed.
- Silt fence to be installed and maintained along the property boundaries.
- Install mud mats at all construction entrances.
- During active construction periods, visual inspections shall be undertaken on a weekly basis and after major storm events (>25mm of rain in 24 hour period) on ESC and any damage repaired immediately.
- ESC shall also be assessed (and repaired as required) following significant snowmelt events.
- Visual inspections shall also be undertaken in anticipation of large storm events (or a series of rainfall and/or snowmelt days) that could potentially yield significant runoff volumes.
- Care shall be taken to prevent damage to ESC during construction operations.
- In some cases, barriers may be removed temporarily to accommodate construction operations. The affected barriers shall be reinstated immediately after construction operations are completed.
- ESC should be adjusted during construction to adapt to site features as the site becomes developed.

- ESC shall be cleaned of accumulated sedimentation as required and replaced as necessary.
- During the course of construction, if the Engineer believes that additional prevention methods are required to control erosion and sedimentation, the Contractor shall implement additional measures, as required, to the satisfaction of the Engineer.
- Construction and maintenance requirements for erosion and sediment controls are to comply with Ontario Provincial Standard Specification (OPSS) 805.

Refer to the Erosion and Sediment Control Plan (DWG. 20027-ESC1) provided in **Appendix B** for more details.

9.0 CONCLUSIONS

This servicing and stormwater management report has been prepared to support the Site Plan Application for the development of the property located at 8800 Campeau Drive, within the KWBP. The report has detailed the proposed means of servicing the site and provided details on how to meet the stormwater management requirements in accordance with City of Ottawa standards and the overarching IBI Reports prepared for the KWBP. The proposed servicing and stormwater management designs will be achieved by implementing the following key features:

- Domestic water supply will be provided by a 200 mm diameter watermain connection to the existing 250 mm diameter watermain on Campeau Drive.
- Water supply for fire protection will be provided by a proposed on-site hydrant.
- Sanitary flows will be conveyed to the existing 250 mm diameter sanitary sewer on Campeau Drive via a proposed 200 mm diameter sanitary sewer.
- Stormwater runoff (minor system) will be conveyed by the proposed storm sewer system to EXMH101 on Campeau Drive.
- Stormwater outflows for all storm events up to and including the 100 year design storm will be controlled in accordance with the *IBI Report*.
- On-site storage will be provided for all storm events up to and including the 100 year design storm event.
- Major overland flows will be conveyed to Campeau Drive.
- A proposed infiltration gallery, fed by roof drains, will be utilized to meet the infiltration targets for the site.
- Quality control will be provided by the existing Pond 6 West Facility.
- Erosion and sediment control measures will be implemented prior to construction and maintained until vegetation has been re-established in disturbed areas.

Report Prepared By:



Brandon MacKechnie, P.Eng.
Project Engineer

Report Reviewed By:

Sean Czaharynski, P.Eng.
Practice Area Lead – Land Development

Watermain Analysis Prepared By:

Pat Leblanc, P.Eng.
Project Manager

Appendix A

Pre-Consultation Notes

KWBP Figure 6 – Draft Plan (prepared by IBI Group)

KWBP General Plan of Services
(prepared by IBI Group)

*KWBP Campeau Drive from STA
19+780 to STA 20+410*
(prepared by IBI Group)

*KWBP Upper Canada Street from
Campeau Drive to STA 0+410*
(prepared by IBI Group)

Jill Sparling

From: David McRobie
Sent: September-28-20 10:44 AM
To: Jill Sparling
Subject: FW: Pre-Consultation Follow-Up: Maritime Ontario (Kanata West Business Park)
Attachments: Pre-con Applicant's Study and Plan Identification List.pdf

Her name is Laurel McCreight.

David McRobie FRAIC OAA OAA AAA
President



Suite 100, 66 Queen Street
Ottawa, Ontario K1P 5C6
T. 613-238-2072 ext. 222
C. 613-979-2072
microbie@microbie.com
www.microbie.com

From: Derek Howe <derek.howe@taggart.ca>
Sent: September-25-20 10:39 AM
To: David McRobie <McRobie@microbie.com>
Subject: FW: Pre-Consultation Follow-Up: Maritime Ontario (Kanata West Business Park)

This is who you should request – she is really good.
Derek

From: McCreight, Laurel <Laurel.McCreight@ottawa.ca>
Sent: October 23, 2019 10:51 AM
To: dplumb@realinc-scs.com; dplumb.can@gmail.com
Cc: Derek Howe <derek.howe@taggart.ca>; Emily McGirr <emily.mcgirr@taggart.ca>
Subject: Pre-Consultation Follow-Up: Maritime Ontario (Kanata West Business Park)

Hi David,

Please refer to the below regarding the Pre-Application Consultation Meeting held on Thursday October 17, 2019 for the property at the far west end of the Kanata West Business Park north of Campeau Drive for a Site Plan Control Application for Maritime Ontario (warehouse and office). I have also attached the required Plans & Study List for application submission.

Below are staff's preliminary comments based on the information available at the time of pre-consultation meeting:

Planning / Urban Design

- Phase 5 of the Kanata West Business Park must be registered prior to receiving site plan approval.
 - An address will be assigned as part of the subdivision registration.
- Emphasis on landscaping along the street edge to provide a green buffer to the parking lot will be important.
- Pedestrian circulation on site from parking areas to the buildings should be clearly defined.

- Please include sidewalks along the frontage of the site.
- Examples of similar developments (Moncton and Brampton) as discussed in the meeting are welcome examples of the level of detail and attention to landscaping, site layout and building design.

Engineering

- The Stormwater Management Criteria for the subject site is to be in accordance with Kanata West Business Park Phase 5 Design Brief, prepared by IBI Group (latest revision). The Phase 5 registration documents are currently under review by the City of Ottawa. Flows to the storm sewer in excess of the allocated storm release rate, up to and including the 100-year storm event, must be detained on site.
- The sanitary sewer release rate for the subject site is to be in accordance with Kanata West Business Park Phase 5 Design Brief, prepared by IBI Group (latest revision).
- Proposed connection locations for sanitary and storm services are to be in accordance with Kanata West Business Park Phase 5 Design Brief, prepared by IBI Group (latest revision)
- Provide the following information for water main boundary conditions:
 1. Location map with water service connection location
 2. Average daily demand (l/s)
 3. Maximum daily demand (l/s)
 4. Maximum hourly demand (l/s)
 5. Fire flow demand (provide fire detailed flow calculations based on the fire underwriters survey method)
 6. If you are proposing any exterior light fixtures, all must be included and approved as part of the site plan approval. Therefore, the lights must be clearly identified by make, model and part number. All external light fixtures must meet the criteria for full cut-off classification as recognized by the Illuminating Engineering Society of North America (IESNA or IES), and must result in minimal light spillage onto adjacent properties (as a guideline, 0.5 fc is normally the maximum allowable spillage). In order to satisfy these criteria, the applicant must provide certification from an acceptable professional engineer. The location of all exterior fixtures, a table showing the fixture types (including make, model, part number), and the mounting heights must be included on a plan.
- An MECP Environmental Compliance Approval (Industrial Sewage Works) will be required for the proposed development assuming “storage of goods or materials” will occur at the proposed warehouse.

Please contact Infrastructure Project Manager, [Julie Candow](#) for follow-up questions.

Transportation

- Follow Traffic Impact Assessment Guidelines
 - Screening form to start, full Traffic Impact Assessment if any of the triggers on the screening form are satisfied.
 - Start this process asap. The application will not be deemed complete until the submission of the draft step 1-4, including the functional draft RMA package (if applicable) and/or monitoring report (if applicable).
- It would be beneficial if the TIA forecasting includes reference to existing Bantree site in terms of site generated traffic.
- Corner triangles as per OP Annex 1 - Road Classification and Rights-of-Way at the following locations on the final plan will be required (measure on the property line/ROW protected line; no structure above or below this triangle):
 - Local Road to Local Road: 3 m x 3 m
- Sight triangle as per Zoning by-law is 6 m x 6 m (measure on the curb line).
- Based upon TAC (Figure 8.8.2), the minimum corner clearance for a local road is 15m.
- Review the [Private Approach By-law](#) to define:
 - The number of accesses (based upon frontage size);
 - The allowable width of private approach (desired max. 9m, exception can be granted for “transport loading areas”);

- The required distance between private approaches (min. 9 m).
- Consider separating heavy vehicles and passenger vehicles on site and at accesses.
- On site plan:
 - Show all details of the roads abutting the site up to and including the opposite curb; include such items as pavement markings, accesses and/or sidewalks.
 - Turning templates will be required for all accesses showing the largest vehicle to access the site; required for internal movements and at all access (entering and exiting and going in both directions).
 - Show all curb radii measurements; ensure that all curb radii are reduced as much as possible
 - Show lane/aisle widths.
 - Provide dedicated pedestrian paths.
 - Sidewalk is to be provided along the site frontages and continuous across accesses as per City Specification 7.1.
 - Grey out any area that will not be impacted by this application.

Please contact Transportation Project Manager, [Josiane Gervais](#) for follow-up questions.

Other

Please refer to the links to “[Guide to preparing studies and plans](#)” and [fees](#) for general information. Additional information is available related to [building permits, development charges, and the Accessibility Design Standards](#). Be aware that other fees and permits may be required, outside of the development review process. You may obtain background drawings by contacting informationcentre@ottawa.ca.

These pre-consultation comments are valid for one year. If you submit a development application(s) after this time, you may be required to meet for another pre-consultation meeting and/or the submission requirements may change. You are as well encouraged to contact us for a follow-up meeting if the plan/concept will be further refined.

Please do not hesitate to contact me if you have any questions.


Regards,
Laurel

Laurel McCreight MCIP, RPP
Planner
Development Review West
Urbaniste
Examen des demandes d'aménagement ouest

City of Ottawa | Ville d'Ottawa
☎ 613.580.2424 ext./poste 16587
ottawa.ca/planning / ottawa.ca/urbanisme

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

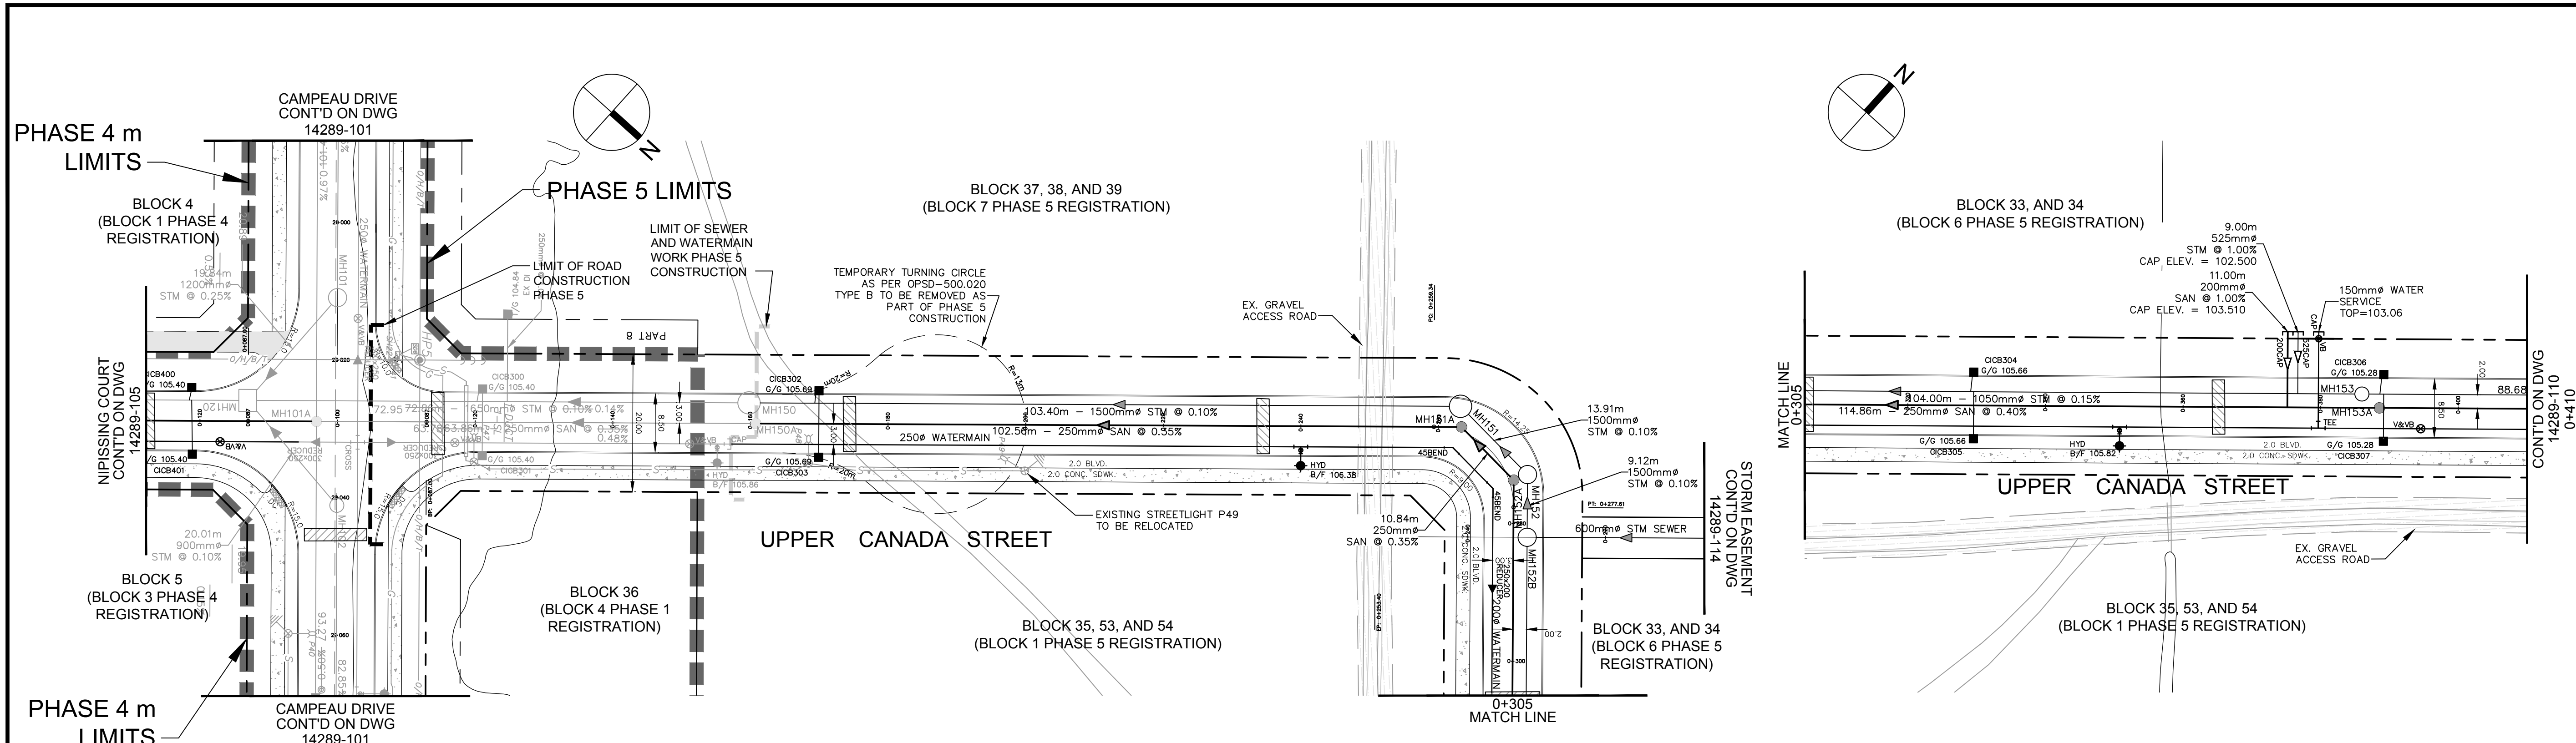


LEGEND:

- MH3A SANITARY MANHOLE
- MH3 STORM MANHOLE
- CB 7/G 99.76 STREET CATCHBASIN c/w TOP OF GRATE
- CB 7/G 98.76 CURB INLET CATCHBASIN c/w CUTTER GRADE
- RVCB 11/G 100.27 REARWARD CB c/w TOP OF GRATE
- DMH 11/G 97.40 DITCH INLET MANHOLE c/w TOP OF GRATE
- CBMH 7/G 101.55 STREET CATCHBASIN MANHOLE c/w GUTTER GRADE
- V&V VALVE AND VALVE BOX
- V&C VALVE AND CHAMBER
- H/F 100.56 HYDRANT c/w BOTTOM OF FLANGE ELEVATION
- BARRIER CURB AS PER SC1.1
- DEPRESSED BARRIER CURB AS PER SC1.1 COMPLETE WITH TWSI PER SC7.3
- MOUNTABLE CURB AS PER SC1.3
- PROPOSED CONCRETE SIDEWALK
- ▨ REQUIRED FILL BELOW ROAD SUBGRADE
- ▨ CLAY DYKES
- HCL 103.34 HYDRAULIC GRADE LINE
- TEMPORARY 3.0m GRAVEL ACCESS ROAD

FOR EXTENT OF EXISTING CONSTRUCTION REFER TO DRAWING 14289-100A

No.	REVISIONS	By	Date
19			
18	ADD SERVICE CONNECTIONS FOR BLOCKS 5 AND 6	LME	20:06:17
17	ISSUED FOR CONSTRUCTION PHASE 4 AND 5	LME	20:05:27
16	ISSUED FOR TENDER PHASE 4 AND 5	LME	20:02:12
15	REVISED AS PER PHASE 5 COMMENTS	LME	19:10:25
14	ISSUED FOR PHASE 5 REGISTRATION	LME	19:09:10
13	REVISED FOR PHASE 3 REGISTRATION	LME	18:09:14
12	ADDED CITY FILE NUMBER	LME	18:05:30
11	REVISED FOR PHASE 2 REGISTRATION	LME	18:04:20
10	RELOCATE V&V, HYDRANT AND CAP AT BLOCK 35/36	LME	16:05:05
9	REVISED LIMIT BLK 36, RELOCATE V&V, HYDRANT AND CAP	LME	16:04:20
8	ISSUED FOR CONSTRUCTION	LME	16:01:19
7	ISSUED FOR MYLARS	LME	16:01:12
6	ISSUED TO TAGGART	LME	15:12:14
5	REVISED AS PER CITY COMMENTS	LME	15:10:15
4	REVISE PHASE 1 LIMITS	LME	15:08:19
3	REVISED AS PER NEW SITE PLAN AND CITY COMMENTS	LME	15:06:19
2	REVISED AS PER CITY COMMENTS	LME	15:04:08
1	ISSUED TO CITY FOR APPROVAL	LME	14:11:27

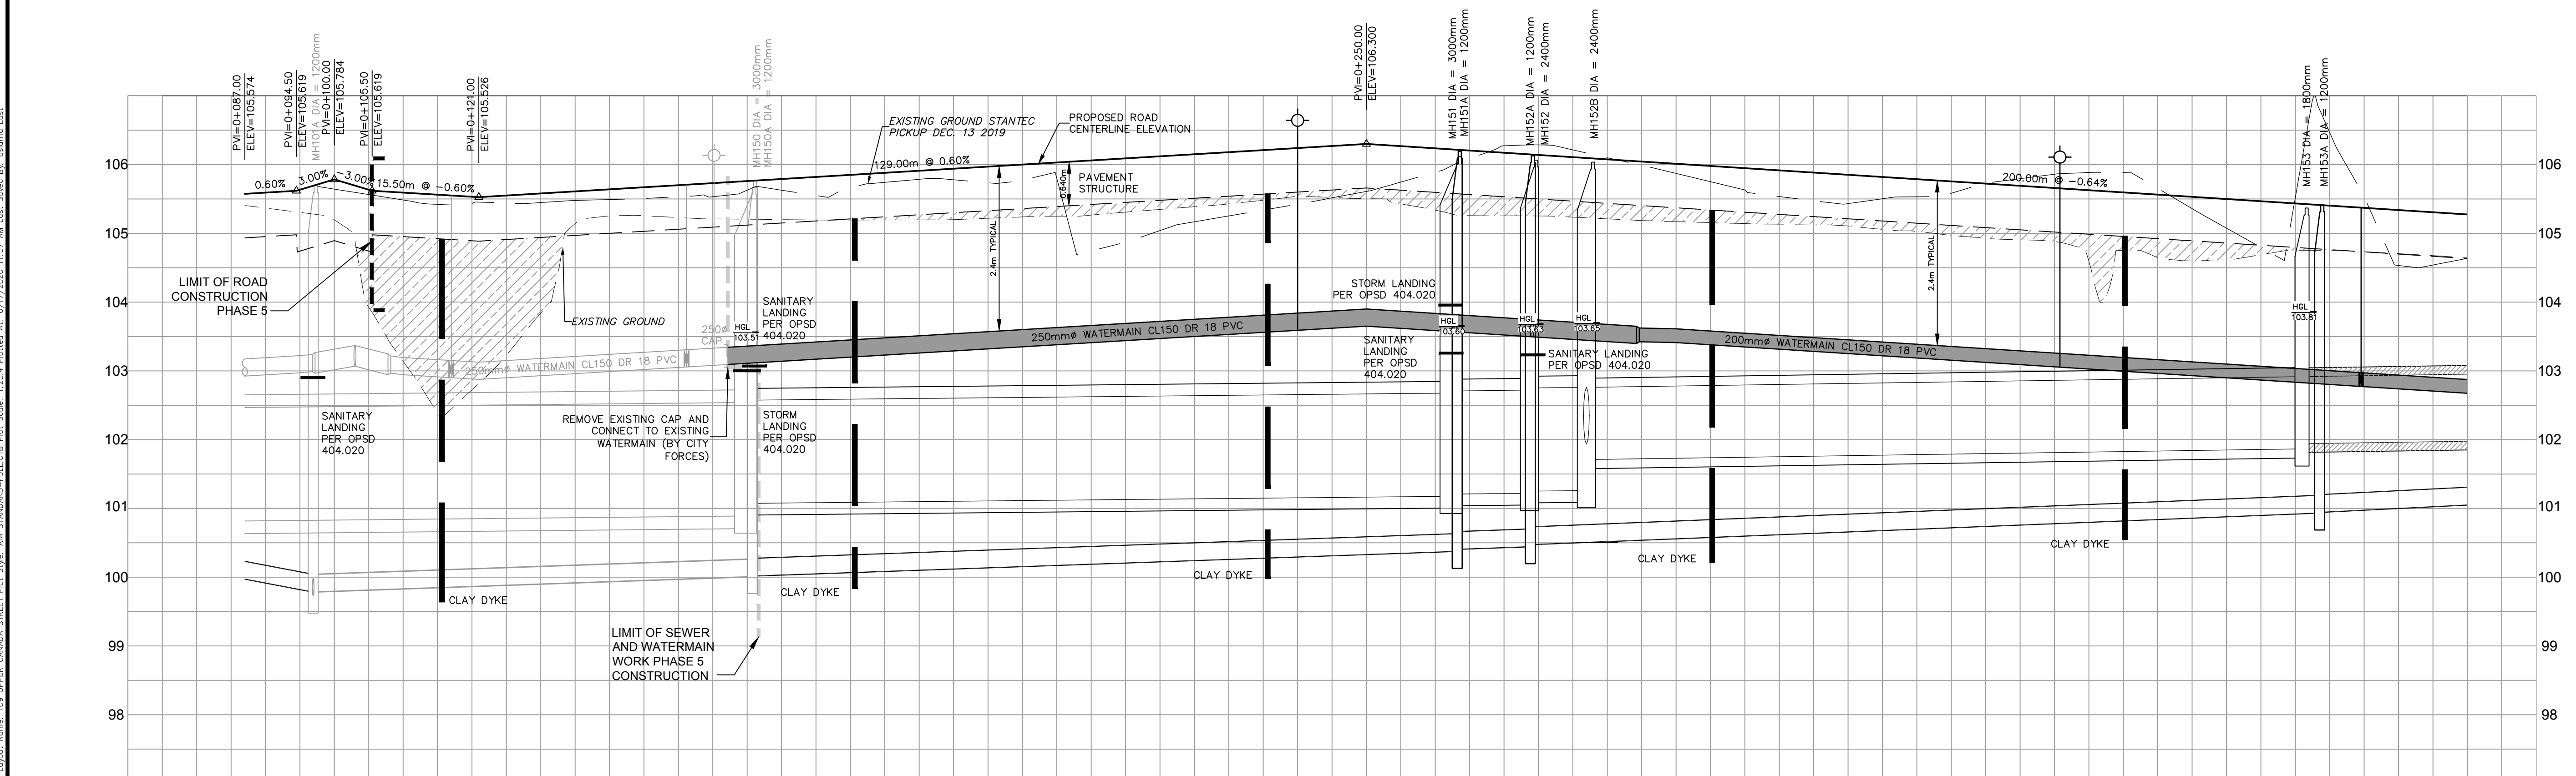

ROAD GRADE	105.574	105.619	105.784	105.619	105.526	105.640	105.760	105.890	106.000	106.120	106.240	106.300	106.236	106.108	105.990	105.851	105.723	105.595	105.467	105.338	ROAD GRADE													
TOP OF WATERMAIN	103.174	103.219	103.264	103.350	103.350	103.350	103.343	103.360	103.480	103.600	103.840	103.900	103.836	103.708	103.580	103.451	103.323	103.195	103.067	102.939	TOP OF WATERMAIN													
STM SEWER INVERT		72.95	72.95	72.95	72.95	72.95	72.95	72.95	103.40m	103.40m	103.40m	103.91m	103.836	103.708	103.580	103.451	103.323	103.195	103.067	102.939	STM SEWER INVERT													
SAN SEWER INVERT	97.00m	99.7975E	99.7975E	99.7975E	99.7975E	99.7975E	99.7975E	99.7975E	102.56m	102.56m	102.56m	102.84m	102.799E	102.721E	102.593E	102.464E	102.335E	102.206E	102.077E	101.948E	SAN SEWER INVERT													
STATION	0+080	0+090	0+100	0+110	0+120	0+130	0+140	0+150	0+160	0+170	0+180	0+190	0+200	0+210	0+220	0+230	0+240	0+250	0+260	0+270	0+280	0+290	0+300	0+310	0+320	0+330	0+340	0+350	0+360	0+370	0+380	0+390	0+400	STATION

TAGGART REALTY MANAGEMENT

IBI GROUP
400 - 333 Preston Street
Oshawa ON K1G 5N4 Canada
tel 613 225 1311 fax 613 225 9868
ibigroup.com

Project Title: **KANATA WEST BUSINESS PARK PHASE 5**

LIAM M. ERNOL
PROFESSIONAL ENGINEER
2020/06/17
PROVINCE OF ONTARIO

Drawing Title: **UPPER CANADA STREET**
FROM CAMPEAU DRIVE TO STA. 0+410

Scale: HORIZ. SCALE 1:500
VERT. SCALE 1:50

Design	LME	Date	NOV. 2014
Drawn	DPS	Checked	TRB

Project No. **14289** Drawing No. **109**

Appendix B

Site Plan
(prepared by McRobie Architects)

Servicing Plans
(DWG. 20027-S1, S2)

Grading Plans
(DWG. 20027-GR1, GR2, GR3)

Erosion and Sediment Control Plan
(DWG. 20027-ESC1)

Notes & Details
(DWG. 20027-N1)

Existing Conditions and Removals Plan
(DWG. 20027-R1)


CONSULTANTS

CLELAND JARDINE ENGINEERING LTD.
STRUCTURAL ENGINEERS
200 - 860 TERRY FOX DRIVE, KANATA, ON, K2L 4B9
TEL: 613-891-1533


MCKEE ENGINEERING
MECHANICAL & ELECTRICAL ENGINEERS
128 WOODWARD DRIVE, OTTAWA, ON, K2C 0P9
TEL: 613-723-9885

ROBINSON CONSULTANTS INC.
CIVIL ENGINEERS
200 - 300 PALLADIUM DRIVE, OTTAWA, ON, K2V 1A8
TEL: 613-552-0086

LEVSTEK CONSULTANTS INC.
LANDSCAPE ARCHITECTS
6511 HIGH CRESSLETT, OSSINGO, ON, N0A 2W0
TEL: 613-828-0518

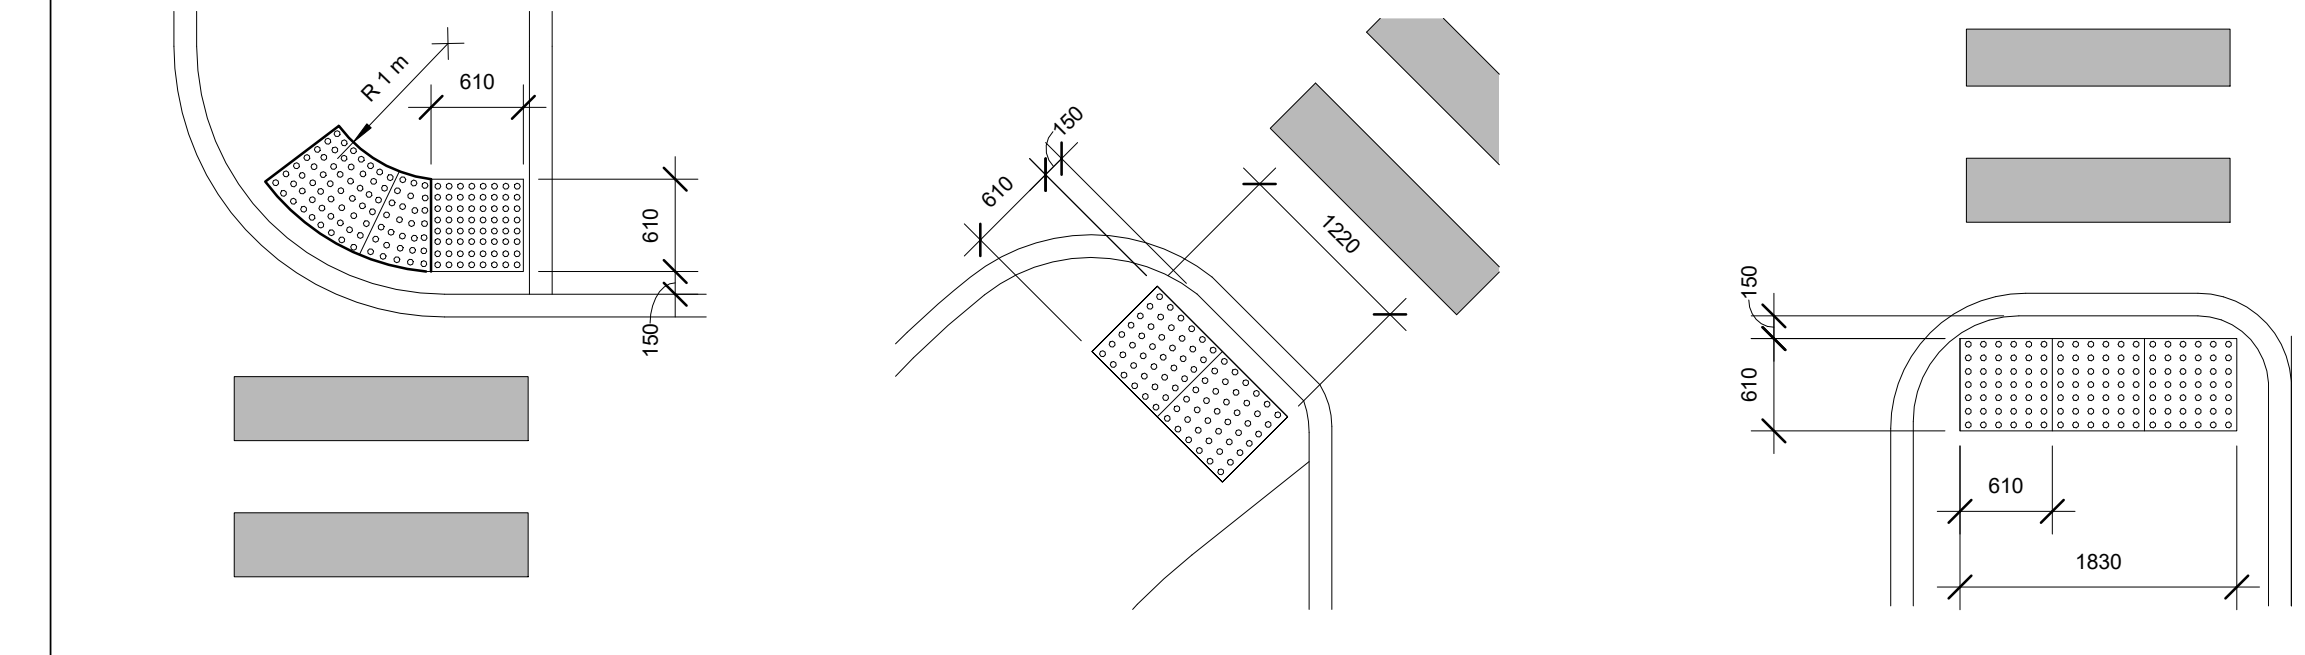

4.1 TWSI - TYPE A Scale: 1:50
4.2 TWSI - TYPE B Scale: 1:50
4.3 TWSI - TYPE C Scale: 1:50

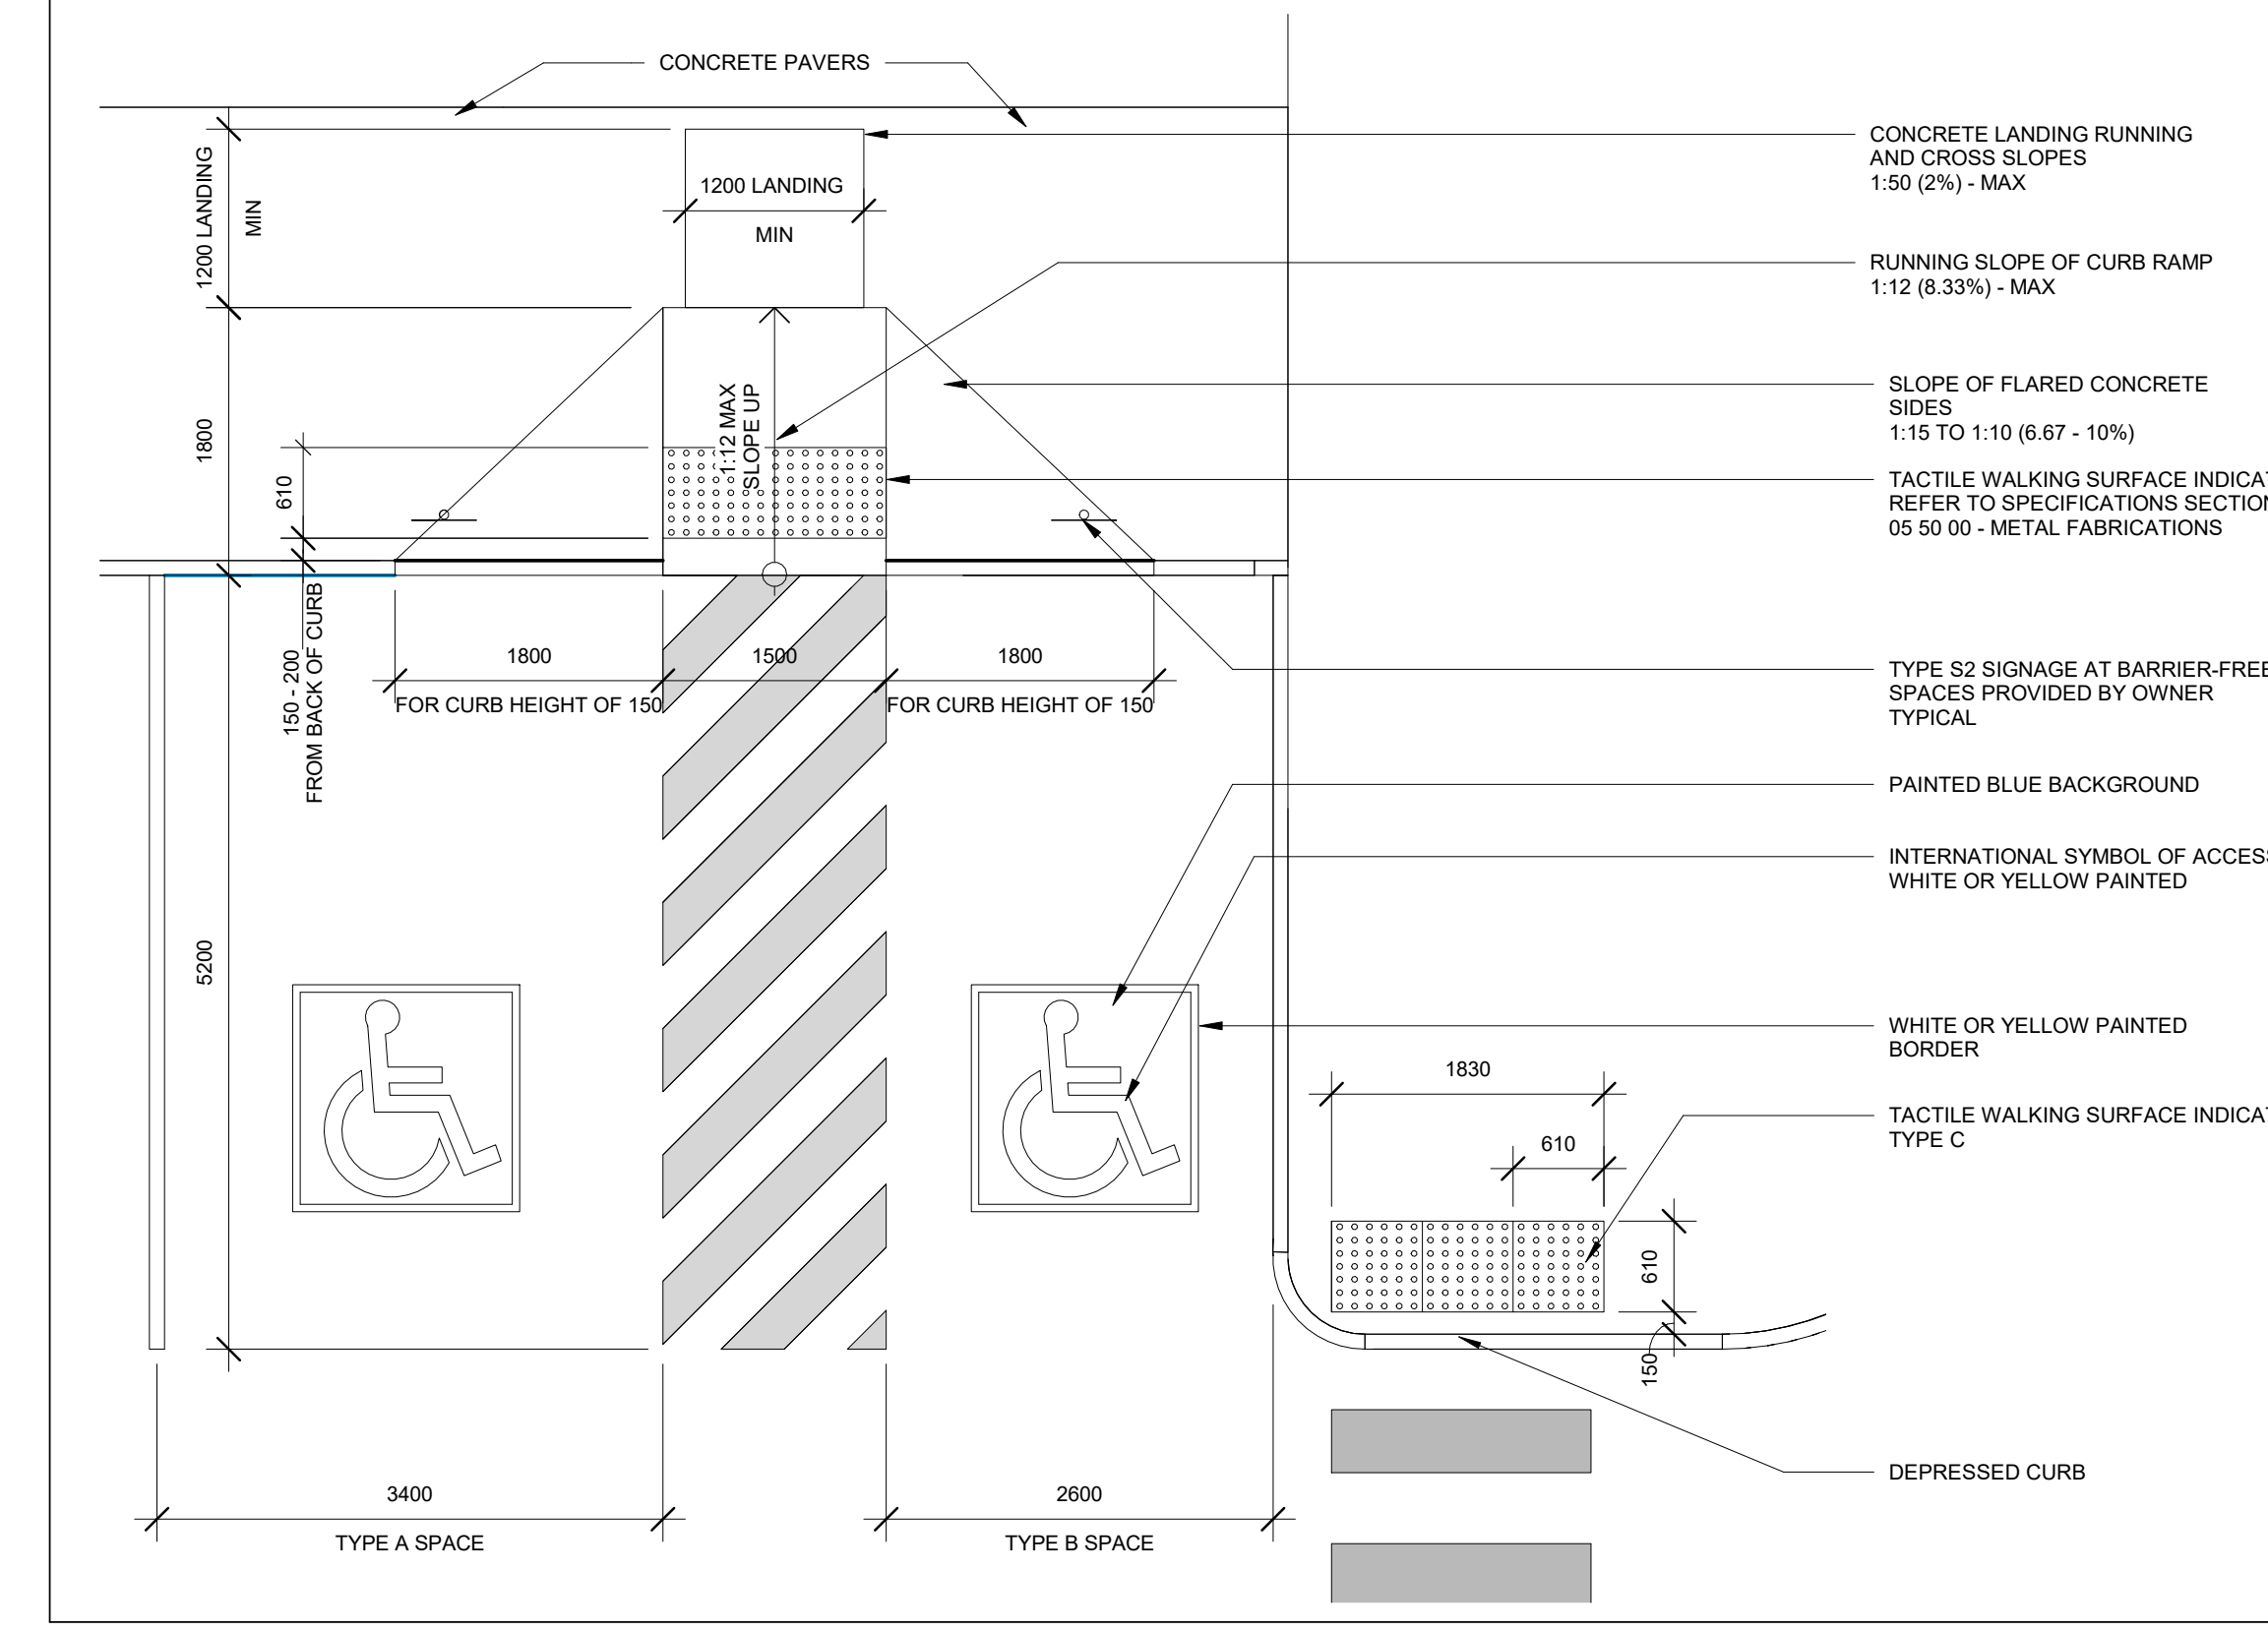

03 TYPICAL DETAIL - DEPRESSED CURB AND TWSI AT BARRIER-FREE PARKING STALL
Scale: 1:50

CITY OF OTTAWA ZONING BY-LAW 2009-250	REQUIRED	PROVIDED
MINIMUM LOT AREA	750m ²	70,334m ²
MINIMUM LOT WIDTH	NO MINIMUM	297.6m
MINIMUM LOT COVERAGE	50%	+/- 10.3%
SETBACKS	FRONT YARD: 6m INTERIOR SIDE YARD: 4m CORNER SIDE YARD: 6m REAR YARD: 6m	FRONT YARD: 59.83m INTERIOR SIDE YARD: 100m CORNER SIDE YARD: 81.37m REAR YARD: 88.4m
MAXIMUM FLOOR SPACE INDEX	2.0	+/- 0.103
MAXIMUM BUILDING HEIGHT	22m	12.36m
MINIMUM WIDTH OF LANDSCAPE	ABUTTING A STREET: 3m ALL OTHER CASES: NO MINIMUM	ABUTTING A STREET: 3m (CAMPEAU), 5.30m (UPPER CANADA) ALL OTHER CASES: 1.52m
ACCESSORY SALES AND DISPLAY AREA	MAXIMUM 25% OF THE GROSS FLOOR AREA OF THE PROPOSED BUILDING	N/A
MINIMUM PARKING WAREHOUSE: 9.8/100m ² OF GFA	WAREHOUSE: 58 SPACES	134 SPACES
BARRIER FREE PARKING TYPE A: MINIMUM 3.4m WIDE TYPE B: MINIMUM 2.0m WIDE MINIMUM ACCESS AISLE: 1.5m	4 SPACES (2 TYPE A + 2 TYPE B)	4 SPACES (2 TYPE A + 2 TYPE B)
MINIMUM BICYCLE PARKING WAREHOUSE: 1/1000m ² OF GFA	7 SPACES	10 SPACES
LOADING SPACES	2 SPACES	48 SPACES

02 ZONING TABLE
Scale: N/A

SITE PLAN INFORMATION
UNDERLYING TOPOGRAPHICAL INFORMATION IS AS PER A PLAN PREPARED BY STANTEC GEOMATICS LTD., ONTARIO LAND SURVEYORS DATED DECEMBER 20TH, 2019 OF PART OF LOT 4 CONCESSION 1, GEOGRAPHIC TOWNSHIP OF HUNTLEY.

ABBREVIATIONS

- ADA: ACCESSIBILITY FOR ONTARIANS WITH DISABILITIES
- TWSI: TACTILE WALKING SURFACE INDICATOR
- N.I.C.: NOT IN CONTRACT

LEGEND


- LINE OF SETBACK AS PER ZONING BY-LAW
- PROPERTY LINE
- SUBJECT TO HYDRO EASEMENT
- EXISTING OVERHEAD WIRES
- EXISTING UTILITY POLE
- NEW EXTERIOR LIGHT STANDARD
- GENERATOR - REFER TO ELECTRICAL
- TRANSFORMER - REFER TO ELECTRICAL
- POST-MOUNTED BLOCK HEATER OUTLETS, DUAL RECEPTACLE - REFER TO ELECTRICAL
- EXISTING LIGHT STANDARD
- PRECAST CONCRETE PAVERS - REFER TO LANDSCAPE PLAN
- SOO, REFER TO LANDSCAPE PLAN
- NEW SHRUBS, REFER TO LANDSCAPE PLAN
- NEW TREE, REFER TO LANDSCAPE PLAN
- GALVANIZED CHAIN LINK FENCE
- GALVANIZED W-BEAM GUARDRAIL ON STEEL POSTS REFER TO CIVIL
- BUILDING ENTRANCE
- 230mm DIAMETER CONCRETE FILLED BOLLARD REFER TO STRUCTURAL DETAIL DC-165002
- OVERHEAD DOOR
- SIEMENS FIRE DEPARTMENT CONNECTION REFER TO MECHANICAL
- NEW FIRE HYDRANT REFER TO CIVIL
- EXISTING FIRE HYDRANT
- NEW CATCH BASIN - REFER TO CIVIL
- EXISTING CATCH BASIN
- BARRIER FREE PARKING STALL - REFER TO CIVIL FOR LINE PAINTING
- NEW HORIZONTAL BICYCLE PARKING - REFER TO LANDSCAPE FOR BIKE RACKS
- CROSSWALK PAINT MARKINGS - REFER TO CIVIL FOR LINE PAINTING
- 610mm DEEP TACTILE WALKING SURFACE INDICATOR (TWSI) - PROFILE TO MATCH EXTENT OF DEPRESSED CURB - TYPICAL ALL DEPRESSED CURBS UNLESS OTHERWISE INDICATED. REFER TO DETAIL 4.1, 4.2, 4.3 ON SP-01
- DEPRESSED CURB - REFER TO DETAIL 03 SP-01

SIGNAGE


- (S1) NEW ILLUMINATED MONUMENT SIGN
- (S2) ADA COMPLIANT VERTICAL PARKING SIGN REFER TO CIVIL DRAWINGS FOR ALL GRADING SERVICE, STORMWATER MANAGEMENT AND LINE PAINTING
- (S3) FIRE ROUTE SIGNAGE
- (S4) AUTHORIZED USE ONLY OVERHEAD SIGN

NOTE: ALL SIGNAGE, POSTS, AND FOUNDATIONS N.I.C.

01 SITE PLAN NOTES, LEGEND, AND ABBREVIATIONS
Scale: N/A

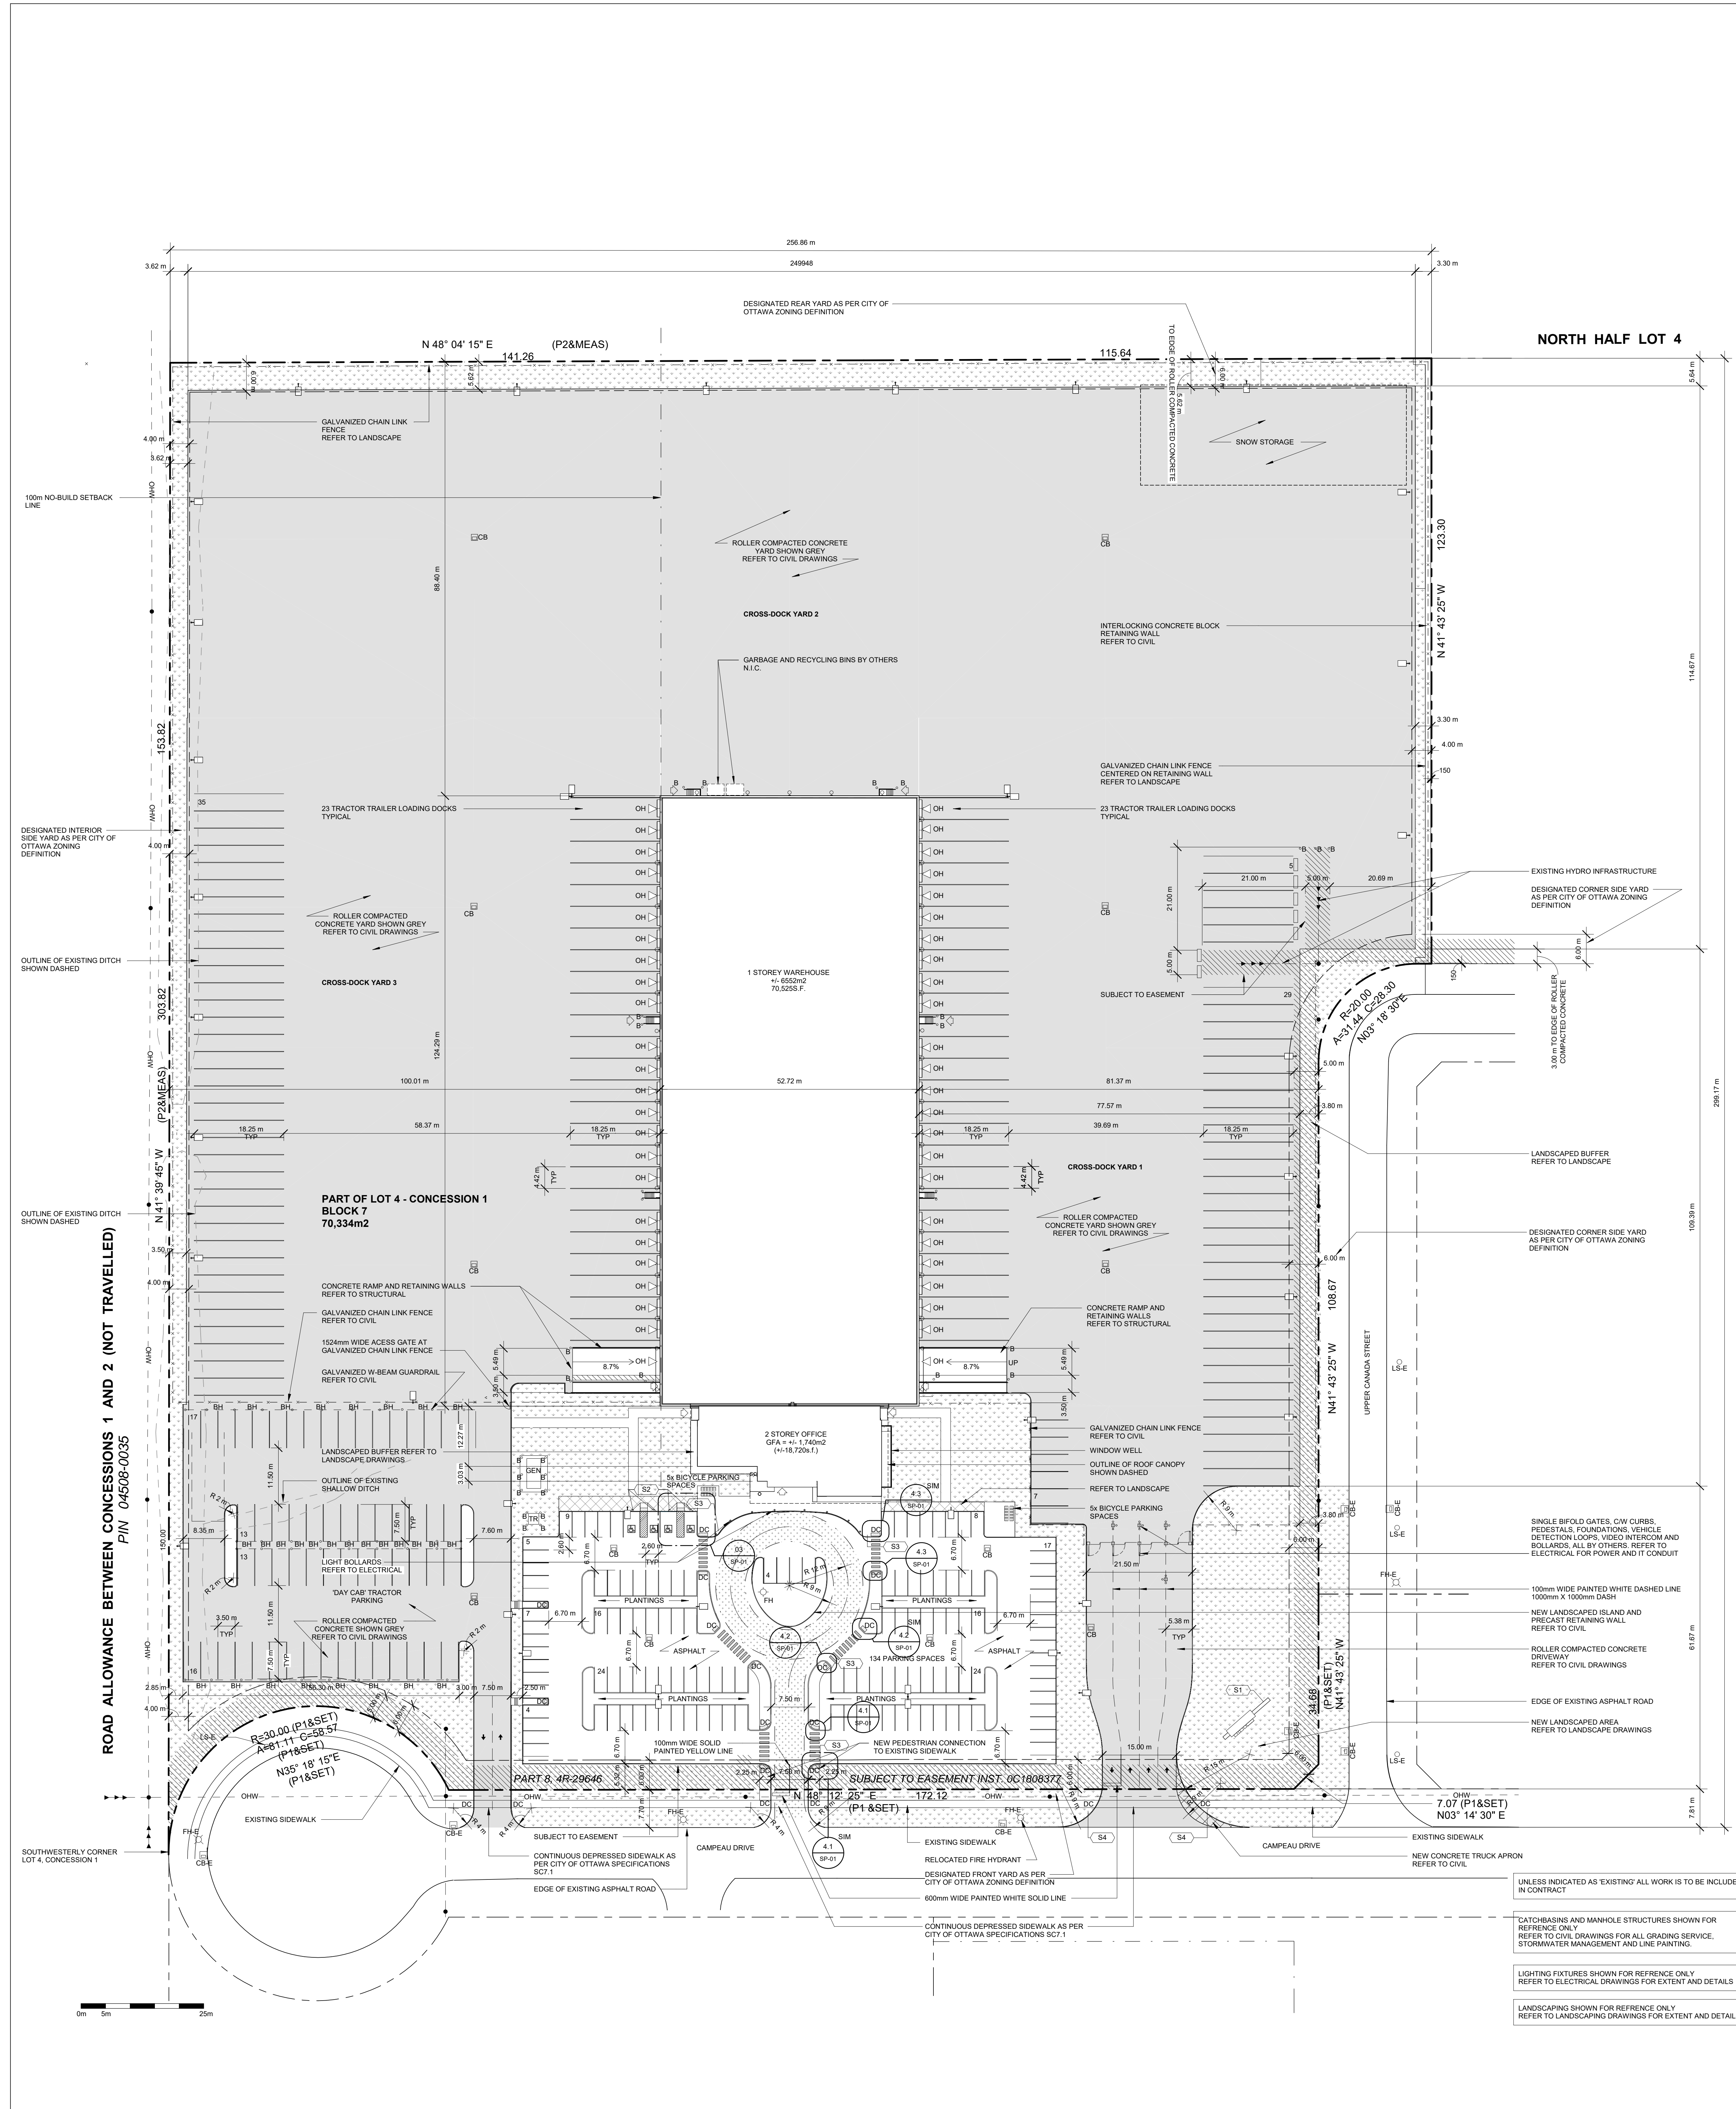

05 SITE PLAN
Scale: 1:500

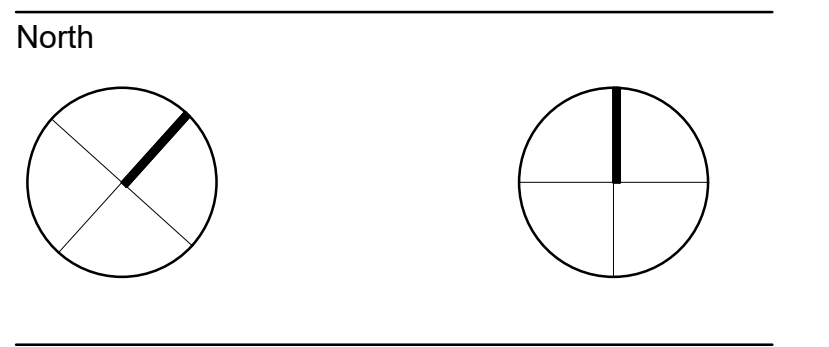

Revisions

Revision Number	Description	Date
1	ISSUED FOR SITE PLAN APPLICATION	2020-12-16
2	ISSUED FOR COORDINATION	2021-03-08
3	ISSUED FOR COORDINATION	2021-03-19
4	ISSUED FOR COORDINATION	2021-03-23
5	ISSUED FOR PERMIT	2021-04-07
6	ISSUED FOR COORDINATION	2021-05-31
7	ISSUED IN RESPONSE TO CITY COMMENTS	2021-06-05
8	ISSUED FOR TENDER	2021-06-11

Project
MARITIME-ONTARIO OTTAWA FACILITY

8800 CAMPEAU DRIVE, OTTAWA, ON

SITE PLAN

Scale: As Indicated
Stamp: [Blank]

Drawn: RH
Checked: DM

Project No.: 19-247
Drawing No.: **SP-01**
Date: 2020/07/21

MATCHLINE
REFER TO DWG. 20027-S2

ICD DESIGN TABLE				
STRUCTURE	100 YEAR OUTFLOW (L/s)	100 YEAR HEAD (m)	ORIFICE DIAMETER (mm)	TYPE
CB 1	120	1.78	204.1	SLIDE
CB 2	60	1.79	144.1	SLIDE
CB 3	80	1.79	166.4	SLIDE
CB 4	60	1.81	143.8	SLIDE
CB 5	120	1.78	204.1	SLIDE
CB 6	60	1.77	144.5	SLIDE
CB 7	30	1.83	101.4	SLIDE
CB 8	25	1.83	92.6	SLIDE
CB 9	55	1.66	140.8	SLIDE
CB 10	30	1.58	105.3	SLIDE
CB 11	25	1.74	93.8	SLIDE
CB 12	40	1.66	120.1	SLIDE
CB 13	30	1.75	102.6	SLIDE
CB 14	25	1.74	93.8	SLIDE
DICB 15	20	1.63	85.3	SLIDE
DICB 17	20	1.63	85.3	SLIDE


CATCH BASIN TABLE				
STRUCTURE	STRUCTURE SIZE	T/G ELEV	INVERT	GRATE
CB 1	600x600mm	106.42	NE=104.74	S19
CB 2	600x600mm	106.32	NE=104.64	S19
CB 3	600x600mm	106.22	NE=104.54	S19
CB 4	600x600mm	106.15	NE=104.47	S19
CB 5	600x600mm	106.42	NE=104.74	S19
CB 6	600x600mm	106.32	NE=104.64	S19
CB 7	600x600mm	106.22	NE=104.54	S19
CB 8	600x600mm	105.95	NE=104.27	S19
CB 9	600x600mm	107.10	NE=105.42	S19
CB 10	600x600mm	106.64	NE=105.13	S19
CB 11	600x600mm	106.06	SE=104.38	S19
CB 12	600x600mm	107.10	SW=105.42	S19
CB 13	600x600mm	106.64	SW=104.96	S19
CB 14	600x600mm	106.06	SE=104.38	S19
CB 16	600x600mm	106.61	SW=105.41	S19
DICB 15	600x600mm	106.42	SW=104.67	403.010
DICB 17	600x600mm	106.50	NE=104.75	403.010

SEWER CROSSING TABLE				
CROSSING No.	INVERTS (m)	SEPARATION (m)		
1	WATER INV.=103.77	0.27		
	STM OBV.=103.50			
	SAN INV.=104.51			
2	STM INV.=103.55	0.96		
	STM INV.=104.64			
	STM OBV.=103.94			
3	SAN INV.=104.41	1.41		
	EX STM OBV.=103.00			
	SAN INV.=104.42			
4	EX WATER OBV.=103.88	0.54		
	EX WATER INV.=103.28			
5	STM OBV.=102.90	0.38		

WATERMAIN GRADE TABLE (200mm)				
STATION	FINISHED GRADE (m)	TOP OF WATER (m)	DESCRIPTION	
0+000	106.17	103.86	200mm OFF 250mm TEE	
0+010.1	106.25	103.85	VALVE & VALVE BOX	
0+020	106.36	103.96	TOP OF WATERMAIN	
0+030	106.63	104.23	TOP OF WATERMAIN	
0+040	107.08	104.68	TOP OF WATERMAIN	
0+050	107.77	105.37	152mm OFF 250mm HYDRANT TEE	
0+060	107.78	105.38	TOP OF WATERMAIN	
0+066.3	107.89	105.49	11.25' BEND	
0+070.8	108.08	105.50	CAP	



NOTES				
THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.				

SCALE				
5	REVISED PER COMMENTS	09/08/21	SMC	
4	ISSUED FOR TENDER	11/06/21	SMC	
3	REVISED PER COMMENTS	28/05/21	SMC	
2	ISSUED FOR PROGRESS REVIEW	22/03/21	SMC	
1	ISSUED FOR SITE PLAN APPLICATION	02/12/20	SMC	
NO.	REVISION DESCRIPTION	DATE	BY	

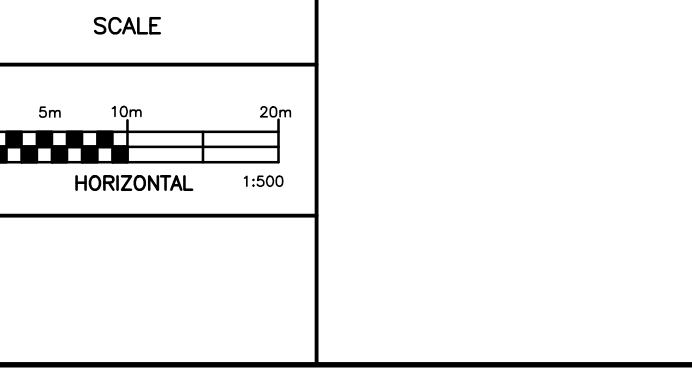

STORM MANHOLE TABLE				
STRUCTURE	STRUCTURE SIZE	T/G ELEV	INVERT	GRATE
EX101	2400mm	105.88	SW=101.44 E=101.41 NW=101.86	S24.1
200	2400mm	105.88	NW=103.82 SW=102.04 SE=101.98	S24.1
201	1500mm	106.37	SW=102.67 NW=103.24 NE=102.64	S24.1
202	1800mm	106.43	NW=102.96 SE=103.29	S24.1
203	1500mm	106.35	NW=103.32 SE=103.29	S24.1
204	1500mm	106.46	SE=103.76	S24.1
205	1800mm	106.23	NW=102.42 SW=102.34 NE=102.19	S24.1
206	1500mm	106.33	NW=102.96 SE=102.93	S24.1
207	1500mm	106.46	SE=103.78	S24.1
208	1200mm	106.66	NW=105.13 SE=105.08	S24.1
300	1200mm	106.44	NW=104.94 SW=105.00	S24.1
301	1200mm	106.47	SE=104.94 SW=105.00	S24.1
302	1200mm	106.55	SE=104.76 NE=104.68 NW=104.76 SW=104.76	S24.1
303	1200mm	106.76	SW=104.56 SE=105.18	S24.1
304	1200mm	106.48	NW=104.12 SE=104.09 NW=104.84	S24.1

SANITARY MANHOLE TABLE				
STRUCTURE	STRUCTURE SIZE	T/G ELEV	INVERT	GRATE
100	1200mm	106.28	NW=104.49 SE=104.46	S24
101	1200mm	108.28	SE=104.66 NW=104.69	S24

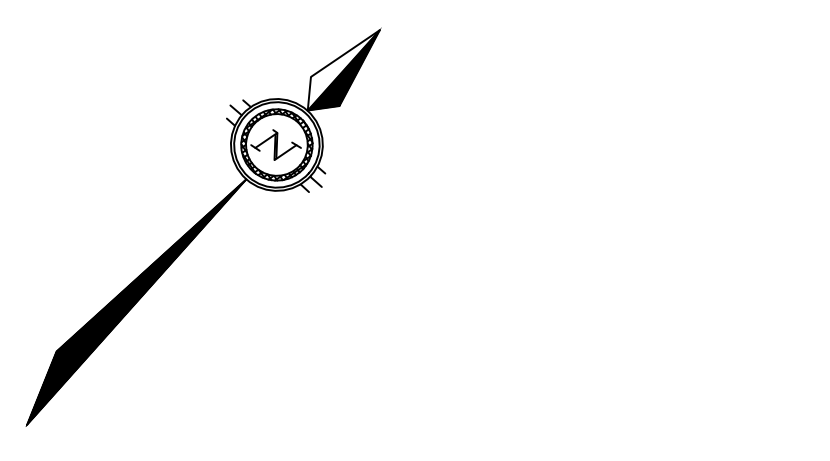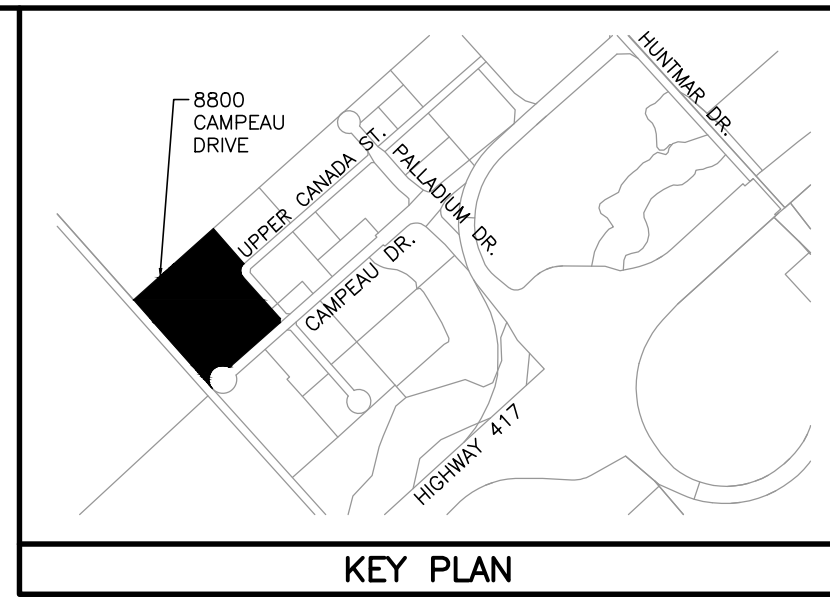

CATCH BASIN TABLE				
STRUCTURE	STRUCTURE SIZE	T/G ELEV	INVERT	GRATE
CB 1	600x600mm	106.42	NE=104.74	S19
CB 2	600x600mm	106.32	NE=104.64	S19
CB 3	600x600mm	106.22	NE=104.54	S19
CB 4	600x600mm	106.15	NE=104.47	S19
CB 5	600x600mm	106.42	NE=104.74	S19
CB 6	600x600mm	106.32	NE=104.64	S19
CB 7	600x600mm	106.22	NE=104.54	S19
CB 8	600x600mm	105.95	NE=104.27	S19
CB 9	600x600mm	107.10	NE=105.42	S19
CB 10	600x600mm	106.64	NE=105.13	S19
CB 11	600x600mm	106.06	SE=104.38	S19
CB 12	600x600mm	107.10	SW=105.42	S19
CB 13	600x600mm	106.64	SW=104.96	S19
CB 14	600x600mm	106.06	SE=104.38	S19
CB 16	600x600mm	106.61	SW=105.41	S19
DICB 15	600x600mm	106.42	SW=104.67	403.010
DICB 17	600x600mm	106.50	NE=104.75	403.010

NOT FOR CONSTRUCTION



Robinson
Land Development

350 Palladium Drive
Ottawa, ON K2V 1A8
(613) 592-6060 roii.com




DESIGN	BLM
CHECKED	SMC
DRAWN	BLM
CHECKED	SMC
APPROVED	SMC

MARITIME-ONTARIO
FREIGHT LINES LIMITED

KANATA WEST BUSINESS PARK
8800 CAMPEAU DRIVE, OTTAWA, ON

SERVICING PLAN

PROJECT No.	20027
SURVEY	STANTEC
DATED	AUGUST 2021
DWG. No.	20027-S1

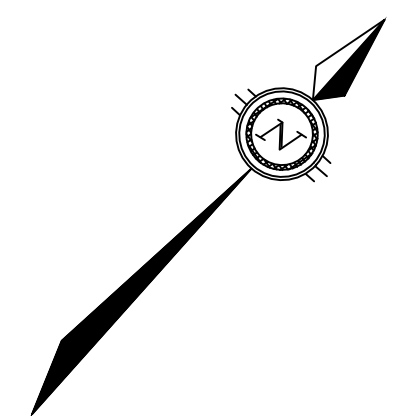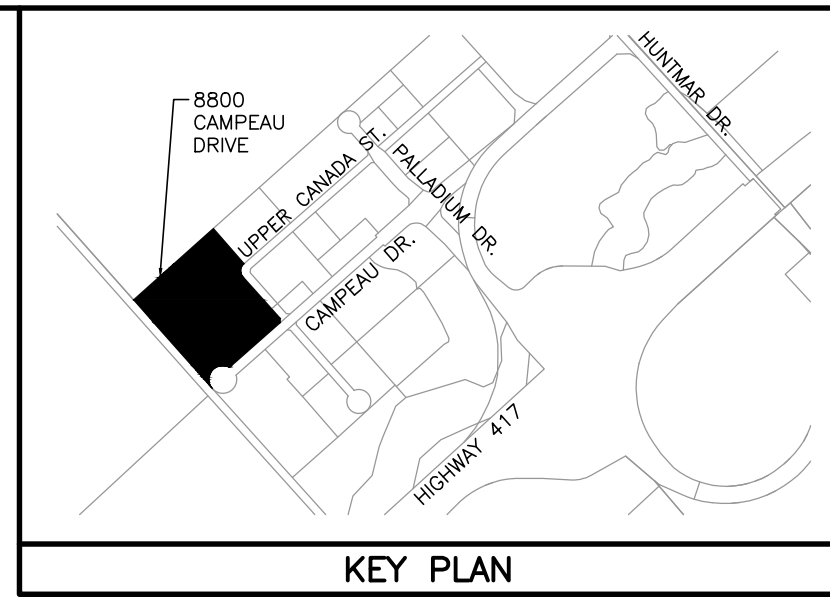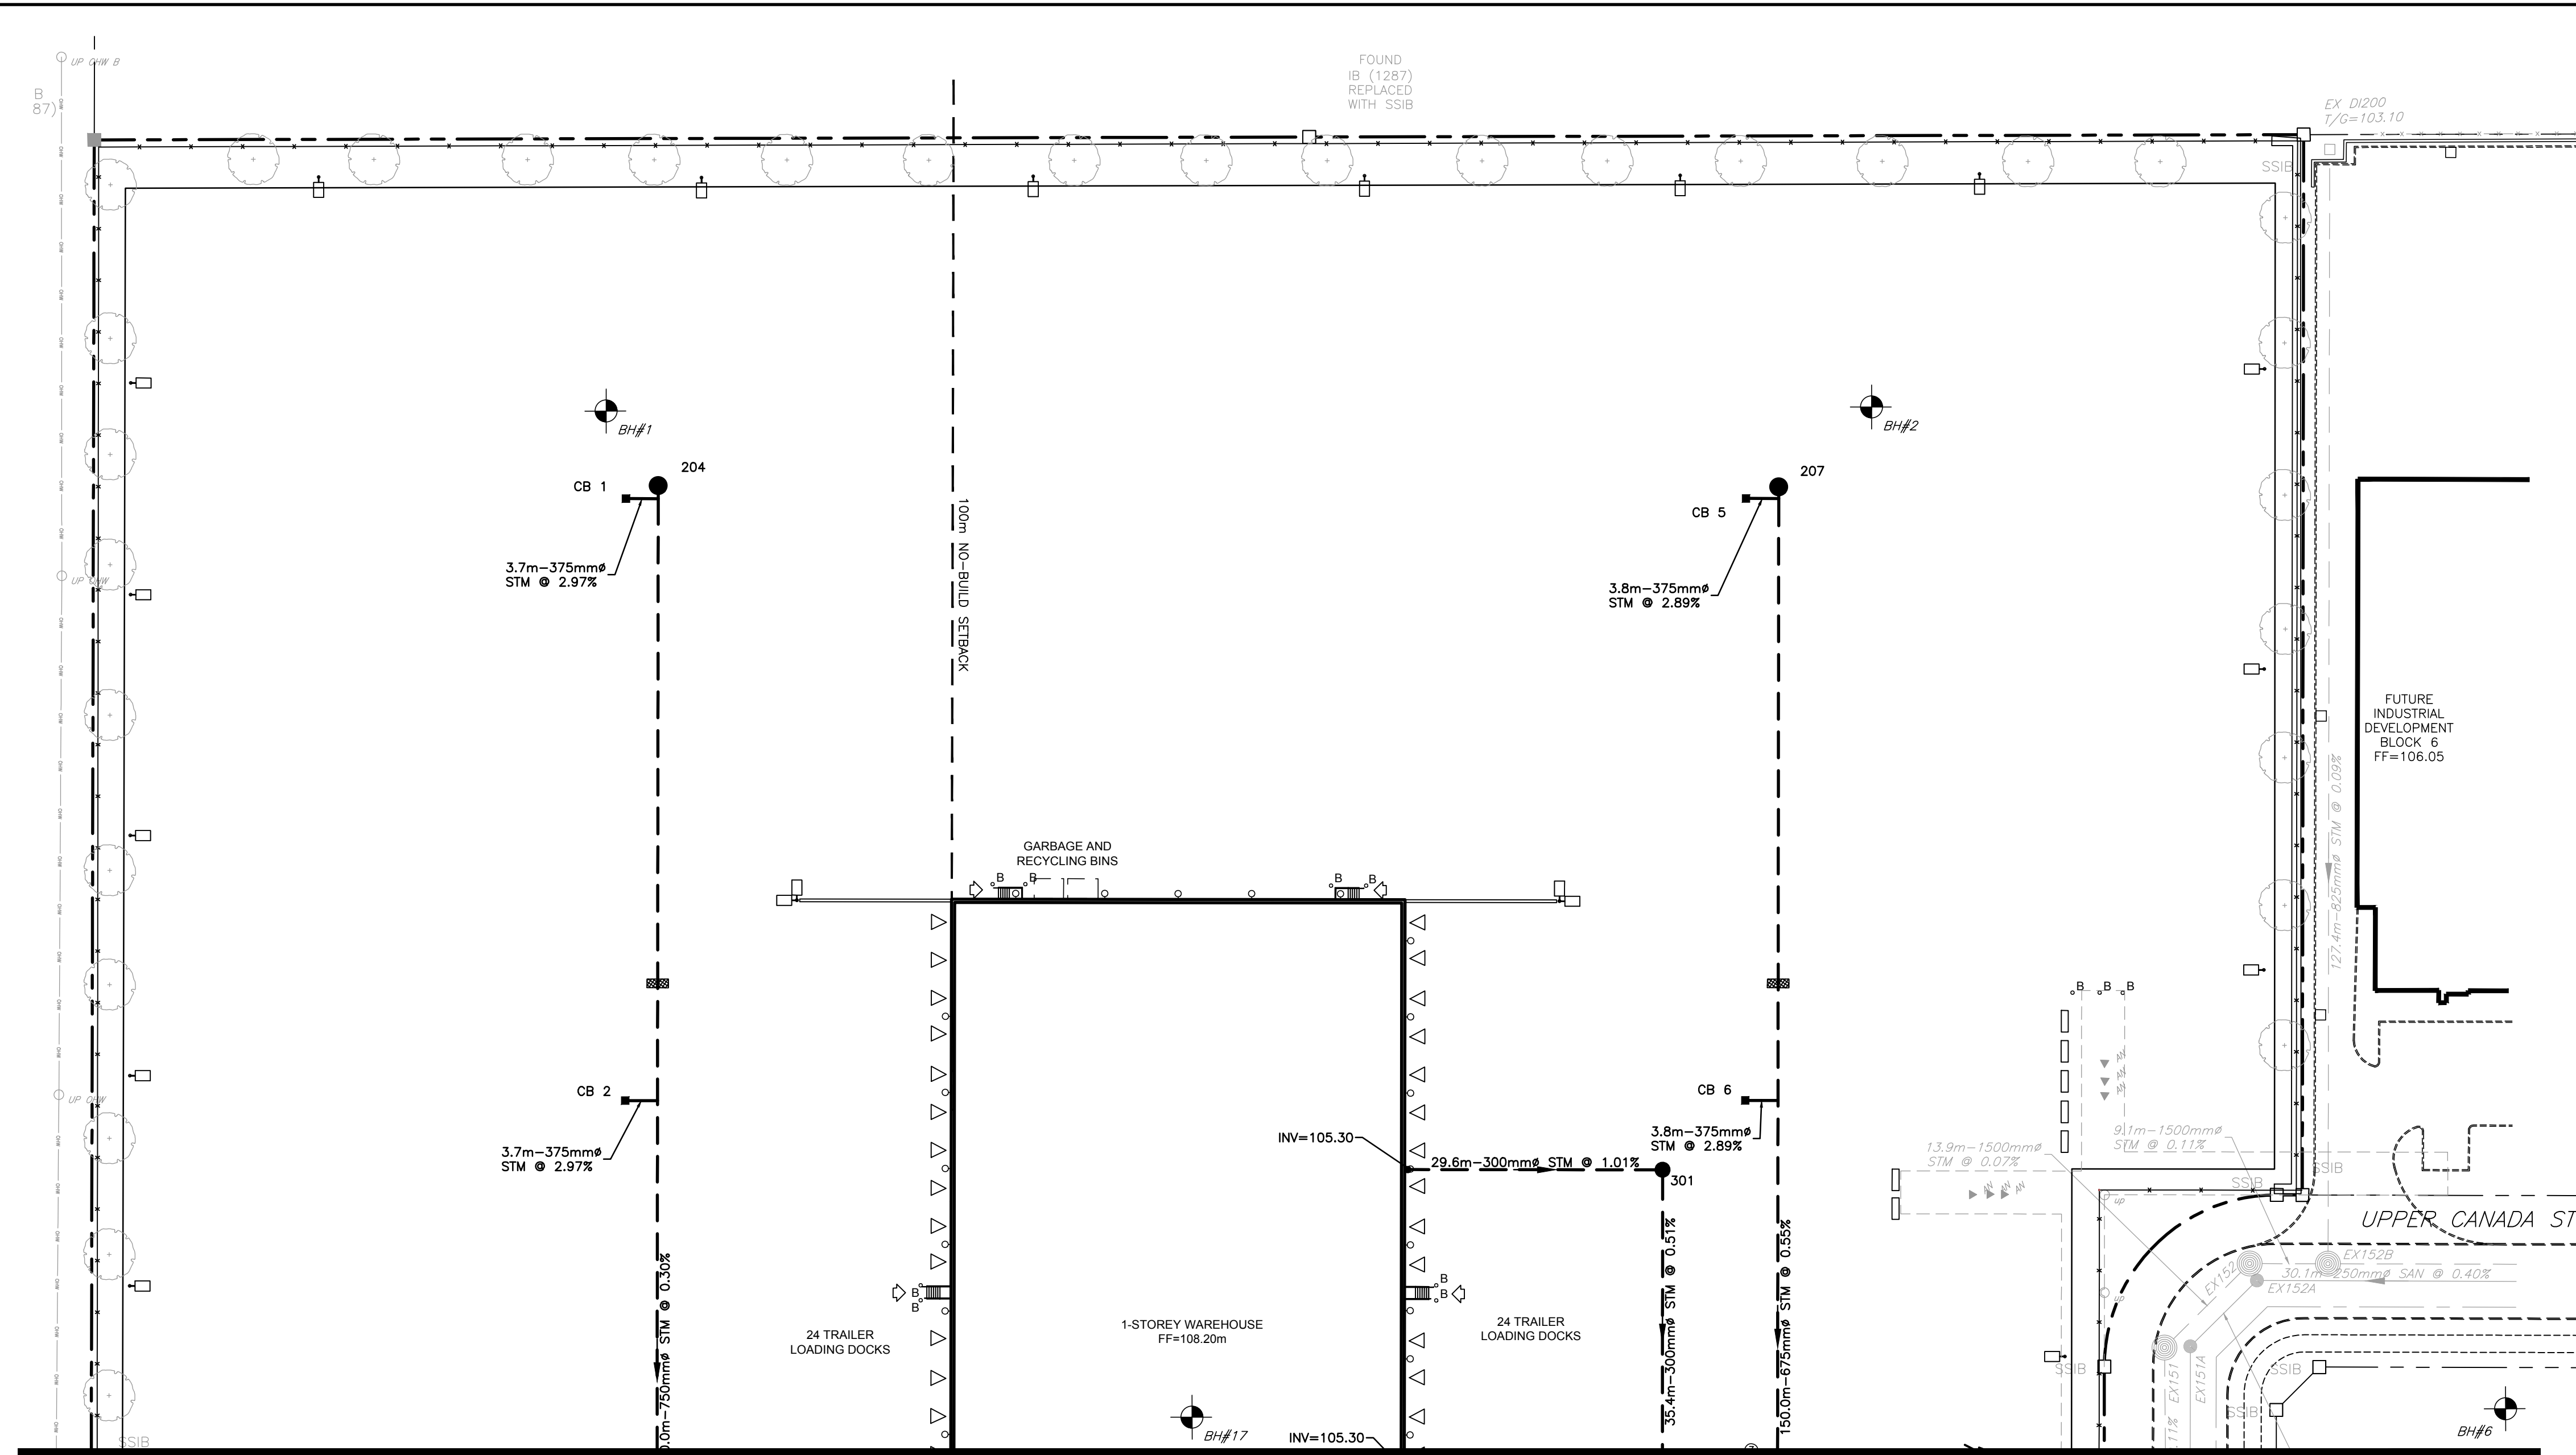

STORM MANHOLE TABLE				
STRUCTURE	STRUCTURE SIZE	T/G ELEV	INVERT	GRATE
EX101	2400mm#	105.88	SW=101.44 E=101.41 NW=101.86	S24.1
200	2400mm#	105.88	NW=103.82 SW=102.04 SE=101.98	S24.1
201	1500mm#	106.37	SW=102.67 NW=103.24 NE=102.64	S24.1
202	1800mm#	106.43	NW=102.96 NE=102.90	S24.1
203	1500mm#	106.35	NW=103.32 SE=103.29	S24.1
204	1500mm#	106.46	SE=103.76	S24.1
205	1800mm#	106.23	NW=102.42 SW=102.34 NE=102.19	S24.1
206	1500mm#	106.33	NW=102.96 SE=102.93	S24.1
207	1500mm#	106.46	SE=103.78	S24.1
208	1200mm#	106.66	NW=105.13 SE=105.08	S24.1
300	1200mm#	106.44	NW=104.94 SW=105.00	S24.1
301	1200mm#	106.47	SE=104.94 SW=105.00	S24.1
302	1200mm#	106.55	SE=104.76 NE=104.68 NW=104.76 SW=104.76	S24.1
303	1200mm#	106.76	SW=104.56 SE=104.50 SE=105.18	S24.1
304	1200mm#	106.48	NW=104.12 SE=104.09 NW=104.84	S24.1

SANITARY MANHOLE TABLE				
STRUCTURE	STRUCTURE SIZE	T/G ELEV	INVERT	GRATE
100	1200mm#	106.28	NW=104.49 SE=104.46	S24
101	1200mm#	106.28	SE=104.66 NW=104.69	S24

CATCH BASIN TABLE				
STRUCTURE	STRUCTURE SIZE	T/G ELEV	INVERT	GRATE
CB 1	600x600mm	106.42	NE=104.74	S19
CB 2	600x600mm	106.32	NE=104.64	S19
CB 3	600x600mm	106.22	NE=104.54	S19
CB 4	600x600mm	106.15	NE=104.47	S19
CB 5	600x600mm	106.42	NE=104.74	S19
CB 6	600x600mm	106.32	NE=104.64	S19
CB 7	600x600mm	106.22	NE=104.54	S19
CB 8	600x600mm	105.95	NE=104.27	S19
CB 9	600x600mm	107.10	NE=105.42	S19
CB 10	600x600mm	106.64	NE=105.13	S19
CB 11	600x600mm	106.06	SE=104.38	S19
CB 12	600x600mm	107.10	SW=105.42	S19
CB 13	600x600mm	106.64	SW=104.96	S19
CB 14	600x600mm	106.06	SE=104.38	S19
CB 16	600x600mm	106.61	SW=105.41	S19
DICB 15	600x600mm	106.42	SW=104.67 NE=105.15	403.010
DICB 17	600x600mm	106.50	NE=104.75	403.010

ICD DESIGN TABLE				
STRUCTURE	100 YEAR OUTFLOW (L/s)	100 YEAR HEAD (m)	ORIFICE DIAMETER (mm)	TYPE
CB 1	120	1.78	204.1	SLIDE
CB 2	60	1.79	144.1	SLIDE
CB 3	80	1.79	166.4	SLIDE
CB 4	60	1.81	143.8	SLIDE
CB 5	120	1.78	204.1	SLIDE
CB 6	60	1.77	144.5	SLIDE
CB 7	30	1.83	101.4	SLIDE
CB 8	25	1.83	92.6	SLIDE
CB 9	55	1.66	140.8	SLIDE
CB 10	30	1.58	105.3	SLIDE
CB 11	25	1.74	93.8	SLIDE
CB 12	40	1.66	120.1	SLIDE
CB 13	30	1.75	102.6	SLIDE
CB 14	25	1.74	93.8	SLIDE
DICB 15	20	1.63	85.3	SLIDE
DICB 17	20	1.63	85.3	SLIDE


- LEGEND**
- PROPERTY BOUNDARY
 - CATCH BASIN
 - STORM SEWER & MANHOLE
 - SANITARY SEWER & MANHOLE
 - WATERMAIN
 - ◆ HYDRANT
 - ⊕ VALVE & VALVE BOX
 - ⊕ SIAMESE CONNECTION
 - EXISTING CATCH BASIN
 - EXISTING STORM SEWER & MANHOLE
 - EXISTING SANITARY SEWER & MANHOLE
 - EXISTING WATERMAIN
 - ◆ EXISTING HYDRANT
 - ⊕ EXISTING VALVE & VALVE BOX
 - 100m NO-BUILD SETBACK
 - ▨ CLAY SEAL
 - ⊕ BOREHOLE
 - ⊕ CROSSING NUMBER
 - GALVANIZED CHAIN LINK FENCE (REFER TO SITE PLAN)
 - GALVANIZED W-BEAM GUARDRAIL (OPSD 912.130)
 - △ BUILDING ENTRANCE (REFER TO SITE PLAN)
 - BOLLARD (REFER TO SITE PLAN)
 - BH POST-MOUNTED BLOCK HEATER (REFER TO SITE PLAN)
 - LIGHT STANDARD (REFER TO SITE PLAN)
 - JERSEY BARRIER (REFER TO SITE PLAN)
 - TWSI (REFER TO SITE PLAN)
 - PROPOSED TREE (REFER TO LANDSCAPE PLAN)

MATCHLINE
REFER TO DWG. 20027-S1

NOTES

THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

NO.	REVISION DESCRIPTION	DATE	BY
5	REVISED PER COMMENTS	09/08/21	SMC
4	ISSUED FOR TENDER	11/06/21	SMC
3	REVISED PER COMMENTS	28/05/21	SMC
2	ISSUED FOR PROGRESS REVIEW	22/03/21	SMC
1	ISSUED FOR SITE PLAN APPLICATION	02/12/20	SMC

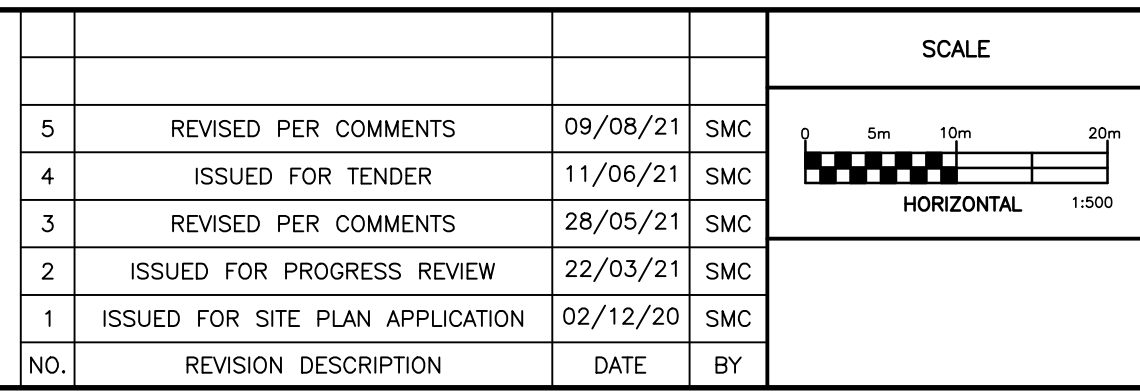

Robinson Land Development

350 Palladium Drive
Ottawa, ON K2V 1A8
(613) 592-6060 rcii.com

DESIGN

BLM
CHECKED SMC
DRAWN BLM
CHECKED SMC
APPROVED SMC

MARITIME-ONTARIO FREIGHT LINES LIMITED

KANATA WEST BUSINESS PARK
8800 CAMPEAU DRIVE, OTTAWA, ON





NOT FOR CONSTRUCTION

SERVICING PLAN


PROJECT No.	20027
SURVEY	STANTEC
DATED	AUGUST 2021
DWG. No.	20027-S2

#18376

MATCHLINE
REFER TO DWG. 20027-GR3

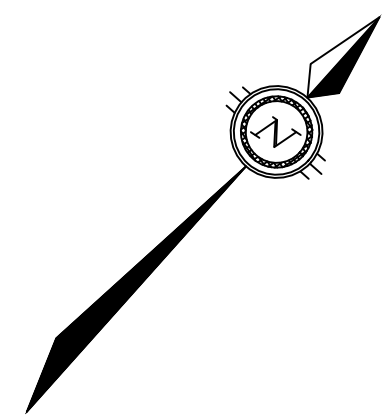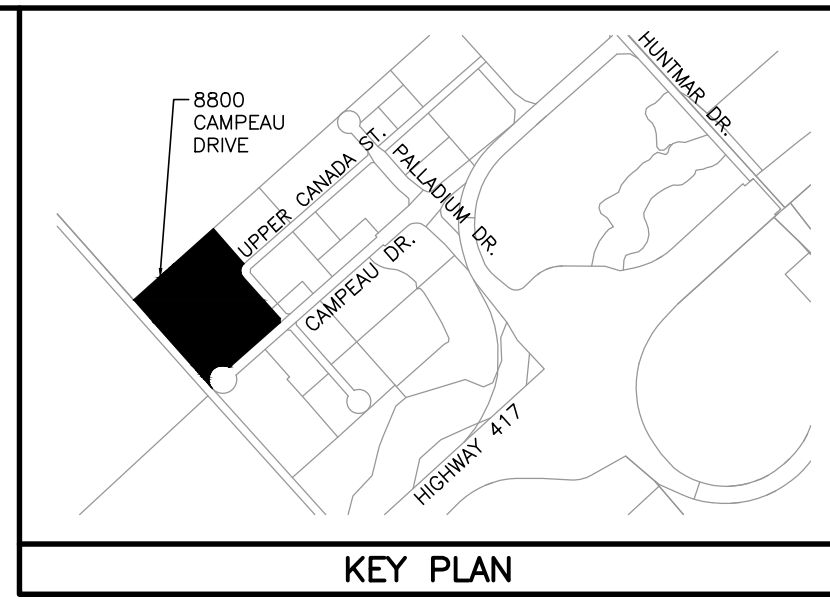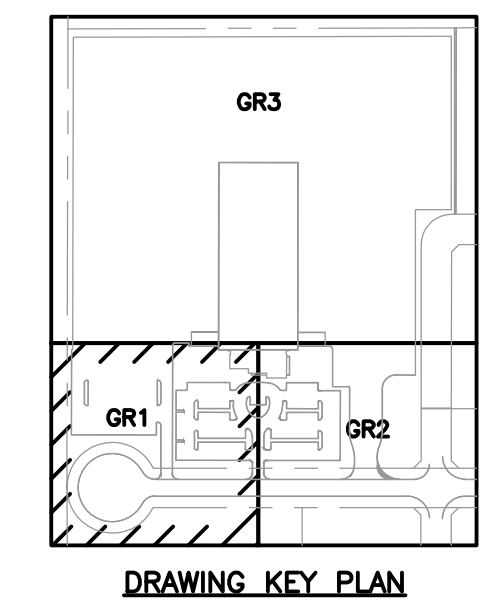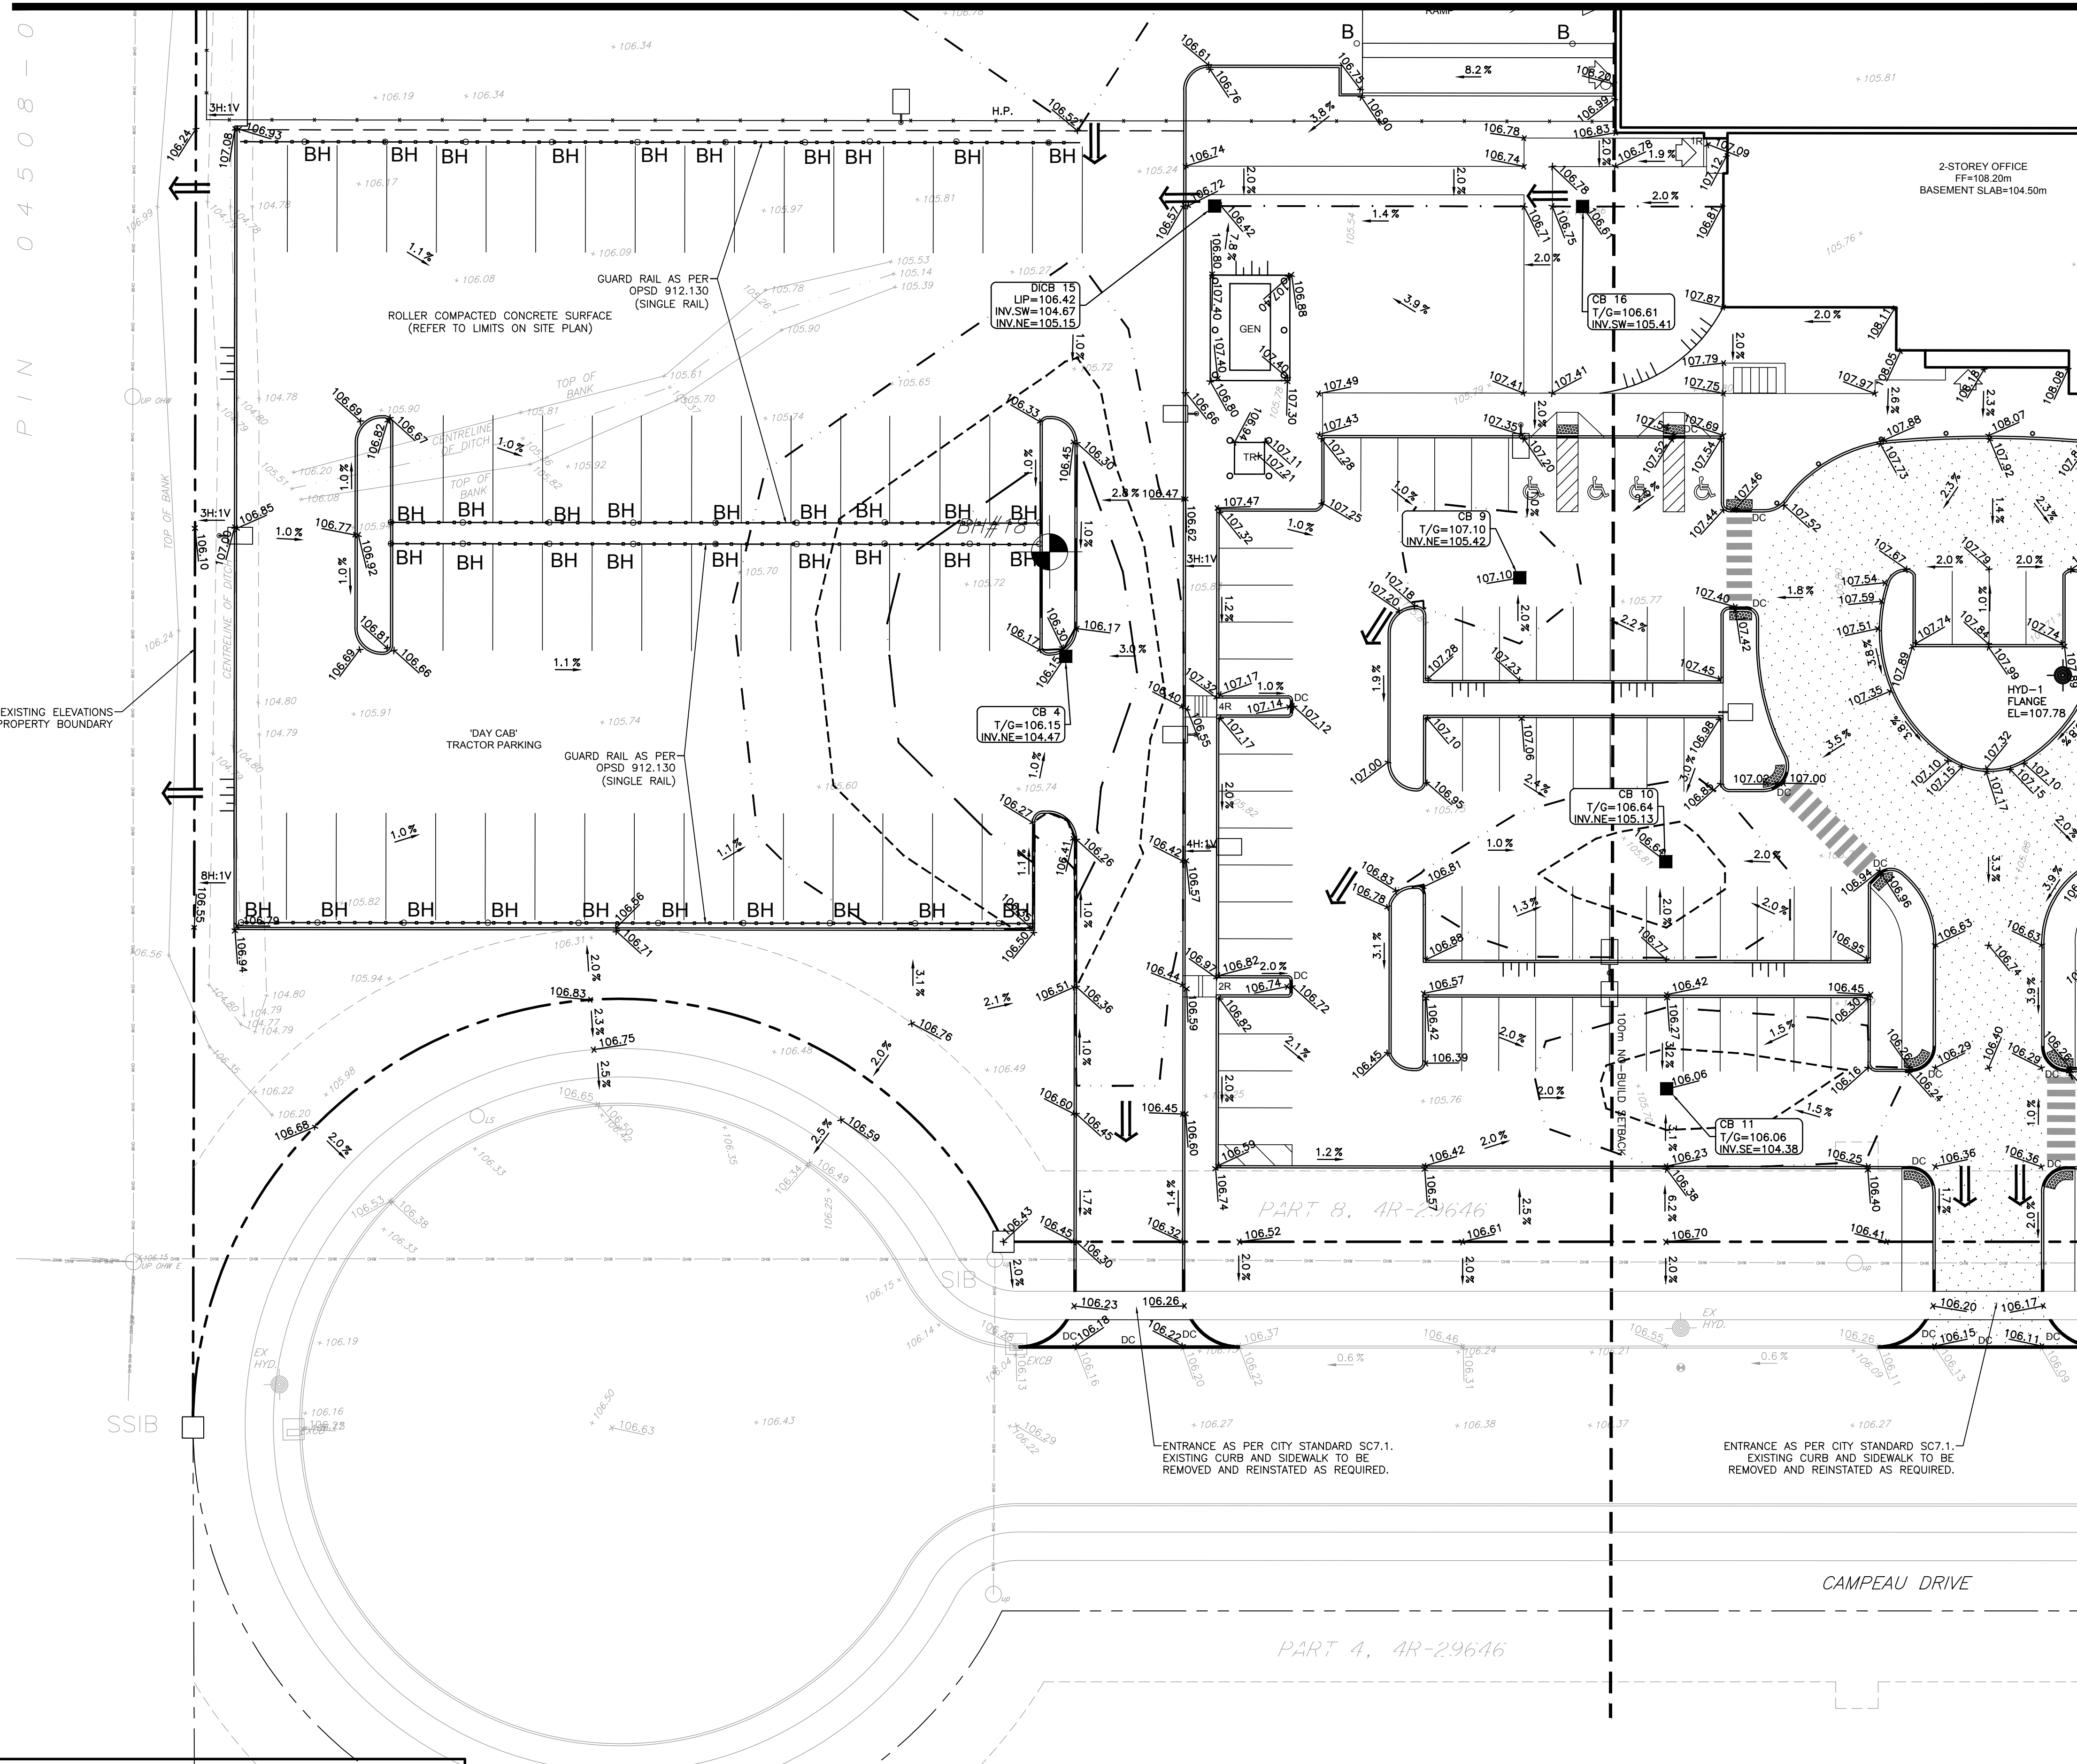


- LEGEND**
- +106.00 EXISTING ELEVATION
 - x107.00 PROPOSED GRADE
 - 2.0% PROPOSED DRAINAGE SLOPE AND DIRECTION
 - x107.00 IBI GROUP DESIGN GRADE
 - PROPERTY BOUNDARY
 - CATCH BASIN
 - EXISTING CATCH BASIN
 - EXISTING HYDRANT
 - SWALE
 - H.P.- HIGH POINT
 - DC DEPRESSED CURB
 - TERRACING (3H:1V MAX.)
 - 100m NO-BUILD SETBACK
 - 2 YEAR PONDING LIMIT
 - 5 YEAR PONDING LIMIT
 - 100 YEAR PONDING LIMIT
 - BOREHOLE
 - △ BUILDING ENTRANCE (REFER TO SITE PLAN)
 - GALVANIZED CHAIN LINK FENCE (REFER TO SITE PLAN)
 - GALVANIZED W-BEAM GUARDRAIL (OPSD 912.130)
 - B BOLLARD (REFER TO SITE PLAN)
 - BH POST-MOUNTED BLOCK HEATER (REFER TO SITE PLAN)
 - LIGHT STANDARD (REFER TO SITE PLAN)
 - TWIS (REFER TO SITE PLAN)
 - MAJOR OVERLAND FLOW ROUTE
 - HEAVY DUTY ASPHALT LIMITS

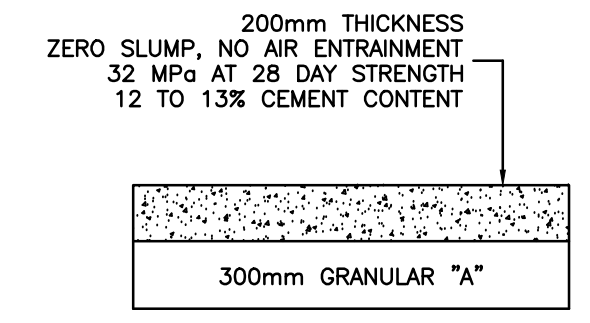

NOTE:
1. REFER TO GEOTECHNICAL INVESTIGATION PREPARED BY PATERSON GROUP, REPORT PG5618-1, DATED APRIL 9, 2021.
2. REFER TO LIMITS OF INSTALLATION ON SITE PLAN.

ROLLER COMPACTED CONCRETE PAVEMENT STRUCTURE DETAIL
N.T.S.

50mm WEAR COURSE - HL 3 OR SUPERPAVE 12.5 ASPHALTIC CONCRETE
40mm WEAR COURSE - SUPERPAVE 12.5 ASPHALTIC CONCRETE
50mm BINDER COURSE - SUPERPAVE 19.0 ASPHALTIC CONCRETE

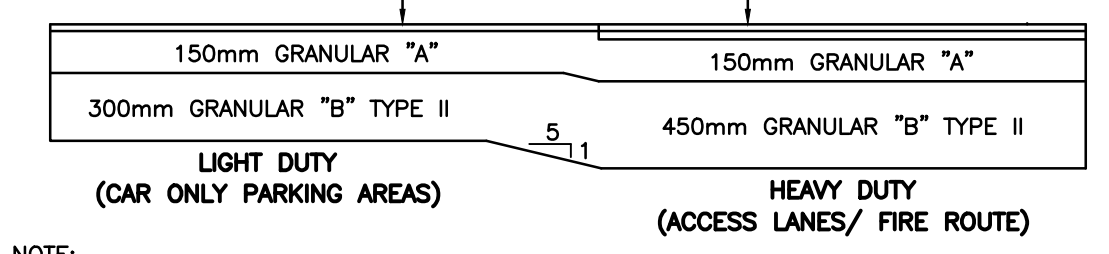

NOTE:
1. REFER TO GEOTECHNICAL INVESTIGATION PREPARED BY PATERSON GROUP, REPORT PG5618-1, DATED APRIL 9, 2021.
2. REFER TO LIMITS OF INSTALLATION ON SITE PLAN.


ASPHALT PAVEMENT STRUCTURE DETAIL
N.T.S.

LOCATION	SURFACE STORAGE AREAS								
	2 YEAR			5 YEAR			100 YEAR		
	STORAGE VOLUME (m³)	PONDING DEPTH (m)	PONDING ELEVATION (m)	STORAGE VOLUME (m³)	PONDING DEPTH (m)	PONDING ELEVATION (m)	STORAGE VOLUME (m³)	PONDING DEPTH (m)	PONDING ELEVATION (m)
CB 4	15.5	0.15	106.30	30.3	0.19	106.34	109.4	0.28	106.43
CB 9	N/A	N/A	N/A	N/A	N/A	N/A	3.7	0.10	107.20
CB 10	N/A	N/A	N/A	1.8	0.09	106.73	16.6	0.19	106.83
CB 11	N/A	N/A	N/A	2.1	0.09	106.15	15.7	0.18	106.24
DICB 15	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
CB 16	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

NOT FOR CONSTRUCTION

NOTES
THE POSITION OF ALL POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

NO.	REVISION DESCRIPTION	DATE	BY
5	REVISED PER COMMENTS	09/08/21	SMC
4	ISSUED FOR TENDER	11/06/21	SMC
3	REVISED PER COMMENTS	28/05/21	SMC
2	ISSUED FOR PROGRESS REVIEW	22/03/21	SMC
1	ISSUED FOR SITE PLAN APPLICATION	02/12/20	SMC

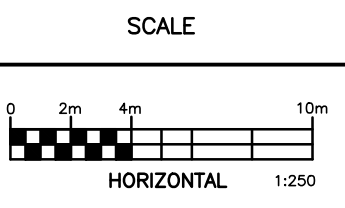

Robinson Land Development
350 Palladium Drive
Ottawa, ON K2V 1A8
(613) 592-6060 roii.com





DESIGN	BLM
CHECKED	SMC
DRAWN	BLM
CHECKED	SMC
APPROVED	SMC

MARITIME-ONTARIO FREIGHT LINES LIMITED
KANATA WEST BUSINESS PARK
8800 CAMPEAU DRIVE, OTTAWA, ON

GRADING PLAN


PROJECT No.	20027
SURVEY	STANTEC
DATED	AUGUST 2021
DWG. No.	20027-GR1

MATCHLINE
REFER TO DWG. 20027-GR3

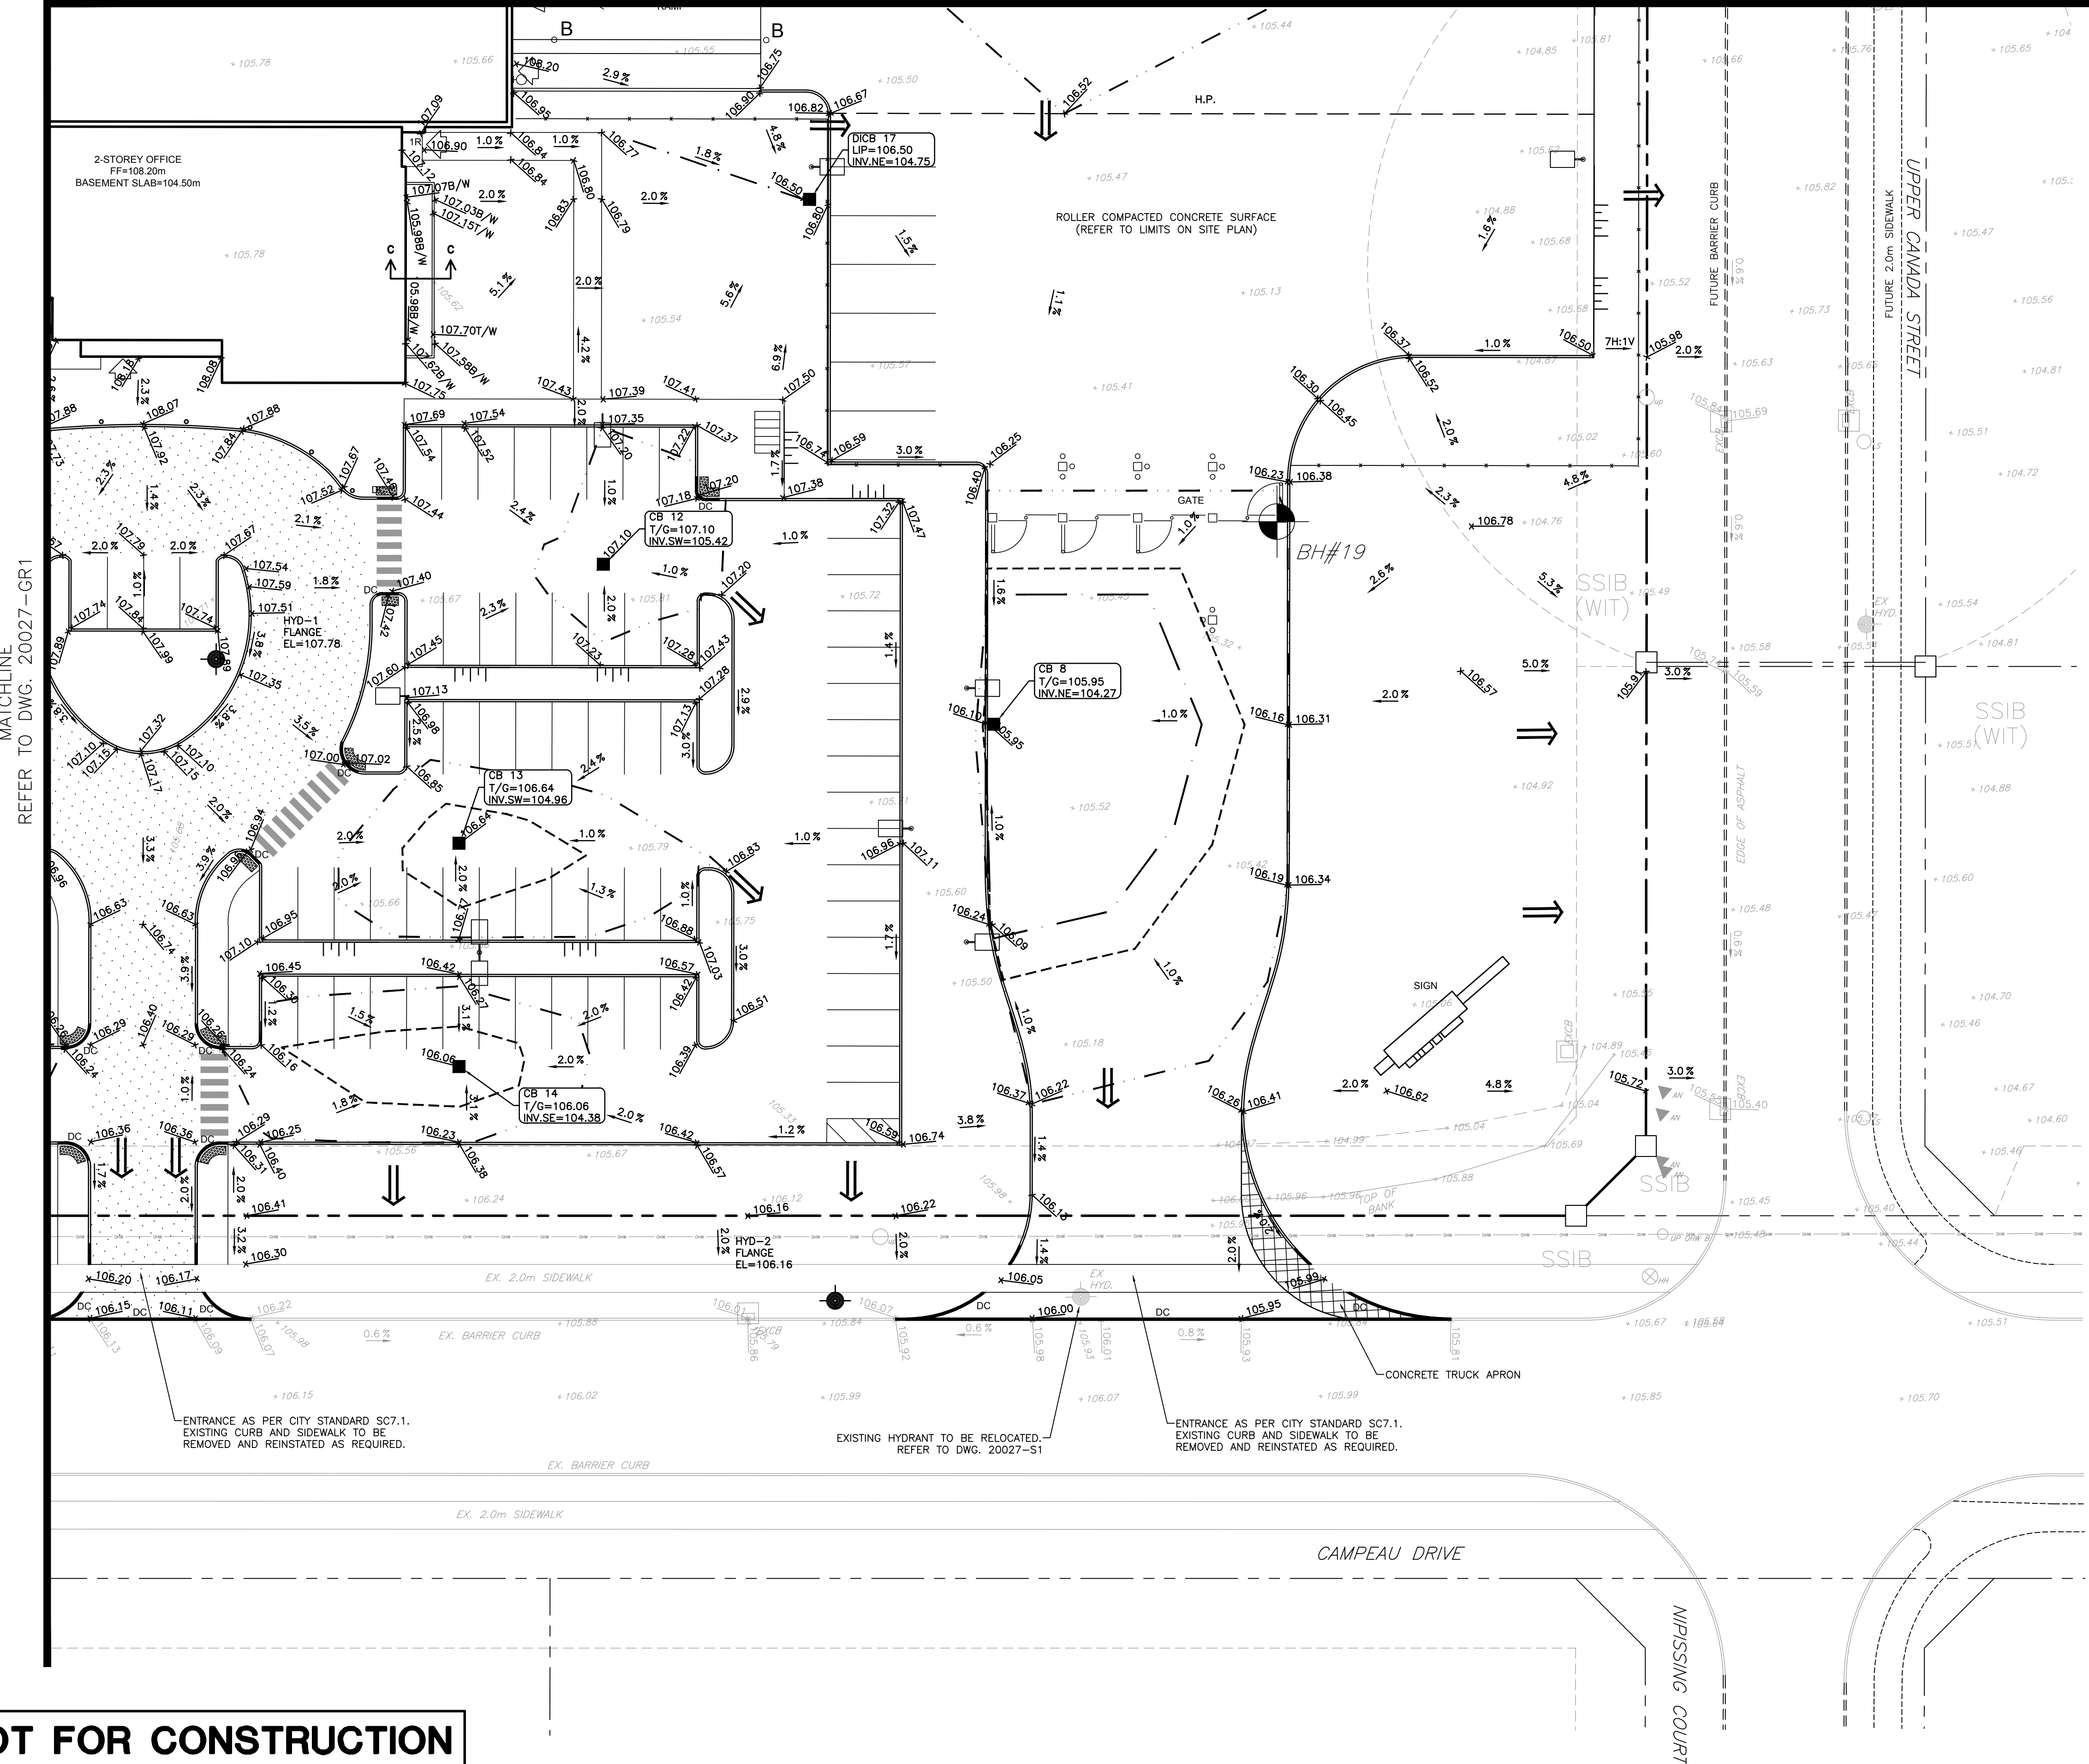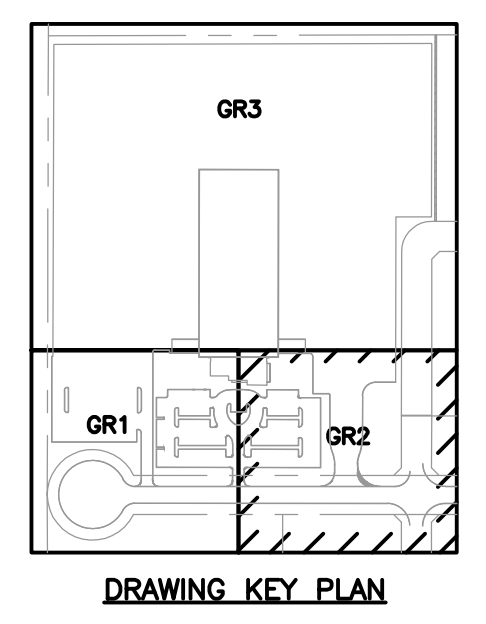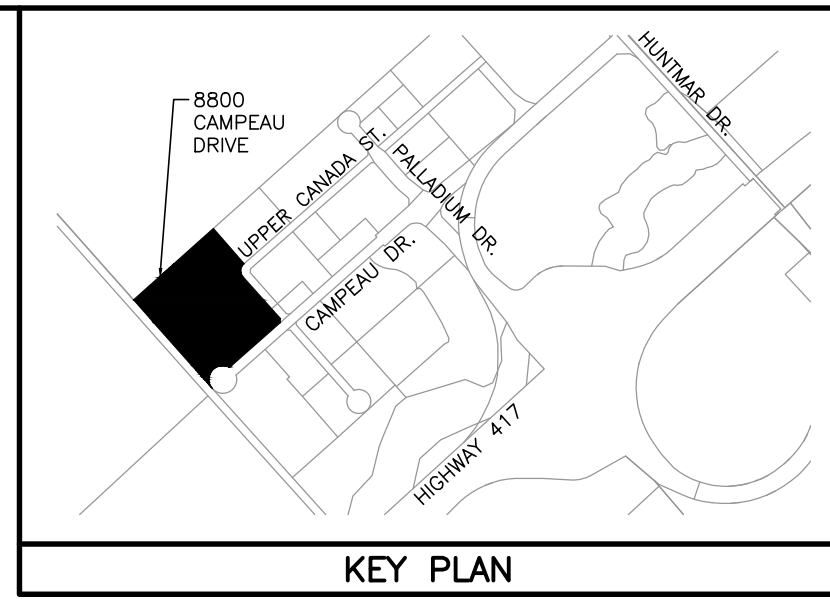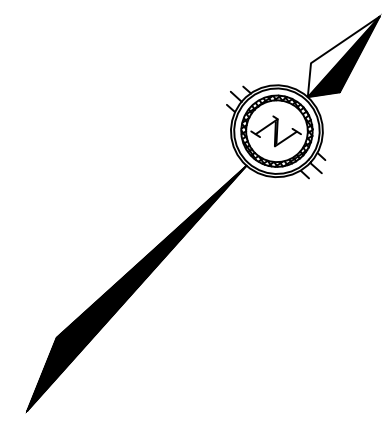


LEGEND

- EXISTING ELEVATION
- PROPOSED GRADE
- PROPOSED DRAINAGE SLOPE AND DIRECTION
- IBI GROUP DESIGN GRADE
- PROPERTY BOUNDARY
- CATCH BASIN
- EXISTING CATCH BASIN
- EXISTING HYDRANT
- SWALE
- H.P. HIGH POINT
- DC DEPRESSED CURB
- TERRACING (3H:1V MAX.)
- 100m NO-BUILD SETBACK
- 2 YEAR PONDING LIMIT
- 5 YEAR PONDING LIMIT
- 100 YEAR PONDING LIMIT
- BOREHOLE
- BUILDING ENTRANCE (REFER TO SITE PLAN)
- GALVANIZED CHAIN LINK FENCE (REFER TO SITE PLAN)
- GALVANIZED W-BEAM GUARDRAIL (OPSD 912.130)
- BOLLARD (REFER TO SITE PLAN)
- POST-MOUNTED BLOCK HEATER (REFER TO SITE PLAN)
- LIGHT STANDARD (REFER TO SITE PLAN)
- TWSI (REFER TO SITE PLAN)
- MAJOR OVERLAND FLOW ROUTE
- HEAVY DUTY ASPHALT LIMITS

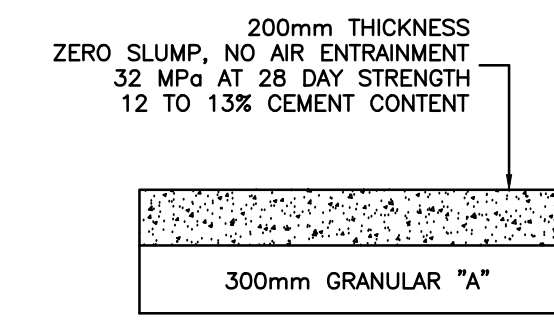


- NOTE:
- REFER TO GEOTECHNICAL INVESTIGATION PREPARED BY PATERSON GROUP, REPORT PG5618-1, DATED APRIL 9, 2021.
 - REFER TO LIMITS OF INSTALLATION ON SITE PLAN.

ROLLER COMPACTED CONCRETE PAVEMENT STRUCTURE DETAIL
N.T.S.

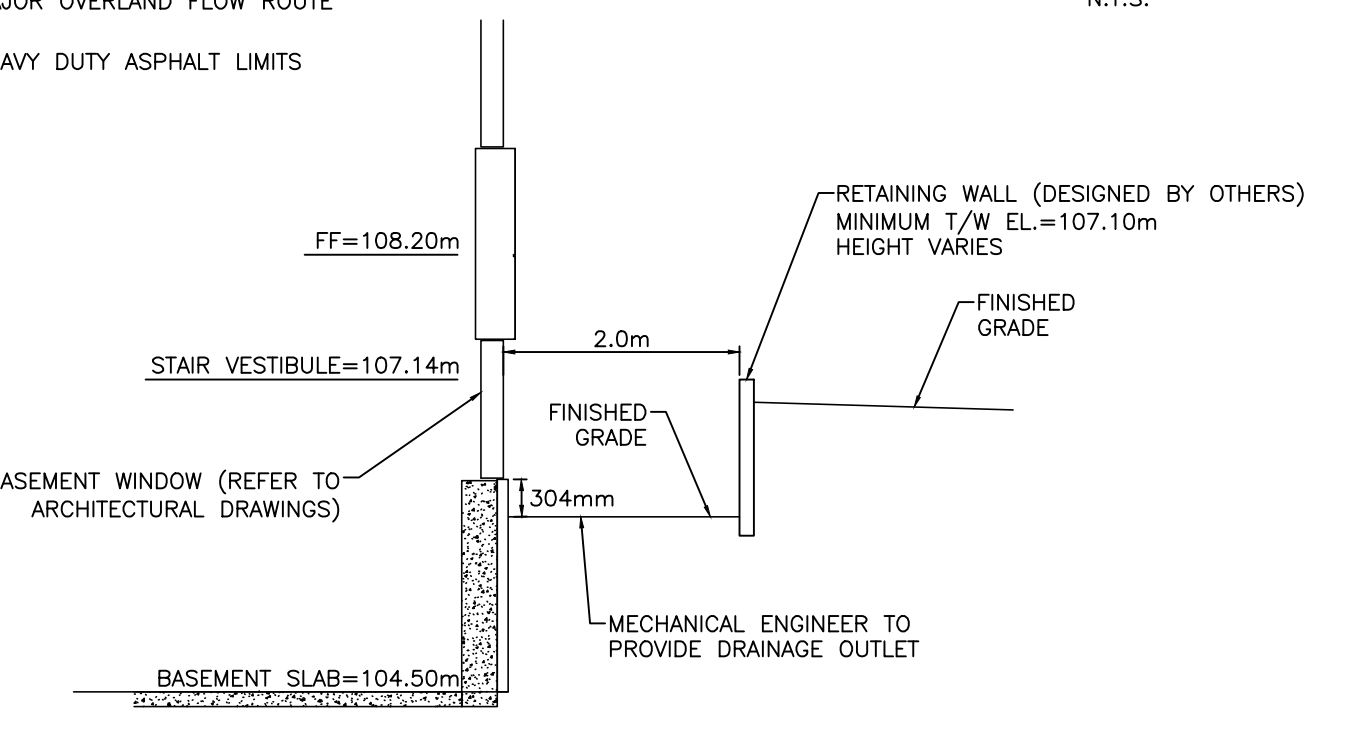

WINDOW WELL SECTION C-C
N.T.S.

- 50mm WEAR COURSE - HL 3 OR SUPERPAVE 12.5 ASPHALTIC CONCRETE
- 40mm WEAR COURSE - SUPERPAVE 12.5 ASPHALTIC CONCRETE
- 50mm BINDER COURSE - SUPERPAVE 19.0 ASPHALTIC CONCRETE

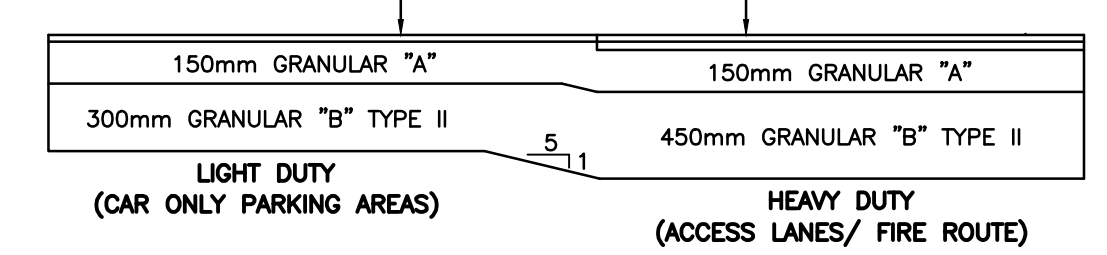

ASPHALT PAVEMENT STRUCTURE DETAIL
N.T.S.


- NOTE:
- REFER TO GEOTECHNICAL INVESTIGATION PREPARED BY PATERSON GROUP, REPORT PG5618-1, DATED APRIL 9, 2021.
 - REFER TO LIMITS OF INSTALLATION ON SITE PLAN.

LOCATION	2 YEAR			5 YEAR			100 YEAR		
	STORAGE VOLUME (m³)	PONDING DEPTH (m)	PONDING ELEVATION (m)	STORAGE VOLUME (m³)	PONDING DEPTH (m)	PONDING ELEVATION (m)	STORAGE VOLUME (m³)	PONDING DEPTH (m)	PONDING ELEVATION (m)
CB 8	15.3	0.15	106.10	26.5	0.18	106.13	86.7	0.27	106.22
CB 12	N/A	N/A	N/A	N/A	N/A	N/A	4.6	0.10	107.20
CB 13	N/A	N/A	N/A	1.8	0.09	106.73	16.6	0.19	106.83
CB 14	N/A	N/A	N/A	2.1	0.09	106.15	15.7	0.18	106.24
CB 17	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

NOT FOR CONSTRUCTION

NOTES
THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

NO.	REVISION DESCRIPTION	DATE	BY
5	REVISED PER COMMENTS	09/08/21	SMC
4	ISSUED FOR TENDER	11/06/21	SMC
3	REVISED PER COMMENTS	28/05/21	SMC
2	ISSUED FOR PROGRESS REVIEW	22/03/21	SMC
1	ISSUED FOR SITE PLAN APPLICATION	02/12/20	SMC

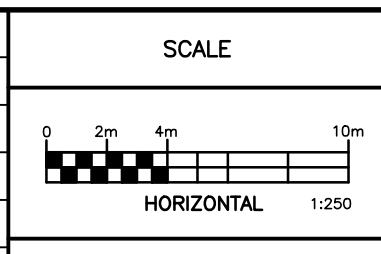

Robinson
Land Development

350 Palladium Drive
Ottawa, ON K2V 1A8
(613) 592-6060 rcii.com





DESIGN	BLM
CHECKED	SMC
DRAWN	BLM
CHECKED	SMC
APPROVED	SMC

MARITIME-ONTARIO
FREIGHT LINES LIMITED


KANATA WEST BUSINESS PARK
8800 CAMPEAU DRIVE, OTTAWA, ON

GRADING PLAN

PROJECT No.	20027
SURVEY	STANTEC
DATED	AUGUST 2021
DWG. No.	20027-GR2

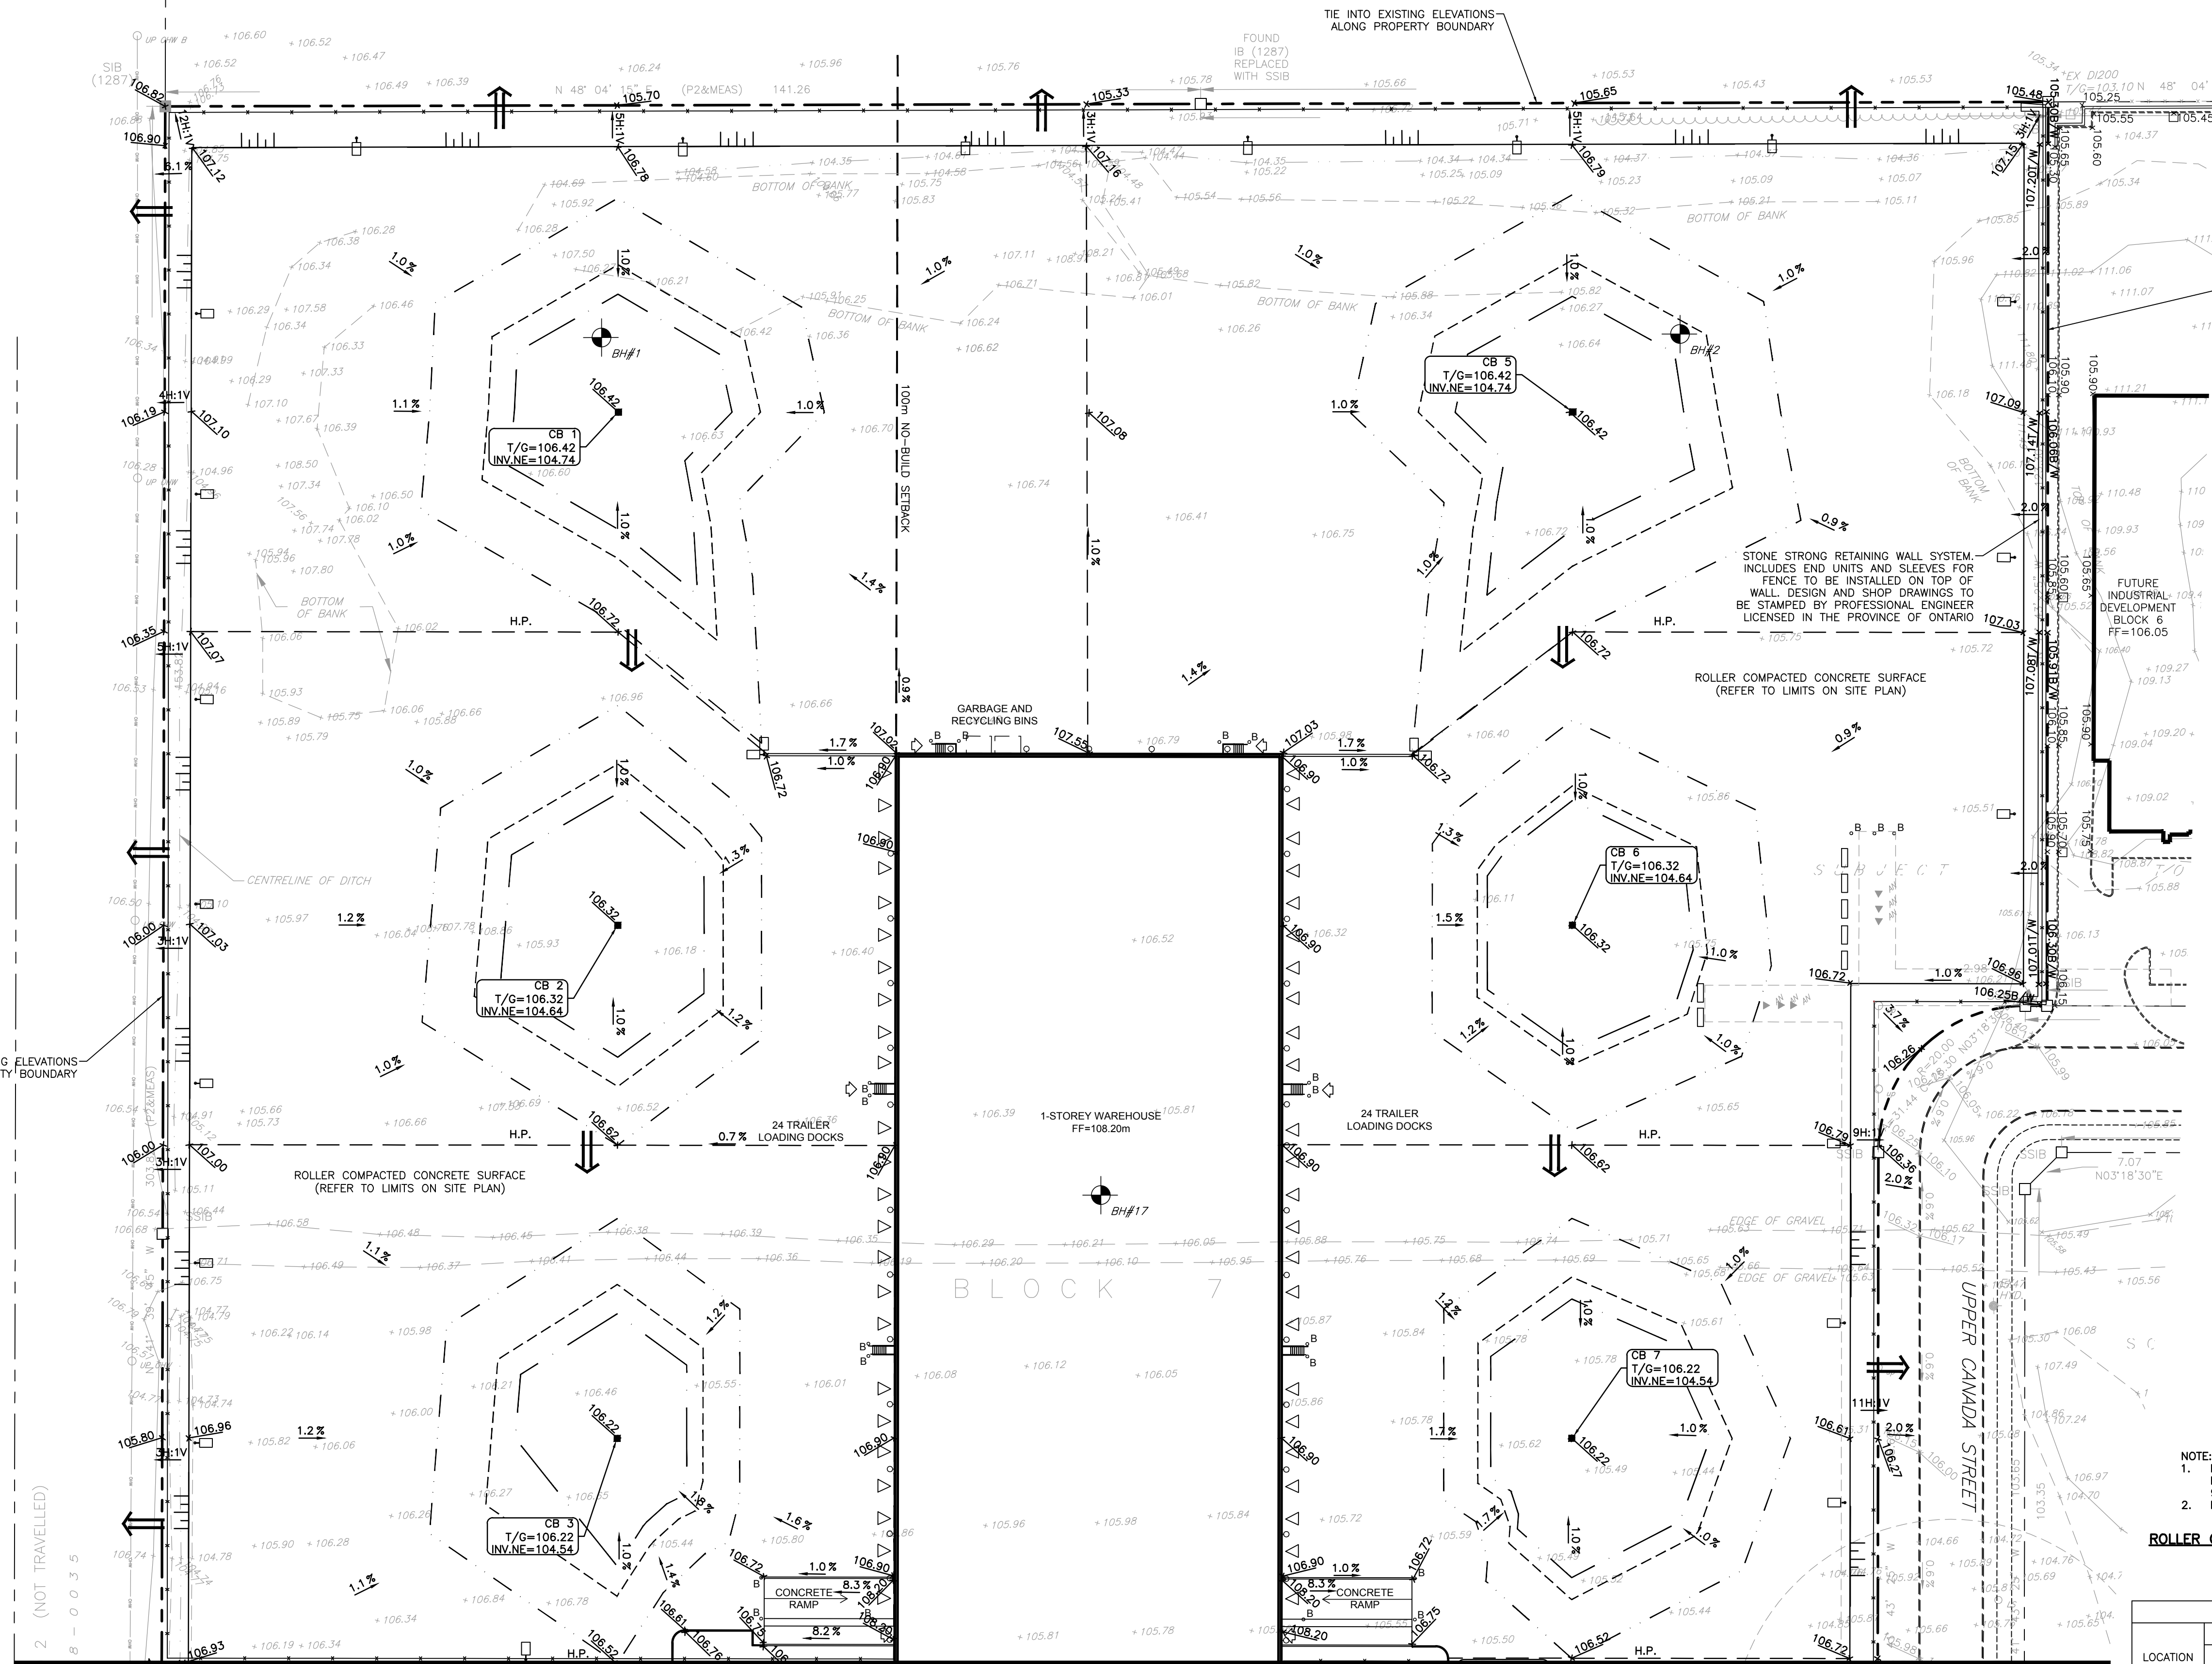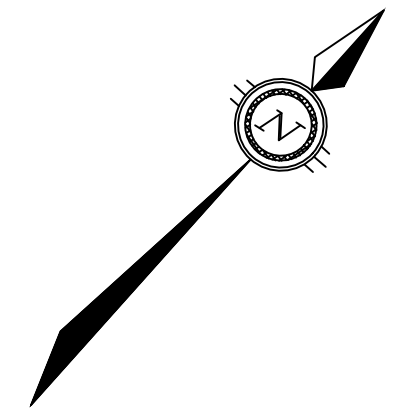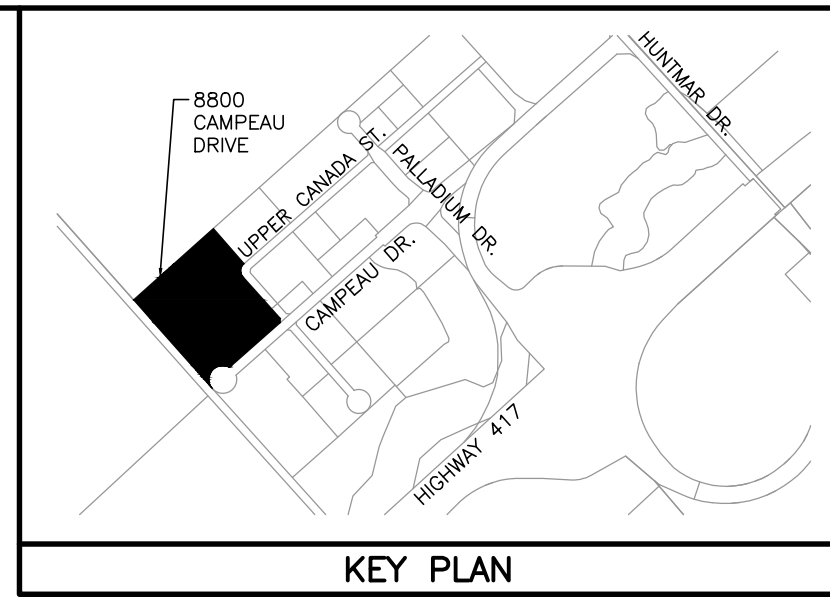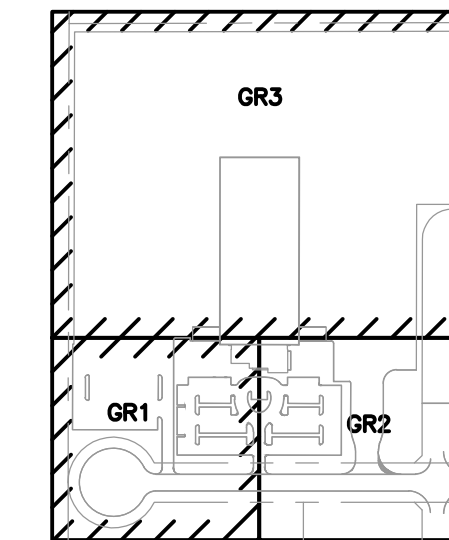

- LEGEND**
- + 106.00 EXISTING ELEVATION
 - x 107.00 PROPOSED GRADE
 - 2.0% PROPOSED DRAINAGE SLOPE AND DIRECTION
 - x 107.00 IBI GROUP DESIGN GRADE
 - PROPERTY BOUNDARY
 - CATCH BASIN
 - EXISTING CATCH BASIN
 - EXISTING HYDRANT
 - SWALE
 - H.P. HIGH POINT
 - DC DEPRESSED CURB
 - TERRACING (3H:1V MAX.)
 - RETAINING WALL
 - 100m NO-BUILD SETBACK
 - 2 YEAR PONDING LIMIT
 - 5 YEAR PONDING LIMIT
 - 100 YEAR PONDING LIMIT
 - BOREHOLE
 - △ BUILDING ENTRANCE (REFER TO SITE PLAN)
 - GALVANIZED CHAIN LINK FENCE (REFER TO SITE PLAN)
 - GALVANIZED W-BEAM GUARDRAIL (OPSD 912.130)
 - B BOLLARD (REFER TO SITE PLAN)
 - BH POST-MOUNTED BLOCK HEATER (REFER TO SITE PLAN)
 - LIGHT STANDARD (REFER TO SITE PLAN)
 - TWSI (REFER TO SITE PLAN)
 - MAJOR OVERLAND FLOW ROUTE
 - HEAVY DUTY ASPHALT LIMITS

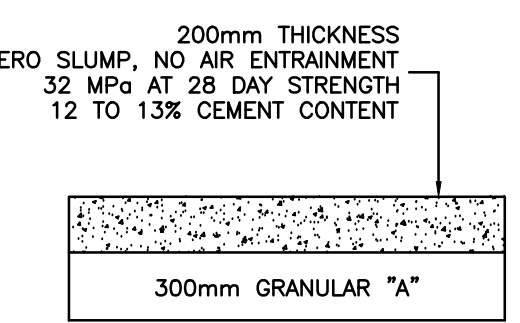

NOTE:
 1. REFER TO GEOTECHNICAL INVESTIGATION PREPARED BY PATERSON GROUP, REPORT PG5618-1, DATED APRIL 9, 2021.
 2. REFER TO LIMITS OF INSTALLATION ON SITE PLAN.

ROLLER COMPACTED CONCRETE PAVEMENT STRUCTURE DETAIL
N.T.S.



LOCATION	2 YEAR			5 YEAR			100 YEAR		
	STORAGE VOLUME (m³)	PONDING DEPTH (m)	PONDING ELEVATION (m)	STORAGE VOLUME (m³)	PONDING DEPTH (m)	PONDING ELEVATION (m)	STORAGE VOLUME (m³)	PONDING DEPTH (m)	PONDING ELEVATION (m)
CB 1	39.1	0.16	106.58	78.6	0.20	106.62	232.6	0.29	106.71
CB 2	43.4	0.18	106.50	79.2	0.22	106.54	200.8	0.30	106.62
CB 3	29.9	0.17	106.39	63.4	0.21	106.43	184.7	0.30	106.52
CB 5	40.9	0.16	106.58	79.9	0.20	106.62	243.6	0.29	106.71
CB 6	40.3	0.17	106.49	65.2	0.19	106.51	180.2	0.28	106.60
CB 7	50.9	0.19	106.41	83.8	0.22	106.44	200.5	0.30	106.52

NOT FOR CONSTRUCTION

NOTES

THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

NO.	REVISION DESCRIPTION	DATE	BY
5	REVISED PER COMMENTS	09/08/21	SMC
4	ISSUED FOR TENDER	11/06/21	SMC
3	REVISED PER COMMENTS	28/05/21	SMC
2	ISSUED FOR PROGRESS REVIEW	22/03/21	SMC
1	ISSUED FOR SITE PLAN APPLICATION	02/12/20	SMC

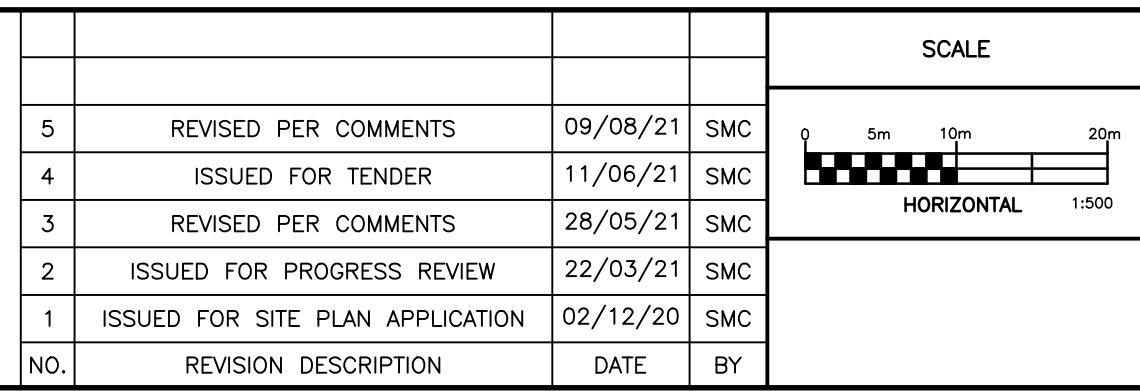

Robinson Land Development

350 Palladium Drive
Ottawa, ON K2V 1A8
(613) 592-6060 roil.com

DESIGN	BLM
CHECKED	SMC
DRAWN	BLM
CHECKED	SMC
APPROVED	SMC





MARITIME-ONTARIO FREIGHT LINES LIMITED

KANATA WEST BUSINESS PARK
8800 CAMPEAU DRIVE, OTTAWA, ON

GRADING PLAN

PROJECT No.	20027
SURVEY	STANTEC
DATED	AUGUST 2021
DWG. No.	20027-GR3

PROJECT No. 20027
 SURVEY STANTEC
 DATED AUGUST 2021
 DWG. No. 20027-GR3

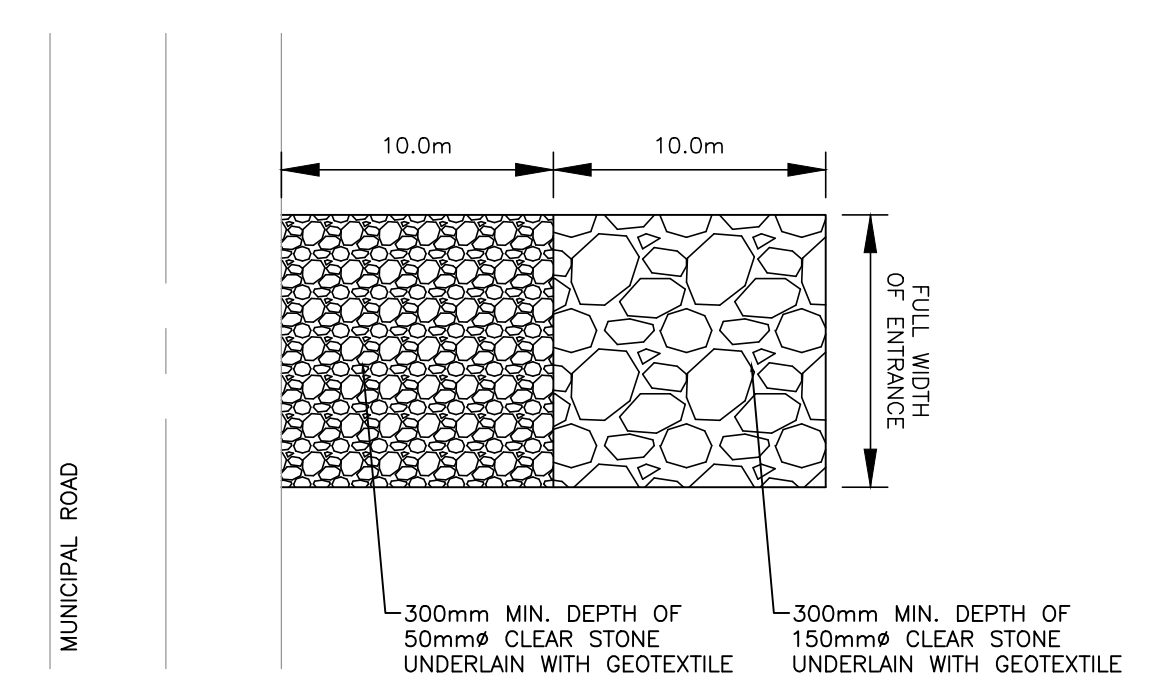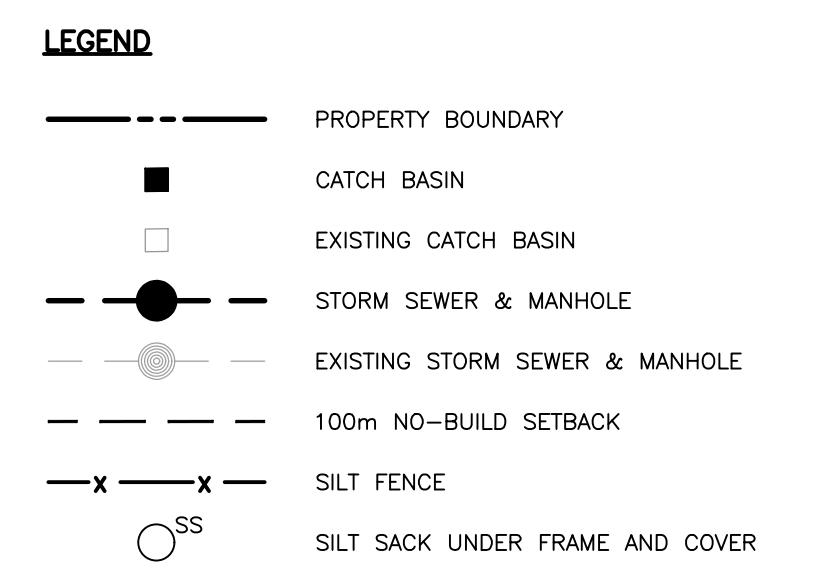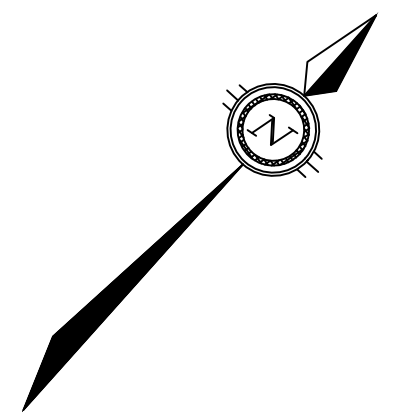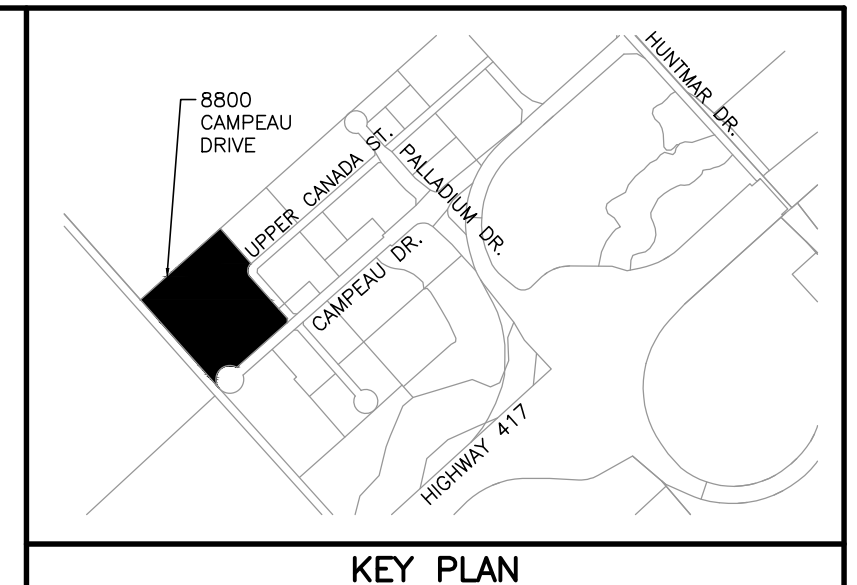


- NOTES:
- MUD MAT TO BE UNDERLAIN WITH A GEOTEXTILE FABRIC.
 - SEDIMENT SHALL BE CLEANED FROM MUNICIPAL RIGHT-OF-WAYS AS REQUIRED.
 - STORM INLETS IN CLOSE VICINITY TO MUD MAT SHALL BE PROTECTED WITH INLET CONTROL MEASURES.


MUD MAT DETAIL
N.T.S.

- NOTES:
- THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE ULTIMATE RECEIVING WATERCOURSE DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
 - LIMIT THE EXTENT OF EXPOSED SOILS AT ANY GIVEN TIME.
 - EROSION AND SEDIMENT CONTROL MEASURES SHALL BE MAINTAINED UNTIL VEGETATION HAS BEEN RE-ESTABLISHED IN ALL DISTURBED AREAS. RE-VEGETATE DISTURBED AREAS IN ACCORDANCE WITH APPROVED LANDSCAPE PLAN AS SOON AS POSSIBLE.
 - STOCKPILE SOIL AWAY (15 METRES OR GREATER) FROM WATERCOURSES, DRAINAGE FEATURES AND TOP OF STEEP SLOPES.
 - SILT SACKS ARE TO BE PLACED UNDERNEATH THE FRAME AND COVER OF ALL PROPOSED AND EXISTING CATCH BASINS AND OPEN COVER STORM MANHOLES UNTIL CONSTRUCTION IS COMPLETED.
 - A SILT FENCE BARRIER SHALL BE INSTALLED AS PER OPSD 219.1100 WHERE INDICATED AND MAINTAINED AS REQUIRED.
 - DURING ACTIVE CONSTRUCTION PERIODS, VISUAL INSPECTIONS SHALL BE UNDERTAKEN ON A WEEKLY BASIS AND AFTER MAJOR STORM EVENTS (>25mm RAIN IN 24 HOUR PERIOD) ON SEDIMENT CONTROL BARRIERS AND ANY DAMAGE REPAIRED IMMEDIATELY.
 - EROSION AND SEDIMENT CONTROL BARRIERS SHALL ALSO BE ASSESSED (AND REPAIRED AS REQUIRED) FOLLOWING SIGNIFICANT SNOWMELT EVENTS.
 - VISUAL INSPECTIONS SHALL ALSO BE UNDERTAKEN IN ANTICIPATION OF LARGE STORM EVENTS (OR A SERIES OF RAINFALL AND/OR SNOWMELT DAYS) THAT COULD POTENTIALLY YIELD SIGNIFICANT RUNOFF VOLUMES.
 - CARE SHALL BE TAKEN TO PREVENT DAMAGE TO EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION OPERATIONS.
 - IN SOME CASES, BARRIERS MAY BE REMOVED TEMPORARILY TO ACCOMMODATE THE CONSTRUCTION OPERATIONS. THE AFFECTED BARRIERS SHALL BE REINSTATED IMMEDIATELY AFTER CONSTRUCTION OPERATIONS ARE COMPLETED.
 - EROSION AND SEDIMENT CONTROL MEASURES SHALL BE ADJUSTED AS REQUIRED AS THE SITE BECOMES DEVELOPED.
 - SEDIMENT CONTROL DEVICES SHALL BE CLEANED OF ACCUMULATED SEDIMENTATION AS REQUIRED AND REPLACED AS NECESSARY.
 - DURING THE COURSE OF CONSTRUCTION, IF THE ENGINEER BELIEVES THAT ADDITIONAL PREVENTION METHODS ARE REQUIRED TO CONTROL EROSION AND SEDIMENTATION, THE CONTRACTOR SHALL IMPLEMENT ADDITIONAL MEASURES, AS REQUIRED, TO THE SATISFACTION OF THE ENGINEER.
 - CONSTRUCTION AND MAINTENANCE REQUIREMENTS FOR EROSION AND SEDIMENT CONTROLS ARE TO COMPLY WITH OPSD 805.
 - MUD MATS SHALL BE INSTALLED AT ALL CONSTRUCTION ENTRANCES.

Typical Siltsack® Construction - Type A



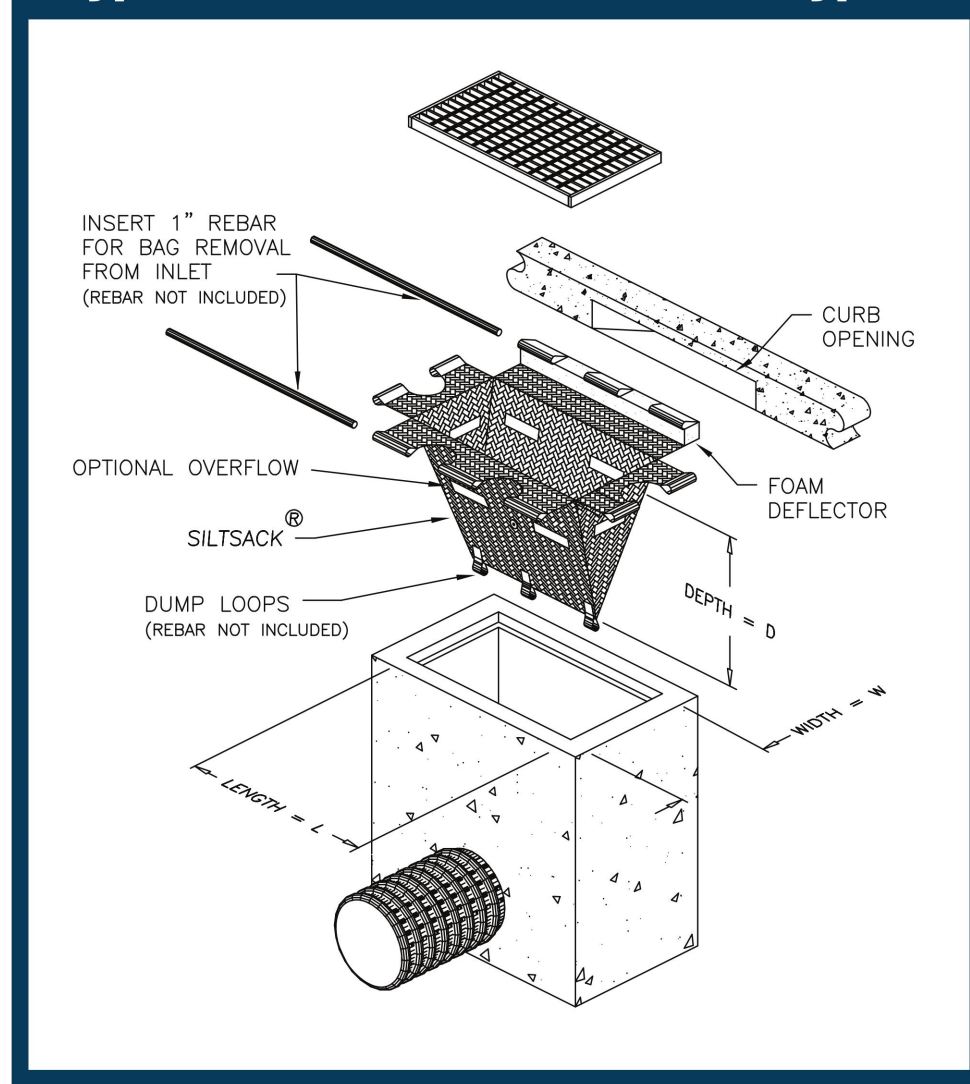


Typical Siltsack® Construction - Type B

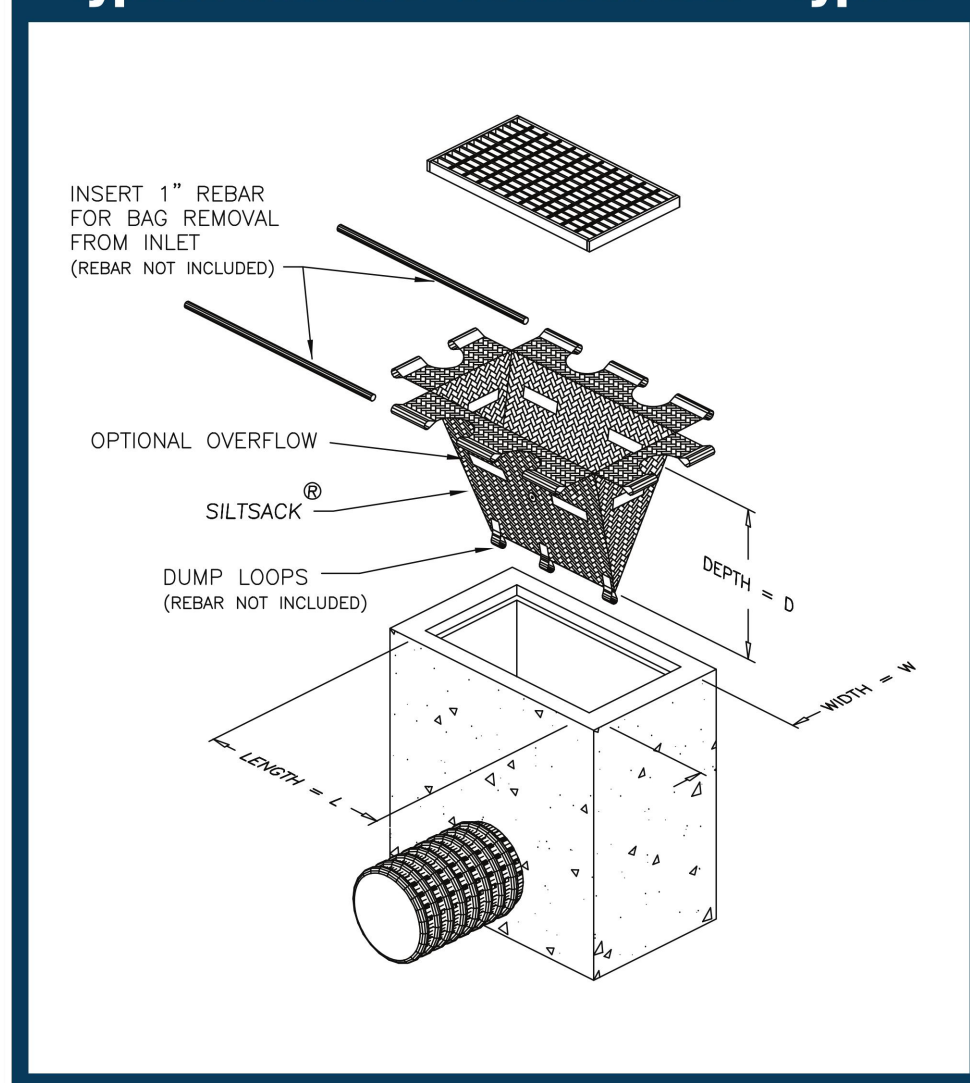

INFILTRATION GALLERY NOTES:

- INFILTRATION GALLERY SHALL BE CONSTRUCTED TOWARDS THE END OF THE DEVELOPMENT CONSTRUCTION PERIOD IN ORDER TO NOT CONTAMINATE THE PRACTICE.
- SMEARING OF THE NATIVE MATERIAL AT THE INTERFACE WITH THE GALLERY FLOOR MUST BE AVOIDED AND/OR CORRECTED BY RAKING OR ROTO-TILLING.
- COMPACTION OF THE GALLERY BOTTOM MUST BE MINIMIZED.

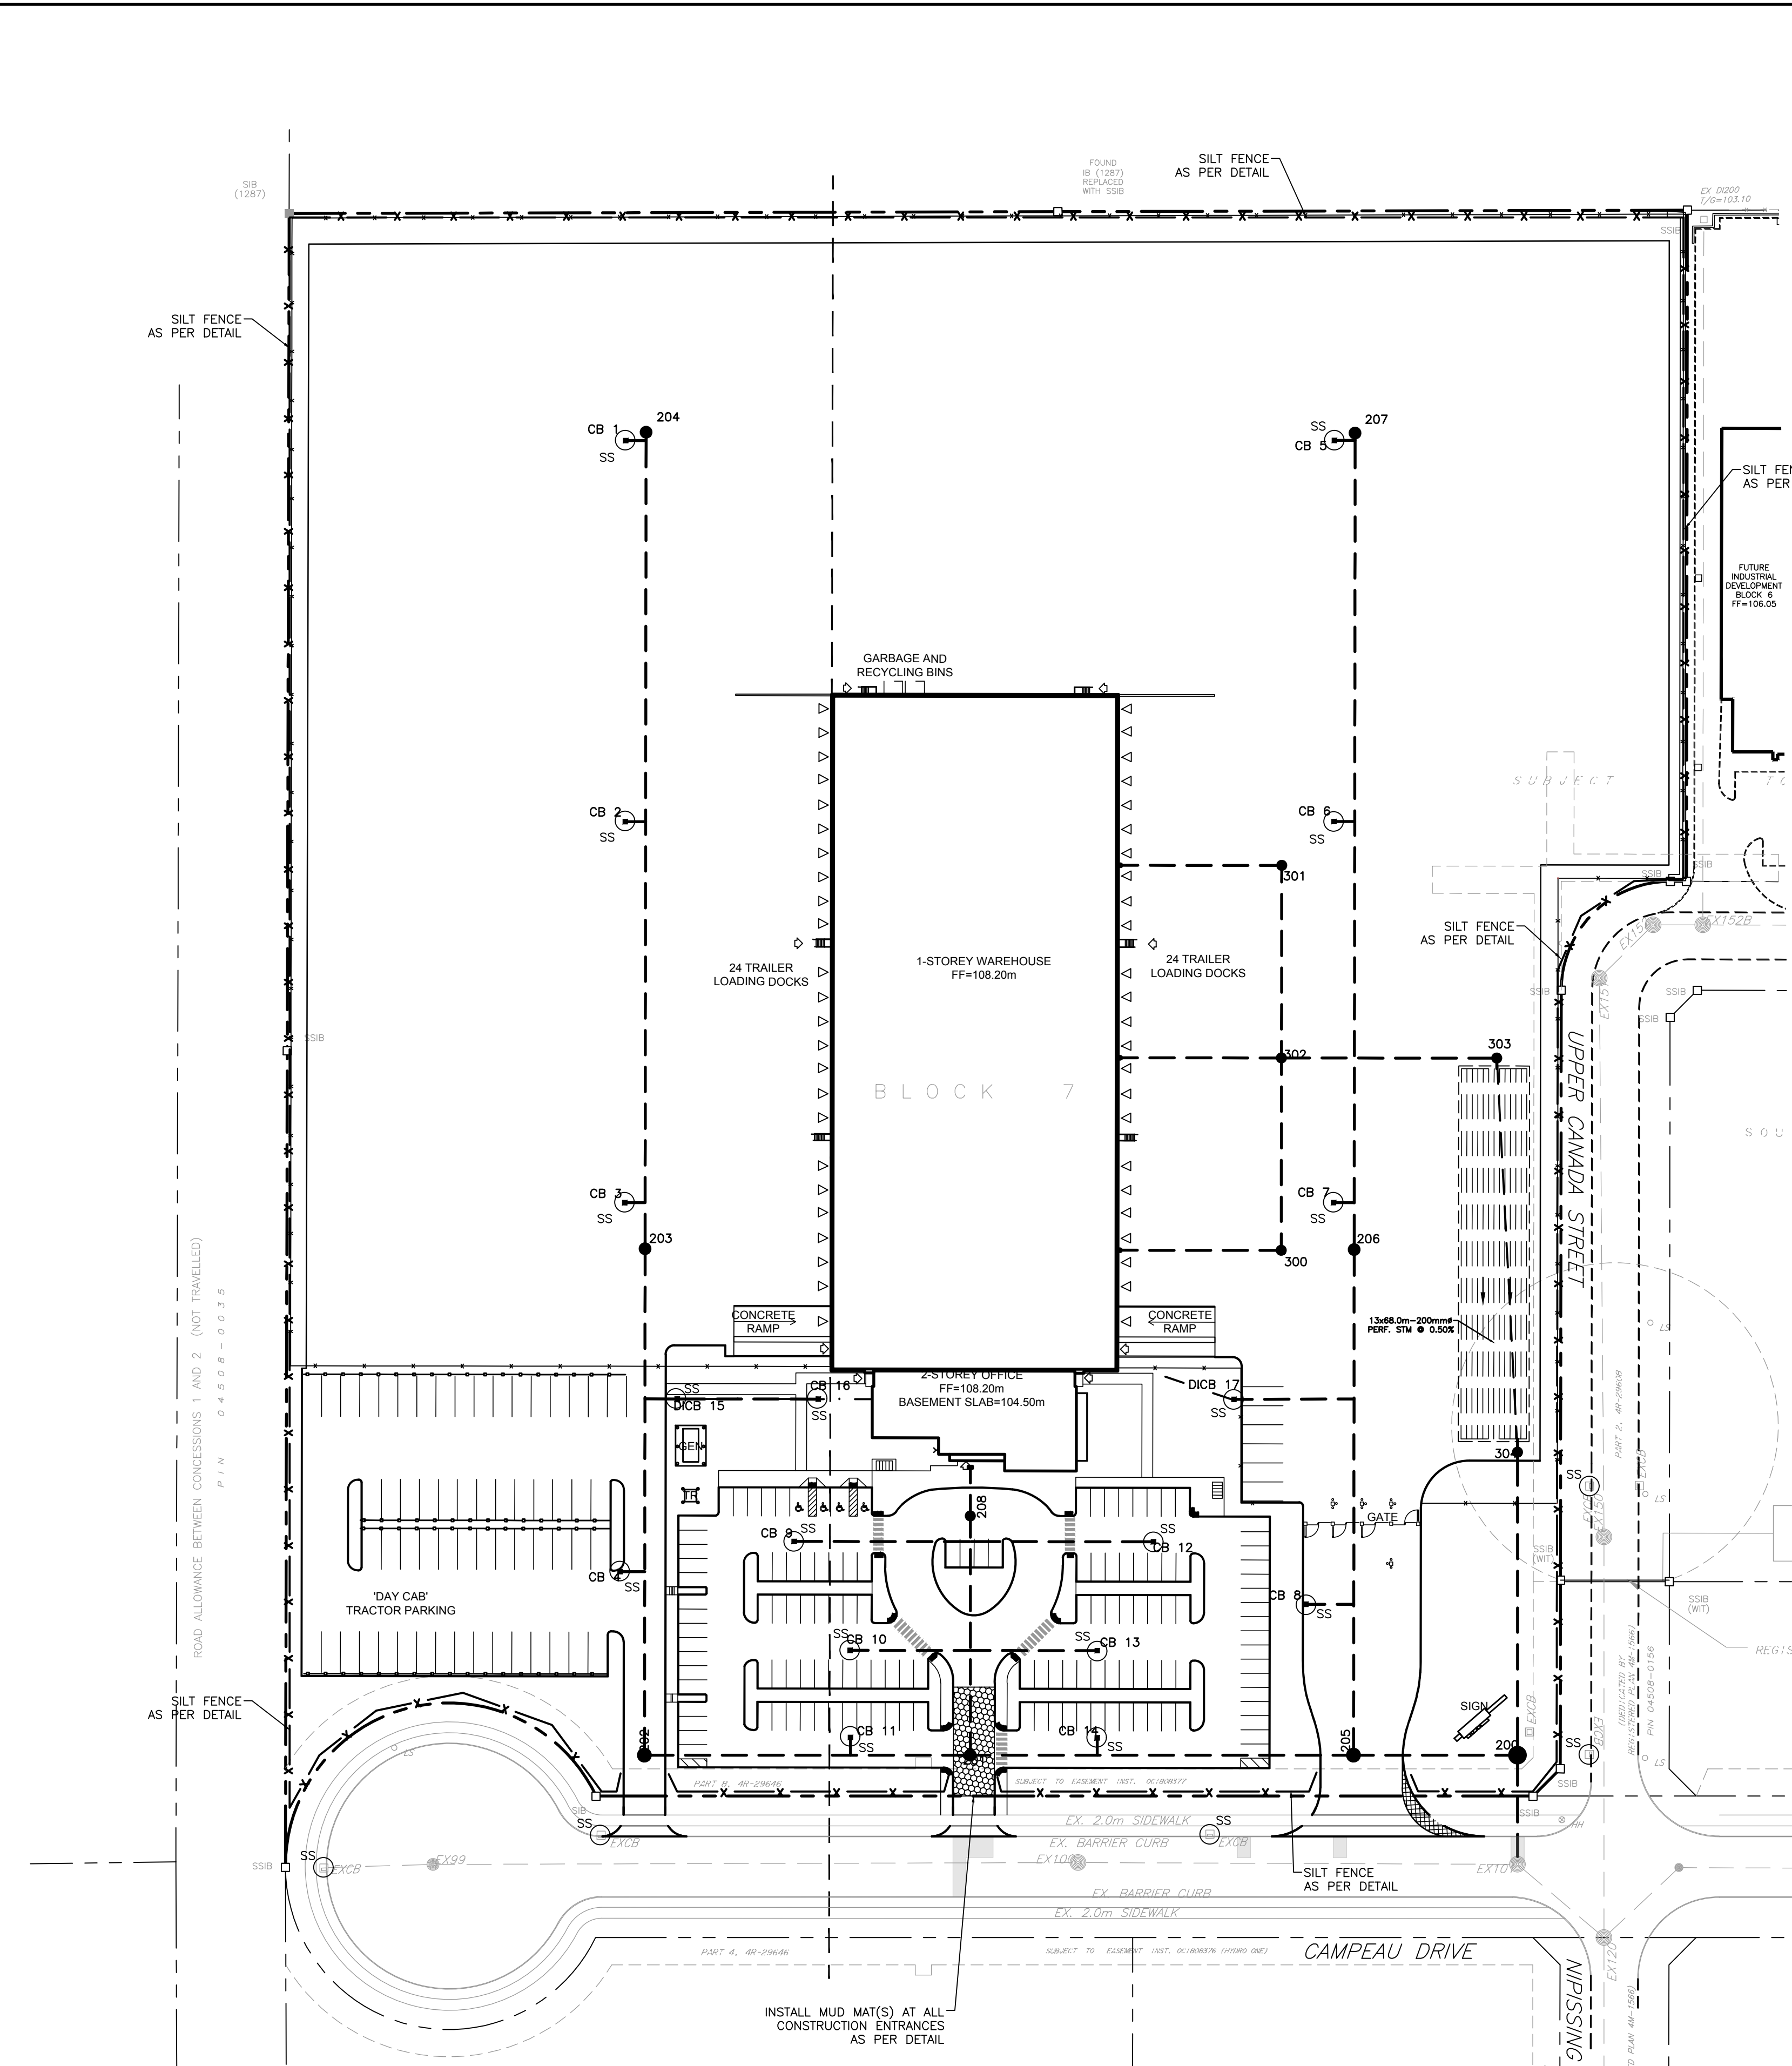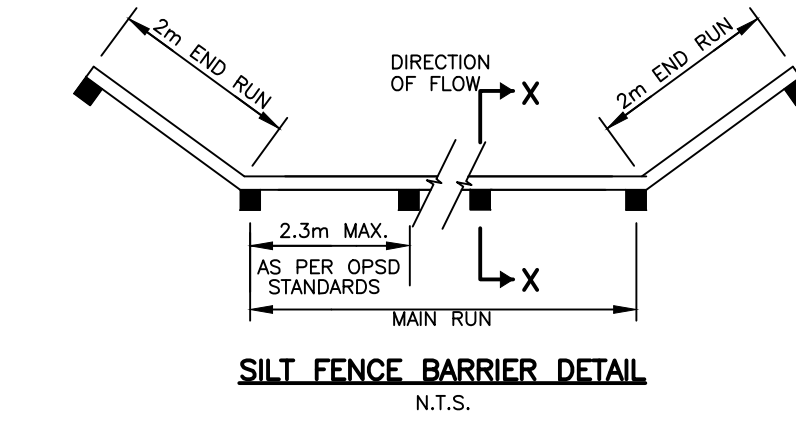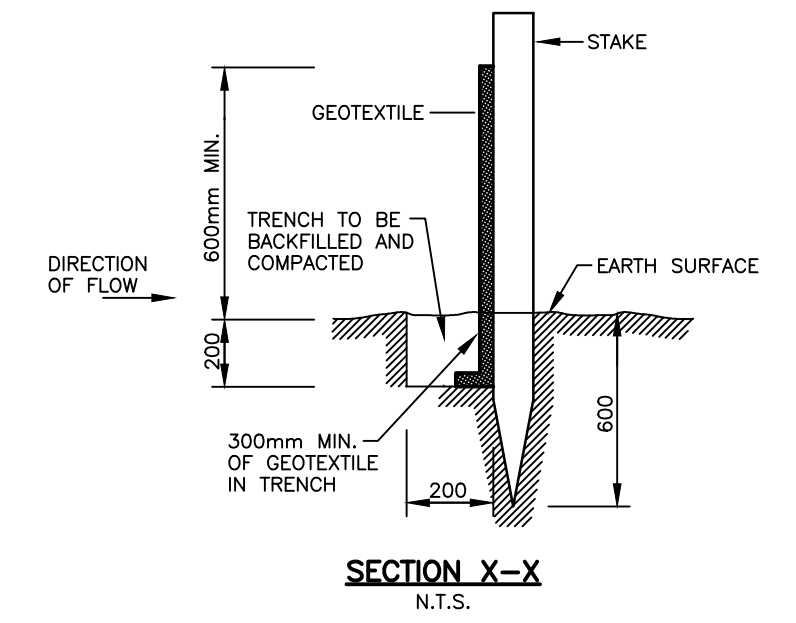


NOT FOR CONSTRUCTION

NOTES

THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

NO.	REVISION DESCRIPTION	DATE	BY
5	REVISED PER COMMENTS	09/08/21	SMC
4	ISSUED FOR TENDER	11/06/21	SMC
3	REVISED PER COMMENTS	28/05/21	SMC
2	ISSUED FOR PROGRESS REVIEW	22/03/21	SMC
1	ISSUED FOR SITE PLAN APPLICATION	02/12/20	SMC

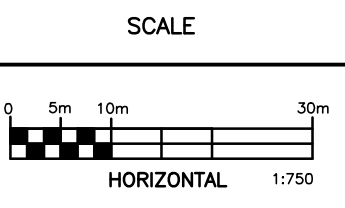

Robinson
Land Development

350 Palladium Drive
Ottawa, ON K2V 1A8
(613) 592-6060 rcii.com

DESIGN	BLM
CHECKED	SMC
DRAWN	BLM
CHECKED	SMC
APPROVED	SMC

MARITIME-ONTARIO
FREIGHT LINES LIMITED

KANATA WEST BUSINESS PARK
8800 CAMPEAU DRIVE, OTTAWA, ON

EROSION AND SEDIMENT
CONTROL PLAN

PROJECT No.	20027
SURVEY	STANTEC
DATED	AUGUST 2021
DWG. No.	20027-ESC1

GENERAL NOTES:

1. ALL WORKS AND MATERIALS SHALL CONFORM TO THE LATEST REVISIONS OF THE STANDARDS AND SPECIFICATIONS OF THE CITY OF OTTAWA AND ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD) AND SPECIFICATIONS (OPSS), AS AMENDED BY THE CITY OF OTTAWA.
2. THE CONTRACTOR SHALL CONFIRM THE LOCATION OF ALL EXISTING UTILITIES WITHIN THE SITE AND ADJACENT WORK AREAS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING ALL EXISTING UTILITIES TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR OR REPLACEMENT OF ANY SERVICES OR UTILITIES DISTURBED DURING CONSTRUCTION, TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION.
3. ALL DIMENSIONS AND ELEVATIONS SHALL BE CHECKED AND VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO THE START OF CONSTRUCTION. ANY DISCREPANCIES SHALL BE REPORTED IMMEDIATELY TO THE ENGINEER.
4. DESIGN ELEVATIONS GIVEN ARE TO BE ADHERED TO WITH NO CHANGES WITHOUT PRIOR WRITTEN APPROVAL BY ROBINSON LAND DEVELOPMENT.
5. ANY AREAS BEYOND THE LIMIT OF THE SITE DISTURBED DURING CONSTRUCTION SHALL BE RESTORED TO ORIGINAL CONDITION OR BETTER TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION AT THE CONTRACTOR'S EXPENSE.
6. RELOCATION OF EXISTING SERVICES AND/OR UTILITIES SHALL BE AS SHOWN ON THE DRAWINGS OR AS DIRECTED BY THE ENGINEER AT THE EXPENSE OF THE CONTRACTOR.
7. ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH THE "OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS". THE GENERAL CONTRACTOR SHALL BE DEEMED TO BE THE CONSTRUCTOR AS DEFINED IN THE ACT.
8. ALL CONSTRUCTION SIGNAGE MUST CONFORM TO THE M.T.O. MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES (LATEST AMENDMENT).
9. ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE SPECIFIED.
10. THE SUPPORT OF ALL UTILITIES SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
11. THE CONTRACTOR WILL BE RESPONSIBLE FOR ADDITIONAL BEDDING OR ADDITIONAL STRENGTH PIPE IF THE MAXIMUM TRENCH WIDTH, AS SPECIFIED BY OPSD, IS EXCEEDED.
12. ALL NECESSARY CLEARING AND GRUBBING SHALL BE COMPLETED BY THE CONTRACTOR, REVIEW WITH CONTRACT ADMINISTRATOR AND THE CITY OF OTTAWA PRIOR TO AND TREE CUTTING.
13. REFER TO GEOTECHNICAL INVESTIGATION PREPARED BY PATTERSON GROUP, REPORT NO. P05618-1, DATED MAY 11, 2021.
14. THE CONTRACTOR IS RESPONSIBLE FOR AND SHALL PROVIDE FOR DEWATERING, SUPPORT AND PROTECTION OF EXCAVATIONS AND TRENCHING AS WELL AS RELEASE OF ANY PUMPED GROUNDWATER IN A CONTROLLED AND APPROVED MANNER.
15. DO NOT CONSTRUCT USING DRAWINGS THAT ARE NOT MARKED "ISSUED FOR CONSTRUCTION".
16. CONTRACTOR IS RESPONSIBLE FOR ALL LAYOUT FOR CONSTRUCTION OF SEWER TRENCHES TO PROVIDE ADDITIONAL BEDDING, A DIFFERENT TYPE OF BEDDING OR A HIGHER PIPE STRENGTH AT HIS OWN EXPENSE AND SHALL ALSO BE RESPONSIBLE FOR EXTRA TEMPORARY AND/OR PERMANENT REPAIRS MADE NECESSARY BY THE WIDENED TRENCH.

STORM SEWERS:

1. ALL REINFORCED CONCRETE STORM SEWER PIPE SHALL BE IN ACCORDANCE WITH CSA A257.2 (LATEST AMENDMENT). ALL NON-REINFORCED CONCRETE STORM SEWER PIPE SHALL BE IN ACCORDANCE WITH CSA A257.1 (LATEST AMENDMENT). PIPE SHALL BE JOINTED WITH STD. RUBBER GASKETS AS PER CSA A257.3 (LATEST AMENDMENT).
2. ALL STORM SEWER TRENCH AND BEDDING SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. S6 AND S7 CLASS 'B' UNLESS OTHERWISE SPECIFIED. BEDDING AND COVER MATERIAL SHALL BE SPECIFIED BY PROJECT GEOTECHNICAL ENGINEER.
3. ALL PVC STORM SEWERS ARE TO BE SDR 35 APPROVED PER C.S.A. B182.2 OR LATEST AMENDMENT, UNLESS OTHERWISE SPECIFIED.
4. STORM MANHOLE FRAME AND COVERS SHALL BE AS PER CITY OF OTTAWA STD. S24.1.
5. STORM SEWER MANHOLES SERVING SEWERS LESS THAN 900mm SHALL BE BENCHED AS PER OPSD 701.021.
6. SANITARY PRE-CAST MANHOLE SHALL BE CONSTRUCTED WITH A HIGHER PERCENTAGE OF SILICA FUME IN THE CONCRETE TO MAKE IT MORE DENSE AND LESS SUSCEPTIBLE TO CORROSION OR PINHOLE LEAKS. WHERE THE SPECIFIED TRENCH WIDTH IS EXCEEDED, THE CONTRACTOR SHALL BE REQUIRED TO PROVIDE ADDITIONAL BEDDING, A DIFFERENT TYPE OF BEDDING OR A HIGHER PIPE STRENGTH AT HIS OWN EXPENSE AND SHALL ALSO BE RESPONSIBLE FOR EXTRA TEMPORARY AND/OR PERMANENT REPAIRS MADE NECESSARY BY THE WIDENED TRENCH.

SANITARY SEWERS:


1. ALL SANITARY SEWERS SHALL BE PVC SDR 35, IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS.
2. SANITARY SEWER TRENCH AND BEDDING SHALL BE AS PER CITY OF OTTAWA STD. S6 AND S7, CLASS 'B' BEDDING UNLESS OTHERWISE NOTED.
3. ALL SANITARY SEWERS ARE TO BE EQUIPPED WITH APPROVED BACKWATER VALVES.
4. SANITARY MANHOLE FRAME AND COVERS SHALL BE AS PER CITY OF OTTAWA STD. S24.
5. SANITARY SEWER MANHOLES SHALL BE BENCHED AS PER OPSD 701.021.
6. SANITARY PRE-CAST MANHOLE SHALL BE CONSTRUCTED WITH A HIGHER PERCENTAGE OF SILICA FUME IN THE CONCRETE TO MAKE IT MORE DENSE AND LESS SUSCEPTIBLE TO CORROSION OR PINHOLE LEAKS. ADEQUATE STRUCTURAL SUPPORT FOR THE SEWERS IS REQUIRED TO PREVENT EXCESSIVE DEFLECTION OF JOINTS AND SETTLING. THE LENGTH OF WATER PIPE SHALL BE CENTERED AT THE POINT OF CROSSING SO THAT THE JOINTS WILL BE EQUIDISTANT AND AS FAR AS POSSIBLE FROM THE SEWER AS PER CITY STD. W25.
7. INSULATION FOR WATERMAIN CROSSING OVER AND BELOW SEWER SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. W25.2 AND W25.3, RESPECTIVELY, WHERE WATERMAIN COVER IS LESS THAN 2.4m.
8. AS PER CITY GUIDELINE, THE MINIMUM VERTICAL CLEARANCE BETWEEN WATERMAIN AND SEWER / UTILITY IS 0.25m FOR CROSSING OVER THE SEWER, AS PER CITY STD. W25.2. FOR CROSSING UNDER SEWER, ADEQUATE STRUCTURAL SUPPORT FOR THE SEWERS IS REQUIRED TO PREVENT EXCESSIVE DEFLECTION OF JOINTS AND SETTLING. THE LENGTH OF WATER PIPE SHALL BE CENTERED AT THE POINT OF CROSSING SO THAT THE JOINTS WILL BE EQUIDISTANT AND AS FAR AS POSSIBLE FROM THE SEWER AS PER CITY STD. W25.
9. CONNECTION TO EXISTING WATERMAIN TO BE PERFORMED BY CITY FORCES. CONTRACTOR TO PROVIDE LABOUR, EQUIPMENT AND MATERIAL REQUIRED FOR EXCAVATION, BEDDING AND REINSTATEMENT.
10. SWABBING, DISINFECTION AND HYDROSTATIC TESTING TO BE CONDUCTED IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS IN THE PRESENCE OF A CITY INSPECTOR AND/OR CONSULTANT.
11. INSULATION FOR WATERMAIN CROSSING OVER AND BELOW SEWER SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. W25.2 AND W25.3, RESPECTIVELY, WHERE WATERMAIN COVER IS LESS THAN 2.4m.
12. AS PER CITY GUIDELINE, THE MINIMUM VERTICAL CLEARANCE BETWEEN WATERMAIN AND SEWER / UTILITY IS 0.25m FOR CROSSING OVER THE SEWER, AS PER CITY STD. W25.2. FOR CROSSING UNDER SEWER, ADEQUATE STRUCTURAL SUPPORT FOR THE SEWERS IS REQUIRED TO PREVENT EXCESSIVE DEFLECTION OF JOINTS AND SETTLING. THE LENGTH OF WATER PIPE SHALL BE CENTERED AT THE POINT OF CROSSING SO THAT THE JOINTS WILL BE EQUIDISTANT AND AS FAR AS POSSIBLE FROM THE SEWER AS PER CITY STD. W25.
13. CONNECTION TO EXISTING WATERMAIN TO BE PERFORMED BY CITY FORCES. CONTRACTOR TO PROVIDE LABOUR, EQUIPMENT AND MATERIAL REQUIRED FOR EXCAVATION, BEDDING AND REINSTATEMENT.
14. SWABBING, DISINFECTION AND HYDROSTATIC TESTING TO BE CONDUCTED IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS IN THE PRESENCE OF A CITY INSPECTOR AND/OR CONSULTANT.

WATER SUPPLY:

1. ALL PVC WATERMANS SHALL BE EQUAL TO AWWA C-900 CLASS 150, SDR 18, OR APPROVED EQUAL.
2. WATERMAIN TRENCH AND BEDDING SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STANDARD W17, UNLESS OTHERWISE SPECIFIED. BEDDING AND COVER MATERIAL SHALL BE SPECIFIED BY PROJECT GEOTECHNICAL ENGINEER.
3. ALL PVC WATERMANS SHALL BE INSTALLED WITH A 16 GAUGE STRANDED COPPER TWU OR RWU TRACER WIRE IN ACCORDANCE WITH CITY OF OTTAWA STD. W36.
4. CATHODIC PROTECTION IS REQUIRED ON ALL METALLIC FITTINGS AS PER CITY OF OTTAWA STD. W40 AND W42.
5. CONTRACTOR TO SUPPLY HYDRANT EXTENSION TO ADJUST THE LENGTH OF HYDRANT BARREL IF REQUIRED.
6. FIRE HYDRANTS SHALL BE INSTALLED AS PER CITY OF OTTAWA STD. W19, AND LOCATED AS PER CITY STD. W18.
7. VALVE IN BOXES SHALL BE INSTALLED AS PER CITY OF OTTAWA STD. W24.
8. WATERMAIN IN FILL AREAS TO BE INSTALLED WITH RESTRAINED JOINTS AS PER CITY OF OTTAWA STD. W25.5 AND W25.6.
9. THRUST BLOCKING OF WATERMAIN TO BE INSTALLED AS PER CITY OF OTTAWA STD. W25.3 AND W25.4.
10. THE CONTRACTOR SHALL PROVIDE ALL TEMPORARY CLOSURES, PLUGS AND BLOW-OFFS AND NOZZLES REQUIRED FOR TESTING AND DISINFECTION OF THE WATERMAIN.
11. INSULATION FOR WATERMAIN CROSSING OVER AND BELOW SEWER SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. W25.2 AND W25.3, RESPECTIVELY, WHERE WATERMAIN COVER IS LESS THAN 2.4m.
12. AS PER CITY GUIDELINE, THE MINIMUM VERTICAL CLEARANCE BETWEEN WATERMAIN AND SEWER / UTILITY IS 0.25m FOR CROSSING OVER THE SEWER, AS PER CITY STD. W25.2. FOR CROSSING UNDER SEWER, ADEQUATE STRUCTURAL SUPPORT FOR THE SEWERS IS REQUIRED TO PREVENT EXCESSIVE DEFLECTION OF JOINTS AND SETTLING. THE LENGTH OF WATER PIPE SHALL BE CENTERED AT THE POINT OF CROSSING SO THAT THE JOINTS WILL BE EQUIDISTANT AND AS FAR AS POSSIBLE FROM THE SEWER AS PER CITY STD. W25.
13. CONNECTION TO EXISTING WATERMAIN TO BE PERFORMED BY CITY FORCES. CONTRACTOR TO PROVIDE LABOUR, EQUIPMENT AND MATERIAL REQUIRED FOR EXCAVATION, BEDDING AND REINSTATEMENT.
14. SWABBING, DISINFECTION AND HYDROSTATIC TESTING TO BE CONDUCTED IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS IN THE PRESENCE OF A CITY INSPECTOR AND/OR CONSULTANT.


ROADWORK SPECIFICATIONS:

1. CONCRETE CURB SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. SC1.1 (BARRIER CURB). PROVISION SHALL BE MADE FOR CURB DEPRESSIONS AT SIDEWALKS AND DRIVEWAYS.
 2. ALL BARRIER CURBS TO BE 150mm ABOVE FINISHED ASPHALT GRADE UNLESS OTHERWISE NOTED.
 3. CONCRETE SIDEWALK SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. SC3 AND SC1.4.
 4. TWSs SHALL BE INSTALLED IN ACCORDANCE WITH CITY OF OTTAWA STD. SC7.3.
 5. PAVEMENT REINSTATEMENT FOR SERVICE AND UTILITY CUTS SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. R10 AND OPSD 509.010, OPSS 310.
 6. GRANULAR "A" SHALL BE PLACED TO A MINIMUM THICKNESS OF 300mm AROUND ALL STRUCTURES WITHIN PAVEMENT AREA.
 7. ALL GRANULAR FOR ROADS SHALL BE COMPACTED TO A MINIMUM OF 98% STANDARD PROCTOR DENSITY.
 8. ASPHALT WEAR COURSE SHALL NOT BE PLACED UNTIL THE VIDEO INSPECTION OF SEWERS & NECESSARY REPAIRS HAVE BEEN CARRIED OUT TO THE SATISFACTION OF THE ENGINEER.
 9. SUB-EXCAVATE SOFT AREAS AND FILL WITH GRANULAR 'B' COMPACTED IN MAXIMUM 300mm LIFTS.
 10. PEDESTRIAN CURB RAMP WITH BOULEVARD SHALL BE ACCORDANCE WITH CITY OF OTTAWA STD. SC7.
 11. ALL EDGES OF DISTURBED PAVEMENT SHALL BE SAW-CUT TO FORM A NEAT AND STRAIGHT LINE PRIOR TO PLACING NEW ASPHALT.
 12. PAVEMENT DESIGN AS PER GEOTECHNICAL RECOMMENDATIONS:
- LIGHT DUTY (CAR ONLY PARKING AREAS)**
- 50mm WEAR COURSE - HL-3 OR SUPERPAVE 12.5 ASPHALTIC CONCRETE
 - 150mm BASE - OPSS GRANULAR "A" CRUSHED STONE
 - 300mm SUBBASE - OPSS GRANULAR "A" CRUSHED STONE
 - SUBGRADE - EITHER FILL, IN SITU SOIL OR OPSS GRANULAR "B" TYPE I OR II MATERIAL PLACED OVER IN SITU SOIL OR FILL
- HEAVY DUTY (ACCESS LANES AND HEAVY TRUCK PARKING AREAS)**
- 40mm WEAR COURSE - SUPERPAVE 12.5 ASPHALTIC CONCRETE
 - 50mm BINDER COURSE - SUPERPAVE 19.0 ASPHALTIC CONCRETE
 - 150mm BASE - OPSS GRANULAR "A" CRUSHED STONE
 - 450mm SUBBASE - OPSS GRANULAR "B" TYPE II
 - SUBGRADE - EITHER FILL, IN SITU SOIL OR OPSS GRANULAR "B" TYPE I OR II MATERIAL PLACED OVER IN SITU SOIL OR FILL
- ROLLER COMPACTED CONCRETE (AS PER SITE PLAN)**
- 200mm THICKNESS, ZERO SLUMP, NO AIR ENTRAPMENT, 32 MPa at 28 DAY STRENGTH, 12 TO 13% CEMENT CONTENT
 - 300mm BASE - OPSS GRANULAR "A" CRUSHED STONE

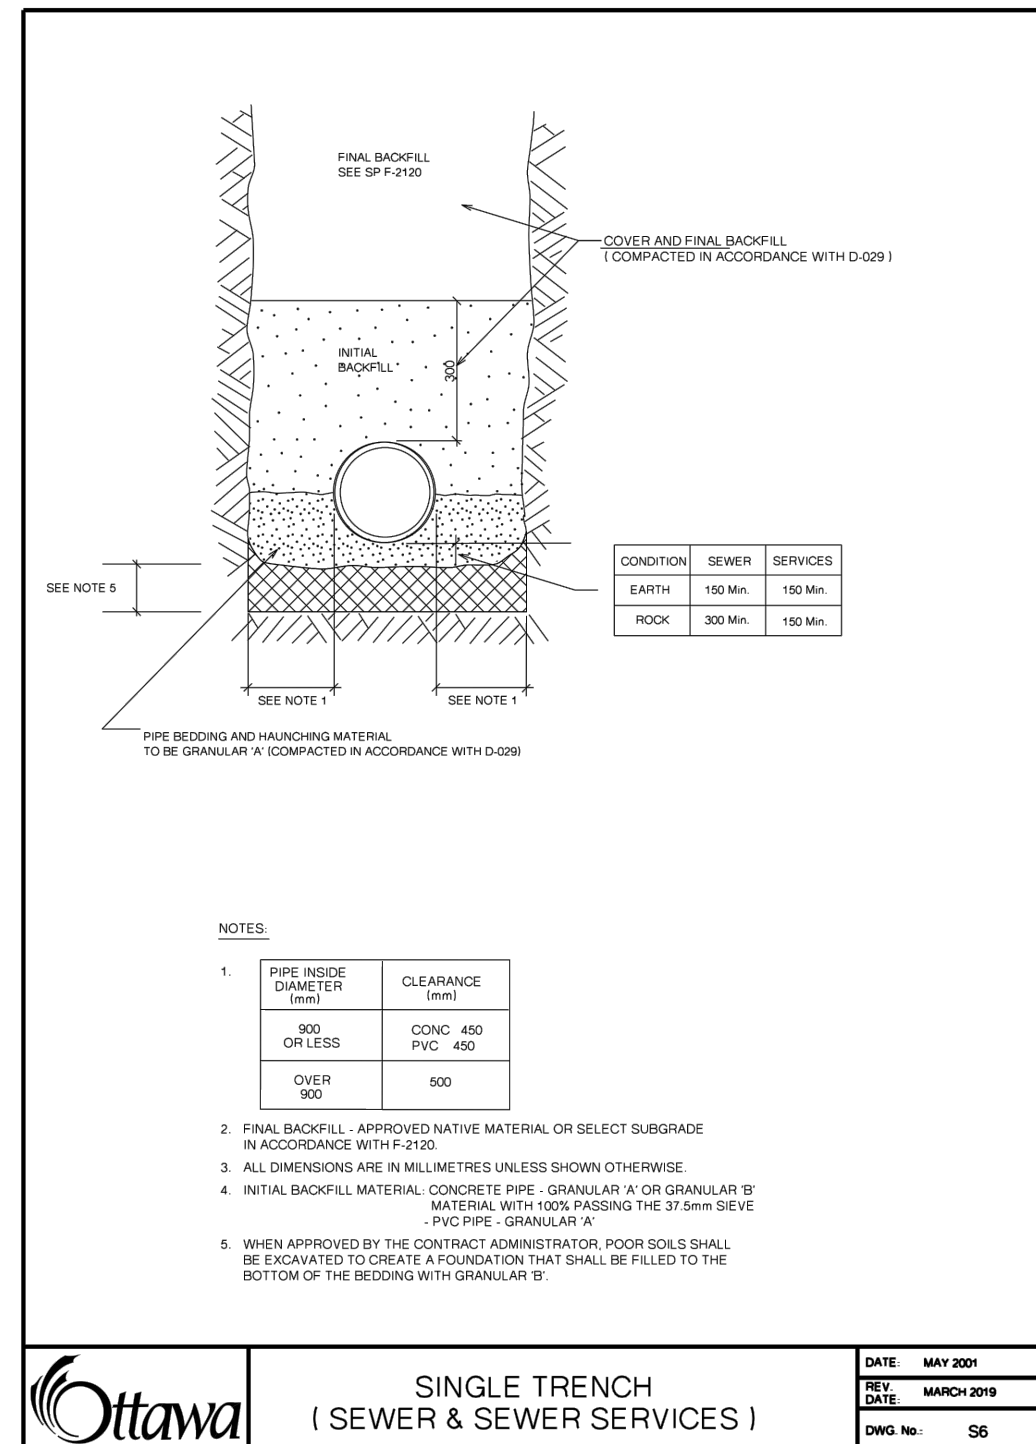


Ottawa SINGLE TRENCH (SEWER & SEWER SERVICES)

DATE: MAY 2007
REV. DATE: MARCH 2019
DWG. NO.: S6

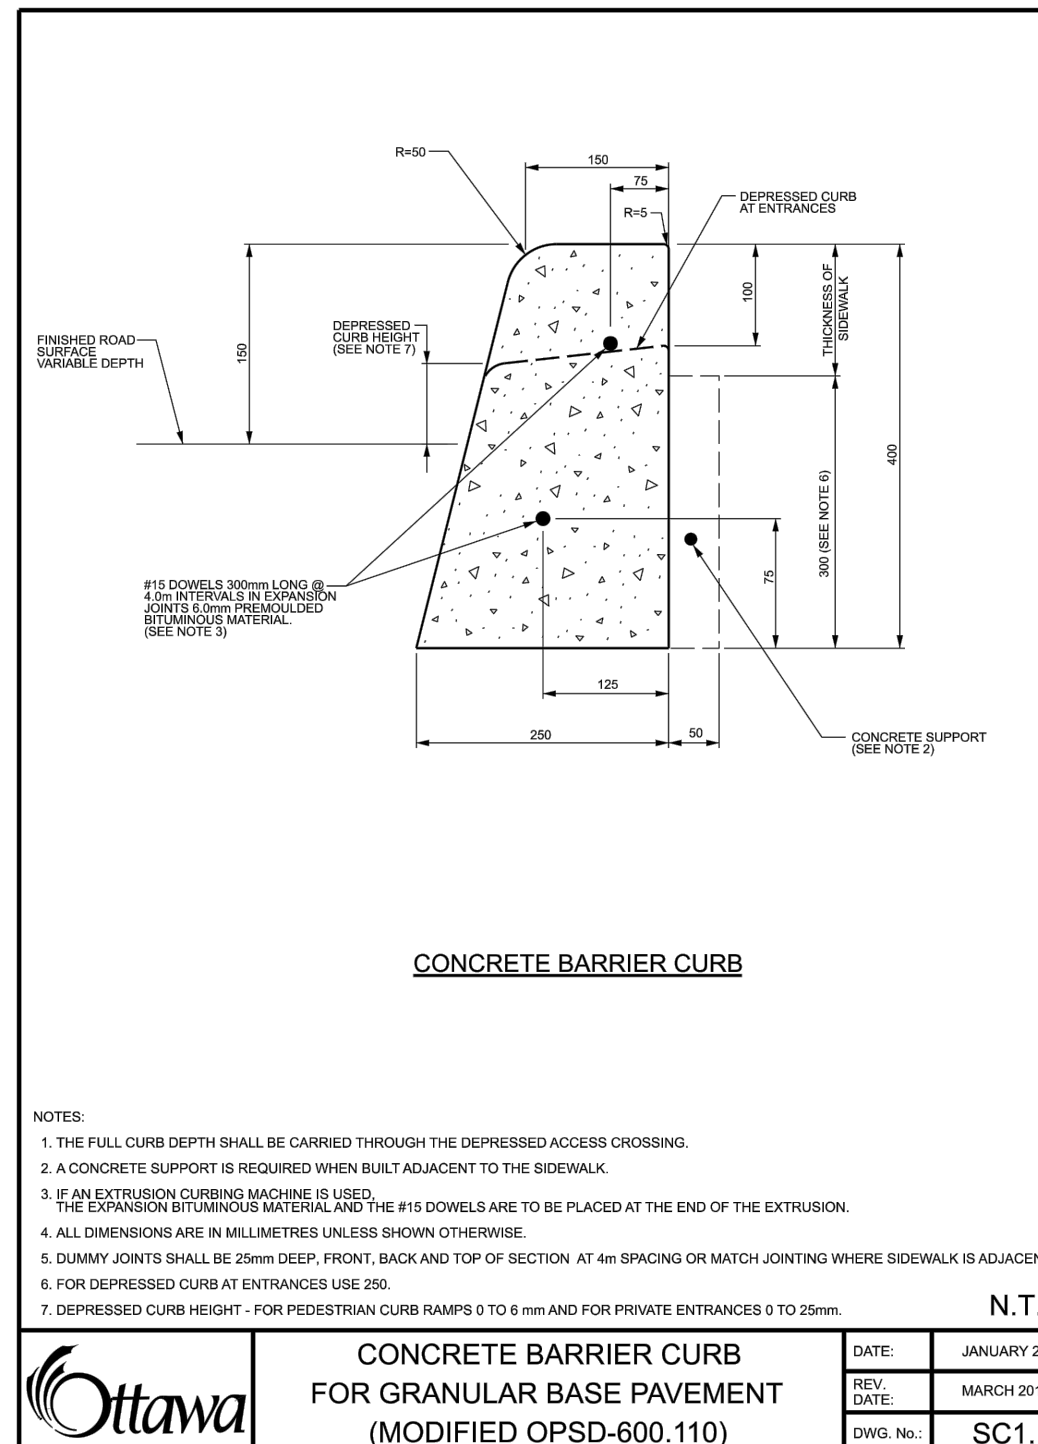


Ottawa CONCRETE BARRIER CURB FOR GRANULAR BASE PAVEMENT (MODIFIED OPSD-600.110)

DATE: JANUARY 2003
REV. DATE: MARCH 2019
DWG. NO.: SC1.1

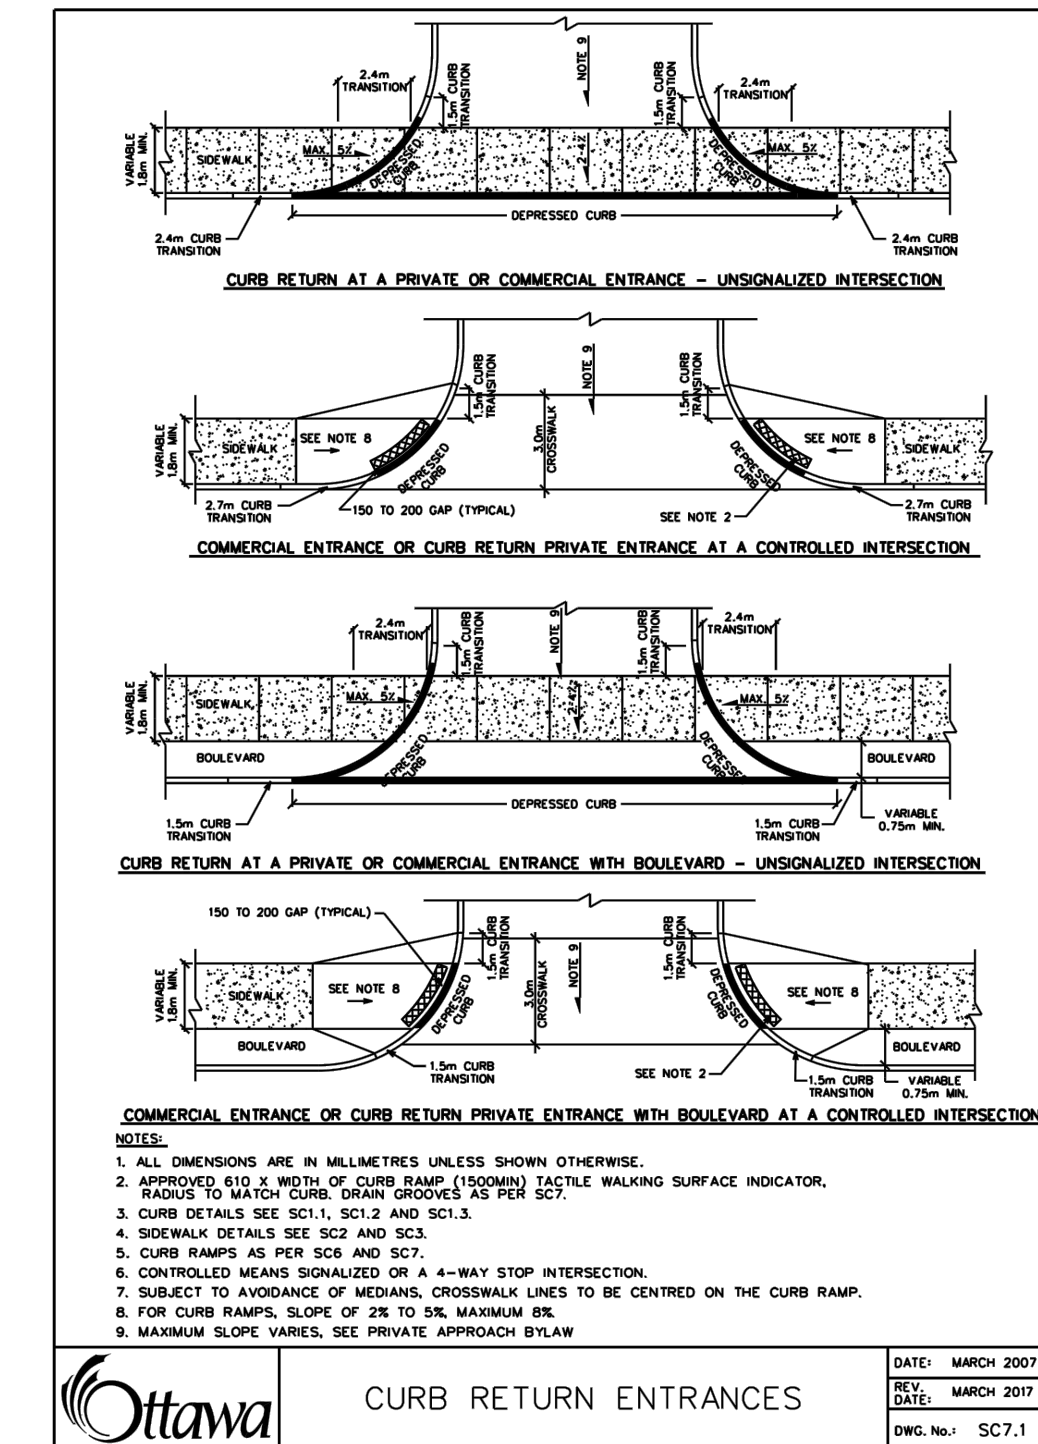


Ottawa CURB RETURN ENTRANCES

DATE: MARCH 2007
REV. DATE: MARCH 2017
DWG. NO.: SC7.1

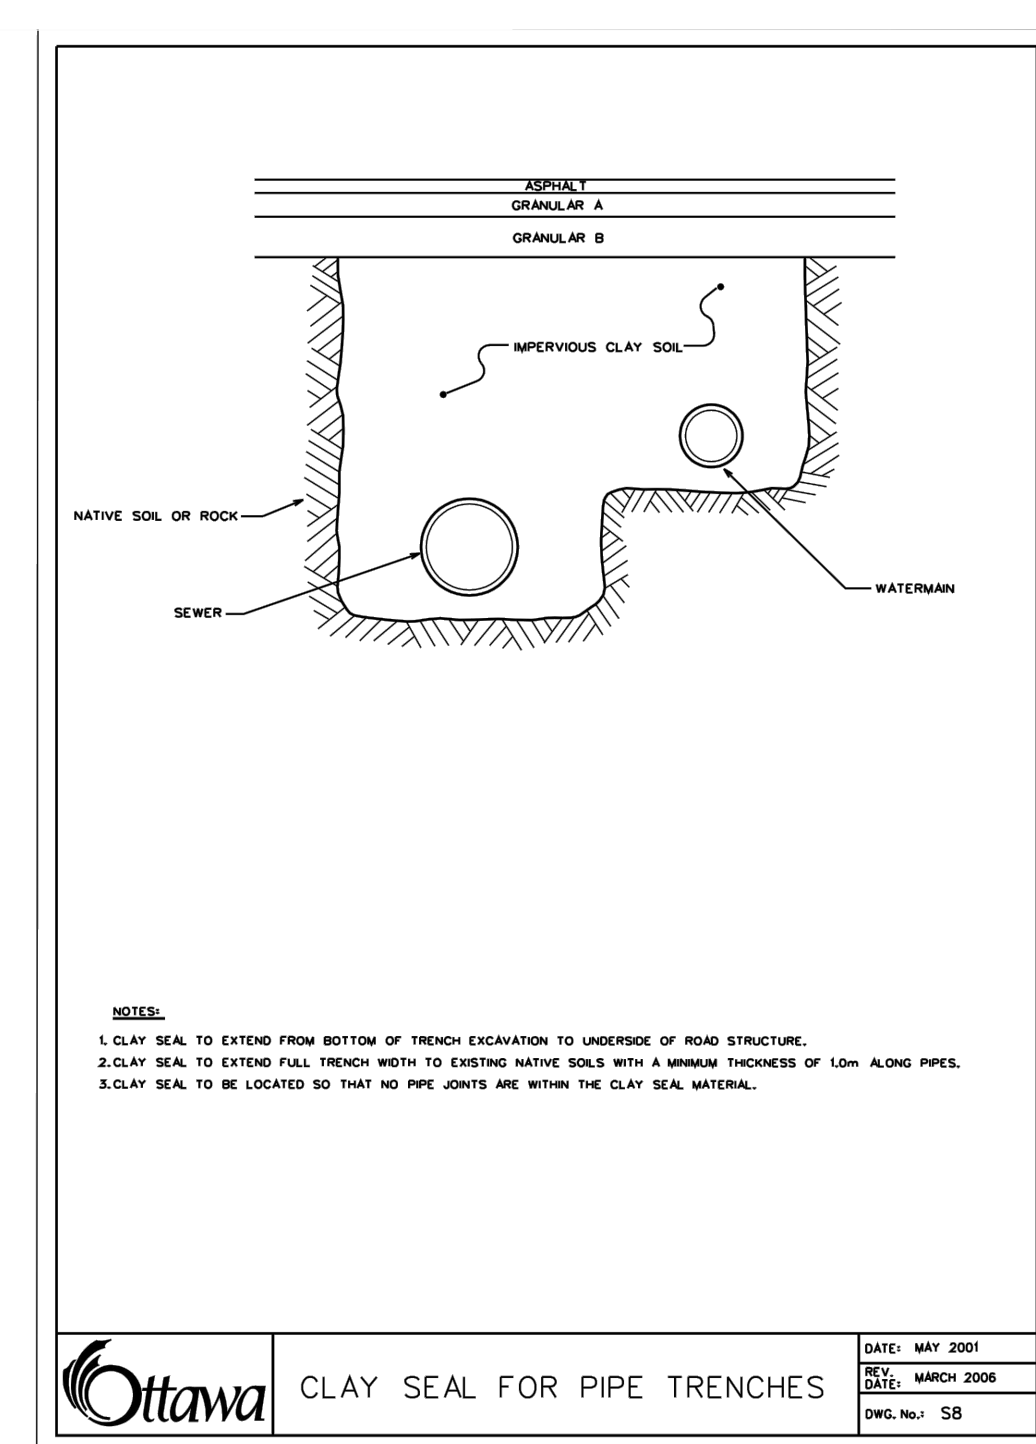


Ottawa CLAY SEAL FOR PIPE TRENCHES

DATE: MAY 2001
REV. DATE: MARCH 2006
DWG. NO.: S8

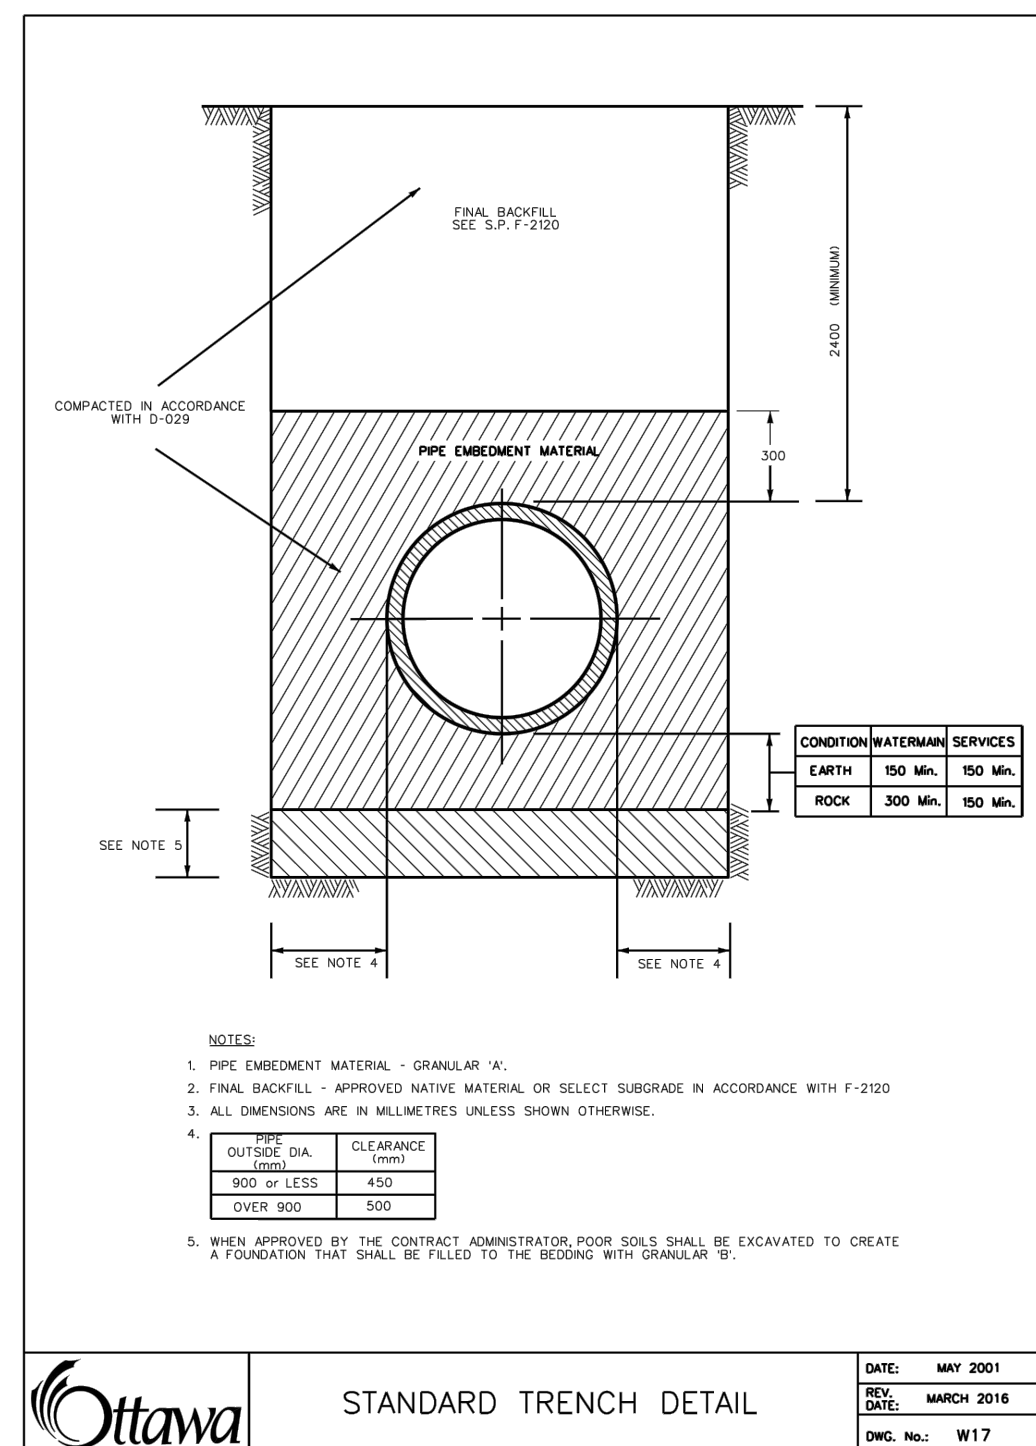


Ottawa STANDARD TRENCH DETAIL

DATE: MAY 2007
REV. DATE: MARCH 2016
DWG. NO.: W17

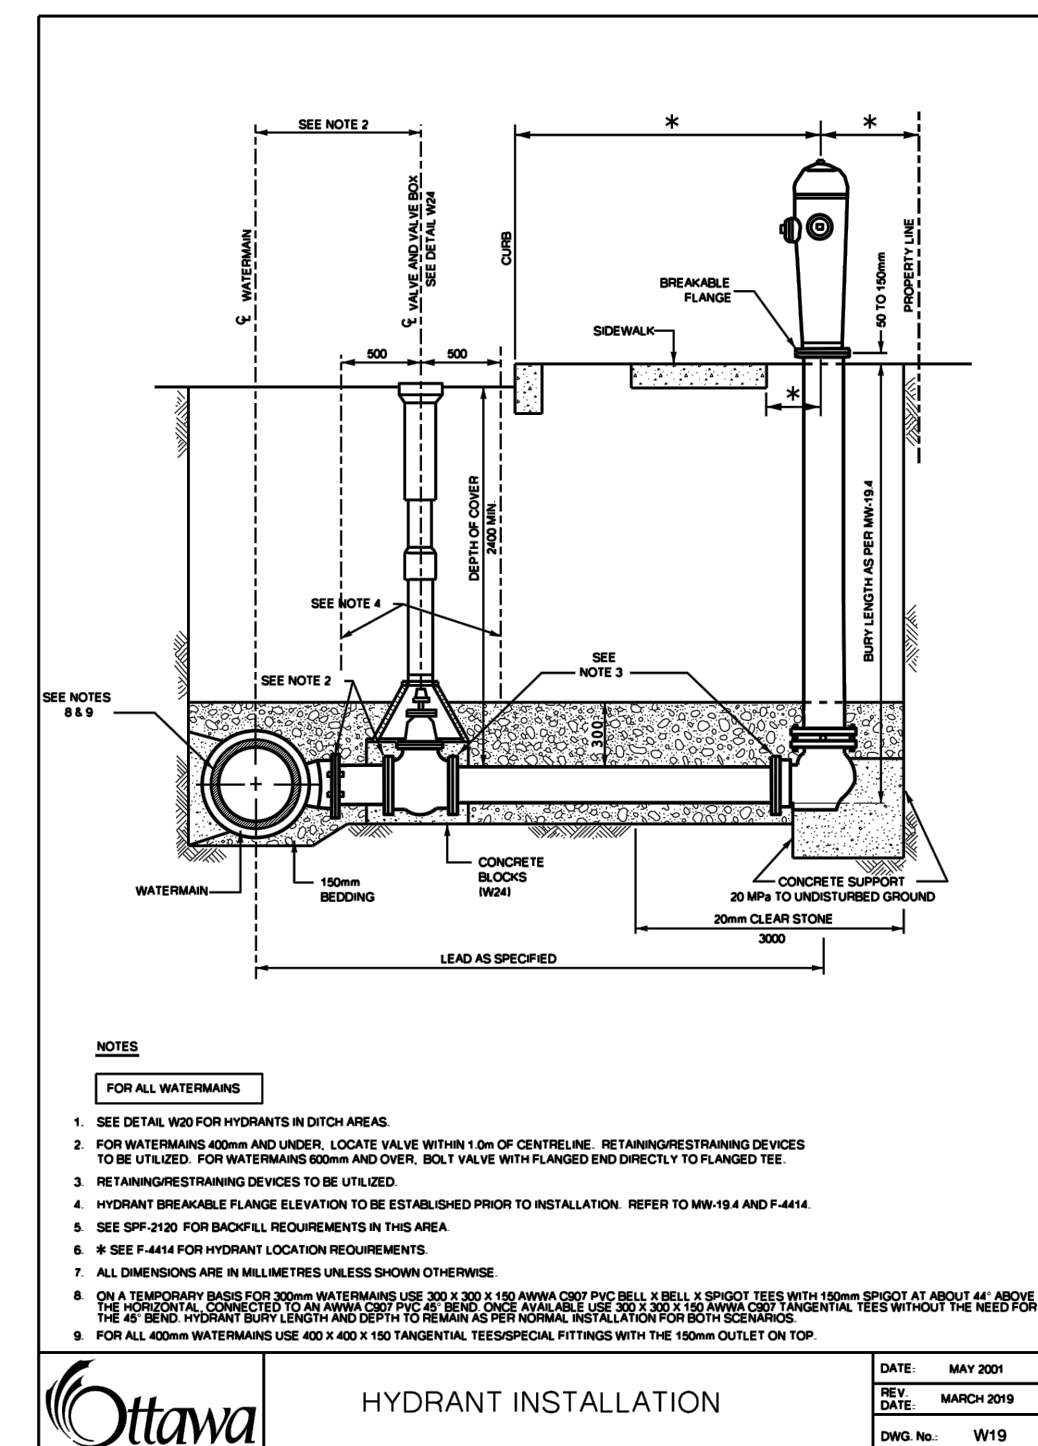


Ottawa HYDRANT INSTALLATION

DATE: MAY 2007
REV. DATE: MARCH 2009
DWG. NO.: W19

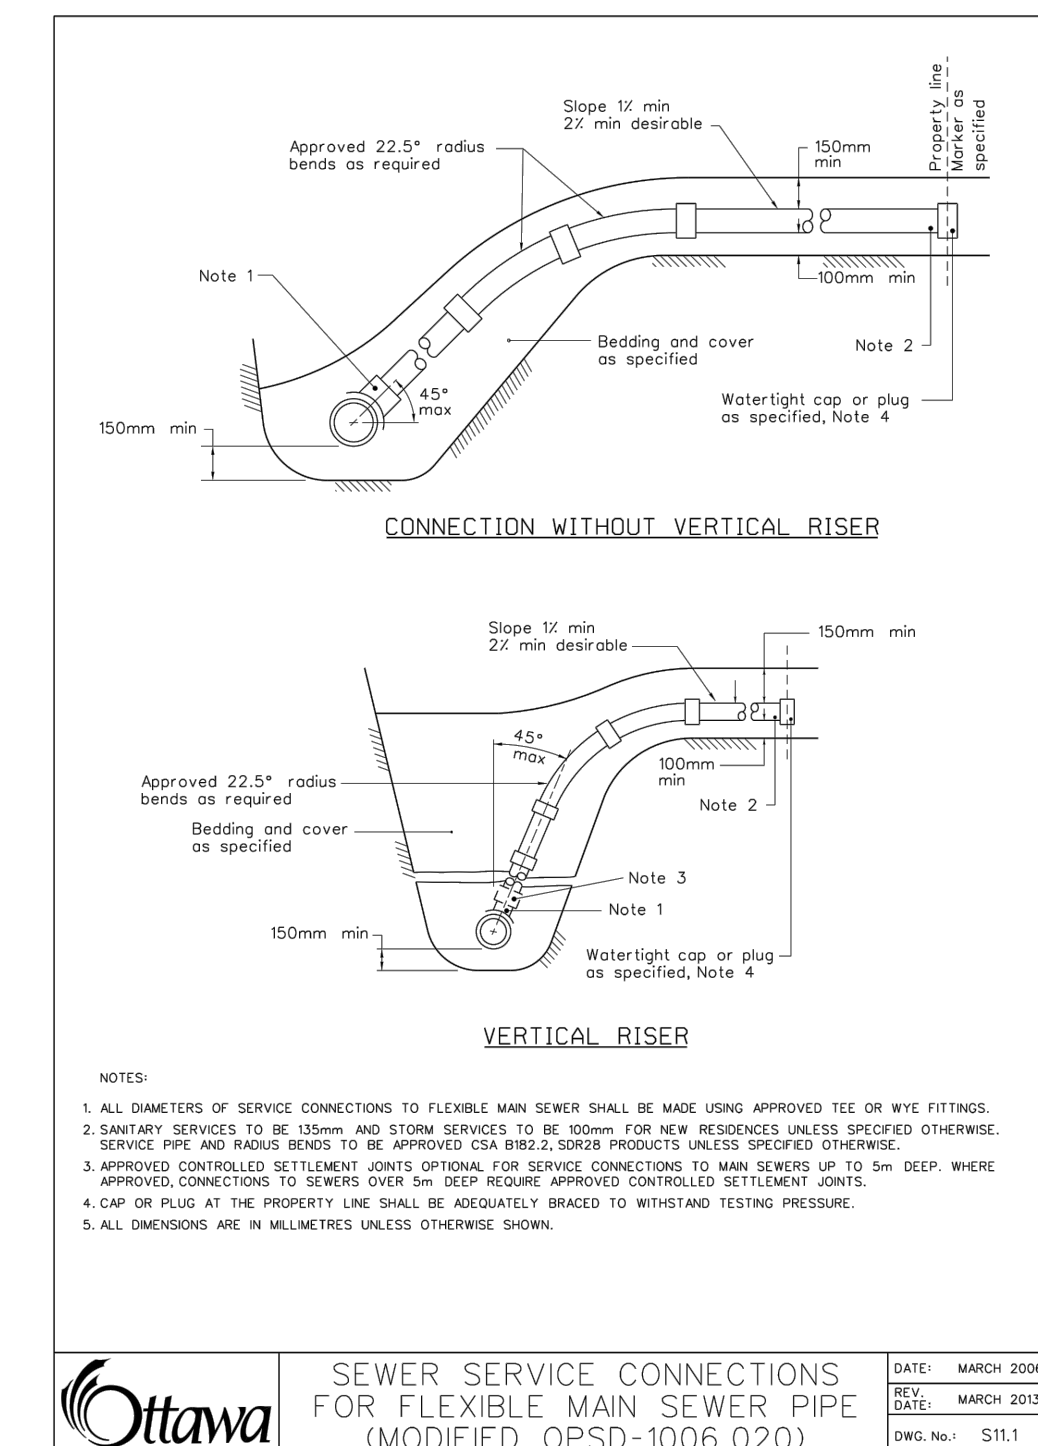

Ottawa SEWER SERVICE CONNECTIONS FOR FLEXIBLE MAIN SEWER PIPE (MODIFIED OPSD-1006.020)

DATE: MARCH 2006
REV. DATE: MARCH 2013
DWG. NO.: S11.1

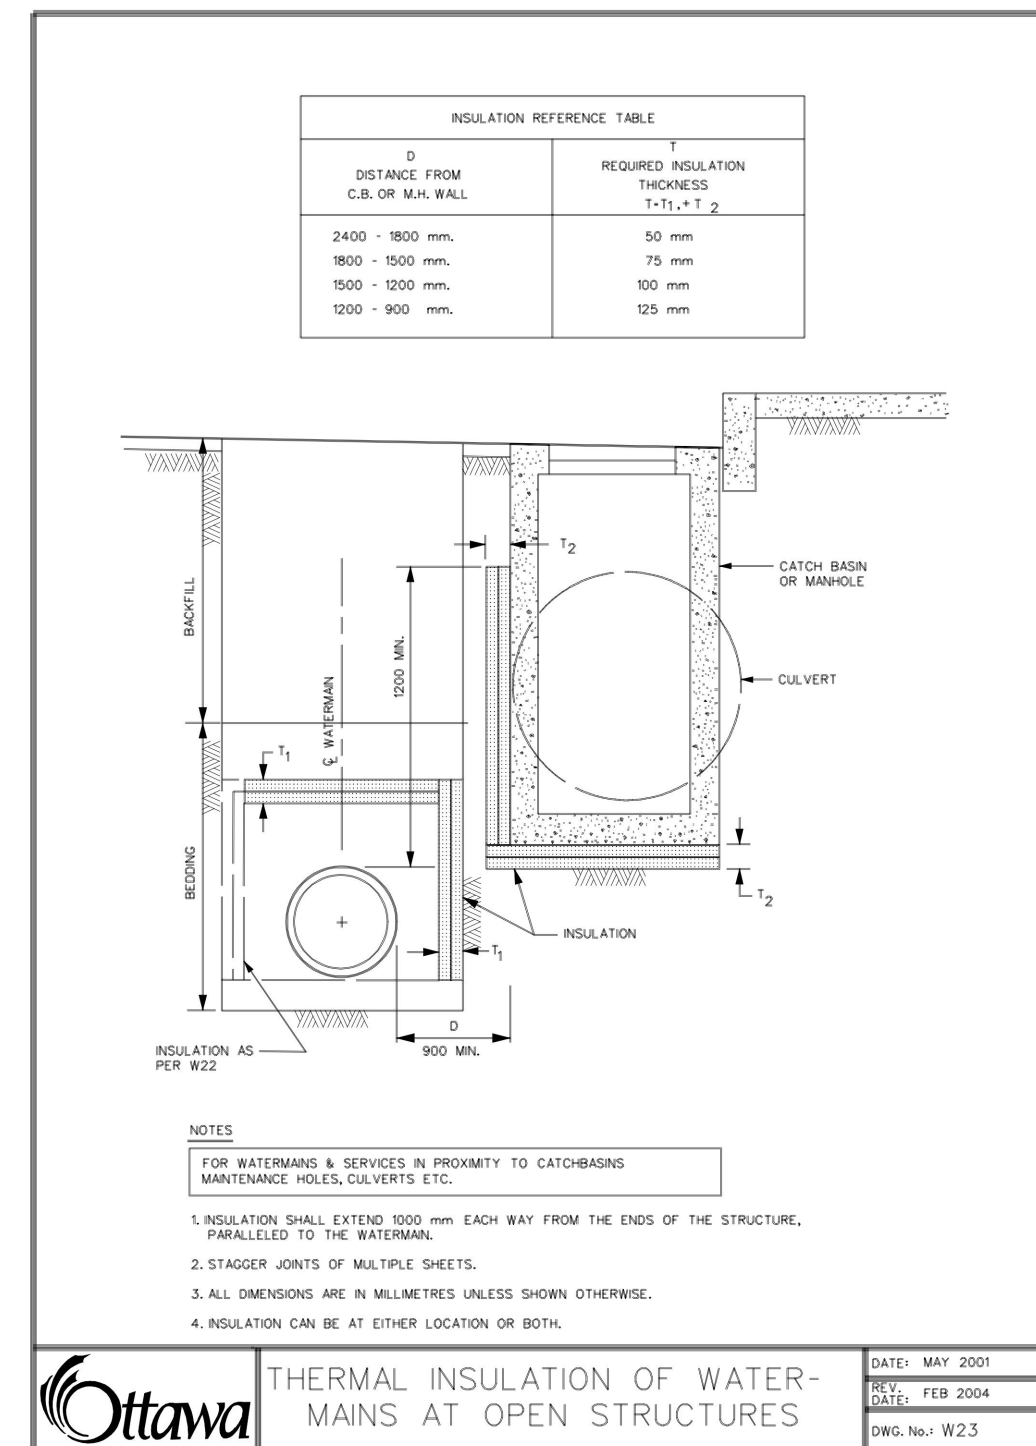

Ottawa THERMAL INSULATION OF WATER MAINS AT OPEN STRUCTURES

DATE: MAY 2007
REV. DATE: FEB 2004
DWG. NO.: W23

NOT FOR CONSTRUCTION

NO.	REVISION DESCRIPTION	DATE	BY
5	REVISED PER COMMENTS	09/08/21	SMC
4	ISSUED FOR TENDER	11/06/21	SMC
3	REVISED PER COMMENTS	28/05/21	SMC
2	ISSUED FOR PROGRESS REVIEW	22/03/21	SMC
1	ISSUED FOR SITE PLAN APPLICATION	02/12/20	SMC

SCALE	



Robinson
Land Development

350 Palladium Drive
Ottawa, ON K2V 1A8
(613) 592-6060 roii.com



DESIGN	BLM
CHECKED	SMC
DRAWN	BLM
CHECKED	SMC
APPROVED	SMC

MARITIME-ONTARIO
FREIGHT LINES LIMITED

KANATA WEST BUSINESS PARK
8800 CAMPEAU DRIVE, OTTAWA, ON

NOTES & DETAILS

PROJECT No.	20027
SURVEY	STANTEC
DATED	AUGUST 2021
DWG. No.	20027-N1

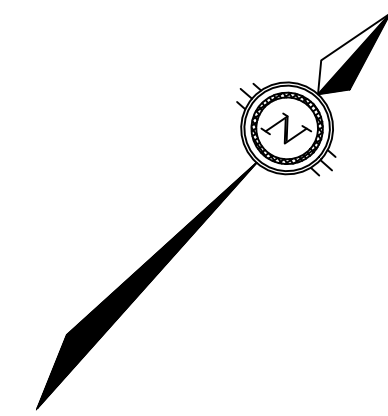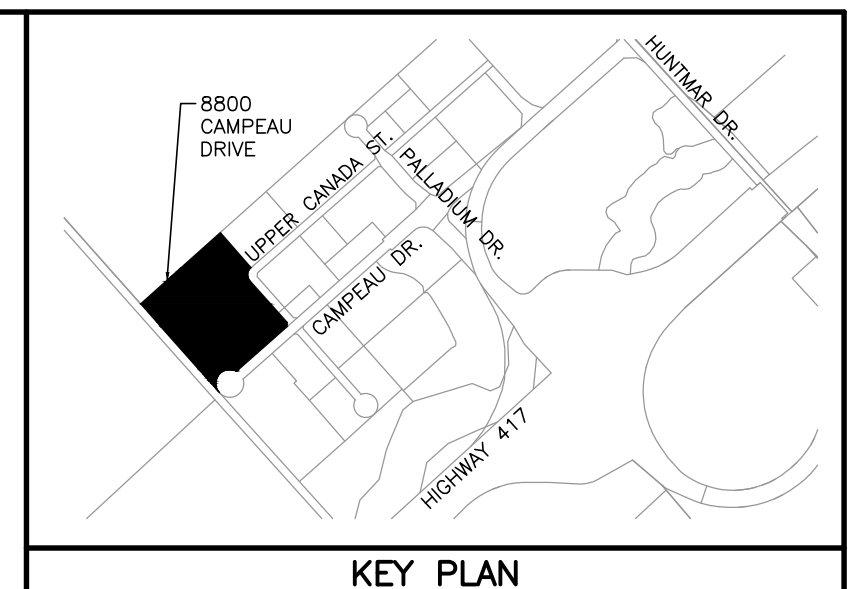


LEGEND

- PROPERTY BOUNDARY
- + 106.00 EXISTING ELEVATION
- - - EXISTING DITCH
- EXISTING CATCH BASIN
- EXISTING STORM SEWER & MANHOLE
- EXISTING SANITARY SEWER & MANHOLE
- EXISTING WATERMAIN
- ◆ EXISTING HYDRANT
- ⊕ EXISTING VALVE & VALVE BOX
- - - 100m NO-BUILD SETBACK
- ⊕ BOREHOLE
- ▨ EXISTING CURB REMOVAL
- ▩ EXISTING ASPHALT REMOVAL
- ▧ EXISTING SIDEWALK REMOVAL

NOTES:

1. THE CONTRACTOR SHALL CONFIRM THE LOCATION OF ALL EXISTING UTILITIES WITHIN THE SITE AND ADJACENT WORK AREAS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING ALL EXISTING UTILITIES TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR OR REPLACEMENT OF ANY SERVICES OR UTILITIES DISTURBED DURING CONSTRUCTION, TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION.
2. ANY AREAS BEYOND THE LIMIT OF THE SITE DISTURBED DURING CONSTRUCTION SHALL BE RESTORED TO ORIGINAL CONDITION OR BETTER TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION AT THE CONTRACTOR'S EXPENSE.
3. RELOCATION OF EXISTING SERVICES AND/OR UTILITIES SHALL BE AS SHOWN ON THE DRAWINGS OR AS DIRECTED BY THE ENGINEER AT THE EXPENSE OF THE CONTRACTOR.
4. THE SUPPORT OF ALL UTILITIES SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
5. ALL NECESSARY CLEARING AND GRUBBING SHALL BE COMPLETED BY THE CONTRACTOR. REVIEW WITH CONTRACT ADMINISTRATOR AND THE CITY OF OTTAWA PRIOR TO AND TREE CUTTING.
6. REFER TO GEOTECHNICAL INVESTIGATION PREPARED BY PATERSON GROUP, REPORT NO. PG5618-1, DATED MAY 11, 2021.
7. ALL EXISTING ASPHALT TO BE SAW-CUT.
8. REINSTATE ROAD CUTS IN ACCORDANCE WITH CITY STANDARD R10.


NOT FOR CONSTRUCTION

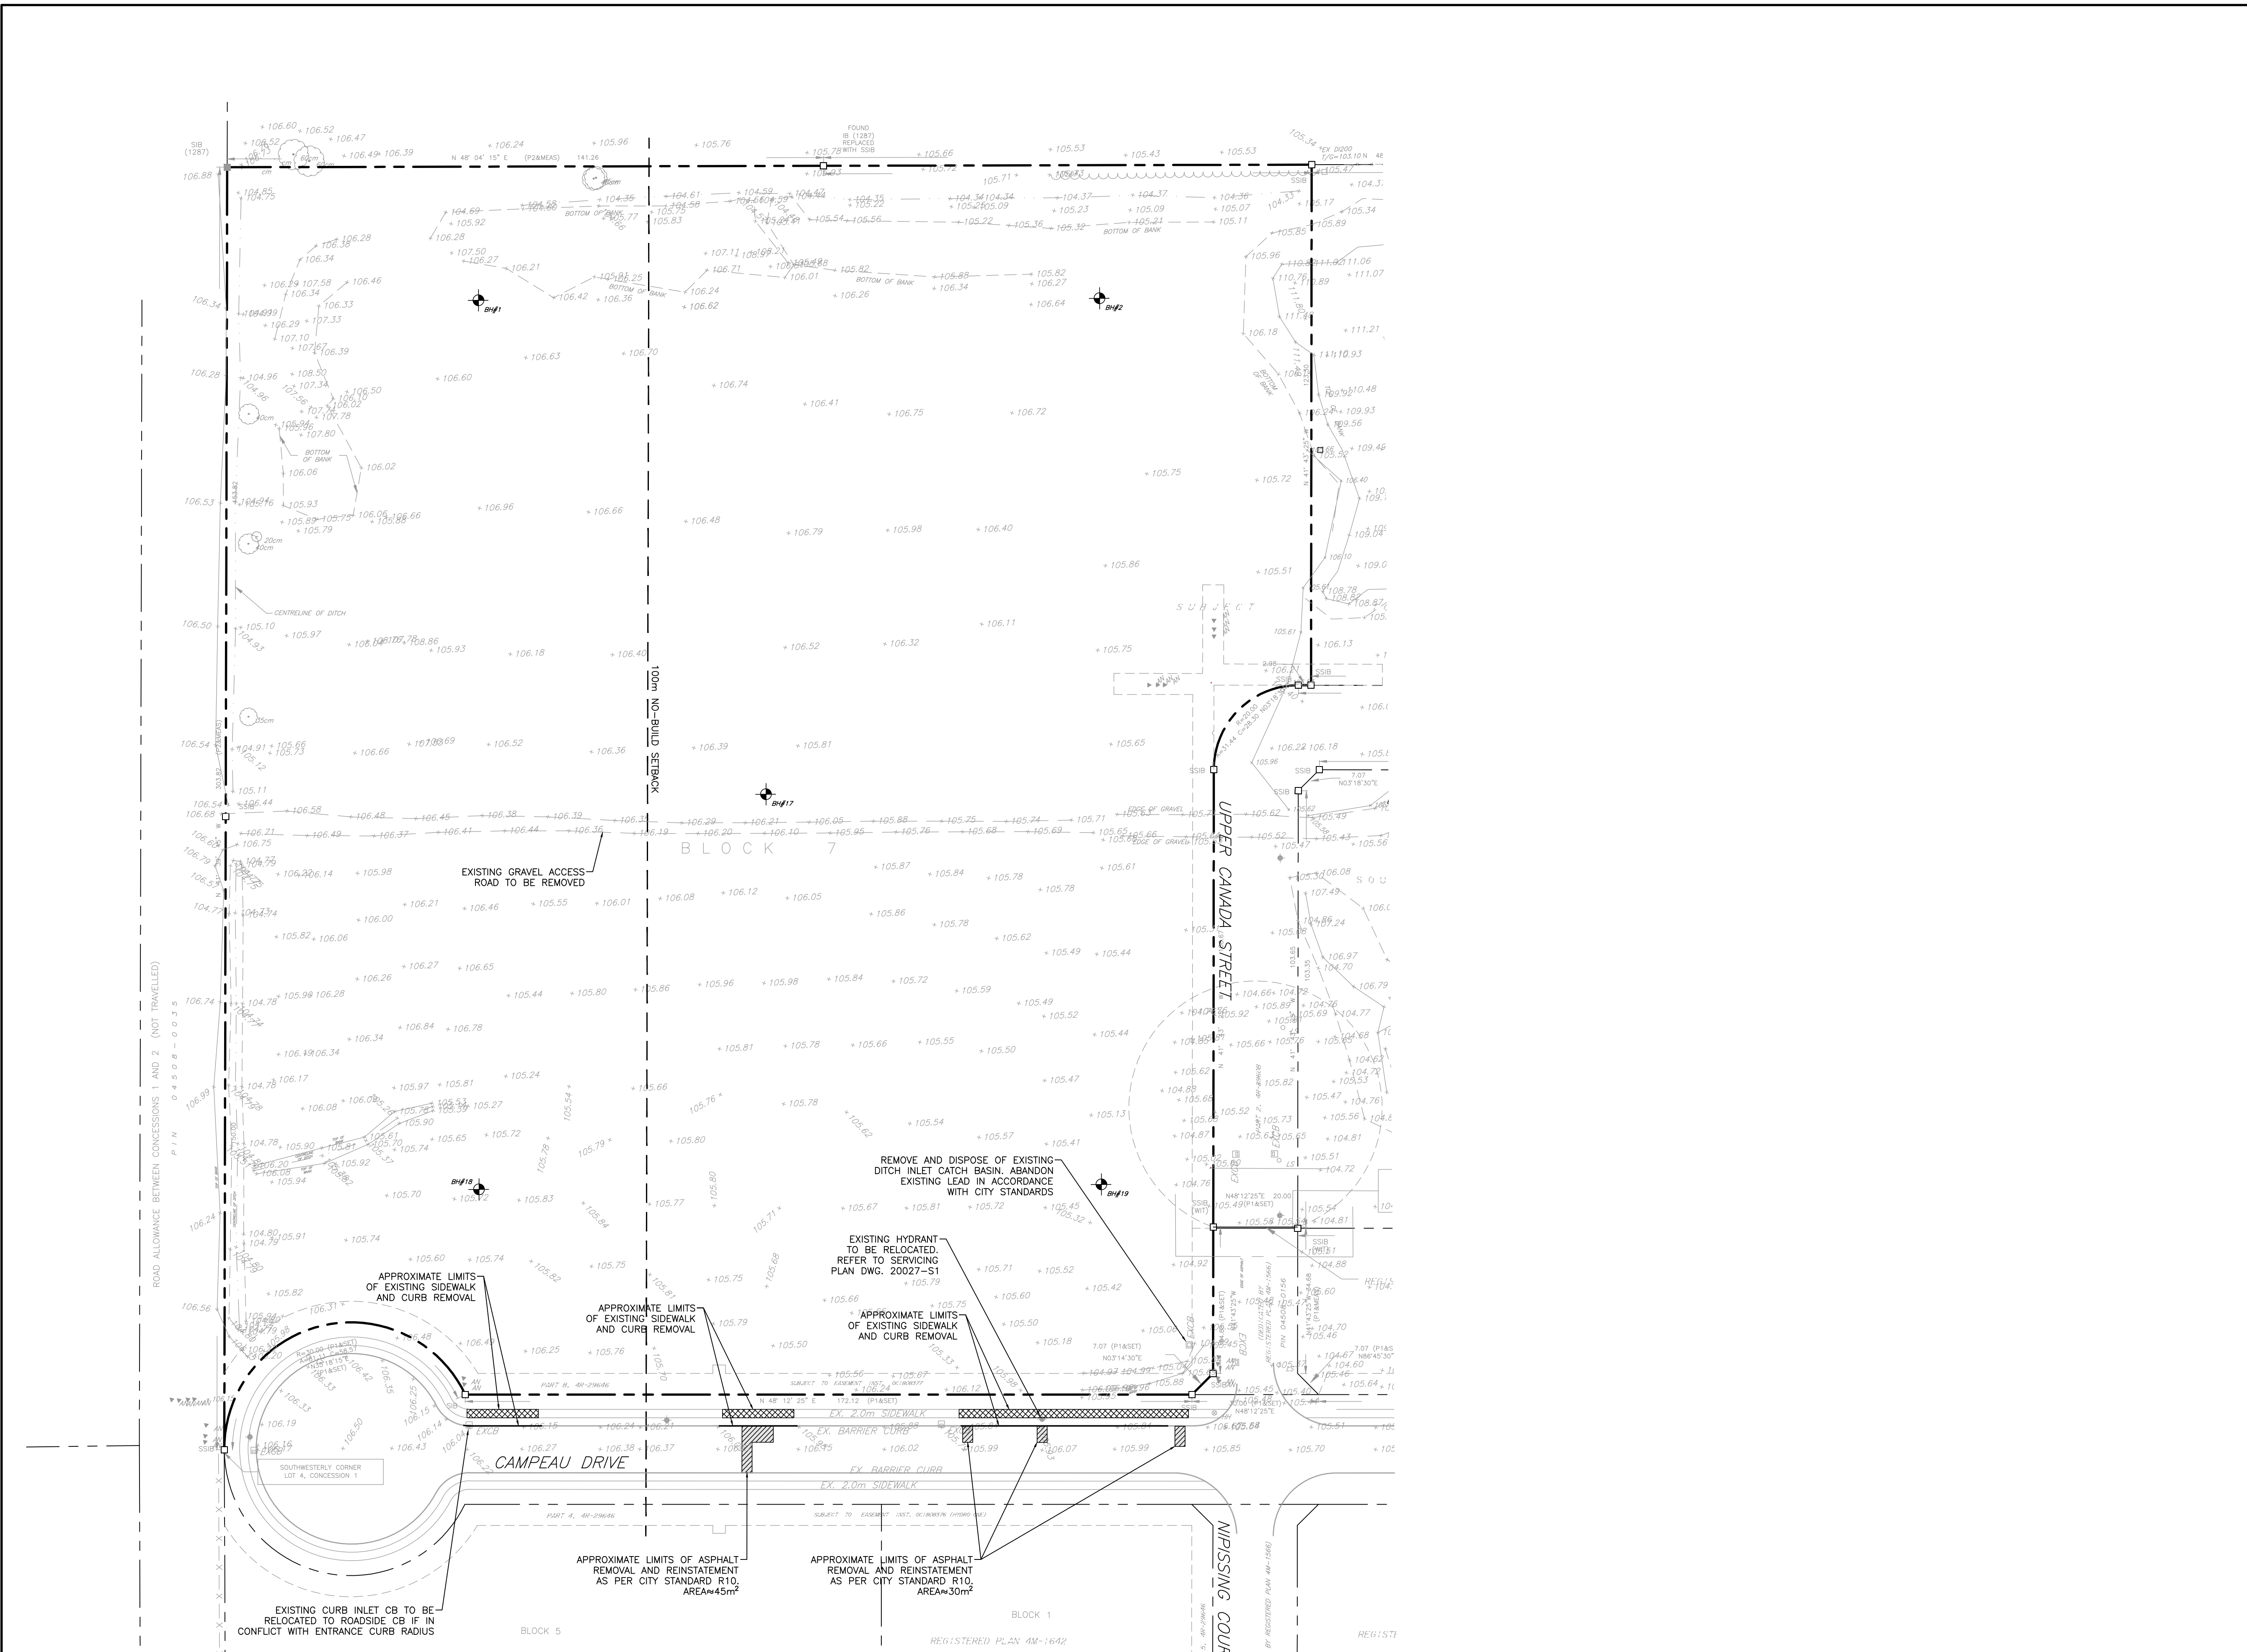

NOTES

THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

NO.	REVISION DESCRIPTION	DATE	BY
3	REVISED PER COMMENTS	09/08/21	SMC
2	ISSUED FOR TENDER	11/06/21	SMC
1	REVISED PER COMMENTS	28/05/21	SMC

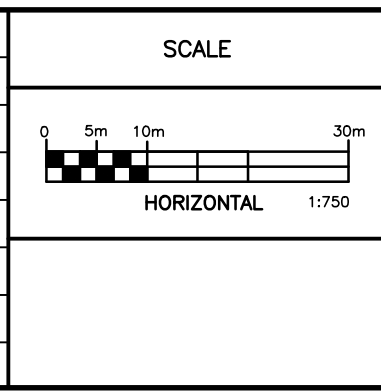



Robinson
Land Development

350 Palladium Drive
Ottawa, ON K2V 1A8
(613) 592-6060 rcii.com

DESIGN	BLM
CHECKED	SMC
DRAWN	BLM
CHECKED	SMC
APPROVED	SMC

**MARITIME-ONTARIO
FREIGHT LINES LIMITED**

**KANATA WEST BUSINESS PARK
8800 CAMPEAU DRIVE, OTTAWA, ON**

**EXISTING CONDITIONS
AND REMOVALS PLAN**

PROJECT No.	20027
SURVEY	STANTEC
DATED	AUGUST 2021
DWG. No.	20027-R1

Appendix C

KWBP Figure 4 – Water Distribution Plan (prepared by IBI Group)

Boundary Conditions


Boundary Condition Model

FUS Long Form

Water Model Outputs

Watermain Design Sheet

J:\14289_Terracelands\5.9 Drawings\59civil\current\Phase 5 Figures\14289-Figures-2019-09-11.dwg Sheet Set: ###

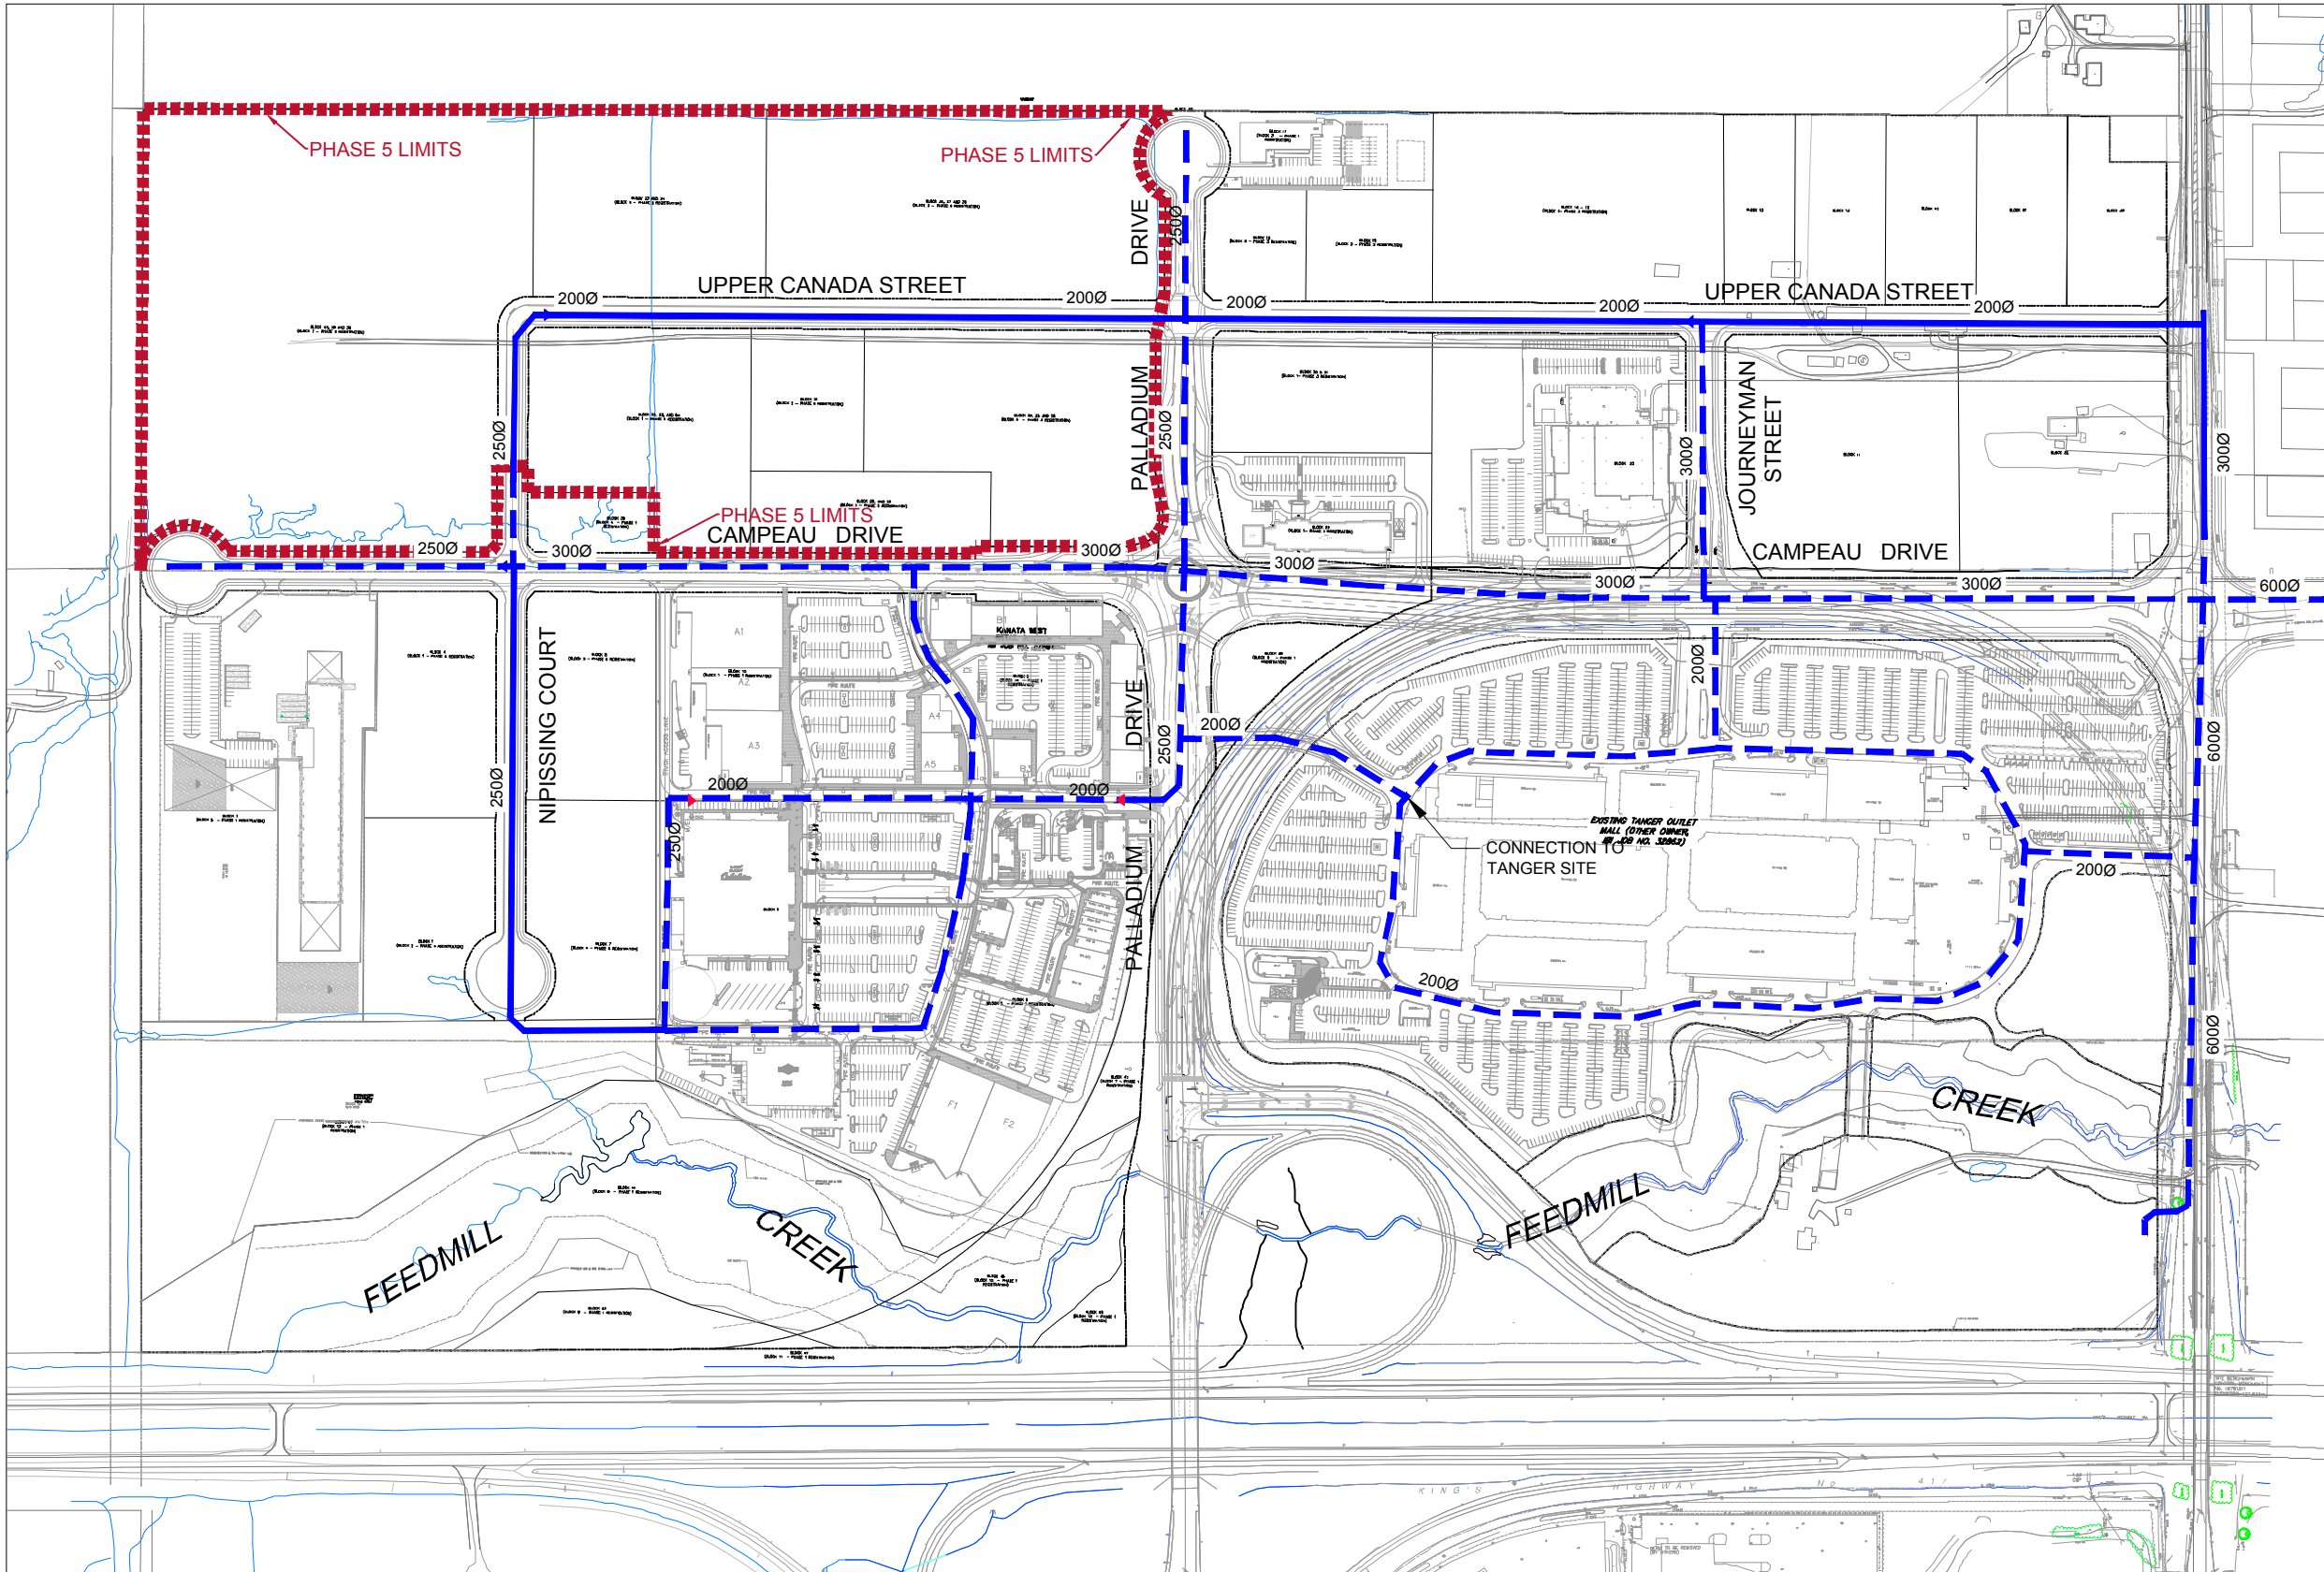

LEGEND

- 3000 EXISTING WATERMAIN AND DIAMETER
- 3000 PROPOSED WATERMAIN AND DIAMETER
- 3000 FUTURE WATERMAIN AND DIAMETER

Plot Style: AIA STANDARD COLOR-HALF.CTB Plot Scale: 0.039:1 Plotted At: Sep. 11, 19 8:26 AM Printed By: DDN SIURNA Last Saved By: DSIURNA Last Saved At: Sep. 11, 19

Boundary Conditions 8800 Campeau Drive

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	161	2.69
Maximum Daily Demand	242	4.03
Peak Hour	436	7.26
Fire Flow Demand #1	9,000	150.00

Location



Results

Connection 1 – Campeau Dr.

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	161.4	80.2
Peak Hour	156.3	72.9
Max Day plus Fire 1	122.6	25.1

¹ Ground Elevation = 104.98 m

Connection 2 – Upper Canada St.

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	161.4	80.2
Peak Hour	156.3	72.9
Max Day plus Fire 1	136.0	44.1

¹ Ground Elevation = 104.99 m


Notes

1. A second connection to the watermain is required since the basic day demand is above 50m³/d.
2. As per the Ontario Building Code in areas that may be occupied, the static pressure at any fixture shall not exceed 552 kPa (80 psi.) Pressure control measures to be considered are as follows, in order of preference:
 - a. If possible, systems to be designed to residual pressures of 345 to 552 kPa (50 to 80 psi) in all occupied areas outside of the public right-of-way without special pressure control equipment.
 - b. Pressure reducing valves to be installed immediately downstream of the isolation valve in the home/ building, located downstream of the meter so it is owner maintained.

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

MARATIME

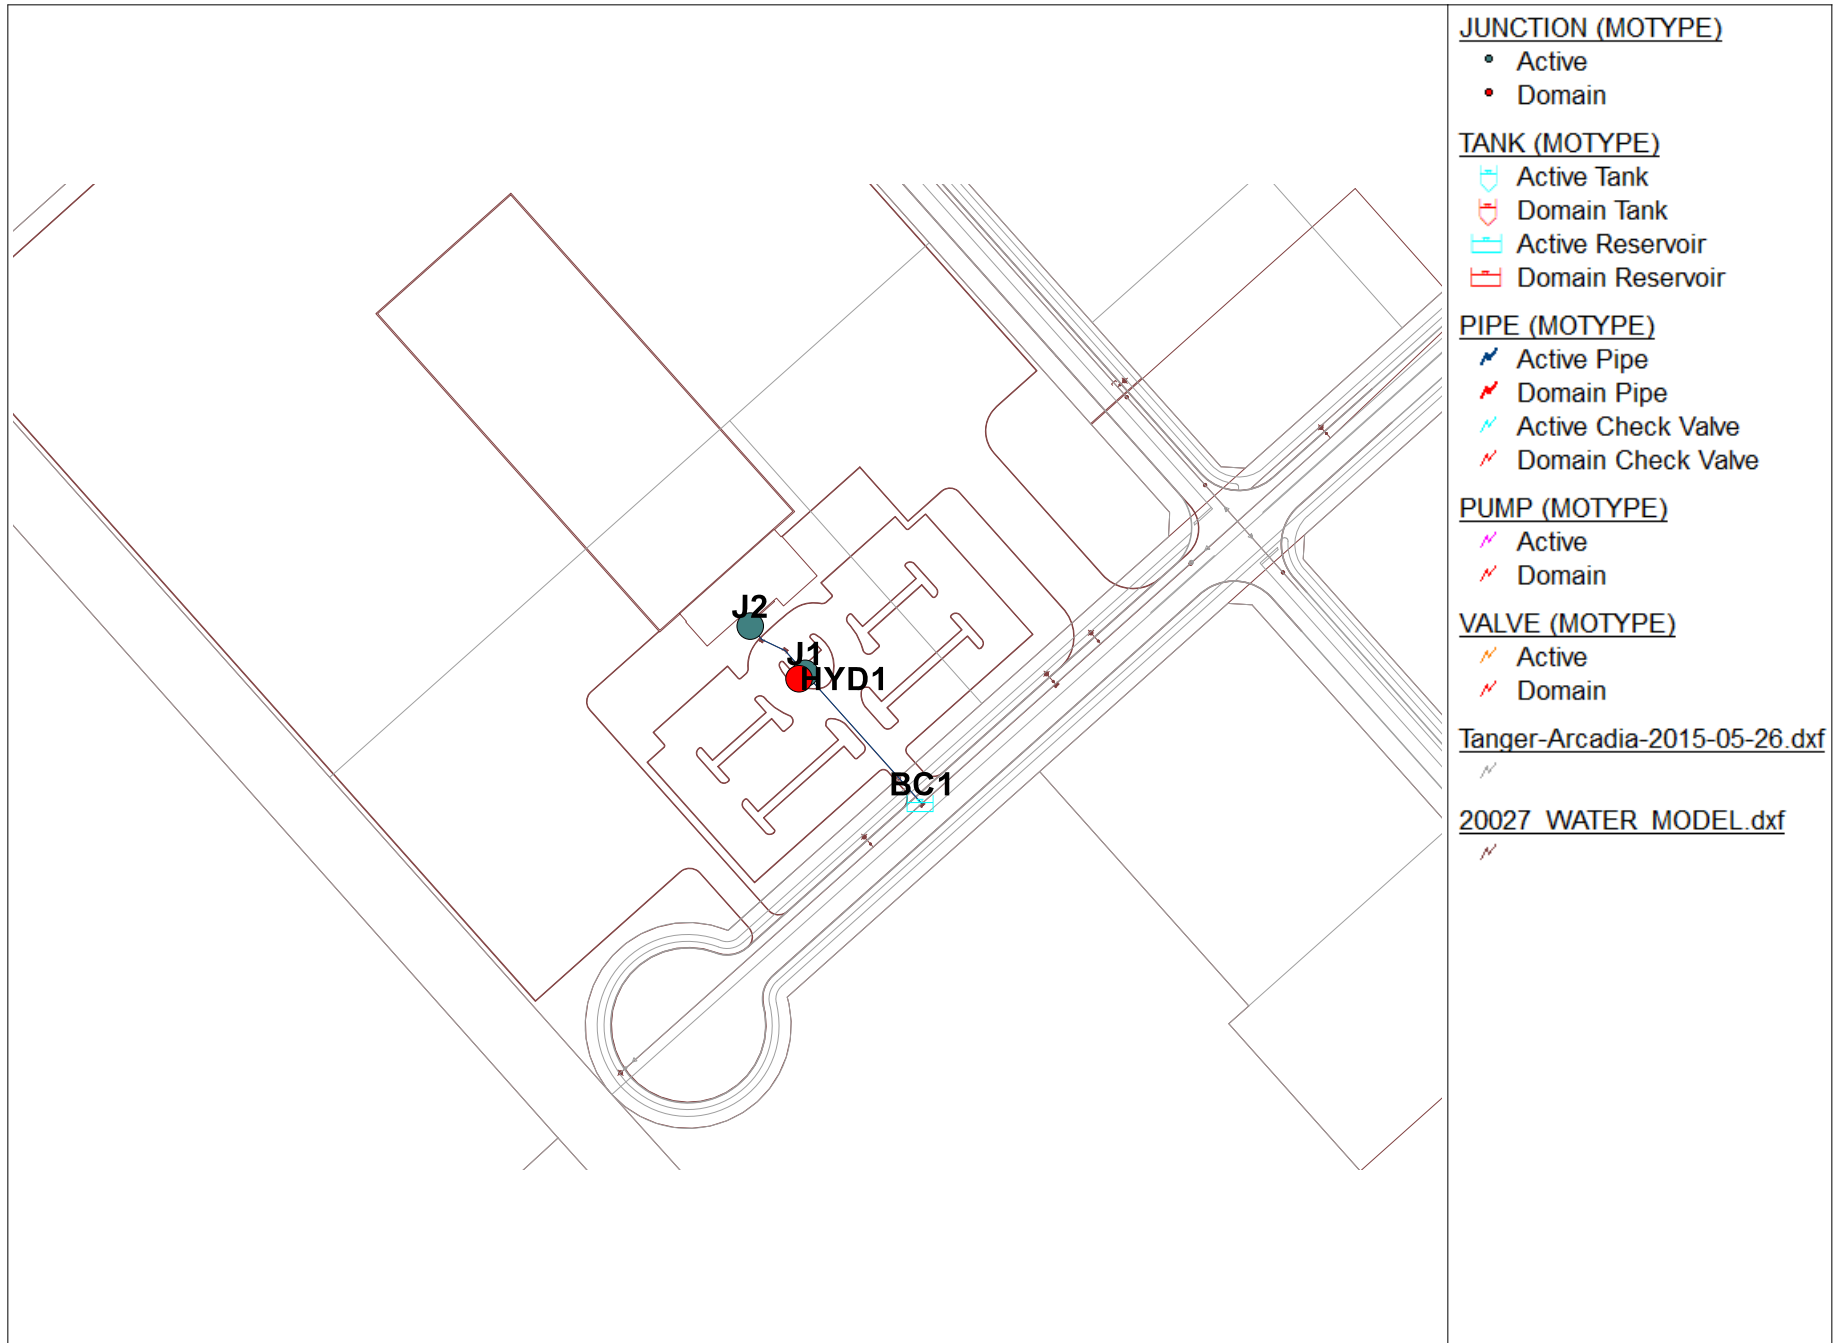

JUNCTION (MOTYPE)

- Active
- Domain

TANK (MOTYPE)

- Active Tank
- Domain Tank
- Active Reservoir
- Domain Reservoir

PIPE (MOTYPE)

- Active Pipe
- Domain Pipe
- Active Check Valve
- Domain Check Valve

PUMP (MOTYPE)

- Active
- Domain

VALVE (MOTYPE)

- Active
- Domain

Tanger-Arcadia-2015-05-26.dxf

20027 WATER MODEL.dxf



FUS Fire Flow Calculations

Project #: 20027
 Project Name: Maritime Ontario - Kanata West
 Date: 27-Oct-20

Calculations Based on 1999 Publication "Water Supply for Public Fire Protection" by Fire Underwriters' Survey (FUS)

Building Type/Description/Name: Commercial Warehouse

Table A: Fire Underwriters Survey Determination of Required Fire Flow - Long Method									
Step	Task	Term	Options	Multiplier Associated with Option	Choose:	Value Used	Unit	Total Fire Flow (L/min)	
1	Choose Frame Used for Construction of Unit	Coefficient related to type of construction (C)	Framing Material						
			Wood Frame	1.5	Fire resistive construction (> 2 hrs)	0.6	m		
			Ordinary Construction	1					
			Non-combustible construction	0.8					
			Fire resistive construction (< 2 hrs)	0.7					
Fire resistive construction (> 2 hrs)	0.6								
2	Choose Type of Housing (if TH, Enter Number of Units per TH Block)	Type of Housing	Floor Space Area						
			Single Family	1	Other (comm, ind, etc.)	1	Units		
			Townhouse - indicate # of units	1					
			Other (comm, ind, etc.)	1					
2.2	# of Storeys	Number of Floors/Storeys in the Unit (do not include basement):		2				2	Storeys
2.3	Length-height factor	Length	North Side	52.7	Length-Height factor	105.4	m.Storeys		
			East Side	142.3	Length-Height factor	284.6	m.Storeys		
			South Side	52.7	Length-Height factor	105.4	m.Storeys		
			West Side	142.3	Length-Height factor	284.6	m.Storeys		
3	Enter Ground Floor Area of One Unit	Measurement Units	Enter Ground Floor Area (A) of One Unit Only:		7130	7130	Area in Square Metres (m ²)		
			Square Feet (ft ²)	0.09290304	Square Metres (m ²)				
			Square Metres (m ²)	1					
			Hectares (ha)	10,000					
4	Obtain Required Fire Flow Without Reductions	Required Fire Flow (without reductions or increases per FUS) (F=220*C ^{1/4} *A), round to nearest 1000 L/min						11000	
5	Apply Factors Affecting Burning	Reductions/Increases Due to Factors Affecting Burning							
5.1	Choose Combustibility of Building Contents	Occupancy content hazard reduction or surcharge	Non-combustible	-0.25	Combustible	0	N/A	11000	
			Limited Combustible	-0.15					
			Combustible	0					
			Free burning	0.15					
			Rapid Burning	0.25					
5.2	Choose Reduction Due to Presence of Sprinklers	Sprinkler reduction	Complete Automatic Sprinkler Protection	-0.5	Complete Automatic Sprinkler Protection	-0.5	N/A	-5500	
			None	0					
5.3	Choose Separation Distance Between Units	Exposure Distance Between Units	North Side	50	5%	0.2	N/A	2200	
			East Side	50					
			South Side	50					
			West Side	50					
6	Obtain Required Fire Flow, Duration & Volume	Total Required Fire Flow, rounded to nearest 1000 L/min:						8000	
		Total Required Fire Flow (above) in L/s:						133.333333	
		Required Duration of Fire Flow (hrs)						2	
		Required Volume of Fire Flow (m³)						960	

Note: The most current FUS document should be referenced before design to ensure that the above figures are consistent with the intent of the Guidelines

Legend	
	Drop down menu - choose option, or enter value
	No information, No input required

Maritime-Ontario - Maximum Pressure Junction Output

		ID	Demand (Lpm)	Elevation (m)	Head (m)	Pressure (psi)
1	<input type="checkbox"/>	HYD1	0.00	107.78	161.40	76.22
2	<input type="checkbox"/>	J1	0.00	107.20	161.40	77.04
3	<input type="checkbox"/>	J2	161.40	108.10	161.39	75.76

Maritime-Ontario - Peak Hour Junction Report

	ID	Demand (Lpm)	Elevation (m)	Head (m)	Pressure (psi)
1	HYD1	0.00	107.78	156.28	68.94
2	J1	0.00	107.20	156.28	69.77
3	J2	435.60	108.10	156.27	68.47

Maritime-Ontario - Fireflow Report

	ID	Total Demand (Lpm)	Critical Fire Node ID	Adjusted Fire-Flow (Lpm)	Available Flow at Hydrant (Lpm)
1	<input type="checkbox"/> HYD1	6,959.95	HYD1	11,556.07	11,556.43

Maritime-Ontario - Fireflow Report

	ID	Design Flow (Lpm)
1 <input type="checkbox"/>	HYD1	11,556.07

Maritime-Ontario - Pipe Report

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness
1	<input type="checkbox"/>	P1	BC1	J1	51.01	203.00	110.00
2	<input type="checkbox"/>	P2	J1	HYD1	2.39	152.00	100.00
3	<input type="checkbox"/>	P3	J1	J2	21.49	203.00	110.00

WATERMAIN DESIGN SHEET

Maritime Ontario - Kanata West

Project No. 20027

TABLE

Junction Node Number	RESIDENTIAL POPULATION				NON-RES		AVG. DAILY				MAX. DAILY				MAX. HOURLY					
	ACTUAL COUNT				COMM. (HA)	INST. (HA)	DEMAND (l/s)				DEMAND (l/s)				DEMAND (l/s)					
	Low Density	Medium Density	High Density	Total Population			RES.	IND.	INST.	TOTAL	RES.	IND.	INST.	TOTAL	RES.	IND.	INST.	TOTAL		
J1					6.64			2.69			2.69		4.03			4.03		7.26		7.26
Total					6.64			2.69			2.69		4.03			4.03		7.26		7.26

Residential Densities

Low Density (SFH's) = 3.4 cap/unit
 Medium Density (Townhouses) = 2.7 cap/unit
 High Density (Apartments) = 1.8 cap/unit

Avg. Daily Demand:

Residential = 350 L/cap/day
 Commercial = 60000 L/ha/day
 Institutional = 15000 L/ha/day
 Industrial Light = 35000 L/ha/day

Max. Daily Demand:

2.5 x Avg. Day
 1.5 x Avg. Day
 1.5 x Avg. Day
 1.5 x Avg. Day

Max. Hourly Demand:

2.2 x Max. Day
 1.8 x Max. Day
 1.8 x Max. Day
 1.8 x Max. Day

Appendix D


KWBP Figure 5 – Wastewater Plan
(prepared by IBI Group)

KWBP Sanitary Drainage Area Plan
(prepared by IBI Group)

KWBP Sanitary Sewer Design Sheet
(prepared by IBI Group)

Sanitary Sewer Design Sheet

J:\14289_Terracotta\5.9 Drawings\59civil\current\Phase 5 Figures\14289-Figures-2019-09-11.dwg Sheet Set: ###

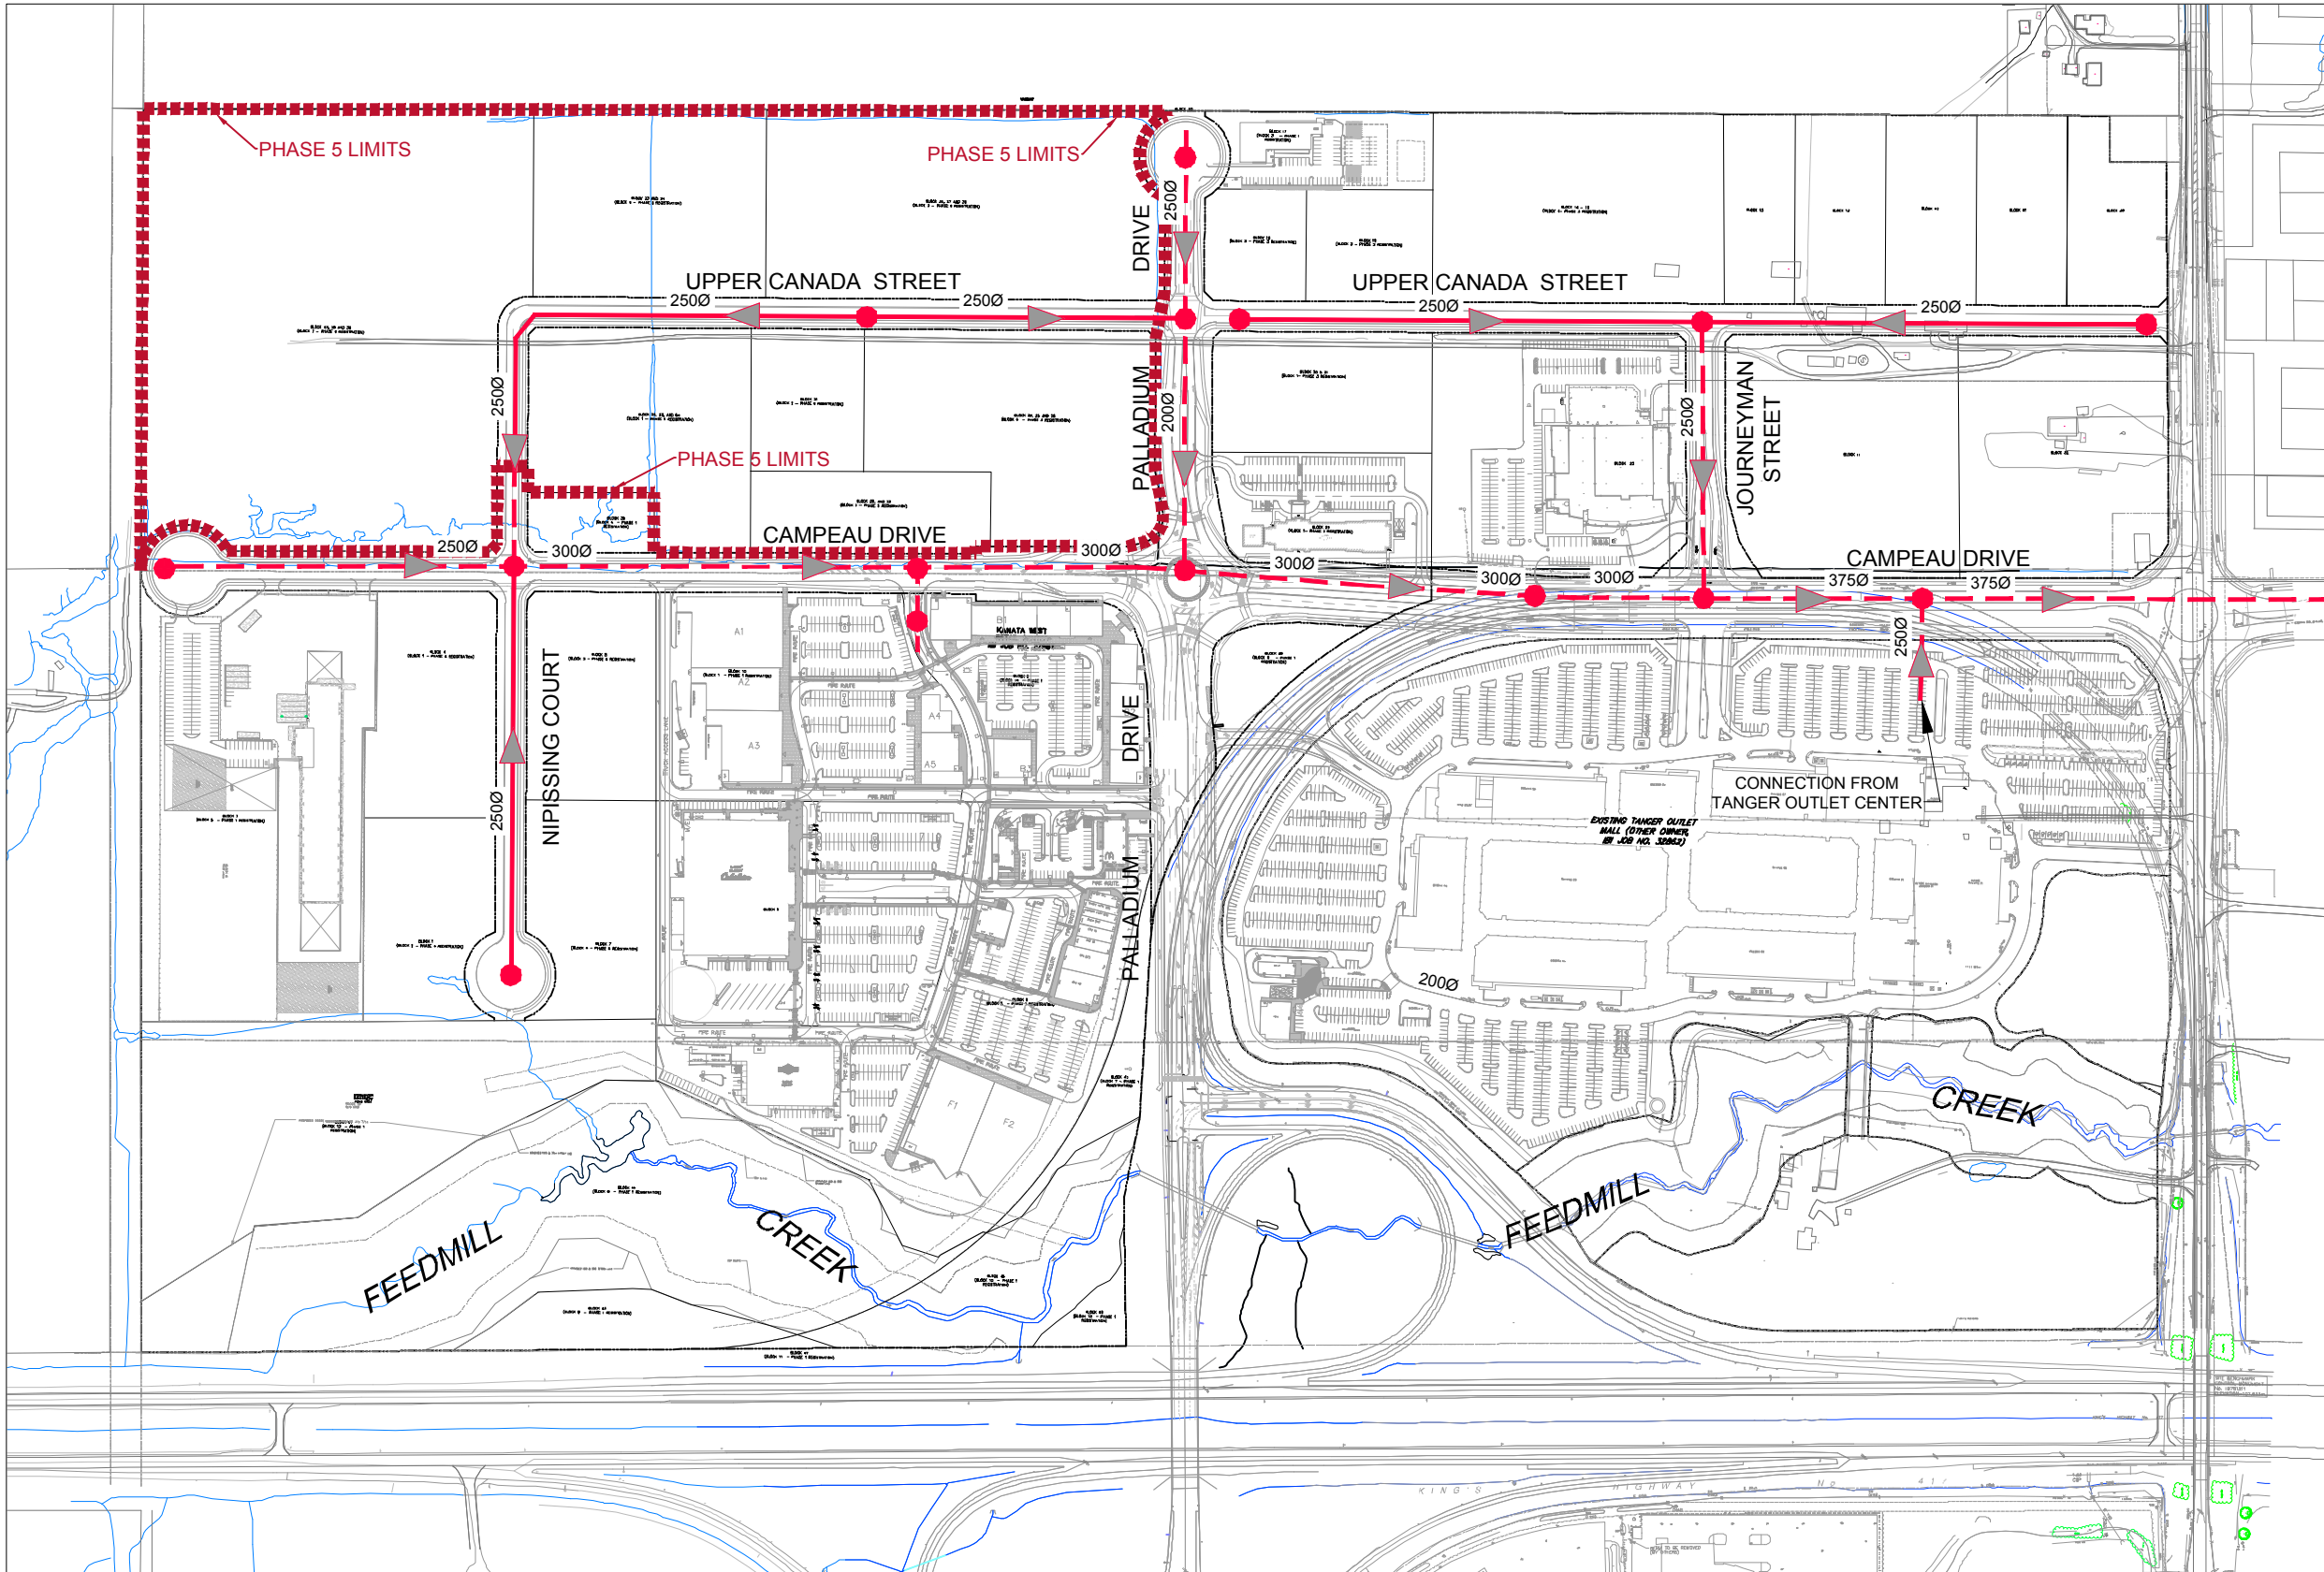

LEGEND

- 3000 EXISTING WASTE WATER AND DIAMETER
- 3000 PROPOSED WASTE WATER AND DIAMETER

Plot Style: AIA STANDARD COLOR-HALF.CTB Plot Scale: 0.039:1 Plotted At: Sep. 11, 19 8:27 AM Printed By: DDN SIURNA Last Saved By: DSIURNA Last Saved At: Sep. 11, 19



IBI Group
400-333 Preston Street
Ottawa, Ontario
K1S 5N4

SANITARY SEWER DESIGN SHEET

PROJECT: KANATA WEST BUSINESS PARK
LOCATION: 333 HUNTMAR DRIVE
CLIENT: TAGGART

LOCATION				RESIDENTIAL									ICI AREAS						INFILTRATION ALLOWANCE			FIXED FLOW	TOTAL FLOW	PROPOSED SEWER DESIGN										
STREET	AREA ID	FROM MH	TO MH	UNIT TYPES				AREA (Ha)	POPULATION		PEAK FACTOR	PEAK FLOW (L/s)	AREA (Ha)			PEAK FLOW (L/s)	FLOW (L/s)		FIXED FLOW (L/s)	TOTAL FLOW (L/s)	CAPACITY (L/s)	LENGTH (m)	DIA (mm)	SLOPE (%)	VELOCITY (full) (m/s)	VELOCITY (actual) (m/s)	AVAILABLE CAPACITY							
				SF	SD	TH	APT		IND	CUM			IND	CUM	IND		CUM	PF									IND	CUM	IND	CUM	L/s	(%)		
KANATA WEST BUSINESS PARK - Block number based on overall concept plan of subdivision																																		
Upper Canada Street	Blocks 31	MH154A	MH153A									0.70	0.70			0.00	1.50	0.34	0.92	0.92	0.30	0.00	0.64	43.87	110.00	250	0.50	0.866	0.301	43.22	98.53			
	Blocks 35, 53, 54											1.84	2.54			0.00	1.50	1.23	2.06	2.98		0.00	1.23											
	Blocks 33, 34	MH153A	MH152A											1.89	1.89	5.90	4.52	1.89	4.87	1.61	0.00	7.36	39.24	114.86	250	0.40	0.774	0.543	31.88	81.24				
		MH152A	MH151A													1.89	5.90	5.75	0.03	4.90	1.62	0.00	7.37	36.70	10.84	250	0.35	0.724	0.562	29.33	79.92			
	Blocks 37, 38, 39	MH151A	MH150A											2.54	7.04	8.93	4.50	17.51	7.24	12.14	4.01	0.00	21.52	36.70	102.56	250	0.35	0.724	0.753	15.18	41.37			
		MH150A	MH101A											2.54		8.93	4.50	17.51	7.24	12.14	4.01	0.00	21.52	36.70	63.86	250	0.35	0.724	0.753	15.15	41.27			
Campeau Drive	Blocks 3	MH99A	MH100A									4.18	4.18								2.03	4.68	4.68	1.54	0.00	3.58	50.02	112.75	250	0.65	0.987	0.570	46.44	92.85
		MH100A	MH101A											4.18							2.03	0.25	4.93	1.63	0.00	3.66	51.91	101.44	250	0.70	1.024	0.571	48.25	92.95
Nipissing Court	Blocks 1, 7	MH123A	MH122A											2.23	2.23	6.25	5.65	2.59	2.59	0.85	0.00	6.50	50.02	65.18	250	0.65	0.987	0.607	43.52	87.00				
		MH122A	MH121A											2.23	2.23	6.25	5.65	2.59	2.79	0.92	0.00	6.57	50.02	100.00	250	0.65	0.987	0.607	43.45	86.87				
	Blocks 4, 5	MH121A	MH101A											2.37	2.37	6.80	6.25	2.61	5.40	1.78	0.00	8.58	85.51	97.00	250	1.90	1.988	1.038	76.93	89.97				
Campeau Drive	Block 36	MH101A	MH103A									0.33	9.42			11.16	4.75	26.05	0.56	23.14	7.64	0.00	33.69	43.87	93.00	250	0.50	0.866	0.952	10.18	23.20			
	Block 32, 54	MH103A	MH104A									1.00	10.42			11.16	4.75	26.54	1.31	24.45	8.07	0.00	34.61	43.87	120.00	250	0.50	0.866	0.952	9.26	21.11			
Campeau Drive	Block 29, 32	MH104A	MH105A									0.85	11.27			11.16	4.75	26.95	0.99	25.44	8.40	0.00	35.35	43.87	53.11	250	0.50	0.866	0.952	8.52	19.42			
KWRC	Blocks 6, 8, 9, 10		MH 105A																		5.73	11.78	11.78	3.89	0.00	9.61	39.24	12.01	250	0.40	0.774	0.601	29.62	75.50
Campeau Drive	Block 24	MH105A	MH106A																															
		MH106A	MH107A									0.75	12.02			11.78	4.75	33.04	1.10	38.60	12.74	0.00	45.78	59.68	90.92	300	0.35	0.818	0.900	13.90	23.29			
Upper Canada Street	Blocks 26, 27, 30	MH154A	MH156A											3.19	3.19	5.50	7.11	3.40	3.40	1.12	0.00	8.23	50.02	107.00	250	0.65	0.987	0.692	41.79	83.55				
		MH156A	MH131A													3.19	5.50	7.11	0.19	3.59	1.18	0.00	8.29	50.02	101.71	250	0.65	0.987	0.692	41.73	83.42			
Palladium Drive	Blocks 17	MH130A	MH131A											0.00	0.71	0.71	5.50	1.58	1.18	0.39	0.00	1.97	50.02	106.00	250	0.65	0.987	0.467	48.05	96.06				
Palladium Drive		MH131A	MH132A																															
	Block 23, 24, 25, 28	MH132A	MH133A									3.30	3.30			3.90	5.25	9.90	3.56	8.56	2.82	0.00	12.72	43.87	71.26	250	0.50	0.866	0.730	31.14	71.00			
		MH133A	MH107A													3.90	5.25	9.90	0.17	8.73	2.88	0.00	12.78	107.45	42.79	250	3.00	2.121	1.304	94.67	88.11			
Campeau Drive	Block 49	MH107A	MH108A																															
		MH108A	EX604A																															
	Block 22	MH 604A	MH 603A									2.63	17.95			12.20	15.06	4.40	41.50	3.03	51.82	17.10	0.00	58.60	62.51	102.12	300	0.38	0.857	0.942	3.91	6.26		
Upper Canada Street	Blocks 18, 19, 20, 21	MH160A	MH161A																															
		MH161A	MH162A																															
	Block 14- 16	MH162A	MH140A											2.23	2.23	5.75	6.32	2.45	4.93	1.63	0.00	7.95	50.02	112.00	250	0.65	0.987	0.692	42.07	84.10				
		MH162A	MH140A													2.23	5.75	6.32	0.22	5.15	1.70	0.00	8.02	63.57	110.98	250	1.05	1.255	0.772	55.55	87.38			
Upper Canada Street	Blocks 40, 41	MH167A	MH166A																															
	Block 42	MH166A	MH165A																															
	Blocks 12, 13	MH165A	MH140A											0.00	1.49	3.68	5.30	7.90	1.68	4.28	1.41	0.00	9.31	39.24	99.02	250	0.40	0.774	0.601	29.92	76.26			
Journeyman Street		MH140A	MH141A																															
		MH141A	MH [84]																															
		Stub	MH 603A																															
Campeau Drive	Block 11	MH 603A	MH 602A																															
	Tanger Outlet Centres	MH 602A	MH 601A																															
	Block 52	MH 601A	MH 600A																															
Campeau Drive	Block XX	MH XXX	MH XXX																															

Campeau Drive Block XX MH XXX MH XXX Light Grey = Constructed Sewer

Design Parameters:				Notes:				Designed: LME		No.				Revision				Date			
Residential		ICI Areas		Peak Factor (PF)		1. Manning's coefficient (n) = 0.013				1.		City submission No. 1		2014-11-25							
SF	3.4 p/p/u					2. Demand (per capita): 280 L/day 300 L/day				2.		City submission No. 2		2015-04-08							
TH/SD	2.7 p/p/u	P.B.P.	28,000 L/Ha/day	1.5		3. Infiltration allowance: 0.33 L/s/Ha 0.4 L/s/Ha				3.		City submission No. 3		2015-06-18							
APT	1.8 p/p/u	COM	28,000 L/Ha/day	1.5		4. Residential Peaking Factor: Harmon Formula = 1+(14/(4+P^0.5)) K=0.8 where P = population in thousands				4.		City submission No. 4		2015-10-15							
Other	60 p/p/Ha	IND	35,000 L/Ha/day	MOE Chart						5.		Revised for Phase 2 Registration		2018-04-19							
										5.		Revised for Phase 3 Registration		2018-09-14							
										6.		Revised per City Comments (Phase 3)		2018-12-14							
										7.		Revised for Phase 4 Registration		2019-04-26							
										8.		Revised for Phase 4 Registration Comments		2019-06-24							
										9.		Revised for Phase 5 Registration		2019-09-11							
										10.		Revised per City comments for Phase 5 Registration		2019-10-25							
										11.											
										File Reference: 14289.5.7.1		Date: 2018-04-19		Sheet No: 1 of 1							

SANITARY SEWER DESIGN SHEET
for
MARITIME-ONTARIO
8800 CAMPEAU DRIVE, KWBP

LOCATION			AREA (ha)		INDUSTRIAL FLOW				PIPE						
STREET	FROM MH	TO MH	INDIVIDUAL	CUMM.	PEAK FACTOR	PEAK IND. FLOW (L/s)	EXTRAN. FLOW (L/s)	PEAK DESIGN FLOW (L/s)	LENGTH (m)	DIAMETER (mm)	SLOPE (%)	CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	EXCESS CAPACITY (L/s)	PERCENT FULL
TO CAMPEAU DRIVE SANITARY SEWER															
PARKING LOT	BLDG	101	7.04	7.04	4.50	10.27	2.32	12.59	10.3	201.16	1.07	34.49	1.09	21.90	36.50
PARKING LOT	101	100	0.00	7.04	4.50	10.27	2.32	12.59	49.5	201.16	0.34	19.44	0.61	6.85	64.76
PARKING LOT	100	MAIN	0.00	7.04	4.50	10.27	2.32	12.59	17.5	201.16	0.36	20.01	0.63	7.42	62.93
CAMPEAU DRIVE	EX99A	EX100A	4.18	11.22		12.30	3.86	16.17	113.0	250.00	0.65	47.99	0.98	31.82	33.69
CAMPEAU DRIVE	EX100A	EX101A	0.00	11.22		12.30	3.95	16.25	101.3	250.00	0.97	58.63	1.19	42.38	27.72

DESIGN PARAMETERS

<p>Average Daily Flow = L/person/day</p> <p>Comm./Inst. Flow = L/s/ha</p> <p>Light Industrial Flow = 28000 L/ha/d</p> <p>Maximum Residential Peak Factor = 4.0</p> <p>Harmon - Correction Factor (K) = 0.8</p> <p>Peaking Factor = 4.5 (MOE Chart - City of Ottawa Appendix 4-B.1)</p> <p>Extraneous Flow = 0.33 L/s/ha</p> <p>Minimum Full Flow Velocity = 0.60 m/s</p> <p>Maximum Full Flow Velocity = 3.0 m/s</p> <p>Manning's Coefficient (n) = 0.013</p>	<p>Notes:</p> <ol style="list-style-type: none"> 1. Sanitary sewer design parameters in accordance IBI Report for KWBP - Phase 5 2. Refer to drawing Campeau Drive from STA 19+780 to STA 20+110, Drawing No. 101, prepared by IBI Group. 3. Refer to KWBP sanitary sewer design sheet, prepared by IBI Group.
---	---

Appendix E

KWBP Storm Sewer Design Sheet
(prepared by IBI Group)

*KWBP Figure 8 – Proposed Storm
Sewer Plan* (prepared by IBI Group)

KWBP Storm Drainage Area Plan
(prepared by IBI Group)

*KWBP Table 4.2 – Drainage Area
Parameters* (prepared by IBI Group)



KWBP SWMHYMO Schematic
(prepared by IBI Group)

*KWBP Table 4.10 – Summary of
Hydraulic Grade Line* (prepared by IBI
Group)

Aquafor Beech Report Excerpts

Geotechnical Correspondence

*KWBP Figure 2 – Post-Development
SWM Drainage Boundaries Overall Site*
(prepared by IBI Group)

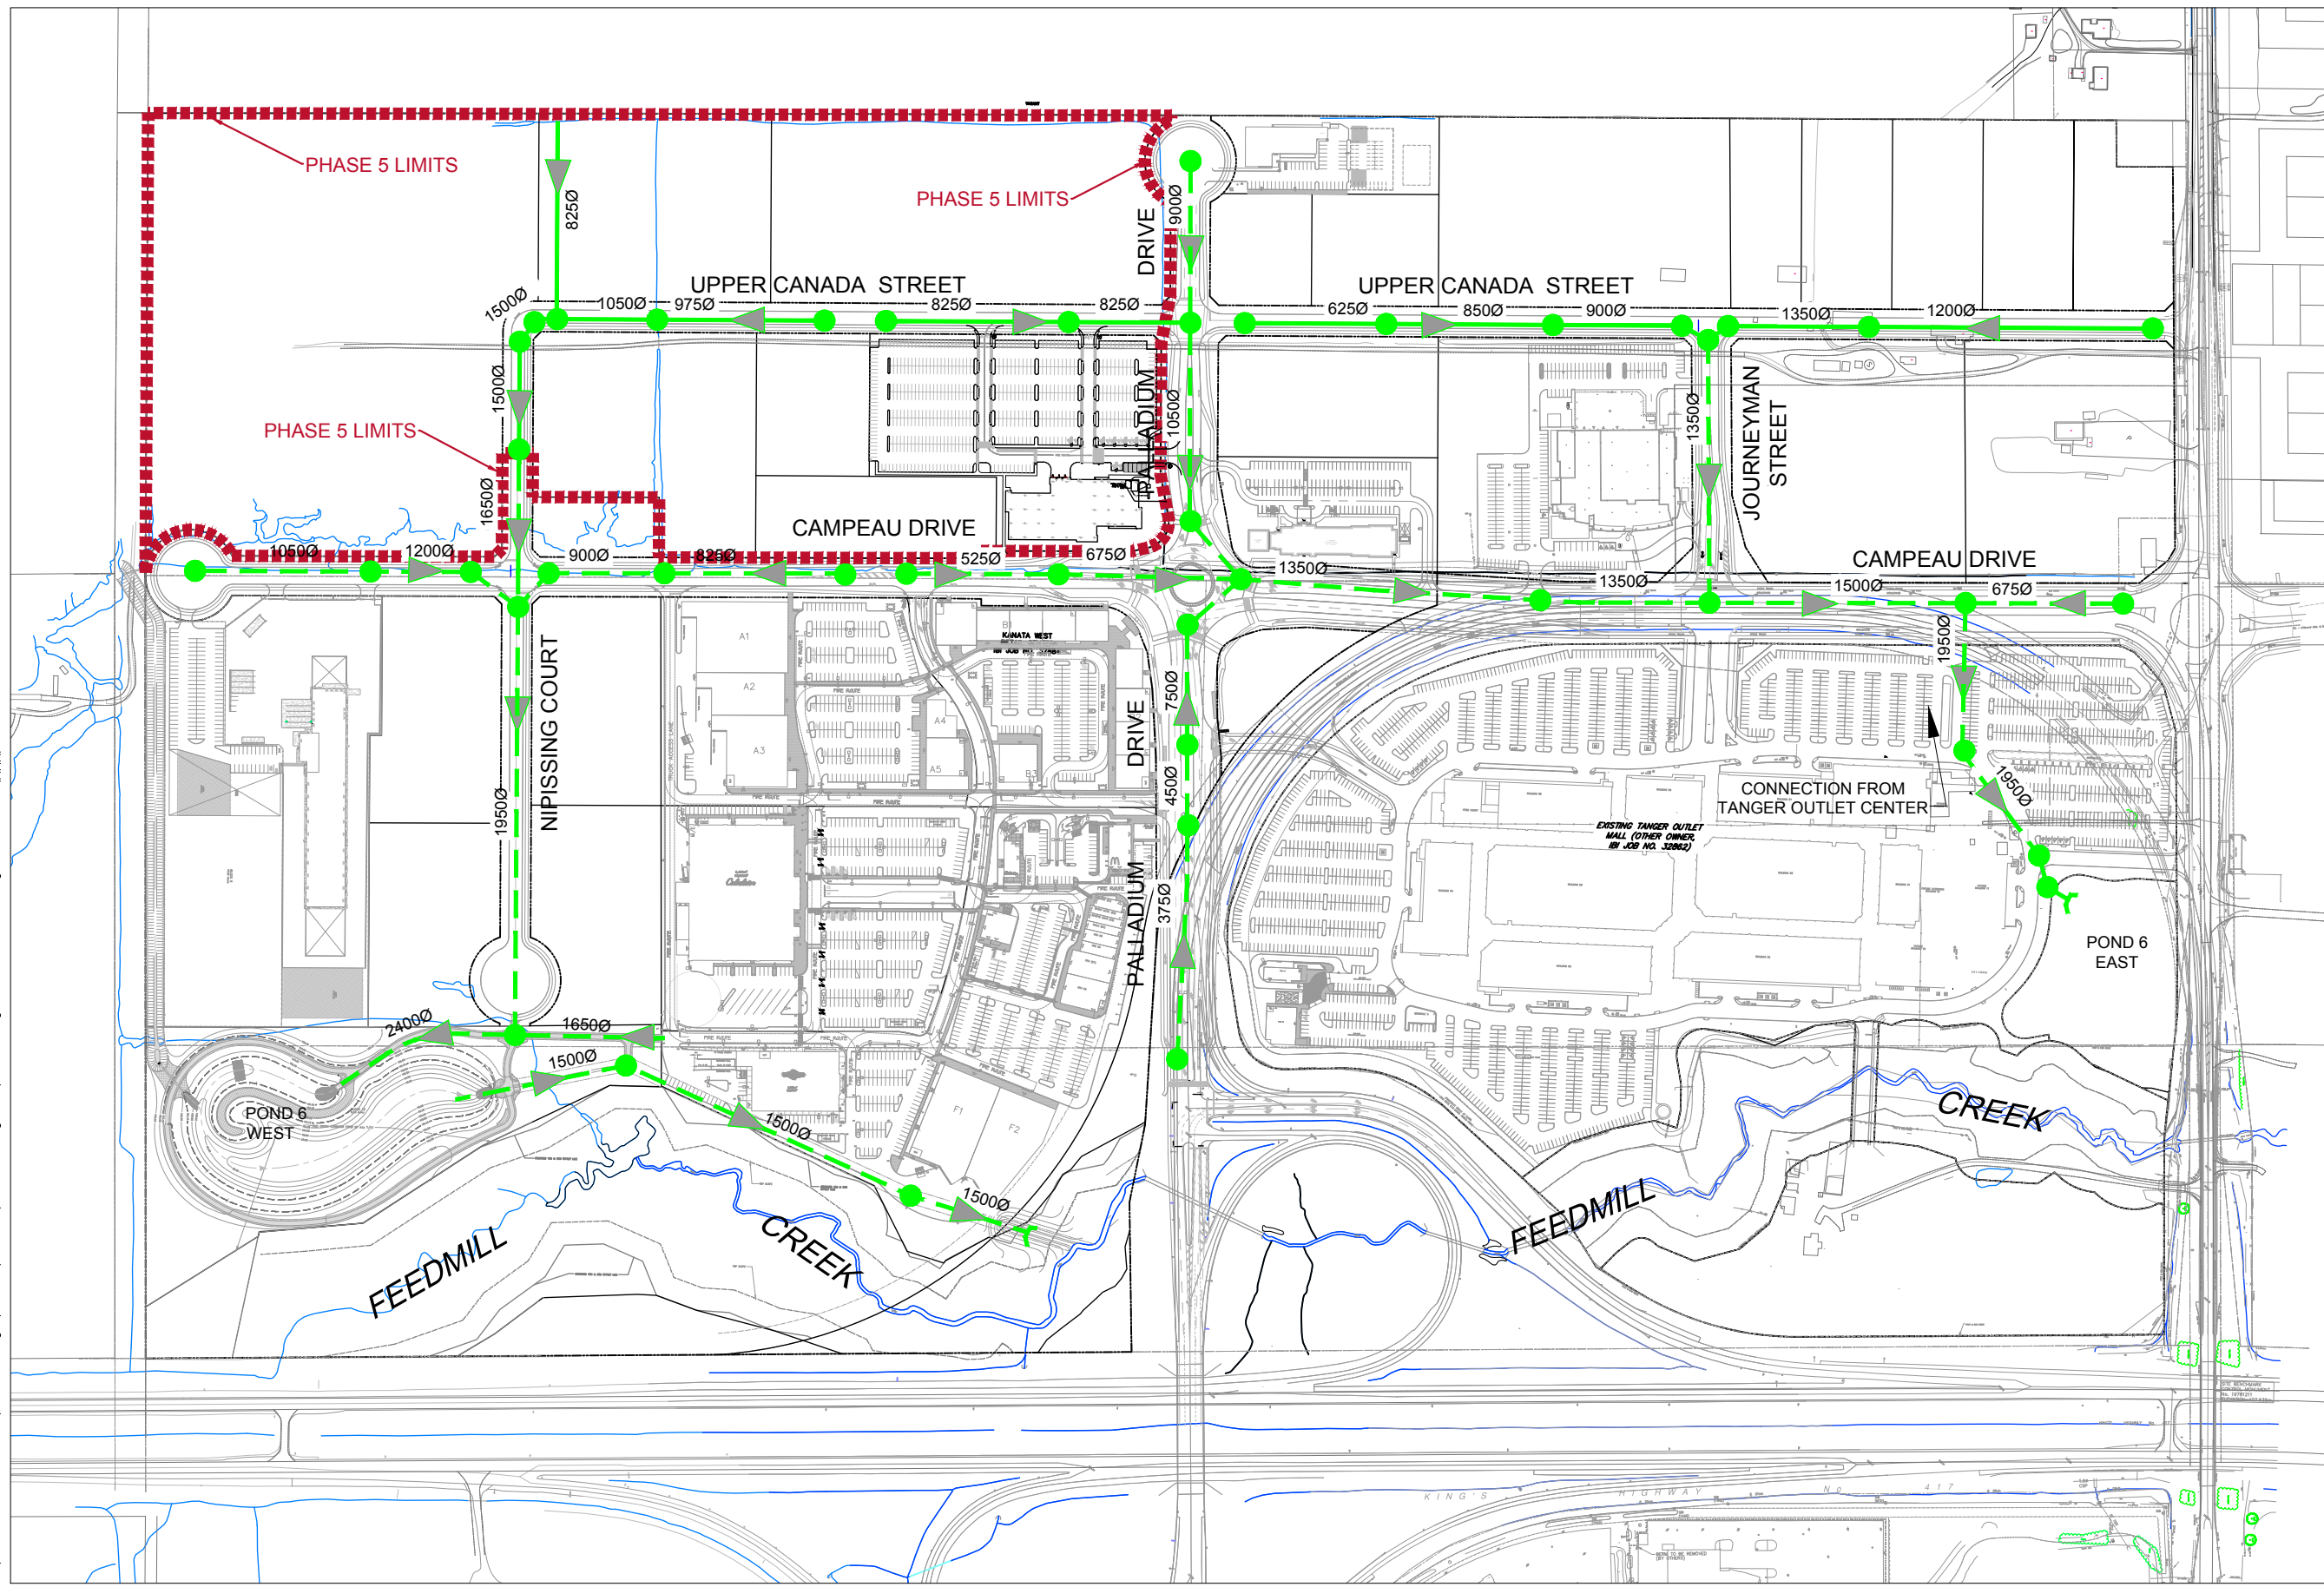

- LEGEND**
- 3000 EXISTING STORM SEWER AND DIAMETER
 - 3000 PROPOSED STORM SEWER AND DIAMETER

Plot Style: AIA STANDARD COLOR-HALF.CTB Plot Scale: 0.042:1 Plotted At: Oct. 17, 19 1:41 PM Printed By: DON SIURNA Last Saved By: DSIURNA Last Saved At: Oct. 17, 19

Area ID	Area (ha)	IMP (%)		LGI (m)	AVAILABLE/REQUIRED STORAGE (cu-m)	MINOR SYSTEM CAPTURE (l/s)
		TIMP	XIMP			
101A	7.03	0.93	0.93	327	780	1230
150A	0.17	0.53	0.53	83	n/a	31
150B	0.2	0.53	0.53	75	7	37
UPS Site modelled as per approved report "Design Brief UPS Canada Inc. 8825 Campeau Drive (IBI Group, January 2017)						
99C	0.14	0.69	0.69	30	44	33
99D	0.22	0.69	0.69	60	21	45
100C	0.27	0.59	0.59	103	13	49
100B	1.21	0.93	0.93	155	117	259
120A	1.16	0.93	0.93	214	75	191
120B	0.26	0.53	0.53	100	7	45
103A	0.33	0.93	0.93	56	20	104
104C	0.36	0.59	0.59	135	17	62
Kanata West Retail Centre modelled as per approved report "Design Brief Kanata West Retail Centre 3015, 3075 and 3095 Palladium Drive" (IBI Group, July 2017)						
121C	0.21	0.53	0.53	101	49	37
122B	1.07	0.93	0.93	149	103	231
122A	1.16	0.93	0.93	216	73	185
122C	0.21	0.69	0.69	60	21	46
122D	0.14	0.69	0.69	30	24	31
153A	1.89	0.93	0.93	119	190	430
153B	1.82	0.93	0.93	129	180	408
153C	0.16	0.53	0.53	79	n/a	29
154D	0.15	0.53	0.53	76	n/a	29
154A	0.70	0.93	0.93	81	70	171
154C	0.17	0.57	0.57	82	48	33
155C	0.29	0.57	0.57	141	60	50
155A	3.19	0.93	0.93	160	480	525
132D	2.29	0.93	0.93	157	360	377
156B	0.11	0.57	0.57	56	5	22
156C	0.14	0.93	0.93	82	7	40
132B	0.15	0.93	0.93	80	9	43
130C	0.15	0.93	0.93	30	15	41
130B	0.71	0.93	0.93	101	120	111
130D	0.24	0.93	0.93	67	15	62
160C	0.15	0.93	0.93	81	n/a	43
132A	1.01	0.93	0.93	117	132	187
132C	0.15	0.93	0.93	77	4	43
104A	0.85	0.93	0.93	95	90	204
104B	0.3	0.71	0.71	111	65	75
105B	0.22	0.93	0.93	65	n/a	57
106C	0.17	0.93	0.93	82	1	110
135E	0.25	0.93	0.93	50	11	80
106B	0.15	0.93	0.93	82	1	58
133A	0.15	0.93	0.93	57	19	48
133B	0.16	0.93	0.93	57	n/a	74
137A	0.08	0.93	0.93	33	n/a	38
137B/C	0.12	0.93	0.93	36	n/a	57

Table 4.10 Summary of Hydraulic Grade Line during the 100 year 12 hour SCS Storm and 100 year 3 hour Chicago Storm

LOCATION	MH	FINISHED FLOOR ELEVATION (M)	100 YEAR 12 HOUR SCS		100 YEAR 3 HOUR CHICAGO		100 YEAR 12 HOUR SCS +20%		100 YEAR 3 HOUR CHICAGO +20%		
			HGL (M)	FB (M)	HGL (M)	FB (M)	HGL (M)	FB (M)	HGL (M)	FB (M)	
			POND 6 WEST	NIPISSING COURT	P6WEST	N/A	103.26	N/A	102.93	N/A	103.71
123	105.37 (T/G)	103.28			2.09	102.94	2.43	103.73	1.64	103.30	2.07
122	106.20	103.34			2.86	102.97	3.23	103.76	2.44	103.32	2.88
121	106.20	103.40			2.90	103.03	3.27	103.78	2.52	103.34	2.96
120	106.30	103.48			2.83	103.07	3.23	103.83	2.47	103.41	2.89
UPPER CANADA ST	150	106.00		103.51	2.49	103.09	2.91	103.86	2.14	103.45	2.55
	151	106.00		103.60	2.40	103.14	2.86	103.91	2.09	103.54	2.46
	152	105.90		103.63	2.27	103.17	2.73	103.92	1.98	103.58	2.32
	152B	105.85		103.65	2.20	103.19	2.66	103.93	1.92	103.60	2.25
	153	105.85		103.81	2.04	103.34	2.51	104.03	1.82	103.74	2.11
CAMPEAU DR.	154	105.80		103.82	1.98	103.35	2.45	104.05	1.75	103.76	2.04
	99	106.70		103.66	3.04	103.16	3.54	103.91	2.79	103.56	3.14
	100	106.75		103.60	3.15	103.16	3.60	103.87	2.88	103.54	3.21
	101	106.60		103.57	3.03	103.13	3.47	103.88	2.72	103.51	3.09
	102	106.00		103.51	2.49	103.08	2.92	103.85	2.15	103.44	2.57
	103	105.85		103.63	2.22	103.25	2.60	103.95	1.90	103.54	2.31
104	105.45	103.71		1.74	103.33	2.12	104.01	1.44	103.62	1.83	
POND 6 EAST	CAMPEAU DR.	P6EAST		N/A	98.40	N/A	98.37	N/A	98.55	N/A	98.48
		13	100.42 (T/G)	98.50	1.92	98.44	1.98	98.71	1.71	98.56	1.86
		12	101.30 (T/G)	98.71	2.59	98.56	2.74	98.96	2.34	98.77	2.53
		9	101.38 (T/G)	98.96	2.42	98.77	2.61	99.30	2.08	99.07	2.31
		600	102.60	99.51	3.09	99.22	3.38	100.02	2.58	99.78	2.82
		601	102.60	99.43	3.17	99.21	3.39	99.93	2.67	99.69	2.91
		602	102.70	100.00	2.70	99.72	2.98	100.70	2.00	100.39	2.31
		603	103.30	100.47	2.83	100.16	3.14	101.32	1.98	100.94	2.36
		604	103.30	100.84	2.47	100.52	2.78	101.87	1.43	101.42	1.88
		108	104.00	101.06	2.94	100.76	3.24	102.24	1.76	101.73	2.27
		107	104.00	101.30	2.70	101.02	2.98	102.64	1.36	102.07	1.93
		106	105.10	101.34	3.76	101.09	4.01	102.78	2.32	102.14	2.96
		105	105.45	101.42	4.03	101.41	4.04	102.93	2.52	102.16	3.29
	JOURNEYMAN ST	141	102.70	100.58	2.12	100.26	2.44	101.44	1.26	101.05	1.65
		140	102.70	100.70	2.00	100.37	2.33	101.57	1.13	101.17	1.53
	UPPER CANADA ST	164	102.90	100.70	2.20	100.38	2.52	101.57	1.33	101.17	1.73
		165	102.90	100.72	2.18	100.39	2.51	101.59	1.31	101.19	1.71
		166	102.55	100.75	1.80	100.56	1.99	101.62	0.93	101.21	1.34
		167	102.20	100.79	1.41	100.55	1.65	101.63	0.57	101.22	0.98
		163	102.90	100.75	2.15	100.43	2.47	101.62	1.28	101.22	1.68
		162	103.25	100.99	2.26	100.65	2.60	101.87	1.38	101.45	1.80
		161	103.90	101.09	2.81	100.74	3.16	101.97	1.93	101.54	2.36
	160	104.25	101.29	2.96	100.89	3.36	102.17	2.08	101.72	2.53	
	PALLADIUM DR	134	104.60	101.45	3.15	101.14	3.46	102.86	1.74	102.18	2.42
		135	104.60	101.77	2.83	101.42	3.18	103.24	1.36	102.38	2.22
		136	105.42 (T/G)	102.51	2.91	102.56	2.86	103.86	1.57	102.59	2.84
		137	107.79 (T/G)	104.57	3.22	104.65	3.14	105.13	2.66	104.65	3.14
		133	104.00	101.48	2.52	101.21	2.79	102.86	1.14	102.29	1.71
		132	104.00	101.71	2.29	101.45	2.55	103.11	0.89	102.55	1.45
		131	105.10	101.80	3.30	101.54	3.56	103.23	1.87	102.66	2.44
	130	104.95	101.81	3.14	101.56	3.39	103.30	1.65	102.68	2.27	
	UPPER CANADA ST	156	104.36 (T/G)	102.03	2.33	101.83	2.53	103.50	0.86	102.93	1.43
		155	104.93 (T/G)	102.19	2.74	102.13	2.80	103.65	1.28	103.08	1.85

(Model Files: 14289-100YRSCS-2019-08-27.out, 32862-100YRSCS-2019-08-27.out, 14289-100YRCHI-2019-08-27.out, 32862-100YRCHI-2019-08-27.out, 14289-100YRSCS20%-2019-08-27.out, 32862-100YRSCS20%-2019-08-27.out, 14289-100YRCHI20%-2019-08-27.out, 32862-100YRCHI20%-2019-08-27.out)

The hydraulic grade line will be at least 1.41m below the T/G or finished floor elevation within the proposed Phase 5 of the KWBP. A summary of all results of the computer simulations are presented within **Appendix C**. It should be noted that the Kanata West Business Park will be comprised of typical commercial type buildings constructed using slab on grade foundation type (ie no basement).

Table 3.16 - 90th and 95th Percentile event daily rainfall volumes from daily climate data collected proximal to the City of Ottawa.

Station Name	Annual Average		Number of Years in Analysis	90th Percentile Daily Volume (mm)				95th Percentile Daily Volume (mm)			
	Precipitation* (mm)	Oct. to Apr. Rainfall (mm)		ALL RAINFALL EVENTS		APR. 1 ST - OCT. 31 ST		ALL RAINFALL EVENTS		APR. 1 ST - OCT. 31 ST	
				2 mm Cut-off	5 mm Cut-off	2 mm Cut-off	5 mm Cut-off	2 mm Cut-off	5 mm Cut-off	2 mm Cut-off	5 mm Cut-off
OTTAWA CDA	910	583	36	21.2	25.8	21.8	25.8	27.2	31.4	27.4	31.8
OTTAWA MACDONALD-CARTIER INT'L A	935	580	36	22.0	26.6	22.6	26.8	28.6	34.4	29.0	35.0
Average	922	581	36	21.6	26.2	22.2	26.3	27.9	32.9	28.2	33.4

3.7.3.3 Windsor

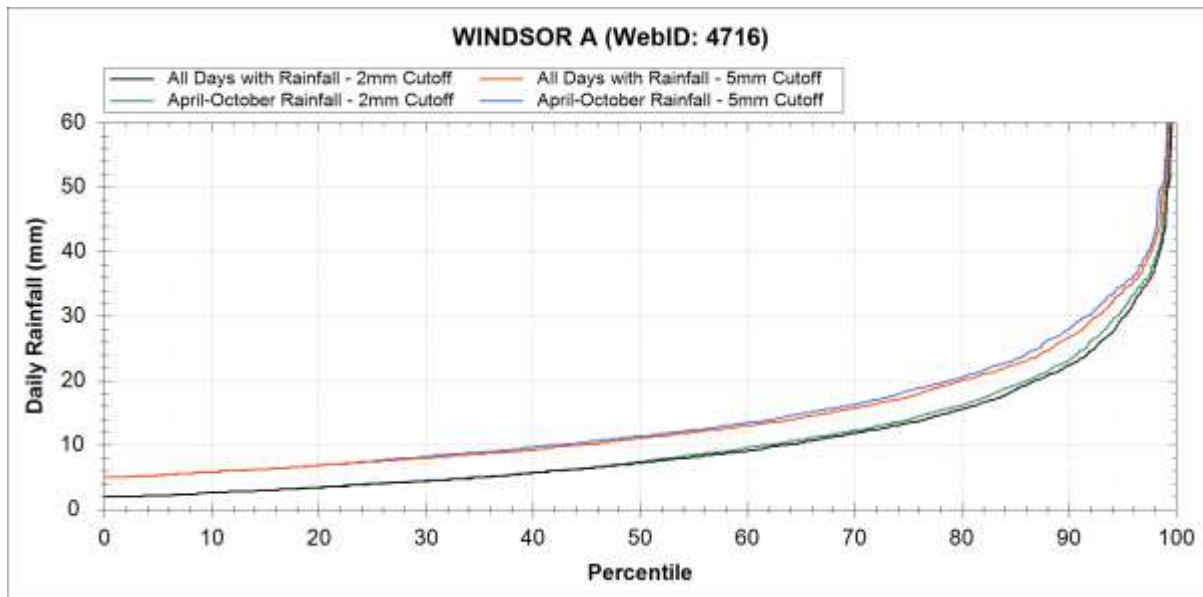


Figure 3.59 - Daily rainfall frequency curves derived from daily rainfall data at ECCC climate station WINDSOR A.

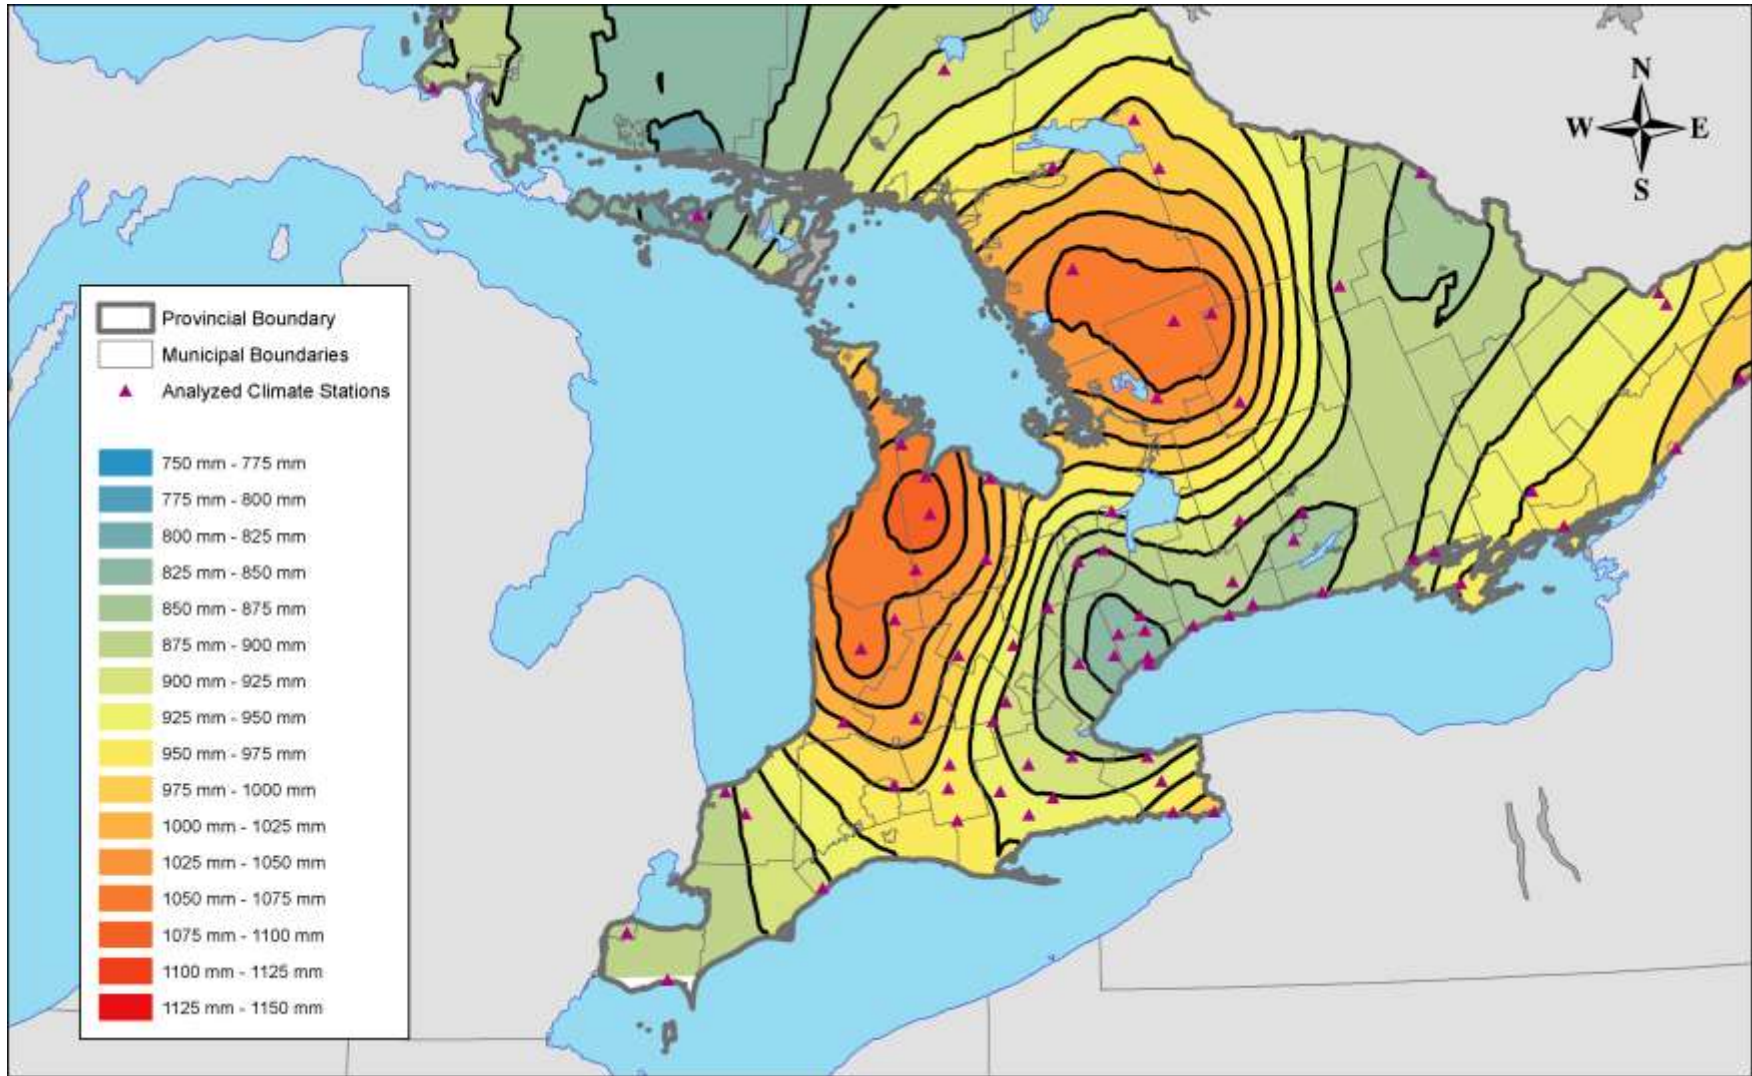


Figure 3.41 - Average annual precipitation in southern Ontario (1970-2005).

Grain Size Distribution Sieve Analysis

Grain size distribution (sieve analysis) was also completed on two (2) selected soil samples. The results of the grain size analysis are summarized in Table 2 and presented on the Grain-Size Distribution Testing Results sheets in Appendix 1.

Table 1 - Summary of Grain Size Distribution Analysis				
Test Hole	Sample	Gravel (%)	Sand (%)	Silt and Clay (%)
BH 1-21	SS5	0.0	12.4	87.6
BH 3-21	SS6	1.0	38.4	60.6

4.3 Groundwater

Groundwater level readings were recorded on March 31, April 12 and May 7, 2021. The groundwater level readings are presented in the Soil Profile and Test Data sheets in Appendix 1 and summarized in Table 2. It should be noted that groundwater levels are subject to seasonal fluctuations, therefore, the groundwater levels could vary at the time of construction.

Based on available design plans, the proposed finished floor elevation in the office is 108.2 m and the underground level underside of footing elevation is 3.7 m below the finished floor elevation, corresponding to a geodetic elevation of 104.5 m.

Table 2 - Summary of Groundwater Levels				
Borehole Number	Ground Elev. (m)	Groundwater Levels (m)		Recording Date
		Depth	Elevation	
BH 1-21	105.80	0.30	105.50	Mar. 31, 2021
		0.65	105.15	April 12, 2021
		0.57	105.23	May 7, 2021
BH 2-21	106.18	0.68	105.50	Mar. 31, 2021
		0.73	105.45	April 12, 2021
		0.68	105.50	May 7, 2021

Table 2 - Summary of Groundwater Levels cont.				
BH 3-21	106.59	0.62	105.97	Mar. 31, 2021
		0.93	105.66	April 12, 2021
		0.86	105.73	May 7, 2021
BH 1	105.99	1.5	104.49	Jan. 15, 2014
BH 2	104.99	1.8	103.19	Jan. 15, 2014
BH 17	105.68	2.0	103.68	Jan. 15, 2014
BH 18	105.53	1.5	104.03	Jan. 15, 2014
BH 19	105.08	2.0	103.08	Jan. 15, 2014

Table 4 - Recommended Flexible Pavement Structure - Car Only Parking Areas	
Thickness (mm)	Material Description
50	Wear Course - HL 3 or Superpave 12.5 Asphaltic Concrete
150	BASE - OPSS Granular A Crushed Stone
300	SUBBASE - OPSS Granular B Type II
SUBGRADE - Either fill, in situ soil or OPSS Granular B Type I or II material placed over in situ soil or fill	

Table 5 - Recommended Flexible Pavement Structure - Access Lanes and Heavy Truck Parking/loading Areas	
Thickness (mm)	Material Description
40	Wear Course - Superpave 12.5 Asphaltic Concrete
50	Binder Course - Superpave 19.0 Asphaltic Concrete
150	BASE - OPSS Granular A Crushed Stone
450	SUBBASE - OPSS Granular B Type II
SUBGRADE - Either fill, in situ soil or OPSS Granular B Type I or II material placed over in situ soil or fill	

If soft spots develop in the subgrade during compaction or due to construction traffic, the affected areas should be excavated and replaced with OPSS Granular B Type II material. The pavement granular base and subbase should be placed in maximum 300 mm thick lifts and compacted to a minimum of 100% of the material's SPMDD using suitable vibratory equipment.

5.8 Hydraulic Conductivity Testing

Hydraulic conductivity testing was completed at borehole BH 1-21 which was outfitted with a monitoring well and screened within the silty sand to sandy silt and glacial till layers. Rising head and falling head testing ("slug testing") was completed within the soil strata in accordance with ASTM Standard Test Method D4404 - Field Procedure for Instantaneous Change in Head (Slug) Tests for Determining Hydraulic Properties of Aquifers.

Following the completion of the slug testing, the test data was analyzed as per the method set out by Hvorslev (1951). Assumptions inherent in the Hvorslev method include a homogeneous and isotropic aquifer of infinite extent with zero-storage assumption, and a screen length significantly greater than the monitoring well diameter. The assumption regarding aquifer storage is considered to be appropriate for groundwater flow through the overburden aquifer. The assumption regarding screen length and well diameter is considered to be met based on the screen length of 3 m and the well diameter of 0.051 m at borehole BH 1-21.

While the idealized assumptions regarding aquifer extent, homogeneity, and isotropy are not strictly met in this case (or in any real-world situation), it has been our experience that the Hvorslev method produces effective point estimates of hydraulic conductivity in conditions similar to those encountered at the subject site.

The Hvorslev analysis is based on the line of best fit through the field data (hydraulic head recovery vs. time), plotted on a semi-logarithmic scale. In cases where the initial hydraulic head displacement is known with relative certainty, such as in this case where a physical slug has been introduced/removed, the line of best fit is considered to pass through the origin.

Based on the above test methods, the monitoring wells screened in the overburden soils displayed a hydraulic conductivity value ranging from 4.6×10^{-6} to 1.34×10^{-5} m/sec. The values measured within the monitoring well are generally consistent with similar material Paterson has encountered on other sites and typical published values for silty sand and sandy silt. These values typically range from 1×10^{-4} to 1×10^{-6} m/sec. The results from the hydraulic conductivity testing are attached to the current report.

5.9 Percolation Rates

Infiltration galleries are anticipated to be located beneath the roller compacted concrete pavement structure within the subject site. Paterson completed hydraulic conductivity testing at borehole BH 1-21 in order to establish hydraulic conductivity and percolation time of in-situ materials.

It is anticipated that a silty sand to sandy silt will be encountered at the base of the infiltration galleries during the installation and will affect the rate of stormwater infiltration into the underlying material. The results of the hydraulic conductivity testing were used to determine the estimated percolation rates of the in-situ soils using the approximate relationship between infiltration rate and hydraulic conductivity, as described in the Draft LID Guidance Document, dated December 2019. Based on this relationship, the estimated percolation rate (T-Time) was estimated to be within the ranges in Table 5.

Table 6 - Estimated Percolation Rates		
Material	Hydraulic Conductivity - k (m/sec)	Percolation (T-time) - (mins/cm)
Silty Fine Sand to Sandy Silt	1.3×10^{-5} to 4.6×10^{-6}	6 to 10

DATUM Geodetic

REMARKS

BORINGS BY CME 55 Power Auger

DATE 2021 March 15

FILE NO. **PG5618**

HOLE NO. **BH 1-21**

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction	
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %					
								20	40	60	80		
GROUND SURFACE													
TOPSOIL FILL: Brown silty clay trace sand and gravel	0.08 0.46	AU	1			0	105.80						
Compact brown SILTY SAND to SANDY SILT		SS	2	58	23	1	104.80						
	1.83	SS	3	33	13	2	103.80						
Compact to loose grey SILTY SAND to SANDY SILT		SS	4	50	17	3	102.80						
		SS	5	42	9	4	101.80						
	4.52	SS	6	33	5	4	101.80						
GLACIAL TILL: Grey silty sand to sandy silt some gravel, trace clay, cobbles and boulders		SS	7	50	1	5	100.80						
	5.94	SS	8	50	33								
End of Borehole (GWL @ 0.30 m depth - March 31, 2021)													

20 40 60 80 100
Shear Strength (kPa)
▲ Undisturbed △ Remoulded

DATUM Geodetic


REMARKS

BORINGS BY CME 55 Power Auger

DATE 2021 March 15

FILE NO. **PG5618**

HOLE NO. **BH 2-21**

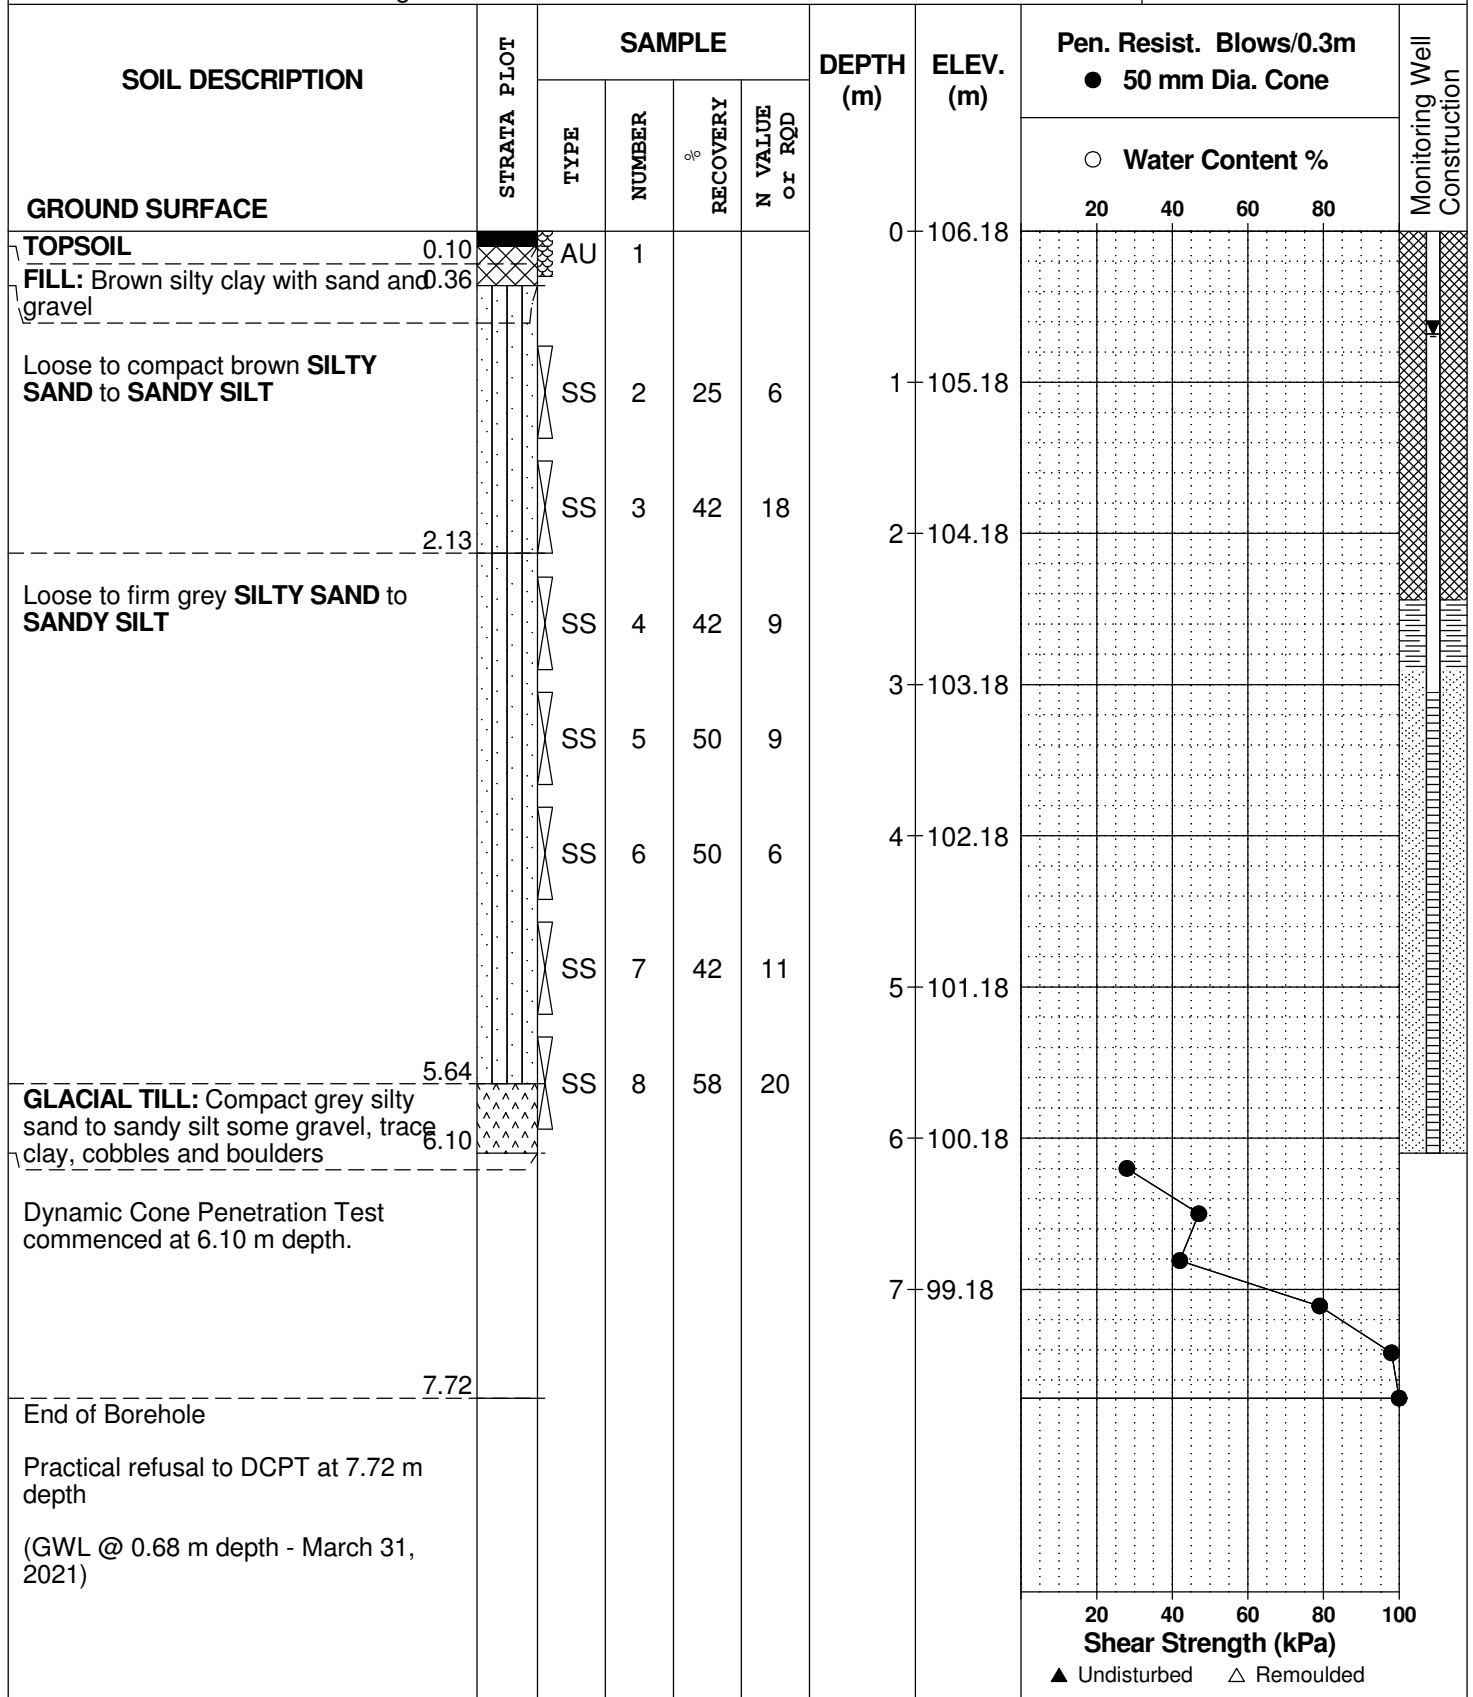

DATUM Geodetic

REMARKS

BORINGS BY CME 55 Power Auger

DATE 2021 March 15

FILE NO. **PG5618**

HOLE NO. **BH 3-21**

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %				
GROUND SURFACE								20	40	60	80	
TOPSOIL FILL: Brown silty clay with sand, trace gravel and topsoil	0.08 0.30	AU	1			0	106.59					
Compact brown SILTY SAND to SANDY SILT - Dense by 1.7 m depth		SS	2	25	3	1	105.59					
		SS	3	67	20	2	104.59					
Compact to loose grey SILTY SAND to SANDY SILT	2.13	SS	4	50	12	3	103.59					
		SS	5	50	11	4	102.59					
		SS	6	50	5	4	102.59					
		SS	7	33	8	5	101.59					
		SS	8	67	W	5	101.59					
End of Borehole (GWL @ 0.62 m depth - March 31, 2021)	5.94											

20 40 60 80 100
Shear Strength (kPa)
▲ Undisturbed △ Remoulded

DATUM Ground surface elevations provided by Stantec Geomatics Ltd.


FILE NO. **PG3115**

REMARKS

HOLE NO. **BH 1**

BORINGS BY CME 55 Power Auger

DATE January 15, 2014

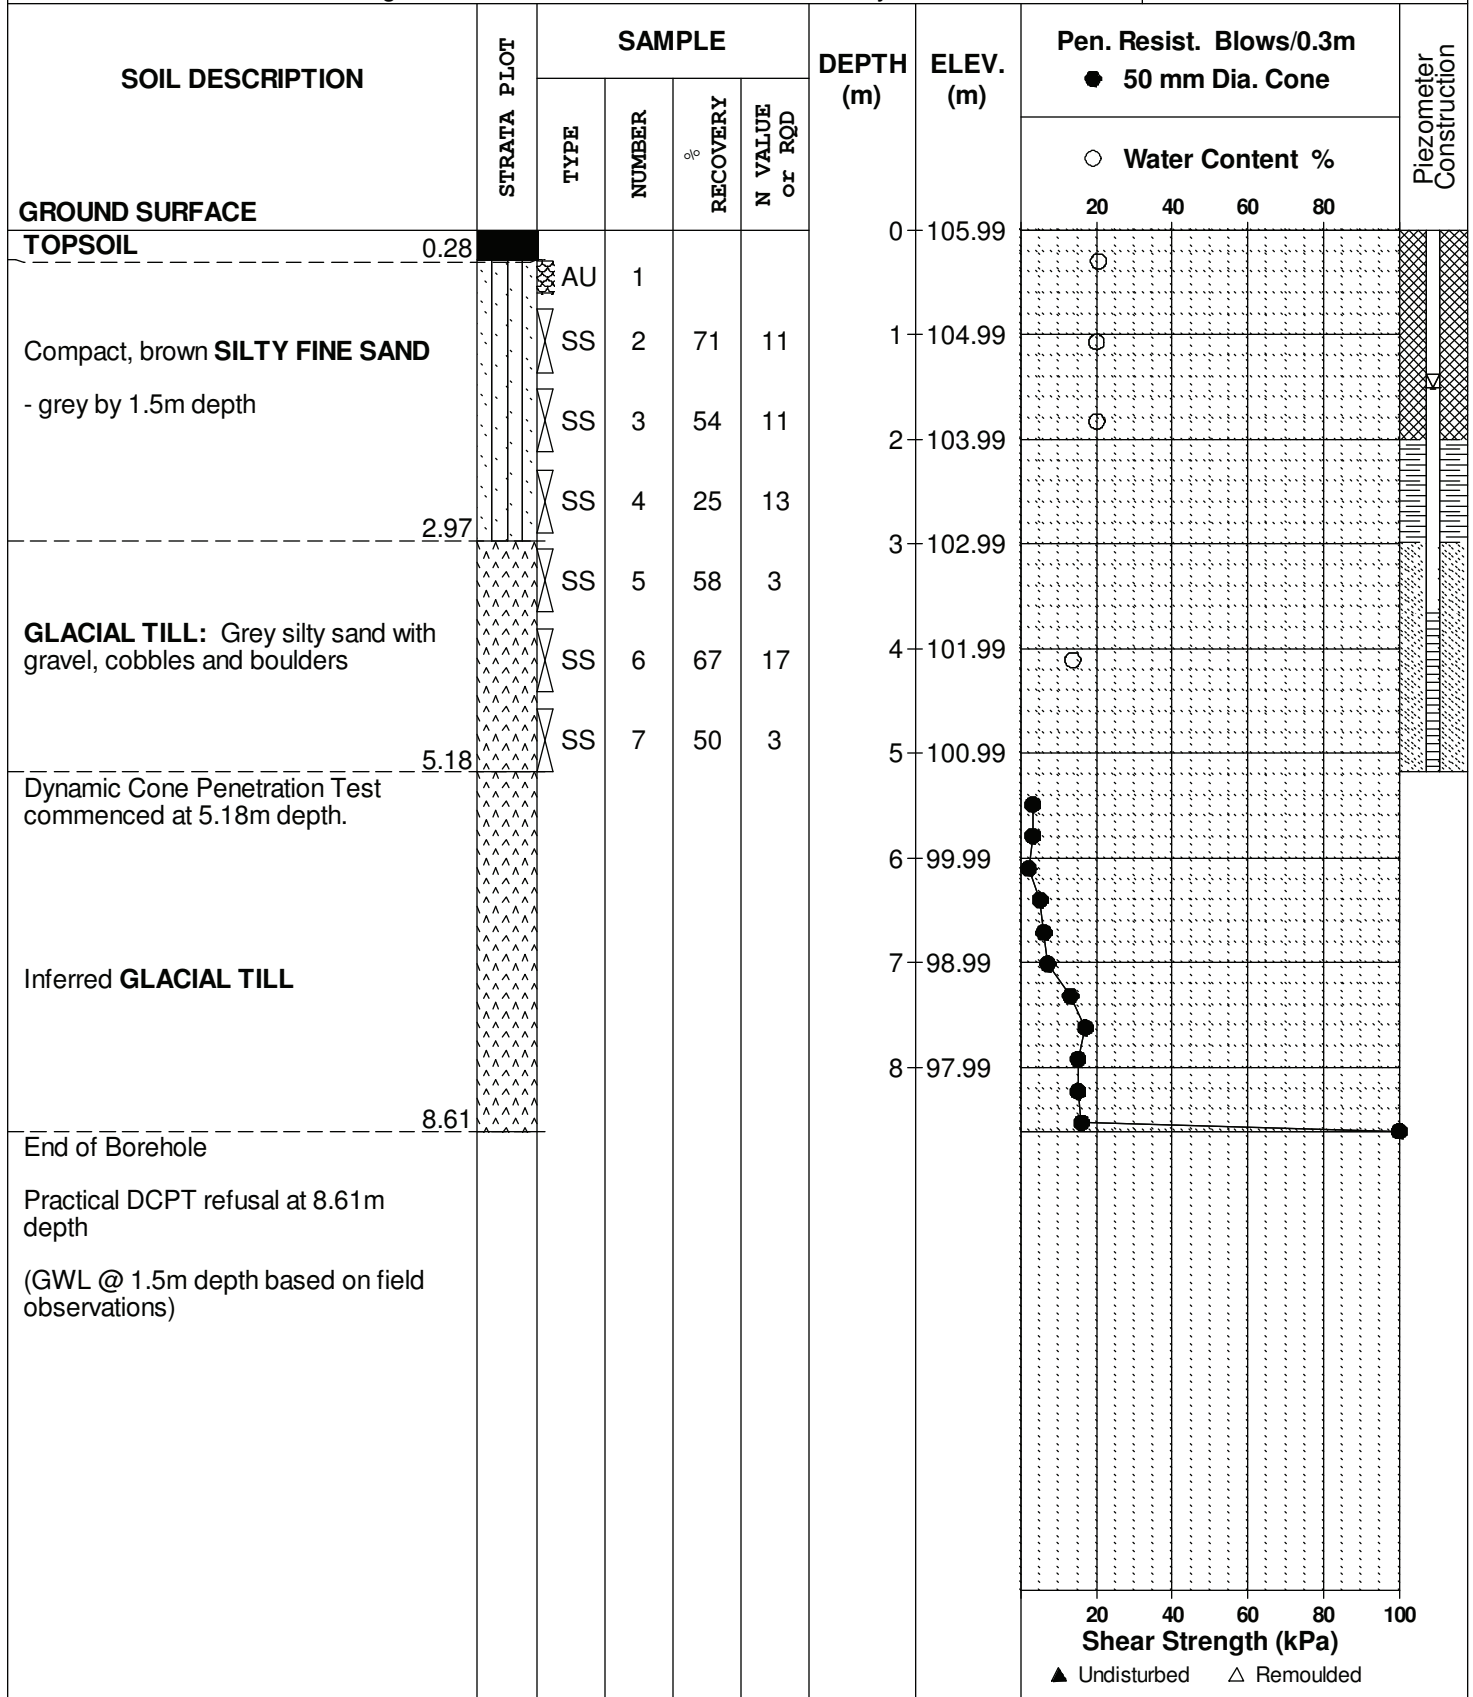

DATUM Ground surface elevations provided by Stantec Geomatics Ltd.


FILE NO. **PG3115**

REMARKS

HOLE NO. **BH 2**

BORINGS BY CME 55 Power Auger

DATE January 15, 2014

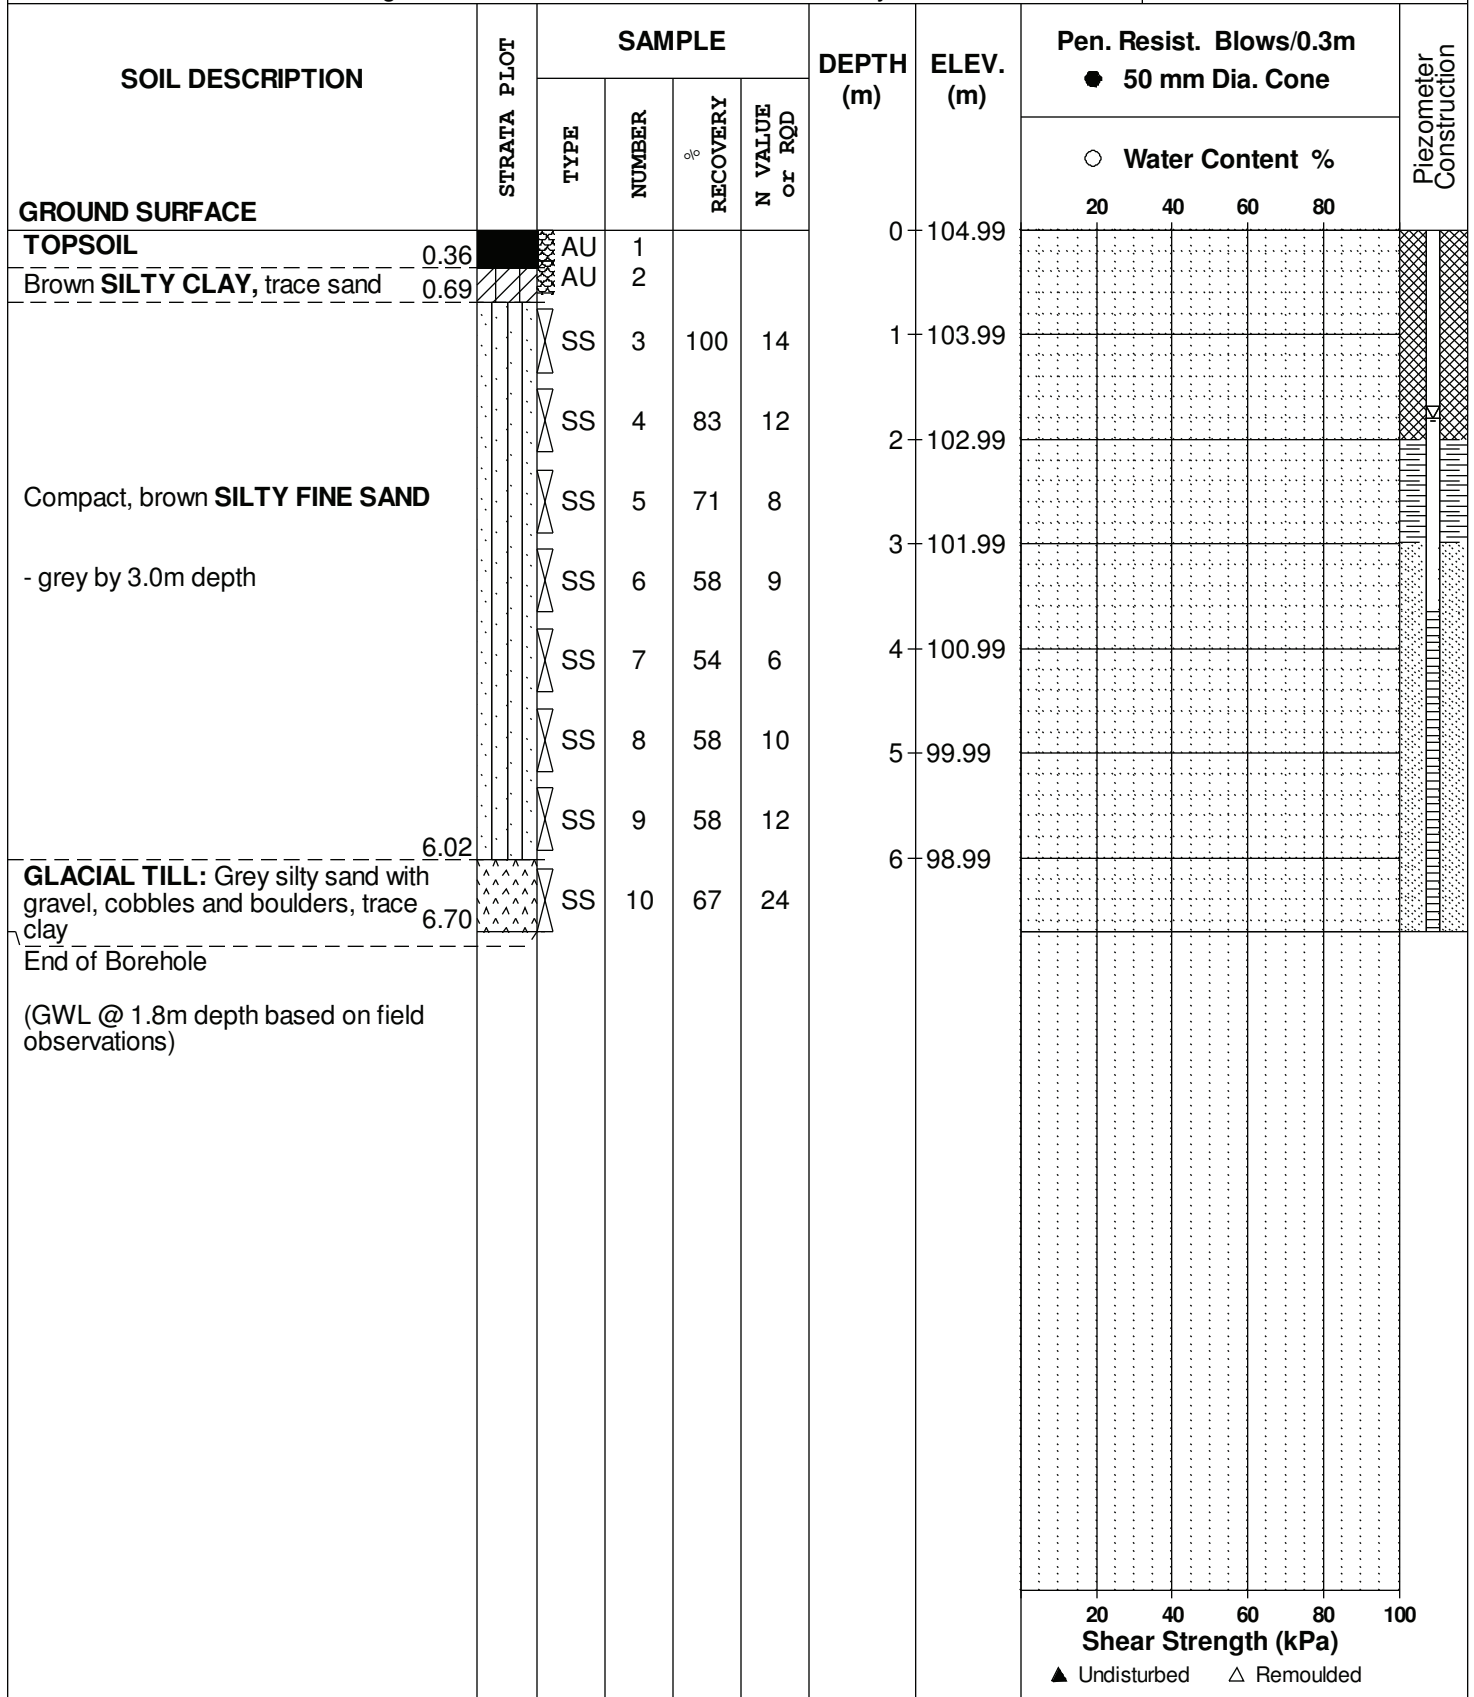

DATUM Ground surface elevations provided by Stantec Geomatics Ltd.


FILE NO. **PG3115**

REMARKS

HOLE NO. **BH17**

BORINGS BY CME 55 Power Auger

DATE January 15, 2014

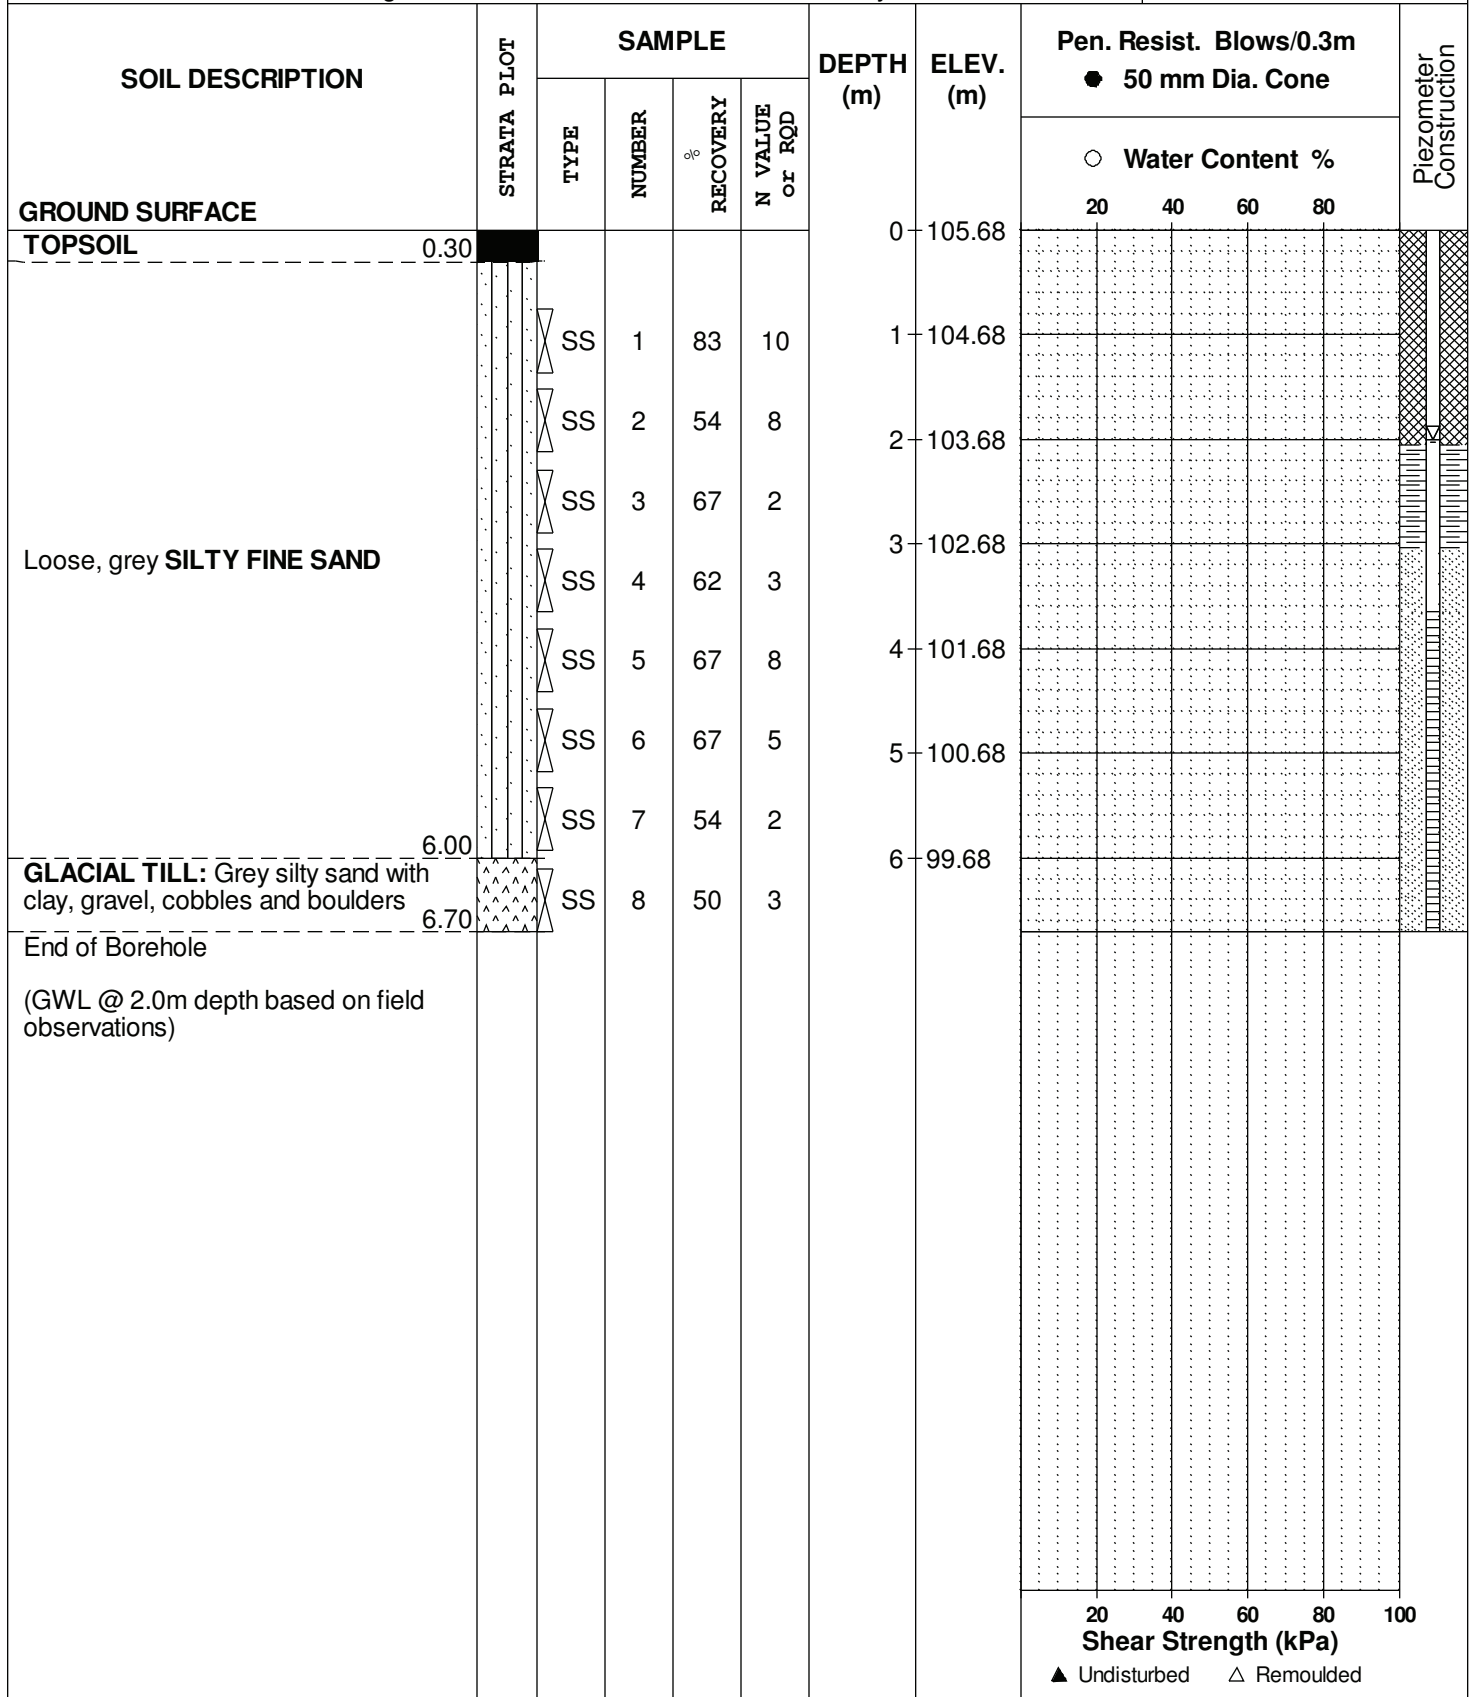

SOIL PROFILE AND TEST DATA

Geotechnical Investigation

Proposed Commercial Development - Huntmar Road
Ottawa, Ontario

DATUM Ground surface elevations provided by Stantec Geomatics Ltd.


REMARKS

BORINGS BY CME 55 Power Auger

DATE January 15, 2014

FILE NO. PG3115

HOLE NO. BH18

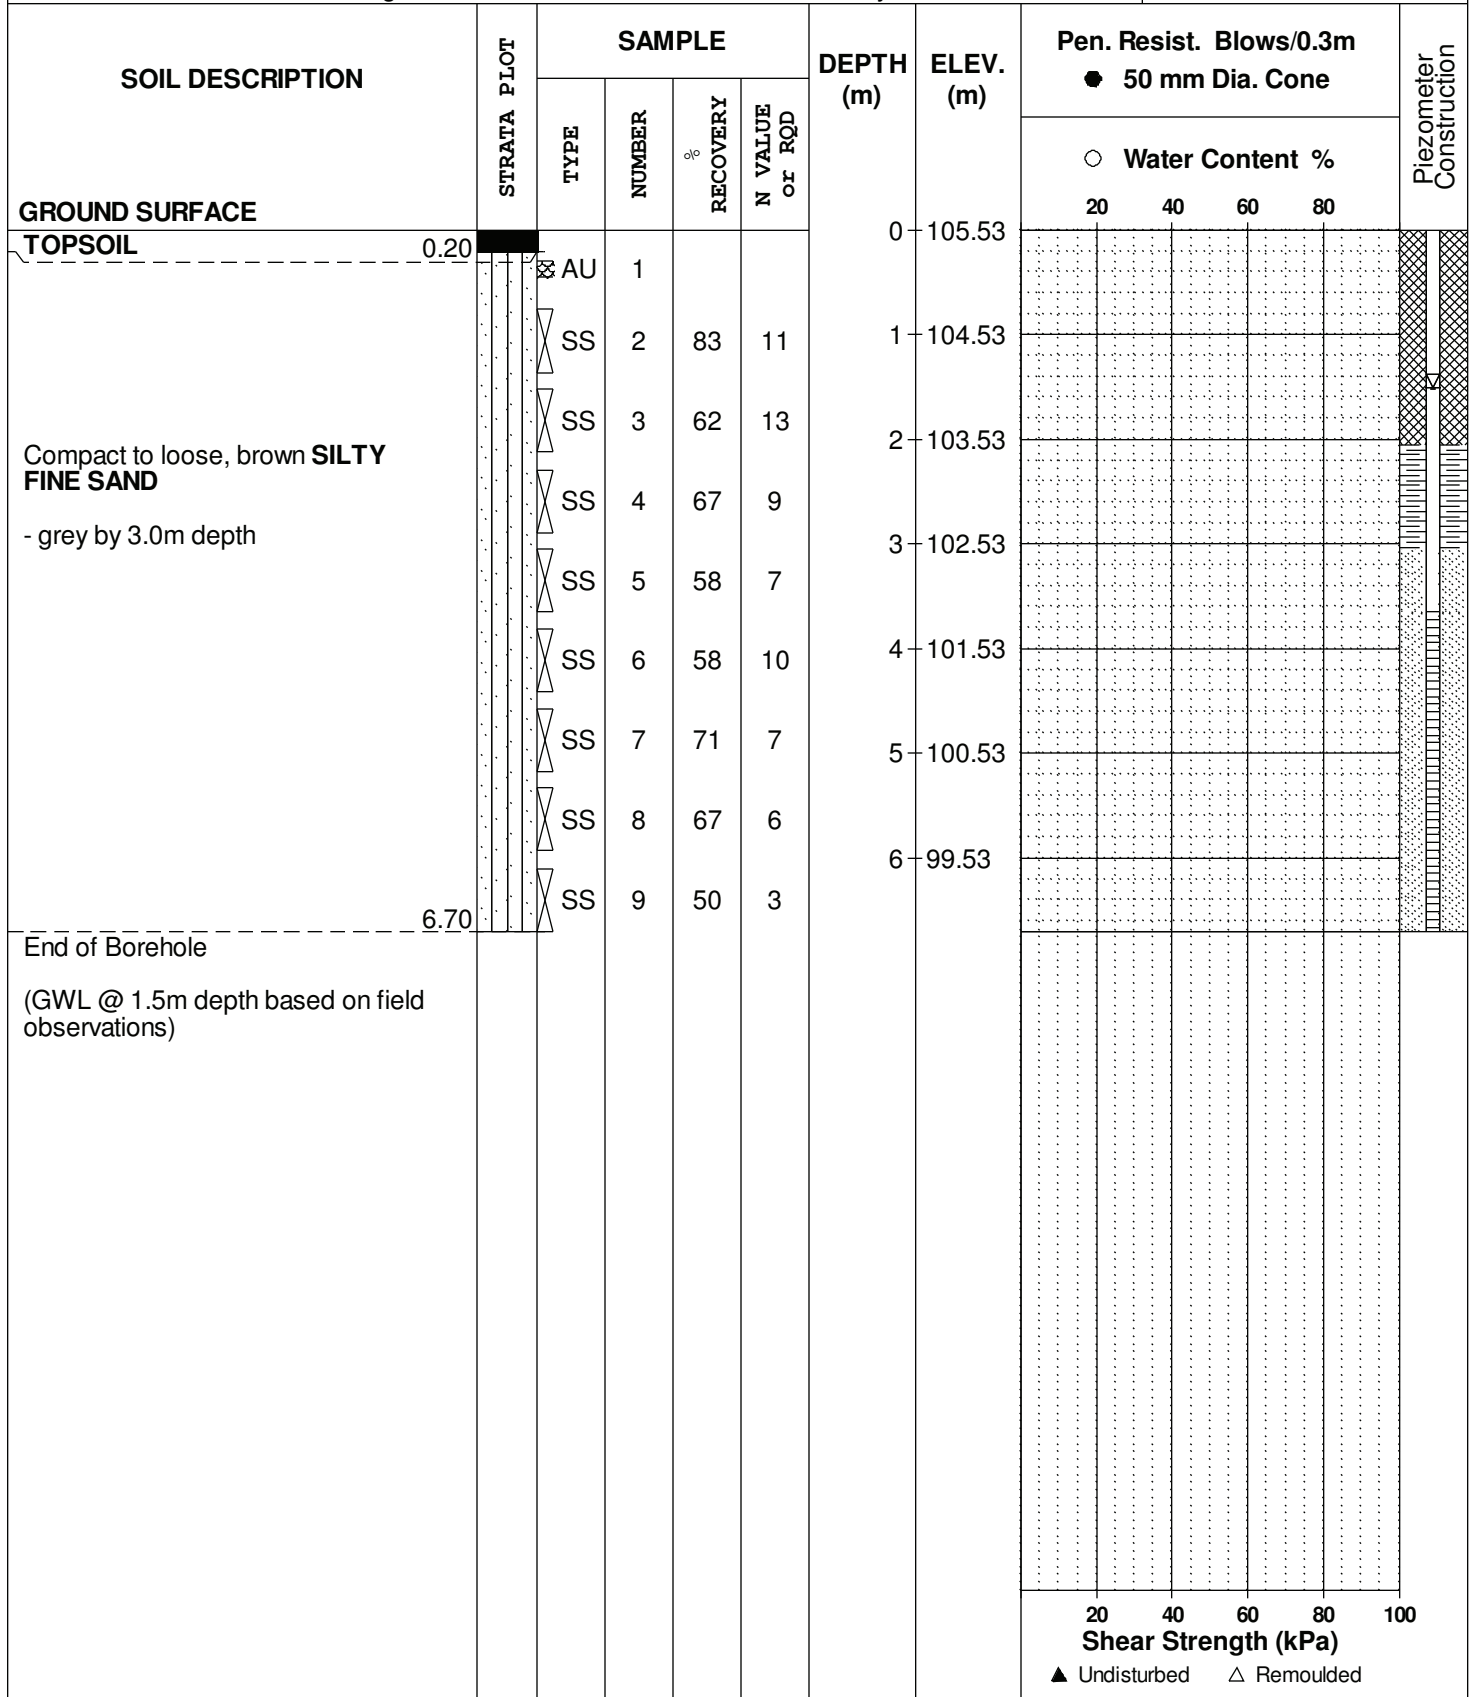

DATUM Ground surface elevations provided by Stantec Geomatics Ltd.


REMARKS

BORINGS BY CME 55 Power Auger

DATE January 15, 2014

FILE NO. **PG3115**

HOLE NO. **BH19**

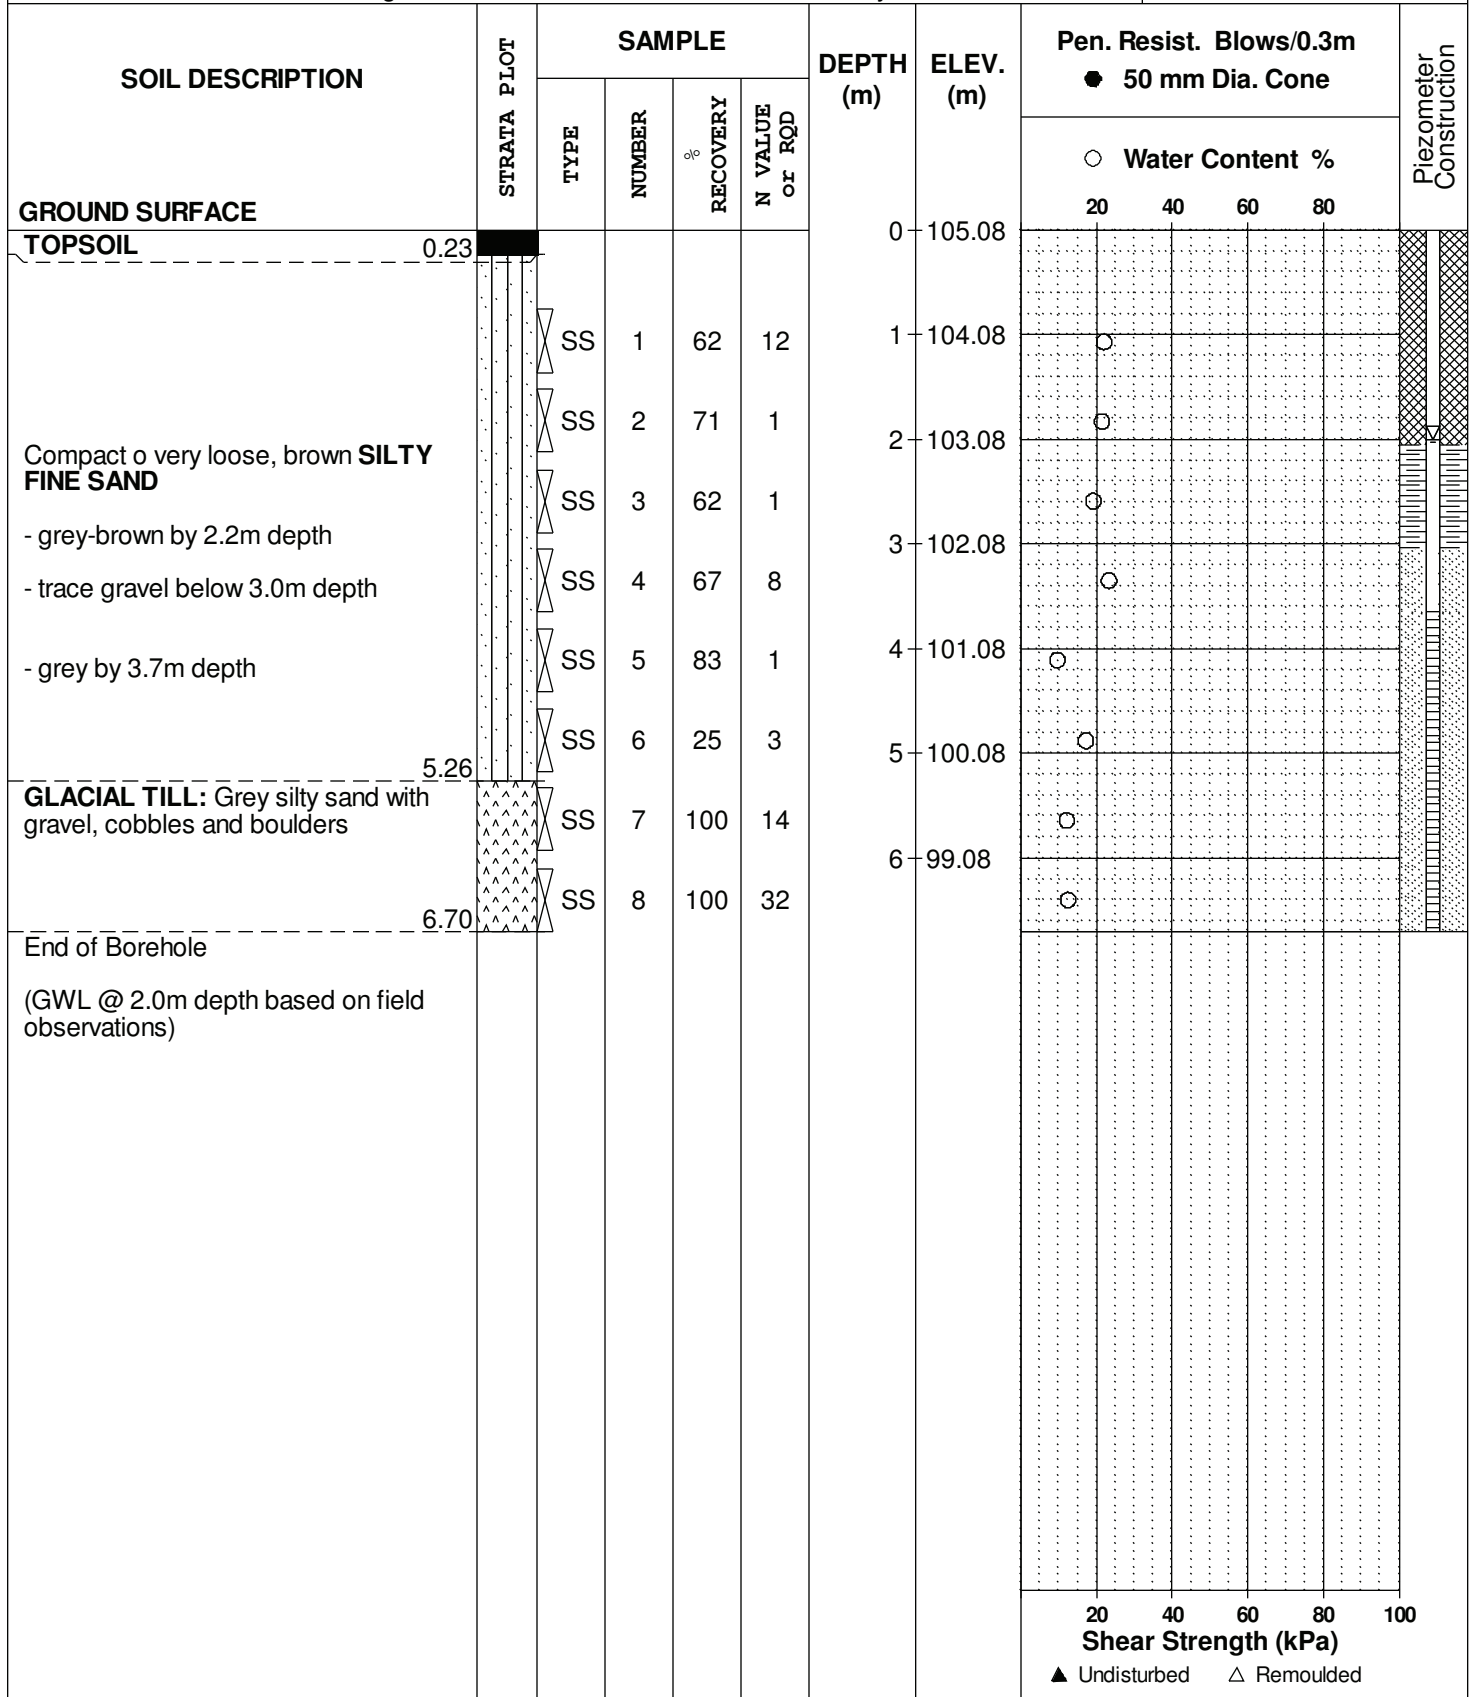


Hvorslev Hydraulic Conductivity Analysis

Project: Maritime Ontario c/o Realinc-SCS - 8800 Campeau Drive

Test Location: BH 1-21

Test: 1 of 2 Falling Head

Date: May 7, 2021

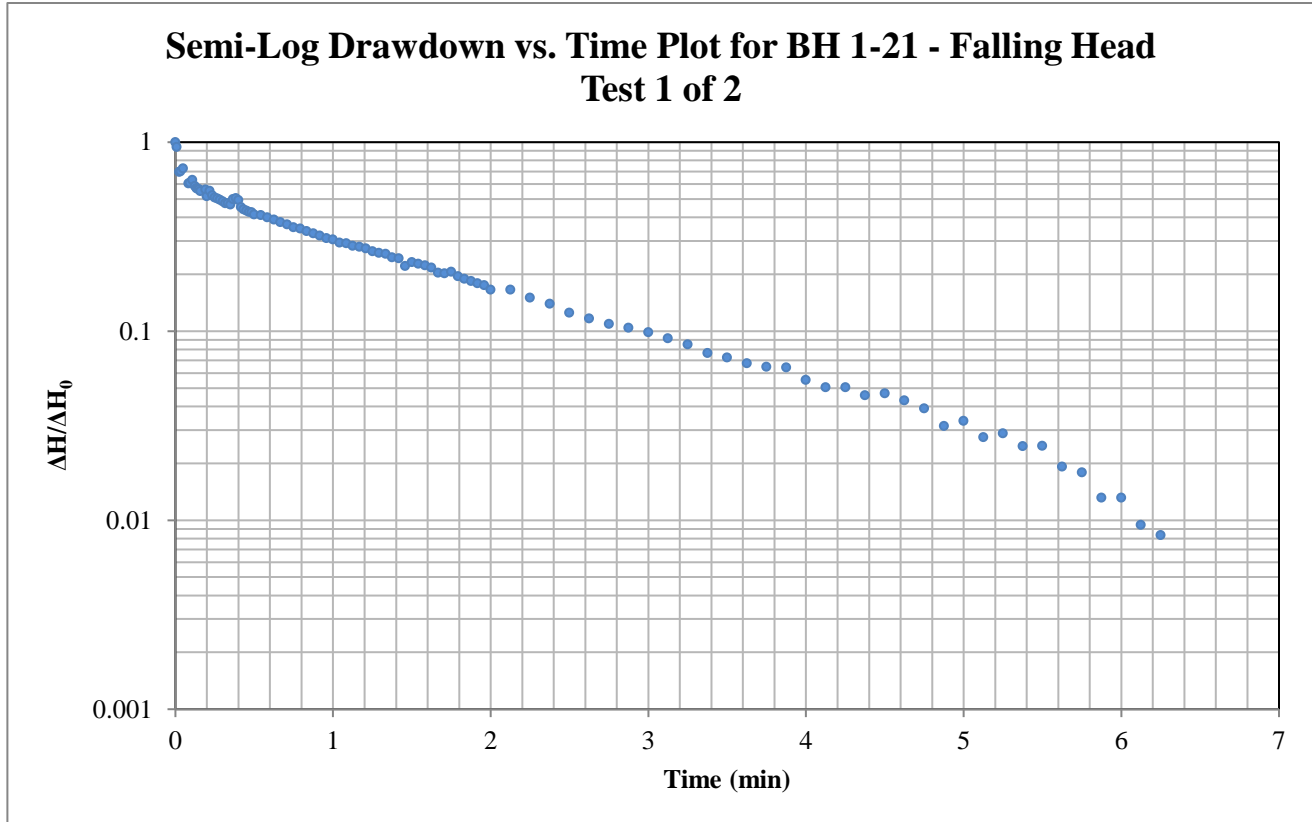

Hvorslev Horizontal Hydraulic Conductivity

Hvorslev Shape Factor

$$K = \frac{\pi r_c^2}{F t^*} \ln\left(\frac{\Delta H^*}{\Delta H_0}\right)$$

$$F = \frac{2\pi L}{\ln\left(\frac{2L}{D}\right)}$$

Valid for $L \gg D$

Hvorslev Shape Factor F: 4.00025

Well Parameters:

L	3.048 m	Saturated length of screen or open hole
D	0.0508 m	Diameter of well
r_c	0.0254 m	Radius of well

Data Points (from plot):

t^* :	0.679 minutes	$\Delta H^*/\Delta H_0$:	0.37
---------	---------------	---------------------------	------

Horizontal Hydraulic Conductivity
K = 1.24E-05 m/sec


Hvorslev Hydraulic Conductivity Analysis

Project: Maritime Ontario c/o Realinc-SCS - 8800 Campeau Drive

Test Location: BH 1-21

Test: 2 of 2 Falling Head

Date: May 7, 2021

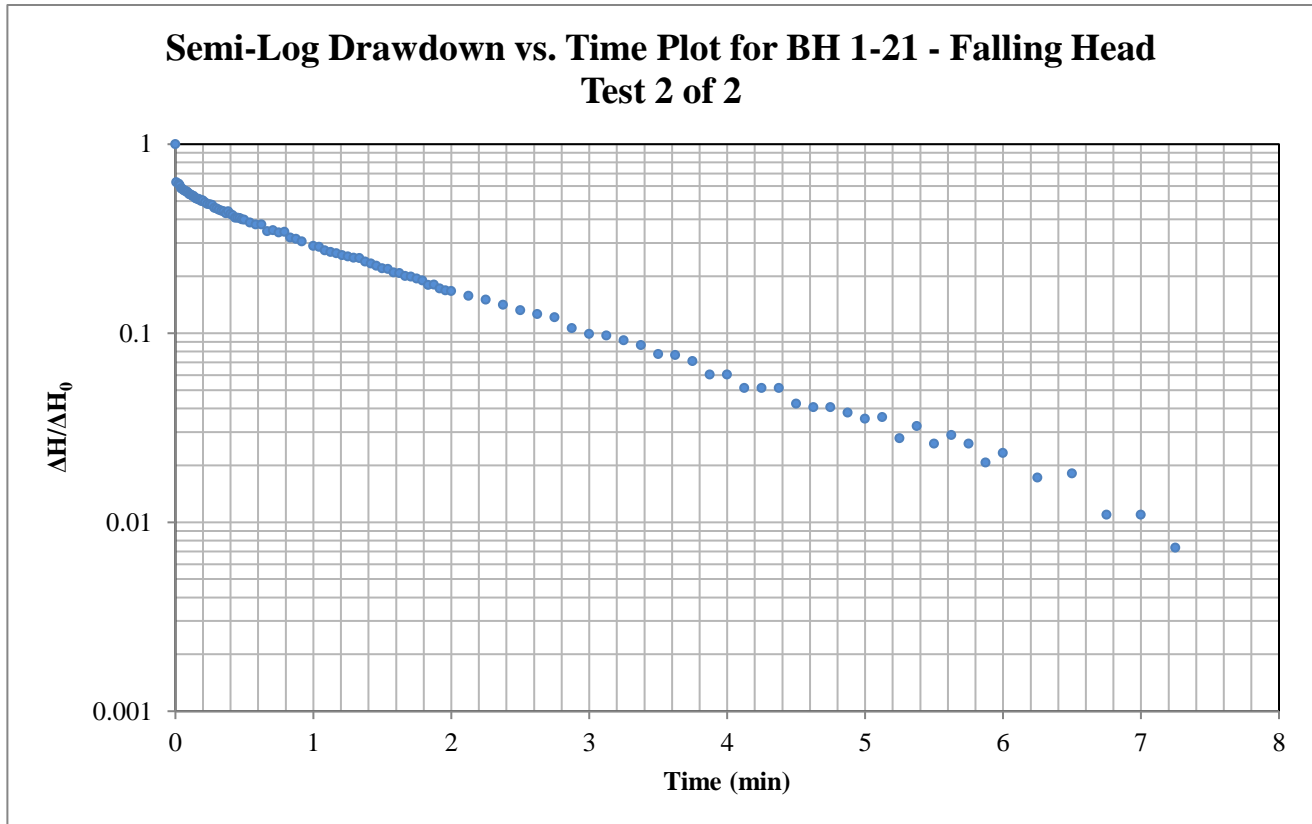

Hvorslev Horizontal Hydraulic Conductivity

Hvorslev Shape Factor

$$K = \frac{\pi r_c^2}{F} \frac{1}{t^*} \ln\left(\frac{\Delta H^*}{\Delta H_0}\right)$$

$$F = \frac{2\pi L}{\ln\left(\frac{2L}{D}\right)}$$

Valid for L >> D

Hvorslev Shape Factor F: 4.00025

Well Parameters:

L	3.048 m	Saturated length of screen or open hole
D	0.0508 m	Diameter of well
r _c	0.0254 m	Radius of well

Data Points (from plot):

t*:	0.628 minutes	ΔH*/ΔH₀:	0.37
-----	---------------	----------	------

Horizontal Hydraulic Conductivity
K = 1.34E-05 m/sec


Hvorslev Hydraulic Conductivity Analysis

Project: Maritime Ontario c/o Realinc-SCS - 8800 Campeau Drive

Test Location: BH 2-21

Test: 1 of 2 Rising Head

Date: May 7, 2021

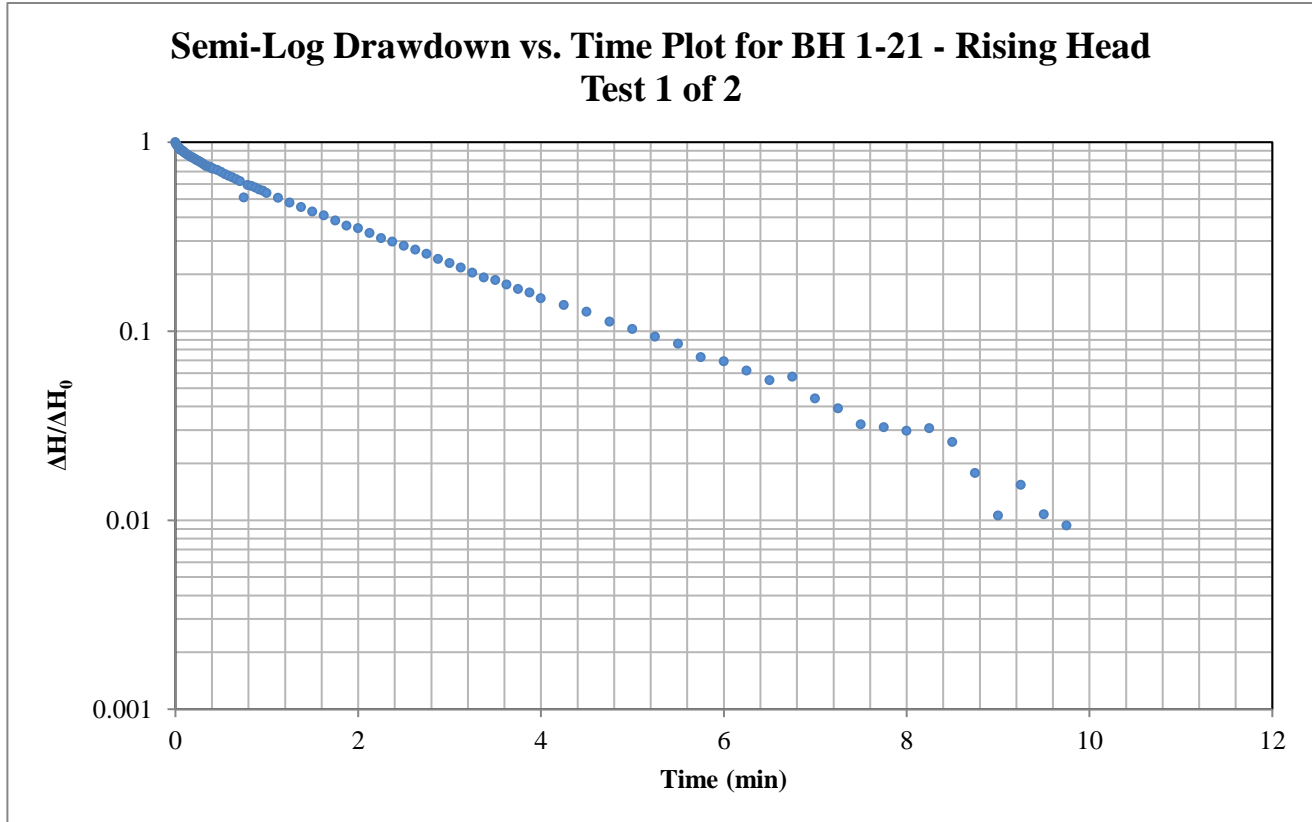

Hvorslev Horizontal Hydraulic Conductivity

Hvorslev Shape Factor

$$K = \frac{\pi r_c^2}{F t^*} \ln\left(\frac{\Delta H^*}{\Delta H_0}\right)$$

$$F = \frac{2\pi L}{\ln\left(\frac{2L}{D}\right)}$$

Valid for $L \gg D$

Hvorslev Shape Factor F: 4.00025

Well Parameters:

L	3.048 m	Saturated length of screen or open hole
D	0.0508 m	Diameter of well
r_c	0.0254 m	Radius of well

Data Points (from plot):

t^* : 1.841 minutes $\Delta H^*/\Delta H_0$: 0.37

Horizontal Hydraulic Conductivity
K = 4.56E-06 m/sec


Hvorslev Hydraulic Conductivity Analysis

Project: Maritime Ontario c/o Realinc-SCS - 8800 Campeau Drive

Test Location: BH 2-21

Test: 2 of 2 Rising Head

Date: May 7, 2021

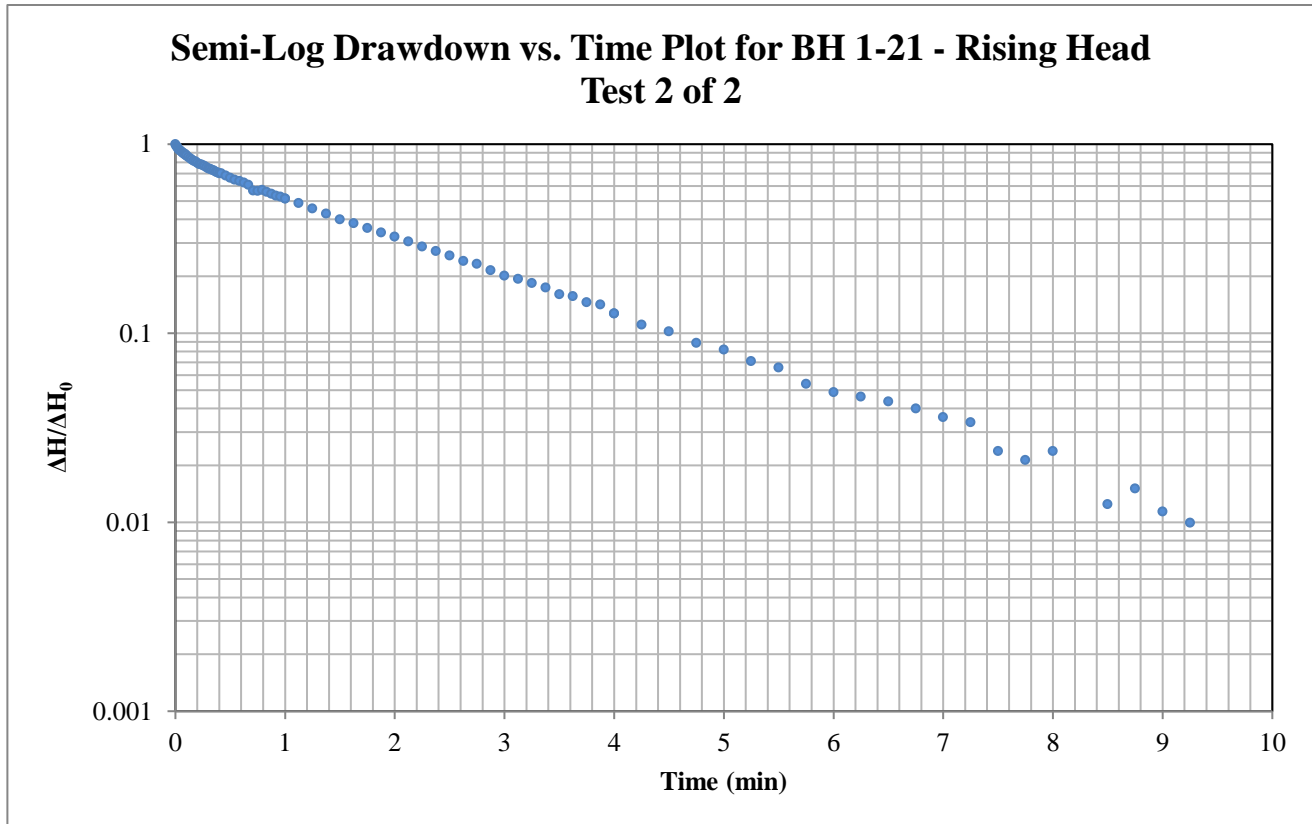

Hvorslev Horizontal Hydraulic Conductivity

Hvorslev Shape Factor

$$K = \frac{\pi r_c^2}{F t^*} \ln\left(\frac{\Delta H^*}{\Delta H_0}\right)$$

$$F = \frac{2\pi L}{\ln\left(\frac{2L}{D}\right)}$$

Valid for L >> D

Hvorslev Shape Factor F: 4.00025

Well Parameters:


L	3.048 m	Saturated length of screen or open hole
D	0.0508 m	Diameter of well
r _c	0.0254 m	Radius of well

Data Points (from plot):

t*:	1.705 minutes	ΔH*/ΔH₀:	0.37
-----	---------------	----------	------



Horizontal Hydraulic Conductivity

K = 4.93E-06 m/sec



- LEGEND:**
- BOREHOLE LOCATION (CURRENT INVESTIGATION)
 - BOREHOLE LOCATION (PREVIOUS INVESTIGATION , PG3115)
 - 105.99 GROUND SURFACE ELEVATION (m)
 - (97.38) PRACTICAL REFUSAL TO DCPT/AUGERING ELEVATION (m)

TBM-TOP OF STORM WATER MANHOLE NORTH WEST OF THE INTERSECTION OF PALLADIUM AND CAMPEAU DRIVE. GEODETIC ELEVATION=104.53m PROVIDED BY STANTEC GEOMATICS LTD.

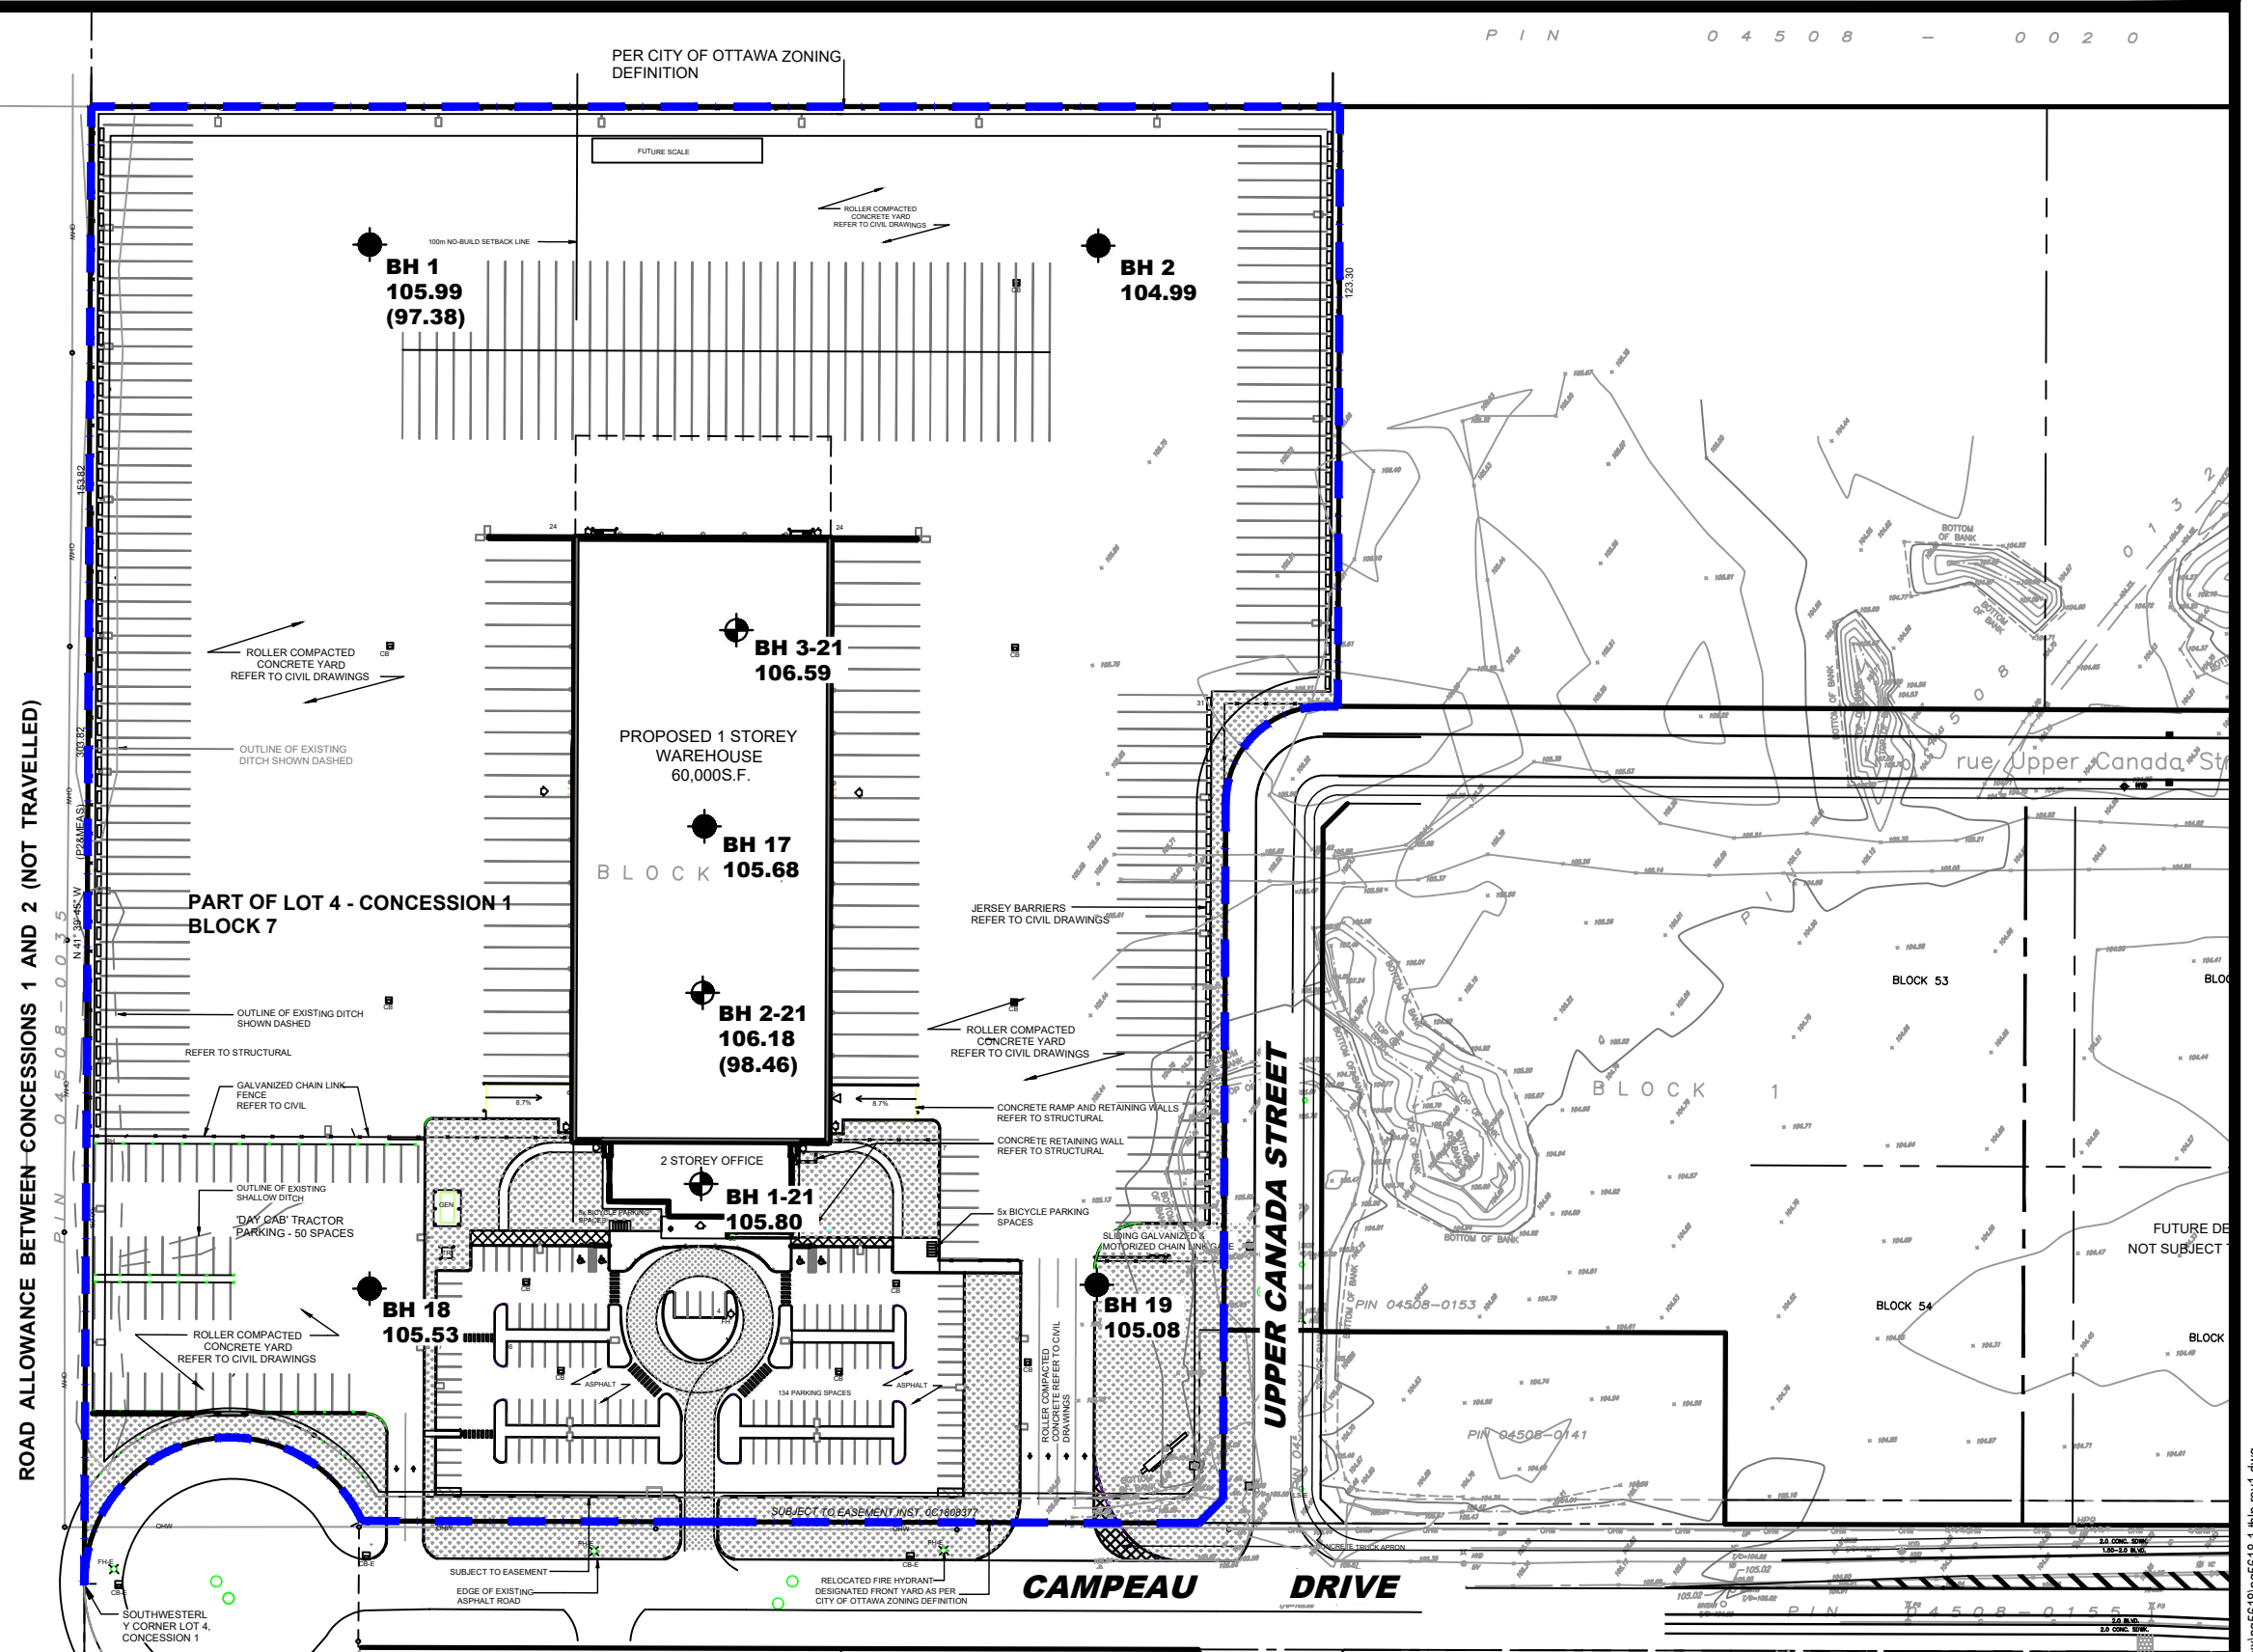

patersongroup
consulting engineers

154 Colonnade Road South
Ottawa, Ontario K2E 7J5
Tel: (613) 226-7381 Fax: (613) 226-6344

NO.	REVISIONS	DATE	INITIAL
1	BH 1-21 TO 3-21 ADDED	18/03/2021	NP

MARITIME ONTARIO
GEOTECHNICAL INVESTIGATION

PROPOSED WAREHOUSE AND OFFICE BUILDINGS - KANATA WEST BUSINESS PARK - BLOCK 4 - CAMPEAU DR.
OTTAWA, ONTARIO

Title: **TEST HOLE LOCATION PLAN**

Scale:	1:1500	Date:	11/2020
Drawn by:	NFRV	Report No.:	PG5618-1 REV.1
Checked by:	NP	Dwg. No.:	PG5618-1
Approved by:	DJG	Revision No.:	1

p:\autocad drawings\geotechnical\pg5618\pg5618-1.dwg

re: **Geotechnical Response to City Comments**
Proposed Commercial Development
8800 Campeau Drive - Ottawa

to: Maritime Ontario c/o Realinc-SCS - **Mr. David Plumb** - dplumb@realinc-scs.com

date: May 11, 2021

file: PG5618-MEMO.01 Revision 1

Further to your request and authorization, Paterson Group (Paterson) prepared the following memorandum to provide geotechnical responses to city comments regarding the proposed commercial development at the aforementioned site. This memorandum should be read in conjunction with Paterson Geotechnical Report PG5618-1 Revision 3 dated May 11, 2021.

Servicing and Stormwater Management Report Comments

Comment 34: *Per the Geotechnical Report: “The percolation rate was interpreted from the hydraulic conductivity which was estimated based on previous investigations within the area and on experience”.*

Comment 35: *Per the Draft December 2019 LID Guidance Document (which has been circulated publicly for comment): “Infiltration Rate – The rate at which stormwater moves from the surface into the soil, typically measured in inches per hour, millimeters, centimeters or meters per second. It is critical to note that that **infiltration rate and hydraulic conductivity are two different concepts and that conversion from one parameter to another cannot be done through unit conversion (see hydraulic conductivity and saturated hydraulic conductivity)**. Typically, saturated hydraulic conductivity is used to calculate the infiltration rate to be used as a design input based on the approximate relationships and often include an infiltration reduction factor (or safety factor)”*

Comment 36: Please request confirmation of the site specific infiltration rate from the Geotechnical Engineer re the definition above.

Response to Comments 34, 35 & 36: Please refer to sections 5.8 Hydraulic Conductivity Testing and 5.9 Percolation Rates of Paterson Group Report PG5618 Revision 3, dated May 11, 2021. Hydraulic conductivity testing was carried out at borehole BH 1-21 on May 7, 2021. The hydraulic conductivity of the in-situ soils was determined based on the results of the rising head and falling head testing (“slug testing”) carried out at borehole BH 1-21. The hydraulic conductivity values were then used to determine the infiltration rates of the in-situ soils using Figure C1: Approximate relationship between infiltration rate and hydraulic conductivity, as described in the Draft December 2019 LID Guidance Document.

Geotechnical Investigation, Prepared by Paterson Group, Report PG5618-1, dated November 24, 2020 Report Comments

Comment 45: *Please provide a memo that grading plans have been reviewed and meets grade raise restrictions.*

Response: Please refer to Paterson Group memorandum PG5618-MEMO.02, dated May 6, 2021. A silty clay deposit was not encountered during the geotechnical investigation and therefore no permissible grade raises restrictions have been provided for the subject site. Based on a review of the most recent grading plans and the soils present at the subject site, the grading is considered acceptable from a geotechnical perspective.

Comment 46: *Please Provide confirmation of the seasonal high groundwater elevation.*

Response: Please refer to section 4.3 Groundwater of Paterson Group Report PG5618 Revision 3, dated May 11, 2021. Groundwater levels were measured periodically throughout the spring months at the monitoring well constructed at borehole BH 1-21 as well as within the flexible piezometers installed in the remaining boreholes, seasonal high groundwater was generally encountered at geodetic elevations ranging from 105.2 to 106.0 m.

However, it is anticipated that the elevated groundwater levels observed within boreholes BH 1-21 through BH 3-21 have been influence by surface water collected within the adjacent drainage ditch which runs along the western limit of the subject site. Therefore, groundwater levels are expected to be lowered within the immediate area of the drainage ditch if a culvert is installed to allow flow to continue toward the adjacent ditch along the access road.

Comment 47: *Please demonstrate in the next design submission how the base of the storage media is a minimum 1 m from the seasonally high groundwater table, as per Ministry requirements.*

Response: Upon review of the civil drawings, the base of the proposed infiltration gallery will be located at a geodetic elevation of 103.6 m. Based on the measured groundwater levels within boreholes BH 1-21 through BH 3-21 the seasonally high groundwater is anticipated to be located at an approximate geodetic elevation of 105 to 106 m. However, as previously discussed, it is anticipated that the elevated groundwater levels have been influenced by the neighbouring quarry.

Based on the observed colour and consistency of the recovered soil samples, the long-term groundwater table is anticipated to be located at an approximated geodetic elevation of 104 to 104.5 m. Further, it is anticipated that the localized long-term groundwater level will be lowered due to development of the site and adjacent roadway, which will provide sufficient separation between the storage media and the groundwater table.

Comment 48: *The depth from the bottom of the infiltration practice to the bedrock should be greater than or equal to 1 meter, per Ministry requirements. Please provide confirmation that this will be achieved.*

Response: Based on the available geological mapping, bedrock is expected at a depth of 5 to 15 m below the existing ground surface. In addition, practical refusal to dynamic cone penetration testing was encountered in boreholes BH 2-21 and BH 1 (2014) at geodetic elevations of 98.46 and 97.38 m, respectively. Upon review of the civil drawings, the bottom of the infiltration system will be located at geodetic elevation 103.6 m. Therefore, the depth from the bottom of the infiltration system to the bedrock will be greater than 1 m, as per Ministry requirements.

Comment 49: *Please provide a note about construction the infiltration gallery under the compacted Concrete Surface, and recommendations for constructions.*

Response: It is anticipated that the infiltration system will be designed to support the temporary loading during construction of the roller compacted concrete structure as well as the heavy truck traffic loads.

Where the infiltration system subgrade consists of a silty sand which is observed to be in a loose state of compactness, the material should be proof compacted using suitable vibratory equipment making several passes under dry conditions and above freezing temperatures and which is approved by Paterson at the time of construction. If soft spots develop in the subgrade during compaction or due to construction traffic, the affected areas should be excavated and replaced with OPSS Granular B Type II material.

Comment 50: *Please confirm the design for Roller Compacted Concrete Surface.*

Response: Please refer to Section 5.7 Pavement Structure, Table 3 - Recommended Roller Compacted Concrete Pavement Structure - Heavy Truck Access Lanes, Parking and Loading Areas. The roller compacter concrete pavement structure will consist of an approximate 200 mm thickness of zero slump, 32 MPa at 28 day strength concrete which is underlain by an approximate 300 mm thickness OPSS Granular A crushed stone base.

We trust that the current submission meets your immediate requirements.

Best Regards,

Paterson Group Inc.

Kevin A. Pickard, EIT

Paterson Group Inc.



David J. Gilbert, P.Eng.

Ottawa Head Office
154 colonnade Road South
Ottawa – Ontario – K2E 5S9
Tel: (613) 226-7381 Fax: (613) 226-6344

Ottawa Laboratory
28 Concourse Gate
Ottawa – Ontario – K2E 7T7
Tel: (613) 226-7381 Fax: (613) 226-6344

Northern Office and Laboratory
63 Gibson Street
North bay – Ontario – P1B 8Z4
Tel: (705) 472-5331 Fax: (705) 472-2334

re: **Geotechnical Response to City Comments - Second Submission**
Proposed Commercial Development
8800 Campeau Drive - Ottawa

to: Maritime Ontario c/o Realinc-SCS - **Mr. David Plumb** - dplumb@realinc-scs.com

date: July 30, 2021

file: PG5618-MEMO.04

Further to your request and authorization, Paterson Group (Paterson) prepared the following memorandum to provide geotechnical responses to second submission comments from the City of Ottawa (dated July 26, 2021) regarding the proposed commercial building at the aforementioned site. This memorandum should be read in conjunction with Paterson Geotechnical Report PG5618-1 Revision 3 dated May 11, 2021 and Paterson Memorandum PG5618-MEMO.01 Revision 1 dated May 11, 2021.

Engineering

Maritime-Ontario, 8800 Campeau Drive, KWBP, Servicing and Stormwater Management Report, Dated December 2020

Comment 9: *Please provide confirmation of the seasonal high groundwater elevation (seasonal high water is typical during the spring freshet).*

Geotech Response - First Submission: *Please refer to section 4.3 Groundwater of Paterson Group Paterson Group Report PG5618 Revision 3, dated May 11, 2021. Groundwater levels were measured periodically throughout the spring months at the monitoring well constructed at borehole BH 1-21 as well as within the flexible piezometers installed in the remaining boreholes, seasonal high groundwater was generally encountered at geodetic elevations ranging from **105.2 to 106.0 m**.*

*However, it is anticipated that the elevated groundwater levels observed within boreholes BH 1-21 through BH 3-21 have been influenced by **surface water collected within the adjacent drainage ditch** which runs along the western limit of the subject site. Therefore, groundwater levels are expected to be lowered within the immediate area of the drainage ditch if a culvert is installed to allow flow to continue toward the adjacent ditch along the access road.*

Geotech Response - First Submission: *Upon review of the civil drawings, the base of the proposed infiltration gallery will be located at a geodetic elevation of 103.6 m. Based on the measured groundwater levels within boreholes BH 1-21 through BH 3-21 the seasonally high groundwater is anticipated to be located at an approximate geodetic elevation of 105 to 106 m. However, as previously discussed, it is anticipated that the elevated groundwater levels have been influenced by the neighbouring quarry.*

Based on the observed colour and consistency of the recovered soil samples, the long-term groundwater table is anticipated to be located at an approximated geodetic elevation of 104 to 104.5 m. Further, it is anticipated that the localized long-term groundwater level will be lowered due to development of the site and adjacent roadway, which will provide sufficient separation between the storage media and the groundwater table.

Robinson Response: *The function of an infiltration gallery may be limited during seasonally high groundwater conditions, **however, infiltration is still feasible during the remainder of the year when groundwater levels are lower.** The groundwater level on the property is expected to become lower over time once the site is developed as the sewer service trenches are lower than the infiltration gallery and the foundation drainage system includes two duplex sump pump systems that have been designed to maintain the groundwater level below the basement slab.*

City 2nd Review: *The long term groundwater elevation and future seasonal high groundwater elevation have not been declared and as such, it is not clear how MECP guidelines are met and it is not clear how this proposed LID will achieve the infiltration target (or whether the design may result in groundwater directed into the receiving STM sewer and downstream SWMF).*

- ❑ *Based on the information received to date, the City is concerned that the long and short-term groundwater will submerge the LID and the LID will not function as designed.*

Paterson Response: Paterson does not expect that the long-term groundwater level will negatively influence the operation of the LID system. It is expected that hardscaping and development of the subject site will result in lowering of the groundwater table due to the introduction of a stormwater management system which will limit the amount of surface water contributing to the current elevated groundwater level observed across the site. This groundwater lowering condition has been observed at several developed blocks within the Kanata West Business Park in areas of similar soil conditions.

- ❑ *It's not clear from the Geotech response whether surface water in the adjacent ditch entered the boreholes BH 1-21 through BH 3-21 via the surface or via groundwater. Please clarify.*

Paterson Response: It is anticipated that the surface water within the drainage ditch has contributed to raising the groundwater table across the undeveloped site. The groundwater levels observed at borehole locations BH 1-21 through 3-21 reflect this elevated water table. As noted previously, the development of the subject site will result in significantly less surface water from rain event and snow melt perched within the subject site. It is expected that the hardscaping and presence of granular bedding below service pipes will provide an outlet for perched water, which will lower the seasonal high and long-term groundwater elevations to at or near the lowest service pipe invert elevations (approximately 102 to 101.8 m).

- Are the “elevated groundwater levels” influenced by the quarry or the adjacent drainage ditch? Please clarify how the ditch and quarry impact groundwater levels and how this has been considered in the long term estimates.

Paterson Response: The source of the elevated groundwater levels has not been confirmed. However, several potential sources have been identified which could contribute to the elevated groundwater table observed within the western portion of the subject site. Paterson has incorporated the potential for an elevated groundwater level within the design recommendations for the subject building (i.e. waterproofing and sump pump drainage recommendations for basement level). It should be further noted that the development of the site, which will include stormwater management services will have a positive impact on controlling the groundwater elevation at a lower depth.

- *It's not clear how infiltration is feasible in the long term and especially when the groundwater is at its seasonal high. The building's proposed underground level underside of footing (per the Geotech Memo) is at 104.5 m. If the long-term groundwater around the LID is at elevation of 104.5 m then the infiltration practice is submerged and groundwater would be directed to the downstream SWMF (the proposed invert of the LID downstream subdrain invert is 104.21 m, which is lower than the underground level underside of footing at 104.5 m). As such, in the long and short term, the LID will not achieve any infiltration (nor will it perform at all as an infiltration facility) and its not clear whether the design will cause groundwater to be directed to the STM sewers and SWMF.*

Paterson Response: As previously noted, it is expected that development of the subject site will result in lowering of the groundwater table due to the introduction of a stormwater management system which will limit the amount of surface water contributing to the current elevated groundwater level observed across the site. It is further expected that the hardscaping and presence of granular bedding below service pipes will provide an outlet for perched water, which will lower the seasonal high and long-term groundwater elevations to at or near the lowest service pipe invert elevations (approximately 102 to 101.8 m). This condition has been observed at several developed blocks within the Kanata West Business Park in areas of similar soil conditions.

- *As per the first review: a groundwater mounding analysis is required where the seasonally high water table (or bedrock) is less than 1 m from the bottom of the facility. Please reference the February 2021 LID Guidance Document re when a mounding analysis is required.*

Paterson Response: It is expected that hardscaping and presence of granular bedding below service pipes will provide an outlet for perched water and will result in lowering of the seasonal high and long-term groundwater elevations to at or near the lowest service pipe invert elevations (approximately 102 to 101.8 m). Based on a long-term groundwater elevation of 102 m and a seasonal high groundwater elevation of 102.5 m, a separation of 1m from the bottom of the LID facility and the seasonally high water table is expected.

- ❑ *As per the first review: explore whether the invert of the gallery can be raised and whether the footprint of the gallery needs to be increased to meet the KWMSS infiltration targets while also complying with MECP guidelines.*

Paterson Response: This comment has been acknowledged.

- ❑ *Is it worth exploring any other opportunities onsite to infiltrate stormwater to demonstrate compliance with the MECP guidelines?*

Paterson Response: This comment has been acknowledged.

- ❑ *If the site requires an MECP ECA, then please demonstrate the 1 m clearance.*

Paterson Response: This comment has been acknowledged.


We trust that the current submission meets your immediate requirements.

Best Regards,

Paterson Group Inc.



Kevin A. Pickard, EIT




David J. Gilbert, P.Eng.

Paterson Group Inc.

Ottawa Head Office
154 Colonnade Road South
Ottawa – Ontario – K2E 5S9
Tel: (613) 226-7381 Fax: (613) 226-6344

Ottawa Laboratory
28 Concourse Gate
Ottawa – Ontario – K2E 7T7
Tel: (613) 226-7381 Fax: (613) 226-6344

Northern Office and Laboratory
63 Gibson Street
North bay – Ontario – P1B 8Z4
Tel: (705) 472-5331 Fax: (705) 472-2334

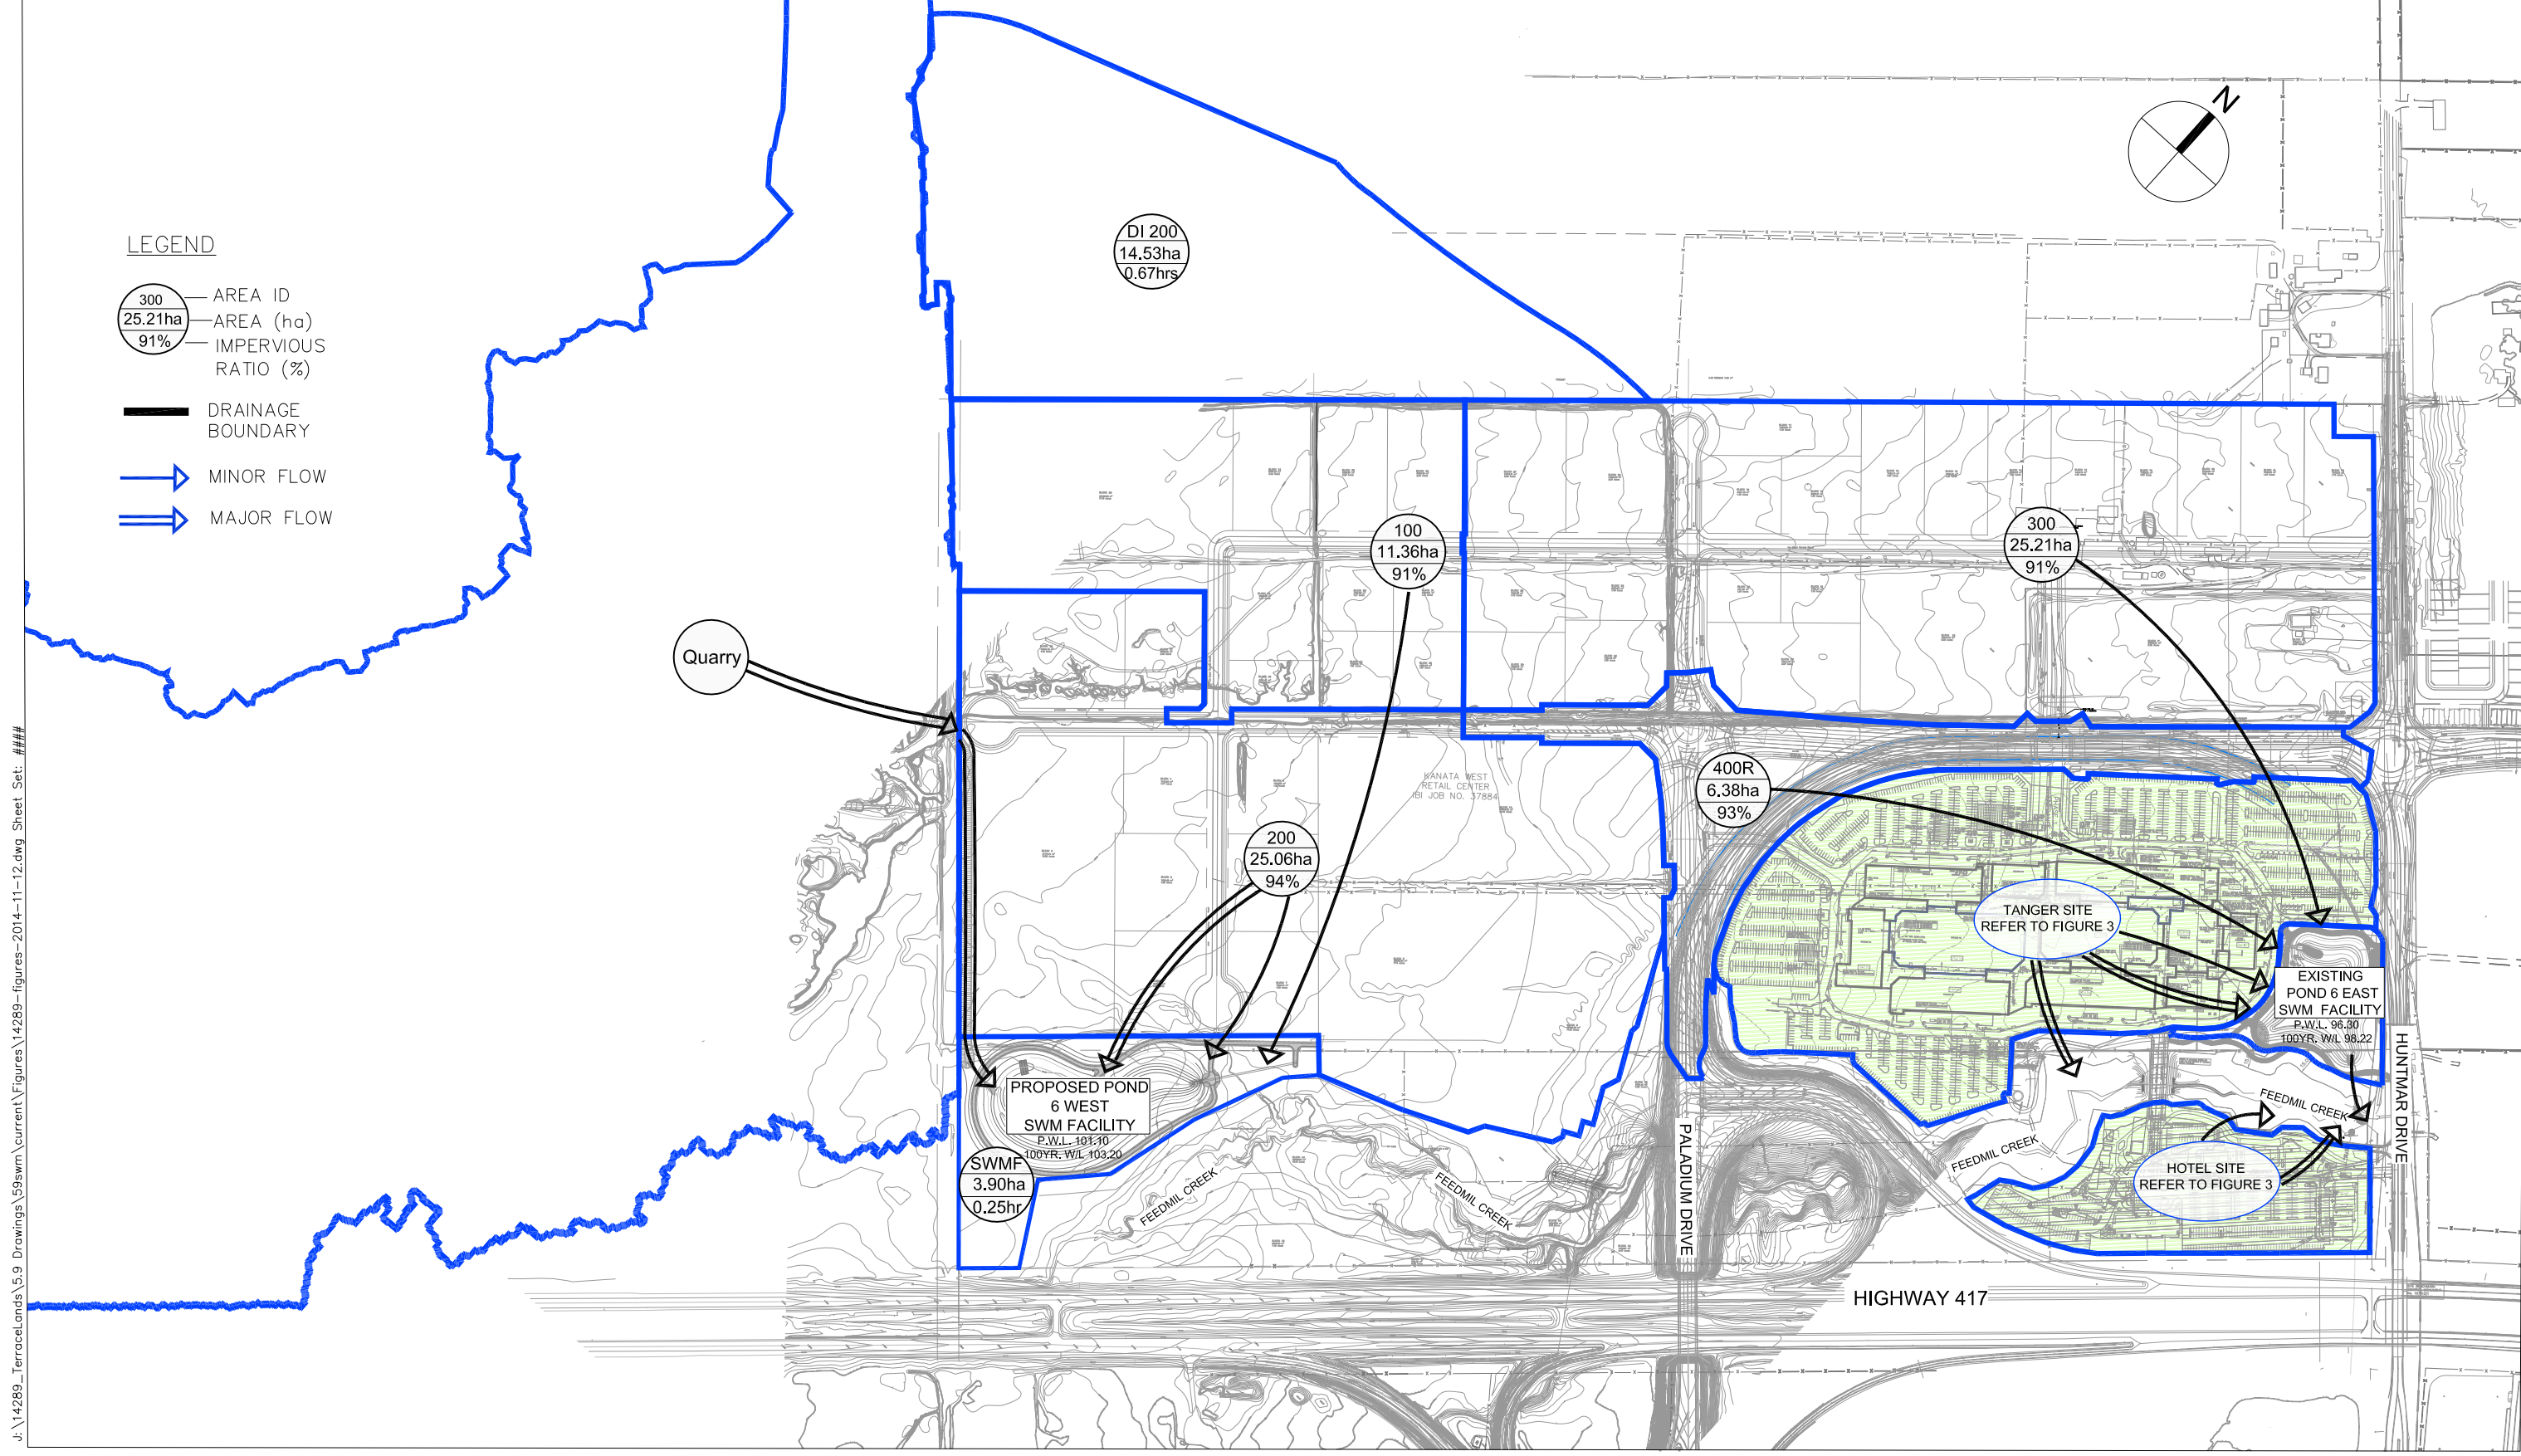

J:\14289_Terracelands\5.9 Drawings\59swm\current\Figures\14289-figures-2014-11-12.dwg Sheet Set: ###

Plot Style: ---- Plot Scale: 1:1 Plotted At: Sep. 28, 15 10:17 AM Printed By: SLAVICA VUKIC Last Saved By: SVUKIC Last Saved At: Sep. 28, 15

Appendix F

Storm Sewer Design Sheet

Storm Drainage Area Plan
(DWG. 20027-STM1)

Flow Control Roof Drainage
Declaration

Roof Flow Correspondence

Figure 3 – Roof Drainage Area Plan

Infiltration Gallery Storm Sewer Design
Sheet

Runoff Coefficient Calculations

Free Flow Calculations

ICD Calculations

Storage Volume Tables

HGL Computation Sheet

STORM SEWER DESIGN SHEET
for
MARITIME-ONTARIO, CAMPEAU DRIVE, KWBP



LOCATION				AREA (ha)		INDIV. 2.78AR	ACCUM. 2.78AR	TIME OF CONC. (min)	5 YR RAINFALL INTENSITY (mm/hr)	5 YR PEAK FLOW (L/s)	PROPOSED SEWER						
DRAINAGE AREA	STREET NAME	FROM MH	TO MH	TOTAL AREA	C						PIPE DIA. (mm)	GRADE (%)	LENGTH (m)	CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW (min)	PERCENT FULL
STM1	PARKING LOT	CB 1	MAIN	0.90	0.90	2.25	2.25	10.00	104.19	234.64	366.4	2.97	3.7	284.36	2.70	0.02	83%
STM2	PARKING LOT	CB 2	MAIN	0.63	0.90	1.58	1.58	10.00	104.19	164.15	366.4	2.97	3.7	284.36	2.70	0.02	58%
STM3	PARKING LOT	CB 3	MAIN	0.67	0.90	1.68	1.68	10.00	104.19	174.93	366.4	2.89	3.8	280.50	2.66	0.02	62%
	PARKING LOT	204	203	0.00	0.00	0.00	5.51	10.02	104.07	573.06	762.0	0.30	150.0	636.77	1.40	1.79	90%
STM4	PARKING LOT	CB 4	MAIN	0.44	0.82	1.01	1.01	10.00	104.19	105.44	299.4	2.93	4.1	164.75	2.34	0.03	64%
STM16	LANDSCAPE	CB 16	DICB 15	0.02	0.28	0.02	0.02	10.00	104.19	1.78	251.5	1.00	25.9	60.46	1.22	0.35	3%
STM15	LANDSCAPE	DICB 15	MAIN	0.05	0.25	0.04	0.05	10.35	102.36	5.38	251.5	3.05	5.9	105.59	2.13	0.05	5%
	PARKING LOT	203	202	0.00	0.00	0.00	6.57	11.81	95.50	627.53	762.0	0.35	93.0	687.79	1.51	1.03	91%
STM11	PARKING LOT	CB 11	MAIN	0.12	0.70	0.23	0.23	10.00	104.19	23.44	251.5	3.03	3.3	105.24	2.12	0.03	22%
	PARKING LOT	202	201	0.00	0.00	0.00	6.80	12.84	91.25	620.13	762.0	0.38	59.9	716.67	1.57	0.64	87%
STM5	PARKING LOT	CB 5	MAIN	0.96	0.89	2.38	2.38	10.00	104.19	248.50	366.4	2.89	3.8	280.50	2.66	0.02	89%
STM6	PARKING LOT	CB 6	MAIN	0.62	0.89	1.54	1.54	10.00	104.19	160.49	366.4	2.89	3.8	280.50	2.66	0.02	57%
STM7	PARKING LOT	CB 7	MAIN	0.54	0.90	1.35	1.35	10.00	104.19	140.47	299.4	2.89	3.8	163.62	2.32	0.03	86%
	PARKING LOT	207	206	0.00	0.00	0.00	5.27	10.03	104.05	548.70	686.0	0.55	150.0	651.51	1.76	1.42	84%
STM17	LANDSCAPE	DICB 17	MAIN	0.07	0.27	0.05	0.05	10.00	104.19	5.06	251.5	3.01	21.6	104.89	2.11	0.17	5%
STM8	PARKING LOT	CB 8	MAIN	0.32	0.68	0.60	0.60	10.00	104.19	62.65	251.5	2.98	8.4	104.37	2.10	0.07	60%
	PARKING LOT	206	205	0.00	0.00	0.00	5.92	11.45	97.13	575.34	686.0	0.55	92.9	651.51	1.76	0.88	88%
STM18	PARKING LOT	BLDG	208	0.06	0.90	0.14	0.14	10.00	104.19	14.83	251.5	4.02	9.2	121.27	2.44	0.06	12%
STM9	PARKING LOT	CB 9	MAIN	0.10	0.85	0.22	0.22	10.00	104.19	23.40	251.5	0.99	32.2	60.16	1.21	0.44	39%
STM12	PARKING LOT	CB 12	MAIN	0.08	0.89	0.20	0.20	10.00	104.19	20.91	251.5	1.01	33.5	60.76	1.22	0.46	34%
STM13	PARKING LOT	CB 13	MAIN	0.11	0.79	0.25	0.25	10.00	104.19	26.19	251.5	0.99	23.2	60.16	1.21	0.32	44%
STM10	PARKING LOT	CB 10	MAIN	0.11	0.79	0.25	0.25	10.00	104.19	26.24	251.5	1.00	21.9	60.46	1.22	0.30	43%
STM10	PARKING LOT	208	201	0.00	0.00	0.00	1.07	10.44	101.91	109.14	299.4	4.19	43.9	197.02	2.80	0.26	55%

STORM SEWER DESIGN SHEET
for
MARITIME-ONTARIO, CAMPEAU DRIVE, KWBP



LOCATION				AREA (ha)		INDIV. 2.78AR	ACCUM. 2.78AR	TIME OF CONC. (min)	5 YR RAINFALL INTENSITY (mm/hr)	5 YR PEAK FLOW (L/s)	PROPOSED SEWER						
DRAINAGE AREA	STREET NAME	FROM MH	TO MH	TOTAL AREA	C						PIPE DIA. (mm)	GRADE (%)	LENGTH (m)	CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW (min)	PERCENT FULL
STM14	PARKING LOT	CB 14	MAIN	0.10	0.81	0.21	0.21	10.00	104.19	22.34	251.5	3.12	3.2	106.79	2.15	0.02	21%
	PARKING LOT	201	205	0.00	0.00	0.00	8.08	13.48	88.83	717.83	762.0	0.43	70.4	762.36	1.67	0.70	94%
	PARKING LOT	205	200	0.00	0.00	0.00	14.00	14.18	86.31	1208.73	914.0	0.50	30.1	1335.22	2.04	0.25	91%
STM19	PARKING LOT	304	200	0.66	0.90	1.64	1.64	10.00	104.19	170.85	366.4	0.48	55.7	114.32	1.08	0.86	
	PARKING LOT	200	EX101	0.00	0.00	0.00	15.64	14.42	85.46	1337.01	914.0	0.60	20.0	1462.66	2.23	0.15	91%

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations. $I = 998.071 / (T + 6.053)^{0.814}$ (T= time in minutes)
2. Peak Flow = Accumulated 2.78AR x Rainfall Intensity
3. Full Flow Velocity: MIN. = 0.80 m/s; MAX. = 3.0 m/s (City of Ottawa Sewer Design Guidelines, v.2012)

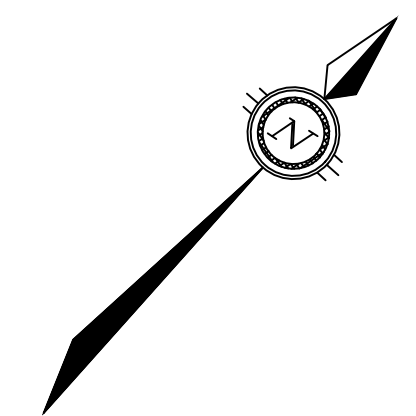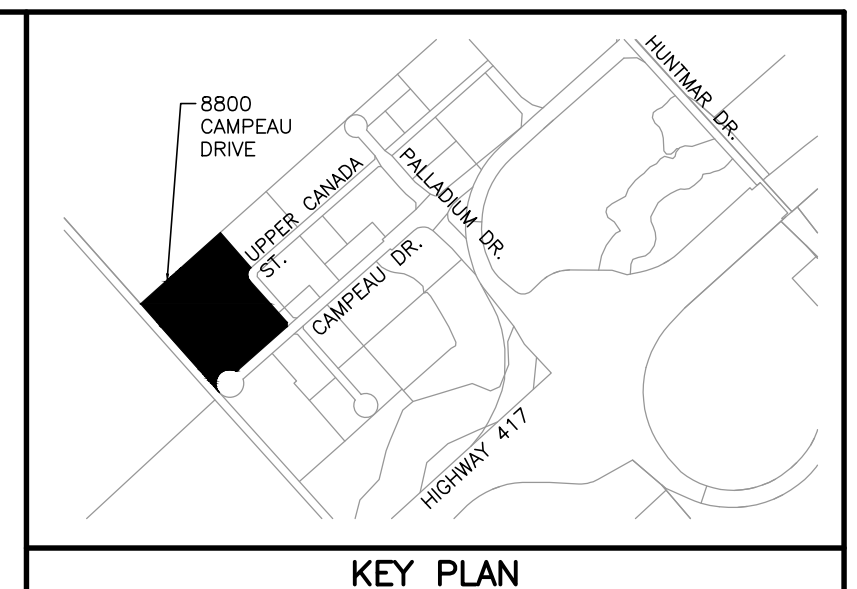

- LEGEND**
- PROPERTY BOUNDARY
 - CATCH BASIN
 - EXISTING CATCH BASIN
 - STORM SEWER & MANHOLE
 - EXISTING STORM SEWER & MANHOLE
 - - - 100m NO-BUILD SETBACK
 - - - SWALE
 - STORM DRAINAGE AREA BOUNDARY
 - ⇒ MAJOR OVERLAND FLOW ROUTE

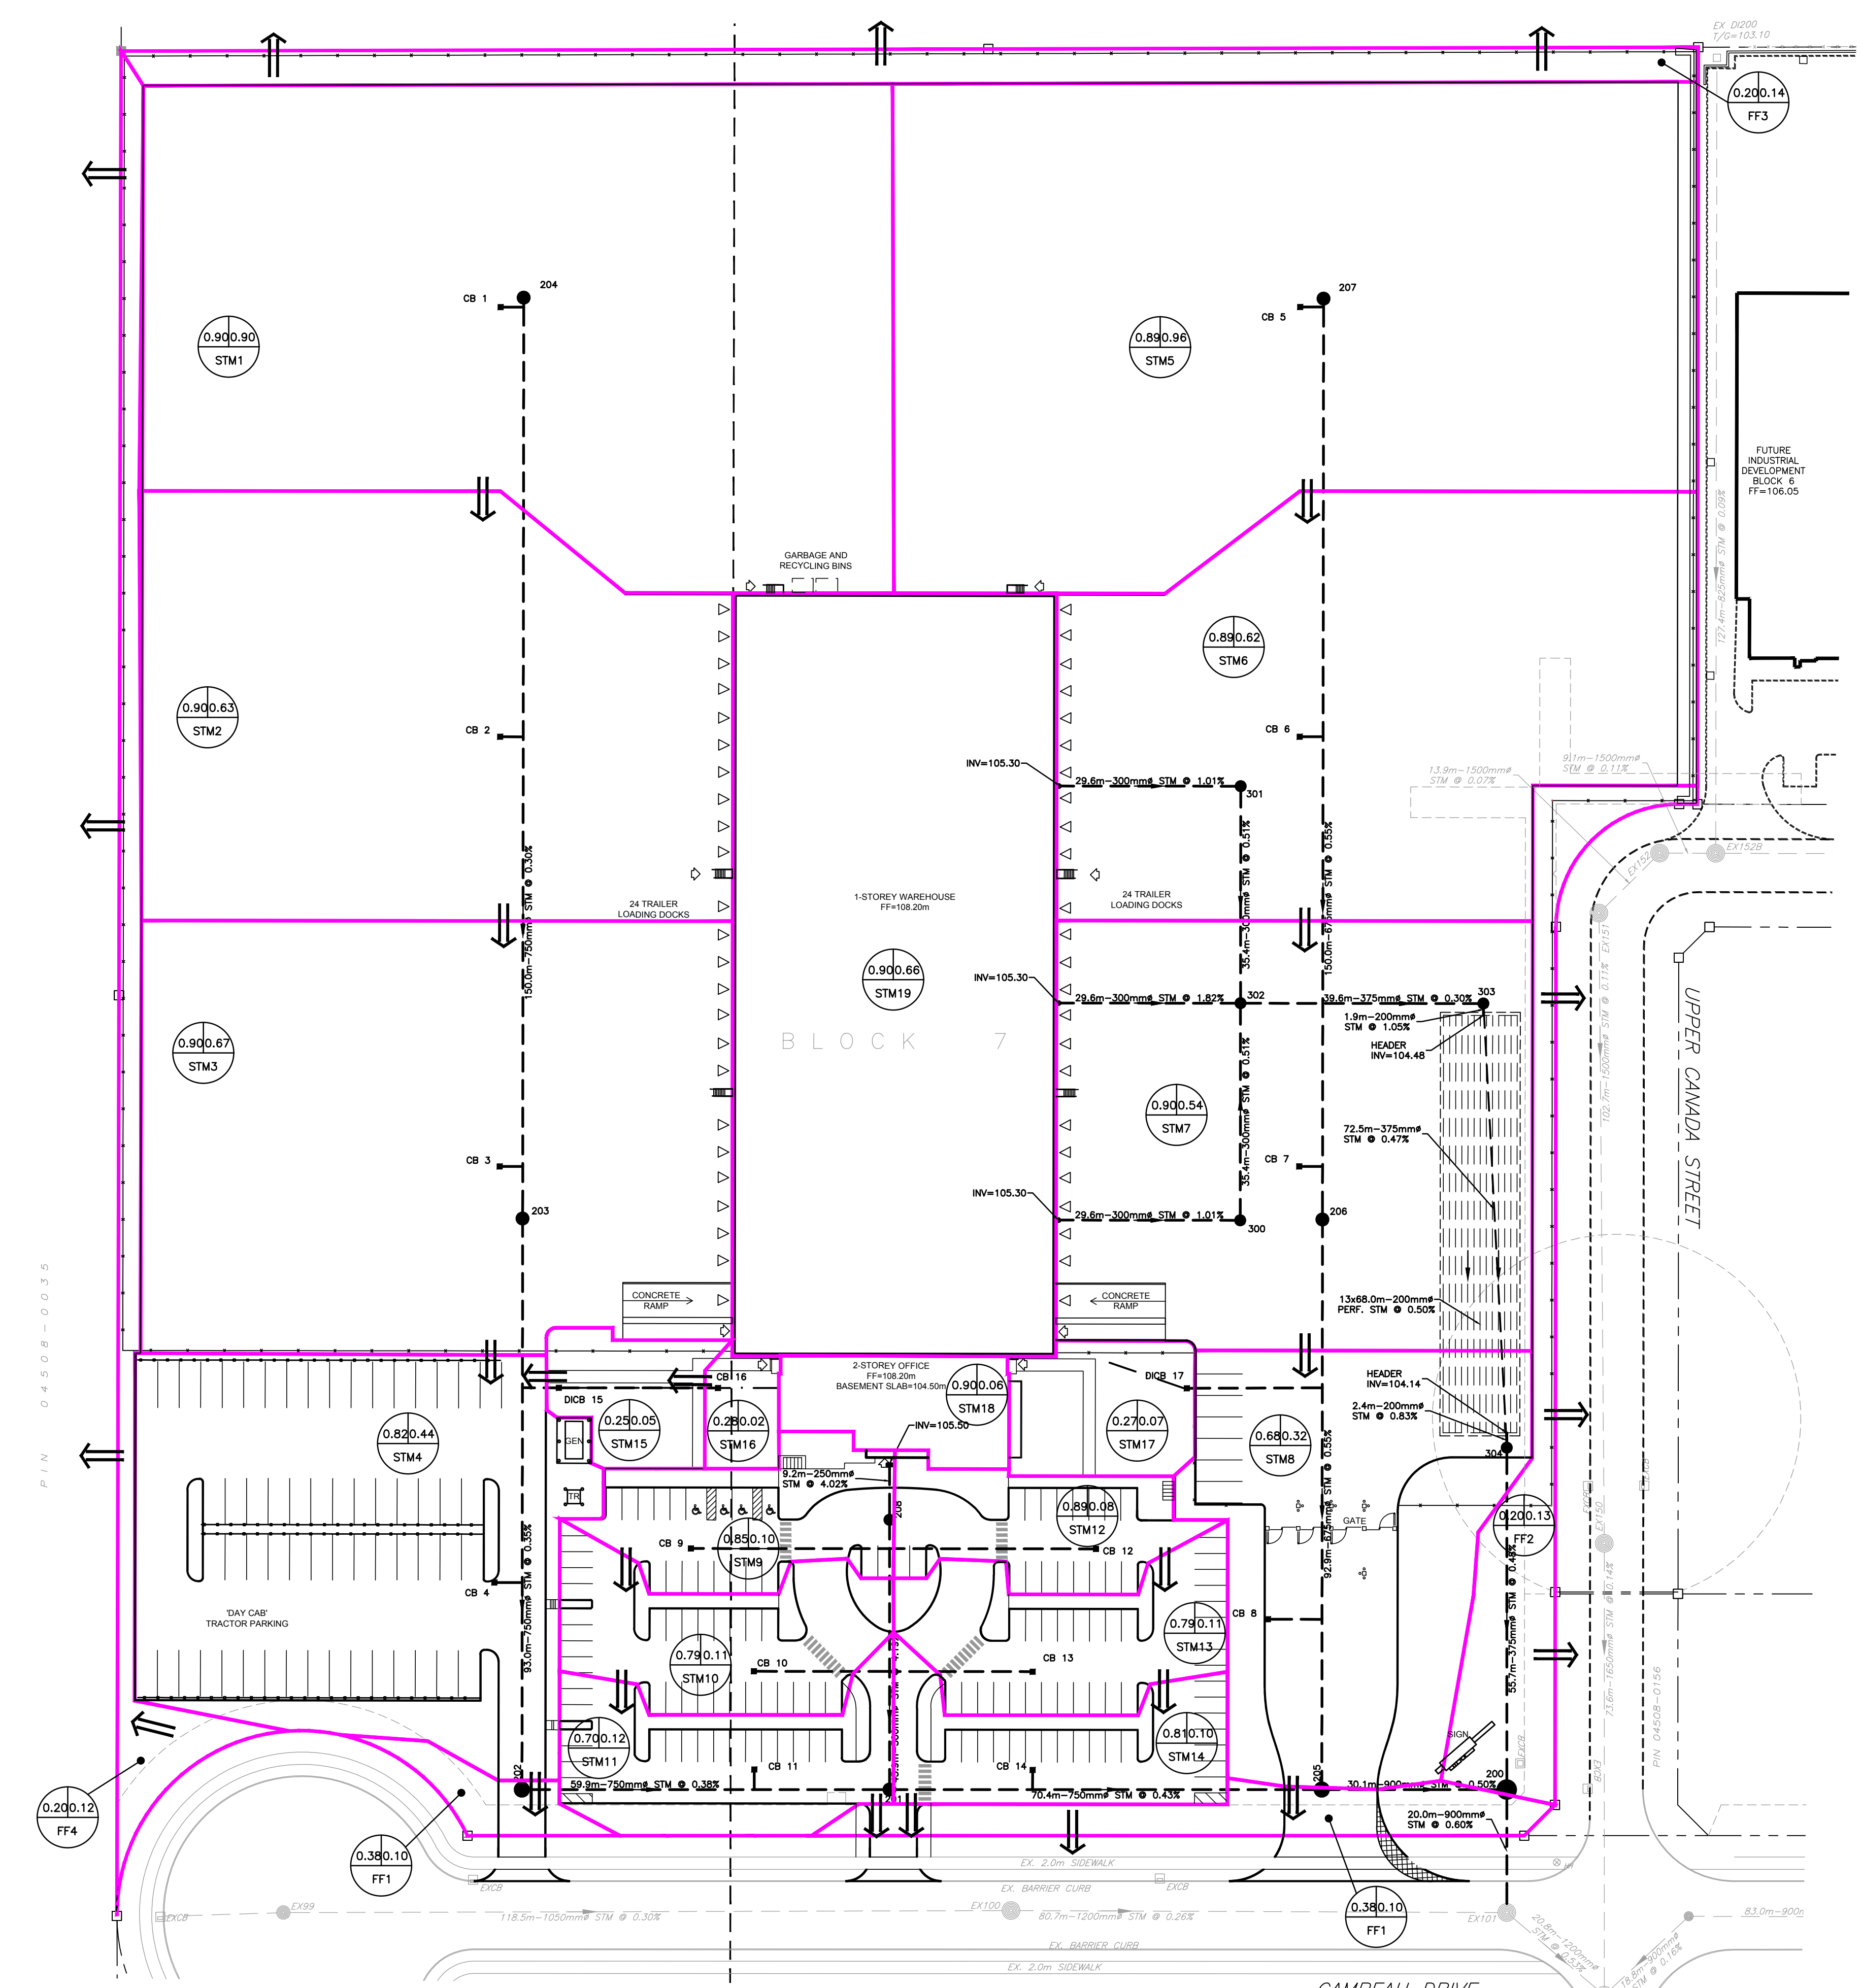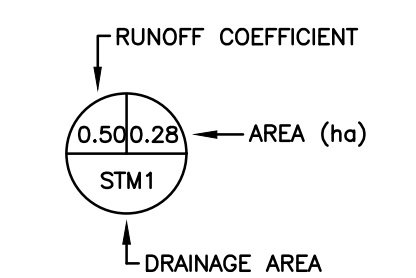



NOT FOR CONSTRUCTION

NOTES

THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

NO.	REVISION DESCRIPTION	DATE	BY
3	REVISED PER COMMENTS	09/08/21	SMC
2	REVISED PER COMMENTS	28/05/21	SMC
1	ISSUED FOR SITE PLAN APPLICATION	02/12/20	SMC

NO.	REVISION DESCRIPTION	DATE	BY
3	REVISED PER COMMENTS	09/08/21	SMC
2	REVISED PER COMMENTS	28/05/21	SMC
1	ISSUED FOR SITE PLAN APPLICATION	02/12/20	SMC

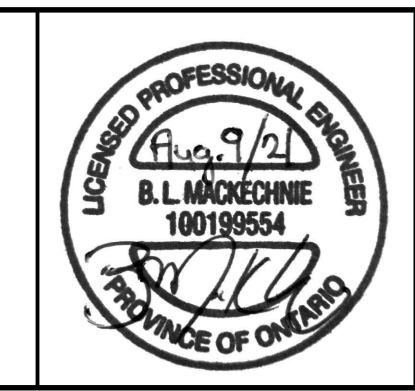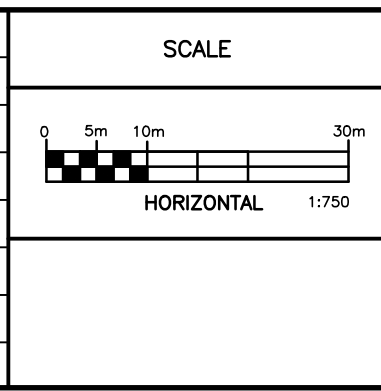

Robinson
Land Development

350 Palladium Drive
Ottawa, ON K2V 1A8
(613) 592-6060 rcii.com

DESIGN	BLM
CHECKED	SMC
DRAWN	BLM
CHECKED	SMC
APPROVED	SMC

MARITIME-ONTARIO
FREIGHT LINES LIMITED

KANATA WEST BUSINESS PARK
8800 CAMPEAU DRIVE, OTTAWA, ON

STORM DRAINAGE AREA PLAN

PROJECT No.	20027
SURVEY	STANTEC
DATED	AUGUST 2021
DWG. No.	20027-STM1

FLOW CONTROL ROOF DRAINAGE DECLARATION

THIS FORM TO BE COMPLETED BY THE MECHANICAL AND STRUCTURAL ENGINEERS RESPONSIBLE FOR DESIGN

Permit Application No.
D07-12-20-0189

Project Name: Maritime Ontario

Building Location: 8800 Campeau Drive

Municipality: Ottawa

The roof drainage system has been designed in accordance with the following criteria: (please check one of the following).

M1. Conventionally drained roof (no flow control roof drains used).

M2. Flow control roof drains meeting the following conditions have been incorporated in this design:

- (a) the maximum drain down time does not exceed 24h,
- (b) one or more scuppers are installed so that the maximum depth of water on the roof cannot exceed 150mm,
- (c) drains are located not more than 15m from the edge of roof and not more than 30m from adjacent drains, and
- (d) there is at least one drain for each 900 sq.m.

M3. A flow control drainage system that does not meet the minimum drainage criteria described in M2 has been incorporated in this design.

PROFESSIONAL SEAL APPLIED BY:

Practitioner's Name: Andrew Lawton

Firm: McKee Engineering

Phone#: 613-723-9585

City: Ottawa Province: Ontario



Mechanical Engineer's Seal

S1. The design parameters incorporated into the overall structural design are consistent with the information provided by the Mechanical Engineer in M2. Loads due to rain are not considered to act simultaneously with loads due to snow as per Sentence 4.1.7.3 (3) OBC.

S2. The structure has been designed incorporating the additional structural loading due to rain acting simultaneously with the snow load. The design parameters are consistent with the control flow drainage system designed by the mechanical engineer.

S3. The structure has not been designed for flow control roof drains, consistent with the information provided in M1 above.

PROFESSIONAL SEAL APPLIED BY:

Practitioner's Name: Colin Davies, P.Eng.

Firm: Cleland Jardine Engineering Ltd.

Phone#: 613-591-1533

City: Ottawa Province: Ontario



Structural Engineer's Seal

Brandon Mackechnie

Subject: FW: 19-247 - M-O - Kanata North Business Park - Weeping Tile Pumps(MK 20071)

From: Andrew Lawton <andrew.lawton@mckeeottawa.ca>

Sent: May 19, 2021 8:46 AM

To: Sean Czaharynski <sczaharynski@rcii.com>

Cc: Jill Sparling <Sparling@mcrobie.com>

Subject: RE: 19-247 - M-O - Kanata North Business Park - Weeping Tile Pumps(MK 20071)

"CAUTION: External Sender"

Hi Sean,

For the Cross Dock: 37.6 l/s

For the Office: 19.5 l/s

Andrew Lawton, P.Eng.

President

Andrew.Lawton@mckeeottawa.ca

1785 Woodward Drive

Ottawa, ON K2C 0P9

Tel: (613) 723-9585 Ext 105

Fax: (613) 723-9584

www.mckeeottawa.ca



From: Sean Czaharynski <sczaharynski@rcii.com>

Sent: May 19, 2021 7:45 AM

To: Andrew Lawton <andrew.lawton@mckeeottawa.ca>

Cc: Jill Sparling <Sparling@mcrobie.com>

Subject: RE: 19-247 - M-O - Kanata North Business Park - Weeping Tile Pumps(MK 20071)

Morning Andrew

Can you tell me what your design flowrate from the uncontrolled roof drains are?

I want to include that in our storm drainage section of our design report.

Thanks,



Sean Czaharynski, P.Eng. | Manager - Land Development

Robinson

350 Palladium Drive, Suite 210, Ottawa ON, K2V 1A8


Land Development T.(613) 592-6060 ext. 152 | rcii.com

This e-mail is intended solely for the individual or company to whom it is addressed. The information contained herein is confidential. Any dissemination, distribution or copying of this e-mail, other than by its intended recipient, is strictly prohibited. If you have received this e-mail in error, please notify the sender immediately, and delete this e-mail from your records. Thank you.

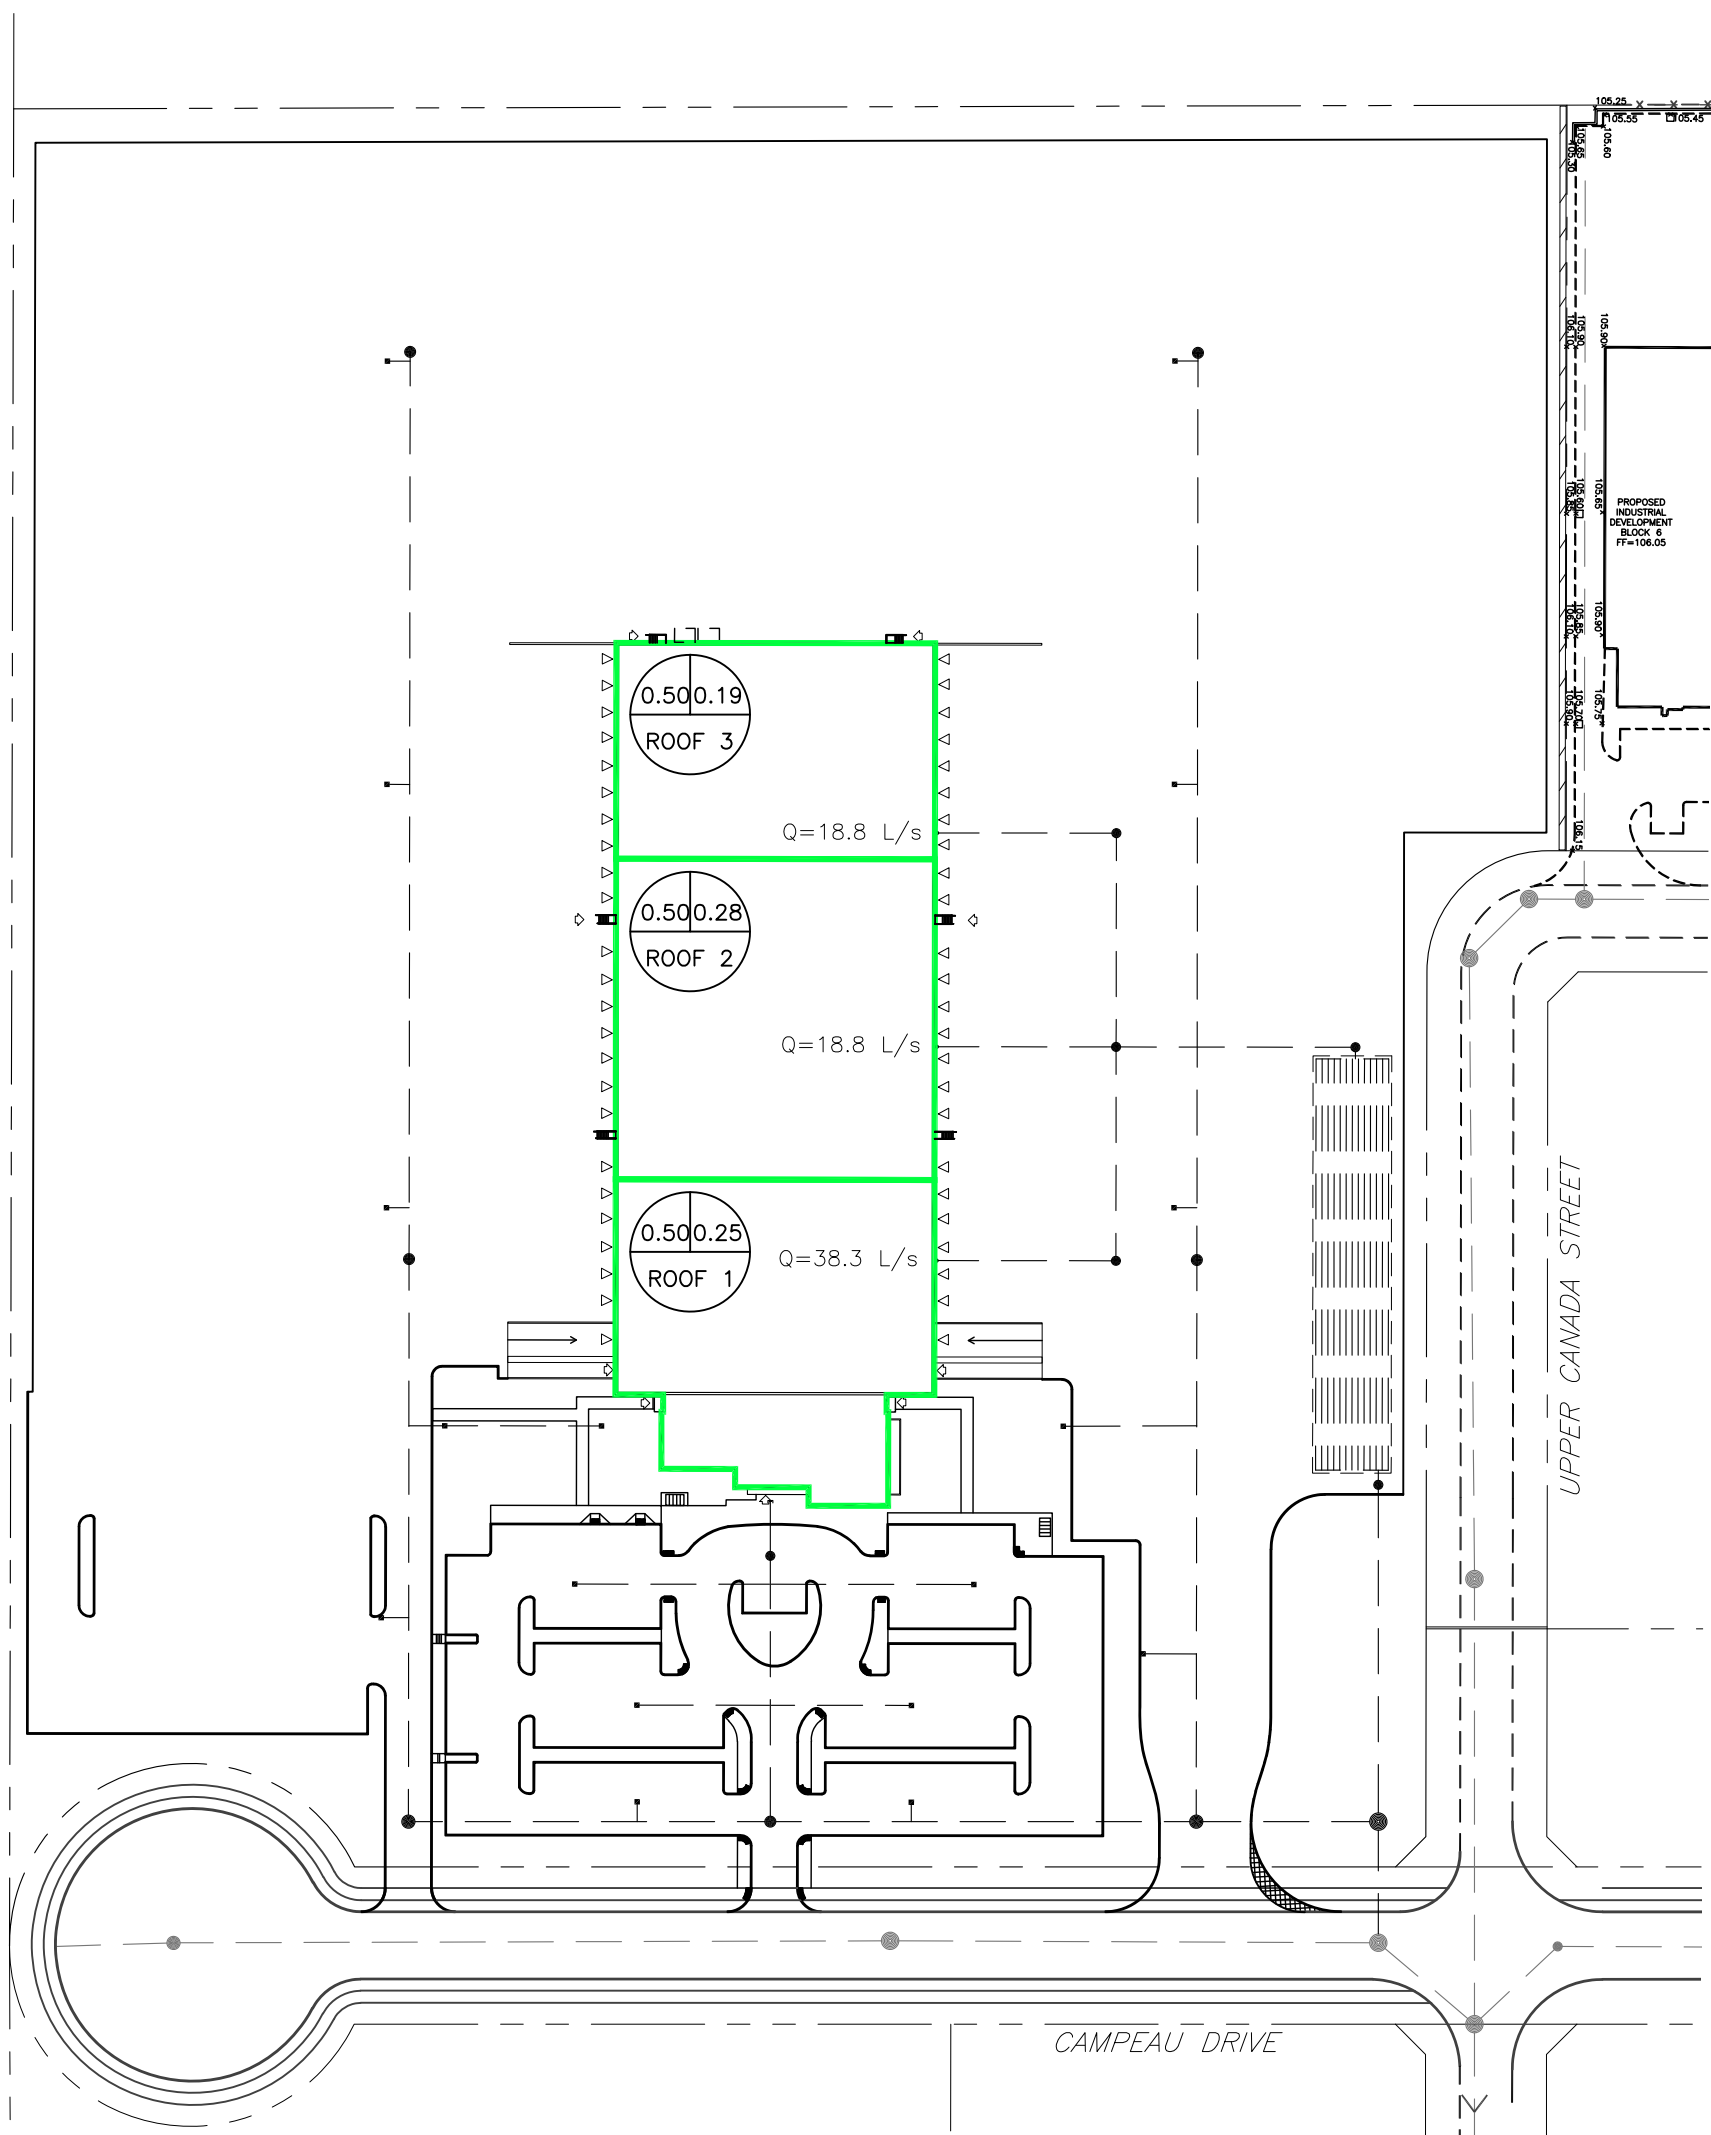

LEGEND

- PROPERTY BOUNDARY
- ROOF DRAINAGE AREA BOUNDARY

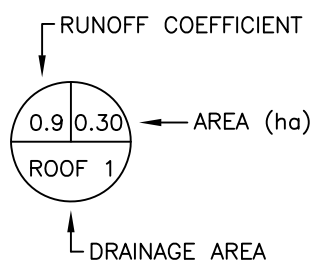

Robinson

Land Development

scale
N.T.S.
date
27/05/21
drawn by
BLM

MARITIME-ONTARIO, KWBP
ROOF DRAINAGE AREA PLAN

project no.
20027
FIG 3

STORM SEWER DESIGN SHEET - INFILTRATION GALLERY
for
MARITIME-ONTARIO, CAMPEAU DRIVE, KWBP

LOCATION				AREA (ha)		INDIV. 2.78AR	ACCUM. 2.78AR	TIME OF CONC. (min)	5 YR RAINFALL INTENSITY* ¹ (mm/hr)	5 YR PEAK FLOW* ² (L/s)	FIXED FLOW* ⁴ (L/s)	PROPOSED SEWER						
DRAINAGE AREA	STREET NAME	FROM MH	TO MH	TOTAL AREA	C							PIPE DIA. (mm)	GRADE (%)	LENGTH (m)	CAPACITY (L/s)	FULL FLOW VELOCITY* ³ (m/s)	TIME OF FLOW (min)	PERCENT FULL
ROOF1	PARKING LOT	RD1	300	0.25	0.90	0.63	0.63	10.00	104.19	65.17	38.30	299.4	1.01	29.6	96.73	1.37	0.36	40%
	PARKING LOT	300	302	0.00	0.00	0.00	0.63	10.36	102.33	64.01	38.30	299.4	0.51	35.4	68.74	0.98	0.60	56%
ROOF2	PARKING LOT	RD2	302	0.28	0.90	0.70	0.70	10.00	104.19	72.99	18.80	299.4	1.82	29.6	129.85	1.84	0.27	14%
ROOF3	PARKING LOT	RD3	301	0.19	0.90	0.48	0.48	10.00	104.19	49.53	18.80	299.4	1.01	29.6	96.73	1.37	0.36	19%
	PARKING LOT	301	302	0.00	0.00	0.00	0.48	10.36	102.33	48.65	18.80	299.4	0.51	35.4	68.74	0.98	0.60	27%
	PARKING LOT	302	303	0.00	0.00	0.00	1.80	10.96	99.37	179.00	75.90	366.4	0.30	39.6	90.38	0.86	0.77	84%
	PARKING LOT	303	HEADER	INFILTRATION GALLERY														
	PARKING LOT	HEADER	304															
	PARKING LOT	304	200	0.00	0.00	0.00	1.80	11.73	95.85	172.67	75.90	366.4	0.48	55.7	114.32	1.08	0.86	66%
	<i>BYPASS PIPE</i>	303	304	0.00	0.00	0.00	1.80	11.73	95.85	172.67	75.90	366.4	0.47	72.5	113.12	1.07	1.13	67%

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations. $I = 998.071 / (T + 6.053)^{0.814}$ (T= time in minutes)
2. Peak Flow = Accumulated 2.78AR x Rainfall Intensity
3. Full Flow Velocity: MIN. = 0.80 m/s; MAX. = 3.0 m/s (City of Ottawa Sewer Design Guidelines, v.2012)
4. Fixed flow corresponds to roof flows provided by Mechanical Engineer. Refer to Appendix F.

Runoff Coefficient Calculations

Development Condition	Impervious Area (ha)	Pervious Area (ha)	Gravel Area (ha)	Total Area (ha)	C	C (100 YR)	Percent Impervious (%)
PRE	0.00	6.96	0.08	7.04	0.21	0.26	1.2
POST	6.19	0.85	0.00	7.04	0.82	1.00	87.9

Sub-Drainage Area Runoff Coefficient Calculations

Drainage Area ID	Impervious Area (ha)	Pervious Area (ha)	Gravel Area (ha)	Total Area (ha)	C	C (100 YR)	Percent Impervious (%)
STM1	0.90	0.00	0.00	0.90	0.90	1.00	100.0
STM2	0.63	0.00	0.00	0.63	0.90	1.00	100.0
STM3	0.67	0.00	0.00	0.67	0.90	1.00	100.0
STM4	0.39	0.05	0.00	0.44	0.82	1.00	89.1
STM5	0.95	0.01	0.00	0.96	0.89	1.00	98.5
STM6	0.61	0.01	0.00	0.62	0.89	1.00	98.4
STM7	0.54	0.00	0.00	0.54	0.90	1.00	100.0
STM8	0.22	0.10	0.00	0.32	0.68	0.85	69.1
STM9	0.09	0.01	0.00	0.10	0.85	1.00	92.6
STM10	0.10	0.02	0.00	0.11	0.79	0.99	85.0
STM11	0.08	0.03	0.00	0.12	0.70	0.88	71.5
STM12	0.08	0.00	0.00	0.08	0.89	1.00	99.1
STM13	0.10	0.02	0.00	0.11	0.79	0.99	84.8
STM14	0.08	0.01	0.00	0.10	0.81	1.00	87.0
STM15	0.00	0.05	0.00	0.05	0.25	0.31	7.3
STM16	0.00	0.02	0.00	0.02	0.28	0.34	10.8
STM17	0.01	0.06	0.00	0.07	0.27	0.34	9.8
STM18 (ROOF 1)	0.06	0.00	0.00	0.06	0.90	1.00	100.0
STM19 (ROOF 2)	0.66	0.00	0.00	0.66	0.90	1.00	100.0
FF1 (CAMPEAU)	0.03	0.07	0.00	0.10	0.38	0.47	25.7
FF2 (UPPER CANADA)	0.00	0.13	0.00	0.13	0.20	0.25	0.0
FF3 (NORTH)	0.00	0.14	0.00	0.14	0.20	0.25	0.0
FF4 (WEST)	0.00	0.12	0.00	0.12	0.20	0.25	0.0

Runoff Coefficients:

C impervious = 0.90

C pervious = 0.20

C gravel = 0.80

$C_{100} = C * 1.25$ (Max. 1.0)

Free Flow Calculations - FF1 (CAMPEAU)

Given:
 Area (ha) = 0.10
 C = 0.38
 C (100 YR) = 0.47

Design Event	Time (min)	Rainfall Intensity (mm/hr)	Flow (L/s)
5 Year	5	141.2	14.7
	10	104.2	10.8
	15	83.6	8.7
	20	70.3	7.3
	25	60.9	6.3
	30	53.9	5.6
100 Year	5	242.7	31.5
	10	178.6	23.2
	15	142.9	18.6
	20	120.0	15.6
	25	103.8	13.5
	30	91.9	11.9

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Flow calculated using the Rational Method. $Q=2.78CiA$
3. $C (100 YR) = C + 25\%$ (Max. 1.0)

Free Flow Calculations - FF2 (UPPER CANADA)

Given:
 Area (ha) = 0.13
 C = 0.20
 C (100 YR) = 0.25

Design Event	Time (min)	Rainfall Intensity (mm/hr)	Flow (L/s)
5 Year	5	141.2	10.3
	10	104.2	7.6
	15	83.6	6.1
	20	70.3	5.1
	25	60.9	4.5
	30	53.9	4.0
100 Year	5	242.7	22.2
	10	178.6	16.4
	15	142.9	13.1
	20	120.0	11.0
	25	103.8	9.5
	30	91.9	8.4

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Flow calculated using the Rational Method. $Q=2.78CiA$
3. $C (100 YR) = C + 25\%$ (Max. 1.0)

Free Flow Calculations - FF4 (WEST)

Given:
 Area (ha) = 0.12
 C = 0.20
 C (100 YR) = 0.25

Design Event	Time (min)	Rainfall Intensity (mm/hr)	Flow (L/s)
5 Year	5	141.2	9.3
	10	104.2	6.8
	15	83.6	5.5
	20	70.3	4.6
	25	60.9	4.0
	30	53.9	3.5
100 Year	5	242.7	19.9
	10	178.6	14.7
	15	142.9	11.7
	20	120.0	9.9
	25	103.8	9.5
	30	91.9	7.5

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Flow calculated using the Rational Method. $Q=2.78CiA$
3. $C (100 YR) = C + 25\%$ (Max. 1.0)

Free Flow Calculations - FF3 (NORTH)

Given:
 Area (ha) = 0.14
 C = 0.20
 C (100 YR) = 0.25

Design Event	Time (min)	Rainfall Intensity (mm/hr)	Flow (L/s)
5 Year	5	141.2	11.2
	10	104.2	8.3
	15	83.6	6.6
	20	70.3	5.6
	25	60.9	4.8
	30	53.9	4.3
100 Year	5	242.7	24.1
	10	178.6	17.7
	15	142.9	14.2
	20	120.0	11.9
	25	103.8	9.5
	30	91.9	9.1

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Flow calculated using the Rational Method. $Q=2.78CiA$
3. $C (100 YR) = C + 25\%$ (Max. 1.0)

Free Flow Calculations - STM18 (ROOF 1)

Given:

Area (ha) = 0.06
 C = 0.90
 C (100 YR) = 1.00

Design Event	Time (min)	Rainfall Intensity (mm/hr)	Flow (L/s)
5 Year	5	141.2	20.1
	10	104.2	14.8
	15	83.6	11.9
	20	70.3	10.0
	25	60.9	8.7
	30	53.9	7.7
100 Year	5	242.7	38.4
	10	178.6	28.2
	15	142.9	22.6
	20	120.0	19.0
	25	103.8	16.4
	30	91.9	14.5

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Flow calculated using the Rational Method. $Q=2.78CiA$
3. $C (100 YR) = C + 25\%$ (Max. 1.0)

Free Flow Calculations - STM19 (ROOF 2)

Given:

Area (ha) = 0.66
 C = 0.90
 C (100 YR) = 1.00

Design Event	Time (min)	Rainfall Intensity (mm/hr)	Flow (L/s)
5 Year	5	141.2	231.5
	10	104.2	170.8
	15	83.6	137.0
	20	70.3	115.2
	25	60.9	99.9
	30	53.9	88.4
100 Year	5	242.7	442.2
	10	178.6	325.3
	15	142.9	260.3
	20	120.0	218.5
	25	103.8	189.2
	30	91.9	167.4

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Flow calculated using the Rational Method. $Q=2.78CiA$
3. $C (100 YR) = C + 25\%$ (Max. 1.0)

Inlet Control Device Calculations

Structure	Drainage Area	Outlet Pipe Inv. Elev. (m)	Outlet Pipe Diam. (m)	C/L Orifice Elev. (m)	T/G Elev. (m)	Max. Ponding Depth (m)	Max. Ponding Elev. (m)	Max. Head (m)	100 Yr. Ponding Depth (m)	100 Yr. Ponding Elev. (m)	100 Yr. Head (m)	100 Yr. Outflow (L/s)	Orifice Area (m ²)	Orifice Diameter (mm)	Orifice Type
CB 1	STM1	104.74	0.375	104.93	106.42	0.30	106.72	1.79	0.29	106.71	1.78	120.0	0.033	204.1	Circular, slide
CB 2	STM2	104.64	0.375	104.83	106.32	0.30	106.62	1.79	"100 Year El. = Maximum El."			60.0	0.016	144.1	Circular, slide
CB 3	STM3	104.54	0.375	104.73	106.22	0.30	106.52	1.79	"100 Year El. = Maximum El."			80.0	0.022	166.4	Circular, slide
CB 4	STM4	104.47	0.300	104.62	106.15	0.30	106.45	1.83	0.28	106.43	1.81	60.0	0.016	143.8	Circular, slide
CB 5	STM5	104.74	0.375	104.93	106.42	0.30	106.72	1.79	0.29	106.71	1.78	120.0	0.033	204.1	Circular, slide
CB 6	STM6	104.64	0.375	104.83	106.32	0.30	106.62	1.79	0.28	106.60	1.77	60.0	0.016	144.5	Circular, slide
CB 7	STM7	104.54	0.300	104.69	106.22	0.30	106.52	1.83	"100 Year El. = Maximum El."			30.0	0.008	101.4	Circular, slide
CB 8	STM8	104.27	0.250	104.40	105.95	0.27	106.22	1.83	"100 Year El. = Maximum El."			25.0	0.007	92.6	Circular, slide
CB 9	STM9	105.42	0.250	105.55	107.10	0.10	107.20	1.66	"100 Year El. = Maximum El."			55.0	0.016	140.8	Circular, slide
CB 10	STM10	105.13	0.250	105.26	106.64	0.19	106.83	1.58	"100 Year El. = Maximum El."			30.0	0.009	105.3	Circular, slide
CB 11	STM11	104.38	0.250	104.51	106.06	0.30	106.36	1.86	0.18	106.24	1.74	25.0	0.007	93.8	Circular, slide
CB 12	STM12	105.42	0.250	105.55	107.10	0.10	107.20	1.66	"100 Year El. = Maximum El."			40.0	0.011	120.1	Circular, slide
CB 13	STM13	104.96	0.250	105.09	106.64	0.19	106.83	1.75	"100 Year El. = Maximum El."			30.0	0.008	102.6	Circular, slide
CB 14	STM14	104.38	0.250	104.51	106.06	0.30	106.36	1.86	0.18	106.24	1.74	25.0	0.007	93.8	Circular, slide
DICB 15	STM15	104.67	0.250	104.80	106.42	0.30	106.72	1.93	0.00	106.42	1.63	20.0	0.006	85.3	Circular, slide
DICB 17	STM16	104.75	0.250	104.88	106.50	0.30	106.80	1.93	0.00	106.50	1.63	20.0	0.006	85.3	Circular, slide
Total =												800.0			

Notes:

1. Maximum ponding depth is measured from the maximum ponding elevation to the T/G elevation; 100 year ponding depth is measured from the 100 year ponding elevation to the T/G elevation.
2. Maximum head is measured from the maximum ponding elevation to the centreline of orifice elevation; 100 year head is measured from the 100 year ponding elevation to the centreline of orifice elevation.
3. Orifice Area = $(Q/1000) / 0.62(2*9.81*H_{100})^{0.5}$
4. Orifice area calculated using 100 year head values.

HYDRAULIC GRADE LINE COMPUTATION FORM

From Manhole	To Manhole	U/S Invert	D/S Invert	U/S Obvert	D/S Obvert	Slope	TW	Diameter D _o	Area	Hydraulic Radius	5 Year Peak Flow Q _o	Length L _o	Velocity V _o	Velocity Head V _o ² /2g	Friction Slope Sf _o	Friction Loss H _f	Angle of Deflection at U/S MH	Hydraulic Loss at MH*1	EGL _o	EGL _i	HGL _o	HGL _i	Ground Elev.	Surcharge Depth	Free Board
		m	m	m	m	m/m	m	m	m ²	m	m ³ /s	m	m/s	m	m/m	m	degrees	m	m	m	m	m	m	m	
EX101	200	101.98	101.86	102.89	102.77	0.0060	103.57	0.914	0.66	0.23	1.3370	20.0	2.04	0.21	0.0050	0.100	50	0.0974	103.78	103.98	103.57	103.77	105.93	0.87	2.16
200	205	102.19	102.04	103.10	102.95	0.0050	103.77	0.914	0.66	0.23	1.2087	30.1	1.84	0.17	0.0041	0.124	90	0.2284	103.94	104.29	103.77	104.12	106.10	1.02	1.98
205	201	102.64	102.34	103.40	103.10	0.0043	104.12	0.762	0.46	0.19	0.7178	70.4	1.57	0.13	0.0038	0.269	0	0.0025	104.25	104.52	104.12	104.39	106.21	0.99	1.82
201	202	102.90	102.67	103.66	103.43	0.0038	104.39	0.762	0.46	0.19	0.6201	59.9	1.36	0.09	0.0029	0.171	0	0.0019	104.49	104.66	104.39	104.56	106.37	0.90	1.81
202	203	103.29	102.96	104.05	103.72	0.0035	104.56	0.762	0.46	0.19	0.6275	93.0	1.38	0.10	0.0029	0.272	90	0.1274	104.66	105.06	104.56	104.96	106.43	0.91	1.47
203	204	103.76	103.32	104.52	104.08	0.0029	104.96	0.762	0.46	0.19	0.5731	150.0	1.26	0.08	0.0024	0.365	0	0.0016	105.04	105.41	104.96	105.33	106.34	0.81	1.01
EX101	200	101.98	101.86	102.89	102.77	0.0060	103.57	0.914	0.66	0.23	1.344	20.0	2.05	0.21	0.0051	0.101	50	0.0984	103.78	103.98	103.57	103.77	105.93	0.88	2.16
200	205	102.19	102.04	103.10	102.95	0.0050	103.77	0.914	0.66	0.23	1.216	30.1	1.85	0.18	0.0042	0.125	90	0.2310	103.94	104.30	103.77	104.13	106.10	1.02	1.97
205	201	102.64	102.34	103.40	103.10	0.0045	104.13	0.762	0.46	0.19	0.720	70.8	1.58	0.13	0.0038	0.272	0	0.0025	104.25	104.53	104.13	104.40	106.21	0.98	1.81
201	208	104.98	103.24	105.28	103.54	4.1900	104.40	0.299	0.07	0.07	0.109	43.9	1.55	0.12	0.0129	0.566	90	0.1618	104.52	105.25	104.40	105.13	106.37	-0.15	1.24
208	BLDG	105.50	105.04	105.75	105.29	4.0200	105.13	0.252	0.05	0.06	0.015	9.2	0.30	0.00	0.0006	0.006	30	0.0010	105.13	105.14	105.13	105.13	107.85	-0.62	2.72
EX101	200	101.98	101.86	102.89	102.77	0.0060	103.57	0.914	0.66	0.23	1.344	20.0	2.05	0.21	0.0051	0.101	50	0.0984	103.78	103.98	103.57	103.77	105.93	0.88	2.16
200	205	102.19	102.04	103.10	102.95	0.0050	103.77	0.914	0.66	0.23	1.216	30.1	1.85	0.18	0.0042	0.125	90	0.2310	103.94	104.30	103.77	104.13	106.10	1.02	1.97
205	206	102.93	102.42	103.62	103.11	0.0055	104.13	0.686	0.37	0.17	0.575	92.9	1.56	0.12	0.0043	0.399	90	0.1631	104.25	104.81	104.13	104.69	106.21	1.07	1.52
206	207	103.78	102.96	104.47	103.65	0.0055	104.69	0.686	0.37	0.17	0.549	150.0	1.48	0.11	0.0039	0.586	0	0.0022	104.80	105.39	104.69	105.28	106.33	0.81	1.05
EX101	200	101.98	101.86	102.89	102.77	0.0060	103.57	0.914	0.66	0.23	1.347	20.0	2.05	0.21	0.0051	0.102	50	0.0989	103.78	103.99	103.57	103.77	105.93	0.88	2.16
200	304	HGL is contained within storm sewer																							
Notes: 1. From "Sewer Bend Loss Coefficient Design Chart", Appendix 6-B, City of Ottawa Sewer Design Guidelines, 2004												Designed: BLM					Project: Maritime-Ontario Distribution Warehouse								
												Checked:					Location: 8800 Campeau Drive, KWBP, Ottawa, ON								
												Dwg. Reference:					Project No.: 20027			Date: 27-May-21			Page 1 of 1		

From "Sewer Bend Loss Coefficient Design Chart", Appendix 6-B, City of Ottawa Sewer Design Guidelines, 2004

Deflection Angle	Bend Loss Coefficient
0	0.02
30	0.22
50	0.46
90	1.32