

CONNECT TO EXISTING 300mmØ PVC COMBINED SEWER WITH INSERTA-TEE FROM ABOVE WITH (2) 22.5° VERTICAL BENDS PER CITY OF OTTAWA STANDARD DETAIL S11.1. EXCAVATION, BACKFILL AND REINSTATEMENT BY CONTRACTOR. PROPOSED 200mmØ SANITARY SERVICE INVERT=68.95m± AT CONNECTION. EXISTING 300mmØ INVERT=68.80m±. EXISTING 300mmØ SPRINGLINE=68.95m±. SANITARY SERVICE TO CROSS ABOVE THE EXISTING 150mmØ WATERMAIN. MINIMUM CLEARANCE BETWEEN OUTSIDE OF PIPES AT CROSSING=0.5m±. TOP OF EX. 150mmØ WATERMAIN AT CROSSING=69.40±. SANITARY SERVICE INVERT AT WATERMAIN CROSSING=69.90m±.

CONNECT TO EXISTING 150mmØ PVC WATERMAIN WITH NEW 150mmØ PVC WATER SERVICE BY CITY FORCES. CONTRACTOR TO DETERMINE EXACT LOCATION AND ELEVATION OF WATERMAIN IN FIELD. EXCAVATION, BACKFILL AND REINSTATEMENT BY CONTRACTOR.

CONNECT TO EXISTING 200mmØ PVC WATERMAIN WITH NEW 150mmØ PVC WATER SERVICE BY CITY FORCES. CONTRACTOR TO DETERMINE EXACT LOCATION AND ELEVATION OF WATERMAIN IN FIELD. EXCAVATION, BACKFILL AND REINSTATEMENT BY CONTRACTOR.

MAINTAIN AND PROTECT ALL EXISTING MUNICIPAL INFRASTRUCTURE WITHIN THE R.O.W. DURING ALL PHASES OF CONSTRUCTION

APPROXIMATE LIMITS OF INTERNAL SWM TANK. MINIMUM ACTIVE STORAGE VOLUME > 67m³. REFER TO ARCH/MECH. PLANS FOR DETAILS.

THE WESTERN PORTION OF THE SITE IS TO REMAIN, INCLUDING THE EXISTING BUILDING. EXISTING SERVICE LATERALS WILL CONTINUE TO DRAIN TO THE COMBINED SEWER IN LOUISA STREET.

EXISTING UTILITIES TO BE RE-USED OR RE-ROUTED ON-SITE PER THE MECHANICAL/ELECTRICAL PLANS. CONTRACTOR TO PROVIDE LOCATES FOR ALL EXISTING UTILITIES IN THE EXISTING PARKING LOT.

PROVIDE INTERNAL TEST PORT ON SANITARY SERVICE. REFER TO MECHANICAL PLANS FOR DETAILS.

ALL EXTERIOR DECK DRAINS AND UNCONTROLLED ROOF DRAINS ARE TO BE CONVEYED TO THE INTERNAL SWM STORAGE TANK SYSTEM. REFER TO MECHANICAL AND ELECTRICAL PLANS FOR PUMP AND BACKUP POWER DETAILS.

FLOW FROM WEEPING TILE AND/OR UNDERSLAB DRAINAGE SYSTEMS TO BE PUMPED SEPARATELY TO THE BUILDING SERVICE. BY-PASSING THE INTERNAL SWM STORAGE SYSTEM. REFER TO MECHANICAL PLANS FOR DETAILS.

ALL INTERNAL BUILDING FLOOR DRAINS ARE TO BE CONVEYED TO THE BUILDING SANITARY SERVICE. REFER TO MECHANICAL PLANS FOR DETAILS.

NOTE: THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

OWNER INFORMATION  
IRONWOOD FUND LIMITED PARTNERSHIP  
SUITE 370, 18 LOUISA STREET  
OTTAWA, ONTARIO, K1R 6Y6

No.	REVISION	DATE	BY
1	ISSUED FOR SITE PLAN APPROVAL	MAY 28/21	FST

### INTERNAL SWM STORAGE SYSTEM

DESIGN EVENT	STORAGE SYSTEM CONTROLLED FLOW	STORAGE VOLUMES REQUIRED	PROVIDED
1:2 YR	5.0 L/s	18.0 m³	> 67 m³
1:5 YR	5.0 L/s	27.8 m³	
1:100 YR	5.0 L/s	66.2 m³	
1:100+20%	5.0 L/s	84.1 m³	

NOTES:

- ALL DRAINAGE FROM AREA A-2 (PROPOSED COURTYARD DECK DRAINS AND ALL ROOF + PATIO DRAINS) TO BE DIRECTED TO THE INTERNAL STORMWATER STORAGE SYSTEM. REFER TO ARCHITECTURAL AND MECHANICAL PLANS FOR DETAILS.
- REFER TO ARCHITECTURAL AND STRUCTURAL PLANS FOR EXACT SIZE AND DETAILS OF INTERNAL STORMWATER STORAGE SYSTEM.
- REFER TO MECHANICAL PLANS FOR PUMP INFORMATION AND DETAILS OF THE INTERNAL STORMWATER STORAGE SYSTEM.

### LEGEND:

- RD ○ PROPOSED CONTROLLED FLOW ROOF DRAIN
- PROPOSED WATER METER AND REMOTE METER
- DC PROPOSED DEPRESSED CURB
- ▽ PROPOSED BUILDING ENTRANCE
- ▽ PROPOSED WATER SERVICE
- ▽ PROPOSED STORM SERVICE
- ▽ PROPOSED VALVE AND VALVE BOX
- ▽ PROPOSED THERMAL INSULATION
- FFE FINISHED FLOOR ELEVATION
- T/FND TOP OF FOUNDATION WALL ELEVATION
- USF UNDERSIDE OF FOOTING ELEVATION
- X REMOVAL AND/OR ABANDONMENT
- WATERMAIN CAP
- PROPOSED FENCE AND GATE
- PROPOSED TEST PORT
- PROPOSED WATER SERVICE
- PROPOSED SANITARY SERVICE
- PROPOSED STORM SERVICE
- CBMH LID FOR SWM TANK OVERFLOW
- PROPOSED SIAMESE CONNECTION

### GENERAL NOTES:

- COORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
- DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT AND ASSUME RESPONSIBILITY FOR ALL EXISTING UTILITIES WHETHER OR NOT SHOWN ON THIS DRAWING.
- OBTAIN ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA BEFORE COMMENCING CONSTRUCTION.
- BEFORE COMMENCING CONSTRUCTION OBTAIN AND PROVIDE PROOF OF COMPREHENSIVE, ALL RISK AND OPERATIONAL LIABILITY INSURANCE FOR \$5,000,000.00. INSURANCE POLICY TO NAME OWNERS, ENGINEERS AND ARCHITECTS AS CO-INSURED.
- COMPLETE ALL WORKS IN ACCORDANCE WITH THE MOST CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS USING THE CURRENT GUIDELINES, BYLAWS AND STANDARDS INCLUDING MATERIALS OF CONSTRUCTION, DISINFECTION AND ALL RELEVANT REFERENCES TO OPSS, OPSD & AWWA GUIDELINES - ALL CURRENT VERSIONS AND AS AMENDED.
- RESTORE ALL DISTURBED AREAS ON-SITE AND OFF-SITE, INCLUDING TRENCHES AND SURFACES ON PUBLIC ROAD ALLOWANCES TO EXISTING CONDITIONS OR BETTER TO THE SATISFACTION OF MUNICIPAL AUTHORITIES.
- REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL, ORGANIC MATERIAL AND DEBRIS UNLESS OTHERWISE INSTRUCTED BY ENGINEER. EXCAVATE AND REMOVE FROM SITE ANY CONTAMINATED MATERIAL. ALL CONTAMINATED MATERIAL SHALL BE DISPOSED OF AT A LICENSED LANDFILL FACILITY.
- ALL ELEVATIONS ARE GEODETIC.
- REFER TO GEOTECHNICAL INVESTIGATION REPORT (PATTERSON REPORT NUMBER PG5405-1), DATED JANUARY 19, 2021, PREPARED BY PATTERSON GROUP, FOR SUBSURFACE CONDITIONS, CONSTRUCTION RECOMMENDATIONS AND GEOTECHNICAL REQUIREMENTS. THE GEOTECHNICAL CONSULTANT IS TO REVIEW ON-SITE CONDITIONS AFTER EXCAVATION PRIOR TO PLACEMENT OF THE GRANULAR MATERIAL.
- REFER TO MECHANICAL PLAN FOR UN-CONTROLLED ROOF DRAIN INFORMATION.
- REFER TO ARCHITECT'S AND LANDSCAPE ARCHITECT'S DRAWINGS FOR BUILDING AND HARD SURFACED AREAS AND DIMENSIONS.
- REFER TO THE 'DEVELOPMENT SERVICING STUDY' AND 'STORMWATER MANAGEMENT REPORT' (R-2020-130) PREPARED BY NOVATECH.
- SAW CUT AND KEYGRIND ASPHALT AT ALL ROAD CUTS AND ASPHALT TIE-IN POINTS AS PER CITY OF OTTAWA STANDARDS (R10).

### SEWER NOTES:

- SUPPLY AND CONSTRUCT ALL SEWERS AND APPURTENANCES IN ACCORDANCE WITH THE MOST CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS - ALL CURRENT VERSIONS AND AS AMENDED.
- SPECIFICATIONS:
 

ITEM	SPEC. No.	REFERENCE
CBMH FRAME AND COVER	401.010 - TYPE 'B'	OPSD
STORM SERVICE	PVC DR 35	
SANITARY SERVICE	PVC DR 35	
SEWER TRENCH	BEDDING (GRANULAR 'A')	
	COVER (GRANULAR 'B' OR GRANULAR 'B' TYPE I WITH MAXIMUM PARTICLE SIZE=25mm)	
- THE SANITARY SERVICE LATERAL SHALL BE EQUIPPED WITH A BACKFLOW PREVENTER WITHIN THE BUILDING FOOTPRINT AS PER CITY OF OTTAWA STANDARD DETAILS S14.1 OR S14.2. REFER TO MECHANICAL PLANS FOR DETAILS.
- THE STORM SERVICE LATERAL SHALL BE EQUIPPED WITH A BACKFLOW PREVENTER WITHIN THE BUILDING FOOTPRINT AS PER CITY OF OTTAWA STANDARD DETAILS S14. REFER TO MECHANICAL PLANS FOR DETAILS.
- PIPE BEDDING, COVER AND BACKFILL ARE TO BE COMPACTED TO AT LEAST 95% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY. THE USE OF CLEAR CRUSHED STONE AS A BEDDING LAYER SHALL NOT BE PERMITTED.
- INSULATE ALL SEWER PIPES THAT HAVE LESS THAN 1.5m COVER WITH UP TO 125mm THICK HI-40 RIGID INSULATION.
- CONTRACTOR TO PROVIDE THE CONSULTANT WITH A GENERAL PLAN OF SERVICES INDICATING ALL APPLICABLE SERVICING AS-BUILT INFORMATION SHOWN ON THIS PLAN. AS-BUILT INFORMATION MUST INCLUDE: PIPE MATERIAL, SIZES, LENGTHS, SLOPES, INVERT AND T&G ELEVATIONS, STRUCTURE LOCATIONS AND ANY ALIGNMENT CHANGES, ETC.
- THE OWNER SHALL REQUIRE THAT THE SITE SERVICING CONTRACTOR PERFORM FIELD TESTS FOR QUALITY CONTROL OF ALL SANITARY SEWERS. LEAKAGE TESTING SHALL BE COMPLETED IN ACCORDANCE WITH OPSS 410.07.16, 410.07.16.04 AND 407.07.24. DYE TESTING IS TO BE COMPLETED ON ALL SANITARY SERVICES TO CONFIRM PROPER CONNECTION TO THE SANITARY SEWER MAIN. THE FIELD TESTS SHALL BE PERFORMED IN THE PRESENCE OF A CERTIFIED PROFESSIONAL ENGINEER WHO SHALL SUBMIT A CERTIFIED COPY OF THE TEST RESULTS.

### WATERMAIN NOTES:

- SUPPLY AND CONSTRUCT ALL WATERMAIN AND APPURTENANCES IN ACCORDANCE WITH THE MOST CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS - ALL CURRENT VERSIONS AND AS AMENDED.
- SPECIFICATIONS:
 

ITEM	SPEC. No.	REFERENCE
WATERMAIN TRENCHING	W17	CITY OF OTTAWA
THERMAL INSULATION IN SHALLOW TRENCHES	W22	CITY OF OTTAWA
THERMAL INSULATION BY OPEN STRUCTURES	W23	CITY OF OTTAWA
WATERMAIN CROSSING BELOW SEWERS	W25	CITY OF OTTAWA
WATERMAIN MATERIAL	PVC DR 18 (100mm AND LARGER)	
- EXCAVATION, INSTALLATION, BACKFILL AND RESTORATION OF ALL WATERMANS BY THE CONTRACTOR. CONNECTIONS AND SHUT-OFFS AT THE MAIN AND CHLORINATION OF THE WATER SYSTEM SHALL BE PERFORMED BY CITY OFFICIALS. EXCAVATION, INSTALLATION OF SERVICE, BACKFILL AND RESTORATION BY THE CONTRACTOR.
- WATERMAIN SHALL BE MINIMUM 2.4m DEPTH BELOW GRADE UNLESS OTHERWISE INDICATED.
- PROVIDE MINIMUM 0.5m CLEARANCE BETWEEN OUTSIDE OF PIPES AT ALL CROSSINGS, UNLESS OTHERWISE INDICATED.
- WATER SERVICE IS TO BE CONSTRUCTED TO WITHIN 1.0m OF FOUNDATION WALL AND CAPPED, UNLESS OTHERWISE INDICATED.

PROPOSED 150mmØ WATER SERVICE TABLE - LOUISA STREET



STATION	SURFACE ELEVATION	T&W ELEVATION	COMMENTS
0+00	71.60±	69.40±	150mmØ WM CONNECTION TO EX. 150mmØ WM
0+05.9	71.8±	69.43	150mmØ V&VB
0+06.4	71.84	69.44	CAP 0.5m FROM PROPERTY LINE

\* CONNECTION TO EXISTING 150mmØ WATERMAIN. EXACT ELEVATIONS TO BE FIELD DETERMINED.  
\*\* PROVIDE THERMAL INSULATION AS PER CITY OF OTTAWA DETAIL W22 IN SHALLOW TRENCHES AND/OR CITY OF OTTAWA DETAIL W23 ADJACENT TO OPEN STRUCTURES.

PROPOSED 150mmØ WATER SERVICE TABLE - BELL STREET

STATION	SURFACE ELEVATION	T&W ELEVATION	COMMENTS
1+00	71.60±	69.37±	150mmØ WM CONNECTION TO EX. 200mmØ WM
1+03.0	71.74	69.34	150mmØ V&VB
1+04.5	71.74	69.34	CROSS UNDER 150mm GAS (T&GAS=70.84±, CLEARANCE = 1.35m±)
1+05.2	71.75	69.35	CAP 0.5m FROM PROPERTY LINE

\* CONNECTION TO EXISTING 200mmØ WATERMAIN. EXACT ELEVATIONS TO BE FIELD DETERMINED.  
\*\* PROVIDE THERMAL INSULATION AS PER CITY OF OTTAWA DETAIL W22 IN SHALLOW TRENCHES AND/OR CITY OF OTTAWA DETAIL W23 ADJACENT TO OPEN STRUCTURES.

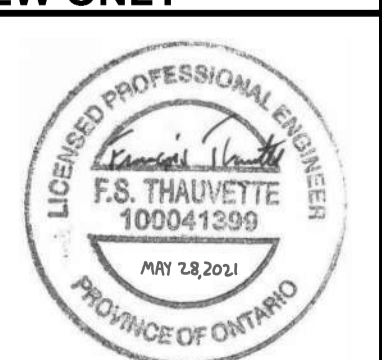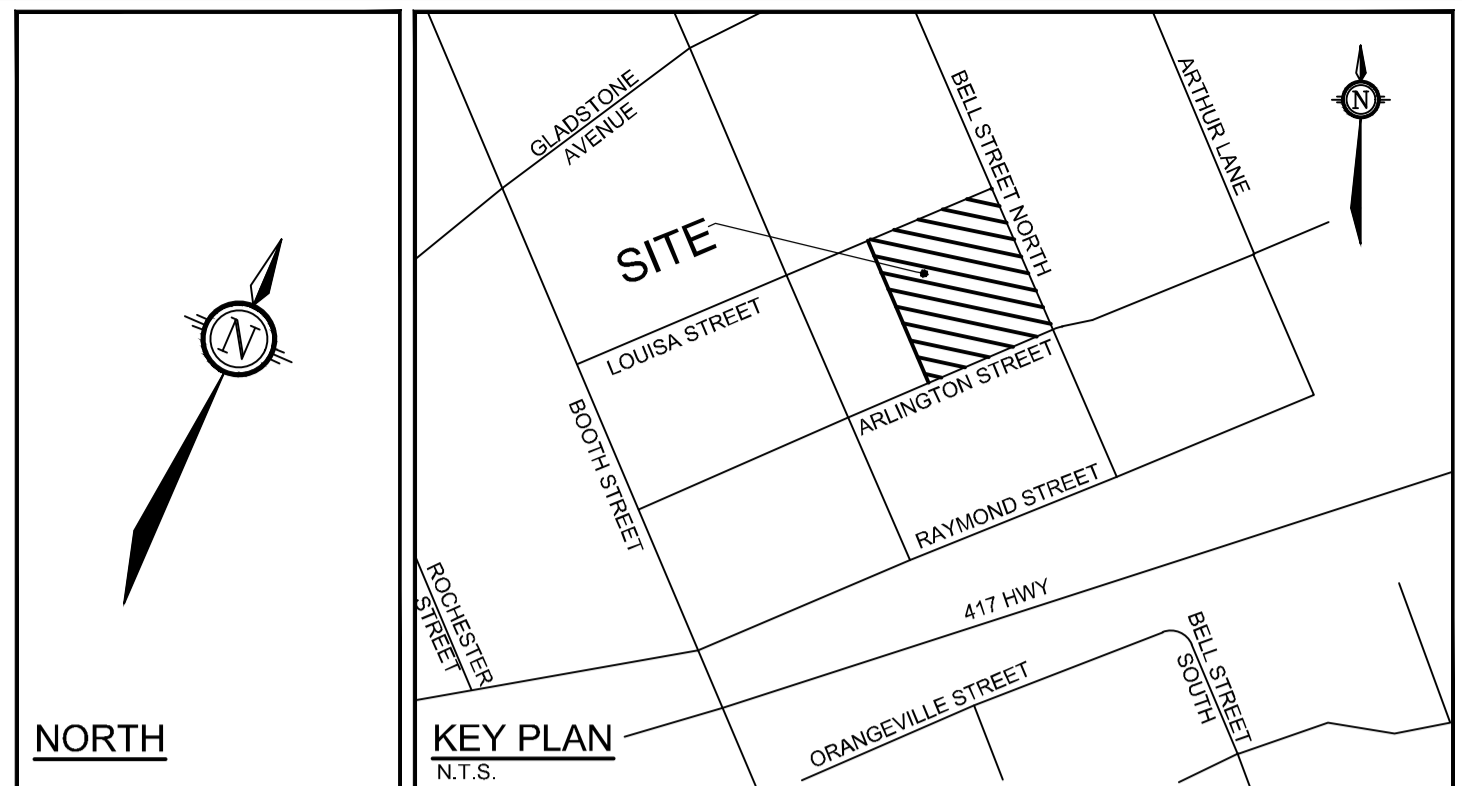

**NOVATECH**  
Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6  
Telephone: (613) 254-9643  
Facsimile: (613) 254-9667  
Website: www.novatech-eng.com

LOCATION CITY OF OTTAWA 18 LOUISA STREET	PROJECT No. 120206-00
DRAWING NAME GENERAL PLAN OF SERVICES	REV REV #1
	DRAWING No. 120206-GP

M:\2020\120206\CAD\Design\120206-GP.dwg, GP(A1), May 28, 2021, 8:37 am, smathews