

NOTES: GENERAL

- ALL SERVICES, MATERIALS, CONSTRUCTION METHODS AND INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE LATEST STANDARDS AND REGULATIONS OF THE: CITY OF OTTAWA STANDARD SPECIFICATIONS AND DRAWINGS, ONTARIO PROVINCIAL SPECIFICATION STANDARD SPECIFICATION (OPSS) AND ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD).
- THE POSITION OF EXISTING POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND ABOVEGROUND UTILITIES, STRUCTURES AND APPURTENANCES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWING AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL SATISFY HIMSELF OF THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES, AND SHALL ASSUME ALL LIABILITY FOR DAMAGE TO THEM DURING THE COURSE OF CONSTRUCTION. ANY RELOCATION OF EXISTING UTILITIES REQUIRED BY THE DEVELOPMENT OF SUBJECT LANDS IS TO BE UNDERTAKEN AT CONTRACTOR'S EXPENSE.
- THE CONTRACTOR MUST NOTIFY ALL EXISTING UTILITY COMPANY OFFICIALS FIVE (5) BUSINESS DAYS PRIOR TO START OF CONSTRUCTION AND HAVE ALL EXISTING UTILITIES AND SERVICES LOCATED IN THE FIELD OR EXPOSED PRIOR TO THE START OF CONSTRUCTION, INCLUDING BUT NOT LIMITED TO HYDRO, BELL, CABLE TV, AND CONSUMERS GAS LINES.
- ALL TRENCHING AND EXCAVATIONS TO BE IN ACCORDANCE WITH THE LATEST REVISIONS OF THE OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS.
- REFER TO ARCHITECTS PLANS FOR BUILDING DIMENSIONS, ELEVATIONS, LAYOUT AND DECK STRUCTURE. REFER TO LANDSCAPE PLAN FOR LANDSCAPED DETAILS AND OTHER RELEVANT INFORMATION. ALL INFORMATION SHALL BE CONFIRMED PRIOR TO COMMENCEMENT OF CONSTRUCTION.
- TOPOGRAPHIC SURVEYS COMPLETED AND PROVIDED BY ANNIS, O'SULLIVAN, VOLLEBEKK LTD. DATED JUNE 15 2021 AND DECEMBER 9 2022. CONTRACTOR TO VERIFY IN THE FIELD PRIOR TO CONSTRUCTION OF ANY WORK AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES.
- ALL ELEVATIONS ARE GEODETIC AND UTILIZE METRIC UNITS.
- ALL GROUND SURFACES SHALL BE EVENLY GRADED WITHOUT PONDING AREAS AND WITHOUT LOW POINTS EXCEPT WHERE APPROVED SWALE OR DRAIN OUTLETS ARE PROVIDED.
- ALL EDGES OF DISTURBED PAVEMENT SHALL BE SAW CUT TO FORM A NEAT AND STRAIGHT LINE PRIOR TO PLACING NEW PAVEMENT. PAVEMENT REINSTATEMENT SHALL BE WITH STEP JOINTS OF 500mm WIDTH MINIMUM.
- ALL DISTURBED AREAS OUTSIDE PROPOSED GRADING LIMITS TO BE RESTORED TO ORIGINAL ELEVATIONS AND CONDITIONS UNLESS OTHERWISE SPECIFIED. EXISTING PARKING LOT SHALL BE RE-ASPHALTED AT EXISTING GRADES EXCEPT AS NOTED TO EVEN OUT GRADES. ALL RESTORATION SHALL BE COMPLETED WITH THE GEOTECHNICAL REQUIREMENTS FOR BACKFILL AND COMPACTION.
- ALL MATERIAL SUPPLIED AND PLACED FOR PARKING LOT AND ACCESS ROAD CONSTRUCTION SHALL BE TO OPSS STANDARDS AND SPECIFICATIONS UNLESS OTHERWISE NOTED. CONSTRUCTION TO OPSS 206, 310 & 314. MATERIALS TO OPSS 1001, 1003 & 1010.
- RETAINING WALLS ARE TO BE CONSTRUCTED PER OPSD 3120.100 TYPE II.
- ABUTTING PROPERTY GRADES TO BE MATCHED.
- CONTRACTOR SHALL OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE MUNICIPAL AUTHORITIES PRIOR TO COMMENCING CONSTRUCTION.
- MINIMIZE DISTURBANCE TO EXISTING VEGETATION DURING THE EXECUTION OF ALL WORKS.
- REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL UNLESS OTHERWISE DIRECTED FROM THE ENGINEER. EXCAVATE AND REMOVE ALL ORGANIC MATERIAL AND DEBRIS LOCATED WITHIN THE PROPOSED BUILDING, PARKING AND ROADWAY LOCATIONS.
- AT PROPOSED UTILITY CONNECTION POINTS AND CROSSINGS (I.E. STORM SEWER, SANITARY SEWER, WATER, ETC.) THE CONTRACTOR SHALL DETERMINE THE PRECISE LOCATION AND DEPTH OF EXISTING UTILITIES AND REPORT ANY DISCREPANCIES OR CONFLICTS TO THE ENGINEER BEFORE COMMENCING WORK.
- SERVICE TRENCHES ON MUNICIPAL RIGHT OF WAY TO BE REINSTATED AS PER CITY OF OTTAWA DETAIL R10.
- PRIOR TO CONSTRUCTION, A GEOTECHNICAL ENGINEER REGISTERED IN THE PROVINCE OF ONTARIO IS TO INSPECT ALL SUB-SURFACES FOR FOOTINGS, SERVICES AND PAVEMENT STRUCTURES.
- FOR ANY SOLS RELATED INFORMATION, REFER TO THE GEOTECHNICAL INVESTIGATION REPORT (PG5716-1) PROVIDED BY PATERSON GROUP INC. DATED MARCH 10 2021.
- CONTRACTOR TO OBTAIN POST-CONSTRUCTION TOPOGRAPHIC SURVEY PERFORMED BY CERTIFIED OLS OR P.ENG. CONFIRMING COMPLIANCE WITH DESIGN GRADING AND SERVICING. SURVEY IS TO INCLUDE LOCATION AND INVERTS FOR BURIED UTILITIES.
- EXISTING STORM SEWER, SANITARY SEWER, AND WATERMAIN ALONG NELSON STREET WERE DRAWN IN BASED ON SURVEY. CONTRACTOR TO CONFIRM ON SITE PRIOR TO CONSTRUCTION. SEWERS AND SERVICE LATERALS TO BE ABANDONED AS SHOWN IN PLAN PER CITY OF OTTAWA STANDARDS S11.4 AND F-4104.
- ELEVATIONS SHOWN ON THIS PLAN ARE RELATED TO CGVD28 GEODETIC DATUM. BENCHMARK NO 1 HAVING A PUBLISHED ELEVATION OF 60.24m AND BENCHMARK NO 2 HAVING A PUBLISHED ELEVATION OF 59.25m. TOPOGRAPHIC INFORMATION PROVIDED BY ANNIS, O'SULLIVAN, VOLLEBEKK LTD. JUNE 15 2021 AND DECEMBER 9 2022.

NOTES: STORM SEWERS AND STRUCTURES

- ALL STORM SEWER MATERIALS AND CONSTRUCTION METHODS SHALL CONFORM TO THE CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS. PROVIDE CCTV INSPECTION REPORTS FOR ALL NEW STORM SEWERS, SERVICES AND CB LEADS.
 - STORM SEWERS 450mm DIAMETER AND SMALLER SHALL BE PVC SDR-35, WITH RUBBER GASKET PER CSA A-287.3.
 - STORM SEWER LARGER THAN 450mm SHALL BE REINFORCED CONCRETE CLASS 100.
 - SEWER BEDDING AS PER CITY OF OTTAWA DETAIL S6.
 - ALL STORM MANHOLES TO BE AS PER STORM STRUCTURE TABLE.
 - ANY NEW OR EXISTING STORM SEWER WITH LESS THAN 2.0m COVER REQUIRES THERMAL INSULATION AS PER CITY OF OTTAWA STANDARD W22, OR APPROVED BY THE ENGINEER.
 - STORM CATCH-BASINS AS PER OPSD 705.010 AND FRAME/COVER AS PER CITY STANDARD DRAWINGS S19. STORM CBMH'S AS INDICATED IN TABLE WITH SUMP. ADJUSTMENT SECTIONS SHALL BE AS PER OPSD 704.010.
 - INSTALLATION OF FLOW CONTROL IC'D'S TO BE VERIFIED BY QUALITY VERIFICATION ENGINEER RETAINED BY CONTRACTOR.
 - PROVIDE BACKWATER VALVE ON FOUNDATION DRAIN PER S14
- NOTES: SANITARY SEWER AND MANHOLES**
- ALL SANITARY SEWER, SANITARY SEWER APPURTENANCES AND CONSTRUCTION METHODS SHALL CONFORM TO THE CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS. PROVIDE CCTV INSPECTION REPORTS FOR ALL NEW SANITARY PIPING.
 - SANITARY SEWER PIPE SIZE 150mm DIAMETER AND GREATER TO BE PVC SDR-35 (UNLESS SPECIFIED OTHERWISE) WITH RUBBER GASKET TYPE JOINTS IN CONFORMANCE WITH CSA B-182.2.3.4.
 - SEWER BEDDING AS PER CITY OF OTTAWA DETAIL S6.
 - ALL SANITARY MANHOLES 1200mm IN DIAMETER TO BE AS PER OPSD 701.01. FRAME AND COVER TO BE AS PER CITY OF OTTAWA STANDARD S25 AND S24.
 - MAINTENANCE HOLE BENCHING AND PIPE OPENING ALTERNATIVES AS PER THE OPSD 701.021
 - ANY SANITARY SEWER WITH LESS THAN 2.0m COVER REQUIRES THERMAL INSULATION AS PER CITY OF OTTAWA STANDARD W22, OR APPROVED BY THE ENGINEER.
 - PROVIDE BACKWATER VALVE PER S14.1

NOTES: WATERMAIN




- ALL WATERMAIN AND WATERMAIN APPURTENANCES, MATERIALS, CONSTRUCTION AND TESTING METHODS SHALL CONFORM TO THE CURRENT CITY OF OTTAWA AND MINISTRY OF ENVIRONMENT STANDARDS AND SPECIFICATIONS.
- ALL WATERMAIN 300mm DIAMETER AND SMALLER TO BE POLY VINYL CHLORIDE (PVC) CLASS 150 DR 18 MEETING AWWA SPECIFICATION C900.
- ALL WATERMAIN TO BE INSTALLED AT MINIMUM COVER OF 2.4m BELOW FINISHED GRADE. WHERE WATERMANS CROSS OVER OTHER UTILITIES, A MINIMUM 0.30m CLEARANCE SHALL BE MAINTAINED. WHERE WATERMANS CROSS UNDER OTHER UTILITIES, A MINIMUM 0.50m CLEARANCE SHALL BE MAINTAINED. WHERE THE MINIMUM SEPARATION CANNOT BE ACHIEVED, THE WATERMAIN SHALL BE INSTALLED AS PER CITY OF OTTAWA STANDARDS W25 AND W25.2 WHERE 2.4m MINIMUM DEPTH CANNOT BE ACHIEVED, THERMAL INSULATION SHALL BE PROVIDED AS PER CITY OF OTTAWA STANDARD W22. WHERE A WATERMAIN IS IN CLOSE PROXIMITY TO AN OPEN STRUCTURE, THERMAL INSULATION SHALL BE PROVIDED AS PER CITY OF OTTAWA STANDARD W23.
- CONCRETE THRUST BLOCKS AND MECHANICAL RESTRAINTS ARE TO BE INSTALLED AT ALL TEES, BENDS, HYDRANTS, REDUCERS, ENDS OF MAINS AND CONNECTIONS 100mm AND LARGER, IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS W25.3 & W25.4.
- CATHODIC PROTECTION REQUIRED FOR ALL IRON FITTINGS AS PER CITY OF OTTAWA STANDARD W40 & W42.
- ALL VALVES AND VALVE BOXES AND CHAMBERS, HYDRANTS, AND HYDRANT VALVES AND ASSEMBLES SHALL BE INSTALLED AS PER CITY OF OTTAWA STANDARD.
- IF WATER MAIN MUST BE DEFLECTED TO MEET ALIGNMENT, ENSURE THAT THE AMOUNT OF DEFLECTION USED IS LESS THAN HALF THAT RECOMMENDED BY THE MANUFACTURER.

NOTES: REMOVALS

- CONTRACT ADMINISTRATOR TO CONFIRM THAT ALL EXISTING WATER AND SANITARY SEWER UTILITIES TO BE ABANDONED. FILL WITH GROUT AND CAP, OR REMOVE COMPLETELY. THE BLANKING OF EXISTING WATER SERVICES BEYOND THE PROPERTY LINE SHALL BE PERFORMED BY CITY FORCES. THE CONTRACTOR SHALL PROVIDE EXCAVATION, BACKFILL AND REINSTATEMENT.

NOTES: EROSION AND SEDIMENT CONTROL

- ** CONTRACTOR IS RESPONSIBLE FOR ALL INSTALLATION, MONITORING, REPAIR AND REMOVAL OF ALL EROSION AND SEDIMENT CONTROL FEATURES. **
- PRIOR TO START OF CONSTRUCTION:
 - INSTALL SILT FENCE IN LOCATION SHOWN.
 - INSTALL FILTER FABRIC OR SILT SACK FILTERS IN ALL THE CATCHBASINS AND MANHOLES TO REMAIN DURING CONSTRUCTION WITHIN THE SITE.
 - INSPECT MEASURES IMMEDIATELY AFTER INSTALLATION.
 - INSTALL MUD MAT AT CONSTRUCTION ENTRANCES.
 - DURING CONSTRUCTION:
 - MINIMIZE THE EXTENT OF DISTURBED AREAS AND THE DURATION OF EXPOSURE AND IMPACTS TO EXISTING GRADING. PERIMETER VEGETATION TO REMAIN IN PLACE UNTIL PERMANENT STORM WATER MANAGEMENT IS IN PLACE. OTHERWISE, IMMEDIATELY INSTALL SILT FENCE WHEN THE EXISTING SITE IS DISTURBED AT THE PERIMETER.
 - PROTECT DISTURBED AREAS FROM OVERLAND FLOW BY PROVIDING TEMPORARY SWALES TO THE SATISFACTION OF THE FIELD ENGINEER. TIE-IN TEMPORARY SWALE TO EXISTING CB'S AS REQUIRED.
 - PROVIDE TEMPORARY COVER SUCH AS SEEDING OR MULCHING IF DISTURBED AREA WILL NOT BE REHABILITATED WITHIN 30 DAYS.
 - INSPECT SILT FENCES, FILTER FABRIC FILTERS AND CATCH BASIN SUMPS WEEKLY AND WITHIN 24 HOURS AFTER A STORM EVENT. CLEAN AND REPAIR WHEN NECESSARY.
 - DOWNSIDE STORM INFRASTRUCTURE SHALL BE PROTECTED FROM UNFILTERED RUNOFF DURING ON-SITE STORM INFRASTRUCTURE DEMOLITION.
 - DRAWING TO BE REVIEWED AND REVISED AS REQUIRED DURING CONSTRUCTION.
 - EROSION CONTROL FENCING TO BE ALSO INSTALLED AROUND THE BASE OF ALL STOCKPILES.
 - DO NOT LOCATE TOPSOIL PILES AND EXCAVATION MATERIAL CLOSER THAN 2.5m FROM ANY GRAVE SURFACE, OR ONE WHICH IS TO BE PAVED BEFORE THE PILE IS REMOVED. ALL TOPSOIL PILES ARE TO BE SEEDED IF THEY ARE TO REMAIN ON SITE LONG ENOUGH FOR SEEDS TO GROW (LONGER THAN 30 DAYS).
 - CONTROL WIND-BLOWN DUST OFF SITE. BY SEEDING TOPSOIL PILES AND OTHER AREAS TEMPORARILY (PROVIDE WATERING AS REQUIRED AND TO THE SATISFACTION OF THE ENGINEER).
 - NO ALTERNATE METHODS OF EROSION PROTECTION SHALL BE PERMITTED UNLESS APPROVED BY THE FIELD ENGINEER.
 - CITY ROADWAY AND SIDEWALK TO BE CLEANED OF ALL SEDIMENT FROM VEHICULAR TRACKING AS REQUIRED.
 - DURING WET CONDITIONS, TIRES OF ALL VEHICLES/EQUIPMENT LEAVING THE SITE ARE TO BE SCRAPPED.
 - ANY MUD/MATERIAL TRACKED ONTO THE ROAD SHALL BE REMOVED IMMEDIATELY BY HAND OR RUBBER TIRE LOADER.
 - TAKE ALL NECESSARY STEPS TO PREVENT BUILDING MATERIAL, CONSTRUCTION DEBRIS OR WASTE BEING SPILLED OR TRACKED ONTO ABUTTING PROPERTIES OR PUBLIC STREETS DURING CONSTRUCTION AND PROCEED IMMEDIATELY TO CLEAN UP ANY AREAS SO AFFECTED.
 - ALL EROSION CONTROL STRUCTURE TO REMAIN IN PLACE UNTIL ALL DISTURBED GROUND SURFACES HAVE BEEN STABILIZED EITHER BY PAVING OR RESTORATION OF VEGETATIVE GROUND COVER.
 - THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE, DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.

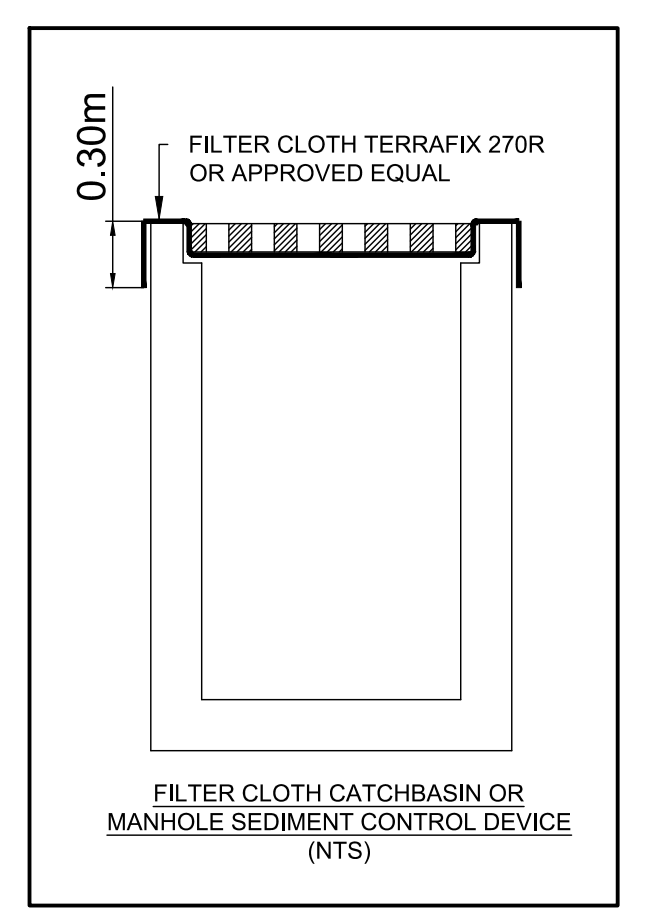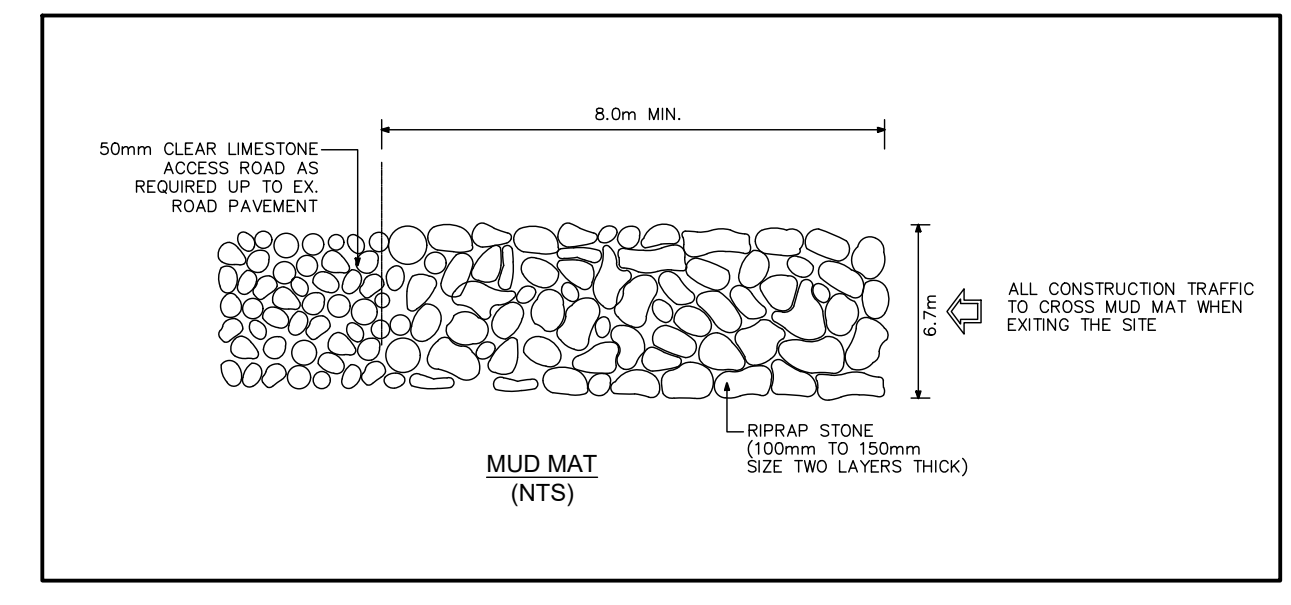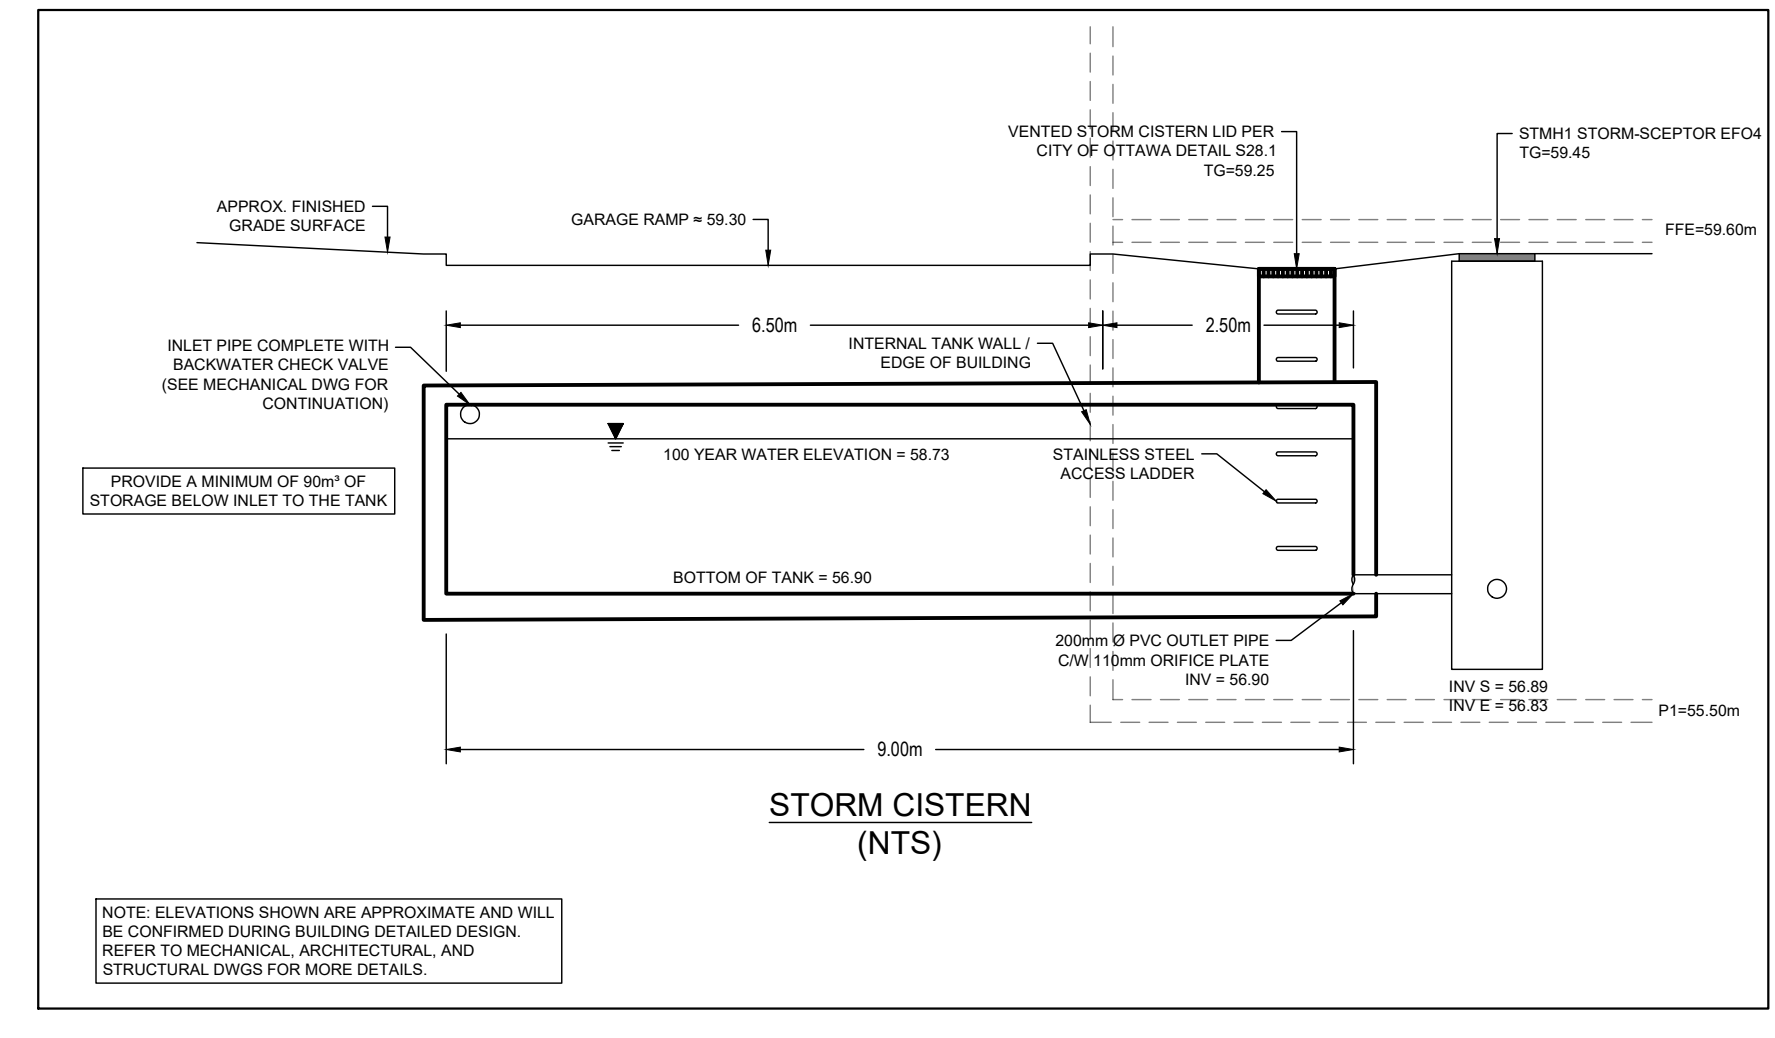

Andrew McCreight

ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
By Andrew McCreight at 10:06 am, Oct 15, 2024

STRUCTURE ID	TOP OF GRATE ELEVATION	INVERT IN	INVERT OUT	INSULATION REQUIRED ON OUTLET PIPE?	DESCRIPTION			NOTES
					SIZE	OPSD	COVER	
SAMH1	59.45	56.46	56.45	N	1200mm DIA.	OPSD 701.010	S24	

STRUCTURE ID	TOP OF GRATE ELEVATION	INVERT IN	INVERT OUT	INSULATION REQUIRED ON OUTLET PIPE?	DESCRIPTION			NOTES
					SIZE	OPSD	COVER	
AD01	59.20							AREA DRAIN
AD02	59.20							AREA DRAIN
AD03	59.15							AREA DRAIN
AD04	59.15							AREA DRAIN
AD05	59.20							AREA DRAIN
AD06	59.25							AREA DRAIN
AD07	59.20							AREA DRAIN
AD08	57.55							AREA DRAIN
AD09	57.55							AREA DRAIN
AD10	57.55							AREA DRAIN
AD11	59.20							AREA DRAIN
AD12	59.20							AREA DRAIN
AD13	59.15							AREA DRAIN
STMH1	59.45	56.89	56.83	N	1200mm DIA.	OPSD 701.010	Stormceptor	EFO4

		Obvert		Invert	
1	EX 300mm SAN	56.53	0.27	Clearance Under	56.80 150mm WM
2	EX 450mm STM	57.09	0.26	Clearance Under	57.35 150mm WM
3	EX 300mm SAN	56.53	0.27	Clearance Under	56.80 150mm WM
4	EX 450mm STM	57.09	0.26	Clearance Under	57.35 150mm WM
5	150mm WM	56.60	0.25	Clearance Under	56.85 EX 200mm WM
6	EX 900mm STM*	57.02	0.25	Clearance Under	57.27 150mm WM
7	EX 375mm SAN*	55.57	1.63	Clearance Under	57.20 150mm WM
8	EX 300mm SAN	56.55	0.43	Clearance Under	56.98 150mm STM
9	EX 300mm SAN	56.56	0.19	Clearance Under	56.75 250mm STM

*information provided on utilities along east side of Nelson St is approximate; contractor to confirm in field

CLIENT
FORUM/SLP 112 NELSON LIMITED PARTNERSHIP
226 ARGYLE AVE. OTTAWA, ON K2P 1B9

KEY PLAN

PROJECT NORTH **TRUE NORTH**

DISCLAIMER: COPYRIGHT:
THIS DRAWING AND DESIGN IS COPYRIGHT PROTECTED WHICH SHALL NOT BE USED, REPRODUCED OR REVISED WITHOUT WRITTEN PERMISSION BY WSP. THE CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND UTILITY LOCATIONS AND REPORT ALL ERRORS AND OMISSIONS PRIOR TO COMMENCING WORK.

SUBJECT TO APPROVAL

NO.	REVISION	DDMMYY DATE
9	ISSUED FOR CITY COMMENTS	12/09/24
8	ISSUED FOR REVIEW	06/08/24
7	REISSUED FOR SPA	28/06/24
6	REVISED PER CITY COMMENTS	25/07/23
5	REVISED AND ISSUED FOR SPA	17/07/23
4	REVISED AND ISSUED FOR SPA	26/05/23
3	REVISED AND ISSUED FOR SPA	17/02/23
2	REISSUED FOR SPA	08/25/21
1	ISSUED FOR SPA	07/16/21
NO.	REVISION	DDMMYY DATE



300-2611 QUEENSVIEW DRIVE
OTTAWA ONTARIO CANADA K2B 9K2
TEL: 1-613-829-2800 | FAX: 1-613-829-8298 | WWW.WSPGROUP.COM

DISCIPLINE: CIVIL

PROJECT:
112-134 NELSON ST

DRAWING:
NOTES AND DETAILS

DATE: 12/09/24	PROJECT NO: 211-04788-00
SCALE: AS NOTED	DRAWING NO:
DRAWN BY: S.M.	C01
APPROVED BY: I.J.	

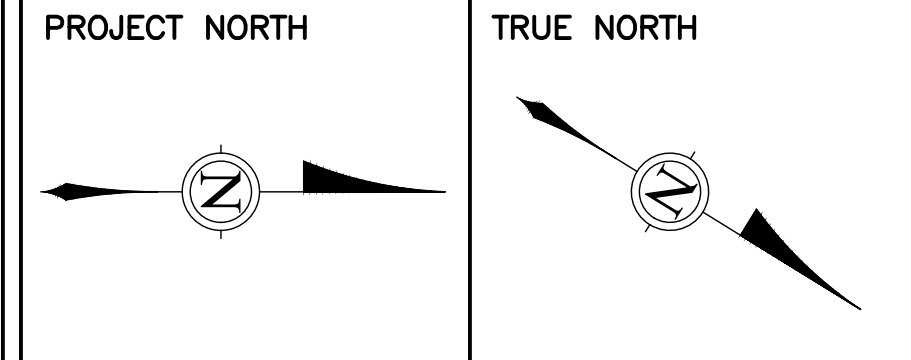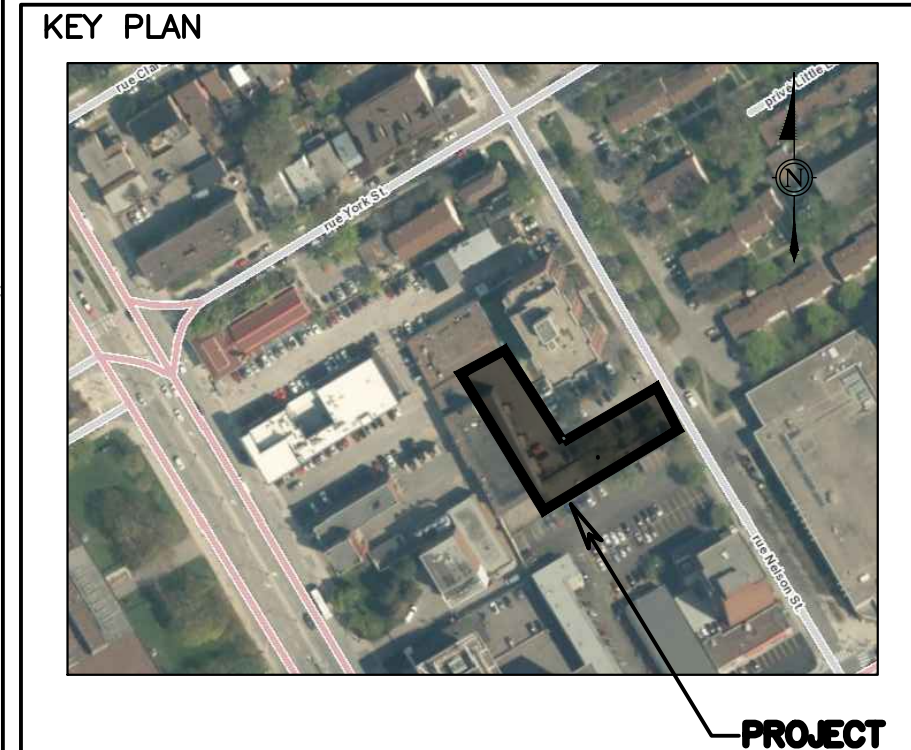

DISCLAIMER: THIS DRAWING AND DESIGN IS COPYRIGHTED WHICH SHALL NOT BE USED, REPRODUCED OR REVISED WITHOUT WRITTEN PERMISSION BY WSP. THE CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND UTILITY LOCATIONS AND REPORT ALL ERRORS AND OMISSIONS PRIOR TO COMMENCING WORK.



SUBJECT TO APPROVAL

NO.	REVISION	DATE
9	ISSUED FOR CITY COMMENTS	12/09/24
8	ISSUED FOR REVIEW	06/08/24
7	REISSUED FOR SPA	28/06/24
6	REVISED PER CITY COMMENTS	25/07/23
5	REVISED AND ISSUED FOR SPA	17/07/23
4	REVISED AND ISSUED FOR SPA	26/05/23
3	REVISED AND ISSUED FOR SPA	17/02/23
2	REISSUED FOR SPA	08/25/21
1	ISSUED FOR SPA	07/16/21




DISCIPLINE:
CIVIL

PROJECT:
112-134 NELSON ST


DRAWING:
GRADING PLAN

DATE: 12/09/24	PROJECT NO: 211-04788-00
SCALE: AS NOTED	DRAWING NO: C02
DRAWN BY: S.M.	APPROVED BY: I.J.

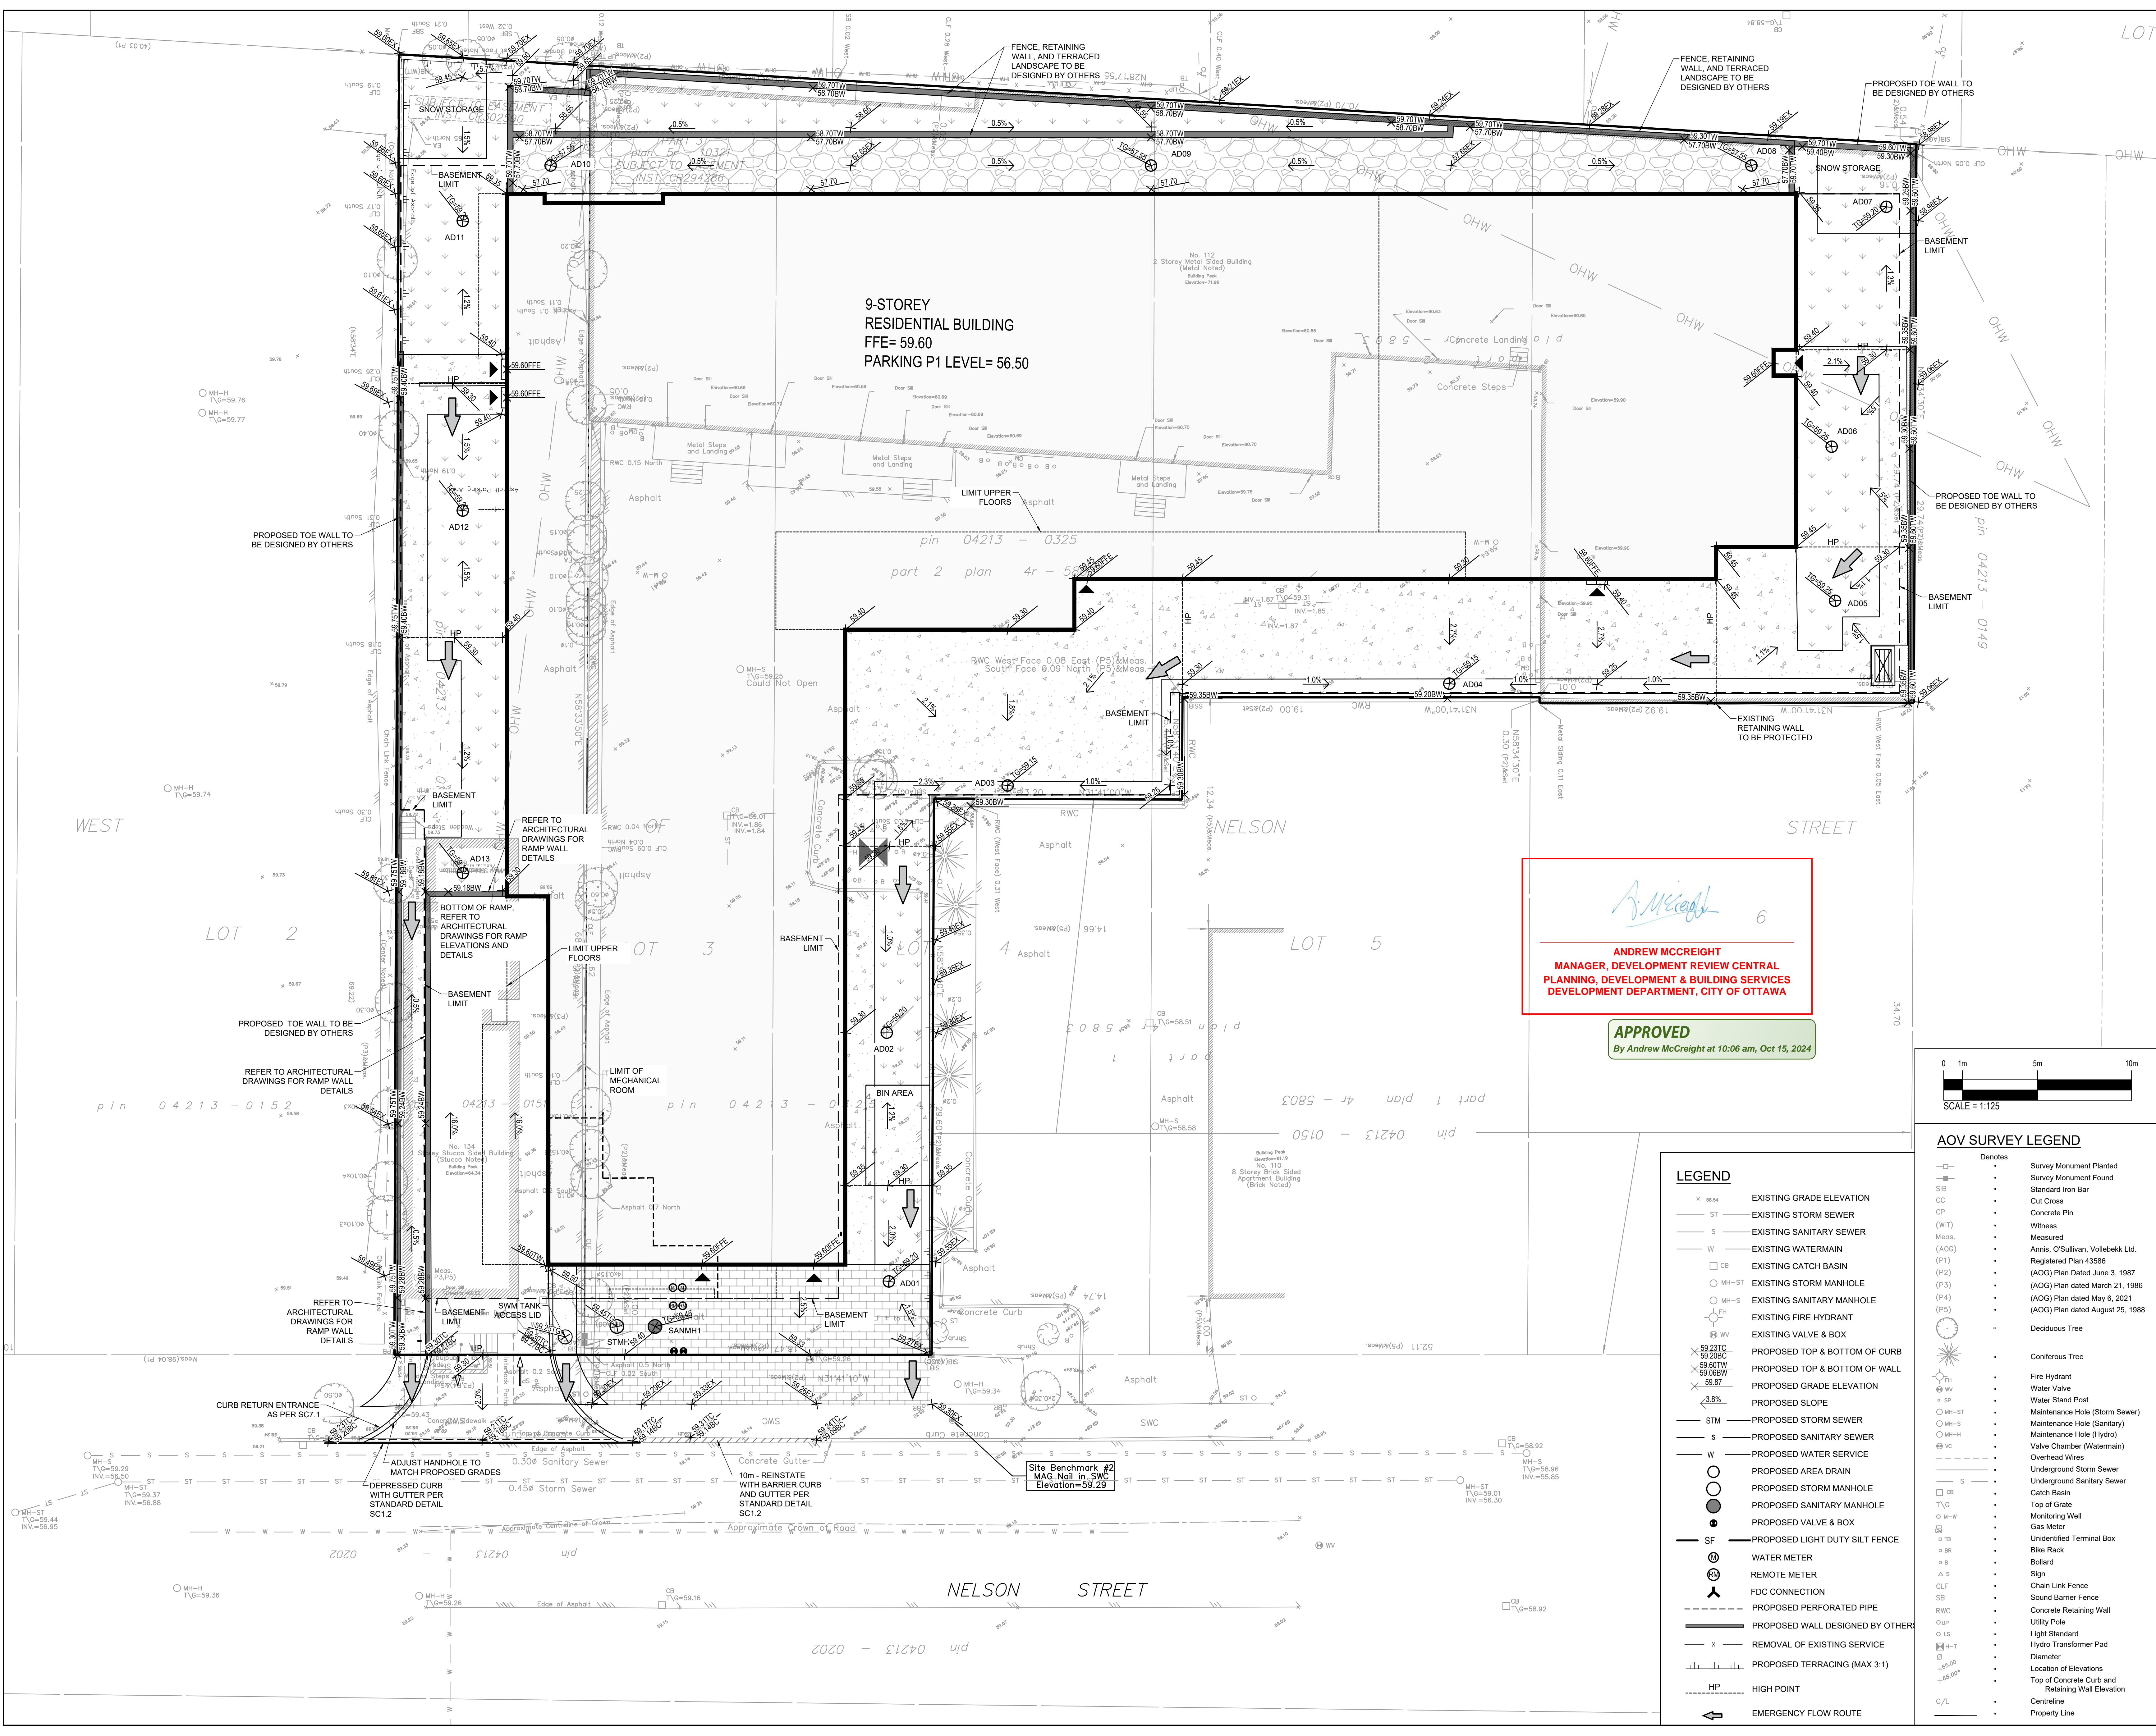



Andrew McCreight
ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
By Andrew McCreight at 10:06 am, Oct 15, 2024

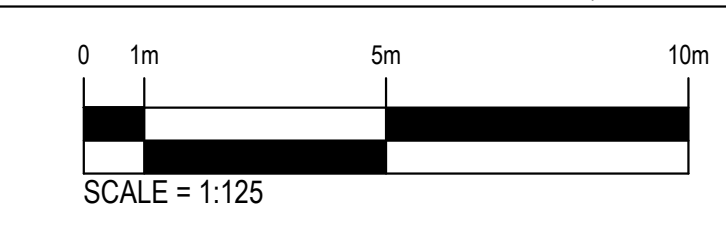

- LEGEND**
- EXISTING GRADE ELEVATION
 - EXISTING STORM SEWER
 - EXISTING SANITARY SEWER
 - EXISTING WATERMAIN
 - EXISTING CATCH BASIN
 - EXISTING STORM MANHOLE
 - EXISTING SANITARY MANHOLE
 - EXISTING FIRE HYDRANT
 - EXISTING VALVE & BOX
 - PROPOSED TOP & BOTTOM OF CURB
 - PROPOSED TOP & BOTTOM OF WALL
 - PROPOSED GRADE ELEVATION
 - PROPOSED SLOPE
 - PROPOSED STORM SEWER
 - PROPOSED SANITARY SEWER
 - PROPOSED WATER SERVICE
 - PROPOSED AREA DRAIN
 - PROPOSED STORM MANHOLE
 - PROPOSED SANITARY MANHOLE
 - PROPOSED VALVE & BOX
 - PROPOSED LIGHT DUTY SILT FENCE
 - WATER METER
 - REMOTE METER
 - FDC CONNECTION
 - PROPOSED PERFORATED PIPE
 - PROPOSED WALL DESIGNED BY OTHER
 - REMOVAL OF EXISTING SERVICE
 - PROPOSED TERRACING (MAX 3:1)
 - HIGH POINT
 - EMERGENCY FLOW ROUTE

- AOV SURVEY LEGEND**
- Denotes
 - Survey Monument Planted
 - Survey Monument Found
 - Standard Iron Bar
 - Cut Cross
 - Concrete Pin
 - Witness
 - Measured
 - Annis, O'Sullivan, Vollebakk Ltd. Registered Plan 43586 (ADG) Plan Dated June 3, 1987 (P1)
 - (ADG) Plan dated March 21, 1988 (P3)
 - (ADG) Plan dated May 6, 2021 (P4)
 - (ADG) Plan dated August 25, 1986 (P5)
 - Deciduous Tree
 - Coniferous Tree
 - Fire Hydrant
 - Water Valve
 - Water Stand Post
 - Maintenance Hole (Storm Sewer)
 - Maintenance Hole (Sanitary)
 - Valve Chamber (Watermain)
 - Overhead Wire
 - Underground Storm Sewer
 - Underground Sanitary Sewer
 - Catch Basin
 - Top of Grate
 - Monitoring Well
 - Gas Meter
 - Unidentified Terminal Box
 - Bike Rack
 - Bollard
 - Sign
 - Chain Link Fence
 - Sound Barrier Fence
 - Concrete Retaining Wall
 - Utility Pole
 - Light Standard
 - Hydro Transformer Pad
 - Diameter
 - Location of Elevations
 - Top of Concrete Curb and Retaining Wall Elevation
 - Centreline
 - Property Line

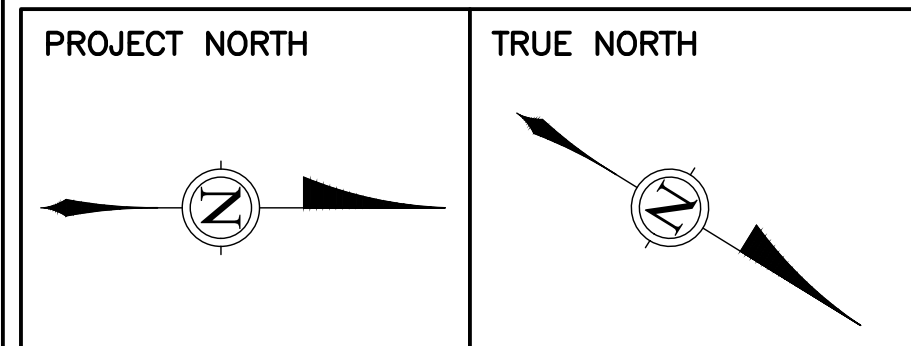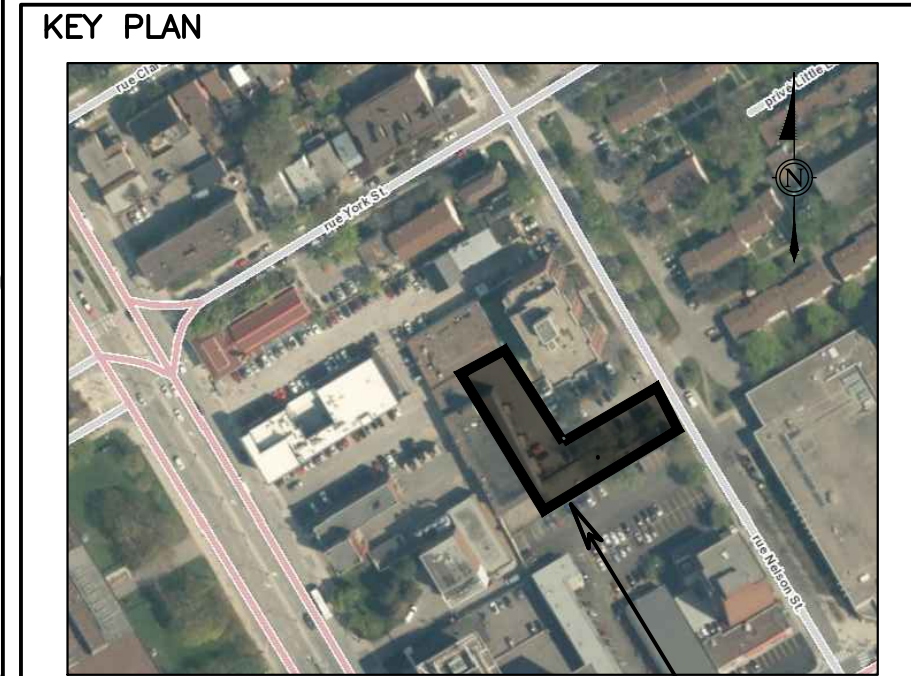

DISCLAIMER: THIS DRAWING AND DESIGN IS COPYRIGHTED WHICH SHALL NOT BE USED, REPRODUCED OR REVISED WITHOUT WRITTEN PERMISSION BY WSP. THE CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND UTILITY LOCATIONS AND REPORT ALL ERRORS AND OMISSIONS PRIOR TO COMMENCING WORK.

COPYRIGHT:



SUBJECT TO APPROVAL

NO.	REVISION	DATE
9	ISSUED FOR CITY COMMENTS	12/09/24
8	ISSUED FOR REVIEW	06/08/24
7	REISSUED FOR SPA	28/06/24
6	REVISED PER CITY COMMENTS	25/07/23
5	REVISED AND ISSUED FOR SPA	17/07/23
4	REVISED AND ISSUED FOR SPA	26/05/23
3	REVISED AND ISSUED FOR SPA	17/02/23
2	REISSUED FOR SPA	08/25/21
1	ISSUED FOR SPA	07/16/21




DISCIPLINE:
CIVIL

PROJECT:
112-134 NELSON ST

DRAWING:
EROSION AND SEDIMENT CONTROL PLAN

DATE: 12/09/24	PROJECT NO: 211-04788-00
SCALE: AS NOTED	DRAWING NO: C04
DRAWN BY: S.M.	APPROVED BY: I.J.

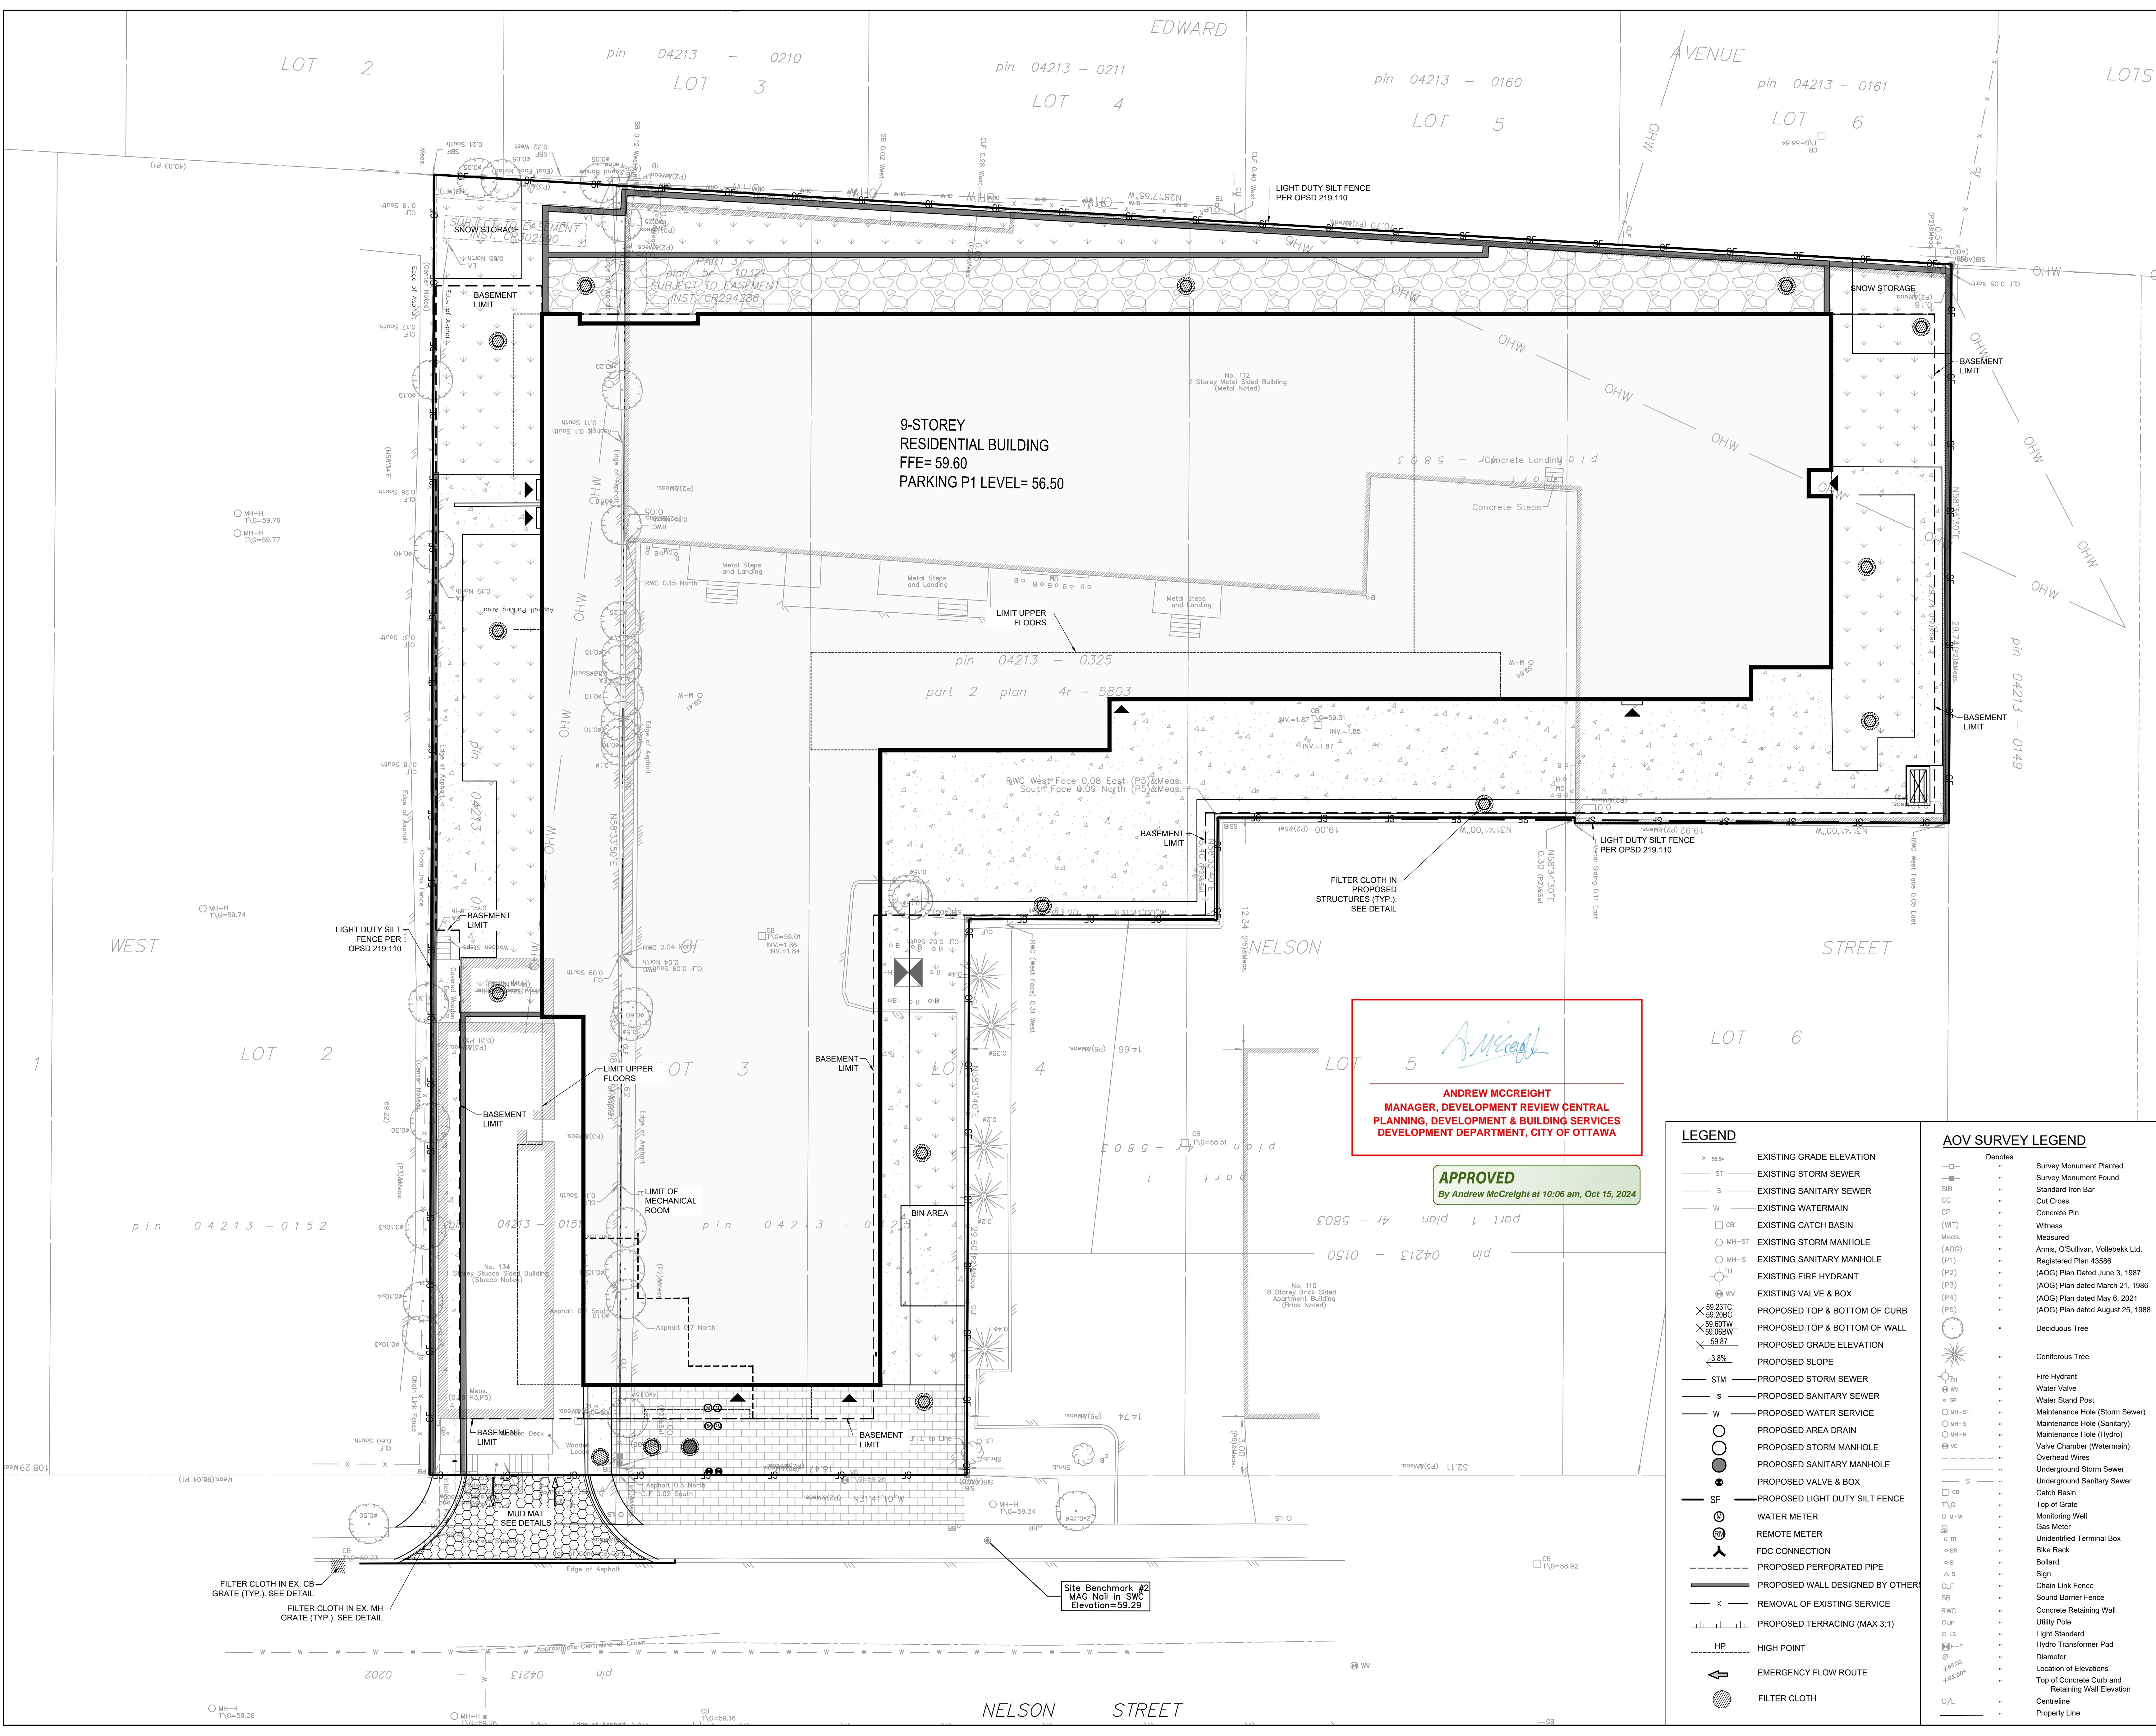

ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
By Andrew McCreight at 10:06 am, Oct 15, 2024

LEGEND

— x —	EXISTING GRADE ELEVATION
— ST —	EXISTING STORM SEWER
— S —	EXISTING SANITARY SEWER
— W —	EXISTING WATERMAIN
□ CB	EXISTING CATCH BASIN
○ MH-S	EXISTING STORM MANHOLE
○ MH-S	EXISTING SANITARY MANHOLE
○ FH	EXISTING FIRE HYDRANT
○ V&B	EXISTING VALVE & BOX
✕ 59.23TC	PROPOSED TOP & BOTTOM OF CURB
✕ 59.20BC	PROPOSED TOP & BOTTOM OF WALL
✕ 59.60TW	PROPOSED GRADE ELEVATION
✕ 59.87	PROPOSED SLOPE
— STM —	PROPOSED STORM SEWER
— S —	PROPOSED SANITARY SEWER
— W —	PROPOSED WATER SERVICE
○	PROPOSED AREA DRAIN
○	PROPOSED STORM MANHOLE
○	PROPOSED SANITARY MANHOLE
○	PROPOSED VALVE & BOX
— SF —	PROPOSED LIGHT DUTY SILT FENCE
○	WATER METER
○	REMOTE METER
○	FDC CONNECTION
— HP —	PROPOSED PERFORATED PIPE
— x —	PROPOSED WALL DESIGNED BY OTHER
— x —	REMOVAL OF EXISTING SERVICE
—	PROPOSED TERRACING (MAX 3:1)
— HP —	HIGH POINT
→	EMERGENCY FLOW ROUTE
○	FILTER CLOTH

AOV SURVEY LEGEND

—	Denotes	Survey Monument Planted
—	Survey Monument Found	Standard Iron Bar
—	Cut Cross	Concrete Pin
—	Witness Measured	Annis, O'Sullivan, Vollebek Ltd. Registered Plan 43586 (AOG) Plan Dated June 3, 1987 (P1) (AOG) Plan dated March 21, 1986 (P2) (AOG) Plan dated May 6, 2021 (P3) (AOG) Plan dated August 25, 1988 (P4) (P5)
—	Deciduous Tree	Coniferous Tree
—	Fire Hydrant	Water Valve
—	Water Stand Post	Maintenance Hole (Storm Sewer)
—	Maintenance Hole (Sanitary)	Maintenance Hole (Hydro)
—	Valve Chamber (Watermain)	Overhead Wires
—	Underground Storm Sewer	Underground Sanitary Sewer
—	Catch Basin	Top of Grate
—	Monitoring Well	Gas Meter
—	Unidentified Terminal Box	Bike Rack
—	Bollard	Sign
—	Chain Link Fence	Sound Barrier Fence
—	Concrete Retaining Wall	Utility Pole
—	Light Standard	Hydro Transformer Pad
—	Diameter	Location of Elevations
—	Top of Concrete Curb and Retaining Wall Elevation	Centreline
—	Property Line	