


INTERNAL SWM STORAGE SYSTEM

DESIGN EVENT	STORAGE SYSTEM CONTROLLED FLOW	STORAGE VOLUMES	
		REQUIRED	PROVIDED
1:2 YR	4.4 L/s	17.9 m ³	> 83 m ³
1:5 YR		27.4 m ³	
1:100 YR		64.7 m ³	
1:100+20%		82.1 m ³	

NOTES:

- ALL DRAINAGE FROM AREA A-2 (PROPOSED BUILDING DECK DRAINS AND ALL ROOF + PATIO DRAINS) TO BE DIRECTED TO THE INTERNAL STORMWATER STORAGE SYSTEM. REFER TO ARCHITECTURAL AND MECHANICAL PLANS FOR DETAILS.
- REFER TO ARCHITECTURAL AND STRUCTURAL PLANS FOR EXACT SIZE AND DETAILS OF INTERNAL STORMWATER STORAGE SYSTEM.
- REFER TO MECHANICAL PLANS FOR PUMP INFORMATION AND DETAILS OF THE INTERNAL STORMWATER STORAGE SYSTEM.

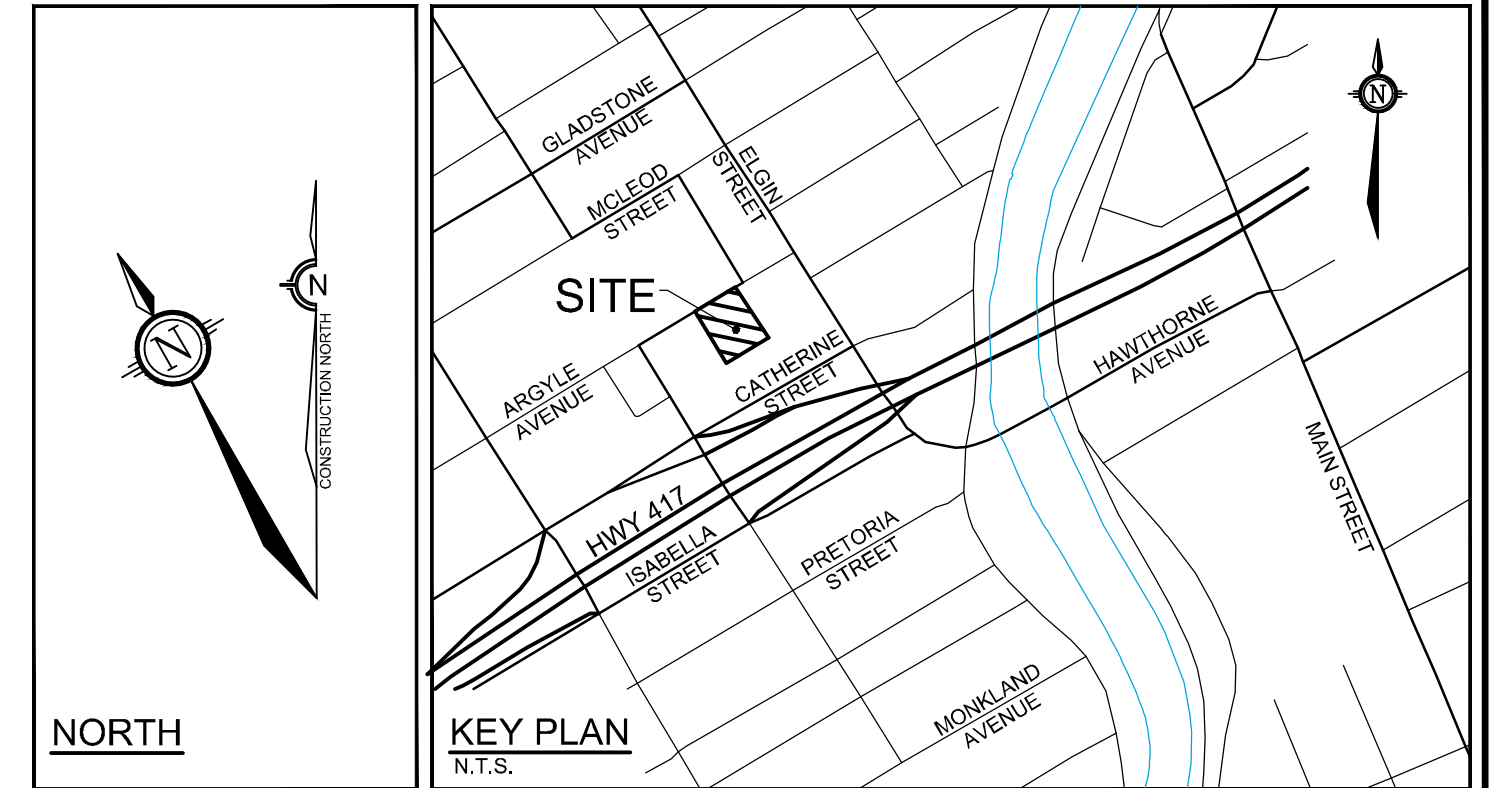


LEGEND

---	PROPERTY LINE	— OHW —	EXISTING OVERHEAD WIRES
—	PROPOSED SANITARY SERVICE	—	EXISTING CONCRETE CURB
—	PROPOSED STORM SERVICE	—	EXISTING SANITARY MANHOLE & SEWER
—	PROPOSED MECHANICAL DECK DRAIN	—	EXISTING CATCHBASIN MANHOLE
—	PROPOSED WATER METER AND REMOTE METER	—	EXISTING STORM MANHOLE & SEWER
—	PROPOSED BARRIER CURB	—	EXISTING CATCHBASIN C/W CATCHBASIN LEAD
—	PROPOSED DEPRESSED CURB	—	EXISTING HYDRANT & VALVE
—	PROPOSED WATER SERVICE AND DIAMETER	—	EXISTING TREES / VEGETATION
—	PROPOSED VALVE & VALVE BOX	—	EXISTING UTILITY POLE
—	PROPOSED CAP	—	EXISTING FENCE
—	PROPOSED BUILDING ENTRANCE	—	EXISTING WATERMAIN
—	REMOVALS	—	EXISTING HYDRANT C/W VALVE & LEAD
—	THERMAL INSULATION FOR SHALLOW SEWERS	—	FFE FINISHED FLOOR ELEVATION
		—	P1 LEVEL PARKING GARAGE LEVEL ELEVATION
		—	USF UNDERSIDE OF FOOTING ELEVATION

- ### GENERAL NOTES:
- COORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
 - DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT AND ASSUME RESPONSIBILITY FOR ALL EXISTING UTILITIES WHETHER OR NOT SHOWN ON THIS DRAWING.
 - OBTAIN ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA BEFORE COMMENCING CONSTRUCTION.
 - BEFORE COMMENCING CONSTRUCTION OBTAIN AND PROVIDE PROOF OF COMPREHENSIVE, ALL RISK AND OPERATIONAL LIABILITY INSURANCE FOR \$5,000,000.00. INSURANCE POLICY TO NAME OWNERS, ENGINEERS AND ARCHITECTS AS CO-INSURED.
 - RESTORE ALL DISTURBED AREAS ON-SITE AND OFF-SITE, INCLUDING TRENCHES AND SURFACES ON PUBLIC ROAD ALLOWANCES TO EXISTING CONDITIONS OR BETTER TO THE SATISFACTION OF MUNICIPAL AUTHORITIES.
 - REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL, ORGANIC MATERIAL AND DEBRIS UNLESS OTHERWISE INSTRUCTED BY ENGINEER. EXCAVATE AND REMOVE FROM SITE ANY CONTAMINATED MATERIAL. ALL CONTAMINATED MATERIAL SHALL BE DISPOSED OF AT A LICENSED LANDFILL FACILITY.
 - ALL ELEVATIONS ARE GEODETIC.
 - REFER TO GEOTECHNICAL INVESTIGATION REPORT (R&N: PG4458-1 REVISION 2) DATED JUNE 21, 2021, PREPARED BY PATERSON GROUP INC. FOR SUBSURFACE CONDITIONS, CONSTRUCTION RECOMMENDATIONS AND GEOTECHNICAL INSPECTION REQUIREMENTS. THE GEOTECHNICAL CONSULTANT IS TO REVIEW ON-SITE CONDITIONS AFTER EXCAVATION PRIOR TO PLACEMENT OF THE GRANULAR MATERIAL.
 - REFER TO ARCHITECT'S AND LANDSCAPE ARCHITECT'S DRAWINGS FOR BUILDING AND HARD SURFACED AREAS AND DIMENSIONS.
 - REFER TO THE 'DEVELOPMENT SERVICING STUDY AND STORMWATER MANAGEMENT REPORT' (R-2021-100) PREPARED BY NOVATECH.
 - SAW CUT AND KEYGRIND ASPHALT AT ALL ROAD CUTS AND ASPHALT TIE-IN POINTS AS PER CITY OF OTTAWA STANDARDS (R10).

- ### SEWER NOTES:
- SUPPLY AND CONSTRUCT ALL SEWERS AND APPURTENANCES IN ACCORDANCE WITH THE MOST CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS.
 - SPECIFICATIONS:

ITEM	SPEC. No.	REFERENCE
EXTERIOR MECHANICAL DECK DRAIN	FD-490-F4 (or APPROVED EQUIVALENT)	WATTS CANADA
SEWER TRENCH	S6	CITY OF OTTAWA
SANITARY / STORM SEWER	PVC DR 35	
 - THE SANITARY SERVICE LATERAL SHALL BE EQUIPPED WITH BACKFLOW PREVENTERS WITHIN THE BUILDING FOOTPRINT AS PER CITY OF OTTAWA STANDARD DETAILS S14.1 OR S14.2. REFER TO MECHANICAL PLANS FOR DETAILS.
 - THE STORM SERVICE LATERAL SHALL BE EQUIPPED WITH A BACKFLOW PREVENTER WITHIN THE BUILDING FOOTPRINT AS PER CITY OF OTTAWA STANDARD DETAILS S14. REFER TO MECHANICAL PLANS FOR DETAILS.
 - SERVICES ARE TO BE CONSTRUCTED TO 1.0m FROM FACE OF BUILDING AT A MINIMUM SLOPE OF 1.0%.
 - PIPE BEDDING, COVER AND BACKFILL ARE TO BE COMPACTED TO AT LEAST 95% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY. THE USE OF CLEAR CRUSHED STONE AS A BEDDING LAYER SHALL NOT BE PERMITTED.
 - INSULATE ALL PIPES (SAN / STM) THAT HAVE LESS THAN 1.5m COVER WITH H-40 INSULATION PER INSULATION DETAIL FOR SHALLOW SEWERS. PROVIDE 150mm CLEARANCE BETWEEN PIPE AND INSULATION.
 - FLEXIBLE CONNECTIONS ARE REQUIRED FOR CONNECTING PIPES TO MANHOLES (FOR EXAMPLE KOR-N-SEAL, PSX- POSITIVE SEAL, INVERT AND TIG SEAL). THE CONCRETE CRADLE FOR THE PIPE CAN BE ELIMINATED.
 - TYPICAL STORM MANHOLES AND CATCHBASIN MANHOLES ARE TO HAVE 300mm SLUMPS UNLESS OTHERWISE INDICATED.
 - THE CONTRACTOR IS TO TELEVISION (CCTV) ALL PROPOSED SEWERS, 200mm OR GREATER PRIOR TO BASE COURSE ASPHALT. UPON COMPLETION OF CONTRACT, THE CONTRACTOR IS RESPONSIBLE TO FLUSH AND CLEAN ALL SEWERS & APPURTENANCES. PROVIDE A COPY OF ALL CCTV INSPECTION REPORTS TO THE ENGINEER FOR REVIEW.
 - CONTRACTOR TO PROVIDE THE CONSULTANT WITH A GENERAL PLAN OF SERVICES INDICATING ALL APPLICABLE SERVICING AS-BUILT INFORMATION SHOWN ON THIS PLAN. AS-BUILT INFORMATION MUST INCLUDE: PIPE MATERIAL, SIZES, LENGTHS, SLOPES, INVERT AND TIG ELEVATIONS, STRUCTURE LOCATIONS AND ANY ALIGNMENT CHANGES, ETC.
 - THE OWNER SHALL REQUIRE THAT THE SITE SERVICING CONTRACTOR PERFORM FIELD TESTS FOR QUALITY CONTROL OF ALL SANITARY SEWERS. LEAKAGE TESTING SHALL BE COMPLETED IN ACCORDANCE WITH OPSS 410.07-16, 410.07-16.04 AND 407.07.24. DYE TESTING IS TO BE COMPLETED ON ALL SANITARY SERVICES TO CONFIRM PROPER CONNECTION TO THE SANITARY SEWER MAIN. THE FIELD TESTS SHALL BE PERFORMED IN THE PRESENCE OF A CERTIFIED PROFESSIONAL ENGINEER, WHO SHALL SUBMIT A CERTIFIED COPY OF THE TEST RESULTS.

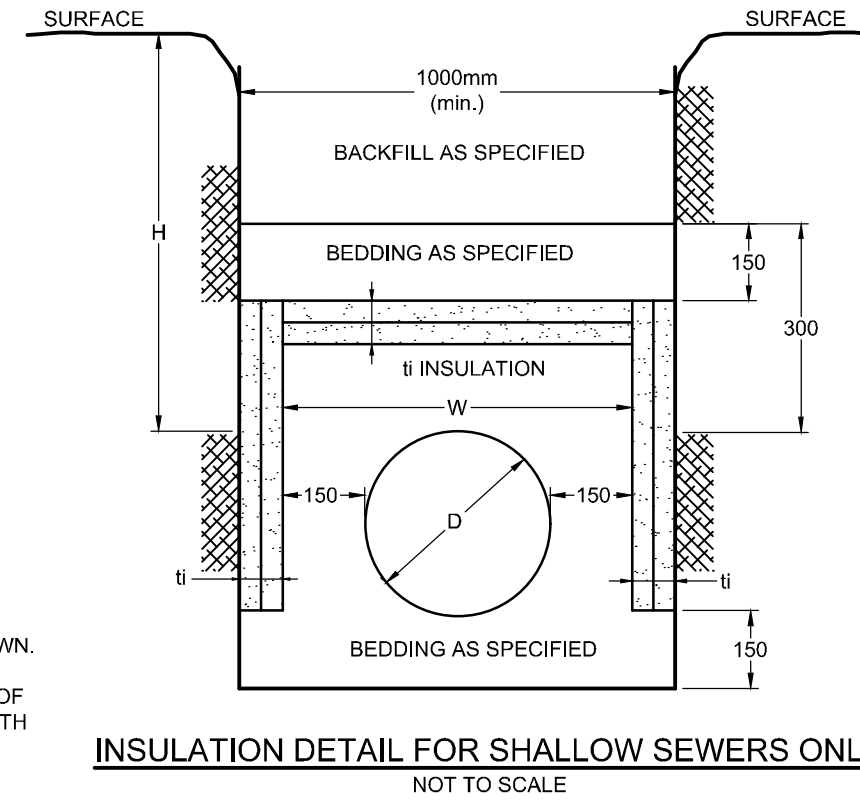

COVER (mm)	INSULATION THICKNESS (mm)
1800-1500	50
1500-1200	75
1200-900	100
900-600	125

i = THICKNESS OF INSULATION (mm)
 h = DEPTH OF COVER
 W = D + 300 (1000 mm.)
 W = WIDTH OF INSULATION (mm)
 D = O.D. OF PIPE (mm)

- ### NOTES:
- INSULATE ALL SEWER PIPES THAT HAVE LESS THAN 1.0m COVER WITH EXPANDED POLYSTYRENE INSULATION AS SHOWN.
 - THE THICKNESS OF INSULATION SHALL BE THE EQUIVALENT OF 25mm FOR EVERY 300mm REDUCTION IN THE REQUIRED DEPTH OF COVER (SEE TABLE).

WATERMAIN NOTES:

- SUPPLY AND CONSTRUCT ALL WATERMAIN AND APPURTENANCES IN ACCORDANCE WITH THE MOST CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS.
- SPECIFICATIONS:

ITEM	SPEC. No.	REFERENCE
WATERMAIN TRENCHING	W17	CITY OF OTTAWA
THERMAL INSULATION IN SHALLOW TRENCHES	W22	CITY OF OTTAWA
THERMAL INSULATION BY OPEN STRUCTURES	W23	CITY OF OTTAWA
VALVE BOX ASSEMBLY	W24	CITY OF OTTAWA
WATERMAIN CROSSING BELOW SEWERS	W25	CITY OF OTTAWA
CATHODIC PROTECTION FOR PVC WATERMANS	W40	CITY OF OTTAWA
WATERMAIN MATERIAL	PVC DR 18 (100mm AND LARGER)	
- EXCAVATION, INSTALLATION, BACKFILL AND RESTORATION OF ALL WATERMANS BY THE CONTRACTOR. CONNECTIONS AND SHUT-OFFS AT THE MAIN AND CHLORINATION OF THE WATER SYSTEM SHALL BE PERFORMED BY CITY OFFICIALS. EXCAVATION, INSTALLATION OF SERVICE, BACKFILL AND RESTORATION BY THE CONTRACTOR.
- WATERMAIN SHALL BE MINIMUM 2.4m DEPTH BELOW GRADE UNLESS OTHERWISE INDICATED.
- PROVIDE MINIMUM 0.5m CLEARANCE BETWEEN OUTSIDE OF PIPES AT ALL CROSSINGS, UNLESS OTHERWISE INDICATED.
- WATER SERVICE IS TO BE CONSTRUCTED TO WITHIN 1.0m OF FOUNDATION WALL AND CAPPED, UNLESS OTHERWISE INDICATED.

150mmØ WATER SERVICE TABLE (WEST)

STATION	SURFACE ELEVATION	T/W/M ELEVATION	COMMENTS
0+00	70.17±	67.77±	150mmØ WM CONNECTION TO EX. 200mmØ DI WM
0+03.1	70.15	67.75	CROSS BELOW EX. 200mm GAS (CLEARANCE = ±1.3m)
0+07.3	70.24	67.82	CROSS BELOW EX. 542mm HYDRO DUCT (CLEARANCE = ±1.2m)
0+09.3	70.29	67.84	150mmØ V&VB
0+09.8	70.31	67.85	CAP 0.5m FROM FOUNDATION WALL

150mmØ WATER SERVICE TABLE (EAST)

STATION	SURFACE ELEVATION	T/W/M ELEVATION	COMMENTS
1+00	70.17±	67.77±	150mmØ WM CONNECTION TO EX. 200mmØ DI WM
1+03.1	70.15	67.75	CROSS BELOW EX. 200mm GAS (CLEARANCE = ±1.3m)
1+07.3	70.22	67.82	CROSS BELOW EX. 542mm HYDRO DUCT (CLEARANCE = ±1.2m)
1+09.3	70.27	67.84	150mmØ V&VB
1+09.8	70.29	67.85	CAP 0.5m FROM FOUNDATION WALL

* CONNECTIONS TO EXISTING 200mmØ DI. EXACT ELEVATIONS TO BE FIELD DETERMINED.
 ** PROVIDE THERMAL INSULATION AS PER CITY OF OTTAWA DETAIL W22 IN SHALLOW TRENCHES AND/OR CITY OF OTTAWA DETAIL W23 ADJACENT TO OPEN STRUCTURES.

NOTE:
 THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

OWNER INFORMATION
 100 ARGYLE CORPORATION
 BONNIE MARTELL C/O COLONNADE BRIDGEPORT
 200-16 CONCOURSE GATE
 OTTAWA, ON K2E 7S8
 TEL: 613-225-8118
 bmartell@colonnadebridgeport.ca

No.	REVISION	DATE	BY
1	ISSUED FOR SITE PLAN APPROVAL	AUG 13/21	FST

DESIGN	CHECKED	DRAWN	APPROVED
DWM	FST	DWM	FST

SCALE: 1:150

FOR REVIEW ONLY

NOVATECH
 Engineers, Planners & Landscape Architects
 Suite 200, 240 Michael Cowpland Drive
 Ottawa, Ontario, Canada K2M 1P6
 Telephone: (613) 254-9643
 Facsimile: (613) 254-5867
 Website: www.novatech-eng.com

LOCATION
 CITY OF OTTAWA
 100 ARGYLE AVENUE

DRAWING NAME
 GENERAL PLAN OF SERVICES

PROJECT No.
 118116

REV #1

DRAWING No.
 118116-GP

M:\2021\118116\GP\Drawings\118116-GP.dwg, GP, Aug 13, 2021, 2:20pm, amhuthu