



PROJECT:

**LIB KANATA
KANATA AVENUE AND MARITIME WAY
CITY OF OTTAWA, ONTARIO**

PROJECT NO:

600401

DATE:

2022-03-23



160, boulevard de l'Hôpital, Gatineau (Québec) J8T 8J1
T 819 303 2700
info@equipelaurence.ca | equipelaurence.ca

**LIB KANATA - KANATA AVENUE AND MARITIME WAY
PROJET 600401 - PLANS ÉMIS FOR SITE PLAN APPLICATION REVISION 3, LE 2022-03-23**

007-12-21-0153

TECHNICAL AND GENERAL SPECIFICATIONS

1.0 GENERAL SPECIFICATIONS

All work shall conform with Ontario building code, latest edition as well as local regulation and bylaws.

Contractor to verify all dimensions and report any discrepancies to the engineer immediately to get design confirmation before proceeding with construction.

Refer to the City of Ottawa for regulations and standards (supersedes provincial standards).

Refer to Ontario Provincial Standards for Roads and Public Works - Volume 3 for details.

Ontario provincial standards for roads and public works must also be respected.

Work to be performed in accordance with the Occupational Health and Safety Act and Regulations for Construction Projects.

All materials shall meet all current applicable standards set by the American Water Works Association ("AWWA"), Canadian Standards Association ("CSA"), the American National Standards Institute ("ANSI") safety criteria standards, American Society for Testing and Materials (ASTM), NSF/14, NSF/60 and NSF/61.

The Contractor will get approval for all materials selection from the Civil Engineer prior to delivery to the site.

BUILDING OWNER: EMD BATIMO

CONSULTING CIVIL ENGINEER: ÉQUIPE LAURENCE INC.

2.0 GENERAL INFORMATIONS

2.1 UNDERGROUND SERVICES

The plans show certain underground installations for the sole purpose to highlight the existence of cables, pipelines and underground structures. In the sectors where work must be performed, the contractor is responsible to verify himself with the competent authorities the existence and actual location of all cables, pipelines and existing underground structures that may affect the works.

Before beginning excavations, the contractor must thus contact the Ontario One Call (www.on1call.com), the municipal authorities and all other stake holders in order to identify on the field all existing underground structures whether they are shown on the plans or not.

He is responsible for damages to cables, pipelines and underground structures. No cost variation resulting from underground structures not shown or poorly located on the plans can be claimed against the building owner. Following the review of the plans and specifications, the contractor must notify the engineer of any error, omission or discrepancy noted by him before starting work.

2.2 EXISTING WATERMAIN AND SEWER CONDUITS

The location of the watermain and sewer pipes is approximate. The contractor must verify and validate the position and depth of the pipes by the means of meticulous excavations. Should discrepancies be observed, they must be provided to the engineer without delay in order that the required modifications are made to the construction plans. The contractor will have to coordinate with the city, the connecting works to the existing networks (watermain and sewers). No service interruption shall take place without the building owner's authorization or the relevant authorities.

2.3 PROTECTION AGAINST EROSION

As per "Erosion and sediment control guideline for urban construction"
In all areas of the building site where there is a risk of erosion, the ground must be stabilized. Runoff water must be intercepted and routed to stabilized areas and this, throughout the construction period. The contractor must use the recognized methods to prevent the transport of sediments.

- Sediment barrier
- Mud mat
- Sedimentation pond
- Filtering berm and sediment trap
- Straw bale filter

Any intervention on the building site which may cause the transfer of sediments must be simultaneously accompanied by sediment capture measures.

2.4 DRAINING OF THE EXCAVATIONS

The contractor shall take all necessary precautions to prevent the penetration of surface waters and to evacuate surface, underground or sewer waters. Waste waters must be directed towards a combined sewer or a sanitary sewer and the surface and underground waters towards a storm sewer, a combined sewer or a ditch. In all cases, the diversion site must be submitted for approval.
The contractor must assume all required pumping and cleaning costs.

2.5 PAVEMENT PROTECTION

At all times, the movement of machinery and metal tracked vehicles is prohibited on paved surfaces unless plywood sheets with a 20mm normal thickness or rubber with a 12.5mm thickness are used in order to avoid damaging pavement. All repairs or complete replacements of pavement is the contractor's responsibility, who will have to pay all the costs.

2.6 CLEANING OF SITE

At the end of the construction works and as often as requested by the project superintendent, the contractor must clean and eliminate all construction generated debris and restore all construction affected areas. The cleaning of the construction site is included in the global market unit prices.

3.0 SITE GRADING

Surface topsoil layer stripping required.
Low-lying areas may be filled by utilising soil cut from higher areas and by importing suitable fill materials.


The approved subgrade may be raised to design subgrade level with approved compactable on-site soil, providing it is placed in maximum 300 mm thick lifts and each lift is compacted to at least 95% of the material's SPMDD. As an alternative to subexcavation, a woven geotextile separator, such as Terratrack 24-15, Amoco 2002, Mirafri 500XL or equivalent, may be placed over spongy areas prior to placing the Granular 'B' sub-base layer.

4.0 CONCRETE WORKS

All weather exposed concrete shall have 5 to 8% air entrainment or as otherwise specified in Tables 2 and 4 of CSA A23.1.

Concrete sidewalk as per OPSD 310.010. Foundation consist of 150 mm minimum of granular 'A' material. Sidewalk concrete thickness shall be 200 mm.

Concrete barrier curb as per OPSD 600.110. Foundation consist of 150 mm minimum of granular 'A' material.

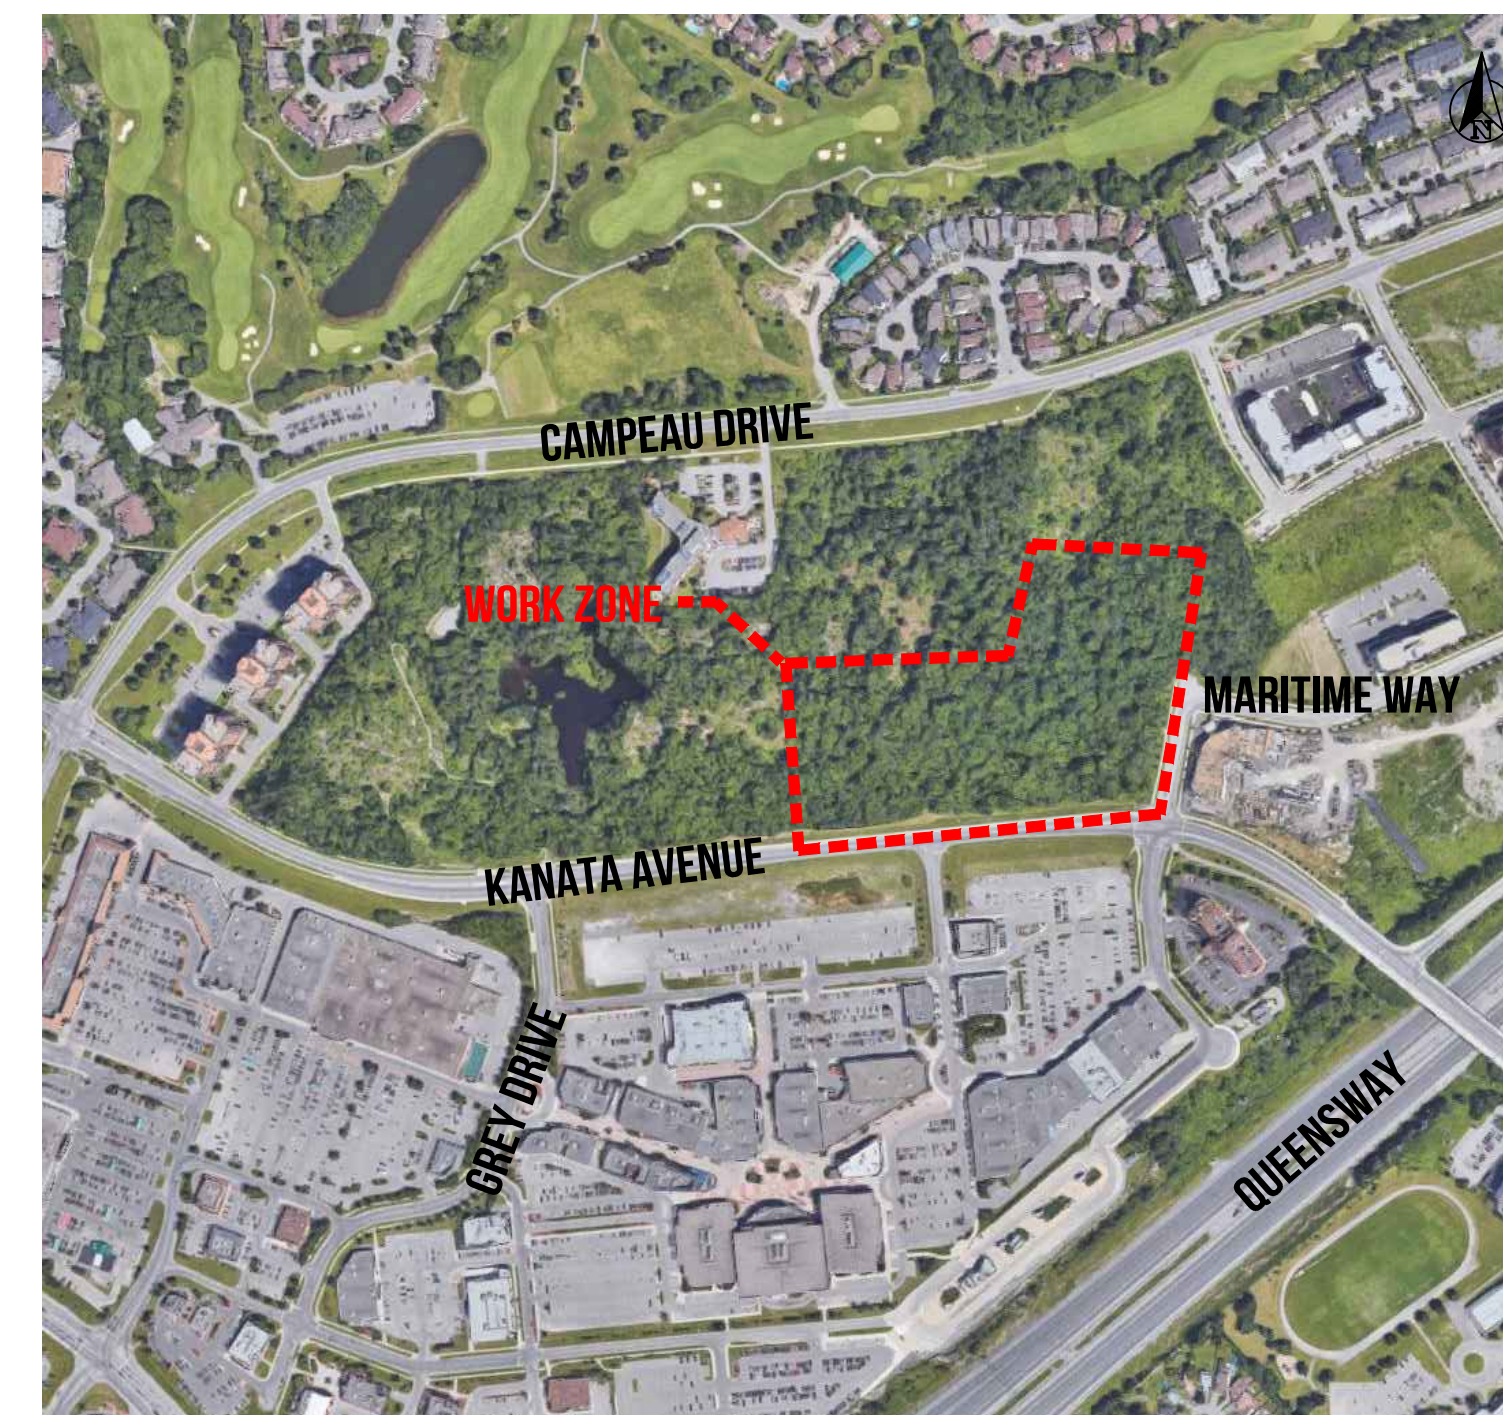

PROJECT LOCATION
NO SCALE

CIVIL ENGINEERING LEGEND

| | |
|--|---|
| | EXISTING BUILDING |
| | PROPOSED BUILDING |
| | BOTTOM OF EMBANKMENT |
| | TOP OF EMBANKMENT |
| | DITCH CENTER |
| | DITCH TO BE REMOVED |
| | DITCH CENTER WITH ROCK FILL PROTECTION |
| | EXISTING FENCE |
| | FENCE TO BE REMOVED |
| | PROPOSED FENCE |
| | SILT FENCE BARRIER |
| | ISOLATED WETLAND |
| | EXISTING TREE |
| | WOODED AREA |
| | WOODED AREA TO BE REMOVED |
| | OVERLAND FLOW ROUTE |
| | GUARDRAIL |
| | STONE RETAINING WALL |
| | EXISTING FIRE HYDRANT |
| | PROPOSED FIRE HYDRANT |
| | EXISTING WATER SERVICE VALVE |
| | PROPOSED WATER SERVICE VALVE |
| | EXISTING WATER PIPE |
| | EXISTING WATER PIPE TO BE REMOVED |
| | PROPOSED WATER PIPE |
| | EXISTING DRINKING WATER SERVICE CONNECTION |
| | PROPOSED DRINKING WATER SERVICE CONNECTION |
| | EXISTING SANITARY SEWER AND MANHOLE |
| | PROPOSED SANITARY SEWER AND MANHOLE |
| | SANITARY SEWER AND MANHOLE TO BE REMOVED |
| | EXISTING STORM SEWER PIPE AND MANHOLE |
| | PROPOSED STORM SEWER PIPE AND MANHOLE |
| | STORM SEWER AND MANHOLE TO BE REMOVED |
| | CULVERT |
| | EXISTING CATCH BASIN OR MANHOLE-CATCH BASIN |
| | PROPOSED CATCH BASIN OR MANHOLE-CATCH BASIN |
| | EXISTING STORM SEWER MANHOLE |
| | PROPOSED STORM SEWER MANHOLE |
| | EXISTING SANITARY SEWER MANHOLE |
| | PROPOSED SANITARY SEWER MANHOLE |
| | LIGHTNING UNIT |
| | OVERHEAD WIRING AND GUY WIRE |
| | EXISTING GAS PIPELINE |
| | BELL CANADA UNDERGROUND CABLE |
| | UNDERGROUND ELECTRICAL WIRE |
| | PROPOSED ASPHALT SURFACE |
| | PROPOSED CONCRETE SIDEWALK/SLAB |
| | PAVER SIDEWALK |
| | PROPOSED GRASS SURFACE |
| | GRANULAR SURFACE |
| | PROPOSED TEMPORARY MUD MAT |
| | PROPOSED STONES SURFACE |
| | PROPOSED GRANITE STONES |
| | EXISTING ASPHALT SURFACE TO BE REMOVED |
| | EXISTING SURFACE TO BE REMOVED |
| | PROPOSED ELEVATION |
| | PROPOSED ELEVATION OF CONCRETE CURB |
| | PROPOSED ELEVATION OF CONCRETE SLAB |
| | PROPOSED TOP ELEVATION OF GRASS |
| | PROPOSED TOP ELEVATION OF SIDEWALK |
| | PROPOSED TOP ELEVATION OF RETAINING WALL |
| | PROPOSED BOTTOM ELEVATION OF RETAINING WALL |
| | EXISTING ELEVATION OF SURFACE |
| | GRADING SLOPES |
| | NORTH |

LIST OF PLANS

| | |
|-------|--|
| C-201 | TECHNICAL AND GENERAL SPECIFICATIONS, LEGEND AND NOTES LOCATION |
| C-202 | PLAN VIEW EXISTING ITEMS, DEMOLITION AND EROSION AND SEDIMENT CONTROL PLAN |
| C-203 | SITE GRADING PLAN |
| C-204 | SITE SERVING PLAN AND DRAINAGE AREA |
| C-205 | STANDARD SECTIONS AND DETAILS |
| C-206 | STANDARD SECTIONS AND DETAILS II |
| C-207 | FIRE HYDRANT COVERAGE MAP |

| REV | DESCRIPTION | BY | DATE |
|-----|--------------------------------------|------|------------|
| D | FOR SITE PLAN APPLICATION REVISION 3 | A.L. | 2022-03-23 |
| C | FOR SITE PLAN APPLICATION REVISION 2 | A.L. | 2021-10-07 |
| B | FOR SITE PLAN APPLICATION REVISION 1 | A.L. | 2021-09-24 |
| A | FOR SITE PLAN APPLICATION | A.L. | 2021-09-17 |

CLIENT:

PROJECT:
LIB KANATA
KANATA AVENUE AND MARITIME WAY
CITY OF OTTAWA, ONTARIO

733, chemin Jean-Adam, Piedmont (Dobac) J0R 1R3
T. 450 227 1857
info@equipe-laurence.ca | equipe-laurence.ca

TITLE:
TECHNICAL AND GENERAL SPECIFICATIONS, LEGEND AND NOTES LOCATION

SCALE: NO SCALE

| | |
|--------------------------------|------------|
| B. BRAY, ing. / L. MENARD, CPI | C-201.dwg |
| DESIGN | DRAWING |
| F. LANDRY | 2021-09-14 |
| DRAWN | DATE |
| A. LATOUR, ing. | 600401 |
| APPROVED | PROJECT NO |
| | PLAN NO |

EROSION AND SEDIMENT CONTROL

- PRE-CONSTRUCTION**
 PRIOR TO ANY REMOVAL OF SOIL AND CONSTRUCTION,
 - INSTALL SILT FENCE (GEOTEXTILE) AS NOTED
 - INSTALL FILTER CLOTH OVER ALL EXISTING MANHOLE IN CONSTRUCTION ZONE
 - CONTROL MEASURES TO BE INSPECTED ONCE INSTALLED.
 - CONSTRUCTION OF MUD MATS, SEE CONTRACTOR FOR LOCATION.
- CONSTRUCTION**
 - MINIMIZE THE EXTENT OF DISTURBED AREAS.
 - PROTECT DISTURBED AREAS OF RUNOFF.
 - PROVIDE COVER (I.E. MULCH) IF DISTURBED AREAS WILL NOT BE REINSTATED WITHIN A REASONABLE PERIOD OF TIME.
 - INSPECT SILT FENCE REGULARLY DURING CONSTRUCTION. CLEAN AND REPAIR, AS REQUIRED.
 - CONTROL DUST DURING CONSTRUCTION.
- AFTER CONSTRUCTION**
 - PROVIDE PERMANENT COVER TO DISTURBED AREAS (I.E. TOPSOIL AND SEED)
 - REMOVE ALL TEMPORARY EROSION AND SEDIMENT CONTROL ITEMS (SILT FENCE AND FILTER CLOTHS) ONCE DISTURBED AREAS HAVE BEEN REINSTATED.
- INSPECTIONS**
 - EROSION AND SEDIMENT CONTROL MEASURES WILL BE INSPECTED UPON COMPLETION.
 - CONTROL MEASURES ARE TO BE INSPECTED WEEKLY.
- CONTRACTOR TO BE RESPONSIBLE FOR INSTALLATION, INSPECTIONS AND MAINTENANCE OF ALL SEDIMENT AND EROSION CONTROL MEASURES.


NOTE:
 THE EXISTING AND PROPOSED SUBDIVISION WILL HAVE TO BE VALIDATED BY THE SURVEYOR-GEOMETER ON FILE.

SURVEY AND LOTS INFORMATION PROVIDED BY FARLEY, SMITH & DENIS SURVEYING LTD.
 DATE: SEPTEMBER 13 2021
 FILE NO.: 139-21
 PLANIMETRIC REFERENCE SYSTEM: MTM NAD 83 ZONE 9
 ALTIMETRIC REFERENCE SYSTEM: CGVD28 HT2.0

SITE PLAN PREPARED BY ROSSMANN ARCHITECTURE
 DATE: SEPTEMBER 21 2021
 PROJECT: 21019

EXISTING POWER DUCT BANK, WATERMAIN, STORM SEWER AND SANITARY SEWER FROM OTTAWA COORDINATING COMMITTEE CENTRAL REGISTRY AND CITY OF KANATA DEPARTMENT OF ENGINEERING

THE CONTRACTOR MUST NOTIFY ÉQUIPE LAURENCE, THE CONSULTANT, IF HE NOTICES ANY DISCREPANCIES BETWEEN THE INFORMATION PRESENTED ON THE PLANS AND THE MEASUREMENTS TAKEN ON SITE SO THAT ADJUSTMENTS CAN BE MADE.
 WHEN APPLICABLE, HE MUST ALSO VERIFY THE ELEVATIONS OF EXISTING SEWERS BEFORE STARTING CONSTRUCTION AND MUST PROVIDE THE INFORMATION TO THE CONSULTANT.

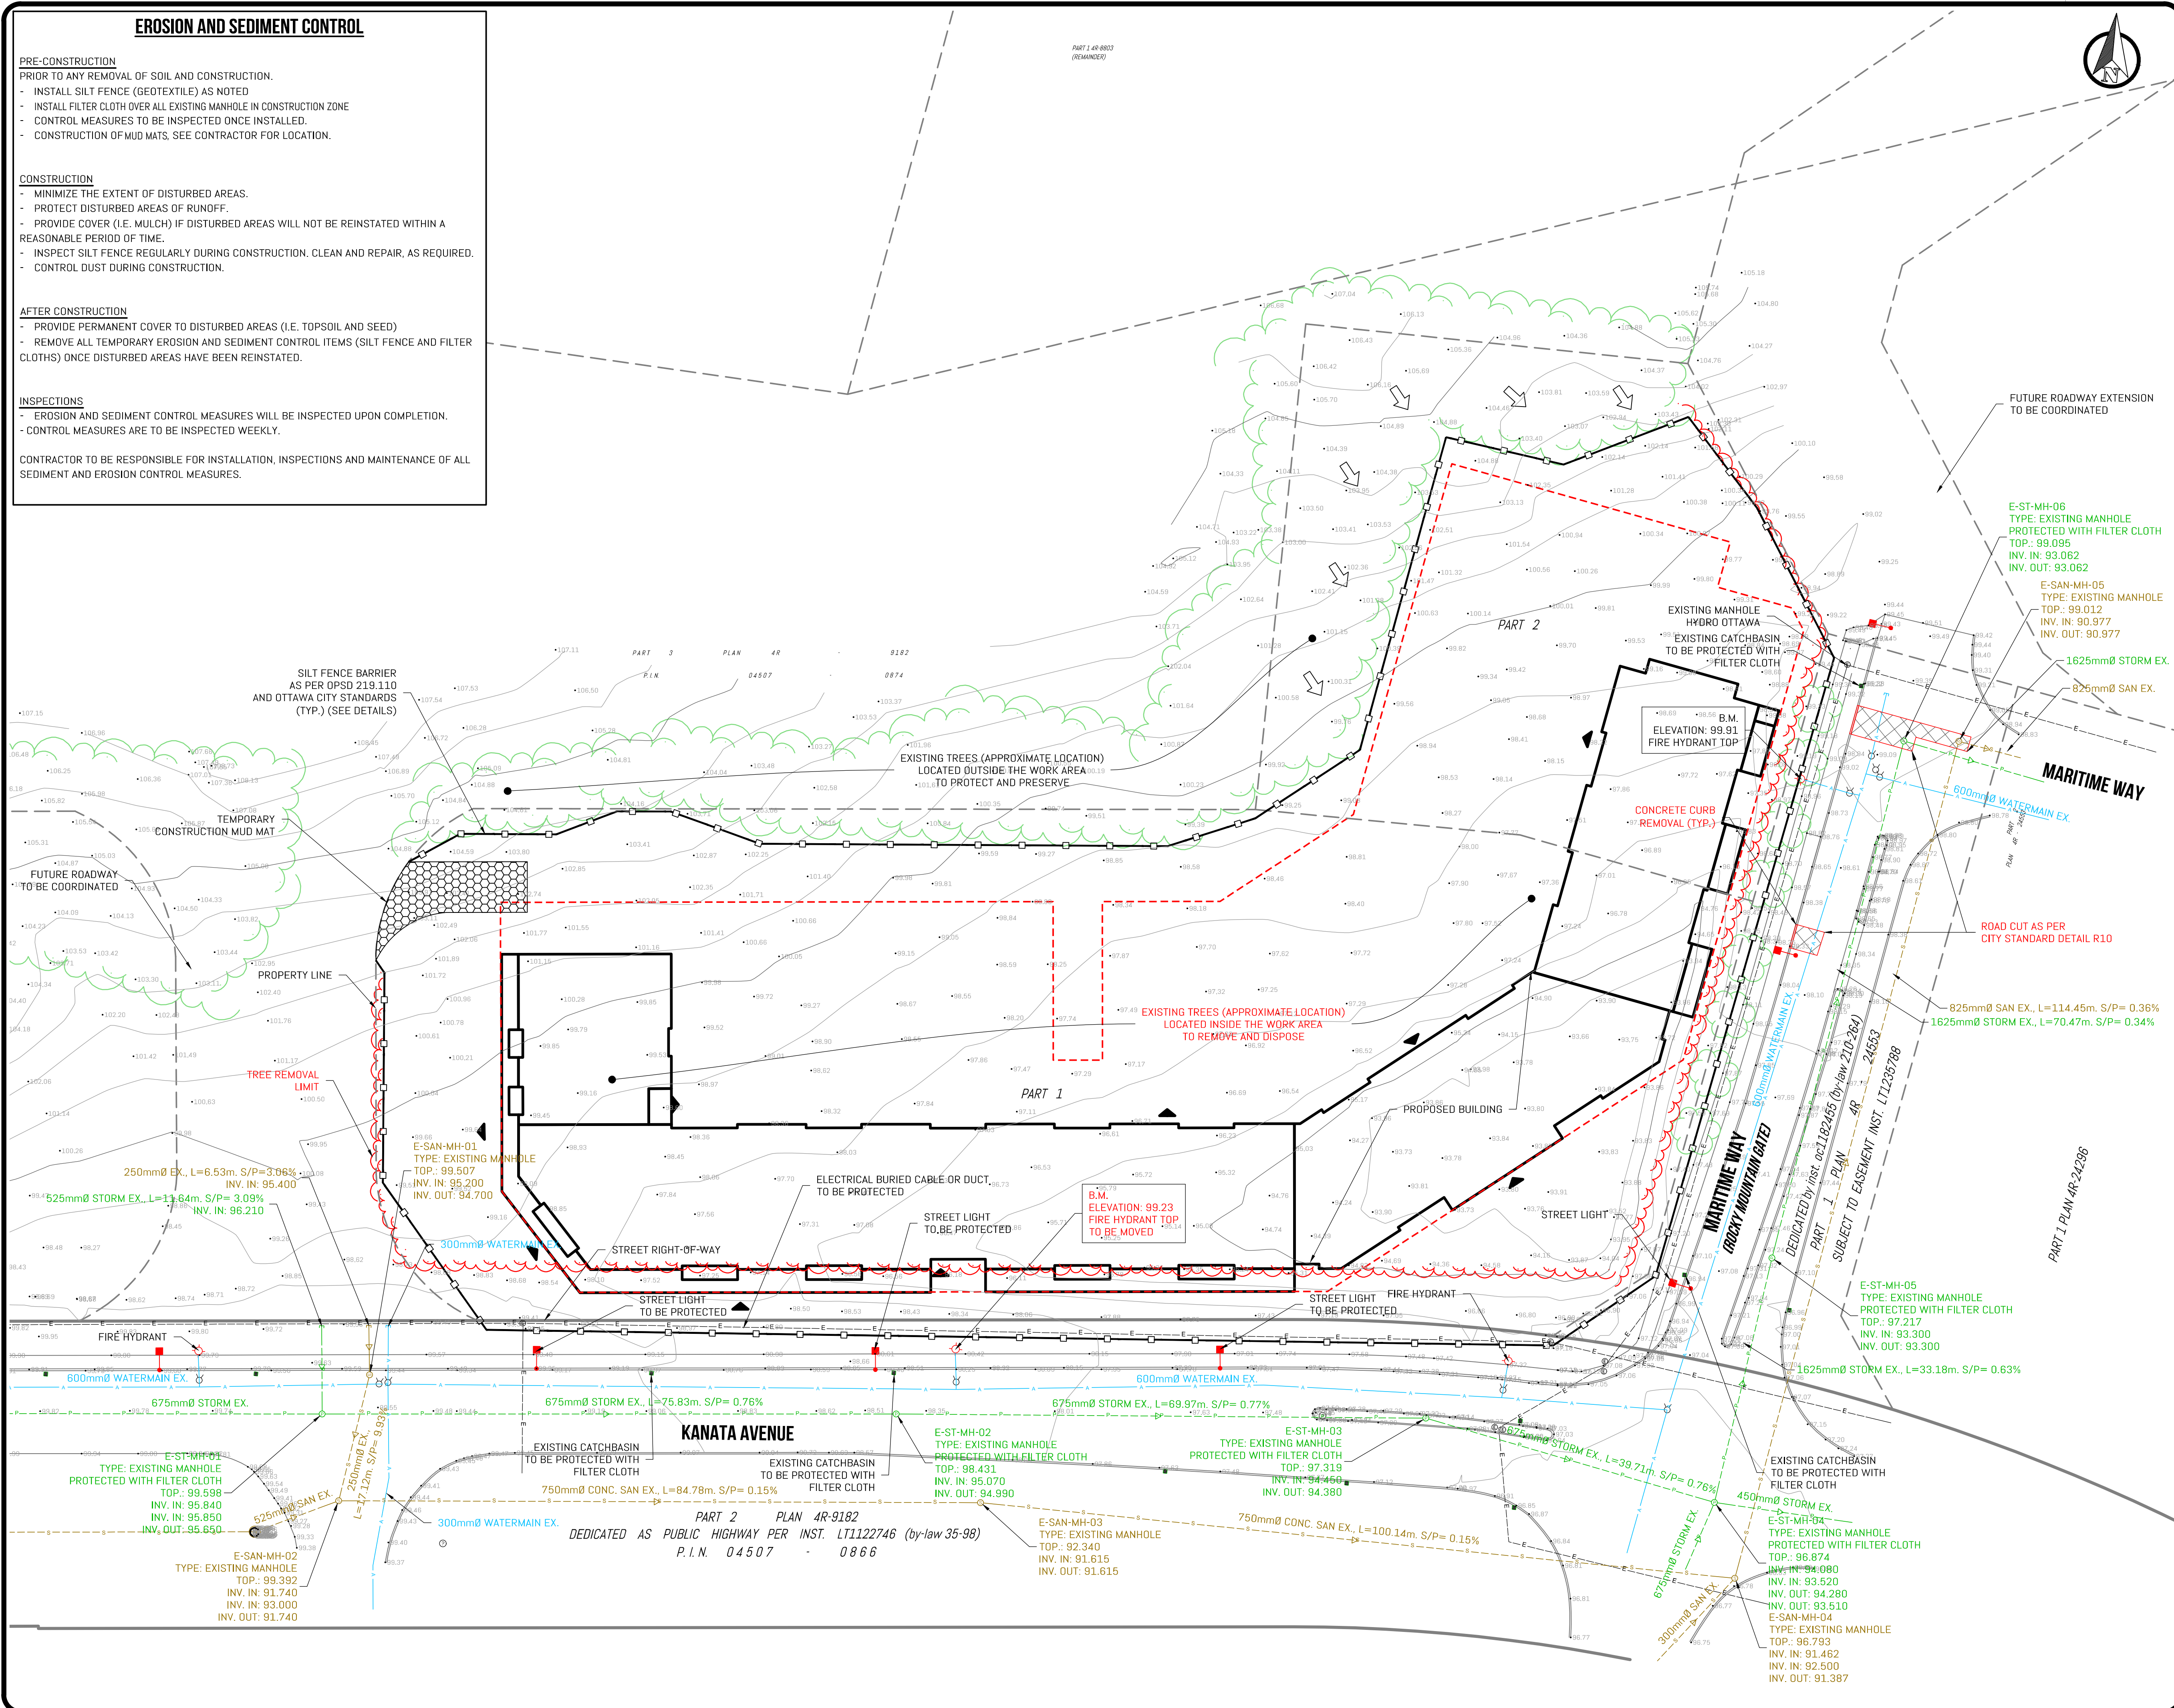

| REV | DESCRIPTION | BY | DATE |
|-----|--------------------------------------|------|------------|
| D | FOR SITE PLAN APPLICATION REVISION 3 | A.L. | 2022-03-23 |
| C | FOR SITE PLAN APPLICATION REVISION 2 | A.L. | 2021-10-07 |
| B | FOR SITE PLAN APPLICATION REVISION 1 | A.L. | 2021-09-24 |
| A | FOR SITE PLAN APPLICATION | A.L. | 2021-09-17 |

CLIENT: **emo batimo**
 CONSTRUCTION PROMOTEUR ET GESTIONNAIRE IMMOBILIERS

PROJECT: **LIB KANATA**
 KANATA AVENUE AND MARITIME WAY
 CITY OF OTTAWA, ONTARIO

ÉQUIPE LAURENCE
 INGÉNIERIE CIVILE

733, chemin Jean-Adam, Piedmont (Dubreuc) J0R 1R3
 T. 450 227 1857
 info@equipe-laurence.ca | equipe-laurence.ca




TITLE: **PLAN VIEW**
 EXISTING ITEMS, DEMOLITION AND
 EROSION AND SEDIMENT CONTROL PLAN

SCALE: Horizontal 1:400

| | |
|-------------------------------|--------------------|
| B. BRAY, ing. / L.MENARD, CPI | C-202.dwg |
| F. LANDRY | DRAWING 2021-09-14 |
| A. LATOUR, ing. | DATE 600401 |
| | PROJECT NO C-202 |
| | PLAN NO |

File: \projets\600401\15_Plan-C-202.dwg, 2022-03-23 18:39:46, omontsej

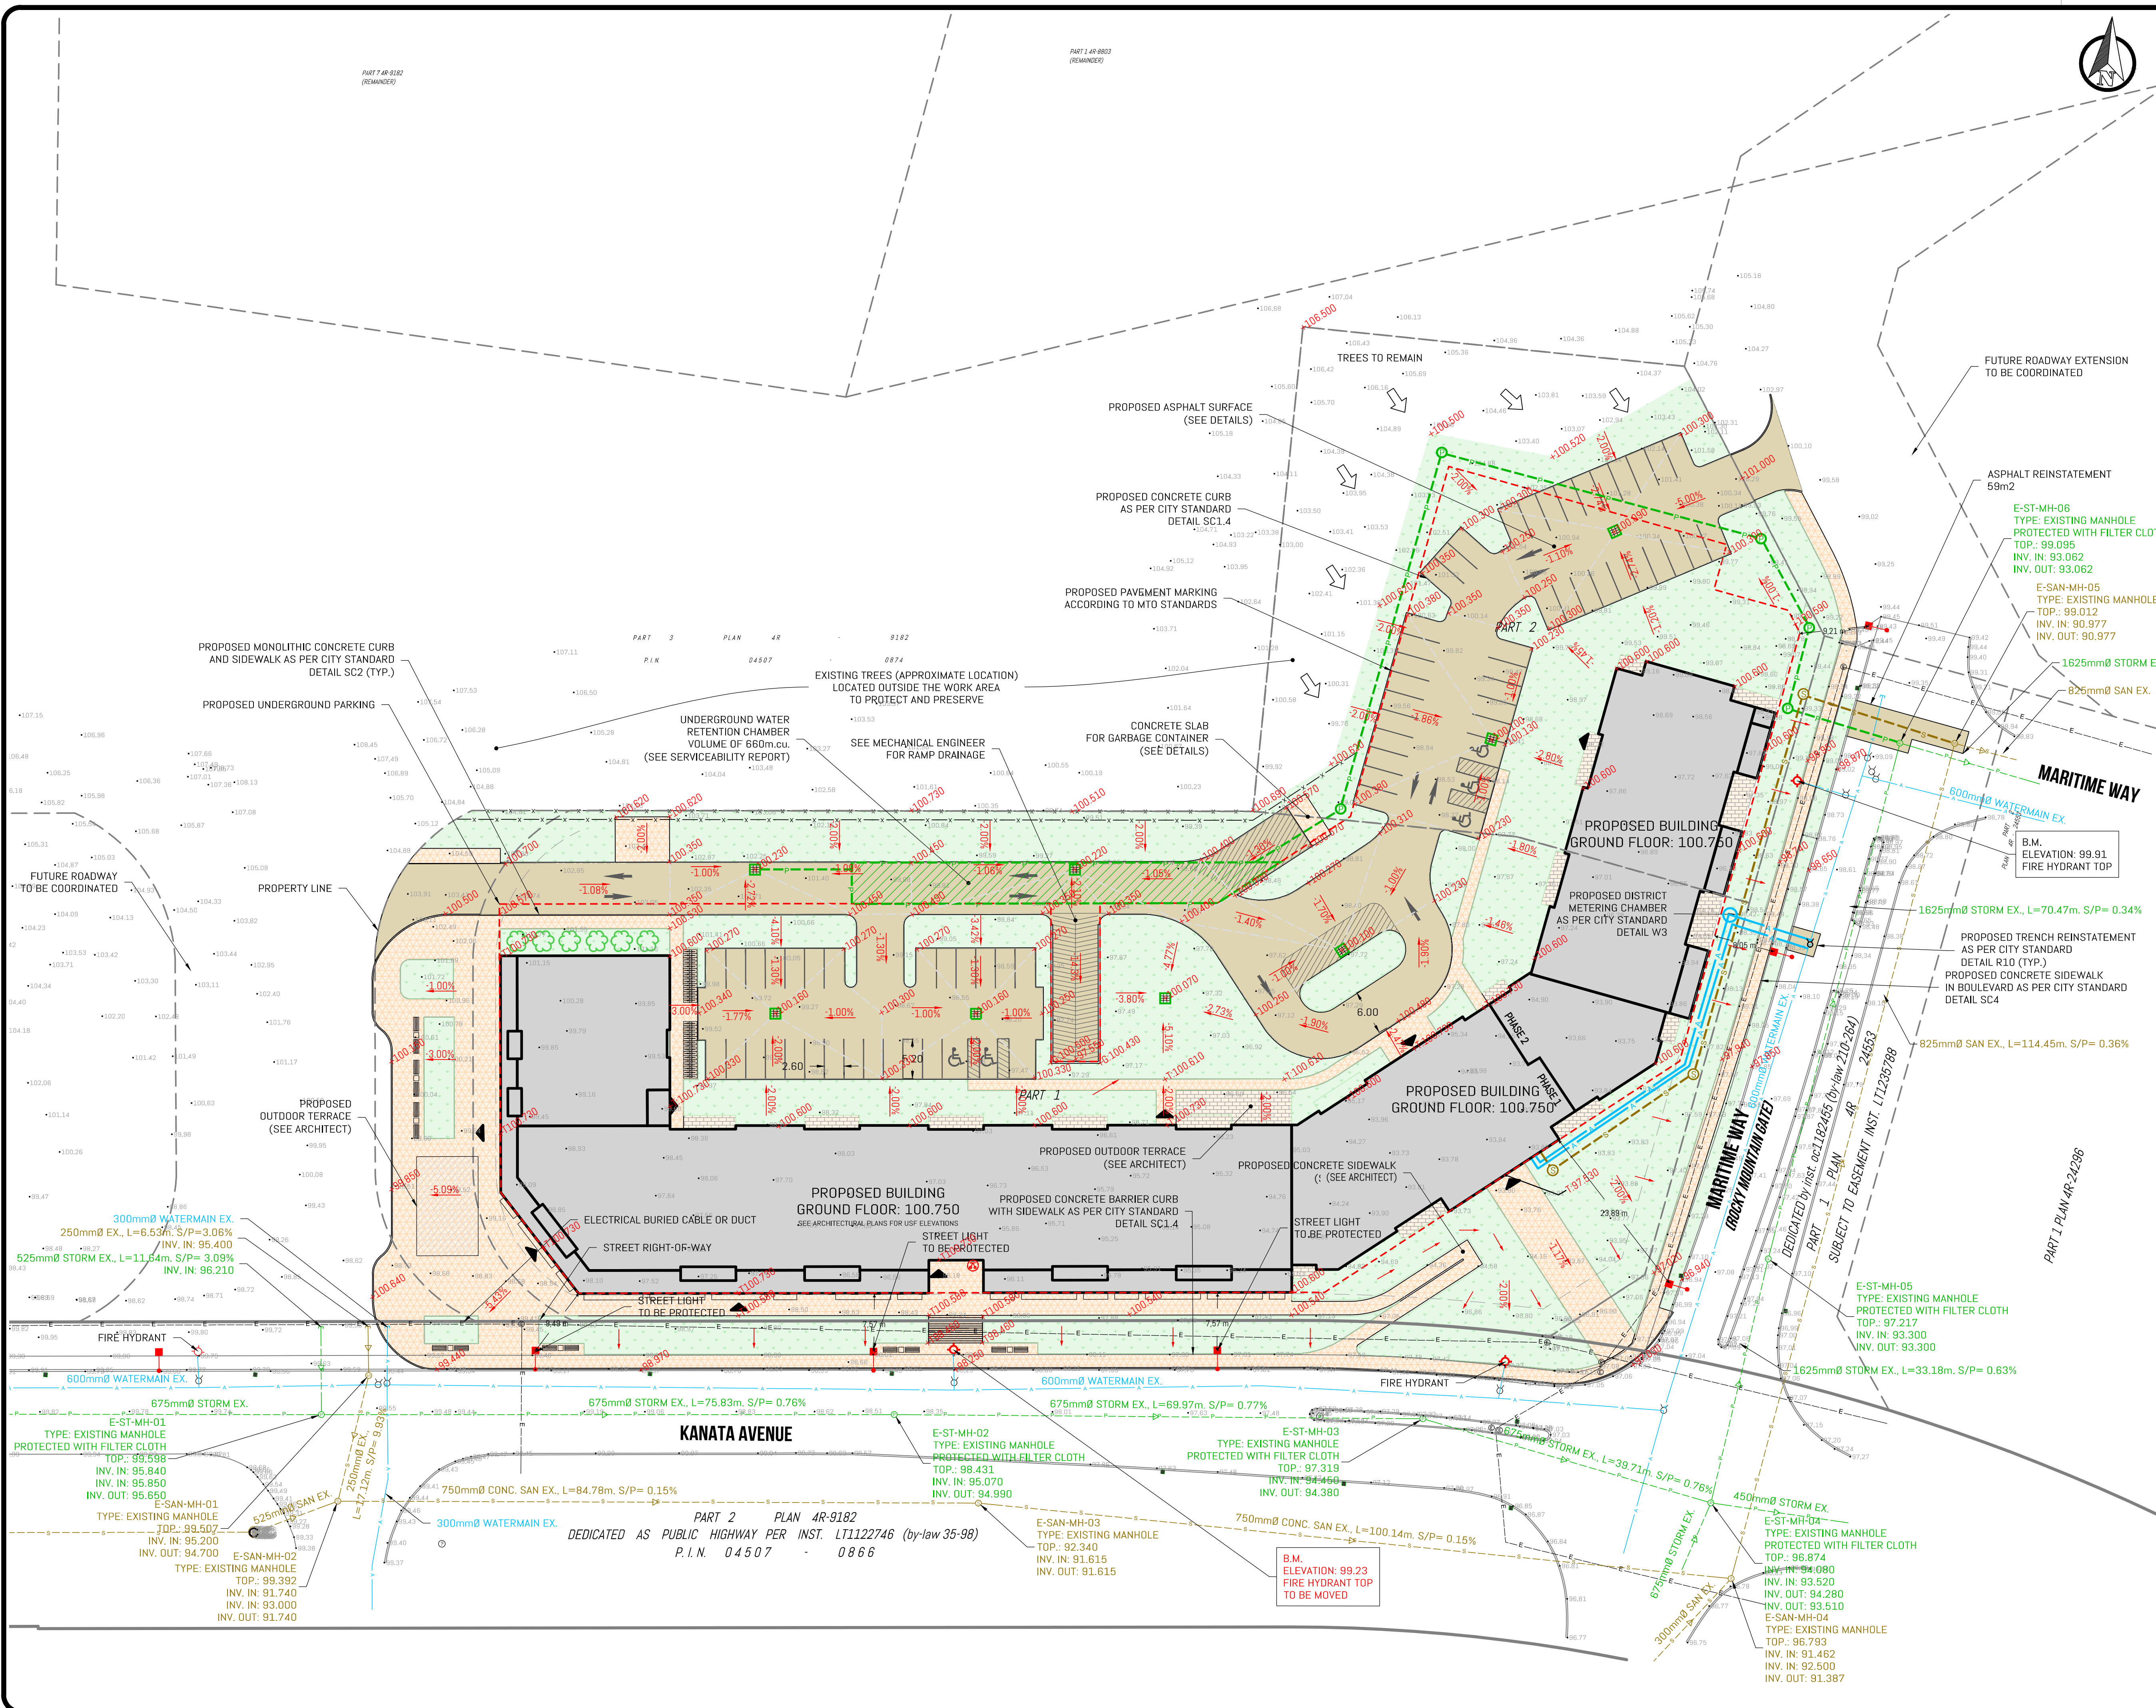

NOTE:

THE EXISTING AND PROPOSED SUBDIVISION WILL HAVE TO BE VALIDATED BY THE SURVEYOR-GEOMETER ON FILE.

SURVEY AND LOTS INFORMATION PROVIDED BY FARLEY, SMITH & DENIS SURVEYING LTD.
DATE: SEPTEMBER 13 2021
FILE NO.: 139-21
PLANIMETRIC REFERENCE SYSTEM: MTM NAD 83 ZONE 9
ALTIMETRIC REFERENCE SYSTEM: CGVD28 HT2.0

SITE PLAN PREPARED BY
ROSSMANN
ARCHITECTURE
DATE: MARCH 17 2022
PROJECT: 21019

EXISTING POWER DUCT BANK, WATERMAIN, STORM SEWER AND SANITARY SEWER FROM OTTAWA COORDINATING COMMITTEE CENTRAL REGISTRY AND CITY OF KANATA DEPARTMENT OF ENGINEERING

UNLESS OTHERWISE STATED, ALL PROPOSED ELEVATIONS SHOWN ON PLAN REPRESENT THE ELEVATION OF THE PAVEMENT SURFACE /PROJECTED TERRAIN.
ADD 0.15m TO SEE THE ELEVATION OF THE SIDEWALK OR ADJACENT

THE CONTRACTOR MUST NOTIFY ÉQUIPE LAURENCE, THE CONSULTANT, IF HE NOTICES ANY DISCREPANCIES BETWEEN THE INFORMATION TAKEN ON THE PLANS AND THE MEASUREMENTS TAKEN ON SITE SO THAT ADJUSTMENTS CAN BE MADE.
WHEN APPLICABLE, HE MUST ALSO VERIFY THE ELEVATIONS OF EXISTING SEWERS BEFORE STARTING CONSTRUCTION AND MUST PROVIDE THE INFORMATION TO THE CONSULTANT.

| REV | DESCRIPTION | BY | DATE |
|-----|--------------------------------------|------|------------|
| D | FOR SITE PLAN APPLICATION REVISION 3 | A.L. | 2022-03-23 |
| C | FOR SITE PLAN APPLICATION REVISION 2 | A.L. | 2021-10-07 |
| B | FOR SITE PLAN APPLICATION REVISION 1 | A.L. | 2021-09-24 |
| A | FOR SITE PLAN APPLICATION | A.L. | 2021-09-17 |

CLIENT: **emo batimo**
CONSTRUCTION PROMOTEUR DE GESTIONNAIRE IMMOBILIER


PROJECT: **LIB KANATA**
KANATA AVENUE AND MARITIME WAY
CITY OF OTTAWA, ONTARIO

LAURENCE
ÉQUIPE
INGÉNIERIE CIVILE

733, chemin Jean-Adam, Piedmont (Dubreuc) J0R 1R3
T 450 227 1857
info@equipe-laurence.ca | equipe-laurence.ca



TITLE: **SITE GRADING PLAN**



| | |
|--------------------------------|------------|
| B. BRAY, ing. / L. MENARD, CPI | C-203.dwg |
| F. LANDRY | DRAWING |
| A. LATOUR, ing. | DATE |
| APPROVED | PROJECT NO |
| | PLAN NO |

STRUCTURE TABLE - STORM SEWER

| NAME | DETAILS | ELEVATIONS/INVERTS |
|----------|--|---|
| ST-MH-01 | 915mm | INV. IN: 97.490 INV. OUT: 97.440 SUMP: 97.440 |
| ST-MH-02 | 915mm | INV. IN: 97.200 INV. OUT: 97.150 SUMP: 97.150 |
| ST-MH-03 | 915mm | INV. IN: 96.940 INV. OUT: 96.890 SUMP: 96.890 |
| ST-MH-04 | 915mm | INV. IN: 96.830 INV. OUT: 96.780 SUMP: 96.780 |
| ST-MH-05 | 1200mm WITH FLOWRATE REGULATOR SEE SERVICEABILITY REPORT | INV. IN: 96.730 INV. OUT: 96.680 SUMP: 96.230 |

STRUCTURE TABLE - STORM SEWER

| NAME | DETAILS | ELEVATIONS/INVERTS | RUNOFF COEFFICIENT (Cr) | SURFACE AREA (ha) |
|-------|----------------|------------------------------|-------------------------|-------------------|
| CB-01 | SEE MECHANICAL | TOP: 100.090 | 0,573 | 0,232 |
| CB-02 | SEE MECHANICAL | TOP: 100.100 | 0,710 | 0,127 |
| CB-03 | SEE MECHANICAL | TOP: 100.100 | 0,913 | 0,133 |
| CB-04 | SEE MECHANICAL | TOP: 100.070 | 0,950 | 0,062 |
| CB-05 | SEE MECHANICAL | TOP: 100.220 | 0,640 | 0,050 |
| CB-06 | SEE MECHANICAL | TOP: 100.160 | 0,950 | 0,065 |
| CB-07 | SEE MECHANICAL | TOP: 100.160 | 0,950 | 0,080 |
| CB-08 | 600mm x 600mm | SUMP: 98.630 INV.: 98.930 | 0,716 | 0,089 |

STRUCTURE TABLE - SANITARY SEWER

| NAME | DETAILS | ELEVATIONS/INVERTS |
|-----------|---------|---|
| SAN-MH-01 | 1200mm | INV. IN: 94.240 INV. OUT: 94.240 SUMP: 94.240 |
| SAN-MH-02 | 915mm | INV. IN: 94.750 INV. OUT: 94.750 SUMP: 94.750 |
| SAN-MH-03 | 915mm | INV. IN: 94.960 INV. OUT: 94.960 SUMP: 94.960 |

STORMWATER MANAGEMENT NOTES:

REFER TO "STORMWATER MANAGEMENT REPORT" PREPARED BY EQUIPE LAURENCE INC.

NOTE:


THE EXISTING AND PROPOSED SUBDIVISION WILL HAVE TO BE VALIDATED BY THE SURVEYOR-GEOMETER ON FILE.

SURVEY AND LOTS INFORMATION PROVIDED BY FARLEY, SMITH & DENIS SURVEYING LTD.
DATE: SEPTEMBER 13 2021
FILE NO.: 139-21
PLANIMETRIC REFERENCE SYSTEM: MTM NAD 83 ZONE 9
ALTIMETRIC REFERENCE SYSTEM: CGVD28 HT2.0

SITE PLAN PREPARED BY ROSSMANN ARCHITECTURE
DATE: SEPTEMBER 21 2021
PROJECT: 21019

EXISTING POWER DUCT BANK, WATERMAIN, STORM SEWER AND SANITARY SEWER FROM OTTAWA COORDINATING COMMITTEE CENTRAL REGISTRY AND CITY OF KANATA DEPARTMENT OF ENGINEERING

THE CONTRACTOR MUST NOTIFY ÉQUIPE LAURENCE, THE CONSULTANT, IF HE NOTICES ANY DISCREPANCIES BETWEEN THE INFORMATION PRESENTED ON THE PLANS AND THE MEASUREMENTS TAKEN ON SITE SO THAT ADJUSTMENTS CAN BE MADE.
WHEN APPLICABLE, HE MUST ALSO VERIFY THE ELEVATIONS OF EXISTING SEWERS BEFORE STARTING CONSTRUCTION AND MUST PROVIDE THE INFORMATION TO THE CONSULTANT.

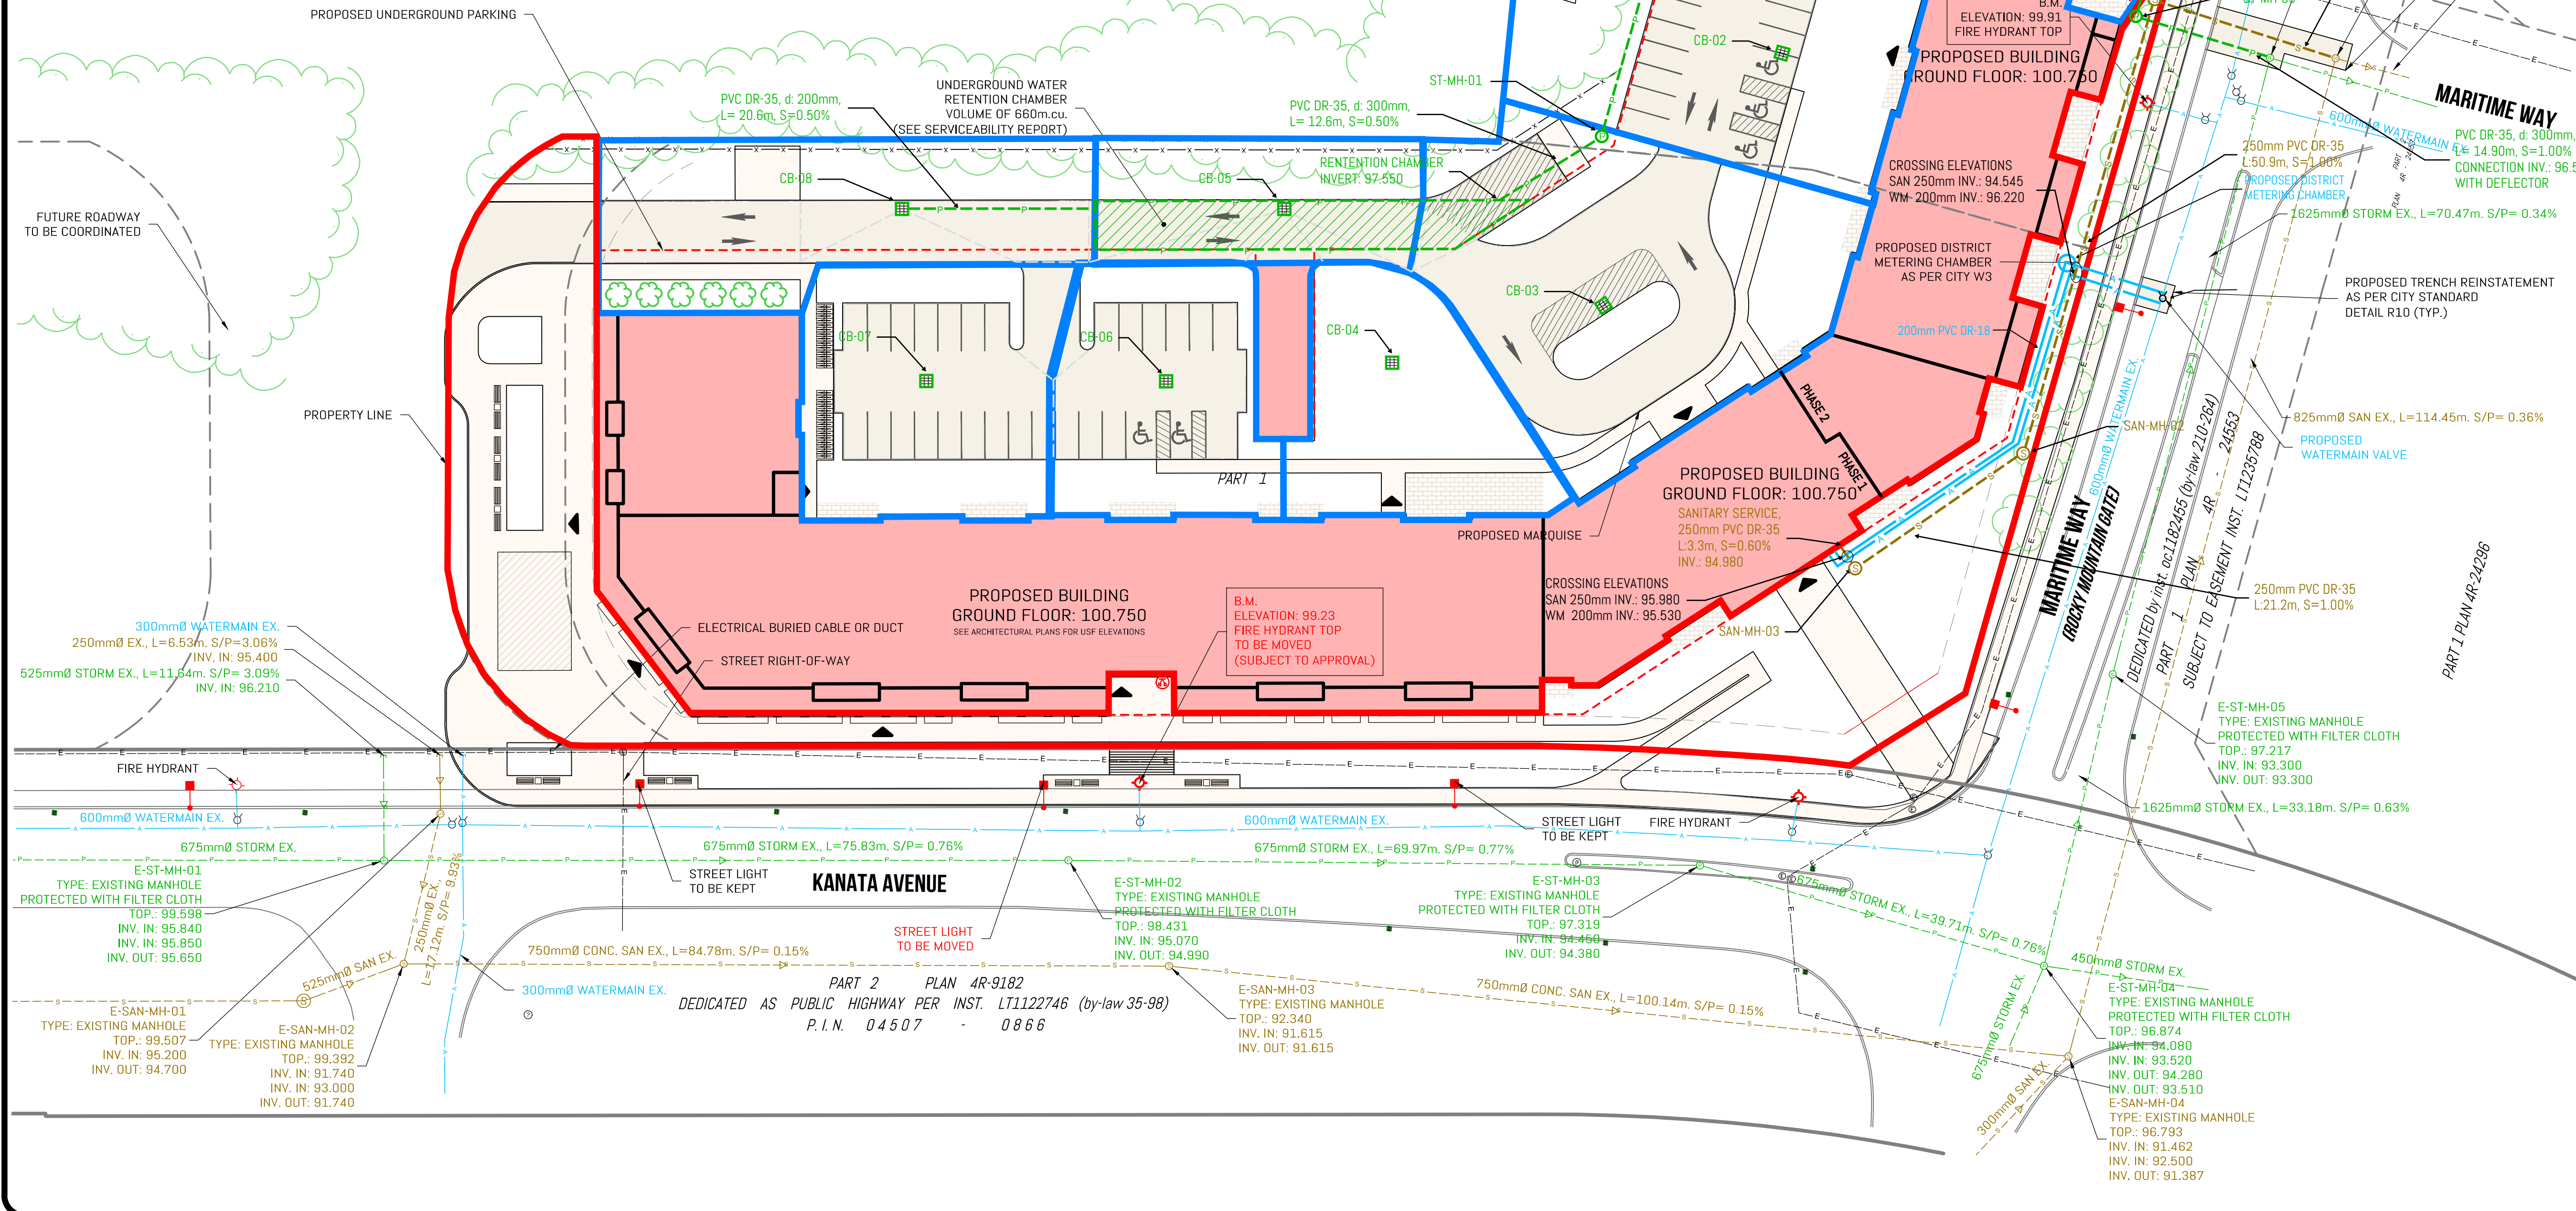

| REV | DESCRIPTION | BY | DATE |
|-----|--------------------------------------|------|------------|
| D | FOR SITE PLAN APPLICATION REVISION 3 | A.L. | 2022-03-23 |
| C | FOR SITE PLAN APPLICATION REVISION 2 | A.L. | 2021-10-07 |
| B | FOR SITE PLAN APPLICATION REVISION 1 | A.L. | 2021-09-24 |
| A | FOR SITE PLAN APPLICATION | A.L. | 2021-09-17 |


CLIENT: **emo batimo**
CONSTRUCTION PROMOTEUR ET GESTIONNAIRE IMMOBILIER

PROJECT: LIB KANATA
KANATA AVENUE AND MARITIME WAY
CITY OF OTTAWA, ONTARIO

EQUIPE LAURENCE
INGENIERIE CIVILE
733, chemin Jean-Adam, Piedmont (Dorval) J0R 1R3
T 450 227 1857
info@equipe-laurence.ca | equipe-laurence.ca


ALATOUR
10022289
PROFESSIONAL ENGINEER
PROVINCE OF ONTARIO
2022-03-23

TITLE: SITE SERVICING PLAN AND DRAINAGE AREA

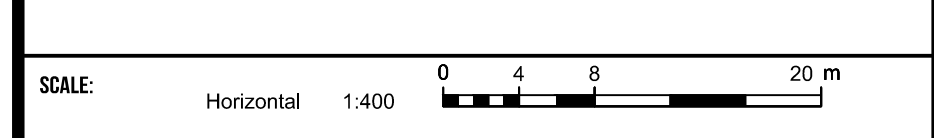

| | |
|-------------------------------|--------------------|
| B. BRAY, ing./ L. MENARD, CPI | C-204.dwg |
| F. LANDRY | DRAWING 2021-09-14 |
| A. LATOUR, ing. | DATE 600401 C-204 |
| APPROVED | PROJECT NO PLAN NO |


f:\ed\projets\600401\5_Plans\C-204.dwg, 2022-03-23 16:40:09, omtissay

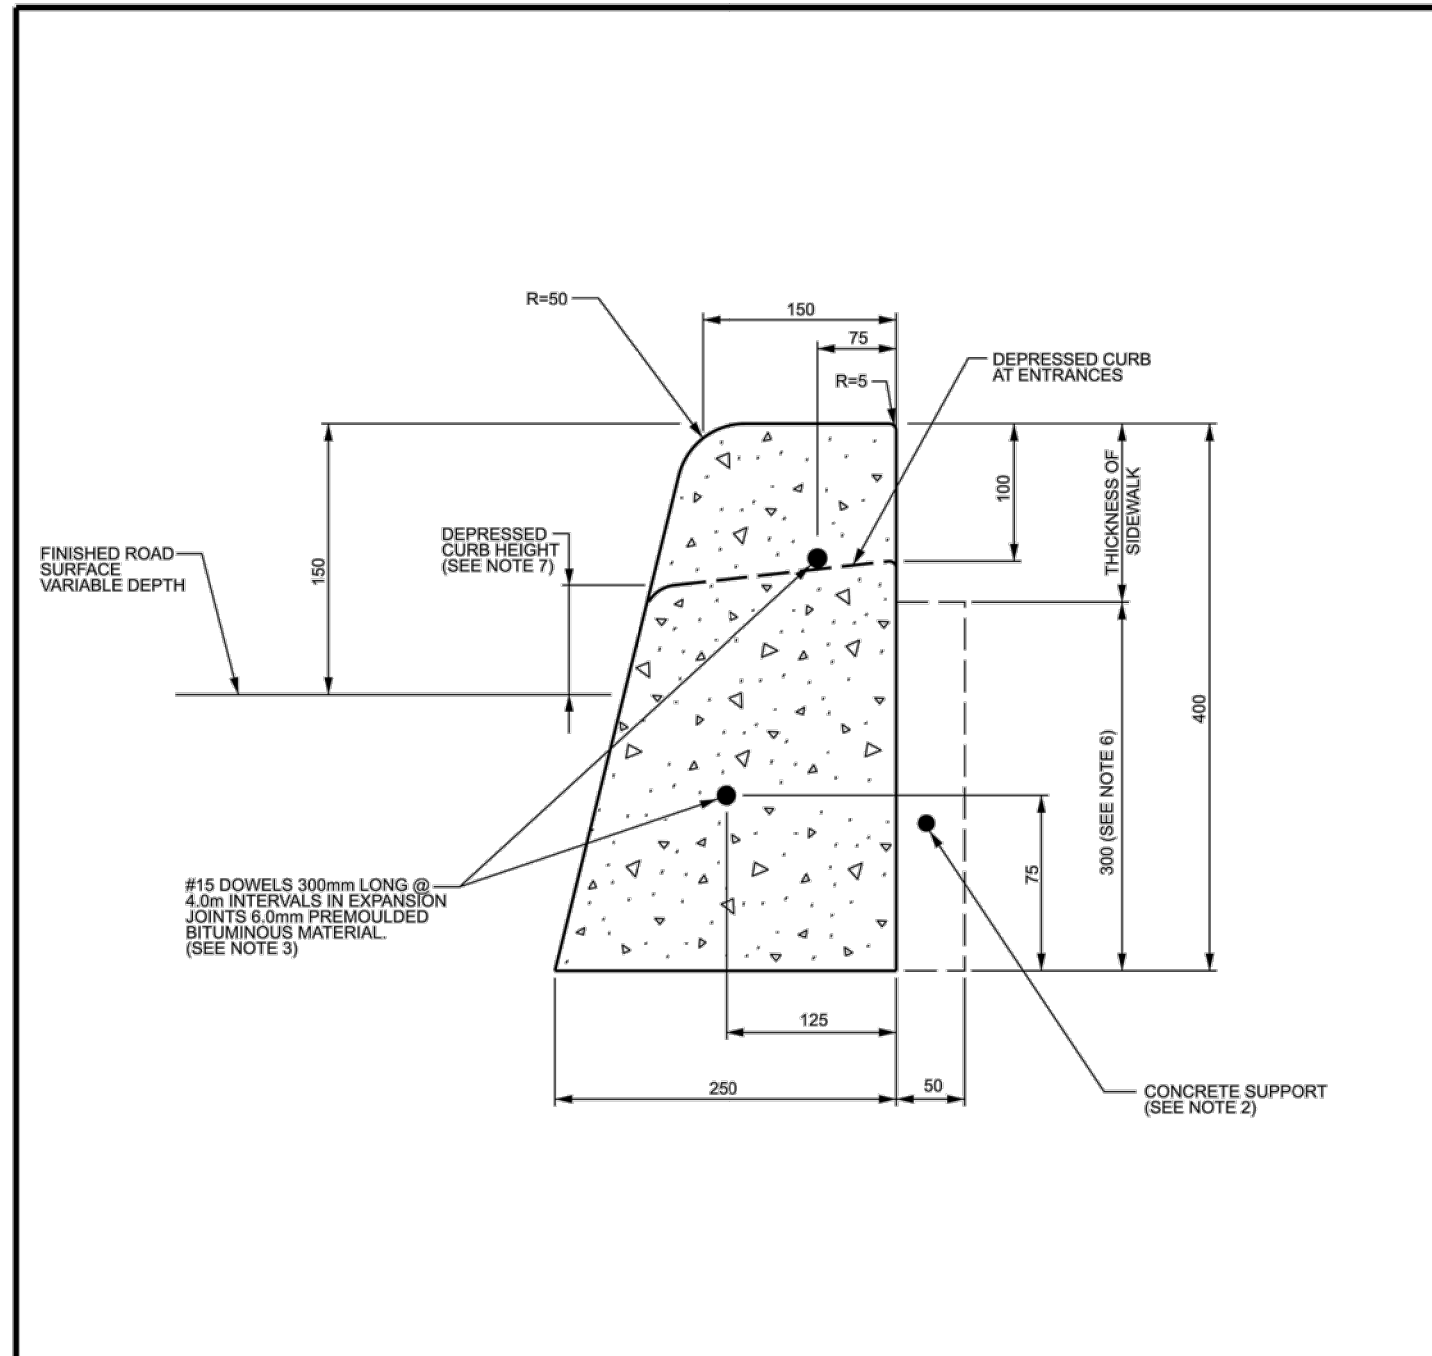

CONCRETE BARRIER CURB

- NOTES:
1. THE FULL CURB DEPTH SHALL BE CARRIED THROUGH THE DEPRESSED ACCESS CROSSING.
 2. A CONCRETE SUPPORT IS REQUIRED WHEN BUILT ADJACENT TO THE SIDEWALK.
 3. IF AN EXTRUSION CURBING MACHINE IS USED, THE EXPANSION BITUMINOUS MATERIAL AND THE #15 DOWELS ARE TO BE PLACED AT THE END OF THE EXTRUSION.
 4. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
 5. DUMMY JOINTS SHALL BE 25mm DEEP, FRONT, BACK AND TOP OF SECTION AT 4m SPACING OR MATCH JOINTING WHERE SIDEWALK IS ADJACENT.
 6. FOR DEPRESSED CURB AT ENTRANCES USE 250.
 7. DEPRESSED CURB HEIGHT - FOR PEDESTRIAN CURB RAMPS 0 TO 6 mm AND FOR PRIVATE ENTRANCES 0 TO 13mm.


| | | | |
|--|---|--------|--------------------|
| | CONCRETE BARRIER CURB FOR GRANULAR BASE PAVEMENT (MODIFIED OPSD-600.110) | | DATE: JANUARY 2003 |
| | REV. DATE: MARCH 2021 | N.T.S. | |
| | DWG. No.: SC1.1 | | |
| | | | |

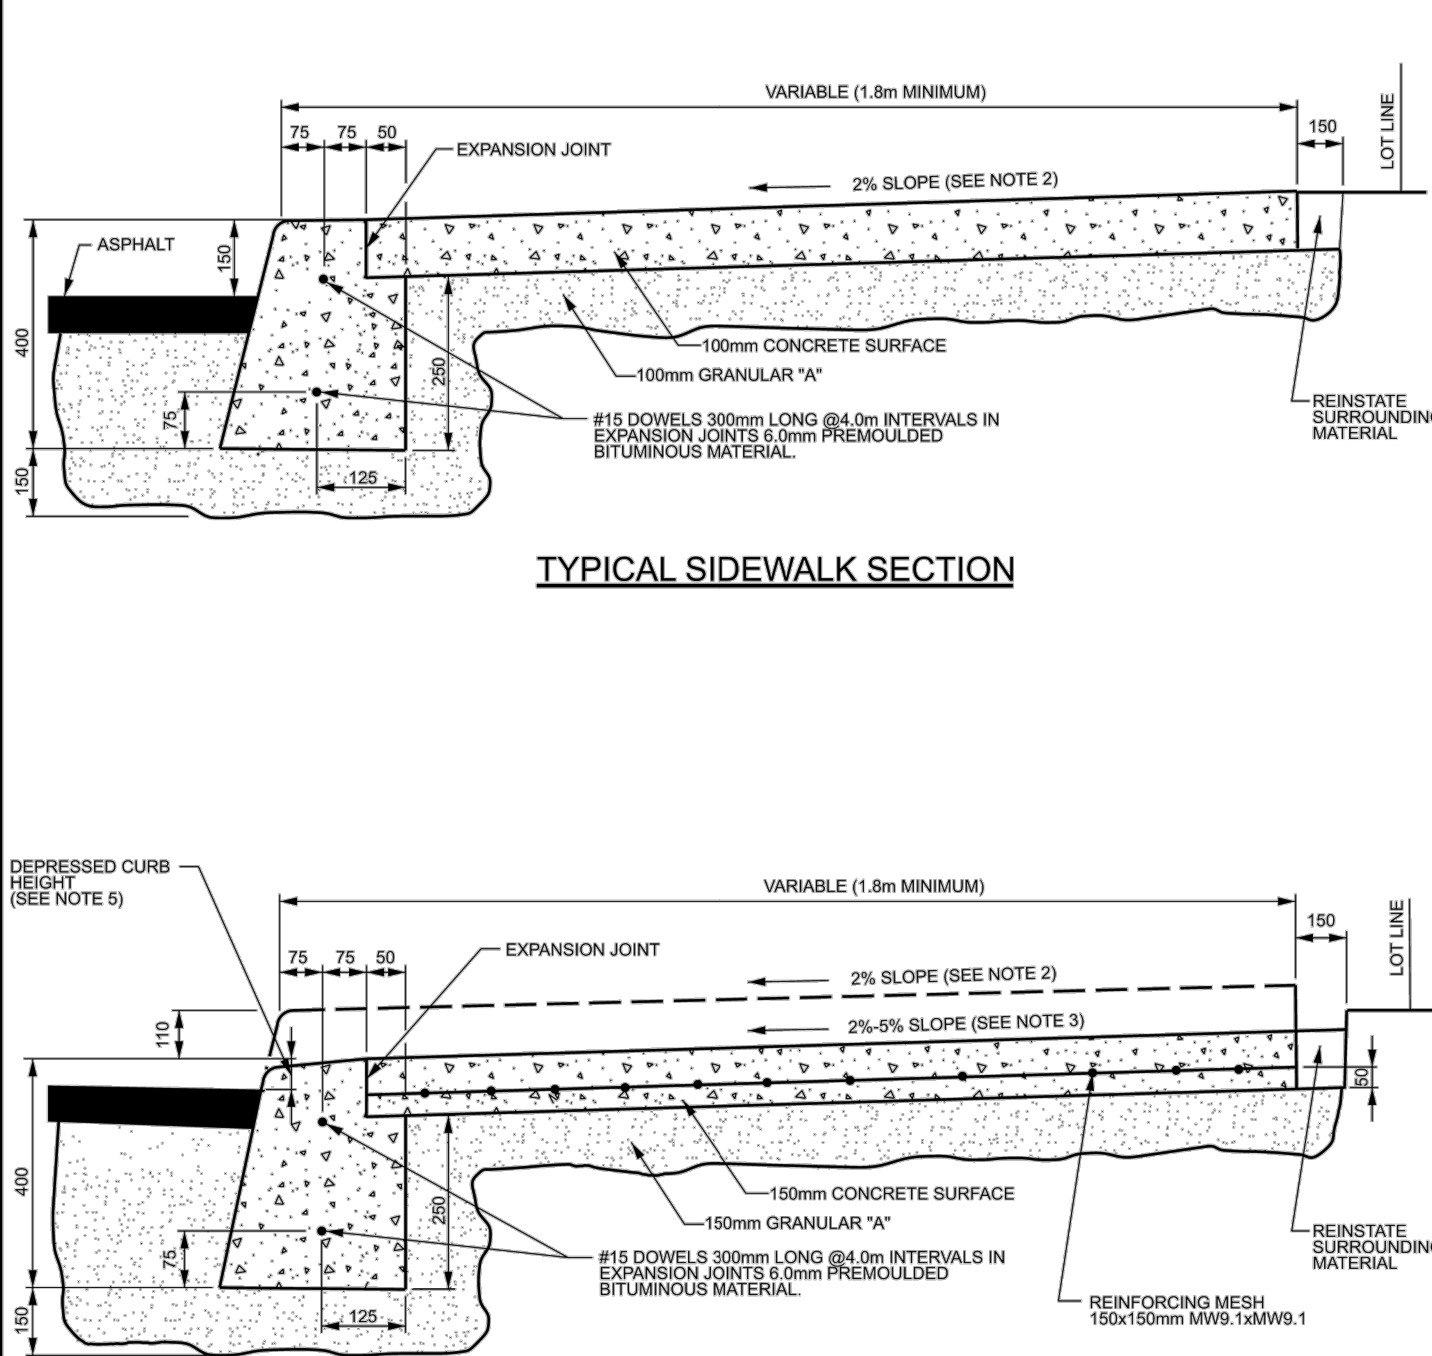

TYPICAL SIDEWALK SECTION

- NOTES:
1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
 2. THE MAXIMUM SLOPE IS NOT TO EXCEED 2%.
 3. FOR CURB RAMPS, SLOPE OF 2% TO 5%, MAXIMUM 8%.
 4. EXPANSION AND DUMMY JOINTS AS PER SCS.
 5. DEPRESSED CURB HEIGHT - FOR PEDESTRIAN CURB RAMPS 0 TO 6 mm AND FOR PRIVATE ENTRANCES 0 TO 13 mm.


| | | | |
|--|--|--------|--------------------|
| | CONCRETE BARRIER CURB WITH SIDEWALK | | DATE: JANUARY 2003 |
| | REV. DATE: MAY 2021 | N.T.S. | |
| | DWG. No.: SC1.4 | | |
| | | | |

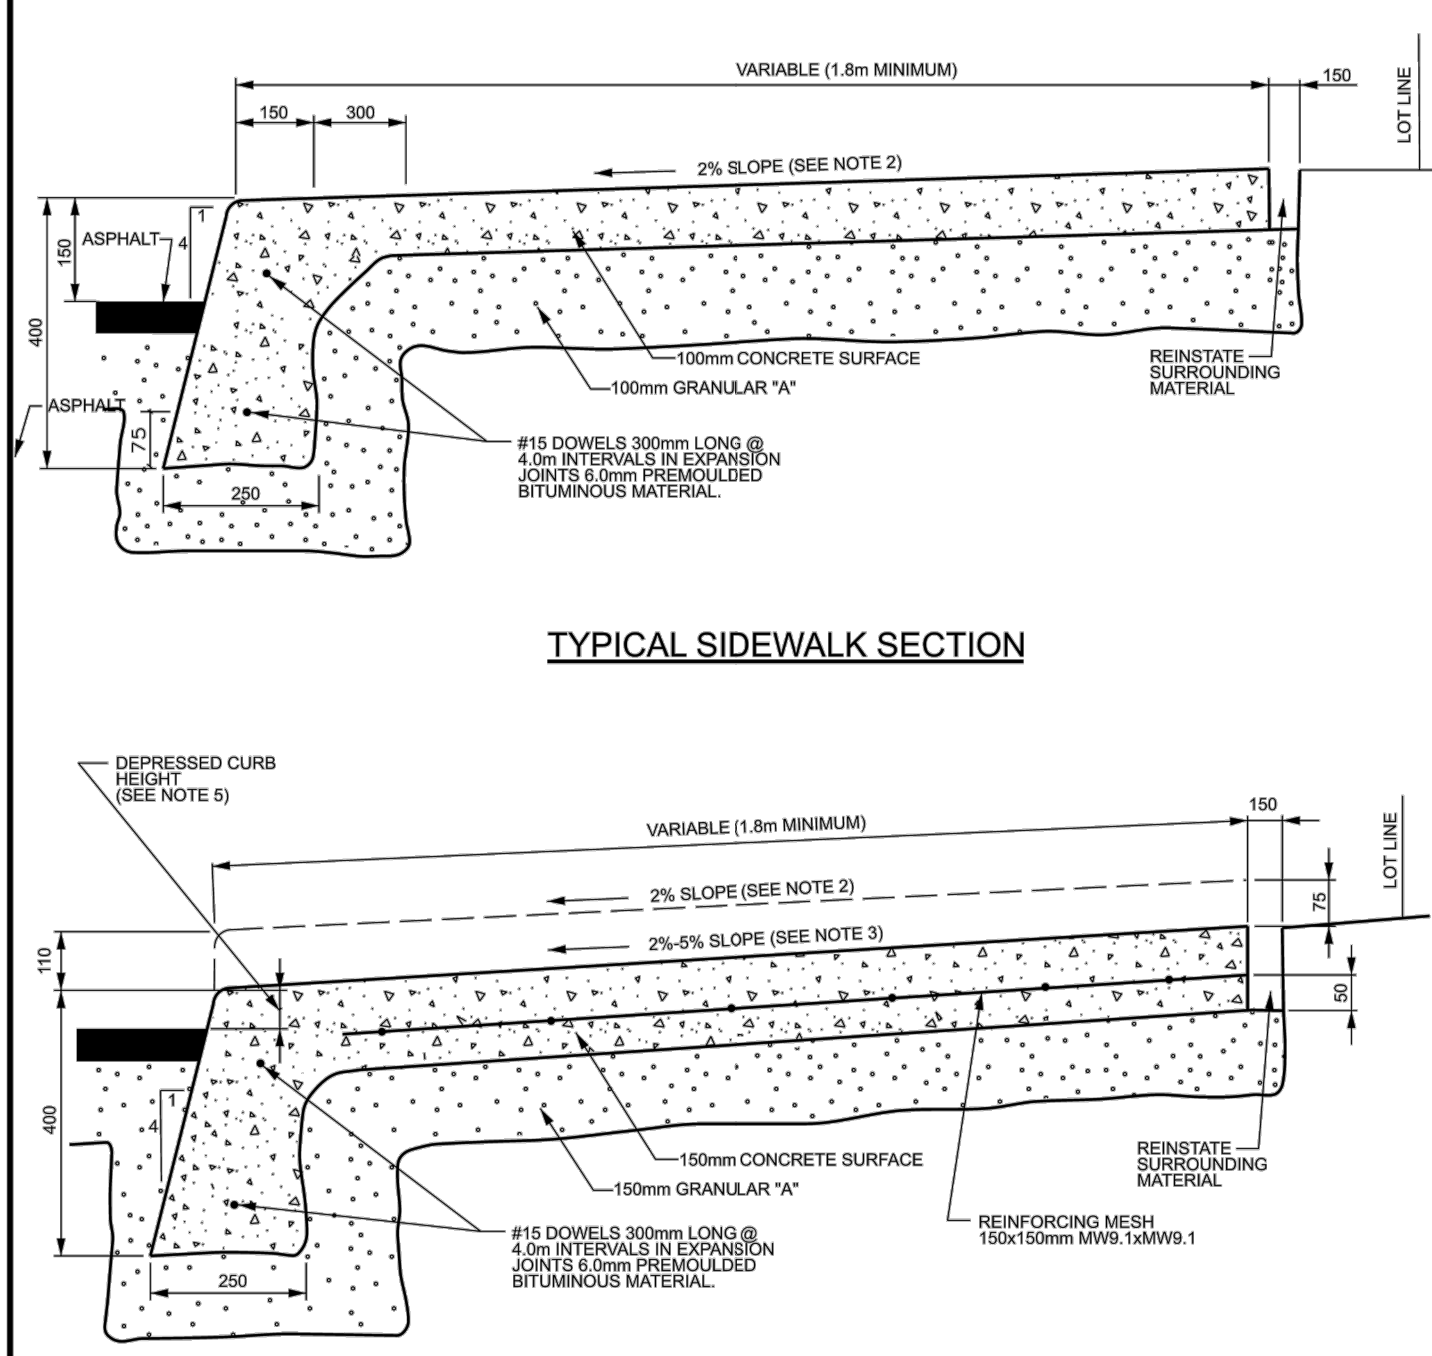

TYPICAL SIDEWALK SECTION

- NOTES:
1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
 2. THE MAXIMUM SLOPE IS NOT TO EXCEED 2%.
 3. FOR CURB RAMPS, SLOPE OF 2% TO 5%, MAXIMUM 8%.
 4. EXPANSION AND DUMMY JOINTS AS PER SCS.
 5. DEPRESSED CURB HEIGHT - FOR PEDESTRIAN CURB RAMPS 0 TO 6 mm AND FOR PRIVATE ENTRANCES 0 TO 13 mm.


| | | | |
|--|--|--------|----------------|
| | MONOLITHIC CONCRETE CURB AND SIDEWALK | | DATE: MAY 2001 |
| | REV. DATE: MAY 2021 | N.T.S. | |
| | DWG. No.: SC2 | | |
| | | | |

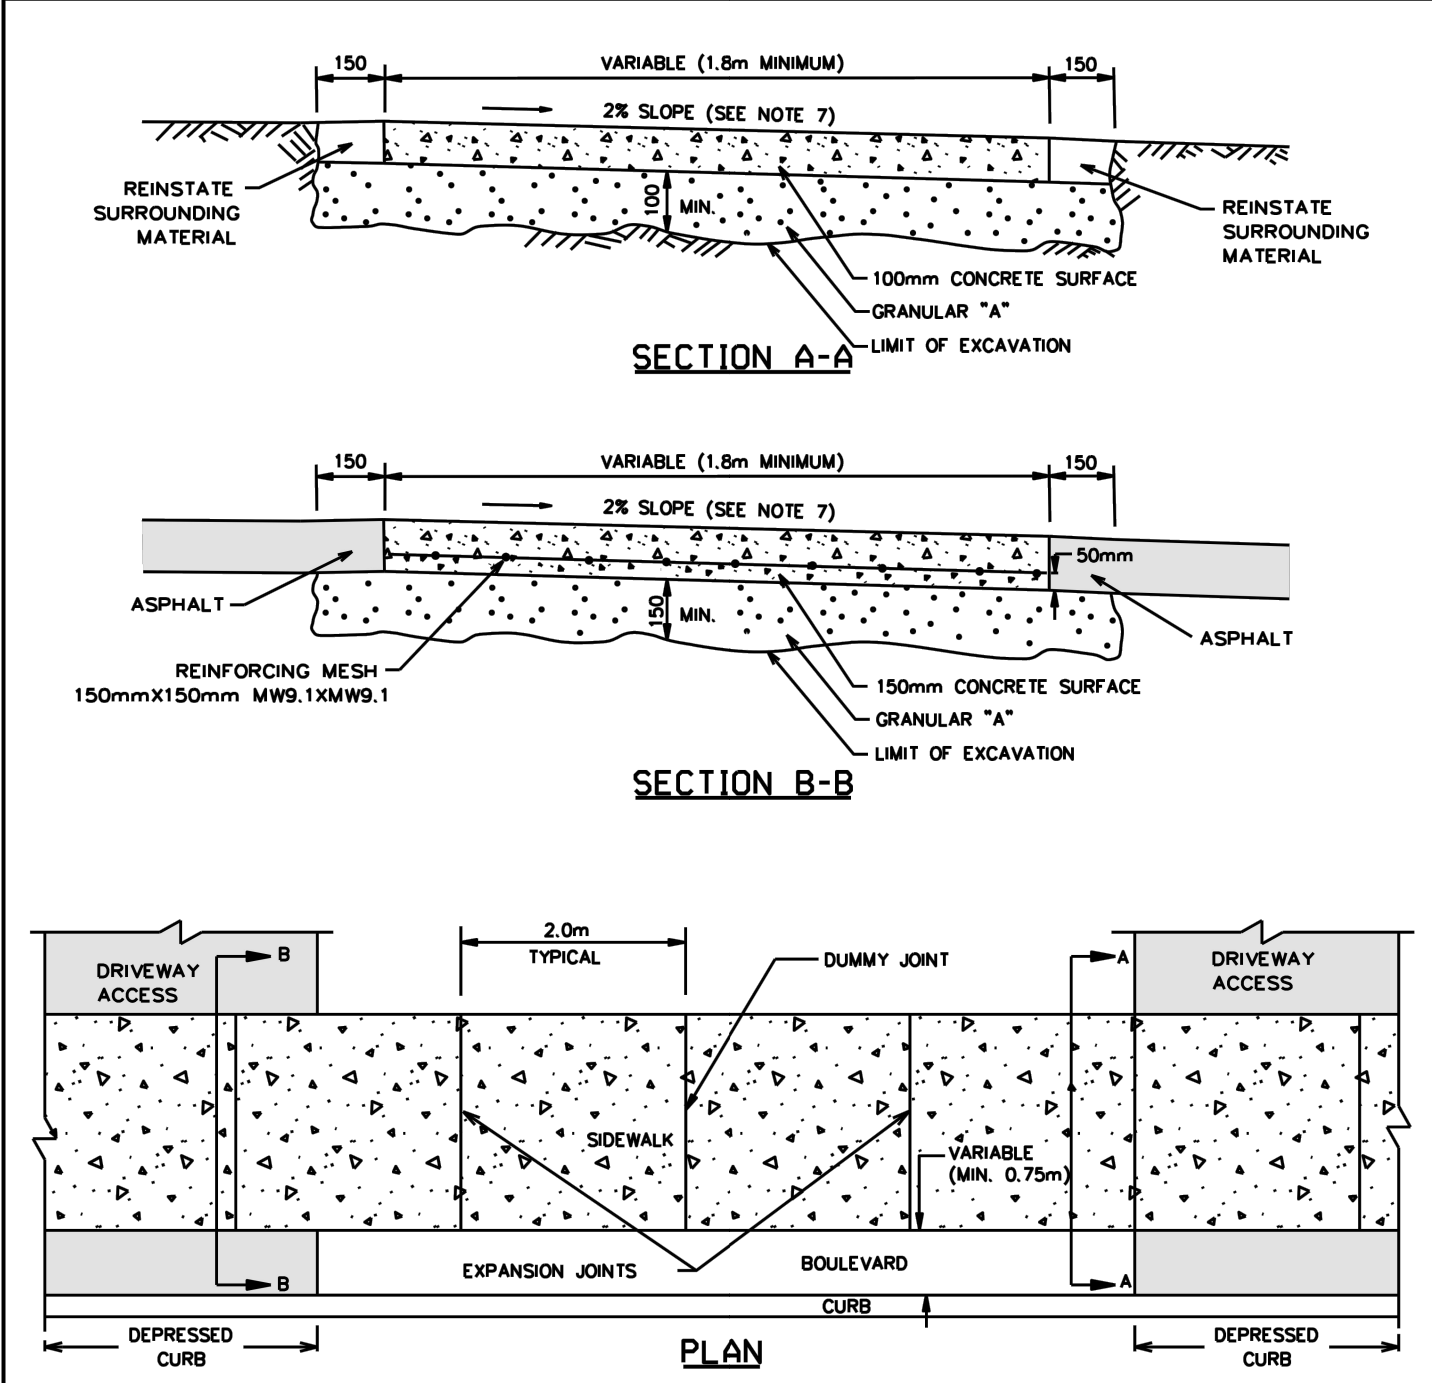

TYPICAL CONCRETE SIDEWALK IN BOULEVARD

- NOTES:
1. CONCRETE AND GRANULAR "A" IS TO BE INCREASED TO 150mm AT THE ENTRANCE AND 150x150mm MW9.1 x MW9.1 REINFORCING MESH IS TO BE PLACED MID DEPTH WITHIN DRIVEWAY ACCESS.
 2. TRANSVERSE EXPANSION JOINTS ARE REQUIRED AT THE ENDS, THE MIDPOINT, AT INTERVALS OF 4m MAXIMUM, AND ALSO TO ISOLATE OBSTRUCTIONS FROM SIDEWALK, HYDRANTS, POLES, BUILDINGS, ETC.
 3. WHEN THE OVERALL SIDEWALK WIDTH EXCEEDS 2.5m, A LONGITUDINAL CONSTRUCTION JOINT SHALL BE CREATED AT ITS MIDPOINT.
 4. EDGES AND JOINTS ARE TO BE FINISHED WITH A 75mm EDGING TOOL.
 5. ALL CONCRETE SIDEWALKS ARE TO HAVE A BROOM FINISH UNLESS OTHERWISE SPECIFIED.
 6. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
 7. THE MAXIMUM SLOPE IS NOT TO EXCEED 2%.
 8. INSTALL DUMMY TRANSVERSE JOINTS AS REQUIRED SO THERE IS A MAXIMUM SPACING OF 2m BETWEEN ALL JOINTS.
 9. SIDEWALK NOT TO BE DEPRESSED ACROSS DRIVEWAY ACCESSES.
 10. EXPANSION AND DUMMY JOINTS AS PER SCS


| | | | |
|--|---|--------|----------------|
| | TYPICAL CONCRETE SIDEWALK IN BOULEVARD | | DATE: MAY 2001 |
| | REV. DATE: MARCH 2016 | N.T.S. | |
| | DWG. No.: SC4 | | |
| | | | |

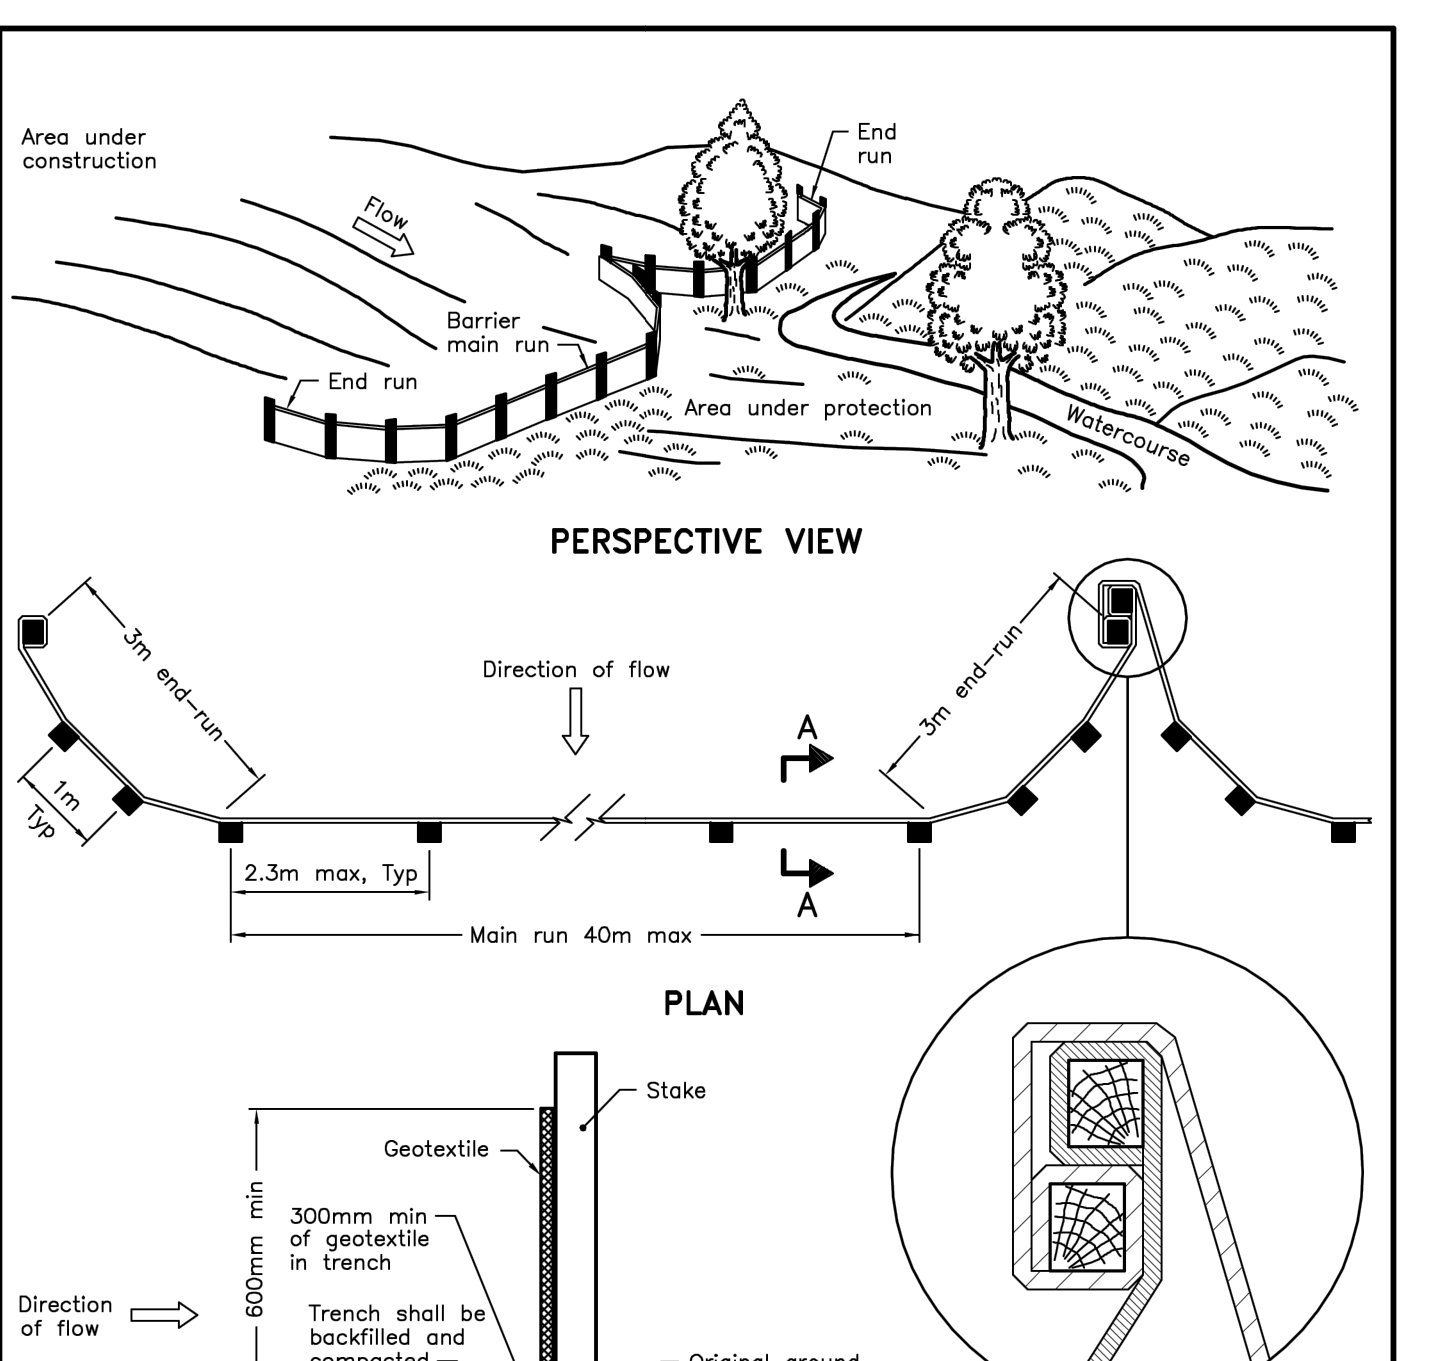

LIGHT-DUTY SILT FENCE BARRIER

- NOTES:
1. CLEARANCE AROUND PIPE AT CHAMBER WALL TO BE 50mm MINIMUM.
 2. VALVE CHAMBERS IN LIEU OF BOXES ON WATERMAINS SMALLER THAN 300mm ONLY TO BE USED, IF APPROVED BY THE CONTRACT ADMINISTRATION.
 3. REFER TO MW-13.1 FOR ADDITIONAL REQUIREMENTS.
 4. REFER TO MW-18.15 FOR APPROVED MANUFACTURERS.
 5. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
 6. CATHODIC PROTECTION MEASURES SHALL BE INSTALLED IN ACCORDANCE WITH W08, W10 AND W12.
 7. TRACER WIRE REQUIRED FOR P.C. #16 AND HOPE WATERMAIN PIPE ONLY AS PER W08. TRACER WIRE TO BE CONNECTED TO VALVE BOLT AS PER W08 AND SECURED TO TOP OF CHAMBER.

| | | | |
|--|--|-------|----------------|
| | ONTARIO PROVINCIAL STANDARD DRAWING | | DATE: NOV 2015 |
| | REV. DATE: MARCH 2021 | Rev 2 | |
| | DWG. No.: OPSD 219.110 | | |
| | | | |

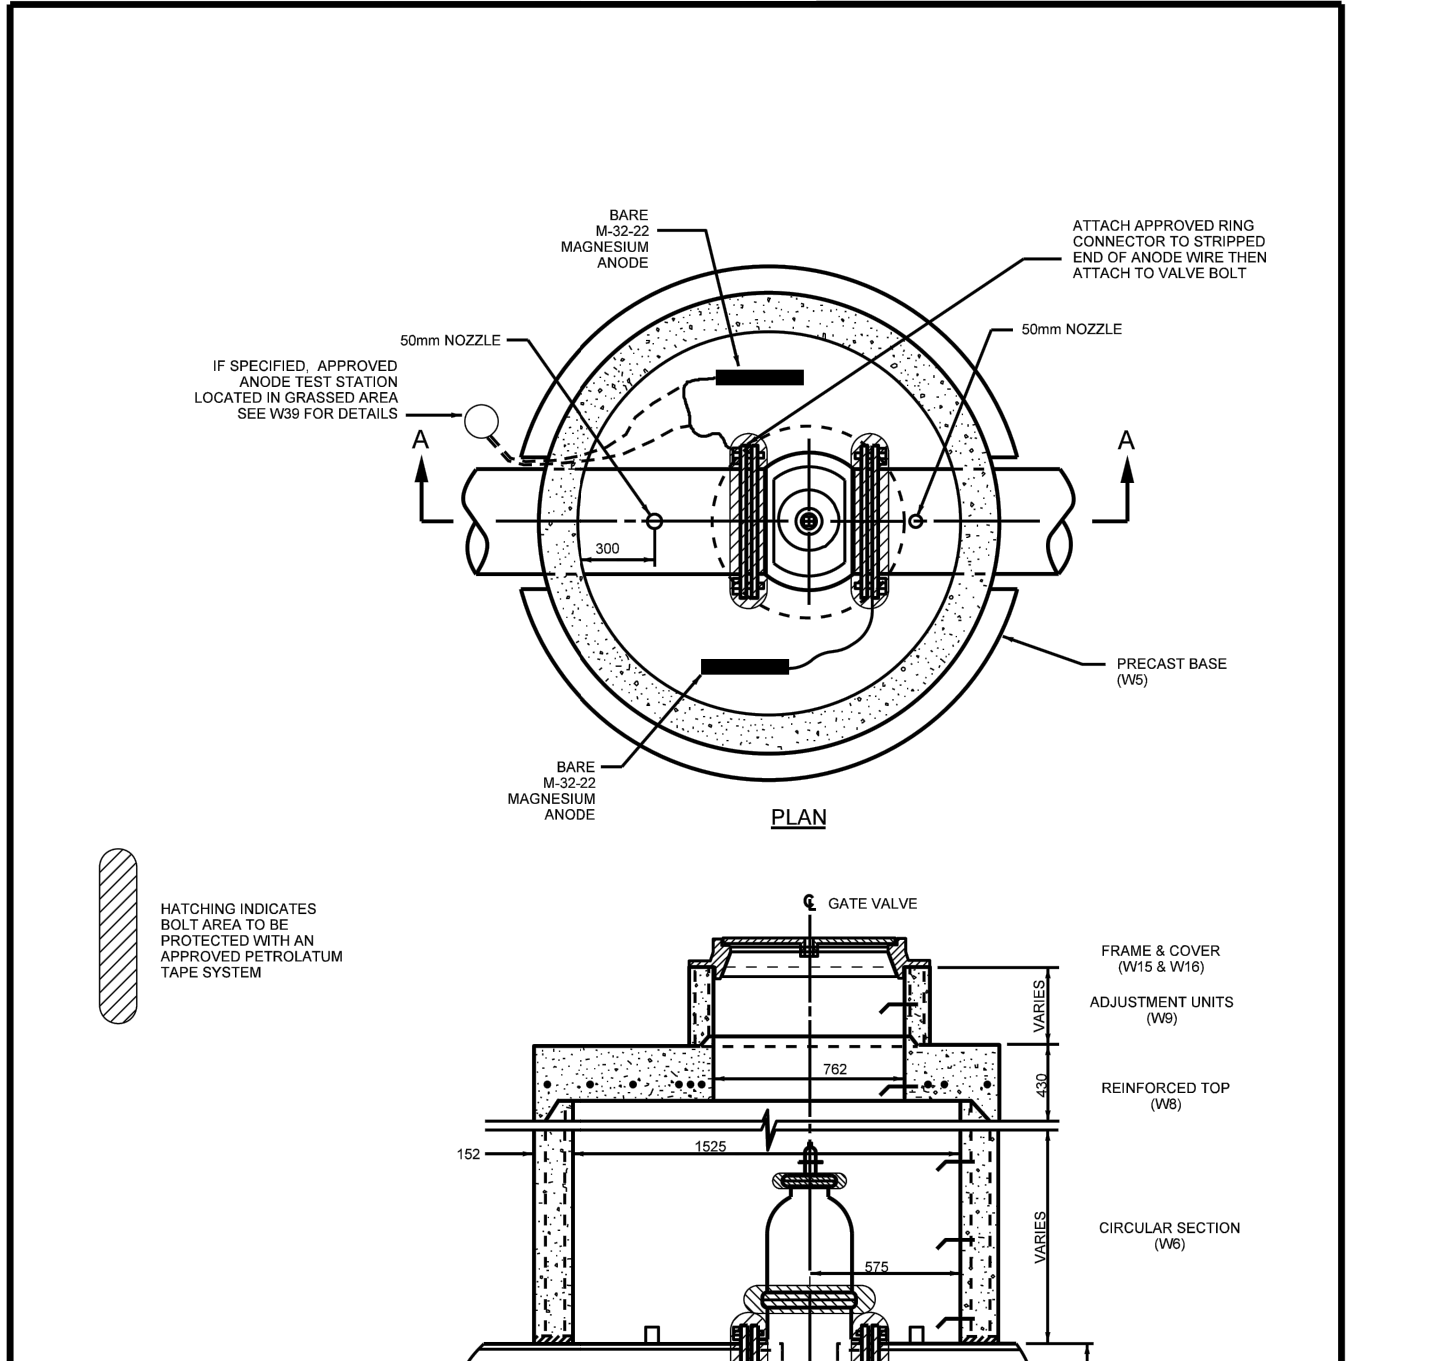

CIRCULAR CHAMBER GATE VALVES

- NOTES:
1. CLEARANCE AROUND PIPE AT CHAMBER WALL TO BE 50mm MINIMUM.
 2. VALVE CHAMBERS IN LIEU OF BOXES ON WATERMAINS SMALLER THAN 300mm ONLY TO BE USED, IF APPROVED BY THE CONTRACT ADMINISTRATION.
 3. REFER TO MW-13.1 FOR ADDITIONAL REQUIREMENTS.
 4. REFER TO MW-18.15 FOR APPROVED MANUFACTURERS.
 5. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
 6. CATHODIC PROTECTION MEASURES SHALL BE INSTALLED IN ACCORDANCE WITH W08, W10 AND W12.
 7. TRACER WIRE REQUIRED FOR P.C. #16 AND HOPE WATERMAIN PIPE ONLY AS PER W08. TRACER WIRE TO BE CONNECTED TO VALVE BOLT AS PER W08 AND SECURED TO TOP OF CHAMBER.

| | | | |
|--|---|--------|----------------|
| | CIRCULAR CHAMBER GATE VALVES | | DATE: MAY 2001 |
| | REV. DATE: MARCH 2021 | N.T.S. | |
| | DWG. No.: W0 | | |
| | | | |

| D | FOR SITE PLAN APPLICATION REVISION 3 | A.L. | 2022-03-23 |
|-----|--------------------------------------|------|------------|
| C | FOR SITE PLAN APPLICATION REVISION 2 | A.L. | 2021-10-07 |
| B | FOR SITE PLAN APPLICATION REVISION 1 | A.L. | 2021-09-24 |
| A | FOR SITE PLAN APPLICATION | A.L. | 2021-09-17 |
| REV | DESCRIPTION | BY | DATE |

| | | | |
|----------|---|--|--|
| CLIENT: | | | |
| PROJECT: | LIB KANATA KANATA AVENUE AND MARITIME WAY CITY OF OTTAWA, ONTARIO | | |

INGENIERIE CIVILE

733, chemin Jean-Jacques, Piedmont (Doubac) J0R 1R3
T. 450 227 1857
info@equiplaurence.ca | equiplaurence.ca



ALATOUR
10022286
PROVINCE OF ONTARIO

2022-03-23


| | | | |
|--------|-------------------------------|--|--|
| TITLE: | STANDARD SECTIONS AND DETAILS | | |
| SCALE: | NO SCALE | | |

| | | | |
|-----------|--------------------------------|------------|------------|
| DESIGN: | B. BRAY, ing. / L. MENARD, CPI | DATE: | MAY 2001 |
| DRAWN: | F. LANDRY | REV. DATE: | MARCH 2021 |
| APPROVED: | A. LATOUR, ing. | DWG. No.: | W0 |
| | | DATE: | MAY 2001 |
| | | REV. DATE: | MARCH 2021 |
| | | DWG. No.: | W0 |

D07-12-21-0153

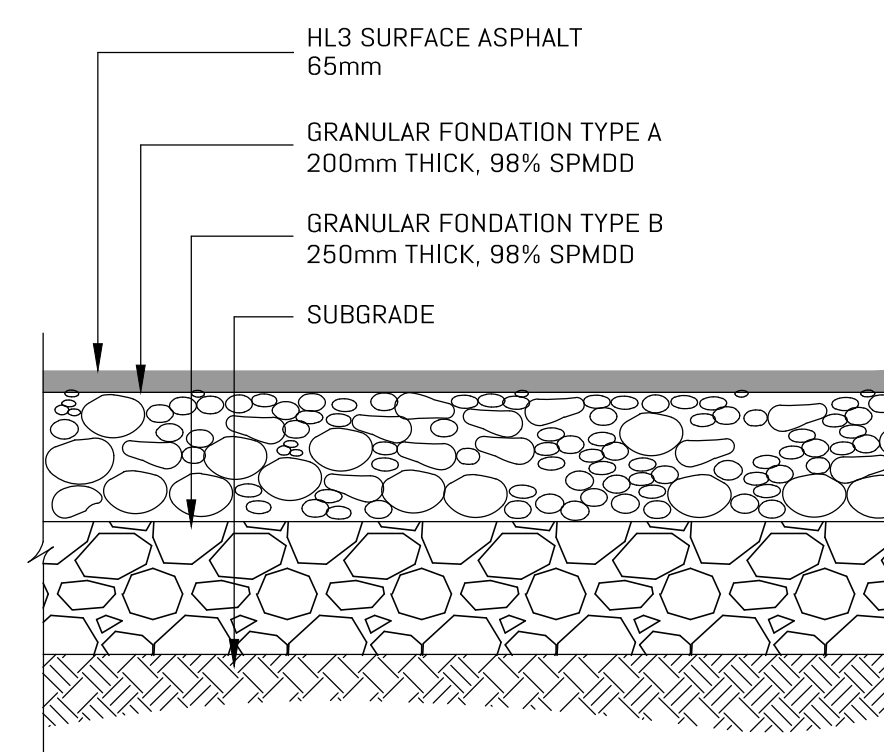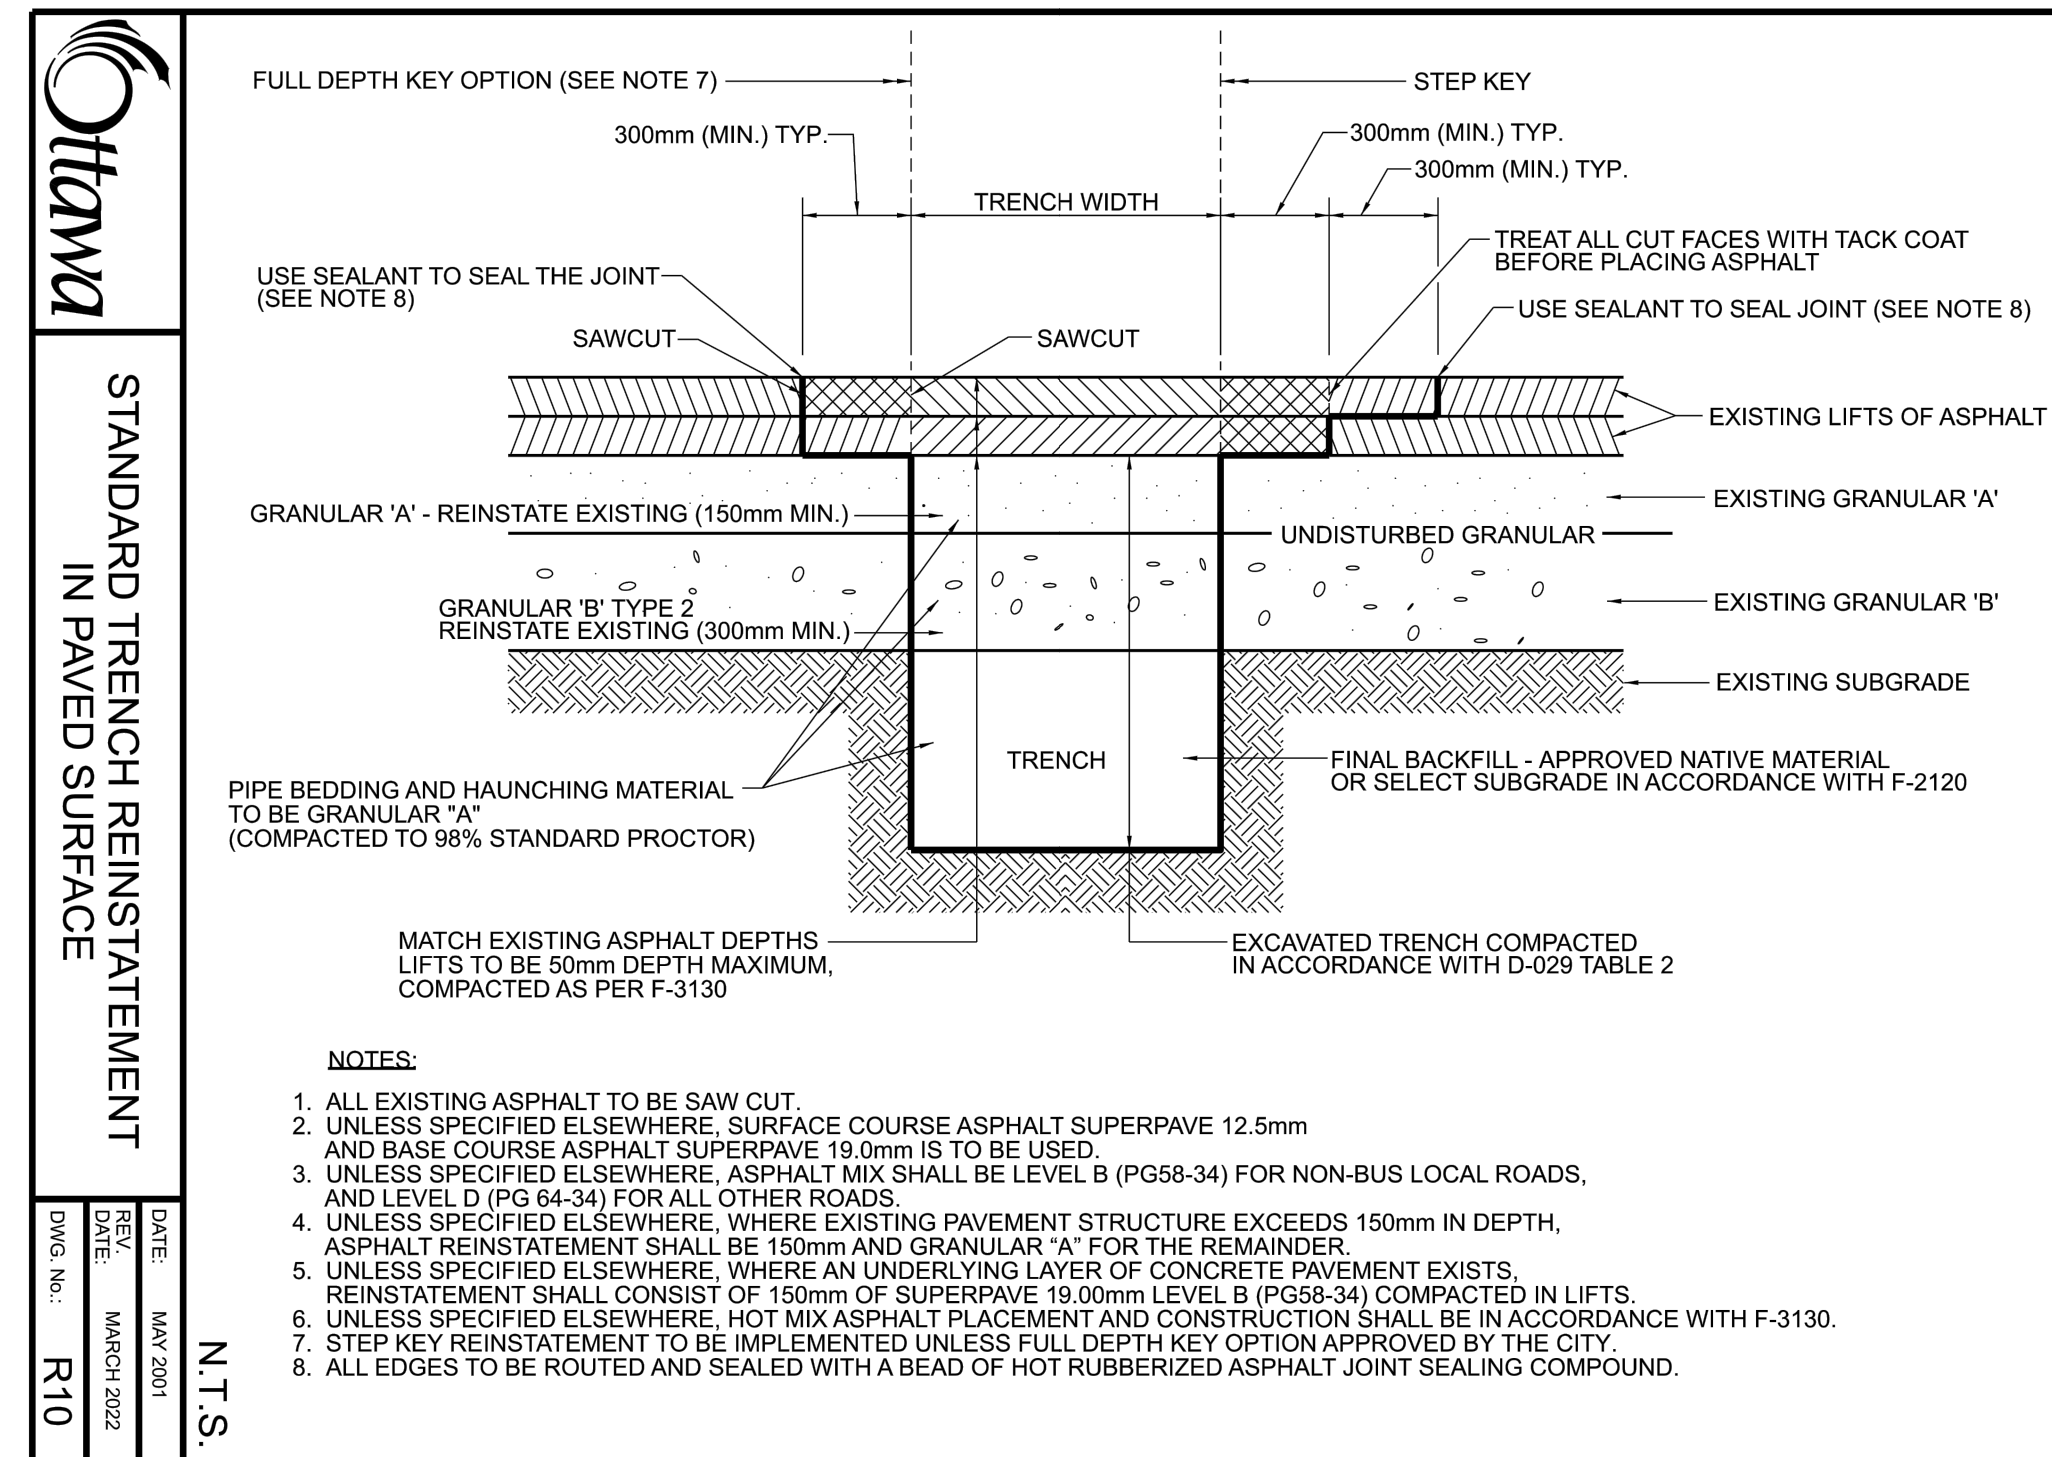


**PARKING AND ACCESS
FOUNDATION ASPHALT SURFACE**
 (TO BE VERIFIED BY GEOTECHNICAL ENGINEER)

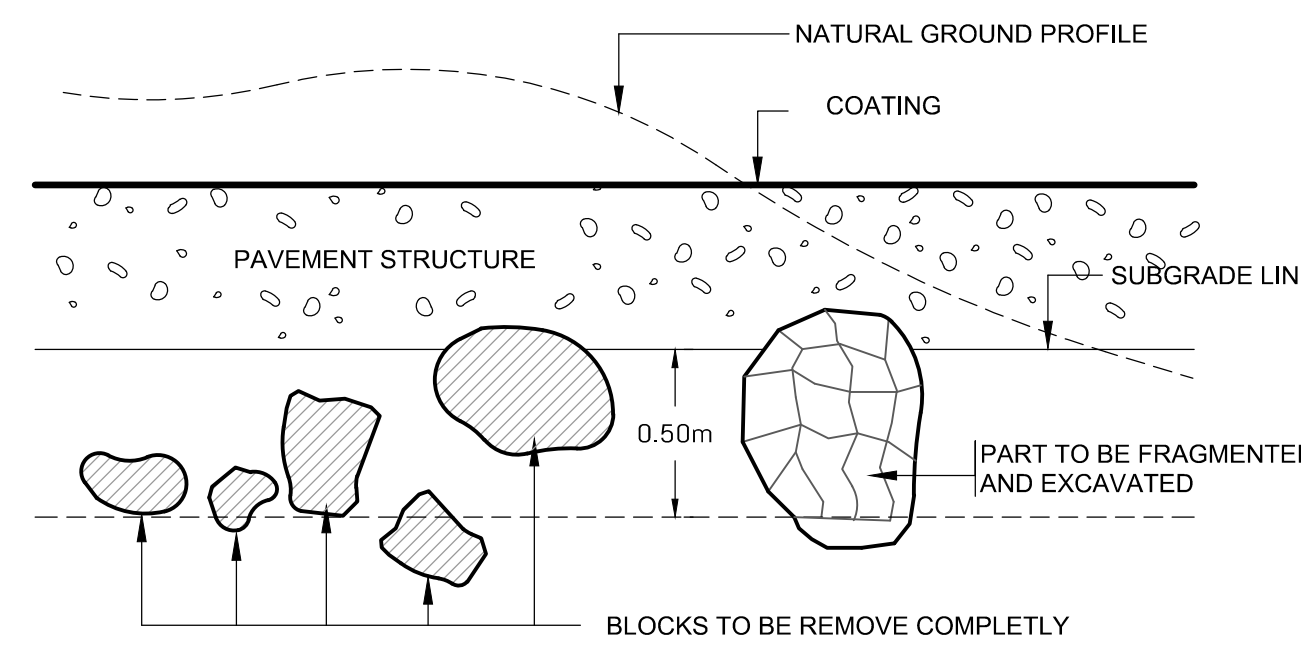

- NOTES:
- ALL BLOCKS OVER 250mm DIAMETER PRESENT IN THE FIRST 500 mm UNDER INFRASTRUCTURE LINE MUST BE REMOVED, FRAGMENTED AND EXCAVATED TO 500 mm DEPT;
 - AFTER REMOVING BLOCS, THE EXCAVATIONS HAVE TO BE RAISED TO DESIGN SUBGRADE LEVELS WITH APPROVED COMPACTABLE ON SITE SOIL.
 - LIFTS OF 300mm THICK, COMPACTED AT 95% MSPDD
 - AS AN ALTERNATIVE TO SUBEXCAVATION, A WOVEN GEOTEXTILE SEPARATOR, SUCH AS TERRATRACK 24-15, AMOCO 2002, MIRAFI 500XL OR EQUIVALENT, MAY BE PLACED OVER SPONGY AREAS PRIOR TO PLACING THE GRANULAR "B" SUB-BASE LAYER.

SUBGRADE PREPARATION DETAIL

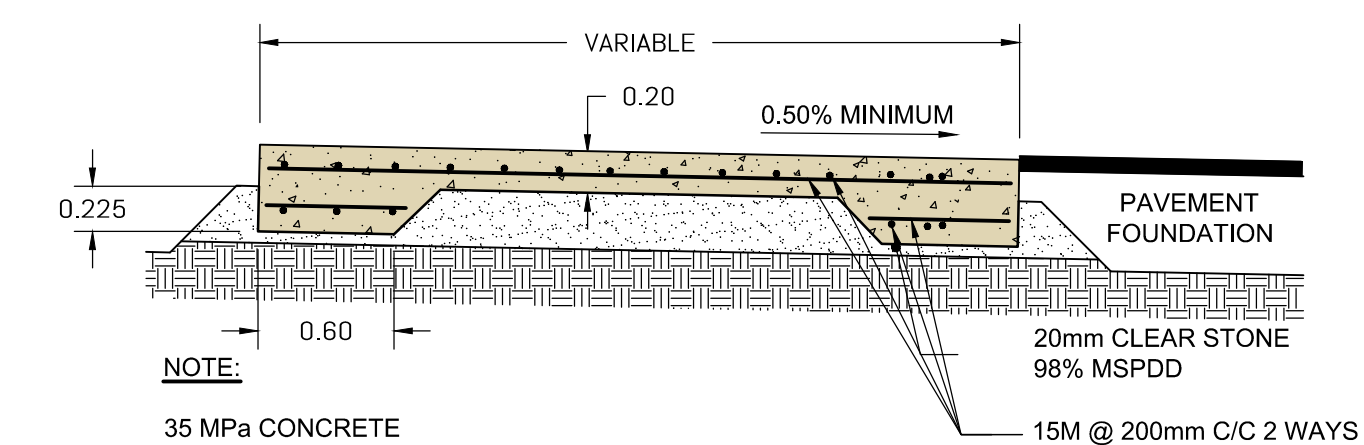

- NOTE:
- 35 MPa CONCRETE
- STATISTICAL STRENGTH TEST ANALYSIS TO CONFIRM THE STRENGTH LEVEL INCLUDING THE EXPECTED 7/28-DAY STRENGTH RATIO (AS PER CSA A23.1 CLAUSE 4.4.6.7)

REINFORCED CONCRETE SLAB FOR GARBAGE CONTAINERS

| REV | DESCRIPTION | BY | DATE |
|-----|--------------------------------------|------|------------|
| A | FOR SITE PLAN APPLICATION REVISION 3 | A.L. | 2022-03-23 |

CLIENT: **emo batimo**
 CONSTRUCTION PROMOTEUR ET GESTIONNAIRE IMMOBILIER

PROJECT: **LIB KANATA**
 KANATA AVENUE AND MARITIME WAY
 CITY OF OTTAWA, ONTARIO



733, chemin Jean-Adam, Piedmont (Dobac) J0R 1R3
 T. 450 227 1857
 info@equipelaurence.ca | equipelaurence.ca



2022-03-23

TITLE: **STANDARD SECTIONS AND DETAILS II**

SCALE: NO SCALE

| | |
|-------------------------------|------------|
| B. BRAY, ing. / L.MENARD, CPI | C-206.dwg |
| DESIGN | DRAWING |
| F. LANDRY | 2021-09-14 |
| DRAWN | DATE |
| A. LATOUR, ing. | 600401 |
| APPROVED | PROJECT NO |
| | PLAN NO |



FIRE FLOW DEMAND = 16,000L
 TOTAL FIRE FLOW CONTRIBUTION = 47,500L

150m FROM
 BUILDING FOOTPRINT

75m FROM
 BUILDING FOOTPRINT

BUILDING FOOTPRINT

- HYDRANTS ≤ 75m
- HYDRANTS > 75m & ≤ 150m
- HYDRANTS > 150m

| REV | DESCRIPTION | BY | DATE |
|-----|--------------------------------------|------|------------|
| A | FOR SITE PLAN APPLICATION REVISION 3 | A.L. | 2022-03-23 |

CLIENT: **emo batimo**
CONSTRUCTION PROMOTEUR ET GESTIONNAIRE IMMOBILIER

PROJECT:
 LIB KANATA
 KANATA AVENUE AND MARITIME WAY
 CITY OF OTTAWA, ONTARIO

LAURENCE
EQUIPE
 INGENIERIE CIVILE

733, chemin Jean-Adam, Piedmont (Dubreuc) J0R 1R3
 T. 450 227 1857
 info@equipelaurence.ca | equipelaurence.ca



TITLE:
 FIRE HYDRANT COVERAGE MAP

SCALE: Horizontale 1:1000

| | |
|-------------------------------|------------|
| B. BRAY, ing. / L.MENARD, CPI | C-207.dwg |
| DESIGN | DRAWING |
| F. LANDRY | 2021-09-14 |
| DATE | |
| A. LATOUR, ing. | 600401 |
| APPROVED | PROJECT NO |
| | PLAN NO |