

- GENERAL NOTES**
1. THE CONTRACTOR SHALL VERIFY AND LOCATE ALL EXISTING SERVICES / UTILITIES IN THE FIELD PRIOR TO ANY CONSTRUCTION.
 2. THE CONTRACTOR SHALL INSTALL AND MAINTAIN TREE PROTECTION FENCING AS NOTED ON THE DRAWING DURING CONSTRUCTION PHASE.
 3. ALL LAYOUT FOR PROPOSED PLANT MATERIAL TO BE VERIFIED AND APPROVED ON SITE BY PROJECT MANAGER PRIOR TO ANY PLANTING.
 4. REPORT ANY DISCREPANCIES PRIOR TO COMMENCING WORK. NO RESPONSIBILITY IS BORN BY THE OWNER AND PROJECT MANAGER FOR UNKNOWN SUBSURFACE CONDITIONS.
 5. REINSTATE ALL AREAS AND ITEMS THAT ARE DAMAGED ON SITE AND REPORT ANY ERRORS AND/OR OMISSIONS TO THE PROJECT MANAGER.
 6. WITH THE EXCEPTION OF THE CITY OF OTTAWA CONSTRUCTION SPECIFICATION & STANDARD DETAILS, ONTARIO PROVINCIAL STANDARDS (OPSD) & STANDARD SPECIFICATIONS (OPSD) SHALL APPLY.
 7. THIS DRAWING IS TO BE READ AND INTERPRETED IN CONJUNCTION WITH THE CONTRACT DRAWINGS AND SPECIFICATIONS.



- PLANTING NOTES**
1. CONTRACTOR TO VERIFY LOCATION OF ALL UTILITIES PRIOR TO EXCAVATION.
 2. LOCATION OF ALL PLANT MATERIAL TO BE STAKED BY THE CONTRACTOR AND VERIFIED IN THE FIELD BY THE PROJECT MANAGER PRIOR TO THE EXCAVATION OF TREE PITS.
 3. ALL PLANT MATERIAL SHALL BE NURSERY GROWN STOCK UNLESS OTHERWISE NOTED.
 4. DECIDUOUS TREES TO HAVE A MINIMUM 1800 CLEAR STEM ABOVE GRADE.
 5. ALL PLANT MATERIAL SHALL BE WARRANTED FOR TWO YEARS FROM THE DATE OF PERFORMANCE ACCEPTANCE AS DETERMINED BY THE PROJECT MANAGER.
 6. ALL STEEL STAKING POSTS TO BE REMOVED AFTER ONE GROWING SEASON UNLESS OTHERWISE DIRECTED BY THE PROJECT MANAGER.
 7. CONTRACTOR TO MAKE GOOD ALL EXISTING AREAS DAMAGED BY HIS OR HER WORK TO THE SATISFACTION OF THE PROJECT MANAGER.
 8. QUERCUS SPECIES TO BE SPRUNG DUG SPECIMENS.
 9. ANY PROPOSED PLANT MATERIAL SUBSTITUTIONS SHALL BE MADE WITH PLANTS OF EQUIVALENT OVERALL FORM, HEIGHT, HABIT, FLOWER, LEAF, COLOUR AND CULTURE AND ONLY AFTER WRITTEN APPROVAL FROM THE PROJECT MANAGER.

NO.	DATE	DESCRIPTION
01	SEP 21/21	APPROVED CONCEPT SITE PLAN



COLIZZA BRUNI
architecture

78 CHAMBERLAIN AVE • OTTAWA • ONTARIO • K1S 1V9
T 613 236 2844 • F 613 236 6777 • www.colizzabruni.com

PROJECT NAME
ELLWOOD HOUSE EXTENSION

OTTAWA, ON

PROJECT NORTH

DRAWING TITLE
LANDSCAPE PLAN

SCALE
AS NOTED

DRAWN BY

DATE
10/25/21

PROJECT NO.
001-16


DRAWING NO.
L1

DRAWING LEGEND:


	EXISTING TREE TO BE RETAINED AND PROTECTED - REFER TO TREE CONSERVATION REPORT		PROPOSED SHRUB PLANTING BED WITH DECORATIVE RIVER ROCK MULCH & WEED BARRIER FABRIC (SEE DETAIL 2/L2)		PROPOSED INTERLOCK PAVING
	TREES TO BE REMOVED - REFER TO TREE CONSERVATION REPORT		PROPOSED PERENNIAL PLANTING BED WITH DECORATIVE RIVER ROCK MULCH & WEED BARRIER FABRIC (SEE DETAIL 3/L2)		EXISTING INTERLOCK PAVING
	EXISTING SHRUB PLANTING BED TO BE RETAINED AND PROTECTED		VINES		PROPOSED BIKE RACK
	EXISTING SHRUB PLANTING BED TO BE REMOVED		EXISTING TURF TO BE RETAINED		EXISTING FENCE
	PROPOSED CONIFEROUS TREE (SEE DETAIL 1/L2)		PROPOSED TURF - SOD		NEW 1.8M HIGH FENCE
	PROPOSED DECIDUOUS TREE (SEE DETAIL 1/L2)		DECORATIVE RIVERSTONE GROUND COVER TO BE LOCALLY SUPPLIED 1" RIVER WASHED STONE (WITH A WEED BARRIER OR LANDSCAPE FILTER FABRIC) SUPPLIED AND INSTALLED AT DEPTH OF 4"		RETAINING WALL (TBD)
					NEW ASPHALT PARKING AREA

PLANT LIST


KEY	QTY	BOTANICAL NAME	COMMON NAME	CAL./HT.	CONDITION/REMARKS	KEY	QTY	BOTANICAL NAME	COMMON NAME	CAL./HT.	CONDITION/REMARKS
DECIDUOUS TREES											
Al	2	AMELANCHIER LAEVIS	ALLEGHENY SERVICEBERRY	50MM	W/B	Ca	6	CARAGANA ARBORESCENS 'SUTHERLAND'	SOUTHERLAND CARAGANA	180CM HT.	CONTAINER
Ar	1	ACER RUBRUM	RED MAPLE	70MM	W/B	Ea	6	EUONYMUS ALATUS 'COMPACTUS'	DWARF BURNING BUSH	30CM HT.	CONTAINER
Cc	1	CERCIS CANADENSIS	EASTERN REDBUD	50MM	W/B	Js	31	JUNIPERUS SABINA 'TAMARISCIFOLIA'	TAM JUNIPER	30CM HT.	CONTAINER
Co	1	CELTIS OCCIDENTALIS	COMMON HACKBERRY	70MM	W/B	Po	3	PHYSCARPUS OPULEFOLIUS	COMMON NINEBARK	50CM HT.	CONTAINER
Gt	2	GLEDITSIA TRIACANTHOS 'SHADEMASTER'	SHADEMASTER HONEY LOCUST	50MM	W/B	RaL	36	RHUS ARMATA 'ORO-LOW'	GRO-LOW FRAGRANT SUMAC	30CM HT.	CONTAINER
Ms	1	MAGNOLIA STELLATA 'ROYAL STAR'	STAR MAGNOLIA	50MM	W/B	Rr	23	ROSA RUGOSA	RUGOSA ROSE	30CM HT.	CONTAINER
Om	1	QUERCUS MACROCARPA	BUR OAK	70MM	W/B	Ra	38	RIBES ALPINUM	ALPINE CURRANT	50CM HT.	CONTAINER
Qr	1	QUERCUS RUBRA	RED OAK	70MM	W/B	Sv	3	SYRINGA VULGARIS	COMMON LILAC	180CM HT.	CONTAINER
Tc	2	TILIA CORDATA	LITTLELEAF LINDEN	70MM	W/B						
Sr	4	SYRINGA RETICULATA	JAPANESE TREE LILAC	50MM	W/B						
CONIFEROUS TREES											
To	4	THUJA OCCIDENTALIS	EASTERN WHITE CEDAR	1.8M HEIGHT	W/B	Ep	45	ECHINACEA PURPUREA	CONEFLOWER	15CM HT.	CONTAINER
TsS	3	THUJA OCCIDENTALIS 'SMARAGO'	EMERALD GREEN CEDAR	1.8M HEIGHT	W/B	He	100	HEMEROCALLIS	DAYLILY	15CM HT.	CONTAINER
VINES											
Pq	25	PARTHENOISSIS QUINQUEFOLIA	VIRGINA CREEPER	1 GAL.	CONTAINER	Hv	13	PANICUM VIRGATUM 'HEAVY METAL'	BLUE SWITCH GRASS	1 GAL.	CONTAINER
						Rh	15	RUDBECKIA HIRTA	BLACKED-EYED SUSAN	15CM HT.	CONTAINER

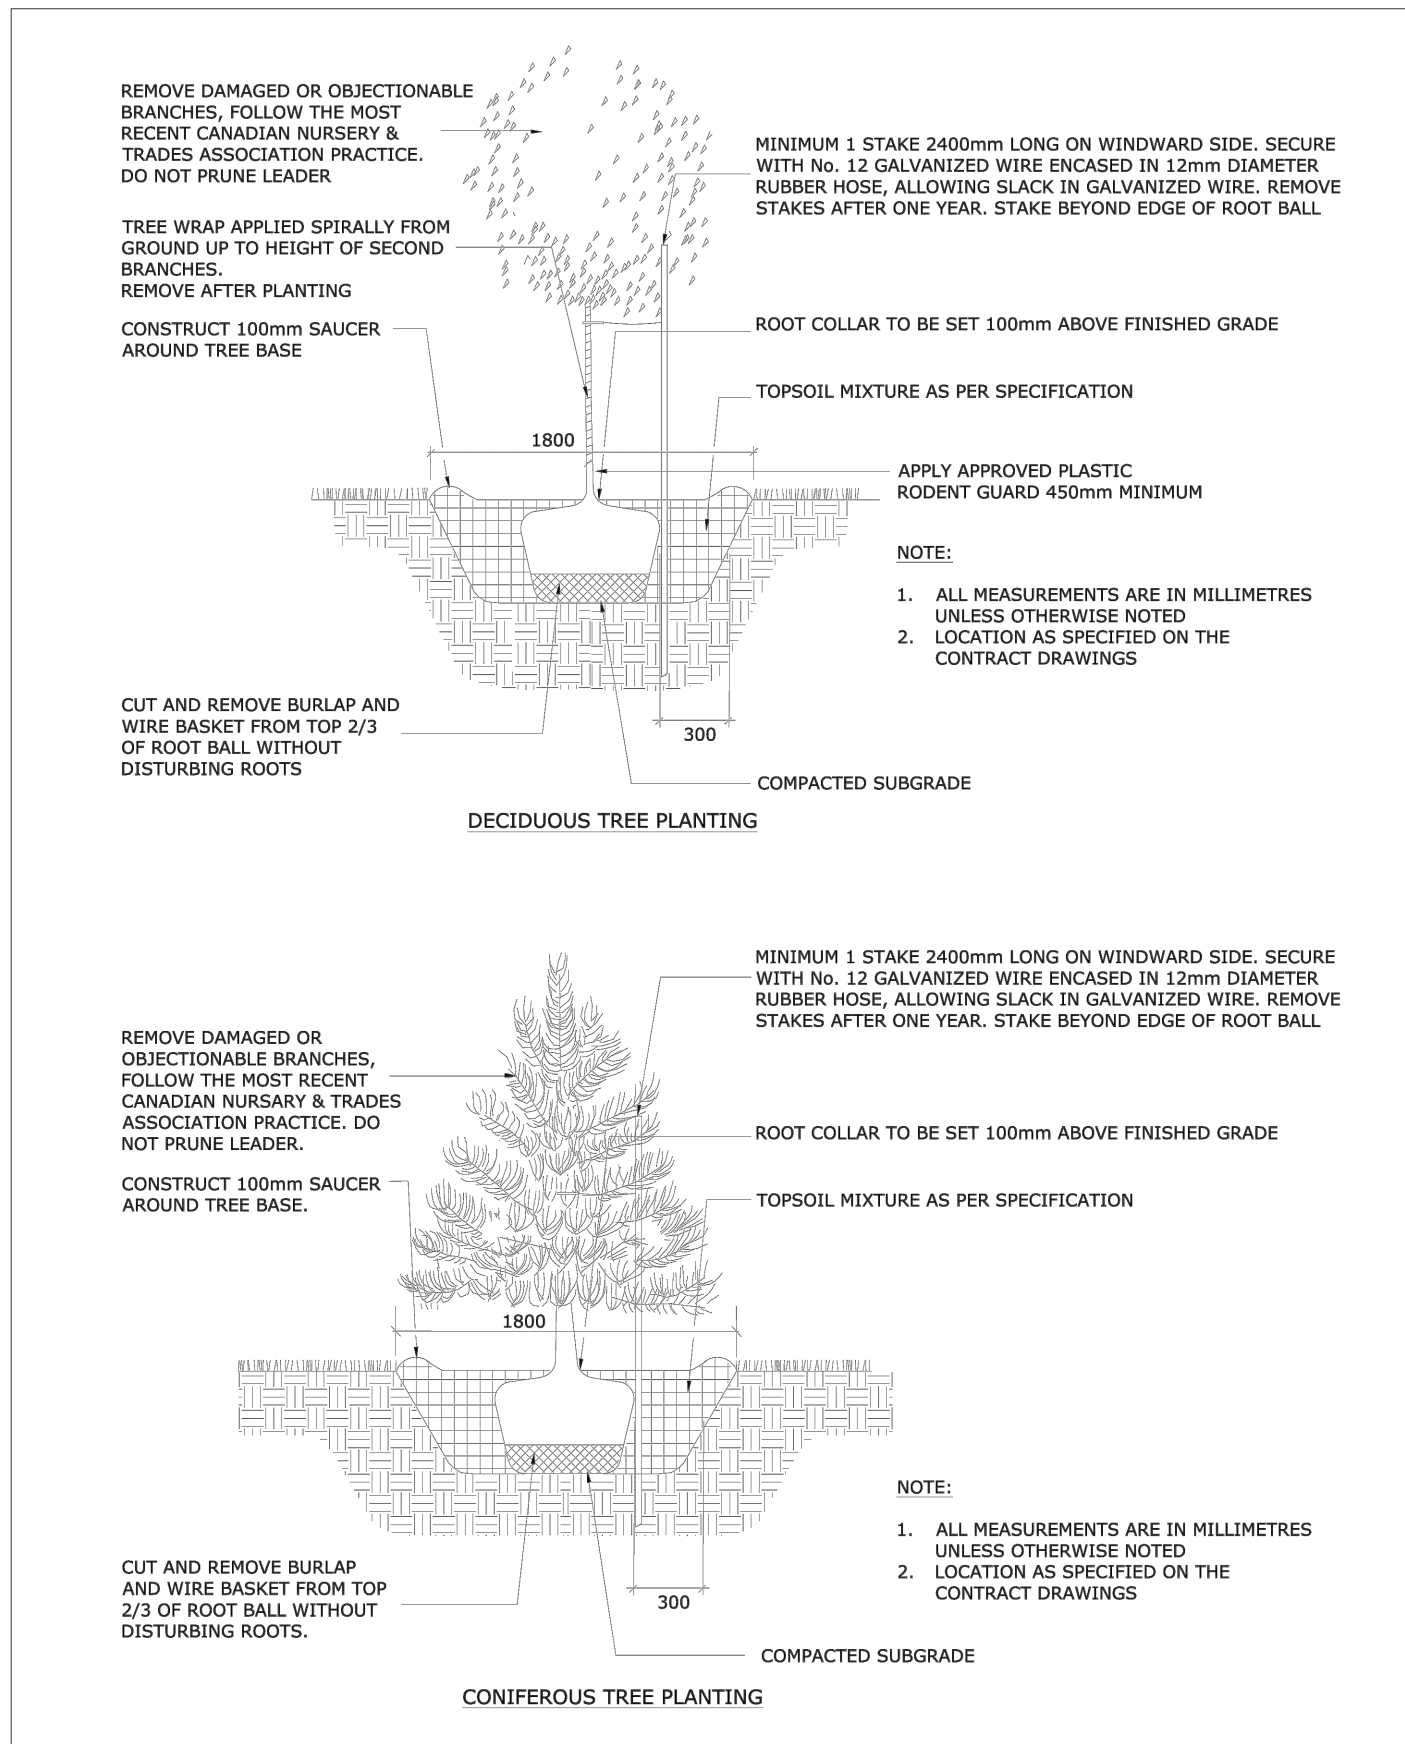


1 PLANTING TRENCH WELL DRAINED SOILS (LOT)

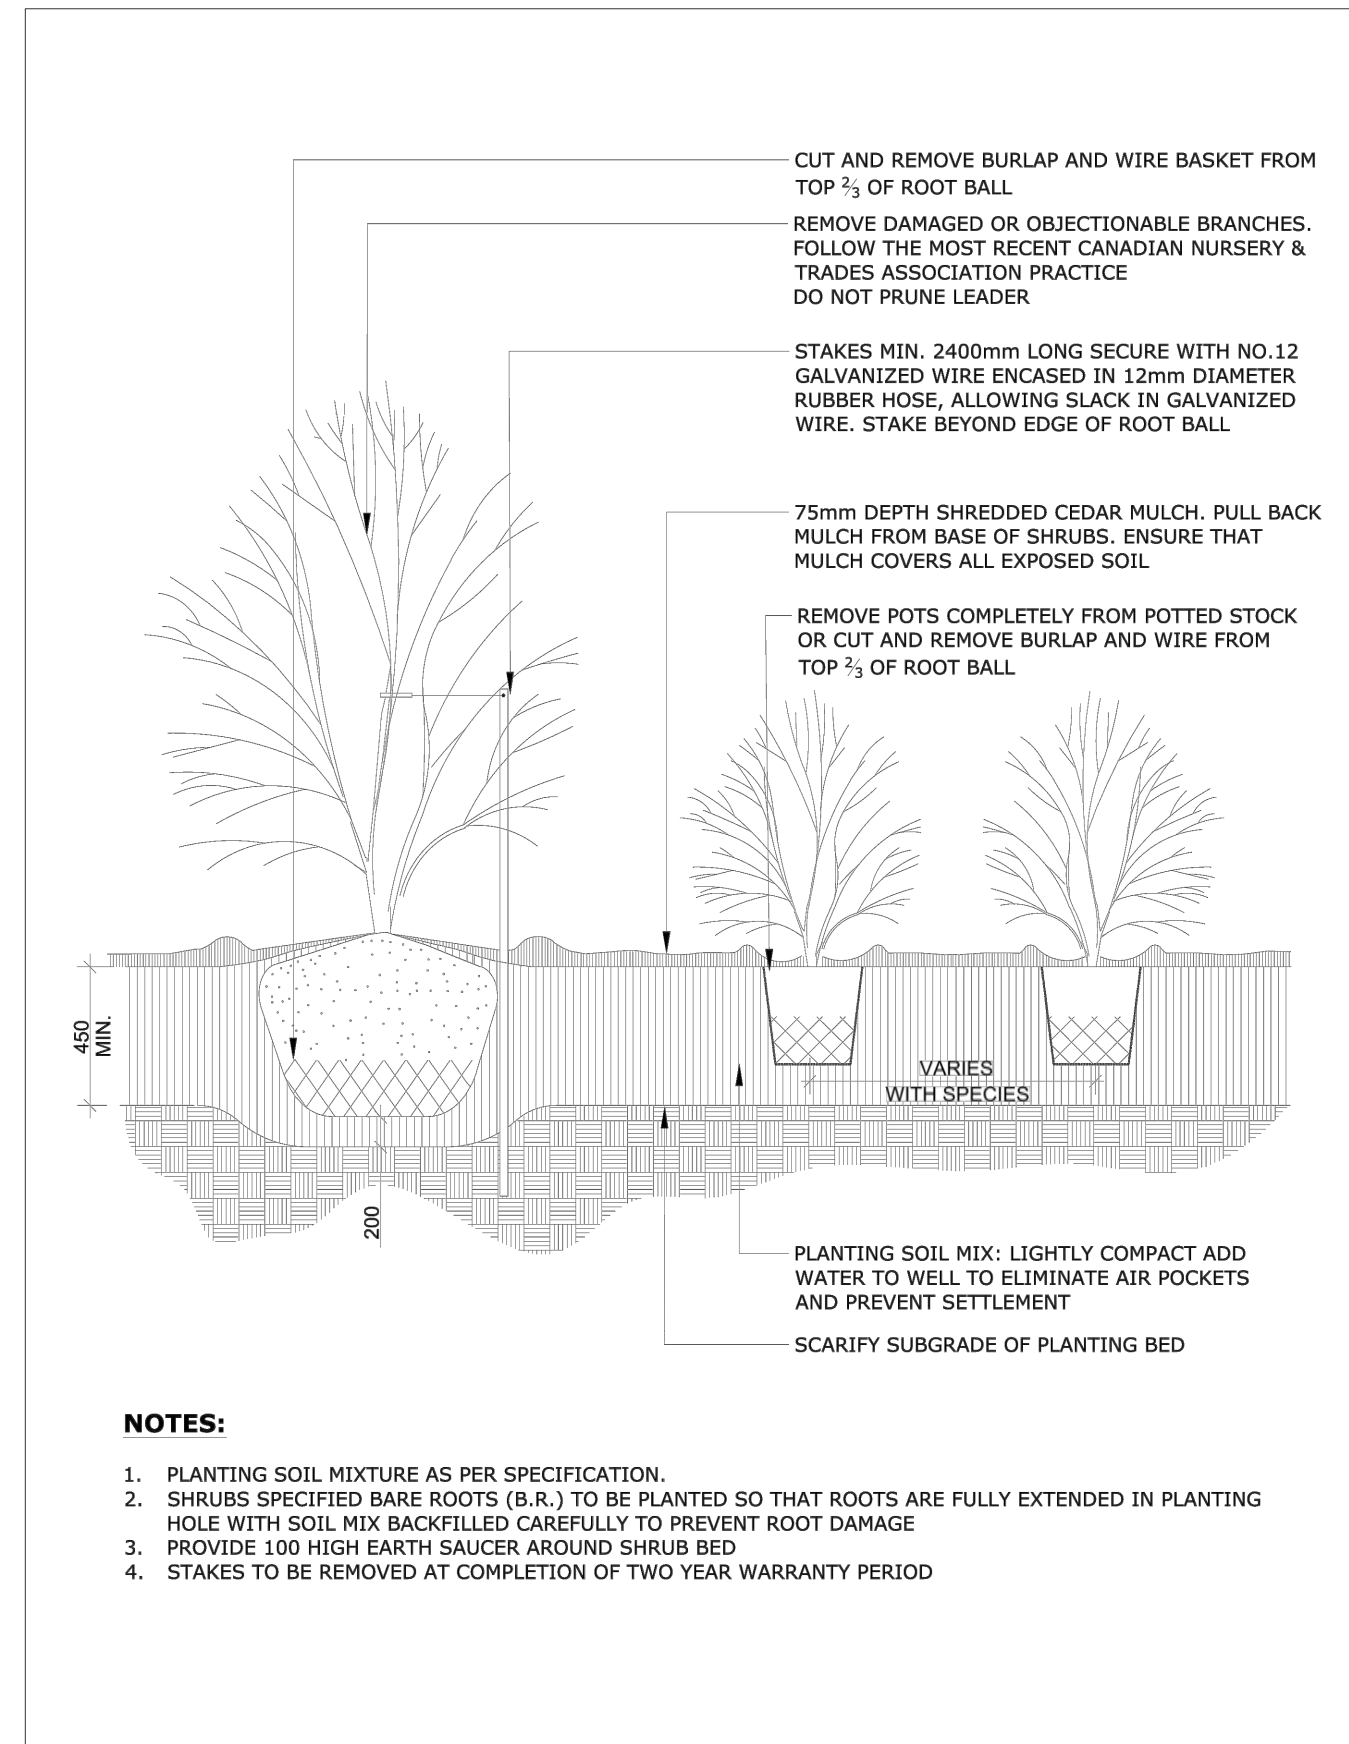

2 CONTINUOUS SHRUB BED PLANTING

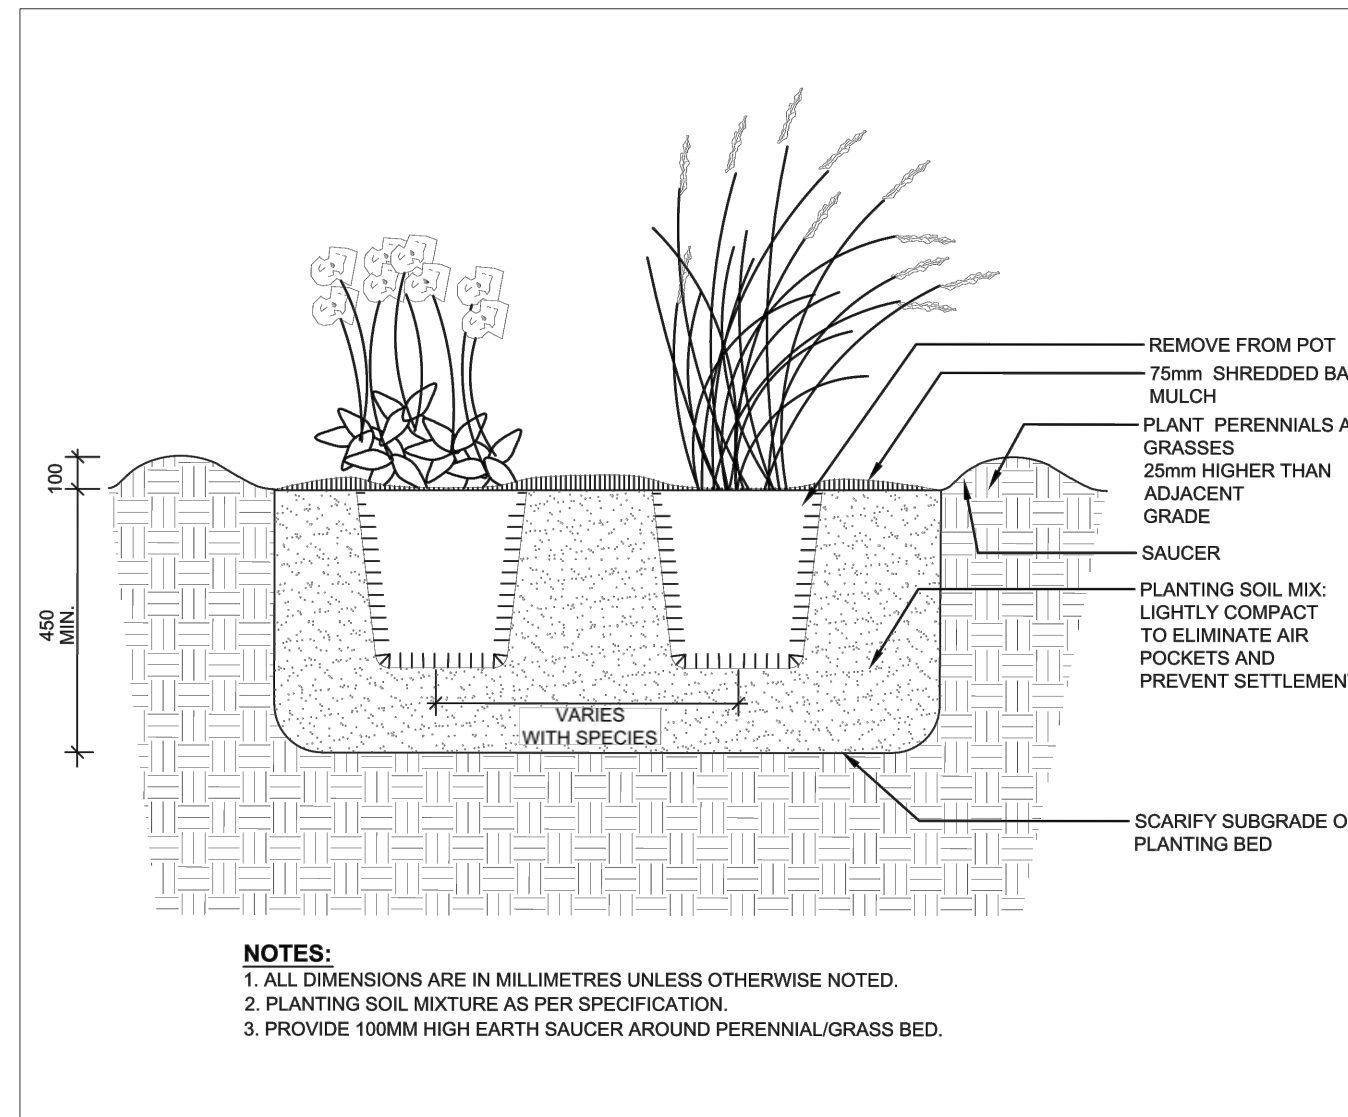

3 PERENNIAL AND ORNAMENTAL GRASS PLANTING

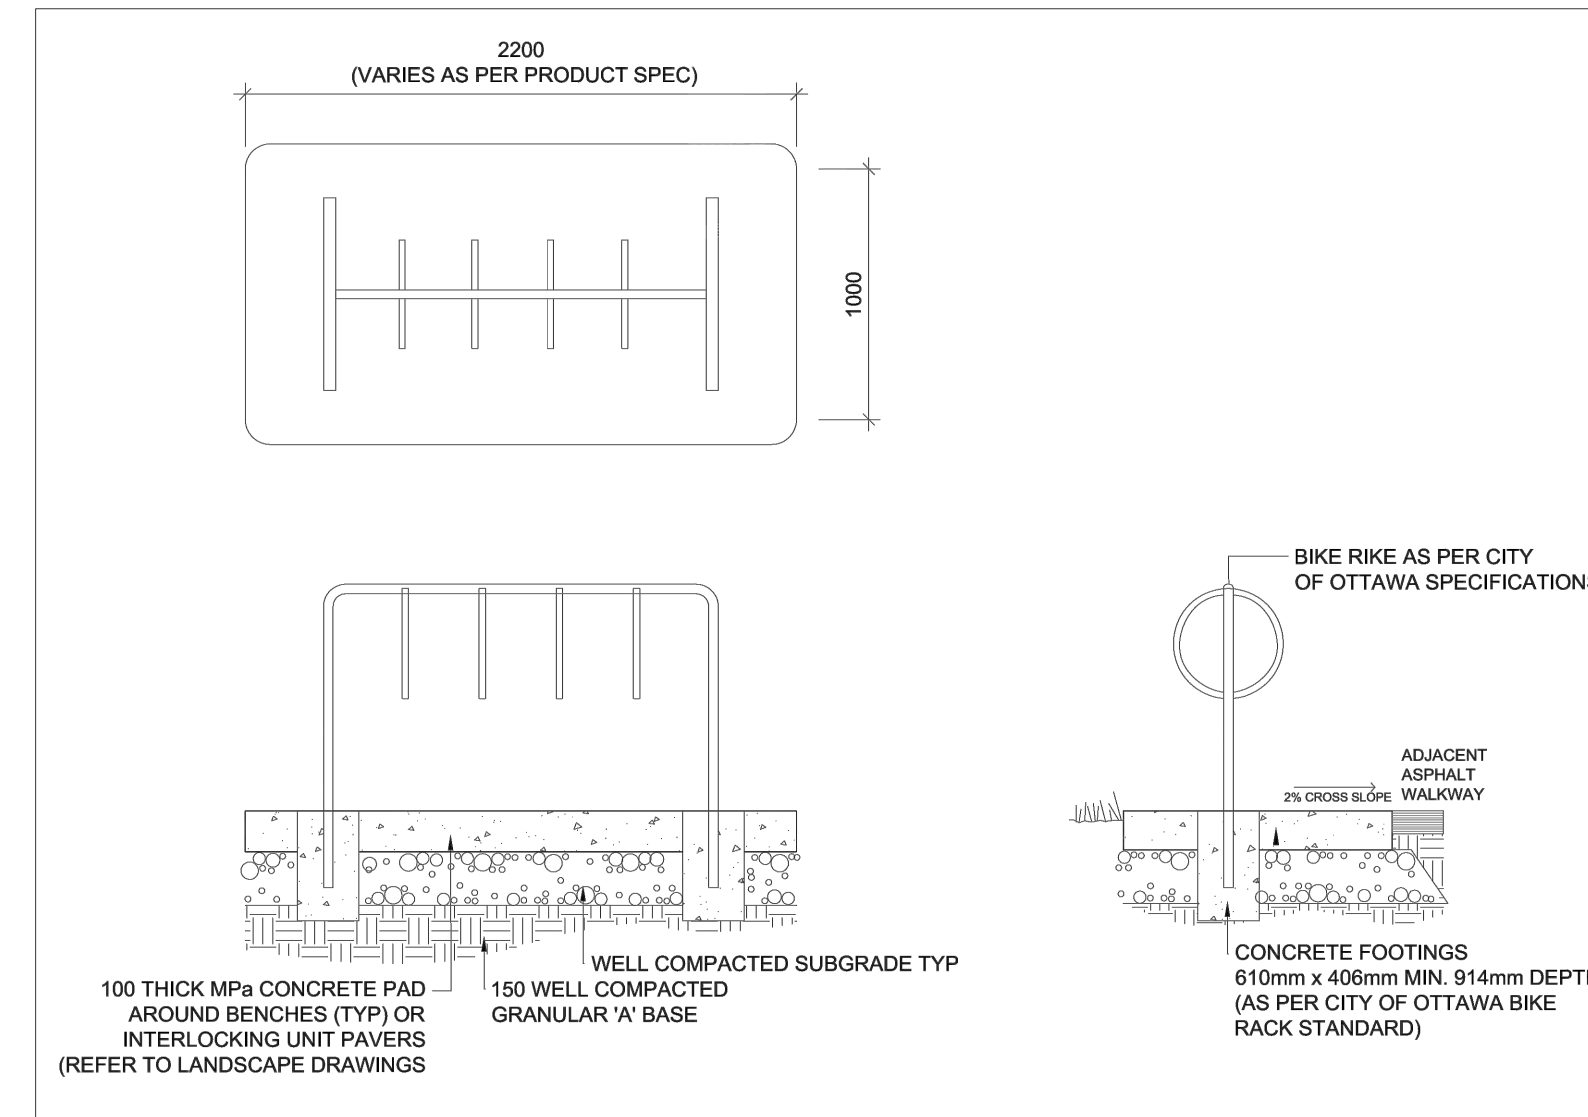

4 CONCRETE PAD FOR CITY OF OTTAWA STANDARD BIKE RACK



SPECIFICATIONS:

A. SEGMENTAL LANDSCAPE PLANTER WALL

1.0 GENERAL

1. SCOPE OF WORK

1. THE WORK COVERED BY THIS SECTION INCLUDES THE FURNISHING OF ALL LABOUR, MATERIALS, EQUIPMENT, INSPECTION AND CONSTRUCTION OF A MODULAR CONCRETE SEGMENTAL RETAINING WALL ("SRW") INCLUDING DRAINAGE SYSTEM AND GEOSYNTHETIC REINFORCEMENT. THE WORK INCLUDED IN THIS SECTION CONSISTS OF, BUT IS NOT LIMITED, TO THE FOLLOWING:

1. EXCAVATION AND FOUNDATION SOIL PREPARATION.
2. FURNISH AND PLACEMENT OF THE LEVELING BASE.
3. FURNISH AND PLACEMENT OF THE CONCRETE STARTER UNITS.
4. FURNISH AND PLACEMENT OF GEOTEXTILE.
5. FURNISH AND PLACEMENT OF SRW UNITS.
6. FURNISH AND PLACEMENT OF ROOT BARRIER.
7. FURNISH FINAL GRADING.

2.0 REFERENCES

1. ALL REFERENCES TO LATEST EDITION OF STANDARDS:

1. ONTARIO PROVINCIAL STANDARD SPECIFICATIONS (OPSS)
 1. OPSS 1010, AGGREGATES - GRANULAR A, B, M, AND SELECT SUBGRADE MATERIALS
2. AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM):
 1. ASTM C131, TEST METHOD FOR RESISTANCE TO DEGRADATION OF SMALL SIZE COURSE AGGREGATES BY ABRASION AND IMPACTS IN THE LOS ANGELES MACHINE
 2. ASTM C 140, SAMPLING AND TESTING CONCRETE MASONRY UNITS
 3. ASTM C 979, STANDARD SPECIFICATION FOR PIGMENTS FOR INTEGRALLY COLOURED CONCRETE.
 4. ASTM C 1372, STANDARD SPECIFICATIONS FOR SEGMENTAL RETAINING WALL UNITS
 5. ASTM D 698, STANDARD TEST METHOD FOR LABORATORY COMPACTION CHARACTERISTICS OF SOIL USING STANDARD EFFORT (12,000 FT-LBF/FT³ (600 KN-M/M³)).
3. NATIONAL CONCRETE MASONRY ASSOCIATION (NCMA):
 1. NCMA DESIGN MANUAL FOR SEGMENTAL RETAINING WALLS, SECOND EDITION.
 2. NCMA TEK 2-4 - SPECIFICATIONS FOR SEGMENTAL RETAINING WALL UNITS.
 3. NCMA SRW-2 - DETERMINATION OF SHEAR STRENGTH BETWEEN SEGMENTAL CONCRETE UNITS.

3.0 SUBMITTALS

1.1 SEGMENTAL RETAINING WALL:

1. SAMPLES FOR VERIFICATION: THREE REPRESENTATIVE FULL-SIZE SAMPLES OF SRW. THICKNESS, COLOR AND FINISH THAT INDICATE THE RANGE OF COLOR VARIATION AND TEXTURE EXPECTED UPON PROJECT COMPLETION.
2. ACCEPTED SAMPLES BECOME THE STANDARD OF ACCEPTANCE FOR THE PRODUCT PRODUCED.
3. TEST RESULTS FROM AN INDEPENDENT TESTING LABORATORY FOR COMPLIANCE OF CONCRETE PAVERS WITH ASTM C1372.
4. MANUFACTURER'S CATALOG PRODUCT DATA, INSTALLATION INSTRUCTIONS, AND MATERIAL SAFETY DATA SHEETS FOR THE SAFE HANDLING OF THE SPECIFIED MATERIALS AND PRODUCTS.

2. LEVELING BASE:

1. TEST RESULTS FROM AN INDEPENDENT TESTING LABORATORY FOR SIEVE ANALYSIS PER ASTM C136.

3. GEOTEXTILE FABRIC:

1. PROVIDE PRODUCT DATA SHEETS.
2. PROVIDE ONE (1) REPRESENTATIVE SAMPLE 150MM X 150MM

4.0 MATERIAL

1. SEGMENTAL RETAINING WALL ("SRW"), AND COPING

1. BASIS-OF-DESIGN PRODUCT: SRW MODULAR, SOLID, DRY-CAST CONCRETE BLOCKS BASED ON:
 1. PERMACON, LAFITT TANDEM WALL (OR APPROVED EQUIVALENT)
 2. THE SPECIFIED PRODUCT NOTED ESTABLISH THE MINIMUM REQUIREMENTS THAT SUBSTITUTIONS MUST MEET TO BE CONSIDERED ACCEPTABLE.
 3. REQUESTS FOR ALTERNATIVE PRODUCTS WILL NOT BE CONSIDERED DURING TENDER.
2. PRODUCT REQUIREMENTS:
 1. SRW: LAFITT TANDEM WALL
 2. COLOUR: AMBOISE BEIGE
 3. FINISH: CHISELED
 4. PROVIDE SRW MEETING THE REQUIREMENTS SET FORTH IN ASTM C1372.
 5. PROVIDE SRW MEETING THE PHYSICAL PROPERTIES LISTED BELOW AS TESTED USING ASTM C140:
 6. DIMENSIONAL TOLERANCE SHALL BE +/- 3 MM (1/8") FOR HEIGHT, WIDTH, AND LENGTH.
 7. THE MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 35 MPA (5000 PSI).
 8. THE MAXIMUM MOISTURE ABSORPTION SHALL BE 1.0 KN/M³.
 9. PROVIDE SRW UTILIZING AN INTEGRAL SHEAR KEY CONNECTION WITH OFFSET TO CREATE A VERTICAL WALL.
 10. PROVIDE CONCRETE STARTER UNITS AS PART OF INSTALLATION.

2. GEOTEXTILE

1. PROVIDE GEOTEXTILE MATERIAL CONFORMING TO THE FOLLOWING PERFORMANCE CHARACTERISTICS, MEASURED PER THE TEST METHODS REFERENCED:
 1. 4 OZ., NONWOVEN NEEDLE PUNCHED GEOTEXTILE COMPOSED OF 100% POLYPROPYLENE STAPLE FIBERS THAT ARE INERT TO BIOLOGICAL DEGRADATION AND RESISTS NATURALLY ENCOUNTERED CHEMICALS, ALKALIS, AND ACIDS.
 2. GRAB TENSILE STRENGTH: ASTM D 4632: 115 LBS.
 3. GRAB TENSILE ELONGATION: ASTM D 4632: 50%
 4. TRAPEZOIDAL TEAR: ASTM D4533: 50 LBS.
 5. PUNCTURE: ASTM D4833: 65 LBS.
 6. APPARENT OPENING SIZE: ASTM D 4751: 0.212 MM, 70 U.S. SIEVE
 7. PERMITTIVITY: ASTM D 4491: 2.0 SEC -1
 8. FLOW RATE: ASTM D 4491: 140 GAL/MIN/S.F.

3. CONCRETE ADHESIVE

1. PROVIDE A CONCRETE ADHESIVE MANUFACTURED BY THE FOLLOWING (OR APPROVED EQUIVALENT):
 1. LEPAGE: PL 9000 HEAVY DUTY CONSTRUCTION ADHESIVE
 2. ALLIANCE: GATOR GLUE XP POLYURETHANE CONSTRUCTION ADHESIVE.

5.0 CONSTRUCTION

1. EXAMINE AREAS INDICATED TO RECEIVE SRW FOR COMPLIANCE WITH REQUIREMENTS FOR INSTALLATION TOLERANCES AND OTHER CONDITIONS AFFECTING PERFORMANCE FOR THE FOLLOWING ITEMS:
 1. VERIFY THAT SUBGRADE PREPARATION, COMPACTED DENSITY AND ELEVATIONS CONFORM TO SPECIFIED REQUIREMENTS.
 2. VERIFY ALL SITE SERVICES ARE LOCATED OUTSIDE OF SRW CONSTRUCTION AREA UNLESS OTHERWISE NOTED.
2. LEVELING BASE
 1. LEVELING BASE AGGREGATE TO BE COMPOSED OF INERT, CLEAN, TOUGH AND DURABLE PARTICLES OF NATURAL OR CRUSHED ROCK CAPABLE OF WITHSTANDING THE DELETERIOUS EFFECTS OF EXPOSURE TO WATER, FREEZE-THAW, HANDLING AND SPREADING.
 2. MATERIAL TO BE CAPABLE OF COMPACTING TO MINIMUM REQUIRED DENSITY.
 3. AGGREGATE SHALL HAVE A PERCENTAGE OF WEAR, BY THE LOS ANGELES TEST (ASTM C 131), OF NOT MORE THAN 50.
 4. THE AGGREGATE PARTICLES SHALL BE UNIFORM IN QUALITY, FREE FROM EXCESS OF FLAT AND ELONGATED PARTICLES.
 5. THE PARTICLES SHALL HAVE A GRADATION FALLING WITHIN THE STANDARD LIMITS FOR GRANULAR A AS OUTLINED IN MTO OPSS 1010.
3. GEOTECHNICAL INSPECTION
 1. VERIFY SOIL PARAMETERS AND GROUNDWATER CONDITIONS ARE ACCEPTABLE FOR SRW.
 2. VERIFY SUBGRADE BEARING CAPACITY MEETS OR EXCEEDS VALUES REQUIRED FOR AREA TO RECEIVE SRW.
 3. IDENTIFY GROUNDWATER CONDITIONS AND/OR OTHER WATER SOURCE PRIOR TO SRW INSTALLATION.
 4. ENSURE THAT SURFACE WATER RUNOFF AND/OR OTHER SOURCES OF WATER ARE BEING CONTROLLED DURING CONSTRUCTION AND DIRECTED AWAY FROM THE SRW TO A FUNCTIONING DRAIN.
4. EXCAVATION
 1. THE FOUNDATION SOIL SHALL BE EXCAVATED AS REQUIRED TO THE GRADES AND DIMENSIONS SHOWN ON THE CONSTRUCTION DRAWINGS.
5. LEVELING BASE PLACEMENT
 1. THE MINIMUM THICKNESS OF THE LEVELING BASE SHALL BE 300MM
 2. THE LEVELING BASE SHALL EXTEND A MINIMUM OF 150MM FROM THE FRONT, AND 300MM FROM THE BACK, OF THE PROPOSED WALL.
 3. THE MATERIAL SHALL BE COMPACTED TO >99% STANDARD PROCTOR DENSITY.
6. CONCRETE STARTER UNITS
 1. CONCRETE STARTER UNITS PER AS PER WALL SUPPLIER REQUIREMENTS.
7. PLACING GEOTEXTILE
 1. PLACE GEOTEXTILE SO THAT THE LENGTHS ARE SUFFICIENTLY LONG TO BE SET AGAINST THE BACK OF THE FIRST RETAINING WALL UNIT, RUN OVER THE PREPARED FOUNDATION, EXTEND TOWARDS THE BACK OF THE EXCAVATION, AND UP THE EXCAVATION FACE AS SHOWN IN THE CONTRACT DRAWINGS.
 2. GEOTEXTILE OVERLAPS SHALL BE A MINIMUM OF 300MM.
 3. START INSTALLATION BY LAYING THE GEOTEXTILE ALONG THE BOTTOM OF THE EXCAVATION, ALLOWING EXTRA MATERIAL TO BE SET AGAINST THE BACK OF THE FIRST RETAINING WALL UNIT WHEN INSTALLED. RUN LENGTHS UP THE BACK OF THE EXPOSED CUT FACE AND STAKE AGAINST THE SLOPE DURING CONSTRUCTION.

6.0 CONSTRUCTION TOLERANCES

1. INSTALLATION OF SRW FACIA SHALL BE WITHIN ALL THE FOLLOWING ACCEPTABLE TOLERANCES:
 1. VERTICAL CONTROL: +/- 32MM OVER A 3.0M DISTANCE
 2. HORIZONTAL CONTROL: STRAIGHT LINES: +/- 32MM OVER 3.0M DISTANCE
 3. ROTATION OF THE SRW FACE: MAXIMUM 2.0 DEGREES FROM VERTICAL.

7.0 MEASUREMENT FOR PAYMENT AND BASIS OF PAYMENT

1. PAYMENT AT THE CONTRACT LUMP SUM PRICE FOR THE TENDER ITEM "SEGMENTAL LANDSCAPE PLANTER WALL" SHALL BE FULL COMPENSATION FOR ALL LABOUR, EQUIPMENT AND MATERIAL REQUIRED FOR SUPPLY AND INSTALLATION OF THE WALL SYSTEM.

B. BICYCLE RACK

1.0 ACCEPTABLE MATERIALS:

1. MODEL #BU-4RING AS MODIFIED TO CITY OF OTTAWA SPECIFICATIONS. SURFACE MOUNT AS SUPPLIED BY JOHNSONS ENVIRONMENTAL PRODUCTS INC. TEL: 1-800-653-1222. METAL FRAMEWORK TO BE POWDER COATED WITH "INFINGUARD" PROFESSIONAL ANTI-RUST CORROSION SYSTEM.
2. BIKE-UP STANDARD 4-RING 'RING BACK', AS SUPPLIED BY BIKE-UP BICYCLE PARKING SYSTEMS INC., TEL: 800-661-3506. METAL TO BE POWDER-COATED OR GALVANIZED, FASTENED WITH STAINLESS STEEL ANTI-VANDAL HARDWARE.

2.0 INSTALLATION OF SEGMENTAL RETAINING WALL UNITS.

1. INSTALL UNITS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS AND RECOMMENDATIONS FOR THE SPECIFIC CONCRETE WALL UNIT, AND AS SPECIFIED HEREIN.
2. THE BOTTOM ROW OF WALL MODULES SHALL BE PLACED ON THE PREPARED STARTER FOOTING AS SHOWN ON THE CONTRACT DRAWINGS. CARE SHALL BE TAKEN TO ENSURE THAT THE WALL MODULES ARE ALIGNED PROPERLY, LEVELED FROM SIDE TO SIDE AND FRONT TO BACK AND ARE IN COMPLETE CONTACT WITH THE BASE.
3. THE WALL MODULES ABOVE THE BOTTOM COURSE SHALL BE PLACED SUCH THAT THE TONGUE AND GROVE ARRANGEMENT PROVIDE A VERTICAL WALL FACE.
4. VENEER AND STRUCTURAL WALL UNITS TO BE PRE-ASSEMBLED PRIOR TO PLACING.
5. SUCCESSIVE COURSES SHALL BE PLACED TO CREATE A RUNNING BOND PATTERN.
6. THE WALL MODULES SHALL BE SWEEP CLEAN BEFORE PLACING ADDITIONAL LEVELS TO ENSURE THAT NO DIRT, CONCRETE OR OTHER FOREIGN MATERIALS BECOME LODGED BETWEEN SUCCESSIVE LIFTS OF THE WALL MODULES.
7. THE CONTRACTOR SHALL CHECK THE LEVEL OF WALL MODULES WITH EACH LIFT TO ENSURE THAT NO GAPS ARE FORMED BETWEEN SUCCESSIVE LIFTS.
8. CARE SHALL BE TAKEN TO ENSURE THAT THE WALL ARE NOT BROKEN OR DAMAGED DURING HANDLING AND PLACEMENT.
9. FINAL COURSE OF THE STRUCTURAL UNITS SHALL BE SECURED TO THE UNITS BELOW USING CONCRETE ADHESIVE PRIOR TO PLACING COPING.
9. INSTALLATION OF WALL COPING
 1. THE COPING UNITS SHALL BE SECURED TO THE TOP OF THE WALL WITH TWO 10MM BEADS OF THE APPROVED FLEXIBLE CONCRETE ADHESIVE POSITIONED 50MM IN FRONT AND BEHIND THE TONGUE OF THE LAST COURSE OF RETAINING WALL UNITS.
 2. FINISH GRADING BEHIND THE WALL TO DIRECT SURFACE RUN OFF WATER AWAY FROM THE SEGMENTAL RETAINING WALL.

01	SEP 21/21	APPROVED CONCEPT SITE PLAN
NO.	DATE	DESCRIPTION

studioRed
landscape architecture

COLIZZA BRUNI
architecture

78 CHAMBERLAIN AVE. • OTTAWA • ONTARIO • K1S 1V9
T 613.236.2944 • F 613.236.6777 • www.colizzabruni.com

PROJECT NAME

ELLWOOD HOUSE EXTENSION

OTTAWA, ON

DRAWING TITLE	LANDSCAPE DETAILS
DRAWING NO.	
SCALE	L2
AS NOTED	
DRAWN BY	
DATE	10/25/21
PROJECT NO.	001-16