



Stormwater Management and Servicing Report

Navan Stacked Town Homes
6001-6005 Renaud Road
Orleans, Ontario

Prepared for:

Landric Homes Inc.
63 chemin de Montreal Est
Gatineau (QC) J8M 1K3

Attention: Eric Danis

LRL File No.: 210216-05

April 3rd, 2023
Rev. July 24th, 2024



TABLE OF CONTENTS

1	INTRODUCTION AND SITE DESCRIPTION.....	1
2	EXISTING SITE AND DRAINAGE DESCRIPTION.....	2
3	SCOPE OF WORK.....	2
4	REGULATORY APPROVALS.....	3
5	WATER SUPPLY AND FIRE PROTECTION.....	3
5.1	Existing Water Supply Services and Fire Hydrant Coverage.....	3
5.2	Water Supply Servicing Design	3
6	SANITARY SERVICE.....	6
6.1	Existing Sanitary Sewer Services	6
6.2	Sanitary Sewer Servicing Design.....	7
7	STORMWATER MANAGEMENT	7
7.1	Existing Stormwater Infrastructure	7
7.2	Design Criteria	7
7.2.1	Water Quality.....	7
7.2.2	Water Quantity	8
7.3	Method of Analysis	8
7.4	Proposed Stormwater Quantity Controls	8
8	EROSION AND SEDIMENT CONTROL.....	11
9	CONCLUSION.....	11
10	REPORT CONDITIONS AND LIMITATIONS.....	12



APPENDICES

Appendix A	Pre-consultation / Correspondence
Appendix B	Water Supply Calculations
Appendix C	Wastewater Collection Calculation Supporting Documents
Appendix D	Stormwater Management Calculation Supporting Documents Hydrovex Flow Control Unit Stormtech Chambers Detail
Appendix E	Civil Engineering Drawings
Drawings/Figures	Proposed Site Plan Legal Survey Ziegler Road Plan & Profile As-builts

LIST OF TABLES

Table 1: City of Ottawa Design Guidelines Design Parameters	3
Table 2: Development Residential Population Estimate	4
Table 3: Summary of Boundary Conditions	5
Table 4: Fire Protection Summary Table	6
Table 5: Drainage Areas	9
Table 6: Stormwater Release Rate & Storage Volume Summary (100 Year).....	10

LIST OF FIGURES

Figure 1 – Arial View of Proposed Development	1
--	----------



1 INTRODUCTION AND SITE DESCRIPTION

LRL Associates Ltd. was retained by Landric Homes Inc. to complete a Stormwater Management Analysis and Servicing Brief for a proposed development of stacked townhomes located at 6001-6005 Renaud Rd, Orleans, Ottawa. The legal description of the property is Part of Lot 7, Concession 3, geographic Township of Gloucester, City of Ottawa.



Figure 1: Aerial View of Proposed Development

The site at 6001-6005 Renaud Road has approximately 76.1 metres of frontage along Renaud Road (south property line), maximum side yard depth of approximately 61.0 metres. The overall lot area is approximately **0.46 ha**. The site is currently zoned DR (Development Reserve Zone) and is occupied by two detached residential dwellings (2-storey and 1.5-storey buildings). Most of the site is landscaped with some paved surfaces.

The proposed works will only take into consideration the area of site allocated to the development of the stacked townhomes and amenities. These works will be located primarily within the south portion of the lot, with the exception of a lane along the east property line (to provide site access to Ziegler). Frontage along Renaud will remain the same, at approximately 76.1m. Side yard lengths will vary; west side yard of 35.5m, east side yard of 61.0m. Rear yard lot line will be split



between the lot line abutting the future semi-detached lots at 68.5m, and abutting Ziegler street at 11.6m. The overall limits of construction area is approximately **0.29 ha**

The development proposes five (5) blocks of 3-storey stacked townhome buildings with walk-out basements, consisting of 20 units to the south of the property and 6 semi-detached houses to the north of the property. However, the 6 semi-detached house will not be considered for site plan application or within the stormwater report. The proposed development will also feature 18 surface parking spaces as well as sheltered garages to accommodate parking demands.

For the purposes of this report & design, the lots allocated to the development of future semi-detached homes will not be considered. The combined area of the future semi-detached lots is approximately 68.5m (frontage along Renaud) by 25.3m (side yard along the west property line).

This report has been prepared in consideration of the terms and conditions noted above and with the civil drawings prepared for the new development. Should there be any changes in the design features, which may relate to the stormwater considerations, LRL Associates Ltd. should be advised to review the report recommendations.

2 EXISTING SITE AND DRAINAGE DESCRIPTION

The development boundary for the stacked townhouses within the larger parcel of land is approximately **0.29 ha**. It is gently sloped north from Renaud Road to Ziegler Street. Existing elevations range from 75.65m along south property line fronting Renaud St to 74.34m along north property line fronting Ziegler St. The topography of the site divides the pre-development drainage pattern into two directions; 1) towards Ziegler Street, and 2) towards Renaud Street.

Sewer and watermain mapping, along with as-built information collected from the City of Ottawa indicate the following existing infrastructure located within the adjacent right-of-way:

Ziegler Street:

- 200mmØ PVC DR-18 watermain
- 250mmØ PVC DR-35 sanitary sewer
- 750, 825 & 975mmØ CL 100-D concrete storm sewer

3 SCOPE OF WORK

As per applicable guidelines, the scope of work includes the following:

Stormwater management

- Calculate the allowable stormwater release rates towards Renaud Road and towards Ziegler Street (to mimic pre-development conditions)
- Calculate the anticipated post-development stormwater release rates.
- Demonstrate how the target quantity objectives will be achieved.



Water services

- Calculate the expected water supply demand at average and peak conditions.
- Calculate the required fire flow as per the Fire Underwriters Survey (FUS) method.
- Confirm the adequacy of water supply and pressure during peak flow and fire flow.
- Describe the proposed water distribution network and connection to the existing system.

Sanitary services

- Describe the existing sanitary sewers available to receive wastewater from the building.
- Calculate peak flow rates from the development.
- Describe the proposed sanitary sewer system.
- Review impact of increased sanitary flow on downstream sanitary sewer.

4 REGULATORY APPROVALS

An MECP Environmental Compliance Approval is not expected to be required for installation of the proposed storm and sanitary sewers within the site. A Permit to Take Water is not anticipated to be required for pumping requirements for sewer installation. The Rideau Valley Conservation Authority will need to be consulted to obtain municipal approval for site development. No other approval requirements from other regulatory agencies are anticipated.

5 WATER SUPPLY AND FIRE PROTECTION

5.1 Existing Water Supply Services and Fire Hydrant Coverage

The subject property lies within the City of Ottawa 2E water distribution network pressure zone. The subject property is located within proximity of an existing 200 mm dia. watermain along Ziegler St. There are currently several existing fire hydrants available to service the subject property. Refer to **Appendix B** for the location of fire hydrants.

5.2 Water Supply Servicing Design

The subject property is proposed to be serviced via a closed loop network of 150 mm diameter watermain connected to the existing 200 mm watermain within Ziegler Street. Refer to Site Servicing Plan C.401 in **Appendix E** for servicing layout.

Table 1 summarizes the City of Ottawa Design Guidelines design parameters employed in the preparation of the water demand estimate.

Table 1: City of Ottawa Design Guidelines Design Parameters

Design Parameter	Value
Residential Townhouse	2.7 P/unit
Average Daily Demand	280 L/d/per
Minimum Depth of Cover	2.4 m from top of watermain to finished grade
Desired operating pressure range during normal operating conditions	350 kPa and 480 kPa



During normal operating conditions pressure must not drop below	275 kPa
During normal operating conditions pressure shall not exceed	552 kPa
During fire flow operating conditions pressure must not drop below	140 kPa
*Table updated to reflect technical Bulletin ISDTB-2018-02	

The interior layout and architectural floor plans have been reviewed, and it was determined that the total proposed residential development will house twenty (20) stacked town units. Based on the City of Ottawa Design guidelines for population projection, this translates to approximately 54.0 residents. Table 2 below summarizes the proposed development as interpreted using table 4.1 of the City of Ottawa Design Guidelines.

Table 2: Development Residential Population Estimate

Proposed Unit type	Persons Per Unit	Number of Units	Population
Townhouse	2.7	20	54.0
Total Residential Population			54.0

The required water supply requirements for the residential units in proposed building have been calculated using the following formula:

Where:

$$Q = (q \times P \times M)$$

q = average water consumption (L/capita/day)

P = design population (capita)

M = Peak factor

Using a calculated Maximum Day Factor and Peak Hour factor of **7.5** and **11.2** respectively as per Table 3-3 in the *MOE Design Guidelines*, anticipated demands were calculated as follows:

- Average daily domestic water demand is **0.18** L/s,
- Maximum daily demand is **1.30** L/s, and
- Maximum hourly is **14.62** L/s.

Refer to **Appendix B** for water demand calculations.

The City of Ottawa was contacted to obtain boundary conditions associated with the estimated water demand, as indicated in the boundary request correspondence included in **Appendix B**. Table 3 below summarizes boundary conditions for the proposed development.



Table 3: Summary of Anticipated Demands and Boundary Conditions

Design Parameter	Anticipated Demand (L/min)	Boundary Conditions @ Renaud Road Head (m) / Pressure (psi)
Average Daily Demand	11	130.7 / 81.2
Max Day + Fire Flow (Block A)	78 + 16,000	115.5 / 59.5
Max Day + Fire Flow (Block B)	78 + 16,000	115.5 / 59.5
Peak Hour	877	126.7 / 75.5
<p><i>*Assumed Ground elevation at connection point = 73.60 m.</i></p> <p><i>Water demand calculation per City of Ottawa Water Design guidelines. See Appendix B for details.</i></p>		

As indicated in Table 3, Average Daily Demand pressure exceeded the required pressure range (greater than 80 psi) stated in Table 1 as per City of Ottawa Design Guidelines. Pipe Pressure Losses were calculated to factor in the loss in pressure expected. Considering a PVC pipe (roughness coefficient C of 150) of 150mm inner diameter, at a length of 121.5m and an elevation variable of 1.64m, we could calculate a pipe pressure loss of **2.33 psi** within the network, resulting in an adjusted max pressure of **78.90 psi**, now falling within the allowable range.

Refer to **Appendix B** for Boundary Conditions & Pipe Pressure Loss Calculations.

The estimated fire flow for the proposed buildings was calculated in accordance with *ISTB-2018-02*. The following parameters were provided by the Architect, see **Appendix A** for collaborating correspondence:

- Type of construction – Wood Frame Construction;
- Occupancy type – Limited Combustibility; and
- Sprinkler Protection – Non-Sprinklered.

The estimated fire flow demand was estimated to be **16,000 L/min** for Blocks A and **16,000 L/min** for Block B. See **Appendix B** for details.

There are several existing fire hydrants within 300 m to the proposed buildings that are available to meet the required fire flow demands stated above. Refer to **Appendix B** for fire hydrant locations.

Table 4 below summarizes the approximate aggregate fire flow of the contributing hydrants within 300 m to the proposed development based on Table 18.5.4.3 of *ISTB-2018-02*.



Table 4: Fire Protection Summary Table

Building	Fire Flow Demand (L/min)	Fire Hydrants(s) within 75m	Fire Hydrant(s) within 150m	Fire Hydrant(s) within 300m	Approximate Available Combined Fire Flow (L/min)
BLOCK A	16,000	2	6	-	(2 x 5678) + (6 x 3785) = 34,066
BLOCK B	16,000	2	6	-	(2 x 5678) + (6 x 3785) = 34,066

As shown in Table 4, the approximate total available fire flow from contributing hydrants is sufficient to provide adequate fire flow for the proposed buildings.

The proposed water supply design conforms to all relevant City Guidelines and Policies.

6 SANITARY SERVICE

6.1 Existing Sanitary Sewer Services

The subject property is tributary to the Forest valley trunk sewer. There is an existing 250 mm dia. sanitary sewer within Ziegler St. across from the subject site that ultimately conveys flows to the Forest Valley trunk sewer.

The subject property falls within the area contemplated in the *Gloucester East Urban Community Infrastructure Servicing Study Update (Gloucester EUC)*, prepared by Stantec, revision date March 2005. Refer to Drainage Plan extracted from the *Gloucester EUC* in **Appendix C**.

The post development total wet wastewater flow was calculated to be is **0.80 L/s** as a result of proposed residential population and a small portion of infiltration. Refer to **Appendix C** for further information on the calculated sanitary flows.

As per the **Urbantech Functional Servicing Report** dated December 2020, the 250mm diameter sanitary sewer within Ziegler Street has a full capacity of 38.0 L/s. Maximum design from the current developed subdivision is expected to be 19.97 L/s. Assuming peak design flow should not exceed 85%, the current reserve capacity of the Ziegler sewer is expected to be 12.3 L/s.

The proposed Caivan residential development, directly East of the 6001/6005 Renaud site, is expected to have a peak design flow of 10.5 L/s. This would leave an allowable reserve capacity of **1.8 L/s** for the proposed residential developments at 6001/6005 Renaud Road.

Refer to **Appendix C** for relevant references from the Functional Servicing Report

The current proposed residential developments (Block A, Block B) will require **0.80 L/s** of the sewer capacity. This would leave the sewer with a capacity of **1.00 L/s** for the future semi-detached houses (located along Ziegler Street, refer to site plan). Therefore, it is anticipated that



the existing local sanitary sewer network has sufficient capacity to accommodate the proposed development.

6.2 Sanitary Sewer Servicing Design

The proposed development will be serviced via a 150 mm dia. sanitary sewer network which will connect to the existing 250mm dia. sanitary sewer located within Ziegler Street. Refer to LRL drawing C.401 for the proposed sanitary servicing.

The parameters used to calculate the anticipated sanitary flows are; residential average population per unit of 2.7 persons for townhouse units, a residential daily demand of 280 L/p/day, a residential peaking factor of 4.0 and a total infiltration rate of 0.33 L/s/ha. Based on these parameters and the total site area of 0.29 ha, the total wet wastewater flow was calculated as **0.80 L/s**. Refer to **Appendix C** for the site sanitary sewer design sheet.

7 STORMWATER MANAGEMENT

7.1 Existing Stormwater Infrastructure

Stormwater runoff from the subject property is tributary to the City of Ottawa sewer system as such, approvals for the proposed development within this area are under the approval authority of the City of Ottawa.

In pre-development conditions, the stormwater runoff flows uncontrolled overland in two directions; towards the Renaud Road right-of-way and towards the Ziegler Street right-of-way. There is an existing 750 mm diameter storm sewer within Ziegler Street right-of-way. Refer to **Appendix D** for pre- and post-development watershed information.

7.2 Design Criteria

The stormwater management criteria for this development are based on the criteria stated in the **Gloucester EUC Study**, as well as pre-consultation with City of Ottawa officials, the City of Ottawa Sewer Design Guidelines including City of Ottawa Stormwater Management Design Guidelines, 2012 (City standards), as well as the Ministry of the Environment's Stormwater Planning and Design Manual, 2003 (SWMP Manual).

7.2.1 Water Quality

The subject property lies within the Ottawa River East sub-watershed and is therefore subject to review by the Rideau Valley Conservation Authority (RVCA).

As per the **Gloucester EUC Study**, the subject property falls within the tributary area of SWM Pond 3, refer to Figure 6 as well as the Drainage Plan extracted from the **Gloucester EUC Study** included in **Appendix D**. Therefore, it was determined that no further treatment is required for stormwater runoff from the proposed development. Correspondence with RVCA is included in **Appendix A**.



7.2.2 Water Quantity

As per the **Urbantech Functional Servicing Report** dated December 2020, the 750mm diameter storm sewer within Ziegler Street has a full capacity of 1113 L/s. The maximum design flow from the currently developed subdivision is expected to be 757 L/s (1113 L/s at $\pm 68\%$ capacity). Assuming pipe capacity should not exceed 90% full (± 1002 L/s), the current reserve capacity of the Ziegler storm sewer is expected to be ± 245 L/s for the proposed development and other future downstream developments.

Refer to **Appendix D** for the relevant references from the Functional Servicing Report.

Based on **Gloucester EUC Study**, the following stormwater management requirements were identified for the subject site:

- Meet an allowable release of 85 L/s/ha;
- Attenuate all storms up to and including the City of Ottawa 100-year storm event on site;

The allowable release rate for the subject site was calculated to be **24.82 L/s**, further assigned to each outlet direction to be **11.39 L/s** towards Ziegler and **13.43 L/s** towards Renaud. Refer to **Appendix D** for calculations.

7.3 Method of Analysis

The Modified Rational Method has been used to calculate the runoff rate from the site to quantify the detention storage required for quantity control of the development. Refer to **Appendix D** for storage calculations.

7.4 Proposed Stormwater Quantity Controls

For the purposes of this report, as pre-development and post-development runoff is split between Renaud Road and Ziegler Street ROW's, independent stormwater management analyses and designs will be performed for each watershed / group of watersheds contributing to the respective outlet point. This will ensure that independent post-development runoff out letting to both Renaud and Ziegler do not exceed their respective pre-development allowable release rates.

The proposed stormwater management quantity control for this development will be accomplished by allowing portions of site runoff to flow overland uncontrolled, and utilizing an inlet control device to restrict flows to the allowable release rate. Storage required as a result of quantity control will be accomplished through a combination of surface storage and underground stormwater chambers in the parking lot.

The subject site is proposed to be serviced via a network of 300mm diameter storm sewers that outlet to the existing 750 mm diameter storm sewer within Ziegler street. The proposed site storm sewer and stormwater management system are shown on drawing C.401 and detailed calculations, including the design sheet, can be found in **Appendix D**.



The existing site is delineated by catchments EWS-01 and EWS-02. The site grading is currently divided by a natural high point running from east to west, running roughly through the existing buildings.

EWS-01 begins from the natural high point and slopes predominantly northwest, conveying overland flow uncontrolled to the north property line and ultimately the Ziegler Street right-of-way. A pre-development allowable release rate of **11.39 L/s** was established for this watershed.

EWS-02 begins from the natural low points and slopes predominantly southeast, conveying overland flow uncontrolled to the south property line and ultimately the Renaud Road right-of-way. A pre-development allowable release rate of **13.43 L/s** was established for this watershed.

The site has been analyzed and post development watersheds have been allocated.

Watershed WS-01 (0.043 ha), consisting of grassed area, landscaping and sidewalk, will flow uncontrolled overland to the Renaud Road right-of-way.

Watershed WS-02 (0.015 ha), consisting of landscaping and a paved driveway, will flow uncontrolled overland to the Ziegler Street right-of-way.

Overland flow within watershed WS-03 (0.233 ha) will be captured by catch basins CBMH02, CBMH04, CBMH05 and CB06. A Hydrovex 50VHV-1 vertical flow regulator is proposed at MH01 to restrict collected runoff to a specific release rate. Grading proposed will provide positive overland drainage to the proposed storm water collection and control systems.

Table 5 below summarizes post-development drainage areas. Calculations can be seen in **Appendix D**.

Table 5: Drainage Areas

Drainage Area Name	Area	Weighted Runoff Coefficient	100 Year Weighted Runoff Coefficient (25% increase)
Outlet to Renaud Rd ROW			
WS-01 (uncontrolled)	0.043	0.45	0.56
Outlet to Ziegler St ROW			
WS-02 (uncontrolled)	0.015	0.65	0.81
WS-03 (controlled)	0.233	0.74	0.92

Table 6 below summarize the release rates and storage volumes required to meet the allowable release rates of **13.43 L/s** for Renaud and **11.39 L/s** for Ziegler for 100-year flow rates.



Table 6: Stormwater Release Rate & Storage Volume Summary (100 Year)

Catchment Area	Drainage Area (ha)	100-year Allow. Release Rate (L/s)	100-year Release Rate (L/s)	100-Year Required Storage (m ³)	Total Available Storage (m ³)
Outlet to Renaud Rd ROW					
WS-01 (uncontrolled)	0.058	13.43	12.06	0	0
Outlet to Ziegler St ROW					
WS-02 (uncontrolled)	0.015	11.39	6.09	0	0
WS-03 (controlled)	0.233		5.00	127.28	129.51

7.4.1 Renaud Road Outlet

It is estimated that **12.06 L/s** of runoff will flow uncontrolled from WS-01 towards the Renaud Road right-of-way. As this release rate falls below the calculated allowable release rate of **13.43 L/s** for the Renaud Road outlet, no further stormwater management design calculations are required.

7.4.2 Ziegler Street Outlet

It is estimated that **6.09 L/s** of runoff will flow uncontrolled from WS-02 towards the Ziegler Street right-of-way. Runoff collected in WS-03 will be attenuated on site and discharged at a specific release rate of **5.00 L/s** via a Hydrovex 50-VHV-1 flow control unit located at the invert of MH01, refer to **Appendix D** for additional info on the flow control unit. With implementation of flow control within the controlled watershed, it is ensured that post-development release rate to the Ziegler Street outlet will not exceed the calculated allowable release rate of **11.39 L/s**.

Considering a halved controlled release rate (to account for variable design head due to the combination of underground and overland storage), it can be calculated that a total **118.35 m³** of storage will be required to attenuate flows to the allowable release rate for the 100-year storm event. The project runoff exceeding the allowable release rate will be stored on-site via surface ponding at the parking lot as well as Stormtech underground chambers Model MC-3500 (or approved equivalent). Total proposed surface ponding provides approx. **16.98 m³** and the proposed underground chambers provide **112.51 m³** to provide a total storage of **129.51 m³** during the 100-year storm event. No surface ponding will occur in the 5-year and 2-year storm events, as all necessary storage requirements will be fully accommodated by the proposed stormwater underground chambers.

Refer to **Appendix D** for additional info on Stormtech chambers. The 100-year maximum ponding depths can be found on drawing "C601 – Stormwater Management Plan" of **Appendix E**.



8 EROSION AND SEDIMENT CONTROL

During construction, erosion and sediment controls will be provided primarily via a sediment control fence to be erected along the perimeter of the site where runoff has the potential of leaving the site. Inlet sediment control devices are also to be provided in any catch basin and/or manholes in and around the site that may be impacted by the site construction. Construction and maintenance requirements for erosion and sediment controls are to comply with Ontario Provincial Standard Specification OPSS 577. Refer to LRL Associates drawing C.101 for erosion and sediment control details.

9 CONCLUSION

This Stormwater Management and Servicing Report for the development proposed at 6001/6005 Renaud presents the rationale and details for the servicing requirements for the subject property.

In accordance with the report objectives, the servicing requirements for the development are summarized below:

Water Service

- The maximum required fire flow was calculated at **16,000 L/min** for Block A and **16,000 L/min** for Block B using the FUS method.
- There are at least seven (8) existing fire hydrants within 150m available to service the proposed developments. They will provide a combined fire flow of **34,066 L/min** to the site.
- The new development/expansion will be serviced with a new 150 mm Φ closed loop watermain network to be connected to the existing 200mm Φ watermain within Ziegler Street.
- Boundary conditions received from the City of Ottawa, considering pipe pressure losses, have indicate that sufficient pressure is available to service the proposed site.

Sanitary Service

- The anticipated sanitary flow from the proposed development is **0.80 L/s**.
- The proposed development will be serviced by a 150 mm diameter sanitary sewer network that connects to the existing 250 mm dia. sanitary sewer within Ziegler Street.



Stormwater Management

- The subject property is serviced by existing SWM Pond 3 as per the **Gloucester EUC Study**. Hence additional quality control measures are not proposed.
- The storm water release rates from the proposed development will meet the pre-allocated rate of **85 L/s/ha** stated in the **Gloucester EUC Study**. The target release rate for the site, based on the EUC, was calculated to be **13.43 L/s** for all runoff heading to Renaud, and **11.39 L/s** for all runoff heading to Ziegler.
- As the proposed release rate for all site runoff heading to the Renaud ROW, **12.06 L/s**, fell below the calculated allowable release rate, no further verification was required.
- As for the Ziegler outlet, uncontrolled runoff was calculated to be **6.09 L/s**, and stormwater quantity control measures were implemented within the controlled watershed to ensure allowable release to the Ziegler ROW was not exceeded. A Hydrovex 50-VHV-1 flow control unit is proposed to limit controlled runoff to **5.00 L/s**, and a combination of surface ponding and underground storage via Stormtech Chambers will provide **129.51 m³** of available storage volume to accommodate stormwater storage requirements.

10 REPORT CONDITIONS AND LIMITATIONS

The report conclusions are applicable only to this specific project described in the preceding pages. Any changes, modifications or additions will require a subsequent review by LRL Associates Ltd. to ensure the compatibility with the recommendations contained in this document. If you have any questions or comments, please contact the undersigned.

Prepared by:
LRL Associates Ltd.



Kyle Herold



Virginia Johnson, P.Eng



APPENDIX A
Pre-consultation / Correspondance



MEMO

Date: July 16, 2021

To /
Destinataire Steve Belan, Planner

From /
Expéditeur Natasha Baird, Senior Engineer, Infrastructure
Approvals


Subject /
Objet **Pre-Application Consultation
6001 and 6007 Renaud Road
Proposed Residential Development.**

File No. PC2020-0295

Please note the following information regarding the engineering design submission for the above noted site:

1. The Servicing Study Guidelines for Development Applications are available at the following address: <http://ottawa.ca/en/development-application-review-process-0/servicing-study-guidelines-development-applications>
2. Servicing and site works shall be in accordance with the following documents:
 - ⇒ Ottawa Sewer Design Guidelines (October 2012)
 - ⇒ Ottawa Design Guidelines – Water Distribution (2010)
 - ⇒ Geotechnical Investigation and Reporting Guidelines for Development Applications in the City of Ottawa (2007)
 - ⇒ City of Ottawa Slope Stability Guidelines for Development Applications (revised 2012)
 - ⇒ City of Ottawa Environmental Noise Control Guidelines (January, 2016)
 - ⇒ City of Ottawa Park and Pathway Development Manual (2012)
 - ⇒ City of Ottawa Accessibility Design Standards (2012)
 - ⇒ Ottawa Standard Tender Documents (latest version)
 - ⇒ Ontario Provincial Standards for Roads & Public Works (2013)

3. Record drawings and utility plans are also available for purchase from the City (Contact the City's Information Centre by email at InformationCentre@ottawa.ca or by phone at (613) 580-2424 x.44455).
4. EUC CDP and Background Studies: The parcels are situated on East Urban Community (EUC) Phase 1 lands, and there is the Phase 1 Community Design Plan (CDP) and associated background studies which accompany this document, such as the 2005 Gloucester EUC Infrastructure Study Update (Stantec) which sets out the infrastructure plan for the CDP area, and the 2004 Geotechnical Considerations: East Urban Community study (Golder), amongst others. Note that a CDP for the Phase 2 lands (bordering Mer Bleue Rd. to the east, Mer Bleue bog to the south, and Renaud Rd. to the North) was finalized in 2013 and the direction of this CDP supersedes the requirements set out in the Phase 1 CDP. These documents are to be consulted accordingly, and the proposed design is to be consistent with these documents.
5. The sanitary servicing criteria is subject to Forest Valley PS and capacity is required. Please refer to the EUC Master Servicing Study from Stantec (dated March 2005).

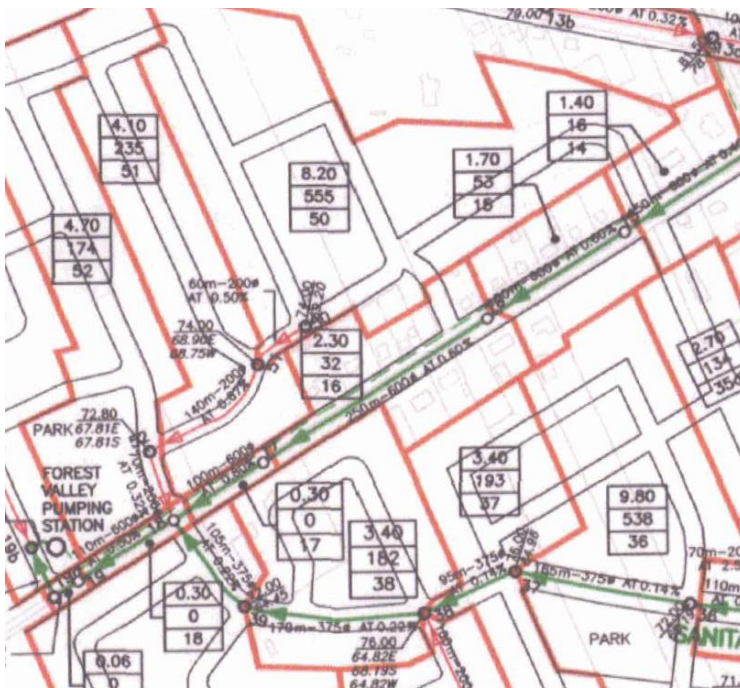

iv. *Provide information on the type of connection permitted*

Sewer connections to be made above the springline of the sewermain as per:

- a. Std Dwg S11.1 for flexible main sewers – *connections made using approved tee or wye fittings.*
- b. Std Dwg S11 (For rigid main sewers) – *lateral must be less than 50% the diameter of the sewermain,*
- c. Std Dwg S11.2 (for rigid main sewers using bell end insert method) – *for larger diameter laterals where manufactured inserts are not available; lateral must be less than 50% the diameter of the sewermain,*
- d. Connections to manholes permitted when the connection is to rigid main sewers where the lateral exceeds 50% the diameter of the sewermain. – Connect obvert to obvert with the outlet pipe unless pipes are a similar size.
- e. *No submerged outlet connections.*

9. Water Boundary condition requests must include the location of the service and the expected loads required by the proposed development. Please provide the following information:

- i. Location of service
- ii. Type of development and the amount of fire flow required (as per FUS, 1999).
- iii. Average daily demand: ___ l/s.
- iv. Maximum daily demand: ___ l/s.
- v. Maximum hourly daily demand: ___ l/s.

10. MECP ECA Requirements:

An MECP Environmental Compliance Approval (Municipal Sewage Works) will **only be required if multiple parcels** are proposed for this development. This

application will be under the ToR Program. For your information, I have included the email to the Ottawa District office, but you are not required to contact them.

For residential applications: moeccottawaseage@ontario.ca

11. Phase 1 ESAs and Phase 2 ESAs must conform to clause 4.8.4 of the Official Plan that requires that development applications conform to Ontario Regulation 153/04.
12. Provide comments from the conservation authority. It is recommended to consult the office prior to submitting an application. The major overland flow route is susceptible to discharge to the Mud Creek Watershed which is part of the Rideau Valley Conservation Authority. Please contact Jamie Batchelor at the RVCA: <https://www.rvca.ca/contact-us>. Please refer to the Mud Creek Cumulative Impact Study.
13. Development Charges (DC): The site is subject to an Area Specific DC as it falls within Area E-3 of the Gloucester East Urban Centre Stormwater Facilities By-Law 2019-165. Further information regarding DC calculations, exemptions, indexing of rates can be obtained through Gary Baker, DC Program Coordinator (gary.baker@ottawa.ca).
14. Gloucester EUC Cost Sharing Agreement dated February 2008 between participating Owners: Rivard/Monarch, Richcraft, Minto, DCR Phoenix, Claridge, and Ashcroft: The site is subject to an existing EUC Ownership Cost Sharing Agreement which is administered by a Trustee on behalf of the ownership group. It is recommended that the Applicant contact the Trustee to discuss the terms of the agreement as a Non-Participating Owner (an owner of a land shown on the plans attached in Schedule D of the Agreement, and who is not party to this Agreement). The Trustee is Kris Kilborn at Stantec Consulting Ltd. (kris.kilborn@stantec.com).
15. Geotechnical Considerations: East Urban Community study was completed in 2004 by Golder. The study covers the EUC lands and provided findings with respect to the type of development proposed and landform (topography, and the fact that the area predominantly consists of surficial sand and silty sand over sensitive marine clay soils). These can bring some constraints along with them, specifically:
 - a. grade raise restrictions
 - b. slope stability (around the drainage features and the escarpment)
 - c. relatively high groundwater levels.

Geotechnical MSS related to Zone 2A and 3 as per the MSS:



Zone 2

Zone 2 encompasses the area south and west of Navan Road with the exception of Zone 3 and includes the Escarpment lands. The subsurface condition typically consists of discontinuous deposits of surficial sand and silty sand typically 1.5 to 2.0m in depth overlying sensitive weathered silty clay of 2.0 to 3.0m. Surficial sand and silty sand deposits exceed 3.0m in some areas and are absent in others. The soil conditions in Zone 2 are similar to Zone 1 with varying strengths and a thinner weathered crust. The un-drained shear strength of the un-weathered silty clay is in the order of 20 to 25 kPa suggesting it is compressible. Groundwater levels are shallow, ranging in depth from the ground surface to within 1.0 to 1.5m of the ground surface.

The subsurface conditions within the escarpment are similar, with a thicker crust and deeper groundwater levels reflecting better drainage.

Due to the variability in data, making it difficult to establish grade restrictions for all of Zone 2, it was divided into two parts, Zone 2A and Zone 2B. Within Zone 2A, which includes almost all of Zone 2, a maximum grade raise restriction of 0.5m is acceptable, with no grade raise preferred. Conversely, a maximum grade raise of 2.0m is acceptable in Zone 2B.

Zone 2A is not well suited for development of higher-density structures using conventional spread footings. Even with the grade raise, conventional houses may not be feasible through all of Zone 2A, requiring wider footings or shallower foundations consistent with "high ranch" style homes.

Higher density developments on conventional spread footings are possible in Zone 2B provided grade raises are minimized to allow sufficient remaining capacity to support additional structure loads.

Zone 3

Zone 3 covers a portion of the low-lying areas south of Fourth Line Road and consists of glacial till overlain by a thick deposit of weathered silty clay. There is no practical limit to the grade raise permitted in Zone 3 but, for planning purposes, a reasonable limit of 3m was proposed. The area is well suited for mid-rise and possibly high-rise buildings on conventional spread footings.

Table 1
Feasible Building Structures Supported on Spread Footings
within Zones 1, 2, 3 and MUC

Building Structures	Geographical Zones			
	1	2	3	MUC
Up to 2 storey timber frame w or w/o basements and at-grade garage (i.e. conventional suburban housing and/or "high ranch" style homes)		✓ (2A) ¹		
Up to 2 storey timber frame w basements and at-grade garage (i.e. conventional suburban housing)				✓
Up to 3 storey timber frame w or w/o basements (i.e. stacked townhouses)	✓ ²			
Up to 3 storey (possibly 4 storey) timber frame w/o basements (i.e. townhouses or apartment buildings)				✓
Up to 3 storey timber frame w basements, w/o at grade garages or w garage in basement (i.e. stacked townhouses with depressed driveways)				✓
Up to 3 storey (possibly 4 storey) timber frame w concrete framed ground floor and basement level parking garages				✓
Higher density type developments		✓ (2B)	✓	

Note:

¹ Lack of good quality geotechnical information within the area and consequently guideline may be too conservative. Type of housing (conventional suburban versus "high ranch" style homes) depends on the servicing feasibility given the 0-0.5m grade raise restriction.

² Up to 3 storey timber framed w or w/o basements (i.e. stacked townhouses) may only be semi-feasible if supported on spread footings.

Given the grade raise and the building restrictions, please contact a geotechnical engineer to determine what possible development can occur based on the discussion in the MSS report. Further geotechnical investigation will be required to clarify the possible types of development.

Should you have any questions or require additional information, please contact me directly at (613) 580-2424, ext. 27995 or by email at Natasha.baird@ottawa.ca.

APPENDIX B
Water Supply Calculations





Water Supply Calculations

LRL File No. 210216-02
 Date June 9, 2023
 Prepared by K. Herold
 Project Location 6001/6005 Renaud

Residential Demand based on the City of Ottawa Design Guidelines-Water Distribution, 2010

Unit Type	Persons Per Unit	Number of Units	Population
Townhouse	2.7	20	54.0
Total		20	54.0

Average Water Consumption Rate	280 L/c/d	
Average Day Demand	15,120 L/d	0.18 L/s
Maximum Day Factor	7.5	(MOE Table 3-3)
Maximum Daily Demand	112,697 L/d	1.30 L/s
Peak Hour Factor	11.2	(MOE Table 3-3)
Maximum Hour Demand	1,263,509 L/d	14.62 L/s

Water Service Pipe Sizing

$$Q = VA$$

Where: V = velocity

A = area of pipe

Q = flow rate

Assuming a maximum velocity of 1.8m/s, the diameter of pipe is calculated as:

$$\begin{aligned} \text{Minimum pipe diameter (d)} &= (4Q/\pi V)^{1/2} \\ &= 0.102 \text{ m} \\ &= 102 \text{ mm} \end{aligned}$$

$$\begin{aligned} \text{Proposed pipe diameter (d)} &= 150 \text{ mm} \\ &= 6 \text{ Inches} \end{aligned}$$



LRJ

Fire Flow Calculations
6001 / 6005 Renaud - Block A

LRL File No. 210216-02
 Date June 9, 2023
 Method Fire Underwriters Survey (FUS)
 Prepared by K. Herold

Step	Task	Term	Options	Multiplier	Choose:	Value	Unit	Fire Flow
Structural Framing Material								
1	Choose frame used for building	Coefficient C related to the type of construction	Wood Frame	1.5	Wood Frame	1.5		
			Ordinary Construction	1.0				
			Non-combustible construction	0.8				
			Fire resistive construction <2 hrs	0.7				
			Fire resistive construction >2 hrs	0.6				
Floor Space Area (A)								
2	Total area (building area of 360m ² , 4 stories)					1,440	m ²	
3	Obtain fire flow before reductions	Required fire flow	Fire Flow = 220 x C x A ^{0.5}				L/min	12,523
Reductions or surcharge due to factors affecting burning								
4	Choose combustibility of contents	Occupancy hazard reduction or surcharge	Non-combustible	-25%	Limited combustible	-15%	L/min	10,644
			Limited combustible	-15%				
			Combustible	0%				
			Free burning	15%				
			Rapid burning	25%				
5	Choose reduction for sprinklers	Sprinkler reduction	Full automatic sprinklers	-30%	False	0%	L/min	10,644
			Water supply is standard for both the system and fire department hose lines	-10%	False	0%		
			Fully supervised system	-10%	False	0%		
6	Choose separation	Exposure distance between units	North side	20.1 to 30m	10%	L/min	15,966	
			East side	3.1 to 10m	20%			
			South side	>45m	0%			
			West side	3.1 to 10m	20%			50%
Net required fire flow								
7	Obtain fire flow, duration, and volume	Minimum required fire flow rate (rounded to nearest 1000)					L/min	16,000
		Minimum required fire flow rate					L/s	266.7
		Required duration of fire flow					hr	4.25



LRJ

**Fire Flow Calculations
6001 / 6005 Renaud - Block B**

LRL File No. 210216-02
 Date June 9, 2023
 Method Fire Underwriters Survey (FUS)
 Prepared by K. Herold

Step	Task	Term	Options	Multiplier	Choose:	Value	Unit	Fire Flow
Structural Framing Material								
1	Choose frame used for building	Coefficient C related to the type of construction	Wood Frame	1.5	Wood Frame	1.5		
			Ordinary Construction	1.0				
			Non-combustible construction	0.8				
			Fire resistive construction <2 hrs	0.7				
			Fire resistive construction >2 hrs	0.6				
Floor Space Area (A)								
2			Total area (building area of 360m ² , 4 stories)			1,440	m ²	
3	Obtain fire flow before reductions	Required fire flow	Fire Flow = 220 x C x A ^{0.5}				L/min	12,523
Reductions or surcharge due to factors affecting burning								
4	Choose combustibility of contents	Occupancy hazard reduction or surcharge	Non-combustible	-25%	Limited combustible	-15%	L/min	10,644
			Limited combustible	-15%				
			Combustible	0%				
			Free burning	15%				
			Rapid burning	25%				
5	Choose reduction for sprinklers	Sprinkler reduction	Full automatic sprinklers	-30%	False	0%	L/min	10,644
			Water supply is standard for both the system and fire department hose lines	-10%	False	0%		
			Fully supervised system	-10%	False	0%		
6	Choose separation	Exposure distance between units	North side	20.1 to 30m	10%	L/min	15,966	
			East side	3.1 to 10m	20%			
			South side	>45m	0%			
			West side	3.1 to 10m	20%			50%
Net required fire flow								
7	Obtain fire flow, duration, and volume					Minimum required fire flow rate (rounded to nearest 1000)	L/min	16,000
						Minimum required fire flow rate	L/s	266.7
						Required duration of fire flow	hr	4.25



Pipe Pressure Losses Calculations

LRL File No. 210216-02

Project Navan Stacked Townhomes

Location: 6001/6005 Renaud Road

Date June 9, 2023

Designed: K. Herold

Piezometric Head Equation (Derived from Bernoulli's Equation)

$$h = \frac{p}{\gamma} + z$$

Where:

h = HGL (m)

p = Pressure (Pa)

γ = Specific weight (N/m³) =

9810

z = Elevation of centreline of pipe (m) =

73.6

Water Pressure on Huron Street			
HGL (m)		Pressure	
		kPa	psi
Minimum =	126.7	520.91	75.55
Maximum =	130.7	560.15	81.24
Max. Day + Fire =	115.5	411.04	59.62

Hazen Williams Equation

$$h_f = \frac{10.67 \times Q^{1.85} \times L}{C^{1.85} \times d^{4.87}}$$

Where:

h_f = Head loss over the length of pipe (m)

Q = Volumetric flow rate (m³/s)

L = Length of pipe (m)

C = Pipe roughness coefficient

d = Pipe diameter (m)

Scenario 1: maximum daily demand

Q (L/s)	1.30
C	150
L (m.)	121.5

I.D. (mm)	150	
V (m/s)	0.07	
h_f (m)	0.01	
Head Loss (psi)	0.01	
Min. Pressure (psi)	75.54	
Max. Pressure (psi)	81.23	
Service Obs. @ Street Connection (m)	70.86	
Service Obs. @ Building Connection (m)	72.50	
Pressure Adjustment (psi)	-2.33	(due to service elevation difference from street to building)
Adjusted Min. Pressure (psi)	73.21	(must not be less than 50psi)
Adjusted Max. Pressure (psi)	78.90	(must not be more than 80psi)

Scenario 2: maximum hourly demand

Q (L/s)	14.62	
C	150	
L (m.)	121.5	
I.D. (mm)	150	
V (m/s)	0.83	
h_f (m)	0.51	
Head Loss (psi)	0.72	
Min. Pressure (psi)	74.83	
Max. Pressure (psi)	80.52	
Service Obs. @ Street Connection (m)	70.86	
Service Obs. @ Building Connection (m)	72.50	
Pressure Adjustment (psi)	-2.33	(due to service elevation difference from street to building)
Adjusted Min. Pressure (psi)	72.50	(must not be less than 40psi)
Adjusted Max. Pressure (psi)	78.19	(must not be more than 80psi)

City of Ottawa Boundary Conditions (Multi-Hydrant Analysis)


	Quantity	Max Capacity (L/min)*	Available Fire Flow** (L/min)
Fire Hydrant(s) Within 76m	2	5678	11356
Fire Hydrant(s) Within 76m to 152m	6	3785	22710
Fire Hydrant(s) Within 152m to 305m		2839	0
Available Combined Fire Flow (L/min)			34066
Max Day + Fire Flow Demand (L/min)			16000

*as per Table 18.5.4.3. of ISTB-2018-02

**assumed class AA hydrants

***flow provided from all hydrants within 76m is more than adequate to accommodate fire flow requirements, balance of hydrants within 152m and 305m not considered in design

City of Ottawa - Water Distribution System Facilities & Feeder mains

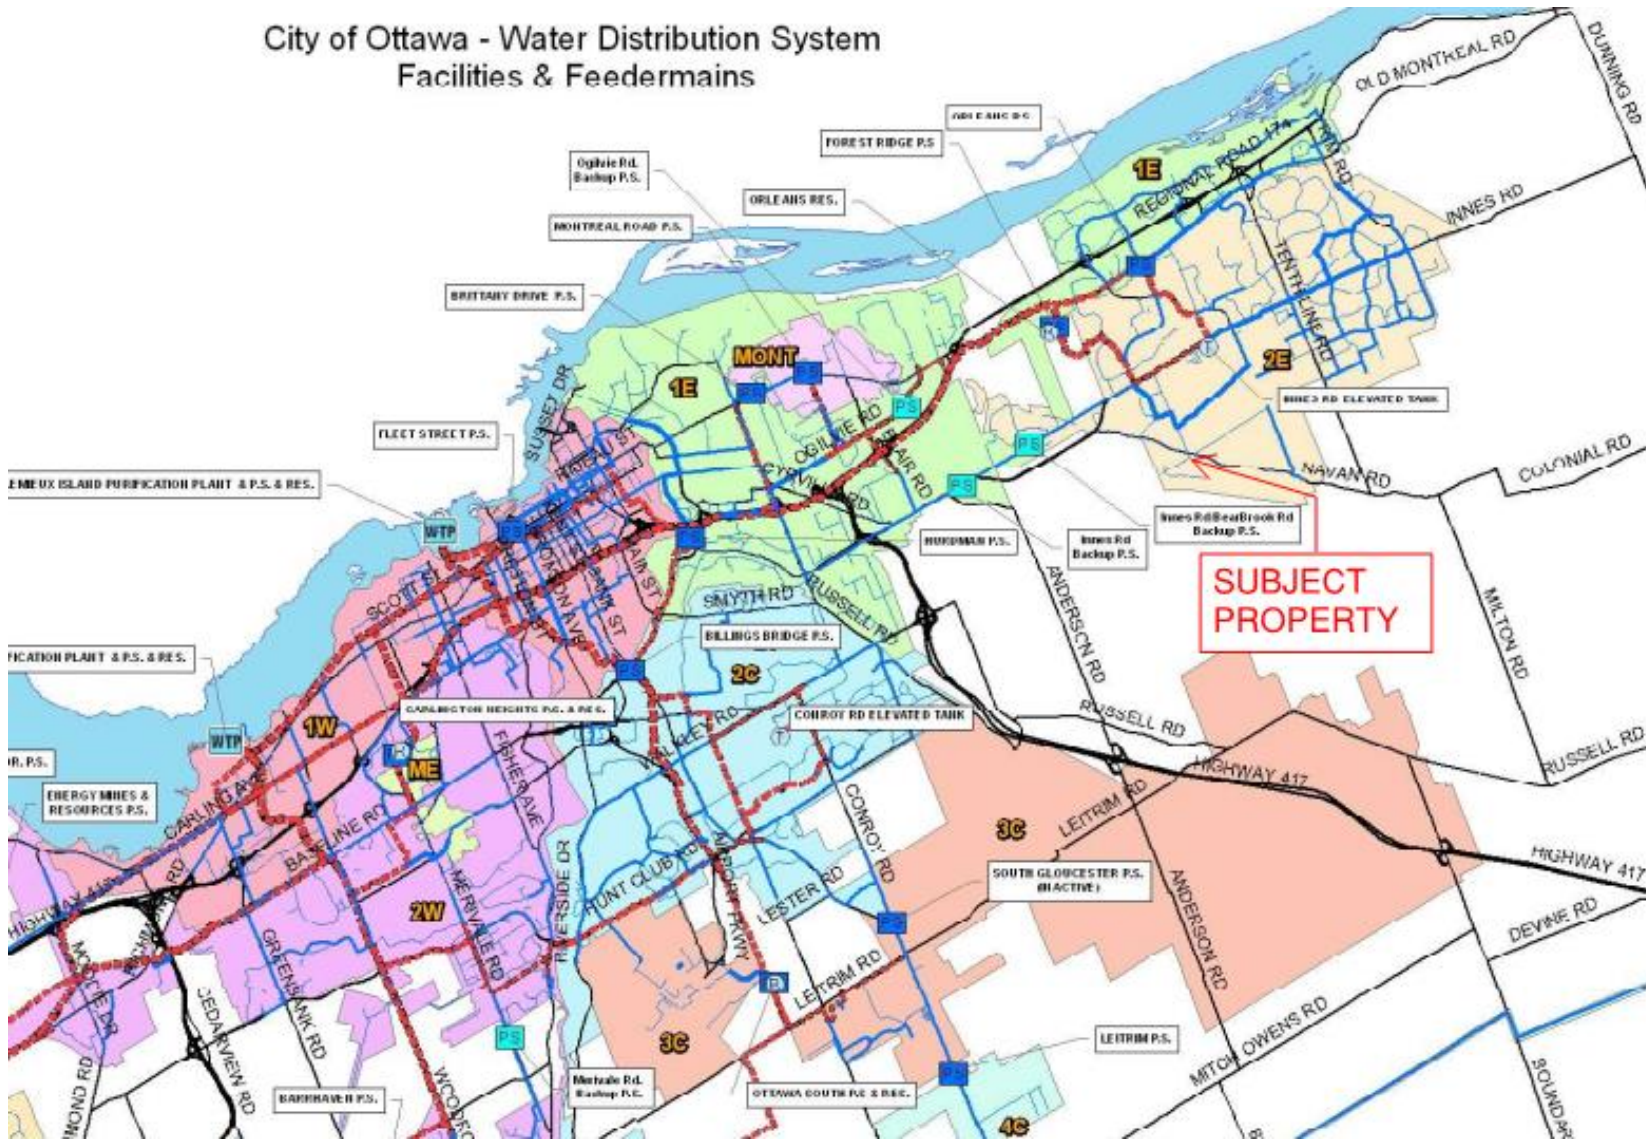

Legend

Water System Structure

- Pump Station
- Backup Pump Station
- Water Treatment Plant
- Well
- Elevated Tank
- Reservoir

WATERMAINS

- Priority, Internal Diameter
- Backbone 1524mm - 1067mm
 - Backbone 1067mm - 1372mm
 - Backbone 610mm - 914mm
 - Backbone 406mm - 305mm
 - Backbone 152mm - 305mm
 - Distribution 1679mm - 1561mm
 - Distribution 1067mm - 1372mm
 - Distribution 610mm - 914mm
 - Distribution 406mm - 305mm
 - Distribution 305mm - 301mm

PRESSURE ZONES

- 1E
- 1W
- 2C
- 2E
- 2W
- 3C
- 3W
- 4C
- 4W
- 5C
- 5W
- 6C
- 6W
- 7C
- 7W
- 8C
- 8W
- 9C
- 9W
- 10C
- 10W
- SHAD

- a. If possible, systems to be designed to residual pressures of 345 to 552 kPa (50 to 80 psi) in all occupied areas outside of the public right-of-way without special pressure control equipment.
- b. Pressure reducing valves to be installed immediately downstream of the isolation valve in the home/ building, located downstream of the meter so it is owner maintained.

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

**FIRE HYDRANT
LOCATIONS
FIGURE**

LEGEND

SUBJECT SITE

HYDRANTS WITHIN 75 M ●

HYDRANTS WITHIN 150 M ●



Table 18.5.4.3 Maximum Fire Hydrant Fire Flow Capacity

Distance to Building ^a		Maximum Capacity ^b	
(ft)	(m)	(gpm)	(L/min)
≤ 250	≤ 76	1500	5678
> 250 and ≤ 500	> 76 and ≤ 152	1000	3785
> 500 and ≤ 1000	> 152 and ≤ 305	750	2839

^aMeasured in accordance with 18.5.1.4 and 18.5.1.5.
^bMinimum 20 psi (139.9 kPa) residual pressure.

APPENDIX C
Wastewater Collection Calculations
Supporting Documents





LRL File No. 210216-05
Project: Residential Development (20 Stacked TH)
Location: 6001/6005 Renaud Rd
Date: July 24 2024

Sanitary Design Parameters

Average Daily Flow = 280 L/p/day
 Commercial & Institutional Flow = 50000 L/ha/day
 Light Industrial Flow = 35000 L/ha/day
 Heavy Industrial Flow = 55000 L/ha/day
 Maximum Residential Peak Factor = 4.0
 Commercial & Institutional Peak Factor = 1.5

Industrial Peak Factor = as per Appendix 4-B = 7
 Extraneous Flow = 0.33L/s/gross ha

Pipe Design Parameters

Minimum Velocity = 0.60 m/s
 Manning's n = 0.013

LOCATION			RESIDENTIAL AREA AND POPULATION						COMMERCIAL		INDUSTRIAL			INSTITUTIONAL		G+I+I	INFILTRATION			TOTAL FLOW	PIPE					
STREET	FROM MH	TO MH	AREA (Ha)	POP.	CUMMULATIVE AREA (Ha)	POP.	PEAK FACT.	PEAK FLOW (l/s)	AREA (Ha)	ACCU. AREA (Ha)	AREA (Ha)	ACCU. AREA (Ha)	PEAK FACT.	AREA (Ha)	ACCU. AREA (Ha)	PEAK FLOW (l/s)	TOTAL AREA (Ha)	ACCU. AREA (Ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	LENGT H (m)	DIA. (mm)	SLOPE (%)	MATERIAL	CAP. (FULL) (l/s)	VEL. (FULL) (m/s)
	SITE MH3	MH2	0.291	54.0	0.29	54.0	4.0	0.70	0.000	0.000	0.00	0.00	7.0	0.0	0.0	0.00	0.291	0.291	0.10	0.80	69.6	150	1.50%	PVC	18.65	1.06
	SITE MH2	MH1						0.70									0.291	0.291	0.10	0.80	24.6	150	1.50%	PVC	18.65	1.06
	SITE MH1	SAN SWR						0.70									0.291	0.291	0.10	0.80	23.7	150	2.00%	PVC	21.54	1.22

NOTES Existing inverts and slopes are estimated. They are to be confirmed on-site.

Designed: K.H.	PROJECT: Navan Stacked Townhomes		
Checked: V.J.	LOCATION: 6001/6005 Renaud Rd		
Dwg. Reference: C401	File Ref.: 210216-05	Date:	Sheet No. 1 of 1

APPENDIX D
Stormwater Management Calculations
Supporting Documents
Hydrovex ICD
Stormtech Chaber Details



LRL Associates Ltd.
Storm Watershed Summary



LRL File No. 210216-04
Project: Stacked Townhouses
Location: 6001/6005 RENAUD
Date: July 24th, 2024
Designed: K. Herold
Drawing Reference: C701/C702

Pre-Development Catchments

WATERSHED	C = 0.20	C = 0.80	C = 0.90	Total Area (m ²)	Total Area (ha)	Combined C
EWS-01	1096.3	0.0	240.6	1336.9	0.134	0.33
EWS-02	1176.7	0.0	400.8	1577.5	0.158	0.38
TOTAL	2273.0	0.0	641.4	2914.4	0.291	0.35

Post-Development Catchments

WATERSHED	C = 0.20	C = 0.80	C = 0.90	Total Area (m ²)	Total Area (ha)	Combined C
WS-01 (UNCONTROLLED)	275.6	0.0	154.8	430.4	0.043	0.45
WS-02 (UNCONTROLLED)	54.5	0.0	96.9	151.4	0.015	0.65
WS-03 (CONTROLLED)	549.0	0.0	1783.6	2332.6	0.233	0.74
TOTAL	879.1	0.0	2035.3	2914.4	0.291	0.66


LRL File No. 210216-04
Project: Shaded Townhouse
Location: 6001 6005 PENALD
Date: July 24th, 2024
Designed: K. Noid
Drawn By: C601, C601

**Stormwater Management
60-Year Design Storm**

Runoff Equation

$Q = 2.78CIA (L/s)$
 $C =$ Runoff coefficient
 $I =$ Rainfall intensity (mm/h)
 $A =$ Area (ha)
 $t_c =$ Time of concentration (min)
 $C = A / (T_c + C)^2$

Pre-development Stormwater Management

EWS-01 Total Area =	0.134	ha
EWS-02 Total Area =	0.108	ha
Total Area =	0.291	ha

EWS-01 Allowable Release Rate =	11.39	L/s	(runoff to Ziegler ROW)
EWS-02 Allowable Release Rate =	13.43	L/s	(runoff to Renaud ROW)
Total Allowable Release Rate =	24.82	L/s	(The pre-allocated release rate of EWS/Aha as per EUC Master Servicing Study (Stanlex, 2005))

Post-development Stormwater Management (EWS-01 - Runoff to Ziegler)

	Total Site Area =	0.248	ha	1R _u	1R _u
Controlled	WS-01	0.233	ha	1R _u	0.73
	Total Controlled =	0.233	ha	1R _u	0.73
Un-controlled	WS-02	0.015	ha	1R _u	0.81
	Total Un-Controlled =	0.015	ha	1R _u	0.81

Post-development Stormwater Management (EWS-02 - Runoff to Renaud)

	Total Site Area =	0.066	ha	1R _u	1R _u
Controlled	Total Controlled =	0.066	ha	1R _u	0.58
Un-controlled	WS-01	0.043	ha	1R _u	0.45
	Total Un-Controlled =	0.043	ha	1R _u	0.58

Post-development Stormwater Management (WS-01 - Runoff to Renaud)

100 Year Storm Event:
 $I_{100} = 1735.688 / (T_c + 6.014)^{0.88}$ $a = 1735.688$ $b = 0.820$ $C = 6.014$

Time (min)	Intensity (mm/h)	Uncontrolled Runoff (L/s)	Controlled Release Rate (L/s)	Total Release Rate (L/s)
10	178.6	0.00	0.00	0.00
15	147.8	0.00	0.00	0.00

*As total release rate at max intensity for post-development overlain runoff to Renaud (12.06 L/s) falls below the pre-development allowable release rate to Renaud (13.43 L/s), no further SWM design consideration is required for Renaud

Post-development Stormwater Management (WS-02, WS-03 - Runoff to Ziegler)

100 Year Storm Event:
 $I_{100} = 1735.688 / (T_c + 6.014)^{0.88}$ $a = 1735.688$ $b = 0.820$ $C = 6.014$

Time (min)	Intensity (mm/h)	Controlled Runoff (L/s)	Storage Required		Uncontrolled Runoff (L/s)	Total Release Rate (L/s)
			Storage Volume (m ³)	Controlled Release Rate Constant (L/s)		
10	178.6	106.42	60.85	5.00	6.09	11.09
15	147.8	85.16	74.15	5.00	4.87	9.07
20	120.0	71.49	79.79	5.00	4.09	9.09
25	101.8	61.89	82.94	5.00	3.14	6.54
30	91.9	54.75	88.55	5.00	3.13	6.13
35	81.9	47.78	95.68	5.00	2.56	5.56
40	74.0	42.12	99.35	5.00	2.18	7.18
45	67.3	38.15	101.99	5.00	1.81	6.81
50	61.1	34.50	105.81	5.00	1.40	6.40
55	55.5	31.25	109.64	5.00	1.24	5.24
100	35.9	19.60	105.15	5.00	1.12	6.12
140	29.2	17.37	103.84	5.00	0.99	5.99
180	26.2	16.64	102.13	5.00	0.89	5.89
190	25.9	16.25	99.85	5.00	0.81	5.81
200	22.0	13.10	97.21	5.00	0.75	5.75

*falls below allow. rel. rate #11.9 L/s

Post-development Stormwater Management (WS-02, WS-03 - Runoff to Ziegler)

Stormwater Storage Calculations (1/2 release rate for u/g storage & variable design head)

100 Year Storm Event:
 $I_{100} = 1735.688 / (T_c + 6.014)^{0.88}$ $a = 1735.688$ $b = 0.820$ $C = 6.014$

Time (min)	Intensity (mm/h)	Controlled Runoff (L/s)	Storage Required		Uncontrolled Runoff (L/s)	Total Release Rate (L/s)
			Storage Volume (m ³)	Controlled Release Rate Constant (L/s)		
10	178.6	106.42	82.25	2.00	0.00	2.00
15	147.8	85.16	74.40	2.00	0.00	2.00
20	120.0	71.49	82.79	2.00	0.00	2.00
25	101.8	61.89	86.05	2.00	0.00	2.00
30	91.9	54.75	91.48	2.00	0.00	2.00
35	81.9	47.78	100.85	2.00	0.00	2.00
40	74.0	42.12	101.98	2.00	0.00	2.00
45	67.3	38.15	110.88	2.00	0.00	2.00
50	61.1	34.50	118.81	2.00	0.00	2.00
55	55.5	31.25	124.99	2.00	0.00	2.00
100	35.9	19.60	123.15	2.00	0.00	2.00
140	29.2	17.37	124.94	2.00	0.00	2.00
180	26.2	16.64	126.13	2.00	0.00	2.00
190	25.9	16.25	125.85	2.00	0.00	2.00
200	22.0	13.10	127.21	2.00	0.00	2.00
220	20.4	12.14	127.58	2.00	0.00	2.00
240	19.0	11.25	127.11	2.00	0.00	2.00

Total Storage Required = 127.28 m³
 Available Storage = 120.81 m³ refer to LRL Plan C601

Summary of Release Rates and Storage Volumes

Catchment Area	Drainage Area (ha)	100-year Allow. Release Rate (L/s)	Prop. 100-year Release Rate (L/s)	100-Year Required Storage (m ³)	Total Available Storage (m ³)
Renaud/Renaud RD	0.043	13.43	12.05	0	0
WS-01	0.043	13.43	12.05	0	0
WS-02	0.043	13.43	12.05	127.28	129.51
WS-03	0.233	13.43	12.05	127.28	129.51
TOTAL	0.291	24.82	23.15	127.28	129.51

Post-development Stormwater Management (WS-03)

Stormwater Storage Calculations (1/2 release rate for u/g storage & variable design head)

2 Year Storm Event:
 $I_{2} = 732.951 / (T_c + 6.199)^{0.77}$ $a = 732.951$ $b = 0.81$ $C = 6.199$

Time (min)	Intensity (mm/h)	Controlled Runoff (L/s)	Storage Required		Uncontrolled Runoff (L/s)	Total Release Rate (L/s)
			Storage Volume (m ³)	Controlled Release Rate Constant (L/s)		
10	76.8	45.77	25.56	2.00	0.00	2.00
15	61.8	36.81	30.88	2.00	0.00	2.00
20	52.0	31.01	34.21	2.00	0.00	2.00
25	45.2	26.52	36.03	2.00	0.00	2.00
30	40.0	23.86	36.46	2.00	0.00	2.00
40	32.9	19.59	41.01	2.00	0.00	2.00
50	28.0	16.71	42.64	2.00	0.00	2.00
60	24.6	14.64	43.69	2.00	0.00	2.00
75	20.8	12.49	44.57	2.00	0.00	2.00
95	18.1	10.81	44.89	2.00	0.00	2.00
100	17.6	10.55	44.89	2.00	0.00	2.00
140	12.9	7.70	43.71	2.00	0.00	2.00
180	11.7	6.96	42.66	2.00	0.00	2.00
190	11.6	6.93	41.40	2.00	0.00	2.00
200	9.6	5.81	39.07	2.00	0.00	2.00

Total Storage Required = 44.89 m³
 Underground Available Storage = 112.53 m³ refer to LRL Plan C601
 *underground chambers have more than sufficient volume to accommodate all storage requirements for the 2-year storm event, no overland ponding to occur in the 2-year storm event

LRL Associates Ltd.
Storm Design Sheet



LRL File No. 210216-04
Project: 36 Stacked Towns
Location: 6001/6005 RENAUD
Date: July 24th, 2024
Designed: K. Herold
Drawing Reference: C401

Storm Design Parameters

Rational Method $Q = 2.78CIA$

Q = Peak flow in litres per second (L/s)
A = Drainage area in hectares (ha)
C = Runoff coefficient
I = Rainfall intensity (mm/hr)


Runoff Coefficient (C)
Grass 0.20
Gravel 0.80
Asphalt / rooftop 0.90

Ottawa Macdonald-Cartier International Airport IDF curve
equation (5 year event, intensity in mm/hr)
 $I = 998.071 / (T_c + 6.053)^{0.814}$
Min. velocity = 0.80 m/s
Manning's "n" = 0.013

LOCATION			AREA (ha)			FLOW						STORM SEWER							
WATERSHED / STREET	From MH	To MH	C = 0.20	C = 0.80	C = 0.90	Indiv. 2.78AC	Accum. 2.78AC	Time of Conc. (min.)	Rainfall Intensity (mm/hr)	Peak Flow Q (L/s)	Controlled Flow Q (L/s)	Pipe Diameter (mm)	Type	Slope (%)	Length (m)	Capacity Full (L/s)	Velocity Full (m/s)	Time of Flow (min.)	Ratio (Q/Q _{FULL})
WS-03	CB06	CBMH05	0.011	0.000	0.003	0.014	0.01	10.00	104.2	1.42		300	PVC	0.50%	16.5	68.4	0.97	0.28	0.02
	CBMH05	CBMH04	0.017	0.000	0.081	0.212	0.23	10.28	102.7	23.19		300	PVC	0.50%	35.5	68.4	0.97	0.61	0.34
	CBMH04	MH03	0.015	0.000	0.079	0.206	0.43	10.90	99.7	43.04		300	PVC	0.50%	17.8	68.4	0.97	0.31	0.63
	MH03	CBMH02	0.012	0.000	0.016	0.047	0.48	11.20	98.2	47.00		300	PVC	0.50%	9.2	68.4	0.97	0.16	0.69
	CBMH02	MH01	0.000	0.000	0.000	0.000	0.48	11.36	97.5	46.65		300	PVC	0.50%	13.3	68.4	0.97	0.23	0.68
	MH01	SEWER	0.000	0.000	0.000	0.000	0.48	11.59	96.5	46.16	5.00	300	PVC	5.50%	21.5	226.8	3.21	0.11	0.20



HYDROVEX[®] VHV / SVHV
Vertical Vortex Flow Regulator

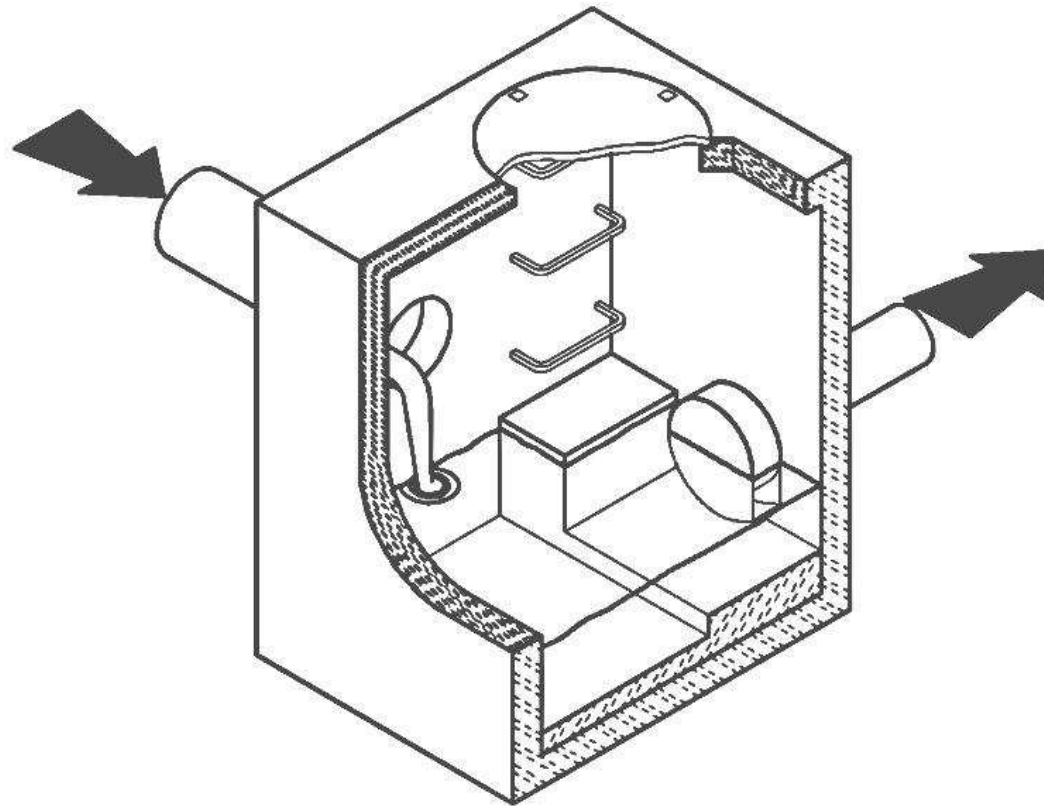

JOHN MEUNIER

HYDROVEX® VHV / SVHV VERTICAL VORTEX FLOW REGULATOR

APPLICATIONS

One of the major problems of urban wet weather flow management is the runoff generated after a heavy rainfall. During a storm, uncontrolled flows may overload the drainage system and cause flooding. Due to increased velocities, sewer pipe wear is increased dramatically and results in network deterioration. In a combined sewer system, the wastewater treatment plant may also experience significant increases in flows during storms, thereby losing its treatment efficiency.

A simple means of controlling excessive water runoff is by controlling excessive flows at their origin (manholes). **John Meunier Inc.** manufactures the **HYDROVEX® VHV / SVHV** line of vortex flow regulators to control stormwater flows in sewer networks, as well as manholes.

The vortex flow regulator design is based on the fluid mechanics principle of the forced vortex. This grants flow regulation without any moving parts, thus reducing maintenance. The operation of the regulator, depending on the upstream head and discharge, switches between orifice flow (gravity flow) and vortex flow. Although the concept is quite simple, over 12 years of research have been carried out in order to get a high performance.

The **HYDROVEX® VHV / SVHV** Vertical Vortex Flow Regulators (**refer to Figure 1**) are manufactured entirely of stainless steel, and consist of a hollow body (1) (in which flow control takes place) and an outlet orifice (7). Two rubber "O" rings (3) seal and retain the unit inside the outlet pipe. Two stainless steel retaining rings (4) are welded on the outlet sleeve to ensure that there is no shifting of the "O" rings during installation and use.

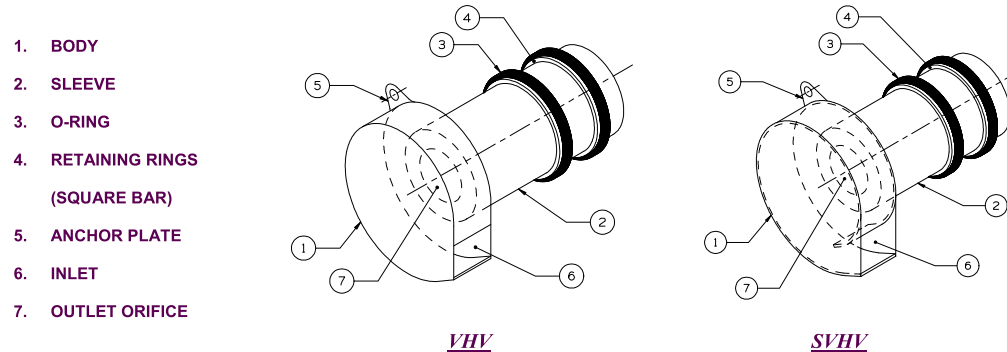


FIGURE 1: HYDROVEX® VHV-SVHV VERTICAL VORTEX FLOW REGULATORS

ADVANTAGES

- The **HYDROVEX® VHV / SVHV** line of flow regulators are manufactured entirely of stainless steel, making them durable and corrosion resistant.
- Having no moving parts, they require minimal maintenance.
- The geometry of the **HYDROVEX® VHV / SVHV** flow regulators allows a control equal to an orifice plate, having a cross section area 4 to 6 times smaller. This decreases the chance of blockage of the regulator, due to sediments and debris found in stormwater flows. **Figure 2** illustrates the comparison between a regulator model 100 SVHV-2 and an equivalent orifice plate. One can see that for the same height of water, the regulator controls a flow approximately four times smaller than an equivalent orifice plate.
- Installation of the **HYDROVEX® VHV / SVHV** flow regulators is quick and straightforward and is performed after all civil works are completed.
- Installation requires no special tools or equipment and may be carried out by any contractor.
- Installation may be carried out in existing structures.

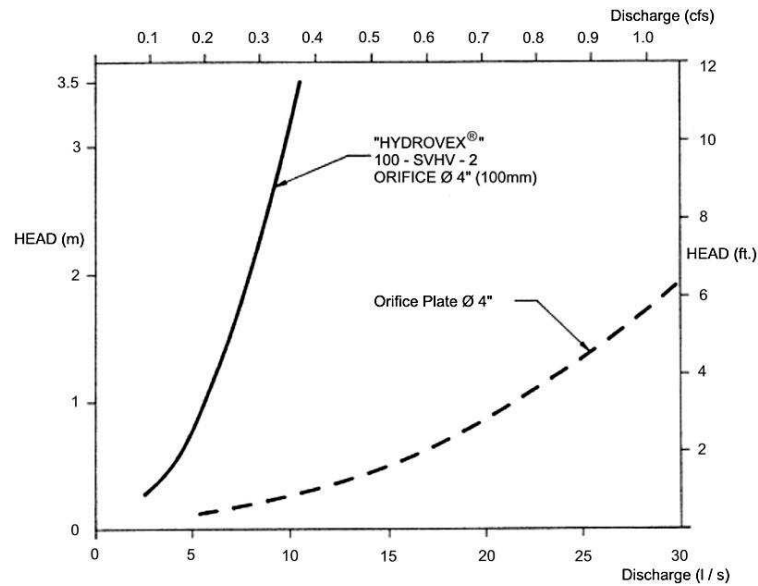


FIGURE 2: DISCHARGE CURVE SHOWING A HYDROVEX® FLOW REGULATOR VS AN ORIFICE PLATE

SELECTION

Selection of a **VHV** or **SVHV** regulator can be easily made using the selection charts found at the back of this brochure (see **Figure 3**). These charts are a graphical representation of the maximum upstream water pressure (head) and the maximum discharge at the manhole outlet. The maximum design head is the difference between the maximum upstream water level and the invert of the outlet pipe. All selections should be verified by John Meunier Inc. personnel prior to fabrication.

Example:

- ✓ Maximum design head 2m (6,56 ft.)
- ✓ Maximum discharge 6 L/s (0.2 cfs)
- ✓ Using **Figure 3** - VHV model required is a **75 VHV-1**

INSTALLATION REQUIREMENTS

All **HYDROVEX®** **VHV** / **SVHV** flow regulators can be installed in circular or square manholes. **Figure 4** gives the various minimum dimensions required for a given regulator. *It is imperative to respect the minimum clearances shown to ensure easy installation and proper functioning of the regulator.*

SPECIFICATIONS

In order to specify a **HYDROVEX**[®] regulator, the following parameters must be defined:

- The model number (ex: 75-VHV-1)
- The diameter and type of outlet pipe (ex: 6" diam. SDR 35)
- The desired discharge (ex: 6 l/s or 0.21 CFS)
- The upstream head (ex: 2 m or 6.56 ft.) *
- The manhole diameter (ex: 36" diam.)
- The minimum clearance "H" (ex: 10 inches)
- The material type (ex: 304 s/s, 11 Ga. standard)

* *Upstream head is defined as the difference in elevation between the maximum upstream water level and the invert of the outlet pipe where the **HYDROVEX**[®] flow regulator is to be installed.*

PLEASE NOTE THAT WHEN REQUESTING A PROPOSAL, WE SIMPLY REQUIRE THAT YOU PROVIDE US WITH THE FOLLOWING:

- *project design flow rate*
- *pressure head*
- *chamber's outlet pipe diameter and type*



Typical VHV model in factory

OPTIONS



VHV-1-O (standard model with odour control inlet)



FV-SVHV (mounted on sliding plate)



FV-VHV-O (mounted on sliding plate with odour control inlet)



VHV with Gooseneck assembly in existing chamber without minimum release at the bottom



VHV with air vent for minimal slopes



VHV Vertical Vortex Flow Regulator

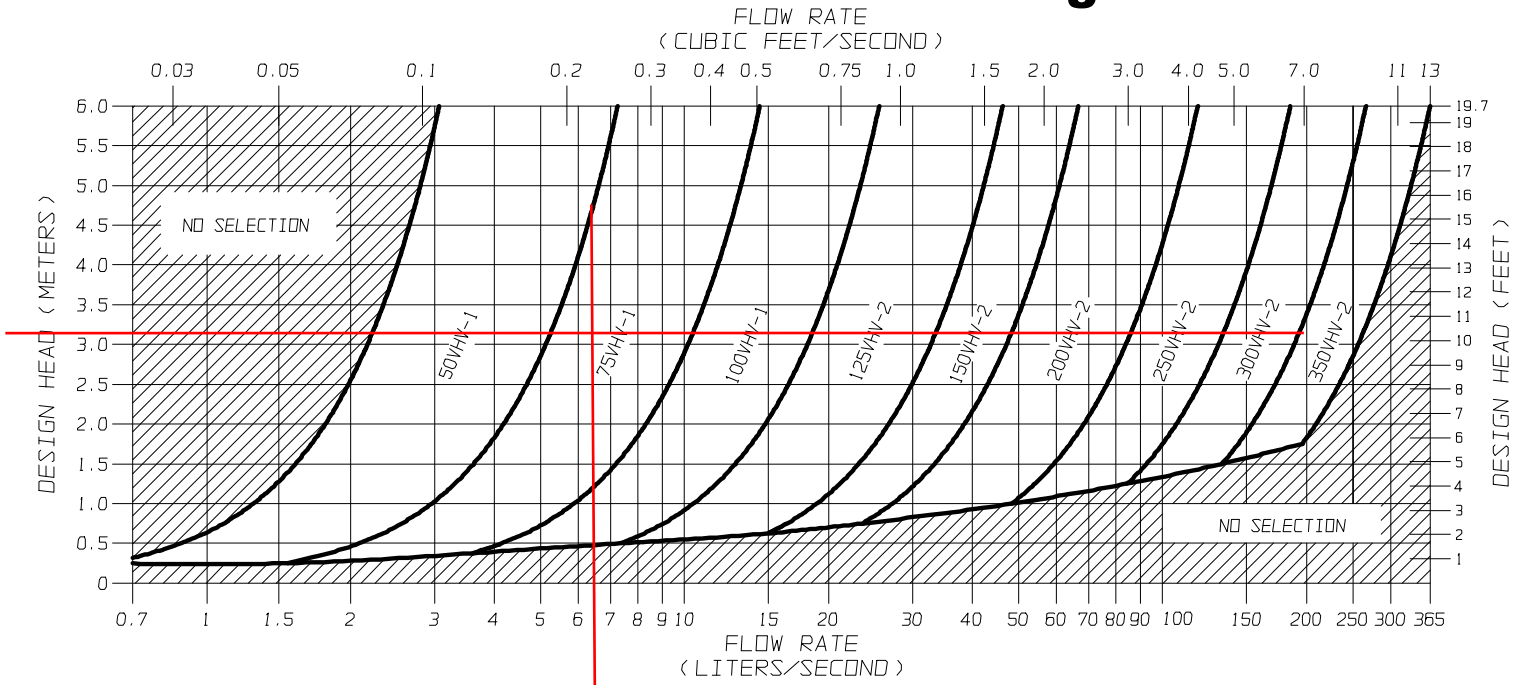


FIGURE 3 - VHV

JOHN MEUNIER



SVHV Vertical Vortex Flow Regulator


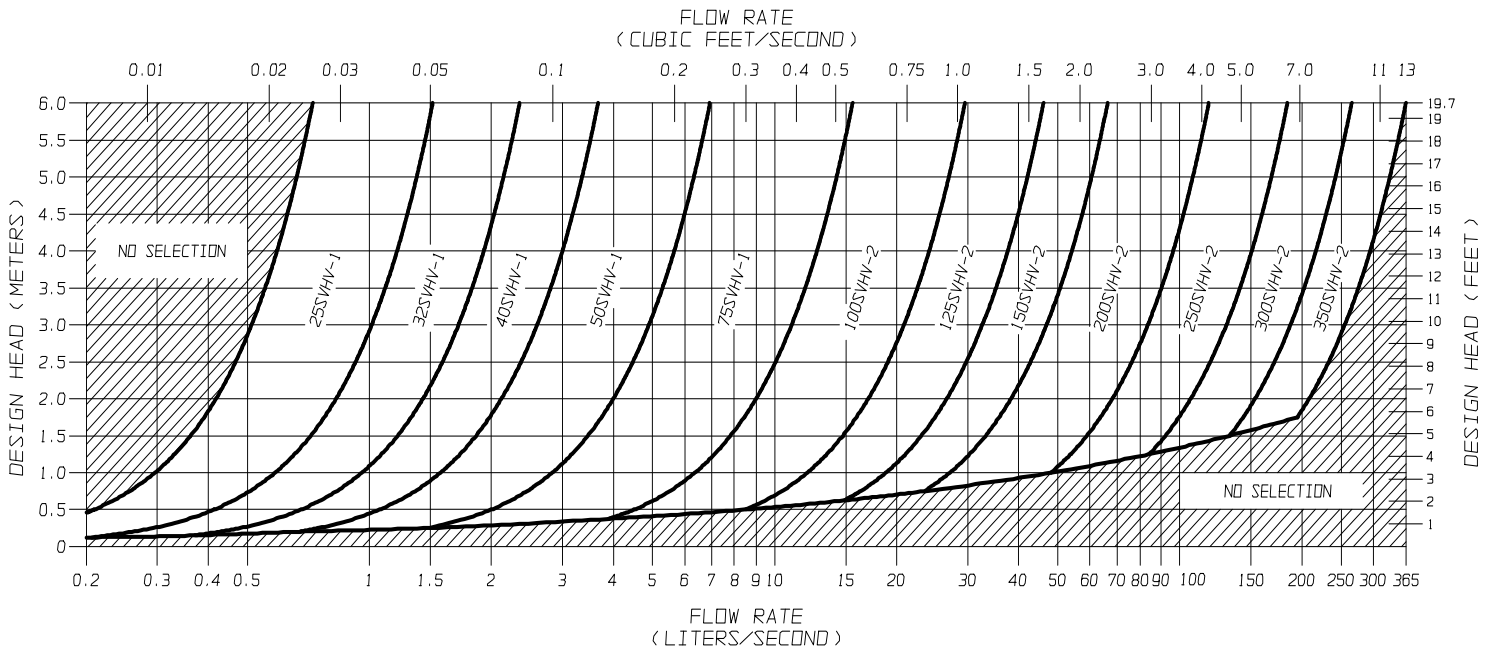


FIGURE 3 - SVHV

JOHN MEUNIER



FLOW REGULATOR TYPICAL INSTALLATION IN CIRCULAR MANHOLE
FIGURE 4 (MODEL VHV)

Model Number	Regulator Diameter		Minimum Manhole Diameter		Minimum Outlet Pipe Diameter		Minimum Clearance	
	A (mm)	A (in.)	B (mm)	B (in.)	C (mm)	C (in.)	H (mm)	H (in.)
50VHV-1	150	6	600	24	150	6	150	6
75VHV-1	250	10	600	24	150	6	150	6
100VHV-1	325	13	900	36	150	6	200	8
125VHV-2	275	11	900	36	150	6	200	8
150VHV-2	350	14	900	36	150	6	225	9
200VHV-2	450	18	1200	48	200	8	300	12
250VHV-2	575	23	1200	48	250	10	350	14
300VHV-2	675	27	1600	64	250	10	400	16
350VHV-2	800	32	1800	72	300	12	500	20

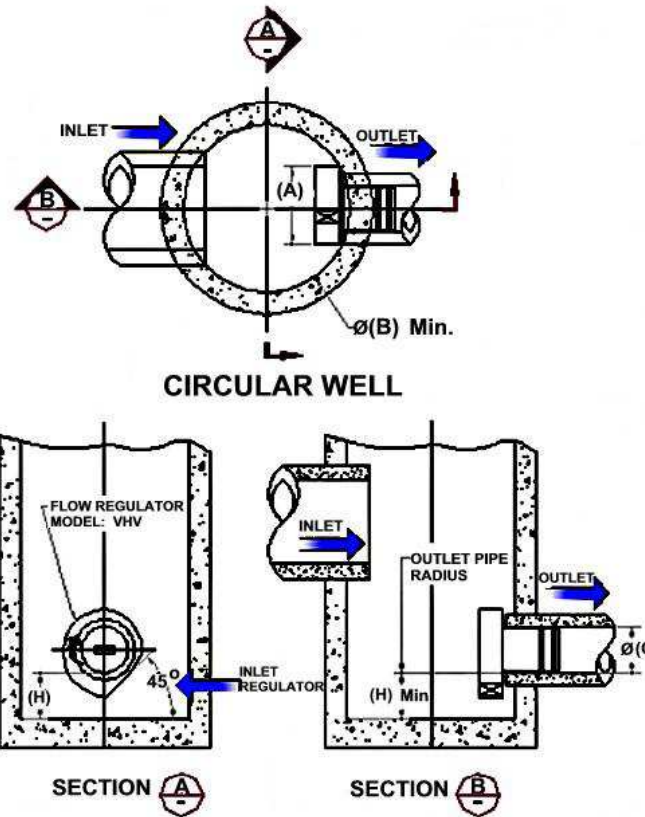

**FLOW REGULATOR TYPICAL INSTALLATION IN CIRCULAR MANHOLE
FIGURE 4 (MODEL SVHV)**


Model Number	Regulator Diameter		Minimum Manhole Diameter		Minimum Outlet Pipe Diameter		Minimum Clearance	
	A (mm)	A (in.)	B (mm)	B (in.)	C (mm)	C (in.)	H (mm)	H (in.)
25 SVHV-1	125	5	600	24	150	6	150	6
32 SVHV-1	150	6	600	24	150	6	150	6
40 SVHV-1	200	8	600	24	150	6	150	6
50 SVHV-1	250	10	600	24	150 <td 6	150	6	
75 SVHV-1	375	15	900	36	150	6	275	11
100 SVHV-2	275	11	900	36	150	6	250	10
125 SVHV-2	350	14	900	36	150	6	300	12
150 SVHV-2	425	17	1200	48	150	6	350	14
200 SVHV-2	575	23	1600	64	200	8	450	18
250 SVHV-2	700	28	1800	72	250	10	550	22
300 SVHV-2	850	34	2400	96	250	10	650	26
350 SVHV-2	1000	40	2400	96	250	10	700	28

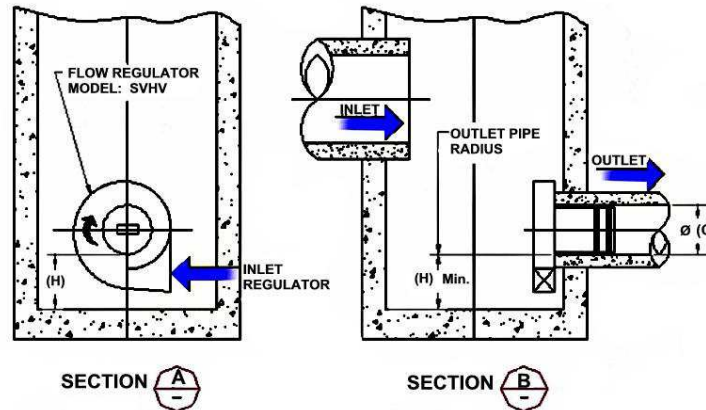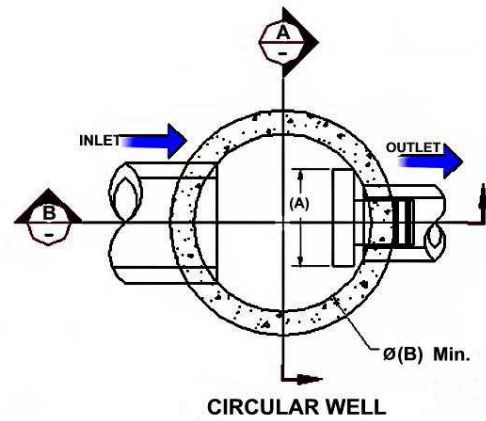


**FLOW REGULATOR TYPICAL INSTALLATION IN SQUARE MANHOLE
FIGURE 4 (MODEL VHV)**

Model Number	Regulator Diameter		Minimum Chamber Width		Minimum Outlet Pipe Diameter		Minimum Clearance	
	A (mm)	A (in.)	B (mm)	B (in.)	C (mm)	C (in.)	H (mm)	H (in.)
50VHV-1	150	6	600	24	150	6	150	6
75VHV-1	250	10	600	24	150	6	150	6
100VHV-1	325	13	600	24	150	6	200	8
125VHV-2	275	11	600	24	150	6	200	8
150VHV-2	350	14	600	24	150	6	225	9
200VHV-2	450	18	900	36	200	8	300	12
250VHV-2	575	23	900	36	250	10	350	14
300VHV-2	675	27	1200	48	250	10	400	16
350VHV-2	800	32	1200	48	300	12	500	20

NOTE: *In the case of a square manhole, the outlet flow pipe must be centered on the wall to ensure enough clearance for the unit.*

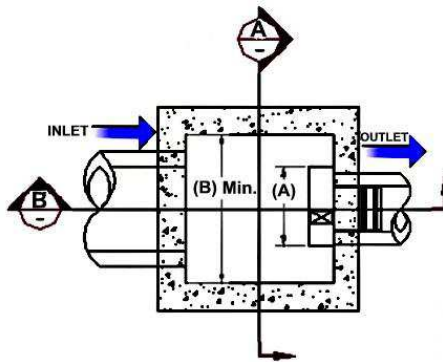



SQUARE / RECTANGULAR WELL

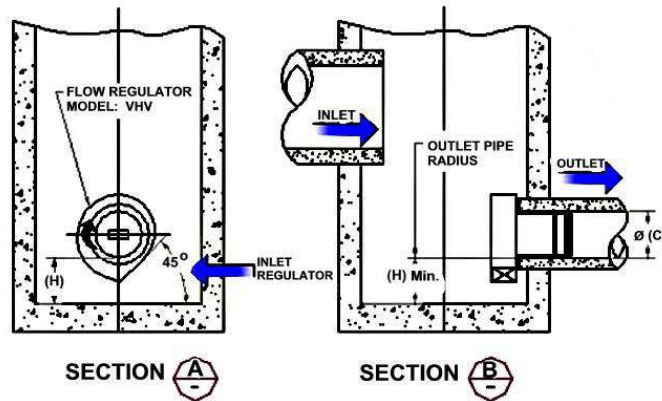

FLOW REGULATOR TYPICAL INSTALLATION IN SQUARE MANHOLE
FIGURE 4 (MODEL SVHV)

Model Number	Regulator Diameter		Minimum Chamber Width		Minimum Outlet Pipe Diameter		Minimum Clearance	
	A (mm)	A (in.)	B (mm)	B (in.)	C (mm)	C (in.)	H (mm)	H (in.)
25 SVHV-1	125	5	600	24	150	6	150	6
32 SVHV-1	150	6	600	24	150	6	150	6
40 SVHV-1	200	8	600	24	150	6	150	6
50 SVHV-1	250	10	600	24	150	6	150	6
75 SVHV-1	375	15	600	24	150	6	275	11
100 SVHV-2	275	11	600	24	150	6	250	10
125 SVHV-2	350	14	600	24	150	6	300	12
150 SVHV-2	425	17	600	24 arrow="right" <td>150</td> <td>6</td> <td>350</td> <td>14</td>	150	6	350	14
200 SVHV-2	575	23	900	36	200	8	450	18
250 SVHV-2	700	28	900	36	250	10	550	22
300 SVHV-2	850	34	1200	48	250	10	650	26
350 SVHV-2	1000	40	1200	48	250	10	700	28

NOTE: *In the case of a square manhole, the outlet flow pipe must be centered on the wall to ensure enough clearance for the unit.*

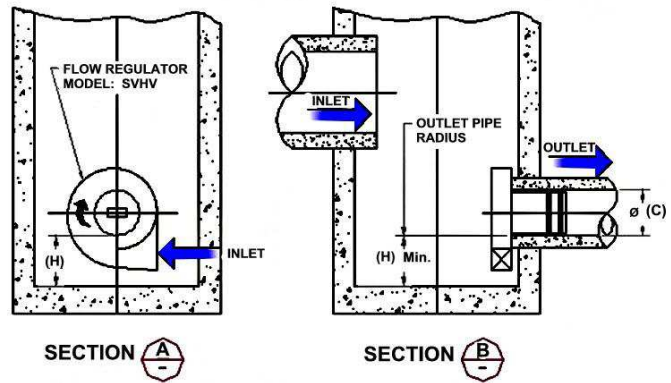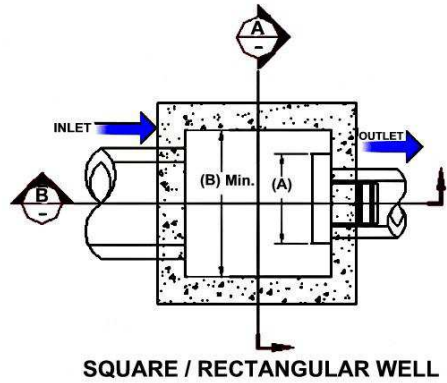

INSTALLATION

The installation of a **HYDROVEX**[®] regulator may be undertaken once the manhole and piping is in place. Installation consists of simply fitting the regulator into the outlet pipe of the manhole. **John Meunier Inc.** recommends the use of a lubricant on the outlet pipe, in order to facilitate the insertion and orientation of the flow controller.

MAINTENANCE

HYDROVEX[®] regulators are manufactured in such a way as to be maintenance free; however, a periodic inspection (every 3-6 months) is suggested in order to ensure that neither the inlet nor the outlet has become blocked with debris. The manhole should undergo periodically, particularly after major storms, inspection and cleaning as established by the municipality

GUARANTY

The **HYDROVEX**[®] line of **VHV / SVHV** regulators are guaranteed against both design and manufacturing defects for a period of 5 years. Should a unit be defective, **John Meunier Inc.** is solely responsible for either modification or replacement of the unit.

John Meunier Inc.

ISO 9001 : 2008

Head Office

4105 Sartelon
Saint-Laurent (Quebec) Canada H4S 2B3
Tel.: 514-334-7230 www.johnmeunier.com
Fax: 514-334-5070 cs@johnmeunier.com

Ontario Office

2000 Argentia Road, Plaza 4, Unit 430
Mississauga (Ontario) Canada L5N 1W1
Tel.: 905-286-4846 www.johnmeunier.com
Fax: 905-286-0488 ontario@johnmeunier.com

USA Office

2209 Menlo Avenue
Glenside, PA USA 19038
Tel.: 412-417-6614 www.johnmeunier.com
Fax: 215-885-4741 asteel@johnmeunier.com



Revised: 2011-05-03

PROJECT INFORMATION	
ENGINEERED PRODUCT MANAGER	
ADS SALES REP	
PROJECT NO.	



210216 - 6001-6005 RENAUD

OTTAWA, ON, CANADA

MC-3500 STORMTECH CHAMBER SPECIFICATIONS

- CHAMBERS SHALL BE STORMTECH MC-3500.
- CHAMBERS SHALL BE ARCH-SHAPED AND SHALL BE MANUFACTURED FROM VIRGIN, IMPACT-MODIFIED POLYPROPYLENE COPOLYMERS.
- CHAMBERS SHALL BE CERTIFIED TO CSA B184, "POLYMERIC SUB-SURFACE STORMWATER MANAGEMENT STRUCTURES", AND MEET THE REQUIREMENTS OF ASTM F2418, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS" CHAMBER CLASSIFICATION 45x76 DESIGNATION SS.
- CHAMBER ROWS SHALL PROVIDE CONTINUOUS, UNOBSTRUCTED INTERNAL SPACE WITH NO INTERNAL SUPPORTS THAT WOULD IMPEDE FLOW OR LIMIT ACCESS FOR INSPECTION.
- THE STRUCTURAL DESIGN OF THE CHAMBERS, THE STRUCTURAL BACKFILL, AND THE INSTALLATION REQUIREMENTS SHALL ENSURE THAT THE LOAD FACTORS SPECIFIED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET FOR: 1) LONG-DURATION DEAD LOADS AND 2) SHORT-DURATION LIVE LOADS, BASED ON THE CSA S6 CL-625 TRUCK AND THE AASHTO DESIGN TRUCK WITH CONSIDERATION FOR IMPACT AND MULTIPLE VEHICLE PRESENCES.
- CHAMBERS SHALL BE DESIGNED, TESTED AND ALLOWABLE LOAD CONFIGURATIONS DETERMINED IN ACCORDANCE WITH ASTM F2787, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS". LOAD CONFIGURATIONS SHALL INCLUDE: 1) INSTANTANEOUS (<1 MIN) AASHTO DESIGN TRUCK LIVE LOAD ON MINIMUM COVER 2) MAXIMUM PERMANENT (75-YR) COVER LOAD AND 3) ALLOWABLE COVER WITH PARKED (1-WEEK) AASHTO DESIGN TRUCK.
- REQUIREMENTS FOR HANDLING AND INSTALLATION:
 - TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 - TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 75 mm (3").
 - TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT AS DEFINED IN SECTION 6.2.8 OF ASTM F2418 SHALL BE GREATER THAN OR EQUAL TO 450 LBS/FT%. AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 23° C / 73° F), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.
- ONLY CHAMBERS THAT ARE APPROVED BY THE SITE DESIGN ENGINEER WILL BE ALLOWED. UPON REQUEST BY THE SITE DESIGN ENGINEER OR OWNER, THE CHAMBER MANUFACTURER SHALL SUBMIT A STRUCTURAL EVALUATION FOR APPROVAL BEFORE DELIVERING CHAMBERS TO THE PROJECT SITE AS FOLLOWS:
 - THE STRUCTURAL EVALUATION SHALL BE SEALED BY A REGISTERED PROFESSIONAL ENGINEER.
 - THE STRUCTURAL EVALUATION SHALL DEMONSTRATE THAT THE SAFETY FACTORS ARE GREATER THAN OR EQUAL TO 1.95 FOR DEAD LOAD AND 1.75 FOR LIVE LOAD, THE MINIMUM REQUIRED BY ASTM F2787 AND BY SECTIONS 3 AND 12.12 OF THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS FOR THERMOPLASTIC PIPE.
 - THE TEST DERIVED CREEP MODULUS AS SPECIFIED IN ASTM F2418 SHALL BE USED FOR PERMANENT DEAD LOAD DESIGN EXCEPT THAT IT SHALL BE THE 75-YEAR MODULUS USED FOR DESIGN.
- CHAMBERS AND END CAPS SHALL BE PRODUCED AT AN ISO 9001 CERTIFIED MANUFACTURING FACILITY.

IMPORTANT - NOTES FOR THE BIDDING AND INSTALLATION OF MC-3500 CHAMBER SYSTEM

- STORMTECH MC-3500 CHAMBERS SHALL NOT BE INSTALLED UNTIL THE MANUFACTURER'S REPRESENTATIVE HAS COMPLETED A PRE-CONSTRUCTION MEETING WITH THE INSTALLERS.
- STORMTECH MC-3500 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
- CHAMBERS ARE NOT TO BE BACKFILLED WITH A DOZER OR AN EXCAVATOR SITUATED OVER THE CHAMBERS. STORMTECH RECOMMENDS 3 BACKFILL METHODS:
 - STONESHOOTER LOCATED OFF THE CHAMBER BED.
 - BACKFILL AS ROWS ARE BUILT USING AN EXCAVATOR ON THE FOUNDATION STONE OR SUBGRADE.
 - BACKFILL FROM OUTSIDE THE EXCAVATION USING A LONG BOOM HOE OR EXCAVATOR.
- THE FOUNDATION STONE SHALL BE LEVELED AND COMPACTED PRIOR TO PLACING CHAMBERS.
- JOINTS BETWEEN CHAMBERS SHALL BE PROPERLY SEATED PRIOR TO PLACING STONE.
- MAINTAIN MINIMUM - 150 mm (6") SPACING BETWEEN THE CHAMBER ROWS.
- INLET AND OUTLET MANIFOLDS MUST BE INSERTED A MINIMUM OF 300 mm (12") INTO CHAMBER END CAPS.
- EMBEDMENT STONE SURROUNDING CHAMBERS MUST BE A CLEAN, CRUSHED, ANGULAR STONE WELL GRADED BETWEEN ¾" AND 2" (20-50 mm).
- STONE MUST BE PLACED ON THE TOP CENTER OF THE CHAMBER TO ANCHOR THE CHAMBERS IN PLACE AND PRESERVE ROW SPACING.
- THE CONTRACTOR MUST REPORT ANY DISCREPANCIES WITH CHAMBER FOUNDATION MATERIALS BEARING CAPACITIES TO THE SITE DESIGN ENGINEER.
- ADS RECOMMENDS THE USE OF "FLEXSTORM CATCH IT" INSERTS DURING CONSTRUCTION FOR ALL INLETS TO PROTECT THE SUBSURFACE STORMWATER MANAGEMENT SYSTEM FROM CONSTRUCTION SITE RUNOFF.

NOTES FOR CONSTRUCTION EQUIPMENT

- STORMTECH MC-3500 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
- THE USE OF EQUIPMENT OVER MC-3500 CHAMBERS IS LIMITED:
 - NO EQUIPMENT IS ALLOWED ON BARE CHAMBERS.
 - NO RUBBER Tired LOADER, DUMP TRUCK, OR EXCAVATORS ARE ALLOWED UNTIL PROPER FILL DEPTHS ARE REACHED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
 - WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT CAN BE FOUND IN THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
- FULL 900 mm (36") OF STABILIZED COVER MATERIALS OVER THE CHAMBERS IS REQUIRED FOR DUMP TRUCK TRAVEL OR DUMPING.

USE OF A DOZER TO PUSH EMBEDMENT STONE BETWEEN THE ROWS OF CHAMBERS MAY CAUSE DAMAGE TO CHAMBERS AND IS NOT AN ACCEPTABLE BACKFILL METHOD. ANY CHAMBERS DAMAGED BY USING THE "DUMP AND PUSH" METHOD ARE NOT COVERED UNDER THE STORMTECH STANDARD WARRANTY.

CONTACT STORMTECH AT 1-888-892-2694 WITH ANY QUESTIONS ON INSTALLATION REQUIREMENTS OR WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT.

PROPOSED LAYOUT		CONCEPTUAL ELEVATIONS:	
20	STORMTECH MC-3500 CHAMBERS	MAXIMUM ALLOWABLE GRADE (TOP OF PAVEMENT/UNPAVED):	3.810
4	STORMTECH MC-3500 END CAPS	MINIMUM ALLOWABLE GRADE (UNPAVED WITH TRAFFIC):	1.981
305	STONE ABOVE (mm)	MINIMUM ALLOWABLE GRADE (UNPAVED NO TRAFFIC):	1.829
229	STONE BELOW (mm)	MINIMUM ALLOWABLE GRADE (TOP OF RIGID CONCRETE PAVEMENT):	1.829
40	STONE VOID	MINIMUM ALLOWABLE GRADE (BASE OF FLEXIBLE PAVEMENT):	1.829
112.5	INSTALLED SYSTEM VOLUME (m ³) (PERIMETER STONE INCLUDED) (COVER STONE INCLUDED) (BASE STONE INCLUDED)	TOP OF STONE:	1.676
		TOP OF MC-3500 CHAMBER:	1.372
		300 mm x 300 mm TOP MANIFOLD INVERT:	0.898
		600 mm ISOLATOR ROW PLUS INVERT:	0.281
110.6	SYSTEM AREA (m ²)	BOTTOM OF MC-3500 CHAMBER:	0.229
56.7	SYSTEM PERIMETER (m)	BOTTOM OF STONE:	0.000

					*INVERT ABOVE BASE OF CHAMBER	
PART TYPE	ITEM ON LAYOUT	DESCRIPTION	INVERT*	MAX FLOW		
PREFABRICATED END CAP	A	600 mm BOTTOM CORED END CAP, PART#: MC3500IEPP24BC / TYP OF ALL 600 mm BOTTOM CONNECTIONS AND ISOLATOR PLUS ROWS	52 mm			
PREFABRICATED END CAP	B	300 mm TOP CORED END CAP, PART#: MC3500IEPP12T / TYP OF ALL 300 mm TOP CONNECTIONS	670 mm			
FLAMP	C	INSTALL FLAMP ON 600 mm ACCESS PIPE / PART#: MCFLAMP				
MANIFOLD	D	300 mm x 300 mm TOP MANIFOLD, ADS N-12	670 mm			
NYLOPLAST (INLET W/ ISO PLUS ROW)	E	750 mm DIAMETER (610 mm SUMP MIN)			70 L/s IN	



- ISOLATOR ROW PLUS (SEE DETAIL)
- PLACE MINIMUM 5.334 m OF ADSPLUS175 WOVEN GEOTEXTILE OVER BEDDING STONE AND UNDERNEATH CHAMBER FEET FOR SCOUR PROTECTION AT ALL CHAMBER INLET ROWS
- BED LIMITS

NOTES

- MANIFOLD SIZE TO BE DETERMINED BY SITE DESIGN ENGINEER. SEE TECH NOTE #6.32 FOR MANIFOLD SIZING GUIDANCE.
- DUE TO THE ADAPTATION OF THIS CHAMBER SYSTEM TO SPECIFIC SITE AND DESIGN CONSTRAINTS, IT MAY BE NECESSARY TO CUT AND COUPLE ADDITIONAL PIPE TO STANDARD MANIFOLD COMPONENTS IN THE FIELD.
- THE SITE DESIGN ENGINEER MUST REVIEW ELEVATIONS AND IF NECESSARY ADJUST GRADING TO ENSURE THE CHAMBER COVER REQUIREMENTS ARE MET.
- THIS CHAMBER SYSTEM WAS DESIGNED WITHOUT SITE-SPECIFIC INFORMATION ON SOIL CONDITIONS OR BEARING CAPACITY. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL AND PROVIDING THE BEARING CAPACITY OF THE INSITU SOILS. THE BASE STONE DEPTH MAY BE INCREASED OR DECREASED ONCE THIS INFORMATION IS PROVIDED.
- **NOT FOR CONSTRUCTION:** THIS LAYOUT IS FOR DIMENSIONAL PURPOSES ONLY TO PROVE CONCEPT & THE REQUIRED STORAGE VOLUME CAN BE ACHIEVED ON SITE.

210216 - 6001-6005 RENAUD

OTTAWA, ON, CANADA

DATE: _____

PROJECT #: _____

DRAWN: KH

CHECKED: N/A

StormTech®
Chamber System

888-892-2694 | WWW.STORMTECH.COM

4640 TRUEMAN BLVD
HILLIARD, OH 43026
1-800-733-7473

SCALE = 1 : 100

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.


SHEET
2 OF 6

ACCEPTABLE FILL MATERIALS: STORMTECH MC-3500 CHAMBER SYSTEMS

MATERIAL LOCATION	DESCRIPTION	AASHTO MATERIAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
D	FINAL FILL: FILL MATERIAL FOR LAYER 'D' STARTS FROM THE TOP OF THE 'C' LAYER TO THE BOTTOM OF FLEXIBLE PAVEMENT OR UNPAVED FINISHED GRADE ABOVE. NOTE THAT PAVEMENT SUBBASE MAY BE PART OF THE 'D' LAYER	N/A	PREPARE PER SITE DESIGN ENGINEER'S PLANS. PAVED INSTALLATIONS MAY HAVE STRINGENT MATERIAL AND PREPARATION REQUIREMENTS.
C	INITIAL FILL: FILL MATERIAL FOR LAYER 'C' STARTS FROM THE TOP OF THE EMBEDMENT STONE ('B' LAYER) TO 24" (600 mm) ABOVE THE TOP OF THE CHAMBER. NOTE THAT PAVEMENT SUBBASE MAY BE A PART OF THE 'C' LAYER.	AASHTO M145 ¹ A-1, A-2-4, A-3 OR AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57, 6, 67, 68, 7, 78, 8, 89, 9, 10	BEGIN COMPACTIONS AFTER 24" (600 mm) OF MATERIAL OVER THE CHAMBERS IS REACHED. COMPACT ADDITIONAL LAYERS IN 12" (300 mm) MAX LIFTS TO A MIN. 95% PROCTOR DENSITY FOR WELL GRADED MATERIAL AND 95% RELATIVE DENSITY FOR PROCESSED AGGREGATE MATERIALS.
B	EMBEDMENT STONE: FILL SURROUNDING THE CHAMBERS FROM THE FOUNDATION STONE ('A' LAYER) TO THE 'C' LAYER ABOVE.	AASHTO M43 ¹ 3, 4	NO COMPACTION REQUIRED.
A	FOUNDATION STONE: FILL BELOW CHAMBERS FROM THE SUBGRADE UP TO THE FOOT (BOTTOM) OF THE CHAMBER.	AASHTO M43 ¹ 3, 4	PLATE COMPACT OR ROLL TO ACHIEVE A FLAT SURFACE. ^{2,3}

PLEASE NOTE:

1. THE LISTED AASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE CLEAN, CRUSHED, ANGULAR. FOR EXAMPLE, A SPECIFICATION FOR #4 STONE WOULD STATE: "CLEAN, CRUSHED, ANGULAR NO. 4 (AASHTO M43) STONE".
2. STORMTECH COMPACTION REQUIREMENTS ARE MET FOR 'A' LOCATION MATERIALS WHEN PLACED AND COMPACTED IN 9" (230 mm) (MAX) LIFTS USING TWO FULL COVERAGES WITH A VIBRATORY COMPACTOR.
3. WHERE INFILTRATION SURFACES MAY BE COMPROMISED BY COMPACTION, FOR STANDARD DESIGN LOAD CONDITIONS, A FLAT SURFACE MAY BE ACHIEVED BY RAKING OR DRAGGING WITHOUT COMPACTION EQUIPMENT. FOR SPECIAL LOAD DESIGNS, CONTACT STORMTECH FOR COMPACTION REQUIREMENTS.
4. ONCE LAYER 'C' IS PLACED, ANY SOIL/MATERIAL CAN BE PLACED IN LAYER 'D' UP TO THE FINISHED GRADE. MOST PAVEMENT SUBBASE SOILS CAN BE USED TO REPLACE THE MATERIAL REQUIREMENTS OF LAYER 'C' OR 'D' AT THE SITE DESIGN ENGINEER'S DISCRETION.

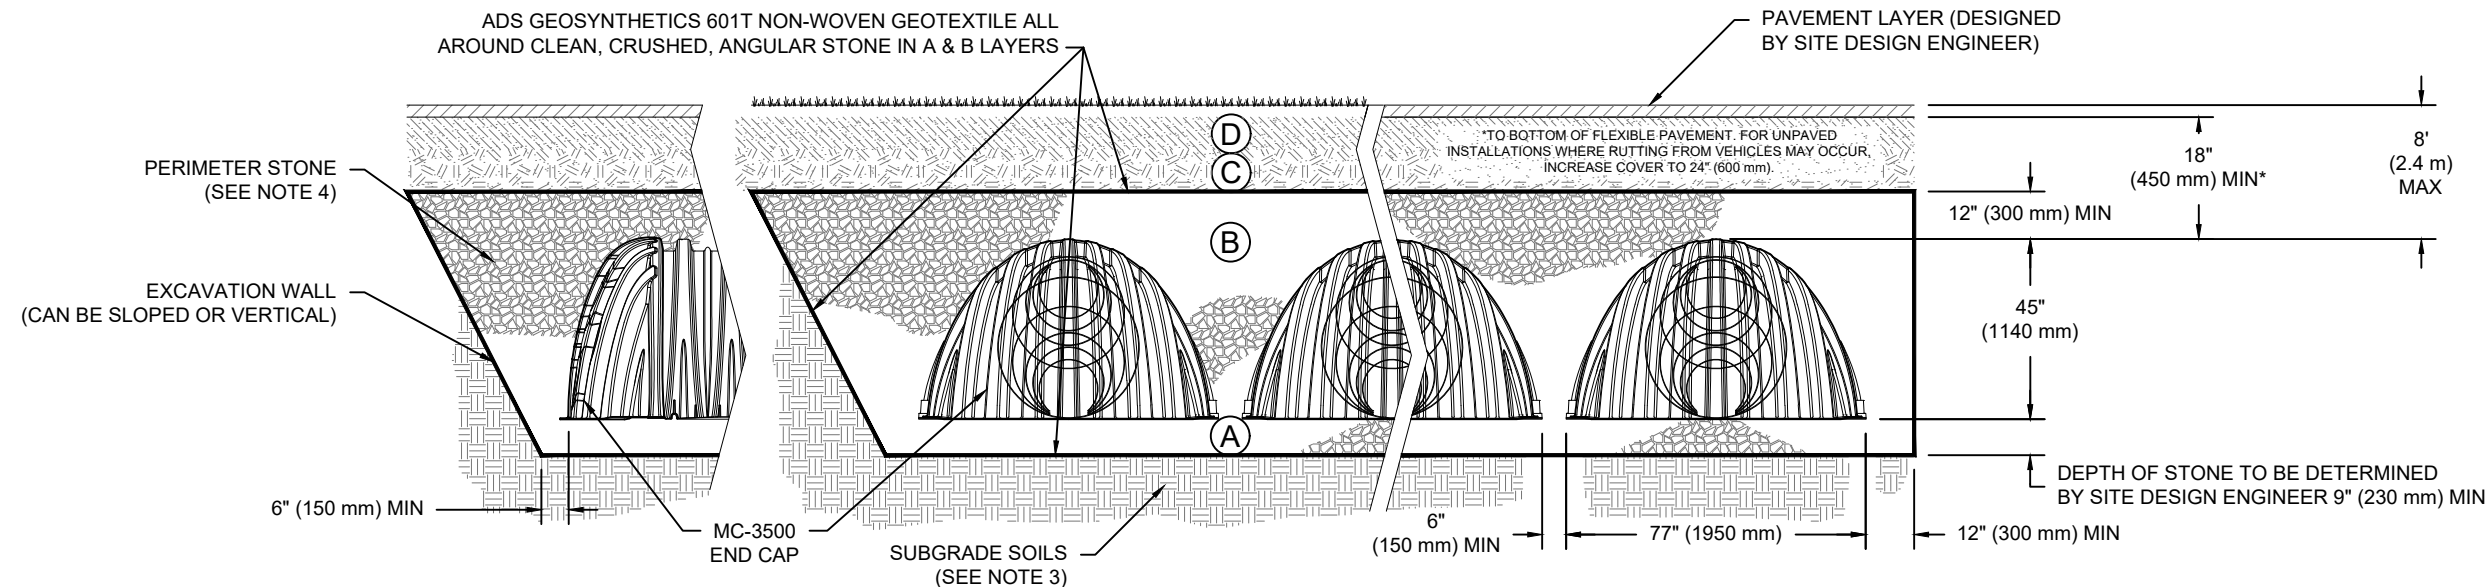

NOTES:

1. CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F2418, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS" CHAMBER CLASSIFICATION 45x76 DESIGNATION SS.
2. MC-3500 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
3. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR ASSESSING THE BEARING RESISTANCE (ALLOWABLE BEARING CAPACITY) OF THE SUBGRADE SOILS AND THE DEPTH OF FOUNDATION STONE WITH CONSIDERATION FOR THE RANGE OF EXPECTED SOIL MOISTURE CONDITIONS.
4. PERIMETER STONE MUST BE EXTENDED HORIZONTALLY TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.
5. REQUIREMENTS FOR HANDLING AND INSTALLATION:
 - TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 - TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 3".
 - TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT SHALL BE GREATER THAN OR EQUAL TO 450 LBS/FT²%. THE ASC IS DEFINED IN SECTION 6.2.8 OF ASTM F2418. AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 73° F / 23° C), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.

210216 - 6001-6005 RENAUD

OTTAWA, ON, CANADA

DATE:

PROJECT #:

CHK

DATE


DESCRIPTION

StormTech®
Chamber System
888-892-2694 | WWW.STORMTECH.COM

4640 TRUEMAN BLVD
HILLIARD, OH 43026
1-800-733-7473



THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

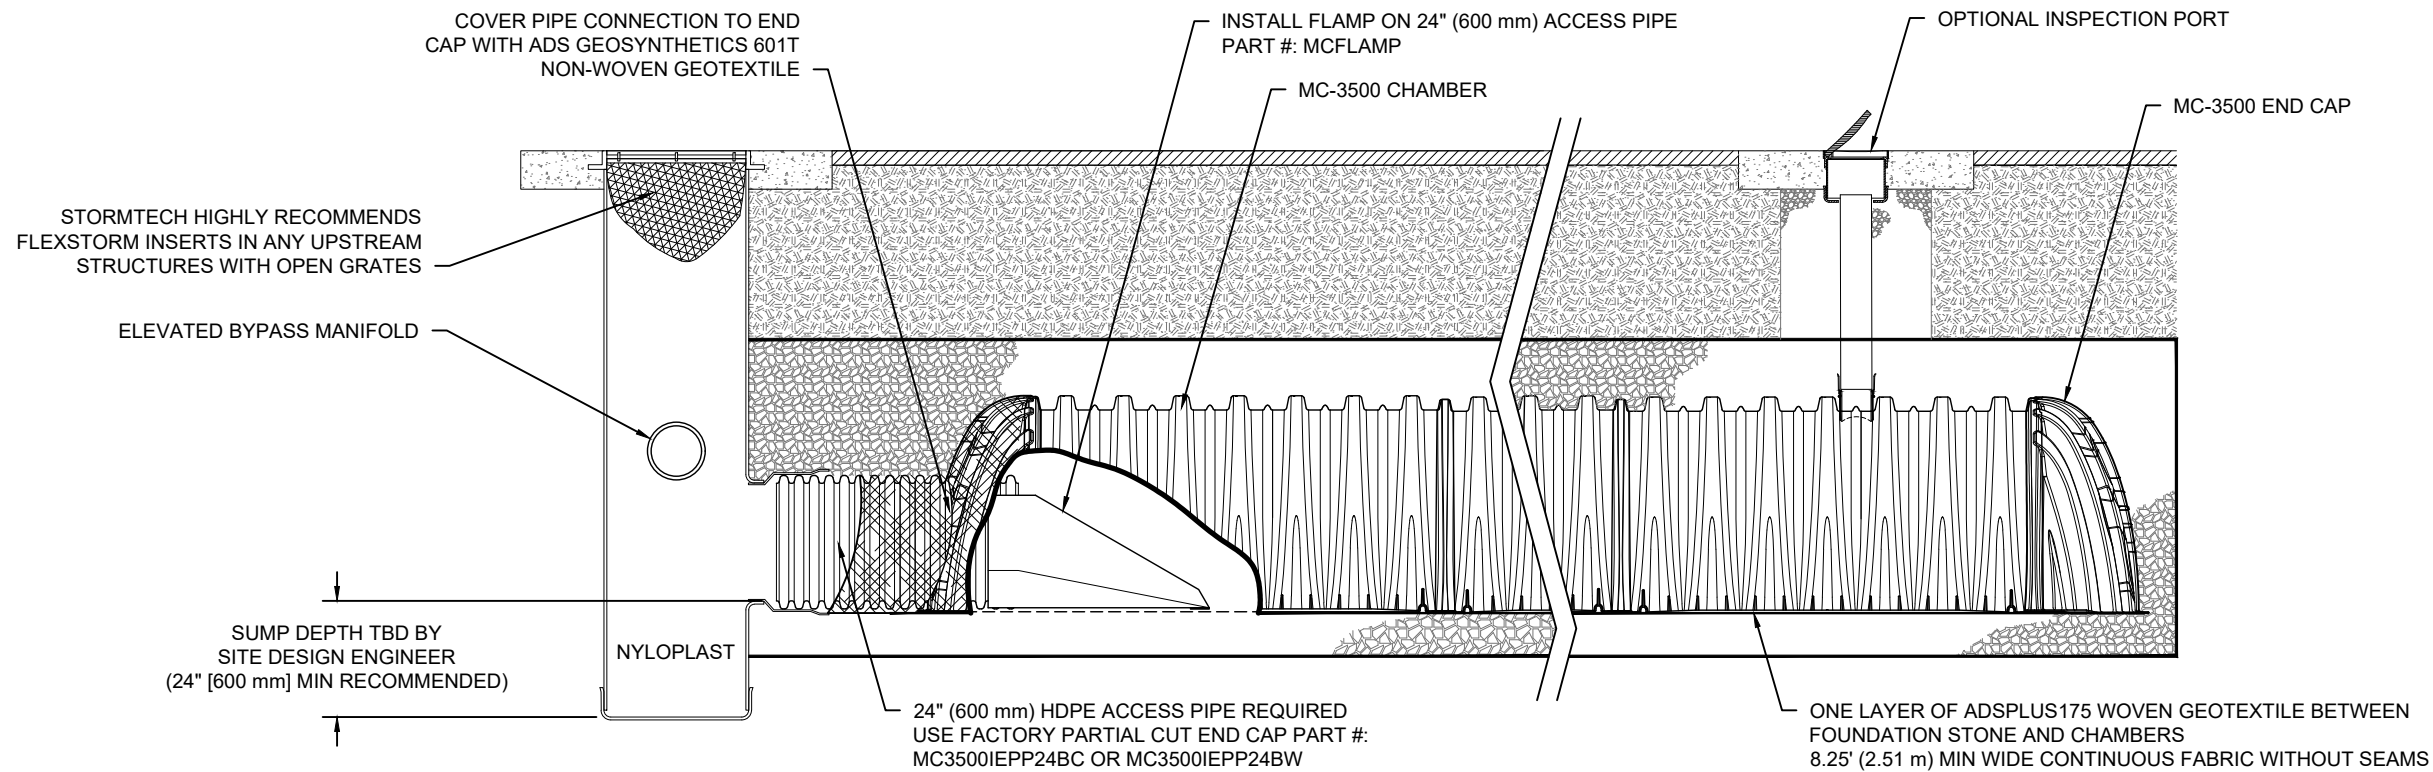

MC-3500 ISOLATOR ROW PLUS DETAIL

NTS

INSPECTION & MAINTENANCE

- STEP 1) INSPECT ISOLATOR ROW PLUS FOR SEDIMENT
 - A. INSPECTION PORTS (IF PRESENT)
 - A.1. REMOVE/OPEN LID ON NYLOPLAST INLINE DRAIN
 - A.2. REMOVE AND CLEAN FLEXSTORM FILTER IF INSTALLED
 - A.3. USING A FLASHLIGHT AND STADIA ROD, MEASURE DEPTH OF SEDIMENT AND RECORD ON MAINTENANCE LOG
 - A.4. LOWER A CAMERA INTO ISOLATOR ROW PLUS FOR VISUAL INSPECTION OF SEDIMENT LEVELS (OPTIONAL)
 - A.5. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
 - B. ALL ISOLATOR PLUS ROWS
 - B.1. REMOVE COVER FROM STRUCTURE AT UPSTREAM END OF ISOLATOR ROW PLUS
 - B.2. USING A FLASHLIGHT, INSPECT DOWN THE ISOLATOR ROW PLUS THROUGH OUTLET PIPE
 - i) MIRRORS ON POLES OR CAMERAS MAY BE USED TO AVOID A CONFINED SPACE ENTRY
 - ii) FOLLOW OSHA REGULATIONS FOR CONFINED SPACE ENTRY IF ENTERING MANHOLE
 - B.3. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
- STEP 2) CLEAN OUT ISOLATOR ROW PLUS USING THE JETVAC PROCESS
 - A. A FIXED CULVERT CLEANING NOZZLE WITH REAR FACING SPREAD OF 45" (1.1 m) OR MORE IS PREFERRED
 - B. APPLY MULTIPLE PASSES OF JETVAC UNTIL BACKFLUSH WATER IS CLEAN
 - C. VACUUM STRUCTURE SUMP AS REQUIRED
- STEP 3) REPLACE ALL COVERS, GRATES, FILTERS, AND LIDS; RECORD OBSERVATIONS AND ACTIONS.
- STEP 4) INSPECT AND CLEAN BASINS AND MANHOLES UPSTREAM OF THE STORMTECH SYSTEM.


NOTES

- 1. INSPECT EVERY 6 MONTHS DURING THE FIRST YEAR OF OPERATION. ADJUST THE INSPECTION INTERVAL BASED ON PREVIOUS OBSERVATIONS OF SEDIMENT ACCUMULATION AND HIGH WATER ELEVATIONS.
- 2. CONDUCT JETTING AND VACTORING ANNUALLY OR WHEN INSPECTION SHOWS THAT MAINTENANCE IS NECESSARY.

<p>StormTech® Chamber System</p> <p>888-892-2694 WWW.STORMTECH.COM</p>	
<p>4640 TRUEMAN BLVD HILLIARD, OH 43026 1-800-733-7473</p>	<p>210216 - 6001-6005 RENAUD OTTAWA, ON, CANADA</p>
<p>DATE: _____</p> <p>PROJECT #: _____</p>	<p>DRAWN: KH</p> <p>CHECKED: N/A</p>
<p>DATE DRW CHK DESCRIPTION</p>	
<p>THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.</p>	
<p>SHEET 4 OF 6</p>	

MC-3500 TECHNICAL SPECIFICATION

NTS

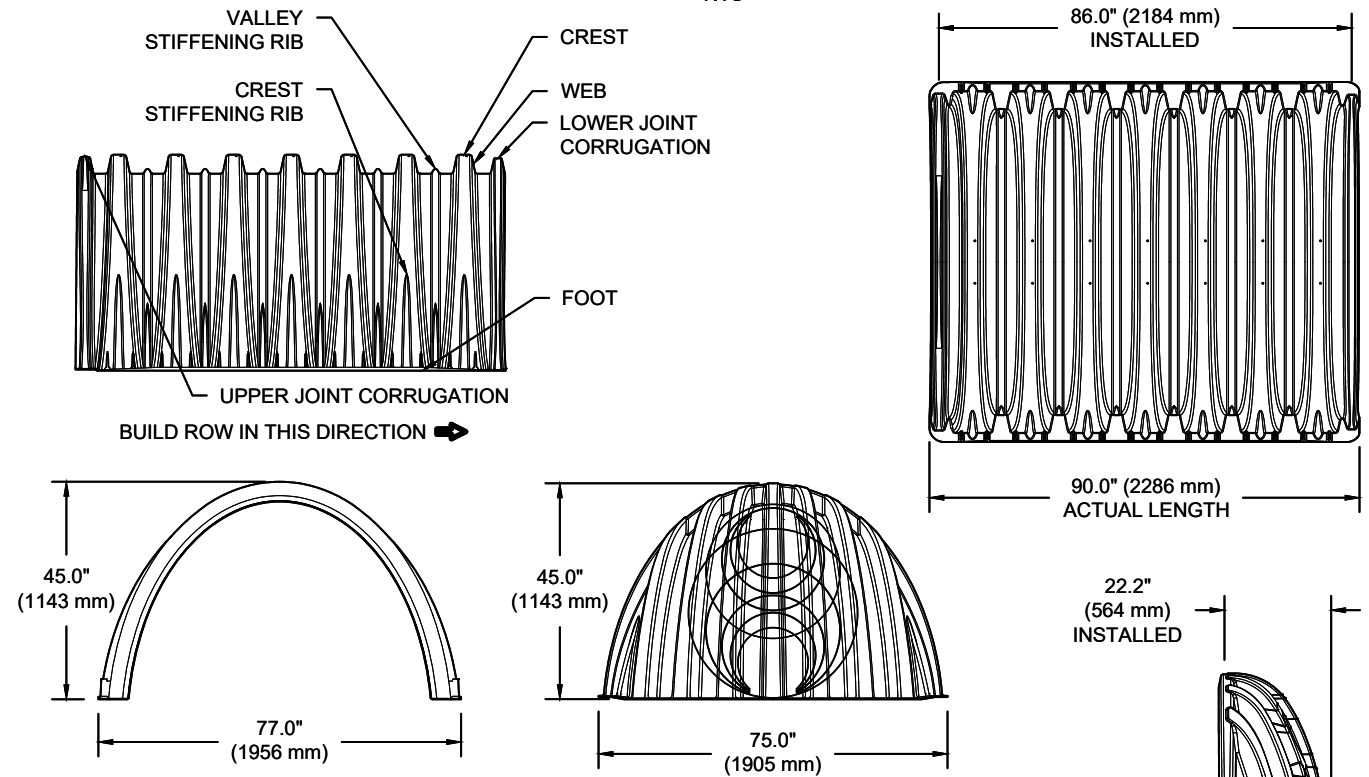

NOMINAL CHAMBER SPECIFICATIONS

SIZE (W X H X INSTALLED LENGTH)	77.0" X 45.0" X 86.0"	(1956 mm X 1143 mm X 2184 mm)
CHAMBER STORAGE	109.9 CUBIC FEET	(3.11 m ³)
MINIMUM INSTALLED STORAGE*	175.0 CUBIC FEET	(4.96 m ³)
WEIGHT	134 lbs.	(60.8 kg)

NOMINAL END CAP SPECIFICATIONS

SIZE (W X H X INSTALLED LENGTH)	75.0" X 45.0" X 22.2"	(1905 mm X 1143 mm X 564 mm)
END CAP STORAGE	14.9 CUBIC FEET	(0.42 m ³)
MINIMUM INSTALLED STORAGE*	45.1 CUBIC FEET	(1.28 m ³)
WEIGHT	49 lbs.	(22.2 kg)

*ASSUMES 12" (305 mm) STONE ABOVE, 9" (229 mm) STONE FOUNDATION, 6" SPACING BETWEEN CHAMBERS, 6" (152 mm) STONE PERIMETER IN FRONT OF END CAPS AND 40% STONE POROSITY


STUBS AT BOTTOM OF END CAP FOR PART NUMBERS ENDING WITH "B"
 STUBS AT TOP OF END CAP FOR PART NUMBERS ENDING WITH "T"
 END CAPS WITH A WELDED CROWN PLATE END WITH "C"
 END CAPS WITH A PREFABRICATED WELDED STUB END WITH "W"

PART #	STUB	B	C
MC3500IEPP06T	6" (150 mm)	33.21" (844 mm)	---
MC3500IEPP06B		---	0.66" (17 mm)
MC3500IEPP08T	8" (200 mm)	31.16" (791 mm)	---
MC3500IEPP08B		---	0.81" (21 mm)
MC3500IEPP10T	10" (250 mm)	29.04" (738 mm)	---
MC3500IEPP10B		---	0.93" (24 mm)
MC3500IEPP12T	12" (300 mm)	26.36" (670 mm)	---
MC3500IEPP12B		---	1.35" (34 mm)
MC3500IEPP15T	15" (375 mm)	23.39" (594 mm)	---
MC3500IEPP15B		---	1.50" (38 mm)
MC3500IEPP18TC	18" (450 mm)	20.03" (509 mm)	---
MC3500IEPP18TW			---
MC3500IEPP18BC			1.77" (45 mm)
MC3500IEPP18BW			---
MC3500IEPP24TC	24" (600 mm)	14.48" (368 mm)	---
MC3500IEPP24TW			---
MC3500IEPP24BC			2.06" (52 mm)
MC3500IEPP24BW			---
MC3500IEPP30BC	30" (750 mm)	---	2.75" (70 mm)

NOTE: ALL DIMENSIONS ARE NOMINAL

MC-SERIES END CAP INSERTION DETAIL

NTS

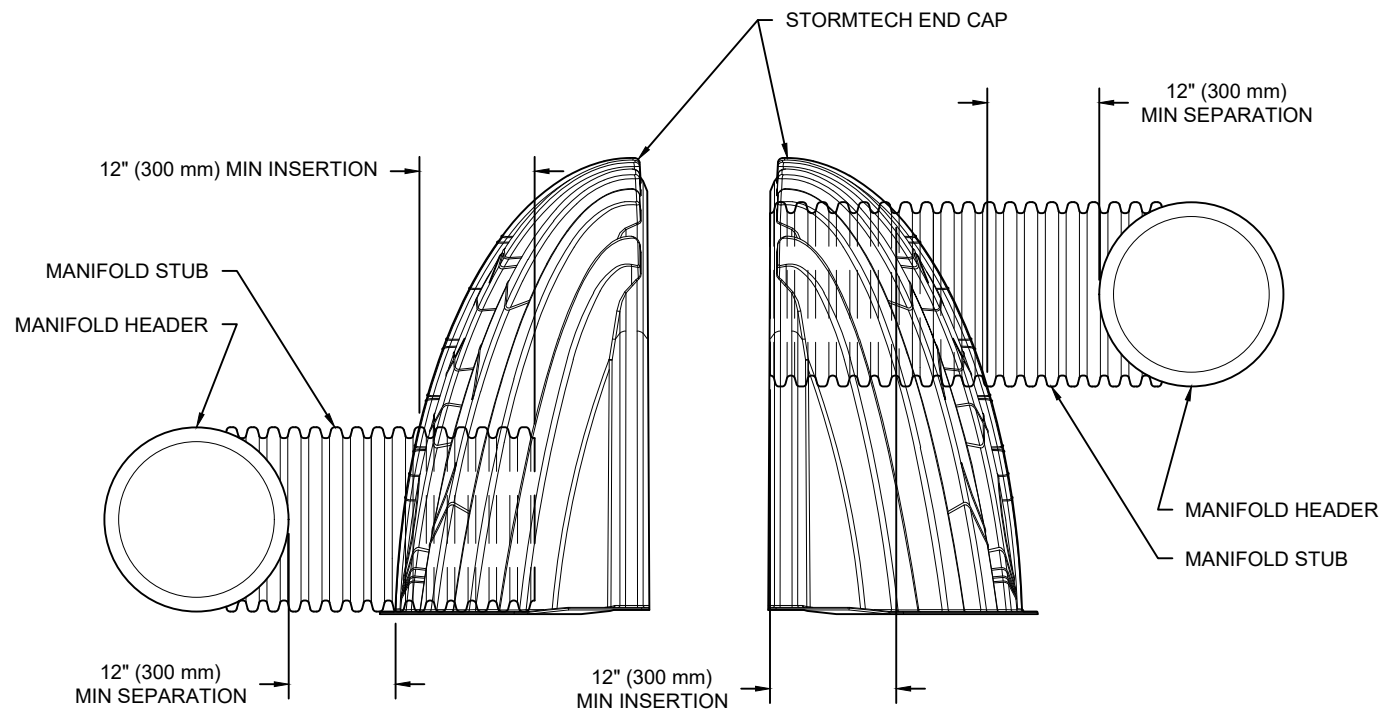

NOTE: MANIFOLD STUB MUST BE LAID HORIZONTAL FOR A PROPER FIT IN END CAP OPENING.

CUSTOM PRECORED INVERTS ARE AVAILABLE UPON REQUEST. INVENTORIED MANIFOLDS INCLUDE 12-24" (300-600 mm) SIZE ON SIZE AND 15-48" (375-1200 mm) ECCENTRIC MANIFOLDS. CUSTOM INVERT LOCATIONS ON THE MC-3500 END CAP CUT IN THE FIELD ARE NOT RECOMMENDED FOR PIPE SIZES GREATER THAN 10" (250 mm). THE INVERT LOCATION IN COLUMN 'B' ARE THE HIGHEST POSSIBLE FOR THE PIPE SIZE.

210216 - 6001-6005 RENAUD

OTTAWA, ON, CANADA

DATE:

DRAWN: KH

PROJECT #:

CHECKED: N/A

NO.	DESCRIPTION	DATE	DRW	CHK

StormTech®
Chamber System

888-892-2694 | WWW.STORMTECH.COM

4640 TRUEMAN BLVD
HILLIARD, OH 43026
1-800-733-7473




SHEET

5 OF 6

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

NYLOPLAST DRAIN BASIN

NTS

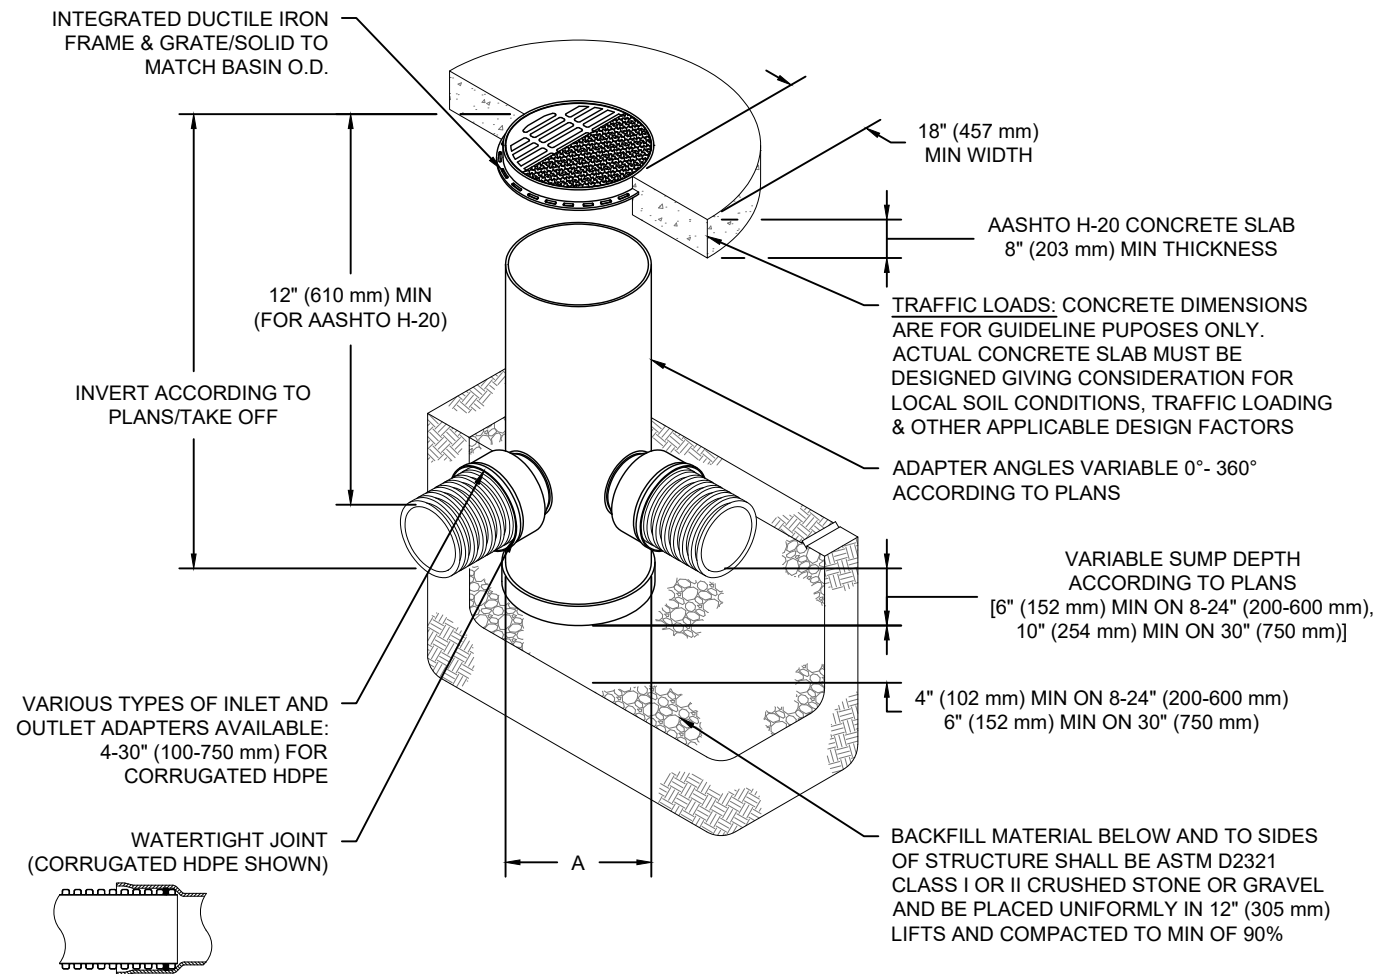

NOTES

- 8-30" (200-750 mm) GRATES/SOLID COVERS SHALL BE DUCTILE IRON PER ASTM A536 GRADE 70-50-05
- 12-30" (300-750 mm) FRAMES SHALL BE DUCTILE IRON PER ASTM A536 GRADE 70-50-05
- DRAIN BASIN TO BE CUSTOM MANUFACTURED ACCORDING TO PLAN DETAILS
- DRAINAGE CONNECTION STUB JOINT TIGHTNESS SHALL CONFORM TO ASTM D3212 FOR CORRUGATED HDPE (ADS & HANCOR DUAL WALL) & SDR 35 PVC
- FOR COMPLETE DESIGN AND PRODUCT INFORMATION: WWW.NYLOPLAST-US.COM
- TO ORDER CALL: 800-821-6710

A	PART #	GRATE/SOLID COVER OPTIONS		
8" (200 mm)	2808AG	PEDESTRIAN LIGHT DUTY	STANDARD LIGHT DUTY	SOLID LIGHT DUTY
10" (250 mm)	2810AG	PEDESTRIAN LIGHT DUTY	STANDARD LIGHT DUTY	SOLID LIGHT DUTY
12" (300 mm)	2812AG	PEDESTRIAN AASHTO H-10	STANDARD AASHTO H-20	SOLID AASHTO H-20
15" (375 mm)	2815AG	PEDESTRIAN AASHTO H-10	STANDARD AASHTO H-20	SOLID AASHTO H-20
18" (450 mm)	2818AG	PEDESTRIAN AASHTO H-10	STANDARD AASHTO H-20	SOLID AASHTO H-20
24" (600 mm)	2824AG	PEDESTRIAN AASHTO H-10	STANDARD AASHTO H-20	SOLID AASHTO H-20
30" (750 mm)	2830AG	PEDESTRIAN AASHTO H-20	STANDARD AASHTO H-20	SOLID AASHTO H-20

210216 - 6001-6005 RENAUD

OTTAWA, ON, CANADA

DATE:

DRAWN: KH

CHECKED: N/A

PROJECT #:

DESCRIPTION

CHK

DRW

DATE

DATE

DATE

DATE

DATE

DATE

DATE

DATE

DATE

DATE

DATE

DATE

DATE

DATE

DATE

DATE

DATE

DATE

DATE

Nyloplast[®]

4640 TRUEMAN BLVD
HILLIARD, OH 43026
1-800-733-7473



SHEET
6 OF 6

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.



PROP. 69.6m - 150mmØ PVC-DR28 SAN SERVICE @ 1.50% SLOPE

PROP. NYLOPLAST FD-4HC
T/G = 74.53
SE INV = 71.84
(OR APPROVED EQUIVALENT)

PROP. STM CBMH04
COVER AS PER S28.1
T/G = 74.45
NE INV = 71.77
SW INV = 71.80
NW INV = 71.77

PROPOSED PROPERTY LINE

PROP. 121.5m - 150mmØ WATERMAIN TO BE BURIED MIN. 2.4m BELOW GRADE

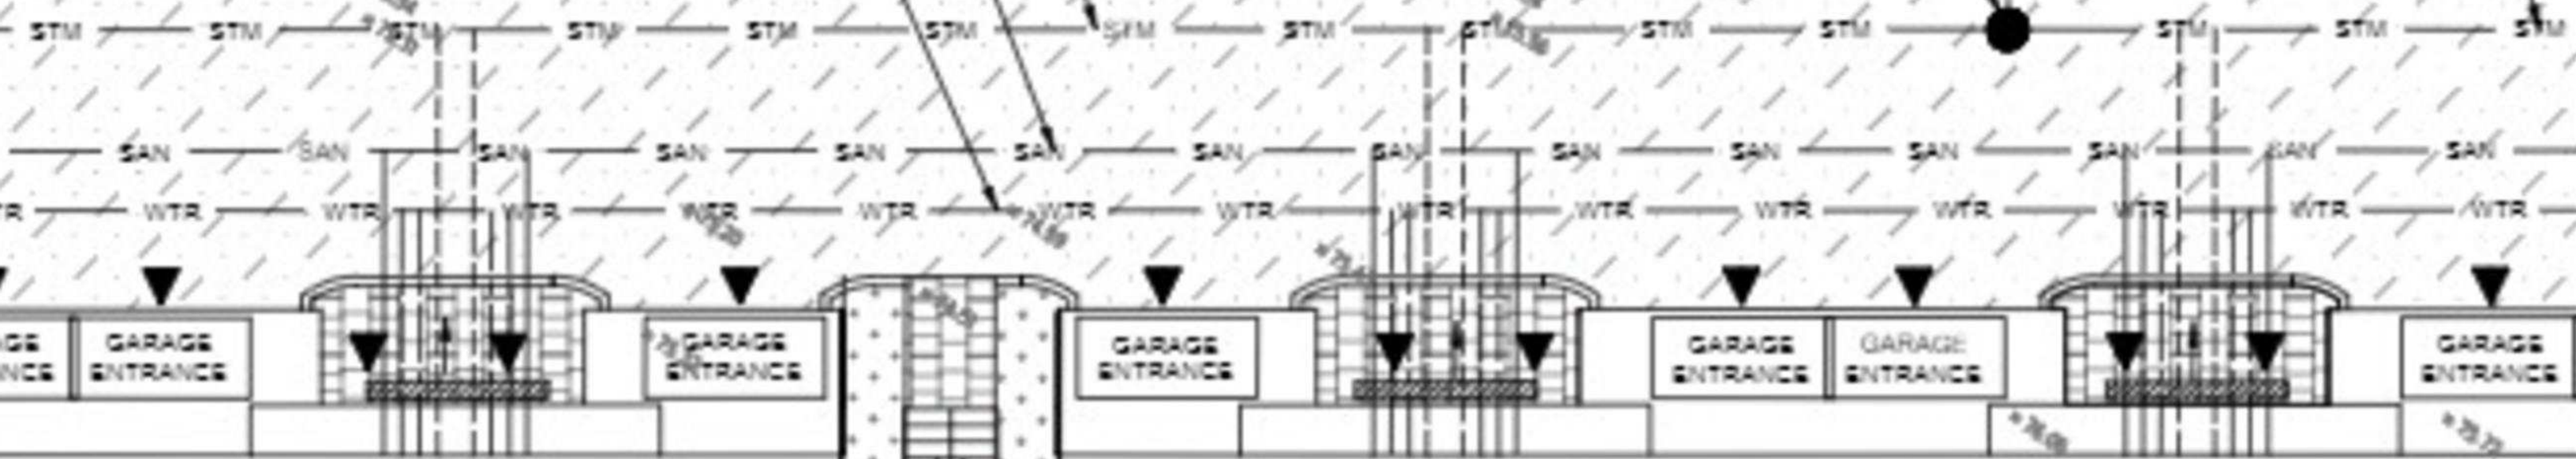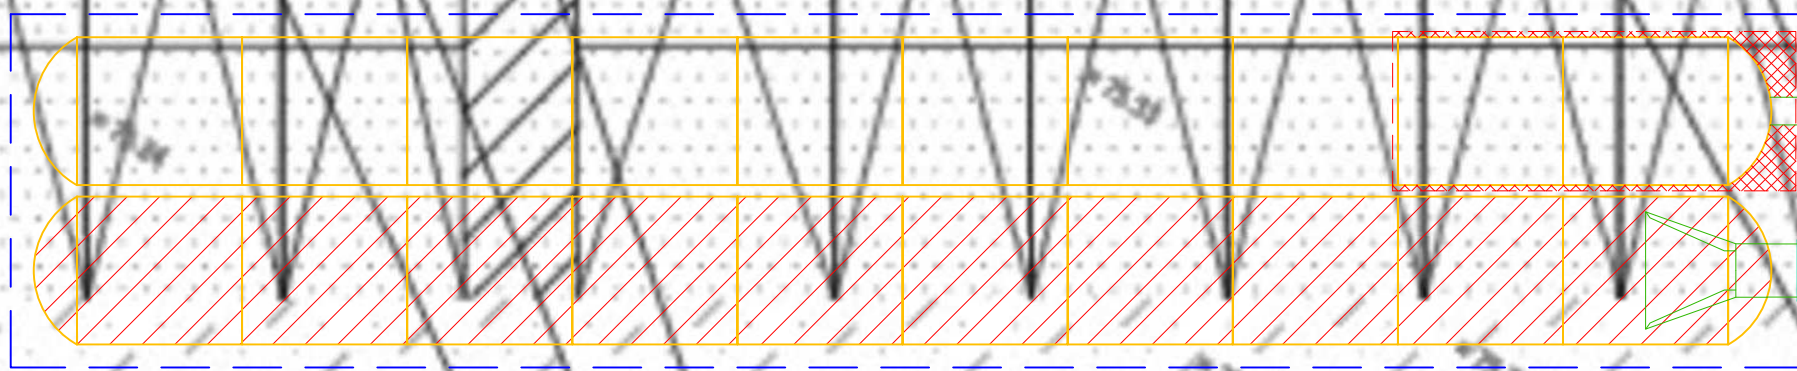

77.75
74.90
72.93
73.13

GROUND F.F.E. = 77.75
BASEMENT F.F.E. = 74.90
NORTH U.S.F. = 72.93
SOUTH U.S.F. = 73.13

FlexStorm Catch-It™

Inlet Filters

FlexStorm Catch-It inlet filters are the temporary and reusable solution for storm sewer inlet protection. They comply with ASTM D8057 and are the preferred choice for storm water runoff control. FlexStorm Catch-It inlet filters are configured to fit any drainage structure, are equipped with a high-efficiency filter bag and allow builders to keep their job sites SWPPP compliant during construction.

Applications

- Residential developments
- Commercial developments
- Roadway construction

Features

- Configured to fit any storm drainage structure
- Geotextile bag is easily replaced
- Bypass feature allows streets to drain if bag is full
- Installs quickly, easy maintenance

Benefits

- Prevents hazardous road conditions by eliminating ponding at curb inlets
- Prevents pollution of rivers, lakes and ponds
- Reduces job site flooding
- Significantly reduces clean-up costs



FlexStorm Catch-It Inlet Filters Specification

Material and Performance

The filter is comprised of a corrosion resistant steel frame and a replaceable geotextile filter bag attached to the frame with a stainless steel locking band. The filter bag hangs suspended below the grate that shall allow full water flow into the drainage structure if the bag is completely filled with sediment. The standard woven "FX" filter bags are rated for 200 gpm/sqft with a removal efficiency of 82% when filtering a USDA Sandy Loam sediment load. The filters are certified to meet ASTM D8057.

Installation

1. Remove the grate from the inlet.
2. Clean debris from the ledges of the inlet.
3. Place the inlet filter onto the load bearing ledges of the structure.
4. Replace the grate and confirm it is not elevated more than 1/8" (3 mm).

Frequency of Inspections

Inspection should occur every three months and following rain events greater than 1/2" (13 mm). Sites with greater runoff conditions may need to be inspected more frequently.

Maintenance Guidelines

1. Empty the filter bag manually or by industrial vacuum taking care not to damage the geotextile bag when more than half filled or during scheduled inspection period.
2. Remove compacted silt from sediment bag and flush with medium spray.
3. Inspect and replace bag if torn or punctured.

Filter Bag Replacement




1. Remove the bag by loosening or cutting off clamping band.
2. Take the new, correctly sized sediment bag and secure hose clamping band to the frame channel as previously removed.
3. Ensure bag is secure and there is no slack around perimeter.

Build America, Buy America (BABA)

ADS FlexStorm Catch-It Inlet Filter is manufactured for temporary use during construction and therefore is not subject to the requirements of the Build America, Buy America (BABA) Act.



ADS FLEXSTORM CATCH-IT INLET FILTERS

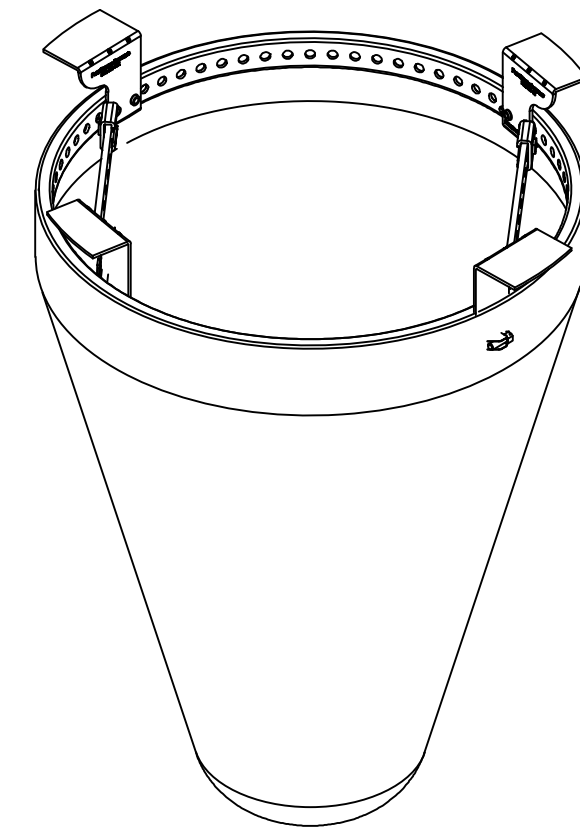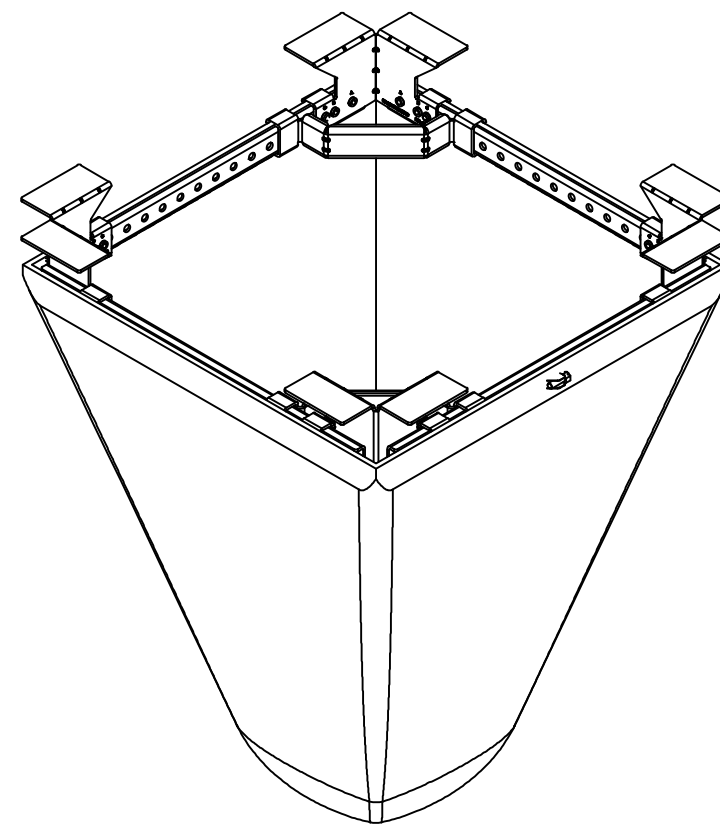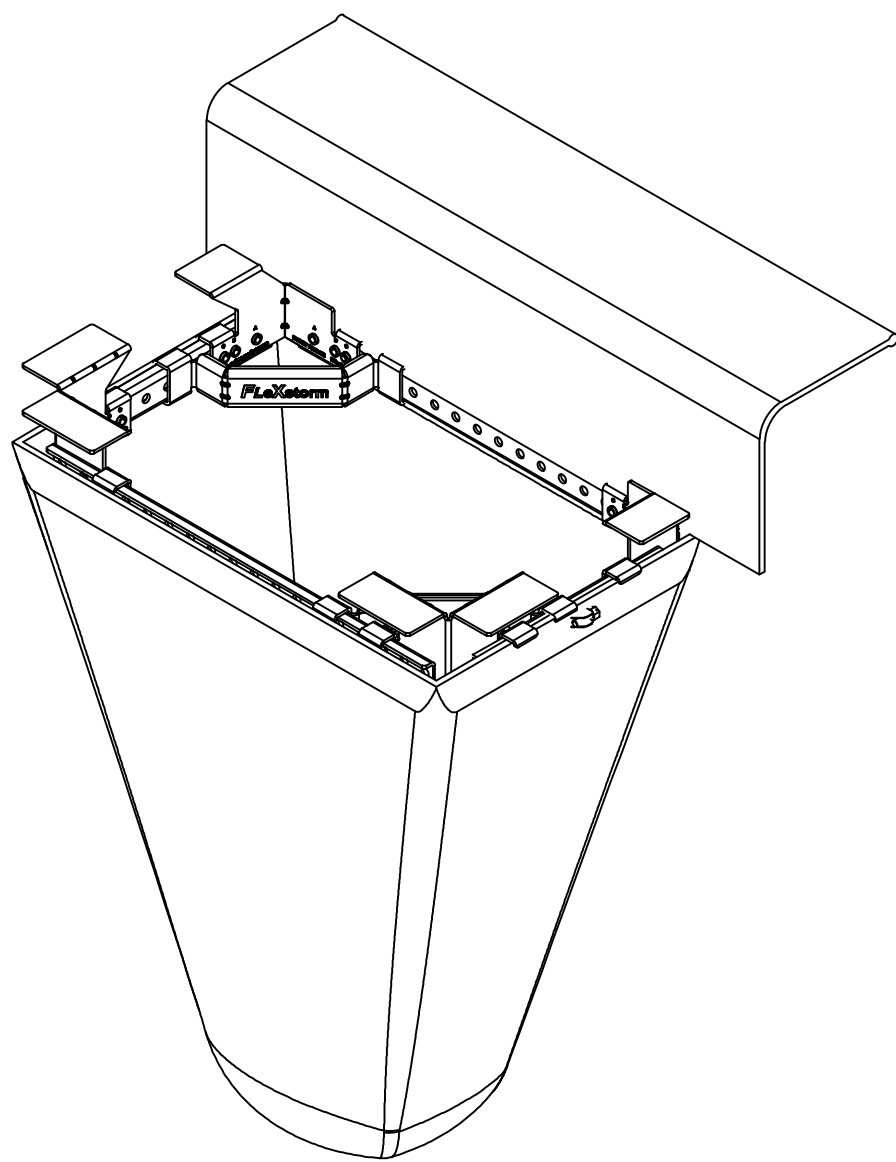

SQUARE/RECTANGULAR CURB INLET FILTER		
Clear Opening Size	Style P/N	Minimum Bypass Flow Rate (CFS)
Small: Up to 64" Perimeter	62SCBFX	2.4
Medium: 65" - 96" Perimeter	62MCBFX	3.5
Large: 97" - 120" Perimeter	62LCBFX	5.0
Extra-Large: 121" or Greater Perimeter	62XLCBFX	7.2

SQUARE/RECTANGULAR INLET FILTER		
Clear Opening Size	Style P/N	Minimum Bypass Flow Rate (CFS)
Small: Up to 64" Perimeter	62SSQFX	2.4
Medium: 65" - 96" Perimeter	62MSQFX	3.5
Large: 97" - 120" Perimeter	62LSQFX	5.0
Extra-Large: 121" or Greater Perimeter	62XLSQFX	7.2


ROUND INLET FILTER		
Clear Opening Size	Style P/N	Minimum Bypass Flow Rate (CFS)
Small: 10" - 16" Dia.	62SRDFX	1.6
Medium: 17" - 24" Dia.	62MRDFX	2.7
Large: 25" - 36" Dia.	62LRDFX	3.8

SPECIFICATIONS BY NOMINAL SIZE RANGE (MIN. VALUES)			
Nominal Bag Size	Solids Storage (CuFt)	Flow Rate (CFS)*	TSS Removal Rate
Small	1.6	1.2	82%; Large scale 3rd party testing per ASTM D 7351
Medium	2.1	1.7	using 7% concentration
Large	3.8	2.7	USDA Sandy Loam
Extra Large	4.2	3.6	

*Filter bag at 50% max solids storage capacity

INSTALLATION INSTRUCTIONS:

1. REMOVE GRATE
2. CLEAN GRATE LEDGE
3. SET INLET FILTER ON LOAD BEARING LEDGE OF STRUCTURE
4. REPLACE GRATE

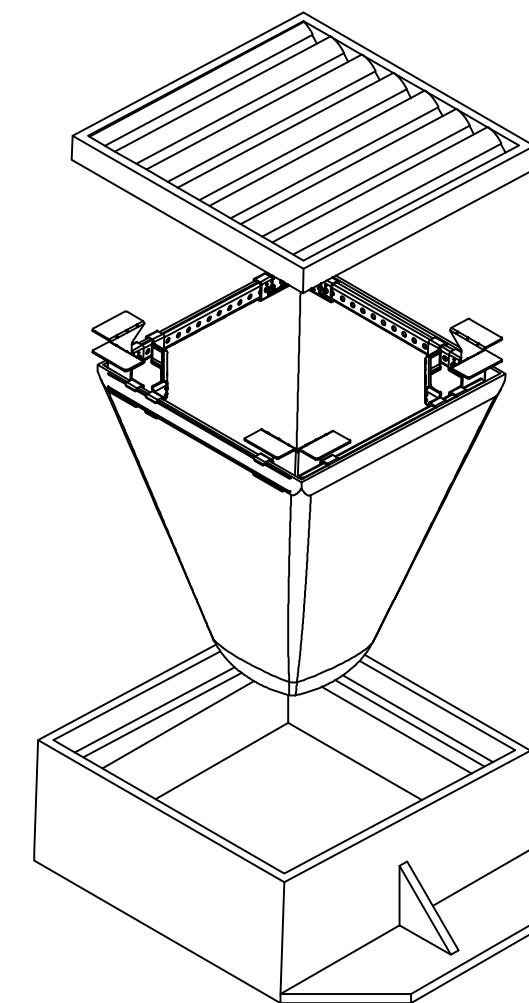

NOTES:

1. ALL FRAMING IS CONSTRUCTED OF G90 GALVANIZED STEEL.
2. TOTAL BYPASS CAPACITY WILL VARY WITH EACH SIZE DRAINAGE STRUCTURE. ADS DESIGNS FRAMING BYPASS TO MEET OR EXCEED THE DESIGN FLOW OF THE PARTICULAR DRAINAGE STRUCTURE.
3. UPON ORDERING, CONFIRMATION OF THE INLET SPECIFICATION, PRECAST/FOUNDRY CASTING MAKE AND MODEL, OR DETAILED DIMENSIONAL FORMS MUST BE PROVIDED TO CONFIGURE AND ASSEMBLE AN INLET FILTER.
4. ALL FILTERS MEET ASTM D8057 SPECIFICATIONS.
5. FOR WRITTEN SPECIFICATIONS AND MAINTENANCE GUIDELINES VISIT WWW.ADPIPE.COM.






ALL PRODUCTS MANUFACTURED
BY ADVANCED DRAINAGE SYSTEMS
WWW.ADPIPE.COM
PH. 1-800-821-6710



SIZE	DATE	DWG NO	REV
C	02/06/2023	ADS FLEXSTORM CATCH-IT	A
SCALE	N/A	SHEET 1 OF 1	



SUBJECT SITE

-  FUTURE ROADS
-  AREAS WHERE FLOW IS DIVERTED TO ADJACENT SUB-WATERSHED
-  DRY POND WHICH REQUIRES EXCAVATION
-  DRY POND USING NATURAL DEPRESSIONS / RAVINES
-  STORMWATER FLOW ROUTE
-  POND TRIBUTARY AREA
-  SUB-WATERSHED BOUNDARY

PLAN IS TAKEN FROM THE CITY OF GLOUCESTER, EAST URBAN COMMUNITY, MASTER DRAINAGE PLAN BY GORE & STORRIE LIMITED, DATED SEPT. 1991.

RECOMMENDED SWM POND LOCATIONS EAST URBAN COMMUNITY City of Ottawa

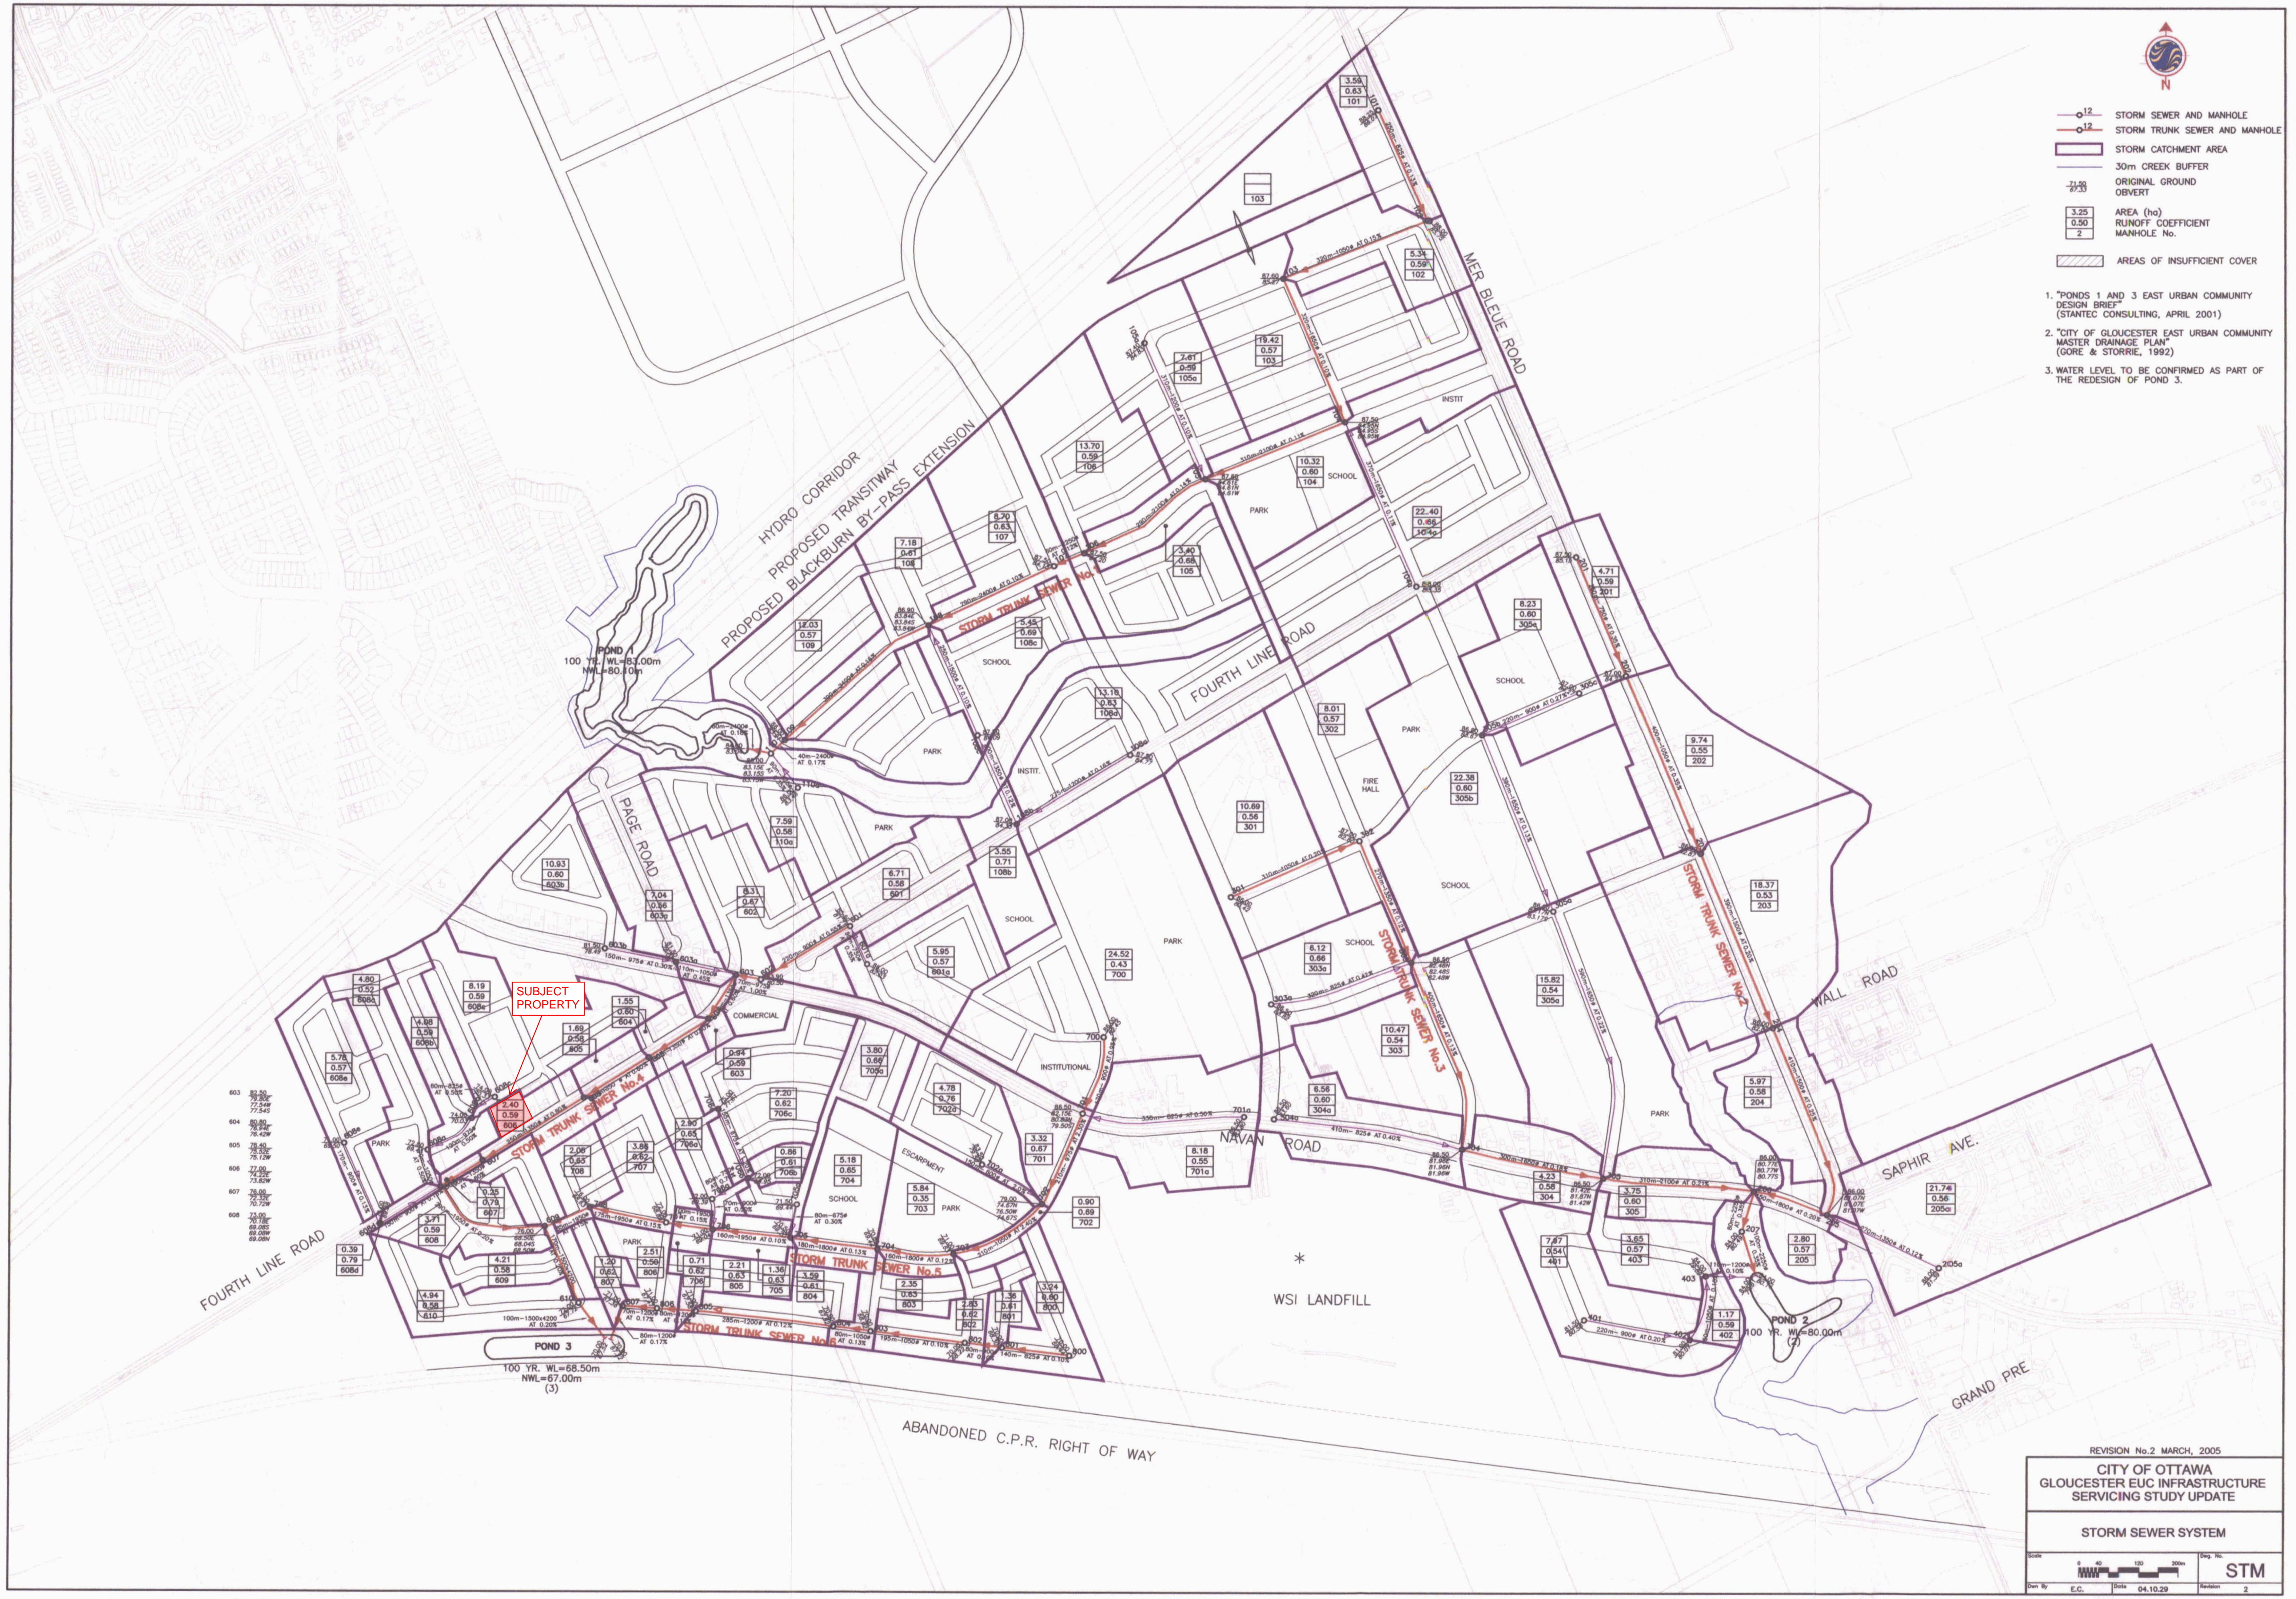


Figure 6



- STORM SEWER AND MANHOLE
- STORM TRUNK SEWER AND MANHOLE
- STORM CATCHMENT AREA
- 30m CREEK BUFFER
- ORIGINAL GROUND OBVERT
- AREA (ha)
RUNOFF COEFFICIENT
MANHOLE No.
- AREAS OF INSUFFICIENT COVER


1. "PONDS 1 AND 3 EAST URBAN COMMUNITY DESIGN BRIEF" (STANTEC CONSULTING, APRIL 2001)
2. "CITY OF GLOUCESTER EAST URBAN COMMUNITY MASTER DRAINAGE PLAN" (GORE & STORRIE, 1992)
3. WATER LEVEL TO BE CONFIRMED AS PART OF THE REDESIGN OF POND 3.



REVISION No.2 MARCH, 2005

CITY OF OTTAWA
GLOUCESTER EUC INFRASTRUCTURE
SERVICING STUDY UPDATE

STORM SEWER SYSTEM

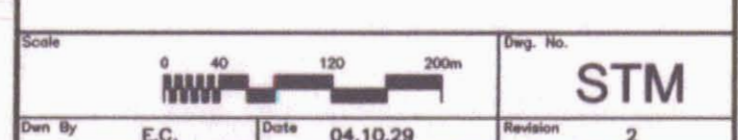

Drawn By: E.C. Date: 04.10.29 Revision: 2

STORM SEWER CALCULATION SHEET (RATIONAL METHOD) - POND 3

Manning's 0.013

Return Frequency = 5 years

From Node	To Node	AREA (Ha)							FLOW				SEWER DATA										Upstream OG	Downstream OG	Upstream Invert	Upstream Obvert	Downstream Invert	Downstream Obvert	Drop Structure	US Frost Depth	DS Frost Depth
		R=0.3	R=0.5	R=0.55	R=0.6	R=0.75	R=0.79	R=0.82	Indiv. 2.78 AC	Accum. 2.78 AC	Time of Conc.	Rainfall Intensity	Peak Flow Q (l/s)	DIA. (m) (actual)	DIA. (mm) (nominal)	TYPE	SLOPE (m/m)	LENGTH (m)	CAPACITY (l/s)	VELOCITY (m/s)	TIME OF FLOW (min.)	RATIO Q/Q full									
601A	601	0.00	4.45	0.00	0.00	0.00	1.50	0.00	9.48	9.48	21.00	68.13	645.86	0.76	750	CONC	0.0035	90	687.1	1.5	1.00	0.94	86.00	85.50	81.27	82.03	80.95	81.71		3.97	3.79
601	602	0.00	4.91	0.00	0.00	0.00	1.80	0.00	10.78	20.26	22.00	66.15	1340.16	0.91	900	CONC	0.0055	220	1400.6	2.1	1.72	0.96	85.50	83.90	80.80	81.71	79.59	80.50		3.79	3.40
602	603	0.00	0.66	3.50	0.00	0.97	1.43	1.75	15.42	35.68	23.71	63.03	2248.78	0.99	975	CONC	0.01	70	2338.0	3.0	0.38	0.96	83.90	82.50	79.51	80.50	78.81	79.80	2.26	3.40	2.70
603B	603A	0.00	4.42	3.47	0.00	0.00	1.24	1.80	18.28	18.28	22.00	66.15	1208.89	0.99	975	CONC	0.003	150	1280.5	1.7	1.50	0.94	81.50	81.50	77.50	78.49	77.05	78.04		3.01	3.46
603A	603	0.00	5.58	0.00	0.00	0.00	1.08	0.38	10.99	29.27	23.50	63.39	1855.51	1.07	1050	CONC	0.0045	110	1911.0	2.1	0.86	0.97	81.50	82.50	76.97	78.04	76.48	77.54		3.46	4.96
603	604	0.00	0.66	0.00	0.00	0.00	0.28	0.00	1.53	66.48	25.96	59.41	3949.46	1.37	1350	CONC	0.006	100	4313.1	2.9	0.57	0.92	82.50	80.80	76.17	77.54	75.57	76.94	0.52	4.96	3.86
604	605	0.00	1.03	0.00	0.00	0.00	0.52	0.00	2.57	69.06	26.53	58.56	4043.75	1.37	1350	CONC	0.006	150	4313.1	2.9	0.86	0.94	80.80	78.40	75.05	76.42	74.15	75.52	0.40	4.38	2.88
605	606	0.00	0.89	0.41	0.00	0.00	0.39	0.00	2.72	71.78	27.39	57.33	4115.22	1.37	1350	CONC	0.006	150	4313.1	2.9	0.86	0.95	78.40	77.00	73.75	75.12	72.85	74.22	0.40	3.28	2.78
606	607	0.00	1.66	0.00	0.00	0.00	0.74	0.00	3.93	75.71	28.24	56.17	4252.25	1.37	1350	CONC	0.006	250	4313.1	2.9	1.43	0.99	77.00	76.00	72.45	73.82	70.95	72.32	1.60	3.18	3.68
607	608	0.00	0.00	0.00	0.00	0.00	0.25	0.00	0.55	76.26	29.67	54.33	4143.26	1.37	1350	CONC	0.006	90	4313.1	2.9	0.51	0.96	76.00	73.00	69.35	70.72	68.81	70.18	1.10	5.28	2.82
608E	608D	0.41	3.79	0.00	0.00	0.00	1.58	0.00	9.08	9.08	20.00	70.25	637.88	0.91	900	CONC	0.0013	170	680.9	1.0	2.73	0.94	71.00	71.00	68.59	69.50	68.36	69.28		1.50	1.72
608D	608	0.00	0.00	0.00	0.00	0.00	0.39	0.00	0.86	9.94	22.73	64.77	643.62	0.91	900	CONC	0.0013	150	680.9	1.0	2.41	0.95	71.00	73.00	68.36	69.28	68.17	69.08		1.72	3.92
608C	608B	0.00	2.57	3.82	0.00	0.00	1.80	0.00	13.37	13.37	19.00	72.53	969.39	0.84	825	CONC	0.005	60	1058.9	1.9	0.52	0.92	74.00	74.00	69.50	70.33	69.20	70.03		3.67	3.97
608B	608A	0.00	3.12	0.00	0.00	0.00	0.96	0.00	6.45	19.81	19.52	71.32	1412.95	0.99	975	CONC	0.005	120	1653.2	2.1	0.93	0.85	74.00	72.80	69.04	70.03	68.44	69.43		3.97	3.37
608A	608	1.26	2.29	0.00	0.00	0.00	1.25	0.00	6.98	26.79	20.45	69.27	1855.82	1.07	1050	CONC	0.005	70	2014.4	2.3	0.52	0.92	72.80	73.00	68.37	69.43	68.02	69.08		3.37	3.92
608	609	0.00	2.60	0.00	0.00	0.00	1.11	0.00	6.05	119.04	30.18	53.70	6392.78	1.98	1950	CONC	0.002	290	6638.9	2.2	2.24	0.96	73.00	76.00	67.10	69.08	66.52	68.50	0.46	3.92	7.50
700	701	16.26	2.78	0.00	0.00	1.39	4.09	0.00	29.31	29.31	25.00	60.90	1784.60	0.91	900	CONC	0.0095	170	1840.8	2.8	1.01	0.97	86.00	86.50	81.53	82.45	79.92	80.83	1.33	3.56	5.67
701A	701	0.00	6.89	0.00	0.00	0.00	0.00	1.29	12.52	12.52	15.00	83.56	1045.95	0.84	825	CONC	0.005	330	1058.9	1.9	2.87	0.99	86.50	86.50	82.95	83.80	81.31	82.15	2.65	2.70	4.35
701	702	0.00	1.56	0.00	0.00	0.00	0.46	1.30	6.14	47.97	26.01	59.33	2845.74	0.99	975	CONC	0.023	210	3545.7	4.6	0.76	0.80	86.50	79.00	78.51	79.50	73.68	74.67		7.00	4.33
702A	702	0.00	0.00	0.00	0.00	3.11	1.67	0.00	10.15	10.15	20.00	70.25	713.19	0.61	600	CONC	0.02	150	905.9	3.1	0.81	0.79	83.50	79.00	78.89	79.50	75.89	76.50	1.83	4.00	2.50
702	703	0.00	0.00	0.36	0.00	0.00	0.54	0.00	1.74	59.85	26.77	58.21	3483.92	1.07	1050	CONC	0.024	210	4413.3	4.9	0.71	0.79	79.00	71.00	73.60	74.67	68.56	69.63		4.33	1.37
703	704	5.02	0.00	0.41	0.00	0.00	0.41	0.00	5.71	65.57	27.48	57.20	3750.72	1.83	1800	CONC	0.0012	160	4154.1	1.6	1.69	0.90	71.00	70.80	67.80	69.63	67.61	69.44		1.37	1.36
704	705	0.99	0.00	0.55	0.00	3.19	0.45	0.00	9.31	74.87	29.17	54.96	4115.38	1.83	1800	CONC	0.0013	180	4323.7	1.6	1.82	0.95	70.80	70.50	67.61	69.44	67.38	69.20		1.36	1.30
705A	705	0.00	0.00	2.06	0.00	0.00	1.74	0.00	6.97	6.97	23.00	64.29	448.15	0.69	675	CONC	0.003	80	480.3	1.3	1.03	0.93	71.50	70.50	68.76	69.44	68.52	69.20		2.06	1.30
705	706	0.00	0.00	0.92	0.00	0.00	0.44	0.00	2.37	84.22	30.89	52.75	4442.71	1.98	1950	CONC	0.001	160	4694.4	1.5	1.75	0.95	70.50	71.00	67.22	69.20	67.06	69.04		1.30	1.96
706C	706B	0.00	0.00	5.20	0.00	0.00	2.00	0.00	12.34	12.34	21.00	68.13	840.94	0.69	675	CONC	0.012	155	960.5	2.6	0.99	0.88	75.00	72.00	71.13	71.81	69.27	69.95		3.19	2.05
706B	706A	0.00	0.00	0.64	0.00	0.00	0.22	0.00	1.46	13.80	21.99	66.16	913.32	0.76	750	CONC	0.007	80	971.7	2.1	0.63	0.94	72.00	72.00	69.19	69.95	68.63	69.39		2.05	2.61
706A	706	0.00	0.00	1.74	0.00	0.00	1.16	0.00	5.21	19.01	22.62	64.98	1235.49	0.91	900	CONC	0.005	70	1335.4	2.0	0.57	0.93	72.00	71.00	68.48	69.39	68.13	69.04		2.61	1.96
706	707	0.00	0.00	0.50	0.00	0.00	0.21	0.00	1.23	104.46	32.74	50.81	5307.00	1.98	1950	CONC	0.0015	100	5749.5	1.9	0.89	0.92	71.00	72.00	67.06	69.04	66.91	68.89		1.96	3.11
707	708	0.00	0.00	2.66	0.00	0.00	1.20	0.00	6.70	111.16	33.63	49.87	5543.80	1.98	1950	CONC	0.0015	175	5749.5	1.9	1.56	0.96	72.00	76.00	66.91	68.89	66.65	68.63		3.11	7.37
708	609	0.00	0.00	1.38	0.00	0.00	0.67	0.00	3.58	114.74	35.20	48.33	5545.19	1.98	1950	CONC	0.0015	85	5749.5	1.9	0.76	0.96	76.00	76.00	66.65	68.63	66.52	68.50	0.46	7.37	7.50
609	610	0.00	3.00	0.00	0.00	0.00	1.21	0.00	6.83	240.60	35.96	47.62	11456.50	1.52	1500 x 4200	CONC	0.002	160	14595.0	2.3	1.15	0.78	76.00	72.00	66.52	68.04	66.20	67.72		7.96	4.28
610	Outlet	0.00	3.98	0.00	0.00	0.00	0.96	0.00	7.64	248.25	37.11	46.58	11563.06	1.52	1500 x 4200	CONC	0.002	100	14595.0	2.3	0.72	0.79	72.00	70.00	66.20	67.72	66.00	67.52		4.28	2.48
800	801	0.00	0.00	2.51	0.00	0.00	0.73	0.00	5.44	5.44	18.00	74.97	407.91	0.84	825	CONC	0.001	140	473.6	0.9	2.72	0.86	70.00	70.00	67.60	68.44	67.46	68.30		1.56	1.70
801	802	0.00	0.00	1.02	0.00	0.00	0.34	0.00	2.31	7.75	20.72	68.71	532.33	0.91	900	CONC	0.001	80	597.2	0.9	1.47	0.89	70.00	70.00	67.38	68.30	67.30	68.22		1.70	1.78
802	803	0.00	0.00	2.06	0.00	0.00	0.77	0.00	4.84	12.59	22.19	65.79																			




APPENDIX B**DESIGN CALCULATIONS**

- Storm Sewer Design Sheet (5-Year)
- Sanitary Sewer Design Sheet



STREET	FROM MH	TO MH	AREA (ha)	RUNOFF COEFFICIENT "R"	'AR'	ACCUM. 'AR'	RAINFALL INTENSITY (mm/hr)	FLOW (m3/s)	CONSTANT FLOW (m3/s)	ACCUM. CONSTANT FLOW (m3/s)	TOTAL FLOW (m3/s)	LENGTH (m)	SLOPE (%)	PIPE DIAMETER (mm)	FULL FLOW CAPACITY (m3/s)	FULL FLOW VELOCITY (m/s)	INITIAL Tc (min)	TIME OF CONCENTRATION (min)	ACC. TIME OF CONCENTRATION (min)	PERCENT FULL (%)
STREET E																				
ST. E	MH 9	MH 10	0.27	0.71	0.19	3.66	90.8	0.924			0.924	90.0	1.00	750	1.113	2.52	12.95	0.60	13.54	83%
STREET C																				
ST. C	MH 11	MH 12	0.32	0.72	0.23	0.23	104.2	0.067			0.067	39.0	1.00	300	0.097	1.37	10.00	0.48	10.48	69%
ST. C	MH 12	MH 13				0.23	101.7	0.065			0.065	14.0	1.00	300	0.097	1.37	10.48	0.17	10.65	67%
ST. C	MH 13	MH 14	0.56	0.76	0.43	0.66	100.9	0.184			0.184	73.0	1.00	450	0.285	1.79	10.65	0.68	11.32	64%
STREET A																				
ST. A	MH 14	MH 15				0.66	97.7	0.178			0.178	20.0	1.00	450	0.285	1.79	11.32	0.19	11.51	62%
ST. A	MH 15	MH 16				0.66	96.8	0.176			0.176	42.0	1.00	450	0.285	1.79	11.51	0.39	11.90	62%
STREET B																				
ST. B	MH 18	MH 19	0.53	0.74	0.39	0.39	104.2	0.114			0.114	67.0	1.00	375	0.175	1.59	10.00	0.70	10.70	65%
ST. B	MH 19	MH 20	0.72	0.74	0.53	0.93	100.6	0.259			0.259	93.0	1.00	525	0.430	1.99	10.70	0.78	11.48	60%
ST. B	MH 20	MH 21				0.93	97.0	0.249			0.249	21.0	1.00	525	0.430	1.99	11.48	0.18	11.66	58%
EXTERNAL DRAINAGE 1	DICB 1	MH 21	1.09	0.70	0.76	0.76	104.2	0.221			0.221	31.0	0.50	525	0.304	1.40	10.00	0.37	10.37	73%
ST. B	MH 21	MH 22	0.35	0.74	0.26	1.95	96.2	0.520			0.520	60.0	1.00	600	0.614	2.17	11.66	0.46	12.12	85%
ST. B	MH 22	MH 16	0.50	0.74	0.37	2.32	94.2	0.606			0.606	69.0	1.00	675	0.841	2.35	12.12	0.49	12.61	72%
ST. B	MH 16	MH 23				2.97	92.2	0.761			0.761	10.0	1.00	750	1.113	2.52	12.61	0.07	12.68	68%
STREET A																				
ELBOW BLOCK	MH 23	EXDICB300				2.97	91.9	0.759			0.759	26.0	1.00	750	1.113	2.52	12.68	0.17	12.85	68%
ZIEGLER ST.																				

Urbantech Consulting, A Division of Leighton-Zec Ltd.
 3760 14th Avenue, Suite 301 Markham, Ontario L3R 3T7
 TEL: 905.946.9461 FAX: 905.946.9595
www.urbantech.com

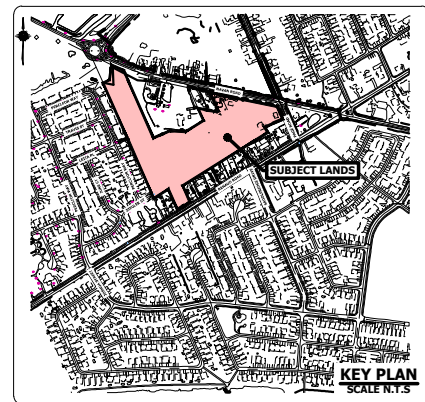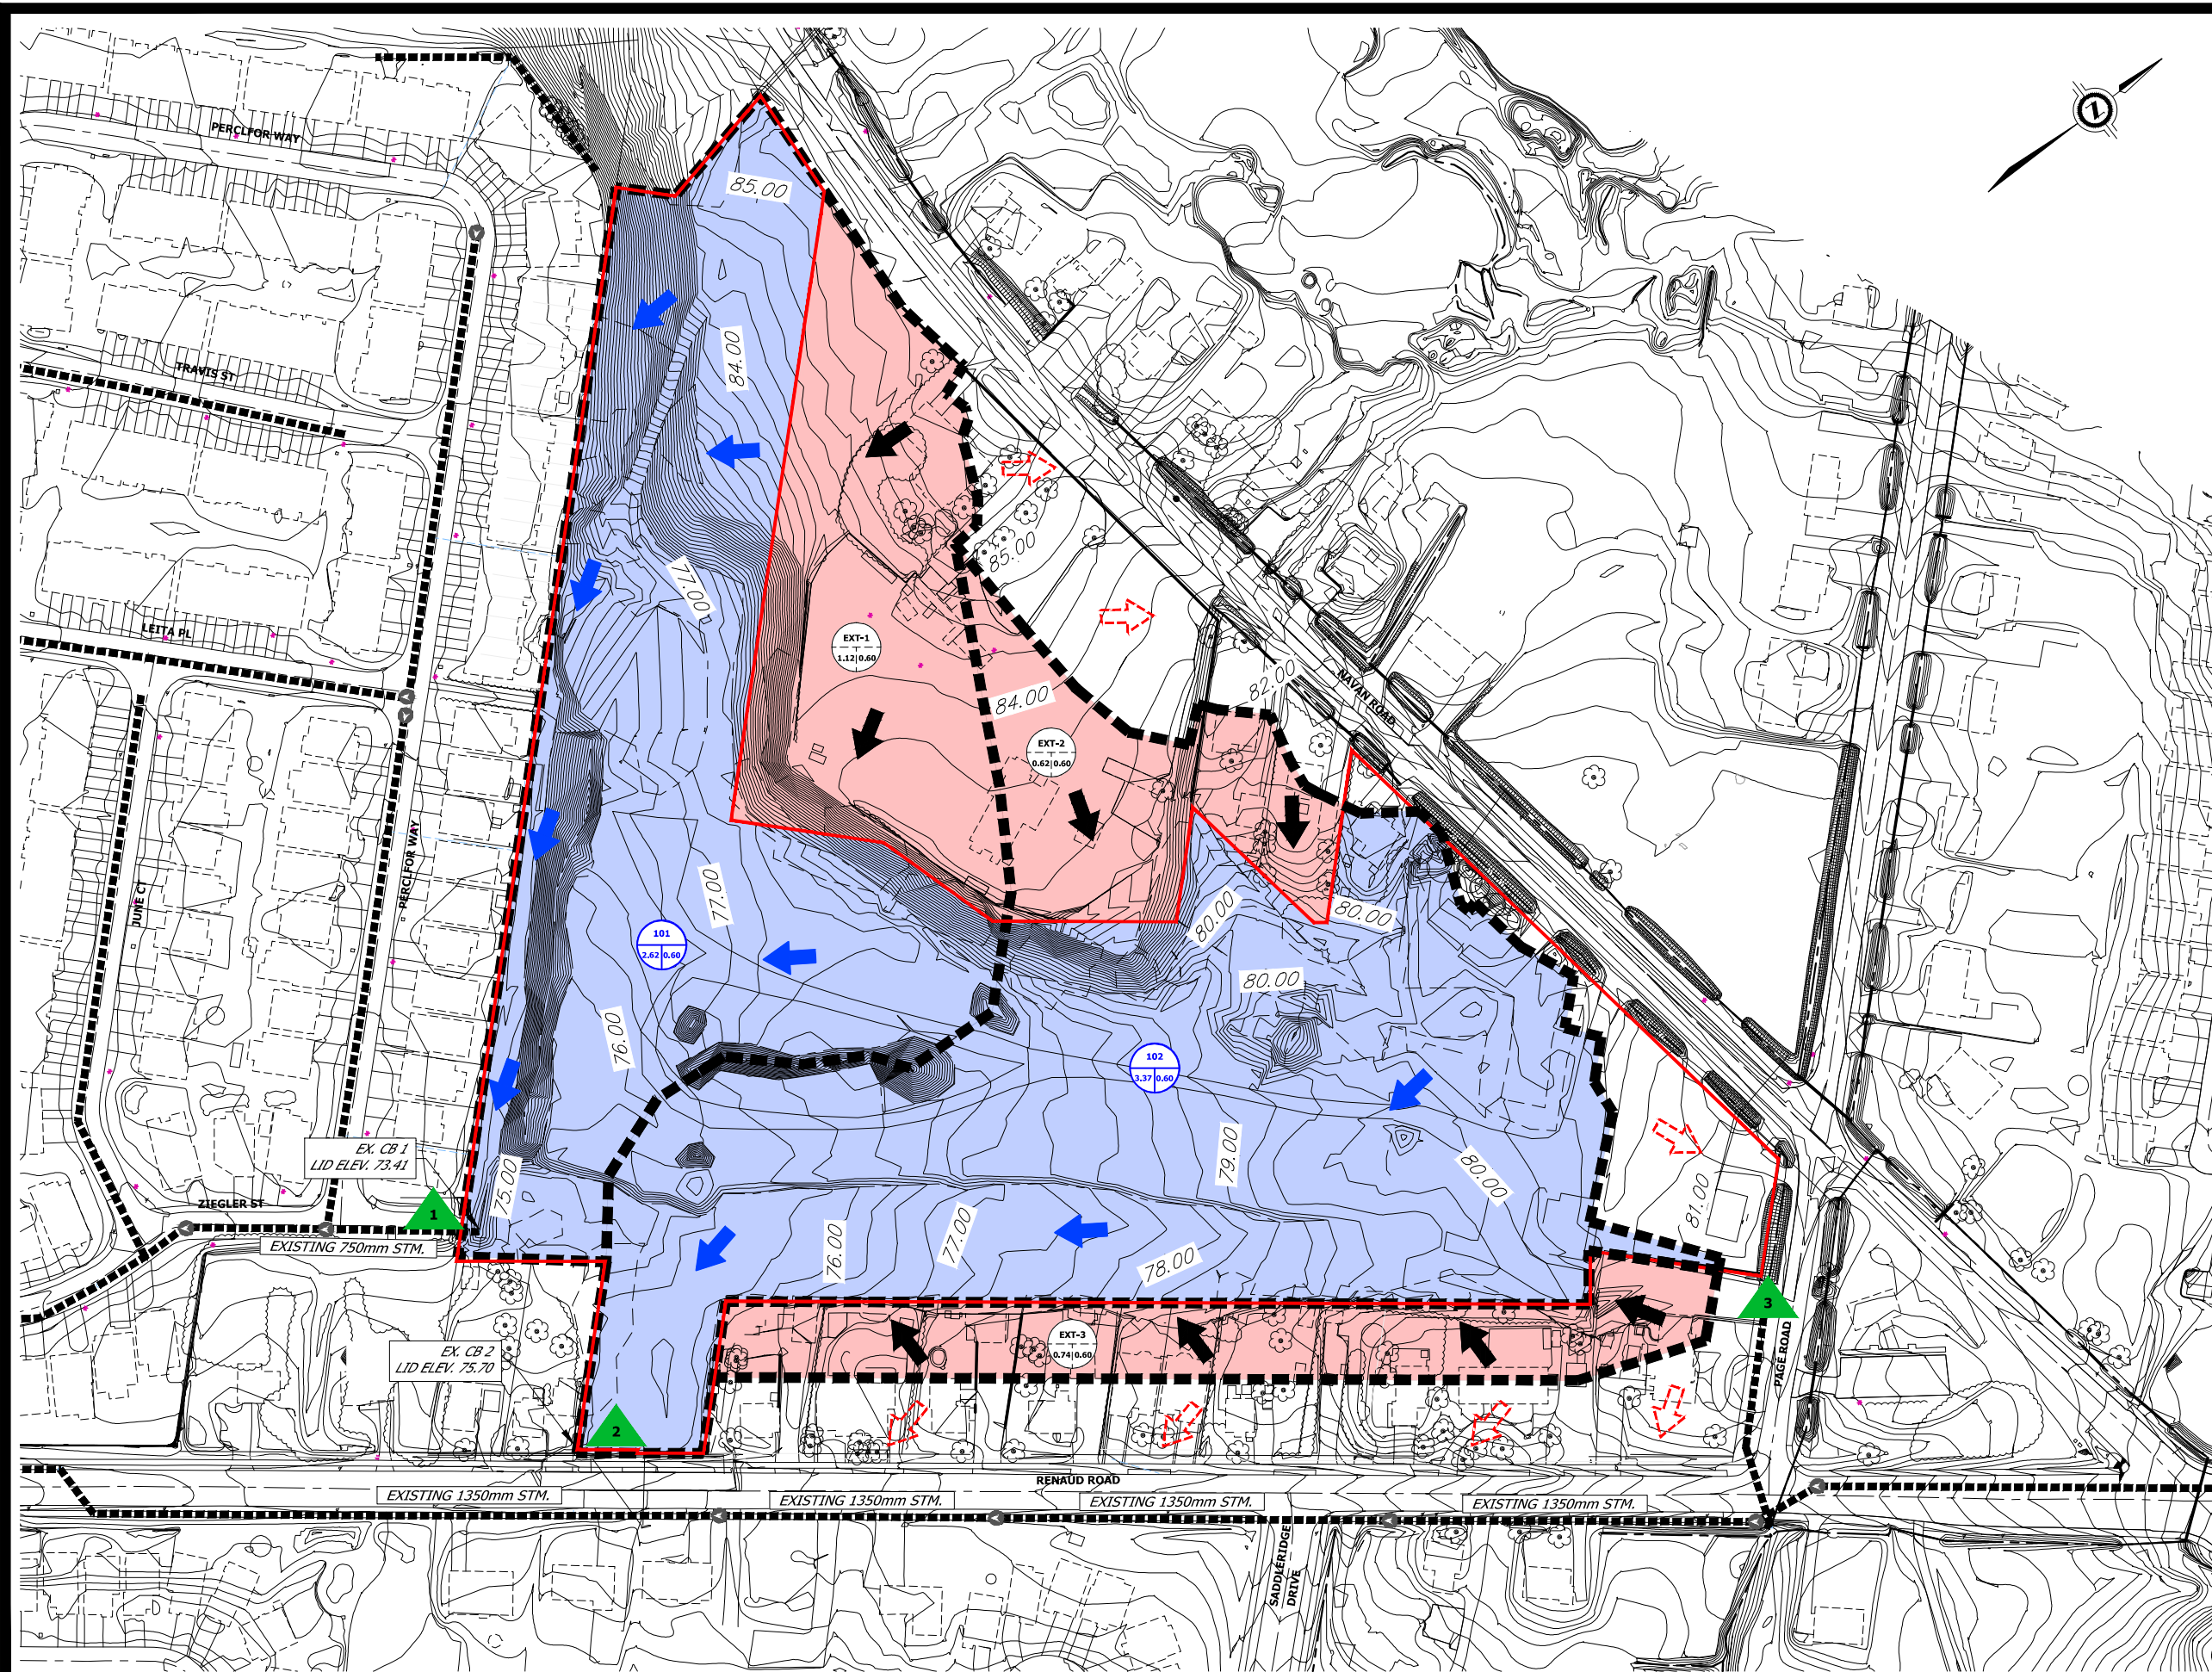

LEGEND

- SUBJECT PROPERTY
- EXISTING CONTOUR
- INTERNAL DRAINAGE AREA ID
- INTERNAL DRAINAGE AREA (ha)
- RUNOFF COEFFICIENT
- EXTERNAL DRAINAGE AREA ID
- EXTERNAL DRAINAGE AREA (ha)
- RUNOFF COEFFICIENT
- ▲ DRAINAGE OUTLET & ID
- EXISTING DRAINAGE BOUNDARY
- EXISTING INTERNAL DRAINAGE AREA
- EXISTING EXTERNAL DRAINAGE AREA FLOWING TOWARDS SITE
- ➔ EXISTING INTERNAL FLOW DIRECTION
- ➔ EXISTING EXTERNAL FLOW DIRECTION
- ➔ EXISTING FLOW DIRECTION FLOWING AWAY FROM SITE
- EXISTING STORM SEWER AND FLOW DIRECTION



Urbantech® Consulting
 A Division of Leighton-Zec Ltd.
 3750 14th Avenue, Suite 301,
 Markham, ON, L3R 3T7
 TEL 905.946.9461 • urbantech.com

Caivan Renaud Inc.
 CITY OF OTTAWA

PRE-DEVELOPMENT
 DRAINAGE PLAN

PROJECT No.	DATE	SCALE	FIGURE No.
20-647-O	DEC 2020	1:2000	3

File: T:\Projects\20-647-O-Caivan - Brazeau East\Reports\Functional Servicing Report\Drawings & Figures\20-647-O-STM-2_Existing Storm Drainage Plan.dwg - Revised by <RBAGHER> - Tue, Aug 11, 2020 - 9:43am

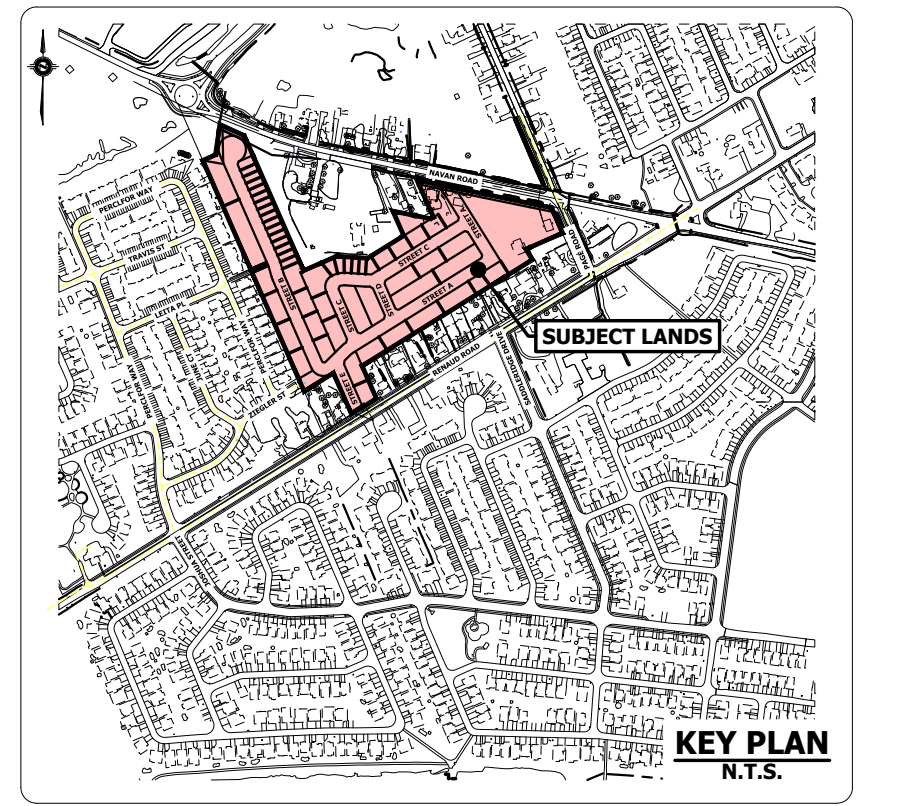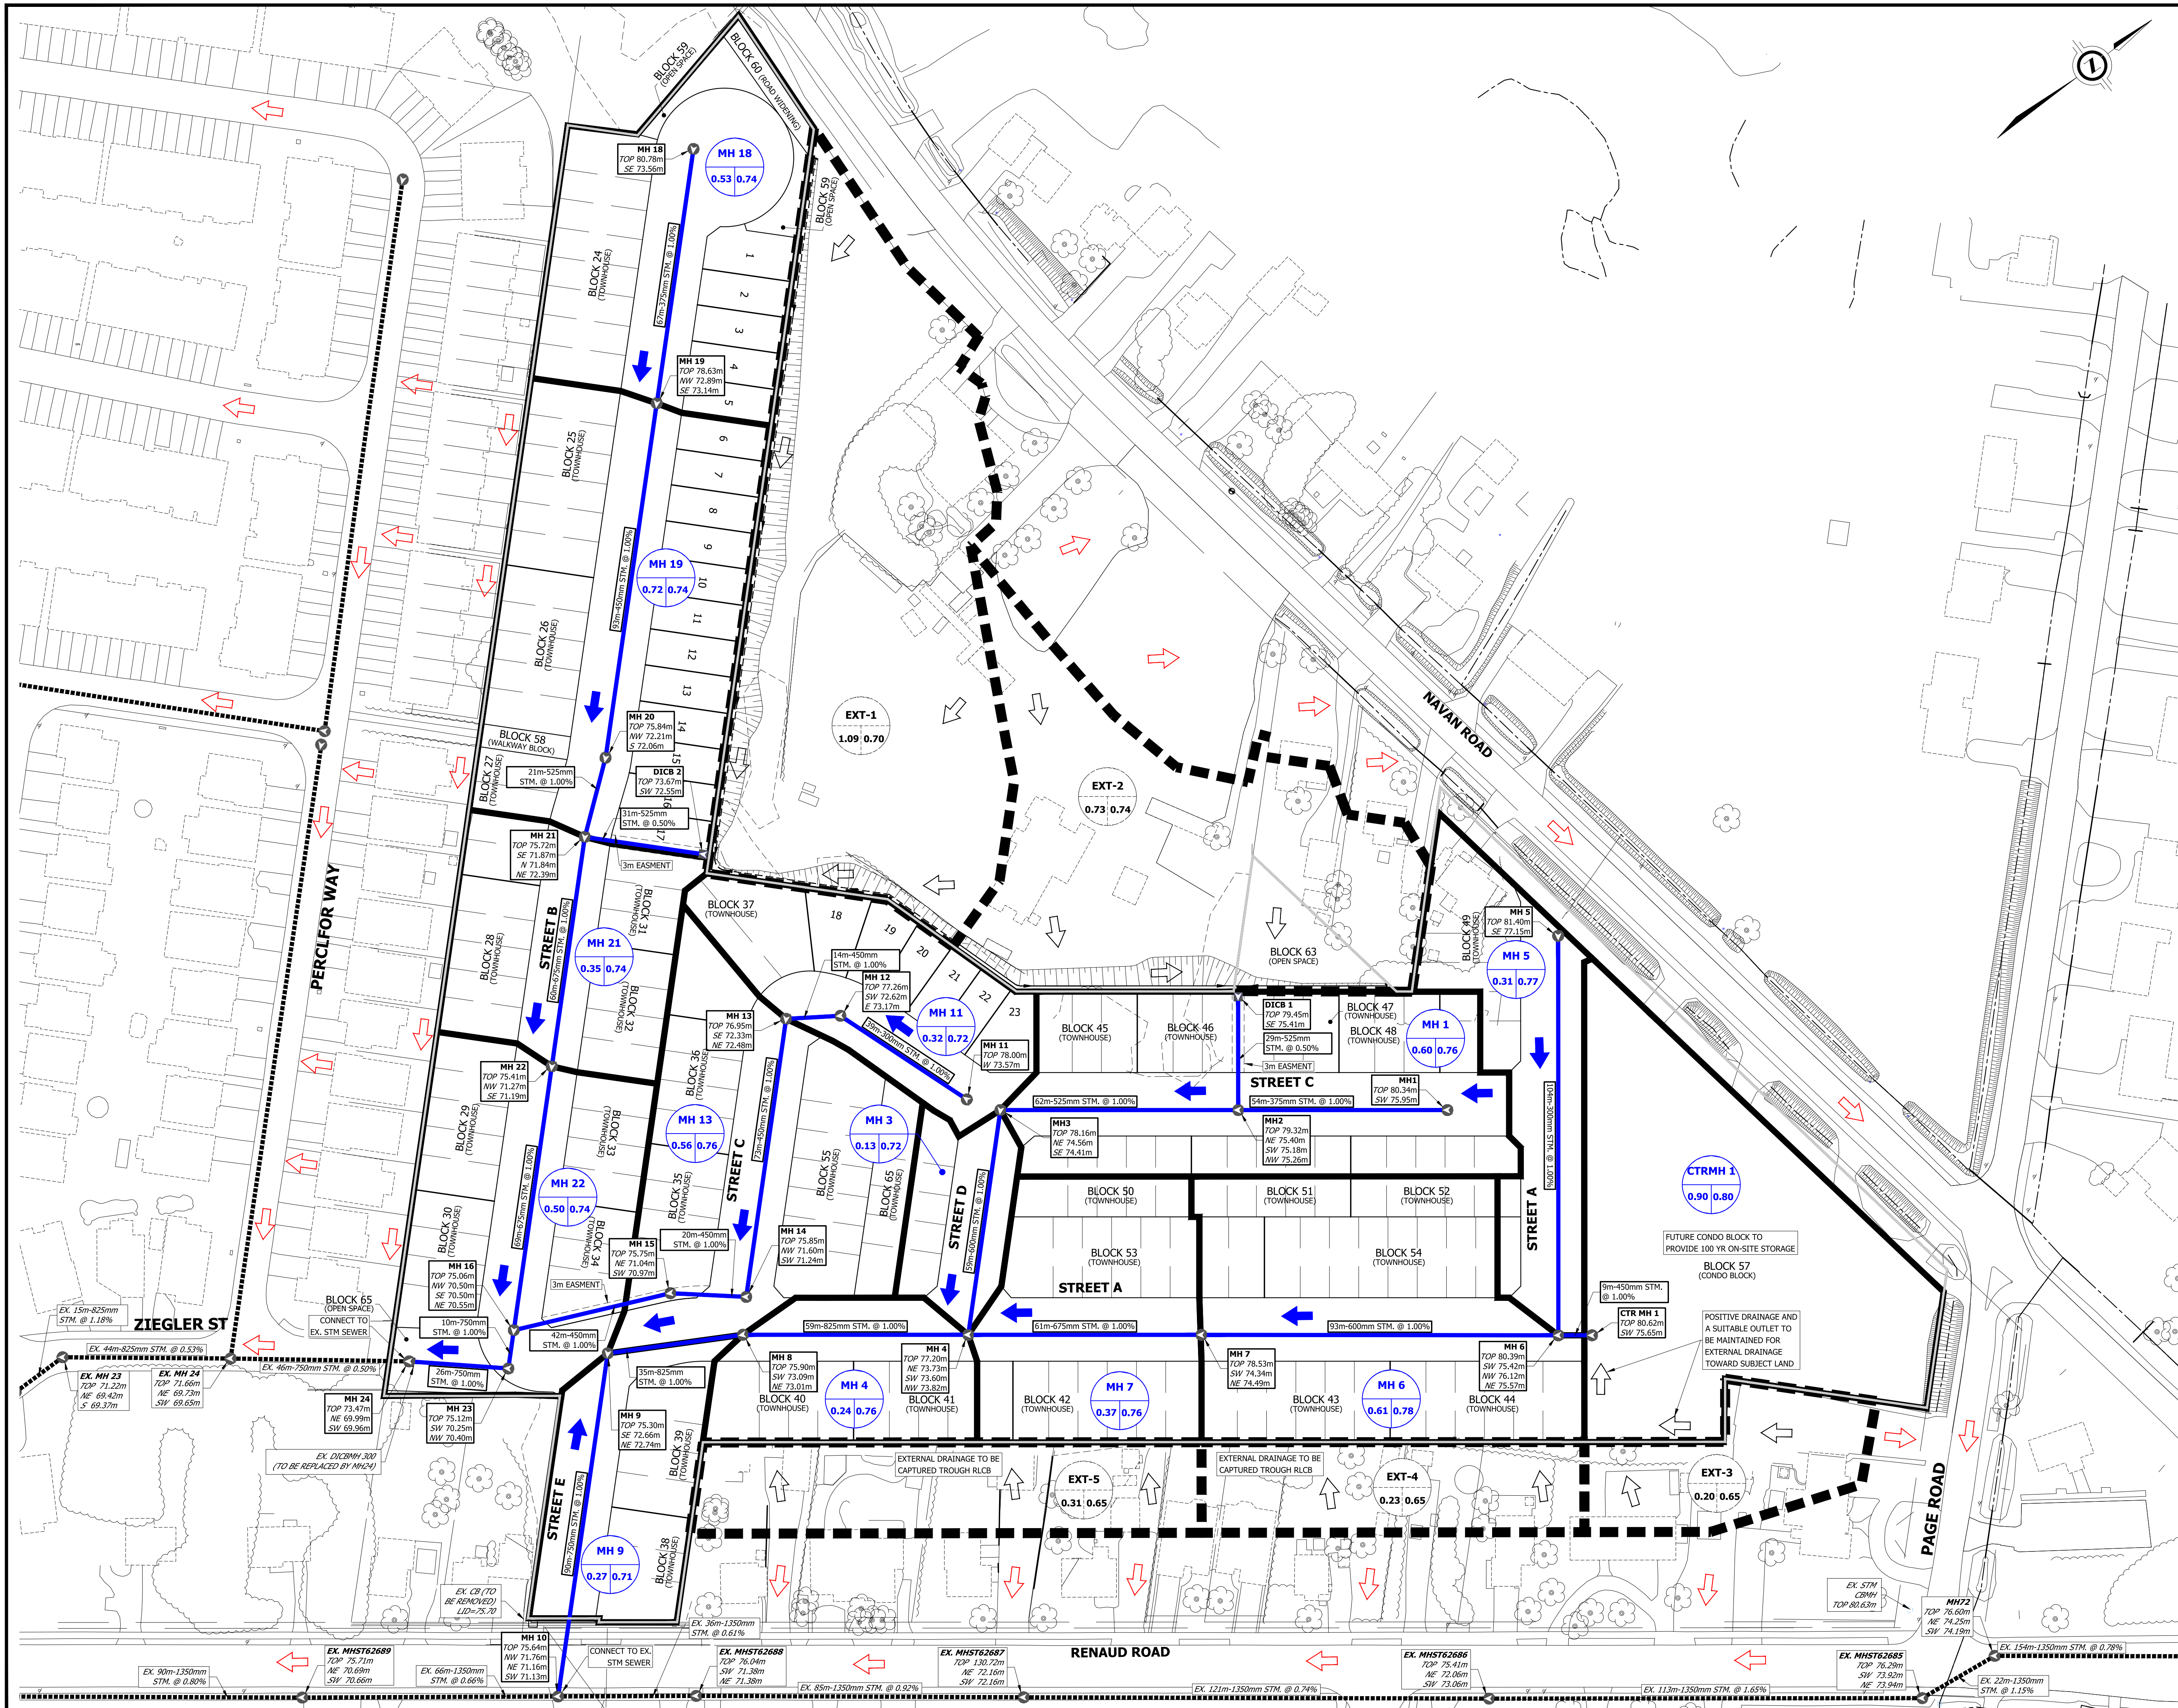

- LEGEND:**
- PROPERTY LIMIT
 - PROPOSED DRAINAGE AREA
 - EXTERNAL DRAINAGE AREA
 - PROPOSED STORM SEWER AND DIRECTION
 - EXISTING STORM SEWER AND DIRECTION
 - ➔ INTERNAL OVERLAND FLOW
 - ➔ EXTERNAL OVERLAND FLOW TOWARDS SUBJECT LANDS
 - ➔ EXTERNAL OVERLAND FLOW AWAY FROM SUBJECT LANDS
 - MH 21
0.35 0.74
Assigned Minor System Outlet
Area-Weighted Runoff Coefficient
Catchment Area (ha)
 - EXT-4
0.23 0.65
External Drainage Area ID
Area-Weighted Runoff Coefficient
Catchment Area (ha)

CAIVAN RENUAD INC.

CITY OF OTTAWA

Urbantech® Consulting
A Division of Leighton-Zec Ltd.
3750 14th Avenue, Suite 301,
Markham, ON, L3R 3T7
TEL 905.946.9461 • urbantech.com

POST DEVELOPMENT STORM DRAINAGE PLAN

PROJECT No.: 20-647-O FIGURE No.:
DATE: DECEMBER, 2020
SCALE: 1:750

4

APPENDIX E

Civil Engineering Drawings



NAVAN STACKED TOWN HOMES 6001 / 6005 RENAUD ROAD, OTTAWA, ON.

REVISION 05



KEY PLAN (N.T.S.)

DRAWING INDEX	
TITLE PAGE	
GENERAL NOTES	C001
SEDIMENT AND EROSION CONTROL PLAN	C101
DEMOLITION PLAN	C102
SITE DEVELOPMENT PLAN	C201
GRADING AND DRAINAGE PLAN	C301
SERVICING PLAN	C401
STORMWATER MANAGEMENT PLAN	C601
PRE-DEVELOPMENT WATERSHED PLAN	C701
POST-DEVELOPMENT WATERSHED PLAN	C702
CONSTRUCTION DETAIL PLAN 1/2	C901
CONSTRUCTION DETAIL PLAN 2/2	C902



LRJ

ENGINEERING | INGÉNIERIE

5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

NAVAN STACKED TOWN HOMES
6001/6005 RENAUD ROAD, OTTAWA, ON.
REV.05 - ISSUED FOR CLIENT APPROVAL - JULY 24th, 2024
LRL PROJECT no: 210216-05



NOT AUTHENTIC UNLESS SIGNED AND DATED

GENERAL NOTES

1. ALL WORKS MATERIALS SHALL CONFORM TO THE LAST REVISION OF THE STANDARDS AND SPECIFICATIONS FOR THE CITY OF OTTAWA, ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD) AND SPECIFICATIONS (OPSS), WHERE APPLICABLE. LOCAL UTILITY STANDARDS AND MINISTRY OF TRANSPORTATION STANDARDS WILL APPLY WHERE REQUIRED.
2. THE CONTRACTORS SHALL CONFIRM THE LOCATION OF ALL EXISTING UTILITIES WITHIN THE SITE AND ADJACENT WORK AREAS. THE CONTRACTORS SHALL BE RESPONSIBLE FOR PROTECTING ALL EXISTING UTILITIES TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REPAIR OR REPLACEMENT OF ANY SERVICES OR UTILITIES DISTURBED DURING CONSTRUCTION, TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION.
3. ALL DIMENSIONS SHALL BE CHECKED AND VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO THE START OF CONSTRUCTION. ANY DISCREPANCIES SHALL BE REPORTED IMMEDIATELY TO THE ENGINEER. LOST TIME DUE TO FAILURE OF THE CONTRACTORS TO CONFIRM UTILITY LOCATIONS AND NOTIFY ENGINEER OF POSSIBLE CONFLICTS PRIOR TO CONSTRUCTION WILL BE AT CONTRACTORS EXPENSE.
4. ANY AREA BEYOND THE LIMIT OF THE SITE DISTURBED DURING CONSTRUCTION SHALL BE RESTORED TO ORIGINAL CONDITION OR BETTER TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION AT THE CONTRACTORS EXPENSE. RELOCATING OF EXISTING SERVICES AND/OR UTILITIES SHALL BE AS SHOWN ON THE DRAWINGS OR DETECTED BY THE ENGINEER AT THE EXPENSE OF DEVELOPERS.
5. ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH THE OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS. THE GENERAL CONTRACTORS SHALL BE DEEMED TO BE THE CONTRACTOR AS DEFINED IN THE ACT.
6. ALL THE CONSTRUCTION SIGNAGE MUST CONFORM TO THE MINISTRY OF TRANSPORTATION OF ONTARIO MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES PER LATEST AMENDMENT.
7. THE CONTRACTOR IS ADVISED THAT WORKS BY OTHERS MAY BE ONGOING DURING THE PERIOD OF THE CONTRACT. THE CONTRACTOR SHALL COORDINATE CONSTRUCTION ACTIVITIES TO PREVENT CONFLICTS.
8. ALL DIMENSIONS ARE IN METRES UNLESS SPECIFIED OTHERWISE.
9. THERE WILL BE NO SUBSTITUTION OF MATERIALS UNLESS PRIOR WRITTEN APPROVAL IS RECEIVED FROM THE ENGINEER.
10. ALL CONSTRUCTION SHALL BE CARRIED OUT IN ACCORDANCE WITH THE RECOMMENDATIONS MADE IN THE GEOTECHNICAL REPORT.
11. FOR DETAILS RELATING TO STORMWATER MANAGEMENT AND ROOF DRAINAGE REFER TO THE SITE SERVICING AND STORMWATER MANAGEMENT REPORT.
12. ALL SEWERS CONSTRUCTED WITH GRADES LESS THAN 1.0% SHALL BE INSTALLED USING LASER ALIGNMENT AND CHECKED WITH LEVEL INSTRUMENT PRIOR TO BACKFILLING.
13. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL PERMITS REQUIRED AND TO BEAR THE COST OF THE SAME.
14. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ADDITIONAL BEDDING, OR ADDITIONAL STRENGTH PIPE IF THE MAXIMUM TRENCH WIDTH AS SPECIFIED BY OPSD IS EXCEEDED.
15. ALL PIPE/CULVERT SECTION SIZES REFER TO INSIDE DIMENSIONS.
16. SHOULD DEEPLY BURIED ARCHAEOLOGICAL REMAINS BE FOUND ON THE PROPERTY DURING CONSTRUCTION ACTIVITIES, THE HERITAGE OPERATIONS UNIT OF THE ONTARIO MINISTRY OF CULTURE MUST BE NOTIFIED IMMEDIATELY.
17. ALL NECESSARY CLEARING AND GRUBBING SHALL BE COMPLETED BY THE CONTRACTOR. REVIEW WITH CONTRACT ADMINISTRATOR AND THE CITY OF OTTAWA PRIOR TO ANY TREE CUTTING/REMOVAL.
18. DRAWINGS SHALL BE READ ON CONJUNCTION WITH ARCHITECTURAL SITE PLAN.
19. THE CONTRACTOR SHALL PROVIDE THE PROJECT ENGINEER ON SET OF AS CONSTRUCTED SITE SERVICING AND GRADING DRAWINGS.
20. BENCHMARKS: IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THAT THE SITE BENCHMARK(S) HAS NOT BEEN ALTERED OR DISTURBED AND THAT ITS RELATIVE ELEVATION AND DESCRIPTION AGREES WITH THE INFORMATION DEPICTED ON THIS PLAN.

EROSION AND SEDIMENT CONTROL NOTES

GENERAL

THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE, DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.

THE CONTRACTOR ACKNOWLEDGES THAT SURFACE EROSION AND SEDIMENT RUNOFF RESULTING FROM THEIR CONSTRUCTION OPERATIONS HAS POTENTIAL TO CAUSE A DETRIMENTAL IMPACT TO ANY DOWNSTREAM WATERCOURSE OR SEWER, AND THAT ALL CONSTRUCTION OPERATIONS THAT MAY IMPACT UPON WATER QUALITY SHALL BE CARRIED OUT IN MANNER THAT STRICTLY MEETS THE REQUIREMENT OF ALL APPLICABLE LEGISLATION AND REGULATIONS.

AS SUCH, THE CONTRACTOR SHALL BE RESPONSIBLE FOR CARRYING OUT THEIR OPERATIONS, AND SUPPLYING AND INSTALLING ANY APPROPRIATE CONTROL MEASURES, SO AS TO PREVENT SEDIMENT LADEN RUNOFF ENTERING ANY SEWER OR WATERCOURSE WITHIN OR DOWNSTREAM OF THE WORKING AREA.

THE CONTRACTOR ACKNOWLEDGES THAT NO ONE MEASURE IS LIKELY TO BE 100% EFFECTIVELY FOR EROSION PROTECTION AND CONTROLLING SEDIMENT RUNOFF AND DISCHARGES FROM THE SITE. THEREFORE, WHERE NECESSARY THE CONTRACTOR SHALL IMPLEMENT ADDITIONAL MEASURES ARRANGED IN SUCH MANNER AS TO MITIGATE SEDIMENT RELEASE FROM THE CONSTRUCTION OPERATIONS AND ACHIEVE SPECIFIC MAXIMUM PERMITTED CRITERIA WHERE APPLICABLE. SUGGESTED ON-SITE MEASURES MAY INCLUDE, BUT SHALL NOT BE LIMITED TO, THE FOLLOWING METHODS: SEDIMENT PONDS, FILTER BAGS, PUMP FILTERS, SETTLING TANKS, SILT FENCE, STRAW BALES, FILTER CLOTHS, CATCH BASIN FILTERS, CHECK DAMS AND/OR OTHER RECOGNIZED TECHNOLOGIES AND METHOD AVAILABLE AT THE TIME OF CONSTRUCTION. SPECIFIC MEASURES SHALL BE INSTALLED IN ACCORDANCE WITH REQUIREMENTS OF OPSS 577 WHERE APPROPRIATE, OR IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

WHERE, IN THE OPINION OF THE CONTRACT ADMINISTRATOR OR REGULATORY AGENCY, THE INSTALLED CONTROL MEASURES FAIL TO PERFORM ADEQUATELY, THE CONTRACTOR SHALL SUPPLY AND INSTALL ADDITIONAL OR ALTERNATIVE MEASURES AS DIRECTED BY THE CONTRACT ADMINISTRATOR OR REGULATORY AGENCY. AS SUCH, THE CONTRACTOR SHALL HAVE ADDITIONAL CONTROL MATERIALS ON SITE AT ALL TIME WHICH ARE EASILY ACCESSIBLE AND MAY BE IMPLEMENTED BY HIM AT THE MOMENT'S NOTICE.

PRIOR TO COMMENCING WORK, THE CONTRACTOR SHALL SUBMIT TO THE CONTRACT ADMINISTRATOR SIX COPIES OF A DETAILED EROSION AND SEDIMENT CONTROL PLAN (ESCP). THE ESCP WILL CONSIST OF WRITTEN DESCRIPTION AND DETAILED DRAWINGS INDICATING THE ON-SITE ACTIVITIES AND MEASURES TO BE USED TO CONTROL EROSION AND SEDIMENT MOVEMENT FOR EACH STEP OF THE WORK.

CONTRACTOR'S RESPONSIBILITIES

THE CONTRACTOR SHALL ENSURE THAT ALL WORKERS, INCLUDING SUB-CONTRACTOR, IN THE WORKING AREA ARE AWARE OF THE IMPORTANCE OF THE EROSION AND SEDIMENT CONTROL MEASURES AND INFORMED OF THE CONSEQUENCES OF THE FAILURE TO COMPLY WITH THE REQUIREMENTS OF ALL REGULATORY AGENCIES.

THE CONTRACTOR SHALL PERIODICALLY, AND WHEN REQUESTED BY THE CONTRACT ADMINISTRATOR, CLEAN OUT ACCUMULATED SEDIMENT DEPOSITS AS REQUIRED AT THE SEDIMENT CONTROL DEVICES, INCLUDING THOSE DEPOSITS THAT MAY ORIGINATE FROM OUTSIDE THE CONSTRUCTION AREA. ACCUMULATED SEDIMENT SHALL BE REMOVED IN SUCH A MANNER THAT PREVENTS THE DEPOSITION OF THIS MATERIAL INTO THE SEWER WATERCOURSE AND AVOIDS DAMAGE TO CONTROL MEASURES. THE SEDIMENT SHALL BE REMOVED FROM THE SITE AT THE CONTRACTOR'S EXPENSE AND MANAGED IN COMPLIANCE WITH REQUIREMENTS FRO EXCESS EARTH MATERIAL, AS SPECIFIED ELSEWHERE IN THE CONTRACT.

THE CONTRACTOR SHALL IMMEDIATELY REPORT TO THE CONTRACT ADMINISTRATOR ANY ACCIDENTAL DISCHARGES OF SEDIMENT MATERIAL INTO EITHER THE WATERCOURSE OR THE STORM SEWER SYSTEM. FAILURE TO REPORT WILL BE CONSTITUTE A BREACH OF THIS SPECIFICATION AND THE CONTRACTOR MAY ALSO BE SUBJECT TO THE PENALTIES IMPOSED BY THE APPLICABLE REGULATORY AGENCY. APPROPRIATE RESPONSE MEASURES, INCLUDING ANY REPAIRS TO EXISTING CONTROL MEASURES OR THE IMPLEMENTATION OF ADDITIONAL CONTROL MEASURES, SHALL BE CARRIED OUT BY THE CONTRACTOR WITHOUT DELAY.

THE SEDIMENT CONTROL MEASURES SHALL ONLY BE REMOVED WHEN, IN THE OPINION OF THE CONTRACT ADMINISTRATOR, THE MEASURE OR MEASURES, IS NO LONGER REQUIRED. NO CONTROL MEASURE MAY BE PERMANENTLY REMOVED WITHOUT PRIOR AUTHORIZATION FROM THE CONTRACT ADMINISTRATOR. ALL SEDIMENT AND EROSION CONTROL MEASURES SHALL BE REMOVED IN A MANNER THAT AVOIDS THE ENTRY OF ANY EQUIPMENT, OTHER THAN HAND-HELD EQUIPMENT, INTO ANY WATERCOURSE, AND PREVENTS THE RELEASE OF ANY SEDIMENT OR DEBRIS INTO ANY SEWER OR WATERCOURSE WITHIN OR DOWNSTREAM OF THE WORKING AREA. ALL ACCUMULATED SEDIMENT SHALL BE REMOVED FROM THE WORKING AREA AT THE CONTRACTOR'S EXPENSE AND MANAGED IN COMPLIANCE WITH THE REQUIREMENTS FOR EXCESS EARTH MATERIAL.

WHERE, IN THE OPINION OF EITHER THE CONTRACT ADMINISTRATOR OR A REGULATORY AGENCY, ANY OF THE TERMS SPECIFIED HEREIN HAVE NOT BEEN COMPLIED WITH OR PERFORMED IN A SUITABLE MANNER, OR THAT ALL THE CONTRACTOR ADMINISTRATOR OR A REGULATORY AGENCY HAS THE RIGHT TO IMMEDIATELY WITHDRAW ITS PERMISSION TO CONTINUE THE WORK BUT MAY RENEW ITS PERMISSION UPON BEING SATISFIED THAT THE DEFAULTS OR DEFICIENCIES IN THE PERFORMANCE OF THIS SPECIFICATION BY THE CONTRACTOR HAVE BEEN REMEDIED.

SPILL CONTROL NOTES

1. ALL CONSTRUCTION EQUIPMENT SHALL BE RE-FUELED, MAINTAINED, AND STORED NO LESS THAN 30 METRES FROM WATERCOURSE, STREAMS, CREEKS, WOODLOTS, AND ANY ENVIRONMENTALLY SENSITIVE AREAS, OR AS OTHERWISE SPECIFIED.
2. THE CONTRACTOR MUST IMPLEMENT ALL NECESSARY MEASURES IN ORDER TO PREVENT LEAKS, DISCHARGES OR SPILLS OF POLLUTANTS, DELETERIOUS MATERIALS, OR OTHER SUCH MATERIALS OR SUBSTANCES WHICH WOULD OR COULD CAUSE AN ADVERSE IMPACT TO THE NATURAL ENVIRONMENT.
3. IN THE EVENT OF A LEAK, DISCHARGE OR SPILL OF POLLUTANT, DELETERIOUS MATERIAL OR OTHER SUCH MATERIAL OR SUBSTANCE WHICH WOULD OR COULD CAUSE AN ADVERSE IMPACT TO THE NATURAL ENVIRONMENT, THE CONTRACTOR SHALL:
 - 3.1. IMMEDIATELY NOTIFY APPROPRIATE FEDERAL, PROVINCIAL, AND LOCAL GOVERNMENT MINISTRIES, DEPARTMENTS, AGENCIES, AND AUTHORITIES OF THE INCIDENT IN ACCORDANCE WITH ALL CURRENT LAWS, LEGISLATION, ACTS, BY-LAWS, PERMITS, APPROVALS, ETC.
 - 3.2. TAKE IMMEDIATE MEASURES TO CONTAIN THE MATERIAL OR SUBSTANCE, AND TO TAKE SUCH MEASURES TO MITIGATE AGAINST ADVERSE IMPACTS TO THE NATURAL ENVIRONMENT.
 - 3.3. RESTORE THE AFFECTED AREA TO THE ORIGINAL CONDITION OR BETTER TO THE SATISFACTION OF THE AUTHORITIES HAVING JURISDICTION.

MUD MAT NOTES

1. THE GRANULAR MATERIAL WILL REQUIRE PERIODIC REPLACEMENT AS IT BECOMES CONTAMINATED BY VEHICLE TRAFFIC.
2. SEDIMENT SHALL BE CLEANED FROM PUBLIC ROADS AT THE END OF EACH DAY.
3. SEDIMENT SHALL BE REMOVED FROM PUBLIC ROADS BY SHOVELING OR SWEEPING AND DISPOSED OR PROPERLY IN A CONTROLLED SEDIMENT DISPOSAL AREA.

SITE GRADING NOTES

1. PRIOR TO THE COMMENCEMENT OF THE SITE GRADING WORKS, ALL SILTATION CONTROL DEVICES SHALL BE INSTALLED AND OPERATIONAL PER EROSION CONTROL PLAN.
2. ALL GRANULAR AND PAVEMENT FOR ROADS/PARKING AREAS SHALL BE CONSTRUCTED IN ACCORDANCE WITH GEOTECHNICAL ENGINEERS RECOMMENDATIONS.
3. ALL TOPSOIL AND ORGANIC MATERIAL SHALL BE STRIPPED WITHIN THE ROAD AND PARKING AREAS ALLOWANCE PRIOR TO THE COMMENCEMENT OF CONSTRUCTION.
4. CONCRETE CURB SHALL BE IN ACCORDANCE WITH THE CITY OF OTTAWA STD. SC1.1 PROVISION SHALL BE MADE OR CURB DEPRESSIONS AS INDICATED ON ARCHITECTURAL SITE PLAN. CONCRETE SIDEWALK SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD SC1.4. ALL CURBS, CONCRETE ISLANDS, AND SIDEWALKS SHOWN O THIS DRAWING ARE TO BE BRICED IN SITE WORKS PORTION OF THE CONTRACT.
5. PAVEMENT STATEMENT FOR SERVICE AND UTILITY CUTS SHALL BE IN ACCORDANCE WITH THE CITY OF OTTAWA STD. R10 AND OPSD 509.010 AND OPSS 310.
6. GRANULAR 'A' SHALL BE PLACED TO A MINIMUM THICKNESS OF 300MM AROUND ALL STRUCTURES WITHIN THE PAVEMENT AREA.
7. SUB-EXCAVATE SOFT AREAS AND FILL WITH GRANULAR 'B' COMPACTED IN MAXIMUM 300MM LIFTS.
8. ALL WORK ON THE MUNICIPAL RIGHT OF WAY AND EASEMENTS TO BE INSPECTED BY THE MUNICIPALITY PRIOR BACKFILLING.
9. CONTRACTOR TO OBTAIN A ROAD OCCUPANCY PERMIT 48 HOURS PRIOR TO COMMENCING ANY WORK WITHIN THE MUNICIPAL ROAD ALLOWANCE, IF REQUIRED BY THE MUNICIPALITY.
10. ALL PAVEMENT MARKING FEATURES AND SITE SIGNAGE SHALL BE PLACED PER ARCHITECTURAL SITE PLAN. LINE PAINTING AND DIRECTIONAL SYMBOLS SHALL BE APPLIED WITH A MINIMUM OF TWO COATS OF ORGANIC SOLVENT PAINT.
11. REFER TO ARCHITECTURAL SITE PLAN FOR DIMENSIONS AND SITE DETAILS.
12. STEP JOINTS ARE TO BE USED WHERE PROPOSED ASPHALT MEETS EXISTING ASPHALT. ALL JOINTS MUST BE SEALED.
13. SIDEWALKS TO BE 13MM X BEVELED AT 2:1 OR 6MM WITH NO BEVEL REQUIRED BELOW THE FINISHED FLOOR SLAB ELEVATION AT ENTRANCES REQUIRED TO BE BARRIER-FREE, UNLESS OTHERWISE NOTED. ALL IN ACCORDANCE WITH OBC 3.8.1.3 & OTTAWA ACCESSIBILITY DESIGN STANDARDS.
14. WHERE APPLICABLE THE CONTRACTOR IS TO SUBMIT SHOP DRAWINGS TO THE ENGINEER FOR APPROVAL PRIOR TO CONSTRUCTION. SHOP DRAWINGS MUST BE SITE SPECIFIC, SIGNED AND SEALED BY A LICENSED STRUCTURAL ENGINEER. THE CONTRACTOR WILL ALSO BE REQUIRED TO SUPPLY AND GEOTECHNICAL CERTIFICATION OF THE AS-CONSTRUCTED RETAINING WALL TO THE ENGINEER PRIOR TO FINAL ACCEPTANCE.

ROADWORK SPECIFICATIONS

15. ROADWORK TO BE COMPLETED IN ACCORDANCE WITH GEOTECHNICAL REPORT, PREPARED BY LRL ASSOCIATES, DATED NOVEMBER 2020.
16. ALL TOPSOIL AND ORGANIC MATERIAL SHALL BE STRIPPED WITHIN THE ROAD ALLOWANCE PRIOR TO THE COMMENCEMENT OF CONSTRUCTION AND STOCK PILLED ON SITE AS DIRECTED BY NATIONAL MUNICIPALITY.
17. THE SUBGRADE SHALL BE CROWNED AND SLOPED AT LEAST 2% AND PROOF ROLLED WITH HEAVY ROLLERS.
18. SUB-EXCAVATE SOFT AREAS AND FILL WITH GRANULAR 'A', TYPE II COMPACTED IN MAXIMUM 300MM LIFTS.
19. ALL GRANULAR FOR ROADS SHALL BE COMPACTED TO MINIMUM OF 100% STANDARD PROCTOR DENSITY MAXIMUM DRY DENSITY (SPMDD).

SANITARY, FOUNDATION DRAIN, STORM SEWER AND WATERMAIN NOTES

GENERAL

1. LASER ALIGNMENT CONTROL TO BE UTILIZED ON ALL SEWER INSTALLATIONS.
2. CLAY SEALS TO BE INSTALLED AS PER CITY STANDARD DRAWING S8. THE SEALS SHOULD BE AT LEAST 1.5M LONG (IN THE TRENCH DIRECTION) AND SHOULD EXTEND FROM TRENCH WALL TO TRENCH WALL. THE SEALS SHOULD EXTEND FROM THE FROST LINE AND FULLY PENETRATE THE BEDDING, SUB-BEDDING, AND COVER MATERIAL. THE BARRIERS SHOULD CONSIST OF RELATIVELY DRY AND COMPACTIBLE BROWN SILTY CLAY PLACED IN MAXIMUM 225MM LIFTS AND COMPACTED TO A MINIMUM OF 95% SPMDD. THE CLAY SEALS SHOULD BE PLACED AT THE SITE BOUNDARIES AND AT 60M INTERVALS IN THE SERVICE TRENCHES.
3. SERVICES TO BUILDING TO BE TERMINATED 1.0M FROM THE OUTSIDE FACE OF BUILDING UNLESS OTHERWISE NOTED.
4. ALL MAINTENANCE STRUCTURE AND CATCH BASIN EXCAVATIONS TO BE BACKFILLED WITH GRANULAR MATERIAL COMPACTED TO 98% STANDARD PROCTOR DENSITY, A MINIMUM OF 300MM AROUND STRUCTURES.
5. 'MODULOC' OR APPROVED PRE-CAST MAINTENANCE STRUCTURE AND CATCH BASIN ADJUSTERS TO BE USED IN LIEU OF BRICKING. PARGE ADJUSTING UNITS ON THE OUTSIDE ONLY.
6. SAFETY PLATFORMS SHALL BE PER OPSD 404.02.
7. DROP STRUCTURES SHALL BE IN ACCORDANCE WITH OPSD 1003.01, IF APPLICABLE.
8. THE CONTRACTOR IS TO PROVIDE CCTV CAMERA INSPECTIONS OF ALL SEWERS, INCLUDING PICTORIAL REPORT, ONE (1) CD COPY AND TWO (2) VIDEO RECORDINGS IN A FORMAT ACCEPTABLE TO ENGINEER. ALL SEWER ARE TO BE FLUSHED PRIOR TO CAMERA INSPECTION. ASPHALT WEAR COURSE SHALL NOT BE PLACED UNTIL THE VIDEO INSPECTION OF SEWERS AND NECESSARY REPAIRS HAVE BEEN COMPLETED TO THE SATISFACTION OF THE ENGINEER.
9. CONTRACTOR SHALL PERFORM LEAKAGE TESTING, IN THE PRESENCE OF THE CONSULTANT, FOR SANITARY SEWERS IN ACCORDANCE WITH OPSD 407. CONTRACTOR SHALL PERFORM VIDEO INSPECTION OF ALL SEWERS. A COPY OF THE VIDEO AND INSPECTION REPORT SHALL BE SUBMITTED TO THE CONSULTANT FOR REVIEW AND APPROVAL PRIOR TO PLACEMENT OF WEAR COURSE ASPHALT.

SANITARY

10. ALL SANITARY SEWER INSTALLATION SHALL CONFORM TO THE LATEST SPECIFIONS OF THE CITY OF OTTAWA AND THE ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD) AND SPECIFICATIONS (OPSS).
11. ALL SANITARY GRAVITY SEWER SHALL BE PVC SDR 35, IPEX 'RING-TITE' (OR APPROVED EQUIVALENT) PER CSA STANDARD B182.2 OR LATEST AMENDMENT, UNLESS SPECIFIED OTHERWISE.
12. EXISTING MAINTENANCE STRUCTURES TO BE RE-BENCHED WHERE A NEW CONNECTION IS MADE.
13. SANITARY GRAVITY SEWER TRENCH AND BEDDING SHALL BE PER CITY OF OTTAWA STD. S6 AND S7 CLASS 'B' BEDDING, UNLESS SPECIFIED OTHERWISE.
14. SANITARY MAINTENANCE STRUCTURE FRAME AND COVERS SHALL BE PER CITY OF OTTAWA STD. S24 AND S25.
15. SANITARY MAINTENANCE STRUCTURES SHALL BE BENCHED PER OPSD 701.021.
16. 100MM THICK HIGH-DENSITY GRADE 'A' POLYSTYRENE INSULATION TO BE INSTALLED IN ACCORDANCE WITH CITY STD W22 WHERE INDICATED ON DRAWING SSP-1.

STORM

17. ALL REINFORCED CONCRETE STORM SEWER PIPE SHALL BE IN ACCORDANCE WITH CSA A257.2, OR LATEST AMENDMENT. ALL NON-REINFORCED CONCRETE STORM SEWER PIPE SHALL BE IN ACCORDANCE WITH CSA A257.1, OR LATEST AMENDMENT. PIPE SHALL BE JOINED WITH STD. RUBBER GASKETS AS PER CSA A257.3, OR LATEST AMENDMENT.
18. ALL STORM SEWER TRENCH AND BEDDING SHALL BE IN ACCORDANCE WITH THE CITY OF OTTAWA STD. S24 AND S7 CLASS 'B' UNLESS OTHERWISE SPECIFIED. BEDDING AND COVER MATERIAL SHALL BE SPECIFIED BY PROJECT GEOTECHNICAL ENGINEER.
19. ALL PVC STORM SEWERS ARE TO BE SDR 35 APPROVED PER C.S.A. B182.2 OR LATEST AMENDMENT, UNLESS OTHERWISE SPECIFIED.
20. CATCH BASIN SHALL BE IN ACCORDANCE WITH OPSD 705.010.
21. CATCH BASIN LEADS SHALL BE IN 200MM DIA. AT 1% SLOPE (MIN) UNLESS SPECIFIED OTHERWISE.
22. ALL CATCH BASINS SHALL HAVE 600MM SUMPS, UNLESS SPECIFIED OTHERWISE.
23. ALL CATCH BASIN LEAD INVERTS TO BE 1.5M BELOW FINISHED GRADE UNLESS SPECIFIED OTHERWISE.
24. THE STORM SEWER CLASSES HAVE BEEN DESIGNED BASED ON BEDDING CONDITIONS SPECIFIED ABOVE. WHERE THE SPECIFIED TRENCH WIDTH IS EXCEEDED, THE CONTRACTOR IS REQUIRED TO PROVIDE AND SHALL BE RESPONSIBLE FOR EXTRA TEMPORARY AND/OR PERMANENT REPAIRS MADE NECESSARY BY THE WIDENED TRENCH.
25. ALL ROAD AND PARKING LOT CATCH BASINS TO BE INSTALLED WITH ORTHOGONALLY PLACED SUBDRAINS IN ACCORDANCE WITH DETAIL. PERFORATED SUBDRAIN FOR ROAD AND PARKING LOT CATCH BASIN SHALL BE INSTALLED PER CITY STD R1 UNLESS OTHERWISE NOTED.
26. PERFORATED SUBDRAIN FOR REAR YARD AND LANDSCAPING APPLICATIONS SHALL BE INSTALLED PER CITY STD S29, S30 AND S31, WHERE APPLICABLE.
27. RIP-RAP TREATMENT SEWER AND CULVERT OUTLETS PER OPSD 810.010.
28. ALL STORM SEWER CULVERTS TO BE INSTALLED WITH FROST TREATMENT PER OPSD 803.031 WHERE APPLICABLE.
29. ALL STORM MANHOLES WITH PIPE LESS THAN 900MM IN DIAMETER SHALL BE CONSTRUCTED WITH A 300MM SUMP AS PER SDG, CLAUSE 6.2.

WATERMAIN

30. ALL WATERMAIN INSTALLATION SHALL CONFORM TO THE LATEST REVISIONS OF THE CITY OF OTTAWA AND THE ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD) AND SPECIFICATIONS (OPSS).
31. ALL PVC WATERMAINS SHALL BE AWWA C-900 CLASS 150, SDR 18 OR APPROVED EQUIVALENT.
32. ALL WATER SERVICES LESS THAN OR EQUAL TO 50MM IN DIAMETER TO BE TYPE 'K' COPPER.
33. WATERMAIN TRENCH AND BEDDING SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STANDARD W17. UNLESS SPECIFIED OTHERWISE. BEDDING AND COVER MATERIAL SHALL BE SPECIFIED BY THE PROJECT GEOTECHNICAL ENGINEER.
34. ALL PVC WATERMAINS, SHALL BE INSTALLED WITH A 10 GAUGE STRANDED COPPER TWU OR RWU TRACER WIRE IN ACCORDANCE WITH CITY OF OTTAWA STD. W36.
35. CATHODIC PROTECTION IS REQUIRED ON ALL METALLIC FITTINGS PER CITY OF OTTAWA STD.25.5 AND W25.6.
36. VALVE BOXES SHALL BE INSTALLED PER CITY OF OTTAWA STD W24.
37. WATERMAIN IN FILL AREAS TO BE INSTALLED WITH RESTRAINED JOINTS PER CITY OF OTTAWA STD.25.5 AND W25.6.
38. THRUST BLOCKING OF WATERMAINS TO BE INSTALLED PER CITY OF OTTAWA STD. W25.3 AND W25.4.
39. THE CONTRACTOR SHALL PROVIDE ALL TEMPORARY CAPS, PLUGS, BLOW-OFFS, AND NOZZLES REQUIRED FOR TESTING AND DISINFECTION OF THE WATERMAIN.
40. WATERMAIN CROSSING OVER AND BELOW SEWERS SHALL BE IN ACCORDANCE WITH THE CITY OF OTTAWA STD. W25.2 AND W25, RESPECTIVELY.
41. WATER SERVICES ARE TO BE INSULATED PER CITY STD. W23 WHERE SEPARATION BETWEEN SERVICES AND MAINTENANCE HOLES ARE LESS THAN 2.4M.
42. THE MINIMUM VERTICAL CLEARANCE BETWEEN WATERMAIN AND SEWER/UTILITY IS 0.5M PER MOE GUIDELINES. FOR CROSSING UNDER SEWERS, ADEQUATE STRUCTURAL SUPPORT FOR THE SEWER IS REQUIRED TO PREVENT EXCESSIVE DEFLECTION OF JOINTS AND SETTLING. THE LENGTH OF WATER PIPE SHALL BE CENTERED AT THE POINT OF CROSSING TO ENSURE THAT THE JOINTS WILL BE EQUIDISTANT AND AS FAR AS POSSIBLE FROM THE SEWER.
43. ALL WATERMAINS SHALL HAVE A MINIMUM COVER OR 2.4M, OTHERWISE THERMAL INSULATION IS REQUIRED AS PER STD DWG W22.
44. GENERAL WATER PLANT TO UTILITY CLEARANCE AS PER STD DWG R20.
45. FIRE HYDRANT INSTALLATION AS PER STD DWG W19. ALL BOTTOM OF HYDRANT FLANGE ELEVATIONS TO BE INSTALLED 0.10M ABOVE PROPOSED FINISHED GRADE AT HYDRANT; FIRE HYDRANT LOCATION AS PER STD DWG W18.
46. BUILDING SERVICE TO BE CAPPED 1.0M OFF THE FACE OF THE BUILDING UNLESS OTHERWISE NOTED AND MUST BE RESTRAINED A MINIMUM OF 12M BACK FROM STUBS.
47. ALL WATERMAINS SHALL BE HYDROSTATICALLY TESTED IN ACCORDANCE WITH THE CITY OF OTTAWA AND ONTARIO GUIDELINES UNLESS OTHERWISE DIRECTED. PROVISIONS FOR FLUSHING WATER LINE PRIOR TO TESTING, ETC. MUST BE PROVIDED.
48. ALL WATERMAINS SHALL BE BACTERIOLOGICALLY TESTED IN ACCORDANCE WITH THE CITY OF OTTAWA AND ONTARIO GUIDELINES. ALL CHLORINATED WATER TO BE DISCHARGED AND PRETREATED TO ACCEPTABLE LEVELS PRIOR TO DISCHARGE. ALL DISCHARGED WATER MUST BE CONTROLLED AND TREATED SO AS NOT TO ADVERSELY EFFECT ENVIRONMENT. IT IS RESPONSIBILITY OF THE CONTRACTOR TO ENSURE THAT ALL MUNICIPAL AND/OR PROVINCIAL REQUIREMENTS ARE FOLLOWED.
49. ALL WATERMAIN STUBS SHALL BE TERMINATED WITH A PLUG AND 50MM BLOW OFF UNLESS OTHERWISE NOTED.

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE USE AND INTENT OF THE DRAWINGS. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE DRAWING CONTRACTORS AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS IF REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILS UNLESS OTHERWISE SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIED THERE OF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THE PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATES THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BIDDER HAS NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO THE SPECIFICATIONS, DRAWINGS, OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL, AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES, TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COST, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONTRACT DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND DEPTH OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE REVISIONS THEREON, SPECIFICATIONS OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.


CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.



No.	REVISIONS	BY	DATE
05	ISSUED FOR MUNICIPAL APPROVAL	K.H.	24 JUL 2024
04	ISSUED FOR MUNICIPAL APPROVAL	K.H.	23 APR 2024
03	ISSUED FOR MUNICIPAL APPROVAL	K.H.	19 DEC 2023
02	ISSUED FOR MUNICIPAL APPROVAL	K.H.	09 JUN 2023
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	24 DEC 2021



NOT AUTHENTIC UNLESS SIGNED AND DATED

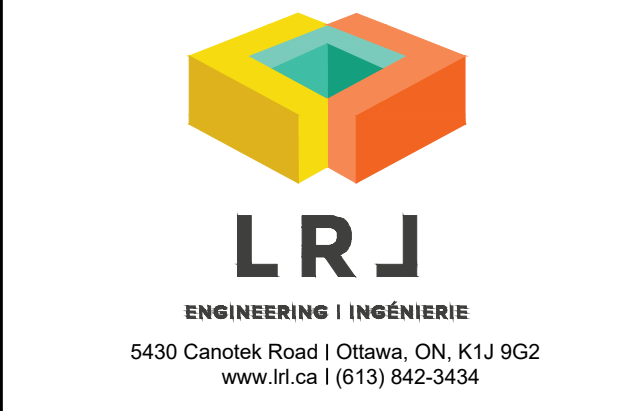

CLIENT		
LANDRIC HOMES 1173 CYRVILLE RD, SUITE 202, OTTAWA ON K1J 7S6		
DESIGNED BY: K.H.	DRAWN BY: K.H.	APPROVED BY: V.J.

PROJECT
NAVAN STACKED TOWN HOMES
6001/6005 RENAUD RD,
OTTAWA, ONTARIO

DRAWING TITLE

GENERAL NOTES

PROJECT NO.	210216
DATE	NOVEMBER 2021

C001






SCALE: N.T.S.

PAVEMENT STRUCTURE


COURSE	MATERIAL	THICKNESS (mm)	
		AUTOMOBILE PARKING	TRUCK ROUTE (HEAVY TRAFFIC)
SURFACE	HL 3 A/C (PG 58-28)	50	40
BINDER	HL 8 A/C (PG 58-28)	—	50
BASECOURSE	OPSS GRANULAR "A"	150	150
SUBBASE	OPSS GRANULAR "B" TYPE II	300	450

NOTE:
REFER TO GEOTECHNICAL INVESTIGATION BY PATERSON GROUP DATED APRIL 23, 2021. IN PREPARATION FOR PAVEMENT CONSTRUCTION AT THIS SITE. ANY SURFICIAL OR NEAR SURFACE/SUBGRADE LEVEL TOPSOIL AND ANY SOFT, WET OR DELETERIOUS MATERIALS SHOULD BE REMOVED FROM THE PROPOSED PAVED AREAS. THE EXPOSED SUBGRADE SHOULD BE INSPECTED AND APPROVED BY GEOTECHNICAL PERSONNEL, AND ANY SOFT AREAS EVIDENT SHOULD BE SUBCAVATED AND REPLACED WITH SUITABLE EARTH BORROW APPROVED BY THE GEOTECHNICAL ENGINEER. THE SUBGRADE SHOULD BE SHAPED AND CROWNED TO PROMOTE DRAINAGE OF THE SITE DRAINAGE STRUCTURES. FOLLOWING APPROVAL OF THE PREPARATION OF THE SUBGRADE, THE PAVEMENT GRANULARS MAY BE PLACED.

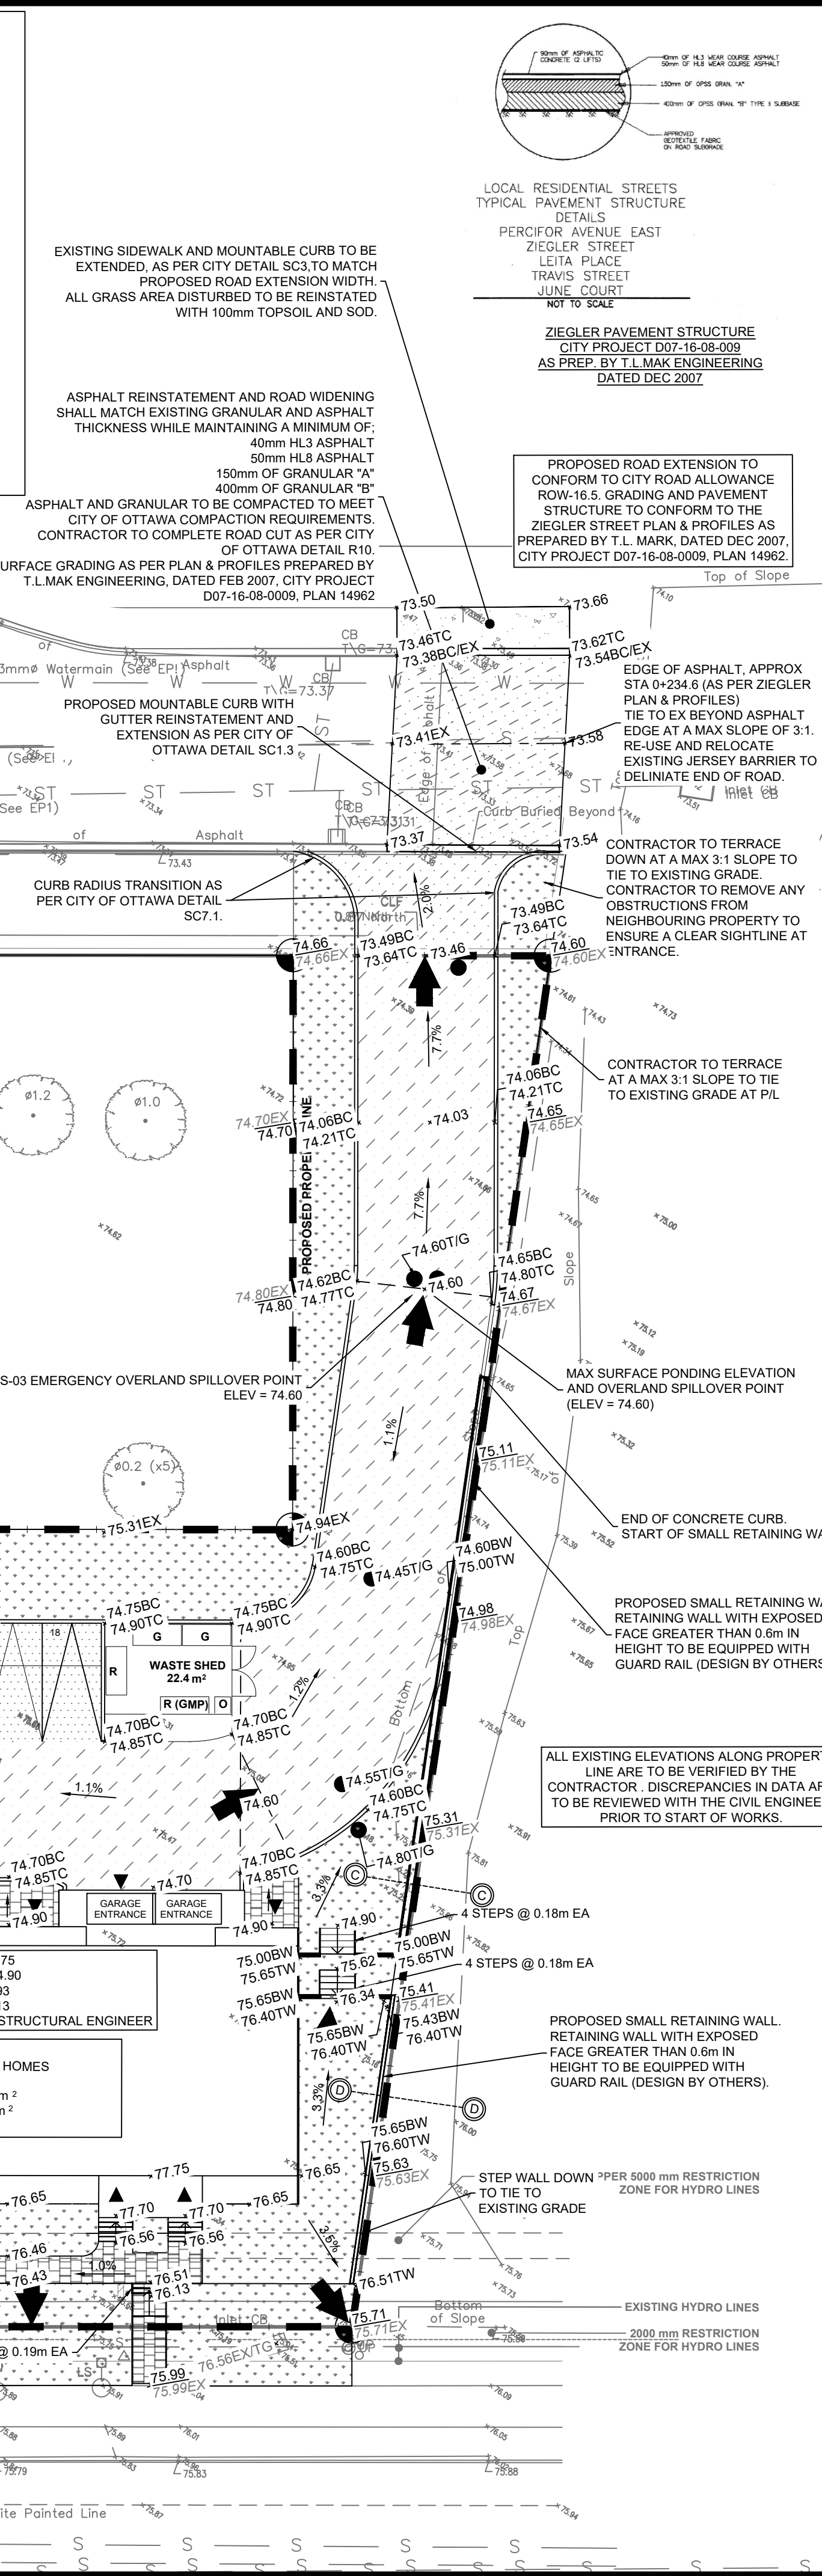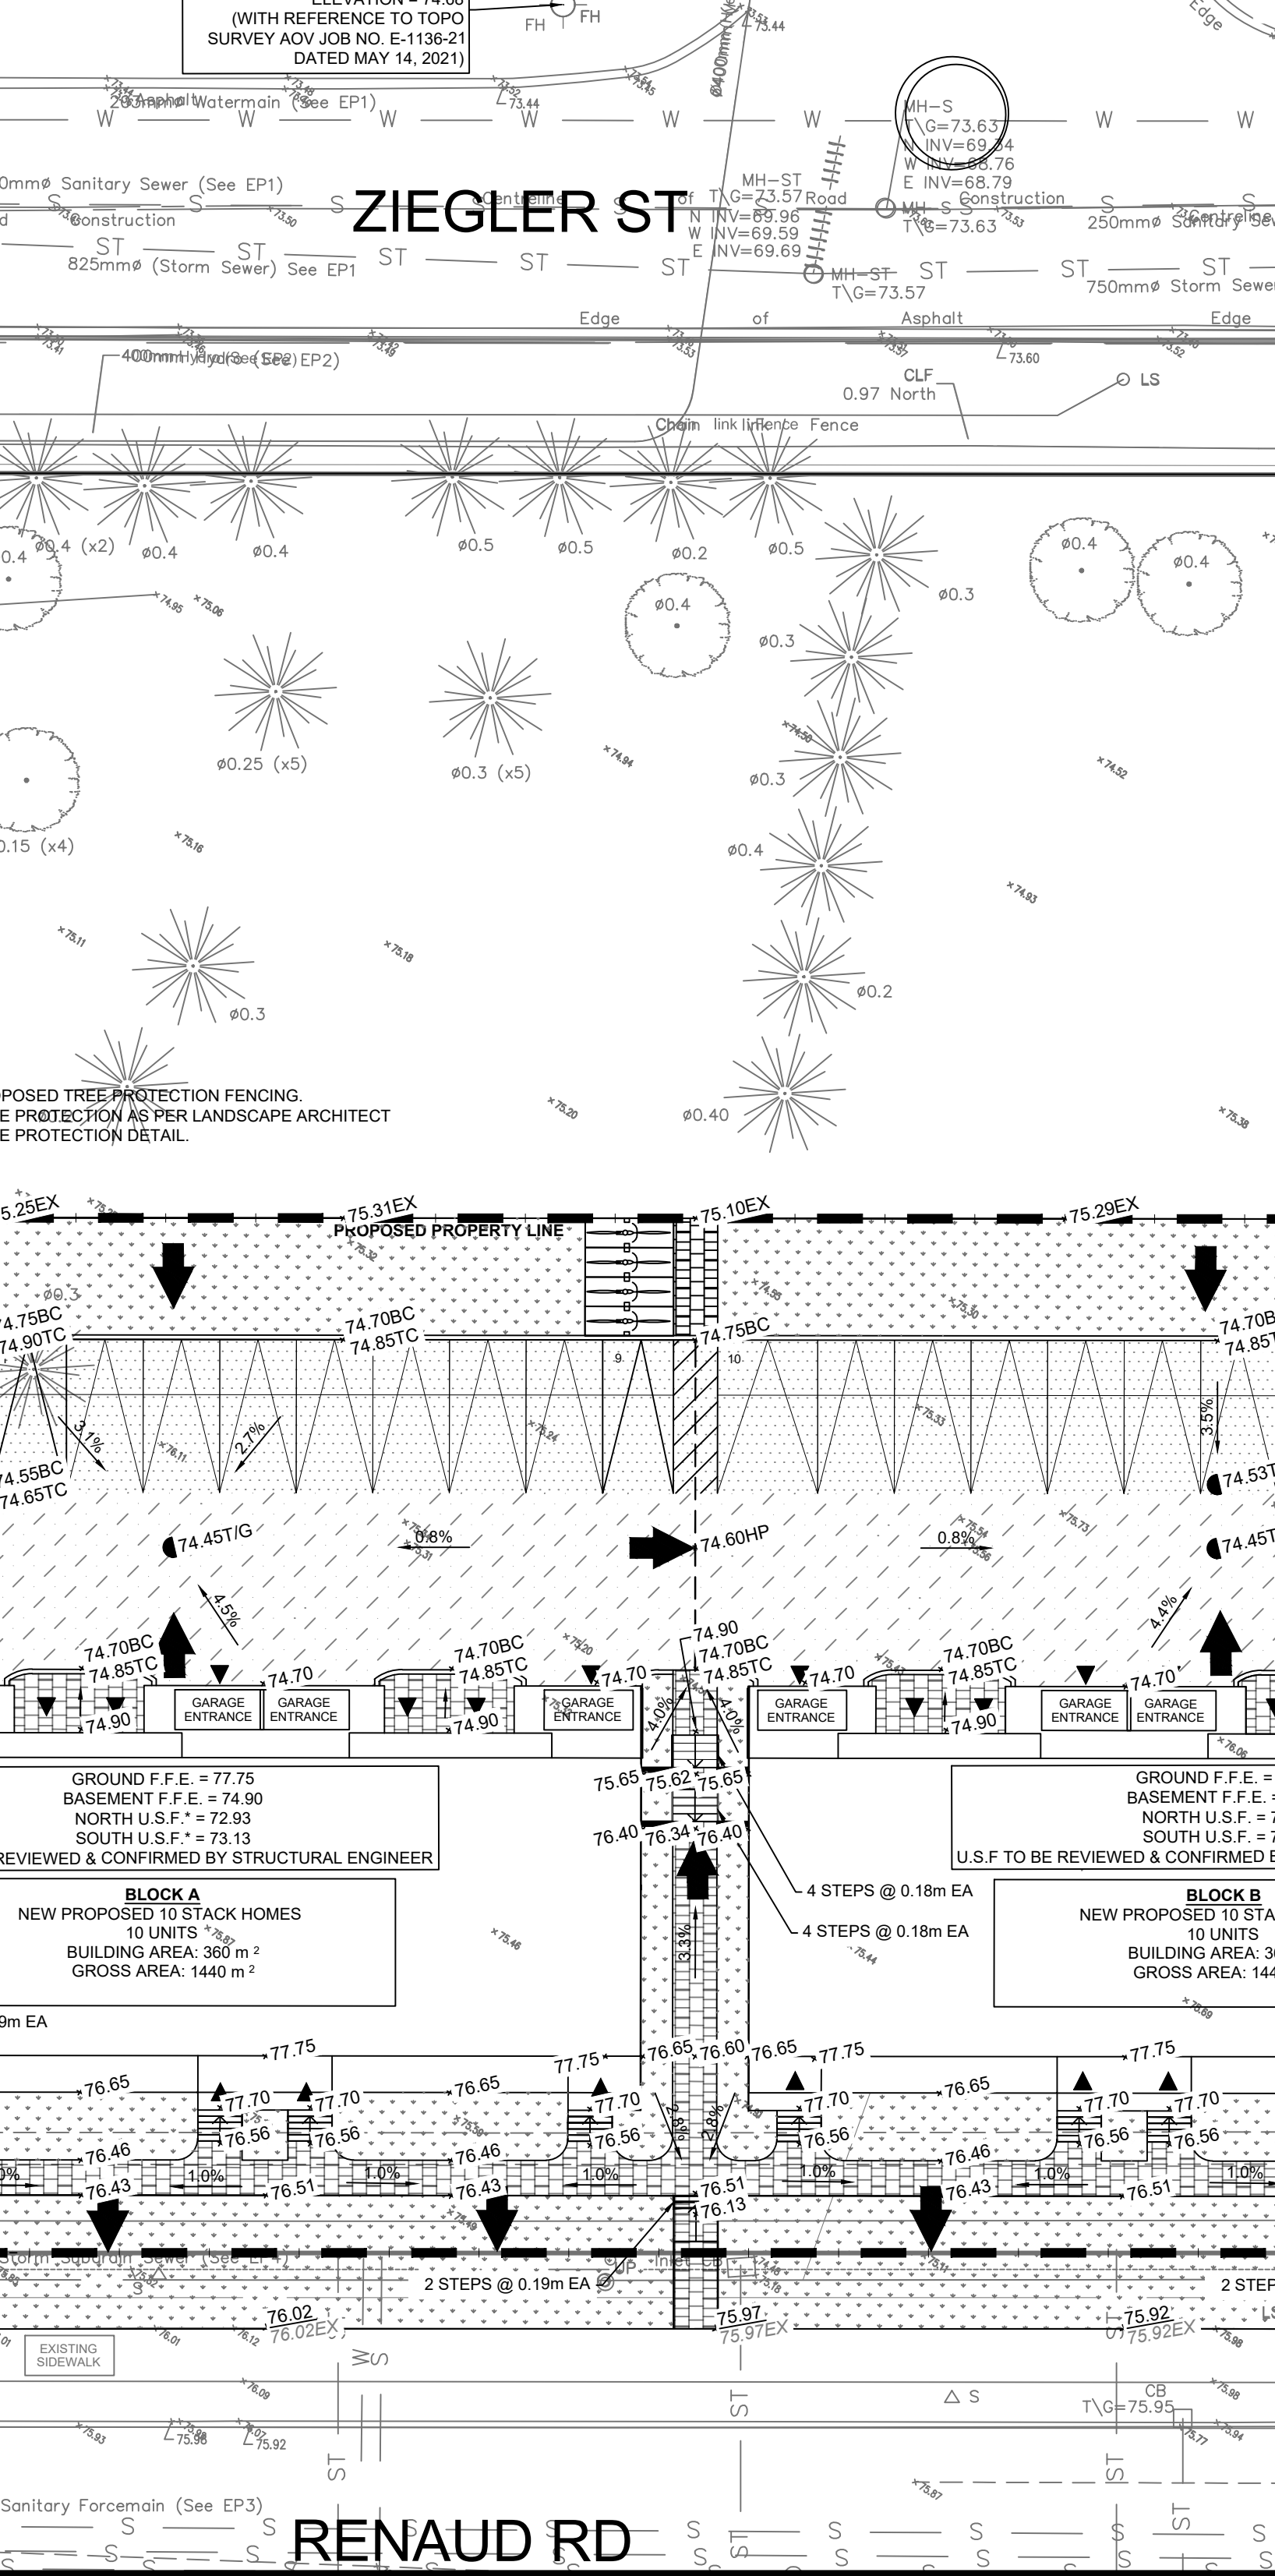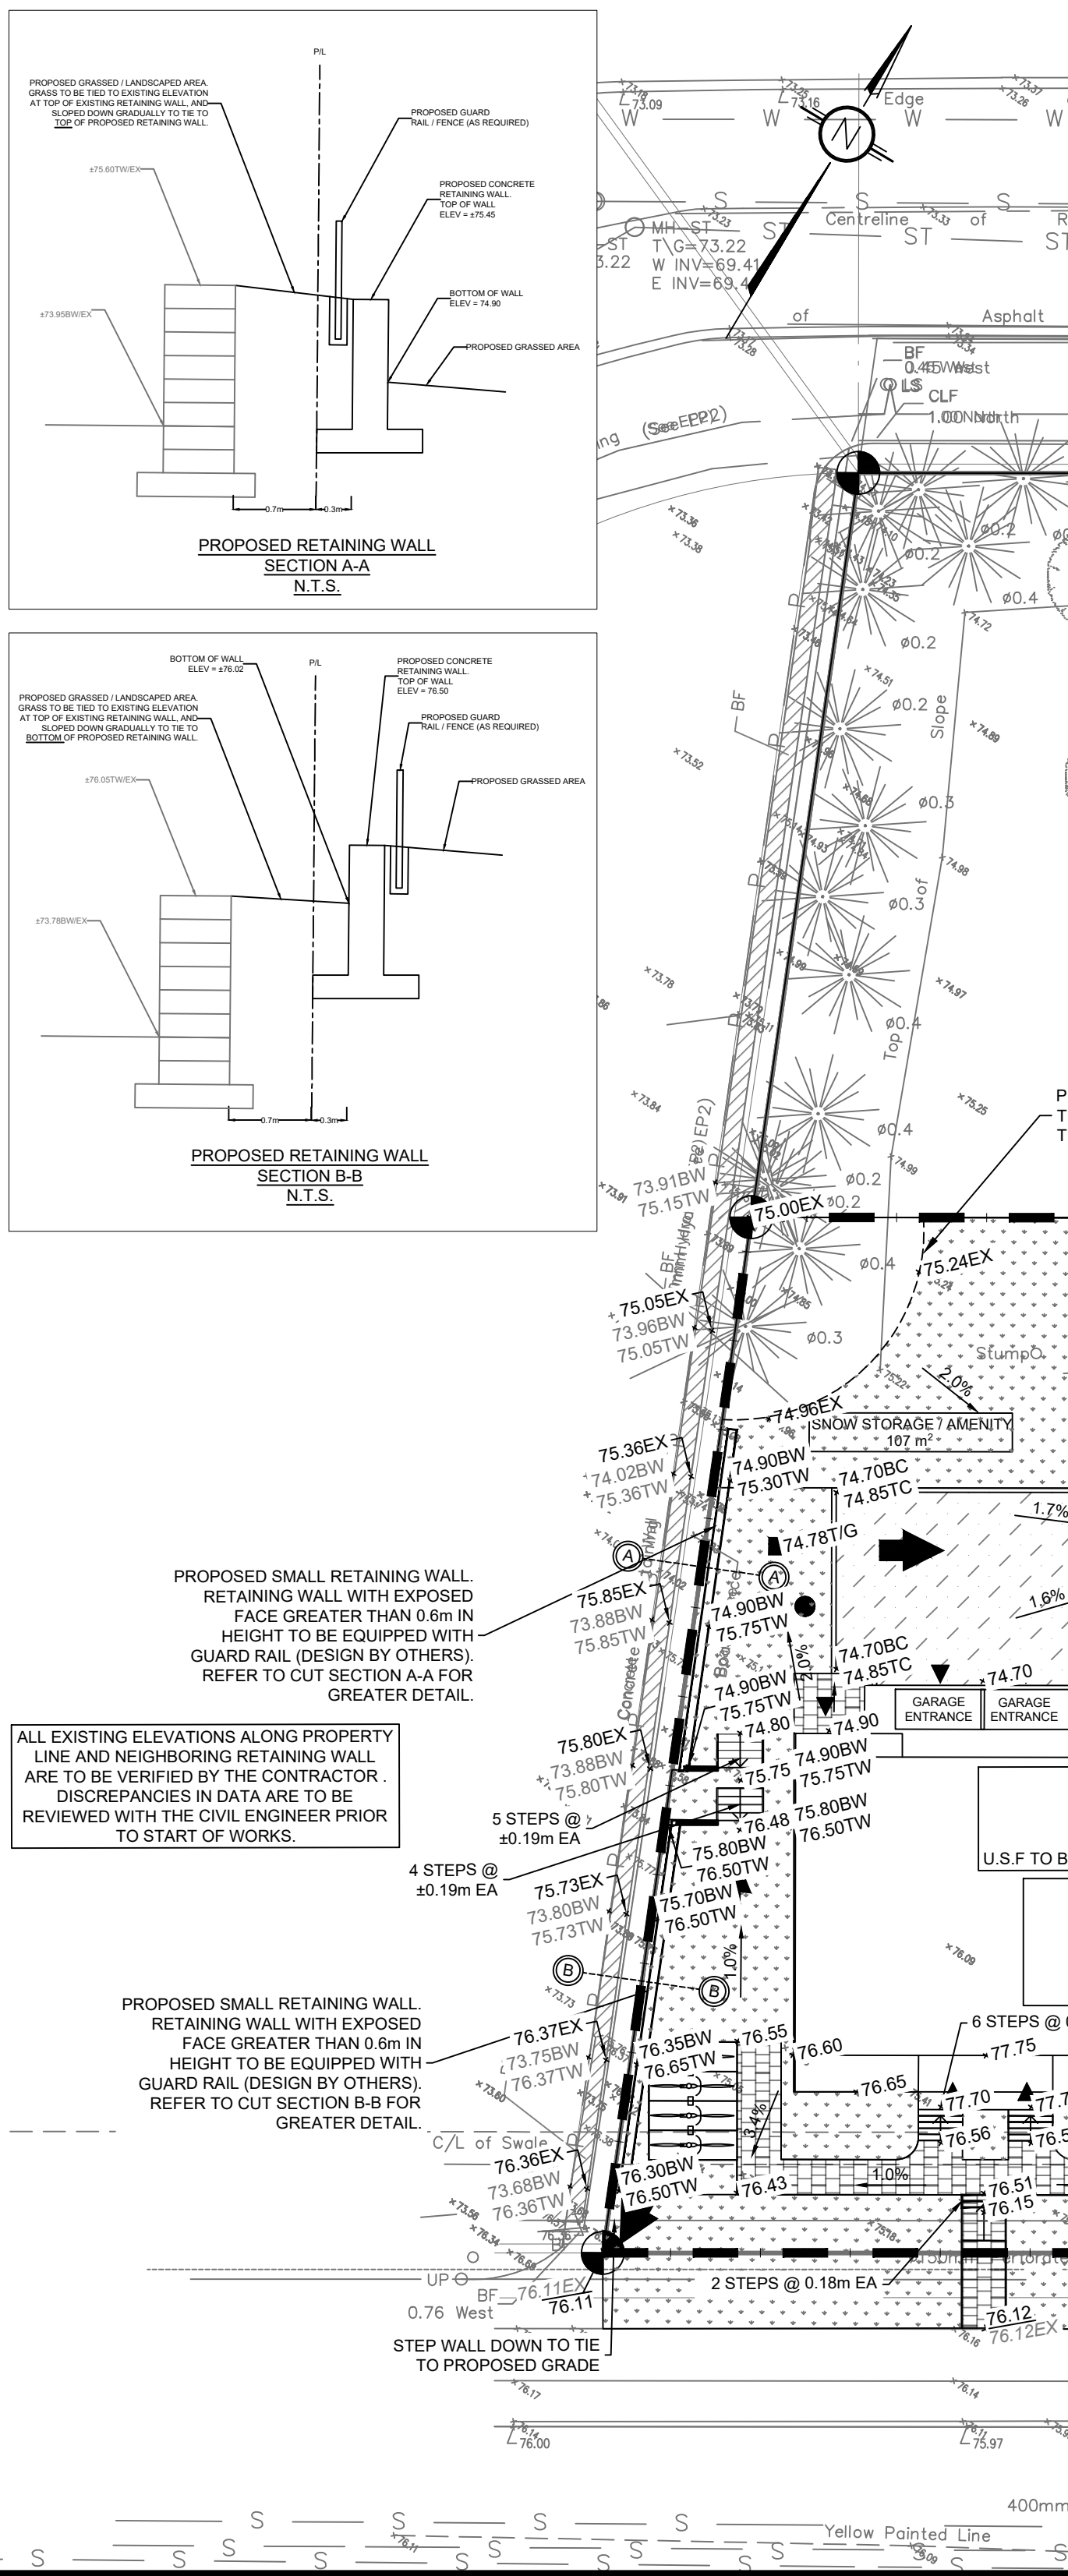

LEGEND:

	EXISTING PROPERTY LINE TO REMAIN
	PROPOSED CURB
	PROPOSED DEPRESSED CURB
	PROPOSED TERRACING (3:1 MIN.)
	PROPOSED SILT FENCE AS PER OPSD 219.110
	PROPOSED FENCE
	PROPOSED DOOR ENTRANCE/EXIT
	PROPOSED GRASS AREA (100mm TOP SOIL & SOD)
	PROPOSED CONCRETE FEATURES/SLAB
	PROPOSED HEAVY DUTY ASPHALT
	PROPOSED LIGHT DUTY ASPHALT
	PROPOSED RIP RAP
	PROPOSED ELEVATION
	PROPOSED HIGH POINT ELEVATION
	PROPOSED SWALE ELEVATION
	PROPOSED BOTTOM OF CURB / ASPHALT ELEVATION
	PROPOSED TOP OF CURB ELEVATION
	PROPOSED EXPOSED BOTTOM OF RETAINING WALL
	PROPOSED TOP OF RETAINING WALL
	MATCH INTO EXISTING ELEVATION
	EXISTING ELEVATION
	EXISTING OVERLAND MAJOR FLOW ROUTE
	PROPOSED OVERLAND MAJOR FLOW ROUTE
	PROPOSED STORM SEWER
	PROPOSED SANITARY SEWER
	PROPOSED WATERMAIN
	PROPOSED 150mm SAN SERVICE
	PROPOSED STM SERVICE
	PROPOSED 25mm PEX WTR SERVICE
	EXISTING STORM SEWER
	EXISTING SANITARY SEWER
	EXISTING WATERMAIN
	EXISTING MANHOLE
	EXISTING CATCHBASIN
	PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
	PROPOSED MANHOLE
	PROPOSED CURB STOP
	PROPOSED PIPE INSULATION
	PROPOSED CLAY SEAL AS PER CITY DETAIL S8
	PROPOSED 100 YEAR HIGH WATER LEVEL
	STORM WATERSHED EXTENT
	WATERSHED NAME
	RUNOFF COEFFICIENT
	AREA IN HECTARES

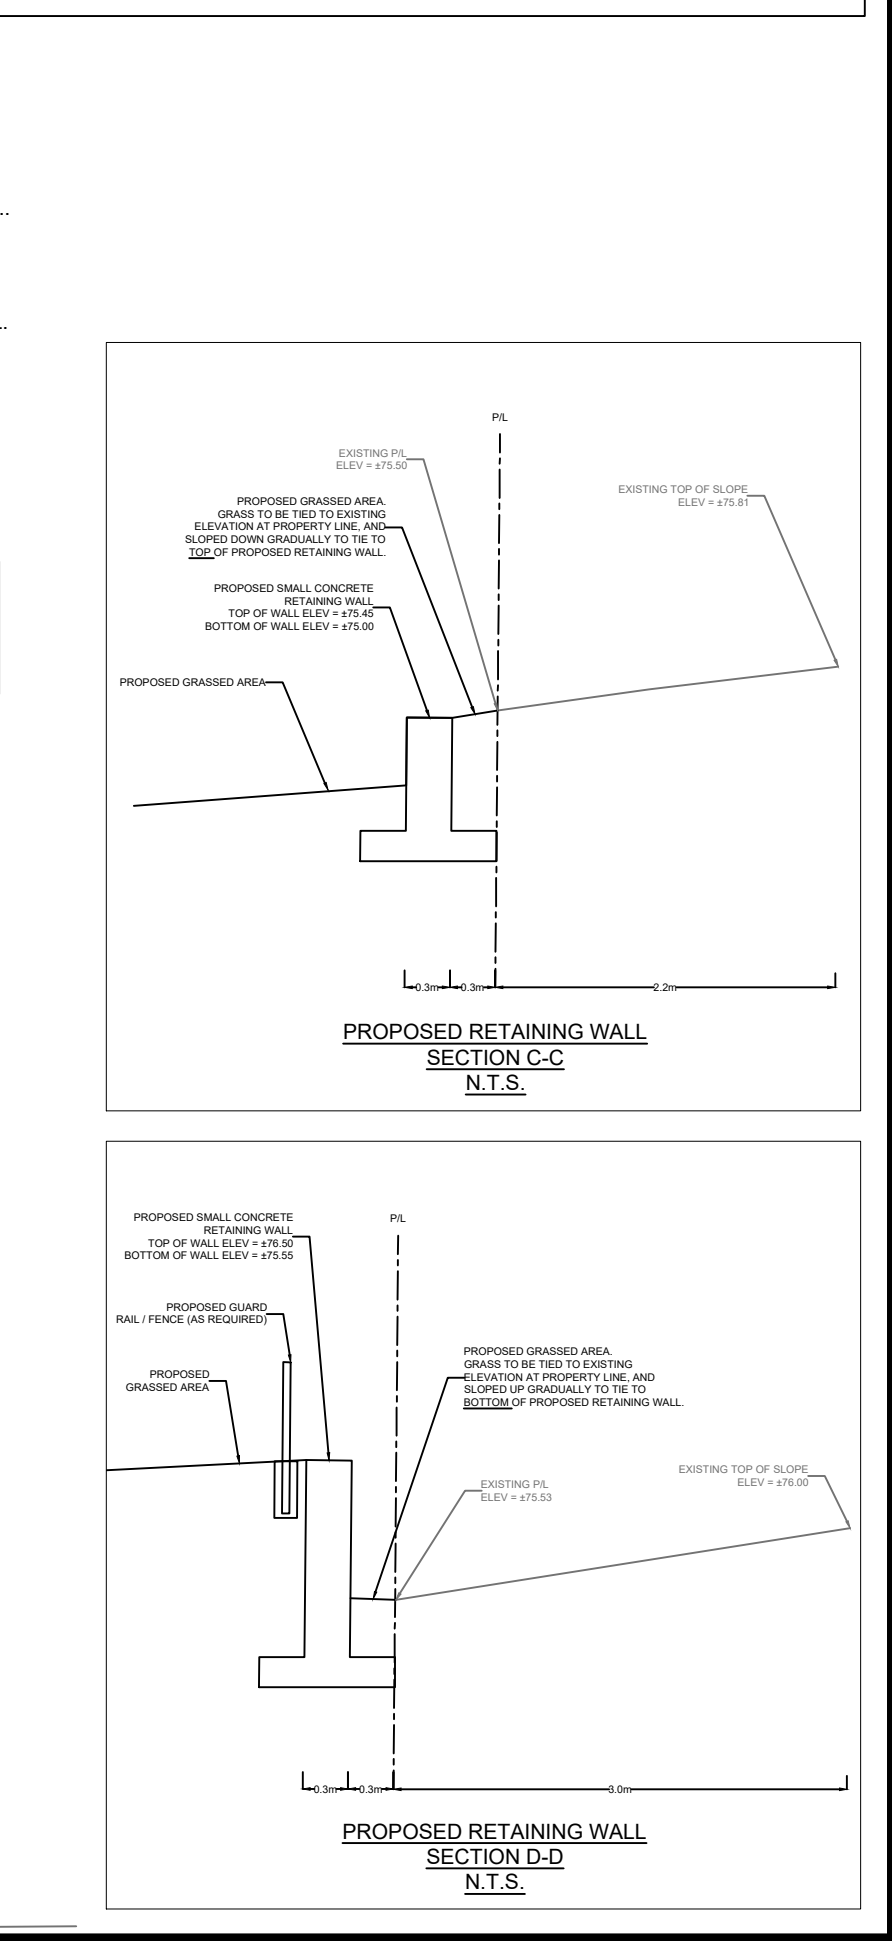

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE USE AND INTENT OF THE DRAWINGS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITY.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE METHOD TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE CONTRACT PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY IRL ASSOCIATES LTD. (IRL) WITHOUT OBTAINING IRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST IRL AND TO RELEASE IRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS IRL FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COSTS OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO IRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF IRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH IRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY FOR LOCATION AND DEPTH OF EXISTING SERVICES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND NOTES. CONTRACTOR SHALL ASSUME FULL RESPONSIBILITY FOR ANY PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

SUBJECT TO APPROVAL

No.	REVISIONS	BY	DATE
05	ISSUED FOR MUNICIPAL APPROVAL	K.H.	24 JUL 2024
04	ISSUED FOR MUNICIPAL APPROVAL	K.H.	23 APR 2024
03	ISSUED FOR MUNICIPAL APPROVAL	K.H.	19 DEC 2023
02	ISSUED FOR MUNICIPAL APPROVAL	K.H.	09 JUN 2023
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	24 DEC 2021

PROFESSIONAL ENGINEER
V. JOHNSON
100510576
07-24-2024
PROVINCE OF ONTARIO

NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
ENGINEERING | INGÉNIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: **LANDRIC HOMES**
1173 CYRVILLE RD, SUITE 202,
OTTAWA ON K1J 756

DESIGNED BY: K.H. DRAWN BY: K.H. APPROVED BY: V.J.

PROJECT: **NAVAN STOKED TOWN HOMES**
6001/6005 RENAUD RD,
OTTAWA, ONTARIO

DRAWING TITLE: **GRADING AND DRAINAGE PLAN**

PROJECT NO: 210216
DATE: NOVEMBER 2021

C301

PLAN # 18659

CITY FILE # D07-12-21-0239



PIPE CROSSING TABLE (+)						
CROSSING ID	PROP. 150mm WTR SERV INV	PROP. 150mm SAN SERV OBV	EX. 250mm SAN SWR OBV	EX. 750mm STM SWR OBV	EX. 750mm STM SWR INV	CLEARANCE (m)
1	70.81		69.18			1.63
2	71.14			70.64		0.50
3		69.22			69.89	0.77

LEGEND:

- EXISTING PROPERTY LINE TO REMAIN
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MIN.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED FENCE
- PROPOSED DOOR ENTRANCE/EXIST
- PROPOSED GRASS AREA (100mm TOP SOIL & SOD)
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY DUTY ASPHALT
- PROPOSED LIGHT DUTY ASPHALT
- PROPOSED RIP RAP
- PROPOSED ELEVATION
- PROPOSED HIGH POINT ELEVATION
- PROPOSED SWALE ELEVATION
- PROPOSED BOTTOM OF CURB / ASPHALT ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- PROPOSED EXPOSED BOTTOM OF RETAINING WALL
- PROPOSED TOP OF RETAINING WALL
- MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- EXISTING OVERLAND MAJOR FLOW ROUTE
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- PROPOSED 135mm SAN SERVICE
- PROPOSED STM SERVICE
- PROPOSED 25mm PEX WTR SERVICE
- EXISTING STORM SEWER
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED MANHOLE
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED CLAY SEAL AS PER CITY DETAIL S8
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES

CONTRACTOR TO FIELD VERIFY ALL SEWER / MAIN ELEVATIONS. ANY DISCREPANCIES IN DATA ARE TO BE REVIEWED WITH THE CIVIL ENGINEER PRIOR TO SERVICE INSTALLATION.

CONNECTION TO EXISTING 250mmØ AS PER CITY STD S11. EX SAN SWR INV = +68.93 OBVERT TO OBVERT CONNECTION PROP. SAN SERV INV = 69.03

PIPE CROSSING 3 EX STM SWR INV = +69.89 PROP SAN SERV OBV = 69.22 CLEARANCE = 0.77m

PROP CONNECTION TO EXISTING 750mmØ STM SEWER EX STM SWR INV = +69.89 EX STM SWR SL ELEV = +70.27 PROP. STM SERV INV = 70.27

PROP CONNECTION TO 203mmØ WATERMAIN BY CITY FORCES. EXCAVATION AND REINSTATEMENT BY CONTRACTOR EX. WTR MAIN OBV = +70.96 PROP. WTR SERV OBV = 70.96 TOP OF GRADE = +73.45

PIPE CROSSING 1 EX SAN SWR OBV = +69.18 PROP WTR SERV INV = 70.81 CLEARANCE = 1.63m

PIPE CROSSING 2 EX STM SWR OBV = +70.64 PROP WTR SERV INV = 71.14 CLEARANCE = 0.50m

PROP. AUTOMATIC FLUSHING CHAMBER AS PER CITY OF OTTAWA DETAIL W3.2 PROP. 21.5m - 300mmØ PVC-DR35 STM SERVICE @ 5.50% SLOPE PROP. 23.7m - 150mmØ PVC-DR28 SAN SERVICE @ 2.00% SLOPE

PROP. SAN MH01 COVER AS PER S24 TIG = 74.58 NW INV = 69.50 SE INV = 70.08

PROP. STM MH01 COVER AS PER S24.1 TIG = 74.60 NW INV = 71.44 SE INV = 71.47 NW INV TO BE EQUIPPED W/ HYDROVEX 50VHV-1 VERTICAL VORTEX FLOW REGULATOR DESIGN HEAD = 3.10m MAX FLOW RATE = 5.00L/s

PROP. 13.3m - 300mmØ PVC-DR35 STM SERVICE @ 0.50% SLOPE

PROP. 24.6m - 150mmØ PVC-DR28 SAN SERVICE @ 1.50% SLOPE

PROP. STM CBMH02 COVER AS PER S28.1 TIG = 74.80 NW INV = 71.54 SE INV = 71.57


PROP. 9.2m - 300mmØ PVC-DR35 STM SERVICE @ 0.50% SLOPE

PROP. STM MH03 COVER AS PER S24.1 TIG = 74.55 NW INV = 71.62 SW INV = 71.68

PROP. SAN MH02 COVER AS PER S24 TIG = 74.80 N INV = 70.39 SW INV = 70.45

ZIEGLER ST

PROPOSED STORMTECH MC-3500 UNDERGROUND STORMWATER STORAGE CHAMBERS (OR APPROVED EQUIVALENT). STORAGE VOLUME PROVIDED = 112.53m³ MAX LENGTH = 23.67m, MAX WIDTH = 4.68m REFER TO C901 & SMM REPORT FOR GREATER DETAIL.

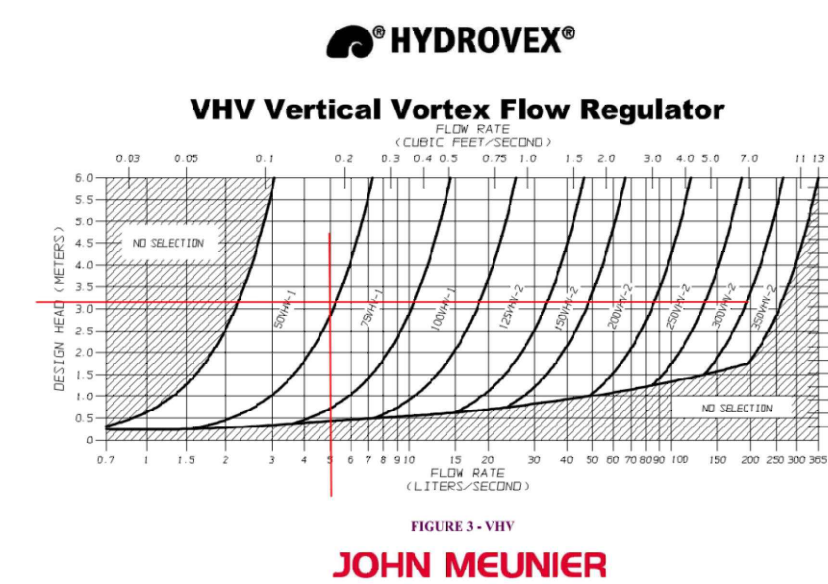

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE SCOPE AND INTENT OF THE DRAWING. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITY AND FOR OBTAINING ALL NECESSARY INFORMATION FROM THE LOCAL AUTHORITY AND FOR OBTAINING ALL NECESSARY INFORMATION FROM THE LOCAL AUTHORITY AND FOR OBTAINING ALL NECESSARY INFORMATION FROM THE LOCAL AUTHORITY.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO THESE DRAWINGS, THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITY AND FOR OBTAINING ALL NECESSARY INFORMATION FROM THE LOCAL AUTHORITY AND FOR OBTAINING ALL NECESSARY INFORMATION FROM THE LOCAL AUTHORITY.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROVALS IN LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

SUBJECT TO APPROVAL

No.	REVISIONS	BY	DATE
05	ISSUED FOR MUNICIPAL APPROVAL	K.H.	24 JUL 2024
04	ISSUED FOR MUNICIPAL APPROVAL	K.H.	23 APR 2024
03	ISSUED FOR MUNICIPAL APPROVAL	K.H.	19 DEC 2023
02	ISSUED FOR MUNICIPAL APPROVAL	K.H.	09 JUN 2023
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	24 DEC 2021

LICENCED PROFESSIONAL ENGINEER
V. JOHNSON
100510576
07-24-2024
PROVINCE OF ONTARIO

NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: **LANDRIC HOMES**
1173 CYRVILLE RD, SUITE 202,
OTTAWA ON K1J 7S6

DESIGNED BY: K.H. DRAWN BY: K.H. APPROVED BY: V.J.


PROJECT: **NAVAN STACKED TOWN HOMES**
6001/6005 RENAUD RD,
OTTAWA, ONTARIO

DRAWING TITLE: **SERVICING PLAN**


PROJECT NO: 210216

DATE: NOVEMBER 2021

C401

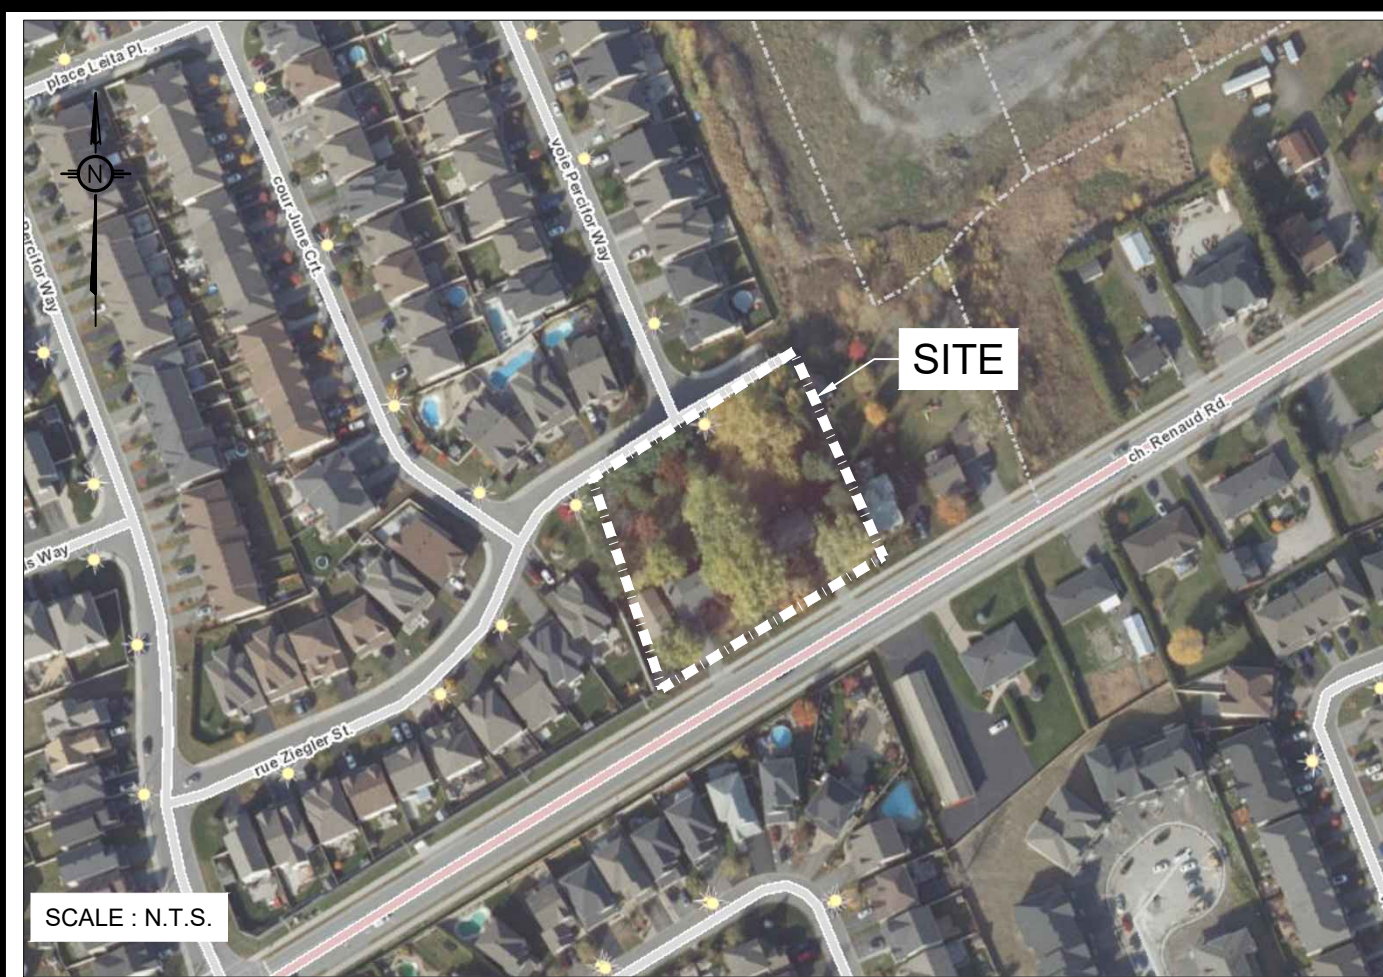

SCALE: N.T.S.

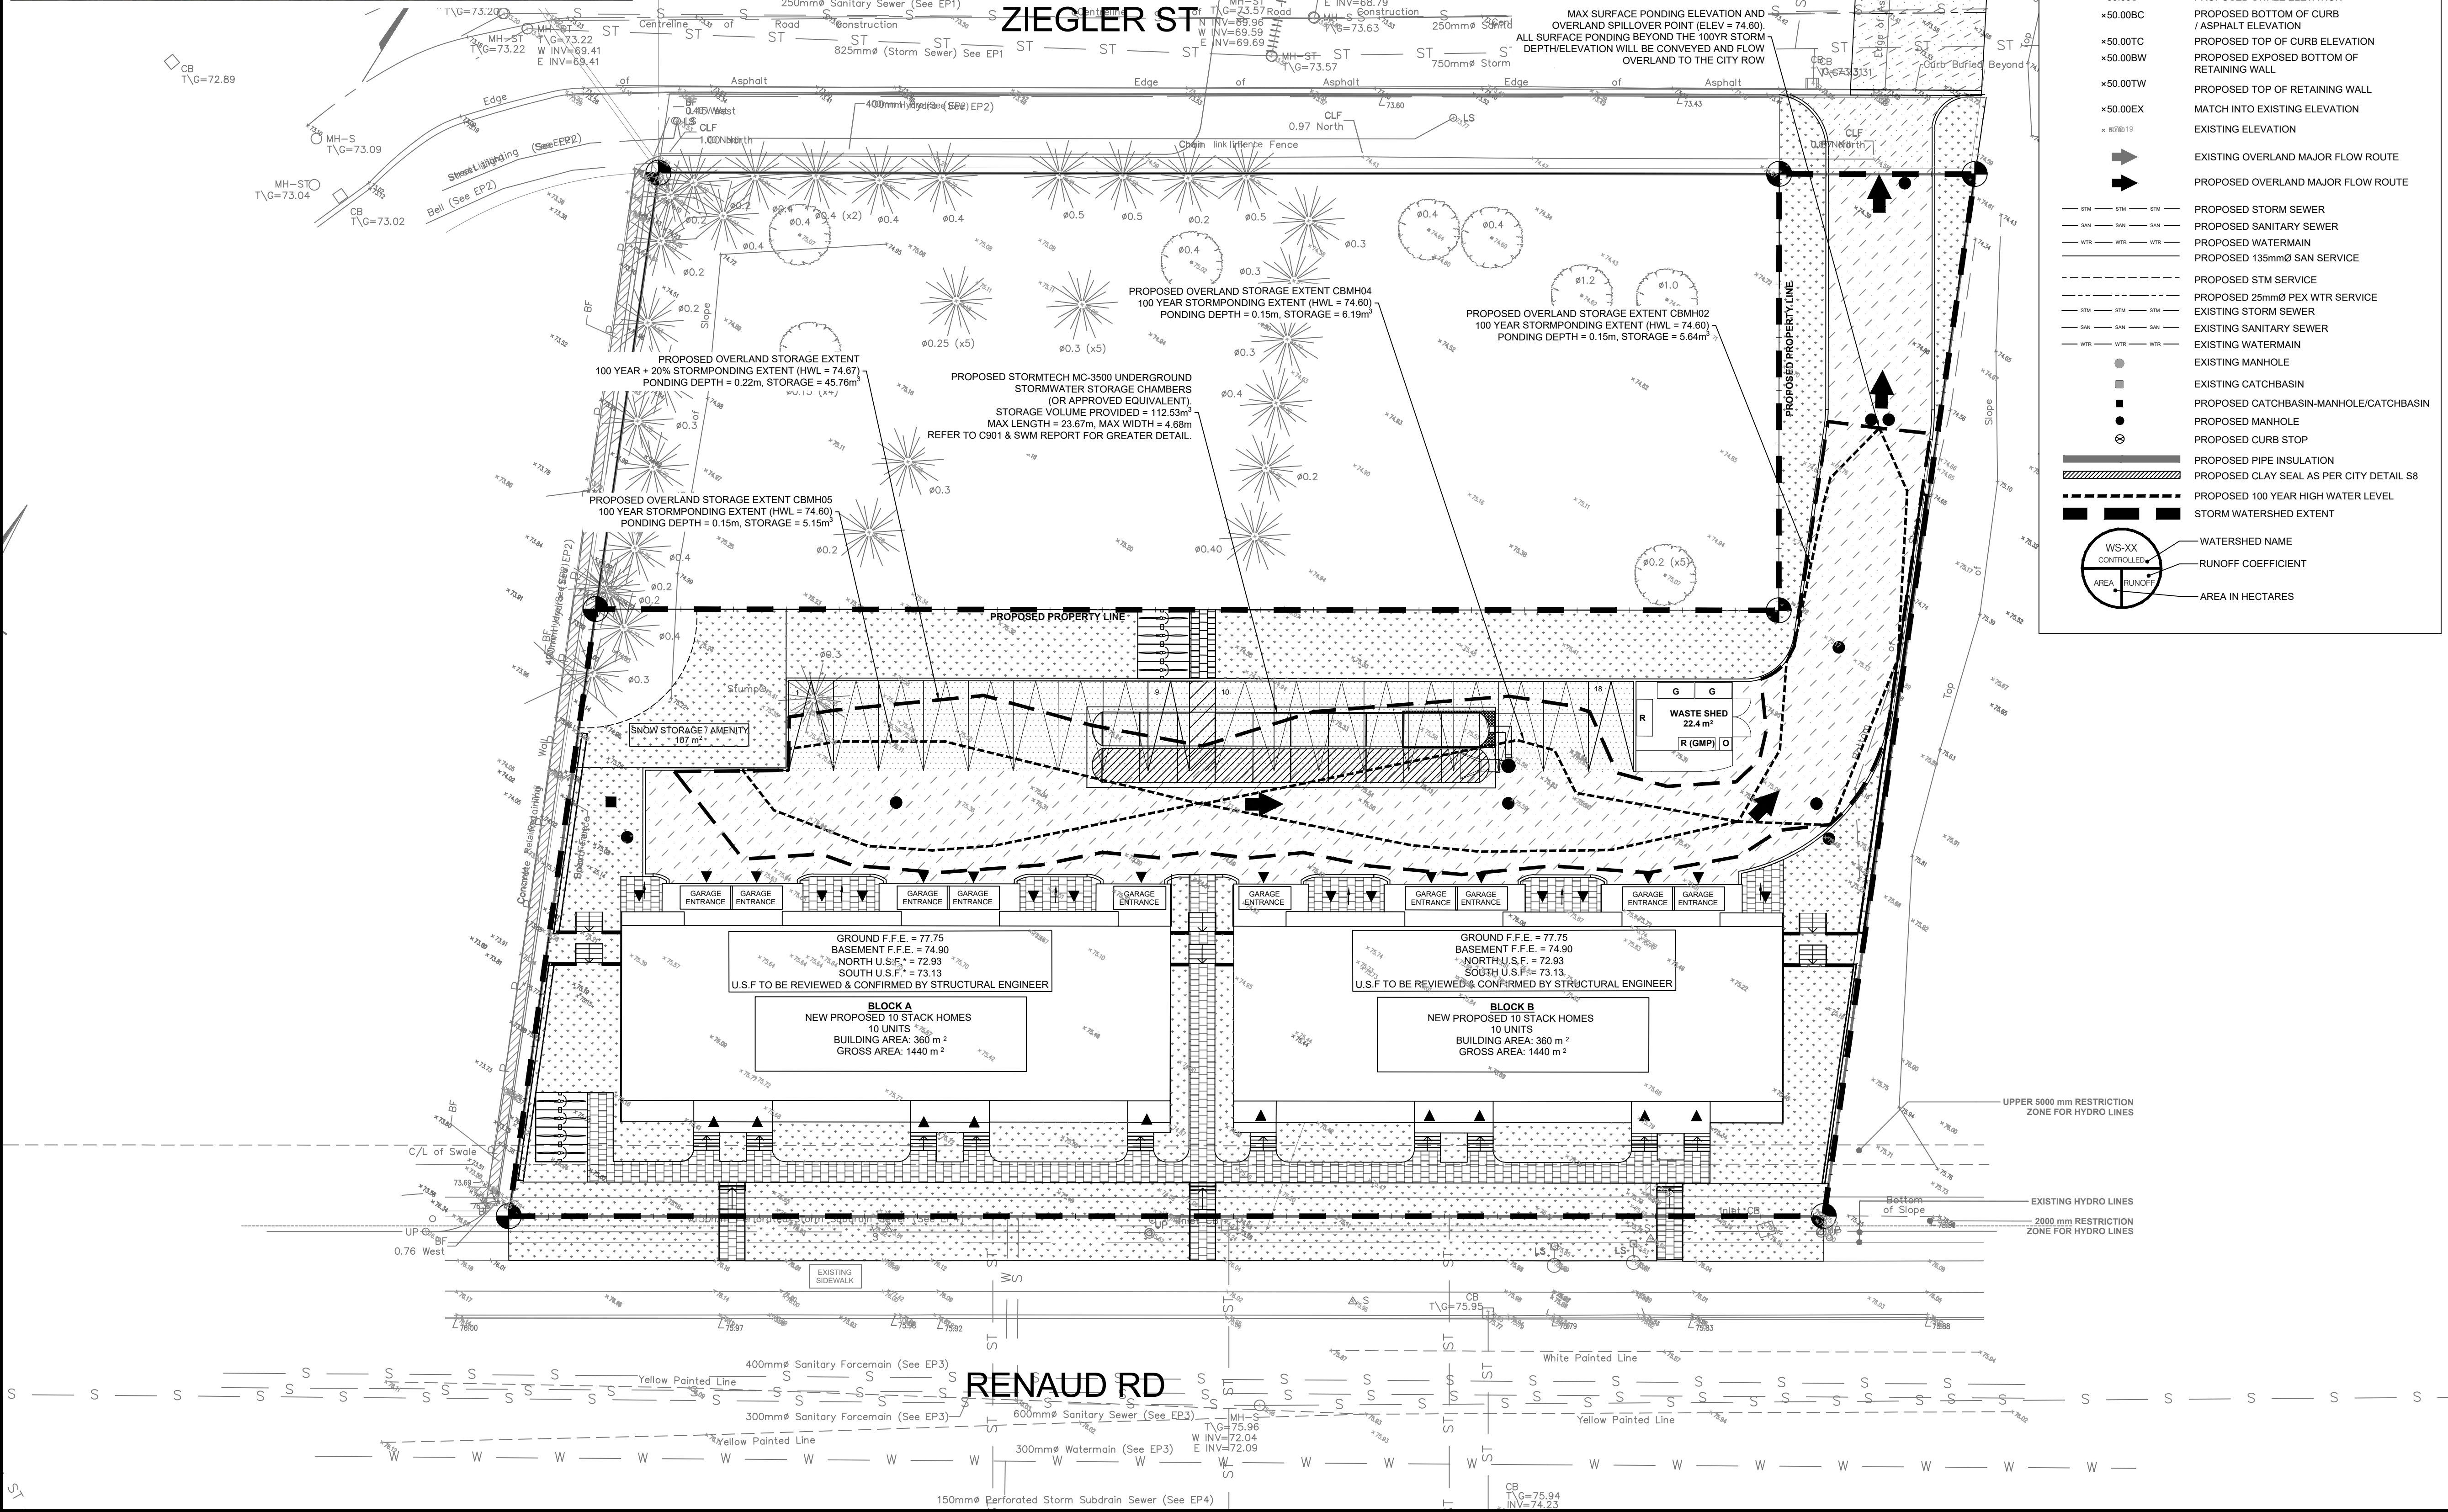

LEGEND:

- EXISTING PROPERTY LINE TO REMAIN
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MIN.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED FENCE
- PROPOSED DOOR ENTRANCE/EXIST
- PROPOSED GRASS AREA (100mm TOP SOIL & SOD)
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY DUTY ASPHALT
- PROPOSED LIGHT DUTY ASPHALT
- PROPOSED RIP RAP
- PROPOSED ELEVATION
- PROPOSED HIGH POINT ELEVATION
- PROPOSED SWALE ELEVATION
- PROPOSED BOTTOM OF CURB / ASPHALT ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- PROPOSED EXPOSED BOTTOM OF RETAINING WALL
- PROPOSED TOP OF RETAINING WALL
- MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- EXISTING OVERLAND MAJOR FLOW ROUTE
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- PROPOSED 135mm SAN SERVICE
- PROPOSED STM SERVICE
- PROPOSED 25mm PEX WTR SERVICE
- EXISTING STORM SEWER
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED MANHOLE
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED CLAY SEAL AS PER CITY DETAIL S8
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES

GENERAL CONDITIONS OF DRAWINGS:

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE USE AND INTENT OF THE DRAWING. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITIES.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGMENT OF THE RESPONSIBILITIES AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE, THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.


GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

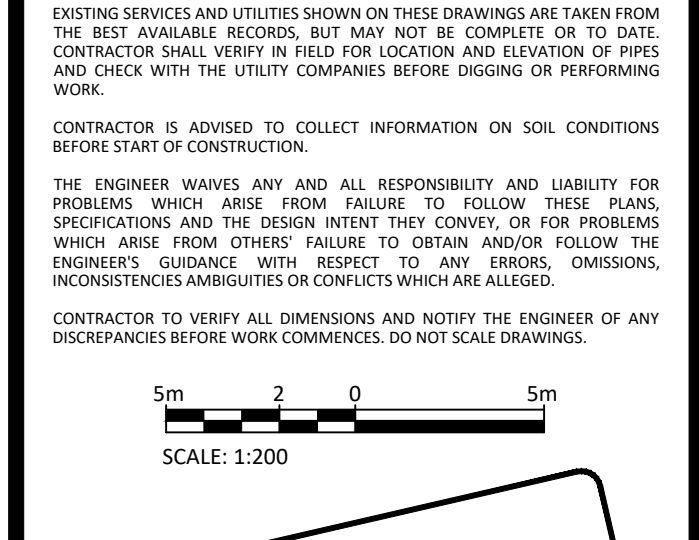

SUBJECT TO APPROVAL

No.	REVISIONS	BY	DATE
05	ISSUED FOR MUNICIPAL APPROVAL	K.H.	24 JUL 2024
04	ISSUED FOR MUNICIPAL APPROVAL	K.H.	23 APR 2024
03	ISSUED FOR MUNICIPAL APPROVAL	K.H.	19 DEC 2023
02	ISSUED FOR MUNICIPAL APPROVAL	K.H.	09 JUN 2023
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	24 DEC 2021



NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434


CLIENT: **LANDRIC HOMES**
1173 CRYVILLE RD, SUITE 202,
OTTAWA ON K1J 7S6

DESIGNED BY: K.H. DRAWN BY: K.H. APPROVED BY: V.J.

PROJECT: **NAVAN STACKED TOWN HOMES**
6001/6005 RENAUD RD,
OTTAWA, ONTARIO


DRAWING TITLE: **STORMWATER MANAGEMENT PLAN**

PROJECT NO. **210216**
DATE: **NOVEMBER 2021**

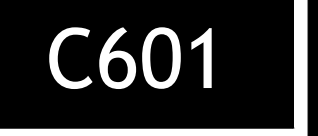


PLAN # 18659

CITY FILE # D07-12-21-0239

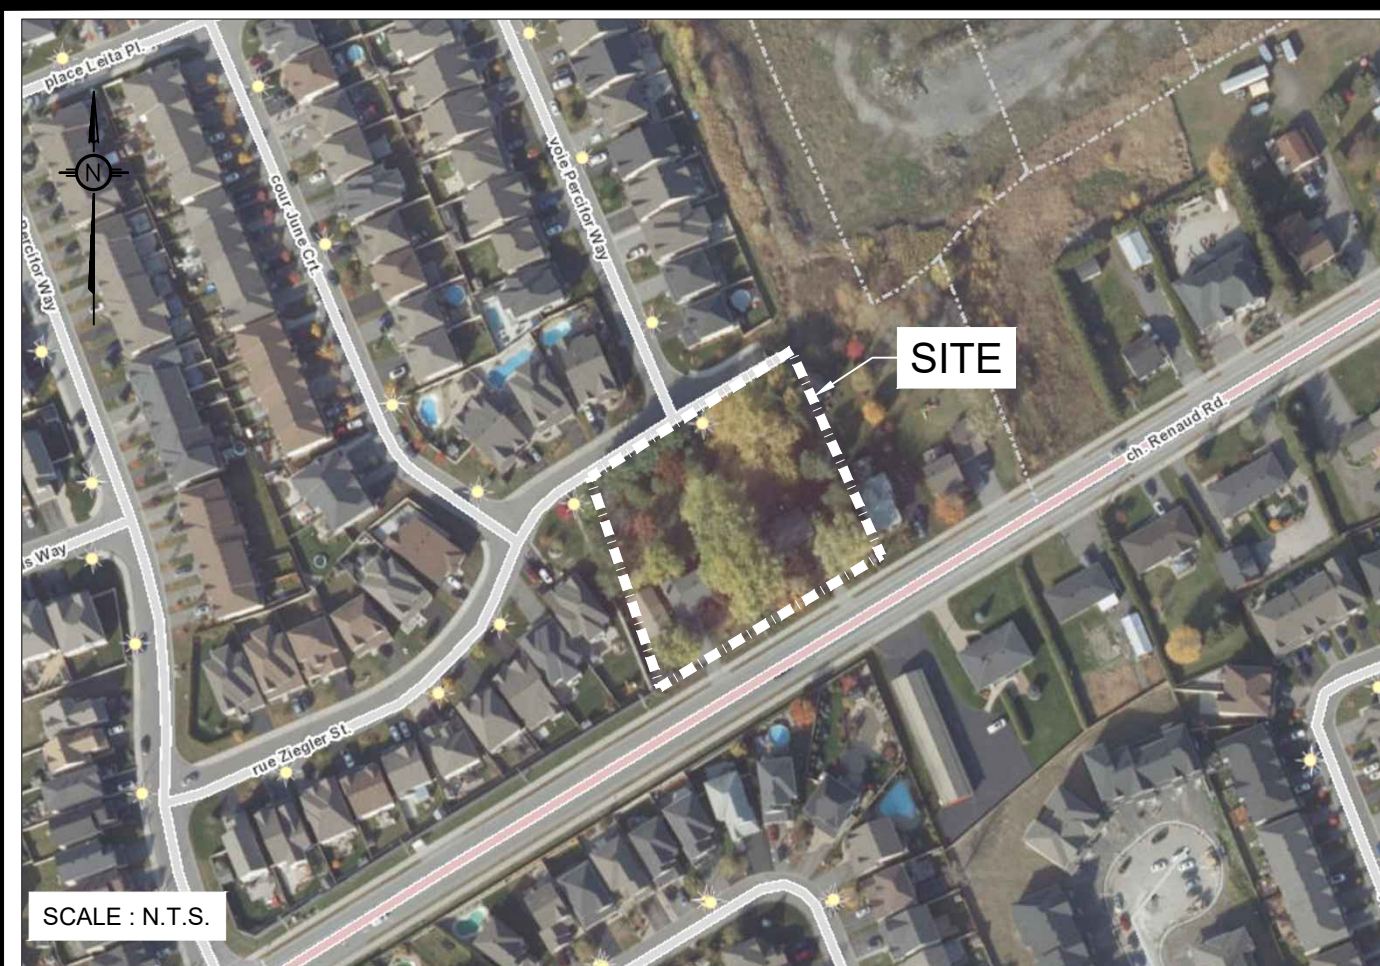

SCALE: N.T.S.

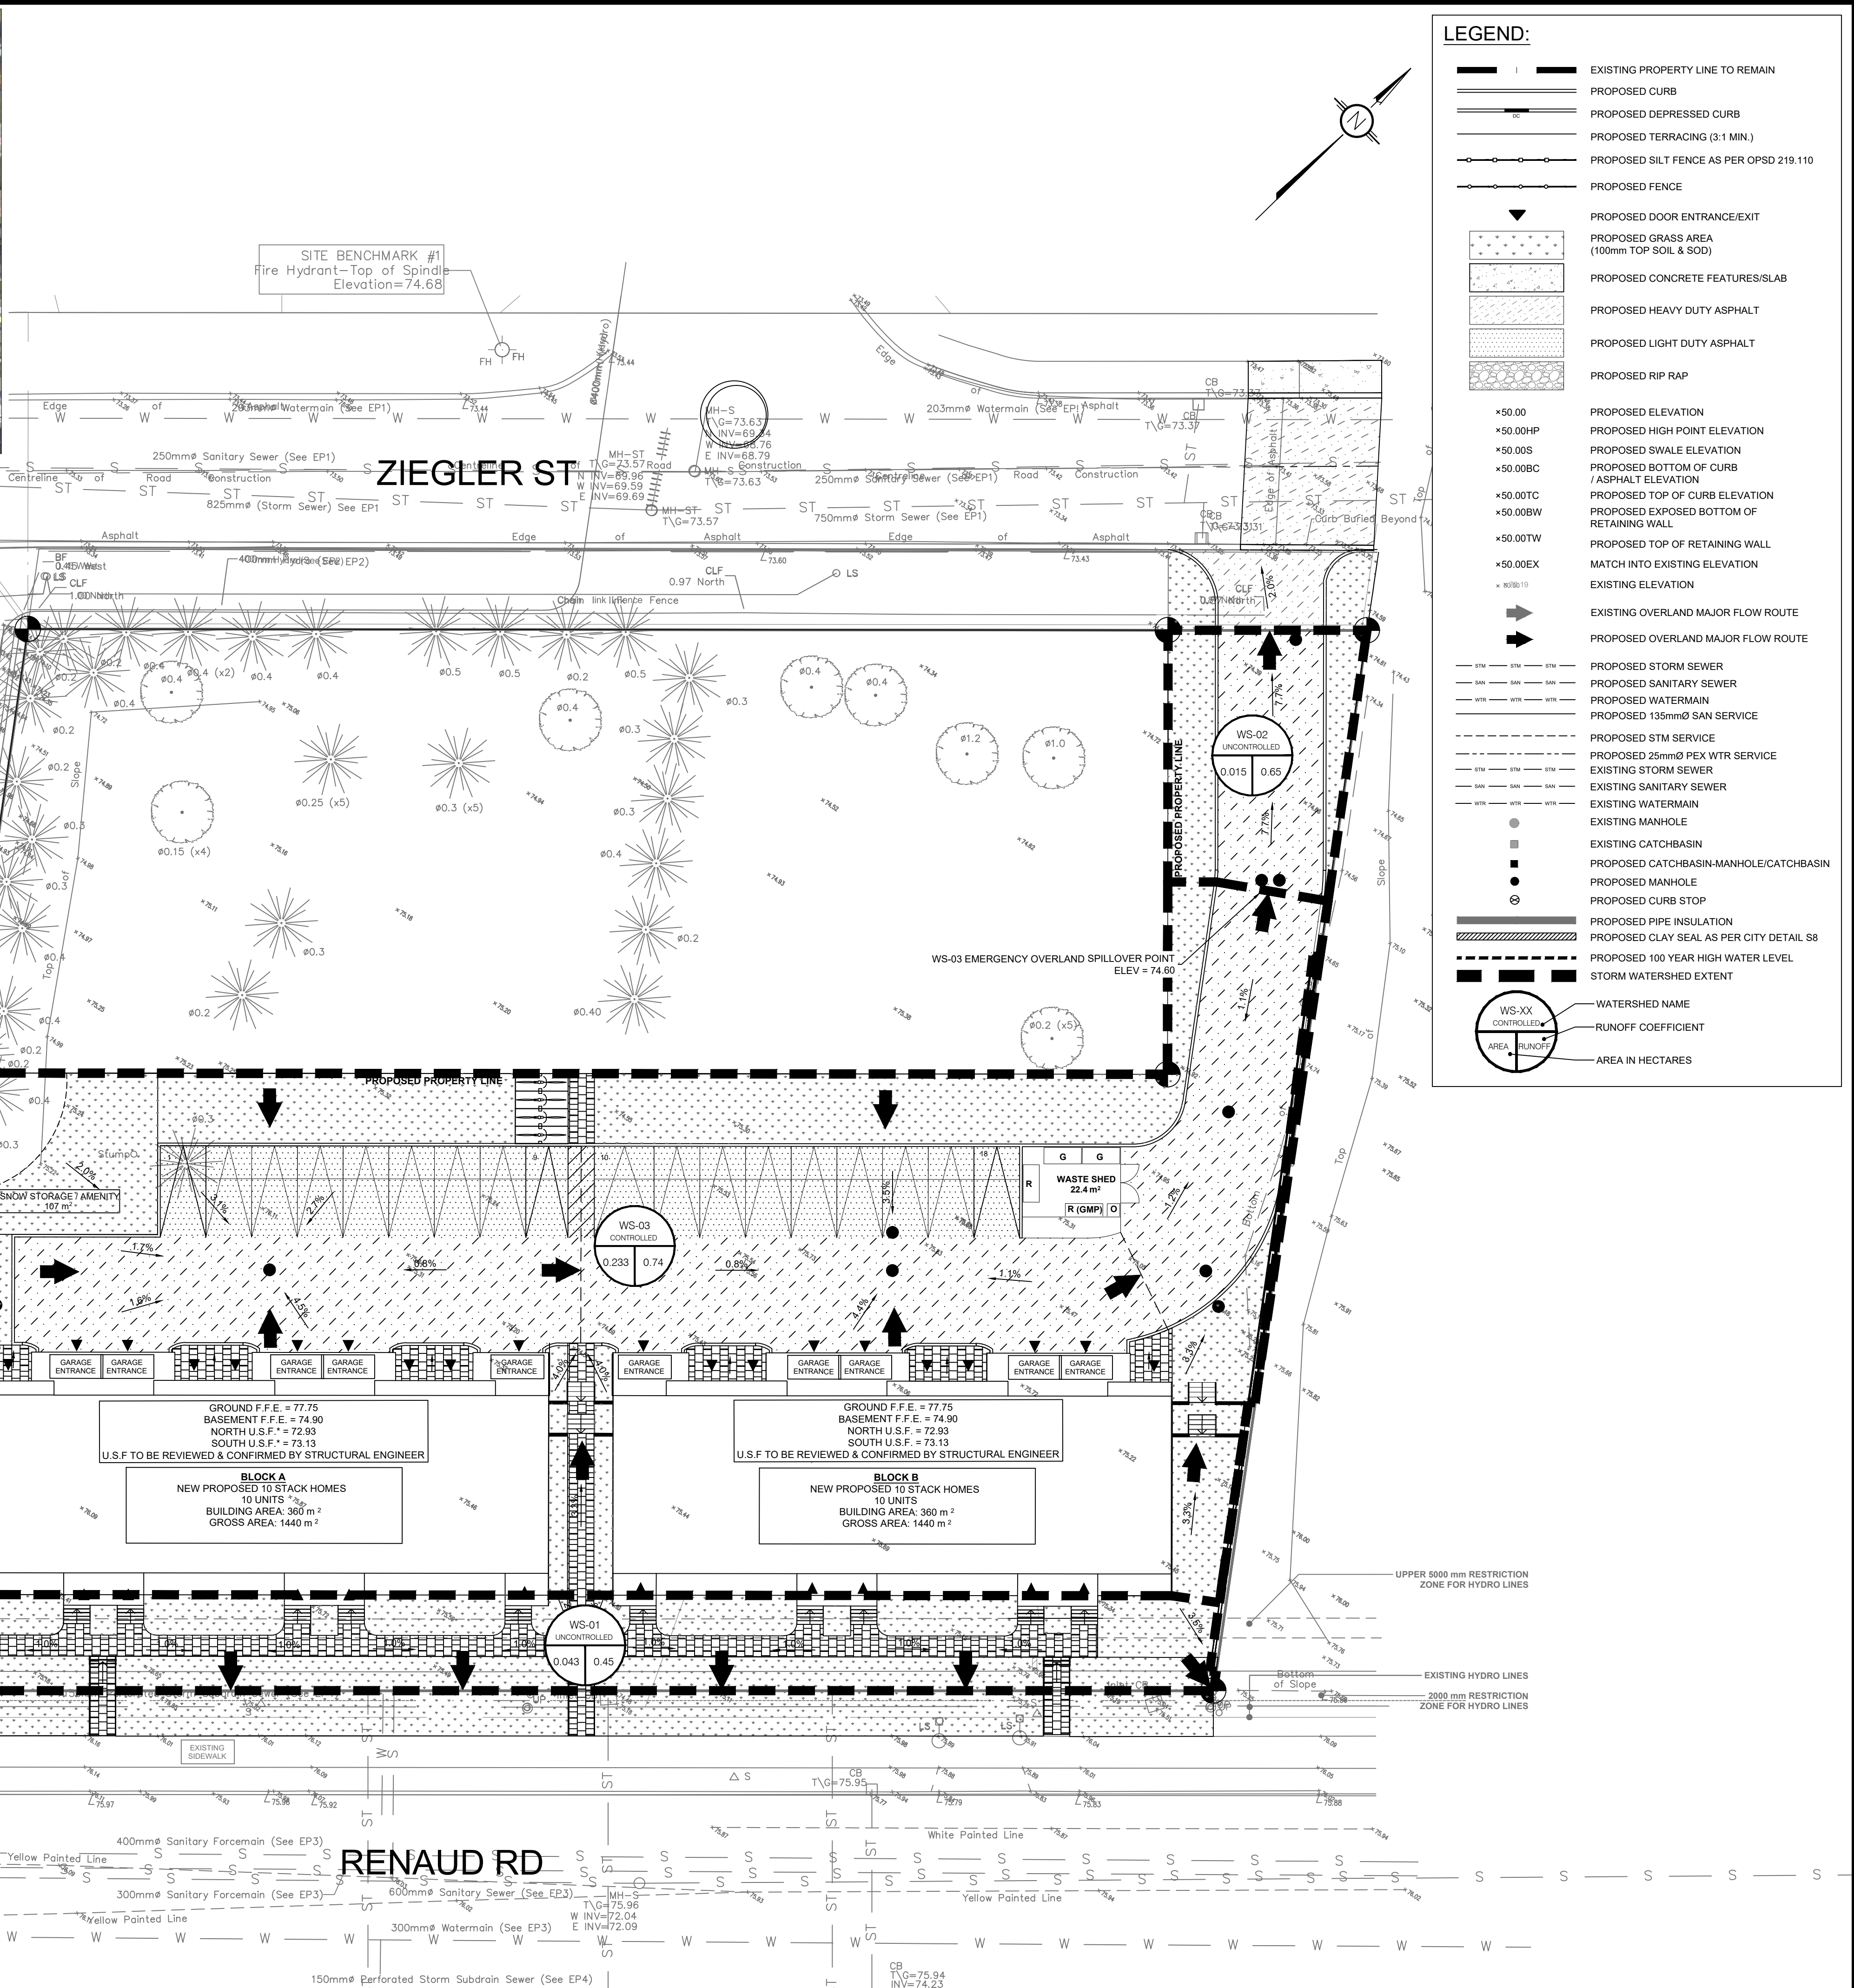

LEGEND:

	EXISTING PROPERTY LINE TO REMAIN
	PROPOSED CURB
	PROPOSED DEPRESSED CURB
	PROPOSED TERRACING (3:1 MIN.)
	PROPOSED SILT FENCE AS PER OPSD 219.110
	PROPOSED FENCE
	PROPOSED DOOR ENTRANCE/EXIST
	PROPOSED GRASS AREA (100mm TOP SOIL & SOD)
	PROPOSED CONCRETE FEATURES/SLAB
	PROPOSED HEAVY DUTY ASPHALT
	PROPOSED LIGHT DUTY ASPHALT
	PROPOSED RIP RAP
	PROPOSED ELEVATION
	PROPOSED HIGH POINT ELEVATION
	PROPOSED SWALE ELEVATION
	PROPOSED BOTTOM OF CURB / ASPHALT ELEVATION
	PROPOSED TOP OF CURB ELEVATION
	PROPOSED EXPOSED BOTTOM OF RETAINING WALL
	PROPOSED TOP OF RETAINING WALL
	EXISTING ELEVATION
	EXISTING OVERLAND MAJOR FLOW ROUTE
	PROPOSED OVERLAND MAJOR FLOW ROUTE
	PROPOSED STORM SEWER
	PROPOSED SANITARY SEWER
	PROPOSED WATERMAIN
	PROPOSED 135mm SAN SERVICE
	PROPOSED STM SERVICE
	PROPOSED 25mm PEX WTR SERVICE
	EXISTING STORM SEWER
	EXISTING SANITARY SEWER
	EXISTING WATERMAIN
	EXISTING MANHOLE
	EXISTING CATCHBASIN
	PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
	PROPOSED MANHOLE
	PROPOSED CURB STOP
	PROPOSED PIPE INSULATION
	PROPOSED CLAY SEAL AS PER CITY DETAIL S8
	PROPOSED 100 YEAR HIGH WATER LEVEL
	STORM WATERSHED EXTENT
	WATERSHED NAME
	RUNOFF COEFFICIENT
	AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS IF REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS A KNOWLEDGEABLE ACCEPTANCE OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK AND THE COST THEREOF. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY RECORDS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.


GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

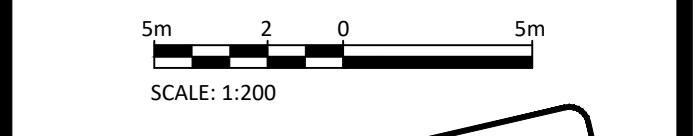

SUBJECT TO APPROVAL

No.	REVISIONS	BY	DATE
05	ISSUED FOR MUNICIPAL APPROVAL	K.H.	24 JUL 2024
04	ISSUED FOR MUNICIPAL APPROVAL	K.H.	23 APR 2024
03	ISSUED FOR MUNICIPAL APPROVAL	K.H.	19 DEC 2023
02	ISSUED FOR MUNICIPAL APPROVAL	K.H.	09 JUN 2023
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	24 DEC 2021



NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ

ENGINEERING | INGÉNIÉRIE

5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: **LANDRIC HOMES**
1173 CYRVILLE RD, SUITE 202,
OTTAWA ON K1J 7S6

DESIGNED BY: K.H. DRAWN BY: K.H. APPROVED BY: V.J.


















PROJECT: **NAVAN STACKED TOWN HOMES**
6001/6005 RENAUD RD,
OTTAWA, ONTARIO

DRAWING TITLE: **POST-DEVELOPMENT WATERSHED PLAN**

PROJECT NO: 210216
DATE: NOVEMBER 2021
C702

CITY FILE # D07-12-21-0239

PLAN # 18659

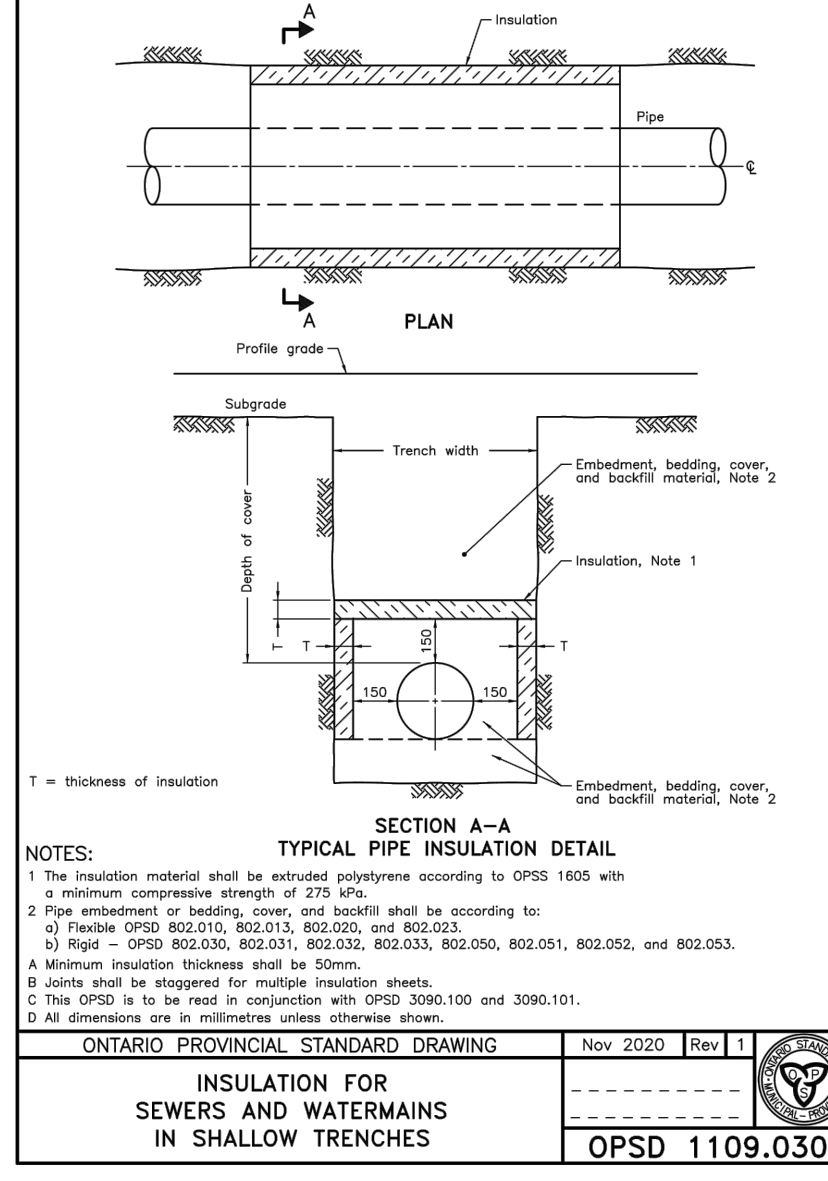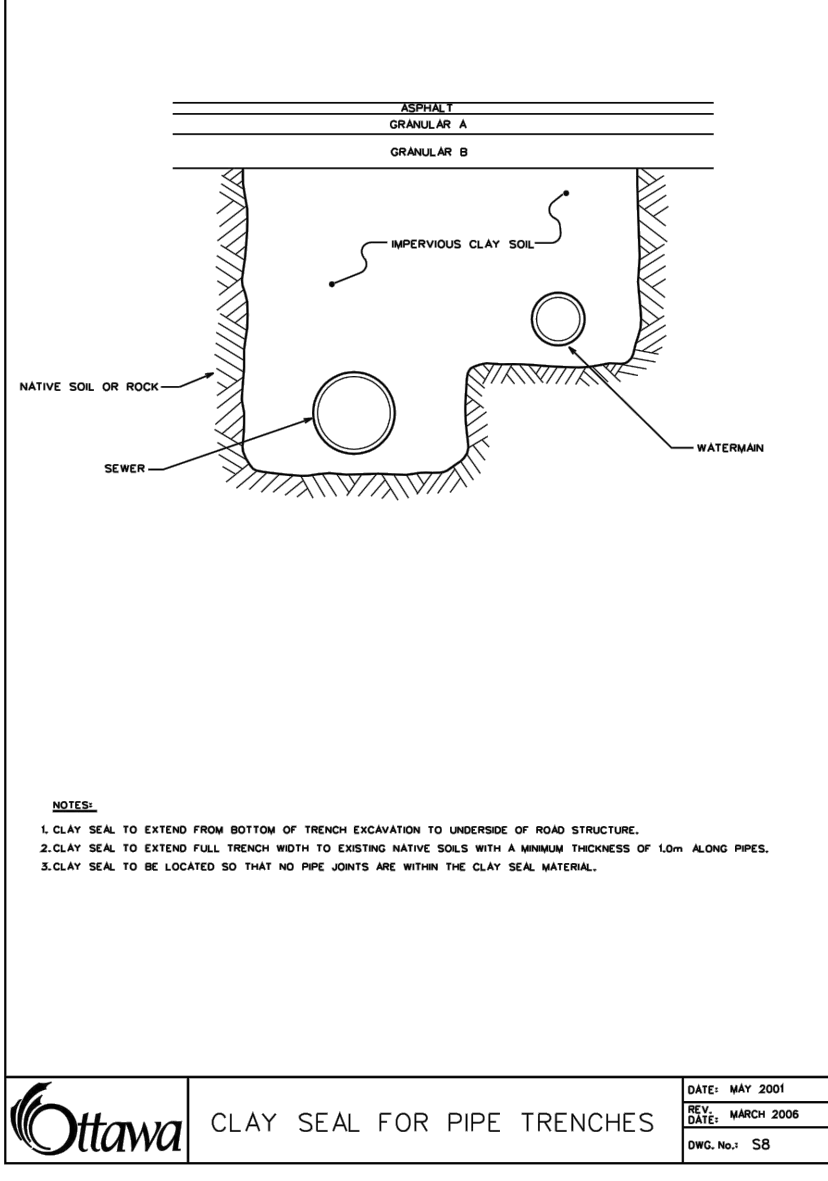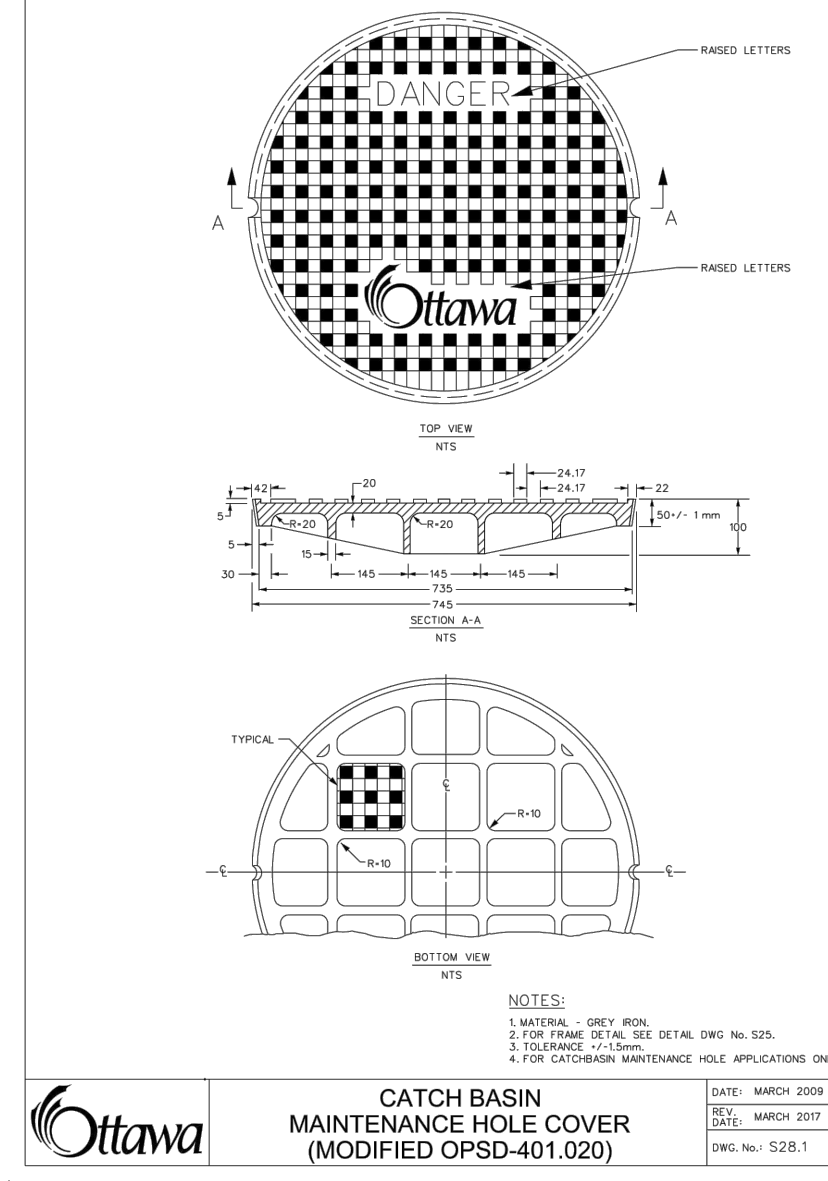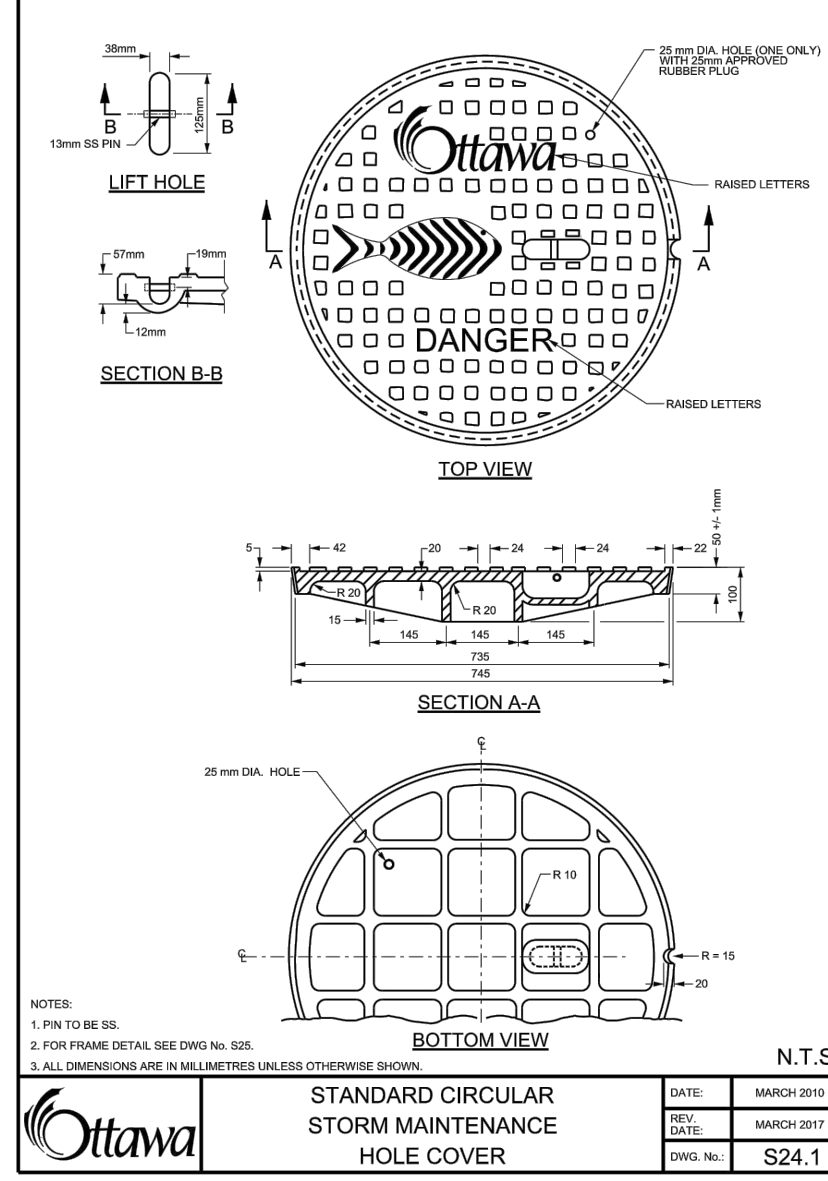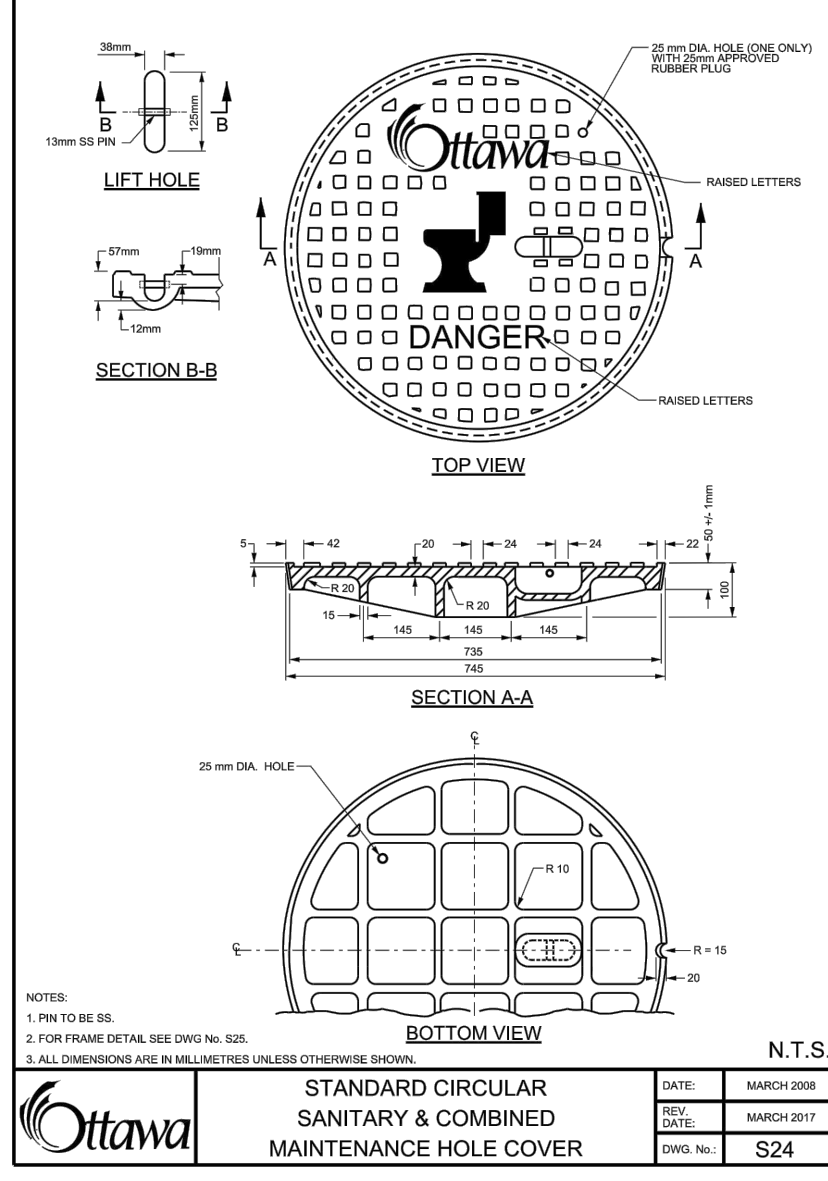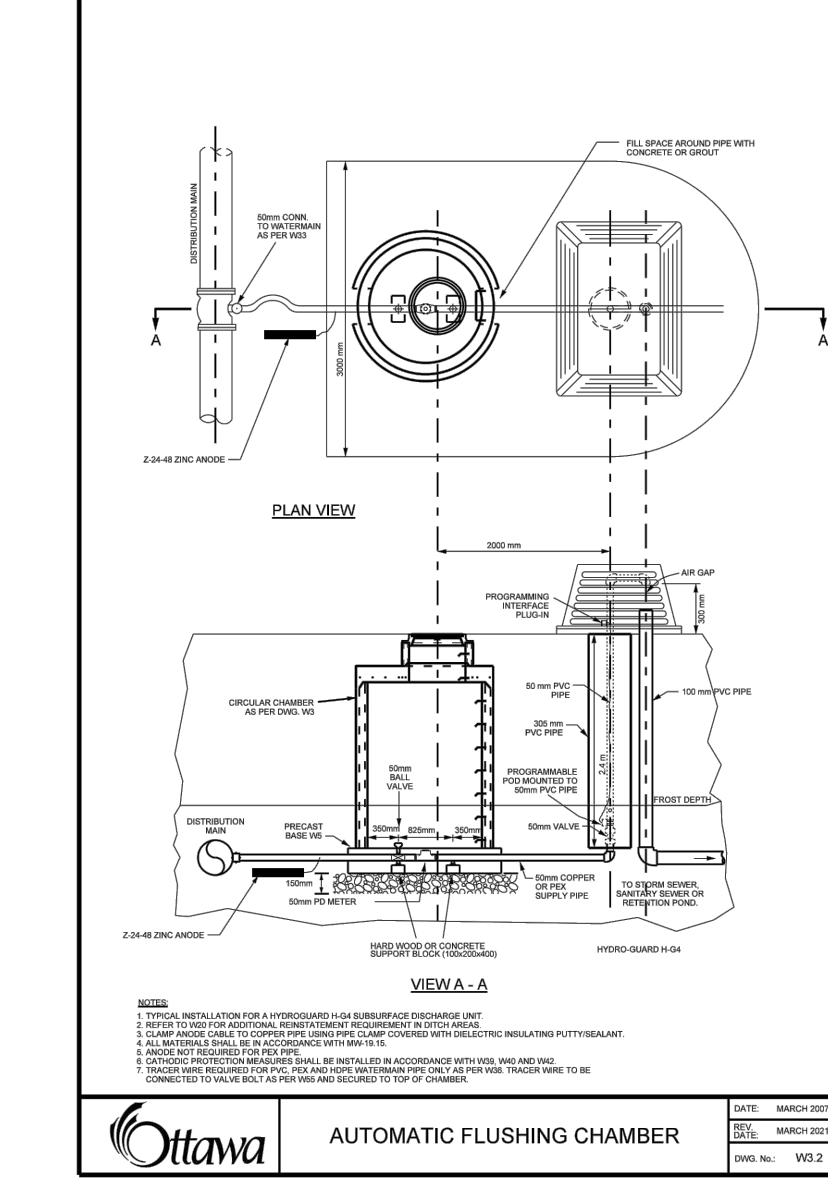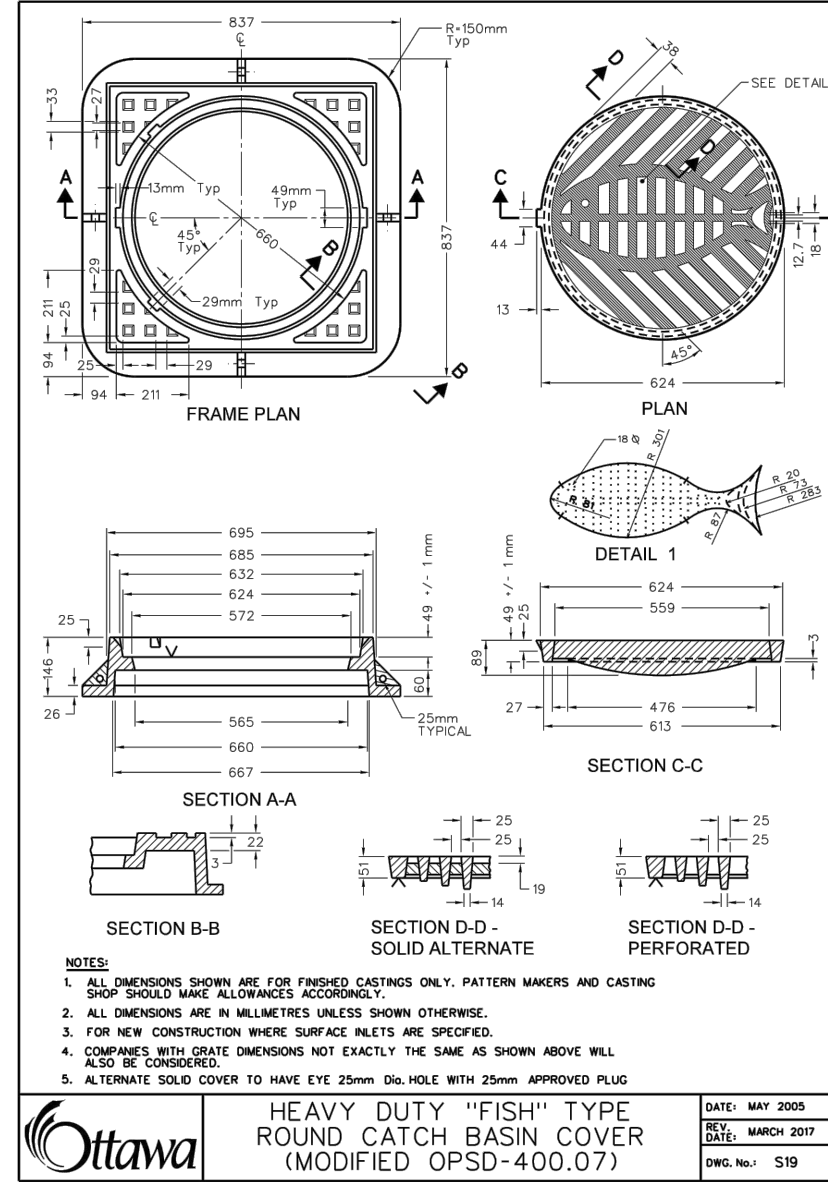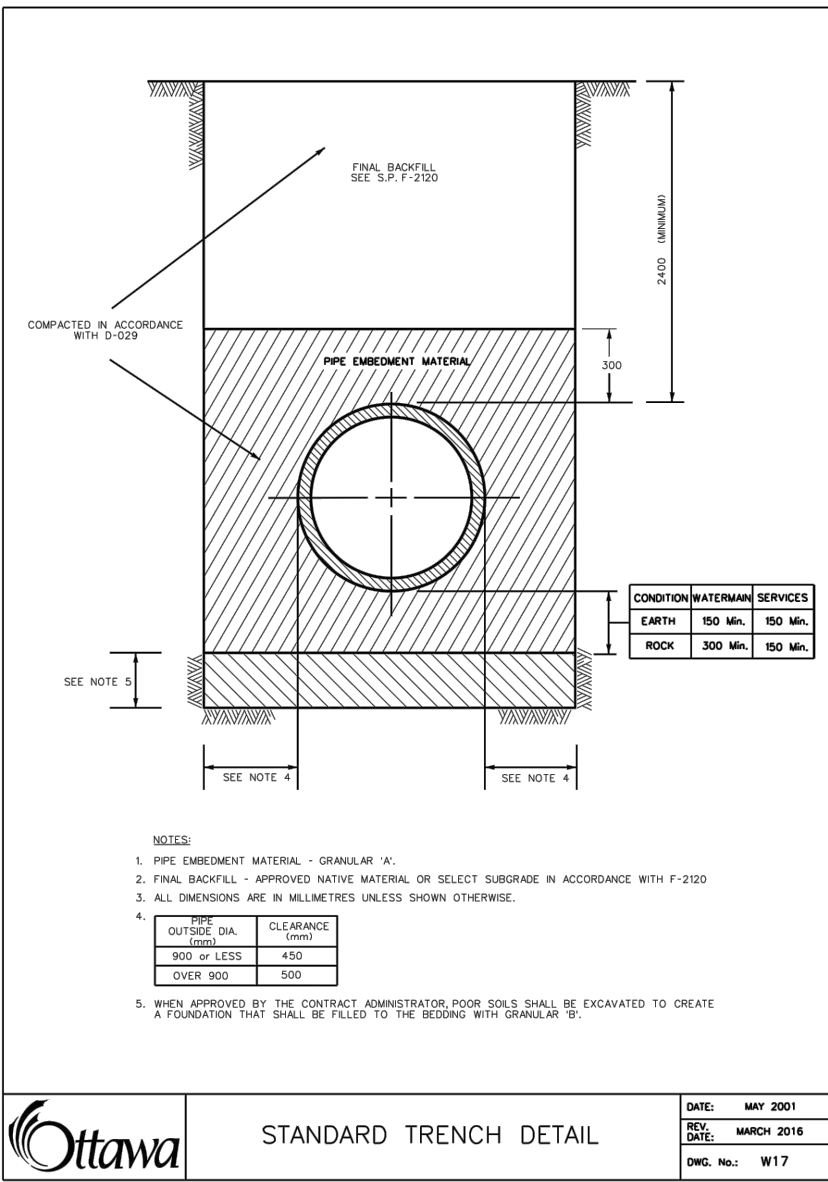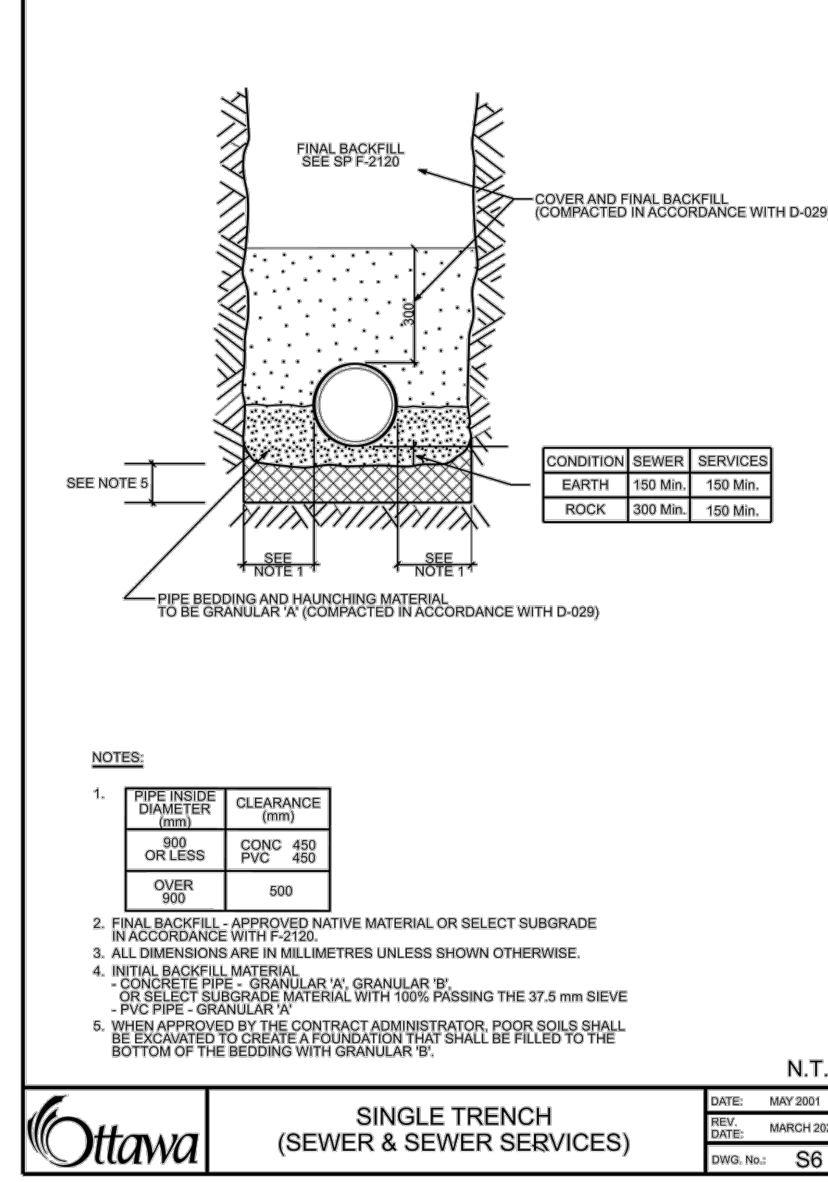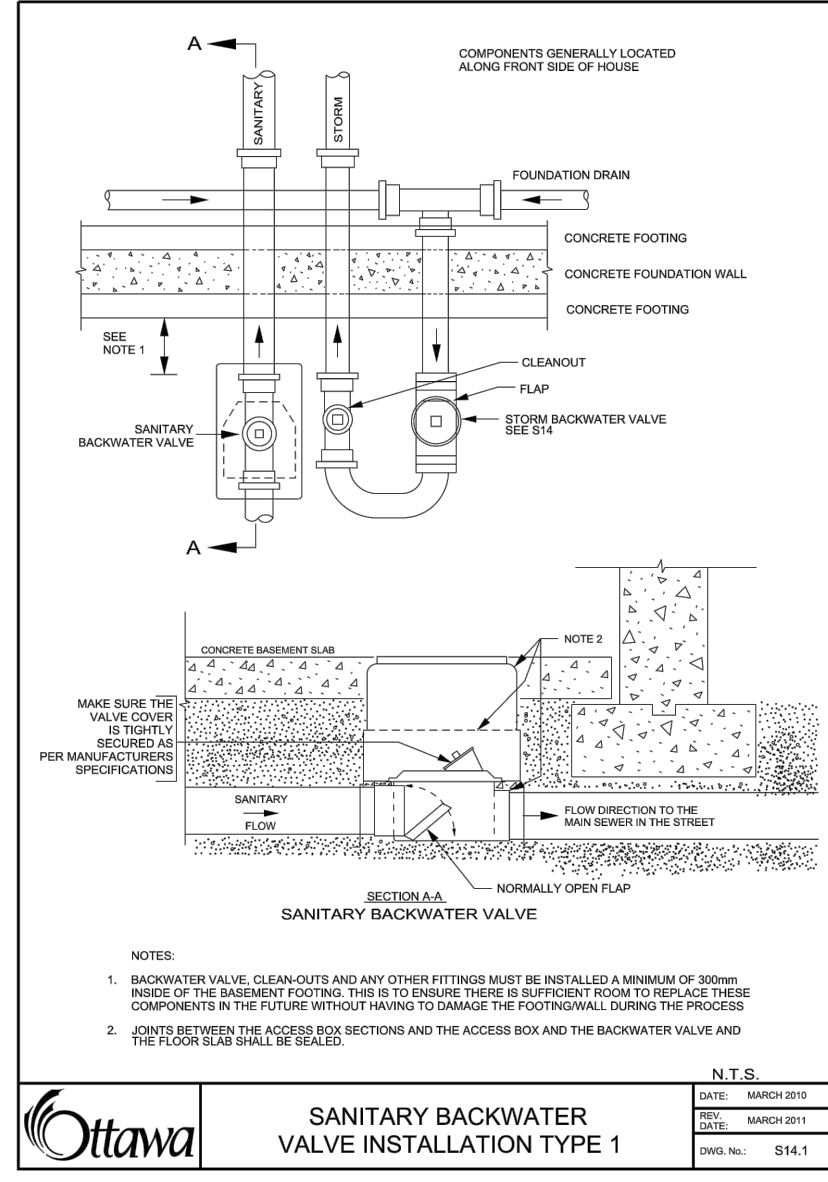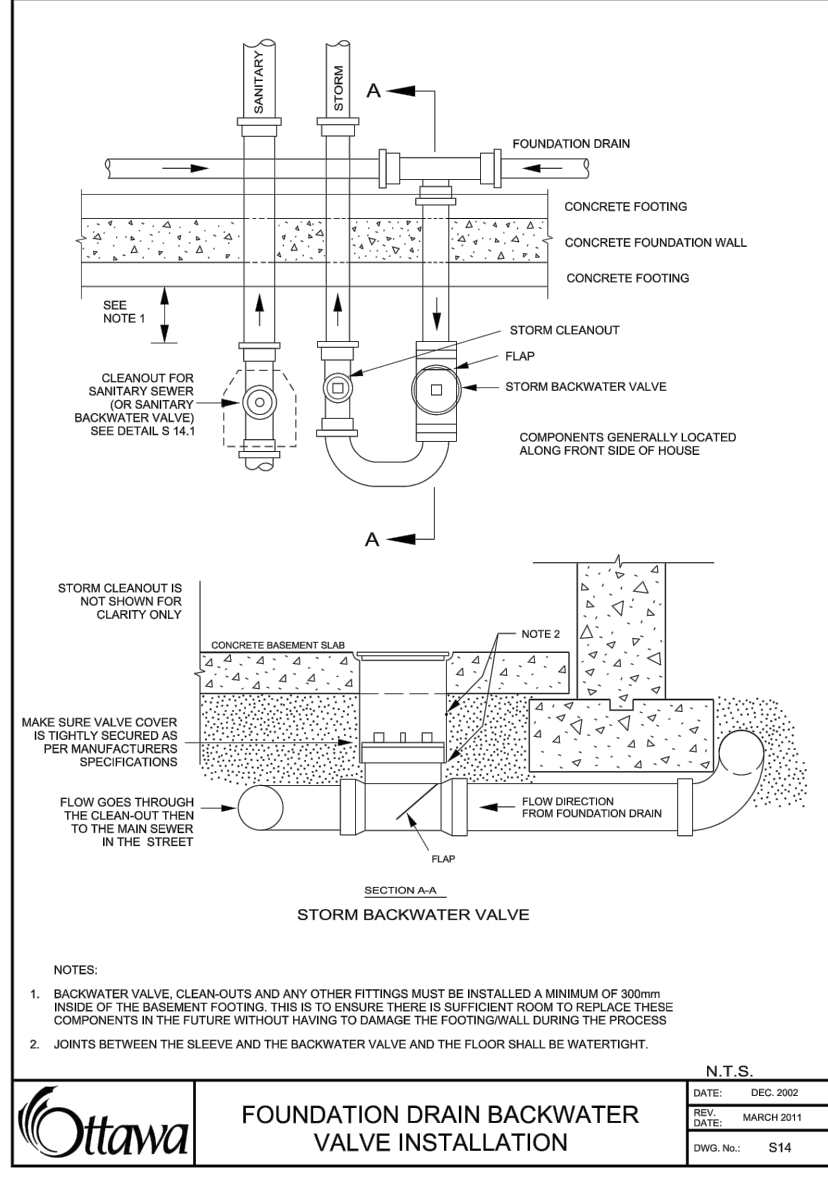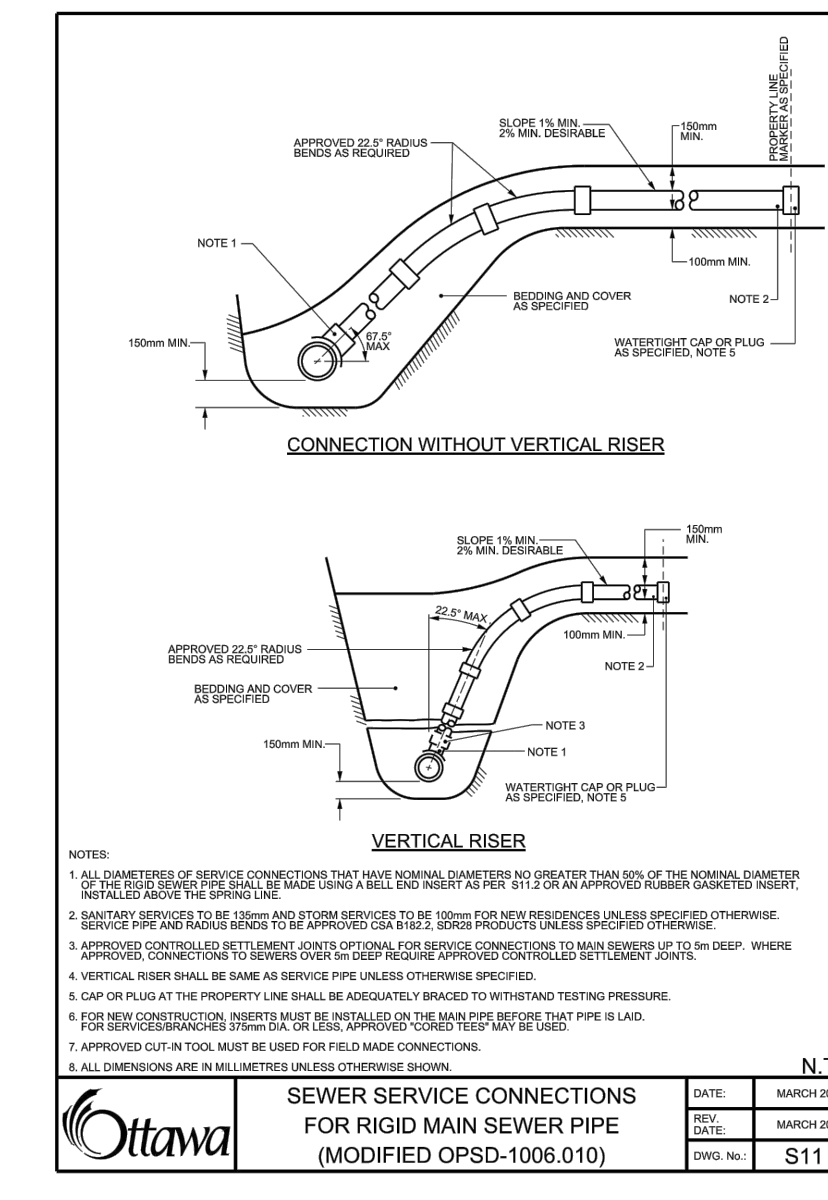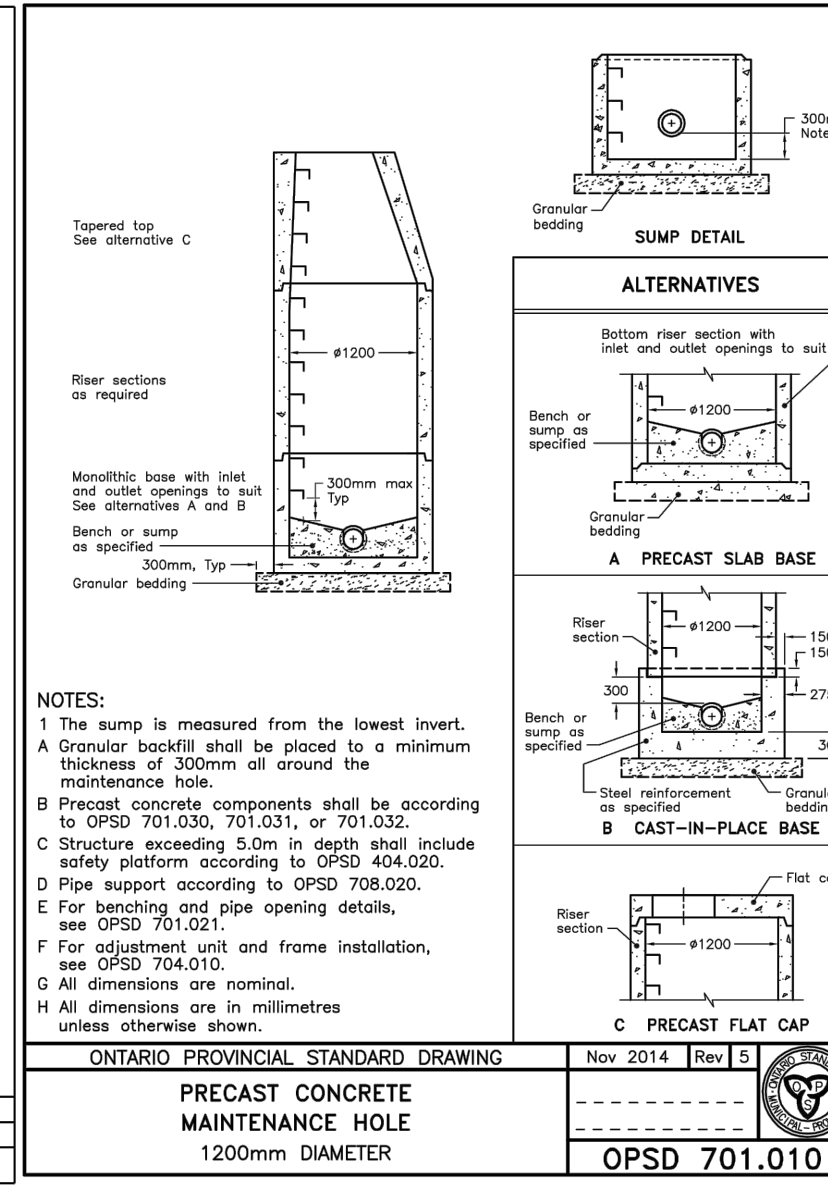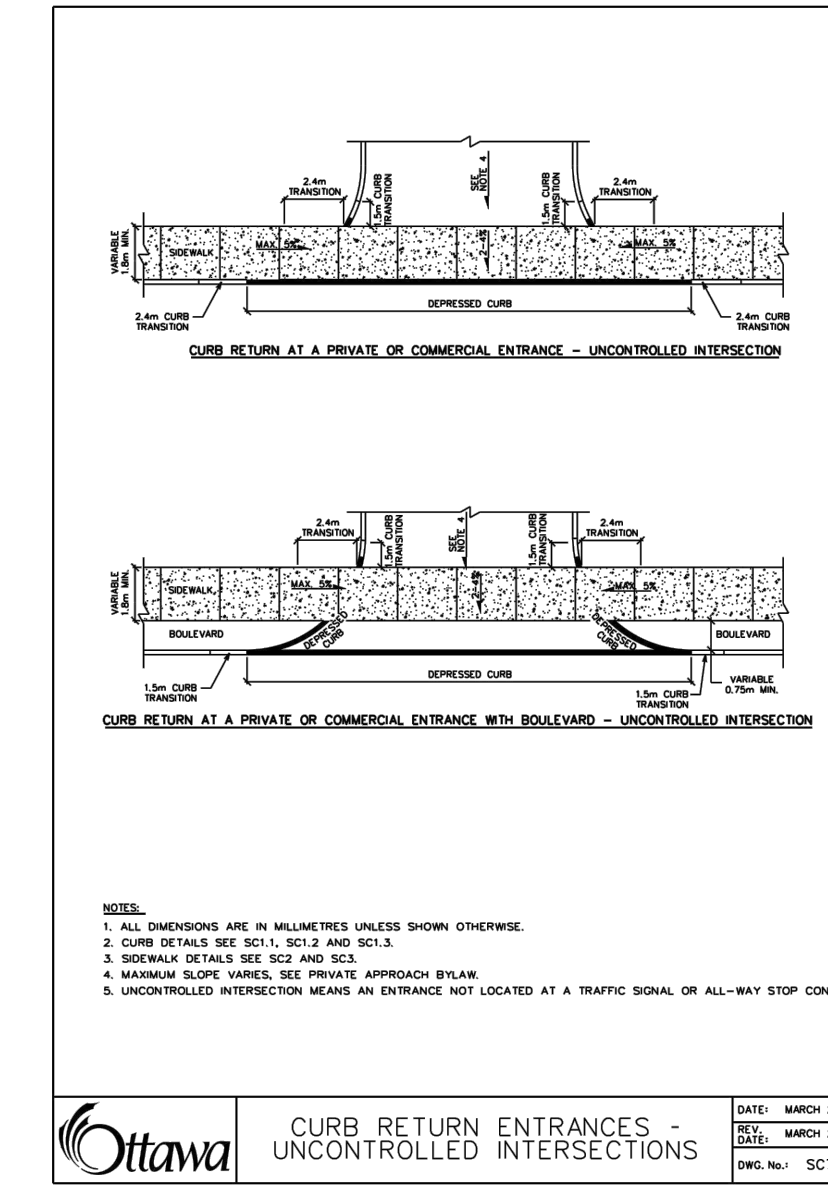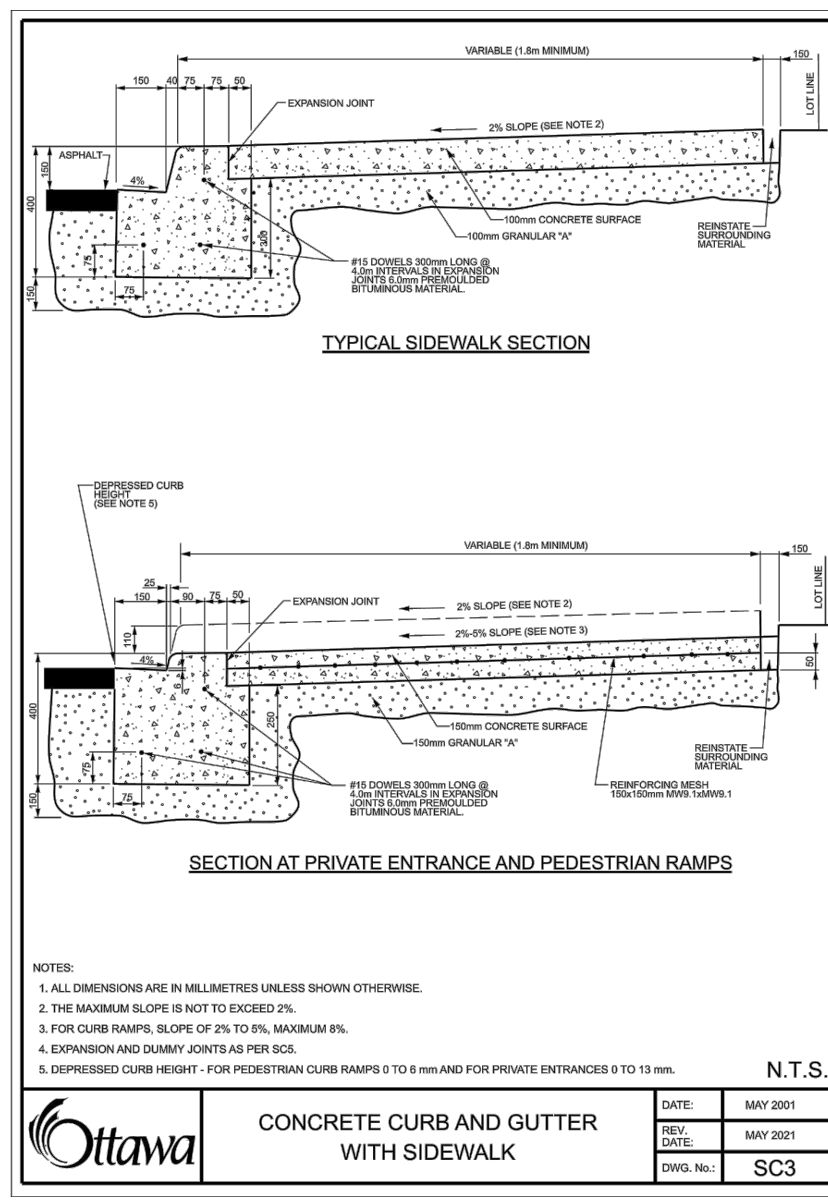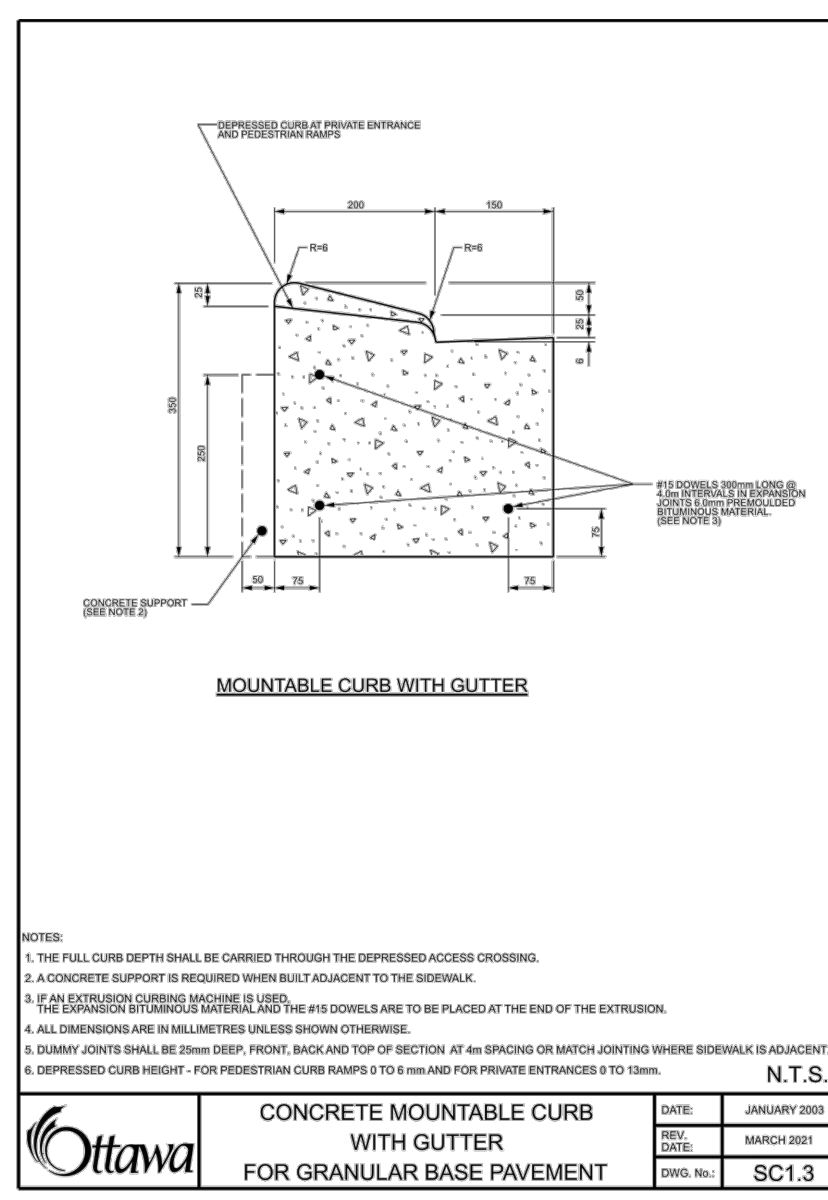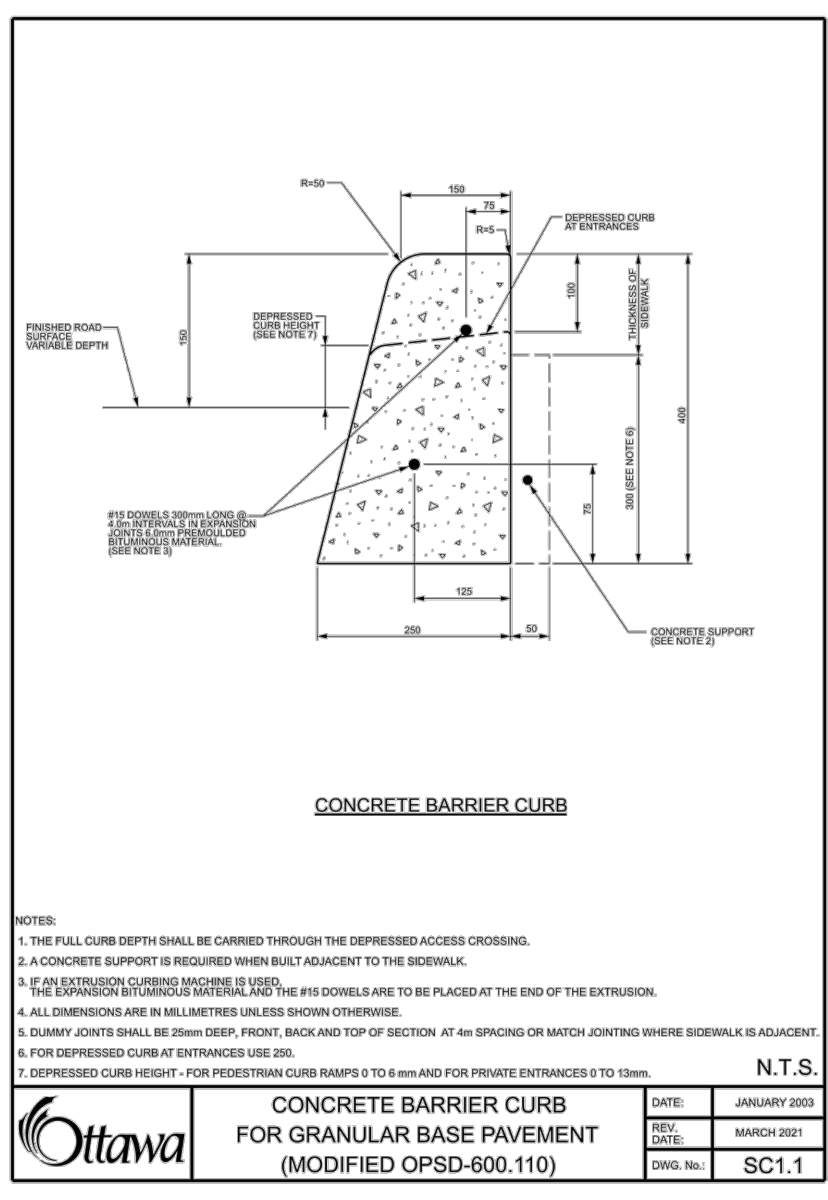

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE USE AND INTENT OF THE DRAWINGS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITY.

GENERAL NOTES

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOTIFY SCALE DRAWINGS.

No.	REVISIONS	BY	DATE
05	ISSUED FOR MUNICIPAL APPROVAL	K.H.	24 JULY 2024
04	ISSUED FOR MUNICIPAL APPROVAL	K.H.	23 APR 2024
03	ISSUED FOR MUNICIPAL APPROVAL	K.H.	19 DEC 2023
02	ISSUED FOR MUNICIPAL APPROVAL	K.H.	09 JUN 2023
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	24 DEC 2021

NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
 ENGINEERING | INGENIERIE
 5430 Canotek Road | Ottawa, ON, K1J 9G2
 www.lrj.ca | (613) 842-3434

CLIENT: **LANDRIC HOMES**
 1173 CYRILLE RD, SUITE 202,
 OTTAWA ON K1J 756

DESIGNED BY: K.H. DRAWN BY: K.H. APPROVED BY: J.V.

PROJECT: **NAVAN STACKED TOWN HOMES**
 6001/6005 RENAUD RD,
 OTTAWA, ONTARIO

DRAWING TITLE: **CONSTRUCTION DETAIL PLAN**

PROJECT NO: 210216
 DATE: NOVEMBER 2021

C901

PLAN # 18659

CITY FILE # D07-12-21-0239

PROJECT INFORMATION

ADS
Advanced Design Systems, Inc.

210216 - 6001-6005 RENAUD
OTTAWA, ON, CANADA

MC-3500 STORMTECH CHAMBER SPECIFICATIONS

IMPORTANT NOTES FOR THE BEDDING AND INSTALLATION OF MC-3500 CHAMBER SYSTEM

NOTES FOR CONSTRUCTION EQUIPMENT

INSPECTION & MAINTENANCE

NOTES

RECOMMENDED LAYER

RECOMMENDED LAYER	CONSTRUCTION EQUIPMENT	MAXIMUM THICKNESS	REMARKS
1	Grader	150 mm	Subgrade
2	Grader	150 mm	Subgrade
3	Grader	150 mm	Subgrade
4	Grader	150 mm	Subgrade
5	Grader	150 mm	Subgrade
6	Grader	150 mm	Subgrade
7	Grader	150 mm	Subgrade
8	Grader	150 mm	Subgrade
9	Grader	150 mm	Subgrade
10	Grader	150 mm	Subgrade
11	Grader	150 mm	Subgrade
12	Grader	150 mm	Subgrade
13	Grader	150 mm	Subgrade
14	Grader	150 mm	Subgrade
15	Grader	150 mm	Subgrade
16	Grader	150 mm	Subgrade
17	Grader	150 mm	Subgrade
18	Grader	150 mm	Subgrade
19	Grader	150 mm	Subgrade
20	Grader	150 mm	Subgrade
21	Grader	150 mm	Subgrade
22	Grader	150 mm	Subgrade
23	Grader	150 mm	Subgrade
24	Grader	150 mm	Subgrade
25	Grader	150 mm	Subgrade
26	Grader	150 mm	Subgrade
27	Grader	150 mm	Subgrade
28	Grader	150 mm	Subgrade
29	Grader	150 mm	Subgrade
30	Grader	150 mm	Subgrade
31	Grader	150 mm	Subgrade
32	Grader	150 mm	Subgrade
33	Grader	150 mm	Subgrade
34	Grader	150 mm	Subgrade
35	Grader	150 mm	Subgrade
36	Grader	150 mm	Subgrade
37	Grader	150 mm	Subgrade
38	Grader	150 mm	Subgrade
39	Grader	150 mm	Subgrade
40	Grader	150 mm	Subgrade
41	Grader	150 mm	Subgrade
42	Grader	150 mm	Subgrade
43	Grader	150 mm	Subgrade
44	Grader	150 mm	Subgrade
45	Grader	150 mm	Subgrade
46	Grader	150 mm	Subgrade
47	Grader	150 mm	Subgrade
48	Grader	150 mm	Subgrade
49	Grader	150 mm	Subgrade
50	Grader	150 mm	Subgrade

ACCEPTABLE FILL MATERIALS: STORMTECH MC-3500 CHAMBER SYSTEMS

MATERIAL LOCATION	DESCRIPTION	ADDITIONAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
1	Subgrade	Subgrade	95% Proctor Density
2	Subgrade	Subgrade	95% Proctor Density
3	Subgrade	Subgrade	95% Proctor Density
4	Subgrade	Subgrade	95% Proctor Density
5	Subgrade	Subgrade	95% Proctor Density
6	Subgrade	Subgrade	95% Proctor Density
7	Subgrade	Subgrade	95% Proctor Density
8	Subgrade	Subgrade	95% Proctor Density
9	Subgrade	Subgrade	95% Proctor Density
10	Subgrade	Subgrade	95% Proctor Density
11	Subgrade	Subgrade	95% Proctor Density
12	Subgrade	Subgrade	95% Proctor Density
13	Subgrade	Subgrade	95% Proctor Density
14	Subgrade	Subgrade	95% Proctor Density
15	Subgrade	Subgrade	95% Proctor Density
16	Subgrade	Subgrade	95% Proctor Density
17	Subgrade	Subgrade	95% Proctor Density
18	Subgrade	Subgrade	95% Proctor Density
19	Subgrade	Subgrade	95% Proctor Density
20	Subgrade	Subgrade	95% Proctor Density
21	Subgrade	Subgrade	95% Proctor Density
22	Subgrade	Subgrade	95% Proctor Density
23	Subgrade	Subgrade	95% Proctor Density
24	Subgrade	Subgrade	95% Proctor Density
25	Subgrade	Subgrade	95% Proctor Density
26	Subgrade	Subgrade	95% Proctor Density
27	Subgrade	Subgrade	95% Proctor Density
28	Subgrade	Subgrade	95% Proctor Density
29	Subgrade	Subgrade	95% Proctor Density
30	Subgrade	Subgrade	95% Proctor Density
31	Subgrade	Subgrade	95% Proctor Density
32	Subgrade	Subgrade	95% Proctor Density
33	Subgrade	Subgrade	95% Proctor Density
34	Subgrade	Subgrade	95% Proctor Density
35	Subgrade	Subgrade	95% Proctor Density
36	Subgrade	Subgrade	95% Proctor Density
37	Subgrade	Subgrade	95% Proctor Density
38	Subgrade	Subgrade	95% Proctor Density
39	Subgrade	Subgrade	95% Proctor Density
40	Subgrade	Subgrade	95% Proctor Density
41	Subgrade	Subgrade	95% Proctor Density
42	Subgrade	Subgrade	95% Proctor Density
43	Subgrade	Subgrade	95% Proctor Density
44	Subgrade	Subgrade	95% Proctor Density
45	Subgrade	Subgrade	95% Proctor Density
46	Subgrade	Subgrade	95% Proctor Density
47	Subgrade	Subgrade	95% Proctor Density
48	Subgrade	Subgrade	95% Proctor Density
49	Subgrade	Subgrade	95% Proctor Density
50	Subgrade	Subgrade	95% Proctor Density

SCALE: 1:100

ACCEPTABLE FILL MATERIALS: STORMTECH MC-3500 CHAMBER SYSTEMS

MATERIAL LOCATION

DESCRIPTION

ADDITIONAL CLASSIFICATIONS

COMPACTION / DENSITY REQUIREMENT

NOTES:

NYLOPLAST DRAIN BASIN

NOTES:

User Inputs

Results

Chamber Model: MC-3500

Outlet Control Structure: No

Project Name: 210216 - 6001-6005 RENAUD

Engineer: K.H. Ontario

Project Location: Metric

Required Storage Volume: 111.12 cubic meters

Stone Perfority: 40%

Stone Foundation Depth: 200 mm

Stone Above Chambers: 458 mm

Average Cover Over Chambers: 458 mm

Design Constraint Dimension: (6.01 m x 25.00 m)

System Volume and Bed Size

Installed Storage Volume: 112.53 cubic meters

Storage Volume Per Chamber: 3.12 cubic meters

Number of Chambers Required: 20

Chamber Rows: 4

Maximum Length: 23.17 m

Maximum Width: 4.68 m

Approx. Bed Size Required: 110.61 square meters

System Components

Volume of Stone Required: 122 cubic meters

Volume of Excavation (not including fill): 188 cubic meters

Total Non woven Geotextile Required: 393 square meters

Woven Geotextile Required (including 4 square meters Isolat): 397 square meters

Woven Geotextile Required (Isolat): 4 square meters

Total Woven Geotextile Required: 88 square meters

Impervious Liner Required: 0 square meters

MC-3500 ISOLATOR ROW PLAN DETAIL

INSPECTION & MAINTENANCE

NOTES

MC-3500 TECHNICAL SPECIFICATION

NYLOPLAST DRAIN BASIN

NOTES

NYLOPLAST DRAIN BASIN

NOTES

NYLOPLAST DRAIN BASIN

NOTES

ACCEPTABLE FILL MATERIALS: STORMTECH MC-3500 CHAMBER SYSTEMS

NOTES

NYLOPLAST DRAIN BASIN

NOTES

NYLOPLAST DRAIN BASIN

NOTES

NYLOPLAST DRAIN BASIN

NOTES

SECTION

RESIDENTIAL ROAD 16.5m ROAD ALLOWANCE

DATE: MARCH 2009

DWG. No.: ROW - 16.5

NOTES:

- 1.6.5 METRE RIGHT-OF-WAY ONLY BE USED WHERE A MINIMUM SEPARATION OF 1.0m IS PROVIDED FROM A BUILDING STRUCTURE TO THE ROAD LINE. THE 1.0m AREA IS TO BE CLEAR AND UNOCCLUDED OF ANY SUBSURFACE ENCROACHMENTS.
- REFERENCE STANDARD NOTES ROAD ALLOWANCE (DNR-ROW-NOTES).
- CONCRETE CURBS MAY BE BARRIER TYPE OR HOUSING TYPE/CATCH BASIN TYPE WILL SUIT CURB DESIGN. SEE SEWER DESIGN GUIDELINES FOR CATCH BASIN PREFERENCE.
- AT CATCH BASIN AND HYDRANT LOCATIONS THE GAS MAIN SHALL HAVE A MINIMUM 0.6m CLEARANCE FROM STRUCTURES.
- SIDEWALKS (IF REQUIRED) AND HYDRANT TRANSFORMERS ARE TO BE LOCATED ON OPPOSITE SIDES OF THE STREET. THE HYDRANT TRANSFORMERS ARE TO BE PLACED ON THE OUTSIDE PORTION OF THE STREET ON CROSSINGS AND CORNER ROADWAYS.
- STREET LIGHTS AND SIDEWALKS ARE TO BE LOCATED ON OPPOSITE SIDES OF THE ROW.
- TREES WILL NOT BE PLACED ON LOTS THAT HAVE A HYDRANT TRANSFORMER. WHERE TREES ARE PLANTED, THE PLACEMENT AND SPECIES OF TREES WILL BE DETERMINED ON A SITE-BY-SITE BASIS AND BE INCORPORATED IN THE LANDSCAPE PLAN.
- FOR SINGLE LOADED BOULEVARD ON SIDE WITH NO HOUSING MAY BE REDUCED TO A MINIMUM 1.5m.

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE USE AND INTENT OF THE DRAWINGS. BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAIL AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS NOTICED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTALS OF A BID TO PERFORM THIS WORK SHALL CONSTITUTE ACCEPTANCE OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT. THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

SUBJECT TO APPROVAL

No.	REVISIONS	BY	DATE
05	ISSUED FOR MUNICIPAL APPROVAL	K.H.	24 JUL 2024
04	ISSUED FOR MUNICIPAL APPROVAL	K.H.	23 APR 2024
03	ISSUED FOR MUNICIPAL APPROVAL	K.H.	19 DEC 2023
02	ISSUED FOR MUNICIPAL APPROVAL	K.H.	09 JUN 2023
01	ISSUED FOR MUNICIPAL APPROVAL	A.S.	24 DEC 2021

Licensed Professional Engineer
V. JOHNSON
100510576
07-24-2024
PROVINCE OF ONTARIO

NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: LANDRIC HOMES
1173 CRYVALLE RD, SUITE 202,
OTTAWA ON K1J 756

DESIGNED BY: K.H. **DRAWN BY:** K.H. **APPROVED BY:** J.V.

PROJECT: NAVAN STOKES TOWN HOMES
6001/6005 RENAUD RD,
OTTAWA, ONTARIO

DRAWING TITLE: CONSTRUCTION DETAIL PLAN

PROJECT NO.: 210216
DATE: NOVEMBER 2021

C902

PLAN # 18659

CITY FILE # D07-12-21-0239

DRAWINGS/FIGURES

**Proposed Site Plan
Legal Survey
As-builts**



NOT FOR CONSTRUCTION
PAS POUR CONSTRUCTION

This document and all information herein is confidential and the intellectual property of Rossmann Architecture Inc. It is disclosed in confidence on terms that it will not be disclosed to any third party, used, sold, loaned, licensed, or reproduced in whole or in any part in any manner or form for manufacturing, tendering or for any other purpose without the written permission of Rossmann Architecture Inc. The copyright is retained by Rossmann Architecture Inc.

Ce document, ainsi que tous renseignements contenus a l'intérieur, est la propriété de Rossmann Architecture Inc. Il est divulgué en confiance sous les termes qu'il ne sera pas divulgué a aucun tiers, utilisé, vendu, prêté, licencié ou reproduit en son entier ou en partie d'aucune manière pour la manufacture, soumission ou pour autres fins sans la permission écrite de Rossmann Architecture Inc. Le droit d'auteur est retenu par Rossmann Architecture Inc.

PROJECT TEAM / ÉQUIPE DU PROJET :

NOTE-A :
ALL DRAWINGS ARE TO BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS AND SPECIFICATIONS, INCLUDING OTHER CONSULTANTS DRAWINGS AND SPECIFICATIONS. ANY DISCREPANCIES BETWEEN DRAWINGS WILL BE REPORTED TO THE PROJECT LEAD IMMEDIATELY FOR CLARIFICATION PRIOR TO COMMENCING ANY CONSTRUCTION.

NOTE-B :
ALL GENERAL SITE INFORMATION AND CONDITIONS HAVE BEEN COMPILED FROM EXISTING PLANS AND SURVEYS.

NOTE-C :
CONTRACTOR IS RESPONSIBLE TO CHECK AND VERIFY ALL DIMENSIONS ON SITE AND REPORT ALL ERRORS AND / OR OMISSIONS TO THE ARCHITECT.

NOTE-D :
REFER TO LANDSCAPE PLAN FOR ALL EXTERIOR LANDSCAPING.



NOTE-E :
DO NOT SCALE DRAWINGS.

NOTE-F :
ALL CONTRACTORS MUST COMPLY WITH ALL APPLICABLE CODES AND REGULATIONS.

GENERAL NOTES

SURVEY INFO

TOPOGRAPHIC SURVEY OF :

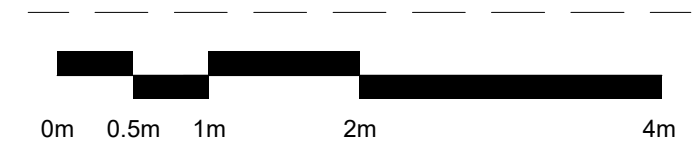

PROJECT INFORMATION

SITE SUMMARY

ADDRESS	6001-6005 RENAUD, OTTAWA, ON
PROPOSED ZONING	RAZ
SITE AREA	4598.69 m ²
PROPOSED USE	RESIDENTIAL
BUILDING AREA	723.20 m ²

ZONING SUMMARY

	REQUIRED	PROPOSED
LOT AREA	N/A	2913.14 m ²
LOT WIDTH	N/A	76.12 m
MAX. BUILDING HEIGHT	18.00 m	12.02 m
MAX. PARAPET HEIGHT	N/A	N/A
Above max. building		
SET BACKS :	3.00 m	5.39 m
- FRONT YARD	3.00 m (min.)	N/A
- CORNER SIDE YARD	3.00 m / 6.00m	3.10 m
- INTERIOR SIDE YARD	6.00 m	15.88 m
- REAR YARD	N/A	N/A
- ADDITIONAL REQ	N/A	N/A
MIN LANDSCAPED AREA	30% OF LOT	35% (1021.6 m ²)

VEHICULAR PARKING

	REQUIRED	PROPOSED
MIN PARKING SPACES	24	24 (10 int)
MIN VISITOR PARKING SPACES	4	4
MIN ACCESSIBLE PRKG SPACES (incl. in count)	1	1

BICYCLE PARKING

	REQUIRED	PROPOSED
MIN PARKING SPACES	5	8

WASTE CONTAINERS

	REQUIRED	PROPOSED
GARBAGE (0.231 y ³ / unit)	5	6
RECYCLING GMP (0.018 y ³ / unit)	2	2
RECYCLING FIBRE (0.062 y ³ / unit)	2	2
ORGANICS (L)	240	240

AMENITY AREA

	REQUIRED	PROPOSED
PRIVATE	60.00 m ²	151.00 m ² BALCONIES
COMMUNAL	60.00 m ²	107.00 m ² EXTERIOR

BUILDING SUMMARY

	UNITS	GFA - ORG
SEMI-BASEMENT	20	420.00 m ²
GROUND	0	313.00 m ²
LEVEL 2	20	361.00 m ²
LEVEL 3	0	321.00 m ²

SITE CONTEXT



LEGEND

- PROPOSED GRASS
- RIVERSTONE
- CONCRETE PAVERS
- POURED CONCRETE
- ASPHALT PAVING
- PROPOSED NEW BUILDING
- CONCRETE RETAINING WALL
- EXISTING BUILDING TO BE DEMOLISHED

LINES

- PROPERTY LINE
- SETBACK LINE
- EXISTING FENCE
- NEW FENCE
- OVERHEAD WIRES

VEGETATION


- TREE: EXISTING TO REMAIN
- TREE: EXISTING TO BE REMOVED
- TREE: NEW PROPOSED
- SHRUB: NEW PROPOSED

SYMBOLS

- DIRECTIONAL ARROWS
- BUILDING ACCESS
- BUILDING EGRESS
- SIAMESE CONNECTION
- UTILITY POLE
- FIRE HYDRANT
- CATCH BASIN / MANHOLE
- DEPRESSED CURB
- LANDSCAPE LIGHT
- LIGHT POLE
- EXISTING GRADE ELEVATION
- PROPOSED GRADE ELEVATION
- LOT CORNERS

PARKING

- BIKE PARKING
- RESIDENTIAL
- VISITOR
- BF PARKING (TYPE A)
- RESIDENTIAL
- VISITOR
- BF PARKING (TYPE B)
- RESIDENTIAL
- VISITOR

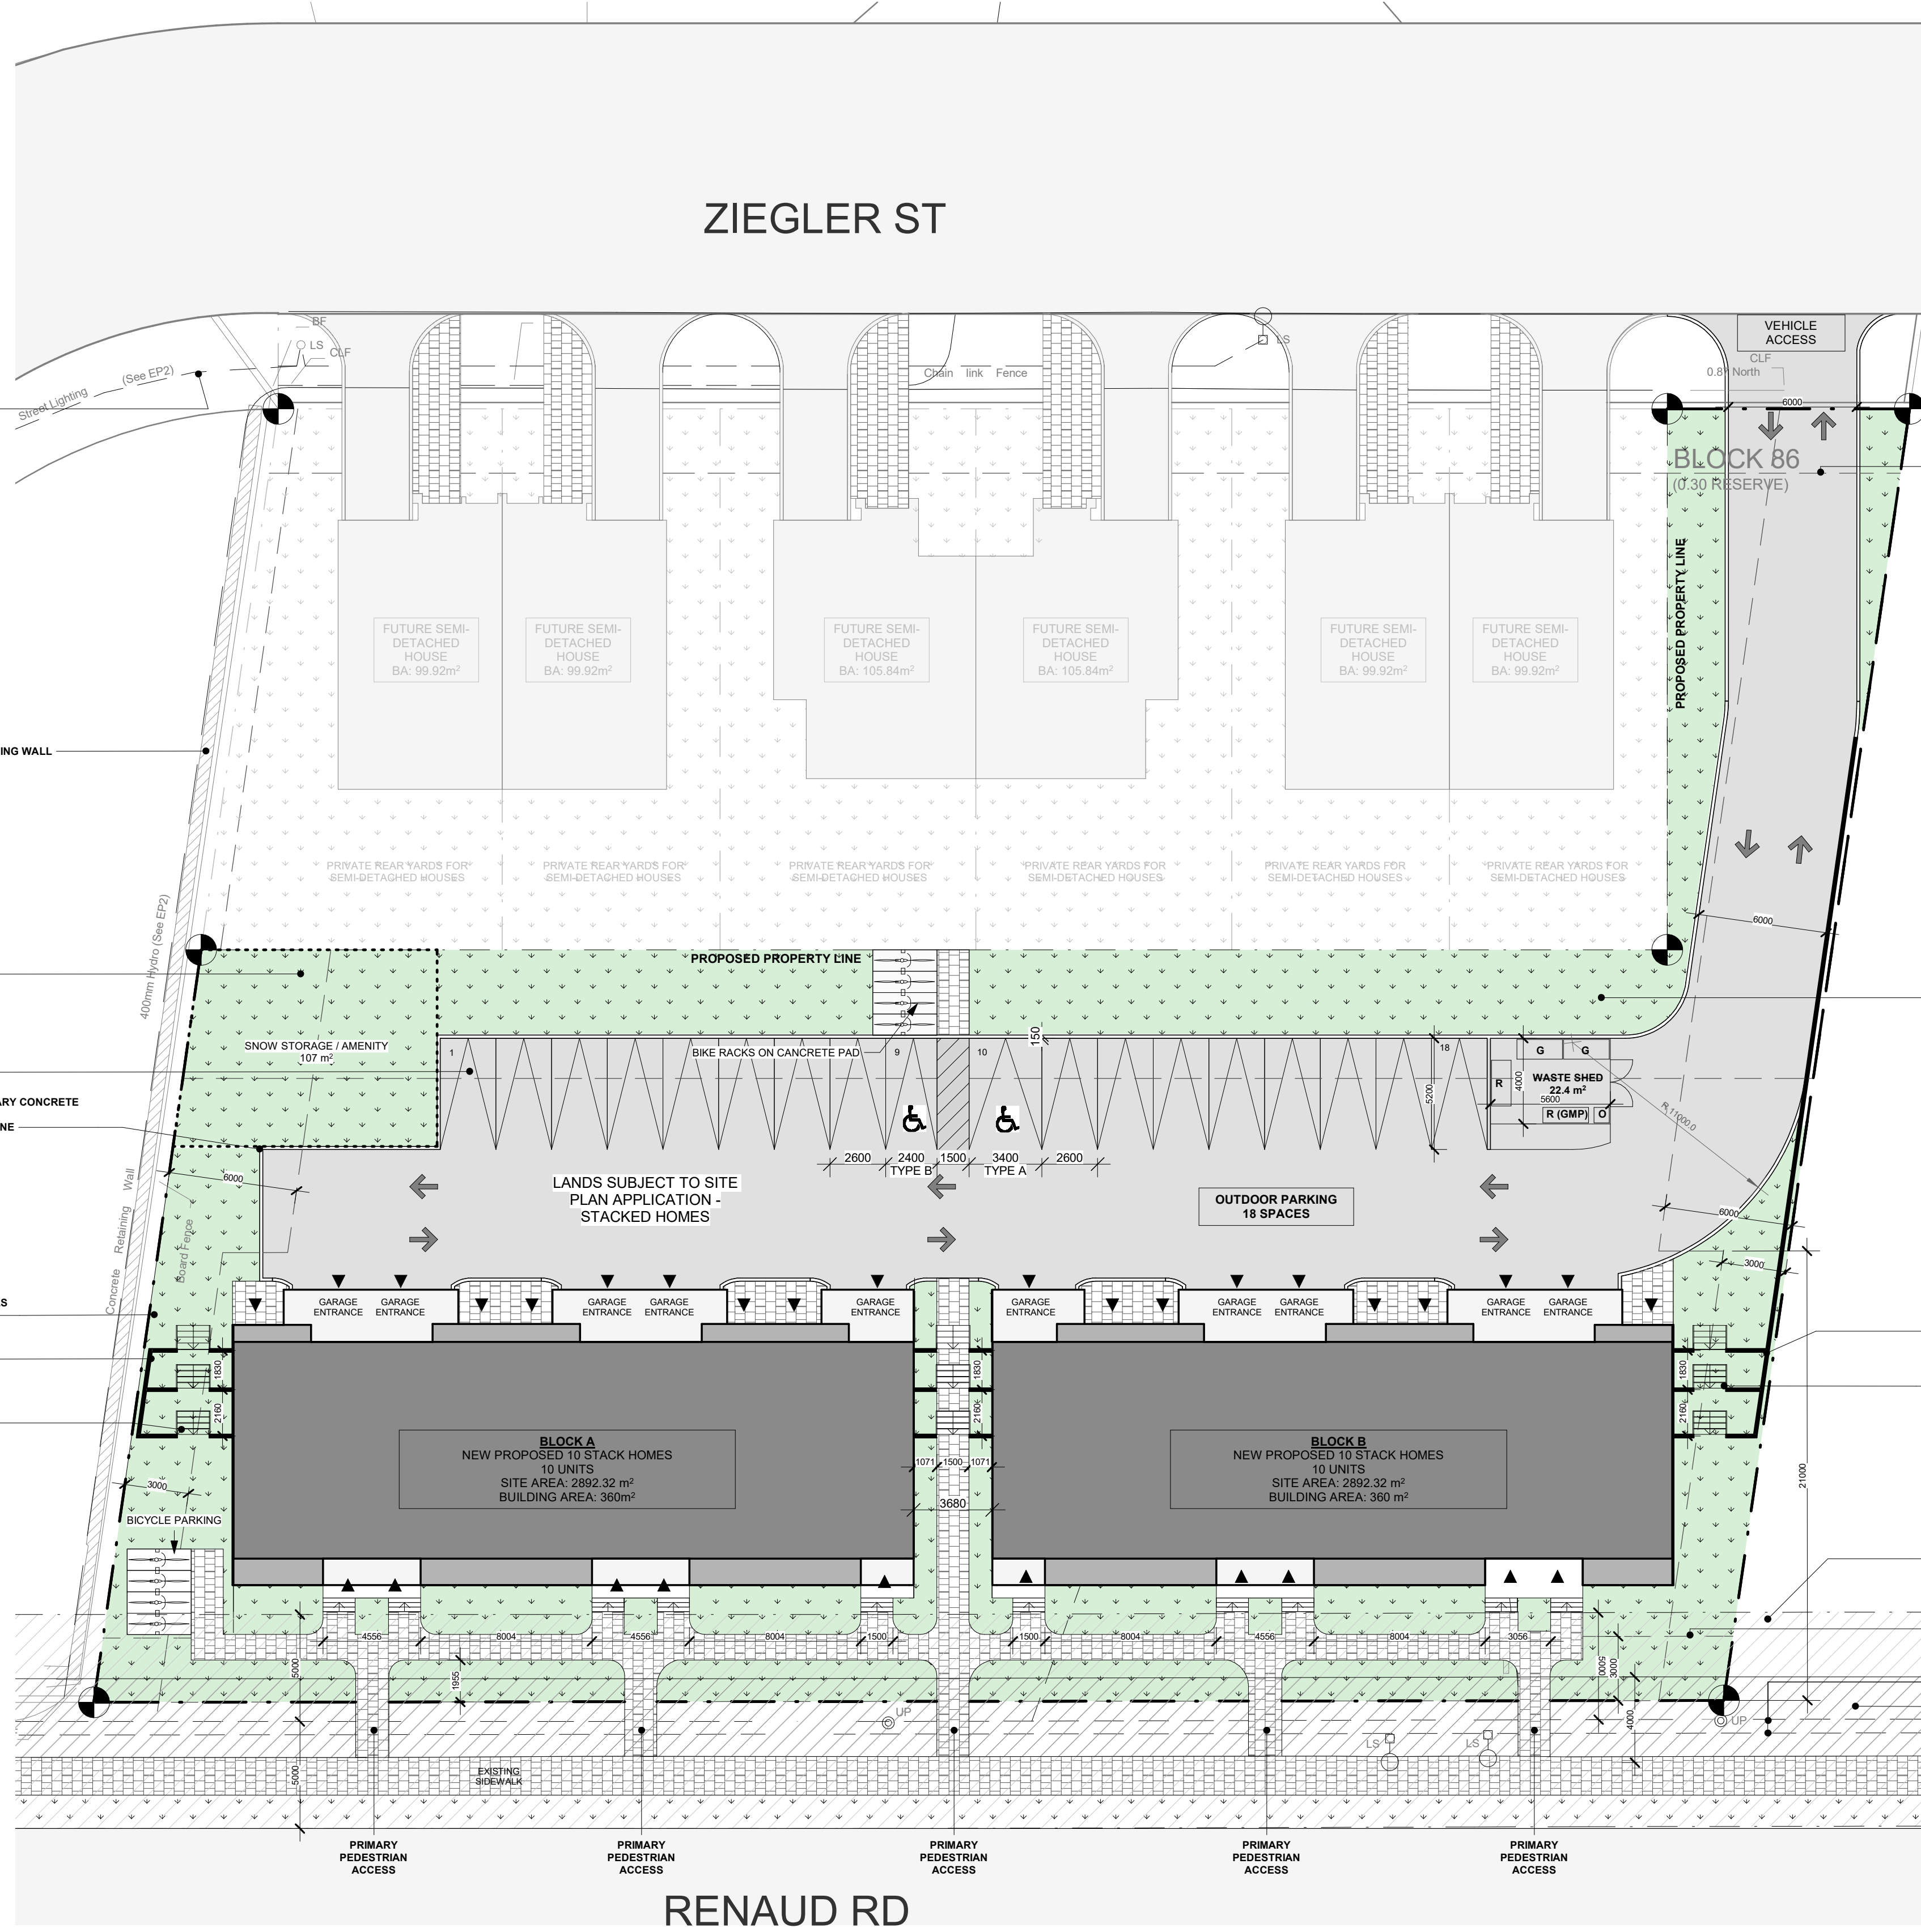

1 SITE PLAN
A050 1 : 200

KEY PLAN / PLAN CLÉ :



CLIENT :



1.6	ISSUED FOR SPC	23-04-05
1.4	ISSUED FOR 66%	23-02-24
1.3	City discussion	22-11-16
1.2	City discussion	22-10-27
1.1	Issued for 33%	22-10-12
1.0	SITE PLAN	22-10-11
revision	description	date

PROJECT NAME / NOME DU PROJET :

6001-6005 Renaud

DRAWING NAME / NOM DU DESSIN :

SITE PLAN

DRAWING INFORMATION / INFORMATION DU DESSIN :

PROJECT NO. / NO. DE PROJET : **22170**
DATE : **2023-04-05**
DRAWN BY / DESSINÉ PAR : **E.T.**
REVIEWED BY / VÉRIFIÉ PAR : **L.G.**
SCALE / ÉCHELLE : **As indicated**
PROJECT PHASE / PHASE DU PROJET : **1**
DWG NO. / NO. DESSIN : **A050**

REVISION NO. / NO. DE RÉVISION : **1.6**

PART OF LOT 7
CONCESSION 3 (OTTAWA FRONT)
(Geographic Township of Gloucester)
CITY OF OTTAWA

Surveyed by Annis, O'Sullivan, Vollebek Ltd.

Scale 1 : 250



Metric
DISTANCES SHOWN ON THIS PLAN ARE IN METRES AND
CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

Surveyor's Certificate

I CERTIFY THAT:

- 1. This survey and plan are correct and in accordance with the Surveys Act, the Surveyors Act and the regulations made under them.
- 2. The survey was completed on May 7, 2021.

May 14, 2021 Date "Tyler Allison"
Tyler J. Allison
Ontario Land Surveyor

Rev.	Date	Add Pole Conductors and Pole Transformer
1	Oct. 1/21	

ANNIS, O'SULLIVAN, VOLLEBEK LTD. grants to Landis Homes ("The Client"), their solicitors, mortgagees, and other related parties permission to use original, signed, sealed copies of the Topographical Plan of Survey in transactions involving The Client.

Notes & Legend

- Denotes
- Survey Monument Planted
- Survey Monument Found
- Standard Iron Bar
- Short Standard Iron Bar
- Iron Bar
- Origin Unknown
- N&W Nail & Washer
- (WIT) Witness
- Meas. Measured
- (AOG) Annis, O'Sullivan, Vollebek Ltd.
- (P1) Registered Plan 4M-1400
- (P2) Registered Plan 4M-1373
- (P3) Plan 5R-5324
- (P4) Plan by Santeac Job No. 161650000-109, Ref 4M-1400
- EPI Plan and Profile of Ziegler Street (T.L. Mak Engineer Consultants, Project 805-47) Drawing P-2 Rev. 5 "As Recorded" 07/22/14
- EP2 City of Ottawa U.C.C. Central Registry Data, Sheet J-29-24 Dated August 2015
- EP3 Plan and Profile of Renaud Road (Santeac Project 160400704) Drawing PP-2 Rev. 7 "As Recorded" 11/11/21
- EP4 City of Ottawa U.C.C. Central Registry Data, Sheet J-29-30 Dated August 2015
- (DI) Inst. CT257733
- Deciduous Tree
- Coniferous Tree
- Fire Hydrant
- M&ST Maintenance Hole (Storm Sewer)
- M&S Maintenance Hole (Sanitary)
- M&I Maintenance Hole (Unidentified)
- CB Catch Basin
- GM Gas Meter
- S Sign
- CLF Chain Link Fence
- BF Board Fence
- LP Utility Pole
- LS Light Standard
- A/C Air Conditioner
- D Diameter
- + 05.00 Location of Elevations
- + 05.00 Top of Concrete Curb Elevation
- + 65.00 Top of Retaining Wall Elevation
- C/L Centreline
- Property Line
- ST Underground Storm Sewer
- S Underground Sanitary Sewer
- W Underground Water
- P Underground Power
- G Underground Gas
- OHW Overhead Wires

Bearings are grid, derived from Can-Net 2016 Real Time Network GPS observations and are referenced to Specified Control Points 01919880184 and 019198434761, MTM Zone 9 (76°30' West Longitude) NAD-83 (original).

Coordinate values are to urban accuracy in accordance with O. Reg. 216/10.

.01919880184 Northing 5040610.16 Easting 384736.56
.019198434761 Northing 5036178.12 Easting 372436.11


ELEVATION NOTES

- 1. Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
- 2. It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that it's relative elevation and description agrees with the information shown on this drawing.


UTILITY NOTES

- 1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
- 2. Only visible surface utilities were located.
- 3. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.
- 4. Underground services (including invert elevations) shown are compiled from EP1, EP2, EP3 and EP4 and are subject to field confirmation.

© Annis, O'Sullivan, Vollebek Ltd. 2021. THIS PLAN IS PROTECTED BY COPYRIGHT!
ANNIS, O'SULLIVAN, VOLLEBEK LTD.
165 Bay Street
Embrun, Ont. K0A 1W1
Phone: (613) 443-3364
Email: embron@aovltd.com
Ontario Land Surveyors
Reg. No. E-1136-2

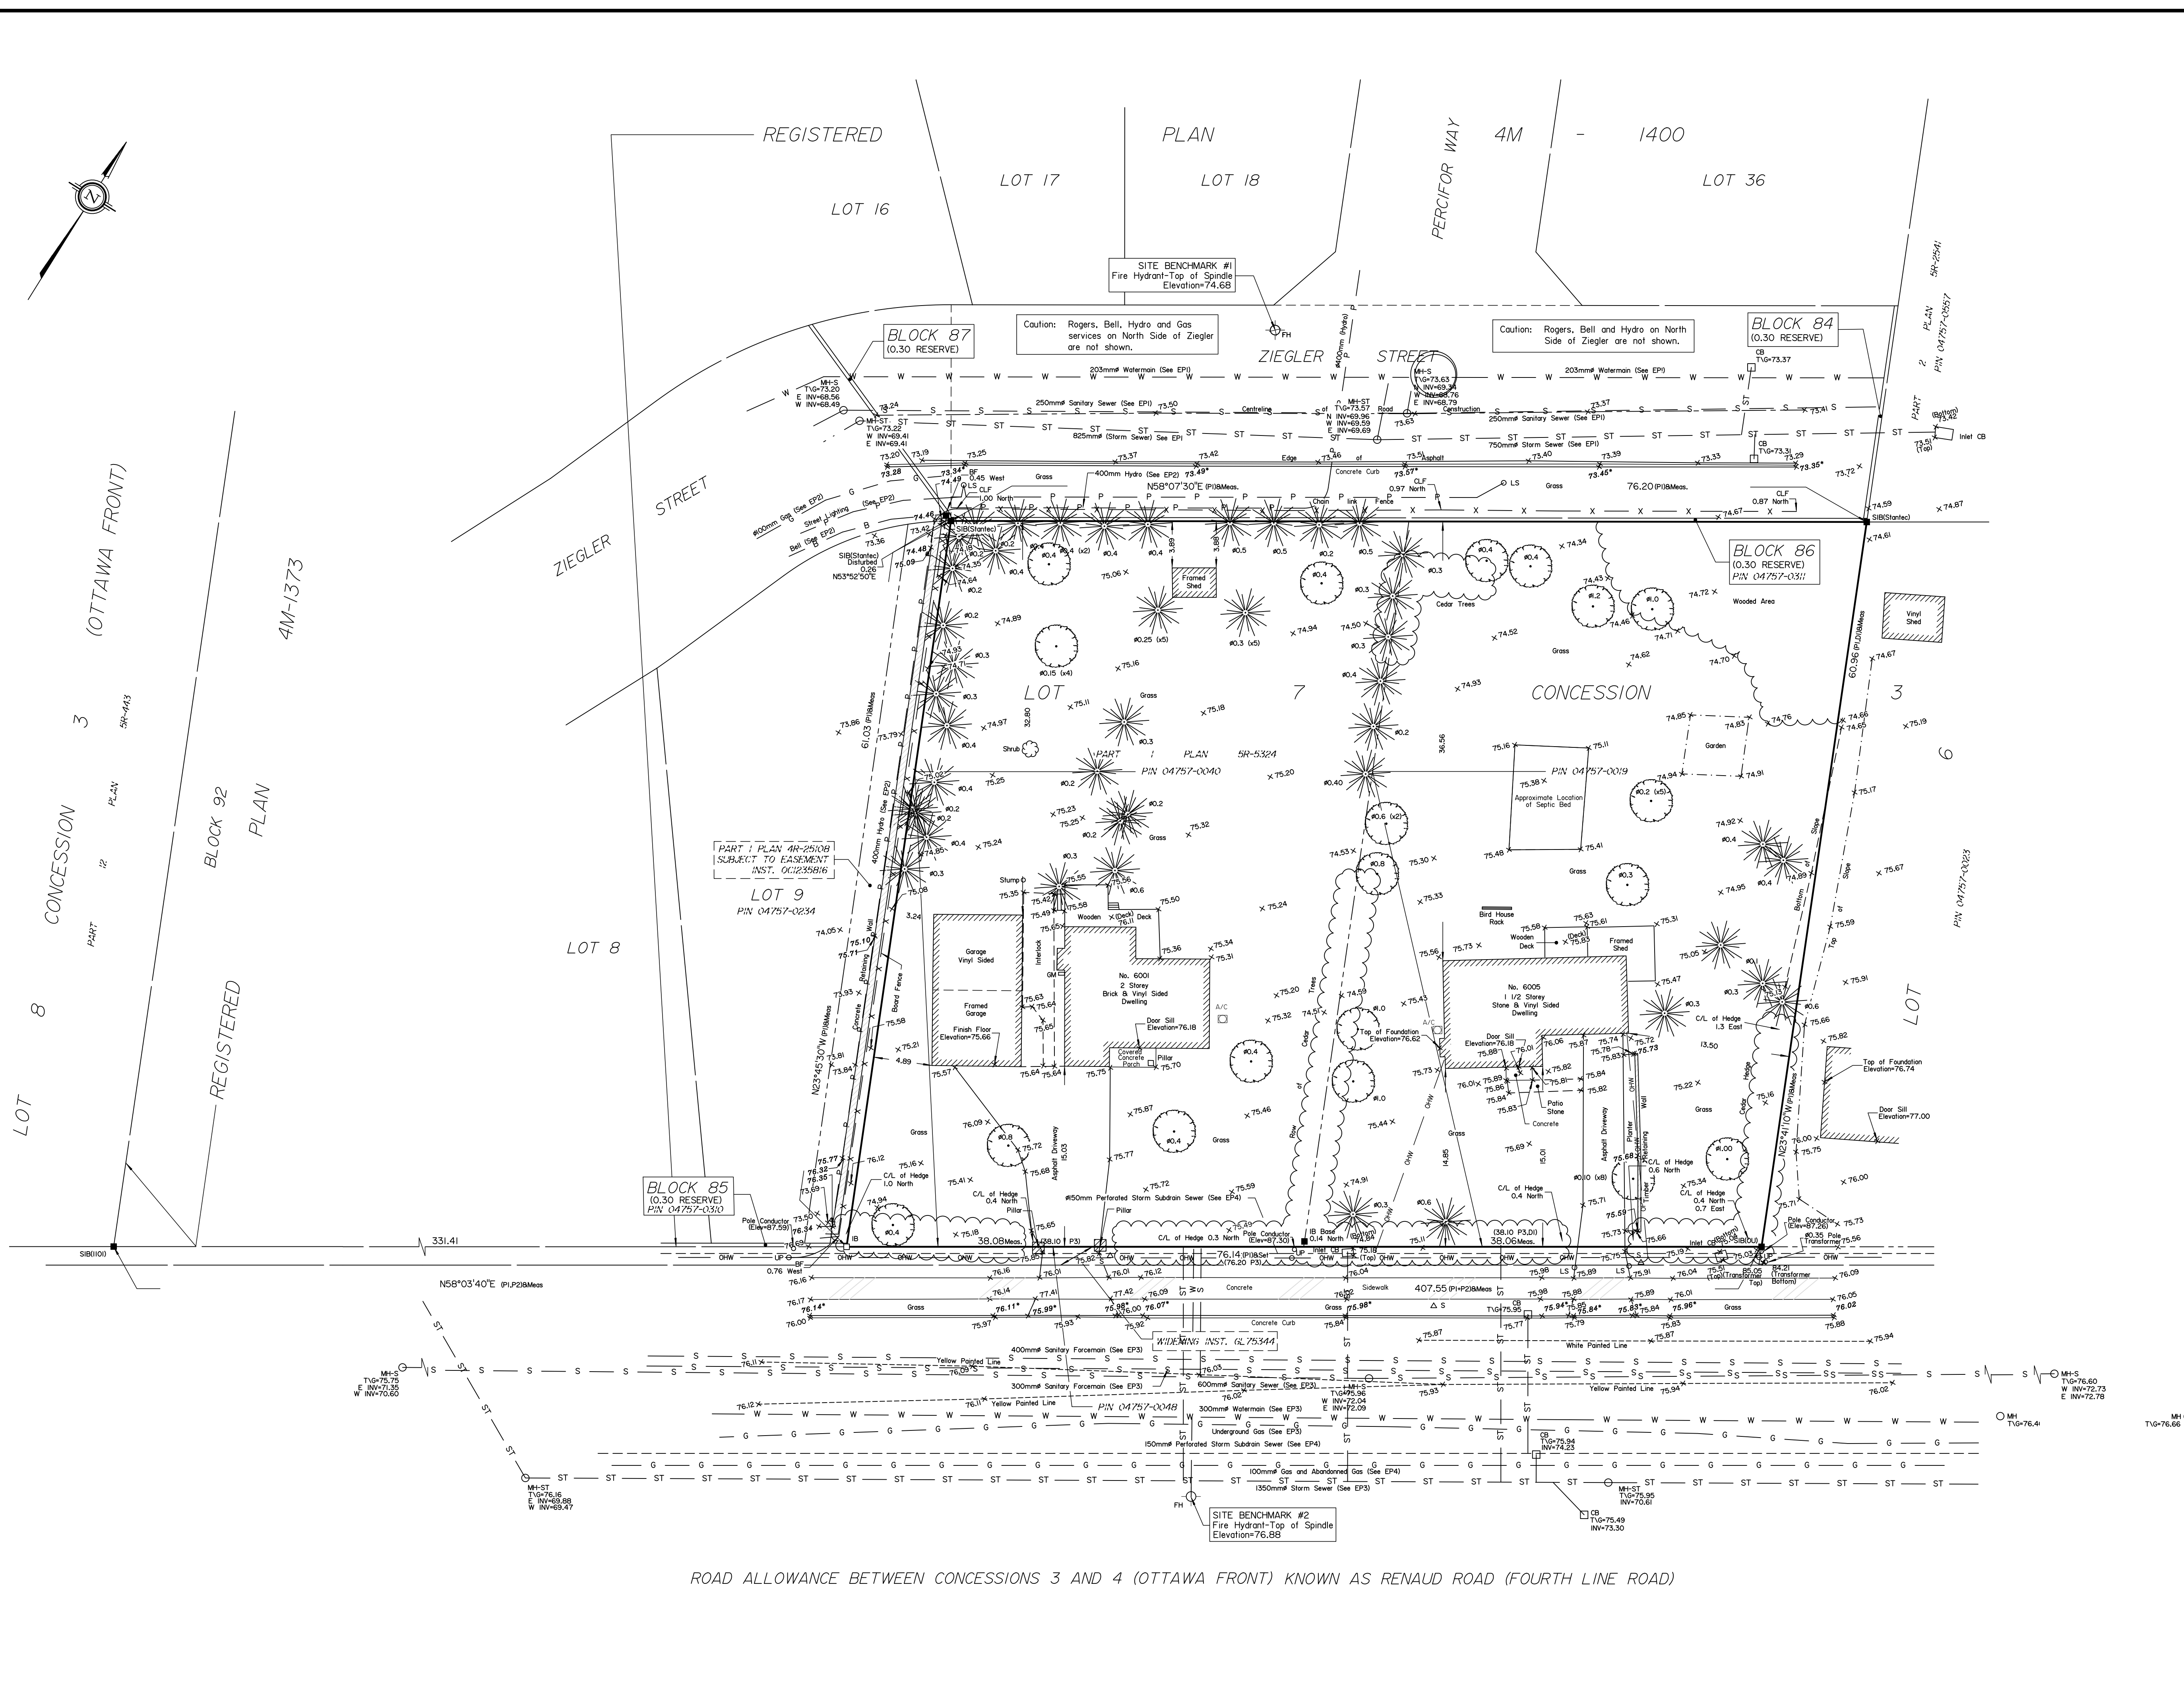


ROAD ALLOWANCE BETWEEN CONCESSIONS 3 AND 4 (OTTAWA FRONT) KNOWN AS RENAUD ROAD (FOURTH LINE ROAD)

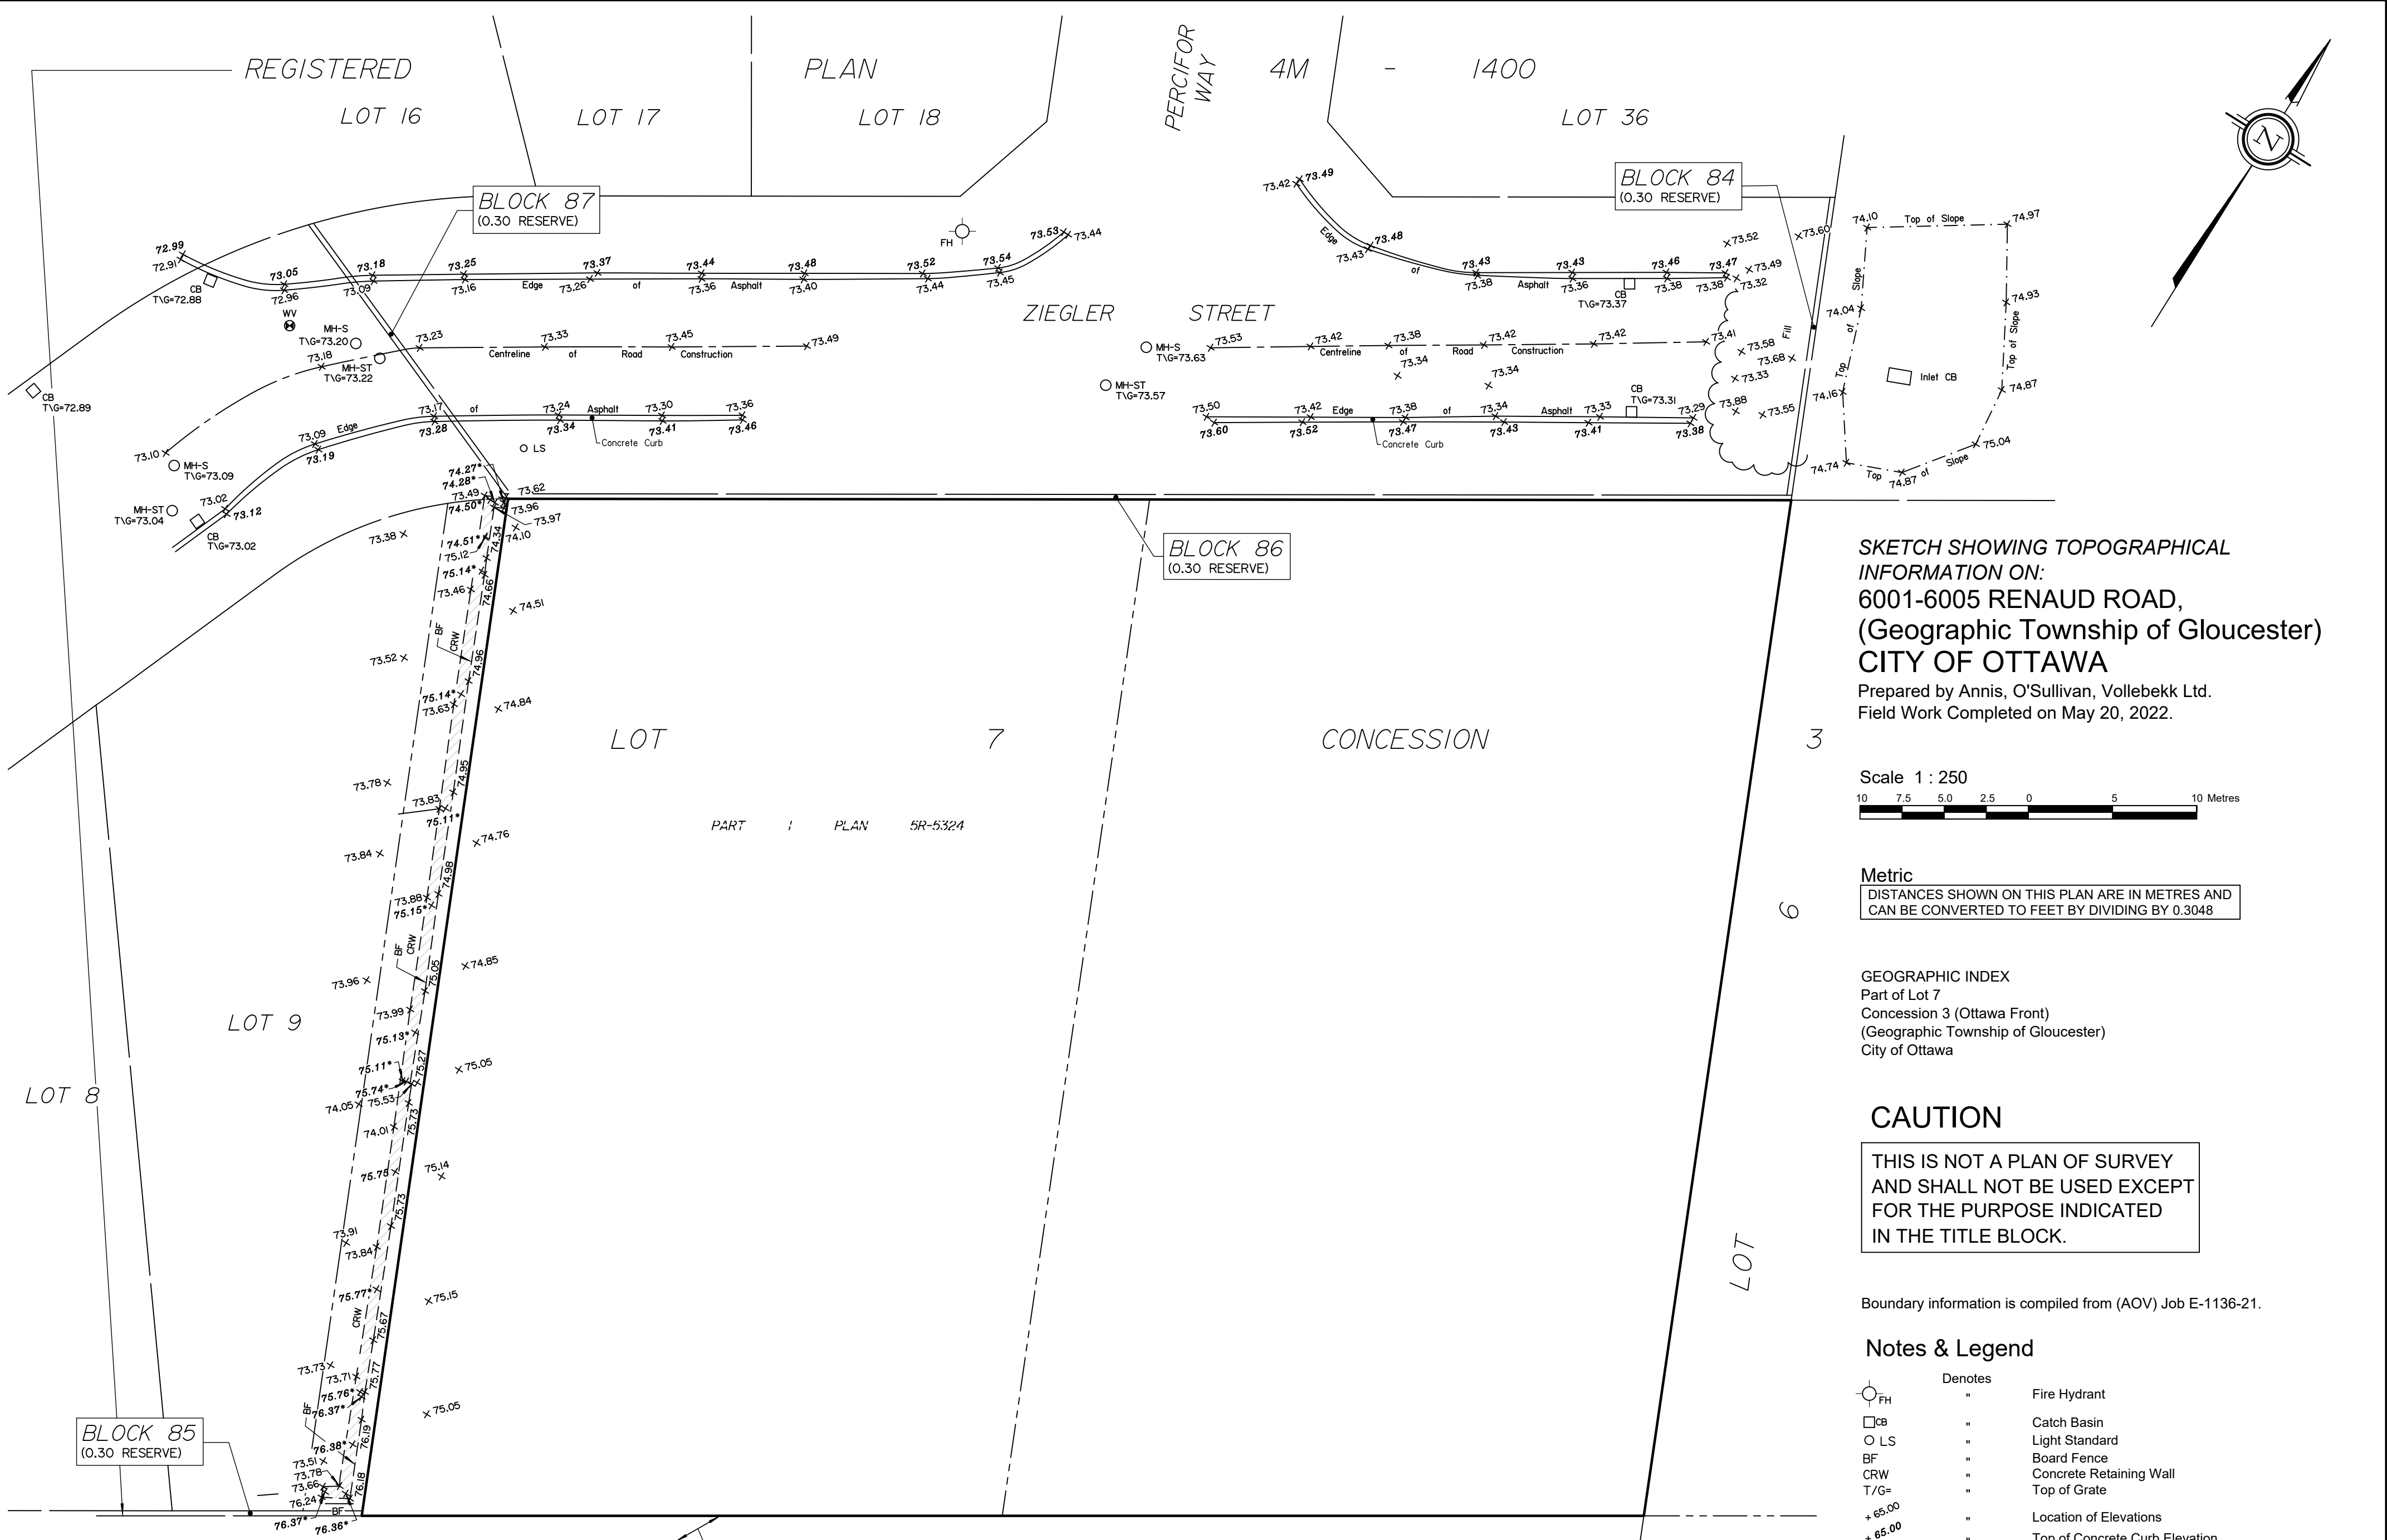

**SKETCH SHOWING TOPOGRAPHICAL INFORMATION ON:
6001-6005 RENAUD ROAD,
(Geographic Township of Gloucester)
CITY OF OTTAWA**

Prepared by Annis, O'Sullivan, Vollebek Ltd.
Field Work Completed on May 20, 2022.

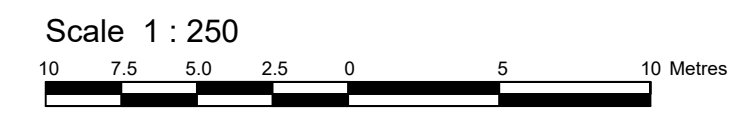

Metric
DISTANCES SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

GEOGRAPHIC INDEX
Part of Lot 7
Concession 3 (Ottawa Front)
(Geographic Township of Gloucester)
City of Ottawa

CAUTION
THIS IS NOT A PLAN OF SURVEY AND SHALL NOT BE USED EXCEPT FOR THE PURPOSE INDICATED IN THE TITLE BLOCK.

Boundary information is compiled from (AOV) Job E-1136-21.

Notes & Legend

Symbol	Denotes
	Fire Hydrant
	Catch Basin
	Light Standard
	Board Fence
	Concrete Retaining Wall
	Top of Grate
+ 65.00	Location of Elevations
+ 65.00	Top of Concrete Curb Elevation
+ 65.00*	Top of Retaining Wall Elevation
C/L	Centreline
---	Property Line

ROAD ALLOWANCE BETWEEN CONCESSIONS 3 AND 4 (OTTAWA FRONT)
KNOWN AS RENAUD ROAD (FOURTH LINE ROAD)

ELEVATION NOTES

- Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
- It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.

UTILITY NOTES


- This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
- Only visible surface utilities were located.
- A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

© Annis, O'Sullivan, Vollebek Ltd, 2022. "THIS PLAN IS PROTECTED BY COPYRIGHT"

ANNIS, O'SULLIVAN, VOLLEBEK LTD.
165 Bay Street
Embrun, Ont. K0A 1W1
Phone: (613) 443-3364
Email: Embrun@aovltd.com

Ontario Land Surveyors Job No. E-1136-21

SKETCH SHOWING TOPOGRAPHICAL INFORMATION ON:
 6001-6005 RENAUD ROAD,
 (Geographic Township of Gloucester)
 CITY OF OTTAWA
 Prepared by Annis, O'Sullivan, Vollebek Ltd.
 Field Work Completed on October 20, 2023.



Metric
 DISTANCES SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

GEOGRAPHIC INDEX
 Part of Lot 7
 Concession 3 (Ottawa Front)
 (Geographic Township of Gloucester)
 City of Ottawa

CAUTION
 THIS IS NOT A PLAN OF SURVEY AND SHALL NOT BE USED EXCEPT FOR THE PURPOSE INDICATED IN THE TITLE BLOCK.

Notes & Legend


+ 65.00	Denotes	Location of Elevations
+ 65.00	"	Top of Concrete Curb Elevation
C/L	"	Centreline
—	"	Property Line

ELEVATION NOTES

- Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
- It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.

UTILITY NOTES

- This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
- Only visible surface utilities were located.
- A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

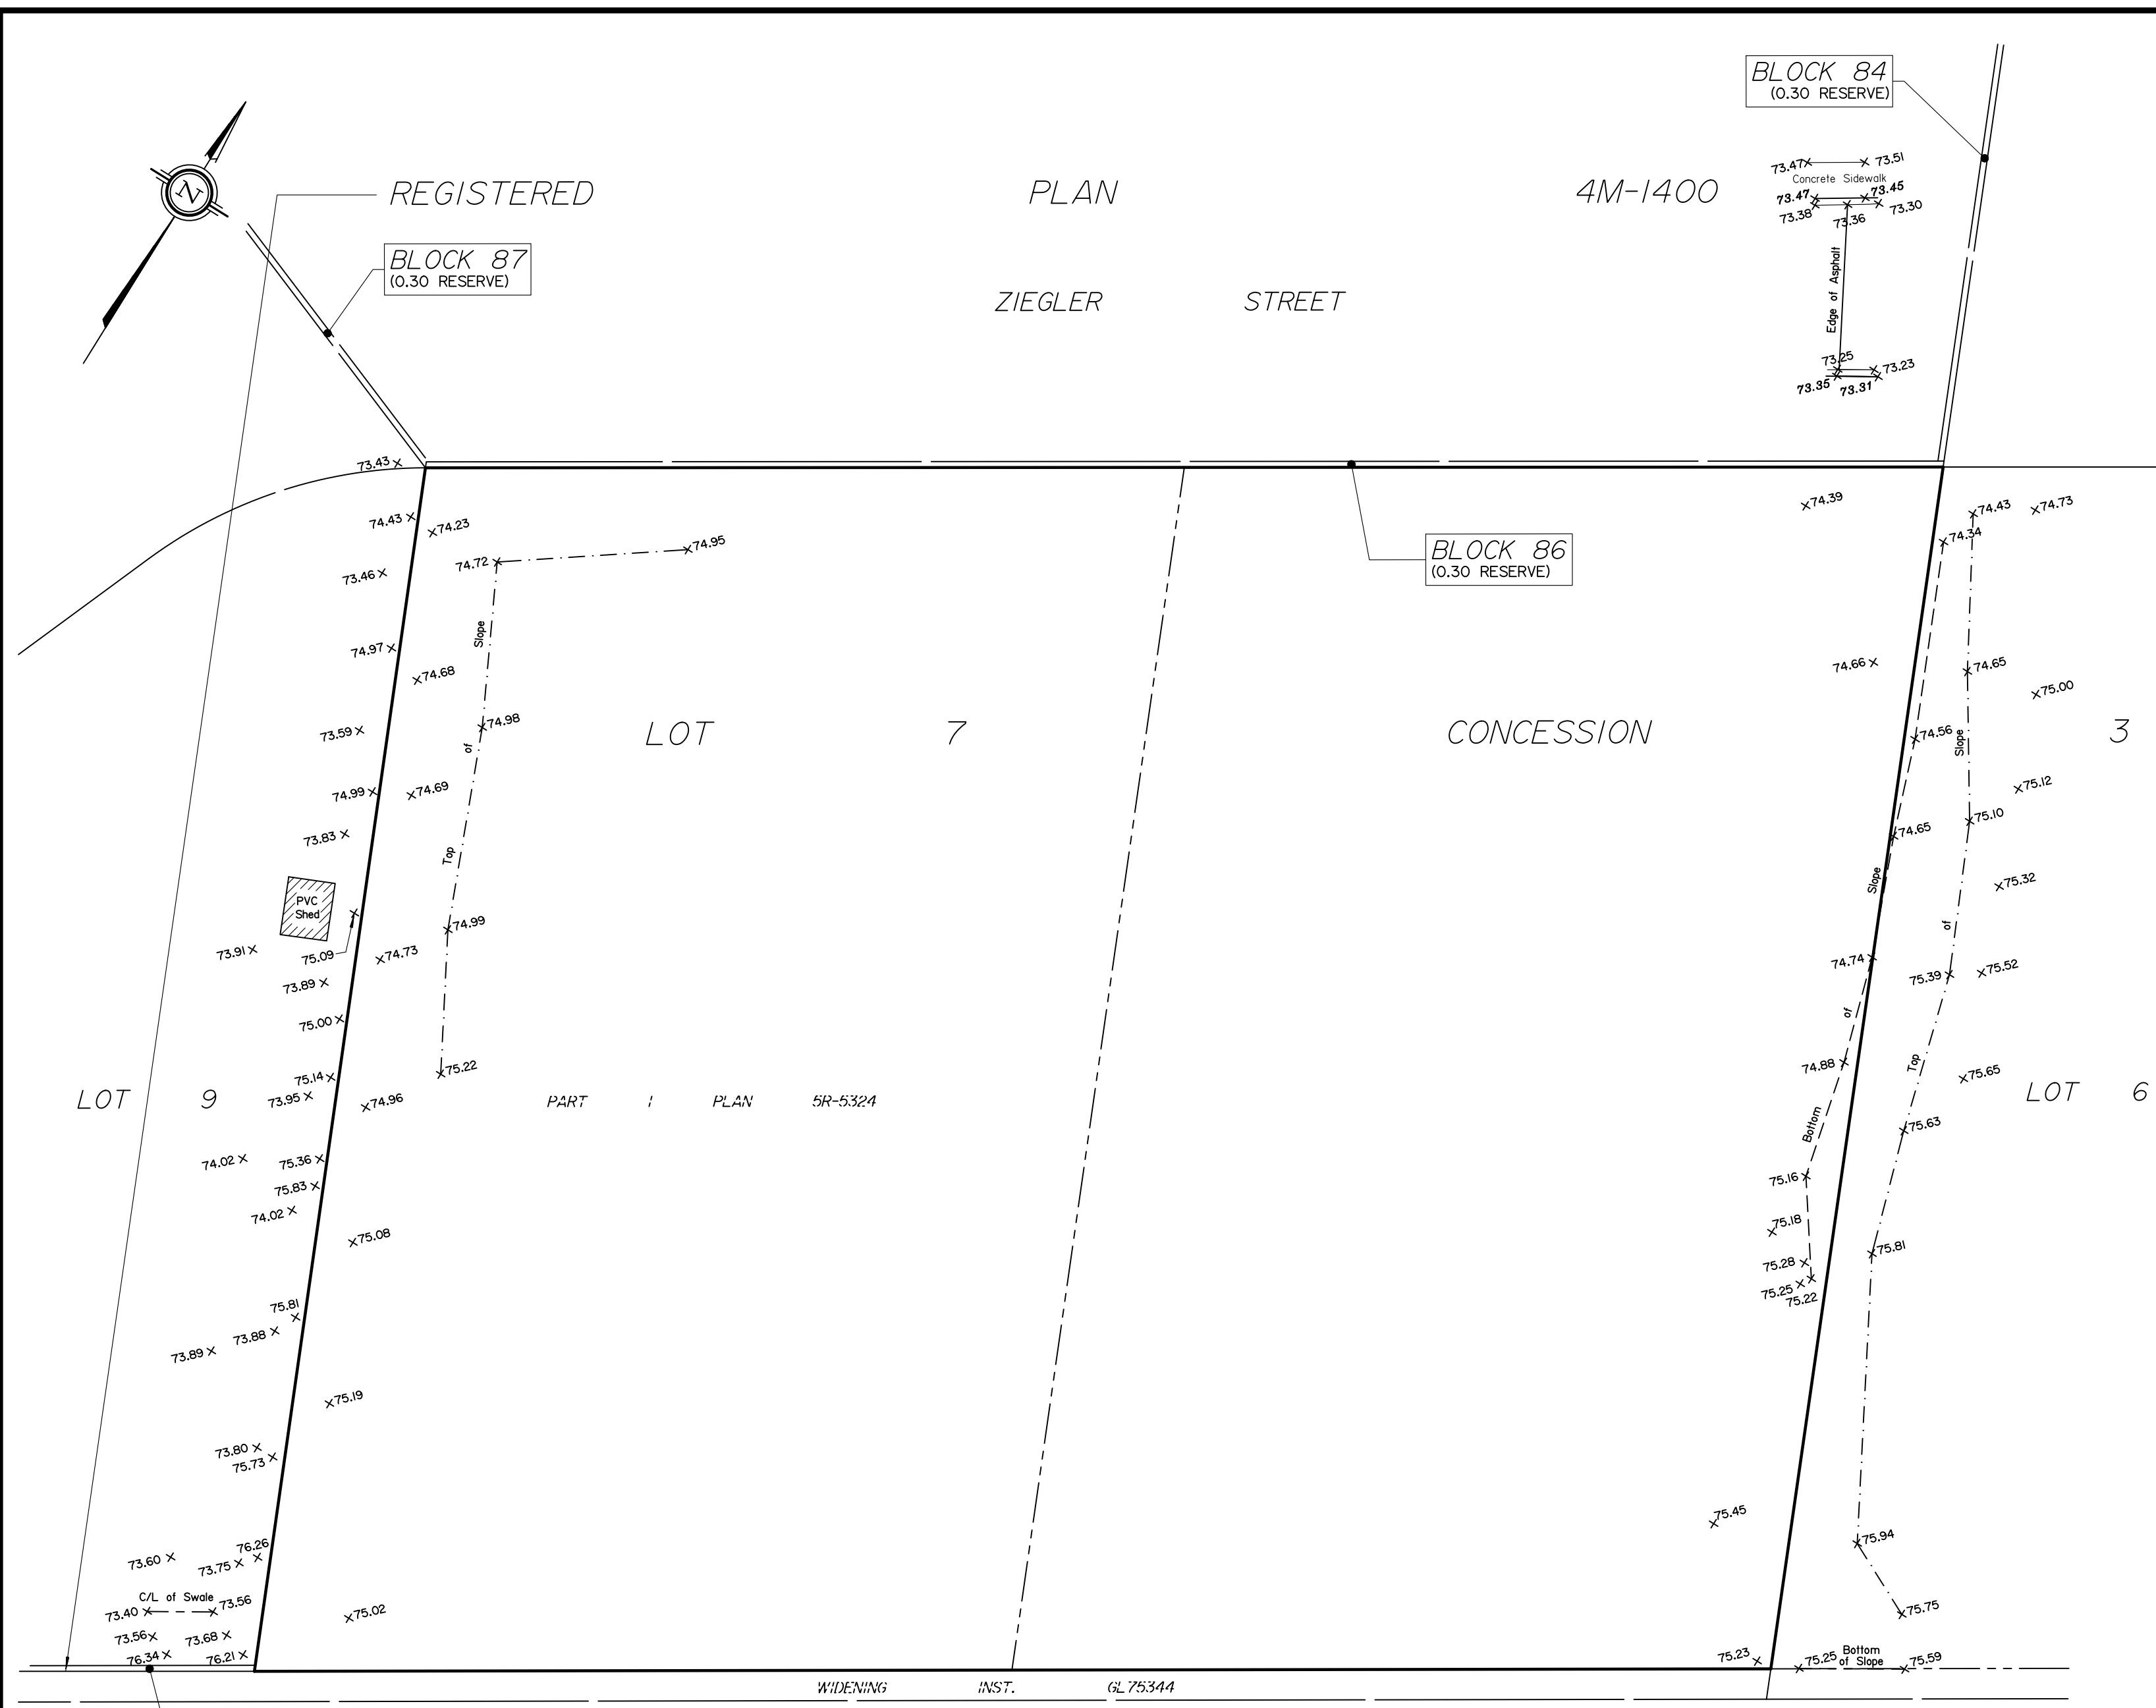

REGISTERED

PLAN

4M-1400

ZIEGLER STREET

BLOCK 84
(0.30 RESERVE)

BLOCK 87
(0.30 RESERVE)

BLOCK 86
(0.30 RESERVE)

LOT 7

CONCESSION 3

LOT 6

PART I PLAN 5R-5324

LOT 9

BLOCK 84
(0.30 RESERVE)

ROAD ALLOWANCE BETWEEN CONCESSIONS 3 AND 4 (OTTAWA FRONT)
 KNOWN AS RENAUD ROAD (FOURTH LINE ROAD)

© Annis, O'Sullivan, Vollebek Ltd, 2023. "THIS PLAN IS PROTECTED BY COPYRIGHT"

ANNIS, O'SULLIVAN, VOLLEBEK LTD.
 165 Bay Street
 Embrun, Ont. K0A 1W1
 Phone: (613) 443-3364
 Email: Embrun@aovltd.com

Ontario Land Surveyors Job No. 3430-23 A.M.

SKETCH SHOWING TOPOGRAPHICAL INFORMATION ON:
 6001-6005 RENAUD ROAD,
 (Geographic Township of Gloucester)
CITY OF OTTAWA
 Prepared by Annis, O'Sullivan, Vollebakk Ltd.
 Field Work Completed on October 20, 2023.



Metric
 DISTANCES SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

GEOGRAPHIC INDEX
 Part of Lot 7
 Concession 3 (Ottawa Front)
 (Geographic Township of Gloucester)
 City of Ottawa

CAUTION
 THIS IS NOT A PLAN OF SURVEY AND SHALL NOT BE USED EXCEPT FOR THE PURPOSE INDICATED IN THE TITLE BLOCK.

Notes & Legend


+ 65.00	Denotes	Location of Elevations
+ 65.00	"	Top of Concrete Curb Elevation
C/L	"	Centreline
—	"	Property Line

ELEVATION NOTES

- Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
- It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.

UTILITY NOTES

- This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
- Only visible surface utilities were located.
- A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

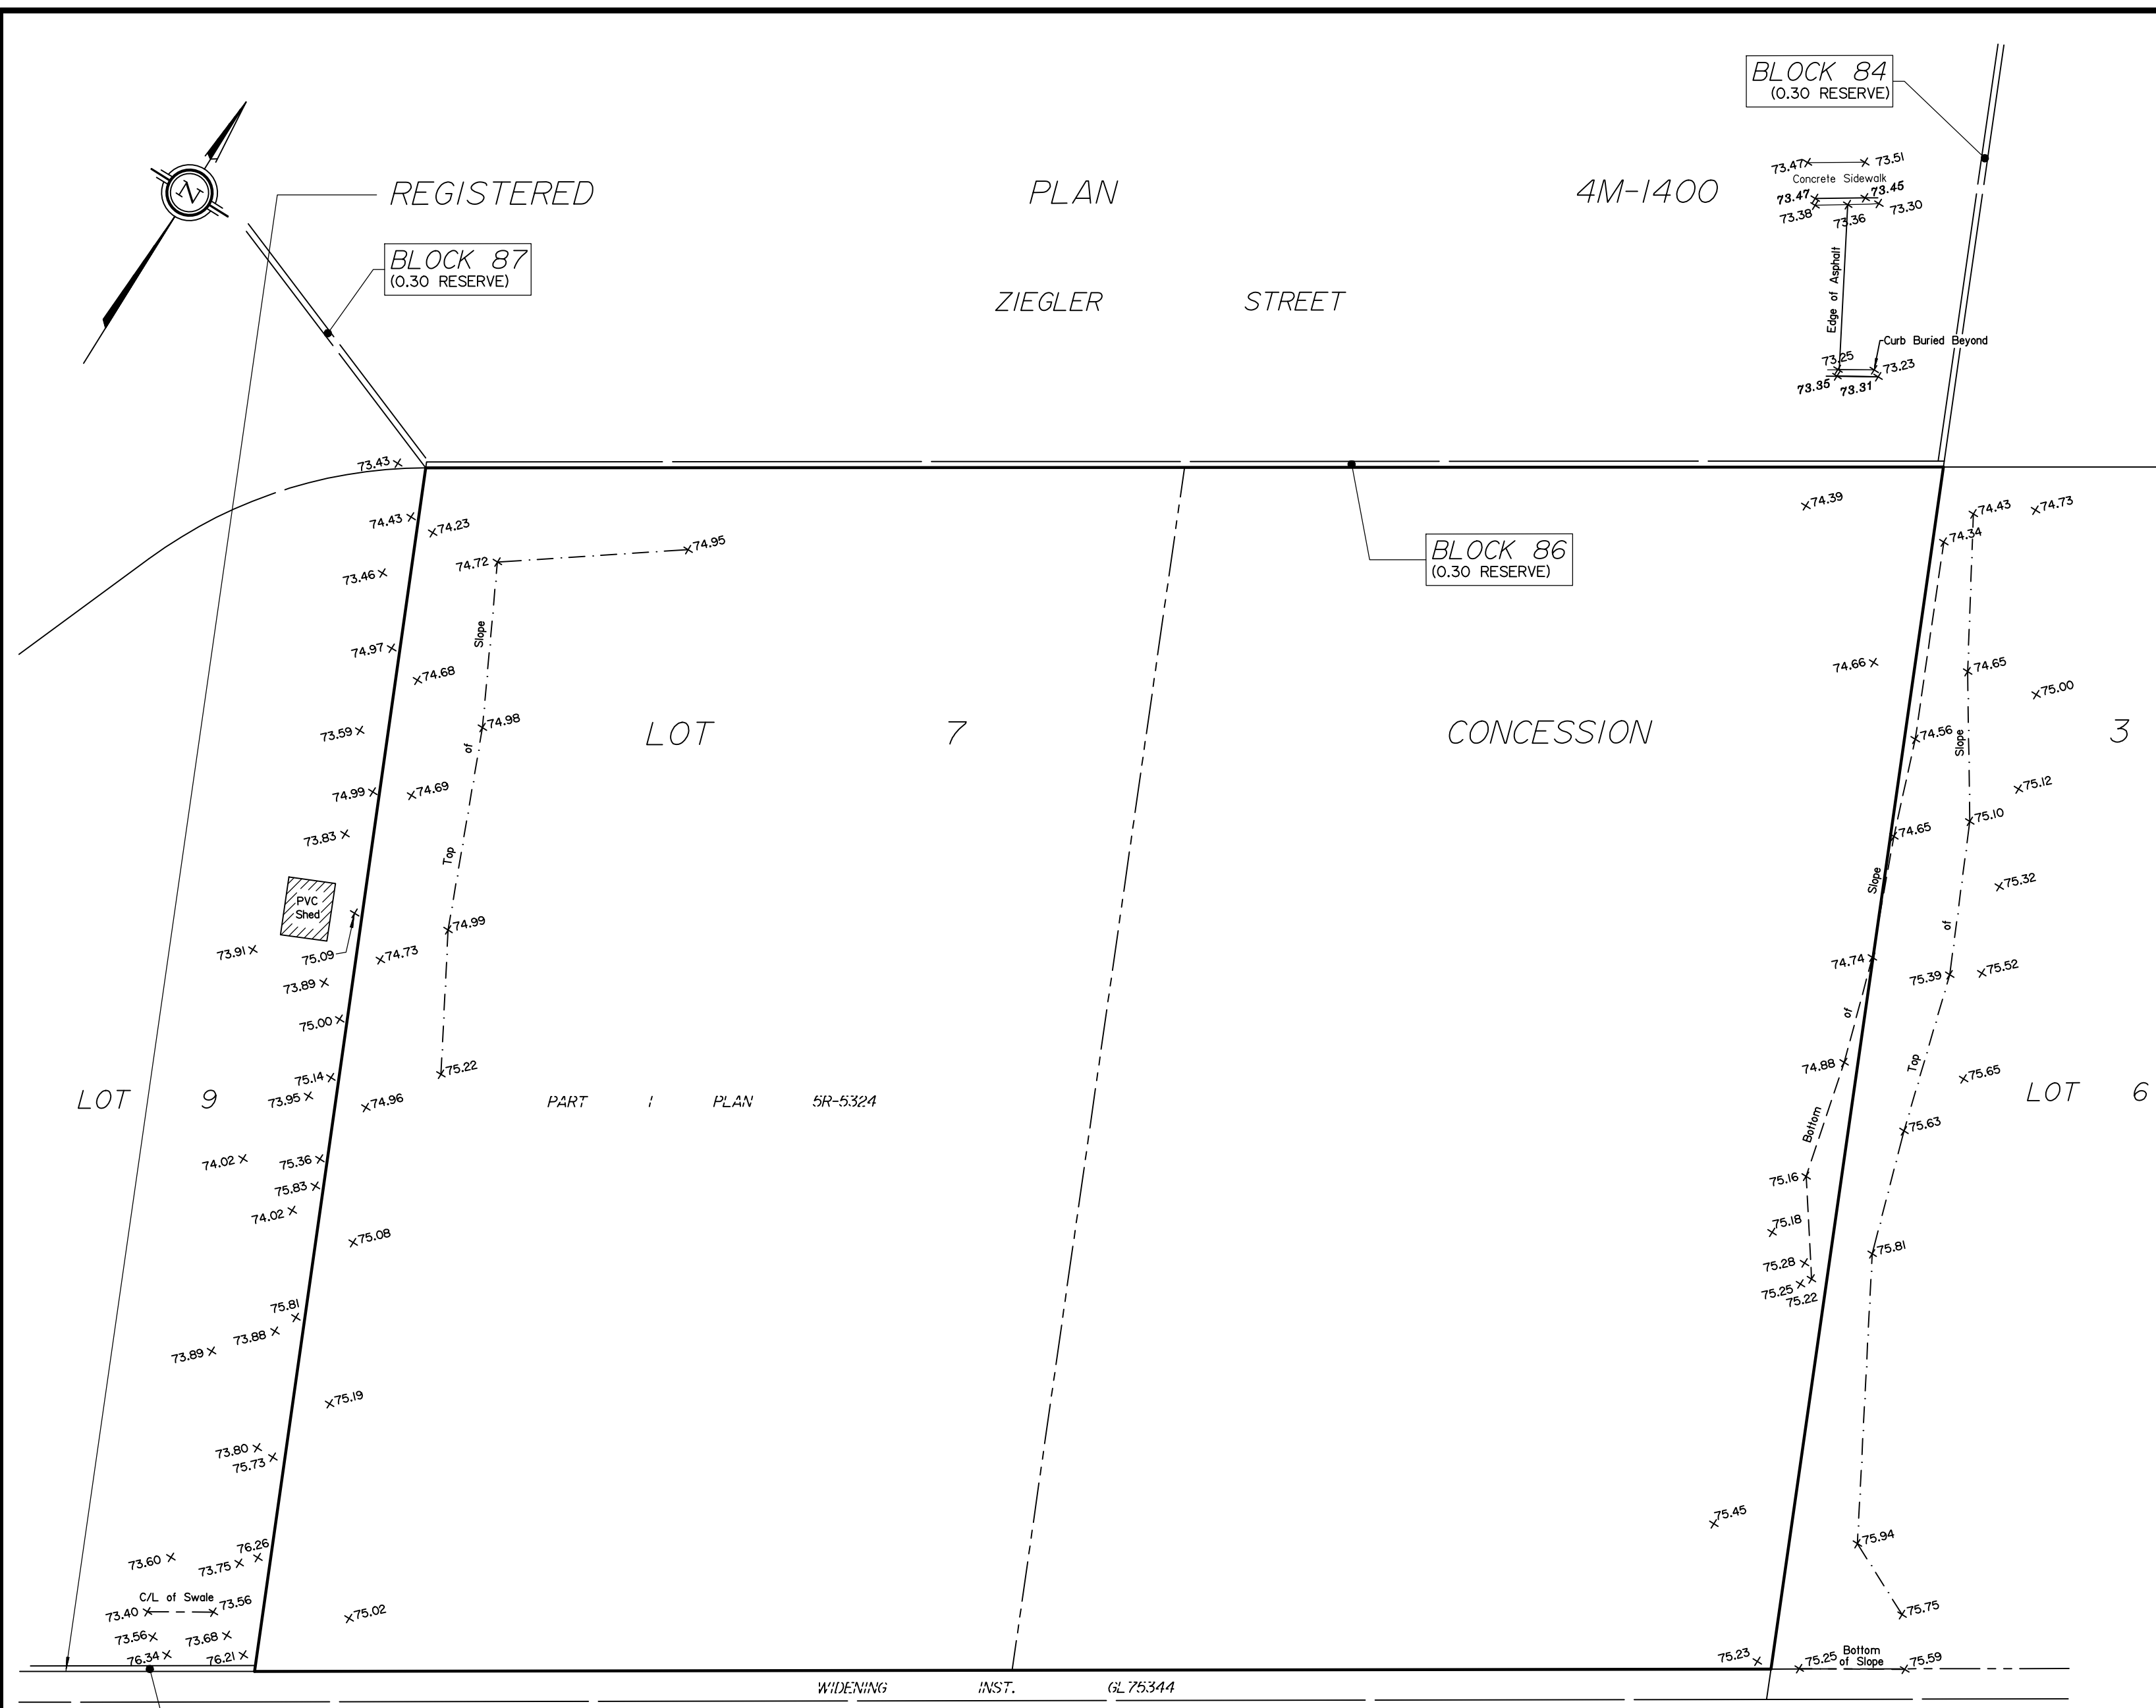

REGISTERED

PLAN

4M-1400

ZIEGLER STREET

BLOCK 87
(0.30 RESERVE)

BLOCK 84
(0.30 RESERVE)

BLOCK 86
(0.30 RESERVE)

LOT 7

CONCESSION 3

LOT 6

PART 1 PLAN 5R-5324

LOT 9

WIDENING INST. GL 75344

ROAD ALLOWANCE BETWEEN CONCESSIONS 3 AND 4 (OTTAWA FRONT)
 KNOWN AS RENAUD ROAD (FOURTH LINE ROAD)

© Annis, O'Sullivan, Vollebakk Ltd, 2023. "THIS PLAN IS PROTECTED BY COPYRIGHT"

ANNIS, O'SULLIVAN, VOLLEBEKK LTD.
 165 Bay Street
 Embrun, Ont. K0A 1W1
 Phone: (613) 443-3364
 Email: Embrun@aovltd.com

Ontario Land Surveyors Job No. 3430-23 A.M.

