



1 C101 REMOVALS AND EROSION CONTROL

- EROSION AND SEDIMENT CONTROL**
- THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES TO PROVIDE PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE DURING CONSTRUCTION ACTIVITIES. THIS INCLUDES LIMITING THE AMOUNT OF EXPOSED SOIL, TEMPORARY SEDIMENT CONTROL GEOSOCKS, CURBS WITH AN OVERFLOW UNDER GRATE OR COVER) TO BE IMPLEMENTED DURING CONSTRUCTION ON ALL PROPOSED ROAD CATCHBASINS, REHABILITATION CATCHBASINS AND CATCHBASIN MANHOLES AND OTHER SEDIMENT TRAPS. NO RECYCLED GEOSOCK MATERIAL SHALL BE PERMITTED FOR USE ON SITE.
 - AT THE DISCRETION OF THE PROJECT MANAGER OR MUNICIPAL STAFF, ADDITIONAL SILT CONTROL DEVICES SHALL BE INSTALLED AT DESIGNATED LOCATIONS.
 - FOR SILT FENCE BARRIER, USE OPSD 219.110.00. GETTEXTILE FOR SILT FENCE AS PER OPSD 1860. TABLE 3.
 - EXCEPT AS PROVIDED IN PARAGRAPHS 4.1., AND 4.2. BELOW, STABILIZATION MEASURES SHALL BE INITIATED AS SOON AS FEASIBLE IN PORTIONS OF THE SITE WHERE CONSTRUCTION ACTIVITIES HAVE TEMPORARILY OR PERMANENTLY CEASED, BUT IN NO CASE MORE THAN 14 DAYS AFTER THE CONSTRUCTION ACTIVITY HAS TEMPORARILY OR PERMANENTLY CEASED.
 - WHERE THE INITIATION OF STABILIZATION MEASURES BY THE 14TH DAY AFTER CONSTRUCTION ACTIVITY TEMPORARILY OR PERMANENTLY CEASES IS PRECLUDED BY SNOW COVER, STABILIZATION MEASURES SHALL BE INITIATED AS SOON AS FEASIBLE.
 - WHERE CONSTRUCTION ACTIVITY WILL RESUME ON A PORTION OF THE SITE WITHIN 21 DAYS FROM WHEN ACTIVITIES CEASED, (E.G. THE TOTAL TIME PERIOD THAT CONSTRUCTION ACTIVITY IS TEMPORARILY OR PERMANENTLY CEASED), AND TEMPORARY WATERCOURSES CROSSINGS SHALL NOT BE CONSTRUCTED OR UTILIZED, UNLESS OTHERWISE SPECIFIED IN THE CONTRACT. IF CLOSURE OF ANY PERMANENT WATER PASSAGE IS NECESSARY, THE CONTRACTOR SHALL RELEASE ANY STRANDED FISH TO THE OPEN PORTION OF THE WATERCOURSE WITHOUT HARM.
 - ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL CONFORM TO OPSD 577.
 - WHERE DEWATERING IS REQUIRED, THE DISCHARGED WATER SHALL BE CONTROLLED IN ACCORDANCE WITH OPSD 518.
 - ALL SETTLING/TRAP BASINS SHALL BE EQUIPPED WITH TERRAZIX 2 FOR GEOTEXTILE OR APPROVED EQUIVALENT AND SHALL BE CLEANED AND REPLACED AS REQUIRED.
 - IF REQUIRED, DEWATERING/SETTLING BASINS SHALL BE CONSTRUCTED AS PER OPSD 229.260 AND LOCATED ON FLAT GRADE UPSTREAM OF OTHER EXISTING MITIGATION MEASURES. WATERCOURSES SHALL NOT BE DIVERTED, OR BLOCKED, AND TEMPORARY WATERCOURSES CROSSINGS SHALL NOT BE CONSTRUCTED OR UTILIZED, UNLESS OTHERWISE SPECIFIED IN THE CONTRACT. IF CLOSURE OF ANY PERMANENT WATER PASSAGE IS NECESSARY, THE CONTRACTOR SHALL RELEASE ANY STRANDED FISH TO THE OPEN PORTION OF THE WATERCOURSE WITHOUT HARM.
 - ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL CONFORM TO OPSD 577.
 - WHERE DEWATERING IS REQUIRED, THE DISCHARGED WATER SHALL BE CONTROLLED IN ACCORDANCE WITH OPSD 518.
 - ALL SETTLING/TRAP BASINS SHALL BE EQUIPPED WITH TERRAZIX 2 FOR GEOTEXTILE OR APPROVED EQUIVALENT AND SHALL BE CLEANED AND REPLACED AS REQUIRED.
 - IF REQUIRED, DEWATERING/SETTLING BASINS SHALL BE CONSTRUCTED AS PER OPSD 229.260 AND LOCATED ON FLAT GRADE UPSTREAM OF OTHER EXISTING MITIGATION MEASURES. WATERCOURSES SHALL NOT BE DIVERTED, OR BLOCKED, AND TEMPORARY WATERCOURSES CROSSINGS SHALL NOT BE CONSTRUCTED OR UTILIZED, UNLESS OTHERWISE SPECIFIED IN THE CONTRACT. IF CLOSURE OF ANY PERMANENT WATER PASSAGE IS NECESSARY, THE CONTRACTOR SHALL RELEASE ANY STRANDED FISH TO THE OPEN PORTION OF THE WATERCOURSE WITHOUT HARM.
 - ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL CONFORM TO OPSD 577.
 - WHERE DEWATERING IS REQUIRED, THE DISCHARGED WATER SHALL BE CONTROLLED IN ACCORDANCE WITH OPSD 518.
 - ALL SETTLING/TRAP BASINS SHALL BE EQUIPPED WITH TERRAZIX 2 FOR GEOTEXTILE OR APPROVED EQUIVALENT AND SHALL BE CLEANED AND REPLACED AS REQUIRED.
 - IF REQUIRED, DEWATERING/SETTLING BASINS SHALL BE CONSTRUCTED AS PER OPSD 229.260 AND LOCATED ON FLAT GRADE UPSTREAM OF OTHER EXISTING MITIGATION MEASURES. WATERCOURSES SHALL NOT BE DIVERTED, OR BLOCKED, AND TEMPORARY WATERCOURSES CROSSINGS SHALL NOT BE CONSTRUCTED OR UTILIZED, UNLESS OTHERWISE SPECIFIED IN THE CONTRACT. IF CLOSURE OF ANY PERMANENT WATER PASSAGE IS NECESSARY, THE CONTRACTOR SHALL RELEASE ANY STRANDED FISH TO THE OPEN PORTION OF THE WATERCOURSE WITHOUT HARM.

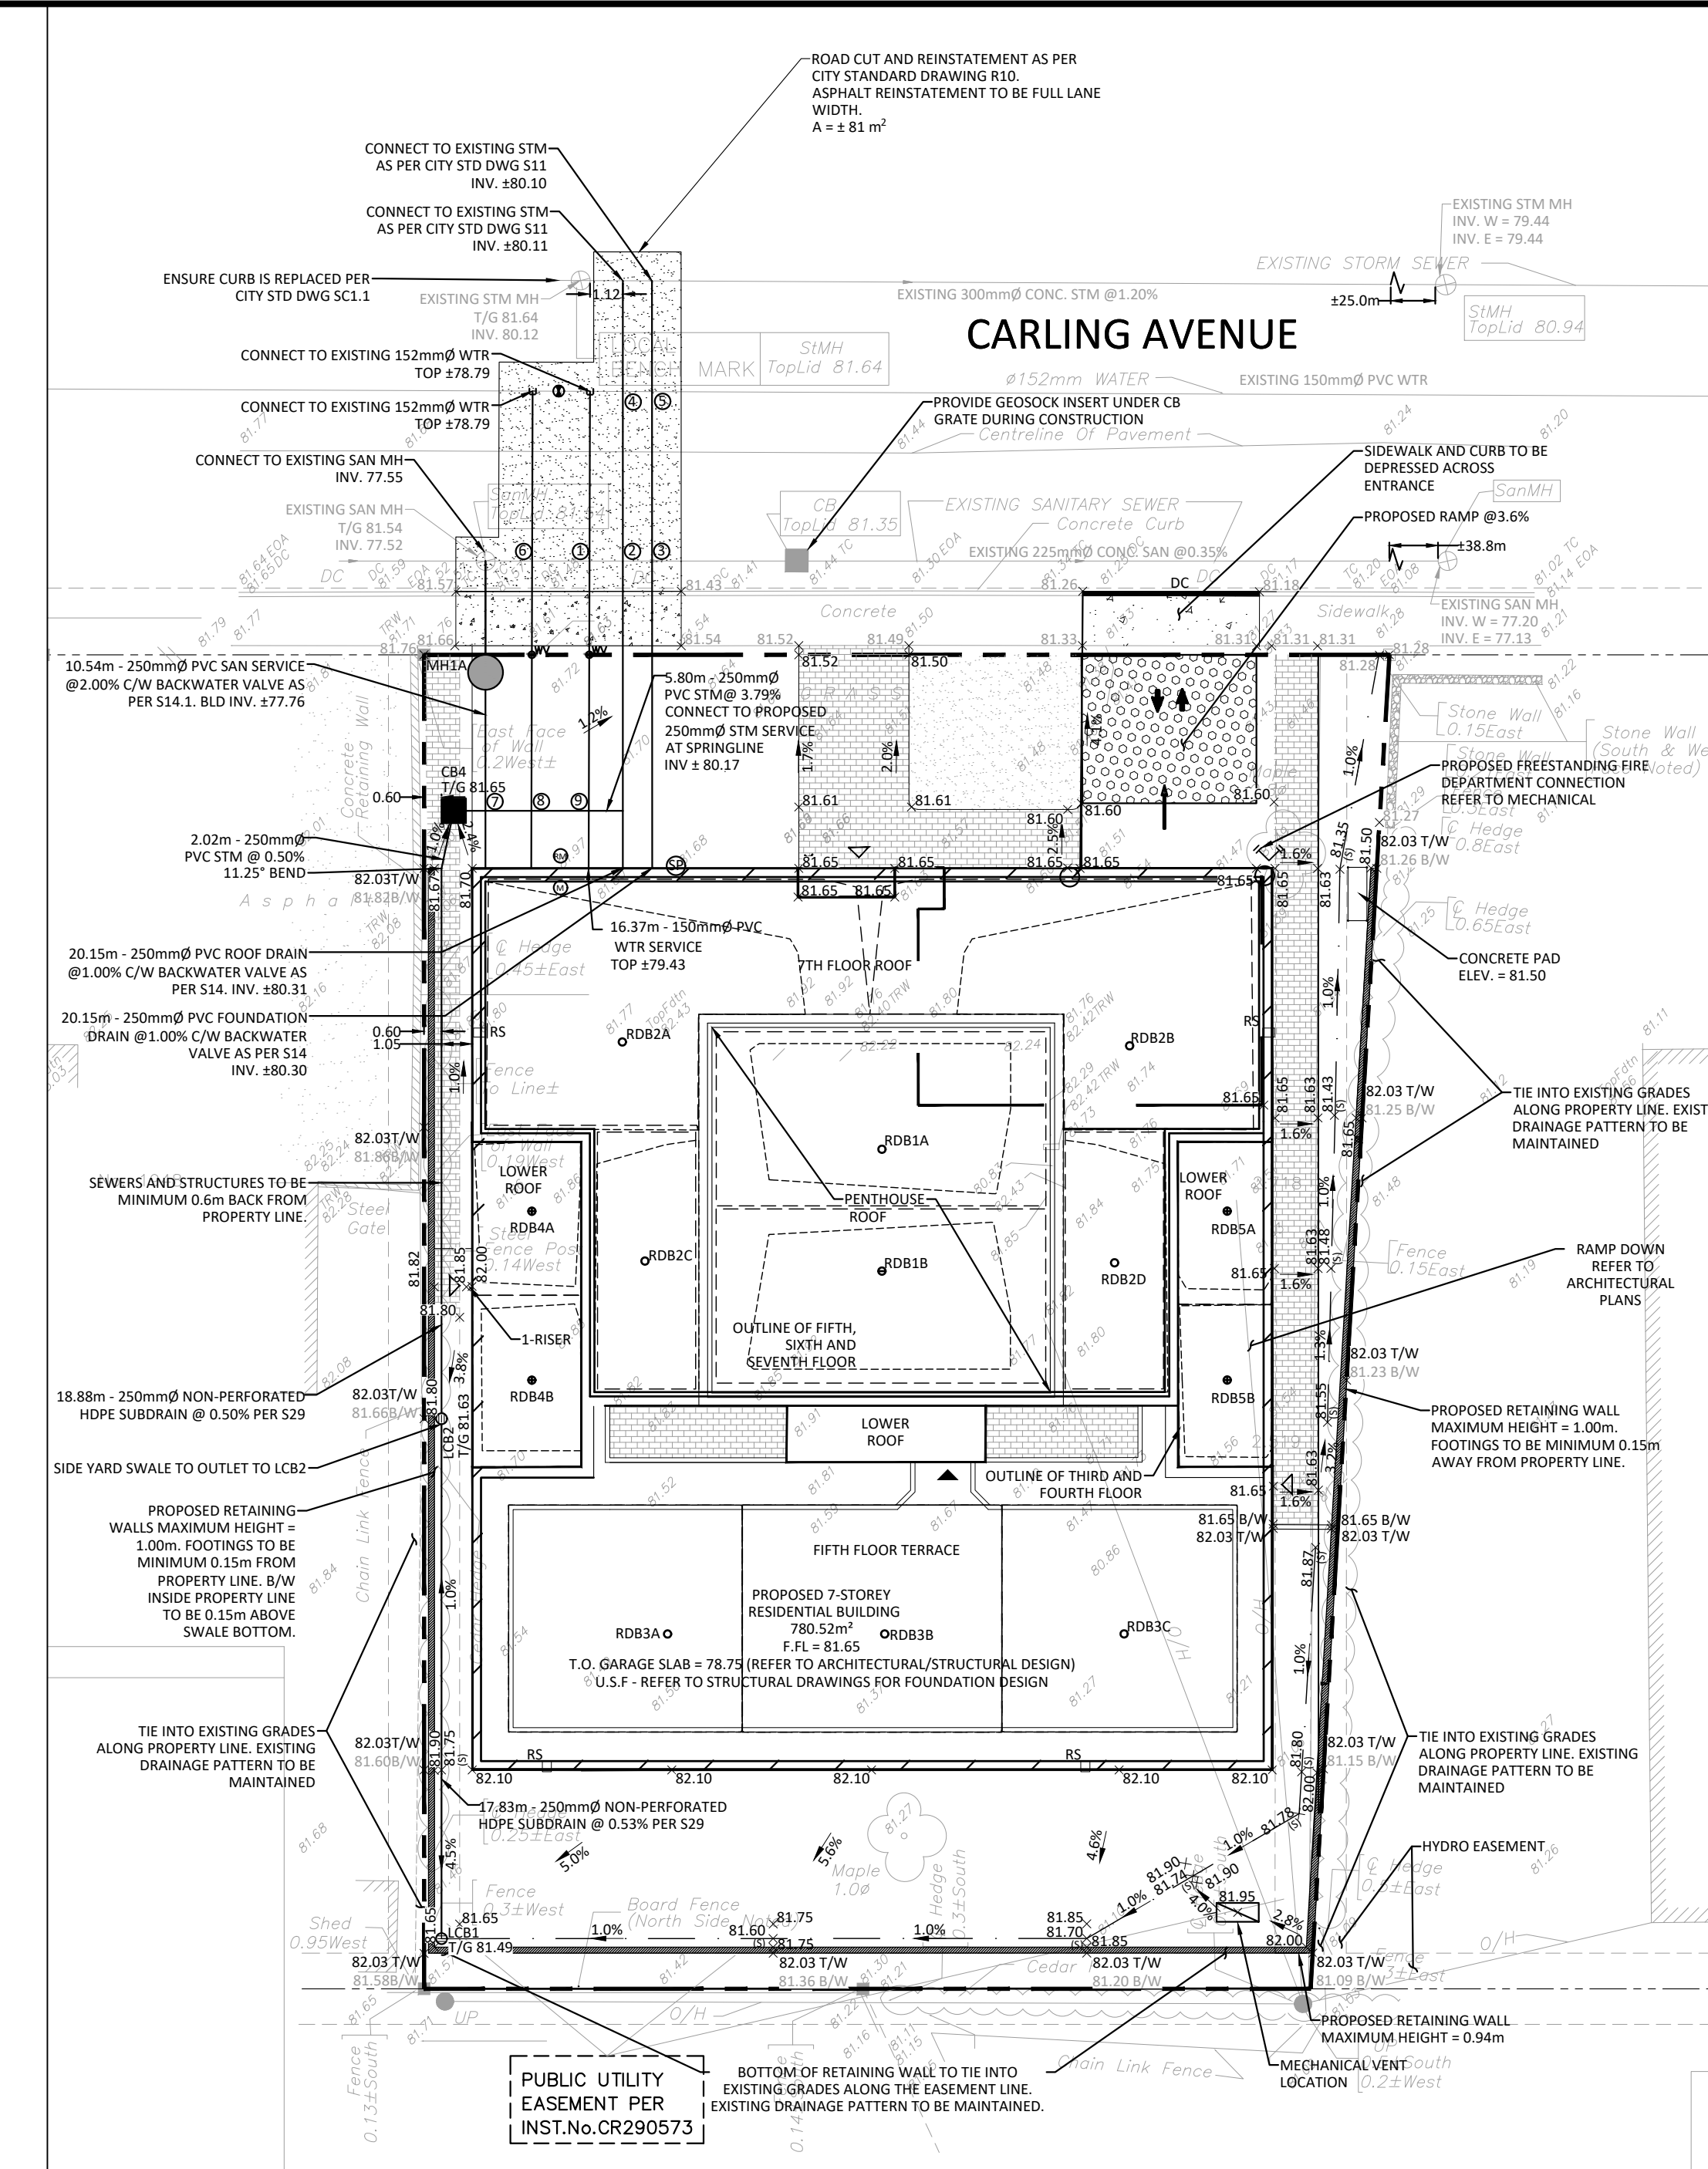

2 C101 SERVICING, SITE GRADING AND DRAINAGE

- GENERAL NOTES**
- THE ORIGINAL TOPOGRAPHY, GROUND ELEVATION AND SURVEY DATA SHOWN ARE SUPPLIED FOR INFORMATION PURPOSES ONLY, AND IN NO GUARANTEE OF ACCURACY. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY ALL INFORMATION SHOWN.
 - DUST CONTROL MEASURES SHOULD BE CONSIDERED PRIOR TO CLEARING AND GRADING. THE USE OF WATER, CALCIUM CHLORIDE FLAKES/SOLUTION OR MAGNESIUM CHLORIDE FLAKES/SOLUTION SHALL BE USED AS DUST SUPPRESSANTS AS PER OPSD 506. THIS IS TO LIMIT WIND EROSION OF SOILS WHICH MAY TRANSPORT SEDIMENTS OFFSITE, WHERE THEY MAY BE WASHED INTO THE RECEIVING WATER BY THE NEXT RAINSTORM.
 - THIS PLAN IS NOT A CADASTRAL SURVEY SHOWING LEGAL PROPERTY BOUNDARIES AND EASEMENTS. THE PROPERTY BOUNDARIES SHOWN HEREON HAVE BEEN DERIVED FROM INFORMATION SUPPLIED BY OR SHOWN ON) FARLEY, SMITH, DENIS LTD PLAN #81-05, AND CANNOT BE RELIED UPON TO BE ACCURATE OR COMPLETE. THE PRECISE LOCATION OF THE CURRENT PROPERTY BOUNDARIES AND EASEMENTS CAN ONLY BE DETERMINED BY AN UP-TO-DATE LAND TITLES SEARCH AND A SUBSEQUENT CADASTRAL SURVEY PERFORMED AND CERTIFIED BY AN ONTARIO LAND SURVEYOR.
 - ALL DISTURBED AREAS TO BE RESTORED TO ORIGINAL CONDITION OR BETTER UNLESS OTHERWISE SPECIFIED.
 - STOCKPILED MATERIAL IS TO BE STORED AWAY FROM POTENTIAL RECEIVERS (E.G. STORM CATCHBASINS, MANHOLES) AND BE SURROUNDED BY EROSION CONTROL MEASURES WHERE MATERIAL IS LEFT IN PLACE IN EXCESS OF 14 DAYS.
 - IF REQUIRED, DEWATERING/SETTLING BASINS SHALL BE CONSTRUCTED AS PER OPSD 229.260 AND LOCATED ON FLAT GRADE UPSTREAM OF OTHER EXISTING MITIGATION MEASURES. WATERCOURSES SHALL NOT BE DIVERTED, OR BLOCKED, AND TEMPORARY WATERCOURSES CROSSINGS SHALL NOT BE CONSTRUCTED OR UTILIZED, UNLESS OTHERWISE SPECIFIED IN THE CONTRACT. IF CLOSURE OF ANY PERMANENT WATER PASSAGE IS NECESSARY, THE CONTRACTOR SHALL RELEASE ANY STRANDED FISH TO THE OPEN PORTION OF THE WATERCOURSE WITHOUT HARM.
 - ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL CONFORM TO OPSD 577.
 - WHERE DEWATERING IS REQUIRED, THE DISCHARGED WATER SHALL BE CONTROLLED IN ACCORDANCE WITH OPSD 518.
 - ALL SETTLING/TRAP BASINS SHALL BE EQUIPPED WITH TERRAZIX 2 FOR GEOTEXTILE OR APPROVED EQUIVALENT AND SHALL BE CLEANED AND REPLACED AS REQUIRED.
 - IF REQUIRED, DEWATERING/SETTLING BASINS SHALL BE CONSTRUCTED AS PER OPSD 229.260 AND LOCATED ON FLAT GRADE UPSTREAM OF OTHER EXISTING MITIGATION MEASURES. WATERCOURSES SHALL NOT BE DIVERTED, OR BLOCKED, AND TEMPORARY WATERCOURSES CROSSINGS SHALL NOT BE CONSTRUCTED OR UTILIZED, UNLESS OTHERWISE SPECIFIED IN THE CONTRACT. IF CLOSURE OF ANY PERMANENT WATER PASSAGE IS NECESSARY, THE CONTRACTOR SHALL RELEASE ANY STRANDED FISH TO THE OPEN PORTION OF THE WATERCOURSE WITHOUT HARM.
 - ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL CONFORM TO OPSD 577.
 - WHERE DEWATERING IS REQUIRED, THE DISCHARGED WATER SHALL BE CONTROLLED IN ACCORDANCE WITH OPSD 518.
 - ALL SETTLING/TRAP BASINS SHALL BE EQUIPPED WITH TERRAZIX 2 FOR GEOTEXTILE OR APPROVED EQUIVALENT AND SHALL BE CLEANED AND REPLACED AS REQUIRED.
 - IF REQUIRED, DEWATERING/SETTLING BASINS SHALL BE CONSTRUCTED AS PER OPSD 229.260 AND LOCATED ON FLAT GRADE UPSTREAM OF OTHER EXISTING MITIGATION MEASURES. WATERCOURSES SHALL NOT BE DIVERTED, OR BLOCKED, AND TEMPORARY WATERCOURSES CROSSINGS SHALL NOT BE CONSTRUCTED OR UTILIZED, UNLESS OTHERWISE SPECIFIED IN THE CONTRACT. IF CLOSURE OF ANY PERMANENT WATER PASSAGE IS NECESSARY, THE CONTRACTOR SHALL RELEASE ANY STRANDED FISH TO THE OPEN PORTION OF THE WATERCOURSE WITHOUT HARM.
- SEWER NOTES:**
- CONSTRUCT ALL SEWERS, CATCH BASINS, MANHOLES AND APPURTENANCES IN ACCORDANCE WITH OPSD STANDARDS AND SPECIFICATIONS, AS WELL AS CITY.
 - SEWER TRENCHING AND BEDDING SHALL CONFORM TO OPSD 802.010 AND 802.013 UNLESS NOTED OTHERWISE.
 - BEDDING SHALL BE A MINIMUM 150mm OF GRANULAR "A", COMPACTED TO MINIMUM 95% STANDARD PROCTOR DRY DENSITY. CLEAR STONE BEDDING SHALL NOT BE PERMITTED.
 - SUB-BEDDING, IF REQUIRED SHALL CONSIST OF 450mm OF COMPACTED GRANULAR "B" TYPE 1.
 - BACKFILL TO AT LEAST 300mm ABOVE TOP OF PIPE WITH GRANULAR "A" OR GRANULAR "B" TYPE 1.
 - TO MINIMIZE DIFFERENTIAL FROST HEAVING, TRENCH BACKFILL (FROM PAVEMENT) SUBGRADE TO 2.0 METRES BELOW FINISHED GRADE SHALL MATCH EXISTING SOIL CONDITIONS.
 - SANITARY SEWERS AND CONNECTIONS 150mmØ AND SMALLER TO BE PVC 200-2.
 - SEWERS AND CONNECTIONS 300mmØ AND LARGER TO BE PVC 305-2. BEDDING TO BE TYPE "B" EXCEPT AT RESER, UNLESS NOTED OTHERWISE.
 - INSULATE ALL STORM AND SANITARY SEWERS/SERVICES THAT HAVE LESS THAN 2.0m OF COVER WITH THERMAL INSULATION AS PER OPSD 1109.030.
 - VALVES TO BE OPERATED BY CITY STAFF ONLY.
 - NO CONNECTION TO EXISTING WATER NETWORK SHALL BE COMPLETED UNTIL A WATER PERMIT IS OBTAINED FROM THE CITY. CITY TO BE PRESENT FOR WATERMAIN CONNECTION, CONNECTION, EXCAVATION, BACKFILLING AND REINSTATEMENT PER OPSD 1109.030.
 - IT WILL BE THE RESPONSIBILITY OF THE CONTRACTOR TO PERFORM ANY WATERMAIN CONNECTION(S) REQUIRED. THIS SHALL BE COMPLETED IN THE PRESENCE OF A DESIGNATED MUNICIPAL WATER OPERATOR AND THE SELECTED CONTRACTOR SHALL PROVE TO THE SATISFACTION OF THE CITY THAT THEY ARE COMPETENT TO PERFORM THE WORK PRIOR TO INITIATING CONSTRUCTION.
 - ALL WATERMANS SHALL BE EQUIPPED WITH BUTTERFLY AND GATE VALVES AS PER OPSD 1100.011.
 - ALL FIRE HYDRANTS, VALVE AND VALVE BOX SHALL CONFORM TO OPSD 1103.020.
 - CONCRETE THRUST BLOCKS TO CONFORM TO OPSD 1103.010 AND OPSD 1103.020.
 - ALL WATERMAIN TO BE CLASS 150 DR-18 OR APPROVED EQUIVALENT.
 - ALL WATERMAIN TO BE EQUIPPED WITH TRACER WIRE.
- WATERMAIN NOTES**
- CONSTRUCT ALL WATERMANS AND APPURTENANCES IN ACCORDANCE WITH OPSD STANDARDS AND SPECIFICATIONS, AS WELL AS CITY STANDARDS.
 - INDUSTRIAL/COMMERCIAL SERVICE CONNECTIONS TO BE 50mm COPPER PIPING AND SHALL CONFORM TO ASTM 888 TYPE "K" SOFT.
 - WATERMANS AND/OR WATER SERVICES ARE TO HAVE A MINIMUM COVER OF 2.4m. OTHERWISE THERMAL INSULATION IS REQUIRED AS PER CITY STANDARDS (IF AVAILABLE) OR OPSD 1109.030.
 - IF THE WATERMAIN MUST BE DEFLECTED TO MEET ALIGNMENT, ENSURE THAT THE AMOUNT OF DEFLECTION USED IS EQUAL TO OR LESS THAN THAT WHICH IS RECOMMENDED BY THE MANUFACTURER.
 - THERMAL INSULATION OF WATERMANS AT OPEN STRUCTURES AS PER CITY STANDARDS (IF AVAILABLE) OR OPSD 1109.030.
 - VALVES TO BE OPERATED BY CITY STAFF ONLY.
 - NO CONNECTION TO EXISTING WATER NETWORK SHALL BE COMPLETED UNTIL A WATER PERMIT IS OBTAINED FROM THE CITY. CITY TO BE PRESENT FOR WATERMAIN CONNECTION, CONNECTION, EXCAVATION, BACKFILLING AND REINSTATEMENT PER OPSD 1109.030.
 - IT WILL BE THE RESPONSIBILITY OF THE CONTRACTOR TO PERFORM ANY WATERMAIN CONNECTION(S) REQUIRED. THIS SHALL BE COMPLETED IN THE PRESENCE OF A DESIGNATED MUNICIPAL WATER OPERATOR AND THE SELECTED CONTRACTOR SHALL PROVE TO THE SATISFACTION OF THE CITY THAT THEY ARE COMPETENT TO PERFORM THE WORK PRIOR TO INITIATING CONSTRUCTION.
 - ALL WATERMANS SHALL BE EQUIPPED WITH BUTTERFLY AND GATE VALVES AS PER OPSD 1100.011.
 - ALL FIRE HYDRANTS, VALVE AND VALVE BOX SHALL CONFORM TO OPSD 1103.020.
 - CONCRETE THRUST BLOCKS TO CONFORM TO OPSD 1103.010 AND OPSD 1103.020.
 - ALL WATERMAIN TO BE CLASS 150 DR-18 OR APPROVED EQUIVALENT.
 - ALL WATERMAIN TO BE EQUIPPED WITH TRACER WIRE.
- CROSSING CONFLICT TABLE**
- | LOCATION | DESCRIPTION | SEPARATION |
|----------|------------------------------|------------|
| 1 | 150mmØ WTR SERVICE INV 78.86 | 1.03 |
| 2 | 225mmØ SAN SEWER OBY 77.73 | 2.48 |
| 3 | 225mmØ SAN SEWER OBY 77.73 | 2.47 |
| 4 | 200mmØ STM SERVICE INV 80.15 | 1.36 |
| 5 | 152mmØ WTR SEWER OBY 78.79 | 1.35 |
| 6 | 150mmØ WTR SERVICE INV 80.15 | 1.41 |
| 7 | 250mmØ STM SERVICE INV 80.35 | 0.36 |
| 8 | 250mmØ SAN SEWER OBY 77.99 | 0.95 |
| 9 | 150mmØ WTR SERVICE INV 79.34 | 0.87 |
- STM STRUCTURE TABLE**
- | NAME | RIM ELEV. | INVERT IN | INVERT OUT | DESCRIPTION |
|------|-----------|-----------|------------|---|
| CB4 | 81.65 | \$80.420 | \$80.390 | STRUC. OPSD 705.010 FRAME, CITY 519 COVER, CITY 519 |
| LCB1 | 81.49 | N80.630 | | PER CITY STANDARD 531 |
| LCB2 | 81.63 | \$80.536 | N80.530 | PER CITY STANDARD 530 |
- SAN STRUCTURE TABLE**
- | NAME | RIM ELEV. | INVERT IN | INVERT OUT | DESCRIPTION |
|------|-----------|-----------|------------|---|
| MHA | 81.70 | \$87.764 | NW7.61 | COVER CITY STD 524 FRAME CITY STD 525 STRUC. OPSD 701.010 |
- WATER COVER TABLE**
- | LOCATION | STATION | FINISHED GRADE | TOP OF PIPE | COVER |
|------------|----------|----------------|-------------|-------|
| BUILDING | 0+100.00 | 81.75 | 79.20 | 2.55 |
| VALVE | 0+101.62 | 81.66 | 79.14 | 2.52 |
| CROSSING 1 | 0+110.54 | 81.50 | 79.01 | 2.49 |
| CROSSING 2 | 0+116.37 | 81.57 | 78.79 | 2.78 |

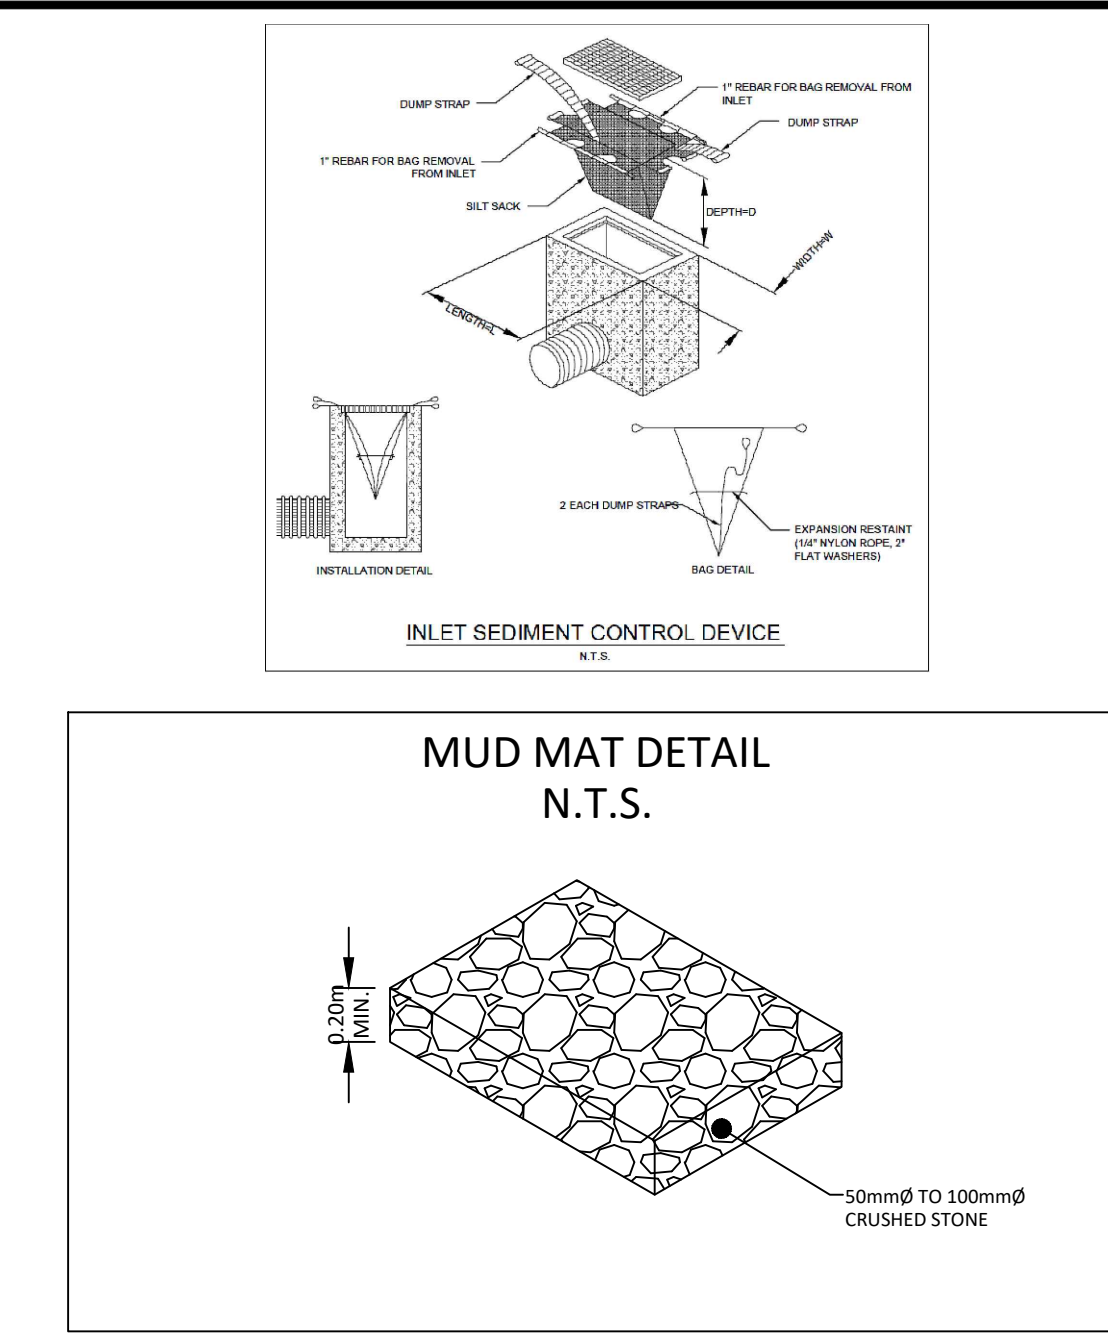

ROOF DRAIN (B1A)

TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	0.60	2.39
DEPTH OF FLOW (m)	0.045	0.085
DEPTH OF FLOW (m)	0.32	0.32
FLOW PER ROOF DRAIN (L/S)	0.32	0.32
DRAW DOWN TIME	33 min	126 min

ROOF DRAIN (B3A)

TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	1.03	3.85
DEPTH OF FLOW (m)	0.055	0.100
DEPTH OF FLOW (m)	0.32	0.32
FLOW PER ROOF DRAIN (L/S)	0.32	0.32
DRAW DOWN TIME	54 min	204 min

ROOF DRAIN (B1B)

TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	0.57	2.30
DEPTH OF FLOW (m)	0.045	0.080
DEPTH OF FLOW (m)	0.32	0.32
FLOW PER ROOF DRAIN (L/S)	0.32	0.32
DRAW DOWN TIME	30 min	122 min

ROOF DRAIN (B3B)

TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	1.24	4.53
DEPTH OF FLOW (m)	0.060	0.105
DEPTH OF FLOW (m)	0.32	0.32
FLOW PER ROOF DRAIN (L/S)	0.32	0.32
DRAW DOWN TIME	65 min	239 min

ROOF DRAIN (B2A)

TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	1.09	4.03
DEPTH OF FLOW (m)	0.055	0.095
DEPTH OF FLOW (m)	0.32	0.32
FLOW PER ROOF DRAIN (L/S)	0.32	0.32
DRAW DOWN TIME	58 min	213 min

ROOF DRAIN (B3C)

TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	1.07	4.00
DEPTH OF FLOW (m)	0.055	0.105
DEPTH OF FLOW (m)	0.32	0.32
FLOW PER ROOF DRAIN (L/S)	0.32	0.32
DRAW DOWN TIME	57 min	211 min

ROOF DRAIN (B2B)

TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	1.03	3.83
DEPTH OF FLOW (m)	0.055	0.095
DEPTH OF FLOW (m)	0.32	0.32
FLOW PER ROOF DRAIN (L/S)	0.32	0.32
DRAW DOWN TIME	55 min	203 min

ROOF DRAIN (B4A)

TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	0.09	0.58
DEPTH OF FLOW (m)	0.030	0.055
DEPTH OF FLOW (m)	0.32	0.32
FLOW PER ROOF DRAIN (L/S)	0.32	0.32
DRAW DOWN TIME	5 min	31 min

ROOF DRAIN (B4B)

TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	0.54	2.21
DEPTH OF FLOW (m)	0.045	0.080
DEPTH OF FLOW (m)	0.32	0.32
FLOW PER ROOF DRAIN (L/S)	0.32	0.32
DRAW DOWN TIME	29 min	117 min

ROOF DRAIN (B2C)

TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	0.72	2.87
DEPTH OF FLOW (m)	0.055	0.090
DEPTH OF FLOW (m)	0.32	0.32
FLOW PER ROOF DRAIN (L/S)	0.32	0.32
DRAW DOWN TIME	38 min	149 min

ROOF DRAIN (B4C)


TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	0.06	0.38
DEPTH OF FLOW (m)	0.025	0.045
DEPTH OF FLOW (m)	0.25	0.32
FLOW PER ROOF DRAIN (L/S)	4 min	20 min

ROOF DRAIN (B2D)

TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	0.72	2.87
DEPTH OF FLOW (m)	0.055	0.090
DEPTH OF FLOW (m)	0.32	0.32
FLOW PER ROOF DRAIN (L/S)	0.32	0.32
DRAW DOWN TIME	38 min	149 min

ROOF DRAIN (B5A)

TYPE OF CONTROL DEVICE	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)	WATTS DRAINAGE RD-100-A-AD (FULLY EXPOSED)
	2-YEAR	100-YEAR
ROOFTOP STORAGE (m³)	0.06	0.38
DEPTH OF FLOW (m)	0.025	0.045
DEPTH OF FLOW (m)	0.25	0.32
FLOW PER ROOF DRAIN (L/S)	4 min	20 min

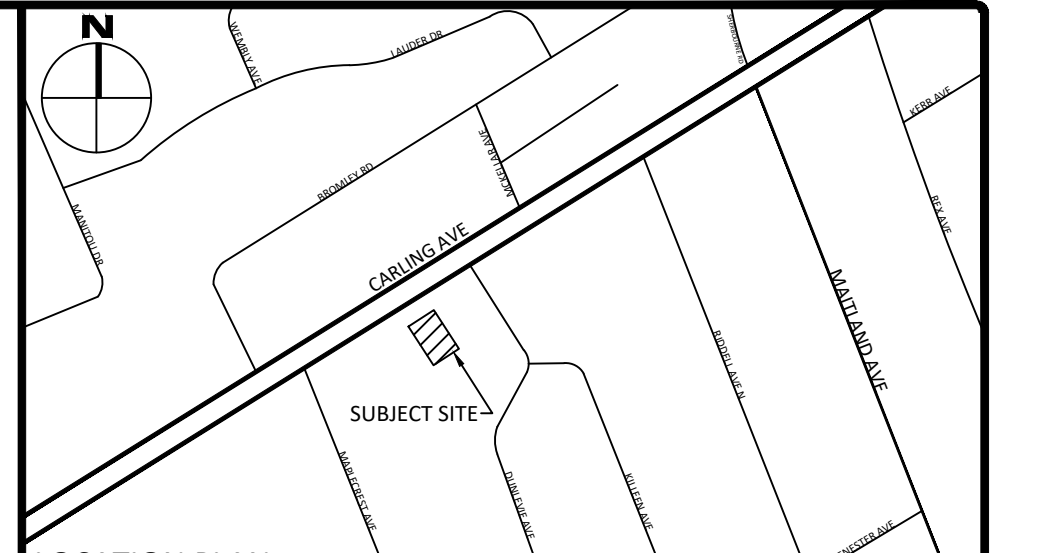

LEGEND

- CONCRETE BARRIER CURB
- CONCRETE WALKWAY
- PROPOSED ASPHALT
- PROPOSED LANDSCAPED AREA
- STORM SEWER MANHOLE
- CATCHBASIN MANHOLE
- SANITARY SEWER MANHOLE
- FIRE HYDRANT
- WATER VALVE
- WATER METER
- REMOTE WATER METER
- ROOF DRAIN
- SEDIMENT CONTROL DEVICE
- ROOF SCUPPER
- LIMIT OF CONSTRUCTION
- DRAINAGE SWALE
- SLOPING AT 3% UNLESS SPECIFIED
- SURFACE ELEVATION
- SWALE ELEVATION
- TOP OF WALL ELEVATION
- BOTTOM OF WALL ELEVATION
- OVERLAND FLOW ROUTE
- SILT FENCE BARRIER
- STRAW BALE CHECK DAM
- MUD MAT
- PROPOSED RETAINING WALL
- 100-YEAR PONDING LEVEL
- 2-YEAR PONDING LEVEL

No.	Revisions	Date
10	ISSUED FOR SITE PLAN CONTROL RESUBMISSION	JAN 19, 2024
9	REVISED PER CITY COMMENTS	DEC 19, 2023
8	REVISED PER UPDATED SITE PLAN	NOV 17, 2023
7	REVISED PER CITY COMMENTS	AUG 24, 2023
6	ISSUED FOR SITE PLAN CONTROL	JULY 7, 2023
5	REVISED PER CITY COMMENTS	JAN. 13, 2023
4	REVISED PER CITY COMMENTS	AUG. 24, 2022
3	ISSUED FOR SITE PLAN CONTROL	NOV. 08, 2021
2	ISSUED FOR REVIEW	SEP 10, 2021
1	ISSUED FOR REVIEW	MAY 28, 2021

Check and verify all dimensions before proceeding with the work. Do not scale drawings.

SCALE 1:200

0 10 20 Metres

McINTOSH PERRY

115 Walgreen Road, RR3, Carp, ON K0A 1L0
Tel: 613-836-2184 Fax: 613-836-3742
www.mcintoshperry.com

Client: **DOMENIC SANTAGUIDA**

Project: **APARTMENT BUILDING**
1940 CARLING AVENUE

Drawing Title: **REMOVALS, SITE SERVICING, LOT GRADING, DRAINAGE, SEDIMENT AND EROSION CONTROL PLAN**

Scale: 1:200 Project Number: **CP-20-0079-01**

Drawn By: **RP** Drawing Number: **C101**

Checked By: **CH**

Designed By: **FV**

D07-12-22-0001