

PROPOSED 100mmØ WATER SERVICE TABLE

STATION	SURFACE ELEVATION	T/WM ELEVATION	COMMENTS
0+00	59.78±	57.33±	ROLL CONNECTION TO 200mmØ WM EXTENSION
0+00.9	59.79	57.53	22.5" VERTICAL BEND
0+02.6	59.80	57.53	CROSS ABOVE 450mmØ COMB (0.3m CLEARANCE)
0+04.5	59.81	57.51	CROSS BELOW 500mmØ GAS (±1.3m CLEARANCE)
0+05.2	59.80	57.40	REMOVE SECTION OF ABANDONED COMB SEWER
0+10	59.88	57.40	---
0+11.3	59.85	57.40	22.5" VERTICAL BEND
0+12.2	59.60	56.85	22.5" VERTICAL BEND
0+12.5	59.50	56.83	100mmØ W&V
0+12.8	59.45	56.80	PROPERTY LINE
0+12.9	59.13	56.78	CROSS BELOW RET. WALL (±0.8m CLEARANCE)
0+13.8	59.15	56.75	INSULATE IN PROXIMITY TO OPEN STRUCTURES
0+14.8	59.17	56.75	CAP 1.0m FROM FOUNDATION WALL

* CONNECT TO 200mmØ WATERMAIN EXTENSION. EXACT ELEVATIONS TO BE FIELD DETERMINED.
 ** PROVIDE THERMAL INSULATION AS PER CITY OF OTTAWA DETAIL W22 IN SHALLOW TRENCHES AND/OR CITY OF OTTAWA DETAIL W23 ADJACENT TO OPEN STRUCTURES.

ROOF DRAIN TABLE: AREA R-1 (ROOF DRAINS 1.1, 1.2 + 2.1, 2.2)

AREA ID	ROOF DRAIN No. (WATTS MODEL)	WEIR SETTING	1.5 YEAR RELEASE RATE	APPROX. 5 YR PONDING DEPTH	1:100 YEAR RELEASE RATE	APPROX. 100 YR PONDING DEPTH
R-1	RD 1.1 (RD-100-A-ADJ)	CLOSED	0.32 L/s	11 cm	0.32 L/s	14 cm
R-1	RD 1.2 (RD-100-A-ADJ)	CLOSED	0.32 L/s	11 cm	0.32 L/s	15 cm
R-1	RD 2.1 (RD-100-A-ADJ)	1/4 EXPOSED	0.79 L/s	11 cm	0.87 L/s	14 cm
R-1	RD 2.2 (RD-100-A-ADJ)	CLOSED	0.32 L/s	11 cm	0.32 L/s	15 cm
TOTALS	-	-	1.75 L/s	-	1.83 L/s	-

* REFER TO THE 'DEVELOPMENT SERVICING STUDY AND STORMWATER MANAGEMENT REPORT' (R-2022-001) PREPARED BY NOVATECH FOR DRAINAGE AREA IDENTIFIERS AND STORMWATER MANAGEMENT DETAILS.
 ** ALL CONTROLLED FLOW ROOF DRAINS FOR THE UPPER ROOF OF THE BUILDING ARE TO BE WATTS CONTROL ADJUSTABLE ROOF DRAINS WITH WEIR SETTINGS AS INDICATED IN THE TABLE ABOVE.


INLET CONTROL DEVICE DATA TABLE - AREA A-2

DESIGN EVENT	ICD TYPE (PLUG TYPE)	OUTLET STRUCTURE	DIAMETER OF OUTLET PIPE (mm)	PEAK DESIGN FLOW (L/s)	DESIGN HEAD (m)	WATER ELEVATION (m)	VOLUME (m³)	AVAILABLE STORAGE
1.2 YR	IPEX TEMPEST	1200mmØ STM MH 01	200mmØ PVC	1.5	0.27	57.33	2.8	10.4 m³
1.5 YR	VORTEX LMF CUSTOM	1200mmØ STM MH 01	200mmØ PVC	1.8	0.38	57.44	4.0	
1:100 YR	-	-	-	3.3	1.22	58.28	7.9	

PROPOSED SITE FLOWS & STORMWATER MANAGEMENT TABLE

DESIGN EVENT	PRE-DEVELOPMENT CONDITIONS		POST-DEVELOPMENT CONDITIONS					
	SITE FLOWS (L/s)	ALLOWABLE RATE (L/s)	A-1 FLOW (L/s)	A-2 FLOW (L/s)	R-1 ROOF DRAINS (L/s)	R-1 DECK DRAINS (L/s)	TOTAL STM FLOWS (L/s)	REDUCTION IN FLOW (L/s or %)
1.2 YR	10.3	7.4	0.2	1.5	1.7	0.4*	3.8	6.5 or 63%
1.5 YR	14.0	-	0.2	1.8	1.7	0.5*	4.2	9.8 or 70%
1:100 YR	27.2	-	0.5	3.3	1.8	1.0*	6.6	20.6 or 76%


* UNCONTROLLED FLOW FROM SUNKEN REAR PATIO DRAINS (REFER TO MECHANICAL PLANS).
 ** DOES NOT INCLUDE POST-DEVELOPMENT SANITARY AND WEEPING TILE FLOWS.
 REDUCED FLOWS ARE COMPARED TO PRE-DEVELOPMENT UNCONTROLLED CONDITIONS.

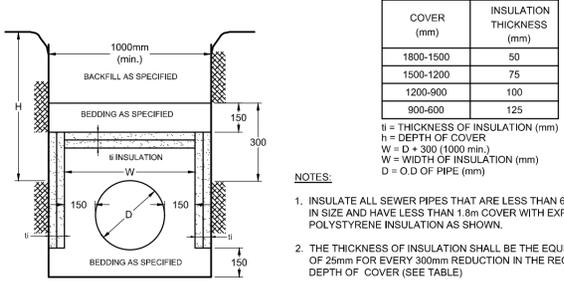

NOT TO SCALE

BENCHMARK INFO:

ALL ELEVATIONS ARE REFERRED TO THE CGVD28 GEODETIC DATUM, DERIVED FROM THE CITY OF OTTAWA VERTICAL CONTROL MONUMENT No. 2016-0357 HAVING AN ELEVATION OF 60.088 METRES. BEARINGS ARE MTR GRID AND ARE REFERRED TO THE SOUTHERLY LIMIT OF LARCH STREET, HAVING A BEARING OF N 66° 23' 20" E AS SHOWN ON A SURVEYOR'S REAL PROPERTY REPORT BY ANNIS, O'SULLIVAN, VOLLEBECK DATED NOVEMBER 2, 2017 THE EXISTING GRADES SHOWN ON THE PLANS ARE TAKEN DIRECTLY FROM SURVEYORS REAL PROPERTY REPORT PLAN (Ref. # 20-10-126-00), PREPARED BY J D BARNES LIMITED SIGNED AND DATED OCTOBER 22, 2020.

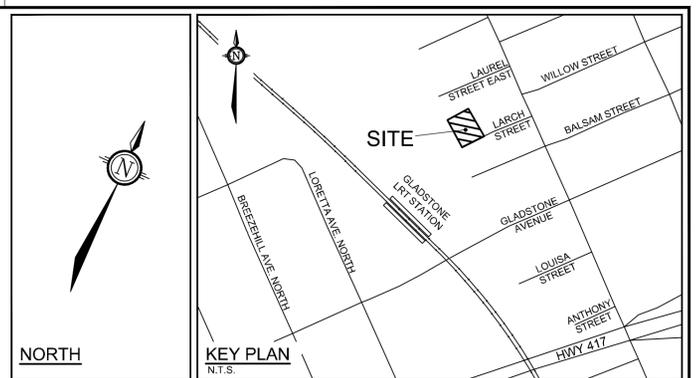

LEGEND:

RD	PROPOSED CONTROLLED FLOW ROOF DRAIN	---	PROPERTY LINE	---	WATERMAIN CAP
DD	PROPOSED DECK DRAIN	---	PROPOSED WATER METER AND REMOTE METER	---	PROPOSED FENCE AND GATE
VE	PROPOSED VALVE AND VALVE BOX	---	PROPOSED BUILDING ENTRANCE	---	EXISTING OVERHEAD WIRES
T/FND	TOP OF FOUNDATION WALL ELEVATION	---	PROPOSED WATER SERVICE	---	EXISTING CONCRETE CURB
BFE	BASEMENT FLOOR ELEVATION	---	PROPOSED STORM SERVICE	---	EXISTING SANITARY MANHOLE & SEWER
USF	UNDERSIDE OF FOOTING ELEVATION	---	PROPOSED SANITARY SERVICE	---	EXISTING CATCHBASIN MANHOLE
SBSE	SUB-BASEMENT SLAB ELEVATION	---	PROPOSED VALVE AND VALVE BOX	---	EXISTING STORM MANHOLE & SEWER
USLF	UNDERSIDE OF LOW FOOTING ELEVATION	---	PROPOSED WATER SERVICE	---	EXISTING CATCHBASIN CW
X	REMOVAL AND/OR ABANDONMENT	---	PROPOSED STORM SERVICE	---	EXISTING CATCHBASIN CW CATCHBASIN LEAD
C.S.	CLAY SEAL SEEPAGE BARRIER	---	PROPOSED SANITARY SERVICE	---	EXISTING HYDRANT & VALVE
---	THERMAL INSULATION FOR SHALLOW SEWERS	---	PROPOSED VALVE AND VALVE BOX	---	EXISTING TREES / VEGETATION

GENERAL NOTES:

- COORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
- DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT AND ASSUME RESPONSIBILITY FOR ALL EXISTING UTILITIES WHETHER OR NOT SHOWN ON THIS DRAWING.
- OBTAIN ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA BEFORE COMMENCING CONSTRUCTION.
- BEFORE COMMENCING CONSTRUCTION OBTAIN AND PROVIDE PROOF OF COMPREHENSIVE, ALL RISK AND OPERATIONAL LIABILITY INSURANCE FOR \$3,000,000.00. INSURANCE POLICY TO NAME OWNERS, ENGINEERS AND ARCHITECTS AS CO-INSURED.
- RESTORE ALL DISTURBED AREAS ON-SITE AND OFF-SITE, INCLUDING TRENCHES AND SURFACES ON PUBLIC ROAD ALLOWANCES TO EXISTING CONDITIONS OR BETTER TO THE SATISFACTION OF MUNICIPAL AUTHORITIES.
- REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL, ORGANIC MATERIAL AND DEBRIS UNLESS OTHERWISE INSTRUCTED BY ENGINEER. EXCAVATE AND REMOVE FROM SITE ANY CONTAMINATED MATERIAL. ALL CONTAMINATED MATERIAL SHALL BE DISPOSED OF AT A LICENSED LANDFILL FACILITY.
- ALL ELEVATIONS ARE GEODETIC.
- REFER TO GEOTECHNICAL INVESTIGATION REPORT (NUMBER PG071-1, REV.1), DATED FEBRUARY 11, 2022, PREPARED BY PATERSON GROUP INC. FOR SUBSURFACE CONDITIONS, CONSTRUCTION RECOMMENDATIONS AND GEOTECHNICAL INSPECTION REQUIREMENTS. THE GEOTECHNICAL CONSULTANT IS TO REVIEW ON-SITE CONDITIONS AFTER EXCAVATION PRIOR TO PLACEMENT OF THE GRANULAR MATERIAL.
- REFER TO MECHANICAL PLAN FOR ROOF DRAIN INFORMATION.
- REFER TO ARCHITECT'S AND LANDSCAPE ARCHITECT'S DRAWINGS FOR BUILDING AND HARD SURFACED AREAS AND DIMENSIONS.
- REFER TO THE 'DEVELOPMENT SERVICING STUDY AND STORMWATER MANAGEMENT REPORT' (R-2022-001) PREPARED BY NOVATECH.
- SAW CUT AND KEYGRIND ASPHALT AT ALL ROAD CUTS AND ASPHALT TIE-IN POINTS AS PER CITY OF OTTAWA STANDARDS (R10).

SEWER NOTES:

- SUPPLY AND CONSTRUCT ALL SEWERS AND APPURTENANCES IN ACCORDANCE WITH THE MOST CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS USING THE CURRENT GUIDELINES, BYLAWS AND STANDARDS INCLUDING MATERIALS OF CONSTRUCTION, DISINFECTION AND ALL RELEVANT REFERENCES TO OPS, OPS & AWWA GUIDELINES - ALL CURRENT VERSIONS AND 'AS AMENDED'.
- SPECIFICATIONS:

ITEM	SPEC. No.	REFERENCE
STORM / CATCHBASIN MANHOLE (1200mmØ)	701.010	OPSD
STORM / CBM MANHOLE FRAME AND COVER	401.010 - TYPE "B"	OPSD
LANDSCAPE DRAIN (ELBOW, COVER & PIPE)	S29 / S31	CITY OF OTTAWA
SEWER TRENCH	S6	CITY OF OTTAWA
STORM SERVICE / SEWER SANITARY SERVICE	PVC DR 35 (HDPE for LD SYSTEM)	PVC DR 35
- THE SANITARY SERVICE LATERAL SHALL BE EQUIPPED WITH A BACKFLOW PREVENTER WITHIN THE BUILDING FOOTPRINT AS PER CITY OF OTTAWA STANDARD DETAILS S14.1 OR S14.2. REFER TO MECHANICAL PLANS FOR DETAILS.
- THE STORM SERVICE LATERAL SHALL BE EQUIPPED WITH A BACKFLOW PREVENTER WITHIN THE BUILDING FOOTPRINT AS PER CITY OF OTTAWA STANDARD DETAILS S14. REFER TO MECHANICAL PLANS FOR DETAILS.
- PIPE BEDDING, COVER AND BACKFILL ARE TO BE COMPACTED TO AT LEAST 95% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY. THE USE OF CLEAR CRUSHED STONE AS A BEDDING LAYER SHALL NOT BE PERMITTED.
- INSULATE ALL SEWER PIPES THAT HAVE LESS THAN 1.8m COVER WITH UP TO 125mm THICK H-40 RIGID INSULATION.
- CONTRACTOR TO PROVIDE THE CONSULTANT WITH A GENERAL PLAN OF SERVICES INDICATING ALL APPLICABLE SERVICING AS-BUILT INFORMATION SHOWN ON THIS PLAN. AS-BUILT INFORMATION MUST INCLUDE: PIPE MATERIAL, SIZES, LENGTHS, SLOPES, INVERT AND TIG ELEVATIONS, STRUCTURE LOCATIONS AND ANY ALIGNMENT CHANGES, ETC.
- THE OWNER SHALL REQUIRE THAT THE SITE SERVICING CONTRACTOR PERFORM FIELD TESTS FOR QUALITY CONTROL OF ALL SANITARY SEWERS. LEAKAGE TESTING SHALL BE COMPLETED IN ACCORDANCE WITH OPS 410.07.16, 410.07.16.04 AND 407.07.24. DYE TESTING IS TO BE COMPLETED ON ALL SANITARY SERVICES TO CONFIRM PROPER CONNECTION TO THE SANITARY SEWER MAIN. THE FIELD TESTS SHALL BE PERFORMED IN THE PRESENCE OF A CERTIFIED PROFESSIONAL ENGINEER WHO SHALL SUBMIT A CERTIFIED COPY OF THE TEST RESULTS.

WATERMAIN NOTES:

- SUPPLY AND CONSTRUCT ALL WATERMAIN AND APPURTENANCES IN ACCORDANCE WITH THE CITY OF OTTAWA STANDARDS AND SPECIFICATIONS - ALL CURRENT VERSIONS AND 'AS AMENDED'.
- SPECIFICATIONS:

ITEM	SPEC. No.	REFERENCE
WATERMAIN TRENCHING	W17	CITY OF OTTAWA
HYDRANT INSTALLATION	W19	CITY OF OTTAWA
THERMAL INSULATION IN SHALLOW TRENCHES	W22	CITY OF OTTAWA
THERMAL INSULATION BY OPEN STRUCTURES	W23	CITY OF OTTAWA
WATERMAIN CROSSING BELOW SEWERS	W25	CITY OF OTTAWA
WATERMAIN MATERIAL	PVC DR 18 (100mm AND LARGER)	
- EXCAVATION, INSTALLATION, BACKFILL AND RESTORATION OF ALL WATERMANS BY THE CONTRACTOR. CONNECTIONS AND SHUT-OFFS AT THE MAIN AND CHLORINATION OF THE WATER SYSTEM SHALL BE PERFORMED BY CITY OFFICIALS. EXCAVATION, INSTALLATION OF SERVICE, BACKFILL AND RESTORATION BY THE CONTRACTOR.
- WATERMAIN SHALL BE MINIMUM 2.4m DEPTH BELOW GRADE UNLESS OTHERWISE INDICATED.
- PROVIDE MINIMUM 0.5m CLEARANCE BETWEEN OUTSIDE OF PIPES AT ALL CROSSINGS, UNLESS OTHERWISE INDICATED.
- WATER SERVICE IS TO BE CONSTRUCTED TO WITHIN 1.0m OF FOUNDATION WALL AND CAPPED, UNLESS OTHERWISE INDICATED.

NOTE: THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

OWNER INFORMATION
 15-19 LARCH ST. INC.
 359 KENT STREET, SUITE 503,
 OTTAWA, ONTARIO, K2P 0R6
 ROBERTO CAMPAGNA
 PHONE: (613) 851-7823
 roberto@rochomes.ca

No.	REVISION	DATE	BY
4	EXTENDED 200mm DIA. WATERMAIN	APRIL 6/23	MS
3	REVISOR PER ADDITIONAL CITY COMMENTS	MAR 27/23	MS
2	REVISED PER CITY COMMENTS	SEPT 2/22	MS
1	ISSUED FOR SITE PLAN APPROVAL	FEB 17/22	MS

SCALE	DESIGN
1:100	SM
	CHECKED MS
	DRAWN DWM / SM
	CHECKED MS
	APPROVED SM
	MS

FOR REVIEW ONLY



NOVATECH
 Engineers, Planners & Landscape Architects
 Suite 200, 240 Michael Cowpland Drive
 Ottawa, Ontario, Canada K2M 1P6
 Telephone (613) 254-9643
 Facsimile (613) 254-5867
 Website www.novatech-eng.com

LOCATION	CITY OF OTTAWA
15 LARCH STREET	
DRAWING NAME	GENERAL PLAN OF SERVICES
PROJECT No.	120251
REV	REV #4
DRAWING No.	120251-GP

D07-12-22-0027