


JOINT FILLING MATERIAL: 2.5-10mm AGGREGATE OR AS RECOMMENDED BY MANUFACTURER
 BEDDING COURSE: 2.5-10mm AGGREGATE OR AS RECOMMENDED BY MANUFACTURER
 BASE COURSE: 5-28mm AGGREGATE OR AS RECOMMENDED BY MANUFACTURER
 SUB-BASE COURSE: 40-80mm AGGREGATE OR AS RECOMMENDED BY MANUFACTURER
 COMPACT EACH LAYER AS RECOMMENDED BY MANUFACTURER

PERMEABLE PAVERS BY UNILOCK LIMITED OR APPROVED EQUAL
 PAVERS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS
 WITH TIGHT BUTT JOINTS OF APPROXIMATELY 3mm, ON A SAND BASE. SAW CUT PAVERS AS REQUIRED.
 USE AN APPROVED VIBRATORY COMPACTOR IN A CIRCULAR PATTERN.
 ALL DAMAGED OR CHIPPED PAVERS MUST BE REPLACED AT THE CONTRACTOR'S COST

EXCAVATE AND REMOVE ALL TOPSOIL AND UNSTABLE MATERIALS OFF SITE. SUBGRADE TO BE GRADED TO SIMILAR CONTOURS AS FINISH GRADE.

GEOTECHNICAL CONSULTANT SHALL INSPECT SUB-GRADE. SUB-GRADE SHALL BE EITHER IN SITU SOIL OR ADDITIONAL PERMEABLE SUBBASE MATERIAL PLACED OVER IN SITU SOIL. SCARIFY THE SUBGRADE TO A DEPTH OF 100 mm WHERE IT CONSISTS OF A FINE-GRAINED SOIL (I.E. GLACIAL TILL).


PERMEABLE PAVERS N.T.S

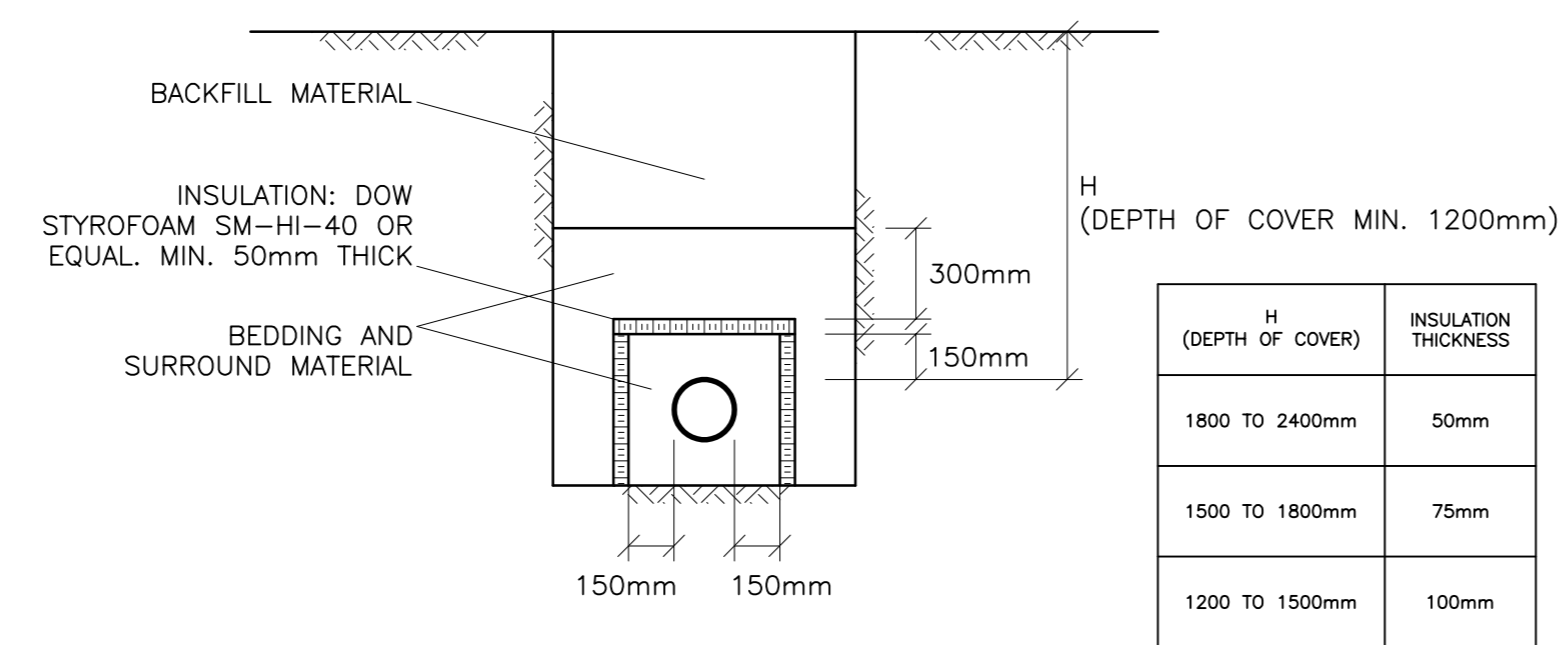

INSULATE WATERMAIN AS INDICATED AND WHERE DEPTH OF COVER IS LESS THAN 2400mm, PROVIDE A MINIMUM 1200mm COVER CENTER INSULATION OVER PIPE. JOINTS BETWEEN SHEETS OF INSULATION SHALL BE STAGGERED.

INSULATION OF WATERMAINS & WATER SERVICE CONNECTIONS IN SHALLOW TRENCHES AS PER CITY OF OTTAWA DRAWING No. W22 N.T.S

INSTALL A MINIMUM OF 4 SCUPPERS, EACH A MINIMUM 200mm WIDE. BOTTOM OF SCUPPERS SHALL BE 150mm ABOVE ROOF DRAINS (REFER TO ARCHITECTURAL FOR EXACT LOCATIONS AND DETAILS). ROOF SHALL BE DESIGNED TO CARRY THE LOAD OF WATER HAVING A 50mm DEPTH AT SCUPPER OR 200mm DEPTH AT ROOF DRAIN (REFER TO STRUCTURAL).

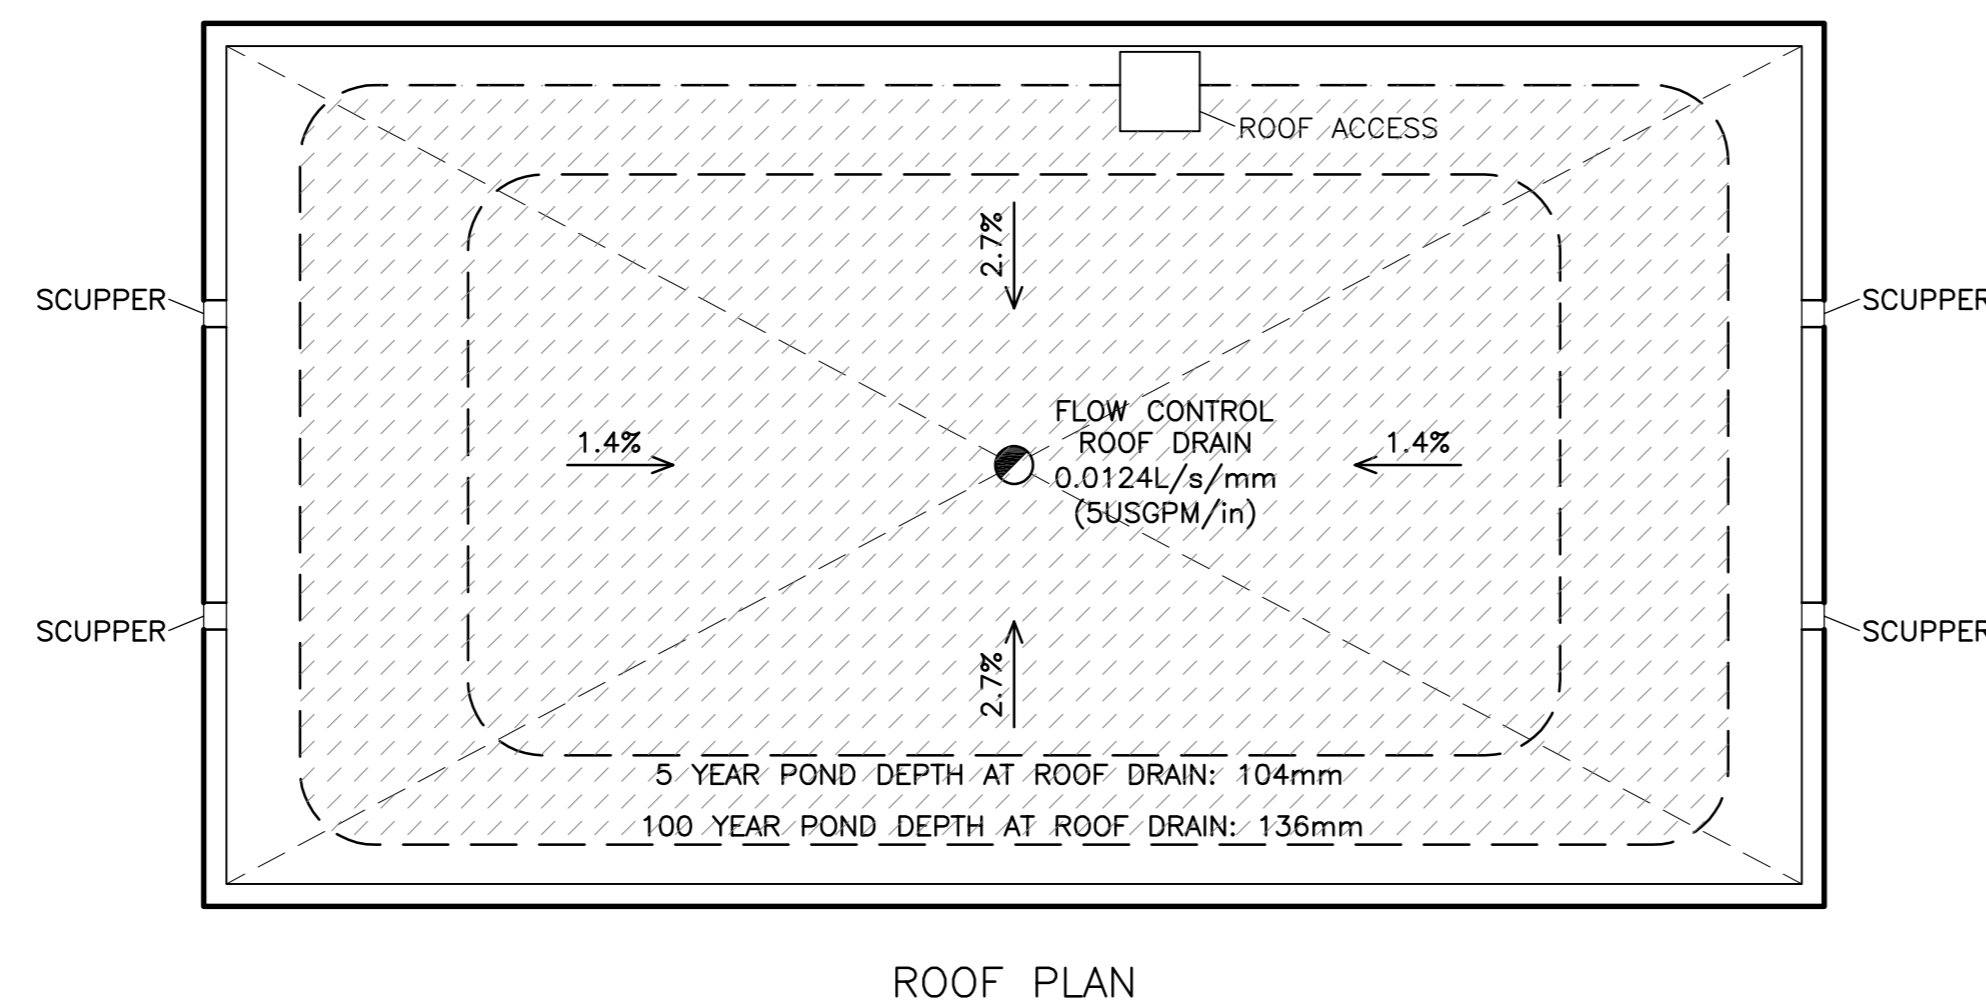

CATCH-BASIN & MANHOLE SCHEDULE

REF	TOP	SIZE	TYPE	INVERT AT INLET	INVERT AT OUTLET	NOTES
STORM SEWER						
CB-1	120.47	600mm x 600mm	PRE-CAST CONCRETE CATCH-BASIN	-	118.26	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS - FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19 INSTALL ICD IN OUTLET PIPE
MH-2	120.65	CDS PMSU2015-4 1200mm	OIL GRIT SEPARATOR (OGS) PRE-CAST CONCRETE MANHOLE	118.23(SE)	118.23(NW)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS EXCEPT WITH A DEEP SUMP AS REQUIRED BY CDS

WATER SERVICE PROFILE TABLE

MATERIAL:
150mm PVC PRESSURE CLASS 150 DR18

STATION	DESCRIPTION	GRADE ELEVATION	TOP OF PIPE	DEPTH OF COVER	NOTES
0+00.0	400mm x 150mm TEE CONNECTION IN 300mm MUNICIPAL WATERMAIN TO CITY OF OTTAWA STANDARDS	±121.30	±119.25	±2.05	INSULATION: 0+00.0 TO 0+02.2 50mm THICK TO CITY OF OTTAWA DRAWING No. W22
0+01.0	22.5' VERTICAL BEND DOWN TO CITY OF OTTAWA STANDARDS	±121.28	119.25	±2.03	
0+02.2	22.5' VERTICAL BEND ACROSS TO CITY OF OTTAWA STANDARDS	±121.26	118.76	±2.50	
0+02.3	-	±121.26	118.76	±2.50	150 WS U/S 118.61 450 SAN TOP ±116.18 (2430mm CLEARANCE)
0+04.1	-	±121.23	118.76	±2.47	150 WS U/S 118.61 825 ST TOP ±118.48 (±130mm CLEARANCE)
0+06.9	-	±121.18	118.76	±2.42	CROSSING 100 GAS
0+08.2	-	±121.16	118.76	±2.40	-
0+08.4	-	±121.16	118.76	±2.40	BOTTOM OF CURB
0+11.7	150mm VALVE & VALVE BOX TO CITY OF OTTAWA STANDARDS	121.44	118.85	±2.59	ON PROPERTY LINE
0+16.0	-	121.50	119.08	±2.42	ENTRY INTO BUILDING

KEY PLAN



No.	DATE	REVISION
3	JUL 15-22	RE-ISSUED FOR APPROVAL
2	MAY 7-21	ISSUED FOR APPROVAL
1	MAY 4-21	ISSUED FOR COORDINATION

D. B. GRAY ENGINEERING INC.
 Stormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermain
 700 Long Point Circle Ottawa, Ontario
 613-425-8044
 d.gray@dbgrayengineering.com

Project
**PROPOSED
 2 STOREY DISTILLERY
 1498 STITTSVILLE MAIN STREET
 OTTAWA, ONTARIO**

DETAILS & SCHEDULES

Engineer's Seal:

Drawn: D.B.G.
 H. Scale
 V. Scale
 Date: APR 21-21
 Job No.: 21029

Drawing No.: **C-6 of 7**

NOT VALID UNLESS SIGNED & DATED