

154 Colonnade Road  
Ottawa, Ontario  
Canada, K2E 7J5  
Tel: (613) 226-7381

June 7, 2022  
File: PH4407-LET.01.REV.01.

**Dymech Engineering Inc.**  
1359 Coker Street,  
Ottawa (Greely), ON  
K4P 1A1

Geotechnical Engineering  
Environmental Engineering  
Hydrogeology  
Geological Engineering  
Materials Testing  
Building Science

[www.patersongroup.ca](http://www.patersongroup.ca)

Attention: **Mat Main**

Subject: **Hydrogeological Assessment and Terrain Analysis**  
**1353 Coker Street**  
**Ottawa (Greely), Ontario**

## HYDROGEOLOGICAL ASSESSMENT

### INTRODUCTION

Further to your request, Paterson Group (Paterson) conducted a Hydrogeological Assessment and Terrain Analysis in support of a site plan application for the proposed warehouse addition to be located at 1353 Coker Street in Ottawa (Greely), Ontario. Please refer to Figure 1 - Key Plan attached for the site location.

The purpose of this work has been to determine the suitability of the water supply aquifer underlying the subject site to service the proposed development in support of a site plan application.

The subject site is an approximately 0.27 hectare (ha) parcel. The ground surface across the site is relatively flat, with a general downslope direction to the south. The general overburden groundwater flow direction is assumed to be south towards the Osgoode Gardens Cedar Acres municipal drain.

The subject site is bordered to the north, east and west by developed commercial properties and to the south by Coker Street followed by additional developed commercial properties. The subject site and all of the neighboring land parcels are zoned RG3 (Rural General Industrial Zone subzone 3).

A Hydrogeological and Terrain Analysis Pre-consultation was completed with a City of Ottawa Hydrogeologist on November 11, 2021, where it was determined that as the

application is for Site Plan application, that nitrate reduction technologies would be allowed in support of the Sewage System Impact Assessment (Terrain Analysis).

## **DESCRIPTION OF SUBJECT SITE**

The subject site is an approximately 0.27 ha lot and is currently occupied by a one storey commercial building. The Site Plan application is for a proposed warehouse addition. Please refer to D.B. Grey Engineering Inc. Drawing A-002 - New Site Plan + Notes attached for proposed site layout. The subject site is currently serviced by an onsite sewage system and a private drilled well, and a new sewage system is proposed to be located in the same location as the old sewage system.

The existing well, hereafter referred to as Test Well 1 (TW1) is the well which will be servicing both the proposed building addition and the existing development.

Paterson has completed a replacement sewage system design for the proposed development. A septic flow value of 1,900 L/day was used for the existing building and a septic flow value of 1,700 L/day was calculated for the proposed building addition. This results in a total daily water demand calculation of 3,600 L/day.

The suitability of the aquifer to supply the subject site was assessed using the methodology provided in City of Ottawa Hydrogeological and Terrain Analysis Guidelines (HTAG).

## **FIELDWORK PROGRAM**

As a means to demonstrate the adequacy of the aquifer underlying the subject lands, with respect to water quality and quantity, the onsite water supply well tested. A WWR was not available for the well, however Paterson field staff measured the well while the existing submersible pump was removed for the constant rate pumping test. The well, referred to as TW1, was measured to have a 150 mm diameter steel casing extending to a depth of 16.1 m below the ground surface (bgs). The total depth of the well was measured to be 22.1 m bgs. Based upon available geological mapping, the drift thickness at TW1 varies from 5 to 10 m bgs. Refer to Paterson Drawing PH4407-3 for the location of TW1.

As a means to evaluate the water supply aquifer intercepted by the well, the well was subjected to a 8 hour constant rate pumping test. The pumping test was conducted on February 3, 2022 under the full-time supervision of Paterson personnel.

A submersible pump was provided by Air Rock for the 8 hour pumping test. A licensed water well technician was retained to complete the necessary plumbing related activities. The existing pump was removed from the well by a licensed well technician, and a rented submersible pump was used for the pumping test. A discharge hose assembly with a gate valve was connected to the rented pump. The discharge line was placed at a sufficient

distance to ensure that the discharge water was being directed away from the well. Upon completion of the test, the pump was removed, the existing pump was re-installed, and the well was disinfected by Air Rock.

The pumping test was carried out at a pumping rate of approximately 19 L/min for a duration of 8 hours, after which the pumping rate was reduced to 9 L/min for a half hour in an attempt to lower turbidity levels. During the pumping test, the pumping rate was periodically measured using the timed volume correlation method. The pump rate was maintained within 5% of the selected pump rate. The static water level was recorded manually and an electronic datalogger (VanEssen TD-Diver) was installed in the test well prior to the start of the pumping test. A 19 L/min pumping rate was chosen. This rate provides approximately three times the maximum total daily design volume for the septic system during the 8 hour pumping test. Combined with the unknown nature of the available well water quantity prior to the pumping test, the rate was determined to be representative of a flow rate which would be in excess of what the development would require.

The data logger recorded water levels at 30 second intervals. In addition, manual water level readings were taken at periodic intervals during the test.

Recovery data was collected from the well following the completion of the pumping. The well was noted to have achieved 100 % recovery in less than one minute after the completion of the pumping test.

Groundwater samples were collected at 4 hours and 8.5 hours after the start of pumping. Prior to collection of the groundwater samples, the free chlorine residual was verified to be non-detectable. The water samples were submitted for comprehensive testing of bacteriological, chemical and physical water quality parameters consistent with the standard 'Subdivision Supply' suite of parameters, and Volatile Organic Compounds (VOC's).

All samples were collected unfiltered and unchlorinated and were placed directly into clean bottles supplied by the analytical laboratory. Samples were placed immediately into a cooler with ice and were transported directly to the Eurofins Environmental Testing Canada Inc. (Eurofins) laboratory in Ottawa. All samples were received by the laboratory within 24 hours of collection.

A series of field tests of the pumped water were carried out at the well head during the 8.5 hour pumping test. The parameters tested at the well head included: pH, total dissolved solids, conductivity, turbidity, apparent colour and temperature.

The generator which powered the rented submersible pump for the pumping test temporarily failed at approximately the 6 hour mark of the pumping test, however Paterson was able to quickly restart the generator to finish the 8 hour test. Due to the spike in the

data from the generator failure, the data collected from the first 6 hours of the pumping test was used in support of this study, however the data from all 8.5 hours is included in this report.

The turbidity level recorded during the field program was higher than the maximum of 5 NTU (field measurement of approximately 6.5 NTU) during the 8 hour constant rate pumping test. After 8 hours of constant rate pumping at 19 L/min, the pumping rate was lowered to 9 L/min for a half hour. The recorded field turbidity after lowering the rate was on the order of 3.4 NTU.

## AQUIFER ANALYSIS

### Water Quantity

Pumping test data was analyzed using AQTESOLV Pro Version 4 aquifer analysis software package by HydroSOLVE Inc. Drawdown data was measured using an electronic water level tape and an electronic datalogger unit.

| TABLE 1:SUMMARY OF WATER SUPPLY AQUIFER CHARACTERISTICS OF TW1 |                    |
|--|--------------------|
| AQUIFER PARAMETER  | RESULT OF ANALYSIS |
| Transmissivity (m <sup>2</sup> /day)                           | 367                |
| Pumping Rate (L/min)   | 19                 |
| Pre-test Static Water Level (m)                                | 3.2                |
| Maximum Drawdown (m)   | 1.9                |
| Available Drawdown (m)   | 18.95              |
| % Drawdown During Pumping Test                                 | 5                  |
| Specific Capacity (L/min/m drawdown)                           | 10                 |

The drawdown data was analyzed using the Theis and Cooper Jacob methods of analysis. Aquifer transmissivity is estimated to be approximately 367 m<sup>2</sup>/day.

The pumping test results show that TW1 has a high yield to support the water demands for the proposed development. Overall, maximum drawdown at a constant pumping rate for a period of 8 hrs was approximately 1.9 m (5 % of the available drawdown). 95% recovery was achieved in less than one minute after the end of pumping. The water level was observed to be rising during the constant rate pumping test, with the measured drawdown at the end of the pumping test recorded at 1.0 m.

The total volume of water pumped during the 8 hour pumping event was approximately 9,120 L. This is approximately three times the maximum total daily design volume of water



required to support the development as part of the site plan application (approximately 3,600 L/day).

Observations from dataloggers placed in TW1 prior to the pumping test indicated that TW1 is hydraulically connected to other water supply wells. The aquifer drawdown recorded outside of the pumping test period is generally on the order of 0.5 m. The recovery from the observed drawdown was very quick, typically on the order of one minute. Groundwater quantity issues are not expected due to the minimal volume of daily water takings required by the proposed development.

The suitability of the aquifer to supply the proposed development was assessed using the methodology provided in City of Ottawa Hydrogeological and Terrain Analysis Guidelines (HTAG).

Based on the information summarized in Table 1, it is readily apparent that the water supply well has intercepted an adequately strong water supply aquifer which has sufficient quantity to service the proposed development under typical usage.


Given the analyses presented and summarized above, it is our opinion that there is an adequate supply of water to service the proposed development in addition to the neighboring lots whose wells may intercept a similar aquifer. Available water well records (WWR's) of the neighbouring properties on the MECP Well Record mapping website indicated that the wells have generally been screened in either a limestone or underlying sandstone bedrock unit. However, two (2) wells are recorded to be screened in gravel with casing extending to a minimum of 11.6 m. Surrounding WWR's are attached to this report.

## **Water Quality**

TW1 is currently supplying the existing building on site, as such the client is familiar with the water quality which TW1 provides.

### ***Field Data***

Turbidity, electrical conductivity, total dissolved solids (TDS), pH, apparent colour and temperature were measured at the wellhead during the pumping test. The measurements and time intervals for each of these parameters are summarized on the graphical representation below. In addition, a Hach Pocket Colorimeter II chlorine reader was used to measure the free chlorine residual level. No chlorine residual was detected in the discharge water prior to the collection of the water samples.

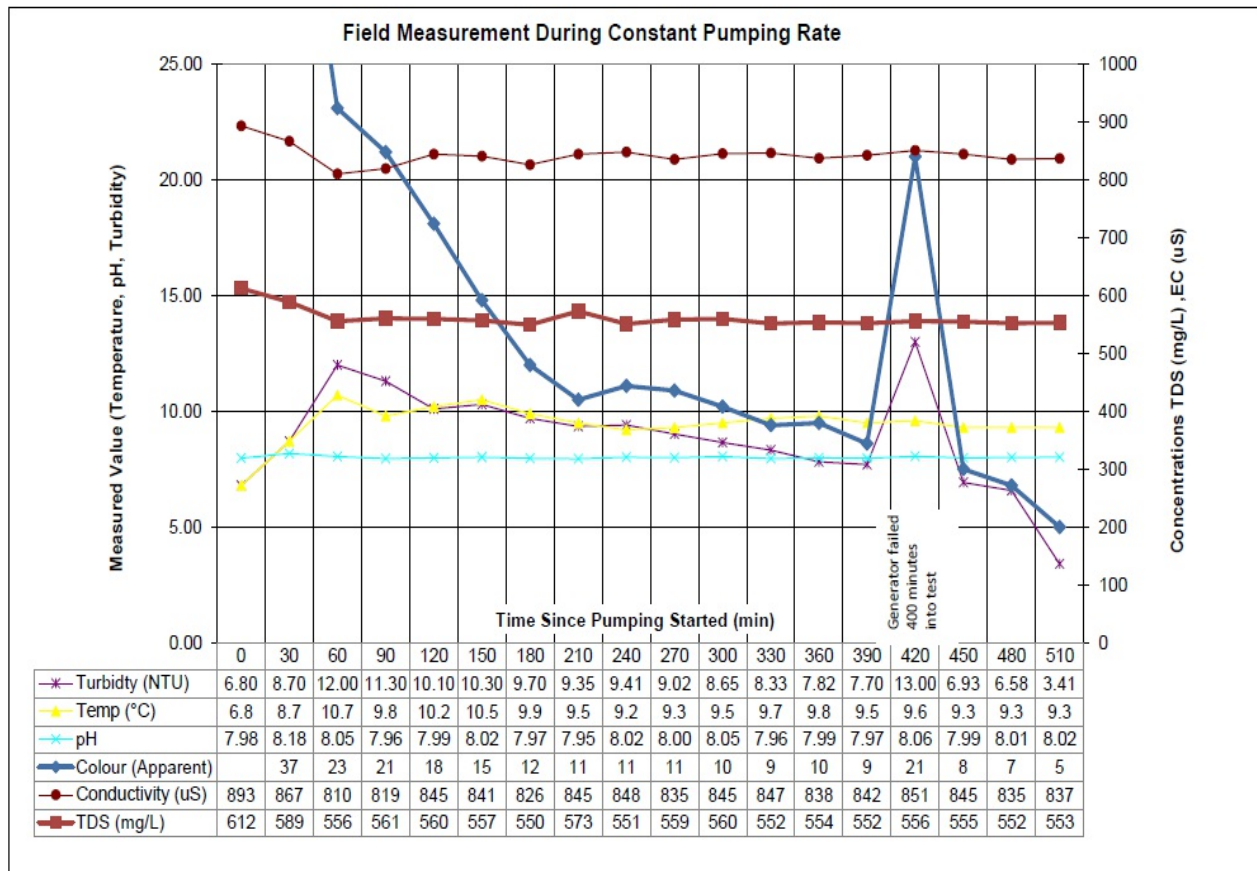

**Laboratory Data**

The laboratory water quality obtained from the pumping test of TW1 is provided in Table 2a 2b, and 2c below and the laboratory analyses reports can be found attached.

| TABLE 2a: GROUNDWATER MICROBIOLOGY & GENERAL GEOCHEMISTRY |          |           |        |                          |                            |
|---|----------|-----------|--------|--------------------------|----------------------------|
| PARAMETER   | UNITS    | ODWS      |        | TW1                      |                            |
|   |          | LIMIT     | TYPE   | GW1 (4 hr)<br>2022-02-03 | GW2 (8.5 hr)<br>2022-02-03 |
| <b>MICROBIOLOGICAL</b>                                    |          |           |        |                          |                            |
| Escherichia Coli (E.Coli)                                 | ct/100mL | 0         | MAC    | 0                        | 0                          |
| Total Coliforms   | ct/100mL | 0         | MAC    | 0                        | 0                          |
| <b>GENERAL CHEMICAL - HEALTH RELATED</b>                  |          |           |        |                          |                            |
| Fluoride (F)  | mg/L     | 1.5       | MAC    | 0.16                     | 0.15                       |
| Ammonia (N-NH <sub>3</sub> )                              | mg/L     | -         | -      | <0.010                   | <0.010                     |
| Nitrite (N-NO <sub>2</sub> )                              | mg/L     | 1         | MAC    | <0.10                    | <0.10                      |
| Nitrate (N-NO <sub>3</sub> )                              | mg/L     | 10        | MAC    | <0.10                    | <0.10                      |
| Total Kjeldahl Nitrogen                                   | mg/L     | -         | -      | 0.210                    | 0.402                      |
| Turbidity (Field)   | NTU      | 1.0 (5.0) | MAC/AO | 9.41                     | 3.41                       |
| Turbidity (Laboratory)                                    | NTU      | 1.0 (5.0) | MAC/AO | 4.9                      | 2.2                        |
| <b>GENERAL CHEMICAL - AESTHETIC RELATED</b>               |          |           |        |                          |                            |
| Alkalinity (as CaCO <sub>3</sub> )                        | mg/L     | 30-500    | OG     | 246                      | 244                        |
| Chloride (Cl)   | mg/L     | 250       | AO     | 97                       | 96                         |
| Colour  | TCU      | 5         | AO     | 67                       | 28                         |
| Colour (Field - Apparent)                                 | TCU      | 5         | AO     | 11                       | 5                          |
| Conductivity  | uS/cm    | -         | -      | 848                      | 840                        |
| Dissolved Organic Carbon                                  | mg/L     | 5         | AO     | 2.4                      | 2.5                        |
| Hardness (as CaCO <sub>3</sub> )                          | mg/L     | 100       | OG     | 384                      | 380                        |
| Ion Balance   | unitless | -         | -      | 0.98                     | 0.98                       |
| pH  | unitless | 6.5-8.5   | AO     | 8.02                     | 8.07                       |
| Phenols   | mg/L     | -         | -      | <0.001                   | <0.001                     |
| Sulphate (SO <sub>4</sub> )                               | mg/L     | 500       | AO     | 70                       | 70                         |
| Sulphide (S <sub>2</sub> )                                | mg/L     | 0.05      | AO     |                          | <0.02                      |
| Tannin & Lignin   | mg/L     | -         | -      | 0.9                      | 0.9                        |
| Total Dissolved Solids                                    | mg/L     | 500       | AO     | 551                      | 546                        |

- ODWS identifies the following types of parameters:  
MAC = Maximum Allowable Concentration  
AO = Aesthetic Objective  
OG = Operational Guideline
- Shaded Concentration Indicates an Exceedance of the ODWS Objective

| TABLE 2b: GROUNDWATER GEOCHEMISTRY - METALS |       |       |      |            |              |
|---|-------|-------|------|------------|--------------|
| PARAMETER                                   | UNITS | ODWS  |      | TW1        |              |
|   |       | LIMIT | TYPE | GW1 (4 hr) | GW2 (8.5 hr) |
|   |       |       |      | 2022-02-03 | 2022-02-03   |
| <b>Volatiles</b>                            |       |       |      |            |              |
| Aluminum (Al)                               | mg/L  | 0.1   | OG   | <0.01      | <0.01        |
| Antimony (Sb)                               | mg/L  | 0.006 | IMAC | <0.0005    | <0.0005      |
| Arsenic (As)                                | mg/L  | 0.01  | IMAC | <0.001     | <0.001       |
| Barium (Ba)                                 | mg/L  | 1.0   | MAC  | 0.40       | 0.40         |
| Beryllium (Be)                              | mg/L  | -     | -    | <0.0005    | <0.0005      |
| Boron (B)                                   | mg/L  | 5.0   | IMAC | 0.02       | 0.02         |
| Cadmium (Cd)                                | mg/L  | 0.005 | MAC  | <0.0001    | <0.0001      |
| Calcium (Ca)                                | mg/L  | -     | -    | 101        | 101          |
| Chromium (Cr)                               | mg/L  | 0.05  | MAC  | <0.001     | <0.001       |
| Cobalt (Co)                                 | mg/L  | -     | -    | <0.0002    | <0.0002      |
| Copper (Cu)                                 | mg/L  | 1.0   | AO   | 0.008      | 0.003        |
| Iron (Fe)                                   | mg/L  | 0.3   | AO   | 0.58       | 0.46         |
| Lead (Pb)                                   | mg/L  | 0.01  | MAC  | <0.001     | <0.001       |
| Magnesium (Mg)                              | mg/L  | -     | -    | 32         | 31           |
| Manganese (Mn)                              | mg/L  | 0.05  | AO   | 0.03       | 0.03         |
| Mercury (Hg)                                | mg/L  | 0.001 | MAC  | <0.0001    | <0.0001      |
| Molybdenum (Mo)                             | mg/L  | -     | -    | <0.005     | <0.005       |
| Nickle (Ni)                                 | mg/L  | -     | -    | <0.005     | <0.005       |
| Potassium (K)                               | mg/L  | -     | -    | 2          | 2            |
| Selenium (Se)                               | mg/L  | 0.05  | MAC  | <0.001     | <0.001       |
| Silver (Ag)                                 | mg/L  | -     | -    | <0.0001    | <0.0001      |
| Sodium (Na)                                 | mg/L  | 200   | AO   | 28         | 28           |
| Strontium (Sr)                              | mg/L  | -     | -    | 0.306      | 0.293        |
| Thallium (Tl)                               | mg/L  | -     | -    | <0.0001    | <0.0001      |
| Uranium (U)                                 | mg/L  | 0.02  | MAC  | <0.001     | <0.001       |
| Vanadium (V)                                | mg/L  | -     | -    | <0.001     | <0.001       |
| Zinc (Zn)                                   | mg/L  | 5.0   | AO   | <0.01      | <0.01        |

1. ODWS identifies the following types of parameters:
  - MAC = Maximum Acceptable Concentration
  - IMAC = Interim Maximum Acceptable Concentration
  - AO = Aesthetic Objective
  - OG = Operational Guideline
2. Shaded Concentration Indicates an Exceedance of the ODWS Objective



| TABLE 2c: GROUNDWATER GEOCHEMISTRY - VOLATILES |       |       |      |            |              |
|--|-------|-------|------|------------|--------------|
| PARAMETER                                      | UNITS | ODWS  |      | TW1        |              |
|  |       | LIMIT | TYPE | GW1 (4 hr) | GW2 (8.5 hr) |
|  |       |       |      | 2022-02-03 | 2022-02-03   |
| <b>VOCs Surrogates</b>                         |       |       |      |            |              |
| 1,2-dichloroethane-d4                          | %     | -     | -    | 110        | 120          |
| 4-bromofluorobenzene                           | %     | -     | -    | 82         | 73           |
| Toluene-d8                                     | %     | -     | -    | 119        | 103          |
| <b>Volatiles</b>                               |       |       |      |            |              |
| 1,1,1,2-tetrachloroethane                      | µg/L  | -     | -    | <0.5       | <0.5         |
| 1,1,1-trichloroethane                          | µg/L  | -     | -    | <0.4       | <0.4         |
| 1,1,2,2-tetrachloroethane                      | µg/L  | -     | -    | <0.5       | <0.5         |
| 1,1,2-trichloroethane                          | µg/L  | -     | -    | <0.4       | <0.4         |
| 1,1-dichloroethane                             | µg/L  | -     | -    | <0.4       | <0.4         |
| 1,1-dichloroethylene                           | µg/L  | 14.0  | MAC  | <0.5       | <0.5         |
| 1,2-dichlorobenzene                            | µg/L  | 200.0 | MAC  | <0.4       | <0.4         |
| 1,2-dichloroethane                             | µg/L  | 5.0   | IMAC | <0.2       | <0.2         |
| 1,2-dichloropropane                            | µg/L  | -     | -    | <0.5       | <0.5         |
| 1,3,5-trimethylbenzene                         | µg/L  | -     | -    | <0.3       | <0.3         |
| 1,3-dichlorobenzene                            | µg/L  | -     | -    | <0.4       | <0.4         |
| 1,3-Dichloropropylene (cis+trans)              | µg/L  | -     | -    | <0.3       | <0.3         |
| 1,4-dichlorobenzene                            | µg/L  | 5.0   | MAC  | <0.4       | <0.4         |
| Acetone  | µg/L  | -     | -    | <30        | <30          |
| Benzene  | µg/L  | 1.0   | MAC  | <0.5       | <0.5         |
| Bromodichloromethane                           | µg/L  | -     | -    | <0.3       | <0.3         |
| Bromoform                                      | µg/L  | -     | -    | <0.4       | <0.4         |
| Bromomethane                                   | µg/L  | -     | -    | <0.5       | <0.5         |
| c-1,2-Dichloroethylene                         | µg/L  | -     | -    | <0.4       | <0.4         |
| c-1,3-Dichloropropylene                        | µg/L  | -     | -    | <0.2       | <0.2         |
| Carbon Tetrachloride                           | µg/L  | 2.0   | MAC  | <0.2       | <0.2         |
| Chloroethane                                   | µg/L  | -     | -    | <0.2       | <0.2         |
| Chloroform                                     | µg/L  | -     | -    | <0.5       | <0.5         |
| Dibromochloromethane                           | µg/L  | -     | -    | <0.3       | <0.3         |
| Dichlorodifluoromethane                        | µg/L  | -     | -    | <0.5       | <0.5         |
| Dichloromethane                                | µg/L  | 50    | MAC  | <4.0       | <4.0         |
| Ethylbenzene                                   | µg/L  | 140   | MAC  | <0.5       | <0.5         |
| Ethylene Dibromide                             | µg/L  | -     | -    | <0.2       | <0.2         |
| Hexane   | µg/L  | -     | -    | <5         | <5           |
| m/p-xylene                                     | µg/L  | -     | -    | <0.4       | <0.4         |
| Methyl Ethyl Ketone (MEK)                      | µg/L  | -     | -    | <10        | <10          |
| Methyl Isobutyl Ketone (MIBK)                  | µg/L  | -     | -    | <10        | <10          |
| Methyl Tert Butyl Ether (MTBE)                 | µg/L  | 15    | AO   | <2         | <2           |
| Monochlorobenzene                              | µg/L  | 80    | MAC  | <0.5       | <0.5         |
| o-xylene                                       | µg/L  | -     | -    | <0.4       | <0.4         |
| Styrene  | µg/L  | -     | -    | <0.5       | <0.5         |
| t-1,2-Dichloroethylene                         | µg/L  | -     | -    | <0.4       | <0.4         |
| t-1,3-Dichloropropylene                        | µg/L  | -     | -    | <0.2       | <0.2         |
| Tetrachloroethylene                            | µg/L  | 10    | MAC  | <0.3       | <0.3         |
| Toluene  | µg/L  | 60    | MAC  | <0.4       | <0.4         |
| Trichloroethylene                              | µg/L  | 5     | MAC  | <0.3       | <0.3         |
| Trichlorofluoromethane                         | µg/L  | -     | -    | <0.5       | <0.5         |
| Vinyl Chloride                                 | µg/L  | 1     | MAC  | <0.2       | <0.2         |
| Xylene; total                                  | µg/L  | 90    | MAC  | <0.5       | <0.5         |

- ODWS identifies the following types of parameters:
  - MAC = Maximum Acceptable Concentration
  - IMAC = Interim Maximum Acceptable Concentration
  - AO = Aesthetic Objective
  - OG = Operational Guideline
- Shaded Concentration Indicates an Exceedance of the ODWS Objective

The bacteriological test results from TW1 at 1353 Coker Street (Certificate of Analysis - Report No. 1971215) indicated that the test samples at the 4 and 8.5 hour interval were non-detect (0 ct/100 mL) for E.Coli and Total Coliforms.

Volatile Organic Compounds (VOC's) were not detected in the groundwater samples taken from TW1.

The water quality of the subject water supply well meets all the Ontario Drinking Water Standards maximum acceptable concentrations (MAC). Furthermore, the water meets all of the aesthetic objectives (AO) and operational guidelines (OG) with the exception of the following:

- Hardness (As  $\text{CaCO}_3$ )
- Total Dissolved Solids (TDS)
- Colour
- Iron

Exceedances of the above parameters are not uncommon of the water supply in the subject aquifer. As TW1 currently supplies potable water to the existing building, the client is familiar with the quality of the groundwater. Each of these groundwater parameters are discussed in detail below.

### **Hardness as $\text{CaCO}_3$**

Hardness, expressed as calcium carbonate, an operational guideline, does not appear in the ODWS. Rather, it appears in the Technical Support Documents for Ontario Drinking Water Standards, Objectives and Guidelines as a parameter with an operational guideline of 100 mg/L. At the measured concentration of 384, and 380 mg/L in the test wells, the water is considered to be hard, however it is below the reasonable treatable limit of 500 mg/L specified in Table 3 of the MOECC guidance document Procedure D-5-5 (1996). The hardness concentration can be treated using conventional water softener technologies.

### **TDS**

Total dissolved solids (TDS) refers to the concentration of inorganic substances dissolved in water. The main constituents are typically chloride, sulphates, calcium, magnesium and bicarbonates. There are various levels of the constituents at a low level and it is not anticipated that they will cause an issue with taste. A point of use reverse osmosis unit may be installed if the owner desires for drinking purposes. As such, no taste problems will occur when the system is used.

The Langelier Saturation Index (Langelier, 1936) is used to predict the calcium carbonate stability of water. It indicates whether the water will precipitate, dissolve, or be in equilibrium with calcium carbonate. The Langelier calculation provided an LSI of 0.8. Based on the evaluation of the result, the water is super saturated and tends to precipitate a scale layer of calcium carbonate (scale forming but non-corrosive). Based on the range of stability in the positive direction, there are no mitigative measures needed. See Langelier Saturation Index Calculation attached for calculation details.

## **Colour**

Colour may occur in drinking water for several reasons. It may be due to organic substances from the decay of vegetation; or the presence of metals such as iron, manganese and copper, which are abundant in nature. The provincial aesthetic objective for colour in drinking water is 5 True Colour Units (TCU). The federal (Health Canada) guideline aesthetic objective limit for colour is 15 TCU (Guidelines for Canadian Drinking Water Quality, Health Canada June 2019). Procedure D-5-5 gives a maximum concentration considered reasonably treatable for colour as 7 TCU. As colour is a strictly aesthetic parameter, it can be reduced from the water supply, if desired, through the use of a manganese greensand treatment.

A Hach DR900 colorimeter was used to measure field colour (apparent colour) in the groundwater during the constant rate pumping test. Apparent colour in the groundwater was measured to be 5 TCU at the end of the pumping test. The elevated colour levels detected in the lab samples is attributed to the precipitation of iron out of the groundwater.

## **Iron**

Concentrations of iron above 0.3 mg/L can contribute to staining of fixtures and a metallic taste at higher concentrations. Precipitation of iron can promote the growth of iron bacteria in pipes. The concentration of iron in the groundwater in the test well is considered to be reasonably treatable in accordance with Procedure D-5-5. It is recommended that an iron filter be used to reduce the levels of iron and reduce the potential for excessive precipitate occurring in the water supply system, if desired.

## ***Turbidity***

Turbidity, which is generally an aesthetic parameter, was detected in the laboratory test samples at value of 4.9 NTU at the 4 hour portion of the test, and 2.2 NTU at the endpoint of the pumping test of the test well. Continued pumping showed a decrease towards the end of the test, and was especially noted when the pumping rate was reduced to 9 L/min. It is expected further development of the well would further reduce turbidity values.

The ODWS maximum acceptable concentration for turbidity in drinking water entering the distribution system is 1 NTU. The Aesthetic Objective for turbidity in drinking water reaching the consumer is 5 NTU.



### ***Sodium***

Sodium (Na), an aesthetic parameter, was detected in the laboratory test samples at a concentration of 28 mg/L in both tests, which does not exceed the ODWS aesthetic objective of 200 mg/L. Although sodium is not toxic and no maximum acceptable concentration has been set, concentrations above 20 mg/L require that the Medical Officer of Health be notified of the water quality results, so that this information may be passed on to local physicians for use in treatment of those requiring a sodium-restricted diet.

## **TERRAIN ANALYSIS**

### **Surficial Geology**

A series of test pits were put down on the subject parcel to delineate the subsurface soil conditions as part of the geotechnical investigation (Paterson Report PG6052-1 dated January 16, 2022). On December 17, 2021 four (4) test pits were excavated on the property for the design of the proposed warehouse addition and its associated infrastructure. The location of the test pits on the property are delineated on the Test Hole Location Plan, Drawing No. PG6052-1, attached.

The test hole locations were recorded and the subsurface conditions, including the soil morphology and depth to the groundwater table (if encountered), were carefully observed and recorded. The soils encountered were classified texturally in the field, and later reviewed in the laboratory.

The test pits were advanced to a maximum depth of 3.2 m below ground surface (bgs). Bedrock was not encountered during the test pit program. Based upon available geological mapping, the drift thickness across the site varies from 5 to 10 m bgs

According to the test pit logs, the subsurface profile consisted of a fill of varying compositions extending to depths of 0.6 to 0.8 m bgs generally underlain by a brown silty sand. The underlying brown silty sand layer was not seen in TP2-21. Underlying the brown silty sand was a stiff to very stiff grey silty clay. Groundwater was observed at depths between 0.4 to 1.0 m bgs in the test pits.

Reference should be made to the test pit logs appended to this report for the details of the soil profiles encountered at each test hole location. The client should be aware that any information pertaining to soils are furnished as a matter of general information only and borehole descriptions are not to be interpreted as descriptive of conditions at locations other than those described by the boreholes themselves.

It should be noted that groundwater levels can fluctuate both seasonally and in conjunction with precipitation events. Therefore, groundwater levels could vary at the time of construction.

### **Hydrogeological Sensitivity of the Site**

The subject site is currently occupied by a one storey commercial building which fronts onto Coker Street. The subject site is bordered to the north, east and west by developed commercial properties and to the south by Coker Street followed by additional developed commercial properties. All surrounding properties are on private services. The adjacent properties are serviced by private wells and septic systems.

The ground surface across the site is relatively flat, with a general downslope direction to the south. The general overburden groundwater flow direction is assumed to be south towards the Osgoode Gardens Cedar Acres municipal drain. The regional groundwater flow is considered to be in an southeasterly direction, towards the North Castor River.

The overburden generally consists of a fill overlying a brown silty sand which is underlain by a grey silty clay. Bedrock was not encountered during the field program. According to available geological mapping, the drift thickness within the site varies from 5 to 10 m bgs. According to the geotechnical field investigation, the overburden thickness was observed to be greater than 2 m.

As the proposed site does not have bedrock within 2.0 m of the ground surface, the site is not considered hydrogeologically sensitive. Separation distances are not required to be increased between the septic components and the onsite well.

To corroborate our position in this matter, the water quality of the bedrock aquifer targeted by the onsite drilled potable supply well shows no indication of surface water or surface impacts from sewage system effluent.

### **Conceptual Lot Development Plan**

It is proposed to add a warehouse to the existing site which is currently occupied by a one storey commercial building. The location of the existing and proposed structures can be found on the attached PH4407 - 3 - Water Well location Plan, attached. It illustrates that the proposed design layout is adequate to accommodate the associated private services and meet all the regulated separation criteria. Please note that the proposed design layout is not meant to restrict the location of the proposed buildings or private services and is designed to demonstrate that the minimum separation distances can be achieved.

### **Proposed Sewage System**

Paterson has completed a replacement sewage system design for the proposed development. A septic flow value of 1,900 L/day was used for the existing building and a septic flow value of 1,700 L/day was calculated for the proposed building addition. This results in a total daily design sewage flow (TDDSF) of 3,600 L/day. Refer to the approved OSSO Septic Permit attached for more specific details. The septic flow values were calculated in accordance with the OBC and are as follows:

Existing Building:

- Factory (no showers) with 6 employees =  $6 \times 76 \text{ L/day} = 450 \text{ L/day}$  OR
- Number of water closets =  $2 \times 950 \text{ L/day} = 1,900 \text{ L/day}$

Proposed Building Addition:

- Warehouse with 5 bay door = 5 x 150 l/day = 750 L/day; AND
- Number of water closets = 1 x 950 L/day = 950 L/day

Combined Existing Building and Proposed Building Addition:

- Existing Building (1,900 L/day) + Proposed Building Addition (1,700 L/day)  
= 3,600 L/day.

### PREDICTIVE NITRATE IMPACT ASSESSMENT

In order to demonstrate that private services would adequately support the proposed commercial development, a predictive nitrate impact assessment for the subject site was completed. The values shown in the Predictive Nitrate Impact Assessment attached to this report are summarized below.

- Site area 0.27 Ha
- Impervious area % 45 %
- Daily sewage flow 3.6 m<sup>3</sup>
- Concentration of nitrate in effluent 40 mg/L  
(Value based on typical effluent concentration)
- Concentration of nitrate in effluent with treatment 4 mg/L  
(Value based on tertiary treatment system with 90% nitrate reduction)
- Surplus Water 379 mm/year  
(The surplus water value was estimated based on Environment Canada Climate Office values with a soil type comprised of fine sandy loam (Urban Lawns) and anthropogenic sources.)
- Combined infiltration factor based on: 0.70
  - Topography infiltration factor 0.30
  - Soil texture infiltration factor 0.30
  - Cover infiltration factor 0.10

The topography infiltration factor of 0.30 is based upon a flat land with average slope of < 0.6 m / km for the proposed development.

The soil texture infiltration factor was based upon an average of “open sandy loam” with a value of 0.4 and “medium combinations of clay and loam” with a value of 0.2 which is a

reasonable generalization based upon the site investigations and available geological mapping.

The “vegetative cover infiltration factor” was calculated as 0.1 based upon the minimum value for cultivated land.

The calculation for a conventional sewage system results in a predicted nitrate concentration of 30.8 mg/L nitrate concentration for the subject site, using a value of 40 mg/L nitrate concentration within the effluent. This value was based upon using a septic flow value of 3,600 L/day for the daily sewage flow. It is expected that the actual usage should be lower.

An existing approved tertiary treatment system capable of reducing the nitrate loading in the effluent is the Waterloo Biofilter brand. The system has an available nitrate reduction of 25 to 35% based upon the standard single pass system and 50 to 65% based upon a double pass re-circulation system. With the addition of the WaterNOx system, 90 to 95% total nitrogen removal can be achieved. This would reduce the nitrate concentration in the effluent from 40 mg/L down to as low as 4 mg/L. Provided the value of 30.8 mg/L of nitrates for the fully sized system, a 90% reduction would provide a value of 3.1 mg/L. A WaterNOx system has been included in the new septic design for the property, as shown in the attached Paterson drawing, PH4407-1-REV.02.

Based on the results of the predicted nitrate impact assessment, it is our opinion that the proposed property can adequately support the proposed commercial development without having an adverse impact on the underlying bedrock aquifer

## CONCLUSIONS

Based on the information contained within the body of this report, the following conclusions can be drawn:

1. The water supply aquifer intercepted by the existing well is considered to be adequate to support the water quantity demands for the proposed warehouse addition.
2. As TW1 currently provides potable water to the existing building, the client is familiar with the quality of the groundwater.
3. The preferred water supply aquifer intercepted by the test wells contains a water supply that is potable, and contains only elevated concentrations of Hardness, TDS, Colour, and Iron. All of the parameters can be treated with current readily available water conditioning equipment.
4. The sodium concentrations were measured to be above the 20 mg/L reporting limit and, as such, the Medical Officer of Health for the City of Ottawa should be informed to assist area physicians in the treatment of local residents on sodium reduced diets.
5. A residential grade water softener is recommended to facilitate the reduction of the hardness concentration. If a water softener is used for the proposed development, the owner should be made aware that additional sodium will be added to the water to reduce hardness. If desired, a point-of-use reverse osmosis system can be used to provide a drinking tap source.
6. If desired, the client can use a iron filter to treat the potential iron values.
7. If desired, the client can use a carbon filter to treat the potential colour values.
8. Any private water supply wells (drilled) and the onsite sewage system components must have a minimum of 15 m horizontal separation as per the Ontario Building Code (2012).
9. The predicted nitrate concentrations at the property boundary is calculated to be below the required 10 mg/L threshold when a standard denitrification system such as the Waterloo Biofilter WaterNOx system is used.
10. The subject site is sufficient in size to accommodate a new sewage system and meet all the regulatory separation criteria

11. A Sewage System Permit and Building Permit need to be issued prior to the commencement of construction on the proposed warehouse addition or the proposed septic system.
12. The results of the Hydrogeological Assessment and Terrain Analysis have provided satisfactory evidence that the subject site can support the proposed warehouse addition with respect to water quality, quantity and sewage system placement.

We trust that this satisfies your present requirements. Should you have any questions regarding this submission, please do not hesitate to contact the undersigned.

Yours truly,

**PATERSON GROUP INC.**



Erik Ardley, BSc Geology.



Michael S. Killam, P.Eng.



**Attachments:**

- Figure 1 - Key Plan
- MECP Water Well Records
- Eurofins Certificate of Analysis
- Paterson Test Pit Logs
- AQTESOLV - Pumping Test Analysis Reports
- Nitrate Impact Assessment Calculations
- D.B. Grey Engineering Inc. Drawing A-002 - New Site Plan + Notes
- Paterson Drawing PG6052-1 - Test Hole Location Plan
- Paterson Drawing PH4407-1(Rev.02) - Sewage System Layout Plan
- Paterson Drawing PH4356-3 - Water Well Location Plan
- Approved OSSO Septic Permit

**Paterson Group Inc.**

**Head Office and Laboratory**  
154 Colonnade Road South  
Ottawa - Ontario - K2E 7J5  
Tel: (613) 226-7381

**Northern Office and Laboratory**  
63 Gibson Street  
North Bay - Ontario - P1B 8Z4  
Tel: (705) 472-5331

**St. Lawrence Office**  
993 Princess Street  
Kingston - Ontario - K7L 1H3  
Tel: (613) 542-7381





# FIGURE 1

## KEY PLAN

316/50



GROUND WATER BRANCH  
NOV 14 1961  
15  
No. 7222  
ONTARIO WATER RESOURCES COMMISSION

UTM 1182 454660 E

15161112170 N

Elev. 41 05322

# WATER WELL RECORD

Basin 25 | | | | @ *Carlton*  
County or District  
Con. 4 Lot PT 5

Township, Village, Town or City *Osgoode*  
Date completed *21 Aug 61*  
(day month year)  
Address *RR-1 Osgoode*

### Casing and Screen Record

Inside diameter of casing *2*  
Total length of casing *38*  
Type of screen *-*  
Length of screen *-*  
Depth to top of screen *-*  
Diameter of finished hole *2*

### Pumping Test

Static level *1*  
Test-pumping rate *12* G.P.M.  
Pumping level *20*  
Duration of test pumping *3 hr*  
Water clear or cloudy at end of test *Clear*  
Recommended pumping rate *6* G.P.M.  
with pump setting of *20* feet below ground surface

### Well Log


### Water Record

| Overburden and Bedrock Record | From ft.  | To ft.    | Depth(s) at which water(s) found | Kind of water (fresh, salty, sulphur) |
|-------------------------------|-----------|-----------|----------------------------------|---------------------------------------|
| <i>Sandy Clay</i>             | <i>0</i>  | <i>10</i> | <i>39</i>                        | <i>fresh</i>                          |
| <i>sand</i>                   | <i>10</i> | <i>25</i> |                                  |                                       |
| <i>Gravel + sand</i>          | <i>25</i> | <i>36</i> |                                  |                                       |
| <i>Gravel</i>                 | <i>36</i> | <i>39</i> |                                  |                                       |

For what purpose(s) is the water to be used? *House*  
Is well on upland, in valley, or on hillside? *upland*  
Drilling or Boring Firm *J.R. Conette*  
Address *1510 Base line RD Ottawa*  
Licence Number *246*  
Name of Driller or Borer *J.R. Conette*  
Address *2 Canal*  
Date *Sept 16-61*  
(Signature of Licensed Drilling or Boring Contractor)

### Location of Well

In diagram below show distances of well from road and lot line. Indicate north by arrow.

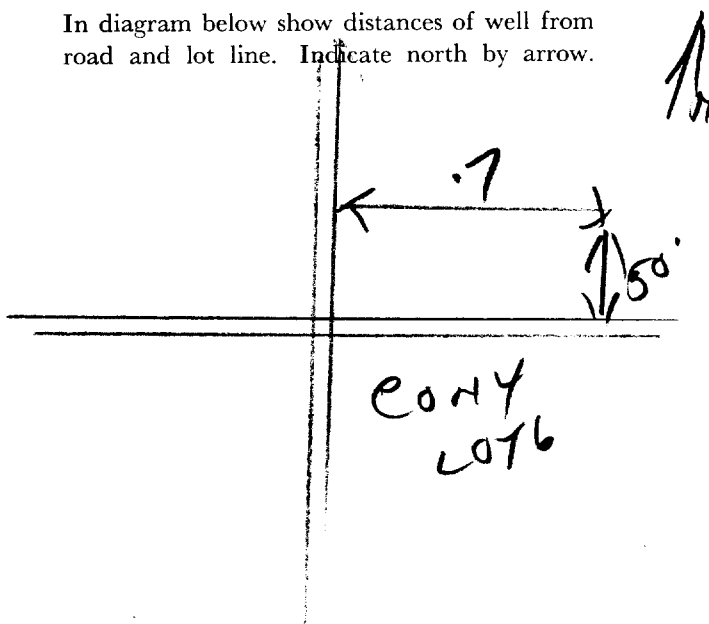

JB

316/57



UTM 1182 455180E

WATER RESOURCES DIVISION 15 No 7224 SEP 28 1965 ONTARIO WATER RESOURCES COMMISSION

Co. 5 R. 15 0 1 1 6 1 9 N The Ontario Water Resources Commission Act

# WATER WELL RECORD

Elev. 503.25

Basin 215 | Carleton

Township, Village, Town or City Osgoode

Con. IV Lot 5

Date completed 26 July 1965 (day month year)

Address RR 2 Osgoode

### Casing and Screen Record

Inside diameter of casing 6 1/4  
 Total length of casing 18'  
 Type of screen —  
 Length of screen —  
 Depth to top of screen —  
 Diameter of finished hole 6"

### Pumping Test

Static level 20'  
 Test-pumping rate 5 G.P.M.  
 Pumping level 65'  
 Duration of test pumping 1/2 hr  
 Water clear or cloudy at end of test cloudy  
 Recommended pumping rate 5 G.P.M.  
 with pump setting of 65 feet below ground surface

### Well Log


### Water Record

| Overburden and Bedrock Record | From ft. | To ft. | Depth(s) at which water(s) found | Kind of water (fresh, salty, sulphur) |
|-------------------------------|----------|--------|----------------------------------|---------------------------------------|
| sand & boulders               | 0        | 15     |                                  |                                       |
| grey limestone                | 15       | 68     | 55-68                            | Fresh                                 |
|                               |          |        |                                  |                                       |
|                               |          |        |                                  |                                       |
|                               |          |        |                                  |                                       |
|                               |          |        |                                  |                                       |
|                               |          |        |                                  |                                       |
|                               |          |        |                                  |                                       |

For what purpose(s) is the water to be used? house  
 Is well on upland, in valley, or on hillside? upland  
 Drilling or Boring Firm McLean Water Supply Ltd  
 Address 1532 Raven Ave Ottawa 3  
 Licence Number 1686  
 Name of Driller or Borer H. Sally  
 Address  
 Date July 26 1965  
 (Signature of Licensed Drilling or Boring Contractor)

### Location of Well

In diagram below show distances of well from road and lot line. Indicate north by arrow.

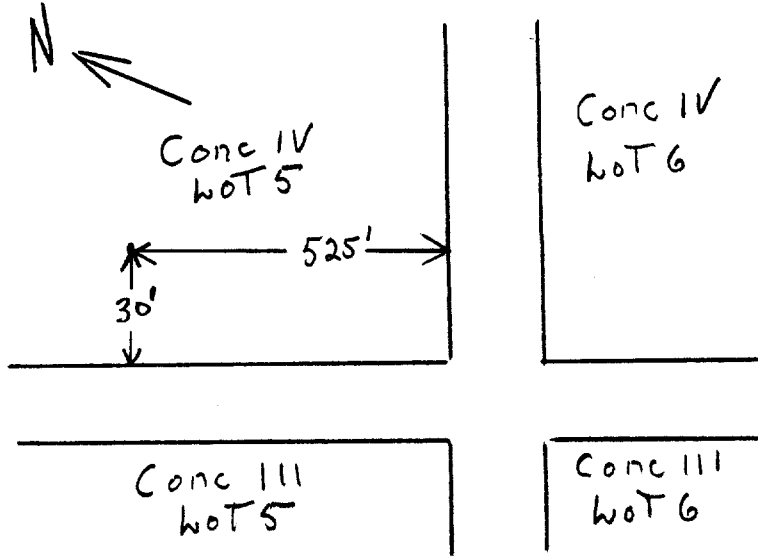

1 8 Z 4 5 5 3 6 0  
 4 R 5 0 1 1 1 7 7 0  
 5 R 0 3 2 5  
 2 5



1509840

316/59 B

The Ontario Water Resources Commission Act

# WATER WELL RECORD

County or District Carleton Place Township, Village, Town or City Carleton Place  
 Con. 5 Lot 4 Date completed 20 June 1968  
 (day month year)  
 Address Manastick

### Casing and Screen Record

Inside diameter of casing 4 inch  
 Total length of casing 13  
 Type of screen  
 Length of screen  
 Depth to top of screen  
 Diameter of finished hole 4 inch

### Pumping Test

Static level 20  
 Test-pumping rate 10 G.P.M.  
 Pumping level 22  
 Duration of test pumping 30 min  
 Water clear or cloudy at end of test clearly  
 Recommended pumping rate 5 G.P.M.  
 with pump setting of 35 feet below ground surface

### Well Log


### Water Record

| Overburden and Bedrock Record | From ft.  | To ft.    | Depth(s) at which water(s) found | Kind of water (fresh, salty, sulphur) |
|-------------------------------|-----------|-----------|----------------------------------|---------------------------------------|
| <u>sandy soil</u>             | <u>0</u>  | <u>3</u>  | <u>42</u>                        | <u>fresh</u>                          |
| <u>hard pan and stone</u>     | <u>3</u>  | <u>13</u> |                                  |                                       |
| <u>hard grey limestone</u>    | <u>13</u> | <u>42</u> |                                  |                                       |
|                               |           |           |                                  |                                       |
|                               |           |           |                                  |                                       |
|                               |           |           |                                  |                                       |
|                               |           |           |                                  |                                       |

For what purpose(s) is the water to be used? house  
 Is well on upland, in valley, or on hillside? valley  
 Drilling or Boring Firm Maurice Cayer  
 Address Carletonman  
Ont  
 Licence Number 2911  
 Name of Driller or Borer  
 Address  
 Date 20 June 1968  
Maurice Cayer  
 (Signature of Licensed Drilling or Boring Contractor)

### Location of Well

In diagram below show distances of well from road and lot line. Indicate north by arrow.

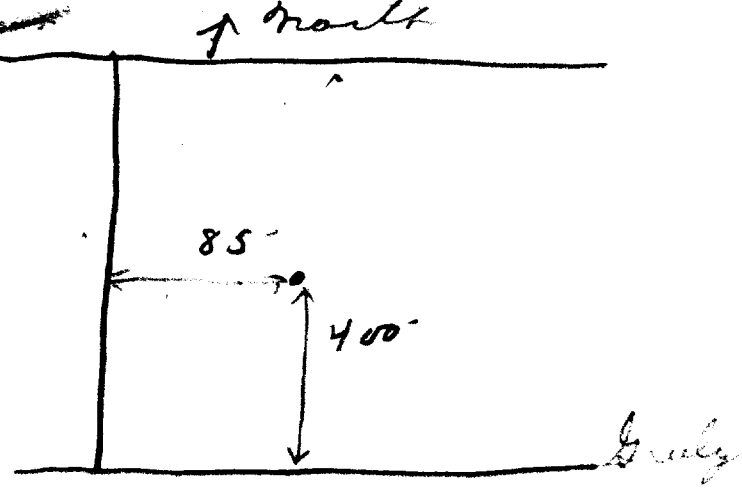



# The Ontario Water Resources Commission Act

# WATER WELL RECORD

Water management in Ontario

1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11

1510585

MUNICIP. 10 15009 14

CON. 15 CPN 22 23 24 04

|  |  |  |   |
|--|--|--|---|
| COUNTY OR DISTRICT<br><b>CARLETON</b>      | TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE<br><b>OSGOODE</b> | CON., BLOCK, TRACT, SURVEY, ETC.<br><b>4</b> | LOT<br><b>006</b>   |
| OWNER (SURNAME FIRST)<br><b>[REDACTED]</b> |  | ADDRESS<br><b>463 RIVERDALE AVE. OTTAWA,</b> | DATE COMPLETED<br>DAY <b>14</b> MO <b>05</b> YR <b>70</b> |
| U<br><b>21</b>                             | T<br><b>18</b>   | E<br><b>455300</b>                           | N<br><b>5011590</b>                                       |
| M<br><b>10</b>                             | L<br><b>12</b>   | S<br><b>17</b>                               | W<br><b>5</b>   |
|  |  |  | E<br><b>0322</b>  |
|  |  |  | R<br><b>4</b>   |
|  |  |  | B<br><b>25</b>  |

### LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

| GENERAL COLOUR | MOST COMMON MATERIAL | OTHER MATERIALS | GENERAL DESCRIPTION | DEPTH - FEET |     |
|----------------|----------------------|-----------------|---------------------|--------------|-----|
|                |                      |                 |                     | FROM         | TO  |
|                | SAND                 | LOAM            |                     | 0            | 5   |
|                | GRAVEL               | BOULDERS SAND   |                     | 5            | 17  |
| GREY           | LIMESTONE            |                 |                     | 17           | 108 |
|                |                      |                 |                     |              |     |
|                |                      |                 |                     |              |     |
|                |                      |                 |                     |              |     |
|                |                      |                 |                     |              |     |
|                |                      |                 |                     |              |     |
|                |                      |                 |                     |              |     |
|                |                      |                 |                     |              |     |
|                |                      |                 |                     |              |     |
|                |                      |                 |                     |              |     |
|                |                      |                 |                     |              |     |
|                |                      |                 |                     |              |     |
|                |                      |                 |                     |              |     |
|                |                      |                 |                     |              |     |

|                     |                       |                     |                     |
|---------------------|-----------------------|---------------------|---------------------|
| 31 <u>0005 0209</u> | 32 <u>0017 111309</u> | 33 <u>0108 0108</u> | 34 <u>0108 0108</u> |
|---------------------|-----------------------|---------------------|---------------------|

#### 41 WATER RECORD

| WATER FOUND AT - FEET | KIND OF WATER                             |                                |                                  |                                  |
|-----------------------|---|--------------------------------|----------------------------------|----------------------------------|
| 10-13<br><b>0105</b>  | <input checked="" type="checkbox"/> FRESH | <input type="checkbox"/> SALTY | <input type="checkbox"/> SULPHUR | <input type="checkbox"/> MINERAL |
| 15-18                 | <input type="checkbox"/> FRESH            | <input type="checkbox"/> SALTY | <input type="checkbox"/> SULPHUR | <input type="checkbox"/> MINERAL |
| 20-23                 | <input type="checkbox"/> FRESH            | <input type="checkbox"/> SALTY | <input type="checkbox"/> SULPHUR | <input type="checkbox"/> MINERAL |
| 25-28                 | <input type="checkbox"/> FRESH            | <input type="checkbox"/> SALTY | <input type="checkbox"/> SULPHUR | <input type="checkbox"/> MINERAL |
| 30-33                 | <input type="checkbox"/> FRESH            | <input type="checkbox"/> SALTY | <input type="checkbox"/> SULPHUR | <input type="checkbox"/> MINERAL |

#### 51 CASING & OPEN HOLE RECORD


| INSIDE DIAM. INCHES | MATERIAL  | WALL THICKNESS INCHES | DEPTH - FEET |                      |
|---------------------|---|-----------------------|--------------|----------------------|
|                     |   |                       | FROM         | TO                   |
| 10-11<br><b>06</b>  | <input checked="" type="checkbox"/> STEEL   |                       |              | 13-16<br><b>0022</b> |
| 11-18<br><b>54</b>  | <input type="checkbox"/> GALVANIZED<br><input type="checkbox"/> CONCRETE<br><input type="checkbox"/> OPEN HOLE  | <b>188</b>            | <b>0</b>     | <b>22</b>            |
| 17-18<br><b>06</b>  | <input type="checkbox"/> STEEL<br><input type="checkbox"/> GALVANIZED<br><input type="checkbox"/> CONCRETE<br><input checked="" type="checkbox"/> OPEN HOLE |                       | <b>22</b>    | 20-23<br><b>0108</b> |
| 24-25<br><b>14</b>  | <input type="checkbox"/> STEEL<br><input type="checkbox"/> GALVANIZED<br><input type="checkbox"/> CONCRETE<br><input type="checkbox"/> OPEN HOLE            |                       |              | 27-30<br><b>108</b>  |

#### 61 PLUGGING & SEALING RECORD

| DEPTH SET AT - FEET |                    | MATERIAL AND TYPE<br>(CEMENT GROUT, LEAD PACKER, ETC.) |
|---------------------|--------------------|--|
| FROM                | TO                 |  |
| 10-13<br><b>17</b>  | 14-17<br><b>22</b> | <b>CEMENT GROUT</b>                                    |
| 18-21               | 22-25              |  |
| 26-29               | 30-33              |  |

#### 71 PUMPING TEST

|  |   |  |  |  |  |  |
|--|---|--|--|--|--|--|
| PUMPING TEST METHOD<br><input type="checkbox"/> PUMP <input checked="" type="checkbox"/> BAILER  | PUMPING RATE<br><b>0010</b> GPM.              | DURATION OF PUMPING<br><b>01</b> HOURS <b>00</b> MINS. |  |  |  |  |
| STATIC LEVEL<br><b>015</b> FEET  | WATER LEVEL END OF PUMPING<br><b>030</b> FEET | WATER LEVELS DURING                                    |  |  |  |  |
| <table style="width: 100%;"> <tr> <td>15 MINUTES<br/>26-28<br/><b>018</b> FEET</td> <td>30 MINUTES<br/>29-31<br/><b>017</b> FEET</td> <td>45 MINUTES<br/>32-34<br/><b>016</b> FEET</td> <td>60 MINUTES<br/>35-37<br/><b>015</b> FEET</td> </tr> </table> |   |  | 15 MINUTES<br>26-28<br><b>018</b> FEET | 30 MINUTES<br>29-31<br><b>017</b> FEET | 45 MINUTES<br>32-34<br><b>016</b> FEET | 60 MINUTES<br>35-37<br><b>015</b> FEET |
| 15 MINUTES<br>26-28<br><b>018</b> FEET   | 30 MINUTES<br>29-31<br><b>017</b> FEET        | 45 MINUTES<br>32-34<br><b>016</b> FEET                 | 60 MINUTES<br>35-37<br><b>015</b> FEET |  |  |  |
| IF FLOWING, GIVE RATE  | PUMP INTAKE SET AT<br>GPM.                    | WATER AT END OF TEST<br>FEET                           |  |  |  |  |
| RECOMMENDED PUMP TYPE<br><input type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP   | RECOMMENDED PUMP SETTING<br><b>050</b> FEET   | RECOMMENDED PUMPING RATE<br><b>0008</b> GPM.           |  |  |  |  |
| 50-53 <b>000.7</b> GPM./FT. SPECIFIC CAPACITY  |   |  |  |  |  |  |

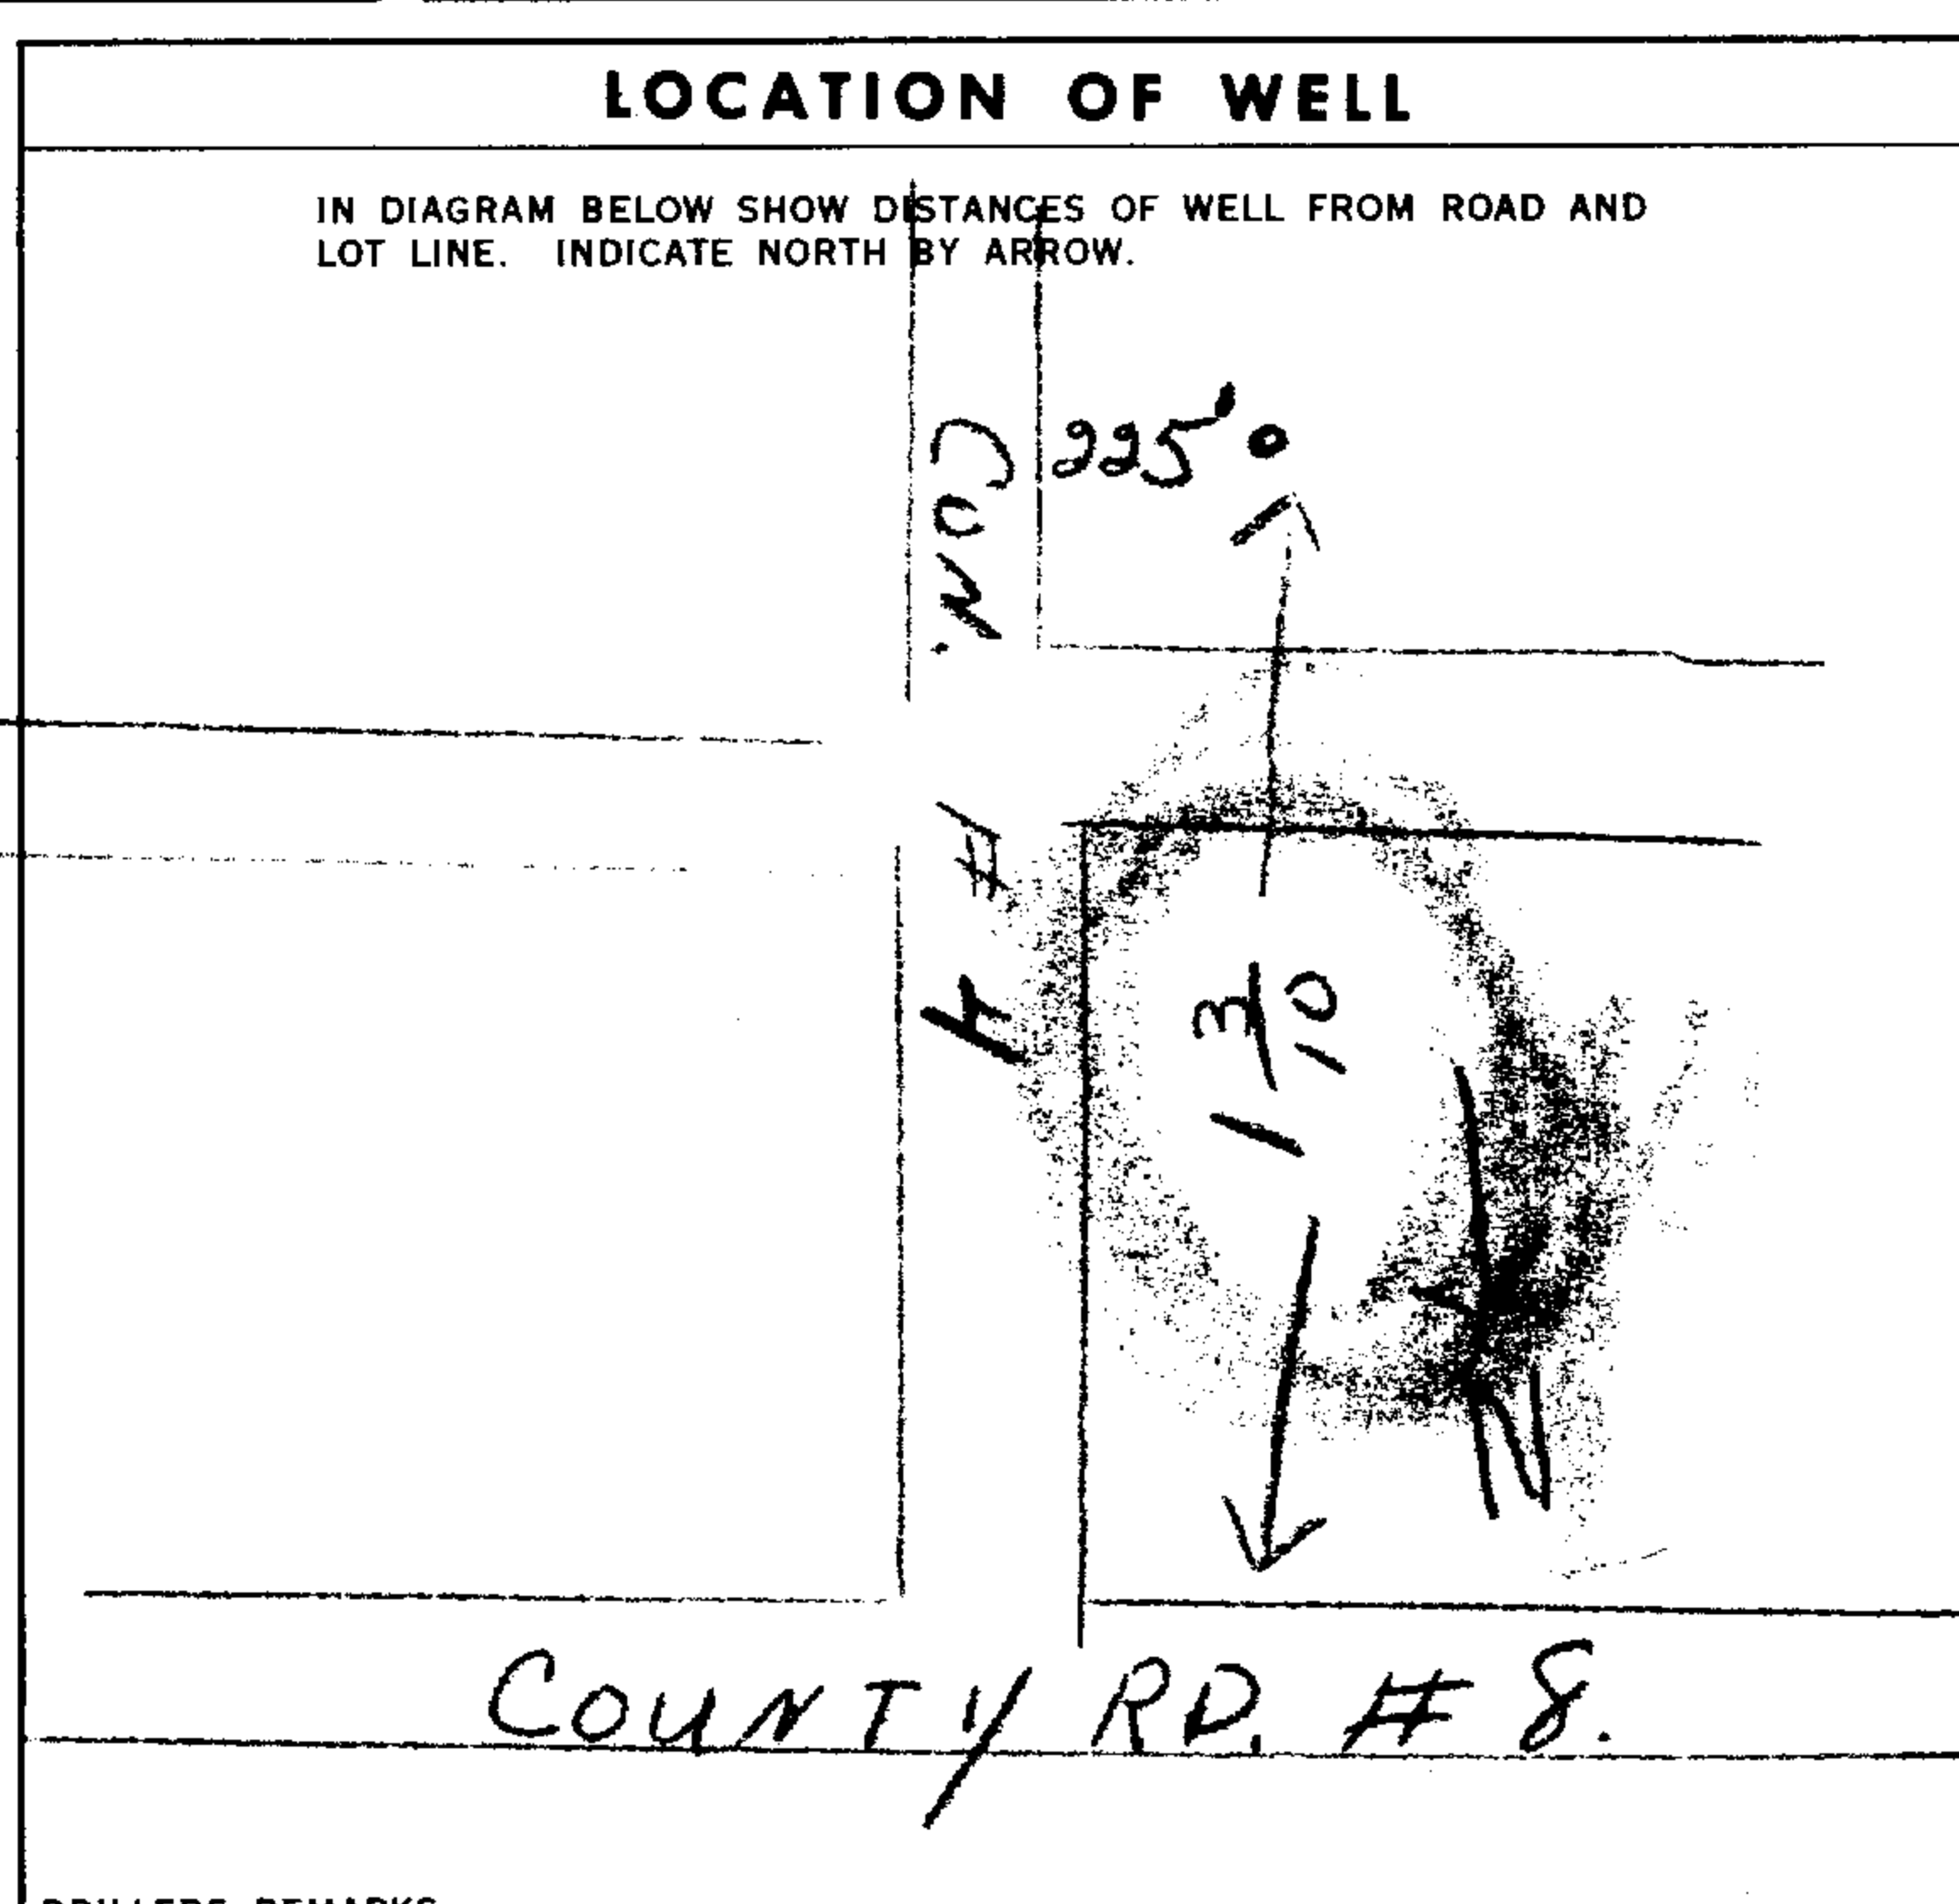

#### FINAL STATUS OF WELL

|  |   |
|--|---|
| <input checked="" type="checkbox"/> WATER SUPPLY | <input type="checkbox"/> ABANDONED, INSUFFICIENT SUPPLY |
| <input type="checkbox"/> OBSERVATION WELL        | <input type="checkbox"/> ABANDONED, POOR QUALITY        |
| <input type="checkbox"/> TEST HOLE               | <input type="checkbox"/> UNFINISHED                     |
| <input type="checkbox"/> RECHARGE WELL           |   |

#### WATER USE

|  |  |
|--|--|
| <input checked="" type="checkbox"/> DOMESTIC | <input type="checkbox"/> COMMERCIAL                  |
| <input type="checkbox"/> STOCK               | <input type="checkbox"/> MUNICIPAL                   |
| <input type="checkbox"/> IRRIGATION          | <input type="checkbox"/> PUBLIC SUPPLY               |
| <input type="checkbox"/> INDUSTRIAL          | <input type="checkbox"/> COOLING OR AIR CONDITIONING |
| <input type="checkbox"/> OTHER               | <input type="checkbox"/> NOT USED                    |

#### METHOD OF DRILLING

|  |                                  |
|--|----------------------------------|
| <input checked="" type="checkbox"/> CABLE TOOL | <input type="checkbox"/> BORING  |
| <input type="checkbox"/> ROTARY (CONVENTIONAL) | <input type="checkbox"/> DIAMOND |
| <input type="checkbox"/> ROTARY (REVERSE)      | <input type="checkbox"/> JETTING |
| <input type="checkbox"/> ROTARY (AIR)          | <input type="checkbox"/> DRIVING |
| <input type="checkbox"/> AIR PERCUSSION        |                                  |

#### CONTRACTOR

|   |   |
|---|---|
| NAME OF WELL CONTRACTOR<br><b>MCLEAN WATER SUPPLY LTD</b> | LICENCE NUMBER<br><b>3504</b>                             |
| ADDRESS<br><b>1532 RAVEN AVE. OTTAWA 3,</b>               |   |
| NAME OF DRILLER OR BORER<br><b>M. MALLON</b>              | LICENCE NUMBER  |
| SIGNATURE OF CONTRACTOR<br><i>[Signature]</i>             | SUBMISSION DATE<br>DAY <b>19</b> MO <b>5</b> YR <b>70</b> |

#### OFFICE USE ONLY

|                         |                                 |                                |
|-------------------------|---------------------------------|--------------------------------|
| DATA SOURCE<br><b>1</b> | CONTRACTOR<br><b>3504</b>       | DATE RECEIVED<br><b>280570</b> |
| DATE OF INSPECTION      | INSPECTOR<br><b>[Signature]</b> |                                |
| REMARKS:                |                                 |                                |

OWRC COPY



# WATER WELL RECORD

1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11

1522346

MUNICIPALITY 15009

CON. 10 14 15 22 23 24

COUNTY OR DISTRICT: OTTAWA-CARLETON  
TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE: TWP. OF OSSBOONE  
CON. BLOCK, TRACT, SURVEY ETC: CONCESSION 4  
LOT: 5

OWNER (SURNAME FIRST): DONWEL CONSTRUCTION  
ADDRESS: 6979 SHADOW RIDGE, GREELEY, ONT.  
DATE COMPLETED: DAY 18 MO 04 YR 88

21

ZONE EASTING NORTHING RC ELEVATION RC BASIN CODE II III IV

| GENERAL COLOUR | MOST COMMON MATERIAL | OTHER MATERIALS | GENERAL DESCRIPTION | DEPTH - FEET |     |
|----------------|----------------------|-----------------|---------------------|--------------|-----|
|                |                      |                 |                     | FROM         | TO  |
| BROWN          | SAND                 |                 |                     | 0            | 8   |
| GREY           | SAND, GRAVEL         | BOULDERS        |                     | 8            | 56  |
| GREY           | LIMESTONE            | SLATE           |                     | 56           | 176 |

31

32

41 WATER RECORD

| WATER FOUND AT - FEET | KIND OF WATER  |
|-----------------------|--|
| 10-13<br>95           | 1 <input checked="" type="checkbox"/> FRESH<br>2 <input type="checkbox"/> SALTY<br>3 <input type="checkbox"/> SULPHUR<br>4 <input type="checkbox"/> MINERALS<br>6 <input type="checkbox"/> GAS |
| 15-18                 | 1 <input type="checkbox"/> FRESH<br>2 <input type="checkbox"/> SALTY<br>3 <input type="checkbox"/> SULPHUR<br>4 <input type="checkbox"/> MINERALS<br>6 <input type="checkbox"/> GAS            |
| 20-23                 | 1 <input type="checkbox"/> FRESH<br>2 <input type="checkbox"/> SALTY<br>3 <input type="checkbox"/> SULPHUR<br>4 <input type="checkbox"/> MINERALS<br>6 <input type="checkbox"/> GAS            |
| 25-28                 | 1 <input type="checkbox"/> FRESH<br>2 <input type="checkbox"/> SALTY<br>3 <input type="checkbox"/> SULPHUR<br>4 <input type="checkbox"/> MINERALS<br>6 <input type="checkbox"/> GAS            |
| 30-33                 | 1 <input type="checkbox"/> FRESH<br>2 <input type="checkbox"/> SALTY<br>3 <input type="checkbox"/> SULPHUR<br>4 <input type="checkbox"/> MINERALS<br>6 <input type="checkbox"/> GAS            |

51 CASING & OPEN HOLE RECORD

| INSIDE DIAM. INCHES | MATERIAL  | WALL THICKNESS INCHES | DEPTH - FEET |       |
|---------------------|---|-----------------------|--------------|-------|
|                     |   |                       | FROM         | TO    |
| 10-11<br>6 1/4"     | 1 <input checked="" type="checkbox"/> STEEL<br>2 <input type="checkbox"/> GALVANIZED<br>3 <input type="checkbox"/> CONCRETE<br>4 <input type="checkbox"/> OPEN HOLE<br>5 <input type="checkbox"/> PLASTIC | .188                  | 0            | 63    |
| 17-18<br>6"         | 1 <input type="checkbox"/> STEEL<br>2 <input type="checkbox"/> GALVANIZED<br>3 <input type="checkbox"/> CONCRETE<br>4 <input type="checkbox"/> OPEN HOLE<br>5 <input type="checkbox"/> PLASTIC            |                       | 63           | 126   |
| 24-25               | 1 <input type="checkbox"/> STEEL<br>2 <input type="checkbox"/> GALVANIZED<br>3 <input type="checkbox"/> CONCRETE<br>4 <input type="checkbox"/> OPEN HOLE<br>5 <input type="checkbox"/> PLASTIC            |                       |              | 27-30 |

SCREEN

| SIZE(S) OF OPENING (SLOT NO.) | DIAMETER | LENGTH |
|-------------------------------|----------|--------|
|                               | INCHES   | FEET   |
|                               |          | 41-44  |
|                               |          | FEET   |

MATERIAL AND TYPE

DEPTH TO TOP OF SCREEN

61 PLUGGING & SEALING RECORD

| DEPTH SET AT - FEET | MATERIAL AND TYPE | (CEMENT GROUT LEAD PACKER ETC.) |
|---------------------|-------------------|---------------------------------|
| FROM                | TO                |                                 |
| 0-10<br>0           | 14-17<br>63       | CEMENT GROUT                    |
| 18-21               | 22-25             | BENTONITE SLURRY                |
| 26-28               | 30-33             | (Pressure grout)                |

71 PUMPING TEST

PUMPING TEST METHOD: 1  PUMP 2  BAILER

PUMPING RATE: 20 GPM

DURATION OF PUMPING: 15-16 HOURS 30 MINS

| STATIC LEVEL | WATER LEVEL END OF PUMPING | WATER LEVELS DURING |            |            |            |
|--------------|----------------------------|---------------------|------------|------------|------------|
| 19-21 FEET   | 22-24 FEET                 | 15 MINUTES          | 30 MINUTES | 45 MINUTES | 60 MINUTES |
| 10           | 115                        | 115                 | 115        | 115        | 115        |

IF FLOWING, GIVE RATE: — GPM

PUMP INTAKE SET AT: 115 FEET

WATER AT END OF TEST: 1  CLEAR 2  CLOUDY

RECOMMENDED PUMP TYPE:  SHALLOW  DEEP

RECOMMENDED PUMP SETTING: 115 FEET

RECOMMENDED PUMPING RATE: 620 GPM

FINAL STATUS OF WELL

1  WATER SUPPLY  
2  OBSERVATION WELL  
3  TEST HOLE  
4  RECHARGE WELL

5  ABANDONED, INSUFFICIENT SUPPLY  
6  ABANDONED POOR QUALITY  
7  UNFINISHED  
9  DEWATERING

WATER USE


1  DOMESTIC  
2  STOCK  
3  IRRIGATION  
4  INDUSTRIAL  
5  OTHER

6  COMMERCIAL  
8  MUNICIPAL  
7  PUBLIC SUPPLY  
9  COOLING OR AIR CONDITIONING  
9  NOT USED

METHOD OF CONSTRUCTION

1  CABLE TOOL  
2  ROTARY (CONVENTIONAL)  
3  ROTARY (REVERSE)  
4  ROTARY (AIR)  
5  AIR PERCUSSION

6  BORING  
7  DIAMOND  
8  JETTING  
9  DRIVING  
9  DIGGING  
9  OTHER

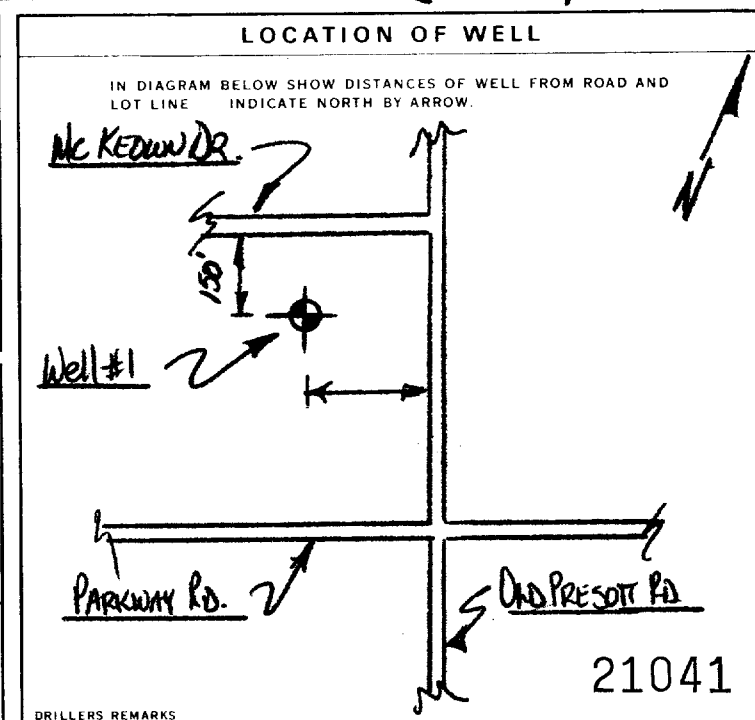

CONTRACTOR

NAME OF WELL CONTRACTOR: STANTON DRILLING INC  
WELL CONTRACTOR'S LICENCE NUMBER: 4875

ADDRESS: BOX 429, GREELEY, ONT.

NAME OF WELL TECHNICIAN: PETER JA STANTON  
WELL TECHNICIAN'S LICENCE NUMBER: T-0036

SIGNATURE OF TECHNICIAN/CONTRACTOR: [Signature]

SUBMISSION DATE: DAY 26 MO 04 YR 88

OFFICE USE ONLY

DATA SOURCE: 58 CONTRACTOR: 59-62 DATE RECEIVED: 63-68

DATE OF INSPECTION: JUN 21 1988

INSPECTOR: [Signature]

REMARKS: [Blank]

CSSEES

1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11

1522347

MUNICIP 15009

CON.

COUNTY OR DISTRICT: OTTAWA-CARLETON  
TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE: TWP. OF OSGOODE  
CON. BLOCK, TRACT, SURVEY, ETC: CONCESSION 4  
LOT: 5  
OWNER (SURNAME FIRST): DONWEL CONSTRUCTION  
ADDRESS: 6979 SHADOW RIDGE, GREEZY, ONT.  
DATE COMPLETED: DAY 18 MO 04 YR 88

U ZONE EASTING NORTHING RC ELEVATION RC BASIN CODE III IV

| LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS) |                      |                 |                     |              |    |
|--|----------------------|-----------------|---------------------|--------------|----|
| GENERAL COLOUR   | MOST COMMON MATERIAL | OTHER MATERIALS | GENERAL DESCRIPTION | DEPTH - FEET |    |
|  |                      |                 |                     | FROM         | TO |
| BROWN  | SAND                 |                 |                     | 0            | 9  |
| GREY   | SANDY GRAVEL         | BOULDERS        |                     | 9            | 57 |
| GREY   | LIMESTONE            | SHALE           |                     | 57           | 62 |

31 32

**41 WATER RECORD**

| WATER FOUND AT - FEET | KIND OF WATER                             |                                |                                  |                                   |                              |  |
|-----------------------|---|--------------------------------|----------------------------------|-----------------------------------|------------------------------|--|
| 60                    | <input checked="" type="checkbox"/> FRESH | <input type="checkbox"/> SALTY | <input type="checkbox"/> SULPHUR | <input type="checkbox"/> MINERALS | <input type="checkbox"/> GAS |  |
| 15-18                 | <input type="checkbox"/> FRESH            | <input type="checkbox"/> SALTY | <input type="checkbox"/> SULPHUR | <input type="checkbox"/> MINERALS | <input type="checkbox"/> GAS |  |
| 20-23                 | <input type="checkbox"/> FRESH            | <input type="checkbox"/> SALTY | <input type="checkbox"/> SULPHUR | <input type="checkbox"/> MINERALS | <input type="checkbox"/> GAS |  |
| 25-28                 | <input type="checkbox"/> FRESH            | <input type="checkbox"/> SALTY | <input type="checkbox"/> SULPHUR | <input type="checkbox"/> MINERALS | <input type="checkbox"/> GAS |  |
| 30-33                 | <input type="checkbox"/> FRESH            | <input type="checkbox"/> SALTY | <input type="checkbox"/> SULPHUR | <input type="checkbox"/> MINERALS | <input type="checkbox"/> GAS |  |

**51 CASING & OPEN HOLE RECORD**

| INSIDE DIAM INCHES | MATERIAL  | WALL THICKNESS INCHES | DEPTH - FEET |    |
|--------------------|---|-----------------------|--------------|----|
|                    |   |                       | FROM         | TO |
| 6 1/4"             | 1 <input checked="" type="checkbox"/> STEEL<br>2 <input type="checkbox"/> GALVANIZED<br>3 <input type="checkbox"/> CONCRETE<br>4 <input type="checkbox"/> OPEN HOLE<br>5 <input type="checkbox"/> PLASTIC | .188                  | 0            | 59 |
| 6"                 | 1 <input type="checkbox"/> STEEL<br>2 <input type="checkbox"/> GALVANIZED<br>3 <input type="checkbox"/> CONCRETE<br>4 <input type="checkbox"/> OPEN HOLE<br>5 <input type="checkbox"/> PLASTIC            |                       | 59           | 62 |

**SCREEN**

| SIZE(S) OF OPENING (SLOT NO.) | DIAMETER INCHES | LENGTH FEET |
|-------------------------------|-----------------|-------------|
|                               |                 |             |

**61 PLUGGING & SEALING RECORD**

| DEPTH SET AT - FEET | MATERIAL AND TYPE (CEMENT GROUT LEAD PACKER, ETC.) |
|---------------------|--|
| 0-59                | CEMENT GROUT & BENTONITE SLURRY (Pressure grouted) |


**71 PUMPING TEST**

PUMPING TEST METHOD:  PUMP  BAILER  
PUMPING RATE: 40+ GPM  
DURATION OF PUMPING: 0 HOURS 45 MINS

| STATIC LEVEL | WATER LEVEL END OF PUMPING | WATER LEVELS DURING |         |         |        |
|--------------|----------------------------|---------------------|---------|---------|--------|
| 10 FEET      | 40 FEET                    | 40 FEET             | 40 FEET | 40 FEET | — FEET |

IF FLOWING, GIVE RATE: — GPM  
PUMP INTAKE SET AT: 40 FEET  
WATER AT END OF TEST: 1  CLEAR 2  CLOUDY

RECOMMENDED PUMP TYPE:  SHALLOW  DEEP  
RECOMMENDED PUMP SETTING: 40 FEET  
RECOMMENDED PUMPING RATE: 40 GPM

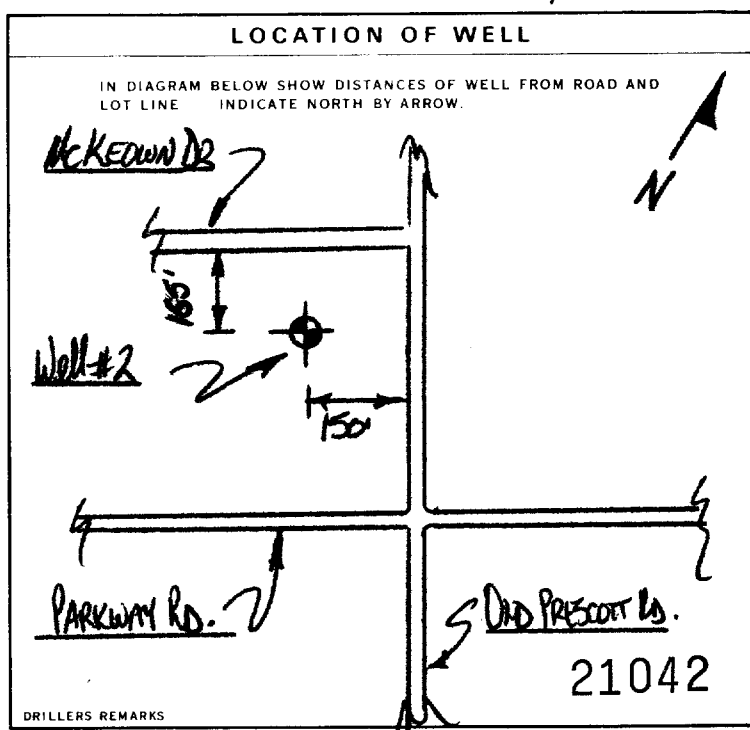

**FINAL STATUS OF WELL**

1  WATER SUPPLY  
2  OBSERVATION WELL  
3  TEST HOLE  
4  RECHARGE WELL

5  ABANDONED, INSUFFICIENT SUPPLY  
6  ABANDONED, POOR QUALITY  
7  UNFINISHED  
9  DEWATERING

**WATER USE**

1  DOMESTIC  
2  STOCK  
3  IRRIGATION  
4  INDUSTRIAL  
5  OTHER

6  COMMERCIAL  
8  MUNICIPAL  
7  PUBLIC SUPPLY  
9  COOLING OR AIR CONDITIONING  
9  NOT USED

**METHOD OF CONSTRUCTION**

1  CABLE TOOL  
2  ROTARY (CONVENTIONAL)  
3  ROTARY (REVERSE)  
4  ROTARY (AIR)  
5  AIR PERCUSSION

6  BORING  
7  DIAMOND  
8  JETTING  
9  DRIVING  
9  DIGGING  
9  OTHER

**CONTRACTOR**

NAME OF WELL CONTRACTOR: STANTON DRILLING INC  
ADDRESS: BOX 429, GREEZY, ONT.  
WELL CONTRACTOR'S LICENCE NUMBER: 4875

NAME OF WELL TECHNICIAN: PETER VA STANTON  
WELL TECHNICIAN'S LICENCE NUMBER: 710066

SIGNATURE OF TECHNICIAN / CONTRACTOR: [Signature]  
SUBMISSION DATE: DAY 26 MO 04 YR 88

**OFFICE USE ONLY**

DATA SOURCE: 58 CONTRACTOR: 4875  
DATE RECEIVED: JUN 21 1988

DATE OF INSPECTION: \_\_\_\_\_  
INSPECTOR: \_\_\_\_\_

REMARKS: \_\_\_\_\_



1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11

1522348

MUNICIPALITY 15009

CON. 15 22 23 24

COUNTY OR DISTRICT: **OTTAWA-CARLETON** TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE: **TWP. OF OSGOODE** CON. BLOCK TRACT. SURVEY ETC.: **CONCESSION 4** LOT: **5**

OWNER (SURNAME FIRST): **DONWEL CONSTRUCTION** ADDRESS: **6975 SHADOW RIDGE, GREELY.** DATE COMPLETED: DAY **19** MO **04** YR **88**

21 ZONE EASTING NORTHING RC ELEVATION RC BASIN CODE II III IV

| GENERAL COLOUR | MOST COMMON MATERIAL | OTHER MATERIALS | GENERAL DESCRIPTION | DEPTH - FEET |    |
|----------------|----------------------|-----------------|---------------------|--------------|----|
|                |                      |                 |                     | FROM         | TO |
| BROWN          | SAND                 |                 |                     | 0            | 9  |
| GREY           | SAND + GRAVEL        | BOULDERS        |                     | 9            | 57 |
| GREY           | LIMESTONE            | SHALE           |                     | 57           | 62 |

31 32

**41 WATER RECORD**

| WATER FOUND AT - FEET | KIND OF WATER   |   |  |
|-----------------------|---|---|--|
| 60                    | <input checked="" type="checkbox"/> FRESH<br><input type="checkbox"/> SALTY | <input type="checkbox"/> SULPHUR<br><input type="checkbox"/> MINERALS<br><input type="checkbox"/> GAS |  |
| 15-18                 | <input type="checkbox"/> FRESH<br><input type="checkbox"/> SALTY            | <input type="checkbox"/> SULPHUR<br><input type="checkbox"/> MINERALS<br><input type="checkbox"/> GAS |  |
| 20-23                 | <input type="checkbox"/> FRESH<br><input type="checkbox"/> SALTY            | <input type="checkbox"/> SULPHUR<br><input type="checkbox"/> MINERALS<br><input type="checkbox"/> GAS |  |
| 25-28                 | <input type="checkbox"/> FRESH<br><input type="checkbox"/> SALTY            | <input type="checkbox"/> SULPHUR<br><input type="checkbox"/> MINERALS<br><input type="checkbox"/> GAS |  |
| 30-33                 | <input type="checkbox"/> FRESH<br><input type="checkbox"/> SALTY            | <input type="checkbox"/> SULPHUR<br><input type="checkbox"/> MINERALS<br><input type="checkbox"/> GAS |  |

**51 CASING & OPEN HOLE RECORD**

| INSIDE DIAM. INCHES | MATERIAL  | WALL THICKNESS INCHES | DEPTH - FEET |    |
|---------------------|---|-----------------------|--------------|----|
|                     |   |                       | FROM         | TO |
| 6 1/4"              | <input checked="" type="checkbox"/> STEEL<br><input type="checkbox"/> GALVANIZED<br><input type="checkbox"/> CONCRETE<br><input type="checkbox"/> OPEN HOLE<br><input type="checkbox"/> PLASTIC | 1/8"                  | 0            | 59 |
| 6"                  | <input type="checkbox"/> STEEL<br><input type="checkbox"/> GALVANIZED<br><input type="checkbox"/> CONCRETE<br><input type="checkbox"/> OPEN HOLE<br><input type="checkbox"/> PLASTIC            |                       | 59           | 62 |

**SCREEN**

| SIZE(S) OF OPENING (SLOT NO.) | DIAMETER | LENGTH |
|-------------------------------|----------|--------|
|                               | INCHES   | FEET   |
|                               |          | 41-44  |
|                               |          | FEET   |

MATERIAL AND TYPE: \_\_\_\_\_ DEPTH TO TOP OF SCREEN: \_\_\_\_\_

**61 PLUGGING & SEALING RECORD**

| DEPTH SET AT - FEET | MATERIAL AND TYPE (CEMENT GROUT, LEAD PACKER, ETC.) |
|---------------------|---|
| 0-13                | Cement Grout &                                      |
| 13-17               | BENTONITE SLURRY                                    |
| 18-21               | (Pressure grouted)                                  |
| 22-25               |   |
| 26-28               |   |
| 30-33               |   |

**71 PUMPING TEST**

PUMPING TEST METHOD:  PUMP  BAILER

PUMPING RATE: **40+** GPM

DURATION OF PUMPING: **1** HOURS **0** MINS

| STATIC LEVEL | WATER LEVEL END OF PUMPING | WATER LEVELS DURING |                |                |                |
|--------------|----------------------------|---------------------|----------------|----------------|----------------|
| 10           | 40                         | 15 MINUTES: 40      | 30 MINUTES: 40 | 45 MINUTES: 40 | 60 MINUTES: 40 |

IF FLOWING, GIVE RATE: \_\_\_\_\_ GPM


PUMP INTAKE SET AT: **40** FEET

WATER AT END OF TEST: **40** FEET

RECOMMENDED PUMP TYPE:  SHALLOW  DEEP

RECOMMENDED PUMP SETTING: **40** FEET

RECOMMENDED PUMPING RATE: **640** GPM

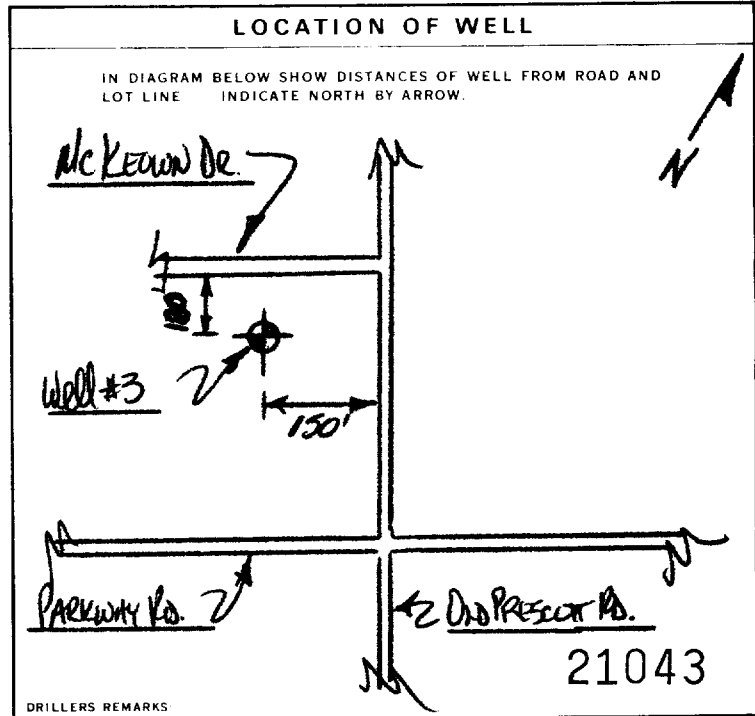

**FINAL STATUS OF WELL**

WATER SUPPLY  ABANDONED, INSUFFICIENT SUPPLY  
 OBSERVATION WELL  ABANDONED, POOR QUALITY  
 TEST HOLE  UNFINISHED  
 RECHARGE WELL  DEWATERING

**WATER USE**

DOMESTIC  COMMERCIAL  
 STOCK  MUNICIPAL  
 IRRIGATION  PUBLIC SUPPLY  
 INDUSTRIAL  COOLING OR AIR CONDITIONING  
 OTHER \_\_\_\_\_  NOT USED

**METHOD OF CONSTRUCTION**

CABLE TOOL  BORING  
 ROTARY (CONVENTIONAL)  DIAMOND  
 ROTARY (REVERSE)  JETTING  
 ROTARY (AIR)  DRIVING  
 AIR PERCUSSION  DIGGING  OTHER \_\_\_\_\_

**CONTRACTOR**

NAME OF WELL CONTRACTOR: **STANTON DRILLING INC** WELL CONTRACTOR'S LICENSE NUMBER: **4875**

ADDRESS: **BOX 429, GREELY, ONT.**

NAME OF WELL TECHNICIAN: **PETER VA STANTON** WELL TECHNICIAN'S LICENSE NUMBER: **7-0006**

SIGNATURE OF TECHNICIAN/CONTRACTOR: \_\_\_\_\_ SUBMISSION DATE: DAY **16** MO **04** YR **88**

**OFFICE USE ONLY**

DATE RECEIVED: **JUN 21 1988**

CONTRACTOR: **4875**

DATE OF INSPECTION: \_\_\_\_\_ INSPECTOR: \_\_\_\_\_

REMARKS: \_\_\_\_\_

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

11

1529728

Municipality 15009 Con. CON 14

County or District: [Redacted] Township/Borough/City/Town/Village: **Osgoode** Con block tract survey, etc.: **4** Lot: **5**  
Address: **P.O. Box 124 Greely Ontario K4P 1N4** Date completed: **23** day **10** month **97** year

| General colour | Most common material     | Other materials | General description | Depth - feet |    |
|----------------|--------------------------|-----------------|---------------------|--------------|----|
|                |                          |                 |                     | From         | To |
| Brown          | Soil                     |                 | Loose Fill          | 0            | 4  |
| Brown          | Clay                     |                 | Packed              | 4            | 9  |
| Gray           | Clay                     |                 | Sticky              | 9            | 34 |
| Gray           | Sand, Gravel, & Boulders |                 |                     | 34           | 51 |
| Gray           | Limestone                |                 | Layered             | 51           | 62 |
| Gray           | Limestone                |                 | Medium              | 62           | 76 |

31 [Scale] 32 [Scale]

**41 WATER RECORD**

Water found at - feet: **56-62** Kind of water: **NOT TESTED**

10-13 1  Fresh 3  Sulphur 14   
 2  Salty 4  Minerals 15-18  Gas  
 15-18 1  Fresh 3  Sulphur 19   
 2  Salty 4  Minerals 20-23  Gas  
 20-23 1  Fresh 3  Sulphur 24   
 2  Salty 4  Minerals 25-28  Gas  
 25-28 1  Fresh 3  Sulphur 29   
 2  Salty 4  Minerals 30-33  Gas  
 30-33 1  Fresh 3  Sulphur 34   
 2  Salty 4  Minerals 35  Gas

**51 CASING & OPEN HOLE RECORD**

| Inside diam inches | Material   | Wall thickness inches | Depth - feet |    |
|--------------------|------------|-----------------------|--------------|----|
|                    |            |                       | From         | To |
| 6 1/4              | Steel      | .188                  | 0            | 54 |
| 6 1/8              | Galvanized |                       | 54           | 76 |

**SCREEN**

Sizes of opening (Slot No.): 31-33 Diameter: 34-38 Length: 39-40  
 Material and type: 41-44 Depth at top of screen: 45-49

**61 PLUGGING & SEALING RECORD**

Annular space  Abandonment

Depth set at - feet: 10-13 14-17 20-23 24-27 28-31 32-35 36-39 40-43 44-47 48-51 52-55 56-59 60-63 64-67 68-71 72-75 76-79 80-83 84-87 88-91 92-95 96-99 100-103


Material and type (Cement grout, bentonite, etc.):  
 52-21 34 Bentonite (6)  
 34 0 Cement (10)

**71 PUMPING TEST**

Pumping test method:  Pump  Bailer Pumping rate: **50** GPM Duration of pumping: **1** Hours **1** Mins

Static level: **5.8** feet Water level end of pumping: **20** feet  
 Water levels during: 15 minutes: **7.6** feet 30 minutes: **6.1** feet 45 minutes: **5.8** feet 60 minutes: **5.8** feet

Recommended pump type:  Shallow  Deep Recommended pump setting: **35** feet Recommended pump rate: **5** GPM

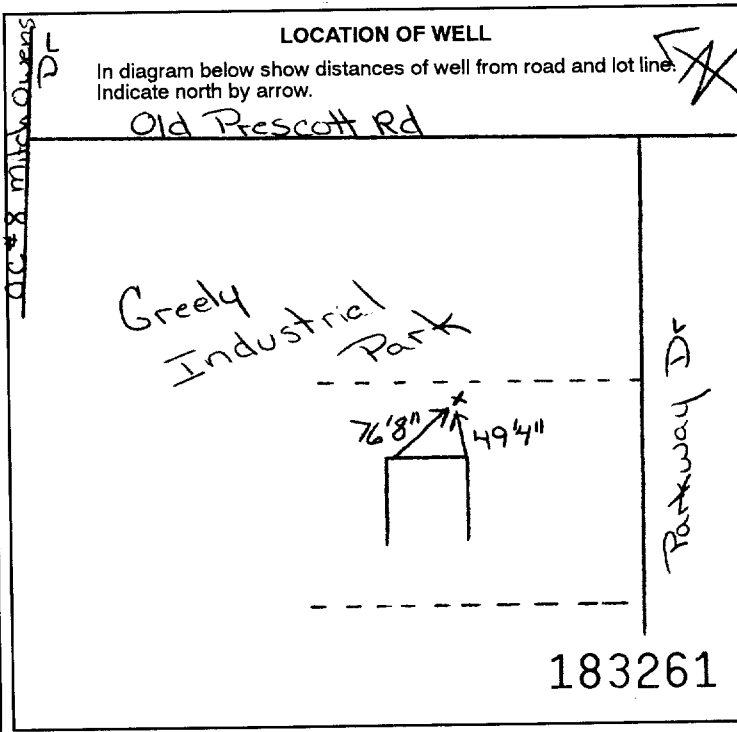

**FINAL STATUS OF WELL**

1  Water supply 5  Abandoned, insufficient supply 9  Unfinished  
 2  Observation well 6  Abandoned, poor quality 10  Replacement well  
 3  Test hole 7  Abandoned (Other)  
 4  Recharge well 8  Dewatering

**WATER USE**

1  Domestic 5  Commercial 9  Not used  
 2  Stock 6  Municipal 10  Other  
 3  Irrigation 7  Public supply  
 4  Industrial 8  Cooling & air conditioning

**METHOD OF CONSTRUCTION**

1  Cable tool 5  Air percussion 9  Driving  
 2  Rotary (conventional) 6  Boring 10  Digging  
 3  Rotary (reverse) 7  Diamond 11  Other  
 4  Rotary (air) 8  Jetting

Name of Well Contractor: **Capital Water Supply Ltd.** Well Contractor's Licence No.: **1558**  
 Address: **P.O. Box 490 Stittsville, Ontario K2S 1A6**  
 Name of Well Technician: **S. Miller** Well Technician's Licence No.: **T0097**  
 Signature of Technician/Contractor: [Signature] Submission date: **24** day **10** mo **97** yr

**MINISTRY USE ONLY**

Data source: **1558** Date received: **DEC 22 1997**  
 Date of inspection: Inspector: [Signature]  
 Remarks: [Signature]

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

11

1531816

Municipality 15009

Con. CAN 04 Part of

County or District: **Ottawa-Carleton** Township/Borough/City/Town/Village: **Osgoode** Con block tract survey, etc.: **4** Lot: **304**  
Address: **Grey St** Date completed: **07 22 01**  
Basin Code: ii iii iv

**LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)**

| General colour | Most common material | Other materials | General description | Depth - feet |     |
|----------------|----------------------|-----------------|---------------------|--------------|-----|
|                |                      |                 |                     | From         | To  |
|                | Sand                 | boulders        |                     | 0            | 35  |
| grey           | limestone            |                 |                     | 35           | 142 |
| grey           | sandstone            |                 |                     | 142          | 240 |

31 32

**41 WATER RECORD**

| Water found at - feet | Kind of water  |
|-----------------------|--|
| 89                    | 1 <input checked="" type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty 3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 5 <input type="checkbox"/> Gas |
| 237                   | 1 <input checked="" type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty 3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 5 <input type="checkbox"/> Gas |
|                       | 1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty 3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 5 <input type="checkbox"/> Gas            |
|                       | 1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty 3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 5 <input type="checkbox"/> Gas            |
|                       | 1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty 3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 5 <input type="checkbox"/> Gas            |

**51 CASING & OPEN HOLE RECORD**

| Inside diam inches | Material  | Wall thickness inches | Depth - feet |     |
|--------------------|---|-----------------------|--------------|-----|
|                    |   |                       | From         | To  |
| 6 1/4              | 1 <input checked="" type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic | 188                   | 0            | 44  |
| 8 3/4              | 1 <input type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic |                       | 0            | 42  |
| 6                  | 1 <input type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic |                       | 42           | 240 |

**SCREEN**

| Sizes of opening (Slot No.) | Diameter inches | Length feet |
|-----------------------------|-----------------|-------------|
|                             |                 |             |


Material and type: \_\_\_\_\_ Depth at top of screen: \_\_\_\_\_ feet

**61 PLUGGING & SEALING RECORD**

| Depth set at - feet | Material and type (Cement grout, bentonite, etc.) |
|---------------------|---|
| 2 1/3               | 44 1/2 Cement grout                               |
| 18-21               | 22-25 Bentonite                                   |
| 26-29               | 30-33 80  |

**71 PUMPING TEST**

| Pumping test method  | Pumping rate                         | Duration of pumping              |
|--|--------------------------------------|----------------------------------|
| 1 <input checked="" type="checkbox"/> Pump 2 <input type="checkbox"/> Bailor                     | 5 GPM                                | 1 Hours 17-18 Mins               |
| Static level: 35 feet  | Water level end of pumping: 220 feet | Water levels during:             |
|  |                                      | 15 minutes: 160 feet             |
|  |                                      | 30 minutes: 101 feet             |
|  |                                      | 45 minutes: 41 feet              |
|  |                                      | 60 minutes: 35 feet              |
| If flowing give rate: _____ GPM  | Pump intake set at: _____ feet       | Water at end of test: _____ feet |
| Recommended pump type: <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep | Recommended pump setting: 220 feet   | Recommended pump rate: 5 GPM     |

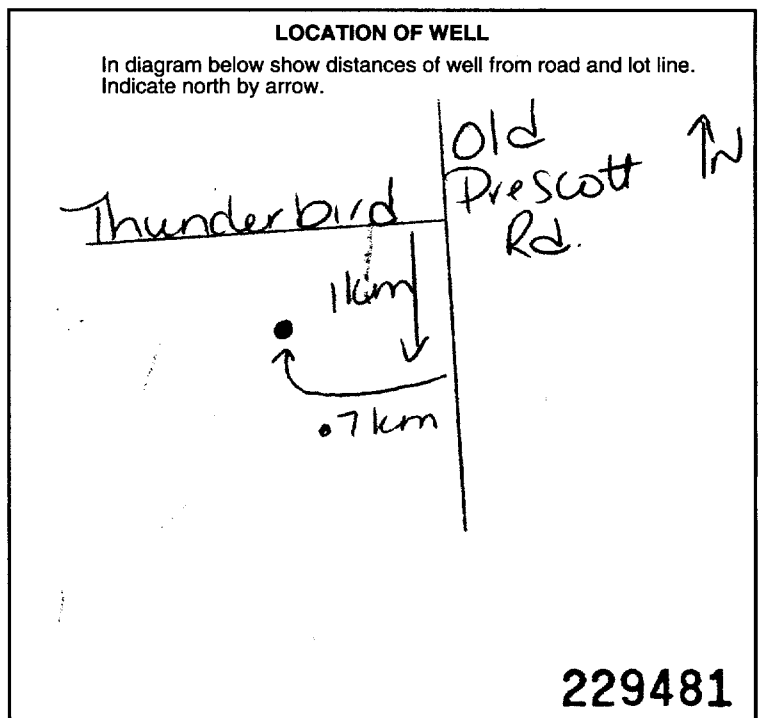

**FINAL STATUS OF WELL**

|  |   |  |
|--|---|--|
| 1 <input checked="" type="checkbox"/> Water supply | 5 <input type="checkbox"/> Abandoned, insufficient supply | 9 <input type="checkbox"/> Unfinished        |
| 2 <input type="checkbox"/> Observation well        | 6 <input type="checkbox"/> Abandoned, poor quality        | 10 <input type="checkbox"/> Replacement well |
| 3 <input type="checkbox"/> Test hole               | 7 <input type="checkbox"/> Abandoned (Other)              |  |
| 4 <input type="checkbox"/> Recharge well           | 8 <input type="checkbox"/> Dewatering                     |  |

**WATER USE**

|  |   |                                    |
|--|---|------------------------------------|
| 1 <input checked="" type="checkbox"/> Domestic | 5 <input type="checkbox"/> Commercial                 | 9 <input type="checkbox"/> Not use |
| 2 <input type="checkbox"/> Stock               | 6 <input type="checkbox"/> Municipal                  | 10 <input type="checkbox"/> Other  |
| 3 <input type="checkbox"/> Irrigation          | 7 <input type="checkbox"/> Public supply              |                                    |
| 4 <input type="checkbox"/> Industrial          | 8 <input type="checkbox"/> Cooling & air conditioning |                                    |

**METHOD OF CONSTRUCTION**

|  |  |                                     |
|--|--|-------------------------------------|
| 1 <input type="checkbox"/> Cable tool            | 5 <input checked="" type="checkbox"/> Air percussion | 9 <input type="checkbox"/> Driving  |
| 2 <input type="checkbox"/> Rotary (conventional) | 6 <input type="checkbox"/> Boring                    | 10 <input type="checkbox"/> Digging |
| 3 <input type="checkbox"/> Rotary (reverse)      | 7 <input type="checkbox"/> Diamond                   | 11 <input type="checkbox"/> Other   |
| 4 <input type="checkbox"/> Rotary (air)          | 8 <input type="checkbox"/> Jetting                   |                                     |

Name of Well Contractor: **Ar Koch Drilling Ltd** Well Contractor's Licence No.: **1119**  
Address: **RR #2 Jasper, Ont**  
Name of Well Technician: **Shannon Purcell** Well Technician's Licence No.: **12122**  
Signature of Technician/Contractor: \_\_\_\_\_ Submission date: **28 02 01**

**MINISTRY USE ONLY**

| Data source        | Contractor  | Date received      |
|--------------------|-------------|--------------------|
|                    | <b>1119</b> | <b>APR 18 2001</b> |
| Date of inspection | Inspector   |                    |
| Remarks            |             | <b>CSS.ES1</b>     |

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

11

1531817

Municipality  
15009

Con.  
CON

04

County or District: Ottawa Carleton Township/Borough/City/Town/Village: Osgoode Con. block tract survey, etc.: 4 Lot: 394  
 Owner's surname: Sunset Lakes First Name: \_\_\_\_\_ Address: Greely, Ont Date completed: 08 day 02 month 01 year

21 Zone Easting Northing RC Elevation RC Basin Code ii iii iv

| LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions) |                      |                 |                     |              |           |
|--|----------------------|-----------------|---------------------|--------------|-----------|
| General colour   | Most common material | Other materials | General description | Depth - feet |           |
|  |                      |                 |                     | From         | To        |
|  | <u>sand</u>          | <u>boulders</u> |                     | <u>0</u>     | <u>44</u> |
| <u>grey</u>  | <u>limestone</u>     |                 |                     | <u>44</u>    | <u>80</u> |
|  |                      |                 |                     |              |           |
|  |                      |                 |                     |              |           |
|  |                      |                 |                     |              |           |
|  |                      |                 |                     |              |           |
|  |                      |                 |                     |              |           |
|  |                      |                 |                     |              |           |
|  |                      |                 |                     |              |           |
|  |                      |                 |                     |              |           |
|  |                      |                 |                     |              |           |
|  |                      |                 |                     |              |           |

31 \_\_\_\_\_  
32 \_\_\_\_\_


| 41 WATER RECORD       |   |                                  |                                   |                              |  |
|-----------------------|---|----------------------------------|-----------------------------------|------------------------------|--|
| Water found at - feet | Kind of water                             |                                  |                                   |                              |  |
| <u>69</u>             | <input checked="" type="checkbox"/> Fresh | <input type="checkbox"/> Sulphur | <input type="checkbox"/> Minerals | <input type="checkbox"/> Gas |  |
| <u>73</u>             | <input checked="" type="checkbox"/> Fresh | <input type="checkbox"/> Sulphur | <input type="checkbox"/> Minerals | <input type="checkbox"/> Gas |  |
|                       | <input type="checkbox"/> Salty            | <input type="checkbox"/> Sulphur | <input type="checkbox"/> Minerals | <input type="checkbox"/> Gas |  |
|                       | <input type="checkbox"/> Salty            | <input type="checkbox"/> Sulphur | <input type="checkbox"/> Minerals | <input type="checkbox"/> Gas |  |
|                       | <input type="checkbox"/> Salty            | <input type="checkbox"/> Sulphur | <input type="checkbox"/> Minerals | <input type="checkbox"/> Gas |  |
|                       | <input type="checkbox"/> Salty            | <input type="checkbox"/> Sulphur | <input type="checkbox"/> Minerals | <input type="checkbox"/> Gas |  |

| 51 CASING & OPEN HOLE RECORD |   |                       |              |           |  |
|------------------------------|---|-----------------------|--------------|-----------|--|
| Inside diam inches           | Material                                  | Wall thickness inches | Depth - feet |           |  |
|                              |   |                       | From         | To        |  |
| <u>6 1/4</u>                 | <input checked="" type="checkbox"/> Steel | <u>188</u>            | <u>0</u>     | <u>53</u> |  |
| <u>8 3/4</u>                 | <input type="checkbox"/> Galvanized       |                       | <u>0</u>     | <u>51</u> |  |
| <u>6</u>                     | <input type="checkbox"/> Concrete         |                       | <u>51</u>    | <u>80</u> |  |
|                              | <input type="checkbox"/> Open hole        |                       |              |           |  |
|                              | <input type="checkbox"/> Plastic          |                       |              |           |  |

| SCREEN | Sizes of opening (Slot No.) | Diameter | Length                 |
|--------|-----------------------------|----------|------------------------|
|        |                             | inches   | feet                   |
|        |                             |          |                        |
|        | Material and type           |          | Depth at top of screen |
|        |                             |          | feet                   |

| 61 PLUGGING & SEALING RECORD   |              |   |  |
|--|--------------|---|--|
| <input checked="" type="checkbox"/> Annular space <input type="checkbox"/> Abandonment |              |   |  |
| Depth set at - feet  |              | Material and type (Cement grout, bentonite, etc.) |  |
| From   | To           |   |  |
| <u>2</u>   | <u>53</u>    | <u>Cement grout</u>                               |  |
| <u>18-21</u>   | <u>22-25</u> | <u>Bentonite</u>                                  |  |
| <u>26-29</u>   | <u>30-33</u> |   |  |

| 71 PUMPING TEST   |                            |   |                |                |                |
|---|----------------------------|---|----------------|----------------|----------------|
| Pumping test method   | Pumping rate               | Duration of pumping   |                |                |                |
| <input checked="" type="checkbox"/> Pump <input type="checkbox"/> Bailor  | <u>45</u> GPM              | Hours: <u>1</u> Mins: _____   |                |                |                |
| Static level  | Water level end of pumping | Water levels during   |                |                |                |
| <u>12</u> feet  | <u>70</u> feet             | 15 minutes  | 30 minutes     | 45 minutes     | 60 minutes     |
|   |                            | <u>12</u> feet  | <u>12</u> feet | <u>12</u> feet | <u>12</u> feet |
| If flowing give rate  | Pump intake set at         | Water at end of test  |                |                |                |
| GPM   | feet                       | <input type="checkbox"/> Clear <input checked="" type="checkbox"/> Cloudy |                |                |                |
| Recommended pump type   | Recommended pump setting   | Recommended pump rate   |                |                |                |
| <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep | <u>70</u> feet             | <u>12</u> GPM   |                |                |                |

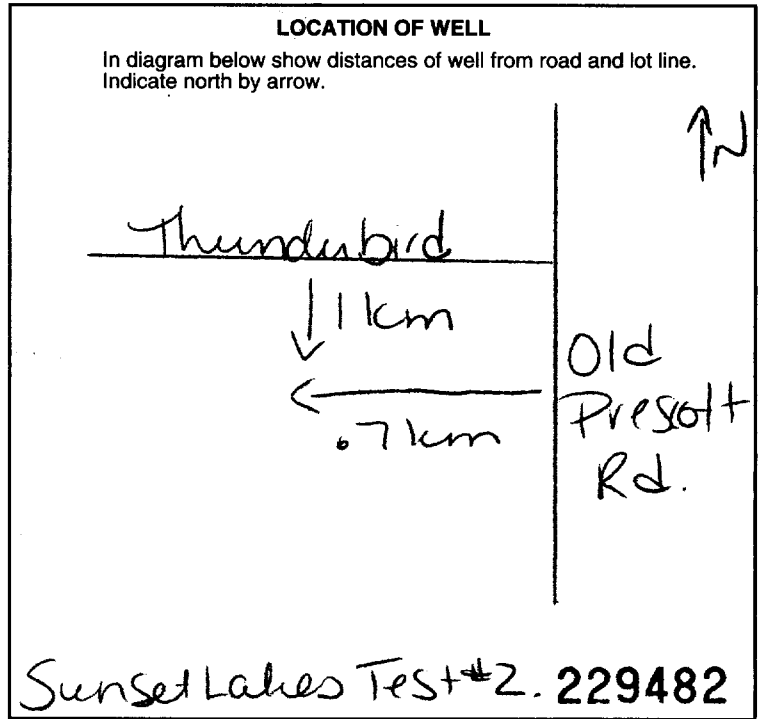

| FINAL STATUS OF WELL                             |   |   |  |  |  |
|--|---|---|--|--|--|
| <input checked="" type="checkbox"/> Water supply | <input type="checkbox"/> Abandoned, insufficient supply | <input type="checkbox"/> Unfinished       |  |  |  |
| <input type="checkbox"/> Observation well        | <input type="checkbox"/> Abandoned, poor quality        | <input type="checkbox"/> Replacement well |  |  |  |
| <input type="checkbox"/> Test hole               | <input type="checkbox"/> Abandoned (Other)              |   |  |  |  |
| <input type="checkbox"/> Recharge well           | <input type="checkbox"/> Dewatering                     |   |  |  |  |

| WATER USE                                    |   |                                  |  |  |  |
|--|---|----------------------------------|--|--|--|
| <input checked="" type="checkbox"/> Domestic | <input type="checkbox"/> Commercial                 | <input type="checkbox"/> Not use |  |  |  |
| <input type="checkbox"/> Stock               | <input type="checkbox"/> Municipal                  | <input type="checkbox"/> Other   |  |  |  |
| <input type="checkbox"/> Irrigation          | <input type="checkbox"/> Public supply              |                                  |  |  |  |
| <input type="checkbox"/> Industrial          | <input type="checkbox"/> Cooling & air conditioning |                                  |  |  |  |

| METHOD OF CONSTRUCTION                         |  |                                  |  |  |  |
|--|--|----------------------------------|--|--|--|
| <input type="checkbox"/> Cable tool            | <input checked="" type="checkbox"/> Air percussion | <input type="checkbox"/> Driving |  |  |  |
| <input type="checkbox"/> Rotary (conventional) | <input type="checkbox"/> Boring                    | <input type="checkbox"/> Digging |  |  |  |
| <input type="checkbox"/> Rotary (reverse)      | <input type="checkbox"/> Diamond                   | <input type="checkbox"/> Other   |  |  |  |
| <input type="checkbox"/> Rotary (air)          | <input type="checkbox"/> Jetting                   |                                  |  |  |  |

Name of Well Contractor: Art Koch Dr. Wngltd Well Contractor's Licence No.: 1119  
 Address: Rt #2 Jasper Ont  
 Name of Well Technician: Shannon Purcell Well Technician's Licence No.: T2122  
 Signature of Technician/Contractor: \_\_\_\_\_ Submission date: 02 day 01 month 01 year

MINISTRY USE ONLY  
 Data source: 1119 Date received: APR 18 2001  
 Date of inspection: \_\_\_\_\_ Inspector: \_\_\_\_\_  
 Remarks: \_\_\_\_\_  
 CSS.ES1

Print only in spaces provided. Mark correct box with a checkmark, where applicable.

11

1532070

Municipality 15009

Con. 10 14 15 22 23 24

County or District: Ottawa Carleton; Township/Borough/City/Town/Village: Osgoode; Address: Greely Lane Greely ONT; Date completed: 06 12 2000

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions). Table with columns: General colour, Most common material, Other materials, General description, Depth - feet (From, To). Rows: Brown sand with some stones (0-5'), Grey clay with some stones (5'-39'), Grey gravel course (39'-60').

31, 32


41 WATER RECORD. Table with columns: Water found at - feet, Kind of water. Rows: 55' (untested), 20-23, 25-28, 30-33.

51 CASING & OPEN HOLE RECORD. Table with columns: Inside diam inches, Material, Wall thickness inches, Depth - feet (From, To). Rows: 8" (0-20'), 6" (2'-57'), 6" (57'-60').

54 SCREEN. Table with columns: Sizes of opening (Slot No.), Diameter, Length, Material and type, Depth at top of screen. Values: 35 slot, 5" diameter, 4' length, stainless steel, 55' depth.

61 PLUGGING & SEALING RECORD. Table with columns: Depth set at - feet (From, To), Material and type. Values: 20' to 0', 8 bags high early.

71 PUMPING TEST. Table with columns: Pumping test method, Pumping rate, Duration of pumping, Static level, Water level end of pumping, Water levels during, Pump intake set at, Water at end of test, Recommended pump type, Recommended pump setting, Recommended pump rate.

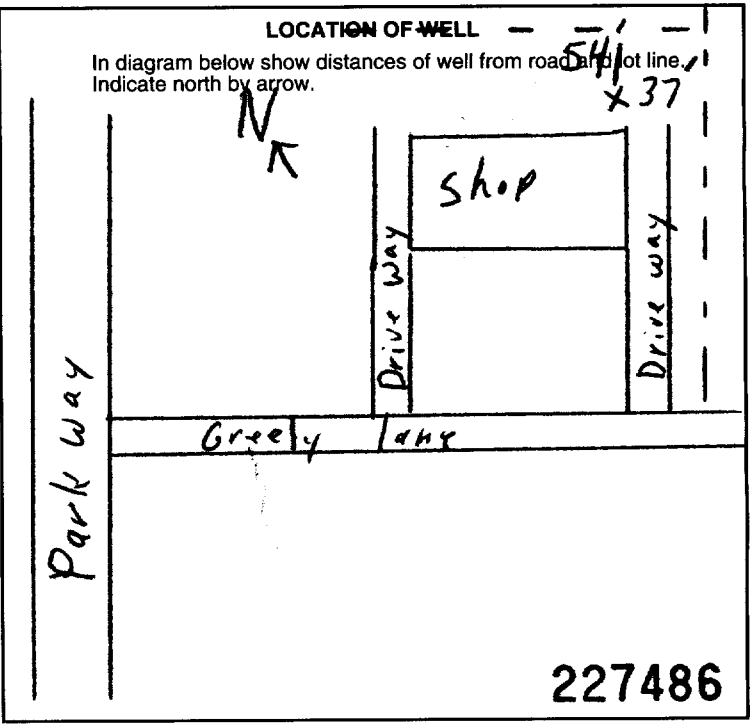

FINAL STATUS OF WELL, WATER USE, METHOD OF CONSTRUCTION. Final status: 1 Water supply, 2 Observation well, 3 Test hole, 4 Recharge well, 5 Abandoned, insufficient supply, 6 Abandoned, poor quality, 7 Abandoned (Other), 8 Dewatering, 9 Unfinished, 10 Replacement well. Water use: 5 Commercial, 6 Municipal, 7 Public supply, 8 Cooling & air conditioning. Method of construction: 1 Cable tool, 2 Rotary (conventional), 3 Rotary (reverse), 4 Rotary (air), 5 Air percussion, 6 Boring, 7 Diamond, 8 Jetting, 9 Driving, 10 Digging, 11 Other.

Name of Well Contractor: Olympic Drilling Co. Ltd.; Well Contractor's Licence No.: 4006; Address: 2320 SCRIVENS RD. METCALFE ONT.; Name of Well Technician: Wayne Renwick; Well Technician's Licence No.: 327; Signature of Technician/Contractor: Wayne Renwick; Submission date.

MINISTRY USE ONLY. Data source: 4006; Date received: JUL 17 2001; Date of inspection; Inspector; Remarks; OSS.ES1.

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

11

1533428

Municipality 15009 Con. CON 04

|   |  |   |                 |
|---|--|---|-----------------|
| County or District<br><b>Ottawa-Carleton</b>                | Township/Borough/City/Town/Village<br><b>Osgoode</b> | Con block tract survey, etc.<br><b>4</b>                    | Lot<br><b>5</b> |
| Address<br><b>1545 River Road Maontick, Ontario K4M 1B4</b> |  | Date completed <b>27</b> day <b>11</b> month <b>02</b> year |                 |

**LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)**

| General colour | Most common material | Other materials | General description | Depth - feet |     |
|----------------|----------------------|-----------------|---------------------|--------------|-----|
|                |                      |                 |                     | From         | To  |
| Brown          | Sandy Soil           |                 |                     | 0            | 4   |
| Gray           | Sand & Gravel        |                 | Wet                 | 4            | 12  |
| Gray           | Sandy Clay           |                 |                     | 12           | 30  |
| Gray           | Sand, Gravel         | Boulders        | Wet                 | 30           | 58  |
| Gray           | Limestone            |                 |                     | 58           | 160 |
| Gray & White   | SANDstone            |                 |                     | 160          | 223 |

**41 WATER RECORD**

| Water found at - feet | Kind of water   |
|-----------------------|---|
| 10-13<br><b>216</b>   | <input type="checkbox"/> Fresh<br><input type="checkbox"/> Salty<br><input checked="" type="checkbox"/> NOT TESTED  |
| 15-18                 | <input type="checkbox"/> Fresh<br><input type="checkbox"/> Salty<br><input type="checkbox"/> Sulphur<br><input type="checkbox"/> Minerals<br><input type="checkbox"/> Gas |
| 20-23                 | <input type="checkbox"/> Fresh<br><input type="checkbox"/> Salty<br><input type="checkbox"/> Sulphur<br><input type="checkbox"/> Minerals<br><input type="checkbox"/> Gas |
| 25-28                 | <input type="checkbox"/> Fresh<br><input type="checkbox"/> Salty<br><input type="checkbox"/> Sulphur<br><input type="checkbox"/> Minerals<br><input type="checkbox"/> Gas |
| 30-33                 | <input type="checkbox"/> Fresh<br><input type="checkbox"/> Salty<br><input type="checkbox"/> Sulphur<br><input type="checkbox"/> Minerals<br><input type="checkbox"/> Gas |

**51 CASING & OPEN HOLE RECORD**

| Inside diam inches | Material                                      | Wall thickness inches | Depth - feet |                 |
|--------------------|---|-----------------------|--------------|-----------------|
|                    |   |                       | From         | To              |
| 6 1/4              | <input checked="" type="checkbox"/> Steel     | .188                  | + 1.5        | 65 <sup>6</sup> |
| 5 7/8              | <input checked="" type="checkbox"/> Open hole |                       | 65           | 223             |

**SCREEN RECORD**


| Sizes of opening (Slot No.) | Diameter inches | Length feet                 |
|-----------------------------|-----------------|-----------------------------|
|                             |                 |                             |
| Material and type           |                 | Depth at top of screen feet |

**61 PLUGGING & SEALING RECORD**

| <input checked="" type="checkbox"/> Annular space | <input type="checkbox"/> Abandonment              |
|---|---|
| Depth set at - feet                               | Material and type (Cement grout, bentonite, etc.) |
| 10-13<br><b>64</b>                                | <b>Grouted - Cement (1)</b>                       |
| 14-17<br><b>0</b>                                 | <b>Bentonite (3)</b>                              |

**71 PUMPING TEST**

|  |  |   |
|--|--|---|
| Pumping test method<br><input checked="" type="checkbox"/> Pump <input type="checkbox"/> Bailer    | Pumping rate<br><b>10</b> GPM                | Duration of pumping<br><b>1</b> Hours <b>17</b> Mins  |
| Static level<br><b>34'6"</b> feet  | Water level end of pumping<br><b>75</b> feet | Water levels during pumping   |
|  |  | 15 minutes <b>220</b> feet  |
|  |  | 30 minutes <b>175</b> feet  |
|  |  | 45 minutes <b>150</b> feet  |
|  |  | 60 minutes <b>75</b> feet   |
| If flowing give rate<br>GPM  | Pump intake set at<br>feet                   | Water at end of test<br><input type="checkbox"/> Clear <input checked="" type="checkbox"/> Cloudy |
| Recommended pump type<br><input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep | Recommended pump setting<br><b>150</b> feet  | Recommended pump rate<br><b>5</b> GPM   |

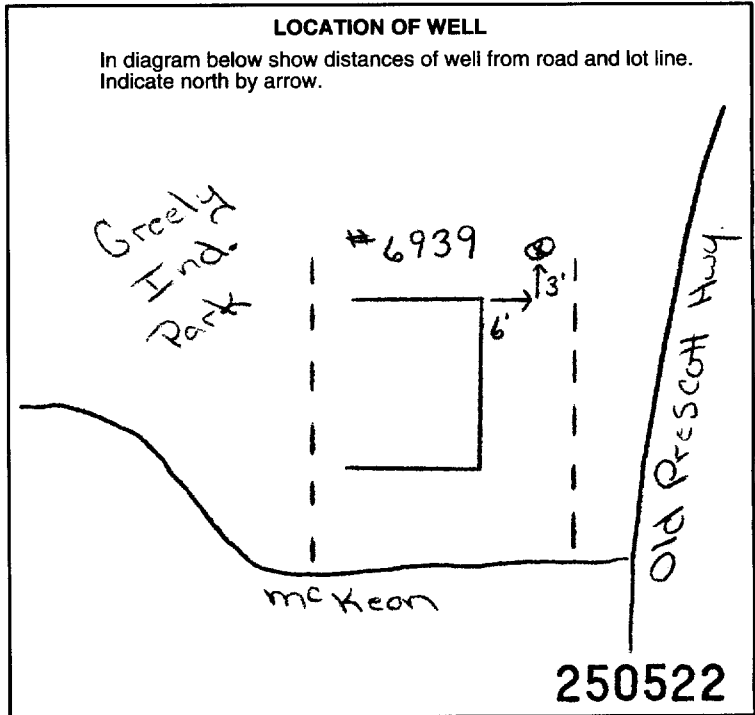

**FINAL STATUS OF WELL**

|  |   |   |
|--|---|---|
| <input checked="" type="checkbox"/> Water supply | <input type="checkbox"/> Abandoned, insufficient supply | <input type="checkbox"/> Unfinished       |
| <input type="checkbox"/> Observation well        | <input type="checkbox"/> Abandoned, poor quality        | <input type="checkbox"/> Replacement well |
| <input type="checkbox"/> Test hole               | <input type="checkbox"/> Abandoned (Other)              |   |
| <input type="checkbox"/> Recharge well           | <input type="checkbox"/> Dewatering                     |   |

**WATER USE**

|  |   |                                  |
|--|---|----------------------------------|
| <input checked="" type="checkbox"/> Domestic | <input type="checkbox"/> Commercial                 | <input type="checkbox"/> Not use |
| <input type="checkbox"/> Stock               | <input type="checkbox"/> Municipal                  | <input type="checkbox"/> Other   |
| <input type="checkbox"/> Irrigation          | <input type="checkbox"/> Public supply              |                                  |
| <input type="checkbox"/> Industrial          | <input type="checkbox"/> Cooling & air conditioning |                                  |

**METHOD OF CONSTRUCTION**

|  |  |                                  |
|--|--|----------------------------------|
| <input type="checkbox"/> Cable tool                  | <input checked="" type="checkbox"/> Air percussion | <input type="checkbox"/> Driving |
| <input type="checkbox"/> Rotary (conventional)       | <input type="checkbox"/> Boring                    | <input type="checkbox"/> Digging |
| <input type="checkbox"/> Rotary (reverse)            | <input type="checkbox"/> Diamond                   | <input type="checkbox"/> Other   |
| <input checked="" type="checkbox"/> Rotary (air) mud | <input type="checkbox"/> Jetting                   |                                  |

|   |  |
|---|--|
| Name of Well Contractor<br><b>Capital Water Supply Ltd</b>  | Well Contractor's Licence No.<br><b>1558</b>               |
| Address<br><b>P.O. Box 490 Stittsville, Ontario K2S 1A6</b> |  |
| Name of Well Technician<br><b>S. Miller</b>                 | Well Technician's Licence No.<br><b>T0097</b>              |
| Signature of Technician/Contractor                          | Submission date<br>day <b>29</b> mo <b>11</b> yr <b>02</b> |

**MINISTRY USE ONLY**

|                            |                           |                                     |
|----------------------------|---------------------------|-------------------------------------|
| Data source<br><b>1558</b> | Contractor<br><b>1558</b> | Date received<br><b>DEC 17 2002</b> |
| Date of inspection         | Inspector                 |                                     |
| Remarks<br><b>CCS.EC2</b>  |                           |                                     |

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

1533469

Municipality: 15009 CON  
Cov: OS  
Plan 4m389 Sublot 11

11

County or District: Ottawa-Carleton  
Township/Borough/City/Town/Village: Osgoode  
Con block tract survey, etc.: 5 Lot: 4  
Address: Greely, Ont  
Date completed: 13/12/02

21  
25-27  
48-53  
Northings  
RC  
Elevation  
RC  
Basin Code  
ii  
iii  
iv

| LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions) |                      |                   |                     |              |     |
|--|----------------------|-------------------|---------------------|--------------|-----|
| General colour   | Most common material | Other materials   | General description | Depth - feet |     |
|  |                      |                   |                     | From         | To  |
|  | sand                 | gravel & boulders |                     | 0            | 62  |
| grey   | limestone            |                   |                     | 62           | 188 |
| grey   | sandy limestone      |                   |                     | 188          | 227 |
| white-grey   | sandstone            |                   |                     | 227          | 333 |

31  
32


| 41 WATER RECORD       |   |   |    |
|-----------------------|---|---|----|
| Water found at - feet | Kind of water   |   |    |
| 10-13<br>330          | 1 <input type="checkbox"/> Fresh<br>2 <input checked="" type="checkbox"/> Salty | 3 <input type="checkbox"/> Sulphur<br>4 <input type="checkbox"/> Minerals<br>5 <input type="checkbox"/> Gas | 14 |
| 15-18                 | 1 <input type="checkbox"/> Fresh<br>2 <input checked="" type="checkbox"/> Salty | 3 <input type="checkbox"/> Sulphur<br>4 <input type="checkbox"/> Minerals<br>5 <input type="checkbox"/> Gas | 19 |
| 20-23                 | 1 <input type="checkbox"/> Fresh<br>2 <input type="checkbox"/> Salty            | 3 <input type="checkbox"/> Sulphur<br>4 <input type="checkbox"/> Minerals<br>5 <input type="checkbox"/> Gas | 24 |
| 25-28                 | 1 <input type="checkbox"/> Fresh<br>2 <input type="checkbox"/> Salty            | 3 <input type="checkbox"/> Sulphur<br>4 <input type="checkbox"/> Minerals<br>5 <input type="checkbox"/> Gas | 29 |
| 30-33                 | 1 <input type="checkbox"/> Fresh<br>2 <input type="checkbox"/> Salty            | 3 <input type="checkbox"/> Sulphur<br>4 <input type="checkbox"/> Minerals<br>5 <input type="checkbox"/> Gas | 34 |

| 51 CASING & OPEN HOLE RECORD |   |                       |              |     |
|------------------------------|---|-----------------------|--------------|-----|
| Inside diam inches           | Material  | Wall thickness inches | Depth - feet |     |
|                              |   |                       | From         | To  |
| 10-11<br>6 1/4               | 1 <input checked="" type="checkbox"/> Steel<br>2 <input type="checkbox"/> Galvanized<br>3 <input type="checkbox"/> Concrete<br>4 <input type="checkbox"/> Open hole<br>5 <input type="checkbox"/> Plastic | 12<br>188             | 13-16<br>0   | 70  |
| 17-18<br>8 3/4               | 1 <input type="checkbox"/> Steel<br>2 <input type="checkbox"/> Galvanized<br>3 <input type="checkbox"/> Concrete<br>4 <input type="checkbox"/> Open hole<br>5 <input type="checkbox"/> Plastic            | 19                    | 20-23<br>0   | 68  |
| 24-25<br>6                   | 1 <input type="checkbox"/> Steel<br>2 <input type="checkbox"/> Galvanized<br>3 <input type="checkbox"/> Concrete<br>4 <input checked="" type="checkbox"/> Open hole<br>5 <input type="checkbox"/> Plastic | 26                    | 27-30<br>68  | 333 |

| SCREEN | Sizes of opening (Slot No.) | Diameter     | Length                            |
|--------|-----------------------------|--------------|-----------------------------------|
|        | 31-33                       | 34-38 inches | 39-40 feet                        |
|        |                             |              |                                   |
|        | Material and type           |              | Depth at top of screen 41-44 feet |

| 61 PLUGGING & SEALING RECORD                      |             |   |
|---|-------------|---|
| <input checked="" type="checkbox"/> Annular space |             | <input type="checkbox"/> Abandonment              |
| Depth set at - feet                               |             | Material and type (Cement grout, bentonite, etc.) |
| From  | To          |   |
| 18-21<br>2  | 22-25<br>30 | bentonite   |
| 26-29   | 30-33       |   |

| 71 PUMPING TEST   | Pumping test method   | Pumping rate               | Duration of pumping   |                       |                       |
|---|---|----------------------------|---|-----------------------|-----------------------|
|   | 1 <input checked="" type="checkbox"/> Pump<br>2 <input type="checkbox"/> Bailer | 9 GPM                      | 1   | Hours                 | Mins                  |
|   | Static level  | Water level end of pumping | Water levels during   |                       |                       |
|   | 19-21<br>50 feet  | 22-24<br>160 feet          | 15 minutes<br>50 feet   | 30 minutes<br>50 feet | 45 minutes<br>50 feet |
| If flowing give rate  |   | Pump intake set at         | Water at end of test  |                       |                       |
| GPM   |   | feet                       | <input type="checkbox"/> Clear <input checked="" type="checkbox"/> Cloudy |                       |                       |
| Recommended pump type   |   | Recommended pump setting   | Recommended pump rate   |                       |                       |
| <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep |   | 160 feet                   | 9 GPM   |                       |                       |

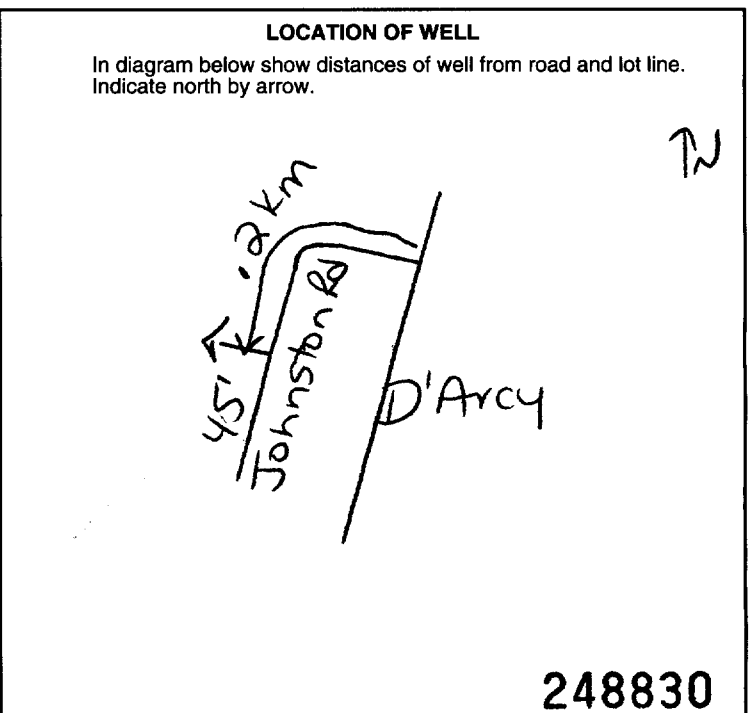

| FINAL STATUS OF WELL                               |   |  |
|--|---|--|
| 1 <input checked="" type="checkbox"/> Water supply | 5 <input type="checkbox"/> Abandoned, insufficient supply | 9 <input type="checkbox"/> Unfinished        |
| 2 <input type="checkbox"/> Observation well        | 6 <input type="checkbox"/> Abandoned, poor quality        | 10 <input type="checkbox"/> Replacement well |
| 3 <input type="checkbox"/> Test hole               | 7 <input type="checkbox"/> Abandoned (Other)              |  |
| 4 <input type="checkbox"/> Recharge well           | 8 <input type="checkbox"/> Dewatering                     |  |

| WATER USE                                      |   |                                    |
|--|---|------------------------------------|
| 1 <input checked="" type="checkbox"/> Domestic | 5 <input type="checkbox"/> Commercial                 | 9 <input type="checkbox"/> Not use |
| 2 <input type="checkbox"/> Stock               | 6 <input type="checkbox"/> Municipal                  | 10 <input type="checkbox"/> Other  |
| 3 <input type="checkbox"/> Irrigation          | 7 <input type="checkbox"/> Public supply              |                                    |
| 4 <input type="checkbox"/> Industrial          | 8 <input type="checkbox"/> Cooling & air conditioning |                                    |

| METHOD OF CONSTRUCTION                           |  |                                     |
|--|--|-------------------------------------|
| 1 <input type="checkbox"/> Cable tool            | 5 <input checked="" type="checkbox"/> Air percussion | 9 <input type="checkbox"/> Driving  |
| 2 <input type="checkbox"/> Rotary (conventional) | 6 <input type="checkbox"/> Boring                    | 10 <input type="checkbox"/> Digging |
| 3 <input type="checkbox"/> Rotary (reverse)      | 7 <input type="checkbox"/> Diamond                   | 11 <input type="checkbox"/> Other   |
| 4 <input type="checkbox"/> Rotary (air)          | 8 <input type="checkbox"/> Jetting                   |                                     |

|   |                                      |
|---|--------------------------------------|
| Name of Well Contractor: Air-Rock Drilling Ltd  | Well Contractor's Licence No.: 1119  |
| Address: RR#1 Richmond, Ont                     |                                      |
| Name of Well Technician: Shannon Purcell        | Well Technician's Licence No.: TA122 |
| Signature of Technician/Contractor: [Signature] | Submission date: 18/12/02            |

| MINISTRY USE ONLY | Data source        | Contractor | Date received |
|-------------------|--------------------|------------|---------------|
|                   |                    | 1119       | DEC 23 2002   |
|                   | Date of inspection | Inspector  |               |
| Remarks           |                    |            |               |
| CSS.EC2           |                    |            |               |



**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

**Well Owner's Information and Location of Well Information**

MUN **15009** CON **CON** LOT **04** CONCESSION **06**

Address of Well Location (County/District/Municipality) **Ottawa Carleton** Township **Osgoode** Lot **6** Concession **4**  
 RR#/Street Number/Name \_\_\_\_\_ City/Town/Village **Glebe** Site/Compartment/Block/Tract etc. \_\_\_\_\_  
 GPS Reading NAD Zone Easting Northing Unit Make/Model Mode of Operation: Undifferentiated  Averaged  
**8.3 18 455214 5011633 magellan** Differentiated, specify \_\_\_\_\_

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour | Most common material | Other Materials | General Description | Depth From | Metres To |
|----------------|----------------------|-----------------|---------------------|------------|-----------|
| grey           | Clay                 |                 |                     | 0          | 10.06     |
| grey           | sandstone            |                 |                     | 10.06      | 15.24     |
| grey           | limestone            |                 |                     | 15.24      | 41.76     |

**Hole Diameter**

| Depth From | Metres To | Diameter Centimetres |
|------------|-----------|----------------------|
| 0          | 41.76     | 15.24                |

**Water Record**

Water found at **41.1** Metres Kind of Water **Not tested**

Gas  Sulphur  Minerals

Other: **Not tested**

After test of well yield, water was **Clear and sediment free**

Other, specify: **Not tested**

Chlorinated  Yes  No

**Construction Record**

| Inside diam centimetres                       | Material   | Wall thickness centimetres | Depth From | Metres To |
|---|--|----------------------------|------------|-----------|
| 15.88   | <input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized | .478                       | 0          | 18.9      |
| <b>Screen</b>                                 |  |                            |            |           |
| Outside diam                                  | <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized            | Slot No.                   |            |           |
| <b>No Casing or Screen</b>                    |  |                            |            |           |
| <input checked="" type="checkbox"/> Open hole |  |                            |            |           |

18.3 41.76

**Test of Well Yield See Attached.**

| Pumping test method   | Draw Down    |                    | Recovery |                    |
|---|--------------|--------------------|----------|--------------------|
|   | Time min     | Water Level Metres | Time min | Water Level Metres |
| <b>Subpump</b>  |              |                    |          |                    |
| Pump intake set at - (metres)   | Static Level | 2.66               |          | 9.85               |
| Pumping rate <b>84</b> (litres/min) + <b>30</b>   | 1            | 5.66               | 1        | 8.18               |
| Duration of pumping <b>6</b> hrs + <b>-</b> min   | 2            | 8.26               | 2        | 7.40               |
| Final water level end of pumping <b>9.8</b> metres  | 3            |                    | 3        |                    |
| Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep | 4            | 12.78              | 4        | 6.32               |
| Recommended pump depth <b>39.6</b> metres   | 6            | 16.34              | 6        | 5.52               |
| Recommended pump rate <b>36</b> (litres/min)  | 8            | 18.37              | 8        | 4.96               |
| If flowing give rate - (litres/min)   | 10           | 19.98              | 10       | 4.60               |
|   | 16           | 22.82              | 16       | 3.89               |
|   | 20           | 24.14              | 20       | 3.67               |
|   | 25           | 19.42              | 25       | 3.87               |
| If pumping discontinued, give reason.   | 30           | 15.98              | 30       | 3.47               |
|   | 40           | 11.66              | 40       | 3.19               |
|   | 50           | 10.32              | 50       | 3.10               |
|   | 60           | 9.94               | 60       | 3.04               |

**Plugging and Sealing Record**  Annular space  Abandonment

| Depth set at - Metres From | To | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
|----------------------------|----|---|------------------------------|
| 18.3                       | 0  | Cement grout slurry   | 250 gallons                  |

**Location of Well**

In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging

Rotary (conventional)  Air percussion  Jetting  Other

Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other

Stock  Commercial  Not used

Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)

Observation well  Abandoned, insufficient supply  Dewatering

Test Hole  Abandoned, poor quality  Replacement well

Audit No. **Z 04877** Date Well Completed **2004 02 17**

Was the well owner's information package delivered?  Yes  No **NA**

**Well Contractor/Technician Information**

Name of Well Contractor **Ar. Rock Drilling Ltd** Well Contractor's Licence No. **1119**

Business Address (street name, number, city etc.) **Rt 1 Richmond, Ont**

Name of Well Technician (last name, first name) **Shannon Pulwell** Well Technician's Licence No. **Ta 122**

Signature of Technician/Contractor **[Signature]** Date Submitted **2004 03 22**

**Ministry Use Only**

Data Source Contractor **1119**

Date Received **MAR 31 2004** Date of Inspection \_\_\_\_\_

Remarks **CS 153** Well Record Number **1534585**

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

| Ministry Use Only |  |  |  |     |  |  |  |     |  |  |  |
|-------------------|--|--|--|-----|--|--|--|-----|--|--|--|
| MUN               |  |  |  | CON |  |  |  | LOT |  |  |  |

**Well Owner's Information and Location of Well Information**

RR#/Street Number/Name: **6976 South Village Drive** City/Town/Village: **Georgetown** Site/Compartment/Block/Tract etc.: **1/1**

GPS Reading: NAD 83 Zone 18 Easting 455034E Northing 5012414 Unit Make/Model: **Magedan** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour | Most common material | Other Materials | General Description | Depth From | Metres To |
|----------------|----------------------|-----------------|---------------------|------------|-----------|
| brown          | topsoil              |                 | soft                | 0          | 1.02      |
| grey           | sand                 | layers of clay  | soft                | 1.02       | 10.36     |
| grey           | sand - gravel        |                 | packed              | 10.36      | 14.93     |
| grey           | gravel               |                 | packed              | 14.93      | 16.45     |
| grey           | limestone            |                 | layered             | 16.45      | 30.48     |

| Hole Diameter |           |                      |
|---------------|-----------|----------------------|
| Depth From    | Metres To | Diameter Centimetres |
| 0             | 17.37     | 21.23                |
| 17.37         | 30.48     | 15.55                |

| Construction Record        |  |                                    |              |       |
|----------------------------|--|------------------------------------|--------------|-------|
| Inside diam centimetres    | Material   | Wall thickness centimetres         | Depth Metres |       |
|                            |  |                                    | From         | To    |
| <b>Casing</b>              |  |                                    |              |       |
| 15.55                      | <input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass<br><input type="checkbox"/> Plastic <input type="checkbox"/> Concrete<br><input type="checkbox"/> Galvanized | 0.48                               | 10.60        | 17.37 |
| <b>Screen</b>              |  |                                    |              |       |
| Outside diam               | <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass<br><input type="checkbox"/> Plastic <input type="checkbox"/> Concrete<br><input type="checkbox"/> Galvanized            | Slot No.                           |              |       |
| <b>No Casing or Screen</b> |  |                                    |              |       |
|                            |  | <input type="checkbox"/> Open hole | 17.37        | 30.48 |

| Test of Well Yield  |                    |                    |          |                    |
|---|--------------------|--------------------|----------|--------------------|
| Pumping test method   | Draw Down Time min | Water Level Metres | Recovery |                    |
|   |                    |                    | Time min | Water Level Metres |
| 3 H.P. sub  |                    |                    |          |                    |
| Pump intake set at - (metres) 2.4   | Static Level 4.61  |                    |          | 5.49               |
| Pumping rate - (litres/min) 38  | 1                  |                    | 1        |                    |
| Duration of pumping 1 hrs + 0 min   | 2                  |                    | 2        |                    |
| Final water level end of pumping 5.19 metres  | 3                  | 5.21               | 3        |                    |
| Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep | 4                  |                    | 4        |                    |
| Recommended pump depth. 2.4 metres  | 5                  | 5.21               | 5        | 4.69               |
| Recommended pump rate. 40 (litres/min)  | 10                 | 5.36               | 10       | 4.61               |
| If flowing give rate - (litres/min)   | 15                 | 5.36               | 15       |                    |
|   | 20                 | 5.43               | 20       |                    |
|   | 25                 | 5.45               | 25       |                    |
| If pumping discontinued, give reason.   | 30                 | 5.46               | 30       |                    |
|   | 40                 | 5.48               | 40       |                    |
|   | 50                 | 5.48               | 50       |                    |
|   | 60                 | 5.49               | 60       |                    |

**Water Record**

Water found at: 30 m Kind of Water:  Fresh  Sulphur  Gas  Salty  Minerals

After test of well yield, water was  Clear and sediment free  Other, specify

Chlorinated  Yes  No

| Plugging and Sealing Record |       |   |                              |
|-----------------------------|-------|---|------------------------------|
| Depth set at - Metres From  | To    | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
| 0                           | 16.38 | cement grout  | 10 bags                      |

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  
 Rotary (conventional)  Air percussion  Jetting  Other  
 Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other  
 Stock  Commercial  Not used  
 Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  
 Observation well  Abandoned, insufficient supply  Dewatering  
 Test Hole  Abandoned, poor quality  Replacement well

**Location of Well**

In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.

Audit No. **28003** Date Well Completed **05 09 27**

Was the well owner's information package delivered?  Yes  No Date Delivered

**Well Contractor/Technician Information**

Name of Well Contractor: **Gilles Bourgeois** Well Contractor's Licence No.: **1414**

Business Address (street name, number, city, etc.): **St A. Bourgeois**

Name of Well Technician (last name, first name): **Claude Bourgeois** Well Technician's Licence No.: **3310**

Signature of Technician/Contractor: *[Signature]* Date Submitted: **05 09 27**

**Ministry Use Only**

Data Source: Contractor **1414**

Date Received: **05 09 27** Date of Inspection: **05 09 27**

Remarks: **1** Well Record Number:

**Instructions for Completing Form**

- For use in the Province of Ontario only. This document is a permanent legal document. Please retain for future reference.
- All Sections must be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.
- Please print clearly in blue or black ink only.

**Ministry Use Only**

|     |     |     |
|-----|-----|-----|
| MUN | CON | LOT |
|-----|-----|-----|

Address of Well Location (County/District/Municipality) **Ottawa Carleton** Township **Osgoode** Lot **4** Concession **4**

RR#/Street Number/Name **#6958 South Village Dr** City/Town/Village **Greenley** Site/Compartment/Block/Tract etc. **PLAN 4M-1265 9/110**

GPS Reading NAD **83** Zone **18** Easting **454913** Northing **5012338** Unit Make/Model **Magellan** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify \_\_\_\_\_

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour | Most common material | Other Materials | General Description | Depth Metres |      |
|----------------|----------------------|-----------------|---------------------|--------------|------|
|                |                      |                 |                     | From         | To   |
|                | sand fill            |                 |                     | 0            | 1.2  |
|                | clay                 | sand            |                     | 1.2          | 6.1  |
|                | sand                 | gravel          |                     | 6.1          | 14.9 |
| grey           | limestone            |                 |                     | 14.9         | 24.4 |

**Hole Diameter**

| Depth Metres | Diameter Centimetres |
|--------------|----------------------|
| 0            | 24.4                 |
| 14.9         | 14.9                 |

**Construction Record**

| Inside diam centimetres                       | Material   | Wall thickness centimetres | Depth Metres |      |
|---|--|----------------------------|--------------|------|
|   |  |                            | From         | To   |
| 15.88   | <input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass<br><input type="checkbox"/> Plastic <input type="checkbox"/> Concrete<br><input type="checkbox"/> Galvanized | .48                        | 0            | 17.7 |
| <b>Screen</b>                                 |  |                            |              |      |
| Outside diam                                  | <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass<br><input type="checkbox"/> Plastic <input type="checkbox"/> Concrete<br><input type="checkbox"/> Galvanized            | Slot No.                   |              |      |
| <b>No Casing or Screen</b>                    |  |                            |              |      |
| <input checked="" type="checkbox"/> Open hole |  |                            | 17.1         | 24.4 |

**Test of Well Yield**

| Pumping test method                       | Draw Down   |                    | Recovery |                    |
|---|---|--------------------|----------|--------------------|
|   | Time min  | Water Level Metres | Time min | Water Level Metres |
| <b>Sub Pump</b>                           |   |                    |          |                    |
| Pump intake size (metres)                 | 0.133   | Static Level 4.34  |          | 7.53               |
| Pumping rate (litres/min)                 | 91  | 1 6.22             | 1        | 5.03               |
| Duration of pumping                       | 1 hr + 0 min  | 2 6.85             | 2        | 4.72               |
| Final water level end of pumping (metres) | 7.53  | 3 7.07             | 3        | 4.69               |
| Recommended pump type                     | <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep | 4 7.19             | 4        | 4.66               |
| Recommended pump depth (metres)           | 0.33  | 5 7.24             | 5        | 4.62               |
| Recommended pump rate (litres/min)        | 91  | 10 7.38            | 10       | 4.56               |
| If flowing give rate (litres/min)         | 15 7.42   | 15                 | 4.50     |                    |
|   | 20 7.44   | 20                 | 4.48     |                    |
|   | 25 7.47   | 25                 | 4.46     |                    |
| If pumping discontinued, give reason.     | 30 7.48   | 30                 | 4.44     |                    |
|   | 40 7.50   | 40                 | 4.42     |                    |
|   | 50 7.52   | 50                 | 4.41     |                    |
|   | 60 7.53   | 60                 | 4.40     |                    |

**Plugging and Sealing Record**  Annular space  Abandonment

| Depth set at - Metres | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
|-----------------------|---|------------------------------|
| 17.1                  | neat cement slurry  | 11816                        |
| 14.0                  | bentonite slurry  | 490                          |

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  
 Rotary (conventional)  Air percussion  Jetting  Other  
 Rotary (reverse)  Boring  Drilling

**Water Use**

Domestic  Industrial  Public Supply  Other  
 Stock  Commercial  Not used  
 Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  
 Observation well  Abandoned, insufficient supply  Dewatering  
 Test Hole  Abandoned, poor quality  Replacement well

**Location of Well**

In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.

Audit No. **Z 23315** Date Well Completed **2005 10 18**

Was the well owner's information package delivered?  Yes  No Date Delivered **2005 10 19**

**Well Contractor/Technician Information**

Name of Well Contractor **Air Rod Drilling Co Ltd** Well Contractor's Licence No. **1119**

Business Address (street name, number, city etc.) **RR#1 Richmond, Ont**

Name of Well Technician (last name, first name) **Purcell Shannon** Well Technician's Licence No. **T2122**

Signature of Technician/Contractor *[Signature]* Date Submitted **2005 11 04**

**Ministry Use Only**

Data Source \_\_\_\_\_ Contractor **1119**

Date Received **NOV 14, 2005** Date of Inspection **YYYY MM DD**

Remarks \_\_\_\_\_ Well Record Number \_\_\_\_\_

**Instructions for Completing Form**

**A 028641**

page \_\_\_ of \_\_\_

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

|   |  |  |  |   |  |  |   |  |  |   |  |  |   |  |  |
|---|--|--|--|---|--|--|---|--|--|---|--|--|---|--|--|
| <b>Well Owner's Information and Location of Well Information</b>                              |  |  |  | <b>Ministry Use Only</b>  |  |  |   |  |  |   |  |  |   |  |  |
|   |  |  |  | MUN   |  |  | CON   |  |  | LOT   |  |  |   |  |  |
| First Name<br><b>[Redacted]</b>   |  |  |  | Mailing Address (Street Number/Name, RR, Lot, Concession)<br><b>6779 LAKES PARK DRIVE</b> |  |  |   |  |  |   |  |  |   |  |  |
| County/District/Municipality<br><b>Chabot Manor Development</b>                               |  |  |  | Township/City/Town/Village<br><b>GREELY</b>   |  |  | Province<br><b>Ontario</b>  |  |  | Postal Code<br><b>K4P1P1</b>                                |  |  | Telephone Number (include area code)                    |  |  |
| Address of Well Location (County/District/Municipality)<br><b>Ottawa Carleton</b>             |  |  |  | Township<br><b>Osgoode</b>  |  |  | Lot<br><b>4</b>   |  |  | Concession<br><b>4</b>                                      |  |  | RR#/Street Number/Name<br><b>#6935 SOUTH VILLAGE DR</b> |  |  |
| City/Town/Village<br><b>Greely</b>  |  |  |  | City/Town/Village<br><b>Greely</b>  |  |  | City/Town/Village<br><b>Greely</b>  |  |  | City/Town/Village<br><b>Greely</b>                          |  |  | City/Town/Village<br><b>Greely</b>                      |  |  |
| GPS Reading<br>NAD: <b>83</b> Zone: <b>18</b> Easting: <b>454843</b> Northing: <b>5012416</b> |  |  |  | Unit Make/Model<br><b>Magellan</b>  |  |  | Mode of Operation:<br><input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged <input type="checkbox"/> Differentiated, specify |  |  | Sm/Compartment/Block/Tract etc.<br><b>PLAN 4M-1265 9/25</b> |  |  |   |  |  |

| Log of Overburden and Bedrock Materials (see instructions) |                      |                 |                     |              |      |
|--|----------------------|-----------------|---------------------|--------------|------|
| General Colour   | Most common material | Other Materials | General Description | Depth Metres |      |
|  |                      |                 |                     | From         | To   |
|  | Sand                 | gravel          |                     | 0            | 12.8 |
| grey   | limestone            |                 |                     | 12.8         | 29.6 |
| grey   | limestone            | sandstone       | mixed               | 29.6         | 54.9 |

| Hole Diameter   |  |                      |
|---|--|----------------------|
| Depth From  | Metres To  | Diameter Centimetres |
| 0   | 54.9   | 15.07                |
| Water Record  |  |                      |
| Water found at Metres   | Kind of Water  |                      |
| 28.3  | Fresh <input type="checkbox"/> Sulphur <input type="checkbox"/> Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals <input type="checkbox"/> Other: <b>NOT</b>    |                      |
| 34.7  | Fresh <input type="checkbox"/> Sulphur <input type="checkbox"/> Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals <input type="checkbox"/> Other: <b>tested</b> |                      |
| 50.6  | Fresh <input type="checkbox"/> Sulphur <input type="checkbox"/> Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals <input type="checkbox"/> Other: <b>cloudy</b> |                      |
| After test of well yield, water was <input type="checkbox"/> Clear and sediment free <input checked="" type="checkbox"/> Other, specify <b>cloudy</b> |  |                      |
| Chlorinated   | <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No  |                      |

| Construction Record        |   |                            |              |      |
|----------------------------|---|----------------------------|--------------|------|
| Inside diam centimetres    | Material  | Wall thickness centimetres | Depth Metres |      |
|                            |   |                            | From         | To   |
| <b>Casing</b>              |   |                            |              |      |
| 15.88                      | <input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass | .48                        | 0            | 15.2 |
|                            | <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete            |                            |              |      |
|                            | <input type="checkbox"/> Galvanized   |                            |              |      |
| <b>Screen</b>              |   |                            |              |      |
| Outside diam               | <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass            | Slot No.                   |              |      |
|                            | <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete            |                            |              |      |
|                            | <input type="checkbox"/> Galvanized   |                            |              |      |
| <b>No Casing or Screen</b> |   |                            |              |      |
|                            | <input checked="" type="checkbox"/> Open hole                                 |                            | 14.6         | 54.9 |

| Test of Well Yield                    |   |                    |          |                    |
|---------------------------------------|---|--------------------|----------|--------------------|
| Pumping test method                   | Draw Down   |                    | Recovery |                    |
|                                       | Time min  | Water Level Metres | Time min | Water Level Metres |
| <b>Sub pump</b>                       |   |                    |          |                    |
| Pump intake set at (metres)           | 51.8  | Static Level 11.13 |          |                    |
| Pumping rate - (litres/min)           | 30.28   | 1 12.95            | 1 36.15  |                    |
| Duration of pumping                   | 1 hrs + 0 min   | 2 13.93            | 2 34.77  |                    |
| Final water level end of pumping      | 37.51 metres  | 3 14.82            | 3 33.64  |                    |
| Recommended pump type                 | Shallow <input type="checkbox"/> Deep <input checked="" type="checkbox"/> | 4 15.68            | 4 32.47  |                    |
| Recommended pump depth                | 51.8 metres   | 5 16.53            | 5 30.53  |                    |
| Recommended pump rate (litres/min)    | 30.28   | 10 20.15           | 10 27.20 |                    |
| If flowing give rate - (litres/min)   |   | 15 22.80           | 15 24.10 |                    |
|                                       |   | 20 25.44           | 20 21.90 |                    |
|                                       |   | 25 27.62           | 25 20.14 |                    |
| If pumping discontinued, give reason. |   | 30 29.37           | 30 18.24 |                    |
|                                       |   | 40 32.73           | 40 16.58 |                    |
|                                       |   | 50 35.22           | 50 14.98 |                    |
|                                       |   | 60 37.51           | 60 14.11 |                    |

| Plugging and Sealing Record |      |   |                              |
|-----------------------------|------|---|------------------------------|
| Depth set at - Metres       |      | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
| From                        | To   |   |                              |
| 14.6                        | 11.6 | Cement slurry   | .1362                        |
| 11.6                        | 0    | bentonite slurry  | .490                         |

| Method of Construction                           |   |   |   |
|--|---|---|---|
| <input type="checkbox"/> Cable Tool              | <input type="checkbox"/> Rotary (air)                   | <input type="checkbox"/> Diamond                    | <input type="checkbox"/> Digging            |
| <input type="checkbox"/> Rotary (conventional)   | <input checked="" type="checkbox"/> Air percussion      | <input type="checkbox"/> Jetting                    | <input type="checkbox"/> Other              |
| <input type="checkbox"/> Rotary (reverse)        | <input type="checkbox"/> Boring                         | <input type="checkbox"/> Driving                    |   |
| Water Use  |   |   |   |
| <input checked="" type="checkbox"/> Domestic     | <input type="checkbox"/> Industrial                     | <input type="checkbox"/> Public Supply              | <input type="checkbox"/> Other              |
| <input type="checkbox"/> Stock                   | <input type="checkbox"/> Commercial                     | <input type="checkbox"/> Not used                   |   |
| <input type="checkbox"/> Irrigation              | <input type="checkbox"/> Municipal                      | <input type="checkbox"/> Cooling & air conditioning |   |
| Final Status of Well                             |   |   |   |
| <input checked="" type="checkbox"/> Water Supply | <input type="checkbox"/> Recharge well                  | <input type="checkbox"/> Unfinished                 | <input type="checkbox"/> Abandoned, (Other) |
| <input type="checkbox"/> Observation well        | <input type="checkbox"/> Abandoned, insufficient supply | <input type="checkbox"/> Dewatering                 |   |
| <input type="checkbox"/> Test Hole               | <input type="checkbox"/> Abandoned, poor quality        | <input type="checkbox"/> Replacement well           |   |

| Well Contractor/Technician Information   |   |
|--|---|
| Name of Well Contractor<br><b>Air Rock Drilling Ltd</b>                        | Well Contractor's Licence No.<br><b>1119</b>  |
| Business Address (street name, number, city etc.)<br><b>RR#1 Richmond, Ont</b> |   |
| Name of Well Technician (last name, first name)<br><b>Purcell Shannon</b>      | Well Technician's Licence No.<br><b>12122</b> |
| Signature of Technician/Contractor<br><i>[Signature]</i>                       | Date Submitted<br><b>2005 11 30</b>           |

| Location of Well  |  |
|---|--|
| In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.                     |  |
|   |  |
| Audit No.<br><b>Z 23357</b>   | Date Well Completed<br><b>2005 09 30</b> |
| Was the well owner's information package delivered? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | Date Delivered<br><b>2005 09 30</b>      |

| Ministry Use Only                   |                                  |
|-------------------------------------|----------------------------------|
| Data Source                         | Contractor<br><b>1119</b>        |
| Date Received<br><b>NOV 14 2005</b> | Date of Inspection<br>YYYY MM DD |
| Remarks                             | Well Record Number               |





Well Tag Number **A 028715**  
**A028715**

Instructions for Completing Form

- For use in the Province of Ontario only. This document is a permanent legal document. Please retain for future reference.
- All Sections must be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.
- Please print clearly in blue or black ink only.

Ministry Use Only

Address of well Location (County/District/Municipality) **Ottawa Carleton** Township **Osgoode** Lot **4** Concession **4**  
 RR#/Street Number/Name **#6945 South Village Dr** City/Town/Village **Greely** Site/Compartment/Block/Tract etc. **PLANAM-1265 5/126**  
 GPS Reading NAD **83** Zone **18** Easting **454807** Northing **5012421** Unit Make/Model **magellan** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify \_\_\_\_\_


Log of Overburden and Bedrock Materials (see instructions)

| General Colour | Most common material | Other Materials | General Description | Depth Metres |      |
|----------------|----------------------|-----------------|---------------------|--------------|------|
|                |                      |                 |                     | From         | To   |
|                | sand                 | gravel          |                     | 0            | 11.6 |
| grey           | limestone            |                 |                     | 11.6         | 30.5 |
| grey           | sandstone            |                 |                     | 30.5         | 54.9 |

| Hole Diameter   |  |                      | Construction Record   |  |                            |            | Test of Well Yield  |                     |                    |                    |                   |                    |
|---|--|----------------------|---|--|----------------------------|------------|---|---------------------|--------------------|--------------------|-------------------|--------------------|
| Depth From  | Metres To  | Diameter Centimetres | Inside diam centimetres   | Material   | Wall thickness centimetres | Depth From | Metres To   | Pumping test method | Draw Down Time min | Water Level Metres | Recovery Time min | Water Level Metres |
| 0   | 54.9   | 15.24                | 15.88   | Steel <input checked="" type="checkbox"/> Fibreglass <input type="checkbox"/><br>Plastic <input type="checkbox"/> Concrete <input type="checkbox"/><br>Galvanized <input type="checkbox"/> | .48                        | 0          | 14.0  | Subpump             |                    | 10.06              |                   |                    |
| Water Record  |  |                      | Casing  |  |                            |            | Test of Well Yield  |                     |                    |                    |                   |                    |
| Water found at Metres   | Kind of Water  |                      | Screen  |  |                            |            | Test of Well Yield  |                     |                    |                    |                   |                    |
| 35.0  | Fresh <input type="checkbox"/> Sulphur <input type="checkbox"/><br>Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals <input type="checkbox"/><br>Other: <b>NOT</b>    |                      | Outside diam <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/><br><input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/><br><input type="checkbox"/> Galvanized <input type="checkbox"/> |  |                            |            | Pumping rate - (litres/min) <b>26.5</b>   |                     |                    |                    |                   |                    |
| 51.5  | Fresh <input type="checkbox"/> Sulphur <input type="checkbox"/><br>Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals <input type="checkbox"/><br>Other: <b>TESTED</b> |                      | No Casing or Screen   |  |                            |            | Duration of pumping 1 hrs + min   |                     |                    |                    |                   |                    |
| After test of well yield, water was   |  |                      | Open hole <input checked="" type="checkbox"/>   |  |                            |            | Final water level end of pumping <b>25.42</b> metres  |                     |                    |                    |                   |                    |
| Clear and sediment free <input type="checkbox"/>                                |  |                      | 13.4  |  |                            |            | Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep |                     |                    |                    |                   |                    |
| Other, specify <b>cloudy</b>  |  |                      | 54.9  |  |                            |            | Recommended pump depth <b>51.8</b> metres   |                     |                    |                    |                   |                    |
| Chlorinated <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No |  |                      |   |  |                            |            | Recommended pump rate <b>26.5</b> (litres/min)  |                     |                    |                    |                   |                    |

Plugging and Sealing Record  Annular space  Abandonment

| Depth set at - Metres From | To   | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
|----------------------------|------|---|------------------------------|
| 13.4                       | 10.4 | neat cement slurry  | .1362                        |
| 10.4                       | 0    | bentonite slurry  | .490                         |

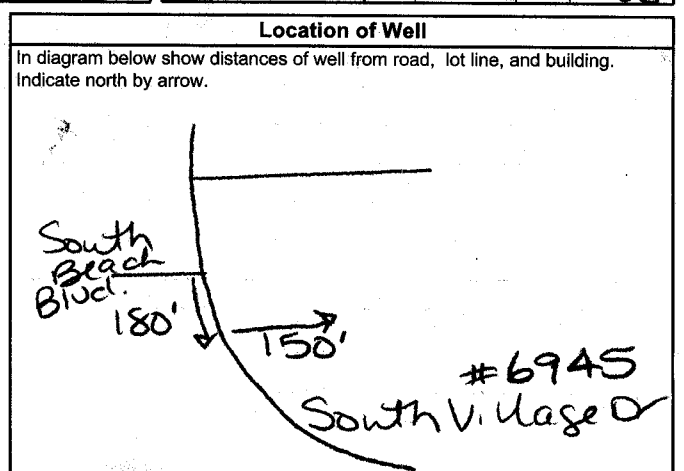

Method of Construction

Cable Tool  Rotary (air)  Diamond  Digging  
 Rotary (conventional)  Air percussion  Jetting  Other  
 Rotary (reverse)  Boring  Driving

Water Use

Domestic  Industrial  Public Supply  Other  
 Stock  Commercial  Not used  
 Irrigation  Municipal  Cooling & air conditioning

Final Status of Well

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  
 Observation well  Abandoned, insufficient supply  Dewatering  
 Test Hole  Abandoned, poor quality  Replacement well

Audit No. **Z 23364** Date Well Completed **2005 09 30**

Was the well owner's information package delivered?  Yes  No Date Delivered **2005 10 03**

Well Contractor/Technician Information

Name of Well Contractor **A1 Koch Drilling Ltd** Well Contractor's Licence No. **1119**  
 Business Address (street name, number, city etc.) **Rte 1 Richmond, Ont**  
 Name of Well Technician (last name, first name) **Purcell Shannon** Well Technician's Licence No. **12122**  
 Signature of Technician/Contractor **[Signature]** Date Submitted **2005 11 04**

Ministry Use Only

Data Source **1119** Contractor **1119**  
 Date Received **NOV 14 2005** Date of Inspection **YYYY MM DD**  
 Remarks \_\_\_\_\_ Well Record Number \_\_\_\_\_

Instructions for Completing Form

- For use in the Province of Ontario only. This document is a permanent legal document. Please retain for future reference. All Sections must be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form. Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203. All metre measurements shall be reported to 1/10th of a metre. Please print clearly in blue or black ink only.

Well Owner's Information and Location of Well Information

Table with columns: MUN, CON, LOT. Includes 'Ministry Use Only' header.

RR#/Street Number/Name: Ottawa Carleton #6934 South Village Drive; City/Town/Village: Ossonge Greely; Site/Compartment/Block/Tract etc: 4 4 Plan AM-1265 S/L 14

Log of Overburden and Bedrock Materials (see instructions)

Table with columns: General Colour, Most common material, Other Materials, General Description, Depth From, Metres To. Includes handwritten entries: Sand gravel, Gray limestone, 0 12.19, 12.19 45.72.

Hole Diameter, Water Record, Chlorinated sections. Includes handwritten notes: 'TESTED', 'NOT TESTED'.


Construction Record, Screen, No Casing or Screen sections. Includes handwritten entries: 15.88, .48, 0, 14.63, 14.02, 45.72.

Test of Well Yield table. Includes handwritten entries: Subpump, 10.20, 11.13, 11.46, 11.65, 11.78, 11.87, 12.09, 12.38, 12.50, 12.56, 12.62, 12.68, 12.71, 12.75.

Plugging and Sealing Record table. Includes handwritten entries: 14.02, 10.97, Neat Cement Slurry, Bentonite Slurry.

Method of Construction, Water Use, Final Status of Well sections. Includes handwritten entries: Air percussion, Domestic.

Well Contractor/Technician Information section. Includes handwritten entries: AIR ROCK DRILLING CO LTD, HOSAN DAN.

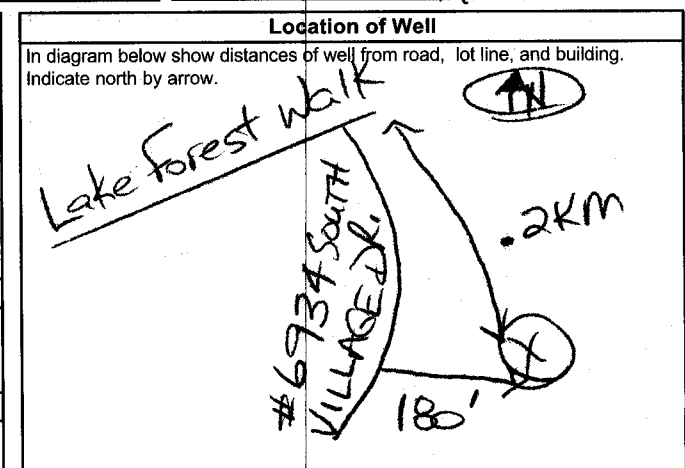

Audit No. z 39914, Date Well Completed 2006 03 15, Date Delivered 2006 03 16.

Ministry Use Only section. Includes handwritten entries: Data Source, Contractor 1119, Date Received APR 12 2006.

**Instructions for Completing Form**

- For use in the Province of Ontario only. This document is a permanent legal document. Please retain for future reference.
- All Sections must be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.
- Please print clearly in blue or black ink only.

**Ministry Use Only**

|     |  |     |  |     |  |
|-----|--|-----|--|-----|--|
| MUN |  | CON |  | LOT |  |
|-----|--|-----|--|-----|--|

**Well Owner's Information and Location of Well Information**

|   |   |   |                                   |   |  |
|---|---|---|-----------------------------------|---|--|
| First Name<br><b>Savvy Custom Building</b>  | Last Name                                   | Mailing Address (Street Number/Name, RR, Lot, Concession)<br><b>555 Legget Dr. P.O. Box 73010</b> |                                   |   |  |
| County/District/Municipality<br><b>Ottawa Carleton</b>                            | Township/City/Town/Village<br><b>Kanata</b> | Province<br><b>Ontario</b>  | Postal Code<br><b>K2K 3C5</b>     | Telephone Number (include area code)<br><b>613</b>  |  |
| Address of Well Location (County/District/Municipality)<br><b>Ottawa Carleton</b> |   | Township<br><b>Osgoode</b>  | Lot<br><b>3</b>                   | Concession<br><b>4</b>  |  |
| RR#/Street Number/Name<br><b>Lot 23 South Village</b>                             |   | City/Town/Village<br><b>Greely</b>  | Site/Compartment/Block/Tract etc. |   |  |
| GPS Reading   | NAD Zone Easting<br><b>8 3 18 454882</b>    | Northing<br><b>5012483</b>  | Unit Make/Model<br><b>Garmin</b>  | Mode of Operation: <input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged<br><input type="checkbox"/> Differentiated, specify |  |

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour                    | Most common material     | Other Materials | General Description | Depth Metres |              |
|-----------------------------------|--------------------------|-----------------|---------------------|--------------|--------------|
|                                   |                          |                 |                     | From         | To           |
| <b>brown</b>                      | <b>sand</b>              |                 |                     | <b>0</b>     | <b>1.21</b>  |
| <b>gray</b>                       | <b>sand &amp; gravel</b> |                 | <b>wet</b>          | <b>1.21</b>  | <b>3.04</b>  |
| <b>gray</b>                       | <b>clay</b>              |                 | <b>packed</b>       | <b>3.04</b>  | <b>11.88</b> |
| <b>gray</b>                       | <b>sand &amp; gravel</b> |                 |                     | <b>11.88</b> | <b>13.10</b> |
| <b>gray</b>                       | <b>limestone</b>         |                 |                     | <b>13.10</b> | <b>48.76</b> |
| <b>gray &amp; white sandstone</b> |                          |                 |                     | <b>48.76</b> | <b>95.09</b> |

| Hole Diameter |              |              |
|---------------|--------------|--------------|
| Depth         | Metres       | Diameter     |
| From          | To           | Centimetres  |
| <b>0</b>      | <b>14.93</b> | <b>12.75</b> |
| <b>14.93</b>  | <b>95.09</b> | <b>15.23</b> |

| Construction Record        |  |                            |              |              |  |
|----------------------------|--|----------------------------|--------------|--------------|--|
| Inside diam centimetres    | Material   | Wall thickness centimetres | Depth Metres |              |  |
|                            |  |                            | From         | To           |  |
| <b>Casing</b>              |  |                            |              |              |  |
| <b>15.86</b>               | <input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass<br><input type="checkbox"/> Plastic <input type="checkbox"/> Concrete<br><input type="checkbox"/> Galvanized | <b>0.48</b>                | <b>+ .45</b> | <b>14.93</b> |  |
| <b>Screen</b>              |  |                            |              |              |  |
| Outside diam               | <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass<br><input type="checkbox"/> Plastic <input type="checkbox"/> Concrete<br><input type="checkbox"/> Galvanized            | Slot No.                   |              |              |  |
| <b>No Casing or Screen</b> |  |                            |              |              |  |
| <b>15.23</b>               | <input checked="" type="checkbox"/> Open hole  |                            | <b>14.93</b> | <b>95.09</b> |  |

| Test of Well Yield  |              |                    |           |                    |
|---|--------------|--------------------|-----------|--------------------|
| Pumping test method   | Draw Down    |                    | Recovery  |                    |
|   | Time min     | Water Level Metres | Time min  | Water Level Metres |
| <b>submersible</b>  |              |                    |           |                    |
| Pump intake set at - (metres)<br><b>60.95</b>   | Static Level |                    |           |                    |
| Pumping rate - (litres/min)<br><b>54.6</b>  | <b>1</b>     | <b>10.32</b>       | <b>1</b>  | <b>10.21</b>       |
| Duration of pumping<br><b>1</b> hrs + <b>0</b> min  | <b>2</b>     | <b>10.32</b>       | <b>2</b>  | <b>10.22</b>       |
| Final water level end of pumping<br><b>10.34</b>  | <b>3</b>     | <b>10.33</b>       | <b>3</b>  | <b>10.22</b>       |
| Recommended pump type.<br><input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep | <b>4</b>     | <b>10.33</b>       | <b>4</b>  | <b>10.23</b>       |
| Recommended pump depth.<br><b>45.71</b> metres  | <b>5</b>     | <b>10.33</b>       | <b>5</b>  | <b>10.22</b>       |
| Recommended pump rate.<br><b>45.5</b> (litres/min)  | <b>10</b>    | <b>10.33</b>       | <b>10</b> | <b>10.222</b>      |
| If flowing give rate - (litres/min)   | <b>15</b>    | <b>10.33</b>       | <b>15</b> | <b>10.22</b>       |
|   | <b>20</b>    | <b>10.34</b>       | <b>20</b> | <b>10.22</b>       |
|   | <b>25</b>    | <b>10.34</b>       | <b>25</b> | <b>10.20</b>       |
|   | <b>30</b>    | <b>10.34</b>       | <b>30</b> | <b>10.19</b>       |
| If pumping discontinued, give reason.   | <b>40</b>    | <b>10.34</b>       | <b>40</b> | <b>10.19</b>       |
|   | <b>50</b>    | <b>10.34</b>       | <b>50</b> | <b>10.19</b>       |
|   | <b>60</b>    | <b>10.34</b>       | <b>60</b> | <b>10.19</b>       |

| Plugging and Sealing Record |          |   |                              |
|-----------------------------|----------|---|------------------------------|
| Depth set at - Metres       |          | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
| From                        | To       |   |                              |
| <b>14.93</b>                | <b>0</b> | <b>Grouted Bentonite Slurry</b>                               | <b>1.38m3</b>                |

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  
 Rotary (conventional)  Air percussion  Jetting  Other  
 Rotary (reverse)  Boring  Driving

**Water Use**


Domestic  Industrial  Public Supply  Other  
 Stock  Commercial  Not used  
 Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  
 Observation well  Abandoned, insufficient supply  Dewatering  
 Test Hole  Abandoned, poor quality  Replacement well

**Well Contractor/Technician Information**

Name of Well Contractor: **Capital Water Supply Ltd.** Well Contractor's Licence No.: **1558**  
 Business Address (street name, number, city etc.): **Box 490 Stittsville, Ontario K3S 1A6**  
 Name of Well Technician (last name, first name): **Miller, Stephen** Well Technician's Licence No.: **T0097**  
 Signature of Technician/Contractor: *[Signature]* Date Submitted: **2006 03 31**

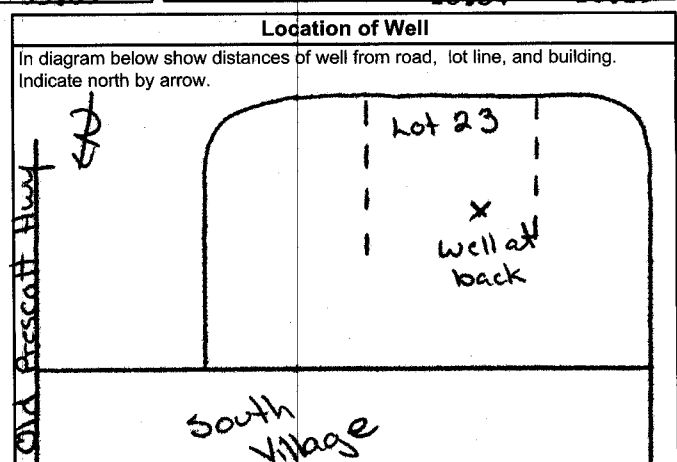

Audit No. **7 39272** Date Well Completed **2006 03 30**

Was the well owner's information package delivered?  Yes  No Date Delivered **2006 03 30**

**Ministry Use Only**

Data Source: **1558** Contractor

Date Received **APR 19 2006** Date of Inspection

Remarks: Well Record Number



Instructions for Completing Form

- For use in the Province of Ontario only. This document is a permanent legal document. Please retain for future reference. All Sections must be completed in full to avoid delays in processing. Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203. All metre measurements shall be reported to 1/10th of a metre. Please print clearly in blue or black ink only.

Well Owner's Information and Location of Well Information

Ministry Use Only table with columns for MUN, CON, LOT

RR#/Street Number/Name: #6970 South Village Drive; City/Town/Village: Greely; Site/Compartment/Block/Tract etc: Pbn 4M-1265 S/L8

Log of Overburden and Bedrock Materials (see instructions)


Table with columns: General Colour, Most common material, Other Materials, General Description, Depth From, Metres To. Handwritten entries: Sand & Boulders, Dark Grey limestone.

Hole Diameter and Water Record sections. Includes depth, diameter, and water quality test results.

Construction Record section. Includes casing and screen details with materials and dimensions.

Test of Well Yield table. Shows pumping test results including draw down and recovery times.

Plugging and Sealing Record section. Details the use of neat cement slurry and bentonite slurry.

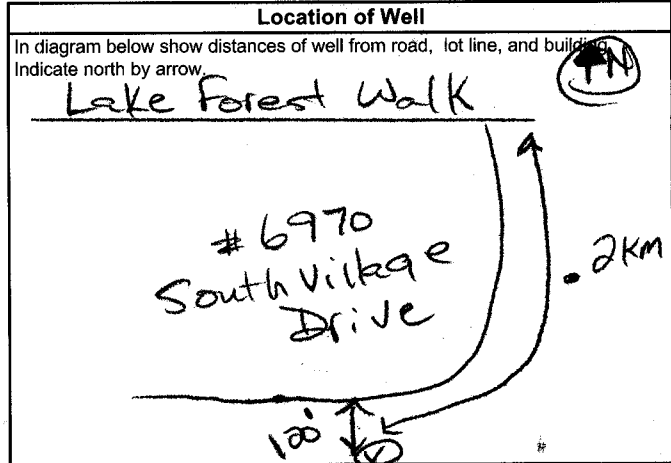

Method of Construction, Water Use, and Final Status of Well sections.

Audit No. 239992 and Date Well Completed 2006 04 19.

Well Contractor/Technician Information section. Lists Air Rock Drilling Co Ltd and technician Hosan Dan.

Ministry Use Only section. Includes Data Source, Date Received JUN 12 2006, and Well Record Number 1119.

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

**Well Owner's Information and Location of Well Information**

| Ministry Use Only |  |  |  |     |  |  |  |     |  |  |  |
|-------------------|--|--|--|-----|--|--|--|-----|--|--|--|
| MUN               |  |  |  | CON |  |  |  | LOT |  |  |  |

RR#/Street Number/Name: **1332 South Beach Blvd** City/Town/Village: **Greely** Site/Compartment/Block/Tract etc.: **Plan 4M-1265 S/L 111**

GPS Reading: NAD **83** Zone **18** Easting **454569** Northing **5012144** Unit Make/Model: **Magellan** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour | Most common material | Other Materials | General Description | Depth Metres |       |
|----------------|----------------------|-----------------|---------------------|--------------|-------|
|                |                      |                 |                     | From         | To    |
|                | Sand                 |                 |                     | 0            | 13.10 |
|                | Grey limestone       |                 |                     | 13.10        | 28.95 |
|                | ✓ Sandstone          |                 |                     | 28.95        | 34.44 |
|                | ✓ Limestone          |                 |                     | 34.44        | 41.14 |
|                | ✓ Sandstone          |                 |                     | 41.14        | 42.66 |

**Hole Diameter**

| Depth From | Metres To | Diameter Centimetres |
|------------|-----------|----------------------|
| 0          | 42.66     | 15.23                |

**Construction Record**

| Inside diam centimetres    | Material   | Wall thickness centimetres | Depth Metres |       |
|----------------------------|--|----------------------------|--------------|-------|
|                            |  |                            | From         | To    |
| 15.88                      | <input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass<br><input type="checkbox"/> Plastic <input type="checkbox"/> Concrete<br><input type="checkbox"/> Galvanized | .48                        | 0            | 15.84 |
| <b>Screen</b>              |  |                            |              |       |
| Outside diam               | <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass<br><input type="checkbox"/> Plastic <input type="checkbox"/> Concrete<br><input type="checkbox"/> Galvanized            | Slot No.                   |              |       |
| <b>No Casing or Screen</b> |  |                            |              |       |
|                            |  |                            | 15.23        | 42.66 |

**Test of Well Yield**

| Pumping test method  | Draw Down |                    | Recovery |                    |
|--|-----------|--------------------|----------|--------------------|
|  | Time min  | Water Level Metres | Time min | Water Level Metres |
| <b>Subpump</b>   |           |                    |          |                    |
| Pump intake set at (metres)  | 37.62     | Static Level 28.6  |          | 41.72              |
| Pumping rate (litres/min)  | 45.50     | 1 5.72             | 1        | 39.29              |
| Duration of pumping (hrs + 0 min)  | 2         | 8.20               | 2        | 37.35              |
| Final water level end of pumping (metres)  | 41.72     | 3 10.17            | 3        | 35.35              |
| Recommended pump type: <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep | 4         | 12.26              | 4        | 38.26              |
| Recommended pump depth (metres)  | 5         | 14.10              | 5        | 37.79              |
| Recommended pump rate (litres/min)   | 10        | 21.89              | 10       | 34.06              |
|  | 15        | 26.88              | 15       | 31.51              |
| If flowing give rate (litres/min)  | 20        | 30.53              | 20       | 30.90              |
|  | 25        | 33.16              | 25       | 34.53              |
| If pumping discontinued, give reason:  | 30        | 34.94              | 30       | 31.53              |
|  | 40        | 37.60              | 40       | 29.34              |
|  | 50        | 40.22              | 50       | 27.92              |
|  | 60        | 41.72              | 60       | 24.48              |

**Plugging and Sealing Record**  Annular space  Abandonment


| Depth set at - Metres From | To    | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
|----------------------------|-------|---|------------------------------|
| 15.23                      | 12.19 | Neat Cement Slurry  | .227                         |
| 12.19                      | 0     | Bentonite Slurry  | .981                         |

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  
 Rotary (conventional)  Air percussion  Jetting  Other  
 Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other  
 Stock  Commercial  Not used  
 Irrigation  Municipal  Cooling & air conditioning

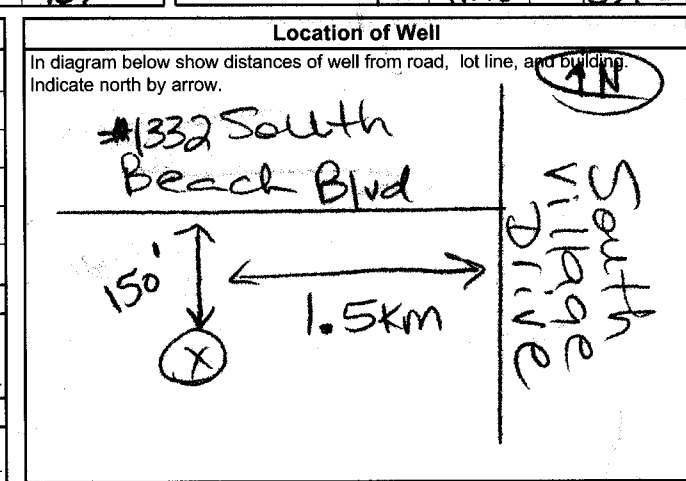

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  
 Observation well  Abandoned, insufficient supply  Dewatering  
 Test Hole  Abandoned, poor quality  Replacement well

**Well Contractor/Technician Information**

Name of Well Contractor: **Air Rock Drilling Co Ltd** Well Contractor's Licence No.: **1119**  
 Business Address (street name, number, city etc.): **RR#1 Richmond Ont K0A2Z0**  
 Name of Well Technician (last name, first name): **Desautniers Ken** Well Technician's Licence No.: **T4**  
 Signature of Technician/Contractor: *[Signature]* Date Submitted: **2006 08 28**

Audit No. **Z 48636** Date Well Completed: **2006 07 27**

Was the well owner's information package delivered?  Yes  No Date Delivered: **2006 08 06**

**Ministry Use Only**

Data Source: Contractor **1119**

Date Received: **SEP 07 2006** Date of Inspection: **2006 08 28**

Remarks: \_\_\_\_\_ Well Record Number: \_\_\_\_\_

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

**Well Owner's Information and Location of Well Information**

| Ministry Use Only |  |  |  |  |  |  |  |  |  |     |     |
|-------------------|--|--|--|--|--|--|--|--|--|-----|-----|
| MUN               |  |  |  |  |  |  |  |  |  | CON | LOT |

RR#/Street Number/Name: **Ottawa-Carleton** **1350 South Beach Blvd**  
 City/Town/Village: **Ussoude** **Greenly**  
 Site/Compartment/Block/Tract, etc.: **4 4** **4M-6655/L114**  
 GPS Reading: NAD **813** Zone **18** Easting **454648** Northing **5012199**  
 Unit Make/Model: **Magellan** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour | Most common material | Other Materials | General Description | Depth Metres |       |
|----------------|----------------------|-----------------|---------------------|--------------|-------|
|                |                      |                 |                     | From         | To    |
|                | Sand & gravel        |                 |                     | 0            | 13.10 |
|                | Grey limestone       |                 |                     | 13.10        | 36.57 |
|                | Grey Sandstone       |                 |                     | 36.57        | 53.33 |

| Hole Diameter |           |                      |
|---------------|-----------|----------------------|
| Depth From    | Metres To | Diameter Centimetres |
| 0             | 53.33     | 15.23                |

| Construction Record        |  |                            |              |       |
|----------------------------|--|----------------------------|--------------|-------|
| Inside diam centimetres    | Material   | Wall thickness centimetres | Depth Metres |       |
|                            |  |                            | From         | To    |
| 15.88                      | <input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass<br><input type="checkbox"/> Plastic <input type="checkbox"/> Concrete<br><input type="checkbox"/> Galvanized | 1.48                       | 0            | 15.84 |
| <b>Casing</b>              |  |                            |              |       |
| <b>Screen</b>              |  |                            |              |       |
| Outside diam               | <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass<br><input type="checkbox"/> Plastic <input type="checkbox"/> Concrete<br><input type="checkbox"/> Galvanized            | Slot No.                   |              |       |
| <b>No Casing or Screen</b> |  |                            |              |       |
|                            |  |                            | 15.23        | 53.33 |

| Test of Well Yield                        |   |                    |          |                    |
|---|---|--------------------|----------|--------------------|
| Pumping test method                       | Draw Down   |                    | Recovery |                    |
|   | Time min  | Water Level Metres | Time min | Water Level Metres |
| <b>SUBPUMP</b>                            |   |                    |          |                    |
| Pump intake set (metres)                  | 48.75   | Static Level       | 10.78    | 21.96              |
| Pumping rate (litres/min)                 | 24.6  | 1                  | 12.73    | 19.60              |
| Duration of pumping                       | 1 hrs + 0 min   | 2                  | 13.7     | 17.18              |
| Final water level end of pumping (metres) | 21.96   | 3                  | 14.38    | 15.08              |
| Recommended pump type                     | <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep | 4                  | 15.0     | 14.17              |
| Recommended pump depth (metres)           | 48.75   | 5                  | 15.45    | 13.08              |
| Recommended pump rate (litres/min)        | 54.60   | 10                 | 17.36    | 11.15              |
| If flowing give rate (litres/min)         |   | 15                 | 18.53    | 10.96              |
|   |   | 20                 | 19.40    | 10.89              |
|   |   | 25                 | 20.08    | 10.87              |
|   |   | 30                 | 20.57    | 10.85              |
|   |   | 40                 | 21.30    | 10.83              |
|   |   | 50                 | 21.63    | 10.80              |
|   |   | 60                 | 21.96    | 10.79              |

| Plugging and Sealing Record |       |   | <input checked="" type="checkbox"/> Annular space | <input type="checkbox"/> Abandonment |
|-----------------------------|-------|---|---|--------------------------------------|
| Depth set at - Metres From  | To    | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres)                      |                                      |
| 15.23                       | 12.19 | Neat Cement Slurry  | .227  |                                      |
| 12.19                       | 0     | Bentonite Slurry  | .735  |                                      |

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  
 Rotary (conventional)  Air percussion  Jetting  Other  
 Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other  
 Stock  Commercial  Not used  
 Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  
 Observation well  Abandoned, insufficient supply  Dewatering  
 Test Hole  Abandoned, poor quality  Replacement well

**Well Contractor/Technician Information**

Name of Well Contractor: **AR ROCK DRILLING Co Ltd** Well Contractor's Licence No.: **1119**  
 Business Address (street name, number, city etc.): **RR#1 RICHMOND ONT K0A2Z0**  
 Name of Well Technician (last name, first name): **Desautniers Ken** Well Technician's Licence No.: **T4**  
 Signature of Technician/Contractor: *[Signature]* Date Submitted: **2006 08 28**

**Location of Well**

In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.

#1350 South Beach Blvd

153' (distance from road)

1.3 km (distance from building)

South Village Drive

Audit No. **Z 48637** Date Well Completed **2006 07 24**  
 Was the well owner's information package delivered?  Yes  No Date Delivered **2006 07 26**

**Ministry Use Only**

Data Source: Contractor **1119**  
 Date Received: **SEP 07 2006** Date of Inspection: **2006 08 28**  
 Remarks: \_\_\_\_\_ Well Record Number: \_\_\_\_\_

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

| Ministry Use Only |  |  |  |  |  |  |  |  |  |     |     |
|-------------------|--|--|--|--|--|--|--|--|--|-----|-----|
| MUN               |  |  |  |  |  |  |  |  |  | CON | LOT |
|                   |  |  |  |  |  |  |  |  |  |     |     |

**Well Owner's Information and Location of Well Information**

RR#/Street Number/Name: Uttawa Carleton #6940 South Village Dr City/Town/Village: Uxbridge Site/Compartment/Block/Tract etc: 4 4

GPS Reading: NAD Zone Easting Northing: 83 18454807 502320 Unit/Make/Model: Mogellan Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour | Most common material     | Other Materials | General Description | Depth Metres |       |
|----------------|--------------------------|-----------------|---------------------|--------------|-------|
|                |                          |                 |                     | From         | To    |
|                | Sand                     |                 |                     | 0            | 5.18  |
|                | Sandy clay, sand, gravel |                 |                     | 5.18         | 10.97 |
|                | Limestone                |                 |                     | 10.97        | 24.99 |

**Hole Diameter**

| Depth Metres | Diameter Centimetres |
|--------------|----------------------|
| 0 to 24.99   | 15.24                |

**Water Record**

Water found at 16.10 m Kind of Water:  Fresh  Sulphur  Gas  Salty  Minerals

Other: TESTED

After test of well yield, water was  Clear and sediment free  Other, specify TESTED

Chlorinated  Yes  No

**Construction Record**

| Inside diam centimetres                       | Material   | Wall thickness centimetres | Depth Metres |       |
|---|--|----------------------------|--------------|-------|
|   |  |                            | From         | To    |
| 15.88   | <input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized | 48                         | 0            | 16.00 |
| <b>Screen</b>                                 |  |                            |              |       |
| Outside diam                                  | <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized            | Slot No.                   |              |       |
| <b>No Casing or Screen</b>                    |  |                            |              |       |
| <input checked="" type="checkbox"/> Open hole |  |                            | 15.39        | 24.99 |

**Test of Well Yield**

| Pumping test method  | Draw Down    |                    | Recovery |                    |
|--|--------------|--------------------|----------|--------------------|
|  | Time min     | Water Level Metres | Time min | Water Level Metres |
| Sub Pump   |              |                    |          |                    |
| Pump intake set at <u>2.33</u> metres  | Static Level | 3.27               |          | 4.85               |
| Pumping rate (litres/min) <u>91</u>  | 1            | 4.36               | 1        | 3.56               |
| Duration of pumping <u>1</u> hrs + <u>0</u> min  | 2            | 4.50               | 2        | 3.51               |
| Final water level at end of pumping <u>4.53</u> metres   | 3            | 4.56               | 3        | 3.46               |
| Recommended pump type: <input checked="" type="checkbox"/> Shallow <input type="checkbox"/> Deep | 4            | 4.60               | 4        | 3.45               |
| Recommended pump depth: <u>0.33</u> metres   | 5            | 4.62               | 5        | 3.44               |
| Recommended pump rate: <u>91</u> (litres/min)  | 10           | 4.70               | 10       | 3.38               |
| If flowing give rate - <u>91</u> (litres/min)  | 15           | 4.72               | 15       | 3.34               |
|  | 20           | 4.74               | 20       | 3.29               |
|  | 25           | 4.75               | 25       | 3.27               |
|  | 30           | 4.76               | 30       |                    |
|  | 40           | 4.77               | 40       |                    |
|  | 50           | 4.80               | 50       |                    |
|  | 60           | 4.85               | 60       |                    |

**Plugging and Sealing Record**  Annular space  Abandonment

| Depth set at - Metres | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
|-----------------------|---|------------------------------|
| 15.39 to 12.34        | Neat Cement Slurry  | 1.816                        |
| 12.34 to 0            | bentonite Slurry  | 0.858                        |

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging

Rotary (conventional)  Air percussion  Jetting  Other

Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other

Stock  Commercial  Not used

Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)

Observation well  Abandoned, insufficient supply  Dewatering

Test Hole  Abandoned, poor quality  Replacement well


**Well Contractor/Technician Information**

Name of Well Contractor: AIR ROCK DRILLING CO LTD Well Contractor's Licence No.: 1119

Business Address (street name, number, city etc.): RR#1 RICHMOND ONT K0A2Z0

Name of Well Technician (last name, first name): Desautiers Ken Well Technician's Licence No.: 14

Signature of Technician/Contractor: [Signature] Date Submitted: 2006 08 28

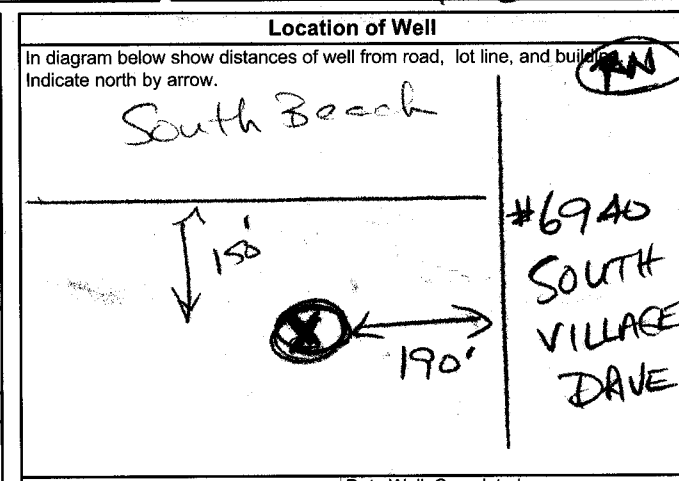

Audit No. Z 48610 Date Well Completed: 2006 07 28

Was the well owner's information package delivered?  Yes  No Date Delivered: 2006 08 01

**Ministry Use Only**

Data Source: Contractor 1119

Date Received: SEP 07 2006 Date of Inspection: 2006 08 01

Remarks: \_\_\_\_\_ Well Record Number: \_\_\_\_\_

**Instructions for Completing Form**

- For use in the Province of Ontario only. This document is a permanent legal document. Please retain for future reference.
- All Sections must be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.
- Please print clearly in blue or black ink only.

| Ministry Use Only |  |  |  |  |  |  |  |  |  |     |  |  |  |  |  |  |  |  |  |  |     |
|-------------------|--|--|--|--|--|--|--|--|--|-----|--|--|--|--|--|--|--|--|--|--|-----|
| MUN               |  |  |  |  |  |  |  |  |  | CON |  |  |  |  |  |  |  |  |  |  | LOT |

**Well Owner's Information and Location of Well Information**

Ottawa - Carleton / 4590000 / 4 / 4  
 RR#/Street Number/Name: #1362 South Beach Blvd / City/Town/Village: Greely / Site/Compartment/Block/Tract etc: Plan 4M-1065/1416  
 GPS Reading: NAD 83 / Zone 18 / Easting 454725 / Northing 5012231 / UTM Make/Model: Mogellan / Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour | Most common material | Other Materials | General Description | Depth Metres |       |
|----------------|----------------------|-----------------|---------------------|--------------|-------|
|                |                      |                 |                     | From         | To    |
|                | Sandy clay           |                 |                     | 0            | 2.74  |
|                | Sand & gravel        |                 |                     | 2.74         | 13.11 |
|                | Limestone            |                 |                     | 13.11        | 46.02 |
|                | Sandstone            |                 |                     | 46.02        | 56.69 |

**Hole Diameter**

| Depth From | Metres To | Diameter Centimetres |
|------------|-----------|----------------------|
| 0          | 56.69     | 152.3                |

**Water Record**

Water found at: 54.25 Metres / Kind of Water: Fresh / Sulphur / Gas / Salt / Minerals / Other: TESTED

After test of well yield, water was: Clear and sediment free / Other, specify: TESTED

Chlorinated:  Yes  No

**Construction Record**

| Inside diam centimetres | Material   | Wall thickness centimetres | Depth From | Metres To |
|-------------------------|--|----------------------------|------------|-----------|
| 15.88                   | Steel <input checked="" type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized <input type="checkbox"/> | .48                        | 0          | 15.54     |

**Screen**

| Outside diam | Material  | Slot No. |
|--------------|---|----------|
|              | Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized <input type="checkbox"/> |          |

**No Casing or Screen**


Open hole / 14.93 / 56.69

**Test of Well Yield**

| Pumping test method                       | Draw Down |                    | Recovery |                    |
|---|-----------|--------------------|----------|--------------------|
|   | Time min  | Water Level Metres | Time min | Water Level Metres |
| Sublump                                   |           |                    |          |                    |
| Pump intake set at (metres)               | 51.81     | Static Level       | 10.37    | 14.80              |
| Pumping rate (litres/min)                 | 91        | 1                  | 11.01    |                    |
| Duration of pumping (hrs + min)           | 1         | 0                  | 2        | 10.70              |
| Final water level and of pumping (metres) | 14.80     | 3                  | 10.57    |                    |
| Recommended pump type                     | 4         | 14.10              | 4        | 10.53              |
| Recommended pump depth (metres)           | 36.37     | 5                  | 10.52    |                    |
| Recommended pump rate (litres/min)        | 91        | 10                 | 10.46    |                    |
| If flowing give rate (litres/min)         | 20        | 14.68              | 20       | 10.37              |
| If pumping discontinued, give reason      | 30        | 14.75              | 30       |                    |
|   | 40        | 14.77              | 40       |                    |
|   | 50        | 14.78              | 50       |                    |
|   | 60        | 14.80              | 60       |                    |

**Plugging and Sealing Record**

| Depth set at - Metres From | To    | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
|----------------------------|-------|---|------------------------------|
| 14.93                      | 11.89 | Neat Cement Slurry  | .227                         |
| 11.89                      | 0     | Bentonite Slurry  | .735                         |

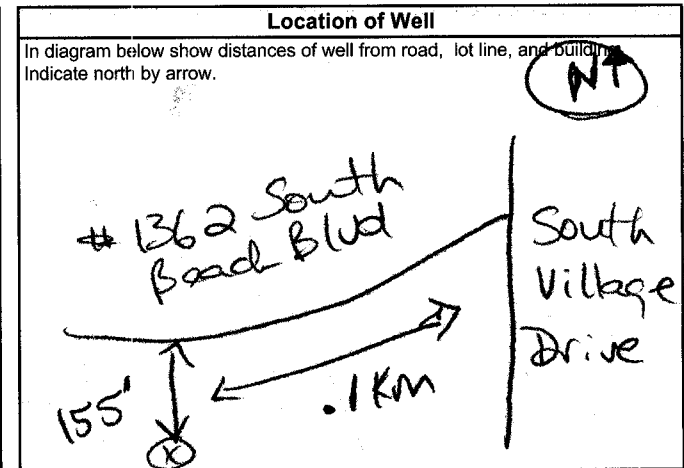

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  Rotary (conventional)  Air percussion  Jetting  Other  Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other  Stock  Commercial  Not used  Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  Observation well  Abandoned, insufficient supply  Dewatering  Test Hole  Abandoned, poor quality  Replacement well

Audit No. **z 48653** / Date Well Completed **2006 09 05**

Was the well owner's information package delivered?  Yes  No / Date Delivered **2006 09 06**

**Well Contractor/Technician Information**

Name of Well Contractor: **AIR ROCK DRILLING CO LTD** / Well Contractor's Licence No.: **1119**

Business Address (street name, number, city etc.): **RR#1 RICHMOND ONT K0A2Z0**

Name of Well Technician (last name, first name): **MURCELL STANNOW** / Well Technician's Licence No.: **T2122**

Signature of Technician/Contractor: *[Signature]* / Date Submitted: **2006 09 07**

**Ministry Use Only**

Data Source: Contractor **1119**

Date Received: **OCT 11 2006** / Date of Inspection: YYY MM DD

Remarks: / Well Record Number:

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

**Well Owner's Information and Location of Well Information**

| Ministry Use Only |  |  |  |  |  |  |  |  |  |     |  |  |  |  |  |  |  |  |  |     |
|-------------------|--|--|--|--|--|--|--|--|--|-----|--|--|--|--|--|--|--|--|--|-----|
| MUN               |  |  |  |  |  |  |  |  |  | CON |  |  |  |  |  |  |  |  |  | LOT |

City/Town/Village: **City of Ottawa** / **City of Ottawa Osgoode 112**  
 RR#/Street Number/Name: **1338 South Beach DR.**  
 City/Town/Village: **GREELY** / Site/Compartment/Block/Tract etc.: **Plan HM 1265**  
 GPS Reading: NAD **83** Zone **18** Easting **454616E** Northing **5012160** Unit Make/Model: **Magellan utm** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour | Most common material | Other Materials | General Description | Depth Metres |       |
|----------------|----------------------|-----------------|---------------------|--------------|-------|
|                |                      |                 |                     | From         | To    |
| yellow         | sand                 |                 | Soft                | 0            | 3.10  |
| grey           | sand                 |                 | Soft                | 3.10         | 10.97 |
| grey           | gravel               |                 | Packed              | 10.97        | 13.41 |
| red            | illite shale         |                 | layered             | 13.41        | 42.67 |
| purple         | sandstone            |                 | Hard                | 42.67        | 48.76 |

**Hole Diameter**

| Depth From | Metres To | Diameter Centimetres |
|------------|-----------|----------------------|
| 0          | 14.63     | 2123                 |
| 14.63      | 48.76     | 1555                 |

**Water Record**

Water found at: **4.4** m / Kind of Water:  Fresh  Sulphur  Gas  Salty  Minerals

After test of well yield, water was  Clear and sediment free  Other, specify

Chlorinated:  Yes  No

**Construction Record**

| Inside diam centimetres | Material   | Wall thickness centimetres | Depth From | Metres To |
|-------------------------|--|----------------------------|------------|-----------|
| 1555                    | <input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized | 0.48                       | 14.63      | 14.63     |

**Screen**

| Outside diam | Material  | Slot No. |
|--------------|---|----------|
|              | <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized |          |

**No Casing or Screen**

Open hole

14.63 48.76

**Test of Well Yield**

| Pumping test method   | Draw Down |                    | Recovery |                    |
|---|-----------|--------------------|----------|--------------------|
|   | Time min  | Water Level Metres | Time min | Water Level Metres |
| Pump intake set at - (metres) <b>30</b>   |           | <b>7.17</b>        |          | <b>10.17</b>       |
| Pumping rate - (litres/min) <b>40</b>   | 1         | <b>8.12</b>        | 1        | <b>9.72</b>        |
| Duration of pumping <b>1</b> hrs + <b>0</b> min   | 2         | <b>8.40</b>        | 2        | <b>9.37</b>        |
| Final water level end of pumping <b>10.17</b> metres  | 3         | <b>8.46</b>        | 3        | <b>9.16</b>        |
| Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep | 4         | <b>8.67</b>        | 4        | <b>8.99</b>        |
| Recommended pump depth <b>30</b> metres   | 5         | <b>8.70</b>        | 5        | <b>8.90</b>        |
| Recommended pump rate <b>40</b> (litres/min)  | 10        | <b>8.86</b>        | 10       | <b>8.33</b>        |
| If flowing give rate - (litres/min)   | 15        | <b>9.32</b>        | 15       | <b>8.62</b>        |
|   | 20        | <b>9.60</b>        | 20       | <b>7.87</b>        |
|   | 25        | <b>9.79</b>        | 25       | <b>7.72</b>        |
| If pumping discontinued, give reason.   | 30        | <b>9.79</b>        | 30       | <b>7.62</b>        |
|   | 40        | <b>9.96</b>        | 40       | <b>7.2</b>         |
|   | 50        | <b>10.10</b>       | 50       | <b>-</b>           |
|   | 60        | <b>10.17</b>       | 60       | <b>-</b>           |

**Plugging and Sealing Record**  Annular space  Abandonment

| Depth set at - Metres From | To    | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
|----------------------------|-------|---|------------------------------|
| 0                          | 14.63 | <b>neat P slurry</b>  | <b>11 bags</b>               |

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  Rotary (conventional)  Air percussion  Jetting  Other  Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other  Stock  Commercial  Not used  Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  Observation well  Abandoned, insufficient supply  Dewatering  Test Hole  Abandoned, poor quality  Replacement well

**Location of Well**

In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.

Audit No. **Z 52056** Date Well Completed **06/11/21**

Was the well owner's information package delivered?  Yes  No

**Well Contractor/Technician Information**

Name of Well Contractor: **Giles Bourgeois** Well Contractor's Licence No. **1414**

Business Address (street name, number, city etc.): **57A 16th Ave**

Name of Well Technician (last name, first name): **Alan Bourgeois** Well Technician's Licence No. **2710**

Signature of Technician/Contractor: **Alan Bourgeois** Date Submitted **06/11/21**

**Ministry Use Only**

Data Source: **1414** Contractor

Date Received: **JAN 25 2007** MM DD Date of Inspection: **06/11/21** YYYY MM DD

Remarks: \_\_\_\_\_ Well Record Number: \_\_\_\_\_



Instructions for Completing Form

- For use in the Province of Ontario only. This document is a permanent legal document. Please retain for future reference. All Sections must be completed in full to avoid delays in processing. Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203. All metre measurements shall be reported to 1/10th of a metre. Please print clearly in blue or black ink only.

Ministry Use Only

Address of well location (County/District/Municipality) City of Ottawa, Township 05900de, Lot 113, Concession, RR# Street Number/Name 1344 South Beach DR, City/Town/Village GREELY, Site/Compartment/Block/Tract, etc. Plan 4M1265, GPS Reading NAD 83, Zone 18, Easting 454626 E, Northing 5012175, Unit Make/Model Magellan, Mode of Operation 4m

Log of Overburden and Bedrock Materials (see instructions)

Table with columns: General Colour, Most common material, Other Materials, General Description, Depth From, Metres To. Includes handwritten entries for sand, gravel, limestone, and sandstone.


Hole Diameter table with columns: Depth From, Metres To, Diameter Centimetres. Includes handwritten data for 0-14.63m and 14.63-48.68m.

Construction Record table with columns: Inside diam centimetres, Material, Wall thickness centimetres, Depth From, Metres To. Includes handwritten data for casing and screen.

Test of Well Yield table with columns: Pumping test method, Draw Down, Recovery. Includes handwritten data for 3 H.P. pump and various pumping rates.

Water Record section with fields for Water found at, Kind of Water, Chlorinated status, and After test of well yield.

Plugging and Sealing Record table with columns: Depth set at - Metres, Material and type, Volume Placed. Includes handwritten entry for pressure grout cement.

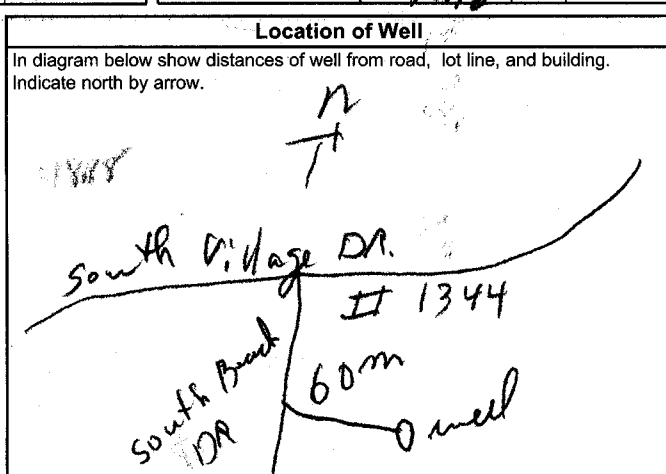

Method of Construction, Water Use, and Final Status of Well sections with checkboxes for various options.

Audit No. Z 52057, Date Well Completed 06/11/22, and package delivered status.

Well Contractor/Technician Information section with fields for Name, Address, Licence No., and Signature.

Ministry Use Only section with fields for Data Source, Date Received, Date of Inspection, and Well Record Number.



**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

**Ministry Use Only**

Address of well Location (County/District/Municipality) **Ottawa - Carleton** Township **Osgoode** Lot **4** Concession **4**  
 RR#/Street Number/Name **1368 South Beach Blvd** City/Town/Village **Greely** Site/Compartment/Block/Tract etc. **4M-1263 S/L 117**  
 GPS Reading NAD Zone Easting Northing Unit Make/Model Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour | Most common material | Other Materials | General Description | Depth |           |
|----------------|----------------------|-----------------|---------------------|-------|-----------|
|                |                      |                 |                     | From  | Metres To |
|                | Sand                 |                 |                     | 0     | 12.50     |
|                | Grey Limestone       |                 |                     | 12.50 | 45.72     |
|                | White Sandstone      |                 |                     | 45.72 | 48.77     |

**Hole Diameter**

| Depth | Metres | Diameter    |
|-------|--------|-------------|
| From  | To     | Centimetres |
| 0     | 48.77  | 14.91       |

**Water Record**

Water found at **17.81** m / Kind of Water **NOT TESTED**

Fresh  Sulphur  Gas  Salty  Minerals  Other: **NOT TESTED**

Fresh  Sulphur  Gas  Salty  Minerals  Other: **NOT TESTED**

After test of well yield, water was **clear and sediment free** **NOT TESTED**

Chlorinated  Yes  No

**Construction Record**


| Inside diam centimetres    | Material   | Wall thickness centimetres | Depth |           |
|----------------------------|--|----------------------------|-------|-----------|
|                            |  |                            | From  | Metres To |
| <b>Casing</b>              |  |                            |       |           |
| 15.88                      | <input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized | .48                        | 0     | 14.93     |
| <b>Screen</b>              |  |                            |       |           |
| <b>No Casing or Screen</b> |  |                            |       |           |
|                            | <input checked="" type="checkbox"/> Open hole  |                            | 14.32 | 48.77     |

**Test of Well Yield**

| Pumping test method                       | Draw Down |                           | Recovery |                    |
|---|-----------|---------------------------|----------|--------------------|
|   | Time min  | Water Level Metres        | Time min | Water Level Metres |
| <b>Sub Pump</b>                           |           |                           |          |                    |
| Pump intake set at (metres)               |           | Static Level <b>10.40</b> |          | <b>13.44</b>       |
| Pumping rate (litres/min)                 | 1         | <b>11.73</b>              | 1        | <b>11.40</b>       |
| Duration of pumping                       | 2         | <b>12.14</b>              | 2        | <b>11.32</b>       |
| Final water level end of pumping (metres) | 3         | <b>12.35</b>              | 3        | <b>11.16</b>       |
| Recommended pump type                     | 4         | <b>12.47</b>              | 4        | <b>11.08</b>       |
| Recommended pump depth (metres)           | 5         | <b>12.63</b>              | 5        | <b>10.99</b>       |
| Recommended pump rate (litres/min)        | 10        | <b>12.73</b>              | 10       | <b>10.80</b>       |
| If flowing give rate (litres/min)         | 15        | <b>13.10</b>              | 15       | <b>10.63</b>       |
|   | 20        | <b>13.20</b>              | 20       | <b>10.57</b>       |
|   | 25        | <b>13.24</b>              | 25       | <b>10.51</b>       |
|   | 30        | <b>13.28</b>              | 30       | <b>10.45</b>       |
|   | 40        | <b>13.43</b>              | 40       | <b>10.40</b>       |
|   | 50        | <b>13.43</b>              | 50       |                    |
|   | 60        | <b>13.44</b>              | 60       |                    |

**Plugging and Sealing Record**  Annular space  Abandonment

| Depth set at - Metres | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
|-----------------------|---|------------------------------|
| From To               |   |                              |
| 14.32 11.28           | Neat Cement Slurry  | .1362                        |
| 11.28 0               | Bentonite Slurry  | .613                         |

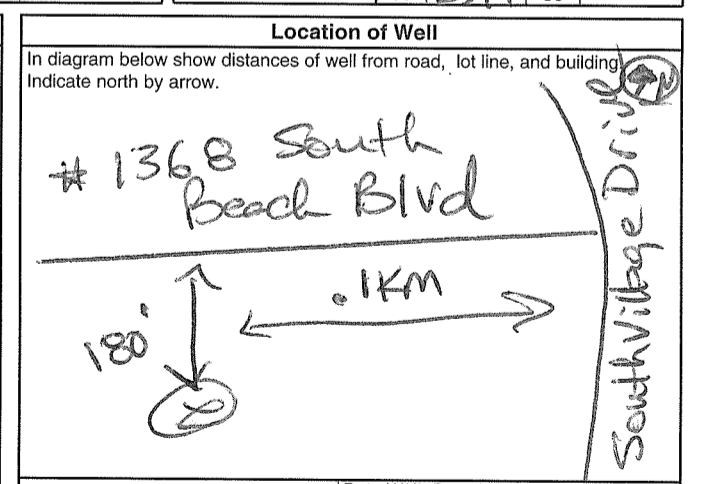

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  Rotary (conventional)  Air percussion  Jetting  Other  Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other  Stock  Commercial  Not used  Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  Observation well  Abandoned, insufficient supply  Dewatering  Test Hole  Abandoned, poor quality  Replacement well

Audit No. **Z 55596** Date Well Completed **2007 01 05**

Was the well owner's information package delivered?  Yes  No Date Delivered **2007 01 12**

**Well Contractor/Technician Information**

Name of Well Contractor **HR Back Drilling Ltd 1119** Well Contractor's Licence No. **3058**  
 Business Address (street name, number, city etc.) **RR1 RICHMOND ONT K0A2Z0**  
 Name of Well Technician (last name, first name) **TOSAN DAN** Well Technician's Licence No. **3058**  
 Signature of Technician/Contractor **[Signature]** Date Submitted **2007 01 05**

**Ministry Use Only**

Data Source Contractor **1119**

Date Received **FEB 12 2007** Date of Inspection **2007 01 05**

Remarks Well Record Number

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

**Ministry Use Only**

Address of Well Location (County/District/Municipality) Ottawa-Carleton Township Osgoode Lot 4 Concession 4  
 RR#/Street Number/Name #6892 Lake Forest Walk City/Town/Village Greely Site/Compartment/Block/Tract/etc. Plan 4M-1265-1L27  
 GPS Reading NAD 83 Zone 18 Easting 454770 Northing 5012405 Unit Make/Model Mazda Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify \_\_\_\_\_

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour | Most common material | Other Materials | General Description | Depth Metres |              |
|----------------|----------------------|-----------------|---------------------|--------------|--------------|
|                |                      |                 |                     | From         | To           |
|                | <u>Sand Gravel</u>   |                 |                     | <u>0</u>     | <u>12.50</u> |
|                | <u>Limestone</u>     |                 |                     | <u>12.50</u> | <u>54.86</u> |

**Hole Diameter**

| Depth From | Metres To    | Diameter Centimetres |
|------------|--------------|----------------------|
| <u>0</u>   | <u>54.86</u> | <u>14.91</u>         |

**Water Record**

Water found at 36.10 Metres Kind of Water  Fresh  Sulphur  Gas  Salty  Minerals  Other: \_\_\_\_\_

45 m  Fresh  Sulphur  Gas  Salty  Minerals  Other: \_\_\_\_\_

After test of well yield, water was  Clear and sediment free  Other, specify NOT TESTED

Chlorinated  Yes  No

**Construction Record**

| Inside diam centimetres | Material   | Wall thickness centimetres | Depth Metres |              |
|-------------------------|--|----------------------------|--------------|--------------|
|                         |  |                            | From         | To           |
| <u>15.88</u>            | <input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized | <u>.48</u>                 | <u>0</u>     | <u>14.93</u> |

**Screen**

| Outside diam | Material  | Slot No. |
|--------------|---|----------|
|              | <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized |          |

**No Casing or Screen**

Open hole 14.32 54.86

**Test of Well Yield**

| Pumping test method   | Draw Down    |                    | Recovery |                    |
|---|--------------|--------------------|----------|--------------------|
|   | Time min     | Water Level Metres | Time min | Water Level Metres |
| <u>Sub Pump</u>   |              |                    |          |                    |
| Pump intake set at (metres) <u>43.17</u>  | Static Level | <u>10.61</u>       |          | <u>21.27</u>       |
| Pumping rate (litres/min) <u>24.07</u>  | 1            | <u>12.70</u>       | 1        | <u>17.50</u>       |
| Duration of pumping (hrs + 0 min) <u>1</u>  | 2            | <u>13.27</u>       | 2        | <u>15.30</u>       |
| Final water level and of pumping (metres) <u>21.27</u>  | 3            | <u>13.78</u>       | 3        | <u>14.79</u>       |
| Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep | 4            | <u>14.17</u>       | 4        | <u>12.90</u>       |
| Recommended pump depth (metres) <u>43.17</u>  | 5            | <u>14.50</u>       | 5        | <u>12.37</u>       |
| Recommended pump rate (litres/min) <u>24.07</u>   | 10           | <u>16.07</u>       | 10       | <u>11.07</u>       |
| If flowing give rate (litres/min) <u>24.07</u>  | 15           | <u>17.00</u>       | 15       | <u>10.61</u>       |
| If pumping discontinued, give reason.   | 20           | <u>17.78</u>       | 20       |                    |
|   | 25           | <u>18.51</u>       | 25       |                    |
|   | 30           | <u>19.00</u>       | 30       |                    |
|   | 40           | <u>19.92</u>       | 40       |                    |
|   | 50           | <u>20.73</u>       | 50       |                    |
|   | 60           | <u>21.27</u>       | 60       |                    |

**Plugging and Sealing Record**

| Depth set at - Metres From | To           | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
|----------------------------|--------------|---|------------------------------|
| <u>14.32</u>               | <u>11.28</u> | <u>Neat Cement Slurry</u>                                     | <u>.227</u>                  |
| <u>11.28</u>               | <u>0</u>     | <u>Bentonite Slurry</u>                                       | <u>.490</u>                  |

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  Rotary (conventional)  Air percussion  Jetting  Other  Rotary (reverse)  Boring  Driving

**Water Use**


Domestic  Industrial  Public Supply  Other  Stock  Commercial  Not used  Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  Observation well  Abandoned, insufficient supply  Dewatering  Test Hole  Abandoned, poor quality  Replacement well

**Well Contractor/Technician Information**

Name of Well Contractor Aircock Drilling Co Ltd Well Contractor's Licence No. 1119  
 Business Address (street name, number, city etc.) RR#1 RICHMOND ONT K0A2Z0  
 Name of Well Technician (last name, first name) PURCELL SHANNON Well Technician's Licence No. 12122  
 Signature of Technician/Contractor [Signature] Date Submitted 2007 01 28

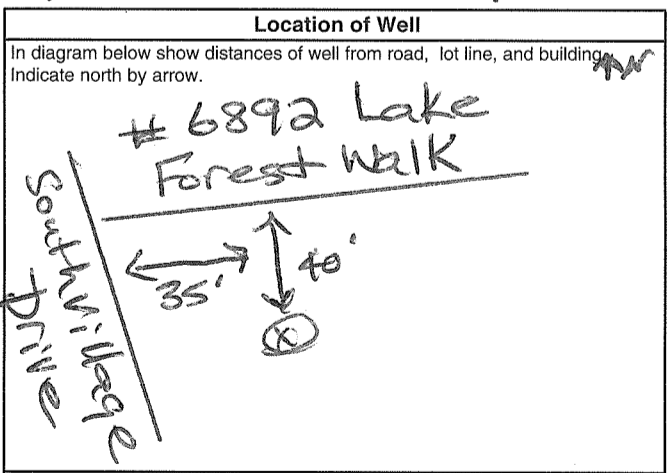

Audit No. Z 55551 Date Well Completed 2006 11 23  
 Was the well owner's information package delivered?  Yes  No Date Delivered 2006 11 27

**Ministry Use Only**

Data Source \_\_\_\_\_ Contractor 1119  
 Date Received FEB 12 2007 Date of Inspection \_\_\_\_\_  
 Remarks \_\_\_\_\_ Well Record Number \_\_\_\_\_

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

**Ministry Use Only**

Address of well location (County/District/Municipality) **Ottawa-Carleton** Township **Osgoode** Lot **4** Concession **4**  
 RR#/Street Number/Name **#1369 South Beach Blvd** City/Town/Village **Greely** Site/Compartment/Block/Tract etc. **Plan 4M-1265 S/L81**  
 GPS Reading NAD **83** Zone **18** Easting **454682** Northing **5012330** Unit/Make/Model **Nagellon** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour | Most common material   | Other Materials | General Description | Depth |       |
|----------------|------------------------|-----------------|---------------------|-------|-------|
|                |                        |                 |                     | From  | To    |
|                | Till                   |                 |                     | 0     | 1.52  |
|                | Sand, Gravel, boulders |                 |                     | 1.52  | 13.11 |
|                | Limestone              |                 |                     | 13.11 | 38.10 |
|                | Sandstone              |                 |                     | 38.10 | 94.48 |

**Hole Diameter**

| Depth | Metres | Diameter    |
|-------|--------|-------------|
| From  | To     | Centimetres |
| 0     | 79.24  | 14.91       |
| 79.24 | 94.48  | 14.59       |

**Water Record**

Water found at **0.83** m Kind of Water **NOT TESTED**

Gas  Sulphur  Minerals

After test of well yield, water was **NOT TESTED**

Chlorinated  Yes  No

**Construction Record**


| Inside diam centimetres                       | Material   | Wall thickness centimetres | Depth |       |
|---|--|----------------------------|-------|-------|
|   |  |                            | From  | To    |
| 15.88   | Steel <input checked="" type="checkbox"/> Fibreglass <input type="checkbox"/><br>Plastic <input type="checkbox"/> Concrete <input type="checkbox"/><br>Galvanized <input type="checkbox"/> | 480                        | 0     | 15.54 |
| <b>Screen</b>                                 |  |                            |       |       |
| Outside diam                                  | Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/><br>Plastic <input type="checkbox"/> Concrete <input type="checkbox"/><br>Galvanized <input type="checkbox"/>            | Slot No.                   |       |       |
| <b>No Casing or Screen</b>                    |  |                            |       |       |
| <input checked="" type="checkbox"/> Open hole |  |                            | 14.93 | 94.48 |

**Test of Well Yield**

| Pumping test method                | Draw Down    |                    | Recovery |                    |
|------------------------------------|--------------|--------------------|----------|--------------------|
|                                    | Time min     | Water Level Metres | Time min | Water Level Metres |
| <b>Sub Pump</b>                    |              |                    |          |                    |
| Pump intake set (metres)           | Static Level | 11.90              |          | 13.74              |
| Pumping rate (litres/min)          | 1            | 13.15              | 1        | 11.97              |
| Duration of pumping                | 2            | 13.40              | 2        | 11.90              |
| Final water level end of pumping   | 3            | 13.50              | 3        |                    |
| Recommended pump type              | 4            | 13.54              | 4        |                    |
| Recommended pump depth             | 5            | 13.57              | 5        |                    |
| Recommended pump rate (litres/min) | 10           | 13.65              | 10       |                    |
| If flowing give rate (litres/min)  | 15           | 13.69              | 15       |                    |
|                                    | 20           | 13.72              | 20       |                    |
|                                    | 25           | 13.74              | 25       |                    |
|                                    | 30           | 13.74              | 30       |                    |
|                                    | 40           | 13.74              | 40       |                    |
|                                    | 50           | 13.74              | 50       |                    |
|                                    | 60           | 13.74              | 60       |                    |

**Plugging and Sealing Record**  Annular space  Abandonment

| Depth set at - Metres | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
|-----------------------|---|------------------------------|
| From                  | To  |                              |
| 14.93                 | 11.87 Neat Cement Slurry                                      | 0.227                        |
| 11.87                 | 0 Bentonite Slurry  | 1.10                         |

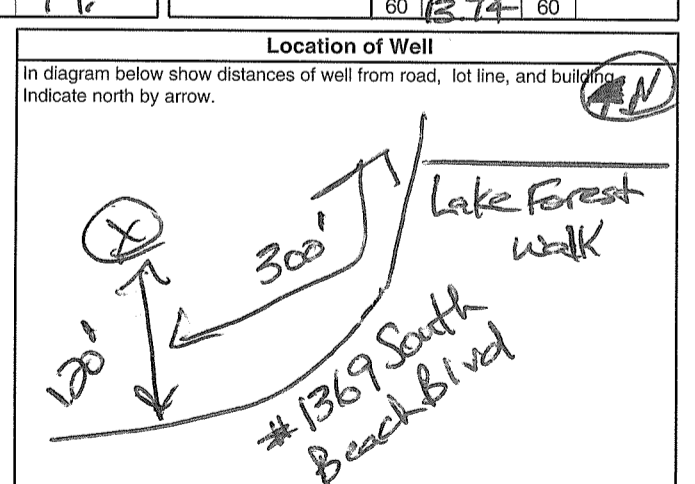

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging

Rotary (conventional)  Air percussion  Jetting  Other

Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other

Stock  Commercial  Not used

Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)

Observation well  Abandoned, insufficient supply  Dewatering

Test Hole  Abandoned, poor quality  Replacement well

Audit No. **Z 64799** Date Well Completed **2007 03 17**

Was the well owner's information package delivered?  Yes  No Date Delivered **2007 05 20**

**Well Contractor/Technician Information**

Name of Well Contractor **AIR ROCK DRILLING CO LTD** Well Contractor's Licence No. **1119**

Business Address (street name, number, city etc.) **RR#1 RICHMOND ONT K0A2Z0**

Name of Well Technician (last name, first name) **Desaulniers Ken** Well Technician's Licence No. **14**

Signature of Technician/Contractor **x Ken Desaulniers** Date Submitted **2007 03 20**

**Ministry Use Only**

Data Source Contractor **1119**

Date Received **APR 11 2007** Date of Inspection **YYYY MM DD**

Remarks Well Record Number

**A055252**

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

**Well Owner's Information and Location of Well Information**

| Ministry Use Only |  |  |  |     |  |  |  |     |  |  |
|-------------------|--|--|--|-----|--|--|--|-----|--|--|
| MUN               |  |  |  | CON |  |  |  | LOT |  |  |

RR#/Street Number/Name: **#1374 South Beach Blvd** City/Town/Village: **Greely** Site/Compartment/Block/Tract/etc.: **Plan 4M-1265 5/L118**

GPS Reading: **8.3** NAD Zone: **18** Easting: **454767** Northing: **5012263** Unit Make/Model: **Mogellan** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify

**Log of Overburden and Bedrock Materials (see instructions)**

| General Colour | Most common material         | Other Materials | General Description | Depth Metres |              |
|----------------|------------------------------|-----------------|---------------------|--------------|--------------|
|                |                              |                 |                     | From         | To           |
|                | <b>Sand Gravel, Boulders</b> |                 |                     | <b>0</b>     | <b>12.19</b> |
|                | <b>Grey Limestone</b>        |                 |                     | <b>12.19</b> | <b>42.97</b> |
|                | <b>White Sandstone</b>       |                 |                     | <b>42.97</b> | <b>48.77</b> |

**Hole Diameter**

| Depth From | Metres To    | Diameter Centimetres |
|------------|--------------|----------------------|
| <b>0</b>   | <b>48.77</b> | <b>15.55</b>         |

**Water Record**

Water found at **45.72** m Kind of Water:  Fresh  Sulphur  Gas  Salty  Minerals  Other: **NOT TESTED**

Water found at **46.63** m Kind of Water:  Fresh  Sulphur  Gas  Salty  Minerals  Other: **TESTED**

After test of well yield, water was  Clear and sediment free  Other: **TESTED**

Chlorinated  Yes  No

**Construction Record**

| Inside diam centimetres                       | Material   | Wall thickness centimetres | Depth Metres |              |
|---|--|----------------------------|--------------|--------------|
|   |  |                            | From         | To           |
| <b>15.88</b>                                  | <input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized | <b>.48</b>                 | <b>0</b>     | <b>15.24</b> |
| <b>Screen</b>                                 |  |                            |              |              |
| Outside diam                                  | <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized            | Slot No.                   |              |              |
| <b>No Casing or Screen</b>                    |  |                            |              |              |
| <input checked="" type="checkbox"/> Open hole |  |                            | <b>14.63</b> | <b>48.77</b> |

**Test of Well Yield**

| Pumping test method   | Draw Down    |                    | Recovery |                    |
|---|--------------|--------------------|----------|--------------------|
|   | Time min     | Water Level Metres | Time min | Water Level Metres |
| <b>Sub Pump</b>   |              |                    |          |                    |
| Pump intake set at (metres) <b>42.57</b>  | Static Level | <b>9.46</b>        |          | <b>12.27</b>       |
| Pumping rate (litres/min) <b>91</b>   | 1            | <b>11.15</b>       | 1        | <b>10.53</b>       |
| Duration of pumping <b>0</b> hrs + <b>0</b> min   | 2            | <b>11.44</b>       | 2        | <b>10.53</b>       |
| Final water level end of pumping (metres) <b>12.27</b>  | 3            | <b>11.58</b>       | 3        | <b>10.52</b>       |
| Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep | 4            | <b>11.68</b>       | 4        | <b>10.51</b>       |
| Recommended pump depth (metres) <b>42.57</b>  | 5            | <b>11.76</b>       | 5        | <b>10.45</b>       |
| Recommended pump rate (litres/min) <b>91</b>  | 10           | <b>11.97</b>       | 10       | <b>10.38</b>       |
| If flowing give rate - (litres/min)   | 15           | <b>12.06</b>       | 15       | <b>10.19</b>       |
|   | 20           | <b>12.12</b>       | 20       | <b>10.12</b>       |
|   | 25           | <b>12.15</b>       | 25       | <b>10.11</b>       |
| If pumping discontinued, give reason.   | 30           | <b>12.17</b>       | 30       | <b>10.09</b>       |
|   | 40           | <b>12.21</b>       | 40       | <b>10.09</b>       |
|   | 50           | <b>12.24</b>       | 50       | <b>10.08</b>       |
|   | 60           | <b>12.27</b>       | 60       | <b>10.08</b>       |

**Plugging and Sealing Record**  Annular space  Abandonment

| Depth set at - Metres From | To           | Material and type (bentonite slurry, neat cement slurry) etc. | Volume Placed (cubic metres) |
|----------------------------|--------------|---|------------------------------|
| <b>14.63</b>               | <b>11.58</b> | <b>Neat Cement Slurry</b>                                     | <b>.227</b>                  |
| <b>11.58</b>               | <b>0</b>     | <b>Bentonite Slurry</b>                                       | <b>.490</b>                  |

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  Rotary (conventional)  Air percussion  Jetting  Other  Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other  Stock  Commercial  Not used  Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  Observation well  Abandoned, insufficient supply  Dewatering  Test Hole  Abandoned, poor quality  Replacement well


**Well Contractor/Technician Information**

Name of Well Contractor: **AIR ROCK DRILLING CO LTD** Well Contractor's Licence No.: **1119**

Business Address (street name, number, city etc.): **RR#1 RICHMOND ONT K0A2Z0**

Name of Well Technician (last name, first name): **PURCELL STAMMANN** Well Technician's Licence No.: **T2122**

Date Submitted: **2007 08 21**

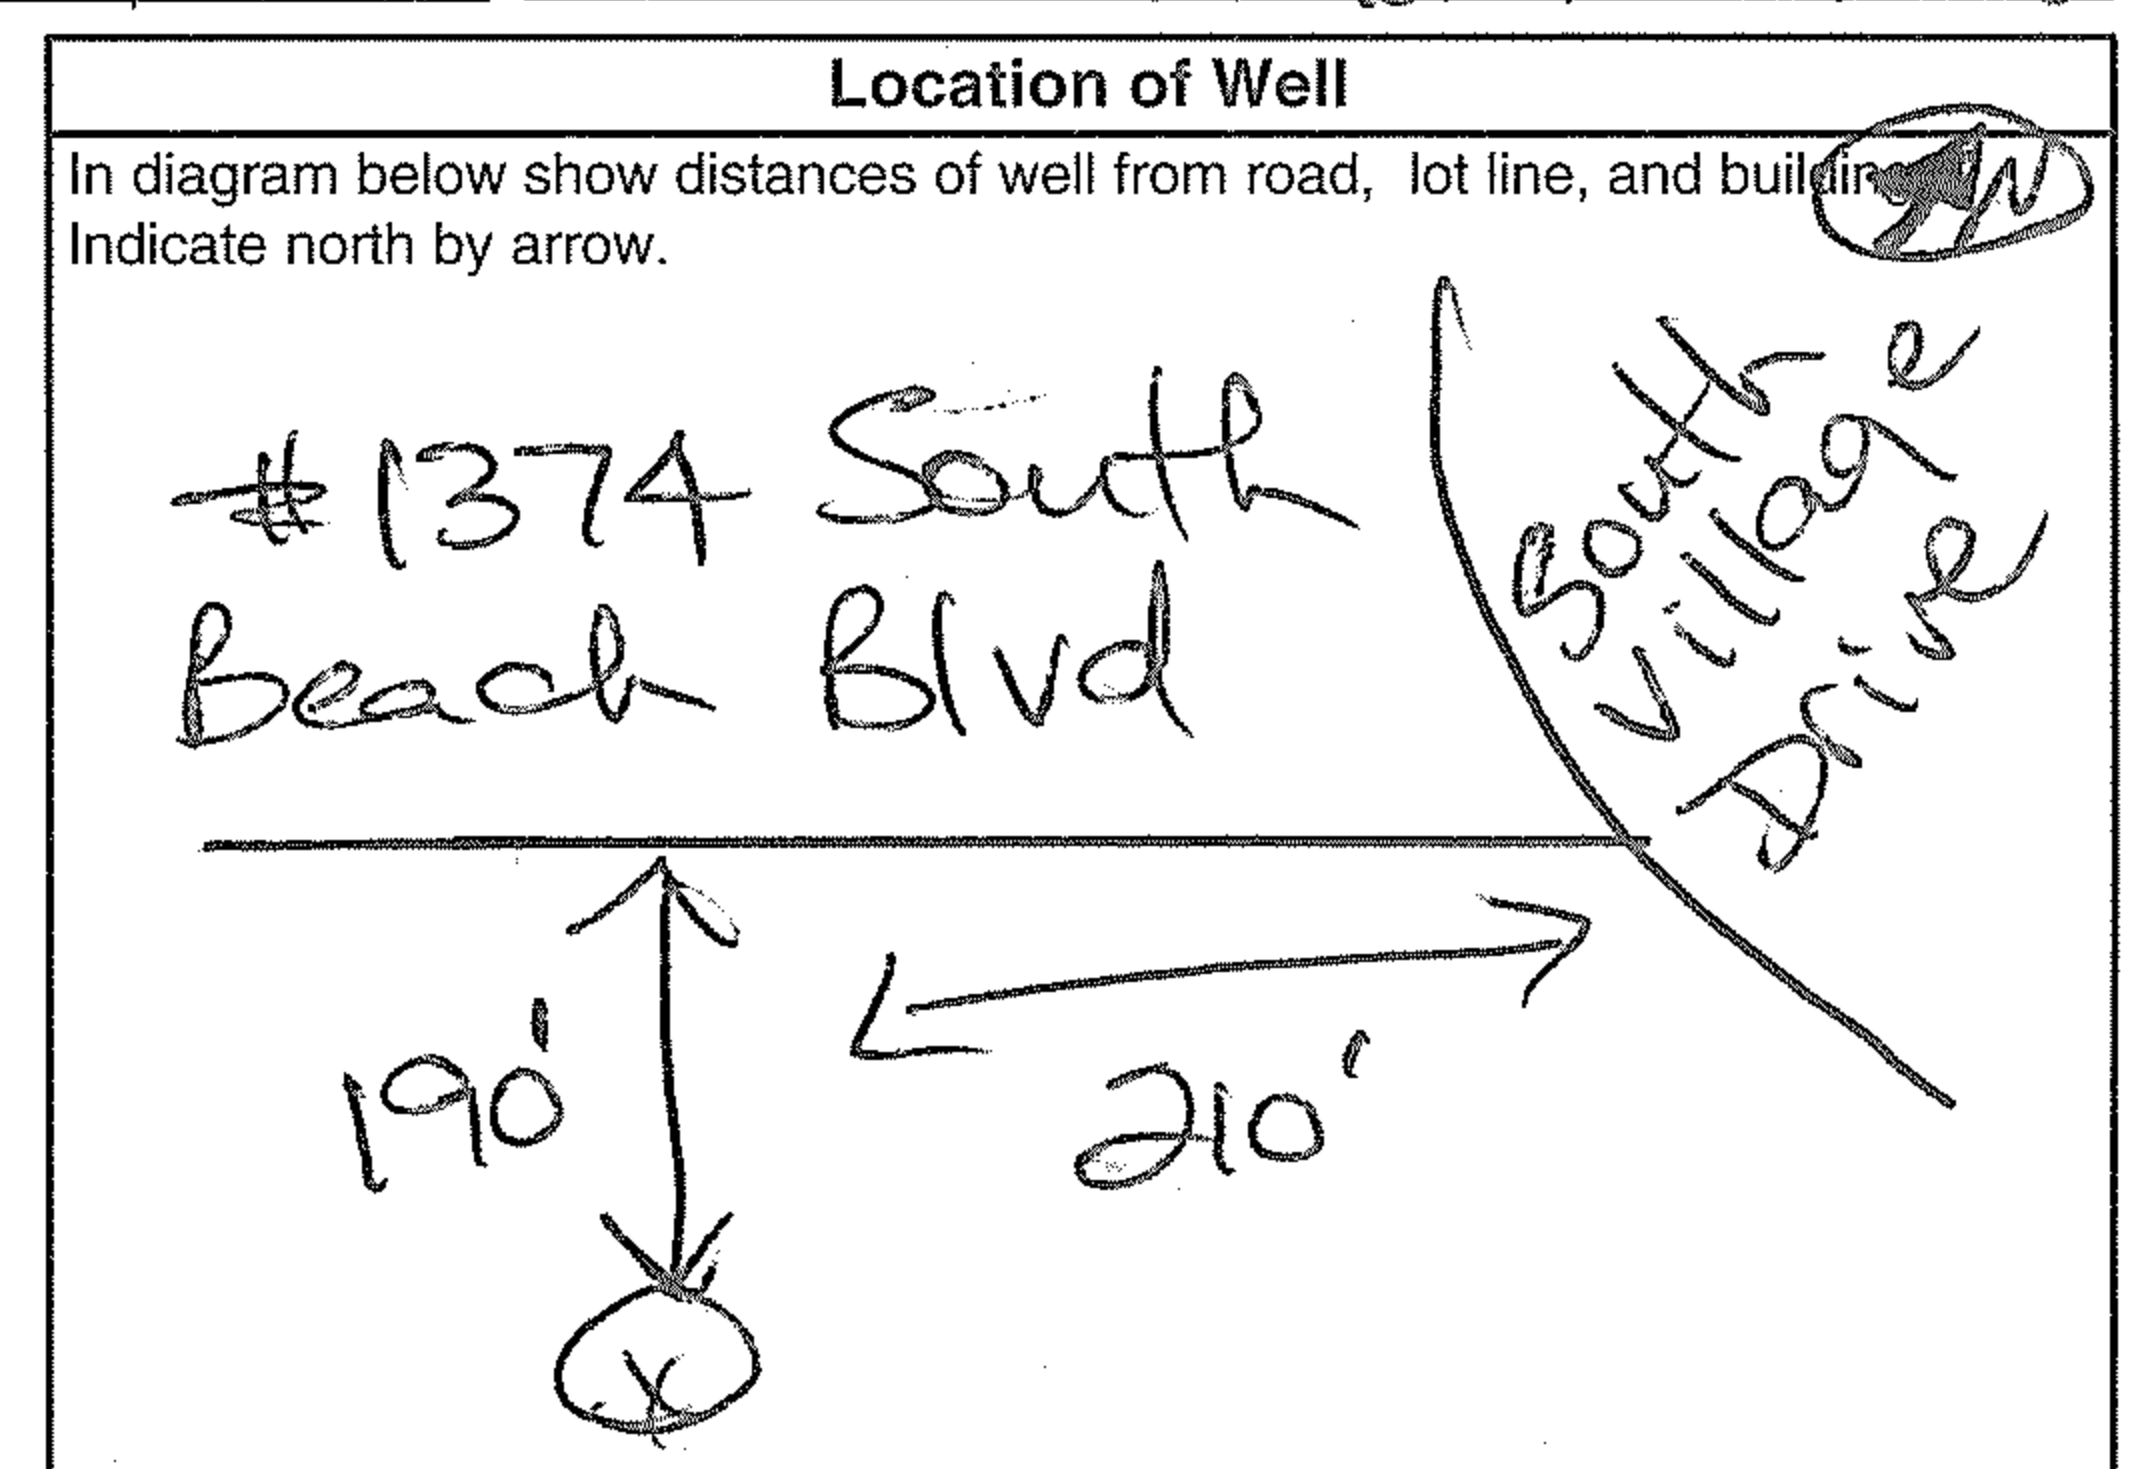

Audit No. **Z 65197** Date Well Completed **2007 06 05**

Was the well owner's information package delivered?  Yes  No Date Delivered **2007 06 18**

**Ministry Use Only**

Data Source: Contractor **1119**

Date Received: **AUG 23 2007** DD Date of Inspection: **2007 06 18** MM DD

Remarks: Well Record Number



N/A

Well Owner's Information

First Name: Ken Gordon Holdings Inc, Last Name: Gordon, E-mail Address: [blank], Mailing Address: Box 310, Municipality: Manotick, Province: Ont, Postal Code: K4M 1A4

Part A Construction and/or Major Alteration of a Well

Address of Well Location: #6969 Parkway Road, Township: Osgoode, Lot: P/L 5, Concession: 4, County/District/Municipality: Ottawa-Carleton, City/Town/Village: Greely, Province: Ontario, Postal Code: [blank]

Overburden and Bedrock Materials (see instructions on the back of this form)

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (Metres) From, To. Entry: 6" Drilled Well Abandonment, 0 to 13.90.

Annular Space/Abandonment Sealing Record

Table with columns: Depth Set at (Metres) From, To, Type of Sealant Used (Material and Type), Volume Placed (Cubic Metres). Entry: 13.90 to 0.15 Hole Plug, 0.15 to 0 Dirt.

Results of Well Yield Testing

Table with columns: Check box if after test of well yield, water was: [ ] Clear and sand free, [ ] Cannot develop to sand-free state. Includes Draw Down and Recovery columns.

Method of Construction


Method of Construction: [ ] Cable Tool, [ ] Rotary (Conventional), [ ] Rotary (Reverse), [ ] Rotary (Air), [ ] Air percussion, [ ] Other, specify. Water Use: [ ] Public, [ ] Commercial, [ ] Not used, [ ] Domestic, [ ] Municipal, [ ] Dewatering, [ ] Livestock, [ ] Test Hole, [ ] Monitoring, [ ] Irrigation, [ ] Cooling & Air Conditioning, [ ] Industrial, [ ] Other, specify.

Status of Well

Status of Well: [ ] Water Supply, [ ] Replacement Well, [ ] Test Hole, [ ] Recharge Well, [ ] Dewatering Well, [ ] Abandoned, Insufficient Supply, [ ] Abandoned, Poor Water Quality, [ ] Abandoned, other, specify NOT USEABLE, [ ] Observation and/or Monitoring Hole, [ ] Alteration (Construction), [ ] Other, specify.

Location of Well

Please provide a map below showing: - all property boundaries, and measurements sufficient to locate the well in relation to fixed points, - an arrow indicating the North direction, - detailed drawings can be provided as attachments no larger than legal size (8.5" by 14"), - digital pictures of inside of well can also be provided.

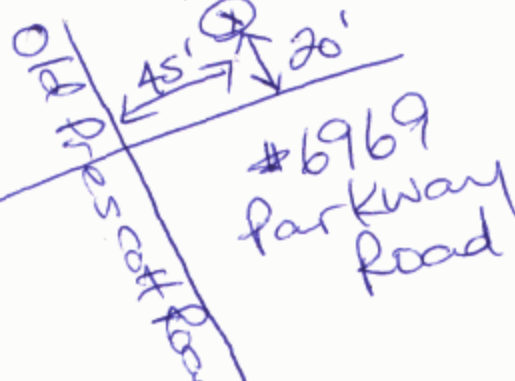

Water Details

Table with columns: Water found at Depth (Metres), Kind of Water (Fresh, Salty, Sulphur, Minerals). Includes checkboxes for Gas, Fresh, Salty, Sulphur, Minerals.

Casing Used

Screen Used

Casing and Well Details

Casing Used: [ ] Galvanized, [ ] Steel, [ ] Fibreglass, [ ] Plastic, [ ] Concrete. Screen Used: [ ] Galvanized, [ ] Steel, [ ] Fibreglass, [ ] Plastic, [ ] Concrete. Casing and Well Details: Diameter of the Hole (Centimetres), Depth of the Hole (Metres), Wall Thickness (Metres), Inside Diameter of the Casing (Metres), Depth of the Casing (Metres).

Well Contractor and Well Technician Information

Business Name of Well Contractor: AIR ROCK DRILLING CO. LTD (119), Business Address: #1, Richmond, Province: ONT, Postal Code: K0A 2Z0, Business E-mail Address: [blank], Date Well Completed: 2008-03-22, Was the well owner's signature package delivered? Yes [X] No [ ], Date the Well Record and Package Delivered to Well Owner: [blank], Bus. Telephone No.: 613-838-2170, Name of Well Technician: Desautels, Well Technician's Licence No.: T14, Signature of Technician: [Signature], Date Submitted: 2008-04-01.

Ministry Use Only

Audit No.: z 78174, Well Contractor No.: [blank], Date Received: APR 28 2008, Date of Inspection: [blank], Remarks: [blank].



**Well Owner's Information**

First Name: Oakcraft Last Name: Momez Inc. E-mail Address: ebizprogen.com  Well Constructed by Well Owner  
 Mailing Address (Street Number/Name, RR): 6876 Lakes Park Dr. Municipality: Greenby Province: On Postal Code: K4P1M6 Telephone No. (inc. area code): 613 724 0990

**Part A Construction and/or Major Alteration of a Well**

Address of Well Location (Street Number/Name, RR): 1326 South Beach Blvd Township: Ottawa Lot: 110 Concession:  
 County/District/Municipality: Ottawa Carleton City/Town/Village: Ottawa/Greely Province: Ontario Postal Code: K4P1M6  
 UTM Coordinates: Zone: 18 Easting: 4545525012125 Northing: UTM GPS Unit Make: Magellan Model: Magellan Mode of Operation:  Undifferentiated  Averaged  
 Differentiated, specify \_\_\_\_\_

**Overburden and Bedrock Materials** (see instructions on the back of this form)

| General Colour | Most Common Material | Other Materials | General Description | Depth (Metres) From | Depth (Metres) To |
|----------------|----------------------|-----------------|---------------------|---------------------|-------------------|
| Brown          | Sand                 |                 | loose               | 0                   | 5                 |
| Grey           | Sand                 |                 | loose               | 5                   | 8                 |
| Grey           | gravel               | Boulder         | packed              | 8                   | 13                |
| Grey           | limestone            |                 | layered             | 13                  | 48.7              |

**Annular Space/Abandonment Sealing Record**

| Depth Set at (Metres) From | Depth Set at (Metres) To | Type of Sealant Used (Material and Type) | Volume Placed (Cubic Metres) |
|----------------------------|--------------------------|--|------------------------------|
| 0                          | 14.63                    | liment grout                             | 13 Bag                       |

**Results of Well Yield Testing**

| Check box if after test of well yield, water was:<br><input checked="" type="checkbox"/> Clear and sand free<br><input type="checkbox"/> Cannot develop to sand-free state<br>If pumping discontinued, give reason:<br>Pumping test method:<br>Pump intake set at (Metres):<br>Pumping rate (Litres/min):<br>Duration of pumping:<br>Final water level end of pumping (Metres):<br>Recommended pump type:<br><input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep<br>Recommended pump depth:<br>Recommended pump rate (Litres/min):<br>If flowing give rate (Litres/min): | Draw Down  |                      | Recovery   |                      |
|--|------------|----------------------|------------|----------------------|
|  | Time (Min) | Water Level (Metres) | Time (Min) | Water Level (Metres) |
| Static Level   | 3.8        | Static Level         | 23.54      |                      |
| 1  | 6          | 1                    |            |                      |
| 2  | 7.01       | 2                    | 20.90      |                      |
| 3  | 7.84       | 3                    | 19.20      |                      |
| 4  | 9.20       | 4                    | 15.51      |                      |
| 5  | 10.30      | 5                    | 13.11      |                      |
| 10   | 14.50      | 10                   | 9.08       |                      |
| 15   | 17.25      | 15                   | 5.38       |                      |
| 20   | 18.78      | 20                   | 3.90       |                      |
| 25   | 20.11      | 25                   |            |                      |
| 30   | 21.50      | 30                   |            |                      |
| 40   | 22.51      | 40                   |            |                      |
| 50   | 23.24      | 50                   |            |                      |
| 60   | 23.54      | 60                   |            |                      |

**Method of Construction**


Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Rotary (Air)  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Boring  Industrial  
 Other, specify \_\_\_\_\_

**Status of Well**

Water Supply  Dewatering Well  Observation and/or Monitoring Hole  
 Replacement Well  Abandoned, Insufficient Supply  Alteration (Construction)  
 Test Hole  Abandoned, Poor Water Quality  Other, specify \_\_\_\_\_  
 Recharge Well  Abandoned, other, specify \_\_\_\_\_

**Location of Well**

Please provide a map below showing:  
 - all property boundaries, and measurements sufficient to locate the well in relation to fixed points,  
 - an arrow indicating the North direction  
 - detailed drawings can be provided as attachments no larger than legal size (8.5" by 14")  
 - vidigital pictures of inside of well can also be provided

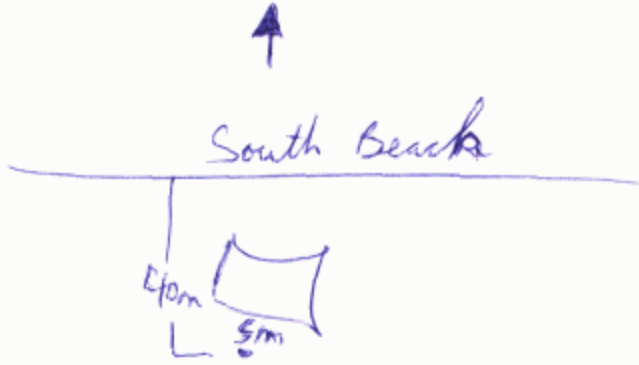

**Water Details**

Water found at Depth: 4.2 Metres  Gas  Fresh  Salty  Sulphur  Minerals

Water found at Depth: \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals

Water found at Depth: \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals

| Casing Used  | Screen Used   | Casing and Well Details   |
|--|---|---|
| <input type="checkbox"/> Galvanized<br><input checked="" type="checkbox"/> Steel<br><input type="checkbox"/> Fibreglass<br><input type="checkbox"/> Plastic<br><input type="checkbox"/> Concrete | <input type="checkbox"/> Galvanized<br><input type="checkbox"/> Steel<br><input type="checkbox"/> Fibreglass<br><input type="checkbox"/> Plastic<br><input type="checkbox"/> Concrete | Diameter of the Hole (Centimetres): <u>15.55</u><br>Depth of the Hole (Metres): <u>48.7</u><br>Wall Thickness (Metres): <u>0.48</u><br>Inside Diameter of the Casing (Metres): <u>15.55</u><br>Depth of the Casing (Metres): <u>14.63</u> |
| <b>No Casing and Screen Used</b><br><input checked="" type="checkbox"/> Open Hole<br>Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No                            |   |   |

Date Well Completed (yyyy/mm/dd): 2008/05/30 Was the well owner's information package delivered?  Yes  No Date the Well Record and Package Delivered to Well Owner (yyyy/mm/dd): \_\_\_\_\_

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: Bourgeois well Drilling Well Contractor's Licence No.: 1414  
 Business Address (Street No./Name, number, RR): 1782 900 East Municipality: Nation  
 Province: Ontario Postal Code: K0A3C0 Business E-mail Address: NA  
 Bus. Telephone No. (inc. area code): 613 987 9291 Name of Well Technician (Last Name, First Name): Michael Genier  
 Well Technician's Licence No.: 3493 Signature of Technician: [Signature] Date Submitted (yyyy/mm/dd): 2008/05/30

**Ministry Use Only**

Audit No.: z 79829 Well Contractor No.: \_\_\_\_\_  
 Date Received (yyyy/mm/dd): JUN 25 2008 Date of Inspection (yyyy/mm/dd): \_\_\_\_\_  
 Remarks: \_\_\_\_\_



**Well Owner's Information**

First Name: **Dakera FT Homes Inc.** Last Name: \_\_\_\_\_ E-mail Address: \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name, RR): **6876 Lakes Park Dr.** Municipality: **Oroon** Province: **Ont.** Postal Code: **K4P1M6** Telephone No. (inc. area code): **6137240990**

**Part A Construction and/or Major Alteration of a Well**

Address of Well Location (Street Number/Name, RR): **1320 South Beach Blvd.** Township: **Ottawa** Lot: **109** Concession: \_\_\_\_\_

County/District/Municipality: **Ottawa Carleton** City/Town/Village: **Ottawa/Oroon** Province: **Ontario** Postal Code: \_\_\_\_\_

UTM Coordinates: Zone **18** Easting **454522** Northing **5012119** GPS Unit Make: **UTM** Model: **Magellan** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify \_\_\_\_\_

**Overburden and Bedrock Materials** (see instructions on the back of this form)

| General Colour | Most Common Material | Other Materials | General Description | Depth (Metres) From | Depth (Metres) To |
|----------------|----------------------|-----------------|---------------------|---------------------|-------------------|
| Brown          | Sand                 |                 | loose               | 0                   | 4                 |
| Grey           | Sand                 |                 | loose               | 4                   | 8                 |
| Grey           | gravel               | Boulder         | Packed              | 8                   | 11                |
| Grey           | limestone            |                 | layered             | 11                  | 418.7             |

**Annular Space/Abandonment Sealing Record**

| Depth Set at (Metres) From | Depth Set at (Metres) To | Type of Sealant Used (Material and Type) | Volume Placed (Cubic Metres) |
|----------------------------|--------------------------|--|------------------------------|
| 0                          | 13.4                     | liment grout                             | 10 Bay                       |

**Results of Well Yield Testing**

Check box if after test of well yield, water was:  
 Clear and sand free  
 Cannot develop to sand-free state

If pumping discontinued, give reason: \_\_\_\_\_

Pumping test method: **1/2 ph Sub**

Pump intake set at (Metres): **38.7**

Pumping rate (Litres/min): **53**

Duration of pumping: **1** hrs + **0** min

Final water level end of pumping (Metres): \_\_\_\_\_

Recommended pump type:  Shallow  Deep

Recommended pump depth: **38.7** Metres

Recommended pump rate (Litres/min): **53**

If flowing give rate (Litres/min): \_\_\_\_\_

| Time (Min)   | Draw Down            |              | Recovery             |            |
|--------------|----------------------|--------------|----------------------|------------|
|              | Water Level (Metres) | Time (Min)   | Water Level (Metres) | Time (Min) |
| Static Level | 3.90                 | Static Level | 23.89                |            |
| 1            | 5.90                 | 1            |                      |            |
| 2            | 6.99                 | 2            | 20.14                |            |
| 3            | 7.60                 | 3            | 19.02                |            |
| 4            | 9m                   | 4            | 18.78                |            |
| 5            | 10.28                | 5            | 9.14                 |            |
| 10           | 14.12                | 10           | 8.50                 |            |
| 15           | 17.35                | 15           | 4.75                 |            |
| 20           | 18.52                | 20           | 4.40                 |            |
| 25           | 19.96                | 25           |                      |            |
| 30           | 20.82                | 30           |                      |            |
| 40           | 22.43                | 40           |                      |            |
| 50           | 23.19                | 50           |                      |            |
| 60           | 23.89                | 60           |                      |            |

**Method of Construction**

**Water Use**


Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Drilling  Livestock  Test Hole  Monitoring  
 Rotary (Air)  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Boring  Industrial  
 Other, specify \_\_\_\_\_  Other, specify \_\_\_\_\_

**Status of Well**

Water Supply  Dewatering Well  Observation and/or Monitoring Hole  
 Replacement Well  Abandoned, Insufficient Supply  Alteration (Construction)  
 Test Hole  Abandoned, Poor Water Quality  Other, specify \_\_\_\_\_  
 Recharge Well  Abandoned, other, specify \_\_\_\_\_

**Location of Well**

Please provide a map below showing:  
 - all property boundaries, and measurements sufficient to locate the well in relation to fixed points,  
 - an arrow indicating the North direction  
 - detailed drawings can be provided as attachments no larger than legal size (8.5" by 14")  
 - digital pictures of inside of well can also be provided

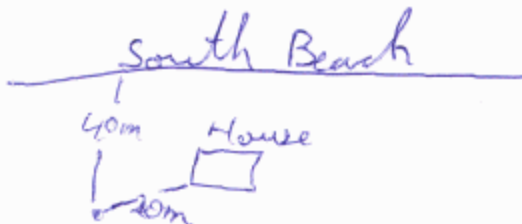

**Water Details**

Water found at Depth: **4.2** Metres  Gas  Fresh  Salty  Sulphur  Minerals

Water found at Depth: \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals

Water found at Depth: \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals

**Casing Used**

**Screen Used**

**Casing and Well Details**

Galvanized  Galvanized  
 Steel  Steel  
 Fibreglass  Fibreglass  
 Plastic  Plastic  
 Concrete  Concrete

Open Hole  
 Disinfected?  Yes  No

Diameter of the Hole (Centimetres): **15.55**  
 Depth of the Hole (Metres): **418.47**  
 Wall Thickness (Metres): **0.48**  
 Inside Diameter of the Casing (Metres): **15.55**  
 Depth of the Casing (Metres): **13.41**

**Ministry Use Only**

Audit No.: **z 79830** Well Contractor No.: \_\_\_\_\_

Date Received (yyyy/mm/dd): **JUN 25 2008** Date of Inspection (yyyy/mm/dd): \_\_\_\_\_

Remarks: \_\_\_\_\_

Date Well Completed (yyyy/mm/dd): **2008/05/30** Was the well owner's information package delivered?  Yes  No

Date the Well Record and Package Delivered to Well Owner (yyyy/mm/dd): \_\_\_\_\_

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **Bourgeois well Drilling** Well Contractor's Licence No.: **14114**

Business Address (Street No./Name, number, RR): **1182 900 East** Municipality: **Nation**

Province: **Ontario** Postal Code: **K0A3K0** Business E-mail Address: **NA**

Bus. Telephone No. (inc. area code): **6139875291** Name of Well Technician (Last Name, First Name): **Michael Genier**

Well Technician's Licence No.: **34193** Signature of Technician: *[Signature]* Date Submitted (yyyy/mm/dd): **2008/05/08**



Measurements recorded in:  Metric  Imperial

Page \_\_\_\_\_ of \_\_\_\_\_

A 066957

Well Owner's Information

1363 South Beach Osgoode ~~7130~~ Lot 4 Con 4  
 County/District/Municipality City/Town/Village Province Postal Code  
 Ottawa Carlton Greely Ontario  
 UTM Coordinates Zone Easting Northing Municipal Plan and Subsector Number Other  
 NAD 83 18454592 5012292 4M-1265 S/L #80

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

| General Colour | Most Common Material                                 | Other Materials | General Description | Depth (m/ft)<br>From To               |
|----------------|--|-----------------|---------------------|---------------------------------------|
|                | Sand & Boulders<br>Grey Limestone<br>White Sandstone |                 |                     | 0 12.50<br>12.50 41.14<br>41.14 54.86 |

| Annular Space                  |   |                           |
|--------------------------------|---|---------------------------|
| Depth Set at (m/ft)<br>From To | Type of Sealant Used<br>(Material and Type) | Volume Placed<br>(m³/ft³) |
| 14.32 11.21                    | Mat Cement Slurry                           | 1.816                     |
| 11.21 0                        | Bentonite Slurry                            | 4.90                      |


| Results of Well Yield Testing                                       |  |            |                    |
|---|--|------------|--------------------|
| After test of well yield, water was:                                |  |            |                    |
| <input type="checkbox"/> Clear and sand free                        | <input checked="" type="checkbox"/> NOT TESTED |            |                    |
| <input type="checkbox"/> Other, specify                             |  |            |                    |
| If pumping discontinued, give reason:                               |  |            |                    |
| <del>_____</del>  |  |            |                    |
| Pump intake set at (m/ft)   |  |            |                    |
| 51.81   |  |            |                    |
| Pumping rate (l/min / GPM)  |  |            |                    |
| 34.07   |  |            |                    |
| Duration of pumping   |  |            |                    |
| 1 hrs + 0 min   |  |            |                    |
| Final water level end of pumping (m/ft)                             |  |            |                    |
| 12.38   |  |            |                    |
| If flowing give rate (l/min / GPM)                                  |  |            |                    |
| <del>_____</del>  |  |            |                    |
| Recommended pump depth (m/ft)                                       |  |            |                    |
| 51.81   |  |            |                    |
| Recommended pump rate (l/min / GPM)                                 |  |            |                    |
| 34.07   |  |            |                    |
| Well production (l/min / GPM)                                       |  |            |                    |
| 7 g.p.m   |  |            |                    |
| Disinfected?  |  |            |                    |
| <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No |  |            |                    |
| Draw Down   |  |            |                    |
| Time (min)  | Water Level (m/ft)                             | Time (min) | Water Level (m/ft) |
| Static Level  | 8.14   |            | 12.30              |
| 1   | 9.70   | 1          | 11.13              |
| 2   | 10.12  | 2          | 10.47              |
| 3   | 10.68  | 3          | 10.15              |
| 4   | 11.07  | 4          | 9.90               |
| 5   | 11.29  | 5          | 9.73               |
| 10  | 11.95  | 10         | 8.74               |
| 15  | 12.08  | 15         | ↓                  |
| 20  | 12.31  | 20         |                    |
| 25  | 12.32  | 25         |                    |
| 30  | 12.33  | 30         |                    |
| 40  | 12.35  | 40         |                    |
| 50  | 12.36  | 50         |                    |
| 60  | 12.38  | 60         |                    |

| Method of Construction                             |                                  | Well Use                                     |   |
|--|----------------------------------|--|---|
| <input type="checkbox"/> Cable Tool                | <input type="checkbox"/> Diamond | <input type="checkbox"/> Public              | <input type="checkbox"/> Commercial                 |
| <input type="checkbox"/> Rotary (Conventional)     | <input type="checkbox"/> Jetting | <input checked="" type="checkbox"/> Domestic | <input type="checkbox"/> Municipal                  |
| <input type="checkbox"/> Rotary (Reverse)          | <input type="checkbox"/> Driving | <input type="checkbox"/> Livestock           | <input type="checkbox"/> Test Hole                  |
| <input type="checkbox"/> Boring                    | <input type="checkbox"/> Digging | <input type="checkbox"/> Irrigation          | <input type="checkbox"/> Cooling & Air Conditioning |
| <input checked="" type="checkbox"/> Air percussion |                                  | <input type="checkbox"/> Industrial          |   |
| <input type="checkbox"/> Other, specify            |                                  | <input type="checkbox"/> Other, specify      |   |

| Construction Record - Casing |  |                        |                         | Status of Well   |   |
|------------------------------|--|------------------------|-------------------------|--|---|
| Inside Diameter (cm/in)      | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm/in) | Depth (m/ft)<br>From To | <input checked="" type="checkbox"/> Water Supply       | <input type="checkbox"/> Replacement Well                   |
| 15.88                        | Steel  | .48                    | 4.6 14.32               | <input type="checkbox"/> Test Hole                     | <input type="checkbox"/> Recharge Well                      |
| 15.09                        | open hole  |                        | 14.32 54.86             | <input type="checkbox"/> Dewatering Well               | <input type="checkbox"/> Observation and/or Monitoring Hole |
|                              |  |                        |                         | <input type="checkbox"/> Alteration (Construction)     | <input type="checkbox"/> Abandoned, Insufficient Supply     |
|                              |  |                        |                         | <input type="checkbox"/> Abandoned, Poor Water Quality | <input type="checkbox"/> Abandoned, other, specify          |
|                              |  |                        |                         | <input type="checkbox"/> Other, specify                |   |

| Construction Record - Screen |                                       |          |                         |
|------------------------------|---------------------------------------|----------|-------------------------|
| Outside Diameter (cm/in)     | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft)<br>From To |
|                              |                                       |          |                         |

| Water Details               |   | Hole Diameter           |                  |
|-----------------------------|---|-------------------------|------------------|
| Water found at Depth (m/ft) | Kind of Water: <input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify | Depth (m/ft)<br>From To | Diameter (cm/in) |
| 52.72                       | Water   | 54.86 0                 | 15.07            |
| Water found at Depth (m/ft) | Kind of Water: <input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify |                         |                  |
| Water found at Depth (m/ft) | Kind of Water: <input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify |                         |                  |

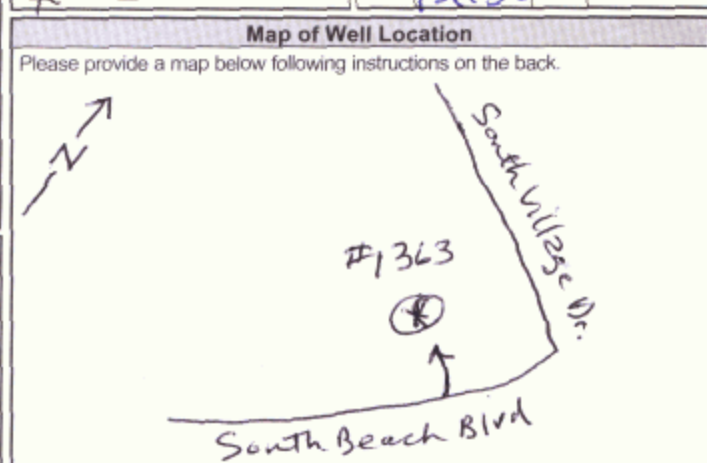

Well Contractor and Well Technician Information

Business Name of Well Contractor: Air Rock Drilling Co Ltd  
 Well Contractor's Licence No.: 11119  
 Business Address (Street Number/Name): RR1  
 Municipality: Richmond  
 Province: Ont Postal Code: K0A2Z0  
 Business E-mail Address:  
 Bus. Telephone No. (inc. area code): 613 838 2170  
 Name of Well Technician (Last Name, First Name): Purcell, Shannon  
 Well Technician's Licence No.: T2122  
 Signature of Technician and/or Contractor: [Signature]  
 Date Submitted: 2008 08 01

Comments: #1363 South Beach

|  |                                    |   |
|--|------------------------------------|---|
| Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | Date Package Delivered: 2008 07 24 | Ministry Use Only<br>Audit No. Z 80748<br>AUG 14 2008<br>Received |
| Date Work Completed: 2008 05 21  |                                    |   |

A085398

Well Tag No. for Master Well (Place Sticker and/or Print Below)

**A 085398**

10/19 Page 1 of 3

Address of Well Location (Street Number/Name, RR) **6906 McKeown Rd** Township \_\_\_\_\_ Lot \_\_\_\_\_ Concession \_\_\_\_\_  
 County/District/Municipality \_\_\_\_\_ City/Town/Village **Greely** Province **Ontario** Postal Code \_\_\_\_\_

UTM Coordinates Zone Easting Northing GPS Unit Make Model Mode of Operation:  
**NAD 83 18 455060 5011834** **Garmin** **Etrex**  Undifferentiated  Averaged  
 Differentiated, specify \_\_\_\_\_

**Overburden and Bedrock Materials (see instructions on the back of this form)**

| General Colour | Most Common Material | Other Materials | General Description | Depth (Metres) |      |
|----------------|----------------------|-----------------|---------------------|----------------|------|
|                |                      |                 |                     | From           | To   |
| Grn            | Gravel               | Sand            | soft, dry           | 0              | .61  |
| Brn            | Sand                 |                 | soft, dry           | .61            | 1.5  |
| Grn            | clay                 |                 | soft, moist         | 1.5            | 2.74 |
| Grn            | silt                 |                 | Wet                 | 2.74           | 4.88 |

**Hole Details**

| Depth (Metres) From | Depth (Metres) To | Diameter (Centimetres) |
|---------------------|-------------------|------------------------|
|                     |                   |                        |

**Water Use**

Public  Industrial  Not used  Other, specify \_\_\_\_\_  
 Domestic  Commercial  Dewatering  
 Livestock  Municipal  Monitoring  
 Irrigation  Test Hole  Cooling & Air Conditioning

**Method of Construction**

Cable Tool  Air Percussion  Digging  
 Rotary (Conventional)  Diamond  Boring  
 Rotary (Reverse)  Jetting  Other, specify \_\_\_\_\_  
 Rotary (Air)  Driving **Direct Push**

**Status of Well**

Test Hole  Abandoned, Insufficient Supply  
 Replacement Well  Abandoned, Poor Water Quality  
 Dewatering Well  Other, specify **monitoring**  
 Alteration (Construction)  Abandoned, other, specify \_\_\_\_\_

**No Casing and Screen Used**  Yes  No

**Static Water Level Test** \_\_\_\_\_ Metres

**Screen**

Galvanized  Steel  Fibreglass  Concrete  Plastic

Outside Diameter (Centimetres) **6.03** Slot No. **10**

**Water Details**

Water found at Depth \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals  
 Water found at Depth \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals  
 Water found at Depth \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals

Disinfected  Yes  No. If no, provide reason: \_\_\_\_\_ Date Master Well Completed (yyyy/mm/dd) **2009/08/31**

**Cluster Information (Please also fill out the additional Cluster Well Information for Well Construction for each parcel of land and cluster.)**

Total Wells in Cluster **4** Please indicate Number of Cluster Well Information Log Sheets Submitted **1**  
 Total Wells on this Property **4**

**Location of Well Cluster**

Detailed Map must be provided as an attachment no larger than legal size (8.5"x 14"). Sketches are not allowed.  
 Check box to confirm detailed map is provided as per Section 11.1 (3)

**Construction Details**

| Inside Diameter (Centimetres) | Material (steel, plastic, fibreglass, concrete, galvanized) | Wall Thickness | Depth (Metres) |      |
|-------------------------------|---|----------------|----------------|------|
|                               |   |                | From           | To   |
| 5.20                          | PVC Riser   | .390           | 0              | 1.83 |
|                               | PVC Screen  |                | 1.83           | 4.88 |

**Annular Space/Abandonment Sealing Record**

| Depth Set at (Metres) |      | Type of Sealant Used (Material and Type) | Volume Used (Cubic Metres) |
|-----------------------|------|--|----------------------------|
| From                  | To   |  |                            |
| 0                     | .31  | Concrete / Flushmount                    |                            |
| .31                   | 1.5  | Benseal                                  |                            |
| 1.5                   | 4.88 | sand                                     |                            |

**Well Contractor and Well Technician Information**

Business Name of Well Contractor **Strata Soil Sampling** Well Contractor's Licence No. **7241**  
 Business Address (Street No./Name, number, RR) **#2-147 West Beaver Creek** Municipality **Richmond Hill**  
 Province **ON** Postal Code **L4B1C6** Business E-mail Address \_\_\_\_\_  
 Bus. Telephone No. (inc. area code) **(905) 764-9301** Name of Well Technician (Last Name, First Name) **Robynne Teas**  
 Well Technician's Licence No. **31659** Signature of Technician \_\_\_\_\_ Date Submitted (yyyy/mm/dd) **2009/09/11**

**Ministry Use Only**

Audit No. **M 02599** Well Contractor No. \_\_\_\_\_  
 Date Received (yyyy/mm/dd) **SEP 22 2009** Date of Inspection (yyyy/mm/dd) \_\_\_\_\_  
 Remarks \_\_\_\_\_

A085398

1679 Page 2 of 3

|  |  |                     |             |                         |                |  |                                    |  |                   |
|--|--|---------------------|-------------|-------------------------|----------------|--|------------------------------------|--|-------------------|
| Address of Well Location (Street Number/Name, RR)<br>6906 McKeown Rd |  |                     | Lot         | Concession              | Township       | County/District/Municipality   | upon request                       |  |                   |
| City/Town/Village<br>Greely  |  | Province<br>Ontario | Postal Code | GPS Unit Make<br>Garmin | Model<br>Etrex | Unit Mode of Operation<br><input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged | Signature of Technician/Contractor |  | Date (yyyy/mm/dd) |

| Well # on Sketch | UTM Coordinates |         | Full Depth of Hole (metres) | Hole Diameter (cm) | Method of Construction | Casing Material | Casing Length (metres) | Screen Interval (metres) |      | Annular Space Sealant Used | Static Water Level (metres) | Abandonment Sealant Used | Comments | Date of Completion (yyyy/mm/dd) |
|------------------|-----------------|---------|-----------------------------|--------------------|------------------------|-----------------|------------------------|--------------------------|------|----------------------------|-----------------------------|--------------------------|----------|---------------------------------|
|                  | Zone            | Easting |                             |                    |                        |                 |                        | Northing                 | From |                            |                             |                          |          |                                 |
| 2                | 18              | 455042  | 5011837                     | 4.88               | 10.92                  | Direct Push     | PVC                    | 1.83                     | 1.83 | 4.88                       | Benseal                     |                          |          | 2009/08/31                      |
| 3                | 18              | 455051  | 5011843                     | 4.88               | 10.92                  | Direct Push     | PVC                    | 1.83                     | 1.83 | 4.88                       | Benseal                     |                          |          | 2009/08/31                      |
| 4                | 18              | 455052  | 5011837                     | 4.88               | 10.92                  | Direct Push     | PVC                    | 1.83                     | 1.83 | 4.88                       | Benseal                     |                          |          | 2009/08/31                      |

| Well Contractor and Well Technician Information                    |   |   |   |
|--|---|---|---|
| Business Name of Well Contractor<br>Strata Soil Sampling           |   | Business Address (Street Number/Name, RR)<br>#2-147 West Beaver Creek |   |
| Municipality<br>Richmond Hill                                      |   | Province<br>ON  |   |
| Postal Code<br>L4B 1C6   | Business Telephone No. (inc. area code)<br>(905) 769-9304 | Well Contractor's Licence No.<br>72411                                | Business E-mail Address                 |
| Name of Well Technician (First Name, Last Name)<br>Trevor Robinson |   | Well Technician's Licence No.<br>3159                                 | Date Submitted (yyyy/mm/dd)<br>09/09/11 |
| Signature of Technician  |   |   |   |

| Date 1st Well in Cluster Constructed<br>(yyyy/mm/dd)<br>2009/08/31 | Date Last Well in Cluster Constructed<br>(yyyy/mm/dd)<br>2009/08/31 |
|--|---|
| Ministry Use Only  |   |
| Date Received (yyyy/mm/dd)<br>SEP 22 2009                          | Date Inspected (yyyy/mm/dd)   |
| Audit No.<br>C 03827   | Remarks<br>M02599   |





**Trow Associates Inc.** 154 Colonnade Road South, Tel: (613) 225-9940  
Ottawa, Ontario K2E 7J5 Fax: (613) 225-7337

|                   |   |                          |
|-------------------|---|--------------------------|
| DATE<br>JULY 2009 | CLIENT<br>VINTAGE PAVING                                    | JOB No.<br>OTEN00020135A |
| DESIGN<br>CB      | CHECKED<br>CH   | SCALE<br>1:1250±         |
| DRAWN<br>RG       | TITLE<br>SITE LAYOUT<br>6906 McKEOWN DRIVE, GREELY (OTTAWA) | FIG 2                    |

SEP 22 2009  
C-7241 M02599 203827

A085398

Well Tag No. for Master Well (Place Sticker and/or Print Below)

**A 085398**

10/19 Page 1 of 3

Address of Well Location (Street Number/Name, RR) **6906 McKeown Rd** Township \_\_\_\_\_ Lot \_\_\_\_\_ Concession \_\_\_\_\_  
 County/District/Municipality \_\_\_\_\_ City/Town/Village **Greely** Province **Ontario** Postal Code \_\_\_\_\_

UTM Coordinates Zone Easting Northing GPS Unit Make Model Mode of Operation:  
 NAD **83** **18** **455060** **5011834** **Garmin** **Etrex**  Undifferentiated  Averaged  
 Differentiated, specify \_\_\_\_\_

| Overburden and Bedrock Materials (see instructions on the back of this form) |                      |                 |                     |                |      |
|--|----------------------|-----------------|---------------------|----------------|------|
| General Colour   | Most Common Material | Other Materials | General Description | Depth (Metres) |      |
|  |                      |                 |                     | From           | To   |
| Grn  | Gravel               | Sand            | soft, dry           | 0              | .61  |
| Brn  | Sand                 |                 | soft, dry           | .61            | 1.5  |
| brn  | clay                 |                 | soft, moist         | 1.5            | 2.74 |
| brn  | silt                 |                 | Wet                 | 2.74           | 4.88 |

| Hole Details   |                        |       |
|----------------|------------------------|-------|
| Depth (Metres) | Diameter (Centimetres) |       |
|                | From                   | To    |
| 0              | 4.88                   | 10.92 |

**Water Use**

Public  Industrial  Not used  Other, specify \_\_\_\_\_  
 Domestic  Commercial  Dewatering  
 Livestock  Municipal  Monitoring  
 Irrigation  Test Hole  Cooling & Air Conditioning

**Method of Construction**

Cable Tool  Air Percussion  Digging  
 Rotary (Conventional)  Diamond  Boring  
 Rotary (Reverse)  Jetting  Other, specify \_\_\_\_\_  
 Rotary (Air)  Driving **Direct Push**

**Status of Well**

Test Hole  Abandoned, Insufficient Supply  
 Replacement Well  Abandoned, Poor Water Quality  
 Dewatering Well  Other, specify **monitoring**  
 Alteration (Construction)  Abandoned, other, specify \_\_\_\_\_

**No Casing and Screen Used**  Yes  No

**Static Water Level Test** \_\_\_\_\_ Metres

**Screen**

Galvanized  Steel  Fibreglass  Concrete  Plastic

Outside Diameter (Centimetres) **6.03** Slot No. **10**

**Water Details**

Water found at Depth \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals  
 Water found at Depth \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals  
 Water found at Depth \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals

Disinfected  Yes  No. If no, provide reason: \_\_\_\_\_ Date Master Well Completed (yyyy/mm/dd) **2009/08/31**

**Cluster Information (Please also fill out the additional Cluster Well Information for Well Construction for each parcel of land and cluster.)**

Total Wells in Cluster **4** Please indicate Number of Cluster Well Information Log Sheets Submitted **1**  
 Total Wells on this Property **4**

**Location of Well Cluster**

Detailed Map must be provided as an attachment no larger than legal size (8.5"x 14"). Sketches are not allowed.  
 Check box to confirm detailed map is provided as per Section 11.1 (3)

**Construction Details**

| Inside Diameter (Centimetres) | Material (steel, plastic, fibreglass, concrete, galvanized) | Wall Thickness | Depth (Metres) |             |
|-------------------------------|---|----------------|----------------|-------------|
|                               |   |                | From           | To          |
| <b>5.20</b>                   | <b>PVC Riser</b>  | <b>.390</b>    | <b>0</b>       | <b>1.83</b> |
|                               | <b>PVC Screen</b>   |                | <b>1.83</b>    | <b>4.88</b> |

**Annular Space/Abandonment Sealing Record**

| Depth Set at (Metres) |             | Type of Sealant Used (Material and Type) | Volume Used (Cubic Metres) |
|-----------------------|-------------|--|----------------------------|
| From                  | To          |  |                            |
| <b>0</b>              | <b>.31</b>  | <b>Concrete / Flushmount</b>             |                            |
| <b>.31</b>            | <b>1.5</b>  | <b>Benseal</b>                           |                            |
| <b>1.5</b>            | <b>4.88</b> | <b>sand</b>                              |                            |

**Well Contractor and Well Technician Information**

Business Name of Well Contractor **Strata Soil Sampling** Well Contractor's Licence No. **7241**  
 Business Address (Street No./Name, number, RR) **#2-147 West Beaver Creek** Municipality **Richmond Hill**  
 Province **ON** Postal Code **L4B1C6** Business E-mail Address \_\_\_\_\_  
 Bus. Telephone No. (inc. area code) **(905) 764-9301** Name of Well Technician (Last Name, First Name) **Robynne Teas**  
 Well Technician's Licence No. **31659** Signature of Technician \_\_\_\_\_ Date Submitted (yyyy/mm/dd) **2009/09/11**

**Ministry Use Only**

Audit No. **M 02599** Well Contractor No. \_\_\_\_\_  
 Date Received (yyyy/mm/dd) **SEP 22 2009** Date of Inspection (yyyy/mm/dd) \_\_\_\_\_  
 Remarks \_\_\_\_\_

A085398

|  |                     |             |                         |                |  |   |
|--|---------------------|-------------|-------------------------|----------------|--|---|
| Address of Well Location (Street Number/Name, RR)<br>6906 McKeown Rd |                     | Lot         | Concession              | Township       |  | County/District/Municipality                      |
| City/Town/Village<br>Greely  | Province<br>Ontario | Postal Code | GPS Unit Make<br>Garmin | Model<br>Etrex | Unit Mode of Operation<br><input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged | <input type="checkbox"/> Differentiated, specify: |

|                                    |                   |
|------------------------------------|-------------------|
| upon request                       |                   |
| Signature of Technician/Contractor | Date (yyyy/mm/dd) |

| Well # on Sketch | UTM Coordinates |         | Full Depth of Hole (metres) | Hole Diameter (cm) | Method of Construction | Casing Material | Casing Length (metres) | Screen Interval (metres) |      | Annular Space Sealant Used | Static Water Level (metres) | Abandonment Sealant Used | Comments | Date of Completion (yyyy/mm/dd) |
|------------------|-----------------|---------|-----------------------------|--------------------|------------------------|-----------------|------------------------|--------------------------|------|----------------------------|-----------------------------|--------------------------|----------|---------------------------------|
|                  | Zone            | Easting |                             |                    |                        |                 |                        | Northing                 | From |                            |                             |                          |          |                                 |
| 2                | 18              | 455042  | 5011837                     | 4.88               | 10.92                  | Direct Push     | PVC                    | 1.83                     | 1.83 | 4.88                       | Benseal                     |                          |          | 2009/08/31                      |
| 3                | 18              | 455051  | 5011843                     | 4.88               | 10.92                  | Direct Push     | PVC                    | 1.83                     | 1.83 | 4.88                       | Benseal                     |                          |          | 2009/08/31                      |
| 4                | 18              | 455052  | 5011837                     | 4.88               | 10.92                  | Direct Push     | PVC                    | 1.83                     | 1.83 | 4.88                       | Benseal                     |                          |          | 2009/08/31                      |

|  |   |   |   |                               |                |
|--|---|---|---|-------------------------------|----------------|
| Well Contractor and Well Technician Information                    |   |   |   |                               |                |
| Business Name of Well Contractor<br>Strata Soil Sampling           |   | Business Address (Street Number/Name, RR)<br>#2-147 West Beaver Creek |   | Municipality<br>Richmond Hill | Province<br>ON |
| Postal Code<br>L4B 1C6   | Business Telephone No. (inc. area code)<br>(905) 769-9304 | Well Contractor's Licence No.<br>72411                                | Business E-mail Address                 |                               |                |
| Name of Well Technician (First Name, Last Name)<br>Trevor Robinson |   | Well Technician's Licence No.<br>8159                                 | Date Submitted (yyyy/mm/dd)<br>08/09/11 | Signature of Technician       |                |

|  |   |
|--|---|
| Date 1st Well in Cluster Constructed<br>(yyyy/mm/dd)<br>2009/08/31 | Date Last Well in Cluster Constructed<br>(yyyy/mm/dd)<br>2009/08/31 |
| Ministry Use Only  |   |
| Date Received (yyyy/mm/dd)<br>SEP 22 2009                          | Date Inspected (yyyy/mm/dd)   |
| Audit No.<br>C 03827   | Remarks<br>M02599   |





**Trow Associates Inc.** 154 Colonnade Road South, Tel: (613) 225-9940  
Ottawa, Ontario K2E 7J5 Fax: (613) 225-7337

|                   |   |                          |
|-------------------|---|--------------------------|
| DATE<br>JULY 2009 | CLIENT<br>VINTAGE PAVING                                    | JOB No.<br>OTEN00020135A |
| DESIGN<br>CB      | CHECKED<br>CH   | SCALE<br>1:1250±         |
| DRAWN<br>RG       | TITLE<br>SITE LAYOUT<br>6906 McKEOWN DRIVE, GREELY (OTTAWA) | FIG 2                    |

SEP 22 2009  
C-7241 M02599 203827

A085398

Well Tag No. for Master Well (Place Sticker and/or Print Below)

**A 085398**

10/19 Page 1 of 3

Address of Well Location (Street Number/Name, RR) **6906 McKeown Rd** Township \_\_\_\_\_ Lot \_\_\_\_\_ Concession \_\_\_\_\_  
 County/District/Municipality \_\_\_\_\_ City/Town/Village **Greely** Province **Ontario** Postal Code \_\_\_\_\_

UTM Coordinates Zone Easting Northing GPS Unit Make Model Mode of Operation:  Undifferentiated  Averaged  
**NAD 83 18 455060 5011834** **Garmin** **Etrex**  Differentiated, specify \_\_\_\_\_

| Overburden and Bedrock Materials (see instructions on the back of this form) |                      |                 |                     |                        |
|--|----------------------|-----------------|---------------------|------------------------|
| General Colour   | Most Common Material | Other Materials | General Description | Depth (Metres) From To |
| Grey   | Gravel               | Sand            | soft, dry           | 0 .61                  |
| Brn  | Sand                 |                 | soft, dry           | .61 1.5                |
| grey   | clay                 |                 | soft, moist         | 1.5 2.74               |
| grey   | silt                 |                 | Wet                 | 2.74 4.88              |

| Hole Details           |                        |  |
|------------------------|------------------------|--|
| Depth (Metres) From To | Diameter (Centimetres) |  |
| 0 4.88                 | 10.92                  |  |

**Water Use**

Public  Industrial  Not used  Other, specify \_\_\_\_\_  
 Domestic  Commercial  Dewatering \_\_\_\_\_  
 Livestock  Municipal  Monitoring \_\_\_\_\_  
 Irrigation  Test Hole  Cooling & Air Conditioning \_\_\_\_\_

**Method of Construction**

Cable Tool  Air Percussion  Digging \_\_\_\_\_  
 Rotary (Conventional)  Diamond  Boring \_\_\_\_\_  
 Rotary (Reverse)  Jetting  Other, specify \_\_\_\_\_  
 Rotary (Air)  Driving **Direct Push** \_\_\_\_\_

**Status of Well**

Test Hole  Abandoned, Insufficient Supply \_\_\_\_\_  
 Replacement Well  Abandoned, Poor Water Quality \_\_\_\_\_  
 Dewatering Well  Other, specify **monitoring** \_\_\_\_\_  
 Alteration (Construction)  Abandoned, other, specify \_\_\_\_\_

**No Casing and Screen Used**  Yes  No

**Static Water Level Test** \_\_\_\_\_ Metres

**Screen**

Galvanized  Steel  Fibreglass  Concrete  Plastic

Outside Diameter (Centimetres) **6.03** Slot No. **10**

**Water Details**

Water found at Depth \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals

Water found at Depth \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals

Water found at Depth \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals

Disinfected  Yes  No. If no, provide reason: \_\_\_\_\_ Date Master Well Completed (yyyy/mm/dd) **2009/08/31**

**Cluster Information (Please also fill out the additional Cluster Well Information for Well Construction for each parcel of land and cluster.)**

Total Wells in Cluster **4** Please indicate Number of Cluster Well Information Log Sheets Submitted \_\_\_\_\_  
 Total Wells on this Property **4** **1**

**Location of Well Cluster**

Detailed Map must be provided as an attachment no larger than legal size (8.5"x 14"). Sketches are not allowed.  
 Check box to confirm detailed map is provided as per Section 11.1 (3)

**Construction Details**

| Inside Diameter (Centimetres) | Material (steel, plastic, fibreglass, concrete, galvanized) | Wall Thickness | Depth (Metres) From To |
|-------------------------------|---|----------------|------------------------|
| 5.20                          | PVC Riser   | .390           | 0 1.83                 |
|                               | PVC Screen  |                | 1.83 4.88              |

**Annular Space/Abandonment Sealing Record**

| Depth Set at (Metres) From To | Type of Sealant Used (Material and Type) | Volume Used (Cubic Metres) |
|-------------------------------|--|----------------------------|
| 0 .31                         | Concrete / Flushmount                    |                            |
| .31 1.5                       | Benseal                                  |                            |
| 1.5 4.88                      | sand                                     |                            |

**Well Contractor and Well Technician Information**

Business Name of Well Contractor **Strata Soil Sampling** Well Contractor's Licence No. **7241**  
 Business Address (Street No./Name, number, RR) **#2-147 West Beaver Creek** Municipality **Richmond Hill**  
 Province **ON** Postal Code **L4B1C6** Business E-mail Address \_\_\_\_\_  
 Bus. Telephone No. (inc. area code) **(905) 764-9301** Name of Well Technician (Last Name, First Name) **Rebecca Teas**  
 Well Technician's Licence No. **31659** Signature of Technician \_\_\_\_\_ Date Submitted (yyyy/mm/dd) **2009/09/11**

**Ministry Use Only**

Audit No. **M 02599** Well Contractor No. \_\_\_\_\_  
 Date Received (yyyy/mm/dd) **SEP 22 2009** Date of Inspection (yyyy/mm/dd) \_\_\_\_\_  
 Remarks \_\_\_\_\_

A085398

|  |                     |             |                         |                |  |                              |
|--|---------------------|-------------|-------------------------|----------------|--|------------------------------|
| Address of Well Location (Street Number/Name, RR)<br>6906 McKeown Rd |                     |             | Lot                     | Concession     | Township   | County/District/Municipality |
| City/Town/Village<br>Greely  | Province<br>Ontario | Postal Code | GPS Unit Make<br>Garmin | Model<br>Etrex | Unit Mode of Operation<br><input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged |                              |

|                                    |                   |
|------------------------------------|-------------------|
| upon request                       |                   |
| Signature of Technician/Contractor | Date (yyyy/mm/dd) |

| Well # on Sketch | UTM Coordinates |         | Full Depth of Hole (metres) | Hole Diameter (cm) | Method of Construction | Casing Material | Casing Length (metres) | Screen Interval (metres) |      | Annular Space Sealant Used | Static Water Level (metres) | Abandonment Sealant Used | Comments | Date of Completion (yyyy/mm/dd) |
|------------------|-----------------|---------|-----------------------------|--------------------|------------------------|-----------------|------------------------|--------------------------|------|----------------------------|-----------------------------|--------------------------|----------|---------------------------------|
|                  | Zone            | Easting |                             |                    |                        |                 |                        | Northing                 | From |                            |                             |                          |          |                                 |
| 2                | 18              | 455042  | 5011837                     | 4.88               | 10.92                  | Direct Push     | PVC                    | 1.83                     | 1.83 | 4.88                       | Benseal                     |                          |          | 2009/08/31                      |
| 3                | 18              | 455051  | 5011843                     | 4.88               | 10.92                  | Direct Push     | PVC                    | 1.83                     | 1.83 | 4.88                       | Benseal                     |                          |          | 2009/08/31                      |
| 4                | 18              | 455052  | 5011837                     | 4.88               | 10.92                  | Direct Push     | PVC                    | 1.83                     | 1.83 | 4.88                       | Benseal                     |                          |          | 2009/08/31                      |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |
|                  |                 |         |                             |                    |                        |                 |                        |                          |      |                            |                             |                          |          |                                 |

|  |   |   |   |
|--|---|---|---|
| <b>Well Contractor and Well Technician Information</b>             |   |   |   |
| Business Name of Well Contractor<br>Strata Soil Sampling           |   | Business Address (Street Number/Name, RR)<br>#2-147 West Beaver Creek |   |
| Municipality<br>Richmond Hill                                      |   | Province<br>ON  |   |
| Postal Code<br>L4B 1C6   | Business Telephone No. (inc. area code)<br>(905) 769-9304 | Well Contractor's Licence No.<br>72411                                | Business E-mail Address                 |
| Name of Well Technician (First Name, Last Name)<br>Trevor Robinson |   | Well Technician's Licence No.<br>8159                                 | Date Submitted (yyyy/mm/dd)<br>08/09/11 |
|  |   | Signature of Technician<br>   |   |

|  |   |
|--|---|
| Date 1st Well in Cluster Constructed<br>(yyyy/mm/dd)<br>2009/08/31 | Date Last Well in Cluster Constructed<br>(yyyy/mm/dd)<br>2009/08/31 |
| <b>Ministry Use Only</b>   |   |
| Date Received (yyyy/mm/dd)<br>SEP 22 2009                          | Date Inspected (yyyy/mm/dd)   |
| Audit No.<br>C 03827   | Remarks<br>M02599   |





**Trow Associates Inc.** 154 Colonnade Road South, Tel: (613) 225-9940  
Ottawa, Ontario K2E 7J5 Fax: (613) 225-7337

|                   |   |                          |
|-------------------|---|--------------------------|
| DATE<br>JULY 2009 | CLIENT<br>VINTAGE PAVING                                    | JOB No.<br>OTEN00020135A |
| DESIGN<br>CB      | CHECKED<br>CH   | SCALE<br>1:1250±         |
| DRAWN<br>RG       | TITLE<br>SITE LAYOUT<br>6906 McKEOWN DRIVE, GREELY (OTTAWA) | FIG 2                    |

SEP 22 2009  
C-7241 M02599 203827

A085398

Well Tag No. for Master Well (Place Sticker and/or Print Below)

**A 085398**

10/19 Page 1 of 3

Address of Well Location (Street Number/Name, RR) **6906 McKeown Rd** Township \_\_\_\_\_ Lot \_\_\_\_\_ Concession \_\_\_\_\_  
 County/District/Municipality \_\_\_\_\_ City/Town/Village **Greely** Province **Ontario** Postal Code \_\_\_\_\_

UTM Coordinates Zone Easting Northing GPS Unit Make Model Mode of Operation:  
 NAD **83** **18** **455060** **5011834** **Garmin** **Etrex**  Undifferentiated  Averaged  
 Differentiated, specify \_\_\_\_\_

**Overburden and Bedrock Materials (see instructions on the back of this form)**

| General Colour | Most Common Material | Other Materials | General Description | Depth (Metres) |      |
|----------------|----------------------|-----------------|---------------------|----------------|------|
|                |                      |                 |                     | From           | To   |
| Grn            | Gravel               | Sand            | soft, dry           | 0              | .61  |
| Brn            | Sand                 |                 | soft, dry           | .61            | 1.5  |
| brn            | clay                 |                 | soft, moist         | 1.5            | 2.74 |
| brn            | silt                 |                 | Wet                 | 2.74           | 4.88 |

**Hole Details**

| Depth (Metres) | Diameter (Centimetres) |       |
|----------------|------------------------|-------|
|                | From                   | To    |
| 0              | 4.88                   | 10.92 |

**Water Use**

Public  Industrial  Not used  Other, specify \_\_\_\_\_  
 Domestic  Commercial  Dewatering  
 Livestock  Municipal  Monitoring  
 Irrigation  Test Hole  Cooling & Air Conditioning

**Method of Construction**

Cable Tool  Air Percussion  Digging  
 Rotary (Conventional)  Diamond  Boring  
 Rotary (Reverse)  Jetting  Other, specify \_\_\_\_\_  
 Rotary (Air)  Driving **Direct Push**

**Status of Well**

Test Hole  Abandoned, Insufficient Supply  
 Replacement Well  Abandoned, Poor Water Quality  
 Dewatering Well  Other, specify **monitoring**  
 Alteration (Construction)  Abandoned, other, specify \_\_\_\_\_

**No Casing and Screen Used**  Yes  No

**Static Water Level Test** \_\_\_\_\_ Metres

**Screen**

Galvanized  Steel  Fibreglass  Concrete  Plastic

Outside Diameter (Centimetres) **6.03** Slot No. **10**

**Water Details**

Water found at Depth \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals  
 Water found at Depth \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals  
 Water found at Depth \_\_\_\_\_ Metres  Gas  Fresh  Salty  Sulphur  Minerals

Disinfected  Yes  No. If no, provide reason: \_\_\_\_\_ Date Master Well Completed (yyyy/mm/dd) **2009/08/31**

**Cluster Information (Please also fill out the additional Cluster Well Information for Well Construction for each parcel of land and cluster.)**

Total Wells in Cluster **4** Please indicate Number of Cluster Well Information Log Sheets Submitted **1**  
 Total Wells on this Property **4**

**Location of Well Cluster**

Detailed Map must be provided as an attachment no larger than legal size (8.5"x 14"). Sketches are not allowed.  
 Check box to confirm detailed map is provided as per Section 11.1 (3)

**Construction Details**

| Inside Diameter (Centimetres) | Material (steel, plastic, fibreglass, concrete, galvanized) | Wall Thickness | Depth (Metres) |             |
|-------------------------------|---|----------------|----------------|-------------|
|                               |   |                | From           | To          |
| <b>5.20</b>                   | <b>PVC Riser</b>  | <b>.390</b>    | <b>0</b>       | <b>1.83</b> |
|                               | <b>PVC Screen</b>   |                | <b>1.83</b>    | <b>4.88</b> |

**Annular Space/Abandonment Sealing Record**

| Depth Set at (Metres) |             | Type of Sealant Used (Material and Type) | Volume Used (Cubic Metres) |
|-----------------------|-------------|--|----------------------------|
| From                  | To          |  |                            |
| <b>0</b>              | <b>.31</b>  | <b>Concrete / Flushmount</b>             |                            |
| <b>.31</b>            | <b>1.5</b>  | <b>Benseal</b>                           |                            |
| <b>1.5</b>            | <b>4.88</b> | <b>sand</b>                              |                            |

**Well Contractor and Well Technician Information**

Business Name of Well Contractor **Strata Soil Sampling** Well Contractor's Licence No. **7241**  
 Business Address (Street No./Name, number, RR) **#2-147 West Beaver Creek** Municipality **Richmond Hill**  
 Province **ON** Postal Code **L4B1C6** Business E-mail Address \_\_\_\_\_  
 Bus. Telephone No. (inc. area code) **(905) 764-9301** Name of Well Technician (Last Name, First Name) **Robynne Teas**  
 Well Technician's Licence No. **31659** Signature of Technician \_\_\_\_\_ Date Submitted (yyyy/mm/dd) **2009/09/11**

**Ministry Use Only**

Audit No. **M 02599** Well Contractor No. \_\_\_\_\_  
 Date Received (yyyy/mm/dd) **SEP 22 2009** Date of Inspection (yyyy/mm/dd) \_\_\_\_\_  
 Remarks \_\_\_\_\_

A085398

|  |                     |             |                         |                |   |
|--|---------------------|-------------|-------------------------|----------------|---|
| Address of Well Location (Street Number/Name, RR)<br>6906 McKeown Rd |                     | Lot         | Concession              | Township       | County/District/Municipality  |
| City/Town/Village<br>Greely  | Province<br>Ontario | Postal Code | GPS Unit Make<br>Garmin | Model<br>Etrex | Unit Mode of Operation<br><input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged<br><input type="checkbox"/> Differentiated, specify: |

|                                    |                   |
|------------------------------------|-------------------|
| upon request                       |                   |
| Signature of Technician/Contractor | Date (yyyy/mm/dd) |

| Well # on Sketch | UTM Coordinates |         | Full Depth of Hole (metres) | Hole Diameter (cm) | Method of Construction | Casing Material | Casing Length (metres) | Screen Interval (metres) |      | Annular Space Sealant Used | Static Water Level (metres) | Abandonment Sealant Used | Comments | Date of Completion (yyyy/mm/dd) |
|------------------|-----------------|---------|-----------------------------|--------------------|------------------------|-----------------|------------------------|--------------------------|------|----------------------------|-----------------------------|--------------------------|----------|---------------------------------|
|                  | Zone            | Easting |                             |                    |                        |                 |                        | Northing                 | From |                            |                             |                          |          |                                 |
| 2                | 18              | 455042  | 5011837                     | 4.88               | 10.92                  | Direct Push     | PVC                    | 1.83                     | 1.83 | 4.88                       | Benseal                     |                          |          | 2009/08/31                      |
| 3                | 18              | 455051  | 5011843                     | 4.88               | 10.92                  | Direct Push     | PVC                    | 1.83                     | 1.83 | 4.88                       | Benseal                     |                          |          | 2009/08/31                      |
| 4                | 18              | 455052  | 5011837                     | 4.88               | 10.92                  | Direct Push     | PVC                    | 1.83                     | 1.83 | 4.88                       | Benseal                     |                          |          | 2009/08/31                      |

|  |   |   |   |                               |                |
|--|---|---|---|-------------------------------|----------------|
| Well Contractor and Well Technician Information                    |   |   |   |                               |                |
| Business Name of Well Contractor<br>Strata Soil Sampling           |   | Business Address (Street Number/Name, RR)<br>#2-147 West Beaver Creek |   | Municipality<br>Richmond Hill | Province<br>ON |
| Postal Code<br>L4B 1C6   | Business Telephone No. (inc. area code)<br>(905) 769-9304 | Well Contractor's Licence No.<br>72411                                | Business E-mail Address                 |                               |                |
| Name of Well Technician (First Name, Last Name)<br>Trevor Robinson |   | Well Technician's Licence No.<br>8159                                 | Date Submitted (yyyy/mm/dd)<br>08/09/11 | Signature of Technician       |                |

|  |   |
|--|---|
| Date 1st Well in Cluster Constructed<br>(yyyy/mm/dd)<br>2009/08/31 | Date Last Well in Cluster Constructed<br>(yyyy/mm/dd)<br>2009/08/31 |
| Ministry Use Only  |   |
| Date Received (yyyy/mm/dd)<br>SEP 22 2009                          | Date Inspected (yyyy/mm/dd)   |
| Audit No.<br>C 03827   | Remarks<br>M02599   |





**Trow Associates Inc.** 154 Colonnade Road South, Tel: (613) 225-9940  
Ottawa, Ontario K2E 7J5 Fax: (613) 225-7337

|                   |   |                          |
|-------------------|---|--------------------------|
| DATE<br>JULY 2009 | CLIENT<br>VINTAGE PAVING                                    | JOB No.<br>OTEN00020135A |
| DESIGN<br>CB      | CHECKED<br>CH   | SCALE<br>1:1250±         |
| DRAWN<br>RG       | TITLE<br>SITE LAYOUT<br>6906 McKEOWN DRIVE, GREELY (OTTAWA) | FIG 2                    |

SEP 22 2009  
C-7241 M02599 203827



Measurements recorded in:  Metric  Imperial

**A095924**

**Well Owner's Information**

First Name: **MANOR** Last Name / Organization: **DEVELOPMENTS** E-mail Address: \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name): **1269 South Beach Blvd** Municipality: **Greely Ont** Province: **Ont** Postal Code: **K4P 0A5** Telephone No. (inc. area code): \_\_\_\_\_

**Well Location**

Address of Well Location (Street Number/Name): **#1363 South Beach Blvd** Township: **Osgoode** Lot: **4** Concession: **4**

County/District/Municipality: **Ottawa-Carleton** City/Town/Village: **Greely** Province: **Ontario** Postal Code: \_\_\_\_\_

UTM Coordinates Zone: **18** Easting: **454641** Northing: **5012313** Municipal Plan and Sublot Number: **PLAN 4M-1265** Other: **S/L 80**

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

| General Colour | Most Common Material           | Other Materials | General Description | Depth (m/ft) From | To     |
|----------------|--------------------------------|-----------------|---------------------|-------------------|--------|
|                | Sand, Gravel + boulders        |                 |                     | 0                 | 45' 6" |
|                | Grey limestone                 |                 |                     | 45' 2"            | 145'   |
|                | Grey Sandstone                 |                 |                     | 145'              | 215'   |
|                | Grey limestone + Sandstone Mix |                 |                     | 215'              | 248'   |
|                | Grey + White Sandstone         |                 |                     | 248'              | 301'   |

**Annular Space**

| Depth Set at (m/ft) From | To  | Type of Sealant Used (Material and Type) | Volume Placed (m <sup>3</sup> /ft <sup>3</sup> ) |
|--------------------------|-----|--|--|
| 54'                      | 44' | Neat Cement Slurry                       | 7.8  |
| 44'                      | 0'  | Neat Bentonite Slurry                    | 29.4   |

**Results of Well Yield Testing**

After test of well yield, water was:  Clear and sand free  Other, specify: \_\_\_\_\_

If pumping discontinued, give reason: **TESTED**

| Pumping rate (l/min / GPM) | Draw Down  |                    | Recovery   |                    |
|----------------------------|------------|--------------------|------------|--------------------|
|                            | Time (min) | Water Level (m/ft) | Time (min) | Water Level (m/ft) |
| 20                         | 31' 3"     | 52' 5"             |            |                    |
| 20                         | 1' 35' 8"  | 1' 41' 6"          |            |                    |
| 20                         | 2' 40'     | 2' 34' 2"          |            |                    |
| 20                         | 3' 44'     | 3' 31' 3"          |            |                    |
| 20                         | 4' 48'     | 4'                 |            |                    |
| 20                         | 5' 50'     | 5'                 |            |                    |
| 20                         | 10' 52' 1" | 10'                |            |                    |
| 20                         | 15' ↓      | 15'                |            |                    |
| 20                         | 20' 52' 2" | 20'                |            |                    |
| 20                         | 25' ↓      | 25'                |            |                    |
| 20                         | 30' 52' 4" | 30'                |            |                    |
| 20                         | 40' ↓      | 40'                |            |                    |
| 20                         | 50' 52' 5" | 50'                |            |                    |
| 20                         | 60' ↓      | 60'                |            |                    |

Final water level end of pumping (m/ft): **52' 5"**

If flowing give rate (l/min / GPM): **20**

Recommended pump depth (m/ft): **200'**

Recommended pump rate (l/min / GPM): **20**

Well production (l/min / GPM): **20**

Disinfected?  Yes  No

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used

Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering

Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring

Boring  Digging  Irrigation  Cooling & Air Conditioning

Air percussion  Industrial  Other, specify \_\_\_\_\_

Other, specify \_\_\_\_\_

**Construction Record - Casing**

| Inside Diameter (cm/in) | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm/in) | Depth (m/ft) |    | Status of Well                                   |
|-------------------------|--|------------------------|--------------|----|--|
|                         |  |                        | From         | To |  |
| 6"                      | Steel  | 188"                   | 12' 54'      |    | <input checked="" type="checkbox"/> Water Supply |
| 6"                      | Openhole   |                        | 54' 301'     |    | <input type="checkbox"/> Replacement Well        |

Test Hole  Recharge Well  Dewatering Well  Observation and/or Monitoring Hole  Alteration (Construction)  Abandoned, Insufficient Supply  Abandoned, Poor Water Quality  Abandoned, other, specify \_\_\_\_\_  Other, specify \_\_\_\_\_

**Construction Record - Screen**

| Outside Diameter (cm/in) | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft) |    | Status of Well  |
|--------------------------|---------------------------------------|----------|--------------|----|---|
|                          |                                       |          | From         | To |   |
|                          |                                       |          |              |    | <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____ |

**Water Details**

| Water found at Depth (m/ft) | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____ |
|-----------------------------|---|
| 146'                        |   |
| 295'                        |   |

**Hole Diameter**

| Depth (m/ft) From | To   | Diameter (cm/in) |
|-------------------|------|------------------|
| 0'                | 301' | 6"               |

**Well Contractor and Well Technician Information**


Business Name of Well Contractor: **Air Rock Drilling Co Ltd** Well Contractor's Licence No.: **11119**

Business Address (Street Number/Name): **Richmond** Municipality: **Richmond**

Province: **Ont** Postal Code: **K0A 2Z0** Business E-mail Address: \_\_\_\_\_

Bus. Telephone No. (inc. area code): **6138380170** Name of Well Technician (Last Name, First Name): **GRAHAM RYAN**

Well Technician's Licence No.: **T3484** Signature of Technician and/or Contractor: **[Signature]** Date Submitted: **20100510**

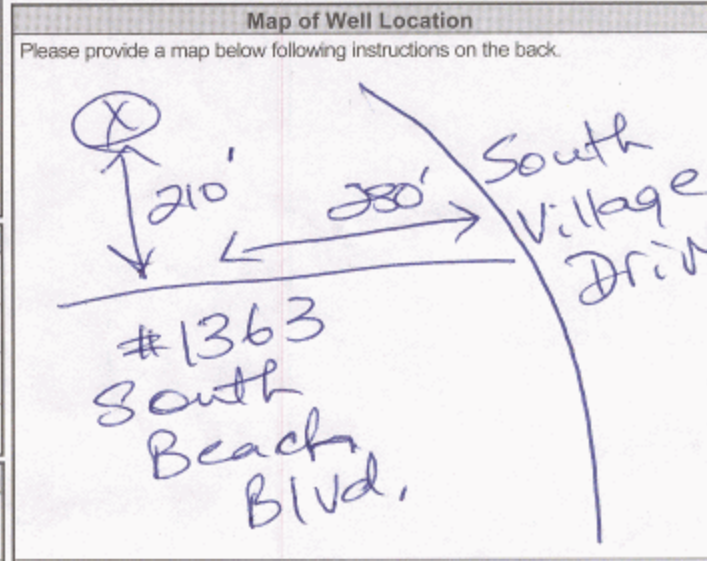

Comments: \_\_\_\_\_

|  |   |  |
|--|---|--|
| Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | Date Package Delivered: <b>20100405</b> | Ministry Use Only<br>Audit No. <b>Z 108300</b> |
| Date Work Completed: <b>20100315</b>   | Reg. No. <b>JUN 01 2010</b>             |  |



Well ID: A095990

Address of Well Location (Street Number/Name) #1385 South Beach Blvd Township Osgoode Lot 4 Concession 4  
 County/District/Municipality Ottawa-Carleton City/Town/Village Greely Province Ontario Postal Code       
 UTM Coordinates Zone 18 Easting 454728 Northing 5012346 Municipal Plan and Sublot Number PLAN 4M-1265 Other 3/L82

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

| General Colour | Most Common Material                   | Other Materials | General Description | Depth (m/ft) From | Depth (m/ft) To |
|----------------|--|-----------------|---------------------|-------------------|-----------------|
|                | Sand, Gravel + boulders                |                 |                     | 0ft               | 42'             |
|                | Gray limestone                         |                 |                     | 42'               | 155'            |
|                | Gray Sandstone                         |                 |                     | 155'              | 172'            |
|                | Gray + White Sandstone + limestone Mix |                 |                     | 172'              | 300'            |

**Annular Space**

| Depth Set at (m/ft) From | Depth Set at (m/ft) To | Type of Sealant Used (Material and Type) | Volume Placed (m <sup>3</sup> /ft <sup>3</sup> ) |
|--------------------------|------------------------|--|--|
| 50'                      | 40'                    | Neat Cement Slurry                       | 7.8  |
| 40'                      | 0'                     | Neat Bentonite Slurry                    | 18.90  |

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify TESTED

If pumping discontinued, give reason:  
 Pump intake set at (m/ft) 250'

Pumping rate (l/min / GPM) 20

Duration of pumping 1 hrs 0 min

Final water level end of pumping (m/ft) 36'6"

If flowing give rate (l/min / GPM) 20

Recommended pump depth (m/ft) 36'5"

Recommended pump rate (l/min / GPM) 20

Well production (l/min / GPM) 20

Disinfected?  Yes  No

| Time (min)   | Draw Down          |            | Recovery           |            |
|--------------|--------------------|------------|--------------------|------------|
|              | Water Level (m/ft) | Time (min) | Water Level (m/ft) | Time (min) |
| Static Level | 35'6"              |            | 36'6"              |            |
| 1            | 36'3"              | 1          | 35'6"              |            |
| 2            | ↓                  | 2          |                    |            |
| 3            | ↓                  | 3          |                    |            |
| 4            | 36'4"              | 4          |                    |            |
| 5            | ↓                  | 5          |                    |            |
| 10           | ↓                  | 10         |                    |            |
| 15           | ↓                  | 15         |                    |            |
| 20           | 36'5"              | 20         |                    |            |
| 25           | ↓                  | 25         |                    |            |
| 30           | ↓                  | 30         |                    |            |
| 40           | ↓                  | 40         |                    |            |
| 50           | 36'6"              | 50         |                    |            |
| 60           | ↓                  | 60         |                    |            |

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify     

**Construction Record - Casing**

| Inside Diameter (cm/in) | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm/in) | Depth (m/ft) |      | Status of Well                                   |
|-------------------------|--|------------------------|--------------|------|--|
|                         |  |                        | From         | To   |  |
| 6"                      | Steel  | .188"                  | 0'           | 50'  | <input checked="" type="checkbox"/> Water Supply |
| 6 1/4"                  | open hole  |                        | 50'          | 300' | <input type="checkbox"/> Replacement Well        |


Test Hole  Recharge Well  Dewatering Well  Observation and/or Monitoring Hole  Alteration (Construction)  Abandoned, Insufficient Supply  Abandoned, Poor Water Quality  Abandoned, other, specify       Other, specify     

**Construction Record - Screen**

| Outside Diameter (cm/in) | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft) |    |
|--------------------------|---------------------------------------|----------|--------------|----|
|                          |                                       |          | From         | To |
|                          |                                       |          |              |    |

**Water Details**

| Water found at Depth (m/ft) | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested | Depth (m/ft) From | Depth (m/ft) To | Diameter (cm/in) |
|-----------------------------|--|-------------------|-----------------|------------------|
| 172                         | <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify <u>    </u>           | 0'                | 50'             | 6"               |
| 274                         | <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify <u>    </u>           | 50'               | 300'            | 6 1/4"           |

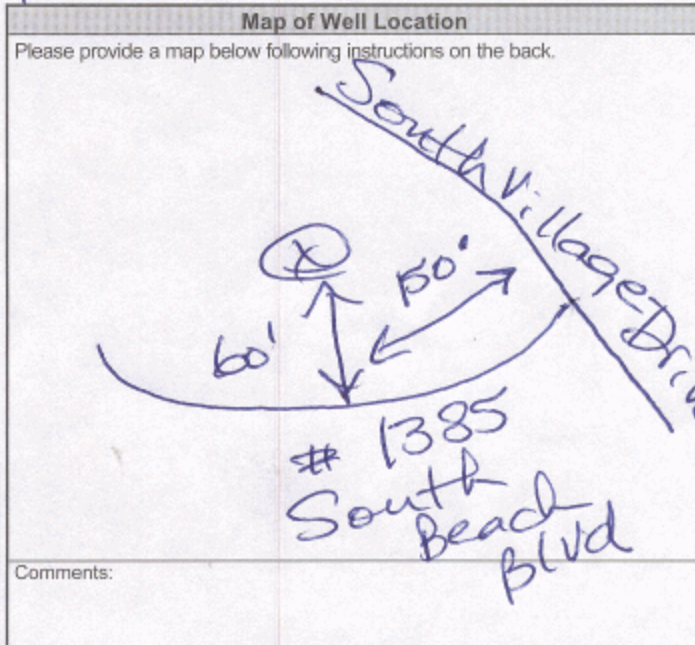

**Well Contractor and Well Technician Information**

Business Name of Well Contractor AIR ROCK DRILLING CO LTD Well Contractor's Licence No. 1119  
 Business Address (Street Number/Name) RR#1 RICHMOND Municipality       
 Province ONT Postal Code K0A2Z0 Business E-mail Address     

Bus. Telephone No. (inc. area code) 613 838 2170 Name of Well Technician (Last Name, First Name) GRAHAM RYAN  
 Well Technician's Licence No. T3484 Signature of Technician and/or Contractor [Signature] Date Submitted 20100510

Well owner's information package delivered  Yes  No

Date Package Delivered 20100427 Date Work Completed 20100421

**Ministry Use Only**

Audit No. Z108320  
 JUN 01 2010  
 Received



**Well Location**

|  |                  |                                    |   |             |
|--|------------------|------------------------------------|---|-------------|
| Address of Well Location (Street Number/Name)<br><b>1344 Barfield Street</b> |                  | Township<br><b>Osgoode</b>         | Lot<br><b>Part 62, 63 + 64</b>                    | Concession  |
| County/District/Municipality<br><b>Ottawa Carleton</b>                       |                  | City/Town/Village<br><b>Greely</b> | Province<br><b>Ontario</b>                        | Postal Code |
| UTM Coordinates Zone   | Easting          | Northing                           | Municipal Plan and Sublot Number<br><b>4M-351</b> |             |
| NAD 83   | <b>18 454720</b> | <b>5011766</b>                     | Other<br><b>PT BLK 5 RP 4R054 27</b>              |             |

**Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)**

| General Colour | Most Common Material | Other Materials | General Description            | Depth (m(ft)) |            |
|----------------|----------------------|-----------------|--------------------------------|---------------|------------|
|                |                      |                 |                                | From          | To         |
|                |                      |                 | <b>Silty Sand</b>              | <b>0'</b>     | <b>26'</b> |
|                |                      |                 | <b>Sand, Gravel + Boulders</b> | <b>26</b>     | <b>54</b>  |
|                |                      |                 | <b>Grey + Brown limestone</b>  | <b>54</b>     | <b>120</b> |

| Annular Space                   |  |                        |  |
|---------------------------------|--|------------------------|--|
| Depth Set at (m(ft))            | Type of Sealant Used (Material and Type) | Volume Placed (m³/ft³) |  |
| From: <b>60'</b> To: <b>50'</b> | <b>Neat cement</b>                       | <b>7.8</b>             |  |
| From: <b>50'</b> To: <b>0'</b>  | <b>Bentonite slurry</b>                  | <b>25.2</b>            |  |

| Method of Construction                             |                                  | Well Use                                     |   |
|--|----------------------------------|--|---|
| <input type="checkbox"/> Cable Tool                | <input type="checkbox"/> Diamond | <input type="checkbox"/> Public              | <input type="checkbox"/> Commercial                 |
| <input type="checkbox"/> Rotary (Conventional)     | <input type="checkbox"/> Jetting | <input checked="" type="checkbox"/> Domestic | <input type="checkbox"/> Municipal                  |
| <input type="checkbox"/> Rotary (Reverse)          | <input type="checkbox"/> Driving | <input type="checkbox"/> Livestock           | <input type="checkbox"/> Test Hole                  |
| <input type="checkbox"/> Boring                    | <input type="checkbox"/> Digging | <input type="checkbox"/> Irrigation          | <input type="checkbox"/> Cooling & Air Conditioning |
| <input checked="" type="checkbox"/> Air percussion |                                  | <input type="checkbox"/> Industrial          |   |
| <input type="checkbox"/> Other, specify            |                                  | <input type="checkbox"/> Other, specify      |   |

| Construction Record - Casing |  |                        |                 | Status of Well                                   |   |
|------------------------------|--|------------------------|-----------------|--|---|
| Inside Diameter (cm/in)      | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm/in) | Depth (m(ft))   | <input checked="" type="checkbox"/> Water Supply | <input type="checkbox"/> Replacement Well                   |
|                              |  |                        | From To         |  |   |
| <b>6"</b>                    | <b>Steel</b>   | <b>.188"</b>           | <b>+2' 60'</b>  | <input type="checkbox"/> Test Hole               | <input type="checkbox"/> Recharge Well                      |
| <b>515/16</b>                | <b>Open Hole</b>   |                        | <b>60' 120'</b> | <input type="checkbox"/> Dewatering Well         | <input type="checkbox"/> Observation and/or Monitoring Hole |

| Construction Record - Screen |                                       |          |               | Status of Well  |
|------------------------------|---------------------------------------|----------|---------------|---|
| Outside Diameter (cm/in)     | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m(ft)) |   |
|                              |                                       |          | From To       |   |
|                              |                                       |          |               | <input type="checkbox"/> Alteration (Construction)      |
|                              |                                       |          |               | <input type="checkbox"/> Abandoned, Insufficient Supply |
|                              |                                       |          |               | <input type="checkbox"/> Abandoned, Poor Water Quality  |
|                              |                                       |          |               | <input type="checkbox"/> Abandoned, other, specify      |
|                              |                                       |          |               | <input type="checkbox"/> Other, specify                 |

| Water Details                          |   | Hole Diameter                    |                  |  |
|--|---|----------------------------------|------------------|--|
| Water found at Depth <b>65</b> (m/ft)  | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify | Depth (m/ft)                     | Diameter (cm/in) |  |
| Water found at Depth <b>105</b> (m/ft) | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify | From: <b>0'</b> To: <b>60'</b>   | <b>6"</b>        |  |
| Water found at Depth <b>113</b> (m/ft) | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify | From: <b>60'</b> To: <b>120'</b> | <b>515/16</b>    |  |

| Well Contractor and Well Technician Information                           |  |
|---|--|
| Business Name of Well Contractor<br><b>Air Rock Drilling Co. Ltd.</b>     | Well Contractor's Licence No.<br><b>1119</b> |
| Business Address (Street Number/Name)<br><b>6659 Franktown Road, RR#1</b> | Municipality<br><b>Richmond</b>              |
| Province<br><b>ON</b>   | Postal Code<br><b>K0A 2Z0</b>                |
| Business E-mail Address<br><b>air-rock@sympatico.ca</b>                   |  |

|  |  |
|--|--|
| Bus. Telephone No. (inc. area code)<br><b>6138382170</b> | Name of Well Technician (Last Name, First Name)<br><b>Graham, Ryan</b> |
| Well Technician's Licence No.<br><b>T3484</b>            | Signature of Technician and/or Contractor<br>                          |
| Date Submitted<br><b>2010 01 29</b>                      |  |

| Results of Well Yield Testing   |              |                    |            |                    |
|---|--------------|--------------------|------------|--------------------|
| After test of well yield, water was:<br><input type="checkbox"/> Clear and sand free<br><input type="checkbox"/> Other, specify <b>Not tested</b> | Draw Down    |                    | Recovery   |                    |
|   | Time (min)   | Water Level (m/ft) | Time (min) | Water Level (m/ft) |
| If pumping discontinued, give reason:<br><del>XXXXXXXXXX</del>  | Static Level | <b>4</b>           |            | <b>41.7</b>        |
|   | 1            | <b>12.8</b>        | 1          | <b>23.5</b>        |
|   | 2            | <b>17.2</b>        | 2          | <b>15.5</b>        |
|   | 3            | <b>20.2</b>        | 3          | <b>10.3</b>        |
|   | 4            | <b>22.5</b>        | 4          | <b>6.7</b>         |
|   | 5            | <b>24</b>          | 5          | <b>5.1</b>         |
| Pump intake set at (m(ft))<br><b>80'</b>  |              |                    |            |                    |
| Pumping rate (l/min / GPM)<br><b>20</b>   |              |                    |            |                    |
| Duration of pumping<br><b>1 hrs + 0 min</b>   |              |                    |            |                    |
| Final water level end of pumping (m/ft)<br><b>41.7'</b>   |              |                    |            |                    |
| If flowing give rate (l/min / GPM)  |              |                    |            |                    |
| Recommended pump depth (m(ft))<br><b>80'</b>  |              |                    |            |                    |
| Recommended pump rate (l/min / GPM)<br><b>20</b>  |              |                    |            |                    |
| Well production (l/min / GPM)<br><b>20</b>  |              |                    |            |                    |
| Disinfected?<br><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No   |              |                    |            |                    |

**Map of Well Location**

Please provide a map below following instructions on the back.

**Well owner's information package delivered**  
 Yes  No

**Date Package Delivered**  
Y 2010 M 01 D 17

**Date Work Completed**  
Y 2010 M 01 D 16

**Ministry Use Only**  
Audit No. **z119920**  
Received **DEC 29 2010**



Measurements recorded in:  Metric  Imperial

Page of

Well Location

Address of Well Location (Street Number/Name) 6906 McKeown Drive, Township Osgoode, Lot P/L5, Concession 4, County/District/Municipality Ottawa Carleton, City/Town/Village Greely, Province Ontario, Postal Code, UTM Coordinates Zone Easting Northing, Municipal Plan and Sublot Number Plan 4M-351 P/Block 3 less 4RS327

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

Part 1 to 9

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth From, Depth To. Includes handwritten entries: Sand & Gravel & Clay, Grey Limestone, 0' 56', 56' 180'

Annular Space table with columns: Depth Set at (m/ft) From, To, Type of Sealant Used (Material and Type), Volume Placed (m³/ft³). Includes entries for Neat cement and Bentonite slurry.

Results of Well Yield Testing table with columns: Draw Down (Time, Water Level), Recovery (Time, Water Level). Includes handwritten entries for pumping rate, duration, and water level.

Method of Construction and Well Use checkboxes. Includes options like Cable Tool, Rotary, Boring, Air percussion, and various well uses like Domestic, Commercial, etc.


Construction Record - Casing table with columns: Inside Diameter, Open Hole OR Material, Wall Thickness, Depth, Status of Well. Includes handwritten entries for Steel and Open Hole casing.

Construction Record - Screen table with columns: Outside Diameter, Material, Slot No., Depth. Includes handwritten entries for screen details.

Water Details and Hole Diameter tables. Includes columns for Water found at Depth, Kind of Water, and Hole Diameter (Depth, Diameter).

Well Contractor and Well Technician Information section. Includes Business Name (Air Rock Drilling Co. Ltd.), Licence No., Address, Municipality, Province, Postal Code, and Business E-mail Address.

Well Technician and Date Submitted section. Includes Bus. Telephone No., Name of Well Technician (Hogan, Dan), Signature, Date Submitted (2010 01 29), and Well Technician's Licence No. (T3058).

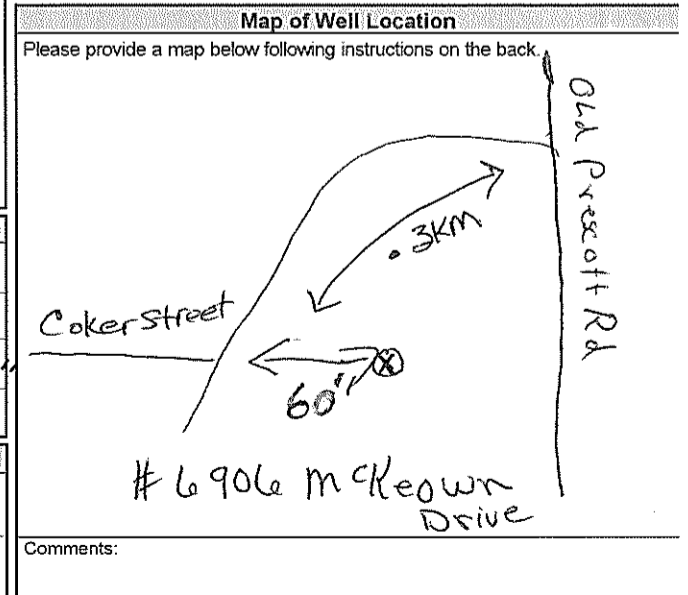

Ministry Use Only section. Includes Well owner's information package delivered status, Date Package Delivered (2010 01 25), Date Work Completed (2010 01 24), Audit No. (z119918), and Received date (JAN 17 2011).

Measurements recorded in:  Metric  Imperial

Well Location

Address of Well Location (Street Number/Name) **1333 South Beach Boulevard** Township **City Ottawa** Lot **Sublot 75** Concession **4**  
 County/District/Municipality **Osgoood** City/Town/Village **Osgoood** Province **Ontario** Postal Code **K0A 2W0**  
 UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other  
 NAD **83** **184545615012104** **R Plan 4M 1265**

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

| General Colour | Most Common Material | Other Materials | General Description | Depth (m/ft) |      |
|----------------|----------------------|-----------------|---------------------|--------------|------|
|                |                      |                 |                     | From         | To   |
| Brown          | Sand                 | clay            | soft                | 0            | 3.1  |
| Grey           | Sand coarse          | gravel, Stone   | soft/packed         | 3.1          | 12.5 |
| Grey           | gravel               | stone, Boulder  | packed              | 12.5         | 14.6 |
| Grey           | Limestone            |                 | layered             | 14.6         | 25.9 |

| Annular Space       |  |                        |  |
|---------------------|--|------------------------|--|
| Depth Set at (m/ft) | Type of Sealant Used (Material and Type) | Volume Placed (m³/ft³) |  |
| 0 to 16.6           | ciment grout                             | 7 Bag                  |  |

| Results of Well Yield Testing                           |                    |            |                    |
|---|--------------------|------------|--------------------|
| After test of well yield, water was:                    |                    |            |                    |
| <input checked="" type="checkbox"/> Clear and sand free |                    |            |                    |
| <input type="checkbox"/> Other, specify                 |                    |            |                    |
| If pumping discontinued, give reason:                   |                    |            |                    |
| Draw Down   |                    | Recovery   |                    |
| Time (min)  | Water Level (m/ft) | Time (min) | Water Level (m/ft) |
| Static Level  | 3.24               |            | 3.32               |
| 1   | 3.25               | 1          | 3.26               |
| 2   | 3.27               | 2          | 3.24               |
| 3   | 3.28               | 3          | 7                  |
| 4   | 3.28               | 4          |                    |
| 5   | 2.29               | 5          |                    |
| 10  | 3.30               | 10         |                    |
| 15  | 3.30               | 15         |                    |
| 20  | 3.31               | 20         |                    |
| 25  | 3.31               | 25         |                    |
| 30  | 3.32               | 30         |                    |
| 40  | 3.32               | 40         |                    |
| 50  | 3.32               | 50         |                    |
| 60  | 3.32               | 60         |                    |

| Method of Construction   |                                  | Well Use                                     |   |
|--|----------------------------------|--|---|
| <input type="checkbox"/> Cable Tool                                  | <input type="checkbox"/> Diamond | <input type="checkbox"/> Public              | <input type="checkbox"/> Commercial                 |
| <input type="checkbox"/> Rotary (Conventional)                       | <input type="checkbox"/> Jetting | <input checked="" type="checkbox"/> Domestic | <input type="checkbox"/> Municipal                  |
| <input type="checkbox"/> Rotary (Reverse)                            | <input type="checkbox"/> Driving | <input type="checkbox"/> Livestock           | <input type="checkbox"/> Test Hole                  |
| <input type="checkbox"/> Boring                                      | <input type="checkbox"/> Digging | <input type="checkbox"/> Irrigation          | <input type="checkbox"/> Cooling & Air Conditioning |
| <input type="checkbox"/> Air percussion                              |                                  | <input type="checkbox"/> Industrial          |   |
| <input checked="" type="checkbox"/> Other, specify <b>Air Rotary</b> |                                  | <input type="checkbox"/> Other, specify      |   |

| Construction Record - Casing |  |                        |              | Status of Well |  |
|------------------------------|--|------------------------|--------------|----------------|--|
| Inside Diameter (cm/in)      | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm/in) | Depth (m/ft) |                | <input checked="" type="checkbox"/> Water Supply<br><input type="checkbox"/> Replacement Well<br><input type="checkbox"/> Test Hole<br><input type="checkbox"/> Recharge Well<br><input type="checkbox"/> Dewatering Well<br><input type="checkbox"/> Observation and/or Monitoring Hole<br><input type="checkbox"/> Alteration (Construction)<br><input type="checkbox"/> Abandoned, Insufficient Supply<br><input type="checkbox"/> Abandoned, Poor Water Quality<br><input type="checkbox"/> Abandoned, other, specify<br><input type="checkbox"/> Other, specify |
|                              |  |                        | From         | To             |  |
| 15.55                        | Steel  | 0.48                   | 4.6          | 16.6           |  |
| 15.55                        | Open Hole  |                        | 16.6         | 25.9           |  |

| Construction Record - Screen |                                       |          |              |    |
|------------------------------|---------------------------------------|----------|--------------|----|
| Outside Diameter (cm/in)     | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft) |    |
|                              |                                       |          | From         | To |
|                              |                                       |          |              |    |

| Water Details                         |  | Hole Diameter                                |                               |
|---------------------------------------|--|--|-------------------------------|
| Water found at Depth <b>24 (m/ft)</b> | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested | Depth (m/ft) From <b>0</b> To <b>16.6</b>    | Diameter (cm/in) <b>21.23</b> |
| Water found at Depth <b>(m/ft)</b>    | Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested            | Depth (m/ft) From <b>16.6</b> To <b>25.9</b> | Diameter (cm/in) <b>15.55</b> |

Well Contractor and Well Technician Information

Business Name of Well Contractor **Bourgeois Well Drilling Ltd** Well Contractor's Licence No. **74117**  
 Business Address (Street Number/Name) **151 Montee D'Abust** Municipality **Nation**  
 Province **On** Postal Code **K0A 3C0** Business E-mail Address **N/A**  
 Bus. Telephone No. (inc. area code) **613 987 5291** Name of Well Technician (Last Name, First Name) **Gempier Michael**  
 Well Technician's Licence No. **3493** Signature of Technician and/or Contractor **[Signature]** Date Submitted **2011/01/23**

Map of Well Location

Please provide a map below following instructions on the back.

Comments:

Well owner's information package delivered  Yes  No

Date Package Delivered **2011/01/23**

Date Work Completed

Ministry Use Only

Audit No. **2127020**

Received **JAN 21 2011**



N/A

Measurements recorded in:  Metric  Imperial

Page \_\_\_\_\_ of \_\_\_\_\_

**Well Owner's Information**

First Name: **KEN GORDON** Last Name / Organization: **HOLDINGS** E-mail Address: \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name): **Box 310** Municipality: **Manotick Ont** Province: **Ont** Postal Code: **K4M 1A4** Telephone No. (inc. area code): \_\_\_\_\_

**Well Location**

Address of Well Location (Street Number/Name): **Parkway Road** Township: **Osgoode** Lot: **6** Concession: **4**

County/District/Municipality: **Ottawa-Carleton** City/Town/Village: **Greely** Province: **Ontario** Postal Code: \_\_\_\_\_

UTM Coordinates Zone: **18** Easting: **455214** Northing: **5011633** Municipal Plan and Sublot Number: \_\_\_\_\_ Other: \_\_\_\_\_

**Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)**

| General Colour | Most Common Material | Other Materials | General Description                | Depth (m/ft) From | Depth (m/ft) To |
|----------------|----------------------|-----------------|------------------------------------|-------------------|-----------------|
|                |                      |                 | <b>6" Drilled Well Abandonment</b> | <b>0'</b>         | <b>137'</b>     |

TW#5 - Tag A004862 - Audit 204877 - Feb 17, 2004

| Annular Space            |           |  |
|--------------------------|-----------|--|
| Depth Set at (m/ft) From | To        | Type of Sealant Used (Material and Type) |
| <b>137'</b>              | <b>6'</b> | <b>Grout plug</b>                        |
| <b>6'</b>                | <b>0'</b> | <b>Backfill</b>                          |

| Method of Construction  | Well Use  |
|---|---|
| <input type="checkbox"/> Cable Tool<br><input type="checkbox"/> Rotary (Conventional)<br><input type="checkbox"/> Rotary (Reverse)<br><input type="checkbox"/> Boring<br><input type="checkbox"/> Air percussion<br><input type="checkbox"/> Other, specify _____ | <input type="checkbox"/> Diamond<br><input type="checkbox"/> Jetting<br><input type="checkbox"/> Driving<br><input type="checkbox"/> Digging<br><input type="checkbox"/> Public<br><input type="checkbox"/> Domestic<br><input type="checkbox"/> Livestock<br><input type="checkbox"/> Irrigation<br><input type="checkbox"/> Industrial<br><input type="checkbox"/> Other, specify _____ |

| Construction Record - Casing |  |                        |              | Status of Well |  |
|------------------------------|--|------------------------|--------------|----------------|--|
| Inside Diameter (cm/in)      | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm/in) | Depth (m/ft) |                | <input type="checkbox"/> Water Supply<br><input type="checkbox"/> Replacement Well<br><input type="checkbox"/> Test Hole<br><input type="checkbox"/> Recharge Well<br><input type="checkbox"/> Dewatering Well<br><input type="checkbox"/> Observation and/or Monitoring Hole<br><input type="checkbox"/> Alteration (Construction)<br><input type="checkbox"/> Abandoned, Insufficient Supply<br><input type="checkbox"/> Abandoned, Poor Water Quality<br><input checked="" type="checkbox"/> Abandoned, other, specify <b>Construction (new subdivision)</b><br><input type="checkbox"/> Other, specify _____ |
|                              |  |                        | From         | To             |  |
|                              |  |                        |              |                |  |

| Construction Record - Screen |                                       |          |              |    |
|------------------------------|---------------------------------------|----------|--------------|----|
| Outside Diameter (cm/in)     | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft) |    |
|                              |                                       |          | From         | To |
|                              |                                       |          |              |    |

| Water Details  |   | Hole Diameter     |                  |
|--|---|-------------------|------------------|
| Water found at Depth (m/ft) <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____ | Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested | Depth (m/ft) From | To               |
| Water found at Depth (m/ft) <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____ | Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested |                   | Diameter (cm/in) |
| Water found at Depth (m/ft) <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____ | Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested |                   |                  |

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **AIR ROCK DRILLING CO LTD 1119** Well Contractor's Licence No.: \_\_\_\_\_


Business Address (Street Number/Name): **RR#1** Municipality: **RICHMOND**

Province: **ONT** Postal Code: **K0A2Z0** Business E-mail Address: \_\_\_\_\_

Bus. Telephone No. (inc. area code): **6138382170** Name of Well Technician (Last Name, First Name): **Desautels Ken**

Well Technician's Licence No.: **T4** Signature of Technician and/or Contractor: **Ken Desautels** Date Submitted: **20110131**

| Results of Well Yield Testing   |              |                    |            |                    |
|---|--------------|--------------------|------------|--------------------|
| After test of well yield, water was:<br><input type="checkbox"/> Clear and sand free<br><input type="checkbox"/> Other, specify _____   | Draw Down    |                    | Recovery   |                    |
|   | Time (min)   | Water Level (m/ft) | Time (min) | Water Level (m/ft) |
| If pumping discontinued, give reason:<br><br>Pump intake set at (m/ft)<br><br>Pumping rate (l/min / GPM)<br><br>Duration of pumping _____ hrs + _____ min<br><br>Final water level end of pumping (m/ft)<br><br>If flowing give rate (l/min / GRM)<br><br>Recommended pump depth (m/ft)<br><br>Recommended pump rate (l/min / GPM)<br><br>Well production (l/min / GPM)<br><br>Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | Static Level |                    |            |                    |
|   | 1            |                    | 1          |                    |
|   | 2            |                    | 2          |                    |
|   | 3            |                    | 3          |                    |
|   | 4            |                    | 4          |                    |
|   | 5            |                    | 5          |                    |
|   | 10           |                    | 10         |                    |
| 15  |              | 15                 |            |                    |
| 20  |              | 20                 |            |                    |
| 25  |              | 25                 |            |                    |
| 30  |              | 30                 |            |                    |
| 40  |              | 40                 |            |                    |
| 50  |              | 50                 |            |                    |
| 60  |              | 60                 |            |                    |

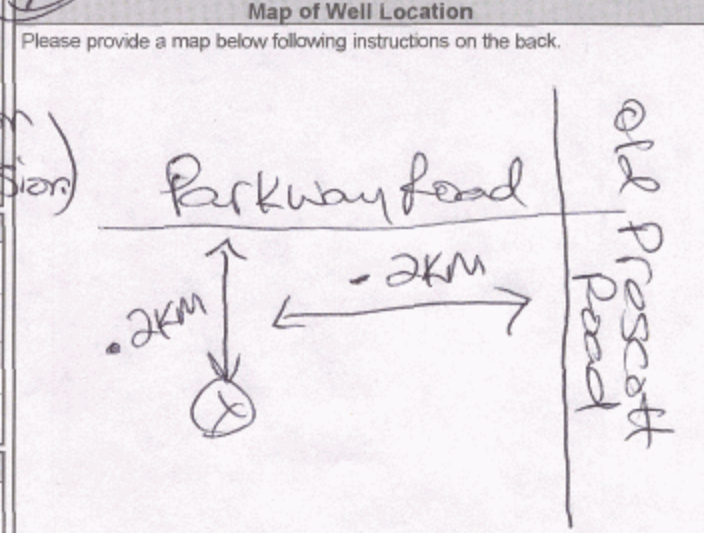

Comments: **TW#5 - A004862**

| Well owner's information package delivered                          | Date Package Delivered | Ministry Use Only           |
|---|------------------------|-----------------------------|
| <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | <b>20110118</b>        | Audit No. <b>z119939</b>    |
|   | Date Work Completed    | Received <b>FEB 10 2011</b> |



Address of Well Location (Street Number/Name) **1356 South Beach Blvd** Township **Osgoode** Lot **4** Concession **4**  
 County/District/Municipality **Ottawa-Carleton** City/Town/Village **Greely** Province **Ontario** Postal Code \_\_\_\_\_  
 UTM Coordinates Zone **18** Easting **454663** Northing **5012212** Municipal Plan and Sublot Number **4M-1265** Other **S/L 115**

**Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)**

| General Colour | Most Common Material | Other Materials | General Description | Depth (m/ft) |      |
|----------------|----------------------|-----------------|---------------------|--------------|------|
|                |                      |                 |                     | From         | To   |
|                | Sand & Gravel        | Boulders        |                     | 0'           | 42'  |
| Grey           | Limestone            |                 |                     | 42'          | 55'  |
| Grey           | Limestone            |                 |                     | 55'          | 94'  |
| Grey           | Limestone            |                 |                     | 94'          | 100' |

**Annular Space**

| Depth Set at (m/ft) | Type of Sealant Used (Material and Type) | Volume Placed (m <sup>3</sup> /ft <sup>3</sup> ) |
|---------------------|--|--|
| 50' to 40'          | Neat cement slurry                       | 9.36   |
| 40' to 0'           | Bentonite slurry                         | 29.4   |

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify \_\_\_\_\_  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

| Inside Diameter (cm/in) | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm/in) | Depth (m/ft) |      | Status of Well   |
|-------------------------|--|------------------------|--------------|------|--|
|                         |  |                        | From         | To   |  |
| 6"                      | Steel  | .188"                  | +2'          | 50'  | <input checked="" type="checkbox"/> Water Supply<br><input type="checkbox"/> Replacement Well<br><input type="checkbox"/> Test Hole<br><input type="checkbox"/> Recharge Well<br><input type="checkbox"/> Dewatering Well<br><input type="checkbox"/> Observation and/or Monitoring Hole<br><input type="checkbox"/> Alteration (Construction)<br><input type="checkbox"/> Abandoned, Insufficient Supply<br><input type="checkbox"/> Abandoned, Poor Water Quality<br><input type="checkbox"/> Abandoned, other, specify _____<br><input type="checkbox"/> Other, specify _____ |
| 57 3/4"                 | Open Hole  |                        | 50'          | 100' |  |

**Construction Record - Screen**

| Outside Diameter (cm/in) | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft) |    |
|--------------------------|---------------------------------------|----------|--------------|----|
|                          |                                       |          | From         | To |
|                          |                                       |          |              |    |

**Water Details**

| Water found at Depth (m/ft) | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested | Depth (m/ft) | Diameter (cm/in) |
|-----------------------------|--|--------------|------------------|
| 55 (m/ft)                   | <input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify _____      | 0' to 50'    | 6"               |
| 94 (m/ft)                   | <input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify _____      | 50' to 100'  | 57 3/4"          |
|                             | <input type="checkbox"/> Fresh <input type="checkbox"/> Untested                           |              |                  |

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **Air Rock Drilling Co. Ltd.** Well Contractor's Licence No.: **1119**  
 Business Address (Street Number/Name): **6659 Franktown Road, RR#1** Municipality: **Richmond**  
 Province: **ON** Postal Code: **K0A 2Z0** Business E-mail Address: **air-rock@sympatico.ca**  
 Bus. Telephone No. (inc. area code): **6138882170** Name of Well Technician (Last Name, First Name): **Hogan, Dan**  
 Well Technician's Licence No.: **T3058** Signature of Technician and/or Contractor: *[Signature]* Date Submitted: **2011 07 29**

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify **Not tested**

If pumping discontinued, give reason:  \_\_\_\_\_

Pump intake set at (m/ft) **80'**

Pumping rate (l/min / GPM) **20**

Duration of pumping **1 hrs + 0 min**

Final water level end of pumping (m/ft) **12.9'**

If flowing give rate (l/min / GPM) **20**


Recommended pump depth (m/ft) **80'**

Recommended pump rate (l/min / GPM) **20**

Well production (l/min / GPM) **20**

Disinfected?  Yes  No

| Time (min)   | Draw Down (m/ft) |      | Recovery (m/ft) |      |
|--------------|------------------|------|-----------------|------|
|              | Water Level      | Time | Water Level     | Time |
| Static Level | 8.6'             |      | 12.9'           |      |
| 1            | 10.5             | 1    | 10.8            |      |
| 2            | 10.8             | 2    | 8.6             |      |
| 3            | 11               | 3    | 8.6             |      |
| 4            | 11.2             | 4    | 8.6             |      |
| 5            | 11.3             | 5    | 8.6             |      |
| 10           | 11.7             | 10   | 8.6             |      |
| 15           | 11.9             | 15   | 8.6             |      |
| 20           | 12.1             | 20   | 8.6             |      |
| 25           | 12.2             | 25   | 8.6             |      |
| 30           | 12.3             | 30   | 8.6             |      |
| 40           | 12.5             | 40   | 8.6             |      |
| 50           | 12.8             | 50   | 8.6             |      |
| 60           | 12.9             | 60   | 8.6             |      |

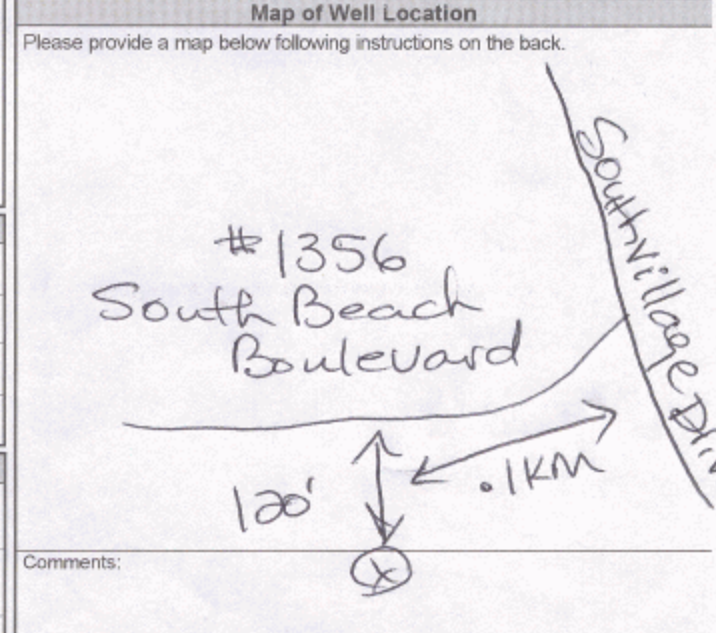

**Ministry Use Only**

Well owner's information package delivered:  Yes  No

Date Package Delivered: **2011 06 24**

Date Work Completed: **2011 06 23**

Audit No.: **z119752**

Received: **AUG 22 2011**





Measurements recorded in:  Metric  Imperial

Well Owner's Information

First Name, Last Name / Organization (SiteCast Construction Corp.), E-mail Address, Mailing Address (16 Concourse Gate #200), Municipality (Ottawa), Province (ON), Postal Code (K2E 7S8), Telephone No.

Well Location

Address of Well Location (6815 McKeown Road), Township (Osgoode), Lot (P/L 5), Concession (4), County/District/Municipality (Ottawa-Carleton), City/Town/Village (Greely), Province (Ontario), UTM Coordinates, Municipal Plan and Sublot Number (4M-351), Other (P/L 6)

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Includes entries for Sand & Gravel, Clay, Limestone, Sandstone.

Annular Space table with columns: Depth Set at (m/ft) From, To; Type of Sealant Used; Volume Placed (m³/ft³). Includes entries for Neat cement and Bentonite slurry.

Method of Construction and Well Use checkboxes. Includes options like Cable Tool, Rotary, Boring, Air percussion, Public, Commercial, Domestic, etc.

Construction Record - Casing table with columns: Inside Diameter, Open Hole OR Material, Wall Thickness, Depth (m/ft) From, To. Includes entries for Steel and Open Hole.

Construction Record - Screen table with columns: Outside Diameter, Material, Slot No., Depth (m/ft) From, To.

Water Details and Hole Diameter tables. Includes columns for Water found at Depth, Kind of Water, Depth (m/ft) From, To, Diameter (cm/in).

Well Contractor and Well Technician Information. Includes Business Name (Air Rock Drilling Co. Ltd.), Business Address (8659 Franktown Road), Province (ON), Postal Code (K0A 2Z0), Business E-mail Address (air-rock@sympatico.ca), Name of Well Technician (Purcell, Shannon), Date Submitted (2012 05 31).

Results of Well Yield Testing table. Includes columns: After test of well yield, water was; Draw Down (Time, Water Level); Recovery (Time, Water Level). Includes handwritten notes like 'Not tested', '140'', '12', '54.3', '180', '12', '54.3', '12', '54.3'.

Map of Well Location. Includes handwritten text: 'HIRAM DRIVE', '230'', '175'', '# 6815 MCKEOWN ROAD'. Comments: '1/2 HP - 10 GPM set @ 140 ft'.

Ministry Use Only section. Includes Well owner's information package delivered (Yes/No), Date Package Delivered (2012 05 08), Date Work Completed (2012 05 03), Audit No. (z 128551), Received (JUN 29 2012).



Measurements recorded in: Metric Imperial

Address of Well Location (Street Number/Name) 6946 South Village Drive Township Osgoode Lot 4 Concession 4
County/District/Municipality Ottawa-Carleton City/Town/Village Greely Province Ontario Postal Code
UTM Coordinates Zone Easting Northing NAD 83 18 454832 5012327 Municipal Plan and Sublot Number 4M-1265 Other S/L 12

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)
Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To

Annular Space
Table with columns: Depth Set at (m/ft) From, To, Type of Sealant Used (Material and Type), Volume Placed (m³/ft³)

Method of Construction and Well Use
Method of Construction: Cable Tool, Rotary (Conventional), Rotary (Reverse), Boring, Air percussion, Other.
Well Use: Public, Commercial, Domestic, Municipal, Livestock, Test Hole, Irrigation, Cooling & Air Conditioning, Industrial, Other.


Construction Record - Casing and Status of Well
Table with columns: Inside Diameter (cm/in), Open Hole OR Material, Wall Thickness (cm/in), Depth (m/ft) From, To, Status of Well (Water Supply, Replacement Well, etc.)

Construction Record - Screen
Table with columns: Outside Diameter (cm/in), Material (Plastic, Galvanized, Steel), Slot No., Depth (m/ft) From, To

Water Details and Hole Diameter
Water Details: Water found at Depth, Kind of Water (Fresh, Untested, Gas, Other).
Hole Diameter: Depth (m/ft) From, To, Diameter (cm/in).

Well Contractor and Well Technician Information
Business Name of Well Contractor: Air Rock Drilling Co. Ltd.
Well Contractor's Licence No.: 1119
Business Address: 6659 Franktown Road, RR#1
Municipality: Richmond
Province: ON, Postal Code: K0A 2Z0, Business E-mail Address: air-rock@sympatico.ca
Bus. Telephone No.: 6138382170, Name of Well Technician: Purcell, Shannon
Well Technician's Licence No.: T2122, Signature of Technician and/or Contractor: [Signature], Date Submitted: 2012 06 29

Results of Well Yield Testing
Table with columns: Draw Down (Time, Water Level), Recovery (Time, Water Level).
Includes notes: After test of well yield, water was: Not tested. Pump intake set at 160'. Pumping rate 20. Duration of pumping 1 hrs + 0 min. Final water level end of pumping 74.9". If flowing give rate 74.9". Recommended pump depth 100' (3/4 HP - 15 GPM). Recommended pump rate 20. Well production 20. Disinfected? Yes.

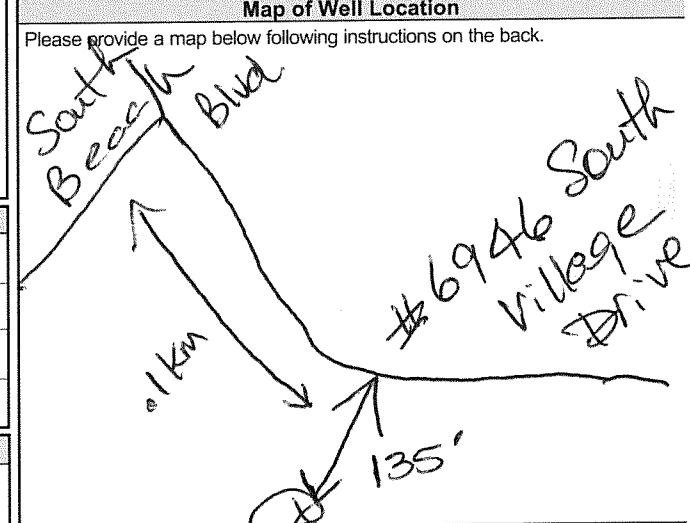

Comments: 3/4 HP - 15 GPM SET @ 100.
Ministry Use Only: Audit No. Z 144600, Date Work Completed: 2012 06 06, Date Package Delivered: 2012 06 07, Date Submitted: 2012 06 29.

Measurements recorded in:  Metric  Imperial

Page \_\_\_\_\_ of \_\_\_\_\_

**Well Owner's Information**

|   |  |                            |   |
|---|--|----------------------------|---|
| First Name  | Last Name / Organization<br><b>M. Scapillati Flooring Inc.</b> | E-mail Address             | <input type="checkbox"/> Well Constructed by Well Owner |
| Mailing Address (Street Number/Name)<br><b>P.O. Box 13090</b> | Municipality<br><b>Kanata</b>                                  | Province<br><b>Ontario</b> | Postal Code<br><b>K2K 1X3</b>                           |
| Telephone No. (inc. area code)<br><b>613 839 3462</b>         |  |                            |   |

**Well Location**

|  |                                    |                            |                        |
|--|------------------------------------|----------------------------|------------------------|
| Address of Well Location (Street Number/Name)<br><b>6786 Hiram Drive</b> | Township<br><b>Osgoode</b>         | Lot<br><b>5</b>            | Concession<br><b>4</b> |
| County/District/Municipality<br><b>Ottawa Carleton</b>                   | City/Town/Village<br><b>Greely</b> | Province<br><b>Ontario</b> | Postal Code            |
| UTM Coordinates  | Zone                               | Easting                    | Northing               |
| <b>NAD 83</b>  | <b>18</b>                          | <b>454621</b>              | <b>5011602</b>         |
| Municipal Plan and Sublot Number   |                                    | Other                      |                        |

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

| General Colour | Most Common Material | Other Materials | General Description | Depth (m/ft) |       |
|----------------|----------------------|-----------------|---------------------|--------------|-------|
|                |                      |                 |                     | From         | To    |
| Brown          | Clay                 |                 | Packed              | 0            | 2.43  |
| Grey           | Clay                 |                 | Sticky              | 2.43         | 4.87  |
| Grey           | Sand                 | Boulders        | Loose               | 4.87         | 17.67 |
| Grey           | Limestone            |                 |                     | 17.67        | 29.86 |

| Annular Space       |                            |               |  |
|---------------------|----------------------------|---------------|--|
| Depth Set at (m/ft) | Type of Sealant Used       | Volume Placed |  |
| From                | (Material and Type)        | (m³/ft³)      |  |
| 19.50               | 0 Grouted Bentonite Slurry | .92m³         |  |

| Results of Well Yield Testing                                       |   |              |                    |            |                    |
|---|---|--------------|--------------------|------------|--------------------|
| After test of well yield, water was:                                |   | Draw Down    |                    | Recovery   |                    |
| <input checked="" type="checkbox"/> Clear and sand free             | <input type="checkbox"/> Other, specify _____ | Time (min)   | Water Level (m/ft) | Time (min) | Water Level (m/ft) |
| If pumping discontinued, give reason:                               |   | Static Level | 1.73               |            |                    |
| Pump intake set at (m/ft)   |   | 1            | 2.74               | 1          | 4.81               |
| 22.85   |   | 2            | 2.70               | 2          | 3.11               |
| Pumping rate (l/min / GPM)  |   | 3            | 4.25               | 3          | 2.23               |
| 45.5  |   | 4            | 4.62               | 4          | 1.90               |
| Duration of pumping   |   | 5            | 4.88               | 5          | 1.83               |
| 7 hrs + 28 min  |   | 10           | 5.49               | 10         | 1.81               |
| Final water level end of pumping (m/ft)                             |   | 15           | 5.68               | 15         |                    |
| 6.31  |   | 20           | 5.78               | 20         |                    |
| If flowing give rate (l/min / GPM)                                  |   | 25           | 5.82               | 25         |                    |
| Recommended pump depth (m/ft)                                       |   | 30           | 5.85               | 30         |                    |
| 22.85   |   | 40           | 5.88               | 40         |                    |
| Recommended pump rate (l/min / GPM)                                 |   | 50           | 5.92               | 50         |                    |
| 45.5  |   | 60           | 5.95               | 60         |                    |
| Well production (l/min / GPM)                                       |   |              |                    |            |                    |
| Disinfected?  |   |              |                    |            |                    |
| <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No |   |              |                    |            |                    |

| Method of Construction                                    |                                  | Well Use                                      |   |                                     |
|---|----------------------------------|---|---|-------------------------------------|
| <input type="checkbox"/> Cable Tool                       | <input type="checkbox"/> Diamond | <input type="checkbox"/> Public               | <input type="checkbox"/> Commercial                 | <input type="checkbox"/> Not used   |
| <input checked="" type="checkbox"/> Rotary (Conventional) | <input type="checkbox"/> Jetting | <input checked="" type="checkbox"/> Domestic  | <input type="checkbox"/> Municipal                  | <input type="checkbox"/> Dewatering |
| <input type="checkbox"/> Rotary (Reverse)                 | <input type="checkbox"/> Driving | <input type="checkbox"/> Livestock            | <input type="checkbox"/> Test Hole                  | <input type="checkbox"/> Monitoring |
| <input type="checkbox"/> Boring                           | <input type="checkbox"/> Digging | <input type="checkbox"/> Irrigation           | <input type="checkbox"/> Cooling & Air Conditioning |                                     |
| <input checked="" type="checkbox"/> Air percussion        |                                  | <input type="checkbox"/> Industrial           |   |                                     |
| <input type="checkbox"/> Other, specify _____             |                                  | <input type="checkbox"/> Other, specify _____ |   |                                     |

| Construction Record - Casing |  |                        |              | Status of Well |  |
|------------------------------|--|------------------------|--------------|----------------|--|
| Inside Diameter (cm/in)      | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm/in) | Depth (m/ft) |                | <input checked="" type="checkbox"/> Water Supply<br><input type="checkbox"/> Replacement Well<br><input type="checkbox"/> Test Hole<br><input type="checkbox"/> Recharge Well<br><input type="checkbox"/> Dewatering Well<br><input type="checkbox"/> Observation and/or Monitoring Hole<br><input type="checkbox"/> Alteration (Construction)<br><input type="checkbox"/> Abandoned, Insufficient Supply<br><input type="checkbox"/> Abandoned, Poor Water Quality<br><input type="checkbox"/> Abandoned, other, specify _____<br><input type="checkbox"/> Other, specify _____ |
|                              |  |                        | From         | To             |  |
| 15.86                        | Steel  | .48                    | + .45        | 19.50          |  |

| Construction Record - Screen |                                       |          |              |    |   |
|------------------------------|---------------------------------------|----------|--------------|----|---|
| Outside Diameter (cm/in)     | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft) |    | <input type="checkbox"/> Other, specify _____ |
|                              |                                       |          | From         | To |   |
|                              |                                       |          |              |    |   |

| Water Details               |  | Hole Diameter |       |                  |
|-----------------------------|--|---------------|-------|------------------|
| Water found at Depth (m/ft) | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested | Depth (m/ft)  |       | Diameter (cm/in) |
|                             | <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____                 | From          | To    |                  |
| 21.33                       |  | 0             | 19.50 | 15.86            |
| 28.95                       |  | 19.50         | 29.86 | 15.23            |
|                             |  |               |       |                  |

| Well Contractor and Well Technician Information                      |   |  |  |
|--|---|--|--|
| Business Name of Well Contractor<br><b>Capital Water Supply Ltd.</b> |   | Well Contractor's Licence No.<br><b>1 5 5 8</b>          |  |
| Business Address (Street Number/Name)<br><b>Box 490</b>              |   | Municipality<br><b>Stittsville</b>                       |  |
| Province<br><b>Ontario</b>   | Postal Code<br><b>K2S 1A6</b>   | Business E-mail Address<br><b>office@capitalwater.ca</b> |  |
| Bus. Telephone No. (inc. area code)<br><b>613 836 1766</b>           | Name of Well Technician (Last Name, First Name)<br><b>Miller, Stephen</b> |  |  |
| Well Technician's Licence No.<br><b>0 0 9 7</b>                      | Signature of Technician and/or Contractor                                 | Date Submitted<br><b>20120131</b>                        |  |

| Map of Well Location   |  |
|--|--|
| Please provide a map below following instructions on the back. |  |
|  |  |
| Comments: _____  |  |

| Well owner's information package delivered |                             | Date Package Delivered                        |  | Ministry Use Only              |  |
|--|-----------------------------|---|--|--------------------------------|--|
| <input checked="" type="checkbox"/> Yes    | <input type="checkbox"/> No | <b>2 0 1 2 0 1 2 7</b>                        |  | Audit No.<br><b>Z139740</b>    |  |
|  |                             | Date Work Completed<br><b>2 0 1 2 0 1 2 4</b> |  | Received<br><b>SEP 20 2012</b> |  |



Measurements recorded in:  Metric  Imperial

Well Owner's Information

First Name, Last Name / Organization (Slavko Concrete Finishing), E-mail Address, Mailing Address (6789 Sunset Blvd), Municipality (Greely), Province (ON), Postal Code (K4P 1M6), Telephone No.

Well Location

Address of Well Location (6828 McKeown Drive), Township (Osgoode), Lot (P/L 4), Concession (4), County/District/Municipality (Ottawa-Carleton), City/Town/Village (Greely), Province (Ontario), UTM Coordinates, Municipal Plan and Sublot Number (4M-351 - S/L 19), Other (Block 6)

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Rows include Sand & Gravel, Boulders, Limestone at various depths.

\*\*GRAVEL SEAM - KEEP PUMP ABOVE 100 FEET\*\*

Annular Space table with columns: Depth Set at (m/ft) From, To; Type of Sealant Used; Volume Placed (m³/ft³). Rows for Neat cement and Bentonite slurry.

Method of Construction and Well Use checkboxes. Includes Cable Tool, Rotary, Boring, Air percussion, and various well uses like Domestic, Commercial, etc.


Construction Record - Casing and Status of Well. Includes Inside Diameter, Open Hole OR Material, Wall Thickness, Depth, and checkboxes for Water Supply, Replacement Well, etc.

Construction Record - Screen. Includes Outside Diameter, Material, Slot No., and Depth.

Water Details and Hole Diameter. Includes Water found at Depth, Kind of Water, and Hole Diameter (Depth and Diameter).

Well Contractor and Well Technician Information. Includes Business Name (Air Rock Drilling Co. Ltd.), Licence No., Business Address (6659 Franktown Road), and Technician Name (Graham, Ryan).

Results of Well Yield Testing table. Includes Draw Down and Recovery columns with Time, Water Level, and Static Level data.

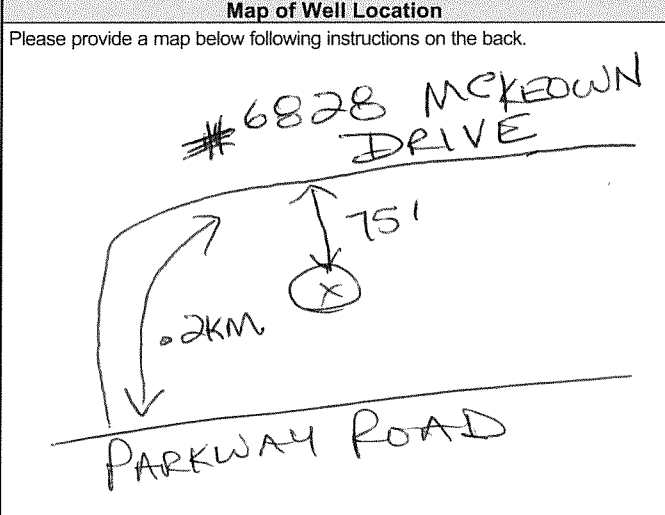

Comments: 3/4 HP - 15 GPM - SET AT 100 FEET

Well owner's information package delivered, Date Package Delivered (2013 01 28), Date Work Completed (2013 01 17), Ministry Use Only (Audit No. Z144877, Received FEB 19 2013).



Measurements recorded in:  Metric  Imperial

A135268

Page \_\_\_ of \_\_\_

**Well Owner's Information**

First Name: \_\_\_\_\_ Last Name / Organization: **1850563 Ontario Ltd** E-mail Address: \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name): **146 Tartan Drive** Municipality: **Ottawa** Province: **ON** Postal Code: **K2J 3X2** Telephone No. (inc. area code): \_\_\_\_\_

**Well Location**

Address of Well Location (Street Number/Name): **1358 Coker Street** Township: **Osgoode** Lot: **P/L5** Concession: **4**

County/District/Municipality: **Ottawa-Carleton** City/Town/Village: **Greely** Province: **Ontario** Postal Code: \_\_\_\_\_

UTM Coordinates Zone: **18** Easting: **454059** Northing: **5011925** Municipal Plan and Sublot Number: **4M 351** Other: **RP4R-5427 Part 26, 27, 28**

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

| General Colour | Most Common Material | Other Materials | General Description | Depth (m) |
|----------------|----------------------|-----------------|---------------------|-----------|
|                |                      |                 |                     | From To   |
|                | Sand & Gravel        | Boulders        |                     | 0' 45'    |
| Grey           | Limestone            |                 |                     | 45' 138'  |
| Grey & White   | Sandstone            | Mix             |                     | 138' 154' |
| Grey & White   | Sandstone            | Mix             |                     | 154' 182' |
| Grey & White   | Sandstone            | Mix             |                     | 182' 200' |

**Annular Space**

| Depth Set at (m/ft) | Type of Sealant Used | Volume Placed                      |
|---------------------|----------------------|------------------------------------|
| From To             | (Material and Type)  | (m <sup>3</sup> /ft <sup>3</sup> ) |
| 52' 42'             | Neat cement          | 10.9                               |
| 42' 0'              | Bentonite slurry     | 21                                 |

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify **Not tested**

If pumping discontinued, give reason: \_\_\_\_\_

Pump intake set at (m/ft): **180'**

Pumping rate (l/min / GPM): **20**

Duration of pumping: **1** hrs + **0** min

Final water level end of pumping (m/ft): **34' 1"**

If flowing give rate (l/min / GPM): \_\_\_\_\_

Recommended pump depth (m/ft): **100'**

Recommended pump rate (l/min / GPM): **20**

Well production (l/min / GPM): **20**

Disinfected?  Yes  No

| Time (min)   | Draw Down          |            | Recovery           |            |
|--------------|--------------------|------------|--------------------|------------|
|              | Water Level (m/ft) | Time (min) | Water Level (m/ft) | Time (min) |
| Static Level | 15' 9"             |            | 34' 9"             |            |
| 1            | 25.6               | 1          | 25.5               |            |
| 2            | 29.1               | 2          | 21.2               |            |
| 3            | 32.5               | 3          | 18.4               |            |
| 4            | 34.9               | 4          | 15.9               |            |
| 5            | 34.9               | 5          |                    |            |
| 10           |                    | 10         |                    |            |
| 15           |                    | 15         |                    |            |
| 20           |                    | 20         |                    |            |
| 25           |                    | 25         |                    |            |
| 30           |                    | 30         |                    |            |
| 40           |                    | 40         |                    |            |
| 50           |                    | 50         |                    |            |
| 60           |                    | 60         |                    |            |

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Domestic  Test Hole  Monitoring  
 Boring  Digging  Livestock  Cooling & Air Conditioning  
 Air percussion  Irrigation  Industrial  Other, specify \_\_\_\_\_  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

| Inside Diameter (cm/in) | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm/in) | Depth (m/ft) |      | Status of Well   |
|-------------------------|--|------------------------|--------------|------|--|
|                         |  |                        | From         | To   |  |
| 6 1/4"                  | Steel  | 188"                   | +2'          | 52'  | <input checked="" type="checkbox"/> Water Supply<br><input type="checkbox"/> Replacement Well<br><input type="checkbox"/> Test Hole<br><input type="checkbox"/> Recharge Well<br><input type="checkbox"/> Dewatering Well<br><input type="checkbox"/> Observation and/or Monitoring Hole<br><input type="checkbox"/> Alteration (Construction)<br><input type="checkbox"/> Abandoned, Insufficient Supply<br><input type="checkbox"/> Abandoned, Poor Water Quality<br><input type="checkbox"/> Abandoned, other, specify _____<br><input type="checkbox"/> Other, specify _____ |
| 5 7/8"                  | Open Hole  |                        | 52'          | 200' |  |

**Construction Record - Screen**

| Outside Diameter (cm/in) | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft) |    |
|--------------------------|---------------------------------------|----------|--------------|----|
|                          |                                       |          | From         | To |
|                          |                                       |          |              |    |

**Water Details**

| Water found at Depth (m/ft) | Kind of Water:  | Untested                            |
|-----------------------------|---|-------------------------------------|
| 154 (m/ft)                  | <input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify _____ | <input checked="" type="checkbox"/> |
| 182 (m/ft)                  | <input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify _____ | <input checked="" type="checkbox"/> |
| (m/ft)                      | <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____            | <input type="checkbox"/>            |

**Hole Diameter**

| Depth (m/ft) | Diameter (cm/in) |
|--------------|------------------|
| 0' 52'       | 9 3/4"           |
| 52' 200'     | 5 7/8"           |

**Well Contractor and Well Technician Information**


Business Name of Well Contractor: **Air Rock Drilling Co. Ltd** Well Contractor's Licence No.: **1119**

Business Address (Street Number/Name): **6659 Franktown Road, RR#1** Municipality: **Richmond**

Province: **ON** Postal Code: **K0A 2Z0** Business E-mail Address: **air-rock@sympatico.ca**

Bus. Telephone No. (inc. area code): **613-832-170** Name of Well Technician (Last Name, First Name): **Graham, Ryan**

Well Technician's Licence No.: **T3484** Signature of Technician and/or Contractor: \_\_\_\_\_ Date Submitted: **2013 03 28**

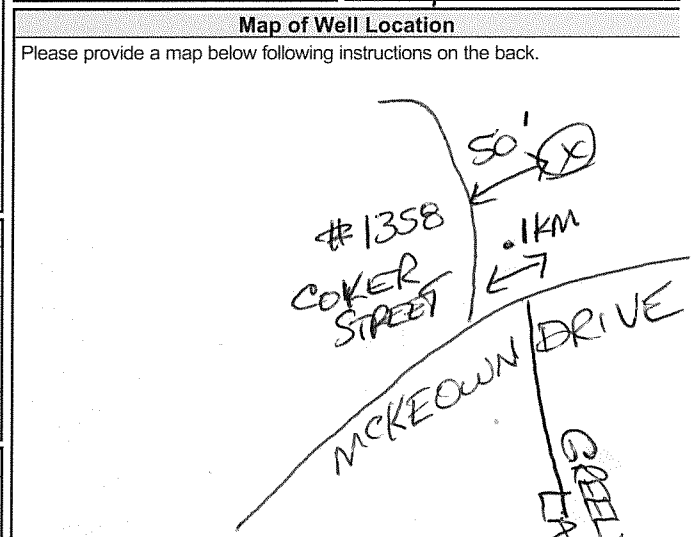

Comments: **3/4HP - 15GPM @ 100 FT**

| Well owner's information package delivered | Date Package Delivered | Ministry Use Only         |
|--|------------------------|---------------------------|
| <input checked="" type="checkbox"/> Yes    | <b>2013 03 12</b>      | Audit No. <b>Z 155046</b> |
| <input type="checkbox"/> No                | <b>2013 03 11</b>      | Rec'd On <b>15 2013</b>   |



Measurements recorded in:  Metric  Imperial

Well Owner's Information

First Name, Last Name / Organization (1384341 Ontario Limited (c/o Cavanagh Const)), E-mail Address, Mailing Address (9094 Cavanagh Road), Municipality (Ashton), Province (On), Postal Code (K0A 1B0), Telephone No.

Well Location

Address of Well Location (1240 Old Prescott Road), Township (Osgoode), Lot (P/L 4), Concession (4S), County/District/Municipality (Ottawa-Carleton), City/Town/Village (Greely), Province (Ontario), UTM Coordinates, Northing (5012245), TEST WELL # 1

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (From/To). Rows include Sand, Sand y, Sand - Course + Gravel & Boulders, Limestone, Sandstone, Limestone, Sandstone, Limestone, Sandstone, Limestone, Sandstone, Limestone.

Annular Space table with columns: Depth Set at (From/To), Type of Sealant Used, Volume Placed. Rows for Neat cement and Bentonite slurry.

Method of Construction and Well Use checkboxes. Includes Cable Tool, Rotary, Boring, Air percussion, and various well uses like Domestic, Commercial, Municipal, etc.


Construction Record - Casing and Status of Well. Includes Inside Diameter, Open Hole OR Material, Wall Thickness, Depth, and checkboxes for Water Supply, Replacement Well, etc.

Construction Record - Screen. Includes Outside Diameter, Material, Slot No., and Depth.

Water Details and Hole Diameter. Includes Water found at Depth, Kind of Water, and Hole Diameter (Depth/Diameter).

Well Contractor and Well Technician Information. Includes Business Name (Air Rock Drilling Co. Ltd.), Licence No., Business Address (6659 Franktown Road), Municipality (Richmond), Province (ON), Postal Code (K0A 2Z0), Business E-mail Address (air-rock@sympatico.ca), Name of Well Technician (Graham, Ryan), and Licence No. (T3484).

Results of Well Yield Testing table. Includes Draw Down and Recovery columns with Time, Water Level, and Static Level data.

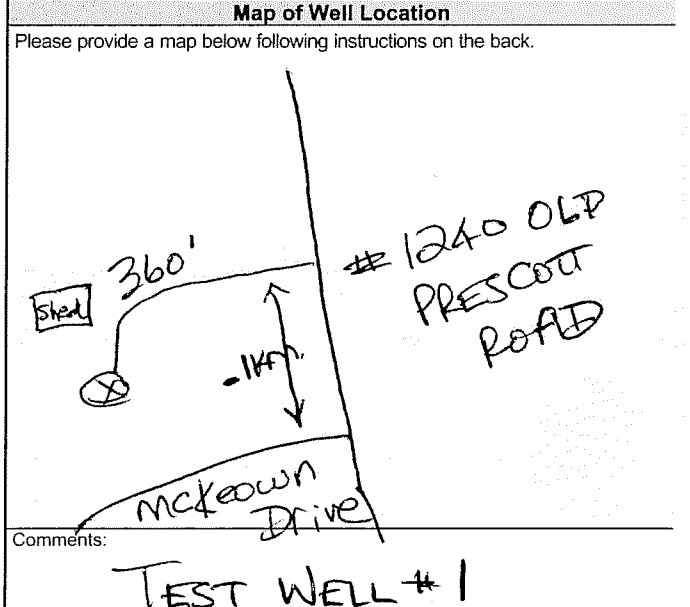

Well owner's information package delivered, Date Package Delivered (2013 05 29), Date Work Completed (2013 05 27), Ministry Use Only (Audit No. Z 155095, Received JUL 16 2013).



Measurements recorded in:  Metric  Imperial

Well Owner's Information

First Name, Last Name / Organization (1384341 Ontario Limited (c/o Cavanagh Const)), E-mail Address, Mailing Address (9094 Cavanagh Road), Municipality (Ashton), Province (On), Postal Code (K0A 1B0), Telephone No.

Well Location

Address of Well Location (1240 Old Prescott Road), Township (Osgoode), Lot (P/L 4), Concession (4S), County/District/Municipality (Ottawa-Carleton), City/Town/Village (Greely), Province (Ontario), UTM Coordinates, Northing (5012227), Municipal Plan and Sublot Number (TEST WELL # 2)

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Includes entries for Sand, Silty Sand & Gravel, Boulders, Limestone, and Sandstone Mix.

Annular Space table with columns: Depth Set at (m/ft) From, To; Type of Sealant Used; Volume Placed (m³). Includes entries for Neat cement and Bentonite slurry.

Method of Construction and Well Use checkboxes. Includes options like Cable Tool, Rotary, Boring, Air percussion, and Well Use categories like Domestic, Commercial, Industrial.


Construction Record - Casing and Status of Well. Includes columns for Inside Diameter, Open Hole OR Material, Wall Thickness, Depth, and checkboxes for Water Supply, Replacement Well, etc.

Construction Record - Screen. Includes columns for Outside Diameter, Material, Slot No., and Depth.

Water Details and Hole Diameter. Includes columns for Water found at Depth, Kind of Water, and Hole Diameter (Depth and Diameter).

Well Contractor and Well Technician Information. Includes Business Name (Air Rock Drilling Co. Ltd.), Licence No., Business Address (6658 Franktown Road), Province (ON), Postal Code (K0A 2Z0), Business E-mail Address (air-rock@sympatico.ca), Name of Well Technician (Graham, Ryan), and Signature.

Results of Well Yield Testing. Includes Draw Down and Recovery data with columns: Time (min), Water Level (m/ft), and Static Level. Includes notes like 'Not tested' and 'Pump intake set at 190'.

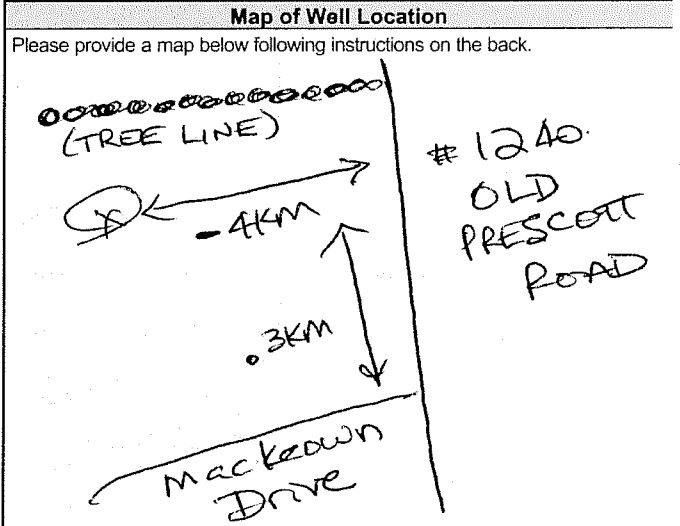

Comments: 3/4 HP - 10 GPM SET AT 190 FT TESTWELL#2

Ministry Use Only section. Includes Well owner's information package delivered (Yes/No), Date Package Delivered (2013 06 04), Date Work Completed (2013 05 30), Audit No. (2155104), and Date (JUL 16 2013).



Follow the **[COVID-19 restrictions and public health measures \(https://covid-19.ontario.ca/public-health-measures\)](https://covid-19.ontario.ca/public-health-measures)** and **[book your appointment to get vaccinated \(https://covid-19.ontario.ca/book-vaccine/\)](https://covid-19.ontario.ca/book-vaccine/)**.



[\(/page/government-ontario\)](/page/government-ontario)

Français (/fr/page/registre-de-puits)  
FR (/FR/PAGE/REGISTRE-DE-PUITS)

Menu

# Map: Well records

This map allows you to search and view well record information from reported wells in Ontario.

Full dataset is available in the [Open Data catalogue \(https://data.ontario.ca/dataset/well-records\)](https://data.ontario.ca/dataset/well-records).

---

[Go Back to Map \(\)](#)

## Well ID

Well ID Number: 7206661

Well Audit Number: Z155129

Well Tag Number: A128106

*This table contains information from the original well record and any subsequent updates.*

## Well Location

**Address of Well Location**

6808 HIRAM DRIVE

|   |   |
|---|---|
| <b>Township</b>                         | OSGOODE TOWNSHIP  |
| <b>Lot</b>                              | 005   |
| <b>Concession</b>                       | CON 04  |
| <b>County/District/Municipality</b>     | OTTAWA-CARLETON   |
| <b>City/Town/Village</b>                | GREELV  |
| <b>Province</b>                         | ON  |
| <b>Postal Code</b>                      | n/a   |
| <b>UTM Coordinates</b>                  | NAD83 — Zone 18<br>Easting: 454576.00<br>Northing: 5011680.00 |
| <b>Municipal Plan and Sublot Number</b> |   |

#### Other

## Overburden and Bedrock Materials Interval

| General Colour | Most Common Material | Other Materials | General Description | Depth From | Depth To |
|----------------|----------------------|-----------------|---------------------|------------|----------|
| BRWN           | CLAY                 |                 |                     | 0 ft       | 5 ft     |
| GREY           | CLAY                 |                 |                     | 5 ft       | 18 ft    |
|                | SAND                 | GRVL            | BLDR                | 18 ft      | 52 ft    |
| GREY           | LMSN                 |                 |                     | 52 ft      | 135 ft   |
| GREY           | LMSN                 | SNDS            |                     | 135 ft     | 153 ft   |
| GREY           | LMSN                 | SNDS            |                     | 153 ft     | 160 ft   |

## Annular Space/Abandonment Sealing Record

| Depth From | Depth To | Type of Sealant Used (Material and Type) | Volume Placed |
|------------|----------|--|---------------|
| 50 ft      | 0 ft     | BENTONITE SLURRY                         |               |
| 60 ft      | 50 ft    | CONCRETE                                 |               |

## Method of Construction & Well Use

### Method of Construction    Well Use

Air Percussion

Domestic

## Status of Well

Water Supply

## Construction Record - Casing

| Inside Diameter | Open Hole or material | Depth From | Depth To |
|-----------------|-----------------------|------------|----------|
| 6.25 inch       | STEEL                 | -2 ft      | 60 ft    |
| 6 inch          | OPEN HOLE             | 60 ft      | 160 ft   |

## Construction Record - Screen

| Outside Diameter | Material | Depth From | Depth To |
|------------------|----------|------------|----------|
|                  |          |            |          |



# Well Contractor and Well Technician Information

Well Contractor's Licence Number: 1119

## Results of Well Yield Testing

After test of well yield, water was

If pumping discontinued, give reason

Pump intake set at 150 ft

Pumping Rate 20 GPM

Duration of Pumping 1 h:0 m

Final water level 36.6 ft

If flowing give rate

Recommended pump depth 100 ft

Recommended pump rate 20 GPM

Well Production

Disinfected? Y

## Draw Down & Recovery

| Draw Down Time(min) | Draw Down Water level | Recovery Time(min) | Recovery Water level |
|---------------------|-----------------------|--------------------|----------------------|
| SWL                 | 18.3 ft               |                    |                      |
| 1                   | 22.5 ft               | 1                  | 27.6 ft              |
| 2                   | 24.5 ft               | 2                  | 26.6 ft              |
| 3                   | 25.7 ft               | 3                  | 26 ft                |

|    |         |    |         |
|----|---------|----|---------|
| 4  | 26.6 ft | 4  | 25.4 ft |
| 5  | 27.4 ft | 5  | 24.8 ft |
| 10 | 29.5 ft | 10 | 21.8 ft |
| 15 | 31.1 ft | 15 | 19 ft   |
| 20 | 32.7 ft | 20 | 18.3 ft |
| 25 | 33 ft   | 25 | 18.3 ft |
| 30 | 33.3 ft | 30 | 18.3 ft |
| 40 | 34.5 ft | 40 | 18.3 ft |
| 45 |         | 45 |         |
| 50 | 35.7 ft | 50 | 18.3 ft |
| 60 | 36.6 ft | 60 | 18.3 ft |

## Water Details

### Water Found at Depth    Kind

|        |          |
|--------|----------|
| 153 ft | Untested |
|--------|----------|

## Hole Diameter

### Depth    Depth    Diameter From    To

|      |       |           |
|------|-------|-----------|
| 0 ft | 60 ft | 9.75 inch |
|------|-------|-----------|

|       |        |        |
|-------|--------|--------|
| 60 ft | 160 ft | 6 inch |
|-------|--------|--------|

---

**Audit Number:** Z155129

**Date Well Completed:** June 24, 2013

**Date Well Record Received by MOE:** August 19, 2013

## Related

[How to use a Ministry of the Environment map \(/page/how-use-ministry-environment-map#wells\)](/page/how-use-ministry-environment-map#wells)

Technical documentation: Metadata record (<https://data.ontario.ca/dataset/well-records/resource/3031344e-e3f2-48d5-888c-c1deadfd2f77>)

Updated: October 18, 2021

Published: March 20, 2014

---

[about Ontario \(https://www.ontario.ca/page/about-ontario\)](https://www.ontario.ca/page/about-ontario)

[accessibility \(https://www.ontario.ca/page/accessibility\)](https://www.ontario.ca/page/accessibility)

[news \(http://news.ontario.ca/newsroom/en\)](http://news.ontario.ca/newsroom/en)

[privacy \(https://www.ontario.ca/page/privacy-statement\)](https://www.ontario.ca/page/privacy-statement)

[terms of use \(https://www.ontario.ca/page/terms-use\)](https://www.ontario.ca/page/terms-use)

[© Queen's Printer for Ontario, 2012-22 \(https://www.ontario.ca/page/copyright-information-c-queens-printer-ontario\)](https://www.ontario.ca/page/copyright-information-c-queens-printer-ontario)





Measurements recorded in:  Metric  Imperial

Page of

Well Owner's Information

First Name, Last Name / Organization, E-mail Address, Mailing Address (Street Number/Name), Municipality, Province, Postal Code, Telephone No. (inc. area code)

Well Location

Address of Well Location (Street Number/Name), Township, Lot, Concession, County/District/Municipality, City/Town/Village, Province, Postal Code, UTM Coordinates, Zone, Easting, Northing, Municipal Plan and Sublot Number, Other

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To

TEST WELL # 4

Annular Space

Table with columns: Depth Set at (m/ft) From, To, Type of Sealant Used (Material and Type), Volume Placed (m<sup>3</sup>/ft<sup>3</sup>)

Results of Well Yield Testing

Table with columns: After test of well yield, water was: (Clear and sand free, Other), Draw Down (Time, Water Level), Recovery (Time, Water Level), Pumping rate, Duration of pumping, Final water level end of pumping, If flowing give rate, Recommended pump depth, Recommended pump rate, Well production, Disinfected?

Method of Construction

Form with checkboxes for Cable Tool, Rotary (Conventional/Reverse), Boring, Air percussion, Other, and Well Use (Public, Commercial, Domestic, Municipal, Test Hole, Monitoring, Irrigation, Industrial, Other)

Construction Record - Casing

Table with columns: Inside Diameter (cm/in), Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel), Wall Thickness (cm/in), Depth (m/ft) From, To, Status of Well (Water Supply, Replacement Well, Test Hole, Recharge Well, Dewatering Well, Observation and/or Monitoring Hole, Alteration, Abandoned, Insufficient Supply, Abandoned, Poor Water Quality, Abandoned, other, Other)

Construction Record - Screen

Table with columns: Outside Diameter (cm/in), Material (Plastic, Galvanized, Steel), Slot No., Depth (m/ft) From, To


Water Details

Table with columns: Water found at Depth (m/ft), Kind of Water (Fresh, Untested, Gas, Other), Hole Diameter (Depth (m/ft) From, To, Diameter (cm/in))

Well Contractor and Well Technician Information

Form with fields for Business Name of Well Contractor, Well Contractor's Licence No., Business Address (Street Number/Name), Municipality, Province, Postal Code, Business E-mail Address, Bus. Telephone No. (inc. area code), Name of Well Technician (Last Name, First Name), Well Technician's Licence No., Signature of Technician and/or Contractor, Date Submitted

Map of Well Location

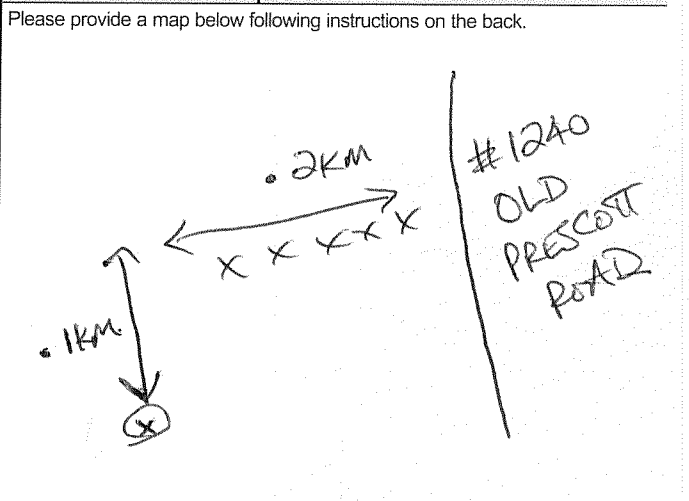

Comments: 3/4 HP - 15 GPM SET @ 100 FT

Form with fields for Well owner's information package delivered (Yes/No), Date Package Delivered, Date Work Completed, Ministry Use Only (Audit No., Received)



Measurements recorded in:  Metric  Imperial

A144873

Well Owner's Information

First Name, Last Name / Organization (1384341 Ontario Limited (c/o Cavanagh Const)), E-mail Address, Mailing Address (9094 Cavanagh Road), Municipality (Ashton), Province (On), Postal Code (K0A 1B0), Telephone No.

Well Location

Address of Well Location (1240 Old Prescott Road), Township (Osgoode), Lot (P/L 4), Concession (4S), County/District/Municipality (Ottawa-Carleton), City/Town/Village (Greely), Province (Ontario), UTM Coordinates, Municipal Plan and Sublot Number, Other (TEST WELL #3)

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth From, Depth To. Rows include Sand, Sand & Gravel, Limestone, Sandstone Mix.

Annular Space table with columns: Depth Set at (From/To), Type of Sealant Used, Volume Placed.

Results of Well Yield Testing table with columns: Draw Down (Time, Water Level), Recovery (Time, Water Level). Includes pumping rate, duration, and final water level.

Method of Construction and Well Use checkboxes. Includes Cable Tool, Rotary, Boring, Air percussion, and various well uses like Domestic, Commercial, Industrial.

Construction Record - Casing and Status of Well. Includes Inside Diameter, Open Hole OR Material, Wall Thickness, Depth, and checkboxes for Water Supply, Replacement Well, etc.

Construction Record - Screen. Includes Outside Diameter, Material, Slot No., Depth.

Water Details and Hole Diameter. Includes Water found at Depth, Kind of Water, and Hole Diameter (Depth, Diameter).

Well Contractor and Well Technician Information. Includes Business Name (Air Rock Drilling Co. Ltd.), Licence No., Business Address, Municipality, Province, Postal Code, Business E-mail Address, Bus. Telephone No., Name of Well Technician (Grant, Andrew), Well Technician's Licence No., Signature, Date Submitted.

Map of Well Location with handwritten notes: West Beaver Blvd, #1240 OLD PRESCOTT RD, 1051, 2km, MCKEOWN DR. Includes a diagram of the well location relative to these landmarks.

Additional information fields: Date Package Delivered (2013/08/19), Date Work Completed (2013/08/14), Well owner's information package delivered (Yes/No).

Ministry Use Only section: Audit No. (z 155193), Date (OCT 10 2013).



Measurements recorded in:  Metric  Imperial

Well Owner's Information

First Name: Last Name / Organization: Direct Bore Inc. E-mail Address: Well Constructed by Well Owner: Mailing Address (Street Number/Name): 5689 Power Road Municipality: Gloucester Province: ON Postal Code: K1G 3N4 Telephone No. (inc. area code):

Well Location

Address of Well Location (Street Number/Name): 6834 Hiram Drive Township: Osgoode Lot: P/L 5 Concession: 4 County/District/Municipality: Ottawa-Carleton City/Town/Village: Greely Province: Ontario Postal Code: UTM Coordinates: Zone: Easting: Northing: Municipal Plan and Sublot Number: Other: P/L 6

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Rows include Sand, Clay, Gravel, Boulders, Limestone.

Annular Space table with columns: Depth Set at (m/ft) From, To; Type of Sealant Used (Material and Type); Volume Placed (m³/ft³). Rows include Neat cement and Bentonite slurry.

Method of Construction and Well Use checkboxes. Includes Cable Tool, Rotary, Boring, Air percussion, Diamond, Jetting, Driving, Digging, Public, Commercial, Domestic, Municipal, Test Hole, Cooling & Air Conditioning, Livestock, Irrigation, Industrial, etc.


Construction Record - Casing and Status of Well. Includes Inside Diameter, Open Hole OR Material, Wall Thickness, Depth, and checkboxes for Water Supply, Replacement Well, etc.

Construction Record - Screen. Includes Outside Diameter, Material, Slot No., and Depth.

Water Details and Hole Diameter. Includes Water found at Depth, Kind of Water, and Hole Diameter (Depth and Diameter).

Well Contractor and Well Technician Information. Includes Business Name (Air Rock Drilling Co. Ltd.), Licence No., Address, Municipality, Province, Postal Code, Business E-mail Address, Bus. Telephone No., Name of Well Technician (Shannon Furcell), Signature, and Date Submitted.

Results of Well Yield Testing. Includes After test of well yield, water was: (Clear and sand free, Other, Not tested), Draw Down (Time, Water Level), Recovery (Time, Water Level), Pumping rate, Duration of pumping, Final water level end of pumping, If flowing give rate, Recommended pump depth, Recommended pump rate, Well production, Disinfected? (Yes/No).

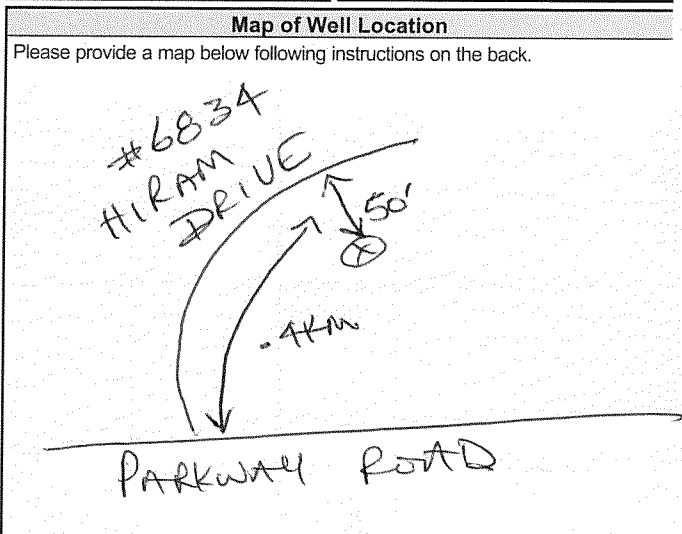

Comments: 1/2 HP - 10 GPM - SET @ 90 FT

Ministry Use Only. Includes Well owner's information package delivered (Yes/No), Date Package Delivered (2013 08 09), Date Work Completed (2013 08 08), Audit No. (z 155176), and Date (OCT 10 2013).

Follow the **COVID-19 restrictions and public health measures** (<https://covid-19.ontario.ca/public-health-measures>) and **book your appointment to get vaccinated** (<https://covid-19.ontario.ca/book-vaccine/>).



[\(/page/government-ontario\)](/page/government-ontario)

Français (/fr/page/registre-de-puits)  
FR (/FR/PAGE/REGISTRE-DE-PUITS)

Menu

## Map: Well records

This map allows you to search and view well record information from reported wells in Ontario.

Full dataset is available in the [Open Data catalogue](https://data.ontario.ca/dataset/well-records) (<https://data.ontario.ca/dataset/well-records>).

---

[Go Back to Map \(\)](#)

### Well ID

Well ID Number: 7228021

Well Audit Number: Z166988

Well Tag Number: A128102

*This table contains information from the original well record and any subsequent updates.*

### Well Location

**Address of Well Location**

6823 HIRAM DRIVE

---



**Township**

OSGOODE TOWNSHIP

**Lot****Concession****County/District/Municipality**

OTTAWA-CARLETON

**City/Town/Village**

GREELY

**Province**

ON

**Postal Code**

n/a

**UTM Coordinates**

NAD83 — Zone 18

Easting: 454579.00

Northing: 5011728.00

**Municipal Plan and Sublot Number****Other**

## Overburden and Bedrock Materials Interval

| General Colour | Most Common Material | Other Materials | General Description | Depth From | Depth To |
|----------------|----------------------|-----------------|---------------------|------------|----------|
|                | SAND                 | GRVL            | BLDR                | 0 ft       | 52 ft    |
| GREY           | LMSN                 |                 |                     | 52 ft      | 87 ft    |
| GREY           | LMSN                 |                 |                     | 87 ft      | 135 ft   |
| GREY           | SNDS                 |                 |                     | 135 ft     | 155 ft   |
| GREY           | SNDS                 |                 |                     | 155 ft     | 162 ft   |

## Annular Space/Abandonment Sealing Record

| Depth From | Depth To | Type of Sealant Used (Material and Type) | Volume Placed |
|------------|----------|--|---------------|
|------------|----------|--|---------------|

|       |      |                  |
|-------|------|------------------|
| 48 ft | 0 ft | BENTONITE SLURRY |
|-------|------|------------------|

|       |       |             |
|-------|-------|-------------|
| 58 ft | 48 ft | NEAT CEMENT |
|-------|-------|-------------|

## Method of Construction & Well Use

| Method of Construction | Well Use |
|------------------------|----------|
|------------------------|----------|

|                |  |
|----------------|--|
| Air Percussion |  |
|----------------|--|

|  |          |
|--|----------|
|  | Domestic |
|--|----------|

## Status of Well

Water Supply

## Construction Record - Casing

| Inside Diameter | Open Hole or material | Depth From | Depth To |
|-----------------|-----------------------|------------|----------|
| 6.25 inch       | STEEL                 | -2 ft      | 58 ft    |
| 5.9375 inch     | OPEN HOLE             | 58 ft      | 162 ft   |

## Construction Record - Screen

| Outside Diameter | Material | Depth From | Depth To |
|------------------|----------|------------|----------|
|------------------|----------|------------|----------|

## Well Contractor and Well Technician Information

Well Contractor's Licence Number: 1119

## Results of Well Yield Testing

After test of well yield, water was

If pumping discontinued, give reason

Pump intake set at 150 ft

Pumping Rate 5 GPM

Duration of Pumping 1 h:0 m

Final water level 114.5 ft

If flowing give rate

Recommended pump depth 140 ft

Recommended pump rate 5 GPM

Well Production

Disinfected? Y

## Draw Down & Recovery

| Draw Down Time(min) | Draw Down Water level | Recovery Time(min) | Recovery Water level |
|---------------------|-----------------------|--------------------|----------------------|
| SWL                 | 15.5 ft               |                    |                      |
| 1                   | 19.417 ft             | 1                  | 96.583 ft            |
| 2                   | 28.5 ft               | 2                  | 79.25 ft             |
| 3                   | 33.167 ft             | 3                  | 72.167 ft            |
| 4                   | 36.417 ft             | 4                  | 69.167 ft            |
| 5                   | 40.583 ft             | 5                  | 66.417 ft            |

|    |            |    |           |
|----|------------|----|-----------|
| 10 | 55.333 ft  | 10 | 50.667 ft |
| 15 | 63.667 ft  | 15 | 36.333 ft |
| 20 | 71.583 ft  | 20 | 23.167 ft |
| 25 | 78.5 ft    | 25 | 15.5 ft   |
| 30 | 87.25 ft   | 30 | 15.5 ft   |
| 40 | 94.5 ft    | 40 | 15.5 ft   |
| 45 |            | 45 |           |
| 50 | 103.583 ft | 50 | 15.5 ft   |
| 60 | 114.5 ft   | 60 | 15.5 ft   |

## Water Details

| Water Found at Depth | Kind     |
|----------------------|----------|
| 155 ft               | Untested |

## Hole Diameter

| Depth From | Depth To | Diameter    |
|------------|----------|-------------|
| 0 ft       | 58 ft    | 9.75 inch   |
| 58 ft      | 162 ft   | 5.9375 inch |

**Audit Number:** Z166988



**Date Well Completed:** August 13, 2014

**Date Well Record Received by MOE:** September 22, 2014

## Related

[How to use a Ministry of the Environment map \(/page/how-use-ministry-environment-map#wells\)](/page/how-use-ministry-environment-map#wells)

Technical documentation: Metadata record (<https://data.ontario.ca/dataset/well-records/resource/3031344e-e3f2-48d5-888c-c1deadfd2f77>)

Updated: October 18, 2021

Published: March 20, 2014

---

[about Ontario \(https://www.ontario.ca/page/about-ontario\)](https://www.ontario.ca/page/about-ontario)

[accessibility \(https://www.ontario.ca/page/accessibility\)](https://www.ontario.ca/page/accessibility)

[news \(http://news.ontario.ca/newsroom/en\)](http://news.ontario.ca/newsroom/en)

[privacy \(https://www.ontario.ca/page/privacy-statement\)](https://www.ontario.ca/page/privacy-statement)

[terms of use \(https://www.ontario.ca/page/terms-use\)](https://www.ontario.ca/page/terms-use)

[© Queen's Printer for Ontario, 2012–22 \(https://www.ontario.ca/page/copyright-information-c-queens-printer-ontario\)](https://www.ontario.ca/page/copyright-information-c-queens-printer-ontario)



Measurements recorded in:  Metric  Imperial

A144876

Page \_\_\_ of \_\_\_

Well Owner's Information

First Name, Last Name / Organization, E-mail Address, Mailing Address (Street Number/Name), Municipality, Province, Postal Code, Telephone No. (inc. area code)

Well Location

Address of Well Location (Street Number/Name), Township, Lot, Concession, County/District/Municipality, City/Town/Village, Province, Postal Code, UTM Coordinates, Northing, Municipal Plan and Sublot Number, Other

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Includes handwritten 'Test Well #5'.

Annular Space table with columns: Depth Set at (m/ft) From, To, Type of Sealant Used (Material and Type), Volume Placed (m³/ft³)

Method of Construction and Well Use checkboxes: Cable Tool, Rotary, Boring, Air percussion, etc.


Construction Record - Casing table with columns: Inside Diameter (cm/in), Open Hole OR Material, Wall Thickness (cm/in), Depth (m/ft) From, To, Status of Well

Construction Record - Screen table with columns: Outside Diameter (cm/in), Material, Slot No., Depth (m/ft) From, To

Water Details and Hole Diameter tables with columns for water depth, kind of water, and hole dimensions.

Well Contractor and Well Technician Information form: Business Name, Address, E-mail, Licence No., Technician Name, Signature, Date Submitted

Results of Well Yield Testing table with columns: Draw Down (Time, Water Level), Recovery (Time, Water Level), Pumping rate, Duration of pumping, Final water level end of pumping, Recommended pump depth, Recommended pump rate, Well production, Disinfected?

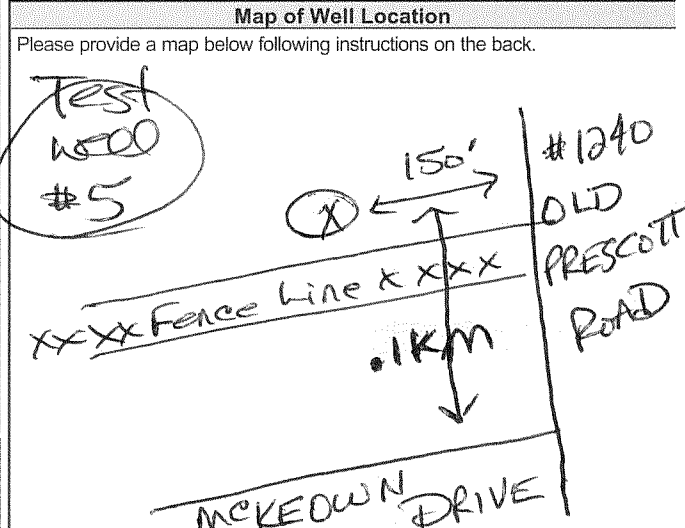

Comments: 1 HP - 10 GPM SET @ 250 FT TW#5

Well owner's information package delivered, Date Package Delivered, Date Work Completed, Ministry Use Only (Audit No., Received)



Measurements recorded in:  Metric  Imperial

Page of

Well Owner's Information

First Name, Last Name / Organization (Waiko Construction Ltd.), E-mail Address, Mailing Address (811 Kennedy Road), Municipality (Kemptville), Province (ON), Postal Code (K0G 1J0), Telephone No.

Well Location

Address of Well Location (6945 McKeown Drive), Township (Osgoode), Lot (P/L 5), Concession (4), County/District/Municipality (Ottawa-Carleton), City/Town/Village (Greely), Province (Ontario), UTM Coordinates, Municipal Plan and Sublot Number (4M-351), Other (Part Block 1)

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Rows include Clay, Sand & Boulders, Limestone, Sandstone.

Annular Space table with columns: Depth Set at (m/ft) From, To, Type of Sealant Used, Volume Placed (m³/ft³). Rows for Neat cement and Bentonite slurry.

Method of Construction and Well Use checkboxes. Includes Cable Tool, Rotary, Boring, Air percussion, Public, Commercial, Domestic, Municipal, Test Hole, Irrigation, Industrial, etc.


Construction Record - Casing and Status of Well. Includes Inside Diameter, Open Hole OR Material, Wall Thickness, Depth, and checkboxes for Water Supply, Replacement Well, etc.

Construction Record - Screen. Includes Outside Diameter, Material, Slot No., and Depth.

Water Details and Hole Diameter. Includes Water found at Depth, Kind of Water, and Hole Diameter (Depth and Diameter).

Well Contractor and Well Technician Information. Includes Business Name of Well Contractor (Air Rock Drilling Co. Ltd.), Well Contractor's Licence No., Business Address, Municipality, Province, Postal Code, Business Email Address, Bus. Telephone No., Name of Well Technician (Hogan, Dan), Signature of Technician and/or Contractor, Date Submitted.

Results of Well Yield Testing. Includes After test of well yield, water was (Not tested), Draw Down table (Time, Water Level, Recovery), Pumping rate, Duration of pumping, Final water level end of pumping, If flowing give rate, Recommended pump depth and rate, Well production, Disinfected?

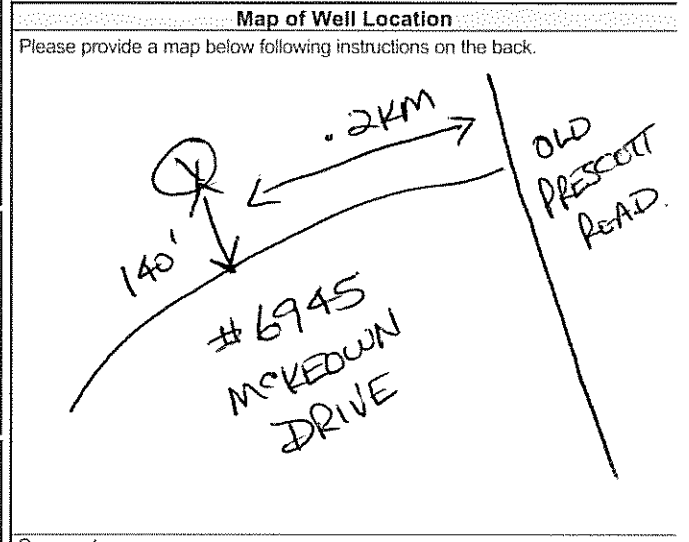

Comments: 1/2 HP - 5 GPM SET @ 140 FT

Ministry Use Only. Includes Well owner's information package delivered (Yes/No), Date Package Delivered (2015 02 11), Date Work Completed (2015 02 06), Audit No. (Z191365), Received (APR 24 2015).

Measurements recorded in:  Metric  Imperial

A177769

Page \_\_\_ of \_\_\_

**Well Owner's Information**

First Name: \_\_\_\_\_ Last Name / Organization: **Marathon Drilling Co. Ltd.** E-mail Address: \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name): **6847 Hiram Road** Municipality: **Greely** Province: **ON** Postal Code: **K4P 1A2** Telephone No. (inc. area code): \_\_\_\_\_

**Well Location**

Address of Well Location (Street Number/Name): **6847 Hiram Road** Township: **Osgoode** Lot: **P1L4** Concession: **45**

County/District/Municipality: **Ottawa-Carleton** City/Town/Village: **Greely** Province: **Ontario** Postal Code: \_\_\_\_\_

UTM Coordinates Zone: **18** Easting: **454596** Northing: **5011876** Municipal Plan and Sublot Number: \_\_\_\_\_ Other: \_\_\_\_\_

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

| General Colour | Most Common Material | Other Materials | General Description | Depth (m/ft) |
|----------------|----------------------|-----------------|---------------------|--------------|
|                |                      |                 |                     | From To      |
|                | Sand                 | Clay            |                     | 0' 28'       |
|                | Sand & Gravel        | Boulders        |                     | 28' 54'      |
| Grey           | Limestone            |                 |                     | 54' 143'     |
| Grey           | Sandstone            |                 |                     | 143' 161'    |
| Grey           | Sandstone            |                 |                     | 161' 232'    |
| Grey           | Sandstone            |                 |                     | 232' 247'    |
| Grey           | Sandstone            |                 |                     | 247' 260'    |

**Annular Space**

| Depth Set at (m/ft) | Type of Sealant Used (Material and Type) | Volume Placed (m <sup>3</sup> /ft <sup>3</sup> ) |
|---------------------|--|--|
| From To             |  |  |
| 64' 54'             | Neat cement                              | 21.8   |
| 54' 0'              | Bentonite slurry                         | 16.8   |

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used

Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering

Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring

Boring  Digging  Irrigation  Cooling & Air Conditioning

Air percussion  Industrial  Other, specify \_\_\_\_\_

Other, specify \_\_\_\_\_

**Construction Record - Casing**

| Inside Diameter (cm/in) | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm/in) | Depth (m/ft) |      | Status of Well   |
|-------------------------|--|------------------------|--------------|------|--|
|                         |  |                        | From         | To   |  |
| 6 1/4"                  | Steel  | .188"                  | +2'          | 64'  | <input checked="" type="checkbox"/> Water Supply<br><input type="checkbox"/> Replacement Well<br><input type="checkbox"/> Test Hole<br><input type="checkbox"/> Recharge Well<br><input type="checkbox"/> Dewatering Well<br><input type="checkbox"/> Observation and/or Monitoring Hole<br><input type="checkbox"/> Alteration (Construction)<br><input type="checkbox"/> Abandoned, Insufficient Supply<br><input type="checkbox"/> Abandoned, Poor Water Quality<br><input type="checkbox"/> Abandoned, other, specify _____<br><input type="checkbox"/> Other, specify _____ |
| 6"                      | Open Hole  |                        | 64'          | 260' |  |

**Construction Record - Screen**

| Outside Diameter (cm/in) | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft) |    |
|--------------------------|---------------------------------------|----------|--------------|----|
|                          |                                       |          | From         | To |
|                          |                                       |          |              |    |

**Water Details**

| Water found at Depth (m/ft) | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested |
|-----------------------------|--|
| 161 (m/ft)                  | <input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify _____      |
| 232 (m/ft)                  | <input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify _____      |
| 247 (m/ft)                  | <input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify _____      |

**Hole Diameter**

| Depth (m/ft) | Diameter (cm/in) |
|--------------|------------------|
| From To      |                  |
| 0' 64'       | 9 3/4"           |
| 64' 260'     | 6"               |

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **Air Rock Drilling Co. Ltd.** Well Contractor's Licence No.: **1119**

Business Address (Street Number/Name): **6639 Franktown Road, RR#1** Municipality: **Richmond**

Province: **ON** Postal Code: **K0A 2Z0** Business E-mail Address: **air-rock@sympatico.ca**

Bus. Telephone No. (inc. area code): **613882170** Name of Well Technician (Last Name, First Name): **Hanna, Jeremy**

Well Technician's Licence No.: **T3632** Signature of Technician and/or Contractor: \_\_\_\_\_ Date Submitted: **2015 10 30**

**Results of Well Yield Testing**

After test of well yield, water was:  Clear and sand free  Other, specify **Not tested**

If pumping discontinued, give reason: \_\_\_\_\_

Pump intake set at (m/ft): **200'**

Pumping rate (l/min / GPM): **20**

Duration of pumping: **1 hrs + 0 min**

Final water level end of pumping (m/ft): **86'6"**

If flowing give rate (l/min / GPM): \_\_\_\_\_


Recommended pump depth (m/ft): **200'**

Recommended pump rate (l/min / GPM): **20+**

Well production (l/min / GPM): **20+**

Disinfected?  Yes  No

| Time (min)   | Draw Down          |            | Recovery           |            |
|--------------|--------------------|------------|--------------------|------------|
|              | Water Level (m/ft) | Time (min) | Water Level (m/ft) | Time (min) |
| Static Level | <b>26'6"</b>       |            | <b>86.6"</b>       |            |
| 1            | 35.5               | 1          | 60                 |            |
| 2            | 41.3               | 2          | 50.8               |            |
| 3            | 45.6               | 3          | 45.6               |            |
| 4            | 49.2               | 4          | 42.2               |            |
| 5            | 52.1               | 5          | 39.5               |            |
| 10           | 61.3               | 10         | 33                 |            |
| 15           | 66.6               | 15         | 27                 |            |
| 20           | 69.9               | 20         | 26.6               |            |
| 25           | 72.3               | 25         | 26.6               |            |
| 30           | 74.5               | 30         | 26.6               |            |
| 40           | 78.7               | 40         | 26.6               |            |
| 50           | 82.7               | 50         | 26.6               |            |
| 60           | 86.6"              | 60         | 26.6"              |            |

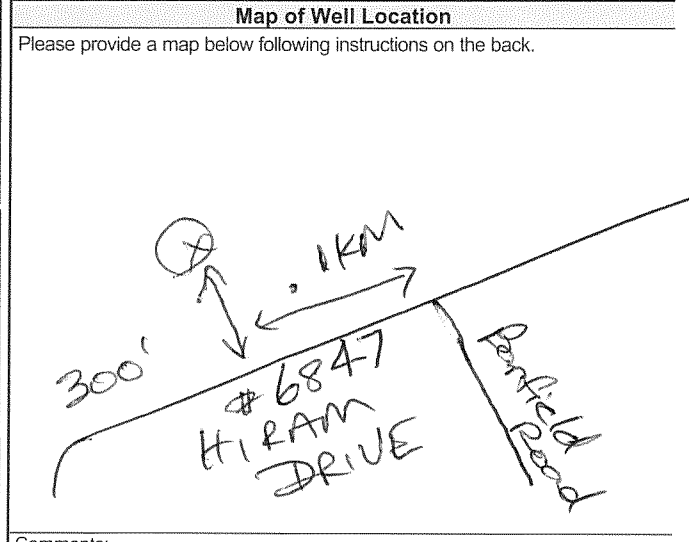

Comments: \_\_\_\_\_

**Ministry Use Only**

Well owner's information package delivered:  Yes  No

Date Package Delivered: **2015 10 06**

Date Work Completed: **2015 10 01**

Audit No: **202618**

Retrieved: **NOV 17 2015**





Measurements recorded in:  Metric  Imperial

A229022

Page \_\_\_ of \_\_\_

Address of Well Location (Street Number/Name) **6820 Mckeown Drive** Township **Osgoode** Lot **P/L 4** Concession **4**

County/District/Municipality **Ottawa-Carleton** City/Town/Village **Greely** Province **Ontario** Postal Code \_\_\_\_\_

UTM Coordinates Zone **18** Easting **454770** Northing **5011553** Municipal Plan and Sublot Number **4M-351** Other **Part Block 6**

**Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)**

| General Colour | Most Common Material | Other Materials | General Description | Depth (m) |
|----------------|----------------------|-----------------|---------------------|-----------|
|                |                      |                 |                     | From To   |
|                | Clay                 |                 |                     | 0' 10'    |
|                | Gravel               | ☑ Boulders      |                     | 10' 58'   |
| Grey           | Limestone            |                 |                     | 58' 151'  |
| Grey           | Sandstone            |                 |                     | 151' 209' |
| Grey           | Sandstone            |                 |                     | 209' 213' |
| Grey           | Sandstone            |                 |                     | 213' 220' |

**Annular Space**

| Depth Set at (m) | Type of Sealant Used (Material and Type) | Volume Placed (m³) |
|------------------|--|--------------------|
| From To          |  |                    |
| 66' 58'          | Neat cement                              | 10.8               |
| 58' 0'           | Bentonite slurry                         | 18.8               |

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used

Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering

Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring

Boring  Digging  Irrigation  Cooling & Air Conditioning

Air percussion  Industrial  Other, specify \_\_\_\_\_

**Construction Record - Casing**

| Inside Diameter (cm) | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm) | Depth (m) | Status of Well                                   |
|----------------------|--|---------------------|-----------|--|
|                      |  |                     | From To   |  |
| 6 1/4"               | Steel  | .188"               | +2' 66'   | <input checked="" type="checkbox"/> Water Supply |
| 6"                   | Open Hole  |                     | 66' 220'  | <input type="checkbox"/> Replacement Well        |

**Construction Record - Screen**

| Outside Diameter (cm/in) | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft) | Status of Well   |
|--------------------------|---------------------------------------|----------|--------------|--|
|                          |                                       |          | From To      |  |
|                          |                                       |          |              | <input type="checkbox"/> Abandoned, Insufficient Supply  |
|                          |                                       |          |              | <input type="checkbox"/> Abandoned, Poor Water Quality   |
|                          |                                       |          |              | <input type="checkbox"/> Abandoned, other, specify _____ |
|                          |                                       |          |              | <input type="checkbox"/> Other, specify _____            |

**Water Details**

| Water found at Depth (m/ft) | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Intested | Depth (m/ft) | Diameter (cm/in) |
|-----------------------------|--|--------------|------------------|
|                             | <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____                 | From To      |                  |
| 209 (m/ft)                  | <input checked="" type="checkbox"/> Intested   | 0' 66'       | 9 3/4"           |
| 213 (m/ft)                  | <input checked="" type="checkbox"/> Intested   | 66' 220'     | 6"               |

**Well Contractor and Well Technician Information**

Business Name of Well Contractor **Air Rock Drilling Co. Ltd.** Well Contractor's Licence No. **1119**

Business Address (Street Number/Name) **6820 Mckeown Road, RR#1** Municipality **Richmond**

Province **ON** Postal Code **K0A 2Z0** Business E-mail Address **air-rock@sympatico.ca**

Bus. Telephone No. (inc. area code) **813882170** Name of Well Technician (Last Name, First Name) **Hanna, Jeremy**

Well Technician's Licence No. **13632** Signature of Technician and/or Contractor *[Signature]* Date Submitted **09 29 2017**

**Results of Well Yield Testing**

After test of well yield, water was:  Clear and sand free  Other, specify **Not tested**

If pumping discontinued, give reason: **X**

Pump intake set at (m) **180**

Pumping rate (l/min / GPM) **20**

Duration of pumping **1** hrs + **0** min

Final water level end of pumping (m/ft) **51.1'**

If flowing give rate (l/min / GPM) **X**


Recommended pump depth (m) **140'**

Recommended pump rate (l/min / GPM) **20 gpm**

Well production (l/min / GPM) **20**

Disinfected?  Yes  No

| Time (min) | Draw Down (m/ft) |              | Recovery (m/ft) |              |
|------------|------------------|--------------|-----------------|--------------|
|            | Water Level      | Static Level | Water Level     | Static Level |
|            |                  | <b>23.5'</b> |                 | <b>51.1'</b> |
| 1          | 30               |              | 1               | 32.5         |
| 2          | 33.1             |              | 2               | 28.9         |
| 3          | 35.4             |              | 3               | 27.3         |
| 4          | 37               |              | 4               | 26.7         |
| 5          | 38.3             |              | 5               | 26.4         |
| 10         | 41.5             |              | 10              | 25.2         |
| 15         | 43.1             |              | 15              | 24.2         |
| 20         | 44.2             |              | 20              | 23.5         |
| 25         | 45.2             |              | 25              | 23.5         |
| 30         | 46.1             |              | 30              | 23.5         |
| 40         | 47.8             |              | 40              | 23.5         |
| 50         | 49.4             |              | 50              | 23.5         |
| 60         | 51.1'            |              | 60              | 23.5'        |

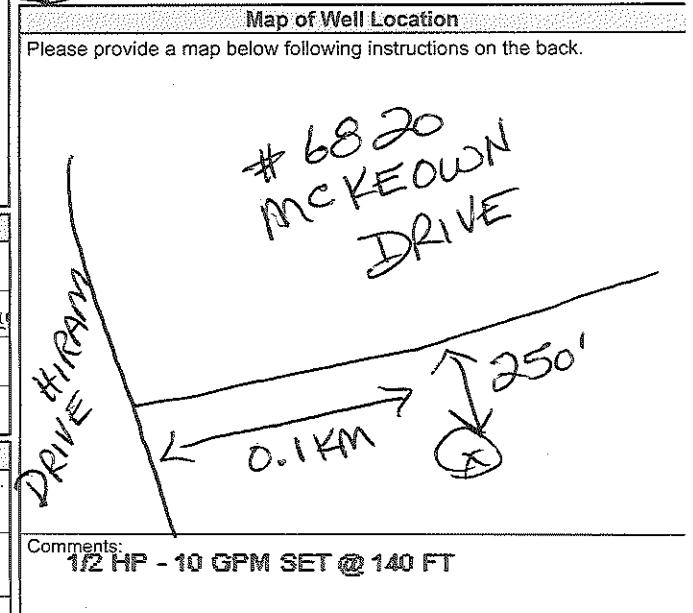

Comments: **1/2 HP - 10 GPM SET @ 140 FT**

Well owner's information package delivered  Yes  No

Date Package Delivered **2017 09 19**

Date Work Completed **2017 09 18**

**Ministry Use Only**

Audit No. **2262386**

Received **OCT 13 2017**

Follow the **[COVID-19 restrictions and public health measures \(https://covid-19.ontario.ca/public-health-measures\)](https://covid-19.ontario.ca/public-health-measures)** and **[book your appointment to get vaccinated \(https://covid-19.ontario.ca/book-vaccine/\)](https://covid-19.ontario.ca/book-vaccine/)**.



[\(/page/government-ontario\)](/page/government-ontario)

Français (/fr/page/registre-de-puits)  
FR (/FR/PAGE/REGISTRE-DE-PUITS)

Menu

# Map: Well records

This map allows you to search and view well record information from reported wells in Ontario.

Full dataset is available in the [Open Data catalogue \(https://data.ontario.ca/dataset/well-records\)](https://data.ontario.ca/dataset/well-records).

---

[Go Back to Map \(\)](#)

## Well ID

Well ID Number: 7310034

Well Audit Number: Z262192

Well Tag Number: A229069

*This table contains information from the original well record and any subsequent updates.*

## Well Location

**Address of Well Location**

1314 SOUTH BEACH BLVD

|   |   |
|---|---|
| <b>Township</b>                         | OSGOODE TOWNSHIP  |
| <b>Lot</b>                              | 004   |
| <b>Concession</b>                       | CON 04  |
| <b>County/District/Municipality</b>     | OTTAWA-CARLETON   |
| <b>City/Town/Village</b>                | GREELY  |
| <b>Province</b>                         | ON  |
| <b>Postal Code</b>                      | n/a   |
| <b>UTM Coordinates</b>                  | NAD83 — Zone 18<br>Easting: 454482.00<br>Northing: 5012159.00 |
| <b>Municipal Plan and Sublot Number</b> |   |
| <b>Other</b>                            |   |

## Overburden and Bedrock Materials Interval

| General Colour | Most Common Material | Other Materials | General Description | Depth From | Depth To |
|----------------|----------------------|-----------------|---------------------|------------|----------|
|                | SAND                 | GRVL            |                     | 0 ft       | 44 ft    |
| GREY           | LMSN                 |                 |                     | 44 ft      | 95 ft    |
| GREY           | LMSN                 |                 |                     | 95 ft      | 116 ft   |
| GREY           | LMSN                 |                 |                     | 116 ft     | 134 ft   |
| GREY           | LMSN                 |                 |                     | 134 ft     | 140 ft   |

## Annular Space/Abandonment Sealing Record

| Depth From | Depth To | Type of Sealant Used (Material and Type) | Volume Placed |
|------------|----------|--|---------------|
|------------|----------|--|---------------|

|       |      |                     |
|-------|------|---------------------|
| 40 ft | 0 ft | BENTONITE SLURRY 21 |
|-------|------|---------------------|

|       |       |                  |
|-------|-------|------------------|
| 50 ft | 40 ft | NEAT CEMENT 12.5 |
|-------|-------|------------------|

## Method of Construction & Well Use

| Method of Construction | Well Use |
|------------------------|----------|
|------------------------|----------|

|                |  |
|----------------|--|
| Air Percussion |  |
|----------------|--|

|  |          |
|--|----------|
|  | Domestic |
|--|----------|

## Status of Well

Water Supply

## Construction Record - Casing

| Inside Diameter | Open Hole or material | Depth From | Depth To |
|-----------------|-----------------------|------------|----------|
| 6.25 inch       | STEEL                 | -2 ft      | 50 ft    |
| 6 inch          | OPEN HOLE             | 50 ft      | 140 ft   |

## Construction Record - Screen

| Outside Diameter | Material | Depth From | Depth To |
|------------------|----------|------------|----------|
|------------------|----------|------------|----------|

## Well Contractor and Well Technician Information



Well Contractor's Licence Number: 1119

## Results of Well Yield Testing

After test of well yield, water was

If pumping discontinued, give reason

Pump intake set at 80 ft

Pumping Rate 20 GPM

Duration of Pumping 1 h:0 m

Final water level 7.333 ft

If flowing give rate

Recommended pump depth 80 ft

Recommended pump rate 20 GPM

Well Production

Disinfected? Y

## Draw Down & Recovery

| Draw Down Time(min) | Draw Down Water level | Recovery Time(min) | Recovery Water level |
|---------------------|-----------------------|--------------------|----------------------|
| SWL                 | 6 ft                  |                    |                      |
| 1                   | 7 ft                  | 1                  | 6 ft                 |
| 2                   | 7 ft                  | 2                  | 6 ft                 |
| 3                   | 7.1 ft                | 3                  | 6 ft                 |
| 4                   | 7.1 ft                | 4                  | 6 ft                 |
| 5                   | 7.1 ft                | 5                  | 6 ft                 |

|    |        |    |      |
|----|--------|----|------|
| 10 | 7.1 ft | 10 | 6 ft |
| 15 | 7.1 ft | 15 | 6 ft |
| 20 | 7.1 ft | 20 | 6 ft |
| 25 | 7.1 ft | 25 | 6 ft |
| 30 | 7.1 ft | 30 | 6 ft |
| 40 | 7.1 ft | 40 | 6 ft |
| 45 |        | 45 |      |
| 50 | 7.1 ft | 50 | 6 ft |
| 60 | 7.1 ft | 60 | 6 ft |

## Water Details

| Water Found at Depth | Kind     |
|----------------------|----------|
| 95 ft                | Untested |
| 116 ft               | Untested |
| 134 ft               | Untested |

## Hole Diameter

| Depth From | Depth To | Diameter  |
|------------|----------|-----------|
| 0 ft       | 50 ft    | 9.75 inch |
| 50 ft      | 140 ft   | 6 inch    |

**Audit Number:** Z262192

**Date Well Completed:** November 14, 2017

**Date Well Record Received by MOE:** April 24, 2018

## Related

[How to use a Ministry of the Environment map \(/page/how-use-ministry-environment-map#wells\)](/page/how-use-ministry-environment-map#wells)

Technical documentation: Metadata record (<https://data.ontario.ca/dataset/well-records/resource/3031344e-e3f2-48d5-888c-c1deadfd2f77>)

Updated: October 18, 2021

Published: March 20, 2014

---

[about Ontario \(https://www.ontario.ca/page/about-ontario\)](https://www.ontario.ca/page/about-ontario)

[accessibility \(https://www.ontario.ca/page/accessibility\)](https://www.ontario.ca/page/accessibility)

[news \(http://news.ontario.ca/newsroom/en\)](http://news.ontario.ca/newsroom/en)

[privacy \(https://www.ontario.ca/page/privacy-statement\)](https://www.ontario.ca/page/privacy-statement)

[terms of use \(https://www.ontario.ca/page/terms-use\)](https://www.ontario.ca/page/terms-use)

[© Queen's Printer for Ontario, 2012–22 \(https://www.ontario.ca/page/copyright-information-c-queens-printer-ontario\)](https://www.ontario.ca/page/copyright-information-c-queens-printer-ontario)

Measurements recorded in:  Metric  Imperial

|  |                         |                             |   |                        |
|--|-------------------------|-----------------------------|---|------------------------|
| Address of Well Location (Street Number/Name)<br>1366 Johnston Drive |                         | Township<br>Osgoode         | Lot<br>N/A                              | Concession<br>N/A      |
| County/District/Municipality<br>Ottawa                               |                         | City/Town/Village<br>Ottawa | Province<br>Ontario                     | Postal Code<br>K4P 1W6 |
| UTM Coordinates Zone<br>NAD 83                                       | Easting<br>180455360501 | Northing<br>21104           | Municipal Plan and Sublot Number<br>N/A | Other                  |

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

| General Colour | Most Common Material | Other Materials | General Description   | Depth (m/ft)<br>From To |
|----------------|----------------------|-----------------|---|-------------------------|
|                |                      |                 | raised casing above<br>Grade in accordance of<br>regulation 903 |                         |
|                |                      |                 | *well was sanitized*  |                         |

| Annular Space                  |   |                           |
|--------------------------------|---|---------------------------|
| Depth Set at (m/ft)<br>From To | Type of Sealant Used<br>(Material and Type) | Volume Placed<br>(m³/ft³) |
|                                | N/A   |                           |

| Results of Well Yield Testing   |              |                    |            |                    |
|---|--------------|--------------------|------------|--------------------|
| After test of well yield, water was:<br><input type="checkbox"/> Clear and sand free<br><input type="checkbox"/> Other, specify | Draw Down    |                    | Recovery   |                    |
|   | Time (min)   | Water Level (m/ft) | Time (min) | Water Level (m/ft) |
| If pumping discontinued, give reason:   | Static Level |                    |            |                    |
|   | 1            |                    | 1          |                    |
| Pump intake set at (m/ft)   | 2            |                    | 2          |                    |
| Pumping rate (l/min / GPM)  | 3            |                    | 3          |                    |
| Duration of pumping<br>hrs + min  | 4            |                    | 4          |                    |
| Final water level end of pumping (m/ft)   | 5            |                    | 5          |                    |
| If flowing give rate (l/min / GPM)  | 10           |                    | 10         |                    |
|   | 15           |                    | 15         |                    |
| Recommended pump depth (m/ft)   | 20           |                    | 20         |                    |
|   | 25           |                    | 25         |                    |
| Recommended pump rate (l/min / GPM)   | 30           |                    | 30         |                    |
|   | 40           |                    | 40         |                    |
| Well production (l/min / GPM)   | 50           |                    | 50         |                    |
|   | 60           |                    | 60         |                    |
| Disinfected?<br><input type="checkbox"/> Yes <input type="checkbox"/> No  |              |                    |            |                    |

| Method of Construction                         |   | Well Use                            |   |
|--|---|-------------------------------------|---|
| <input type="checkbox"/> Cable Tool            | <input checked="" type="checkbox"/> Diamond | <input type="checkbox"/> Public     | <input type="checkbox"/> Commercial                 |
| <input type="checkbox"/> Rotary (Conventional) | <input type="checkbox"/> Jetting            | <input type="checkbox"/> Domestic   | <input type="checkbox"/> Municipal                  |
| <input type="checkbox"/> Rotary (Reverse)      | <input type="checkbox"/> Driving            | <input type="checkbox"/> Livestock  | <input type="checkbox"/> Test Hole                  |
| <input type="checkbox"/> Boring                | <input checked="" type="checkbox"/> Digging | <input type="checkbox"/> Irrigation | <input type="checkbox"/> Cooling & Air Conditioning |
| <input type="checkbox"/> Air percussion        |   | <input type="checkbox"/> Industrial | <input type="checkbox"/> Other, specify             |
| <input type="checkbox"/> Other, specify        |   | <input type="checkbox"/> Not used   | <input type="checkbox"/> Dewatering                 |
|  |   | <input type="checkbox"/> Monitoring |   |


| Construction Record - Casing |  |                        | Status of Well |    |
|------------------------------|--|------------------------|----------------|----|
| Inside Diameter (cm/in)      | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm/in) | Depth (m/ft)   |    |
|                              |  |                        | From           | To |
|                              | N/A  |                        | 6"             | 6" |

|   |
|---|
| <input checked="" type="checkbox"/> Water Supply            |
| <input type="checkbox"/> Replacement Well                   |
| <input type="checkbox"/> Test Hole                          |
| <input type="checkbox"/> Recharge Well                      |
| <input type="checkbox"/> Dewatering Well                    |
| <input type="checkbox"/> Observation and/or Monitoring Hole |
| <input type="checkbox"/> Alteration (Construction)          |
| <input type="checkbox"/> Abandoned, Insufficient Supply     |
| <input type="checkbox"/> Abandoned, Poor Water Quality      |
| <input type="checkbox"/> Abandoned, other, specify          |
| <input type="checkbox"/> Other, specify                     |

| Construction Record - Screen |                                       |          |              |    |
|------------------------------|---------------------------------------|----------|--------------|----|
| Outside Diameter (cm/in)     | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft) |    |
|                              |                                       |          | From         | To |
|                              | N/A                                   |          |              |    |

| Water Details  |  | Hole Diameter        |                  |
|--|--|----------------------|------------------|
| Water found at Depth (m/ft) <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested | Depth (m/ft) From To | Diameter (cm/in) |
|  | 11ft   |                      | N/A              |

| Well Contractor and Well Technician Information             |  |   |                            |
|---|--|---|----------------------------|
| Business Name of Well Contractor<br>CN electric & Plumbing  |  | Well Contractor's Licence No.<br>6684     |                            |
| Business Address (Street Number/Name)<br>5640 Manotick main |  | Municipality<br>Ottawa                    |                            |
| Province<br>ONT   | Postal Code<br>K4M 1B3   | Business E-mail Address<br>CN-electric.ca |                            |
| Bus. Telephone No. (inc. area code)<br>613 692 3284         | Name of Well Technician (Last Name, First Name)<br>Sadler Johnston |   |                            |
| Well Technician's Licence No.<br>3689                       | Signature of Technician and/or Contractor                          |   | Date Submitted<br>20190816 |

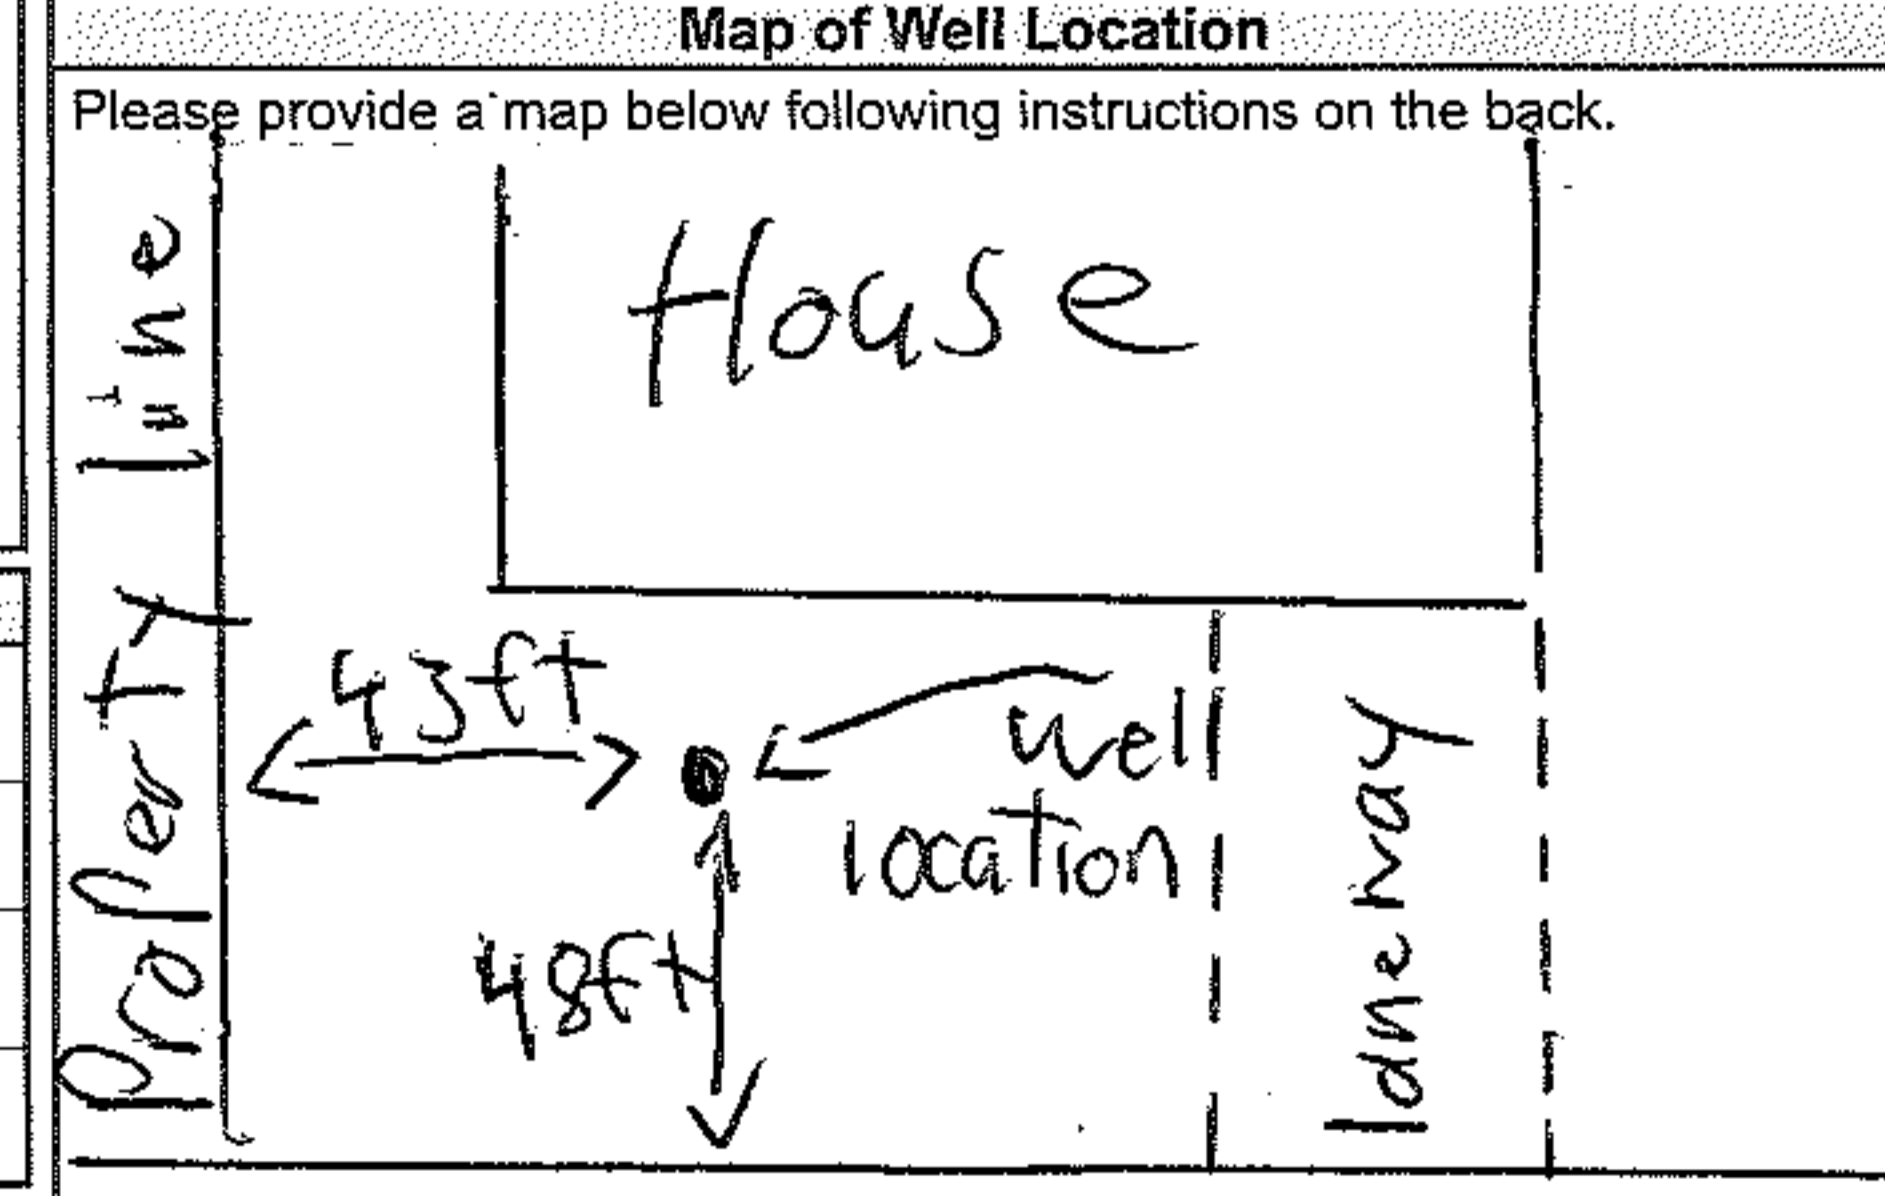

Johnston Drive

Comments:

|   |                                    |   |
|---|------------------------------------|---|
| Well owner's information package delivered<br><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | Date Package Delivered<br>20180816 | Ministry Use Only<br>Audit No. 2319379<br>SEP 06 2019<br>Received |
|   | Date Work Completed<br>20180816    |   |



Follow the **[COVID-19 restrictions and public health measures \(https://covid-19.ontario.ca/public-health-measures\)](https://covid-19.ontario.ca/public-health-measures)** and **[book your appointment to get vaccinated \(https://covid-19.ontario.ca/book-vaccine/\)](https://covid-19.ontario.ca/book-vaccine/)**.



[\(/page/government-ontario\)](/page/government-ontario)

Français (/fr/page/registre-de-puits)  
FR (/FR/PAGE/REGISTRE-DE-PUITS)

Menu

# Map: Well records

This map allows you to search and view well record information from reported wells in Ontario.

Full dataset is available in the [Open Data catalogue \(https://data.ontario.ca/dataset/well-records\)](https://data.ontario.ca/dataset/well-records).

---

[Go Back to Map \(\)](#)

## Well ID

Well ID Number: 7372157

Well Audit Number: Z344080

Well Tag Number: A305154

*This table contains information from the original well record and any subsequent updates.*

## Well Location

**Address of Well Location**

---

|   |   |
|---|---|
| <b>Township</b>                         | OSGOODE TOWNSHIP  |
| <b>Lot</b>                              | 004   |
| <b>Concession</b>                       | CON 04  |
| <b>County/District/Municipality</b>     | OTTAWA-CARLETON   |
| <b>City/Town/Village</b>                |   |
| <b>Province</b>                         | ON  |
| <b>Postal Code</b>                      | n/a   |
| <b>UTM Coordinates</b>                  | NAD83 — Zone 18<br>Easting: 454691.00<br>Northing: 5012376.00 |
| <b>Municipal Plan and Sublot Number</b> |   |
| <b>Other</b>                            |   |

## Overburden and Bedrock Materials Interval

| General Colour | Most Common Material | Other Materials | General Description | Depth From | Depth To |
|----------------|----------------------|-----------------|---------------------|------------|----------|
|----------------|----------------------|-----------------|---------------------|------------|----------|

## Annular Space/Abandonment Sealing Record

| Depth From | Depth To | Type of Sealant Used (Material and Type) | Volume Placed |
|------------|----------|--|---------------|
|------------|----------|--|---------------|

## Method of Construction & Well Use

| Method of Construction | Well Use |
|------------------------|----------|
|------------------------|----------|

## Status of Well

### Construction Record - Casing

| Inside Diameter | Open Hole or material | Depth From | Depth To |
|-----------------|-----------------------|------------|----------|
|-----------------|-----------------------|------------|----------|

### Construction Record - Screen

| Outside Diameter | Material | Depth From | Depth To |
|------------------|----------|------------|----------|
|------------------|----------|------------|----------|

## Well Contractor and Well Technician Information

Well Contractor's Licence Number: 7681

## Results of Well Yield Testing

After test of well yield, water was

If pumping discontinued, give reason

Pump intake set at

**Pumping Rate**

**Duration of Pumping**

**Final water level**

**If flowing give rate**

**Recommended pump depth**

**Recommended pump rate**

**Well Production**

**Disinfected?**

**Draw Down & Recovery**

| <b>Draw Down Time(min)</b> | <b>Draw Down Water level</b> | <b>Recovery Time(min)</b> | <b>Recovery Water level</b> |
|----------------------------|------------------------------|---------------------------|-----------------------------|
| SWL                        |                              |                           |                             |
| 1                          |                              | 1                         |                             |
| 2                          |                              | 2                         |                             |
| 3                          |                              | 3                         |                             |
| 4                          |                              | 4                         |                             |
| 5                          |                              | 5                         |                             |
| 10                         |                              | 10                        |                             |
| 15                         |                              | 15                        |                             |
| 20                         |                              | 20                        |                             |
| 25                         |                              | 25                        |                             |
| 30                         |                              | 30                        |                             |



40

40

45

45

50

50

60

60

## Water Details

**Water Found at Depth    Kind**

## Hole Diameter

**Depth    Depth    Diameter  
From    To**

**Audit Number:** Z344080

**Date Well Completed:** September 11, 2020

**Date Well Record Received by MOE:** November 03, 2020

## Related

[How to use a Ministry of the Environment map \(/page/how-use-ministry-environment-map#wells\)](/page/how-use-ministry-environment-map#wells)

Technical documentation: Metadata record (<https://data.ontario.ca/dataset/well-records/resource/3031344e-e3f2-48d5-888c-c1deadfd2f77>)

Updated: October 18, 2021

Published: March 20, 2014

---

[about Ontario \(https://www.ontario.ca/page/about-ontario\)](https://www.ontario.ca/page/about-ontario)

[accessibility\\_ \(https://www.ontario.ca/page/accessibility\)](https://www.ontario.ca/page/accessibility)

[news \(http://news.ontario.ca/newsroom/en\)](http://news.ontario.ca/newsroom/en)

[privacy\\_ \(https://www.ontario.ca/page/privacy-statement\)](https://www.ontario.ca/page/privacy-statement)

[terms of use \(https://www.ontario.ca/page/terms-use\)](https://www.ontario.ca/page/terms-use)

[© Queen's Printer for Ontario, 2012–22 \(https://www.ontario.ca/page/copyright-information-c-queens-printer-ontario\)](https://www.ontario.ca/page/copyright-information-c-queens-printer-ontario)

Client: Paterson Group  
154 Colonnade Rd. South  
Nepean, ON  
K2E 7T7  
Attention: Mr. Kirby Magee-Dittburner  
PO#: 33729  
Invoice to: Paterson Group

Report Number: 1971215  
Date Submitted: 2022-02-04  
Date Reported: 2022-02-10  
Project: PH4407  
COC #: 885852

Page 1 of 13

---

**Dear Kirby Magee-Dittburner:**

**Please find attached the analytical results for your samples. If you have any questions regarding this report, please do not hesitate to call (613-727-5692).**

Report Comments:

APPROVAL: \_\_\_\_\_

Addrine Thomas, Inorganics Supervisor

All analysis is completed at Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) unless otherwise indicated.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is accredited by CALA, Canadian Association for Laboratory Accreditation to ISO/IEC 17025 for tests which appear on the scope of accreditation. The scope is available at: <http://www.cala.ca/scopes/2602.pdf>.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is licensed by the Ontario Ministry of the Environment, Conservation, and Parks (MECP) for specific tests in drinking water (license #2318). A copy of the license is available upon request.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is accredited by the Ontario Ministry of Agriculture, Food, and Rural Affairs for specific tests in agricultural soils.

Please note: Field data, where presented on the report, has been provided by the client and is presented for informational purposes only. Guideline values listed on this report are provided for ease of use (informational purposes) only. Eurofins recommends consulting the official provincial or federal guideline as required. Unless otherwise stated, measurement uncertainty is not taken into account when determining guideline or regulatory exceedances.

Client: Paterson Group  
 154 Colonnade Rd. South  
 Nepean, ON  
 K2E 7T7  
 Attention: Mr. Kirby Magee-Dittburner  
 PO#: 33729  
 Invoice to: Paterson Group

Report Number: 1971215  
 Date Submitted: 2022-02-04  
 Date Reported: 2022-02-10  
 Project: PH4407  
 COC #: 885852

| Group             | Analyte             | MRL    | Units  | Guideline | 1608980<br>GW<br>2022-02-03<br>GW1 | 1608981<br>GW<br>2022-02-03<br>GW2 |
|-------------------|---------------------|--------|--------|-----------|------------------------------------|------------------------------------|
| Anions            | Cl                  | 1      | mg/L   | AO 250    | 97                                 | 96                                 |
|                   | F                   | 0.10   | mg/L   | MAC 1.5   | 0.16                               | 0.15                               |
|                   | N-NO2               | 0.10   | mg/L   | MAC 1.0   | <0.10                              | <0.10                              |
|                   | N-NO3               | 0.10   | mg/L   | MAC 10.0  | <0.10                              | <0.10                              |
|                   | SO4                 | 1      | mg/L   | AO 500    | 70                                 | 70                                 |
| General Chemistry | Alkalinity as CaCO3 | 5      | mg/L   | OG 30-500 | 246                                | 244                                |
|                   | Colour (Apparent)   | 2      | TCU    | AO 5      | 67*                                | 28*                                |
|                   | Conductivity        | 5      | uS/cm  |           | 848                                | 840                                |
|                   | DOC                 | 0.5    | mg/L   | AO 5      | 2.4                                | 2.5                                |
|                   | pH                  | 1.00   |        | 6.5-8.5   | 8.02                               | 8.07                               |
|                   | Phenols             | 0.001  | mg/L   |           | <0.001                             | <0.001                             |
|                   | S2-                 | 0.02   | mg/L   | AO 0.05   |                                    | <0.02                              |
|                   |                     | 0.05   | mg/L   | AO 0.05   | <0.05                              |                                    |
| TDS (COND - CALC) | 1                   | mg/L   | AO 500 | 551*      | 546*                               |                                    |
| Turbidity         | 0.1                 | NTU    | AO 5   | 4.9       | 2.2                                |                                    |
| Hardness          | Hardness as CaCO3   | 1      | mg/L   | OG 80-100 | 384*                               | 380*                               |
| Indices/Calc      | Ion Balance         | 0.01   |        |           | 0.98                               | 0.98                               |
| Metals            | Ag                  | 0.0001 | mg/L   |           | <0.0001                            | <0.0001                            |
|                   | Al                  | 0.01   | mg/L   | OG 0.1    | <0.01                              | <0.01                              |
|                   | As                  | 0.001  | mg/L   | IMAC 0.01 | <0.001                             | <0.001                             |
|                   | B                   | 0.01   | mg/L   | IMAC 5.0  | 0.02                               | 0.02                               |
|                   | Ba                  | 0.01   | mg/L   | MAC 1.0   | 0.40                               | 0.40                               |
|                   | Be                  | 0.0005 | mg/L   |           | <0.0005                            | <0.0005                            |
|                   | Ca                  | 1      | mg/L   |           | 101                                | 101                                |
|                   | Cd                  | 0.0001 | mg/L   | MAC 0.005 | <0.0001                            | <0.0001                            |

Guideline = ODWSOG

\* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range



Client: Paterson Group  
 154 Colonnade Rd. South  
 Nepean, ON  
 K2E 7T7  
 Attention: Mr. Kirby Magee-Dittburner  
 PO#: 33729  
 Invoice to: Paterson Group

Report Number: 1971215  
 Date Submitted: 2022-02-04  
 Date Reported: 2022-02-10  
 Project: PH4407  
 COC #: 885852

| Group           | Analyte                 | MRL    | Units    | Guideline  | Lab I.D.      | 1608980    | 1608981    |
|-----------------|-------------------------|--------|----------|------------|---------------|------------|------------|
|                 |                         |        |          |            | Sample Matrix | GW         | GW         |
|                 |                         |        |          |            | Sample Type   | 2022-02-03 | 2022-02-03 |
|                 |                         |        |          |            | Sampling Date | GW1        | GW2        |
|                 |                         |        |          |            | Sample I.D.   |            |            |
| Metals          | Co                      | 0.0002 | mg/L     |            |               | <0.0002    | <0.0002    |
|                 | Cr                      | 0.001  | mg/L     | MAC 0.05   |               | <0.001     | <0.001     |
|                 | Cu                      | 0.001  | mg/L     | AO 1       |               | 0.008      | 0.003      |
|                 | Fe                      | 0.03   | mg/L     | AO 0.3     |               | 0.58*      | 0.46*      |
|                 | Hg                      | 0.0001 | mg/L     | MAC 0.001  |               | <0.0001    | <0.0001    |
|                 | K                       | 1      | mg/L     |            |               | 2          | 2          |
|                 | Mg                      | 1      | mg/L     |            |               | 32         | 31         |
|                 | Mn                      | 0.01   | mg/L     | AO 0.05    |               | 0.03       | 0.03       |
|                 | Mo                      | 0.005  | mg/L     |            |               | <0.005     | <0.005     |
|                 | Na                      | 1      | mg/L     | AO 200     |               | 28         | 28         |
|                 | Ni                      | 0.005  | mg/L     |            |               | <0.005     | <0.005     |
|                 | Pb                      | 0.001  | mg/L     | MAC 0.010  |               | <0.001     | <0.001     |
|                 | Sb                      | 0.0005 | mg/L     | IMAC 0.006 |               | <0.0005    | <0.0005    |
|                 | Se                      | 0.001  | mg/L     | MAC 0.05   |               | <0.001     | <0.001     |
|                 | Sr                      | 0.001  | mg/L     |            |               | 0.306      | 0.293      |
|                 | Tl                      | 0.0001 | mg/L     |            |               | <0.0001    | <0.0001    |
|                 | U                       | 0.001  | mg/L     | MAC 0.02   |               | <0.001     | <0.001     |
|                 | V                       | 0.001  | mg/L     |            |               | <0.001     | <0.001     |
| Zn              | 0.01                    | mg/L   | AO 5     |            | <0.01         | <0.01      |            |
| Microbiology    | Escherichia Coli        | 0      | ct/100mL | MAC 0      |               | 0          | 0          |
|                 | Total Coliforms         | 0      | ct/100mL | MAC 0      |               | 0          | 0          |
| Nutrients       | N-NH3                   | 0.010  | mg/L     |            |               | <0.010     | <0.010     |
|                 | Total Kjeldahl Nitrogen | 0.100  | mg/L     |            |               | 0.210      | 0.402      |
| Subcontract     | Tannin & Lignin         | 0.1    | mg/L     |            |               | 0.9        | 0.9        |
| VOCs Surrogates | 1,2-dichloroethane-d4   | 0      | %        |            |               | 110        | 120        |

Guideline = ODWSOG

\* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Paterson Group  
 154 Colonnade Rd. South  
 Nepean, ON  
 K2E 7T7  
 Attention: Mr. Kirby Magee-Dittburner  
 PO#: 33729  
 Invoice to: Paterson Group

Report Number: 1971215  
 Date Submitted: 2022-02-04  
 Date Reported: 2022-02-10  
 Project: PH4407  
 COC #: 885852

| Group                | Analyte                           | MRL  | Units | Guideline | 1608980<br>GW<br>2022-02-03<br>GW1 | 1608981<br>GW<br>2022-02-03<br>GW2 |
|----------------------|-----------------------------------|------|-------|-----------|------------------------------------|------------------------------------|
| VOCs Surrogates      | 4-bromofluorobenzene              | 0    | %     |           | 82                                 | 73                                 |
|                      | Toluene-d8                        | 0    | %     |           | 119                                | 103                                |
| Volatiles            | 1,1,1,2-tetrachloroethane         | 0.5  | ug/L  |           | <0.5                               | <0.5                               |
|                      | 1,1,1-trichloroethane             | 0.4  | ug/L  |           | <0.4                               | <0.4                               |
|                      | 1,1,2,2-tetrachloroethane         | 0.5  | ug/L  |           | <0.5                               | <0.5                               |
|                      | 1,1,2-trichloroethane             | 0.4  | ug/L  |           | <0.4                               | <0.4                               |
|                      | 1,1-dichloroethane                | 0.4  | ug/L  |           | <0.4                               | <0.4                               |
|                      | 1,1-dichloroethylene              | 0.5  | ug/L  | MAC 14    | <0.5                               | <0.5                               |
|                      | 1,2-dichlorobenzene               | 0.4  | ug/L  | MAC 200   | <0.4                               | <0.4                               |
|                      | 1,2-dichloroethane                | 0.2  | ug/L  | IMAC 5    | <0.2                               | <0.2                               |
|                      | 1,2-dichloropropane               | 0.5  | ug/L  |           | <0.5                               | <0.5                               |
|                      | 1,3,5-trimethylbenzene            | 0.3  | ug/L  |           | <0.3                               | <0.3                               |
|                      | 1,3-dichlorobenzene               | 0.4  | ug/L  |           | <0.4                               | <0.4                               |
|                      | 1,3-Dichloropropylene (cis+trans) | 0.3  | ug/L  |           | <0.3                               | <0.3                               |
|                      | 1,4-dichlorobenzene               | 0.4  | ug/L  | MAC 5     | <0.4                               | <0.4                               |
|                      | Acetone                           | 30   | ug/L  |           | <30                                | <30                                |
|                      | Benzene                           | 0.5  | ug/L  | MAC 1     | <0.5                               | <0.5                               |
|                      | Bromodichloromethane              | 0.3  | ug/L  |           | <0.3                               | <0.3                               |
|                      | Bromoform                         | 0.4  | ug/L  |           | <0.4                               | <0.4                               |
|                      | Bromomethane                      | 0.5  | ug/L  |           | <0.5                               | <0.5                               |
|                      | c-1,2-Dichloroethylene            | 0.4  | ug/L  |           | <0.4                               | <0.4                               |
|                      | c-1,3-Dichloropropylene           | 0.2  | ug/L  |           | <0.2                               | <0.2                               |
| Carbon Tetrachloride | 0.2                               | ug/L | MAC 2 | <0.2      | <0.2                               |                                    |
| Chloroethane         | 0.2                               | ug/L |       | <0.2      | <0.2                               |                                    |
| Chloroform           | 0.5                               | ug/L |       | <0.5      | <0.5                               |                                    |

Guideline = ODWSOG

\* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

**Certificate of Analysis**

Client: Paterson Group  
 154 Colonnade Rd. South  
 Nepean, ON  
 K2E 7T7  
 Attention: Mr. Kirby Magee-Dittburner  
 PO#: 33729  
 Invoice to: Paterson Group

Report Number: 1971215  
 Date Submitted: 2022-02-04  
 Date Reported: 2022-02-10  
 Project: PH4407  
 COC #: 885852

| Group         | Analyte                        | MRL  | Units  | Guideline | Lab I.D.      | 1608980    | 1608981    |
|---------------|--------------------------------|------|--------|-----------|---------------|------------|------------|
|               |                                |      |        |           | Sample Matrix | GW         | GW         |
|               |                                |      |        |           | Sample Type   | 2022-02-03 | 2022-02-03 |
|               |                                |      |        |           | Sampling Date | GW1        | GW2        |
|               |                                |      |        |           | Sample I.D.   |            |            |
| Volatiles     | Dibromochloromethane           | 0.3  | ug/L   |           |               | <0.3       | <0.3       |
|               | Dichlorodifluoromethane        | 0.5  | ug/L   |           |               | <0.5       | <0.5       |
|               | Dichloromethane                | 4.0  | ug/L   | MAC 50    |               | <4.0       | <4.0       |
|               | Ethylbenzene                   | 0.5  | ug/L   | MAC 140   |               | <0.5       | <0.5       |
|               | Ethylene Dibromide             | 0.2  | ug/L   |           |               | <0.2       | <0.2       |
|               | Hexane                         | 5    | ug/L   |           |               | <5         | <5         |
|               | m/p-xylene                     | 0.4  | ug/L   |           |               | <0.4       | <0.4       |
|               | Methyl Ethyl Ketone (MEK)      | 10   | ug/L   |           |               | <10        | <10        |
|               | Methyl Isobutyl Ketone (MIBK)  | 10   | ug/L   |           |               | <10        | <10        |
|               | Methyl Tert Butyl Ether (MTBE) | 2    | ug/L   | AO 15     |               | <2         | <2         |
|               | Monochlorobenzene              | 0.5  | ug/L   | MAC 80    |               | <0.5       | <0.5       |
|               | o-xylene                       | 0.4  | ug/L   |           |               | <0.4       | <0.4       |
|               | Styrene                        | 0.5  | ug/L   |           |               | <0.5       | <0.5       |
|               | t-1,2-Dichloroethylene         | 0.4  | ug/L   |           |               | <0.4       | <0.4       |
|               | t-1,3-Dichloropropylene        | 0.2  | ug/L   |           |               | <0.2       | <0.2       |
|               | Tetrachloroethylene            | 0.3  | ug/L   | MAC 10    |               | <0.3       | <0.3       |
|               | Toluene                        | 0.4  | ug/L   | MAC 60    |               | <0.4       | <0.4       |
|               | Trichloroethylene              | 0.3  | ug/L   | MAC 5     |               | <0.3       | <0.3       |
|               | Trichlorofluoromethane         | 0.5  | ug/L   |           |               | <0.5       | <0.5       |
|               | Vinyl Chloride                 | 0.2  | ug/L   | MAC 1     |               | <0.2       | <0.2       |
| Xylene; total | 0.5                            | ug/L | MAC 90 |           | <0.5          | <0.5       |            |

Guideline = ODWSOG

\* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Paterson Group  
 154 Colonnade Rd. South  
 Nepean, ON  
 K2E 7T7  
 Attention: Mr. Kirby Magee-Dittburner  
 PO#: 33729  
 Invoice to: Paterson Group

Report Number: 1971215  
 Date Submitted: 2022-02-04  
 Date Reported: 2022-02-10  
 Project: PH4407  
 COC #: 885852

**QC Summary**

| Analyte   | Blank       | QC % Rec | QC Limits |
|---|-------------|----------|-----------|
| <b>Run No</b> 416630 <b>Analysis/Extraction Date</b> 2022-02-05 <b>Analyst</b> DRA<br><b>Method</b> AMBCOLM1      |             |          |           |
| Escherichia Coli  |             |          |           |
| Total Coliforms   |             |          |           |
| <b>Run No</b> 416636 <b>Analysis/Extraction Date</b> 2022-02-04 <b>Analyst</b> AaN<br><b>Method</b> C SM2130B     |             |          |           |
| Turbidity   | <0.1 NTU    | 99       | 70-130    |
| <b>Run No</b> 416668 <b>Analysis/Extraction Date</b> 2022-02-07 <b>Analyst</b> AsA<br><b>Method</b> C SM2120C     |             |          |           |
| Colour (Apparent)   | <2 TCU      | 109      | 90-110    |
| <b>Run No</b> 416675 <b>Analysis/Extraction Date</b> 2022-02-07 <b>Analyst</b> SKH<br><b>Method</b> EPA 350.1     |             |          |           |
| N-NH3   | <0.010 mg/L | 104      | 80-120    |
| <b>Run No</b> 416691 <b>Analysis/Extraction Date</b> 2022-02-07 <b>Analyst</b> SKH<br><b>Method</b> EPA 351.2     |             |          |           |
| Total Kjeldahl Nitrogen   | <0.100 mg/L | 98       | 70-130    |
| <b>Run No</b> 416692 <b>Analysis/Extraction Date</b> 2022-02-07 <b>Analyst</b> AsA<br><b>Method</b> C SM4500-S2-D |             |          |           |
| S2-   | <0.01 mg/L  | 92       | 80-120    |

**Guideline = ODWSOG**

**\* = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range



Client: Paterson Group  
 154 Colonnade Rd. South  
 Nepean, ON  
 K2E 7T7  
 Attention: Mr. Kirby Magee-Dittburner  
 PO#: 33729  
 Invoice to: Paterson Group

Report Number: 1971215  
 Date Submitted: 2022-02-04  
 Date Reported: 2022-02-10  
 Project: PH4407  
 COC #: 885852

**QC Summary**

| Analyte   | Blank      | QC % Rec | QC Limits |
|---|------------|----------|-----------|
| <b>Run No</b> 416703 <b>Analysis/Extraction Date</b> 2022-02-07 <b>Analyst</b> Z S<br><b>Method</b> M SM3120B-3500C     |            |          |           |
| Calcium   | <1 mg/L    | 99       | 90-110    |
| Potassium   | <1 mg/L    | 90       | 87-113    |
| Magnesium   | <1 mg/L    | 98       | 76-124    |
| Sodium  | <1 mg/L    | 97       | 82-118    |
| <b>Run No</b> 416719 <b>Analysis/Extraction Date</b> 2022-02-08 <b>Analyst</b> AaN<br><b>Method</b> SM 4110             |            |          |           |
| Chloride  | <1 mg/L    | 100      | 90-110    |
| N-NO2   | <0.10 mg/L | 101      | 90-110    |
| N-NO3   | <0.10 mg/L | 105      | 90-110    |
| SO4   | <1 mg/L    | 105      | 90-110    |
| <b>Run No</b> 416755 <b>Analysis/Extraction Date</b> 2022-02-07 <b>Analyst</b> AsA<br><b>Method</b> SM2320,2510,4500H/F |            |          |           |
| Alkalinity (CaCO3)  | <5 mg/L    | 104      | 90-110    |
| Conductivity  | <5 uS/cm   | 100      | 90-110    |
| F   | <0.10 mg/L | 105      | 90-110    |
| pH  |            | 99       | 90-110    |

**Guideline = ODWSOG**

**\* = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Paterson Group  
 154 Colonnade Rd. South  
 Nepean, ON  
 K2E 7T7  
 Attention: Mr. Kirby Magee-Dittburner  
 PO#: 33729  
 Invoice to: Paterson Group

Report Number: 1971215  
 Date Submitted: 2022-02-04  
 Date Reported: 2022-02-10  
 Project: PH4407  
 COC #: 885852

**QC Summary**

| Analyte   | Blank     | QC % Rec | QC Limits |
|---|-----------|----------|-----------|
| <b>Run No</b> 416780 <b>Analysis/Extraction Date</b> 2022-02-08 <b>Analyst</b> YH<br><b>Method</b> EPA 8260 |           |          |           |
| Tetrachloroethane, 1,1,1,2-   | <0.5 ug/L | 86       | 60-130    |
| Trichloroethane, 1,1,1-   | <0.4 ug/L | 94       | 60-130    |
| Tetrachloroethane, 1,1,2,2-   | <0.5 ug/L | 100      | 60-130    |
| Trichloroethane, 1,1,2-   | <0.4 ug/L | 105      | 60-130    |
| Dichloroethane, 1,1-  | <0.4 ug/L | 91       | 60-130    |
| Dichloroethylene, 1,1-  | <0.5 ug/L | 93       | 60-130    |
| Dichlorobenzene, 1,2-   | <0.4 ug/L | 82       | 60-130    |
| Dichloroethane, 1,2-  | <0.2 ug/L | 97       | 60-130    |
| Dichloropropane, 1,2-   | <0.5 ug/L | 88       | 60-130    |
| 1,3,5-trimethylbenzene  | <0.3 ug/L | 85       | 60-130    |
| Dichlorobenzene, 1,3-   | <0.4 ug/L | 90       | 60-130    |
| Dichloropropene, 1,3-   | <0.3 ug/L |          |           |
| Dichlorobenzene, 1,4-   | <0.4 ug/L | 85       | 60-130    |
| Acetone   | <30 ug/L  |          | 60-130    |
| Benzene   | <0.5 ug/L | 88       | 60-130    |
| Bromodichloromethane  | <0.3 ug/L | 92       | 60-130    |

**Guideline = ODWSOG**

**\* = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Paterson Group  
 154 Colonnade Rd. South  
 Nepean, ON  
 K2E 7T7  
 Attention: Mr. Kirby Magee-Dittburner  
 PO#: 33729  
 Invoice to: Paterson Group

Report Number: 1971215  
 Date Submitted: 2022-02-04  
 Date Reported: 2022-02-10  
 Project: PH4407  
 COC #: 885852

**QC Summary**

| Analyte                        | Blank     | QC % Rec | QC Limits |
|--------------------------------|-----------|----------|-----------|
| Bromoform                      | <0.4 ug/L | 101      | 60-130    |
| Bromomethane                   | <0.5 ug/L | 91       | 60-130    |
| Dichloroethylene, 1,2-cis-     | <0.4 ug/L | 87       | 60-130    |
| Dichloropropene, 1,3-cis-      | <0.2 ug/L | 81       | 60-130    |
| Carbon Tetrachloride           | <0.2 ug/L | 90       | 60-130    |
| Chloroethane                   | <0.2 ug/L | 92       | 60-130    |
| Chloroform                     | <0.5 ug/L | 90       | 60-130    |
| Dibromochloromethane           | <0.3 ug/L | 103      | 60-130    |
| Dichlorodifluoromethane        | <0.5 ug/L | 89       | 60-130    |
| Methylene Chloride             | <4.0 ug/L | 117      | 60-130    |
| Ethylbenzene                   | <0.5 ug/L | 82       | 60-130    |
| Ethylene dibromide             | <0.2 ug/L | 100      | 60-130    |
| Hexane (n)                     | <5 ug/L   | 90       | 60-130    |
| m/p-xylene                     | <0.4 ug/L | 84       | 60-130    |
| Methyl Ethyl Ketone            | <10 ug/L  | 100      | 60-130    |
| Methyl Isobutyl Ketone         | <10 ug/L  |          | 60-130    |
| Methyl tert-Butyl Ether (MTBE) | <2 ug/L   | 80       | 60-130    |
| Chlorobenzene                  | <0.5 ug/L | 99       | 60-130    |

**Guideline = ODWSOG**

**\* = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Paterson Group  
 154 Colonnade Rd. South  
 Nepean, ON  
 K2E 7T7  
 Attention: Mr. Kirby Magee-Dittburner  
 PO#: 33729  
 Invoice to: Paterson Group

Report Number: 1971215  
 Date Submitted: 2022-02-04  
 Date Reported: 2022-02-10  
 Project: PH4407  
 COC #: 885852

**QC Summary**

| Analyte   | Blank       | QC % Rec | QC Limits |
|---|-------------|----------|-----------|
| o-xylene  | <0.4 ug/L   | 91       | 60-130    |
| Styrene   | <0.5 ug/L   | 87       | 60-130    |
| Dichloroethylene, 1,2-trans-  | <0.4 ug/L   | 85       | 60-130    |
| Dichloropropene, 1,3-trans-   | <0.2 ug/L   | 84       | 60-130    |
| Tetrachloroethylene   | <0.3 ug/L   | 81       | 60-130    |
| Toluene   | <0.4 ug/L   | 88       | 60-130    |
| Trichloroethylene   | <0.3 ug/L   | 88       | 60-130    |
| Trichlorofluoromethane  | <0.5 ug/L   | 92       | 60-130    |
| Vinyl Chloride  | <0.2 ug/L   | 89       | 60-130    |
| <b>Run No</b> 416789 <b>Analysis/Extraction Date</b> 2022-02-08 <b>Analyst</b> YH<br><b>Method</b> EPA 8260         |             |          |           |
| Xylene Mixture  |             |          |           |
| <b>Run No</b> 416791 <b>Analysis/Extraction Date</b> 2022-02-08 <b>Analyst</b> IP<br><b>Method</b> SM5530D/EPA420.2 |             |          |           |
| Phenols   | <0.001 mg/L | 57       | 50-120    |
| <b>Run No</b> 416797 <b>Analysis/Extraction Date</b> 2022-02-08 <b>Analyst</b> AET<br><b>Method</b> C SM2340B       |             |          |           |
| Hardness as CaCO <sub>3</sub>   |             |          |           |
| Ion Balance   |             |          |           |

**Guideline = ODWSOG**

**\* = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range



**Certificate of Analysis**

Client: Paterson Group  
 154 Colonnade Rd. South  
 Nepean, ON  
 K2E 7T7  
 Attention: Mr. Kirby Magee-Dittburner  
 PO#: 33729  
 Invoice to: Paterson Group

Report Number: 1971215  
 Date Submitted: 2022-02-04  
 Date Reported: 2022-02-10  
 Project: PH4407  
 COC #: 885852

**QC Summary**

| Analyte  | Blank        | QC % Rec | QC Limits |
|--|--------------|----------|-----------|
| TDS (COND - CALC)  |              |          |           |
| <b>Run No</b> 416800 <b>Analysis/Extraction Date</b> 2022-02-08 <b>Analyst</b> AsA<br><b>Method</b> SM 5310B |              |          |           |
| DOC  | <0.5 mg/L    | 92       | 80-120    |
| <b>Run No</b> 416836 <b>Analysis/Extraction Date</b> 2022-02-08 <b>Analyst</b> SD<br><b>Method</b> EPA 200.8 |              |          |           |
| Silver   | <0.0001 mg/L | 102      | 80-120    |
| Aluminum   | <0.01 mg/L   | 115      | 80-120    |
| Arsenic  | <0.001 mg/L  | 101      | 80-120    |
| Boron (total)  | <0.01 mg/L   | 116      | 80-120    |
| Barium   | <0.01 mg/L   | 95       | 80-120    |
| Beryllium  | <0.0005 mg/L | 114      | 80-120    |
| Cadmium  | <0.0001 mg/L | 99       | 80-120    |
| Cobalt   | <0.0002 mg/L | 111      | 80-120    |
| Chromium Total   | <0.001 mg/L  | 110      | 80-120    |
| Copper   | <0.001 mg/L  | 115      | 80-120    |
| Iron   | <0.03 mg/L   | 112      | 80-120    |
| Manganese  | <0.01 mg/L   | 106      | 80-120    |

**Guideline = ODWSOG**

**\* = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

**Certificate of Analysis**

Client: Paterson Group  
 154 Colonnade Rd. South  
 Nepean, ON  
 K2E 7T7  
 Attention: Mr. Kirby Magee-Dittburner  
 PO#: 33729  
 Invoice to: Paterson Group

Report Number: 1971215  
 Date Submitted: 2022-02-04  
 Date Reported: 2022-02-10  
 Project: PH4407  
 COC #: 885852

**QC Summary**

| Analyte   | Blank        | QC % Rec | QC Limits |
|---|--------------|----------|-----------|
| Molybdenum  | <0.005 mg/L  | 102      | 80-120    |
| Nickel  | <0.005 mg/L  | 116      | 80-120    |
| Lead  | <0.001 mg/L  | 108      | 80-120    |
| Antimony  | <0.0005 mg/L | 111      | 80-120    |
| Selenium  | <0.001 mg/L  | 90       | 80-120    |
| Strontium   | <0.001 mg/L  | 93       | 80-120    |
| Thallium  | <0.0001 mg/L | 109      | 80-120    |
| Uranium   | <0.001 mg/L  | 112      | 80-120    |
| Vanadium  | <0.001 mg/L  | 106      | 80-120    |
| Zinc  | <0.01 mg/L   | 104      | 80-120    |
| <b>Run No</b> 416840 <b>Analysis/Extraction Date</b> 2022-02-07 <b>Analyst</b> AET<br><b>Method</b> SUBCONTRACT-A |              |          |           |
| Tannin & Lignin   | <0.10 mg/L   | 108      |           |
| <b>Run No</b> 416883 <b>Analysis/Extraction Date</b> 2022-02-09 <b>Analyst</b> SD<br><b>Method</b> EPA 200.8      |              |          |           |
| Mercury   | <0.0001 mg/L | 119      | 80-120    |

**Guideline = ODWSOG**

**\* = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

**Certificate of Analysis**

Client: Paterson Group  
154 Colonnade Rd. South  
Nepean, ON  
K2E 7T7  
Attention: Mr. Kirby Magee-Dittburner  
PO#: 33729  
Invoice to: Paterson Group

Report Number: 1971215  
Date Submitted: 2022-02-04  
Date Reported: 2022-02-10  
Project: PH4407  
COC #: 885852

---

***Sample Comment Summary***

|                    |     |  |
|--------------------|-----|--|
| Sample ID: 1608980 | GW1 | S2- MRL elevated due to matrix interference (dilution was done). |
| Sample ID: 1608981 | GW2 | S2- MRL elevated due to matrix interference (dilution was done). |

**Guideline = ODWSOG**

**\* = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.  
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

DATUM Geodetic






FILE NO. **PG6052**

REMARKS

HOLE NO. **TP 1-21**

BORINGS BY Backhoe

DATE December 17, 2021

| SOIL DESCRIPTION  | STRATA PLOT   | SAMPLE |        |            |                | DEPTH (m) | ELEV. (m) | Pen. Resist. Blows/0.3m<br>● 50 mm Dia. Cone |    |    |    | Piezometer Construction |   |
|---|---|--------|--------|------------|----------------|-----------|-----------|--|----|----|----|-------------------------|---|
|   |   | TYPE   | NUMBER | RECOVERY % | N VALUE or RQD |           |           | 20   | 40 | 60 | 80 |                         |   |
| <b>GROUND SURFACE</b>   |   |        |        |            |                | 0         | 100.05    |  |    |    |    |                         |   |
| Asphaltic concrete  |    |        |        |            |                |           |           |  |    |    |    |                         |   |
| <b>FILL:</b> Brown silty sand with gravel and crushed stone                         |    | G      | 1      |            |                |           |           |  |    |    |    |                         |   |
| Compact, brown <b>SILTY SAND</b>  |   | G      | 2      |            |                | 1         | 99.05     |  |    |    |    |                         | ▽ |
| Very stiff to stiff, grey <b>SILTY CLAY</b><br>- silt content increasing with depth |  | G      | 3      |            |                | 2         | 98.05     |  |    |    |    |                         | ▲ |
| Stiff, grey <b>CLAYEY SILT</b>  |  | G      | 4      |            |                | 3         | 97.05     |  |    |    |    |                         |   |
| End of Test Pit<br>(Groundwater infiltration at 1.0m depth)                         |   |        |        |            |                |           |           |  |    |    |    |                         |   |

20 40 60 80 100  
**Shear Strength (kPa)**  
▲ Undisturbed    △ Remoulded






DATUM Geodetic

REMARKS

BORINGS BY Backhoe

DATE December 17, 2021

FILE NO.  
**PG6052**HOLE NO.  
**TP 2-21**

| SOIL DESCRIPTION  | STRATA PLOT   | SAMPLE |        |            |                | DEPTH (m) | ELEV. (m) | Pen. Resist. Blows/0.3m<br>● 50 mm Dia. Cone |    |    |    | Piezometer Construction |  |   |
|---|---|--------|--------|------------|----------------|-----------|-----------|--|----|----|----|-------------------------|--|---|
|   |   | TYPE   | NUMBER | RECOVERY % | N VALUE or RQD |           |           | 20   | 40 | 60 | 80 |                         |  |   |
| <b>GROUND SURFACE</b>   |   |        |        |            |                | 0         | 100.06    |  |    |    |    |                         |  |   |
| <b>FILL:</b> Crushed stone with sand                            |  |        |        |            |                |           |           |  |    |    |    |                         |  | ▽ |
| <b>FILL:</b> Brown silty sand with gravel<br>0.47               |  | G      | 1      |            |                |           |           |  |    |    |    |                         |  | ▽ |
| Very stiff to stiff, grey <b>SILTY CLAY</b><br>0.65             |  | G      | 2      |            |                |           |           |  |    |    |    |                         |  | ▲ |
| 0.92  |   |        |        |            |                |           |           |  |    |    |    |                         |  |   |
| End of Test Pit<br><br>(Groundwater infiltration at 0.4m depth) |   |        |        |            |                |           |           |  |    |    |    |                         |  |   |

20 40 60 80 100  
**Shear Strength (kPa)**  
▲ Undisturbed    △ Remoulded

DATUM Geodetic


REMARKS

BORINGS BY Backhoe

DATE December 17, 2021

FILE NO. **PG6052**

HOLE NO. **TP 3-21**

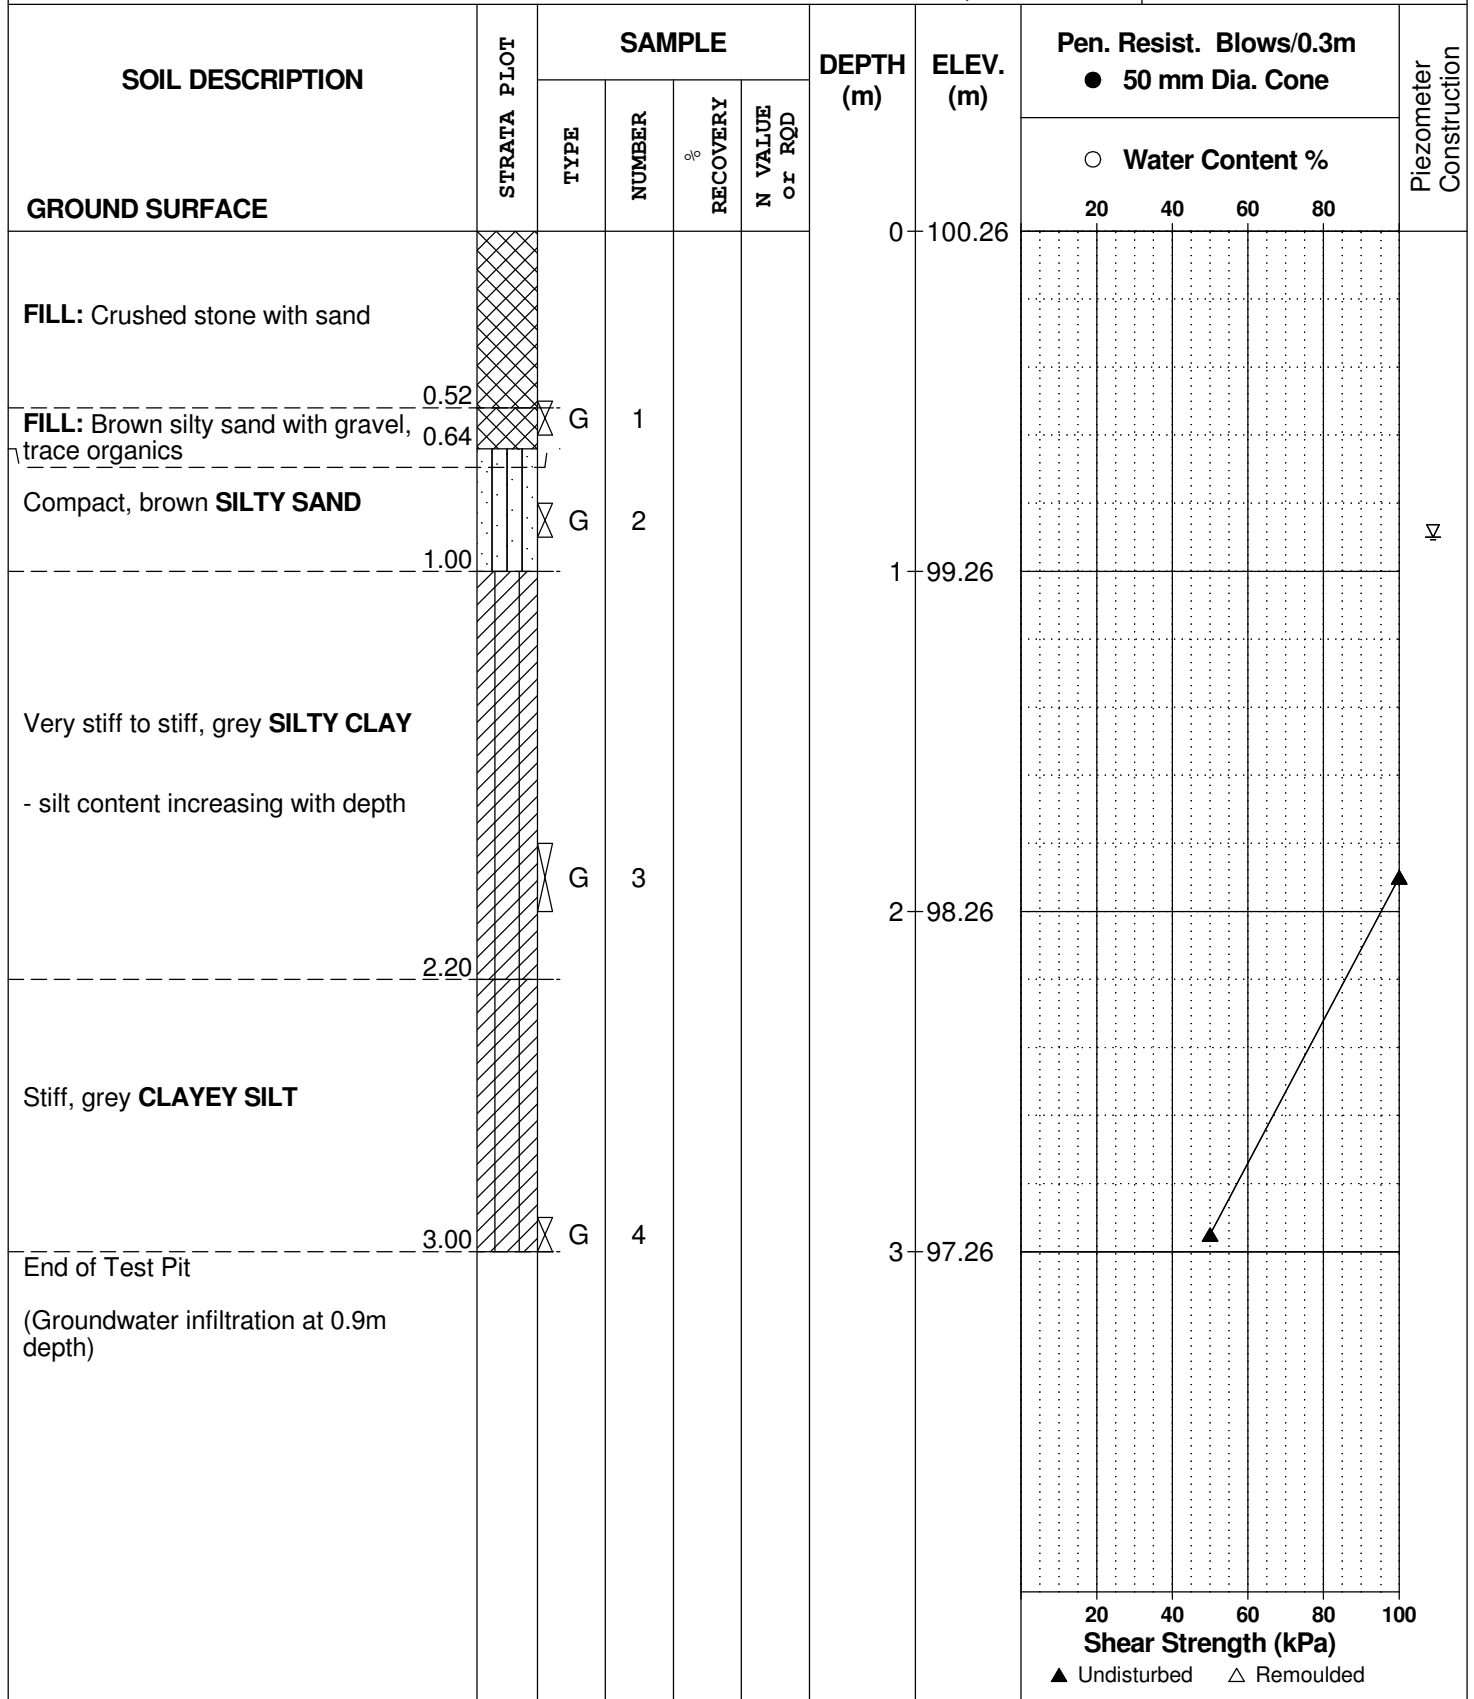

DATUM Geodetic

FILE NO. **PG6052**

REMARKS

HOLE NO. **TP 4-21**

BORINGS BY Backhoe

DATE December 17, 2021

| SOIL DESCRIPTION  | STRATA PLOT              | SAMPLE |        |          |                | DEPTH (m) | ELEV. (m) | Pen. Resist. Blows/0.3m<br>● 50 mm Dia. Cone |    |    |    | Piezometer Construction |
|---|--------------------------|--------|--------|----------|----------------|-----------|-----------|--|----|----|----|-------------------------|
|   |                          | TYPE   | NUMBER | RECOVERY | N VALUE or RQD |           |           | ○ Water Content %                            |    |    |    |                         |
| GROUND SURFACE  |                          |        |        |          |                | 0         | 100.14    | 20   | 40 | 60 | 80 |                         |
| FILL: Crushed stone with sand                                   | [Cross-hatched pattern]  |        |        |          |                |           |           |  |    |    |    |                         |
| 0.40  |                          |        |        |          |                |           |           |  |    |    |    |                         |
| FILL: Brown silty sand with gravel                              | [Cross-hatched pattern]  | G      | 1      |          |                |           |           |  |    |    |    | ▽                       |
| 0.82  |                          |        |        |          |                |           |           |  |    |    |    |                         |
| Compact, brown <b>SILTY SAND</b>                                | [Vertical lines pattern] | G      | 2      |          |                |           |           |  |    |    |    |                         |
| 1.00  |                          |        |        |          |                |           |           |  |    |    |    |                         |
| Very stiff, grey <b>SILTY CLAY</b>                              | [Diagonal lines pattern] | G      | 3      |          |                | 1         | 99.14     |  |    |    |    | ▲                       |
| 1.20  |                          |        |        |          |                |           |           |  |    |    |    |                         |
| End of Test Pit<br><br>(Groundwater infiltration at 0.6m depth) |                          |        |        |          |                |           |           |  |    |    |    |                         |
|   |                          |        |        |          |                |           |           | 20   | 40 | 60 | 80 | 100                     |
|   |                          |        |        |          |                |           |           | <b>Shear Strength (kPa)</b>                  |    |    |    |                         |
|   |                          |        |        |          |                |           |           | ▲ Undisturbed    △ Remoulded                 |    |    |    |                         |

## SYMBOLS AND TERMS

### SOIL DESCRIPTION

Behavioural properties, such as structure and strength, take precedence over particle gradation in describing soils. Terminology describing soil structure are as follows:

|                  |   |  |
|------------------|---|--|
| Desiccated       | - | having visible signs of weathering by oxidation of clay minerals, shrinkage cracks, etc.                                   |
| Fissured         | - | having cracks, and hence a blocky structure.   |
| Varved           | - | composed of regular alternating layers of silt and clay.   |
| Stratified       | - | composed of alternating layers of different soil types, e.g. silt and sand or silt and clay.                               |
| Well-Graded      | - | Having wide range in grain sizes and substantial amounts of all intermediate particle sizes (see Grain Size Distribution). |
| Uniformly-Graded | - | Predominantly of one grain size (see Grain Size Distribution).   |

The standard terminology to describe the strength of cohesionless soils is the relative density, usually inferred from the results of the Standard Penetration Test (SPT) 'N' value. The SPT N value is the number of blows of a 63.5 kg hammer, falling 760 mm, required to drive a 51 mm O.D. split spoon sampler 300 mm into the soil after an initial penetration of 150 mm.

| Relative Density | 'N' Value | Relative Density % |
|------------------|-----------|--------------------|
| Very Loose       | <4        | <15                |
| Loose            | 4-10      | 15-35              |
| Compact          | 10-30     | 35-65              |
| Dense            | 30-50     | 65-85              |
| Very Dense       | >50       | >85                |

The standard terminology to describe the strength of cohesive soils is the consistency, which is based on the undisturbed undrained shear strength as measured by the in situ or laboratory vane tests, penetrometer tests, unconfined compression tests, or occasionally by Standard Penetration Tests.

| Consistency | Undrained Shear Strength (kPa) | 'N' Value |
|-------------|--------------------------------|-----------|
| Very Soft   | <12                            | <2        |
| Soft        | 12-25                          | 2-4       |
| Firm        | 25-50                          | 4-8       |
| Stiff       | 50-100                         | 8-15      |
| Very Stiff  | 100-200                        | 15-30     |
| Hard        | >200                           | >30       |

## SYMBOLS AND TERMS (continued)

### SOIL DESCRIPTION (continued)

Cohesive soils can also be classified according to their "sensitivity". The sensitivity is the ratio between the undisturbed undrained shear strength and the remoulded undrained shear strength of the soil.

Terminology used for describing soil strata based upon texture, or the proportion of individual particle sizes present is provided on the Textural Soil Classification Chart at the end of this information package.

### ROCK DESCRIPTION

The structural description of the bedrock mass is based on the Rock Quality Designation (RQD).

The RQD classification is based on a modified core recovery percentage in which all pieces of sound core over 100 mm long are counted as recovery. The smaller pieces are considered to be a result of closely-spaced discontinuities (resulting from shearing, jointing, faulting, or weathering) in the rock mass and are not counted. RQD is ideally determined from NXL size core. However, it can be used on smaller core sizes, such as BX, if the bulk of the fractures caused by drilling stresses (called "mechanical breaks") are easily distinguishable from the normal in situ fractures.

| <b>RQD %</b> | <b>ROCK QUALITY</b>  |
|--------------|--|
| 90-100       | Excellent, intact, very sound                                |
| 75-90        | Good, massive, moderately jointed or sound                   |
| 50-75        | Fair, blocky and seamy, fractured                            |
| 25-50        | Poor, shattered and very seamy or blocky, severely fractured |
| 0-25         | Very poor, crushed, very severely fractured                  |

### SAMPLE TYPES

|    |   |   |
|----|---|---|
| SS | - | Split spoon sample (obtained in conjunction with the performing of the Standard Penetration Test (SPT))                         |
| TW | - | Thin wall tube or Shelby tube   |
| PS | - | Piston sample   |
| AU | - | Auger sample or bulk sample   |
| WS | - | Wash sample   |
| RC | - | Rock core sample (Core bit size AXT, BXL, etc.). Rock core samples are obtained with the use of standard diamond drilling bits. |



## SYMBOLS AND TERMS (continued)

### GRAIN SIZE DISTRIBUTION

|     |   |  |
|-----|---|--|
| MC% | - | Natural moisture content or water content of sample, %   |
| LL  | - | Liquid Limit, % (water content above which soil behaves as a liquid)   |
| PL  | - | Plastic limit, % (water content above which soil behaves plastically)  |
| PI  | - | Plasticity index, % (difference between LL and PL)   |
| Dxx | - | Grain size which xx% of the soil, by weight, is of finer grain sizes<br>These grain size descriptions are not used below 0.075 mm grain size |
| D10 | - | Grain size at which 10% of the soil is finer (effective grain size)  |
| D60 | - | Grain size at which 60% of the soil is finer   |
| Cc  | - | Concavity coefficient = $(D_{30})^2 / (D_{10} \times D_{60})$  |
| Cu  | - | Uniformity coefficient = $D_{60} / D_{10}$   |

Cc and Cu are used to assess the grading of sands and gravels:

Well-graded gravels have:  $1 < Cc < 3$  and  $Cu > 4$

Well-graded sands have:  $1 < Cc < 3$  and  $Cu > 6$

Sands and gravels not meeting the above requirements are poorly-graded or uniformly-graded.

Cc and Cu are not applicable for the description of soils with more than 10% silt and clay (more than 10% finer than 0.075 mm or the #200 sieve)

### CONSOLIDATION TEST

|            |   |  |
|------------|---|--|
| $p'_o$     | - | Present effective overburden pressure at sample depth          |
| $p'_c$     | - | Preconsolidation pressure of (maximum past pressure on) sample |
| Ccr        | - | Recompression index (in effect at pressures below $p'_c$ )     |
| Cc         | - | Compression index (in effect at pressures above $p'_c$ )       |
| OC Ratio   |   | Overconsolidation ratio = $p'_c / p'_o$                        |
| Void Ratio |   | Initial sample void ratio = volume of voids / volume of solids |
| Wo         | - | Initial water content (at start of consolidation test)         |

### PERMEABILITY TEST

|   |   |  |
|---|---|--|
| k | - | Coefficient of permeability or hydraulic conductivity is a measure of the ability of water to flow through the sample. The value of k is measured at a specified unit weight for (remoulded) cohesionless soil samples, because its value will vary with the unit weight or density of the sample during the test. |
|---|---|--|

## SYMBOLS AND TERMS (continued)

### STRATA PLOT



Topsoil



Asphalt



Fill



Peat



Sand



Silty Sand



Silt



Sandy Silt



Clay



Silty Clay



Clayey Silty Sand



Glacial Till



Shale




Bedrock

### MONITORING WELL AND PIEZOMETER CONSTRUCTION

#### MONITORING WELL CONSTRUCTION




#### PIEZOMETER CONSTRUCTION

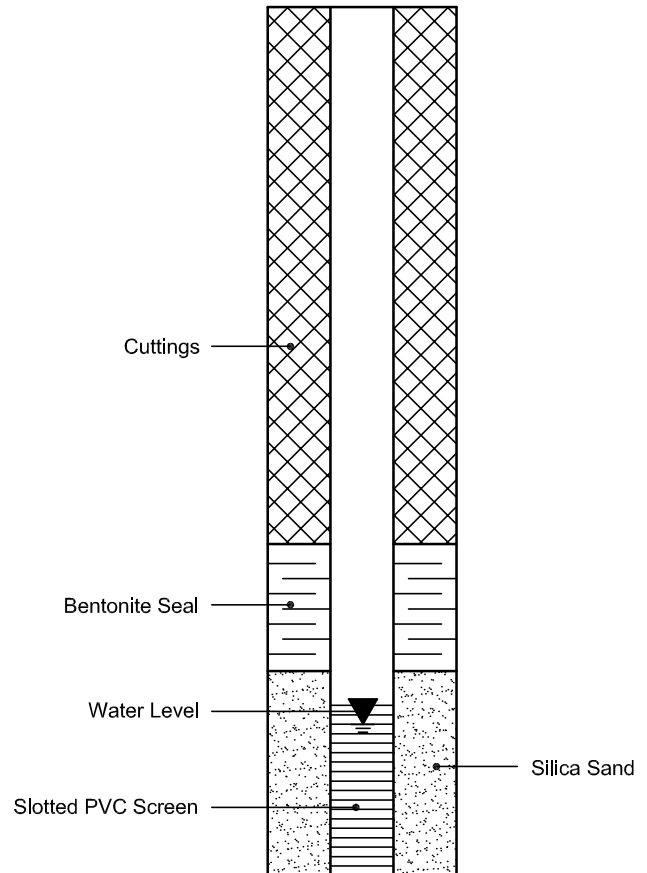


**Pumping Test Analysis Report**

|               |                               |                                       |              |
|---------------|-------------------------------|---------------------------------------|--------------|
| File No.      | PH4407                        | Well ID:                              | TW1          |
| Date:         | February 22, 2022             | Solution Method:                      | <b>Theis</b> |
| Client:       | Dymech Engineering Inc.       | Transmissivity (m <sup>2</sup> /day): | 367.2        |
| Site Address: | 1353 Coker Street, Ottawa, ON | Discharge Rate (L/min)                | 19           |
| Project:      | Site Plan Application         | Analysis performed by:                | EA           |

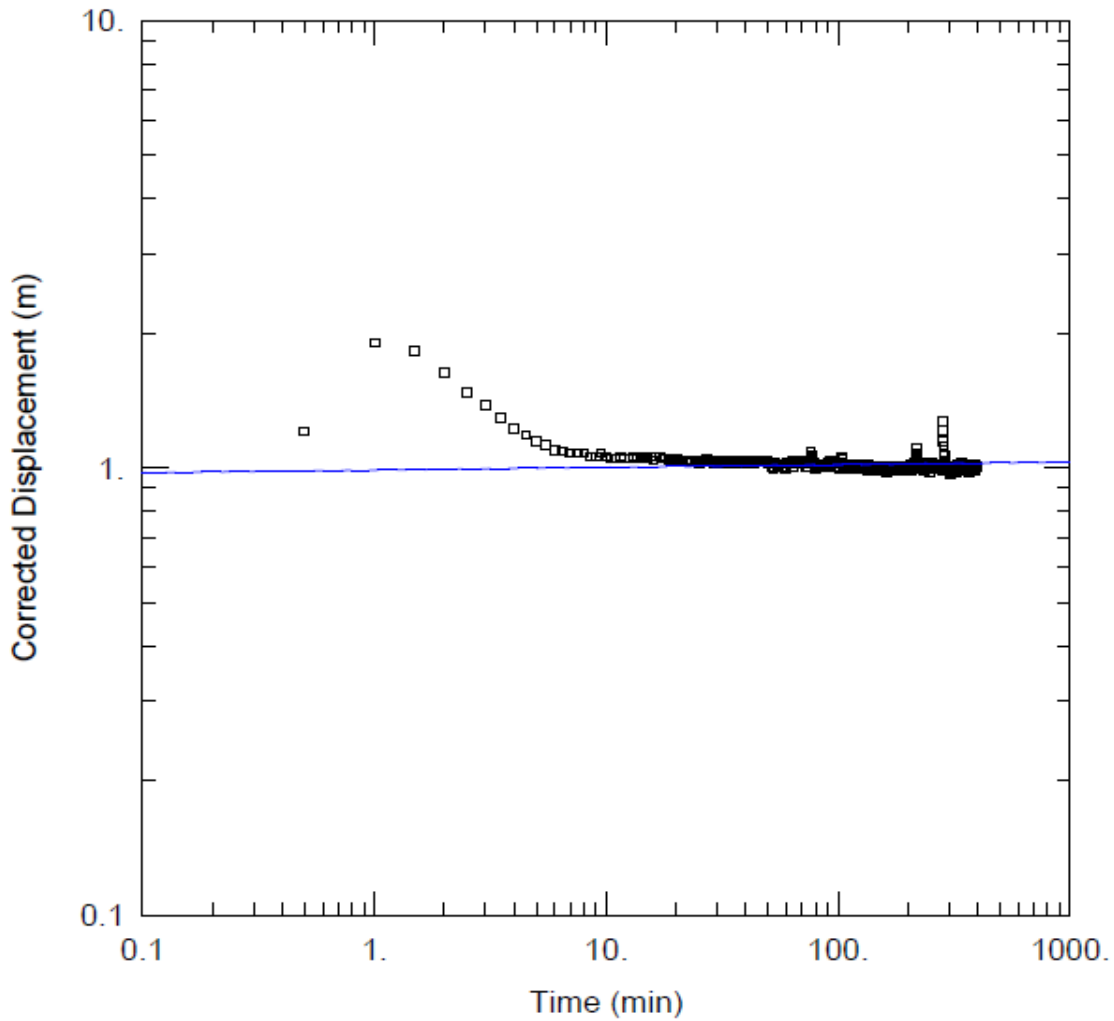

**Pumping Test Analysis Report**

|               |                               |                                       |                     |
|---------------|-------------------------------|---------------------------------------|---------------------|
| File No.      | PH4407                        | Well ID:                              | TW1                 |
| Date:         | February 22, 2022             | Solution Method:                      | <b>Cooper-Jacob</b> |
| Client:       | Dymech Engineering Inc.       | Transmissivity (m <sup>2</sup> /day): | 367.2               |
| Site Address: | 1353 Coker Street, Ottawa, ON | Discharge Rate (L/min)                | 19                  |
| Project:      | Site Plan Application         | Analysis performed by:                | EA                  |

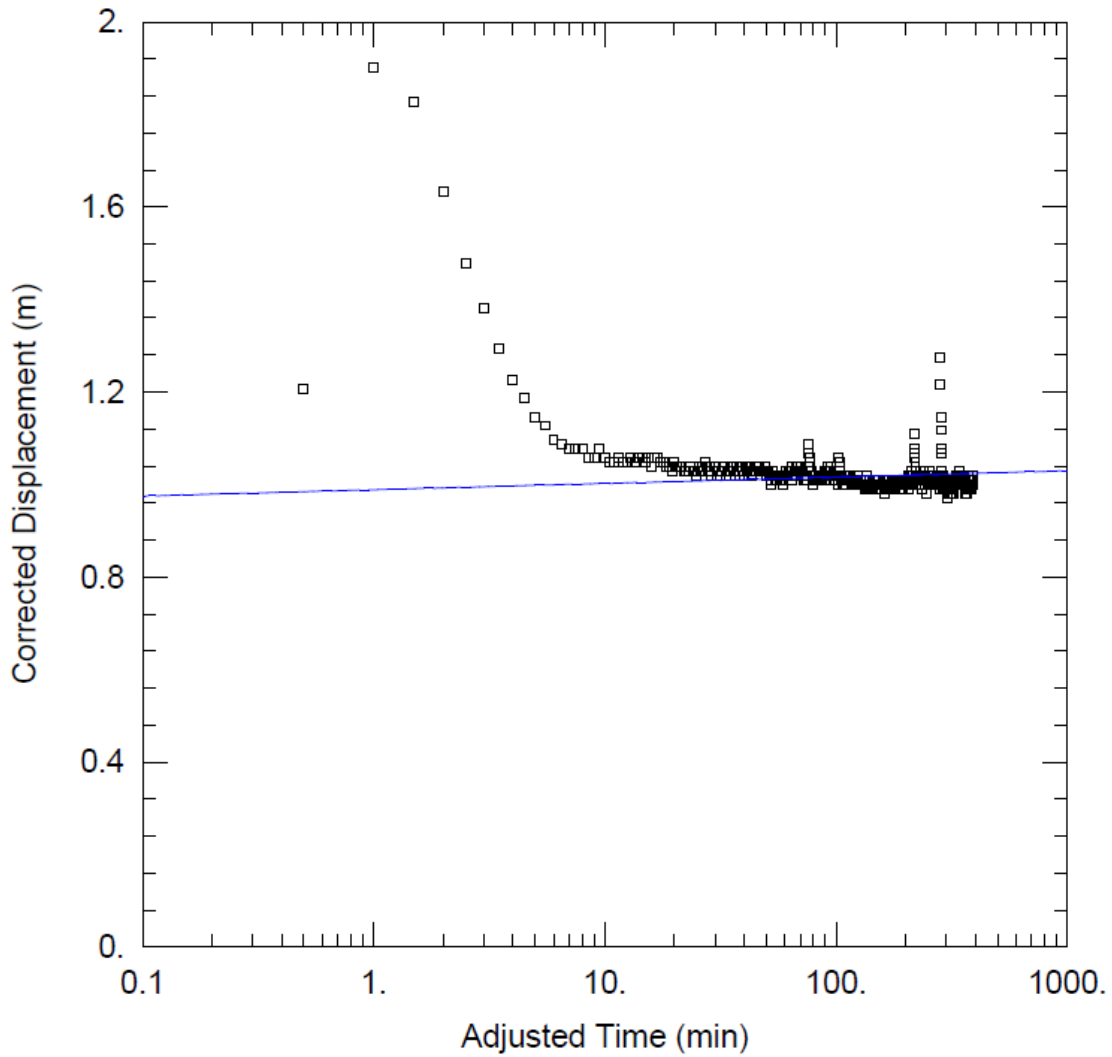

**Pumping Test Analysis Report**

File No. PH4407  
Date: February 22, 2022  
Client: Dymech Engineering Inc.  
Site Address: 1353 Coker Street, Ottawa, ON  
Project: Site Plan Application

| Summary Table:   |          |                                       |
|------------------|----------|---------------------------------------|
| Solution Method: | Well ID: | Transmissivity (m <sup>2</sup> /day): |
| Theis            | TW1      | 367.2                                 |
| Cooper-Jacob     | TW1      | 367.2                                 |
| Average:         |          | <b>367.20</b>                         |



| <b>PREDICTIVE NITRATE IMPACT ASSESSEMENT</b>   |             |                     |
|--|-------------|---------------------|
| <b>Infiltration Factors</b>  |             |                     |
| Topography   | 0.30        |                     |
| Soil   | 0.30        |                     |
| Cover  | 0.10        |                     |
| <b>Total</b>   | <b>0.70</b> |                     |
| <b>Site Characteristics</b>  |             |                     |
| Area of Site :   | 2675        | m <sup>2</sup>      |
| Total of roof areas:   | 729         | m <sup>2</sup>      |
| Total area of paved driveway areas:  | 475         | m <sup>2</sup>      |
| Roof + paved driveway areas  | 1204        | m <sup>2</sup>      |
| Impervious Area  | 1204        | m <sup>2</sup>      |
| Percent Impervious Area =  | 45          | %                   |
| Infiltration Area =  | 1471        | m <sup>2</sup>      |
| <b>Septic Effluent</b>   |             |                     |
| Concentration of Effluent (Cs) =   | 4           | mg/L                |
| Daily Sewage Flow (Qs)=  | 3.6         | m <sup>3</sup>      |
| See Notes below.   |             |                     |
| <b>Infiltration Calculation</b>  |             |                     |
| Nitrate concentration in precipitation (C <sub>i</sub> ) =   | 0           | mg/L                |
| Surplus Water (Environment Canada)   | 379         | mm/yr               |
| Factored Water Surplus =   | 265         | mm/yr               |
| Infiltration % due to stormwater management measures   | -           | %                   |
| Infiltration rate from stormwater management measures =  | 0           | mm/yr               |
| Infiltration Flow Entering the System (Q <sub>i</sub> ) =  | 1           | m <sup>3</sup> /day |
| <b>Mass Balance Model (MOEE, 1995)</b>   |             |                     |
| $C_T = (Q_b C_b + Q_e C_e + Q_i C_i) / (Q_b + Q_e + Q_i)$ = Cumulative Nitrate Concentration   |             |                     |
| Q <sub>b</sub> = flow entering the system across the upgradient area   | 0           | m <sup>3</sup> /day |
| C <sub>b</sub> = background nitrate concentration  | 0           | mg/L                |
| Q <sub>e</sub> = flow entering the system from the septic drainfield   | 3.6         | m <sup>3</sup> /day |
| C <sub>e</sub> = concentration of nitrates in the septic effluent  | 4           | mg/L                |
| Q <sub>i</sub> = flow entering the system from infiltration  | 1           | m <sup>3</sup> /day |
| C <sub>i</sub> = Concentration of nitrates in the infiltrate   | 0           | mg/L                |
| <b>C<sub>T</sub> =</b>   | <b>3.08</b> | <b>mg/L</b>         |
| Estimate Number of Lots  | 1           | lots                |
| <i>Notes: Site characteristic values were measured as approximate values from the available site plan. Daily Sewage Flow volume was calculated by Paterson Group as a preliminary design flow.</i> |             |                     |






DRAWING LIST:

ARCHITECTURAL

- A000 - COVER PAGE
- A002 - DRAWING LIST, LEGEND + NEW SITE PLAN + ZONING COMPLIANCE + O.B.C. MATRIX
- A050 - EXCAVATION PLAN + NOTES
- A100 - NEW FLOOR PLAN + NOTES
- A200 - EXTERIOR ELEVATIONS + NOTES

LEGEND:


-  NOT INCLUDED IN CONTRACT (N.I.C.)
-  EXISTING GRASS

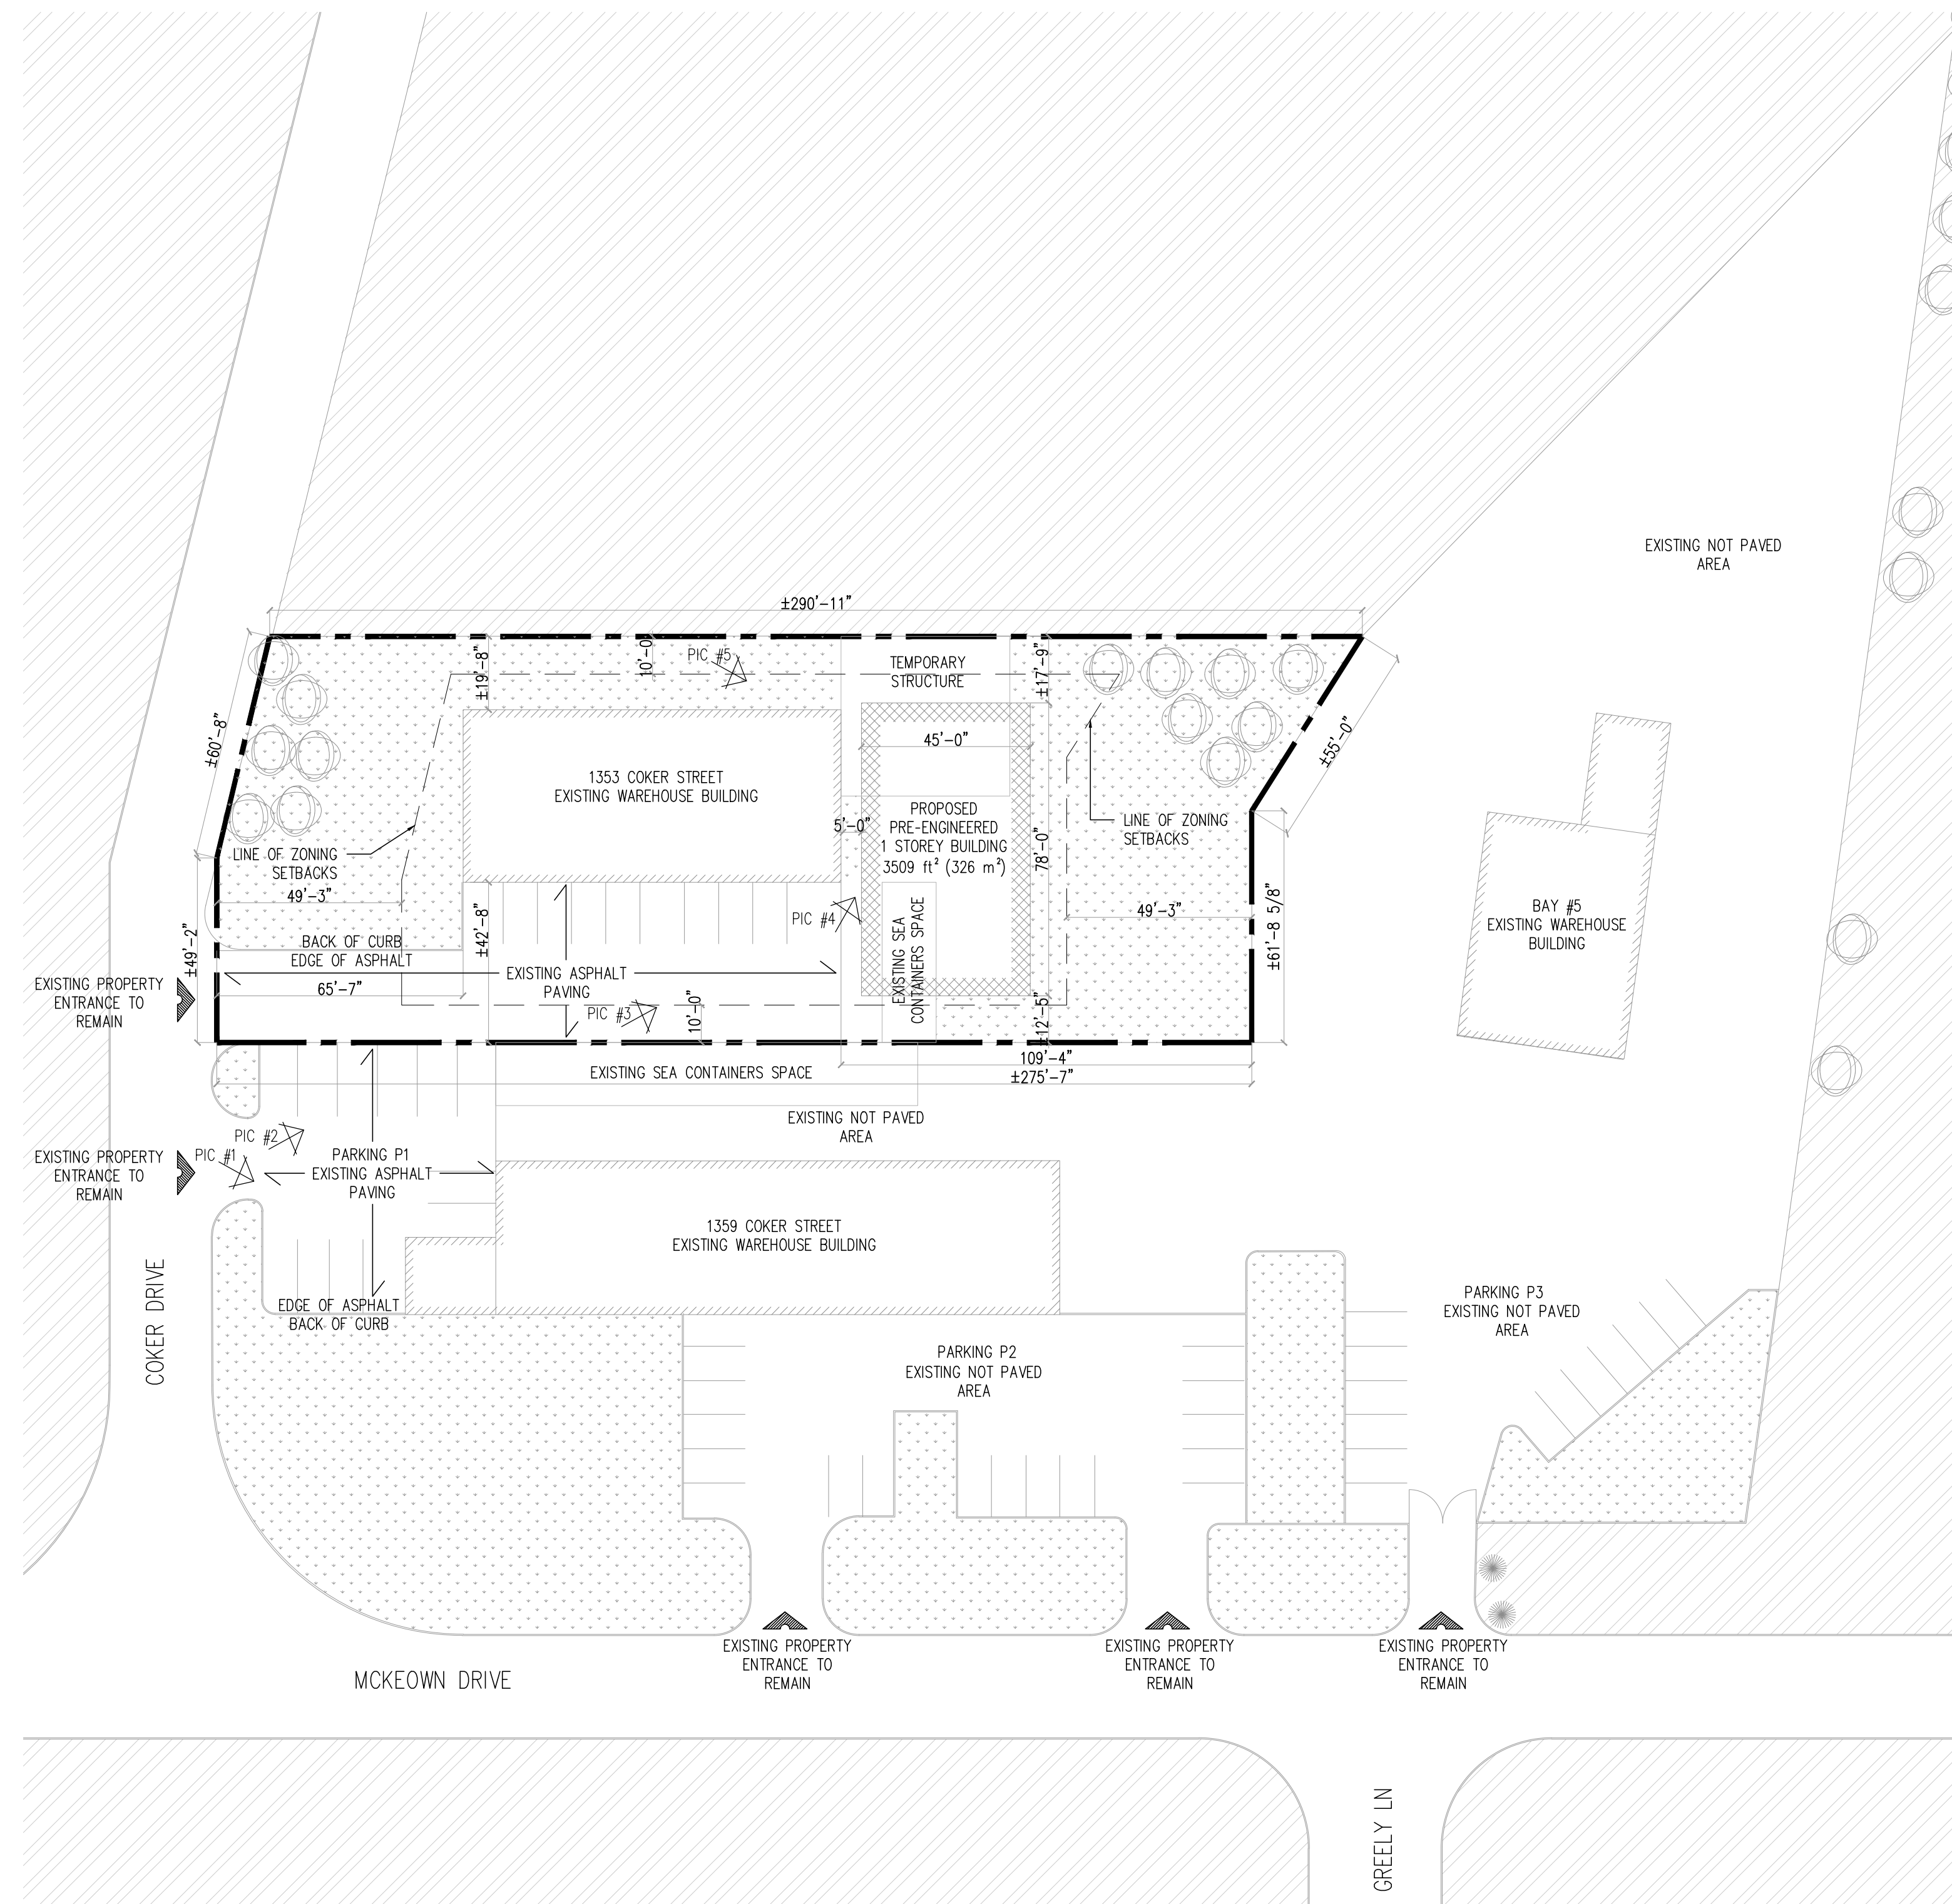

**1** NEW SITE PLAN  
A-002 1/32" = 1'-0"



PICTURE #1

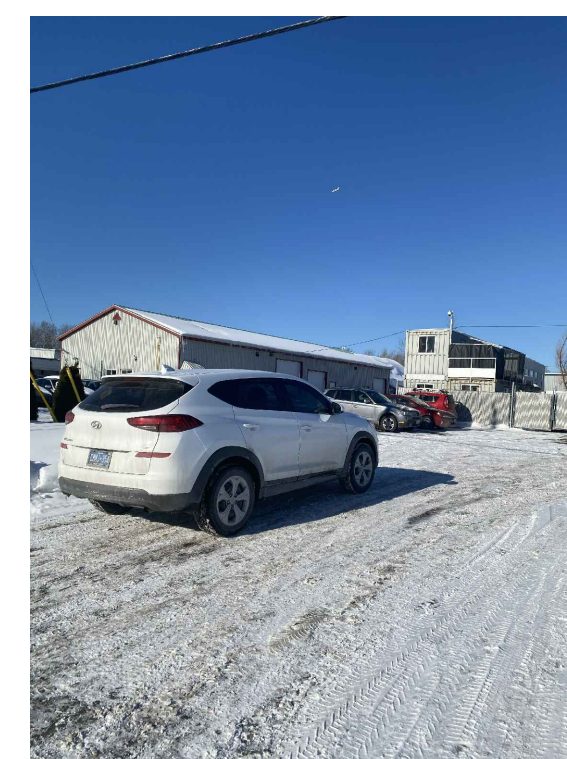

PICTURE #2



PICTURE #3



PICTURE #4



PICTURE #5

LOCATION PLAN: GROUND FLOOR




CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.

DO NOT SCALE DRAWINGS.

REVISIONS

| NO. | DESCRIPTION                 | DATE          |
|-----|-----------------------------|---------------|
| 1   | Issued for Class D estimate | Feb. 22, 2021 |
|     |                             |               |
|     |                             |               |
|     |                             |               |
|     |                             |               |
|     |                             |               |
|     |                             |               |
|     |                             |               |

|  |                   |
|--|-------------------|
| PROJECT NORTH<br> | DATE              |
|  | DRAWN<br>PB       |
|  | CHECKED<br>AB     |
|  | DATE PRINTED<br>- |

NOT TO BE USED FOR CONSTRUCTION PURPOSES UNTIL SIGNED BY THE ARCHITECT.

**DYMECH WAREHOUSE ADDITION**


ADDRESS: 1359 COKER STREET, GREELEY, ON, K4P 1A1

DRAWING TITLE

**NEW SITE PLAN + NOTES**

|                       |                              |
|-----------------------|------------------------------|
| SCALE<br>AS SHOWN     | DRAWING NO.:<br><b>A-002</b> |
| PROJECT NO.<br>059-20 |                              |



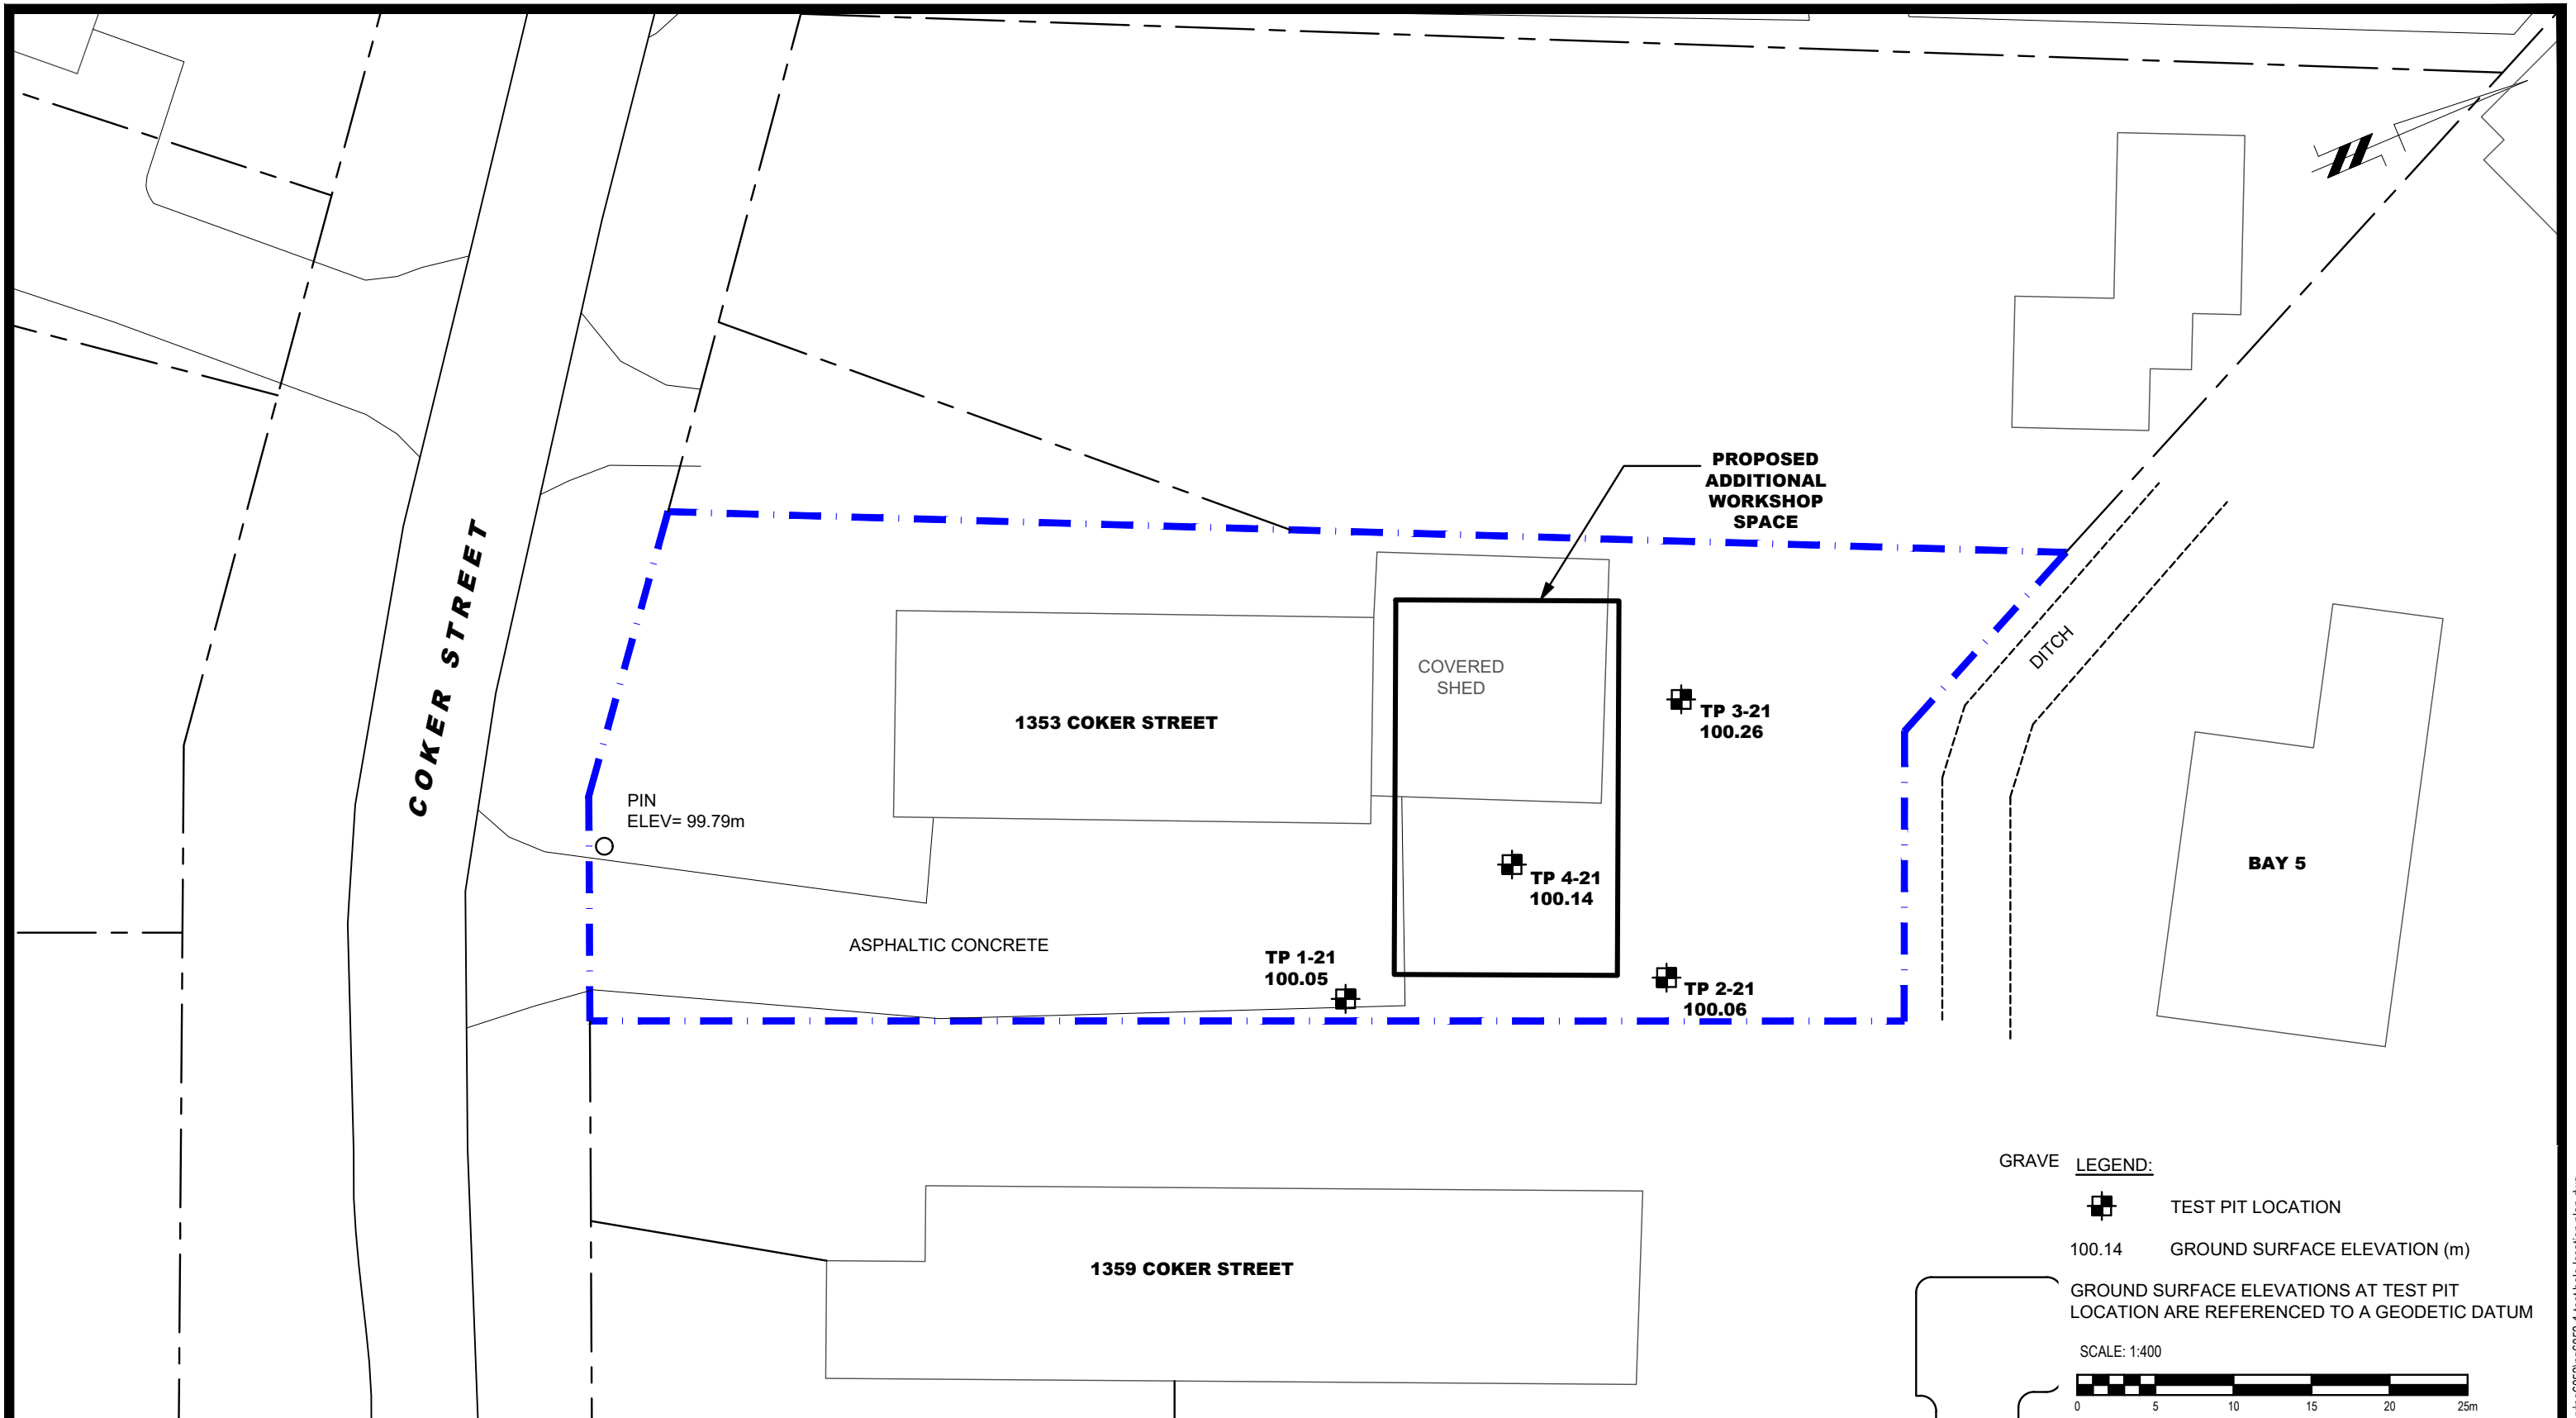

GRAVE LEGEND:  
 [Symbol] TEST PIT LOCATION  
 100.14 GROUND SURFACE ELEVATION (m)  
 GROUND SURFACE ELEVATIONS AT TEST PIT LOCATION ARE REFERENCED TO A GEODETIC DATUM  
 SCALE: 1:400  
 [Scale bar: 0, 5, 10, 15, 20, 25m]

**patersongroup**  
 consulting engineers

154 Colonnade Road South  
 Ottawa, Ontario K2E 7J5  
 Tel: (613) 226-7381 Fax: (613) 226-6344

| NO. | REVISIONS | DATE | INITIAL |
|-----|-----------|------|---------|
|     |           |      |         |
|     |           |      |         |
|     |           |      |         |

GREELY,  
 Title:


DYMECH ENGINEERING INC.  
 GEOTECHNICAL INVESTIGATION  
 PROPOSED BUILDING ADDITION  
 1353 COKER STREET

ONTARIO


**TEST HOLE LOCATION PLAN**

Scale: 1:400  
 Drawn by: YA  
 Checked by: MS  
 Approved by: DJG

Date: 01/2022  
 Report No.: PG6052-1  
 Dwg. No.: **PG6052-1**  
 Revision No.:



CONTRACTOR TO EXERCISE CAUTION DURING CONSTRUCTION NOT TO IMPACT EXISTING OVERHEAD HYDRO LINES, AND UNDERGROUND HYDRO AND GAS LINES

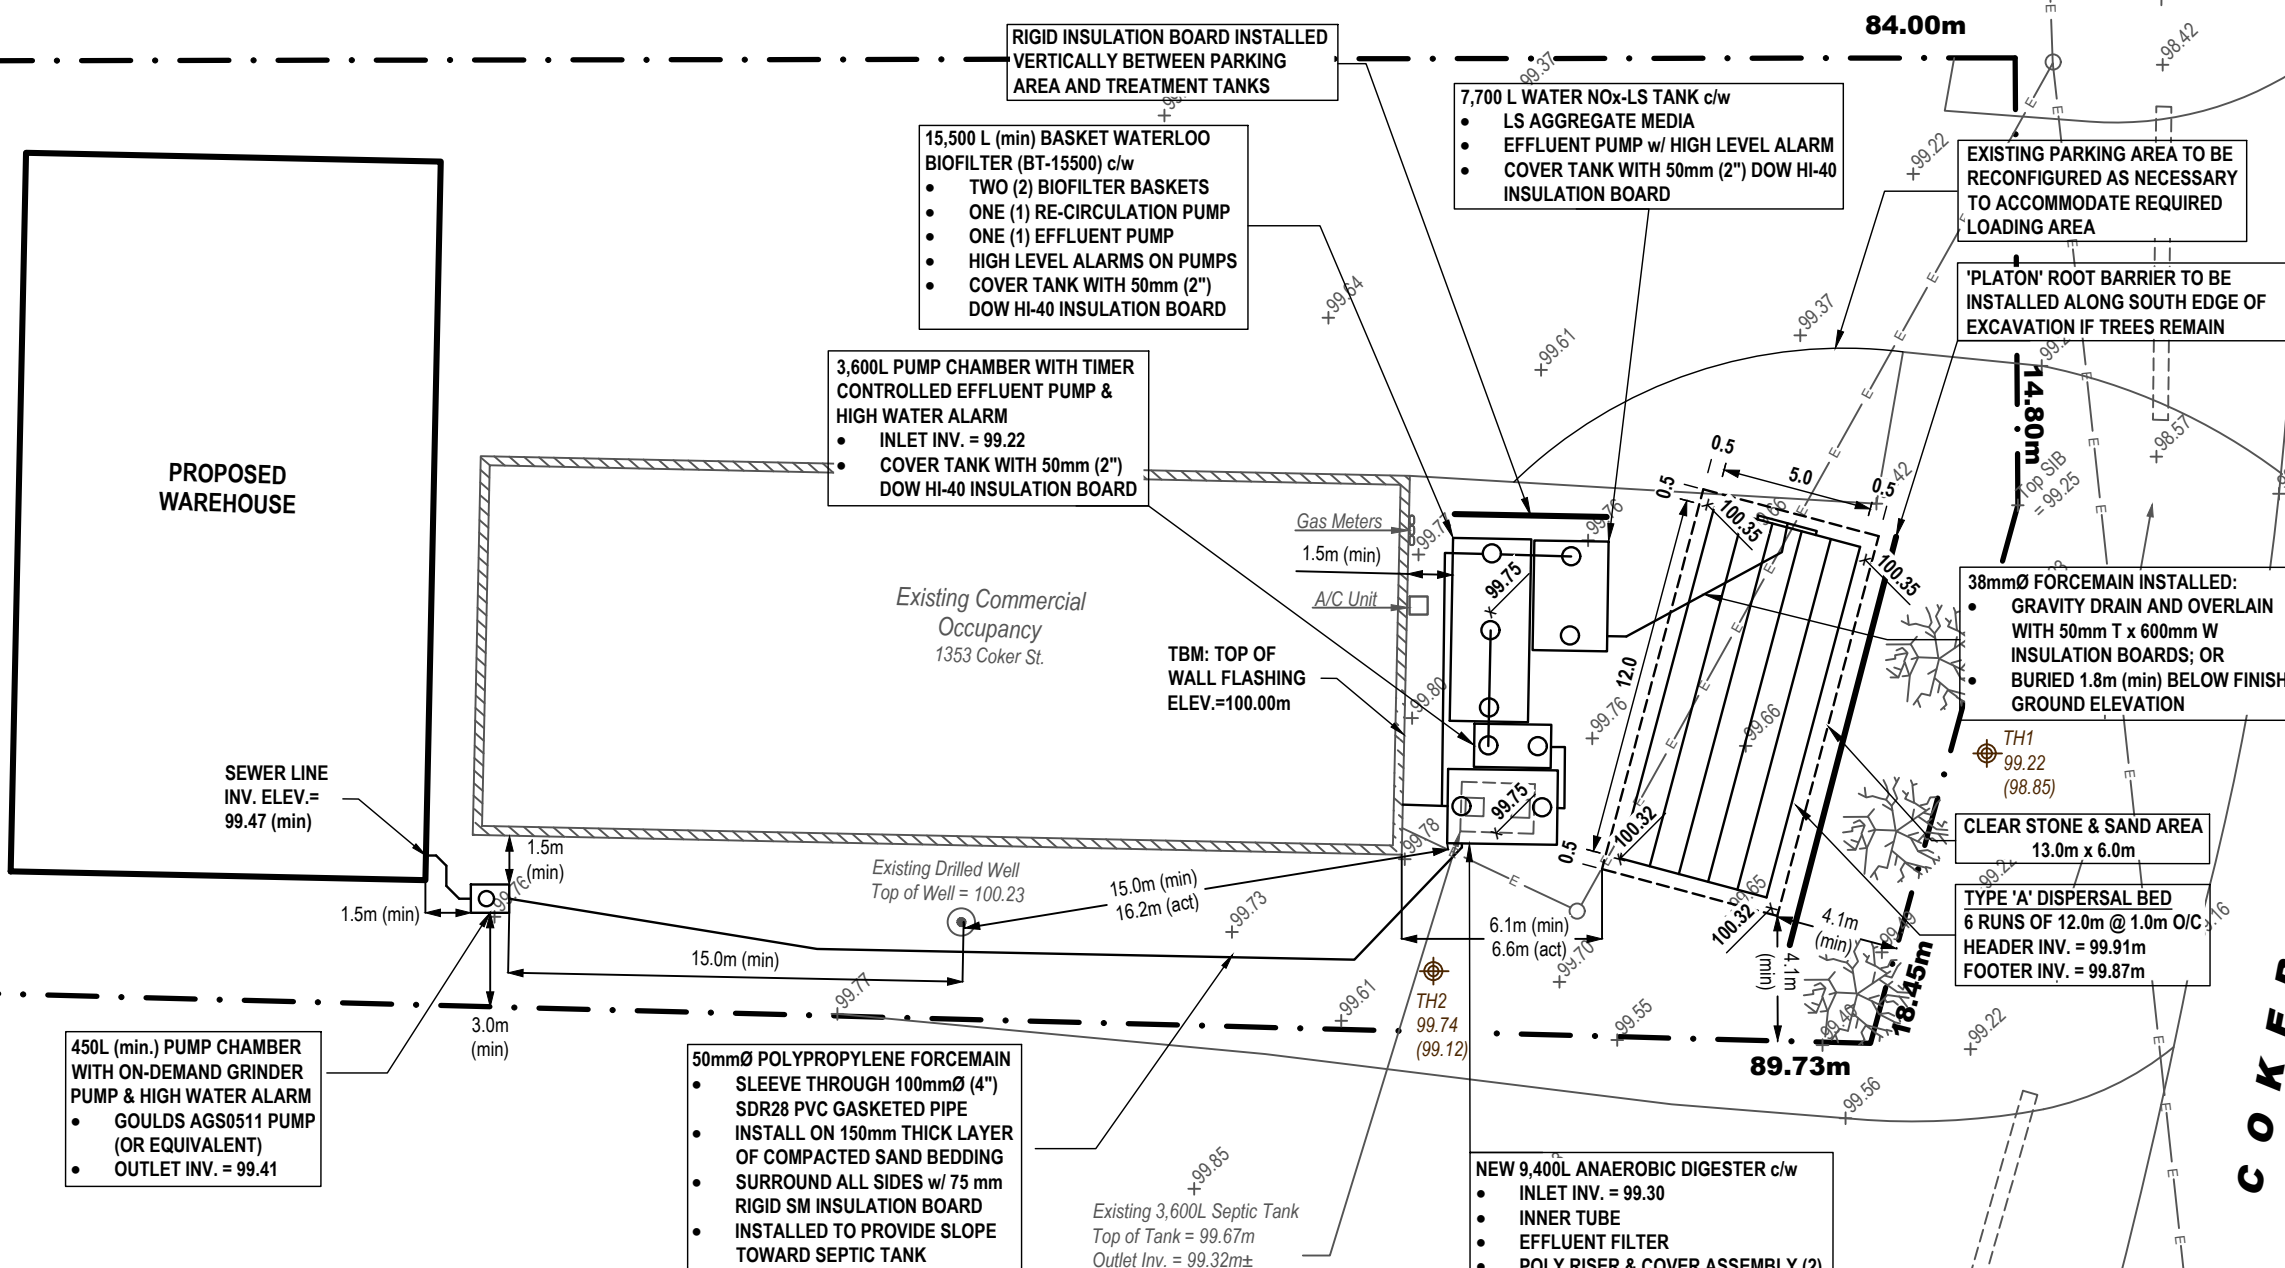

COKER STREET

| LEGEND:                                   |                                   | BENCHMARK INFORMATION:   |   |
|---|-----------------------------------|--------------------------|---|
| Test Hole Location                        | GFL                               | Garage Floor Level       | TBM: Top of Wall Flashing at Base of Metal Wall Sheeting. Elev. = 100.00m   |
| x 70.81 Existing Ground Surface Elev. (m) | USF                               | Underside of Footing     |   |
| x 72.70 Proposed Ground Surface Elev. (m) | ←                                 | Surficial Flow Direction |   |
| (70.7) Groundwater Elev. (m) - Dec.14/21  | Final Grading: 2%Min., 7% Max. or |                          | <b>REFERENCE:</b>   |
| MFL Main Floor Level                      | Terrace Grade 3H:1V Max.          |                          | Base Plan Information Obtained from GeoOttawa Imagery.  |
| BFL Basement Floor Level                  | Existing Structure                |                          | A LEGAL SURVEY DESCRIBING THE PROPERTY BOUNDARY WAS NOT AVAILABLE TO THIS FIRM AT THE TIME OF THESE WORKS. AS SUCH, PROPERTY BOUNDARIES SHOULD BE CONFIRMED PRIOR TO CONSTRUCTION |
| T/C Top of Foundation Wall                | Proposed Structure                |                          |   |

Existing Occupancy  
1341 Coker St.

**patersongroup**  
consulting engineers  
154 Colonnade Road, Ottawa, Ontario K2E 7J5

| DD/MM/YY | Description                        | Rev. |
|----------|------------------------------------|------|
| 17/02/22 | Issued for Permit Approval         | 2    |
| 11/02/22 | Revised per Treatment Requirements | 1    |
| 21/12/21 | Issued for Client Review           | 0    |


Client  
**DYMECH ENGINEERING INC.**  
1353 COKER STREET  
OTTAWA (GREELY), ONTARIO

Project  
**PROPOSED REPLACEMENT SEWAGE SYSTEM**


Drawing  
**SEWAGE SYSTEM LAYOUT PLAN**

|              |                        |             |    |
|--------------|------------------------|-------------|----|
| Scale:       | 1:250                  | Drawn by:   | AD |
| Date:        | 02/2022                | Checked by: | MK |
| Drawing no.: | <b>PH4407-1(rev.2)</b> |             |    |

p:\autocad\drawings\hydrology\ph4407\ph4407-dymech-engineering-1353 coker slph4407-1.dwg



Existing Occupancy  
1359 Coker St.

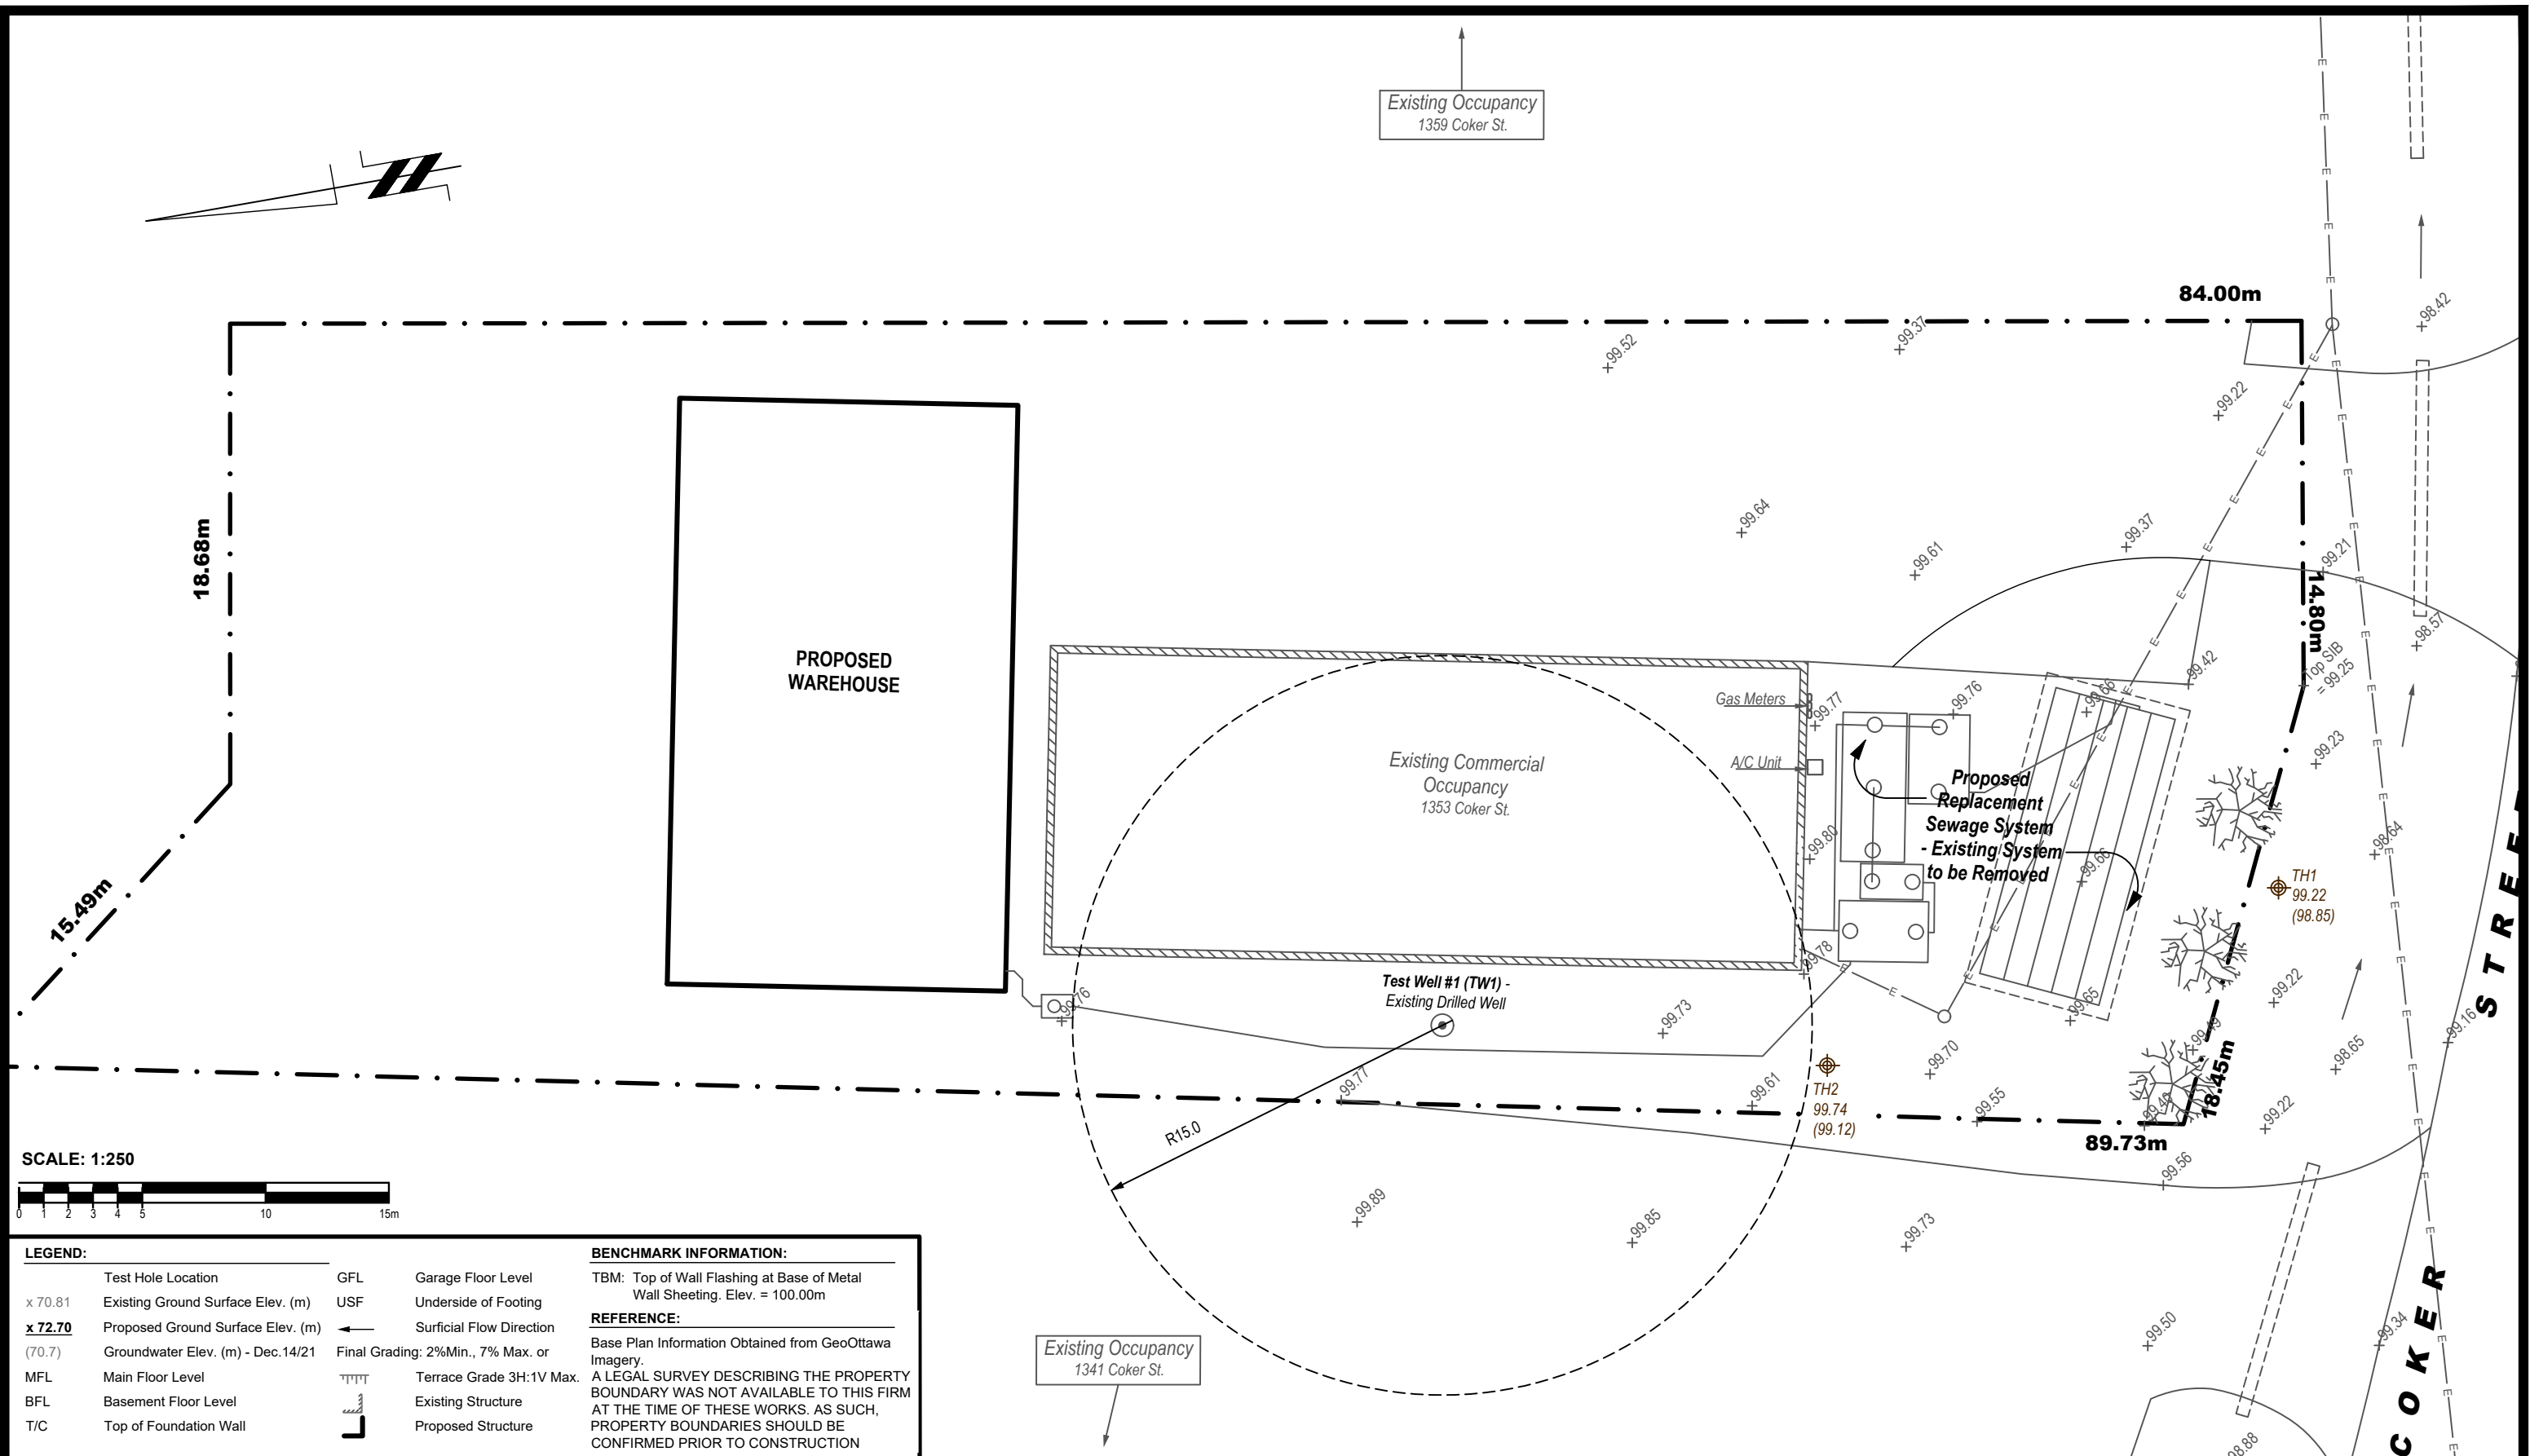

| LEGEND: |                                   | BENCHMARK INFORMATION:            |                          |
|---------|-----------------------------------|-----------------------------------|--------------------------|
| x 70.81 | Existing Ground Surface Elev. (m) | GFL                               | Garage Floor Level       |
| x 72.70 | Proposed Ground Surface Elev. (m) | USF                               | Underside of Footing     |
| (70.7)  | Groundwater Elev. (m) - Dec.14/21 | ←                                 | Surficial Flow Direction |
| MFL     | Main Floor Level                  | Final Grading: 2%Min., 7% Max. or |                          |
| BFL     | Basement Floor Level              | TTTT                              | Terrace Grade 3H:1V Max. |
| T/C     | Top of Foundation Wall            | Existing Structure                |                          |
|         |                                   | Proposed Structure                |                          |

**REFERENCE:**  
Base Plan Information Obtained from GeoOttawa Imagery.  
A LEGAL SURVEY DESCRIBING THE PROPERTY BOUNDARY WAS NOT AVAILABLE TO THIS FIRM AT THE TIME OF THESE WORKS. AS SUCH, PROPERTY BOUNDARIES SHOULD BE CONFIRMED PRIOR TO CONSTRUCTION

**patersongroup**  
consulting engineers  
154 Colonnade Road, Ottawa, Ontario K2E 7J5

| DD/MM/YY | Description             | Rev. |
|----------|-------------------------|------|
| 18/02/22 | Issued for City Comment | 0    |

Client  
**DYMECH ENGINEERING INC.**

Project  
**PROPOSED WAREHOUSE ADDITION**  
1353 COKER STREET  
OTTAWA (GREALY), ONTARIO

Drawing  
**WATER WELL LOCATION PLAN**

|              |                 |             |    |
|--------------|-----------------|-------------|----|
| Scale:       | 1:250           | Drawn by:   | AD |
| Date:        | 02/2022         | Checked by: | MK |
| Drawing no.: | <b>PH4407-3</b> |             |    |

p:\autocad\drawings\hydrogeology\p4407\p4407-1.dwg





Ottawa Septic Bureau des systèmes  
System Office septiques d'Ottawa

3889 Rideau Valley Drive Box 599 Manotick, ON K4M 1A5

Phone: 613-692-3571 **PRESS "4" for septic office** 1-800-267-3504 **OTTAWA** Fax: 613-692-1507 Email: [septic@rvca.ca](mailto:septic@rvca.ca)

SITE ADDRESS: 1353 Coker St Township OSG-HUN-GLO-FIT-CUM-NEP-GOU-RID-KAN-TOR

CONTACT: 1. Ke Peterson 2. Dymrech Eng. 3. \_\_\_\_\_

### INFORMATION FOR OWNER/APPLICANT

Attached is your Sewage System Permit. A minimum of two inspections are required before your proposed sewage system can be approved for use (additional inspections may be required for clay soils/bedrock and/or re-inspections). Inspections must be requested in writing. Please see attached:

- Inspection fax request form (all inspections MUST be requested in writing)
- As-built components and drawing form
- Copy of the approved application and schedule pages
- Approved Part 8 permit: \***Electronic copy only** – Be sure to **INCLUDE** in **Building Application Package** for **Plans Examiner at CITY of OTTAWA** client services, if **NEW** or **RENO** construction project.

#### Special Note

- A permit is **valid for 12 months** from the original date of issuance noted in "permit date". If lapsed, it **may be renewed only once** for a period of 12 months from the date of expiry.

- No person shall make a material change or cause a material change to be made to a plan, specification, document or other information on the basis of which a permit was issued without notifying, filing details with and obtaining the authorization of the Chief Building Official. (*Building Code Act 1992, c.23, s.8(12)*)

#### Sewage System Permit Construction Requirements

##### 1. Clay Soils/Bedrock only (if required per issued Approval)

In clay soils/bedrock, a site preparation inspection is required. The total contact area must be properly prepared. Scarification must be done under dry conditions prior to importing leaching bed fill.

##### 2. Installation Inspection – 2<sup>nd</sup> inspection

When the sewage system is substantially completed (i.e., before the final fill is placed over the septic tank and leaching bed system) an installation inspection is required. Prior to any inspection request, the following must be submitted:

- "as-built components" and "as-built drawings" — see attached form
- "engineer letter" — if the system is engineered
- grain size analysis and weight bills for all Filter Media types of septic systems
- Weight bills for washed septic stone, where applicable
- Maintenance/service contract for treatment unit installed

##### 3. Final Grading Inspection – 3<sup>rd</sup> inspection

When construction of the sewage system is complete, a final grading inspection is required. Before a Certificate of Completion can be issued, the following must be complete:

- The leaching bed and septic tank must be covered with sand fill and topsoil and graded accordingly
- All conditions of the Sewage System Permit & comments on the installation inspection report must be met
- The depth of cover & material type must be identified by inspection pipes or holes placed over trenches at 4 corners of bed
- The 4 corners of the bed must be staked

JULY 2020

Location: 2:Administration templates\CoverPart8page

STREET/CIVIC INITIAL   
\*\*EMAIL ONLY\*\*

SEPTIC FILE #

22-059



**RVCA RECEIVED**  
**MAR 04 2022**

**Application for a Permit to Construct or Demolish**  
This form is authorized under subsection 8(1.1) of the Building Code Act, 1992

**SEPTIC FILE #**  
**22-059**  
**OTTAWA**

|                                       |                                     |
|---------------------------------------|-------------------------------------|
| <b>For use by Principal Authority</b> |                                     |
| Application number: REFER TO: _____   | Permit number (if different): _____ |
| Date received: _____                  | Roll number: _____                  |

Application submitted to: **OTTAWA SEPTIC SYSTEM OFFICE**  
(Name of municipality, upper-tier municipality, board of health or conservation authority)

**A. Project information**

|   |                               |                                |          |
|---|-------------------------------|--------------------------------|----------|
| Building number, street name<br><b>1353 Coker St.</b> |                               | Unit number                    | Lot/con. |
| Municipality<br><b>Ottawa (Osgoode)</b>               | Postal code<br><b>K4P 1A1</b> | Plan number/other description  |          |
| Project value est. \$                                 |                               | Area of work (m <sup>2</sup> ) |          |

**B. Purpose of application**

New construction    
  Addition to an existing building    
  Alteration/repair    
  Demolition    
  Conditional Permit

|  |                         |
|--|-------------------------|
| Proposed use of building<br><b>Commercial</b>  | Current use of building |
| Description of proposed work<br><b>Construction of new sewage system to accommodate proposed construction of additional warehouse building</b> |                         |


**C. Applicant**

|   |                               |                                   |  |
|---|-------------------------------|-----------------------------------|--|
| Applicant is:                                     |                               | Owner or                          | Authorized agent of owner                                |
| Last name<br><b>Dillon</b>                        |                               | First name<br><b>Adam</b>         | Corporation or partnership<br><b>Paterson Group Inc.</b> |
| Street address<br><b>154 Colonnade Rd. S</b>      |                               | Unit number                       | Lot/con.   |
| Municipality<br><b>Ottawa (Nepean)</b>            | Postal code<br><b>K2E 7J5</b> | Province<br><b>ON</b>             | E-mail<br><b>adillon@patersongroup.ca</b>                |
| Telephone number<br><small>(613) 226-7381</small> | Fax<br><small>( )</small>     | Cell number<br><small>( )</small> |  |

**D. Owner (if different from applicant)**

|   |                               |                                   |  |
|---|-------------------------------|-----------------------------------|--|
| Last name                                   |                               | First name                        | Corporation or partnership<br><b>Dymech Engineering Inc.</b> |
| Street address<br><b>1359 Coker St.</b>     |                               | Unit number                       | Lot/con.   |
| Municipality<br><b>Ottawa (Osgoode)</b>     | Postal code<br><b>K4P 1A1</b> | Province<br><b>ON</b>             | E-mail<br><b>mmain@dymech.ca</b>                             |
| Telephone number<br><b>( 613 ) 327-4867</b> | Fax<br><small>( )</small>     | Cell number<br><small>( )</small> |  |

Application for a Permit to Construct or Demolish – Effective January 1, 2014

| E. Builder (optional)  |             | RVCA RECEIVED                              |        | 22-059                                  |  |
|--|-------------|--|--------|---|--|
| Last name  | First name  | Corporation or partnership (if applicable) |        |   |  |
| Street address   |             | REFER TO: _____                            |        | Unit number                             | Lot/con.                               |
| Municipality   | Postal code | Province                                   | E-mail |   |  |
| Telephone number<br>( )  | Fax<br>( )  | Cell number<br>( )                         |        |   |  |
| F. Tarion Warranty Corporation (Ontario New Home Warranty Program)   |             |  |        |   |  |
| i. Is proposed construction for a new home as defined in the <i>Ontario New Home Warranties Plan Act</i> ? If no, go to section G.   |             |  |        | Yes <input type="checkbox"/>            | No <input checked="" type="checkbox"/> |
| ii. Is registration required under the <i>Ontario New Home Warranties Plan Act</i> ?   |             |  |        | Yes <input type="checkbox"/>            | No <input checked="" type="checkbox"/> |
| iii. If yes to (ii) provide registration number(s): _____  |             |  |        |   |  |
| G. Required Schedules  |             |  |        |   |  |
| i) Attach Schedule 1 for each individual who reviews and takes responsibility for design activities.   |             |  |        |   |  |
| ii) Attach Schedule 2 where application is to construct on-site, install or repair a sewage system.  |             |  |        |   |  |
| H. Completeness and compliance with applicable law   |             |  |        |   |  |
| i) This application meets all the requirements of clauses 1.3.1.3 (5) (a) to (d) of Division C of the <i>Building Code</i> (the application is made in the correct form and by the owner or authorized agent, all applicable fields have been completed on the application and required schedules, and all required schedules are submitted).<br>Payment has been made of all fees that are required, under the applicable by-law, resolution or regulation made under clause 7(1)(c) of the <i>Building Code Act, 1992</i> , to be paid when the application is made. |             |  |        | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/>            |
| ii) This application is accompanied by the plans and specifications prescribed by the applicable by-law, resolution or regulation made under clause 7(1)(b) of the <i>Building Code Act, 1992</i> .  |             |  |        | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/>            |
| iii) This application is accompanied by the information and documents prescribed by the applicable by-law, resolution or regulation made under clause 7(1)(b) of the <i>Building Code Act, 1992</i> which enable the chief building official to determine whether the proposed building, construction or demolition will contravene any applicable law.  |             |  |        | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/>            |
| iv) The proposed building, construction or demolition will not contravene any applicable law.  |             |  |        | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/>            |
| I. Declaration of applicant  |             |  |        |   |  |
| <p><b>Adam Dillon - Paterson Group Inc.</b> _____ declare that:</p> <p>(print name)</p> <p>1. The information contained in this application, attached schedules, attached plans and specifications, and other attached documentation is true to the best of my knowledge.</p> <p>2. If the owner is a corporation or partnership, I have the authority to bind the corporation or partnership.</p> <p>Date <b>2/17/22</b> Signature of applicant </p>                              |             |  |        |   |  |


Personal information contained in this form and schedules is collected under the authority of subsection 8(1.1) of the *Building Code Act, 1992*, and will be used in the administration and enforcement of the *Building Code Act, 1992*. Questions about the collection of personal information may be addressed to: a) the Chief Building Official of the municipality or upper-tier municipality to which this application is being made, or, b) the inspector having the powers and duties of a chief building official in relation to sewage systems or plumbing for an upper-tier municipality, board of health or conservation authority to whom this application is made, or, c) Director, Building and Development Branch, Ministry of Municipal Affairs and Housing 777 Bay St., 2nd Floor. Toronto, M5G 2E5 (416) 585-6666.



**RVCA RECEIVED**  
**MAR 04 2022**

**Schedule 1: Designer Information**

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

|   |                               |   |                                    |                    |
|---|-------------------------------|---|------------------------------------|--------------------|
| <b>A. Project Information</b>   |                               |   |                                    | <b>SEPTIC FILE</b> |
| Building number, street name<br>1353 Coker St.  |                               | Unit no.  | Lot/con.<br>22-059                 |                    |
| Municipality<br>Ottawa (Osgoode)  | Postal code<br>K4P 1A1        | Plan number/ other description  |                                    |                    |
| <b>B. Individual who reviews and takes responsibility for design activities</b>   |                               |   |                                    | <b>OTTAWA</b>      |
| Name<br>Adam Dillon   |                               | Firm<br>Paterson Group Inc.   |                                    |                    |
| Street address<br>154 Colonnade Rd. S.  |                               | Unit no.  | Lot/con.                           |                    |
| Municipality<br>Ottawa (Nepean)   | Postal code<br>K2E 7J5        | Province<br>ON  | E-mail<br>adillon@patersongroup.ca |                    |
| Telephone number<br>( ) ( ) (613) 226-7381  | Fax number<br>( ) ( )         | Cell number<br>( ) ( )  |                                    |                    |
| <b>C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1. of Division C]</b>  |                               |   |                                    |                    |
| House   | HVAC – House                  | Building Structural   |                                    |                    |
| Small Buildings   | Building Services             | Plumbing – House  |                                    |                    |
| Large Buildings   | Detection, Lighting and Power | Plumbing – All Buildings  |                                    |                    |
| Complex Buildings   | Fire Protection               | X On-site Sewage Systems  |                                    |                    |
| Description of designer's work<br>New sewage system - Waterloo Biofilter with WaterNOx-LS System and Type 'A' Dispersal Bed   |                               |   |                                    |                    |
| <b>D. Declaration of Designer</b>   |                               |   |                                    |                    |
| I Adam Dillon - Paterson Group Inc. declare that (choose one as appropriate):   |                               |   |                                    |                    |
| (print name)  |                               |   |                                    |                    |
| I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. |                               |   |                                    |                    |
| Individual BCIN: 19879  |                               |   |                                    |                    |
| Firm BCIN: 29346  |                               |   |                                    |                    |
| I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code.  |                               |   |                                    |                    |
| Individual BCIN: _____  |                               |   |                                    |                    |
| Basis for exemption from registration: _____  |                               |   |                                    |                    |
| The design work is exempt from the registration and qualification requirements of the Building Code.  |                               |   |                                    |                    |
| Basis for exemption from registration and qualification: _____  |                               |   |                                    |                    |
| I certify that:   |                               |   |                                    |                    |
| 1. The information contained in this schedule is true to the best of my knowledge.  |                               |   |                                    |                    |
| 2. I have submitted this application with the knowledge and consent of the firm.  |                               |   |                                    |                    |
| Date 2/17/22  |                               | Signature of Designer  |                                    |                    |


**NOTE:**

1. For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) (c), of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
2. Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of practice, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.


**Schedule 2 Sewage System Installer Information**

RECEIVED  
MAR 04 2022

SEPTIC FILE

|  |                        |  |                    |
|--|------------------------|--|--------------------|
| <b>A. Project Information</b>  |                        |  |                    |
| Building number, street name<br>1353 Coker St.   |                        | Unit number  | Lot/con.<br>22-059 |
| Municipality<br>Ottawa (Osgoode)   | Postal code<br>K4P 1A1 | Plan number/ other description                                     |                    |
| <b>B. Sewage system installer</b>  |                        |  |                    |
| Is the installer of the sewage system engaged in the business of constructing on-site, installing, repairing, servicing, cleaning or emptying sewage systems, in accordance with Building Code Article 3.3.1.1, Division C?  |                        |  |                    |
| Yes (Continue to Section C)  |                        | No (Continue to Section E)   |                    |
|  |                        | X Installer unknown at time of application (Continue to Section E) |                    |
| <b>C. Registered installer information (where answer to B is "Yes")</b>  |                        |  |                    |
| Name   |                        | BCIN   |                    |
| Street address   |                        | Unit number  | Lot/con.           |
| Municipality   | Postal code            | Province   | E-mail             |
| Telephone number<br>( )  | Fax<br>( )             | Cell number<br>( )   |                    |
| <b>D. Qualified supervisor information (where answer to section B is "Yes")</b>  |                        |  |                    |
| Name of qualified supervisor(s)  |                        | Building Code Identification Number (BCIN)                         |                    |
|  |                        |  |                    |
| <b>E. Declaration of Applicant:</b>  |                        |  |                    |
| <p><b>Adam Dillon - Paterson Group Inc.</b> declare that:</p> <p>(print name)</p> <p>I am the applicant for the permit to construct the sewage system. If the installer is unknown at time of application, I shall submit a new Schedule 2 prior to construction when the installer is known;</p> <p><u>OR</u></p> <p>I am the holder of the permit to construct the sewage system, and am submitting a new Schedule 2, now that the installer is known.</p> <p>I certify that:</p> <ol style="list-style-type: none"> <li>The information contained in this schedule is true to the best of my knowledge.</li> <li>If the owner is a corporation or partnership, I have the authority to bind the corporation or partnership.</li> </ol> <p>2/17/22<br/>Date</p> <p align="right">Signature of applicant </p> |                        |  |                    |





Do Not Complete  
 Permit # \_\_\_\_\_  
 Revision # 2-059  
 Date \_\_\_\_\_  
 OTTAWA

**Schedule 4**  
**Proposed Services**  
 Complete Sections 1 thru 7

**1. Engineered**

- Yes
- No

**2. Water supply**

- Proposed
- Existing

**3. Type of work proposed**

- New Installation
- Replacement
- Alteration

**4. Type of Well**

- Dug/bored/Sandpoint well
- Drilled well
- Municipal
- Other

**5. Residential Sewage Design Flow Info.**

**Bedrooms** \_\_\_\_\_  
**House (floor area)** \_\_\_\_\_ **m<sup>2</sup>**  
**People** \_\_\_\_\_  
**Total Fixture Units** \_\_\_\_\_ (Schedule 8)  
**Residential Flow** \_\_\_\_\_ **L/day**

**6. Sewage Design Flow Other Occupancies**

Design Flow 3,600 L/day  
 Detailed sewage flow calculations:  
 Refer to Drawing No. PH4407-2(rev.2)  
 \_\_\_\_\_  
 \_\_\_\_\_

**7. Type of System**

- Treatment Unit \_\_\_\_\_
- Class 2 – Leaching Pit
- Class 3 – Cesspool
- Class 4 – Shallow Buried Trench

---

- Class 4 – Trench (Schedule 9)
  - Fully raised
  - Partially raised
  - In-ground
- Class 4 – Filter Media (Schedule 10)
  - Fully raised
  - Partially raised
  - In-ground

- Class 4 – BMEC Area Bed (Schedule 11)
  - Fully raised
  - Partially raised
  - In-ground
- Class 4 – “Type A” Dispersal (Schedule 13)
  - Fully raised
  - Partially raised
  - In-ground
- Class 4 – “Type B” Dispersal (Schedule 14)
  - Fully raised
  - Partially raised
  - In-ground
- Class 5 – Holding Tank (9000L min)
- Tank/Treatment Unit/Pump Chamber ONLY
- Effluent Filter/Risers ONLY



**RVCA RECEIVED**  
**MAR 04 2022**  
 REFER TO: \_\_\_\_\_

Do Not Complete  
 Permit # **SEPTIC FILE #**  
 Revision # \_\_\_\_\_  
 Date **22-059**

OTTAWA

**Schedule 5  
 Sewage System Details**

|                                   |  |                            |
|-----------------------------------|--|----------------------------|
| Type of System                    | Class 4 - Type 'A' Dispersal Bed ( Schedule 4) |                            |
| Septic/Holding Tank Size:         | 9,400 Litres                                   | Make: Boyd Bros.           |
| Septic Tank Effluent Filter Make: | Tuf-Tite                                       | Model: EF6 (or equivalent) |

Treatment Unit – Make & Model Waterloo Biofilter BT-15,500 + WaterNOx-LS

Number of Units:

Other: \_\_\_\_\_

Refer to Typical Drawing #

Pump(s) required yes

Mantle Information:

Pump Rate \_\_\_\_\_ L/15min

Native or imported =15m in \_\_\_\_\_ direction(s)

**Note:** Alarm required for all pumping systems

Slope subgrade \_\_\_\_\_ % slope  
 \_\_\_\_\_ direction(s)

|  |                      |
|--|----------------------|
| <b>Site to be Scarified (If clay)</b>  | <b>YES / NO - No</b> |
| <b>Clay Seal Required (If bedrock)</b> | <b>YES / NO - No</b> |

**Trench**

Distribution Pipe Length \_\_\_\_\_ m

**Shallow Buried Trench**

Loading Area \_\_\_\_\_ m<sup>2</sup>

Pipe Length \_\_\_\_\_ m

Type of Chamber \_\_\_\_\_

Length of Chamber \_\_\_\_\_ m

**Filter Media Bed**

**BMEC Area Bed**

Stone \_\_\_\_\_ m<sup>2</sup>

**Type A**

Extended Base \_\_\_\_\_ m<sup>2</sup>

**Type B**

Pipe \_\_\_\_\_ m

Stone 78.0 m<sup>2</sup>

Weight of Filter Media \_\_\_\_\_ Kg

Sand 78.0 m<sup>2</sup>

Loading Area \_\_\_\_\_ m<sup>2</sup>

Pipe 72.0m (6 @ 12.0m) m

Linear Loading \_\_\_\_\_ L/m<sup>2</sup>

**Tank/Treatment Unit/Pump Chamber Replacement ONLY**

**Effluent Filter & Riser ONLY**

Construction Notes:

---



---



---



**RVCA RECEIVED**  
**MAR 04 2022**  
 REFER TO:

Do Not Complete  
 Permit # **SEPTIC FILE #**  
 Revision # \_\_\_\_\_  
 Date **22-059**

OTTAWA

**Schedule 6**  
**Soil and Water Table Information**  
**(Minimum depth of test pit: 2 metres)**

|  |                                       |   |   |   |   |
|--|---------------------------------------|---|---|---|---|
| Name of Applicant/Agent: <u>Paterson Group Inc.</u><br>Date: <u>December 14, 2021</u> Time: _____<br>Applicant/Agent Signature: _____  |                                       |   | Inspector: <u>HO</u><br>Date: _____ Time: _____<br>Inspector Signature: _____ |   |   |
| EG (.....)   | Soil Description                      | T | EG (.....)  | Soil Description  |   |
| .5m  | Refer to Drawing No. PH4407-2 (rev.2) |   | .5m   |   |   |
| 1.0 m  |                                       |   | 1.0 m   |   |   |
| 1.5m   |                                       |   | 1.5m  | Test pits not available for inspection. Engineer assumes all liability for soil and HGWT info/elv's |   |
| 2.0 m  |                                       |   | 2.0 m   |   |   |
| EG (.....)   | Soil Description                      | T | EG (.....)  | Soil Description  | T |
| .5m  |                                       |   | .5m   |   |   |
| 1.0 m  |                                       |   | 1.0 m   |   |   |
| 1.5m   |                                       |   | 1.5m  |   |   |
| 2.0 m  |                                       |   | 2.0 m   |   |   |
| <b>LEGEND</b><br>BR = Bedrock                      HGWT = High ground water table                      EG = Existing grade<br>GWT = Ground water table                      M = metres                      T = percolation rate |                                       |   |   |   |   |





BYCA RECEIVED  
MAR 04 2022

Do Not Complete  
Permit # \_\_\_\_\_  
Revision # 27-059  
Date \_\_\_\_\_  
OTTAWA

Scale: 1Block = \_\_\_\_\_

**Schedule 7  
Layout Section**

N

Refer to Drawing No. PH4407-1(rev.2)

○Dug Well ●Drilled Well ▲Neighbouring Homes ◇Benchmark ---Tile Drainage —Property Line

Elevations (metric only)

B.M. 100.00 \_\_\_\_\_ m

B.M. Description Top of wall flashing at base of metal

wall sheeting near center of south wall

Exact Location see plan

Min. of 5 elevations in proposed system area (in X pattern)

X<sub>1</sub> \_\_\_\_\_ X<sub>2</sub> \_\_\_\_\_

X<sub>3</sub> \_\_\_\_\_ X<sub>4</sub> \_\_\_\_\_

X<sub>5</sub> \_\_\_\_\_ X<sub>6</sub> (toe) \_\_\_\_\_

X<sub>7</sub> \_\_\_\_\_ X<sub>8</sub> \_\_\_\_\_





**RVCA RECEIVED**  
**MAR 04 2022**  
 REFER TO:  
**Schedule 8**

Do Not Complete  
 Permit # **SEPTIC FILE #**  
 Revision # \_\_\_\_\_  
 Date **22-059**

**Fixture unit count**

OTTAWA

| Fixtures  | # Existing + # Proposed X unit count = Fixture Count |   |   |   |           |
|---|--|---|---|---|-----------|
| <b>Bathroom</b>   |  |   |   |   |           |
| Bathroom group (toilet, sink and tub or shower) installed in the <u>same</u> room                                 |  | + |   | X | 6 =       |
| Bathtub with/without overhead shower  |  | + |   | X | 1.5 =     |
| Shower stall  |  | + |   | X | 1.5 =     |
| Wash basin (SINK) (1½inch trap)   | 2  | + | 1 | X | 1.5 = 4.5 |
| Watercloset (TOILET) tank operated  | 2  | + | 1 | X | 4 = 12.0  |
| Bidet   |  | + |   | X | 1 =       |
| <b>Kitchen</b>  |  |   |   |   |           |
| Dishwasher  |  | + |   | X | 1 =       |
| Sink with/without garbage grinder(s), domestic and other small type single, double or 2 single with a common trap |  | + |   | X | 1.5 =     |
| <b>Other</b>  |  |   |   |   |           |
| Domestic washing machine  |  | + |   | X | 1.5 =     |
| Combination sink and laundry tray single or double (Installed on 1½ trap)   |  | + |   | X | 1.5 =     |

**\*Total: 16.5**


**\*Insert the TOTAL in section 5 of Schedule 4 (0.Reg 151/13 Table 7.4.9.3)**

1. **Sump pumps and floor drains are not to be connected to the sewage system.** Connection of such fixtures to a sewage system may lead to a hydraulic failure of the said system. The above mentioned fixtures should be discharged separately to an approved Class 2 (leaching pit) sewage system.
2. Where laundry waste is not more than 20% of the total daily design sanitary sewage flow, it may discharge to a sewage system (Part 8, OBC, 8.1.3.1(2)).

\_\_\_\_\_  
 Agent/Owner signature

February 17, 2022  
 Date





**RVCA RECEIVED**  
**MAR 04 2022**  
 REFER TO:

**SEPTIC FILE #**  
**22-059**  
**OTTAWA**

CONTRACTOR TO EXERCISE CAUTION DURING CONSTRUCTION NOT TO IMPACT EXISTING OVERHEAD HYDRO LINES, AND UNDERGROUND HYDRO AND GAS LINES

Existing Occupancy  
 1359 Coker St.

RIGID INSULATION BOARD INSTALLED VERTICALLY BETWEEN PARKING AREA AND TREATMENT TANKS

15,500 L (min) BASKET WATERLOO BIOFILTER (BT-15500) c/w  
 • TWO (2) BIOFILTER BASKETS  
 • ONE (1) RE-CIRCULATION PUMP  
 • ONE (1) EFFLUENT PUMP  
 • HIGH LEVEL ALARMS ON PUMPS  
 • COVER TANK WITH 50mm (2") DOW HI-40 INSULATION BOARD

7,700 L WATER NOx-LS TANK c/w  
 • LS AGGREGATE MEDIA  
 • EFFLUENT PUMP w/ HIGH LEVEL ALARM  
 • COVER TANK WITH 50mm (2") DOW HI-40 INSULATION BOARD

EXISTING PARKING AREA TO BE RECONFIGURED AS NECESSARY TO ACCOMMODATE REQUIRED LOADING AREA

'PLATON' ROOT BARRIER TO BE INSTALLED ALONG SOUTH EDGE OF EXCAVATION IF TREES REMAIN

3,600L PUMP CHAMBER WITH TIMER CONTROLLED EFFLUENT PUMP & HIGH WATER ALARM  
 • INLET INV. = 99.22  
 • COVER TANK WITH 50mm (2") DOW HI-40 INSULATION BOARD

38mmØ FORCEMAIN INSTALLED:  
 • GRAVITY DRAIN AND OVERLAIN WITH 50mm T x 600mm W INSULATION BOARDS; OR  
 • BURIED 1.8m (min) BELOW FINISHED GROUND ELEVATION

Existing Commercial Occupancy  
 1353 Coker St.

TBM: TOP OF WALL FLASHING ELEV.=100.00m

CLEAR STONE & SAND AREA  
 13.0m x 6.0m

TYPE 'A' DISPERSAL BED  
 6 RUNS OF 12.0m @ 1.0m O/C  
 HEADER INV. = 99.91m  
 FOOTER INV. = 99.87m

PROPOSED WAREHOUSE

SEWER LINE INV. ELEV. = 99.47 (min)

Existing Drilled Well  
 Top of Well = 100.23

NEW 9,400L ANAEROBIC DIGESTER c/w  
 • INLET INV. = 99.30  
 • INNER TUBE  
 • EFFLUENT FILTER  
 • POLY RISER & COVER ASSEMBLY (2)  
 • COVER TANK WITH 50mm (2") DOW HI-40 INSULATION BOARD

Existing 3,600L Septic Tank  
 Top of Tank = 99.67m  
 Outlet Inv. = 99.32m±  
 • TO BE PUMPED AND REMOVED

50mmØ POLYPROPYLENE FORCEMAIN  
 • SLEEVE THROUGH 100mmØ (4") SDR28 PVC GASKETED PIPE  
 • INSTALL ON 150mm THICK LAYER OF COMPACTED SAND BEDDING  
 • SURROUND ALL SIDES w/ 75 mm RIGID SM INSULATION BOARD  
 • INSTALLED TO PROVIDE SLOPE TOWARD SEPTIC TANK

450L (min.) PUMP CHAMBER WITH ON-DEMAND GRINDER PUMP & HIGH WATER ALARM  
 • GOULDS AGS0511 PUMP (OR EQUIVALENT)  
 • OUTLET INV. = 99.41

Existing Occupancy  
 1341 Coker St.

| LEGEND: |                                   | BENCHMARK INFORMATION:            |                          |
|---------|-----------------------------------|-----------------------------------|--------------------------|
| x 70.81 | Existing Ground Surface Elev. (m) | GFL                               | Garage Floor Level       |
| x 72.70 | Proposed Ground Surface Elev. (m) | USF                               | Underside of Footing     |
| (70.7)  | Groundwater Elev. (m) - Dec.14/21 | ←                                 | Surficial Flow Direction |
| MFL     | Main Floor Level                  | Final Grading: 2%Min., 7% Max. or |                          |
| BFL     | Basement Floor Level              | Terrace Grade 3H:1V Max.          |                          |
| T/C     | Top of Foundation Wall            | Existing Structure                |                          |
|         |                                   | Proposed Structure                |                          |

**REFERENCE:**  
 Base Plan Information Obtained from GeoOttawa Imagery.  
 A LEGAL SURVEY DESCRIBING THE PROPERTY BOUNDARY WAS NOT AVAILABLE TO THIS FIRM AT THE TIME OF THESE WORKS. AS SUCH, PROPERTY BOUNDARIES SHOULD BE CONFIRMED PRIOR TO CONSTRUCTION

**patersongroup**  
 consulting engineers  
 154 Colonnade Road, Ottawa, Ontario K2E 7J5

| DD/MM/YY | Description                        | Rev. |
|----------|------------------------------------|------|
| 17/02/22 | Issued for Permit Approval         | 2    |
| 11/02/22 | Revised per Treatment Requirements | 1    |
| 21/12/21 | Issued for Client Review           | 0    |
| DD/MM/YY | Description                        | Rev. |


Client  
**DYMECH ENGINEERING INC.**  
 Project  
**PROPOSED REPLACEMENT SEWAGE SYSTEM**  
 1353 COKER STREET  
 OTTAWA (GRIELY), ONTARIO

Drawing  
**SEWAGE SYSTEM LAYOUT PLAN**

|              |                        |             |    |
|--------------|------------------------|-------------|----|
| Scale:       | 1:250                  | Drawn by:   | AD |
| Date:        | 02/2022                | Checked by: | MK |
| Drawing no.: | <b>PH4407-1(rev.2)</b> |             |    |

p:\arccad\drawings\hydrogeology\ph4407-1\ph4407-1.dwg - dymech engineering - 1353 coker st\ph4407-1.dwg



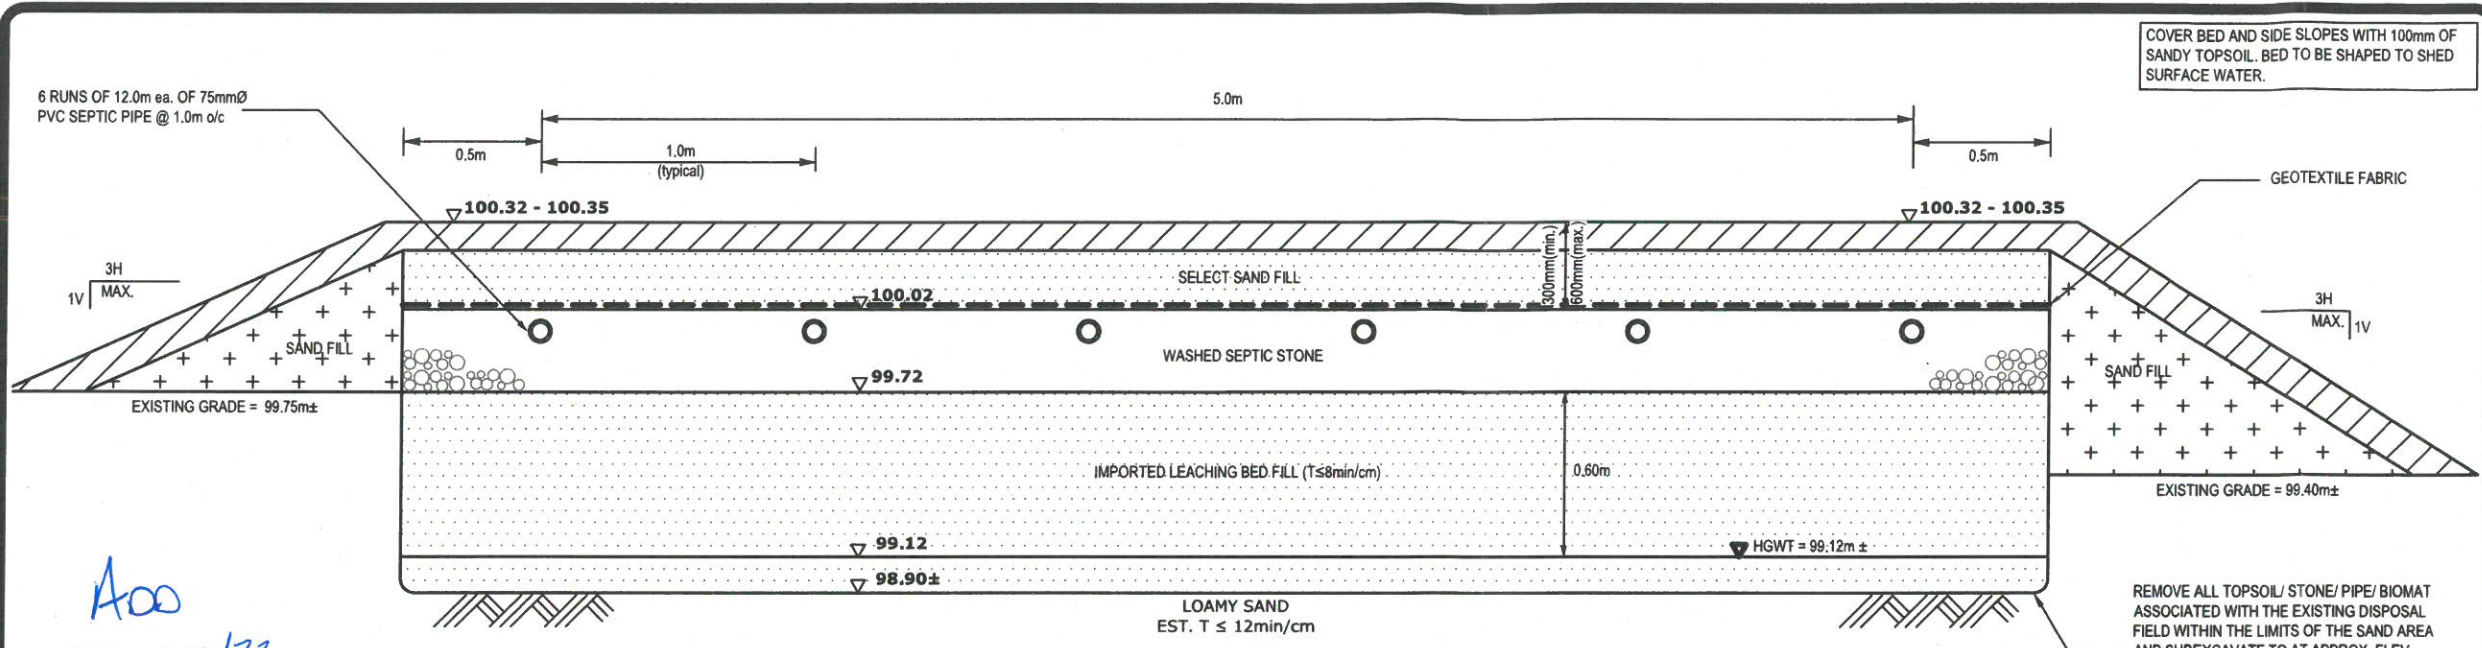

**PROFILE**  
N.T.S.

Acc  
March 2/22

**NOTES:**

**1) ESTIMATE OF DAILY SEWAGE FLOW (Q)**

- EXISTING:
- FACTORY (NO SHOWERS) w/ 6 EMPLOYEES = 6 X 76 L/DAY = 450 L/DAY; OR
  - NO. OF WATER CLOSETS = 2 X 950 L/DAY = 1,900 L/DAY

- PROPOSED:
- WAREHOUSE w/ 5 BAY DOORS = 5 X 150 L/DAY = 750 L/DAY; AND
  - NO. OF WATER CLOSETS = 1 X 950 L/DAY = 950 L/DAY

DESIGN SEWAGE FLOW RATE = 1,900 (EXISTING) + 1,700 (PROPOSED) = 3,600 L/DAY

**2) SOIL CONDITIONS**

SOILS INFORMATION GATHERED BY PATERSON GROUP INC. ON DECEMBER 14, 2021

| TH 1, ELEV. 99.22m |                          | TH 2, ELEV. 99.74m |                |
|--------------------|--------------------------|--------------------|----------------|
| 0-0.13             | TOPSOIL                  | 0-0.13             | TOPSOIL        |
| 0.13-0.29          | MIXED FILL               | 0.13-0.68          | MIXED FILL     |
| 0.29-0.37          | TOPSOIL                  | 0.68-0.82          | TOPSOIL        |
| 0.37-0.50          | LOAMY SAND               | 0.82-1.22          | LOAMY SAND     |
| 0.50-0.65          | SAND w/ PEBBLES & GRAVEL | 1.22-1.35          | GR. SANDY CLAY |

-WATER @ 0.37m B/G      -WATER @ 0.62m B/G

**3) SEPTIC TANK / ANAEROBIC DIGESTER**

- PUMP AND REMOVE EXISTING SEPTIC TANK.
- MINIMUM WORKING CAPACITY OF NEW ANAEROBIC DIGESTER TANK = 9,400L (min.)
- TANK TO CONTAIN A MINIMUM 720L INNER TUBE OF 305mmØ
- AN OBC APPROVED EFFLUENT FILTER (I.E. POLYLOK PL-122 EFFLUENT FILTER, OR EQUIVALENT) SHALL BE INSTALLED ON THE OUTLET PIPE OF ANAEROBIC DIGESTER TANK.
- THE ACCESS LIDS TO THE TANK OPENINGS SHALL BE EXTENDED TO THE GROUND SURFACE. INSTALL RISERS AND COVERS TO SUIT.

**4) PUMP CHAMBER (IN TREATMENT PROCESS)**

- INSTALL A NEW 3,600L (min) PUMP CHAMBER
- EQUIP WITH OPERATIONAL AND HIGH-LEVEL ALARM FLOATS SET TO MANUFACTURER SPECIFICATIONS
- ACCESS LID TO TANK OPENING SHALL BE EXTENDED TO THE GROUND SURFACE. INSTALL RISER AND COVER TO SUIT

**5) WATERLOO BIOFILTER BASKET TANK**

- INSTALL A NEW MINIMUM CAPACITY 15,500L CONCRETE TREATMENT TANK c/w TWO (2) BIOFILTER BASKETS
- HELICAL SPRAY NOZZLES TO BE INSTALLED DIRECTLY OVER BIOFILTER BASKETS
- INSTALL ONE (1) ½ HP LITTLE GIANT WSV50 (OR EQUIVALENT) EFFLUENT PUMP PLUMBED TO RECIRCULATE EFFLUENT TO INLET OF ANAEROBIC DIGESTER TANK
- INSTALL ONE (1) ½ HP LITTLE GIANT WSV50 (OR EQUIVALENT) EFFLUENT PUMP PLUMBED TO

- DISCHARGE EFFLUENT INTO WATER NOx-LS TANK
- EQUIP WITH OPERATIONAL AND HIGH-LEVEL ALARM FLOATS SET TO MANUFACTURER SPECIFICATIONS
- ACCESS LID TO TANK OPENING SHALL BE EXTENDED TO THE GROUND SURFACE. INSTALL RISER AND COVER TO SUIT

**6) WATER NOx-LS TANK**

- INSTALL A NEW 7,700L CONCRETE, TWO-COMPARTMENT WATER NOx-LS TANK
- FIRST COMPARTMENT TO CONTAIN LIME-SULPHUR AGGREGATE MEDIA
- SECOND COMPARTMENT TO BE EQUIPPED WITH ONE (1) ½ HP LITTLE GIANT WSV50 (OR EQUIVALENT) EFFLUENT PUMP AND OPERATIONAL AND HIGH-LEVEL ALARM FLOATS SET TO MANUFACTURER SPECIFICATIONS
- ACCESS LID TO TANK OPENING SHALL BE EXTENDED TO THE GROUND SURFACE. INSTALL RISER AND COVER TO SUIT

**7) FORCEMAIN (TO TYPE A DISPERSAL BED)**

- A 38mmØ FORCEMAIN SHALL BE USED TO CARRY THE EFFLUENT FROM THE WATER NOx-LS TANK TO THE SECONDARY HEADER OF THE TYPE A DISPERSAL BED.
- FORCEMAIN SHALL BE INSTALLED TO EITHER GRAVITY DRAIN BACK TO THE PUMP CHAMBER OR BURIED MIN. 1.8m BELOW GROUND SURFACE TO FROST PROTECT THE CHARGED LINE.
- THE FORCEMAIN SHALL BE INSTALLED ON A 150mm THICK LAYER OF COMPACTED SAND OVERLAIN WITH 50mm T x 600mm W RIGID INSULATION BOARD IF NOT INSTALLED 1.8m B/G.
- OPERATIONAL FLOAT TETHER LENGTH SHALL BE SET SO TO MANUFACTURER SPECIFICATIONS.
- PUMP CHAMBER SHALL BE EQUIPPED WITH A HIGH-LEVEL ALARM FLOAT SET SO TO ALLOW RESPONSE TIME IN THE EVENT OF PUMP FAILURE.

**8) TYPE 'A' DISPERSAL BED**

- STONE AREA REQUIRED = Q/50 = 3,600/50 = 72.0m²
- USE 6 RUNS OF 12.0m EACH @ 1.0m o/c
- STONE AREA PROVIDED = 6.0m x 13.0 = 78.0m²
- SAND AREA REQUIRED = 3,600(12)/850 = 50.8m²
- SAND AREA PROVIDED = 6.0m x 13.0m = 78.0m²
- HYDRAULIC LOADING RATE = 46.2 L/m²/DAY

**9) TYPE 'A' DISPERSAL BED CONSTRUCTION GUIDELINES**

- REMOVE ALL TOPSOIL/ PIPE/ STONE/ BIOMAT/ CONTAMINATED MATERIAL ASSOCIATED WITH EXISTING DISPOSAL FIELD AND SUBEXCAVATE TO AT LEAST ELEVATION 98.90m
- A MINIMUM THICKNESS OF 0.30m OF LEACHING BED SAND FILL, HAVING A PERCOLATION RATE OF NOT GREATER THAN 8 min/cm, SHALL BE INSTALLED BELOW OVER THE EXTENDED BASE AREA.
- LEACHING BED SAND FILL SHALL CONSIST OF UNIFORM SAND WITH GRADING LIMITS SIMILAR TO 100% PASSING 13.2mm SIEVE, LESS THAN 5% PASSING 0.075mm SIEVE AND HAVING A PERCOLATION RATE OF 6 TO 8 min/cm.
- THE LEACHING BED FILL SHALL CONFORM TO THE REQUIREMENTS OF 8.7.7.1.(4).(a) OF THE OBC.

- THE DISTRIBUTION PIPES (6 RUNS OF 12.0m EACH) SHALL CONSIST OF 75mmØ PERFORATED PVC SEPTIC PIPE WHICH SHALL BE EMBEDDED IN A CONTINUOUS 300mm THICK LAYER OF WASHED SEPTIC STONE.
- THE INVERT LEVEL OF THE DISTRIBUTION PIPES SHALL BE SET AT ELEVATION 99.90m AT THE HEADER AND ELEVATION 99.87m AT THE FOOTER.
- THE ENDS OF EACH RUN SHALL BE INTERCONNECTED WITH A SOLID PVC FOOTER PIPE.
- THE CLEAR STONE LAYER SHOULD BE COVERED WITH A NON-WOVEN GEOTEXTILE FABRIC.
- THE SURFACE OF THE BED SHOULD BE COVERED WITH PERMEABLE SAND FOLLOWED BY APPROXIMATELY 100mm OF SANDY TOPSOIL. THE BED AREA SHOULD BE VEGETATED.
- THE TOTAL THICKNESS OF THE COVER OVER THE CLEAR STONE SHOULD BE WITHIN A RANGE OF 0.3m TO 0.6m.
- THE SIDES OF THE BED SHOULD BE SLOPED IN THE RANGE OF 3H:1V OR SHALLOWER.

**10) MINIMUM CLEARANCE DISTANCE FROM LEACHING BED**

- 4.1m FROM ANY PROPERTY LINE
- 6.1m FROM ANY STRUCTURE; 5.0m TO ANY STRUCTURE WITHOUT PERIMETER DRAINAGE
- 16.1m FROM ANY DRILLED WELL; 31.1m TO ANY DUG OR SANDPOINT WELL

**11) MINIMUM CLEARANCE DISTANCE FROM TANK(S)**

- 1.5m FROM ANY STRUCTURE
- 15.0m FROM ANY DRILLED WELL (AS PER EXISTING)
- 3.0m FROM ANY PROPERTY LINE

**12) GENERAL**

- THE BACKWASH WATERS FROM ANY HOUSEHOLD WATER TREATMENT UNIT, SUCH AS WATER SOFTENER, SHOULD NOT DISCHARGE INTO THE SEWAGE SYSTEM.
- THE SEWAGE SYSTEM HAS BEEN DESIGNED TO ACCEPT ONLY WATER FROM DOMESTIC TYPE FIXTURES - NO FLOOR DRAINS, WASHWATER, ETC ARE TO BE DIRECTED TO SYSTEM.
- CONTRACTOR SHALL BE QUALIFIED AND REGISTERED UNDER PART 8 OF THE ONTARIO BUILDING CODE.
- ALL WORK SHALL BE CARRIED OUT IN ACCORDANCE WITH THE LATEST BY-LAWS, CODES AND REGULATIONS.
- CONTRACTOR SHALL REVIEW DRAWINGS IN DETAIL AND SHALL INFORM THE CONSULTANT OF ANY ERRORS AND/OR OMISSIONS ON DESIGN DRAWINGS IMMEDIATELY.
- CONTRACTOR SHALL BE RESPONSIBLE TO LOCATE AND PROTECT ALL EXISTING UNDERGROUND SERVICES.
- CONTRACTOR SHALL VISIT THE SITE AND REVIEW ALL DOCUMENTATION TO BECOME FAMILIAR WITH THE SITE AND SUBSURFACE SOIL CONDITIONS TO DETERMINE SUITABLE METHODS OF CONSTRUCTION.
- THE FIRM OF PATERSON GROUP INC. HAS PROVIDED DESIGN SERVICES ONLY FOR THE SUBJECT SEWAGE SYSTEM. THE DESIGN HAS BEEN CARRIED OUT IN ACCORDANCE WITH THE MANUFACTURER'S GUIDELINES AND OUR INTERPRETATION OF PART 8 OF THE ONTARIO BUILDING CODE.
- IF THIS FIRM IS TO COMPLETE ANY CONSTRUCTION INSPECTION(S), ADDITIONAL FEES MAY BE APPLIED. CONFIRMATION OF PAYMENT WILL BE REQUIRED PRIOR TO THE INSPECTION.
- THE TEST HOLE INFORMATION PROVIDED, IS INTENDED TO BE USED FOR DESIGN PURPOSES ONLY, AND SHOULD NOT BE RELIED UPON FOR CONSTRUCTION PURPOSES. IF DISCREPANCIES ARE FOUND DURING THE CONSTRUCTION PROCESS, IT IS THE CLIENT'S RESPONSIBILITY TO CONTACT THIS FIRM TO MAKE ANY NECESSARY COMMENTS OR REVISIONS. ADDITIONAL REVISIONS ARE NOT CONSIDERED PART OF THE DESIGN WORKS AND WILL BE CONSIDERED AS AN ADDITIONAL COST.

SEPTIC FILE #  
22-059  
OTTAWA

RVCA RECEIVED  
MAR 04 2022  
REFER TO:

| DD/MM/YY | DESCRIPTION                        | REV. |
|----------|------------------------------------|------|
| 17/02/22 | Issued for Permit Approval         | 2    |
| 11/02/22 | Revised per Treatment Requirements | 1    |
| 12/12/21 | Issued for Preliminary Review      | 0    |

Consultant:  
**paterSONgroup**  
consulting engineers

Client:  
**DYMECH ENGINEERING INC.**

Project:  
**PROPOSED SEWAGE SYSTEM REPLACEMENT**  
1353 COKER ST.  
OTTAWA (GREELY), ONTARIO

Drawing:  
**SEWAGE SYSTEM DETAIL & NOTES**

|                  |                   |
|------------------|-------------------|
| Scale:<br>N.T.S. | Drawn by:<br>AD   |
| Date:<br>02/2022 | Checked by:<br>HV |

Drawing No.:  
**PH4407-2(rev.2)**





|                           |
|---------------------------|
| Do Not Complete           |
| Permit No <u>22-059</u>   |
| Revision No _____         |
| Date _____                |
| Related Application _____ |

## Permit

### Part 8 – Sewage System

### Ontario Building Code

**A copy of this permit must be posted on the property at all time during construction. OBC, Division C — Part 1, Section 1.3.2.1**

This permit verifies that the on-site sewage system was reviewed and approved for construction under the *Ontario Building Code* and *O.Reg. 323/12* as amended by *O.Reg. 151/13*.

Inspected & Recommended by: ALEX DEKLEINE Owner: DYMECH ENGINEERING INC

Inspection Date & Time: MARCH 9, 2022 Weather: SUNNY

Civic Address: 1353 COKER ST Legal: \_\_\_\_\_

Osgoode:  CUMBERLAND:  Gloucester:

number of bedrooms: \_\_\_\_\_ fixture units: \_\_\_\_\_

finished floor area: \_\_\_\_\_ Q: 3600 L/day

|  |  |
|--|--|
| pretreatment tank <u>9400</u> L<br>effluent filter <u>N/A</u><br>pump rate <u>AS PER WATERLOO BIOFILTER</u> L/15 MIN<br>treatment unit <u>Waterloo Biofilter BT-15,500</u><br>number of units <u>1</u> | weigh bills for <input type="checkbox"/> yes <input checked="" type="checkbox"/> no<br>grain size analysis required <input type="checkbox"/> yes <input checked="" type="checkbox"/> no<br>site to be scarified <input type="checkbox"/> yes <input checked="" type="checkbox"/> no<br>clay seal inspection <input type="checkbox"/> yes <input checked="" type="checkbox"/> no<br>mantle required <input type="checkbox"/> yes <input checked="" type="checkbox"/> no<br>sub-grade inspection <input checked="" type="checkbox"/> yes <input type="checkbox"/> no |
|--|--|

**ELEVATION**    In Ground    Partially Raised    Fully Raised

**TYPE OF SYSTEM**

- Trench  
 Pipe and Stone or  Chambers

type of chamber \_\_\_\_\_

loading area \_\_\_\_\_ m<sup>2</sup>

total trench length \_\_\_\_\_ m

trench configuration \_\_\_\_\_

**■ Dispersal Bed**

BMEC    Type A    Type B

stone 78 m<sup>2</sup>

sand 78 m<sup>2</sup>

pipe 6 RUNS OF 12M @ 1M O/C

weight of sand \_\_\_\_\_ kg

**Shallow Buried Trench**

pipe length \_\_\_\_\_ m

orifice spacing \_\_\_\_\_ m

**Filter Media Bed**

stone \_\_\_\_\_ m<sup>2</sup>

extended base \_\_\_\_\_ m<sup>2</sup>


pipe \_\_\_\_\_

weight of filter media \_\_\_\_\_ kg

loading area \_\_\_\_\_ m<sup>2</sup>

**Class 5 Holding Tank**

**Septic Tank Only**

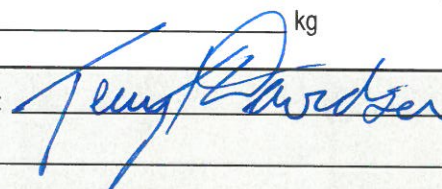Manager, Septic System Approvals:  Permit Date: MARCH 17 2022

Comments: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

maintenance/pumping required  
  ESA permit # required  
  engineer to verify  
 Class 5 Holding Tank approval only valid for three years from date of issue  
  subgrade  
 squirt height

Manager, Septic System Approvals: \_\_\_\_\_ Revision Date: \_\_\_\_\_

Comments: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_