


STARWOOD GROUP INC.



THE HAZELTON WESTBORO 403 RICHMOND ROAD & 389 ROOSEVELT AVENUE

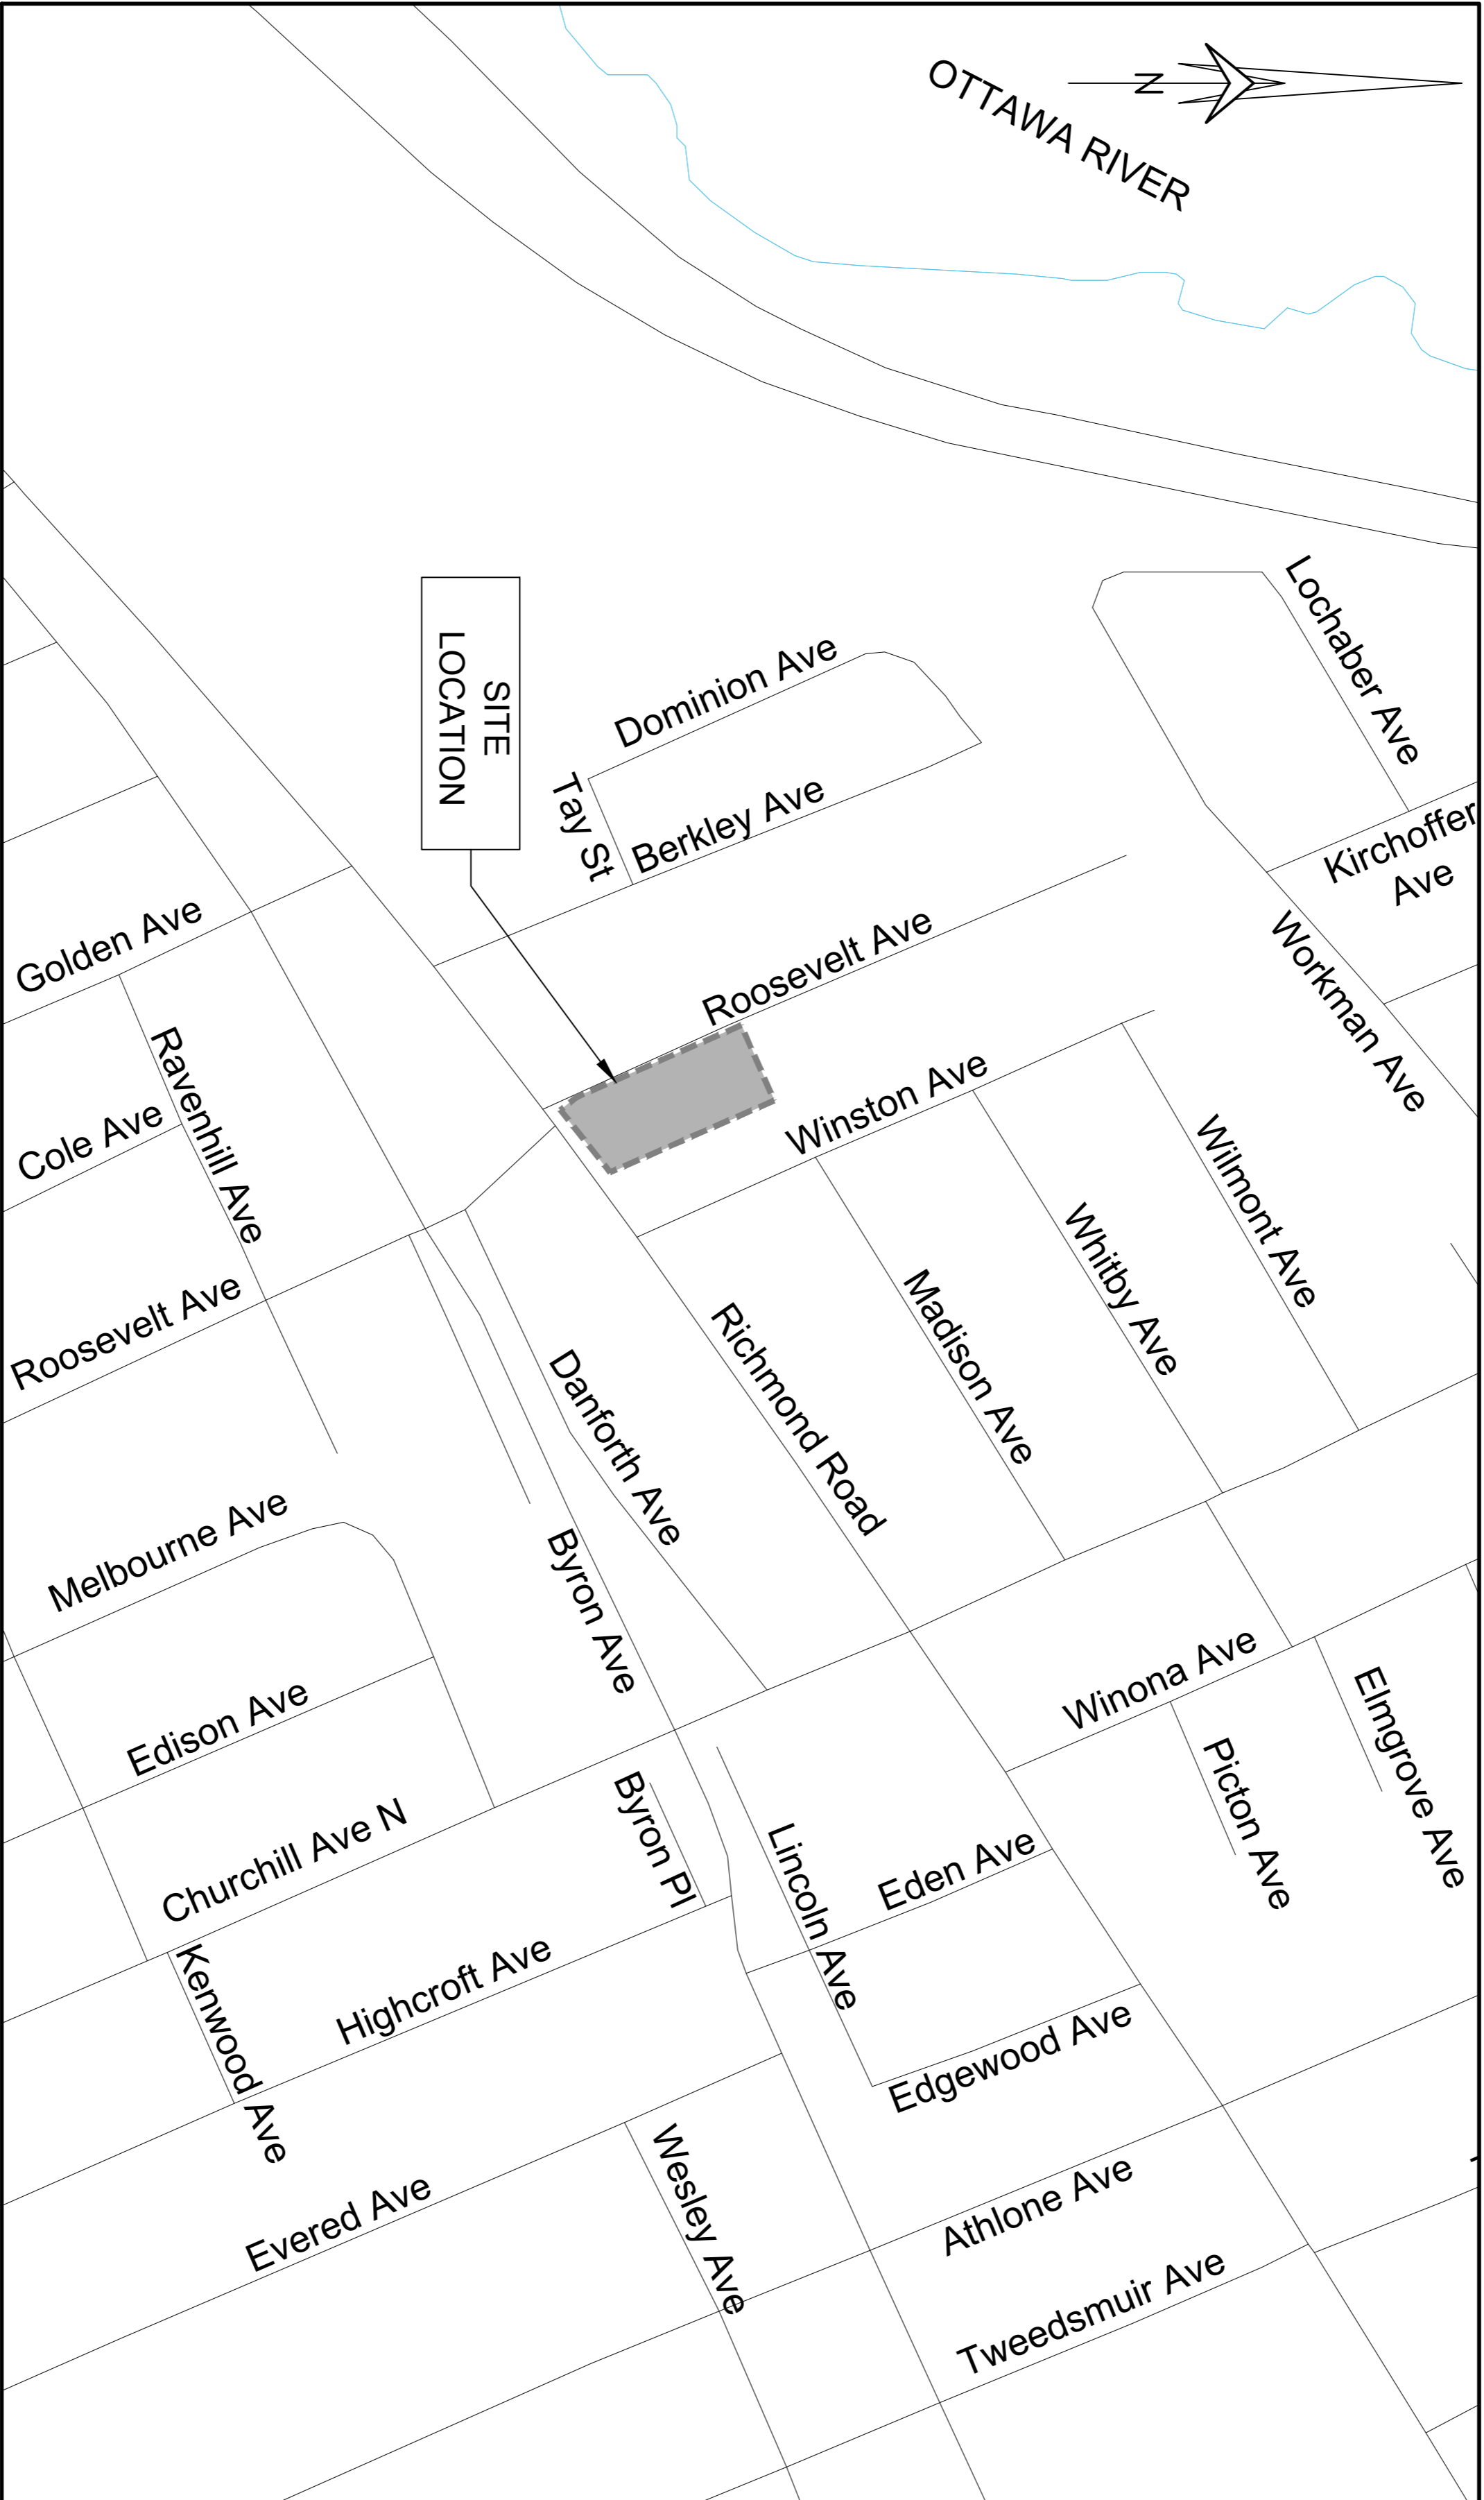

LIST OF DRAWINGS

PLAN No.	DESCRIPTION
C000	COVER PAGE
C001	TOPOGRAPHICAL SURVEY PLAN
C002	SEDIMENT AND EROSION CONTROL PLAN
C003	NOTES PLAN - 1 of 2
C004	NOTES PLAN - 2 of 2
C005	GRADE CONTROL AND DRAINAGE PLAN
C006	SITE SERVICING PLAN
C007	STORM WATER MANAGEMENT PLAN
C008	CIVIL DETAILS PLAN - 1 of 5
C009	CIVIL DETAILS PLAN - 2 of 5
C010	CIVIL DETAILS PLAN - 3 of 5
C011	CIVIL DETAILS PLAN - 4 of 5
C012	CIVIL DETAILS PLAN - 5 of 5



STARWOOD GROUP INC.
THE HAZELTON WESTBORO
403 RICHMOND ROAD & 389 ROOSEVELT AVENUE
RE-ISSUED FOR SITE PLAN CONTROL - JANUARY 20, 2023




T: 613-860-3462
 600-1400 Blair Towers Place, Ottawa, ON K1J 9B8 CANADA

C000

#18861

D07-12-22-0067

TITLE BLOCK 24238 VERT ENG 3.0
 PRINT DATE: 2023/01/20 / PAPER SIZE: ISO A4 (210.00 x 297.00 MM)
 PATH: Z:\Cma-C\101\01\Projects\A001000-000-1699\A001046_003 Richmond - Servicing Report\040480_Civ\005-Grading.dwg / LAYOUT: C005

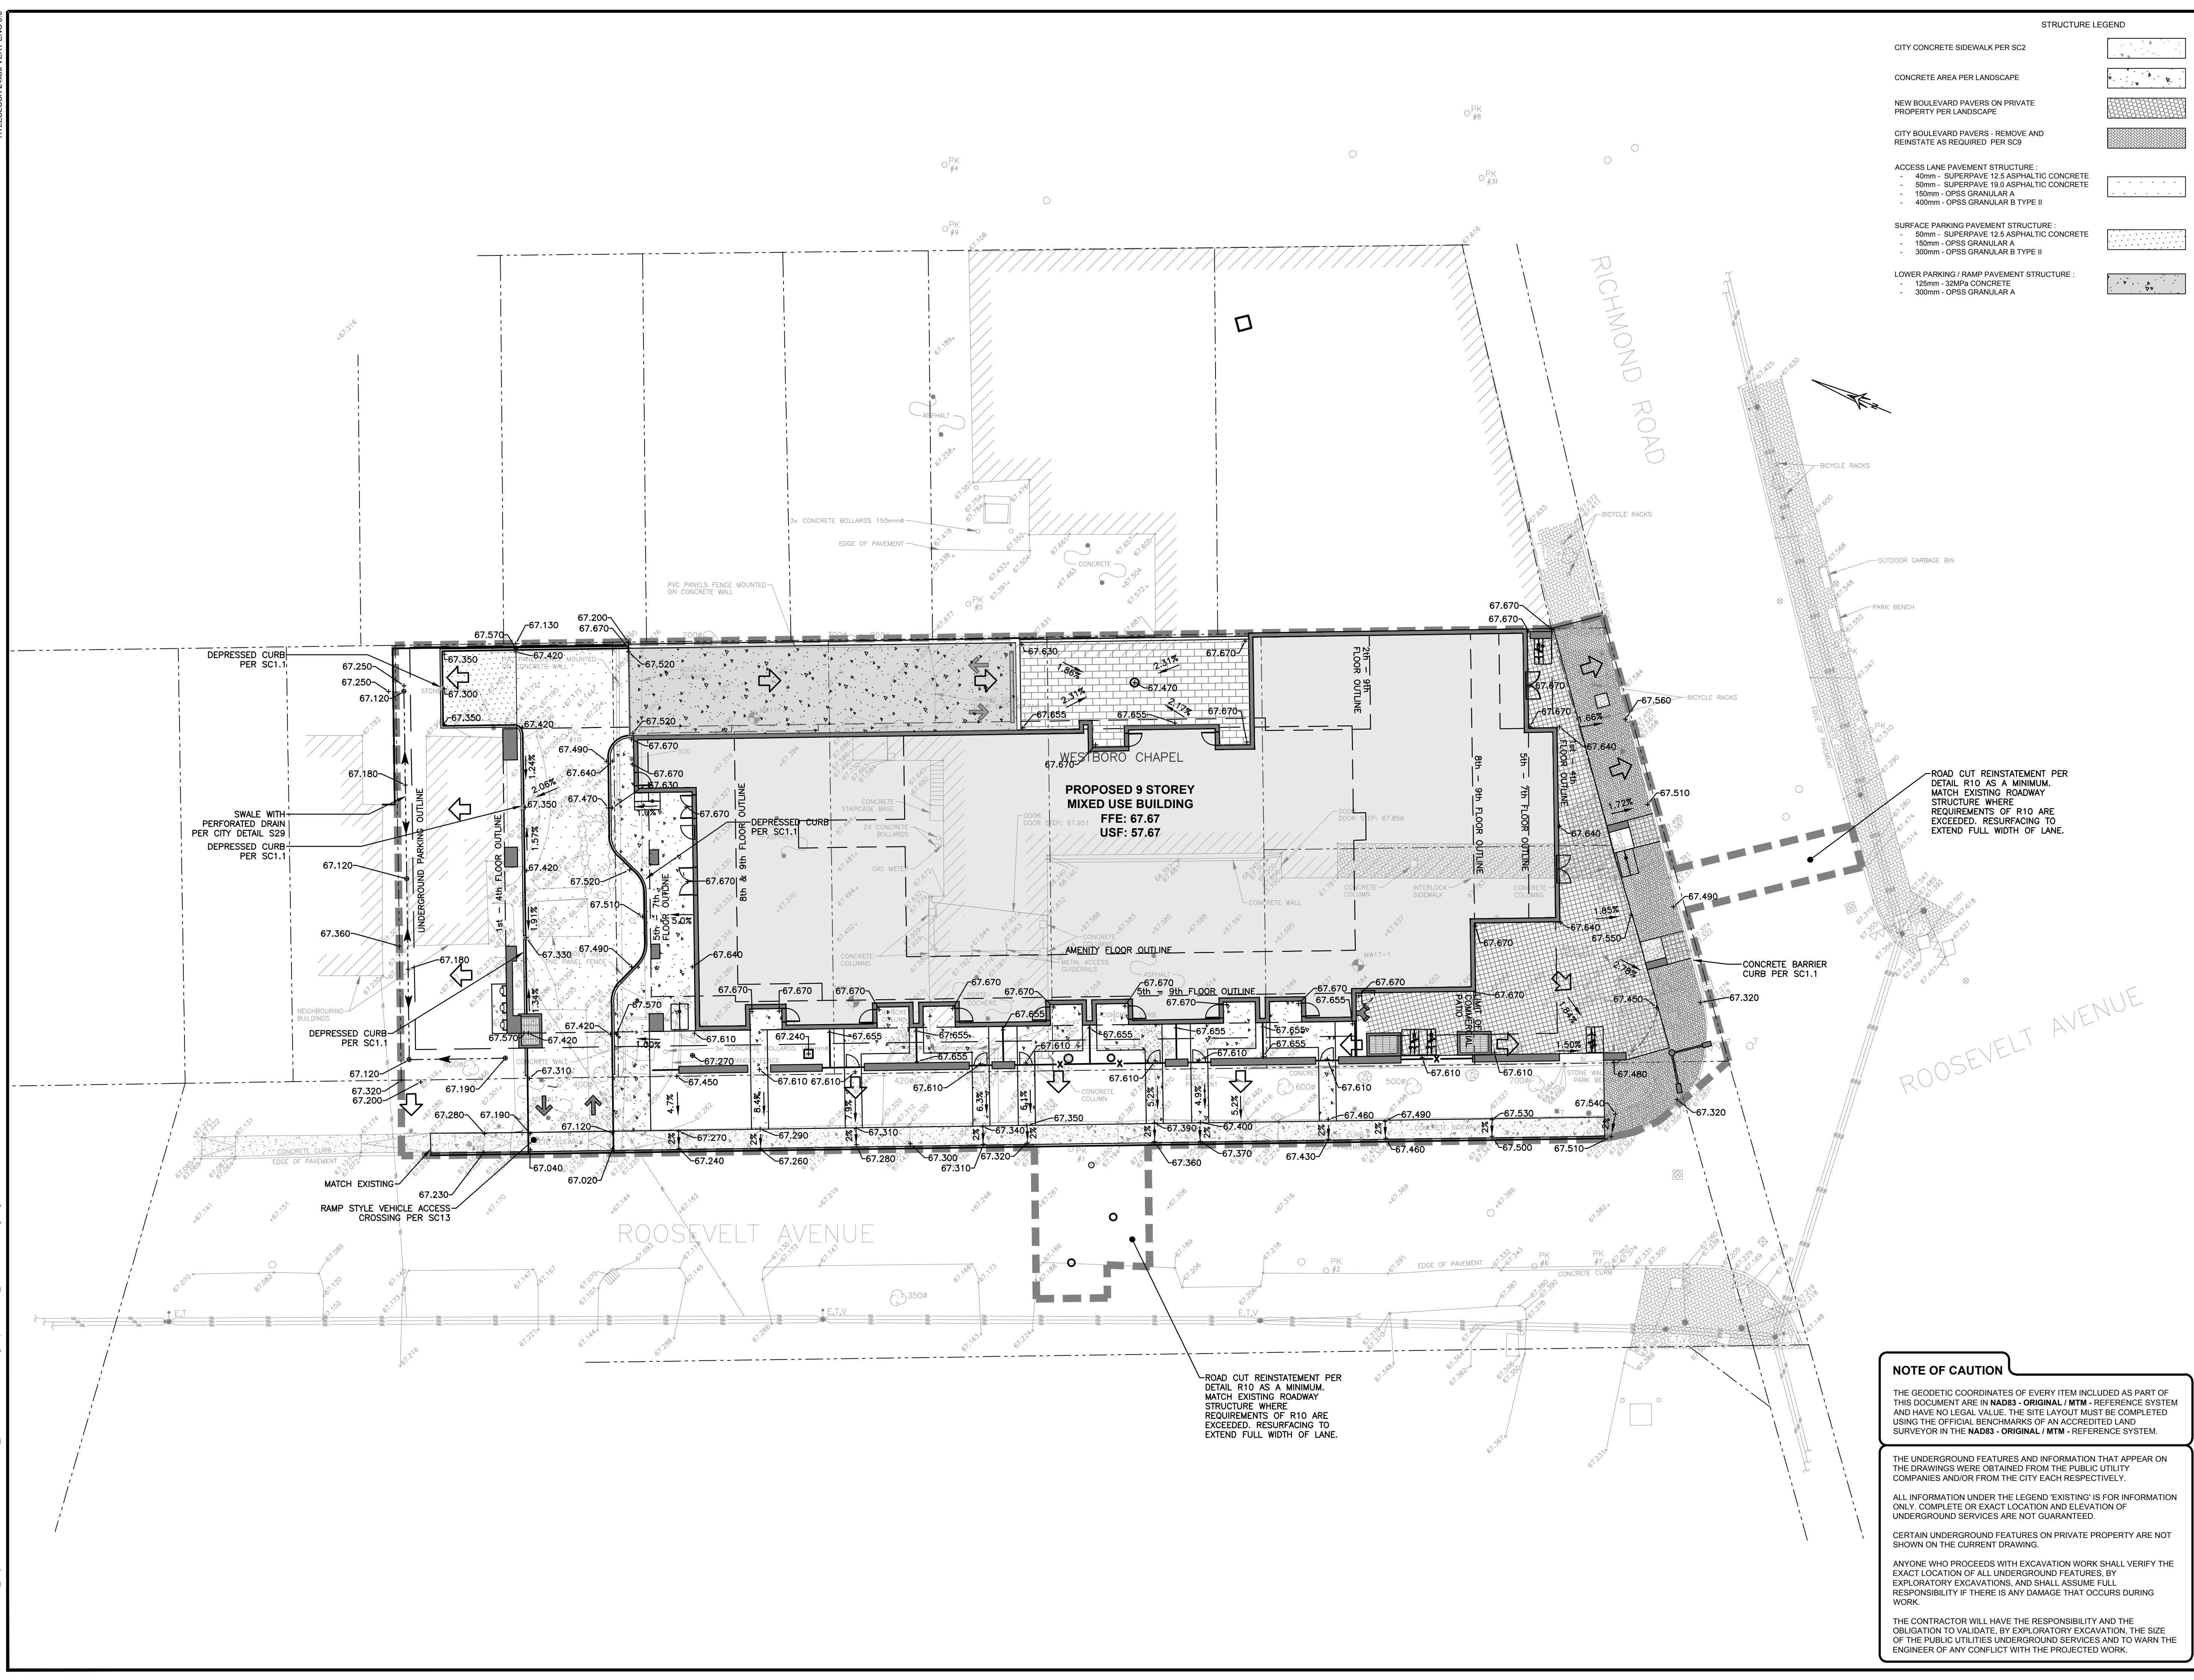

STRUCTURE LEGEND

CITY CONCRETE SIDEWALK PER SC2	[Symbol]
CONCRETE AREA PER LANDSCAPE	[Symbol]
NEW BOULEVARD PAVERS ON PRIVATE PROPERTY PER LANDSCAPE	[Symbol]
CITY BOULEVARD PAVERS - REMOVE AND REINSTATE AS REQUIRED PER SC9	[Symbol]
ACCESS LANE PAVEMENT STRUCTURE: - 40mm - SUPERPAVE 12.5 ASPHALTIC CONCRETE - 50mm - SUPERPAVE 19.0 ASPHALTIC CONCRETE - 150mm - OPSS GRANULAR A - 400mm - OPSS GRANULAR B TYPE II	[Symbol]
SURFACE PARKING PAVEMENT STRUCTURE: - 50mm - SUPERPAVE 12.5 ASPHALTIC CONCRETE - 150mm - OPSS GRANULAR A - 300mm - OPSS GRANULAR B TYPE II	[Symbol]
LOWER PARKING / RAMP PAVEMENT STRUCTURE: - 125mm - 32MPa CONCRETE - 300mm - OPSS GRANULAR A	[Symbol]

EXISTING



WM	WATERMAIN
SS	SANITARY SEWER
STW	STORM SEWER
D	DRAIN
G	GAS LINE (APPROX. LOC.)
T	UNDERGROUND TELEPHONE (APPROX. LOC.)
CA	UNDERGROUND TRAFFIC CABLE (APPROX. LOC.)
E	FENCE
UW	UNDERGROUND ELECTRICITY (APPROX. LOC.)
OW	OVERHEAD WIRES
RL	LOT LINE
RL	RIGHT-OF-WAY LIMITS
EA	EASEMENT
TS	TOP OF SLOPE
DC	DITCH CENTER
BS	BOTTOM OF SLOPE
WA	WOOD AREA
GC	GRADE CROSSING
FP	FLAGPOLE
CB	CATCHBASIN
MC	MANHOLE/CATCHBASIN
M	MANHOLE
FH	FIRE HYDRANT
V	VALVE
R	REDUCER
T	TEE
VC	VALVE CHAMBER
PU	PRIVATE UTILITIES (WATERMAIN)
EF	EXTERIOR WATER FAUCET
SL	SLUCEWAY
N	NATURAL GAS VALVE
S	SIGN
TS	STOP SIGN
TL	TRAFFIC LIGHT
EP	ELECTRICITY POLE
TP	TELEPHONE POLE
ES	ELECT-TEL-STREET LIGHT POLE
ET	ELECT-TEL-TRANSFORMER POLE
PS	PRIVATE STREET LIGHT
EM	ELECTRICITY MANHOLE
TM	TELEPHONE MANHOLE
ST	SURVEY STATION
E	ELEVATION
DR	DRAINAGE DIRECTION
B	BOREHOLE (LOC. APPROX.)
OW	OVERLAND FLOW
WL	WORK LIMIT

Scale: 1:200

No.	Date	Description	By
4	23/01/20	RE-ISSUED FOR SITE PLAN CONTROL	T.K
3	22/11/07	RE-ISSUED FOR SITE PLAN CONTROL	T.K
2	22/10/14	RE-ISSUED FOR SITE PLAN CONTROL	T.K
1	22/04/07	ISSUED FOR SITE PLAN CONTROL	T.K

STAMPS:

DESIGNED BY	APPROVED BY

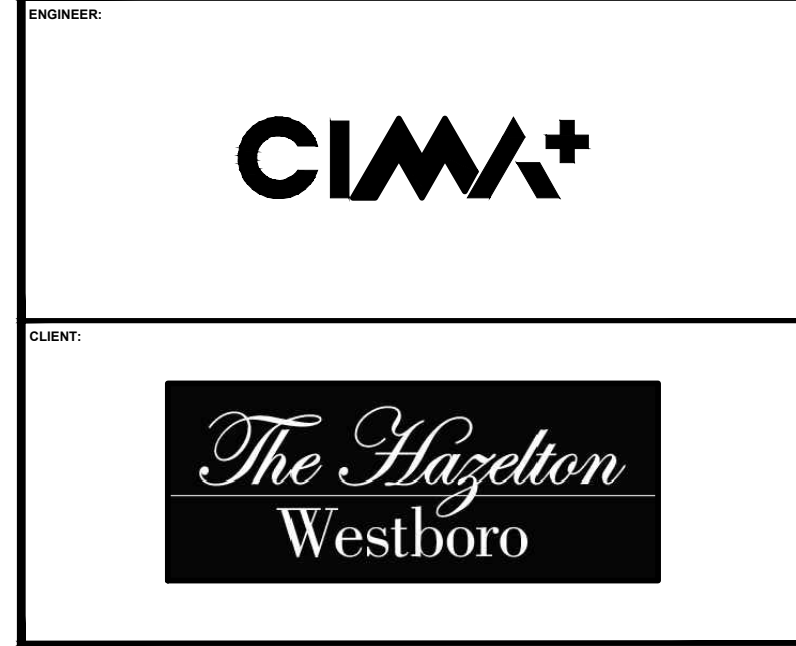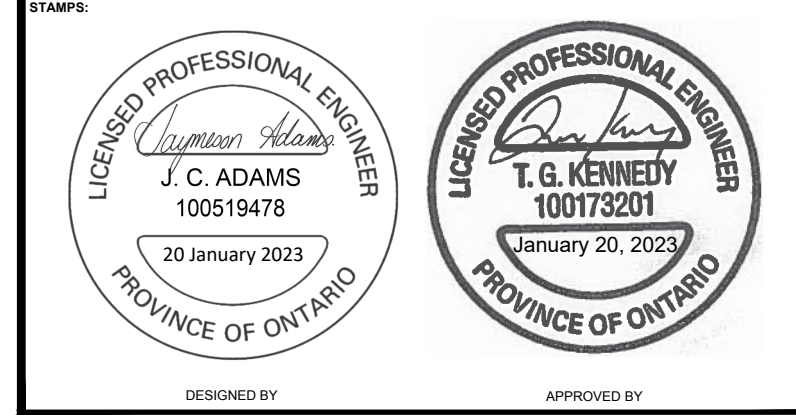

PROJECT NAME:
403 RICHMOND ROAD & 389 ROOSEVELT AVENUE

SHEET TITLE:
GRADE CONTROL AND DRAINAGE PLAN

DISCIPLINE: CIVIL

DRAWN BY: S.C. POGGIOLI	SCALE: 1:200
DESIGNER: J. ADAMS	DATE: 2022/04/07
APPROVER: T. KENNEDY	APPROVER: T. KENNEDY
PROJECT NO: A001046	DRAWING NO: C005
SHEET NO: 5 of 12	

NOTE OF CAUTION

THE GEODETIC COORDINATES OF EVERY ITEM INCLUDED AS PART OF THIS DOCUMENT ARE IN NAD83 - ORIGINAL / MTM - REFERENCE SYSTEM AND HAVE NO LEGAL VALUE. THE SITE LAYOUT MUST BE COMPLETED USING THE OFFICIAL BENCHMARKS OF AN ACCREDITED LAND SURVEYOR IN THE NAD83 - ORIGINAL / MTM - REFERENCE SYSTEM.

THE UNDERGROUND FEATURES AND INFORMATION THAT APPEAR ON THE DRAWINGS WERE OBTAINED FROM THE PUBLIC UTILITY COMPANIES AND/OR FROM THE CITY EACH RESPECTIVELY.

ALL INFORMATION UNDER THE LEGEND 'EXISTING' IS FOR INFORMATION ONLY. COMPLETE OR EXACT LOCATION AND ELEVATION OF UNDERGROUND SERVICES ARE NOT GUARANTEED.


CERTAIN UNDERGROUND FEATURES ON PRIVATE PROPERTY ARE NOT SHOWN ON THE CURRENT DRAWING.

ANYONE WHO PROCEEDS WITH EXCAVATION WORK SHALL VERIFY THE EXACT LOCATION OF ALL UNDERGROUND FEATURES, BY EXPLORATORY EXCAVATIONS, AND SHALL ASSUME FULL RESPONSIBILITY IF THERE IS ANY DAMAGE THAT OCCURS DURING WORK.

THE CONTRACTOR WILL HAVE THE RESPONSIBILITY AND THE OBLIGATION TO VALIDATE, BY EXPLORATORY EXCAVATION, THE SIZE OF THE PUBLIC UTILITIES UNDERGROUND SERVICES AND TO WARN THE ENGINEER OF ANY CONFLICT WITH THE PROJECTED WORK.







D07-12-22-0067

TITLE BLOCK 24238 VERT ENG 3.0
 PRINT DATE: 2023/01/20 / PAPER SIZE: ISO A4 (210.00 x 297.00 MM)
 PATH: Z:\Cma-C\101\Projects\A\1000\1000-ADD\1699\A01046_003 Richmond - Servicing Report\dwg\LA\OUT_0006

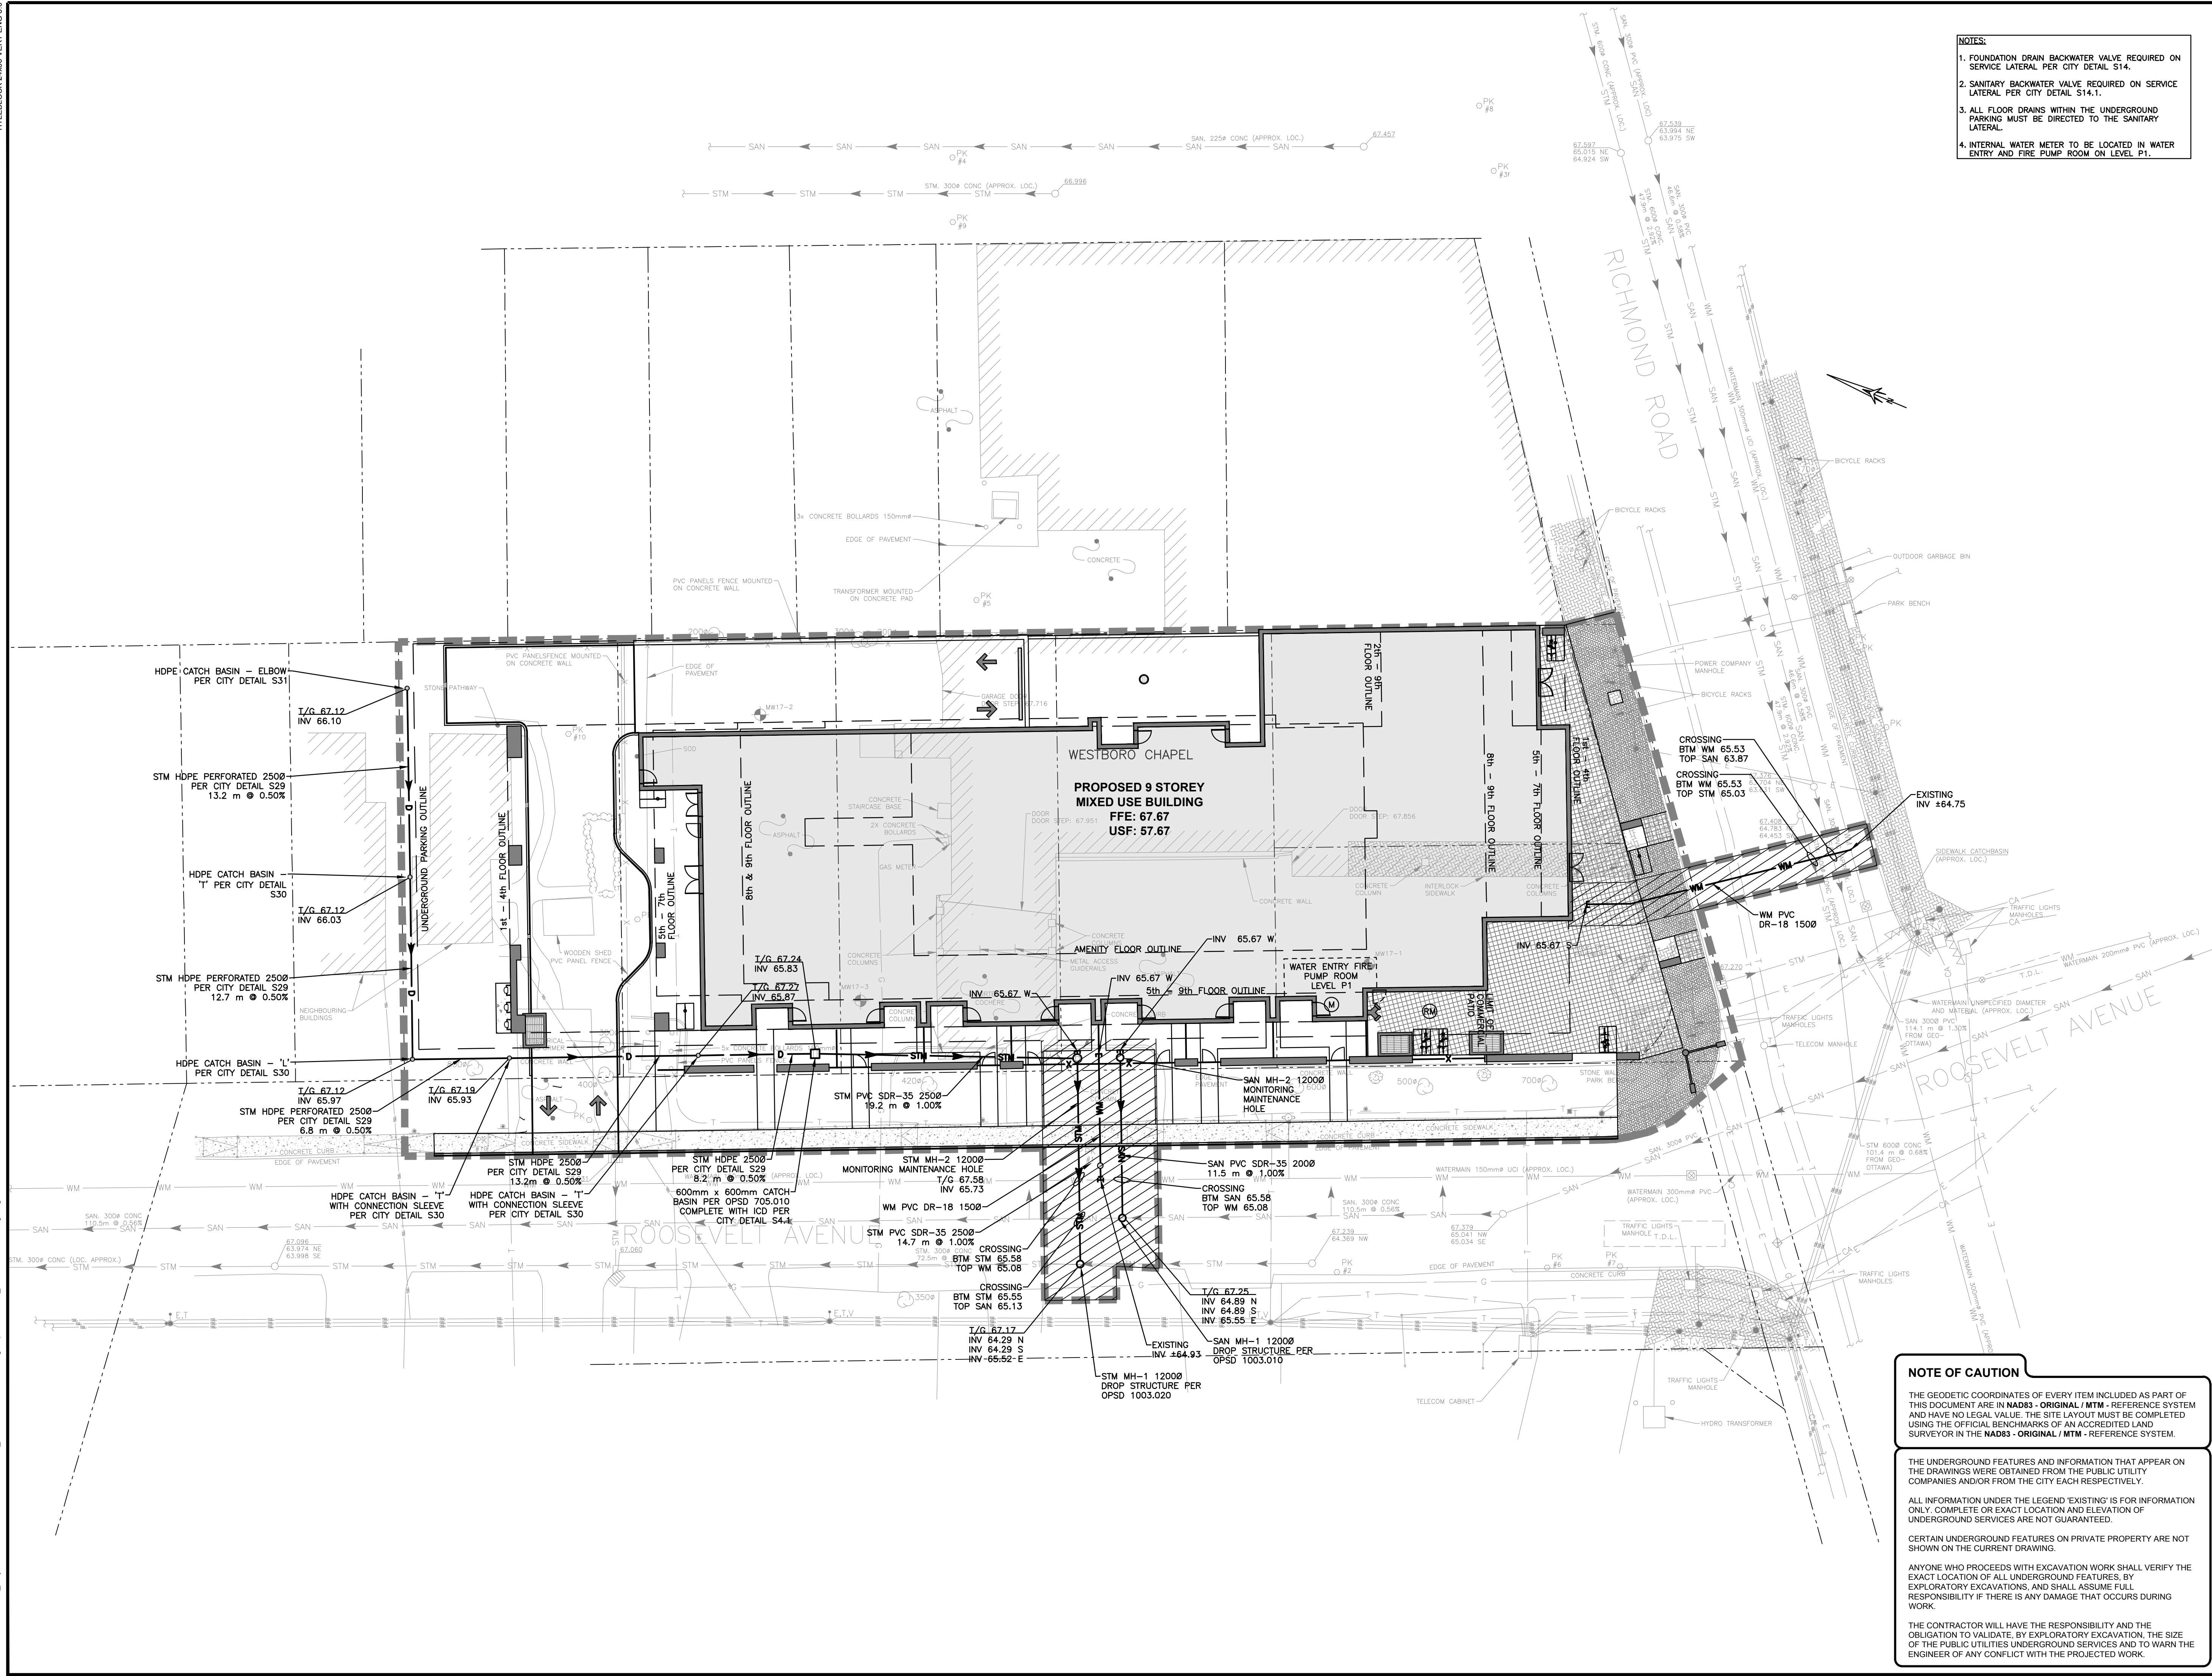

- NOTES:**
1. FOUNDATION DRAIN BACKWATER VALVE REQUIRED ON SERVICE LATERAL PER CITY DETAIL S14.
 2. SANITARY BACKWATER VALVE REQUIRED ON SERVICE LATERAL PER CITY DETAIL S14.1.
 3. ALL FLOOR DRAINS WITHIN THE UNDERGROUND PARKING MUST BE DIRECTED TO THE SANITARY LATERAL.
 4. INTERNAL WATER METER TO BE LOCATED IN WATER ENTRY AND FIRE PUMP ROOM ON LEVEL P1.

EXISTING	PROPOSED
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM
SAN	SAN
STM	STM
D	D
G	G
T	T
CA	CA
E	E
WM	WM

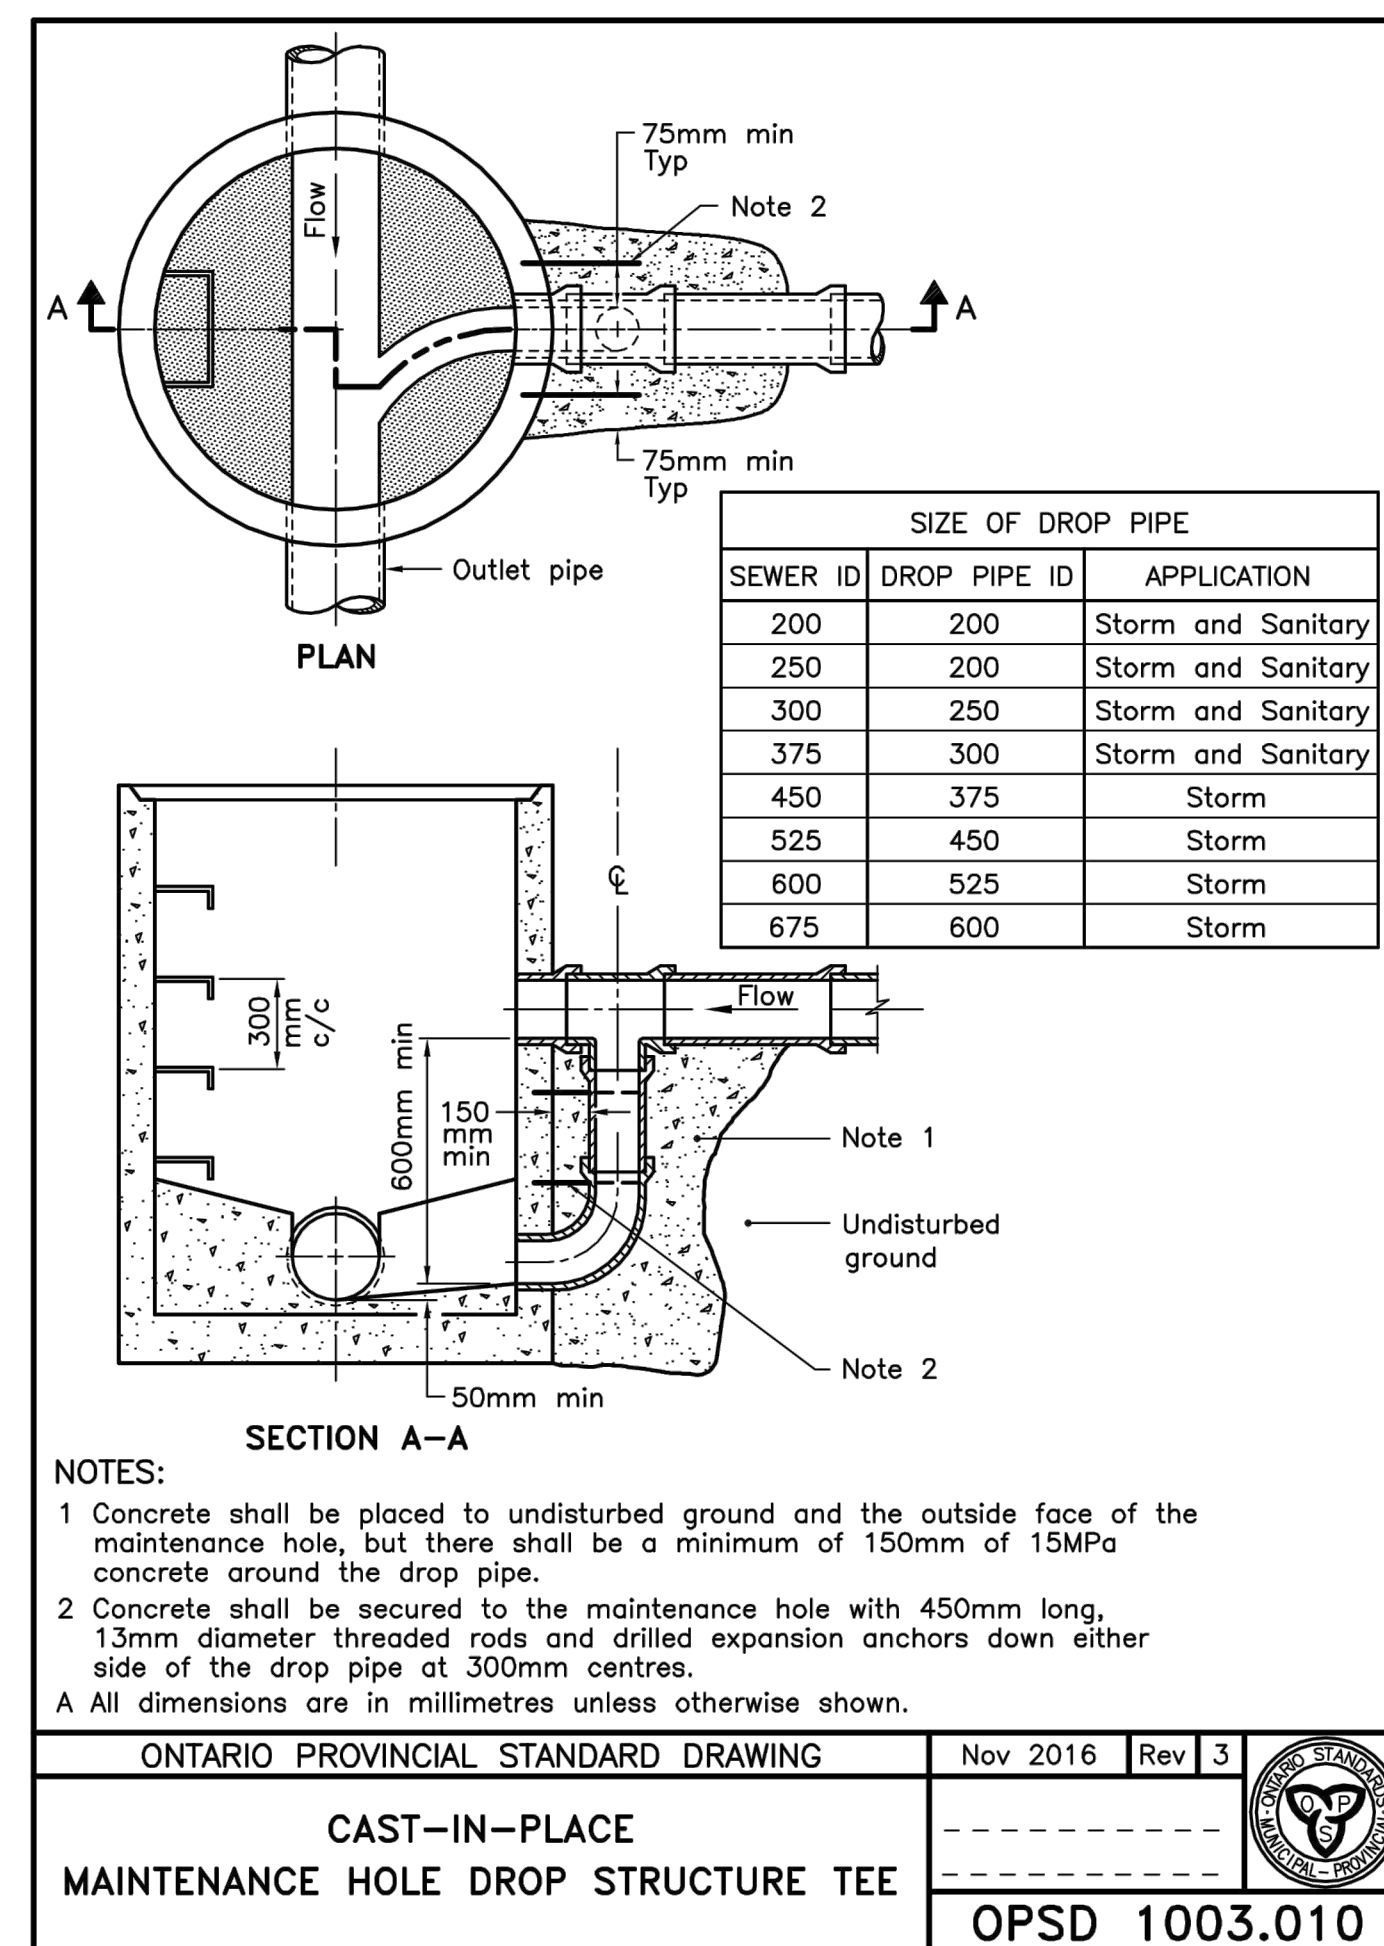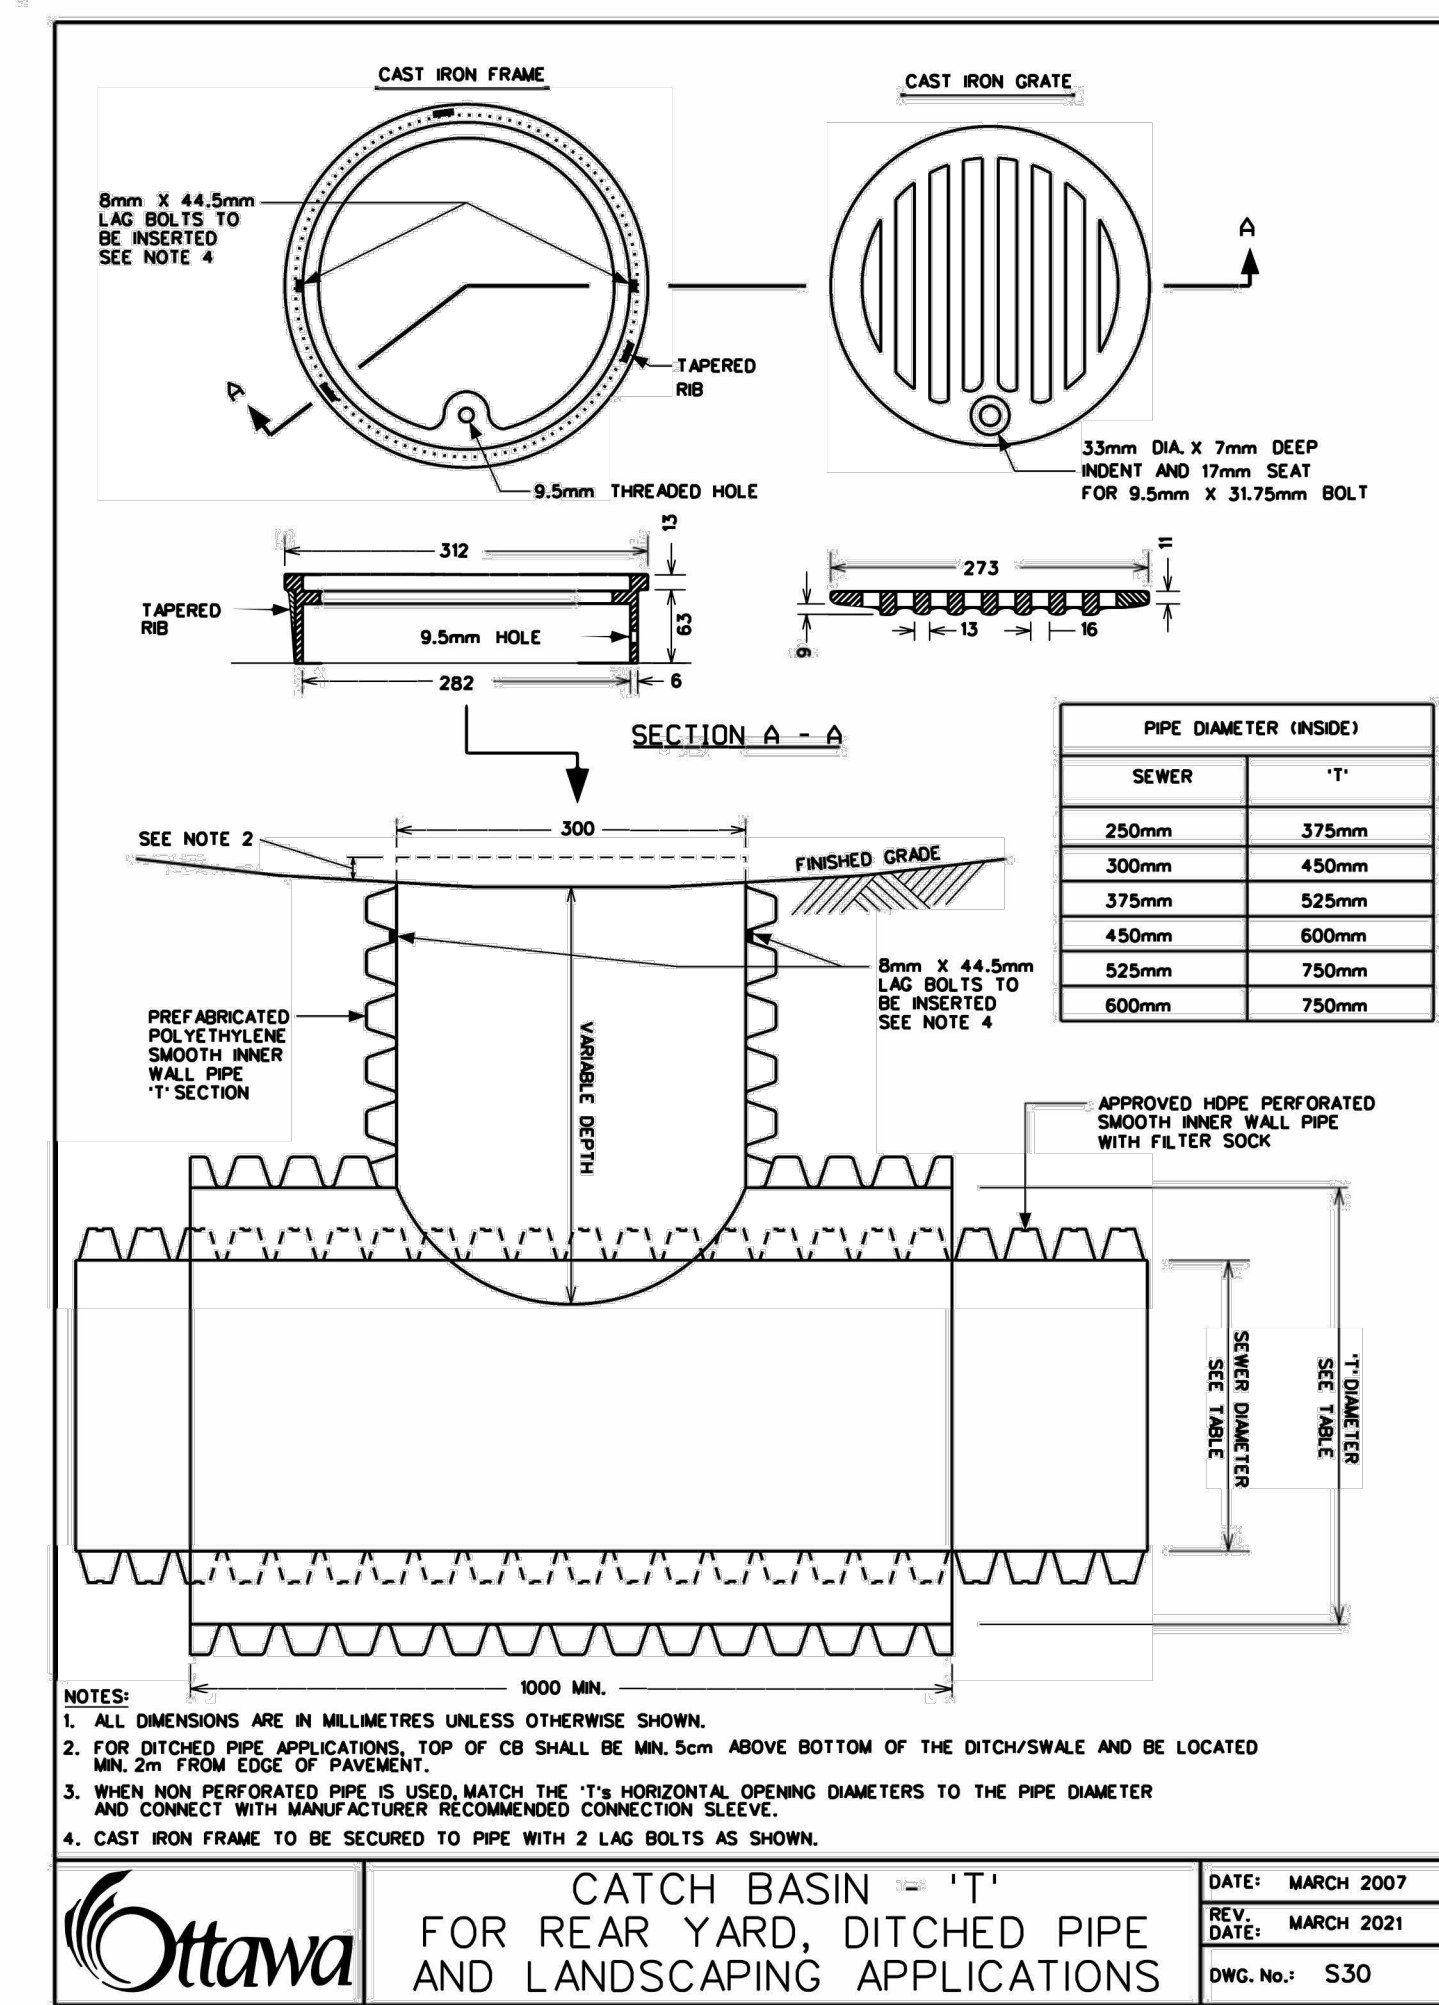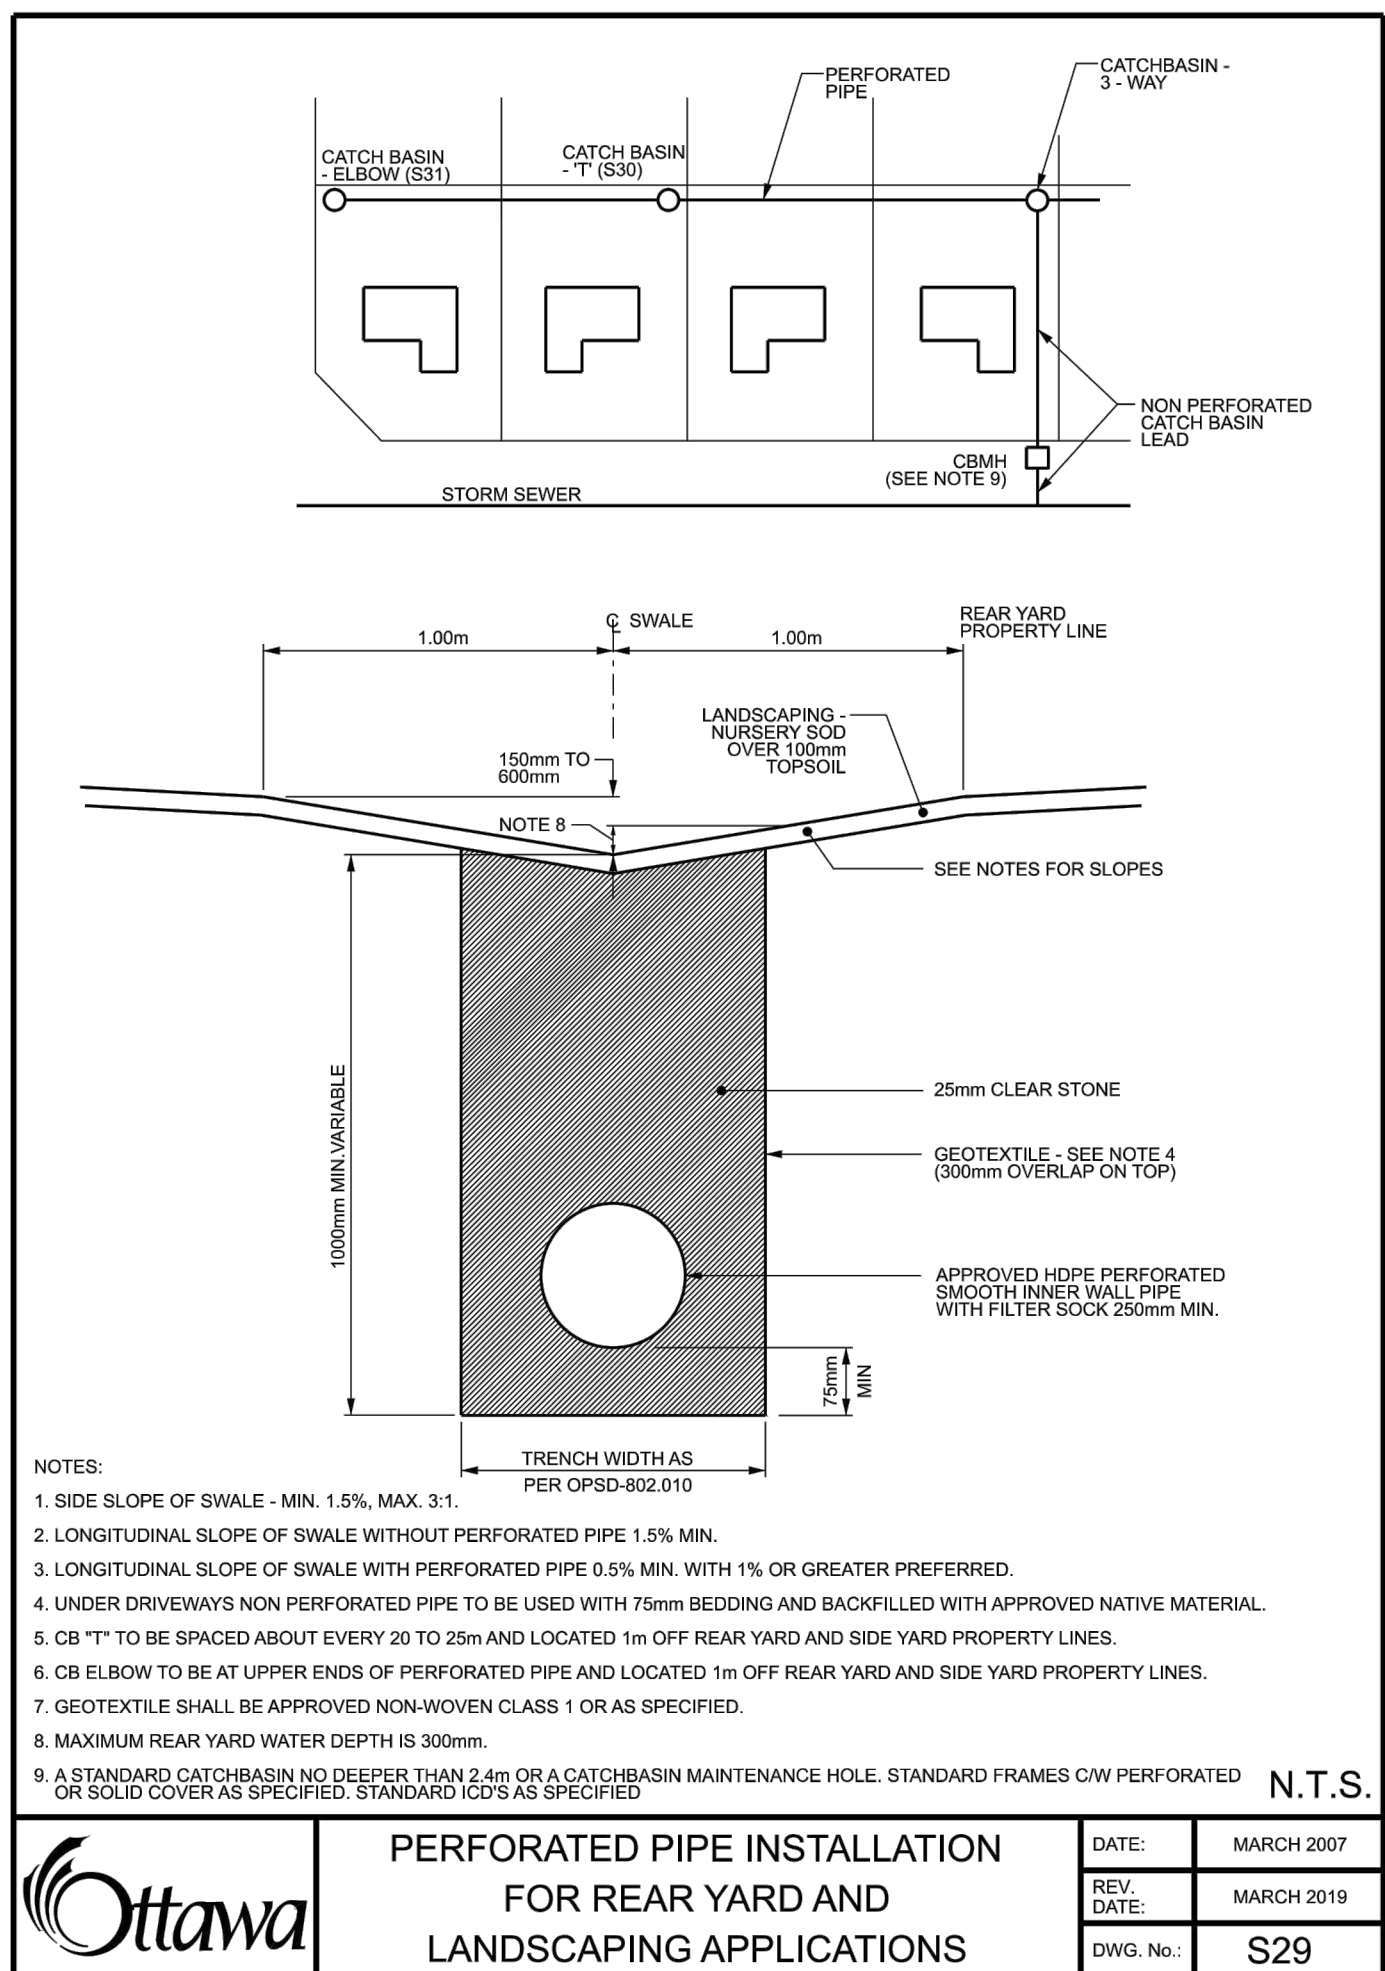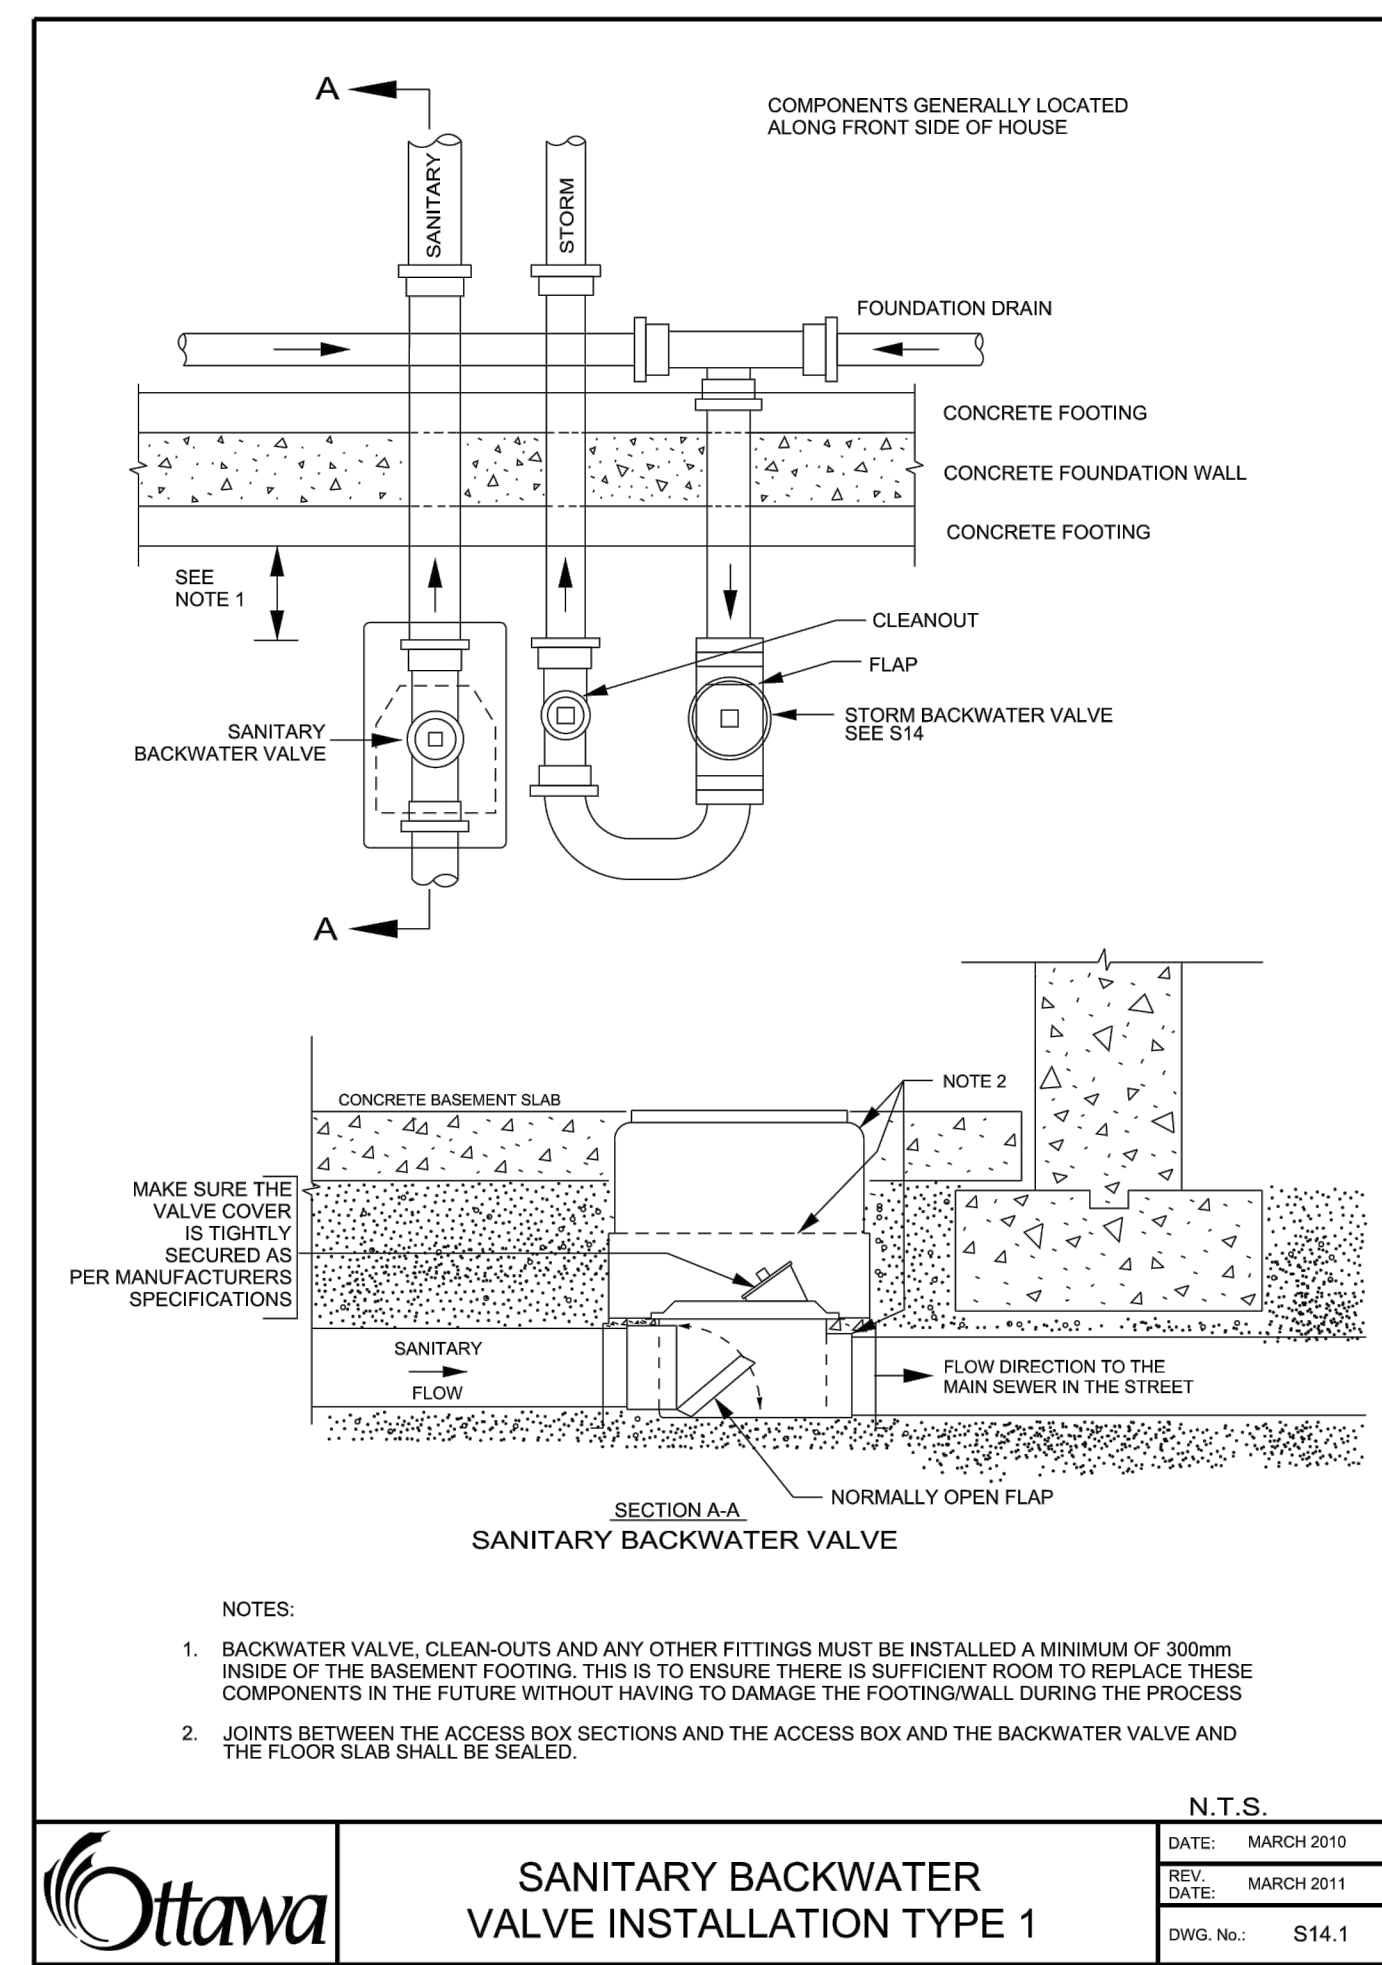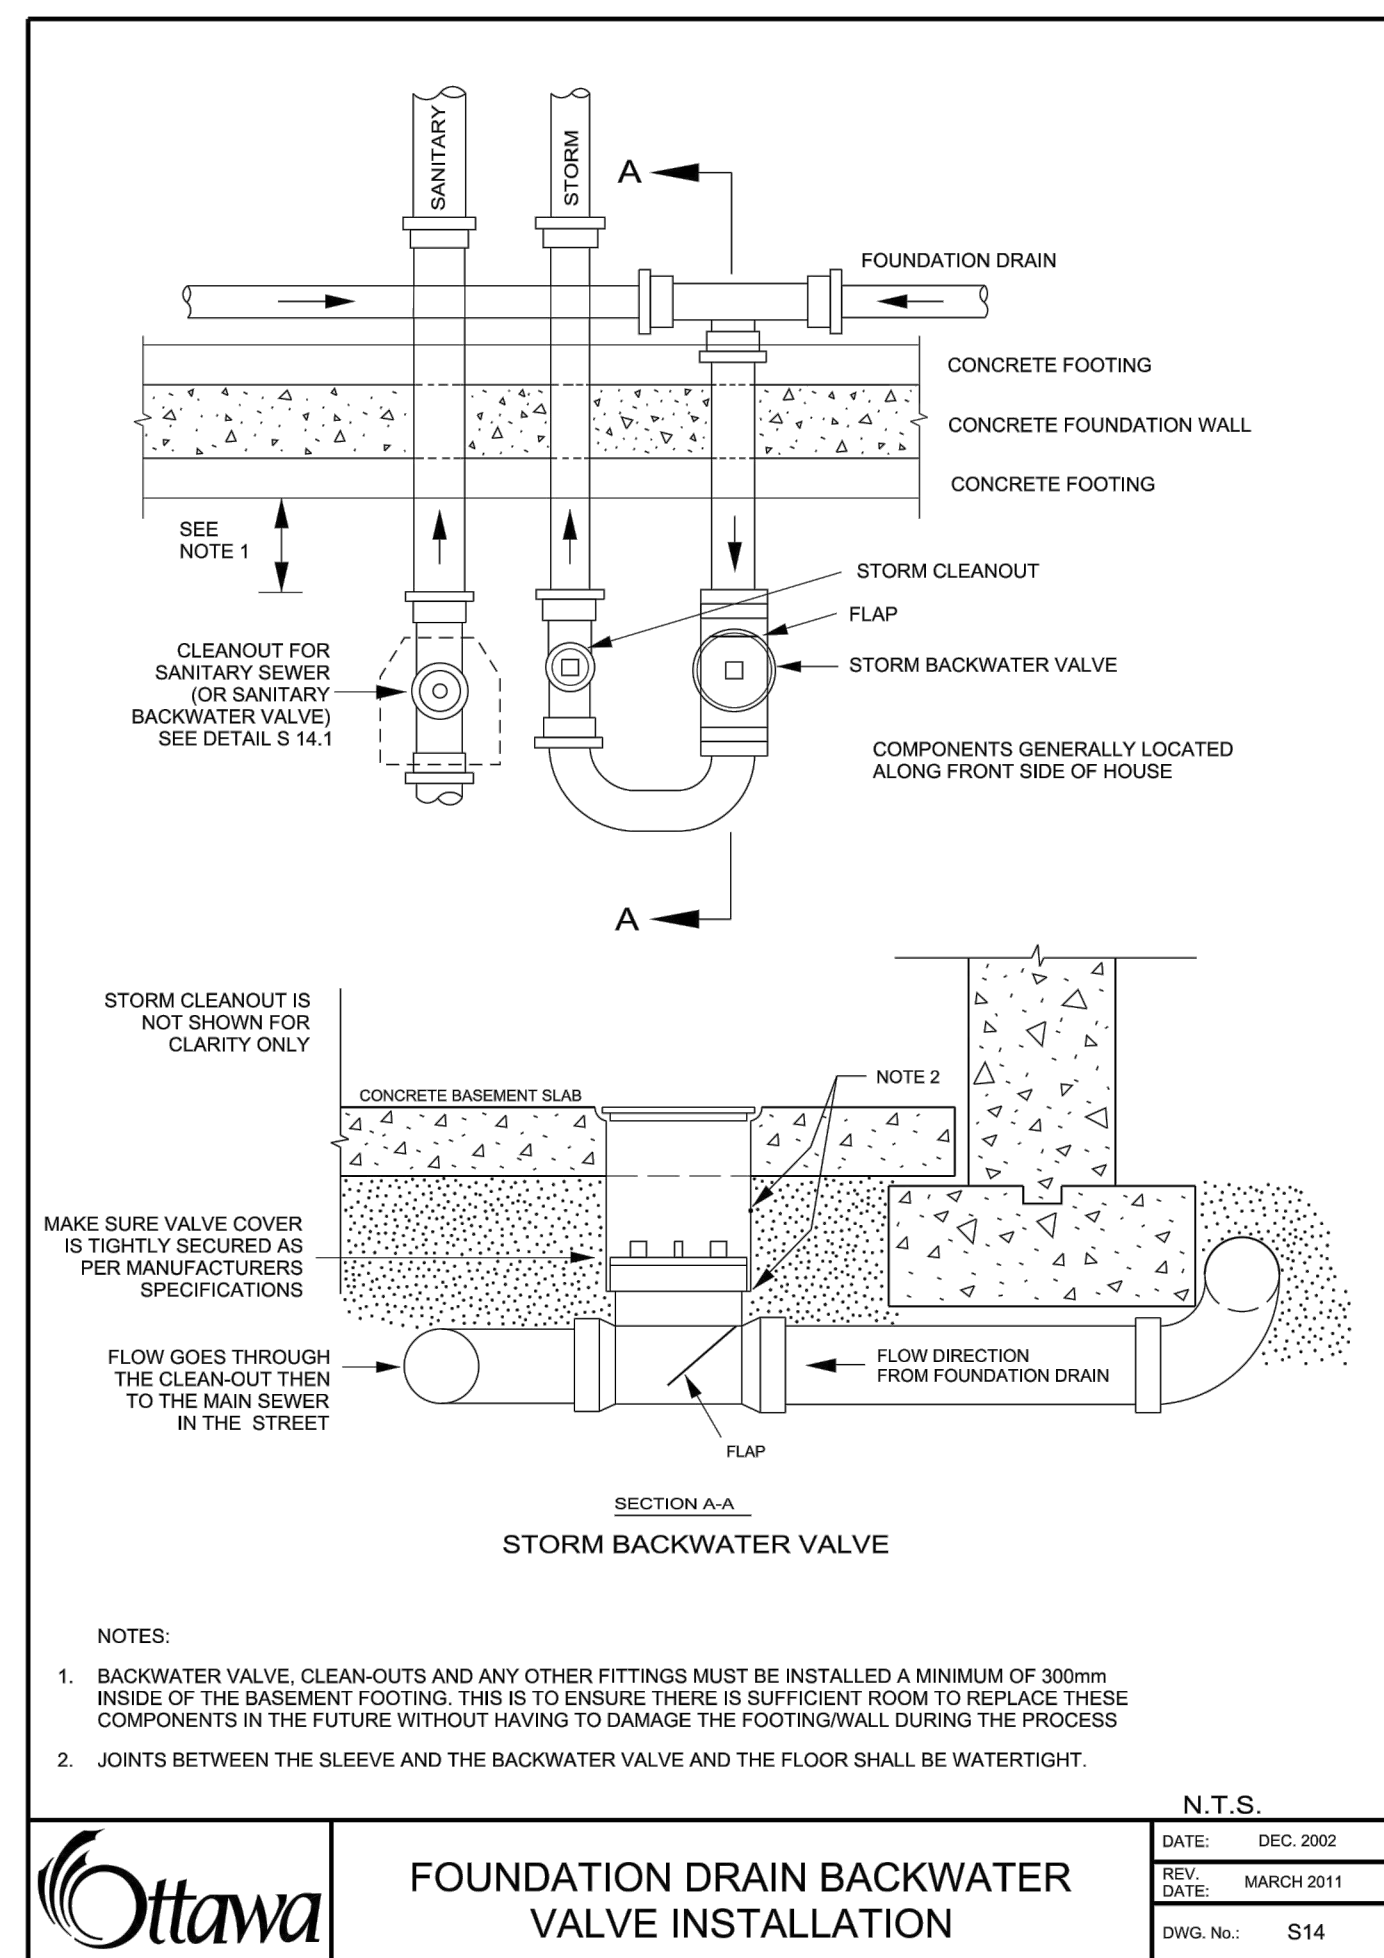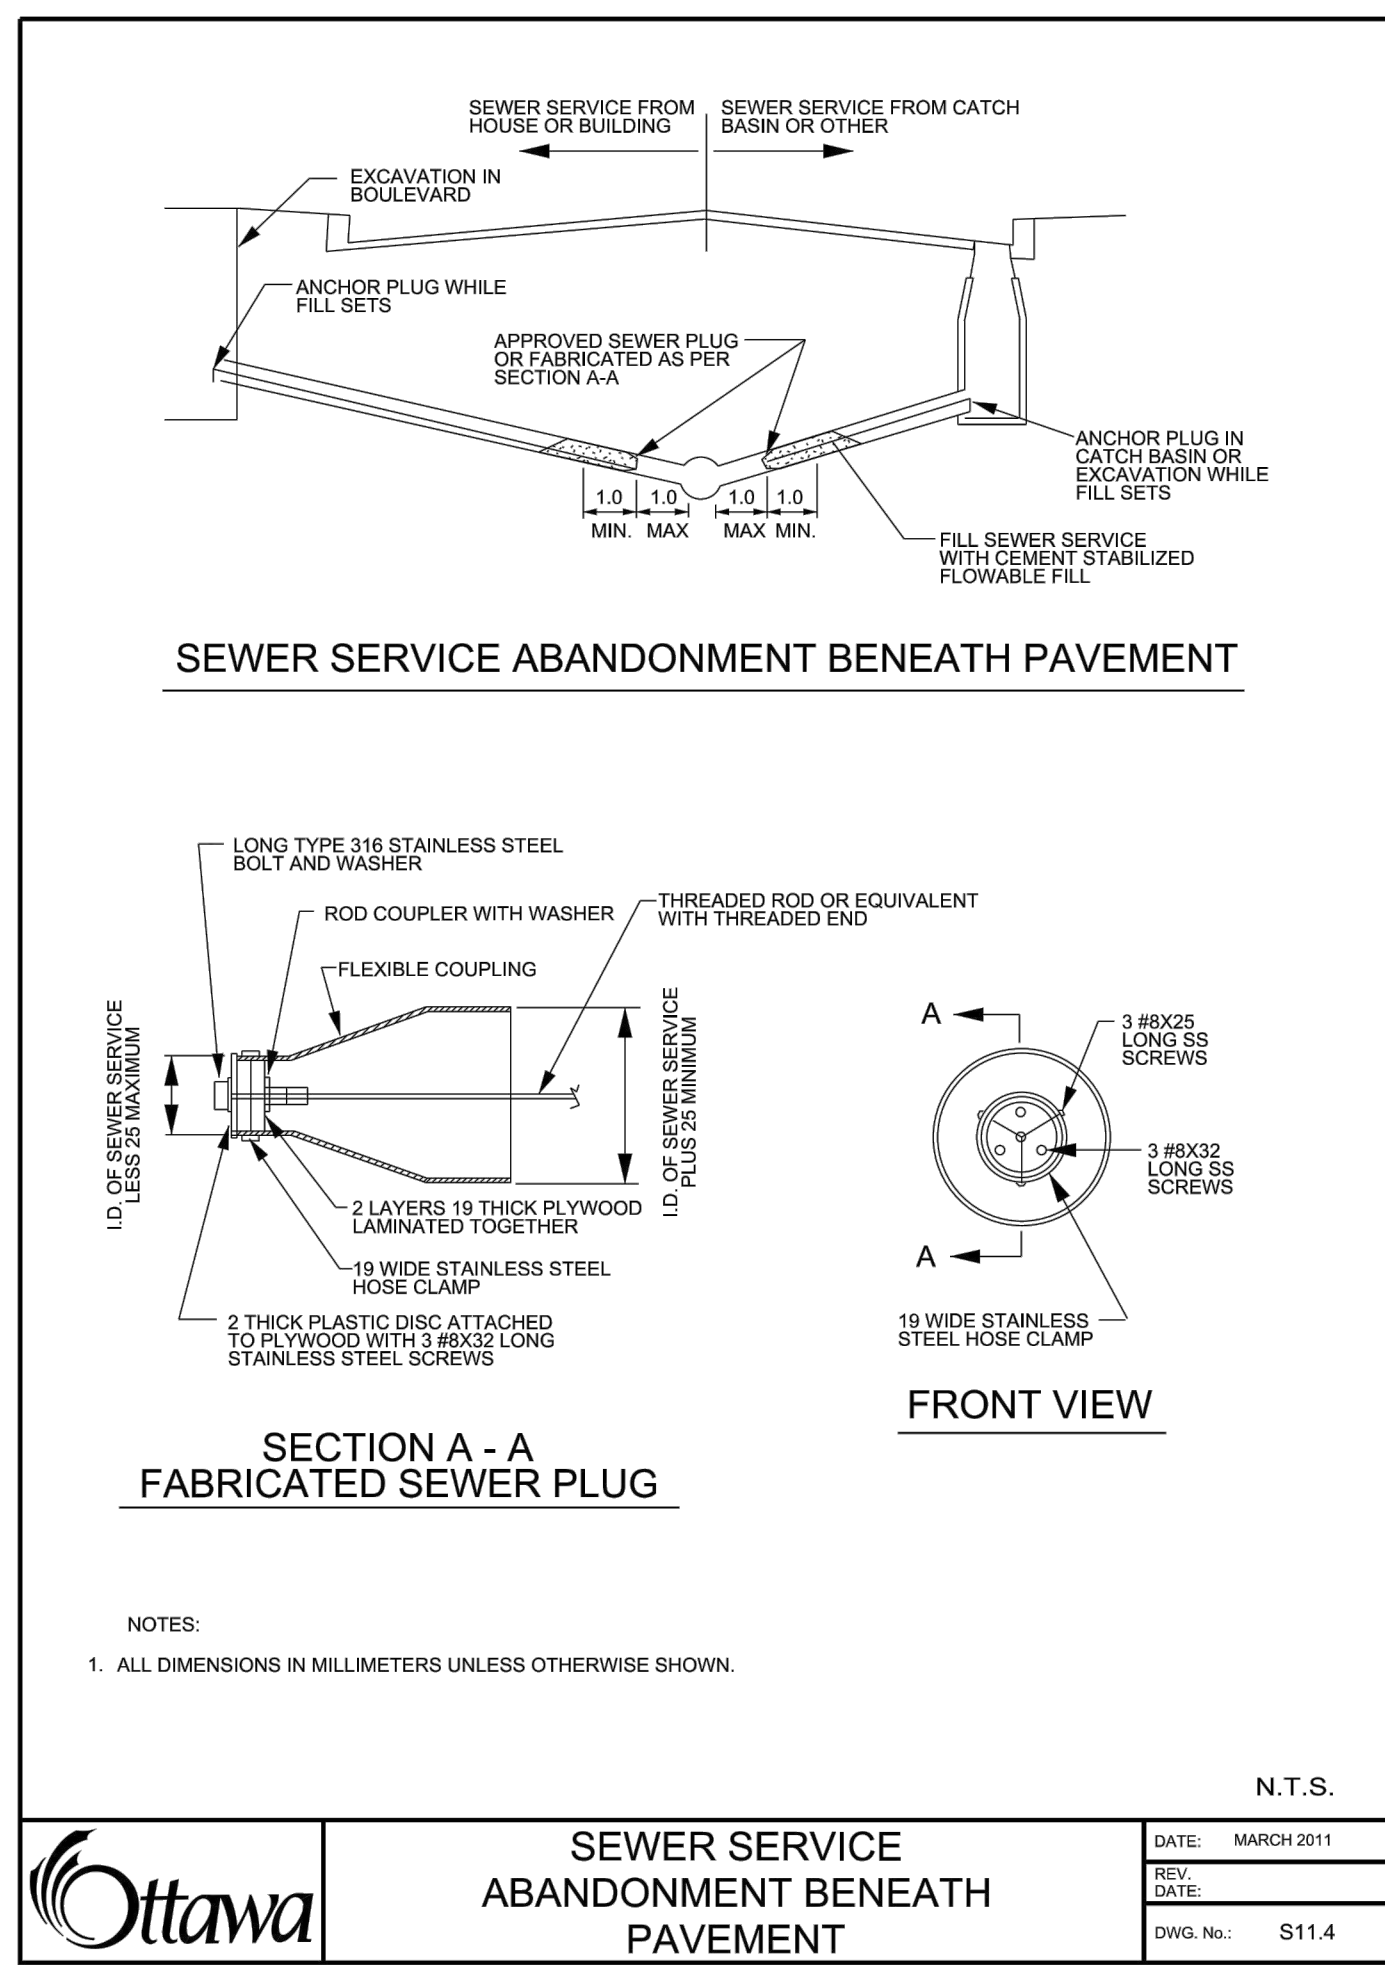

No.	Date	Description	By
4	23/01/20	RE-ISSUED FOR SITE PLAN CONTROL	T.K
3	22/11/07	RE-ISSUED FOR SITE PLAN CONTROL	T.K
2	22/10/14	RE-ISSUED FOR SITE PLAN CONTROL	T.K
1	22/04/07	ISSUED FOR SITE PLAN CONTROL	T.K

DESIGNED BY:

APPROVED BY:

ENGINEER:

CUSTOMER:

PROJECT NAME:
403 RICHMOND ROAD & 389 ROOSEVELT AVENUE

SHEET TITLE:
DETAILS PLAN

DISCIPLINE:
CIVIL

DRAWER: S.C. POGGIOLI
DESIGNER: T. KENNEDY
APPROVER: T. KENNEDY
PROJECT No.: A001046
SHEET No.: 9 of 12

SCALE:
DATE: 2022/04/07
APPROVER: T. KENNEDY
DRAWING No.: C009

SEWER ID	DROP PIPE ID
200	200
250	200
300	250
375	300

NOTES:
 1 Concrete shall be placed to undisturbed ground and the outside face of the maintenance hole, but there shall be a minimum of 150mm of 15MPa concrete around the drop pipe.
 2 Concrete shall be secured to the maintenance hole with 450mm long, 13mm diameter threaded rods and drilled expansion anchors down either side of the drop pipe at 300mm centres.
 A All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2016 Rev 3
CAST-IN-PLACE MAINTENANCE HOLE DROP STRUCTURE WYE
 OPSD 1003.020

NOTES:
 A This OPSD shall be read in conjunction with OPSD 610.010 and 610.020.
 B All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2018 Rev 3
CAST IRON, SQUARE FRAME WITH SQUARE FLAT GRATE FOR CATCH BASINS, HERRING BONE OPENINGS
 OPSD 400.020

NOTES:
 A Covers shall be Type A or Type B, as specified.
 B All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2018 Rev 4
CAST IRON, SQUARE FRAME WITH CIRCULAR CLOSED OR OPEN COVER FOR MAINTENANCE HOLES
 OPSD 401.010

NOTES:
 1 The sump is measured from the lowest invert.
 A Granular backfill shall be placed to a minimum thickness of 300mm all around the maintenance hole.
 B Precast concrete components shall be according to OPSD 701.030, 701.031, or 701.032.
 C Structure exceeding 5.0m in depth shall include safety platform according to OPSD 404.020.
 D Pipe support according to OPSD 708.020.
 E For benching and pipe opening details, see OPSD 701.021.
 F For adjustment unit and frame installation, see OPSD 704.010.
 G All dimensions are nominal.
 H All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 5
PRECAST CONCRETE MAINTENANCE HOLE 1200mm DIAMETER
 OPSD 701.010

Maintenance Hole Diameter	No. 1-4			No. 5 and 6		No. 8		No. 7	
	Inlet	Hole	Outlet	Inlet	Hole	Inlet	Hole	Inlet	Hole
1200	700	860	780	700	860	700	860	700	860
1500	860	1220	960	860	1170	860	1170	860	1170
1800	1220	1485	1220	1220	1485	1220	1485	1220	1485
2400	1485	2020	1760	1485	2020	1485	2020	1485	2020
3000	1930	2450	2300	1930	2450	1930	2450	1930	2450
3600	2470	3085	2730	2470	3085	2470	3085	2470	3085

NOTES:
 1 Slopes shall be maintained from the outlet hole opening for top of benching.
 A Concrete for benching shall be 30MPa.
 B When benching is hand-finished, it shall be given wood float finish, channel shall be given steel trowel finish.
 C Benching slope and height shall be as specified.
 D When specified, maintenance holes that are 1200mm in diameter with a uniform channel for 200 or 250mm pipe may be pre-benched at the manufacturer with standardized benching slope and channel orientation.
 E All dimensions are nominal.
 F All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 4
MAINTENANCE HOLE BENCHING AND PIPE OPENING ALTERNATIVES
 OPSD 701.021

NOTES:
 1 If first step is in an adjustment unit, the adjustment unit shall be of the type manufactured with a step in place.
 2 Centre reinforcing in adjustment unit ±10mm.
 3 Round and square adjustment units are available in sizes of 50, 75, 100, 150, and 300mm.
 A Adjustment units shall not extend beyond the outside edge of the structure.
 B All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 3
PRECAST CONCRETE ADJUSTMENT UNITS FOR MAINTENANCE HOLES, CATCH BASINS, AND VALVE CHAMBERS
 OPSD 704.010

4	23/01/20	RE-ISSUED FOR SITE PLAN CONTROL	T.K
3	22/11/07	RE-ISSUED FOR SITE PLAN CONTROL	T.K
2	22/10/14	RE-ISSUED FOR SITE PLAN CONTROL	T.K
1	22/04/07	ISSUED FOR SITE PLAN CONTROL	T.K

DESIGNED BY: J.C. ADAMS
 APPROVED BY: T.G. KENNEDY

CIMA+

The Hazelton Westboro

PROJECT NAME: 403 RICHMOND ROAD & 389 ROOSEVELT AVENUE

SHEET TITLE: DETAILS PLAN

DISCIPLINE: CIVIL

DRAWER: S.C. POGGIOLI
 DESIGNER: T. KENNEDY
 APPROVER: T. KENNEDY
 PROJECT NO: A001046
 SHEET NO: 10 of 12

SCALE: 2022/04/07
 DATE: 2022/04/07
 DRAWING NO: T. KENNEDY
 C910

10 of 12

ALTERNATE STANDARD HEIGHTS	
ALTERNATIVE	DIMENSION
A	1980
B	1830
C	1520
D	1380

PLAN

SECTION A-A

SECTION B-B

NOTES:

- Outlet hole size 525mm diameter maximum, location as required.
- 200mm diameter knockout to accommodate subdrain. Knockout shall be 60mm deep.
- Centre reinforcing in base slab and walls ±20mm.
- Granular backfill shall be placed to a minimum thickness of 300mm all around the catch basin.
- Frame, grate, and adjustment units shall be installed according to OPSD 704.010.
- Pipe support shall be according to OPSD 708.020.
- All dimensions are nominal.
- All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2019 Rev 4

PRECAST CONCRETE CATCH BASIN
600x600mm

OPSD 705.010

PIPE IN SUPPORTED EXCAVATION

PIPE IN UNSUPPORTED EXCAVATION

LEGEND:
D - Inside diameter

NOTES:

- Height of fill is measured from the finished surface to top of pipe.
- The pipe bed shall be compacted and shaped to receive the bottom of the pipe.
- Pipe culvert frost treatment shall be according to OPSD 803.030 and 803.031.
- Condition of excavation is symmetrical about centreline of pipe.

A Granular material placed in the haunch area shall be compacted prior to placing and compacting the remainder of the embedment material.

B Soil types as defined in the Occupational Health and Safety Act and Regulations for Construction Projects.

C All dimensions are in metres unless otherwise shown.

Pipe Inside Diameter mm	Clearance mm
900 or less	300
Over 900	500

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 3

FLEXIBLE PIPE EMBEDMENT AND BACKFILL EARTH EXCAVATION

OPSD 802.010

PIPE IN SUPPORTED EXCAVATION

PIPE IN UNSUPPORTED EXCAVATION

LEGEND:
D - Inside diameter
* - Type 1 or 2 soil
** - Type 3 soil
*** - Type 4 soil

NOTES:

- Height of fill is measured from the finished surface to top of pipe.
- The pipe bed shall be compacted and shaped to receive the bottom of the pipe.
- Pipe culvert frost treatment shall be according to OPSD 803.030 and 803.031.
- Condition of excavation is symmetrical about centreline of pipe.
- Embedment material shall be wrapped in non-woven geotextile when specified.

A Granular material placed in the haunch area shall be compacted prior to placing and compacting the remainder of the embedment material.

B Soil types as defined in the Occupational Health and Safety Act and Regulations for Construction Projects.

C Fractured rock shall be treated as Type 1 soil.

D All dimensions are in metres unless otherwise shown.

Pipe Inside Diameter mm	Clearance mm
900 or less	300
Over 900	500

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 3

FLEXIBLE PIPE EMBEDMENT AND BACKFILL ROCK EXCAVATION

OPSD 802.013

INSULATION REFERENCE TABLE

D DISTANCE FROM C.B. OR WALL	REQUIRED INSULATION THICKNESS T1, T2
2400 - 1800 mm	50 mm
1800 - 1500 mm	75 mm
1500 - 1200 mm	100 mm
1200 - 900 mm	125 mm

NOTES:

- FOR 150 - 400mm (NOMINAL DIAMETER) WATERMANS, WHERE THE DEPTH OF COVER IS LESS THAN 2400mm
- INCREMENTS OF THICKNESS SHALL BE ADJUSTABLE TO 25mm.
- IN PROXIMITY OF MAINTENANCE HOLES, CULVERTS, CATCHBASINS, ETC., INSULATION SHALL BE PLACED PER DETAIL W23
- DEPTH OF COVER LESS THAN 1200mm REQUIRES SPECIAL DESIGN
- STAGGER JOINTS OF MULTIPLE SHEETS.
- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.

DATE: MAY 2001
REV. DATE: MARCH 2013
DWG. No.: W22

THERMAL INSULATION FOR WATERMANS IN SHALLOW TRENCHES

INSULATION REFERENCE TABLE

D DISTANCE FROM C.B. OR WALL	REQUIRED INSULATION THICKNESS T1, T2
2400 - 1800 mm	50 mm
1800 - 1500 mm	75 mm
1500 - 1200 mm	100 mm
1200 - 900 mm	125 mm

NOTES:

- FOR WATERMANS & SERVICES IN PROXIMITY TO CATCHBASINS MAINTENANCE HOLES, CULVERTS, ETC.
- INSULATION SHALL EXTEND 1000 mm EACH WAY FROM THE ENDS OF THE STRUCTURE, PARALLEL TO THE WATERMAIN.
- STAGGER JOINTS OF MULTIPLE SHEETS.
- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
- INSULATION CAN BE AT EITHER LOCATION OR BOTH.

DATE: MAY 2001
REV. DATE: FEB 2004
DWG. No.: W23

THERMAL INSULATION OF WATERMANS AT OPEN STRUCTURES

SECTION A-A

VALVE BOX CAP

ADJUSTABLE ROAD LEVELER (ALTERNATIVE)

VALVE BOX ASSEMBLY

NOTES:

- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
- FOR 200 AND 250mm VALVES, ADD BEDDING BELOW THE CONCRETE BLOCKS AS REQUIRED TO RAISE RELL HIGH ENOUGH TO PREVENT CONTACT WITH THE VALVE BONNET.

DATE: MAY 2001
REV. DATE: MARCH 2021
DWG. No.: W24

No.	Date	Description	By
4	23/01/20	RE-ISSUED FOR SITE PLAN CONTROL	T.K
3	22/11/07	RE-ISSUED FOR SITE PLAN CONTROL	T.K
2	22/10/14	RE-ISSUED FOR SITE PLAN CONTROL	T.K
1	22/04/07	ISSUED FOR SITE PLAN CONTROL	T.K

DESIGNED BY: J.C. ADAMS
APPROVED BY: T.G. KENNEDY

CIMA+

The Hazelton Westboro

PROJECT NAME:
403 RICHMOND ROAD & 389 ROOSEVELT AVENUE

SHEET TITLE:
DETAILS PLAN


DISCIPLINE:
CIVIL

DRAWER: S.C. POGGIOLI
DESIGNER: T. KENNEDY
APPROVER: T. KENNEDY
PROJECT No.: A001046
DRAWING No.:

SCALE:
DATE: 2022/04/07
APPROVER: T. KENNEDY


C011

11 of 12

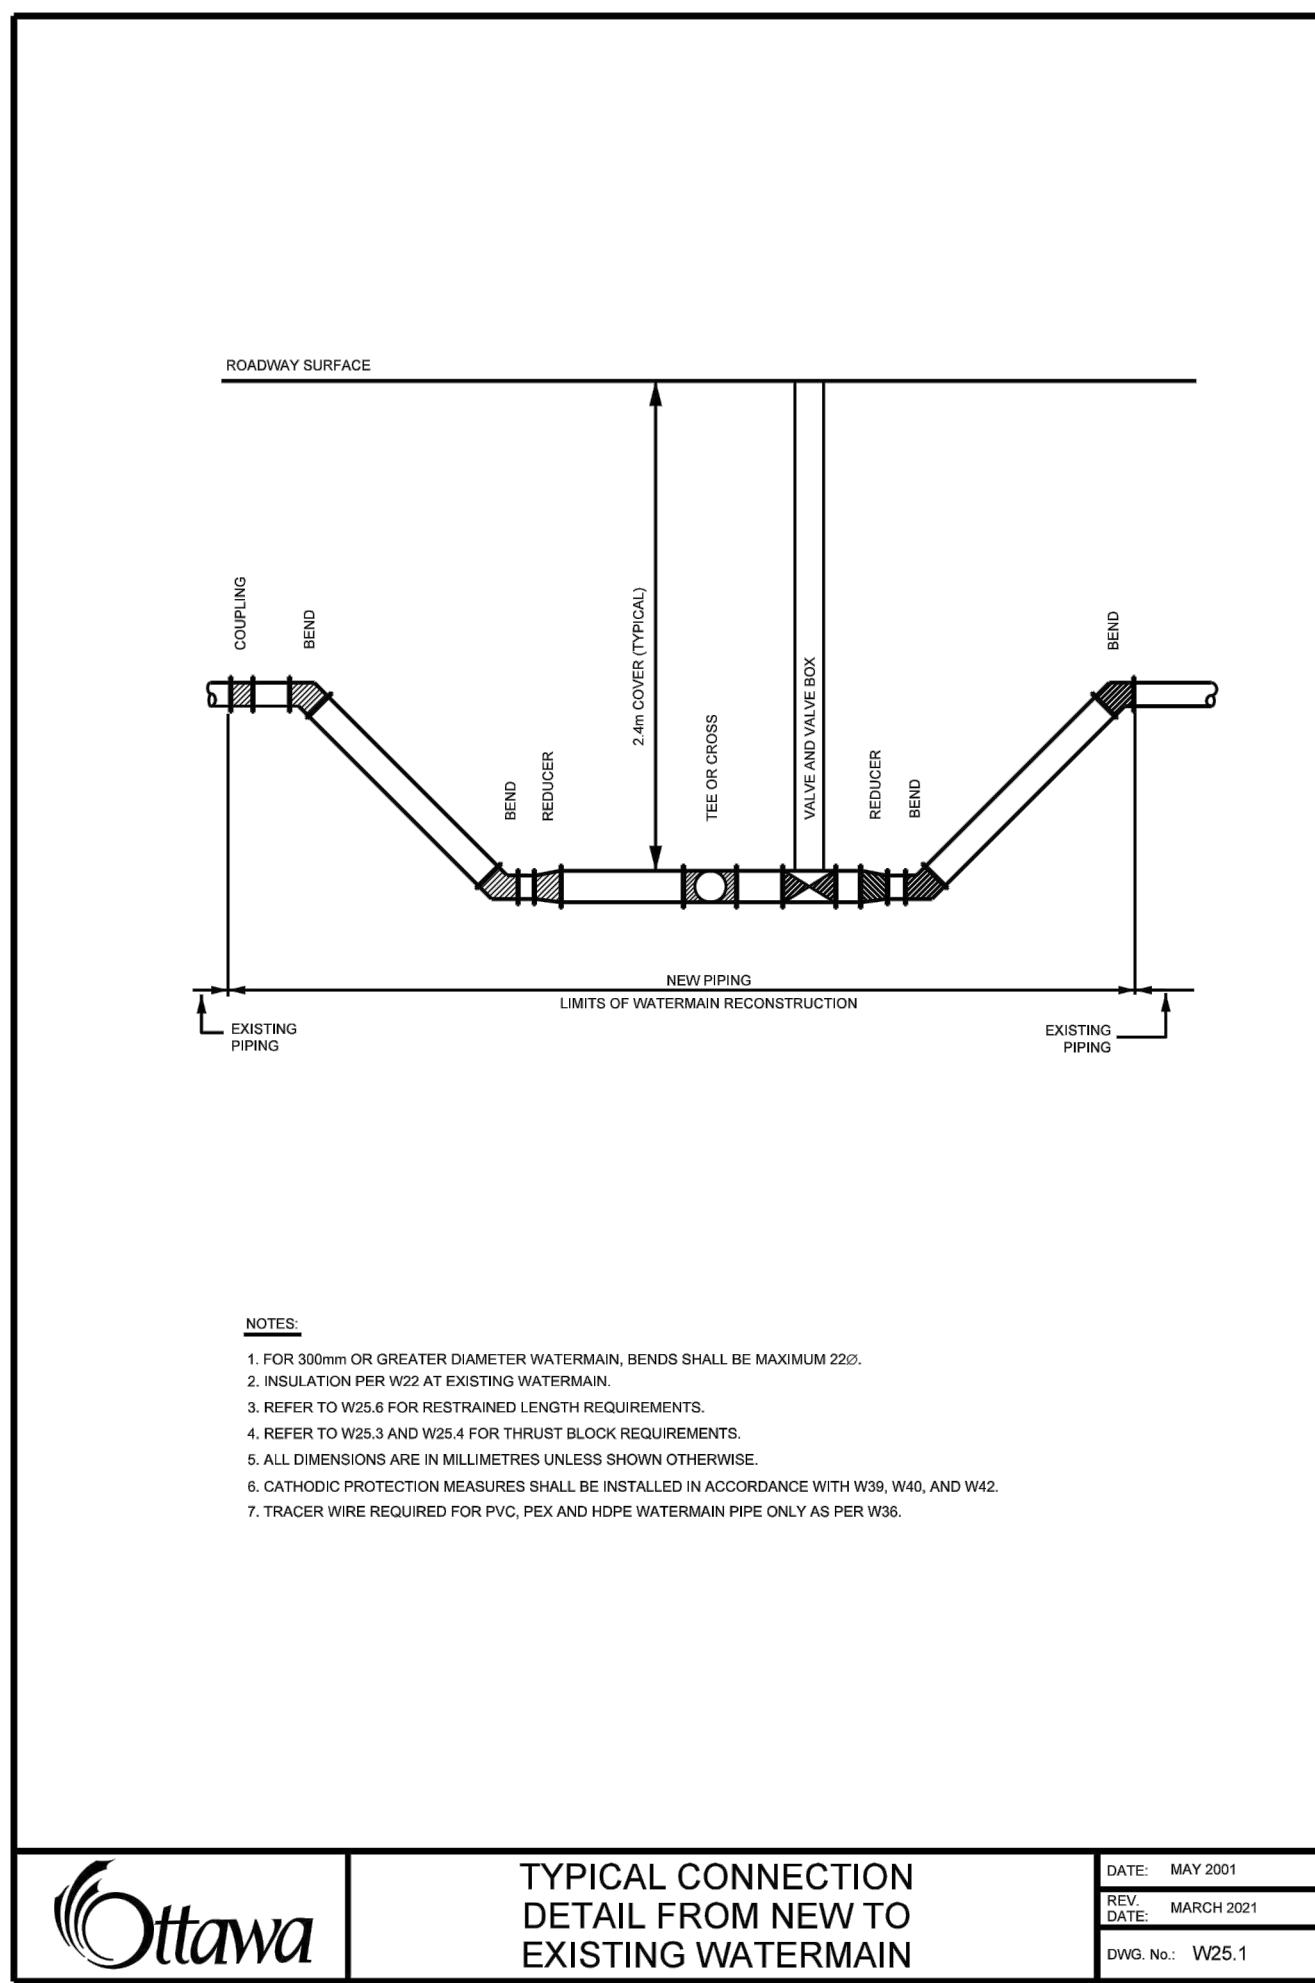

Ottawa TYPICAL CONNECTION DETAIL FROM NEW TO EXISTING WATERMAIN

DATE: MAY 2001
REV. DATE: MARCH 2011
DWG. No.: W25.1

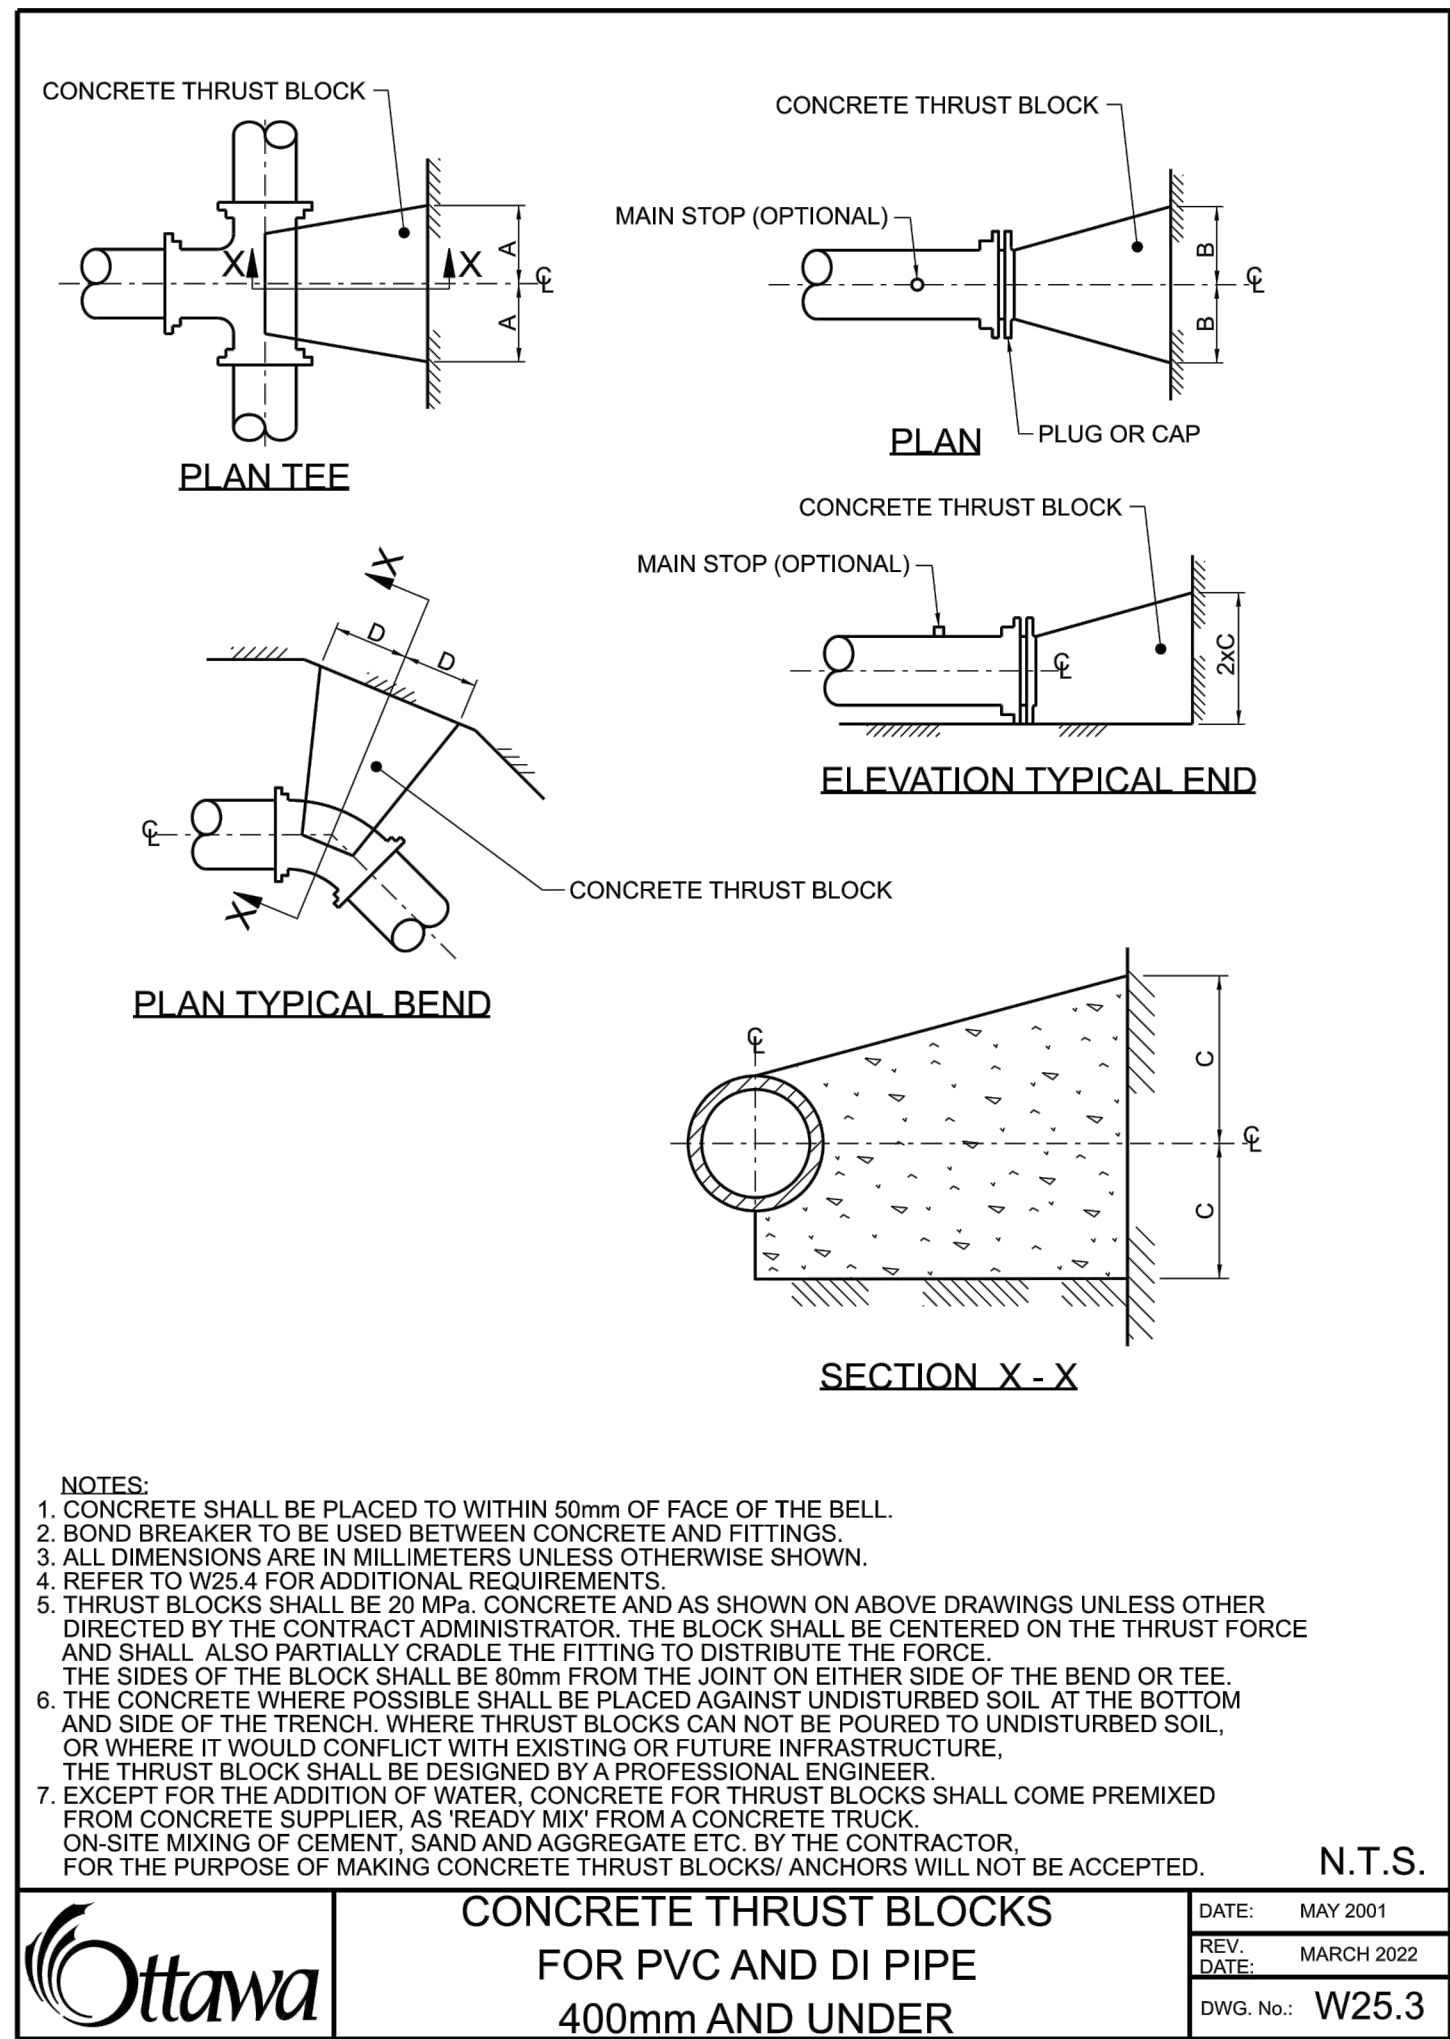

Ottawa CONCRETE THRUST BLOCKS FOR PVC AND DI PIPE 400mm AND UNDER

DATE: MAY 2001
REV. DATE: MARCH 2022
DWG. No.: W25.3

THRUST BLOCK DIMENSION TABLES FOR PVC AND DI PIPE 400mm AND UNDER

DATE: MAY 2001
REV. DATE: MARCH 2011
DWG. No.: W25.4

1. SOIL DESCRIPTION: VERY FINE SANDS, SANDY CLAYS, CLAYS
SOILS WITH TYPICAL BEARING STRENGTH OF 100 TO 199 KPa

PIPE DIAMETER	DIMENSION NOTED ON W25.3			
	A	B	C	D
102	250	250	200	200
152	400	400	250	300
203	550	550	300	450
254	650	650	400	500
305	800	800	450	650
406	1050	1050	600	850

2. SOIL DESCRIPTION: SILTY SAND GRAVELS OR CLAYEY SAND GRAVEL MIXTURES, MODERATE AMOUNT OF FINES.
SOILS WITH TYPICAL BEARING STRENGTH OF 200 TO 299 KPa


PIPE DIAMETER	DIMENSION NOTED ON W25.3			
	A	B	C	D
102	200	200	150	150
152	250	250	200	200
203	350	350	250	270
254	450	450	300	350
305	500	500	350	400
406	750	750	400	600

3. SOIL DESCRIPTION: SANDS, GRAVELS AND GRAVEL-SAND MIXTURES.
SOILS WITH TYPICAL BEARING STRENGTH OF 300 KPa AND OVER

PIPE DIAMETER	DIMENSION NOTED ON W25.3			
	A	B	C	D
102	150	150	150	150
152	200	200	200	200
203	300	300	200	230
254	400	400	250	270
305	450	450	300	300
406	650	650	350	450

NOTES:

- THE ABOVE THRUST BLOCK DIMENSIONS MEET OR EXCEED THE WATERMAIN DESIGN CRITERIA FOR FUTURE ALTERATIONS AUTHORIZED UNDER A DRINKING WATER WORKS PERMIT.
- THE ASSUMPTIONS MADE FOR THE ABOVE CALCULATIONS ARE AS FOLLOWS:
 - a) MAXIMUM OPERATING PRESSURE OF 100 psi
 - b) MAXIMUM SURGE PRESSURE WITH A FLOW VELOCITY CHANGE OF 0.6 m/s OF 115 psi (115 psi FOR CLASS 52 DI AND FOR PVC MAX. SURGE IS 35 psi)
- THE TABLES APPLY TO BOTH DUCTILE IRON AND PVC. WHERE ONE LENGTH EXCEEDED THE OTHER THE LONGER LENGTH WAS USED.
- DIMENSIONS MAY BE ADJUSTED TO LONG AS THE BEARING SURFACE AREA OF THE THRUST BLOCK IS NOT REDUCED.
- TO BE USED IN CONJUNCTION WITH W25.3.

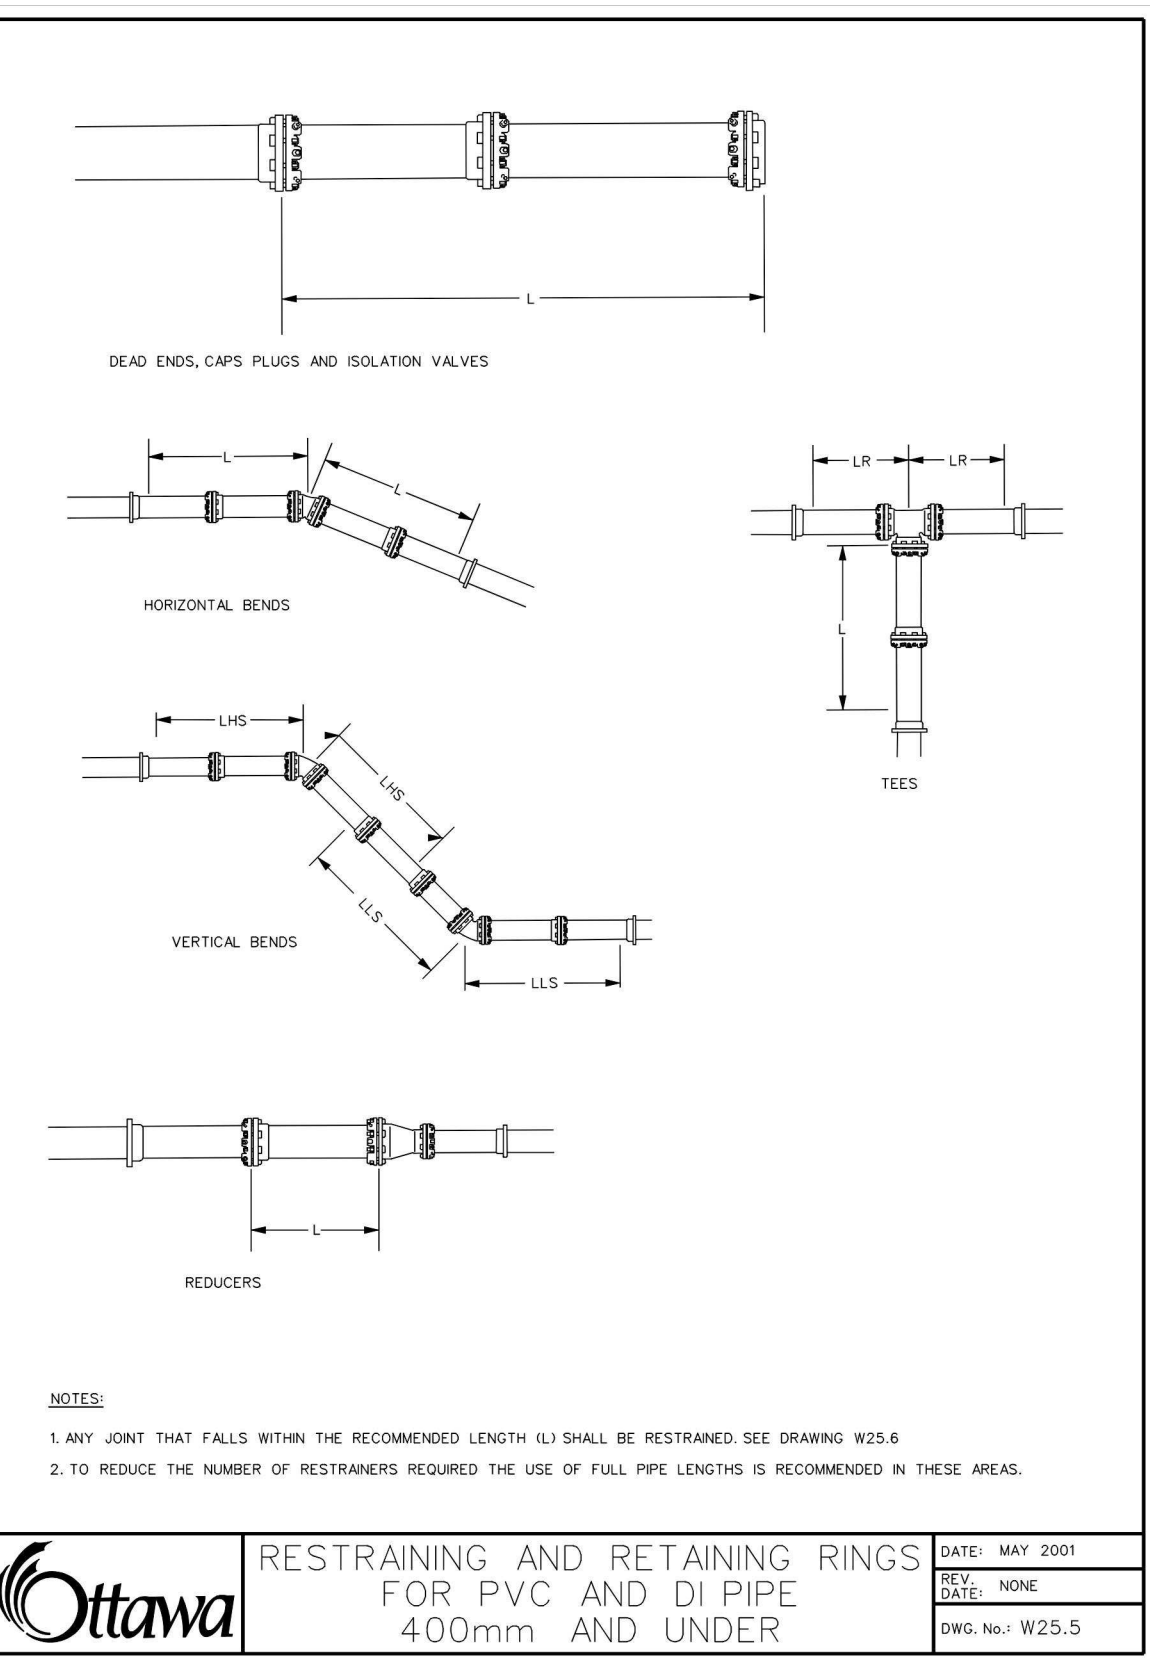

Ottawa RESTRAINING AND RETAINING RINGS FOR PVC AND DI PIPE 400mm AND UNDER

DATE: MAY 2001
REV. DATE: NONE
DWG. No.: W25.5

TABLE OF RESTRAINED LENGTHS FOR DI AND PVC WATERMAIN PIPE IN STANDARD GRANULAR 'A' EMBEDMENT IN SOILS OF BEARING CAPACITY OF 100 KPa AND OVER

REDUCERS	LARGER DIAMETER SIDE (TO BE RESTRAINED)					
	100mm	150mm	200mm	250mm	300mm	400mm
100mm	N/A	3	6	8	10	14
150mm	N/A	N/A	4	6	9	13
200mm	N/A	N/A	N/A	3	6	11
250mm	N/A	N/A	N/A	N/A	4	9
300mm	N/A	N/A	N/A	N/A	N/A	7
400mm	N/A	N/A	N/A	N/A	N/A	N/A

PIPE DIAMETER	PIPE DIAMETER					
	100mm	150mm	200mm	250mm	300mm	400mm
5	6	9	10	12	16	

VERTICAL BENDS	PIPE DIAMETER					
	100mm	150mm	200mm	250mm	300mm	400mm
LENGTH HIGH SIDE - LHS	3	4	5	6	7	9
LENGTH LOW SIDE - LLS	1.5	2	2.5	3	3.5	4.5

TEES	PIPE DIAMETER					
	100mm	150mm	200mm	250mm	300mm	400mm
LENGTH ALONG THE BRANCH - L	1	1	1	1	1	1
LENGTH ALONG THE RUN - Lr	3	3	3	3	3	3


HORIZONTAL BENDS	PIPE DIAMETER					
	100mm	150mm	200mm	250mm	300mm	400mm
11.25, 22.5, AND 45 DEGREE BENDS	1	1.5	1.5	2	2	2.5

NOTES:

- THE ABOVE RESTRAINED LENGTHS MEET OR EXCEED THE WATERMAIN DESIGN CRITERIA FOR FUTURE ALTERATIONS AUTHORIZED UNDER A DRINKING WATER WORKS PERMIT.
- THE ASSUMPTIONS MADE FOR THE ABOVE CALCULATIONS ARE AS FOLLOWS:
 - a) MAXIMUM OPERATING PRESSURE OF 100 psi
 - b) MAXIMUM SURGE PRESSURE WITH A FLOW VELOCITY CHANGE OF 0.6 m/s OF 115 psi (115 psi FOR CLASS 52 DI AND FOR PVC MAX. SURGE IS 35 psi)
- FOR SOFTWARE CALCULATIONS A TEST PRESSURE OF 150 psi AND A SAFETY FACTOR OF 1.5 WAS USED WHICH RESULTS IN 225 psi MAXIMUM PRESSURE.
- TYPE 5 TRENCH BEDDING.
- DEPTH TO BURY 2.4 METRES EXCEPT FOR VERTICAL BENDS WHERE THE HIGH SIDE IS AT 1.8 METRES.
- EMBANKMENT MATERIAL GRANULAR 'A' WITH CHARACTERISTICS OF ASTM D2952 GP.
- GP SOILS ARE DESCRIBED AS POORLY GRADED GRAVEL AND SAND-GRAVEL MIXES WITH LITTLE OR NO FINES.
- (L) MUST BE OF SOLID PIPE WITHOUT JOINTS, FITTINGS, ETC.
- THE TABLES APPLY TO BOTH DUCTILE IRON AND PVC. WHERE ONE LENGTH EXCEEDED THE OTHER THE LONGER LENGTH WAS USED.
- RESTRAINED LENGTHS ARE IN METRES.


Ottawa TABLES OF RESTRAINED LENGTHS FOR PVC AND DI PIPE 400mm AND UNDER

DATE: MAY 2001
REV. DATE: MARCH 2011
DWG. No.: W25.6

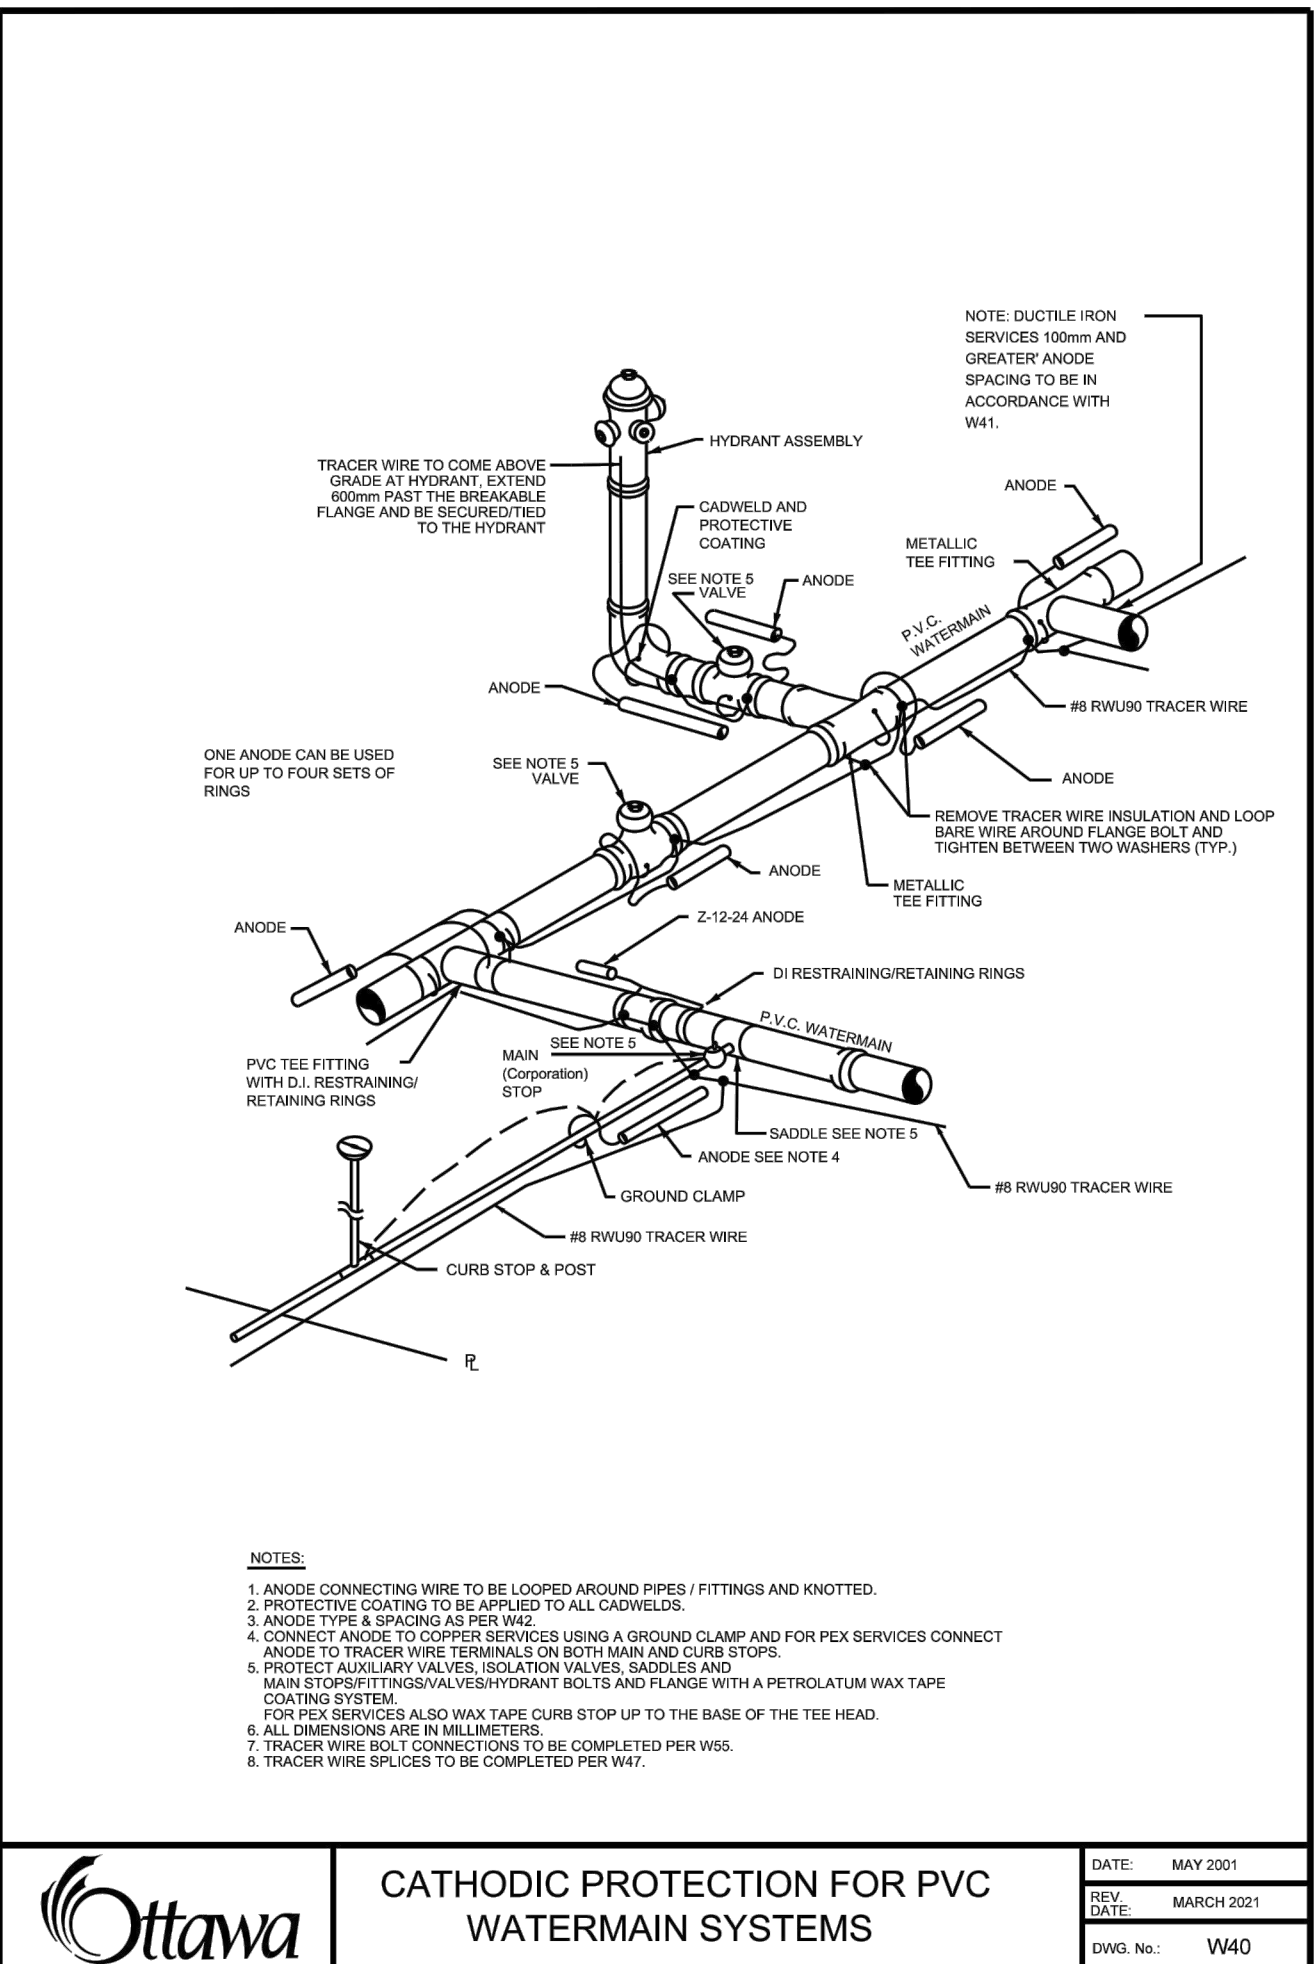

Ottawa CATHODIC PROTECTION FOR PVC WATERMAIN SYSTEMS

DATE: MAY 2001
REV. DATE: MARCH 2021
DWG. No.: W40

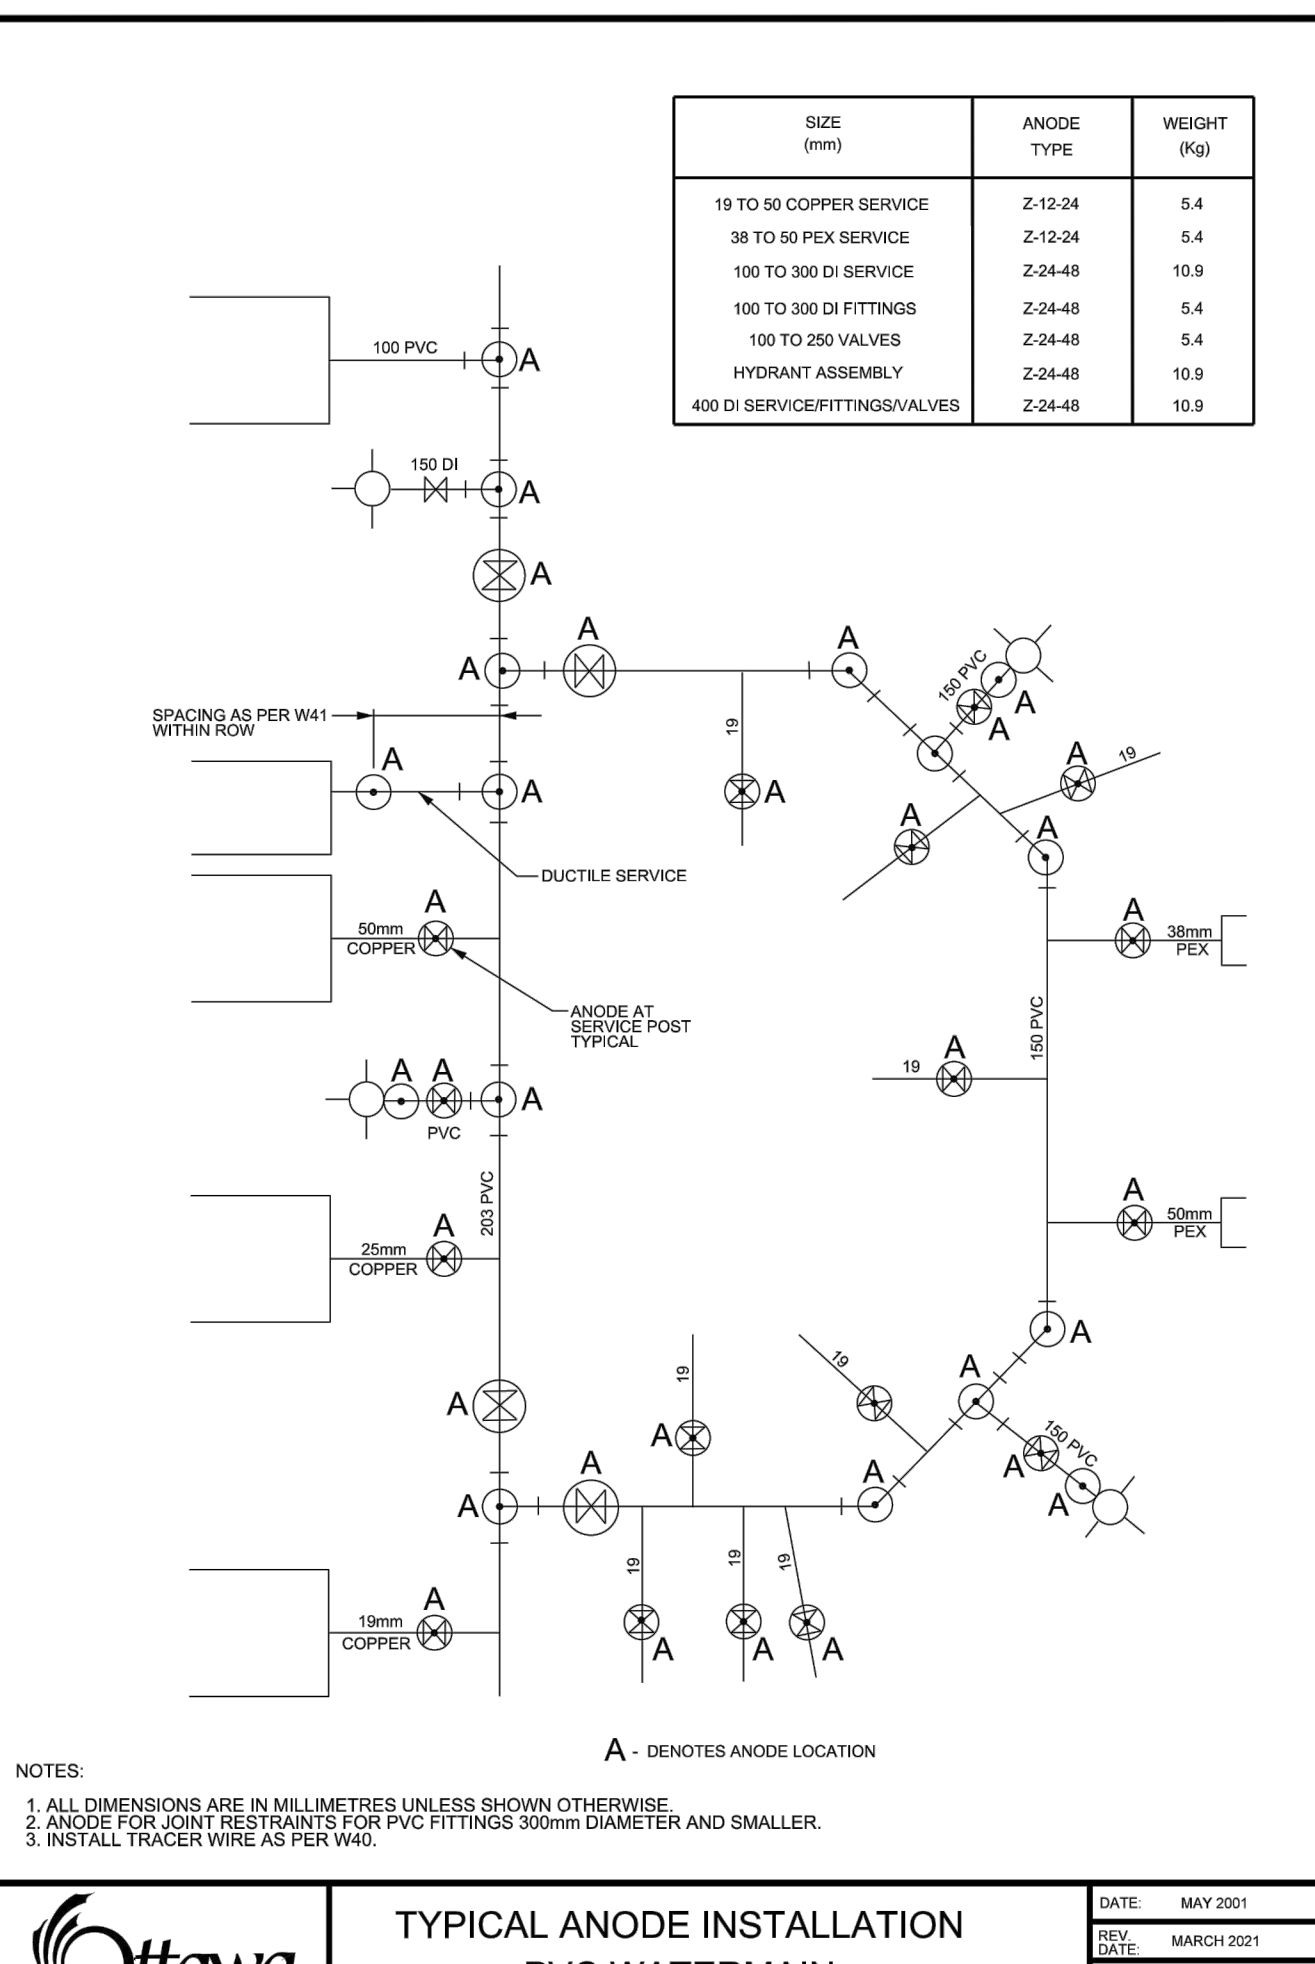

Ottawa TYPICAL ANODE INSTALLATION PVC WATERMAIN

DATE: MAY 2001
REV. DATE: MARCH 2021
DWG. No.: W42

No.	Date	Description	By
4	23/01/20	RE-ISSUED FOR SITE PLAN CONTROL	T.K
3	22/11/07	RE-ISSUED FOR SITE PLAN CONTROL	T.K
2	22/10/14	RE-ISSUED FOR SITE PLAN CONTROL	T.K
1	22/04/07	ISSUED FOR SITE PLAN CONTROL	T.K

DESIGNED BY: **J. C. ADAMS** (LICENSED PROFESSIONAL ENGINEER, 100519478, 20 January 2023)

APPROVED BY: **T. G. KENNEDY** (LICENSED PROFESSIONAL ENGINEER, 100173201, 20 January 2023)

CIMA+

ENGINEER: **The Hazelton Westboro**

PROJECT NAME: 403 RICHMOND ROAD & 389 ROOSEVELT AVENUE

SHEET TITLE: DETAILS PLAN

DISCIPLINE: CIVIL

DRAWER: S.C. POGGIOLI | SCALE: | DATE: 2022/04/07

DESIGNER: T. KENNEDY | APPROVER: T. KENNEDY

PROJECT No.: A001046 | DRAWING No.: C012