

REFER TO NOTES & DETAILS ON DRAWING C-3


WATER SERVICE PROFILE TABLE

150mm PVC PRESSURE CLASS 150 DR18

STATION	DESCRIPTION	GRADE ELEVATION	TOP OF PIPE	DEPTH OF COVER	NOTES
0+00.0	400mm x 150mm TEE CONNECTION IN 400mm MUNICIPAL WATERMAIN TO CITY OF OTTAWA STANDARDS	±62.71	±60.24	±2.47	-
0+03.2	-	±62.77	60.24	2.53	CENTERLINE OF ROAD
0+04.3	-	±62.75	60.24	2.51	CROSSING 300 ST INV 60.75 WM TOP 60.24 - 510mm CLEARANCE (MIN. 500mm REQ'D)
0+07.1	-	±62.70	60.24	2.46	CROSSING 375 SAN TOP 58.91 WM U/S 60.09 - 1180mm CLEARANCE (MIN. 250mm REQ'D)
0+10.3	-	±62.64	60.24	2.40	BOTTOM OF CURB
0+12.9	-	±62.82	60.24	2.58	BACK OF SIDEWALK
0+15.1	150mm VALVE & VALVE BOX TO CITY OF OTTAWA STANDARDS	62.87	60.24	2.63	-
0+16.1	-	62.89	60.24	2.65	ENTRY INTO BUILDING

LEGEND

- MH STORM MANHOLE
- MH SANITARY MANHOLE
- VB VALVE & VALVE BOX
- FH FIRE HYDRANT
- FDC FIRE DEPARTMENT CONNECTION
- SAN SANITARY SEWER
- ST STORM SEWER
- WS/WM WATER SERVICE/WATERMAIN
- SPL SPRINGLINE OF PIPE
- INV INVERT OF PIPE
- (M) WATER METER
- (R) REMOTE WATER METER
- BFL BASEMENT FLOOR ELEVATION
- USF UNDERSIDE OF FOOTING
- - - - PROPERTY LINE
- x 99.99 EXISTING GRADE ELEVATION

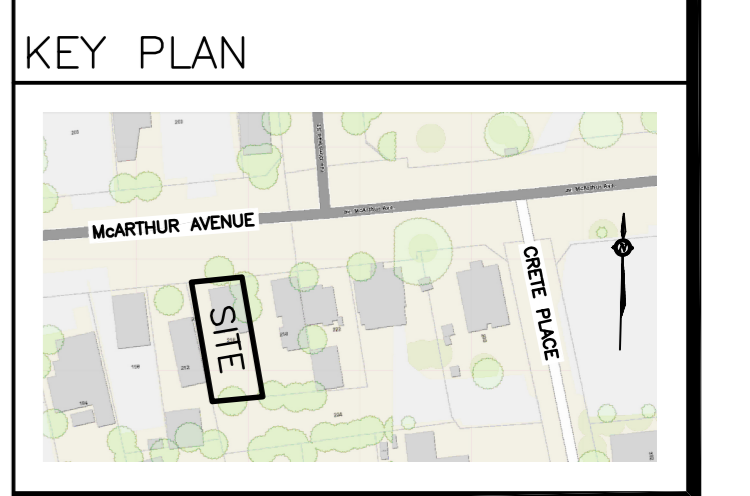


No.	DATE	REVISION
3	NOV 22-22	RE-ISSUED FOR APPROVAL
2	FEB 16-22	ISSUED FOR APPROVAL
1	JAN 5-22	ISSUED FOR COORDINATION

D. B. GRAY ENGINEERING INC.
Stormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermain
 700 Long Point Circle Ottawa, Ontario
 613-425-8044 d.gray@dbgrayengineering.com

Project
PROPOSED 3-STORY MIXED-USE BUILDING
 216 McARTHUR AVENUE
 OTTAWA, ONTARIO

Drawing Title
SITE SERVICING PLAN

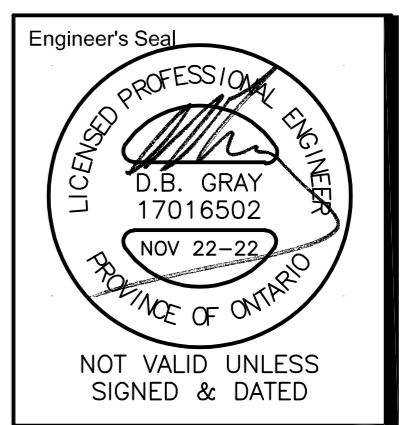

Drawn D.B.G.
 H. Scale 1:100
 V. Scale
 Date JAN 5-22
 Job No. 20123

Drawing No.
C-1
 of 3

#18797

D07-12-22-0072