


LEGEND	
	PROPERTY LINE
	EXISTING BUILDING
	BREAK OF SLOPE - NEW
	NEW FENCE
	EXISTING SANITARY SEWER
	EXISTING STORM SEWER
	EXISTING WATERMAIN
	NEW SANITARY SEWER
	NEW STORM SEWER
	NEW WATERMAIN
	SWALE
	BERM
	NEW LIGHT DUTY ASPHALT
	NEW HEAVY DUTY ASPHALT
	NEW CONCRETE SIDEWALK
	NEW GRASS
	NEW REINFORCED GRASS
	MILLING & OVERLAY 50mm THICK HEAVY DUTY ASPHALT AS PER CITY SPECS
	NEW GRAVEL
	NEW MULCH
	NEW SILT FENCE
	DEPRESSED CURB
	EXISTING CATCHBASIN
	EXISTING MANHOLES
	NEW CATCHBASIN
	NEW CURB INLET CATCHBASIN
	NEW CATCHBASIN MANHOLE
	NEW SANITARY MANHOLE
	NEW STORM MANHOLE
	NEW WATER VALVE
	NEW TRANSFORMER PAD
	EXISTING GRADE
	NEW GRADE
	NEW SLOPE
	OVERLAND FLOW ROUTE
	TOP OF CURB
	BOTTOM OF CURB
	NEW SIAMESE CONNECTION

- GENERAL NOTES**
- DESIGN AND CONSTRUCTION IS TO BE IN ACCORDANCE WITH MOST RECENT ONTARIO BUILDING CODE.
 - THE CONTRACTOR IS RESPONSIBLE FOR CHECKING AND VERIFYING ALL DIMENSIONS WITH RESPECT TO SITE CONDITIONS AND ALL MATERIALS TO THE PROJECT. ANY DISCREPANCY SHALL BE REPORTED TO THE ENGINEER.
 - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL MATERIAL RELEVANT TO THE PROJECT.
 - ADDITIONAL DRAWINGS MAY BE ISSUED FOR CLARIFICATION TO ASSIST PROPER EXECUTION OF WORK. SUCH DRAWINGS WILL HAVE THE SAME MEANING AND INTENT AS IF THEY WERE INCLUDED WITH THE CONTRACT DOCUMENTS.
 - CONTRACTOR MUST COMPLY WITH LOCAL BY-LAWS, ONTARIO OCCUPATIONAL HEALTH AND SAFETY ACT AND ALL REGULATIONS SET BY AUTHORITIES HAVING JURISDICTION. IN CASE OF CONFLICT OR DISCREPANCY, THE MORE STRINGENT REQUIREMENTS SHALL APPLY.
 - CONTRACTOR RESPONSIBLE FOR OBTAINING ALL REQUIRED UTILITY LOCATES, DAYLIGHTING, INSPECTIONS, PERMITS, AND APPROVALS, INCLUDING ALL ASSOCIATED COSTS. LOCATION OF EXISTING UTILITIES ARE APPROXIMATE ONLY AND BASED ON BEST AVAILABLE INFORMATION.

- DRAWING NOTES**
- INSTALL SILT FENCE IN ACCORDANCE WITH OPSD 219.130.
 - MATCH EXISTING GRADES AT PROPERTY LINE AND LIMITS OF WORK.
 - REINSTATE PAVEMENT TO MATCH EXISTING ROAD PAVEMENT STRUCTURE.
 - INSTALL LIGHT DUTY PAVEMENT IN ACCORDANCE WITH DETAIL 1C3 ACCORDINGLY REINSTATE GRADES TO THE INTO EXISTING AND PROVIDE POSITIVE DRAINAGE TOWARDS STORM STRUCTURES.
 - GRADES TO SLOPE AWAY FROM THE BUILDING TO PROVIDE POSITIVE DRAINAGE.
 - ANY DISTURBED AREA WITHIN THE RIGHT-OF-WAY SHALL BE REINSTATED TO EQUAL OR BETTER CONDITION TO THE SATISFACTION OF THE CITY OF OTTAWA.
 - PROTECT EXISTING MANHOLES AND CATCHBASINS USING A FILTER SOCK OR FILTER BASE IN ACCORDANCE WITH DETAIL 41C3.
 - NEW RAMP & TWSI AS PER CITY STANDARD.
 - PAVEMENT TO BE WITHIN 12mm OF DOOR.
 - PROVIDE MAXIMUM 4:1 SLOPE.
 - NEW CONCRETE SIDEWALK AS PER CITY STANDARD.
 - CONTRACTOR TO PROVIDE TRENCH BOX FOR EXCAVATION IN PROXIMITY OF MUNICIPAL RIGHT OF WAY.
 - REMOVE EXISTING BARRIER CURB.
 - EXISTING SIDEWALK TO BE REPLACED CONTRACTOR SHALL ENSURE THE STRUCTURAL INTEGRITY OF EXISTING CONCRETE SIDEWALK THAT WILL REMAIN IN PLACE AND ITS UNDERLYING GRANULAR BASE WHEN COMPACTING THE SUBGRADE AND GRANULAR BASE OF THE NEW SIDEWALK.
 - INSTALL NEW BARRIER CURB AS PER CITY STANDARD SC1.1.
 - INSTALL NEW DEPRESSED CURB AS PER CITY STANDARD AT THE INTERFACE OF EXISTING EDGE OF PAVEMENT AND PROPOSED PAVEMENT OF THE NEW LAY-0Y.

- EROSION AND SEDIMENT CONTROL NOTES**
- THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES TO PROVIDE PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATER COURSE DURING CONSTRUCTION ACTIVITIES. THIS INCLUDES LIMITING THE AMOUNT OF EXPOSED SOIL, INSTALLING SILT FENCES AND OTHER EFFECTIVE SEDIMENT TRAPS, AND INSTALLING AND MAINTAINING MUD MATS FOR OUTGOING CONSTRUCTION TRAFFIC DURING CONSTRUCTION ACTIVITIES.
 - PREVENT SOIL LOSS DURING CONSTRUCTION (BY STORM WATER RUNOFF OR WIND EROSION).
 - PROTECT TOPSOIL BY STOCKPILING FOR REUSE.
 - PREVENT SEDIMENTATION OF STORM SEWERS AND RECEIVING STREAMS.
 - PREVENT AIR POLLUTION FROM DUST AND PARTICULATE MATTER.
 - ALL STORM MANHOLES AND CATCHBASIN MANHOLES TO HAVE 300mm SUMPS; ALL CATCHBASINS TO HAVE 600mm SUMPS.
 - INSTALL FILTER BAG INSERT IN ALL STORM MANHOLES AND CATCH BASINS IMPACTED DURING CONSTRUCTION, INCLUDING CATCH BASINS IN THE RIGHT OF WAY.
 - SEDIMENT AND EROSION CONTROL MEASURES MAY BE MODIFIED IN THE FIELD AT THE DISCRETION OF THE CITY OF OTTAWA INSPECTOR OR CONSERVATION AUTHORITY.
 - STORM WATER PUMPED INTO CITY SERVICE SHALL FLOW THROUGH A FILTER SOCK.
 - THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENTATION CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.


- GEOTECHNICAL NOTES**
- A GEOTECHNICAL ENGINEER LICENSED IN THE PROVINCE OF ONTARIO SHALL INSPECT ALL SUBGRADE SURFACES FOR FOOTING AND TRENCHES, PIPE BEDDING AND PAVEMENT STRUCTURES PRIOR TO CONSTRUCTION.
 - IT IS STRICTLY RECOMMENDED TO REFER GEOTECHNICAL INVESTIGATION REPORT: GEOTECHNICAL INVESTIGATION - PROPOSED FINDLAY CREEK CATHOLIC ELEMENTARY SCHOOL 4140 KELLY FARM DRIVE - PREPARED BY EXP SERVICES INC.
 - STRINGENT CONSTRUCTION CONTROL PROCEDURES SHOULD BE MAINTAINED TO ENSURE THAT UNIFORM SUBGRADE MOISTURE AND DENSITY CONDITIONS ARE MAINTAINED.
 - SHOULD SURFACE AND SUBSURFACE WATER SEEPAGE OCCUR INTO THE EXCAVATIONS COLLECT ANY WATER ENTERING THE EXCAVATIONS AND REMOVE IT BY PUMPING FROM SUMP.
 - THE SUBDRAINS ILLUSTRATED ON PLANS ARE SCHEMATIC. FULL SCHEMATIC OF SUBDRAINS SHOULD BE INSTALLED ON BOTH SIDES OF THE ACCESS ROAD(S). SUBDRAINS MUST BE INSTALLED IN THE PROPOSED PARKING AREA AND ACCESS ROADWAY AT LOW POINTS AND SHOULD BE CONTINUOUS BETWEEN CATCHBASINS TO INTERCEPT EXCESS SURFACE AND SUBSURFACE MOISTURE AND TO PREVENT SUBGRADE SOFTENING. THE LOCATION, SIZE AND EXTENT OF SUBDRAINS REQUIRED WITHIN THE PAVED AREAS SHOULD BE SUBMITTED BY CONTRACTOR AND REVIEWED BY THE GEOTECHNICAL ENGINEER IN CONJUNCTION WITH THE PROPOSED SITE GRADING.
 - IT IS RECOMMENDED THAT THE PIPE BEDDING BE 300 MM THICK AND CONSIST OF OPSS GRANULAR A. THE BEDDING MATERIAL SHOULD BE PLACED ALONG THE SIDES AND ON TOP OF THE PIPE TO PROVIDE A MINIMUM COVER OF 300 MM. THE BEDDING SHOULD BE COMPACTED TO AT LEAST 98 PERCENT OF THE SPMD.
 - BACKFILL AROUND STRUCTURES MANHOLES AND CATCHBASINS SHOULD CONSIST OF FREE-DRAINING GRANULAR MATERIAL CONFORMING TO OPSS GRANULAR B TYPE II IN ORDER TO MINIMIZE DIFFERENTIAL MOVEMENT BETWEEN PAVEMENT AND CATCHBASIN/MANHOLE DUE TO FROST ACTION. WEEP HOLES SHOULD BE PROVIDED IN THE CATCHBASIN/MANHOLES TO FACILITATE DRAINAGE OF ANY WATER THAT MAY ACCUMULATE IN THE GRANULAR FILL.
 - SPECIAL PROVISIONS SHOULD BE ALLOWED BY CONTRACTOR FOR LOADING CONDITIONS ON PAVEMENT STRUCTURE DURING CONSTRUCTION SUCH AS RESTRICTED LANES, HALF-LOADS DURING PAVING AND/OR TEMPORARY CONSTRUCTION ROADWAYS ESPECIALLY IF CONSTRUCTION TIME SPANS THROUGH UNFAVORABLE WEATHER PERIOD.
 - IT IS RECOMMENDED THAT A GEOTEXTILE BE PLACED ON THE SURFACE OF THE SUBGRADE PRIOR TO PLACEMENT OF ANY GRANULAR SUBBASE. THIS MUST BE ALLOWED FOR BY CONTRACTOR AND INSTALLED WHEN DIRECTED BY THE GEOTECHNICAL ENGINEER.
 - WEAKER SUBGRADE MAY DEVELOP AT SUBGRADE LEVEL OF SERVICE TRENCHES. IT IS RECOMMENDED TO PROVIDE ADDITIONAL GRANULAR SUBBASE, OPSS GRANULAR B TYPE II, AND GEOTEXTILE AT SUB-GRADE LEVEL TO THE SATISFACTION OF THE GEOTECHNICAL ENGINEER. FOR PIPE BEDDING REQUIREMENTS REFER TO GEOTECHNICAL REPORT.
 - THE PROPOSED PARKING AREA AND ACCESS ROADS SHOULD BE STRIPPED OF ALL EXISTING FILL SURFACE AND BURIED TOPSOIL (ORGANIC) LAYERS, ORGANIC STAINED SOILS AND OTHER OBVIOUSLY UNSUITABLE MATERIAL. THE SUBGRADE SHOULD BE PROPERLY SHAPED, CROWNED, THEN PROOF ROLLED WITH A HEAVY VIBRATORY ROLLER IN THE FULL-TIME PRESENCE OF A REPRESENTATIVE OF THE GEOTECHNICAL ENGINEER'S OFFICE. ANY SOFT OR SPONGY SUBGRADE AREAS DETECTED SHOULD BE SUB EXCAVATED AND PROPERLY REPLACED WITH SUITABLE APPROVED BACKFILL COMPACTED TO 95 PERCENT SPMD (ASTM D699-12E2).
 - THE GRANULAR MATERIALS USED FOR PAVEMENT CONSTRUCTION SHOULD CONFORM TO ONTARIO PROVINCIAL STANDARD SPECIFICATIONS (OPSS 1010) FOR GRANULAR A AND GRANULAR B TYPE II AND SHOULD BE COMPACTED TO 100 PERCENT OF THE SPMD.
 - THE ASPHALTIC CONCRETE USED, AND ITS PLACEMENT SHOULD MEET OPSS 1150 OR 1151 REQUIREMENTS. IT SHOULD BE COMPACTED FROM 92 PERCENT TO 97 PERCENT OF THE MFD (ASTM D2041). ASPHALT PLACEMENT SHOULD BE IN ACCORDANCE WITH OPSS 310 AND OPSS 313.
 - TO MINIMIZE SETTLEMENT OF THE PAVEMENT STRUCTURE OVER SERVICES TRENCHES, THE TRENCH BACKFILL MATERIAL WITHIN THE FROST ZONE, TO 1.8 M DEPTH BELOW FINAL GRADE, SHOULD MATCH THE EXISTING MATERIAL ALONG THE TRENCH WALLS TO MINIMIZE DIFFERENTIAL FROST HEAVING OF THE SUBGRADE SOIL. PROVIDED THIS MATERIAL IS COMPACTIBLE. OTHERWISE, FROST TAPERS MAY BE REQUIRED.
 - THE MUNICIPAL SERVICES SHOULD BE INSTALLED IN SHORT OPEN TRENCH SECTIONS THAT ARE EXCAVATED AND BACKFILLED THE SAME DAY.
 - TRENCH BACKFILL AND SUBGRADE FILL SHOULD CONSIST OF OPSS 1010 GRANULAR B TYPE II FOR THE PLAY STRUCTURE AND OPSS 1010 SELECT SUBGRADE MATERIAL (SSM) FOR THE SPORTS FIELD, PARKING LOT AND ACCESS ROADS. PLACED IN 300 MM THICK LIFTS AND EACH LIFT COMPACTED TO 95 PERCENT SPMD; AND FILL FOR LANDSCAPED AREAS SHOULD BE CLEAN FILL FREE OF DEBRIS, TOPSOIL (ORGANIC SOIL), COBBLES AND BOULDERS PLACED IN 300 MM THICK LIFTS AND EACH LIFT COMPACTED TO 92 PERCENT SPMD.

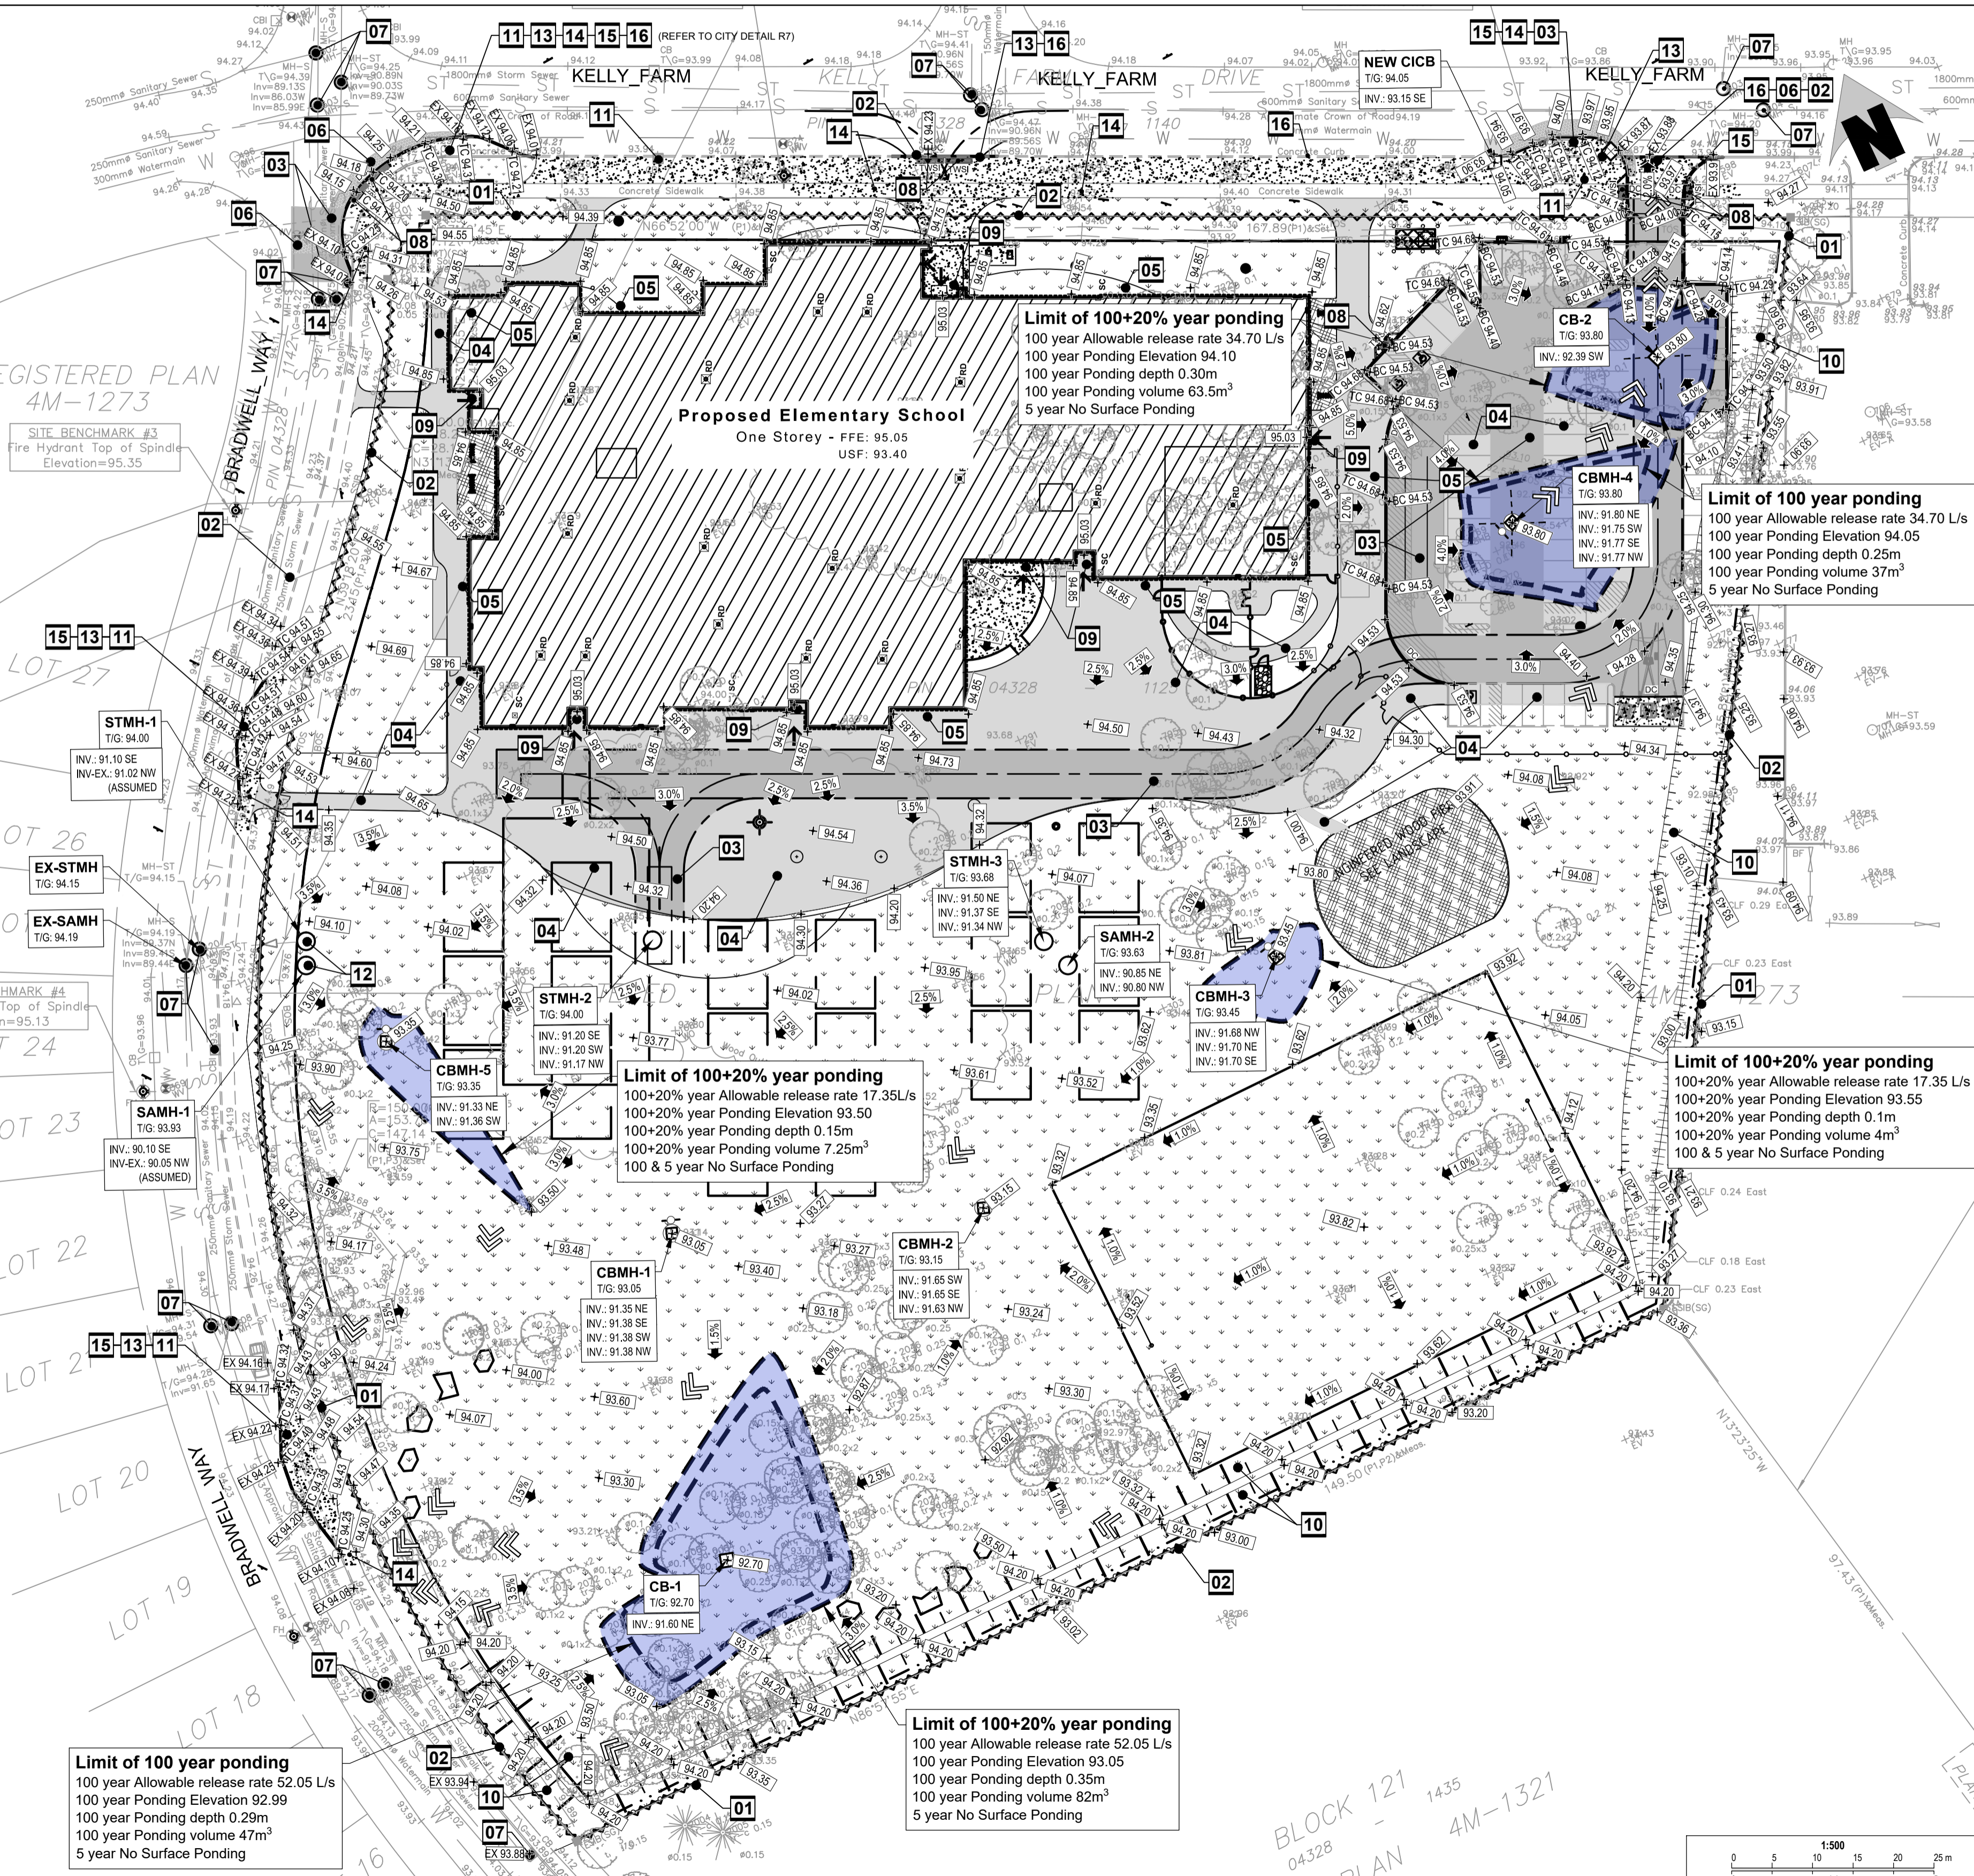

Jp2g Consultants Inc.
 ENGINEERS - PLANNERS - PROJECT MANAGERS
 1150 Morrison Drive, Suite 410, Ottawa, ONT.
 Phone: (613) 628-7600 Fax: (613) 628-2600
 402g No: 20-1095C



No.	Description	YYYY-MM-DD
1	ISSUED FOR SITE PLAN CONTROL REV-1	2022-10-07

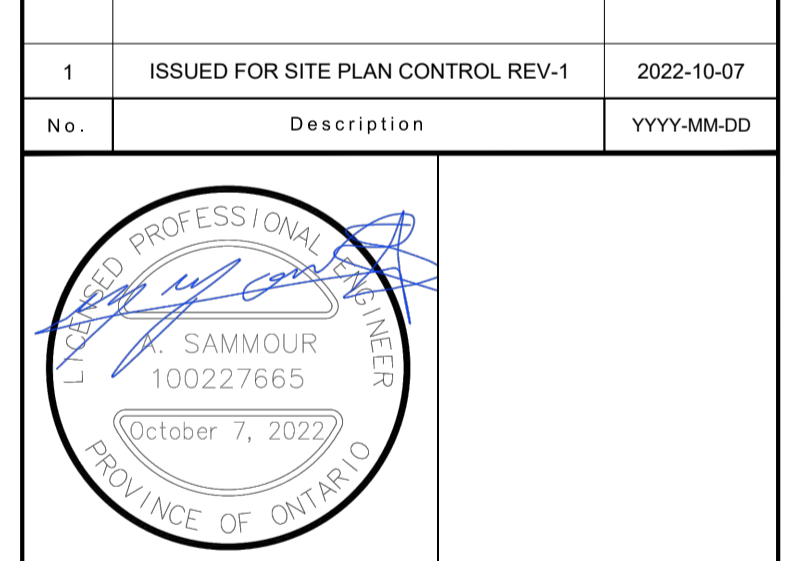

Client: **P R T Y** PYE & RICHARDS - TEMPRANO & YOUNG ARCHITECTS INC.
 824 Meath St. Suite 200 613. 724. 7700
 Ottawa, ON K1Z 6E8 info@prty.ca

Project: **OCSB Findlay Creek Elementary School**
 4140 Kelly Farm Drive, Ottawa, Ontario

Drawing Title: **Site Grading, Erosion and Sediment Control Plan**

Do not scale. Refer any dimensional errors and/or possible trade interference/conflict to the architect for clarification prior to commencement of the work. The conditions of the contract apply.

Project No.	As shown	Drawing No.	C2
Scale	R.I.	Revision No.	
Drawn By	A.S.		
Checked			
Date			