

April 05, 2021  
File: PG5775-LET.01

28 Concourse Gate, Unit 1  
Ottawa, Ontario  
Canada, K2E 7T7  
Tel: (613) 226-7381  
Fax: (613) 226-6344

**Lapenseé**  
1085 Boul. De La Carriere  
Gatineau, Quebec  
J8Y 6V4

Geotechnical Engineering  
Environmental Engineering  
Hydrogeology  
Geological Engineering  
Materials Testing  
Building Science

Attention: **Ms. Valérie Lapenseé**

Subject: **Geotechnical Investigation  
Proposed Development  
3493 - 3499 Innes Road - Ottawa**

[www.patersongroup.ca](http://www.patersongroup.ca)

Dear Madame,

Upon your request, Paterson Group (Paterson) conducted a geotechnical investigation for the proposed development to be located at 3493 - 3499 Innes Road, in the City of Ottawa, Ontario.

It is understood that the proposed development will consist of two (2) retail buildings of slab-on-grade construction. The first building will be located along the western portion of the site. The second building will be constructed on the eastern portion of the site. Associated access roads and parking areas will occupy the remainder of the site.

## 1.0 Field Investigation

A geotechnical investigation was conducted at subject site on January 27, 2010, and consisted of excavating 5 test pits to a maximum depth of 1.3 m below existing grade using a rubber tired backhoe. All fieldwork was conducted under the full-time supervision of Paterson personnel under the direction of a senior engineer from our geotechnical division. The field procedure consisted of excavating to the required depths, sampling and testing the overburden at selected locations.

The test pit locations and ground surface elevations at the test pit locations were surveyed by Paterson field personnel. Ground surface elevations at the test pit locations were referenced to a temporary benchmark (TBM), consisting of the top spindle of the fire hydrant located just east of the subject property, on the south side of Innes Road. An assumed elevation of 100.0 m was assigned to the TBM. The locations of the test pits are shown on Drawing PG5775-1 - Test Hole Location Plan attached to this letter.

## **2.0 Field Observations**

### **Surface Conditions**

Currently, the site is occupied by a one storey-building at the centre, along with associated garage to the west, and landscaped areas for the remainder of the site. The ground surface across the subject site is relatively flat and at grade with the neighbouring roadways and properties. Several trees were observed within the eastern portion and along the southwest corner of the subject site.

The site is bound by residential dwellings to the north, a single house and associated garden to the east, Innes Road to the south, and by a one-storey commercial development to the west.

### **Subsurface Conditions**

#### **Overburden**

Generally, the subsoil profile at the test hole locations consists of topsoil underlain by a loose to compact brown silty sand followed by bedrock. A layer of very stiff brown silty clay was encountered below the top soil at the location of TP 1. Practical refusal to excavation was encountered at all test pits at depths ranging between 0.2 to 1.3m below ground surface. All test pits were noted to be dry upon completion. For specific details at each test hole location reference should be made to our Soil Profile and Test Data sheets attached to the present letter.

#### **Bedrock**

According to the available geological mapping and the depth of refusal to excavation, the bedrock in the subject area consists of limestone bedrock of the Bobcaygeon formation, with an overburden drift thickness of 0 to 1m.

#### **Groundwater**

Groundwater observations were recorded during the current investigation and are presented on the test holes logs. All test pits were observed to be dry upon the completion of excavation.

It should be noted that groundwater levels are subject to seasonal fluctuations. Therefore, groundwater level could vary at the time of construction.

## **3.0 Geotechnical Assessment**

It is recommended that proposed buildings be founded by shallow footings placed on a clean, sounded bedrock surface.

Bedrock removal may be required at some locations within the subject site.

The above and other considerations are further discussed in the following sections.

### **Site Grading and Preparation**

#### **Stripping Depth**

Topsoil and deleterious fill, such as those containing organic materials, should be stripped from under any building and other settlement sensitive structures. Under paved areas, existing construction remnants, such as foundation walls, pipe ducts, etc., should be excavated to a minimum depth of 1 m below final grade.

#### **Fill Placement**

Fill used for grading beneath the proposed building footprint, unless otherwise specified, should consist of clean imported granular fill, such as Ontario Provincial Standard Specifications (OPSS) Granular A or Granular B Type II. The fill should be tested and approved prior to delivery to the site. It should be placed in lifts no greater than 300 mm thick and compacted using suitable compaction equipment for the lift thickness. Fill placed beneath the building should be compacted to at least 98% of its standard Proctor maximum dry density (SPMDD).

Non-specified existing fill along with site-excavated soil can be used as general landscaping fill where settlement of the ground surface is of minor concern. These materials should be spread in thin lifts and at least compacted by the tracks of the spreading equipment to minimize voids. If these materials are to be used to build up the subgrade level for areas to be paved, they should be compacted in thin lifts to a minimum density of 95% of their respective SPMDD. Non-specified existing fill and site-excavated soils are not suitable for use as backfill against foundation walls.

#### **Bedrock Removal**

Bedrock removal can be accomplished by hoe ramming where only a small quantity of the bedrock needs to be removed. Sound bedrock may be removed by line drilling and controlled blasting.

Prior to considering blasting, the blasting effects on the existing buildings and structures should be considered. As a general guideline, peak particle velocities should not exceed 50 mm/sec (measured at the structure) during the blasting program to reduce the risks of damages to the existing structures. Blasting close to freshly placed concrete should also be closely controlled.

The blasting operations should be carried out under the supervision of a licensed professional engineer who is also a blasting expert.

A pre-blast or preconstruction survey of the existing surrounding structures should be carried out prior to commencing site activities. The extent of the survey should be determined by the blasting consultant and should be sufficient to respond to any inquiries/claims related to the blasting operations.

## **Foundation Design**

Footings placed on a clean, surface sounded bedrock bearing surface can be designed using a factored bearing resistance value at ultimate limit states (ULS) of **1,000 kPa**. A geotechnical resistance factor of 0.5 was applied to the reported bearing resistance values at ULS.

A clean, surface-sounded bedrock bearing surface should be free of all soil and loose materials, and have no near surface seams, voids, fissures or open joints which can be detected from surface sounding with a rock hammer.

Footings bearing on an acceptable bedrock bearing surface and designed using the bearing resistance values provided herein will be subjected to negligible potential post-construction total and differential settlements.

## **Design for Earthquakes**

The site class for seismic site response can be taken as **Class C** for the shallow foundations considered at this site. A higher site class, such as Classes A or B could be applicable for this site, but would have to be determined based on site-specific seismic testing, such as near-surface reflection/refraction. The soils underlying the proposed shallow foundations are not susceptible to liquefaction. Reference should be made to the latest revision of the 2012 Ontario Building Code for a full discussion of the earthquake design requirements.

## Slab on Grade Construction

With the removal of all topsoil and fill, containing deleterious materials, within the footprint of the proposed building, the native soil surface will be considered to be an acceptable subgrade surface on which to commence backfilling for the floor slab. The upper 150 mm of sub-slab fill should consist of an OPSS Granular A material for slab on grade construction. Alternatively, if consideration is given to including a basement level, the upper 150 mm of sub-slab fill should consist of 19 mm clear stone. All backfill material within the footprint of the proposed building should be placed in maximum 300 mm thick loose layers and compacted to at least 98% of its SPMDD.

Any soft areas should be removed and backfilled with appropriate backfill material. OPSS Granular B Type II, with a maximum particle size of 50 mm, are recommended for backfilling below the floor slab.

## Pavement Structure

Car only parking, heavy truck parking areas and access lanes are expected for the proposed development. The proposed pavement structures are presented in Tables 1 and 2.

<b>Table 1 - Recommended Pavement Structure - Car Only Parking</b>	
<b>Thickness mm</b>	<b>Material Description</b>
50	<b>WEAR COURSE</b> - HL-3 or Superpave 12.5 Asphaltic Concrete
150	<b>BASE</b> - OPSS Granular A Crushed Stone
300	<b>SUBBASE</b> - OPSS Granular B Type II
<b>SUBGRADE</b> - Either in situ soil, bedrock or OPSS Granular B Type II material placed over in situ soil or bedrock.	

<b>Table 2 - Recommended Pavement Structure - Heavy Truck Parking and Access Lanes</b>	
<b>Thickness (mm)</b>	<b>Material Description</b>
40	<b>Wear Course</b> - HL-3 or Superpave 12.5 Asphaltic Concrete
50	<b>Binder Course</b> - HL-8 or Superpave 19.0 Asphaltic Concrete
150	<b>BASE</b> - OPSS Granular A Crushed Stone
400	<b>SUBBASE</b> - OPSS Granular B Type II
<b>SUBGRADE</b> - Either in situ soil, bedrock or OPSS Granular B Type I or II material placed over in situ soil or bedrock	

Minimum Performance Graded (PG) 58-34 asphalt cement should be used for this project.

If soft spots develop in the subgrade during compaction or due to construction traffic, the affected areas should be excavated and replaced with OPSS Granular B Type II material.

The pavement granular base and subbase should be placed in maximum 300 mm thick lifts and compacted to a minimum of 98% of the material's SPMDD using suitable compaction equipment.

### **Pavement Structure Drainage**

Satisfactory performance of the pavement structure is largely dependent on the contact zone between the subgrade material and the base stone in a dry condition.

Failure to provide adequate drainage under conditions of heavy wheel loading could result in the subgrade soil being pumped into the voids in the stone subbase, thereby reducing the load bearing capacity.

Due to the impervious nature of the subgrade materials consideration to installing subdrains during the pavement construction should be provided. These drains should be installed at each catch basin, be a minimum of 3 m long and should extend in four orthogonal directions or longitudinally when placed along a curb. The subdrain inverts should be approximately 300 mm below subgrade level. The subgrade surface should be shaped to promote water flow to the drainage lines.

## **4.0 Design and Construction Precautions**

### **Foundation Drainage and Backfill**

It is recommended that a perimeter foundation drainage system be provided for the proposed structures. The system should consist of a 100 mm to 150 mm diameter perforated corrugated plastic pipe, surrounded on all sides by 150 mm of 10 mm clear crushed stone, placed at the footing level around the exterior perimeter of the structure. The pipe should have a positive outlet, such as a gravity connection to the storm sewer.

Backfill against the exterior sides of the foundation walls should consist of free-draining non frost susceptible granular materials. The greater part of the site excavated materials will be frost susceptible and, as such, are not recommended for re-use as backfill against the foundation walls, unless a composite drainage system (such as System Platon or Miradrain) is used. Imported granular materials, such as clean sand or OPSS Granular B Type I granular material, should be used for this purpose.

### **Protection of Footings Against Frost Action**

Perimeter footings of heated structures are required to be insulated against the deleterious effects of frost action. A minimum of 1.5 m of soil cover alone, or a minimum of 0.6 m of soil cover, in conjunction with foundation insulation, should be provided in this regard.

Exterior unheated footings, such as those for isolated exterior piers, are more prone to deleterious movement associated with frost action than the exterior walls of the structure proper and require additional protection, such as soil cover of 2.1 m or a combination of soil cover and foundation insulation.

### **Excavation Side Slopes**

The side slopes of excavations in the soil and fill overburden materials should either be cut back at acceptable slopes or should be retained by shoring systems from the start of the excavation until the structure is backfilled. It is assumed that sufficient room will be available for the greater part of the excavation to be undertaken by open-cut methods (i.e. unsupported excavations).

The excavation side slopes above the groundwater level extending to a maximum depth of 3 m should be cut back at 1H:1V or flatter. The flatter slope is required for excavation below groundwater level. The subsoil at this site is considered to be mainly Type 2 and 3 soil according to the Occupational Health and Safety Act and Regulations for Construction Projects.

Excavated soil should not be stockpiled directly at the top of excavations and heavy equipment should be kept away from the excavation sides.

Slopes in excess of 3 m in height should be periodically inspected by the geotechnical consultant in order to detect if the slopes are exhibiting signs of distress.

It is recommended that a trench box be used at all times to protect personnel working in trenches with steep or vertical sides. It is expected that services will be installed by “cut and cover” methods and excavations will not be left open for extended periods of time.

In bedrock, almost vertical side slopes can be used provided that all loose rock and blocks with unfavourable weak planes are removed or stabilized.

## **Groundwater Control**

The contractor should be prepared to direct water away from all bearing surfaces and subgrades, regardless of the source, to prevent disturbance to the founding medium.

The rate of flow of groundwater into the excavation through the overburden soil should be low for expected founding levels and the conditions at this site. It is anticipated that pumping from open sumps will be sufficient to control the groundwater influx through the sides of the excavations.

A temporary Ministry of the Environment, Conservation and Parks (MECP) permit to take water (PTTW) may be required for this project if more than 400,000 L/day of ground and/or surface water is to be pumped during the construction phase. A minimum 4 to 5 months should be allowed for completion of the PTTW application package and issuance of the permit by the MECP.

For typical ground or surface water volumes being pumped during the construction phase (between 50,000 to 400,000 L/day), it is required to register on the Environmental Activity and Sector Registry (EASR). A minimum of two to four weeks should be allotted for completion of the EASR registration and the Water Taking and Discharge Plan to be prepared by a Qualified Person as stipulated under O.Reg. 63/16. If a project qualifies for a PTTW based upon anticipated conditions, an EASR will not be allowed as a temporary dewatering measure while awaiting the MECP review of the PTTW application.

## **Winter Construction**

Precautions must be taken if winter construction is considered for this project. The subsoil conditions at this site mostly consist of frost susceptible materials. In presence of water and freezing conditions, ice could form within the soil mass. Heaving and settlement upon thawing could occur.



In the event of construction during below zero temperatures, the founding stratum should be protected from freezing temperatures by the use of straw, propane heaters and tarpaulins or other suitable means. In this regard, the base of the excavations should be insulated from sub-zero temperatures immediately upon exposure and until such time as heat is adequately supplied to the building and the footings are protected with sufficient soil cover to prevent freezing at founding level.

The trench excavations should be carried out in a manner to avoid the introduction of frozen materials, snow or ice into the trenches. As well, pavement construction is difficult during winter. The subgrade consists of frost susceptible soils which will experience total and differential frost heaving as the work takes place. Also, the introduction of frost, snow or ice into the pavement materials, which is difficult to avoid, could adversely affect the performance of the pavement structure.

## 5.0 Recommendations

It is a requirement for the design data provided herein to be applicable that an acceptable materials testing and observation program, including the aspects shown below, be performed by the geotechnical consultant.

- Observation of all bearing surfaces prior to the placement of concrete.
- Sampling and testing of the concrete and fill materials used.
- Periodic observation of the condition of unsupported excavation side slopes in excess of 3 m in height, if applicable.
- Observation of all subgrades prior to backfilling.
- Field density tests to determine the level of compaction achieved.
- Sampling and testing of the bituminous concrete including mix design reviews.

Upon request, a report confirming that these works have been conducted in general accordance with our recommendations could be issued following the completion of a satisfactory materials testing and observation program by the geotechnical consultant.

## 6.0 Statement of Limitations

The recommendations in this report are in accordance with the present understanding of the project. Paterson requests permission to review the grading plan once available and the recommendations when the drawings and specifications are complete.

A geotechnical investigation of this nature is a limited sampling of a site. The recommendations are based on information gathered at the specific test locations and can only be extrapolated to an undefined limited area around the test locations. The extent of the limited area depends on the soil, bedrock and groundwater conditions, as well the history of the site reflecting natural, construction, and other activities. Should any conditions at the site be encountered which differ from the test locations, Paterson requests notification immediately in order to permit reassessment of the recommendations.

The present report applies only to the project described in this document. Use of this report for purposes other than those described herein or by person(s) other than Lapenseé or their agents, without review by this firm for the applicability of our recommendations to the altered use of the report.

Best Regards,

**Paterson Group Inc.**



Maha Saleh, P.Eng (Prov.)



David J. Gilbert, P.Eng.

### Attachments

- Soil Profile and Test Data sheets
- Drawing PG5775-1 - Test Hole Location Plan

### Report Distribution

- Lapenseé (3 copies)
- Paterson Group (1 copy)

**DATUM** TBM - Top spindle of fire hydrant located at the southwest corner of subject site.  
Assumed elevation = 100.00m.

**FILE NO.** PG2024

**REMARKS**

**HOLE NO.** TP 1

**BORINGS BY** Backhoe

**DATE** 27 January 2010

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Piezometer Construction	
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %					
GROUND SURFACE						0	98.93	20	40	60	80		
TOPSOIL	[REDACTED]	G	1										
Very stiff, brown <b>SILTY CLAY</b>	[DIAGONAL HATCH]	G	2										
End of Test Pit													
TP terminated on bedrock surface @ 0.90m depth (TP dry upon completion)													



**DATUM** TBM - Top spindle of fire hydrant located at the southwest corner of subject site.  
Assumed elevation = 100.00m.

**REMARKS**

**FILE NO.** PG2024

**HOLE NO.** TP 2

**BORINGS BY** Backhoe

**DATE** 27 January 2010

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Piezometer Construction	
		TYPE	NUMBER	RECOVERY	N VALUE or RQD			○ Water Content %					
GROUND SURFACE								20	40	60	80		
TOPSOIL	[REDACTED]	G	1			0	98.63						
Loose to compact, brown <b>SILTY SAND</b>	[REDACTED]	G	2										
End of Test Pit													
TP terminated on bedrock surface @ 0.50m depth (TP dry upon completion)													

20 40 60 80 100  
**Shear Strength (kPa)**  
▲ Undisturbed    △ Remoulded

**DATUM** TBM - Top spindle of fire hydrant located at the southwest corner of subject site.  
Assumed elevation = 100.00m.

**REMARKS**

**FILE NO.** PG2024

**HOLE NO.** TP 3

**BORINGS BY** Backhoe

**DATE** 27 January 2010

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Piezometer Construction
		TYPE	NUMBER	RECOVERY	N VALUE or RQD			○ Water Content %				
GROUND SURFACE						0	98.21	20	40	60	80	
TOPSOIL		G	1									
	0.25											
Loose, brown <b>SILTY SAND</b>		G	2									
	1.30					1	97.21					
End of Test Pit												
TP terminated on bedrock surface @ 1.30m depth (TP dry upon completion)												

20 40 60 80 100  
**Shear Strength (kPa)**  
▲ Undisturbed    △ Remoulded

**DATUM** TBM - Top spindle of fire hydrant located at the southwest corner of subject site.  
Assumed elevation = 100.00m.

**REMARKS**

**FILE NO.** PG2024

**HOLE NO.** TP 4

**BORINGS BY** Backhoe

**DATE** 27 January 2010

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Piezometer Construction
		TYPE	NUMBER	RECOVERY	N VALUE or RQD			○ Water Content %				
GROUND SURFACE						0	97.80	20	40	60	80	
TOPSOIL	[REDACTED]	G	1									
0.20												
Loose, brown <b>SILTY SAND</b> , trace cobbles	[REDACTED]	G	2									
0.70												
End of Test Pit												
TP terminated on bedrock surface @ 0.70m depth (TP dry upon completion)												

20 40 60 80 100  
**Shear Strength (kPa)**  
▲ Undisturbed    △ Remoulded

**DATUM** TBM - Top spindle of fire hydrant located at the southwest corner of subject site.  
Assumed elevation = 100.00m.

**REMARKS**

**FILE NO.**  
**PG2024**

**HOLE NO.**  
**TP 5**

**BORINGS BY** Backhoe

**DATE** 27 January 2010

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Piezometer Construction
		TYPE	NUMBER	RECOVERY	N VALUE or RQD			20	40	60	80	
GROUND SURFACE						0	97.52					
TOPSOIL		G	1									
End of Test Pit  TP terminated on bedrock surface @ 0.20m depth  (TP dry upon completion)	0.20											





# SYMBOLS AND TERMS

## SOIL DESCRIPTION

Behavioural properties, such as structure and strength, take precedence over particle gradation in describing soils. Terminology describing soil structure are as follows:

Desiccated	-	having visible signs of weathering by oxidation of clay minerals, shrinkage cracks, etc.
Fissured	-	having cracks, and hence a blocky structure.
Varved	-	composed of regular alternating layers of silt and clay.
Stratified	-	composed of alternating layers of different soil types, e.g. silt and sand or silt and clay.
Well-Graded	-	Having wide range in grain sizes and substantial amounts of all intermediate particle sizes (see Grain Size Distribution).
Uniformly-Graded	-	Predominantly of one grain size (see Grain Size Distribution).

The standard terminology to describe the strength of cohesionless soils is the relative density, usually inferred from the results of the Standard Penetration Test (SPT) 'N' value. The SPT N value is the number of blows of a 63.5 kg hammer, falling 760 mm, required to drive a 51 mm O.D. split spoon sampler 300 mm into the soil after an initial penetration of 150 mm.

Relative Density	'N' Value	Relative Density %
Very Loose	<4	<15
Loose	4-10	15-35
Compact	10-30	35-65
Dense	30-50	65-85
Very Dense	>50	>85

The standard terminology to describe the strength of cohesive soils is the consistency, which is based on the undisturbed undrained shear strength as measured by the in situ or laboratory vane tests, penetrometer tests, unconfined compression tests, or occasionally by Standard Penetration Tests.

Consistency	Undrained Shear Strength (kPa)	'N' Value
Very Soft	<12	<2
Soft	12-25	2-4
Firm	25-50	4-8
Stiff	50-100	8-15
Very Stiff	100-200	15-30
Hard	>200	>30

## SYMBOLS AND TERMS (continued)

### SOIL DESCRIPTION (continued)

Cohesive soils can also be classified according to their "sensitivity". The sensitivity is the ratio between the undisturbed undrained shear strength and the remoulded undrained shear strength of the soil.

Terminology used for describing soil strata based upon texture, or the proportion of individual particle sizes present is provided on the Textural Soil Classification Chart at the end of this information package.

### ROCK DESCRIPTION

The structural description of the bedrock mass is based on the Rock Quality Designation (RQD).

The RQD classification is based on a modified core recovery percentage in which all pieces of sound core over 100 mm long are counted as recovery. The smaller pieces are considered to be a result of closely-spaced discontinuities (resulting from shearing, jointing, faulting, or weathering) in the rock mass and are not counted. RQD is ideally determined from NXL size core. However, it can be used on smaller core sizes, such as BX, if the bulk of the fractures caused by drilling stresses (called "mechanical breaks") are easily distinguishable from the normal in situ fractures.

<b>RQD %</b>	<b>ROCK QUALITY</b>
90-100	Excellent, intact, very sound
75-90	Good, massive, moderately jointed or sound
50-75	Fair, blocky and seamy, fractured
25-50	Poor, shattered and very seamy or blocky, severely fractured
0-25	Very poor, crushed, very severely fractured

### SAMPLE TYPES

SS	-	Split spoon sample (obtained in conjunction with the performing of the Standard Penetration Test (SPT))
TW	-	Thin wall tube or Shelby tube
PS	-	Piston sample
AU	-	Auger sample or bulk sample
WS	-	Wash sample
RC	-	Rock core sample (Core bit size AXT, BXL, etc.). Rock core samples are obtained with the use of standard diamond drilling bits.

## SYMBOLS AND TERMS (continued)

### GRAIN SIZE DISTRIBUTION

MC%	-	Natural moisture content or water content of sample, %
LL	-	Liquid Limit, % (water content above which soil behaves as a liquid)
PL	-	Plastic limit, % (water content above which soil behaves plastically)
PI	-	Plasticity index, % (difference between LL and PL)
Dxx	-	Grain size which xx% of the soil, by weight, is of finer grain sizes These grain size descriptions are not used below 0.075 mm grain size
D10	-	Grain size at which 10% of the soil is finer (effective grain size)
D60	-	Grain size at which 60% of the soil is finer
Cc	-	Concavity coefficient = $(D_{30})^2 / (D_{10} \times D_{60})$
Cu	-	Uniformity coefficient = $D_{60} / D_{10}$

Cc and Cu are used to assess the grading of sands and gravels:

Well-graded gravels have:  $1 < Cc < 3$  and  $Cu > 4$

Well-graded sands have:  $1 < Cc < 3$  and  $Cu > 6$

Sands and gravels not meeting the above requirements are poorly-graded or uniformly-graded.

Cc and Cu are not applicable for the description of soils with more than 10% silt and clay (more than 10% finer than 0.075 mm or the #200 sieve)

### CONSOLIDATION TEST

$p'_o$	-	Present effective overburden pressure at sample depth
$p'_c$	-	Preconsolidation pressure of (maximum past pressure on) sample
Ccr	-	Recompression index (in effect at pressures below $p'_c$ )
Cc	-	Compression index (in effect at pressures above $p'_c$ )
OC Ratio		Overconsolidation ratio = $p'_c / p'_o$
Void Ratio		Initial sample void ratio = volume of voids / volume of solids
Wo	-	Initial water content (at start of consolidation test)

### PERMEABILITY TEST

k	-	Coefficient of permeability or hydraulic conductivity is a measure of the ability of water to flow through the sample. The value of k is measured at a specified unit weight for (remoulded) cohesionless soil samples, because its value will vary with the unit weight or density of the sample during the test.
---	---	--

## SYMBOLS AND TERMS (continued)

### STRATA PLOT



Topsoil



Asphalt



Fill



Peat



Sand



Silty Sand



Silt



Sandy Silt



Clay



Silty Clay



Clayey Silty Sand



Glacial Till



Shale



Bedrock


### MONITORING WELL AND PIEZOMETER CONSTRUCTION

#### MONITORING WELL CONSTRUCTION




#### PIEZOMETER CONSTRUCTION



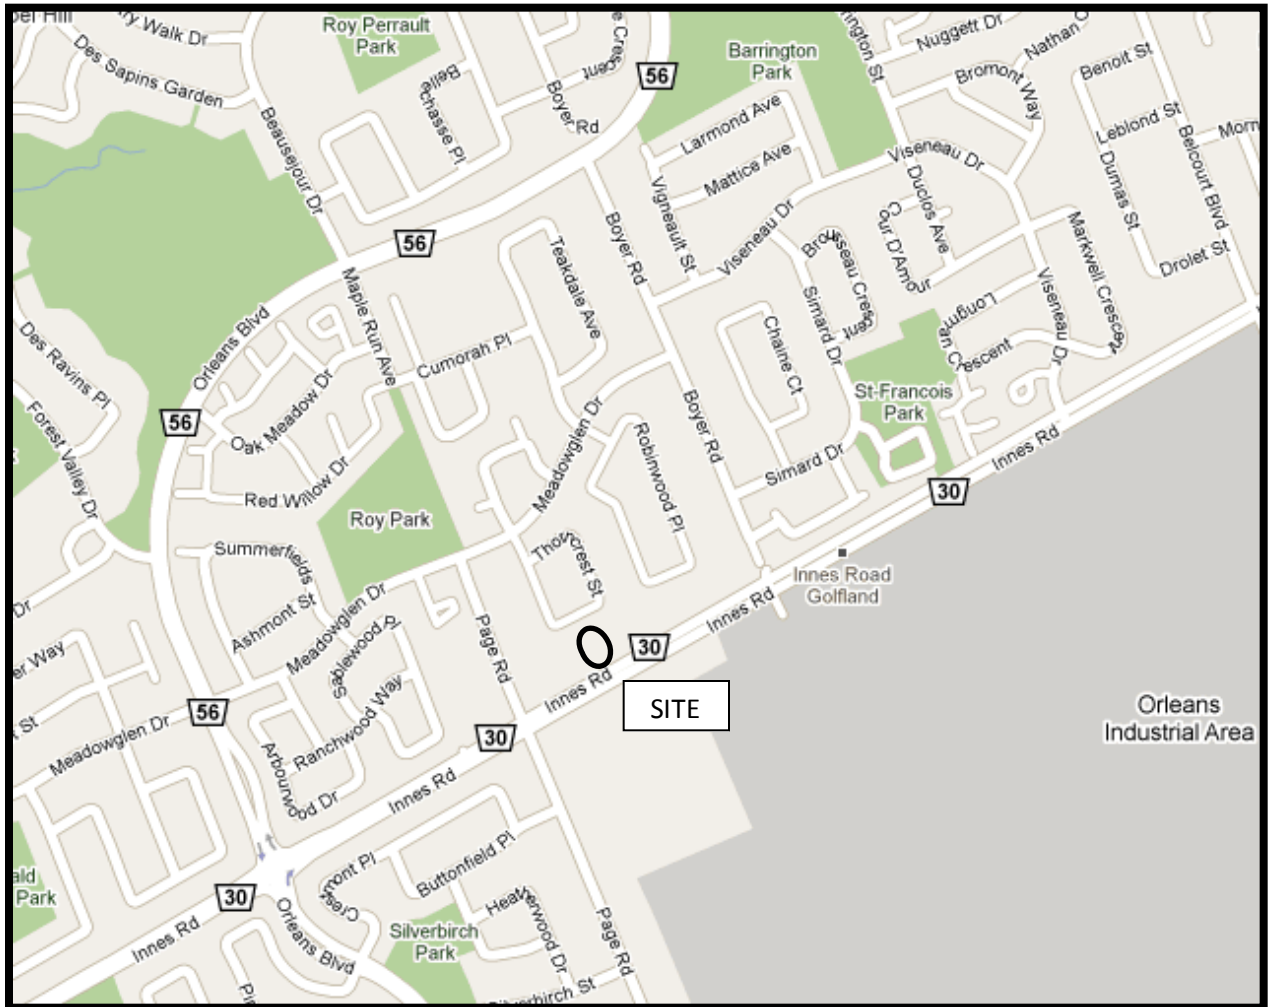


**FIGURE 1**  
**KEY PLAN**

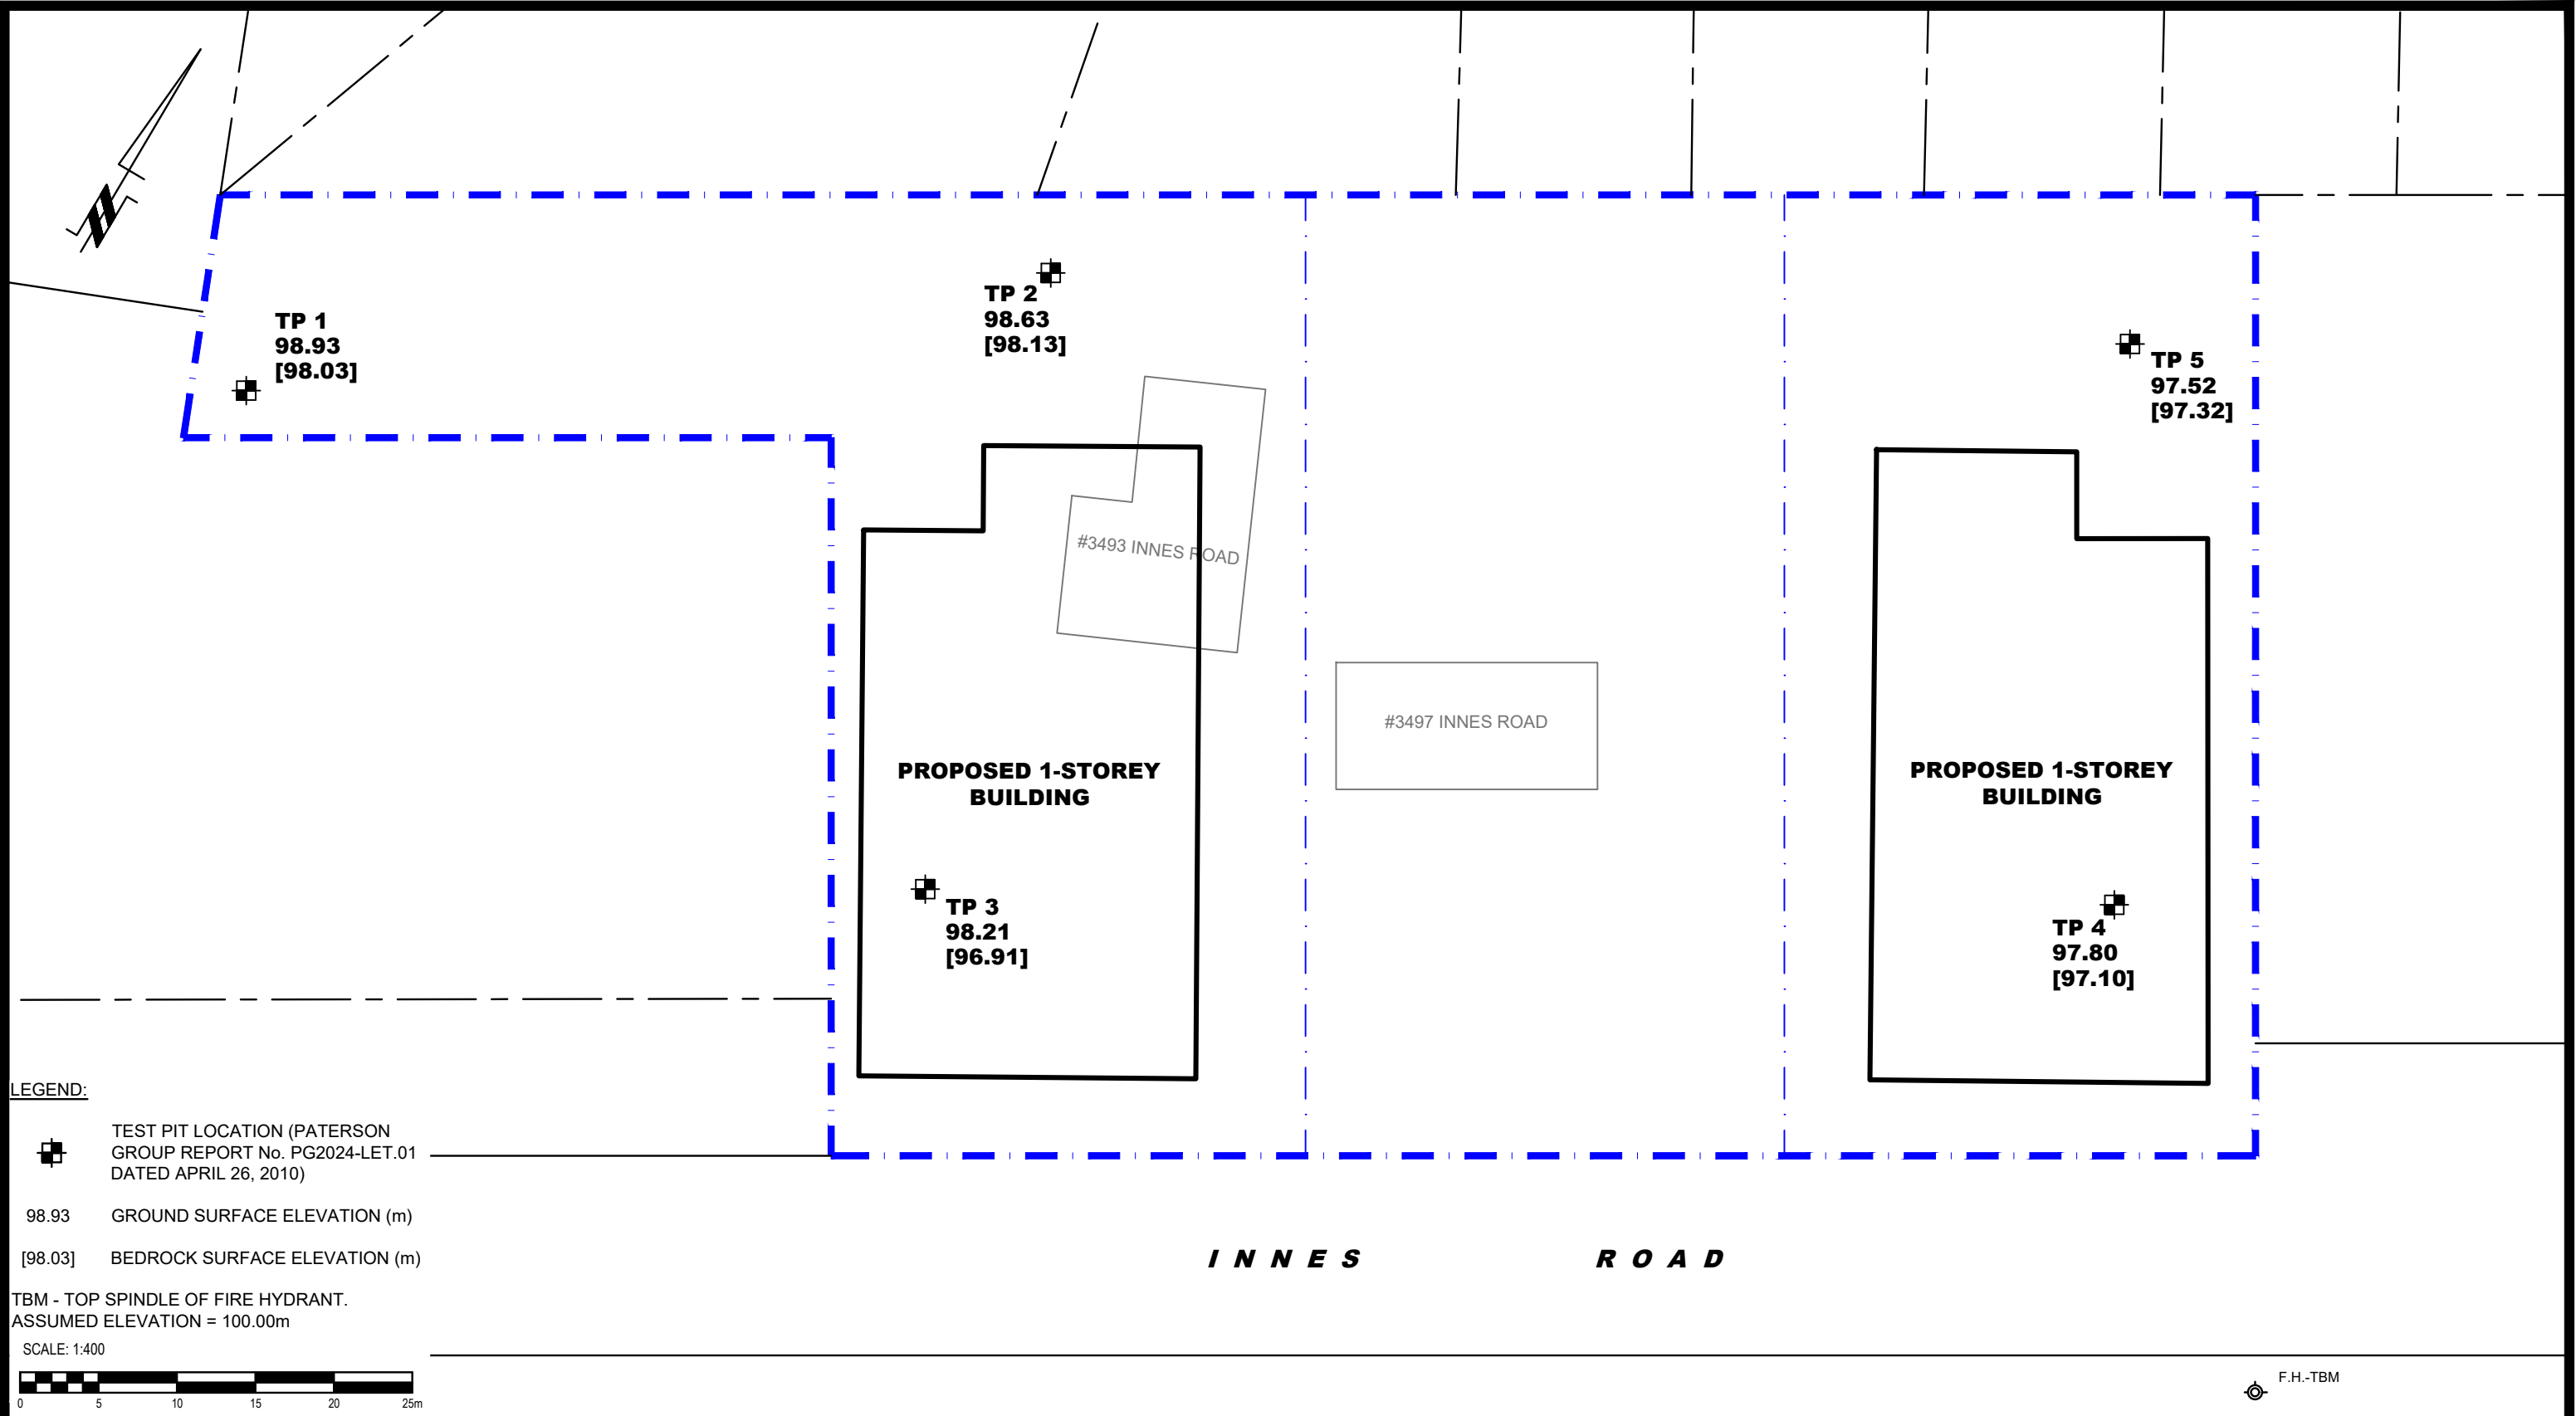


**LEGEND:**

 TEST PIT LOCATION (PATERSON GROUP REPORT No. PG2024-LET.01 DATED APRIL 26, 2010)  
 98.93 GROUND SURFACE ELEVATION (m)  
 [98.03] BEDROCK SURFACE ELEVATION (m)

TBM - TOP SPINDLE OF FIRE HYDRANT.  
 ASSUMED ELEVATION = 100.00m

SCALE: 1:400



F.H.-TBM 

**patersongroup**  
 consulting engineers

154 Colonnade Road South  
 Ottawa, Ontario K2E 7J5  
 Tel: (613) 226-7381 Fax: (613) 226-6344

NO.	REVISIONS	DATE	INITIAL

LAPENSEE  
 GEOTECHNICAL INVESTIGATION  
 PROPOSED DEVELOPMENT  
 3439-3499 INNES ROAD  
 OTTAWA, ONTARIO

Title: **TEST HOLE LOCATION PLAN**

Scale:	1:400	Date:	04/2021
Drawn by:	NFRV	Report No.:	PG5775-LET.01
Checked by:	MS	Dwg. No.:	<b>PG5775-1</b>
Approved by:	DJG	Revision No.:	

p:\autocad\drawings\geotechnical\pg5775\pg5775-1.tlp.dwg