

GENERAL NOTES

- 1. ALL TOPOGRAPHY, GROUND ELEVATIONS AND SURVEY DATA ARE SHOWN FOR INFORMATION PURPOSES ONLY AND IMPLY NO GUARANTEE OF ACCURACY. ALL DIMENSIONS AND ELEVATIONS TO BE VERIFIED BY THE CONTRACTOR PRIOR TO CONSTRUCTION.
- 2. THIS PLAN HAS BEEN PREPARED IN REFERENCE TO A SITE PLANS PREPARED BY CHRISTOPHER A. LEGGETT ARCHITECT INC. DATED 09.22.21
- THIS PLAN HAS BEEN PREPARED IN REFERENCE TO THE PLAN OF SURVEY AS COMPLETED BY ANNIS, O'SULLIVAN, VOLLEBEKK LTD. A SIGNED COPY WAS NOT AVAILABLE, BUT NOTES PROVIDED ON THE SUPPLIED PLAN SPECIFY THE SURVEY WAS COMPLETED ON JULY 12, 2022. 4. THE OWNER IS RESPONSIBLE FOR ALL PERMITS AND APPROVALS FROM THE APPLICABLE AGENCIES PRIOR TO CONSTRUCTION.
- LAYOUT BY OTHERS. ALL DISTURBED AREAS ARE TO BE SEEDED AS SOON AS FEASIBLE. NO BARE TOPSOIL SHALL REMAIN. ALL DISTURBED AREAS INTENDED TO BE FINISHED AS GRASS ARE TO BE TREATED WITH A MIN. 100mm
- TOPSOIL AND SEED (OR SOD). 8. ALL DISTURBED AREAS TO BE RESTORED TO ORIGINAL CONDITION OR BETTER UNLESS OTHERWISE
- SPECIFIED. 9. DISTURBED AREAS WITHIN THE CITY ROAD ALLOWANCE ARE TO BE RESTORED TO THE SATISFACTION
- 10. GRADING NOT TO EXTEND BEYOND PROPERTY LINES. 11. SUITABILITY OF SUBGRADE CONDITIONS TO BE VERIFIED BY A GEOTECHNICAL ENGINEER (OR SUITABLE
- COVER < 1.5m. FROST PROTECTION DESIGN BY OTHERS. 12. ALL PARKING LOT AND GRADING WORKS ARE TO BE COMPLETED IN ACCORDANCE WITH THE CITY STANDARDS AND SPECIFICATIONS. THE CONTRACTOR IS TO ENSURE POSITIVE DRAINAGE AWAY FROM

PROFESSIONAL) PRIOR TO FOOTING INSTALLATION. FROST PROTECTION REQUIRED WHERE DEPTH OF

- ALL BUILDINGS. 13. CONTACT THE CITY FOR INSPECTION AT KEY MILESTONES. REFERENCE SHALL BE MADE TO THE SITE
- PLAN AGREEMENT AND/OR BUILDING PERMIT FOR INSPECTION MILESTONES. 14. ALL WORKS ARE TO BE PERFORMED IN ACCORDANCE WITH CURRENT CODES AND STANDARDS.
- 15. ANY CHANGES MADE TO THIS PLAN ARE TO BE VERIFIED AND APPROVED BY SHADE GROUP INC. AND ARE SUBJECT TO APPROVAL FROM THE APPROPRIATE APPROVAL AGENCIES. 16. THE LOCATION OF THE WELL AND SEPTIC HAS BEEN SHOWN FOR ILLUSTRATION PURPOSES ONLY. THE SUITABILITY OF THE WELL LOCATION IS TO BE VERIFIED BY OTHERS, WHILE THE DESIGN OF THE SEPTIC

IS TO BE COMPLETED BY OTHERS. WELL IS TO BE MIN. 15m FROM ANY SEPTIC SYSTEM (BOTH ON-SITE

EROSION AND SEDIMENT CONTROL NOTES

AND ON ADJACENT PROPERTIES).

- BEST MANAGEMENT PRACTICES SHALL BE IMPLEMENTED BY THE CONTRACTOR/OWNER TO PROTECT THE SITE AND SURROUNDING PROPERTIES DURING CONSTRUCTION ACTIVITIES. THIS INCLUDES PRACTICES SUCH AS LIMITING THE AMOUNT OF DISTURBED LANDS, AND INSTALLATION OF SILT FENCE
- ADDITIONAL EROSION AND SEDIMENT CONTROL MEASURES MAY BE REQUIRED AT THE DISCRETION OF THE PROJECT MANAGER, OWNER, MTO, CONSERVATION AUTHORITY, MECP, MUNICIPALITY OR OTHER APPLICABLE REGULATORY AGENCY.
- DISTURBED AREAS ARE TO BE TOPSOILED, SEEDED AND/OR STABILIZED UPON COMPLETION, OR THROUGH LONG PERIODS OF WORK STOP (E.G. DURING WINTER MONTHS). REGROWTH OF VEGETATION SHALL BE A PRIORITY UPON SITE COMPLETION. VEGETATION OF THE SITE SERVES AS A KEY EROSION AND SEDIMENT CONTROL PRACTICE FOR THE LONG TERM PERFORMANCE
- EROSION AND SEDIMENT CONTROL MEASURES SHALL BE IMPLEMENTED PRIOR TO THE START OF CONSTRUCTION. ALL MEASURES ARE TO BE MONITORED AND MAINTAINED THROUGHOUT THE DURATION OF CONSTRUCTION, INCLUDING UPON COMPLETION, UP UNTIL THE SITE IS DEEMED
- 6. ALL EROSION AND SEDIMENT CONTROL MEASURES ARE TO BE INSTALLED AS PER MANUFACTURER SPECIFICATIONS. WHERE NO SUCH SPECIFICATION IS AVAILABLE, REFERENCE SHALL BE MADE TO THE APPROPRIATE OPSD OR OPSS.
- THE OWNER AND/OR CONTRACTOR IS RESPONSIBLE FOR DEVELOPING A MAINTENANCE AND MONITORING PLAN FOR EROSION AND SEDIMENT CONTROL UP TO PROJECT COMPLETION - AND UPON COMPLETION UNTIL THE SITE IS DEEMED STABLE. THIS SHALL INCLUDE CONSIDERATION FOR INSPECTION, AND DUE CONSIDERATION FOR MAINTENANCE, INCLUDING REMOVAL OF ACCUMULATED SEDIMENT AND REMOVAL IN SUCH A MANNER THAT SEDIMENT IS NOT DISCHARGED DOWNSTREAM.
- 8. REFER TO THE MTO EROSION AND SEDIMENT CONTROL GUIDE ON PROPER PRACTICE IN MAINTENANCE OF EROSION AND SEDIMENT CONTROL MEASURES.

INFILTRATION GALLERY NOTES

4. CAP WITH GRANULAR 'A'. PLACEMENT OF GRANULAR 'A' AND ANY COMPACTION REQUIREMENTS TO

INFILTRATION GALLERY TO BE EXCAVATED TO SPECIFIED BOTTOM ELEVATION.

BE COMPLETED IN CONSULTATION WITH GEOTECHNICAL ENGINEER.

2. CONTRACTOR TO BACKFILL WITH 50mm CLEARSTONE TO SPECIFIED ELEVATION. CONTRACTOR TO CAP CLEARSTONE WITH 40mm HDPE GEOMEMBRANE INSTALLED PER MANUFACTURER'S SPECIFICATIONS.


PERIMETER CONVEYANCE TRENCH NOTES


- PERIMETER CONVEYANCE TRENCH TO BE EXCAVATED TO SPECIFIED BOTTOM ELEVATIONS. 2. CONTRACTOR TO LINE EXCAVATED TRENCH WITH 40mm HDPE GEOMEMBRANE INSTALLED PER MANUFACTURER'S SPECIFICATIONS.
- 3. CONTRACTOR TO BACKFILL TRENCH WITH 50mm CLEARSTONE TO SPECIFIED ELEVATION.


PERIMETER DRAIN DETAILS


N.T.S.

PERIMETER DRAIN LOCKABLE LOW MONITORING WELL PROFILE ALUMINUM MONITORING WELL NOT TO SCALE 4" SMOOTHWALL REFER TO SOLID PIPE CROSS-SECTION 4" SMOOTHWALL — A-A' OR B-B' FOR TRENCH PERFORATED PIPE DETAILS C/W SOCK

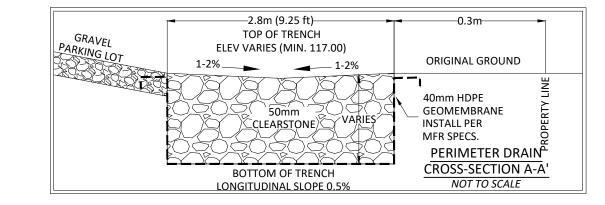

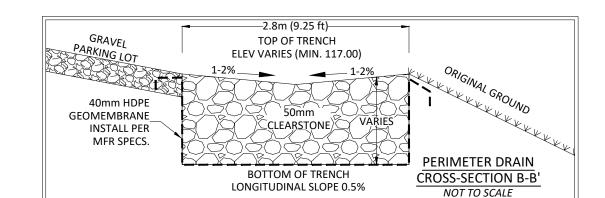


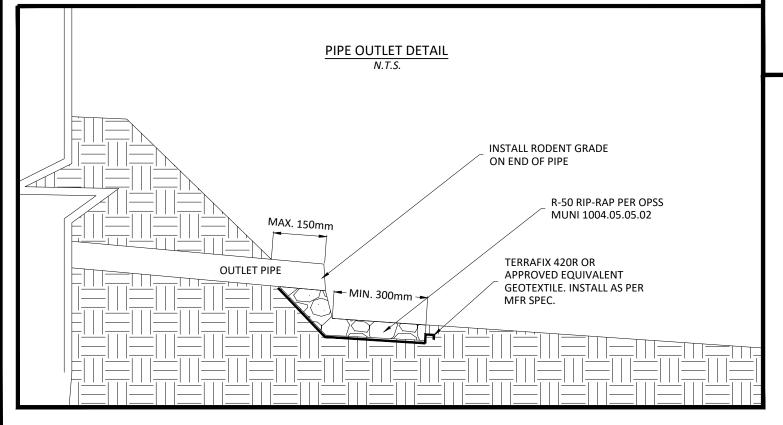

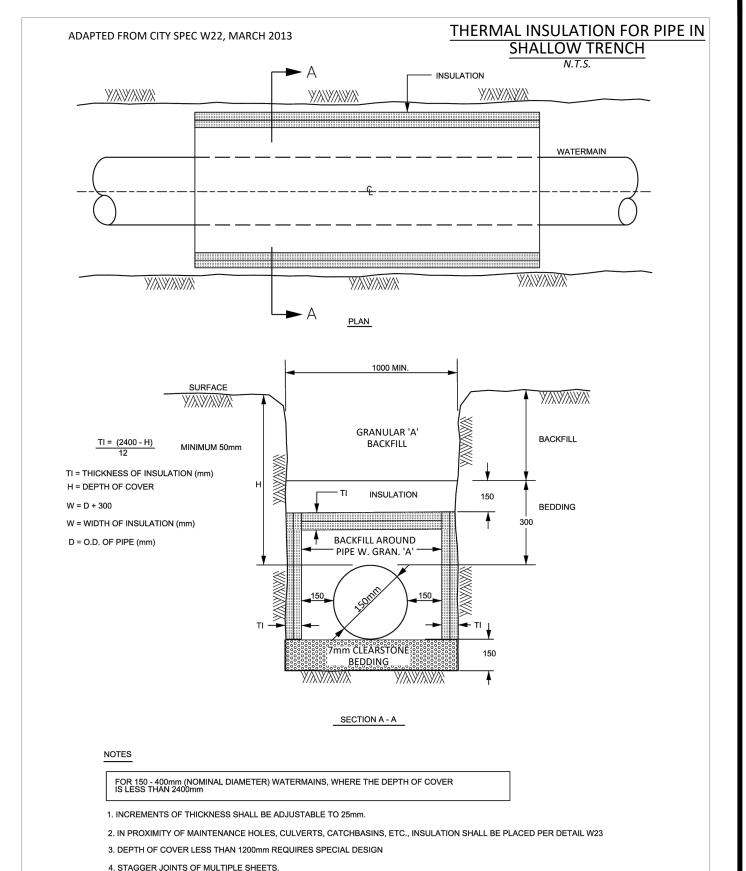

THERMAL INSULATION DEPTH ADAPTED FROM CITY SPEC W21, MAY 2001


INSULATION REFERENCE TABLE		
EFFECTIVE EARTH COVER (H)	REQUIRED THICKNESS (T)	
2400 - 1800 mm	50 mm	
1800 - 1500 mm	75 mm	
1500 - 1200 mm	100 mm	

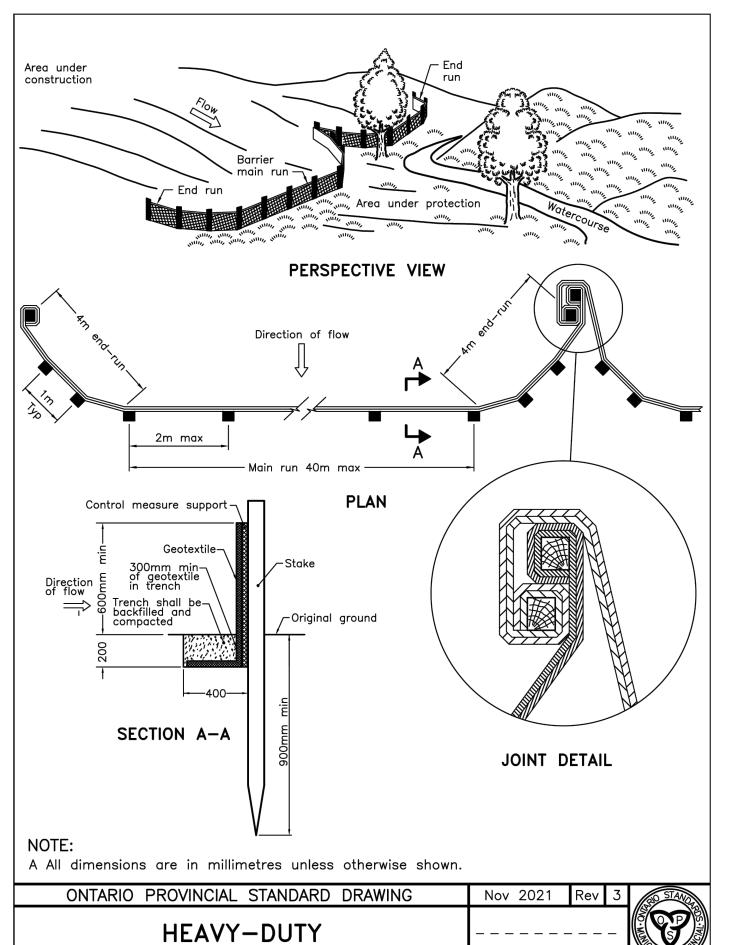

SILT FENCE BARRIER

_ _ _ _ _ _ _ .

_ _ _ _ _ _ _ _ _ .

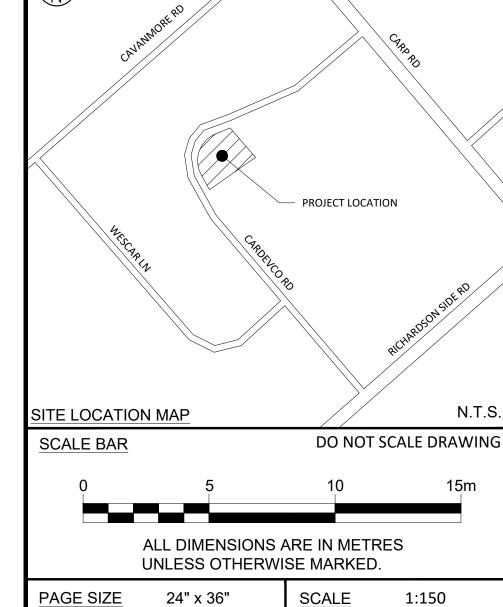

SHADE GROUP INC 4625 MARCH ROAD ALMONTE, ON K0A 1A0


,,			,	
- 1	MOLTA HIDLA	REFERENCE	TADLE	


5. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.

INSULATION REFERENCE TABLE		
EFFECTIVE (H)	REQUIRED THICKNESS (T)	
2400 - 1800 mm	50 mm	
1800 - 1500 mm	75 mm	
1500 - 1200 mm	100 mm	

DETAIL 'E'			11.0m
↑ INFILTRATION GALLERY			4.0m - 1.6m
AND PIPING		0	
$\frac{1}{N.T.S.}$			
14.11.5.			1.6m PRÓP. INFILTRATION GÁLLERY TO ACCEPT ROOFWATER RUNOFF.
			ELEV. = 117.21
			TOP OF CLEARSTONE ELEV. = 117.41
			TOP CLEARSTONE WITH 40mm
			│ │ │ │ │ │ │ │ │ │ │ │ │ │ │ │ │ │ │
	ROOF DOWNSPOUTS TO DRAIN	°	PLACE TBX1500 GEOGRID (OR) APPROVED EQUIVALENT).
	o INTO NDS PRO 24" CATCH BASIN C/W CATCH BASIN FILTER.		CAP WITH GRANULAR 'A'
			SEE DETAIL C-C'
 9.0m	MIN. 6" DIAMETER DOWNSPOUT		SSEE DEȚAJI. C-C'
	6" DIAMETER OUTLET PIPE (~5m) TO CONNECT TO PERFORATED		
	PIPE W. TEE.	0	
	•		
	° /		
		/)	
		.c / _	
		<u>†</u> / 1	
		ROOF DOWNSPOUTS TO DRAIN INTO NDS PRO 24" CATCH BASIN	
\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\		C/W CATCH BASIN FILTER.	
	PROP. INFILTRATION GALLERY TO	MIN. 6" DIAMETER DOWNSPOUT	
	ACCEPT ROOFWATER RUNOFF.	6" DIAMETER OUTLET PIPE (~5m)	
	BOTTOM	TO CONNECT TO PERFORATED PIPE W. TEE.	
	ELEV. = 117.21 TOP OF CLEARSTONE		
	ELEV. = 117.41		
	TOP CLEARSTONE WITH 40mm HDPE GEOMEMBRANE. THEN	°	
	PLACE TBX1500 GEOGRID (OR		
	APPROVED EQUIVALENT).		
	CAP WITH GRANULAR 'A'		2 RUNS x ±29.8m
	SEE DETAIL C-C'		2 RONS X ±29.8m
INSTALL 3.0m			
INCREASER -			
150mm to 200mm			
20011111	°		
	· / / / / / / / / / / / / / / / / / / /	<u>//////////</u> .	INSTALL REDUCER -
	° 1m	0	200mm to 150mm
	INSTALL CLEAN OUT TEE -	INSTALL CLEAN OUT TEE -	INSTALL CLEAN OUT TEE -
	SEE X-SECTION D-D'	SEE X-SECTION D-D'	SEE X-SECTION D-D'

INFILTRATION GALLERY DETAILS

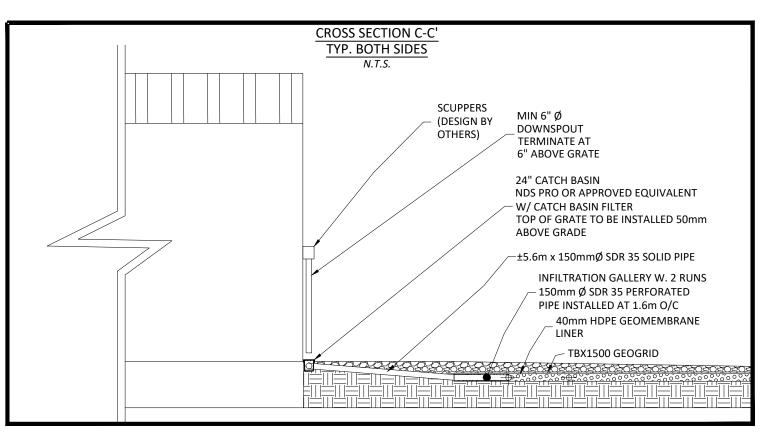

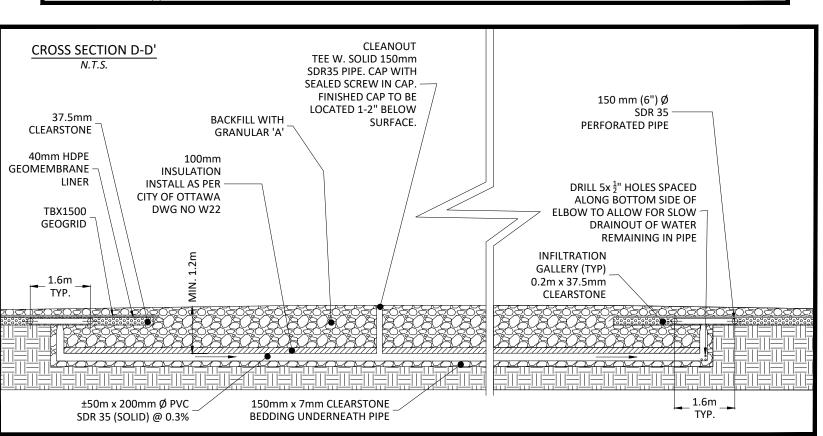

- · · · · · · · · · · · · · · · · · · ·		DAIL
REV.#	REVISION DESCRIPTION	DATE
00	SUBMITTED W. REVISED PLANS	NOV 30, 2023
01	SUBMITTED W. REVISED PLANS	NOV 25, 2024
02	SUBMITTED W. REVISED PLANS	JAN 27, 2025
03	ISSUED FOR CONSTRUCTION	APR 1, 2025

STAMP

DRAWING NO.



PROJECT TITLE	WHELAN TRUCK REPAIR - BUILDING ADDITION
PROJECT ADDRESS	158 CARDEVCO ROAD CARP, ON K0A 1L0
DRAWING TITLE	MISC. DETAILS & CROSS-SECTIONS

2 OF 3

