

GENERAL NOTES

- 1. THE ORIGINAL TOPOGRAPHY, GROUND ELEVATION AND SURVEY DATA SHOWN ARE SUPPLIED FOR INFORMATION PURPOSES ONLY, AND IMPLY NO GUARANTEE OF ACCURACY. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY ALL INFORMATION
- 2. THIS PLAN IS NOT A CADASTRAL SURVEY SHOWING LEGAL PROPERTY BOUNDARIES AND EASEMENTS. THE PROPERTY BOUNDARIES SHOWN HEREON HAVE BEEN DERIVED INFORMATION SUPPLIED BY (OR SHOWN ON) ANNIS, O'SULLIVAN, VOLLEBEKK LTD DRAWING #22549-22 AND CANNOT BE RELIED UPON TO BE ACCURATE OR COMPLETE. THE PRECISE LOCATION OF THE CURRENT PROPERTY BOUNDARIES AND EASEMENTS CAN ONLY BE DETERMINED BY AN UP-TO-DATE LAND TITLES SEARCH AND A SUBSEQUENT CADASTRAL
- 3. THE CONTRACTOR IS TO OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY BEFORE COMMENCING
- CONSTRUCTION. 4. THE CONTRACTOR IS RESPONSIBLE FOR ALL LAYOUT.
- 5. THE CONTRACTOR IS TO DETERMINE THE EXACT LOCATION, SIZE MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT AND ASSUME ALL RESPONSIBILITY FOR EXISTING UTILITIES WHETHER OR NOT SHOWN ON THESE DRAWINGS. IF THERE IS ANY DISCREPANCY THE CONTRACTOR IS TO NOTIFY THE ENGINEER PROMPTLY.
- 6. RESTORE ALL TRENCHES AND SURFACES OF PUBLIC ROAD ALLOWANCES TO CONDITION EQUAL OR BETTER THAN ORIGINAL CONDITION AND TO THE SATISFACTION OF THE CITY AUTHORITIES.
- 7. EXCAVATE AND DISPOSE OF ALL EXCESS EXCAVATED MATERIAL, SUCH AS ASPHALT, CURBING AND DEBRIS, OFF SITE AS DIRECTED BY THE ENGINEER AND THE CITY.
- 8. TOPSOIL TO BE STRIPPED AND STOCKPILED FOR REHABILITATION. CLEAN FILL TO BE PLACED IN FILL AREAS AND COMPACTED TO 95% STANDARD PROCTOR DENSITY.

WATERMAIN NOTES

AVAILABLE) OR OPSD 1109.030.

OPSD 1109.030.

CONSTRUCTION.

EQUIVALENT.

1103.010 AND OPSD 1103.020.

9. ALL DISTURBED AREAS TO BE RESTORED TO ORIGINAL CONDITION OR BETTER UNLESS OTHERWISE SPECIFIED.

ACCORDANCE WITH OPSD STANDARDS AND

SPECIFICATIONS, AS WELL AS CITY STANDARDS.

2. WATERMAINS AND/OR WATER SERVICES ARE TO HAVE A

INSULATION IS REQUIRED AS PER CITY STANDARDS (IF

ALIGNMENT, ENSURE THAT THE AMOUNT OF DEFLECTION

STRUCTURES AS PER CITY STANDARDS (IF AVAILABLE) OR

6. NO CONNECTION TO EXISTING WATER NETWORK SHALL BE

THE CITY. CITY TO BE PRESENT FOR WATERMAIN

COMPLETED UNTIL A WATER PERMIT IS OBTAINED FROM

CONNECTION. CONNECTION, EXCAVATION, BACKFILLING

7. IT WILL BE THE RESPONSIBILITY OF THE CONTRACTOR TO

THIS SHALL BE COMPLETED IN THE PRESENCE OF A DESIGNATED MUNICIPAL WATER OPERATOR AND THE

SELECTED CONTRACTOR SHALL PROVE TO THE

8. CONCRETE THRUST BLOCKS TO CONFORM TO OPSD

9. ALL WATERMAIN TO BE CLASS 150 DR-18 OR APPROVED

10. ALL WATERMAIN TO BE EQUIPPED WITH TRACER WIRE.

PERFORM THE WORKS PRIOR TO INITIATING

PERFORM ANY WATERMAIN CONNECTION(S) REQUIRED.

AND REINSTATEMENT TO BE COMPLETED BY CONTRACTOR.

SATISFACTION OF THE CITY THAT THEY ARE COMPETENT TO

MINIMUM COVER OF 2.4m. OTHERWISE THERMAL

3. IF THE WATERMAIN MUST BE DEFLECTED TO MEET

4. THERMAL INSULATION OF WATERMAINS AT OPEN

RECOMMENDED BY THE MANUFACTURER.

5. VALVES TO BE OPERATED BY CITY STAFF ONLY.

USED IS EQUAL TO OR LESS THAN THAT WHICH IS

SEWER NOTES:

OTHERWISE SPECIFIED.

1. CONSTRUCT ALL WATERMAINS AND APPURTENANCES IN 1. CONSTRUCT ALL SEWERS, CATCH BASINS, MANHOLES AND APPURTENANCES IN ACCORDANCE WITH OPSD STANDARDS AND SPECIFICATIONS, AS WELL AS CITY.

10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL TRAFFIC

12. ALL ROADWAY, PARKING LOT, AND GRADING WORKS TO BE

13. CONTACT THE CITY FOR INSPECTION OF ROUGH GRADING OF

14. ALL DIMENSIONS AND INVERTS MUST BE VERIFIED PRIOR TO

DRAINAGE AWAY FROM THE BUILDING.

TO NOTIFY THE ENGINEER PROMPTLY.

ARE SUBJECT TO THE INDIVIDUAL AGENCY:

• ELECTRICAL SERVICE - HYDRO ONE.

TELEVISION SERVICE - ROGERS.

• GAS SERVICE - ENBRIDGE, • TELEPHONE SERVICE - BELL CANADA,

16. INSTALLATION TO BE IN ACCORDANCE WITH CURRENT CODES AND

18. ALL PROPOSED CURB TO BE CONCRETE BARRIER CURB UNLESS

STANDARDS OF APPROVAL AGENCIES HYDRO ONE, BELL AND THE

UNDERTAKEN IN ACCORDANCE WITH CITY STANDARDS AND

SPECIFICATIONS. THE CONTRACTOR IS TO PROVIDE POSITIVE

PARKING LOTS, ROADWAYS AND LANDSCAPED AREAS PRIOR TO

SHALL BE RECTIFIED TO THE CITY'S SATISFACTION PRIOR TO PLACEMENT OF ANY ASPHALT, TOPSOIL, SEED & MULCH AND/OR

PLACEMENT OF ASPHALT AND TOPSOIL. ALL DEFICIENCIES NOTED

CONTROL AND SAFETY MEASURES DURING THE CONSTRUCTION PERIOD, INCLUDING THE SUPPLY, INSTALLATION, AND REMOVAL OF

ALL NECESSARY SIGNAGE, DELINEATORS, MARKERS AND BARRIERS.

11. DO NOT ALTER GRADING OF THE SITE WITHOUT PRIOR APPROVAL

- 2. SEWER TRENCHING AND BEDDING SHALL CONFORM TO OPSD 802.010 AND 802.013 UNLESS NOTED OTHERWISE. 2.1. BEDDING SHALL BE A MINIMUM 150mm OF GRANULAR "A", COMPACTED TO MINIMUM 95% STANDARD PROCTOR DRY DENSITY. CLEAR STONE BEDDING SHALL NOT BE PERMITTED.
- 2.2. SUB-BEDDING, IF REQUIRED SHALL CONSIST OF 450mm OF COMPACTED GRANULAR "B" TYPE 1. 2.3. BACKFILL TO AT LEAST 300mm ABOVE TOP OF PIPE
- WITH GRANULAR "A" OR GRANULAR "B" TYPE 1. 2.4. TO MINIMIZE DIFFERENTIAL FROST HEAVING, TRENCH BACKFILL (FROM PAVEMENT SUBGRADE TO 2.0 METRES BELOW FINISHED GRADE) SHALL MATCH
- 3. SANITARY SEWERS AND CONNECTIONS 150mmØ AND SMALLER TO BE PVC SDR-28.
- SEWERS AND CONNECTIONS 200mmØ AND LARGER TO BE PVC SDR-35. BEDDING TO BE TYPE "B" EXCEPT AT RISERS, UNLESS NOTED OTHERWISE.

EXISTING SOIL CONDITIONS.

- INSULATE ALL STORM AND SANITARY SEWERS/SERVICES THAT HAVE LESS THAN 2.0m OF COVER WITH THERMAL INSULATION AS PER OPSD 1109.030.
- SEWER CONNECTIONS ARE TO BE MADE ABOVE THE SPRINGLINE OF THE SEWERMAIN AS PER CITY OF OTTAWA STANDARD DRAWING S11, S11.1 & S11.2.
- 7. SUPPLY AND INSTALL ALL PIPING AND APPURTENANCES AS SHOWN AND DETAILED TO WITHIN 1.0m OF BUILDING, ALL ENDS OF SERVICES TO BE PROPERLY
- CAPPED AND LOCATED WITH 2"x4"X8' LONG MARKER. 8. CONTRACTOR TO TELEVISE (CCTV) ALL PROPOSED AND PIPES 150mmØ OR GREATER PRIOR TO BASE COURSE ASPHALT. UPON COMPLETION OF CONTRACT, THE CONTRACTOR IS RESPONSIBLE TO FLUSH AND
- 9. DYE TESTING IS TO BE COMPLETED ON SANITARY SERVICE TO CONFIRM PROPER CONNECTION TO SANITARY SEWER MAIN.

CLEAN ALL SEWERS & APPURTENANCES.


CROSSING CONFLICT TABLE

LOCATION	DESCRIPTION	SEPARATION	
1	EX. 300mmØ SAN SEWER INV 87.20- 50mmØ WATER SERVICE TOP 86.67	0.53	
2	EX. 1350mmØ STM TOP 86.80 - 50mmØ WATER SERVICE INV = 87.3	0.50	
3	200mmØ STM INV 87.61 - 50mmØ WATER SERVICE TOP 86.85	0.76	
4	300mmØ STM TOP 87.15 - 150mmØ SAN SERVICE INV 87.67	0.520	

WATER COVER TABLE

LOCATION	STATION	FINISHED GRADE	TOP OF PIPE	COVER		
WATERMAIN CONNECTION	0+100.00	89.25	86.85	2.40		
SANITARY CROSSING	0+101.75	89.27	86.67	2.60		
STORM CROSSING	0+104.77	89.25	87.35	1.90		
VALVE	0+114.39	89.30	86.90	2.40		
BUILDING	0+163.72	89.50	87.10	2.40		

*NOTE: CONTRACTOR TO ENSURE A MINIMUM OF 0.3m OF VERTICAL SEPARATION BETWEEN EXISTING UTILITIES, SEWERS, AND PROPOSED SERVICES **NOTE: CONTRACTOR TO VERIFY ALL EXISTING SEWER AND UTILITY ELEVATIONS AND IMMEDIATELY ADVISE THE ENGINEER OF ANY

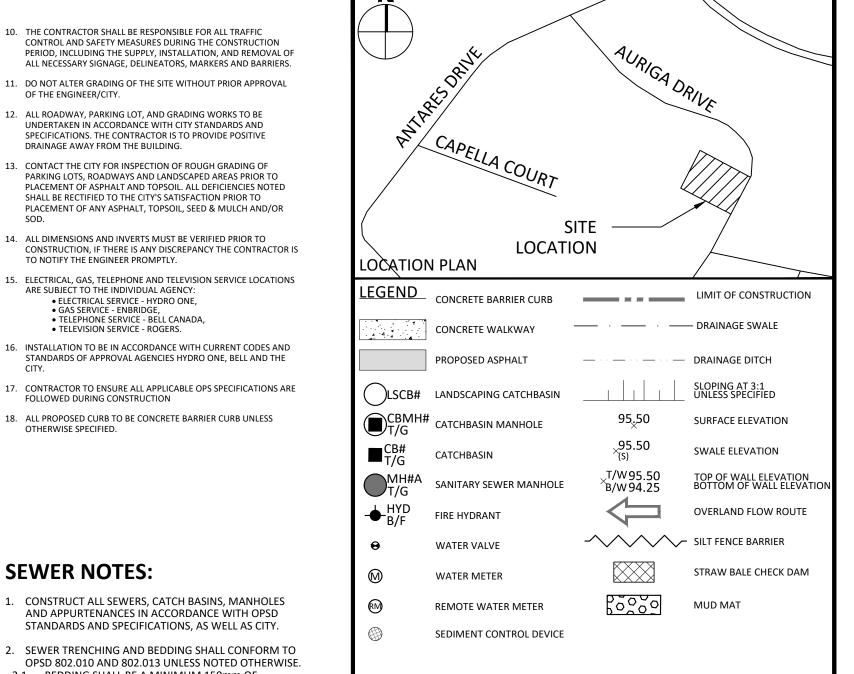


NOT FOR CONSTRUCTION


1	ISSUED FOR SITE PLAN APPLICATION		2022.01.17
No.	Revisions		Date
Check and verify all dimensions before proceeding with the work		Do not	scale drawings

1	3		
SCALE	1:250		
	<u> </u>	 .!_	

McINTOSH PERRY

115 Walgreen Road, RR3, Carp, ON KOA 1L0 Tel: 613-836-2184 Fax: 613-836-3742 www.mcintoshperry.com





ROSSMANN ARCHITECTURE 86 BOUL. ST-JOSEPH GATINEAU, QC J8Y 3W5

PROPOSED WAREHOUSE **30 AURIGA DRIVE**

Drawing Title:

SITE SERVICING PLAN

1:250 CCO-23-0914 M.R. CJM