

Mr. David Young
President
Z.V. Holdings Corporation
1801 Woodward Drive
Ottawa, Ontario, K2C 0R3

Arcadis Canada Inc.
333 Preston Street
Suite 500
Ottawa
Ontario K2H 8K7
Phone: 613 225 1311
Fax: 613 225 9868
www.arcadis.com

Date: 7 June 2023
Our Ref: 30127480 – Geotech
Subject: **Geotechnical Review – Global Stability Analysis**
Proposed Retaining wall, Merivale Warehouse
1881 Merivale Road, Ottawa

Dear Mr. Young,

As per our proposal dated 8 May 2023, Arcadis Canada Inc., (Arcadis) has prepared the following memorandum to provide a geotechnical review of the global stability analysis of the proposed retaining wall structure.

Background Information

As requested, Arcadis Canada Inc., (Arcadis) completed a Redi-Rock retaining wall design to be located on the eastern side of the truck unloading bay of the proposed development. The Redi-Rock retaining wall system has been designed for the subject site to consider site constraints and grading requirements. The walls have also been designed in accordance with the National Building Code of Canada 2020 (NBCC). Details of the retaining wall are presented below and are depicted in Drawing C-01 attached.

The following grading plan prepared by McIntosh-Perry was reviewed as part of our retaining wall designs:

- Project No. CCO-23-1150, Drawing C101, Grading, Drainage and Erosion & Sediment Control Plan, Revision 1 dated 13 February 2023.

Based on our review, the exposed portions of the subject Redi Rock retaining wall vary in height between 0.3m to 1.9m.

Retaining Wall Fencing

The proposed fencing is recommended to be extended through the top two blocks of the Redi Rock wall and designed by others. Open guide rail, chain link fences and others of a “flow-through” configuration, will not impart significant wind loads on the wall. It should be noted that the fencing should be installed using galvanized steel to protect the railing/fencing system from long-term corrosion. Refer to City of Ottawa fencing standard - Figure 7.9

Global and Internal Stability Analysis

The global stability analysis was modeled using Redi-Rock+ software (part of the Fine suite by Geo 5), a computer program which permits a two-dimensional slope stability analysis calculating several methods including the Bishop’s method, which is a widely accepted slope analysis method. The software further allows for the internal review of the design as per various codes including the CHBDC 2019. The program calculates a factor of safety, which represents the ratio of the forces resisting failure to forces favoring failure. Theoretically, a factor of safety of 1.0 represents a condition where the slope is stable. However, due to intrinsic limitations of the calculation methods and the variability of the subsurface soil and groundwater conditions, a factor of safety greater than 1.0 is generally required for the failure risk to be considered acceptable.

A minimum factor of safety of 1.5 is generally recommended for conditions where the slope failure would comprise permanent structures. Based on the configuration of the Site plans reviewed and the conservative nature of the software/parameters used, a factor of safety of 1.3 was considered acceptable. An analysis considering seismic loading was also completed. A horizontal acceleration of 0.1515 g was considered for the sections for the seismic loading condition. A factor of safety of 1.1 is considered to be satisfactory for stability analyses including seismic loading. Based on the conservative nature of the software/parameters used, including the fact that the model does not account for the wall being affixed to the adjacent structure, a factor of safety within rounding error is considered acceptable.

The highest retaining wall cross-section was studied as the worst-case scenario. The following parameters were used for the slope stability analysis under static and seismic conditions:

Table 1 - Effective Soil Parameters for Stability Analysis			
Soil Layer	Unit Weight (kN/m³)	Friction Angle (degrees)	Cohesion (kPa)
SAND, some silt	18	35	0
Granular B Type II	21	40	0

The total strength parameters for seismic analysis were chosen based on the geotechnical testing results from the subject site, and are the same as those used above.

Analysis Results

The factor of safety for the retaining wall section was greater than 1.3 for static conditions. Similarly, the results under seismic loading yielded a factor of safety for this section greater than 1.1.

The internal and structural design reviewed the bearing capacity, overturning resistance, and sliding resistance of the retaining wall units. All analysis were found to be acceptable, the worst case scenarios are presented in attached calculation sheets.

Based on these results, the retaining wall design is considered suitable from a geotechnical perspective.

Geotechnical Recommendations

Backfill Material

The retaining wall should be backfilled with free-draining granular backfill materials and incorporate longitudinal drains and weep holes to provide positive drainage of the backfill. For the purpose of this report, it is recommended that the wall be backfilled with either OPSS Granular B Type II or Granular A materials. The backfill should be placed within a wedge-shaped zone defined by a line drawn up and back from the back edge of the base block of the wall at an inclination of 1H:1V or a minimum of 1 m behind the back of the blocks. All material should be compacted to a minimum of 98% of the material's SPMDD.

Drainage

A 100 mm diameter perforated drainage pipe wrapped in geotextile and surrounded on all sides by 150 mm of clear crushed stone, should be installed at the heel of the bottom block. The drainage should have positive drainage to a nearby outlet such as a catch basin or an existing ditch. It is recommended that the outlets be spaced evenly along the retaining wall with a minimum spacing of 30m center to center passing through the wall or connected to a nearby catch basin.

General Recommendations

It is recommended that the following be completed once the retaining wall design and course of action are determined

- Observation of all bearing surfaces prior to backfill;
- Observation of all subgrades prior to placing backfilling materials;
- Observation of the drainage system prior to backfilling;
- Field density tests to ensure the specified level of compaction was achieved;
- Periodic observation of the retaining wall installation, especially at the first course.

A report confirming that these works have been conducted in general accordance with Arcadis's recommendations could be issued upon request, following the completion of a satisfactory material testing and observation program by the geotechnical consultant.

We trust the current memorandum satisfies your immediate requirements.

Sincerely,
Arcadis Canada Inc.



Troy Austrins P.Eng., PMP
Resource Manager



Ryan Janzen, P.Eng
Geotechnical Engineer

Geotechnical Review – Global Stability Analysis
Arcadis Canada Inc,
7 June 2023

Enclosures:

Attachment 1: Drawing C101: Grading, Drainage and Erosion & Sediment and Erosion Control Plan

Attachment 2: Drawing C-01: Retaining Wall -1; Retaining Wall Design

Attachment 3: Global Stability Section Plots

Analysis of Redi Rock wall

Input data (Stage of construction 1)

Task : Global Stability
 Part : 1881 Merivale Development_Geotech
 Description : Truck Bay Retaining Wall
 Customer : ZV Holdings Corp.
 Author : Ryan Janzen, P.Eng.
 Date : 2023-05-17
 Project ID : Merivale Geotech Consult
 Project number : 30127480

Settings

USA - LRFD

Wall analysis

Verification methodology : according to LRFD
 Active earth pressure calculation : Coulomb
 Passive earth pressure calculation : Mazindrani (Rankine)
 Earthquake analysis : Mononobe-Okabe
 Shape of earth wedge : Calculate as skew
 Allowable eccentricity : 0.333
 Internal stability : Standard - straight slip surface
 Reduction coeff. of contact first block - base : 1.00

Load factors				
Design situation - Service I				
		Minimum	Maximum	
Dead load of structural components :	DC =	1.00 [-]	1.00 [-]	
Dead load of wearing surfaces :	DW =	1.00 [-]	1.00 [-]	
Earth pressure - active :	EH _A =	1.00 [-]	1.00 [-]	
Earth pressure - at rest :	EH _R =	1.00 [-]	1.00 [-]	
Earth surcharge load (permanent) :	ES =	1.00 [-]	1.00 [-]	
Vertical pressure of earth fill :	EV =	1.00 [-]	1.00 [-]	
Live load surcharge :	LL =	0.00 [-]	1.00 [-]	
Water load :	WA =	1.00 [-]	1.00 [-]	

Resistance factors				
Design situation - Service I				
Resistance factor on overturning :	$\phi_o =$	1.00 [-]		
Resistance factor on sliding :	$\phi_t =$	1.00 [-]		
Resistance factor on bearing capacity :	$\phi_b =$	1.00 [-]		
Resistance factor on passive pressure :	$\phi_{VE} =$	1.00 [-]		

Blocks

No.	Description	Height h [mm]	Width w [mm]	Unit weight γ [kN/m ³]
1	Block 28	457.2	711.2	18.85
2	Block 41	457.2	1028.7	18.85
3	Block 60	457.2	1524.0	20.42
4	Top block 24 straight	457.2	609.6	16.97
5	Planter 41	457.2	1028.7	18.85
6	Planter 60	457.2	1524.0	17.59

No.	Description	Height h [mm]	Width w [mm]	Unit weight γ [kN/m ³]
7	Top block 28	457.2	711.2	18.85
8	Top block 41	457.2	1028.7	18.85
9	Top block 24 straight garden	457.2	609.6	12.57
10	Block R-5236 HC	914.4	1320.8	17.28
11	Block R-7236 HC	914.4	1828.8	17.28
12	Block R-9636 HC	914.4	2438.4	17.28
13	Block R-41 HC	457.2	1028.7	17.28

No.	Description	Min. shear strength F _{min} [kN/m]	Max. shear strength F _{max} [kN/m]	Friction f [°]
1	Block 28	88.45	164.56	44.00
2	Block 41	88.45	164.56	44.00
3	Block 60	88.45	164.56	44.00
4	Top block 24 straight	88.45	164.56	44.00
5	Planter 41	88.45	164.56	44.00
6	Planter 60	88.45	164.56	44.00
7	Top block 28	88.45	164.56	44.00
8	Top block 41	88.45	164.56	44.00
9	Top block 24 straight garden	88.45	164.56	44.00
10	Block R-5236 HC	66.40	175.13	44.00
11	Block R-7236 HC	66.40	175.13	44.00
12	Block R-9636 HC	66.40	175.13	44.00
13	Block R-41 HC	78.19	188.35	37.00

Setbacks

No.	Setback s [mm]
1	0.254
2	9.525
3	41.275
4	238.125
5	422.275

Geometry

No. group	Description	Count	Setback s [mm]
1	Block R-5236 HC	2	82.6
2	Top block 24 straight	1	-

Base

Geometry

Upper setback $a_1 = 0.15$ m

Lower setback $a_2 = 0.30$ m

Height $h = 0.30$ m

Width $b = 1.90$ m

Material

Soil creating foundation - Granular

Basic soil parameters

No.	Name	Pattern	φ_{ef} [°]	c_{ef} [kPa]	γ [kN/m ³]	γ_{su} [kN/m ³]	δ [°]
1	SAND, some silt, trace clay		35.00	0.00	18.00	9.00	25.00
2	Granular		40.00	0.00	21.00	12.00	30.00

All soils are considered as cohesionless for at rest pressure analysis.

Soil parameters

SAND, some silt, trace clay

Unit weight : $\gamma = 18.00$ kN/m³
 Stress-state : effective
 Angle of internal friction : $\varphi_{ef} = 35.00$ °
 Cohesion of soil : $c_{ef} = 0.00$ kPa
 Angle of friction struc.-soil : $\delta = 25.00$ °
 Saturated unit weight : $\gamma_{sat} = 19.00$ kN/m³

Granular

Unit weight : $\gamma = 21.00$ kN/m³
 Stress-state : effective
 Angle of internal friction : $\varphi_{ef} = 40.00$ °
 Cohesion of soil : $c_{ef} = 0.00$ kPa
 Angle of friction struc.-soil : $\delta = 30.00$ °
 Saturated unit weight : $\gamma_{sat} = 22.00$ kN/m³

Backfill

Assigned soil : Granular
 Slope = 45.00 °

Geological profile and assigned soils

No.	Thickness of layer t [m]	Depth z [m]	Assigned soil	Pattern
1	2.29	0.00 .. 2.29	SAND, some silt, trace clay	
2	-	2.29 .. ∞	SAND, some silt, trace clay	

Terrain profile

Terrain behind the structure is flat.

Water influence

Ground water table is located below the structure.

Input surface surcharges

No.	Surcharge		Action	Mag.1 [kN/m ²]	Mag.2 [kN/m ²]	Ord.x x [m]	Length l [m]	Depth z [m]
	new	change						
1	Yes		variable	5.00		1.00	0.30	on terrain

No.	Name
1	Pedestrians

Resistance on front face of the structure

Resistance on front face of the structure: not considered
 Soil on front face of the structure - Granular

Soil thickness in front of structure $h = 0.50$ m

Terrain in front of structure is flat.

Applied forces acting on the structure

No.	Force		Name	Action	F_x [kN/m]	F_z [kN/m]	M [kNm/m]	x [m]	z [m]
	new	edit							
1	Yes		Fence Load	permanent	0.00	3.00	0.00	-0.30	0.00

Settings of the stage of construction

Design situation : Service I

Reduction of soil/soil friction angle : do not reduce

Verification No. 1 (Stage of construction 1)

Forces acting on construction

Name	F_{hor} [kN/m]	App.Pt. z [m]	F_{vert} [kN/m]	App.Pt. x [m]	Coeff. overtur.	Coeff. sliding	Coeff. stress
Weight - wall	0.00	-1.07	57.40	0.98	1.000	1.000	1.000
Weight - earth wedge	0.00	-0.48	1.60	1.72	1.000	1.000	1.000
Weight - earth wedge	0.00	-2.35	5.14	1.33	1.000	1.000	1.000
Active pressure	13.69	-0.80	15.86	1.76	1.000	1.000	1.000
Pedestrians	0.47	-1.64	0.25	1.68	1.000	1.000	1.000
Fence Load	0.00	-2.59	3.00	0.77	1.000	1.000	1.000

Verification of complete wall

Check for overturning stability

Resisting moment $M_{res} = 96.30$ kNm/m

Overturning moment $M_{ovr} = 11.75$ kNm/m

Capacity demand ratio CDR = 8.19

Wall for overturning is SATISFACTORY

Check for slip

Resisting horizontal force $H_{res} = 58.29$ kN/m

Active horizontal force $H_{act} = 14.17$ kN/m


Capacity demand ratio CDR = 4.11

Wall for slip is SATISFACTORY

Overall check - WALL is SATISFACTORY

Name : Verification
Description : Initial

Stage - analysis : 1 - 1

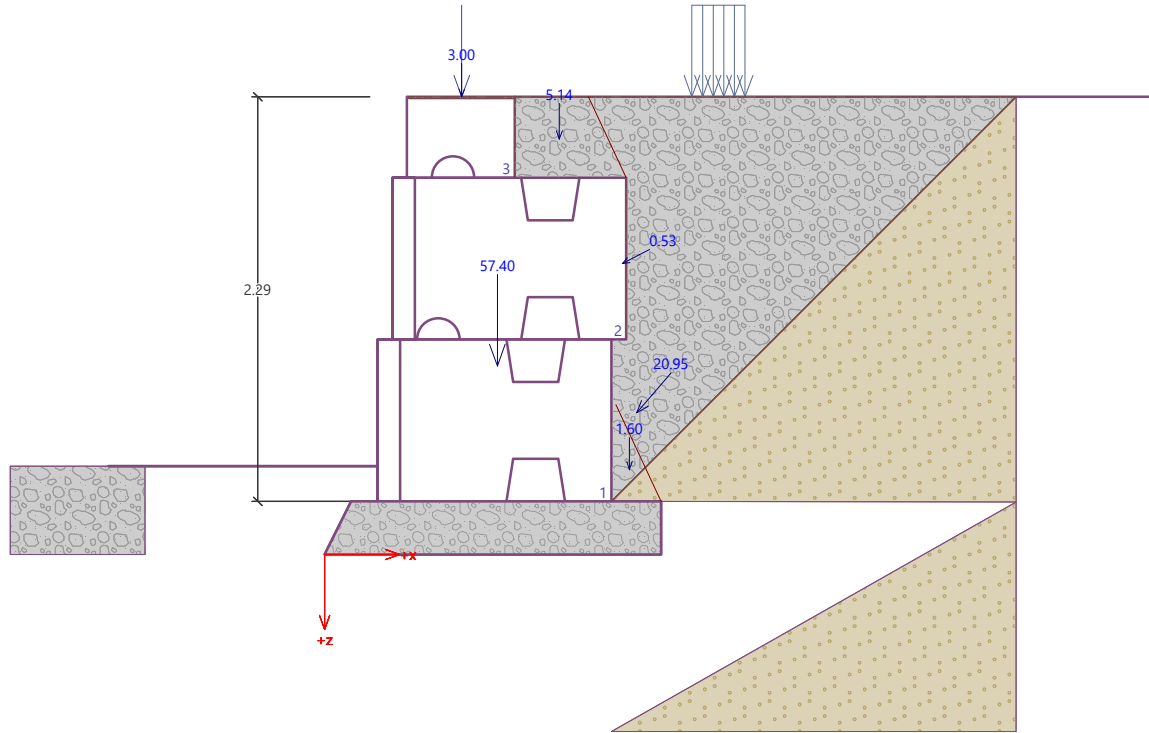

Dimensioning No. 1 (Stage of construction 1)

Forces acting on construction

Name	F _{hor} [kN/m]	App.Pt. z [m]	F _{vert} [kN/m]	App.Pt. x [m]	Coeff. overturn.	Coeff. sliding	Coeff. stress
Weight - wall	0.00	-1.01	45.43	0.68	1.000	1.000	1.000
Weight - earth wedge	0.00	-2.05	5.14	1.03	1.000	1.000	1.000
Active pressure	9.07	-0.78	5.48	1.35	1.000	1.000	1.000
Pedestrians	0.47	-1.34	0.25	1.38	1.000	1.000	1.000
Fence Load	0.00	-2.29	3.00	0.47	1.000	1.000	1.000

Verification of block No. 1

Check for overturning stability

Resisting moment $M_{res} = 45.45$ kNm/m

Overturning moment $M_{ovr} = 7.69$ kNm/m

Capacity demand ratio CDR = 5.91

Joint for overturning stability is SATISFACTORY

Check for slip

Resisting horizontal force $H_{res} = 49.75$ kN/m

Active horizontal force $H_{act} = 9.54$ kN/m

Capacity demand ratio CDR = 5.21

Joint for verification is SATISFACTORY


Bearing capacity of foundation soil (Stage of construction 1)

Design load acting at the center of footing bottom

No.	Moment [kNm/m]	Norm. force [kN/m]	Shear Force [kN/m]	Eccentricity [-]	Stress [kPa]
1	-5.46	83.25	14.17	0.000	43.81

Service load acting at the center of footing bottom

No.	Moment [kNm/m]	Norm. force [kN/m]	Shear Force [kN/m]
1	-5.46	83.25	14.17

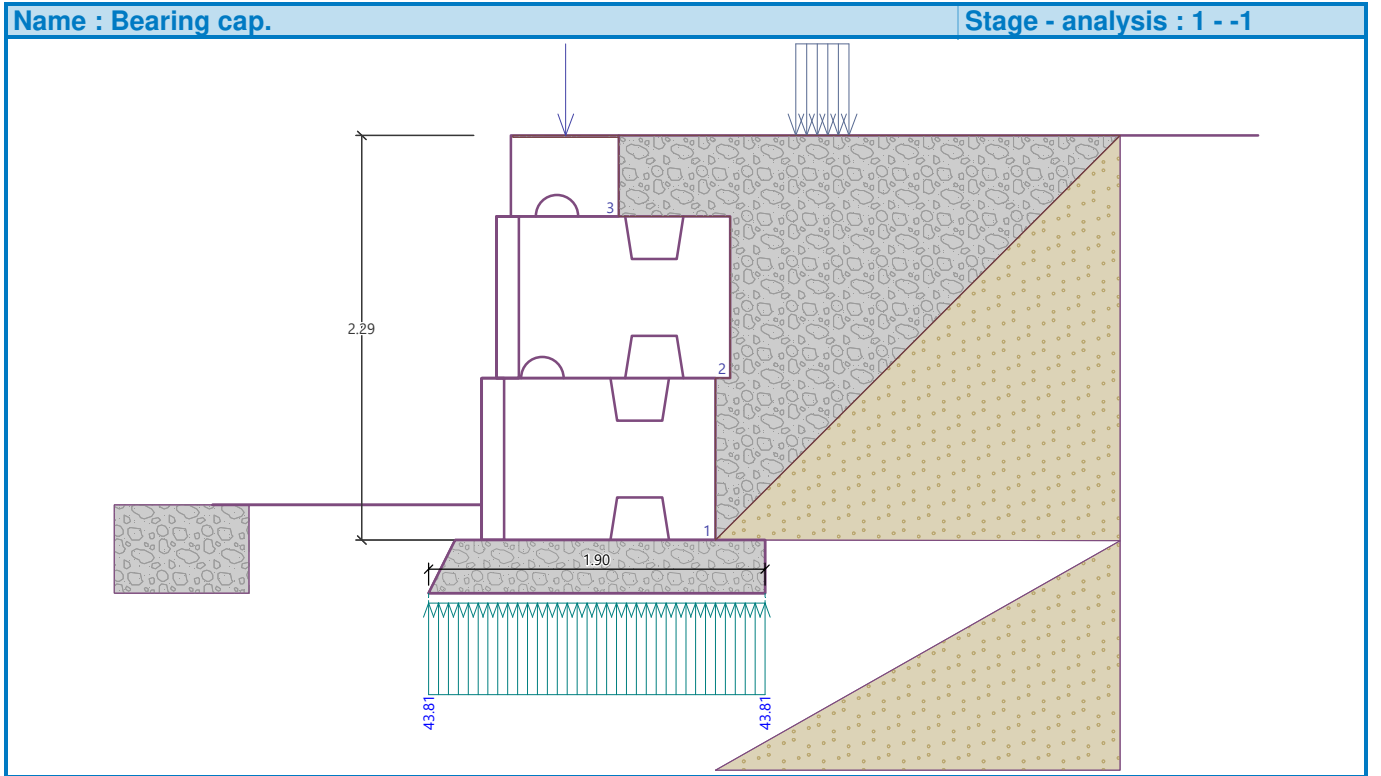

Slope stability analysis

Input data (Construction stage 1)

Settings

USA - LRFD

Stability analysis

Verification methodology : according to LRFD




Earthquake analysis : Standard

Load factors			
Design situation - Service I			
		Minimum	Maximum
Earth surcharge load (permanent) :	ES =	1.00 [-]	1.00 [-]
Live load surcharge :	LL =	0.00 [-]	1.00 [-]



Resistance factors		
Design situation - Service I		
Resistance factor on stability :	$\phi_{SS} =$	0.65 [-]

Interface

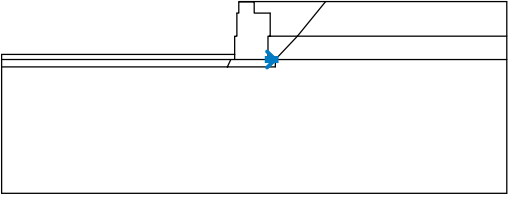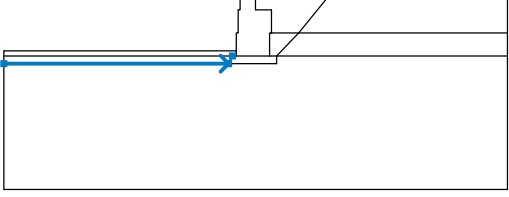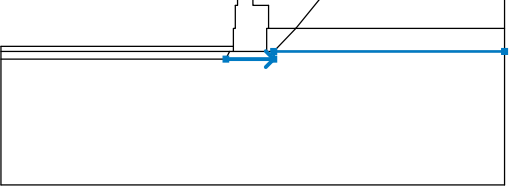

No.	Interface location	Coordinates of interface points [m]					
		x	z	x	z	x	z
1		-0.60	0.00	-0.60	-0.01	0.00	-0.01
		0.00	-0.46	0.63	-0.46		
2		1.71	-1.37	2.83	0.00		
3		-10.00	-2.09	-0.77	-2.09	-0.77	-1.37
		-0.69	-1.37	-0.69	-0.46	-0.61	-0.46
		-0.61	0.00	-0.60	0.00	0.00	0.00
		2.83	0.00	10.00	0.00		
4		-0.77	-2.29	0.55	-2.29	0.55	-1.37
		0.63	-1.37	0.63	-0.46		
5		0.63	-1.37	1.71	-1.37	10.00	-1.37
6		0.83	-2.29	1.71	-1.37		
7		-10.00	-2.29	-0.92	-2.29	-0.77	-2.29
		-0.77	-2.09				

No.	Interface location	Coordinates of interface points [m]					
		x	z	x	z	x	z
8		0.55	-2.29	0.83	-2.29		
9		-10.00	-2.59	-1.07	-2.59	-0.92	-2.29
10		-1.07	-2.59	0.83	-2.59	0.83	-2.29
		10.00	-2.29				

Soil parameters - effective stress state

No.	Name	Pattern	ϕ_{ef} [°]	c_{ef} [kPa]	γ [kN/m ³]
1	SAND, some silt, trace clay		35.00	0.00	18.00
2	Granular		40.00	0.00	21.00

Soil parameters - uplift

No.	Name	Pattern	γ_{sat} [kN/m ³]	γ_s [kN/m ³]	n [-]
1	SAND, some silt, trace clay		19.00		
2	Granular		22.00		

Soil parameters


SAND, some silt, trace clay

Unit weight : $\gamma = 18.00 \text{ kN/m}^3$
 Stress-state : effective
 Shear strength : Mohr-Coulomb
 Angle of internal friction : $\phi_{ef} = 35.00^\circ$
 Cohesion of soil : $c_{ef} = 0.00 \text{ kPa}$
 Saturated unit weight : $\gamma_{sat} = 19.00 \text{ kN/m}^3$





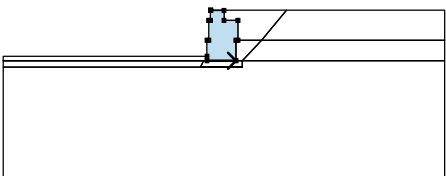

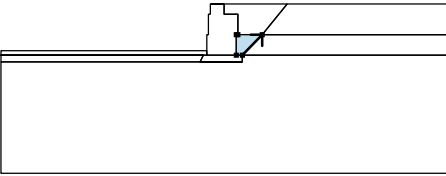

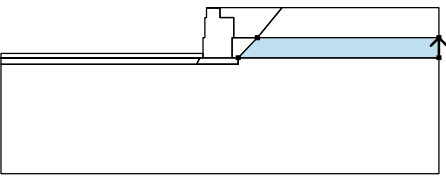

Granular

Unit weight : $\gamma = 21.00 \text{ kN/m}^3$
 Stress-state : effective
 Shear strength : Mohr-Coulomb
 Angle of internal friction : $\phi_{ef} = 40.00^\circ$
 Cohesion of soil : $c_{ef} = 0.00 \text{ kPa}$
 Saturated unit weight : $\gamma_{sat} = 22.00 \text{ kN/m}^3$

Rigid Bodies

No.	Name	Sample	γ [kN/m ³]
1	Material of structure		18.85

Assigning and surfaces

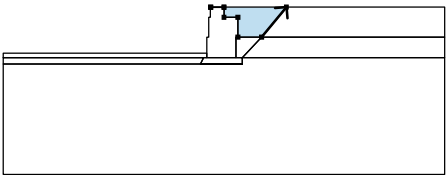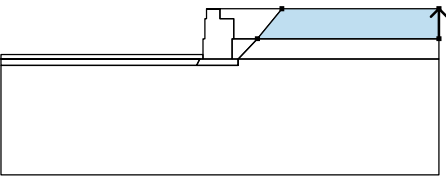No.	Surface position	Coordinates of surface points [m]				Assigned soil
		x	z	x	z	
1		1.71	-1.37	2.83	0.00	Granular 
		0.00	0.00	-0.60	0.00	
		-0.60	-0.01	0.00	-0.01	
		0.00	-0.46	0.63	-0.46	
		0.63	-1.37			
2		10.00	-1.37	10.00	0.00	SAND, some silt, trace clay 
		2.83	0.00	1.71	-1.37	
3		-0.77	-2.29	0.55	-2.29	Material of structure 
		0.55	-1.37	0.63	-1.37	
		0.63	-0.46	0.00	-0.46	
		0.00	-0.01	-0.60	-0.01	
		-0.60	0.00	-0.61	0.00	
		-0.61	-0.46	-0.69	-0.46	
		-0.69	-1.37	-0.77	-1.37	
4		0.83	-2.29	1.71	-1.37	Granular 
		0.63	-1.37	0.55	-1.37	
		0.55	-2.29			
5		10.00	-2.29	10.00	-1.37	SAND, some silt, trace clay 
		1.71	-1.37	0.83	-2.29	

No.	Surface position	Coordinates of surface points [m]				Assigned soil
		x	z	x	z	
6		-0.92	-2.29	-0.77	-2.29	Granular
		-0.77	-2.09	-10.00	-2.09	
		-10.00	-2.29			
7		-1.07	-2.59	-0.92	-2.29	Granular
		-10.00	-2.29	-10.00	-2.59	
8		0.83	-2.59	0.83	-2.29	Granular
		0.55	-2.29	-0.77	-2.29	
		-0.92	-2.29	-1.07	-2.59	
9		0.83	-2.29	0.83	-2.59	SAND, some silt, trace clay
		-1.07	-2.59	-10.00	-2.59	
		-10.00	-7.59	10.00	-7.59	
		10.00	-2.29			

Surcharge

No.	Type	Type of action	Location z [m]	Origin		Width b [m]	Slope α [°]	Magnitude	
				x [m]	l [m]			q, q ₁ , f, F, x	q ₂ , z
1	strip	variable	on terrain	x = 1.00	l = 0.30		0.00	5.00	kN/m ²

Surcharges

No.	Name
1	Pedestrians

Earthquake

Earthquake not included.

Settings of the stage of construction

Design situation : Service I

Results (Construction stage 1)

Analysis 1

Circular slip surface

Slip surface parameters							
Center :	x =	-1.03	[m]	Angles :	$\alpha_1 =$	-35.12	[°]
	z =	0.83	[m]		$\alpha_2 =$	76.56	[°]
Radius :	R =	3.57	[m]				

The slip surface after optimization.

Total weight of soil above the slip surface: 145.52 kN/m

Slope stability verification (Bishop)

Sum of active forces : $F_a = 52.63$ kN/m

Sum of passive forces : $F_p = 113.14$ kN/m


Sliding moment : $M_a = 187.91$ kNm/m

Resisting moment : $M_p = 262.53$ kNm/m

Utilization : 71.6 %

Capacity demand ratio CDR: 1.397

Slope stability ACCEPTABLE

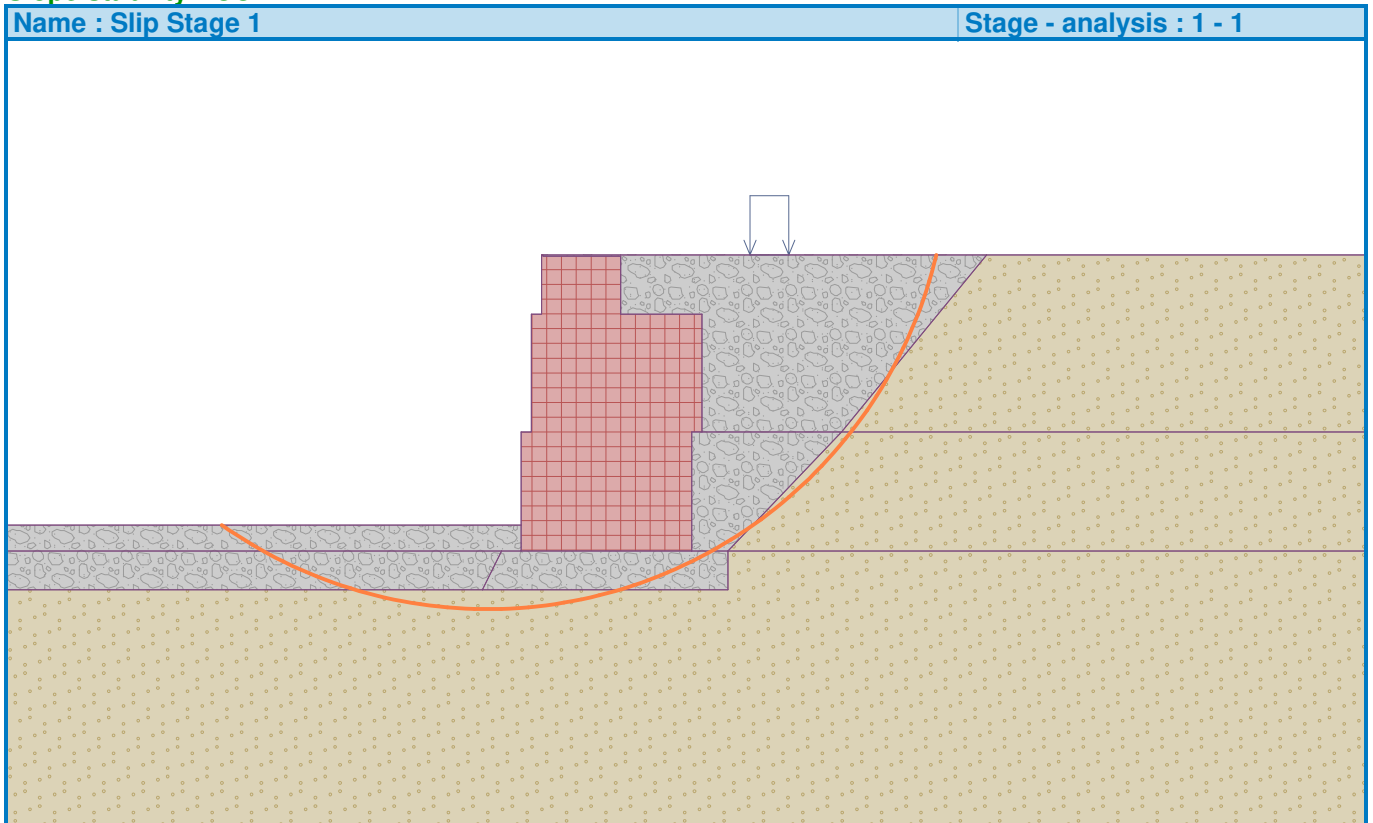

Input data (Stage of construction 2)

Geological profile and assigned soils

No.	Thickness of layer t [m]	Depth z [m]	Assigned soil	Pattern
1	2.29	0.00 .. 2.29	SAND, some silt, trace clay	
2	-	2.29 .. ∞	SAND, some silt, trace clay	

Terrain profile

Terrain behind the structure is flat.

Water influence

Ground water table is located below the structure.

Resistance on front face of the structure

Resistance on front face of the structure: at rest

Soil on front face of the structure - Granular

Soil thickness in front of structure $h = 0.50 \text{ m}$

Terrain in front of structure is flat.

Applied forces acting on the structure

No.	Force		Name	Action	F_x [kN/m]	F_z [kN/m]	M [kNm/m]	x [m]	z [m]
	new	edit							
1	No	No	Fence Load	permanent	0.00	3.00	0.00	-0.30	0.00

Earthquake

Factor of horizontal acceleration $K_h = 0.1515$

Factor of vertical acceleration $K_v = 0.0000$

Water below the GWT is restricted.

Combination 1 - Seismic load reduction factor $p_{1,ir} = 0.50$

Combination 1 - Earth pressure reduction factor $p_{1,ae} = 1.00$

Combination 2 - Seismic load reduction factor $p_{2,ir} = 1.00$

Combination 2 - Earth pressure reduction factor $p_{2,ae} = 0.50$

Settings of the stage of construction

Design situation : Service I

Reduction of soil/soil friction angle : do not reduce

Verification No. 1 (Stage of construction 2)

Forces acting on construction - combination 1

Name	F_{hor} [kN/m]	App.Pt. z [m]	F_{vert} [kN/m]	App.Pt. x [m]	Coeff. overtur.	Coeff. sliding	Coeff. stress
Weight - wall	0.00	-1.07	57.40	0.98	1.000	1.000	1.000
Earthq.- constr.	8.84	-1.12	0.00	0.97	0.500	0.500	0.500
FF resistance	-0.94	-0.17	0.01	-0.15	1.000	1.000	1.000
Weight - earth wedge	0.00	-0.48	1.60	1.72	1.000	1.000	1.000
Earthquake - soil wedge	0.24	-0.48	0.00	1.72	0.500	0.500	0.500
Weight - earth wedge	0.00	-2.35	5.14	1.33	1.000	1.000	1.000
Earthquake - soil wedge	0.78	-2.35	0.00	1.33	0.500	0.500	0.500
Active pressure	13.69	-0.80	15.86	1.76	1.000	1.000	1.000
Earthq.- act.pressure	5.82	-1.75	7.37	1.64	1.000	1.000	1.000
Fence Load	0.00	-2.59	3.00	0.77	1.000	1.000	1.000

Verification of complete wall

Check for overturning stability

Resisting moment $M_{res} = 107.96 \text{ kNm/m}$

Overturning moment $M_{ovr} = 26.94 \text{ kNm/m}$

Capacity demand ratio CDR = 4.01

Wall for overturning is SATISFACTORY

Check for slip

Resisting horizontal force $H_{res} = 63.28 \text{ kN/m}$

Active horizontal force $H_{act} = 23.50 \text{ kN/m}$

Capacity demand ratio CDR = 2.69

Wall for slip is SATISFACTORY

Overall check - WALL is SATISFACTORY

Forces acting on construction - combination 2

Name	F_{hor} [kN/m]	App.Pt. z [m]	F_{vert} [kN/m]	App.Pt. x [m]	Coeff. overtur.	Coeff. sliding	Coeff. stress
Weight - wall	0.00	-1.07	57.40	0.98	1.000	1.000	1.000
Earthq.- constr.	8.84	-1.12	0.00	0.97	1.000	1.000	1.000
FF resistance	-0.94	-0.17	0.01	-0.15	1.000	1.000	1.000
Weight - earth wedge	0.00	-0.48	1.60	1.72	1.000	1.000	1.000
Earthquake - soil wedge	0.24	-0.48	0.00	1.72	1.000	1.000	1.000
Weight - earth wedge	0.00	-2.35	5.14	1.33	1.000	1.000	1.000
Earthquake - soil wedge	0.78	-2.35	0.00	1.33	1.000	1.000	1.000
Active pressure	13.69	-0.80	15.86	1.76	0.500	0.500	0.500
Earthq.- act.pressure	5.82	-1.75	7.37	1.64	0.500	0.500	0.500
Fence Load	0.00	-2.59	3.00	0.77	1.000	1.000	1.000

Verification of complete wall

Check for overturning stability

Resisting moment $M_{res} = 87.94$ kNm/m

Overturning moment $M_{ovr} = 22.27$ kNm/m

Capacity demand ratio CDR = 3.95

Wall for overturning is SATISFACTORY

Check for slip

Resisting horizontal force $H_{res} = 55.15$ kN/m

Active horizontal force $H_{act} = 18.68$ kN/m

Capacity demand ratio CDR = 2.95

Wall for slip is SATISFACTORY

Overall check - WALL is SATISFACTORY

Dimensioning No. 1 (Stage of construction 2)

Forces acting on construction - combination 1

Name	F_{hor} [kN/m]	App.Pt. z [m]	F_{vert} [kN/m]	App.Pt. x [m]	Coeff. overtur.	Coeff. sliding	Coeff. stress
Weight - wall	0.00	-1.01	45.43	0.68	1.000	1.000	1.000
Earthq.- constr.	7.29	-1.03	0.00	0.68	0.500	0.500	0.500
FF resistance	-0.15	-0.07	0.00	0.00	1.000	1.000	1.000
Weight - earth wedge	0.00	-2.05	5.14	1.03	1.000	1.000	1.000
Earthquake - soil wedge	0.78	-2.05	0.00	1.03	0.500	0.500	0.500
Active pressure	9.07	-0.78	5.48	1.35	1.000	1.000	1.000
Earthq.- act.pressure	4.64	-1.56	5.44	1.31	1.000	1.000	1.000
Fence Load	0.00	-2.29	3.00	0.47	1.000	1.000	1.000

Verification of block No. 1

Check for overturning stability

Resisting moment $M_{res} = 52.26$ kNm/m

Overturning moment $M_{ovr} = 18.82$ kNm/m

Capacity demand ratio CDR = 2.78

Joint for overturning stability is SATISFACTORY

Check for slip

Resisting horizontal force $H_{res} = 54.12$ kN/m
 Active horizontal force $H_{act} = 17.59$ kN/m

Capacity demand ratio CDR = 3.08

Joint for verification is SATISFACTORY

Forces acting on construction - combination 2

Name	F_{hor} [kN/m]	App.Pt. z [m]	F_{vert} [kN/m]	App.Pt. x [m]	Coeff. overtur.	Coeff. sliding	Coeff. stress
Weight - wall	0.00	-1.01	45.43	0.68	1.000	1.000	1.000
Earthq.- constr.	7.29	-1.03	0.00	0.68	1.000	1.000	1.000
FF resistance	-0.15	-0.07	0.00	0.00	1.000	1.000	1.000
Weight - earth wedge	0.00	-2.05	5.14	1.03	1.000	1.000	1.000
Earthquake - soil wedge	0.78	-2.05	0.00	1.03	1.000	1.000	1.000
Active pressure	9.07	-0.78	5.48	1.35	0.500	0.500	0.500
Earthq.- act.pressure	4.64	-1.56	5.44	1.31	0.500	0.500	0.500
Fence Load	0.00	-2.29	3.00	0.47	1.000	1.000	1.000

Verification of block No. 1

Check for overturning stability

Resisting moment $M_{res} = 44.99$ kNm/m

Overturning moment $M_{ovr} = 16.21$ kNm/m

Capacity demand ratio CDR = 2.78

Joint for overturning stability is SATISFACTORY

Check for slip

Resisting horizontal force $H_{res} = 49.53$ kN/m

Active horizontal force $H_{act} = 14.77$ kN/m

Capacity demand ratio CDR = 3.35

Joint for verification is SATISFACTORY

Bearing capacity of foundation soil (Stage of construction 2)

Design load acting at the center of footing bottom

No.	Moment [kNm/m]	Norm. force [kN/m]	Shear Force [kN/m]	Eccentricity [-]	Stress [kPa]
1	4.83	90.37	23.50	0.028	50.40
2	9.15	78.76	18.68	0.061	47.23
3	9.15	78.76	18.68	0.061	47.23

Service load acting at the center of footing bottom

No.	Moment [kNm/m]	Norm. force [kN/m]	Shear Force [kN/m]
1	10.75	90.37	28.43

Slope stability analysis

Input data (Construction stage 1)

Settings

USA - LRFD

Stability analysis

Verification methodology : according to LRFD

Earthquake analysis : Standard

Load factors			
Design situation - Service I			
		Minimum	Maximum
Earth surcharge load (permanent) :	ES =	1.00 [-]	1.00 [-]
Live load surcharge :	LL =	0.00 [-]	1.00 [-]

Resistance factors		
Design situation - Service I		
Resistance factor on stability :	$\phi_{SS} =$	0.65 [-]

Interface

No.	Interface location	Coordinates of interface points [m]					
		x	z	x	z	x	z
1		-0.60	0.00	-0.60	-0.01	0.00	-0.01
		0.00	-0.46	0.63	-0.46		
2		1.74	-1.37	2.83	0.00		
3		-10.00	-2.09	-0.77	-2.09	-0.77	-1.37
		-0.69	-1.37	-0.69	-0.46	-0.61	-0.46
		-0.61	0.00	-0.60	0.00	0.00	0.00
		2.83	0.00	10.00	0.00		
4		-0.77	-2.29	0.55	-2.29	0.55	-1.37
		0.63	-1.37	0.63	-0.46		
5		0.63	-1.37	1.74	-1.37	10.00	-1.37
6		0.83	-2.29	1.74	-1.37		

No.	Interface location	Coordinates of interface points [m]					
		x	z	x	z	x	z
7		-10.00	-2.29	-0.92	-2.29	-0.77	-2.29
		-0.77	-2.09				
8		0.55	-2.29	0.83	-2.29		
9		-10.00	-2.59	-1.07	-2.59	-0.92	-2.29
10		-1.07	-2.59	0.83	-2.59	0.83	-2.29
		10.00	-2.29				

Soil parameters - effective stress state

No.	Name	Pattern	Φ_{ef} [°]	C_{ef} [kPa]	γ [kN/m ³]
1	SAND, some silt, trace clay		35.00	0.00	18.00
2	Granular		40.00	0.00	21.00

Soil parameters - uplift

No.	Name	Pattern	γ_{sat} [kN/m ³]	γ_s [kN/m ³]	n [-]
1	SAND, some silt, trace clay		19.00		
2	Granular		22.00		

Soil parameters


SAND, some silt, trace clay

Unit weight : $\gamma = 18.00 \text{ kN/m}^3$
 Stress-state : effective
 Shear strength : Mohr-Coulomb
 Angle of internal friction : $\varphi_{ef} = 35.00^\circ$
 Cohesion of soil : $c_{ef} = 0.00 \text{ kPa}$
 Saturated unit weight : $\gamma_{sat} = 19.00 \text{ kN/m}^3$



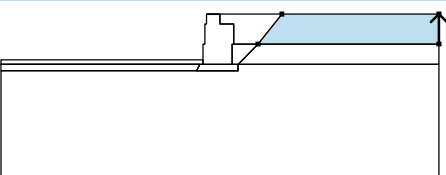

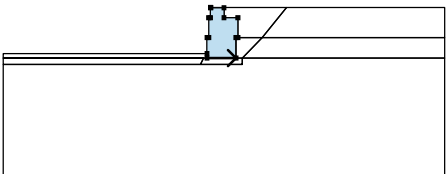

Granular

Unit weight : $\gamma = 21.00 \text{ kN/m}^3$
 Stress-state : effective
 Shear strength : Mohr-Coulomb
 Angle of internal friction : $\varphi_{ef} = 40.00^\circ$
 Cohesion of soil : $c_{ef} = 0.00 \text{ kPa}$
 Saturated unit weight : $\gamma_{sat} = 22.00 \text{ kN/m}^3$

Rigid Bodies

No.	Name	Sample	γ [kN/m ³]
1	Material of structure		18.85

Assigning and surfaces

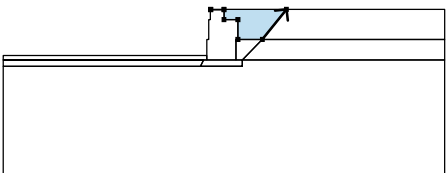No.	Surface position	Coordinates of surface points [m]				Assigned soil
		x	z	x	z	
1		1.74	-1.37	2.83	0.00	Granular 
		0.00	0.00	-0.60	0.00	
		-0.60	-0.01	0.00	-0.01	
		0.00	-0.46	0.63	-0.46	
		0.63	-1.37			
2		10.00	-1.37	10.00	0.00	SAND, some silt, trace clay 
		2.83	0.00	1.74	-1.37	
3		-0.77	-2.29	0.55	-2.29	Material of structure 
		0.55	-1.37	0.63	-1.37	
		0.63	-0.46	0.00	-0.46	
		0.00	-0.01	-0.60	-0.01	
		-0.60	0.00	-0.61	0.00	
		-0.61	-0.46	-0.69	-0.46	
		-0.69	-1.37	-0.77	-1.37	
		-0.77	-2.09			

No.	Surface position	Coordinates of surface points [m]				Assigned soil
		x	z	x	z	
4		0.83	-2.29	1.74	-1.37	Granular
		0.63	-1.37	0.55	-1.37	
		0.55	-2.29			
5		10.00	-2.29	10.00	-1.37	SAND, some silt, trace clay
		1.74	-1.37	0.83	-2.29	
6		-0.92	-2.29	-0.77	-2.29	Granular
		-0.77	-2.09	-10.00	-2.09	
		-10.00	-2.29			
7		-1.07	-2.59	-0.92	-2.29	Granular
		-10.00	-2.29	-10.00	-2.59	
8		0.83	-2.59	0.83	-2.29	Granular
		0.55	-2.29	-0.77	-2.29	
		-0.92	-2.29	-1.07	-2.59	
9		0.83	-2.29	0.83	-2.59	SAND, some silt, trace clay
		-1.07	-2.59	-10.00	-2.59	
		-10.00	-7.59	10.00	-7.59	
		10.00	-2.29			

Earthquake

Horizontal seismic coefficient : $K_h = 0.1515$

Vertical seismic coefficient : $K_v = 0.0000$

Settings of the stage of construction

Design situation : Service I

Results (Construction stage 1)

Analysis 1

Circular slip surface

Slip surface parameters			
Center :	x =	-1.24 [m]	Angles :
	z =	1.52 [m]	$\alpha_1 =$ -32.07 [°]
Radius :	R =	4.26 [m]	$\alpha_2 =$ 69.10 [°]
The slip surface after optimization.			

Total weight of soil above the slip surface: 154.93 kN/m

Slope stability verification (Bishop)

Sum of active forces : $F_a = 69.39$ kN/m

Sum of passive forces : $F_p = 113.67$ kN/m

Sliding moment : $M_a = 295.59$ kNm/m

Resisting moment : $M_p = 314.75$ kNm/m

Utilization : 93.9 %

Capacity demand ratio CDR: 1.065

Slope stability ACCEPTABLE

