

<u>LEGEND</u> PROPOSED CURB SILT FENCE

300mm MINIMUM 11 FILTER CLOTH-PROFILE VIEW 15.0m MINIMUM LEXISTING GROUND EXISTING GROUND, CONSTRUCTION ROAD CONSTRUCTION ROAD, MUDMAP 7,0mx20.0m PLAN VIEW NOTES:


- 1. STONE USE CLEAR CRUSHED 100mm STONE.
- 2. LENGTH AS REQUIRED BUT NOT LESS THAN 15.0m.
- 3. THICKNESS NOT LESS THAN 300mm.

MUST BE REMOVED IMMEDIATELY.

- 4. WIDTH 7.0m MINIMUM, NOT LESS THAN THE WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS.
- 5. FILTER CLOTH WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING STONE.
- . MAINTENANCE THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHT-OF-WAY. THIS MAY REQUIRED PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEAN OUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED OR TRACKED ONTO THE PUBLIC RIGHT-OF-WAY
- 7. PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RAIN.

MUD MAT DETAIL

N.T.S

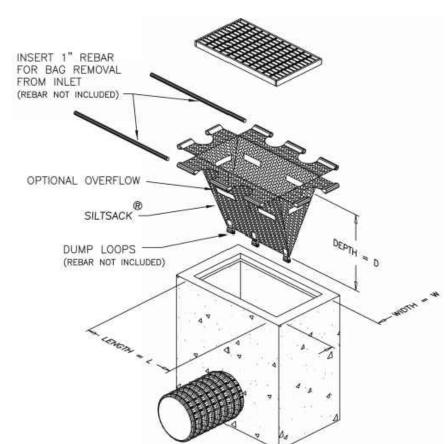

PROVIDE FILTER BAGS AS SHOWN (GEO-SYNTHETICS MANUFACTURER OR APPROVED EQUIVALENT)

FILTER BAG DETAIL

"BULGES" DEVELOP IN THE SILT FENCE. WOOD POSTS TO BE HARDWOOD TYPE (50mm x 50mm). GEOTEXTILE TO BE EMBEDDED 200mm INTO GROUND. 7. GEOTEXTILE TO CONFORM TO OPSS 805 STANDARDS.
8. SILT FENCE MUST BE INSTALLED BEFORE COMMENCEMENT OF CONSTRUCTION AND IN ACCORDANCE WITH DETAIL. SILT FENCE CAN BE REMOVED AFTER LANDSCAPING IS


KONSON WAREHOUSE

E POSITION OF ALL POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND TRUCTURES IS NOT GUARANTEED. BEFORI STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FO

AMAGE TO THEM.

CONSTRUCTION IS COMPLETED.

NOT FOR CONSTRUCTION

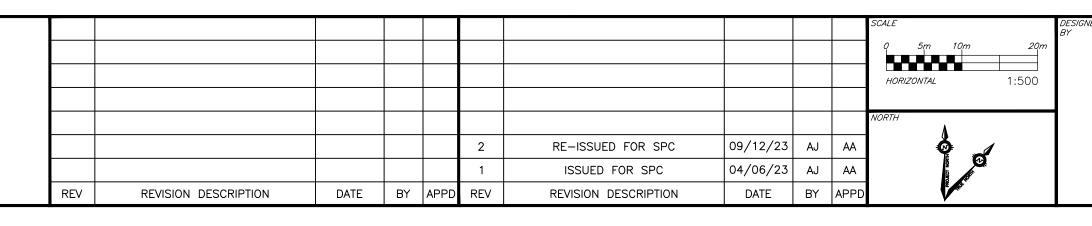



THE PARTY OF THE P	DC
	*e>

OR STAPLES.

FENCE.

DOLYN CONSTRUCTION LTD. 1-888 LADY ELLEN PLACE OTTAWA, ON. K1Z 5L5	
•0	exp Services Inc.
exp.	t: +1.613.688.1899 f: +1.613.225.7330 2650 Queensview Drive, Unit 100 Ottawa, ON K2B 8H6 Canada
· •	www.exp.com
•	BUILDINGS • FARTH & ENVIRONMENT • ENERGY

SECTION A-A

LIGHT-DUTY

SILT FENCE BARRIER

OVERLAPPED BY A MINIMUM OF 500mm.

POSTS TO BE SPACED AT 2.3 METRES CENTRE TO CENTRE.

A All dimensions are in millimetres unless otherwise shown.

PERSPECTIVE VIEW

PLAN

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2015 Rev 2

1. WOVEN WIRE FENCE TO BE FASTENED SECURELY TO WOOD POSTS WITH WIRE TIES

WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE

4. MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN

9. SEDIMENTS MUST BE CLEARED AWAY WHEN THEY REACH HALF THE HEIGHT OF THE

AJ AA NT • ENERGY • • INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

JOINT DETAIL

OPSD 219.110


1485 UPPER CANADA STREET OTTAWA, ONTARIO. EROSION AND SEDIMENT

01/10/2023 C300 CONTROL PLAN

#18973

IT-22023462-

AOV

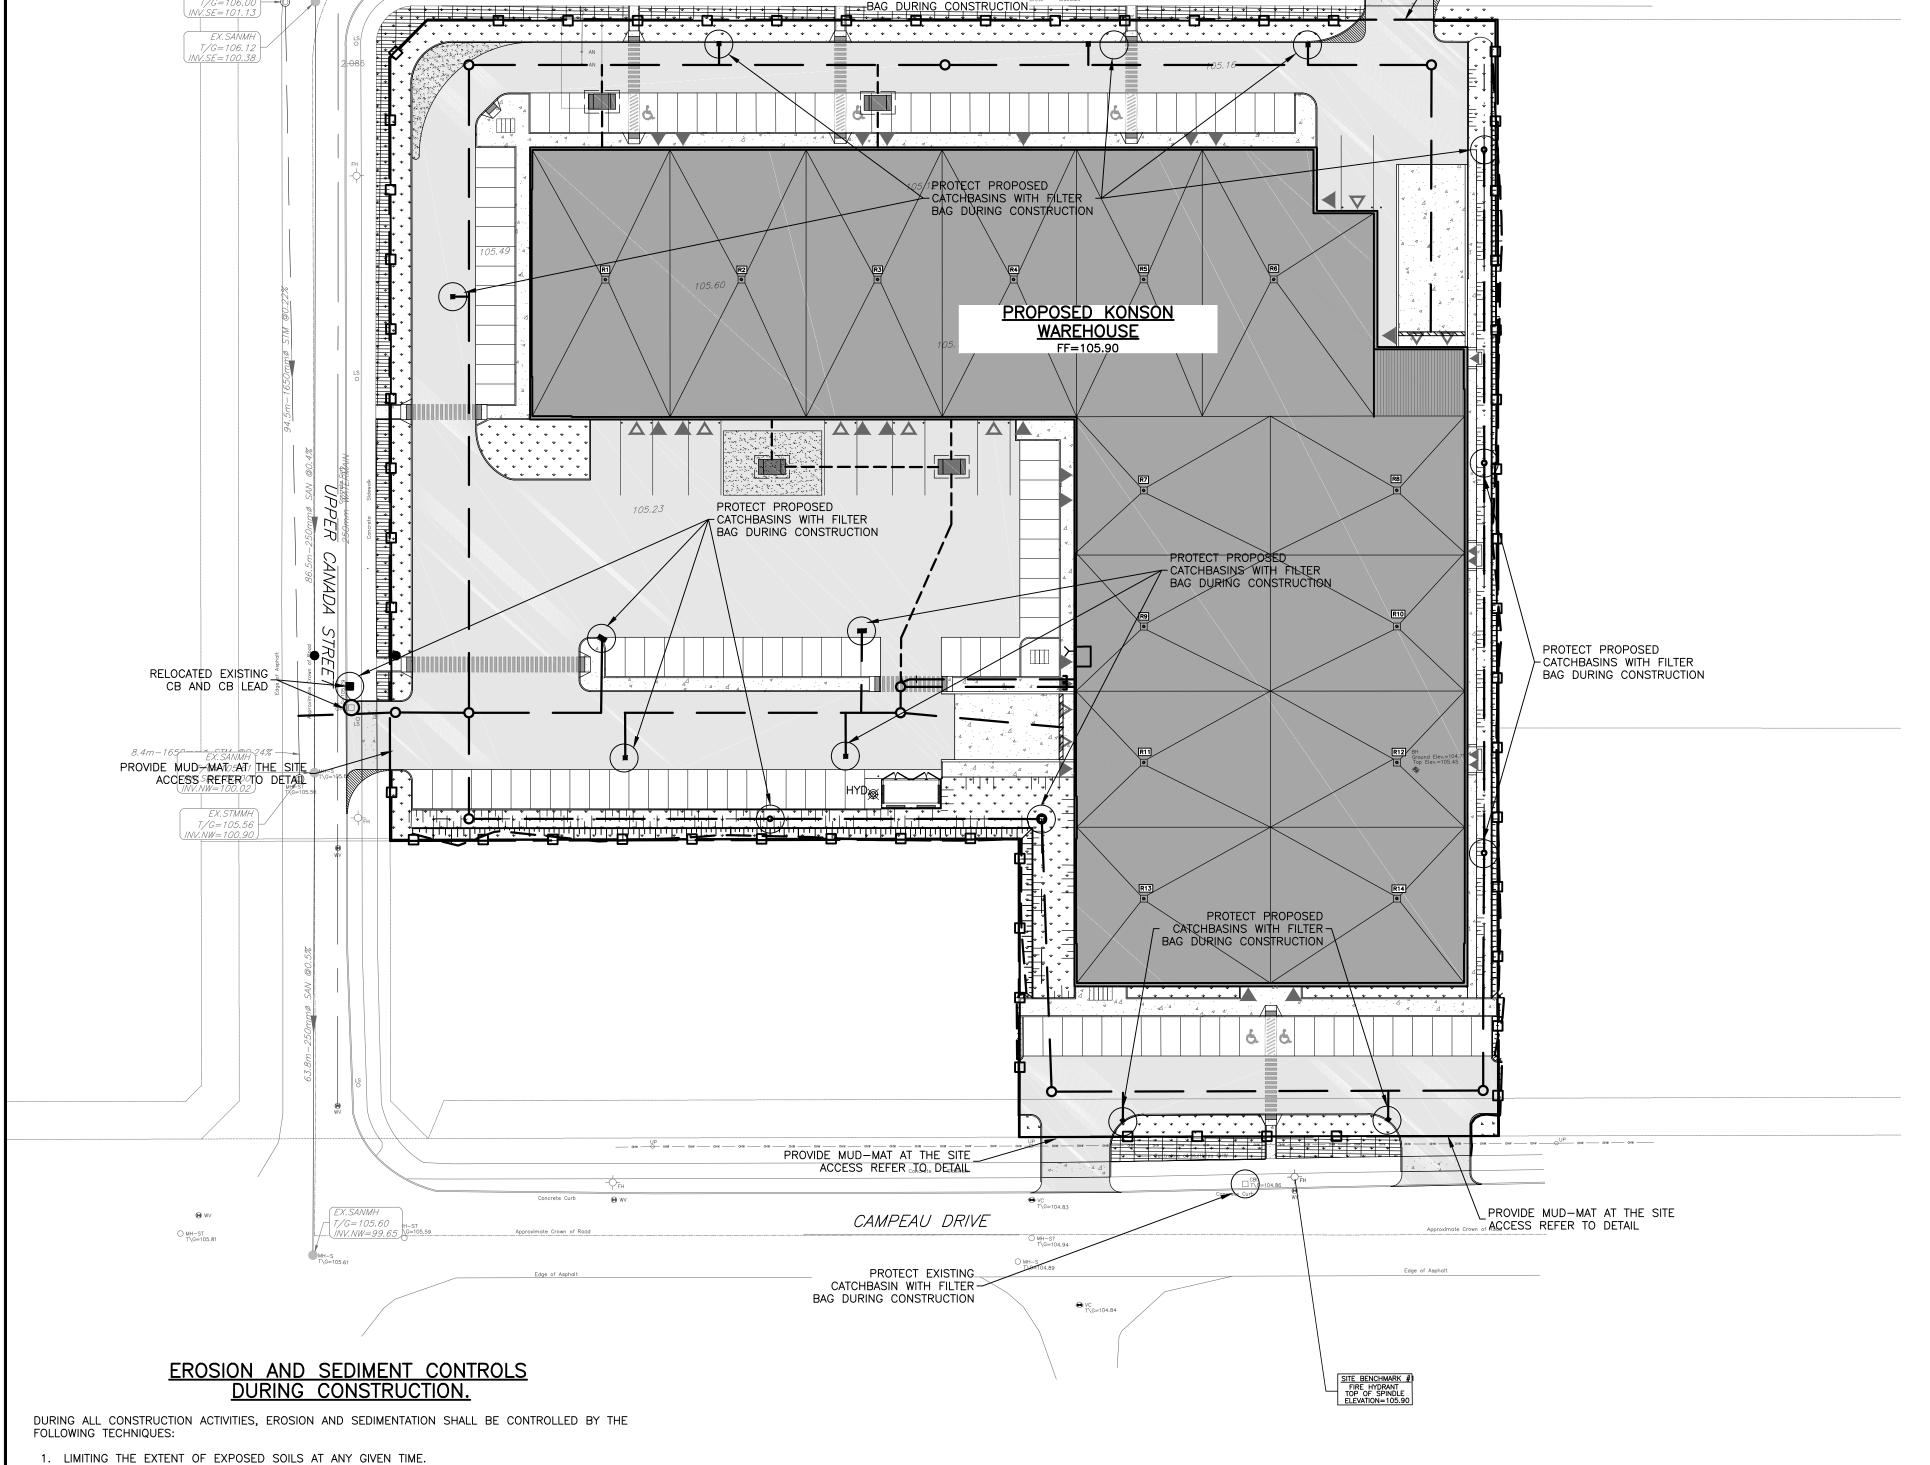

- 2. REVEGETATION OF EXPOSED AREAS AS SOON AS POSSIBLE.
- 3. MINIMIZATION OF AREA TO BE CLEARED AND DISRUPTION TO ADJACENT AREAS.
- 4. INSTALLATION OF FILTER CLOTH BETWEEN FRAME AND COVER ON ALL PROPOSED CATCH BASINS AND CATCH BASIN MANHOLES.
- 5. A SILT FENCE TO BE INSTALLED 0.3m INSIDE THE SITE PROPERTY LINE TO LOCATIONS SHOWN ON
- 6. A VISUAL INSPECTION SHALL BE COMPLETED DAILY ON SEDIMENT CONTROL BARRIERS AND ANY DAMAGE REPAIRED IMMEDIATELY. CARE WILL BE TAKEN TO PREVENT DAMAGE DURING CONSTRUCTION
- 7. IN SOME CASES SOME BARRIERS MAY BE REMOVED TEMPORARILY TO ACCOMODATE THE CONSTRUCTION OPERATIONS. THE AFFECTED BARRIERS WILL BE REINSTATED AT NIGHT WHEN
- 8. THE SEDIMENT CONTROL DEVICES WILL BE CLEANED OF ACCUMULATED SILT AS REQUIRED. THE DEPOSITS WILL BE DISPOSED OF AS PER THE REQUIREMENTS OF THE CONTRACT.
- 9. DURING THE COURSE OF CONSTRUCTION IF THE ENGINEER BELIEVES THAT ADDITIONAL PREVENTION METHODS ARE REQUIRED TO CONTROL EROSION AND SEDIMENTATION, THE CONTRACTOR WILL INSTALL ADDITONAL SILT FENCES OR OTHER METHODS AS REQUIRED TO THE SATISFACTION OF THE ENGINEER.
- 10. CONSTRUCTION AND MAINTENANCE REQUIRMENTS FOR EROSION AND SEDIMENT CONTROLS TO COMPLY WITH ONTARIO PROVINCIAL STANDARD SPECIFICATION (OPSS) OPSS 805, AND CITY OF OTTAWA
- 11. SEDIMENT AND EROSION CONTROL MEASURES MAY BE MODIFIED IN THE FIELD AT THE DISCRETION OF THE CITY OF OTTAWA SITE INSPECTOR OR CONSERVATION AUTHORITY.