

John Murphy


**JOHN SEVIGNY C.E.T.
MANAGER (A), DEVELOPMENT REVIEW EAST
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEPARTMENT, CITY OF OTTAWA**

APPROVED
By sevignyjo at 9:53 am, Oct 27, 2025

CATCH BASIN & MANHOLE SCHEDULE

(SUBMIT SHOP DRAWINGS OF ALL CATCH BASINS & MANHOLES TO ENGINEER FOR APPROVAL)

REF	TOP	SIZE	TYPE	INVERT AT INLET	INVERT AT OUTLET	NOTES
STORM SEWER						
CB/MH-1	75.49	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	—	73.24	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS – FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB/MH-2	75.49	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	73.10(NW)	73.10(NE)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS – FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
MH-3	75.39	1200mm	PRECAST CONCRETE MANHOLE	73.01(SW)	73.01(NE)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS – FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S24.1 OR OPSD 401.010
CB-4	75.15	600mm x 600mm	PRECAST CONCRETE CATCH-BASIN	—	72.90	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS – FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB/MH-5	75.15	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	72.94(SW) 72.79(NE)	72.79(NW)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS – FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB-6	75.15	600mm x 600mm	PRECAST CONCRETE CATCH-BASIN	—	72.90	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS – FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB/MH-7	75.15	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	72.79(NE) 72.71(SE)	72.71(NW)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS – FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB/MH-8	75.23	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	72.66(SE)	72.62(NW)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS – FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB/MH-9	75.23	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	72.58(SE)	72.17(NW)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS – FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010 INSTALL ICD IN OUTLET PIPE
MH-10	75.30	CDS PMSU2015-4	PRECAST CONCRETE MANHOLE	72.27(NE) 71.95(SE)	71.94(NW)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS EXCEPT WITH A DEEP SUMP AS REQUIRED BY CDS – FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
MH-11	75.26	1200mm	PRECAST CONCRETE MANHOLE	—	72.76	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS – FRAME & WATERTIGHT COVER TO OPSD 401.030
MH-12	75.26	1200mm	PRECAST CONCRETE MANHOLE	72.67(SE)	72.09(NE)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS – FRAME & WATERTIGHT COVER TO OPSD 401.030
CB/MH-13	74.71	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	—	72.46	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS – FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
SANITARY SEWER						
MH-SA.1	75.47	1200mm	PRECAST CONCRETE MANHOLE	—	71.97	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS – FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S24 OR OPSD 401.010
MH-SA.2	75.27	1200mm	PRECAST CONCRETE MANHOLE	71.92(SE)	71.91(NW)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS – FRAME & WATERTIGHT COVER TO OPSD 401.030

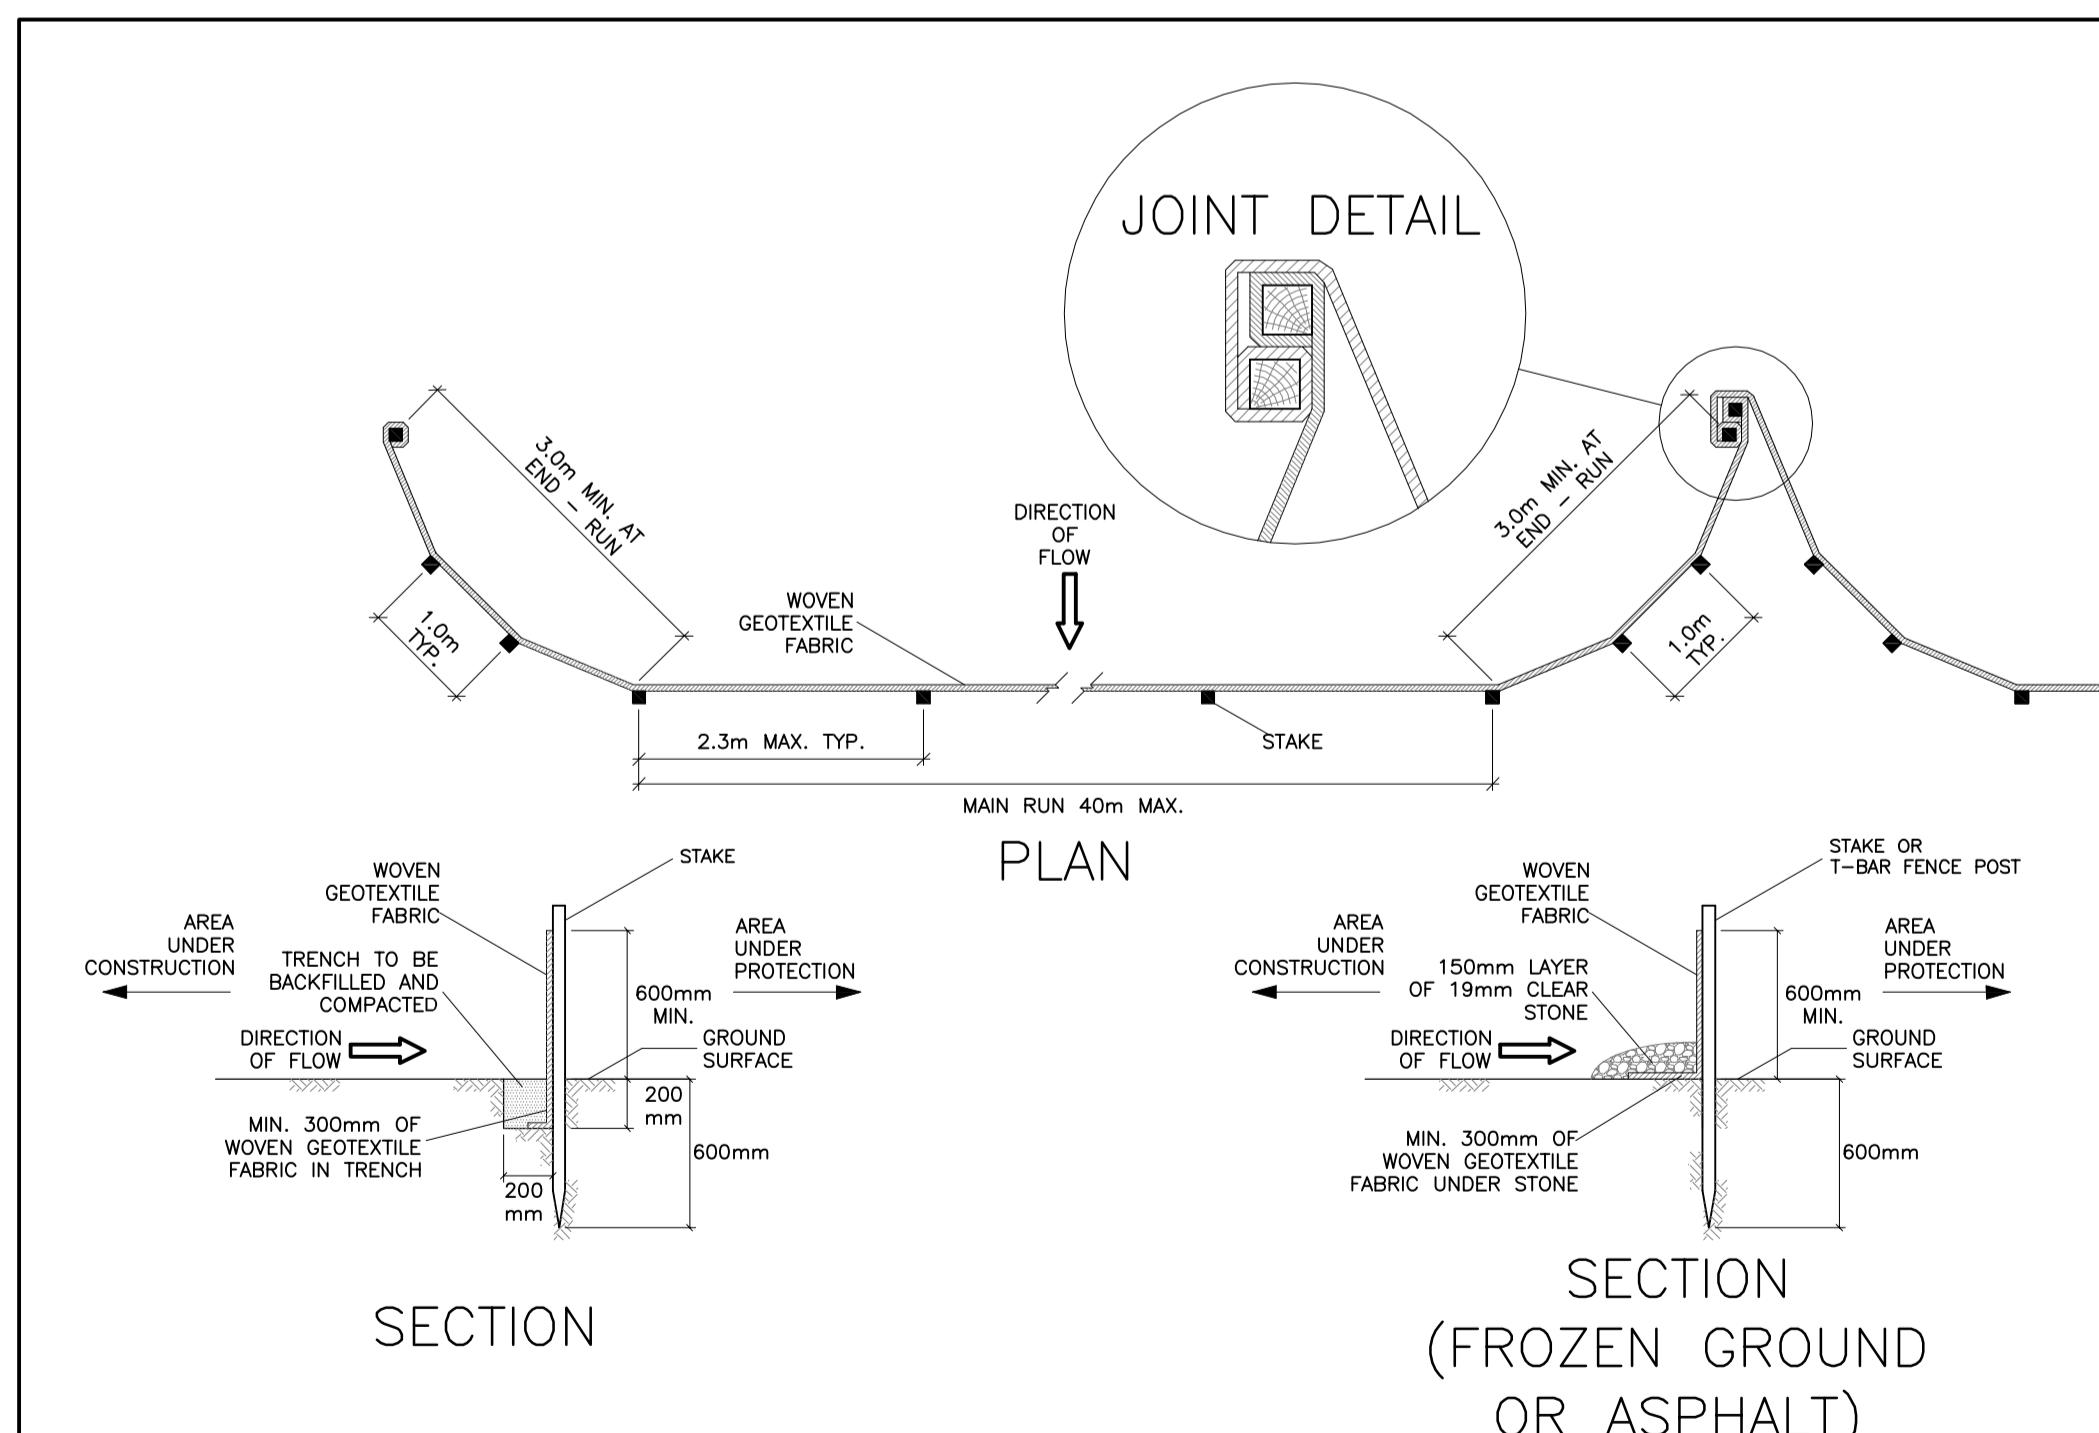

SILT FENCE BARRIER
AS PER OPSD 219.110
(MODIFIED FOR FROZEN GROUND OR ASPHALT)
N.T.S.

 LID UNLESS & DATED	Drawn	D.B.G
	H. Scale	
	V. Scale	
	Date	Dec 20-23
Job No.	23087	
Drawing No.		
C-9 of 12		

007-12-24-0038

D.B.G
20-23
23087

9
2

9196

D07-12-24-0038