



## **Traffic Noise Assessment**

**788 March Road  
Ottawa, Ontario**

REPORT: GWE18-080 – Traffic Noise

### **Prepared For:**

Ralph Esposito, Jr.  
**10731854 Canada Inc.**  
c/o NEUF Architect(e)s  
47 Clarence Street, Suite 406  
Ottawa, Ontario K1N 9K1  
Canada

### **Prepared By:**

Omar Daher, B.Eng., EIT, Junior Environmental Scientist  
Joshua Foster, P.Eng., Principal

August 14, 2018

---

## EXECUTIVE SUMMARY

This document describes a traffic noise assessment in support of site plan application for a proposed residential development at 788 March Road in Ottawa, Ontario. The development will contain six (6) floors and contain a grade-level outdoor terrace that will serve as an Outdoor Living Area (OLA). All other private balconies provided as amenity space are not considered as OLA since they are less than 4-metres in depth. The major sources of traffic noise are due to March Road to the south and Klondike Road to the west. Figure 1 illustrates a complete site plan with surrounding context.

The assessment is based on: (i) theoretical noise prediction methods that conform to the Ministry of the Environment and Climate Change (MOECC) and City of Ottawa requirements; (ii) noise level criteria as specified by the City of Ottawa's Environmental Noise Control Guidelines (ENCG); (iii) future vehicular traffic volumes based on the City of Ottawa's Official Plan roadway classifications; and (iv) site plan drawings received from NEUF Architect(e)s in June 2018.

The results of the current analysis indicate that noise levels will range between 60 and 75 dBA during the daytime period (07:00-23:00) and between 53 and 68 dBA during the nighttime period (23:00-07:00). The highest noise level (75 dBA) occurs on the south façade of the development, most exposed to March Road and Klondike Road. Predicted noise levels due to roadway traffic exceed the criteria listed in Section 4.2 for building components. Therefore, upgraded building components are required where noise levels exceed 65 dBA as shown in Figure 3. Noise levels at the ground-level terrace do not exceed 55 dBA, therefore no mitigation is required.

In addition to upgraded building components, the development requires central air conditioning with applicable Warning Clauses. If installed, this would allow occupants to keep windows closed to maintain a quiet indoor environment. Additionally, Warning Clauses will be included in all Agreements of Lease, Purchase and Sale as described in Section 6.

---

## CONTENTS

<b>1. INTRODUCTION.....</b>	<b>1</b>
<b>2. TERMS OF REFERENCE.....</b>	<b>1</b>
<b>3. OBJECTIVES.....</b>	<b>2</b>
<b>4. METHODOLOGY.....</b>	<b>2</b>
<b>4.1 Background.....</b>	<b>2</b>
<b>4.2 Roadway Traffic Noise.....</b>	<b>2</b>
<b>4.2.1 Criteria for Roadway Traffic Noise.....</b>	<b>2</b>
<b>4.3 Roadway Noise Assessment.....</b>	<b>4</b>
<b>4.3.1 Theoretical Roadway Noise Predictions.....</b>	<b>4</b>
<b>4.4 Roadway Traffic Volumes.....</b>	<b>5</b>
<b>4.5 Indoor Noise Calculations.....</b>	<b>5</b>
<b>5. RESULTS AND DISCUSSION.....</b>	<b>7</b>
<b>5.1 Roadway Traffic Noise Levels.....</b>	<b>7</b>
<b>5.2 Noise Control Measures.....</b>	<b>7</b>
<b>6. CONCLUSIONS AND RECOMMENDATIONS.....</b>	<b>9</b>

### FIGURES

### APPENDICES:

**Appendix A – STAMSON 5.04 Input and Output Data**

---

## 1. INTRODUCTION

Gradient Wind Engineering Inc. (GWE) was retained by 10731854 Canada Inc. to undertake a traffic noise assessment in support of site plan application for a proposed residential development at March Road in Ottawa, Ontario. The development will contain 6 floors and contain a grade-level outdoor terrace to serve as an Outdoor Living Area (OLA). This report summarizes the methodology, results, and recommendations related to a traffic noise assessment. GWE's scope of work involved assessing exterior and interior noise levels generated by local roadway traffic. The assessment was performed on the basis of theoretical noise calculation methods conforming to the City of Ottawa<sup>1</sup> and Ministry of the Environment and Climate Change (MOECC)<sup>2</sup> guidelines. Noise calculations were based on architectural drawings received from NEUF Architect(e)s, with future traffic volumes corresponding to the City of Ottawa's Official Plan (OP) roadway classifications.

## 2. TERMS OF REFERENCE

The focus of this traffic noise assessment proposed a residential development at 788 March Road in Ottawa, Ontario. The development will contain 6 floors and contain a grade-level outdoor terrace to serve as an Outdoor Living Area (OLA). The outdoor terrace is approximately 3-metres below the elevation of March Road, with the depression creating a 3-metre retaining wall between the OLA and the visitor parking. Additionally, amenity space is also provided in the form of private balconies on the various floors. As the private balconies are less than 4-metres in depth, they are not considered to be Outdoor Living Areas (OLA). The building planform is composed of an L-shaped and rectangular buildings connected by a walkway in the middle. The development is oriented along the intersection of March Road and Klondike Road.

The site is surrounded in the immediate vicinity by residential and commercial buildings to the west, low-density residential areas to the east and south beyond greenspace, and commercial areas to the north beyond greenspace. The major sources of traffic noise are March Road to the south, and Klondike Road to the west. Figure 1 illustrates a complete site plan with surrounding context.

---

<sup>1</sup> City of Ottawa Environmental Noise Control Guidelines, January 2016

<sup>2</sup> Ontario Ministry of the Environment and Climate Change – Environmental Noise Guidelines, Publication NPC-300, Queens Printer for Ontario, Toronto, 2013  
*10731854 Canada Inc.*

### **3. OBJECTIVES**

The main goals of this work are to: (i) calculate the future noise levels on the study buildings produced by local roadway traffic, and (ii) ensure that interior and exterior noise levels do not exceed the allowable limits specified by the City of Ottawa's Environmental Noise Control Guidelines as outlined in Section 4.2 of this report.

### **4. METHODOLOGY**

#### **4.1 Background**

Noise can be defined as any obtrusive sound. It is created at a source, transmitted through a medium, such as air, and intercepted by a receiver. Noise may be characterized in terms of the power of the source or the sound pressure at a specific distance. While the power of a source is characteristic of that particular source, the sound pressure depends on the location of the receiver and the path that the noise takes to reach the receiver. Measurement of noise is based on the decibel unit, dBA, which is a logarithmic ratio referenced to a standard noise level ( $2 \times 10^{-5}$  Pascals). The 'A' suffix refers to a weighting scale, which better represents how the noise is perceived by the human ear. With this scale, a doubling of power results in a 3 dBA increase in measured noise levels and is just perceptible to most people. An increase of 10 dBA is often perceived to be twice as loud.

#### **4.2 Roadway Traffic Noise**

##### **4.2.1 Criteria for Roadway Traffic Noise**

For surface roadway traffic noise, the equivalent sound energy level,  $L_{eq}$ , provides a measure of the time varying noise levels, which is well correlated with the annoyance of sound. It is defined as the continuous sound level, which has the same energy as a time varying noise level over a period of time. For roadways, the  $L_{eq}$  is commonly calculated on the basis of a 16-hour ( $L_{eq16}$ ) daytime (07:00-23:00) / 8-hour ( $L_{eq8}$ ) nighttime (23:00-07:00) split to assess its impact on residential buildings. The City of Ottawa's Environmental Noise Control Guidelines (ENCG) specifies that the recommended indoor noise limit range (that is relevant to this study) is 45 and 40 dBA for living rooms and sleeping quarters, respectively, for roadway as listed in Table 1.

**TABLE 1: INDOOR SOUND LEVEL CRITERIA (ROAD)<sup>3</sup>**

Type of Space	Time Period	Leq (dBA)
		Road
General offices, reception areas, retail stores, etc.	07:00 – 23:00	50
Living/dining/den areas of <b>residences</b> , hospitals, schools, nursing/retirement homes, day-care centres, theatres, places of worship, libraries, individual or semi-private offices, conference rooms, etc.	07:00 – 23:00	45
Sleeping quarters of hotels/motels	23:00 – 07:00	45
Sleeping quarters of <b>residences</b> , hospitals, nursing/retirement homes, etc.	23:00 – 07:00	40

Predicted noise levels at the plane of window (POW) dictate the action required to achieve the recommended sound levels. An open window is considered to provide a 10 dBA reduction in noise, while a standard closed window is capable of providing a minimum 20 dBA noise reduction<sup>4</sup>. A closed window due to a ventilation requirement will bring noise levels down to achieve an acceptable indoor environment<sup>5</sup>. Therefore, where noise levels exceed 55 dBA daytime and 50 dBA nighttime, the ventilation for the building should consider the need for having windows and doors closed, which normally triggers the need for central air conditioning. Where noise levels exceed 65 dBA daytime and 60 dBA nighttime, building components will require higher levels of sound attenuation<sup>6</sup>.

The sound level criterion for outdoor living areas is 55 dBA, which applies during the daytime (07:00 to 23:00). When noise levels exceed 55 dBA, mitigation must be provided to reduce noise levels where technically and administratively feasible to acceptable levels at or below the criterion.

<sup>3</sup> Adapted from ENCG 2016 – Tables 2.2b and 2.2c

<sup>4</sup> Burberry, P.B. (2014). Mitchell’s Environment and Services. Routledge, Page 125

<sup>5</sup> MOECC, Environmental Noise Guidelines, NPC 300 – Part C, Section 7.8

<sup>6</sup> MOECC, Environmental Noise Guidelines, NPC 300 – Part C, Section 7.1.3

10731854 Canada Inc.

---

## 4.3 Roadway Noise Assessment

### 4.3.1 Theoretical Roadway Noise Predictions

Noise predictions were performed with the aid of the MOECC computerized noise assessment program, STAMSON 5.04, for road analysis. Appendix A includes the STAMSON 5.04 input and output data.

Roadway traffic noise calculations were performed by treating each roadway segment as separate line sources of noise. In addition to the traffic volumes summarized in Table 2, theoretical noise predictions were based on the following parameters:

- Truck traffic on all roadways was taken to comprise 5% heavy trucks and 7% medium trucks, as per ENCG requirements for noise level predictions.
- The day/night split was taken to be 92% / 8% respectively for all streets.
- Reflective ground surface between source and receiver for March Road, while absorptive ground considered for the outdoor terrace due to the distance, building location, and presence of soft-ground between source and receiver.
- Topography assumed to be a flat/gentle slope.
- Receptor height taken to be 16.5 metres at the 6<sup>th</sup> floor for the centre of the window in the absence of elevation drawings as stated in the Ontario Road Noise Analysis Method for Environmental and Transportation (ORNAMENT) technical document<sup>7</sup>.
- No surrounding buildings used as potential noise barriers, except for the proposed building for Receptor 7.
- Receptor distances and exposure angles found in Figure 4 where Receptors 1-7 have similar exposure angles and distances.
- The outdoor terrace is located 3-metres below the elevation of March Road, creating a 3-metre retaining wall between the outdoor terrace and the visitor parking. Therefore, Receptor 7 at the OLA considered an elevation of 3 metres below the elevation of March Road.
- Receptor 7 considered the proposed building as a noise barrier for March Road, with a height of 18-metres. As for Klondike Road, an open exposure angle of 0 to 90 degrees was factored into the calculations.
- Noise receptors were strategically placed at 7 locations around the study area (see Figure 2).

---

<sup>7</sup> ORNAMENT Technical Document, October 1989, Section 5.5.4  
10731854 Canada Inc.

## 4.4 Roadway Traffic Volumes

The ENCG dictates that noise calculations should consider future sound levels based on a roadway's classification at the mature state of development. Therefore, traffic volumes are based on the roadway classifications outlined in the City of Ottawa's Official Plan (OP) and Transportation Master Plan<sup>8</sup> which provide additional details on future roadway expansions. Average Annual Daily Traffic (AADT) volumes are then based on data in Table B1 of the ENCG for each roadway classification. Table 2 (below) summarizes the AADT values used for each roadway included in this assessment.

**TABLE 2: ROADWAY TRAFFIC DATA**

Segment	Roadway / Transit Class	Speed Limit (km/h)	Traffic Volumes
March Road	6-UAD	80	<b>50,000</b>
Klondike Road	2-UCU	50	<b>8,000</b>

## 4.5 Indoor Noise Calculations

The difference between outdoor and indoor noise levels is the noise attenuation provided by the building envelope. According to common industry practice, complete walls and individual wall elements are rated according to the Sound Transmission Class (STC). The STC ratings of common residential walls built in conformance with the Ontario Building Code (2012) typically exceed STC 35, depending on exterior cladding, thickness and interior finish details. For example, concrete and masonry walls can achieve STC 50 or more. Curtain wall systems typically provide around STC 35, depending on the glazing elements. Standard good quality double-glazed non-operable windows can have STC ratings ranging from 25 to 40, depending on the window manufacturer, pane thickness and inter-pane spacing. As previously mentioned, the windows are the known weak point in a partition.

<sup>8</sup> City of Ottawa Transportation Master Plan, November 2013  
10731854 Canada Inc.



---

According to Section 4.2, when daytime noise levels (from road) at the plane of the window exceed 65 dBA, calculations must be performed to evaluate the sound transmission quality of the building components to ensure acceptable indoor noise levels. The calculation procedure<sup>9</sup> considers:

- Window type and total area as a percentage of total room floor area
- Exterior wall type and total area as a percentage of the total room floor area
- Acoustic absorption characteristics of the room
- Outdoor noise source type and approach geometry
- Indoor sound level criteria, which varies according to the intended use of a space

Based on published research<sup>10</sup>, exterior walls possess specific sound attenuation characteristics that are used as a basis for calculating the required STC ratings of windows in the same partition. Due to the limited information, available at the time of the study, which was prepared for site plan approval, detailed floor layouts and building elevations have not been finalized; therefore, detailed STC calculations could not be performed at this time. As a guideline, the anticipated STC requirements for windows have been estimated based on the overall noise reduction required for each intended use of space (STC = outdoor noise level – targeted indoor noise levels).

---

<sup>9</sup> Building Practice Note: Controlling Sound Transmission into Buildings by J.D. Quirt, National Research Council of Canada, September 1985

<sup>10</sup> CMHC, Road & Rail Noise: Effects on Housing  
*10731854 Canada Inc.*

## 5. RESULTS AND DISCUSSION

### 5.1 Roadway Traffic Noise Levels

The results of the roadway traffic noise calculations are summarized in Table 3 below. A complete set of input and output data from all STAMSON 5.04 calculations are available in Appendix A.

**TABLE 3: EXTERIOR NOISE LEVELS DUE TO ROAD TRAFFIC**

Receptor Number	Receptor Height Above Grade (m)	Receptor Location	STAMSON 5.04 Noise Level (dBA)	
			Day	Night
1	16.5	POW – 6 <sup>th</sup> Floor – East Façade	71	64
2	16.5	POW – 6 <sup>th</sup> Floor – South Façade	75	67
3	16.5	POW – 6 <sup>th</sup> Floor – South Façade	75	68
4	16.5	POW – 6 <sup>th</sup> Floor – Southwest Façade	73	66
5	16.5	POW – 6 <sup>th</sup> Floor – West Façade	71	63
6	16.5	POW – 6 <sup>th</sup> Floor – North Façade	60	53
7	1.50	OLA – Ground-level Terrace	55	-

The results of the current analysis indicate that noise levels will range between 60 and 75 dBA during the daytime period (07:00-23:00) and between 53 and 68 dBA during the nighttime period (23:00-07:00). The highest noise level (75 dBA) occurs on the south façade of the development, most exposed to March Road and Klondike Road. Predicted noise levels due to roadway traffic exceed the criteria listed in Section 4.2 for building components. Therefore, upgraded building components are required where noise levels exceed 65 dBA as shown in Figure 3. Noise levels at the ground-level terrace do not exceed 55 dBA, therefore no mitigation is required.

### 5.2 Noise Control Measures

The noise levels predicted due to roadway traffic exceed the criteria listed in Section 4.2 for building components. As discussed in Section 4.5 the anticipated STC requirements for windows have been estimated based on the overall noise reduction required for each intended use of space (STC = outdoor noise level – targeted indoor noise levels). It is recommended detailed STC calculations be performed prior to building permit application for each unit type. The STC requirements for the windows are summarized below for various units within the development (see Figure 3):

- **Living Room Windows**
  - (i) Living room windows facing South will require a minimum STC of 33
  - (ii) Living room windows facing East and West will require a minimum STC of 29
  - (iii) All other living room windows are to satisfy Ontario Building Code (OBC 2012) requirements
  
- **Bedroom Windows**
  - (i) Bedroom windows facing South will require a minimum STC of 38
  - (ii) Bedroom windows facing East and West will require a minimum STC of 34
  - (iii) All other bedroom windows are to satisfy Ontario Building Code (OBC 2012) requirements
  
- **Exterior Walls**
  - (i) Exterior wall components on the South, West and East façades require a minimum STC of 45. Wall assemblies meeting STC 45 would include steel stud walls a minimum of 92 mm deep filled with batt insulation, exterior dense glass sheathing, and a 16 mm gypsum board on the inside.

The STC requirements would apply to windows, doors, spandrel panels and curtain wall elements. Exterior wall components on these façades are recommended to have a minimum STC of 45, where a window / wall system is used. A review of window supplier literature indicates that the specified STC ratings can be achieved by a variety of window systems having a combination of glass thickness and inter-pane spacing. We have specified an example window configuration, however several manufacturers and various combinations of window components, such as those proposed, will offer the necessary sound attenuation rating. It is the responsibility of the manufacturer to ensure that the specified window achieves the required STC. This can only be assured by using window configurations that have been certified by laboratory testing. The requirements for STC ratings assume that the remaining components of the building are constructed and installed according to the minimum standards of the Ontario Building Code. The specified STC requirements also apply to swinging and/or sliding patio doors.

Results of the calculations also indicate that the development will require central air conditioning, which will allow occupants to keep windows closed and maintain a comfortable living environment. In addition to ventilation requirements, Warning Clauses will also be required to be placed on all Lease, Purchase and Sale Agreements, as summarized in Section 6 below.

## 6. CONCLUSIONS AND RECOMMENDATIONS

The results of the current analysis indicate that noise levels will range between 60 and 75 dBA during the daytime period (07:00-23:00) and between 53 and 68 dBA during the nighttime period (23:00-07:00). The highest noise level (75 dBA) occurs on the south façade of the development, most exposed to March Road and Klondike Road. Predicted noise levels due to roadway traffic exceed the criteria listed in Section 4.2 for building components. Therefore, upgraded building components are required where noise levels exceed 65 dBA as shown in Figure 3. Noise levels at the ground-level terrace do not exceed 55 dBA, therefore no mitigation is required.

In addition to upgraded building components, ventilation requirements dictate that the development should have central air conditioning. If installed this would allow occupants to keep windows closed to maintain a quiet indoor environment. The following Warning Clause<sup>11</sup> in all Agreements of Lease, Purchase and Sale will be required for these units:

*“Purchasers/tenants are advised that despite the inclusion of noise control features in the development and within the building units, sound levels due to increasing roadway traffic will interfere with some activities as the sound levels exceed the sound level limits of the City and the Ministry of the Environment and Climate Change.*

*To help address the need for sound attenuation this development has been designed so as to provide an outdoor amenity area and indoor environment that is within provincial guidelines. Measures for sound attenuation include:*

- *STC multi-pane glass glazing elements*
- *Upgraded exterior walls achieving STC 45 or greater*

*To ensure that provincial sound level limits are not exceeded it is important to maintain these sound attenuation features.*

*To ensure that provincial sound level limits are not exceeded internally, this dwelling unit has been designed with central air conditioning. The installation of central air conditioning will allow windows and exterior doors to remain closed, thereby ensuring*

---

<sup>11</sup> City of Ottawa, Environmental Noise Control Guidelines, January 2016  
10731854 Canada Inc.

---

*that the indoor sound levels are within the sound level limits of the City and the Ministry of the Environment and Climate Change.”*

This concludes our assessment and report. If you have any questions or wish to discuss our findings please advise us. In the interim, we thank you for the opportunity to be of service.

Yours truly,


**Gradient Wind Engineering Inc.**


A handwritten signature in dark ink, appearing to read 'Omar Daher'.

Omar Daher, B.Eng., EIT  
Junior Environmental Scientist  
GWE18-080 – Traffic Noise



Joshua Foster, P.Eng.  
Principal

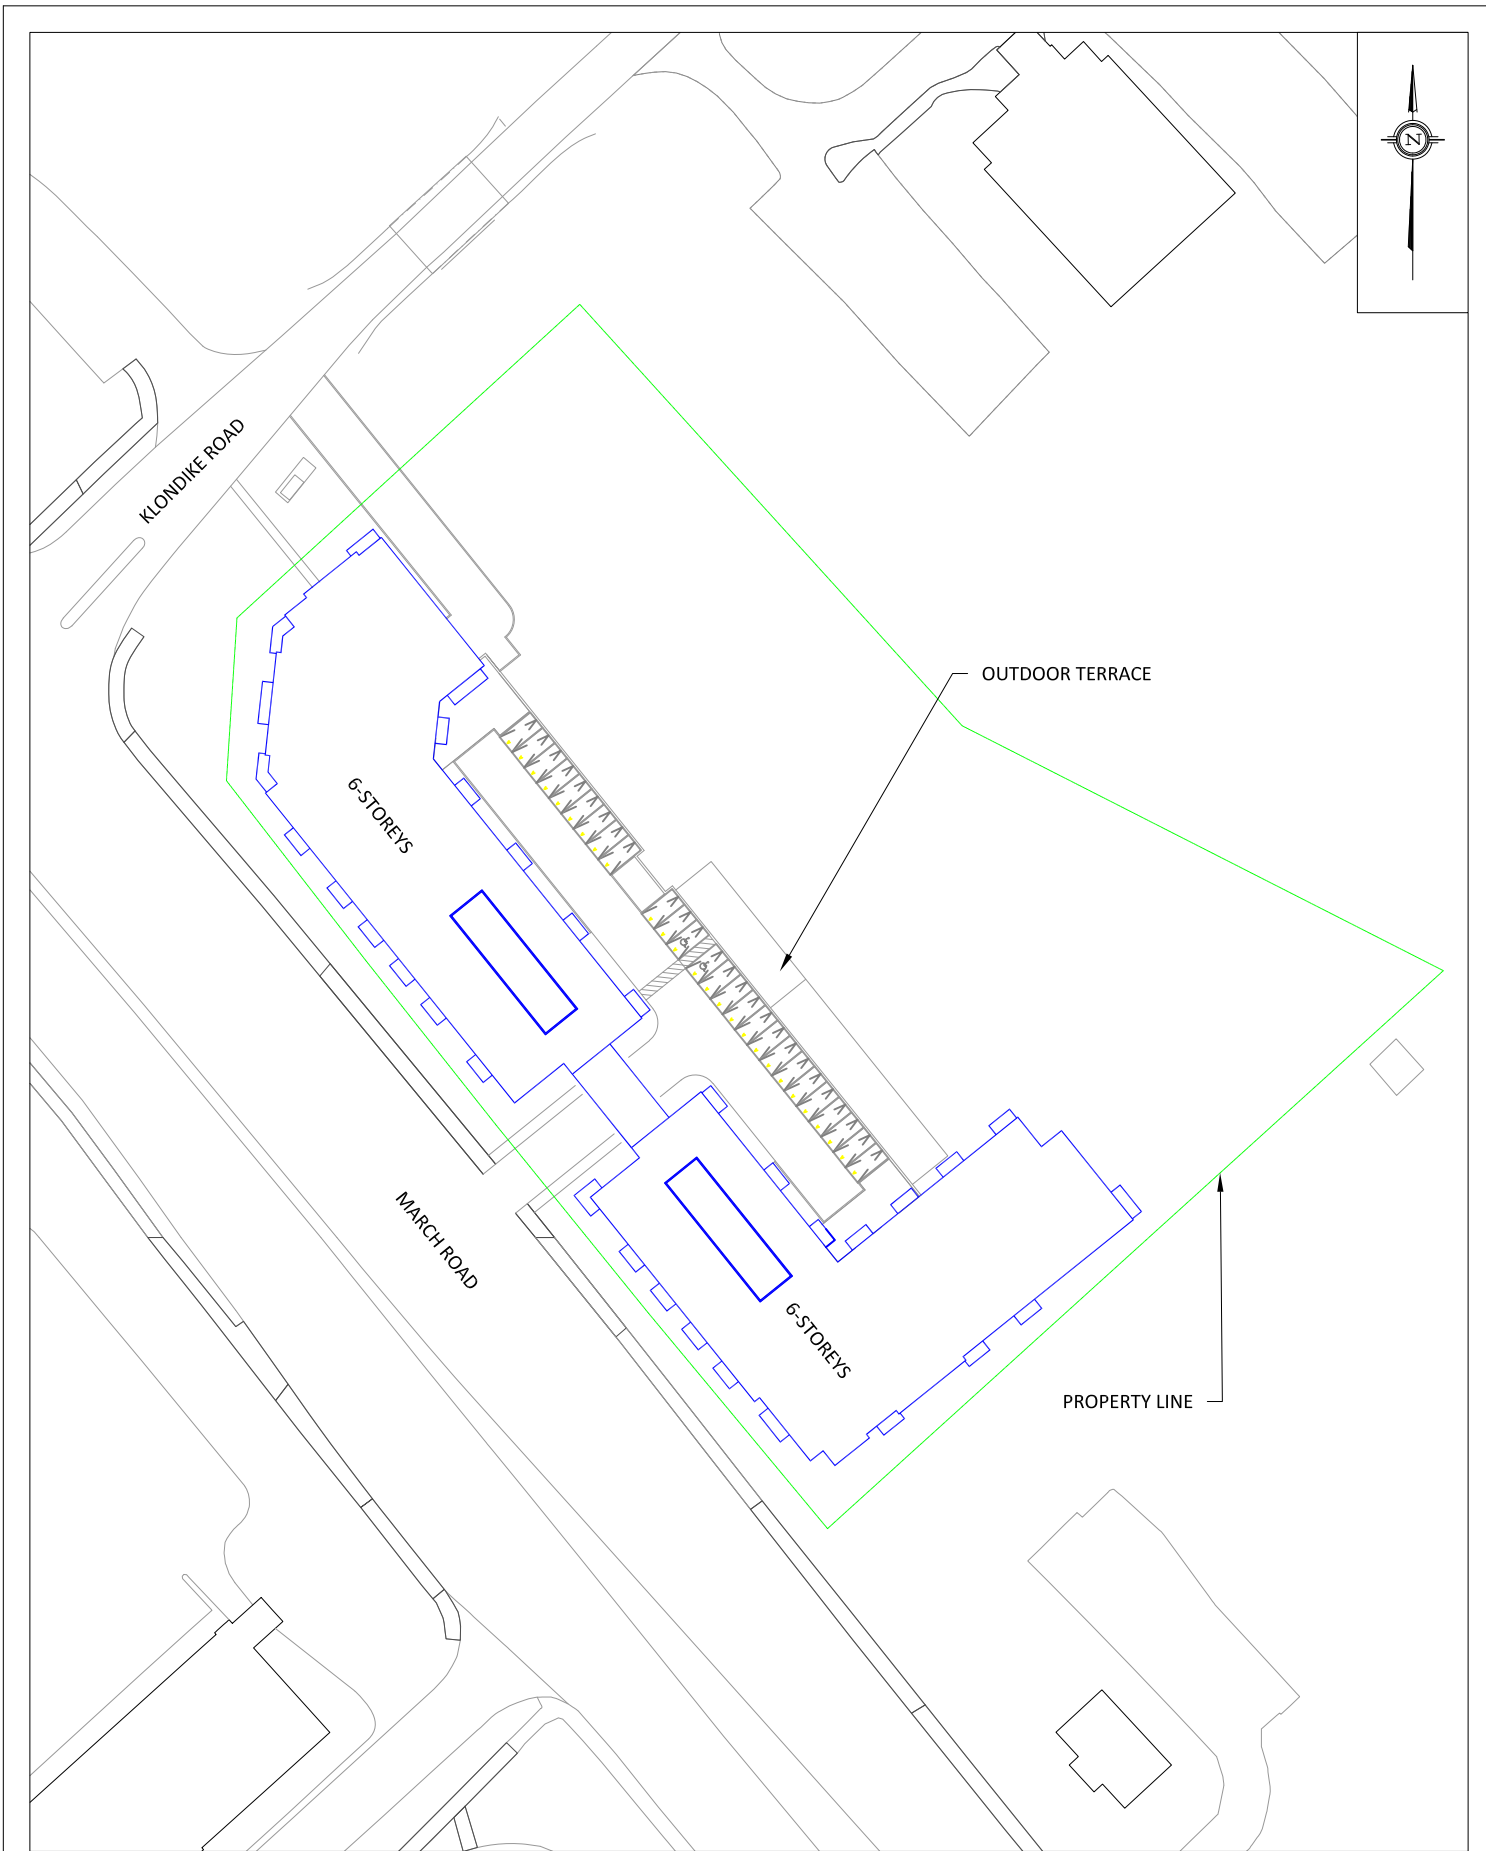

	PROJECT <b>788 MARCH ROAD - TRAFFIC NOISE ASSESSMENT</b>		DESCRIPTION <b>FIGURE 1: SITE PLAN AND SURROUNDING CONTEXT</b>
	SCALE 1:1000 (APPROX)	DRAWING NO. GWE18-080-1	
	DATE JULY 31, 2018	DRAWN BY O.D.	




- OLA RECEPTOR
- 6TH FLOOR RECEPTOR

127 Walgreen Road  
Ottawa, Ontario  
(613) 836 0934


PROJECT	788 MARCH ROAD - TRAFFIC NOISE ASSESSMENT	
SCALE	1:1000 (APPROX)	DRAWING NO. GWE18-080-2
DATE	JULY 31, 2018	DRAWN BY O.D.

DESCRIPTION

**FIGURE 2:  
RECEPTOR LOCATIONS**

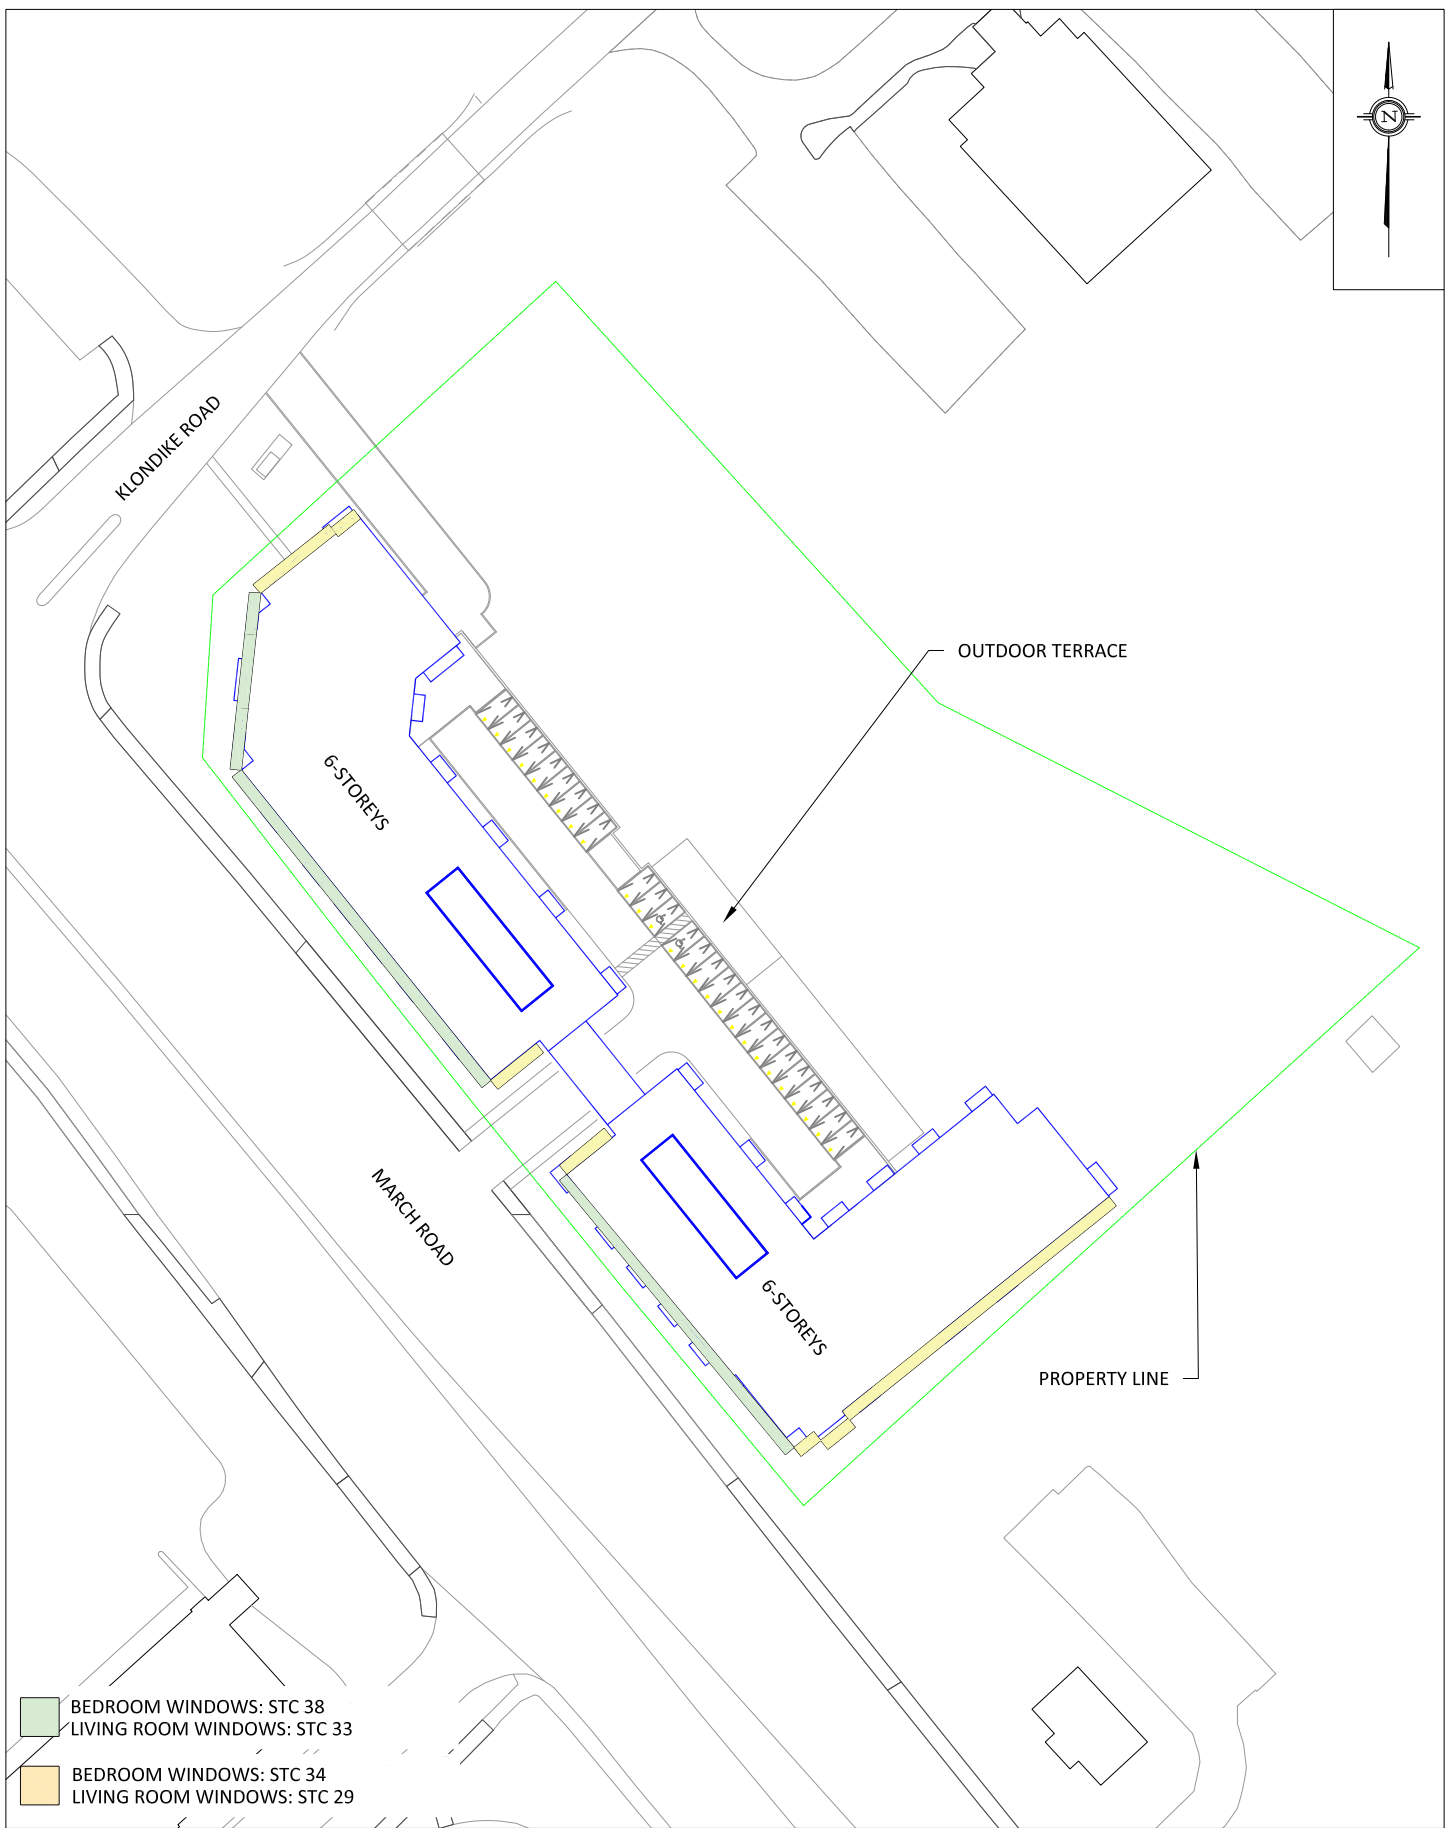


- BEDROOM WINDOWS: STC 38  
LIVING ROOM WINDOWS: STC 33
- BEDROOM WINDOWS: STC 34  
LIVING ROOM WINDOWS: STC 29

	PROJECT		788 MARCH ROAD - TRAFFIC NOISE ASSESSMENT		DESCRIPTION	FIGURE 3: BEDROOM AND LIVING ROOM WINDOW STC REQUIREMENTS
	SCALE	1:1000 (APPROX)	DRAWING NO.	GWE18-080-3		
	DATE	JULY 31, 2018	DRAWN BY	O.D.		





- # OLA RECEPTOR
- # 6TH FLOOR RECEPTOR

	PROJECT <b>788 MARCH ROAD - TRAFFIC NOISE ASSESSMENT</b>		DESCRIPTION <b>FIGURE 4: RECEPTOR DISTANCES AND EXPOSURE ANGLES</b>
	SCALE 1:1000 (APPROX)	DRAWING NO. GWE18-080-4	
	DATE JULY 31, 2018	DRAWN BY O.D.	

127 Walgreen Road  
Ottawa, Ontario  
(613) 836 0934

**APPENDIX A**

**STAMSON 5.04 - INPUT AND OUTPUT DATA**



---

STAMSON 5.0                  NORMAL REPORT                  Date: 03-07-2018 152:34:36  
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r1.te                                  Time Period: Day/Night 16/8 hours  
Description:

Road data, segment # 1: March Road (day/night)

-----  
Car traffic volume    : 40480/3520    veh/TimePeriod    \*  
Medium truck volume  :  3220/280     veh/TimePeriod    \*  
Heavy truck volume   :  2300/200     veh/TimePeriod    \*  
Posted speed limit   :     80 km/h  
Road gradient         :     0 %  
Road pavement        :     1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 50000  
Percentage of Annual Growth        :  0.00  
Number of Years of Growth         :  0.00  
Medium Truck % of Total Volume     :  7.00  
Heavy Truck % of Total Volume       :  5.00  
Day (16 hrs) % of Total Volume     : 92.00

Data for Segment # 1: March Road (day/night)

-----  
Angle1    Angle2               : -90.00 deg    0.00 deg  
Wood depth         :     0        (No woods.)  
No of house rows   :     0 / 0  
Surface             :     2        (Reflective ground surface)  
Receiver source distance : 33.00 / 33.00 m  
Receiver height     : 16.50 / 16.50 m  
Topography         :     1        (Flat/gentle slope; no barrier)  
Reference angle     :     0.00

#



Results segment # 1: March Road (day)

Source height = 1.50 m

ROAD (0.00 + 71.28 + 0.00) = 71.28 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	0	0.00	77.72	0.00	-3.42	-3.01	0.00	0.00	0.00	71.28

Segment Leq : 71.28 dBA

Total Leq All Segments: 71.28 dBA

Results segment # 1: March Road (night)

Source height = 1.50 m

ROAD (0.00 + 63.68 + 0.00) = 63.68 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	0	0.00	70.12	0.00	-3.42	-3.01	0.00	0.00	0.00	63.68

Segment Leq : 63.68 dBA

Total Leq All Segments: 63.68 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 71.28  
(NIGHT): 63.68

#

STAMSON 5.0                    NORMAL REPORT                    Date: 03-07-2018 152:35:50  
 MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r2.te                                    Time Period: Day/Night 16/8 hours  
 Description:

Road data, segment # 1: March Road (day/night)

-----  
 Car traffic volume : 40480/3520 veh/TimePeriod \*  
 Medium truck volume : 3220/280 veh/TimePeriod \*  
 Heavy truck volume : 2300/200 veh/TimePeriod \*  
 Posted speed limit : 80 km/h  
 Road gradient : 0 %  
 Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 50000  
 Percentage of Annual Growth : 0.00  
 Number of Years of Growth : 0.00  
 Medium Truck % of Total Volume : 7.00  
 Heavy Truck % of Total Volume : 5.00  
 Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: March Road (day/night)

-----  
 Angle1 Angle2 : -90.00 deg 90.00 deg  
 Wood depth : 0 (No woods.)  
 No of house rows : 0 / 0  
 Surface : 2 (Reflective ground surface)  
 Receiver source distance : 28.00 / 28.00 m  
 Receiver height : 16.50 / 16.50 m  
 Topography : 1 (Flat/gentle slope; no barrier)  
 Reference angle : 0.00

#



Results segment # 1: March Road (day)

Source height = 1.50 m

ROAD (0.00 + 75.00 + 0.00) = 75.00 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	90	0.00	77.72	0.00	-2.71	0.00	0.00	0.00	0.00	75.00

Segment Leq : 75.00 dBA

Total Leq All Segments: 75.00 dBA

Results segment # 1: March Road (night)

Source height = 1.50 m

ROAD (0.00 + 67.41 + 0.00) = 67.41 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	90	0.00	70.12	0.00	-2.71	0.00	0.00	0.00	0.00	67.41

Segment Leq : 67.41 dBA

Total Leq All Segments: 67.41 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 75.00  
(NIGHT): 67.41

#





Road data, segment # 2: Klondike (day/night)

```

-----
Car traffic volume   : 6477/563   veh/TimePeriod  *
Medium truck volume : 515/45    veh/TimePeriod  *
Heavy truck volume  : 368/32    veh/TimePeriod  *
Posted speed limit  : 50 km/h
Road gradient       : 0 %
Road pavement      : 1 (Typical asphalt or concrete)

```

\* Refers to calculated road volumes based on the following input:

```

24 hr Traffic Volume (AADT or SADT): 8000
Percentage of Annual Growth      : 0.00
Number of Years of Growth       : 0.00
Medium Truck % of Total Volume   : 7.00
Heavy Truck % of Total Volume    : 5.00
Day (16 hrs) % of Total Volume   : 92.00

```

Data for Segment # 2: Klondike (day/night)

```

-----
Angle1  Angle2      : -90.00 deg  0.00 deg
Wood depth      : 0 (No woods.)
No of house rows : 0 / 0
Surface        : 2 (Reflective ground surface)
Receiver source distance : 40.00 / 40.00 m
Receiver height  : 16.50 / 16.50 m
Topography      : 1 (Flat/gentle slope; no barrier)
Reference angle  : 0.00

```

Results segment # 1: March Road (day)

Source height = 1.50 m

ROAD (0.00 + 74.85 + 0.00) = 74.85 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	90	0.00	77.72	0.00	-2.86	0.00	0.00	0.00	0.00	74.85

Segment Leq : 74.85 dBA

#





Results segment # 2: Klondike (day)

Source height = 1.50 m

ROAD (0.00 + 58.48 + 0.00) = 58.48 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	0	0.00	65.75	0.00	-4.26	-3.01	0.00	0.00	0.00	58.48

Segment Leq : 58.48 dBA

Total Leq All Segments: 74.95 dBA

Results segment # 1: March Road (night)

Source height = 1.50 m

ROAD (0.00 + 67.41 + 0.00) = 67.41 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	90	0.00	70.12	0.00	-2.71	0.00	0.00	0.00	0.00	67.41

Segment Leq : 67.41 dBA

Results segment # 2: Klondike (night)

Source height = 1.50 m

ROAD (0.00 + 50.89 + 0.00) = 50.89 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	0	0.00	58.16	0.00	-4.26	-3.01	0.00	0.00	0.00	50.89

Segment Leq : 50.89 dBA

Total Leq All Segments: 67.51 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 74.95  
(NIGHT): 67.51

#



STAMSON 5.0                      NORMAL REPORT                      Date: 03-07-2018 152:36:24  
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r4.te                      Time Period: Day/Night 16/8 hours  
Description:

Road data, segment # 1: March Road (day/night)

-----  
Car traffic volume    : 40480/3520    veh/TimePeriod    \*  
Medium truck volume : 3220/280     veh/TimePeriod    \*  
Heavy truck volume  : 2300/200     veh/TimePeriod    \*  
Posted speed limit  :     80 km/h  
Road gradient        :     0 %  
Road pavement       :     1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 50000  
Percentage of Annual Growth         : 0.00  
Number of Years of Growth           : 0.00  
Medium Truck % of Total Volume      : 7.00  
Heavy Truck % of Total Volume        : 5.00  
Day (16 hrs) % of Total Volume      : 92.00

Data for Segment # 1: March Road (day/night)

-----  
Angle1    Angle2                : -48.00 deg    90.00 deg  
Wood depth                :     0         (No woods.)  
No of house rows         :     0 / 0  
Surface                    :     2         (Reflective ground surface)  
Receiver source distance : 36.00 / 36.00 m  
Receiver height          : 16.50 / 16.50 m  
Topography                :     1         (Flat/gentle slope; no barrier)  
Reference angle          :     0.00

#



Road data, segment # 2: Klondike (day/night)

```

-----
Car traffic volume   : 6477/563   veh/TimePeriod  *
Medium truck volume : 515/45    veh/TimePeriod  *
Heavy truck volume  : 368/32    veh/TimePeriod  *
Posted speed limit  : 50 km/h
Road gradient       : 0 %
Road pavement      : 1 (Typical asphalt or concrete)

```

\* Refers to calculated road volumes based on the following input:

```

24 hr Traffic Volume (AADT or SADT): 8000
Percentage of Annual Growth       : 0.00
Number of Years of Growth         : 0.00
Medium Truck % of Total Volume    : 7.00
Heavy Truck % of Total Volume     : 5.00
Day (16 hrs) % of Total Volume    : 92.00

```

Data for Segment # 2: Klondike (day/night)

```

-----
Angle1  Angle2      : -90.00 deg  54.00 deg
Wood depth      : 0 (No woods.)
No of house rows : 0 / 0
Surface         : 2 (Reflective ground surface)
Receiver source distance : 28.00 / 28.00 m
Receiver height  : 16.50 / 16.50 m
Topography      : 1 (Flat/gentle slope; no barrier)
Reference angle  : 0.00

```

Results segment # 1: March Road (day)

Source height = 1.50 m

ROAD (0.00 + 72.76 + 0.00) = 72.76 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-48	90	0.00	77.72	0.00	-3.80	-1.15	0.00	0.00	0.00	72.76

Segment Leq : 72.76 dBA

#



Results segment # 2: Klondike (day)

Source height = 1.50 m

ROAD (0.00 + 62.07 + 0.00) = 62.07 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	54	0.00	65.75	0.00	-2.71	-0.97	0.00	0.00	0.00	62.07

Segment Leq : 62.07 dBA

Total Leq All Segments: 73.12 dBA

Results segment # 1: March Road (night)

Source height = 1.50 m

ROAD (0.00 + 65.16 + 0.00) = 65.16 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-48	90	0.00	70.12	0.00	-3.80	-1.15	0.00	0.00	0.00	65.16

Segment Leq : 65.16 dBA

Results segment # 2: Klondike (night)

Source height = 1.50 m

ROAD (0.00 + 54.48 + 0.00) = 54.48 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	54	0.00	58.16	0.00	-2.71	-0.97	0.00	0.00	0.00	54.48

Segment Leq : 54.48 dBA

Total Leq All Segments: 65.52 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 73.12  
(NIGHT): 65.52

#



STAMSON 5.0                      NORMAL REPORT                      Date: 03-07-2018 152:36:39  
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r5.te    Time Period: Day/Night 16/8 hours  
Description:

Road data, segment # 1: March Road (day/night)

-----  
Car traffic volume    : 40480/3520    veh/TimePeriod    \*  
Medium truck volume : 3220/280     veh/TimePeriod    \*  
Heavy truck volume  : 2300/200     veh/TimePeriod    \*  
Posted speed limit  :     80 km/h  
Road gradient        :     0 %  
Road pavement       :     1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 50000  
Percentage of Annual Growth         : 0.00  
Number of Years of Growth            : 0.00  
Medium Truck % of Total Volume       : 7.00  
Heavy Truck % of Total Volume        : 5.00  
Day (16 hrs) % of Total Volume       : 92.00

Data for Segment # 1: March Road (day/night)

-----  
Angle1    Angle2                    :    0.00 deg    90.00 deg  
Wood depth                        :     0            (No woods.)  
No of house rows                   :     0 / 0  
Surface                             :     2            (Reflective ground surface)  
Receiver source distance          : 48.00 / 48.00    m  
Receiver height                    : 16.50 / 16.50    m  
Topography                         :     1            (Flat/gentle slope; no barrier)  
Reference angle                     :     0.00

#



Road data, segment # 2: Klondike (day/night)

```

-----
Car traffic volume   : 6477/563   veh/TimePeriod  *
Medium truck volume  : 515/45    veh/TimePeriod  *
Heavy truck volume   : 368/32    veh/TimePeriod  *
Posted speed limit   : 50 km/h
Road gradient        : 0 %
Road pavement        : 1 (Typical asphalt or concrete)

```

\* Refers to calculated road volumes based on the following input:

```

24 hr Traffic Volume (AADT or SADT): 8000
Percentage of Annual Growth         : 0.00
Number of Years of Growth           : 0.00
Medium Truck % of Total Volume      : 7.00
Heavy Truck % of Total Volume       : 5.00
Day (16 hrs) % of Total Volume      : 92.00

```

Data for Segment # 2: Klondike (day/night)

```

-----
Angle1  Angle2          : -90.00 deg   90.00 deg
Wood depth          : 0 (No woods.)
No of house rows    : 0 / 0
Surface             : 2 (Reflective ground surface)
Receiver source distance : 23.00 / 23.00 m
Receiver height     : 16.50 / 16.50 m
Topography          : 1 (Flat/gentle slope; no barrier)
Reference angle     : 0.00

```

Results segment # 1: March Road (day)

Source height = 1.50 m

ROAD (0.00 + 69.65 + 0.00) = 69.65 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
0	90	0.00	77.72	0.00	-5.05	-3.01	0.00	0.00	0.00	69.65

Segment Leq : 69.65 dBA

#



Results segment # 2: Klondike (day)

Source height = 1.50 m

ROAD (0.00 + 63.89 + 0.00) = 63.89 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	90	0.00	65.75	0.00	-1.86	0.00	0.00	0.00	0.00	63.89

Segment Leq : 63.89 dBA

Total Leq All Segments: 70.67 dBA

Results segment # 1: March Road (night)

Source height = 1.50 m

ROAD (0.00 + 62.06 + 0.00) = 62.06 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
0	90	0.00	70.12	0.00	-5.05	-3.01	0.00	0.00	0.00	62.06

Segment Leq : 62.06 dBA

Results segment # 2: Klondike (night)

Source height = 1.50 m

ROAD (0.00 + 56.30 + 0.00) = 56.30 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	90	0.00	58.16	0.00	-1.86	0.00	0.00	0.00	0.00	56.30

Segment Leq : 56.30 dBA

Total Leq All Segments: 63.08 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 70.67  
(NIGHT): 63.08

#



STAMSON 5.0                      NORMAL REPORT                      Date: 29-06-2018 15:42:32  
 MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r6.te                      Time Period: Day/Night 16/8 hours  
 Description:

Road data, segment # 1: Klondike (day/night)

```
-----
Car traffic volume   :   6477/563   veh/TimePeriod  *
Medium truck volume :     515/45   veh/TimePeriod  *
Heavy truck volume  :     368/32   veh/TimePeriod  *
Posted speed limit  :       50 km/h
Road gradient       :         0 %
Road pavement      :         1 (Typical asphalt or concrete)
```

\* Refers to calculated road volumes based on the following input:

```

24 hr Traffic Volume (AADT or SADT):   8000
Percentage of Annual Growth          :   0.00
Number of Years of Growth             :   0.00
Medium Truck % of Total Volume        :   7.00
Heavy Truck % of Total Volume         :   5.00
Day (16 hrs) % of Total Volume        :  92.00
```

Data for Segment # 1: Klondike (day/night)

```
-----
Angle1   Angle2          :   0.00 deg   90.00 deg
Wood depth      :       0       (No woods.)
No of house rows :       0 / 0
Surface         :       2       (Reflective ground surface)
Receiver source distance : 27.00 / 27.00 m
Receiver height  :  16.50 / 16.50 m
Topography      :       1       (Flat/gentle slope; no barrier)
Reference angle  :       0.00
```

#





Results segment # 1: Klondike (day)

Source height = 1.50 m

ROAD (0.00 + 60.19 + 0.00) = 60.19 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
0	90	0.00	65.75	0.00	-2.55	-3.01	0.00	0.00	0.00	60.19

Segment Leq : 60.19 dBA

Total Leq All Segments: 60.19 dBA

Results segment # 1: Klondike (night)

Source height = 1.50 m

ROAD (0.00 + 52.59 + 0.00) = 52.59 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
0	90	0.00	58.16	0.00	-2.55	-3.01	0.00	0.00	0.00	52.59

Segment Leq : 52.59 dBA

Total Leq All Segments: 52.59 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 60.19  
(NIGHT): 52.59

#



STAMSON 5.0                      NORMAL REPORT                      Date: 03-07-2018 152:37:12  
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r7.te    Time Period: Day/Night 16/8 hours  
Description:

Road data, segment # 1: March Road (day/night)

-----  
Car traffic volume    : 40480/3520    veh/TimePeriod    \*  
Medium truck volume : 3220/280     veh/TimePeriod    \*  
Heavy truck volume  : 2300/200     veh/TimePeriod    \*  
Posted speed limit  :     80 km/h  
Road gradient        :     0 %  
Road pavement       :     1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 50000  
Percentage of Annual Growth        : 0.00  
Number of Years of Growth         : 0.00  
Medium Truck % of Total Volume    : 7.00  
Heavy Truck % of Total Volume     : 5.00  
Day (16 hrs) % of Total Volume    : 92.00

Data for Segment # 1: March Road (day/night)

-----  
Angle1    Angle2                    : -20.00 deg    0.00 deg  
Wood depth                        :     0        (No woods.)  
No of house rows                  :     0 / 0  
Surface                             :     2        (Reflective ground surface)  
Receiver source distance         : 65.00 / 65.00 m  
Receiver height                    : 1.50 / 1.50 m  
Topography                         :     1        (Flat/gentle slope; no barrier)  
Reference angle                    :     0.00

#



Road data, segment # 2: Klondike (day/night)

```

-----
Car traffic volume : 6477/563 veh/TimePeriod *
Medium truck volume : 515/45 veh/TimePeriod *
Heavy truck volume : 368/32 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

```

\* Refers to calculated road volumes based on the following input:

```

24 hr Traffic Volume (AADT or SADT): 8000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

```

Data for Segment # 2: Klondike (day/night)

```

-----
Angle1 Angle2 : 0.00 deg 90.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 1 (Absorptive ground surface)
Receiver source distance : 95.00 / 95.00 m
Receiver height : 1.50 / 1.50 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00

```

Results segment # 1: March Road (day)

Source height = 1.50 m

ROAD (0.00 + 61.80 + 0.00) = 61.80 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-20	0	0.00	77.72	0.00	-6.37	-9.54	0.00	0.00	0.00	61.80

Segment Leq : 61.80 dBA

#



Results segment # 2: Klondike (day)

Source height = 1.50 m

ROAD (0.00 + 47.98 + 0.00) = 47.98 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
0	90	0.66	65.75	0.00	-13.31	-4.47	0.00	0.00	0.00	47.98

Segment Leq : 47.98 dBA

Total Leq All Segments: 61.98 dBA

Results segment # 1: March Road (night)

Source height = 1.50 m

ROAD (0.00 + 54.21 + 0.00) = 54.21 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-20	0	0.00	70.12	0.00	-6.37	-9.54	0.00	0.00	0.00	54.21

Segment Leq : 54.21 dBA

Results segment # 2: Klondike (night)

Source height = 1.50 m

ROAD (0.00 + 40.38 + 0.00) = 40.38 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
0	90	0.66	58.16	0.00	-13.31	-4.47	0.00	0.00	0.00	40.38

Segment Leq : 40.38 dBA

Total Leq All Segments: 54.39 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 61.98  
(NIGHT): 54.39

#



STAMSON 5.0                      NORMAL REPORT                      Date: 03-07-2018 207:48:13  
 MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r7ola.te                      Time Period: Day/Night 16/8 hours  
 Description:

Road data, segment # 1: March Road 1 (day/night)

```
-----
Car traffic volume   : 40480/3520  veh/TimePeriod  *
Medium truck volume :  3220/280    veh/TimePeriod  *
Heavy truck volume  :  2300/200   veh/TimePeriod  *
Posted speed limit  :     80 km/h
Road gradient       :      0 %
Road pavement      :      1 (Typical asphalt or concrete)
```

\* Refers to calculated road volumes based on the following input:

```
24 hr Traffic Volume (AADT or SADT): 50000
Percentage of Annual Growth         :  0.00
Number of Years of Growth           :  0.00
Medium Truck % of Total Volume      :  7.00
Heavy Truck % of Total Volume       :  5.00
Day (16 hrs) % of Total Volume      : 92.00
```

Data for Segment # 1: March Road 1 (day/night)

```
-----
Angle1   Angle2       : -90.00 deg   -20.00 deg
Wood depth :      0      (No woods.)
No of house rows :      0 / 0
Surface     :      2      (Reflective ground surface)
Receiver source distance : 65.00 / 65.00 m
Receiver height :  1.50 / 1.50 m
Topography    :      2      (Flat/gentle slope; with barrier)
Barrier angle1 : -90.00 deg   Angle2 : -20.00 deg
Barrier height : 18.00 m
Barrier receiver distance : 37.00 / 37.00 m
Source elevation : 77.00 m
Receiver elevation : 74.00 m
Barrier elevation : 77.00 m
Reference angle  :  0.00
```

#                                      #



Road data, segment # 2: March Road 2 (day/night)

-----  
Car traffic volume : 40480/3520 veh/TimePeriod \*  
Medium truck volume : 3220/280 veh/TimePeriod \*  
Heavy truck volume : 2300/200 veh/TimePeriod \*  
Posted speed limit : 80 km/h  
Road gradient : 0 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 50000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: March Road 2 (day/night)

-----  
Angle1 Angle2 : -20.00 deg 0.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 2 (Reflective ground surface)  
Receiver source distance : 65.00 / 65.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -20.00 deg Angle2 : 0.00 deg  
Barrier height : 3.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 77.00 m  
Receiver elevation : 74.00 m  
Barrier elevation : 74.00 m  
Reference angle : 0.00

#

#



Road data, segment # 3: March Road 3 (day/night)

-----  
Car traffic volume : 40480/3520 veh/TimePeriod \*  
Medium truck volume : 3220/280 veh/TimePeriod \*  
Heavy truck volume : 2300/200 veh/TimePeriod \*  
Posted speed limit : 80 km/h  
Road gradient : 0 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 50000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 3: March Road 3 (day/night)

-----  
Angle1 Angle2 : 0.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 2 (Reflective ground surface)  
Receiver source distance : 65.00 / 65.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 0.00 deg Angle2 : 90.00 deg  
Barrier height : 18.00 m  
Barrier receiver distance : 37.00 / 37.00 m  
Source elevation : 77.00 m  
Receiver elevation : 74.00 m  
Barrier elevation : 77.00 m  
Reference angle : 0.00

# #



Road data, segment # 4: Klondike (day/night)

-----  
Car traffic volume : 6477/563 veh/TimePeriod \*  
Medium truck volume : 515/45 veh/TimePeriod \*  
Heavy truck volume : 368/32 veh/TimePeriod \*  
Posted speed limit : 50 km/h  
Road gradient : 0 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 8000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 4: Klondike (day/night)

-----  
Angle1 Angle2 : 0.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 95.00 / 95.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 1 (Flat/gentle slope; no barrier)  
Reference angle : 0.00

# #





Results segment # 1: March Road 1 (day)

Source height = 1.50 m

Barrier height for grazing incidence

Source Height (m)	Receiver Height (m)	Barrier Height (m)	Elevation of Barrier Top (m)
1.50	1.50	0.21	77.21

ROAD (0.00 + 48.82 + 0.00) = 48.82 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	-20	0.00	77.72	0.00	-6.37	-4.10	0.00	0.00	-18.42	48.82

Segment Leq : 48.82 dBA

Results segment # 2: March Road 2 (day)

Source height = 1.50 m

Barrier height for grazing incidence

Source Height (m)	Receiver Height (m)	Barrier Height (m)	Elevation of Barrier Top (m)
1.50	1.50	1.64	75.64

ROAD (0.00 + 49.29 + 0.00) = 49.29 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-20	0	0.00	77.72	0.00	-6.37	-9.54	0.00	0.00	-12.52	49.29

Segment Leq : 49.29 dBA

# #



Results segment # 3: March Road 3 (day)

Source height = 1.50 m

Barrier height for grazing incidence

Source Height (m)	Receiver Height (m)	Barrier Height (m)	Elevation of Barrier Top (m)
1.50	1.50	0.21	77.21

ROAD (0.00 + 49.61 + 0.00) = 49.61 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
0	90	0.00	77.72	0.00	-6.37	-3.01	0.00	0.00	-18.73	49.61

Segment Leq : 49.61 dBA

Results segment # 4: Klondike (day)

Source height = 1.50 m

ROAD (0.00 + 47.98 + 0.00) = 47.98 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
0	90	0.66	65.75	0.00	-13.31	-4.47	0.00	0.00	0.00	47.98

Segment Leq : 47.98 dBA

Total Leq All Segments: 54.99 dBA

# #



Results segment # 1: March Road 1 (night)

Source height = 1.50 m

Barrier height for grazing incidence

Source Height (m)	Receiver Height (m)	Barrier Height (m)	Elevation of Barrier Top (m)
1.50	1.50	0.21	77.21

ROAD (0.00 + 41.23 + 0.00) = 41.23 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	-20	0.00	70.12	0.00	-6.37	-4.10	0.00	0.00	-18.42	41.23

Segment Leq : 41.23 dBA

Results segment # 2: March Road 2 (night)

Source height = 1.50 m

Barrier height for grazing incidence

Source Height (m)	Receiver Height (m)	Barrier Height (m)	Elevation of Barrier Top (m)
1.50	1.50	1.64	75.64

ROAD (0.00 + 41.69 + 0.00) = 41.69 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-20	0	0.00	70.12	0.00	-6.37	-9.54	0.00	0.00	-12.52	41.69

Segment Leq : 41.69 dBA

# #



Results segment # 3: March Road 3 (night)

Source height = 1.50 m

Barrier height for grazing incidence

Source Height (m)	Receiver Height (m)	Barrier Height (m)	Elevation of Barrier Top (m)
1.50	1.50	0.21	77.21

ROAD (0.00 + 42.01 + 0.00) = 42.01 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
0	90	0.00	70.12	0.00	-6.37	-3.01	0.00	0.00	-18.73	42.01

Segment Leq : 42.01 dBA

Results segment # 4: Klondike (night)

Source height = 1.50 m

ROAD (0.00 + 40.38 + 0.00) = 40.38 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
0	90	0.66	58.16	0.00	-13.31	-4.47	0.00	0.00	0.00	40.38

Segment Leq : 40.38 dBA

Total Leq All Segments: 47.39 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 54.99  
(NIGHT): 47.39