
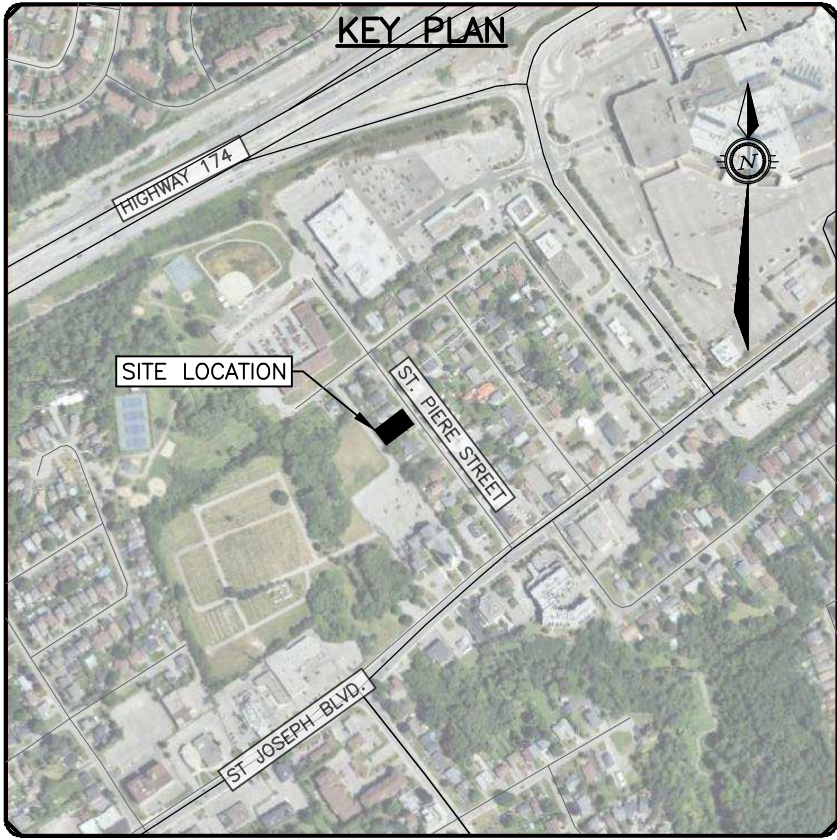


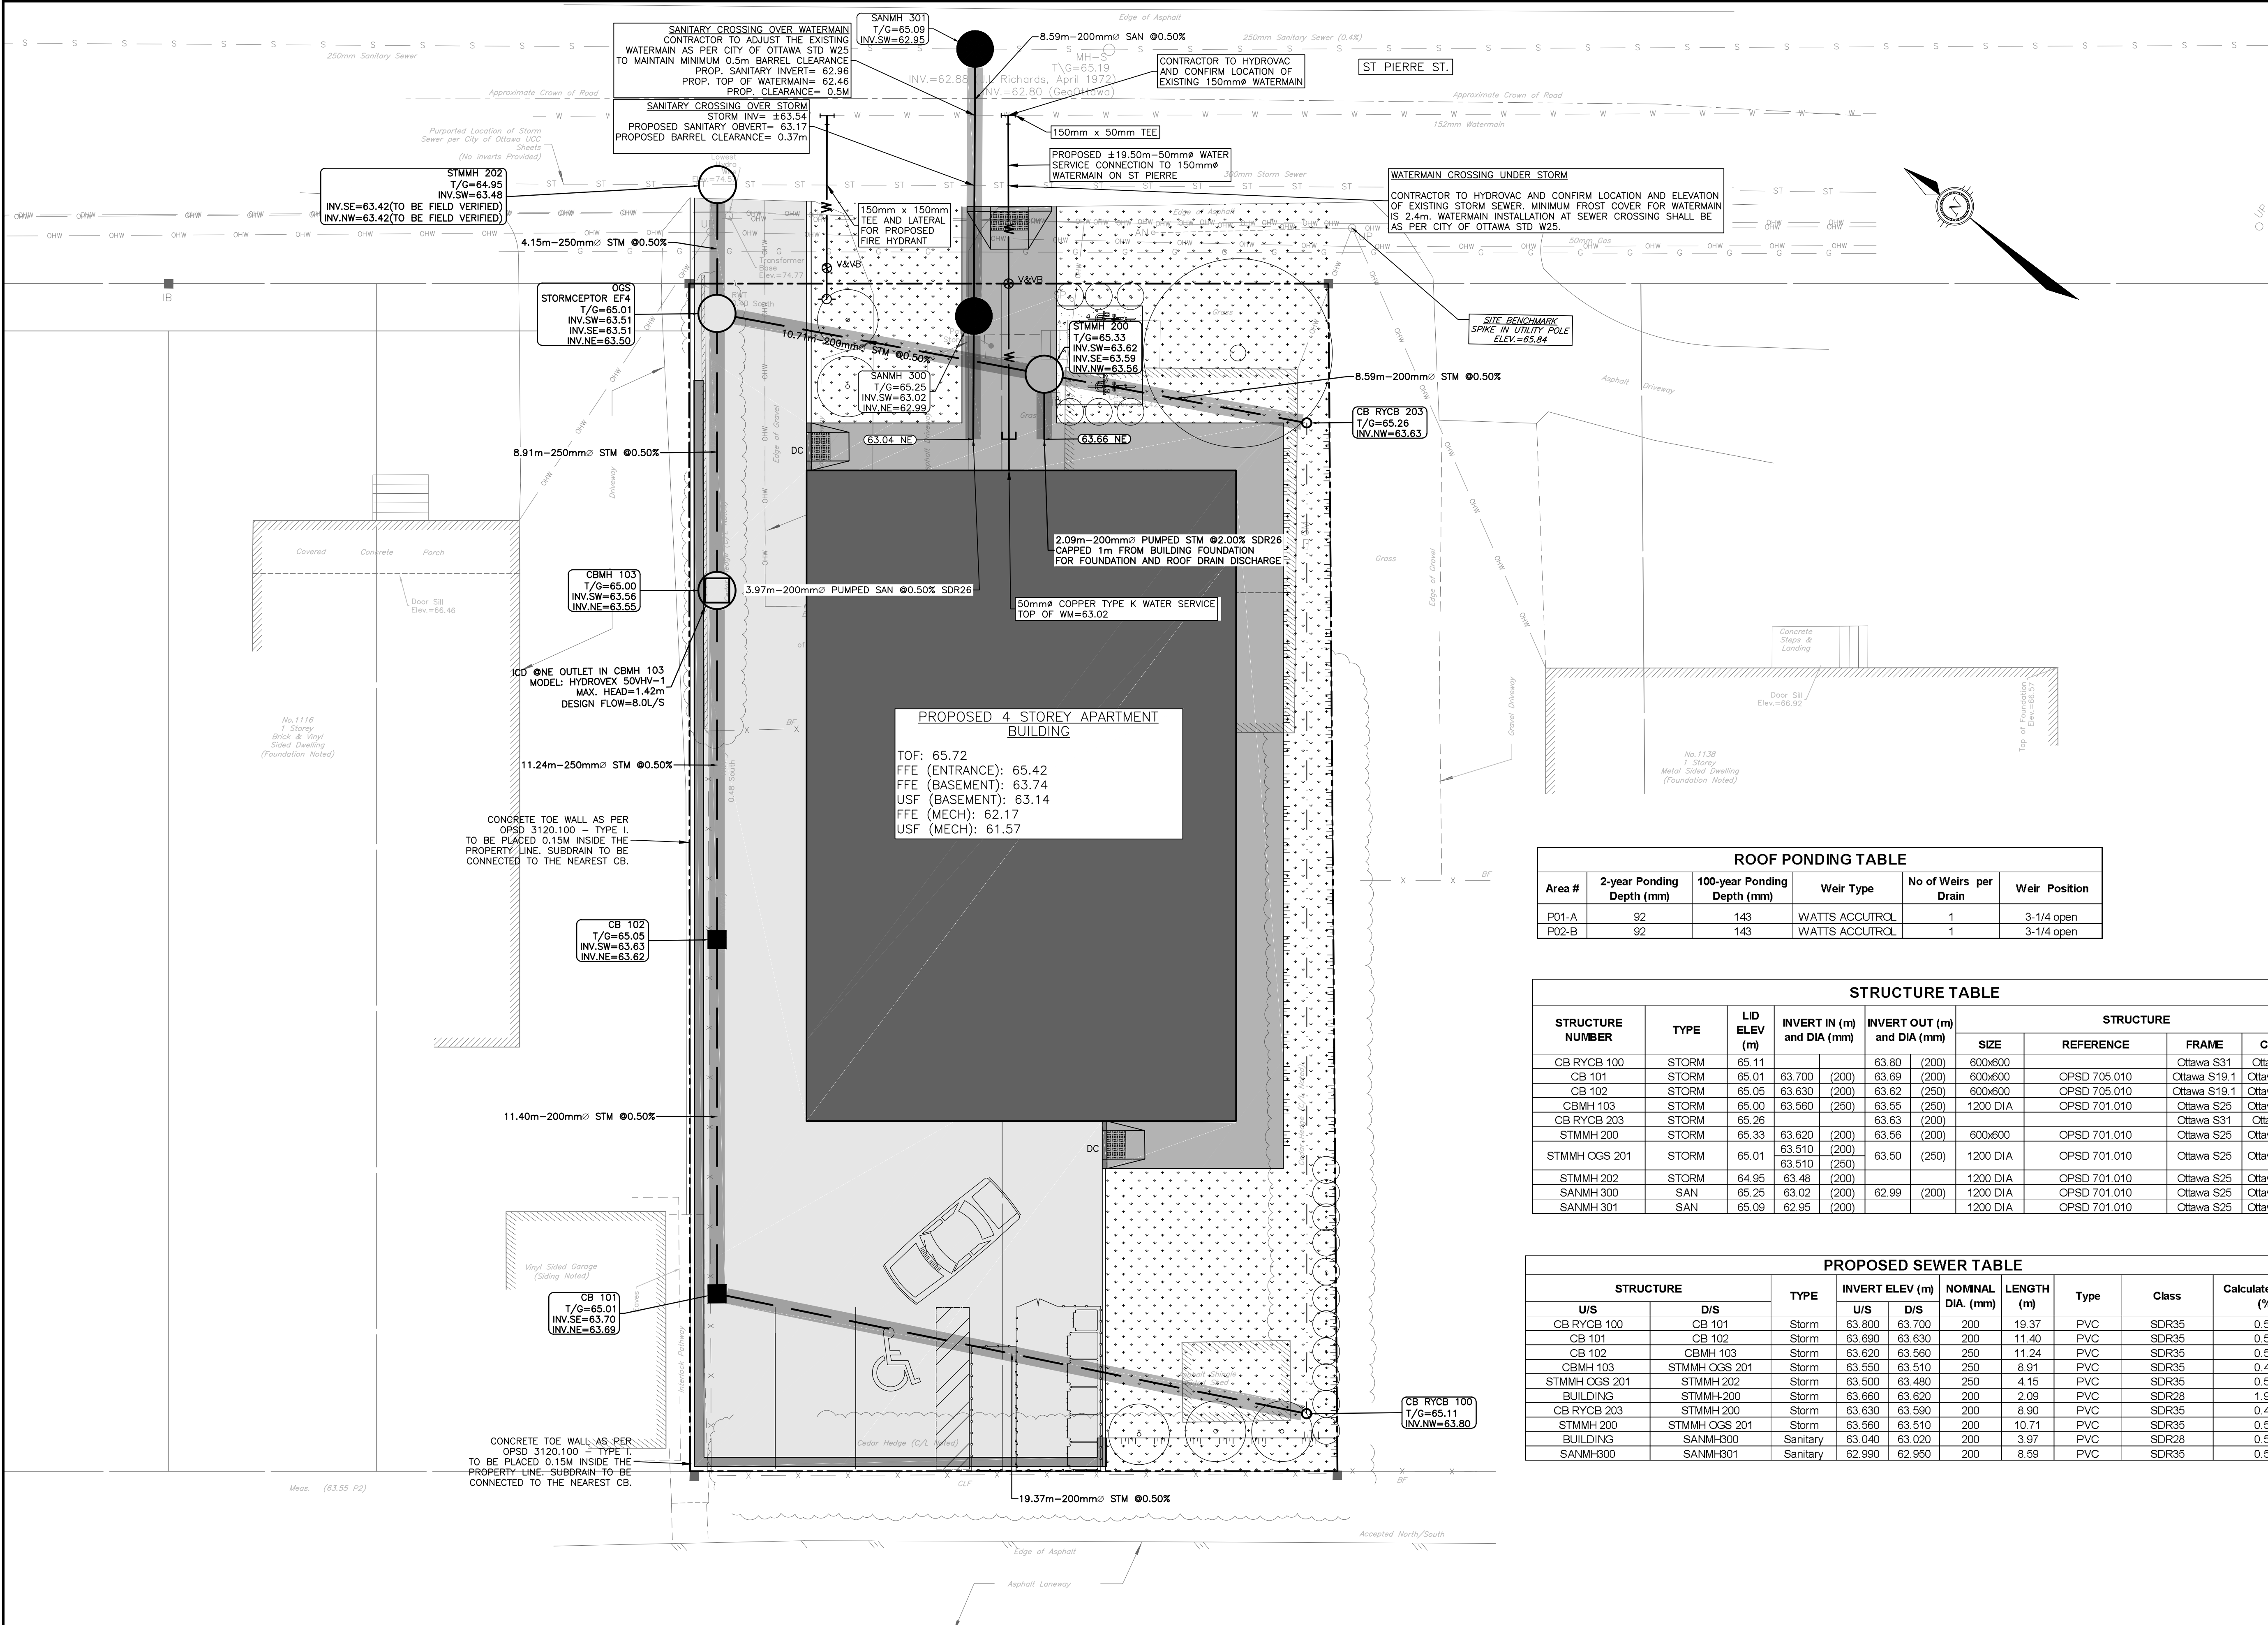

LEGEND	
	PROPERTY LINE
	EXISTING C. OF ROAD
	EXISTING EDGE OF GRAVEL
	EXISTING EDGE OF PAVEMENT
	EXISTING TREE
	EXISTING FENCE
	EXISTING UTILITY POLE
	EXISTING SANITARY MANHOLE
	EXISTING SANITARY
	EXISTING SANITARY STORM
	EXISTING GAS
	EXISTING WATERMAIN
	PROP. ACCESSIBLE ENTRANCE
	PROP. STORM MANHOLE
	PROP. CATCHBASIN MANHOLE
	PROP. STORM RYCB
	PROP. STORM CATCHBASIN
	PROP. SANITARY MANHOLE
	PROP. STORM
	PROP. SANITARY
	PROPOSED WATERMAIN
	PROPOSED 450mm CSP CULVERT
	PROP. VALVE AND VALVEBOX
	PROP. FIRE HYDRANT
	RIGID INSULATION AS PER CITY OF OTTAWA STD S35
	EXISTING ELEVATION
	PROP. OPD 3120.100 TOE WALL
	DEPRESSED CURB
	ASPHALT
	CONCRETE
	INTERLOCK
	GRASS



ROOF PONDING TABLE					
Area #	2-year Ponding Depth (mm)	100-year Ponding Depth (mm)	Weir Type	No of Weirs per Drain	Weir Position
P01-A	92	143	WATTS ACCUTROL	1	3-1/4 open
P02-B	92	143	WATTS ACCUTROL	1	3-1/4 open

STRUCTURE TABLE								
STRUCTURE NUMBER	TYPE	LID ELEV (m)	INVERT IN (m) and DIA (mm)	INVERT OUT (m) and DIA (mm)	STRUCTURE			
					SIZE	REFERENCE	FRAME	COVER
CB RYCB 100	STORM	65.11		63.80 (200)	600x600		Ottawa S31	Ottawa S31
CB 101	STORM	65.01	63.700 (200)	63.69 (200)	600x600	OPSD 705.010	Ottawa S19.1	Ottawa S19.1
CB 102	STORM	65.05	63.630 (200)	63.62 (250)	600x600	OPSD 705.010	Ottawa S19.1	Ottawa S19.1
CBMH 103	STORM	65.00	63.560 (250)	63.55 (250)	1200 DIA	OPSD 701.010	Ottawa S25	Ottawa S24.1
CB RYCB 203	STORM	65.26		63.63 (200)			Ottawa S31	Ottawa S31
STMMH 200	STORM	65.33	63.620 (200)	63.56 (200)	600x600	OPSD 701.010	Ottawa S25	Ottawa S24.1
STMMH OGS 201	STORM	65.01	63.510 (200)	63.50 (250)	1200 DIA	OPSD 701.010	Ottawa S25	Ottawa S24.1
STMMH 202	STORM	64.95	63.48 (200)		1200 DIA	OPSD 701.010	Ottawa S25	Ottawa S24.1
SANMH 300	SAN	65.25	63.02 (200)	62.99 (200)	1200 DIA	OPSD 701.010	Ottawa S25	Ottawa S24.1
SANMH 301	SAN	65.09	62.95 (200)		1200 DIA	OPSD 701.010	Ottawa S25	Ottawa S24.1

PROPOSED SEWER TABLE								
STRUCTURE	U/S	D/S	TYPE	INVERT ELEV (m)		NOMINAL DIA. (mm)	LENGTH (m)	Type
				U/S	D/S			
CB RYCB 100	CB 101	Storm		63.800	63.700	200	19.37	PVC
CB 101	CB 102	Storm		63.690	63.630	200	11.40	PVC
CB 102	CBMH 103	Storm		63.620	63.560	250	11.24	PVC
CBMH 103	STMMH OGS 201	Storm		63.550	63.510	250	8.91	PVC
STMMH OGS 201	STMMH 202	Storm		63.500	63.480	250	4.15	PVC
BUILDING	STMMH 200	Storm		63.660	63.620	200	2.09	PVC
CB RYCB 203	STMMH 200	Storm		63.630	63.590	200	8.90	PVC
STMMH 200	STMMH OGS 201	Storm		63.560	63.510	200	10.71	PVC
BUILDING	SANMH 300	Sanitary		63.040	63.020	200	3.97	PVC
SANMH 300	SANMH 301	Sanitary		62.990	62.950	200	8.59	PVC

CAUTION
THE POSITION OF ALL POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

REV	REVISION DESCRIPTION	DATE	BY	APPD	REV	REVISION DESCRIPTION	DATE	BY	APPD
1	SPA	06/08/24	AGJ	AJ					

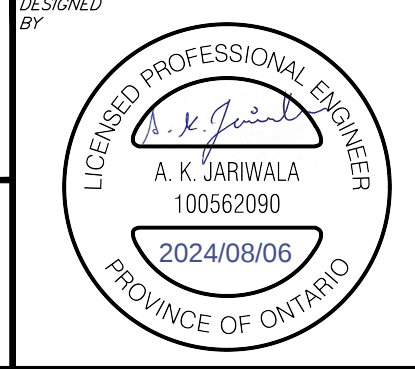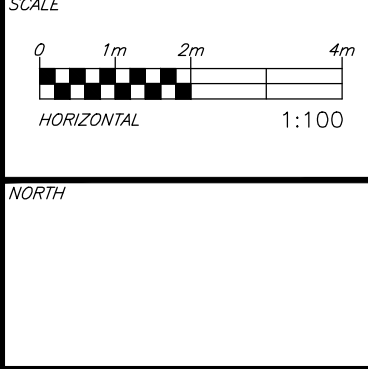

PulseSocieties Ltd.
135 LAURIER AVE W, SUITE 100
OTTAWA, ON. K1P 5J2
613.612.3288

exp. Services Inc.
1-813-888-1880 | 1-813-225-7330
200-10000000 Ave. Unit 100
Ottawa, ON K2B 8K6
Canada
www.exp.com

• BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
• INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

BASEPLAN	AGJ
DESIGN	AGJ
CHECKED	AJ
CAD	AGJ
PROJECT MANAGER	AJ
APPROVED	AA

1132 ST. PIERRE
OTTAWA, ONTARIO. K1C 1L5

SITE SERVICING PLAN

PROJECT No.	OTT-2406873-AD
SURVEY	ADV
DATE	31/07/24
DRAWING No.	C100