

Geotechnical Investigation

Proposed Building Addition

1620 Laperriere Avenue
Ottawa, Ontario

Prepared for Slipacoff's Premium Meats

Report PG7151-1 dated June 27, 2024

Table of Contents

	PAGE
1.0 Introduction	1
2.0 Proposed Development.....	1
3.0 Method of Investigation	2
3.1 Field Investigation	2
3.2 Field Survey	3
3.3 Laboratory Review	3
3.4 Analytical Testing	3
4.0 Observations	4
4.1 Surface Conditions	4
4.2 Subsurface Profile	4
4.3 Groundwater	5
5.0 Discussion	6
5.1 Geotechnical Assessment	6
5.2 Site Grading and Preparation.....	6
5.3 Foundation Design	7
5.4 Design for Earthquakes	8
5.5 Slab on Grade Construction	8
5.6 Pavement Design.....	8
6.0 Design and Construction Precautions.....	10
6.1 Foundation Backfill.....	10
6.2 Protection of Footings Against Frost Action	10
6.3 Excavation Side Slopes	10
6.4 Pipe Bedding and Backfill	11
6.5 Groundwater Control.....	12
6.6 Winter Construction.....	12
6.7 Corrosion Potential and Sulphate	13
7.0 Recommendations	14
8.0 Statement of Limitations.....	15

Appendices

- Appendix 1** Soil Profile and Test Data Sheets
 Symbols and Terms
 Analytical Testing Results
- Appendix 2** Figure 1 – Key Plan
 Drawing PG7151-1 – Test Hole Location Plan

1.0 Introduction

Paterson Group (Paterson) was commissioned by Slipacoff's Premium Meats to conduct a geotechnical investigation for the proposed building addition to be located at 1620 Laperriere Avenue in the City of Ottawa (refer to Figure 1 - Key Plan in Appendix 2 of this report for the general site location).

The objectives of the geotechnical investigation were to:

- ❑ Determine the subsoil and groundwater conditions at this site by means of boreholes and to;
- ❑ Provide geotechnical recommendations pertaining to the design of the proposed development including construction considerations which may affect the design.

The following report has been prepared specifically and solely for the aforementioned project which is described herein. It contains our findings and includes geotechnical recommendations pertaining to the design and construction of the subject development as they are understood at the time of writing this report.

Investigating for the presence or potential presence of contamination on the subject property was not part of the scope of work of the present investigation. Therefore, the present report does not address environmental issues.

2.0 Proposed Development

Based on the available drawings, the proposed development at the subject site will consist of a single-storey building addition with a slab-on-grade and an approximate footprint of 360 m². This building addition will directly abut the existing building to the south.

3.0 Method of Investigation

3.1 Field Investigation

Field Program

The field investigation was carried out on June 20, 2024, and consisted of advancing a total of 2 boreholes to a maximum depth of 5.1 m below the existing ground surface. The borehole locations were determined in the field by Paterson personnel taking into consideration site features and underground services. The locations of the boreholes are shown on Drawing PG7151-1 – Test Hole Location Plan in Appendix 2.

The boreholes were advanced using a track-mounted auger drill rig operated by a two-person crew. All fieldwork was conducted under the full-time supervision of Paterson personnel under the direction of a senior engineer. The drilling procedure consisted of augering to the required depths at the selected locations, and sampling and testing the overburden.

Sampling and In Situ Testing

Soil samples were recovered from the boreholes using two different techniques, namely, sampled directly from the auger flights (AU) or collected using a 50 mm diameter split-spoon (SS) sampler. All samples were visually inspected and initially classified on site and subsequently placed in sealed plastic bags.

All samples were transported to our laboratory for further examination and classification. The depths at which the auger and split spoon samples were recovered from the boreholes are shown as AU and SS, respectively, on the Soil Profile and Test Data sheets presented in Appendix 1.

The Standard Penetration Test (SPT) was conducted in conjunction with the recovery of the split spoon samples. The SPT results are recorded as “N” values on the Soil Profile and Test Data sheets. The “N” value is the number of blows required to drive the split spoon sampler 300 mm into the soil after a 150 mm initial penetration using a 63.5 kg hammer falling from a height of 760 mm.

The subsurface conditions observed in the boreholes were recovered in detail in the field. The soil profiles are logged on the Soil Profile and Test Data sheets in Appendix 1 of this report.

Groundwater

Flexible polyethylene standpipes were installed in all boreholes to permit monitoring of the groundwater levels subsequent to the completion of the field program. The measured groundwater levels are presented and discussed in Section 4.3 and are also provided on the Soil Profile and Test Data sheets in Appendix 1.

3.2 Field Survey

The borehole locations, and the ground surface elevations at each borehole location, were surveyed by Paterson using a handheld GPS unit, and referenced to a geodetic datum. The borehole locations and elevations are presented on Drawing PG7151-1 - Test Hole Location Plan in Appendix 2.

3.3 Laboratory Review

Soil samples were recovered from the subject site and visually examined in our laboratory to review the results of the field logging. All samples from the current investigation will be stored in the laboratory for a period of one month after issuance of this report. They will then be discarded unless we are otherwise directed.

3.4 Analytical Testing

One (1) soil sample was submitted for analytical testing to assess the corrosion potential for exposed ferrous metals and the potential of sulphate attacks against subsurface concrete structures. The sample was submitted to determine the concentration of sulphate and chloride, the resistivity, and the pH of the samples. The results are presented in Appendix 1 and are discussed further in Section 6.7.

4.0 Observations

4.1 Surface Conditions

The site of the proposed building addition currently consists of an asphalt-paved parking and loading area, surrounded by trees along its eastern, western, and southern edges. The site is bordered by the existing building to the north, and commercial properties to east, west, and south.

The existing ground surface across the site is relatively level at approximate geodetic elevation 79 m.

4.2 Subsurface Profile

Generally, the subsurface profile at the subject site consists of asphalt and fill overlying silty sand and/or a glacial till deposit. The fill was generally observed to consist of brown silty sand with gravel and crushed stone, extending to an approximate depth of 0.2 to 0.5 m below the existing ground surface.

In borehole BH 2-24, a 2 m thick sand deposit was encountered underlying the fill, which primarily consists of loose to compact, brown silty sand with some topsoil and trace clay.

The glacial till was encountered at depths of about 0.5 m in borehole BH 1-24 and 2.1 m in borehole BH 2-24, and generally consists of compact to very dense, brown to grey silty sand with varying amounts of gravel, cobbles, boulders, and clay.

Practical auger refusal was encountered in the boreholes at approximate depths ranging from 4.8 to 5.11 m below the existing ground surface.

Reference should be made to the Soil Profile and Test Data sheets in Appendix 1 for the details of the soil profile encountered at each test hole location.

Bedrock

Based on available geological mapping, the bedrock in the subject area consists of interbedded limestone and dolomite of the Gull River Formation with a drift thickness of 3 to 10 m.

4.3 Groundwater

The groundwater levels were measured in the piezometers on June 26, 2024. The observed groundwater levels are summarized in Table 1 below.

Table 1 - Summary of Groundwater Level Readings				
Test Hole Number	Ground Surface Elevation (m)	Groundwater Level (m)	Groundwater Elevation (m)	Recording Date
BH 1-24	79.54	2.63	76.91	June 26, 2024
BH 2-24	79.80	1.30	78.50	June 26, 2024

Note: Ground surface elevations at borehole locations are referenced to a geodetic datum.

It should be noted that groundwater levels could be influenced by surface water infiltrating the backfilled boreholes. The long-term groundwater levels can also be estimated based on the observed colour, moisture content and consistency of the recovered samples.

Based on these observations, the long-term groundwater level is expected to range between approximately 1.5 to 2.5 m below ground surface. However, it should be noted that groundwater levels are subject to seasonal fluctuations, therefore, the groundwater levels could vary at the time of construction.

5.0 Discussion

5.1 Geotechnical Assessment

The subject site is considered suitable for the proposed development, from a geotechnical perspective. It is recommended that the proposed building addition be founded on conventional spread footings placed on the undisturbed, compact silty sand and / or undisturbed, dense glacial till bearing surface.

Where the footings of the proposed building addition abut the existing building, they should match the existing footing elevations.

The above and other considerations are further discussed in the following sections.

5.2 Site Grading and Preparation

Stripping Depth

Topsoil and deleterious fill should be stripped from under any buildings and other settlement sensitive structures and subgrade preparation. It is anticipated that the existing fill within the proposed building addition footprint, free of deleterious material and significant amounts of organics, can be left in place below the proposed building slab-on-grade, outside of the lateral support zones for the footings. However, it is recommended that the existing fill layer be proof-rolled with several passes of a vibratory drum roller, under dry conditions and above freezing temperatures, and which is approved by Paterson personnel at the time of construction. Any poor performing areas noted during the proof-rolling operation should be removed and replaced with an approved fill.

Further, where undisturbed silty sand is encountered at the underside of footing (USF), it should be proof-compacted with several passes of a vibratory plate compactor or vibratory drum roller.

Fill Placement

Engineered fill used for grading beneath the proposed building addition should consist of clean imported granular fill, such as Ontario Provincial Standard Specifications (OPSS) Granular A or Granular B Type II. This material should be tested and approved prior to delivery to the site. The fill should be placed in lifts no greater than 300 mm thick and compacted using suitable compaction equipment for the lift thickness. Fill placed beneath the building and paved areas should be compacted to at least 98% of the material's standard Proctor maximum dry density (SPMDD).

Non-specified existing fill, along with site-excavated soil, can be used as general landscaping fill where settlement of the ground surface is of minor concern. This material should be spread in thin lifts and at least compacted by the tracks of the spreading equipment to minimize voids. If this material is to be used to build up the subgrade level for areas to be paved, it should be compacted in thin lifts to at least 95% of the material's SPMDD.

5.3 Foundation Design

Bearing Resistance Values

Footings can be placed on an undisturbed, compact silty sand and / or undisturbed, dense glacial till, can be designed using a bearing resistance value at serviceability limit states (SLS) of **200 kPa** and a factored bearing resistance value at ultimate limit states (ULS) of **300 kPa**. A geotechnical resistance factor of 0.5 was applied to the bearing resistance value at ULS.

An undisturbed soil bearing surface consists of one from which all topsoil and deleterious materials, such as loose or disturbed soil, have been removed, in the dry, prior to placement of concrete footings.

Footings placed on a soil bearing surface and designed using the bearing resistance values at SLS given above will be subjected to potential post-construction total and differential settlement of 25 and 20 mm, respectively.

As a general procedure, it is recommended that the footings for the proposed building addition that are located adjacent to the existing structure be founded at the same level as the existing footings. This accomplishes three objectives. First, the behaviour of the two structures at their connection will be similar due to the similar bearing medium. Second, there will be minimal stress added to the existing structure from the new structure. Third, the bearing of the new structure will not be influenced by any backfill from the existing structure.

Lateral Support

The bearing medium under footing-supported structures is required to be provided with adequate lateral support with respect to excavations and different foundation levels. Adequate lateral support is provided to a silty sand and/or glacial till bearing medium when a plane extending down and out from the bottom edges of the footing, at a minimum of 1.5H:1V, passes only through in situ soil of the same or higher capacity as that of the bearing medium.

5.4 Design for Earthquakes

The site class for seismic site response can be taken as **Class C**. Soils underlying the subject site are not susceptible to liquefaction. Reference should be made to the latest revision of the OBC 2012 for a full discussion of the earthquake design requirements.

5.5 Slab on Grade Construction

With the removal of any topsoil and fill, such as those containing significant amounts of deleterious materials, the existing fill or native soil subgrade approved by the geotechnical consultant at the time of excavation will be considered an acceptable subgrade surface on which to commence backfilling for floor slab construction.

As noted above, it is recommended that the slab-on-grade subgrade be proof-rolled with a suitably sized roller making several passes under dry conditions prior to fill placement, and which is approved by the geotechnical consultant. Any poor performing areas should be removed and replaced with an engineered fill, such as OPSS Granular A or B Type II.

It is recommended that the upper 200 mm of sub-floor fill is recommended to consist of OPSS Granular A crushed stone. All backfill material required to raise grade within the footprint of the proposed building should be placed in a maximum 300 mm thick loose lifts and compacted to 98% of its SPMDD.

If the proposed building addition will be used for cold storage, then a 100 mm thickness of HI-40 rigid insulation should be placed under the 200 mm thickness of OPSS Granular A

5.6 Pavement Design

Car only parking areas and access lanes are expected surrounding the proposed building addition. The proposed pavement structures are presented in Tables 2 and 3 on next page.

Table 2 - Recommended Pavement Structure - Car Only Parking Areas	
Thickness (mm)	Material Description
50	Wear Course – HL-3 or Superpave 12.5 Asphaltic Concrete
150	BASE - OPSS Granular A Crushed Stone
300	SUBBASE - OPSS Granular B Type II
SUBGRADE – Existing fill, or OPSS Granular B Type I or II material placed over in situ soil or engineered fill	

Table 3 - Recommended Asphalt Pavement Structure - Access Lanes and Heavy Truck Parking/Loading Areas	
Thickness (mm)	Material Description
40	Wear Course – HL-3 or Superpave 12.5 Asphaltic Concrete
50	Binder Course – HL-8 or Superpave 19.0 Asphaltic Concrete
150	BASE - OPSS Granular A Crushed Stone
450	SUBBASE - OPSS Granular B Type II
SUBGRADE – Existing fill, or OPSS Granular B Type I or II material placed over in situ soil or engineered fill	

Minimum Performance Graded (PG) 58-34 asphalt cement should be used for this project.

If soft spots develop in the subgrade during compaction or due to construction traffic, the affected areas should be excavated and replaced with OPSS Granular B Type II material.

The pavement granular base and subbase should be placed in maximum 300 mm thick lifts and compacted to a minimum of 99% of the SPMD using suitable vibratory equipment.

6.0 Design and Construction Precautions

6.1 Foundation Backfill

Foundation Backfill

Backfill against the exterior sides of the foundation walls should consist of free-draining, non-frost susceptible granular materials. Imported granular materials, such as clean sand or OPSS Granular B Type I granular material, can be used for this purpose.

Excavated on-site fill material, consisting of brown silty sand could also be re-used for backfilling the exterior sides of the foundation walls. However, this material would need to be maintained in an unfrozen state and at a suitable moisture content for compaction and free of organic or deleterious material if it is to be re-used for this purpose.

6.2 Protection of Footings Against Frost Action

Perimeter footings of heated structures are recommended to be insulated against the deleterious effects of frost action. A minimum 1.5 m thick soil cover, or an equivalent combination of soil cover and foundation insulation, should be provided in this regard.

If the proposed building addition will be used as cold storage, then 2.1 m of soil cover, or an equivalent thickness of soil cover and foundation insulation, is recommended for footings. Paterson should review the foundation insulation requirements once the detailed design drawings became available

6.3 Excavation Side Slopes

The side slopes of shallow excavations anticipated at this site should either be cut back at acceptable slopes or should be retained by temporary shoring systems from the start of the excavation until the structure is backfilled. It is anticipated that sufficient room will be available for the greater part of the excavation to be undertaken by open-cut methods (i.e., unsupported excavations).

The excavation side slopes above the groundwater level extending to a maximum depth of 3 m should be cut back at 1H:1V or flatter. The flatter slope (i.e. 3H:1V) is required for excavation below groundwater level.

The subsoil at this site is considered to be mainly a Type 2 and 3 soil according to the Occupational Health and Safety Act and Regulations for Construction Projects.

Excavated soil should not be stockpiled directly at the top of excavations and heavy equipment should be kept away from the excavation sides.

Slopes in excess of 3 m in height should be periodically inspected by the geotechnical consultant in order to detect if the slopes are exhibiting signs of distress.

It is recommended that a trench box be used at all times to protect personnel working in trenches with steep or vertical sides. It is expected that services will be installed by “cut and cover” methods and excavations will not be left open for extended periods of time.

6.4 Pipe Bedding and Backfill

Bedding and backfill materials should be in accordance with the most recent Material Specifications and Standard Detail Drawings from the Department of Public Works and Services, Infrastructure Services Branch of the City of Ottawa.

A minimum of 150 mm of OPSS Granular A should be placed for bedding for sewer or water pipes when placed on a soil subgrade. The bedding should extend to the spring line of the pipe. Cover material, from the spring line to a minimum of 300 mm above the obvert of the pipe, should consist of OPSS Granular A (concrete or PSM PVC pipes) or sand (concrete pipe). The bedding and cover materials should be placed in maximum 225 mm thick lifts and compacted to 98% of the SPMDD.

It should generally be possible to re-use the site materials above the cover material if the operations are carried out in dry weather conditions.

Where hard surface areas are considered above the trench backfill, the trench backfill material within the frost zone (about 1.8 m below finished grade) and above the cover material should match the soils exposed at the trench walls to minimize differential frost heaving. The trench backfill should be placed in maximum 225 mm thick loose lifts and compacted to a minimum of 95% of the material's SPMDD. All cobbles larger than 200 mm in their longest direction should be segregated from re-use as trench backfill.

6.5 Groundwater Control

Based on the results of the geotechnical investigation, it is anticipated that groundwater infiltration into the excavations is minimal and should be controllable using open sumps. However, the contractor should be prepared to direct water away from all bearing surfaces and subgrades, regardless of the source, to prevent disturbance to the founding medium.

Permit To Take Water

A temporary Ministry of Environment, Conservation and Parks (MECP) permit to take water (PTTW) may be required if more than 400,000 L/day of ground and/or surface water are to be pumped during the construction phase. At least 4 to 5 months should be allowed for completion of the application and issuance of the permit by the MECP.

For typical ground or surface water volumes being pumped during the construction phase, typically between 50,000 to 400,000 L/day, it is required to register on the Environmental Activity and Sector Registry (EASR). A minimum of two to four weeks should be allotted for completion of the EASR registration and the Water Taking and Discharge Plan to be prepared by a Qualified Person as stipulated under O.Reg. 63/16. If a project qualifies for a PTTW based upon anticipated conditions, an EASR will not be allowed as a temporary dewatering measure while awaiting the MECP review of the PTTW application.

Impacts on Neighboring Structures

Based on the observed existing groundwater level and anticipated shallow depth of foundation, it is not anticipated that the proposed excavation for the proposed building addition will extend below the groundwater table. Therefore, no adverse effects from short-term or long-term dewatering are expected for surrounding structures.

6.6 Winter Construction

Precautions must be taken if winter construction is considered for this project. The subsoil conditions at this site consist of frost susceptible materials. In the presence of water and freezing conditions, ice could form within the soil mass. Heaving and settlement upon thawing could occur.

In the event of construction during below zero temperatures, the founding stratum should be protected from freezing temperatures by the use of straw, propane heaters and tarpaulins or other suitable means. In this regard, the base of the

excavations should be insulated from sub-zero temperatures immediately upon exposure and until such time as heat is adequately supplied to the building and the footings are protected with sufficient soil cover to prevent freezing at founding level.

Trench excavations and pavement construction are also difficult activities to complete during freezing conditions without introducing frost into the subgrade or in the excavation walls and bottoms. Precautions should be taken if such activities are to be carried out during freezing conditions.

6.7 Corrosion Potential and Sulphate

The results of analytical testing show that the sulphate content is less than 0.1%. This result is indicative that Type 10 Portland cement (normal cement) would be appropriate for this site. The chloride content and the pH of the sample indicate that they are not significant factors in creating a corrosive environment for exposed ferrous metals at this site, whereas the resistivity is indicative of an moderate to non-aggressive corrosive environment.

7.0 Recommendations

It is a requirement for the foundation design data provided herein to be applicable that the following material testing and observation program be performed by the geotechnical consultant.

- Observation of all bearing surfaces prior to the placement of concrete.
- Sampling and testing of the concrete and fill materials.
- Periodic observation of the condition of unsupported excavation side slopes in excess of 3 m in height, if applicable.
- Observation of all subgrades prior to backfilling.
- Field density tests to determine the level of compaction achieved.
- Sampling and testing of the bituminous concrete including mix design reviews.

A report confirming that these works have been conducted in general accordance with our recommendations could be issued upon the completion of a satisfactory inspection program by the geotechnical consultant.

All excess soils, with the exception of engineered crushed stone fill, generated by construction activities that will be transported on-site or off-site should be handled as per Ontario Regulation 406/19: On-Site and Excess Soil Management.

8.0 Statement of Limitations

The recommendations provided herein are in accordance with the present understanding of the project. Paterson requests permission to review the recommendations when the drawings and specifications are completed.

A soils investigation is a limited sampling of a site. Should any conditions at the site be encountered which differ from those at the test locations, Paterson requests immediate notification to permit reassessment of our recommendations.

The recommendations provided herein should only be used by the design professionals associated with this project. They are not intended for contractors bidding on or undertaking the work. The latter should evaluate the factual information provided in this report and determine the suitability and completeness for their intended construction schedule and methods. Additional testing may be required for their purposes.

The present report applies only to the project described in this document. Use of this report for purposes other than those described herein or by person(s) other than Slipacoff's Premium Meats., or their agents, is not authorized without review by Paterson for the applicability of our recommendations to the alternative use of the report.

Paterson Group Inc.



Deepak K Rajendran, E.I.T.



Scott S. Dennis, P.Eng.

Report Distribution:

- Slipacoff's Premium Meats (email copy)
- Paterson Group (1 copy)

APPENDIX 1

SOIL PROFILE AND TEST DATA SHEETS

SYMBOLS AND TERMS

ANALYTICAL TESTING RESULTS

9 Auriga Drive, Ottawa, Ontario K2E 7T9

Geotechnical Investigation
1620 Laperriere Avenue
Ottawa, Ontario

EASTING: 363805.875 NORTHING: 5026448.305 ELEVATION: 79.54

DATUM: Geodetic

REMARKS:

BORINGS BY: CME-55 Low Clearance Drill

DATE: June 20, 2024

FILE NO. **PG7151**

HOLE NO. **BH 1-24**

SAMPLE DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				PIEZOMETER CONSTRUCTION	
		TYPE	NUMBER	% RECOVERY	N VALUE or RQD			○ Water Content %					
Ground Surface								20	40	60	80		
ASPHALT	0.08	AU	1			0	79.54						
FILL: Granular crushed stone	0.18	AU	2										
FILL: Brown silty sand with gravel and crushed stone	0.46												
GLACIAL TILL: Compact brown silty sand with gravel, cobbles and boulders, trace clay		SS	3	42	11	1	78.54						
GLACIAL TILL: Dense to very dense grey silty sand to sandy silt	1.45	SS	4	42	+50								
- Clay content decreasing with depth						2	77.54						
- Boulder content increasing with depth	2.21	SS	5	58	+50								
GLACIAL TILL: Dense grey silty sand with gravel, cobbles and boulders		SS	6	67	35								
		SS	7	54	35								
		SS	8	25	+50								
End of Borehole	4.80												
Practical refusal to augering at 4.8 m depth													
(GWL at 2.63 m - June 26, 2024)													
								20	40	60	80	100	
								Shear Strength (kPa)					
								▲ Undisturbed △ Remoulded					

9 Auriga Drive, Ottawa, Ontario K2E 7T9

Geotechnical Investigation
1620 Laperriere Avenue
Ottawa, Ontario

EASTING: 363814.801 NORTHING: 5026428.751 ELEVATION: 79.80

DATUM: Geodetic


REMARKS:

BORINGS BY: CME-55 Low Clearance Drill

DATE: June 20, 2024

FILE NO. **PG7151**

HOLE NO. **BH 2-24**

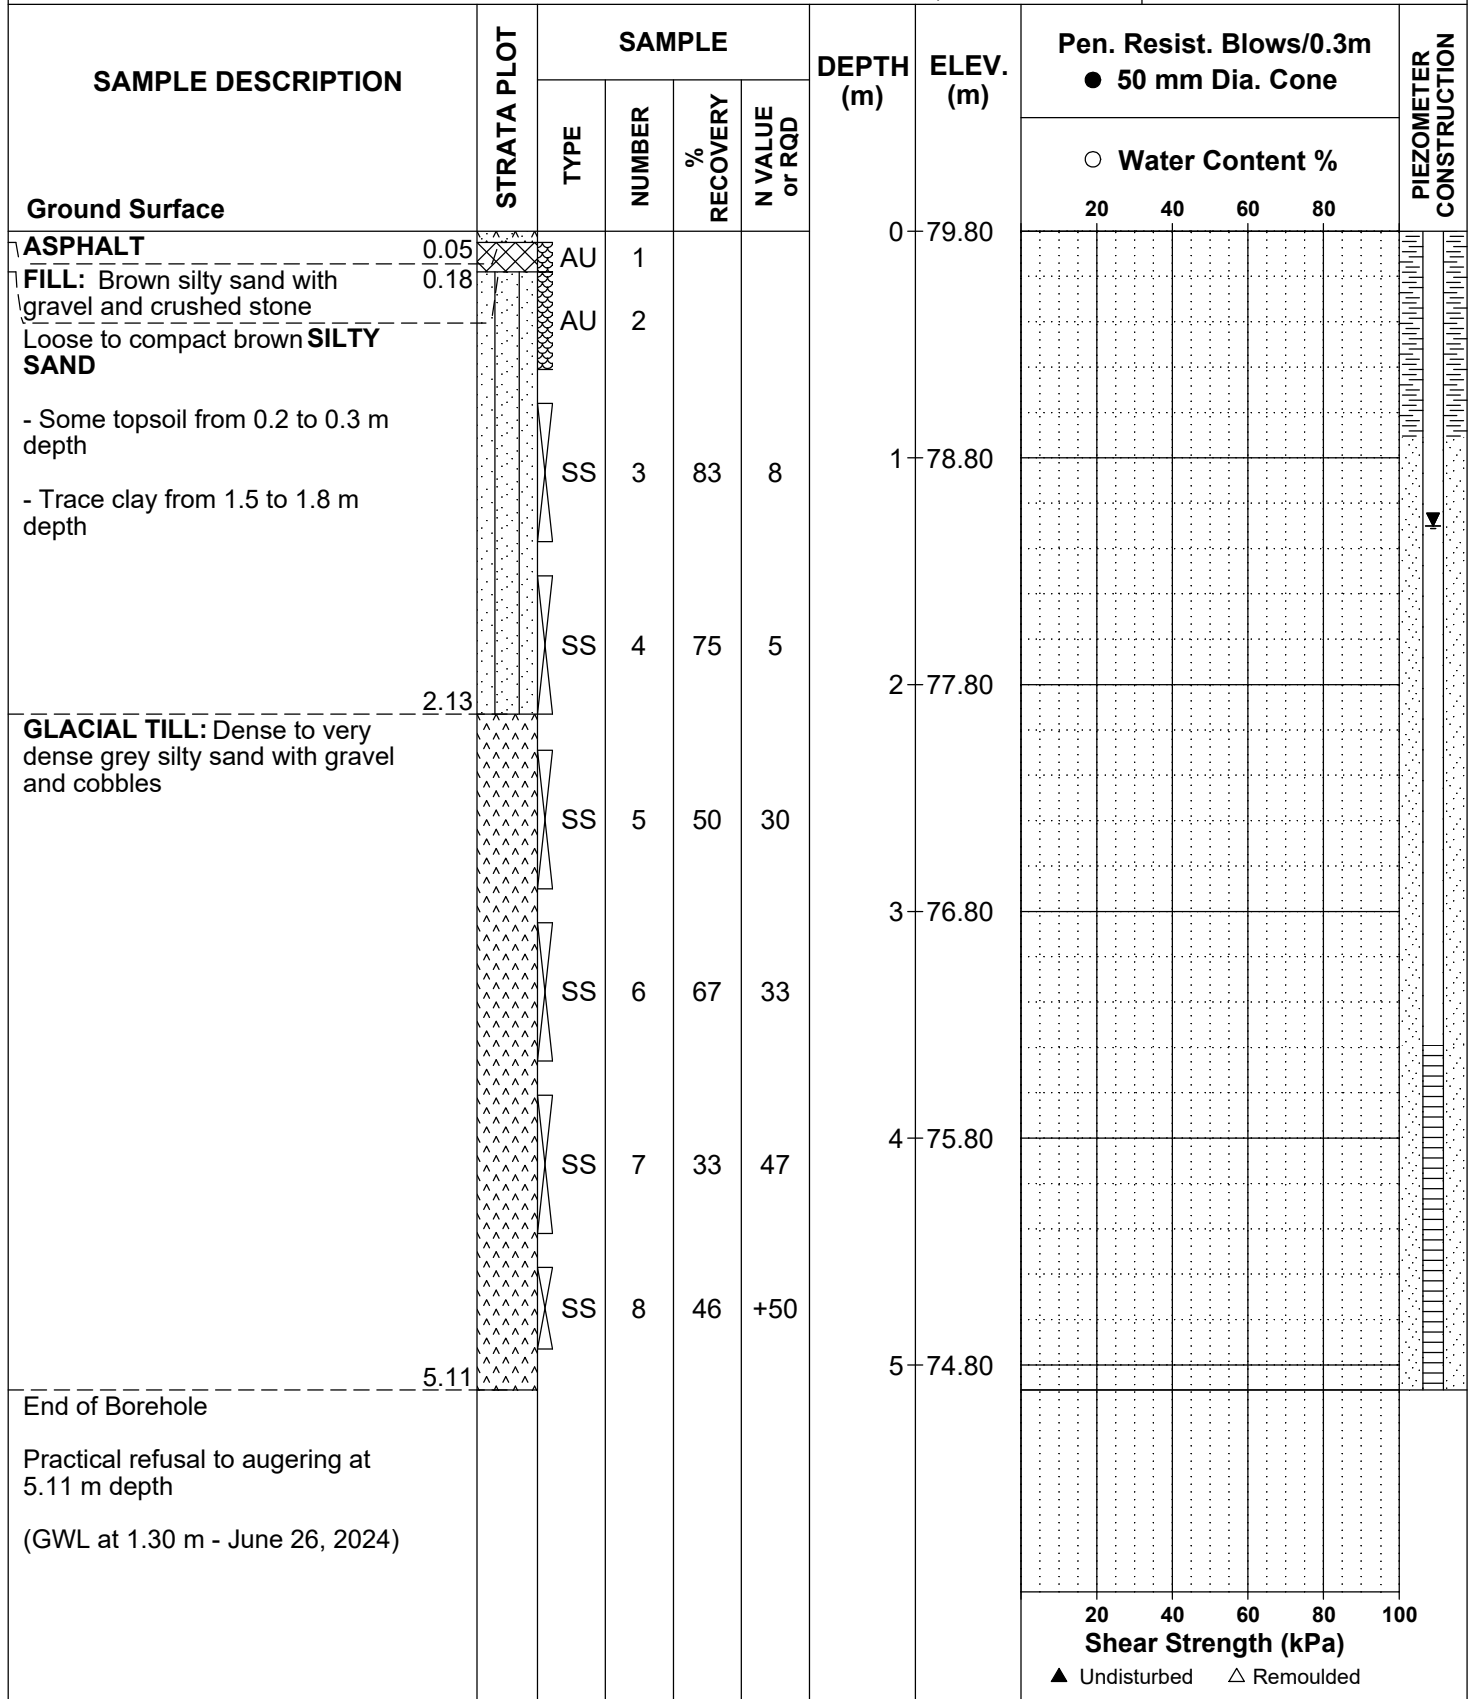

SYMBOLS AND TERMS

SOIL DESCRIPTION

Behavioural properties, such as structure and strength, take precedence over particle gradation in describing soils. Terminology describing soil structure are as follows:

Desiccated	-	having visible signs of weathering by oxidation of clay minerals, shrinkage cracks, etc.
Fissured	-	having cracks, and hence a blocky structure.
Varved	-	composed of regular alternating layers of silt and clay.
Stratified	-	composed of alternating layers of different soil types, e.g. silt and sand or silt and clay.
Well-Graded	-	Having wide range in grain sizes and substantial amounts of all intermediate particle sizes (see Grain Size Distribution).
Uniformly-Graded	-	Predominantly of one grain size (see Grain Size Distribution).

The standard terminology to describe the strength of cohesionless soils is the relative density, usually inferred from the results of the Standard Penetration Test (SPT) 'N' value. The SPT N value is the number of blows of a 63.5 kg hammer, falling 760 mm, required to drive a 51 mm O.D. split spoon sampler 300 mm into the soil after an initial penetration of 150 mm.

Relative Density	'N' Value	Relative Density %
Very Loose	<4	<15
Loose	4-10	15-35
Compact	10-30	35-65
Dense	30-50	65-85
Very Dense	>50	>85

The standard terminology to describe the strength of cohesive soils is the consistency, which is based on the undisturbed undrained shear strength as measured by the in situ or laboratory vane tests, penetrometer tests, unconfined compression tests, or occasionally by Standard Penetration Tests.

Consistency	Undrained Shear Strength (kPa)	'N' Value
Very Soft	<12	<2
Soft	12-25	2-4
Firm	25-50	4-8
Stiff	50-100	8-15
Very Stiff	100-200	15-30
Hard	>200	>30

SYMBOLS AND TERMS (continued)

SOIL DESCRIPTION (continued)

Cohesive soils can also be classified according to their "sensitivity". The sensitivity is the ratio between the undisturbed undrained shear strength and the remoulded undrained shear strength of the soil.

Terminology used for describing soil strata based upon texture, or the proportion of individual particle sizes present is provided on the Textural Soil Classification Chart at the end of this information package.

ROCK DESCRIPTION

The structural description of the bedrock mass is based on the Rock Quality Designation (RQD).

The RQD classification is based on a modified core recovery percentage in which all pieces of sound core over 100 mm long are counted as recovery. The smaller pieces are considered to be a result of closely-spaced discontinuities (resulting from shearing, jointing, faulting, or weathering) in the rock mass and are not counted. RQD is ideally determined from NXL size core. However, it can be used on smaller core sizes, such as BX, if the bulk of the fractures caused by drilling stresses (called "mechanical breaks") are easily distinguishable from the normal in situ fractures.

RQD %	ROCK QUALITY
90-100	Excellent, intact, very sound
75-90	Good, massive, moderately jointed or sound
50-75	Fair, blocky and seamy, fractured
25-50	Poor, shattered and very seamy or blocky, severely fractured
0-25	Very poor, crushed, very severely fractured

SAMPLE TYPES

SS	-	Split spoon sample (obtained in conjunction with the performing of the Standard Penetration Test (SPT))
TW	-	Thin wall tube or Shelby tube
PS	-	Piston sample
AU	-	Auger sample or bulk sample
WS	-	Wash sample
RC	-	Rock core sample (Core bit size AXT, BXL, etc.). Rock core samples are obtained with the use of standard diamond drilling bits.

SYMBOLS AND TERMS (continued)

GRAIN SIZE DISTRIBUTION

MC%	-	Natural moisture content or water content of sample, %
LL	-	Liquid Limit, % (water content above which soil behaves as a liquid)
PL	-	Plastic limit, % (water content above which soil behaves plastically)
PI	-	Plasticity index, % (difference between LL and PL)
Dxx	-	Grain size which xx% of the soil, by weight, is of finer grain sizes These grain size descriptions are not used below 0.075 mm grain size
D10	-	Grain size at which 10% of the soil is finer (effective grain size)
D60	-	Grain size at which 60% of the soil is finer
Cc	-	Concavity coefficient = $(D_{30})^2 / (D_{10} \times D_{60})$
Cu	-	Uniformity coefficient = D_{60} / D_{10}

Cc and Cu are used to assess the grading of sands and gravels:

Well-graded gravels have: $1 < Cc < 3$ and $Cu > 4$

Well-graded sands have: $1 < Cc < 3$ and $Cu > 6$

Sands and gravels not meeting the above requirements are poorly-graded or uniformly-graded.

Cc and Cu are not applicable for the description of soils with more than 10% silt and clay (more than 10% finer than 0.075 mm or the #200 sieve)

CONSOLIDATION TEST

p'_o	-	Present effective overburden pressure at sample depth
p'_c	-	Preconsolidation pressure of (maximum past pressure on) sample
Ccr	-	Recompression index (in effect at pressures below p'_c)
Cc	-	Compression index (in effect at pressures above p'_c)
OC Ratio		Overconsolidation ratio = p'_c / p'_o
Void Ratio		Initial sample void ratio = volume of voids / volume of solids
Wo	-	Initial water content (at start of consolidation test)

PERMEABILITY TEST


k	-	Coefficient of permeability or hydraulic conductivity is a measure of the ability of water to flow through the sample. The value of k is measured at a specified unit weight for (remoulded) cohesionless soil samples, because its value will vary with the unit weight or density of the sample during the test.
---	---	--

SYMBOLS AND TERMS (continued)


STRATA PLOT



Topsoil




Asphalt




Fill




Peat




Sand




Silty Sand




Silt




Sandy Silt



Clay




Silty Clay




Clayey Silty Sand



Glacial Till




Shale




Bedrock

MONITORING WELL AND PIEZOMETER CONSTRUCTION

MONITORING WELL CONSTRUCTION

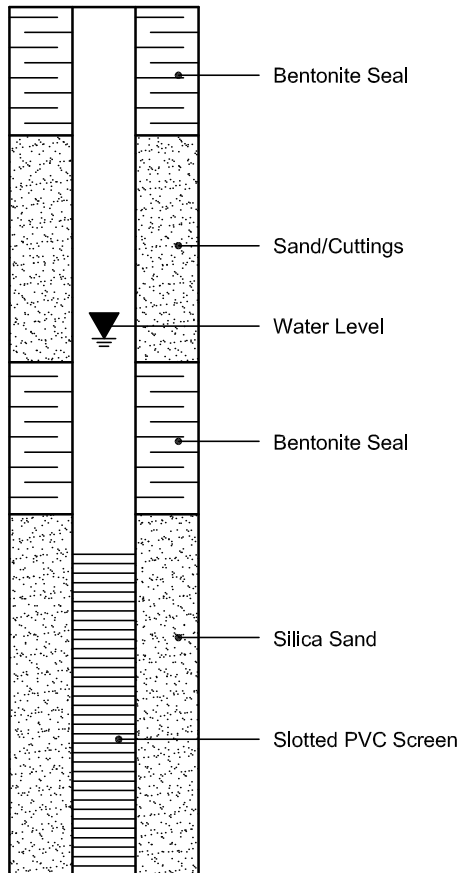

PIEZOMETER CONSTRUCTION

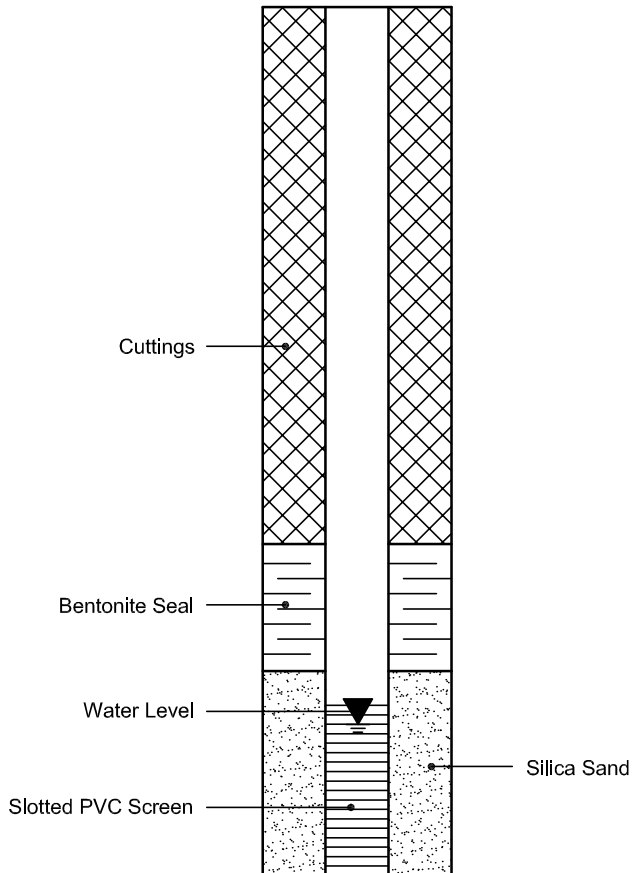

Certificate of Analysis

Report Date: 26-Jun-2024

Client: Paterson Group Consulting Engineers (Ottawa)

Order Date: 20-Jun-2024

Client PO: 60489

Project Description: PG7151

Client ID:	BH2-24 SS4	-	-	-	-
Sample Date:	20-Jun-24 09:00	-	-	-	-
Sample ID:	2425457-01	-	-	-	-
Matrix:	Soil	-	-	-	-
MDL/Units					

Physical Characteristics

% Solids	0.1 % by Wt.	77.4	-	-	-	-
----------	--------------	------	---	---	---	---

General Inorganics

pH	0.05 pH Units	7.17	-	-	-	-
Resistivity	0.1 Ohm.m	69.7	-	-	-	-

Anions

Chloride	10 ug/g	19	-	-	-	-
Sulphate	10 ug/g	39	-	-	-	-

APPENDIX 2


FIGURE 1 – KEY PLAN

DRAWING PG7151-1 – TEST HOLE LOCATION PLAN




FIGURE 1

KEY PLAN

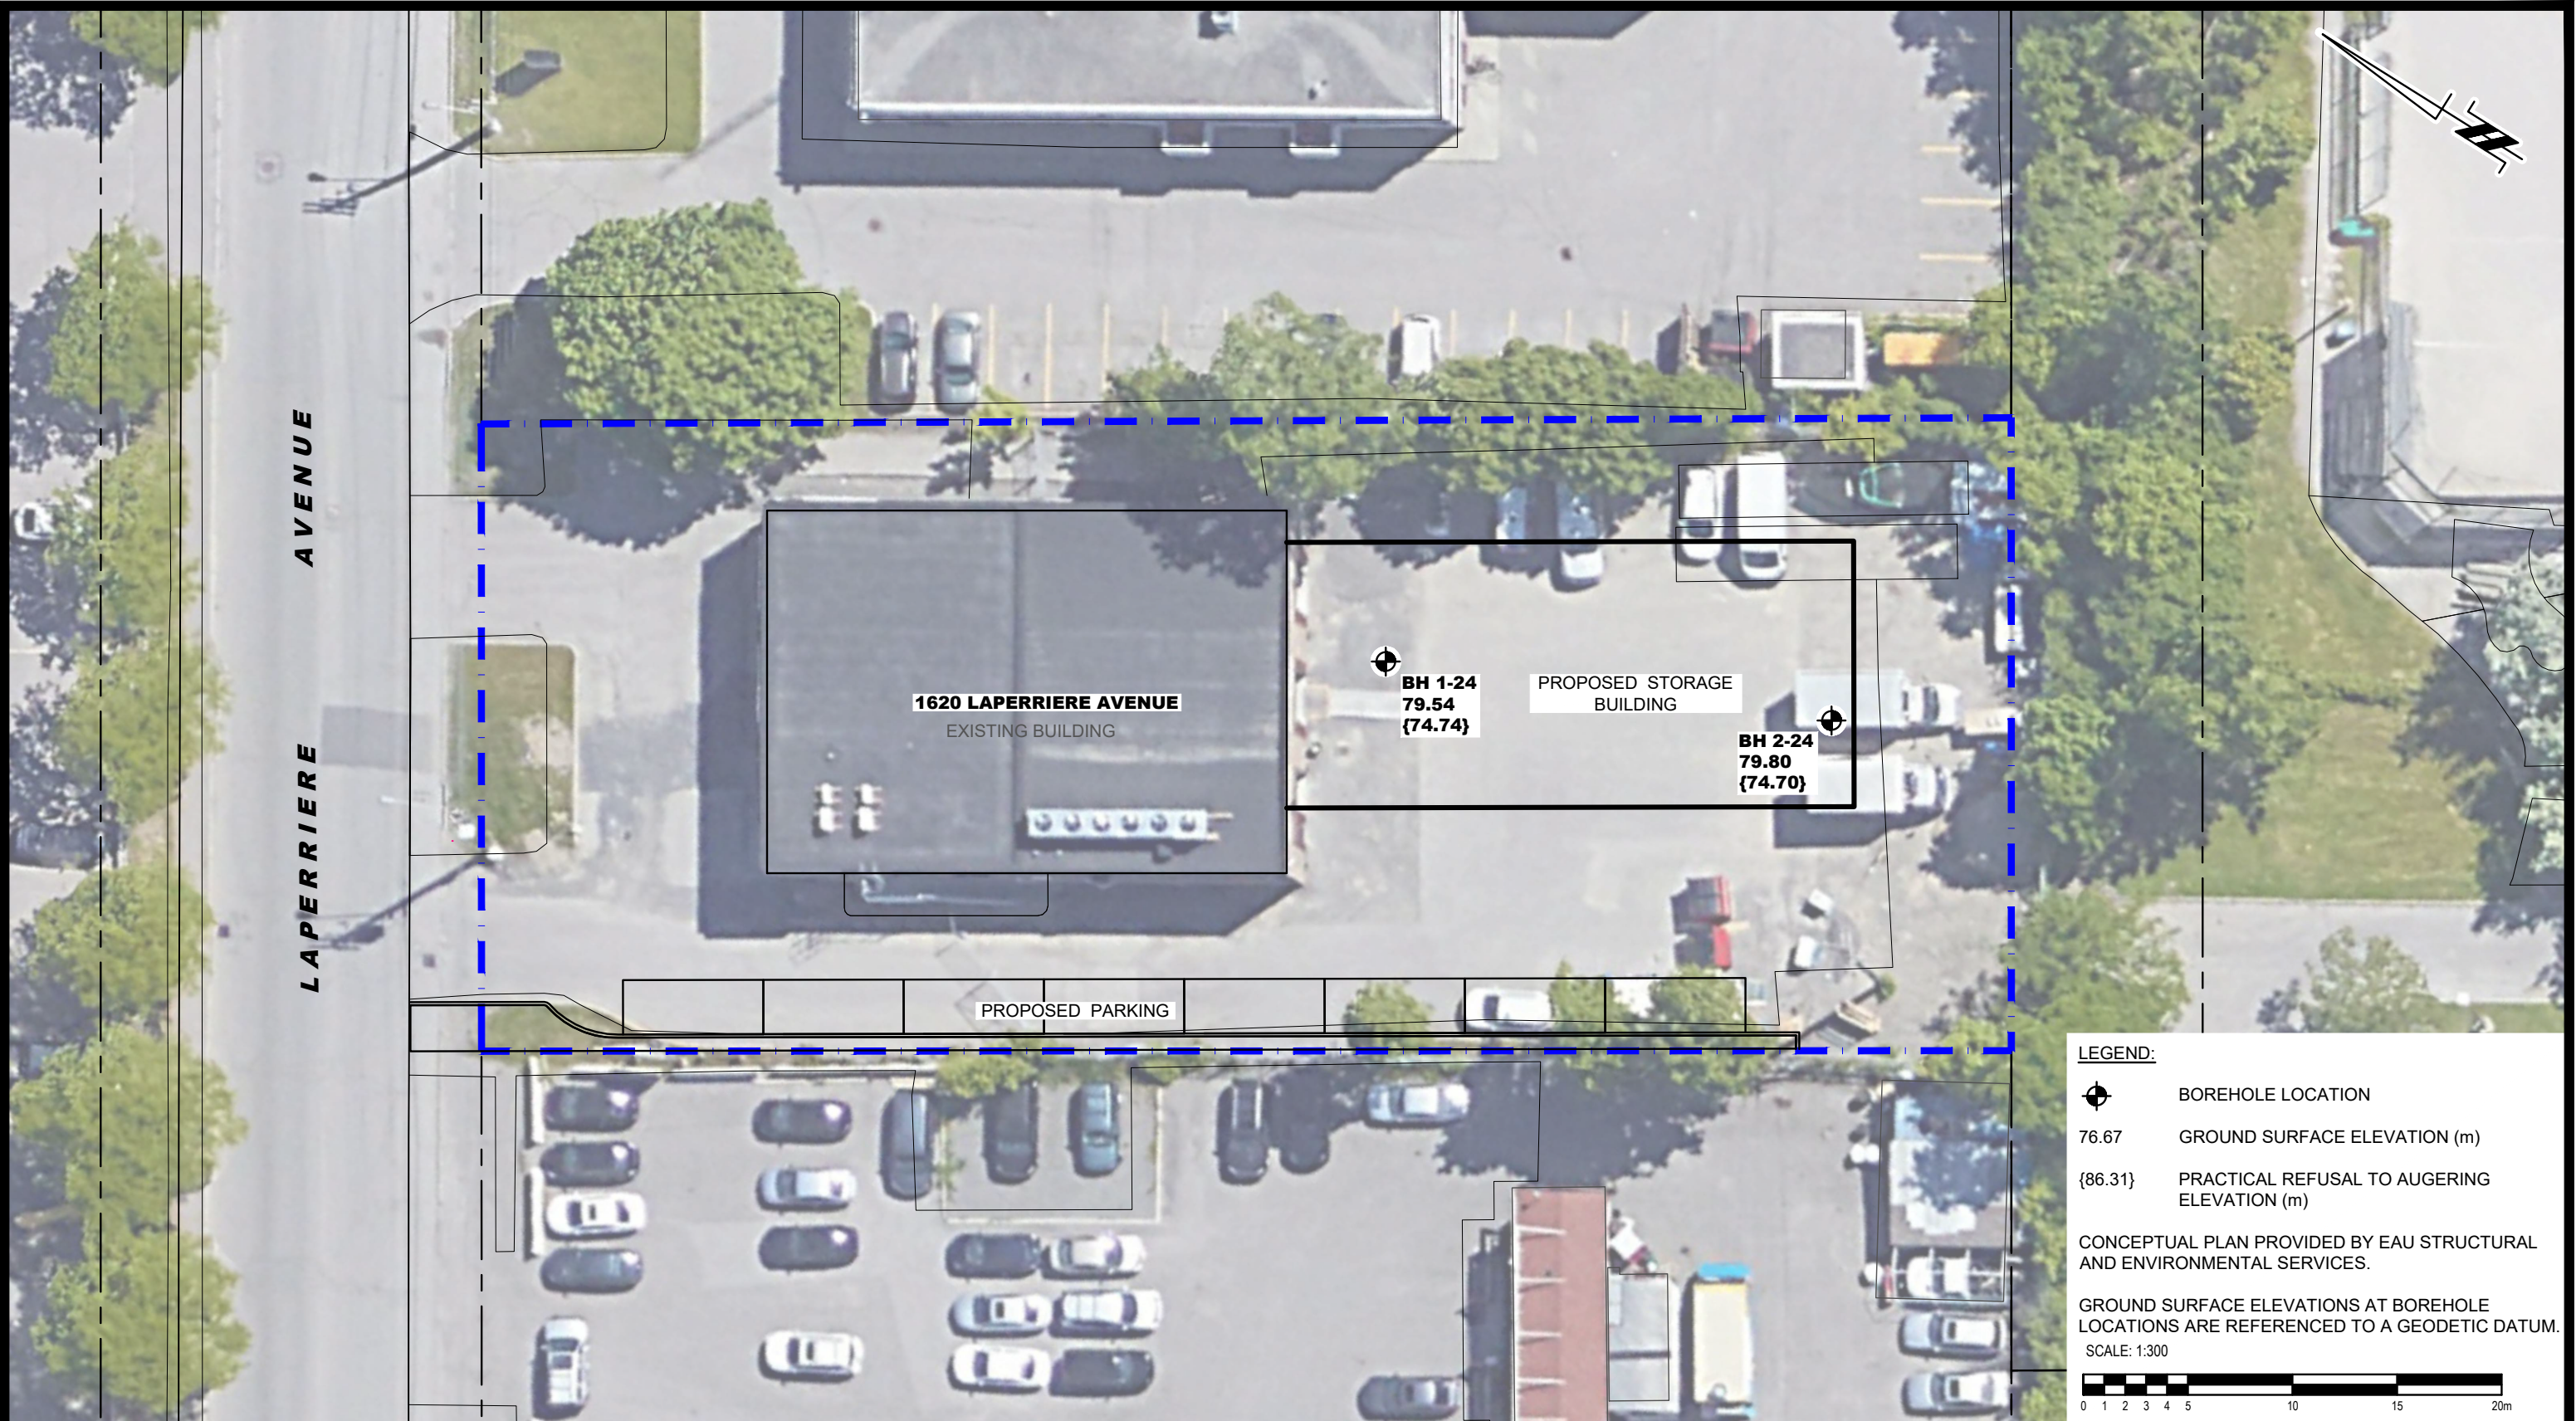


LEGEND:

-  BOREHOLE LOCATION
- 76.67 GROUND SURFACE ELEVATION (m)
- {86.31} PRACTICAL REFUSAL TO AUGERING ELEVATION (m)

CONCEPTUAL PLAN PROVIDED BY EAU STRUCTURAL AND ENVIRONMENTAL SERVICES.

GROUND SURFACE ELEVATIONS AT BOREHOLE LOCATIONS ARE REFERENCED TO A GEODETIC DATUM.
SCALE: 1:300




PATERSON GROUP
9 AURIGA DRIVE
OTTAWA, ON
K2E 7T9
TEL: (613) 226-7381

NO.	REVISIONS	DATE	INITIAL

**SLIPACOFF'S PREMIUM MEATS
GEOTECHNICAL INVESTIGATION
PROPOSED COMMERCIAL BUILDING ADDITION
1620 LAPERRIERE AVENUE**

OTTAWA, ONTARIO

Title: **TEST HOLE LOCATION PLAN**

Scale:	1:300	Date:	06/2024
Drawn by:	GK	Report No.:	PG7151-1
Checked by:	DR	Dwg. No.:	PG7151-1
Approved by:	SD	Revision No.:	