

Report
Project: 143934-6.4.3

BLOCK 5 – WATERIDGE PHASE 4 SERVICING BRIEF



Prepared for ROHIT Communities Inc.
by ARCADIS

IBI GROUP

August 2024

Table of Contents

1	INTRODUCTION	4
1.1	Guidelines and Standards	5
1.2	Pre-Consultation Meeting	5
1.3	Environmental Issues.....	5
1.4	Geotechnical Concerns.....	5
2	WATER DISTRIBUTION	6
2.1	Existing Conditions	6
2.2	Design Criteria	6
2.2.1	Water Demands	6
2.2.2	System Pressures	6
2.2.3	Fire Flow Rate.....	7
2.2.4	Boundary Conditions.....	7
2.3	Proposed Water Plan.....	7
3	WASTEWATER.....	8
3.1	Existing Conditions	8
3.1.1	Verification of Existing Sanitary Sewer Capacity	8
3.2	Proposed Sewers.....	8
3.2.1	Design Flow:	8
3.2.2	Population Density:	8
4	SITE STORMWATER MANAGEMENT	9
4.1	Objective	9
4.2	Existing Conditions	9
4.3	Design Criteria	9
4.4	System Concept.....	10
4.4.1	Dual Drainage Design	10
4.4.2	Proposed Minor System.....	10
4.5	Stormwater Management.....	10
4.5.1	Water Quality Control.....	10
4.5.2	Water Quantity Control.....	11
4.5.3	2 Year Ponding	12
4.5.4	100 year + 20% Stress Test.....	12

5	LOW IMPACT DEVELOPMENT	13
6	SEDIMENT AND EROSION CONTROL PLAN	14
6.1	General	14
6.2	Trench Dewatering.....	14
6.3	Bulkhead Barriers	14
6.4	Seepage Barriers	14
6.5	Surface Structure Filters	14
7	APPROVALS AND PERMIT REQUIREMENTS.....	15
7.1	City of Ottawa	15
7.2	Province of Ontario	15
7.3	Conservation Authority.....	15
7.4	Federal Government.....	15
8	CONCLUSIONS & RECOMMENDATIONS.....	15
8.1	Conclusions	15
8.2	Recommendations	15

List of Appendices

APPENDIX A

143934-001 Site Plan for Block 5
143934-010 Site Servicing Plan
Notes and Legend
City of Ottawa Pre-Consultation Meeting Notes
City of Ottawa Servicing Checklist

APPENDIX B

Water Demand Calculations
Fire flow Calculation
Boundary Conditions

APPENDIX C

Sanitary Sewer Design Sheet
Wateridge Phase 4 Sanitary Design Sheet
Wateridge Phase 4 Sanitary Drainage Area Plan
Wateridge Phase 1A Sanitary Design Sheet
Acknowledgement Letter from CLC

APPENDIX D

143934-500 Storm Sewer Design Sheet
Storm Drainage Area Plan
Correspondence regarding stormwater storage availability on the roof
Wateridge Phase 4 Storm Drainage Area Plan
Modified Rational Method on-site SWM calculations
Minor system release rate (Wateridge Phase 4)
Roof drain ICD type

APPENDIX E

143934-900 Site Erosion and Sediment Control Plan
143934-200 Site Grading Plan
118863-203 Grading Plan (Wateridge Phase 4)


1 INTRODUCTION

In 2011, Canada Lands Company (CLC), bought and took ownership of about 125 ha of the former CFB Rockcliffe air base site. The acquisition of the decommissioned base by CLC offers the opportunity today to reconnect this site back into the urban fabric of the City and create a highly desirable mixed-use community for approximately 10,000 residents. CLC completed a Community Design Plan (CDP) in 2015. In support of the CDP, there were numerous supporting documents including the “Former CFB Rockcliffe Master Servicing Study” (MSS), August 2015, prepared by IBI Group. That report provided a plan for provision of major infrastructure needed to support the proposed development of the Wateridge Village.

CLC plans to develop the Wateridge Village property in several phases. Phases 1A, 1B, 2 and 4 have already been constructed, which cover about 45 ha. The Phase 4 registered 4M plan is provided in **Appendix A**. This phase covers about 5.7 ha and includes 7 blocks. Block 5 is located in the West portion of the Wateridge Village Phase 4. The site plan is included in **Appendix A**. ARCADIS Professional Services Inc. (ARCADIS) has been retained by Rohit Communities Inc. to provide professional engineering services for Block 5. The subject site is approximately 0.42 ha and consists of one 4-storey residential building with a total of 89 units. The site also consists of below grade parking facilities. Additionally, the Block 5 M-plan and Architectural Site Plan have also been provided in **Appendix A**.

Block 5 is bounded by Street No.1 to the North, Hemlock Road to the South, Wateridge Phase 3 to the West and Oshedinaa Street to the East. Its Civic Address is 1076 Hemlock Road. Refer to key plan on **Figure 1.1** for Site location.

Figure 1.1 Site Location

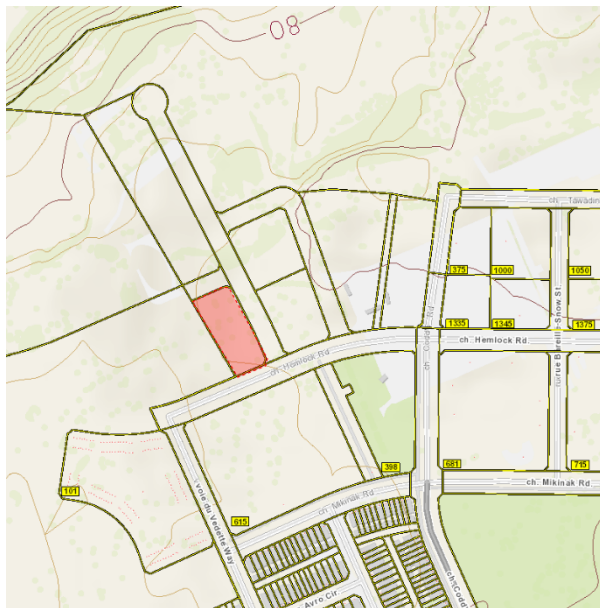

The proposed servicing design conforms to current City of Ottawa and MECP design criteria, and no pre-consultation meetings were requested from the Rideau Valley Conservation Authority (RVCA) or the Ontario Ministry of Environment, Conservation and Parks (MECP).

1.1 Guidelines and Standards

This evaluation takes into consideration the City of Ottawa Sewer Design Guidelines (OSDG) (October 2012), and the February 2014 Technical Bulletin ISDTB-2014-01, the September 2016 Technical Bulletin PIEDTB-2016-01, the June 2018 Technical Bulletin ISTB-2018-04, October 2019 Technical Bulletin 2019-01, and the July Technical Bulletin 2019-02.

It also considers the City of Ottawa Water Distribution Design Guidelines (OWDDG), and the 2010 Technical Bulletin 2010-02, the 2014 Technical Bulletin 2014-02, the 2018 Technical Bulletin 2018-02 and the 2020 Technical Bulletin 2020-02.

All specifications are as per current City of Ottawa standards and specifications, and Province of Ontario (OPSS/D) standards, specifications and drawings.

1.2 Pre-Consultation Meeting

The City of Ottawa hosted a virtual pre-consultation meeting on March 20th, 2023. Notes of the meeting are provided in **Appendix A**. There were no major engineering concerns flagged in this meeting. The City of Ottawa Servicing Study Checklist has also been included in **Appendix A**.

1.3 Environmental Issues

There are no environmental issues related to this site. All environmental concerns were dealt with as part of the CLC's Wateridge Phase 4 subdivision approval.

The Wateridge Phase 4 Development had previously cleared and pre-graded the subject lands. There are no existing watercourses or drainage features associated with this site.

1.4 Geotechnical Concerns

Terrapex was retained to prepare a geotechnical investigation for the proposed mixed-use development for Block 5. The objectives of the investigation were to prepare a report to:

- Determine the subsoil and groundwater conditions at the site by means of test pits and boreholes and;
- To provide geotechnical recommendations pertaining to design of the proposed development including construction considerations.

The geotechnical report CO947.000 was prepared by Terrapex in January 2024. The report contains recommendations which include but are not limited to the following:

- Site grading;
- Foundation Design;
- Pavement Structure;
- Sewer and Watermain Construction;
- Groundwater Control;
- Soil Infiltration
- Grade raises

In general, the grading plan for Block 5 adheres to the grade raise constraints noted above. A copy of the grading plans is included in **Appendix E**.

2 WATER DISTRIBUTION

2.1 Existing Conditions

Phase 4 of Wateridge Village at Rockcliffe will be serviced with potable water from the City of Ottawa's Montreal Road Pressure Zone (Zone MONT). An existing 400 mm diameter watermain on Montreal Road will supply Phase 2B with connections at Codd's Road and Burma Road. As part of the Phase 1 water plan, two 400 mm mains were extended northward along Codd's Road and Wanaki Road. A copy of the existing watermain plan for Phase 4 is included in **Appendix B**.

There is an existing 200mm watermain in Oshedinaa Street to the east of Block 5, an existing 200mm watermain in Street No.1 to the north of the site, and an existing 300mm watermain in Hemlock Road to the south of the site. Refer to the General Plan of Services included in **Appendix A** for the detailed water distribution plan for the site.

2.2 Design Criteria

2.2.1 Water Demands

The proposed development consists of 89 apartment units. In order to calculate water demand rates, the per unit population density and consumption rates are taken from Tables 4.1 and 4.2 of the Ottawa Design Guidelines – Water Distribution were used and are summarized as follows:

- Apartment
 - 1.4 person per 1-bedroom unit
 - 2.1 person per 2-bedroom unit
 - 3.1 person per 3-bedroom unit
- Average Day Demand 280 l/cap/day
- Peak Daily Demand 700 l/cap/day
- Peak Hour Demand 1,540 l/cap/day

A water demand calculation sheet is included in **Appendix B** and the total water demands are summarized as follows:

- Average Day 0.47 l/s
- Maximum Day 1.18 l/s
- Peak Hour 2.59 l/s

2.2.2 System Pressures

The 2010 City of Ottawa Water Distribution Guidelines states that the preferred practice for the design of a new distribution system is to have normal operating pressures range between 345 kPa (50 psi) and 552 kPa (80 psi) under maximum daily flow conditions. Other pressure criteria identified in the guidelines are as follows:

- Minimum Pressure Minimum system pressure under peak hour demand conditions shall not be less than 276 kPa (40 psi).
- Fire Flow During the period of maximum day demand, the system pressure shall not be less than 140 kPa (20 psi) during a fire flow event.

Maximum Pressure Maximum pressure at any point in the distribution system in unoccupied areas shall not exceed 689 kPa (100 psi). In accordance with the Ontario Building/Plumbing Code the maximum pressure should not exceed 552 kPa (80 psi) in occupied areas. Pressure reduction controls may be required for buildings when it is not possible/feasible to maintain the system pressure below 552 kPa.

2.2.3 Fire Flow Rate

The Fire Underwriters Survey was used to determine the fire flow for the site. The calculations result in a fire flow of 6,000 l/min; a copy of the FUS calculation is included in **Appendix B**.

2.2.4 Boundary Conditions

The City of Ottawa has provided a hydraulic boundary condition at the proposed connection to the 200 mm main on Oshedinaa Street. The boundary condition is based on the water demand and fire flow rates provided. A copy of the boundary conditions received November 27, 2023 is included in **Appendix B** and are summarized as follows:

BOUNDARY CONDITIONS	
SCENARIO	HGL (m)
Minimum HGL	143.0
Maximum HGL	143.0
Max Day + Fire Flow (100 l/s)	140.7

2.3 Proposed Water Plan

The proposed development consists of 65 one-bedroom apartment units, 20 two-bedroom apartment units and 4 three-bedroom apartment units, equating to an estimated occupancy of 145.40. One new 150 mm diameter connection from Oshedinaa Street will be installed to service the building. The proposed 150 mm diameter watermain will provide adequate supply to the building to meet demands.

There are 2 municipal fire hydrants within 75m of Building A with a fire flow supply of 5,700 l/min and a combined total of 11,400 l/min. The capacity need for Building A of 6,000 l/min is provided in accordance with Technical Bulletin ISTB-2018-02 date March 21, 2018.

Minimum Pressure (Peak Hour) – The minimum peak hour pressure on the site can be estimated as HGL 143.00m – meter elevation of 88.2m = 54.8m or 537 kPa which exceeds the minimum requirement of 276 kPa. The pressure on the top floor can be estimated as 143.00m – 102.57m = 40.43m or 396.4 KPa which exceeds the minimum requirement of 276 kPa.

Fire Flow – The max day plus fire flow can be estimated as HGL 140.70 – ground floor elevation plus 0.4m 88.85 = 51.85m or 508 KPa which exceeds the minimum of 140kPa.

Max HGL (High Pressure Check) – The high-pressure check can be estimated as HGL 143.00 – (lowest level) 88.20 = 54.80m or 537.3 KPa which is below the maximum of 552 kPa, therefore a pressure reducing valve is not required.

3 WASTEWATER

3.1 Existing Conditions

Canada Lands Company completed a Community Design Plan (CDP) in 2015. To support that plan, a number of technical reports were prepared including the 'Former CFB Rockcliffe Master Servicing Study, August 2015 (MSS), which was subsequently updated in June 2020. That report recommended that the existing combined sewers on the subject site be abandoned in favour of dedicated sanitary and storm sewer systems.

In particular, the MSS recommended that future wastewater flow from Phase 4 be directed to the Codd's Road Shaft. Accordingly, wastewater flows from the subject site will be designed to outlet to that location. The previous Phase 1A design included the new connection to that shaft and the proposed Phase 4 sanitary sewers will connect to the Phase 1A system. A copy of Phase 4 sanitary drainage area plan and design sheet are included in **Appendix C**.

3.1.1 Verification of Existing Sanitary Sewer Capacity

An analysis was completed by Arcadis to determine the ability of the existing sanitary sewer system to accommodate the proposed development. The results of the analysis are included in **Appendix C**. Based on the analysis, the wastewater flows in the Oshedinaa Street sewer from MH191A to MH190A is 13.10 L/s, with a spare capacity of 30.88 L/s and from MH190A to MH180A is 14.64 L/s, with a spare capacity of 110.96 L/s. The sewer downstream of the Oshedinaa Street sewer, along Hemlock Road, from MH180A to MH179A has a wastewater flow of 17.62 L/s, with a spare capacity of 37.63 L/s. The Codd's Road Shaft has a wastewater flow of 125.93 L/s, with a spare capacity of 74.44 L/s. As such, it is Arcadis's opinion that the existing sanitary sewers in Oshedinaa Street and Hemlock Road can accommodate the sanitary flow from the proposed development.

A letter from CLC acknowledging the increased population from the MSS is included in **Appendix C**.

3.2 Proposed Sewers

All on-site sewers have been designed to City of Ottawa and MECP design criteria which include but are not limited to the below listed criteria. The detailed sanitary sewer design sheets which are included in **Appendix C** illustrate the population densities and sewers which provide the necessary outlets. The design wastewater criteria for this analysis:

3.2.1 Design Flow:

Average Residential Flow	-	280 l/cap/day
Peak Residential Factor	-	Modified Harmon Formula
Infiltration Allowance	-	0.33 l/sec/Ha
Minimum Pipe Size	-	200mm diameter

3.2.2 Population Density:

Apartment Units	-	1.4 person per 1-bedroom unit
	-	2.1 person per 2-bedroom unit
	-	3.1 person per 3-bedroom unit

4 SITE STORMWATER MANAGEMENT

4.1 Objective

The purpose of this evaluation is to prepare the dual drainage design, including the minor and major system, for the Block 5 development. The design includes the assignment of inlet control device, roof storage and maximum depth of surface ponding. The evaluation takes into consideration the City of Ottawa Sewer Design Guidelines (OSDG) (October 2012), the February 2014 Technical Bulletin ISDTB-2014-01, the September 2016 Technical Bulletin PIEDTB-2016-01 and the June 2018 Technical Bulletin ISTB-2018-04.

4.2 Existing Conditions

CLC completed an update to the servicing report, "Former CFB Rockcliffe Master Servicing Study" in 2020. That report recommended a preferred Stormwater Management Plan for the Wateridge Village at Rockcliffe site. The report recommended construction of two stormwater ponds and related appurtenances to service the CLC property; the Western Stormwater Management Facility and the Eastern Stormwater Management Facility. The Eastern Pond is proposed to provide management of flows from most of Phase 1 and 2 of the CLC property, including the subject site. The Eastern Pond was constructed and put into service in 2017.

The MSS Report also recommends a series of local and trunk storm sewers to collect runoff from Phases 1, 2 and 4 and route those flows to the Eastern Facility. The Phase 1 design followed the recommendations of the MSS report, including construction of the large diameter sewers, which outlet to the Eastern Stormwater Management Facility; the Eastern Stormwater Management Facility and outlet to the Ottawa River. The Phase 4 storm sewers connect to the downstream Phase 1 sewer system. A copy of the storm drainage area plan and the storm sewer design sheet for Phase 4 are included in **Appendix D**.

Note that a temporary drainage CB is shown on the Wateridge Village Phase 4 storm drainage plan inside Block 5. This CB is not currently existing and is therefore not shown on the Removals Plan.

4.3 Design Criteria

The stormwater system for the subdivision was designed following the principles of dual drainage, making accommodations for both major and minor flow.

Some of the key criteria include the following:

- Design Storm 1:5-year return (Phase 4 Design Brief)
- Rational Method Sewer Sizing
- Initial Time of Concentration 10 minutes
- Runoff Coefficients
 - Landscaped Areas C = 0.25
 - Landscaped Area with Pathway/Roof C = 0.50 - 0.65
 - Building and Roof Area C = 0.90
 - Parking Area and Driveway C = 0.90
- Pipe Velocities 0.80 m/s to 3.0 m/s
- Minimum Pipe Size 250 mm diameter (200 mm CB Leads)

4.4 System Concept

According to the Wateridge Phase 4 report prepared by IBI Group dated March 2023, the development of the adjacent downstream properties included the expected stormwater servicing needs of the subject property. The existing storm sewers constructed adjacent to the site were oversized to provide the needed capacity for minor storm runoff from the subject site. Minor storm runoff from the subject site is proposed to connect to the existing 3000 mmØ sewer in Oshedinaa Street.

4.4.1 Dual Drainage Design

The dual drainage system proposed for the subject site will accommodate both major and minor stormwater runoff. Minor flow from the subject site will be conveyed through the storm sewer network and discharge into the existing 3000 mmØ sewer in Oshedinaa Street.

The balance of the surface flow not captured by the minor system will be conveyed via the major system. Where possible, storage will be provided in surface sags or low points within the roadway. Once the maximum storage is utilized, the excess flow will cascade to the next downstream street sag. Major flow up to 100-year storm event will be restricted and detained on-site. Emergency overflow will be directed towards the North of the site at Street. No. 1.

Note that a foundation drainage system/weeping tiles may be recommended for this site by the geotechnical engineer. The design of any foundation drainage system is to be done under direction of the geotechnical engineer and is separate to civil works. This may not be finalized until detailed design of the building takes place. Any foundation drainage system is to be connected to the storm service downstream of any flow control devices.

4.4.2 Proposed Minor System

Using the criteria identified in Section 4.3, the proposed on-site storm sewers were sized accordingly. A detailed storm sewer design sheet and the associated storm sewer drainage area plan are included in **Appendix D**. The general plan of services, depicting all on-site storm sewers can be found in **Appendix A**.

4.5 Stormwater Management

Wateridge Phase 4 is part of the larger development referred to as the Former CFB Rockcliffe. The stormwater management strategy was outlined in the “Former CFB Rockcliffe Master Servicing Study” (MSS) (IBI Group, August 2020). Phase 4 is located north of Hemlock Road between Wateridge Phase 2B and Wateridge Phase 3&5 (refer to Figure 1.1).

The subject site is part of the drainage area that ultimately discharges to the Eastern SWM Facility. The trunk storm sewer to the pond and the pond itself were constructed as part of Wateridge Phase 1A.

4.5.1 Water Quality Control

The design takes into consideration the August 2020 MSS, the “Design Brief Wateridge Village at Rockcliffe Phase 1B” (IBI Group, June 2017), the “Design Brief Wateridge Village at Rockcliffe Phase 1A” (IBI Group, April 2016), the City of Ottawa Sewer Design Guidelines (OSDG) (October 2012), and the February 2014 Technical Bulletin ISDTB-2014-01.

Any runoff from the site, as with all future developments in Wateridge Village at Rockcliffe, will have end of pipe quality treatment. Any impacts to receiving watercourses will therefore be mitigated. There are no municipal drains in the vicinity of the subject development and there are no drainage catchment diversions proposed by the current development.

4.5.2 Water Quantity Control

The subject site will be limited to a maximum minor system release rate of 120 L/s according to Wateridge Phase 4 Design Brief dated March 2023. In the Phase 4 subdivision stormwater management system design, the development blocks are subjected to minor system inflow restriction with major flow cascading to a street segment. The restricted rates were provided in Table 5-3, taken from Wateridge Phase 4 – Design Brief, dated March 2023 included in **Appendix D**. This will be achieved through rooftop storage.

Surface flows in excess of the site’s allowable release rate will be stored on the building rooftop and gradually released into the minor system to respect the site’s allowable release rate. Average rooftop retention depth located within the building area will be limited to a maximum of 50mm during a 1:100-year event as show on the storm drainage area plan located in **Appendix D** and grading plans located in **Appendix E**. Correspondence from the architect confirms that, at the detailed design stage, the roof will accommodate this volume (see memo in **Appendix D**).

All stormwater from the roof will be directed to the infiltration gallery. If infiltration is not able to keep up with the flow, the gallery will outlet through the overflow pipe to CB1, which outlets through the underground parking garage to the storm sewer in Oshedinaa Street.

Surface flows within the CB1 and Area Drain drainage areas will not require on-site storage. These structures will collect stormwater and outlet to the building’s storm service unrestricted as shown on the storm drainage area plan located in **Appendix D** and grading plans located in **Appendix E**. The maximum ponding outline at CB1 and Area Drain drainage area, should either structure become blocked, is well outside any part of the building envelope and overland flow routes allow for emergency outletting offsite.

Along the perimeter of the site, the opportunity to capture and store runoff is limited due to grading constraints and building geometry. These areas will discharge uncontrolled to Oshedinaa Street, Street No.1 and Hemlock Road. These areas are located at the perimeter of the site where it is necessary to tie into public boulevards and adjacent properties or in areas where ponding stormwater is undesirable. The drainage area of the ramp leading to the underground parkade will also discharge as uncontrolled to the trench drain at the bottom of the ramp and to the storm service outlet onto Oshedinaa Street through internal plumbing.

No stormwater is expected to flow to the west onto the adjacent lot. All overland flow routes and uncontrolled runoff is directed to city ROWs. A letter from CLC acknowledging the terracing onto the adjacent lot to the west (Block 13) is included in **Appendix C**. There are no interim grading concerns with ponding on Block 13 as this property flows away from Block 5.

Based on the proposed site plan, the total uncontrolled area has been calculated to be 0.18 Ha. For the detailed storm drainage area plan for the site, refer to Drawing 500 in **Appendix D**.

Based on a 1:100-year event, the flow from the 0.18 Ha uncontrolled area can be determined as:

UNC1 + UNC2

$Q_{\text{uncontrolled}}$	= 2.78 x C x $i_{100\text{yr}}$ x A where:
C	= Average runoff coefficient = 0.45 x 1.25 = 0.5625 (100 year C-value)
$i_{100\text{yr}}$	= Intensity of 100-year storm event (mm/hr) = 1735.688 x (T _c + 6.014) ^{0.820} = 178.56 mm/hr; where T _c = 10 minutes
A	= Uncontrolled Area = 0.0782 Ha

Therefore, the uncontrolled release rate for this area can be determined as:

$Q_{\text{uncontrolled}}$	= 2.78 x C x $i_{100\text{yr}}$ x A
	= 2.78 x 0.5625 x 178.56 x 0.0782
	= 21.84 L/s

The calculations were repeated for each unrestricted drainage area to get a total uncontrolled flow rate of 81.82 L/s (see detailed calculations in **Appendix D**).

The Maximum allowable release rate from the site can be determined by subtracting the Uncontrolled release rate from the minor system restricted flow rate.

$$Q_{\max} = Q_{\text{restricted}} - Q_{\text{uncontrolled}}$$

$$Q_{\max} = 120.00 \text{ L/s} - 84.80 \text{ L/s}$$

$$Q_{\max} = 35.20 \text{ L/s}$$

The rooftop is the only drainage area that will be controlled. The total flow from the roof will be limited to 30 L/s and controlled through a number of roof drains. The location and number of roof drains is to be determined at the detailed design of the building. Included in the **Appendix D** is an example of a type of roof drain control device that can be used.

DRAINAGE AREA	ICD RESTRICTED FLOW (L/s)	100 YEAR STORAGE REQUIRED (m ³)	ROOF STORAGE PROVIDED (m ³)
BLDA	30.00	38.43	68.50
TOTAL	30.00	38.43	68.50

4.5.3 5 Year Ponding

As stated in the Design Brief for Wateridge Phase 4, a review of the 5-year ponding for Block 5 has been completed using the modified rational method. No ponding is expected outside the rooftop drainage area as it is the only area with a restricted flow rate.

DRAINAGE AREA	ICD RESTRICTED FLOW (L/s)	5 YEAR STORAGE REQUIRED (m ³)	ROOF STORAGE PROVIDED (m ³)
BLDA	30.00	11.12	68.50
TOTAL	30.00	11.12	68.50

4.5.4 100 year + 20% Stress Test

A cursory review of the 100yr event + 20% has been performed using the modified rational method. The Peak flow from each area during a 100-year event has been increased by 20%. The calculations have been included in **Appendix D**.

A summary of the storage volumes, and overflow balances is provided below.

DRAINAGE AREA	ICD RESTRICTED FLOW (L/s)	100yr20 STORAGE REQUIRED (m ³)	SURFACE STORAGE PROVIDED (m ³)	100yr20 OVERFLOW (m ³)
BLDA	30.00	51.51	68.50	0.00
TOTAL	30.00	51.51	68.50	0.00

5 LOW IMPACT DEVELOPMENT

Aquafor Beech was retained by Arcadis on behalf of ROHIT Communities Inc. to complete the design of an infiltration-based Stormwater Management (SWM) facility in support of the development at 1076 Hemlock Road, Ottawa.

A memo was prepared, titled “Block 5 Stormwater Management: Infiltration Facility Development Memo”, dated February 2024 by Aquafor Beech, which is included in **Appendix D** of this report. Arcadis has incorporated this infiltration system into the site servicing design.

6 SEDIMENT AND EROSION CONTROL PLAN

6.1 General

During construction, existing stream and conveyance systems can be exposed to significant sediment loadings. Although construction is only a temporary situation, it is proposed to introduce a number of mitigative construction techniques to reduce unnecessary construction sediment loadings. These will include:

- groundwater in trench will be pumped into a filter mechanism prior to release to the environment;
- bulkhead barriers will be installed at the nearest downstream manhole in each sewer which connects to an existing downstream sewer;
- seepage barriers will be constructed in any temporary drainage ditches; and
- silt sacks will remain on open surface structure such as manholes and catchbasins until these structures are commissioned and put into use.

6.2 Trench Dewatering

During construction of municipal services, any trench dewatering using pumps will be discharged into a filter trap made up of geotextile filters and straw bales similar in design to the OPSD 219.240 Dewatering Trap. These will be constructed in a bowl shape with the fabric forming the bottom and the straw bales forming the sides. Any pumped groundwater will be filtered prior to release to the existing surface runoff. The contractor will inspect and maintain the filters as needed including sediment removal and disposal and material replacement as needed.

6.3 Bulkhead Barriers

At the first manhole constructed immediately upstream of an existing sewer, a ½ diameter bulkhead will be constructed over the lower half of the outletting sewer. This bulkhead will trap any sediment carrying flows, thus preventing any construction –related contamination of existing sewers. The bulkheads will be inspected and maintained including periodic sediment removal as needed.

6.4 Seepage Barriers

These barriers will consist of both the Light Duty Straw Bale Barrier as per OPSD 219.100 or the Light Duty Silt Fence Barrier as per OPSD 219.110 and will be installed in accordance with the sediment and erosion control drawing. The barriers are typically made of layers of straw bales or geotextile fabric staked in place. All seepage barriers will be inspected and maintained as needed.

6.5 Surface Structure Filters

All catchbasins, and to a lesser degree manholes, convey surface water to sewers. However, until the surrounding surface has been completed these structures will be covered to prevent sediment from entering the minor storm sewer system. Until rear yards are sodded or until streets are asphalted and curbed, all catchbasins and manholes will be equipped with geotextile filter socks. These will stay in place and be maintained during construction and build until it is appropriate to remove them.

7 APPROVALS AND PERMIT REQUIREMENTS

7.1 City of Ottawa

The City of Ottawa reviews all development documents including this report and working drawings. Upon completion, the City will approve the local watermains, submit the sewer ECA application to the province, and eventually issue a Commence Work Notification.

7.2 Province of Ontario

The Ministry of Environment, Conservation and Parks (MECP) Environmental Compliance Approval is not required for the subject development. A Permit To Take Water for the subject site has been provided by the MECP. The permit, number 0565-A5AMP8, expires on December 31, 2025.

7.3 Conservation Authority

Since no watercourses are impacted by the proposed development, no permits will be required from the local Conservation Authority (Rideau Valley Conservation Authority).

7.4 Federal Government

There are no federal permits, authorizations or approvals needed for this development.

8 CONCLUSIONS & RECOMMENDATIONS

8.1 Conclusions

This report and the accompanying working drawings clearly indicate that the proposed development meets the requirements of the stakeholder regulators, including the City of Ottawa, provincial MECP and RVCA. The proposed development is also in general conformance with the Master Servicing Study completed by IBI dated June 2020.

Downstream sanitary and storm sewers were designed with the proposed development area included. There is a reliable water supply available adjacent to the proposed development.

8.2 Recommendations

It is recommended that the regulators review this submission with an aim of providing the requisite approvals to permit the owners to proceed to the construction stage of the subject site.


Report prepared by:

ARCADIS



Samantha E. Labadie
Civil Engineer

APPENDIX A

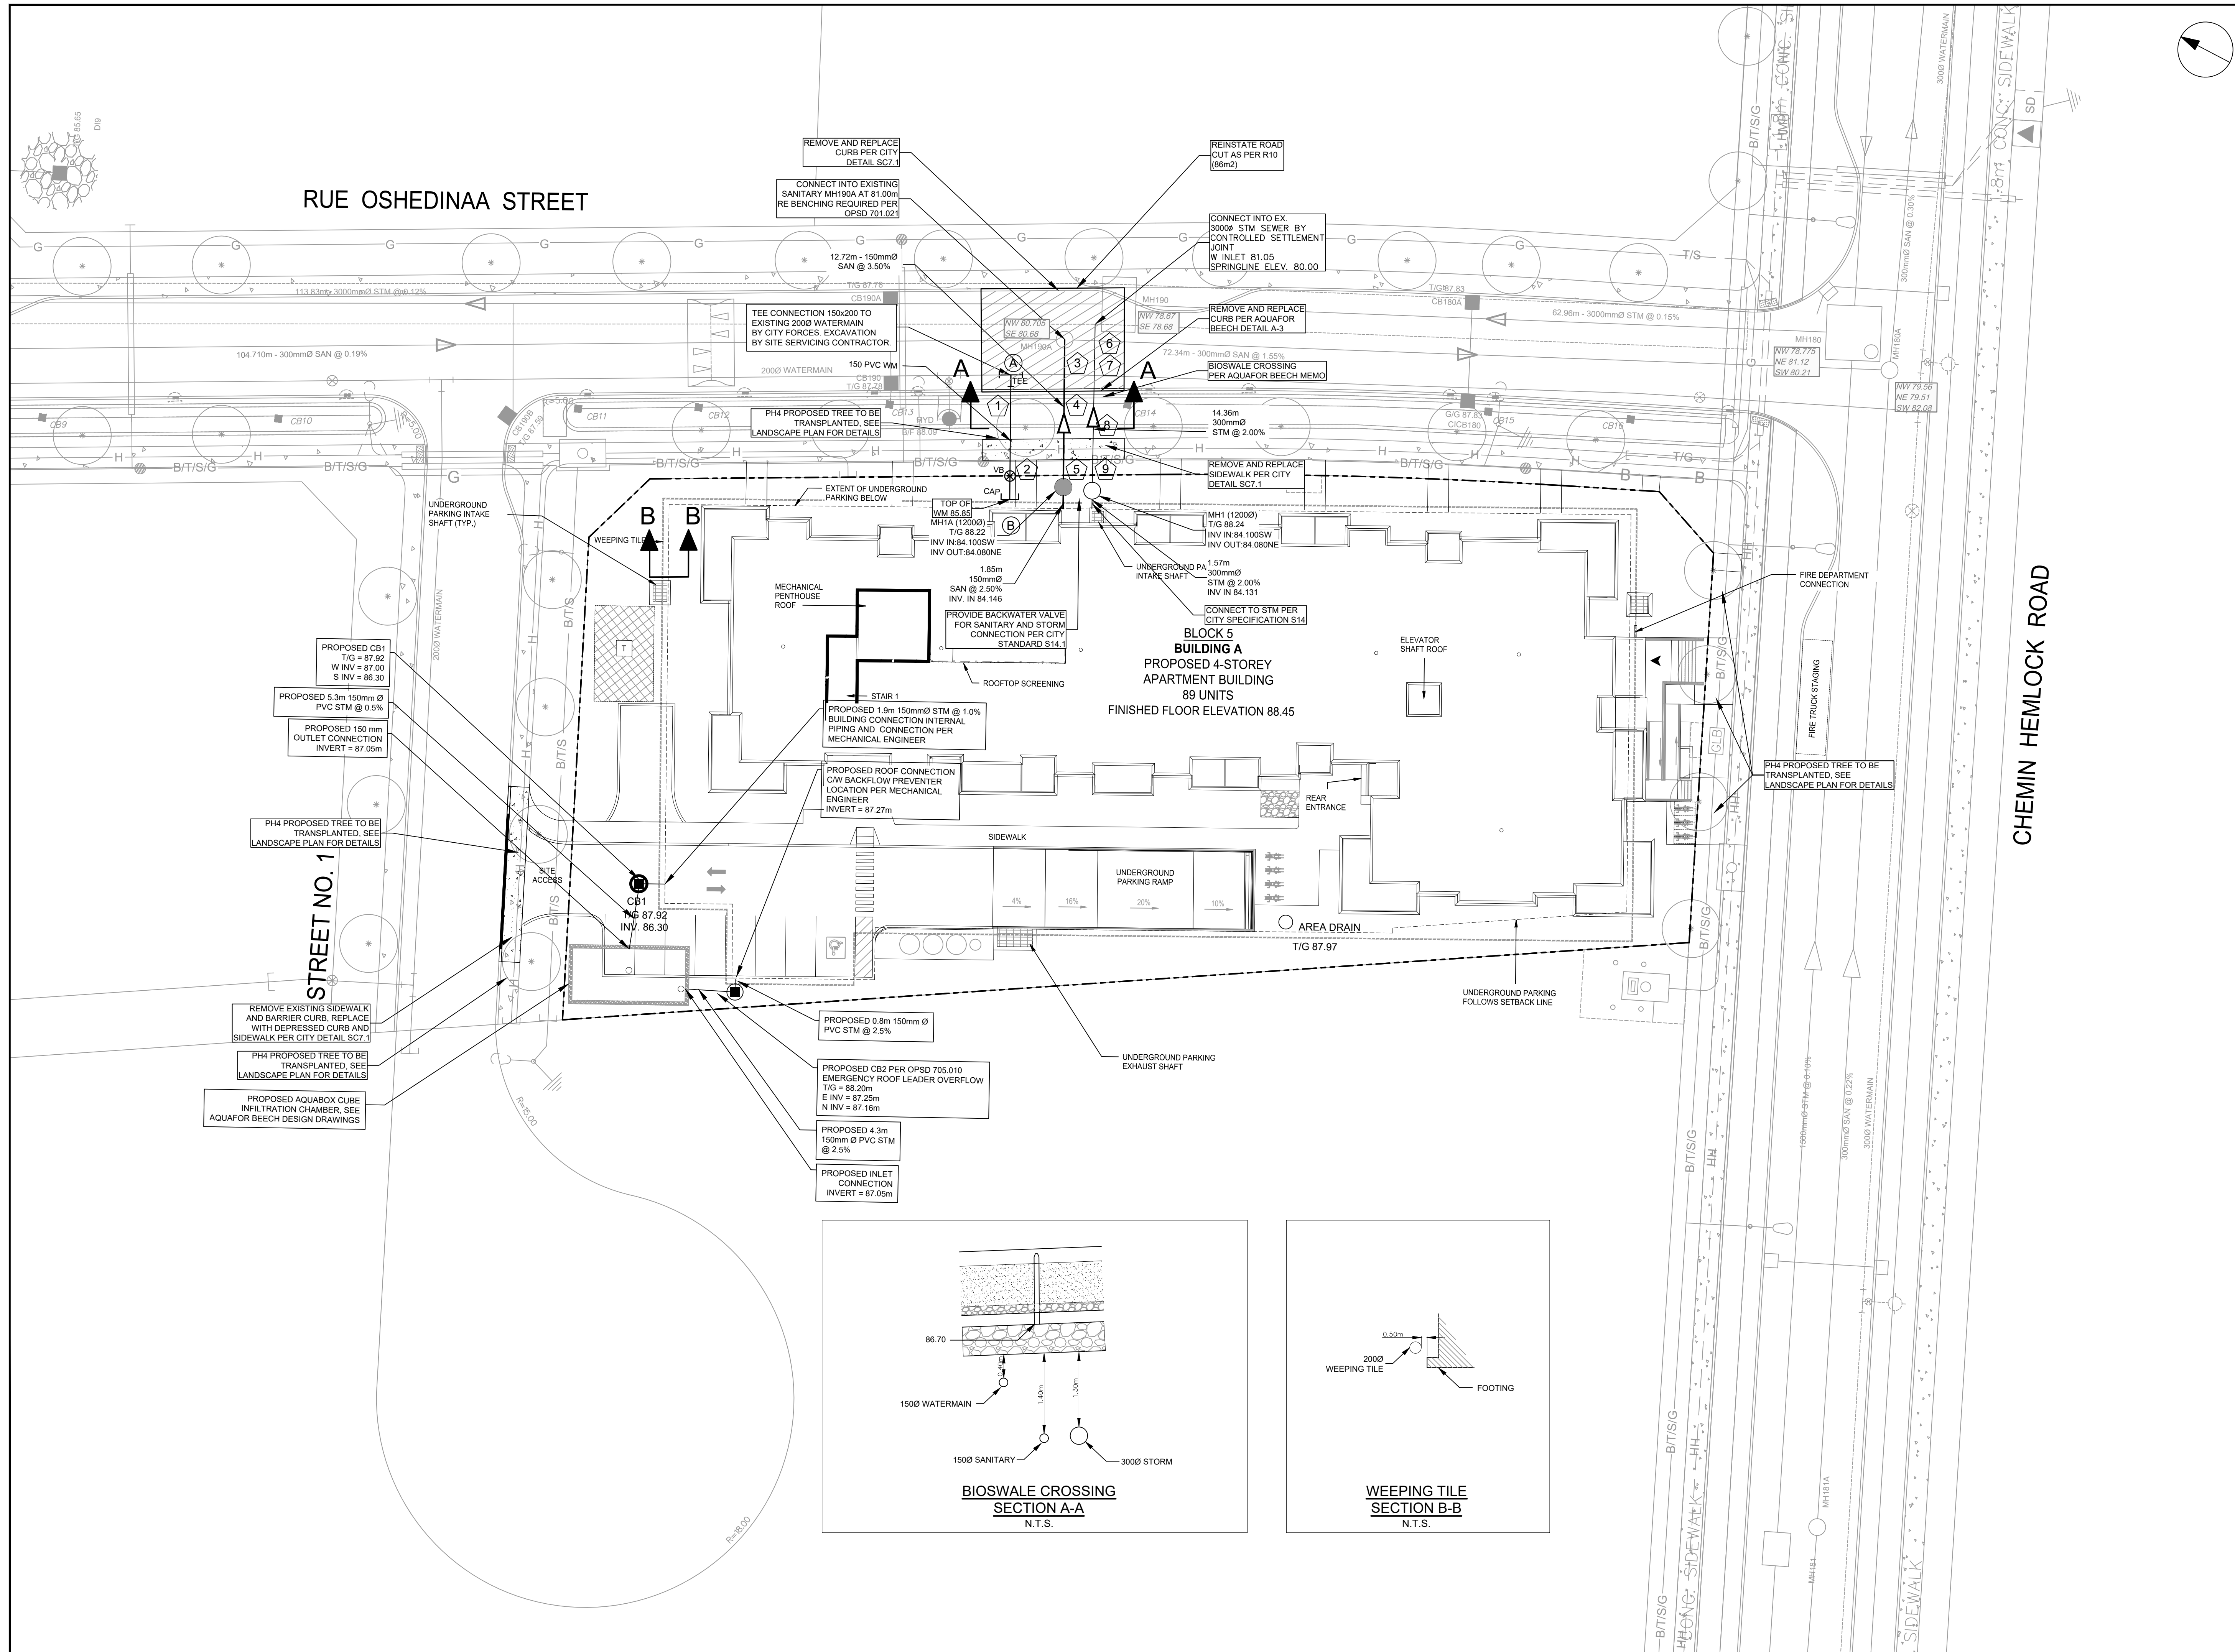

CLIENT
ROHIT GROUP

15 FITZGERALD ROAD, NEPEAN, ON

COPYRIGHT
This drawing has been prepared solely for the intended use, thus any reproduction or distribution for any purpose other than authorized by Arcadis is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and Arcadis shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to Arcadis for general conformance before proceeding with fabrication.

Arcadis Professional Services (Canada) Inc.
Formerly BSI Group Professional Services (Canada) Inc.

ISSUES	No.	DESCRIPTION	DATE
	1	ISSUED FOR CLIENT REVIEW	2023-11-22
	2	SUBMISSION NO 1 FOR CITY REVIEW	2023-12-08
	3	SUBMISSION NO 2 FOR CITY REVIEW	2024-03-04
	4	SUBMISSION NO 3 FOR CITY REVIEW	2024-05-01
	5	BIOSWALE CROSSING NOTE ADDED	2024-07-08
	6	NEW SITE PLAN	2024-08-07
	7		
	8		

KEY PLAN

SCALE
0 2.5 5 7.5 12.5m

SEAL

PRIME CONSULTANT
ARCADIS
333 Preston Street - Suite 500
Ottawa ON K1S 5N4 Canada
tel 613 225 1311
www.arcadis.com

PROJECT
WATERIDGE VILLAGE AT ROCKCLIFFE
PHASE 4 - BLOCK 5

PROJECT NO:
143934

DRAWN BY:
M.M.

CHECKED BY:
D.C.

PROJECT MGR:
D.C.

APPROVED BY:
A.C.


SHEET TITLE
GENERAL PLAN OF SERVICES

SHEET NUMBER
C-001


ISSUE
6

File Location: J:\143934_Block_5_Phase_4\7.0_Production\7.03_Design\04_Civil\Sheet\001_GENERAL PLAN OF SERVICES.dwg
 Last Saved: August 7, 2024, by M.Mline
 Plotted: Monday, August 12, 2024 4:17:17 PM by Sarantina Labadie
 D07-XX-XX-XXXX
 XXXXX

GENERAL LEGEND

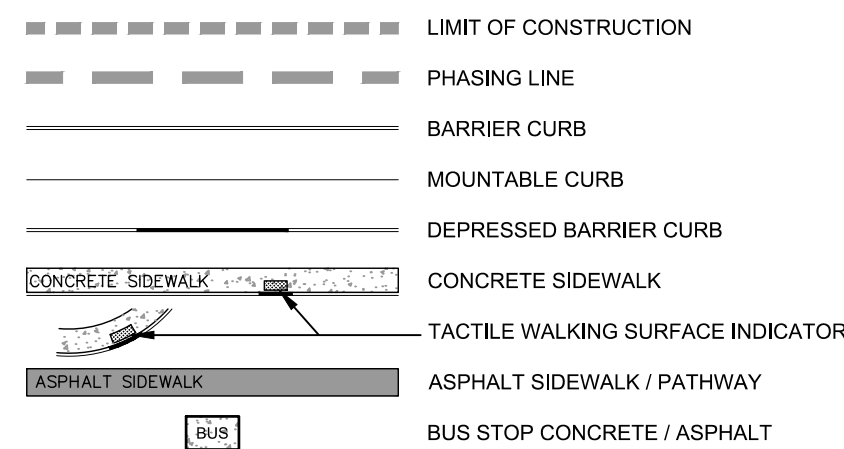

SERVICING LEGEND

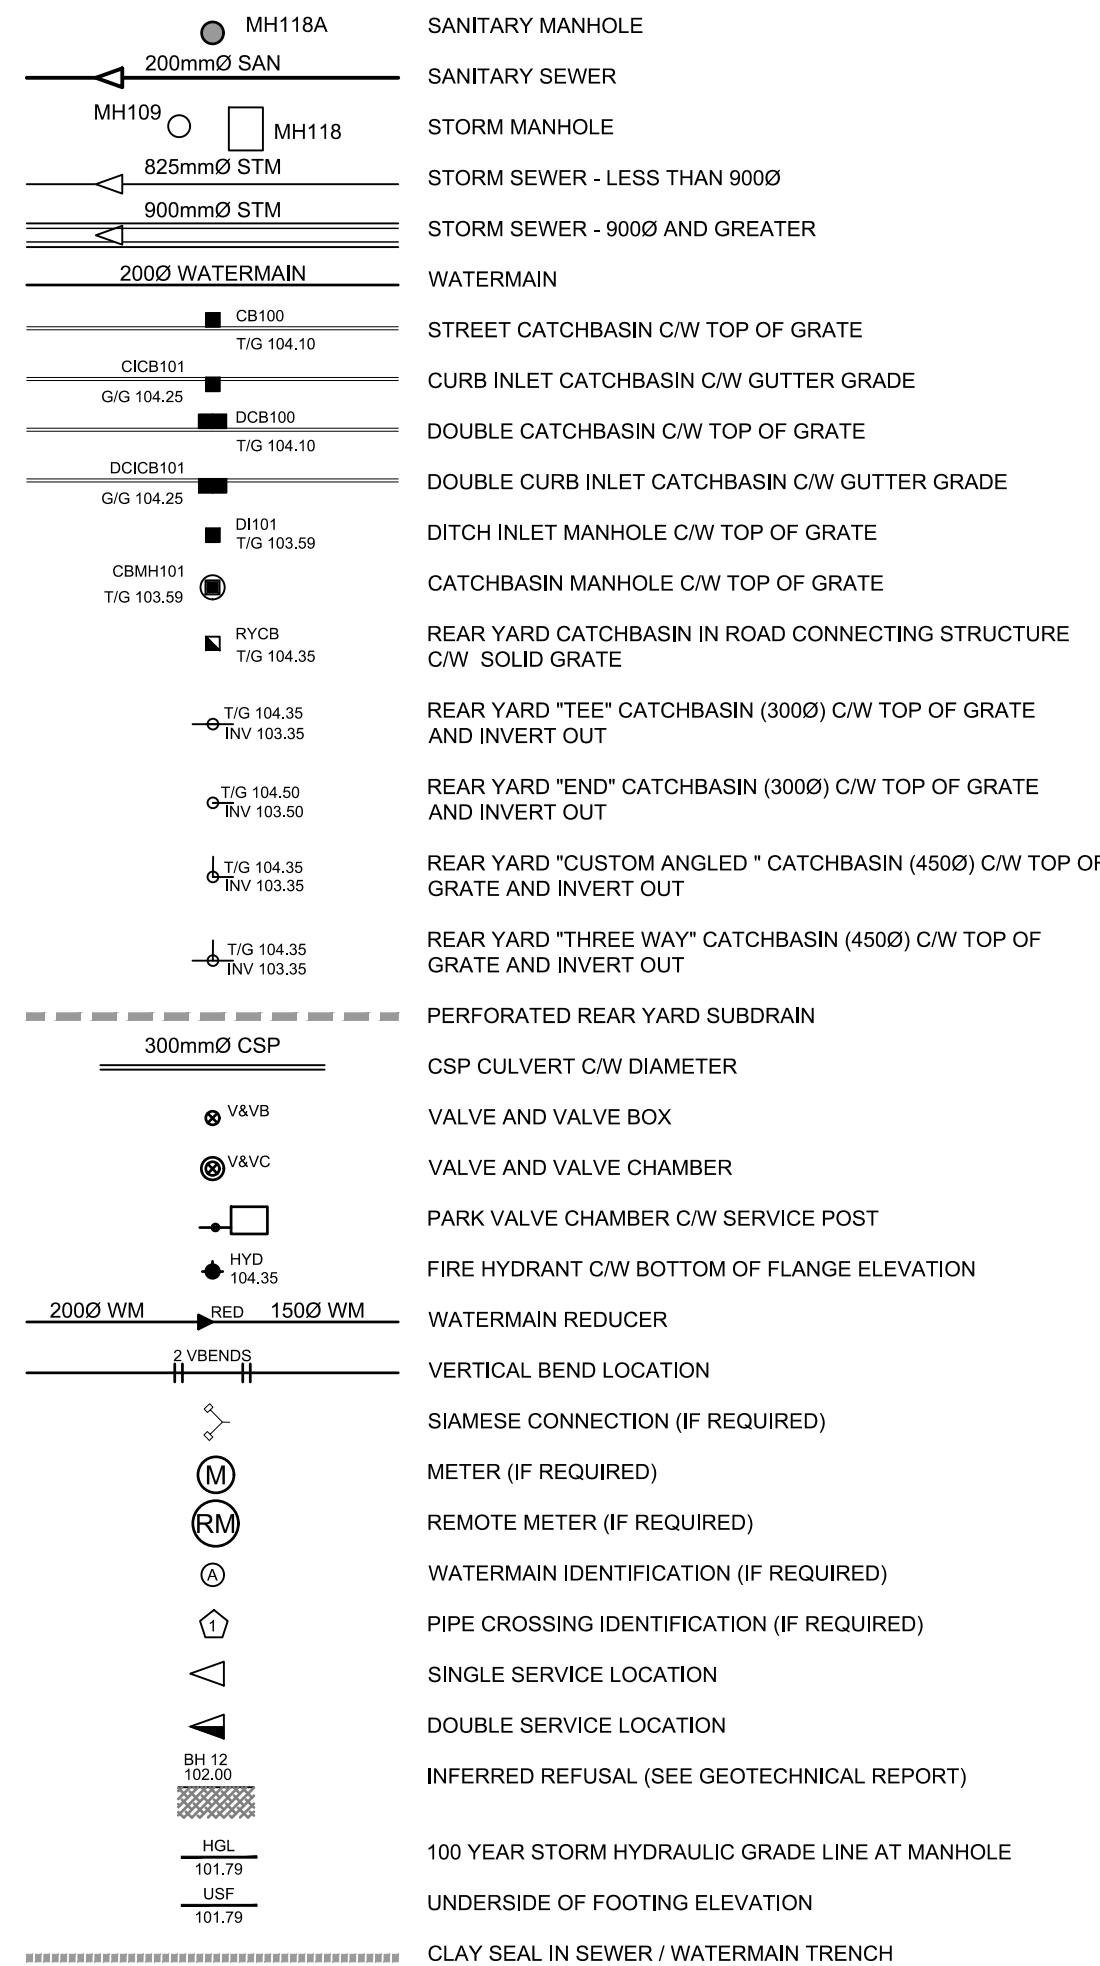

UTILITY NOTES :

- ALL MATERIALS AND CONSTRUCTION IS TO BE IN ACCORDANCE WITH THE CURRENT CITY OF OTTAWA STANDARD DRAWINGS & SPECIFICATIONS OR OPSD/OPSS IF CITY DRAWINGS AND SPECIFICATIONS DO NOT APPLY.
- THE POSITION OF UNDERGROUND AND ABOVEGROUND SERVICE, UTILITIES AND STRUCTURES ARE NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH SERVICE, UTILITIES AND STRUCTURES IS NOT GUARANTEED. THE CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING SERVICES AND UTILITIES PRIOR TO CONSTRUCTION.
- THE CONTRACTOR SHALL REPORT ALL CONFLICTS, DISCOVERIES OF ERROR AND DISCREPANCIES TO THE ENGINEER.
- THE CONTRACTOR SHALL BE RESPONSIBLE TO PROTECT AND ASSUME RESPONSIBILITY FOR ALL UTILITIES WHETHER OR NOT SHOWN ON THESE DRAWINGS.
- THESE DRAWINGS ARE NOT TO BE SCALED OR USED FOR LAYOUT PURPOSES.
- THE COMPOSITE UTILITY PLAN HAS BEEN REVIEWED BY ARCADIS FOR CONFORMITY TO THE DESIGN CONCEPT FOR THE DEVELOPMENT AND FOR GENERAL ARRANGEMENT ONLY AND AS SUCH SHALL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR ERRORS OR OMISSIONS IN EITHER LAYOUT OR WORKMANSHIP.
- THIS DRAWING IS A COMPILATION OF OTHER UTILITY DESIGNS AND DOES NOT INDICATE IN ANY WAY THAT THE PARTY SIGNING THIS DRAWING HAS DESIGNED OR APPROVED THE RESPECTIVE UTILITY PLANTS INDICATED ON THIS DRAWING. THE DRAWING WAS PREPARED TO BE USED AS REFERENCE ONLY AS PER REQUIREMENTS OF THE CITY OF OTTAWA. IT IS THE CONTRACTORS RESPONSIBILITY TO ENSURE IT HAS REVIEWED THE CURRENT AND EXISTING DESIGNS BY HYDRO, STREET LIGHTING, BELL, CANADA POST, O.C. TRANSPQ, CABLE TV AND ANY OTHER PARTIES INCLUDED BUT NOT MENTIONED AND COMPLETE THE INSTALLATION IN ACCORDANCE WITH THE REQUIREMENTS OF THE STAKEHOLDER UTILITY DESIGNS.
- CONTRACTOR TO ADVISE ENGINEER IN WRITING OF ANY DISCREPANCIES IN THE HYDRO, BELL, ROGERS, ENBRIDGE, AND STREETLIGHT DRAWINGS, AND THE CUP AHEAD OF INSTALLATION.
- HYDRO INSPECTOR IS TO BE NOTIFIED AND PRESENT AHEAD OF HYDRO INSTALLATION
- BELL AND ROGERS VAULT EASEMENT SIZE AND LOCATION ARE AS SHOWN ON THE CUP. ANY LOCATION DISCREPANCIES ARE TO BE REPORTED TO THE ENGINEER IN WRITING AHEAD OF INSTALLATION.
- BELL AND ROGERS VAULTS ARE TO BE PLACED TO THE EXTENT POSSIBLE IN THE RIGHT OF WAY RESPECTING THE REQUIRED CLEARANCES FROM DUCTS IN THE JOINT UTILITY TRENCH. IF VAULTS ARE ON PRIVATE PROPERTY THEY MUST BE PLACED WITHIN THE EASEMENT. VERIFY VAULT CORNERS PRIOR TO FINAL INSTALLATION AND FIBRE LINE PLACEMENT. VAULTS INSTALLED IN THE WRONG LOCATION OR OUTSIDE THE EASEMENTS WILL BE RELOCATED AT THE COST OF BELL AND ROGERS.
- UTILITY EASEMENTS ARE TO BE STAKED - ALL 4 CORNERS WITH PROPOSED FINAL GRADES MARKED ON THE STAKES.
- STREETLIGHTS ARE TO BE INSTALLED AT THE OFFSETS FROM FACE OF CURB SHOWN ON THE APPROVED ROAD SECTIONS FOR THE PROJECT.
- CAD FILES OF THE CUP PROVIDED BY THE ENGINEER ARE AS A COURTESY ONLY TO ASSIST THE CONTRACTOR. LAYOUT OF THE UTILITIES IS THE RESPONSIBILITY OF THE CONTRACTOR AND LEGAL SURVEYOR.

NOTES :

- ALL MATERIALS AND CONSTRUCTION IS TO BE IN ACCORDANCE WITH THE CURRENT CITY OF OTTAWA STANDARD DRAWINGS & SPECIFICATIONS OR OPSD/OPSS IF CITY DRAWINGS AND SPECIFICATIONS DO NOT APPLY.
- THE POSITION OF UNDERGROUND AND ABOVEGROUND SERVICE, UTILITIES AND STRUCTURES ARE NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH SERVICE, UTILITIES AND STRUCTURES IS NOT GUARANTEED. THE CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING SERVICES AND UTILITIES PRIOR TO CONSTRUCTION.
- THE CONTRACTOR SHALL REPORT ALL CONFLICTS, DISCOVERIES OF ERROR AND DISCREPANCIES TO THE ENGINEER.
- THE CONTRACTOR SHALL BE RESPONSIBLE TO PROTECT AND ASSUME RESPONSIBILITY FOR ALL UTILITIES WHETHER OR NOT SHOWN ON THESE DRAWINGS.
- THE CONTRACTOR SHALL BE RESPONSIBLE TO PROTECT ALL LANDS BEYOND THE SITE LIMITS. ANY AREAS BEYOND THE SITE LIMITS, WHICH ARE DISTURBED DURING CONSTRUCTION, SHALL BE REPAIRED AND RESTORED TO ORIGINAL CONDITION OR BETTER. TO THE SATISFACTION OF THE ADJACENT LAND OWNER. THE OWNER, THE OWNERS REPRESENTATIVES AND/OR THE AUTHORITY HAVING JURISDICTION AT THE EXPENSE OF THE CONTRACTOR.
- WHERE NECESSARY, THE CONTRACTOR SHALL IMPLEMENT A TRAFFIC MANAGEMENT PLAN TO THE SATISFACTION OF THE CITY OF OTTAWA. ALL CONSTRUCTION SIGNAGE MUST CONFORM TO THE LATEST VERSION OF THE M.T.O. MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES. ALL TEMPORARY TRAFFIC CONTROL MEASURES MUST BE REMOVED UPON THE COMPLETION OF THE WORKS.
- SHOULD ANY BURIED ARCHAEOLOGICAL REMAINS BE FOUND ON THE PROPERTY DURING CONSTRUCTION ACTIVITIES, THE CONTRACTOR SHALL NOTIFY THE OWNER TO CONTACT THE HERITAGE OPERATIONS UNIT OF THE ONTARIO MINISTRY OF CULTURE MUST BE NOTIFIED IMMEDIATE, AND WORK WITHIN THE AREA SHALL BE CEASED UNTIL FURTHER NOTICE.
- FOR GEOTECHNICAL INFORMATION REFER TO GEOTECHNICAL REPORT C0947.00 PREPARED BY TERRAPEX.
- FOR GEODETIC BENCHMARK AND GEOMETRIC LAYOUT OF STREET AND LOTS, REFER TO TOPOGRAPHICAL SURVEY AND PLAN OF SUBDIVISION PREPARED BY AOV 4M-1559 BENCHMARK BASED ON CAN-NET VIRTUAL REFERENCE SYSTEM NETWORK.
- FOR SITE PLAN INFORMATION, REFER TO SITE PLAN PREPARED BY NORR ARCHITECTS.
- THESE DRAWINGS ARE NOT TO BE SCALED OR USED FOR LAYOUT PURPOSES
- THE CONTRACTOR SHALL IMPLEMENT THE EROSION AND SEDIMENT CONTROL PLAN PRIOR TO THE COMMENCEMENT OF ANY SITE CONSTRUCTION. ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE INSTALLED TO THE SATISFACTION OF THE ENGINEER, OR ANY REGULATORY AGENCY. ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE MAINTAINED UNTIL VEGETATION IS ESTABLISH OR UNTIL THE START OF A SUBSEQUENT PHASE.
- CONTRACTORS SHALL BE RESPONSIBLE FOR KEEPING CLEAN ALL ROADS WHICH BECOME COVERED IN DUST, DEBRIS AND/OR MUD AS A RESULT OF ITS CONSTRUCTION OPERATIONS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY ADDITIONAL BEDDING OR ADDITIONAL STRENGTH PIPE SHOULD THE MAXIMUM OPSD TRENCH WIDTH BE EXCEEDED.
- ALL PIPE, CULVERTS, STRUCTURES REFER TO NOMINAL INSIDE DIMENSIONS.
- UNLESS SPECIFICALLY NOTED OTHERWISE, PIPE MATERIALS SHALL BE AS FOLLOWS:
-WATERMANS TO BE PVC DR18
-SANITARY SEWER TO BE PVC DR35
-PERFORATED STORM SEWERS IN REAR YARDS AND LANDSCAPE AREAS TO BE HDPE
-STORM SEWERS 375mm DIAMETER AND LESS TO BE PVC DR35
-STORM SEWERS 450mm DIAMETER AND GREATER TO BE CONCRETE, CLASS AS PER OPSD 807.010 OR 807.030, OR HIGHER FOR SHALLOW SEWERS, REFER TO CITY STANDARD S35.
- ALL CONNECTIONS TO EXISTING WATERMANS ARE TO BE COMPLETED BY CITY FORCES. CONTRACTOR IS TO EXCAVATE, BACKFILL, COMPACT AND REINSTATE.
- ANY WATERMAIN WITH LESS THAN 2.4m AND ANY SEWER WITH LESS THAN 2.0m DEPTH OF COVER REQUIRES THERMAL INSULATION AS PER CITY OF OTTAWA STANDARD W22 OR AS APPROVED BY THE ENGINEER.
- ALL STUBBED SEWERS SHALL HAVE PRE-MANUFACTURED CAPS INSTALLED.
- ALL CATCHBASINS SHALL HAVE A 600mm SUMP.
- ALL SANITARY MANHOLES SHALL BE EQUIPPED WITH A WATERTIGHT COVER.
- ALL LEADS FOR STREET CATCHBASINS AND CURB INLET CATCHBASINS CONNECTED TO MAIN SHALL BE 200mmØ PVC DR35 @ MIN 2% SLOPE UNLESS NOTED OTHERWISE. ALL LEADS FOR RVCB'S CONNECTED TO MAIN SHALL BE 200mmØ PVC DR35 @ MIN 1% SLOPE UNLESS NOTED OTHERWISE.
- UNLESS SPECIFICALLY NOTED OTHERWISE, ALL STREET CATCHBASINS SHALL BE INSTALLED WITH TWO - 3.0m MINIMUM SUBDRAINS INSTALLED LONGITUDINALLY, PARALLEL WITH THE CURB. ALL CATCHBASINS IN ASPHALT AREAS, NOT ADJACENT TO A CURB, SHALL BE INSTALLED WITH FOUR - 3.0m MINIMUM SUBDRAINS INSTALLED ORTHOGONALLY.
- INLET CONTROL DEVICES SHALL BE INSTALLED PRIOR TO COMPLETING THE ROAD BASE (GRANULAR A).
- ALL SEWER SERVICE LATERALS WITH MAINLINE CONNECTIONS DEEPER THAN 5.0m REQUIRE A CONTROLLED SETTLEMENT JOINT.
- EACH BUILDING SHALL BE EQUIPPED WITH A SANITARY AND STORM SEWER BACKWATER VALVE AND CLEAN-OUT ON ITS PRIMARY SERVICE, AS PER ONTARIO BUILDING CODE REQUIREMENTS (BY OTHERS).
- THE SUBGRADE OF ALL STRUCTURES, PIPE, ROADS, SIDEWALKS, WALKWAYS, AND BUILDINGS SHALL BE INSPECTED BY THE GEOTECHNICAL ENGINEER PRIOR TO PROCEEDING WITH CONSTRUCTION.
- TOP COURSE ASPHALT SHALL NOT BE PLACED UNTIL THE FINAL CCTV INSPECTION AND NECESSARY REPAIRS HAVE BEEN COMPLETED TO THE SATISFACTION OF THE ENGINEER AND THE CITY OF OTTAWA.
- ALL RETAINING WALLS GREATER THAN 0.6m IN HEIGHT REQUIRE A GUARD. ANY GUARD ON A RETAINING WALL GREATER THAN 1.0m IN HEIGHT SHALL BE DESIGNED BY THE QUALIFIED STRUCTURAL ENGINEER RESPONSIBLE FOR THE WALL DESIGN.
- ALL PROPOSED COVER FRAMES LOCATED IN A LANDSCAPE AREA (ESPECIALLY OVERFLOW STRUCTURES) NEED TO BE ANCHORED DIRECTLY TO THE TOP OF THE PRECAST CONCRETE TOP AS PER S. P. NO. F-4070 TO PREVENT DISPLACEMENT.

WATERMAIN SCHEDULE

	Station	Description	Finished Grade	Top of Watermain	As Built Watermain
A	0+000.00	200x150 TEE	87.894	85.494	
	0+006.70	150 V&V	88.150	85.750	
B	0+010.76	150 CAP	88.250	85.650	

CROSSING SCHEDULE

1	150 mm Ø W/M	1.13 m	CLEARANCE UNDER	200 mm Ø STM
2	150 mm Ø W/M	1.05 m	CLEARANCE UNDER	UTILITY TRENCH
3	150 mm Ø SAN	0.52 m	CLEARANCE UNDER	200 mm Ø W/M
4	150 mm Ø SAN	1.98 m	CLEARANCE UNDER	200 mm Ø STM
5	150 mm Ø SAN	0.58 m	CLEARANCE UNDER	UTILITY TRENCH
6	300 mm Ø STM	4.18 m	CLEARANCE OVER	300 mm Ø SAN
7	300 mm Ø STM	0.48 m	CLEARANCE UNDER	200 mm Ø W/M
8	300 mm Ø STM	2.32 m	CLEARANCE UNDER	200 mm Ø STM
9	300 mm Ø STM	0.87 m	CLEARANCE UNDER	UTILITY TRENCH

CLIENT
ROHIT GROUP


15 FITZGERALD ROAD, NEPEAN, ON

COPYRIGHT
This drawing has been prepared solely for the intended use, thus any reproduction or distribution for any purpose other than authorized by Arcadis is forbidden. Written dimensions shall have precedence over scale dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and Arcadis shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to Arcadis for general conformance before proceeding with fabrication.

Arcadis Professional Services (Canada) Inc.
formerly BSI Group Professional Services (Canada) Inc.

ISSUES

No.	DESCRIPTION	DATE
1	SUBMISSION NO.1 FOR CITY REVIEW	2023-12-08
2	SUBMISSION NO.2 FOR CITY REVIEW	2024-03-04
3	SUBMISSION NO.3 FOR CITY REVIEW	2024-05-01
4	NEW SITE PLAN	2024-08-07
5		
6		
7		
8		

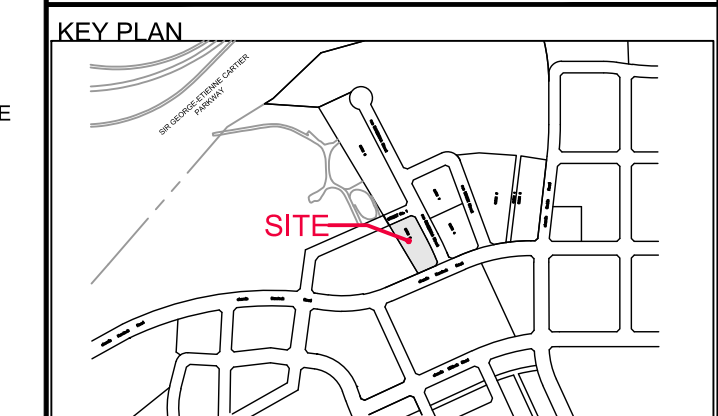

CONFIRM PRIME CONSULTANT
ARCADIS
333 Preston Street - Suite 500
Ottawa ON K1S 5N4 Canada
tel 613 225 1311
www.arcadis.com

PROJECT
WATERIDGE VILLAGE AT ROCKCLIFFE
PHASE 4 - BLOCK 5

PROJECT NO: 143934
DRAWN BY: M.M.
PROJECT MGR: PHASE 4 - BLOCK 5
CHECKED BY: D.C.
APPROVED BY: A.C.

SHEET TITLE
NOTES AND LEGEND

SHEET NUMBER C-010 **ISSUE** 4

Pre-Consul Meeting Notes to the File Lead - John Bernier

April 11, 2023

Re: 1076 Hemlock Ave., St., Lane, Way, Rd.

Ward 13 - Rideau-Rockcliffe, Councillor Rawlson King

4-7 with residential buildings (a mix of mid-rise apartments and stacked townhouses) with approximately 450 units.

Infrastructure:

There is no current infrastructure in Phase 4 to date. Please refer to proposed infrastructure, designed by IBI and latest revisions to civil drawings for this area, including LID features.

The following apply to this site and any development within a separated sewer area:

- Total allowable release rate will be 5-year pre-development rate.
- Coefficient (C) of runoff will need to be determined **as per existing conditions** but in no case more than 0.5. Please refer to MSS, ECAs and CPD for this subdivision (including any covenants) and/or updates.
- TC = 20 minutes or can be calculated
TC should be no less than 10 minutes, since IDF curves become unrealistic at less than 10 min.
- Any storm events greater than 5 year, up to 100 year, and including 100-year storm event must be detained on site.
- Two separate sewer laterals (one for sanitary and other for storm) will be required for each unit or for each block (network).
- LID features are part of the ROW and requires an ECA, which has not been submitted, to date.

Note: It is anticipated that any roads proposed for this development will be private and be a common element and/or have a joint use, maintenance and liability agreement (JUMLA).

- All municipal roads must meet current and approved ROW X-Sections, Municipal Consent and Utility Circulation protocols.

Please note:

Foundation drains are to be independently connected to sewermain unless being pumped with appropriate back up power, sufficient sized pump and back flow prevention.

Roof drains are to be connected downstream of any incorporated ICD within the SWM system.

Provide Roof plan showing roof drain and scupper locations with a table that indicates flow rates, drain type and weir opening, if controlled. Provide Manufacturer Specifications on drains and also provide 5- and 100-year ponding limits on plan.

Boundary Conditions will be provided at request of consultant after providing Average Daily Demands, Peak Hour Demands & Max Day + Fire Flow Demands

If window wells are proposed, they are to be indirectly connected to the footing drains. A detail of window well with indirect connection is required, as is a note at window well location speaking to indirect connection.

Other:

Environmental Noise Study is required due to within 100m proximity of Hemlock Road.

Stationary Noise Study – consultant to speak to this in their report as per City NCG and NPC 300 Guidelines for each building in regards to roof top units, large parking areas, etc. May be required after Mechanical Design completed and prior to building permit issuance.

When equal to or greater than 9-storey in height, a Shadow Study is required for all buildings/dwellings.

When equal to or greater than 9-storey in height, a Wind Study is required for all buildings/dwellings.

Water Supply Redundancy – Fire Flow:

Applicant to ensure that a second service with an inline valve chamber be provided where the average daily demand exceeds 50 m³ / day (0.5787 l/s per day)
FUS Fire Flow Criteria to be used unless a low-rise building, where OBC requirements may be applicable.



W12.pdf

Site Lighting:

Site lighting certificate and photometric plan required for this site. This will be a condition of agreement(s).

Site lighting certificate and photometric plan required for this site, particularly looking at light spillage and effects on nearby residential properties.

Trees:

Please note that a new Tree By-law is now in effect.



General Bulletin_New
Tree Protection Bylaw.

Tree removal is not permitted from April 15- August 16

A gas pressure regulating station may be required depending on HVAC needs (typically for 12+ units). Be sure to include this on the Grading, Site Servicing, SWM and Landscape plans.

This is to ensure that there are no barriers for overland flow routes (SWM) or conflicts with any proposed grading or landscape features with installed structures and has nothing to do with supply and demand of any product.



Gas Pressure
Regulating Station.pdf

Regarding Quantity Estimates:

Please note that external Garbage and/or bicycle storage structures are to be added to QE under Landscaping as it is subject to securities.

In addition, sump pumps for Sanitary and Storm laterals and/or cisterns are to be added to QE under Hard items as it is subject to securities, even though it is internal and is spoken to under SWM and Site Servicing Report and Plan.

Applicant to contact Rideau Valley Conservation Authority (RVCA) for possible restrictions due to quality control. Provide correspondence in Report.


Where servicing involves three or more service trenches, either a full road width or full lane width 40 mm asphalt overlay will be required, as per amended Road Activity By-Law 2003-445 and City Standard Detail Drawing R10. The amount of overlay will depend on condition of roadway and width of roadway(s).

CCTV sewer inspection required for pre and post construction conditions to ensure no damage to City Assets surrounding site.

Pre-Construction (Piling/Hoe Ramming or excavation in close proximity to City Assets) and/or Pre-Blasting (if applicable) Survey required for any buildings/dwellings in proximity of 75m of

site and circulation of notice of vibration/noise to residents within 150 m of site. Conditions for Pre-Construction/ Pre-Blast Survey & Use of Explosives will be applied to agreements. Refer to City's Standard S.P. No. F-1201 entitled *Use of Explosives*, as amended. The intent is to protect nearby property owners, City and Utility Assets and, if applicable, unsupported claims against the applicant.

For Erosion and Sediment Control, provide details of specified and approved products. Please note that wrapping CB grates with geotextile fabric is not longer acceptable, see example of accepted CB protection, below:

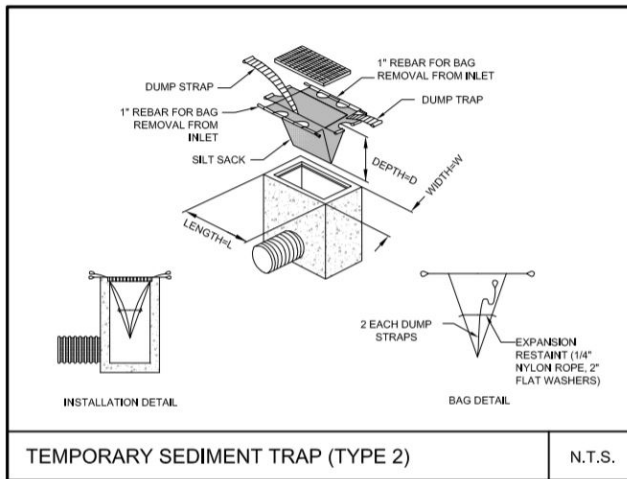

UG storage and Surface Ponding for SWM:

Where underground storage (UG) and surface ponding are being considered:

Show all ponding for 5- and 100-year events

Above and below ground storage is permitted although uses ½ Peak Flow Rate or is modeled. Please confirm that this has been accounted for and/or revise.

Rationale:

The Modified Rational Method for storage computation in the Sewer Design Guidelines was originally intended to be used for above ground storage (i.e. parking lot) where the change in head over the orifice varied from 1.5 m to 1.2 m (assuming a 1.2 m deep CB and a max ponding depth of 0.3 m). This change in

head was small and hence the release rate fluctuated little, therefore there was no need to use an average release rate.

When underground storage is used, the release rate fluctuates from a maximum peak flow based on maximum head down to a release rate of zero. This difference is large and has a significant impact on storage requirements. We therefore require that an average release rate be used to estimate the required volume. Alternatively, the consultant may choose to use a submersible pump in the design to ensure a constant release rate.

In the event that there is a disagreement from the designer regarding the required storage, The City will require that the designer demonstrate their rationale utilizing dynamic modelling, that will then be reviewed by City modellers in the Water Resources Group.

Note that the above will added to upcoming revised Sewer Design Guidelines to account for underground storage, which is now widely used.

Further to above, what will be the actual underground storage provided during the major (100 year) and minor (2 year) storm events?

Please provide information on UG storage pipe. Provide required cover over pipe and details, chart of storage values, capacity etc. How will this pipe be cleaned of sediment and debris?

Note - There must be at least 15cm of vertical clearance between the spill elevation and the ground elevation at the building envelope that is in proximity of the flow route or ponding area. The exception in this case would be at reverse sloped loading dock locations. At these locations, a minimum of 15cm of vertical clearance must be provided below loading dock openings. Ensure to provide discussion in report and ensure grading plan matches if applicable.

Provide information on type of underground storage system including product name and model, number of chambers, chamber configuration, confirm invert of chamber system, top of chamber system, required cover over system and details, interior bottom slope (for self-cleansing), chart of storage values, length, width and height, capacity, entry ports (maintenance) etc.

Provide a cross section of underground chamber system showing invert and obvert/top, major and minor HWLs, top of ground, system volume provided during major and minor events. UG storage to provide actual 2- and 100-year event storage requirements.

In regard to all proposed UG storage, ground water levels (and in particular HGW levels) will need to be reviewed to ensure that the proposed system does not become surcharged and thereby ineffective.

Modeling can be provided to ensure capacity for both storm and sanitary sewers for the proposed development by City's Water Distribution Dept. – Modeling Group, through PM and upon request.

For proposed depressed driveways or developments with private lanes, parking areas or with entrances etc. lower than roadway...



S18.pdf



S18.1.pdf

Rear yard on grade parking to be permeable pavement. Refer to City Standard Detail Drawings SC26 (maintenance/temp parking areas), SC27 or permeable asphalt materials. No gravel or stone dust parking areas permitted.

Severance:

If severance is planned, this needs to be addressed in servicing to satisfy severance requirements. Where a large parcel with multiple buildings is planned, City will require an ultimate servicing plan so as to appropriately understand how severance requirements are being met.

info "Provided Info to applicant":

Please be advised that it is the responsibility of the applicant and their representatives/consultants to verify information provided by the City of Ottawa.

Please contact City View and Release Info Centre at Ext. 44455

Environmental Source Information:

Due to more sensitive use, a Record of Site Condition (RSC) is required. Ensure Phase I, and if applicable, Phase II ESA's speak to required RSC.

Please also note that in the event soil and/or groundwater contamination is identified on this site and the proposal is for a more sensitive land use, the MECP will require approximately 1-1.5 years to review the RSC.

PIED will apply appropriate conditions, based on Environmental Protection Act (Section 168.3.1 (1)) and O.Reg. 153/04 (Parts IV and V) regarding requirements for RSC prior to building permit issuance. Dependent on the levels/types of contamination, timelines for building permit issuance may be longer than expected and we recommend applicant speak to Building Code Services, at the earliest convenience, so as to discuss these timelines in more detail, if deemed applicable.

City of Ottawa - Historical Land Use Inventory (HLUI) - Required

Rationale:

The HLUI database is currently undergoing an update. The updated HLUI will include additional sources beyond those included in the current database, making the inclusion of this record search even more important.

Although a municipal historic land use database is not specifically listed as required environmental record in O. Reg 153/04, Schedule D, Part II states the following:

The following are the specific objectives of a records review:

1. To obtain and review records that relate to the Phase I (One) property and to the current and past uses of and activities at or affecting the Phase I (One) property in order to determine if an area of potential environmental concern exists and to interpret any area of potential environmental concern.
2. To obtain and review records that relate to properties in the Phase I (One) study area other than the Phase I (One) property, in order to determine if an area of potential environmental concern exists and to interpret any area of potential environmental concern.

It is therefore reasonable to request that the HLUI search be included in the Phase I ESA to meet the above objectives.

Please submit.

Under site plan application:

There is a need for Delegated Authority Report for SPCA not for sewer extension. In addition, there will be an agreement for site plan control application that will cover all planning and infrastructure aspects. You do need to ask for any Delegated Authority Report for sewer extension.

All existing reports and plans will need to be revised if older than 2 years and must reflect current City Standards, Guidelines, By-laws and Policies.

Please refer to City of Ottawa website portal for **“Guide to preparing Studies and Plans”** at <https://ottawa.ca/en/city-hall/planning-and-development/information-developers/development-application-review-process/development-application-submission/guide-preparing-studies-and-plans>.

Specific information has been incorporated into both the [Guide to Preparing Studies and Plans](#) for a site plan. The guide outlines the requirement for a statement to be provided on the plan about where the property boundaries have been derived from.

Added to the general information for servicing and grading plans is a note that an O.L.S. should be engaged when reporting on or relating information to property boundaries or existing conditions. The importance of engaging an O.L.S. for development projects is emphasized.

Provide TBM location and elevation as well s Survey Monument information (taken from Survey Plan). Monument information should look like the following:

BENCH MARK No. 0011968U124
ELEVATIONS SHOWN ARE GEODETIC AND ARE REFERRED TO BENCHMARK No. 0011968U124 HAVING A PUBLISHED ELEVATION OF 95.185m. LOCATION: BRIDGE OVER JOCK RIVER IN RICHMOND, 0.8 KM SOUTH OF RICHMOND ROAD, BARSS CAP IN TOP OF EAST WALL, 2.7M FROM NORTH END.

Please ensure you are using the current guidelines, bylaws and standards including materials of construction, disinfection and all relevant reference to OPSS/D and AWWA guidelines - all current and as amended, such as:

[City of Ottawa Sewer Design Guidelines \(CoOSDG\)](#) complete with all current and relative ISTDB technical bulletin updates as well as current Sewer, Landscape & Road Standard Detail Drawings as well as Material Specifications (MS Docs).
Sewer Connection (2003-513) & Sewer Use (2003-514) By-Laws.

[City of Ottawa Water Distribution Design Guidelines \(CoOWDDG\)](#) complete with all current and relative ISTDB technical bulletin updates as well as current Watermain/ Services Material Specifications (MS Docs) as well as Water and Road Standard Detail Drawings.
FUS Fire Flow standards
Water (2018-167) By-Law

Ensure to include version date and add **“(as amended)”** when referencing all standards, detail drawings, by-Laws and guidelines.

Lane Closures:

Special Condition is required for SPC – Applicant to contact Traffic Eng. Reviewer PM and/or File Lead to contact Britney McGrath at Britney.McGrath@ottawa.ca (Ext. 44218)

Structural Works within ROW:

Constructability Report required for any structural works (i.e. Tiebacks) within the ROW.
PM and/or File Lead to contact Greg Kent (Mgr., Traffic Mgmt.) Ext # 21707 -
Greg.Kent@ottawa.ca

Fourth (4th) Review Charges,

Please note that additional charges (per day) for each review, for 4th and each consecutive review, will be applicable to each file. No exceptions.

Construction approach – Please contact the Right-of-Ways Permit Office

TMconstruction@ottawa.ca early in the OP / Zoning / Site Plan process to determine the ability to construct site and copy Choose a File Lead on this request.

Fire Routes - fireroutes@ottawa.ca

Contact me by e-mail shawn.wessel@ottawa.ca if you have any questions.

Sincerely,



Shawn Wessel, A.Sc.T., rcji
Project Manager
Development Review, Central Branch
Planning, Infrastructure and Economic Development Department (PIED)
City of Ottawa

Servicing study guidelines for development applications

4. Development Servicing Study Checklist

The following section describes the checklist of the required content of servicing studies. It is expected that the proponent will address each one of the following items for the study to be deemed complete and ready for review by City of Ottawa Infrastructure Approvals staff.

The level of required detail in the Servicing Study will increase depending on the type of application. For example, for Official Plan amendments and re-zoning applications, the main issues will be to determine the capacity requirements for the proposed change in land use and confirm this against the existing capacity constraint, and to define the solutions, phasing of works and the financing of works to address the capacity constraint. For subdivisions and site plans, the above will be required with additional detailed information supporting the servicing within the development boundary.

4.1 General Content

- Executive Summary (for larger reports only).
- Date and revision number of the report.
- Location map and plan showing municipal address, boundary, and layout of proposed development.
- Plan showing the site and location of all existing services.
- Development statistics, land use, density, adherence to zoning and official plan, and reference to applicable subwatershed and watershed plans that provide context to which individual developments must adhere.
- Summary of Pre-consultation Meetings with City and other approval agencies.
- Reference and confirm conformance to higher level studies and reports (Master Servicing Studies, Environmental Assessments, Community Design Plans), or in the case where it is not in conformance, the proponent must provide justification and develop a defensible design criteria.
- Statement of objectives and servicing criteria.
- Identification of existing and proposed infrastructure available in the immediate area.
- Identification of Environmentally Significant Areas, watercourses and Municipal Drains potentially impacted by the proposed development (Reference can be made to the Natural Heritage Studies, if available).
- Concept level master grading plan to confirm existing and proposed grades in the development. This is required to confirm the feasibility of proposed stormwater management and drainage, soil removal and fill constraints, and potential impacts to neighbouring properties. This is also required to confirm that the proposed grading will not impede existing major system flow paths.
- Identification of potential impacts of proposed piped services on private services (such as wells and septic fields on adjacent lands) and mitigation required to address potential impacts.
- Proposed phasing of the development, if applicable.

- Reference to geotechnical studies and recommendations concerning servicing.

- All preliminary and formal site plan submissions should have the following information:
 - Metric scale

 - North arrow (including construction North)

 - Key plan

 - Name and contact information of applicant and property owner

 - Property limits including bearings and dimensions

 - Existing and proposed structures and parking areas

 - Easements, road widening and rights-of-way

 - Adjacent street names

4.2 Development Servicing Report: Water

- Confirm consistency with Master Servicing Study, if available
- Availability of public infrastructure to service proposed development
- Identification of system constraints
- Identify boundary conditions
- Confirmation of adequate domestic supply and pressure
- Confirmation of adequate fire flow protection and confirmation that fire flow is calculated as per the Fire Underwriter's Survey. Output should show available fire flow at locations throughout the development.
- Provide a check of high pressures. If pressure is found to be high, an assessment is required to confirm the application of pressure reducing valves.
- Definition of phasing constraints. Hydraulic modeling is required to confirm servicing for all defined phases of the project including the ultimate design
- Address reliability requirements such as appropriate location of shut-off valves
- Check on the necessity of a pressure zone boundary modification.
- Reference to water supply analysis to show that major infrastructure is capable of delivering sufficient water for the proposed land use. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure range

- Description of the proposed water distribution network, including locations of proposed connections to the existing system, provisions for necessary looping, and appurtenances (valves, pressure reducing valves, valve chambers, and fire hydrants) including special metering provisions.
- Description of off-site required feeder mains, booster pumping stations, and other water infrastructure that will be ultimately required to service proposed development, including financing, interim facilities, and timing of implementation.
- Confirmation that water demands are calculated based on the City of Ottawa Design Guidelines.
- Provision of a model schematic showing the boundary conditions locations, streets, parcels, and building locations for reference.

4.3 Development Servicing Report: Wastewater

- Summary of proposed design criteria (Note: Wet-weather flow criteria should not deviate from the City of Ottawa Sewer Design Guidelines. Monitored flow data from relatively new infrastructure cannot be used to justify capacity requirements for proposed infrastructure).
- Confirm consistency with Master Servicing Study and/or justifications for deviations.
- Consideration of local conditions that may contribute to extraneous flows that are higher than the recommended flows in the guidelines. This includes groundwater and soil conditions, and age and condition of sewers.
- Description of existing sanitary sewer available for discharge of wastewater from proposed development.
- Verify available capacity in downstream sanitary sewer and/or identification of upgrades necessary to service the proposed development. (Reference can be made to previously completed Master Servicing Study if applicable)
- Calculations related to dry-weather and wet-weather flow rates from the development in standard MOE sanitary sewer design table (Appendix 'C') format.
- Description of proposed sewer network including sewers, pumping stations, and forcemains.
- Discussion of previously identified environmental constraints and impact on servicing (environmental constraints are related to limitations imposed on the development in order to preserve the physical condition of watercourses, vegetation, soil cover, as well as protecting against water quantity and quality).
- Pumping stations: impacts of proposed development on existing pumping stations or requirements for new pumping station to service development.
- Forcemain capacity in terms of operational redundancy, surge pressure and maximum flow velocity.
- Identification and implementation of the emergency overflow from sanitary pumping stations in relation to the hydraulic grade line to protect against basement flooding.
- Special considerations such as contamination, corrosive environment etc.

4.4 Development Servicing Report: Stormwater Checklist

- Description of drainage outlets and downstream constraints including legality of outlets (i.e. municipal drain, right-of-way, watercourse, or private property)
- Analysis of available capacity in existing public infrastructure.
- A drawing showing the subject lands, its surroundings, the receiving watercourse, existing drainage patterns, and proposed drainage pattern.
- Water quantity control objective (e.g. controlling post-development peak flows to pre-development level for storm events ranging from the 2 or 5 year event (dependent on the receiving sewer design) to 100 year return period); if other objectives are being applied, a rationale must be included with reference to hydrologic analyses of the potentially affected subwatersheds, taking into account long-term cumulative effects.
- Water Quality control objective (basic, normal or enhanced level of protection based on the sensitivities of the receiving watercourse) and storage requirements.
- Description of the stormwater management concept with facility locations and descriptions with references and supporting information.
- Set-back from private sewage disposal systems.
- Watercourse and hazard lands setbacks.
- Record of pre-consultation with the Ontario Ministry of Environment and the Conservation Authority that has jurisdiction on the affected watershed.
- Confirm consistency with sub-watershed and Master Servicing Study, if applicable study exists.
- Storage requirements (complete with calculations) and conveyance capacity for minor events (1:5 year return period) and major events (1:100 year return period).
- Identification of watercourses within the proposed development and how watercourses will be protected, or, if necessary, altered by the proposed development with applicable approvals.
- Calculate pre and post development peak flow rates including a description of existing site conditions and proposed impervious areas and drainage catchments in comparison to existing conditions.
- Any proposed diversion of drainage catchment areas from one outlet to another.
- Proposed minor and major systems including locations and sizes of stormwater trunk sewers, and stormwater management facilities.
- If quantity control is not proposed, demonstration that downstream system has adequate capacity for the post-development flows up to and including the 100 year return period storm event.
- Identification of potential impacts to receiving watercourses
- Identification of municipal drains and related approval requirements.
- Descriptions of how the conveyance and storage capacity will be achieved for the development.
- 100 year flood levels and major flow routing to protect proposed development from flooding for establishing minimum building elevations (MBE) and overall grading.

- Inclusion of hydraulic analysis including hydraulic grade line elevations.
- Description of approach to erosion and sediment control during construction for the protection of receiving watercourse or drainage corridors.
- Identification of floodplains – proponent to obtain relevant floodplain information from the appropriate Conservation Authority. The proponent may be required to delineate floodplain elevations to the satisfaction of the Conservation Authority if such information is not available or if information does not match current conditions.
- Identification of fill constraints related to floodplain and geotechnical investigation.

4.5 Approval and Permit Requirements: Checklist

The Servicing Study shall provide a list of applicable permits and regulatory approvals necessary for the proposed development as well as the relevant issues affecting each approval. The approval and permitting shall include but not be limited to the following:

- Conservation Authority as the designated approval agency for modification of floodplain, potential impact on fish habitat, proposed works in or adjacent to a watercourse, cut/fill permits and Approval under Lakes and Rivers Improvement Act. The Conservation Authority is not the approval authority for the Lakes and Rivers Improvement Act. Where there are Conservation Authority regulations in place, approval under the Lakes and Rivers Improvement Act is not required, except in cases of dams as defined in the Act.
- Application for Certificate of Approval (CofA) under the Ontario Water Resources Act.
- Changes to Municipal Drains.
- Other permits (National Capital Commission, Parks Canada, Public Works and Government Services Canada, Ministry of Transportation etc.)

4.6 Conclusion Checklist

- Clearly stated conclusions and recommendations
- Comments received from review agencies including the City of Ottawa and information on how the comments were addressed. Final sign-off from the responsible reviewing agency.
- All draft and final reports shall be signed and stamped by a professional Engineer registered in Ontario

APPENDIX B



ARCADIS IBI GROUP
 500-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 arcadis.com

IBI GROUP

WATERMAIN DEMAND CALCULATION SHEET

Block 5 | Rohit Communities
 143934-6.0 | Rev #2 | 2023-10-30
 Prepared By: AC | Checked By: DRC

NODE	RESIDENTIAL				NON-RESIDENTIAL (ICI)			AVERAGE DAILY DEMAND (l/s)			MAXIMUM DAILY DEMAND (l/s)			MAXIMUM HOURLY DEMAND (l/s)			FIRE DEMAND (l/min)	PEAKING FACTORS FOR POP. UNDER 500 (l/s)		
	APARTMENT 3 BED	APARTMENT 2 BED	APARTMENT 1 BED	POPULATION	INDUST. (ha)	COMM. (ha)	INSTIT. (ha)	RESIDENTIAL	ICI	TOTAL	RESIDENTIAL	ICI	TOTAL	RESIDENTIAL	ICI	TOTAL		NIGHT MIN. HOUR FACTOR	MAX. DAY FACTOR	PEAK HOUR FACTOR
Building 3	4	20	65	145.40				0.47		0.47	1.18		1.18	2.59		2.59	6,000			
TOTAL	4	20	65	145.40						0.47			1.18		2.59			0.05	2.39	3.61

ASSUMPTIONS											
POPULATION DENSITY		WATER DEMAND RATES		PEAKING FACTORS FOR POP. OF 501 TO 3000			FIRE DEMANDS		PEAKING FACTOR FOR POP. UNDER 500		
Apartment	3 Bed	3.1 persons/unit	Residential	280 l/cap/day	Maximum Daily	Residential	2.5 x avg. day	Single Family	10,000 l/min (166.7 l/s)	Night Min. Hour Factor	0.10
Apartment	2 Bed	2.1 persons/unit				Commercial	1.5 x avg. day	Semi Detached		Maximum Day Factor	5.08
Apartment	1 Bed	1.4 persons/unit	Commercial Shopping Center	2,500 L/(1000m2)/day	Maximum Hourly	Residential	2.2 x max. day	& Townhouse	10,000 l/min (166.7 l/s)	Peak Hour Factor	7.66
						Commercial	1.8 x max. day	Medium Density	15,000 l/min (250 l/s)	*Interpolated from MECP Table 3.3 based on a population of 145.4	

STEP	Contents	Description	Adjustment Factor	Result		
1	Floor Area	Building 3		m2		
	Total Storey			4 storey		
	Total Effective Floor Area			6587 m2		
2	Type of Construction	Type V Wood Frame	1.5	Type II Noncombustible Construction		
		Type III Ordinary Construction	1.0			
		Type II Noncombustible Construction	0.8			
		Type I Fire Resistive Construction	0.6			
3	Required Fire Flow	RFF = 220C \sqrt{A}		14000 L/min		
4	Occupancy and Contents	Noncombustible Contents	-25%	Noncombustible Contents.		
		Limited Combustible Contents	-15%			
		Combustible Contents	0%			
		Free Burning Contents	15%			
		Rapid Burning Contents	25%			
	Fire Flow			10500 L/min		
5	Automatic Sprinkler Protection	Automatic Sprinkler Conforming to NFPA 13	-30%	Yes	-30%	-3150 L/min
		Standard Water Supply for both the system and Fire Department Hose Lines	-10%	Yes	-10%	-1050 L/min
		Fully Supervised System	-10%	No		
		Fire Flow				-4200 L/min
6	Exposure Adjustment	Based on Table 6 Exposure Adjustment Charges for Subject Building				
	North	Separation (m)	>30	With unprotected opening	0% 0 L/min	
		Length X Height Factor (m.storeys)	0			
		Construction Type	Type II			
	South	Separation (m)	>30	With unprotected opening	0% 0 L/min	
		Length X Height Factor (m.storeys)	0			
		Construction Type	Type II			
East	Separation (m)	>30	With unprotected opening	0% 0 L/min		
	Length X Height Factor (m.storeys)	0				
	Construction Type	Type II				
West	Separation (m)	>30	With unprotected opening	0% 0 L/min		
	Length X Height Factor (m.storeys)	0				
	Construction Type	Type II				
	Fire Flow			0 L/min		
7	Total Required Fire Flow			6300		
		Rounded to Nearest 1000 L/min		6000 L/min		

Notes 1. Fire flow calculation are based on Fire Underwriters Survey version 2020.

Chetrar, Anton

From: Jhamb, Nishant <nishant.jhamb@ottawa.ca>
Sent: Monday, November 27, 2023 9:18 AM
To: Chetrar, Anton
Subject: RE: Block 5 - Wateridge Phase 4 - Water Boundary Conditions
Attachments: Waterridge Phase 4 Block 5 November 2023.pdf

Hi Anton,

The following are boundary conditions, HGL, for hydraulic analysis for Wateridge Phase 4 Block 5, (zone MONT) assumed to be a connected to the 203 mm stub watermain off Hemlock Road (see attached PDF for location).

Min HGL: 143.0 m

Max HGL: 143.0 m

Max Day + FF (100 L/s): 140.7 m

These are for current conditions and are based on computer model simulation.

Disclaimer: The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation.

Thanks
Nishant

From: Chetrar, Anton <anton.chetrar@arcadis.com>
Sent: November 27, 2023 8:02 AM
To: Jhamb, Nishant <nishant.jhamb@ottawa.ca>
Subject: RE: Block 5 - Wateridge Phase 4 - Water Boundary Conditions

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Good morning Nishant,

Hope you had a good weekend. Any news on the Boundary Conditions for Block 5 at Wateridge Phase 4?

Thanks,
Anton Chetrar P.Eng
Civil Engineer

Arcadis Professional Services (Canada) Inc.
Suite 500, 333 Preston Street | Ottawa | ON | K1S 5N4 | Canada
T: +1 613 225 1311 ext 64072
M: +1 613 882 8197
www.arcadis.com



Please note my new email address and update for your records.

From: Chetrar, Anton
Sent: Tuesday, October 31, 2023 8:22 AM
To: Jhamb, Nishant <nishant.jhamb@ottawa.ca>
Subject: RE: Block 5 - Wateridge Phase 4 - Water Boundary Conditions

Good morning Nishant,

Following up on the status of the boundary conditions for Block 5 at Wateridge Village as noted below.
Please let me know when you have a chance.

Thanks,
Anton Chetrar P.Eng
Civil Engineer
Arcadis Professional Services (Canada) Inc.
Suite 500, 333 Preston Street | Ottawa | ON | K1S 5N4 | Canada
T: +1 613 225 1311 ext 64072
M: +1 613 882 8197
www.arcadis.com



Please note my new email address and update for your records.

From: Chetrar, Anton
Sent: Wednesday, September 20, 2023 1:05 PM
To: Jhamb, Nishant <nishant.jhamb@ottawa.ca>
Subject: Block 5 - Wateridge Phase 4 - Water Boundary Conditions

Good afternoon Nishant,

We are requesting watermain boundary conditions for the proposed Block 5 site plan (the location of the watermain connections are shown on the figure attached).

Please find attached the water demands for Block 5 proposed development (90 apartment units).

- Daily average demand – 0.53 l/s
- Maximum daily demand – 1.31 l/s
- Maximum hourly demand – 2.89 l/s

Fireflow for Building 3: 6,000 L/min


Let me know if you need any other information.

Regards,

Anton Chetrar | P.ENG.

Cell 613-882-8197

Suite 500, 333 Preston Street
Ottawa ON K1S 5N4 Canada
tel +1 613 225 1311 ext 64072



IBI Group is now proudly a part of Arcadis.

NOTE: This email message/attachments may contain privileged and confidential information. If received in error, please notify the sender and delete this e-mail message.

NOTE: Ce courriel peut contenir de l'information privilégiée et confidentielle. Si vous avez reçu ce message par erreur, veuillez le mentionner immédiatement à l'expéditeur et effacer ce courriel.

This email and any files transmitted with it are the property of Arcadis and its affiliates. All rights, including without limitation copyright, are reserved. This email contains information that may be confidential and may also be privileged. It is for the exclusive use of the intended recipient(s). If you are not an intended recipient, please note that any form of distribution, copying or use of this communication or the information in it is strictly prohibited and may be unlawful. If you have received this communication in error, please return it to the sender and then delete the email and destroy any copies of it. While reasonable precautions have been taken to ensure that no software or viruses are present in our emails, we cannot guarantee that this email or any attachment is virus free or has not been intercepted or changed. Any opinions or other information in this email that do not relate to the official business of Arcadis are neither given nor endorsed by it.

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

APPENDIX C

LOCATION				RESIDENTIAL										ICI AREAS						INFILTRATION ALLOWANCE			FIXED FLOW (L/s)		TOTAL FLOW (L/s)	PROPOSED SEWER DESIGN					
STREET	AREA ID	FROM MH	TO MH	AREA w/ Units (Ha)	UNIT TYPES			AREA w/o Units (Ha)	POPULATION		RES PEAK FACTOR	PEAK FLOW (L/s)	AREA (Ha)			ICI PEAK FACTOR	PEAK FLOW (L/s)	AREA (Ha)		FLOW (L/s)	IND	CUM	TOTAL FLOW (L/s)	CAPACITY (L/s)	LENGTH (m)	DIA (mm)	SLOPE (%)	VELOCITY (full) (m/s)	AVAILABLE CAPACITY		
					SF	1 Bed APT	2 Bed APT		3 Bed APT	IND			CUM	IND	CUM			IND	CUM										IND	CUM	L/s
Oshedinaa Street		BLDG A	CTRL MH1A	0.42	65	20	4		145.4	145.4	3.56	168	0.00	0.0	0.00	0.0	0.00	0.00	0.00	0.00	0.00	0.00	181	25.12	185	150	2.50	1377	23.31	92.78%	
Oshedinaa Street		CTRL MH1A	MH190A						0.0	145.4	3.56	168	0.00	0.0	0.00	0.0	0.00	0.00	0.00	0.00	0.00	181	29.72	12.72	150	3.50	1629	27.91	93.90%		
Design Parameters:				Notes:										Designed:						No.			Revision		Date						
Residential				ICI Areas										AC						1.			Servicing Brief - Submission No. 1		2023-11-02						
SF 3.4 p/p/u				1. Mannings coefficient (n) = 0.013										2.						2.			Servicing Brief - Submission No. 2		2024-02-26						
APT 18 p/p/u				2. Demand (per capita): 280 L/day 200 L/day										3.						3.			Servicing Brief - Submission No. 3		2024-04-10						
1 Bed 14 p/p/u				3. Infiltration allowance: 0.33 L/s/Ha										Checked: DRC																	
2 Bed 2.1 p/p/u				4. Residential Peaking Factor: Harmon Formula = $1 + \{14 / (4 + (P/1000)^{0.5})\} 0.8$ where K = 0.8 Correction Factor										Dwg. Reference: 143934																	
3 Bed 3.1 p/p/u				5. Commercial and Institutional Peak Factors based on total area, 1.5 if greater than 20%, otherwise 1.0										File Reference: 143934-6.04.04											Date: 2024-04-10						
Other 60 p/p/Ha																									Sheet No: 1 of 1						



IBI GROUP
 400-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com

LEGEND
 MH190A Block 5 Information

SANITARY SEWER DESIGN SHEET

Wateridge at Rockcliffe - Phase 4
 City of Ottawa
 Canada Lands Company


LOCATION				RESIDENTIAL										ICI AREAS						INFILTRATION ALLOWANCE			FIXED FLOW (L/s)		TOTAL FLOW (L/s)	PROPOSED SEWER DESIGN										
STREET	AREA ID	FROM MH	TO MH	AREA w/ Units (Ha)	UNIT TYPES				AREA w/o Units (Ha)	POPULATION		RES PEAK FACTOR	PEAK FLOW (L/s)	INSTITUTIONAL		COMMERCIAL		INDUSTRIAL		ICI PEAK FACTOR	PEAK FLOW (L/s)	AREA (Ha)		FLOW (L/s)	IND	CUM	TOTAL FLOW (L/s)	CAPACITY (L/s)	LENGTH (m)	DIA (mm)	SLOPE (%)	VELOCITY (full) (m/s)	AVAILABLE CAPACITY			
					SF	SD / TH/F	TH/S	APT		IND	CUM			IND	CUM	IND	CUM	IND	CUM			IND	CUM										L/s	(%)		
Winisik Street	MH320A	MH320A	MH321A	1.48					174			330.6	330.6	3.45	3.69	0.00	0.00	0.09	0.09	0.00	0.00	1.00	0.03	1.57	1.57	0.52	0.00	0.00	4.24	72.08	100.50	250	1.35	1.423	67.84	94.12%
Winisik Street		MH321A	MH322A	0.00								0.0	330.6	3.45	3.69	0.00	0.00	0.00	0.09	0.00	0.00	1.00	0.03	0.00	1.57	0.52	0.00	0.00	4.24	72.08	12.05	250	1.35	1.423	67.84	94.12%
Winisik Street	MH323A	MH322A	MH191A	1.15					136			258.4	589.0	3.35	6.39	0.00	0.00	0.12	0.21	0.00	0.00	1.00	0.07	1.27	2.84	0.94	0.00	0.00	7.40	75.98	83.75	250	1.50	1.500	68.58	90.26%
Oshedinaa Street	MH193A	MH193A	MH192A	1.69					202	1.18		383.8	383.8	3.42	4.26	0.00	0.00	0.00	0.00	0.00	0.00	1.00	0.00	2.87	2.87	0.95	0.00	0.00	5.21	54.44	83.66	250	0.77	1.074	49.23	90.44%
Oshedinaa Street		MH192A	MH191A						43			81.7	465.5	3.39	5.12	0.00	0.00	0.00	0.00	0.00	0.00	1.00	0.00	0.00	2.87	0.95	0.00	0.00	6.06	49.42	83.87	300	0.24	0.677	43.36	87.73%
Oshedinaa Street		MH191A	MH190A	0.34					0			0.0	1054.5	3.23	11.03	0.00	0.00	0.00	0.21	0.00	0.00	1.00	0.07	0.34	6.05	2.00	0.00	0.00	13.10	43.97	104.71	300	0.19	0.603	30.88	70.22%
Oshedinaa Street	MH190A	MH190A	MH180A	0.42					89			145.4	1199.9	3.20	12.44	0.00	0.00	0.00	0.21	0.00	0.00	1.00	0.07	0.42	6.47	2.14	0.00	0.00	14.64	125.60	71.19	300	1.55	1.721	110.96	88.34%
Design Parameters:				Notes: 1. Mannings coefficient (n) = 0.013 2. Demand (per capita): 280 L/day 3. Infiltration allowance: 0.33 L/s/Ha 4. Residential Peaking Factor: Harmon Formula = 1+(14/(4+(P/1000)^0.5))^0.8 where K = 0.8 Correction Factor 5. Commercial and Institutional Peak Factors based on total area, 1.5 if greater than 20%, otherwise 1.0										Designed: AC						Checked: J.I.M.		Dwg. Reference: 118863-410		No.		Revision		Date								
Residential ICI Areas				SF 3.2 p/p/u TH/F/SD 2.4 p/p/u TH/S 2.4 p/p/u APT 1.9 p/p/u Other 60 p/p/Ha										INST 28,000 L/Ha/day COM 28,000 L/Ha/day IND 35,000 L/Ha/day 17000 L/Ha/day						MOE Chart																
																				File Reference: 118863.5.7.1		Date: 2020-06-03		Sheet No: 1 of 1												

J:\118863_Wateridge\Drawings\Proposed SANITARY.dwg, Layout, Name: 410 Plot Size: AIA STANDARD-HALF CTB Plot Scale: 1:50.8 Printed At: 11/27/2023 4:21 PM Last Saved By: MMUNE Last Saved At: Nov 3, 23



LEGEND :

- MANHOLE NUMBER
- POPULATION
- AREA IN HECTARES
- PROPOSED SERVICE LATERAL LOCATION

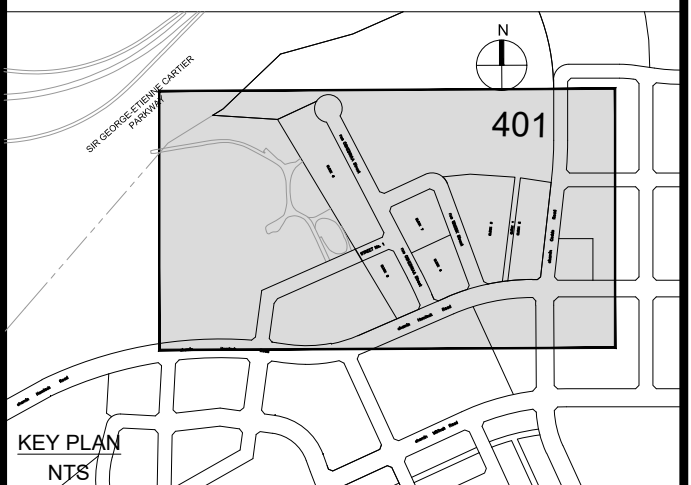

No.	REVISIONS	By	Date
14			
13			
12			
11			
10			
9	REVISED CB180 TO CIB180 AND ADDED NEW LID BASE	J.I.M.	2023-11-03
8	REVISED PER GRDD PLAN	J.I.M.	2023-08-17
7	ISSUED FOR CONSTRUCTION	J.I.M.	2023-07-24
6	ISSUED FOR RFP	J.I.M.	2023-02-28
5	SUBMISSION NO. 5 FOR CITY REVIEW	J.I.M.	2023-01-31
4	SUBMISSION NO. 4 FOR CITY REVIEW	J.I.M.	2022-09-23
3	SUBMISSION NO. 3 FOR CITY REVIEW	J.I.M.	2021-12-10
2	SUBMISSION NO. 2 FOR CITY REVIEW	J.I.M.	2020-07-08
1	SUBMISSION NO. 1 FOR CITY REVIEW	J.I.M.	2018-12-20

CANADA LANDS COMPANY
SOCIÉTÉ IMMOBILIÈRE DU CANADA

100 Queen Street
 Ottawa, On
 K1P 1J9


IBI GROUP
 400 - 333 Preston Street
 Ottawa ON K1S 5N4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com

Project Title
WATERIDGE VILLAGE AT ROCKCLIFFE
 PHASE 4

J. I. MOFFATT
 2023/11/03
 PROVINCE OF ONTARIO

N

Drawing Title
SANITARY DRAINAGE
AREA PLAN

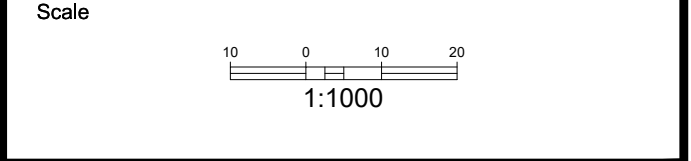

Design	J.I.M.	Date	JUNE 2020
Drawn	M.M.	Checked	A.C.
Project No.	118863	Drawing No.	410



IBI GROUP
 500-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com

Block 5 Information Added

SANITARY SEWER DESIGN SHEET

Former CFB Rockcliffe
 City of Ottawa
 Canada Lands Company

LOCATION				RESIDENTIAL								ICI AREAS						INFILTRATION ALLOWANCE			FIXED FLOW (L/s)	TOTAL FLOW (L/s)	PROPOSED SEWER DESIGN						
STREET	AREA ID	FROM MH	TO MH	AREA Ph1 (Ha)	UNIT TYPES				AREA External (Ha)	POPULATION		PEAK FACTOR	PEAK FLOW (L/s)	AREA (Ha)			PEAK FLOW (L/s)	AREA (Ha)		FLOW (L/s)			CAPACITY (L/s)	LENGTH (m)	DIA (mm)	SLOPE (%)	VELOCITY (full) (m/s)	AVAILABLE CAPACITY	
					SF	SD	TH	APT		IND	CUM			IND	CUM	IND		CUM	IND		CUM	IND						CUM	L/s
Hemlock Road	182A(b)	MH182A	MH181A	0.09					0.0	0.0	3.80	0.00							0.09	0.09	0.03	0.03	42.08	37.30	250	0.46	0.830	42.05	99.93%
	181A, EXT 12	MH181A	MH180A	0.25				0.86	72.0	72.0	3.62	0.85							1.11	1.20	0.40	1.24	47.32	100.21	300	0.22	0.648	46.08	97.38%
Street No. 19	190A	MH190A	MH180A					0.75	145.4	1144.5	3.21	11.90							0.75	13.87	4.58	16.48	125.60	72.34	300	1.55	1.721	109.12	86.88%
chemin Hemlock Road	180A	MH180A	MH179A	0.17					0.0	1216.5	3.19	12.60							0.17	15.24	5.03	17.62	55.26	43.60	300	0.30	0.757	37.63	68.10%
Hemlock Road	177A	MH177B	MH177A	0.23					0.0	0.0	3.80	0.00							0.23	0.23	0.08	0.08	36.17	20.31	250	0.34	0.714	36.10	99.79%
Hemlock Road	---	MH177A	MH178A						0.0	0.0	3.80	0.00							0.00	0.23	0.08	0.08	34.54	48.80	250	0.31	0.682	34.47	99.78%
Hemlock Road	---	MH178A	MH179A						0.0	0.0	3.80	0.00							0.00	0.23	0.08	0.08	39.24	29.91	250	0.40	0.774	39.16	99.81%
EX Shaft	---	MH179A	MH200A						0.0	1216.5	3.19	12.60							0.00	15.47	5.11	17.70	54.33	47.91	300	0.29	0.745	36.63	67.42%
EX Shaft	---	MH200A	EX Shaft						0.0	10454.9	2.55	86.34							0.00	98.24	32.42	125.93	200.37	12.90	375	1.2	1.757	74.44	37.15%
Design Parameters:				Notes:								Designed:						Revision			Date								
Residential				1. Mannings coefficient (n) = 0.013								AC						1. Submission No. 1 for City Review			2023-10-26								
ICI Areas				2. Demand (per capita): 280 L/day								JIM						2. Upstream Capacity Check			2023-11-29								
Peak Factor				3. Infiltration allowance: 0.33 L/s/Ha								38298-501																	
SF 3.4 p/p/u				4. Residential Peaking Factor: Harmon Formula = 1+(14/(4+P^0.5))								File Reference: 38298.5.7.1						Date: 2023-11-29			Sheet No: 2 of 2								
TH/SD 2.7 p/p/u				where P = population in thousands																									
APT 1.8 p/p/u																													
Other 60 p/p/Ha																													
INST 50,000 L/Ha/day																													
COM 50,000 L/Ha/day																													
IND 35,000 L/Ha/day																													
MOE Chart 17000 L/Ha/day																													



February 20, 2024

Anton Chetrar, P. Eng.
Arcadis Professional Services (Canada) Inc.
Suite 500, 333 Preston Street
Ottawa, ON K1S 5N4

Subject: Block 5 Phase 4 Acknowledgement & Permission Letter, Wateridge Village, Ottawa, Ontario

Dear Anton Chetrar,

Canada Lands Company CLC Limited ("CLC") is aware of the increase in population from the approved Phase 4 Design Brief (91.2 to 145.4). CLC will account for, with assistance from Arcadis, this increase in population in the updated sanitary sewer design sheet and the updated water model for the entire subdivision.

CLC grants permission for the terracing works to proceed within Block 13 as shown and highlighted in the attached grading plan [Arcadis (2023, December 8), Grading Plan, C-200, Project No. 143934]. There are existing agreements between CLC and the Rohit Group of Companies which cover and detail requirements surrounding building operations and use of peripheral properties owned by CLC within Wateridge Village.

We look forward to working with you on this project.

Regards,

CANADA LANDS COMPANY CLC LIMITED



Xavier Redhead

Xavier Redhead
Development Manager, Real Estate (NCR)

Mary Jarvis

Mary Jarvis
Senior Director, Real Estate (NCR/Atlantic)

APPENDIX D


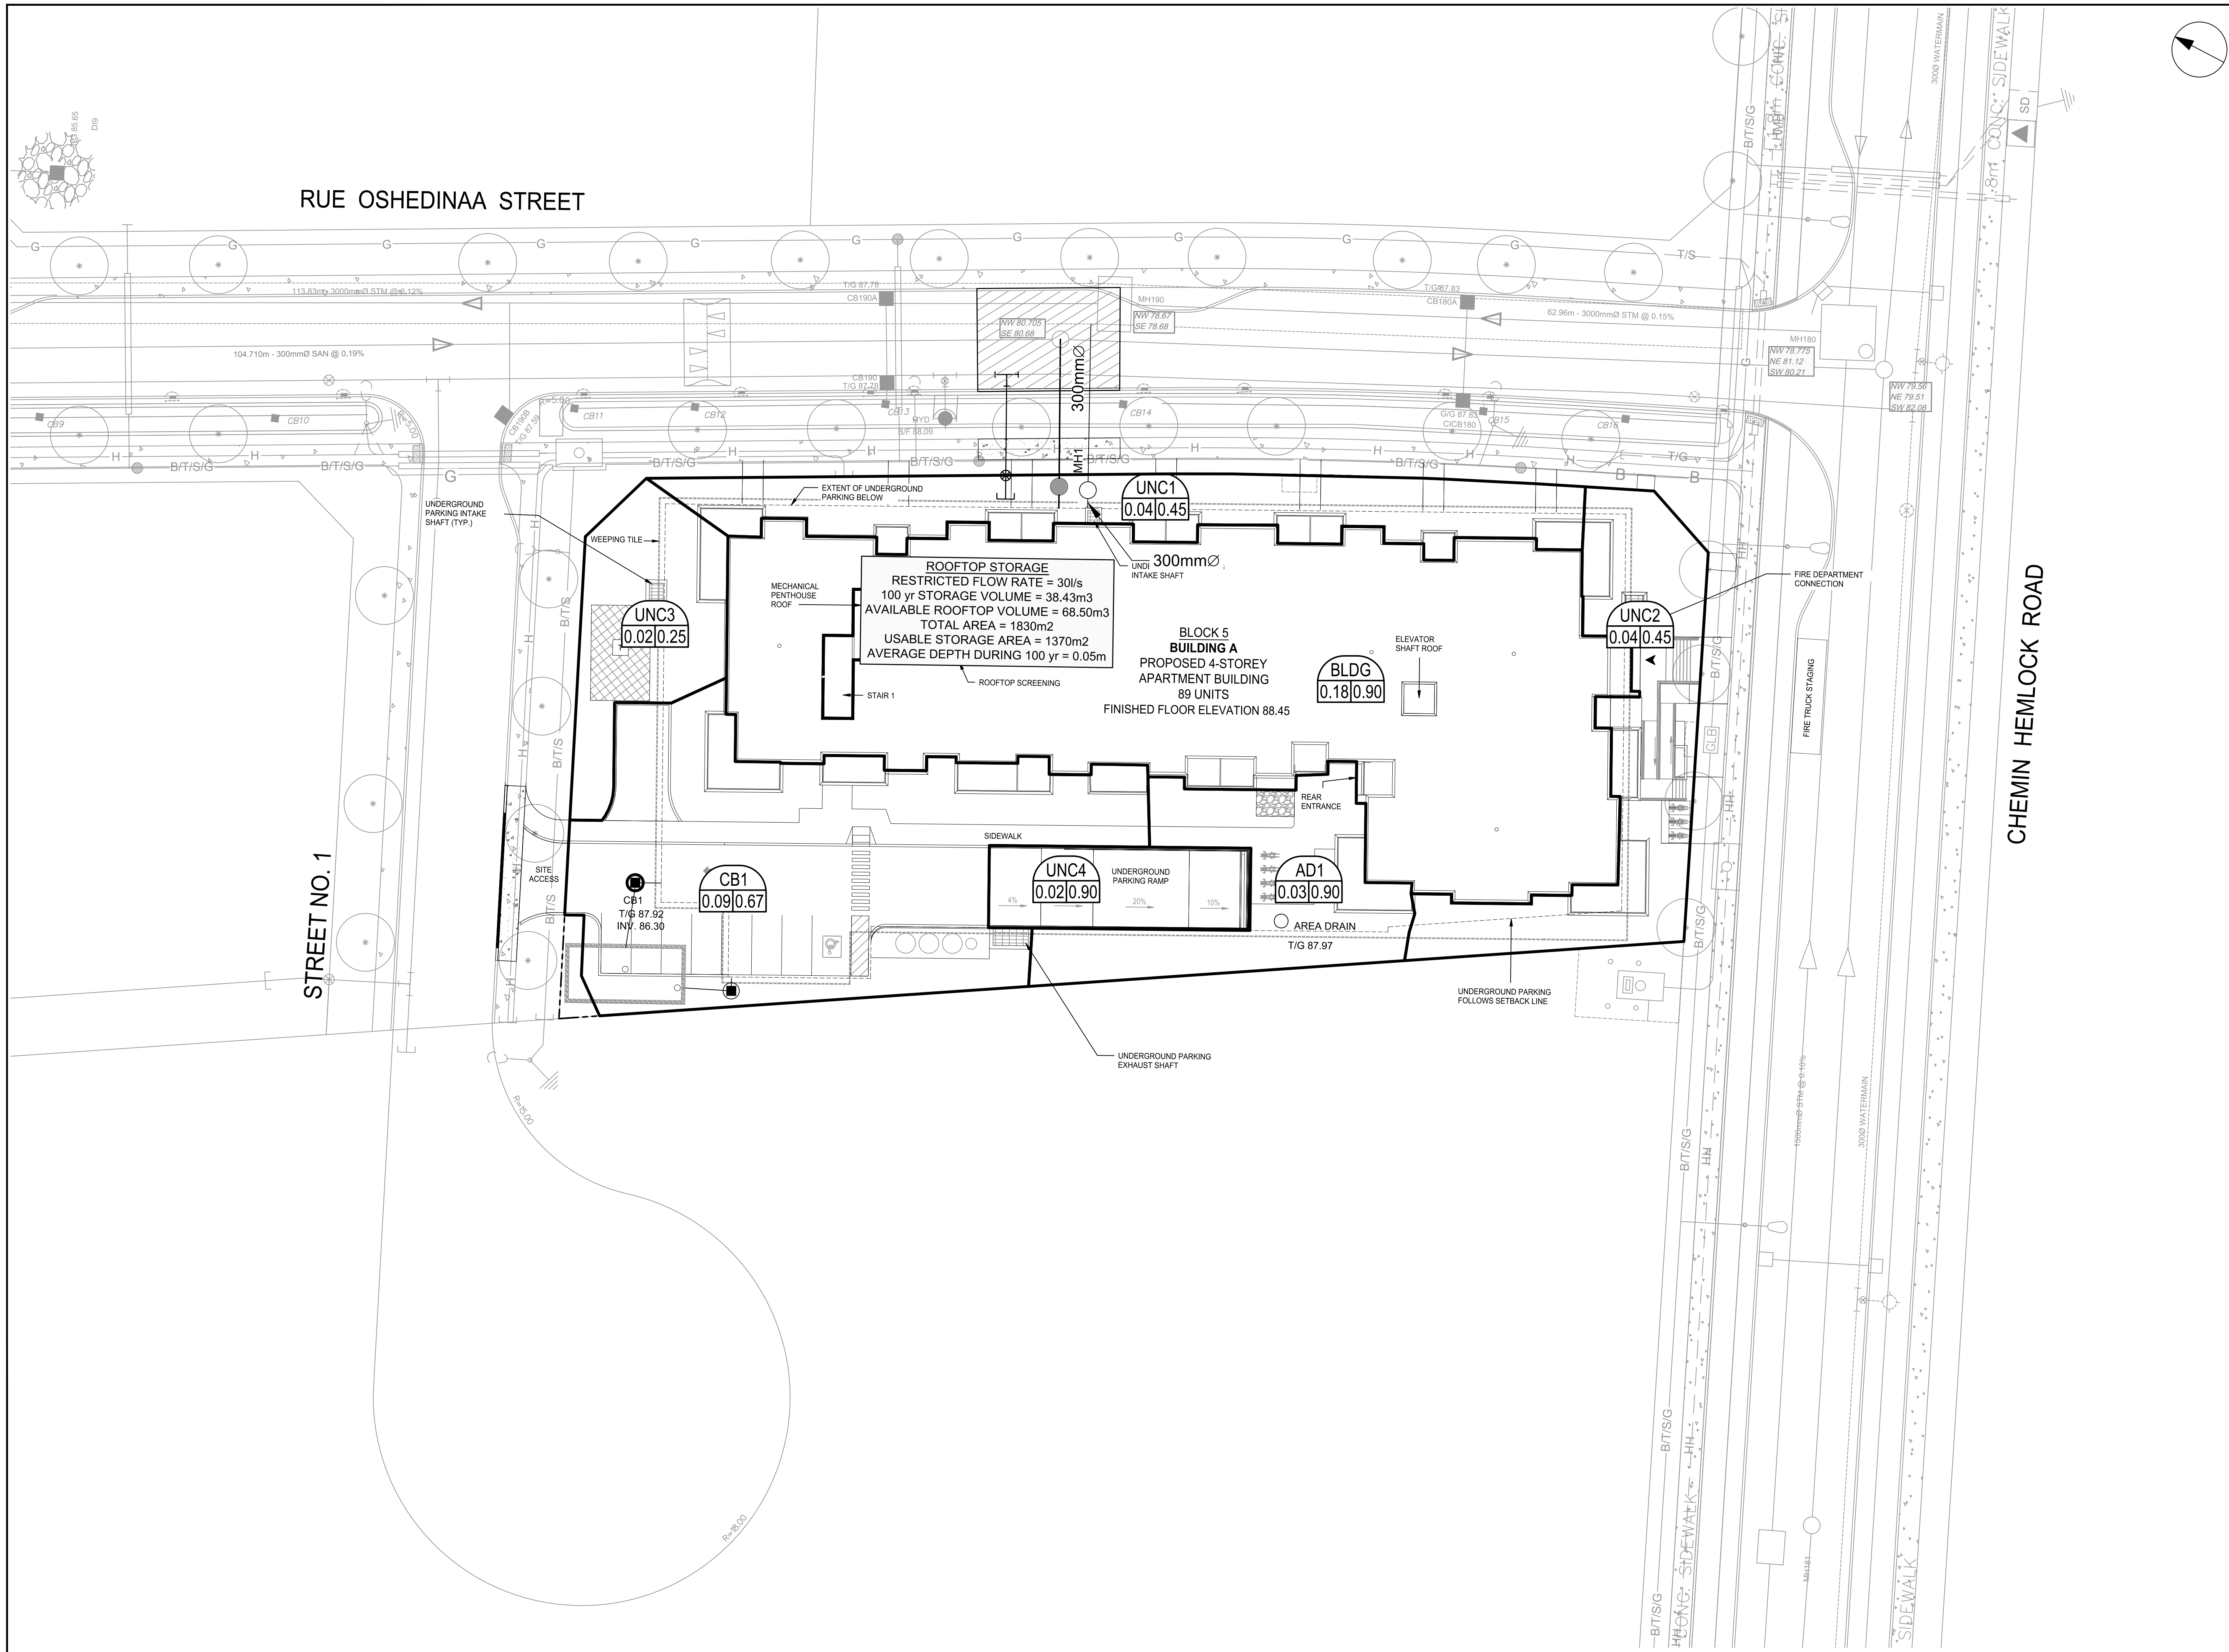


CLIENT
ROHIT GROUP
 15 FITZGERALD ROAD, NEPEAN, ON

COPYRIGHT
 This drawing has been prepared solely for the intended use, thus any reproduction or distribution for any purpose other than authorized by Arcadis is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and Arcadis shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to Arcadis for general conformance before proceeding with fabrication.

Arcadis Professional Services (Canada) Inc.
 Formerly BSI Group Professional Services (Canada) Inc.

No.	DESCRIPTION	DATE
1	SUBMISSION NO.1 FOR CITY REVIEW	2023-12-08
2	SUBMISSION NO.2 FOR CITY REVIEW	2024-03-04
3	SUBMISSION NO.3 FOR CITY REVIEW	2024-05-01
4	NEW SITE PLAN	2024-08-07
5		
6		
7		
8		

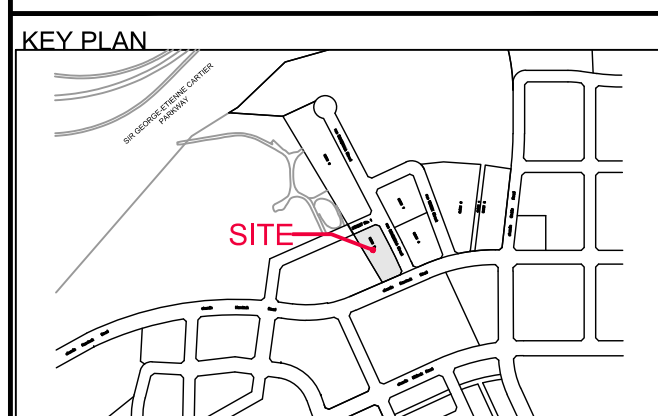

SEAL

PRIME CONSULTANT
ARCADIS
 333 Preston Street - Suite 500
 Ottawa ON K1S 5N4 Canada
 tel 613 225 1311
 www.arcadis.com

PROJECT
**WATERIDGE VILLAGE
 AT ROCKCLIFFE**
 PHASE 4 - BLOCK 5

PROJECT NO:
 143934
 DRAWN BY: **M.M.** CHECKED BY: **D.C.**
 PROJECT MGR: **D.C.** APPROVED BY: **A.C.**

SHEET TITLE
STORM DRAINAGE AREA PLAN

SHEET NUMBER **C-500** ISSUE **4**

File Location: J:\143934_Block_5_Phase_4\7_0_Production\7_03_Design\04_Civil\Sheet\C-500_DRAINAGE AREA PLAN.dwg Last Saved: August 7, 2024, by M.Miline Plotted: Wednesday, August 7, 2024, 2:08:39 PM by Marian Milne
 D07-XX-XX-XXXX
 XXXXX

March 11, 2024

Rohit Ottawa – 5 and 100-year storm event ponding areas

Project No.

NCCA22-0243-05

Project Name

Rohit - Ottawa Wateridge Village LOT 5

To whom it may concern,

This letter is to confirm that in order to accommodate the 5- and 100- year storm event ponding areas, at the time of detailed design of the building, the roof of the building will accommodate a ponding volume on the roof of the building of 68.50 m³, which equals to an average of 52 mm across 70% of the whole roof surface area.

For more information please do not hesitate to contact us.

Signed by

Project Manager

Name: Erin Faulkner

Erin Faulkner
Digitally signed by Erin Faulkner
DN: C=CA, E=erin.faulkner@norr.com,
CN=Erin Faulkner
Date: 2024.03.11 10:39:58-05'00'


Signature

2024-03-11

Date


Notification: Email

J:\118863_Wateridge\Drawings\Storm\1001 Storm.dwg Layout Name: 510 Plot: Storm - AIA STANDARD-HALF CTB Plot Size: 11.00x8.00 Printed At: 11/17/2023 4:22 PM Plot Size: 11.00x8.00 Plot Spaced By: MMLHE Last Saved At: Jul 24, 23

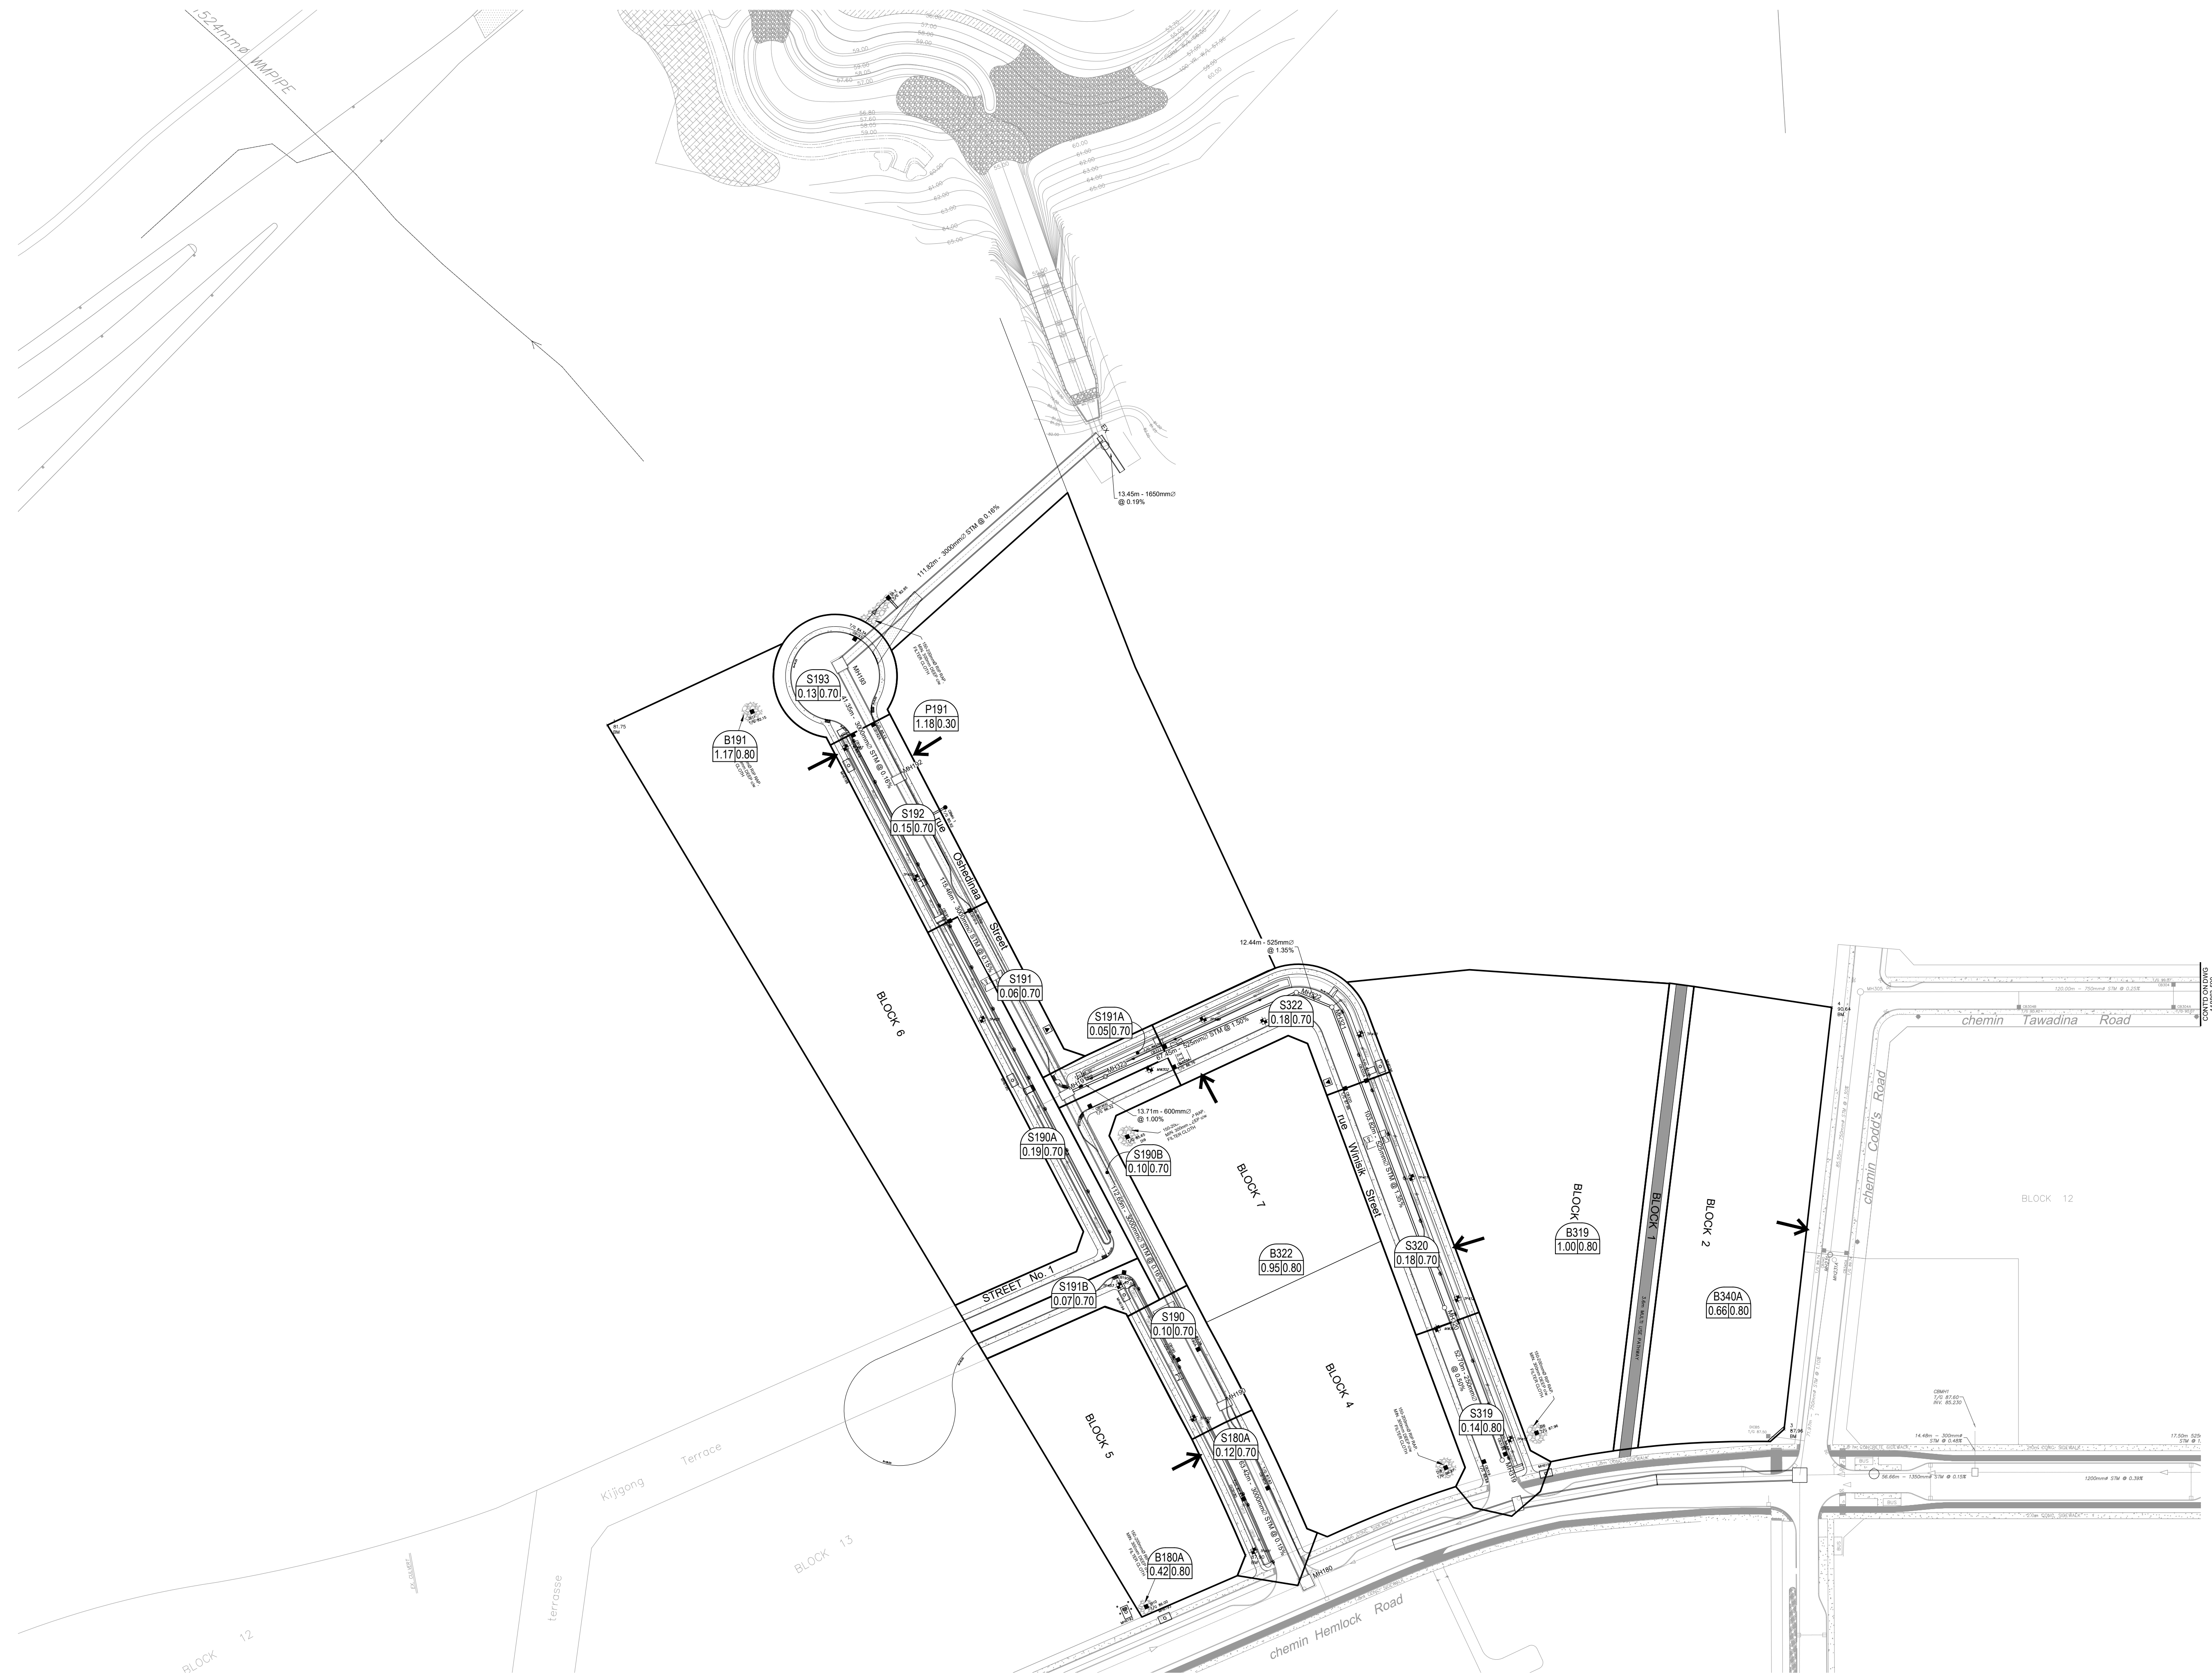

LEGEND :

- AREA NUMBER
- RUNOFF COEFFICIENT
- AREA IN HECTARES
- PROPOSED SERVICE LATERAL LOCATION

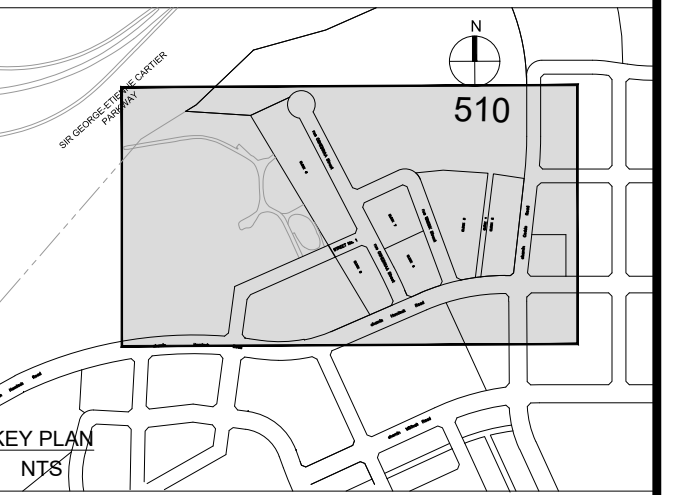

No.	REVISIONS	By	Date
14			
13			
12			
11			
10			
9	REVISED CB180 TO C180 AND ADDED NEW LID BASE	J.I.M.	2023-11-03
8	REVISED PER GRDD PLAN	J.I.M.	2023-08-17
7	ISSUED FOR CONSTRUCTION	J.I.M.	2023-07-24
6	ISSUED FOR RFP	J.I.M.	2023-02-28
5	SUBMISSION NO. 5 FOR CITY REVIEW	J.I.M.	2023-01-31
4	SUBMISSION NO. 4 FOR CITY REVIEW	J.I.M.	2022-09-23
3	SUBMISSION NO. 3 FOR CITY REVIEW	J.I.M.	2021-12-10
2	SUBMISSION NO. 2 FOR CITY REVIEW	J.I.M.	2020-07-08
1	SUBMISSION NO. 1 FOR CITY REVIEW	J.I.M.	2018-12-20

CANADA LANDS COMPANY
SOCIÉTÉ IMMOBILIÈRE DU CANADA

100 Queen Street
Ottawa, On
K1P 1J9

IBI GROUP
400 - 333 Preston Street
Ottawa ON K1S 5N4 Canada
tel 613 225 1311 fax 613 225 9868
ibigroup.com

Project Title
WATERIDGE VILLAGE AT ROCKCLIFFE
PHASE 4

J. I. MOFFATT
2023/11/03
PROVINCE OF ONTARIO

N

Drawing Title
STORM DRAINAGE
AREA PLAN

Scale
1:1000

Design	J.I.M.	Date	JUNE 2020
Drawn	M.M.	Checked	A.C.
Project No.	118863	Drawing No.	510

D07-16-15-0003_P4

Formulas and Descriptions

$i_{3yr} = 12 \text{ year Intensity} = 732.951 / (T_c + 6.199)^{0.810}$
 $i_{5yr} = 15 \text{ year Intensity} = 998.071 / (T_c + 6.053)^{0.814}$
 $i_{100yr} = 1100 \text{ year Intensity} = 1735.688 / (T_c + 6.014)^{0.820}$
 $T_c = \text{Time of Concentration (min)}$
 $C = \text{Average Runoff Coefficient}$
 $A = \text{Area (Ha)}$
 $Q = \text{Flow} = 2.78CIA \text{ (L/s)}$

Maximum Allowable Release Rate

Restricted Flowrate ($Q_{restricted}$) = Based on Wateridge Village report

Based on Wateridge Village report

$Q_{restricted} = 120.00 \text{ L/s}$

Uncontrolled Release ($Q_{uncontrolled} = 2.78 \cdot C^i \cdot i_{100yr} \cdot A_{uncontrolled}$)

UNC1+UNC2

$C = 0.5625$ (0.45 x 1.25 for 100 year)
 $T_c = 10 \text{ min}$
 $i_{100yr} = 178.56 \text{ mm/hr}$
 $A_{uncontrolled} = 0.078 \text{ Ha}$

$Q_{uncontrolled} = 2184 \text{ L/s}$

UNC3

$C = 0.3125$ (0.25 x 1.25 for 100 year)
 $T_c = 10 \text{ min}$
 $i_{100yr} = 178.56 \text{ mm/hr}$
 $A_{uncontrolled} = 0.02 \text{ Ha}$

$Q_{uncontrolled} = 3.10 \text{ L/s}$

UNC4

$C = 100$ (0.90 x 1.25 for 100 year)
 $T_c = 10 \text{ min}$
 $i_{100yr} = 178.56 \text{ mm/hr}$
 $A_{uncontrolled} = 0.015 \text{ Ha}$

$Q_{uncontrolled} = 7.45 \text{ L/s}$

CB1

$C = 0.84$ (0.67 x 1.25 for 100 year)
 $T_c = 10 \text{ min}$
 $i_{100yr} = 178.56 \text{ mm/hr}$
 $A_{uncontrolled} = 0.09 \text{ Ha}$

$Q_{uncontrolled} = 37.53 \text{ L/s}$

AD1

$C = 100$ (0.90 x 1.25 for 100 year)
 $T_c = 10 \text{ min}$
 $i_{100yr} = 178.56 \text{ mm/hr}$
 $A_{uncontrolled} = 0.03 \text{ Ha}$

$Q_{uncontrolled} = 14.89 \text{ L/s}$

Maximum Allowable Release Rate ($Q_{max\ allowable} = Q_{restricted} - Q_{uncontrolled}$)

$Q_{max\ allowable} = 125.14 \text{ L/s}$

MODIFIED RATIONAL METHOD (100-Year, 5-Year Ponding)

Drainage Area		BLDA						
Area (Ha)	0.183	Restricted Flow ICD _{BLDA} (L/s) =	30.00					
C =	1.00	Restricted Flow Q _{BLDA} (L/s) =	30.00					
50% reduction if sub-surface storage								
100-Year Ponding		100-Year +20% Ponding						
T _c Variable (min)	i _{100yr} (mm/hour)	Peak Flow Q _p = 2.78xCI _{100yr} A (L/s)	Q _r (L/s)	Q _p - Q _r (L/s)	Volume 100yr (m ³)	100YRD _p 20% (L/s)	Q _p - Q _r (L/s)	Volume 100+20 (m ³)
13	155.11	78.91	30.00	48.91	38.15			
14	148.72	75.66	30.00	45.66	36.36			
15	142.89	72.70	30.00	42.70	34.43	87.24	57.24	51.51
16	137.55	69.98	30.00	39.98	36.38			
17	132.63	67.47	30.00	37.47	38.22			

Storage (m ³)					100+20				
Overflow	Required	Surface	Sub-surface	Balance	Overflow	Required	Surface	Sub-surface	Balance
0.00	38.43	68.50	0	0.00	0.00	51.51	0.00	0.00	0.00
convert to flow with peak T _c (L/s)					convert to flow with peak T _c (L/s)				
overflows to: off site					overflows to: off site				

SWM Statistics of Modified Site Areas		
Controlled	Area	ICD Flow
BLDA	0.183	30.000
Sum	0.18	30.00
Uncontrolled	Area	Flow
UNC1+UNC2	0.078	2184
UNC3+UNC4	0.035	10.55
CB1	0.090	37.53
AD1	0.030	14.89
Sum	0.23	84.80
Total Sum	0.42	114.803
Allowable		120.00
		TRUE

Drainage Area		BLDA			
Area (Ha)	0.183	Restricted Flow Q _{BLDA} (L/s) =	30.00		
C =	0.90	Restricted Flow Q _{BLDA} (L/s) =	30.00		
5-Year Ponding					
T _c Variable (min)	i _{5yr} (mm/hour)	Peak Flow Q _p = 2.78xCI _{5yr} A (L/s)	Q _r (L/s)	Q _p - Q _r (L/s)	Volume 5yr (m ³)
6	131.57	60.24	30.00	30.24	10.89
7	123.30	56.46	30.00	26.46	11.11
8	116.11	53.16	30.00	23.16	11.12
9	109.79	50.27	30.00	20.27	10.95
10	104.19	47.71	30.00	17.71	10.62

Storage (m ³)				
Overflow	Required	Surface	Sub-surface	Balance
0.00	11.12	68.50	0	0.00
overflows to: off site				

Chetrar, Anton

From: Ghasri, Mahsa
Sent: Tuesday, October 31, 2023 1:59 PM
To: Chetrar, Anton
Cc: Labadie, Samantha; Cave, Doug; Black, Meghan
Subject: RE: Wateridge Phase 4 - Block 5, 6, 4

Hey Anton,

Block 5 (B180A in our report) is restricted to 120l/s, Block 6 (B191 is our report) is restricted at 162 l/s, and Block 4 & 7 (B322 in our report) to 200l/s. The downstream segment for overflow is to Kijigong Terrace (B191B), out of the site to the north, and Winisik Street (B190B), respectively.

Please note that we do not account for any on site storages for blocks within Wateridge.

Thank you

Mahsa Ghasri P.Eng
Water Resources Engineer
Arcadis Professional Services (Canada) Inc.
Suite 500, 333 Preston Street | Ottawa | ON | K1S 5N4 | Canada
T: +1 613 225 1311 ext 64079
www.arcadis.com



[Please note my new email address and update for your records.](#)

From: Chetrar, Anton <anton.chetrar@arcadis.com>
Sent: Tuesday, October 31, 2023 1:36 PM
To: Ghasri, Mahsa <mahsa.ghasri@arcadis.com>
Cc: Labadie, Samantha <samantha.labadie@arcadis.com>; Cave, Doug <doug.cave@arcadis.com>; Black, Meghan <meghan.black@arcadis.com>
Subject: Wateridge Phase 4 - Block 5, 6, 4

Hi Mahsa,

As discussed, we are looking to obtain the stormwater criteria for blocks 5, 6 and 4 used for the design of Wateridge Phase 4.

Let us know if you have any questions.

Thanks,
Anton Chetrar P.Eng
Civil Engineer
Arcadis Professional Services (Canada) Inc.
Suite 500, 333 Preston Street | Ottawa | ON | K1S 5N4 | Canada

T: +1 613 225 1311 ext 64072

M: +1 613 882 8197

www.arcadis.com



Please note my new email address and update for your records.

DRAINAGE AREA ID	AREA (HA)	D/S SEGMENT ID	XPSWMM NODE ID	IMP RATIO [TP (H)]	SEGMENT LENGTH (M)	SUBCATCHMENT WIDTH (M)	AVAILABLE STATIC PONDING (M ³)
S191	0.063	S192	MH191	0.71	59	118	0
S192	0.148	S193	MH192	0.71	69	137	0
S193	0.126	DITCH	MH193	0.71	39	78	0.12
P191	1.176	NORTH ⁽³⁾	MH192	0.20	133	266	0
B180A	0.418	S191B	MH190	0.86	47	95	0 ⁽¹⁾
B191	1.166	NORTH ⁽³⁾	MH193	0.86	132	263	0 ⁽¹⁾
B9	0.12	S176D	MH305	0.07	151	302	0 ⁽¹⁾
S180A	0.118	S190	MH180	0.71	57	115	7
Relevant Existing Phase 1A							
S176D	0.13	DS142 ⁽²⁾	MH176	0.76	95	95	2.60
S176E	0.09	DS142 ⁽²⁾	MH176	0.76	80	80	0
S180	0.16	DNCC ⁽⁴⁾	MH180	0.76	68	68	0

- (1) Assumed ponding volume
 (2) Existing Phase 1B
 (3) North towards existing SWM facility
 (4) West to future phase

Table 5.3 Minor Flow Capture

DRAINAGE AREA ID	CONTINUOUS/ SAG ^{(1),(2)}	ROAD TYPE	MINOR SYSTEM DESIGN TARGET	GENERATED FLOW ON INDIVIDUAL SEGMENT FOR MINOR SYSTEM DESIGN TARGET (DDSWMM SIMULATION) (L/S)	ICD (L/S)	NOTE
Phase 4						
B340A	Block	N/A	5	144	204	Minor system restriction for future development block
S319	Sag	22m Row, 8.5m asphalt	5	26	38	
B319	Block	N/A	100	398	490	Minor system restriction for future development block
S320	Continuous	22m Row, 8.5m asphalt	5	32	12	CB on continuous grade, capture in downstream sag
S322	Continuous	22m Row, 8.5m asphalt	5	30	25	CB on continuous grade, capture in downstream sag
B322	Block	N/A	5	200	200	Minor system restriction for future development block
S190	Sag	22m Row, 8.5m asphalt	5	17	76	
S190A	Continuous	22m Row, 8.5m asphalt	5	21	24	CB on continuous grade, capture in downstream sag

DRAINAGE AREA ID	CONTINUOUS/ SAG ^{(1),(2)}	ROAD TYPE	MINOR SYSTEM DESIGN TARGET	GENERATED FLOW ON INDIVIDUAL SEGMENT FOR MINOR SYSTEM DESIGN TARGET (DDSWMM SIMULATION) (L/S)	ICD (L/S)	NOTE
S190B	Sag	22m Row, 8.5m asphalt	5	19	24	
S191A	Sag	22m Row, 8.5m asphalt	5	7	63	
S191B	Continuous	22m Row, 8.5m asphalt	5	19	19	CB on continuous grade, capture in downstream sag
S191	Continuous	22m Row, 8.5m asphalt	5	23	19	
S192	Continuous	22m Row, 8.5m asphalt	5	25	12	
S193	Sag	22m Row, 8.5m asphalt	5	21	86	
P191	Park	N/A	5	22	24	
B180A	Block	N/A	5	145	120	Minor system restriction for future development block
B191	Block	N/A	5	162	162	Minor system restriction for future development block
B9	Park	N/A	5	12	0	No CBs located in this green space block
S180A	Sag	22m Row, 8.5m asphalt	5	21	25	
Relevant Existing Phase 1A						
S176D	Sag	26m Row, 9.5m asphalt	5		37	Replacing existing ICDs
S176E	Continuous	26m Row, 9.5m asphalt	5		11.4	ICD(s) installed
S180	Continuous	26m Row, 9.5m asphalt	5		16.3	ICD(s) installed

(1) Capture on continuous grade is limited to capacity of grate

(2) The minor flow restriction has been increased in sags to allow full capture of overflow from upstream segments on continuous grade during the design storm event without ponding.

5.4.3 Results of Hydrological Modeling

5.4.3.1 Street Segment Storage

The storage available on-site storage and the results of the DDSWMM major system evaluation for the design storm are presented in **Table 5.4**. The ponding plan for the subject site is presented in **Appendix F** on **Drawings 601**. The DDSWMM output files are presented in **Appendix F**.



Adjustable Accutrol Weir

Tag: _____

Adjustable Flow Control for Roof Drains



ADJUSTABLE ACCUTROL (for Large Sump Roof Drains only)

For more flexibility in controlling flow with heads deeper than 2", Watts Drainage offers the Adjustable Accutrol. The Adjustable Accutrol Weir is designed with a single parabolic opening that can be covered to restrict flow above 2" of head to less than 5 gpm per inch, up to 6" of head. To adjust the flow rate for depths over 2" of head, set the slot in the adjustable upper cone according to the flow rate required. Refer to Table 1 below.
 Note: Flow rates are directly proportional to the amount of weir opening that is exposed.

EXAMPLE:

For example, if the adjustable upper cone is set to cover 1/2 of the weir opening, flow rates above 2" of head will be restricted to 2-1/2 gpm per inch of head.

Therefore, at 3" of head, the flow rate through the Accutrol Weir that has 1/2 the slot exposed will be:
 [5 gpm (per inch of head) x 2 inches of head] + 2-1/2 gpm (for the third inch of head) = 12-1/2 gpm.

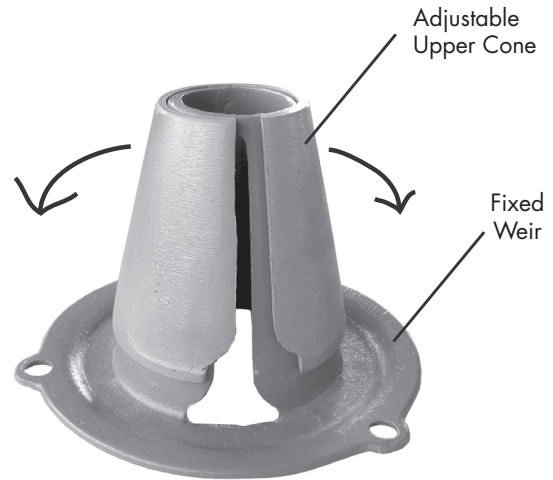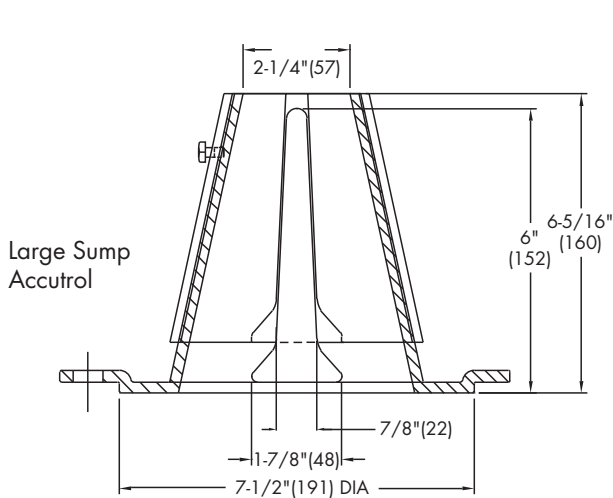

1/2 Weir Opening Exposed Shown Above

TABLE 1. Adjustable Accutrol Flow Rate Settings

Weir Opening Exposed	1"	2"	3"	4"	5"	6"
	Flow Rate (gallons per minute)					
Fully Exposed	5	10	15	20	25	30
3/4	5	10	13.75	17.5	21.25	25
1/2	5	10	12.5	15	17.5	20
1/4	5	10	11.25	12.5	13.75	15
Closed	5	5	5	5	5	5

Job Name _____
 Job Location _____
 Engineer _____

Contractor _____
 Contractor's P.O. No. _____
 Representative _____


Watts product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.

USA: Tel: (800) 338-2581 • Fax: (828) 248-3929 • Watts.com
 Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • Watts.ca
 Latin America: Tel: (52) 81-1001-8600 • Fax: (52) 81-8000-7091 • Watts.com



A Watts Water Technologies Company

APPENDIX E


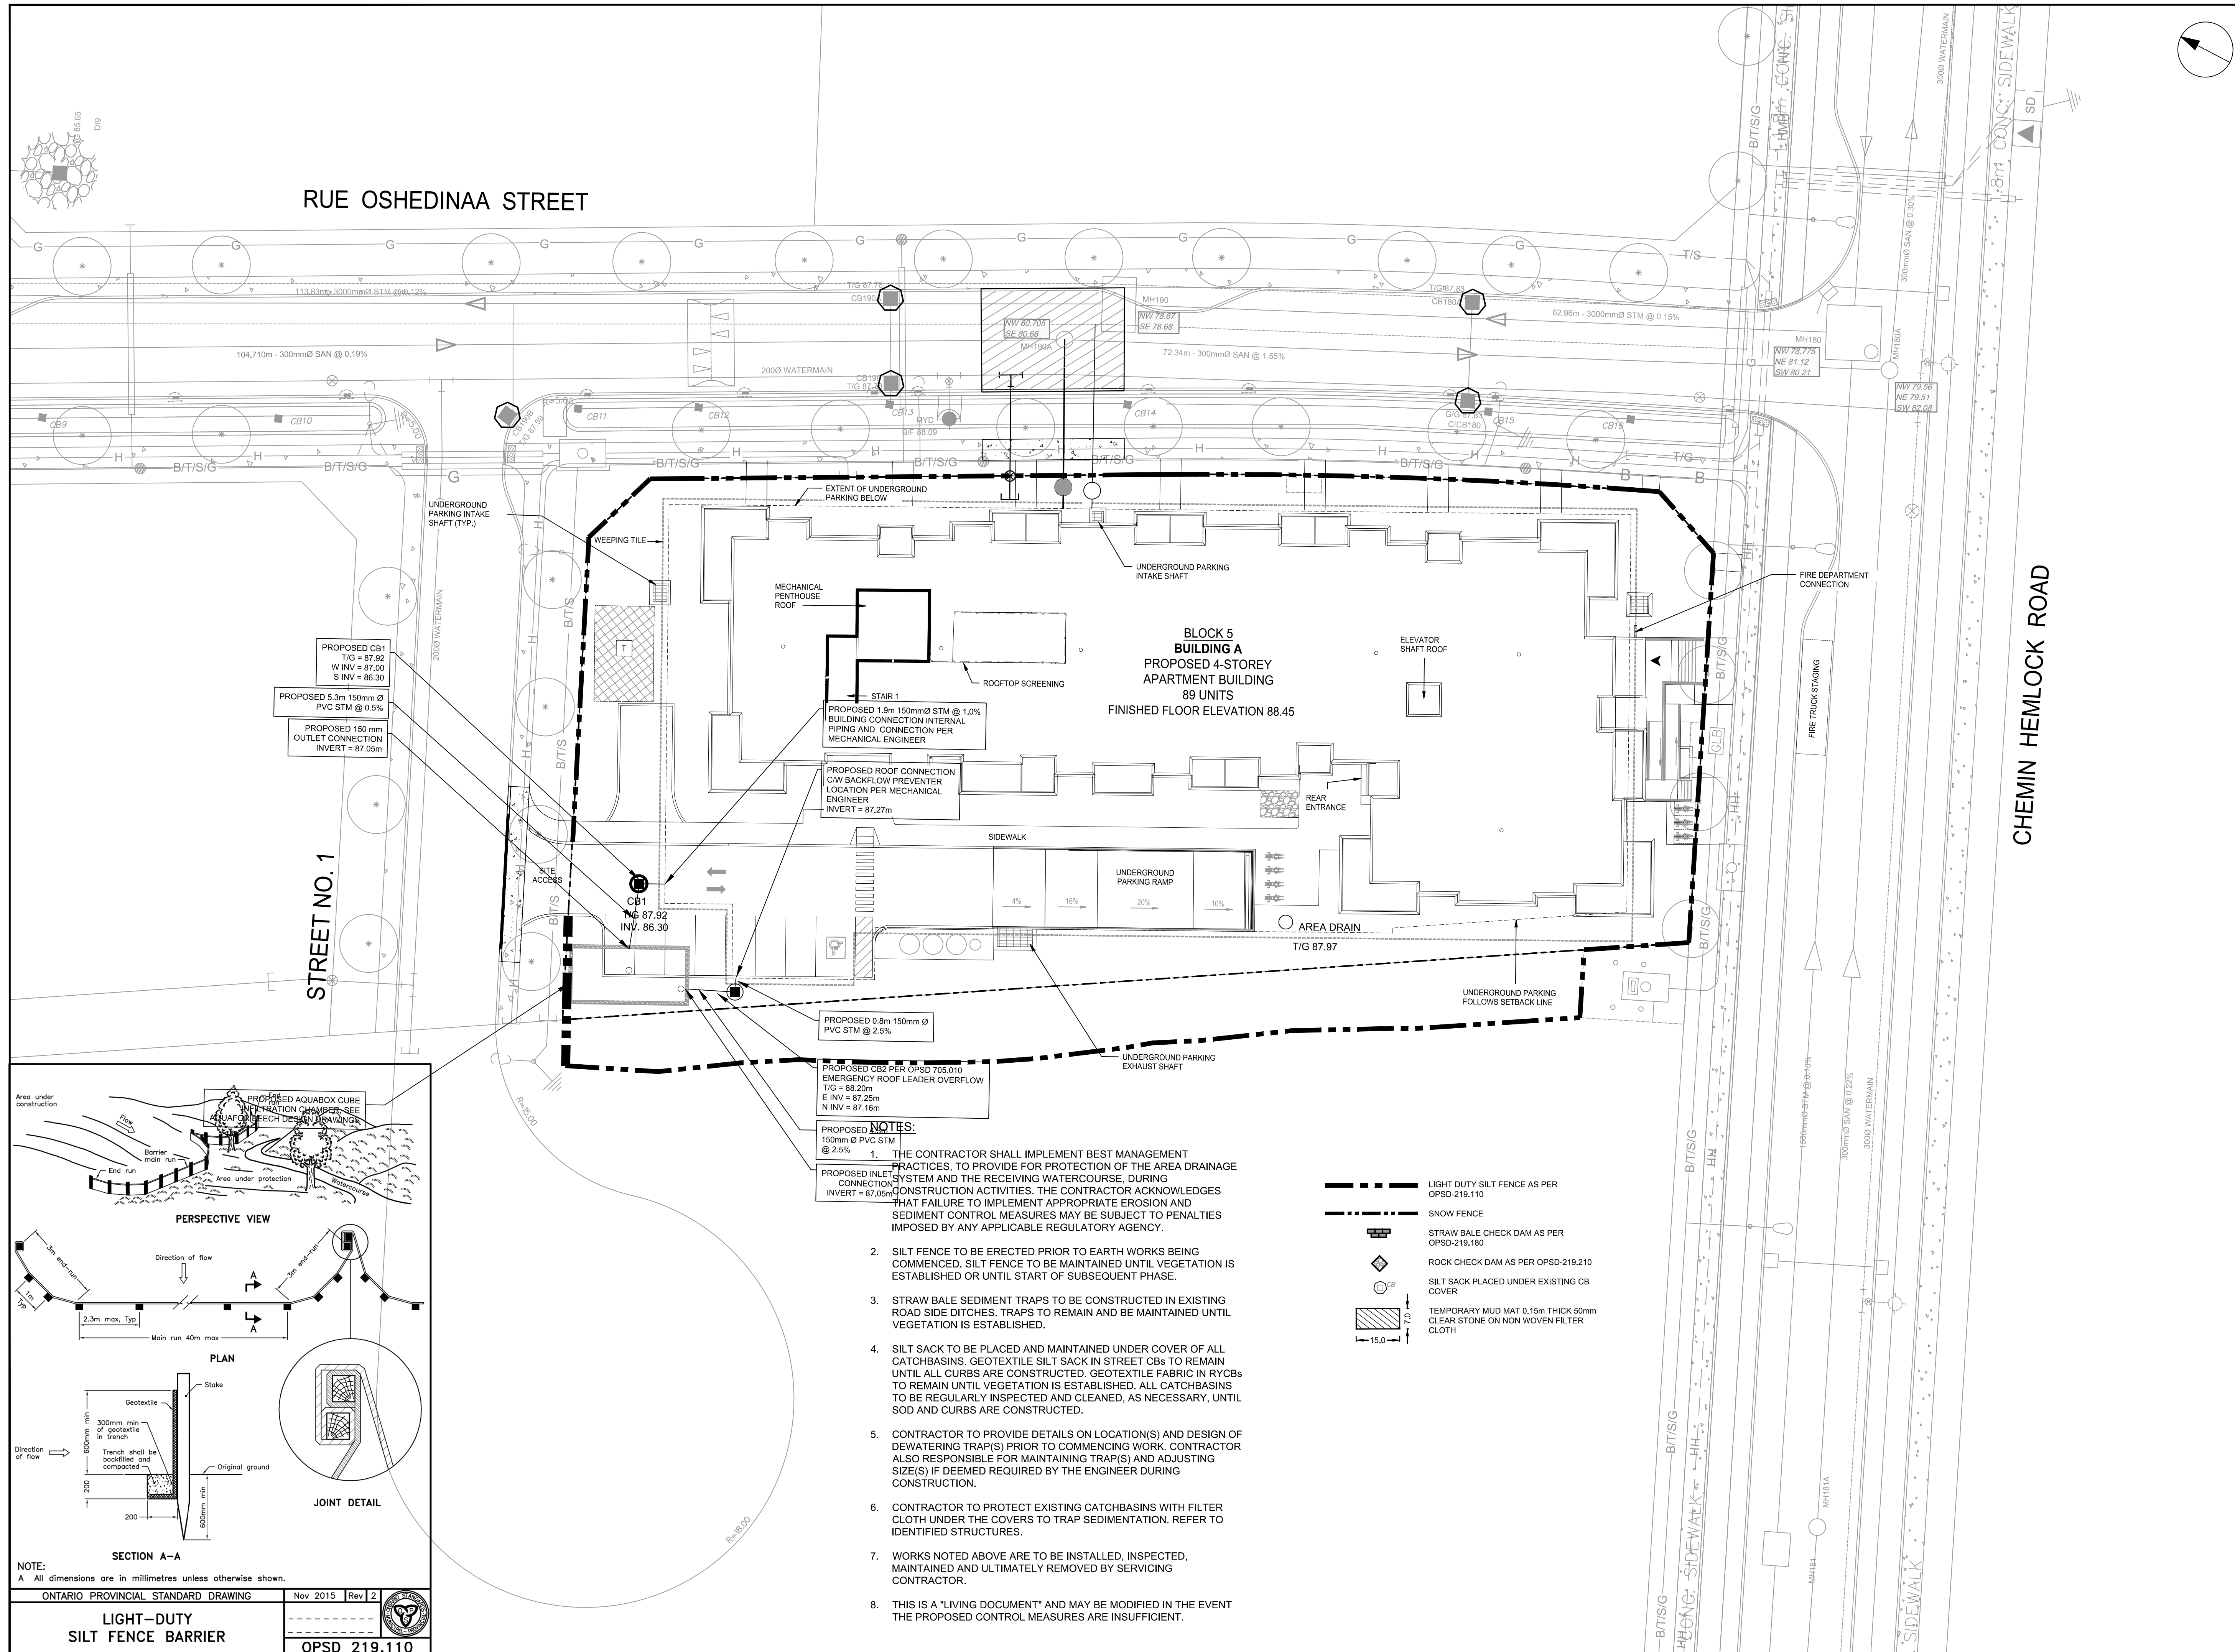


CLIENT
ROHIT GROUP
15 FITZGERALD ROAD, NEPEAN, ON

COPYRIGHT
This drawing has been prepared solely for the intended use, thus any reproduction or distribution for any purpose other than authorized by Arcadis is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and Arcadis shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to Arcadis for general conformance before proceeding with fabrication.

Arcadis Professional Services (Canada) Inc.
Formerly BSI Group Professional Services (Canada) Inc.

ISSUES		
No.	DESCRIPTION	DATE
1	SUBMISSION NO.1 FOR CITY REVIEW	2023-12-08
2	SUBMISSION NO.2 FOR CITY REVIEW	2024-03-04
3	SUBMISSION NO.3 FOR CITY REVIEW	2024-05-01
4	NEW SITE PLAN	2024-08-07
5		
6		
7		
8		

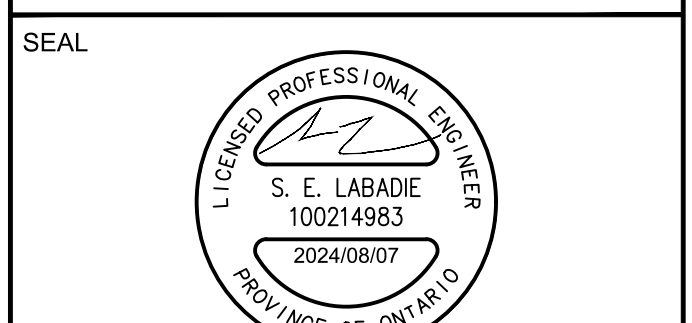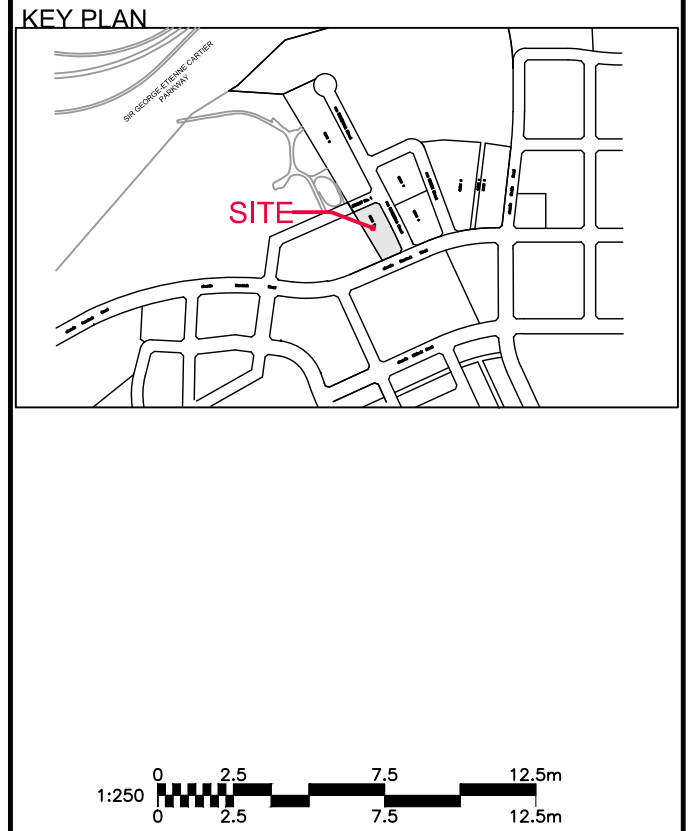


PRIME CONSULTANT
ARCADIS
333 Preston Street - Suite 500
Ottawa ON K1S 5N4 Canada
tel 613 225 1311
www.arcadis.com

PROJECT
WATERIDGE VILLAGE AT ROCKCLIFFE
PHASE 4 - BLOCK 5

PROJECT NO:
143934
DRAWN BY:
M.M.
PROJECT MGR:
D.C.
CHECKED BY:
D.C.
APPROVED BY:
A.C.

SHEET TITLE
SEDIMENT AND EROSION CONTROL PLAN

SHEET NUMBER
C-900
ISSUE
4

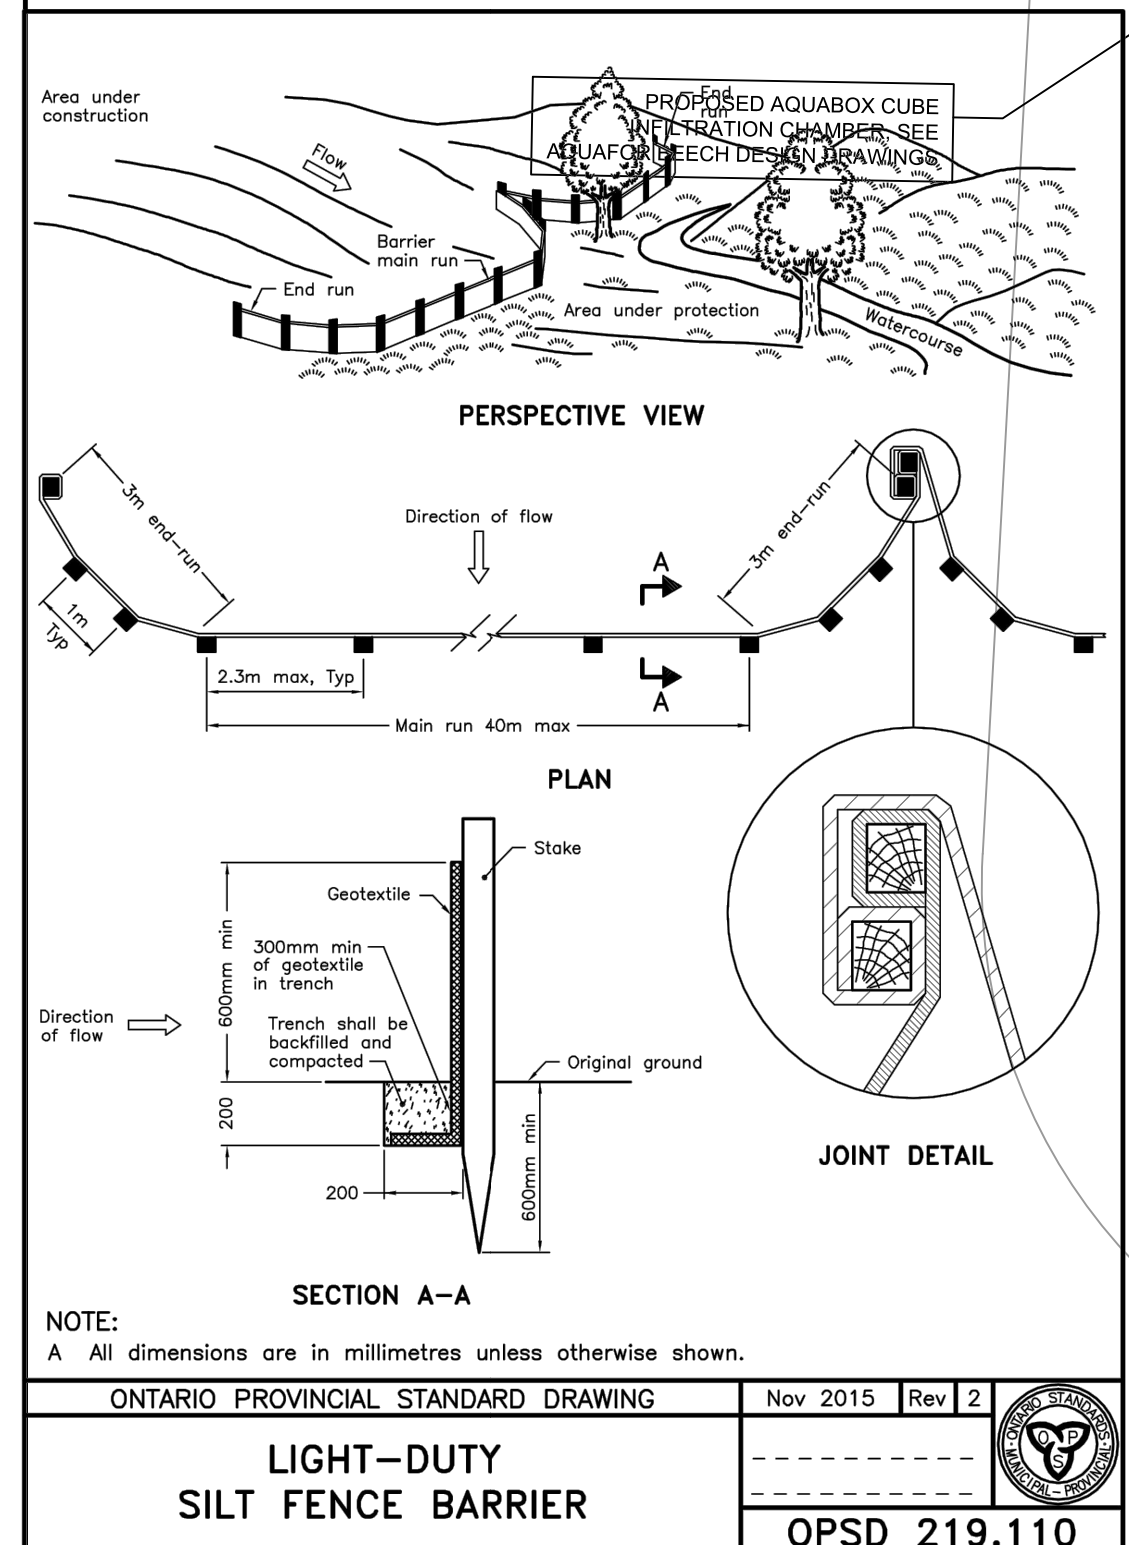


- PROPOSED NOTES:**
1. THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE, DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
 2. SILT FENCE TO BE ERRECTED PRIOR TO EARTH WORKS BEING COMMENCED. SILT FENCE TO BE MAINTAINED UNTIL VEGETATION IS ESTABLISHED OR UNTIL START OF SUBSEQUENT PHASE.
 3. STRAW BALE SEDIMENT TRAPS TO BE CONSTRUCTED IN EXISTING ROAD SIDE DITCHES. TRAPS TO REMAIN AND BE MAINTAINED UNTIL VEGETATION IS ESTABLISHED.
 4. SILT SACK TO BE PLACED AND MAINTAINED UNDER COVER OF ALL CATCHBASINS. GEOTEXTILE SILT SACK IN STREET CBS TO REMAIN UNTIL ALL CURBS ARE CONSTRUCTED. GEOTEXTILE FABRIC IN RYCBS TO REMAIN UNTIL VEGETATION IS ESTABLISHED. ALL CATCHBASINS TO BE REGULARLY INSPECTED AND CLEANED, AS NECESSARY, UNTIL SOD AND CURBS ARE CONSTRUCTED.
 5. CONTRACTOR TO PROVIDE DETAILS ON LOCATION(S) AND DESIGN OF DEWATERING TRAP(S) PRIOR TO COMMENCING WORK. CONTRACTOR ALSO RESPONSIBLE FOR MAINTAINING TRAP(S) AND ADJUSTING SIZE(S) IF DEEMED REQUIRED BY THE ENGINEER DURING CONSTRUCTION.
 6. CONTRACTOR TO PROTECT EXISTING CATCHBASINS WITH FILTER CLOTH UNDER THE COVERS TO TRAP SEDIMENTATION. REFER TO IDENTIFIED STRUCTURES.
 7. WORKS NOTED ABOVE ARE TO BE INSTALLED, INSPECTED, MAINTAINED AND ULTIMATELY REMOVED BY SERVICING CONTRACTOR.
 8. THIS IS A "LIVING DOCUMENT" AND MAY BE MODIFIED IN THE EVENT THE PROPOSED CONTROL MEASURES ARE INSUFFICIENT.

- LIGHT DUTY SILT FENCE AS PER OPSD-219.110
- SNOW FENCE
- STRAW BALE CHECK DAM AS PER OPSD-219.180
- ROCK CHECK DAM AS PER OPSD-219.210
- SILT SACK PLACED UNDER EXISTING CB COVER
- TEMPORARY MUD MAT 0.15m THICK 50mm CLEAR STONE ON NON WOVEN FILTER CLOTH

NOTE:
A All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING
Nov 2015 Rev 2
LIGHT-DUTY SILT FENCE BARRIER
OPSD 219.110

File Location: J:\143934_Block_5_Phase_4\0_Production\203_Design\04_Civil\Sheet\C-900_erosion and sediment control plan.dwg
 Last Saved: January 30, 2024, by M.Miline
 Plotted: Wednesday, August 7, 2024, 2:07:34 PM by Marian Milne
 D07-XX-XX-XXXX
 XXXXX

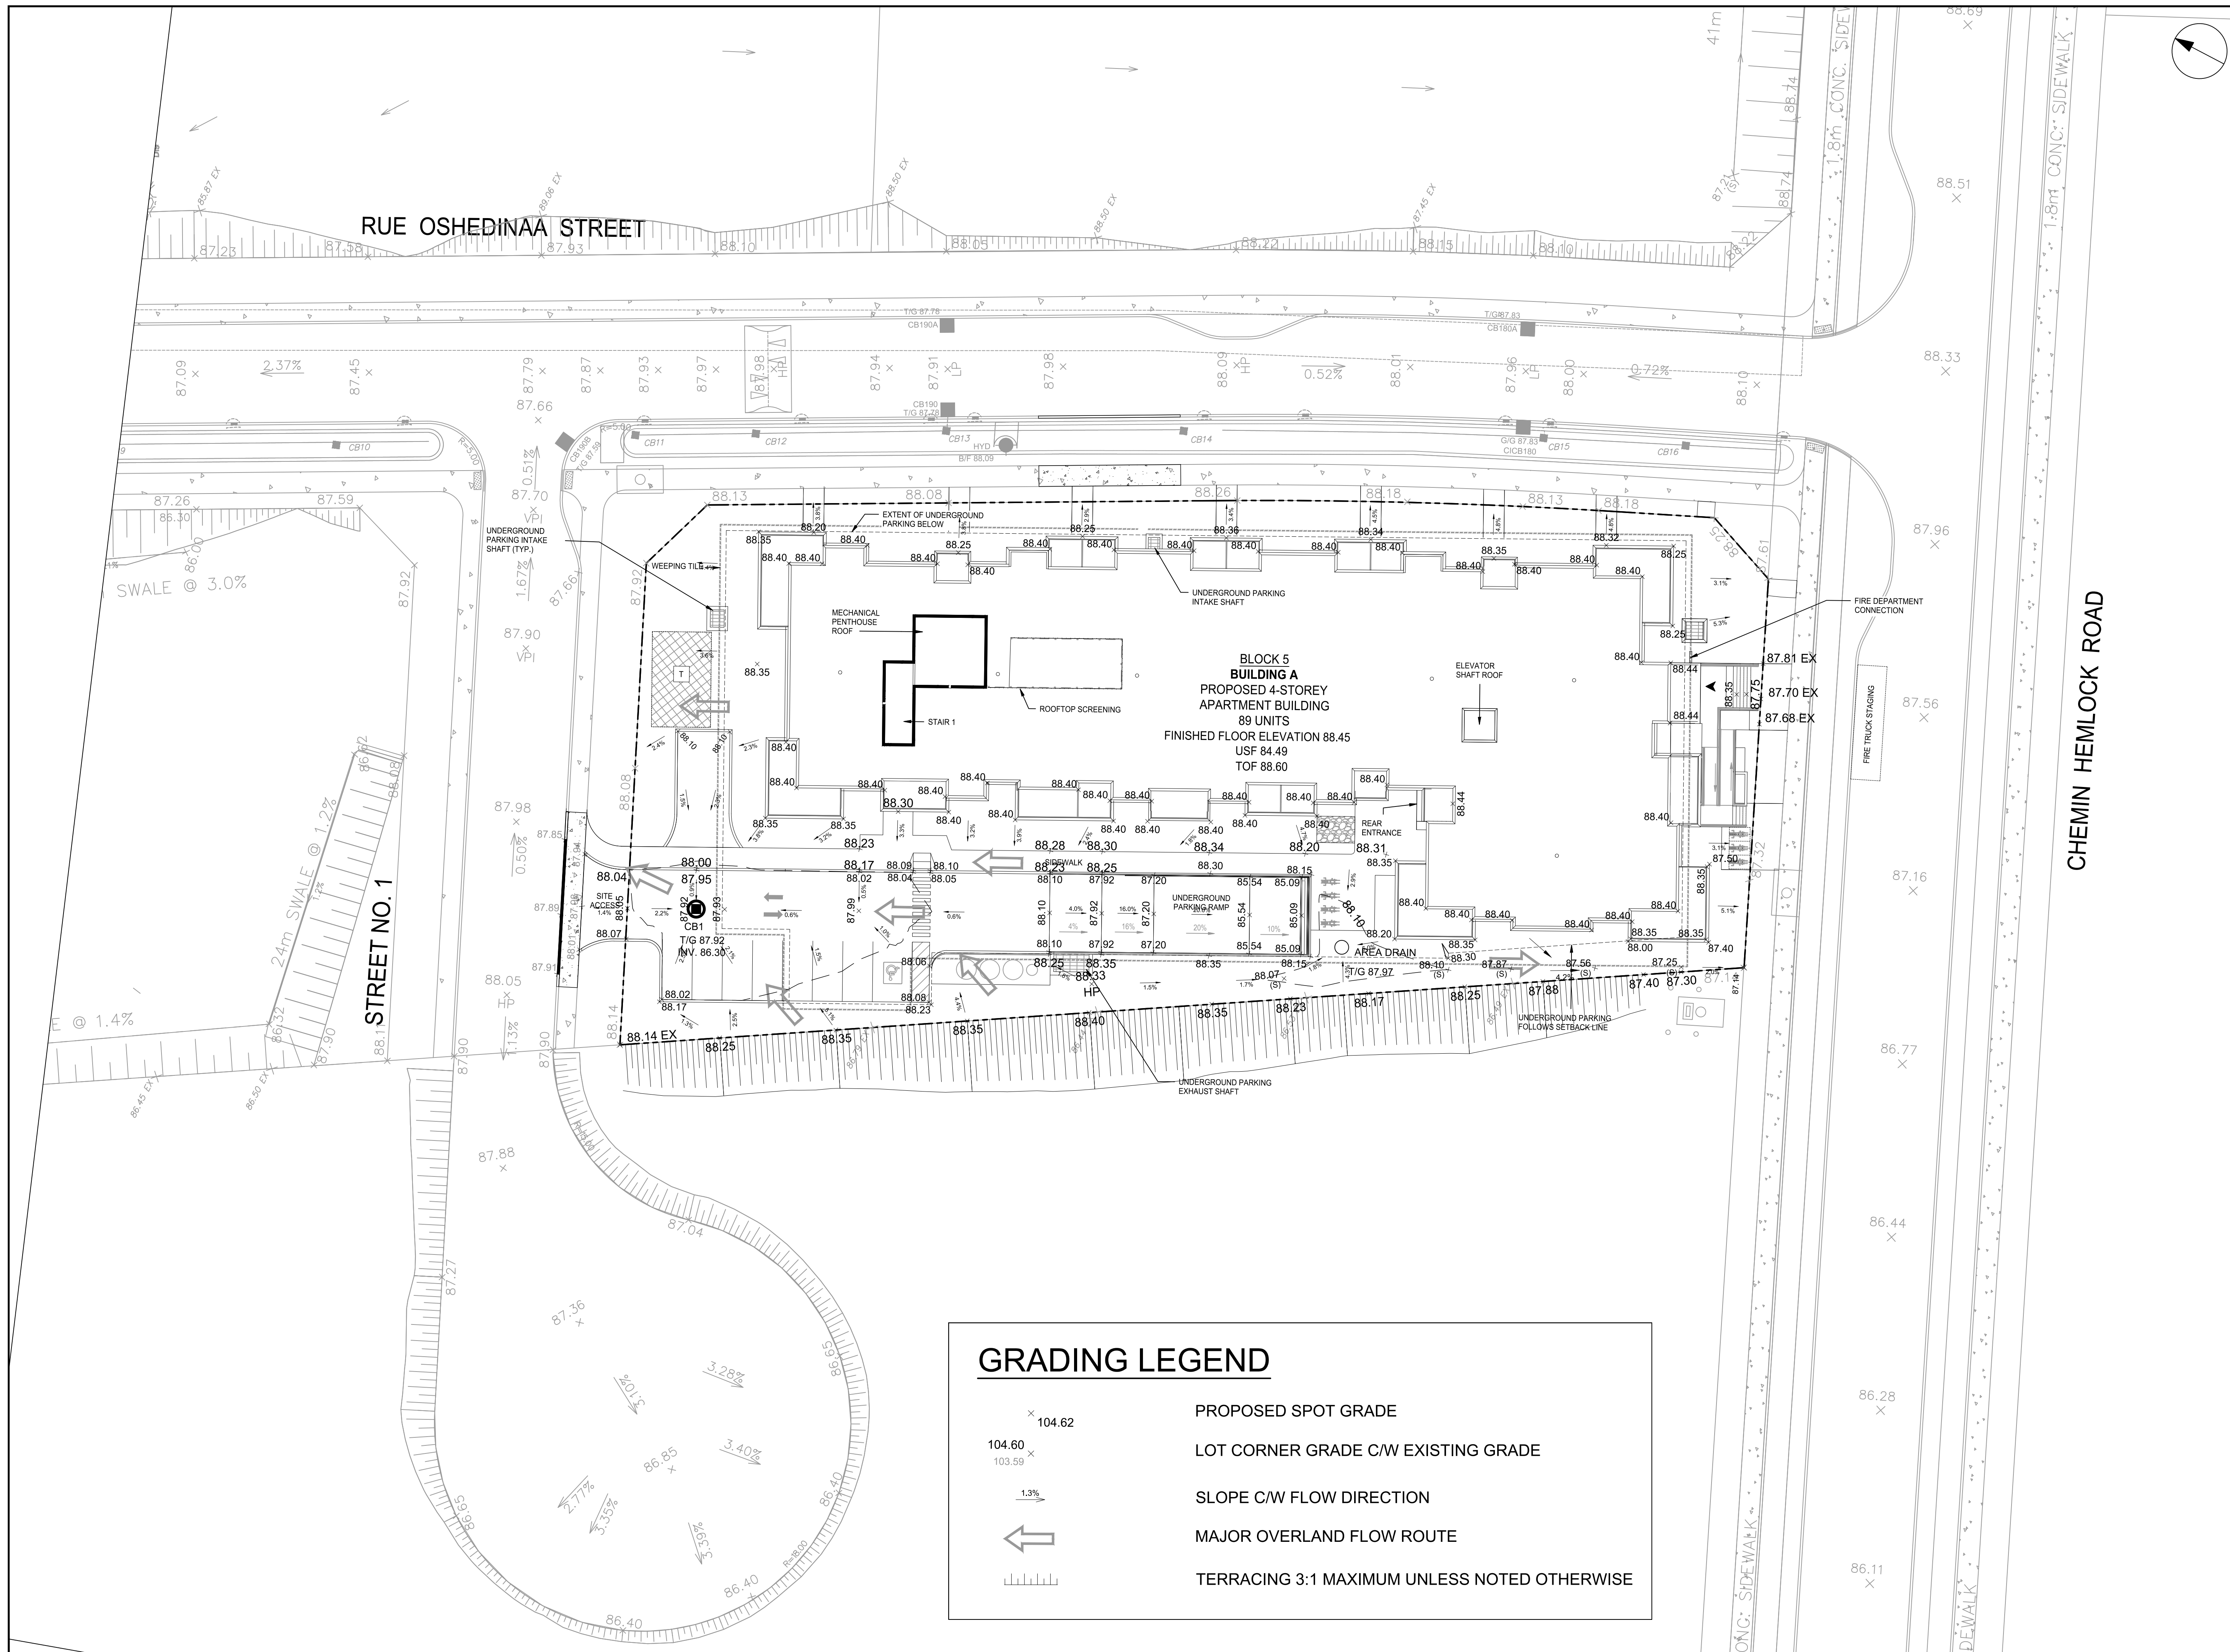

CLIENT
ROHIT GROUP
 15 FITZGERALD ROAD, NEPEAN, ON

COPYRIGHT
 This drawing has been prepared solely for the intended use, thus any reproduction or distribution for any purpose other than authorized by Arcadis is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and Arcadis shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to Arcadis for general conformance before proceeding with fabrication.

Arcadis Professional Services (Canada) Inc.
 Formerly BSI Group Professional Services (Canada) Inc.

ISSUES		
No.	DESCRIPTION	DATE
1	ISSUED FOR CLIENT REVIEW	2023-11-22
2	SUBMISSION NO.1 FOR CITY REVIEW	2023-12-08
3	SUBMISSION NO.2 FOR CITY REVIEW	2024-03-04
4	SUBMISSION NO.3 FOR CITY REVIEW	2024-05-01
5	NEW SITE PLAN	2024-08-07
6		
7		
8		

KEY PLAN

SCALE
 1:250

SEAL

CONFIRM PRIME CONSULTANT
ARCADIS
 333 Preston Street - Suite 500
 Ottawa ON K1S 5N4 Canada
 tel 613 225 1311
 www.arcadis.com

PROJECT
WATERIDGE VILLAGE AT ROCKCLIFFE
 PHASE 4 - BLOCK 5

PROJECT NO: 143934

DRAWN BY: M.M.	CHECKED BY: D.C.
PROJECT MGR: D.C.	APPROVED BY: A.C.

SHEET TITLE
GRADING PLAN

SHEET NUMBER C-200	ISSUE 5
------------------------------	-------------------

GRADING LEGEND

- PROPOSED SPOT GRADE
- LOT CORNER GRADE C/W EXISTING GRADE
- SLOPE C/W FLOW DIRECTION
- MAJOR OVERLAND FLOW ROUTE
- TERRACING 3:1 MAXIMUM UNLESS NOTED OTHERWISE

File Location: J:\143934_Block_5_Plan_4770_Production\103_Design\04_Civil\Sheets\C-200 GRADING PLAN.dwg Last Saved: August 7, 2024, by M.Milne Plotted: Wednesday, August 7, 2024 2:05:43 PM by Marian Milne
 D07-XX-XX-XXXX
 XXXXX

