



Geotechnical Investigation

Proposed Warehouse
363 Entrepreneur Crescent
Navan, Ontario
Revision 2

Prepared for:

Entrepreneur Holding Corporation
363 Entrepreneur Crescent
Navan, Ontario
K4B 1T8

LRL File No.: 220487

February 2023, *Revised: December 2024*



TABLE OF CONTENTS

1	INTRODUCTION	1
2	SITE AND PROJECT DESCRIPTION	1
3	PROCEDURE	1
4	SUBSURFACE SOIL AND GROUNDWATER CONDITIONS	2
4.1	General	2
4.2	Fill Material	3
4.3	Silty Sand	3
4.4	Clayey Silt	3
4.5	Silty Clay	3
4.6	Inferred Glacial Till	3
4.7	Refusal	3
4.8	Laboratory Analysis	3
4.9	Groundwater Conditions	5
5	GEOTECHNICAL CONSIDERATIONS	5
5.1	Foundations	5
5.2	Shallow Foundation	5
5.2.1	Ground Improvement	6
5.3	Grade Raise Restriction	6
5.4	Structural Fill	6
5.5	Lateral Earth Pressure	6
5.6	Settlement	7
5.7	Seismic	7
5.8	Liquefaction Potential	7
5.9	Frost Protection	8
5.10	Foundation Drainage	8
5.11	Foundation Walls Backfill (Shallow Foundations)	8
5.12	Slab-on-grade Construction	8
5.13	Corrosion Potential and Cement Type	9
5.14	Other Considerations	9
6	EXCAVATION AND BACKFILLING REQUIREMENTS	9



6.1	Excavation.....	9
6.2	Groundwater Control.....	10
6.3	Pipe Bedding Requirements	10
6.4	Trench Backfill.....	11
7	REUSE OF ON-SITE SOILS.....	11
8	RECOMMENDED PAVEMENT STRUCTURE.....	12
8.1	Paved Areas & Subgrade Preparation.....	12
9	INSPECTION SERVICES	13
10	REPORT CONDITIONS AND LIMITATIONS.....	13

LIST OF TABLES

Table 1 – Gradation Analysis Summary.....	4
Table 2 – Summary of Atterberg Limits and Water Contents	4
Table 3 – One-Dimensional Consolidation Test Results.....	4
Table 4 – Material and Earth Pressure Properties.....	6
Table 5 – Results of Chemical Analysis.....	9
Table 6 – Recommended Pavement Structure.....	12

APPENDICES

Appendix A	Site and Borehole Location Plans
Appendix B	Borehole Logs
Appendix C	Symbols and Terms Used in Borehole Logs
Appendix D	Lab Results
Appendix E	Supporting Documentation – Phase II ESA Borehole Logs



1 INTRODUCTION

LRL Associates Ltd. (LRL) was retained by Dustin Wilson of Entrepreneur Holding Corporation to perform a geotechnical investigation for a proposed warehouse, to be located at 363 Entrepreneur Crescent, Navan, Ontario.

The purpose of the investigation was to identify the subsurface conditions across the site by the completion of a limited borehole drilling program. Based on the visual and factual information obtained, this report will provide guidelines on the geotechnical engineering aspects of the design of the project, including construction considerations.

This report has been prepared in consideration of the terms and conditions noted above. Should there be any changes in the design features, which may relate to the geotechnical recommendations provided in the report, LRL should be advised in order to review the report recommendations.

2 SITE AND PROJECT DESCRIPTION

The site under investigation is civically located at 363 Entrepreneur Crescent, in Navan, Ontario. Currently the site is vacant of any structures, but is currently being used as a storage yard by the adjacent property for construction equipment and vehicles. The approximate location is presented in Figure 1 included in **Appendix A**. The lot is approximately rectangular in shape, having about 35 m of frontage, and a depth of about 80 m. The site is bound by 357 Entrepreneur Crescent to the east, Entrepreneur Crescent to the south, 371 Entrepreneur Crescent to the west, and 5425 Boundary Road to the north. At the time of carrying out the field work, the site was covered by a thin layer of snow. The topography of the site is considered to be relatively flat. Access to the site will come by way of Entrepreneur Crescent.

It is understood that development on this site will consist of construction of a 15,000 ft² warehouse, with no basement. The structure will be a pre-engineered building, supported by a conventional shallow foundation. The building will be serviced with a well and septic system.

3 PROCEDURE

The initial fieldwork for this investigation was carried out on November 17, 2022. Prior to the fieldwork, the site was cleared for the presence of any underground services and utilities. A total of four (4) boreholes, labelled BH1 through BH4, were drilled across the site to get a general understanding of the site's soil conditions.

A subsequent borehole, labelled BH5, was advanced on July 3, 2024. The purpose of this borehole was to extract a Shelby Tube for consolidation testing.

The approximate locations of the boreholes are shown in Figure 2 included in **Appendix A**.

The boreholes were advanced using a track mount CME 75 drill rig equipped with 200 mm diameter continuous flight hollow stem auger supplied and operated by CCC Geotechnical and Environmental Drilling Ltd. A "two person" crew experienced with geotechnical drilling operated the drill rig and equipment.



Sampling of the overburden materials encountered in the boreholes was carried out at regular depth intervals using a 50.8 mm diameter drive open conventional spoon sampler in conjunction with standard penetration testing (SPT) “N” values. The SPT were conducted following the method **ASTM D1586** and the results of SPT, in terms of the number of blows per 0.3 m of split-spoon sampler penetration after first 0.15 m designated as “N” value.

In-situ field vane shear testing, including remoulds, using a tapered vane was carried out in the soft to very soft cohesive soils. The undrained shear strength values were calculated following **ASTM D 2573**.

The boreholes were augered and sampled to a depth of 6.21 and 7.00 m below ground surface (bgs). A Dynamic Cone Penetration (DCP) test was carried out in BH2 until refusal (24.50 m bgs) to determine the overburden thickness. Upon completion, the boreholes were backfilled using the overburden cuttings.

The fieldwork was supervised throughout by a member of our engineering staff who oversaw the drilling activities, cared for the samples obtained and logged the subsurface conditions encountered within each of the boreholes. All soil samples collected from the boreholes were placed and sealed in plastic bags to prevent moisture loss. The recovered soil samples collected from the boreholes were classified based on visual examination of the materials recovered and the results of the in-situ testing.

Furthermore, all boreholes were located using a Garmin Etrex Legend GPS (Global Positioning System) receiver using NAD 83 datum (North American Datum). An elevation survey was carried out onsite to determine the borehole locations’ elevation. A Temporary Benchmark (TBM) was assigned using the top of the culvert located at the southwest of driveway entrance, and given an elevation of 100.00 m. Ground surface elevations of the boring locations are shown on their respective borehole logs, attached in **Appendix B**.

4 SUBSURFACE SOIL AND GROUNDWATER CONDITIONS

4.1 General

A review of local surficial geology maps provided by the Department of Energy, Mines and Resources Canada suggest that this site consists of a “Champlain Sea Deposits” consisting of blue-grey clay, silt, and silty clay.

The subsurface conditions encountered in the boreholes were classified based on visual and tactile examination of the materials recovered from the boreholes and the results of in-situ laboratory testing. The soil descriptions presented in this report are based on commonly accepted methods of classification and identification employed in geotechnical practice. Classification and identification of soil were conducted according to the procedure **ASTM D2487** and judgement, and LRL does not guarantee descriptions as exact, but infers accuracy to the extent that is common in current geotechnical practice.

The subsurface soil conditions encountered at the boreholes are given in their respective logs presented in **Appendix B**. A greater explanation of the information presented in the borehole logs can be found in **Appendix C** of this report. These logs indicate the subsurface conditions encountered at a specific test location only. Boundaries between zones on the logs are often not distinct, but are rather transitional and have been interpreted as such.



4.2 Fill Material

Fill material consisting of a crushed stone granular material was encountered at the surface of all boring locations, and extended to depths ranging between 0.60 and 1.07 m bgs. The recorded SPT “N” values of this deposit varied from 30 to 36, indicating the deposit is dense. The natural moisture contents were found to be 9 and 11%.

4.3 Silty Sand

Underlying the fill material at all boring locations, a layer of brown silty sand was encountered and extended to a depth of 1.45 m bgs. The recorded SPT “N” values of this deposit varied from 14 to 19, indicating the deposit is compact. The natural moisture contents were found to be 22 and 24%.

4.4 Clayey Silt

Below the silty sand in all boring locations, a layer of clayey silt was encountered and extended to a depth of 4.12 m bgs. This material contained trace sand, grey and wet. The SPT “N” values were found to range between 0 (weight of hammer (WH)) and 4, indicating the material is soft to very soft. The natural moisture contents were determined to range between 37 and 87%.

4.5 Silty Clay

Underlying the clayey silt in all boring locations, a layer of silty clay was encountered and extended to the end of sampling at a depth of 7.00 m bgs. This was found to be grey, and wet. The SPT “N” values of this layer were WH, indicating the material is very soft. The natural moisture contents were determined to be 76 and 90%.

In-situ testing consisting of initial/undisturbed vane shear and remould vane shear testing was carried out within the silty clay deposit. The initial undrained shear strength values were found to range between 20 kPa and 44 kPa. The remould values were found to range between 6 kPa and 8 kPa.

These values indicate the sensitivity of the silty clay ranges between 3 and 6; this equates to a “medium sensitivity to very sensitive” of the deposit.

4.6 Inferred Glacial Till

Inferred glacial till was encountered in BH2 by way of the DCP test. This was found to be in a compact to very dense state of packing.

4.7 Refusal

Refusal using the DCP test was encountered in BH2 at a depth of 24.50 m bgs. This was encountered over a large boulder within the till material or possible bedrock.

4.8 Laboratory Analysis

Four (4) soil samples were collected for laboratory gradation analyses. The gradation analyses comprised of sieve and hydrometer were conducted following the procedure **ASTM D422**. Details of laboratory analyses are reflected in **Table 1**.



Table 1: Gradation Analysis Summary

Sample Location	Depth (m)	Percent for Each Soil Gradation					Estimated Hydraulic Conductivity K (m/s)
		Sand			Silt (%)	Clay (%)	
		Coarse (%)	Medium (%)	Fine (%)			
BH1	1.52 – 2.13	0.4	0.8	4.1	59.3	35.4	5×10^{-8}
BH2	6.10 – 6.71	0.0	0.0	0.6	31.0	68.4	5×10^{-8}
BH5	1.52 – 2.13	0.0	0.1	3.1	29.5	67.3	5×10^{-8}
BH5	3.05 – 3.66	0.0	0.0	1.2	31.7	67.1	5×10^{-8}

Atterberg limits and moisture contents were conducted on three (3) split spoon soil samples. A summary of these values are provided below in **Table 2**.

Table 2: Summary of Atterberg Limits and Water Contents

Sample Location	Parameter						
	Depth (m)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Water Content (%)	Liquidity Index	USCS Group Symbol
BH3	4.57 – 5.18	61	23	38	90	1.75	CH
BH4	1.52 – 2.13	67	25	42	77	1.24	CH
BH5	1.52 – 2.13	84	27	57	79	0.90	CH

One dimensional consolidation test of soil using incremental loading was performed on a silty clay sample taken from a Shelby tube collected from BH5 at depth between 4.6 and 5.2 m bgs following the procedure **ASTM D2435**, the results are tabulated in **Table 3**.

Table 3: One-Dimensional Consolidation Test Results

Sample Location	Depth (m)	Effective Overburden Pressure (kPa)	Pre-consolidation Pressure (kPa)	Over-consolidation Pressure (kPa)	Initial Moisture Content (%)	Initial Void Ratio
BH5	4.9	45.0	90.0	45.0	41.5	2.15

The consolidation test was performed by Stantec. The consolidation test results revealed that the silty clay is over consolidated, which is typical for silty clay deposits found in the Ottawa region. A pre-consolidation pressure taken at depth between 4.6 and 5.2 m was calculated based on the consolidation curve and was found to be approximately 90.0 kPa with an over-consolidation deviation of about 45.0 kPa. The effective overburden pressure is directly affected by groundwater level. The groundwater level was assumed to be 0.30 m below grade. Lowering of groundwater level will increase the overburden pressure and therefore available pre-consolidation pressure will reduce. If the groundwater is lowered by a significant amount, unacceptable settlement may be induced.

The laboratory reports can be found in **Appendix D** of this report.

4.9 Groundwater Conditions

A piezometer was installed in BH3 to measure the static groundwater level. The piezometer consisted of a 19 mm diameter PVC pipe with a slotted bottom to allow for groundwater infiltration, backfilled with silica sand, and sealed with bentonite. The water was measured on December 6, 2022 and found to be at 0.50 m bgs.

Furthermore, groundwater levels encountered in the monitoring wells installed for the Phase II ESA were also considered as part of this Geotechnical Report. Groundwater levels ranged between 0.20 and 0.55 m bgs.

These values indicate in the groundwater level for the site ranges between 0.20 and 0.55 m bgs.

The Borehole Logs from the Phase II ESA can be found attached to this report in **Appendix E – Supporting Documentation**.

It should be noted that groundwater levels could fluctuate with seasonal weather conditions, (i.e.: rainfall, droughts, spring thawing) and due to construction activities at or in the vicinity of the site.

5 GEOTECHNICAL CONSIDERATIONS

This section of the report provides general geotechnical recommendations for the design aspect of the project based on our interpretation of the information gathered from the boreholes performed at this site and from the project requirements.

This section will detail the specific requirements and limitations with regard to allowable foundation bearing pressure and depth, grade raise and size of the footings.

5.1 Foundations

Based on the subsurface soil conditions established at this site, it is expected that the footings for the proposed warehouse will be founded below the frost penetration depth, overlying the native silty sand and/or clayey silt. Therefore, all fill material including incompetent native soil should be removed from the proposed footprint down to the required founding depth.

5.2 Shallow Foundation

Conventional strip and column footings founded over the undisturbed native silty sand and/or clayey silt may be designed using a maximum allowable bearing pressure of **50 kPa** for serviceability limit state (**SLS**) and **75 kPa** for ultimate limit state (**ULS**) factored bearing resistance. The factored ULS value includes the geotechnical resistance factor of 0.5. The maximum footing widths for strip and pad footings is 2.0 and 4.0 m respectively.

In-situ field testing is required to check the strength and stability of the footings subgrade. Any incompetent subgrade areas as identified from in-situ testing must be sub-excavated and backfilled with approved structural fill. Similarly, any soft or wet areas should also be sub-excavated and backfilled with approved structural fill only. Prior to placing any approved structural fill, the subgrade should be inspected and approved by geotechnical engineer or qualified geotechnical personnel. The bearing pressure is contingent on the water level being 0.3 m below the underside footing elevation in order to have a stable and dry subgrade during construction.



Prior to pouring footings concrete, the subgrade should be inspected and approved by a geotechnical engineer or a representative of geotechnical engineer. It is recommended place a 50 mm thick mudslab consisting of a lean concrete mix in order to protect the subgrade prior to placement of the footing formwork.

5.2.1 Ground Improvement

If a greater bearing capacity is required than what is mentioned above, this site may be suitable for a type of ground improvement; consisting of rapid dynamic compaction, wick drains, or Controlled Modulus Columns (CMCs).

If required, LRL can provide recommendations for a contractor specializing in ground improvement methods.

5.3 Grade Raise Restriction

This site has an allowable earth grade raise up to 1.0 m above existing grade. If a greater earth fill grade raise is required, LRL shall be consulted to ensure the bearing capacity values are still valid.

Furthermore, consideration could be given to backfill with Light Weight Fill if the grade raise will exceed 1.0 m.

5.4 Structural Fill

For foundations set over undisturbed native soil and where excavation below the underside of the footings is performed in order to reach a suitable founding stratum, consideration should also be given to support the footings on structural fill. The structural fill should be placed over undisturbed native soils in layers not exceeding 300 mm and compacted to 98% of its Standard Proctor Maximum Dry Density (SPMDD) within $\pm 2\%$ of its optimum moisture content. In order to allow the spread of load beneath the footings and to prevent undermining during construction, the structural fill should extend minimum 1.0 m beyond the outside edges of the footings and then outward and downward at 1 horizontal to 1 vertical profile (or flatter) over a distance equal to the depth of the structural fill below the footing. Furthermore, the structural fill must be tested to ensure that the specified compaction level is achieved.

5.5 Lateral Earth Pressure

The following equation should be used to estimate the intensity of the lateral earth pressure against any earth retaining structure/foundation walls.

$$P = K (\gamma h + q)$$

Where;

P = Earth pressure at depth h;

K = Appropriate coefficient of earth pressure;

γ = Unit weight of compacted backfill, adjacent to the wall;

h = Depth (below adjacent to the highest grade) at which P is calculated;

q = Intensity of any surcharge distributed uniformly over the backfill surface (usually surcharge from traffic, equipment or soil stockpiled and typically considered 10 kPa).



The coefficient of earth pressure at rest (K_0) should be used in the calculation of the earth pressure on the storm water manhole/basement walls, which are expected to be rather rigid and not to deflect.

The above expression assumes that perimeter drainage system prevents the build-up of any hydrostatic pressure behind the foundation wall.

Table 4 below provides various material types and their respective earth pressure properties.

Table 4: Material and Earth Pressure Properties

Type of Material	Bulk Density (kN/m ³)	Friction Angle (Φ)	Pressure Coefficient		
			At Rest (K_0)	Active (K_A)	Passive (K_P)
Granular A	23.0	34	0.44	0.28	3.53
Granular B Type I	20.0	31	0.49	0.32	3.12
Granular B Type II	23.0	32	0.47	0.31	3.25
Silty Sand	17.5	30	0.50	0.33	3.00
Clayey Silt to Silty Clay	18.5	25	0.52	0.41	2.46

5.6 Settlement

The estimated total settlement of the shallow foundations, designed using the recommended serviceability limit state capacity value, as well as other recommendations given above, will be less than 25 mm. The differential settlement between adjacent column footings is anticipated to be 15 mm or less.

5.7 Seismic

Based on the information of this geotechnical investigation and in accordance with the Ontario Building Code 2015 (Table 4.1.8.4.A.) and Canadian Foundation Engineering Manual (4th edition), the site can be classified for Seismic Site Response Site Class F.

The above classifications were recommended based on conventional method exercised for Site Classification for Seismic Site Response and in accordance with the generally accepted geotechnical engineering practice.

5.8 Liquefaction Potential

As recommended in Canadian Foundation Engineering Manual 4th edition (*Bray et al. 2004*), the following criteria can be used to determine liquefaction susceptibility of fine grained soils.

- $w/w_L \geq 0.85$ and $I_p \leq 12$: Susceptible to liquefaction or cyclic mobility
- $w/w_L \geq 0.8$ and $12 \leq I_p \leq 20$: Moderately susceptible to liquefaction or cyclic mobility
- $w/w_L < 0.8$ and $I_p \leq 20$: No liquefaction or cyclic mobility, but may undergo significant deformations if cyclic shear stress > static undrained shear strength.

Based on the above criteria, liquefaction is not a concern for this site.

5.9 Frost Protection

All exterior footings for any heated structure exposed to frost conditions should have a minimum of 1.5 m of earth cover. Footings for any unheated structures, signage or lighting, and where snow will be cleared, 1.8 m of earth cover is required. Alternatively, the required frost protection could be provided using a combination of earth cover and extruded polystyrene insulation. Detailed guidelines for footing insulation frost protection can be provided upon request.

In the event that foundations are to be constructed during winter months, the foundation soils are required to be protected from freezing temperatures using suitable construction techniques. The base of all excavations should be insulated from freezing temperatures immediately upon exposure, until heat can be supplied to the building interior and the footings have sufficient soil cover to prevent freezing of the subgrade soils.

5.10 Foundation Drainage

Permanent perimeter drainage is only required for buildings where basements or whenever any open spaces located below the finish ground are being considered. It is our understanding that no basement construction is included as part of this development and hence no perimeter drainage is required. However, in order to minimize ponding of water adjacent to the foundation walls, roof water should be controlled by a roof drainage system that directs water away from the building to prevent ponding of water adjacent to the foundation wall.

5.11 Foundation Walls Backfill (Shallow Foundations)

To prevent possible foundation frost jacking and lateral loading, the backfill material against any foundation walls, grade beams, isolated walls, or piers should consist of free draining, non-frost susceptible material such as sand or sand and gravel meeting OPSS Granular B Type II or I, or a Select Subgrade Material (SSM).

The foundation wall backfill should be compacted to minimum 95% of its SPMDD using light compaction equipment, where no loads will be set over top. The compaction shall be increased to 98% of its SPMDD under walkways, slabs or paved areas close to the foundation or retaining walls. Backfilling against foundation walls should be carried out on both sides of the wall at the same time where applicable.

5.12 Slab-on-grade Construction

Concrete slab-on-grade should rest over compacted, free draining and well graded structural fill only. Therefore, all fill, or otherwise deleterious material shall be removed from the proposed building's footprint. The exposed undisturbed native subgrade should then be inspected and approved by a qualified geotechnical personnel.

Any underfloor fill needed to raise the general floor grade shall consist of OPSS Granular B Type II or I or SSM material or an approved equivalent, compacted to 95% of its SPMDD. The final lift shall be compacted to 98% of its SPMDD. A minimum 200 mm Granular A layer meeting the **OPSS 1010** shall be placed underneath the slab and compacted to 98% of its SPMDD.

It is also recommended that the area of extensive exterior slab-on-grade (sidewalks, ramp etc.) shall be constructed using Granular A base of thickness 150 mm with incorporating subdrain facilities. The modulus of subgrade reaction (k_s) for the design of the slabs set over competent native soil/structural fill is **22 MPa/m**.



In order to further minimize and control cracking, the floor slab shall be provided with wire or fibre mesh reinforcement and construction or control joints. The construction or control joints should be spaced equal distance in both directions and should not exceed 4.5 m. The wire or fibre mesh reinforcement shall be carried out through the joints.

If any areas of the proposed building area are to remain unheated during the winter period, thermal protection of the slab on grade may be required. The “Guide for Concrete Floor and Slab Construction”, **ACI 302.1R-04** is recommended to follow for the design and construction of vapour retarders below the floor slab. Further details on the insulation requirements could be provided, if necessary.

5.13 Corrosion Potential and Cement Type

A soil sample was submitted to Paracel Laboratories Ltd. for chemical testing. The following **Table 5** below summarizes the results.

Table 5: Results of Chemical Analysis

Sample Location	Depth (m)	pH	Sulphate (µg/g)	Chloride (µg/g)	Resistivity (Ohm.cm)
BH4	1.5 – 2.1	7.44	78	101	2,120.0

The above results revealed a measured sulphate concentration of 78 µg/g. Based on the CAN/CSA-A23.1 standards (Concrete Materials and Methods of Concrete Construction), a sulphate concentration of less than 1000 µg/g falls within the negligible category for sulphate attack on buried concrete. The test results from soil sample is below the noted threshold. As such, buried concrete for footings and foundations walls will not require any special additive to resist sulphate attack and the use of normal Portland cement is acceptable.

The pH, resistivity and chloride concentration provide an indication of the degree of corrosiveness of the sub-surface environment. The soil resistivity was measured to be 2,120.0 ohm.cm, which falls between the “highly corrosive” range for soil resistivity. Therefore, any buried steel for this site shall be coated with a corrosion resistant coating.

5.14 Other Considerations

As noted above in **Section 4.8**, the Atterberg Limits results indicate the moisture content is higher than the liquid limit. This indicates that a loss of moisture from the material could result in shrinkage of the soil and subsequent excessive settlements may occur. To help maintain the groundwater level, it is recommended to install clay dykes within any service trench, downstream from each of the manholes. These dykes should extend from the base of the service trench to the subgrade level, having minimum width of 1.0 m.

In addition to clay dykes, any trees planted onsite should respect the City of Ottawa “Tree Planting in Sensitive Marine Clay Soils – 2017 Guidelines”.

6 EXCAVATION AND BACKFILLING REQUIREMENTS

6.1 Excavation

It is anticipated that the depth of excavation for the building will not be extended below 1.5 - 1.8 m bgs. Most of the excavation being carried out will be through native silty sand and



clayey silt. Excavation must be carried out in accordance with Occupational Health and Safety Act and Regulations for construction Projects.

According to the Ontario's Occupational Health and Safety Act (OHSA), O. Reg. 213/91 and its amendments, the surficial overburden expected to be excavated into at this site can be classified as Type 3. Therefore, shallow temporary excavations can be cut at 1 horizontal to 1 vertical (1H: 1V) for a fully drained excavation starting at the base of the excavation and as per requirements of the OHSA regulations.

Any excavated material stockpiled near an excavation or trench should be stored at a distance equal to or greater than the depth of the excavation/trench and construction equipment, traffic should be limited near open excavation.

6.2 Groundwater Control

Based on the subsurface conditions encountered at this site, groundwater seepage or infiltration from the native soils into the shallow temporary excavations during construction is expected. However, it is anticipated that pumping from open sumps should be sufficient to control groundwater inflow. Any groundwater seepage or infiltration entering the excavation should be removed from the excavation by pumping from sumps within the excavations. Surface water runoff into the excavation should be minimized and diverted away from the excavation if possible.

A permit to take water (PTTW) is required from Ministry of Environment and Climate Change (MOECC), Ontario Reg. 387/04, if more than 400,000 litres per day of groundwater will be pumped during a construction period less than 30 days. Registration in the Environmental Activity and Sector Registry (EASR) is required when the takings of ground water and storm water for the purpose of dewatering construction projects range between 50,000 and 400,000 litres per day.

Based on the field investigation through localized borings, it is anticipated that pumping of groundwater will not exceed 50,000 litres per day. As such, no PTTW nor registration in the EASR is anticipated to be required for the construction of the proposed warehouse at this site.

6.3 Pipe Bedding Requirements

It is anticipated that any underground services required as part of this project will be founded over clayey silt. Alternately, underground services may be founded over properly prepared and approved structural fill, where excavation below the invert is required. Consequently all organic material should be removed down to a suitable bearing layer. Any sub-excavation of disturbed soil should be removed and replaced with a Granular B Type II or I or approved equivalent, laid in loose lifts of thickness not exceeding 300 mm and compacted to 95% of its SPMDD. Bedding, thickness of cover material and compaction requirements for any pipes should conform to the manufacturers design requirements and to the detailed installations outlined in the Ontario Provincial Standard Specifications (OPSS) and any applicable standards or requirements.

If services are required to be founded below the groundwater table the native materials may be sensitive to disturbances and may also be susceptible to piping and scouring from water pressure at the base of the excavation. Therefore, special precautions should be taken in these areas to stabilize and confine the base of the excavation such as using recompression (thicker bedding) and/or dewatering methods (pre-pumping). In order to



properly compact the bedding, the water table should be kept at least 300 mm below the base of the excavation at all time during the installation of any sewers and structures.

As an alternative to Granular A bedding and only where wet conditions are encountered, the use of “clear stone” bedding, such as 19 mm clear stone, **OPSS 1004**, may be considered only in conjunction with a suitable geotextile filter (such as terrafix 270R or approved equivalent). Without proper filtering, there may be entry of fines from native soils and trench backfill into the bedding, which could result in loss of support to the pipes and possible surface settlements. The sub-bedding, bedding and cover materials should be compacted in maximum 200 mm thick lifts to at least 95% of its SPMDD within $\pm 2\%$ of its optimum moisture content using suitable vibratory compaction equipment.

6.4 Trench Backfill

All service trenches should be backfilled using compactable material, free of organics, debris and large cobbles or boulders. Acceptable native materials (if encountered and where possible) should be used as backfill between the roadway subgrade level and the depth of seasonal frost penetrations (i.e. 1.8 m below finished grade) in order to reduce the potential for differential frost heaving between the new excavated trench and the adjacent section of roadway. Where native backfill is used, it should match the native materials exposed on the trench walls. Backfill below the zone of seasonal frost penetration could consist of either acceptable native material or imported granular material conforming to OPSS Granular B Type II or I. Any boulders larger than 150 mm in size should not be used as trench backfill.

To minimize future settlement of the backfill and achieve an acceptable subgrade for the roadway, the trench should be compacted in maximum 300 mm thick lifts to at least 95% of its SPMDD. The specified density may be reduced where the trench backfill is not located within or in close proximity to existing roadways or any other structures.

For trenches carried out in existing paved areas, transitions should be constructed to ensure that proper compaction is achieved between any new pavement structure and the existing pavement structure to minimize potential future differential settlement between the existing and new pavement structure. The transition should start at the subgrade level and extend to the underside of the asphaltic concrete level (if any) at a 1 horizontal to 1 vertical slope. This is especially important where trench boxes are used and where no side slopes are provided to the excavation. Where asphaltic concrete is present, it should be cut back to a minimum of 150 mm from the edge of the excavation to allow for proper compaction between the new and existing pavement structures.

7 REUSE OF ON-SITE SOILS

The existing surficial overburden soils consist mostly of silty sand to clayey silt. These materials are considered to be frost susceptible and should not be used as backfill material directly against foundation walls or underneath unheated concrete slabs. However, these could be reused as general backfill material (service trenches, general landscaping/backfilling) if it can be compacted according to the specifications outlined herein at the time of construction and found free from any waste, organics and debris. Any imported material shall conform to OPSS Granular B – Type II or I, SSM or approved equivalent.

It should be noted that the adequacy of any material for reuse as backfill will depend on its water content at the time of its use and on the weather conditions prevailing prior to and during that time. Therefore, all excavated materials to be reused shall be stockpiled

in a manner that will prevent any significant changes in their moisture content, especially during wet conditions. Any excavated materials proposed for reuse should be stockpiled in a manner to promote drying and should be inspected and approved for reuse by a geotechnical engineer.

8 RECOMMENDED PAVEMENT STRUCTURE

It is anticipated that the subgrade soils for the new access lanes parking areas will consist mostly of silty sand. The construction will be acceptable over the undisturbed native material once all organic material, or otherwise deleterious material are removed from the subgrade area. Furthermore, the subgrade must be compacted using a suitable heavy duty compacting equipment and approved by a geotechnical engineer prior to placing any granular base material.

The following **Table 6** presents the recommended pavement structures to be constructed over a stable subgrade along the proposed parking areas and access lanes as part of this project.

Table 6: Recommended Pavement Structure

Course	Material	Thickness (mm)	
		Light Duty Parking Area (mm)	Heavy Duty Parking Area (Access Roads, Fire Routes and Trucks) (mm)
Surface	HL3/SP12.5 A/C	50	40
Binder	HL8/SP19.0 A/C	-	50
Base course	Granular A	150	150
Sub base	Granular B Type II	350**	450**
Total:		550	690

Performance Graded Asphaltic Cement (PGAC) **58-34** is recommended for this project.

If the pavement structure will not have asphalt present, and will be left as a gravel wear surface; it is recommended to increase the Granular B Type II thickness by 150 mm to ensure structural integrity of the pavement structure.

The base and subbase granular materials shall conform to **OPSS 1010** material specifications. Any proposed materials shall be tested and approved by a geotechnical engineer prior to delivery to the site and shall be compacted to 98% of its SPMD. Asphaltic concrete shall conform to **OPSS 1150** and be placed and compacted to at least 93% of the Marshall Density. The mix and its constituents shall be reviewed, tested and approved by a geotechnical engineer prior to delivery to the site.

8.1 Paved Areas & Subgrade Preparation

The access lanes and parking areas shall be stripped of vegetation, debris and other obvious objectionable fill material. Following the backfilling and satisfactory compaction of any underground service trenches up to the subgrade level, the subgrade shall be shaped, crowned and proof-rolled. A loaded Tandem axle, dual wheel dump truck or approved equivalent heavy duty smooth drum roller shall be used for proof-rolling. Any

resulting loose/soft areas should be sub-excavated down to an adequate bearing layer and replaced with approved backfill.

The preparation of subgrade shall be scheduled and carried out in manner so that a protective cover of overlying granular material (if required) is placed as quickly as possible in order to avoid unnecessary circulation by heavy equipment, except on unexcavated or protected surfaces. Frost protection of the surface shall be implemented if works are carried out during the winter season.

The performance of the pavement structure is highly dependent on the subsurface groundwater conditions and maintaining the subgrade and pavement structure in a dry condition. The surface of the pavement should be properly graded to direct runoff water towards suitable drainage features. It is recommended that the lateral extent of the subbase and base layers not be terminated vertically immediately behind the curb/edge of pavement line but be extended beyond the curb.

9 INSPECTION SERVICES

The engagement of the services of the geotechnical consultant during construction is recommended to confirm that the subsurface conditions throughout the proposed site do not materially differ from those given in the report and that the construction activities do not adversely affect the intent of the design.

All footing areas and any structural fill areas for the proposed structures should be inspected by LRL to ensure that a suitable subgrade has been reached and properly prepared. The placing and compaction of any granular materials beneath the foundations and slab-on-grade should be inspected to ensure that the materials used conform to the grading and compaction specifications.

The subgrade for the pavement areas and underground services should be inspected and approved by geotechnical personnel. In-situ density testing should be carried out on the pavement granular materials, pipe bedding and backfill to ensure the materials meet the specifications for required compaction.

If footings are to be constructed during winter season, the footing subgrade should be protected from freezing temperatures using suitable construction techniques.

10 REPORT CONDITIONS AND LIMITATIONS

It is stressed that the information presented in this report is provided for the guidance of the designers and is intended for this project only. The use of this report as a construction document or its use by a third party beyond the client specifically listed in the report is neither intended nor authorized by LRL Associates Ltd. Contractors bidding on or undertaking the works should examine the factual results of the investigation, satisfy themselves as to the adequacy of the information for construction, and make their own interpretation of the factual data as it affects their construction techniques, schedule, safety and equipment capabilities.

The professional services for this project include only the geotechnical aspects of the subsurface conditions at this site. The presence or implications of possible contamination resulting from previous uses or activities at this site or adjacent properties, and/or resulting from the introduction onto the site of materials from off-site sources are outside the terms of reference for this report.



The recommendations provided in this report are based on subsurface data obtained at the specific boring locations only. Boundaries between zones presented on the borehole are often not distinct but transitional and were interpreted. Experience indicates that the subsurface soil and groundwater conditions can vary significantly between and beyond the test locations. For this reason, the recommendations given in this report are subject to a field verification of the subsurface soil conditions at the time of construction.

The recommendations are applicable only to the project described in this report. Any changes to the project will require a review by LRL Associates Ltd., to ensure compatibility with the recommendations contained in this project.

We trust this report provides sufficient information for your present purposes. If you have any questions concerning this report or if we may be of further services to you, please do not hesitate to contact the undersigned.

Yours truly,
LRL Associates Ltd.



Brad Johnson, P.Eng.
Geotechnical Engineer



W:\FILES 2022\220487\05 Geotechnical\01 Investigation\05 Reports\220487 -Geotechnical Investigation_Proposed Warehouse_363 Entrepreneur Cres_Navan_R2.docx



APPENDIX A
Site and Borehole Location Plan



LRJ

ENGINEERING | INGÉNIERIE

5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

PROJECT

GEOTECHNICAL INVESTIGATION
PROPOSED WAREHOUSE DEVELOPMENT
363 ENTREPRENEUR CRESCENT
VARS, ONTARIO

DRAWING TITLE

SITE LOCATION
SOURCE: GEOTTAWA

CLIENT

ENTREPRENEUR HOLDING CORPORATION


DATE

NOVEMBER 2022

PROJECT

220487

FIGURE 1

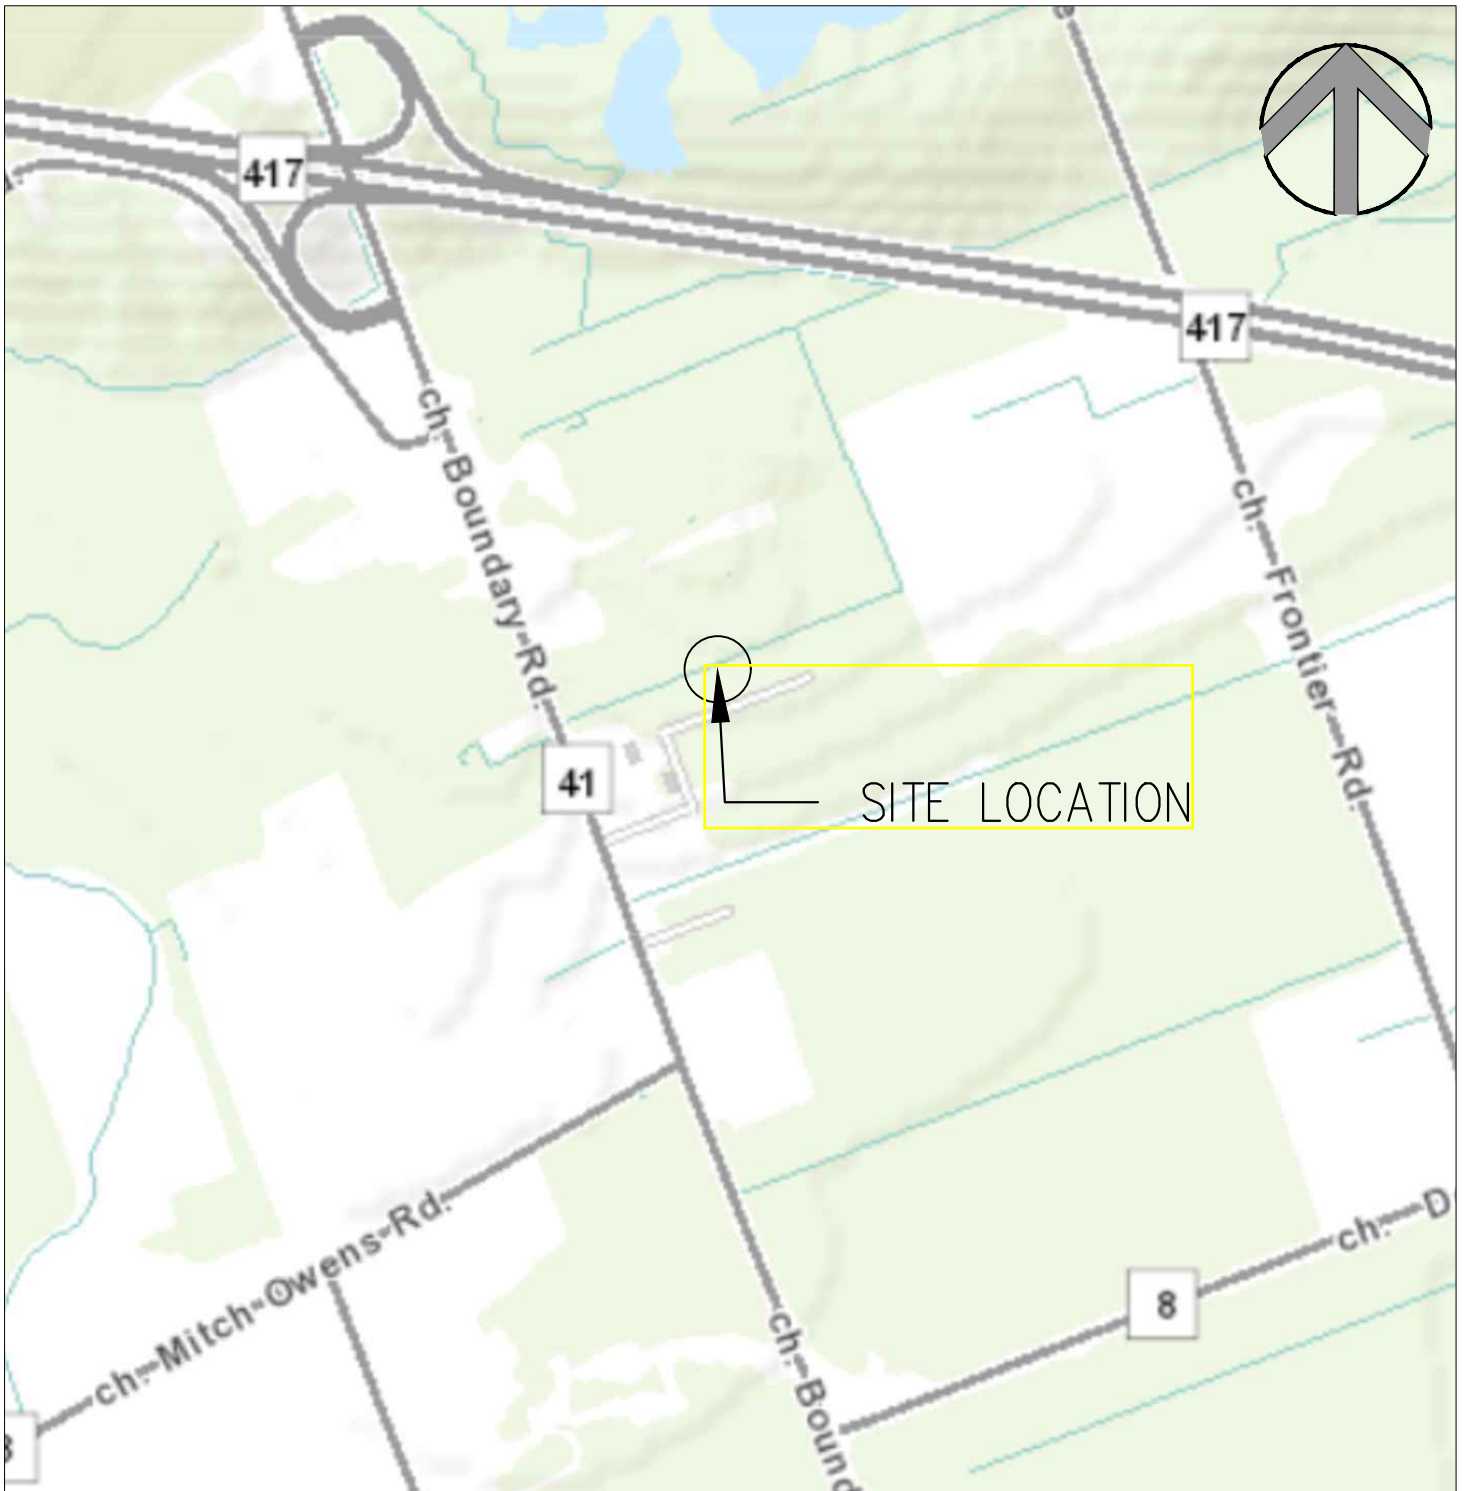



LRJ

ENGINEERING | INGÉNIERIE

5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

PROJECT

GEOTECHNICAL INVESTIGATION
PROPOSED WAREHOUSE DEVELOPMENT
363 ENTREPRENEUR CRESCENT
VARS, ONTARIO

DRAWING TITLE

BOREHOLE LOCATION
SOURCE: GOOGLE AERIAL VIEW

CLIENT

ENTREPRENEUR HOLDING CORPORATION


DATE

NOVEMBER 2022

PROJECT

220487

FIGURE 2

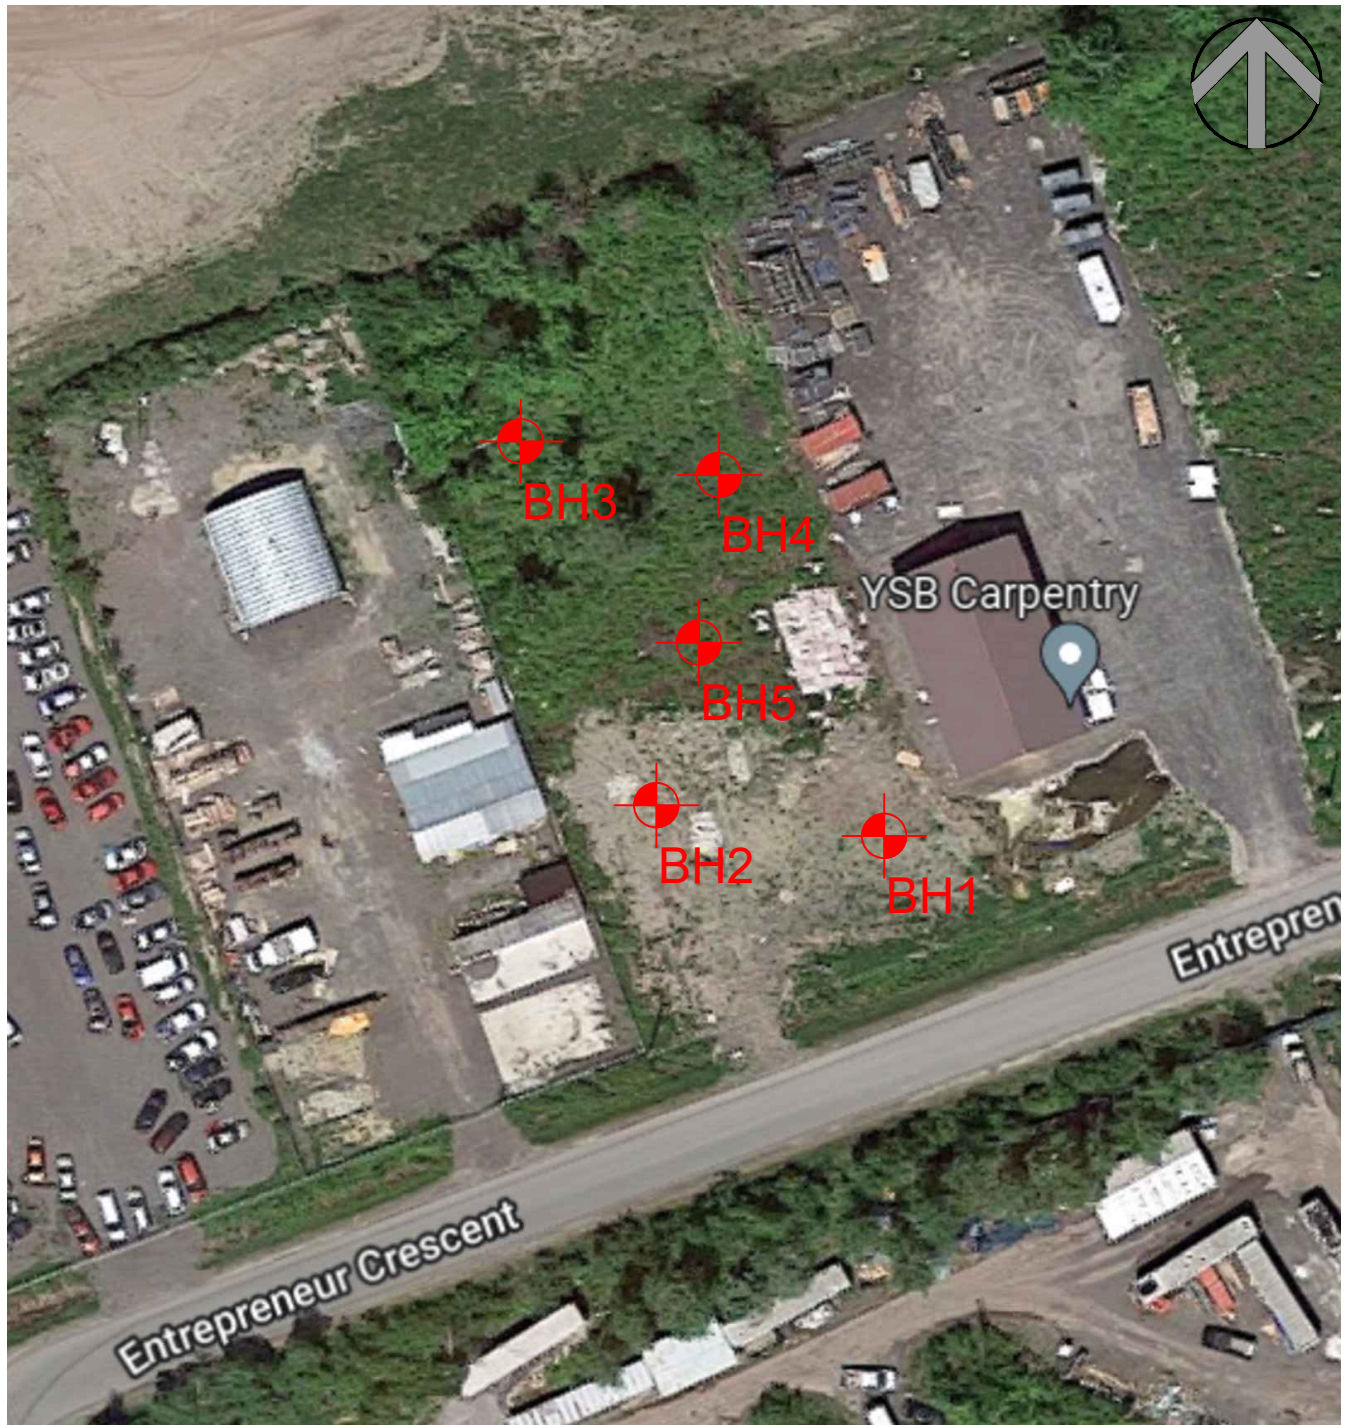

APPENDIX B

Borehole Logs



Project No.: 220487

Client: Entrepreneur Holding Corp.

Date: November 17, 2022

Borehole Log: BH1

Project: Proposed Warehouse

Location: 363 Entrepreneur Cres. Vars ON

Field Personnel: BJ

Driller: CCC Geotech and Enviro Drilling

Drilling Equipment: Track Mount CME 75

Drilling Method: Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth ft m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50 150	25 50 75	
							SPT N Value (Blows/0.3 m)	Liquid Limit (%)	
0	Ground Surface	100.28							
1	FILL MATERIAL crushed stone, grey, moist, dense.	0.00		SS1	34	42	34	9	
2									
3		99.22		SS2	19	58	19		
4	SILTY SAND brown, moist, compact.	1.07							
5		98.83							
6	CLAYEY SILT trace sand, grey, firm to very soft, wet.	1.45		SS3	4	50	4	37	
7									
8									
9				SS4	WH	100	0		
10									
11				SS5	WH	100	0		87
12									
13									
14		96.16							
15	SILTY CLAY grey, very soft, wet.	4.12							
16				SS6	WH	100	0		
17									
18							24		
19							24		
20									
21				SS7	WH	100	0		76
22							24		
23		93.28					24		
24	End of Borehole	7.00							

Easting: 465773 m

Northing: 5020883 m

NOTES:

Site Datum: TBM - Top of Culvert located at Southwest of Driveway entrance. (100.00 m)

Groundsurface Elevation: 100.285 m

Top of Riser Elev.: NA

Hole Diameter: 200 mm

Monitoring Well Diameter: N/A



Project No.: 220487

Client: Entrepreneur Holding Corp.

Date: November 17, 2022

Borehole Log: BH2

Project: Proposed Warehouse

Location: 363 Entrepreneur Cres. Vars ON

Field Personnel: BJ

Driller: CCC Geotech and Enviro Drilling

Drilling Equipment: Track Mount CME 75

Drilling Method: Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth ft m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50 150	25 50 75	
							SPT N Value (Blows/0.3 m)	Liquid Limit (%)	
							20 40 60 80	25 50 75	
0	Ground Surface	100.17							
1	FILL MATERIAL crushed stone, grey, moist, dense.	99.57		SS1	30	42	30		
2		0.60							
3	SILTY SAND brown, moist, compact.	98.72		SS2	15	50	15	22	
4		1.45							
5	CLAYEY SILT trace sand, grey, firm to very soft, wet.			SS3	1	50	1		
6									
7									
8				SS4	WH	58	0	65	
9									
10				SS5	WH	75	0		
11									
12									
13		96.05					20		
14	SILTY CLAY grey, very soft, wet.	4.12					30		
15									
16				SS6	WH	100	0		
17									
18							24		
19							30		

Easting: 465762 m

Northing: 5020885 m

NOTES:

Site Datum: TBM - Top of Culvert located at Southwest of Driveway entrance. (100.00 m)

Groundsurface Elevation: 100.165 m

Top of Riser Elev.: NA

Hole Diameter: 200 mm

Monitoring Well Diameter: N/A



Project No.: 220487

Client: Entrepreneur Holding Corp.

Date: November 17, 2022

Borehole Log (continued): BH2

Project: Proposed Warehouse

Location: 363 Entrepreneur Cres. Vars ON

Field Personnel: BJ

Driller: CCC Geotech and Enviro Drilling

Drilling Equipment: Track Mount CME 75

Drilling Method: Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Monitoring Well Details	
Depth	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	Shear Strength (kPa)	Water Content (%)
							SPT N Value (Blows/0.3 m)	Liquid Limit (%)
20								
21				SS7	WH	100		85
22								
23	7							
24								
25								
26	8							
27								
28								
29								
30	9							
31								
32								
33	10							
34								
35								
36	11							
37								
38								
39								

NOTES



Project No.: 220487

Client: Entrepreneur Holding Corp.

Date: November 17, 2022

Borehole Log (continued): BH2

Project: Proposed Warehouse

Location: 363 Entrepreneur Cres. Vars ON

Field Personnel: BJ

Driller: CCC Geotech and Enviro Drilling

Drilling Equipment: Track Mount CME 75

Drilling Method: Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Monitoring Well Details	
Depth	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	Shear Strength (kPa)	Water Content (%)
							SPT N Value (Blows/0.3 m)	Liquid Limit (%)
40							50 150	25 50 75
41							20 40 60 80	25 50 75
42								
43	13							
44								
45								
46	14							
47								
48								
49	15							
50								
51								
52	16							
53								
54								
55	17							
56								
57								
58								
59								

NOTES



Project No.: 220487

Client: Entrepreneur Holding Corp.

Date: November 17, 2022

Borehole Log (continued): BH2

Project: Proposed Warehouse

Location: 363 Entrepreneur Cres. Vars ON

Field Personnel: BJ

Driller: CCC Geotech and Enviro Drilling

Drilling Equipment: Track Mount CME 75

Drilling Method: Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)		Water Content (%)		Monitoring Well Details
Depth	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	<div><div></div><div>50</div><div>150</div><div></div></div>	<div><div></div><div>25</div><div>50</div><div>75</div><div></div></div>			
							<div><div></div><div>20</div><div>40</div><div>60</div><div>80</div><div></div></div>	<div><div></div><div>25</div><div>50</div><div>75</div><div></div></div>			
60	INFERRED GLACIAL TILL	81.56					17				
61		18.60					21				
62		19					20				
63							14				
64							20				
65							15				
66		20					15				
67							15				
68							15				
69		21					13				
70							18				
71							15				
72		22					15				
73							16				
74							17				
75							17				
76		23					16				
77							27				
78							35				
						47					

NOTES



Project No.: 220487
Client: Entrepreneur Holding Corp.
Date: November 17, 2022

Borehole Log (continued): BH2
Project: Proposed Warehouse
Location: 363 Entrepreneur Cres. Vars ON
Field Personnel: BJ

Driller: CCC Geotech and Enviro Drilling **Drilling Equipment:** Track Mount CME 75 **Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Monitoring Well Details	
Depth	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	Shear Strength (kPa)	Water Content (%)
							SPT N Value (Blows/0.3 m)	Liquid Limit (%)
79	End of Borehole	75.67					44	
80		24.50					50	
81								
82								
83								
84								
85								
86								
87								
88								
89								
90								
91								
92								
93								
94								
95								
96								
97								
98								

NOTES



Project No.: 220487

Client: Entrepreneur Holding Corp.

Date: November 17, 2022

Borehole Log: BH3

Project: Proposed Warehouse

Location: 363 Entrepreneur Cres. Vars ON

Field Personnel: BJ

Driller: CCC Geotech and Enviro Drilling

Drilling Equipment: Track Mount CME 75

Drilling Method: Hollow Stew Auger

SUBSURFACE PROFILE			SAMPLE DATA				Shear Strength (kPa)		Water Content (%)		Monitoring Well Details
Depth	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	SPT N Value (Blows/0.3 m)		Liquid Limit (%)		
							50	150	25	50	
0	Ground Surface	100.18									
1	FILL MATERIAL crushed stone, grey, moist, dense.	99.49		SS1	36	50	36		11		
2		99.49									
3	SILTY SAND brown, moist, compact.	98.73		SS2	14	50	14				
4		98.73									
5	CLAYEY SILT trace sand, grey, very soft, wet.	98.73		SS3	1	100	1			83	
6											
7											
8											
9											
10											
11											
12	-Sand seam at about 3.65 m bgs			SS4	WH	100	0				
13											
14											
15											
16											
17											
18											
19											
20											
21											
22											
23											
24											
25											
26											
27											
28											
29											
30											
31											
32											
33											
34											
35											
36											
37											
38											
39											
40											
41											
42											
43											
44											
45											
46											
47											
48											
49											
50											
51											
52											
53											
54											
55											
56											
57											
58											
59											
60											
61											
62											
63											
64											
65											
66											
67											
68											
69											
70											
71											
72											
73											
74											
75											
76											
77											
78											
79											
80											
81											
82											
83											
84											
85											
86											
87											
88											
89											
90											
91											
92											
93											
94											
95											
96											
97											
98											
99											
100											
101											
102											
103											
104											
105											
106											
107											
108											
109											
110											
111											
112											
113											
114											
115											
116											
117											
118											
119											
120											
121											
122											
123											
124											
125											
126											
127											
128											
129											
130											
131											
132											
133											
134											
135											
136											
137											
138											
139											
140											
141											
142											
143											
144											
145											
146											
147											
148											
149											
150											
151											
152											
153											
154											
155											
156											
157											
158											
159											
160											
161											
162											
163											
164											
165											
166											
167											
168											
169											
170											
171											
172											
173											
174											
175											
176											
177											
178											
179											
180											
181											
182											
183											
184											
185											
186											
187											
188											
189											
190											
191											
192											
193											
194											
195											
196											
197											
198											
199											
200											
201											
202											
203											
204											
205											
206											
207											
208											
209											
210											
211											
212											
213											
214											
215											



Project No.: 220487

Client: Entrepreneur Holding Corp.

Date: November 17, 2022

Borehole Log: BH4

Project: Proposed Warehouse

Location: 363 Entrepreneur Cres. Vars ON

Field Personnel: BJ

Driller: CCC Geotech and Enviro Drilling

Drilling Equipment: Track Mount CME 75

Drilling Method: Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth ft m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50 150	25 50 75	
							SPT N Value (Blows/0.3 m)	Liquid Limit (%)	
							20 40 60 80	25 50 75	
0	Ground Surface	100.22							
1	FILL MATERIAL crushed stone, grey, moist, dense.	99.63		SS1	35	33	35		
2		0.60							
3	SILTY SAND brown, moist, compact.	98.77		SS2	14	50	14	24	
4		1.45							
5	CLAYEY SILT trace sand, grey, firm to very soft, wet.			SS3	2	100	2	67	77
6									
7									
8							24		
9							24		
10									
11				SS4	WH	100	0		
12									
13		96.10					24		
14	SILTY CLAY grey, very soft, wet.	4.12					22		
15									
16									
17							26		
18							24		
19									
20									
21									
22							28		
23		93.22					24		
24	End of Borehole	7.00							

Easting: 465770 m

Northing: 5020920 m

NOTES:

Site Datum: TBM - Top of Culvert located at Southwest of Driveway entrance. (100.00 m)

Groundsurface Elevation: 100.225 m

Top of Riser Elev.: NA

Hole Diameter: 200 mm

Monitoring Well Diameter: N/A



Project No.: 220487

Client: Entrepreneur Holding Corporation

Date: July 03, 2024

Borehole Log: BH5

Project: Proposed Warehouse

Location: 363 Entrepreneur Cres, Vars ON

Field Personnel: BJ

Driller: George Downing Estate Drilling LTD.

Drilling Equipment: Truck Mount CME 85

Drilling Method: Hollow Stem Auger

SUBSURFACE PROFILE		SAMPLE DATA						Shear Strength (kPa)	Water Content (%)	Water Level (Standpipe or Open Borehole)
Depth ft m	Soil Description	Elev./Depth(m)	Lithology	Type	Sample Number	N or RQD	Recovery (%)	50150	255075	
								SPT N Value (Blows/0.3 m)	Liquid Limit (%)	
								20406080	255075	
0	Ground Surface	0.00								
1	FILL MATERIAL crushed stone, grey, moist.									
2		0.60								
3	SILTY SAND brown, moist, compact.							11		
4		1.10			SS1	11	75			
5	SILTY CLAY trace sand, grey, very soft.									
6					SS2	1	100		79	
7									84	
8										
9					SS3	0	100			
10										
11					SS4	0	100			
12										
13								24		
14								26		
15										
16					ST1	ST1				
17								28		
18								26		
19										
20										
21					SS6	0	100			
22	End of Borehole	6.70								

Easting: 465772

Northing: 5020895

NOTES:

Site Datum: TBM - Top of Culvert located at SW of Driveway Entrance (100.00 m)

Groundsurface Elevation: 100.166 m Top of Riser Elev.: NA

Hole Diameter: 200mm

APPENDIX C
Symbols and Terms used in Borehole Logs

Symbols and Terms Used on Borehole and Test Pit Logs

1. Soil Description

The soil descriptions presented in this report are based on commonly accepted methods of classification and identification employed in geotechnical practice. Classification and identification of soil involves some judgement and LRL Associates Ltd. does not guarantee descriptions as exact, but infers accuracy to the extent that is common in current geotechnical practice. Boundaries between zones on the logs are often not distinct but transitional and were interpreted.

a. Proportion

The proportion of each constituent part, as defined by the grain size distribution, is denoted by the following terms:

Term	Proportions
"trace"	1% to 10%
"some"	10% to 20%
prefix (i.e. "sandy" silt)	20% to 35%
"and" (i.e. sand "and" gravel)	35% to 50%

b. Compactness and Consistency

The state of compactness of granular soils is defined on the basis of the Standard Penetration Number (N) as per ASTM D-1586. It corresponds to the number of blows required to drive 300 mm of the split spoon sampler using a metal drop hammer that has a weight of 62.5 kg and free fall distance of 760 mm. For a 600 mm long split spoon, the blow counts are recorded for every 150 mm. The "N" value is obtained by adding the number of blows from the 2nd and 3rd count. Technical refusal indicates a number of blows greater than 50.

The consistency of clayey or cohesive soils is based on the shear strength of the soil, as determined by field vane tests and by a visual and tactile assessment of the soil strength.

The state of compactness of granular soils is defined by the following terms:

State of Compactness Granular Soils	Standard Penetration Number "N"	Relative Density (%)
Very loose	0 – 4	<15
Loose	4 – 10	15 – 35
Compact	10 - 30	35 – 65
Dense	30 - 50	65 - 85
Very dense	> 50	> 85

The consistency of cohesive soils is defined by the following terms:

Consistency Cohesive Soils	Undrained Shear Strength (C_u) (kPa)	Standard Penetration Number "N"
Very soft	<12.5	<2
Soft	12.5 - 25	2 - 4
Firm	25 - 50	4 - 8
Stiff	50 - 100	8 - 15
Very stiff	100 - 200	15 - 30
Hard	>200	>30

c. Field Moisture Condition

Description (ASTM D2488)	Criteria
Dry	Absence of moisture, dusty, dry to touch.
Moist	Damp, but not visible water.
Wet	Visible, free water, usually soil is below water table.

2. Sample Data

a. Elevation depth

This is a reference to the geodesic elevation of the soil or to a benchmark of an arbitrary elevation at the location of the borehole or test pit. The depth of geological boundaries is measured from ground surface.

b. Type

Symbol	Type	Letter Code
⌋	Auger	AU
⌋ ⌋	Split Spoon	SS
	Shelby Tube	ST
 	Rock Core	RC

c. Sample Number

Each sample taken from the borehole is numbered in the field as shown in this column.

LETTER CODE (as above) – Sample Number.

d. Recovery (%)

For soil samples this is the percentage of the recovered sample obtained versus the length sampled. In the case of rock, the percentage is the length of rock core recovered compared to the length of the drill run.

3. Rock Description


Rock Quality Designation (RQD) is a rough measure of the degree of jointing or fracture in a rock mass. The RQD is calculated as the cumulative length of rock pieces recovered having lengths of 100 mm or more divided by the length of coring. The qualitative description of the bedrock based on RQD is given below.

Rock Quality Designation (RQD) (%)	Description of Rock Quality
0 – 25	Very poor
25 – 50	Poor
50 – 75	Fair
75 – 90	Good
90 – 100	Excellent

Strength classification of rock is presented below.

Strength Classification	Range of Unconfined Compressive Strength (MPa)
Extremely weak	< 1
Very weak	1 – 5
Weak	5 – 25
Medium strong	25 – 50
Strong	50 – 100
Very strong	100 – 250
Extremely strong	> 250

4. General Monitoring Well Data

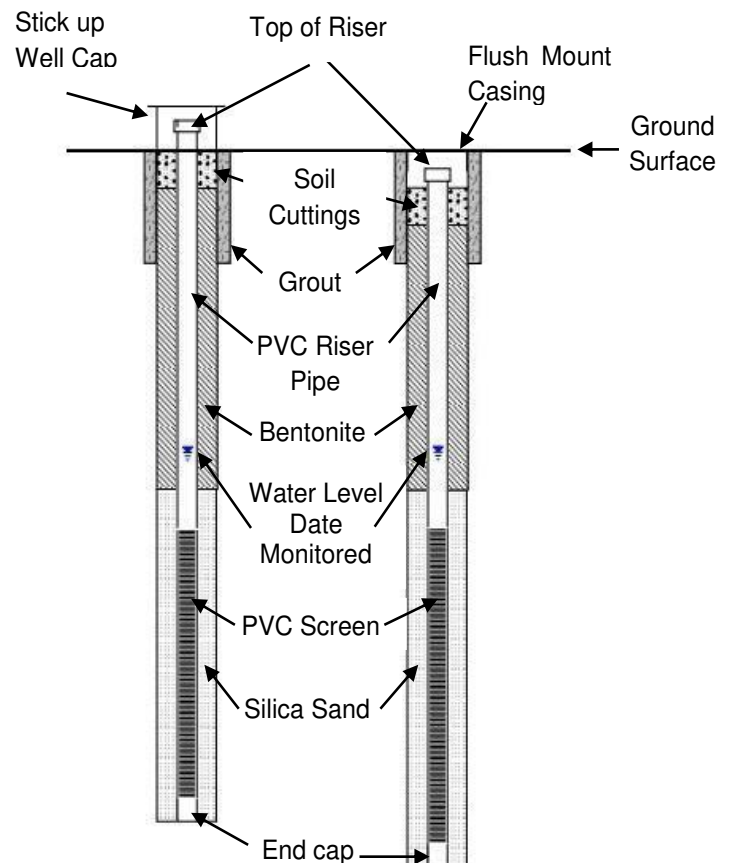

5. Classification of Soils for Engineering Purposes (ASTM D2487) (United Soil Classification System)

Major divisions			Group Symbol	Typical Names	Classification Criteria	
Coarse-grained soils More than 50% retained on No. 200 sieve* (>0.075 mm)	Gravels More than 50% of coarse fraction retained on No. 4 sieve(4.75 mm)	Clean gravels <5% fines	GW	Well-graded gravel	Classification on basis of percentage of fines: Less than 5% pass No. 200 sieve - GW, GP, SW, SP More than 12% pass No. 200 sieve - GM, GC, SM, SC 5 to 12% pass No. 200 sieve - Borderline classifications, use of dual symbols	$C_u = \frac{D_{60}}{D_{10}} \geq 4$; $C_c = \frac{(D_{30})^2}{D_{10} \times D_{60}}$ between 1 and 3
			GP	Poorly graded gravel		Not meeting either C_u or C_c criteria for GW
		Gravels with >12% fines	GM	Silty gravel		Atterberg limits below "A" line or PI less than 4
			GC	Clayey gravel		Atterberg limits on or above "A" line and PI > 7
	Sands 50% or more of coarse fraction passes No. 4 sieve(<4.75 mm)	Clean sands <5% fines	SW	Well-graded sand		$C_u = \frac{D_{60}}{D_{10}} \geq 6$; $C_c = \frac{(D_{30})^2}{D_{10} \times D_{60}}$ between 1 and 3
			SP	Poorly graded sand		Not meeting either C_u or C_c criteria for SW
		Sands with >12% fines	SM	Silty sand		Atterberg limits below "A" line or PI less than 4
			SC	Clayey sand		Atterberg limits on or above "A" line and PI > 7
Fine-grained soils 50% or more passes No. 200 sieve* (<0.075 mm)	Silts and Clays Liquid Limit <50%	Inorganic	ML	Silt	If 15 to 29% coarse-grained, add "with sand" or "with gravel" as appropriate. If >30% coarse-grained, add "sandy" or "gravelly" as appropriate. Class as organic when oven dried liquid limit is <75% of undried liquid limit.	<p>Plasticity Chart</p> <p>Equation of U-Line: Vertical at LL=16 to PI=7, then PI=0.9(LL-8)</p> <p>Equation of A-Line: Horizontal at PI=4 to LL=25.5, then PI=0.73(LL-20)</p>
			CL	Lean Clay -low plasticity		
		Organic	OL	Organic clay or silt (Clay plots above 'A' Line)		
	Silts and Clays Liquid Limit >50%	Inorganic	MH	Elastic silt		
			CH	Fat Clay -high plasticity		
		Organic	OH	Organic clay or silt (Clay plots above 'A' Line)		
	Highly Organic Soils		PT	Peat, muck and other highly organic soils		


APPENDIX D

Laboratory Results

LRL Associates Ltd.
PLASTICITY INDEX
ASTM D 4318 / LS-703/704

Client: Entrepreneur Holding Corporation
Project: Geotechnical Investigation
Location: 363 Entrepreneur Crescent, Navan, ON.

File No.: 220487
Report No.: 1
Date: November 17, 2022

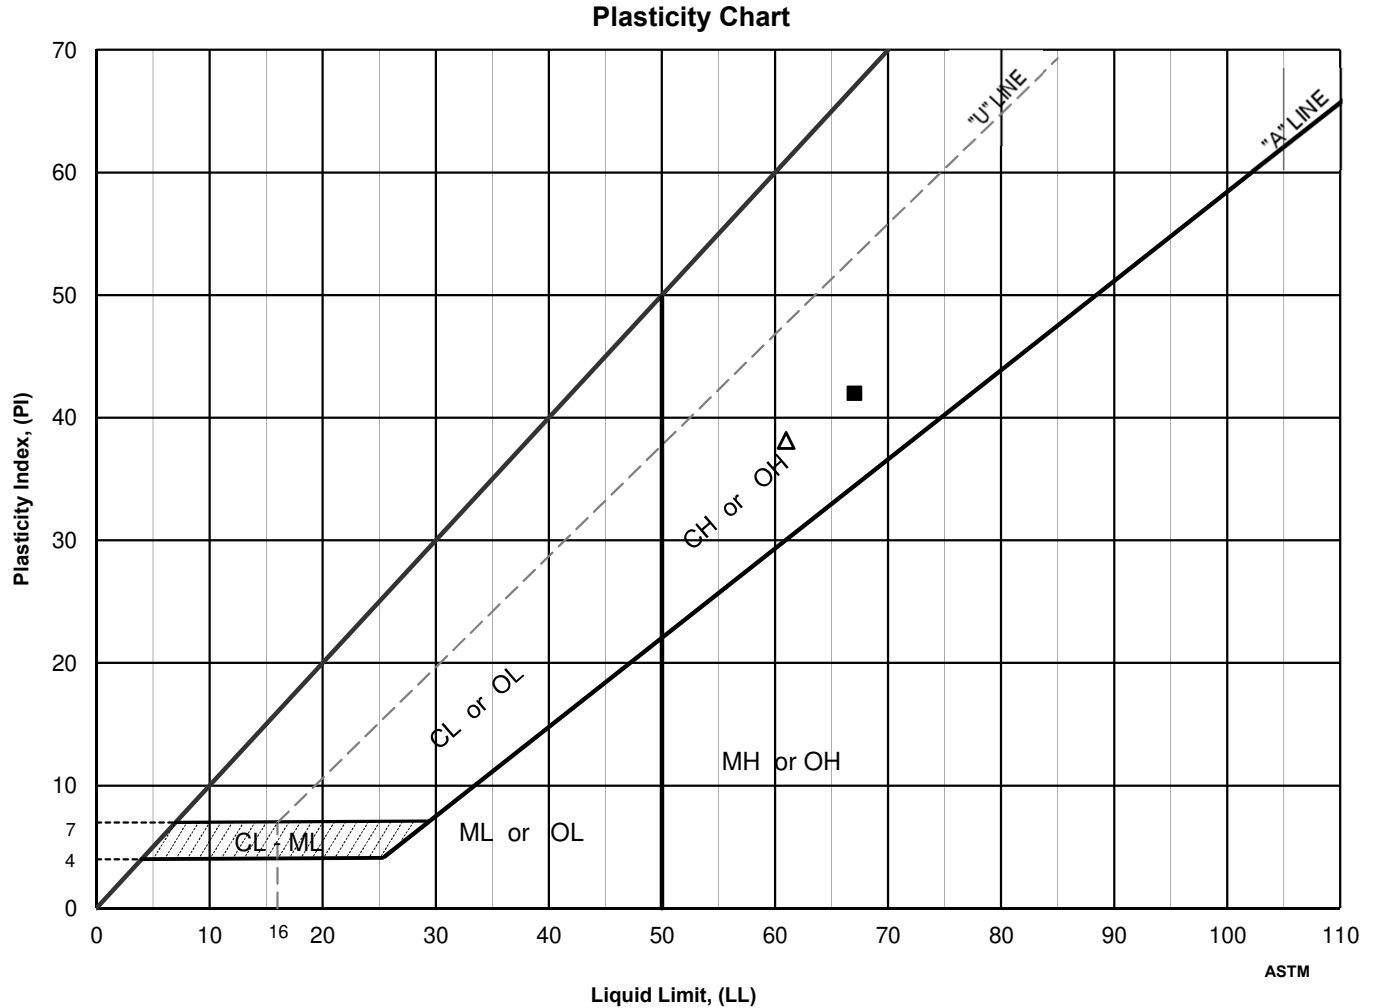

△
■

Location	Sample	Depth, m	Moisture Content, %	Liquid Limit	Plastic Limit	Plasticity Index	Liquidity Index	Activity Number	USCS
BH 3	SS-5	4.57 - 5.18	90	61	23	38	1.75	n/d	CH
BH 4	SS-3	1.52 - 2.13	77	67	25	42	1.24	n/d	CH



PARTICLE SIZE ANALYSIS

ASTM D 422 / LS-702

Client: Entrepreneur Holding Corporation


Project: Geotechnical Investigation

Location: 363 Entrepreneur Crescent, Navan, ON.

File No.: 220487

Report No.: 2

Date: November 17, 2022

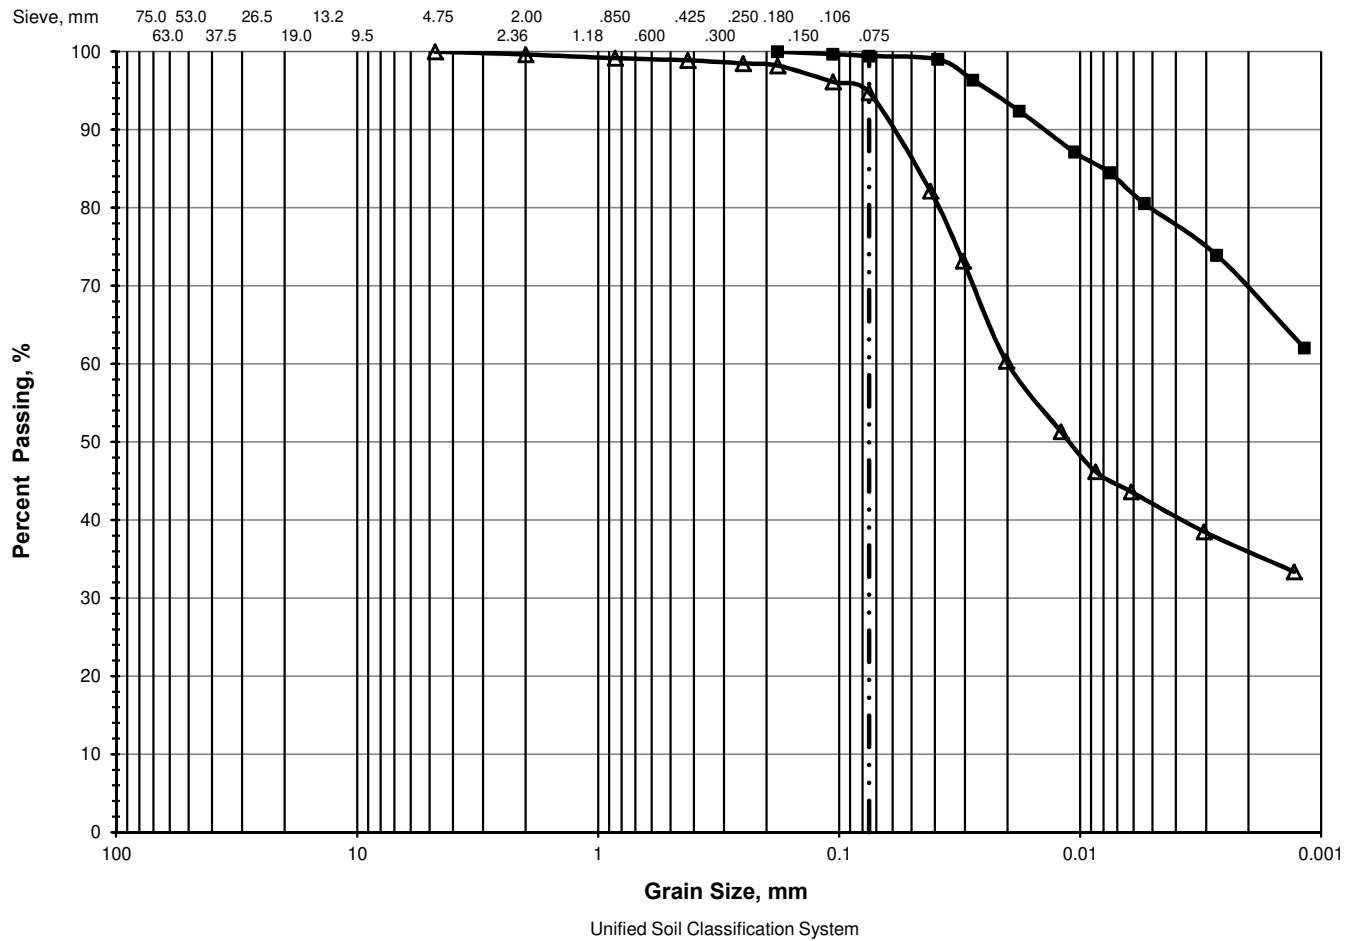

	% GRAVEL		% SAND			% FINES	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
△	0.0	0.0	0.4	0.8	4.1	59.3	35.4
■	0.0	0.0	0.0	0.0	0.6	31.0	68.4

	Location	Sample	Depth, m	D ₆₀	D ₅₀	D ₃₀	D ₁₅	D ₁₀	C _c	C _u
△	BH 1	SS-3	1.52 - 2.13	0.0199	0.0111					
■	BH 2	SS-7	6.10 - 6.71							




LRL Associates Ltd.
PLASTICITY INDEX
ASTM D 4318 / LS-703/704

Client: Entrepreneur Holding Corporation
Project: Geotechnical Investigation
Location: 363 Entrepreneur Crescent, Navan, ON.

File No.: 220487
Report No.: 1
Date: July 3, 2024

Plasticity Chart

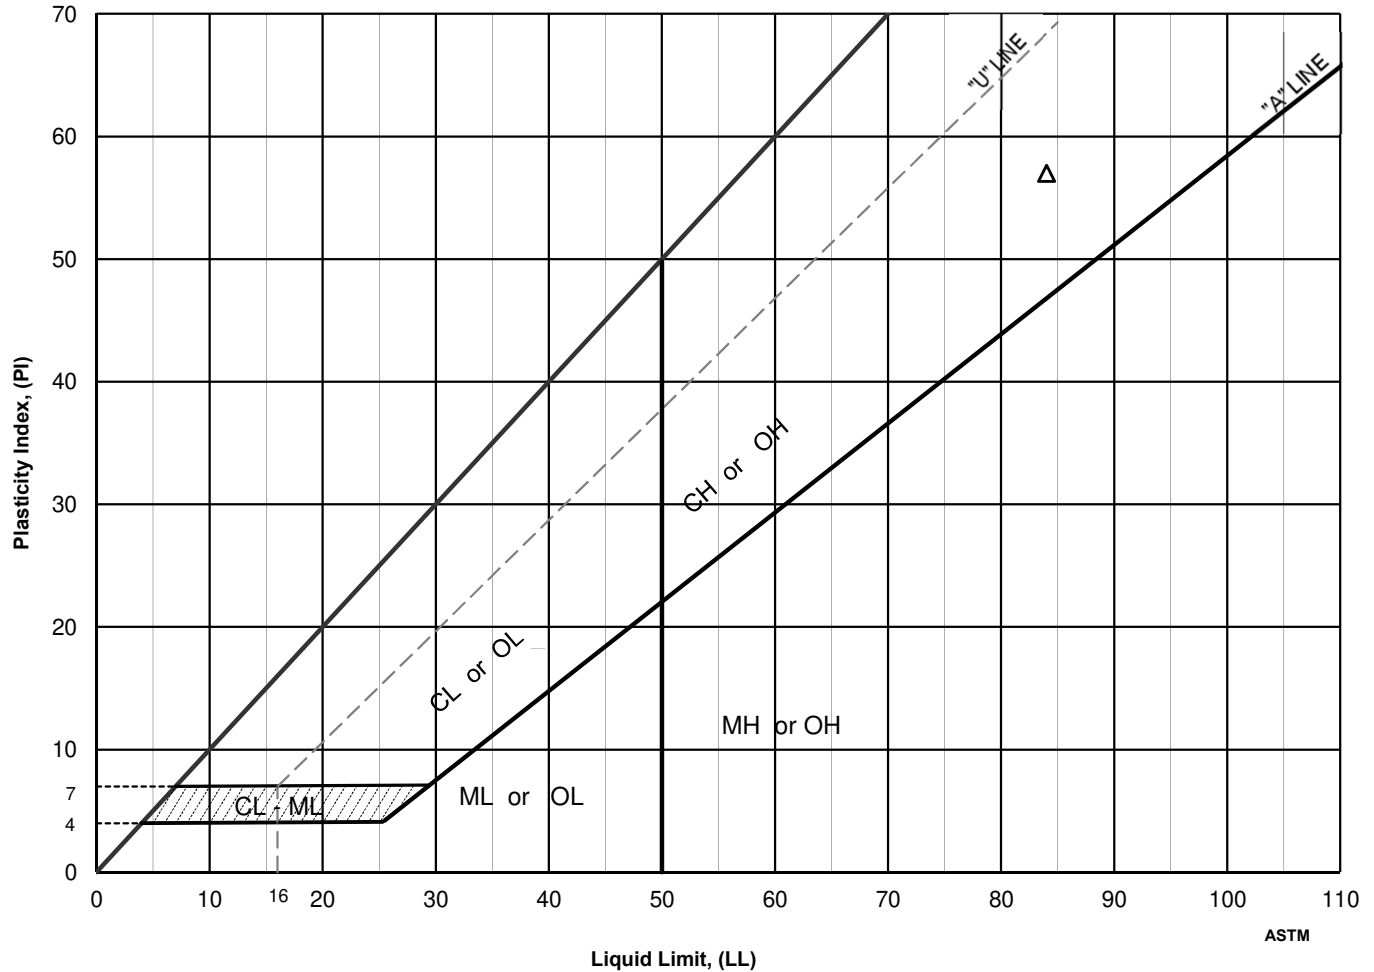

△

Location	Sample	Depth, m	Moisture Content, %	Liquid Limit	Plastic Limit	Plasticity Index	Liquidity Index	Activity Number	USCS
BH 5	SS-2	1.52 - 2.13	79	84	27	57	0.90	0.85	CH




CONSOLIDATION TEST

FIGURE 1

LRL Associates, File# 220487

Void Ratio vs Pressure

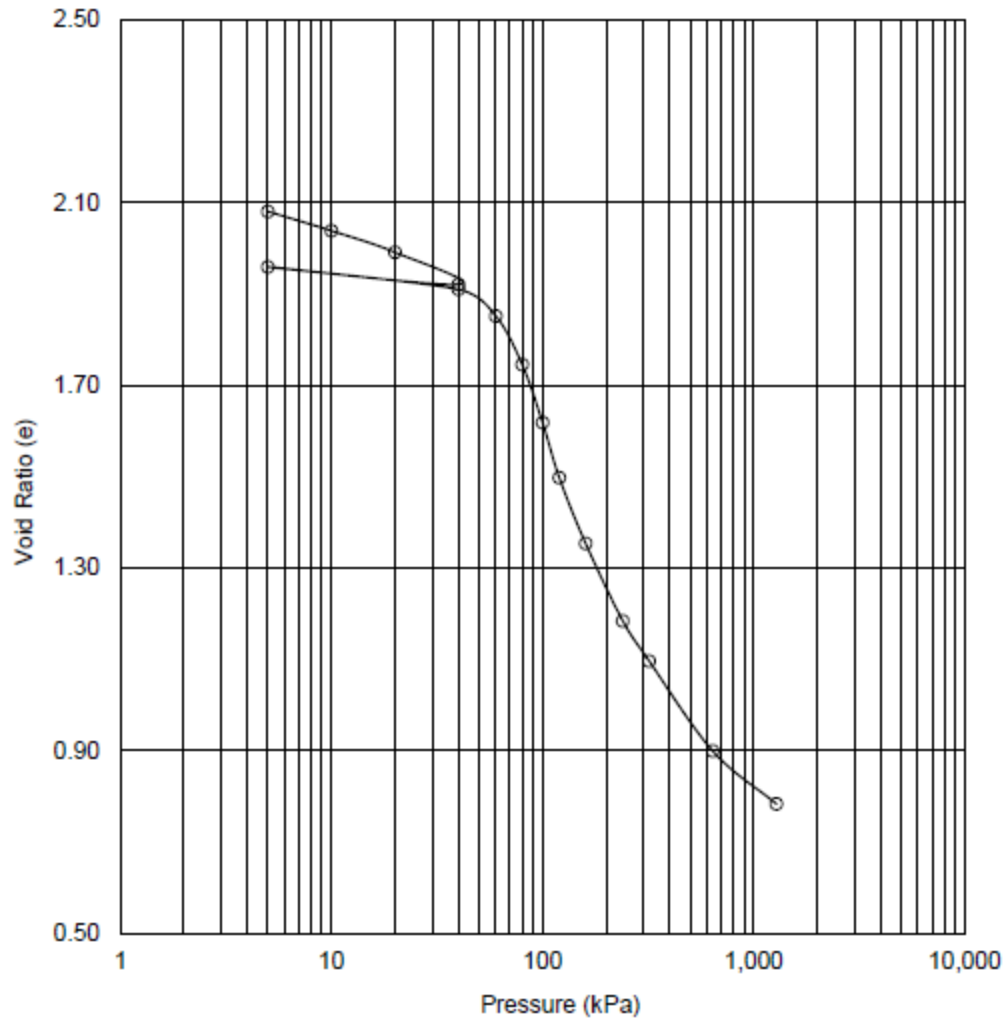

Soil Type : <i>Silty clay with occasional sand seams(≈40 mm), soft to firm, brown, wet</i>			
$e_o =$	2.15	$w_L =$	N/A
$w =$	78%	$w_p =$	N/A
$\gamma =$	15.2 kN/m ³	$PI =$	N/A
$G_s =$	2.75	$\sigma_{v0}' =$	kPa
		$\sigma_p' =$	kPa

Project No. : 121699000
Date : 18-Jul-24

Prepared By : DB
Checked By : RG

Certificate of Analysis

LRL Associates Ltd.

5430 Canotek Road
Ottawa, ON K1J 9G2
Attn: Brad Johnson

Client PO:
Project: 220487
Custody: 141038

Report Date: 6-Dec-2022

Order Date: 30-Nov-2022

Order #: 2249226

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

Paracel ID	Client ID
2249226-01	BH 4 5-7'

Approved By:



Milan Ralitsch, PhD

Senior Technical Manager

Certificate of Analysis

Report Date: 06-Dec-2022

Client: LRL Associates Ltd.

Order Date: 30-Nov-2022

Client PO:

Project Description: 220487

Analysis Summary Table

Analysis	Method Reference/Description	Extraction Date	Analysis Date
Anions	EPA 300.1 - IC, water extraction	2-Dec-22	2-Dec-22
pH, soil	EPA 150.1 - pH probe @ 25 °C, CaCl buffered ext.	1-Dec-22	2-Dec-22
Resistivity	EPA 120.1 - probe, water extraction	5-Dec-22	5-Dec-22
Solids, %	CWS Tier 1 - Gravimetric	1-Dec-22	2-Dec-22

Certificate of Analysis

Client: LRL Associates Ltd.

Client PO:

Report Date: 06-Dec-2022

Order Date: 30-Nov-2022

Project Description: 220487

Summary of Criteria Exceedances

(If this page is blank then there are no exceedances)

Only those criteria that a sample exceeds will be highlighted in red

Regulatory Comparison:

Paracel Laboratories has provided regulatory guidelines on this report for informational purposes only and makes no representations or warranties that the data is accurate or reflects the current regulatory values. The user is advised to consult with the appropriate official regulations to evaluate compliance. Sample results that are highlighted have exceeded the selected regulatory limit. Calculated uncertainty estimations have not been applied for determining regulatory exceedances.

Sample	Analyte	MDL / Units	Result	-	-
--------	---------	-------------	--------	---	---

Certificate of Analysis

Report Date: 06-Dec-2022

Client: LRL Associates Ltd.

Order Date: 30-Nov-2022

Client PO:

Project Description: 220487

Client ID:	BH 4 5-7'	-	-	-	-
Sample Date:	17-Nov-22 12:00	-	-	-	-
Sample ID:	2249226-01	-	-	-	-
Matrix:	Soil	-	-	-	-
MDL/Units					

Physical Characteristics

% Solids	0.1 % by Wt.	56.5	-	-	-	-
----------	--------------	------	---	---	---	---

General Inorganics

pH	0.05 pH Units	7.44	-	-	-	-
Resistivity	0.1 Ohm.m	21.2	-	-	-	-

Anions

Chloride	5 ug/g	101	-	-	-	-
Sulphate	5 ug/g	78	-	-	-	-

Certificate of Analysis

Report Date: 06-Dec-2022

Client: LRL Associates Ltd.

Order Date: 30-Nov-2022

Client PO:

Project Description: 220487

Method Quality Control: Blank

Analyte	Result	Reporting Limit	Units	%REC	%REC Limit	RPD	RPD Limit	Notes
Anions								
Chloride	ND	5	ug/g					
Sulphate	ND	5	ug/g					
General Inorganics								
Resistivity	ND	0.10	Ohm.m					

Certificate of Analysis

Report Date: 06-Dec-2022

Client: LRL Associates Ltd.

Order Date: 30-Nov-2022

Client PO:

Project Description: 220487

Method Quality Control: Duplicate

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Anions									
Chloride	18.5	5	ug/g	18.1			2.4	20	
Sulphate	10.5	5	ug/g	9.28			12.3	20	
General Inorganics									
pH	8.02	0.05	pH Units	7.91			1.4	10	
Resistivity	21.4	0.10	Ohm.m	21.3			0.4	20	
Physical Characteristics									
% Solids	82.6	0.1	% by Wt.	82.4			0.2	25	

Certificate of Analysis

Report Date: 06-Dec-2022

Client: LRL Associates Ltd.

Order Date: 30-Nov-2022

Client PO:

Project Description: 220487

Method Quality Control: Spike

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Anions									
Chloride	126	5	ug/g	18.1	108	82-118			
Sulphate	121	5	ug/g	9.28	112	80-120			

Certificate of Analysis

Client: LRL Associates Ltd.

Client PO:

Report Date: 06-Dec-2022

Order Date: 30-Nov-2022

Project Description: 220487

Qualifier Notes:**Sample Data Revisions:**

None

Work Order Revisions / Comments:

None

Other Report Notes:

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

Soil results are reported on a dry weight basis unless otherwise noted.

Where %Solids is reported, moisture loss includes the loss of volatile hydrocarbons.

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.

APPENDIX E

Supporting Documentation – Phase II ESA Borehole Logs

**LRJ**ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434**PROJECT NO.:** 220487**CLIENT:** ENTREPRENEUR HOLDING CORPORATION**DATE:** MARCH 14, 2023**BOREHOLE LOG:** BH23-1**PROJECT:** PHASE II ENVIRONMENTAL SITE ASSESSMENT**LOCATION:** 363 ENTREPRENEUR CRESCENT, OTTAWA, ONTARIO**FIELD PERSONNEL:** ABDUL KADER**DRILLER:** GEORGE DOWNING ESTATE DRILLING LTD.**DRILLING EQUIPMENT:** TRACK MOUNTED GEO-PROBE**DRILLING METHOD:** DIRECT PUSH

DEPTH	SOIL DESCRIPTION	ELEV./DEPTH (m)	LITHOLOGY	TYPE	SAMPLE NUMBER	N OR RQD (%)	RECOVERY (%)	LABORATORY ANALYSIS	Combustible Soil Vapours (ppm)		MONITORING WELL DETAILS
									10 30 50 70 90	ISOBUTYLENE (ppm) 200 600 1000 1400 1800	
0.0	FILL: Sand and gravel, grey, loose, moist, saturated at (0.0 - 0.2 m bgs).	99.88 0.00	+		SS1 (SS50)		100	PHC, VOC, Metals & General Inorganics	0.1		
1.0			+								
2.0			+								
3.0	SAND: Silty, brown, moist becoming saturated with depth.	99.03 0.85	▨		SS2				<0.1		
4.0			▨								
5.0	CLAY: Silty at (1.20 - 1.95 m bgs) and at (3.65 - 4.50 m bgs), grey, brown at (1.20 - 1.95 m bgs), saturated.	98.68 1.20	▨		SS3		100	PHC & VOC	<0.1		
6.0			▨								
7.0			▨		SS4			PAH & PCB	<0.1		
8.0			▨								
9.0			▨		SS5		100		<0.1		
10.0			▨								
11.0			▨		SS6				<0.1		
12.0			▨								
13.0			▨		SS7		100		<0.1		
14.0			▨								
15.0			▨		SS8				<0.1		
16.0			▨								
17.0			▨		SS9		100		<0.1		
18.0			▨								
19.0			▨		SS10				<0.1		
20.0	End of Borehole	93.88 6.0									

EASTING: 18T 0465761**NORTHING:** 5020902**SITE DATUM:** Elevations measured from temporary benchmark established at the top surface of the Entrepreneur Crescent Centerline opposite the the Site entrance (100.00 m).**GROUND SURFACE ELEVATION:** 99.88 m**TOP OF RISER ELEVATION:** N/A**HOLE DIAMETER:** 91 mm**MONITORING WELL DIAMETER:** N/A**NOTES:**bgs: Below Ground Surface
VOC: Volatile Organic Compounds
PHC: Petroleum Hydrocarbons
PAH: Polycyclic Aromatic Hydrocarbons
PCB: Polychlorinated Biphenyls
N/A: Not applicable



LRJ
ENGINEERING | INGENIERIE
5430 Canotek Road, Ottawa, ON K1J 9G2
www.lrj.ca | (613) 842-3434

PROJECT NO.: 220487

CLIENT: ENTREPRENEUR HOLDING CORPORATION

DATE: MARCH 14, 2023

BOREHOLE LOG: BH/MW23-2

PROJECT: PHASE II ENVIRONMENTAL SITE ASSESSMENT


LOCATION: 363 ENTREPRENEUR CRESCENT, OTTAWA, ONTARIO

FIELD PERSONNEL: ABDUL KADER

DRILLER: GEORGE DOWNING ESTATE DRILLING LTD.

DRILLING EQUIPMENT: TRACK MOUNTED GEO-PROBE

DRILLING METHOD: DIRECT PUSH

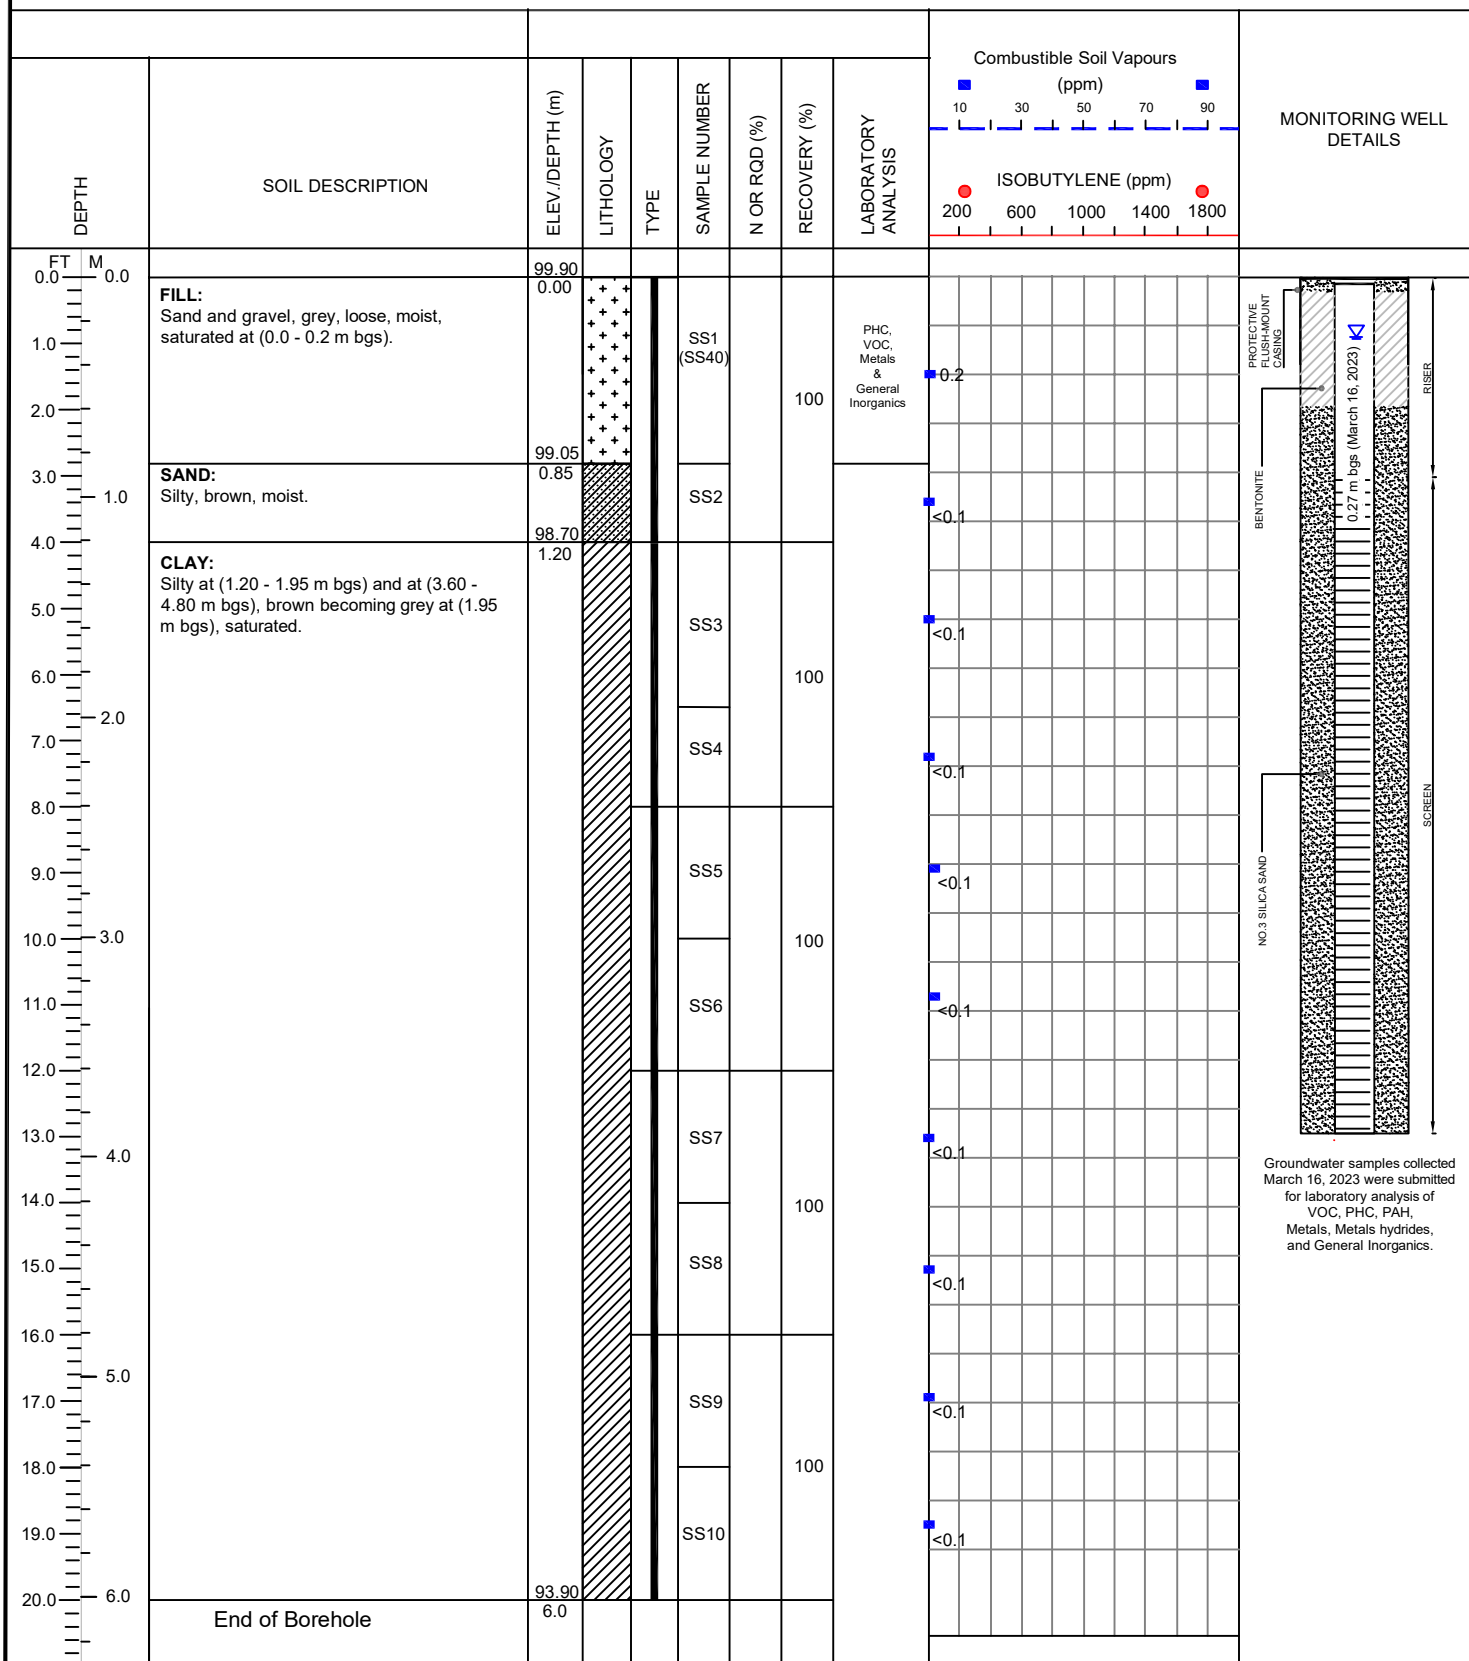

EASTING: 18T 0465753

NORTHING: 5020904

SITE DATUM: Elevations measured from temporary benchmark established at the top surface of the Entrepreneur Crescent Centerline opposite the the Site entrance (100.00 m).

GROUND SURFACE ELEVATION: 99.90 m


TOP OF RISER ELEVATION: N/A

HOLE DIAMETER: 91 mm

MONITORING WELL DIAMETER: N/A

NOTES:


bgs: Below Ground Surface
VOC: Volatile Organic Compounds
PHC: Petroleum Hydrocarbons
PAH: Polycyclic Aromatic Hydrocarbons
PCB: Polychlorinated Biphenyls
N/A: Not applicable

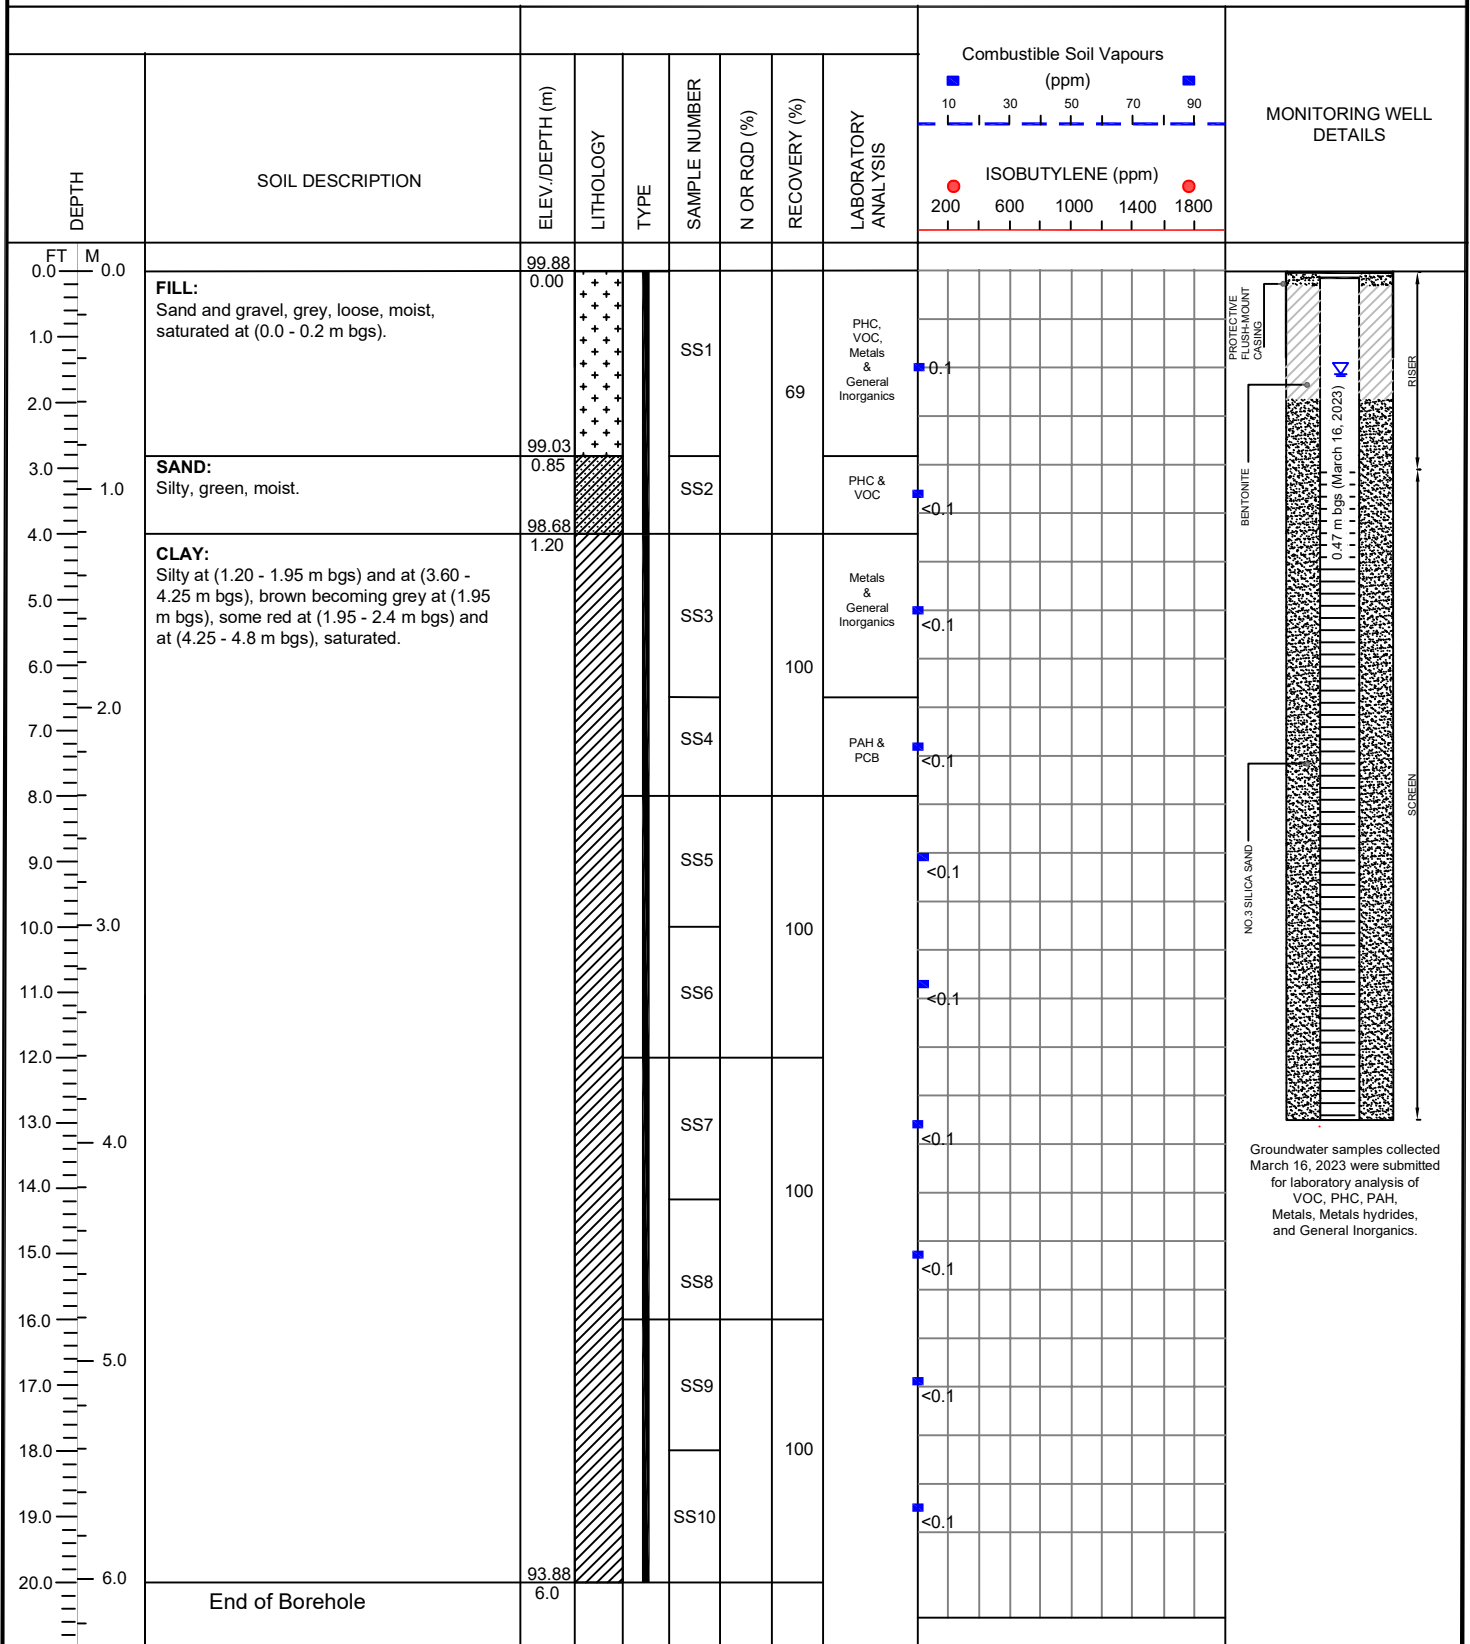**LRJ**ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434**PROJECT NO.:** 220487**CLIENT:** ENTREPRENEUR HOLDING CORPORATION**DATE:** MARCH 14, 2023**BOREHOLE LOG: BH/MW23-3****PROJECT:** PHASE II ENVIRONMENTAL SITE ASSESSMENT**LOCATION:** 363 ENTREPRENEUR CRESCENT, OTTAWA, ONTARIO**FIELD PERSONNEL:** ABDUL KADER**DRILLER:** GEORGE DOWNING ESTATE DRILLING LTD.**DRILLING EQUIPMENT:** TRACK MOUNTED GEO-PROBE**DRILLING METHOD:** DIRECT PUSH**EASTING:** 18T 0465763**NORTHING:** 5020877**SITE DATUM:** Elevations measured from temporary benchmark established at the top surface of the Entrepreneur Crescent Centerline opposite the Site entrance (100.00 m).**GROUND SURFACE ELEVATION:** 99.88 m**TOP OF RISER ELEVATION:** N/A**HOLE DIAMETER:** 91 mm**MONITORING WELL DIAMETER:** N/A**NOTES:**bgs: Below Ground Surface
VOC: Volatile Organic Compounds
PHC: Petroleum Hydrocarbons
PAH: Polycyclic Aromatic Hydrocarbons
PCB: Polychlorinated Biphenyls
N/A: Not applicable

**LRJ**ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434**PROJECT NO.:** 220487**CLIENT:** ENTREPRENEUR HOLDING CORPORATION**DATE:** MARCH 13, 2023**BOREHOLE LOG: BH/MW23-4****PROJECT:** PHASE II ENVIRONMENTAL SITE ASSESSMENT**LOCATION:** 363 ENTREPRENEUR CRESCENT, OTTAWA, ONTARIO**FIELD PERSONNEL:** ABDUL KADER**DRILLER:** GEORGE DOWNING ESTATE DRILLING LTD.**DRILLING EQUIPMENT:** TRACK MOUNTED GEO-PROBE**DRILLING METHOD:** DIRECT PUSH

DEPTH	SOIL DESCRIPTION	ELEV./DEPTH (m)	LITHOLOGY	TYPE	SAMPLE NUMBER	N OR RQD (%)	RECOVERY (%)	LABORATORY ANALYSIS	Combustible Soil Vapours (ppm)		MONITORING WELL DETAILS
									ISOBTYLENE (ppm)		
FT 0.0 1.0 2.0 3.0 4.0 5.0 6.0 7.0 8.0 9.0 10.0 11.0 12.0 13.0 14.0 15.0 16.0 17.0 18.0 19.0 20.0	M 0.0 1.0 2.0 3.0 4.0 5.0 6.0 7.0 8.0 9.0 10.0 11.0 12.0 13.0 14.0 15.0 16.0 17.0 18.0 19.0 20.0	99.87 0.00 98.87 1.0 98.67 1.20 93.87 6.0			SS1 SS2 SS3 SS4 SS5 SS6 SS7 SS8 SS9 SS10		65 100 100 100	Metals & General Inorganics PHC & Metals Metals & General Inorganics PAH & PCB	0.1 <0.1 <0.1 <0.1 <0.1 <0.1 <0.1 <0.1 <0.1 <0.1		PROTECTIVE FLUSHMOUNT CASING BENTONITE 0.55 m bgs (March 16, 2023) NO.3 SILICA SAND SCREEN RISER
	FILL: Sand and gravel, grey, loose, moist, saturated at (0.0 - 0.2 m bgs).										
	SAND: Silty, brown, moist.										
	CLAY: Silty sandy at (1.20 - 2.0 m bgs), silty at (3.60 - 4.25 m bgs), brown becoming grey at (2.0 m bgs), saturated.										
	End of Borehole										

EASTING: 18T 0465769**NORTHING:** 5020895**SITE DATUM:** Elevations measured from temporary benchmark established at the top surface of the Entrepreneur Crescent Centerline opposite the Site entrance (100.00 m).**GROUND SURFACE ELEVATION:** 99.87 m**TOP OF RISER ELEVATION:** N/A**HOLE DIAMETER:** 91 mm**MONITORING WELL DIAMETER:** N/A**NOTES:**bgs: Below Ground Surface
VOC: Volatile Organic Compounds
PHC: Petroleum Hydrocarbons
PAH: Polycyclic Aromatic Hydrocarbons
PCB: Polychlorinated Biphenyls
N/A: Not applicable

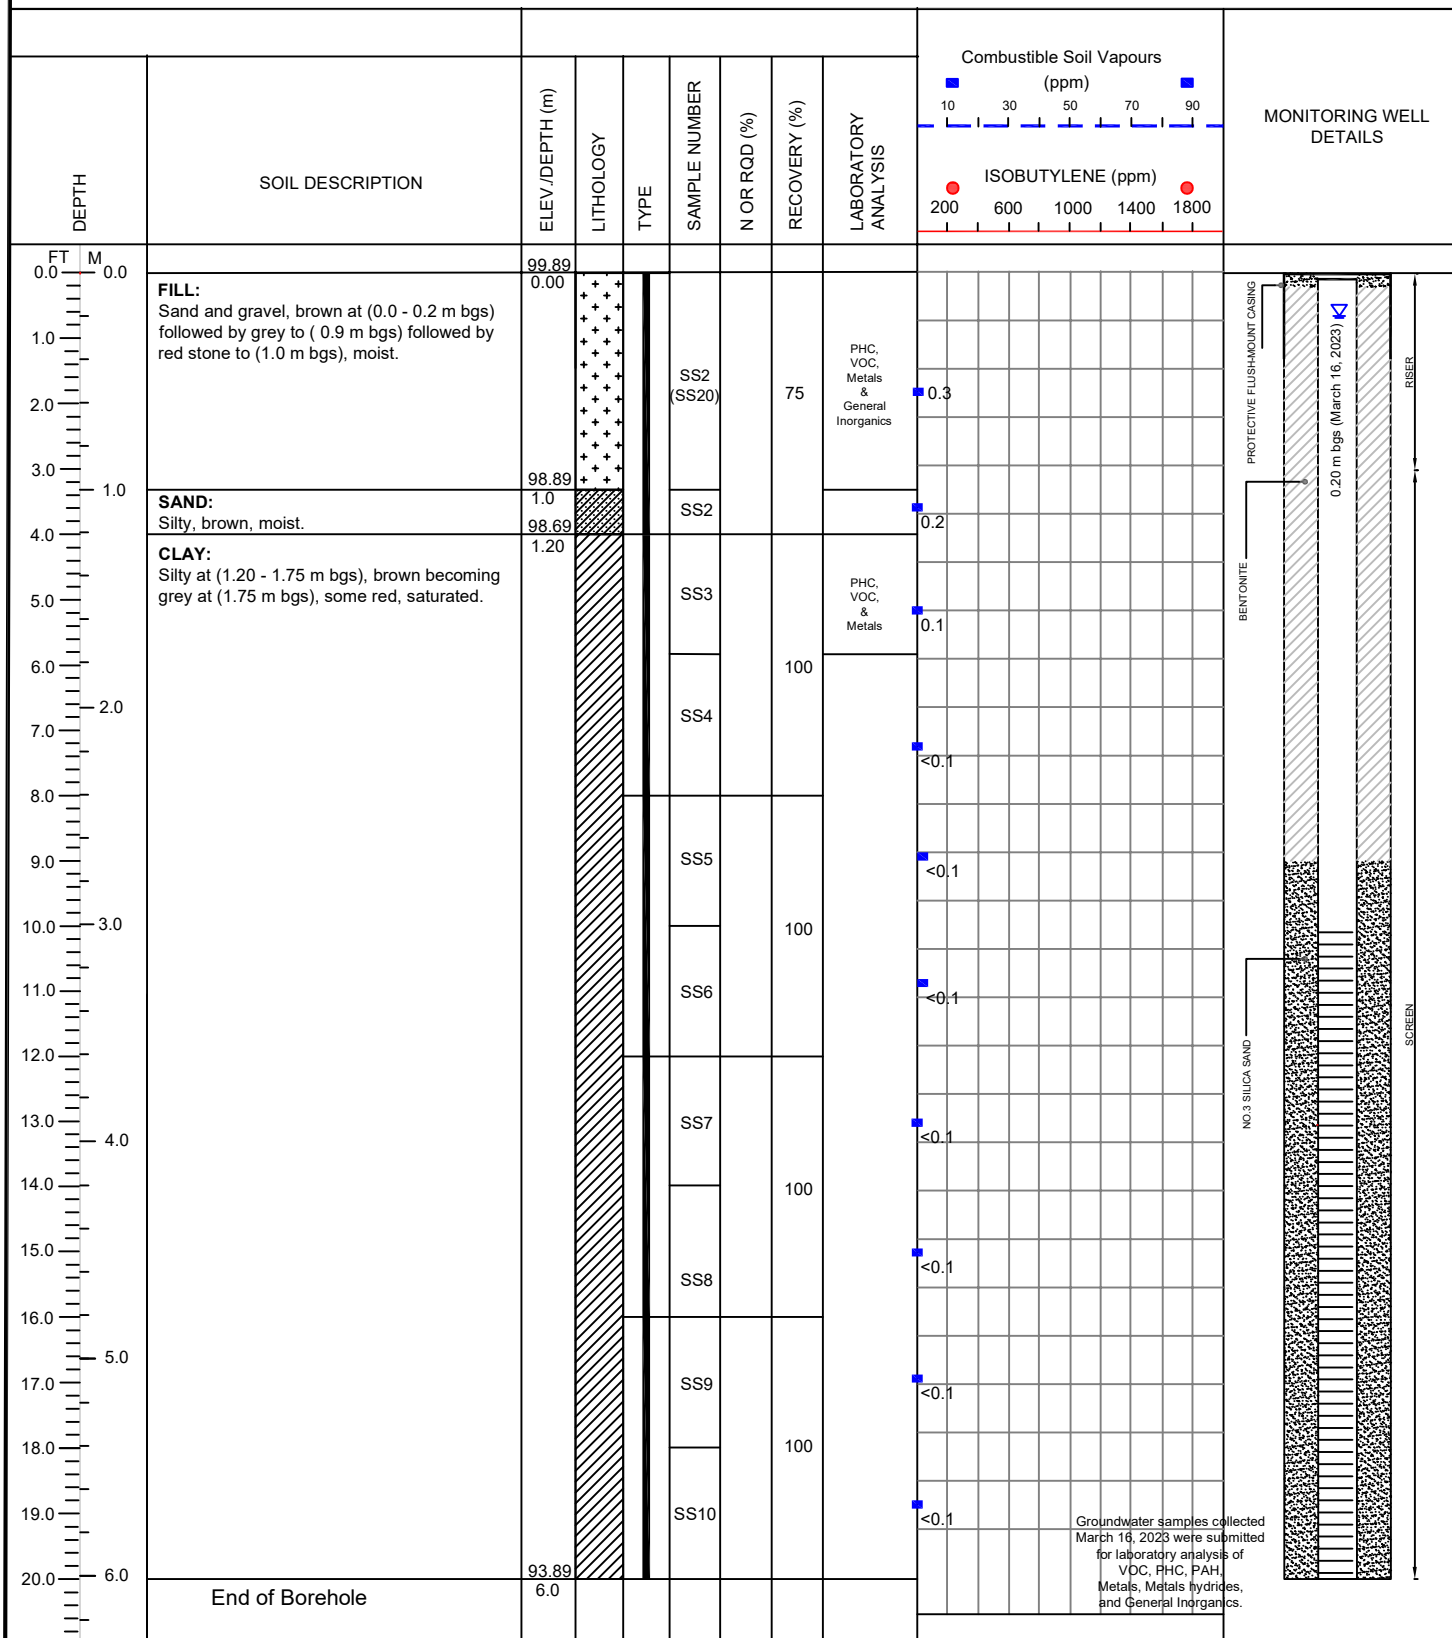**LRJ**ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434**PROJECT NO.:** 220487**CLIENT:** ENTREPRENEUR HOLDING CORPORATION**DATE:** MARCH 13, 2023**BOREHOLE LOG: BH/MW23-5****PROJECT:** PHASE II ENVIRONMENTAL SITE ASSESSMENT**LOCATION:** 363 ENTREPRENEUR CRESCENT, OTTAWA, ONTARIO**FIELD PERSONNEL:** ABDUL KADER**DRILLER:** GEORGE DOWNING ESTATE DRILLING LTD.**DRILLING EQUIPMENT:** TRACK MOUNTED GEO-PROBE**DRILLING METHOD:** DIRECT PUSH**EASTING:** 18T 0465749**NORTHING:** 5020933**SITE DATUM:** Elevations measured from temporary benchmark established at the top surface of the Entrepreneur Crescent Centerline opposite the the Site entrance (100.00 m).**GROUND SURFACE ELEVATION:** 99.89 m**TOP OF RISER ELEVATION:** N/A**HOLE DIAMETER:** 91 mm**MONITORING WELL DIAMETER:** N/A**NOTES:**bgs: Below Ground Surface
VOC: Volatile Organic Compounds
PHC: Petroleum Hydrocarbons
PAH: Polycyclic Aromatic Hydrocarbons
PCB: Polychlorinated Biphenyls
N/A: Not applicable

**LRJ**ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lri.ca | (613) 842-3434

PROJECT NO.: 220487

CLIENT: ENTREPRENEUR HOLDING CORPORATION

DATE: MARCH 13, 2023

BOREHOLE LOG: BH23-6

PROJECT: PHASE II ENVIRONMENTAL SITE ASSESSMENT

LOCATION: 363 ENTREPRENEUR CRESCENT, OTTAWA, ONTARIO

FIELD PERSONNEL: ABDUL KADER

DRILLER: GEORGE DOWNING ESTATE DRILLING LTD.

DRILLING EQUIPMENT: TRACK MOUNTED GEO-PROBE

DRILLING METHOD: DIRECT PUSH

									Combustible Soil Vapours (ppm)		MONITORING WELL DETAILS				
DEPTH	SOIL DESCRIPTION	ELEV./DEPTH (m)	LITHOLOGY	TYPE	SAMPLE NUMBER	N OR RQD (%)	RECOVERY (%)	LABORATORY ANALYSIS	10	30		50	70	90	
									ISOBUTYLENE (ppm)					200	600
0.0 0.0	FILL: Sand and gravel, brown at (0.0 - 0.35 m bgs) followed by grey to (0.85 m bgs), dry, loose.	99.90 0.00			SS1		100		PHC, VOC, Metals & General Inorganics	0.1					
1.0															
2.0															
3.0 1.0	SAND: Silty, brown, moist.	99.05 0.85			SS2					0.1					
4.0															
5.0	CLAY: Silty sandy at (1.20 - 1.9 m bgs), silty at (4.8 - 6.0 m bgs), brown becoming grey with depth, saturated, the sampling tube was empty at (3.6 - 4.8 m bgs) due to high water content.	98.70 1.20			SS3		100			<0.1					
6.0															
7.0 2.0						SS4				<0.1					
8.0															
9.0						SS5		100		<0.1					
10.0 3.0						SS6				<0.1					
11.0															
12.0															
13.0															
14.0															
15.0															
16.0															
17.0 5.0					SS7		100			<0.1					
18.0															
19.0					SS8					<0.1					
20.0 6.0	End of Borehole	93.90 6.0													

EASTING: 18T 0465743

NORTHING: 5020927

SITE DATUM: Elevations measured from temporary benchmark established at the top surface of the Entrepreneur Crescent Centerline opposite the Site entrance (100.00 m).

GROUNDSURFACE ELEVATION: 99.90 m

TOP OF RISER ELEVATION: N/A

HOLE DIAMETER: 91 mm

MONITORING WELL DIAMETER: N/A

NOTES:bgs: Below Ground Surface
VOC: Volatile Organic Compounds
PHC: Petroleum Hydrocarbons
PAH: Polycyclic Aromatic Hydrocarbons
PCB: Polychlorinated Biphenyls
N/A: Not applicable

**LRJ**ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrj.ca | (613) 842-3434**PROJECT NO.:** 220487**CLIENT:** ENTREPRENEUR HOLDING CORPORATION**DATE:** MARCH 14, 2023**BOREHOLE LOG: BH23-7****PROJECT:** PHASE II ENVIRONMENTAL SITE ASSESSMENT**LOCATION:** 363 ENTREPRENEUR CRESCENT, OTTAWA, ONTARIO**FIELD PERSONNEL:** ABDUL KADER**DRILLER:** GEORGE DOWNING ESTATE DRILLING LTD.**DRILLING EQUIPMENT:** TRACK MOUNTED GEO-PROBE**DRILLING METHOD:** DIRECT PUSH

DEPTH	SOIL DESCRIPTION	ELEV./DEPTH (m)	LITHOLOGY	TYPE	SAMPLE NUMBER	N OR RQD (%)	RECOVERY (%)	LABORATORY ANALYSIS	Combustible Soil Vapours (ppm)	MONITORING WELL DETAILS
									ISOBUTYLENE (ppm)	
0.0 0.0	FILL: Sand and gravel, grey, dry, moist at (0.0 - 0.1 m bgs).	99.89 0.00								
1.0					SS1		71	PHC, VOC, Metals & General Inorganics	0.3	
2.0										
3.0		98.89 1.0			SS2				<0.1	
4.0	SAND: Silty, brown, moist.	98.69 1.20								
5.0	CLAY: Silty at (1.20 - 1.95 m bgs) and at (3.6 - 4.20 m bgs), grey, brown at (1.20 - 1.95 m bgs), some red at (1.20 - 2.4 m bgs) and at (4.8 - 6.0 m bgs), saturated.				SS3		100	Metals	<0.1	
6.0										
7.0					SS4				<0.1	
8.0										
9.0					SS5				<0.1	
10.0							100			
11.0					SS6				<0.1	
12.0										
13.0					SS7				<0.1	
14.0							100			
15.0					SS8				<0.1	
16.0										
17.0					SS9				<0.1	
18.0							100			
19.0					SS10				<0.1	
20.0										
6.0	End of Borehole	93.89 6.0								

EASTING: 18T 0465765**NORTHING:** 5020919**SITE DATUM:** Elevations measured from temporary benchmark established at the top surface of the Entrepreneur Crescent Centerline opposite the Site entrance (100.00 m).**GROUND SURFACE ELEVATION:** 99.89 m**TOP OF RISER ELEVATION:** N/A**HOLE DIAMETER:** 91 mm**MONITORING WELL DIAMETER:** N/A**NOTES:**bgs: Below Ground Surface
VOC: Volatile Organic Compounds
PHC: Petroleum Hydrocarbons
PAH: Polycyclic Aromatic Hydrocarbons
PCB: Polychlorinated Biphenyls
N/A: Not applicable



LRJ
ENGINEERING | INGENIERIE
5430 Canotek Road Ottawa, ON, K1J 9G2
www.lri.ca | (613) 842-3434

PROJECT NO.: 220487

CLIENT: ENTREPRENEUR HOLDING CORPORATION

DATE: MARCH 13, 2023

BOREHOLE LOG: BH23-8

PROJECT: PHASE II ENVIRONMENTAL SITE ASSESSMENT

LOCATION: 363 ENTREPRENEUR CRESCENT, OTTAWA, ONTARIO

FIELD PERSONNEL: ABDUL KADER

DRILLER: GEORGE DOWNING ESTATE DRILLING LTD.

DRILLING EQUIPMENT: TRACK MOUNTED GEO-PROBE

DRILLING METHOD: DIRECT PUSH

DEPTH	SOIL DESCRIPTION	ELEV./DEPTH (m)	LITHOLOGY	TYPE	SAMPLE NUMBER	N OR RQD (%)	RECOVERY (%)	LABORATORY ANALYSIS	Combustible Soil Vapours (ppm)		MONITORING WELL DETAILS
									10 30 50 70 90	200 600 1000 1400 1800	
0.0	FILL: Sand and gravel, grey, moist.	99.87 0.00									
1.0					SS1		92		0.1		
2.0											
3.0	SAND: Silty to (1.10 m bgs), followed by silty clayey, brown with some red spots, wet.	98.07 0.80			SS2			PHC, VOC, Metals & General Inorganics	<0.1		
4.0											
5.0	CLAY: Silty at (1.20 - 1.95 m bgs), grey, grey-brown at (1.20 - 1.95 m bgs), some red at (1.95 - 2.4 m bgs), saturated.	98.67 1.20			SS3		100	Metals	<0.1		
6.0					SS4				<0.1		
7.0											
8.0					SS5		100		<0.1		
9.0					SS6				<0.1		
10.0											
11.0					SS7		100		<0.1		
12.0					SS8				<0.1		
13.0											
14.0					SS9		100		<0.1		
15.0					SS10				<0.1		
16.0											
17.0											
18.0											
19.0											
20.0	End of Borehole	93.87 6.0									

EASTING: 18T 0465756

NORTHING: 5020940

SITE DATUM: Elevations measured from temporary benchmark established at the top surface of the Entrepreneur Crescent Centerline opposite the Site entrance (100.00 m).

GROUND SURFACE ELEVATION: 99.87 m

TOP OF RISER ELEVATION: N/A

HOLE DIAMETER: 91 mm

MONITORING WELL DIAMETER: N/A

NOTES:

bgs: Below Ground Surface
VOC: Volatile Organic Compounds
PHC: Petroleum Hydrocarbons
PAH: Polycyclic Aromatic Hydrocarbons
PCB: Polychlorinated Biphenyls
N/A: Not applicable



LRJ

ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lri.ca | (613) 842-3434

PROJECT NO.: 220487

CLIENT: ENTREPRENEUR HOLDING CORPORATION

DATE: MARCH 14, 2023

BOREHOLE LOG: BH23-9

PROJECT: PHASE II ENVIRONMENTAL SITE ASSESSMENT

LOCATION: 363 ENTREPRENEUR CRESCENT, OTTAWA, ONTARIO

FIELD PERSONNEL: ABDUL KADER

DRILLER: GEORGE DOWNING ESTATE DRILLING LTD.

DRILLING EQUIPMENT: TRACK MOUNTED GEO-PROBE

DRILLING METHOD: DIRECT PUSH

DEPTH	SOIL DESCRIPTION	ELEV./DEPTH (m)	LITHOLOGY	TYPE	SAMPLE NUMBER	N OR RQD (%)	RECOVERY (%)	LABORATORY ANALYSIS	<div>Combustible Soil Vapours (ppm) 10 30 50 70 90 ISOBUTYLENE (ppm) 200 600 1000 1400 1800</div>	MONITORING WELL DETAILS
0.0	FILL: Sand and gravel, grey, dry, moist at (0.0 - 0.1 m bgs).	99.89 0.00								
1.0										
2.0					SS1		92	PHC, VOC, Metals & General Inorganics	<0.1	
3.0		98.89								
4.0	SAND: Silty, brown, moist.	1.0 98.69			SS2				<0.1	
5.0		1.20								
6.0	CLAY: Silty at (1.20 - 1.85 m bgs), grey-brown with some red at (1.20 - 1.85 m bgs) followed by grey at (1.85 - 2.4 m bgs), saturated.				SS3		100		<0.1	
7.0										
8.0					SS4				<0.1	
9.0		97.49								
10.0	End of Borehole	2.4								
11.0										
12.0										
13.0										
14.0										
15.0										
16.0										
17.0										
18.0										
19.0										
20.0										

EASTING: 18T 0465765

NORTHING: 5020921

SITE DATUM: Elevations measured from temporary benchmark established at the top surface of the Entrepreneur Crescent Centerline opposite the the Site entrance (100.00 m).

GROUND SURFACE ELEVATION: 99.89 m

TOP OF RISER ELEVATION: N/A

HOLE DIAMETER: 91 mm

MONITORING WELL DIAMETER: N/A

NOTES:

bgs: Below Ground Surface
VOC: Volatile Organic Compounds
PHC: Petroleum Hydrocarbons
PAH: Polycyclic Aromatic Hydrocarbons
PCB: Polychlorinated Biphenyls
N/A: Not applicable



LRJ
ENGINEERING | INGENIERIE
5430 Canotek Road, Ottawa, ON, K1J 9G2
www.lrj.ca | (613) 842-3434

PROJECT NO.: 220487

CLIENT: ENTREPRENEUR HOLDING CORPORATION

DATE: MARCH 14, 2023

BOREHOLE LOG: BH23-10

PROJECT: PHASE II ENVIRONMENTAL SITE ASSESSMENT

LOCATION: 363 ENTREPRENEUR CRESCENT, OTTAWA, ONTARIO

FIELD PERSONNEL: ABDUL KADER

DRILLER: GEORGE DOWNING ESTATE DRILLING LTD.

DRILLING EQUIPMENT: TRACK MOUNTED GEO-PROBE

DRILLING METHOD: DIRECT PUSH

DEPTH	SOIL DESCRIPTION	ELEV./DEPTH (m)	LITHOLOGY	TYPE	SAMPLE NUMBER	N OR RQD (%)	RECOVERY (%)	LABORATORY ANALYSIS	Combustible Soil Vapours (ppm)		MONITORING WELL DETAILS
									10 30 50 70 90	200 600 1000 1400 1800	
0.0	FILL: Sand and gravel, grey, dry, moist at (0.0 - 0.1 m bgs).	99.88 0.00	+					PHC, VOC, Metals & General Inorganics			
1.0					SS1		90		<0.1		
2.0											
3.0	SAND: Silty, brown, moist.	99.03 0.85	■		SS2			Metals		<0.1	
4.0		98.68 1.20	■								
5.0	CLAY: Silty at (1.20 - 1.9 m bgs), grey-brown with some red at (1.20 - 1.9 m bgs), followed by grey with red at (1.9 - 2.4 m bgs), saturated.		■		SS3		100		<0.1		
6.0											
7.0					SS4				<0.1		
8.0	End of Borehole	97.48 2.4									
9.0											
10.0											
11.0											
12.0											
13.0											
14.0											
15.0											
16.0											
17.0											
18.0											
19.0											
20.0											

EASTING: 18T 0465761

NORTHING: 5020893

SITE DATUM: Elevations measured from temporary benchmark established at the top surface of the Entrepreneur Crescent Centerline opposite the the Site entrance (100.00 m).

GROUND SURFACE ELEVATION: 99.88 m

TOP OF RISER ELEVATION: N/A

HOLE DIAMETER: 91 mm

MONITORING WELL DIAMETER: N/A

NOTES:

bgs: Below Ground Surface
VOC: Volatile Organic Compounds
PHC: Petroleum Hydrocarbons
PAH: Polycyclic Aromatic Hydrocarbons
PCB: Polychlorinated Biphenyls
N/A: Not applicable