


GENERAL CONSTRUCTION NOTES

- ALL MATERIAL (SANITARY, STORM & WATERMAIN) AND CONSTRUCTION METHODS TO BE IN ACCORDANCE WITH THE CURRENT CITY OF OTTAWA STANDARD DRAWINGS AND SPECIFICATIONS, AND ONTARIO PROVINCIAL STANDARD DRAWINGS AND SPECIFICATIONS.
- SERVICING DESIGN DRAWINGS TO BE READ IN CONJUNCTION WITH THE SITE SERVICING REPORT (JULY 28, 2024) PREPARED BY J.L. RICHARDS & ASSOCIATES LIMITED (26899-003).
- REFER TO GEOTECHNICAL REPORT No. OTT-21004743-80 DATED SEPTEMBER 13, 2024, PREPARED BY EXP. FOR SUBSURFACE CONDITIONS, CONSTRUCTION RECOMMENDATIONS AND GEOTECHNICAL INSPECTION REQUIREMENTS. THE GEOTECHNICAL CONSULTANT IS TO REVIEW ON-SITE CONDITIONS AFTER EXCAVATION PRIOR TO PLACEMENT OF THE GRANULAR MATERIAL.
- UNLESS OTHERWISE NOTED ALL DIMENSIONS ARE TO THE CENTRELINE OF SEWER OR MAINTENANCE HOLE.
- THE NOMINAL DIAMETER OF PIPES ARE REFERRED TO IN PLAN VIEW.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING LOCATES FROM ALL UTILITY COMPANIES TO LOCATE EXISTING UTILITIES PRIOR TO EXCAVATION.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL EXCAVATION, BACKFILL AND REINSTATEMENT OF ALL AREAS DISTURBED DURING CONSTRUCTION AND ALL ASSOCIATED WORKS TO THE SATISFACTION OF THE ENGINEER AND CITY OF OTTAWA.
- ALL CONNECTIONS TO EXISTING WATERMAIN (INCLUDING CONNECTIONS TO EXISTING WATERMAIN) TO BE COMPLETED BY CITY OF OTTAWA FORCES. CONTRACTOR TO PROVIDE EXCAVATION BACKFILLING, COMPACTION AND REINSTATEMENTS, IN ACCORDANCE WITH CURRENT CITY SPECIFICATIONS.
- THE CONTRACTOR SHALL BE RESPONSIBLE TO DETERMINE, VIA EXCAVATION THE EXACT LOCATION AND ELEVATION OF THE EXISTING WATERMANS, SEWERS AND UNDERGROUND STRUCTURES AS REQUIRED FOR ALL CONNECTIONS, RELOCATIONS, AND BLANKINGS.
- ALL DIMENSIONS AND INVERTS MUST BE VERIFIED PRIOR TO CONSTRUCTION. IF THERE IS ANY DISCREPANCY THE CONTRACTOR IS TO NOTIFY THE ENGINEER PROMPTLY.
- REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL, ORGANIC MATERIAL AND DEBRIS UNLESS OTHERWISE INSTRUCTED BY ENGINEER. EXCAVATE AND REMOVE FROM SITE ANY CONTAMINATED MATERIAL. ALL CONTAMINATED MATERIAL SHALL BE DISPOSED OF AT A LICENSED LANDFILL FACILITY.
- ALL WATERMANS SHALL CONFORM TO THE LATEST REVISIONS OF THE CITY OF OTTAWA AND THE ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD) AND SPECIFICATIONS (OPSS).
- WATERMANS CROSSING BELOW OR OVER A SEWER SHALL BE IN ACCORDANCE WITH CITY STANDARD DRAWING W25 AND W25.2.
- PROVIDE A MINIMUM OF 2.4m COVER ON ALL WATERMANS AND WATER SERVICES. OTHERWISE PROVIDE THERMAL INSULATION AS PER THE CITY STANDARD DRAWING W22 (IN SHALLOW TRENCHES) AND W23 (AT OPEN STRUCTURES).
- WATERMAIN THRUST BLOCKS TO BE CONSTRUCTED PER CITY STANDARD DRAWINGS W25.3 AND W25.4. THRUST BLOCKS ARE REQUIRED AT ALL BENDS, TEES, PLUGS, DEAD END CAPS, VALVES, REDUCERS, OR OTHER FITTINGS WHERE CHANGES OCCUR IN PIPE DIAMETER OR DIRECTION ALL IN ACCORDANCE WITH CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS.
- WATERMAIN SERVICE LATERAL TO BUILDING TO BE PVC DR-18.
- ALL WATER DISTRIBUTION INFRASTRUCTURE TO BE PROVIDED WITH CATHODIC CORROSION PROTECTION AS PER CITY STANDARD W40.
- RESTORE ALL DISTURBED AREAS ON-SITE AND OFF-SITE, INCLUDING TRENCHES AND SURFACES ON PUBLIC ROAD ALLOWANCES TO EXISTING CONDITIONS OR BETTER TO THE SATISFACTION OF THE CITY OF OTTAWA AND ENGINEER. ASPHALT RESTORATION SHALL BE IN ACCORDANCE WITH THE CITY OF OTTAWA STANDARD DRAWING No. R10.
- SANITARY AND STORM SERVICE LATERALS TO BUILDING TO BE PVC DR-28.
- SANITARY AND STORM SERVICES TO BE IN ACCORDANCE WITH CITY STANDARD DRAWING S11.1 AND PROVIDED WITH 0.3m MINIMUM VERTICAL CLEARANCE TO WATERMAIN. REFER TO WATERMAIN TABLE FOR CROSSING DETAILS.
- ALL FLOWS FROM THE UNDERGROUND PARKING GARAGE ARE TO BE CONVEYED TO THE SANITARY SERVICE. SANITARY FLOWS ARE TO BE PUMPED TO THE PROPOSED SANITARY SERVICE (TYP.)
- THE OWNER SHALL REQUIRE THAT THE SITE SERVICING CONTRACTOR PERFORM FIELD TESTS FOR QUALITY CONTROL OF ALL SANITARY SEWERS. LEAKAGE TESTING SHALL BE COMPLETED IN ACCORDANCE WITH OPSS 410.07.1, 410.07.16.04 AND 407.07.24. DYE TESTING IS TO BE COMPLETED ON ALL SANITARY SERVICES TO CONFIRM PROPER CONNECTION TO THE SANITARY SEWER MAIN. THE FIELD TESTS SHALL BE PERFORMED IN THE PRESENCE OF A CERTIFIED PROFESSIONAL ENGINEER WHO SHALL SUBMIT A CERTIFIED COPY OF THE TEST RESULTS.
- SERVICES TO BE TERMINATED 1.0m FROM BUILDING WALL (TYPICAL). FOR STRUCTURAL WORK PROPOSED SERVICES TO BE SLEEVED THROUGH FOUNDATION WALL.
- BUILDER TO INSTALL BACKWATER VALVES ON SANITARY AND STORM SERVICE LATERALS IN ACCORDANCE WITH CITY OF OTTAWA STANDARD DETAIL DRAWINGS S14, S14.1, S14.2.
- ALL STORM & SANITARY MAINTENANCE HOLES C/W FRAME AND COVER AS PER CITY STANDARD DRAWINGS 24 AND 24.1. SANITARY AND STORM MAINTENANCE HOLES TO HAVE WATERIGHT COVERS PER OPSS 401.030.
- IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THAT THE SITE BENCHMARK(S) HAS NOT BEEN ALTERED OR DISTURBED AND THAT ITS RELATIVE ELEVATION AND DESCRIPTION AGREES WITH THE INFORMATION DEPICTED ON THIS PLAN. PLEASE REFER TO THE 'VERTICAL CONTROL POINTS' SKETCH PROVIDED BY STANTEC SEPTEMBER 27, 2024 FOR LOCATION AND DESCRIPTION OF CONTROL POINTS.
- CATCH BASINS FOR LANDSCAPED APPLICATION (CB110, CB111, CB113) TO BE IN ACCORDANCE WITH CITY STANDARD DETAIL S31 OR APPROVED EQUIVALENT. CB112 TO BE 600x600mm PRECAST CONCRETE PER OPSS 705.010 C/W FRAME AND COVER AS PER CITY OF OTTAWA STANDARD DRAWING S19.
- FILL USED FOR GRADING BENEATH THE BASE AND SUB-BASE LAYERS OF PAVED AREAS SHOULD CONSIST UNLESS OTHERWISE SPECIFIED OR CLEAN IMPORTED GRANULAR FILL, SUCH AS OPSS GRANULAR 'A', GRANULAR 'B' TYPE II OR SELECT SUB-GRADE MATERIAL. THIS MATERIAL SHOULD BE TESTED AND APPROVED PRIOR TO DELIVERY TO THE SITE. THE FILL SHOULD BE PLACED IN LIFTS NO GREATER THAN 300mm THICK AND COMPACTED USING SUITABLE COMPACTION EQUIPMENT FOR THE LIFT THICKNESS. FILL PLACED BENEATH THE PAVED AREAS SHOULD BE COMPACTED TO AT LEAST 100% OF ITS SPMD.
- CONCRETE CURB TO BE BARRIER TYPE AS PER STANDARD DRAWING SCI.1.
- CONCRETE SIDEWALKS AND WALKWAYS TO BE CONSTRUCTED AS PER CITY OF OTTAWA DETAIL SC2 (OR SC1-4) AND SC4.
- EXCAVATION FOR THE INSTALLATION OF SERVICES ALONG OR IN PROXIMITY OF A BUILDING OR A STRUCTURE IS TO BE CONTAINED WITHIN A TRENCH BOX WIDTH AND IS TO ENSURE NO CONFLICT WITH ANY FUTURE FOOTINGS. SERVICE TRENCHES SHALL BE BACKFILLED WITH GRANULAR 'A' COMPACTED TO 100% SPMD WHERE ADJACENT TO A BUILDING FOR THE SECTION PARALLEL TO THE UNIT PLUS 5.0 M PAST THE FRONT AND REAR OF THE UNIT. SELECT SUBGRADE MATERIAL, COMPACTED TO 100% SPD TO 1.0m BELOW EXISTING GRADE FOR FULL TRENCH WIDTH OF DISTURBED AREA SHALL BE USED FOR BACKFILL, INCLUDING ALONG ANY SEWERS AND WATERMANS ADJACENT TO A BUILDING OR OTHER STRUCTURE.
- MATCH EXISTING ELEVATIONS AT PROPERTY LIMITS. ENSURE POSITIVE DRAINAGE TOWARDS A SUITABLE OUTLET WHETHER INDICATED OR NOT.
- THE CONTRACTOR SHALL PROVIDE ALL PAVEMENT MARKINGS AS SHOWN, INCLUDING HANDICAPPED PARKING SYMBOLS.
- ALL GROUNDWATER PUMPED FROM THE SITE TO BE METERED AND A PERMIT TO TAKE WATER OBTAINED AS APPLICABLE.
- CONTRACTOR TO INSTALL TEMPORARY INLET CONTROL DEVICE C/W 23mm DIA. ORIFICE AT THE OUTLET OF MH18. THE ICD SHALL BE INSTALLED AND OPERABLE AT THE ONSET OF THE SANITARY SEWER CONSTRUCTION AND SHALL REMAIN IN PLACE UNTIL WRITTEN NOTIFICATION BY ENGINEER TO BE REMOVED.
- CONTROLLED ROOF DRAINS AND LANDSCAPED CB 112 ARE TO BE CONVEYED TO THE FREE FLOWING STORM SERVICE/SEWERS.
- THE PROPOSED AREA DRAINS (CB114, CB115, CB116, CB117 AND CB118) ARE TO BE INSTALLED WITH THE FOLLOWINGS:
 - ZURN Z150F FLOW FORE HIGH PERFORMANCE PROMENADE DECK DRAIN WITH ROTABLE FRAME AND HEEL-PROOF GRATE. PIPE DIAMETER SHALL BE 150mm DIA. PVC.
- INSTALLATION OF THE ZURN PRODUCT SHALL INCLUDE AT MINIMUM A 10mm CONCRETE COLLAR AROUND THE ZURN SYSTEM AND PIPE FROM THE TOP OF SLAB TO 50mm BELOW T/G ELEVATION.
- REFER TO STRUCTURAL FOR DETAILS OF THE PAVEMENT STRUCTURE FOR THE RAMP INTO THE PARKING GARAGE.
- PAVEMENT STRUCTURE TRANSITIONS: FROM GEOTECHNICAL INVESTIGATION PROPOSED RESIDENTIAL DEVELOPMENT 2983, 3053, AND 3079 NAVAN ROAD OTTAWA, ONTARIO PREPARED BY EXP DATED SEPTEMBER 13, 2024.
 - A 10 HORIZONTAL: 1 VERTICAL LONGITUDINAL TRANSITION ZONE SHOULD BE USED AT THE BOTTOM OF THE PAVEMENT STRUCTURES FOR ABUTTING PAVEMENT STRUCTURES WITH DIFFERENT PAVEMENT STRUCTURE THICKNESS.
 - THE JOINT BETWEEN A RIGID PAVEMENT STRUCTURE (CONCRETE PAVEMENT STRUCTURE) AND FLEXIBLE PAVEMENT STRUCTURE (ASPHALT PAVEMENT STRUCTURE) SHOULD BE SEALED WITH A POLYMER MODIFIED BITUMEN STRIP TO PREVENT INGRESS OF WATER, DIRT, VEGETATION AND OTHER PARTICLES THAT WOULD COMPROMISE THE PERFORMANCE OF THE PAVEMENTS AND TO WITHSTAND DIFFERENT RATES OF EXPANSION BETWEEN THE 2 DIFFERENT TYPES OF PAVEMENT STRUCTURES.

- PROPOSED PARKING AREA DRAINS (CB115, CB116 AND CB117), C/W ABOVE THE PODIUM (CB114 AND CB118) AND RAMP TRENCH DRAIN ARE TO BE CONVEYED TO THE PROPOSED CISTERN VIA THE INTERNAL PLUMBING, REFER TO THE MECHANICAL DRAWINGS FOR DETAILS.
- PAVEMENT STRUCTURE: FROM GEOTECHNICAL INVESTIGATION PROPOSED RESIDENTIAL DEVELOPMENT 2983, 3053, AND 3079 NAVAN ROAD OTTAWA, ONTARIO, PREPARED BY EXP DATED SEPTEMBER 13, 2024.
 - ACCESS LANE, FIRE TRUCK LANE, RAMP AND HEAVY TRUCK PARKING AREAS (ABOVE PODIUM DECK)
 - 40mm WEAR COURSE - SP 12.5
 - 60mm BINDER COURSE - SP 19.0
 - 150mm - OPSS 1010 GRANULAR 'A' BASE CRUSHED STONE COMPACTED TO 100% SPMD
 - 150mm RIGID INSULATION, WATERPROOFING MEMBRANE AND PROTECTION BOARD
 - ACCESS LANE, FIRE TRUCK LANE, RAMP AND HEAVY TRUCK PARKING AREAS (OUTSIDE PODIUM DECK)
 - 50mm WEAR COURSE - SP 12.5
 - 60mm BINDER COURSE - SP 19.0
 - 150mm - OPSS 1010 GRANULAR 'A' BASE CRUSHED STONE COMPACTED TO 100% SPMD
 - 600mm - OPSS 1010 GRANULAR 'B' SUB-BASE TYPE II COMPACTED TO 100% SPMD

- REFER TO STRUCTURAL FOR DETAILS OF THE PAVEMENT STRUCTURE FOR THE RAMP INTO THE PARKING GARAGE.
- PAVEMENT STRUCTURE TRANSITIONS: FROM GEOTECHNICAL INVESTIGATION PROPOSED RESIDENTIAL DEVELOPMENT 2983, 3053, AND 3079 NAVAN ROAD OTTAWA, ONTARIO PREPARED BY EXP DATED SEPTEMBER 13, 2024.
 - A 10 HORIZONTAL: 1 VERTICAL LONGITUDINAL TRANSITION ZONE SHOULD BE USED AT THE BOTTOM OF THE PAVEMENT STRUCTURES FOR ABUTTING PAVEMENT STRUCTURES WITH DIFFERENT PAVEMENT STRUCTURE THICKNESS.
 - THE JOINT BETWEEN A RIGID PAVEMENT STRUCTURE (CONCRETE PAVEMENT STRUCTURE) AND FLEXIBLE PAVEMENT STRUCTURE (ASPHALT PAVEMENT STRUCTURE) SHOULD BE SEALED WITH A POLYMER MODIFIED BITUMEN STRIP TO PREVENT INGRESS OF WATER, DIRT, VEGETATION AND OTHER PARTICLES THAT WOULD COMPROMISE THE PERFORMANCE OF THE PAVEMENTS AND TO WITHSTAND DIFFERENT RATES OF EXPANSION BETWEEN THE 2 DIFFERENT TYPES OF PAVEMENT STRUCTURES.

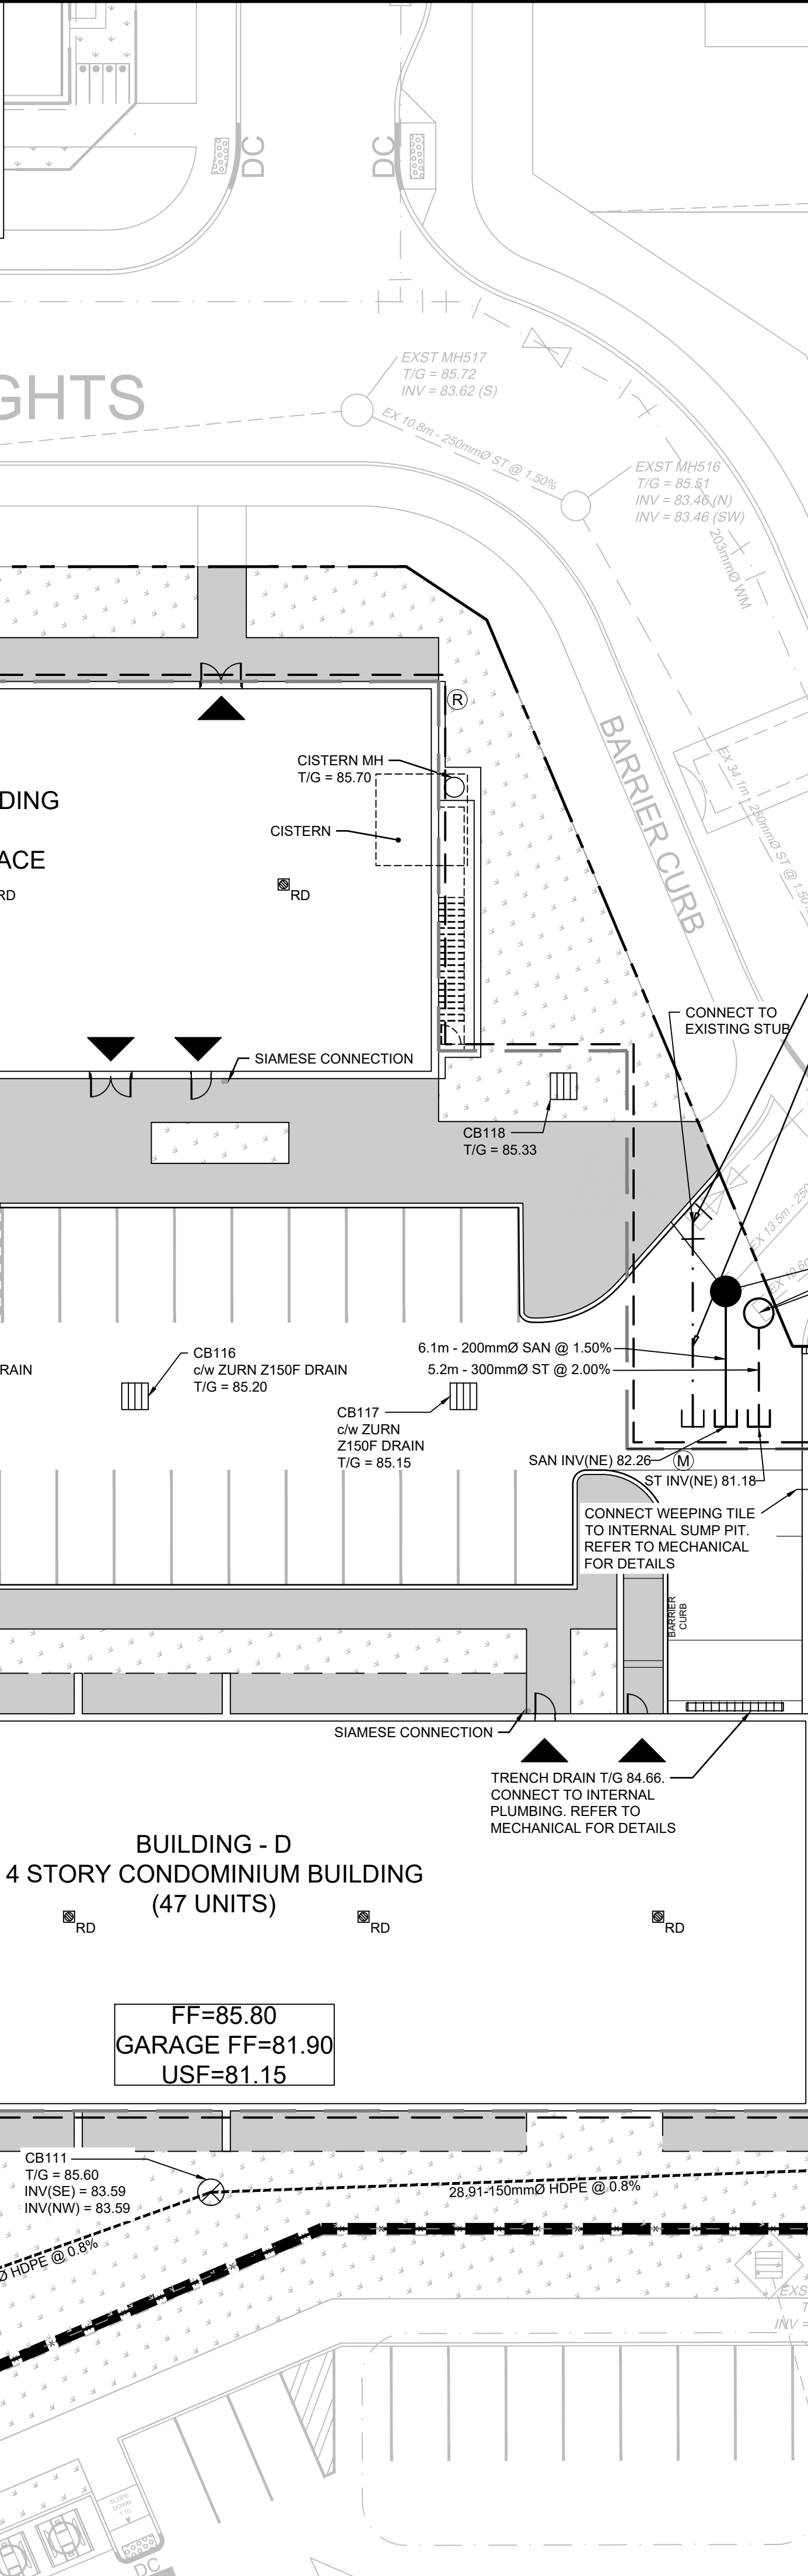



WATERMAIN TABLE- EX. STUB TO BUILDING 'D'
PVC DR-18 CL 150

DETAIL	FINISHED GRADE	TOP OF WM
1 45° BEND	85.32	82.92
2 CAP	85.24	82.84

NOTE: ALL WM CONSTRUCTED AT LESS THAN 2m BELOW FINISHED GRADE SHALL BE INSULATED IN ACCORDANCE WITH THE CITY OF OTTAWA'S REQUIREMENTS AS SET OUT IN THE CITY OF OTTAWA SPECIFICATION (F-4415).



REAR YARD CATCH BASIN TABLE

Street Name	CB ID Number	T/G	Inlet Pipe Dia. (mm)	Pipe Length (m)	Slope	Invert	Outlet Pipe Dia. (mm)	Invert	COVER (mm)	1100 Yr Restricted Capacity (L/s)	CATCH BASIN TYPE	ICD TYPE
BLOCK 15	CB110	85.15	-	-	-	-	150	31.32	83.95	1.45	-	NO ICD
	CB110	85.30	-	-	-	-	150	20.47	83.75	1.40	-	NO ICD
	CB111	85.60	150	20.47	0.8%	83.59	150	28.91	83.59	1.86	-	NO ICD
	CB112	85.20	150	31.32	0.8%	83.36	150	4.21	83.28	1.69	10.00	600 mm x 600 mm CATCH BASIN PER OPSS 705.010
	CB112	85.20	150	28.91	0.8%	83.34	-	-	-	-	-	Water_ICD_C9
	CB112	85.20	150	-	-	-	-	-	-	-	-	-

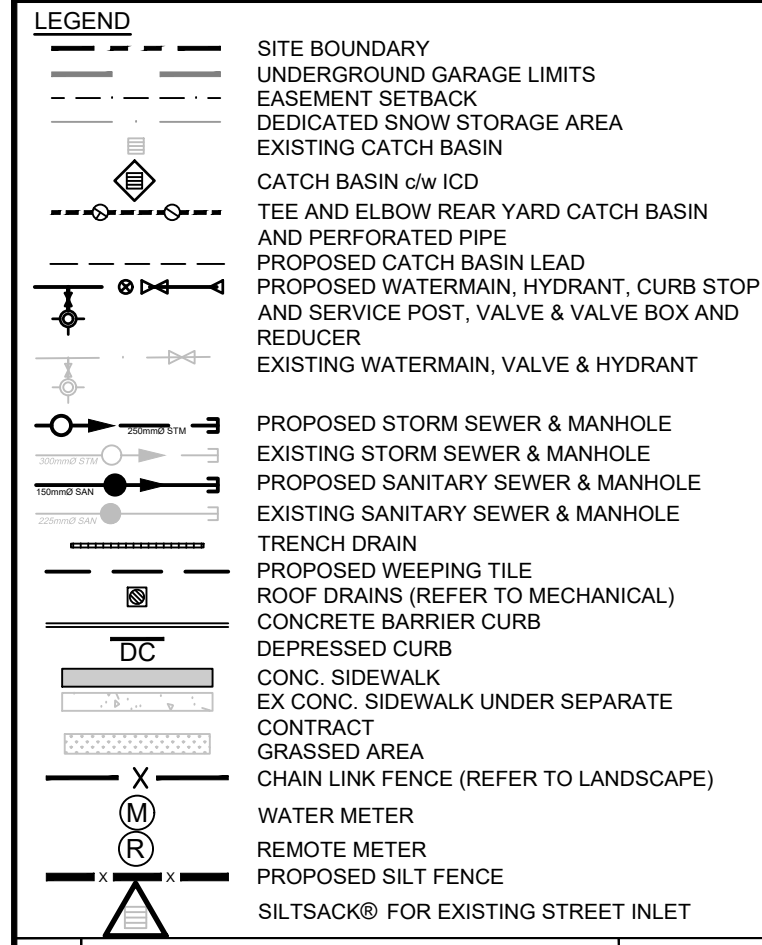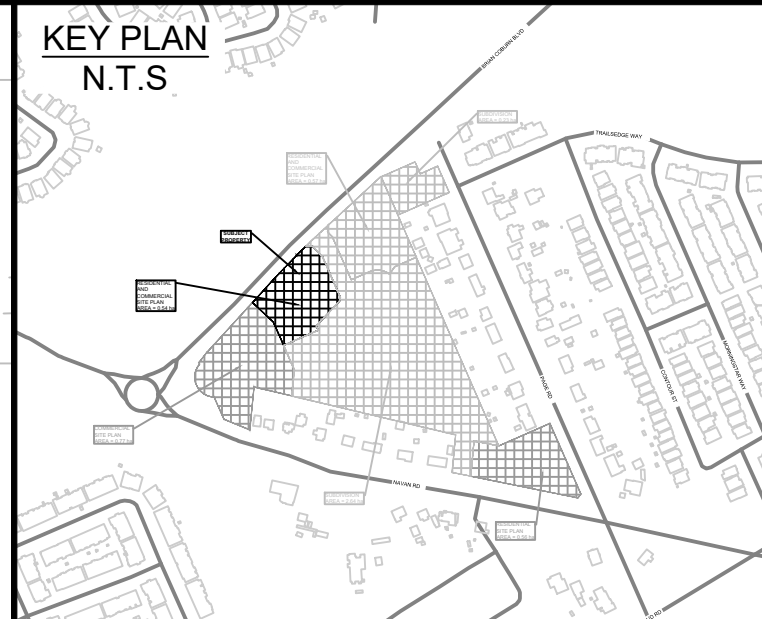

No.	ISSUE / REVISION	DDMMYY
3	ISSUED FOR THIRD ENGINEERING SUBMISSION	10/10/24
2	ISSUED FOR SECOND ENGINEERING SUBMISSION	26/07/24
1	ISSUED FOR FIRST ENGINEERING SUBMISSION	22/03/24



THESE DRAWINGS HAVE BEEN PRODUCED BY J.L. RICHARDS & ASSOCIATES LIMITED AND ARE SUBJECT TO COPYRIGHT AND USE RESTRICTIONS SET OUT IN THE APPLICABLE PROJECT CONTRACT. ANY USE, REUSE, OR MODIFICATION OF THESE DRAWINGS FOR PURPOSES OTHER THAN THE ORIGINAL PROJECT OR EXECUTION OF THE DESCRIBED WORK IS NOT PERMITTED OR ENDORSED WITHOUT THE PRIOR WRITTEN AUTHORIZATION OF J.L.R. J.L.R. MAKES NO WARRANTY, EITHER EXPRESS OR IMPLIED, OF THE SUITABILITY OR FITNESS OF THESE DRAWINGS FOR ANY OTHER PURPOSE, AND ANY PARTY WHICH CHOOSES TO USE, MODIFY, OR OTHERWISE RELY ON THESE DRAWINGS WITHOUT J.L.R.'S AUTHORIZATION ACCEPTS THESE LIMITATIONS AND DOES SO AT THEIR SOLE RISK AND WITHOUT LIABILITY TO J.L.R.

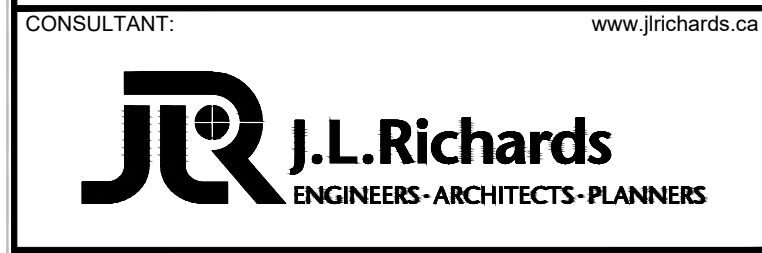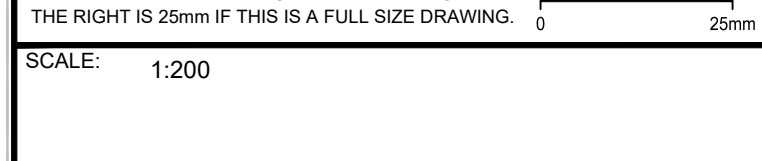

CONSULTANT:
PROFESSIONAL STAMP
LICENSED PROFESSIONAL ENGINEER
K. R. FERREY MORENO
100122432
2024-10-10
PROVINCE OF ONTARIO

PROJECT:
NAVAN RESIDENTIAL AND COMMERCIAL BLOCK 15
2983 NAVAN ROAD OTTAWA, ONTARIO

DRAWING:
SITE SERVICING PLAN
DESIGN: KF/MM
DRAWN: KF
CHECKED: KF
JLR #: 26899-002
DRAWING #: **C01**

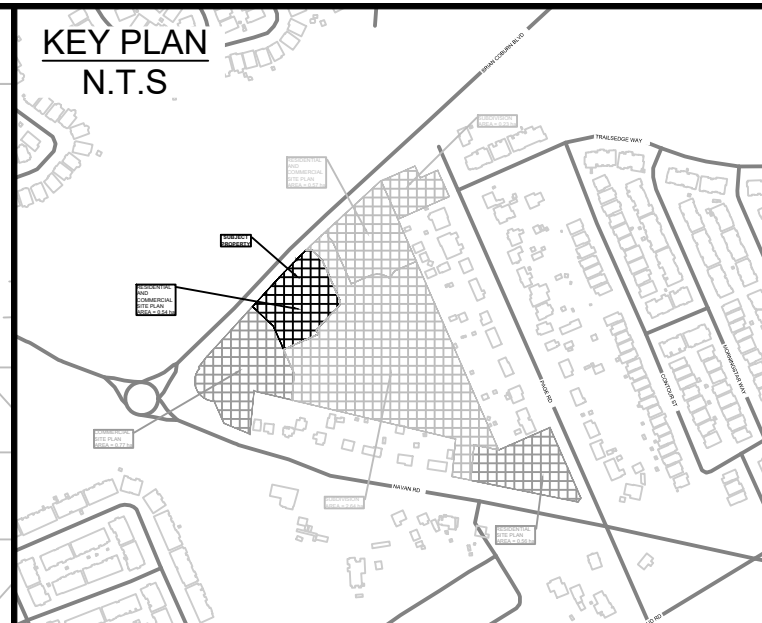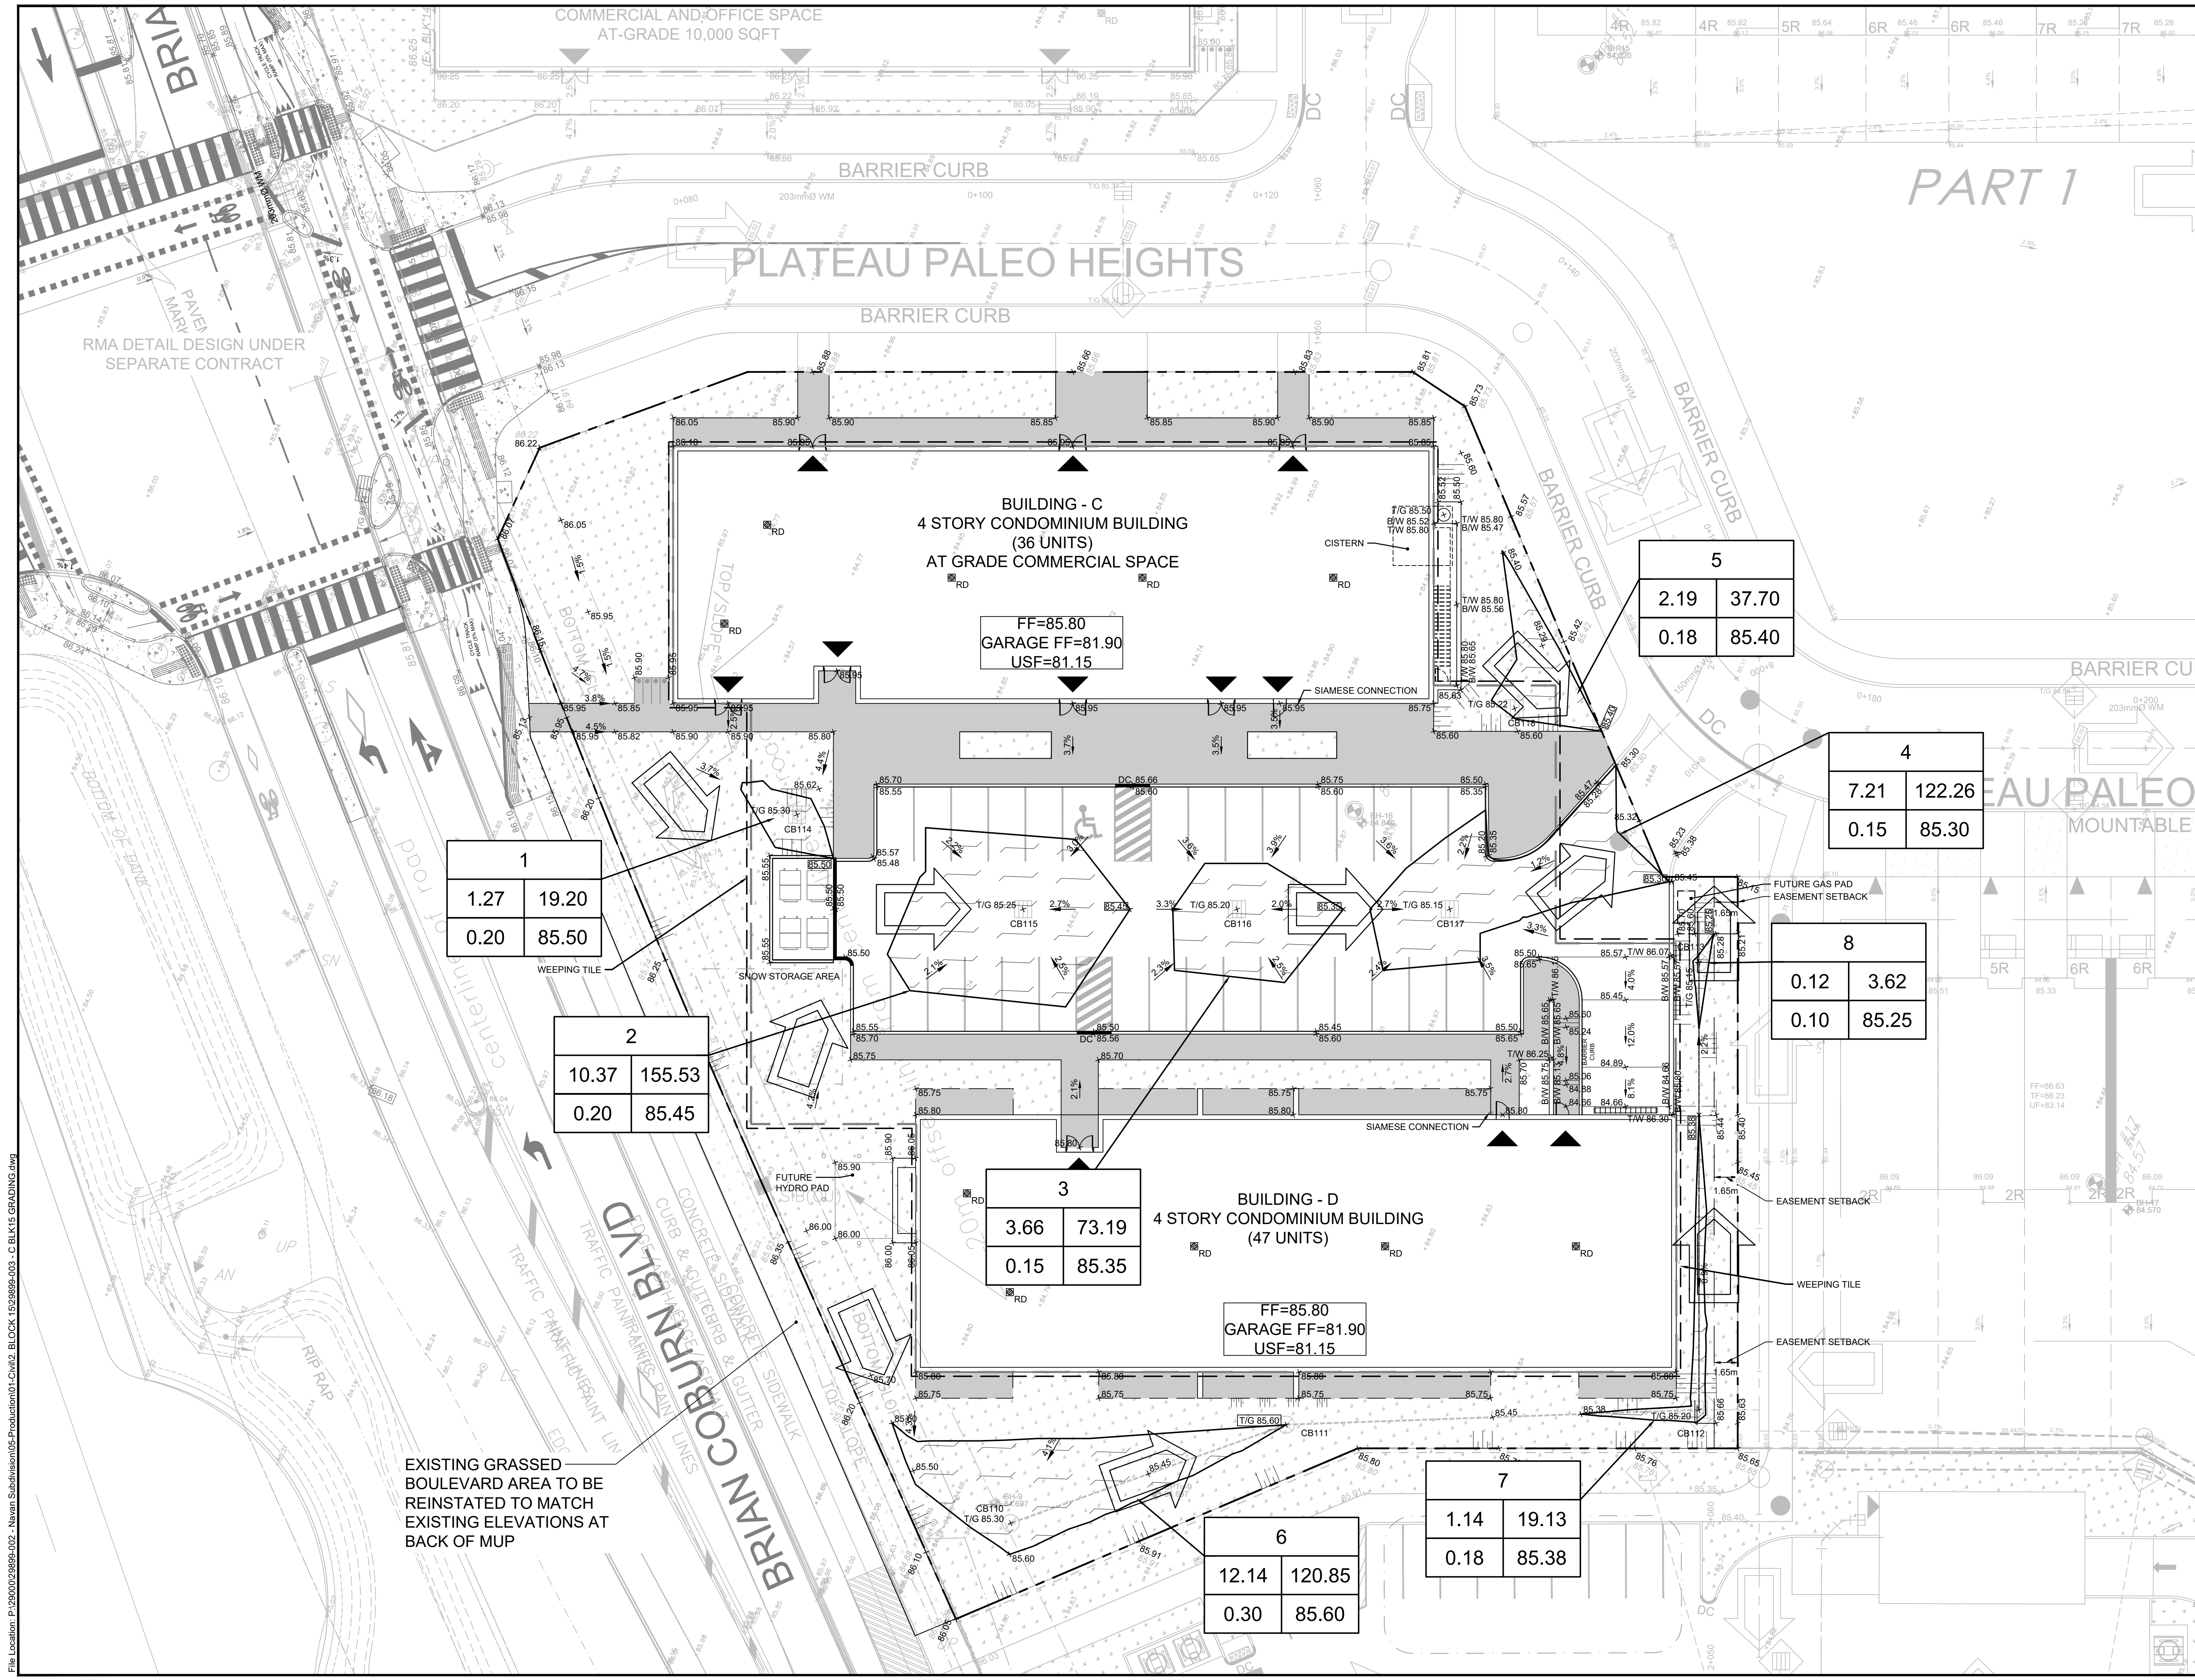

LEGEND

- SITE BOUNDARY
- UNDERGROUND GARAGE LIMITS
- PROPOSED ELEVATION
- PROPOSED SUBDIVISION ELEVATION
- PROPOSED INTERSECTION ELEVATION
- PROPOSED HIGH POINT
- ORIGINAL SURVEY
- PROPOSED SWALE
- PROPOSED TERRACING (MAX 3:1)
- SURFACE SLOPE
- MAJOR EMERGENCY OVERLAND FLOW DIRECTION (+1-100 YR)
- DEPRESSED CURB
- FINISHED FLOOR ELEVATION
- GARAGE FF=82.40
- USF=81.65
- BUILDING ENTRANCE
- BOREHOLE NUMBER
- GROUND SURFACE ELEVATION (m)
- GROUND WATER ELEVATION (m)
- CONC. SIDEWALK
- EX CONC. SIDEWALK UNDER SEPARATE CONTRACT
- MAXIMUM WATER LEVEL (STATIC)
- MAX. PONDING VOLUME (m³)
- AREA ID
- MAX. PONDING AREA (m²)
- MAX. WATER LEVEL (STATIC)
- PONDING DEPTH (STATIC)

No.	ISSUE / REVISION	DDMMYY
3	ISSUED FOR THIRD ENGINEERING SUBMISSION	10/10/24
2	ISSUED FOR SECOND ENGINEERING SUBMISSION	26/07/24
1	ISSUED FOR FIRST ENGINEERING SUBMISSION	22/03/24

THESE DRAWINGS HAVE BEEN PRODUCED BY J.L. RICHARDS & ASSOCIATES LIMITED AND ARE SUBJECT TO COPYRIGHT AND USE RESTRICTIONS SET OUT IN THE APPLICABLE PROJECT CONTRACT. ANY USE, REUSE, OR MODIFICATION OF THESE DRAWINGS FOR PURPOSES OTHER THAN THE ORIGINAL PROJECT OR EXECUTION OF THE DESCRIBED WORK IS NOT PERMITTED OR ENDORSED WITHOUT THE PRIOR WRITTEN AUTHORIZATION OF J.L.R. J.L.R. MAKES NO WARRANTIES, EITHER EXPRESS OR IMPLIED, OF THE SUITABILITY OR FITNESS OF THESE DRAWINGS FOR ANY OTHER PURPOSE, AND ANY PARTY WHICH CHOOSES TO USE, MODIFY, OR OTHERWISE RELY ON THESE DRAWINGS WITHOUT J.L.R.'S AUTHORIZATION ACCEPTS THESE LIMITATIONS AND DOES SO AT THEIR SOLE RISK AND WITHOUT LIABILITY TO J.L.R.

VERIFY SHEET SIZE AND SCALES. THE BAR TO THE RIGHT IS 25mm IF THIS IS A FULL SIZE DRAWING. SCALE: 1:200

CLIENT:

CONSULTANT: J.L. Richards ENGINEERS - ARCHITECTS - PLANNERS

CONSULTANT:

PROFESSIONAL STAMP: PROJECT NORTH

PROJECT: NAVAN RESIDENTIAL AND COMMERCIAL BLOCK 15
2983 NAVAN ROAD OTTAWA, ONTARIO

DRAWING: GRADING AND PONDING PLAN

DESIGN: KF/MM DRAWING #: C02
DRAWN: KC CHECKED: KF JLR #: 29899-002

1	1.27	19.20
	0.20	85.50

2	10.37	155.53
	0.20	85.45

3	3.66	73.19
	0.15	85.35

6	12.14	120.85
	0.30	85.60

7	1.14	19.13
	0.18	85.38

5	2.19	37.70
	0.18	85.40


4	7.21	122.26
	0.15	85.30

8	0.12	3.62
	0.10	85.25


EXISTING GRASSED BOULEVARD AREA TO BE REINSTATED TO MATCH EXISTING ELEVATIONS AT BACK OF MUP

File Location: P:\2000\029899-002 - Navan Subdivision\05-Production\01-Civil\2 - BLOCK 15\29899-003 - C.BLK15 GRADING.dwg



PLOT DATE: October 10, 2024 2:14:28 PM

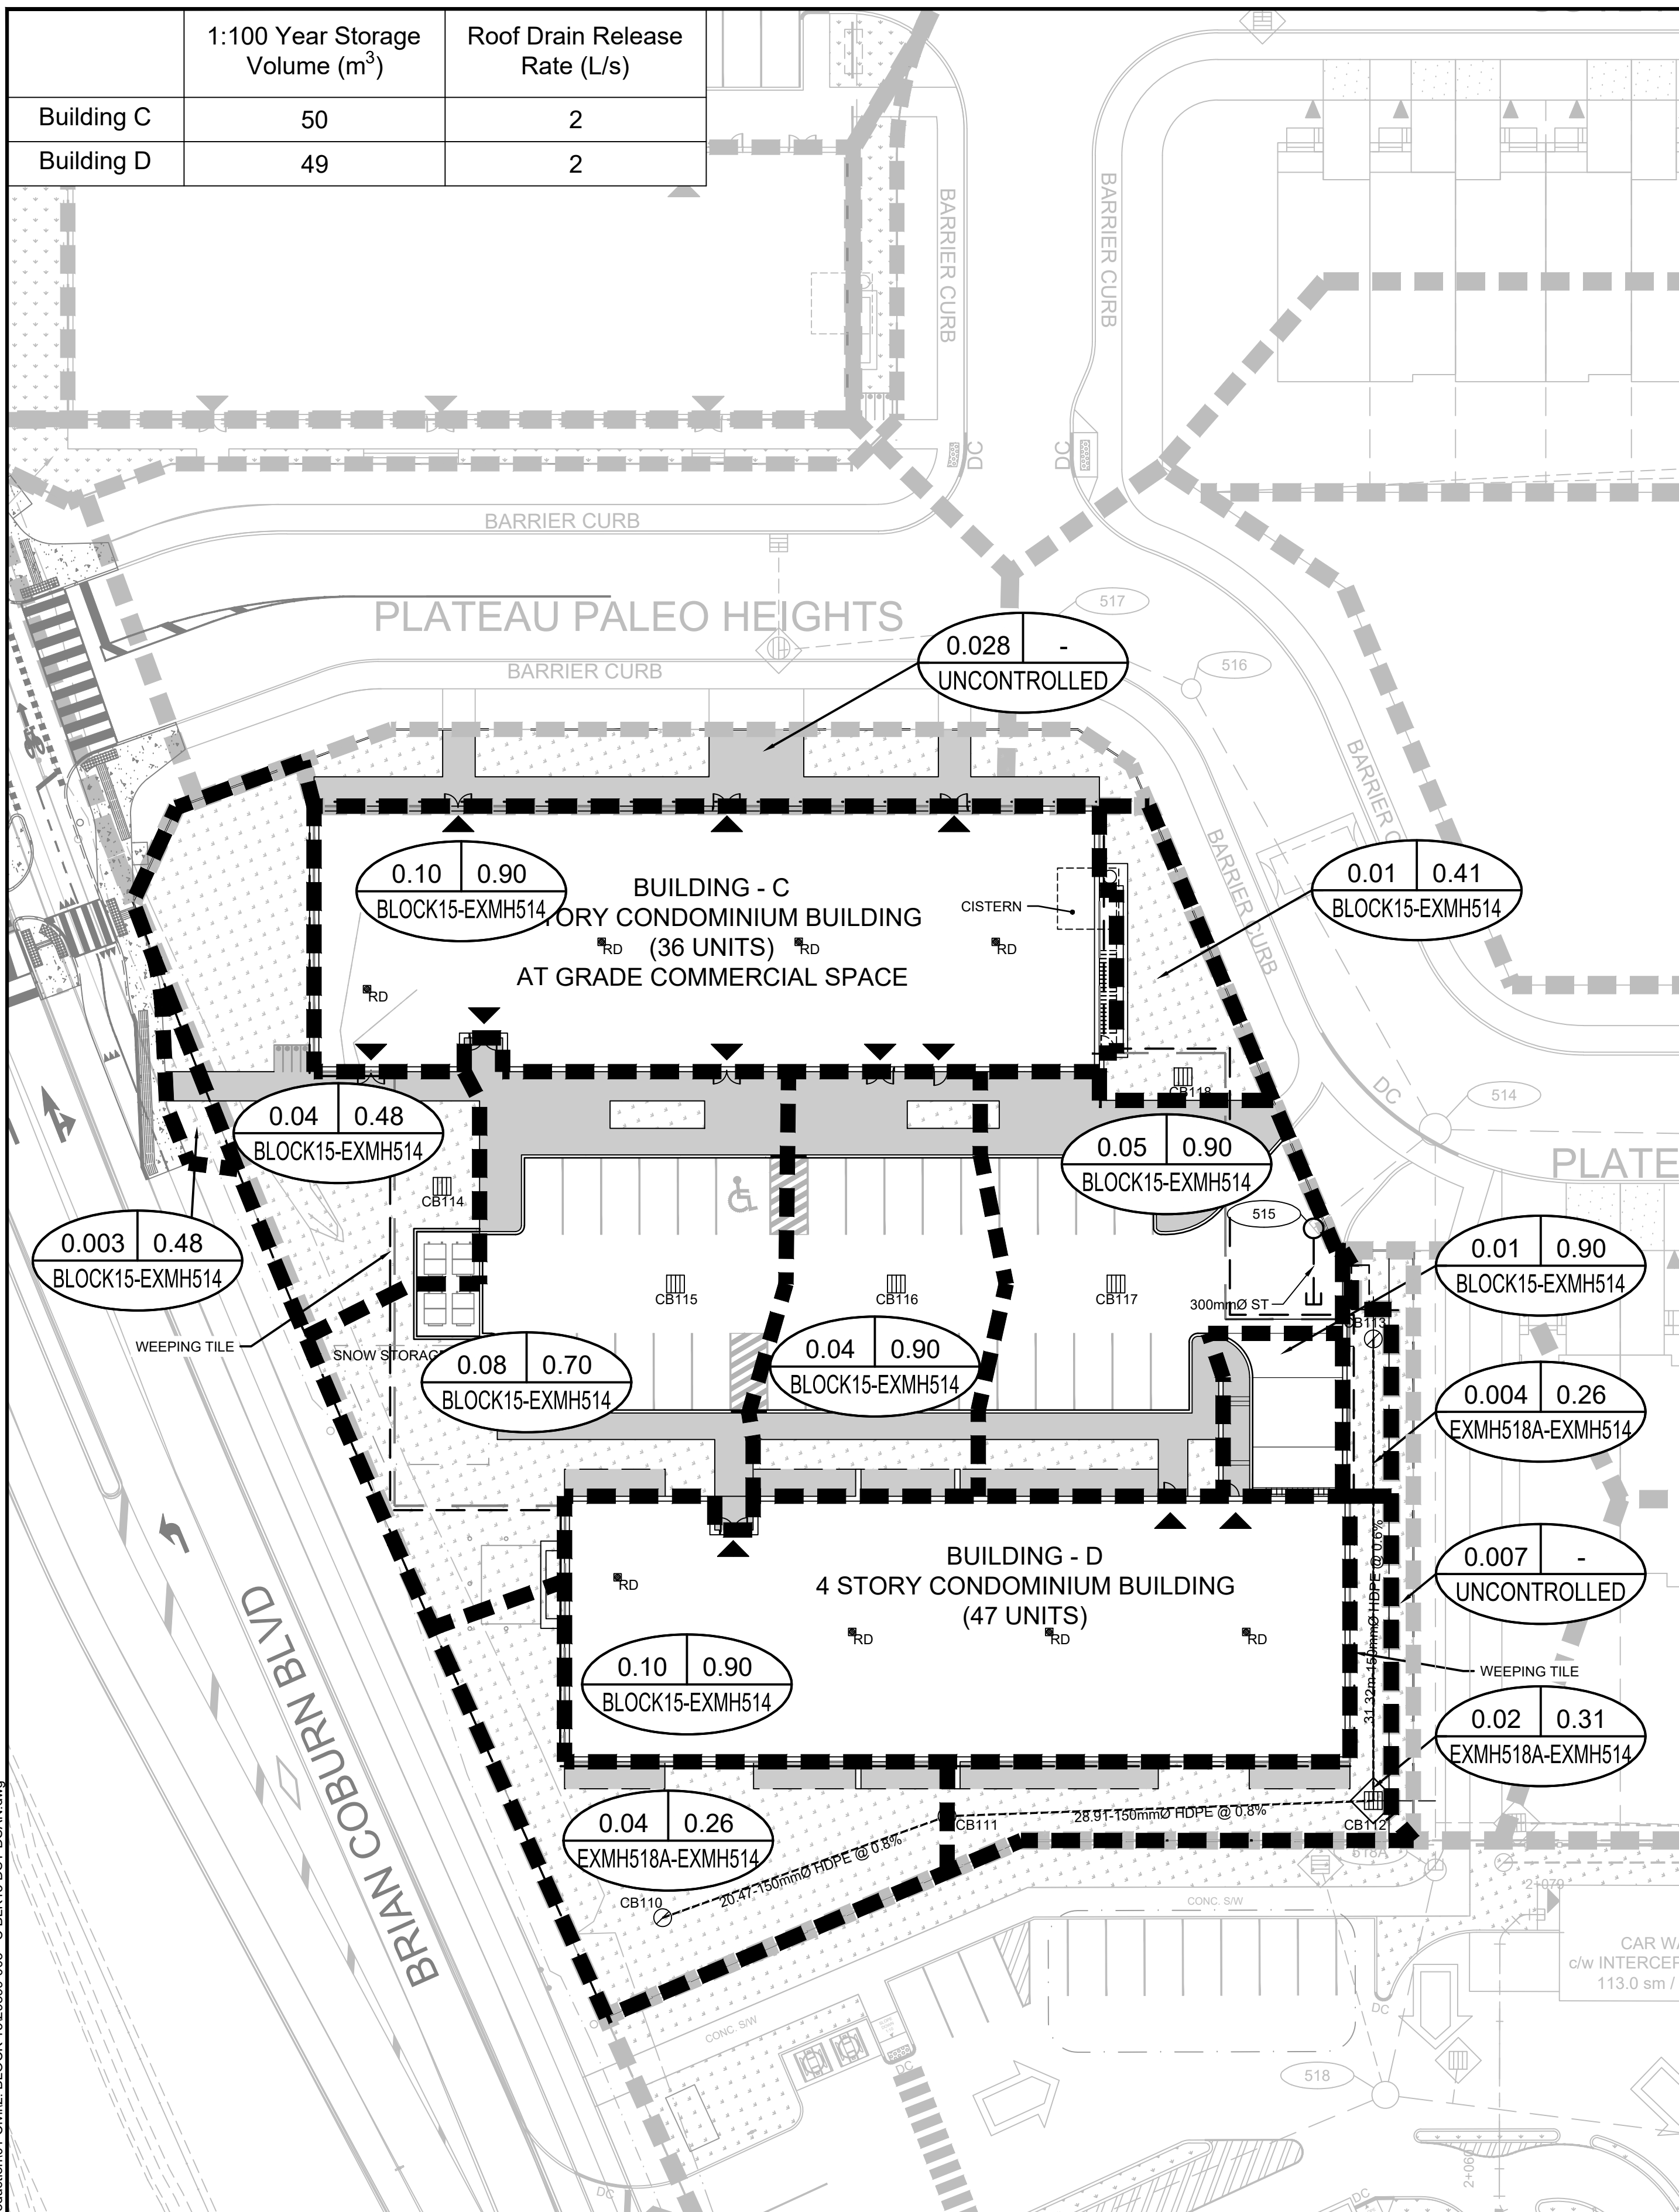

STORM DRAINAGE

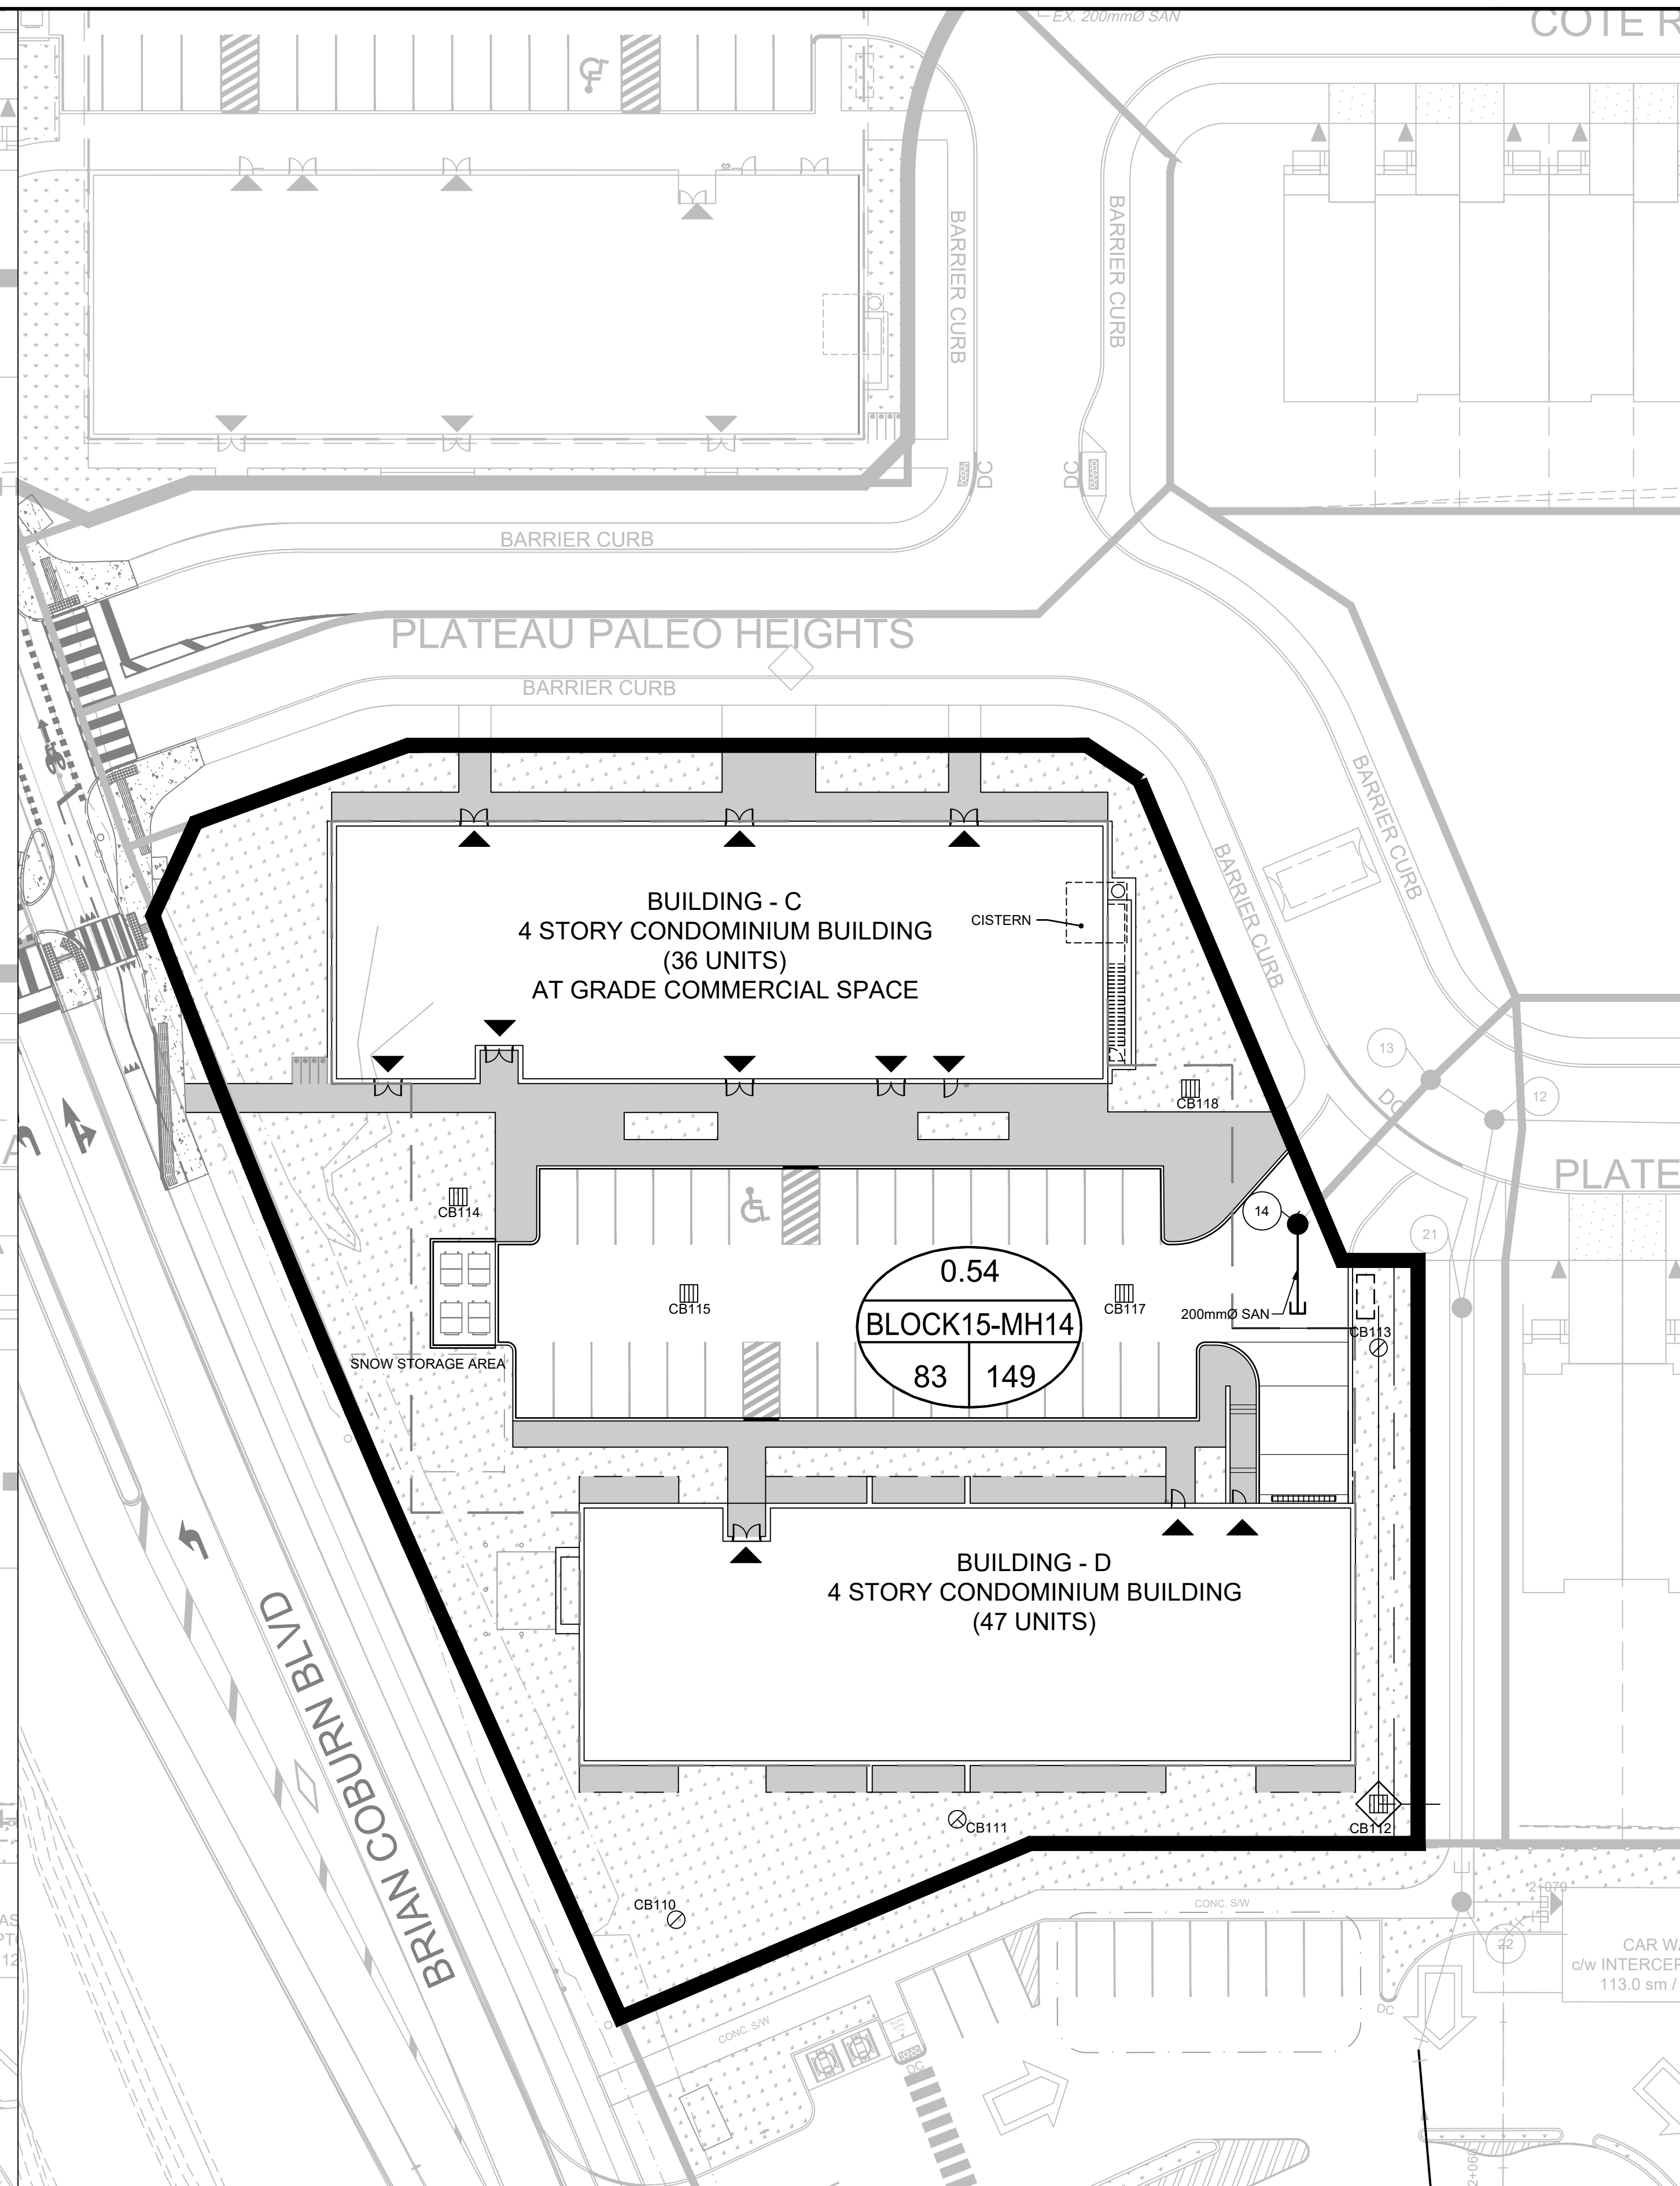

SANITARY DRAINAGE

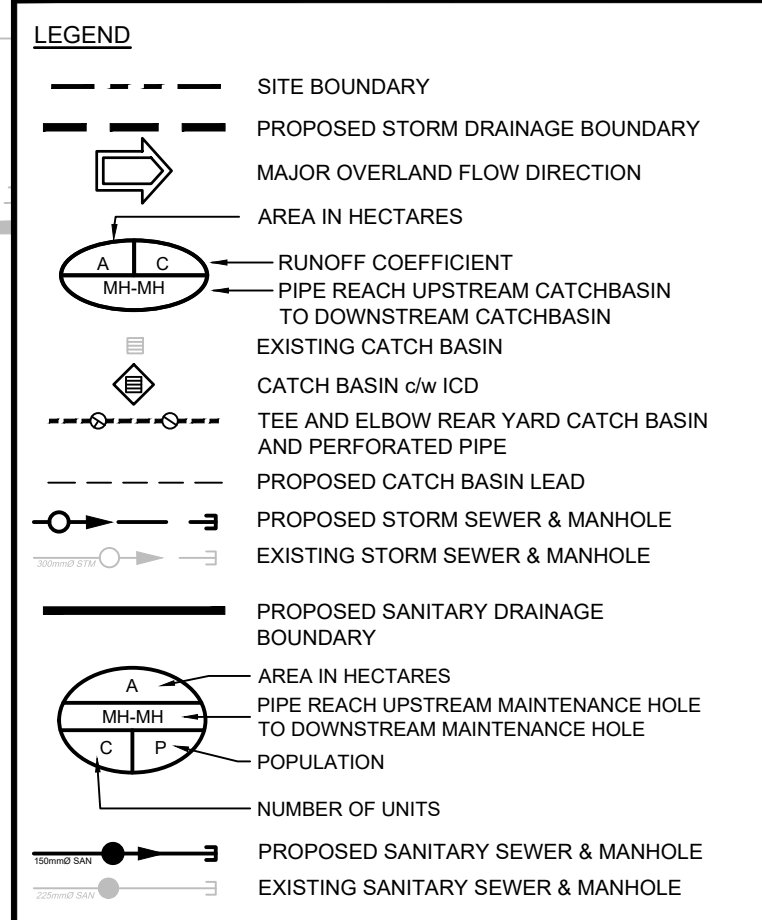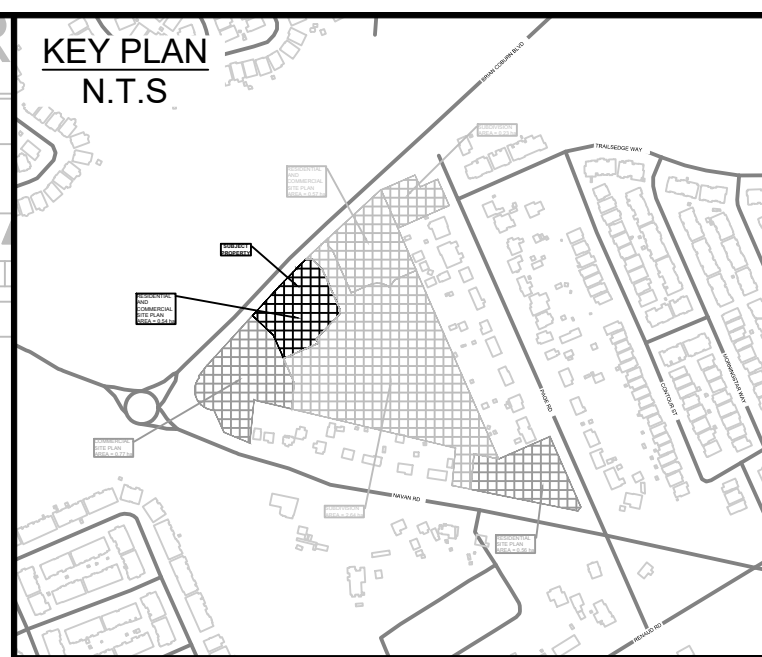




THESE DRAWINGS HAVE BEEN PRODUCED BY J.L. RICHARDS & ASSOCIATES LIMITED AND ARE SUBJECT TO COPYRIGHT AND USE RESTRICTIONS SET OUT IN THE APPLICABLE PROJECT CONTRACT. ANY USE, REUSE, OR MODIFICATION OF THESE DRAWINGS FOR PURPOSES OTHER THAN THE ORIGINAL PROJECT OR EXECUTION OF THE DESCRIBED WORK IS NOT PERMITTED OR ENDORSED WITHOUT THE PRIOR WRITTEN AUTHORIZATION OF J.L.R. J.L.R. MAKES NO WARRANTIES, EITHER EXPRESS OR IMPLIED, OF THE SUITABILITY OR FITNESS OF THESE DRAWINGS FOR ANY OTHER PURPOSE, AND ANY PARTY WHICH CHOOSES TO USE, MODIFY, OR OTHERWISE RELY ON THESE DRAWINGS WITHOUT J.L.R.'S AUTHORIZATION ACCEPTS THESE LIMITATIONS AND DOES SO AT THEIR SOLE RISK AND WITHOUT LIABILITY TO J.L.R.

VERIFY SHEET SIZE AND SCALES. THE BAR TO THE RIGHT IS 25mm IF THIS IS A FULL SIZE DRAWING.

SCALE: 1:300

CLIENT:


CONSULTANT:

 ENGINEERS - ARCHITECTS - PLANNERS

CONSULTANT:

 PROJECT NORTH


PROJECT:
 NAVAN RESIDENTIAL AND COMMERCIAL BLOCK 15
 2983 NAVAN ROAD OTTAWA, ONTARIO

DRAWING:
 STORM AND SANITARY DRAINAGE PLANS

DESIGN: KF/MM
 DRAWN: KC
 CHECKED: KF
 JLR #: 29899-002

DRAWING #:
C03

File Location: P:\2020\02\8899-002 - Navan Subdivision\05-Production\01-Civil\2 - BLOCK 15\29899-003 - C-BLK15_DST.DSN.dwg

PLOT DATE: October 10, 2024 2:15:34 PM