



Calculation Summary										
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min			
HANDICAP PARKING	Illuminance	Fc	6.75	8.2	5.1	1.32	1.60			
DRIVE-THRU	Illuminance	Fc	1.06	3.1	0.3	3.53	10.33			
PARKING LOTS	Illuminance	Fc	3.69	8.2	1.2	3.08	6.83			

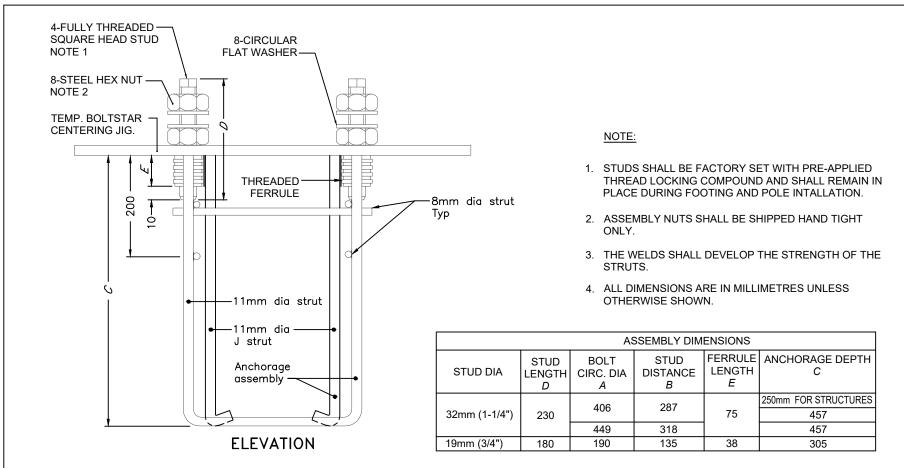

- 1. ALL DIMENSIONS ARE IN MILLIMETRES OR METRES.
- 2. CLASS OF CONCRETE SHALL BE 32mPa. AIR ENTRAINMENT. 3. MINIMUM OF TWO SLEEVES REQUIRED FOR EACH CONC. FOUNDATION UNLESS OTHERWISE SHOWN.
- 4. CONTRACTOR TO VERIFY OPENING SIZE IN POLE BASE PLATE PRIOR TO SETTING CONDUIT SLEEVES. CONTRACTOR TO PROVIDE STRUCTURAL ENGINEER APPROVAL FOR BASE DESIGN.
- 5. SUBJECT TO SOIL CONDITIONS, REFER TO SOIL REPORT.
- 6. FORM RELEASE AGENT HAS BEEN FACTORY-APPLIED TO INSIDE


POLE LENGTH	BURIAL DEPTH	ROD LENGTH	A NO. OF 10M TIES @450mm C/C	TIES @450mm	BOLT CIRCLE DIA FOR METAL POLES			
m	H m	m		ALUMINUM	STEEL	SECTIONAL STEEL		
5.6	2.15	2.00	100	3	N/A	N/A	449	
7.0	2.15	2.00	100	3	N/A	N/A	449	
7.5	2.15	2.00	100	3	406	406	N/A	
8.7	2.45	2.30	250	3	N/A	N/A	449	
9.0	2.45	2.30	0	4	406	406	N/A	
10.5	2.60	2.45	100	4	406	406	449	
12.0	2.75	2.60	150	4	406	406	N/A	
13.6	2.90	2.75	0	5	406	406	N/A	
15.1	3.05	2.90	100	5	406	406	N/A	

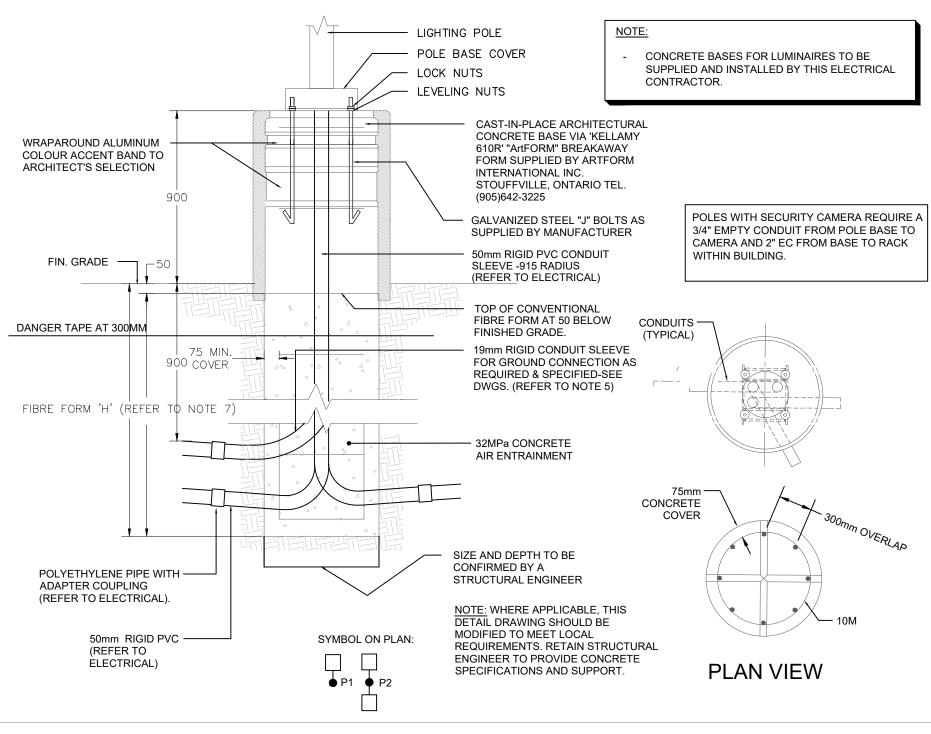



E: dwg@hamjof.com

DO NOT SCALE DRAWINGS. OBTAIN INFORMATION INVOLVING ACCURATE DIMENSIONS TO STRUCTURE FROM DIMENSIONS SHOWN ON ARCHITECTURAL AND STRUCTURAL DRAWINGS, OR BY SITE MEASUREMENTS. SITE PLAN LAYOUT TO BE OBTAINED FROM ARCHITECT OR CIVIL ENGINEER. CONSULT GENERAL CONSTRUCTION DRAWINGS AS WELL AS DETAIL DRAWINGS TO BECOME FAMILIAR WITH ALL CONDITIONS AFFECTING THE WORK, AND VERIFY SPACES IN WHICH THE WORK WILL BE

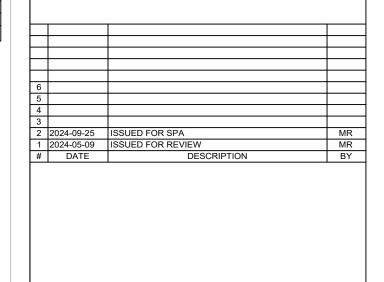

CHICK-FIL-A **ORLEANS - 4270 INNES ROAD,** OTTAWA, ONTARIO

ELECTRICAL SITE PLAN PHOTOMETRIC AND DETAILS

24-002-005 PROJECT DATE MAY 2024 CHECKED BY AS SHOWN



E1.1A