

GENERAL

- DRAWINGS TO BE READ IN CONJUNCTION WITH ARCHITECTURAL AND LANDSCAPE DRAWINGS.
- ALL SERVICES, MATERIALS, CONSTRUCTION METHODS AND INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE LATEST STANDARDS AND REGULATIONS OF THE CITY OF OTTAWA STANDARD SPECIFICATIONS AND DRAWINGS, ONTARIO PROVINCIAL SPECIFICATION STANDARD SPECIFICATION (OPSS) AND ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD), UNLESS OTHERWISE SPECIFIED, TO THE SATISFACTION OF THE CITY AND THE CONSULTANT.
- THE POSITION OF EXISTING POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND ABOVEGROUND UTILITIES, STRUCTURES AND APPURTENANCES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWING, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL SATISFY HIMSELF OF THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES, AND SHALL ASSUME ALL LIABILITY FOR DAMAGE TO THEM DURING THE COURSE OF CONSTRUCTION. ANY RELOCATION OF EXISTING UTILITIES REQUIRED BY THE DEVELOPMENT OF SUBJECT LANDS IS TO BE UNDERTAKEN AT CONTRACTOR'S EXPENSE.
- THE CONTRACTOR MUST NOTIFY ALL EXISTING UTILITY COMPANY OFFICIALS FIVE (5) BUSINESS DAYS PRIOR TO START OF CONSTRUCTION AND HAVE ALL EXISTING UTILITIES AND SERVICES LOCATED IN THE FIELD OR EXPOSED PRIOR TO THE START OF CONSTRUCTION, INCLUDING BUT NOT LIMITED TO HYDRO, BELL, CABLE TV, AND CONSUMERS GAS LINES.
- ALL TRENCHING AND EXCAVATIONS TO BE IN ACCORDANCE WITH THE LATEST REVISIONS OF THE OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS. ALL INFORMATION SHALL BE CONFIRMED PRIOR TO COMMENCEMENT OF CONSTRUCTION.
- REFER TO ARCHITECTS PLANS FOR BUILDING DIMENSIONS, ELEVATIONS, LAYOUT AND REMOVALS. REFER TO LANDSCAPE PLAN FOR LANDSCAPED DETAILS AND OTHER RELEVANT INFORMATION. ALL INFORMATION SHALL BE CONFIRMED PRIOR TO COMMENCEMENT OF CONSTRUCTION.
- TOPOGRAPHIC SURVEY COMPLETED AND PROVIDED BY STANTEC GEOMATICS LTD. DATED JUNE 18, 2024. CONTRACTOR TO VERIFY IN THE FIELD PRIOR TO CONSTRUCTION OF ANY WORK AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES.
- ALL ELEVATIONS ARE GEODETIC AND UTILIZE METRIC UNITS. VERIFY THAT JOB BENCHMARKS HAVE NOT BEEN ALTERED OR DISTURBED.
- ALL GROUND SURFACES SHALL BE EVENLY GRADED WITHOUT PONDING AREAS AND WITHOUT LOW POINTS EXCEPT WHERE APPROVED SWALE OR DRAIN OUTLETS ARE PROVIDED.
- ALL EDGES OF DISTURBED PAVEMENT SHALL BE SAW CUT TO FORM A NEAT AND STRAIGHT LINE PRIOR TO PLACING NEW PAVEMENT. PAVEMENT REINSTATEMENT SHALL BE WITH STEP JOINTS OF 500mm WIDTH MINIMUM.
- ALL DISTURBED AREAS OUTSIDE PROPOSED GRADING LIMITS TO BE RESTORED TO ORIGINAL ELEVATIONS AND CONDITIONS UNLESS OTHERWISE SPECIFIED. EXISTING PARKING LOT SHALL BE RE-ASPHALTED AT EXISTING GRADES EXCEPT AS NOTED TO EVEN OUT GRADES. ALL RESTORATION SHALL BE COMPLETED WITH THE GEOTECHNICAL REQUIREMENTS FOR BACKFILL AND COMPACTION.
- ABUTTING PROPERTY GRADES TO BE MATCHED.
- CONTRACTOR SHALL OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE MUNICIPAL AUTHORITIES PRIOR TO COMMENCING CONSTRUCTION, INCLUDING WATER PERMIT AND ROAD CUT PERMIT.
- MINIMIZE DISTURBANCE TO EXISTING VEGETATION DURING THE EXECUTION OF ALL WORKS.
- REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL UNLESS OTHERWISE DIRECTED FROM THE ENGINEER. EXCAVATE AND REMOVE ALL ORGANIC MATERIAL AND DEBRIS LOCATED WITHIN THE PROPOSED BUILDING, PARKING AND ROADWAY LOCATIONS.
- AT PROPOSED UTILITY CONNECTION POINTS AND CROSSINGS (I.E. STORM SEWER, SANITARY SEWER, WATER, ETC.) THE CONTRACTOR SHALL DETERMINE THE PRECISE LOCATION AND DEPTH OF EXISTING UTILITIES AND REPORT ANY DISCREPANCIES OR CONFLICTS TO THE ENGINEER BEFORE COMMENCING WORK.
- PRIOR TO CONSTRUCTION, A GEOTECHNICAL ENGINEER REGISTERED IN THE PROVINCE OF ONTARIO IS TO INSPECT ALL SUB-SURFACES FOR FOOTINGS, SERVICES AND PAVEMENT STRUCTURES.
- CONTRACTOR TO OBTAIN POST-CONSTRUCTION TOPOGRAPHIC SURVEY PERFORMED BY CERTIFIED OLS OR P.ENG. CONFIRMING COMPLIANCE WITH DESIGN GRADING AND SERVICING. SURVEY IS TO INCLUDE LOCATION AND INVERTS FOR BURIED UTILITIES.
- PROVIDE CCTV INSPECTION REPORT FOR ALL SEWERS AND CATCHBASIN LEADS 200MM DIAMETER AND LARGER. REPEAT CCTV INSPECTION FOLLOWING RECTIFICATION OF ANY DEFICIENCIES.
- REPORT REFERENCES
 - GEOTECHNICAL INVESTIGATION - PROPOSED EVENT CENTRE LANSDOWNE PARK REDEVELOPMENT, REPORT NO. PG6655-1, MAY 2024, BY PATTERSON GROUP.
 - FUNCTIONAL SERVICING AND STORMWATER MANAGEMENT REPORT FOR LANSDOWNE LIVE OTTAWA SPORT AND ENTERTAINMENT GROUP, PROJECT NO. 09-378, JANUARY 2012, BY DSEL.
 - FUNCTIONAL SERVICING AND STORMWATER MANAGEMENT STUDY FOR LANSDOWNE PARK REDEVELOPMENT 2.0, PROJECT NO. CA000286, 1682, SEPTEMBER 2023, BY WSP.
 - STORMWATER MANAGEMENT DESIGN REPORT FOR LANSDOWNE URBAN PARK, FEBRUARY 2012, BY STANTEC CONSULTING LTD.
 - SERVICING REPORT FOR LANSDOWNE PARK EVENT CENTRE, REPORT NO.CA0033920.1056, FEBRUARY 2025, PREPARED BY WSP.
 - SOTRMWATER MANAGEMENT DESIGN REPORT FOR LANSDOWNE PARK EVENT CENTRE, REPORT NO.CA0033920.1056 FEBRUARY 2025, PREPARED BY WSP.
 - DRAFT ENVIRONMENTAL PROVISIONS - LANSDOWNE PARK 2.0 - EVENT CENTRE LANDS AND GREAT LAWN, JANUARY 20, 2024, BY WSP.

ROADWORKS AND WORK IN PUBLIC RIGHTS OF WAY

- CONTRACTOR TO REINSTATE ROAD CUTS AS PER CITY OF OTTAWA DETAIL R10.
- GEOTECHNICAL INVESTIGATION - PROPOSED EVENT CENTRE LANSDOWNE PARK REDEVELOPMENT, REPORT NO. PG6655-1, MAY 2024, BY PATTERSON GROUP.
- CONTRACTOR TO PREPARE SUBGRADE, INCLUDING PROOFROLLING, TO THE SATISFACTION OF THE GEOTECHNICAL CONSULTANT PRIOR TO THE COMMENCEMENT OF PLACEMENT OF GRANULAR B MATERIAL.
- FILL TO BE PLACED AND COMPACTED PER THE GEOTECHNICAL REPORT REQUIREMENTS.
- CONTRACTOR TO SUPPLY, PLACE AND COMPACT GRANULAR B MATERIAL IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE GEOTECHNICAL CONSULTANT. CONTRACTOR TO PROVIDE CONSULTANT WITH SAMPLES OF GRANULAR B MATERIAL FOR TESTING AND CERTIFICATION FROM THE GEOTECHNICAL CONSULTANT THAT THE MATERIAL MEETS THE GRADATION REQUIREMENTS SPECIFIED IN THE GEOTECHNICAL REPORT.
- GRANULAR A MATERIAL TO BE PLACED ONLY UPON APPROVAL BY THE GEOTECHNICAL CONSULTANT OF GRANULAR B PLACEMENT.
- CONTRACTOR TO SUPPLY, PLACE AND COMPACT GRANULAR A MATERIAL IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE GEOTECHNICAL CONSULTANT. CONTRACTOR TO PROVIDE CONSULTANT WITH SAMPLES OF GRANULAR A MATERIAL FOR TESTING AND CERTIFICATION FROM THE GEOTECHNICAL CONSULTANT THAT THE MATERIAL MEETS THE GRADATION REQUIREMENTS SPECIFIED IN THE GEOTECHNICAL REPORT.
- ASPHALT MATERIAL TO BE PLACED ONLY UPON APPROVAL BY THE GEOTECHNICAL CONSULTANT OF GRANULAR A PLACEMENT.
- CONTRACTOR TO SUPPLY, PLACE AND COMPACT ASPHALT MATERIAL IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE GEOTECHNICAL CONSULTANT. CONTRACTOR TO PROVIDE CONSULTANT WITH SAMPLES OF ASPHALT MATERIAL FOR TESTING AND CERTIFICATION FROM THE GEOTECHNICAL CONSULTANT THAT THE MATERIAL MEETS THE REQUIREMENTS SPECIFIED IN THE GEOTECHNICAL REPORT.
- CONTRACTOR IS RESPONSIBLE FOR ESTABLISHING LINE AND GRADE IN ACCORDANCE WITH THE PLANS, AND FOR PROVIDING THE CONSULTANT WITH VERIFICATION PRIOR TO PLACEMENT.
- ALL EXCESS MATERIAL TO BE HAULED OFFSITE AND DISPOSED OF AT AN APPROVED DUMP SITE. SHOULD THE CONTRACTOR DISCOVER ANY HAZARDOUS MATERIAL, CONTRACTOR IS TO NOTIFY CONSULTANT. CONSULTANT TO DETERMINE APPROPRIATE DISPOSAL METHOD/LOCATION.
- PAVEMENT STRUCTURE (MATERIAL TYPES AND THICKNESS) TO BE AS SPECIFIED IN THE GEOTECHNICAL REPORT.

STORM SEWERS AND STRUCTURES

- ALL STORM SEWER MATERIALS AND CONSTRUCTION METHODS SHALL CONFORM TO THE CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS. PROVIDE CCTV INSPECTION REPORTS FOR ALL NEW STORM SEWERS, SERVICES AND CB LEADS.
- STORM SEWERS 450mm DIAMETER AND SMALLER SHALL BE PVC SDR-35, WITH RUBBER GASKET PER CSA A-257.3.
- STORM SEWER LARGER THAN 450mm SHALL BE REINFORCED CONCRETE CLASS 1000. ALL REINFORCED CONCRETE STORM SEWER PIPE SHALL BE ACCORDANCE WITH CSA A257.2. PIPE SHALL BE JOINTED WITH STD. RUBBER GASKETS AS PER CSA A257.3.
- SEWER BEDDING AS PER CITY OF OTTAWA DETAIL S6.
- ALL STORM MANHOLES TO BE AS PER STORM STRUCTURE TABLE.
- ANY NEW OR EXISTING STORM SEWER WITH LESS THAN 2.0m COVER REQUIRES THERMAL INSULATION AS PER CITY OF OTTAWA STANDARD W22, OR APPROVED BY THE ENGINEER.
- ALL CATCHBASIN LEADS TO BE MINIMUM 200mm DIAMETER AT MINIMUM 1.0% SLOPE UNLESS OTHERWISE SPECIFIED.
- SAFETY PLATFORMS SHALL BE AS PER OPSD 404.02.
- DROP STRUCTURES SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA SPECIFICATIONS AND OPSD 1003.01.
- STORM SEWER MANHOLES SERVICING LOCAL SEWERS LESS THAN 900mm SHALL BE CONSTRUCTED WITH A 300mm SUMP. FOR STORM SEWERS 900mm AND OVER USE BENCHING IN ACCORDANCE WITH OPSD 701.021.
- STORM CATCHBASINS AS PER OPSD 705.010 AND FRAME/COVER AS PER CITY STANDARD DRAWINGS S19. STORM CBM'H'S AS INDICATED IN TABLE WITH SUMP, ADJUSTMENT SECTIONS SHALL BE AS PER OPSD 704.010.
- INSTALLATION OF FLOW CONTROL IDC'S TO BE VERIFIED BY QUALITY VERIFICATION ENGINEER RETAINED BY CONTRACTOR.
- PROVIDE BACKWATER VALVE ON FOUNDATION DRAIN, STORM DISCHARGE, AND OVERFLOW DISCHARGE PER S14
- ALL CATCHBASINS EXCLUDING LANDSCAPE CATCHBASINS TO HAVE 150 MMØ PERFORATED PIPE FOR 3.0M ON ALL AVAILABLE SIDES AT AN ELEVATION OF 300mm BELOW SUBGRADE LEVEL AS PER CITY OF OTTAWA STANDARD DRAWING 'R1'

SANITARY SEWER AND STRUCTURES

- ALL SANITARY SEWER, SANITARY SEWER APPURTENANCES AND CONSTRUCTION METHODS SHALL CONFORM TO THE CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS. PROVIDE CCTV INSPECTION REPORTS FOR ALL NEW SANITARY PIPING.
- SANITARY SEWER PIPE SIZE 150mm DIAMETER AND GREATER TO BE PVC SDR-35 (UNLESS SPECIFIED OTHERWISE) WITH RUBBER GASKET TYPE JOINTS IN CONFORMANCE WITH CSA B-182.2.3.4.
- SEWER BEDDING AS PER CITY OF OTTAWA DETAIL S6.
- ALL SANITARY MANHOLES 1200mm IN DIAMETER TO BE AS PER OPSD 701.01. FRAME AND COVER TO BE AS PER CITY OF OTTAWA STANDARD S25 AND S24.
- MAINTENANCE HOLE BENCHING AND PIPE OPENING ALTERNATIVES AS PER THE OPSD 701.021
- ANY SANITARY SEWER WITH LESS THAN 2.0m COVER REQUIRES THERMAL INSULATION AS PER CITY OF OTTAWA STANDARD W22, OR APPROVED BY THE ENGINEER.
- SAFETY PLATFORMS SHALL BE AS PER OPSD 404.02.
- DROP STRUCTURES SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA SPECIFICATIONS AND OPSD 1003.01.
- PROVIDE BACKWATER VALVE FOR BUILDING SANITARY SERVICES PER S14.1

WATERMAIN

- ALL WATERMAIN AND WATERMAIN APPURTANANCES, MATERIALS, CONSTRUCTION AND TESTING METHODS SHALL CONFORM TO THE CURRENT CITY OF OTTAWA AND MINISTRY OF ENVIRONMENT STANDARDS AND SPECIFICATIONS.
- ALL WATERMAIN 300mm DIAMETER AND SMALLER TO BE POLY VINYL CHLORIDE (PVC) CLASS 150 DR 18 MEETING AWWA SPECIFICATION C900.
- ALL WATERMAIN TO BE INSTALLED AT MINIMUM COVER OF 2.4m BELOW FINISHED GRADE. WHERE WATERMANS CROSS OVER OTHER UTILITIES, A MINIMUM 0.30m CLEARANCE SHALL BE MAINTAINED; WHERE WATERMANS CROSS UNDER OTHER UTILITIES, A MINIMUM 0.50m CLEARANCE SHALL BE MAINTAINED. WHERE THE MINIMUM SEPARATION CANNOT BE ACHIEVED, THE WATERMAIN SHALL BE INSTALLED AS PER CITY OF OTTAWA STANDARDS W25 AND W25.2. WHERE 2.4m MINIMUM DEPTH CANNOT BE ACHIEVED, THERMAL INSULATION SHALL BE PROVIDED AS PER CITY OF OTTAWA STANDARD W22. WHERE A WATERMAIN IS IN CLOSE PROXIMITY TO AN OPEN STRUCTURE, THERMAL INSULATION SHALL BE PROVIDED AS PER CITY OF OTTAWA STANDARD W23.
- CONCRETE THRUST BLOCKS AND MECHANICAL RESTRAINTS ARE TO BE INSTALLED AT ALL TEES, BENDS, HYDRANTS, REDUCERS, ENDS OF MAINS AND CONNECTIONS 100mm AND LARGER, IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS W25.3 & W25.4.
- CATHODIC PROTECTION REQUIRED FOR ALL IRON FITTINGS AS PER CITY OF OTTAWA STANDARD W40 & W42.
- ALL VALVES AND VALVE BOXES AND CHAMBERS, HYDRANTS, AND HYDRANT VALVES AND ASSEMBLES SHALL BE INSTALLED AS PER CITY OF OTTAWA STANDARD
- FIRE HYDRANT LOCATION AND INSTALLATION AS PER CITY OF OTTAWA STANDARD W18 & W19. CONTRACTOR TO PROVIDE FLOW TEST AND PAINTING OF NEW HYDRANT IN ACCORDANCE WITH CITY STANDARDS.
- IF WATER MAIN MUST BE DEFLECTED TO MEET ALIGNMENT, ENSURE THAT THE AMOUNT OF DEFLECTION USED IS LESS THAN HALF THAT RECOMMENDED BY THE MANUFACTURER.

EROSION AND SEDIMENT CONTROL

- “ CONTRACTOR IS RESPONSIBLE FOR ALL INSTALLATION, MONITORING, REPAIR AND REMOVAL OF ALL EROSION AND SEDIMENT CONTROL FEATURES. ”
- PRIOR TO START OF CONSTRUCTION:
 - INSTALL SILT FENCE IN LOCATION SHOWN.
 - INSTALL SILT SACK FILTERS IN ALL THE CATCHBASINS AND MANHOLES TO REMAIN DURING CONSTRUCTION WITHIN THE SITE.
 - INSPECT MEASURES IMMEDIATELY AFTER INSTALLATION.
 - INSTALL MUD MAT AT CONSTRUCTION ENTRANCES.
 - DURING CONSTRUCTION:
 - MINIMIZE THE EXTENT OF DISTURBED AREAS AND THE DURATION OF EXPOSURE AND IMPACTS TO EXISTING GRADING.
 - PERMETER VEGETATION TO REMAIN IN PLACE UNTIL PERMANENT STORM WATER MANAGEMENT IS IN PLACE. OTHERWISE, IMMEDIATELY INSTALL SILT FENCE WHEN THE EXISTING SITE IS DISTURBED AT THE PERIMETER.
 - PROTECT DISTURBED AREAS FROM OVERLAND FLOW BY PROVIDING TEMPORARY SWALES TO THE SATISFACTION OF THE FIELD ENGINEER. TIE-IN TEMPORARY SWALE TO EXISTING CB'S AS REQUIRED.
 - PROVIDE TEMPORARY COVER SUCH AS SEEDING OR MULCHING IF DISTURBED AREA WILL NOT BE REHABILITATED WITHIN 30 DAYS.
 - INSPECT SILT FENCES, FILTER FABRIC FILTERS AND CATCH BASIN SUMPS WEEKLY AND WITHIN 24 HOURS AFTER A STORM EVENT. CLEAN AND REPAIR WHEN NECESSARY.
 - DOWNSTREAM STORM INFRASTRUCTURE SHALL BE PROTECTED FROM UNFILTERED RUNOFF DURING ON-SITE STORM INFRASTRUCTURE DEMOLITION.
 - DRAWING TO BE REVIEWED AND REVISED AS REQUIRED DURING CONSTRUCTION.
 - EROSION CONTROL FENCING TO BE ALSO INSTALLED AROUND THE BASE OF ALL STOCKPILES. DO NOT LOCATE TOPSOIL PILES AND EXCAVATION MATERIAL CLOSER THAN 2.5m FROM ANY PAVED SURFACE, OR ONE WHICH IS TO BE PAVED BEFORE THE PILE IS REMOVED. ALL TOPSOIL PILES ARE TO BE SEEDD IF THEY ARE TO REMAIN ON SITE LONG ENOUGH FOR SEEDS TO GROW (LONGER THAN 30 DAYS).
 - CONTROL WIND-BLOWN DUST OFF SITE BY SEEDING TOPSOIL PILES AND OTHER AREAS TEMPORARILY (PROVIDE WATERING AS REQUIRED AND TO THE SATISFACTION OF THE ENGINEER).
 - NO ALTERNATE METHODS OF EROSION PROTECTION SHALL BE PERMITTED UNLESS APPROVED BY THE FIELD ENGINEER.
 - CITY ROADWAY AND SIDEWALK TO BE CLEANED OF ALL SEDIMENT FROM VEHICULAR TRACKING AS REQUIRED.
 - DURING WET CONDITIONS, TIRES OF ALL VEHICLES/EQUIPMENT LEAVING THE SITE ARE TO BE SCRAPPED.
 - ANY MUD/MATERIAL TRACKED ONTO THE ROAD SHALL BE REMOVED IMMEDIATELY BY HAND OR RUBBER TIRE LOADER.
 - TAKE ALL NECESSARY STEPS TO PREVENT BUILDING MATERIAL, CONSTRUCTION DEBRIS OR WASTE BEING SPILLED OR TRACKED ONTO ABUTTING PROPERTIES OR PUBLIC STREETS DURING CONSTRUCTION AND PROCEED IMMEDIATELY TO CLEAN UP ANY AREAS SO AFFECTED.
 - ALL EROSION CONTROL STRUCTURE TO REMAIN IN PLACE UNTIL ALL DISTURBED GROUND SURFACES HAVE BEEN STABILIZED EITHER BY PAVING OR RESTORATION OF VEGETATIVE GROUND COVER.
 - THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE, DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.

STORM WATER MANAGEMENT STRUCTURE

- CHAMBERS SHALL BE STORMTECH MC-3500, OR APPROVED EQUIVALENT AS APPROVED BY THE ENGINEER. REFER TO ADS CHAMBER DRAWINGS, PROJECT S426399 FOR DETAILS, WHICH INCLUDE REQUIRED QA/QC, TESTING AND INSPECTION REQUIREMENTS WHICH SHALL BE FOLLOWED BY THE CONTRACTOR.

THERMOPLASTIC LINER

- THERMOPLASTIC LINER UNDERLYING STORM WATER CHAMBERS SHALL BE TERRAFIX ENVIRONMENTAL TECHNOLOGY INC. 40 MILL LLDPE GEOMEMBRANE, OR APPROVED EQUIVALENT AS APPROVED BY THE ENGINEER.
- LINER INSTALLATION, QA/QC, TESTING AND INSPECTIONS SHALL BE IN STRICT ACCORDANCE WITH ALL MANUFACTURER SPECIFICATIONS AND INCLUDE (BUT NOT BE LIMITED TO) SUBGRADE BASE PREPARATION, FUSION WELDING OF ALL SEAMS, VACUUM TESTING, PEEL TESTING, DOCUMENTATION (INCLUDE PHOTOGRAPHS), UNLESS OTHERWISE APPROVED BY THE GEOTECHNICAL ENGINEER. CONTRACTOR SHALL REFERENCE AND FOLLOW TERRAFIX INSTALLATION & QUALITY CONTROL MANUAL, REVISED FEBRUARY 6, 2024, OR EQUIVALENT/BETTER AS APPROVED BY THE ENGINEER.
- SUPPLIER SHALL INSPECT AND APPROVE IN WRITING ALL COMPONENTS OF TESTING.
- SUBGRADE PREPARATION SHALL BE APPROVED IN WRITTING BY MANUFACTURER AND GEOTECHNICAL ENGINEER PRIOR TO PLACEMENT OF THERMOPLASTIC LINER.

RETAINING WALLS

- PRE-CAST UNIT RETAINING WALL TYPE TO BE SPECIFIED BY PROJECT LANDSCAPE ARCHITECT AT LOCATIONS, AS SPECIFIED ON THE GRADING PLAN TO BE APPROVED BY AUTHORITIES HAVING JURISDICTION PRIOR TO EARLY SERVICING.
- ALL RETAINING WALL SHALL BE CONCRETE, CONCRETE PRODUCT WITH TIE-BACK SYSTEM OR HEAVY BLOCK SYSTEM.
- ALL TYPICAL RETAINING WALLS GREATER THAN 1.0m HEIGHT ARE TO BE DESIGNED, APPROVED AND STAMPED BY A CONSULTING ENGINEER SPECIALIZING IN STRUCTURAL ENGINEERING.
- PRIOR TO THE START OF CONSTRUCTION, THE CONTRACTOR SHALL PROVIDE SHOP DRAWINGS CERTIFIED BY A STRUCTURAL ENGINEER.
- UPON COMPLETION OF CONSTRUCTION, THE CONTRACTOR SHALL PROVIDE A CERTIFICATE FROM A STRUCTURAL ENGINEER CERTIFYING THAT THE WALL HAS BEEN CONSTRUCTED IN ACCORDANCE WITH THE APPROVED ENGINEERING DRAWINGS AND THE CERTIFIED SHOP DRAWINGS.
- FENCES OR RAILINGS ARE REQUIRED FOR WALLS HIGHER THAN 0.6m. REFER TO LANDSCAPING PLAN FOR DETAILS.

Table 2 - Recommended Light Duty Asphalt Pavement Structure - Car Only Parking Areas

Thickness (mm)	Material Description
50	Wear Course - HL-3 or Superpave 12.5 Asphaltic Concrete
150	Base - OPSS Granular A Crushed Stone
300	SUBBASE - OPSS Granular B Type II
SUBGRADE - Either approved fill, in-situ, or OPSS Granular B Type I or II material placed on in-situ soil or fill.	

Table 3 - Recommended Asphalt Pavement Structure - Access Lanes and Heavy Loading Parking Areas

Thickness (mm)	Material Description
40	Wear Course - Superpave 12.5 Asphaltic Concrete
50	Binder Course - Superpave 19.0 Asphaltic Concrete
150	Base - OPSS Granular A Crushed Stone
300	SUBBASE - OPSS Granular B Type II
SUBGRADE - Either approved fill, in-situ, or OPSS Granular B Type I or II material placed on in-situ soil or fill	

EXISTING LEGEND:

---	EXISTING CURB
---	EXISTING BOTTOM OF SLOPE
---	EXISTING TOP OF SLOPE
---	EXISTING WATERMAIN
---	EXISTING STORM SEWER
---	EXISTING SANITARY SEWER
---	EXISTING SWALE
---	EXISTING PERFORATED DRAIN
---	EXISTING FENCE
---	SITE TEMPORARY CONTROL POINT
---	EXISTING SANITARY MANHOLE
---	EXISTING FIRE HYDRANT
---	EXISTING WATER VALVE
---	EXISTING ELEVATION
---	EXISTING TREES TO REMAIN
---	EXISTING CATCHBASIN
---	EXISTING CATCHBASIN MANHOLE
---	EXISTING STORM MANHOLE

REMOVALS LEGEND:

---	CURB REMOVAL
---	STORM REMOVAL
---	STORM REMOVAL
---	WATERMAIN REMOVAL
---	RETAINING WALL REMOVAL
---	SUB DRAIN REMOVAL
---	FULL DEPTH ASPHALT REMOVAL
---	GREEN AREA/ INTERLOCK AREA REMOVAL
---	CONCRETE SIDEWALK REMOVAL
---	GRAVEL ROAD REMOVAL
---	RAMP REMOVAL
---	CLEAN SOIL REMOVAL
---	TREE PROTECTION FENCE
---	CATCH BASIN REMOVAL
---	STORM MANHOLE REMOVAL
---	SANITARY MANHOLE REMOVAL
---	FIRE HYDRANT REMOVAL
---	EXISTING TREES REMOVAL
---	BOLLAR REMOVAL
---	LIGHT STAND REMOVAL

PROPOSED LEGEND:

---	EXISTING BOUNDARY
---	NEW WATERMAIN
---	NEW STORM SEWER
---	NEW HOPE SUBDRAIN
---	NEW SANITARY SEWER
---	HIGH POINT
---	100 YR 100 YEAR PONDING LIMIT
---	NEW STORM CATCH BASIN MANHOLE
---	NEW STORM MANHOLE
---	NEW CATCH BASIN/ DITCH INLET
---	NEW SANITARY MANHOLE
---	NEW WATERMAIN VALVE
---	NEW WATERMAIN CONNECTION
---	NEW WATERMAIN 45° BEND
---	NEW SERVICING CAP
---	PROPOSED ELEVATION
---	PROPOSED SURFACE SLOPE
---	OVER FLOW DIRECTION
---	PROPOSED TRENCH DRAIN
---	PROPOSED INTERLOCK
---	PROPOSED ASPHALT PAVEMENT
---	PROPOSED INSULATION
---	PROPOSED TREES

ESC LEGEND:

---	LIGHT DUTY SILT FENCE (OPSD 219.110)
---	FILTER CLOTH PROTECTION
---	MUD MAT

DRAINAGE AREA LEGEND:

---	DRAINAGE AREA SYMBOL
---	DRAINAGE AREA BOUNDARY



Ottawa Sports and Entertainment Group

BREKIN BROOK BRYON ARCHITECTS

14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999

ARCHITECT

ENTUITIVE

135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274

STRUCTURAL ENGINEER

TAMP

200 KING, ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000

MECH. PLUMB. FIRE PROTECTION ENGINEER

MULVEY & BANANI

90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520

ELEC. LIGHTING ENGINEER

S2O

530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999

FOOD AND BEVERAGE

CSW

319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536

LANDSCAPE ARCHITECT

wsp


2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800

CIVIL ENGINEER

NO.	DESCRIPTION	DATE
13	REVISED AS PER CITY COMMENTS	2025-09-24
12	REVISED AS PER CITY COMMENTS	2025-08-20
12	ISSUED FOR PERMIT	2025-08-16
11	ISSUED FOR 100% CDS FOR TENDER	2025-06-12
10	ISSUED FOR CD UPDATE	2025-05-09
9	ISSUED FOR CD UPDATE - CLASS B ESTIMATE	2025-04-11
8	ISSUED FOR CD UPDATE	2025-03-19
7	REVISED AS PER CITY COMMENTS	2025-03-07
6	ISSUED FOR CD UPDATE	2025-02-28
5	ISSUED FOR CD UPDATE	2025-01-17
4	REVISED AS PER CITY COMMENTS	2025-01-15
3	ISSUED FOR 80% CD - CLASS B ESTIMATE	2024-11-15
2	REVISED AS PER CITY COMMENTS	2024-09-13
1	ISSUED FOR SPA	2024-08-07

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK. DO NOT SCALE THE DRAWINGS

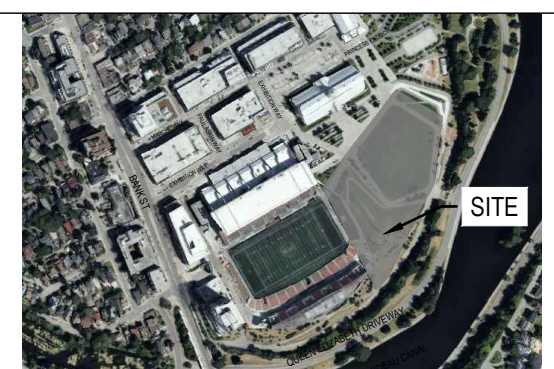

SEAL

LICENSED PROFESSIONAL ENGINEER

D. B. YANG

100230568

2025-09-24

PROVINCE OF ONTARIO

NOT FOR CONSTRUCTION

DRAWN J.T

DATE 2025/09/24

CHECKED W.Y

LANSDOWNE EVENT CENTRE

945 & 1015 BANK STREET

DWG. TITLE

NOTES AND DETAILS

SCALE AS SHOWN

PROJ. NO. CA0033920.1056

DWG. NO. C01A

STORM STRUCTURE TABLE											
STRUCTURE	TOP OF GRATE	STRUC INLET	INLET	INLET	OUTLET	SIZE	OPSD	COVER	DIAMETER	TYPE	
CB01	65.00				63.603	600X600mm	OPSD 705.010	S19.1	250	PVC	SDR-35
CB02	65.58				64.014	K200 REFER TO ACO TRENCH DRAIN DESIGN			250	PVC	SDR-35
CB03	66.28				64.191	K200 REFER TO ACO TRENCH DRAIN DESIGN			250	PVC	SDR-35
CB04	66.02				64.222	600X600mm	OPSD 705.010	S19.1	250	PVC	SDR-35
CB05	64.91				63.745	K200 REFER TO ACO TRENCH DRAIN DESIGN			250	PVC	SDR-35
CB06	64.91				63.755	K200 REFER TO ACO TRENCH DRAIN DESIGN			250	PVC	SDR-35
CB07	64.90				63.690	K200 REFER TO ACO TRENCH DRAIN DESIGN			250	PVC	SDR-35
CB08	64.90				63.188	K200 REFER TO ACO TRENCH DRAIN DESIGN			250	PVC	SDR-35
CB09	65.20				64.220	K300 REFER TO ACO TRENCH DRAIN DESIGN			300	PVC	SDR-35
CB10	65.30				63.620	600X600mm	OPSD 705.010	S19.1	250	PVC	SDR-35
CB11	65.93				63.470	K300 REFER TO ACO TRENCH DRAIN DESIGN			300	PVC	SDR-35
CB12	66.36				65.100	600X600mm	OPSD 705.010	S19.1	250	PVC	SDR-35
CB13	65.79				63.754	K200 REFER TO ACO TRENCH DRAIN DESIGN			250	PVC	SDR-35
CB14	67.22				64.288	K200 REFER TO ACO TRENCH DRAIN DESIGN			250	PVC	SDR-35
CB15	65.15				63.835	600X600mm	OPSD 705.010	S19.1	250	PVC	SDR-35
STMH201(OGS)	65.39			63.080	63.058	1800mm DIA.	OPSD 701.012	S24.1	900	PVC	SDR-35
STMH202	65.38		63.380	63.167	63.060	1800mm DIA.	OPSD 701.012	S24.1	1050	CONC	
STMH203	68.26			63.227	63.207	1800mm DIA.	OPSD 701.012	S24.1	1050	CONC	
STMH204	71.50			63.277	63.257	1800mm DIA.	OPSD 701.012	S24.1	1050	CONC	
STMH205	66.72			63.324	63.304	1800mm DIA.	OPSD 701.012	S24.1	1050	CONC	
STMH206	67.09			63.368	63.348	1800mm DIA.	OPSD 701.012	S24.1	1050	CONC	
STMH207	66.28			63.394	63.394	1800mm DIA.	OPSD 701.012	S24.1	1050	CONC	
STMH208	66.30		63.928	63.490	63.415	1800mm DIA.	OPSD 701.012	S24.1	1050	CONC	
STMH209	66.71		64.730	63.620	63.583	1800mm DIA.	OPSD 701.012	S24.1	900	CONC	
CBMH210	64.90		63.525	63.205	63.175	1200mm DIA.	OPSD 701.010	S28.1	600	CONC	
STMH211	65.75		63.243	63.223	63.223	1200mm DIA.	OPSD 701.010	S24.1	600	CONC	
STMH212	65.37			63.365	63.287	1200mm DIA.	OPSD 701.010	S24.1	600	CONC	
STMH213	65.05	63.380	63.380	63.108	63.060	1200mm DIA.	OPSD 701.010	S24.1	250	PVC	SDR-35
STMH214	66.19		64.110	63.600	63.060	1200mm DIA.	OPSD 701.010	S24.1	250	PVC	SDR-35
STMH215	66.13		64.110	63.380	63.060	1200mm DIA.	OPSD 701.010	S24.1	250	PVC	SDR-35
STMH216	65.40			63.080	63.080	1200mm DIA.	OPSD 701.010	S24.1	250	PVC	SDR-35
STMH218	66.43		64.288	63.560	63.550	1800mm DIA.	OPSD 701.012	S24.1	900	CONC	
STMH219	66.90			64.680	62.999	2400mm DIA.	OPSD 701.013	S24.1	1200	CONC	
STMH220	66.84			63.579	63.569	1800mm DIA.	OPSD 701.012	S24.1	1200	CONC	
STMH221	66.19			63.406	63.406	1800mm DIA.	OPSD 701.012	S24.1	1050	CONC	

SAN STRUCTURE TABLE								
STRUCTUR E ID	TOP OF GRATE	INVERT			DESCRIPTION			
		INLET	INLET	INLET	OUTLET	SIZE	OPSD	COVER
SAMH201	65.34			62.396	62.386	1200mm DIA.	OPSD-701.010	S24
SAMH202	66.13			62.476	62.466	1200mm DIA.	OPSD-701.010	S24
SAMH202A	67.01		64.907	62.540	62.530	1200mm DIA.	OPSD-701.010	S24
SAMH203	71.50			62.645	62.635	1200mm DIA.	OPSD-701.010	S24
SAMH204	66.65			62.696	62.686	1200mm DIA.	OPSD-701.010	S24
SAMH205	66.22		63.022	62.757	62.747	1200mm DIA.	OPSD-701.010	S24
SAMH206	66.15			62.790	62.780	1200mm DIA.	OPSD-701.010	S24
SAMH207	66.29		63.334	62.841	62.831	1200mm DIA.	OPSD-701.010	S24
SAMH208	66.65		64.886	63.017	62.997	1200mm DIA.	OPSD-701.010	S24
SAMH208A	66.40		64.907	62.931	62.921	1200mm DIA.	OPSD-701.010	S24
SAMH209	65.67			62.679	62.659	1200mm DIA.	OPSD-701.010	S24
SAMH210	65.36			62.815	62.755	1200mm DIA.	OPSD-701.010	S24
SAMH211	66.47			63.127	63.117	1200mm DIA.	OPSD-701.010	S24
SAMH212	66.37		65.095	63.220	63.210	1200mm DIA.	OPSD-701.010	S24
SAMH213	66.43			63.238	63.228	1200mm DIA.	OPSD-701.010	S24
SAMH214	66.73			62.967	62.947	1200mm DIA.	OPSD-701.010	S24
SAMH215	66.56			62.993	62.973	1200mm DIA.	OPSD-701.010	S24
SAMH216	66.18			62.817	62.807	1200mm DIA.	OPSD-701.010	S24

		Obvert		Invert			Obvert		Invert		
1	1050mmø CONC STM	64.388	63.205	0.240		Clearance Above	62.965	62.590		375mmø PVC SAN	
2	375mmø PVC SAN	62.566	62.191	0.269		Clearance Under	64.344	62.835	EX. 1350mmø CONC STM		
3	375mmø PVC SAN	62.757	62.382	0.542		Clearance Above	61.840	61.640		200mmø PVC W/M	
4	375mmø PVC SAN	62.775	62.400	0.283		Clearance Under	64.079	63.058		900mmø CONC STM	
5	EX. 200mmø PVC W/M	62.130	61.930	0.925		Clearance Under	64.076	63.055		900mmø CONC STM	
6	375mmø PVC SAN	62.836	62.461	1.313		Clearance Under	64.399	64.149		250mmø PVC STM	
7	375mmø PVC SAN	63.131	62.756	1.349		Clearance Under	64.680	64.480		200mmø PVC W/M	
8	1050mmø CONC STM	64.561	63.378	0.568		Clearance Above	62.810	62.610		200mmø PVC W/M	
9	375mmø PVC SAN	63.204	62.829	0.436		Clearance Under	63.840	63.640		200mmø PVC W/M	
10	200mmø PVC W/M	64.330	64.130	0.482		Clearance Above	63.648	63.348		300mmø PVC SAN	
11	200mmø PVC W/M	63.430	63.230	0.514		Clearance Under	64.639	63.944		600mmø CONC STM	
12	200mmø PVC W/M	64.000	63.800	0.492		Clearance Above	63.308	62.933		375mmø PVC SAN	
13	200mmø PVC SAN	65.121	64.921	0.338		Clearance Above	64.582	63.561		900mmø CONC STM	
14	250mmø PVC STM	63.757	63.507	0.665		Clearance Above	62.842	62.592	EX. 250mmø PVC SAN		
15	250mmø PVC STM	64.443	64.193	1.358		Clearance Above	62.835	62.460	EX. 375mmø PVC SAN		
17	375mmø PVC SAN	63.218	62.843	0.713		Clearance Under	64.626	63.931		600mmø CONC STM	
18	1050mmø CONC STM	64.471	63.288	0.588		Clearance Above	62.700	62.500		200mmø PVC W/M	
19	1050mmø CONC STM	64.466	63.283	0.404		Clearance Under	65.070	64.870		200mmø PVC W/M	
20	375mmø PVC SAN	63.052	62.677	1.748		Clearance Under	65.000	64.800		200mmø PVC W/M	
21	375mmø PVC SAN	63.059	62.684	1.161		Clearance Under	64.420	64.220		200mmø PVC W/M	
22	900mmø CONC STM	64.434	63.413	0.503		Clearance Above	62.910	62.710		200mmø PVC W/M	
23	900mmø CONC STM	64.410	63.389	0.349		Clearance Above	63.040	62.840		200mmø PVC W/M	
24	200mmø PVC W/M	62.120	61.920	0.530		Clearance Under	63.345	62.650	EX. 600mmø CONC STM		
25	200mmø PVC W/M	63.420	63.220	0.375		Clearance Above	62.845	62.595	EX. 250mmø PVC SAN		
26	250mmø PVC STM	64.516	64.266	1.192		Clearance Above	63.073	62.698		375mmø PVC SAN	
27	200mmø PVC W/M	61.800	61.600	0.550		Clearance Under	62.725	62.350		375mmø PVC SAN	
28	EX. 200mmø PVC W/M	62.710	62.510	0.521		Clearance Under	63.926	63.231		600mmø CONC STM	
29	EX. 200mmø PVC W/M	62.660	62.460	1.170		Clearance Under	64.080	63.830		250mmø PVC STM	
30	EX. 1200mmø CONC STM	64.330	62.984	0.320		Clearance Under	64.850	64.650		200mmø PVC W/M	
31	100mmø PVC SAN	63.248	63.148	0.382		Clearance Under	63.830	63.630		200mmø PVC W/M	
32	200mmø PVC W/M	63.090	62.890	0.537		Clearance Under	64.566	63.627	EX. 825mmø CONC STM		
33	375mmø PVC SAN	63.340	62.965	0.283		Clearance Under	64.562	63.623	EX. 825mmø CONC STM		
34	375mmø PVC SAN	63.558	63.183	0.198		Clearance Under	64.695	63.756	EX. 825mmø CONC STM		

*Note: Provide Concrete Encased for crossing clearance less than 0.30m

Andrew McCreight

ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED

By Andrew McCreight at 10:04 am, Nov 18, 2025


WATERMAIN SCHEDULE				
STATION	DESCRIPTION	FINISHED GRADE	TOP OF WATERMAIN	COVER
200mm W/M (FROM CONNECT TO EX.W/M TO BUILDING) - W1				
0+000	Connect to Ex. W/M	71.27	68.870	2.40
0+003.36	Crossing with 100mm PVC SAN	66.50	64.100	2.40
0+006.99	200mm VB	67.11	64.710	2.40
0.009.55	Crossing with 1050mm CONC STM	67.12	62.800	4.32
0+11.06	Refer to crossing table #8			
	Connect to building	67.13	64.730	2.40

WATERMAIN SCHEDULE				
STATION	DESCRIPTION	FINISHED GRADE	TOP OF WATERMAIN	COVER
200mm W/M (FROM BUILDING TO END) - W2				
1+000	Connect to proposed building	66.21	63.810	2.40
1+001.37	Crossing with 900mm CONC STM	66.21	63.010	3.20
	Refer to crossing table #22			
1+002.33	Crossing with 375mm PVC SAN	66.25	63.850	2.40
1+002.91	45° Bend	66.23	63.830	2.40
1+004.09	45° Bend	66.31	63.910	2.40
1+005.02	Crossing with 300mm PVC SAN	66.31	63.910	2.40
1+006.59	Crossing with 600mm CONC STM	66.31	63.910	2.40
1+007.95	150X200mm Tee connection	66.33	63.930	2.40
1+008.79	200mm VB	66.35	63.950	2.40
1+009.52	45° Bend	66.37	63.970	2.40
1+063.64	150X200mm Tee connection	66.43	64.030	2.40
1+066.22	200mm VB	66.43	64.030	2.40
1+070.55	45° Bend	66.49	64.090	2.40
1+075.76	45° Bend	66.42	64.020	2.40
1+075.45	Crossing with EX. 825mm CONC STM	66.39	62.890	3.50
1+078.76	Watermain cap	66.37	63.970	2.40

WATERMAIN SCHEDULE				
STATION	DESCRIPTION	FINISHED GRADE	TOP OF WATERMAIN	COVER
200mm W/M (TEE CONNECTION TO BUILDING) -W3				
2+000	200x200mm TEE Connection	66.48	64.080	2.40
2+000.41	200mm VB	66.43	64.030	2.40
2+002.13	Crossing with 375mm PVC SAN	66.40	64.000	2.40
	Crossing with 900mm CONC STM			
2+004.08	Refer to crossing table #23	66.37	63.040	3.33
2+004.92	Connect to proposed building	66.37	63.970	2.40

WATERMAIN SCHEDULE				
STATION	DESCRIPTION	FINISHED GRADE	TOP OF WATERMAIN	COVER
200mm W/M (FROM CONNECT TO EX.W/M TO BUILDING) - W4				
3+000	Connect to Ex. W/M	64.91	62.510	2.40
3+001.24	200mm VB	64.98	62.580	2.40
3+018.61	Crossing with 375mm PVC SAN	66.82	64.420	2.40
	Crossing with 1050mm CONC STM			
3+020.35	Refer to crossing table #18	66.90	62.700	4.20
3+024.84	22.5° Bend	67.12	64.720	2.40
3+028.01	Connect to proposed building	67.29	64.890	2.40

WATERMAIN SCHEDULE

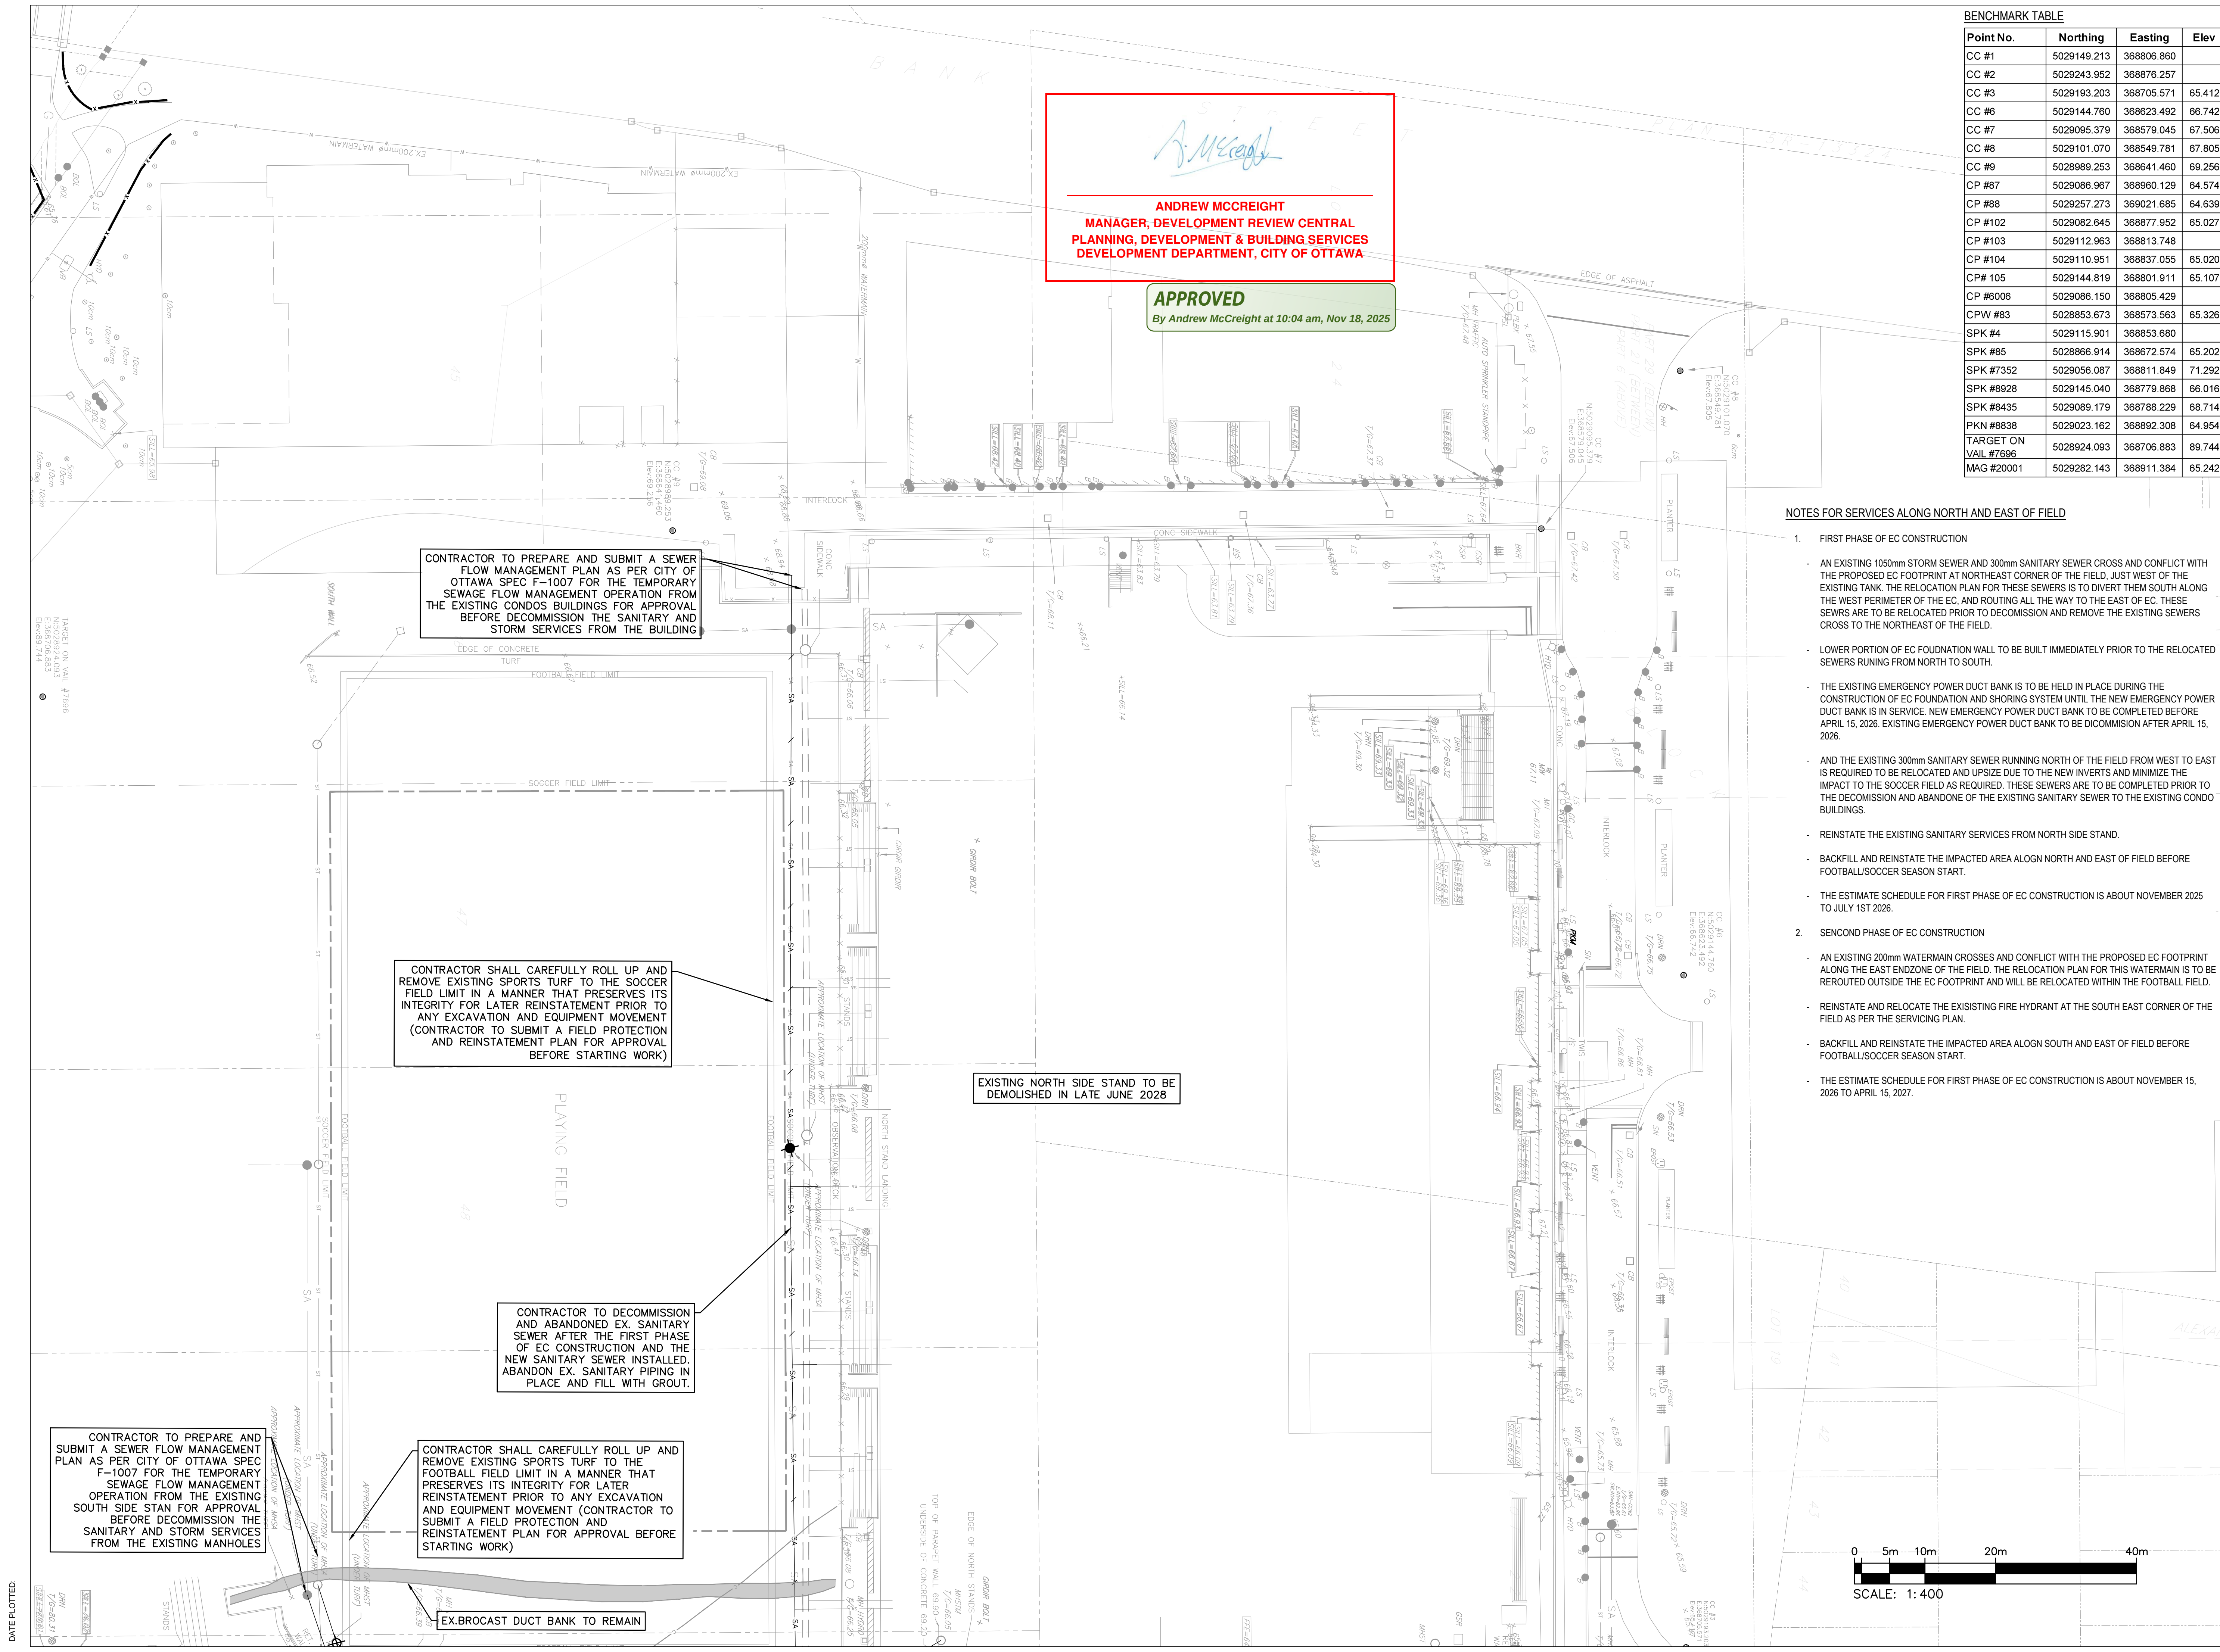

ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
By Andrew McCreight at 10:04 am, Nov 18, 2025

CONTRACTOR TO PREPARE AND SUBMIT A SEWER FLOW MANAGEMENT PLAN AS PER CITY OF OTTAWA SPEC F-1007 FOR THE TEMPORARY SEWAGE FLOW MANAGEMENT OPERATION FROM THE EXISTING CONDOS BUILDINGS FOR APPROVAL BEFORE DECOMMISSION THE SANITARY AND STORM SERVICES FROM THE BUILDING

CONTRACTOR SHALL CAREFULLY ROLL UP AND REMOVE EXISTING SPORTS TURF TO THE SOCCER FIELD LIMIT IN A MANNER THAT PRESERVES ITS INTEGRITY FOR LATER REINSTATEMENT PRIOR TO ANY EXCAVATION AND EQUIPMENT MOVEMENT (CONTRACTOR TO SUBMIT A FIELD PROTECTION AND REINSTATEMENT PLAN FOR APPROVAL BEFORE STARTING WORK)

EXISTING NORTH SIDE STAND TO BE DEMOLISHED IN LATE JUNE 2028

CONTRACTOR TO DECOMMISSION AND ABANDONED EX. SANITARY SEWER AFTER THE FIRST PHASE OF EC CONSTRUCTION AND THE NEW SANITARY SEWER INSTALLED. ABANDON EX. SANITARY PIPING IN PLACE AND FILL WITH GROUT.


CONTRACTOR TO PREPARE AND SUBMIT A SEWER FLOW MANAGEMENT PLAN AS PER CITY OF OTTAWA SPEC F-1007 FOR THE TEMPORARY SEWAGE FLOW MANAGEMENT OPERATION FROM THE EXISTING SOUTH SIDE STAN FOR APPROVAL BEFORE DECOMMISSION THE SANITARY AND STORM SERVICES FROM THE EXISTING MANHOLES

CONTRACTOR SHALL CAREFULLY ROLL UP AND REMOVE EXISTING SPORTS TURF TO THE FOOTBALL FIELD LIMIT IN A MANNER THAT PRESERVES ITS INTEGRITY FOR LATER REINSTATEMENT PRIOR TO ANY EXCAVATION AND EQUIPMENT MOVEMENT (CONTRACTOR TO SUBMIT A FIELD PROTECTION AND REINSTATEMENT PLAN FOR APPROVAL BEFORE STARTING WORK)

EX.BROADCAST DUCT BANK TO REMAIN

NOTES FOR SERVICES ALONG NORTH AND EAST OF FIELD

- FIRST PHASE OF EC CONSTRUCTION
 - AN EXISTING 1050mm STORM SEWER AND 300mm SANITARY SEWER CROSS AND CONFLICT WITH THE PROPOSED EC FOOTPRINT AT NORTHEAST CORNER OF THE FIELD. JUST WEST OF THE EXISTING TANK. THE RELOCATION PLAN FOR THESE SEWERS IS TO DIVERT THEM SOUTH ALONG THE WEST PERIMETER OF THE EC, AND ROUTING ALL THE WAY TO THE EAST OF EC. THESE SEWERS ARE TO BE RELOCATED PRIOR TO DECOMMISSION AND REMOVE THE EXISTING SEWERS CROSS TO THE NORTHEAST OF THE FIELD.
 - LOWER PORTION OF EC FOUNDATION WALL TO BE BUILT IMMEDIATELY PRIOR TO THE RELOCATED SEWERS RUNNING FROM NORTH TO SOUTH.
 - THE EXISTING EMERGENCY POWER DUCT BANK IS TO BE HELD IN PLACE DURING THE CONSTRUCTION OF EC FOUNDATION AND SHORING SYSTEM UNTIL THE NEW EMERGENCY POWER DUCT BANK IS IN SERVICE. NEW EMERGENCY POWER DUCT BANK TO BE COMPLETED BEFORE APRIL 15, 2026. EXISTING EMERGENCY POWER DUCT BANK TO BE DICOMMISSION AFTER APRIL 15, 2026.
 - AND THE EXISTING 300mm SANITARY SEWER RUNNING NORTH OF THE FIELD FROM WEST TO EAST IS REQUIRED TO BE RELOCATED AND UPSIZE DUE TO THE NEW INVERTS AND MINIMIZE THE IMPACT TO THE SOCCER FIELD AS REQUIRED. THESE SEWERS ARE TO BE COMPLETED PRIOR TO THE DECOMMISSION AND ABANDONE OF THE EXISTING SANITARY SEWER TO THE EXISTING CONDO BUILDINGS.
 - REINSTATE THE EXISTING SANITARY SERVICES FROM NORTH SIDE STAND.
 - BACKFILL AND REINSTATE THE IMPACTED AREA ALOGN NORTH AND EAST OF FIELD BEFORE FOOTBALL/SOCCER SEASON START.
 - THE ESTIMATE SCHEDULE FOR FIRST PHASE OF EC CONSTRUCTION IS ABOUT NOVEMBER 2025 TO JULY 1ST 2026.
- SECONCD PHASE OF EC CONSTRUCTION
 - AN EXISTING 200mm WATERMAIN CROSSES AND CONFLICT WITH THE PROPOSED EC FOOTPRINT ALONG THE EAST ENDZONE OF THE FIELD. THE RELOCATION PLAN FOR THIS WATERMAIN IS TO BE REROUTED OUTSIDE THE EC FOOTPRINT AND WILL BE RELOCATED WITHIN THE FOOTBALL FIELD.
 - REINSTATE AND RELOCATE THE EXISISTING FIRE HYDRANT AT THE SOUTH EAST CORNER OF THE FIELD AS PER THE SERVICING PLAN.
 - BACKFILL AND REINSTATE THE IMPACTED AREA ALOGN SOUTH AND EAST OF FIELD BEFORE FOOTBALL/SOCCER SEASON START.
 - THE ESTIMATE SCHEDULE FOR FIRST PHASE OF EC CONSTRUCTION IS ABOUT NOVEMBER 15, 2026 TO APRIL 15, 2027.

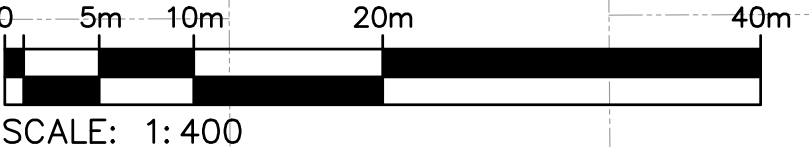

BENCHMARK TABLE			
Point No.	Northing	Easting	Elev
CC #1	5029149.213	368806.860	
CC #2	5029243.952	368876.257	
CC #3	5029193.203	368705.571	65.412
CC #6	5029144.760	368623.492	66.742
CC #7	5029095.379	368579.045	67.506
CC #8	5029101.070	368549.781	67.805
CC #9	5028989.253	368641.460	69.256
CP #87	5029086.967	368960.129	64.574
CP #88	5029257.273	369021.685	64.639
CP #102	5029082.645	368877.952	65.027
CP #103	5029112.963	368813.748	
CP #104	5029110.951	368837.055	65.020
CP# 105	5029144.819	368801.911	65.107
CP #6006	5029086.150	368805.429	
CPW #83	5028853.673	368573.563	65.326
SPK #4	5029115.901	368853.680	
SPK #85	5028866.914	368672.574	65.202
SPK #7352	5029056.087	368811.849	71.292
SPK #8928	5029145.040	368779.868	66.016
SPK #8435	5029089.179	368786.229	68.714
PKN #8638	5029023.162	368892.308	64.954
TARGET ON VAIL #7696	5028924.093	368706.883	89.744
MAG #20001	5029282.143	368911.384	65.242



ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274

TAMP
200 KING, ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH. PLUMB. FIRE PROTECTION ENGINEER

MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELEC. LIGHTING ENGINEER


S2O
530 N. WOOD STREET #C
CHICAGO, IL 60622
(717) 717-1999
FOOD AND BEVERAGE

CSW
319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE ARCHITECT

wsp
2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800
CIVIL ENGINEER

NO.	REVISIONS/ ISSUES	DATE
13	REVISED AS PER CITY COMMENTS	2025-09-24
12	REVISED AS PER CITY COMMENTS	2025-08-20
11	ISSUED FOR PERMIT	2025-08-16
10	ISSUED FOR 100% CDS FOR TENDER	2025-06-12
9	ISSUED FOR CD UPDATE	2025-05-09
8	ISSUED FOR CD UPDATE - CLASS A ESTIMATE	2025-04-11
7	ISSUED FOR CD UPDATE	2025-03-19
6	REVISED AS PER CITY COMMENTS	2025-03-07
5	ISSUED FOR CD UPDATE	2025-02-28
4	REVISED AS PER CITY COMMENTS	2025-01-17
3	ISSUED FOR 90% CD - CLASS B ESTIMATE	2024-11-15
2	REVISED AS PER CITY COMMENTS	2024-11-15
1	ISSUED FOR SPA	2024-08-07

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS

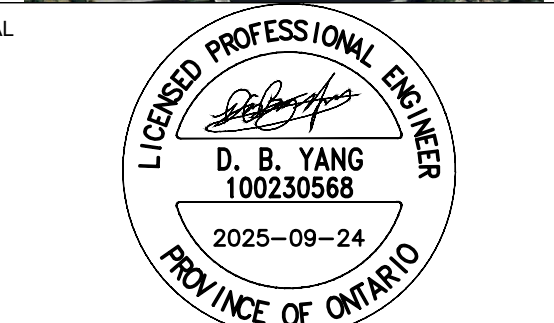

NOT FOR CONSTRUCTION
DRAWN J.T
DATE 2025/09/24
CHECKED W.Y


LANSDOWNE EVENT CENTRE
945 & 1015 BANK STREET

DWG. TITLE
REMOVAL PLAN

SCALE 1:400
PROJ. NO. CA0033920.1056
DWG. NO. C03A

DATE PLOTTED: 2025-09-24

MATCHING LINE
SEE DRAWING C03A

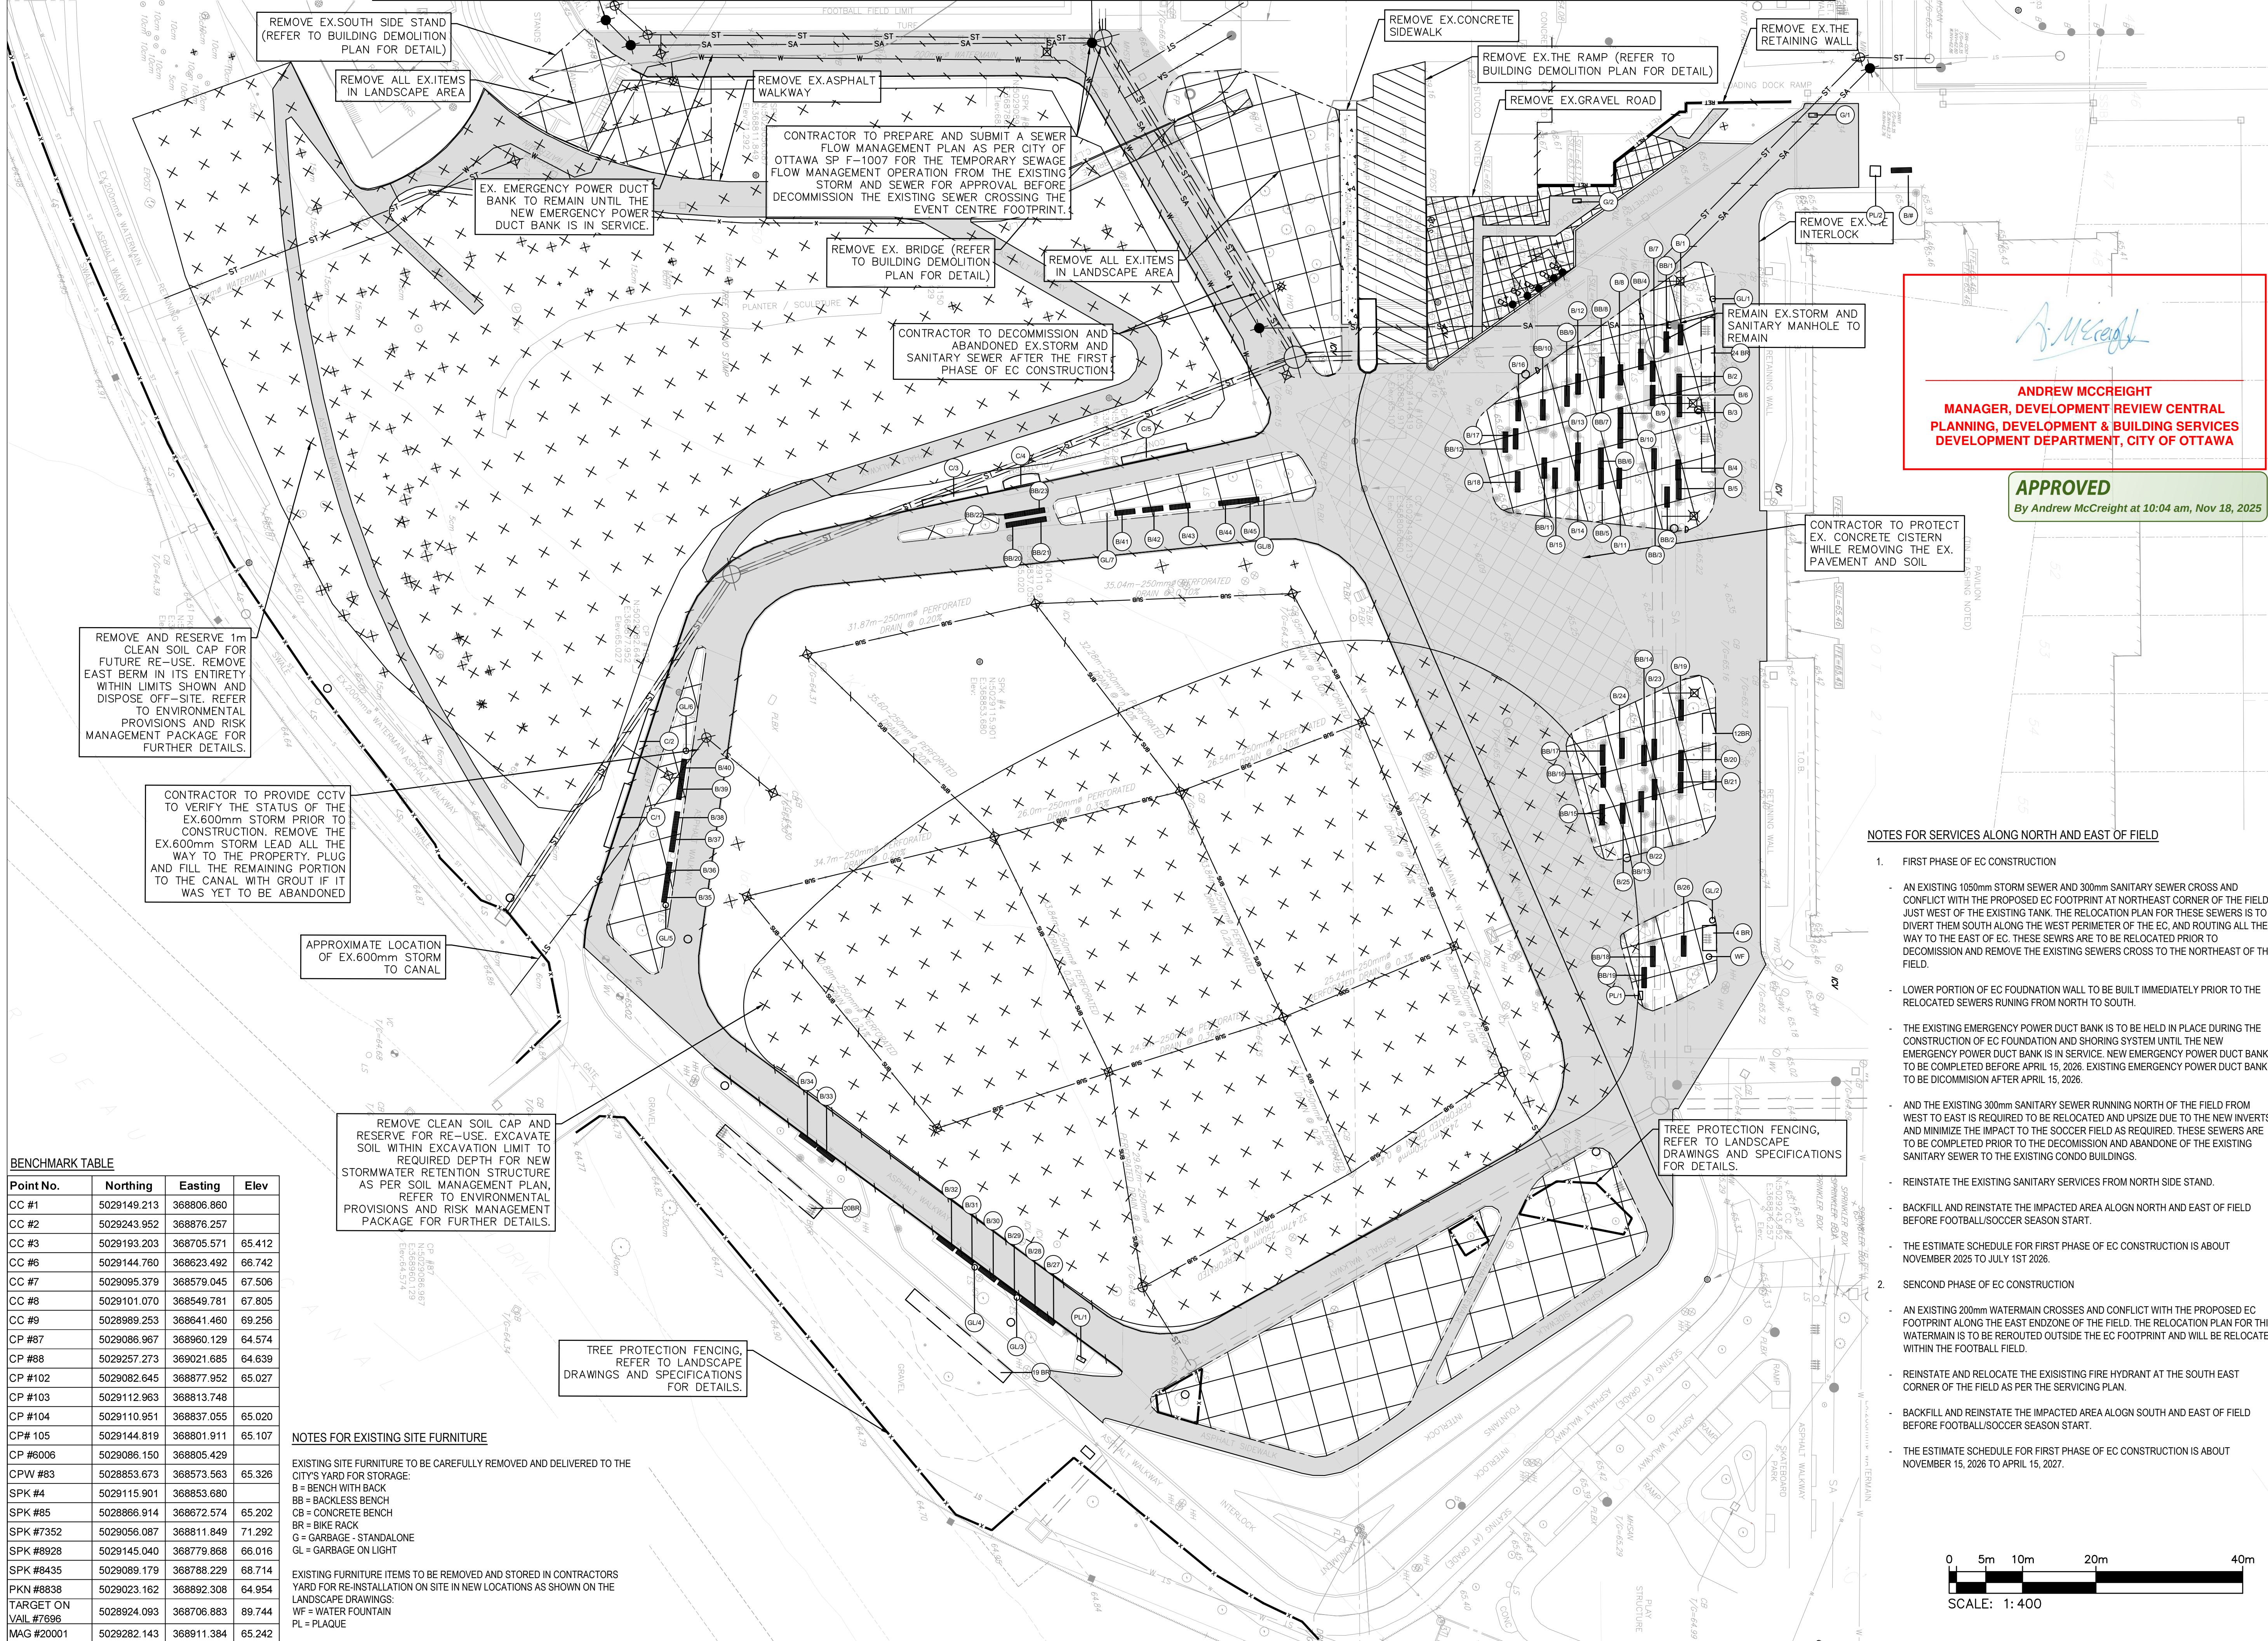

APPROVED
By Andrew McCreight at 10:04 am, Nov 18, 2025

ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA


NOTES FOR SERVICES ALONG NORTH AND EAST OF FIELD

- FIRST PHASE OF EC CONSTRUCTION
 - AN EXISTING 1050mm STORM SEWER AND 300mm SANITARY SEWER CROSS AND CONFLICT WITH THE PROPOSED EC FOOTPRINT AT NORTHEAST CORNER OF THE FIELD, JUST WEST OF THE EXISTING TANK. THE RELOCATION PLAN FOR THESE SEWERS IS TO DIVERT THEM SOUTH ALONG THE WEST PERIMETER OF THE EC, AND ROUTING ALL THE WAY TO THE EAST OF EC. THESE SEWRS ARE TO BE RELOCATED PRIOR TO DECOMMISSION AND REMOVE THE EXISTING SEWERS CROSS TO THE NORTHEAST OF THE FIELD.
 - LOWER PORTION OF EC FOUNDATION WALL TO BE BUILT IMMEDIATELY PRIOR TO THE RELOCATED SEWERS RUNNING FROM NORTH TO SOUTH.
 - THE EXISTING EMERGENCY POWER DUCT BANK IS TO BE HELD IN PLACE DURING THE CONSTRUCTION OF EC FOUNDATION AND SHORING SYSTEM UNTIL THE NEW EMERGENCY POWER DUCT BANK IS IN SERVICE. NEW EMERGENCY POWER DUCT BANK TO BE COMPLETED BEFORE APRIL 15, 2026. EXISTING EMERGENCY POWER DUCT BANK TO BE DICOMMISSION AFTER APRIL 15, 2026.
 - AND THE EXISTING 300mm SANITARY SEWER RUNNING NORTH OF THE FIELD FROM WEST TO EAST IS REQUIRED TO BE RELOCATED AND UPSIZE DUE TO THE NEW INVERTS AND MINIMIZE THE IMPACT TO THE SOCCER FIELD AS REQUIRED. THESE SEWERS ARE TO BE COMPLETED PRIOR TO THE DECOMMISSION AND ABANDONE OF THE EXISTING SANITARY SEWER TO THE EXISTING CONDO BUILDINGS.
 - REINSTATE THE EXISTING SANITARY SERVICES FROM NORTH SIDE STAND.
 - BACKFILL AND REINSTATE THE IMPACTED AREA ALOGN NORTH AND EAST OF FIELD BEFORE FOOTBALL/SOCCER SEASON START.
 - THE ESTIMATE SCHEDULE FOR FIRST PHASE OF EC CONSTRUCTION IS ABOUT NOVEMBER 2025 TO JULY 1ST 2026.
- SECONCD PHASE OF EC CONSTRUCTION
 - AN EXISTING 200mm WATERMAIN CROSSES AND CONFLICT WITH THE PROPOSED EC FOOTPRINT ALONG THE EAST ENDZONE OF THE FIELD. THE RELOCATION PLAN FOR THIS WATERMAIN IS TO BE REROUTED OUTSIDE THE EC FOOTPRINT AND WILL BE RELOCATED WITHIN THE FOOTBALL FIELD.
 - REINSTATE AND RELOCATE THE EXISISTING FIRE HYDRANT AT THE SOUTH EAST CORNER OF THE FIELD AS PER THE SERVICING PLAN.
 - BACKFILL AND REINSTATE THE IMPACTED AREA ALOGN SOUTH AND EAST OF FIELD BEFORE FOOTBALL/SOCCER SEASON START.
 - THE ESTIMATE SCHEDULE FOR FIRST PHASE OF EC CONSTRUCTION IS ABOUT NOVEMBER 15, 2026 TO APRIL 15, 2027.

BENCHMARK TABLE			
Point No.	Northing	Easting	Elev
CC #1	5029149.213	368806.860	
CC #2	5029243.952	368876.257	
CC #3	5029193.203	368705.571	65.412
CC #6	5029144.760	368623.492	66.742
CC #7	5029095.379	368579.045	67.506
CC #8	5029101.070	368549.781	67.805
CC #9	5028989.253	368641.460	69.256
CP #87	5029086.967	368960.129	64.574
CP #88	5029257.273	369021.685	64.639
CP #102	5029082.645	368877.952	65.027
CP #103	5029112.963	368813.748	
CP #104	5029110.951	368837.055	65.020
CP# 105	5029144.819	368801.911	65.107
CP #6006	5029086.150	368805.429	
CPW #83	5028853.673	368573.563	65.326
SPK #4	5029115.901	368853.680	
SPK #85	5028866.914	368672.574	65.202
SPK #7352	5029056.087	368811.849	71.292
SPK #8928	5029145.040	368779.868	66.016
SPK #8435	5029089.179	368788.229	68.714
PKN #8838	5029023.162	368892.308	64.954
TARGET ON VAIL #7696	5028924.093	368706.883	89.744
MAG #20001	5029282.143	368911.384	65.242

NOTES FOR EXISTING SITE FURNITURE

EXISTING SITE FURNITURE TO BE CAREFULLY REMOVED AND DELIVERED TO THE CITY'S YARD FOR STORAGE.
B = BENCH WITH BACK
BB = BACKLESS BENCH
CB = CONCRETE BENCH
BR = BIKE RACK
G = GARBAGE - STANDALONE
GL = GARBAGE ON LIGHT
EXISTING FURNITURE ITEMS TO BE REMOVED AND STORED IN CONTRACTORS YARD FOR RE-INSTALLATION ON SITE IN NEW LOCATIONS AS SHOWN ON THE LANDSCAPE DRAWINGS.
WF = WATER FOUNTAIN
PL = PLAQUE

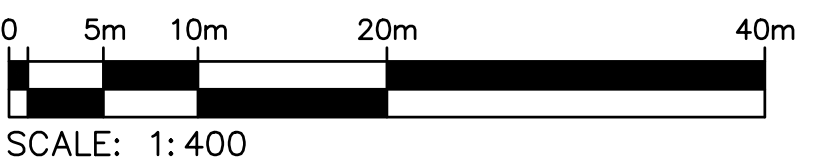

Ottawa Sports and Entertainment Group

BREIN BROOK BEYON ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999
ARCHITECT

ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274
STRUCTURAL ENGINEER

TMP
200 KING, ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH. PLUMB. FIRE PROTECTION ENGINEER

MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELEC. LIGHTING ENGINEER

S2O
530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999
FOOD AND BEVERAGE

CSW
319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE ARCHITECT

wsp
2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800
CIVIL ENGINEER

NO.	DESCRIPTION	DATE
13	REVISED AS PER CITY COMMENTS	2025-09-24
12	REVISED AS PER CITY COMMENTS	2025-08-20
11	ISSUED FOR PERMIT	2025-08-16
10	ISSUED FOR 100% CDS FOR TENDER	2025-08-12
9	ISSUED FOR CD UPDATE	2025-08-09
8	ISSUED FOR CD UPDATE	2025-04-11
7	REVISED AS PER CITY COMMENTS	2025-03-19
6	ISSUED FOR CD UPDATE	2025-03-07
5	ISSUED FOR CD UPDATE	2025-02-28
4	REVISED AS PER CITY COMMENTS	2025-01-17
3	ISSUED FOR 90% CD - CLASS B ESTIMATE	2025-01-15
2	REVISED AS PER CITY COMMENTS	2024-11-15
1	ISSUED FOR SPA	2024-09-13

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS

SEAL

LICENCED PROFESSIONAL ENGINEER
D. B. YANG
100230588
2025-09-24
PROVINCE OF ONTARIO

NOT FOR CONSTRUCTION


LANSDOWNE EVENT CENTRE
945 & 1015 BANK STREET

DWG. TITLE
REMOVAL PLAN

SCALE
1:400

DWG. NO.
C03B

PROJ. NO.
CA0033920.1056

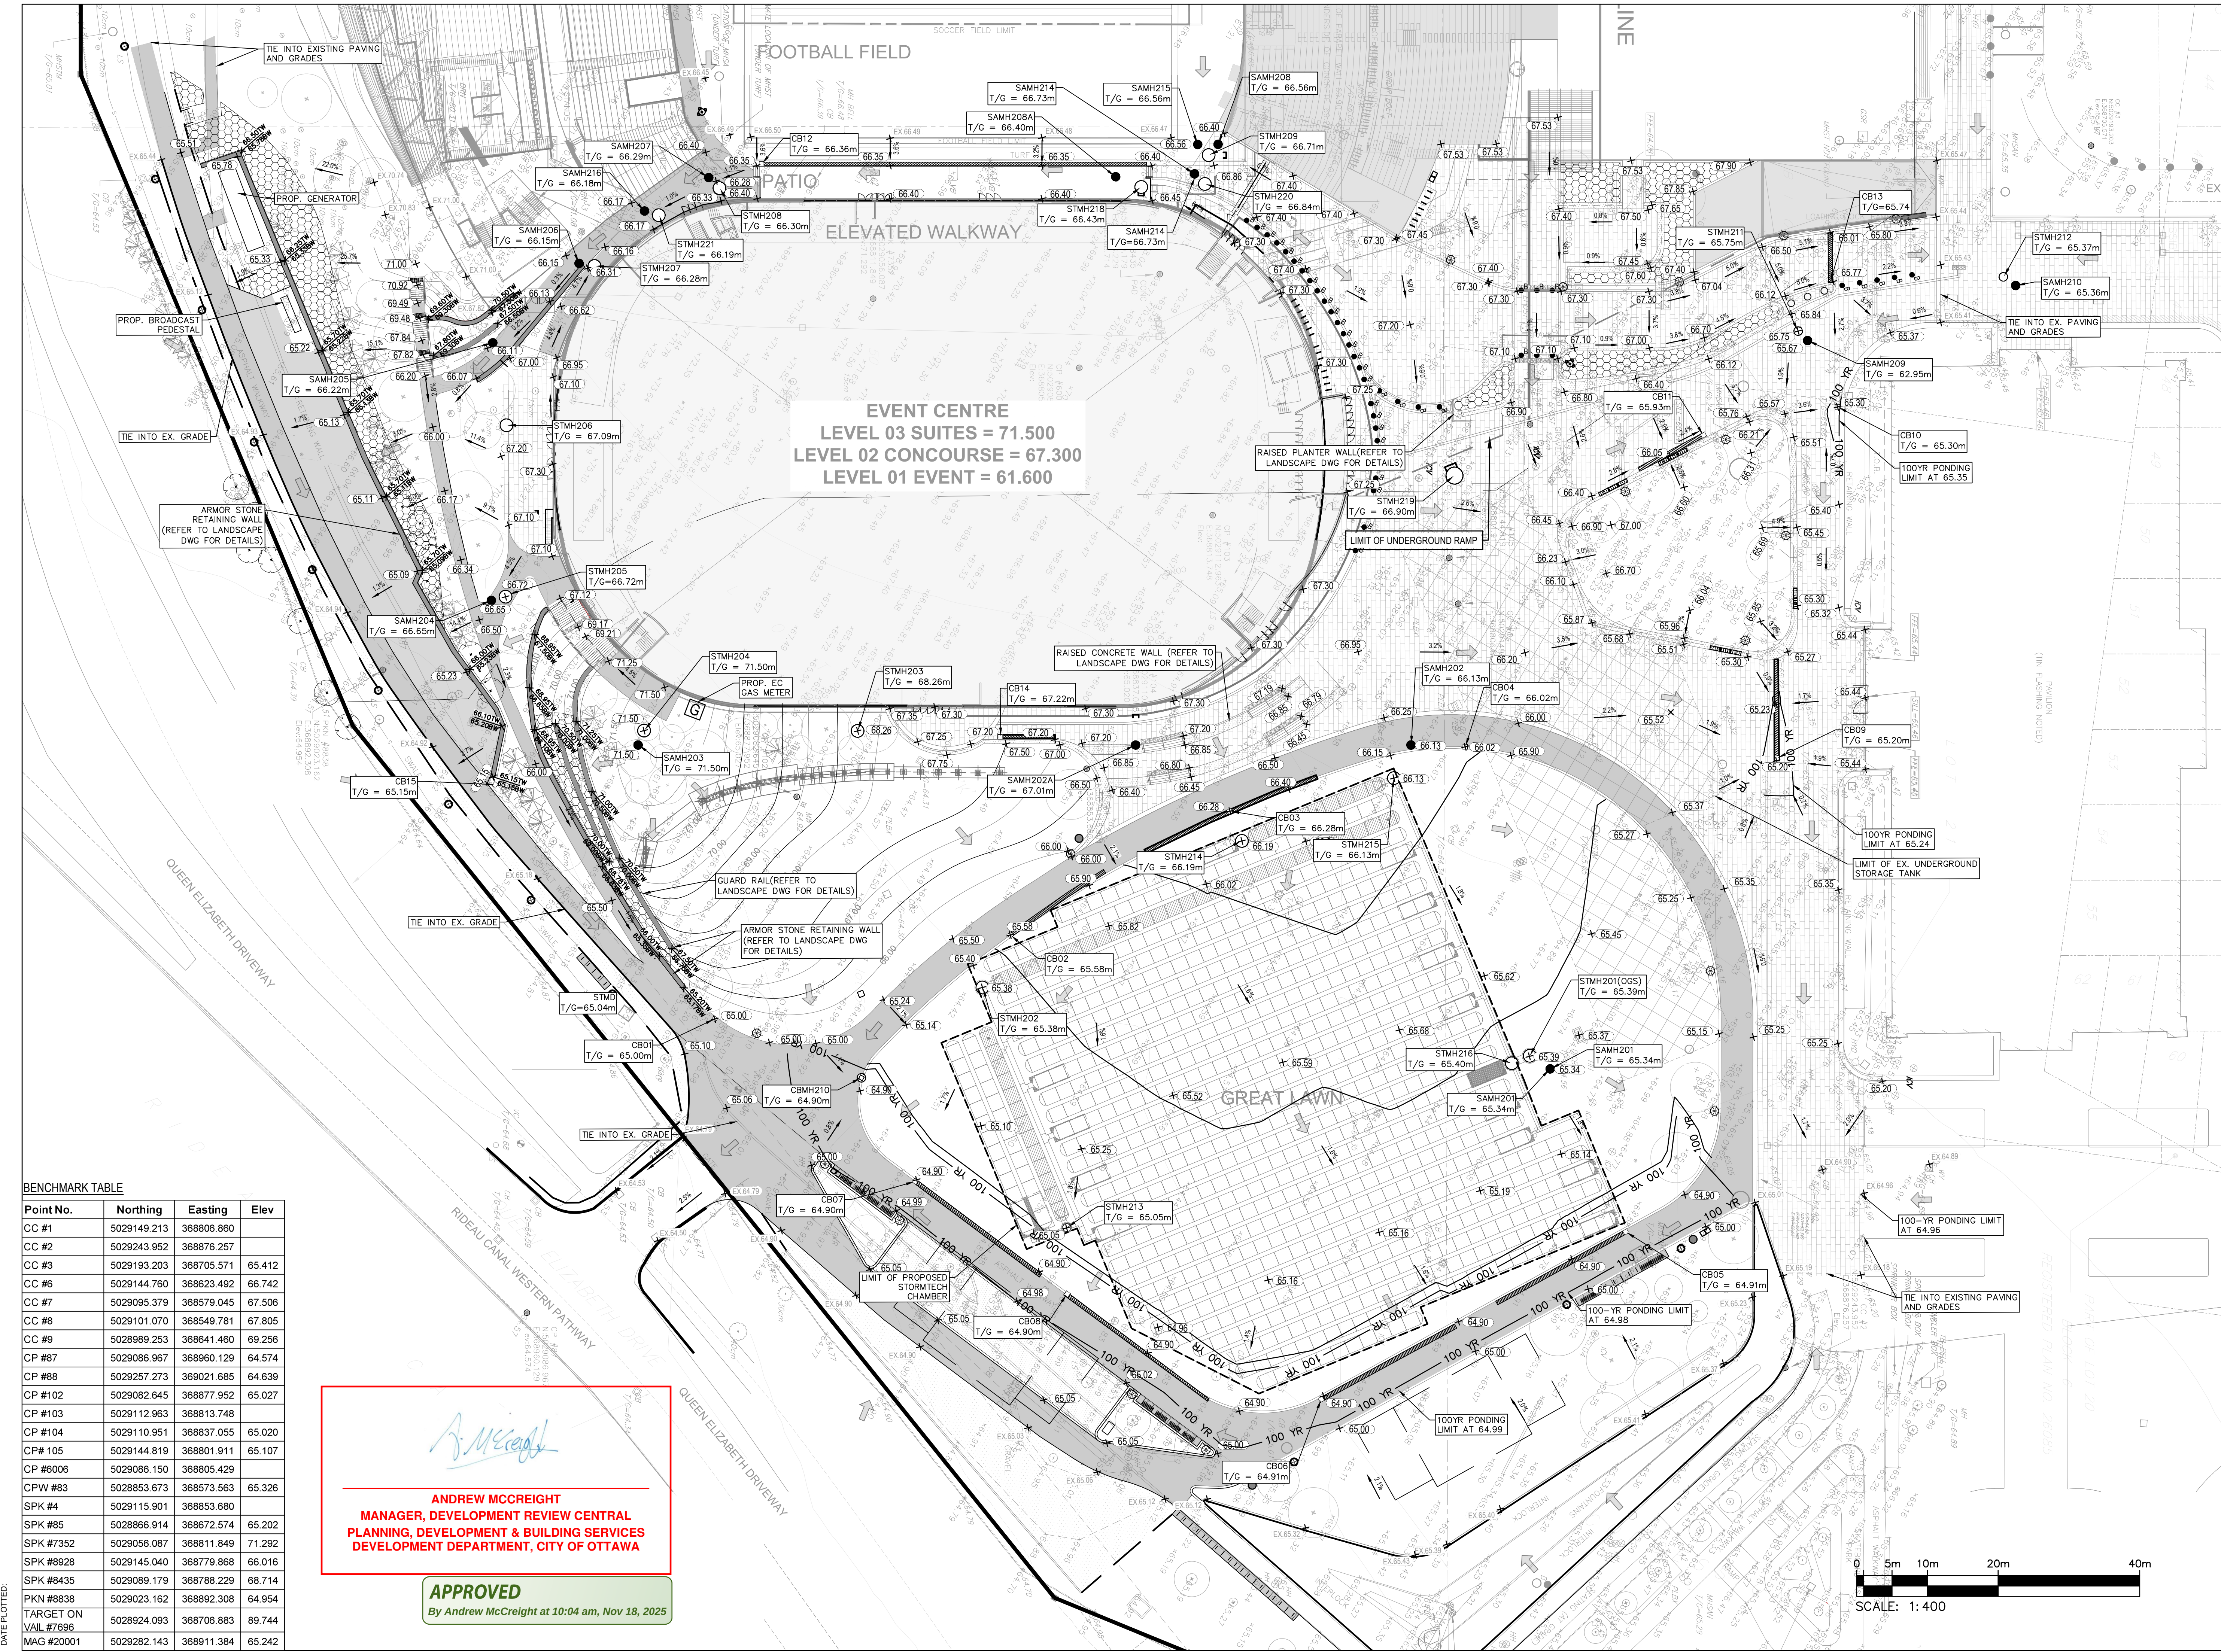

Point No.	Northing	Easting	Elev
CC #1	5029149.213	368806.860	
CC #2	5029243.952	368876.257	
CC #3	5029193.203	368705.571	65.412
CC #6	5029144.780	368623.492	66.742
CC #7	5029095.379	368579.045	67.506
CC #8	5029101.070	368549.781	67.805
CC #9	5028989.253	368641.460	69.256
CP #87	5029086.967	368960.129	64.574
CP #88	5029257.273	369021.685	64.639
CP #102	5029082.645	368877.952	65.027
CP #103	5029112.963	368813.748	
CP #104	5029110.951	368837.055	65.020
CP #105	5029144.819	368801.911	65.107
CP #8006	5029086.150	368805.429	
CPW #83	5028953.673	368573.563	65.326
SPK #4	5029115.901	368853.680	
SPK #85	5028866.914	368672.574	65.202
SPK #7352	5029056.087	368811.849	71.292
SPK #8928	5029145.040	368779.868	66.016
SPK #8435	5029089.179	368788.229	68.714
PKN #8838	5029023.162	368892.308	64.954
TARGET ON VAIL #7696	5028924.093	368706.883	89.744
MAG #20001	5029282.143	368911.384	65.242

ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
By Andrew McCreight at 10:04 am, Nov 18, 2025



Ottawa Sports and Entertainment Group



14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999

ARCHITECT

ENTUITIVE

135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274

STRUCTURAL ENGINEER



200 KING ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000

MECH. PLUMB. FIRE PROTECTION ENGINEER

MULVEY & BANANI

90 SHEPPARD AVE. EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520

ELEC. LIGHTING ENGINEER

S2O

530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999

FOOD AND BEVERAGE



319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536

LANDSCAPE ARCHITECT



2011 QUEENVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800


CIVIL ENGINEER

13	REVISED AS PER CITY COMMENTS	2025-09-24
12	REVISED AS PER CITY COMMENTS	2025-08-20
10	ISSUED FOR PERMIT	2025-08-16
11	ISSUED FOR 100% CDS FOR TENDER	2025-06-12
10	ISSUED FOR CD UPDATE	2025-05-09
9	ISSUED FOR CD UPDATE - CLASS A ESTIMATE	2025-04-11
8	ISSUED FOR CD UPDATE	2025-03-19
7	REVISED AS PER CITY COMMENTS	2025-03-07
6	ISSUED FOR CD UPDATE	2025-02-28
5	ISSUED FOR CD UPDATE	2025-01-17
4	REVISED AS PER CITY COMMENTS	2025-01-15
3	ISSUED FOR 80% CD - CLASS B ESTIMATE	2024-11-15
2	REVISED AS PER CITY COMMENTS	2024-09-13
1	ISSUED FOR SPA	2024-08-07

NO. DESCRIPTION DATE


REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK. DO NOT SCALE THE DRAWINGS

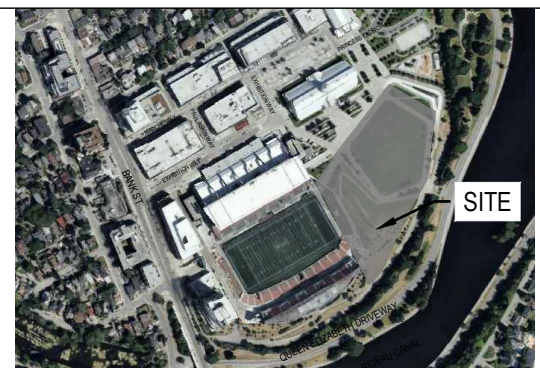


SITE

SEAL

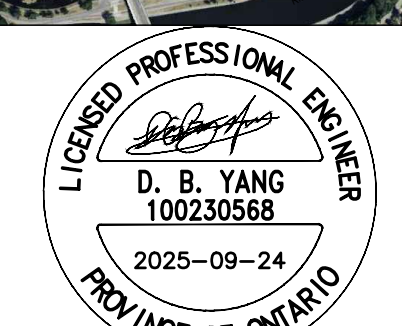

D. B. YANG
100230568
2025-09-24
PROVINCE OF ONTARIO

NOT FOR CONSTRUCTION



DRAWN J.T.
DATE 2025/09/24
CHECKED W.Y.

LANDSDOWNE EVENT CENTRE
945 & 1015 BANK STREET

DWG. TITLE

GRADING PLAN


SCALE 1:400

DWG. NO. C04

PROJ. NO. CA0033920.1056

DATE PLOTTED: 2025/09/24

971972

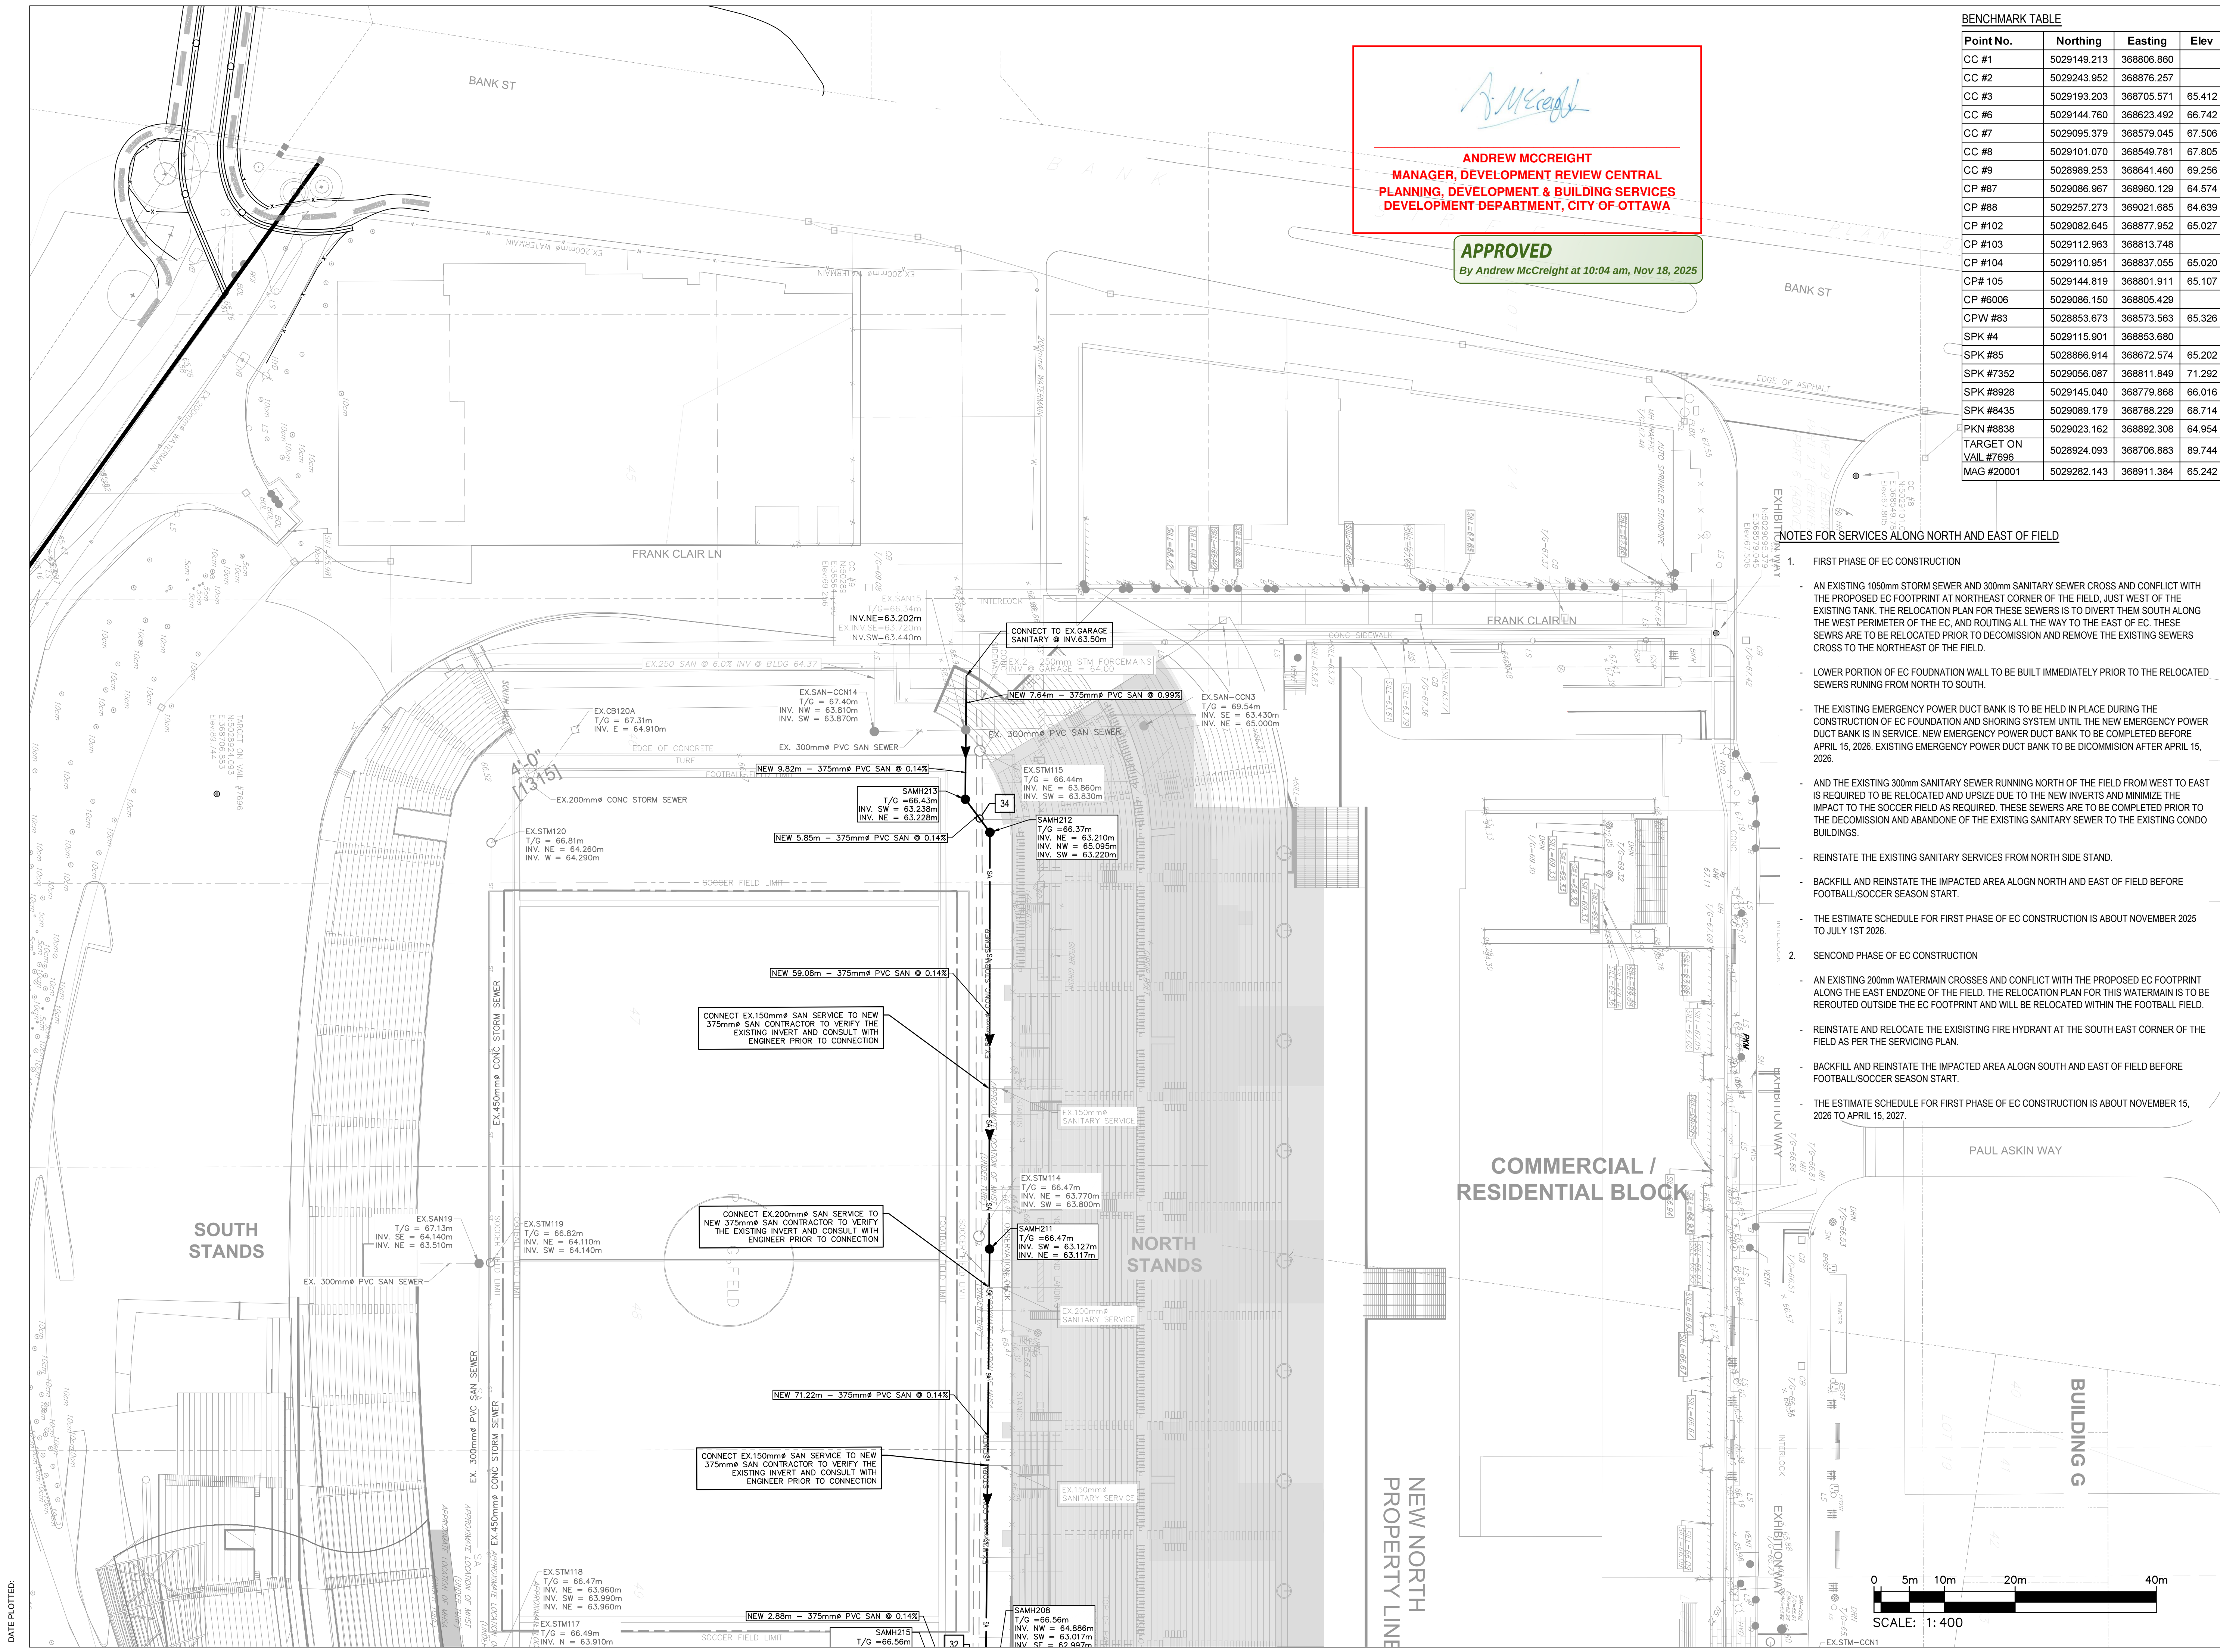

Andrew McCreight

ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
By Andrew McCreight at 10:04 am, Nov 18, 2025

BENCHMARK TABLE			
Point No.	Northing	Easting	Elev
CC #1	5029149.213	368806.860	
CC #2	5029243.952	368876.257	
CC #3	5029193.203	368705.571	65.412
CC #6	5029144.760	368623.492	66.742
CC #7	5029095.379	368579.045	67.506
CC #8	5029101.070	368549.781	67.805
CC #9	5028989.253	368641.460	69.256
CP #87	5029086.967	368960.129	64.574
CP #88	5029257.273	369021.685	64.639
CP #102	5029082.645	368877.952	65.027
CP #103	5029112.963	368813.748	
CP #104	5029110.951	368837.055	65.020
CP #105	5029144.819	368801.911	65.107
CP #6006	5029086.150	368805.429	
CPW #83	5028853.673	368573.563	65.326
SPK #4	5029115.901	368853.680	
SPK #85	5028866.914	368672.574	65.202
SPK #7352	5029056.087	368811.849	71.292
SPK #8928	5029145.040	368779.868	66.016
SPK #8435	5029089.179	368788.229	68.714
PKN #8838	5029023.162	368892.308	64.954
TARGET ON VAIL #7696	5028924.093	368706.883	89.744
MAG #20001	5029282.143	368911.384	65.242

NOTES FOR SERVICES ALONG NORTH AND EAST OF FIELD

- FIRST PHASE OF EC CONSTRUCTION
 - AN EXISTING 1050mm STORM SEWER AND 300mm SANITARY SEWER CROSS AND CONFLICT WITH THE PROPOSED EC FOOTPRINT AT NORTHEAST CORNER OF THE FIELD. JUST WEST OF THE EXISTING TANK. THE RELOCATION PLAN FOR THESE SEWERS IS TO DIVERT THEM SOUTH ALONG THE WEST PERIMETER OF THE EC, AND ROUTING ALL THE WAY TO THE EAST OF EC. THESE SEWERS ARE TO BE RELOCATED PRIOR TO DECOMMISSION AND REMOVE THE EXISTING SEWERS CROSS TO THE NORTHEAST OF THE FIELD.
 - LOWER PORTION OF EC FOUNDATION WALL TO BE BUILT IMMEDIATELY PRIOR TO THE RELOCATED SEWERS RUNNING FROM NORTH TO SOUTH.
 - THE EXISTING EMERGENCY POWER DUCT BANK IS TO BE HELD IN PLACE DURING THE CONSTRUCTION OF EC FOUNDATION AND SHORING SYSTEM UNTIL THE NEW EMERGENCY POWER DUCT BANK IS IN SERVICE. NEW EMERGENCY POWER DUCT BANK TO BE COMPLETED BEFORE APRIL 15, 2026. EXISTING EMERGENCY POWER DUCT BANK TO BE DECOMMISSION AFTER APRIL 15, 2026.
 - AND THE EXISTING 300mm SANITARY SEWER RUNNING NORTH OF THE FIELD FROM WEST TO EAST IS REQUIRED TO BE RELOCATED AND UPSIZE DUE TO THE NEW INVERTS AND MINIMIZE THE IMPACT TO THE SOCCER FIELD AS REQUIRED. THESE SEWERS ARE TO BE COMPLETED PRIOR TO THE DECOMMISSION AND ABANDONE OF THE EXISTING SANITARY SEWER TO THE EXISTING CONDO BUILDINGS.
 - REINSTATE THE EXISTING SANITARY SERVICES FROM NORTH SIDE STAND.
 - BACKFILL AND REINSTATE THE IMPACTED AREA ALOGN NORTH AND EAST OF FIELD BEFORE FOOTBALL/SOCCER SEASON START.
- THE ESTIMATE SCHEDULE FOR FIRST PHASE OF EC CONSTRUCTION IS ABOUT NOVEMBER 2025 TO JULY 1ST 2026.
- SECONDD PHASE OF EC CONSTRUCTION
 - AN EXISTING 200mm WATERMAIN CROSSES AND CONFLICT WITH THE PROPOSED EC FOOTPRINT ALONG THE EAST ENDZONE OF THE FIELD. THE RELOCATION PLAN FOR THIS WATERMAIN IS TO BE REROUTED OUTSIDE THE EC FOOTPRINT AND WILL BE RELOCATED WITHIN THE FOOTBALL FIELD.
 - REINSTATE AND RELOCATE THE EXISISTING FIRE HYDRANT AT THE SOUTH EAST CORNER OF THE FIELD AS PER THE SERVICING PLAN.
 - BACKFILL AND REINSTATE THE IMPACTED AREA ALOGN SOUTH AND EAST OF FIELD BEFORE FOOTBALL/SOCCER SEASON START.
 - THE ESTIMATE SCHEDULE FOR FIRST PHASE OF EC CONSTRUCTION IS ABOUT NOVEMBER 15, 2026 TO APRIL 15, 2027.

135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274

200 KING ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000

90 SHEPPARD AVE. EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520

530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999

319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536

2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 9K2
(613) 829-2800

NO.	REVISIONS/ ISSUES	DATE
13	REVISED AS PER CITY COMMENTS	2025-09-24
12	REVISED AS PER CITY COMMENTS	2025-08-20
10	ISSUED FOR PERMIT	2025-08-16
11	ISSUED FOR 100% CDS FOR TENDER	2025-06-12
10	ISSUED FOR CD UPDATE	2025-05-09
9	ISSUED FOR CD UPDATE - CLASS A ESTIMATE	2025-04-11
8	ISSUED FOR CD UPDATE	2025-03-19
7	REVISED AS PER CITY COMMENTS	2025-03-07
6	ISSUED FOR CD UPDATE	2025-02-28
5	ISSUED FOR CD UPDATE	2025-01-17
4	REVISED AS PER CITY COMMENTS	2025-01-15
3	ISSUED FOR 80% CD - CLASS B ESTIMATE	2024-11-15
2	REVISED AS PER CITY COMMENTS	2024-09-13
1	ISSUED FOR SPA	2024-08-07

SITE

NOT FOR CONSTRUCTION

DRAWN J.T

DATE 2025/09/24

CHECKED W.Y

LANSDOWNE EVENT CENTRE

945 & 1015 BANK STREET

DWG. TITLE

SERVICING PLAN


SCALE 1:400

DWG. NO. C05A

PROJ. NO. CA0033920.1056

DATE PLOTTED:


#07-12-24-0082
#19172

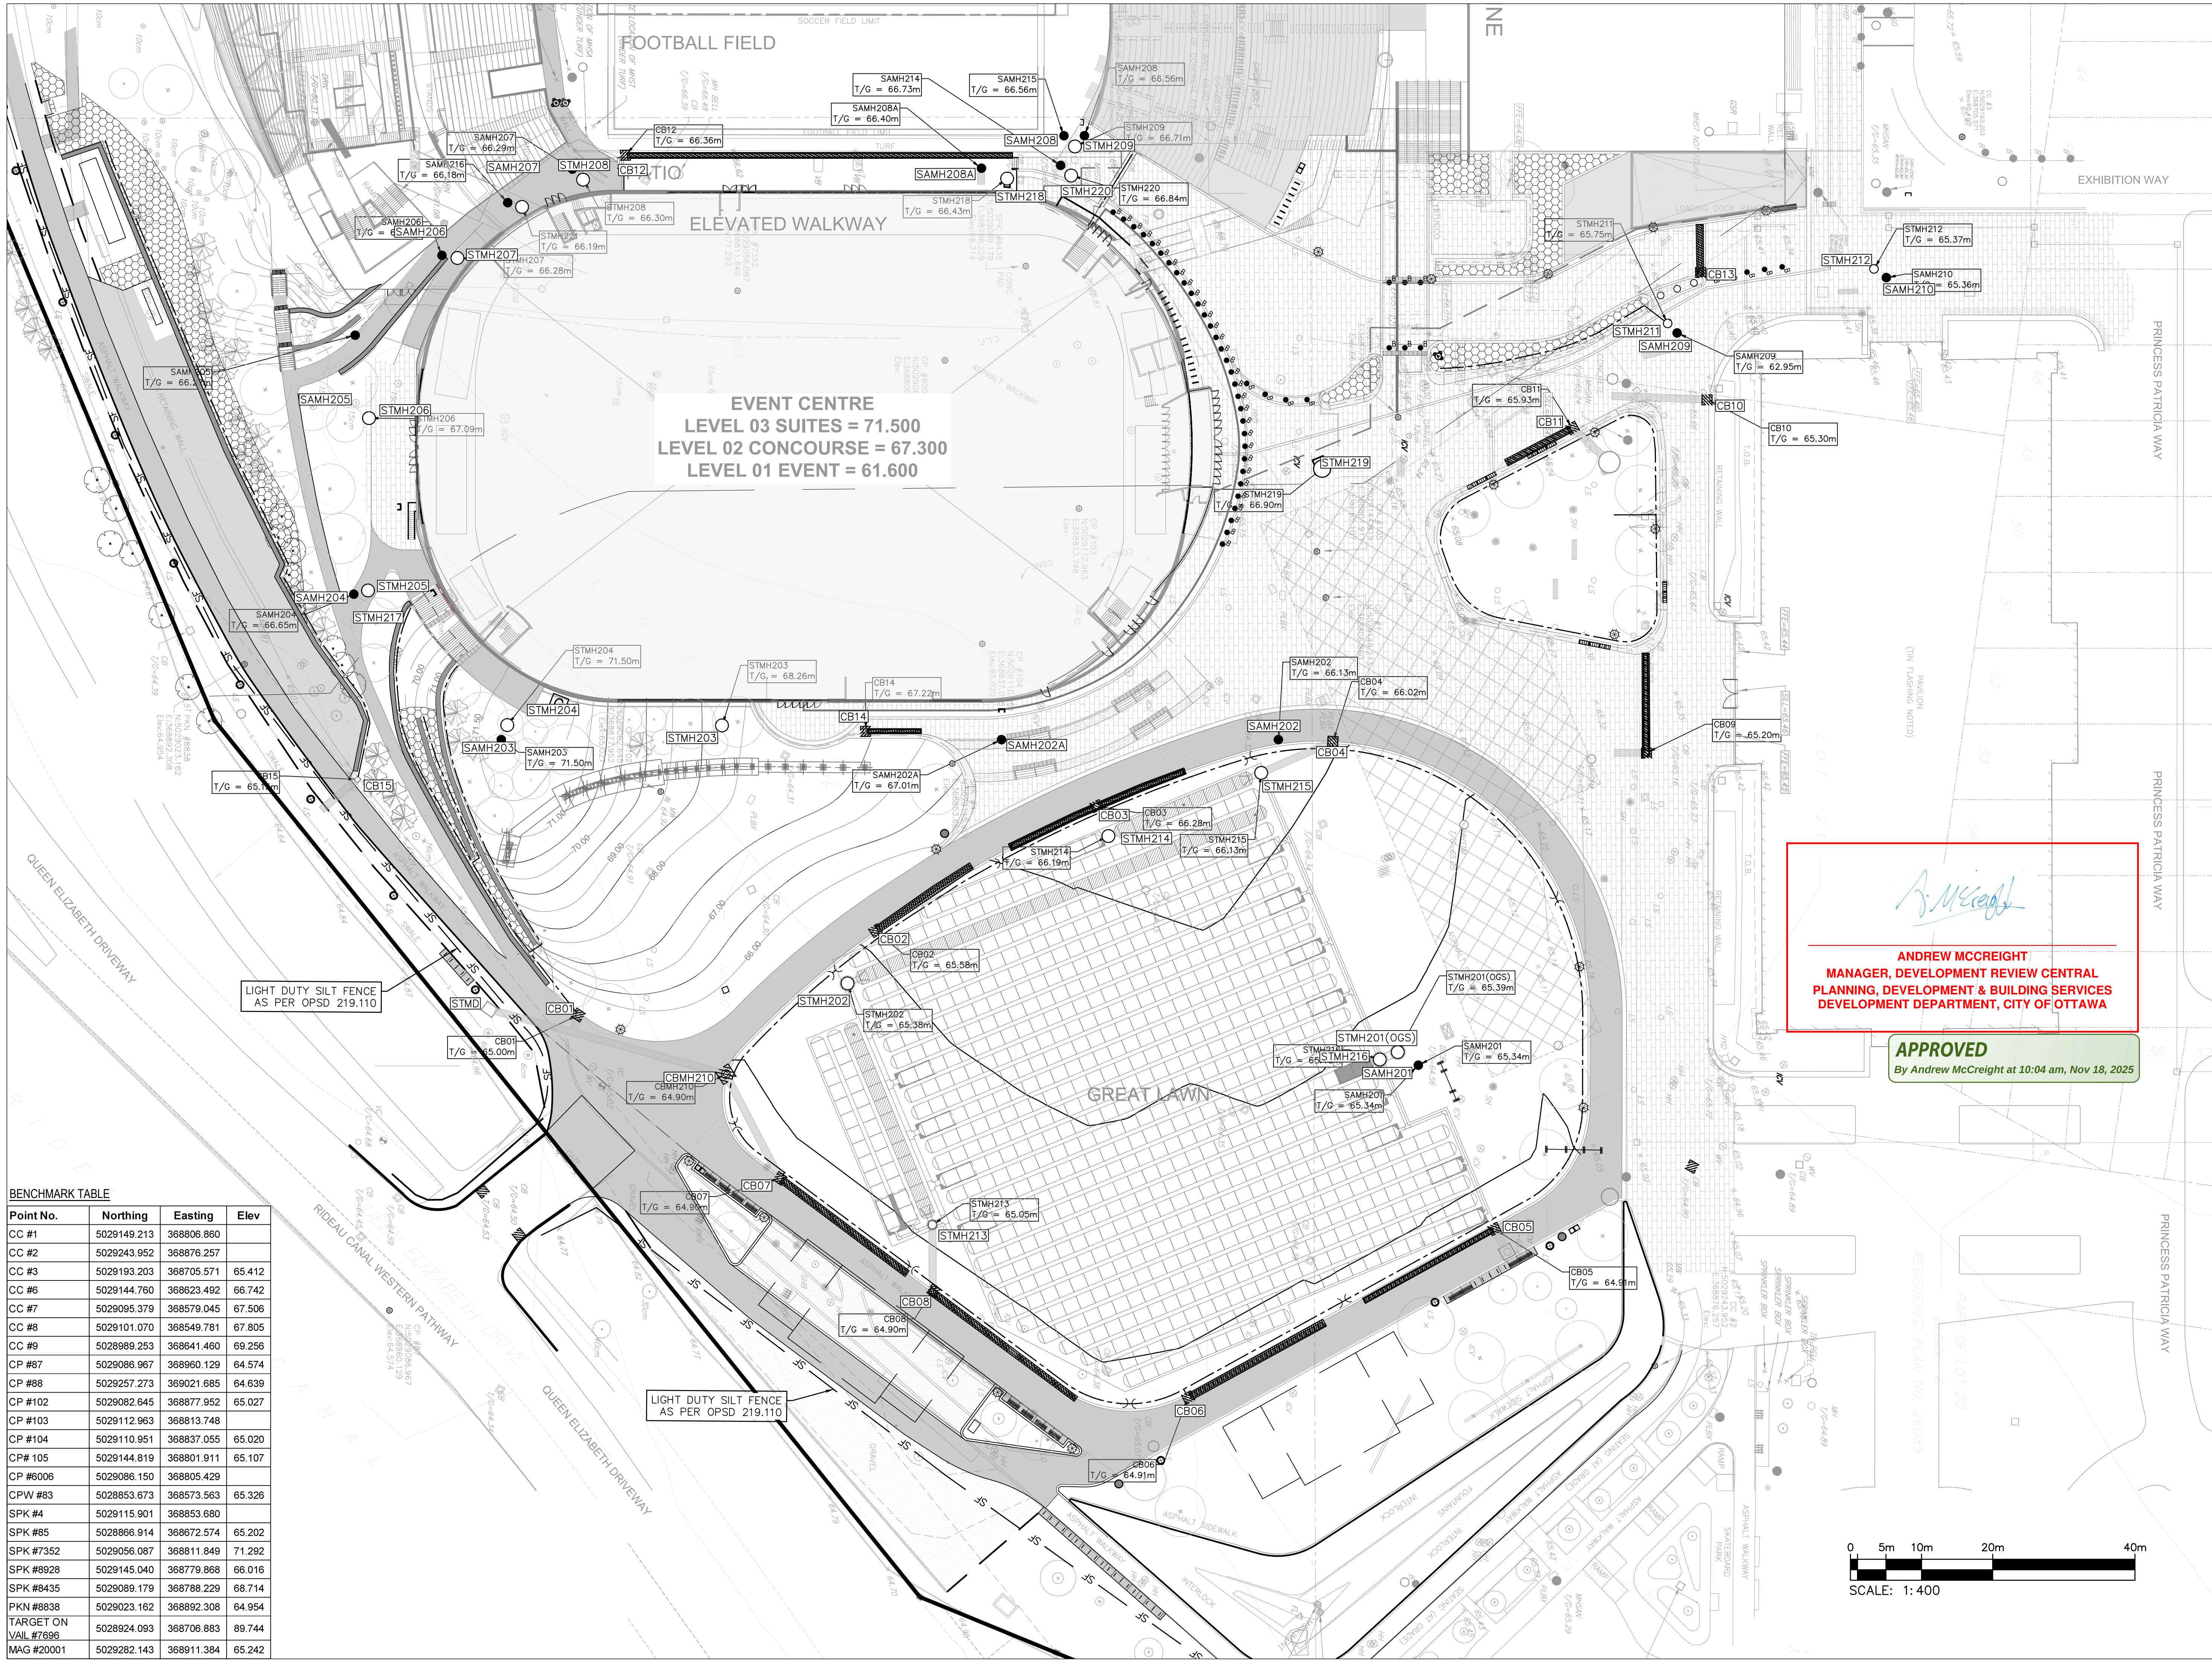

BENCHMARK TABLE			
Point No.	Northing	Easting	Elev
CC #1	5029149.213	368806.860	
CC #2	5029243.952	368876.257	
CC #3	5029193.203	368705.571	65.412
CC #6	5029144.760	368623.492	66.742
CC #7	5029095.379	368579.045	67.506
CC #8	5029101.070	368549.781	67.805
CC #9	5028989.253	368641.460	69.256
CP #87	5029086.967	368960.129	64.574
CP #88	5029257.273	369021.685	64.639
CP #102	5029082.645	368877.952	65.027
CP #103	5029112.963	368813.748	
CP #104	5029110.951	368837.055	65.020
CP# 105	5029144.819	368801.911	65.107
CP #6006	5029086.150	368805.429	
CPW #83	5028853.673	368573.563	65.326
SPK #4	5029115.901	368853.680	
SPK #85	5028866.914	368672.574	65.202
SPK #7352	5029056.087	368811.849	71.292
SPK #8928	5029145.040	368779.868	66.016
SPK #8435	5029089.179	368788.229	68.714
PKN #8838	5029023.162	368892.308	64.954
TARGET ON VAIL #7696	5028924.093	368706.883	89.744
MAG #20001	5029282.143	368911.384	65.242

Andrew McCreight
ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
By Andrew McCreight at 10:04 am, Nov 18, 2025

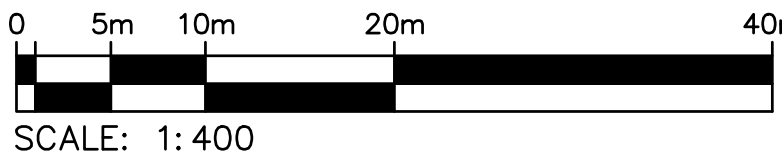

ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274
STRUCTURAL ENGINEER

200 KING, ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH. PLUMB. FIRE PROTECTION ENGINEER

MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELEC. LIGHTING ENGINEER

S2O
530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999
FOOD AND BEVERAGE

319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE ARCHITECT

2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800
CIVIL ENGINEER

13	REVISED AS PER CITY COMMENTS	2025-09-24
12	REVISED AS PER CITY COMMENTS	2025-09-20
12	ISSUED FOR PERMIT	2025-09-19
11	ISSUED FOR 100% ODS FOR TENDER	2025-06-12
10	ISSUED FOR CD UPDATE	2025-06-09
9	ISSUED FOR CD UPDATE - CLASS A ESTIMATE	2025-04-11
8	ISSUED FOR CD UPDATE	2025-03-19
7	REVISED AS PER CITY COMMENTS	2025-03-07
6	ISSUED FOR CD UPDATE	2025-02-28
5	ISSUED FOR CD UPDATE	2025-01-17
4	REVISED AS PER CITY COMMENTS	2025-01-15
3	ISSUED FOR 90% DD - CLASS B ESTIMATE	2024-11-15
2	REVISED AS PER CITY COMMENTS	2024-09-13
1	ISSUED FOR SPA	2024-09-07
NO.	DESCRIPTION	DATE

REVISIONS/ ISSUES
CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS

SITE

SEAL

NOT FOR CONSTRUCTION

NORTH

LANDSDOWNE EVENT CENTRE
945 & 1015 BANK STREET

DWG. TITLE
EROSION AND SEDIMENT CONTROL PLAN

SCALE
1:400

DWG. NO.
C06B

PROJ. NO.
CA0033920.1056

DATE PLOTTED



**BRISBIN
BROOK
BEYON** **ARCHITECTS**
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999

ARCHITECT

ENTUITIVE

135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274

STRUCTURAL ENGINEER

200 KING. ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000

MECH, PLUMB, FIRE PROTECTION ENGINEER

MULVEY & BANANI

90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520

ELEC. LIGHTING ENGINEER

 S_2O

530 N. WOOD STREET #C
CHICAGO, IL 60622

FOOD AND BEVERAGE

CSW

319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536

LANDSCAPE ARCHITECT

WS | P


2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800

CIVIL ENGINEER


13	REVISED AS PER CITY COMMENTS	2025-09-24
12	REVISED AS PER CITY COMMENTS	2025-09-23
12	ISSUED FOR PERMIT	2025-09-16
11	ISSUED FOR 100% CDS FOR TENDER	2025-08-16
10	ISSUED FOR CD UDATE	2025-08-06
9	ISSUED FOR CD UDATE - CLASS A ESTIMATE	2025-04-11
8	ISSUED FOR CD UDATE	2025-03-15
7	REVISED AS PER CITY COMMENTS	2025-03-07
6	ISSUED FOR CD UDATE	2025-02-28
5	ISSUED FOR CD UDATE	2025-01-11
4	REVISED AS PER CITY COMMENTS	2025-01-11
3	ISSUED FOR 80% DD - CLASS B ESTIMATE	2024-11-15
2	REVISED AS PER CITY COMMENTS	2024-08-13
1	ISSUED FOR SPA	2024-03-07
NO	DESCRIPTION	DATE

REVISIONS/ ISSUES


CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS

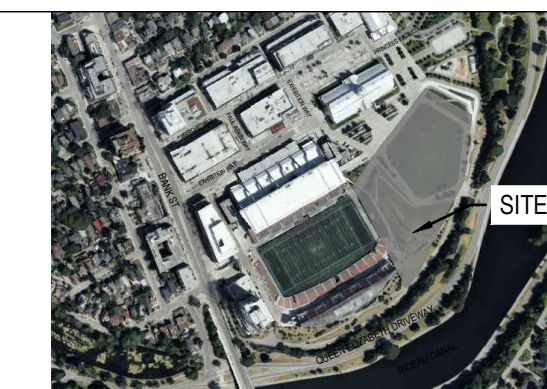

SEA

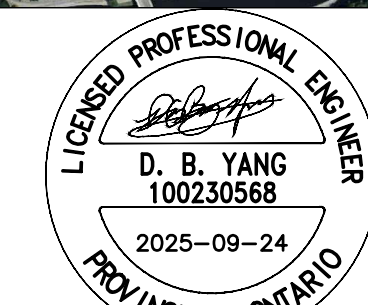

NOT FOR CONSTRUCTION



DRAWN IT

DATE 2025/09/24

CHECKED W.Y.

LANSDOWNE EVENT
CENTRE

945 & 1015 BANK STREET

DWG. TITLE

POST-DRAINAGE AREA PLAN

SCALE


1:750

PROJ. NO.	CA0033920.1056
-----------	----------------

FIG. NO.

C08

#19172

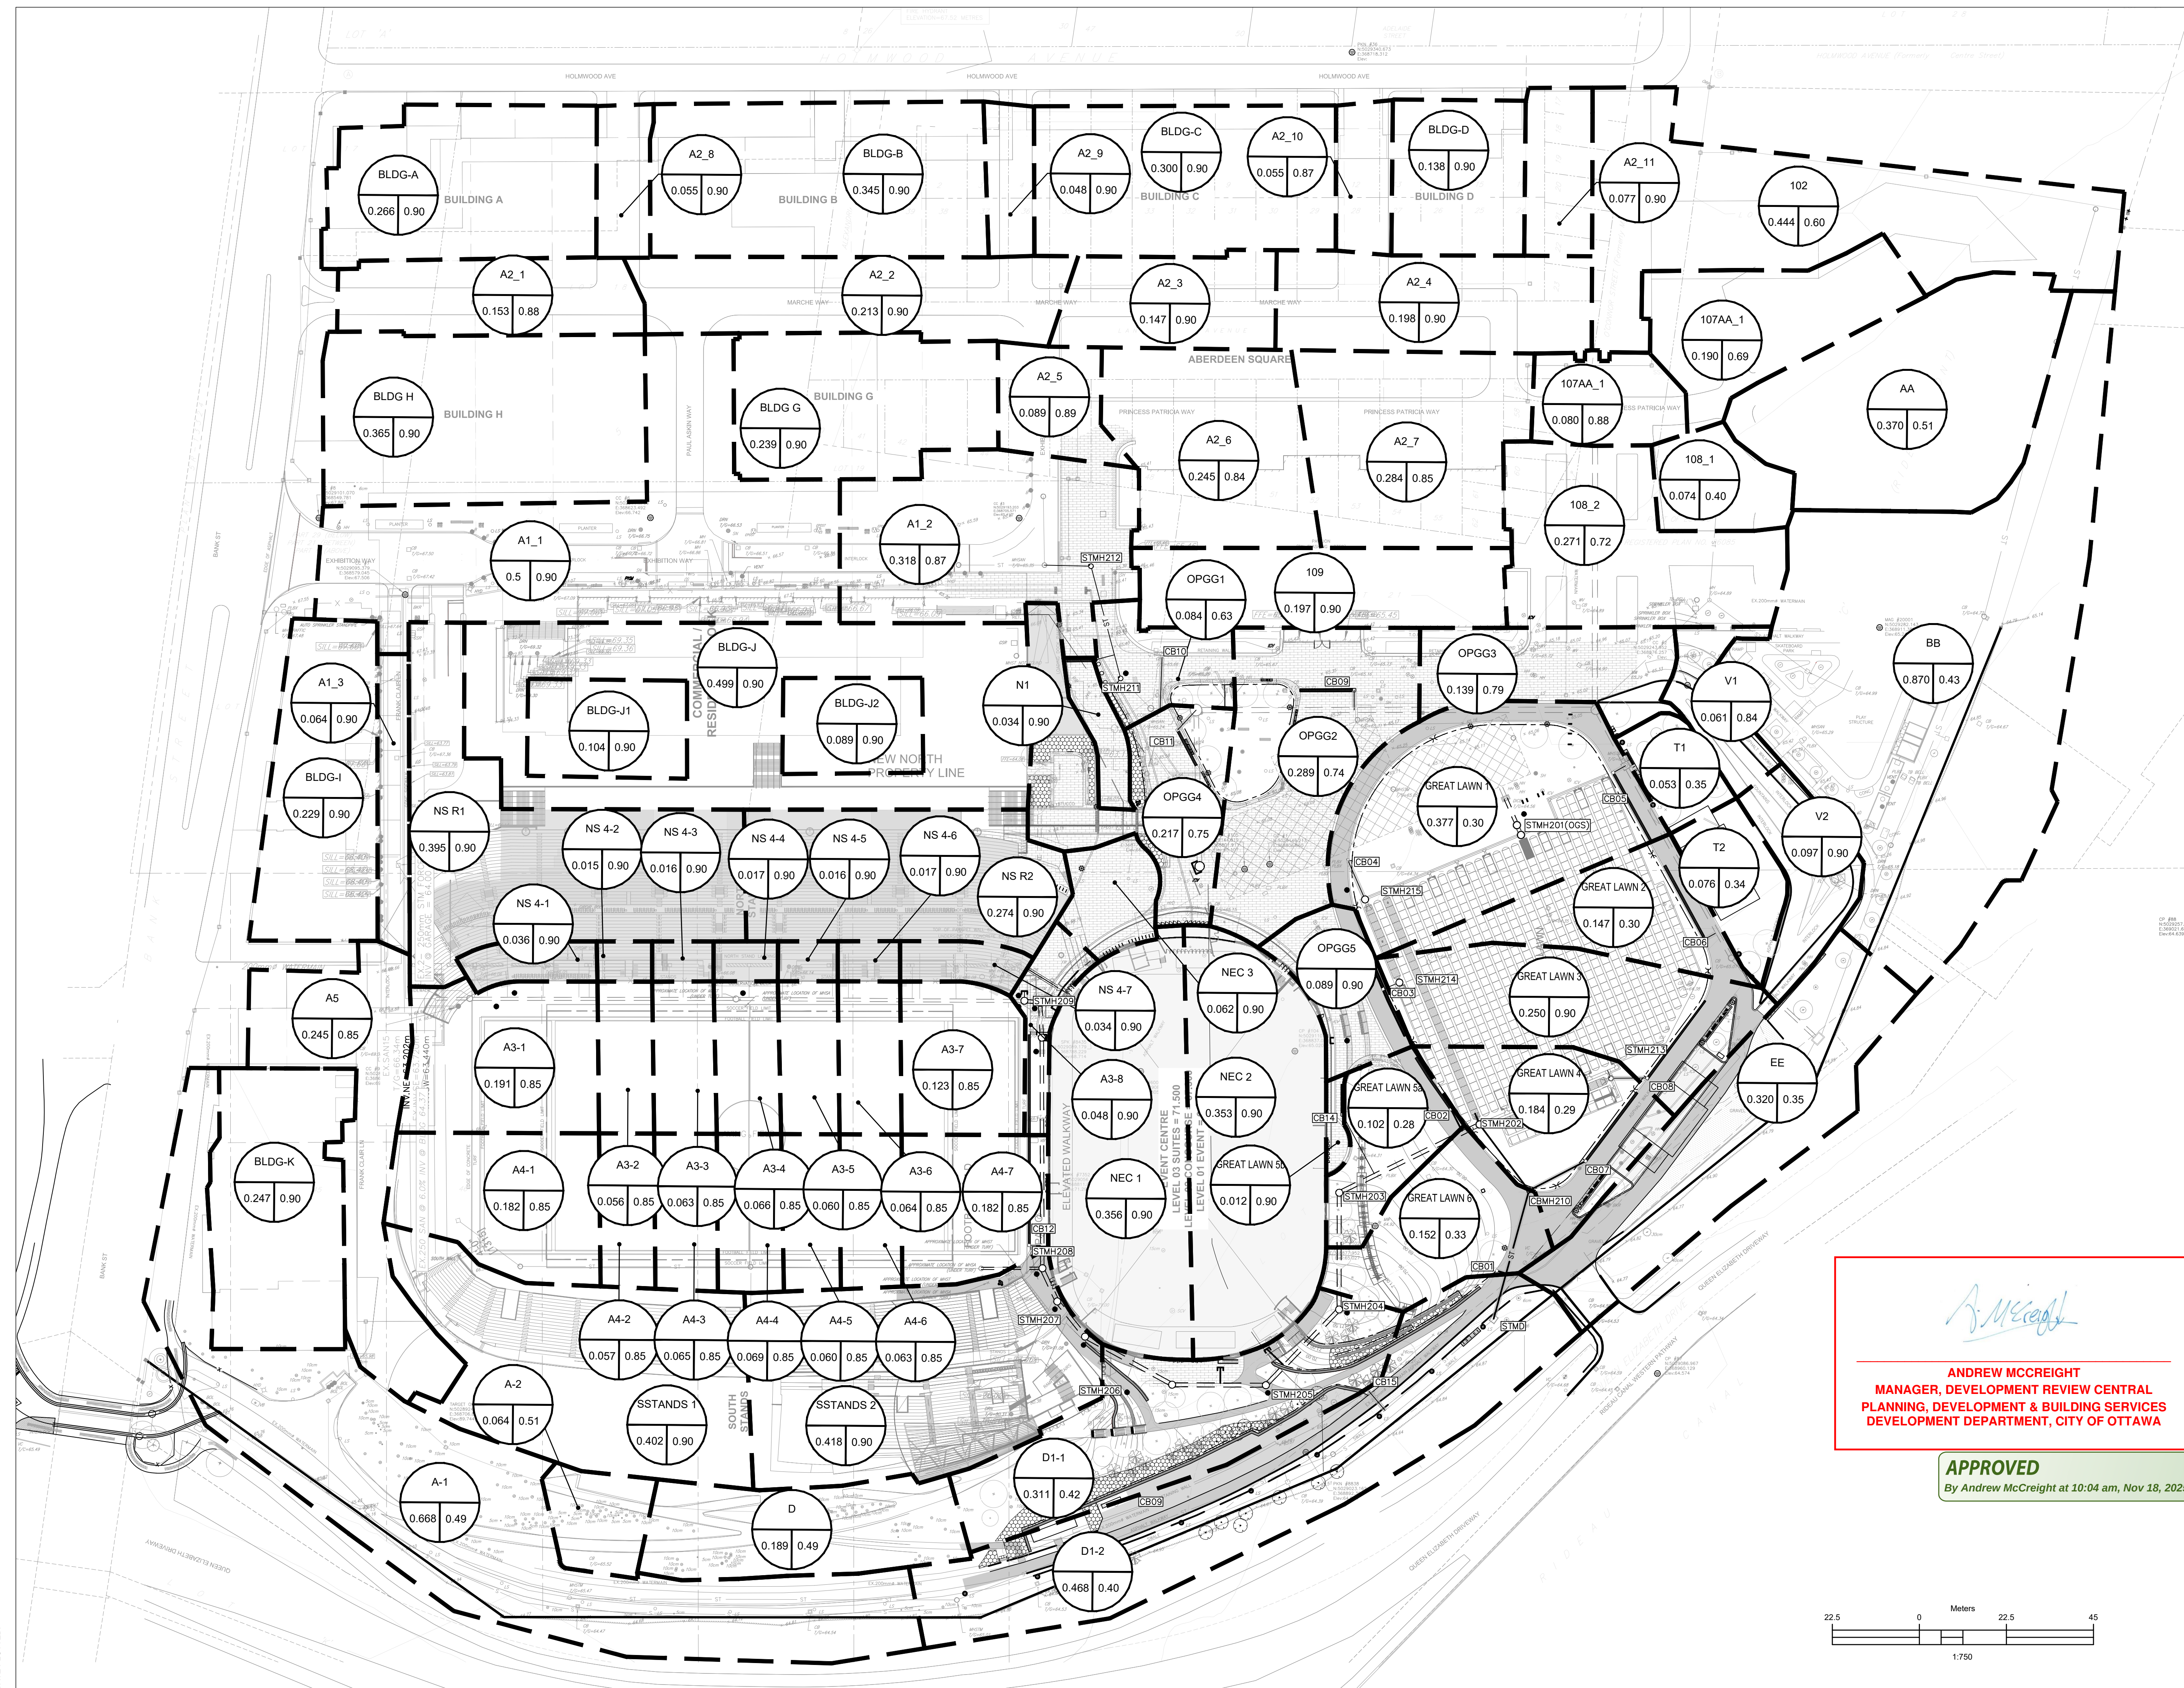

1. DRAWINGS TO BE READ IN CONJUNCTION WITH ARCHITECTURAL AND LANDSCAPE DRAWINGS.
2. ALL SERVICES, MATERIALS, CONSTRUCTION METHODS AND INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE LATEST STANDARDS AND REGULATIONS OF THE: CITY OF OTTAWA STANDARD SPECIFICATIONS AND DRAWINGS, ONTARIO PROVINCIAL SPECIFICATION STANDARD SPECIFICATION (OPSS) AND ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD), UNLESS OTHERWISE SPECIFIED, TO THE SATISFACTION OF THE CITY AND THE CONSULTANT.
3. THE POSITION OF EXISTING POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND ABOVEGROUND UTILITIES, STRUCTURES AND APPURTENANCES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWING, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL SATISFY HIMSELF OF THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES, AND SHALL ASSUME ALL LIABILITY FOR DAMAGE TO THEM DURING THE COURSE OF CONSTRUCTION. ANY RELOCATION OF EXISTING UTILITIES REQUIRED BY THE DEVELOPMENT OF SUBJECT LANDS IS TO BE UNDERTAKEN AT CONTRACTOR'S EXPENSE.
4. THE CONTRACTOR MUST NOTIFY ALL EXISTING UTILITY COMPANY OFFICIALS FIVE (5) BUSINESS DAYS PRIOR TO START OF CONSTRUCTION AND HAVE ALL EXISTING UTILITIES AND SERVICES LOCATED IN THE FIELD OR EXPOSED PRIOR TO THE START OF CONSTRUCTION, INCLUDING BUT NOT LIMITED TO HYDRO, BELL, CABLE TV, AND CONSUMERS GAS LINES.
5. ALL TRENCHING AND EXCAVATIONS TO BE IN ACCORDANCE WITH THE LATEST REVISIONS OF THE OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS. ALL INFORMATION SHALL BE CONFIRMED PRIOR TO COMMENCEMENT OF CONSTRUCTION.
6. REFER TO ARCHITECTS PLANS FOR BUILDING DIMENSIONS, ELEVATIONS, LAYOUT AND REMOVALS. REFER TO LANDSCAPE PLAN FOR LANDSCAPED DETAILS AND OTHER RELEVANT INFORMATION. ALL INFORMATION SHALL BE CONFIRMED PRIOR TO COMMENCEMENT OF CONSTRUCTION.
7. TOPOGRAPHIC SURVEY COMPLETED AND PROVIDED BY STANTEC GEOMATICS LTD. DATED JANUARY 22, 2025. CONTRACTOR TO VERIFY IN THE FIELD PRIOR TO CONSTRUCTION OF ANY WORK AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES.
8. ALL ELEVATIONS ARE GEODETIC AND UTILIZE METRIC UNITS. VERIFY THAT JOB BENCHMARKS HAVE NOT BEEN ALTERED OR DISTURBED.
9. ALL GROUND SURFACES SHALL BE EVENLY GRADED WITHOUT PONDING AREAS AND WITHOUT LOW POINTS EXCEPT WHERE APPROVED SWALES OR DRAIN OUTLETS ARE PROVIDED.
10. ALL EDGES OF DISTURBED PAVEMENT SHALL BE SAW CUT TO FORM A NEAT AND STRAIGHT LINE PRIOR TO PLACING NEW PAVEMENT. PAVEMENT REINSTATEMENT SHALL BE WITH STEP JOINTS OF 500mm width MINIMUM.
11. ALL DISTURBED AREAS OUTSIDE PROPOSED GRADING LIMITS TO BE RESTORED TO ORIGINAL ELEVATIONS AND CONDITIONS UNLESS OTHERWISE SPECIFIED. EXISTING PARKING LOT SHALL BE RE-ASPHALTED AT EXISTING GRADES EXCEPT AS NOTED TO EVEN OUT GRADES. ALL RESTORATION SHALL BE COMPLETED WITH THE GEOTECHNICAL REQUIREMENTS FOR BACKFILL AND COMPACTION.
12. ABUTTING PROPERTY GRADES TO BE MATCHED.
13. CONTRACTOR SHALL OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE MUNICIPAL AUTHORITIES PRIOR TO COMMENCING CONSTRUCTION, INCLUDING WATER PERMIT AND ROAD CUT PERMIT.
14. MINIMIZE DISTURBANCE TO EXISTING VEGETATION DURING THE EXECUTION OF ALL WORKS.
15. REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL UNLESS OTHERWISE DIRECTED FROM THE ENGINEER. EXCAVATE AND REMOVE ALL ORGANIC MATERIAL AND DEBRIS LOCATED WITHIN THE PROPOSED BUILDING, PARKING AND ROADWAY LOCATIONS.
16. AT PROPOSED UTILITY CONNECTION POINTS AND CROSSINGS (I.E. STORM SEWER, SANITARY SEWER, WATER, ETC) THE CONTRACTOR SHALL DETERMINE THE PRECISE LOCATION AND DEPTH OF EXISTING UTILITIES AND REPORT ANY DISCREPANCIES OR CONFLICTS TO THE ENGINEER BEFORE COMMENCING WORK.
17. PRIOR TO CONSTRUCTION, A GEOTECHNICAL ENGINEER REGISTERED IN THE PROVINCE OF ONTARIO IS TO INSPECT ALL SUB-SURFACES FOR FOOTINGS, SERVICES AND PAVEMENT STRUCTURES.
18. CONTRACTOR TO OBTAIN POST-CONSTRUCTION TOPOGRAPHIC SURVEY PERFORMED BY CERTIFIED QLS OR P.ENG. CONFIRMING COMPLIANCE WITH DESIGN GRADING AND SERVICINGS. SURVEY IS TO INCLUDE LOCATION AND INVERTS FOR BURIED UTILITIES.
19. PROVIDE CCTV INSPECTION REPORT FOR ALL SEWERS AND CATCHBASIN LEADS 200MM DIAMETER AND LARGER. REPEAT CCTV INSPECTION FOLLOWING RECTIFICATION OF ANY DEFICIENCIES.

1. CONTRACTOR TO REINSTATE ROAD CUTS AS PER CITY OF OTTAWA DETAIL R10.
2. GEOTECHNICAL INVESTIGATION - PROPOSED NORTH SIDE STANDS LANDSDOWNE PARK REDEVELOPMENT REPORT NO. PG6655-2, DECEMBER 2024, BY PATTERSON GROUP.
3. CONTRACTOR TO PREPARE SUBGRADE, INCLUDING PROOFROLLING, TO THE SATISFACTION OF THE GEOTECHNICAL CONSULTANT PRIOR TO THE COMMENCEMENT OF PLACEMENT OF GRANULAR B MATERIAL.
4. FILL TO BE PLACED AND COMPACTED PER THE GEOTECHNICAL REPORT REQUIREMENTS.
5. CONTRACTOR TO SUPPLY, PLACE AND COMPACT GRANULAR B MATERIAL IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE GEOTECHNICAL CONSULTANT. CONTRACTOR TO PROVIDE CONSULTANT WITH SAMPLES OF GRANULAR B MATERIAL FOR TESTING AND CERTIFICATION FROM THE GEOTECHNICAL CONSULTANT THAT THE MATERIAL MEETS THE GRADATION REQUIREMENTS SPECIFIED IN THE GEOTECHNICAL REPORT.
6. GRANULAR A MATERIAL TO BE PLACED ONLY UPON APPROVAL BY THE GEOTECHNICAL CONSULTANT OF GRANULAR B PLACEMENT.
7. CONTRACTOR TO SUPPLY, PLACE AND COMPACT GRANULAR A MATERIAL IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE GEOTECHNICAL CONSULTANT. CONTRACTOR TO PROVIDE CONSULTANT WITH SAMPLES OF GRANULAR A MATERIAL FOR TESTING AND CERTIFICATION FROM THE GEOTECHNICAL CONSULTANT THAT THE MATERIAL MEETS THE GRADATION REQUIREMENTS SPECIFIED IN THE GEOTECHNICAL REPORT.
8. ASPHALT MATERIAL TO BE PLACED ONLY UPON APPROVAL BY THE GEOTECHNICAL CONSULTANT OF GRANULAR A PLACEMENT.
9. CONTRACTOR TO SUPPLY, PLACE AND COMPACT ASPHALT MATERIAL IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE GEOTECHNICAL CONSULTANT. CONTRACTOR TO PROVIDE CONSULTANT WITH SAMPLES OF ASPHALT MATERIAL FOR TESTING AND CERTIFICATION FROM THE GEOTECHNICAL CONSULTANT THAT THE MATERIAL MEETS THE REQUIREMENTS SPECIFIED IN THE GEOTECHNICAL REPORT.
10. CONTRACTOR IS RESPONSIBLE FOR ESTABLISHING LINE AND GRADE IN ACCORDANCE WITH THE PLANS, AND FOR PROVIDING THE CONSULTANT WITH VERIFICATION PRIOR TO PLACEMENT.
11. ALL EXCESS MATERIAL TO BE HAULED OFFSITE AND DISPOSED OF AT AN APPROVED DUMP SITE. SHOULD THE CONTRACTOR DISCOVER ANY HAZARDOUS MATERIAL, CONTRACTOR IS TO NOTIFY CONSULTANT. CONSULTANT TO DETERMINE APPROPRIATE DISPOSAL METHODOLOGY.
12. PAVEMENT STRUCTURE (MATERIAL TYPES AND THICKNESS) TO BE AS SPECIFIED IN THE GEOTECHNICAL REPORT.

1. ALL STORM SEWER MATERIALS AND CONSTRUCTION METHODS SHALL CONFORM TO THE CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS. PROVIDE CCTV INSPECTION REPORTS FOR ALL NEW STORM SEWERS, SERVICES AND CB LEADS.
2. STORM SEWERS 450mm DIAMETER AND SMALLER SHALL BE PVC SDR-35, WITH RUBBER GASKET PER CSA A-257.3.
3. STORM SEWER LARGER THAN 450mm SHALL BE REINFORCED CONCRETE CLASS 100D.
4. SEWER BEDDING AS PER CITY OF OTTAWA DETAIL S6.
5. ALL STORM MANHOLES TO BE AS PER STORM STRUCTURE TABLE.
6. ANY NEW OR EXISTING STORM SEWER WITH LESS THAN 2.0m COVER REQUIRES THERMAL INSULATION AS PER CITY OF OTTAWA STANDARD W22. OR APPROVED BY THE ENGINEER.
7. ALL CATCHBASIN LEADS TO BE MINIMUM 200mm DIAMETER AT MINIMUM 1.0% SLOPE UNLESS OTHERWISE SPECIFIED.
8. STORM CATCHBASINS AS PER OPSD 705.010 AND FRAME/COVER AS PER CITY STANDARD DRAWINGS S19. STORM CBMH'S AS INDICATED IN TABLE WITH SUMP. ADJUSTMENT SECTIONS SHALL BE AS PER OPSD 704.010.
9. INSTALLATION OF FLOW CONTROL ICD'S TO BE VERIFIED BY QUALITY VERIFICATION ENGINEER RETAINED BY CONTRACTOR.
10. PROVIDE BACKWATER VALVE ON FOUNDATION DRAIN, STORM DISCHARGE, AND OVERFLOW DISCHARGE PER S14
11. ALL CATCHBASINS EXCLUDING LANDSCAPE CATCHBASINS TO HAVE 150 MMØ PERFORATED PIPE FOR 3.0M ON ALL AVAILABLE SIDES AT AN ELEVATION OF 300mm BELOW SUBGRADE LEVEL AS PER CITY OF OTTAWA STANDARD DRAWING 'R1'

1. ALL SANITARY SEWER, SANITARY SEWER APPURTENANCES AND CONSTRUCTION METHODS SHALL CONFORM TO THE CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS. PROVIDE CCTV INSPECTION REPORTS FOR ALL NEW SANITARY PIPING.
2. SANITARY SEWER PIPE SIZE 150mm DIAMETER AND GREATER TO BE PVC SDR-35 (UNLESS SPECIFIED OTHERWISE) WITH RUBBER GASKET TYPE JOINTS IN CONFORMANCE WITH CSA B-182.2.3.4.
3. SEWER BEDDING AS PER CITY OF OTTAWA DETAIL S6.
4. ALL SANITARY MANHOLES 1200mm IN DIAMETER TO BE AS PER OPSD 701.01. FRAME AND COVER TO BE AS PER CITY OF OTTAWA STANDARD S25 AND S24.
5. MAINTENANCE HOLE BENCHING AND PIPE OPENING ALTERNATIVES AS PER THE OPSD 701.021
6. ANY SANITARY SEWER WITH LESS THAN 2.0m COVER REQUIRES THERMAL INSULATION AS PER CITY OF OTTAWA STANDARD W22, OR APPROVED BY THE ENGINEER.
7. PROVIDE BACKWATER VALVE FOR BUILDING SANITARY SERVICES PER S14.1

1. ALL WATERMAIN AND WATERMAIN APPURTENANCES, MATERIALS, CONSTRUCTION AND TESTING METHODS SHALL CONFORM TO THE CURRENT CITY OF OTTAWA AND MINISTRY OF ENVIRONMENT STANDARDS AND SPECIFICATIONS.
2. ALL WATERMAIN 300mm DIAMETER AND SMALLER TO BE POLY VINYL CHLORIDE (PVC) CLASS 150 DR 18 MEETING AWWA SPECIFICATION C900.
3. ALL WATERMAIN TO BE INSTALLED AT MINIMUM COVER OF 2.4m BELOW FINISHED GRADE. WHERE WATERMAINS CROSS OVER OTHER UTILITIES, A MINIMUM 0.30m CLEARANCE SHALL BE MAINTAINED; WHERE WATERMAINS CROSS UNDER OTHER UTILITIES, A MINIMUM 0.05m CLEARANCE SHALL BE MAINTAINED; WHERE THE MINIMUM SEPARATION CANNOT BE ACHIEVED, THE WATERMAIN SHALL BE INSTALLED AS PER CITY OF OTTAWA STANDARDS W25 AND W26.2, WHERE 2.4m MINIMUM DEPTH CANNOT BE ACHIEVED, THERMAL INSULATION SHALL BE PROVIDED AS PER CITY OF OTTAWA STANDARD W22, WHERE A WATERMAIN IS IN CLOSE PROXIMITY TO AN OPEN STRUCTURE, THERMAL INSULATION SHALL BE PROVIDED AS PER CITY OF OTTAWA STANDARD W23.
4. CONCRETE THRUST BLOCKS AND MECHANICAL RESTRAINTS ARE TO BE INSTALLED AT ALL TEES, BENDS, HYDRANTS, REDUCERS, ENDS OF MAINS AND CONNECTIONS 100mm AND LARGER, IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS W25.3 & W25.4.
5. CATHODIC PROTECTION REQUIRED FOR ALL IRON FITTINGS AS PER CITY OF OTTAWA STANDARD W40 & W42.
6. ALL VALVES AND VALVE BOXES AND CHAMBERS, HYDRANTS, AND HYDRANT VALVES AND ASSEMBLES SHALL BE INSTALLED AS PER CITY OF OTTAWA STANDARD.
7. FIRE HYDRANT LOCATION AND INSTALLATION AS PER CITY OF OTTAWA STANDARD W18 & W19. CONTRACTOR TO PROVIDE FLOW TEST AND PAINTING OF NEW HYDRANT IN ACCORDANCE WITH CITY STANDARDS.
8. IF WATER MAIN MUST BE DEFLECTED TO MEET ALIGNMENT, ENSURE THAT THE AMOUNT OF DEFLECTION USED IS LESS THAN HALF THAT RECOMMENDED BY THE MANUFACTURER.

Thickness (mm)	Material Description
40	Wear Course - Superpave 12.5 Asphaltic Concrete
50	Binder Course - Superpave 19.0 Asphaltic Concrete
150	Base - OPSS Granular A Crushed Stone
300	SUBBASE - OPSS Granular B Type II
SUBGRADE - Either approved fill, in-situ, or OPSS Granular B Type I or II material placed on in-situ soil or fill	

1. PRIOR TO START OF CONSTRUCTION:
 - 1.1. INSTALL SILT FENCE IN LOCATION SHOWN.
 - 1.2. INSTALL SILT SACK FILTERS IN ALL THE CATCHBASINS AND MANHOLES TO REMAIN DURING CONSTRUCTION WITHIN THE SITE.
 - 1.3. INSPECT MEASURES IMMEDIATELY AFTER INSTALLATION.
 - 1.4. INSTALL MUD MAT AT CONSTRUCTION ENTRANCES.
2. DURING CONSTRUCTION:
 - 2.1. MINIMIZE THE EXTENT OF DISTURBED AREAS AND THE DURATION OF EXPOSURE AND IMPACTS TO THE SOIL GRADING.
 - 2.2. PERIMETER VEGETATION TO REMAIN IN PLACE UNTIL PERMANENT STORM WATER MANAGEMENT IS IN PLACE. OTHERWISE, IMMEDIATELY INSTALL SILT FENCE WHEN THE EXISTING SITE IS DISTURBED AT THE PERIMETER.
 - 2.3. PROTECT DISTURBED AREAS FROM OVERLAND FLOW BY PROVIDING TEMPORARY SWALES TO THE SATISFACTION OF THE FIELD ENGINEER. TIE-IN TEMPORARY SWALE TO EXISTING CB'S AS REQUIRED.
 - 2.4. PROVIDE TEMPORARY COVER SUCH AS SEEDING OR MULCHING IF DISTURBED AREA WILL NOT BE REHABILITATED WITHIN 30 DAYS.
 - 2.5. INSPECT SILT FENCES, FILTER FABRIC FILTERS AND CATCH BASIN SUMPS WEEKLY AND WITHIN 24 HOURS AFTER A STORM EVENT. CLEAN AND REPAIR WHEN NECESSARY.
 - 2.6. DOWNSTREAM STORM INFRASTRUCTURE SHALL BE PROTECTED FROM UNFILTERED RUNOFF DURING ON-SITE STORM INFRASTRUCTURE DEMOLITION.
 - 2.7. DRAWING TO BE REVIEWED AND REVISED AS REQUIRED DURING CONSTRUCTION.
 - 2.8. EROSION CONTROL FENCING TO BE ALSO INSTALLED AROUND THE BASE OF ALL STOCKPILES.
 - 2.9. DO NOT LOCATE TOPSOIL, PILES AND EXCAVATION MATERIAL CLOSER THAN 2.5m FROM ANY PAVED SURFACE, OR ONE WHICH IS TO BE PAVED BEFORE THE CPILE IS REMOVED. ALL TOPSOIL PILES MUST TO BE SEEDED IF THEY ARE TO REMAIN ON SITE LONG ENOUGH FOR SEEDS TO GROW (LONGER THAN 30 DAYS).
 - 2.10. CONTROL WIND-BLOWN DUST OFF SITE BY SEEDING TOPSOIL PILES AND OTHER AREAS TEMPORARILY (PROVIDE WATERING AS REQUIRED AND TO THE SATISFACTION OF THE ENGINEER).
 - 2.11. NO ALTERNATE METHODS OF EROSION PROTECTION SHALL BE PERMITTED UNLESS APPROVED BY THE FIELD ENGINEER.
 - 2.12. CITY ROADWAY AND SIDEWALK TO BE CLEANED OF ALL SEDIMENT FROM VEHICULAR TRACKING AS REQUIRED.
 - 2.13. DURING WET CONDITIONS, TIRES OF ALL VEHICLES/EQUIPMENT LEAVING THE SITE ARE TO BE SCRAPPED.
 - 2.14. ANY MUD/MATERIAL TRACKED ONTO THE ROAD SHALL BE REMOVED IMMEDIATELY BY HAND OR RUBBER TIRE LOADER.
 - 2.15. TAKE ALL NECESSARY STEPS TO PREVENT BUILDING MATERIAL, CONSTRUCTION DEBRIS OR WASTE BEING SPILLED OR TRACKED ONTO ADJUTING PROPERTIES OR PUBLIC STREETS DURING CONSTRUCTION AND PROCEED IMMEDIATELY TO CLEAN UP ANY AREAS SO AFFECTED.
 - 2.16. ALL EROSION CONTROL STRUCTURE TO REMAIN IN PLACE UNTIL ALL DISTURBED GROUND SURFACES HAVE BEEN STABILIZED EITHER BY PAVING OR RESTORATION OF VEGETATIVE GROUND COVER.
 - 2.17. THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE, DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.

Point No.	Northing	Easting	Elev
CC #1	5029149.213	368806.860	
CC #2	5029243.952	368876.257	
CC #3	5029193.203	368705.571	65.412
CC #6	5029144.760	368623.492	66.744
CC #7	5029095.379	368579.045	67.506
CC #8	5029101.070	368549.781	67.805
CC #9	5028989.253	368641.460	69.256
CP #87	5029086.967	368960.129	64.574
CP #88	5029257.273	369021.685	64.639
CP #102	5029082.645	368877.952	65.027
CP #103	5029112.963	368813.748	
CP #104	5029110.951	368837.055	65.020
CP# 105	5029144.819	368801.911	65.107
CP #6006	5029086.150	368805.429	
CPVV #83	5028853.673	368573.563	65.326
SPK #4	5029115.901	368853.680	
SPK #85	5028866.914	368672.574	65.202
SPK #7352	5029056.087	368811.849	71.292
SPK #8928	5029145.040	368779.868	66.016
SPK #8435	5029089.179	368788.229	68.714
PKN #8838	5029023.162	368892.308	64.954
TARGET ON VAIL #7696	5028924.093	368706.883	89.744
MAG #20001	5029282.143	368911.384	65.242

	EXISTING BOTTOM OF SLOPE
	EXISTING TOP OF SLOPE
	EXISTING WATERMAIN
	EXISTING STORM SEWER
	EXISTING SANITARY SEWER
	EXISTING SWALE
	EXISTING PERFORATED DRAIN
	EXISTING FENCE
	SITE TEMPORARY CONTROL POINT
	EXISTING SANITARY MANHOLE
	EXISTING FIRE HYDRANT
	EXISTING WATER VALVE
	EXISTING ELEVATION
	EXISTING TREES TO REMAIN
	EXISTING CATCHBASIN
	EXISTING CATCHBASIN MANHOLE
	EXISTING STORM MANHOLE



	ST	STORM REMOVAL
	SA	STORM REMOVAL
	W	WATERMAIN REMOVAL
	F	FENCE REMOVAL
		FULL DEPTH ASPHALT REMOVAL
		GREEN AREA/ INTERLOCK AREA REMOVAL
		CONCRETE SIDEWALK REMOVAL
		GRAVEL ROAD REMOVAL
		RETAINING WALL REMOVAL
		CATCH BASIN REMOVAL
		STORM MANHOLE REMOVAL
		SANITARY MANHOLE REMOVAL
		FIRE HYDRANT REMOVAL
		BOLLARD REMOVAL
	LS	LIGHT STAND REMOVAL


	SEWERS BOUNDARY
W	NEW WATERMAIN
---	NEW STORM SEWER
---	NEW HDPE SUBDRAIN
SA	NEW SANITARY SEWER
---	HIGH POINT
⊕	NEW STORM CATCH BASIN MANHOLE
○	NEW STORM MANHOLE
□	NEW CATCH BASIN/ DITCH INLET
●	NEW SANITARY MANHOLE
⊙	NEW WATERMAIN VALVE
+	NEW WATERMAIN CONNECTION
~	NEW WATERMAIN 45° BEND
~	NEW SERVICING CAP
68.79	PROPOSED ELEVATION
1.6%	PROPOSED SURFACE SLOPE
→	OVER FLOW DIRECTION
	PROPOSED TRENCH DRAIN
	PROPOSED INTERLOCK
	PROPOSED ASPHALT PAVEMENT
	PROPOSED TREES
	PROPOSED GAS METER

MUD MAT

DRAINAGE AREA SYMBOL

DRAINAGE AREA BOUNDARY

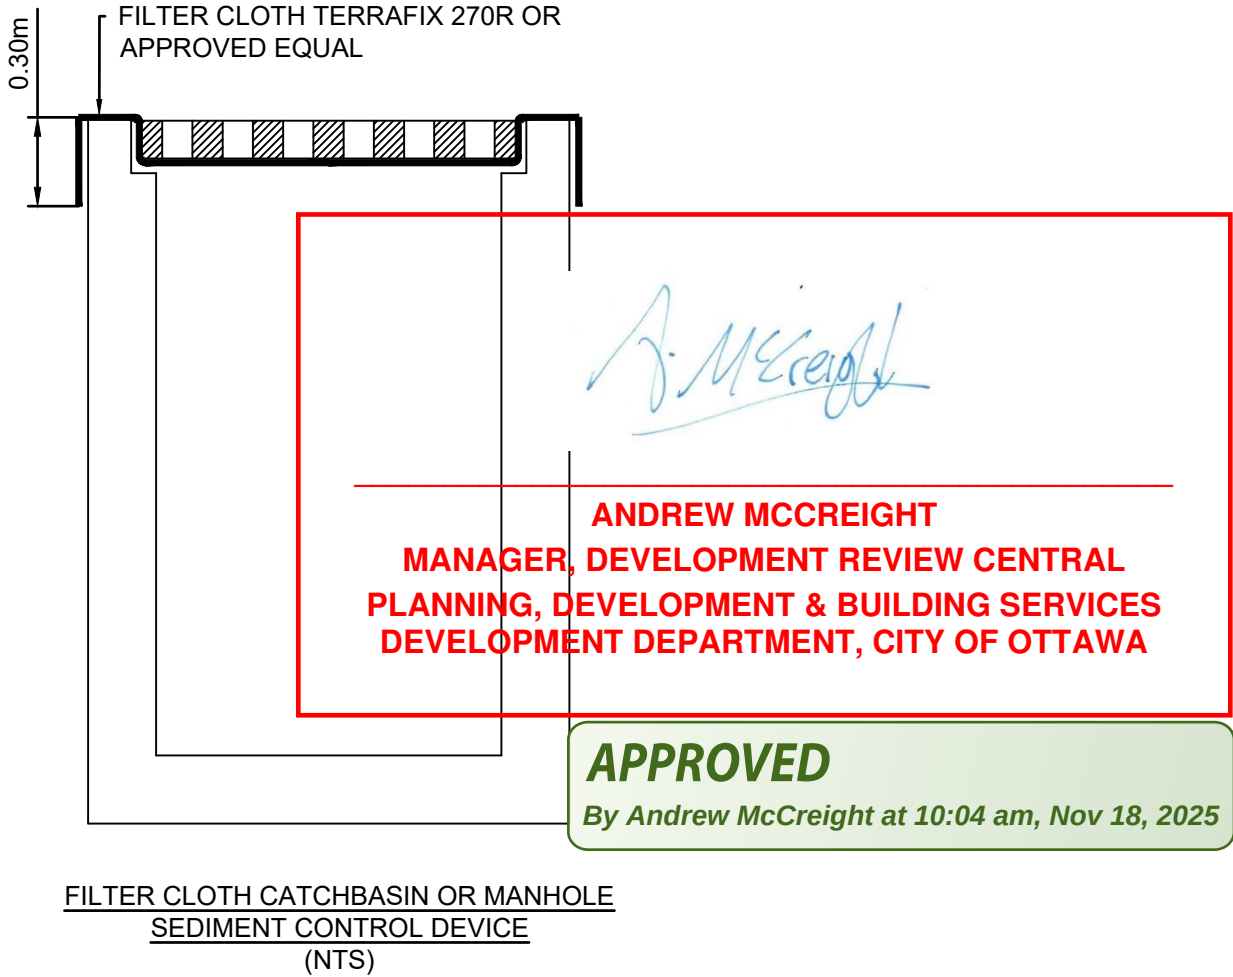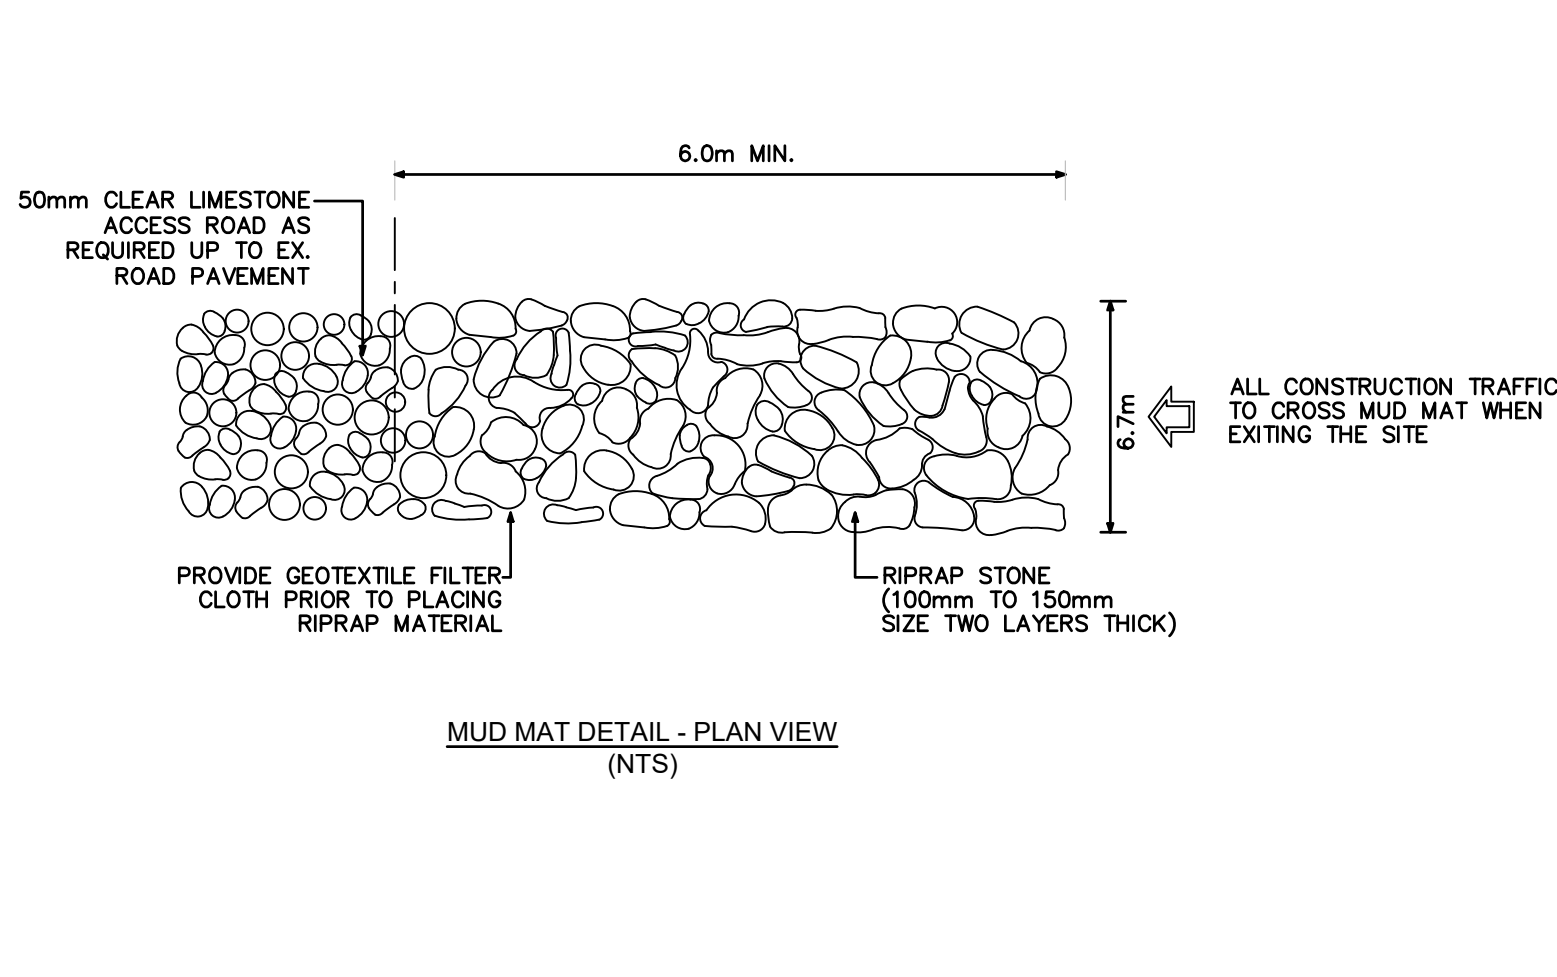

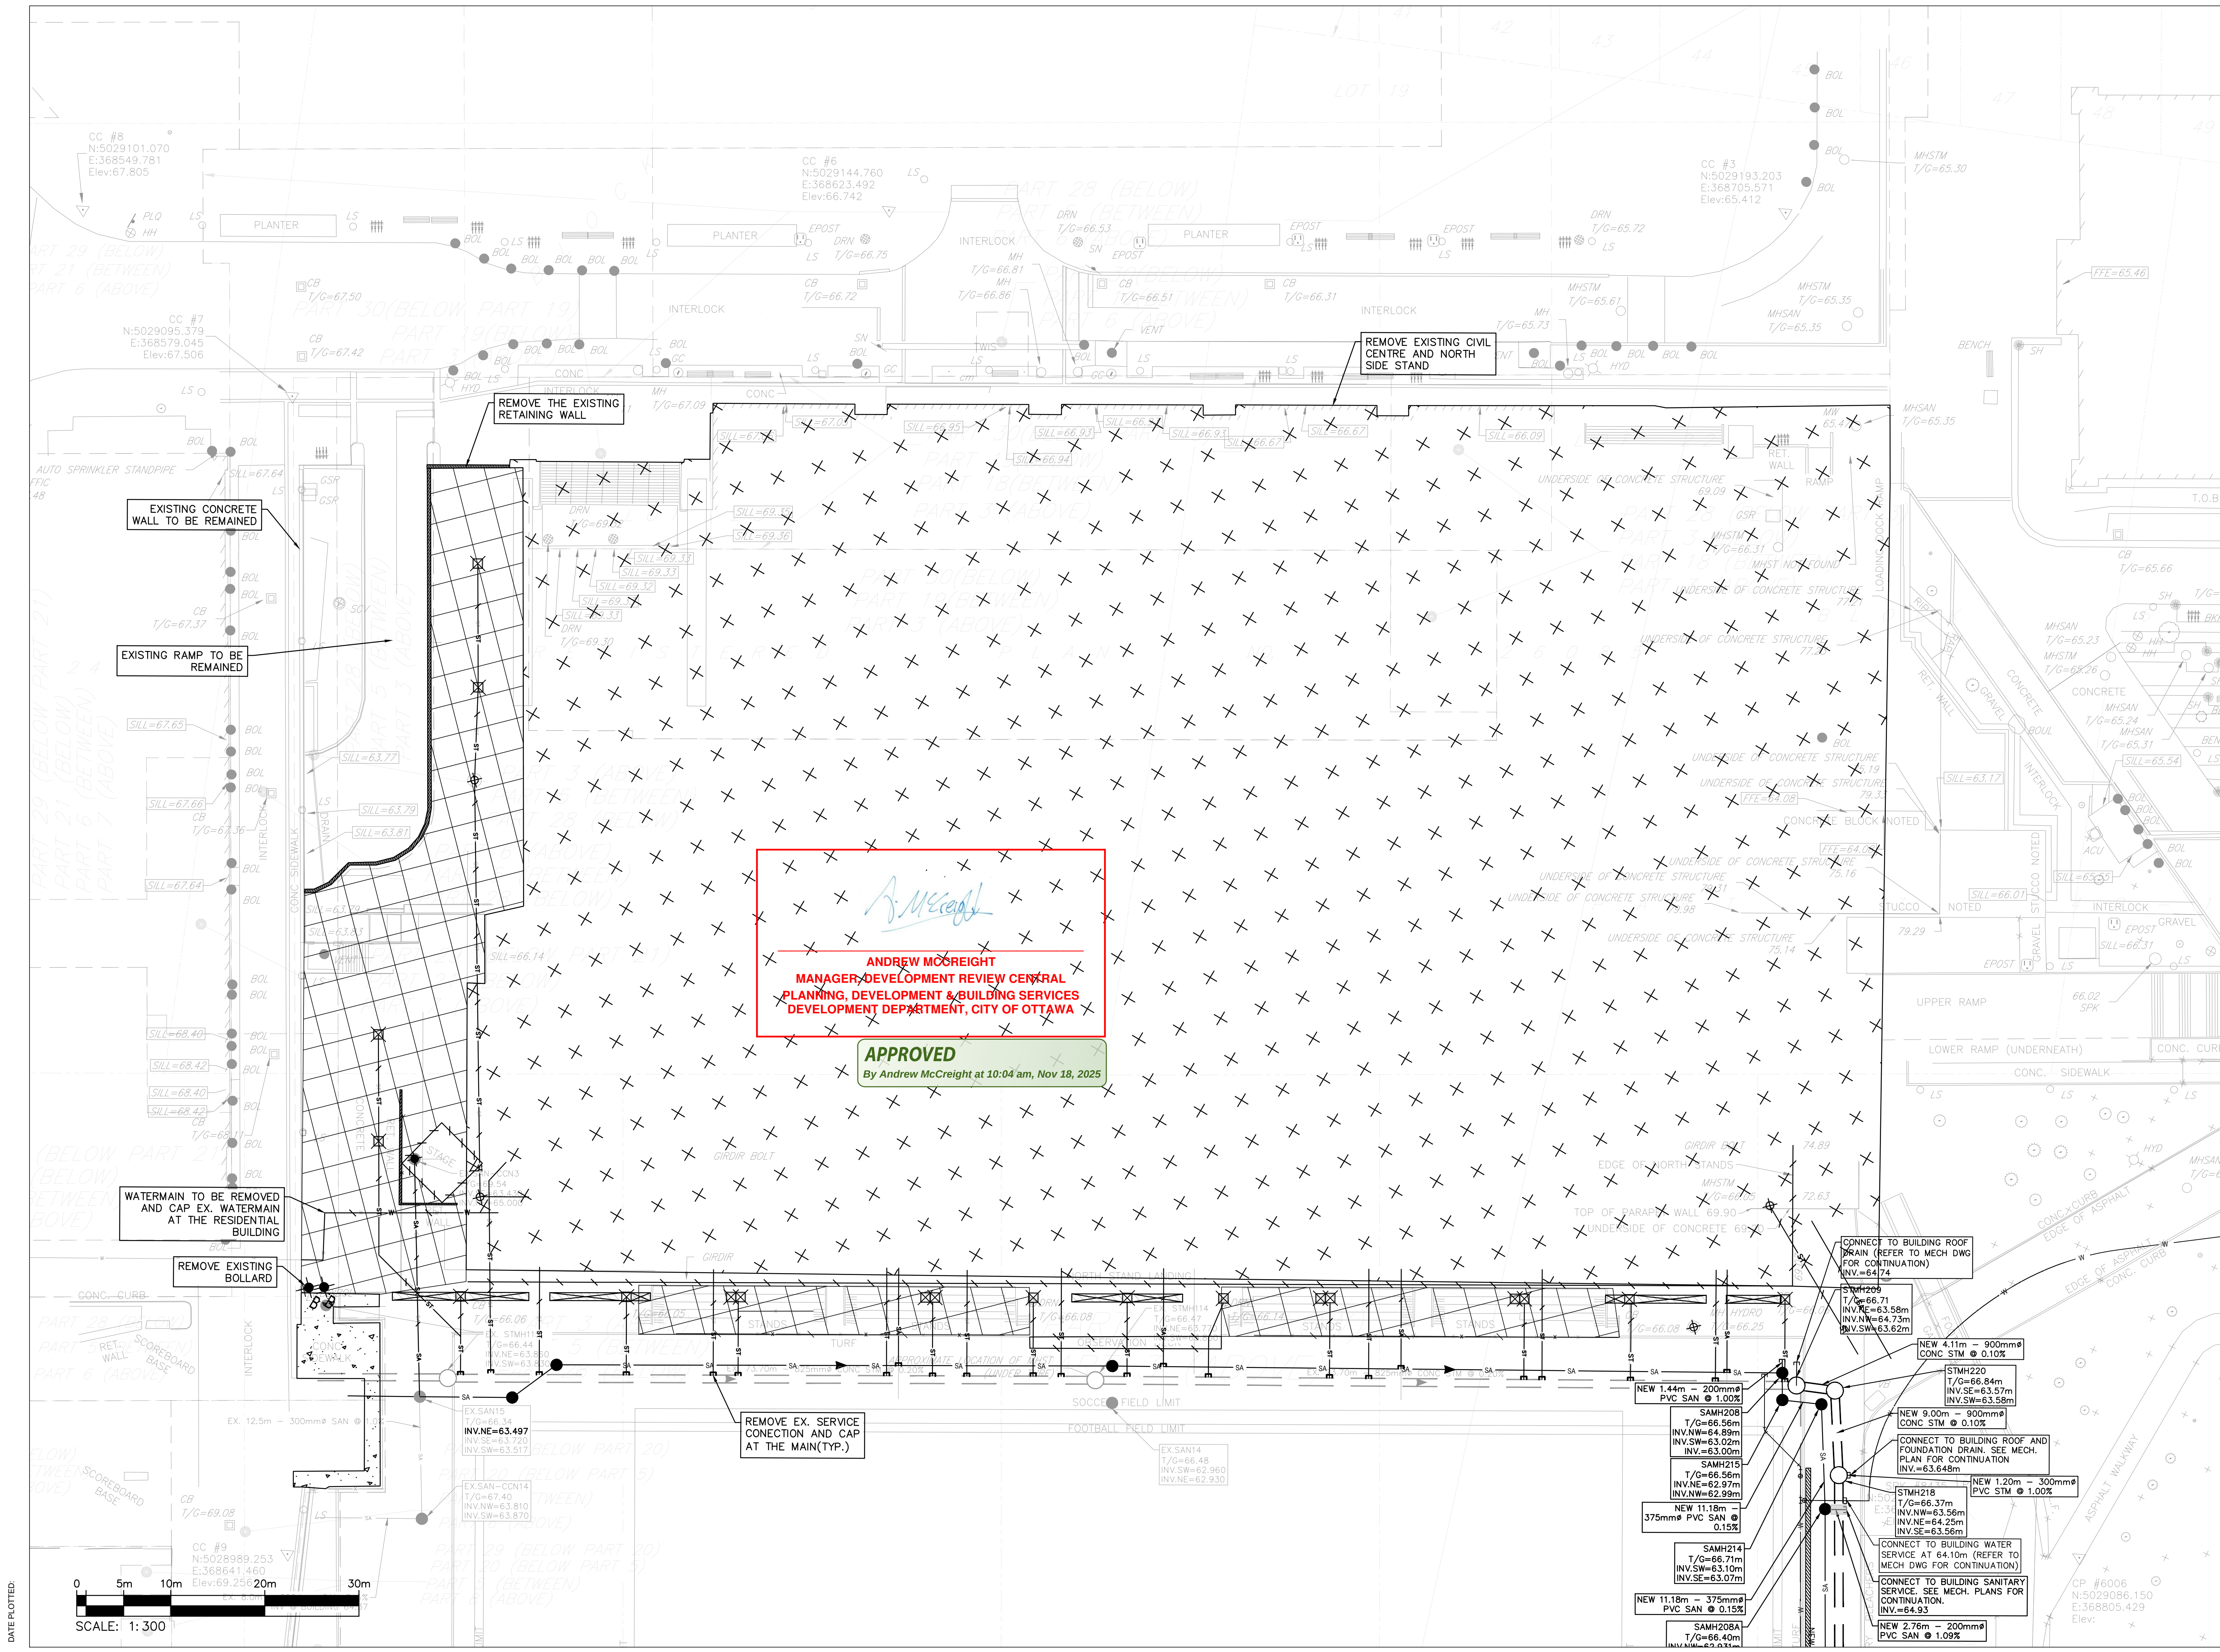

Ottawa Sports and Entertainment Group

BREIN BROOK BEYON ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999

ARCHITECT

ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274

STRUCTURAL ENGINEER

TAMP
200 KING ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000

MECH. PLUMB. FIRE PROTECTION ENGINEER

MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520

ELEC. LIGHTING ENGINEER

S2O
530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999

FOOD AND BEVERAGE

CSW
319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536

LANDSCAPE ARCHITECT

wsp
2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800

CIVIL ENGINEER

NO.	DESCRIPTION	DATE
12	REVISED PER CITY COMMENTS	2025-09-24
11	REVISED PER CITY COMMENTS	2025-09-24
10	ISSUED FOR PERMIT	2025-09-16
9	ISSUED FOR 100% CD FOR TENDER	2025-09-12
8	ISSUED FOR CD UPDATE	2025-05-09
7	ISSUED FOR CD UPDATE - CLASS A ESTIMATE	2025-04-11
6	ISSUED FOR CD UPDATE	2025-03-19
5	ISSUED FOR CD UPDATE	2025-02-28
4	REVISED PER CITY DEFICIENCY COMMENTS	2025-01-22
3	ISSUED FOR CD UPDATE	2025-01-17
2	ISSUED FOR SITE PLAN APPLICATION	2024-11-20
1	ISSUED FOR URP	2024-11-19

REVISIONS/ ISSUES	
CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK. DO NOT SCALE THE DRAWINGS	

SEAL

PROFESSIONAL ENGINEER
D. B. YANG
100230566
2025-09-24
PROVINCE OF ONTARIO

NOT FOR CONSTRUCTION

DRAWN J.T.
DATE 2025/09/24
CHECKED W.Y.

LANDSDOWNE NSS


DWG. TITLE	
REMOVAL PLAN	

SCALE	DWG. NO.
1:300	C02

PROJ. NO.	
CA0043476.7969	

DATE PLOTTED:

D07-12-24-0178

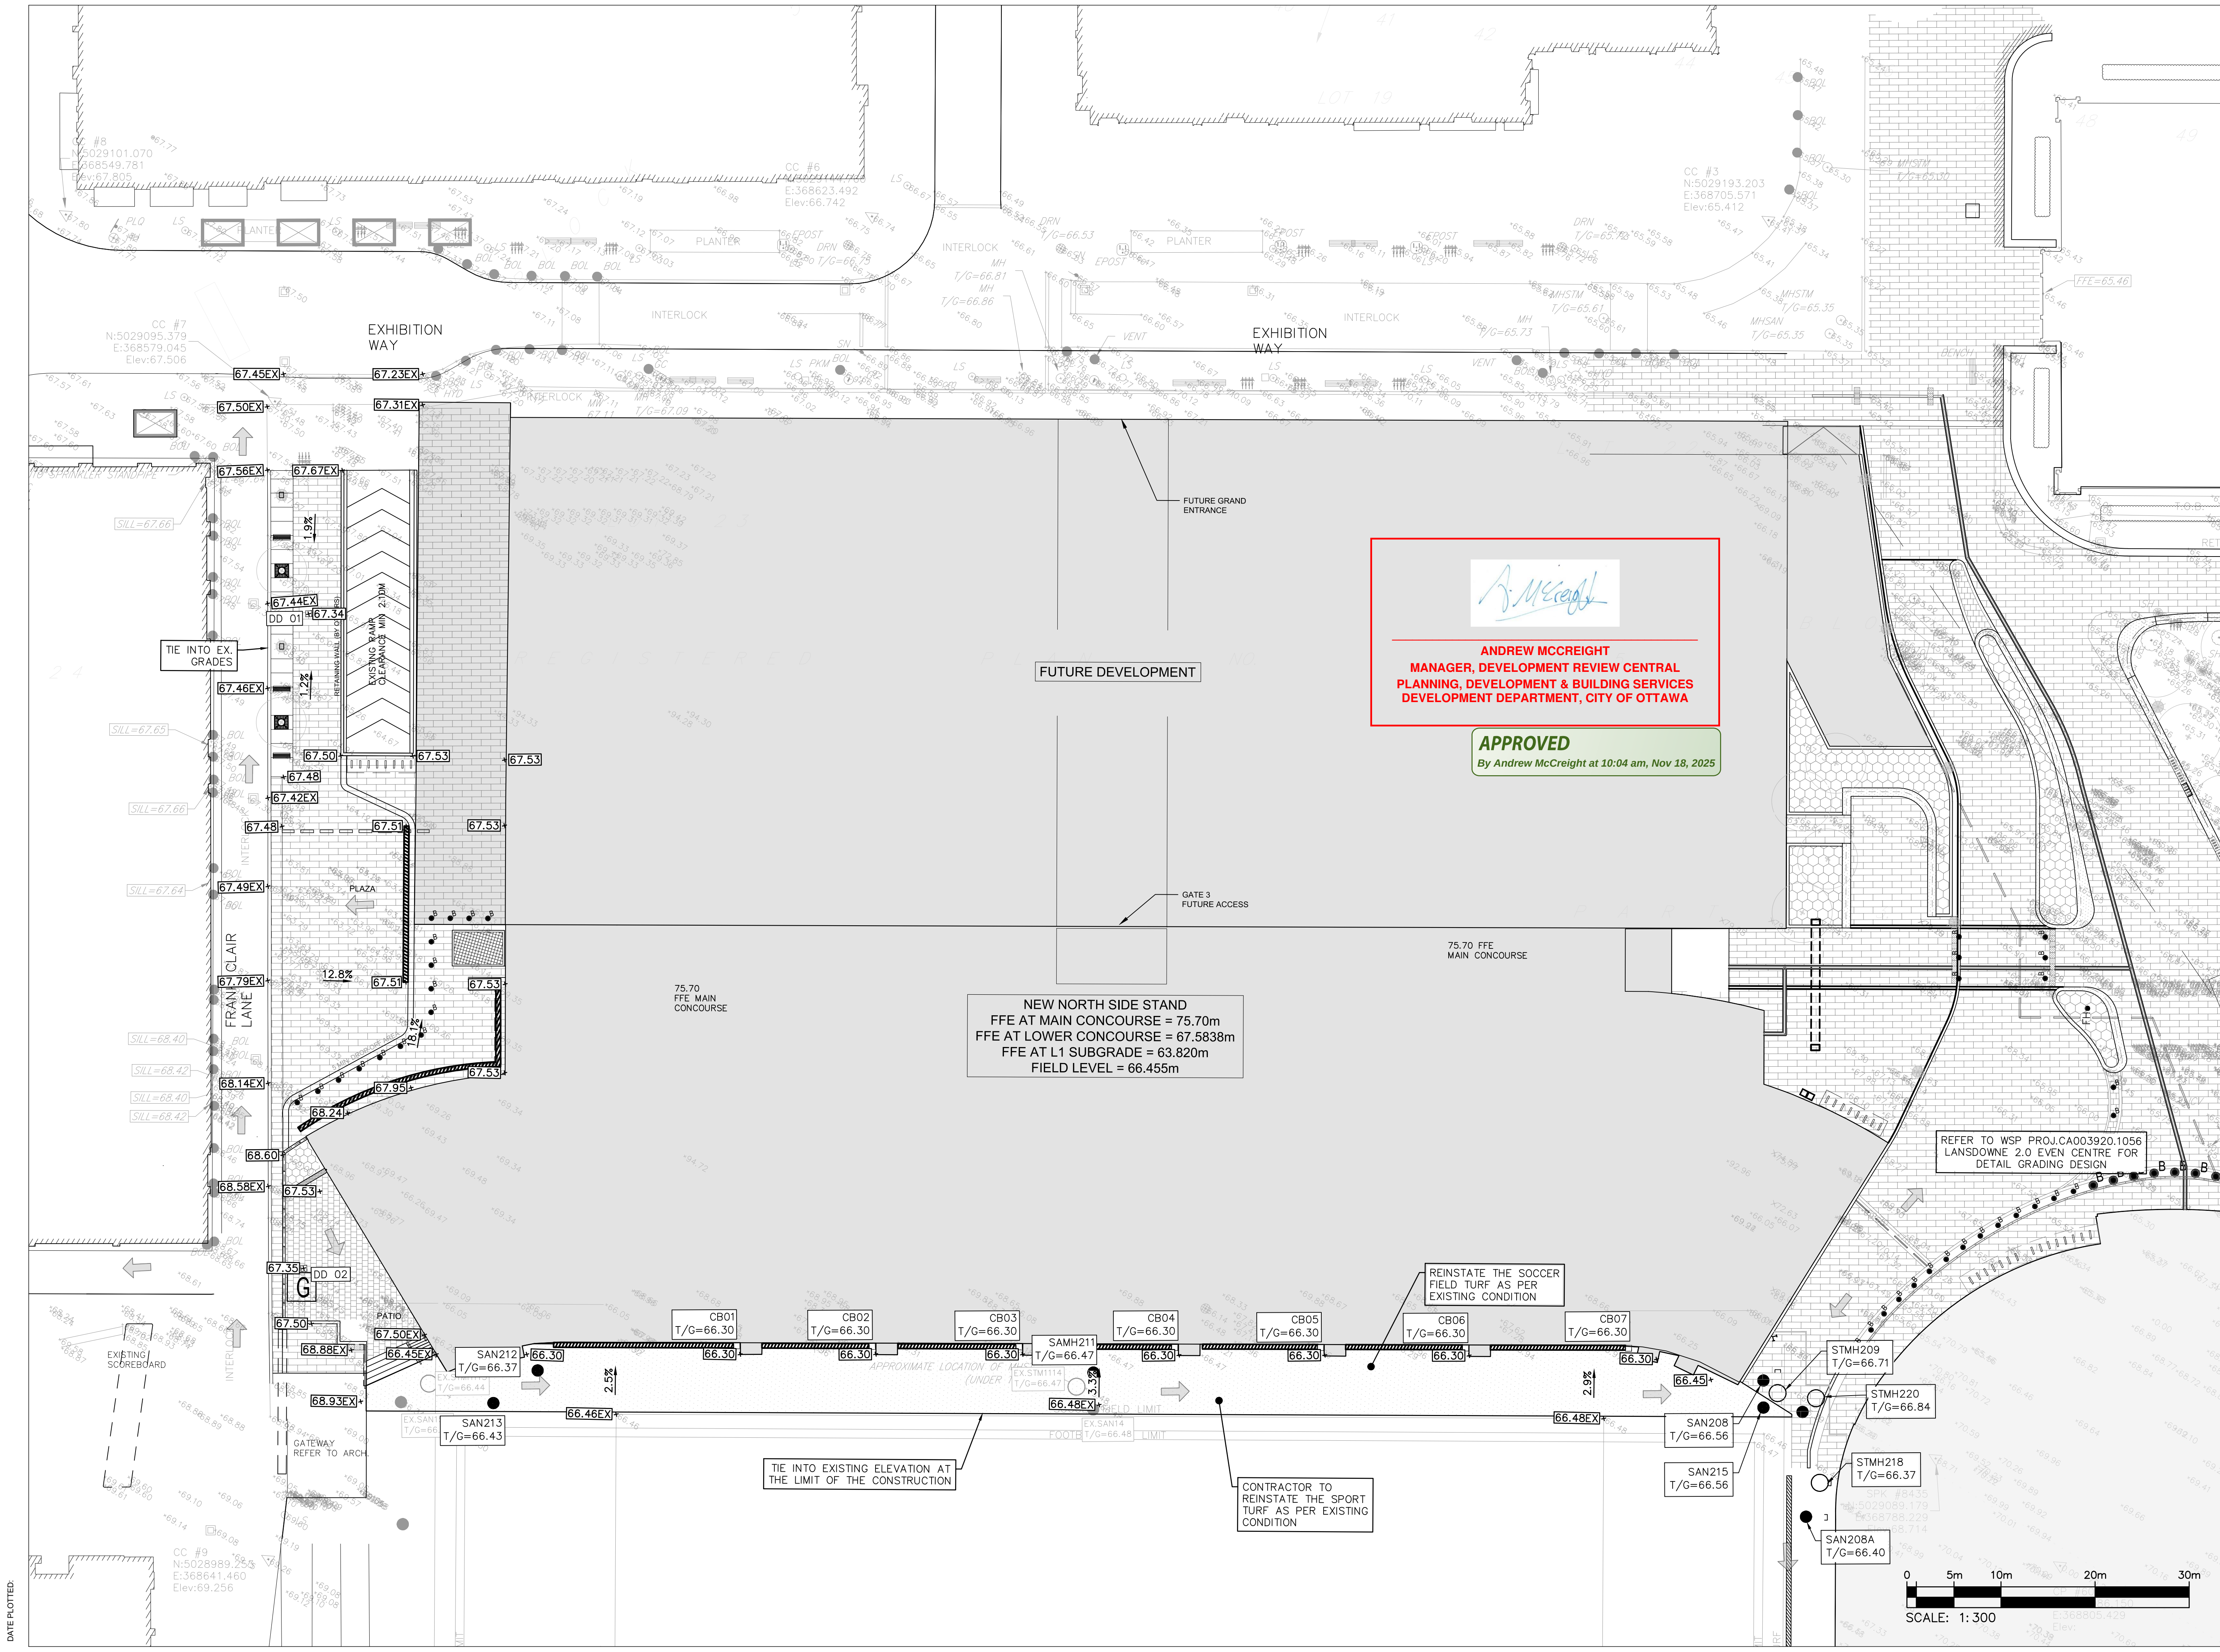

ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
By Andrew McCreight at 10:04 am, Nov 18, 2025

NEW NORTH SIDE STAND
FFE AT MAIN CONCOURSE = 75.70m
FFE AT LOWER CONCOURSE = 67.5838m
FFE AT L1 SUBGRADE = 63.820m
FIELD LEVEL = 66.455m

REFER TO WSP PROJ.CA003920.1056
LANDSOWNE 2.0 EVEN CENTRE FOR
DETAIL GRADING DESIGN

REINSTATE THE SOCCER
FIELD TURF AS PER
EXISTING CONDITION

TIE INTO EXISTING ELEVATION AT
THE LIMIT OF THE CONSTRUCTION

CONTRACTOR TO
REINSTATE THE SPORT
TURF AS PER EXISTING
CONDITION

BRISBROOK BEYOND ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999
ARCHITECT

ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274
STRUCTURAL ENGINEER

TAMP
200 KING ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH. PLUMB. FIRE PROTECTION ENGINEER

MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELEC. LIGHTING ENGINEER

S2O
530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999
FOOD AND BEVERAGE

CSW
319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE ARCHITECT

wsp
2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800
CIVIL ENGINEER

NO	DESCRIPTION	DATE
12	REVISED PER CITY COMMENTS	2025-09-24
11	REVISED PER CITY COMMENTS	2025-08-20
10	ISSUED FOR PERMIT	2025-06-16
9	ISSUED FOR 10% CD FOR TENDER	2025-06-12
8	ISSUED FOR CD UPDATE	2025-05-09
7	ISSUED FOR CD UPDATE - CLASS A ESTIMATE	2025-04-11
6	ISSUED FOR CD UPDATE	2025-03-19
5	ISSUED FOR CD UPDATE	2025-02-28
4	REVISED PER CITY DEFICIENCY COMMENTS	2025-01-32
3	ISSUED FOR CD UPDATE	2024-11-17
2	ISSUED FOR SITE PLAN APPLICATION	2024-11-20
1	ISSUED FOR UDRP	2024-11-19

REVISIONS/ ISSUES
CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS
AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE
ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS

SEAL

D. B. YANG
100230568
2025-09-24
PROVINCE OF ONTARIO

NOT FOR CONSTRUCTION

DRAWN **J.T**
DATE **2025/09/24**
CHECKED **W.Y**

LANDSOWNE NSS

DWG. TITLE
GRADING PLAN


SCALE
1:300
PROJ. NO.
CA0043476.7969

DWG. NO.
C03

DATE PLOTTED

0 5m 10m 20m 30m
SCALE: 1:300

D07-12-24-0178
#19220

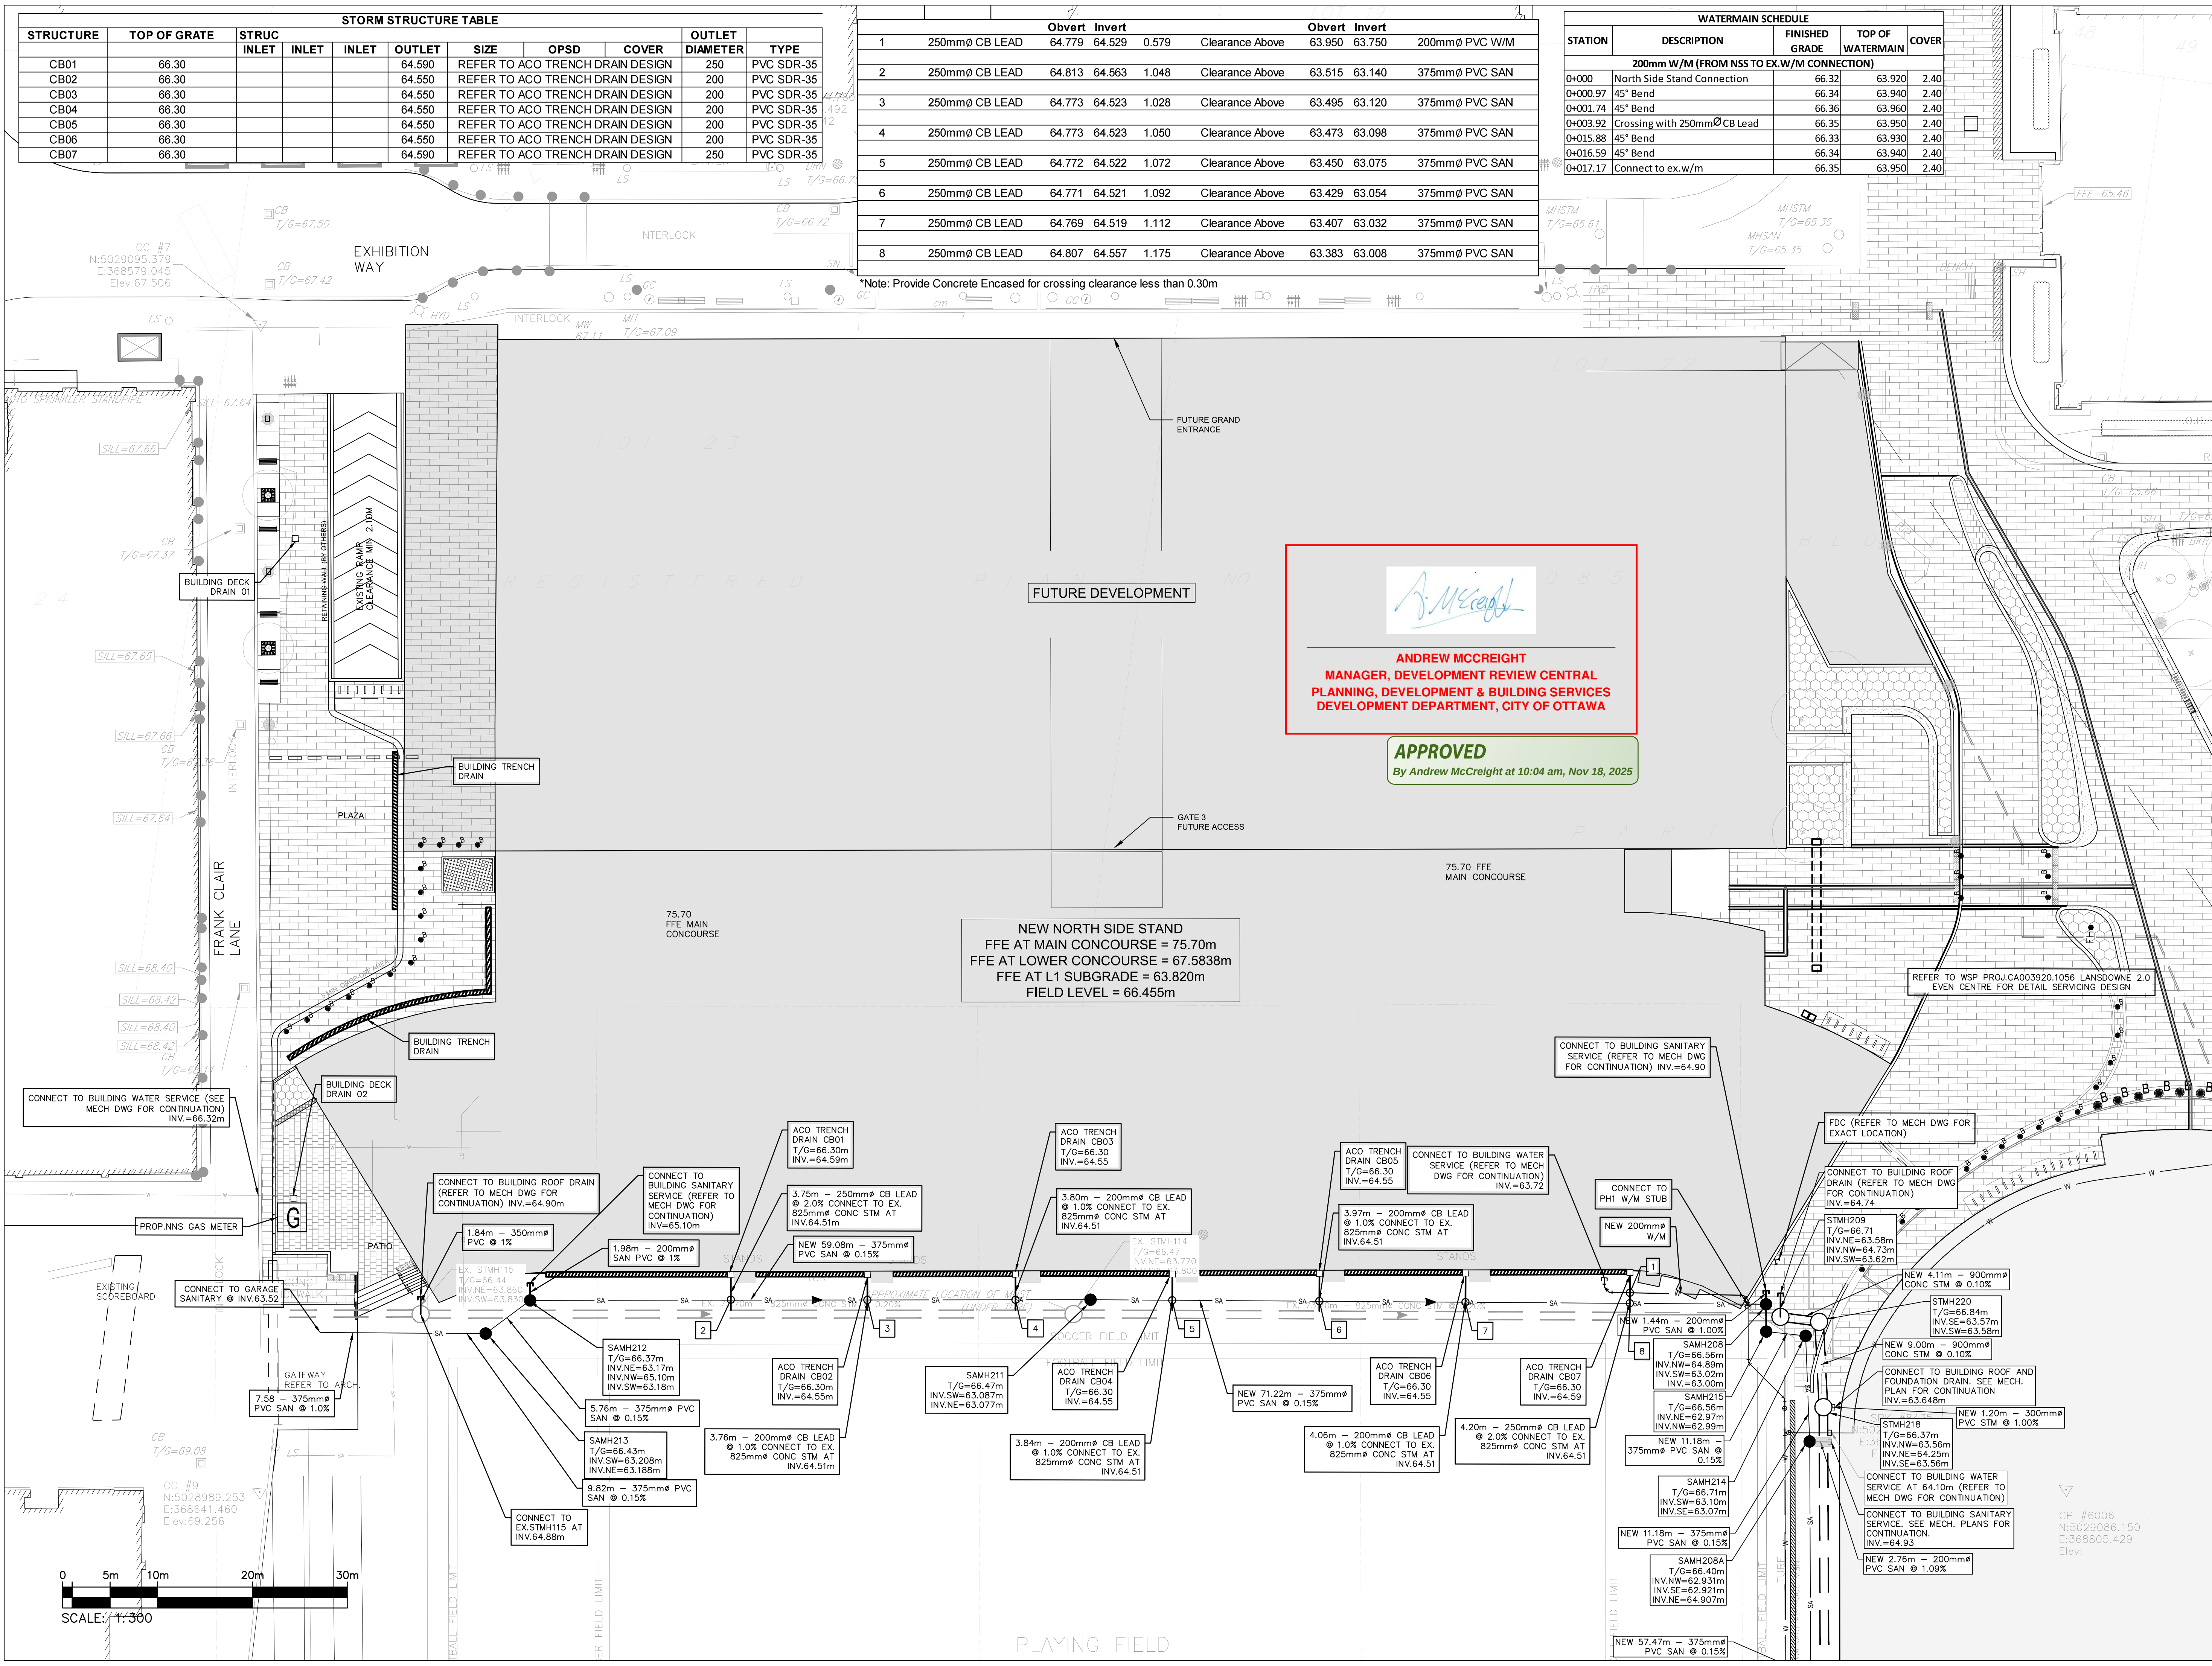

STORM STRUCTURE TABLE									
STRUCTURE	TOP OF GRATE	STRUC INLET	INLET	INLET	OUTLET	SIZE	OPSD	COVER	OUTLET DIAMETER
CB01	66.30				64.590	REFER TO ACO TRENCH DRAIN DESIGN			250
CB02	66.30				64.550	REFER TO ACO TRENCH DRAIN DESIGN			200
CB03	66.30				64.550	REFER TO ACO TRENCH DRAIN DESIGN			200
CB04	66.30				64.550	REFER TO ACO TRENCH DRAIN DESIGN			200
CB05	66.30				64.550	REFER TO ACO TRENCH DRAIN DESIGN			200
CB06	66.30				64.550	REFER TO ACO TRENCH DRAIN DESIGN			200
CB07	66.30				64.590	REFER TO ACO TRENCH DRAIN DESIGN			250

Obvert				Invert				Obvert				Invert			
1	250mmØ CB LEAD	64.779	64.529	0.579	Clearance Above	63.950	63.750	200mmØ PVC W/M							
2	250mmØ CB LEAD	64.813	64.563	1.048	Clearance Above	63.515	63.140	375mmØ PVC SAN							
3	250mmØ CB LEAD	64.773	64.523	1.028	Clearance Above	63.495	63.120	375mmØ PVC SAN							
4	250mmØ CB LEAD	64.773	64.523	1.050	Clearance Above	63.473	63.098	375mmØ PVC SAN							
5	250mmØ CB LEAD	64.772	64.522	1.072	Clearance Above	63.450	63.075	375mmØ PVC SAN							
6	250mmØ CB LEAD	64.771	64.521	1.092	Clearance Above	63.429	63.054	375mmØ PVC SAN							
7	250mmØ CB LEAD	64.769	64.519	1.112	Clearance Above	63.407	63.032	375mmØ PVC SAN							
8	250mmØ CB LEAD	64.807	64.557	1.175	Clearance Above	63.383	63.008	375mmØ PVC SAN							

WATERMAIN SCHEDULE				
STATION	DESCRIPTION	FINISHED GRADE	TOP OF WATERMAIN	COVER
200mm W/M (FROM NSS TO EX. W/M CONNECTION)				
0+000	North Side Stand Connection	66.32	63.920	2.40
0+000.97	45° Bend	66.34	63.940	2.40
0+001.74	45° Bend	66.36	63.960	2.40
0+003.92	Crossing with 250mmØ CB Lead	66.35	63.950	2.40
0+015.88	45° Bend	66.33	63.930	2.40
0+016.59	45° Bend	66.34	63.940	2.40
0+017.17	Connect to ex. w/m	66.35	63.950	2.40

ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
By Andrew McCreight at 10:04 am, Nov 18, 2025

135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274

200 KING ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000

90 SHEPPARD AVE. EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520

530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999

319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536

2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800

2025-09-24
2025-08-20
2025-08-16
2025-08-12
2025-05-09
2025-04-11
2025-03-19
2025-02-28
2025-01-22
2025-01-17
2024-11-20
2024-11-19

12 REVISED PER CITY COMMENTS
11 REVISED PER CITY COMMENTS
10 ISSUED FOR PERMIT
9 ISSUED FOR 10% CD FOR TENDER
8 ISSUED FOR CD UPDATE
7 ISSUED FOR CD UPDATE - CLASS A ESTIMATE
6 ISSUED FOR CD UPDATE
5 ISSUED FOR CD UPDATE
4 REVISED PER CITY DEFICIENCY COMMENTS
3 ISSUED FOR CD UPDATE
2 ISSUED FOR SITE PLAN APPLICATION
1 ISSUED FOR LDRP

NO DESCRIPTION DATE

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK. DO NOT SCALE THE DRAWINGS

NOT FOR CONSTRUCTION

DRAWN J.T
DATE 2025/09/24
CHECKED W.Y

NORTH

LANSDOWNE NSS

DWG. TITLE

SERVICING PLAN


SCALE 1:300

PROJ. NO. CA0043476.7969

DWG. NO. C04

DATE PLOTTED

D07-12-24-0178

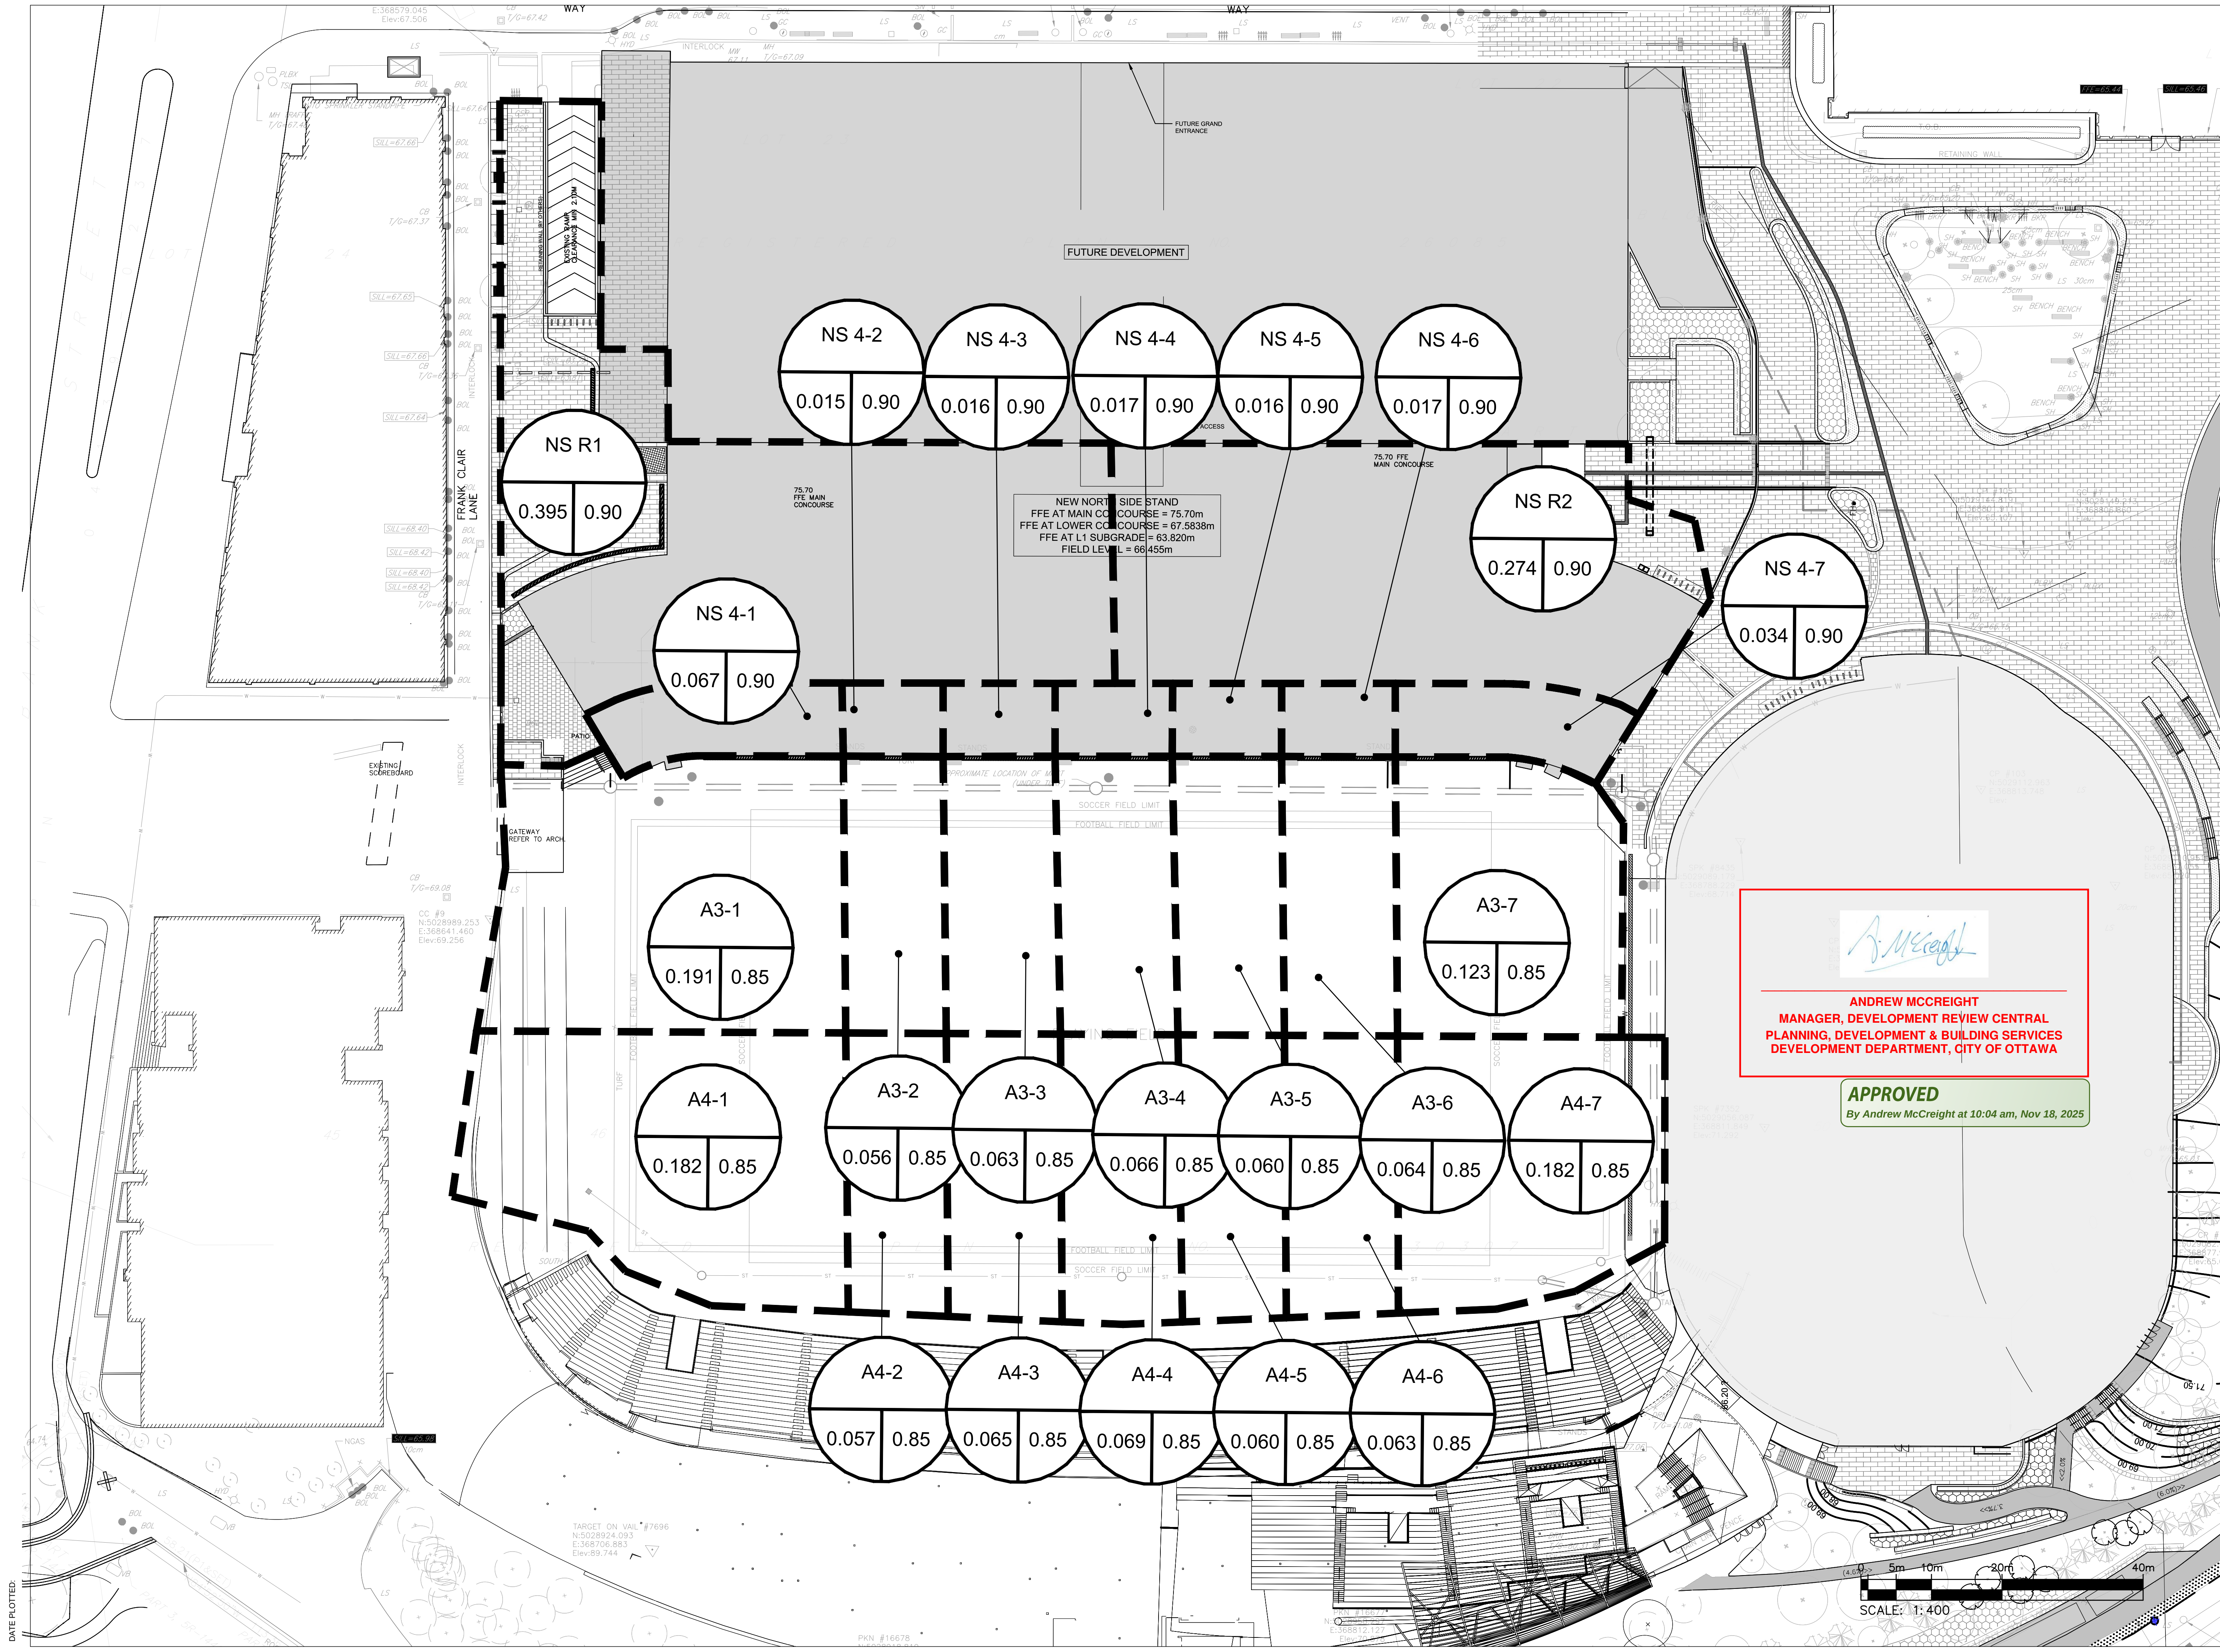

Andrew McCreight

ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
By Andrew McCreight at 10:04 am, Nov 18, 2025

Ottawa Sports and Entertainment Group

BREXID BROOK BEYON ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999

ARCHITECT

ENTUITIVE

135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274

STRUCTURAL ENGINEER

TAMP

200 KING ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000

MECH. PLUMB. FIRE PROTECTION ENGINEER

MULVEY & BANANI

90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520

ELEC. LIGHTING ENGINEER

S2O

530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999

FOOD AND BEVERAGE

CSW

319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536

LANDSCAPE ARCHITECT

wsp

2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800

CIVIL ENGINEER

NO.	DESCRIPTION	DATE
12	REVISED PER CITY COMMENTS	2025-09-24
11	REVISED PER CITY COMMENTS	2025-08-20
10	ISSUED FOR PERMIT	2025-06-16
9	ISSUED FOR 100% CD FOR TENDER	2025-06-12
8	ISSUED FOR CD UPDATE	2025-05-09
7	ISSUED FOR CD UPDATE - CLASS A ESTIMATE	2025-04-11
6	ISSUED FOR CD UPDATE	2025-03-19
5	ISSUED FOR CD UPDATE	2025-02-28
4	REVISED PER CITY DEFICIENCY COMMENTS	2025-01-22
3	ISSUED FOR CD UPDATE	2025-01-17
2	ISSUED FOR SITE PLAN APPLICATION	2024-11-20
1	ISSUED FOR IDRP	2024-11-19

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK. DO NOT SCALE THE DRAWINGS

SEAL

LICENCED PROFESSIONAL ENGINEER
D. B. Yang
D. B. YANG
100230568
2025-09-24
PROVINCE OF ONTARIO

NOT FOR CONSTRUCTION

DRAWN **J.T**

DATE **2025/09/24**

CHECKED **W.Y**

LANDSDOWNE NSS

DWG. TITLE

POST DRAINAGE AREA PLAN

SCALE **1:400** DWG. NO. **C06**

PROJ. NO. **CA0043476.7969**