



REPORT

NOISE IMPACT STUDY

ÉCOLE ÉLÉMENTAIRE LEITRIM

Submitted to:


CONSEIL DES ÉCOLES PUBLIQUES DE L'EST DE L'ONTARIO

Submitted by:

WSP Canada Inc.

CA0040067.4396

2025-02-26

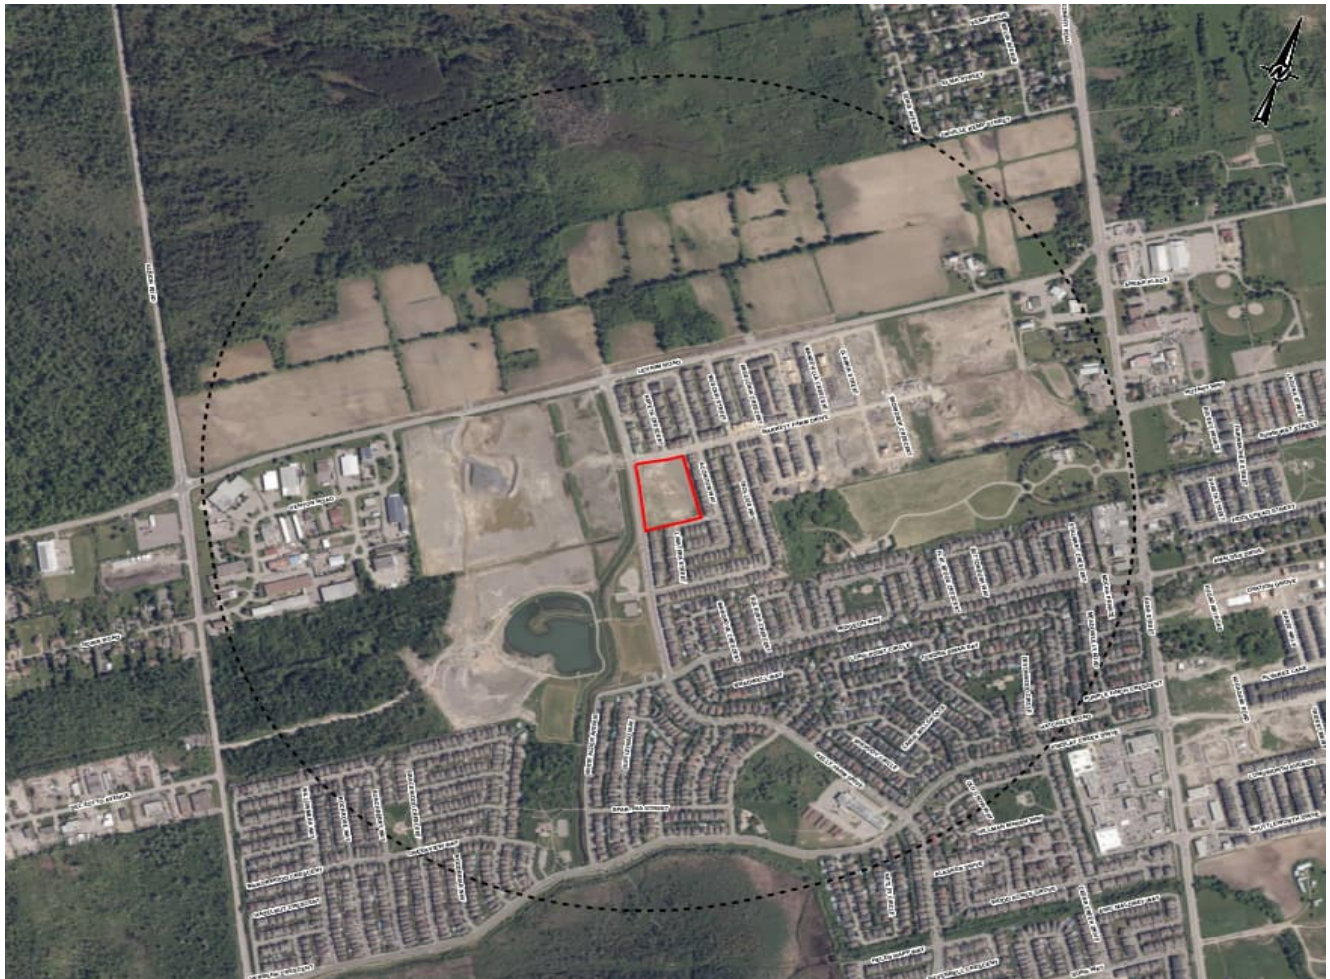

SIGNATURES

PREPARED BY



Zane Charran, M.Esc., EIT
Acoustics, Noise and Vibration Specialist

2025-02-26

Date

REVIEWED BY



Megan Beauchamp, B.Eng., EIT
Acoustics, Noise and Vibration Specialist

2025-02-26

Date

APPROVED BY



Kana Ganesh, M.Sc., PhD, P.Eng.
Sr. Acoustics, Noise and Vibration Engineer

2025-02-26

Date



Record of Issue

Version	Title	Date Issued	Notes/Comments
1.0	Noise Impact Study - École Élémentaire Leitrim	February 26, 2025	Final

Executive Summary

WSP Canada Inc. was retained by Conseil des Écoles Publiques de L'est de L'Ontario (CEPEO) to complete a Noise Impact Study in support of a Site Plan Approval application (SPA) for the proposed École Élémentaire Leitrim development to be located at the corner of Kelly Farm Drive and Barrett Farm Drive in Ottawa, Ontario (the Site/School). The proposed school consists of a main L-shaped building with a one-storey wing and a two-story wing. In addition, the Site will also include separate portable classrooms, sports field, sports court, outdoor play areas and classroom.

The purpose of the study is to assess the potential noise effects of the environment onto the School and assess the potential noise impact of the proposed stationary noise sources at the Site on surrounding noise-sensitive areas. This report is based on the Site Plan, prepared by Architecture 49 Inc. (A49), dated February 25th, 2025 (“Issued for Site Plan Control Submission”).

The assessment was conducted in accordance with the City of Ottawa guideline, Environmental Noise Control Guidelines (ENCG) and the Ministry of Environment, Parks and Conservation’s (MECP’s) Publication NPC-300, Environmental Noise Guideline Stationary and Transportation Sources – Approval and Planning (NPC-300). The acceptable levels of road and air traffic noise impacting noise-sensitive institutional developments are discussed in Section “Part C – Land Use Planning” of NPC-300 as well as Section 2 and 4 of the ENCG.

The source of noise in the vicinity of the proposed development is traffic from Kelly Farm Drive, which is classified as future collector road. The introduced stationary sources of noise by the School are rooftop HVAC equipment and car movements for child pick-up and drop-off.

The evaluated potential noise impact of transportation sources on the Site, and stationary sources associated with the Site on nearby residential uses and onto the School itself. The predicted sound levels were assessed as per the MECP Publication NPC-300 and ENCG requirements to determine that the Site will comply with the applicable noise guidelines without additional noise control measures. Additionally, exterior wall, door, and window construction meeting the minimum requirements of the Ontario Building Code (OBC), will be adequate to meet the indoor sound level limits.

Study Limitations

WSP Canada Inc. (WSP) prepared this report solely for the use of the intended recipient, Conseil des Écoles Publiques de L'est de L'Ontario, in accordance with the professional services agreement between the parties. In the event a contract has not been executed, the parties agree that the WSP General Terms for Consultant shall govern their business relationship which was provided to you prior to the preparation of this report.

The report is intended to be used in its entirety. No excerpts may be taken to be representative of the findings in the assessment.

The conclusions presented in this report are based on work performed by trained, professional and technical staff, in accordance with their reasonable interpretation of current and accepted engineering and scientific practices at the time the work was performed.

The content and opinions contained in the present report are based on the observations and/or information available to WSP at the time of preparation, using investigation techniques and engineering analysis methods consistent with those ordinarily exercised by WSP and other engineering/scientific practitioners working under similar conditions, and subject to the same time, financial and physical constraints applicable to this project.

WSP disclaims any obligation to update this report if, after the date of this report, any conditions appear to differ significantly from those presented in this report; however, WSP reserves the right to amend or supplement this report based on additional information, documentation or evidence.

WSP makes no other representations whatsoever concerning the legal significance of its findings.

The intended recipient is solely responsible for the disclosure of any information contained in this report. If a third party makes use of, relies on, or makes decisions in accordance with this report, said third party is solely responsible for such use, reliance or decisions. WSP does not accept responsibility for damages, if any, suffered by any third party as a result of decisions made or actions taken by said third party based on this report.

WSP has provided services to the intended recipient in accordance with the professional services agreement between the parties and in a manner consistent with that degree of care, skill and diligence normally provided by members of the same profession performing the same or comparable services in respect of projects of a similar nature in similar circumstances. It is understood and agreed by WSP and the recipient of this report that WSP provides no warranty, express or implied, of any kind. Without limiting the generality of the foregoing, it is agreed and understood by WSP and the recipient of this report that WSP makes no representation or warranty whatsoever as to the sufficiency of its scope of work for the purpose sought by the recipient of this report.

In preparing this report, WSP has relied in good faith on information provided by others, as noted in the report. WSP has reasonably assumed that the information provided is correct and WSP is not responsible for the accuracy or completeness of such information.

Benchmark and elevations used in this report are primarily to establish relative elevation differences between the specific testing and/or sampling locations and should not be used for other purposes, such as grading, excavating, construction, planning, development, etc.

The original of this digital file will be kept by WSP for a period of not less than 10 years. As the digital file transmitted to the intended recipient is no longer under the control of WSP, its integrity cannot be assured. As such, WSP does not guarantee any modifications made to this digital file subsequent to its transmission to the intended recipient.

This limitations statement is considered an integral part of this report.

Table of Contents

1	INTRODUCTION	7
1.1	The Site and Surrounding Area	7
1.2	The Proposed Development	7
2	NOISE IMPACT ASSESSMENT CRITERIA.....	8
2.1	Transportation Sources and Assessment Criteria	8
2.1.1	Aircraft Sources.....	8
2.1.2	Surface Transportation Noise Sources	8
2.1.2.1	Road Sources Assessment Criteria	9
2.1.2.2	Building Component Requirements	9
2.1.2.3	Ventilation Requirements.....	9
2.2	Stationary Sources and Assessment Criteria	10
3	NOISE IMPACT ASSESSMENT	11
3.1	Transportation Noise	11
3.1.1	Road Traffic Data	11
3.1.2	Analysis Method.....	11
3.1.3	Results.....	11
3.1.4	Recommendations	12
3.2	Stationary Noise.....	12
3.2.1	Onsite Noise Sources.....	12
3.2.2	Receptors	13
3.2.3	Results.....	13
3.2.3.1	Impacts of the Proposed Development Onto Itself	13
3.2.3.2	Impacts of the Proposed Development Onto the Surrounding Environment.....	14
	RECOMMENDATIONS AND CONCLUSIONS	16
4.1	Conclusions	16
4.2	Recommendations	16

TABLES

Table 2-1	ENCG & NPC-300 Road Traffic Indoor Sound Level Criteria for Schools	9
Table 2-2	Building Requirements for Indoor Spaces	9
Table 2-3	Noise Control and Warning Clause Requirements	10
Table 2-4	MECP's Exclusion Limits in dBA	10
Table 3-1	Summary of Road Traffic Data Used in the Transportation Noise Analysis	11
Table 3-2	Summary of Predicted Sound Levels due to Road Traffic	12
Table 3-3	Proposed Stationary Source Sound Data	13
Table 3-4	Summary of Predicted Sound Levels at the Site due to the Proposed Stationary Sources	13
Table 3-5	Summary of Predicted Sound Levels at the Surrounding Noise Sensitive Land Uses due to the Proposed Stationary Sources	14
Table 4-1	Summary of Building Requirements	16

FIGURES

Figure 1: Site and Surrounding	18
Figure 2: Zoning Map	19
Figure 3: Site Location in Relation to the Airports NEF/NEP Contour Map	20
Figure 4: Site Plan Showing Prediction Locations & Road Sources (Transportation Noise Impacts)	21
Figure 5: Site Plan Showing Onsite Stationary Sources & Receptor Locations (Stationary Noise Impacts Offsite)	22

APPENDICES

APPENDIX A – SITE PLAN

APPENDIX B – TRAFFIC DATA (ENCG)

APPENDIX C – STAMSON VALIDATION

APPENDIX A – CADNA/A OUTPUT

1 INTRODUCTION

WSP Canada Inc. (WSP) was retained by Conseil des Écoles Publiques de L'est de L'Ontario (CEPEO), to complete a Noise Impact Study (NIS) for the proposed École Élémentaire Leitrim development. The planned elementary school location is southeast of the corner of Kelly Farm Drive and Barrett Farm Drive in Ottawa, Ontario (the Site/School). This report was prepared in support of the Site Plan Approval application (SPA) submission.

The purpose of the NIS is to assess the potential noise impacts of both the environment onto the School from the nearby transportation sources (i.e., Kelly Farm Drive), and proposed stationary sources introduced by the School onto surrounding noise-sensitive areas, as well as onto the School itself.

The applicable noise guidelines, findings and recommendations are included within this report.

1.1 The Site and Surrounding Area

The Site/Site is bounded by:

- To the north, Barrett Farm Drive;
- To the south, residential homes;
- To the east, residential homes; and,
- To the west, Kelly Farm Drive.

The proposed Site is surrounded mostly by residential land uses. The location of the Site is shown in **Figure 1**. A zoning map showing the land use surrounding the proposed development obtained from the City of Ottawa is provided in **Figure 2**. The Site is zoned “I1A / R3Z” Minor Institutional, and zoning of the immediate surrounding area of the proposed development includes residential third density and open space land uses.

1.2 The Proposed Development

This report was based on the Site Plan, prepared by Architecture 49 Inc. (A49), dated February 25th, 2025 (“Issued for Site Plan Control Submission”), and included in **Appendix A**. The Site consists of a main L shaped building with a connected one-storey and a two-story wing; it also includes separate portables classroom, sports field, sports court, outdoor play areas and classrooms.

2 NOISE IMPACT ASSESSMENT CRITERIA

2.1 Transportation Sources and Assessment Criteria

Noise is recognized as a pollutant in the Environmental Protection Act, as uncontrolled noise can affect human activities. Ontario provincial noise control guidelines require that noise concerns are addressed in the planning of any new development.

In land use planning, although elimination or control of the source of pollution is usually a primary objective, there are general limits as to what is practical and technically possible. The City's *Environmental Noise Control Guidelines* (ENCG) follows the MECP's Publication NPC-300, *Environmental Noise Guideline Stationary and Transportation Sources – Approval and Planning* for acceptable levels of road and air traffic noise impacting noise-sensitive institutional developments and stationary noise on surrounding noise-sensitive residential areas. These limits are discussed in Section "Part C – Land Use Planning" of NPC-300 as well as Section 2 and 4 of the ENCG.

ENCG stipulates that a noise study shall be prepared when a new development is proposed within distances as follows:

- 100 metres from the right-of-way of an existing or proposed road; arterial, major collector, light rail transit, bus rapid transit or transit priority corridor.
- 250 metres from the right-of-way of an existing or proposed highway;
- 300 metres from the right-of-way of a proposed or existing rail corridor or secondary main railway line;
- 500 metres from the right-of-way of a freeway or 400-series provincial highway or principal main railway line; or
- The Defined area from the Noise Exposure Forecast (NEF) noise contour of airport / aircraft noise

Since the School is located within 100 meters of existing road and within the defined area from the Noise Exposure Forecast (NEF) of Macdonald-Cartier Airport, a noise study is considered required.

2.1.1 Aircraft Sources

The Site is within the Airport Vicinity Development Zone (AVDZ) of the Macdonald-Cartier Airport; however, it is outside the 25 Noise Exposure Forecast (NEF) and Noise Exposure Project (NEP) noise contour line, as indicated on Schedule K of the Official Plan.

The guidelines recommend noise-sensitive land use to be away from the NEF/NEP 30 contour line and the Airport Operating Influence Zone. **Figure 3** shows the Site location in relation to the airport's NEF/NEP contour map is outside the NEF 25 contour. Therefore, as per ENCG, no specific noise control measure is required. Warning clauses specific to the AVDZ are typically recommended for residential developments with purchasers and/or tenants entering agreements.

2.1.2 Surface Transportation Noise Sources

The majority of road types surrounding the Site were identified as 'collectors' in accordance with the City's "Official Plan – Schedule E Urban Road Network". The only defined proposed or existing arterial or collector road within 100 metres of the site is Kelly Farm Drive. Other road types, light rail transit, bus rapid transit, and transit priority corridor, are over 100 metres away from the Site and are not expected to have a significant impact.

There are no highways located within 250 m of proposed school. Similarly, there are no rail corridor or main railway lines noted within 300 m of the development. Freeway and 400-series or principal railway line are further than 500 m of the development. Therefore, no other transportation noise sources are considered in this assessment.

2.1.2.1 Road Sources Assessment Criteria

Table 2-1 summarizes sound level limits for road traffic applicable for the proposed institutional development.

Table 2-1 ENCG & NPC-300 Road Traffic Indoor Sound Level Criteria for Schools

AREA	TIME PERIOD	L_{EQ} (dBA) ^[1] -ROAD	REFERENCE
Indoor Areas of Schools, Daycares	Daytime (0700 – 2300)	45	NPC-300 Table C-2 ENCG Table 2.2b
	Nighttime (2300 - 0700)		
Outdoor Living Area (OLA)	Daytime (0700 – 2300)	55	NPC-300 Table C-1 ENCG Table 2.2a

Notes: [1] Daytime: L_{EQ} 16HR; Nighttime: L_{EQ} 8-HR.

The NPC-300 and ENCG provide sound level limits in terms of energy equivalent (average) sound levels [L_{EQ}] in units of A-weighted decibels (dBA) at a specific noise-sensitive location.

The building envelope, such as walls, windows and doors, where applicable, should be designed so that the indoor sound levels comply with the sound level limits summarized in **Table 2-1** above.

2.1.2.2 Building Component Requirements

To comply with the indoor sound level criteria listed in **Table 2-1**, the ENCG and NPC-300 provides guidelines based on predicted sound level at the façade/plane of window. All buildings are required to comply with the Ontario Building Code (OBC) requirements. If the predicted sound level at the plane of window exceeds 65 dBA during the daytime for institutional building, additional considerations such as the type of windows, exterior walls, and doors that can provide noise attenuation must be selected.

Table 2-2 summarizes requirements for type of building façade construction for institutional purpose buildings.

Table 2-2 Building Requirements for Indoor Spaces

AREA	TIME PERIOD	L_{EQ} (dBA) ^[2]	BUILDING COMPONENT REQUIREMENTS
Plane of Window ^[1]	Daytime (0700 – 2300h)	≤ 65	Building components compliant with Ontario Building Code (OBC)
		> 65	Building components designed/selected to meet Indoor Requirements

Notes: [1] Plane of Window of an institutional purpose building leading to a noise sensitive room, such as teacher's lounge, classrooms, etc.

[2] Daytime: L_{EQ} 16HR.

2.1.2.3 Ventilation Requirements

Similarly, ENCG and NPC-300 also provide ventilation requirements so that the windows could be kept closed. **Table 2-3** summarizes the requirements for ventilation and the requirement for warning clauses to inform the future occupants of the exceedances.

Table 2-3 Noise Control and Warning Clause Requirements

AREA	TIME PERIOD	EQUIVALENT SOUND LEVEL (DBA) ^[2]	VENTILATION REQUIREMENTS	WARNING CLAUSE
Plane of Window ^[1]	Daytime (0700 – 2300h)	≤ 55	None	None
		> 55 and ≤ 65	Forced air heating systems with provisions for the future installation of central air conditioning	Type C required
		> 65	Central air conditioning	Type D required
	Night time (2300 – 0700h)	≤ 50	None	None
		> 50 and ≤ 60	Forced air heating systems with provisions for the future installation of central air conditioning	Type C required
		> 60	Central air conditioning	Type D required

Note: [1] Plane of Window of living/dining room and bedroom.

[2] Daytime: LEQ 16HR; Nighttime: LEQ 8-HR.

Since the School is a non-residential proposed development, warning clauses are not discussed further within this report.

2.2 Stationary Sources and Assessment Criteria

Stationary source is defined in MECP publication NPC-300 as source of sound or combination of sources of sound that are included and normally operated within the property lines of a facility. The ENCG states new stationary sources of noise (noise generating) are defined by proximity to existing or approved noise-sensitive developments.

There are stationary noise sources introduced by the proposed school building development which is surrounded by existing residential buildings. These stationary sources include rooftop electro-mechanical units and the cars completing student pick-ups and drop-offs. Therefore, stationary noise has been included in the NIS to assess the potential noise impacts of the proposed development on the surrounding noise sensitive land uses and onto itself.

For stationary sources, the MECP NPC-300 and ENCG Section 3 provides criteria based on one-hour equivalent sound level. In order to comply with the noise impact from stationary sources, the predicted sound level must comply with the noise guidelines stipulated in NPC-300 and ENCG. Two locations are typically considered: an outdoor location and the plane of window.

Both guidelines provide sound level limits for noise-sensitive receptors based on the acoustical environment of the area. NPC-300 categorizes the acoustical environment into four classes: Class 1 (urban), Class 2 (semi-urban), Class 3 (rural), or Class 4 (special cases). Based on a review of the area using aerial imagery, the general area is urban residential and can be considered as Class 1. Given that the school only operates during the daytime, **Table 2-4** summarizes the MECP's daytime sound level limit for a Class 1 Area and was used as the applicable sound level limit for the development.

Table 2-4 MECP's Exclusion Limits in dBA

PERIOD	CLASS 1	
	PLANE OF WINDOW ^[1]	OUTDOOR POR ^[2]
Daytime (07:00 – 23:00) ^[3]	50	50
Nighttime (07:00 – 23:00)	45	N/A

Notes: [1] Plane of window means a point in space corresponding with the location of the centre of a window of a noise sensitive space

[2] POR means point of reception, representing a point in a receptor location.

[3] Includes outdoor classroom criteria

3 NOISE IMPACT ASSESSMENT

3.1 Transportation Noise

3.1.1 Road Traffic Data

Road traffic data were obtained from the ENCG **Appendix B** for Kelly Farm Drive. The data obtained from the ENCG provides future traffic volume, day/night split, commercial vehicle percentages, and posted speed limits for various roadways based on roadway class and number of lanes. The ENCG data represents the future traffic volume and corresponding to a “mature state of development”, in the City’s Official Plan.

The traffic and road parameters used for sound level predictions are shown in **Table 3-1**. The surrounding topography is generally flat and assessed as such. As per the Site Plan, the school bus drop-off and pickup location is located offsite on Kelly Farm Drive. Therefore, the school buses are considered as part of transportation noise sources impacting onto the development.

Table 3-1 Summary of Road Traffic Data Used in the Transportation Noise Analysis

ROAD	ROAD CLASSIFICATION	TRAFFIC VOLUMES (AADT)	DAY/NIGHT SPLIT (%)	MEDIUM TRUCKS OR BUSES (%)	HEAVY TRUCKS (%)	POSTED SPEED LIMIT (KPH)
Kelly Farm Drive	2-Lane Urban Collector	8,000	92/8	7%	5%	40

3.1.2 Analysis Method

Road traffic sound levels at the proposed development were predicted using Cadna/A, a commercially available noise propagation modelling software. The following parameters were taken into consideration in the model:

- Road and rail alignments and gradients.
- Traffic volumes and design speeds.
- Commercial vehicle percentages for roads.
- Shielding provided by intervening buildings, barriers and/or topographical features; and
- Special details such as barrier and receptor locations, elevations, and heights.

The software’s Building Evaluation feature was used to predict the sound levels on every façade of the proposed school and portables. The software generates an array of receivers along each building facade and predicts sound levels at each of these receivers resulting in a comprehensive analysis the potential impact on the building.

Kelly Farm Drive was modelled as road source using the U.S. FHWA Traffic Noise Model (TNM) noise emission and calculation method implemented by Cadna/A. TNM predictions were equivalent to those made using the MECF prediction software STAMSON, which is an implementation of the ORNAMENT calculation methods recommended in the ENCG. The TNM predictions were validated against the STAMSON predictions; the validation files are included in **Appendix C**.

3.1.3 Results

Based on the road traffic data, sound levels were predicted at the proposed school. The Site’s building and outdoor classroom location with respect to Kelly Farm Drive is shown in **Figure 4**. The predicted sound levels were used to investigate building construction requirements. The highest predicted/estimated sound levels on the façades of proposed development are summarized in **Table 3-2**.

Table 3-2 Summary of Predicted Sound Levels due to Road Traffic

POR	DESCRIPTION	LOCATION	APPROXIMATE HEIGHT (M)	DAYTIME HIGHEST SOUND LEVEL LEQ (DBA)
Main School Building	Plane of Window	West façade adjacent to Kelly Farm Drive	4.5	62
Outdoor Classroom	Outdoor Living Area	East of Development in School Yard	1.5	46
Portables	Plane of Window	West façade adjacent to Kelly Farm Drive	1.5	63

3.1.4 Recommendations

As shown in **Table 3-2**, the sound levels at the OLA during the daytime hours are below 55 dBA and complies with the guidelines. Similarly, the sound levels at plane of window are below 65 dBA and therefore wall, door and window glazing assemblies meeting the minimum requirements of the Ontario Building Code (OBC) will be sufficient to meet the indoor sound level limits discussed in **Table 2-2**.

3.2 Stationary Noise

A detailed mechanical design is not available at the time of this report, the noise sources associated with the proposed development rooftop units are based similar building developments. Car drop-off and pickup are considered as indicated in the Site Plan. Insignificant sources or sources with negligible sound level contribution include hot water heaters, small fans associated with washrooms, and indoor equipment. Additionally, there is no emergency generator planned for the Site.

3.2.1 Onsite Noise Sources

A total of eight (8) rooftop HVAC units (RTUs) are included in the assessment and are shown in **Figure 5**. All eight RTUs were conservatively assumed to operate continually and simultaneously during a predictable worst-case hour. The cars drop-off and pickup of students was also assumed to occur during the predictable worst-case hour. Typically, the school operates during the daytime between 0700h to 1900h and assessed as such.

The sound level data used in the assessment is summarized in **Table 3-3**. The source locations and on-site and off-site receptors are shown in **Figure 5**.

In order to estimate the sound levels from stationary sources to the surrounding residential areas, a predictive analysis was completed using a commercially available software package CADNA/A, a computer implementation of the ISO Standard 9613-2 “Acoustics – Attenuation of Sound During Propagation Outdoors”, which takes into account the following:

- Source sound power levels;
- Distance attenuation;
- Source-receptor geometry;
- Ground and air (atmospheric) attenuation; and,
- Temperature and humidity effects on noise propagation.

Key parameters used in the model and sample calculations are located in **Appendix D**.

Table 3-3 Proposed Stationary Source Sound Data

SOURCE ID ^[1]	BUILDING	DESCRIPTION	OVERALL SOUND POWER LEVEL (dBA)
SS_RTUd_1	Proposed 2-Storey Main School Building	HVAC 8Ton Daycare Unit Discharge	86.5
SS_RTUd_2		HVAC 15Ton Kindergarten Unit Return	86.5
SS_RTUr_3		HVAC 10Ton Library Unit Return	86.5
SS_RTUd_4		HVAC 9Ton Admin Unit Discharge	86.5
SS_RTUr_5		HVAC 16Ton Gym Unit Return	86.5
SS_RTUd_6		HVAC 17Ton Ground East Unit Discharge	86.5
SS_RTUd_7		HVAC 11Ton Admin Unit Discharge	86.5
SS_RTUr_8		HVAC 17Ton Ground Unit Return	86.5
SS_Car_Move	Drop-off Loop East of the Proposed 2-Storey Main School Building	Car Movement for pickup and drop off	76.5

Notes: [1] Refer **Figure 5** for source locations; locations are referred using these IDs.

3.2.2 Receptors

Off-site Receptors: There are several residential lots surrounding the site on the north, south and east sides and are considered in this assessment. These buildings were analysed as receptors at the second-floor plane of window (i.e., 4.5 m above ground) and are described in **Table 3-4** (R01_w to R18_w). Outdoor points of reception were assessed at standing height of 1.5 m above ground representing the backyards and are also described in **Table 3-4** (receptors R01_o to R13_o).

On-site Receptor: In addition to off-site receptors, the Site itself is a receptor. **Figure 5** shows the School, inclusive of the proposed building, portables, and outdoor classroom, in relation to onsite stationary noise sources.

3.2.3 Results

3.2.3.1 Impacts of the Proposed Development onto Itself

Based on the source sound data provided in **Table 3-3**, sound levels were predicted at the most impacted onsite receptors. The highest sound levels on the façades of proposed development building, portables, and at the outdoor classroom, are summarized in **Table 3-4**.

Table 3-4 Summary of Predicted Sound Levels at the Site due to the Proposed Stationary Sources

POR	DESCRIPTION	LOCATION	HEIGHT (M)	DAYTIME HIGHEST SOUND LEVEL LEQ (DBA)	DAYTIME SOUND LEVEL LIMIT (DBA)	COMPLY WITH LIMIT?
School Building	Plane of Window	Southeast Corner, West façade	4.5	48	50	Yes
Outdoor Classroom	Outdoor Living Area	East of Development in School Yard	1.5	48	50	Yes
Portables	Plane of Window	Southwest Corner, West façade	4.5	45	50	Yes

Predicted sound levels are expected to comply with ENCG and NPC-300 at proposed building development due to the Site stationary noise sources as shown in **Table 3-4**.

3.2.3.2 Impacts of the Proposed Development onto the Surrounding Environment

The overall sound levels at receptors of existing and potential surrounding residential homes, generated using assumed predictable worst-case operations of the school, are summarized in **Table 3-5**.

Table 3-5 Summary of Predicted Sound Levels at the Surrounding Noise Sensitive Land Uses due to the Proposed Stationary Sources

POR ID	DESCRIPTION	LOCATION	RECEPTOR HEIGHT (M)	PREDICTED SOUND LEVEL (dBA)	DAYTIME SOUND LEVEL LIMIT (dBA)	COMPLIANCE WITH LIMIT?
R01_o	Outdoor Point of Reception	2-storey Existing Residential Home to the North	1.5	45	50	Yes
R01_w	Plane of Window		4.5	49	50	Yes
R02_o	Outdoor Point of Reception	2-storey Existing Residential Home to the North	1.5	44	50	Yes
R02_w	Plane of Window		4.5	50	50	Yes
R03_w	Plane of Window	2-storey Existing Residential Home to the North	4.5	48	50	Yes
R04_w	Plane of Window	2-storey Existing Residential Home to the North	4.5	47	50	Yes
R05_w	Plane of Window	2-storey Existing Residential Home to the North	4.5	47	50	Yes
R06_w	Plane of Window	2-storey Existing Residential Home to the North	1.5	46	50	Yes
R07_w	Plane of Window	2-storey Existing Residential Home to the North	4.5	46	50	Yes
R08_w	Plane of Window	2-storey Existing Residential Home to the East	4.5	48	50	Yes
R08_o	Outdoor Point of Reception		1.5	47	50	Yes

R09_w	Plane of Window	2-storey Existing Residential Home to the East	4.5	48	50	Yes
R09_o	Outdoor Point of Reception		1.5	48	50	Yes
R10_w	Plane of Window	2-storey Existing Residential Home to the North	4.5	48	50	Yes
R10_o	Outdoor Point of Reception		1.5	47	50	Yes
R11_w	Plane of Window	2-storey Existing Residential Home to the East	4.5	46	50	Yes
R11_o	Outdoor Point of Reception		1.5	46	50	Yes
R12_w	Plane of Window	2-storey Existing Residential Home to the East	4.5	45	50	Yes
R12_o	Outdoor Point of Reception		1.5	44	50	Yes
R13_w	Plane of Window	2-storey Existing Residential Home to the East	4.5	44	50	Yes
R13_o	Outdoor Point of Reception		1.5	43	50	Yes
R14_w	Plane of Window	2-storey Existing Residential Home to the South	4.5	41	50	Yes
R15_w	Plane of Window	2-storey Existing Residential Home to the South	4.5	41	50	Yes
R16_w	Plane of Window	2-storey Existing Residential Home to the South	4.5	42	50	Yes
R17_w	Plane of Window	2-storey Existing Residential Home to the South	4.5	43	50	Yes
R18_w	Plane of Window	2-storey Existing Residential Home to the South	4.5	43	50	Yes

The predicted stationary source sound level of the proposed RTUs and car movement along the drop off loop meets sound level limit at all receptors.

4 RECOMMENDATIONS AND CONCLUSIONS

4.1 Conclusions

WSP Canada Inc. (WSP) was retained by Conseil des Écoles Publiques de L'est de L'Ontario (CEPEO), to complete a Noise Impact Study (NIS) for the proposed École Élémentaire Leitrim development. The planned elementary school location is southeast of the corner of Kelly Farm Drive and Barrett Farm Drive in Ottawa, Ontario (the Site/School). This NIS report has been prepared to support the Site Plan Approval application. The assessment evaluated the potential for noise impact of transportation sources on the proposed elementary school, and stationary sources associated with the Site on nearby residential uses and onto the School itself.

The predicted sound levels were assessed as per the MECP Publication NPC-300 and ENCG requirements. The assessment demonstrates that the Site will comply with the applicable noise guidelines without additional noise control measures.

4.2 Recommendations

Table 4-1 summarizes the building recommendations for the School's proposed development.

Table 4-1 Summary of Building Requirements

BUILDING	BUILDING COMPONENTS (WALLS) STC	BUILDING COMPONENTS (WINDOWS & DOORS) STC	NOISE CONTROL MEASURES
2-Storey Main School Building	OBC ¹	OBC ¹	NA
Portables	OBC ¹	OBC ¹	NPC-216 ²



Notes: [1] OBC – Meet or exceed the minimum requirement of Ontario Building Code (OBC).

[2] If portables include air conditioning, where possible, select equipment to comply with noise criteria of MECP Publication NPC-216, Residential Air Conditioning Devices.

FIGURES



PATH: S:\Client\A49\Kelly_Farm\99_PROJ\CA0040067_4396\001-0001.mxd PRINTED ON: 2024-11-20 AT: 4:38:24 PM

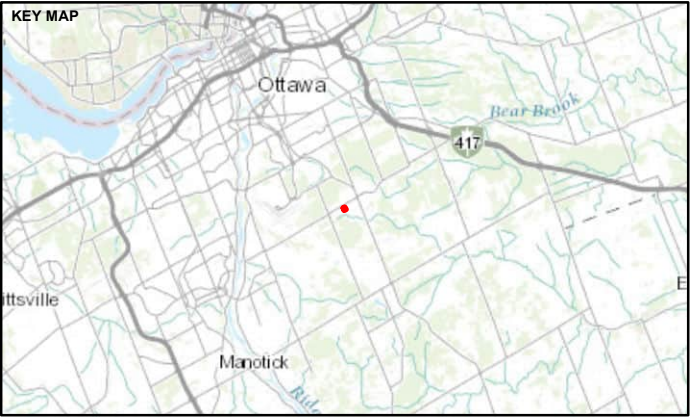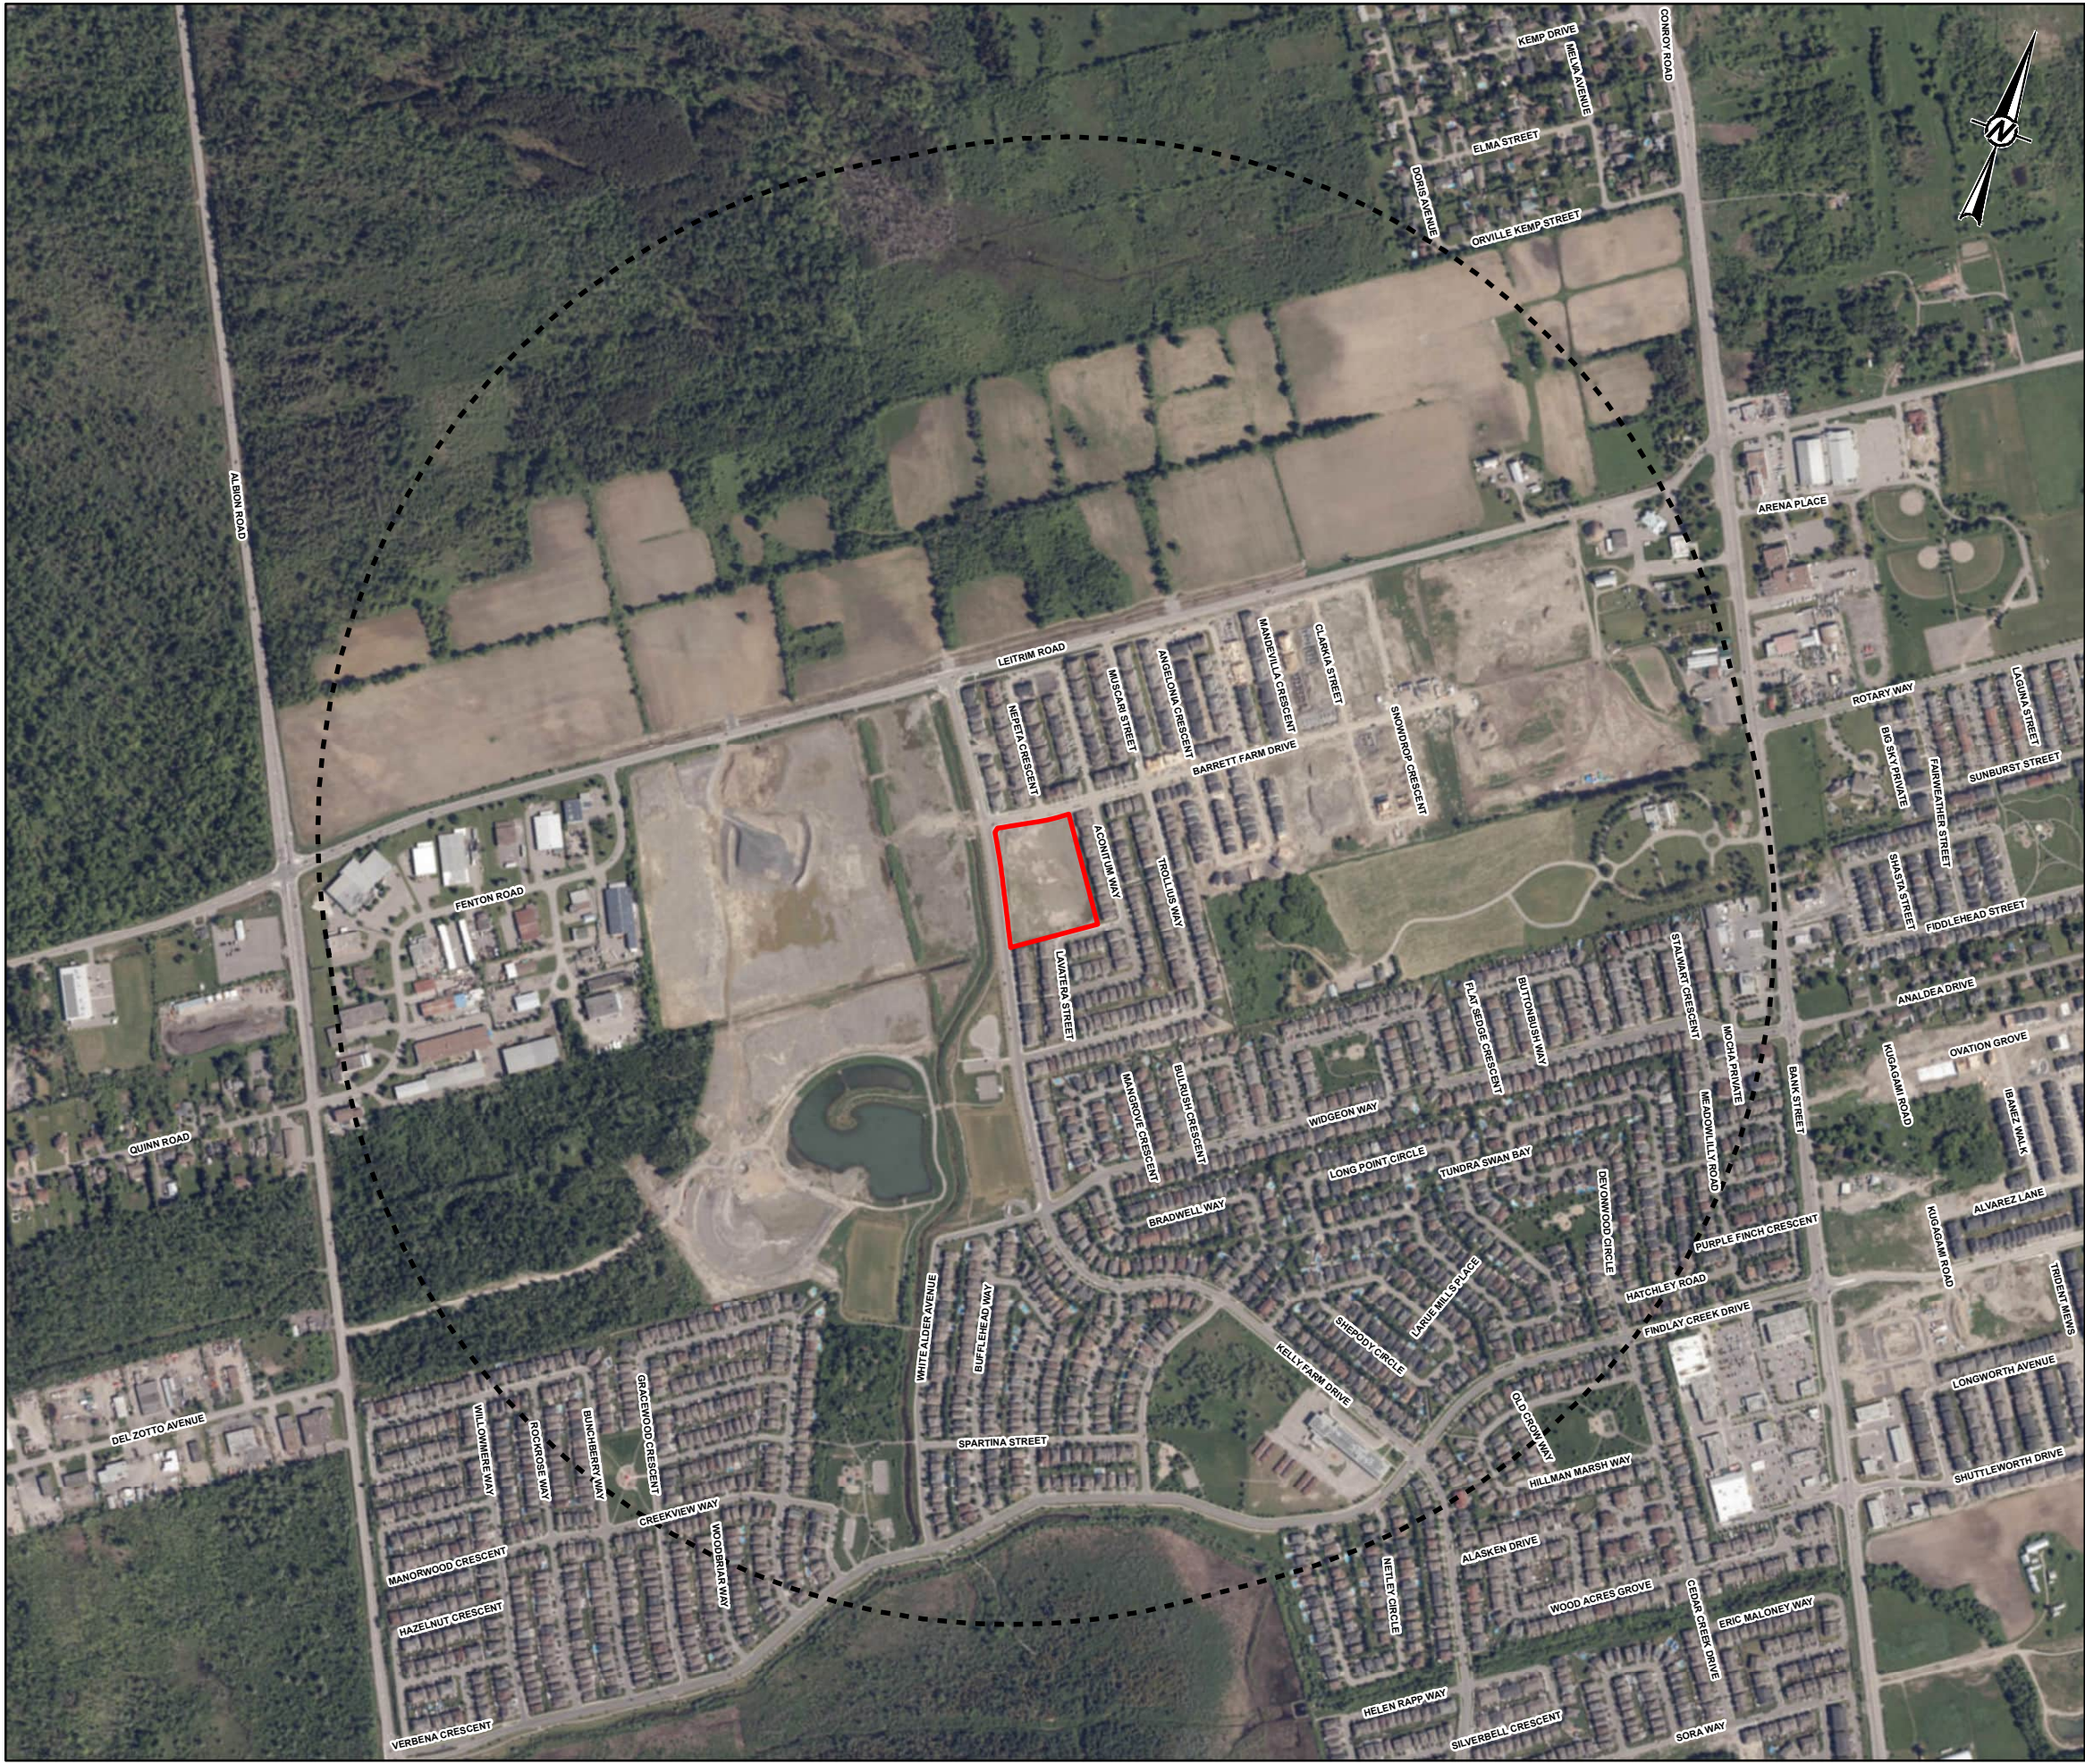

- LEGEND
- SITE BOUNDARY
 - Site_Boundary_Buffer_1000



- REFERENCE(S)
1. IMAGERY OBTAIN FROM THE CITY OF OTTAWA WEBMAPPING SERVICE (2022)
 2. PROJECTION: TRANSVERSE MERCATOR, DATUM: NAD 83, COORDINATE SYSTEM: UTM ZONE 18N


CLIENT
A49 ARCHITECTS INC

PROJECT
KELLY FARM NOISE IMPACT STUDY


TITLE
SITE AND SURROUNDING

	CONSULTANT	YYYY-MM-DD	2024-11-20
	DESIGNED	SO	
	PREPARED	AP	
	REVIEWED		
	APPROVED		

PROJECT NO. CA0040067.4396	CONTROL 0001	REV. 0	FIGURE 1
-------------------------------	-----------------	-----------	--------------------

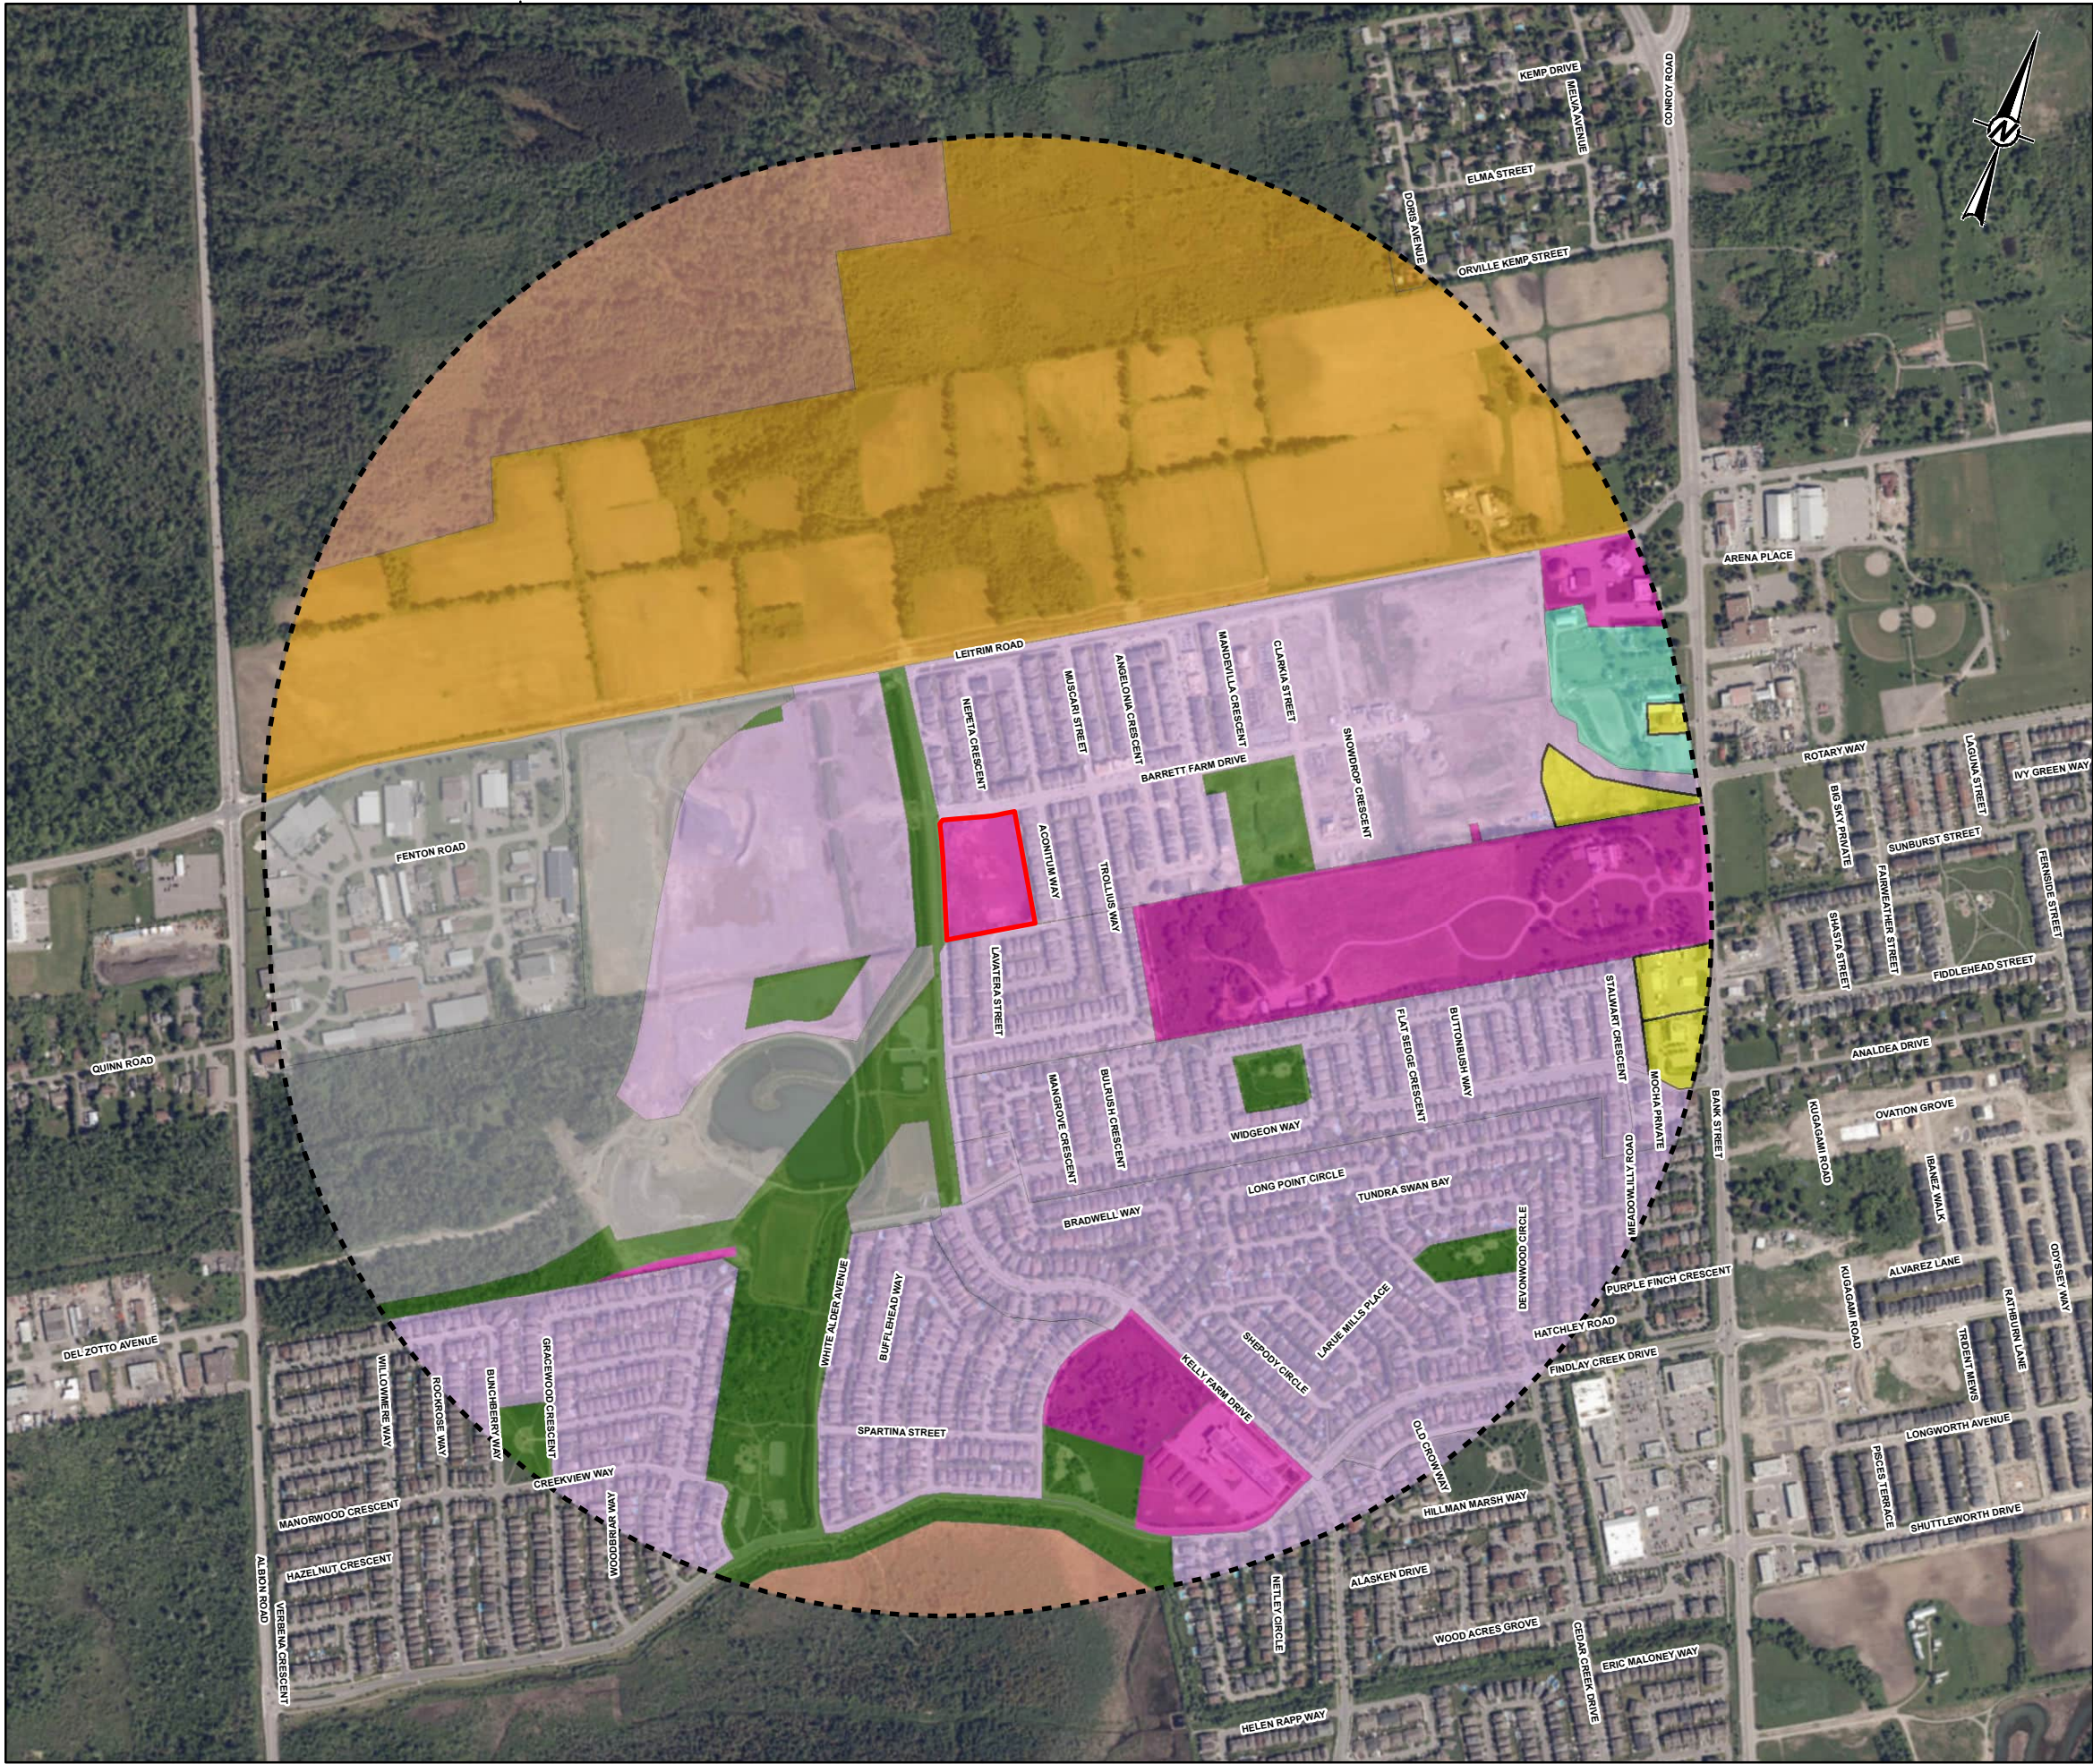

- LEGEND**
- SITE BOUNDARY
 - 1000M SITE BOUNDARY
 - ENVIRONMENTAL
 - INDUSTRIAL
 - INSTITUTIONAL
 - MIXED USE/COMMERCIAL
 - OPEN SPACE
 - OTHER
 - RESIDENTIAL
 - RURAL




- REFERENCE(S)**
1. IMAGERY OBTAIN FROM THE CITY OF OTTAWA WEBMAPPING SERVICE (2022)
 2. ZONING DATA OBTAINED FROM CITY OF OTTAWA WEB MAPPING SERVICES
 3. PROJECTION: TRANSVERSE MERCATOR, DATUM: NAD 83, COORDINATE SYSTEM: UTM ZONE 18N



CLIENT
A49 ARCHITECTS INC

PROJECT
KELLY FARM NOISE IMPACT STUDY


TITLE
ZONING MAP

	CONSULTANT	YYYY-MM-DD	2024-11-20
		DESIGNED	SO
		PREPARED	AP
		REVIEWED	
		APPROVED	

PROJECT NO. CA0040067.4396	CONTROL 0001	REV. 0	FIGURE 2
-------------------------------	-----------------	-----------	--------------------

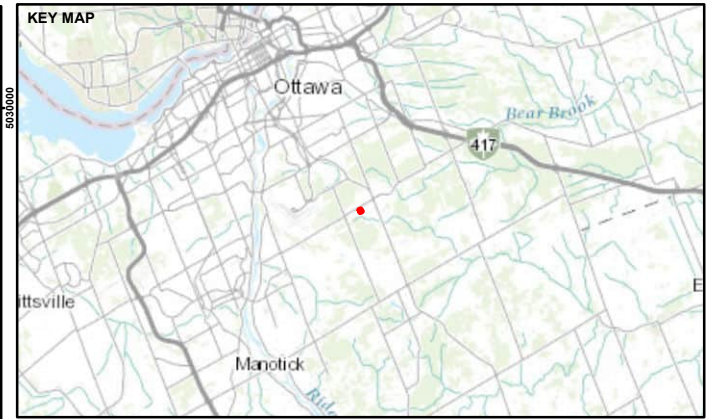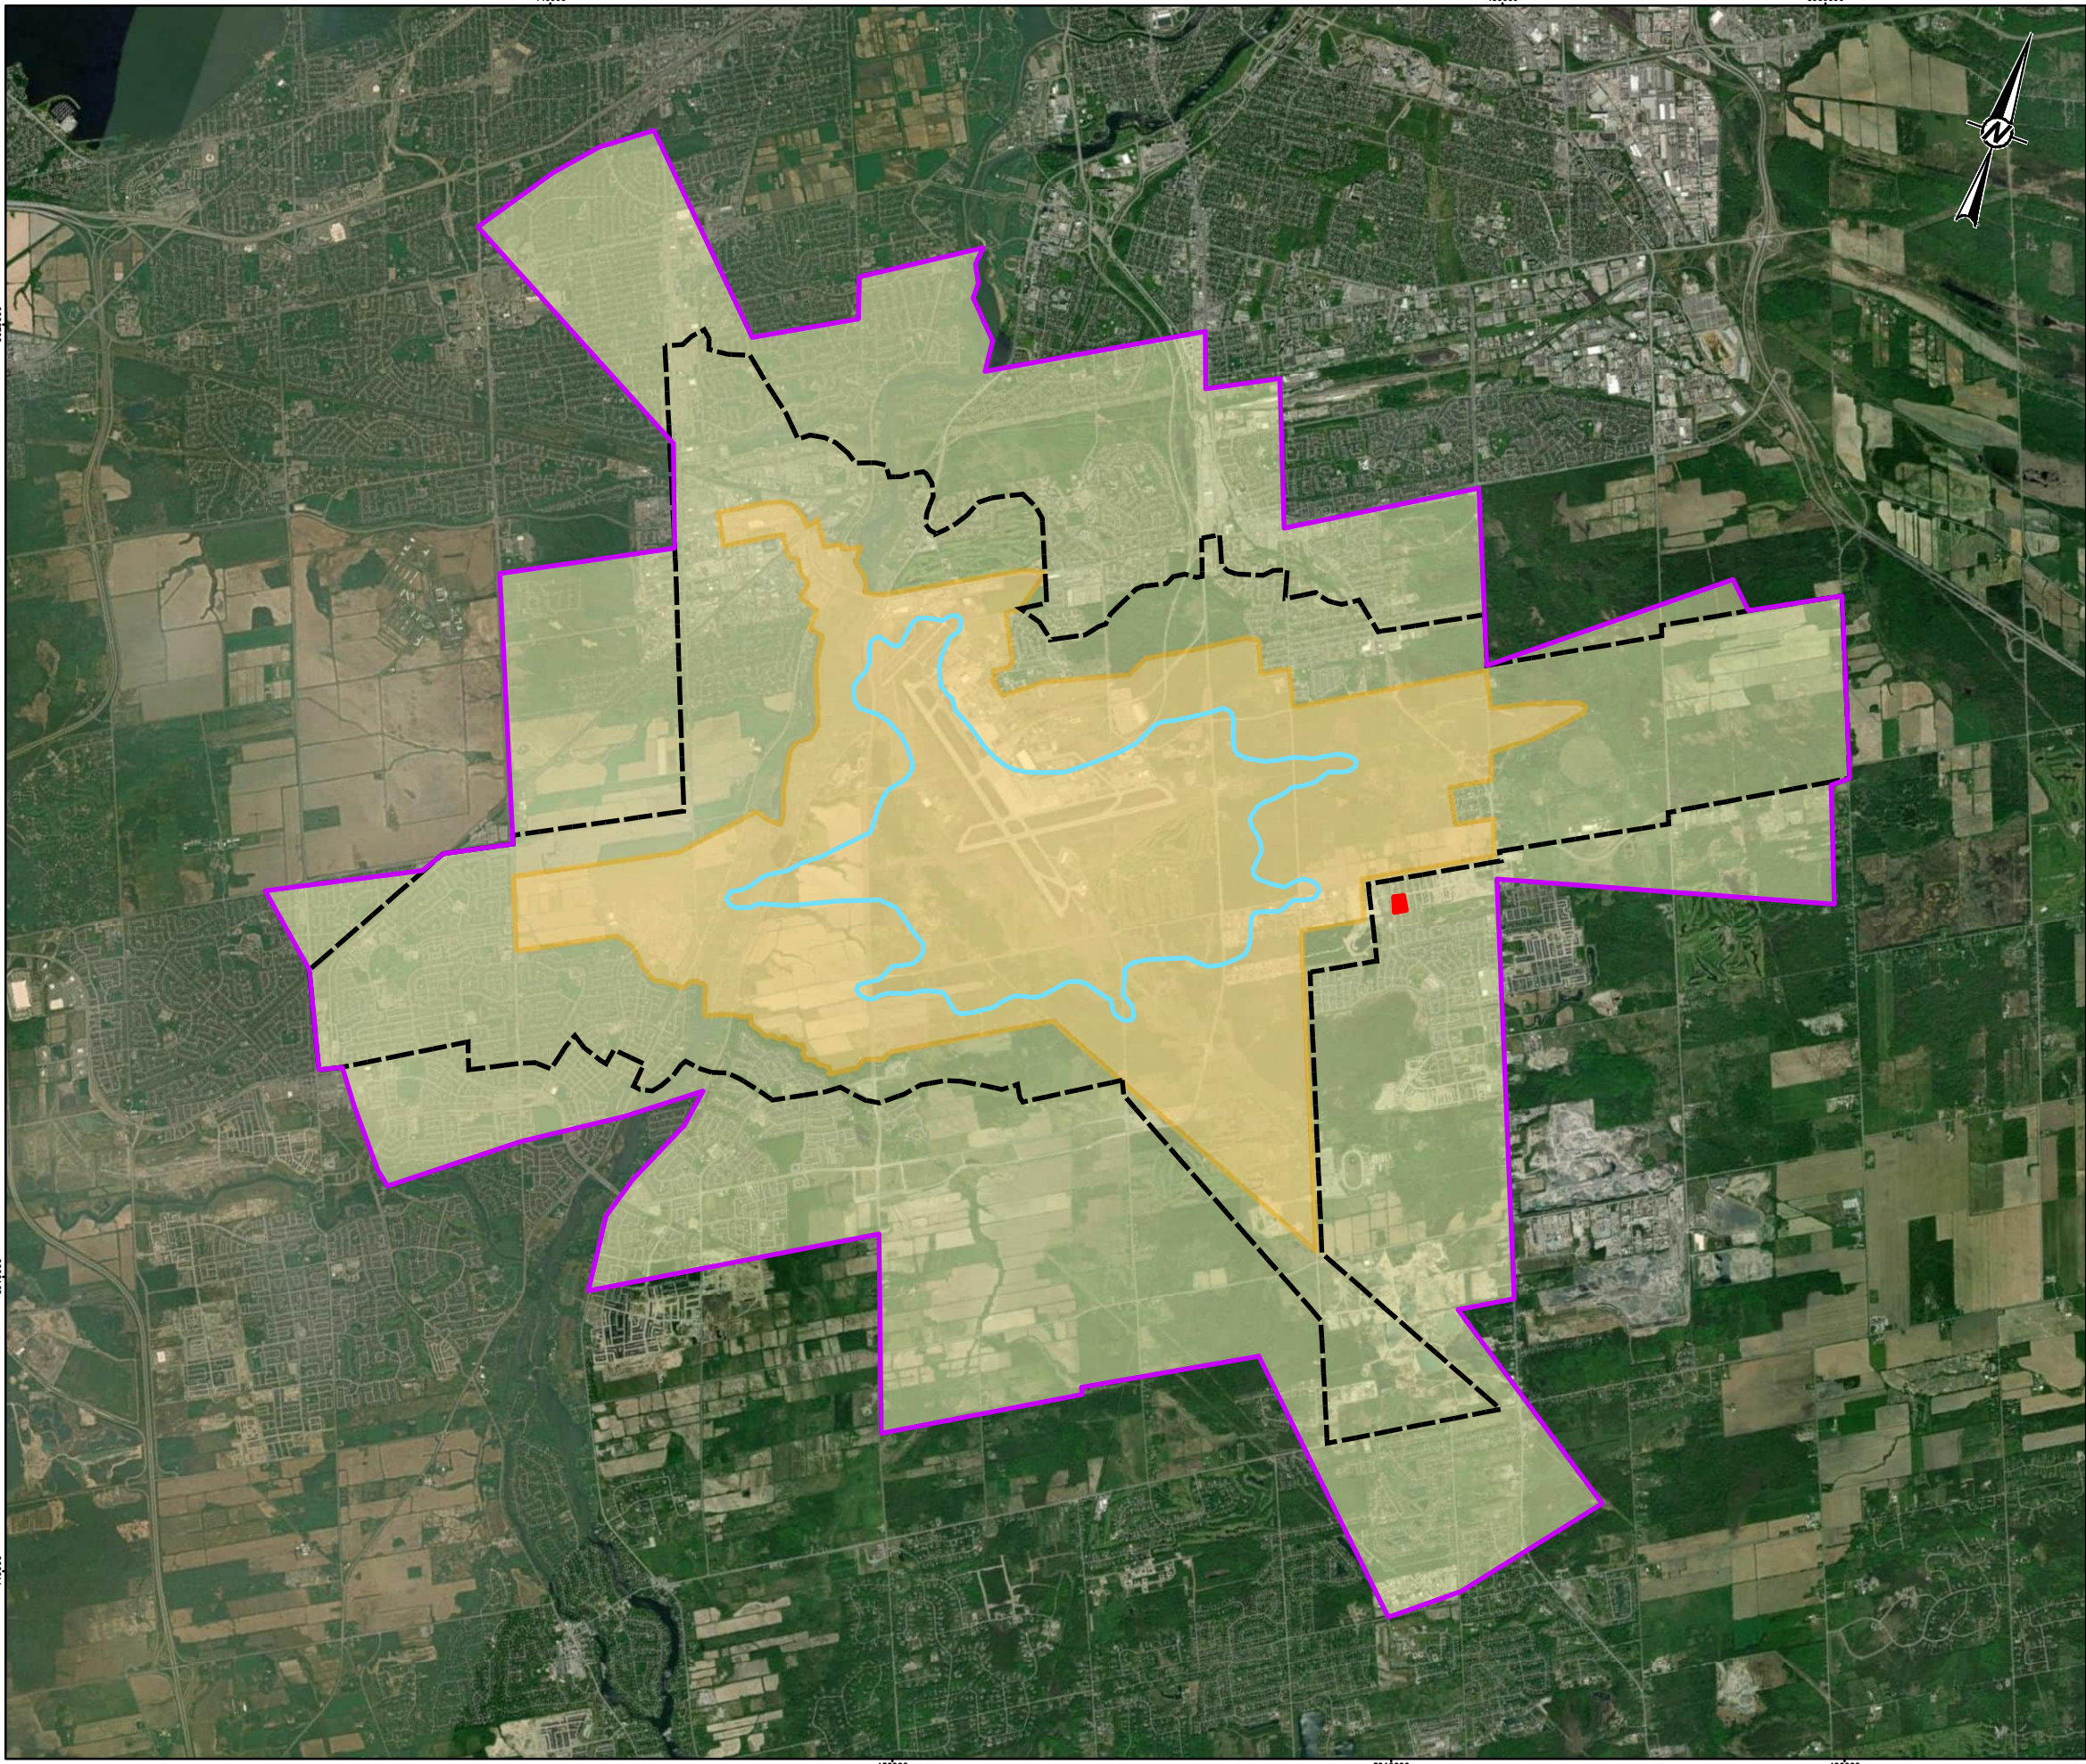

- LEGEND
- AIRPORT VICINITY DEVELOPMENT ZONE
 - 25 LINE (COMPOSITE OF 25 NEF/NEP)
 - 35 LINE NOISE EXPOSURE PROTECTION (NEP 2023)
 - AIRPORT ZONING REGULATIONS
 - AIRPORT OPERATING INFLUENCING ZONE
 - SITE BOUNDARY



REFERENCE(S)
1. IMAGERY OBTAIN FROM ESRI WORLD IMAGERY
2. PROJECTION: TRANSVERSE MERCATOR, DATUM: NAD 83, COORDINATE SYSTEM: UTM ZONE 18N


CLIENT
A49 ARCHITECTS INC

PROJECT
KELLY FARM NOISE IMPACT STUDY

TITLE
SITE LOCATION IN RELATION TO THE AIRPORTS NEF/NEP CONTOUR MAP

	CONSULTANT	YYYY-MM-DD	2024-11-20
	DESIGNED	SO	
	PREPARED	AP	
	REVIEWED		
	APPROVED		

PROJECT NO. CA0040067.4396	CONTROL 0001	REV. 0	FIGURE 3
-------------------------------	-----------------	-----------	-------------

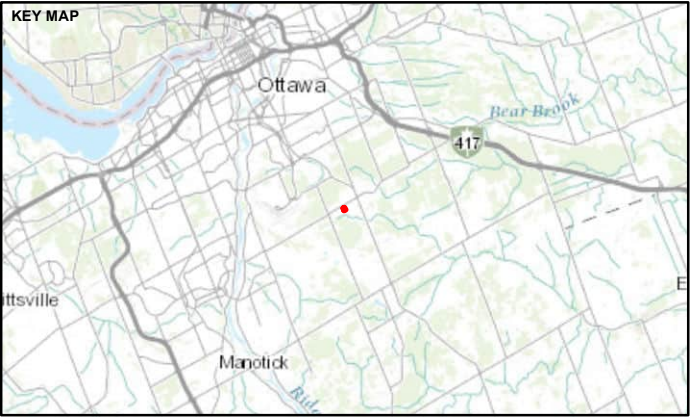

- LEGEND
- OUTDOOR CLASSROOM
 - SITE BOUNDARY
 - PORTABLES
 - PROPOSED BUILDING



REFERENCE(S)
1. IMAGERY OBTAIN FROM THE CITY OF OTTAWA WEBMAPPING SERVICE (2022)
2. PROJECTION: TRANSVERSE MERCATOR, DATUM: NAD 83, COORDINATE SYSTEM: UTM ZONE 18N


CLIENT
A49 ARCHITECTS INC

PROJECT
KELLY FARM NOISE IMPACT STUDY

TITLE
SITE PLAN SHOWING PREDICTION LOCATIONS & ROAD SOURCES
(TRANSPORTATION NOISE IMPACTS)

	CONSULTANT	YYYY-MM-DD	2024-11-25
	DESIGNED	SO	
	PREPARED	AP	
	REVIEWED		
	APPROVED		

PROJECT NO. CA0040067.4396	CONTROL 0001	REV. 0	FIGURE 4
-------------------------------	-----------------	-----------	-------------

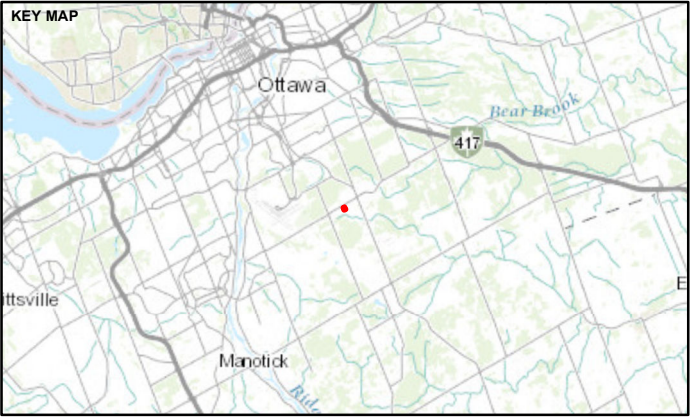

- LEGEND**
- OUTDOOR CLASSROOM
 - SOURCE LOCATION
 - RECEPTOR
 - SOURCE LINE
 - SITE BOUNDARY
 - PROPOSED BUILDING
 - BUILDINGS
 - PORTABLES



REFERENCE(S)
1. 1. IMAGERY OBTAIN FROM THE CITY OF OTTAWA WEBMAPPING SERVICE (2022)
2. PROJECTION: TRANSVERSE MERCATOR, DATUM: NAD 83, COORDINATE SYSTEM: UTM ZONE 18N

CLIENT
A49 ARCHITECTS INC

PROJECT
KELLY FARM NOISE IMPACT STUDY

TITLE
SITE PLAN SHOWING ONSITE STATIONARY SOURCES & RECEPTOR LOCATIONS (STATIONARY NOISE IMPACTS OFFSITE)

CONSULTANT	YYYY-MM-DD	2024-12-20
DESIGNED	SO	
PREPARED	AP	
REVIEWED		
APPROVED		



PROJECT NO. CA0040067.4396 CONTROL 0001 REV. 0 FIGURE 5

APPENDIX

A SITE PLAN






6	25 FEB 2025	ISSUED FOR SITE PLAN CONTROL SUBMISSION
5	14 FEB 2025	ISSUED FOR COSTING
4	10 JAN 2025	ISSUED FOR 60% REVIEW
3	20 DEC 2024	ISSUED FOR COORDINATION
2	24 SEPT 2024	ISSUED FOR CLIENT REVIEW AND COORDINATION
1	17 SEPT 2024	ISSUED FOR SCHEMATIC DESIGN APPROVAL

NO.	DATE	ISSUED
-----	------	--------


ÉCOLE ÉLÉMENTAIRE LEITRIM

ARCHITECTURAL SITE PLAN.

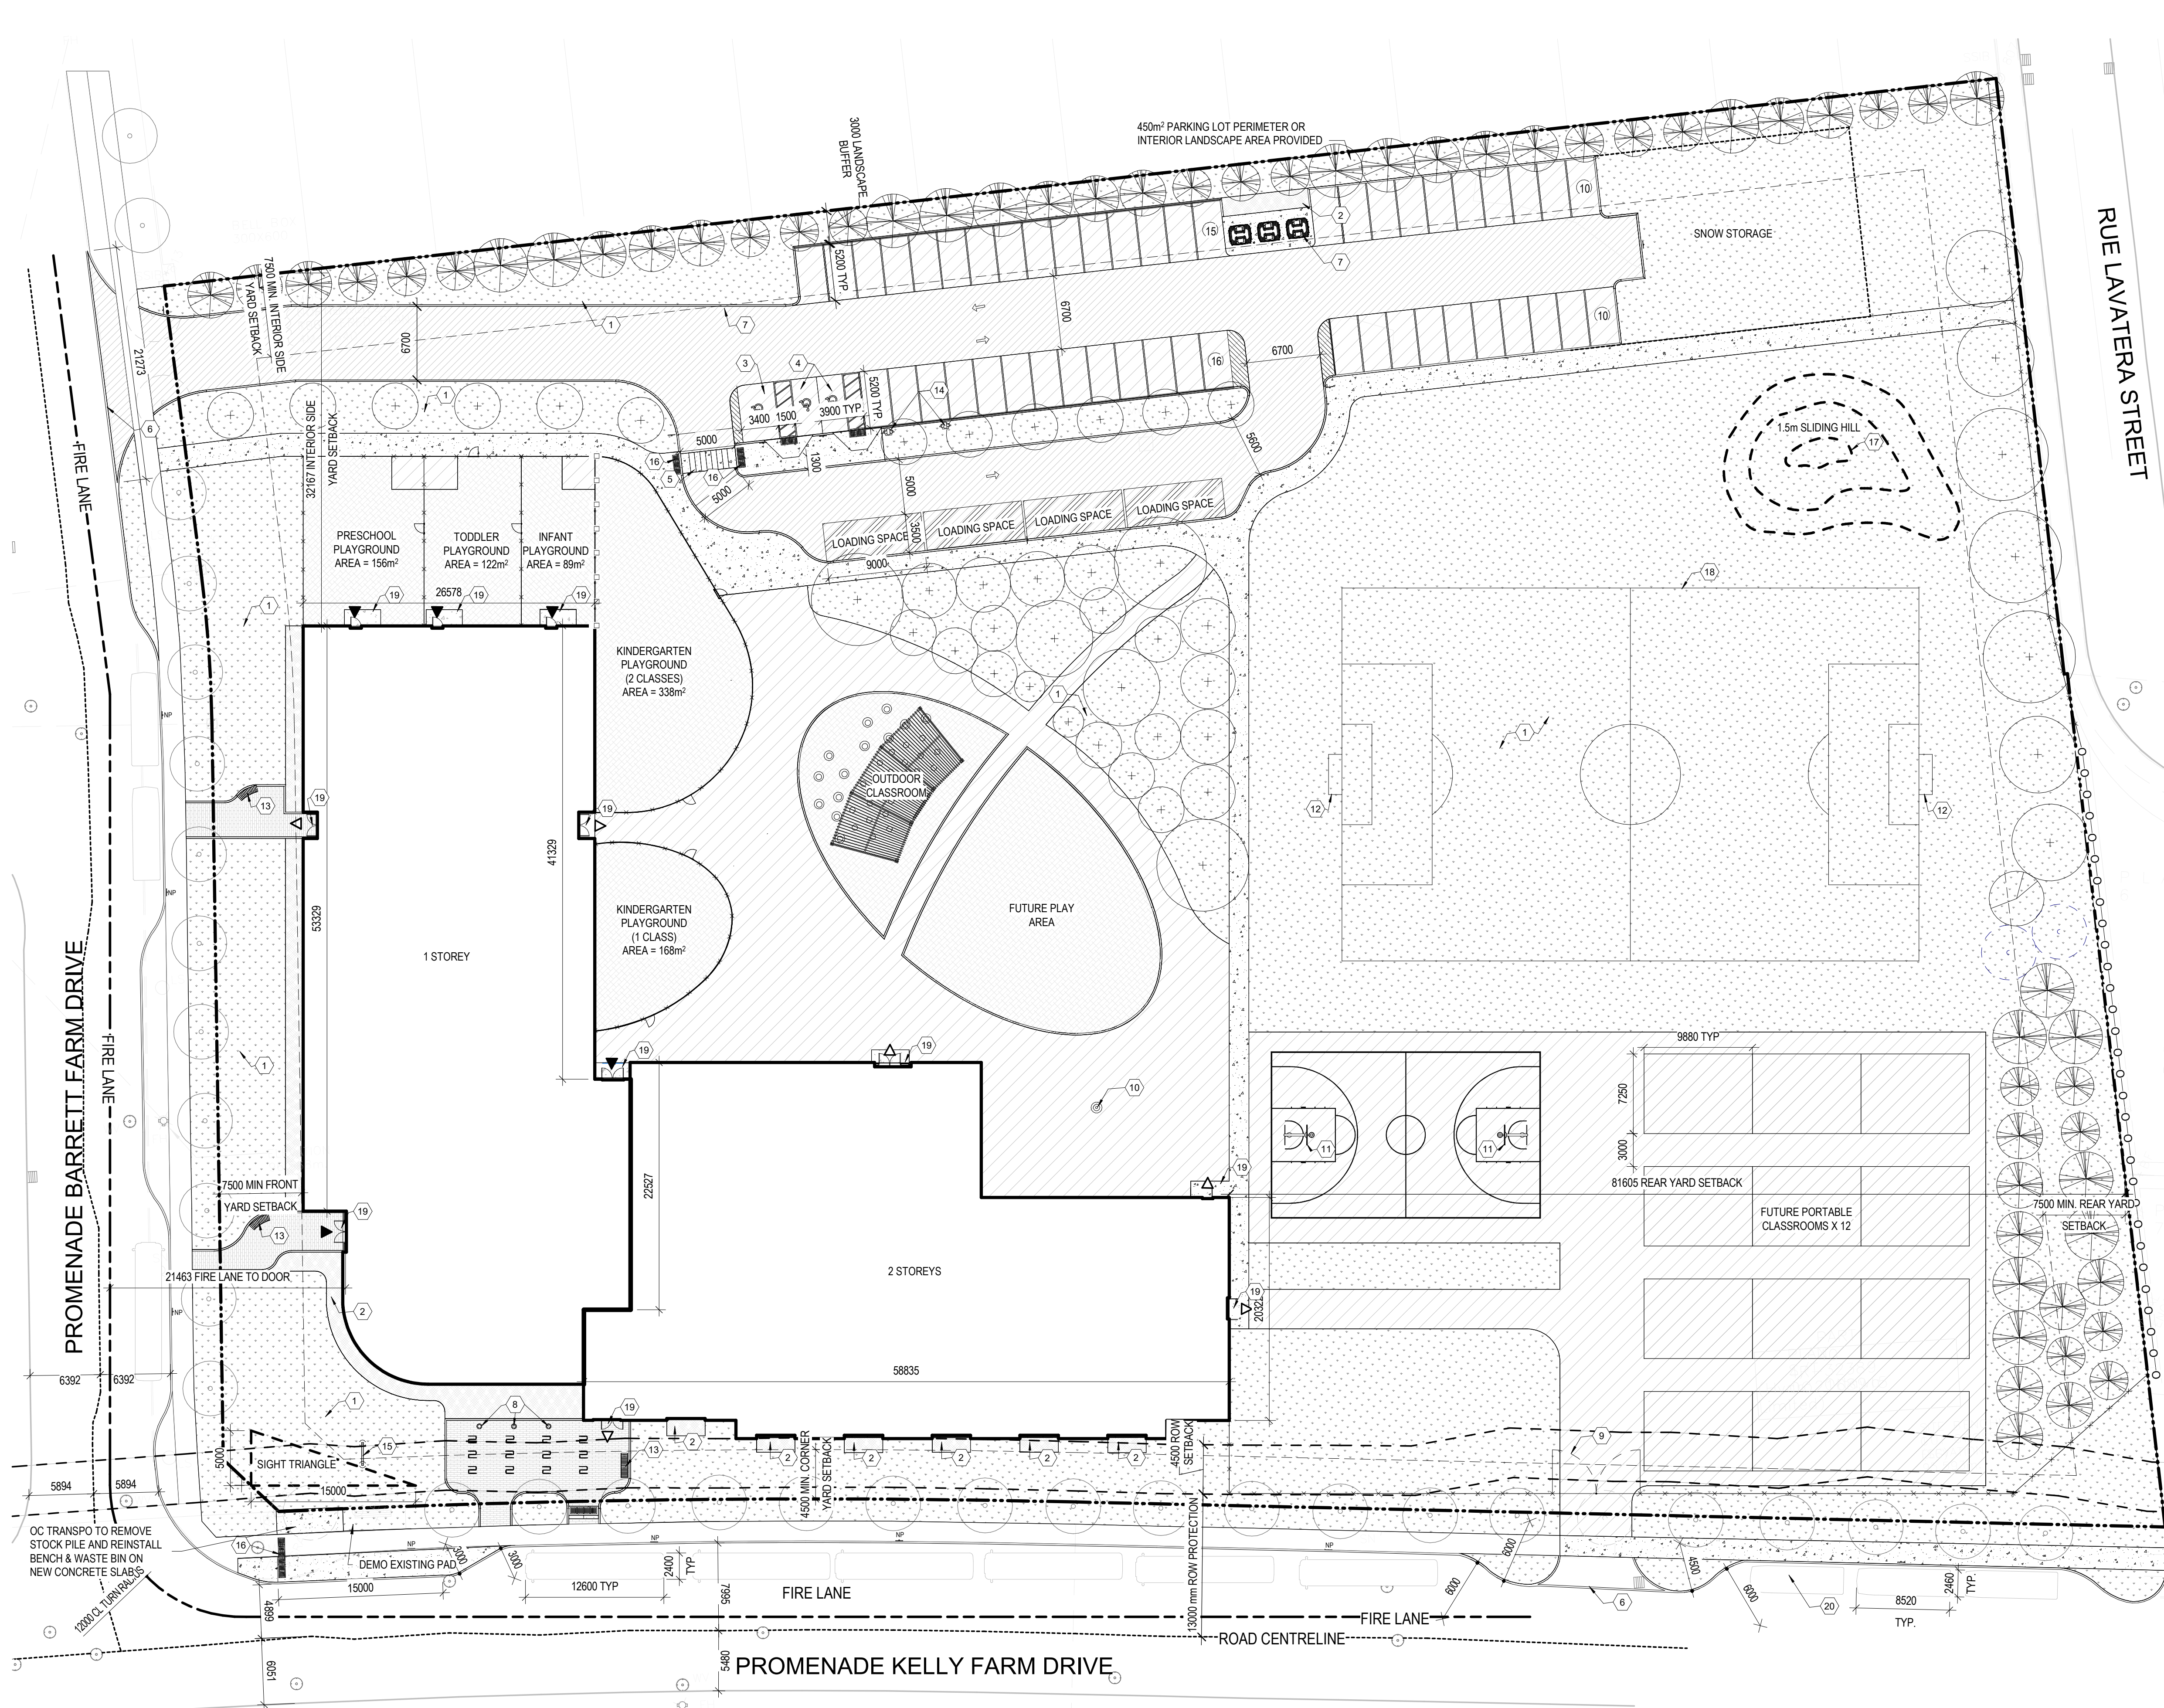

1 ARCHITECTURAL SITE PLAN.

SITE AND PARKING INFORMATION			
SITE DESCRIPTION	BUILDING AREA		FIRE ACCESS REQUIREMENTS
TYPE OF BUILDING OR USE: SCHOOL (GROUP A-2 OCCUPANCY) LEGAL DESCRIPTION: BLOCK, REGISTERED PLAN 4M-1640 MUNICIPAL ADDRESS: 3955 KELLY FARM DRIVE PARCEL IDENTIFICATION NUMBER: 04328-4888(LT) EASEMENTS: SUBJECT TO EASEMENT IN GROSS AS IN OC2168913	FIRST FLOOR = 3,002.3 m ² (EXCLUDING DAYCARE) DAYCARE = 413.2 m ² TOTAL BUILDING FOOTPRINT = 3,415.5m ² + SECOND FLOOR = 1,121.6 m ² TOTAL AREA = 4,537.1 m ²		FIRE TRUCK ACCESS ROUTE IS FROM MUNICIPAL COPE DRIVE AND SHALL CONFORM TO OBC 2012 - 3.2.5.4, 3.2.5.5 AND 3.2.5.6
CHILD OCCUPANCY REQUIREMENTS			
PER ONT CHILD CARE LICENSING MANUAL REQ. OUTDOOR PLAY AREA / CHILD = 5.6m ² PROVIDED OUTDOOR PLAY AREA / CHILD: - PRESCHOOL = 24 X 5.6 = 134.4m ² / 156m ² PROVIDED - TODDLERS = 15 X 5.6 = 84m ² / 122m ² PROVIDED - INFANTS = 15 X 5.6 = 84m ² / 86m ² PROVIDED - KINDERGARTEN = 90 X 5.6 = 504m ² / 506m ² PROVIDED			
ZONING	REQUIREMENT (I1A)	PROPOSED	PARKING PROVISIONS
ZONING = I1A/R32 - MINOR INSTITUTIONAL ZONE, SUBZONE A / RESIDENTIAL THIRD DENSITY, SUBZONE Z			
MINIMUM LOT AREA: SEC. 170, TABLE 170A (b)	400m ²	20, 729m ²	MINIMUM REQUIRED PARKING FOR NEW ELEMENTARY SCHOOL: SEC. 101, TABLE 101, N81
MINIMUM LOT WIDTH: SEC. 170, TABLE 170A (e)	15.0m	± 113.94m	15 CLASSROOMS X 1.5 = 23 2 PER 100m ² OF DAYCARE GROSS FLOOR AREA (413m ²) = 8 12 PORTABLES X 1.5 = 18 PARKING REQ. = 49 / PARKING PROVIDED = 50
MINIMUM FRONT YARD: SEC. 170, TABLE 170A (c)	7.5m	7.5m	MINIMUM NUMBER OF BARRIER-FREE PARKING SPACES: BY-LAW NO. 2017-301, SECTION 111
MINIMUM REAR YARD: SEC. 170, TABLE 170A (d)	7.5m	± 81.605m	MINIMUM REQ. WIDTH OF A LANDSCAPED BUFFER FOR PARKING LOT: SEC. 110, TABLE 110(a)
MINIMUM INTERIOR SIDE YARD: SEC. 170, TABLE 170A (e)	7.5m	± 32.167m	REQ. = 3m PROVIDED= 3m
MINIMUM CORNER SIDE YARD: SEC. 170, TABLE 170A (f)	4.5m	4.5m	MINIMUM REQUIRED PERIMETER OR INTERIOR LANDSCAPE AREA WITHIN PARKING LOT (SEC. 110)
MINIMUM LANDSCAPED OPEN SPACE	NO REQUIREMENT	5.3% WITH PARKING LOT	PARKING AREA = 1248m ² REQ. = 15% AREA OF PARKING = 187.2m ² PROVIDED = 450m ²
MAXIMUM LOT COVERAGE	NO REQUIREMENT	12.8% LOT COVERAGE	
PERCENTAGE OF TOTAL SITE OCCUPIED BY VEGETATION AND LANDSCAPING	NO REQUIREMENT	77% SITE OCCUPIED	MINIMUM NUMBER OF BICYCLE PARKING SPACES: SEC. 111, TABLE 111A (d)
			SCHOOL: 1 PER 100m ² OF GFA OFFICE: 4537 /100 = 45.4 ROUNDED TO 46 DAY CARE: 1 PER 250m ² OF GFA = 360 /250 = 1.44 ROUNDED TO 2 TOTAL: 48
MAXIMUM BUILDING HEIGHT: SEC. 170, TABLE 170A (g)	15.0m	8.7m	BICYCLE PARKING DIMENSIONS: SEC. 111, TABLE 11B
			HORIZONTAL: 0.6m by 1.8m

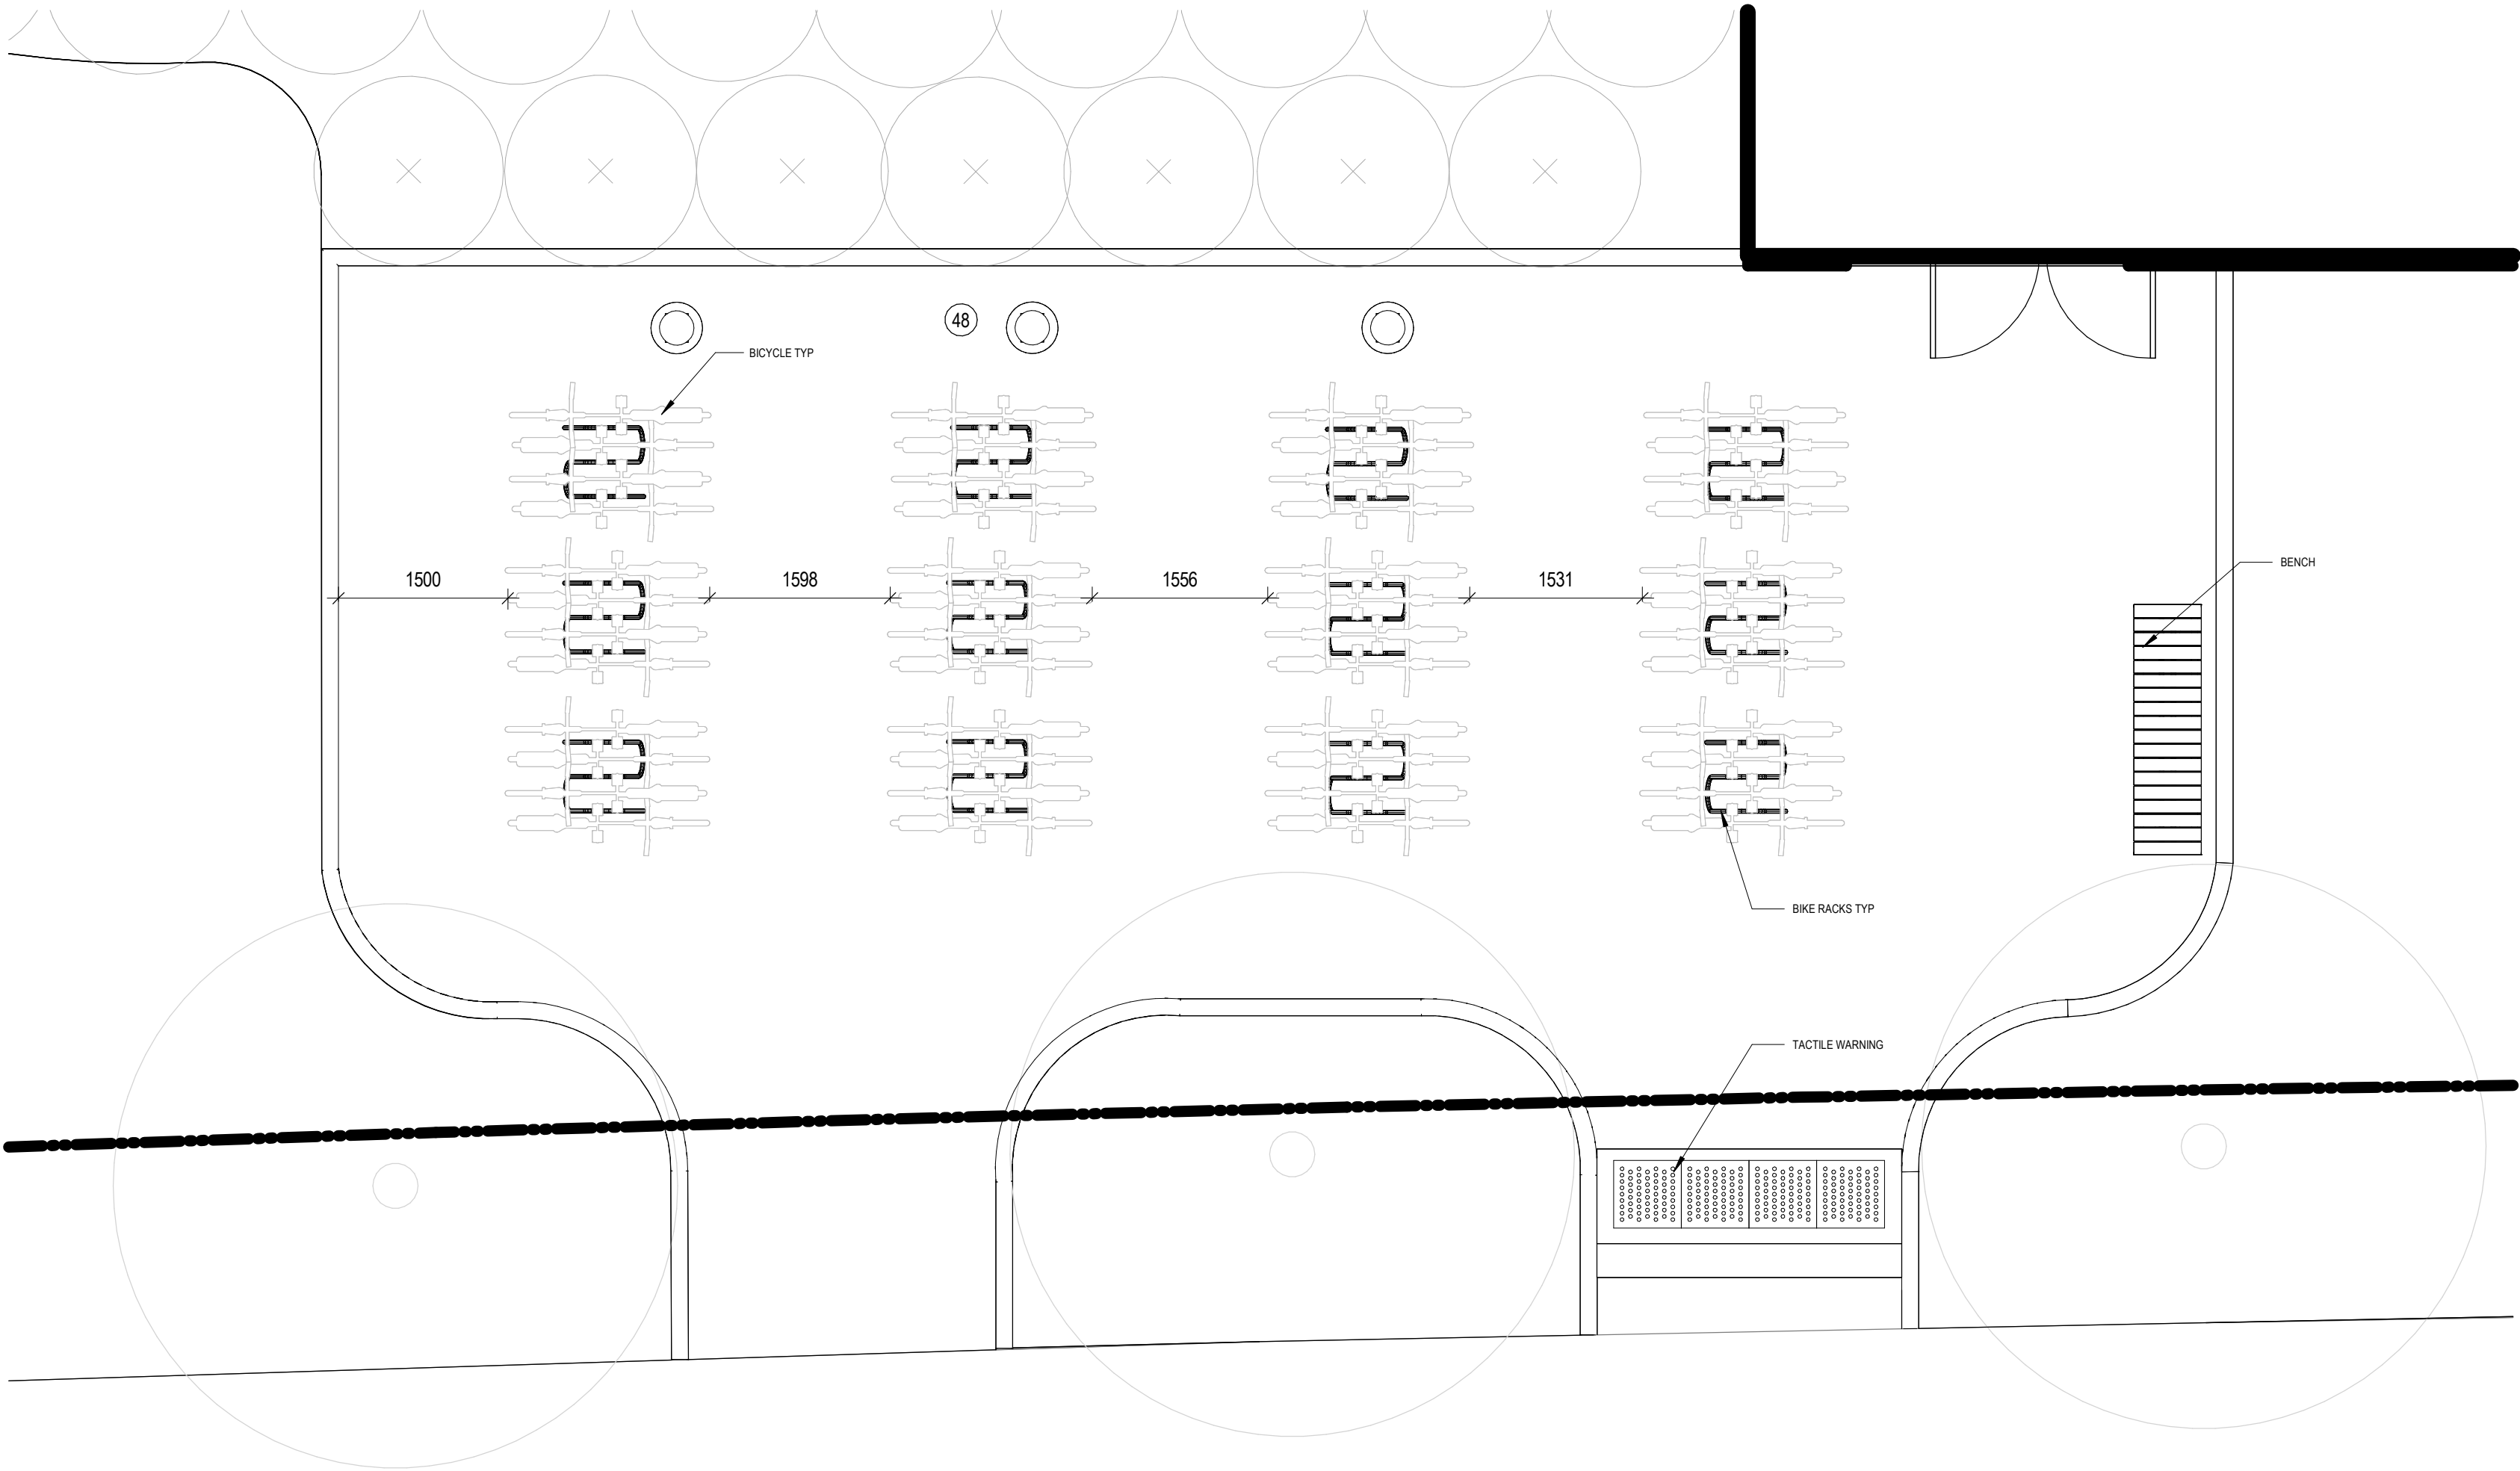

1 AS102 BIKE PARKING AISLE SPACING.
1 : 50

APPENDIX

B TRAFFIC DATA (ENCG)

Appendix B: Table of Traffic and Road Parameters To Be Used For Sound Level Predictions

Table B1 Traffic And Road Parameters To Be Used For Sound Level Predictions

Row Width (m)	Implied Roadway Class	AADT Vehicles/Day	Posted Speed Km/Hr	Day/Night Split %	Medium Trucks %	Heavy Trucks % ¹
NA ²	Freeway, Queensway, Highway	18,333 per lane	100	92/8	7	5
37.5-44.5	6-Lane Urban Arterial-Divided (6-UAD)	50,000	50-80	92/8	7	5
34-37.5	4-Lane Urban Arterial-Divided (4-UAD)	35,000	50-80	92/8	7	5
23-34	4-Lane Urban Arterial-Undivided (4-UAU)	30,000	50-80	92/8	7	5
23-34	4-Lane Major Collector (4-UMCU)	24,000	40-60	92/8	7	5
30-35.5	2-Lane Rural Arterial (2-RAU)	15,000	50-80	92/8	7	5
20-30	2-Lane Urban Arterial (2-UAU)	15,000	50-80	92/8	7	5
20-30	2-Lane Major Collector (2-UMCU)	12,000	40-60	92/8	7	5
30-35.5	2-Lane Outer Rural Arterial (near the extremities of the City) (2-RAU)	10,000	50-80	92/8	7	5
20-30	2-Lane Urban Collector (2-UCU)	8,000	40-50	92/8	7	5

¹ The MOE Vehicle Classification definitions should be used to estimate automobiles, medium trucks and heavy trucks.

² The number of lanes is determined by the future mature state of the roadway.

APPENDIX

C STAMSON VALIDATION

Filename: kf.te Time Period: Day/Night 16/8 hours
 Description: Stanson Validation - Kelly Farm

Road data, segment # 1: Kelly Far (day/night)

 Car traffic volume : 6477/563 veh/TimePeriod *
 Medium truck volume : 515/45 veh/TimePeriod *
 Heavy truck volume : 368/32 veh/TimePeriod *
 Posted speed limit : 40 km/h
 Road gradient : 0 %
 Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT) : 8000
 Percentage of Annual Growth : 0.00
 Number of Years of Growth : 0.00
 Medium Truck % of Total Volume : 7.00
 Heavy Truck % of Total Volume : 5.00
 Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Kelly Far (day/night)

 Angle1 Angle2 : -90.00 deg 90.00 deg
 Wood depth : 0 (No woods.)
 No of house rows : 0 / 0
 Surface : 1 (Absorptive ground surface)
 Receiver source distance : 15.00 / 15.00 m
 Receiver height : 1.50 / 1.50 m
 Topography : 1 (Flat/gentle slope; no barrier)
 Reference angle : 0.00

↑
 Results segment # 1: Kelly Far (day)

 Source height = 1.50 m

ROAD (0.00 + 62.50 + 0.00) = 62.50 dBA

Angle1	Angle2	Alpha	Ref Leq	P. Adj	D. Adj	F. Adj	W Adj	H. Adj	B. Adj	SubLeq
-90	90	0.66	63.96	0.00	0.00	-1.46	0.00	0.00	0.00	62.50

Segment Leq : 62.50 dBA

Total Leq All Segments: 62.50 dBA



Results segment # 1: Kelly Far (night)

Source height = 1.50 m

ROAD (0.00 + 54.91 + 0.00) = 54.91 dBA

Angle1	Angle2	Alpha	Ref Leq	P. Adj	D. Adj	F. Adj	W Adj	H. Adj	B. Adj	SubLeq
--------	--------	-------	---------	--------	--------	--------	-------	--------	--------	--------

-90	90	0.66	56.36	0.00	0.00	-1.46	0.00	0.00	0.00	54.91
-----	----	------	-------	------	------	-------	------	------	------	-------

Segment Leq : 54.91 dBA

Total Leq All Segments: 54.91 dBA



TOTAL Leq FROM ALL SOURCES (DAY) : 62.50
(NIGHT) : 54.91



APPENDIX

D CADNA/A OUTPUTS

Leitrim NIS Sample Calculations - Inputs

Receivers

Name	Sel.	M.	ID	Level Lr			Limit. Value			Land Use			Height		Coordinates		
				Day (dBA)	Le (dBA)	Night (dBA)	Day (dBA)	Le (dBA)	Night (dBA)	Type	Auto	Noise Type	(m)		X (m)	Y (m)	Z (m)
Outdoor Point of Reception 01			SSOFF R01_o	44.8	-80.2	-80.2	50.0	55.0	0.0				1.50	r	452122.19	5019102.36	95.50
Outdoor Point of Reception 01			SSOFF R02_o	44.1	-80.2	-80.2	50.0	55.0	0.0				1.50	r	452130.44	5019105.67	95.50
Outdoor Point of Reception 08			SSOFF R08_o	47.2	-80.2	-80.2	50.0	55.0	0.0				1.50	r	452221.77	5019109.48	95.50
Outdoor Point of Reception 09			SSOFF R09_o	48.0	-80.2	-80.2	50.0	55.0	0.0				1.50	r	452234.98	5019089.02	95.50
Outdoor Point of Reception 10			SSOFF R10_o	47.3	-80.2	-80.2	50.0	55.0	0.0				1.50	r	452247.37	5019062.47	95.50
Outdoor Point of Reception 11			SSOFF R11_o	45.7	-80.2	-80.2	50.0	55.0	0.0				1.50	r	452260.91	5019036.80	95.50
Outdoor Point of Reception 12			SSOFF R12_o	44.3	-80.2	-80.2	50.0	55.0	0.0				1.50	r	452278.92	5019011.30	95.50
Outdoor Point of Reception 13			SSOFF R13_o	43.3	-80.2	-80.2	50.0	55.0	0.0				1.50	r	452289.11	5018987.64	95.50
Plane of Window 01			SSOFF R01_w	49.0	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452110.96	5019093.26	98.50
Plane of Window 02			SSOFF R02_w	50.2	-80.2	-80.2	50.5	50.0	50.0				4.50	r	452145.22	5019108.24	98.50
Plane of Window 02			SSOFF R12_w	44.9	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452278.94	5019017.67	98.50
Plane of Window 03			SSOFF R03_w	48.4	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452174.05	5019125.03	98.50
Plane of Window 04			SSOFF R04_w	47.4	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452184.59	5019130.84	98.50
Plane of Window 05			SSOFF R05_w	46.9	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452193.67	5019135.83	98.50
Plane of Window 06			SSOFF R06_w	46.1	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452202.03	5019141.45	98.50
Plane of Window 07			SSOFF R07_w	45.5	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452209.02	5019145.30	98.50
Plane of Window 08			SSOFF R08_w	48.4	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452226.45	5019107.49	98.50
Plane of Window 09			SSOFF R09_w	48.2	-80.2	-80.2	50.5	50.0	50.0				4.50	r	452235.28	5019095.30	98.50
Plane of Window 10			SSOFF R10_w	47.7	-80.2	-80.2	50.5	50.0	50.0				4.50	r	452248.12	5019066.67	98.50
Plane of Window 11			SSOFF R11_w	45.8	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452267.83	5019033.19	98.50
Plane of Window 13			SSOFF R13_w	43.5	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452294.96	5018985.49	98.50
Plane of Window 14			SSOFF R14_w	41.3	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452304.30	5018949.10	98.50
Plane of Window 15			SSOFF R15_w	41.3	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452283.45	5018936.97	98.50
Plane of Window 16			SSOFF R16_w	41.8	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452270.16	5018930.11	98.50
Plane of Window 17			SSOFF R17_w	42.9	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452232.53	5018923.75	98.50
Plane of Window 18			SSOFF R18_w	42.7	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452202.21	5018904.43	98.50
Plane of Window Outdoor Classroom		+	SSON_OCR01_o	47.8	-80.2	-80.2	50.0	50.0	50.0				1.50	r	452196.20	5019032.28	95.50
Plane of Window Portable 01		~	RS_PR01_w	-88.0	-88.0	-88.0	50.0	50.0	50.0				1.50	r	452166.62	5018938.88	95.50
Plane of Window Portable 01		~	RS_PR01_w	-88.0	-88.0	-88.0	50.0	50.0	50.0				1.50	r	452170.40	5018929.59	95.50
Plane of Window Portable 01		~	RS_PR01_w	-88.0	-88.0	-88.0	50.0	50.0	50.0				1.50	r	452174.36	5018919.99	95.50
Plane of Window Portable 01		~	SSON_PR01_w	-88.0	-88.0	-88.0	50.0	50.0	50.0				1.50	r	452196.98	5018957.11	95.50
Plane of Window Portable 01		~	SSON_PR01_w	-88.0	-88.0	-88.0	50.0	50.0	50.0				1.50	r	452187.37	5018952.26	95.50
Plane of Window Portable 01		~	SSON_PR01_w	-88.0	-88.0	-88.0	50.0	50.0	50.0				1.50	r	452168.42	5018944.52	95.50
Plane of Window Portable 01		~	SSON_PR01_w	-88.0	-88.0	-88.0	50.0	50.0	50.0				1.50	r	452178.38	5018948.68	95.50
Plane of Window Portable 01		~	SSON_PR01_w	-88.0	-88.0	-88.0	50.0	50.0	50.0				4.50	r	452163.95	5019011.44	98.50
Plane of Window Portable 01		~	SSON_PR01_w	-88.0	-88.0	-88.0	50.0	50.0	50.0				4.50	r	452148.36	5019040.28	98.50
School Receptor - 1.5		+	SSON_SCHL1	38.2	-80.2	-80.2	50.0	50.0	50.0				1.50	r	452150.71	5018988.68	95.50
School Receptor - 1.5		+	SSON_SCHLNE	46.6	-80.2	-80.2	50.0	50.0	50.0				1.50	r	452198.81	5019067.19	95.50
School Receptor - 4.5		+	SSON_SCHL4	48.1	-80.2	-80.2	50.0	50.0	50.0				4.50	r	452172.66	5019022.91	98.50

Point Sources

Name	Sel.	M.	ID	Result. PWL			Type	Lw / Li		Correction			Sound Reduction		Attenuation	Operating Time			K0	Freq.	Direct.	Height	Coordinates		
				Day	Evening	Night		Value	norm.	Day	Evening	Night	R	Area		Day	Special	Night					X	Y	Z
				(dB(A))	(dB(A))	(dB(A))			dB(A)	dB(A)	dB(A)		(m²)	(min)	(min)	(min)	(dB)	(Hz)		(m)	(m)	(m)	(m)		
RTU1d_8T Casing Outdoor Air			SS_RTUd_1	86.5	86.5	86.5	Lw	RTU_Casing	0.0	0.0	0.0			60.00	0.00	0.00	0.0	(none)	1.12	g	452192.37	5019070.97	99.12		
RTU2r_15T Casing Outdoor Air			SS_RTUd_2	86.5	86.5	86.5	Lw	RTU_Casing	0.0	0.0	0.0			60.00	0.00	0.00	0.0	(none)	1.50	g	452183.69	5019072.00	99.50		
RTU3r_10T Casing Outdoor Air			SS_RTUd_3	86.5	86.5	86.5	Lw	RTU_Casing	0.0	0.0	0.0			60.00	0.00	0.00	0.0	(none)	1.27	g	452151.67	5019057.62	99.27		
RTU4r_9T Casing Outdoor Air			SS_RTUd_4	86.5	86.5	86.5	Lw	RTU_Casing	0.0	0.0	0.0			60.00	0.00	0.00	0.0	(none)	1.27	g	452146.10	5019057.51	99.27		
RTU5r_16T Casing Outdoor Air			SS_RTUd_5	86.5	86.5	86.5	Lw	RTU_Casing	0.0	0.0	0.0			60.00	0.00	0.00	0.0	(none)	1.50	g	452162.19	5019029.61	103.50		
RTU6d_17T Casing Outdoor Air			SS_RTUd_6	86.5	86.5	86.5	Lw	RTU_Casing	0.0	0.0	0.0			60.00	0.00	0.00	0.0	(none)	1.50	g	452150.83	5019023.04	103.50		
RTU7d_11T Casing Outdoor Air			SS_RTUd_7	86.5	86.5	86.5	Lw	RTU_Casing	0.0	0.0	0.0			60.00	0.00	0.00	0.0	(none)	1.27	g	452152.99	5019010.06	103.27		
RTU8r_17T Casing Outdoor Air			SS_RTUd_8	86.5	86.5	86.5	Lw	RTU_Casing	0.0	0.0	0.0			60.00	0.00	0.00	0.0	(none)	1.50	g	452160.58	5018991.97	103.50		

Line Sources

Name	Sel.	M.	ID	Result. PWL			Result. PWL'			Lw / Li	Type	Correction			Sound Reduction		Attenuation	Operating Time			K0	Freq.	Direct.	Moving Pt. Src		Speed (km/h)	
				Day (dBA)	Evening (dBA)	Night (dBA)	Day (dBA)	Evening (dBA)	Night (dBA)			norm. dB(A)	Day dB(A)	Evening dB(A)	Night dB(A)	R		Area (m²)	Day (min)	Special (min)				Night (min)	(dB)		(Hz)
Car Movement			SS_Car_Move	76.5	-36.5	-36.5	53.0	-60.1	-60.1	PWL-Pt	ssCar_MVMT	0.0	0.0	0.0				60.00	0.00	0.00	0.0		(none)	20.0	0.0	0.0	10.0

Sound Level Library

Name	ID	Type	1/3 Oktave Spectrum (dB)													Source	
			Weight.	31.5	63	125	250	500	1000	2000	4000	8000	10000	A	lin		
RTU1_Daycare_8T_Discharge_CabinetSPL	ssRTU1_Dis	Lw		0.0	90.0	88.0	92.0	94.0	91.0	89.0	83.0	77.0		96.1	99.0	manufacture data	
RTU1_Daycare_8T_Return_CabinetSPL	ssRTU1_Ret	Lw		0.0	90.0	88.0	86.0	78.0	77.0	75.0	70.0	62.0		83.2	93.4		
RTU2_Kindergarten_15T_Discharge_CabinetSPL	ssRTU2_Dis	Lw		0.0	90.0	88.0	86.0	78.0	77.0	75.0	70.0	62.0		83.2	93.4	manufacturer data	
RTU2_Kindergarten_15T_Return_CabinetSPL	ssRTU2_Ret	Lw		0.0	90.0	88.0	86.0	78.0	77.0	75.0	70.0	62.0		83.2	93.4		
RTU3_Library_10T_Discharge_CabinetSPL	ssRTU3_Dis	Lw		0.0	89.0	88.0	91.0	88.0	81.0	77.0	75.0	70.0		88.6	95.5	manufacturer data	
RTU3_Library_10T_Return_CabinetSPL	ssRTU3_Ret	Lw		0.0	86.0	84.0	82.0	77.0	74.0	71.0	67.0	62.0		80.1	89.6		
RTU_Casing	RTU_Casing	Lw		0.0	87.0	86.0	89.0	86.0	78.0	75.0	72.0	67.0		86.4	93.4	WSP Database	
RTU4_Admin_9T_Return_CabinetSPL	ssRTU4_Ret	Lw		0.0	84.0	82.0	80.0	73.0	71.0	68.0	63.0	57.0		77.1	87.4		
RTU5_Gym_16T_Discharge_CabinetSPL	ssRTU5_Dis	Lw		0.0	93.0	91.0	93.0	92.0	88.0	88.0	87.0	83.0		95.2	99.4		
RTU5_Gym_16T_Return_CabinetSPL	ssRTU5_Ret	Lw		0.0	92.0	89.0	87.0	81.0	77.0	78.0	72.0	64.0		84.9	95.0		
RTU6_GroundEast_17T_Discharge_CabinetSPL	ssRTU6_Dis	Lw		0.0	93.0	91.0	93.0	92.0	88.0	88.0	87.0	83.0		95.2	99.4	manufacturer data	
RTU6_GroundEast_17T_Return_CabinetSPL	ssRTU6_Ret	Lw		0.0	92.0	89.0	87.0	81.0	77.0	78.0	72.0	64.0		84.9	95.0		
RTU7_SecondFIZ1_11T_Discharge_CabinetSPL	ssRTU7_Dis	Lw		0.0	90.0	88.0	92.0	83.0	77.0	74.0	70.0	64.0		86.3	95.4	manufacturer data	
RTU7_SecondFIZ1_11T_Return_CabinetSPL	ssRTU7_Ret	Lw		0.0	87.0	85.0	84.0	75.0	73.0	71.0	67.0	62.0		80.1	90.6		
RTU8_SecFIZ2_17T_Discharge_CabinetSPL	ssRTU8_Dis	Lw		0.0	90.0	89.0	92.0	94.0	92.0	88.0	83.0	78.0		96.2	99.2	Manufacturer data	
RTU8_SecFIZ2_17T_Return_CabinetSPL	ssRTU8_Ret	Lw		0.0	92.0	89.0	87.0	81.0	77.0	77.0	72.0	64.0		84.6	94.9	manufacturer data	
Bus_Movement	ssBus_MVMT	Lw		109.8	111.7	100.7	93.9	98.5	99.9	97.4	92.4	92.0		103.9	114.5	WSP Measurement Database	
Car_Movement	ssCar_MVMT	Lw		93.0	85.0	78.0	76.0	78.0	74.0	72.0	69.0	67.0		79.9	94.0	WSP Database	
Bus_Idling	ssBus_IDL1	Lw		94.7	98.2	93.9	88.5	88.2	95.2	92.8	84.7	78.4		98.3	102.8	WSP Measurement Database	

Cadnaa Sample Calculations Leitrim NIS -
Transportation Noise

Receiver

Name: Plane of Window Portable 01
ID: SSON_PR01_w
X: 452196.98 m
Y: 5018957.11 m
Z: 95.50 m

Point Source, ISO 9613, Name: "RTU8r_17T Casing Outdoor Air", ID: "SS_RTU8r_8"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
7	452160.58	5018991.97	103.50	0	D	A	86.5	0.0	0.0	0.0	0.0	45.2	0.2	-0.4	0.0	0.0	0.0	0.0	0.0	41.6

Point Source, ISO 9613, Name: "RTU7d_11T Casing Outdoor Air", ID: "SS_RTU7d_7"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
14	452152.99	5019010.06	103.27	0	D	A	86.5	0.0	0.0	0.0	0.0	47.8	0.3	-0.5	0.0	0.0	6.9	0.0	0.0	32.0
35	452152.99	5019010.06	103.27	1	D	A	86.5	0.0	0.0	0.0	0.0	59.1	0.9	0.2	0.0	0.0	7.1	0.0	5.3	14.0

Point Source, ISO 9613, Name: "RTU5r_16T Casing Outdoor Air", ID: "SS_RTU5r_5"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
39	452162.19	5019029.61	103.50	0	D	A	86.5	0.0	0.0	0.0	0.0	49.1	0.3	-0.1	0.0	0.0	0.0	0.0	0.0	37.1
54	452162.19	5019029.61	103.50	1	D	A	86.5	0.0	0.0	0.0	0.0	49.3	0.3	-0.1	0.0	0.0	0.0	0.0	4.8	32.3

Point Source, ISO 9613, Name: "RTU6d_17T Casing Outdoor Air", ID: "SS_RTU6d_6"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
66	452150.83	5019023.04	103.50	0	D	A	86.5	0.0	0.0	0.0	0.0	49.2	0.3	-0.5	0.0	0.0	6.6	0.0	0.0	30.9
71	452150.83	5019023.04	103.50	1	D	A	86.5	0.0	0.0	0.0	0.0	58.7	0.8	0.2	0.0	0.0	6.5	0.0	5.1	15.2

Point Source, ISO 9613, Name: "RTU3r_10T Casing Outdoor Air", ID: "SS_RTU3r_3"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
79	452151.67	5019057.62	99.27	0	D	A	86.5	0.0	0.0	0.0	0.0	51.9	0.4	-0.0	0.0	0.0	13.4	0.0	0.0	20.9
85	452151.67	5019057.62	99.27	1	D	A	86.5	0.0	0.0	0.0	0.0	51.9	0.4	-0.0	0.0	0.0	14.7	0.0	14.7	4.8

Point Source, ISO 9613, Name: "RTU4r_9T Casing Outdoor Air", ID: "SS_RTU4r_4"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
98	452146.10	5019057.51	99.27	0	D	A	86.5	0.0	0.0	0.0	0.0	52.0	0.4	-0.0	0.0	0.0	13.8	0.0	0.0	20.2

Point Source, ISO 9613, Name: "RTU1d_8T Casing Outdoor Air", ID: "SS_RTU1d_1"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
104	452192.37	5019070.97	99.12	0	D	A	86.5	0.0	0.0	0.0	0.0	52.1	0.4	0.3	0.0	0.0	0.0	0.0	0.0	33.6
115	452192.37	5019070.97	99.12	1	D	A	86.5	0.0	0.0	0.0	0.0	57.0	0.7	-0.5	0.0	0.0	15.7	0.0	3.7	9.9
120	452192.37	5019070.97	99.12	1	D	A	86.5	0.0	0.0	0.0	0.0	57.8	0.8	0.3	0.0	0.0	4.1	0.0	3.5	20.0
129	452192.37	5019070.97	99.12	1	D	A	86.5	0.0	0.0	0.0	0.0	56.0	0.6	0.6	0.0	0.0	0.0	0.0	3.1	26.2

Point Source, ISO 9613, Name: "RTU2r_15T Casing Outdoor Air", ID: "SS_RTU2r_2"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
144	452183.69	5019072.00	99.50	0	D	A	86.5	0.0	0.0	0.0	0.0	52.3	0.5	0.3	0.0	0.0	0.0	0.0	0.0	33.5
149	452183.69	5019072.00	99.50	1	D	A	86.5	0.0	0.0	0.0	0.0	57.1	0.7	-0.9	0.0	0.0	15.8	0.0	3.7	10.1
169	452183.69	5019072.00	99.50	1	D	A	86.5	0.0	0.0	0.0	0.0	57.6	0.7	0.4	0.0	0.0	4.0	0.0	3.6	20.3
179	452183.69	5019072.00	99.50	1	D	A	86.5	0.0	0.0	0.0	0.0	56.4	0.7	0.5	0.0	0.0	0.0	0.0	3.2	25.8

Line Source, ISO 9613, Name: "Car Movement", ID: "SS_Car_Move"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
185	452243.30	5019032.50	95.50	0	D	A	53.0	15.0	0.0	0.0	0.0	49.9	0.7	0.0	0.0	0.0	0.0	0.0	0.0	17.2
189	452249.90	5019019.40	95.50	1	D	A	53.0	2.8	0.0	0.0	0.0	55.9	1.2	-0.4	0.0	0.0	0.0	0.0	8.3	-9.2
202	452247.77	5019023.62	95.50	1	D	A	53.0	10.6	0.0	0.0	0.0	51.7	0.9	-0.1	0.0	0.0	0.0	0.0	9.6	1.5
214	452243.67	5019031.76	95.50	1	D	A	53.0	8.4	0.0	0.0	0.0	51.9	0.9	-0.1	0.0	0.0	0.0	0.0	9.6	-0.9

Line Source, ISO 9613, Name: "Car Movement", ID: "SS_Car_Move"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahou	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
218	452239.20	5019040.65	95.50	1	D	A	53.0	11.2	0.0	0.0	0.0	52.2	0.9	-0.2	0.0	0.0	0.0	0.0	9.7	1.5
231	452245.03	5019029.07	95.50	1	D	A	53.0	6.2	0.0	0.0	0.0	53.1	1.0	-0.2	0.0	0.0	4.1	0.0	2.2	-0.9
235	452241.46	5019036.16	95.50	1	D	A	53.0	10.7	0.0	0.0	0.0	53.2	1.0	-0.2	0.0	0.0	4.1	0.0	2.2	3.4
250	452249.09	5019020.99	95.50	1	D	A	53.0	7.4	0.0	0.0	0.0	53.2	1.0	-0.2	0.0	0.0	4.1	0.0	2.3	0.1
261	452247.53	5019024.10	95.50	1	D	A	53.0	1.6	0.0	0.0	0.0	53.3	1.0	-0.2	0.0	0.0	4.1	0.0	2.3	-5.8
270	452236.89	5019045.22	95.50	1	D	A	53.0	4.5	0.0	0.0	0.0	53.7	1.0	-0.3	0.0	0.0	4.1	0.0	2.3	-3.3
283	452218.69	5019086.39	95.50	0	D	A	53.0	17.2	0.0	0.0	0.0	53.4	1.0	-0.3	0.0	0.0	0.0	0.0	0.0	16.1
341	452226.96	5019069.23	95.50	1	D	A	53.0	11.6	0.0	0.0	0.0	53.2	1.0	-0.2	0.0	0.0	0.0	0.0	9.9	0.7
344	452219.26	5019085.20	95.50	1	D	A	53.0	13.2	0.0	0.0	0.0	53.9	1.0	-0.3	0.0	0.0	0.0	0.0	10.1	1.5
356	452211.96	5019100.37	95.50	1	D	A	53.0	10.0	0.0	0.0	0.0	54.6	1.1	-0.3	0.0	0.0	0.0	0.0	10.2	-2.7
363	452208.55	5019107.44	95.50	1	D	A	53.0	7.6	0.0	0.0	0.0	55.0	1.1	-0.4	0.0	0.0	0.0	0.0	8.1	-3.3
370	452228.52	5019066.00	95.50	1	D	A	53.0	8.6	0.0	0.0	0.0	53.9	1.0	-0.3	0.0	0.0	4.1	0.0	2.2	0.5
375	452226.48	5019070.23	95.50	1	D	A	53.0	3.3	0.0	0.0	0.0	54.1	1.0	-0.3	0.0	0.0	4.1	0.0	2.2	-4.9
381	452221.68	5019080.20	95.50	1	D	A	53.0	11.7	0.0	0.0	0.0	54.5	1.1	-0.3	0.0	0.0	4.1	0.0	2.2	3.0
385	452214.49	5019095.11	95.50	1	D	A	53.0	10.1	0.0	0.0	0.0	55.3	1.2	-0.4	0.0	0.0	4.2	0.0	2.3	0.5
399	452211.91	5019100.47	95.50	1	D	A	53.0	2.3	0.0	0.0	0.0	55.5	1.2	-0.4	0.0	0.0	4.2	0.0	2.3	-7.5
407	452210.18	5019104.06	95.50	1	D	A	53.0	6.7	0.0	0.0	0.0	55.4	1.2	-0.4	0.0	0.0	4.2	0.0	2.4	-3.1
430	452208.23	5019108.10	95.50	1	D	A	53.0	6.3	0.0	0.0	0.0	55.6	1.2	-0.4	0.0	0.0	4.2	0.0	2.4	-3.6
442	452215.58	5019092.85	95.50	1	D	A	53.0	12.4	0.0	0.0	0.0	57.9	1.4	-0.6	0.0	0.0	7.0	0.0	6.6	-6.9
454	452209.49	5019105.48	95.50	1	D	A	53.0	10.1	0.0	0.0	0.0	57.4	1.4	-0.6	0.0	0.0	7.6	0.0	5.7	-8.4
458	452215.26	5019087.86	95.50	0	D	A	53.0	16.8	0.0	0.0	0.0	53.4	1.0	-0.3	0.0	0.0	0.0	0.0	0.0	15.6
482	452207.39	5019107.79	95.50	1	D	A	53.0	7.0	0.0	0.0	0.0	55.0	1.1	-0.4	0.0	0.0	0.0	0.0	10.3	-6.2
494	452210.03	5019101.11	95.50	1	D	A	53.0	9.7	0.0	0.0	0.0	54.7	1.1	-0.3	0.0	0.0	0.0	0.0	10.2	-3.1
509	452215.84	5019086.41	95.50	1	D	A	53.0	12.9	0.0	0.0	0.0	54.1	1.1	-0.3	0.0	0.0	0.0	0.0	13.6	-2.6
514	452221.76	5019071.42	95.50	1	D	A	53.0	11.0	0.0	0.0	0.0	53.6	1.0	-0.3	0.0	0.0	0.0	0.0	13.4	-3.8
523	452207.17	5019108.35	95.50	1	D	A	53.0	5.8	0.0	0.0	0.0	55.6	1.2	-0.4	0.0	0.0	4.1	0.0	2.4	-4.2
527	452208.68	5019104.53	95.50	1	D	A	53.0	6.5	0.0	0.0	0.0	55.5	1.2	-0.4	0.0	0.0	4.1	0.0	2.4	-3.4
534	452209.92	5019101.38	95.50	1	D	A	53.0	4.0	0.0	0.0	0.0	55.6	1.2	-0.4	0.0	0.0	4.1	0.0	2.3	-5.8
547	452212.19	5019095.65	95.50	1	D	A	53.0	9.9	0.0	0.0	0.0	55.4	1.2	-0.4	0.0	0.0	4.1	0.0	2.3	0.3
553	452218.06	5019080.80	95.50	1	D	A	53.0	11.6	0.0	0.0	0.0	54.7	1.1	-0.3	0.0	0.0	4.0	0.0	2.3	2.7
574	452222.03	5019070.73	95.50	1	D	A	53.0	3.2	0.0	0.0	0.0	54.4	1.1	-0.3	0.0	0.0	4.0	0.0	2.3	-5.2
579	452223.24	5019067.67	95.50	1	D	A	53.0	6.5	0.0	0.0	0.0	54.3	1.1	-0.3	0.0	0.0	4.0	0.0	2.3	-1.9
610	452212.17	5019095.70	95.50	1	D	A	53.0	11.7	0.0	0.0	0.0	57.8	1.4	-0.6	0.0	0.0	7.2	0.0	5.6	-6.6
616	452207.92	5019106.44	95.50	1	D	A	53.0	9.0	0.0	0.0	0.0	57.3	1.4	-0.6	0.0	0.0	7.7	0.0	5.7	-9.6
625	452229.67	5019028.01	95.50	0	D	A	53.0	12.5	0.0	0.0	0.0	48.8	0.7	-0.1	0.0	0.0	0.0	0.0	0.0	16.0
636	452229.67	5019028.01	95.50	1	D	A	53.0	12.5	0.0	0.0	0.0	54.8	1.1	-0.3	0.0	0.0	0.0	0.0	6.6	3.3
684	452229.67	5019028.01	95.50	1	D	A	53.0	12.5	0.0	0.0	0.0	54.8	1.1	-0.4	0.0	0.0	6.4	0.0	8.0	-4.6
687	452227.60	5019032.02	95.50	1	D	A	53.0	9.4	0.0	0.0	0.0	54.2	1.1	-0.3	0.0	0.0	4.0	0.0	2.3	1.1
689	452230.66	5019026.09	95.50	1	D	A	53.0	6.7	0.0	0.0	0.0	54.0	1.0	-0.3	0.0	0.0	4.0	0.0	2.3	-1.4
693	452233.47	5019020.66	95.50	1	D	A	53.0	0.6	0.0	0.0	0.0	54.2	1.1	-0.3	0.0	0.0	4.0	0.0	2.3	-7.6
697	452236.99	5019015.65	95.50	0	D	A	53.0	10.5	0.0	0.0	0.0	48.0	0.6	-0.1	0.0	0.0	0.0	0.0	0.0	14.9
701	452236.99	5019015.65	95.50	1	D	A	53.0	10.5	0.0	0.0	0.0	55.5	1.2	-0.4	0.0	0.0	0.0	0.0	8.2	-1.1
734	452236.99	5019015.65	95.50	1	D	A	53.0	10.5	0.0	0.0	0.0	52.6	0.9	-0.2	0.0	0.0	0.0	0.0	19.4	-9.3
742	452236.99	5019015.65	95.50	1	D	A	53.0	10.5	0.0	0.0	0.0	55.6	1.2	-0.4	0.0	0.0	5.7	0.0	9.6	-8.3
748	452236.99	5019015.65	95.50	1	D	A	53.0	10.5	0.0	0.0	0.0	54.1	1.0	-0.3	0.0	0.0	4.0	0.0	2.3	2.3
759	452222.42	5019041.62	95.50	0	D	A	53.0	11.2	0.0	0.0	0.0	49.9	0.7	0.0	0.0	0.0	0.0	0.0	0.0	13.5
767	452219.92	5019046.15	95.50	1	D	A	53.0	4.1	0.0	0.0	0.0	53.6	1.0	-0.3	0.0	0.0	0.0	0.0	4.1	-1.4
772	452220.91	5019044.36	95.50	1	D	A	53.0	1.9	0.0	0.0	0.0	53.7	1.0	-0.3	0.0	0.0	0.0	0.0	4.1	-3.7
789	452223.45	5019039.77	95.50	1	D	A	53.0	9.5	0.0	0.0	0.0	54.0	1.0	-0.3	0.0	0.0	0.0	0.0	5.1	2.6
813	452222.42	5019041.62	95.50	1	D	A	53.0	11.2	0.0	0.0	0.0	53.3	1.0	-0.3	0.0	0.0	0.0	0.0	19.9	-9.9
815	452223.01	5019040.57	95.50	1	D	A	53.0	10.3	0.0	0.0	0.0	54.0	1.0	-0.3	0.0	0.0	7.4	0.0	7.0	-6.0
817	452224.52	5019037.83	95.50	1	D	A	53.0	6.5	0.0	0.0	0.0	54.3	1.1	-0.3	0.0	0.0	4.0	0.0	2.3	-1.8
820	452220.58	5019044.95	95.50	1	D	A	53.0	7.4	0.0	0.0	0.0	54.7	1.1	-0.3	0.0	0.0	4.0	0.0	2.4	-1.4
849	452233.18	5019054.61	95.50	0	D	A	53.0	12.4	0.0	0.0	0.0	51.3	0.8	-0.1	0.0	0.0	0.0	0.0	0.0	13.3
874	452234.53	5019051.05	95.50	1	D	A	53.0	9.9	0.0	0.0	0.0	52.5	0.9	-0.2	0.0	0.0	0.0	0.0	9.8	-0.1
877	452232.00	5019057.70	95.50	1	D	A	53.0	6.5	0.0	0.0	0.0	52.7	0.9	-0.2	0.0	0.0	0.0	0.0	9.8	-3.8
881	452230.65	5019061.26	95.50	1	D	A	53.0	5.0	0.0	0.0	0.0	52.9	0.9	-0.2	0.0	0.0	0.0	0.0	9.8	-5.4
886	452235.63	5019048.15	95.50	1	D	A	53.0	5.6	0.0	0.0	0.0	53.8	1.0	-0.3	0.0	0.0	4.1	0.0	2.3	-2.3
890	452233.74	5019053.14	95.50	1	D	A	53.0	8.5	0.0	0.0	0.0	53.9	1.0	-0.3	0.0	0.0	4.1	0.0	2.3	0.5
895	452231.06	5019060.19	95.50	1	D	A	53.0	7.4	0.0	0.0	0.0	53.8	1.0	-0.3	0.0	0.0	4.1	0.0	2.2	-0.5
901	452244.37	5019012.21	95.50	0	D	A	53.0	9.3	0.0	0.0	0.0	48.2	0.6	-0.1	0.0	0.0	0.0	0.0	0.0	13.5
905	452243.05	5019011.87	95.50	1	D	A	53.0	7.6	0.0	0.0	0.0	55.9	1.2	-0.4	0.0	0.0	0.0	0.0	8.3	-4.4
908	452247.17	5019012.93	95.50	1	D	A	53.0	4.4	0.0	0.0	0.0	56.0	1.2	-0.4	0.0	0.0	0.0	0.0	8.3	-7.8

Line Source, ISO 9613, Name: "Car Movement", ID: "SS_Car_Move"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
918	452244.37	5019012.21	95.50	1	D	A	53.0	9.3	0.0	0.0	0.0	52.1	0.9	-0.2	0.0	0.0	0.0	0.0	15.4	-6.0
940	452244.37	5019012.21	95.50	1	D	A	53.0	9.3	0.0	0.0	0.0	53.7	1.0	-0.3	0.0	0.0	4.0	0.0	2.3	1.5
946	452217.79	5019052.27	95.50	0	D	A	53.0	10.1	0.0	0.0	0.0	50.8	0.8	-0.0	0.0	0.0	0.0	0.0	0.0	11.5
968	452217.64	5019052.74	95.50	1	D	A	53.0	8.9	0.0	0.0	0.0	54.8	1.1	-0.3	0.0	0.0	4.0	0.0	2.4	-0.1
998	452218.99	5019048.22	95.50	1	D	A	53.0	2.4	0.0	0.0	0.0	54.7	1.1	-0.3	0.0	0.0	4.0	0.0	2.4	-6.5
1012	452220.19	5019061.38	95.50	0	D	A	53.0	10.6	0.0	0.0	0.0	51.6	0.8	-0.1	0.0	0.0	0.0	0.0	0.0	11.2
1043	452222.01	5019063.36	95.50	1	D	A	53.0	7.8	0.0	0.0	0.0	53.5	1.0	-0.3	0.0	0.0	0.0	0.0	16.1	-9.5
1057	452220.59	5019061.81	95.50	1	D	A	53.0	10.1	0.0	0.0	0.0	54.4	1.1	-0.3	0.0	0.0	4.0	0.0	2.3	1.6
1068	452249.41	5019015.90	95.50	0	D	A	53.0	7.5	0.0	0.0	0.0	48.9	0.7	-0.0	0.0	0.0	0.0	0.0	0.0	10.9
1074	452249.23	5019015.38	95.50	1	D	A	53.0	6.5	0.0	0.0	0.0	56.0	1.2	-0.4	0.0	0.0	0.0	0.0	8.3	-5.7
1087	452249.41	5019015.90	95.50	1	D	A	53.0	7.5	0.0	0.0	0.0	51.7	0.9	-0.1	0.0	0.0	0.0	0.0	12.8	-4.7
1103	452249.41	5019015.90	95.50	1	D	A	53.0	7.5	0.0	0.0	0.0	53.3	1.0	-0.3	0.0	0.0	4.1	0.0	2.2	0.1

Cadnaa Sample Calculations Leitrim -
Stationary Noise

Receiver

Name: Plane of Window 01

ID: SSOFF_R01_w

X: 452110.96 m

Y: 5019093.26 m

Z: 98.50 m

Point Source, ISO 9613, Name: "RTU4r_9T Casing Outdoor Air", ID: "SS_RTUd_4"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)
2	452146.10	5019057.51	99.27	0	D	A	86.5	0.0	0.0	0.0	0.0	45.0	0.2	-1.6	0.0	0.0	0.0	0.0	0.0	42.9
7	452146.10	5019057.51	99.27	1	D	A	86.5	0.0	0.0	0.0	0.0	49.5	0.3	-2.2	0.0	0.0	10.9	0.0	2.2	25.8

Point Source, ISO 9613, Name: "RTU3r_10T Casing Outdoor Air", ID: "SS_RTUr_3"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)
27	452151.67	5019057.62	99.27	0	D	A	86.5	0.0	0.0	0.0	0.0	45.7	0.2	-1.7	0.0	0.0	0.0	0.0	0.0	42.4
31	452151.67	5019057.62	99.27	1	D	A	86.5	0.0	0.0	0.0	0.0	49.4	0.3	-2.2	0.0	0.0	0.0	0.0	2.1	36.8

Point Source, ISO 9613, Name: "RTU2r_15T Casing Outdoor Air", ID: "SS_RTUd_2"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)
37	452183.69	5019072.00	99.50	0	D	A	86.5	0.0	0.0	0.0	0.0	48.6	0.3	-1.7	0.0	0.0	0.0	0.0	0.0	39.3
68	452183.69	5019072.00	99.50	1	D	A	86.5	0.0	0.0	0.0	0.0	55.7	0.6	-1.3	0.0	0.0	0.0	0.0	3.4	28.1

Point Source, ISO 9613, Name: "RTU6d_17T Casing Outdoor Air", ID: "SS_RTUd_6"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)
75	452150.83	5019023.04	103.50	0	D	A	86.5	0.0	0.0	0.0	0.0	49.2	0.3	-2.2	0.0	0.0	0.0	0.0	0.0	39.2

Point Source, ISO 9613, Name: "RTU5r_16T Casing Outdoor Air", ID: "SS_RTUr_5"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)
91	452162.19	5019029.61	103.50	0	D	A	86.5	0.0	0.0	0.0	0.0	49.3	0.3	-2.2	0.0	0.0	0.0	0.0	0.0	39.1

Point Source, ISO 9613, Name: "RTU1d_8T Casing Outdoor Air", ID: "SS_RTUd_1"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)
125	452192.37	5019070.97	99.12	0	D	A	86.5	0.0	0.0	0.0	0.0	49.5	0.3	-1.8	0.0	0.0	0.0	0.0	0.0	38.5
136	452192.37	5019070.97	99.12	1	D	A	86.5	0.0	0.0	0.0	0.0	55.4	0.6	-1.2	0.0	0.0	0.0	0.0	2.7	29.0

Point Source, ISO 9613, Name: "RTU7d_11T Casing Outdoor Air", ID: "SS_RTUd_7"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)
149	452152.99	5019010.06	103.27	0	D	A	86.5	0.0	0.0	0.0	0.0	50.4	0.4	-2.3	0.0	0.0	4.8	0.0	0.0	33.2

Point Source, ISO 9613, Name: "RTU8r_17T Casing Outdoor Air", ID: "SS_RTUr_8"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)
158	452160.58	5018991.97	103.50	0	D	A	86.5	0.0	0.0	0.0	0.0	52.1	0.4	-2.4	0.0	0.0	4.9	0.0	0.0	31.5
164	452160.58	5018991.97	103.50	1	D	A	86.5	0.0	0.0	0.0	0.0	60.7	1.0	-2.1	0.0	0.0	4.9	0.0	6.0	16.0

Line Source, ISO 9613, Name: "Car Movement", ID: "SS_Car_Move"

Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)
183	452224.33	5019074.70	95.50	0	D	A	53.0	14.2	0.0	0.0	0.0	52.2	0.9	-1.1	0.0	0.0	9.8	0.0	0.0	5.4
187	452212.93	5019098.35	95.50	0	D	A	53.0	14.1	0.0	0.0	0.0	51.2	0.8	-0.5	0.0	0.0	0.0	0.0	0.0	15.6
207	452207.34	5019109.94	95.50	1	D	A	53.0	-6.8	0.0	0.0	0.0	51.5	0.8	-0.5	0.0	0.0	0.0	0.0	4.6	-10.2
232	452220.14	5019083.38	95.50	1	D	A	53.0	11.2	0.0	0.0	0.0	52.8	0.9	-0.5	0.0	0.0	0.0	0.0	8.5	2.4
236	452214.37	5019095.36	95.50	1	D	A	53.0	11.3	0.0	0.0	0.0	52.3	0.9	-0.5	0.0	0.0	0.0	0.0	7.0	4.6
238	452209.47	5019105.52	95.50	1	D	A	53.0	9.6	0.0	0.0	0.0	51.9	0.9	-0.5	0.0	0.0	0.0	0.0	7.0	3.3
241	452228.73	5019065.57	95.50	1	D	A	53.0	6.3	0.0	0.0	0.0	54.7	1.1	-0.4	0.0	0.0	4.4	0.0	2.2	-2.8
244	452226.88	5019069.40	95.50	1	D	A	53.0	6.3	0.0	0.0	0.0	54.6	1.1	-0.4	0.0	0.0	4.4	0.0	2.2	-2.6
248	452224.70	5019073.92	95.50	1	D	A	53.0	7.6	0.0	0.0	0.0	54.4	1.1	-0.4	0.0	0.0	4.4	0.0	2.2	-1.1

Line Source, ISO 9613, Name: "Car Movement", ID: "SS_Car_Move"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
262	452221.46	5019080.65	95.50	1	D	A	53.0	2.3	0.0	0.0	0.0	53.9	1.0	-0.4	0.0	0.0	4.4	0.0	2.2	-5.8
285	452218.93	5019085.91	95.50	1	D	A	53.0	10.0	0.0	0.0	0.0	53.7	1.0	-0.4	0.0	0.0	4.4	0.0	2.2	2.1
287	452214.75	5019094.56	95.50	1	D	A	53.0	7.8	0.0	0.0	0.0	53.5	1.0	-0.5	0.0	0.0	4.4	0.0	2.2	0.1
291	452212.21	5019099.85	95.50	1	D	A	53.0	7.6	0.0	0.0	0.0	53.4	1.0	-0.5	0.0	0.0	4.4	0.0	2.2	0.1
352	452210.96	5019098.76	95.50	0	D	A	53.0	13.9	0.0	0.0	0.0	51.0	0.8	-0.6	0.0	0.0	0.0	0.0	0.0	15.6
362	452219.75	5019076.50	95.50	0	D	A	53.0	13.7	0.0	0.0	0.0	51.8	0.9	-1.2	0.0	0.0	10.3	0.0	0.0	4.9
366	452206.65	5019109.66	95.50	1	D	A	53.0	-0.0	0.0	0.0	0.0	51.5	0.8	-0.5	0.0	0.0	0.0	0.0	4.6	-3.4
427	452217.10	5019083.22	95.50	1	D	A	53.0	10.3	0.0	0.0	0.0	53.9	1.0	-0.4	0.0	0.0	4.4	0.0	2.2	2.2
431	452219.40	5019077.40	95.50	1	D	A	53.0	2.6	0.0	0.0	0.0	54.1	1.0	-0.4	0.0	0.0	4.4	0.0	2.2	-5.7
446	452210.49	5019099.94	95.50	1	D	A	53.0	4.7	0.0	0.0	0.0	53.4	1.0	-0.5	0.0	0.0	4.4	0.0	2.2	-2.9
450	452211.60	5019097.13	95.50	1	D	A	53.0	4.9	0.0	0.0	0.0	53.5	1.0	-0.5	0.0	0.0	4.4	0.0	2.2	-2.8
455	452213.33	5019092.77	95.50	1	D	A	53.0	8.0	0.0	0.0	0.0	53.7	1.0	-0.4	0.0	0.0	4.4	0.0	2.2	0.2
477	452208.67	5019104.56	95.50	1	D	A	53.0	9.8	0.0	0.0	0.0	52.0	0.9	-0.5	0.0	0.0	0.0	0.0	7.0	3.4
480	452213.05	5019093.47	95.50	1	D	A	53.0	11.6	0.0	0.0	0.0	52.4	0.9	-0.5	0.0	0.0	0.0	0.0	8.4	3.3
484	452216.90	5019083.72	95.50	1	D	A	53.0	8.2	0.0	0.0	0.0	52.9	0.9	-0.5	0.0	0.0	0.0	0.0	10.5	-2.7
496	452222.33	5019069.97	95.50	1	D	A	53.0	8.0	0.0	0.0	0.0	54.7	1.1	-0.4	0.0	0.0	4.4	0.0	2.2	-1.1
505	452223.77	5019066.33	95.50	1	D	A	53.0	2.0	0.0	0.0	0.0	54.8	1.1	-0.4	0.0	0.0	4.4	0.0	2.2	-7.2
560	452243.30	5019032.50	95.50	0	D	A	53.0	15.0	0.0	0.0	0.0	54.3	1.1	-0.6	0.0	0.0	7.1	0.0	0.0	6.1
578	452246.69	5019025.75	95.50	1	D	A	53.0	12.1	0.0	0.0	0.0	61.3	1.9	-1.2	0.0	0.0	7.7	0.0	5.7	-10.3
582	452248.80	5019021.57	95.50	1	D	A	53.0	8.3	0.0	0.0	0.0	56.4	1.3	-0.6	0.0	0.0	5.2	0.0	2.4	-3.3
591	452241.34	5019036.39	95.50	1	D	A	53.0	12.2	0.0	0.0	0.0	55.6	1.2	-1.5	0.0	0.0	5.9	0.0	2.3	1.7
615	452233.18	5019054.61	95.50	0	D	A	53.0	12.4	0.0	0.0	0.0	53.2	1.0	-1.1	0.0	0.0	10.2	0.0	0.0	2.0
625	452233.81	5019052.94	95.50	1	D	A	53.0	11.4	0.0	0.0	0.0	55.0	1.1	-0.5	0.0	0.0	5.7	0.0	2.3	0.7
642	452230.79	5019060.88	95.50	1	D	A	53.0	5.0	0.0	0.0	0.0	54.7	1.1	-0.5	0.0	0.0	5.7	0.0	2.3	-5.4
652	452229.67	5019028.01	95.50	0	D	A	53.0	12.5	0.0	0.0	0.0	53.6	1.0	-0.6	0.0	0.0	7.6	0.0	0.0	3.8
661	452232.26	5019023.00	95.50	1	D	A	53.0	8.1	0.0	0.0	0.0	56.4	1.3	-0.5	0.0	0.0	4.9	0.0	2.4	-3.4
665	452227.40	5019032.40	95.50	1	D	A	53.0	8.9	0.0	0.0	0.0	56.1	1.2	-0.5	0.0	0.0	4.9	0.0	2.4	-2.3
701	452222.42	5019041.62	95.50	0	D	A	53.0	11.2	0.0	0.0	0.0	52.8	0.9	-0.9	0.0	0.0	9.6	0.0	0.0	1.7
707	452221.96	5019042.47	95.50	1	D	A	53.0	5.0	0.0	0.0	0.0	55.8	1.2	-0.4	0.0	0.0	4.9	0.0	2.4	-5.9
710	452224.17	5019038.47	95.50	1	D	A	53.0	7.8	0.0	0.0	0.0	55.9	1.2	-0.4	0.0	0.0	5.0	0.0	2.4	-3.3
723	452219.49	5019046.93	95.50	1	D	A	53.0	0.1	0.0	0.0	0.0	55.8	1.2	-0.4	0.0	0.0	0.0	0.0	2.3	-5.9
725	452219.99	5019046.03	95.50	1	D	A	53.0	0.2	0.0	0.0	0.0	55.8	1.2	-0.4	0.0	0.0	4.4	0.0	2.4	-10.3
733	452220.19	5019061.38	95.50	0	D	A	53.0	10.6	0.0	0.0	0.0	52.1	0.9	-1.6	0.0	0.0	12.1	0.0	0.0	-0.0
745	452222.11	5019063.47	95.50	1	D	A	53.0	7.6	0.0	0.0	0.0	55.0	1.1	-0.4	0.0	0.0	0.0	0.0	2.3	2.6
764	452218.24	5019059.25	95.50	1	D	A	53.0	7.5	0.0	0.0	0.0	55.3	1.2	-0.4	0.0	0.0	0.0	0.0	2.3	2.2
770	452217.79	5019052.27	95.50	0	D	A	53.0	10.1	0.0	0.0	0.0	52.2	0.9	-1.4	0.0	0.0	11.8	0.0	0.0	-0.4
775	452216.57	5019056.36	95.50	1	D	A	53.0	2.2	0.0	0.0	0.0	55.5	1.2	-0.4	0.0	0.0	0.0	0.0	2.3	-3.4
788	452217.59	5019052.94	95.50	1	D	A	53.0	7.4	0.0	0.0	0.0	55.6	1.2	-0.4	0.0	0.0	0.0	0.0	2.3	1.6
800	452218.80	5019048.85	95.50	1	D	A	53.0	4.9	0.0	0.0	0.0	55.8	1.2	-0.4	0.0	0.0	0.0	0.0	2.3	-1.1
806	452236.99	5019015.65	95.50	0	D	A	53.0	10.5	0.0	0.0	0.0	54.4	1.1	-0.6	0.0	0.0	6.4	0.0	0.0	2.1
814	452236.81	5019015.90	95.50	1	D	A	53.0	10.2	0.0	0.0	0.0	56.6	1.3	-0.6	0.0	0.0	4.9	0.0	2.4	-1.5
841	452244.37	5019012.21	95.50	0	D	A	53.0	9.3	0.0	0.0	0.0	54.9	1.1	-0.6	0.0	0.0	6.0	0.0	0.0	0.9
870	452245.67	5019012.54	95.50	1	D	A	53.0	7.0	0.0	0.0	0.0	56.8	1.3	-0.7	0.0	0.0	4.9	0.0	2.6	-5.0
895	452249.41	5019015.90	95.50	0	D	A	53.0	7.5	0.0	0.0	0.0	55.0	1.1	-0.6	0.0	0.0	5.9	0.0	0.0	-1.1
918	452249.38	5019015.83	95.50	1	D	A	53.0	7.3	0.0	0.0	0.0	56.6	1.3	-0.6	0.0	0.0	5.1	0.0	2.4	-4.5