

GENERAL NOTES

1. THE CONTRACTOR IS TO OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY BEFORE COMMENCING CONSTRUCTION.
2. THE CONTRACTOR IS RESPONSIBLE FOR ALL LAYOUT.
3. THE CONTRACTOR IS TO DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT AND ASSUME ALL RESPONSIBILITY FOR EXISTING UTILITIES WHETHER OR NOT SHOWN ON THESE DRAWINGS. IF THERE IS ANY DISCREPANCY THE CONTRACTOR IS TO NOTIFY THE ENGINEER PROMPTLY.
4. RESTORE ALL TRENCHES AND SURFACES OF PUBLIC ROAD ALLOWANCES TO CONDITION EQUAL OR BETTER THAN ORIGINAL CONDITION AND TO THE SATISFACTION OF THE CITY AUTHORITIES.
5. EXCAVATE AND DISPOSE OF ALL EXCESS EXCAVATED MATERIAL, SUCH AS ASPHALT, CURBING AND DEBRIS, OFF SITE AS DIRECTED BY THE ENGINEER AND THE CITY.
6. TOPSOIL TO BE STRIPPED AND STOCKPILED FOR REHABILITATION. CLEAN FILL TO BE PLACED IN FILL AREAS AND COMPACTED TO 95% STANDARD PROCTOR DENSITY.
7. CONTRACTOR TO MINIMIZE THE ACTUAL LIMITS OF REMOVALS AND DISTURBED AREA WHEREVER POSSIBLE, AND SHALL MAKE THEIR OWN JUDGEMENT AND ACCOUNT FOR ALL MATERIAL AND LABOUR REQUIRED FOR ADEQUATELY REINSTATING THE AREA TO PRE-CONSTRUCTION CONDITIONS OR BETTER, AND BEAR THE COST OF THE SAME. NO ADDITIONAL PAYMENT WILL BE MADE FOR REINSTATEMENT WORK NOT SHOWN ON THE CONTRACT DRAWING AS A DIRECT RESULT FROM CONSTRUCTION.
8. ALL DISTURBED AREAS TO BE RESTORED TO ORIGINAL CONDITION OR BETTER UNLESS OTHERWISE SPECIFIED.
9. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL TRAFFIC CONTROL AND DELINEATORS, MARKERS AND BARRIERS.
10. DO NOT ALTER GRADING OF THE SITE WITHOUT PRIOR APPROVAL OF THE ENGINEER/CITY.
11. ALL ROADWAY, PARKING LOT, AND GRADING WORKS TO BE UNDERTAKEN IN ACCORDANCE WITH CITY STANDARDS AND SPECIFICATIONS. THE CONTRACTOR IS TO PROVIDE POSITIVE DRAINAGE AWAY FROM THE BUILDING.
12. CONTACT THE CITY FOR INSPECTION OF ROUGH GRADING OF PARKING LOTS, ROADWAYS AND LANDSCAPED AREAS PRIOR TO PLACEMENT OF ASPHALT AND TOPSOIL. ALL DEFICIENCIES NOTED SHALL BE RECTIFIED TO THE CITY'S SATISFACTION PRIOR TO PLACEMENT OF ANY ASPHALT, TOPSOIL, SEED & MULCH AND/OR SOD.
13. ALL DIMENSIONS AND INVERTS MUST BE VERIFIED PRIOR TO CONSTRUCTION, IF THERE IS ANY DISCREPANCY THE CONTRACTOR IS TO NOTIFY THE ENGINEER PROMPTLY.
14. ELECTRICAL, GAS, TELEPHONE AND TELEVISION SERVICE LOCATIONS ARE SUBJECT TO THE INDIVIDUAL AGENCY:
 - ELECTRICAL SERVICE - HYDRO ONE,
 - GAS SERVICE - ENBRIDGE,
 - TELEPHONE SERVICE - BELL CANADA,
 - TELEVISION SERVICE - ROGERS.
15. INSTALLATION TO BE IN ACCORDANCE WITH CURRENT CODES AND STANDARDS OF APPROVAL AGENCIES HYDRO ONE, BELL AND THE CITY.
16. CONTRACTOR TO ENSURE ALL APPLICABLE OPS SPECIFICATIONS ARE FOLLOWED DURING CONSTRUCTION
17. ALL PROPOSED CURB TO BE CONCRETE BARRIER CURB UNLESS OTHERWISE SPECIFIED.
18. THIS PLAN MUST BE READ IN CONJUNCTION WITH THE GEOTECHNICAL INVESTIGATION COMPLETED BY PATERSON GROUP, DATED JULY 9, 2025.

ELEVATION NOTES

1. THE ORIGINAL TOPOGRAPHY, GROUND ELEVATION AND SURVEY DATA SHOWN ARE SUPPLIED FOR INFORMATION PURPOSES ONLY, AND IMPLY NO GUARANTEE OF ACCURACY. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY ALL INFORMATION SHOWN.
2. REFER TO EGIS SURVEYING INC. DRAWING #CCO-25-0415 OTTAWA ST INTEGRATION DATA NOTE. BEARING ARE UTM GRID BEARINGS, DERIVED BY REAL TIME NETWORK GNSS OBSERVATIONS ON OBSERVED REFERENCE POINTS 'A' AND 'B' SHOWN ON DRAWING #CCO-25-0415 OTTAWA ST, AND ARE REFERRED TO THE NAD83 CSRS (2010) MTM ZONE 9 COORDINATE SYSTEM.
3. REFER TO EGIS SURVEYING INC. DRAWING #CCO-25-0415 OTTAWA ST VERTICAL DATUM NOTES. TOPOGRAPHIC SURVEY ELEVATIONS ARE GEODETIC (CGVD 2013) AND ARE DERIVED FROM GNSS OBSERVATIONS REFERENCED TO THE CGG 2013 GEOID MODEL. PLEASE NOTE, OBSERVED LOCAL DIFFERENCE BETWEEN THIS DATUM AND CGVD28:78 IS APPROXIMATELY -0.31M. CARE SHOULD BE TAKEN TO UNDERSTAND THE VERTICAL DATUM USED WHEN REVIEWING THIS AND OTHER RELATED GEOGRAPHIC INFORMATION.
1. RESTORE ANY TRENCHES AND DISTURBED SURFACES OF PUBLIC ROAD ALLOWANCES TO CONDITION EQUAL OR BETTER THAN ORIGINAL CONDITION AND TO THE SATISFACTION OF CITY AUTHORITIES.
2. CONCRETE CURB AND SIDEWALK SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STANDARD SC1.1 (BARRIER CURB), SC2 (MONOLITHIC SIDEWALK & CURB), AND SC4 (STANDARD SIDEWALK) AS NOTED. PROVISIONS SHALL BE MADE FOR CURB DEPRESSIONS AT SIDEWALKS, DRIVEWAYS AND RAMPS.
3. PAVEMENT REINSTATEMENT TO BE ACCORDANCE WITH CITY OF OTTAWA DETAIL R10 WITHIN THE CITY ROW AS WELL AS WITHIN PRIVATE LAND.
4. GRANULAR "A" SHALL BE PLACED TO A MINIMUM THICKNESS OF 300mm AROUND ALL STRUCTURES WITHIN PAVEMENT AREA.
5. ALL GRANULAR FOR ROADS SHALL BE COMPACTED TO A MINIMUM OF 100% SPMDD.
6. ASPHALT WEAR COURSE SHALL NOT BE PLACED UNTIL THE VIDEO INSPECTION OF SEWERS & NECESSARY REPAIRS HAVE BEEN CARRIED OUT TO THE SATISFACTION OF THE ENGINEER.
7. SUB- EXCAVATE SOFT AREAS AND FILL WITH GRANULAR 'B' COMPACTED IN MAXIMUM 300mm LIFTS.

SEWER NOTES:

1. CONSTRUCT ALL SEWERS, CATCH BASINS, MANHOLES AND APPURTENANCES IN ACCORDANCE WITH OPSD STANDARDS AND SPECIFICATIONS, AS WELL AS CITY.
2. SEWER TRENCHING AND BEDDING SHALL CONFORM TO OPSD 802.010 AND 802.013 UNLESS NOTED OTHERWISE.
 - 2.1. BEDDING SHALL BE A MINIMUM 150mm OF GRANULAR "A", COMPACTED TO MINIMUM 95% STANDARD PROCTOR DRY DENSITY. CLEAR STONE BEDDING SHALL NOT BE PERMITTED.
 - 2.2. SUB-BEDDING, IF REQUIRED SHALL CONSIST OF 450mm OF COMPACTED GRANULAR "B" TYPE 1.
 - 2.3. BACKFILL TO AT LEAST 300mm ABOVE TOP OF PIPE WITH GRANULAR "A" OR GRANULAR "B" TYPE 1.
 - 2.4. TO MINIMIZE DIFFERENTIAL FROST HEAVING, TRENCH BACKFILL (FROM PAVEMENT SUBGRADE TO 2.0 METRES BELOW FINISHED GRADE) SHALL MATCH EXISTING SOIL CONDITIONS.
3. SANITARY SEWERS AND CONNECTIONS 150mmØ AND SMALLER TO BE PVC SDR-28.
4. SEWERS AND CONNECTIONS 200mmØ AND LARGER TO BE PVC SDR-35. BEDDING TO BE TYPE "B" EXCEPT AT RISERS, UNLESS NOTED OTHERWISE.
5. SEWERS AND WATERMAINS LOCATED PARALLEL TO EACH OTHER SHOULD BE CONSTRUCTED IN SEPARATE TRENCHES. WHEN IT IS IMPOSSIBLE OR NOT PRACTICAL TO MAINTAIN VERTICAL AND/OR HORIZONTAL SEPARATION PER MECP STANDARDS, ALL SEWERS SHOULD BE CONSTRUCTED OF WATERMAIN QUALITY PIPE, PRESSURE TESTED IN PLACE AT A PRESSURE OF 350 kPa (50 psi) WITHOUT LEAKAGE USING THE TESTING METHODOLOGY IN ONTARIO PROVINCIAL STANDARD SPECIFICATION 701 (OPSS 701) OF THE OPS.
6. INSULATE ALL STORM AND SANITARY SEWERS/SERVICES THAT HAVE LESS THAN 2.0m OF COVER WITH THERMAL INSULATION AS PER CITY DETAIL S35, OPTION A.
7. SUPPLY AND INSTALL ALL PIPING AND APPURTENANCES AS SHOWN AND DETAILED TO WITHIN 1.0m OF BUILDING. ALL ENDS OF SERVICES TO BE PROPERLY CAPPED AND LOCATED WITH 2"x4"X8' LONG MARKER.
8. CONTRACTOR TO TELEVISE (CCTV) ALL PROPOSED SEWERS ON SITE, OUTLET CONNECTION TO THE MAIN AND PIPES 150mmØ OR GREATER PRIOR TO BASE COURSE ASPHALT. UPON COMPLETION OF CONTRACT, THE CONTRACTOR IS RESPONSIBLE TO FLUSH AND CLEAN ALL SEWERS & APPURTENANCES.
9. DYE TESTING IS TO BE COMPLETED ON SANITARY SERVICE TO CONFIRM PROPER CONNECTION TO SANITARY SEWER MAIN.
10. CONSTRUCT ALL WATERMAINS AND APPURTENANCES IN ACCORDANCE WITH CITY STANDARDS AND SPECIFICATIONS.
11. WATERMAINS AND/OR WATER SERVICES ARE TO HAVE A MINIMUM COVER OF 2.4m. INSULATE ALL WATERMAINS AND SERVICES THAT HAVE LESS THAN 2.4m COVER WITH THERMAL INSULATION AS PER CITY DETAIL W22.
12. IF THE WATERMAIN MUST BE DEFLECTED TO MEET ALIGNMENT, ENSURE THAT THE AMOUNT OF DEFLECTION USED IS EQUAL TO OR LESS THAN THAT WHICH IS RECOMMENDED BY THE MANUFACTURER AND CITY OF OTTAWA STANDARDS W25 AND W25.2.
13. THERMAL INSULATION OF WATERMAINS AT SWM AREA CROSSING AS PER CITY DETAIL W21.
14. CONCRETE THRUST BLOCKS TO CONFORM TO CITY STANDARD W25.3.
15. WATERMAIN TO BE CLASS 150 DR-18 PVC OR APPROVED EQUIVALENT.
16. ALL PVC WATERMAIN SHALL BE INSTALLED WITH A 10 GAUGE STRANDED COPPER TWU OR RWU TRACER WIRE IN ACCORDANCE WITH CITY STANDARD W36.
17. FIRE HYDRANTS SHALL CONFORM TO CITY STANDARD W18 AND W19.
18. VALVE BOXES SHALL CONFORM TO CITY STANDARD W24.
19. VALVES TO BE INSTALLED WITH VALVE BOXES AS PER CITY STANDARD W24.
20. AS PER CITY GUIDELINE, THE MINIMUM VERTICAL CLEARANCE BETWEEN WATERMAIN/WATER SERVICE AND SEWER/UTILITY IS 0.25m FOR CROSSING OVER THE SEWER, AS PER CITY DETAIL W25.2 FOR CROSSING UNDER SEWER, THE MINIMUM VERTICAL CLEARANCE IS 0.5m AS PER CITY DETAIL W25. FOR CROSSING UNDER SEWER, ADEQUATE STRUCTURAL SUPPORT FOR THE SEWERS IS REQUIRED TO PREVENT EXCESSIVE DEFLECTION OF JOINTS AND SETTLING. THE LENGTH OF WATER PIPE SHALL BE CENTERED AT THE POINT OF CROSSING SO THAT THE JOINTS WILL BE EQUIDISTANT AND AS FAR AS POSSIBLE FROM THE SEWER.

STM STRUCTURE TABLE

NAME	RIM ELEV.	INVERT IN	INVERT OUT	DESCRIPTION
LSCB1-2	94.70	NW94.350	S94.347	PER CITY STANDARD S30
LSCB1-3	94.83		SE94.463	PER CITY STANDARD S31
LSCB2-2	94.70	NW94.350	E94.350	PER CITY STANDARD S30
LSCB2-3	94.83	NW94.470	SE94.463	PER CITY STANDARD S30
LSCB2-4	94.92		SE94.551	PER CITY STANDARD S31
OGS1-1	95.02	NW93.832	SE93.807	STORMCEPTOR EFO4 60% TSS REMOVAL
OGS2-1	94.89	NW93.698	SE93.673	STORMCEPTOR EFO4 60% TSS REMOVAL


WATER COVER TABLE

LOCATION	STATION	FINISHED GRADE	TOP OF PIPE	COV
A - STORAGE TANK	0+100.00	95.09	92.74	4.1
45° BEND	0+154.08	95.18	92.78	2.4
45° BEND	0+156.39	95.19	92.79	2.4
PHASE 1 BUILDING	0+158.32	95.21	92.81	2.4
B - STORAGE TANK	0+200.00	95.11	90.71	4.1
PHASE 2 BUILDING	0+203.03	95.15	92.75	2.4
C - STORAGE TANK	0+300.00	95.03	90.63	4.1
150mmØX150mmØ TEE	0+308.26	94.92	92.52	2.4
150mmØ VALVE	0+308.97	94.92	92.52	2.4
HYD2	0+309.72	94.91	92.51	2.4
- 150mmØX150mmØ TEE	0+400.00	94.92	92.52	2.4
150mmØ VALVE	0+437.20	94.96	92.56	2.4
HYD1	0+437.94	94.97	92.57	2.4

MAIN ELEVATION AT STORAGE TANK AS PER BOYD BROS 45,000L FIRE
SHOP DRAWING. PROVIDE VERTICAL BENDS AS REQUIRED TO MEET
ET COVER AT BUILDINGS, HYDRANTS, VALVES, BENDS, AND TEES.

The diagram is a site plan showing the location of the 'SUBJECT SITE'. The site is bounded by the 'SMITHS FALLS RAIL CORRIDOR' to the north, 'OTTAWA STREET' to the south, and 'EAGLESON ROAD' to the east. The 'SUBJECT SITE' is a triangular area located between these three features. The 'SMITHS FALLS RAIL CORRIDOR' is depicted as a line with a series of vertical and diagonal hatching. The 'OTTAWA STREET' is a straight line running roughly north-south. The 'EAGLESON ROAD' is a straight line running roughly east-west. The 'SUBJECT SITE' is a triangle with its apex at the intersection of the rail corridor and Ottawa Street, and its base along Eagleson Road.

END

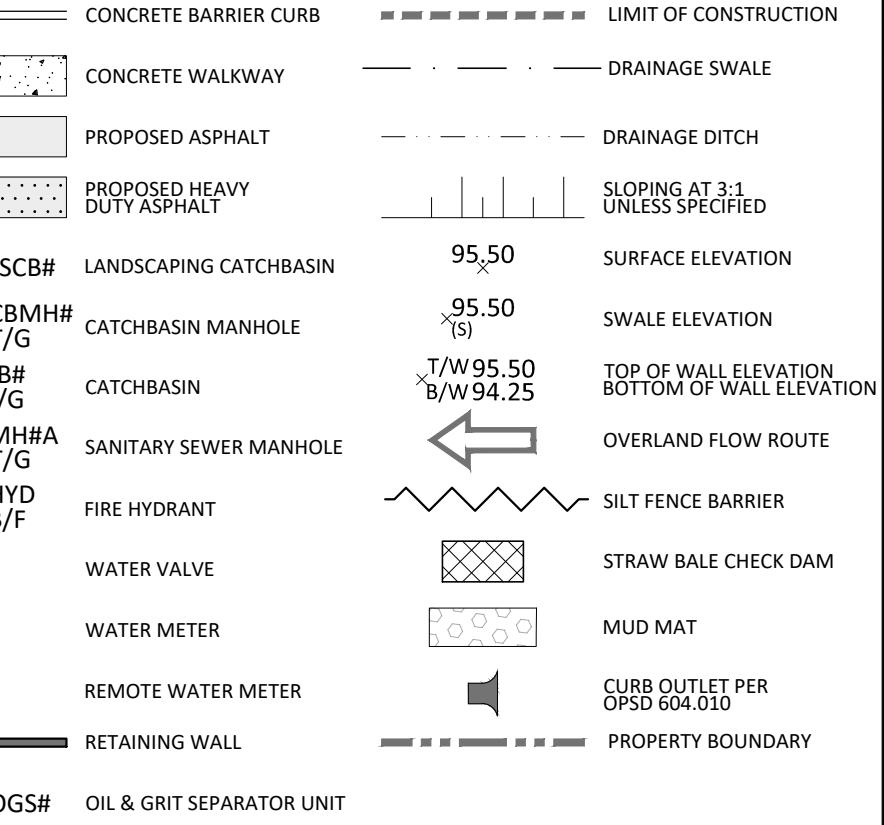

FOR REVIEW ONLY
NOT FOR CONSTRUCTION

REISSUED FOR SITE PLAN CONTROL		SEP. 16, 2025
REISSUED FOR SITE PLAN CONTROL		JUN. 06, 2025
ISSUED FOR SITE PLAN CONTROL		OCT. 17, 2024
ISSUED FOR COORDINATION		OCT. 11, 2024
Revisions		Date
Check and verify all dimensions before proceeding with the work		Do not scale drawings

SCALE 1 : 300

5 10 15 20 25 30 Metres

115 Walgreen Road, R.R.3
Carp, ON K0A 1L0
Tel: 613-836-2184
Fax: 613-836-3742
www.egis-group.com

99117756 CANADA INC.
411 LEGGET DRIVE, SUITE 710
OTTAWA, ON K2B 5E2

OTTAWA, ON K2K 3C9

DISTILLERY & WAREHOUSE

5923 OTTAWA STREET

ng Title:

SITE SERVICING PLAN

1:300	Project Number: CCO-25-0415
By: FV	
ected By: AG	Drawing Number: C102
ned By: AG	