

2280 CITY PARK DRIVE, OTTAWA - ONTARIO



ELECTRICAL DRAWING LIST	
DRAWING NUMBER	DESCRIPTION
E000	ELECTRICAL DRAWING LIST
E100	ELECTRICAL SITE PLAN

**RIO CAN**  
REAL ESTATE INVESTMENT TRUST



**Smith + Andersen**  
1600 Carling Avenue Suite 530 Ottawa Ontario K1Z 1G3  
t 613 230 1186 f 613 230 2598 [smithandandersen.com](http://smithandandersen.com)

[illegible]

08/21/25	ISSUED FOR SPRA
07/31/25	ISSUED FOR 75% CD
date	revision

is the responsibility of the appropriate contractor to check and verify all dimensions on site and report all errors and/or omissions to the engineer.


Robin Architecture  
corporated

1 Parrilla Street  
Toronto, Ontario  
Canada K1S 3K7

613-238-7200  
613-235-2005

mail@hobinarc.com

obinarc.com



**HOBIN**  
ARCHITECTURE

**PROJECT**  
**RIOCAN - CITY**  
**PARK PHASE 2**  
**200 FRONTIER PATH**  
**PRIVATE**

## ELECTRICAL DRAWING LIST

AWN	DATE 07/31/25	SCALE NO SCALE
-----	------------------	-------------------

ORTH ARROW	PROJECT
	16550-004


	18652.004
	DRAWING NO.

2025-08-21  
M. M. LEONG  
26408762

16652.004







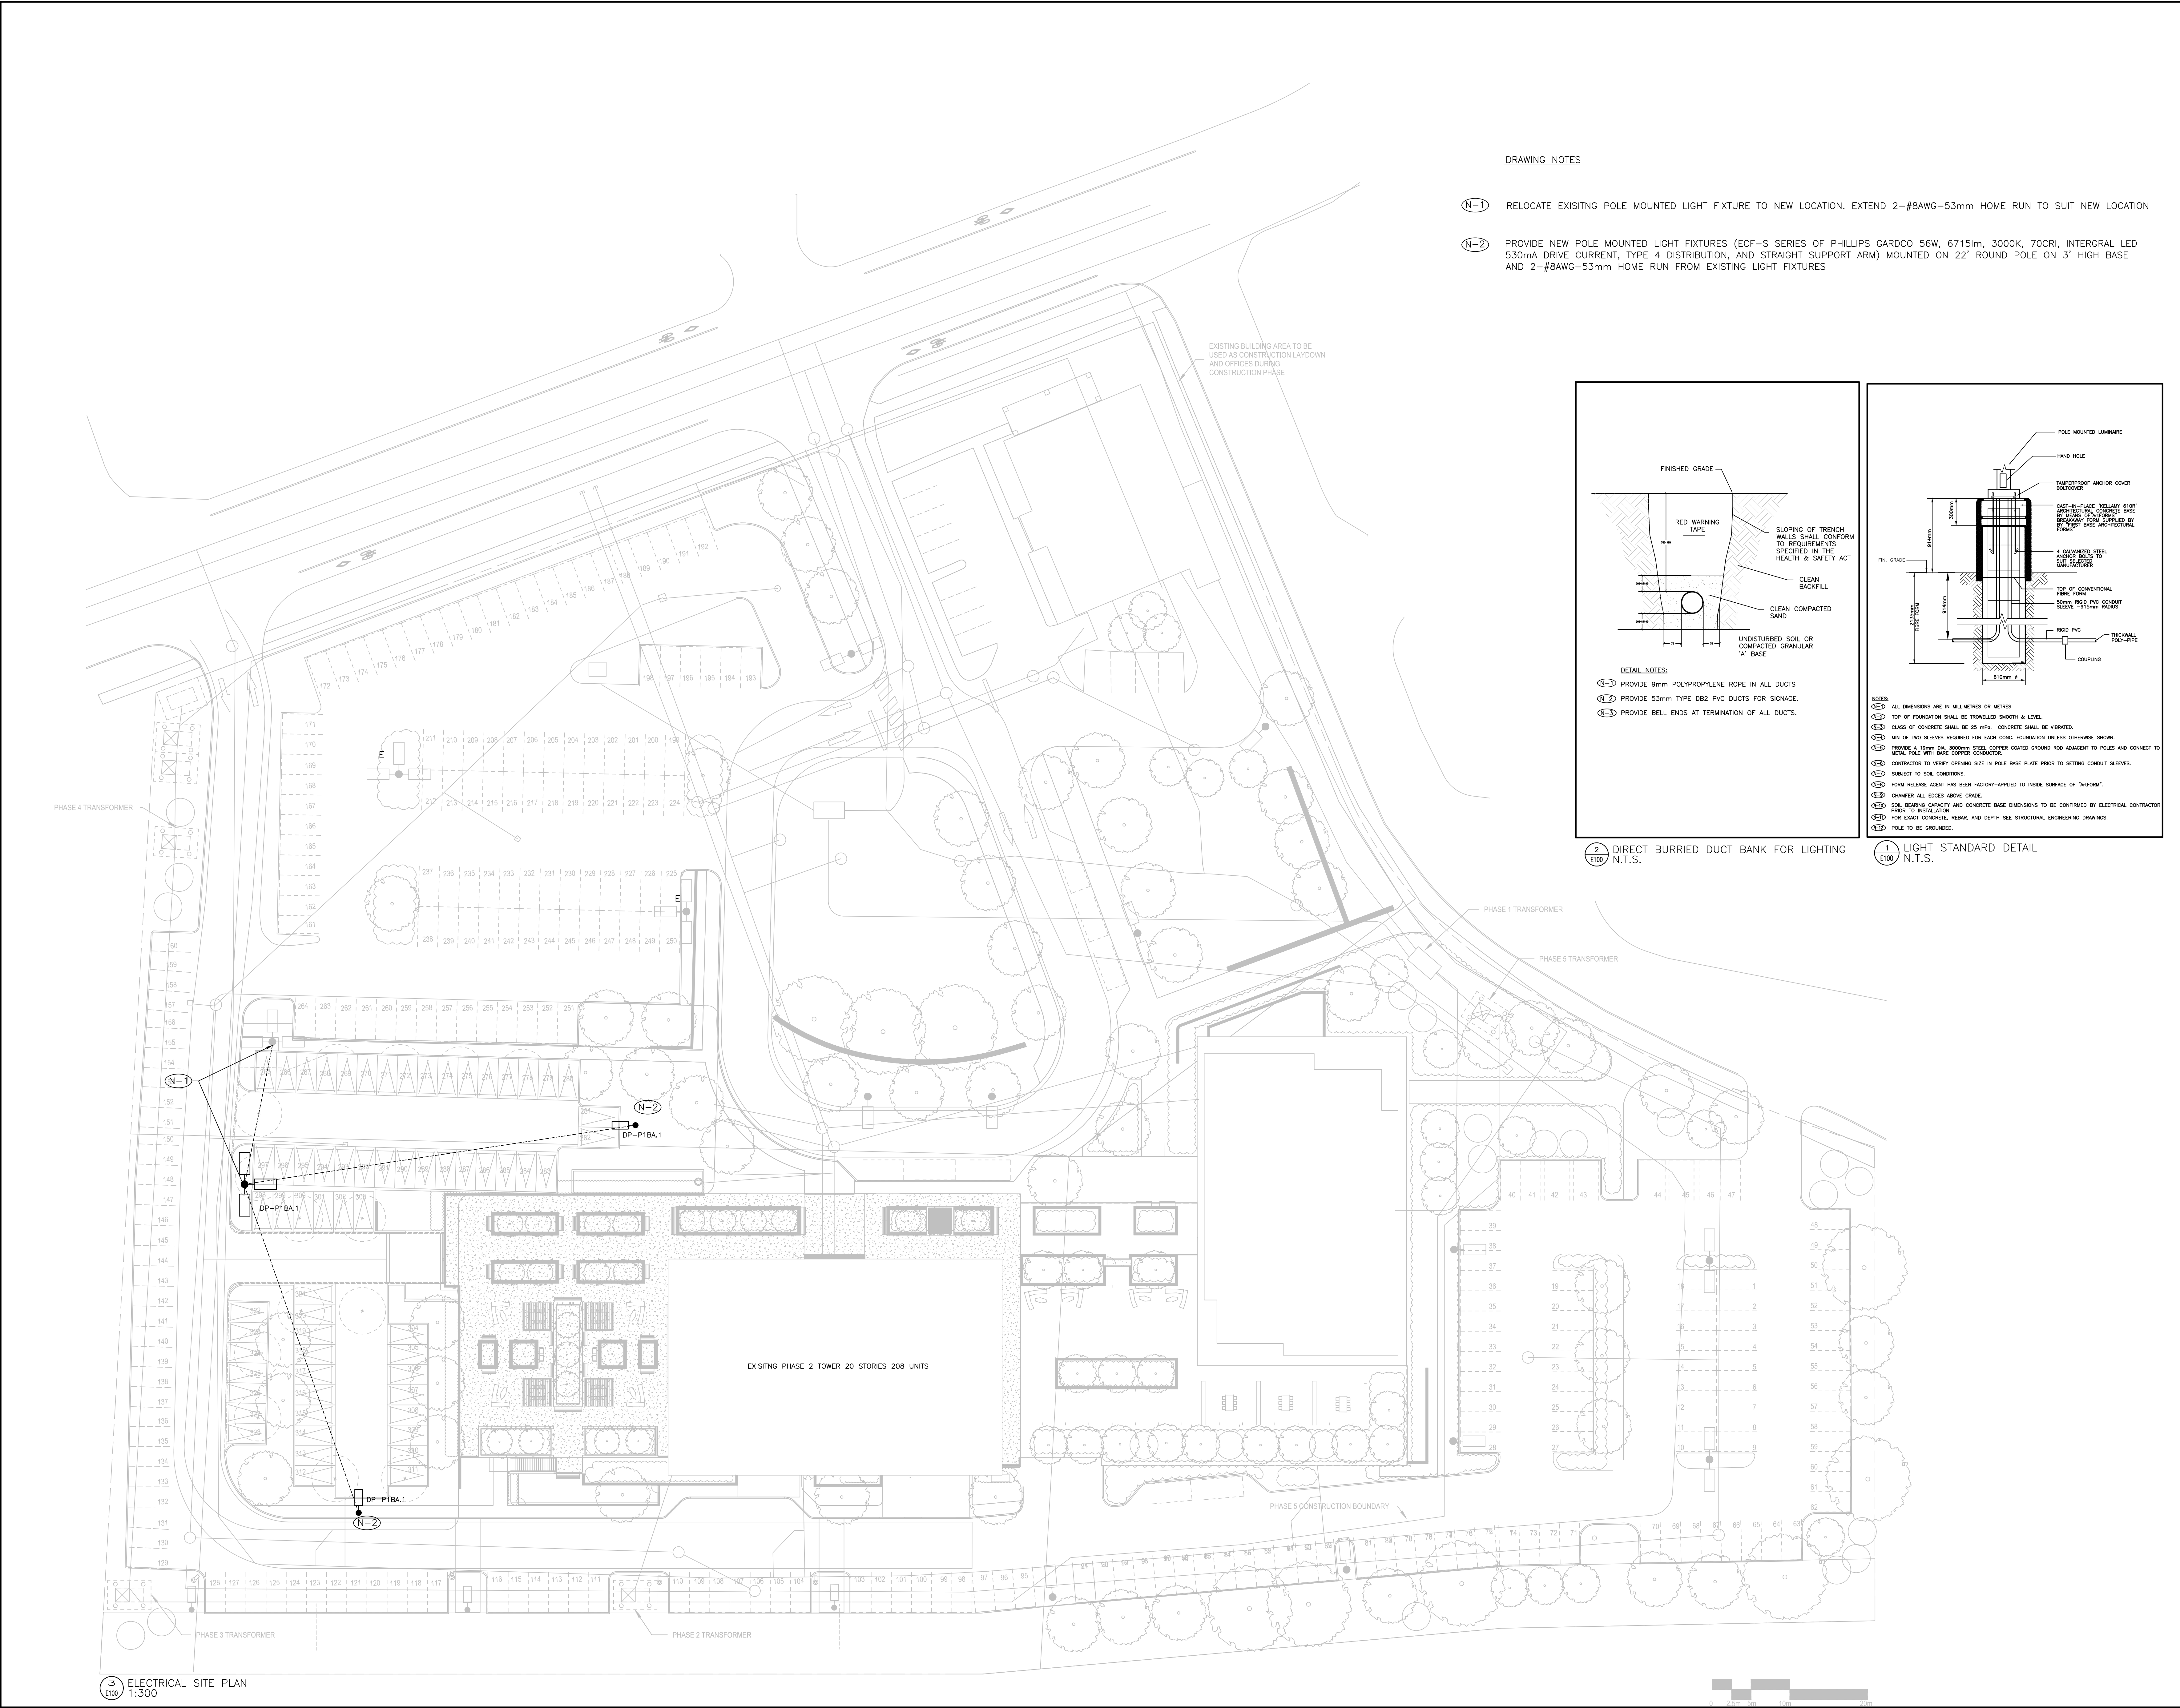

DRAWING NOTES

- N-1 RELOCATE EXISTING POLE MOUNTED LIGHT FIXTURE TO NEW LOCATION. EXTEND 2-#8AWG-53mm HOME RUN TO SUIT NEW LOCATION
- N-2 PROVIDE NEW POLE MOUNTED LIGHT FIXTURES (ECF-S SERIES OF PHILLIPS GARDCO 56W, 6715lm, 3000K, 70CRI, INTERGRAL LED 530mA DRIVE CURRENT, TYPE 4 DISTRIBUTION, AND STRAIGHT SUPPORT ARM) MOUNTED ON 22' ROUND POLE ON 3' HIGH BASE AND 2-#8AWG-53mm HOME RUN FROM EXISTING LIGHT FIXTURES

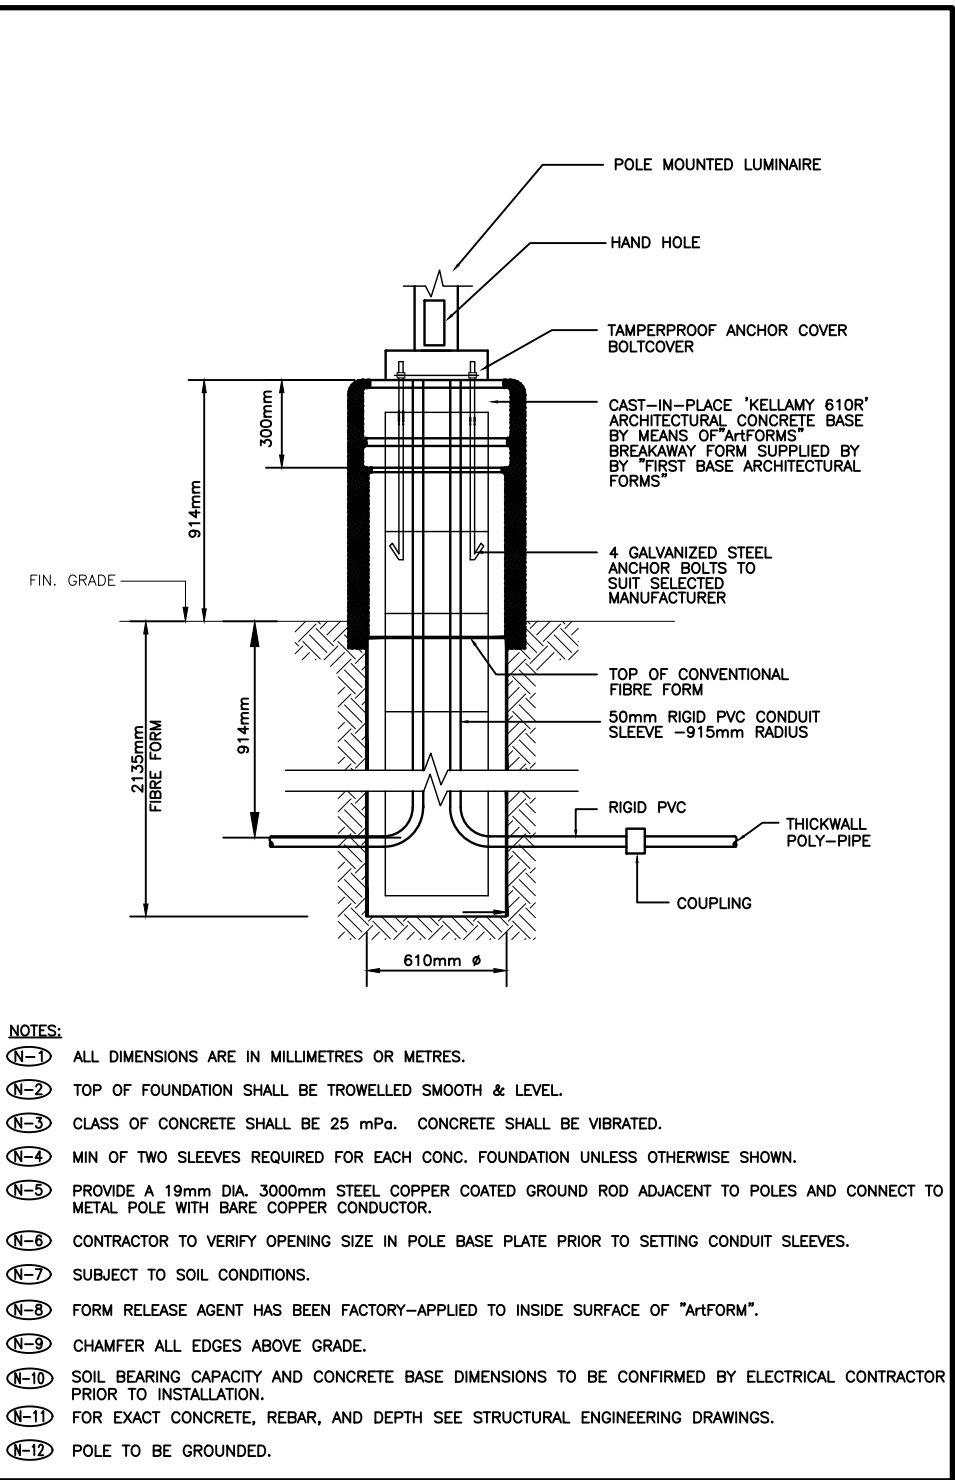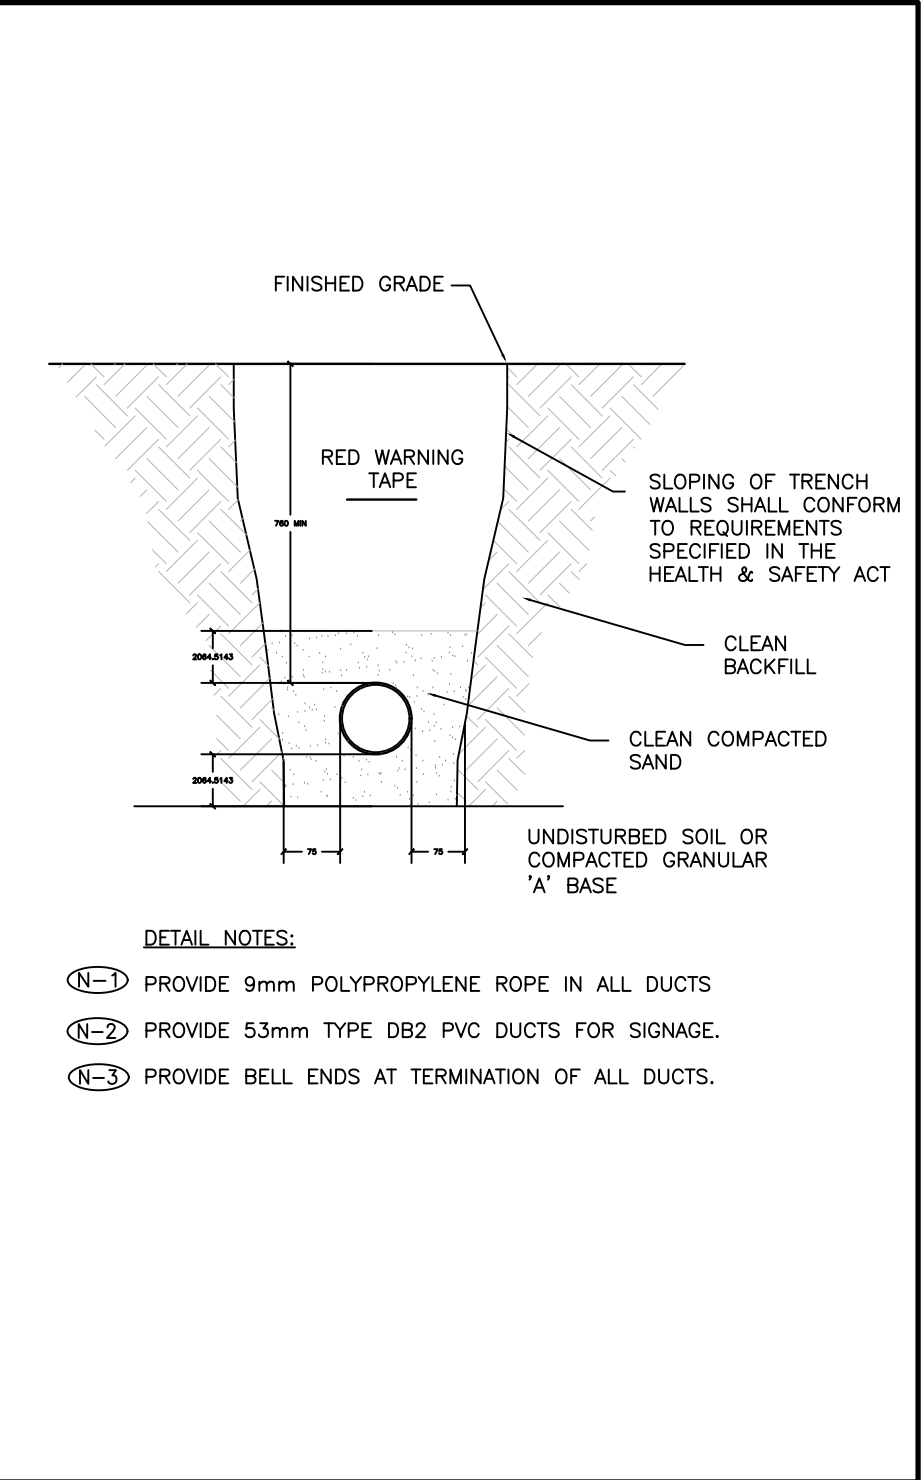

2 DIRECT BURRIED DUCT BANK FOR LIGHTING N.T.S.

1 LIGHT STANDARD DETAIL N.T.S.

no.	date	revision
1	08/21/25	ISSUED FOR SPRA
0	07/31/25	ISSUED FOR 75%

It is the responsibility of the appropriate contractor to check and verify all dimensions on site and report all errors and/or omissions to the engineer.  
All contractors must comply with all  
Do not scale drawings.  
This drawing may not be used for construction until signed.  
Copyright reserved.