

Stantec Consulting Ltd.
1505 Laperriere Avenue
Ottawa ON Canada
K1Z 7T1
Tel. 613.722.4420
Fax. 613.722.2799
www.stantec.com

Stantec
Copyright Reserved

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing. Any errors or omissions shall be reported to Stantec Consulting Ltd. without delay.
The Copyrights to all designs and drawings are the property of Stantec Consulting Ltd. Reproduction or use for other than that authorized by Stantec Consulting Ltd. is forbidden.

Legend

- PROPOSED CULVERT
- PROPOSED DITCH
- PROPOSED HOUSE ENVELOPE AND LOT NUMBER, PROPOSED ELEVATION TO BE IMPLEMENTED AROUND ALL SIDES OF THE HOUSE ENVELOPES.
- [16] LOTS NUMBERS INDICATED IN SQUARE BRACKETS REFER TO REGISTERED LOTS FOR PHASE 2
- [Hatched Area] PARTIALLY-RAISED LEACHING BED WITH NATIVE MANTLE (8 RUNS OF 15m) MIN. FROM ANY STRUCTURES MIN. 6m FROM ANY PROPERTY LINES. (REFER: J.D. PATTERSON AND ASSOC. REPORT GRSS-05 DATED MAY 12, 2003. REVISED APRIL 04, 2005.)
- [Hatched Area] SPARE AREA FOR PARTIALLY-RAISED LEACHING BED (8 RUNS OF 15m) AND ELEVATIONS
- PROPOSED DRILLED WELL
- ◆ HAND AUGER HOLE LOCATION
- ◇ TEST WELL LOCATION
- DRAINAGE EASEMENT
- PROPOSED LOT CORNER ELEVATION
- EXISTING LOT CORNER ELEVATION
- ×(0.02.85) PROPOSED G₁ DITCH ELEVATION
- ×(100.72) 100 YEAR FLOOD ELEVATION
- FILL TO PROVIDE DITCH BACK SLOPE
- CULVERT IDENTIFICATION
- GW=101.0m GROUND WATER ELEVATION (MARCH 17, 2005)
- USF(MIN) 101.80 LOWEST USF BASED ON GROUND WATER ELEVATIONS. SEE NOTES 4 & 5
- 100yr HGL ELEVATION
- NOISE FENCE


Notes

1. ELEVATIONS AT HOUSES ARE BASED ON PARTIALLY RAISED TLE BEDS ON GRAVITY SYSTEM. IF PUMPING IS USED HOUSE ELEVATIONS CAN BE LOWERED. SEPTIC SYSTEM LAYOUT TO BE REVISED ON A LOT BY LOT BASIS.
- CAUTION: LOWERING OF FOUNDATIONS BELOW GROUND WATER TABLE WILL RESULT IN EXCESSIVE OPERATION OF SUMP PUMPS.
2. REFER TO GP-4 FOR GRADING DETAILS.
3. ALL DITCHES SHALL BE c/w 80mm TOPSOIL SEED AND MULCH.
4. GW - RECORDED GROUND WATER ELEVATION. UNDERSIDE OF FOOTING (USF) ELEVATIONS SHALL BE 0.15m (MIN) ABOVE THIS ELEVATION. AS PER THE GEOTECHNICAL REPORT THE FOLLOWING OPTIONS ARE TO BE CONSIDERED FOR DRAINAGE AT THE RESIDENTIAL STRUCTURES:
 - 4.1. DAMP PROOF THE EXTERIOR OF THE FOUNDATION WALLS AND BACKFILL THE WALLS WITH FREE DRAINING, NON-FROST SUSCEPTIBLE SAND OR SAND AND GRAVEL, SUCH AS THAT MEETING ONTARIO PROVINCIAL STANDARD SPECIFICATIONS (OPSS) REQUIREMENTS FOR GRANULAR B TYPE 1.
 - 4.2. INSTALL AND APPROVED PROPRIETARY DRAINAGE MATERIAL (SUCH AS SYSTEM PLATION) ON THE EXTERIOR OF THE FOUNDATION WALLS AND BACKFILL THE WALLS WITH NATIVE MATERIAL OR IMPORTED SOIL.
5. USF IS TYPICALLY BASED ON THE FINISHED HOUSE ELEVATIONS (LESS 2.25m) HOWEVER THE (MINIMUM) USF IS THE LOWEST ELEVATION OF THE ELEVATION WHICH EVER IS GREATER.

10	REMOVED PROP. ENTRANCE FEATURES	GBU	TJW	JAN. 15/13
9	REVISED AS PER CITY COMMENTS	ATR	TJW	SEP. 25/12
8	REVISED AS PER CITY COMMENTS	ATR	TJW	JAN. 27/12
7	ADD BERM ALONG ALBION ROAD	NI	TJW	FEB. 21/06
6	100Y FLOODLINE	GBU	TJW	JUN. 23/05
5	REVISED AS PER CITY COMMENTS	GBU	TJW	MAY. 25/05
4	REVISED PER CITY COMMENTS	NI	TJW	MAR. 28/05
3	REVISED SITE PLAN DATED SEPT/04	SK	TJW	OCT. 18/04
2	REVISED AS PER NEW TOPO AND CITY COMMENTS	GBU	TJW	SEP. 21/04
1	REVISED LOT & ROAD LAYOUT	GBU	TJW	DEC. 8/03

Revision By Appd. Date
File Name: 60400144U-BASE Dwn. Chkd. Dsgn. Date

Seals

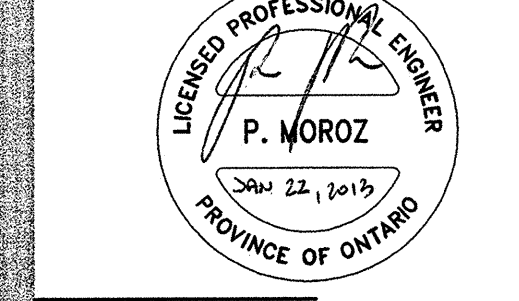

207-16-12-0004
Reviewed By
Development Review Branch
Signature: *[Signature]*
Date: 01/21/2013
DWG # 15542

Client/Project

CAVANAGH CONSTRUCTION

EMERALD LINKS SUBDIVISION


Ottawa, Ontario

Title

GRADING PLAN







Project No. 60400144 Scale 0 7.5 22.5 37.5m
1:750

Drawing No. GP-2 Sheet 15 of 24 Revision 10

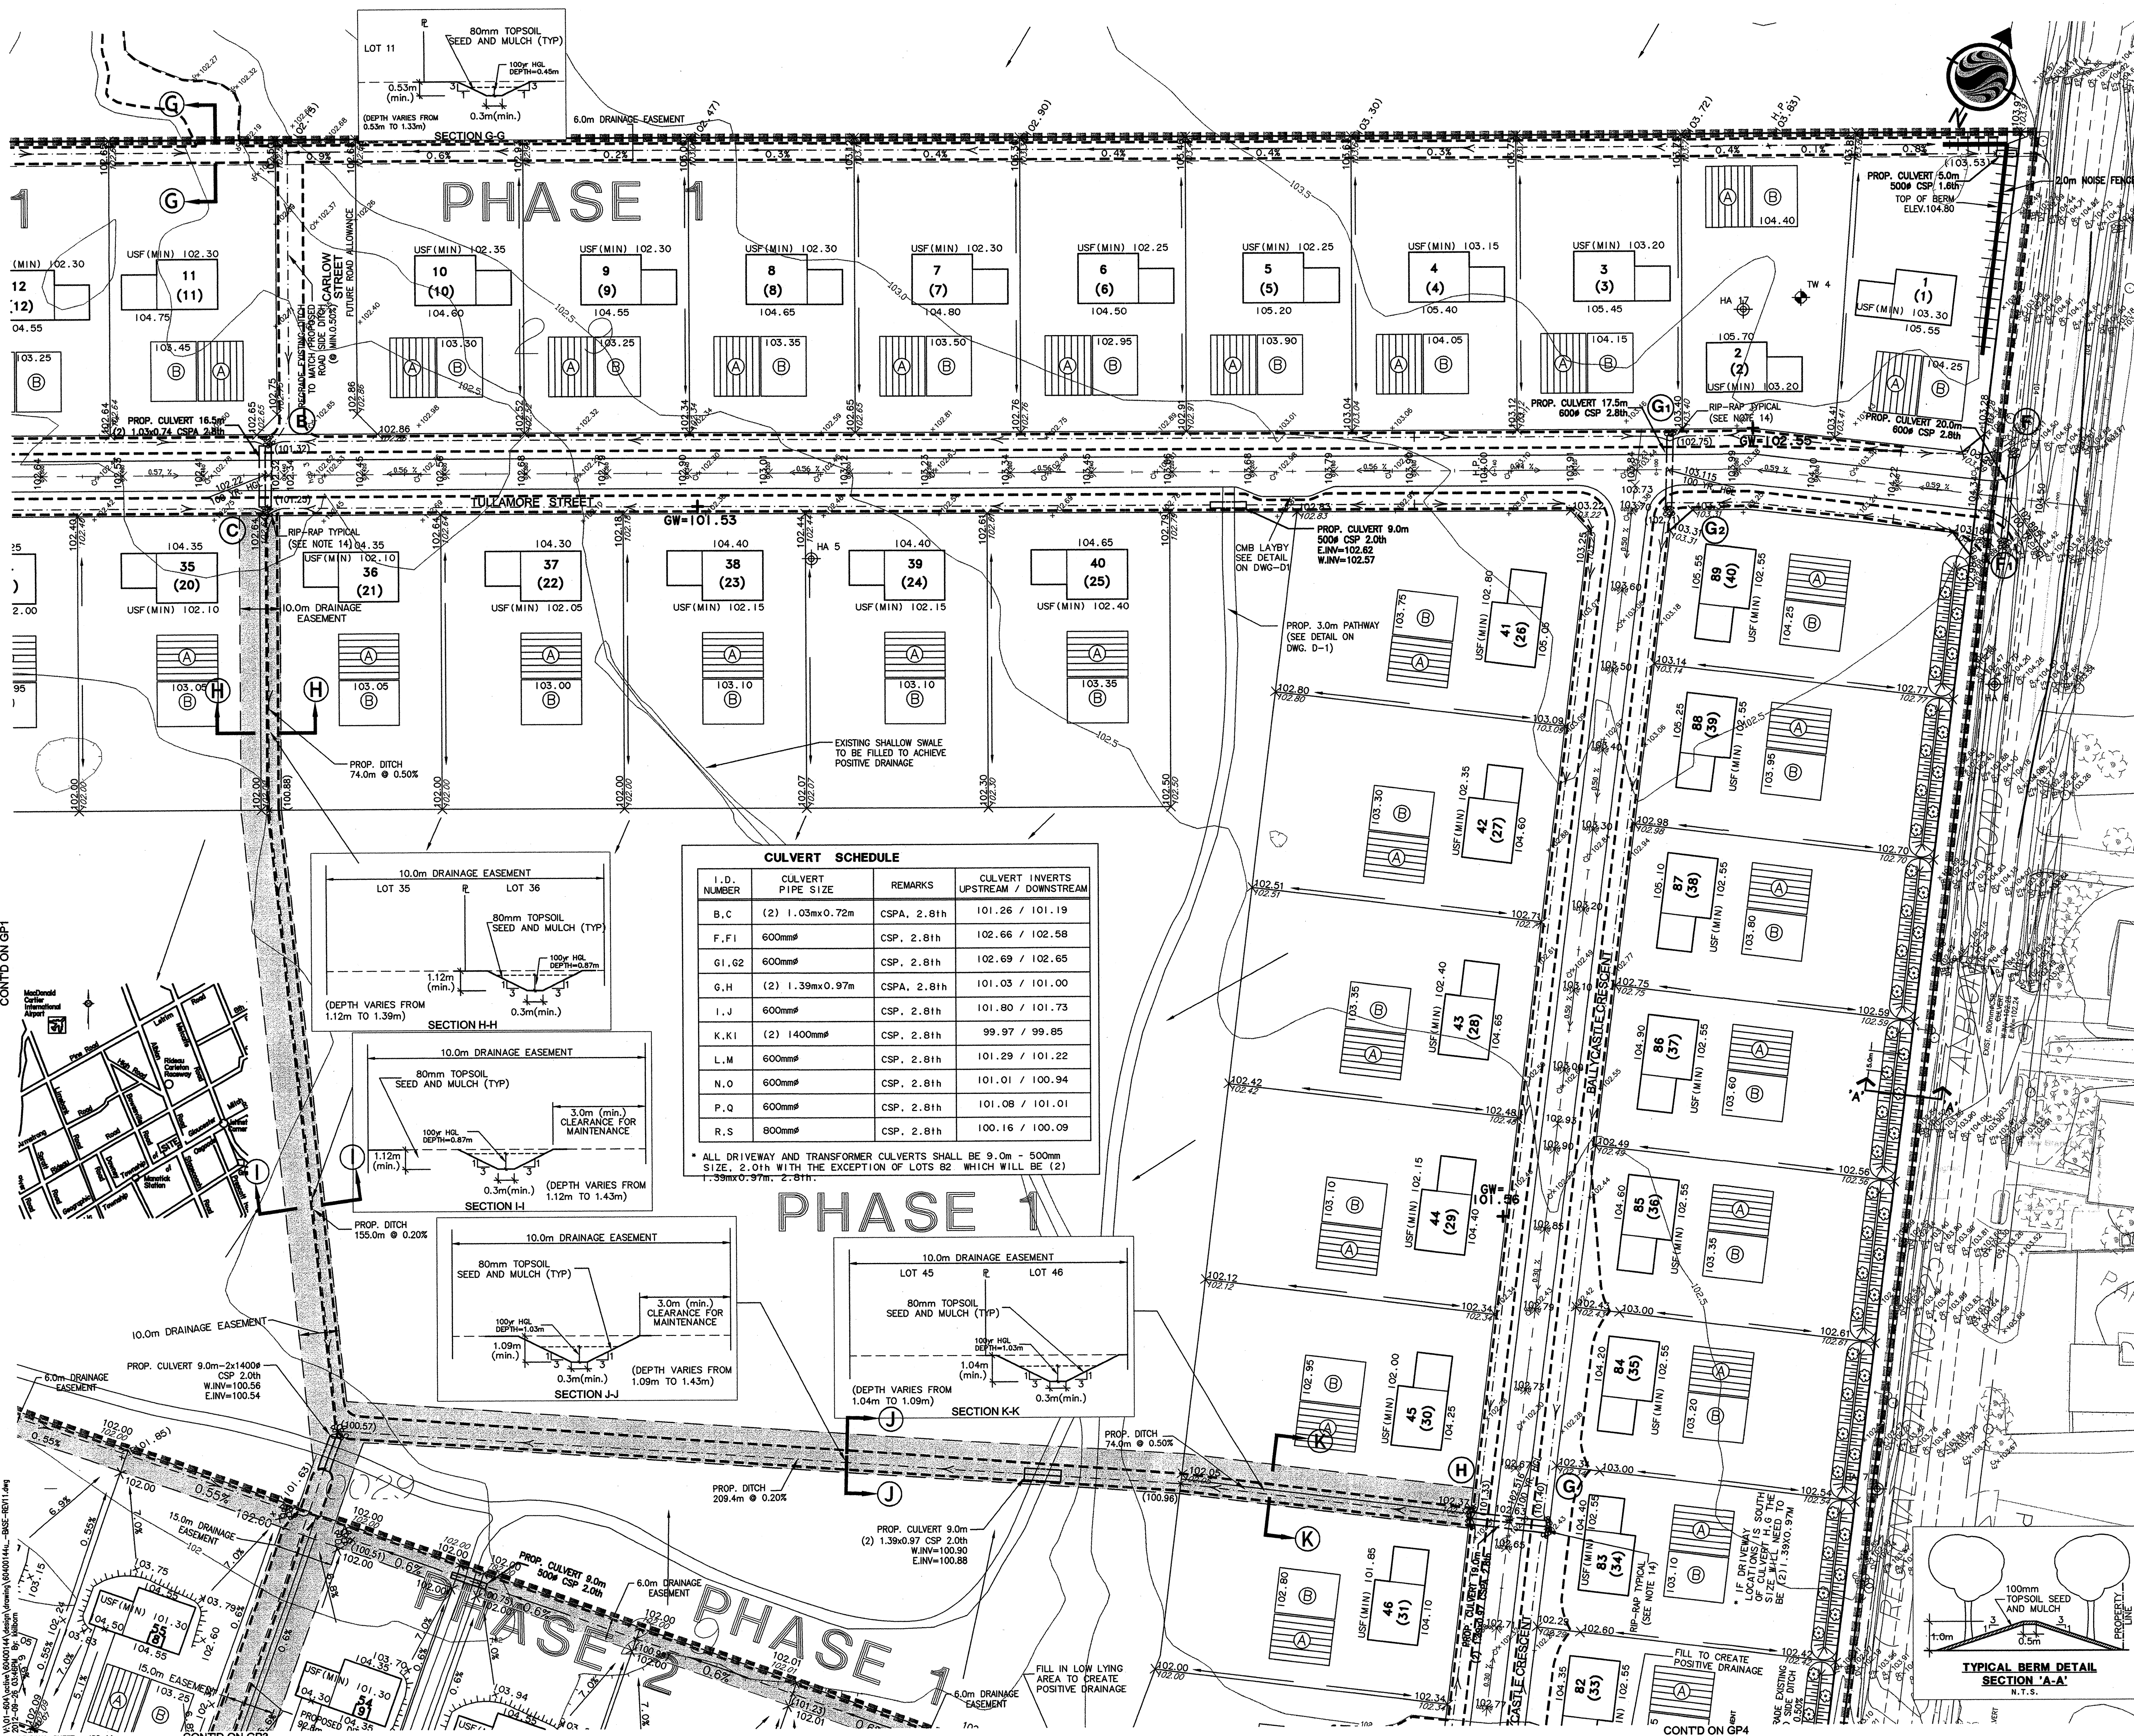

I.D. NUMBER	CULVERT PIPE SIZE	REMARKS	CULVERT INVERTS UPSTREAM / DOWNSTREAM
B,C	(2) 1.03m x 0.72m	CSPA, 2.81h	101.26 / 101.19
F,F1	600mm#	CSP, 2.81h	102.66 / 102.58
G1,G2	600mm#	CSP, 2.81h	102.69 / 102.65
G,H	(2) 1.39m x 0.97m	CSPA, 2.81h	101.03 / 101.00
I,J	600mm#	CSP, 2.81h	101.80 / 101.73
K,K1	(2) 1400mm#	CSP, 2.81h	99.97 / 99.85
L,M	600mm#	CSP, 2.81h	101.29 / 101.22
N,O	600mm#	CSP, 2.81h	101.01 / 100.94
P,Q	600mm#	CSP, 2.81h	101.08 / 101.01
R,S	800mm#	CSP, 2.81h	100.16 / 100.09

* ALL DRIVEWAY AND TRANSFORMER CULVERTS SHALL BE 9.0m - 500mm SIZE, 2.01h WITH THE EXCEPTION OF LOTS 82 WHICH WILL BE (2) 1.39m x 0.97m, 2.81h.

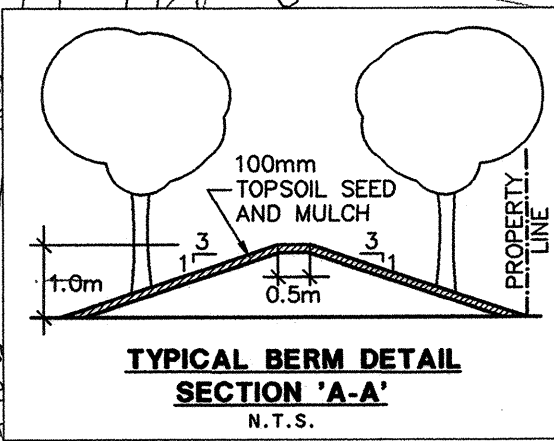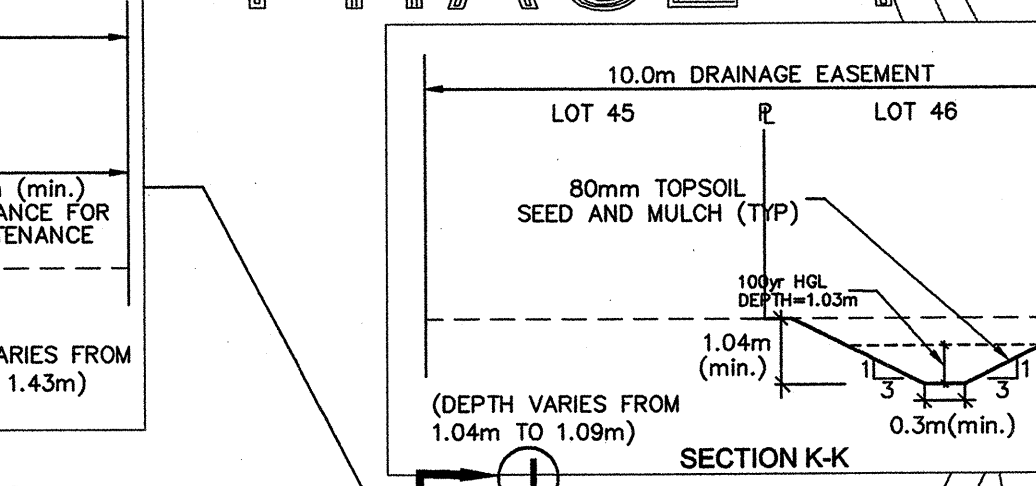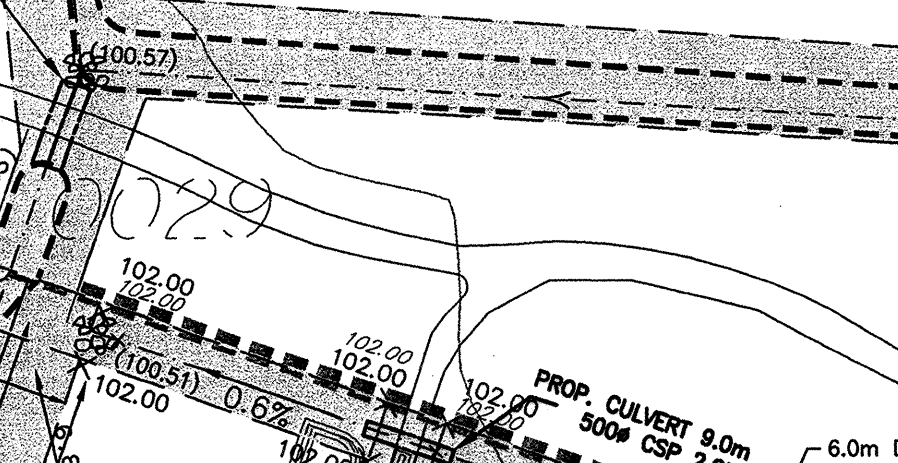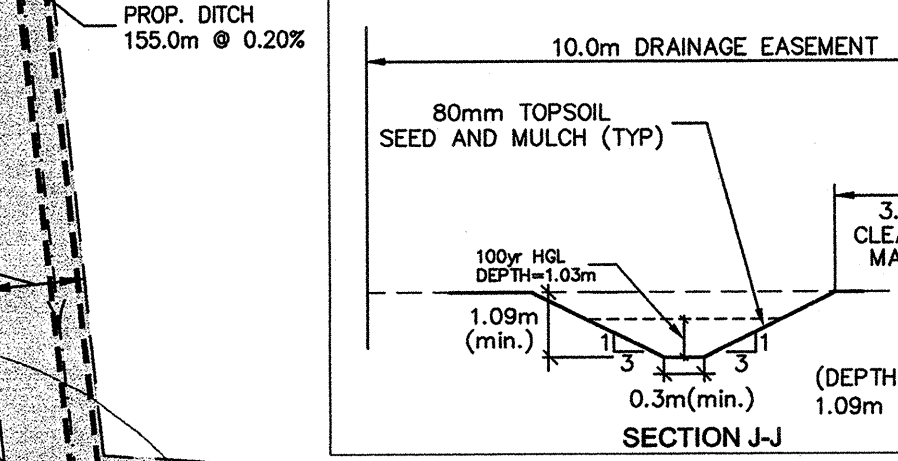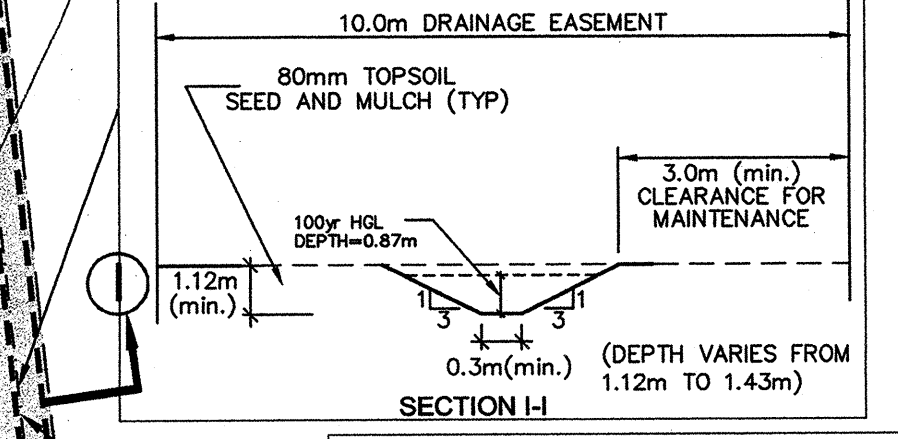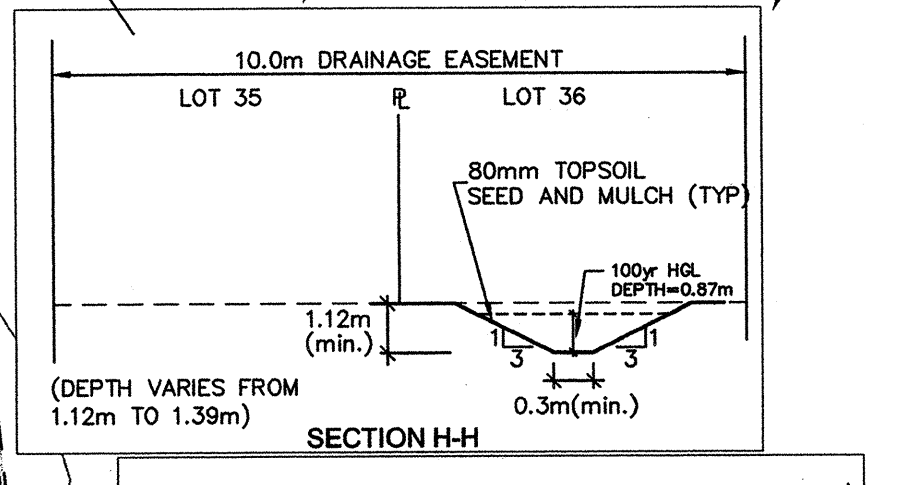

D07-16-12-0004

DWG # 15542

ORIGINAL SHEET - 150 A1