

FUNCTIONAL SERVICING REPORT

FOR

GREEN LANDS WEST & EAST LAFFIN LANDS (WESTERN DEVELOPMENT LANDS)

RICHMOND VILLAGE DEVELOPMENT CORPORATION

CITY OF OTTAWA

PROJECT NO.: 20-1183

**FEBRUARY 2021
2ND SUBMISSION
© DSEL**

**FUNCTIONAL SERVICING REPORT
FOR THE
GREEN LANDS WEST & EAST
LAFFIN LANDS
(WESTERN DEVELOPMENT LANDS)**

RICHMOND VILLAGE DEVELOPMENT CORPORATION

PROJECT NO: 10-1183

TABLE OF CONTENTS

1.0	INTRODUCTION	1
1.1	Green Lands West & East	2
1.2	Laffin Lands	2
1.3	Existing Conditions	3
1.4	Summary of Pre-Consultation.....	4
	1.4.1 Ministry of the Environment, Conservation and Parks (MECP).....	4
	1.4.2 City of Ottawa	4
1.5	Existing Permits / Approvals	5
1.6	Required Permits / Approvals	6
2.0	GUIDELINES, PREVIOUS STUDIES, AND REPORTS.....	7
2.1	Existing Studies, Guidelines, and Reports.....	7
3.0	WATER SUPPLY SERVICING	10
3.1	Existing Water Supply Services.....	10
3.2	Proposed Water Supply.....	10
	3.2.1 Green Lands West Water Supply	10
	3.2.2 Green Lands East Water Supply	12
	3.2.3 Laffin Lands Water Supply.....	12
	3.2.4 Water Demand Calculations	12
3.3	Water Supply Conclusion	13
4.0	WASTEWATER SERVICING.....	14
4.1	Existing/Approved Wastewater Services	14
4.2	Wastewater Design	15
	4.2.1 Green Lands West.....	16
	4.2.2 Green Lands East.....	16
	4.2.3 Laffin Lands	16
4.3	Wastewater Servicing Conclusion	17
5.0	STORMWATER CONVEYANCE	18

5.1	Master Drainage Plan Updates.....	18
5.2	Green Lands West.....	19
5.2.1	Minor System.....	19
5.2.2	Major System.....	21
5.2.3	Quality and Quantity Control.....	21
5.2.4	Floodplain	22
5.3	Green Lands East.....	22
5.3.1	Minor System.....	22
5.3.2	Major System.....	23
5.3.3	Quantity and Quality Control.....	23
5.3.4	Floodplain	23
5.4	Laffin Lands.....	24
5.4.1	Deviations from Master Drainage Plan	24
5.4.2	Minor System.....	26
5.4.3	Major System.....	27
5.4.4	Quality and Quantity Control.....	27
5.4.5	Realignment of the Moore Tributary	27
5.5	Sump Pumps.....	28
5.6	Low Impact Development (LID).....	30
5.7	Stormwater Management Conclusions.....	30
6.0	SITE GRADING.....	32
6.1	Grading Criteria	32
6.2	Functional Grading Design	32
6.2.1	Green Lands West.....	32
6.2.2	Green Lands East.....	33
6.2.3	Laffin Lands	33
7.0	EROSION AND SEDIMENT CONTROL	34
8.0	CONCLUSION AND RECOMMENDATIONS	35

FIGURES

Figure A	Site Context within the Village of Richmond
Figure 1	Site Location
Figure 2	Draft Plan
Figure 3A/3B	Water Servicing Plan
Figure 4	Sump Pump Detail

DRAWINGS

Drawing 1A/1B	Grading Plan
Drawing 2A/2B	Sanitary Servicing Plan
Drawing 3A/3B	Storm Servicing Plan
Drawing 4A/4B	Servicing Profile (Green & Laffin Lands)
Drawing 5A	Servicing Profile (Green Lands)
Drawing 6	Overall Storm Servicing (Laffin Lands)

TABLES

Table 1	Existing Permits / Approvals
Table 2	Required Permits / Approvals
Table 3	Water Supply Design Criteria
Table 4	Summary of Water Demands
Table 5	Wastewater Design Criteria
Table 6	Storm Sewer Design Criteria
Table 7	Sump Pump Design Criteria

APPENDICES

- Appendix A Pre-Consultation
- Appendix B Existing Approvals (ECA)
- Appendix C Richmond Caivan Green & Laffin Lands – Potable Water Capacity
Analysis, (Stantec Consulting Inc, February 2021)
- Appendix D Green Lands - Sanitary Design Sheet (DSEL, February 2021)
Laffin Lands - Sanitary Design Sheet (DSEL, February 2021)
Fox Run PH 1 – Sanitary Design Sheet/Plan (DSEL783, Jan 2018)
- Appendix E Green Lands - Storm Design Sheet (DSEL, February 2021)
Fox Run Ph2 (N) - Storm Design Sheet (DSEL, March 2020)
JFSA Memorandum: “*Richmond Village Development / Proposed
Realignment of the Van Gaal Drain Adjacent to the Green
Lands*” (August 2020)
Laffin Lands - Storm Design Sheet (DSEL, February 2021)
Fox Run Ph1 – Pond Inlet 3 – Storm Trunk (Profile), (DSEL, Rev 7
dated 18-06-13)
MDP 2021 Excerpt – “Storm Servicing Plan – Drawing 3”
MDP 2021 Excerpt – “Grading Plan – Drawing 2”
MDP Excerpt – Various Report extracts
Green Lands East – Preliminary Oil-grit Separator sizing
Ottawa Street - Preliminary Oil-grit Separator sizing
JFSA Technical Memorandum: “*Western Development Lands –
Richmond / Expansion of Drainage Area to SWM Facility 1*”
(February 24, 2021)

**FUNCTIONAL SERVICING REPORT
FOR THE
GREEN LANDS WEST & EAST
LAFFIN LANDS
(WESTERN DEVELOPMENT LANDS)**

RICHMOND VILLAGE DEVELOPMENT CORPORATION

PROJECT NO: 20-1183

1.0 INTRODUCTION

This functional servicing report is submitted in support of a draft plan application for property parcels within the Western Development Lands (WDL) in the Village of Richmond on behalf of the Richmond Village Development Corporation (RVDC).

The following figure provides a site context for the WDL area in the within the Village.

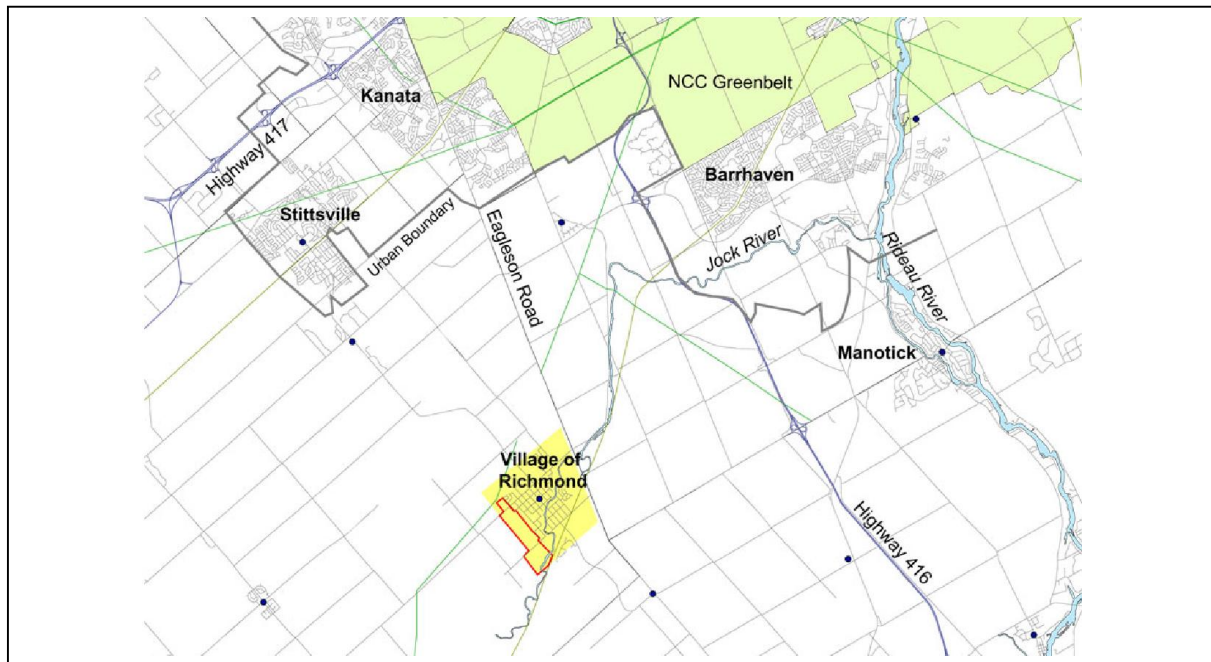


Figure A: Western Development Lands within Richmond

The **Figure 1** Site Location plan in the **Figures** section at the back of the report illustrates the land parcels that are the subject of the current draft plan application and are identified as “Green Lands West”, “Green Lands East” and the “Laffin Lands”. The draft plan for the areas is included for reference and identified as **Figure 2**.

1.1 Green Lands West & East

Green Lands West is proposed to be comprised of 115 single family homes and 260 townhomes (total 375 units).

Green Lands East is proposed to be comprised of 37 single family homes.

Figure 1 also demonstrates the surrounding areas of development that have been advanced within the WDL to date:

1. The first phase of development within the WDL was Fox Run Phase 1 (located south of Perth Street) and consisted of 220 single family homes, an interim stormwater management (SWM) pond and a sanitary trunk sewer outlet upgrade for the WDL along Martin Street. Phase 1 has been constructed to base course asphalt and home construction activities are ongoing;
2. Subsequent to Phase 1, detailed design submissions were made for:
 - a. Phase 2 (North) (between Green Lands West and East) which has been approved and is currently under construction at the time of the writing of this FSR. This phase of development also included an expansion to the interim SWM Pond to its ultimate footprint which will also service the Green Lands West (see further discussion in Section 5 of this FSR). Phase 2 (North) consists of 31 single family homes and 163 townhomes;
 - b. Phase 2 (South) design approval is anticipated in July 2020 with servicing construction to commence upon approval. Phase 2 (South) consists of 200 single family homes.

1.2 Laffin Lands

The **Master Drainage Plan Western Development Lands for Richmond Village (South) Limited** prepared by David Schaeffer Engineering Ltd., dated November 2013 (**MDP**) and the subsequent **March 2020** update (**MDP Update** approved in April 2020) proposed the lands east of the Fox Run Phase development to be serviced by two stormwater management ponds ("Pond 1" and "Pond 2"). The Laffin Lands, located in the central portion of the WDL south (between Perth Street and Ottawa Street) is where the site of Pond 2 was originally located. However, in order to optimize land usage, the Pond 2 is proposed to be removed from the Laffin Lands and utilization of the Pond 1 as one centralized facility. See discussion in Section 5 of this report.

The Laffin Lands are proposed to be comprised of 108 single family homes and 66 townhomes (total 174 units).

This FSR is provided to demonstrate conformance with the design criteria of the City of Ottawa, background studies, including the Master Servicing Study, and general industry practice.

1.3 Existing Conditions

Green Lands West: The majority of this 12.3ha site is currently undeveloped and is active farmland. The site area surrounds an existing BMR commercial property that fronts onto Perth Street. Immediately west of the BMR property is a residential property/structure at 6387 and 6409 Perth Street which will be removed as part of the site development. The general terrain is relatively flat and the majority has been previously cleared of trees, with the exception of some minor hedgerows along the some ditches, along the periphery of the site and in the vicinity of the existing residential buildings.

Existing ground elevations are on average between 96.10m to 94.40m (with some isolated higher elevations at the existing dwellings).

As identified in the ***Green Lands Geotechnical Report*** prepared by Golder Associates, the subsurface conditions within the development area are anticipated to consist of topsoil overlaying a silty clay over sandy silt and glacial till. For additional details please see the borehole logs and descriptions found in ***Appendix F***. The geotechnical investigation of the area indicates that the deposit of generally firm unweathered grey silty clay has a limited capacity to support additional stress and as such there are recommended grade raise restrictions of 1.3m to 1.5m at future home locations and approximately 2 meters at roadways.

Green Lands East: The majority of this 3.62ha site is currently undeveloped and is active farmland. The general terrain is relatively flat and the majority has been previously cleared of trees, with the exception of a hedgerow along the frontage of Mira Court. The future alignment of the Van Gaal Drain borders the west side of the property and the east side fronts onto Mira Court (the proposed south units) or back onto the adjacent Richmond Oaks Subdivision (the proposed north units).

Existing ground elevations are on average between 95.35m to 94.40m (with some isolated higher elevations at the existing dwellings) with a gradient to the southeast.

As identified in the ***Green Lands Geotechnical Report*** prepared by Golder Associates, the subsurface conditions within the development area are anticipated to consist of topsoil overlaying a silty clay over sandy silt and glacial till. For additional details please see the borehole logs and descriptions found in ***Appendix F***. The geotechnical investigation of the area indicates that the deposit of generally firm unweathered grey silty clay has a limited capacity to support additional stress and as such there are

recommended grade raise restrictions of 1.3 m to 1.5 m at future home locations and approximately 2 m at roadways.

Laffin Lands: The majority of this 7.26ha site is currently undeveloped with approximately 80% as agricultural land and the remaining 20% an existing woodlot in the northeast quadrant of the property. Existing ground elevations are between 94.00 m to 97.15 m with the general terrain being relatively flat with a land gradient to the northwest.

As identified in the *Laffin Lands Geotechnical Report* prepared by Golder Associates, the subsurface conditions within the development area consists topsoil overlaying a silty sand fill (thickness ranging from 500 to 800 mm), sandy clayey silt (boreholes 20-306 and 20-307) and silty sand to sand and silt. Glacial till over rock was encountered in the majority of the borehole locations with auger refusals indicating potential bedrock or boulders within the till. Bedrock was encountered in boreholes 20-307 and 20-309 at depths of approximately 3 m. For additional details please see the borehole logs and descriptions found in *Appendix F*. The geotechnical investigation of the area indicates that the site is generally underlain by loose to very dense native silty sand and silty sand till and therefore grade raises typical for low-rise subdivisions (assumed to be 1.5 to 2.5 m) are deemed acceptable.

The WDL development is located within the jurisdiction of the Rideau Valley Conservation Authority (RVCA).

1.4 Summary of Pre-Consultation

The following provides a summary of the pre-consultation:

1.4.1 Ministry of the Environment, Conservation and Parks (MECP)

Prior consultations associated with the Western Development Land area have previously been undertaken for the approval of the Martin Street Sanitary Trunk Sewer, the interim SWM 'Pond 1' that services the initial phases of development, and the sanitary/storm sewers associated with the Phase 1 development area.

1.4.2 City of Ottawa

The following is a list of the pre-consultation meetings with the City of Ottawa for the Green and Laffin Lands:

- March 13, 2020 – a formal pre-application Consultation with Municipal Staff for the Green Lands was held. The intent of the meeting was to discuss the proposed development, review technical considerations and identify/confirm

studies required to accompany the submission of a Plan of Subdivision application.

A copy of the above noted pre-consultation minutes are enclosed in **Appendix A** for reference.

1.5 Existing Permits / Approvals

The existing approvals for surrounding infrastructure, related to the proposed development areas, are presented in the following table. Prior ECA approvals are provided in **Appendix B** for reference.

Table 1: Existing Permits / Approvals

Agency	Approval Type	Approval Number	Remarks
Ministry of the Environment, Conservation and Parks (MECP)	Environmental Compliance Approval	1608-BPHMBF (May 19, 2020)	Stormwater Management Pond 1 expansion which accounts for future drainage from the Green Lands West
Ministry of the Environment, Conservation and Parks (MECP)	Environmental Compliance Approval	5426-A5PMR (January 6, 2016)	Martin Street Sanitary Trunk Sewer for conveyance of sanitary flows from the WDL development area.
Ministry of the Environment, Conservation and Parks (MECP)	Environmental Compliance Approval	1528-BLFNVH (February 24, 2020)	Caivan Communities – Richmond Phase 2 (North) for sanitary and storm sewers
Ministry of the Environment, Conservation and Parks (MECP)	Environmental Compliance Approval	9297-AV9KAL (January 25, 2018)	Caivan Communities – Richmond Phase 1 for sanitary and storm sewers
Rideau Valley Conservation Authority (RVCA)	Alteration of Waterways Permit under O.Reg. 174/06	RV5-4619 (October 1, 2019)	Authorization related to the construction of the Ultimate Stormwater Management Pond 1 located partially within the Regulatory Floodplain of the Jock River and Arbuckle Municipal Drain.
Rideau Valley Conservation Authority (RVCA)	Alteration of Waterways Permit under O.Reg. 174/06	RV5-2919 (January 23, 2020)	Authorization related to the realignment of the Van Gaal Municipal Drain to accommodate development in the WDL development area.

1.6 Required Permits / Approvals

The Green/Laffin Lands development areas are subject to the following permits/ approvals:

Table 2: Required Permits / Approvals

Agency	Approval Type	Trigger	Remarks
City of Ottawa	Commence Work Notification (CWN)	Construction of new sanitary and storm sewers throughout the subdivision.	The City of Ottawa will issue a commence work notification for construction of the sanitary and storm sewers once an ECA is issued by the MECP.
City of Ottawa	MECP Form 1 – Record of Watermains Authorized as a Future Alteration	Construction of watermains throughout the subdivision.	The City of Ottawa will review the watermains on behalf of the MECP through the Form 1 – Record of Watermains Authorized as a Future Alteration.
Ministry of the Environment, Conservation and Parks (MECP)	Environmental Compliance Approval for sanitary and storm sewers	Construction of new sanitary/storm sewers throughout the subdivision areas.	The MECP will issue an ECA for the sanitary/storm sewer design through the transfer of review process.
City of Ottawa	Permission for a storm outlet from the Green Lands East to the Van Gaal Municipal Drain.	Condition of subdivision approval.	The City of Ottawa will issue a permission letter for the connection via the development review process.
Rideau Valley Conservation Authority (RVCA)	RVCA Letter of Permission: Fill Permit	Removal of a minor area of floodplain located in the northwest corner of the Green Lands West area.	Authorization related to a balanced cut/fill placement in a regulated area.
Rideau Valley Conservation Authority (RVCA)	RVCA Letter of Permission: Fill Permit	Alterations to SWM Pond 1 and work within the setback of the regulated area.	Authorization related to a balanced cut/fill placement and underground services within a regulated area.

2.0 GUIDELINES, PREVIOUS STUDIES, AND REPORTS

2.1 Existing Studies, Guidelines, and Reports

The following studies were utilized in the preparation of this report.

- Ottawa Sewer Design Guidelines
City of Ottawa, October 2012
(*Sewer Design Guidelines*)
 - Technical Bulletin ISDTB-2014-01
City of Ottawa, February 5, 2014
(*ITSB-2014-01*)
 - Technical Bulletin PIEDTB-2016-01
City of Ottawa, September 6, 2016
(*PIEDTB-2016-01*)
 - Technical Bulletin ISTB-2018-01
City of Ottawa, March 21, 2018
(*ISTB-2018-01*)
 - Technical Bulletin ISTB-2018-04
City of Ottawa, June 27, 2018
(*ISTB-2018-04*)
- Ottawa Design Guidelines – Water Distribution
City of Ottawa, July 2010
(*Water Supply Guidelines*)
 - Technical Bulletin ISD-2010-2
City of Ottawa, December 15, 2010.
(*ISD-2010-2*)
 - Technical Bulletin ISDTB-2014-2
City of Ottawa, May 27, 2014.
(*ISDTB-2014-2*)
 - Technical Bulletin ISTB-2018-02
City of Ottawa, March 21, 2018
(*ISTB-2018-02*)
- City of Ottawa Official Plan,
adopted by Council 2003.
(*Official Plan*)

- Stormwater Planning and Design Manual
Ministry of the Environment, March 2003.
(SWMP Design Manual)
- Erosion & Sediment Control Guidelines for Urban Construction
Greater Golden Horseshoe Area Conservation Authorities, December 2006
(E&S Guidelines)
- Ontario Building Code Compendium
Ministry of Municipal Affairs and Housing Building Development Branch,
January 1, 2010 Update **(OBC)**
- Village of Richmond Water and Sanitary Master Servicing Study
Stantec Consulting Ltd., July 2011 **(MSS)**
- Village of Richmond Community Design Plan
City of Ottawa, July 2010 **(CDP)**
- Master Drainage Plan Western Development Lands for Richmond Village (South)
Limited
David Schaeffer Engineering Ltd., November 2013 and March 2020 as amended
(MDP and MDP 2020 Update respectively)
- Preliminary Geotechnical Investigation Report, Proposed Residential Subdivision
Perth and Ottawa Streets Richmond Area, Ottawa, ON.
Jacques Whitford Consultants, June 2007
(Geotechnical Investigation)
- Preliminary Geotechnical Report, Green Lands West and Green Lands East
Golder Associates, June 2020 (Project No. 20144864-3000-01)
(Green Lands Geotechnical Report)
- Geotechnical Investigation, Laffin Parcel.
Golder Associates, July 2020 (Report No. 20144864-3000-01)
(Laffin Lands Geotechnical Report)
- Groundwater Impact Assessment, Proposed Residential Development, 6305
Ottawa Street West - Richmond
Paterson Group, June 2020 (Reference No. PH4034-LET.01)
(Paterson Groundwater Report)
- Design Brief for Ultimate Stormwater Management Pond 1, Western
Development Lands, Richmond
JF Sabourin & Associates and David Schaeffer Engineering Ltd, March 2020)
(Ultimate Pond 1 Design Brief)
- Sanitary Design Brief (Off-Site Trunk Sewers) for Richmond Village (North &
South) Ltd, Village of Richmond

- David Schaeffer Engineering Ltd., October 26, 2015 (2nd Submission)
(Off-Site Trunk Sewers)
- Stormwater Management Report for Fox Run Subdivision – Phase 2 North
JF Sabourin and Associates, March 2020
(PH2 North SWM Report)
 - Stormwater Management Report for Fox Run Subdivision – Phase 2 South
JF Sabourin and Associates, May 2020
(PH2 South SWM Report)
 - Stormwater Management Report for Fox Run Subdivision – Phase 1
JF Sabourin and Associates, October 2017
(PH1 SWM Report)
 - Design Brief for Caivan Communities Richmond Phase 1
DSEL, November 2017
(PH1 Design Brief)
 - Technical Memorandum No. 1A – Richmond Population and Wastewater Flow
Projections
Parsons, March 2019
(TM No.1A)
 - Technical Memorandum No. 2 – Proposed Richmond Pumping Station Upgrade
Parsons, May 2019
(TM No.2)
 - Village of Richmond Wastewater Collection System Upgrades Functional Design Study
Parsons, September 2019
(Wastewater Functional Design)
 - Western Development Lands – Richmond / Expansion of Drainage Area to SWM
Facility 1
JF Sabourin and Associates, February 2021
(JFSA 2021 Pond1 Memo)

3.0 WATER SUPPLY SERVICING

3.1 Existing Water Supply Services

The existing City of Ottawa water distribution network currently terminates in Kanata and Barrhaven, approximately 10km from the subject site.

The majority of existing residences and businesses in the Village of Richmond are supplied with potable water by both shallow and deep private wells. Parts of the Village of Richmond are supplied with potable water by a public communal well system (King's Park Water Treatment Facility).

In tandem with the construction of Phase 1 of the Fox Run development area, a new communal well system was constructed (referred to as the Richmond West Pumping Station), and is now commissioned, and will provide water supply service to the entire future *WDL* area. With the advancement of the Phase 2 (North) and (South) development areas, the water supply network will be available to the boundaries of the Green Lands West development area at Perth Street at two locations as seen in **Figure 3A** and **3B** in the **Figures** section.

3.2 Proposed Water Supply

3.2.1 Green Lands West Water Supply

Water servicing for the Green Lands West area was contemplated in the ***Village of Richmond Water and Sanitary Master Servicing Study*** prepared by Stantec Consulting Ltd., July 2011 (***MSS***). The preferred design concept indicated by the ***MSS***, for development of the *WDL*, consisted of a new public communal well system connected to the deep aquifer. The facility is now operational.

The Green Lands West area will be serviced internally by 150 mm, 200 mm and 300mm diameter watermains designed in accordance with the ***Water Supply Guidelines*** and ***2013 Water Master Plan***. Various design criteria are summarized in the following table.

Table 3: Water Supply Design Criteria

Design Parameter	Value
Residential - Single Family	3.4 p/unit
Residential - Townhome	2.7 p/unit
Institutional	28,000 L/ha/day
⁽¹⁾ Residential – Basic Day Demand (BSDY)	180 L/cap/day (Singles); 198 L/cap/day (Townhomes)
⁽¹⁾ Residential - Maximum Daily Demand (MXDY)	As per 2013 WMP
⁽¹⁾ Residential – Peak Hour Demand (PKHR)	As per 2013 WMP
Fire Flow	Calculated as per the Fire Underwriter’s Survey 1999.
Minimum Watermain Size	150 mm diameter
Service Lateral Size	19 mm dia Soft Copper Type ‘K’ or approved equivalent
Minimum Depth of Cover	2.4 m from top of watermain to finished grade
Peak hourly demand operating pressure	275 kPa and 690 kPa
Fire flow operating pressure minimum	140 kPa
<p><i>Extracted from Section 4: Ottawa Design Guidelines, Water Distribution (July 2010), ISDTB-2010-2</i></p> <p><i>(1) See page 2 for “Demand Projections” discussion in Stantec Water Analysis found in Appendix C.</i></p>	

The internal watermains will connect to watermain stubs that were installed as part of the Phase 1 (a 300mm diameter stub to be extended from Equitation Circle across Perth Street) and Phase 2 (north) construction from Oldenburg Avenue (and from future watermain installations from extensions of Oldenburg Avenue). The proposed and existing watermains are depicted in **Figure 3A**.

Stantec has completed a review of the Green Lands West area given that the prior projected number of units assessed for this land area, during evaluation of the Phase 2 (North) development, is increased from 150 single family homes (SFH) with a population of 510 (based on 3.4 p/unit) to 115 SFH and 260 townhomes (~1093 people). Refer to the technical memorandum **Richmond Caivan Green & Laffin Lands – Potable Water Capacity Analysis** prepared by Stantec Consulting Ltd. dated February 2021 (**Stantec Water Review**), enclosed in **Appendix C** which indicates that the additional populations and unit counts can be accommodated. Planned future expansion of the Communal Well storage will ultimately be dictated by the rate of progress of the WDL development area up until demand approaches the current 28 L/s supply with the largest well (40 L/s) out of service.

3.2.2 Green Lands East Water Supply

Similar to the Green Lands West, it is proposed that watermains will be extended to provide water service to the Green Lands East area. Two crossings of the Van Gaal Drain are proposed to provide sufficient system pressures for this water supply connection. The preliminary analysis completed by Stantec indicates that the required system pressures are satisfied with the proposed configuration shown in **Figure 3A**.

3.2.3 Laffin Lands Water Supply

Similar to the Green Lands West, the Laffin Lands were contemplated in the **Village of Richmond Water and Sanitary Master Servicing Study** prepared by Stantec Consulting Ltd., July 2011 (**MSS**) and is serviced by the Communal Well. The internal watermains will connect to the extension of watermains installed at the Communal Well which will extend through the Mattamy property located between Fox Run Phase 1 and the Laffin Lands. Any watermain services required will have to be coordinated with the future advancement of the detailed design of the Mattamy property (including any required watermain looping). The Laffin Lands area are anticipated to be serviced internally by 150mm, 200mm and 300mm diameter watermains designed in accordance with the prior Stantec evaluations. The proposed and existing watermains are depicted in **Figure 3B**.

Stantec has completed a review of the expanded Laffin Lands area given that the prior projected number of units assessed for this land area, during evaluation of the Fox Run Phase 2 (North) and (South) developments, is increased from 98 units (80 SFH and 18 TH) to 174 units (108 SFH and 66 THs). A projected increase in population from 321 to 580 people. This is due to the removal of SWM Pond 2 as discussed further in Section 5 of this report. Refer to the **Stantec Water Review** for review of the Laffin Lands.

3.2.4 Water Demand Calculations

A summary of water demands taken from the **Stantec Water Review** is presented in the following table:

Table 4 – Summary of Water Demands⁽¹⁾

Development Area	Unit Type	Population	Area (ha)	Water Demands		
				BSDY (L/s)	OWD (L/s)	MXDY (L/s)
⁽¹⁾ RVDC Fox Run Ph1	SFH	748	-	1.56	2.67	4.23
RVDC Fox Run Ph2 (North)	SFH	105	-	0.22	0.38	0.60
	MLT	440	-	1.01	-	1.01
RVDC Fox Run Ph2 (South)	SFH	680	-	1.42	2.43	3.85
RVDC Fox Run Ph3	SFH	751	-	1.57	2.68	4.25
Mattamy Ph1	SFH	449	-	0.94	1.60	2.54
	MLT	127	-	0.29	-	0.29
RVDC Green Lands West	SFH	391	-	0.81	1.40	2.21
	MLT	702	-	1.61	-	1.61
RVDC Green Lands East	SFH	126	-	0.26	0.45	0.71
RVDC Laffin Lands	SFH	367	-	0.76	1.31	2.08
	MLT	178	-	0.41	-	0.41
Interim Conditions (Sub-total)		5,064	0	10.85	12.92	23.78
Mattamy Buildout	SFH	2,176	-	4.53	7.77	12.30
	MLT	635	-	1.45	-	1.45
	INS	-	2.63	0.85	-	0.85
	MLT	146	-	0.33	-	0.33
Buildout Conditions (Total)		7,875	2.63	17.69	20.69	38.39

(1) Extracted from “Richmond Caivan Green & Laffin Lands – Potable Water Capacity Analysis” by Stantec Consulting Ltd. dated February 2021. See report in Appendix C for further population details and allocation for Phase 2 South and Phase 2 North.

(2) RVDC = Richmond Village Development Corporation

SFH (Single-Family Home); MLT (Multi / Townhouses); BSDY (Basic Day); OWD (Outdoor Water Demand of 1049 L/SFH/d); MXDY (Maximum Day).

3.3 Water Supply Conclusion

The proposed development areas will be serviced by 150 mm, 200mm and 300 mm diameter watermains which will be connected to the existing water distribution network currently in place. Coordination with the advancement of any detailed design of adjacent properties will be undertaken at the time of the design advancement of the Green West/East or Laffin Lands properties.

The **Stantec Water Review** indicates that the proposed watermain layouts will satisfy the demands under all conditions and the proposed layout conforms to the water servicing plan as conceptualized in the Communal Well design.

4.0 WASTEWATER SERVICING

4.1 Existing/Approved Wastewater Services

The existing Village of Richmond is serviced primarily by City of Ottawa sanitary sewers that convey wastewater to the Richmond Pumping Station located south of the Jock River, on the northwest corner of Cockburn Street and York Street. The Richmond Pump Station (RPS) discharges to the Glen Cairn Trunk Sewer just south of Hazeldean and Robertson Road in Kanata.

The WDL is serviced via the new sanitary trunk sewer that has been recently constructed along Martin Street from Cockburn Street to the boundary of the Fox Run Phase 1 development area.

Wastewater collection services for the WDL was contemplated in the **MSS** and there are currently system capacity constraints requiring upgrades in order to facilitate servicing capacity for the balance of the WDL. The recommended solution is expanding the current wastewater collection system and to continue to pump wastewater to the City's central wastewater treatment facility.

The preferred design concepts for the improvements to the wastewater service includes:

- Upgrades to the existing gravity collection system (City program to remove extraneous flows and pipe size and length improvements for the gravity collection system along specific road segments). ***This was accomplished via the approved Martin Street trunk sewer upgrade.***
- Operation upgraded to facilitate emergency use of the Richmond Lagoon Cell C in extreme wet weather conditions. Twinning of 1200 m of existing forcemain with new 600 mm sewer and repairs to the existing 500mm diameter forcemain. ***Completed.***
- Extension of 5.9 km forcemain twinning from the current termination point with an additional 600 mm diameter forcemain along Eagleson Road. ***Design being initiated.***
- Upgrades / expansion of the existing Richmond Pump Station. Analysis/design ongoing by Stantec with design expected to be completed in 2021.
- New 600mm forcemain twinning from Richmond to the City's central collection system in Kanata. ***Future work.***

Ongoing coordination with the wastewater upgrades/analyses will determine how much flow from the advancing development of the WDL will be allowed. The City of Ottawa has previously retained Parsons to review wastewater within the Village of Richmond.

They have prepared Technical Memorandums (**TM No.1 – Richmond Population and Wastewater Flow Projections (March 2019)** and **TM No.2 – Proposed Richmond Pumping Station Upgrade (May 2019)**) to review the sanitary system in order to facilitate growth within the Village of Richmond. Follow up analyses and consultations are continuing and will ultimately determine system capacity allocations and timing.

4.2 Wastewater Design

The Green and Laffin Lands will be serviced by new gravity sewers designed in accordance with City of Ottawa design criteria which will connect to the existing sanitary sewer infrastructure constructed during the development of Fox Run Phase 1 and Phase 2 (North) areas. The proposed sanitary sewer layouts are depicted in **Drawings 2A and 2B** in the **Drawings** section at the back of this report. The following table summarizes the **City Standards** which are used in the design of the proposed wastewater sewer system.

Table 5: Wastewater Design Criteria

Design Parameter	Value
Residential - Single Family	3.4 persons/unit
Residential - Townhome	2.7 persons/unit
Residential - Average Daily Demand	280 L/d/person
Residential - Peaking Factor	Harmon's Peaking Factor. Max 4.0, Min 2.0
Harmon - Correction Factor	0.80
Institutional – Average Flow	28,000 L/ha/day
Institutional – Peaking Factor	1.5 if ICI in contributing area is >20% 1.0 if ICI in contributing area is <20%
Infiltration and Inflow Allowance	0.33 L/s/ha
Park Flow	9,300 L/ha/day
Sanitary sewers are to be sized employing the Manning's Equation	$Q = \frac{1}{n} AR^{2/3} S^{1/2}$
Minimum Sewer Size	200 mm diameter
Minimum Manning's 'n'	0.013
Minimum Depth of Cover	2.5m from crown of sewer to grade
Minimum Full Flowing Velocity	0.6 m/s
Maximum Full Flowing Velocity	3.0 m/s
<i>Extracted from Sections 4 and 6 of the City of Ottawa Sewer Design Guidelines, October 2012 and Technical Bulletin ISTB-2018-01.</i>	

The Fox Run Phase 1 sanitary design sheets are provided in **Appendix D** as a frame of reference for the previously anticipated sanitary flows from the future Green and Laffin properties. It is noted that the prior design for the **WDL** sewers was based on older City guidelines with an average daily demand of 350 L/d/person while the new guidelines specify 280 L/d/person. The prior infiltration allowance of 0.28 L/s/ha was also used while the current guidelines specify 0.33 L/s/ha as per the table above.

The updated design parameters from the above table are used for the Green Lands and Laffin Land areas.

4.2.1 Green Lands West

The draft plan demonstrates 115 single family homes and 260 townhomes (total 375 units) which results in an increased population that was projected from this external area in the Fox Run Phase 2 (North) sanitary design sheet (which was based on a per hectare population due to uncertainty about the future development unit mix) . As per the sanitary design sheet for the Green Lands West area found in **Appendix D**, the overall projected flows tributary to the connection point at the previously constructed trunk sewer (at existing sanitary manhole MH150A at the Perth Street and Meynell Road intersection) are lower than the flows assessed in the Fox Run Phase 1 design (i.e. 41.93 L/s from the Fox Run Phase 1 design and **35.67 L/s** in this FSR design sheet). As such, the proposed unit mix and population results in design flows through the Fox Run Phase 1 development area that are still lower than previously anticipated flows.

4.2.2 Green Lands East

The Draft Plan demonstrates 37 single family homes for the Green Lands East development area. As per the sanitary design sheet in **Appendix D** this area generates flows of approximately **2.46 L/s** that will be connected to existing sanitary sewers located within the Richmond Oaks development to the east.

Within the **MSS**, various infill and future development scenarios were reviewed in order to assess system capacities. For the Green Lands East area the MSS Figure 5.7 (provided in Appendix D) demonstrates that there are no local system bottlenecks for capacity (other than the Martin Street sewer which has already been upgraded and future pump station and forcemain upgrades which are planned to be implemented). It is anticipated that this small increase in flows can be readily incorporated into the sewer networks and will ultimately be captured in the future sanitary system upgrades for the Village of Richmond.

4.2.3 Laffin Lands

The Draft Plan demonstrates that the Laffin Lands are proposed to be comprised of 108 single family homes and 66 townhomes (total 174 units).

The Fox Run Phase 1 sanitary system is designed to accept external flows from the future Mattamy and Laffin Lands. A summary of the Laffin external flows is as follows:

- Drainage Area = 7.12 ha
- Population = ~580
- Total Peak Flow = ~8.65 L/s

Refer to **Drawing 2B** Sanitary Servicing Plan in the **Drawings** section and the sanitary sewer design sheet in **Appendix D** for details.

The peak sanitary flow contributions from the proposed development areas south of Fox Run Phase 1 were previously estimated to be **62.33 L/s** at the stub from the Fox Run Phase 1 development outlet (see the marked up sanitary design sheet from that phase in **Appendix D**). As per the FSR design sheet for the Mattamy/Laffin Lands the projected flow is **59.10 L/s** therefore the downstream infrastructure up to the sanitary pump station has sufficient capacity as designed/constructed and that the flows will ultimately be captured in the future sanitary system upgrades for the Village of Richmond.

4.3 Wastewater Servicing Conclusion

The Green Lands West and Laffin Lands will connect to existing downstream sewers previously constructed as part of the Fox Run Phase 1 development area. When comparing the projected flows from the areas, the downstream sewer systems were designed for flows that were greater than the projected flows therefore capacity exists in those sewers..

Green Lands East units will outlet to existing sewers in the adjacent Richmond Oaks development. A review of the MSS indicates that there are no downstream constraints in the downstream sewers up to the sanitary pump station.

In a greater context, there are ongoing studies and agreements being formulated in order to increase the sanitary capacity for the Village of Richmond through downstream twinning of forcemains and planned expansion of the Richmond Sanitary Pump station.

The functional sanitary sewers have been designed adhering to all relevant *City Standards*.

5.0 STORMWATER CONVEYANCE

Stormwater conveyance for the Green Lands West and Laffin Lands properties were contemplated in the ***Stormwater Management Report for Richmond Village (South) Limited*** (now known as RVDC) prepared by David Schaeffer Engineering Ltd., November 2013 (***MDP***) and the subsequent ***March 2020*** update (to be referred to as the ***MDP 2020 Update*** that was approved in April 2020). The Green Lands West area conforms to the ***MDP 2020 Update*** however it is proposed that the Laffin Lands will deviate from the document and pursue an alternate servicing arrangement. This will be reflected in a ***MDP 2021 Update*** process that will accompany the functional design submission for draft approval. See discussion later in this section.

The Green Lands East area was not previously contemplated within the ***MDP*** studies and the proposed solution is based on maintaining post-development flows to pre-development levels for quantity control and quality controls via an oil-grit separator (OGS) unit as noted in the pre-consultation minutes.

5.1 Master Drainage Plan Updates

The original ***MDP*** for the WDL conceptualized the stormwater management systems based on the City of Ottawa standard criteria at the time (i.e. 5-year level of service for sewers and 30cm of ponding etc). The ***MDP 2020 Update*** was prepared at the request of City of Ottawa staff to reflect a number of important updates to the ***Sewer Design Guidelines*** subsequent to the preparation of the 2013 ***MDP***. As presented in the ***MDP*** and ***MDP 2020 Update***, the recommended stormwater servicing solution consists of a major system, a minor system, and homes with basements equipped with sump pumps to provide foundation drainage.

Drawing 3 (Storm Servicing Plan) from the ***MDP 2021 Update*** can be found in ***Appendix E*** for reference.

The following were the most relevant aspects of the recent ***MDP 2020 Update*** for the WDL:

- Technical Bulletin ISTB-2019-02 dated July 8, 2019 regarding the use of sump pumps;
- Technical Bulletin PIEDTB-2016-01 dated September 6, 2016 regarding the updated sizing for the minor system (i.e. 2-year for local streets, 5-year for collector streets and 10-year for arterial roads);

In addition, the **MDP 2020 Update** included the following:

- i. Updates to reflect small revisions in the drainage split between the proposed Pond 1 and 2 based on a design concept by Mattamy Homes;
- ii. A section of the report regarding the Moore Tributary was added to describe some design elements of the Realignment of the Moore Tributary (north of the Laffin Lands);
- iii. Maintained the proposal for a two pond servicing concept for the southern WDL area (discussion on the deviation from this aspect is detailed in the Laffin Lands discussion that follows); and
- iv. To reflect optimized design, where sump pumps are eliminated for areas south of Ottawa Street and foundations are drained by gravity

The **MDP 2021 Update** will be adjusting items (i), (iii) and (iv) to reflect the updated approach as it relates to the Laffin Land development area. Please refer to the **MDP 2021 Update** under separate cover for full details and discussion in Section 5.4.

5.2 Green Lands West

5.2.1 Minor System

The Green Lands West development area will be serviced by a storm sewer system designed in accordance with the amendment to the storm sewer and stormwater management elements of the Ottawa Design Guidelines – Sewer (Technical Bulletin PIEDTB-2016-01).

The minor storm sewer system will be sized as follows:

- 2-year event for local streets;
- 5-year event for collector streets; and
- 10-year events for arterial roads

The storm sewers are sized using City of Ottawa IDF curves. The proposed storm sewer layout for the development is depicted in the schematic **Drawing 3A Storm Servicing Plan** in **Drawings**. The storm sewers for this development area will outlet to future sewers to be constructed along Oldenburg Avenue as approved in the Fox Run Phase 2 (North) development and to the future extension of Oldenburg Avenue and sewer network as development progresses. The downstream sewers in Phase 2 (North) were designed with the Green Lands West considered. As illustrated in the Green Lands West and Fox Run Phase 2 (North) design sheets in **Appendix E**, the projected storm flows of 1,911 L/s are less than the 2,201 L/s within the previously designed Oldenburg Avenue sewer segment MH263 to MH264 with sufficient capacity within the previously designed sewers all the way to the SWM Pond 1 inlet.

The sewers ultimately outlet to SWM Pond 1 as per the recently approved design for the ultimate pond that was designed and approved as a component of the Fox Run Phase 2 (North) development (see further discussion in Section 5.2.3 of this FSR report).

The following table summarizes the relevant **City Standards** employed in the design of the proposed minor storm sewer system.

Table 6: Storm Sewer Design Criteria

Design Parameter	Value
Minor System Design Return Period	2-Year (Local Streets), 5-Year (Collector Streets), 10-Year (Arterial Streets) – PIEDTB-2016-01
Major System Design Return Period	100-Year
Intensity Duration Frequency Curve (IDF) 5-year storm event. A = 998.071 B = 6.053 C = 0.814	$i = \frac{A}{(t_c + B)^C}$
Initial Time of Concentration	10 minutes
Rational Method	$Q = CiA$
Runoff coefficient for paved and roof areas	0.9
Runoff coefficient for landscaped areas	0.2
Storm sewers are to be sized employing the Manning's Equation	$Q = \frac{1}{n} AR^{2/3} S^{1/2}$
Minimum Sewer Size	250 mm diameter
Minimum Manning's 'n'	0.013
Service Lateral Size	100 mm dia PVC SDR 28 with a minimum slope of 1.0%
Minimum Depth of Cover	2.0 m from crown of sewer to grade (insulation when not possible)
Minimum Full Flowing Velocity	0.8 m/s
Maximum Full Flowing Velocity	3.0 m/s
<i>Extracted from Sections 5 and 6 of the City of Ottawa Sewer Design Guidelines, October 2012 and PIEDTB-2016-01</i>	

The paved area and grassed area runoff coefficients of 0.9 and 0.2 were used to calculate average runoff coefficients that were applied across the site. The storm drainage areas are found in **Drawings** and the storm design sheets are enclosed in **Appendix E** for reference.

The storm sewers will be sized using City of Ottawa IDF curves. In keeping with the design for Fox Run Phase 2 (North) and (South), the system will not be designed with inlet control devices (ICDs) for catchbasins. The prior analyses for the adjacent phase of the development (which included the Green Lands West) have been modelled with no ICDs and modeled the catchbasins and surface storage dynamically as part of the XPSWMM storm sewer model. This was undertaken in order to confirm the performance of the system when high hydraulic gradeline elevations interact with catchbasin and surface storage. A 100-year hydraulic grade line (HGL) analysis will be completed at the time of detailed design (with detailed grading in place) to confirm that the HGL will be maintained below the gutter line elevation, given that the development will be on sump pumps.

5.2.2 Major System

The major system flows will be conveyed through the internal road network where the 100-year event will be captured by required 100-year inlets prior to discharge to the SWM Pond 1 where they are managed for quality/quantity control prior to release to the Arbuckle Drain. Major events in excess of the 100-year event will outlet to the Van Gaal Drain through the adjacent development to the east (i.e. Fox Run Phase 2 (North) and subsequent phases) in accordance with the **MDP 2021 Update** (see *MDP Grading Plan Drawing 2* in **Appendix E** for details). The emergency overflow is via a 6m land block, proposed behind the existing residential property at 6305 Perth Street, as well as a curb cut along the south side of Perth Street. The JFSA stormwater modelling design for Phase 2 (North) provided "*Calculation Sheet 2E: Required Capacity of Phase 2B Overland Flow Route*" in its Appendix D and projected that minimal overland flow will occur due to 100-year surface storage within the development areas. The modelling conceptually considered future contributing areas (i.e. the Green Lands) as well. The JFSA calculation sheet is provided in **Appendix E** of this report for reference.

The major system will be designed in accordance with the amendment to the storm sewer and stormwater management elements of the Ottawa Design Guidelines – Sewer (Technical Bulletin PIEDTB-2016-01).

5.2.3 Quality and Quantity Control

As per the **MDP Update**, the storm outlet for both the minor/major systems (up to the 100-year event) from the Green Lands West will be to an Ultimate SWM Pond 1. This wet pond facility provides the required erosion, quality, and quantity release components and outlets to the existing Arbuckle Drain. Water quality control is provided by the permanent pool sized for enhanced level of protection per MECP guidelines (80% TSS Removal). The SWM Pond 1 facility was designed and approved during the design of the Fox Run Phase 2 (North) subdivision lands to the east and accounted for the subject lands within in the design. Further details of the SWM Pond 1 modelling and sizing are included in the **Design Brief for Stormwater Management Pond 1**,

Western Development Lands – Richmond (Project No. 15-764 dated March 2020) prepared by J.F. Sabourin and Associates provided under separate cover.

5.2.4 Floodplain

In association with the development of the Fox Run Phase 2 (North), and other RVDC lands to the northeast of Green Lands West, the Van Gaal Drain that previously bisected those properties has been realigned (based on prior approvals already received) to the perimeter of that development area. Construction is essentially complete (landscaping work remaining) with asbuilts submitted as of January 2021. There is currently ongoing coordination for the update of the floodline overlay with RVCA in order to officially remove the floodplain designation for those properties.

As seen in the FSR *Grading Plan (Drawing 1A)* and *Storm Servicing Plan (Drawing 3A)* there is a minor encroachment of the floodline into the proposed lot areas shown for Green Lands West property (northwest corner). The prior Van Gaal Drain realignment work downstream does not specifically remove the floodline from the Green property as it did for the other WDL lands. It is proposed that similar to the adjacent development area to the northeast, the proposed Block 46 Open Space area (as shown in the **Figure 2** Draft Plan) will be used to provide channel and riparian improvements in order to contain the 100-year water levels within the corridor. It is noted that unlike the adjacent development the Van Gaal Drain will be shifted and will not have to be significantly re-routed as its current alignment is at the periphery, and parallel, to the site boundary. Based on the minimal extent of floodline impacted, as shown in **Drawings 1A/3A**, it is anticipated that the same methodology and similar fluvial cross-section for the prior Van Gaal adjustments are feasible.

The attached analysis memorandum prepared by JFSA entitled “*Richmond Village Development / Proposed Realignment of the Van Gaal Drain Adjacent to the Green Lands*” (August 2020) evaluates the pre and post development conditions proposed and concludes that flows can be maintained within the proposed corridor and riparian storage volumes will be equal or greater than existing riparian storage. This Block 46 area of the draft plan is currently active farmland with no significant features or tree cover

5.3 Green Lands East

5.3.1 Minor System

The Green Lands East development area will be serviced by a storm sewer system designed in accordance with the amendment to the storm sewer and stormwater management elements of the Ottawa Design Guidelines – Sewer (Technical Bulletin PIEDTB-2016-01).

With an individual local street being introduced for this infill development, the minor storm sewer system will be sized as follows:

- 2-year event for local streets;

The relevant **City Standards** summarized in Section 5.1.1 will be used for the design of the proposed minor storm sewer system.

The storm sewers will be sized using City of Ottawa IDF curves and are proposed to outlet to the adjacent Van Gaal Drain which is the natural receiver of stormwater runoff from these lands (similar to the nearby Mira Court sewers). Given that this is a Municipal Drain, the appropriate consultation with the City's Drainage Engineer and City staff will be undertaken.

A 100-year hydraulic grade line (HGL) analysis will be completed at the time of detailed design (with detailed grading in place) to confirm that the HGL will be maintained below the gutter line elevation, given that the development will be on sump pumps.

5.3.2 Major System

The major system flows will be conveyed through the internal road network where the 100-year event will be captured by required 100-year inlets prior to discharge to the SWM Pond 1 where they are managed for quality/quantity control prior to release to the Arbuckle Drain. Major events in excess of the 100-year event will outlet to the Van Gaal Drain as demonstrated in the conceptual *Grading Plan Drawing 1A*, along with any required erosion control treatments.

5.3.3 Quantity and Quality Control

Unlike the Green Lands West area, ICDs will be employed to ensure that storm flows entering the minor system are limited to the pre-development limits. The evaluations related to ICDs for other WDL development areas was based on those areas being hydraulically connected to the SWM Pond 1 which is not the circumstance for the Green Lands East.

Quality control will be facilitated by an appropriately sized OGS unit prior to discharge to the adjacent Van Gaal Drain. A preliminary sizing for the unit (CDS Model 3020) can be found in **Appendix E** for reference and will be confirmed during future detailed design.

5.3.4 Floodplain

The newly realigned Van Gaal Drain (VGD) is parallel to the western boundary of the Green Lands East area. The VGD, in its former state, imposed a floodplain overlay over a portion of the property (see the *Storm Servicing Plan (Drawing 3A)* in **Appendix E** for reference). As noted in Section 5.2.4, through a separate process, design and

construction has been completed for the realignment of the Van Gaal Drain. The design has been vetted/approved through consultation with the City's Drainage Engineer, Rideau Valley Conservation Authority and the Department of Fisheries and Oceans.

The revised alignment and configuration defines a revised floodline within the limits of the Drain and ultimately removes the floodplain designation from the Green Lands East development area once the realignment construction of the Drain is completed in August/September 2020. Full details can be found in the ***Richmond Village Development / Proposed Realignment of Van Gaal Drain*** analysis prepared by JFSA (April 20, 2017) and other supporting documentation under separate cover.

5.4 Laffin Lands

5.4.1 Deviations from Master Drainage Plan

As noted in Section 5.1 of this report, the ***MDP 2020 Update*** contained various updates related to the stormwater design for the WDL. The currently proposed storm design for the Laffin Lands deviates from the ***MDP 2020 Update*** and will be reflected in an ***MDP 2021 Update*** as follows:

- The ***MDP 2020 Update*** continued with the concept of two SWM ponds to service the WDL area (as per the *Drawing 3 (Storm Servicing Plan)* from the ***MDP 2020 Update*** in ***Appendix E***). The ~2.75 ha block of land for SWM Pond 2 was proposed to be within the Laffin Lands development area in the ***MDP 2020 Update*** and would have had 38.66 ha of subdivision drainage and 71.8 ha of undeveloped external lands drainage from the southwest draining through it (total of 110.46 ha). The SWM Pond 2 outlet was to be to the Jock River via a new storm sewer along Ottawa Street. The proposal is now for the removal of the SWM Pond 2 and to service all lands north of Ottawa Street, the majority of the WDL lands, to a revised SWM Pond 1, instead of having two separate SWM ponds. The previous land area tributary to SWM Pond 1 from the development area south of Fox Run Phase 1 in the ***MDP 2020 Update*** was ~23.5 ha. With the revised drainage boundary the new drainage area to be managed within SWM Pond 1 is ~38.2 ha;
- In order to mitigate the overall changes to SWM Pond 1 the proposed design redirects 39.2 ha of external drainage area (north side of Ottawa Street), that was originally proposed to drain to Ottawa Street then to SWM Pond 2 in the ***MDP 2020 Update***, to now drain to a new sewer along Ottawa Street and directly to the Jock River (as opposed to passing through a Pond). This is reflected in the ***MDP 2021 Update***.
- The design also proposes to redirect the 32.6 ha of external drainage area (from the Ottawa Street south ditch) noted in Section 6.2 of the ***MDP 2020 Update***

(report excerpt in **Appendix E**). These flows, in the existing condition, are directly conveyed southward to the Jock River via open ditches. Rather than conveying the flows through any SWM pond, it is proposed that the flows be conveyed through a new sewer along Ottawa Street and outletting to the Jock River (see **Drawing 6** in the **Drawings** section of the **Appendices**). The Jock River does not require any quantity control measures and the stormwater would continue to outlet to the Jock River further downstream

- Lastly, given the proposed storm sewer outlets noted above, for external stormwater flows that will be directed along Ottawa Street to the Jock River (similar to the previously proposed pond outlet alignment when SWM Pond 2 was considered), the development lands south of Ottawa Street (as well as Ottawa Street drainage itself) are proposed to be collected and then treated by an OGS unit prior to discharge eastward to the Jock River. This alternative will also serve to mitigate impacts to SWM Pond 1 its Arbuckle Drain outlet. See **Drawing 6** for the proposed infrastructure. A preliminary sizing for the unit (CDS Offline Model 5678) can be found in **Appendix E** for reference and will be confirmed during future detailed design.

Based on the deviations to the **MDP 2020 Update** proposed, a technical review of the modelling has been completed by JFSA in support of the **MDP 2021 Update**. See the **JFSA 2021 Pond1 Memo** in **Appendix E** for reference. The analysis confirms the drainage area of SWM Pond 1 can be modified (under the premise of the above changes) to include lands that were originally intended to go to the SWM Pond 2 that was conceptualized within the Laffin Lands property but will require various adjustments/conditions for SWM Pond 1 in order to facilitate this update as follows:

- i. The erosion control orifice will be revised from a 300mm diameter circular orifice with an invert of 92.65 m to a 270 mm diameter circular orifice at an invert of 92.65 m.
- ii. The baseflow control orifice, quality control orifice, and quantity control weir are unchanged from the March 2020 Pond 1 design brief. Refer to Calculation Sheet B-1 in the **JFSA 2021 Pond1 Memo** for the proposed pond control summary;
- iii. The Summer 100-year water level will be raised from 93.791 m to 93.827 m and the 100yr spring water level will be raised from 94.198 m to 94.202 m from the March 2020 **Ultimate Pond 1 Design Brief**;
- iv. Portions of the current pond access road were designed to be above the prior 2-year water level of 93.55 m. With a new 2-year water level of 93.62 m, the access roads will be assessed with City Staff to determine sections to be raised if deemed absolutely necessary. Similarly, the access road adjacent to the north forebay was designed at 93.81 to be above the prior 100-year summer level of 93.791. With a new water level of 93.827 this access road there is a minor

- exceedance at the edge. It is presumed that this would be deemed acceptable for this location
- v. Sediment management areas in their current configuration would be able to accommodate 9 years of sediment accumulation as opposed to the desired 10 years.
 - vi. The existing SWM Pond 1 southern forebay headwall and inlet sewer from the Mattamy/Laffin Lands will need be removed/replaced with a larger storm sewer size of 2250 mm (instead of the previously installed 1650 mm sewer);

The following additional Pond 1 characteristics are also noted:

- a. The broad-crested quantity control weir set in the berm of the pond, which also functions as an emergency spillway will remain the same;
- b. The lowest point of any sediment management areas are set at 93.85 m which is still above the new 100-year SCS event.
- c. A review of the hydraulic grade line in the **JFSA 2021 Pond1 Memo** demonstrates a minimum freeboard of 0m between the HGL of the top of manhole elevations in all areas of development. There are instances in Fox Run Phase 2 where the HGL is slightly above the gutter line but maintained within road ponding depths. This was previously assessed during development of those areas and deemed acceptable
- d. A review of the existing SWM Pond 1 southern forebay, based on the expanded tributary area, confirms that the existing forebay is sufficiently sized to provide adequate settling and dispersion. The forebay calculation by JFSA is provided in *Calculation Sheet B-2* in the **JFSA 2021 Pond1 Memo**.

5.4.2 Minor System

The Laffin Lands development area will be serviced by a storm sewer system designed in accordance with the amendment to the storm sewer and stormwater management elements of the Ottawa Design Guidelines – Sewer (Tech. Bulletin PIEDTB-2016-01).

The minor storm sewer system will be sized as follows:

- 2-year event for local streets;
- 5-year event for collector streets; and
- 10-year events for arterial roads

The minor storm sewer systems are sized using City of Ottawa IDF curves along with the relevant **City Standards** summarized in Section 5.2.1. The proposed storm sewer layout for the development is depicted in the schematic **Drawing 3B Storm Servicing Plan** in **Drawings**. The storm sewers for this development area will outlet to the SWM Pond 1 forebay previously established during the development of the Fox Run Phase 1

land area. The Phase 1 design has previously provided for a 1650mm diameter storm sewer stub to service the development lands south of Fox Run Phase 1 in accordance with the **MDP** and **MDP 2020 Update**. However, as noted in previous sections, the advancement of the Laffin Lands will be based on the removal of the previous SWM Pond 2 proposed on those lands and instead proposes to direct all stormwater flows to SWM Pond 1. Due to the increase in lands tributary to SWM Pond 1 the 1650mm diameter sewer is proposed to be upsized to a 2250 mm pipe as illustrated in **Drawing 3B** and based on the rational design sheet determinations and SWM modeling.

5.4.3 Major System

The major system flows will be conveyed through the internal road networks and discharge to the SWM Pond 1 where they are managed for quantity control prior to release to the Arbuckle Drain. The major system will be designed in accordance with the amendment to the storm sewer and stormwater management elements of the Ottawa Design Guidelines – Sewer (Technical Bulletin PIEDTB-2016-01).

5.4.4 Quality and Quantity Control

The proposed revision to the SWM Pond 1 will provide the required quality and quantity control requirements noted previously.

SWM Pond 1 outflows require quality, quantity and erosion control prior to discharge to the Arbuckle Drain and then ultimately discharge to the Jock River. Quality control will be provided by 80% TSS removal as per MECP Enhanced Protection and quantity control by limiting the 2- and 100-year release rates to pre-development levels. Erosion control will be provided by controlling the 2-year release rate to 330 L/s or less and the velocity to 0.225 m/s or less to the Arbuckle Drain.

5.4.5 Realignment of the Moore Tributary

As per Section 6.5 of the **MDP 2020 Update**, and subject to review and approval by the RVCA and City Drainage Engineer, the adjacent Mattamy development area includes the realignment of the existing Moore Tributary in order to align with the proposed Mattamy development plans as shown on the **MDP 2021 Update Storm Servicing Plan Drawing 3** provided in **Appendix E**.

The realignment of the Moore Tributary in the **MDP 2020 Update** (and maintained in the current **MDP 2021 Update**) is to convey the 94.2 ha external flows through the subject site to eventually outlet to the Jock River.

In prior submissions/coordination for the Mattamy development area by that proponent, the proposed Moore Tributary channel sizing is to be comprised of 3:1 slopes with a 6.5 m bottom width, and is approximately 0.95 m deep as per Channel Cross Section 2-2 in

Figure 22 from the **MDP 2021 Update** (provided in **Appendix E** for reference). The existing ditch from Ottawa Street, and along the southwest edge of the Mattamy property, draining to the realignment of the Moore Tributary, is approximately 0.75 m deep with a 3.0 m wide bottom and 3:1 slopes as per Channel Cross Section 1-1. The realigned Moore Tributary consists of the following features from southwest of the subject site to Queen Charlotte Street (see **Figure 22 in Appendix E from the MDP 2021 Update**):

- 250 m Ditch length at a slope of 0.1%;
- Proposed 3300x900 mm dia., 33.0 m long box culvert at a slope of 0.35% (capacity ~6,700 L/s);
- 255.5 m Ditch length at a slope of 0.13%;
- Proposed 3300x900 mm dia., 27.5 m long box culvert at a slope of 0.35% (capacity ~6,700 L/s);
- 56.4 m Ditch length at a slope of 0.58%.

This channel sizing would be able convey the 94.2 ha external drainage area for the 100-year 24-hr SCS design storm as documented in the **MDP 2021 Update**. The Moore Tributary conveyance calculation provided in **Appendix E** shows a capacity of 3,897 L/s as per preliminary calculations from JFSA enclosed in.

5.5 Sump Pumps

Similar to Fox Run Phase 1 and Phase 2 (North/South), the proximity of the development area to the stormwater receiver (Arbuckle Drain), high HGL, and grade raise restrictions, the proposed centerline of road grades do not allow for standard basements with a gravity connection to the storm sewer system. Therefore the Green/Laffin areas will also be serviced entirely by sump pumps due to the site constraints imposed. This is consistent with the original **MDP** and **MDP 2020 Update**.

In 2018 and 2019, the City published Technical Bulletins ITSB-2018-04 (June 27, 2018) and ITSB-2019-02 (July 8, 2019), which outline the criteria for sump pumps, the requirements for hydrogeological assessments areas with sump pumps, and revised information on HGL for storm sewers with sump pumps. In detailed design, the proposed sump pump design will conform to Technical Bulletins ITSB-2018-04 (June 27, 2018) and ITSB-2019-02 (July 8, 2019). The sump pump detail can be found on **Figure 4**, and the sump pump components and requirements are outlined in the following table.

Table 7: Sump Pump Design Criteria

Component	Requirements
Sump Pump (General)	Shall be: <ul style="list-style-type: none"> ○ In accordance with City of Ottawa Technical Bulletin ISTB-2018-04 (June 27, 2018); ○ A submersible pump; ○ Automatically controlled and set to maintain the water level at the same elevation as the foundation drain; capable of discharging a minimum flow of 0.9 L/s at 3.6 m head.
Sump Pump (Primary)	Shall be: <ul style="list-style-type: none"> ○ CSA Approved; ○ Connected to an electrical circuit that supplies no other outlets, switches or equipment; ○ Equipped with a self-resetting thermal overload protection switch; ○ Rated for continuous duty.
Sump Pump (Backup)	Shall be: <ul style="list-style-type: none"> ○ CSA Approved; ○ Connected to an electrical circuit that supplies no other outlets, switches or equipment except: A) Charging equipment for backup power and B) Alarm system for primary pump and power failure; ○ Equipped with a self-resetting thermal overload protection switch; ○ Rated for continuous duty; ○ Equipped with an audible failure alarm to notify homeowner that the primary pump has failed or the power supply has been interrupted; ○ Capable of discharging a minimum capacity of 0.90 L/s at 3.6 m head; ○ Powered by a deep-cycle lead-acid battery with a min. ampere-hour rating of 100 AH.
Sump Pit	Shall: <ul style="list-style-type: none"> ○ Have walls and bottoms constructed of concrete polyethylene, polypropylene, or fiberglass; ○ Be provided with a sealed cover; ○ Have a cover which must be secured in a manner acceptable to the authority having jurisdiction; ○ Be vented to the outdoors.
Discharge Pipe System from Sump Pump	Shall: <ul style="list-style-type: none"> ○ Be in accordance with <i>Appendix 9 – Standard Sump Pump Configuration in Greenfield Subdivisions with Clay Soils on Full Municipal Services</i>; ○ Consist of materials and be installed in conformance with the Ontario Building Code; ○ Have a minimum internal diameter of 38 mm (1-1/2") from the sump pump to the 100 mm (4") storm building drain; ○ Have a union, a check valve and a shut-off valve installed in that sequence in the direction of discharge outside of the sump pit; ○ Have a goose neck with a height of no more than 250 mm below the top of the foundation wall and discharge into the vertical leg of the storm building drain; ○ Have a minimum dimension of 600 mm from the vertical leg of the storm discharge pipe to the horizontal offset upstream of the backwater valve; ○ Include a CSA approved backwater valve for the stormwater discharge; ○ Include an emergency discharge pipe to the outside ground surface; ○ Be vented to the outdoors; ○ Be graded or otherwise protected to prevent the freezing of water in the system.
Connections	<ul style="list-style-type: none"> ○ Only the perimeter foundation drainage system will be connected to the sump pit. Eaves trough, surface exterior drainage, swimming pool backwash, floor drains and any other water sources shall not be connected to the sump pit; ○ All new residences with installed sump pump systems must include: <ul style="list-style-type: none"> ○ Eaves troughs discharging to the surface with appropriate drainage away from the house at the time of the original sale; ○ Drainage layer as per the Ontario Building Code; ○ Clay backfill placed against the drainage layer with the clay extending a minimum 1.5 m out from the drainage layer for all sides of the foundation; ○ Impervious backfill capping at the ground surface surrounding the perimeter of the residence area and slope away from the building after settling of backfill; except in areas where window wells are required by Ontario Building Code; ○ The sump pump shall be directly connected to a storm building drain from the building to the property line.

5.6 Low Impact Development (LID)

The following Low Impact Development (LID) techniques may be incorporated as part of detailed design where feasible:

- Rear-yard swales have been designed with minimum grades where possible, to promote infiltration;
- Rear-yard catchbasin leads/subdrain will be perforated (except for the last segment connecting to the storm sewer within the right-of-way), to promote infiltration; and,
- Where eavestroughs are provided on residential units, they are to be directed to landscaped surfaces, to promote infiltration.

These LIDs are implemented as part of the general design requirements for the site.

5.7 Stormwater Management Conclusions

Stormwater management for the Green Lands West follows the previous rationale provided for in the **MDP 2020 Update** and carried forward in the **MDP 2021 Update**. Stormwater flows will be directed to SWM Pond 1 and managed for quality and quantity control prior to discharge to the Arbuckle Drain.

The Green Lands East area was not considered in the original MDP, and subsequent updates, and will provide quality and quantity control within that development area via ICDs and an OGS unit prior within the ROW prior to any discharge. The lots to be provided on a new street extension will be tributary to a new outlet to the Van Gaal Drain (with the approval with the City Drainage Engineer). Sump pumps for the new units fronting onto the west side of existing Mira Court will connect to a storm sewer extension that will be installed for those 'clean water' connections.

The Laffin Lands servicing concept proposes to deviate from the **MDP 2020 Update** and remove the SWM Pond 2 requirement from that parcel and redirect flows to SWM Pond 1 for quality/quantity control to accommodate. This will require a new **MDP 2021 Update** with the following updates:

- Revisions to the SWM Pond 1 erosion control orifice size (300mm diameter to 270 mm diameter), water levels (maximum delta of 0.04 m), and south forebay inlet and headwall replacements will be required to accommodate the additional tributary areas. The existing forebay is sufficiently sized for the proposed tributary area.
- The realignment of the Moore Tributary will be maintained as per the **MDP 2020 Update**. This will be subject to RVCA and the City Drainage Engineer's approval.

- 39.2 ha and 32.6 ha of land originally proposed to drain to Ottawa Street, then to SWM Pond 2, is proposed instead to drain along Ottawa Street via a future storm trunk sewer outletting to the Jock River (Note: This is along the same alignment as was proposed for the prior Pond 2 concept). This work will require approval by the RVCA.
- In conjunction with the external flows proposed to be conveyed along Ottawa Street to the Jock River, the development lands south of Ottawa Street (as well as Ottawa Street drainage itself) will be collected and then treated by a proposed OGS unit prior to discharge eastward to the Jock River.

The associated storm sewer collection system, and stormwater management facility designs have been prepared in accordance with standard City of Ottawa modeling techniques.

In circumstances where infrastructure may be required outside of an individual landowner's development area (due to differences in development timing), there will need to be agreements in place facilitating cost sharing and access when necessary.

6.0 SITE GRADING

6.1 Grading Criteria

The following grading criteria and guidelines have been applied to the detailed design as per City of Ottawa Guidelines:

- Maximum slope in grassed areas between 2% and 5%;
- Grades in excess of 7% require terracing to a maximum of a 3:1 slope;
- Driveway grades between 2% and 6%;
- Drainage ditches and swales should have a minimum slope of 1.5%;
- Perforated pipe is required for swales less than 1.5% in slope;
- Swales are to be 0.15 m deep with 3:1 side slopes unless otherwise indicated on the drawings;

The ideal grading for the proposed 100-year ponding approach is summarized as follows:

- 0.5% longitudinal road slopes from high point to low point and from low point to high point within the ponding area;
- A 2.0% road cross-slope (although a 3.0% road cross-slope is also acceptable);
- As reasonable a freeboard as feasible between the maximum extent of surface storage on the road (i.e. the 100-year water level) and the lowest nearby building opening elevation, in order to ensure that the 100-year + 20% stress test water levels do not reach the building envelope; and
- Back-to-front drainage or well-spaced discharge points for excess rear yard flows draining to the street. Rear yard catchbasins are connected to street catchbasins, which in turn connects to the main storm sewer, allowing rear yard flows to back up into road ponding areas when the capacity of the catchbasin lead is exceeded.

6.2 Functional Grading Design

6.2.1 Green Lands West

The Green Lands West development is constrained by grade raise restrictions. The geotechnical investigation provided an assessment of permissible grade raises based on unit weights of fill of 18.0 kN/m³ and 19.5 kN/m³. The most restrictive grade raise is for the 19.5 kN/m³ unit weight with restrictions of 2.0 m within the roadway and 1.3 m to 1.5 m at the house. See the **Green Lands Geotechnical Report** for full details. The servicing and grading have been designed as low as possible, to minimize the proposed

grade raise within the subdivision and adheres to this requirement. In future, the detailed grading plans will be forwarded to the geotechnical consultant for review and recommendations. Final signoff for the detailed grading plans will be provided by the Geotechnical Engineer.

6.2.2 Green Lands East

The results of the ***Green Lands Geotechnical Report*** as summarized above for the Green Lands West is the same for the East area. Grading is kept as low as possible and ties into the adjacent existing development grading.

6.2.3 Laffin Lands

The geotechnical investigation of the area indicates that the site is generally underlain by loose to very dense native silty sand and silty sand till and therefore grade raises typical for low-rise subdivisions (assumed to be 1.5 to 2.5 m) are deemed acceptable. Based on the ***Grading Plan Drawing 1B*** for the property the proposed grade raise is approximately 2 m or less therefore no concerns are expected. The grading will ultimately be coordinated with the grading for the adjacent Mattamy development areas. Final signoff for the detailed grading plans will be provided by the Geotechnical Engineer.

7.0 EROSION AND SEDIMENT CONTROL

Soil erosion occurs naturally and is a function of soil type, climate and topography. The extent of erosions losses is exaggerated during construction where the vegetation has been removed and the top layer of soil is disturbed.

- Erosion and sediment controls must be in place during construction. The following recommendations to the contractor will be included in contract documents.
- Limit extent of exposed soils at any given time.
- Re-vegetate exposed areas as soon as possible.
- Minimize the area to be cleared and grubbed.
- Protect exposed slopes with plastic or synthetic mulches.
- Install silt fence to prevent sediment from entering existing ditches.
- No refueling or cleaning of equipment near existing watercourses.
- Provide sediment traps and basins during dewatering.
- Install filter cloth between catch basins and frames.
- Installation of mud mats at construction accesses.

8.0 CONCLUSION AND RECOMMENDATIONS

Richmond Village Development Corporation is proposing residential development within the Village of Richmond WDL. The subject properties are the Green Lands West (12.3 ha), Green Land East (3.62 ha) and Laffin Lands (7.62 ha). DSEL was retained to prepare a Functional Servicing Study in support of draft plan application.


- Approvals will be required from the City of Ottawa, the Ministry of the Environment, Conservation and Parks (MECP) and the RVCA as required;
- Water supply to the Green Lands West and Laffin Lands was previously contemplated in the **MSS**. Water supply to the development areas will be via extension of watermains from the now functional Communal Well for the WDL. This water supply will also be extended to the Green Lands East development area given the minor increase in demand for those 37 units. The City is currently undertaking a review of the Communal Well to assess future upgrades for the WDL and external development areas;
- Wastewater services will be provided through a network of gravity sewers that are tributary to the recently constructed and commissioned Martin Street sanitary sewer and any ongoing and planned future upgrades to the existing Richmond Sanitary Pumping Station and downstream forcemains. The ongoing, and future, off-site upgrades required to support the development area were contemplated in the **MSS**;
- With the implementation of the new sanitary design criteria as per Technical Bulletin ISTB-2018-01 (March 21, 2018), the proposed flows downstream of the WDL is lower than what the **MSS** calculated, even with the increase in population of the WDL from what the **MSS** originally projected;
- Foundation drainage for all units will be via sump pumps in the Green and Laffin Land development areas;
- Green Lands West storm sewers are designed in accordance with the new City of Ottawa stormwater guidelines with new 100-year ponding design criteria with a minimum 2-year minor system capture on local roads and a minimum 5-year minor system capture on collector roads. The sewers will outlet to SWM Pond 1 via Fox Run Phase 2 sewers which have considered this drainage area previously;
- Green Lands East storm sewers are designed to the same standard noted for Green Lands West. The sewers will have a new outlet to the adjacent Van Gaal Drain (with the approval with the City Drainage Engineer and RVCA). Quality and quantity control within the development area will be via ICDs and an OGS unit prior to any discharge. Sump pumps for the new units fronting onto the west side of existing Mira Court will connect to a storm sewer extension that will be installed for those 'clean water' connections;

- The Laffin Lands servicing concept proposes to deviate from the **MDP 2020 Update** and remove the SWM Pond 2 requirement from that parcel and redirect flows to an updated SWM Pond 1 for quality/quantity control to accommodate. This will require:
 - Revisions to the SWM Pond 1 erosion control orifice size (300mm diameter to 270 mm diameter), water levels (maximum delta of 0.04 m), and south forebay inlet and headwall replacements will be required to accommodate the additional tributary areas. The existing forebay is sufficiently sized for the proposed tributary area.
 - The realignment of the Moore Tributary will be maintained as per the **MDP 2020 Update**. This will be subject to RVCA and the City Drainage Engineer's approval.
 - 39.2 ha and 32.6 ha of land originally proposed to drain to Ottawa Street, then to SWM Pond 2, is proposed instead to drain along Ottawa Street via a future storm trunk sewer outletting to the Jock River (Note: This is along the same alignment as was proposed for the prior Pond 2 concept). This work will require approval by the RVCA.
- In conjunction with the external flows proposed to be conveyed along Ottawa Street to the Jock River, the development lands south of Ottawa Street (as well as Ottawa Street drainage itself) will be collected and then treated by a proposed OGS unit prior to discharge eastward to the Jock River.
- The proposed stormwater management Pond 1 is designed to meet MECP Enhanced Level of suspended solid removal and will attenuate stormwater to limit impacts on water levels in the receiving Arbuckle Drain.
- The Green Lands West/East will be subject to grade raise restrictions ranging from 2.0 m in the roadways to 1.3 m to 1.5 m at the future residential units (depending on the fill used). Ultimately the grading plan will be reviewed and signed off by the geotechnical engineer or they will provide recommendations to suite.
- The Laffin Lands area is not subject to any grade raise restrictions.
- Erosion and sediment control measures will be implemented and maintained throughout construction.

FUNCTIONAL SERVICING REPORT
GREEN LANDS WEST & EAST
LAFFIN LANDS
(WESTERN DEVELOPMENT LANDS)

RICHMOND VILLAGE DEVELOPMENT CORPORATION
20-1183

Prepared by
David Schaeffer Engineering Ltd.

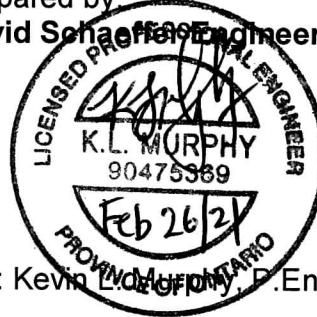

Per: Kevin L. Murphy, P.Eng.

© DSEL
20210226_FSR Green & Laffin Lands_Subm2.doc

APPENDIX A

PC2020-0062 – Perth and Ottawa Street Richmond: DRAFT

Friday March 13 2020

Attendance:

May Pham, Caivan

Matthew Hayley, Environmental Planner

Neeti Paudel, Transportation Engineer

Sarah McCormick, Planner

Damien Whittaker, Senior Engineer

Eric Lalande, RVCA

Reid Shepherd, Parks Planner

Cheryl McWilliams, Planner

Matthew Ippersiel, Urban Design (absent)

The proposal relates to residential subdivision development of lands known as the Green lands and the Laffin lands would see an additional approximately 600 plus units. There are a number of separate parcels at 6295, 6363, 6409 Perth Street and 6305 Ottawa Street.

General

Please note that this pre-consultation is only valid for one year. In addition, given the current sanitary servicing constraints in Richmond, capacity may not be available for the development of these sites until the completion of the final stage of the upgrades, which is the full replacement of the pump station not yet scheduled, so possibly 20 years away.

Given the timing and preliminary nature we are available to speak further on these matters and any revised plans.

Planning

- The road widths and cross-section, block depths and proposed setbacks must be demonstrated as supporting trees (one on each lot not just on average) as part of draft approval
- 16.5 m row widths will not be accepted
- The depths of the blocks must be adequate along the west lot line (Village boundary) to preserve any hedge row.
- There are some older trees on the house lot that should be preserved.
- Demonstrate consistency with the CDP and secondary plan for connections. Look at the north side potential of a MUP connecting across the drains to the east side of the van Gaal Drain to connect eventually to Cedarstone. Alternatively consider the hydro corridor. Royal York is the vehicular connection Mattamy is proposing to the village on

the south side. Burke Street connection as shown is also an option, but we would also want to see pedestrian links through to Meynell.

- Demonstrate compliance with the unit counts and density mixes per the CDP and secondary plan
- The sidewalk will need to be extended along Perth Street to the window street west of the Home Hardware.
- Servicing will need to be confirmed as available prior to supporting any draft approval.
- Consider approaching Hydro again with respect to their lands.
- The current version of the draft update to the Master Drainage Plan for the Western Development lands shows a 3rd storm pond within the hydro corridor and seems to be an in-line pond of the van Gaal. This is not acceptable.
- That same MDP is also showing much of the Laffin lands as a storm pond, which is consistent with the current approved version of the MDP but not the concept plan provided.
- An Archaeological Assessment will be needed
- The LandOwners Agreement and trustee sign-off will be required, for any works to commence.
- There is some sensitivity of the residents in Cedarstone Subdivision (north of Perth) to increases in traffic.
- There is a triangle parcel that is not owned and would limit frontage of the southern most lots on Mira.
- There is a small watercourse abutting the Laffin lands that will require some setback

Engineering

This is a follow-up to the pre-application consultation held on Friday March 13, 2020, at City Hall for regarding a proposal PC2020-0062 for development of the balance of the Western development Lands; 6363, 6409 and 6296 Perth Street in the City of Ottawa district of Rideau-Goulbourn (Ward 21) covered by Councillor Scott Moffatt. The purpose of the meeting was to identify and conduct a general overview of the key issues regarding the proposed development to ensure the application, when submitted, will be as complete as possible prior to circulation of the application and review.

Please find below City of Ottawa engineering/infrastructure information regarding an engineering design submission relevant to the proposed development. The information provided will assist the applicant for their plan of subdivision application.

Guidelines;

Please note that as this application is quite premature, the guidelines to be reviewed against will need to be the (future) amended versions, and there may even be guidelines in place then, that are not currently contemplated.

Water/Sanitary/Storm Servicing:

Water pipes:

Municipal water pipes will need to be extended to service the proposed development. The Western Development Lands developments will need to expand the well supply when appropriate and need to collectively expand the water storage at 28 l/s demand.

Sanitary Sewers:

No capacity exists in the sanitary sewer system presently and the application will not be accepted for draft approval for, probably, ten years, or more. Design parameters shall be the higher of the rates in the Sewer Design Guidelines, as amended and monitored flows. The developer shall apply I/I reduction techniques beyond that provided for the Fox Run Phase II development, that presently consists of blueskin wrap to the existing groundwater level and the use of pressure-rated pipe.

Storm Sewers:

The developer will need to extend conveyance systems in the Village of Richmond to include the development and, entirely at their cost, provide such extension.

Storm Water Management:

The consultant should determine a stormwater management regime for the application and, generally, maintain post-development flows to pre-development levels by way of providing storage to offset increased impervious areas. The existing runoff coefficient shall be taken as that from approved development; non-approved development should be ignored by the consultant in the determination of existing runoff coefficient and will not be taken into consideration by City engineering review staff.

Any existing stormwater runoff from adjacent site(s) that crosses the property must be accommodated by the proposed stormwater management design.

Stormwater quality control is required for the site. The Rideau Valley Conservation Authority (RVCA) can be contacted to determine the level of stormwater quality control required for the site.

All stormwater management determinations shall have supporting rationale.

Stormwater management solutions should be in concurrence with the content of the Western Development Lands Master Drainage Plan (MDP) that shows stormwater management ponds on both areas of proposed development; it is not clear how some of the development will proceed as the MDP plan currently shows the Laffin Lands to be entirely a SWM pond and SWM pond 1 was not designed to take more flow nor is there space for it to be expanded.

Please note that the SWM pond and upstream pipe/s and connected manholes shall be held in securities until the pond unit accepts the pond (at a date anticipated to be later than the rest of the subdivision)

A hydrogeological report will be required for each, and all, stormwater management ponds

Please note that LID will be required and that the forthcoming LID policy may impact the design.

Roads:

Please refer to the City of Ottawa Private Approach By-Law 2003-447 for the entrance design.

Please note that Council has adopted a safer roads initiative called the Road Safety Action Plan that requires local residential roads be both, signed and designed to a 30 km/h limit. This means that curvilinear design is required to deny vehicles from achieving speeds accessible on long straight roads.

Please note that 16.5 m ROW will not be permitted for the development.

Please note that 18 m ROW will not be permitted where either sensitive marine clay is found (whether named or not) or a sidewalk is proposed

Please note that a 25 m, or wider, ROW will be required for any road sections with two sidewalks.

Sensitive Marine Clay:

It is understood that sensitive marine clay (or by any other name) exists in the vicinity. Enhanced investigation will be required including, but not limited to: Atterberg limits testing, sensitivity analysis (if sensitivity analysis is not included an exhaustive discussion of why will be required), consolidation testing (cyclic and non-cyclic) and plasticity chart

Discussion of vibration induced loss of strength (by any name) is required

Discussion of retrogressive landslides is required.

Peer-reviewed and published papers may be necessary for the consultant's reviews; any papers/articles/journals/textbooks used shall be sufficiently provided to the City and the reference shall show unmistakable and undeniable concurrence with the consultant's usage.

Relatively impervious clay shall not be accepted as a reason for not applying LID.

High Performance design Standard:

In due time the City will have High Performance Design Standards in place that the proposal will need to adhere to that may include, but not be limited to; enhanced insulation, electrical generation, electrical grid security, reduced energy demand, reduced environmental "footprint".

Permits and Approvals:

Please note that approval through the Ministry of the Environment, Conservation and Parks (MECP), amongst other federal and provincial departments/agencies, including the Rideau Valley Conservation Authority (RVCA), will be required to facilitate the development: responsibility rests with the developer and their consultant for determining which approvals are needed and for obtaining all external agency approvals. The address shall be in good standing with all approval agencies, for example the RVCA, prior to approval. Copies of confirmation of correspondence will be required by the City of Ottawa from all approval agencies that a form of assent is given. Please note that a stormwater program for multiple lots is understood to be the expanded transfer-of-review type of Environmental Compliance

Approval (ECA) application with the MECP; please speak with your engineering consultant to understand the impact of time and cost this has on the application. An MECP ECA is not submitted until after planning approval. No construction shall commence until after a commence work notification is given from an engineering representative from Development Review.

Ministry of the Environment, Conservation and Parks	Rideau Valley Conservation Authority
Contact Information:	Contact Information:
Christina Des Rochers	Eric Lalande
Water Inspector	eric.lalande@rvca.ca
613-521-3450 ext. 231	
Chstina.Desrochers@ontario.ca	

Plan requirements:

Grading and Drainage Plans*

Erosion and Sediment Control Plan/s*

*All identified required plans are to be submitted on standard A1 size sheets as per City of Ottawa Servicing and Grading Plan Requirements and note the survey monument used to establish datum on the plans with sufficient information to enable a layperson to locate the monument.

Report Submission Requirements¹:

-Site Servicing Report

A plan is required that clearly shows the proposed water service layout.

-Storm Water Management Report

-Erosion and Sediment Control Measures

-Geotechnical Investigation Study

Please note that the area may contain sensitive marine clays. Please note that Atterberg limits, consolidation testing, grade raise restriction, and chemical analysis and discussion will be required in the report if sensitive marine clay is found. The geotechnical consultant will need to provide full copies of any published and peer reviewed papers relied on to determine results and conclusions

Earthquake analysis is now required to be provided in the report.

-Slope Stability Study (if topography deems necessary)

-Phase 1 Environmental Site Assessment (ESA)

The Phase 1 Environmental Site Assessment (ESA) as per O.Reg. 153/04. Phase 1 ESA documents performed to CSA standards are not acceptable.

Please find relevant City of Ottawa Links to Preparing Studies and Plans below:

Guide to preparing drawings for City of Ottawa engineering submissions

<https://ottawa.ca/en/city-hall/planning-and-development/information-developers/development-application-review-process/development-application-submission/guide-preparing-studies-and-plans#servicing-and-grading-plan-requirements>

Guide to preparing City of Ottawa Studies and Plans:

<http://ottawa.ca/en/development-application-review-process-0/guide-preparing-studies-and-plans>

Servicing Study Guidelines for Development Applications:

<https://ottawa.ca/en/city-hall/planning-and-development/information-developers/development-application-review-process/development-application-submission/guide-preparing-studies-and-plans#servicing-and-grading-plan-requirements>

To request City of Ottawa plan(s) or report information please contact the ISD Information Centre:

[Information Centre](#)

(613) 580-2424 ext. 44455

Please feel free to contact me if you have any questions.

Damien

Parks Planning

- Area Parks Plan (APP) is currently in place and was approved in 2019.
- The amenities and park sizes in the APP should be considered minimum requirements for any new proposals.
- If unit density is above that which is listed in the APP, park size requirements and/or Cash-in-Lieu will be larger than those required in the APP. These sizes would need to be determined once a more detailed proposal is put forward containing actual unit numbers.
- Parkland funding agreement required to be in place prior to registering any new phases of development in Western Lands.
- Parks recommends that the lotting pattern around the proposed northern parkette be adjusted to shift the park south so that it is adjacent to the hydro corridor that contains a proposed Multi-Use Pathway (MUP). The adjustment will improve connectivity from the MUP to the park, which was the intention behind the proposed location originally shown in the APP.

Reid Shepherd

Environmental Planning

- A Tree Conservation Report and an Environmental Impact Statement will be required
- A preliminary Integrated Environmental Impact Statement will be required at submission, and form part of the Planning Rationale.
- A 30 m setback is required for the watercourses to the north
- A minimum 6 m access will be needed to the watercourse buffer lands – likely best off the north end of the collector road.

Matthew Hayley

Transportation:

- Follow Traffic Impact Assessment Guidelines
 - Traffic Impact Assessment will be required. Proceed to scoping.
 - Start this process asap.
 - Applicant advised that their application will not be deemed complete until the submission of the draft step 1-4, including the functional draft RMA package (if applicable) and/or monitoring report (if applicable).
 - Request base mapping asap if RMA is required. Contact Engineering Services (<https://ottawa.ca/en/city-hall/planning-and-development/engineering-services>)
- ROW protection on Perth Street between Eagleson and Village Boundary is 30m even.
- Geometric Road Design (GRD) drawings will be required with the first submission of underground infrastructure and grading drawings. These drawings should include such items as, but is not limited to:
 - Road Signage and Pavement Marking for the subdivision;
 - Intersection control measure at new internal intersections; and
 - Location of depressed curbs and TWSIs;
 - More details can be provided upon request
- Include traffic calming measures on roads within the limits of their subdivision to limit vehicular speed and improve pedestrian safety. Traffic calming measures shall reference best management practices from the Canadian Guide to Neighbourhood Traffic Calming, published by the Transportation Association of Canada, and/or Ontario Traffic Manual, and/or the City of Ottawa's Draft Traffic Calming Design Guidelines. These measures may include either vertical or horizontal features (such measures shall not interfere with stormwater management and overland flow routing), including but not limited to:
 - intersection or mid block narrowings, chicanes, medians;
 - speed humps, speed tables, raised intersections, raised pedestrian crossings;
 - road surface alterations (for example, use of pavers or other alternate materials, provided these are consistent with the City's Official Plan policies related to Design Priority Areas);
 - pavement markings/signage; and
 - temporary/seasonal installations such as flexi posts or removable bollards.
- Corner triangles as per OP Annex 1 - Road Classification and Rights-of-Way at the following locations on the final plan will be required:
 - Local Road to Local Road: 3 metre x 3 metres
 - Local Road to Collector Road: 5 metre x 5 metres

- Collector Road to Collector Road: 5 metre x 5 metres
- Collector Road to Arterial Road: 5 metre x 5 metres
- Noise Impact Studies required (Road):
 - Feasibility before draft approval
 - Detailed before registration

-Residential streets (local and collector) are to be designed for 30 kph speed limits (posted).
(Direction from Councillors and Director of Traffic Services).

Neeti Paudel, P.Eng.

Rideau Valley Conservation Authority

- Some flood plain showing on the lands. Confirm that the realignment of the Van Gaal Drain resolves that
- Looking for 80% TSS removal for water quality
- Require a 30 metre setbacks from the drain to the north side of the Green lands.

Eric Lalande

Green Lands Urban Design Comments

- Ensure lot sizes, ROWs, and setbacks are sufficiently sized to achieve the design guidelines found in Section 7.4 of the Village of Richmond CDP. Currently, there may be enough space to achieve such guidelines as having enough space to plant a tree in the front yard, having a varied building setbacks, or parking a vehicle without it overhanging onto the sidewalk or street.
- Explore opportunities to integrate large-lot, village-style detached dwellings into the development along targeted and highly visible streets. See section 7.4.8 of the Village of Richmond CDP for additional details.
- Include a greater mix of the proposed building typologies. It appears the highest densities units have been clustered south of the hydro corridor.
- Open a vehicular connection to Perth Road as a gateway into the community, as shown in the Richmond CDP Demonstration Plan.
- If a window street is created adjacent to Perth Road, re-orient as many of the properties towards Perth as possible.
- Create pedestrian pathway connections in the north-most block to break up the long block and provide a link to a potential future pedestrian pathway north of the site. The pathways should be aligned with proposed north-south streets to create view corridors.
- It would be preferable to have the park open to the public realm on at least three sides, surrounded by single-loaded streets. Configure surrounding roads to have the park terminate views and offset the street grid.

Laffin Lands Urban Design Comments

- Relocate the proposed park to a more central location in the development that is well connected.
- Include mid-block pedestrian pathways to align with adjacent proposed pathways.

Matt Ippersiel

APPENDIX B

ENVIRONMENTAL COMPLIANCE APPROVAL

NUMBER 1528-BLFNVH
Issue Date: February 24, 2020

Richmond Village Development Corporation
2934 Baseline Road, Unit 302
Ottawa, Ontario
K2H 1B2

Site Location: Fox Run Subdivision - Phase 2 (North)
6335 Perth Street
City of Ottawa, Ontario

You have applied under section 20.2 of Part II.1 of the Environmental Protection Act, R.S.O. 1990, c. E. 19 (Environmental Protection Act) for approval of:

the establishment of wastewater infrastructure Works located in the City of Ottawa, consisting of the following:

- **storm sewers** on proposed Trammel Road (from Station 0-14.006 to Station 0-0.25, and from Station 0-0.25 to Station 0+187.215), proposed Postilion Street (from Station 0+160 to Station 0+149.62, and from Station 0+149.62 to 0-1.995), proposed Latigo Ridge (from Station 0+1.952 to Station 0+151.572), proposed Chasing Grove (from Station 0+2.05 to Station 0+151.67), proposed Brush Lane (from Station 0+85.71 to Station 0+151.63), proposed Bascule Place (from Station 0+135.562 to Station 0+197.009, from Station 0+135.562 to Station 0+71.69, from Station 0+71.69 to 0+34.591, and from Station 0+34.591 to 0+2.202), proposed Vaulting Crescent (from Station 0+7.492 to Station 0+53.326), proposed Oldenburg Avenue (from Station 0+238.745 to Station 0+223.481, and from Station 223.481 to Station 0+0.813), Perth Street (from adjacent Block 221 to Station 0+241.788, from Station 0+36.821 to 0+476.497, from Station 0+476.497 to Station 0+37.095, from southwest of Block 282 to 0+242.061, from Station 240.762 to Station 0+285.925, and from Station 285.925 to 0+335.294), proposed Griseo Way (from Station 0+36.761 to Station 0+2.021), and servicing Block 280, discharging to the existing stormwater management facility, located southeast of the intersection of Perth Street and Meynell Road; and
- **sanitary sewers** on proposed Trammel Road (from Station 0+72.432 to Station 0+133.61, from Station 0+180.711 to Station 0+133.61, from Station 0+72.432 to Station 0-0.25, and from Station -0+14.006 to Station 0+0.25), proposed Postilion Street (from Station 0+160.000 to Station 0+0.000), proposed Latigo Ridge (from Station 0+0.000 to Station 149.620), proposed Chasing Grove (from Station 0+0.000 to Station 0+149.620), proposed Bascule Place (from Station 0+194.808 to Station 0+72.432, and from Station 0+72.432 to 0-0.25), and proposed Oldenburg Avenue (from Station 0+238.745 to Station 0+75.807, and from Station 0+75.807 to Station 0-14.971), discharging to existing sanitary sewers, located

on Meynell Road (southeast of Perth Street);

including erosion/sedimentation control measures during construction and all other controls and appurtenances essential for the proper operation of the aforementioned Works;

all in accordance with the submitted application and supporting documents listed in Schedule "A" forming part of this approval.

For the purpose of this environmental compliance approval, the following definitions apply:

DEFINITIONS

1. "Approval" means this entire document and any schedules attached to it, and the application;
2. "Director" means a person appointed by the Minister pursuant to section 5 of the EPA for the purposes of Part II.1 of the EPA;
3. "District Manager" means the District Manager of the appropriate local District Office of the Ministry, where the Works are geographically located;
4. "EPA" means the *Environmental Protection Act*, R.S.O. 1990, c.E.19, as amended;
5. "Ministry" means the ministry of the government of Ontario responsible for the EPA and OWRA and includes all officials, employees or other persons acting on its behalf;
6. "Owner" means Richmond Village Development Corporation, and includes its successors and assignees;
7. "OWRA" means the Ontario Water Resources Act, R.S.O. 1990, c. O.40, as amended;
8. "Works" means the sewage Works described in the Owner's application, and this Approval.

You are hereby notified that this environmental compliance approval is issued to you subject to the terms and conditions outlined below:

TERMS AND CONDITIONS

1. GENERAL CONDITIONS

1. The Owner shall ensure that any person authorized to carry out work on or operate any aspect of the Works is notified of this Approval and the conditions herein and shall take all reasonable measures to ensure any such person complies with the same.

2. Except as otherwise provided by these Conditions, the Owner shall design, build, install, operate and maintain the Works in accordance with the description given in this Approval, and the application for approval of the Works.
3. Where there is a conflict between a provision of any document in the schedule referred to in this Approval and the conditions of this Approval, the conditions in this Approval shall take precedence, and where there is a conflict between the documents in the schedule, the document bearing the most recent date shall prevail.
4. Where there is a conflict between the documents listed in Schedule "A" and the application, the application shall take precedence unless it is clear that the purpose of the document was to amend the application.
5. The conditions of this Approval are severable. If any condition of this Approval, or the application of any requirement of this Approval to any circumstance, is held invalid or unenforceable, the application of such condition to other circumstances and the remainder of this Approval shall not be affected thereby.

2. EXPIRY OF APPROVAL

1. This Approval will cease to apply to those parts of the Works which have not been constructed within five (5) years of the date of this Approval.
2. In the event that completion and commissioning of any portion of the Works is anticipated to be delayed beyond the specified expiry period, the Owner shall submit an application of extension to the expiry period, at least twelve (12) months prior to the end of the period. The application for extension shall include the reason(s) for the delay, whether there is any design change(s) and a review of whether the standards applicable at the time of Approval of the Works are still applicable at the time of request for extension, to ensure the ongoing protection of the environment.

3. CHANGE OF OWNER

1. The Owner shall notify the District Manager and the Director, in writing, of any of the following changes within thirty (30) days of the change occurring:
 - a. change of Owner;
 - b. change of address of the Owner;
 - c. change of partners where the Owner is or at any time becomes a partnership, and a copy of the most recent declaration filed under the *Business Names Act*, R.S.O. 1990, c.B17 shall be included in the notification to the District Manager; or
 - d. change of name of the corporation where the Owner is or at any time becomes a

corporation, and a copy of the most current information filed under the Corporations Information Act, R.S.O. 1990, c. C39 shall be included in the notification to the District Manager.

2. In the event of any change in ownership of the Works, other than a change to a successor municipality, the Owner shall notify in writing the succeeding owner of the existence of this Approval, and a copy of such notice shall be forwarded to the District Manager and the Director.
3. The Owner shall ensure that all communications made pursuant to this condition refer to the number at the top of this Approval.

4. OPERATION AND MAINTENANCE

1. If applicable, any proposed storm sewers or other stormwater conveyance in this Approval can be constructed but not operated until the proposed stormwater management facilities in this Approval or any other Approval that are designed to service the storm sewers or other stormwater conveyance are in operation.

Schedule "A"

1. Application for Environmental Compliance Approval, dated December 12, 2019, received on January 20, 2020, submitted by Richmond Village Development Corporation;
2. Transfer of Review Letter of Recommendation, dated January 14, 2020, revised on January 31, 2020, and signed by Damien Whittaker, P. Eng., Senior Engineer - Infrastructure Applications, Planning, Infrastructure and Economic Development Department, City of Ottawa;
 - a. Final Plans and Specifications prepared by David Schaeffer Engineering Ltd.
 - b. Pipe Data Form - Watermain, Storm Sewer, Sanitary Sewer, and Forcemain Design Supplement to Application for Approval for Water and Sewage Works.
 - c. Hydraulic Design Sheets prepared by David Schaeffer Engineering Ltd.
3. Emails dated January 30, 2020, January 31, 2020, and February 7, 2020, from Damien Whittaker, P. Eng., City of Ottawa.
4. Emails dated February 3, 2020 and February 7, 2020, from Kevin Murphy, David Schaeffer Engineering Ltd.

The reasons for the imposition of these terms and conditions are as follows:

1. Condition 1 is imposed to ensure that the Works are constructed and operated in the manner in which they were described and upon which approval was granted. This condition is also included to emphasize the precedence of conditions in the Approval and the practice that the Approval is based on the most current document, if several conflicting documents are submitted for review.
2. Condition 2 is included to ensure that, when the Works are constructed, the Works will meet the standards that apply at the time of construction to ensure the ongoing protection of the environment.
3. Condition 3 is included to ensure that the Ministry records are kept accurate and current with respect to the approved Works and to ensure that subsequent owners of the Works are made aware of the Approval and continue to operate the Works in compliance with it.
4. Condition 4 is included to prevent the operation of stormwater pipes and other conveyance until such time that their required associated stormwater management Works are also constructed.

In accordance with Section 139 of the Environmental Protection Act, you may by written Notice served upon me and the Environmental Review Tribunal within 15 days after receipt of this Notice, require a hearing by the Tribunal. Section 142 of the Environmental Protection Act provides that the Notice requiring the hearing shall state:

- a. The portions of the environmental compliance approval or each term or condition in the environmental compliance approval in respect of which the hearing is required, and;
- b. The grounds on which you intend to rely at the hearing in relation to each portion appealed.

The Notice should also include:

1. The name of the appellant;
2. The address of the appellant;
3. The environmental compliance approval number;
4. The date of the environmental compliance approval;
5. The name of the Director, and;
6. The municipality or municipalities within which the project is to be engaged in.

And the Notice should be signed and dated by the appellant.

This Notice must be served upon:

The Secretary*
Environmental Review Tribunal
655 Bay Street, Suite 1500
Toronto, Ontario
M5G 1E5

AND

The Director appointed for the purposes of
Part II.1 of the Environmental Protection Act
Ministry of the Environment,
Conservation and Parks
135 St. Clair Avenue West, 1st Floor
Toronto, Ontario
M4V 1P5

* Further information on the Environmental Review Tribunal's requirements for an appeal can be obtained directly from the Tribunal at: Tel: (416) 212-6349, Fax: (416) 326-5370 or www.ert.gov.on.ca

The above noted activity is approved under s.20.3 of Part II.1 of the Environmental Protection Act.

DATED AT TORONTO this 24th day of February, 2020

A handwritten signature in black ink that reads "Aziz Ahmed". The signature is written in a cursive style and is underlined with a single horizontal line.

Aziz Ahmed, P.Eng.

Director

appointed for the purposes of Part II.1 of the
Environmental Protection Act

CA/

c: District Manager, MECP Ottawa
Clerk, City of Ottawa (File No. D07-16-19-0009)
Damien Whittaker, City of Ottawa
Kevin Murphy, David Schaeffer Engineering Ltd.

AMENDED ENVIRONMENTAL COMPLIANCE APPROVAL

NUMBER 1608-BPHMBF
Issue Date: May 19, 2020

Richmond Village Development Corporation
2934 Baseline Road, Unit 302
Ottawa, Ontario
K2H 1B2

Site Location: Fox Run Subdivision
6350 Perth Street
City of Ottawa, Ontario

You have applied under section 20.2 of Part II.1 of the Environmental Protection Act, R.S.O. 1990, c. E. 19 (Environmental Protection Act) for approval of:

modifications to existing stormwater management Works to serve the Western Development Lands and related to the Fox Run subdivision Phase II (North), located in the City of Ottawa, for the collection, transmission, treatment and disposal of stormwater runoff from a total catchment area of 185.19 hectares, to provide Enhanced Level water quality protection and erosion control, baseflow augmentation, and to attenuate post-development peak flows to pre-development peak flows for all storm events up to and including the 100-year storm event, discharging to the Van Gaal/Arbuckle Drain, consisting of the following:

- **stormwater management facility (catchment area 185.19 hectares):** one (1) wet pond with two existing sediment forebays and the inclusion of an additional sediment forebay, located southeast of Perth Street, southwest of Queen Charlotte Street North and northeast of Meynell Road, having a permanent storage volume of 45,330 cubic metres, an extended detention volume of 43,875 cubic metres, and a total storage volume of 66,394 cubic metres including the permanent pool, at a total depth of 1.85 metres, and a new additional inlet structure consisting of a 2100 millimetre and a 975 millimetre diameter series of storm inlet pipes and a concrete headwall, an existing middle inlet of a 1200 millimetre diameter pipe and a concrete headwall, and 'south' inlet consisting of a 1350 millimetre and a 1650 millimetre diameter series of pipes; an outlet structure comprised of a 900 millimetre diameter storm outlet pipe equipped with a 300 millimetre diameter orifice, allowing a maximum extended detention discharge of 440 litres per second under the 100-year storm event to the Van Gaal/Arbuckle Drain, located to east of the pond, cool drain baseflow augmentation via a 100 millimetre diameter orifice and a 300 millimetre diameter pipe providing 28 litres per second and, for emergency events, a 45 metre wide spillway is also provided in

collaboration with an 88.5 metre long quantity control weir;

including erosion/sedimentation control measures during construction and all other controls and appurtenances essential for the proper operation of the aforementioned Works;

all in accordance with the submitted application and supporting documents listed in Schedule "A" forming part of this Approval.

For the purpose of this environmental compliance approval, the following definitions apply:

1. "Approval" means this entire document and any schedules attached to it, and the application;
2. "Director" means a person appointed by the Minister pursuant to section 5 of the EPA for the purposes of Part II.1 of the EPA;
3. "District Manager" means the District Manager of the appropriate local District Office of the Ministry, where the Works are geographically located;
4. "EPA" means the *Environmental Protection Act*, R.S.O. 1990, c.E.19, as amended;
5. "Ministry" means the ministry of the government of Ontario responsible for the EPA and OWRA and includes all officials, employees or other persons acting on its behalf;
6. "Owner" means Richmond Village Development Corporation, and includes its successors and assignees;
7. "OWRA" means the *Ontario Water Resources Act*, R.S.O. 1990, c. O.40 , as amended;
8. "Works" means the sewage Works described in the Owner's application, and this Approval.

You are hereby notified that this environmental compliance approval is issued to you subject to the terms and conditions outlined below:

TERMS AND CONDITIONS

1. GENERAL CONDITIONS

1. The Owner shall ensure that any person authorized to carry out work on or operate any aspect of the Works is notified of this Approval and the conditions herein and shall take all reasonable measures to ensure any such person complies with the same.
2. Except as otherwise provided by these Conditions, the Owner shall design, build, install, operate and maintain the Works in accordance with the description given in this Approval, and the

application for approval of the Works.

3. Where there is a conflict between a provision of any document in the schedule referred to in this Approval and the conditions of this Approval, the conditions in this Approval shall take precedence, and where there is a conflict between the documents in the schedule, the document bearing the most recent date shall prevail.
4. Where there is a conflict between the documents listed in Schedule "A" and the application, the application shall take precedence unless it is clear that the purpose of the document was to amend the application.
5. The conditions of this Approval are severable. If any condition of this Approval, or the application of any requirement of this Approval to any circumstance, is held invalid or unenforceable, the application of such condition to other circumstances and the remainder of this Approval shall not be affected thereby.

2. EXPIRY OF APPROVAL

1. This Approval will cease to apply to those parts of the Works which have not been constructed within five (5) years of the date of this Approval.
2. In the event that completion and commissioning of any portion of the Works is anticipated to be delayed beyond the specified expiry period, the Owner shall submit an application of extension to the expiry period, at least twelve (12) months prior to the end of the period. The application for extension shall include the reason(s) for the delay, whether there is any design change(s) and a review of whether the standards applicable at the time of Approval of the Works are still applicable at the time of request for extension, to ensure the ongoing protection of the environment.

3. CHANGE OF OWNER

1. The Owner shall notify the District Manager and the Director, in writing, of any of the following changes within thirty (30) days of the change occurring:
 - a. change of Owner;
 - b. change of address of the Owner;
 - c. change of partners where the Owner is or at any time becomes a partnership, and a copy of the most recent declaration filed under the *Business Names Act*, R.S.O. 1990, c.B17 shall be included in the notification to the District Manager; or

- d. change of name of the corporation where the Owner is or at any time becomes a corporation, and a copy of the most current information filed under the *Corporations Information Act*, R.S.O. 1990, c. C39 shall be included in the notification to the District Manager.
2. In the event of any change in ownership of the Works, other than a change to a successor municipality, the Owner shall notify in writing the succeeding owner of the existence of this Approval, and a copy of such notice shall be forwarded to the District Manager and the Director.
3. The Owner shall ensure that all communications made pursuant to this condition refer to the number at the top of this Approval.

4. OPERATION AND MAINTENANCE

1. If applicable, any proposed storm sewers or other stormwater conveyance in this Approval can be constructed but not operated until the proposed stormwater management facilities in this Approval or any other Approval that are designed to service the storm sewers or other stormwater conveyance are in operation.
2. The Owner shall make all necessary investigations, take all necessary steps and obtain all necessary approvals so as to ensure that the physical structure, siting and operations of the Works do not constitute a safety or health hazard to the general public.
3. The Owner shall inspect and ensure that the design minimum liquid retention volume is maintained in the Works at all times, except when maintenance is required.
4. The Owner shall undertake an inspection of the condition of the Works, at least once a year, and undertake any necessary cleaning and maintenance to ensure that sediment, debris and excessive decaying vegetation are removed from the Works to prevent the excessive build-up of sediment, oil/grit, debris and/or decaying vegetation, to avoid reduction of the capacity and/or permeability of the Works, as applicable. The Owner shall also regularly inspect and clean out the inlet to and outlet from the Works to ensure that these are not obstructed.
5. The Owner shall construct, operate and maintain the Works with the objective that the effluent from the Works is essentially free of floating and settleable solids and does not contain oil or any other substance in amounts sufficient to create a visible film, sheen, foam or discoloration on the receiving waters.
6. The Owner shall maintain a logbook to record the results of these inspections and any cleaning and maintenance operations undertaken, and shall keep the logbook at the Owner's administrative office for inspection by the Ministry. The logbook shall include the following:
 - a. the name of the Works; and

- b. the date and results of each inspection, maintenance and cleaning, including an estimate of the quantity of any materials removed and method of clean-out of the Works.
7. The Owner shall prepare an operations manual prior to the commencement of operation of the Works that includes, but is not necessarily limited to, the following information:
 - a. operating and maintenance procedures for routine operation of the Works;
 - b. inspection programs, including frequency of inspection, for the Works and the methods or tests employed to detect when maintenance is necessary;
 - c. repair and maintenance programs, including the frequency of repair and maintenance for the Works;
 - d. contingency plans and procedures for dealing with potential spills and any other abnormal situations and for notifying the District Manager; and
 - e. procedures for receiving, responding and recording public complaints, including recording any follow-up actions taken.
8. The Owner shall maintain the operations manual current and retain a copy at the Owner's administrative office for the operational life of the Works. Upon request, the Owner shall make the manual available to Ministry staff.

5. TEMPORARY EROSION AND SEDIMENT CONTROL

1. The Owner shall install and maintain temporary sediment and erosion control measures during construction and conduct inspections once every two (2) weeks and after each significant storm event (a significant storm event is defined as a minimum of 25 mm of rain in any 24 hours period). The inspections and maintenance of the temporary sediment and erosion control measures shall continue until they are no longer required and at which time they shall be removed and all disturbed areas reinstated properly.
2. The Owner shall maintain records of inspections and maintenance which shall be made available for inspection by the Ministry, upon request. The record shall include the name of the inspector, date of inspection, and the remedial measures, if any, undertaken to maintain the temporary sediment and erosion control measures.

6. REPORTING

1. One (1) week prior to the start-up of the operation of the Works, the Owner shall notify the District Manager (in writing) of the pending start-up date.

2. The Owner shall, upon request, make all reports, manuals, plans, records, data, procedures and supporting documentation available to Ministry staff.
3. The Owner shall prepare a performance report within ninety (90) days following the end of the period being reported upon, and submit the report(s) to the District Manager when requested. The first such report shall cover the first annual period following the commencement of operation of the Works and subsequent reports shall be prepared to cover successive annual periods following thereafter. The reports shall contain, but shall not be limited to, the following information:
 - a. a description of any operating problems encountered and corrective actions taken;
 - b. a summary of all maintenance carried out on any major structure, equipment, apparatus, mechanism or thing forming part of the Works, including an estimate of the quantity of any materials removed from the Works;
 - c. a summary of any complaints received during the reporting period and any steps taken to address the complaints;
 - d. a summary of all spill or abnormal discharge events; and
 - e. any other information the District Manager requires from time to time.

7. RECORD KEEPING

1. The Owner shall retain for a minimum of five (5) years from the date of their creation, all records and information related to or resulting from the operation, maintenance and monitoring activities required by this Approval.

Schedule "A"

1. Application for Environmental Compliance Approval, dated March 27, 2020, received on April 30, 2020, submitted by Richmond Village Development Corporation;
2. Transfer of Review Letter of Recommendation, dated April 30, 2020 and signed by Damien Whittaker, P.Eng., Infrastructure Applications, Development Review, City of Ottawa, including the following supporting documents:
 - a. Final Plans and Specifications prepared by David Schaeffer Engineering Ltd.
 - b. Stormwater Management Report prepared by David Schaeffer Engineering Ltd.
 - c. Design Brief for Stormwater Management Pond 1, Western Development Lands - Richmond, Revised March 2020, prepared by J.F. Sabourin and Associates & David Schaeffer Engineering Ltd.
3. Emails received on May 7, 2020, May 8, 2020, May 12, 2020, and May 13, 2020 from Damien Whittaker, P. Eng., City of Ottawa.

The reasons for the imposition of these terms and conditions are as follows:

1. Condition 1 is imposed to ensure that the Works are constructed and operated in the manner in which they were described and upon which approval was granted. This condition is also included to emphasize the precedence of conditions in the Approval and the practice that the Approval is based on the most current document, if several conflicting documents are submitted for review.
2. Condition 2 is included to ensure that, when the Works are constructed, the Works will meet the standards that apply at the time of construction to ensure the ongoing protection of the environment.
3. Condition 3 is included to ensure that the Ministry records are kept accurate and current with respect to the approved Works and to ensure that subsequent owners of the Works are made aware of the Approval and continue to operate the Works in compliance with it.
4. Condition 4 is included as regular inspection and necessary removal of sediment and excessive decaying vegetation from the Works are required to mitigate the impact of sediment, debris and/or decaying vegetation on the treatment capacity of the Works. The Condition also ensures that adequate storage is maintained in the Works at all times as required by the design. Furthermore, this Condition is included to ensure that the Works are operated and maintained to function as designed.
5. Condition 5 is included as installation, regular inspection and maintenance of the temporary sediment and erosion control measures is required to mitigate the impact on the downstream receiving watercourse during construction until they are no longer required.
6. Condition 6 is included to provide a performance record for future references, to ensure that the Ministry is made aware of problems as they arise, and to provide a compliance record for all the terms and conditions outlined in this Approval, so that the Ministry can work with the Owner in resolving any problems in a timely manner.
7. Condition 7 is included to require that all records are retained for a sufficient time period to adequately evaluate the long-term operation and maintenance of the Works.

Upon issuance of the environmental compliance approval, I hereby revoke Approval No(s). 1060-AY8JK4 issued on May 30, 2018.

In accordance with Section 139 of the Environmental Protection Act, you may by written Notice served upon me and the Environmental Review Tribunal within 15 days after receipt of this Notice, require a hearing by the Tribunal. Section 142 of the Environmental Protection Act provides that the Notice requiring the hearing shall state:

- a. The portions of the environmental compliance approval or each term or condition in the environmental compliance approval in respect of which the hearing is required, and;
- b. The grounds on which you intend to rely at the hearing in relation to each portion appealed.

Pursuant to subsection 139(3) of the Environmental Protection Act, a hearing may not be required with respect to any terms and conditions in this environmental compliance approval, if the terms and conditions are substantially the same as those contained in an approval that is amended or revoked by this environmental compliance approval.

The Notice should also include:

1. The name of the appellant;
2. The address of the appellant;
3. The environmental compliance approval number;
4. The date of the environmental compliance approval;
5. The name of the Director, and;
6. The municipality or municipalities within which the project is to be engaged in.

And the Notice should be signed and dated by the appellant.

This Notice must be served upon:

The Secretary*
Environmental Review Tribunal
655 Bay Street, Suite 1500
Toronto, Ontario
M5G 1E5

AND

The Director appointed for the purposes of Part II.1 of
the Environmental Protection Act
Ministry of the Environment, Conservation and Parks
135 St. Clair Avenue West, 1st Floor
Toronto, Ontario
M4V 1P5

*** Further information on the Environmental Review Tribunal's requirements for an appeal can be obtained directly from the Tribunal at: Tel: (416) 212-6349, Fax: (416) 326-5370 or www.ert.gov.on.ca**

The above noted activity is approved under s.20.3 of Part II.1 of the Environmental Protection Act.

DATED AT TORONTO this 19th day of May, 2020



Aziz Ahmed, P.Eng.
Director
appointed for the purposes of Part II.1 of the
Environmental Protection Act

SW/

c: District Manager, MECP Ottawa District Office
City Clerk, City of Ottawa
Damien Whittaker, P. Eng., Senior Engineer, Infrastructure Applications, City of Ottawa
Kevin Murphy, David Schaeffer Engineering Ltd.

ENVIRONMENTAL COMPLIANCE APPROVAL

NUMBER 9297-AV9KAL

Issue Date: January 25, 2018

Richmond Village Development Corporation
2934 Baseline Road, Unit 302
Ottawa, Ontario
K2H 1B2

Site Location: Caivan Communities - Richmond Phase 1
6350 Perth Street
City of Ottawa, Ontario

You have applied under section 20.2 of Part II.1 of the Environmental Protection Act, R.S.O. 1990, c. E. 19 (Environmental Protection Act) for approval of:

sanitary and storm sewers to be constructed in the City of Ottawa, as follows:

- sanitary sewers on Meynell Road (from Station 0+671.0 to Station 1+225.3), Cattle Crescent (from Station 0+000.0 to Station 0+267.9), Pelham Crescent (from Station 0-013.0 to Station 0+377.6), Reynard Crescent (from Station 0+000.0 to Station 0+308.6), Noriker Court (from Station 0-014.0 to Station 0+228.3), Hackamore Crescent (from Station 0+000.0 to Station 0+084.3), Equitation Circle (from Station 0+000.0 to Station 0+503.4), and Pond Inlet 3 - Storm Trunk 2 (from Station 0+080.0 to Station 0+172.6), discharging to Richmond Stormwater Management Pond 1, located in the City of Ottawa; and
- storm sewers on Meynell Road (from Station 0+687.1 to Station 1+225.7), Cattle Crescent (from Station 0+002.5 to Station 0+267.9), Pelham Crescent (from Station 0-013.5 to Station 0+380.0), Reynard Crescent (from Station 0-002.0 to Station 0+310.6), Noriker Court (from Station 0-016.0 to Station 0+238.0), Hackamore Crescent (from Station 0-002.5 to Station 0+084.3), Equitation Circle (from Station 0+002.5 to Station 0+505.8), Block 235 (from Station 0+002.5 to Station 0+070.8), Pond Inlet 2 (from Station 0+006.9 to Station 0+076.8), Pond Inlet 3 - Storm Trunk 1 (from Station 0+003.9 to Station 0+162.3), and Pond Inlet 3 - Storm Trunk 2 (from Station 0+077.7 to Station 0+206.7), discharging to Richmond Stormwater Management Pond 1, located in the City of Ottawa;

all in accordance with the submitted application and supporting documents listed in Schedule "A" forming part of this approval.

For the purpose of this environmental compliance approval, the following definitions apply:

1. "Approval" means this entire document and any schedules attached to it, and the application;
2. "Director" means a person appointed by the Minister pursuant to section 5 of the EPA for the purposes of Part II.1 of the EPA;
3. "District Manager" means the District Manager of the appropriate local District Office of the Ministry, where the Works are geographically located;
4. "EPA" means the Environmental Protection Act, R.S.O. 1990, c.E.19, as amended;
5. "Ministry" means the ministry of the government of Ontario responsible for the EPA and OWRA and includes all officials, employees or other persons acting on its behalf;
6. "Owner" means Richmond Village Development Corporation, and includes their successors and assignees;
7. "OWRA" means the Ontario Water Resources Act, R.S.O. 1990, c. O.40, as amended;
8. "Significant Threat Policy(ies)" has the same meaning as in the Clean Water Act, 2006;
9. "Source Protection Plan" means a drinking water source protection plan prepared under the Clean Water Act, 2006;
10. "Works" means the sewage works described in the Owner's application, and this Approval.

You are hereby notified that this environmental compliance approval is issued to you subject to the terms and conditions outlined below:

TERMS AND CONDITIONS

1. GENERAL CONDITIONS

1. The Owner shall ensure that any person authorized to carry out work on or operate any aspect of the Works is notified of this Approval and the conditions herein and shall take all reasonable measures to ensure any such person complies with the same.
2. Except as otherwise provided by these Conditions, the Owner shall design, build, install, operate and maintain the Works in accordance with the description given in this Approval, and the application for approval of the Works.
3. Where there is a conflict between a provision of any document in the schedule referred to in this Approval and the conditions of this Approval, the conditions in this Approval shall take precedence, and where there is a conflict between the documents in the schedule, the document bearing the most recent date shall prevail.

4. Where there is a conflict between the documents listed in Schedule "A" and the application, the application shall take precedence unless it is clear that the purpose of the document was to amend the application.
5. The conditions of this Approval are severable. If any condition of this Approval, or the application of any requirement of this Approval to any circumstance, is held invalid or unenforceable, the application of such condition to other circumstances and the remainder of this Approval shall not be affected thereby.

2. EXPIRY OF APPROVAL

1. This Approval will cease to apply to those parts of the Work which have not been constructed within five (5) years of the date of this Approval.
2. In the event that completion and commissioning of any portion of the Works is anticipated to be delayed beyond the specified expiry period, the Owner shall submit an application of extension to the expiry period, at least twelve (12) months prior to the end of the period. The application for extension shall include the reason(s) for the delay, whether there is any design change(s) and a review of whether the standards applicable at the time of Approval of the Works are still applicable at the time of request for extension, to ensure the ongoing protection of the environment.

3. CHANGE OF OWNER

1. The Owner shall notify the District Manager and the Director, in writing, of any of the following changes within thirty (30) days of the change occurring:
 - a. change of Owner;
 - b. change of address of the Owner;
 - c. change of partners where the Owner is or at any time becomes a partnership, and a copy of the most recent declaration filed under the Business Names Act, R.S.O. 1990, c.B17 shall be included in the notification to the District Manager; or
 - d. change of name of the corporation where the Owner is or at any time becomes a corporation, and a copy of the most current information filed under the Corporations Information Act, R.S.O. 1990, c. C39 shall be included in the notification to the District Manager.
2. In the event of any change in ownership of the Works, other than a change to a successor municipality, the Owner shall notify in writing the succeeding owner of the existence of this Approval, and a copy of such notice shall be forwarded to the District Manager and the Director.
3. The Owner shall ensure that all communications made pursuant to this condition refer to the number at the top of this Approval.

4. Notwithstanding any other requirements in this Approval, upon transfer of the ownership or assumption of the Works to a municipality if applicable, any reference to the District Manager shall be replaced with the Water Supervisor.

4. OPERATION AND MAINTENANCE

1. If applicable, any proposed storm sewers or other stormwater conveyance in this Approval can be constructed but not operated until the proposed stormwater management facilities in this Approval or any other Approval that are designed to service the storm sewers or other stormwater conveyance are in operation.

5. SOURCE WATER PROTECTION

1. The Owner shall ensure, if applicable, that the design, construction and operation of the Works conforms to any Significant Threat Policies in any Source Protection Plan that applies to the location of the Works.

SCHEDULE "A"

1. Application for Environmental Compliance Approval for Municipal and Private Sewage Works, dated December 19, 2017 and received on December 28, 2017, submitted by Richmond Village Development Corporation.
2. Transfer of Review Letter of Recommendation, dated December 28, 2017 and signed by Damien Whittaker, Senior Engineer, City of Ottawa.

The reasons for the imposition of these terms and conditions are as follows:

1. Condition 1 is imposed to ensure that the Works are constructed and operated in the manner in which they were described and upon which approval was granted. This condition is also included to emphasize the precedence of conditions in the Approval and the practice that the Approval is based on the most current document, if several conflicting documents are submitted for review.
2. Condition 2 is included to ensure that, when the Works are constructed, the Works will meet the standards that apply at the time of construction to ensure the ongoing protection of the environment.
3. Condition 3 is included to ensure that the Ministry records are kept accurate and current with respect to approved Works and to ensure that subsequent owners of the Works are made aware of the Approval and continue to operate the Works in compliance with it.
4. Condition 4 is included to prevent the operation of stormwater pipes and other conveyance until such time that their required associated stormwater management Works are also constructed.
5. Condition 5 is included to ensure that the Works conform to the policies of the local Source Water Protection Plan.

In accordance with Section 139 of the Environmental Protection Act, you may by written Notice served upon me and the Environmental Review Tribunal within 15 days after receipt of this Notice, require a hearing by the Tribunal. Section 142 of the Environmental Protection Act provides that the Notice requiring the hearing shall state:

- a. The portions of the environmental compliance approval or each term or condition in the environmental compliance approval in respect of which the hearing is required, and;
- b. The grounds on which you intend to rely at the hearing in relation to each portion appealed.

The Notice should also include:

1. The name of the appellant;
2. The address of the appellant;
3. The environmental compliance approval number;
4. The date of the environmental compliance approval;
5. The name of the Director, and;
6. The municipality or municipalities within which the project is to be engaged in.

And the Notice should be signed and dated by the appellant.

This Notice must be served upon:

The Secretary*
Environmental Review Tribunal
655 Bay Street, Suite 1500
Toronto, Ontario
M5G 1E5

AND

The Director appointed for the purposes of
Part II.1 of the Environmental Protection Act
Ministry of the Environment and
Climate Change
135 St. Clair Avenue West, 1st Floor
Toronto, Ontario
M4V 1P5

* Further information on the Environmental Review Tribunal's requirements for an appeal can be obtained directly from the Tribunal at: Tel: (416) 212-6349, Fax: (416) 326-5370 or www.ert.gov.on.ca

The above noted activity is approved under s.20.3 of Part II.1 of the Environmental Protection Act.

DATED AT TORONTO this 25th day of January, 2018



Christina Labarge, P.Eng.
Director
appointed for the purposes of Part II.1 of the
Environmental Protection Act

RS/

c: District Manager, MOECC Ottawa
City Clerk, City of Ottawa (File No. D07-16-11-0014)
Linda Carkner, Program Manager, Right of Way Unit (MC 26-61)
Harry R. Alvey, P.E., P.Eng., Project Manager, Rural Branch
Kevin Murphy, David Schaeffer Engineering Ltd.

APPENDIX C

To:	Kevin Murphy David Schaeffer Engineering Ltd.	From:	Jasmin Sidhu / Kevin Alemany Stantec Consulting Ltd.
File:	163401550	Date:	February 26, 2021

Reference: Richmond Caivan Green & Laffin Lands – Potable Water Capacity Analysis

OVERVIEW

To support David Schaeffer Engineering Ltd. (DSEL) with their Functional Servicing Report, Stantec Consulting Ltd. (Stantec) was retained by Richmond Village Development Corporation (RVDC) to complete a potable water hydraulic analysis for Caivan’s recently acquired properties within the Richmond Western Development Lands.

To date, Stantec has completed hydraulic analyses for the water distribution system internal to the Western Development Lands, including that within Caivan’s Richmond Fox Run development lands (Phases 1 and 2) and under buildout conditions.

Caivan has recently acquired additional property in the Western Development Lands, including:

- (1) The lands adjacent to their Fox Run Phase 2 subdivision lands on the north side of Perth Street, including Green Lands West and Fox Run Phase 3 (formerly identified as ‘Other’ as part of previous potable water analyses complete for the Western Development Lands), and Green Lands East (formerly not part of the Western Development Lands); and,
- (2) The Laffin Lands which is within the land area owned by Mattamy.

This technical memorandum quantifies the updated unit density (and population) and documents the associated supply and distribution system capacity analyses to identify if the Green Lands West, Green Lands East and Laffin development lands can still be serviced by the communal well. This memo also identifies if the existing watermain distribution network is capable of servicing the areas in question and if required, what watermain upgrades might be required.

HYDRAULIC ASSESSMENT

PHASING

For the purpose this assessment, development within the Western Development Lands, as shown in **Figure 1**, was assumed to occur (or have occurred) in the following phasing order:

- (1) Caivan Fox Run Phase 1 (servicing construction completed and home building/occupancies ongoing);
- (2) Caivan Fox Run Phase 2 North and South (draft approved with Phase 2 North and South servicing construction ongoing);
- (3) Caivan Fox Run Phase 3 (future; draft approved);
- (4) Mattamy Phase 1 (future; not yet draft approved);
- (5) Caivan Green Lands West, Green Lands East and Laffin Lands; and,
- (6) Buildout of the remaining Western Development Lands, including other developments from Mattamy (draft approved landholdings with design pending).

Reference: Richmond Caivan Green & Laffin Lands – Potable Water Capacity Analysis

Herein, “interim conditions” was considered to include constructed and/or anticipated development up to, and including, the Caivan Green Lands West, Green Lands East and Laffin Lands (i.e., development phases 1 to 5).

GROWTH & DEMAND PROJECTIONS

Growth Projections

The estimated residential population for the Green Lands West, Green Lands East and Laffin Lands is estimated based on projected household sizes as per the Ottawa Water Design Guidelines. **Table 1** attached shows the estimated number of units for these two development lands and their respective projected populations based on the distribution of residential unit types. In summary:

- Green Lands West is estimated to have a total of 375 residential units with a population of 1,093 persons;
- Green Lands East is estimated to have a total of 37 residential units with a population of 126 persons; and,
- Laffin Lands is estimated to have a total of 174 residential units with a population of 545 persons.

Upon buildout of the Western Development Lands, the majority of the land is proposed to be residential, with 2.63 ha proposed to be institutional (i.e., school) as a future phase of the Mattamy buildout development area. **Table 2** attached provides a breakdown of the estimated units and populations for each development phase/area within the Western Development Lands. The total number of units upon buildout is estimated to be 2,475, with a total projected population of 7,875 persons.

Demand Projections

The criteria outlined in the City of Ottawa 2013 Water Master Plan (WMP) were followed to establish water demands for the Green Lands West, Green Lands East and Laffin Lands, as well as the rest of the Western Development Lands. As per **Table 2** attached, the estimated buildout population for the Western Development Lands is 7,875 persons, therefore Zone Level demands for populations greater than 3,000 persons were used. The demand rates from the Table 3-1 of the 2013 WMP were applied to the population projections presented in **Table 2** attached based on land-use and location with respect to the Greenbelt (i.e., outside, denoted as “outside Greenbelt” or OGB). Zone level demands are generally used to assess larger service areas and are not generally used to size smaller internal watermains; however, fire flows generally govern the minimum sizing for smaller internal watermain infrastructure and therefore the use of Zone Level demands for this analysis was considered appropriate.

For residential land use, single-family and semi-detached homes were considered to have similar demands, therefore both housing types were classified as “single-family houses” (SFH) that have a unit consumption rate of 180 L/cap/d. All townhouses were classified as “multi-level townhouses” (MLT) with a unit consumption rate of 198 L/cap/d. For the institutional (INS) lands, a unit demand rate of 28,000 L/ha/d was applied to establish basic day (BSDY) demands. BSDY demands for the Green Lands West, Green Lands East and Laffin Lands and the rest of the Western Development Lands are summarized in **Table 3** attached.

Reference: Richmond Caivan Green & Laffin Lands – Potable Water Capacity Analysis

To establish maximum day (MXDY) demands, an outdoor water demand (OWD) of 1,049 L/SFH/d was taken, as per the 2013 WMP, and allocated to all SFH units. This outdoor water demand was added to BSDY demands to obtain the MXDY demand (see **Table 3** attached).

Peak hour (PKHR) demands were established by applying diurnal patterns developed by the City of Ottawa to the maximum day demands. The diurnal patterns are different for each unit type and vary with time of day. The overall maximum observed demand, with patterns applied, is the PKHR demand. For example, single-family houses will typically have peak demands during 7 to 8 a.m. in the morning and 5 to 8 p.m. in the evening, whereas a school will typically experience peak demands during lunch hours and during the evenings for custodial cleaning.

DISTRIBUTION SYSTEM CAPACITY ANALYSIS

Serviceability

System Pressures

As per the Ottawa Water Design Guidelines, the desired range of pressure under BSDY, MXDY and PKHR demands is 345 to 552 kPa (50 to 80 psi) and no less than 276 kPa (40 psi) at ground elevation (i.e., at street level). The maximum pressure at any point in the water distribution system should not exceed 552 kPa (80 psi); pressure reducing measures are required to service areas where pressures greater than 552 kPa (80 psi) are anticipated.

Under emergency fire conditions, the system must be able to supply appropriate fire flow while maintaining a residual pressure of 138 kPa (20 psi).

Fire Flows

The City requires a fire flow assessment to be completed to demonstrate that local watermains can provide the objective fire flows. For this analysis, an available fire flow of 167 L/s (10,000 L/min), as previously established for the Western Development Lands (Stantec, 2020), was applied. This flow rate was calculated based on the detailed Fire Underwriters Survey (FUS) Guidelines (long method) and capped as per the City of Ottawa Technical Bulletin ISDTB-2014-02 since a minimum separation of 10 m between backs of adjacent units will be provided. The local watermains must therefore be able to provide a minimum fire flow of 167 L/s at a residual pressure of 20 psi.

Proposed Watermain Sizing & Layout

Watermain sizing and layout proposed as part of the Fox Run Phase 2 development and buildout conditions water distribution system analysis (Stantec, 2020) were used for this analysis and updated to reflect the currently proposed site plans for the Green Lands West, Green Lands East and Laffin Lands. The updated watermain sizing and layout for the Green and Laffin development areas are shown in **Figure 2** and **Figure 3**, respectively.

Within Green Lands West, the network is proposed to consist of 152 to 305 mm diameter watermains as shown in **Figure 2**. Based on the current proposed site plan and assumed phasing, the 375 proposed units would be serviced by five feeds. These include one feed across Perth St from Fox Run Phase 1, and four feeds from the

Reference: Richmond Caivan Green & Laffin Lands – Potable Water Capacity Analysis

305 mm and 203 mm proposed watermains sized to accommodate buildout demand conditions to fully service both the adjacent Fox Run Phase 3 lands and Green Lands West.

Within Green Lands East, the network is proposed to consist of a looped 203 mm diameter watermain. As shown in **Figure 2**, this loop is proposed to cross the Van Gaal Drain in two locations, connecting to the Fox Run Phase 3 lands to the north and the Fox Run Phase 2 North lands to the south.

Within the Laffin Lands, the network is proposed to consist of 152 to 305 mm diameter watermains. As previously stated, it is assumed that development of the Mattamy Phase 1 lands, which are located north of the Laffin Lands, will start prior to development of the Laffin Lands. Based on the current proposed site plan, the Laffin Lands will consist of 174 residential units. As such, this development will need to be serviced by more than one feed. Therefore, it is proposed to service the Laffin Lands via two 305 mm diameter feeds through the Mattamy buildout development lands, as shown in **Figure 3** attached. The current site plan also shows 5 properties located along Ottawa Street. To service these properties, the looped 305 mm diameter feed would need to be extended south to Ottawa Street and connected to a proposed 254 mm diameter watermain along Ottawa Street, as shown in **Figure 3** attached. Alternatively, sale of these 5 lots may be frozen until development of the adjacent Mattamy lands. The proposed 305 mm diameter feeds and 254 mm watermain extension along Ottawa Street were previously identified as required upon buildout of the surrounding Mattamy lands. As such, these proposed watermains have been sized to accommodate current buildout demand projections.

Model Results

Basic Day & Peak Hour Demands

Under interim and buildout BSDY conditions, model results show that the maximum HGL in the system is 149 m and 148 m respectively, which correspond to maximum pressures of 531 kPa (77 psi) and 524 kPa (76 psi). Under PKHR demands, model results show that the minimum HGL in the system is 144 m for interim conditions and 132 m for buildout conditions, which corresponds to minimum pressures of 455 kPa (66 psi) and 324 kPa (47 psi), respectively. Therefore, modelled minimum and maximum pressures are within the City's objective of 345 to 552 kPa (50 to 80 psi). Detailed modelling results are provided in the **Hydraulic Modelling Results** attachment.

Maximum Day + Fire Flow

Under both interim and buildout maximum day + fire flow (MXDY+FF) conditions, model results show that fire flows greater than 10,000 L/min with a residual pressure of 138 kPa (20 psi) are available throughout the distribution system. Detailed modelling results are provided in the **Hydraulic Modelling Results** attachment.

SUPPLY CAPACITY ANALYSIS

Maximum Day Supply

With respect to well supply capacity, the 2008 Ministry of Environment of Ontario Design Guidelines for Drinking-Water Systems require that the total developed groundwater source capacity shall equal or exceed the design maximum day demand with the largest producing well out of service (i.e., firm capacity). The two existing groundwater supply wells servicing the Richmond West Pumping Station provide 28 L/s and 40 L/s, respectively. With the largest well out of service, the available supply is **28 L/s**. The cumulative maximum day

Reference: Richmond Caivan Green & Laffin Lands – Potable Water Capacity Analysis

demand for interim conditions (i.e., constructed and/or anticipated development up to, and including, the Caivan Green Lands West, Green Lands East and Laffin Lands) is **23.8 L/s** (refer to **Table 4** attached). Therefore, the existing firm capacity of the well supply exceeds the supply required to service these developments.

The projected buildout maximum day demand from other developments to be serviced by the Richmond West Pumping Station is currently estimated to exceed 28 L/s. As such, as the maximum day demand of the area to be serviced approaches the firm capacity of 28 L/s, additional well supply will be required. It is recommended that the well supply be expanded prior to the system demand reaching 90% of the firm capacity, or 25 L/s.

Fire Flow Storage & Supply

With respect to storage capacity, the Richmond West Pump Station has an existing reservoir storage volume of 1,175 m³. The reservoir is comprised of two reservoirs each capable of operating independently with a volume of 588 m³.

The current fire flow demand of 10,000 L/min was determined following the latest City of Ottawa Water Design Guidelines recommendations for interpretation of the Fire Underwriters Survey (FUS). From an operational perspective, an analysis was carried out to assess the pumping station's ability to provide the maximum day plus fire flow demand over a design period of 2 hours. **Table 5** attached demonstrates the existing facility's ability to provide a 10,000 L/min fire flow using excess well capacity and with various levels of storage water available, ranging from 70% to 90% full. Based on this sensitivity analysis, a fire flow of 10,000 L/min for a duration of 2 hours is available for all anticipated development phases (this assumes additional well capacity is added upon Mattamy Buildout to address maximum day well supply needs).

It is noted that the overall system storage requirements will be assessed as part of a new Village of Richmond functional design report (FDR). The new FDR will be assessing system storage requirements based on the current projection of number of units in Richmond, the Ministry of Environment of Ontario Design Guidelines for new or expanded storage facilities, and the revised fire flow design requirements. This separate study will ultimately identify triggers for both well and storage expansions.

Redundant Storage Requirement

Section 3.29 (Reliability & Redundancy) of the 2008 Ministry of Environment of Ontario Design Guidelines for Drinking-Water Systems states:

"The design of water treatment plants should be based on the premise that failure of any single component must not prevent the drinking-water system from satisfying all applicable regulatory requirements and other site specific treated water quality and quantity criteria, while operating at design flows."

As such, with respect to treated storage, the failure of a single cell in the dual cell reservoir is considered a failure for reliability purposes. Furthermore, to supplement the MOE design guidelines, the City of Ottawa 2013 Water Master Plan Level of Service guidelines stated that for populations less than 10,000 persons, the minimum demands to be met by major infrastructure at all times is Basic Day demand only.

The Richmond West Pumping Station has a reservoir that is split into two independent cells. The storage capacity of each cell is 588 m³. For operation and reliability, each cell can operate independently when the other cell is taken out of service. The cumulative basic day demand for interim conditions is 10.85 L/s.

Reference: Richmond Caivan Green & Laffin Lands – Potable Water Capacity Analysis

Therefore, the well supply and remaining storage capacity meet the basic day demand with one cell out of service (refer to **Table 6** attached).

As the current Western Development Lands service area is not currently projected to exceed 10,000 persons, the current redundant storage and well supply would be capable of meeting the buildout basic day demand of 17.69 L/s for all known developments.

CONCLUSION

Supply and distribution system capacity analyses were completed for the Green Lands West, Green Lands East and Laffin Lands within Richmond's Western Development Lands. The purpose of these analyses was to identify if the additional associated properties can still be serviced by the Communal Well and if the existing watermain distribution network is capable of servicing the areas in question and if required, what watermain upgrades might be required. Based on the results of the analyses, the following conclusions were made:

- Within Green Lands West, the network is proposed to consist of 152 to 305 mm diameter watermains. Based on the current proposed site plan and assumed phasing, the 375 proposed units would be serviced by five feeds from other adjacent development lands sized to accommodate buildout demand conditions to fully service both the adjacent Fox Run Phase 3 lands and Green Lands West.
- Within Green Lands East, the network is proposed to consist of a looped 203 mm diameter watermain. This loop is proposed to cross the Van Gaal Drain in two locations, connecting to the Fox Run Phase 3 lands to the north and the Fox Run Phase 2 North lands to the south.
- Similarly, the network within the Laffin Lands is proposed to consist of 152 to 305 mm diameter watermains and also requires more than one service feed to meet City of Ottawa standards. Therefore, it is proposed to service the Laffin Lands via two 305 mm diameter feeds through the Mattamy buildout development lands. The current site plan also shows 5 properties located along Ottawa Street. To service these properties, the looped 305 mm diameter feed would need to be extended south to Ottawa Street and connected to a proposed 254 mm diameter watermain along Ottawa Street. Alternatively, sale of these 5 lots may be frozen until development of the adjacent Mattamy lands. The proposed 305 mm diameter feeds and 254 mm watermain extension along Ottawa Street were previously identified as required upon buildout of the surrounding Mattamy lands. As such, these proposed watermains have been sized to accommodate buildout demand conditions.
- With the proposed watermain sizing/configuration, system pressures and fire flow serviceability requirements are met under interim and buildout conditions for BSDY, PKHR and MXDY+FF demands.
- The current well supply capacity of the Richmond West Pumping Station meets maximum day demands for constructed and/or anticipated development up to, and including, the Caivan Green Lands West, Green Lands East and Laffin Lands (i.e., interim conditions).
- The current Richmond West Pumping Station has a total storage capacity of 1,175 m³. An operational assessment demonstrated that with a range of existing reservoir volume, plus excess well capacity, a fire flow of 10,000 L/min for a duration of 2 hours can be provided for all anticipated development phases (this assumes additional well capacity is added upon Mattamy Buildout to address maximum day well supply needs).
- The current Richmond West Pumping Station has a storage volume of approximately 590 m³ when one cell is taken out of service. Under the reliability scenario of one cell out of service, the supply wells and remaining storage are capable of meeting the required basic day demand.

February 26, 2021

Kevin Murphy

Page 7 of 7

Reference: Richmond Caivan Green & Laffin Lands – Potable Water Capacity Analysis

REFERENCES

City of Ottawa. (2010). *Ottawa Design Guidelines - Water Distribution*. Ottawa.

City of Ottawa. (2014). *Technical Bulletin ISDTB-2014-02: Revisions to Ottawa Design Guidelines - Water*. Ottawa.

Ministry of the Environment Ontario. (2008). *Design Guidelines for Drinking-Water Systems*.

Stantec Consulting Ltd. (2013). *City of Ottawa 2013 Water Master Plan*. Ottawa.

Stantec Consulting Ltd. (2020). *Fox Run Subdivision Phase 2 Water Distribution System Analysis*. Ottawa.

Stantec Consulting Ltd.



Jasmin Sidhu P. Eng.
Water Resources Engineer

Phone: 613 725 5553

Fax: 613 722 2799

Jasmin.Sidhu@stantec.com



Kevin Alemany M.A.Sc., P.Eng.
Principal, Water, Regional Discipline Leader

Phone: 613 724 4091

Fax: 613 722 2799


Kevin.Alemany@stantec.com

Attachments:

- Figure 1: Western Development Lands
- Figure 2: Proposed Watermain Sizing/Layout – Green Lands West & East
- Figure 3: Proposed Watermain Sizing/Layout – Laffin Lands


- Table 1: Estimated Unit Counts and Populations for Green & Laffin Lands
- Table 2: Estimated Unit Counts and Populations for Buildout Conditions
- Table 3: Estimated Water Demands
- Table 4: Maximum Day Supply
- Table 5: Sensitivity Analysis of Existing Available Storage
- Table 6: Redundant Storage Requirement

- Figure A1: Model System Map
- Hydraulic Modelling Results

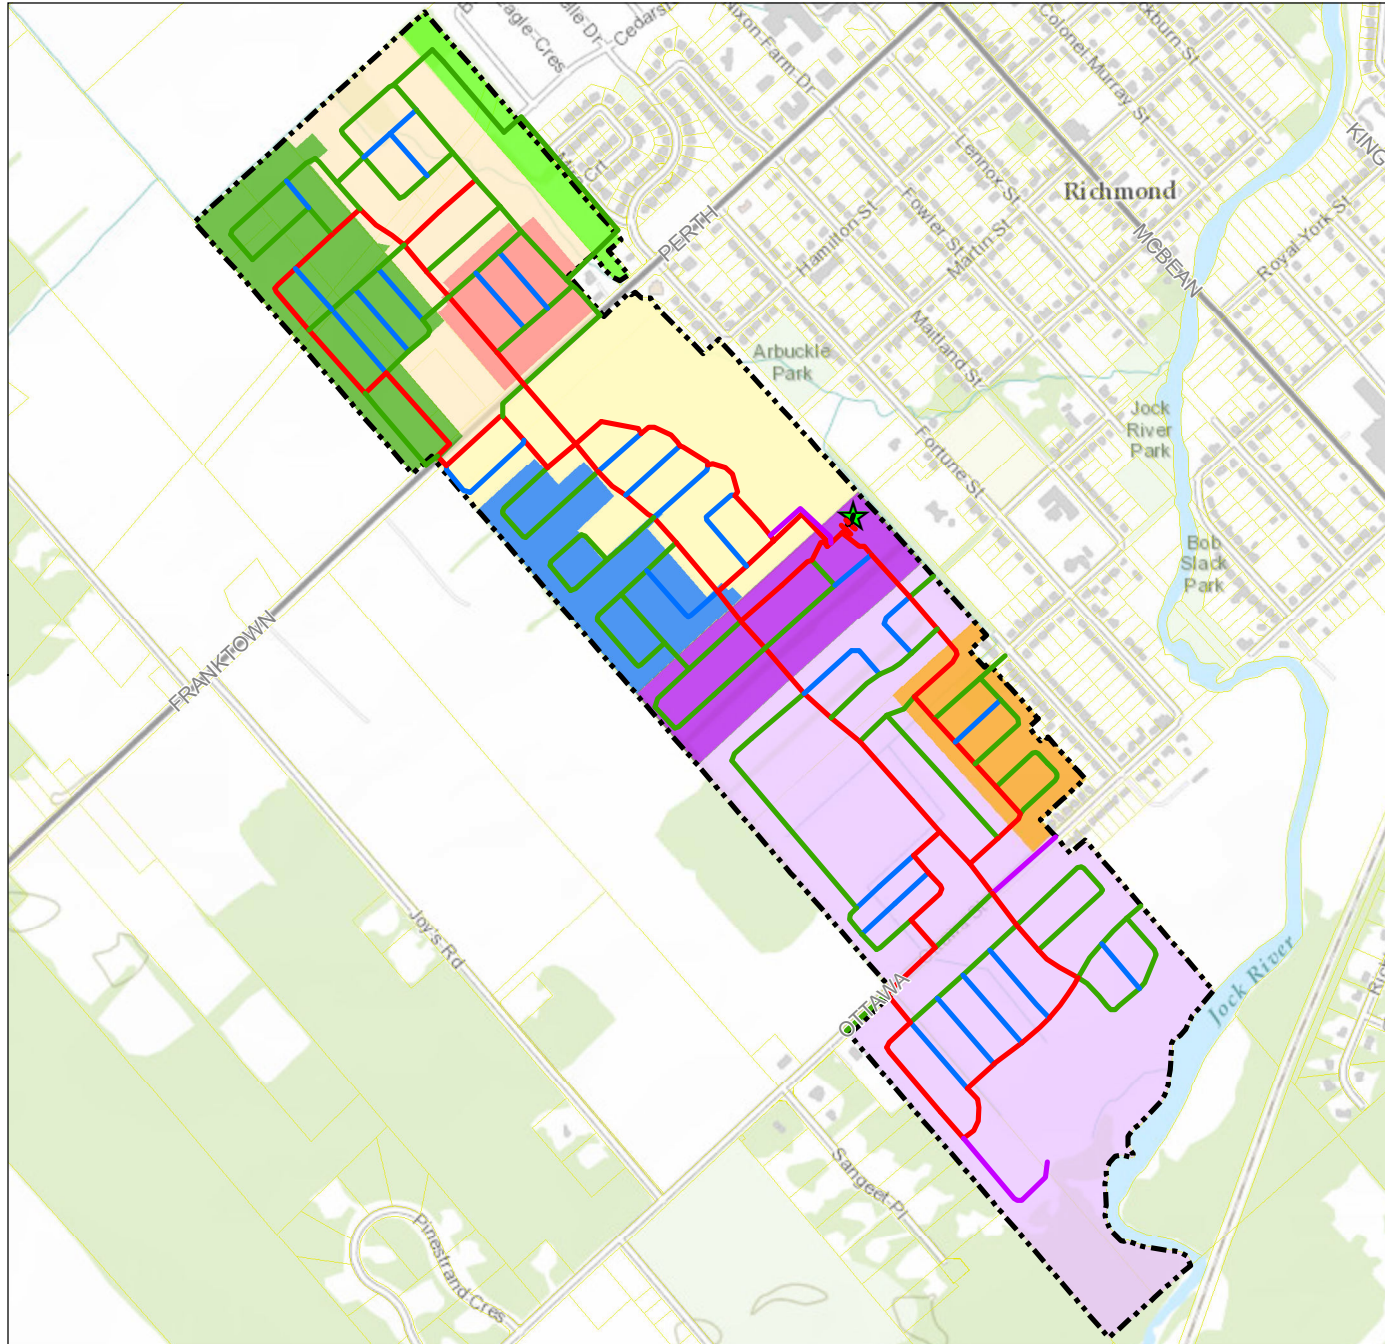


Legend

- Caivan Fox Run Phase 1
- Caivan Fox Run Phase 2 North
- Caivan Fox Run Phase 2 South
- Caivan Fox Run Phase 3 (formerly RVDC)
- Caivan Green Lands West
- Caivan Green Lands East
- Caivan Laffin Lands
- Mattamy Phase 1
- Mattamy (Buildout)
- Western Development Lands
- Property Parcel
- ★ Richmond West Pumping Station



Notes

1. Coordinate System: NAD 1983 MTM 9

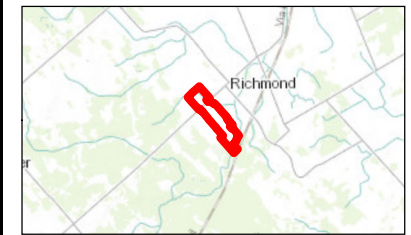


Project Location
Richmond, ON

Client/Project
Richmond Village Development Corporation
Richmond Caivan Green & Laffin Lands
Potable Water Capacity Analysis

Figure No.
1

Title
Western Development Lands

W:\active\1634_01550\planning\drawing\mxd\figures\02_sct\fig_2_caivan_green_land.mxd

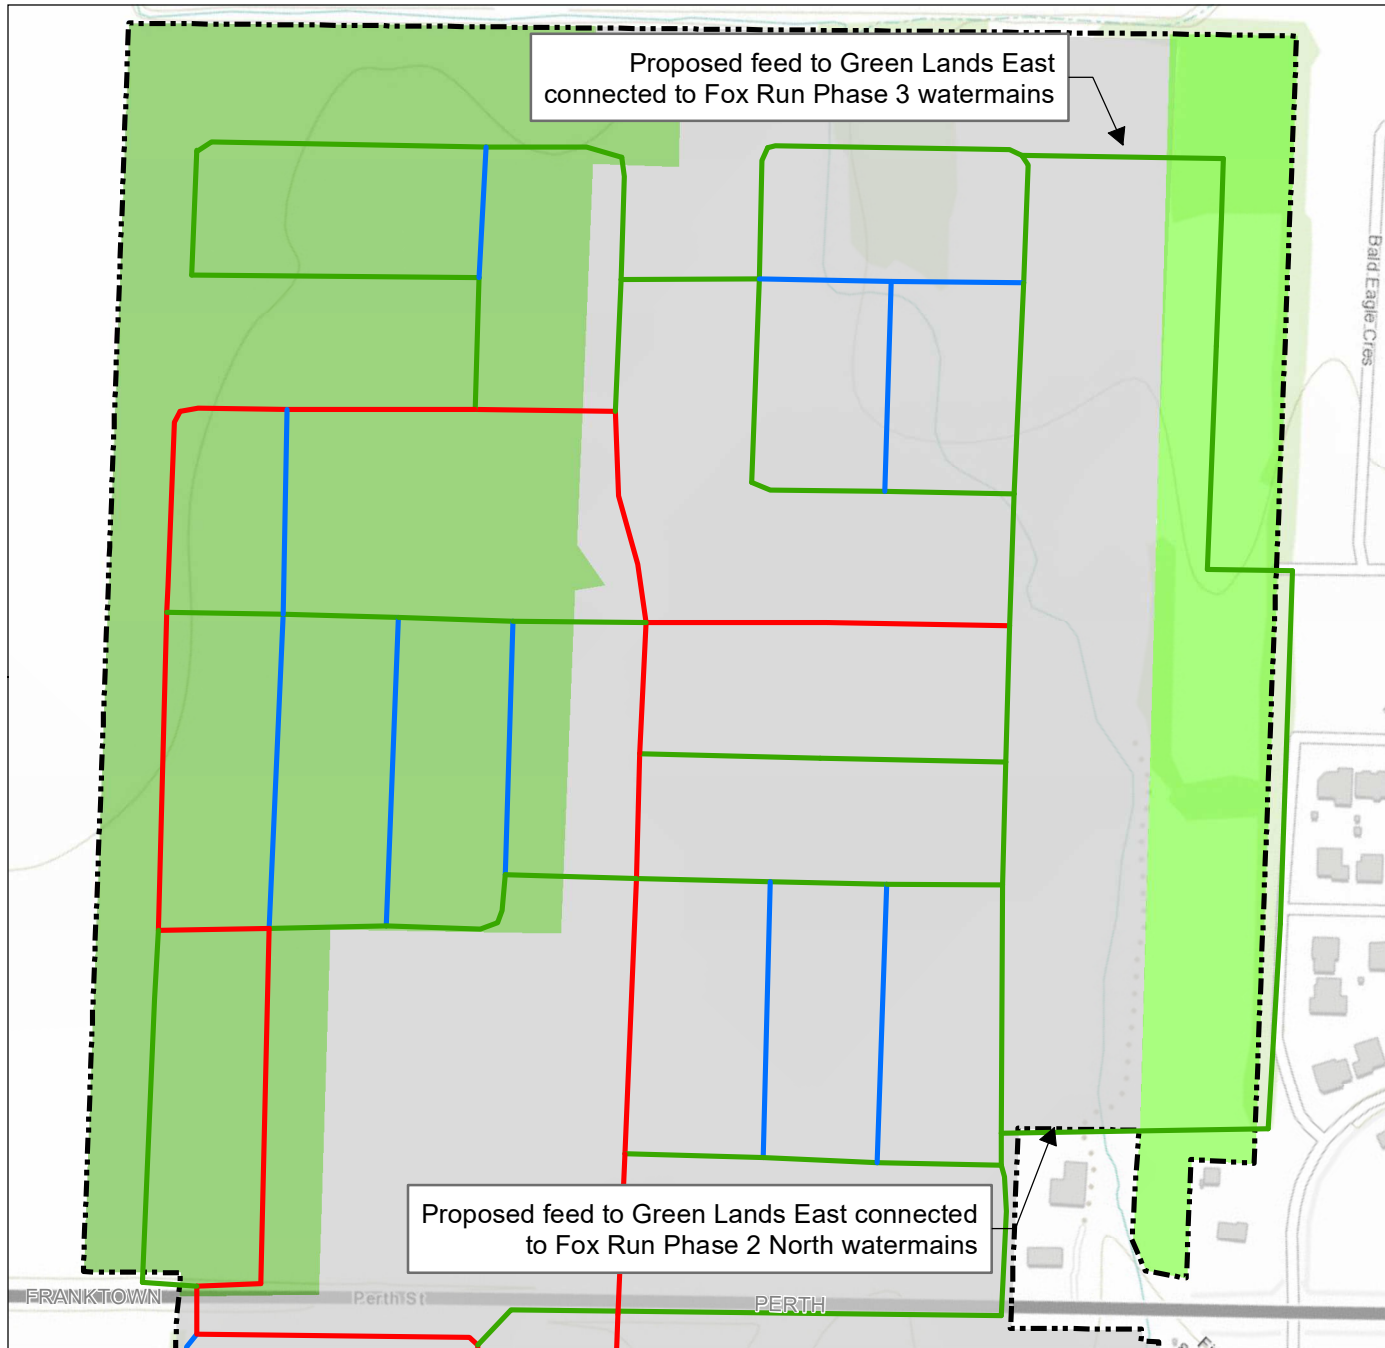


Legend

- Caivan Green Lands West
- Caivan Green Lands East
- Other Development
- Western Development Lands


Watermain Diameter (mm)

- 305
- 203
- 152



Notes

1. Coordinate System: NAD 1983 MTM 9

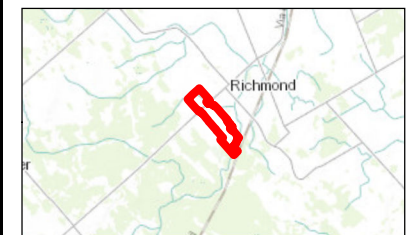


Project Location
Richmond, ON

Client/Project
 Richmond Village Development Corporation
 Richmond Caivan Green & Laffin Lands
 Potable Water Capacity Analysis

Figure No.
2

Title
**Proposed Watermain Sizing/Layout -
 Green Lands West & East**

W:\active\1634_01550\planning\drawing\mxd\figures\02_sci\fig_3_caivan_laffin_landis.mxd

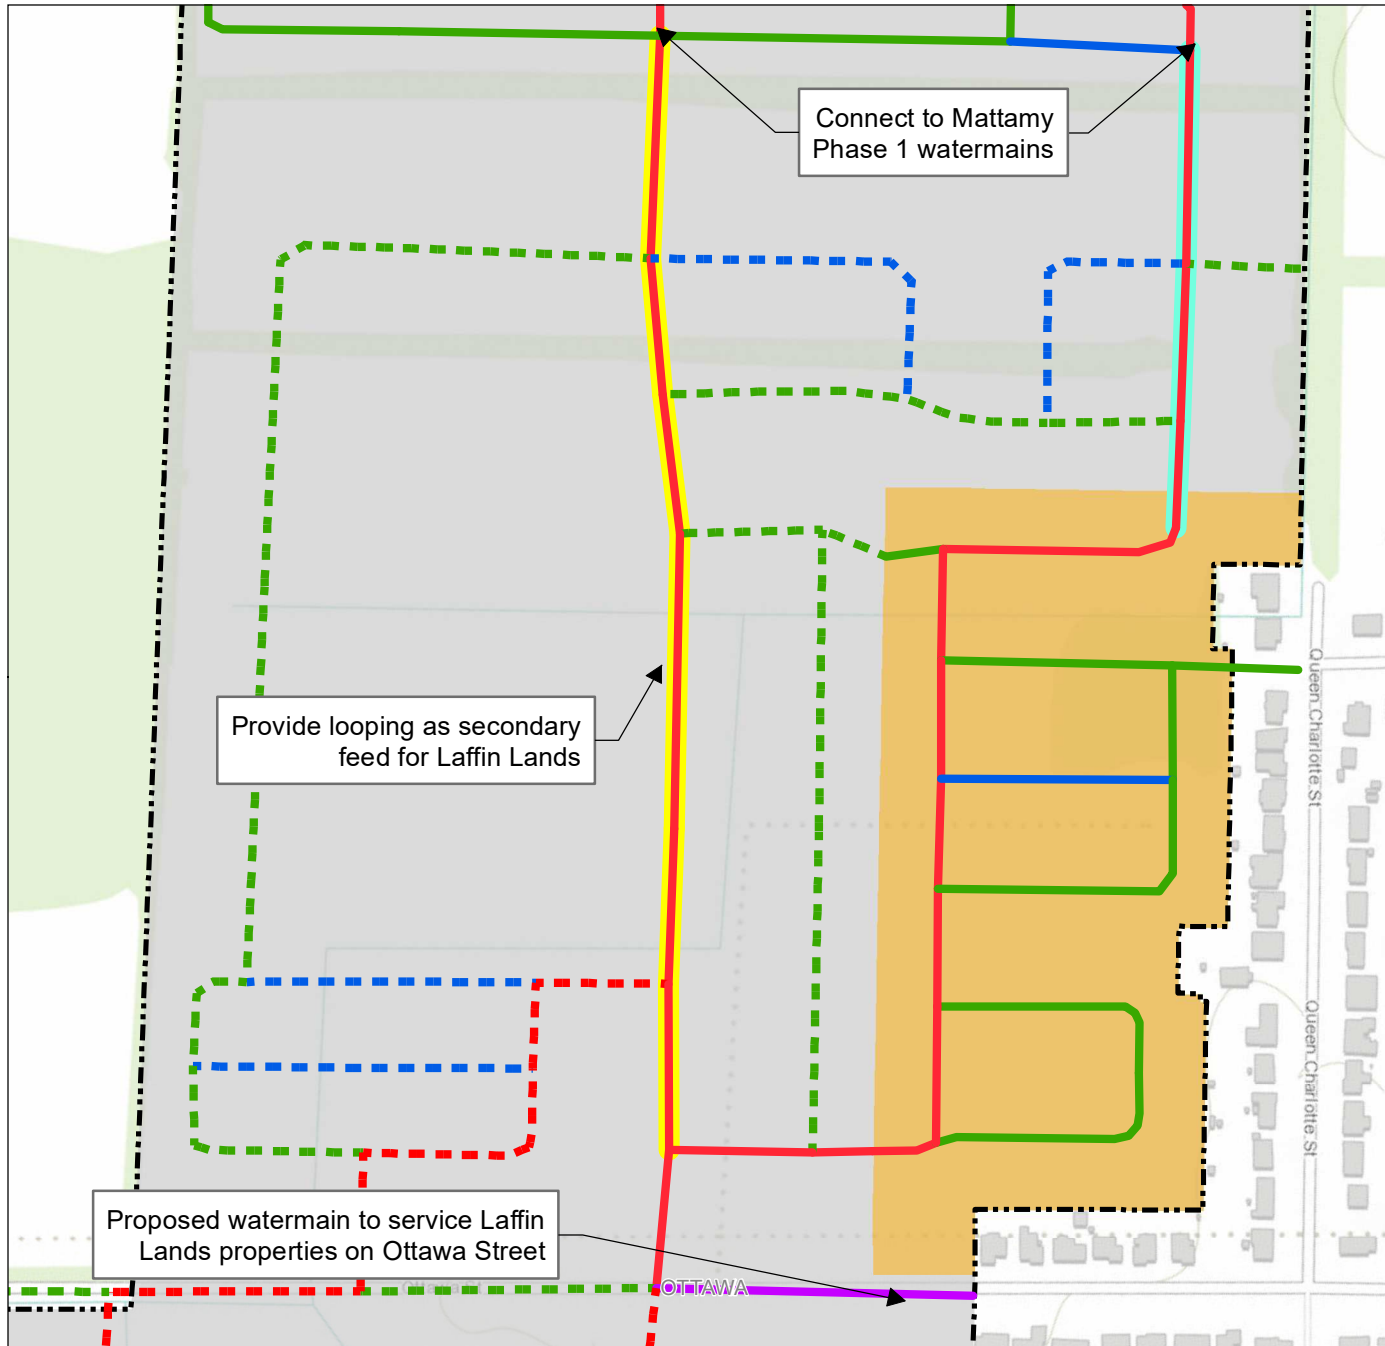

Legend

Existing/Proposed (Interim) Watermain (mm)

- 305
- 254
- 203
- 152

Future (Buildout) Watermain (mm)

- - - 305
- - - 203
- - - 152


— Proposed Primary Feed

— Proposed Secondary Feed

 Caivan Laffin Lands


 Other Development

 Western Development Lands



Notes

1. Coordinate System: NAD 1983 MTM 9

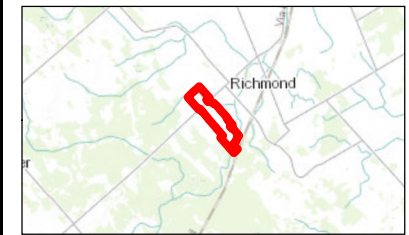

Project Location
Richmond, ON

Client/Project
 Richmond Village Development Corporation
 Richmond Caivan Green & Laffin Lands
 Potable Water Capacity Analysis

Figure No.
3

Title
**Proposed Watermain Sizing/Layout -
 Laffin Lands**

Table 1: Estimated Unit Counts and Populations for Green & Laffin Lands

Development Area	Unit Type	Unit Count	PPU	Population
Caivan Green Lands West	SFH	115	3.4	391
	MLT	260	2.7	702
Caivan Green Lands East	SFH	37	3.4	126
Caivan Laffin Lands	SFH	108	3.4	367
	MLT	66	2.7	178
Total		586		1,764

Table 2: Estimated Unit Counts and Populations for Buildout Conditions

Development Area	Unit Type	Unit Count	Area (ha)	PPU	Population
Caivan Fox Run Phase 1	SFH	220	-	3.4	748
Caivan Fox Run Phase 2 North	SFH	31	-	3.4	105
	MLT	163	-	2.7	440
Caivan Fox Run Phase 2 South	SFH	200	-	3.4	680
Caivan Fox Run Phase 3	SFH	221	-	3.4	751
Mattamy Phase 1	SFH	132	-	3.4	449
	MLT	47	-	2.7	127
Caivan Green Lands West	SFH	115	-	3.4	391
	MLT	260	-	2.7	702
Caivan Green Lands East	SFH	37	-	3.4	126
Caivan Laffin Lands	SFH	108	-	3.4	367
	MLT	66	-	2.7	178
Interim Conditions (Sub-total)		1,600	0	-	5,064
Mattamy (Buildout)	SFH	640	-	3.4	2,176
	MLT	235	-	2.7	635
	INS	-	2.63	-	-
Buildout Conditions (Total)		2,475	2.63	-	7,875

Table 3: Estimated Water Demands

Development Area	Unit Type	Population	Area (ha)	Water Demands		
				BSDY (L/s)	OWD (L/s)	MXDY (L/s)
Caivan Fox Run Phase 1	SFH	748	-	1.56	2.67	4.23
Caivan Fox Run Phase 2 North	SFH	105	-	0.22	0.38	0.60
	MLT	440	-	1.01	-	1.01
Caivan Fox Run Phase 2 South	SFH	680	-	1.42	2.43	3.85
Caivan Fox Run Phase 3	SFH	751	-	1.57	2.68	4.25
Mattamy Phase 1	SFH	449	-	0.94	1.60	2.54
	MLT	127	-	0.29	-	0.29
Caivan Green Lands West	SFH	391	-	0.81	1.40	2.21
	MLT	702	-	1.61	-	1.61
Caivan Green Lands East	SFH	126	-	0.26	0.45	0.71
Caivan Laffin Lands	SFH	367	-	0.76	1.31	2.08
	MLT	178	-	0.41	-	0.41
<i>Interim Conditions (Sub-total)</i>		5,064	0	10.85	12.92	23.78
Mattamy (Buildout)	SFH	2,176	-	4.53	7.77	12.30
	MLT	635	-	1.45	-	1.45
	INS	-	2.63	0.85	-	0.85
<i>Buildout Conditions (Total)</i>		7,875	2.63	17.69	20.69	38.39

Table 4: Maximum Day Well Supply



Development Area	(A)	(B)	(C)	(D)	(E)	(F) = [Sum of (C) to (E)] - [Max of (C) to (E)]	(G) = (F) - (B)
	MXDY	Cumulative MXDY	Well Capacity			Firm Well Capacity (Largest Well Out of Service)	Additional Firm Well Capacity Available for MXDY
	(L/s)	(L/s)	Well #1 (Existing)	Well #2 (Existing)	Well #3 (Future)	(L/s)	(L/s)
Caivan Fox Run Phase 1	4.23	4.23	28.0	40.0		28.0	23.77
Caivan Fox Run Phase 2 (South)	3.85	8.08	28.0	40.0		28.0	19.92
Caivan Fox Run Phase 2 (North)	1.61	9.69	28.0	40.0		28.0	18.31
Caivan Fox Run Phase 3 (formerly RVDC Buildout)	4.25	13.94	28.0	40.0		28.0	14.06
Mattamy Phase 1	2.83	16.77	28.0	40.0		28.0	11.23
Caivan Green Lands West (incl. Flowing Creek Farms)	3.82	20.59	28.0	40.0		28.0	7.41
Caivan Green Lands East	0.71	21.30	28.0	40.0		28.0	6.70
Caivan Laffin Lands	2.48	23.78	28.0	40.0		28.0	4.22
Mattamy (Buildout)	14.61	38.39	28.0	40.0	40.0	68.0	29.61
Tamarack ⁽¹⁾	21.42	59.81	28.0	40.0	40.0	68.0	8.19
Trigger (90% of Existing Firm Capacity) ⁽²⁾	-	25.20	28.0	40.0		28.0	2.80
Trigger (Existing Firm Capacity) ⁽²⁾	-	28.00	28.0	40.0		28.0	0

Table 5: Sensitivity Analysis of Existing Available Storage

Development Area	(A)	(B)	(C)	(D)	(E) = (D)*0.9*1000/60/60/2.0	(F) = (E) + (C)	(G) = (F)*60 (rounded to nearest 1,000)	(H) = (G)*0.8*1000/60/60/2.0	(I) = (H) + (C)	(J) = (I)*60 (rounded to nearest 1,000)	(K) = (D)*0.7*1000/60/60/2.0	(L) = (K) + (C)	(M) = (L)*60 (rounded to nearest 1,000)
	MXDY	Cumulative MXDY	Excess Total Well Capacity (Total Well Capacity - Cumulative MXDY)	Existing Storage Available	Sensitivity Analysis of Existing Available Storage								
					w/ 90% Existing Available Storage			w/ 80% Existing Available Storage			w/ 70% Existing Available Storage		
					Available FF Provided by 90% of Existing Available Storage for Duration of 2 hrs	Available FF based on Existing Storage and Excess Total Well Capacity	Available FF Provided by 80% of Existing Available Storage for Duration of 2 hrs	Available FF based on Existing Storage and Excess Total Well Capacity	Available FF Provided by 70% of Existing Available Storage for Duration of 2 hrs	Available FF based on Existing Storage and Excess Total Well Capacity			
(L/s)	(L/s)	(L/s)	(m ³)	(L/s)	(L/s)	(L/min)	(L/s)	(L/s)	(L/min)	(L/s)	(L/s)	(L/min)	
Caivan Fox Run Phase 1	4.23	4.23	63.8	1,175	146.9	210.6	13,000	130.6	194.3	12,000	114.2	178.0	11,000
Caivan Fox Run Phase 2 (South)	3.85	8.08	59.9	1,175	146.9	206.8	12,000	130.6	190.5	11,000	114.2	174.2	10,000
Caivan Fox Run Phase 2 (North)	1.61	9.69	58.3	1,175	146.9	205.2	12,000	130.6	188.9	11,000	114.2	172.5	10,000
Caivan Fox Run Phase 3 (formerly RVDC Buildout)	4.25	13.94	54.1	1,175	146.9	200.9	12,000	130.6	184.6	11,000	114.2	168.3	10,000
Mattamy Phase 1	2.83	16.77	51.2	1,175	146.9	198.1	12,000	130.6	181.8	11,000	114.2	165.5	10,000
Caivan Green Lands West (incl. Flowing Creek Farms)	3.82	20.59	47.4	1,175	146.9	194.3	12,000	130.6	178.0	11,000	114.2	161.7	10,000
Caivan Green Lands East	0.71	21.30	46.7	1,175	146.9	193.6	12,000	130.6	177.3	11,000	114.2	160.9	10,000
Caivan Laffin Lands	2.48	23.78	44.2	1,175	146.9	191.1	11,000	130.6	174.8	10,000	114.2	158.5	10,000
Mattamy (Buildout)	14.61	38.39	69.6	1,175	146.9	216.5	13,000	130.6	200.2	12,000	114.2	183.8	11,000
Tamarack	21.42	59.81	48.2	1,175	146.9	195.1	12,000	130.6	178.7	11,000	114.2	162.4	10,000

Table 6: Redundant Storage Requirement

Development Area	(A)	(B)	(C)	(D)	(E)	(F)	(G) = (D) or (E) + (E)	(H)	(I)	(J) = Sum of (H) to (J)	(K)	(L)	(M)	(N) = (L)	(O) = (N)*1000/2/3600	(P) = (K) + (O)	(Q) = (P) - (G)	(R) = (L) + (M)	(S) = (R)*1000/2/3600	(T) = (K) + (S)	(U) = (T) - (G)
	Population	Cumulative Population	BSDY	Cumulative BSDY	FUS FF	BSDY (<10,000 persons) or BSDY + Fire Flow (>10,000 persons)	Well Capacity					Existing Storage with One Cell Out of Service	Additional Storage to Be Provided	w/ Existing Available Storage				w/ Additional Storage			
							Well #1 (Existing)	Well #2 (Existing)	Well #3 (Future)	Total Well Capacity	Available Storage with One Cell Out of Service			Flow from Storage with One Cell Out of Service (over 2 hours)	Total Well & Storage Supply Available (over 2 hours)	Excess Well & Storage Supply Available (over 2 hours)	Available Storage with One Cell Out of Service	Flow from Storage with One Cell Out of Service (over 2 hours)	Firm Well & Storage Supply Available (over 2 hours)	Excess Well & Storage Supply Available (over 2 hours)	
							(L/s)	(L/s)	(L/s)	(L/s)	(m ³)			(m ³)	(L/s)	(L/s)	(L/s)	(L/s)	(L/s)	(L/s)	(L/s)
Caivan Fox Run Phase 1	748	748	1.56	1.56	0	1.56	28.0	40.0		68.0	588	0	588	82	150	148.0	588	82	150	148.0	148.0
Caivan Fox Run Phase 2 (South)	680	1,428	1.42	2.98	0	2.98	28.0	40.0		68.0	588	1,300	588	82	150	146.6	1,888	262	330	327.2	327.2
Caivan Fox Run Phase 2 (North)	546	1,974	1.23	4.20	0	4.20	28.0	40.0		68.0	588	1,300	588	82	150	145.4	1,888	262	330	325.9	325.9
Caivan Fox Run Phase 3 (formerly RVDC Buildout)	751	2,725	1.57	5.77	0	5.77	28.0	40.0		68.0	588	1,300	588	82	150	143.8	1,888	262	330	324.4	324.4
Mattamy Phase 1	576	3,301	1.23	6.99	0	6.99	28.0	40.0		68.0	588	1,300	588	82	150	142.6	1,888	262	330	323.2	323.2
Caivan Green Lands West (incl. Flowing Creek Farms)	1,093	4,394	2.42	9.42	0	9.42	28.0	40.0		68.0	588	1,300	588	82	150	140.2	1,888	262	330	320.7	320.7
Caivan Green Lands East	126	4,519	0.26	9.68	0	9.68	28.0	40.0		68.0	588	1,300	588	82	150	139.9	1,888	262	330	320.5	320.5
Caivan Laffin Lands	545	5,065	1.17	10.85	0	10.85	28.0	40.0		68.0	588	1,300	588	82	150	138.7	1,888	262	330	319.3	319.3
Mattamy (Buildout)	2,811	7,875	6.84	17.69	0	17.69	28.0	40.0	40.0	108.0	588	1,300	588	82	190	171.9	1,888	262	370	352.5	352.5
Tamarack ⁽¹⁾	3,249	11,124	15.62	33.31	166.7	200.01	28.0	40.0	40.0	108.0	588	2,750	588	82	190	-10.4	3,338	464	572	371.5	371.5
Trigger (Population/BSDY when Redundant Storage Req. Changes)	-	10,000	-	22.59	166.7	189.29	28.0	40.0	40.0	108.0	588	1,300	588	82	190	0.4	1,888	262	370	180.9	180.9

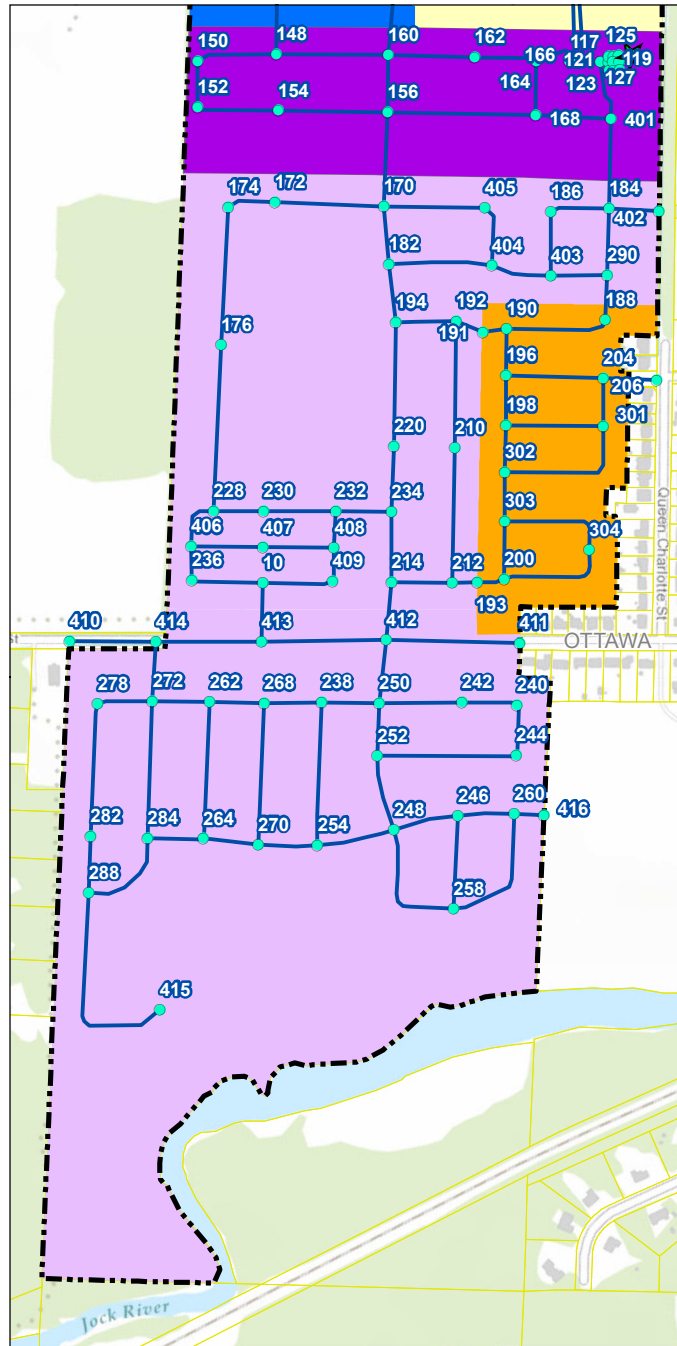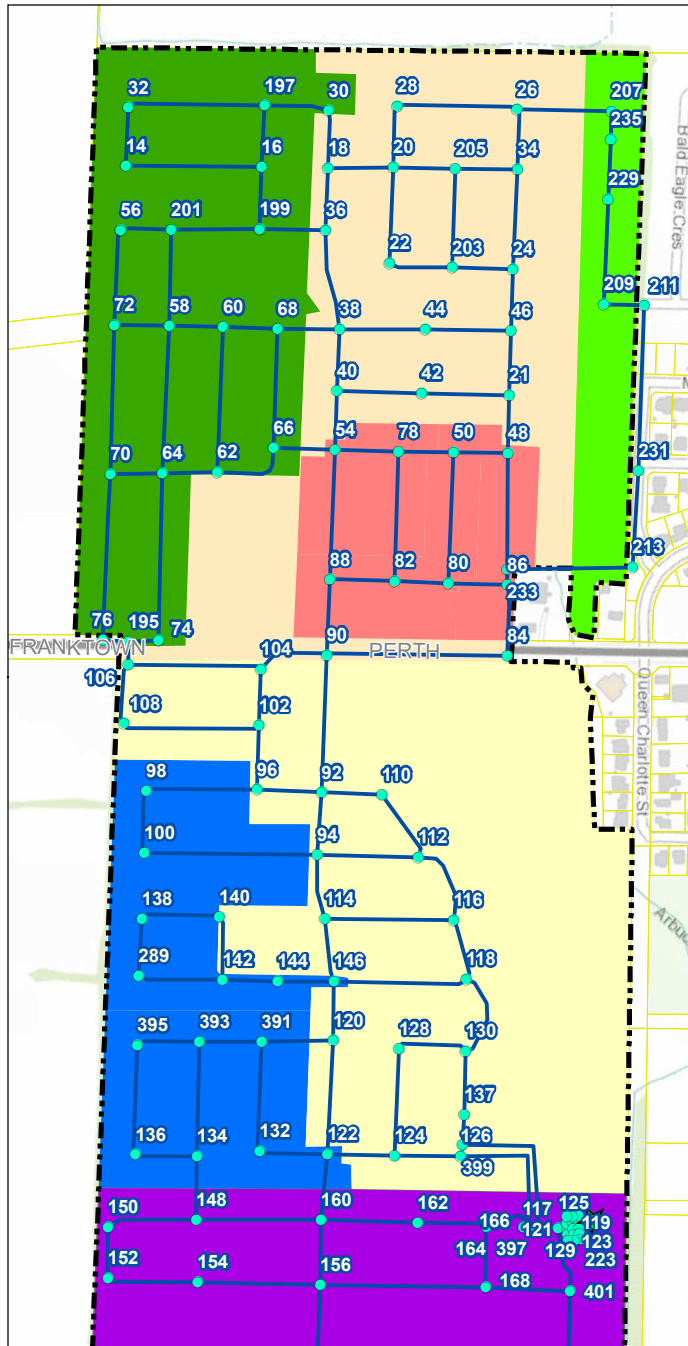

Legend


- Model Node
- Model Pipe
- Caivan Fox Run Phase 1
- Caivan Fox Run Phase 2 North
- Caivan Fox Run Phase 2 South
- Caivan Fox Run Phase 3 (formerly RVDC)
- Caivan Green Lands West
- Caivan Green Lands East
- Caivan Laffin Lands
- Mattamy Phase 1
- Mattamy (Buildout)
- Western Development Lands
- Property Parcel
- ★ Richmond West Pumping Station



0 100 200 metres
(At original document size of 8.5x11)
1:9,500

Notes

1. Coordinate System: NAD 1983 MTM 9

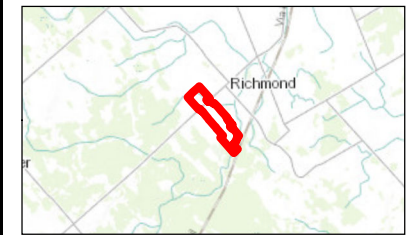

Project Location
Richmond, ON

Client/Project
Richmond Village Development Corporation
Richmond Caivan Green & Laffin Lands
Potable Water Capacity Analysis

Figure No.

A1

Title

Model System Map

163401550 - Richmond Caivan Water Distribution System Analysis - Scope Change 1
Model Results - BSDY (Interim Conditions)

Head								Pressure							
ID	Min	148.59	Max.Time	147.62	Min.Value	Min.Time	Difference	ID	76.54	Max.Time	Min.Value	Min.Time	Average	Difference	
	Max								Max.Value						(psi)
	(m)	(m)	(hrs.)	(m)	(hrs.)	(m)	(m)	(psi)	(psi)	(hrs.)	(psi)	(hrs.)	(psi)	(psi)	
100	148.59	3:00	147.63	7:00	148.18	0.97	100	75.83	3:00	74.46	7:00	75.25	1.37		
102	148.59	3:00	147.62	7:00	148.18	0.97	102	75.60	3:00	74.23	7:00	75.02	1.38		
104	148.59	3:00	147.62	7:00	148.18	0.97	104	75.43	3:00	74.05	7:00	74.85	1.38		
106	148.59	3:00	147.62	7:00	148.18	0.97	106	75.12	3:00	73.74	7:00	74.53	1.38		
108	148.59	3:00	147.62	7:00	148.18	0.97	108	75.01	3:00	73.63	7:00	74.42	1.38		
110	148.59	3:00	147.63	7:00	148.18	0.96	110	76.54	3:00	75.17	7:00	75.96	1.37		
112	148.59	3:00	147.63	7:00	148.18	0.96	112	76.40	3:00	75.03	7:00	75.82	1.37		
114	148.59	3:00	147.63	7:00	148.19	0.96	114	76.06	3:00	74.70	7:00	75.48	1.36		
116	148.59	3:00	147.63	7:00	148.19	0.96	116	76.12	3:00	74.75	7:00	75.54	1.36		
117	148.59	3:00	147.66	7:00	148.20	0.93	117	72.21	3:00	70.89	7:00	71.64	1.32		
118	148.59	3:00	147.64	7:00	148.19	0.96	118	76.32	3:00	74.96	7:00	75.74	1.36		
119	148.59	3:00	147.67	7:00	148.20	0.93	119	72.21	3:00	70.89	7:00	71.65	1.32		
120	148.59	3:00	147.64	7:00	148.19	0.95	120	75.61	3:00	74.25	7:00	75.03	1.36		
121	148.59	3:00	147.67	7:00	148.20	0.93	121	72.21	3:00	70.89	7:00	71.65	1.32		
122	148.59	3:00	147.64	7:00	148.19	0.95	122	75.72	3:00	74.37	7:00	75.15	1.35		
123	148.59	3:00	147.67	7:00	148.20	0.93	123	72.21	3:00	70.89	7:00	71.65	1.32		
124	148.59	3:00	147.65	7:00	148.19	0.95	124	76.12	3:00	74.77	7:00	75.54	1.35		
125	148.59	3:00	147.67	7:00	148.20	0.93	125	72.21	3:00	70.89	7:00	71.65	1.32		
126	148.59	3:00	147.65	7:00	148.19	0.95	126	76.27	3:00	74.93	7:00	75.70	1.35		
127	97.80	3:00	97.80	7:00	97.80	0	127	0	3:00	0	7:00	0	0		
128	148.59	3:00	147.64	7:00	148.19	0.95	128	76.20	3:00	74.85	7:00	75.63	1.35		
129	148.59	3:00	147.67	7:00	148.20	0.93	129	72.21	3:00	70.89	7:00	71.65	1.32		
130	148.59	3:00	147.64	7:00	148.19	0.95	130	76.32	3:00	74.96	7:00	75.74	1.35		
131	97.80	3:00	97.80	7:00	97.80	0	131	0	3:00	0	7:00	0	0		
132	148.59	3:00	147.64	7:00	148.19	0.95	132	75.48	3:00	74.13	7:00	74.90	1.35		
133	148.59	3:00	147.67	7:00	148.20	0.93	133	72.21	3:00	70.89	7:00	71.65	1.32		
134	148.59	3:00	147.64	7:00	148.19	0.95	134	74.94	3:00	73.59	7:00	74.36	1.35		
135	97.80	3:00	97.80	7:00	97.80	0	135	0	3:00	0	7:00	0	0		
136	148.59	3:00	147.64	7:00	148.19	0.95	136	74.79	3:00	73.44	7:00	74.22	1.35		
137	148.59	3:00	147.64	7:00	148.19	0.95	137	76.30	3:00	74.95	7:00	75.73	1.35		
138	148.59	3:00	147.64	7:00	148.19	0.96	138	75.48	3:00	74.11	7:00	74.90	1.36		
14	148.59	3:00	147.62	7:00	148.18	0.98	14	73.84	3:00	72.45	7:00	73.25	1.39		
140	148.59	3:00	147.64	7:00	148.19	0.96	140	75.31	3:00	73.94	7:00	74.73	1.36		
142	148.59	3:00	147.64	7:00	148.19	0.96	142	75.19	3:00	73.83	7:00	74.61	1.36		
144	148.59	3:00	147.64	7:00	148.19	0.96	144	75.06	3:00	73.70	7:00	74.49	1.36		
146	148.59	3:00	147.64	7:00	148.19	0.96	146	75.41	3:00	74.05	7:00	74.83	1.36		
148	148.59	3:00	147.64	7:00	148.19	0.95	148	75.45	3:00	74.10	7:00	74.87	1.35		
150	148.59	3:00	147.64	7:00	148.19	0.95	150	75.31	3:00	73.96	7:00	74.73	1.35		
152	148.59	3:00	147.64	7:00	148.19	0.95	152	75.18	3:00	73.83	7:00	74.60	1.35		
154	148.59	3:00	147.65	7:00	148.19	0.95	154	75.35	3:00	74.00	7:00	74.78	1.35		
156	148.59	3:00	147.65	7:00	148.19	0.95	156	75.18	3:00	73.83	7:00	74.61	1.34		
16	148.59	3:00	147.62	7:00	148.18	0.98	16	74.58	3:00	73.19	7:00	73.99	1.39		
160	148.59	3:00	147.65	7:00	148.19	0.95	160	75.79	3:00	74.44	7:00	75.22	1.35		
162	148.59	3:00	147.65	7:00	148.19	0.94	162	75.73	3:00	74.39	7:00	75.16	1.34		
164	148.59	3:00	147.65	7:00	148.19	0.94	164	75.63	3:00	74.30	7:00	75.06	1.34		
166	148.59	3:00	147.66	7:00	148.19	0.94	166	76.02	3:00	74.68	7:00	75.45	1.33		
168	148.59	3:00	147.65	7:00	148.19	0.94	168	75.93	3:00	74.59	7:00	75.36	1.34		
170	148.59	3:00	147.65	7:00	148.19	0.95	170	74.50	3:00	73.15	7:00	73.92	1.34		
18	148.59	3:00	147.62	7:00	148.18	0.98	18	74.58	3:00	73.19	7:00	73.99	1.39		
182	148.59	3:00	147.65	7:00	148.19	0.95	182	74.35	3:00	73.01	7:00	73.78	1.34		
184	148.59	3:00	147.66	7:00	148.20	0.94	184	74.84	3:00	73.51	7:00	74.27	1.33		
188	148.59	3:00	147.66	7:00	148.19	0.94	188	74.75	3:00	73.42	7:00	74.18	1.33		
190	148.59	3:00	147.65	7:00	148.19	0.94	190	74.50	3:00	73.16	7:00	73.93	1.34		
191	148.59	3:00	147.65	7:00	148.19	0.94	191	74.41	3:00	73.08	7:00	73.84	1.34		
193	148.59	3:00	147.65	7:00	148.19	0.94	193	73.77	3:00	72.43	7:00	73.20	1.34		
194	148.59	3:00	147.65	7:00	148.19	0.95	194	74.10	3:00	72.76	7:00	73.53	1.34		
195	148.59	3:00	147.62	7:00	148.18	0.97	195	74.20	3:00	72.81	7:00	73.61	1.38		
196	148.59	3:00	147.65	7:00	148.19	0.94	196	74.37	3:00	73.03	7:00	73.80	1.34		
197	148.59	3:00	147.62	7:00	148.18	0.98	197	74.01	3:00	72.62	7:00	73.42	1.39		
198	148.59	3:00	147.65	7:00	148.19	0.94	198	74.24	3:00	72.90	7:00	73.67	1.34		
199	148.59	3:00	147.62	7:00	148.18	0.98	199	74.69	3:00	73.31	7:00	74.11	1.39		
20	148.59	3:00	147.62	7:00	148.18	0.98	20	74.51	3:00	73.12	7:00	73.92	1.39		
200	148.59	3:00	147.65	7:00	148.19	0.94	200	73.81	3:00	72.47	7:00	73.24	1.34		
201	148.59	3:00	147.62	7:00	148.18	0.98	201	74.55	3:00	73.17	7:00	73.96	1.39		
203	148.59	3:00	147.62	7:00	148.18	0.98	203	74.62	3:00	73.24	7:00	74.03	1.39		
204	148.59	3:00	147.65	7:00	148.19	0.94	204	74.44	3:00	73.10	7:00	73.87	1.34		
205	148.59	3:00	147.62	7:00	148.18	0.98	205	74.42	3:00	73.04	7:00	73.84	1.39		
206	148.59	3:00	147.65	7:00	148.19	0.94	206	74.35	3:00	73.02	7:00	73.78	1.34		
207	148.59	3:00	147.62	7:00	148.18	0.98	207	74.57	3:00	73.18	7:00	73.98	1.39		
209	148.59	3:00	147.62	7:00	148.18	0.98	209	75.11	3:00	73.72	7:00	74.52	1.39		
21	148.59	3:00	147.62	7:00	148.18	0.97	21	75.48	3:00	74.09	7:00	74.89	1.39		
211	148.59	3:00	147.62	7:00	148.18	0.98	211	74.44	3:00	73.05	7:00	73.85	1.39		
212	148.59	3:00	147.65	7:00	148.19	0.94	212	74.55	3:00	73.21	7:00	73.98	1.34		
213	148.59	3:00	147.62	7:00	148.18	0.97	213	74.05	3:00	72.67	7:00	73.47	1.39		
214	148.59	3:00	147.65	7:00	148.19	0.94	214	74.38	3:00	73.04	7:00	73.81	1.34		
217	97.80	3:00	97.80	7:00	97.80	0	217	0	3:00	0	7:00	0	0		
219	148.59	3:00	147.67	7:00	148.20	0.93	219	72.21	3:00	70.89	7:00	71.65	1.32		
22	148.59	3:00	147.62	7:00	148.18	0.98	22	74.69	3:00	73.31	7:00	74.11	1.39		
220	148.59	3:00	147.65	7:00	148.19	0.94	220	73.89	3:00	72.54	7:00	73.31	1.34		
221	148.59	3:00	147.67	7:00	148.20	0.93	221	72.21	3:00	70.89	7:00	71.65	1.32		
223	97.80	3:00	97.80	7:00	97.80	0	223	0	3:00	0	7:00	0	0		
225	148.59	3:00	147.67	7:00	148.20	0.93	225	72.21	3:00	70.89	7:00	71.65	1.32		
227	148.59	3:00	147.67	7:00	148.20	0.93	227	72.21	3:00	70.89	7:00	71.65	1.32		
229	148.59	3:00	147.62	7:00	148.18	0.98	229	74.76	3:00	73.38	7:00	74.18	1.39		
231	148.59	3:00	147.62	7:00	148.18	0.98	231	74.20	3:00	72.81	7:00	73.61	1.39		
233	148.59	3:00	147.62	7:00	148.18	0.97	233	76.33	3:00	74.94	7:00	75.74	1.39		
234	148.59	3:00	147.65	7:00	148.19	0.94	234	74.23	3:00	72.88	7:00	73.66	1.34		
235	148.59														

290	148.59	3:00	147.66	7:00	148.19	0.94	290	74.75	3:00	73.42	7:00	74.19	1.33
30	148.59	3:00	147.62	7:00	148.18	0.98	30	74.49	3:00	73.11	7:00	73.91	1.39
301	148.59	3:00	147.65	7:00	148.19	0.94	301	74.31	3:00	72.97	7:00	73.74	1.34
302	148.59	3:00	147.65	7:00	148.19	0.94	302	74.10	3:00	72.76	7:00	73.53	1.34
303	148.59	3:00	147.65	7:00	148.19	0.94	303	73.96	3:00	72.62	7:00	73.39	1.34
304	148.59	3:00	147.65	7:00	148.19	0.94	304	73.66	3:00	72.32	7:00	73.09	1.34
32	148.59	3:00	147.62	7:00	148.18	0.98	32	73.50	3:00	72.11	7:00	72.91	1.39
34	148.59	3:00	147.62	7:00	148.18	0.98	34	74.55	3:00	73.16	7:00	73.96	1.39
36	148.59	3:00	147.62	7:00	148.18	0.98	36	74.81	3:00	73.42	7:00	74.22	1.39
38	148.59	3:00	147.62	7:00	148.18	0.97	38	75.39	3:00	74.00	7:00	74.80	1.39
391	148.59	3:00	147.64	7:00	148.19	0.95	391	75.78	3:00	74.42	7:00	75.20	1.35
393	148.59	3:00	147.64	7:00	148.19	0.95	393	75.14	3:00	73.78	7:00	74.56	1.35
395	148.59	3:00	147.64	7:00	148.19	0.95	395	75.18	3:00	73.83	7:00	74.60	1.35
397	148.59	3:00	147.66	7:00	148.19	0.94	397	76.02	3:00	74.69	7:00	75.45	1.33
399	148.59	3:00	147.64	7:00	148.19	0.95	399	76.27	3:00	74.92	7:00	75.70	1.35
40	148.59	3:00	147.62	7:00	148.18	0.97	40	75.45	3:00	74.06	7:00	74.86	1.39
401	148.59	3:00	147.66	7:00	148.20	0.93	401	75.90	3:00	74.58	7:00	75.34	1.33
411	148.59	3:00	147.65	7:00	148.19	0.94	411	73.35	3:00	72.00	7:00	72.77	1.34
412	148.59	3:00:00	147.65	7:00	148.19	0.94	412	73.63	3:00:00	72.29	7:00	73.06	1.34
42	148.59	3:00:00	147.62	7:00	148.18	0.97	42	75.21	3:00:00	73.82	7:00	74.62	1.39
44	148.59	3:00:00	147.62	7:00	148.18	0.98	44	75.05	3:00:00	73.66	7:00	74.46	1.39
46	148.59	3:00	147.62	7:00	148.18	0.98	46	75.05	3:00	73.66	7:00	74.46	1.39
48	148.59	3:00:00	147.62	7:00	148.18	0.97	48	75.52	3:00:00	74.13	7:00	74.93	1.39
50	148.59	3:00	147.62	7:00	148.18	0.97	50	75.66	3:00	74.28	7:00	75.07	1.39
54	148.59	3:00:00	147.62	7:00	148.18	0.97	54	75.76	3:00:00	74.38	7:00	75.17	1.38
56	148.59	3:00:00	147.62	7:00	148.18	0.98	56	74.35	3:00:00	72.97	7:00	73.76	1.39
58	148.59	3:00	147.62	7:00	148.18	0.97	58	74.65	3:00	73.27	7:00	74.06	1.39
60	148.59	3:00:00	147.62	7:00	148.18	0.97	60	74.76	3:00:00	73.38	7:00	74.18	1.39
62	148.59	3:00:00	147.62	7:00	148.18	0.97	62	75.38	3:00:00	73.99	7:00	74.79	1.39
64	148.59	3:00	147.62	7:00	148.18	0.97	64	74.62	3:00	73.24	7:00	74.04	1.38
66	148.59	3:00	147.62	7:00	148.18	0.97	66	75.59	3:00	74.20	7:00	75.00	1.39
68	148.59	3:00	147.62	7:00	148.18	0.97	68	74.88	3:00	73.49	7:00	74.29	1.39
70	148.59	3:00:00	147.62	7:00	148.18	0.97	70	74.62	3:00:00	73.24	7:00	74.04	1.38
72	148.59	3:00:00	147.62	7:00	148.18	0.97	72	74.24	3:00:00	72.85	7:00	73.65	1.39
74	148.59	3:00	147.62	7:00	148.18	0.97	74	74.27	3:00	72.88	7:00	73.68	1.38
76	148.59	3:00	147.62	7:00	148.18	0.97	76	74.20	3:00	72.81	7:00	73.61	1.38
78	148.59	3:00	147.62	7:00	148.18	0.97	78	75.93	3:00	74.55	7:00	75.34	1.39
80	148.59	3:00	147.62	7:00	148.18	0.97	80	76.09	3:00	74.70	7:00	75.50	1.38
82	148.59	3:00	147.62	7:00	148.18	0.97	82	76.24	3:00	74.86	7:00	75.66	1.38
84	148.59	3:00:00	147.62	7:00	148.18	0.97	84	76.06	3:00:00	74.67	7:00	75.47	1.38
86	148.59	3:00	147.62	7:00	148.18	0.97	86	76.33	3:00	74.94	7:00	75.74	1.38
88	148.59	3:00	147.62	7:00	148.18	0.97	88	75.66	3:00	74.28	7:00	75.07	1.38
90	148.59	3:00	147.62	7:00	148.18	0.97	90	76.03	3:00	74.65	7:00	75.45	1.38
92	148.59	3:00:00	147.63	7:00	148.18	0.97	92	76.39	3:00:00	75.01	7:00	75.80	1.37
94	148.59	3:00:00	147.63	7:00	148.18	0.96	94	75.83	3:00:00	74.46	7:00	75.25	1.37
96	148.59	3:00	147.63	7:00	148.18	0.97	96	76.13	3:00	74.76	7:00	75.55	1.37
98	148.59	3:00:00	147.63	7:00	148.18	0.97	98	75.63	3:00:00	74.26	7:00	75.05	1.37

Dummy PS nodes; results at these nodes not reported.

290	148.77	3:00	144.18	20:00	147.60	4.59	290	75.00	3:00	68.47	20:00	73.34	6.53
30	148.76	3:00	143.93	20:00	147.53	4.83	30	74.74	3:00	67.87	20:00	72.99	6.87
301	148.77	3:00	144.14	20:00	147.59	4.62	301	74.56	3:00	67.98	20:00	72.88	6.57
302	148.77	3:00	144.14	20:00	147.59	4.63	302	74.35	3:00	67.77	20:00	72.67	6.58
303	148.77	3:00	144.14	20:00	147.59	4.63	303	74.20	3:00	67.62	20:00	72.53	6.58
304	148.77	3:00	144.14	20:00	147.59	4.63	304	73.90	3:00	67.32	20:00	72.23	6.58
32	148.76	3:00	143.93	20:00	147.53	4.83	32	73.74	3:00	66.87	20:00	71.99	6.87
34	148.76	3:00	143.93	20:00	147.53	4.83	34	74.79	3:00	67.92	20:00	73.04	6.87
36	148.76	3:00	143.94	20:00	147.53	4.83	36	75.05	3:00	68.19	20:00	73.30	6.86
38	148.76	3:00	143.94	20:00	147.53	4.83	38	75.63	3:00	68.77	20:00	73.89	6.86
391	148.77	3:00	144.07	20:00	147.57	4.70	391	76.02	3:00	69.34	20:00	74.32	6.68
393	148.77	3:00	144.07	20:00	147.57	4.70	393	75.38	3:00	68.70	20:00	73.68	6.68
395	148.77	3:00	144.07	20:00	147.57	4.70	395	75.42	3:00	68.75	20:00	73.72	6.68
397	148.77	3:00	144.18	20:00	147.60	4.59	397	76.27	3:00	69.74	20:00	74.60	6.52
399	148.77	3:00	144.09	20:00	147.58	4.67	399	76.52	3:00	69.88	20:00	74.83	6.64
40	148.76	3:00	143.94	20:00	147.53	4.82	40	75.69	3:00	68.83	20:00	73.94	6.86
401	148.77	3:00	144.20	20:00	147.60	4.57	401	76.15	3:00	69.66	20:00	74.50	6.49
411	148.77	3:00	144.13	20:00	147.59	4.64	411	73.59	3:00	67.00	20:00	71.91	6.59
412	148.77	3:00	144.13	20:00	147.59	4.64	412	73.88	3:00	67.28	20:00	72.2	6.59
42	148.76	3:00	143.94	20:00	147.53	4.82	42	75.45	3:00	68.59	20:00	73.7	6.86
44	148.76	3:00	143.94	20:00	147.53	4.83	44	75.29	3:00	68.43	20:00	73.54	6.86
46	148.76	3:00	143.94	20:00	147.53	4.83	46	75.29	3:00	68.43	20:00	73.54	6.86
48	148.76	3:00	143.94	20:00	147.53	4.82	48	75.76	3:00	68.90	20:00	74.01	6.85
50	148.76	3:00	143.94	20:00:00	147.53	4.82	50	75.90	3:00	69.05	20:00:00	74.16	6.85
54	148.76	3:00	143.94	20:00	147.54	4.82	54	76.00	3:00	69.15	20:00	74.26	6.85
56	148.76	3:00	143.94	20:00	147.53	4.83	56	74.59	3:00	67.73	20:00	72.85	6.86
58	148.76	3:00:00	143.94	20:00	147.53	4.82	58	74.89	3:00:00	68.03	20:00	73.15	6.86
60	148.76	3:00	143.94	20:00:00	147.53	4.82	60	75.01	3:00	68.15	20:00:00	73.26	6.86
62	148.76	3:00	143.94	20:00	147.53	4.82	62	75.62	3:00	68.76	20:00	73.87	6.85
64	148.76	3:00	143.94	20:00	147.54	4.82	64	74.86	3:00	68.01	20:00	73.12	6.85
66	148.76	3:00	143.94	20:00	147.53	4.82	66	75.83	3:00	68.98	20:00	74.09	6.85
68	148.76	3:00:00	143.94	20:00	147.53	4.82	68	75.12	3:00:00	68.26	20:00	73.37	6.86
70	148.76	3:00	143.94	20:00	147.54	4.82	70	74.86	3:00	68.01	20:00	73.12	6.85
72	148.76	3:00	143.94	20:00	147.53	4.82	72	74.48	3:00	67.62	20:00	72.73	6.86
74	148.76	3:00:00	143.95	20:00	147.54	4.81	74	74.51	3:00:00	67.67	20:00	72.77	6.84
76	148.76	3:00	143.95	20:00	147.54	4.81	76	74.44	3:00	67.59	20:00	72.70	6.84
78	148.76	3:00:00	143.94	20:00	147.54	4.82	78	76.17	3:00:00	69.32	20:00	74.43	6.85
80	148.76	3:00	143.94	20:00	147.54	4.82	80	76.33	3:00	69.48	20:00	74.58	6.85
82	148.76	3:00	143.95	20:00	147.54	4.82	82	76.48	3:00	69.64	20:00	74.74	6.85
84	148.76	3:00	143.95	20:00	147.54	4.82	84	76.30	3:00	69.45	20:00	74.56	6.85
86	148.76	3:00	143.94	20:00	147.54	4.82	86	76.57	3:00	69.72	20:00	74.83	6.85
88	148.76	3:00	143.95	20:00	147.54	4.81	88	75.90	3:00	69.07	20:00	74.16	6.84
90	148.76	3:00	143.97	20:00	147.54	4.8	90	76.27	3:00	69.45	20:00	74.54	6.82
92	148.76	3:00	143.99	20:00:00	147.55	4.77	92	76.63	3:00	69.85	20:00:00	74.90	6.78
94	148.76	3:00	144.00	20:00	147.55	4.76	94	76.07	3:00	69.31	20:00	74.35	6.77
96	148.76	3:00	143.98	20:00:00	147.55	4.78	96	76.37	3:00	69.58	20:00:00	74.64	6.8
98	148.76	3:00	143.98	20:00:00	147.55	4.78	98	75.87	3:00	69.08	20:00:00	74.15	6.79

Dummy PS nodes; results at these nodes not reported.

163401550 - Richmond Caivan Water Distribution System Analysis - Scope Change 1
Model Results - MXDY+FF (Buildout Conditions)

ID	Min	Static Pressure (psi)	Static Head (m)	Fire-Flow Demand (L/s)	21.95	169.76	Available Flow at Hydrant (L/s)	Available Flow Pressure (psi)
	Max				Residual Pressure (psi)	62.92		
10	0.26	90.54	160.20	167.00	54.40	222.97	20.00	
100	0.28	92.33	160.20	167.00	46.07	205.94	20.00	
102	0.17	92.09	160.19	167.00	55.26	223.11	20.00	
104	0.17	91.92	160.19	167.00	54.50	222.50	20.00	
106	0.17	91.60	160.19	167.00	53.16	221.45	20.00	
108	0.17	91.49	160.19	167.00	25.50	174.56	20.00	
110	0.17	93.04	160.20	167.00	58.19	225.38	20.00	
112	0.17	92.90	160.20	167.00	58.44	225.66	20.00	
114	0.17	92.57	160.20	167.00	58.82	226.14	20.00	
116	0.17	92.63	160.21	167.00	58.77	226.06	20.00	
118	0.17	92.83	160.21	167.00	59.47	226.62	20.00	
120	0.17	92.12	160.21	167.00	59.72	227.14	20.00	
122	0.17	92.25	160.22	167.00	61.06	228.34	20.00	
124	0.17	92.65	160.22	167.00	61.13	228.23	20.00	
126	0.17	92.81	160.22	167.00	61.58	228.60	20.00	
128	0.17	92.73	160.22	167.00	32.75	184.59	20.00	
130	0.17	92.84	160.22	167.00	60.23	227.32	20.00	
132	0.28	92.00	160.22	167.00	32.21	184.15	20.00	
134	0.28	91.46	160.21	167.00	51.62	218.18	20.00	
136	0.28	91.31	160.21	167.00	46.25	206.78	20.00	
137	0.17	92.83	160.22	167.00	60.88	227.93	20.00	
138	0.28	91.98	160.21	167.00	21.95	169.76	20.00	
14	0.22	90.32	160.18	167.00	33.91	186.91	20.00	
140	0.28	91.81	160.21	167.00	24.15	172.73	20.00	
142	0.28	91.70	160.21	167.00	31.29	183.08	20.00	
144	0.28	91.57	160.21	167.00	44.69	203.76	20.00	
146	0.17	91.92	160.21	167.00	58.84	226.40	20.00	
148	0.28	91.97	160.22	167.00	54.79	222.72	20.00	
150	0.32	91.83	160.22	167.00	48.74	211.49	20.00	
152	0.32	91.70	160.22	167.00	47.55	209.14	20.00	
154	0.32	91.87	160.22	167.00	49.24	212.50	20.00	
156	0.32	91.71	160.22	167.00	60.60	228.26	20.00	
16	0.22	91.06	160.18	167.00	44.36	203.54	20.00	
160	0.32	92.32	160.22	167.00	61.54	228.91	20.00	
162	0.32	92.28	160.23	167.00	61.36	228.73	20.00	
164	0.32	92.19	160.24	167.00	61.87	229.26	20.00	
166	0.17	92.59	160.25	167.00	62.92	229.96	20.00	
168	0.32	92.49	160.24	167.00	58.37	225.77	20.00	
170	0.26	91.02	160.22	167.00	58.93	226.91	20.00	
172	0.26	90.73	160.21	167.00	44.40	203.62	20.00	
174	0.26	90.61	160.21	167.00	41.19	197.97	20.00	
176	0.26	90.28	160.21	167.00	38.32	193.42	20.00	
18	0.25	91.06	160.18	167.00	48.17	211.16	20.00	
182	0.61	90.87	160.21	167.00	58.33	226.76	20.00	
184	0.26	91.39	160.24	167.00	59.88	227.63	20.00	
186	0.26	91.22	160.23	167.00	36.69	190.55	20.00	
188	0.19	91.29	160.22	167.00	58.57	226.38	20.00	
190	0.19	91.02	160.21	167.00	57.54	225.54	20.00	
191	0.19	90.93	160.21	167.00	55.44	223.64	20.00	
192	0.26	90.67	160.21	167.00	55.10	223.50	20.00	
193	0.19	90.28	160.21	167.00	55.61	224.07	20.00	
194	0.61	90.61	160.21	167.00	57.51	226.10	20.00	
195	0.22	90.68	160.19	167.00	52.09	220.33	20.00	
196	0.19	90.89	160.21	167.00	56.80	224.91	20.00	
197	0.22	90.49	160.18	167.00	41.25	198.26	20.00	
198	0.19	90.76	160.21	167.00	56.27	224.47	20.00	
199	0.22	91.17	160.18	167.00	51.25	217.90	20.00	
20	0.25	90.98	160.18	167.00	46.26	207.30	20.00	
200	0.19	90.32	160.21	167.00	55.58	224.02	20.00	
201	0.22	91.03	160.18	167.00	51.01	217.45	20.00	
203	0.25	91.10	160.18	167.00	43.62	202.21	20.00	
204	0.19	90.96	160.21	167.00	49.06	212.79	20.00	
205	0.25	90.90	160.18	167.00	36.25	190.17	20.00	
206	0.19	90.87	160.21	167.00	34.53	187.51	20.00	
209	0.14	91.58	160.18	167.00	26.02	175.29	20.00	
21	0.25	91.95	160.18	167.00	50.49	215.48	20.00	
210	0.26	90.91	160.21	167.00	47.50	209.59	20.00	
211	0.14	90.91	160.18	167.00	25.27	174.28	20.00	
212	0.26	91.06	160.21	167.00	56.51	224.67	20.00	
213	0.14	90.53	160.18	167.00	34.24	187.24	20.00	
214	0.26	90.89	160.20	167.00	56.30	224.55	20.00	
22	0.25	91.17	160.18	167.00	41.50	198.42	20.00	
220	0.61	90.39	160.21	167.00	56.02	224.82	20.00	
228	0.26	90.26	160.20	167.00	46.99	209.06	20.00	
229	0	91.24	160.18	167.00	28.67	179.23	20.00	
230	0.26	90.42	160.20	167.00	31.84	184.02	20.00	
231	0	90.67	160.18	167.00	28.61	179.23	20.00	
232	0.26	90.57	160.20	167.00	55.27	223.73	20.00	
233	0	92.81	160.19	167.00	50.42	214.35	20.00	
234	0.26	90.73	160.20	167.00	56.23	224.55	20.00	
235	0.14	91.14	160.18	167.00	31.98	184.01	20.00	
236	0.26	90.44	160.20	167.00	48.87	212.93	20.00	
238	0.26	90.09	160.20	167.00	49.12	213.81	20.00	
24	0.25	91.31	160.18	167.00	47.05	208.67	20.00	
240	0.26	89.70	160.20	167.00	40.76	197.73	20.00	
242	0.26	90.34	160.20	167.00	43.66	202.55	20.00	
244	0.26	87.43	160.20	167.00	38.44	194.78	20.00	
246	0.26	87.43	160.20	167.00	41.09	199.42	20.00	
248	0.26	88.71	160.20	167.00	50.51	218.29	20.00	
250	0.26	90.19	160.20	167.00	53.43	222.23	20.00	
252	0.26	89.63	160.20	167.00	52.15	221.31	20.00	
254	0.26	89.38	160.20	167.00	50.97	218.78	20.00	
258	0.26	88.37	160.20	167.00	39.83	196.75	20.00	
26	0.25	90.87	160.18	167.00	42.56	200.42	20.00	
260	0.26	88.17	160.20	167.00	36.91	192.04	20.00	
262	0.26	89.73	160.20	167.00	48.45	212.61	20.00	
264	0.26	89.32	160.20	167.00	50.57	217.87	20.00	

268	0.26	89.42	160.20	167.00	47.58	210.96	20.00
270	0.26	89.20	160.20	167.00	50.65	218.16	20.00
272	0.26	89.57	160.20	167.00	51.72	220.44	20.00
278	0.26	89.32	160.20	167.00	50.64	218.04	20.00
28	0.25	90.83	160.18	167.00	41.25	198.15	20.00
282	0.26	89.06	160.20	167.00	49.58	215.74	20.00
284	0.26	89.18	160.20	167.00	50.17	217.03	20.00
288	0.26	88.81	160.20	167.00	49.33	215.39	20.00
289	0.28	91.37	160.21	167.00	22.60	170.64	20.00
290	0.26	91.29	160.23	167.00	59.18	227.01	20.00
30	0.25	90.97	160.18	167.00	43.41	201.87	20.00
301	0.19	90.83	160.21	167.00	49.78	214.48	20.00
302	0.19	90.61	160.21	167.00	56.01	224.29	20.00
303	0.19	90.47	160.21	167.00	55.72	224.09	20.00
304	0.19	90.17	160.21	167.00	47.38	209.82	20.00
32	0.22	89.98	160.18	167.00	33.33	186.18	20.00
34	0.25	91.03	160.18	167.00	43.52	202.05	20.00
36	0.25	91.29	160.18	167.00	51.61	218.68	20.00
38	0.25	91.87	160.18	167.00	52.93	221.26	20.00
391	0.28	92.29	160.21	167.00	55.28	223.05	20.00
393	0.28	91.65	160.21	167.00	51.89	218.63	20.00
395	0.28	91.70	160.21	167.00	46.54	207.10	20.00
399	0.17	92.81	160.22	167.00	61.35	228.38	20.00
40	0.25	91.93	160.18	167.00	53.14	221.42	20.00
401	0.32	92.48	160.26	167.00	62.39	229.62	20.00
402	0.26	91.32	160.24	167.00	46.23	206.64	20.00
403	0.26	91.16	160.23	167.00	55.36	223.51	20.00
404	0.26	92.15	160.22	167.00	55.14	222.94	20.00
405	0.26	92.29	160.22	167.00	30.88	182.37	20.00
406	0.26	90.27	160.20	167.00	48.61	212.50	20.00
407	0.26	90.42	160.20	167.00	27.86	178.32	20.00
408	0.26	90.70	160.20	167.00	55.02	223.45	20.00
409	0.26	90.84	160.20	167.00	54.87	223.27	20.00
410	0.26	89.85	160.20	167.00	28.88	180.06	20.00
411	0.19	89.85	160.20	167.00	42.06	199.82	20.00
412	0.26	90.13	160.20	167.00	54.51	223.21	20.00
413	0.26	89.70	160.20	167.00	53.27	222.26	20.00
414	0.26	89.56	160.20	167.00	52.01	221.17	20.00
415	0.26	88.85	160.20	167.00	30.00	181.93	20.00
416	0.26	88.14	160.20	167.00	28.88	180.44	20.00
42	0.25	91.68	160.18	167.00	46.86	207.98	20.00
44	0.25	91.53	160.18	167.00	51.53	218.26	20.00
46	0.25	91.53	160.18	167.00	51.16	217.39	20.00
48	0.18	92.00	160.18	167.00	50.39	215.14	20.00
50	0.18	92.14	160.18	167.00	49.55	213.17	20.00
54	0.18	92.24	160.19	167.00	53.86	221.86	20.00
56	0.22	90.83	160.18	167.00	50.76	217.04	20.00
58	0.22	91.13	160.18	167.00	49.63	214.20	20.00
60	0.22	91.24	160.18	167.00	48.58	211.80	20.00
62	0.22	91.86	160.18	167.00	49.76	213.88	20.00
64	0.22	91.10	160.19	167.00	52.10	219.96	20.00
66	0.22	92.07	160.18	167.00	49.99	214.21	20.00
68	0.22	91.36	160.18	167.00	49.08	212.80	20.00
70	0.22	91.10	160.19	167.00	51.90	219.48	20.00
72	0.22	90.72	160.18	167.00	51.06	217.84	20.00
74	0.22	90.75	160.19	167.00	51.86	219.70	20.00
76	0.22	90.68	160.19	167.00	48.87	212.84	20.00
78	0.18	92.41	160.19	167.00	50.34	214.66	20.00
80	0.18	92.57	160.19	167.00	50.03	213.86	20.00
82	0.18	92.72	160.19	167.00	50.9	215.64	20.00
84	0.18	92.54	160.19	167.00	45.39	204.51	20.00
86	0.18	92.81	160.19	167.00	50.85	215.48	20.00
88	0.18	92.14	160.19	167.00	54.35	222.32	20.00
90	0.17	92.52	160.19	167.00	55.36	223.05	20.00
92	0.17	92.88	160.20	167.00	58.09	225.37	20.00
94	0.17	92.33	160.20	167.00	57.97	225.45	20.00
96	0.17	92.62	160.19	167.00	56.75	224.25	20.00
98	0.28	92.13	160.20	167.00	46.89	207.66	20.00

APPENDIX D

SANITARY SEWER CALCULATION SHEET



Manning's n=0.013

LOCATION		RESIDENTIAL AREA AND POPULATION							COMM		INSTIT		PARK		C+I		INFILTRATION			PIPE								
STREET	FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE		PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL.		
						AREA (ha)	POP.																			(FULL) (m/s)	(ACT.) (m/s)	
STREET 'L'																												
	411A	412A	0.49		44	0.49	44	3.7	0.52		0.00		0.00		0.00	0.00	0.49	0.49	0.16	0.68	77.0	200	0.65	26.44	0.03	0.84	0.36	
	412A	413A	0.43		38	0.92	82	3.6	0.96		0.00		0.00		0.00	0.43	0.92	0.30	1.26	77.0	200	0.35	19.40	0.07	0.62	0.34		
To STREET 'Q', Pipe 413A - 414A						0.92	82				0.00		0.00				0.92											
COMMERCIAL BLOCK																												
	1001A	407A				0.00				1.89	1.89		0.00		0.00	0.61	1.89	1.89	0.62	1.24	31.5	200	0.65	26.44	0.05	0.84	0.43	
To STREET 'P', Pipe 407A - 4001A						0.00	0				1.89		0.00		0.00			1.89										
STREET 'Q'																												
	416A	417A	0.43		38	0.43	38	3.7	0.45		0.00		0.00		0.00	0.43	0.43	0.14	0.59	62.0	200	0.65	26.44	0.02	0.84	0.34		
	417A	418A	0.37		33	0.80	71	3.6	0.83		0.00		0.00		0.00	0.37	0.80	0.26	1.10	62.0	200	0.35	19.40	0.06	0.62	0.33		
To STREET 'J', Pipe 418A - 261A						0.80	71				0.00		0.00		0.00		0.80											
Contribution From STREET 'O', Pipe 402A - 405A						1.13	100				0.00		0.00		0.00		1.13	1.13										
Contribution From STREET 'O', Pipe 404A - 405A						1.00	89				0.00		0.00		0.00		1.00	2.13										
	405A	410A	0.09		8	2.22	197	3.5	2.25		0.00		0.00		0.00	0.09	2.22	0.73	2.98	60.5	200	0.35	19.40	0.15	0.62	0.44		
Contribution From STREET 'I', Pipe 4001A - 410A						0.80	73				1.89		0.00		0.00		2.69	4.91										
Contribution From STREET 'M', Pipe 409A - 410A						0.91	81				0.00		0.00		0.00		0.91	5.82										
	410A	413A	0.20		18	4.13	369	3.4	4.10		1.89		0.00		0.00	0.61	0.20	6.02	1.99	6.70	60.5	250	0.25	29.73	0.23	0.61	0.49	
Contribution From STREET 'L', Pipe 412A - 413A						0.92	82				0.00		0.00		0.00		0.92	6.94										
	413A	414A	0.21		19	5.26	470	3.4	5.16		1.89		0.00		0.00	0.61	0.21	7.15	2.36	8.14	53.0	250	0.25	29.73	0.27	0.61	0.51	
	414A	415A	0.15		13	5.41	483	3.4	5.30		1.89		0.00		0.00	0.61	0.15	7.30	2.41	8.32	11.0	250	0.25	29.73	0.28	0.61	0.52	
	415A	418A	0.11		10	5.52	493	3.4	5.40		1.89		0.00		0.00	0.61	0.11	7.41	2.45	8.46	21.0	250	0.25	29.73	0.28	0.61	0.52	
To STREET 'J', Pipe 418A - 261A						5.52	493				1.89		0.00		0.00		7.41											
STREET 'J'																												
Contribution From STREET 'Q', Pipe 415A - 418A						5.52	493				1.89		0.00		0.00		7.41	7.41										
Contribution From STREET 'Q', Pipe 417A - 418A						0.80	71				0.00		0.00		0.00		0.80	8.21										
	418A	261A	0.06		6	6.37	568				1.89		0.00		0.00	0.06	8.32	2.75	9.60	70.5	250	0.25	29.73	0.32	0.61	0.54		
To OLDENBURG AVENUE, Pipe 261A - 262A						6.43	574				1.89		0.00		0.00		8.32											
STREET 'P'																												
	421A	422A	0.37		33	0.37	33	3.7	0.39		0.00		0.00		0.00	0.37	0.37	0.12	0.52	98.0	200	0.65	26.44	0.02	0.84	0.33		
To STREET 'H', Pipe 422A - 423A						0.37	33				0.00		0.00		0.00		0.37											
STREET 'M'																												
	408A	409A	0.49		44	0.49	44	3.7	0.52		0.00		0.00		0.00	0.49	0.49	0.16	0.68	77.0	200	0.65	26.44	0.03	0.84	0.36		
	409A	410A	0.42		37	0.91	81	3.6	0.95		0.00		0.00		0.00	0.42	0.91	0.30	1.25	77.0	200	0.35	19.40	0.06	0.62	0.34		
To STREET 'Q', Pipe 410A - 413A						0.91	81				0.00		0.00		0.00		0.91											
STREET 'I'																												
	406A	407A				0.00					0.00		0.00		0.00	0.00	0.00	0.00	0.00	29.0	200	0.65	26.44	0.00	0.84	0.05		
Contribution From COMMERCIAL BLOCK, Pipe 1001A - 407A						0.00	0				1.89		0.00		0.00		1.89	1.89										
	407A	4001A	0.45		41	0.45	41	3.7	0.49		1.89		0.00		0.00	0.61	0.45	2.34	0.77	1.87	75.0	200	0.35	19.40	0.10	0.62	0.39	
	4001A	410A	0.35		32	0.80	73	3.6	0.86		1.89		0.00		0.00	0.61	0.35	2.69	0.89	2.36	75.0	200	0.35	19.40	0.12	0.62	0.42	
To STREET 'Q', Pipe 410A - 413A						0.80	73				1.89		0.00		0.00		2.69											

DESIGN PARAMETERS										Designed: SLM		PROJECT: Richmond Green Lands East and West																	
Park Flow = 9300 L/ha/da Average Daily Flow = 280 l/p/day Comm/Inst Flow = 28000 L/ha/da Industrial Flow = 35000 L/ha/da Max Res. Peak Factor = 4.00 Commercial/Inst./Park Peak Factor = 1.00 Institutional = 0.32 l/s/ha										Industrial Peak Factor = as per MOE Graph		Checked: ADF		LOCATION: City of Ottawa															
Extraneous Flow = 0.330 L/s/ha Minimum Velocity = 0.600 m/s Manning's n = (Conc) 0.013 (Pvc) 0.013 Townhouse coeff= 2.7 Single house coeff= 3.4										Dwg. Reference: Sanitary Drainage Plan, Dwgs. No. 2A		File Ref: 20-1183				Date: 26 Feb 2021				Sheet No: 1 of 3									

SANITARY SEWER CALCULATION SHEET



Manning's n=0.013

LOCATION		RESIDENTIAL AREA AND POPULATION							COMM		INSTT		PARK		C+I		INFILTRATION			PIPE							
STREET	FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE		PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL.	
						AREA (ha)	POP.																			(FULL) (m/s)	(ACT.) (m/s)
STREET 'H'																											
Contribution From STREET 'O', Pipe 431A - 420A																											
		420A	422A	0.09	8	0.64	57	3.6	0.77		0.00	0.00	0.00	0.00	0.00	0.00	0.64	0.64	0.24	1.01	60.5	200	0.35	19.40	0.05	0.62	0.32
Contribution From STREET 'P', Pipe 421A - 422A																											
		422A	423A	0.09	8	1.19	106	3.6	1.23		0.00	0.00	1.08	1.08	0.12	1.17	2.27	0.75	2.10	60.5	200	0.35	19.40	0.11	0.62	0.40	
		423A	424A	0.09	8	1.28	114	3.6	1.32		0.00	0.00	1.08	1.08	0.12	1.17	2.36	0.78	2.22	60.5	200	0.35	19.40	0.11	0.62	0.41	
		424A	307A	0.05	4	1.33	118				0.00	0.00	1.08	1.08	0.05	2.41											
		424A	307A	0.05	4	1.38	122	3.6	1.41		0.00	0.00	1.08	1.08	0.12	0.05	2.46	0.81	2.34	72.0	200	0.35	19.40	0.12	0.62	0.41	
To OLDENBURG AVENUE, Pipe 307A - 308A																											
STREET 'K'																											
		429A	430A	0.26	20	0.26	20	3.7	0.24		0.00	0.00	0.00	0.00	0.00	0.26	0.26	0.09	0.33	59.0	200	0.65	26.44	0.01	0.84	0.28	
Contribution From STREET 'N', Pipe 428A - 430A																											
		430A	434A	0.29	22	1.45	110	3.6	1.75		0.00	0.00	0.00	0.00	0.00	1.45	1.71										
To STREET 'O', Pipe 434A - 304A																											
STREET 'O'																											
		431A	420A	0.64	57	0.64	57	3.6	0.67		0.00	0.00	0.00	0.00	0.64	0.64	0.21	0.88	101.5	200	0.65	26.44	0.03	0.84	0.39		
To STREET 'H', Pipe 420A - 422A																											
		401A	402A	0.62	55	0.62	55	3.6	0.65		0.00	0.00	0.00	0.00	0.62	0.62	0.20	0.85	88.0	200	0.65	26.44	0.03	0.84	0.38		
		402A	405A	0.51	45	1.13	100	3.6	1.17		0.00	0.00	0.00	0.00	0.51	1.13	0.37	1.54	88.0	200	0.35	19.40	0.08	0.62	0.37		
To STREET 'Q', Pipe 405A - 410A																											
		403A	404A	0.54	48	0.54	48	3.7	0.57		0.00	0.00	0.00	0.00	0.54	0.54	0.18	0.75	77.5	200	0.65	26.44	0.03	0.84	0.37		
		404A	405A	0.46	41	1.00	89	3.6	1.04		0.00	0.00	0.00	0.00	0.46	1.00	0.33	1.37	77.5	200	0.35	19.40	0.07	0.62	0.35		
To STREET 'Q', Pipe 405A - 410A																											
		431A	432A	0.14	11	0.14	11	3.7	0.13		0.00	0.00	0.00	0.00	0.14	0.14	0.05	0.18	11.0	200	0.65	26.44	0.01	0.84	0.23		
		432A	433A	0.23	17	0.37	28	3.7	0.33		0.00	0.00	0.00	0.00	0.23	0.37	0.12	0.46	53.0	200	0.65	26.44	0.02	0.84	0.32		
		433A	434A	0.63	48	1.00	76	3.6	0.89		0.00	0.00	0.00	0.00	0.63	1.00	0.33	1.22	99.0	200	0.35	19.40	0.06	0.62	0.34		
Contribution From STREET 'K', Pipe 430A - 434A																											
		434A	304A	0.28	21	3.28	249	3.5	2.82		0.00	0.00	0.00	0.00	0.28	3.28	1.08	3.90	73.5	200	0.35	19.40	0.20	0.62	0.48		
To OLDENBURG AVENUE, Pipe 304A - 305A																											
STREET 'N'																											
		435A	426A	0.30	23	0.30	23	3.7	0.28		0.00	0.00	0.00	0.00	0.30	0.30	0.10	0.37	55.0	200	0.65	26.44	0.01	0.84	0.29		
		426A	427A	0.15	11	0.45	34	3.7	0.41		0.00	0.00	0.00	0.00	0.15	0.45	0.15	0.55	11.5	200	0.35	19.40	0.03	0.62	0.27		
		427A	428A	0.52	40	0.97	74	3.6	0.87		0.00	0.00	0.00	0.00	0.52	0.97	0.32	1.19	74.0	200	0.35	19.40	0.06	0.62	0.34		
		428A	430A	0.48	36	1.45	110	3.6	1.28		0.00	0.00	0.00	0.00	0.48	1.45	0.48	1.76	73.5	200	0.35	19.40	0.09	0.62	0.38		
To STREET 'K', Pipe 430A - 434A																											
		435A	436A	0.16	13	0.16	13	3.7	0.16		0.00	0.00	0.00	0.00	0.16	0.16	0.05	0.21	11.0	200	0.65	26.44	0.01	0.84	0.24		
		436A	437A	0.50	38	0.66	51	3.7	0.60		0.00	0.00	0.00	0.00	0.50	0.66	0.22	0.82	74.0	200	0.65	26.44	0.03	0.84	0.38		
		437A	438A	0.49	37	1.15	88	3.6	1.03		0.00	0.00	0.00	0.00	0.49	1.15	0.38	1.41	73.5	200	0.35	19.40	0.07	0.62	0.36		
		438A	301A	0.25	19	1.40	107	3.6	1.24		0.00	0.00	0.00	0.00	0.25	1.40	0.46	1.71	68.0	200	0.35	19.40	0.09	0.62	0.38		
To OLDENBURG AVENUE, Pipe 301A - 302A																											

DESIGN PARAMETERS										Designed: SLM					PROJECT: Richmond Green Lands East and West												
Park Flow = 9300 L/ha/da Average Daily Flow = 280 l/p/day Comm/Inst Flow = 28000 L/ha/da Industrial Flow = 35000 L/ha/da Max Res. Peak Factor = 4.00 Commercial/Inst./Park Peak Factor = 1.00 Institutional = 0.32 l/s/ha										Industrial Peak Factor = as per MOE Graph Extraneous Flow = 0.330 L/s/ha Minimum Velocity = 0.600 m/s Manning's n = 0.013 (Pvc) Townhouse coeff = 2.7 Single house coeff = 3.4					Checked: ADF LOCATION: City of Ottawa Dwg. Reference: Sanitary Drainage Plan, Dwgs. No. 2A File Ref: 20-1183 Date: 26 Feb 2021 Sheet No of 2 of 3												


Lower flows (35.67 L/s) projected for the Green Lands West than the flows that were previously summarized in the Fox Run Phase 1 design sheet. Therefore, no downstream impacts.



SANITARY SEWER CALCULATION SHEET																											
Manning's n=0.013																											
LOCATION		RESIDENTIAL AREA AND POPULATION							COMM		INSTIT		PARK		C+I		INFILTRATION			PIPE							
STREET	FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE AREA (ha)	CUMULATIVE POP.	PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL (FULL) (m/s)	VEL (ACT.) (m/s)
OLDENBURG AVENUE																											
Contribution From STREET 'N', Pipe 438A - 301A																											
	301A	302A	0.11		8	1.40	107				0.00	0.00	0.00	0.00	0.00	1.40	1.40	0.00	1.40	1.83	7.5	200	0.35	19.40	0.09	0.62	0.39
			0.15		11	1.66	126				0.00	0.00	0.00	0.00	0.00	1.66	1.66	0.00	1.66	1.83	7.5	200	0.35	19.40	0.09	0.62	0.39
	302A	303A	0.41		30	2.07	156	3.5	1.79		0.00	0.00	0.00	0.00	0.00	2.07	2.07	0.68	2.48	65.0	200	0.35	19.40	0.13	0.62	0.42	
			0.18		14	2.25	170				0.00	0.00	0.00	0.00	0.00	2.25	2.25	0.00	2.25	65.0	200	0.35	19.40	0.13	0.62	0.42	
	303A	304A	3.00		216	5.25	386	3.4	4.28		0.00	0.00	0.00	0.00	0.00	5.25	5.25	1.73	6.02	70.5	200	0.35	19.40	0.31	0.62	0.54	
Contribution From STREET 'O', Pipe 434A - 304A																											
	304A	305A	0.20		14	8.73	649	3.3	7.01		0.00	0.00	0.00	0.00	0.00	8.73	8.73	2.88	9.89	46.0	250	0.25	29.73	0.33	0.61	0.54	
	305A	306A	0.36		26	9.09	675	3.3	7.27		0.00	0.00	0.00	0.00	0.00	9.09	9.09	3.00	10.27	54.0	250	0.25	29.73	0.35	0.61	0.55	
	306A	307A				9.09	675	3.3	7.27		0.00	0.00	0.00	0.00	0.00	9.09	9.09	3.00	10.27	14.0	250	0.25	29.73	0.35	0.61	0.55	
Contribution From STREET 'H', Pipe 424A - 307A																											
	307A	308A	0.31		22	10.78	819	3.3	8.71		0.00	0.00	0.00	1.08	1.08	11.55	11.55	3.91	12.74	70.5	300	0.20	43.25	0.29	0.61	0.53	
			5.22		400	16.00	1219	2.0	7.90		0.00	0.00	0.00	1.08	1.08	5.22	5.22	17.08	17.08								
			0.29		21	16.29	1240	2.0	8.04		0.00	0.00	0.00	1.08	1.08	0.29	0.29	17.37	17.37								
	308A	EX 261A	0.48		35	16.77	1275	3.2	13.15		0.00	0.00	0.00	1.08	1.08	0.48	0.48	5.89	19.16	66.0	300	0.20	43.25	0.44	0.61	0.59	
Contribution From STREET 'J', Pipe 418A - EX 261A																											
			0.25		21	23.45	1870				1.89	0.00	0.00	1.08	1.08	0.25	0.25	26.42	26.42								
	EX 261A	EX 262A	0.50		44	23.95	1914	3.1	19.11		1.89	0.00	0.00	1.08	0.73	0.50	0.50	8.88	28.72	75.0	300	0.20	43.25	0.66	0.61	0.65	
			0.26		24	24.21	1938				1.89	0.00	0.00	1.08	0.00	0.26	0.26	27.18	27.18								
	EX 262A	EX 263A	0.29		28	24.50	1966	3.1	19.58		1.89	0.00	0.00	1.08	0.73	0.29	0.29	27.47	9.07	29.37	75.0	300	0.20	43.25	0.68	0.61	0.66
			0.22		14	24.72	1980				1.89	0.00	0.00	1.08	0.00	0.22	0.22	27.69	27.69								
	EX 263A	EX 267A	4.04		360	28.76	2340	3.0	22.94		1.89	0.00	0.00	1.08	0.73	4.04	4.04	10.47	34.14	69.0	375	0.15	67.91	0.50	0.61	0.61	
			0.44		126	29.20	2466				1.89	0.00	0.00	1.08	0.00	0.44	0.44	32.17	32.17								
	EX 267A	EX 150A	0.74		2	29.94	2468	3.0	24.08		1.89	0.00	0.00	1.08	0.73	0.74	0.74	10.86	35.67	22.0	375	0.15	67.91	0.53	0.61	0.62	
STREET 'G'																											
Contribution From MIRA COURT, Pipe 24 - 506A																											
	506A	507A				0.55	18.00				0.00	0.00	0.00	0.00	0.00	0.55	0.55	0.00	0.55	30.0	200	1.30	37.40	0.01	1.19	0.38	
To STREET 'G', Pipe 507A - 508A																											
						0.55	18	3.7	0.22		0.00	0.00	0.00	0.00	0.00	0.55	0.55	0.18	0.40								
STREET 'G'																											
	501A	502A	0.19		6	0.19	6	3.7	0.07		0.00	0.00	0.00	0.00	0.00	0.19	0.19	0.06	0.14	18.5	200	0.65	26.44	0.01	0.84	0.22	
	502A	503A	0.51		17	0.70	23	3.7	0.28		0.00	0.00	0.00	0.00	0.00	0.51	0.70	0.23	0.51	87.0	200	0.65	26.44	0.02	0.84	0.33	
	503A	504A	0.54		18	1.24	41	3.7	0.49		0.00	0.00	0.00	0.00	0.00	0.54	1.24	0.41	0.90	84.0	200	0.35	19.40	0.05	0.62	0.31	
	504A	509A	0.49		16	1.73	57	3.6	0.67		0.00	0.00	0.00	0.00	0.00	0.49	1.73	0.57	1.24	84.0	200	0.35	19.40	0.06	0.62	0.34	
To CEDARSTONE STREET, Pipe 509A - 510A																											
Contribution From STREET 'G', Pipe 506A - 507A																											
	507A	508A				0.55	18	3.7	0.22		0.00	0.00	0.00	0.00	0.00	0.55	0.55	0.18	0.40	23.0	200	1.45	39.49	0.01	1.26	0.40	
	508A	509A	0.61		20	1.16	38	3.7	0.45		0.00	0.00	0.00	0.00	0.00	0.61	1.16	0.38	0.83	70.5	200	0.35	19.40	0.04	0.62	0.31	
To CEDARSTONE STREET, Pipe 509A - 510A																											
CEDARSTONE STREET																											
Contribution From STREET 'G', Pipe 504A - 509A																											
						1.73	57				0.00	0.00	0.00	0.00	0.00	1.73	1.73	0.00	1.73								
Contribution From STREET 'G', Pipe 508A - 509A																											
	509A	510A				2.89	95	3.6	1.11		0.00	0.00	0.00	0.00	0.00	2.89	2.89	0.95	2.06	34.5	200	0.35	19.40	0.11	0.62	0.40	
MIRA COURT																											
	24	506A	0.55		18	0.55	18	3.7	0.22		0.00	0.00	0.00	0.00	0.00	0.55	0.55	0.18	0.40	101.5	200	0.65	26.44	0.02	0.84	0.30	
To STREET 'G', Pipe 506A - 507A																											

Green Lands East sanitary flow total of 2.46 L/s projected to existing sewers.

DESIGN PARAMETERS										Designed:		PROJECT:							
Park Flow =	9300	L/ha/da	0.10764	l/s/ha						SLM		Richmond Green Lands East and West							
Average Daily Flow =	280	l/p/day			Industrial Peak Factor = as per MOE Graph							LOCATION:							
Comm/Inst Flow =	28000	L/ha/da	0.3241	l/s/ha	Extraneous Flow =	0.330	L/s/ha			ADF		City of Ottawa							
Industrial Flow =	35000	L/ha/da	0.40509	l/s/ha	Minimum Velocity =	0.600	m/s					Date:							
Max Res. Peak Factor =	4.00				Manning's n = (Conc)	0.013	(Pvc)	0.013				File Ref:				Sheet No			
Commercial/Inst./Park Peak Factor =	1.00				Townhouse coeff =	2.7						20-1183				26 Feb 2021			
Institutional =	0.32	l/s/ha			Single house coeff =	3.4						Sanitary Drainage Plan, Dwg. No. 2A				of 3			

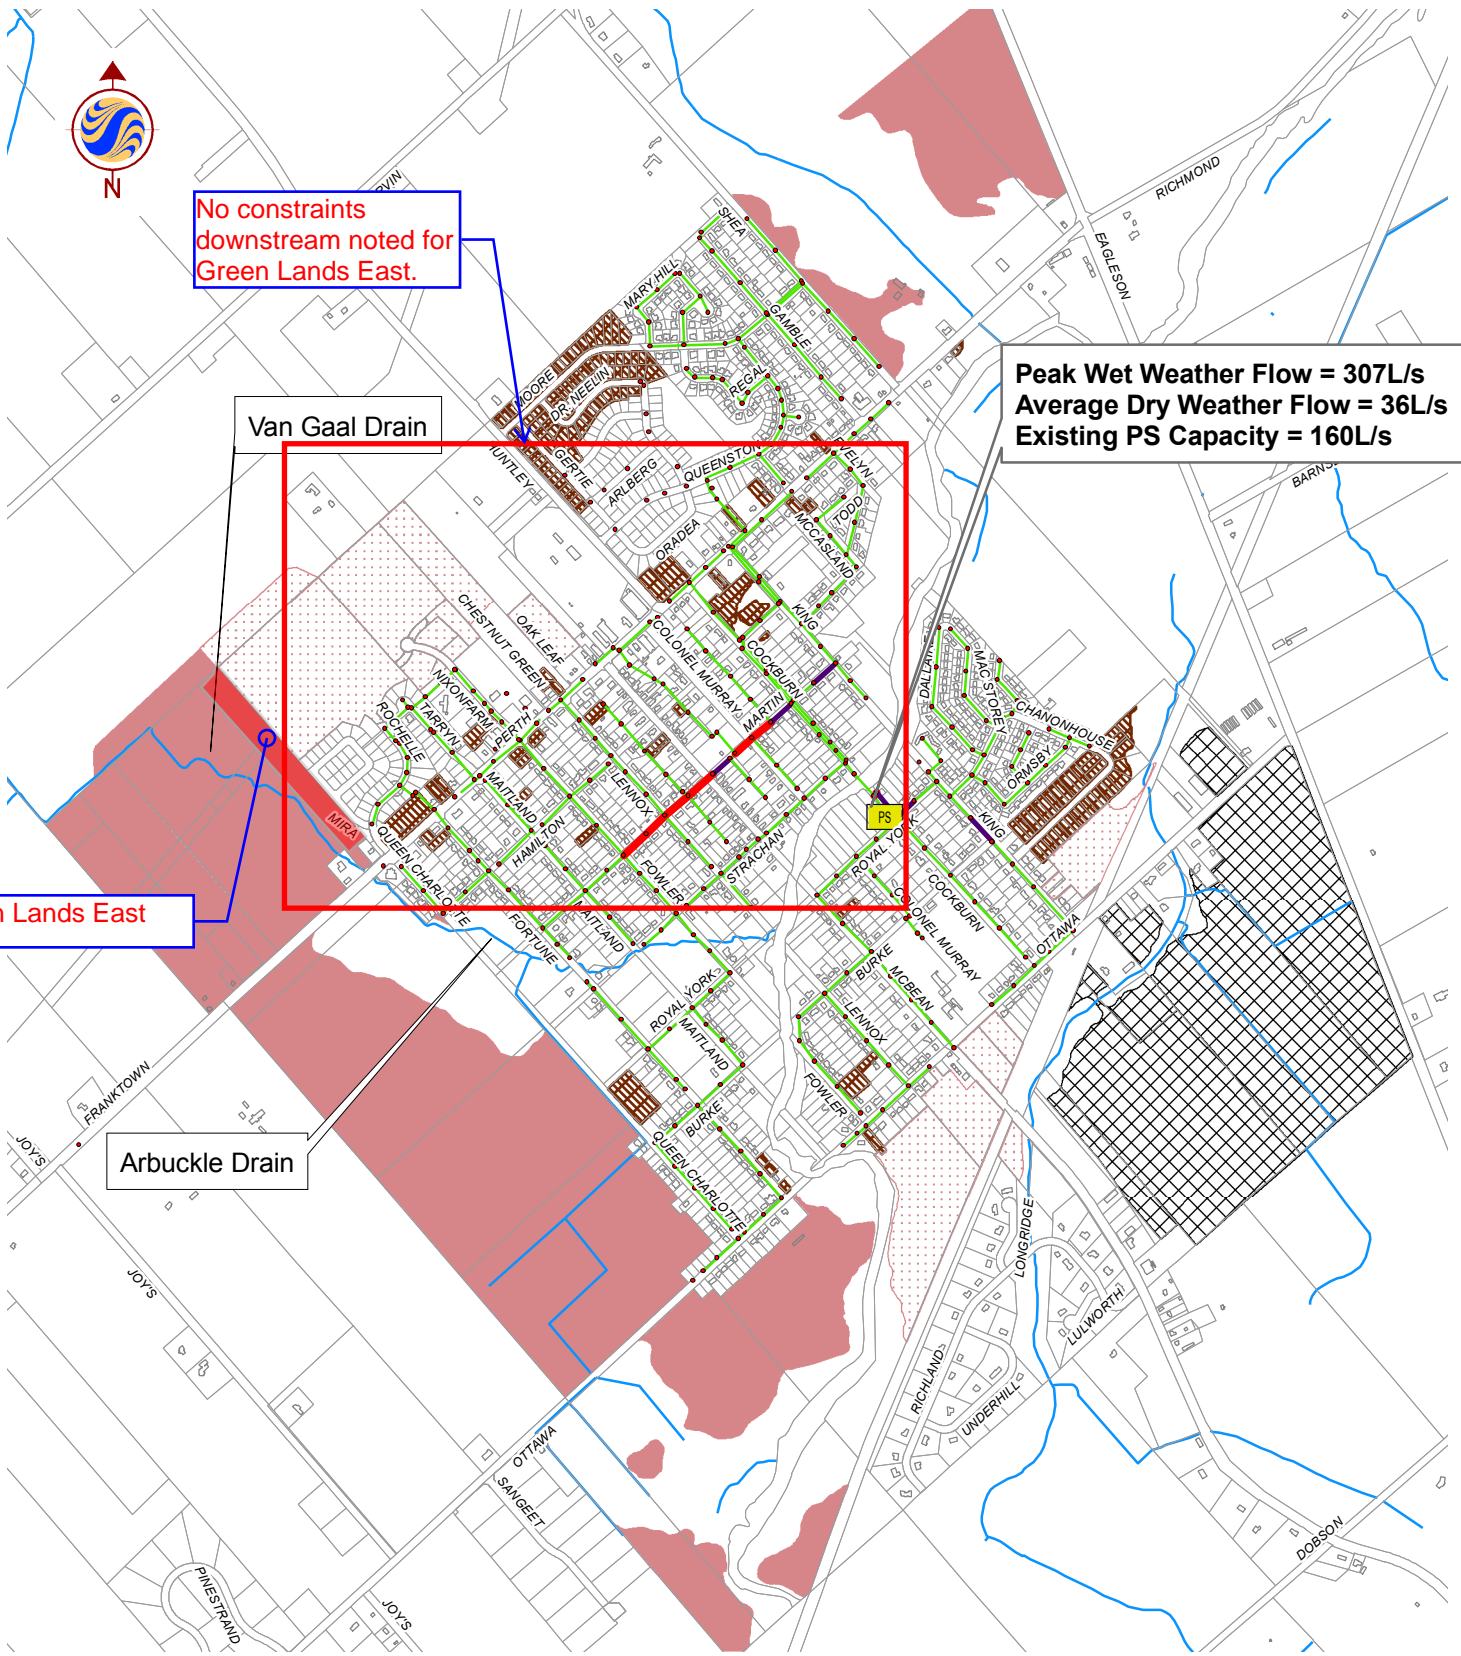

W:\active\1634_00808_Richmond_Water_Sanitary\planning\drawing\GIS Data\Master Plan Figures\Figure 5.7-richmond_wastewater_SS_Results_PS_ECapacity_portrait_mt20090130.mxd

Legend

Flow / Pipe Capacity		Serviced Future Development	
	0.00-0.90		Future Development
	0.90-1.10		Future Infill
	+1.10		Future Industrial

Client/Project

CITY OF OTTAWA
VILLAGE OF RICHMOND
MASTER SERVICING STUDY

Figure No.

5.7

Title

**Existing, Infill & Limited Future
Growth Area
Gravity Collection System
Bottlenecks**

March 2009
1634-00808



Stantec



TOTAL FLOWS FROM LAFFIN ONLY



SANITARY SEWER CALCULATION SHEET

Manning's n=0.013

LOCATION			RESIDENTIAL AREA AND POPULATION							COMM		INSTIT		PARK		CWH	INFILTRATION			PIPE							
STREET	FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE		PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL.	
						AREA (ha)	POP.																			(FULL) (m/s)	(ACT.) (m/s)
	511A	513A	0.19		16	3.16	260	3.5	2.94		0.00		0.00		0.00	0.19	3.16	1.04	3.98	60.5	200	0.35	19.40	0.21	0.62	0.48	
To STREET F, Pipe 513A - 514A						3.16	260				0.00		0.00		0.00		3.16										
STREET F																											
Contribution From STREET A, Pipe 511A - 513A						3.16	260				0.00		0.00		0.00	0.11	3.16	3.27	0.04	0.15	30.5	200	0.65	26.44	0.01	0.84	0.22
	513A	514A	0.71		57	3.98	326	3.5	3.65		0.00		0.00		0.00	0.71	3.98	1.31	4.96	120.0	200	0.35	19.40	0.26	0.62	0.51	
To SAN TRUNK 2, Pipe 524A - 525A						4.03	330	3.4	3.69		0.00		0.00		0.00	0.05	4.03	1.33	5.02	9.5	200	0.35	19.40	0.26	0.62	0.52	
SAN TRUNK 2																											
Contribution From PATHWAY SERVICING BLOCK, Pipe 523A - 524A						2.79	227				0.00		0.00		0.00	2.79	2.79										
Contribution From STREET F, Pipe 514A - 524A						4.03	330				0.00		0.00		0.00	4.03	4.03										
	524A	525A	0.15	3	12	6.97	569				0.00		0.00		0.15	6.97											
	525A	526A	0.80	18	62	7.92	642	3.4	6.30		0.00		0.00		0.00	0.15	7.12	2.35	8.65	61.0	250	0.30	32.57	0.27	0.66	0.56	
	526A	8A	0.32	2	7	8.24	649				0.00		0.00		0.32	8.24											
	8A	9A	0.12	3	11	14.54	1130	3.2	11.76		0.00		0.00		0.30	14.54	4.80	16.56	81.5	250	0.30	32.57	0.51	0.66	0.66		
	9A	11A	0.25	4	14	14.91	1155	3.2	12.00		0.00		0.00		0.25	14.91	4.92	16.92	11.0	250	0.30	32.57	0.52	0.66	0.67		
	11A	12A	0.26	6	21	15.17	1176	3.2	12.21		0.00		0.00		0.26	15.17	5.01	17.21	44.5	250	0.30	32.57	0.53	0.66	0.67		
	12A	13A	0.26	6	21	15.43	1197	3.2	12.41		0.00		0.00		0.26	15.43	5.09	17.50	41.5	250	0.30	32.57	0.54	0.66	0.67		
To SAN TRUNK 2, Pipe 13A - 20A						15.43	1197				0.00		0.00		0.00		15.43										
SAN TRUNK 1																											
Contribution From SAN TRUNK 2, Pipe 12A - 13A						15.43	1197				0.00		0.00		0.00	15.43	15.43										
	13A	20A	0.25	3	11	54.43	4082	2.9	37.84		0.00	2.63	3.60	3.60	1.24	0.25	60.66	20.02	59.10	64.5	375	0.22	82.24	0.72	0.74	0.81	
	20A	21A				54.43	4082	2.9	37.84		0.00	2.63	3.60	3.60	1.24	0.00	60.66	20.02	59.10	47.5	450	0.22	133.73	0.44	0.84	0.81	
	21A	Ex Plug				54.43	4082	2.9	37.84		0.00	2.63	3.60	3.60	1.24	0.00	60.66	20.02	59.10	14.5	450	0.22	133.73	0.44	0.84	0.81	

DESIGN PARAMETERS					
Park Flow =	9300	L/ha/da	0.10764	I/s/ha	
Average Daily Flow =	280	l/p/day			Industrial Peak Factor = as per MOE Graph
Comm/Inst Flow =	28000	L/ha/da	0.3241	I/s/ha	Extraneous Flow = 0.330 L/s/ha
Industrial Flow =	35000	L/ha/da	0.40509	I/s/ha	Minimum Velocity = 0.600 m/s
Max Res. Peak Factor =	4.00				Manning's n = (Conc) 0.013 (Pvc) 0.013
Commercial/Inst./Park Peak Factor =	1.00				Townhouse coeff= 2.7
Institutional =	0.32	I/s/ha			Single house coeff= 3.4

Designed:	A.K.	PROJECT:	CAIVAN RICHMOND LAFFIN	
Checked:	W.L.	LOCATION:	City of Ottawa	
Dwg. Reference:	2B	File Ref:	20-1184	Date: Feb 2021
			Sheet No. 2	of 2


TOTAL FLOWS FROM ALL SOUTH LANDS TO PHASE 1 SEWER (i.e. less than the flow of 62.33L/s estimated during sanitary sewer design for Fox Run Phase 1 sewers).

SANITARY SEWER CALCULATION SHEET



Manning's n=0.013

LOCATION			RESIDENTIAL AREA AND POPULATION							COMM		INSTIT		PARK		C+H		INFILTRATION			PIPE						
STREET	FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE		PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA Nominal (mm)	DIA Actual (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL. (FULL) (m/s)
						AREA (ha)	POP.																				
cercle Equitation Circle																											
	5A	6A	0.38	9	30.6	0.38	30.6	4.00	0.50								0.38	0.38	0.106	0.61	50.0	200	200	0.90	31.12	0.02	0.99
	6A	7A	0.71	20	68.0	1.09	98.6	4.00	1.60								0.71	1.09	0.305	1.91	107.5	200	200	0.40	20.74	0.09	0.66
To cercle Equitation Circle , Pipe 7A - 8A																											
						1.09	98.6																				
	1A	2A	0.24	4	13.6	0.24	13.6	4.00	0.22								0.24	0.24	0.067	0.29	40.0	200	200	0.65	26.44	0.01	0.84
	2A	3A	0.38	8	27.2	0.62	40.8	4.00	0.66								0.38	0.62	0.174	0.83	94.0	200	200	0.40	20.74	0.04	0.66
	3A	4A	0.06	1	3.4	0.68	44.2	4.00	0.72								0.06	0.68	0.190	0.91	11.0	200	200	0.40	20.74	0.04	0.66
	4A	7A	0.29	7	23.8	0.97	68.0	4.00	1.10								0.29	0.97	0.272	1.37	62.5	200	200	0.85	30.24	0.05	0.96
Contribution From cercle Equitation Circle, Pipe 6A - 7A																											
						1.09	98.6										1.09	2.06									
	7A	8A	0.25	5	17.0	2.31	183.6	4.00	2.98								0.25	2.31	0.647	3.63	70.5	200	200	0.40	20.74	0.18	0.66
To croissant Hackamore Crescent , Pipe 8A - 152A																											
						2.31	183.6																				
croissant Hackamore Crescent																											
Contribution From Future Phase																											
						0.94	72.0										0.94	0.94									
	PLUG	8A	0.04	1	3.4	0.98	75.4	4.00	1.22								0.04	0.98	0.274	1.49	11.0	200	200	0.50	23.19	0.06	0.74
Contribution From cercle Equitation Circle, Pipe 7A - 8A																											
						2.31	183.6										2.31	3.29									
	8A	152A	0.26	5	17.0	3.55	276.0	4.00	4.47								0.26	3.55	0.994	5.46	73.5	200	200	0.40	20.74	0.26	0.66
To chemin Meynell Road, Pipe 152A - 153A																											
						3.55	276.0																				
croissant Cantele Crescent																											
Contribution From Flushing Device (1.50 L/s)																											
																				1.50							
	9A	152A	0.34	4	13.6	0.34	13.6	4.00	0.22								0.34	0.34	0.095	1.82	59.0	200	200	0.65	26.44	0.07	0.84
To chemin Meynell Road, Pipe 152A - 153A																											
						0.34	13.6																				
	10A	11A	0.22	3	10.2	0.22	10.2	4.00	0.17								0.22	0.22	0.062	0.23	16.5	200	200	0.65	26.44	0.01	0.84
	11A	153A	0.65	16	54.4	0.87	64.6	4.00	1.05								0.65	0.87	0.244	1.29	103.5	200	200	0.35	19.40	0.07	0.62
To chemin Meynell Road, Pipe 153A - 155A																											
						0.87	64.6																				
Contribution From Future Phase																											
						1.73	130.0										1.73	1.73									
	PLUG	153A	0.00	0	0.0	1.73	130.0	4.00	2.11								0.00	1.73	0.484	2.59	15.5	200	200	0.40	20.74	0.12	0.66
To chemin Meynell Road, Pipe 153A - 155A																											
						1.73	130.0																				
croissant Pelham Crescent																											
	12A	13A	0.36	7	23.8	0.36	23.8	4.00	0.39								0.36	0.36	0.101	0.49	38.0	200	200	0.65	26.44	0.02	0.84
	13A	155A	0.65	16	54.4	1.01	78.2	4.00	1.27								0.65	1.01	0.283	1.55	105.0	200	200	0.40	20.74	0.07	0.66
To chemin Meynell Road, Pipe 155A - 156A																											
						1.01	78.2																				
	1500A	15A	0.11	1	3.4	0.11	3.4	4.00	0.06								0.11	0.11	0.031	0.09	10.0	200	200	0.65	26.44	0.00	0.84
	15A	16A	0.27	6	20.4	0.38	23.8	4.00	0.39								0.27	0.38	0.106	0.50	37.0	200	200	0.65	26.44	0.02	0.84
	16A	156A	0.73	19	64.6	1.11	88.4	4.00	1.43								0.73	1.11	0.311	1.74	112.0	200	200	0.40	20.74	0.08	0.66
To chemin Meynell Road, Pipe 156A - 157A																											
						1.11	88.4																				
Contribution From Future Phase																											
						2.25	162.0										2.25	2.25									
	PLUG	156A	0.00	0	0.0	2.25	162.0	4.00	2.63								0.00	2.25	0.630	3.26	14.5	200	200	0.40	20.74	0.16	0.66
To chemin Meynell Road, Pipe 156A - 157A																											
						2.25	162.0																				

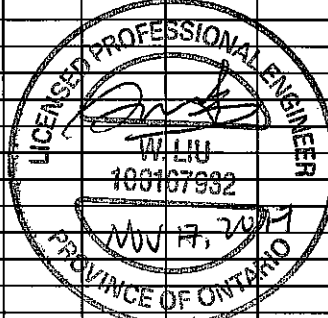

DESIGN PARAMETERS

Average Daily Flow = 350 l/p/day
 Commercial/Institution Flow = 50000 L/ha/da
 Industrial Flow = 35000 L/ha/da
 Max Res. Peak Factor = 4.00
 Commercial/Institution/Park Peak Factor = 1.50
 Park Average Flow = 9300 L/ha/da

Industrial Peak Factor = as per MOE Graph
 Extraneous Flow = 0.280 L/s/ha
 Minimum Velocity = 0.60 m/s
 Manning's n = 0.013
 Townhouse coeff= 2.7
 Single house coeff= 3.4

Designed: K.M.
 Checked: W.L.
 Dwg. Reference: Sanitary Drainage Plan, Dwg. No. 39 - 40

PROJECT: **Caivan Coomunities - Richmond Phase 1**
 LOCATION: **City of Ottawa**
 File Ref: 15-783
 Date: November, 2017
 Sheet No. 1 of 2

SUMMATION OF PROJECTED POPULATIONS FROM THE DEVELOPMENT AREAS NORTH OF PERTH STREET CONSIDERED IN THE FOX RUN PHASE 1 DESIGN:
TO MH150A = 1897 persons

Projected Total flow of 41.93 L/s in the original Fox Run Phase 1 design sheet.


Projected Total flow from the Phase 2 (North) and Green Lands West design sheet (including external areas) = 35.67L/s < 41.93 L/s therefore OK for downstream capacities.



SANITARY SEWER CALCULATION SHEET

Manning's n=0.013

LOCATION			RESIDENTIAL AREA AND POPULATION						COMM		INSTT		PARK		C+H		INFILTRATION			PIPE								
STREET	FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE		PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA Nominal (mm)	DIA Actual (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL. (FULL) (m/s)	
						AREA (ha)	POP.																					
croissant Reynard Crescent																												
	17A	18A	0.20	2	6.8	0.20	6.8	4.00	0.11								0.20	0.20	0.056	0.17	11.0	200	200	2.00	46.38	0.00	1.48	
	18A	19A	0.28	4	13.6	0.48	20.4	4.00	0.33								0.28	0.48	0.134	0.46	61.0	200	200	0.50	23.19	0.02	0.74	
	19A	20A	0.09	1	3.4	0.57	23.8	4.00	0.39								0.09	0.57	0.160	0.55	17.0	200	200	0.40	20.74	0.03	0.66	
	20A	160A	0.77	9	30.6	1.34	54.4	4.00	0.88								0.77	1.34	0.375	1.26	114.0	200	200	0.40	20.74	0.06	0.66	
To cour Noriker Court, Pipe 160A - 161A																												
	17A	159A	0.84	13	44.2	0.84	44.2	4.00	0.72								0.84	0.84	0.235	0.96	113.5	200	200	0.65	26.44	0.04	0.84	
To cour Noriker Court, Pipe 159A - 160A																												
chemin Meynell Road																												
Contribution From External																												
	150A	151A	0.45	7	23.8	31.61	1897.0			1.12		2.75		1.13			36.61	36.61										
	151A	152A	0.51	11	37.4	32.06	1920.8	3.60	28.01		1.12	2.75		1.13	3.54		0.45	37.06	10.377	41.93	73.5	450	450	0.13	102.80	0.41	0.65	
Contribution From croissant Cantle Crescent, Pipe 9A - 152A																												
Contribution From croissant Hackamore Crescent, Pipe 8A - 152A																												
	152A	153A	0.13	0	0.0	0.34	13.6										0.34	37.91										
Contribution From Future Street, Pipe Plug - 153A																												
Contribution From croissant Cantle Crescent, Pipe 11A - 153A																												
	153A	155A	0.14	0	0.0	3.55	276.0										0.87	44.19										
Contribution From Block 236 (Park)																												
Contribution From croissant Pelham Crescent, Pipe 13A - 155A																												
	155A	156A	0.14	0	0.0	1.73	130.0										0.87	44.19										
Contribution From Future Street, Pipe Plug - 156A																												
Contribution From croissant Pelham Crescent, Pipe 16A - 156A																												
	156A	157A	0.63	12	40.8	1.01	78.2						0.96	0.96	0.16		0.96	0.96	0.269	0.43	13.0	200	200	1.00	32.80	0.01	1.04	
	157A	158A	0.68	15	51.0	40.48	2520.6	3.51	35.84		1.12	2.75		2.09	3.70		0.14	46.44	13.003	54.04	71.0	450	450	0.13	102.80	0.53	0.65	
Contribution From Future Street, Pipe Plug - 156A																												
Contribution From croissant Pelham Crescent, Pipe 16A - 156A																												
	156A	157A	0.63	12	40.8	1.11	88.4										1.11	49.80										
	157A	158A	0.68	15	51.0	44.47	2811.8	3.47	39.52		1.12	2.75		2.09	3.70		0.63	50.43	14.120	58.84	102.5	450	450	0.13	102.80	0.57	0.65	
To cour Noriker Court, Pipe 158A - 159A																												
To cour Noriker Court, Pipe 158A - 159A																												
cour Noriker Court																												
Contribution From Future Phase																												
	PLUG	158A	0.00	0	0.0	4.42	330.0	4.00	5.35								4.42	4.42										
Contribution From cour Noriker Court, Pipe 158A - 159A																												
	158A	159A	0.34	4	13.6	45.15	2862.8	3.42	44.42		1.12	2.75		2.09	3.70		51.11	55.53										
Contribution From croissant Reynard Crescent, Pipe 17A - 159A																												
	159A	160A	0.37	5	17.0	49.91	3206.4	3.42	44.42		1.12	2.75		2.09	3.70		0.84	56.71	15.644	65.26	79.5	450	450	0.13	102.80	0.63	0.65	
Contribution From croissant Reynard Crescent, Pipe 20A - 160A																												
	160A	161A	0.36	4	13.6	0.84	44.2										0.84	56.71										
To Block 222 (SWM Pond), Pipe 161A - 121A																												
Block 222 (SWM Pond)																												
Contribution From External																												
	PLUG	161A	0.00	0	0.0	51.61	3097.0	3.43	43.03			2.65		4.10			58.36	58.36										
Contribution From cour Noriker Court, Pipe 160A - 161A																												
	161A	121A	0.00	0	0.0	52.82	3335.6	3.14	81.82		1.12	2.75		2.09	6.66		58.78	117.14										
To Sanitary Trunk, Pipe 121A - 123A																												
						104.43	6432.6				1.12	5.40		6.19	6.66		0.00	117.14	32.799	122.78	42.0	600	600	0.12	212.70	0.58	0.75	

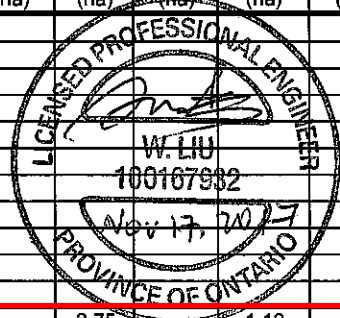

DESIGN PARAMETERS										Designed: K.M.					PROJECT: Caivan Coomunities - Richmond Phase 1												
Average Daily Flow = 350 l/day										Checked:					LOCATION: City of Ottawa												
Commercial/Institution Flow = 50000 L/ha/da															File Ref: 15-783												
Industrial Flow =															Date: November, 2017												
Max Res. Peak Factor =															Sheet No. 2 of 2												
Commercial/Institution/Park Pe																											
Park Average Flow =																											

SUMMATION OF PROJECTED POPULATIONS FROM THE AREAS SOUTH OF FOX RUN PHASE 1 DESIGN (i.e. Mattamy Lands and the Laffin Lands (RVDC):
TO MH161A

Projected Total flow of 62.33 L/s in the Phase 1 design sheet.

Projected Total flow from the Mattamy Lands and Laffin Lands design sheet = 59.10L/s < 62.33 L/s therefore OK for downstream capacities

APPENDIX E

STORM SEWER CALCULATION SHEET (RATIONAL METHOD)

Local Roads Return Frequency = 2 years
 Collector Roads Return Frequency = 5 years
 Arterial Roads Return Frequency = 10 years



Manning 0.013

LOCATION		AREA (Ha)																FLOW					SEWER DATA											
		2 YEAR				5 YEAR				10 YEAR				100 YEAR				Time of	Intensity	Intensity	Intensity	Intensity	Peak Flow	DIA. (mm)	DIA. (mm)	TYPE	SLOPE	LENGTH	CAPACITY	VELOCITY	TIME OF	RATIO		
Location	From Node	To Node	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	Conc. (min)	2 Year (mm/h)	5 Year (mm/h)	10 Year (mm/h)	100 Year (mm/h)	Q (l/s)	(actual)	(nominal)	(%)	(m)	(l/s)	(m/s)	LOW (min)	Q/Q full		
STREET 'L'																																		
	411	412	0.49	0.70	0.95	0.95			0.00	0.00			0.00	0.00			0.00	0.00	10.00	76.81	104.19	122.14	178.56	73	450	450	CONC	0.20	78.0	127.50	0.80	1.62	0.57	
	412	413	0.43	0.70	0.84	1.79			0.00	0.00			0.00	0.00			0.00	0.00	11.62	71.09	96.34	112.90	164.98	127	525	525	CONC	0.20	78.0	192.33	0.89	1.46	0.66	
		To STREET 'Q', Pipe 413 - 414							0.00	0.00			0.00	0.00			0.00	0.00	13.08															
COMMERCIAL BLOCK																																		
	1001	4061			0.00	0.00			0.00	0.00			0.00	0.00			0.00	0.00	10.00	76.81	104.19	122.14	178.56	0	450	450	CONC	0.20	29.5	127.50	0.80	0.61	0.00	
		To STREET 'P', Pipe 4061 - 407							0.00	0.00			0.00	0.00			0.00	0.00	10.61															
STREET 'Q'																																		
	416	417	0.44	0.70	0.86	0.86			0.00	0.00			0.00	0.00			0.00	0.00	10.00	76.81	104.19	122.14	178.56	66	375	375	PVC	0.30	63.0	96.03	0.87	1.21	0.68	
	417	418	0.37	0.70	0.72	1.58			0.00	0.00			0.00	0.00			0.00	0.00	11.21	72.46	98.22	115.11	168.23	114	450	450	CONC	0.30	63.0	156.16	0.98	1.07	0.73	
		To STREET 'J', Pipe 418 - 263							0.00	0.00			0.00	0.00			0.00	0.00	12.28															
		Contribution From STREET 'O', Pipe 402 - 405							0.00	0.00			0.00	0.00			0.00	0.00	13.53															
		Contribution From STREET 'O', Pipe 404 - 405							0.00	0.00			0.00	0.00			0.00	0.00	13.10															
	405	410	0.09	0.70	0.18	4.32			0.00	0.00			0.00	0.00			0.00	0.00	13.53	65.46	88.62	103.81	151.63	283	675	675	CONC	0.20	60.5	375.92	1.05	0.96	0.75	
		Contribution From STREET 'I', Pipe 407 - 410							0.00	0.00			0.00	0.00			0.00	0.00	13.49															
		Contribution From STREET 'M', Pipe 409 - 410							0.00	0.00			0.00	0.00			0.00	0.00	13.08															
	410	413	0.22	0.70	0.43	8.52			0.00	0.00			0.00	0.00			0.00	0.00	14.49	62.99	85.23	99.82	145.79	537	825	825	CONC	0.25	60.5	717.72	1.34	0.75	0.75	
		Contribution From STREET 'L', Pipe 412 - 413							0.00	0.00			0.00	0.00			0.00	0.00	13.08															
	413	414	0.18	0.70	0.35	10.66			0.00	0.00			0.00	0.00			0.00	0.00	15.24	61.20	82.78	96.94	141.55	653	825	825	CONC	0.35	52.0	849.22	1.59	0.55	0.77	
	414	415	0.15	0.70	0.29	10.96			0.00	0.00			0.00	0.00			0.00	0.00	15.79	59.97	81.09	94.95	138.64	657	825	825	CONC	0.35	12.5	849.22	1.59	0.13	0.77	
	415	418	0.11	0.70	0.21	11.17			0.00	0.00			0.00	0.00			0.00	0.00	15.92	59.68	80.70	94.49	137.96	667	825	825	CONC	0.35	20.0	849.22	1.59	0.21	0.78	
		To STREET 'J', Pipe 418 - 263							0.00	0.00			0.00	0.00			0.00	0.00	16.13															
STREET 'J'																																		
		Contribution From STREET 'Q', Pipe 415 - 418							0.00	0.00			0.00	0.00			0.00	0.00	16.13															
		Contribution From STREET 'Q', Pipe 417 - 418							0.00	0.00			0.00	0.00			0.00	0.00	12.28															
	418	263	0.04	0.70	0.08	12.82			0.00	0.00			0.00	0.00			0.00	0.00	16.13	59.22	80.08	93.76	136.89	767	1050	1050	CONC	0.25	71.0	1365.36	1.58	0.75	0.56	
		To OLDENBURG AVENUE, Pipe 263 - 264							0.00	0.00			0.00	0.00			0.00	0.00	16.88															
STREET 'P'																																		
	421	422	0.36	0.70	0.70	0.70			0.00	0.00			0.00	0.00			0.00	0.00	10.00	76.81	104.19	122.14	178.56	54	450	450	CONC	0.20	96.0	127.50	0.80	2.00	0.42	
		To STREET 'H', Pipe 422 - 423							0.00	0.00			0.00	0.00			0.00	0.00	12.00															
STREET 'M'																																		
	408	409	0.50	0.70	0.97	0.97			0.00	0.00			0.00	0.00			0.00	0.00	10.00	76.81	104.19	122.14	178.56	75	450	450	CONC	0.20	78.0	127.50	0.80	1.62	0.59	
	409	410	0.43	0.70	0.84	1.81			0.00	0.00			0.00	0.00			0.00	0.00	11.62	71.09	96.34	112.90	164.98	129	525	525	CONC	0.20	78.0	192.33	0.89	1.46	0.67	
		To STREET 'Q', Pipe 410 - 413							0.00	0.00			0.00	0.00			0.00	0.00	13.08															
STREET 'I'																																		
	406	4061	0.22	0.70	0.43	0.43			0.00	0.00			0.00	0.00			0.00	0.00	10.00	76.81	104.19	122.14	178.56	33	300	300	PVC	0.35	31.0	57.21	0.81	0.64	0.57	
		Contribution From COMMERCIAL BLOCK, Pipe 1001 - 4061							0.00	0.00			0.00	0.00			0.00	0.00	10.61															
	4061	407	0.35	0.70	0.68	1.11			0.00	0.00			0.00	0.00			0.00	0.00	10.64	74.44	100.94	118.31	172.93	83	450	450	CONC	0.20	57.5	127.50	0.80	1.20	0.65	
	407	410	0.44	0.70	0.86	1.97			0.00	0.00			0.00	0.00			0.00	0.00	11.83	70.41	95.41	111.80	163.37	138	525	525	CONC	0.20	88.5	192.33	0.89	1.66	0.72	
		To STREET 'Q', Pipe 410 - 413							0.00	0.00			0.00	0.00			0.00	0.00	13.49															
STREET 'H'																																		
		Contribution From STREET 'O', Pipe 431 - 420							0.00	0.00			0.00	0.00			0.00	0.00	12.06															
	420	422	0.09	0.70	0.18	1.36			0.00	0.00			0.00	0.00			0.00	0.00	12.06	69.71	94.45	110.67	161.71	95	450	450	CONC	0.20	60.5	127.50	0.80	1.26	0.74	
		Contribution From STREET 'P', Pipe 421 - 422							0.00	0.00			0.00	0.00			0.00	0.00	12.00															
	422	423	0.09	0.70	0.18	2.24			0.00	0.00			0.00	0.00			0.00	0.00	13.32	66.05	89.42	104.75	153.03	148	525	525	CONC	0.20	60.5	192.33	0.89	1.13	0.77	
	423	424	0.09	0.70	0.18	2.41			0.00	0.00			0.00	0.00			0.00	0.00	14.45	63.09	85.37	99.99	146.03	152	525	525	CONC	0.20	60.5	192.33	0.89	1.13	0.79	
			0.05	0.70	0.10	2.51			0.00	0.00			0.00	0.00			0.00	0.00	14.45	63.09	85.37	99.99	146.03	152	525	525	CONC	0.20	60.5	192.33	0.89	1.13	0.79	
	424	307			0.00	2.51	1.08	0.40	1.20	1.20			0.00	0.00			0.00	0.00	15.59	60.42	81.71	95.68	139.71	250	675	675	CONC	0.15	72.0	325.56	0.91	1.32	0.77	
		To OLDENBURG AVENUE, Pipe 307 - 308							1.20	1.20			0.00	0.00			0.00	0.00	16.90															

Definitions:
 Q = 2.78 AIR, where
 Q = Peak Flow in Litres per second (L/s)
 A = Areas in hectares (ha)
 I = Rainfall Intensity (mm/h)
 R = Runoff Coefficient

Notes:
 1) Ottawa Rainfall-Intensity Curve

STORM SEWER CALCULATION SHEET (RATIONAL METHOD)

Local Roads Return Frequency = 2 years
 Collector Roads Return Frequency = 5 years
 Arterial Roads Return Frequency = 10 years

Manning 0.013



Projected storm flows as compared to the Fox Run Phase 2 (North) design sheet flow of 2,201 L/s

Location	LOCATION From Node To Node		AREA (Ha)																FLOW					SEWER DATA											
			2 YEAR				5 YEAR				10 YEAR				100 YEAR				Time of Conc.	Intensity 2 Year	Intensity 5 Year	Intensity 10 Year	Intensity 100 Year	Peak Flow Q (l/s)	DIA. (mm) (actual)	DIA. (mm) (nominal)	TYPE	SLOPE (%)	LENGTH (m)	CAPACITY (l/s)	VELOCITY (m/s)	TIME OF LOW (min)	RATIO Q/Q full		
			AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	(min)	(mm/h)	(mm/h)	(mm/h)	(mm/h)												
Contribution From STREET 'J', Pipe 418 - 263			0.34	0.67	0.63	29.99			0.00	5.43			0.00	0.00			0.00	0.00	16.88																
	EX 263	EX 264			0.00	29.99	0.12	0.71	0.24	5.67			0.00	0.00			0.00	0.00	21.11	50.32	67.91	79.46	115.92	1911	1500	1500	CONC	0.15	75.0	2737.76	1.55	0.81	0.70		
	EX 264	EX 265	0.21	0.54	0.32	30.31			0.00	6.31			0.00	0.00			0.00	0.00	21.91	49.14	66.31	77.59	113.17	1941	1500	1500	CONC	0.15	75.0	2737.76	1.55	0.81	0.71		
	EX 265	EX 266	2.76	0.69	5.29	35.60	0.11	0.75	0.23	7.04			0.00	0.00			0.00	0.00	22.72	48.03	64.80	75.80	110.56	2181	1500	1500	CONC	0.20	75.0	3161.29	1.79	0.70	0.69		
To PERTH STREET, Pipe 266 - 267TEE						35.60				7.27				0.00			0.00	0.00	23.42																
PERTH STREET																																			
	DICB	2802			0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	10.00	76.81	104.19	122.14	178.56	2430	1050	1050	CONC	0.90	11.5	2590.59	2.99	0.06	0.94		
	2802	EX 280			0.00	0.00	1.88	0.80	4.18	4.18	0.67	0.85	1.58	1.58			0.00	0.00	10.06	76.56	103.86	121.74	177.98	3932	1650	1650	CONC	0.15	68.5	3530.01	1.65	0.69	1.11		
	EX 280	EX 266	0.07	0.54	0.11	0.11			0.00	4.18	0.10	0.85	0.24	1.82			0.00	0.00	10.76	74.02	100.36	117.63	171.93	3946	1650	1650	CONC	0.15	44.5	3530.01	1.65	0.45	1.12		
Contribution From OLDENBURG AVENUE, Pipe 265 - 266						35.60				7.27				0.00			0.00	0.00	23.42																
	EX 266	EX 267TEE			0.00	35.70			0.00	11.45	0.23	0.85	0.54	2.36			0.00	0.00	23.42	47.11	63.54	74.33	108.40	5890	2100	2100	CONC	0.15	70.5	6715.38	1.94	0.61	0.88		
To STM OUTLET, Pipe 267TEE - 26701						35.70				11.45				2.36				0.00	24.02																
STM OUTLET																																			
Contribution From PERTH STREET, Pipe 266 - 267TEE						35.70				11.45				2.36				0.00	24.02																
	EX 267TEE	EX 26701			0.00	35.70			0.00	11.45			0.00	2.36			0.00	0.00	24.02	46.34	62.50	73.11	106.60	5848	2100	2100	CONC	0.15	19.0	6715.38	1.94	0.16	0.87		
	26701	EX HW			0.00	35.70			0.00	11.45			0.00	2.36			0.00	0.00	24.19	46.14	62.22	72.78	106.13	5837	2100	2100	CONC	0.15	18.0	6715.38	1.94	0.15	0.87		
STREET 'G'																																			
	505	506 (OGS)	0.13	0.65	0.23	0.23			0.00	0.00			0.00	0.00			0.00	0.00	10.00	76.81	104.19	122.14	178.56	18	300	300	PVC	0.35	16.0	57.21	0.81	0.33	0.32		
To BLOCK 28, Pipe 506 (OGS) - 2804						0.23				0.00				0.00				0.00	10.33																
	501	502	0.13	0.54	0.20	0.20			0.00	0.00			0.00	0.00			0.00	0.00	10.00	76.81	104.19	122.14	178.56	34	300	300	PVC	0.35	19.5	57.21	0.81	0.40	0.60		
	502	503	0.18	0.54	0.27	0.72			0.00	0.00			0.00	0.00			0.00	0.00	10.40	75.30	102.12	119.70	174.97	113	525	525	CONC	0.20	110.0	192.33	0.89	2.06	0.59		
	503	504	0.43	0.65	0.78	1.50			0.00	0.00			0.00	0.00			0.00	0.00	12.47	68.48	92.76	108.67	158.78	187	600	600	CONC	0.20	106.5	274.59	0.97	1.83	0.68		
	504	506 (OGS)	0.23	0.54	0.35	1.84			0.00	0.00			0.00	0.00			0.00	0.00	14.29	63.49	85.91	100.62	146.96	229	675	675	CONC	0.20	113.5	375.92	1.05	1.80	0.61		
To BLOCK 28, Pipe 506 - 2804						3.61				0.00				0.00				0.00	16.09																
BLOCK 28																																			
Contribution From STREET 'G', Pipe 504 - 506 (OGS)						3.61				0.00				0.00				0.00	16.09																
Contribution From STREET 'G', Pipe 505 - 506 (OGS)						0.23				0.00				0.00				0.00	10.33																
	506 (OGS)	HW			0.00	3.85			0.00	0.00			0.00	0.00			0.00	0.00	16.09	59.30	80.18	93.88	137.07	228	675	675	CONC	0.20	45.0	375.92	1.05	0.71	0.61		
MIRA COURT																																			
	508	23A			0.00	0.00	0.22	0.65	0.40	0.40			0.00	0.00			0.00	0.00	10.00	76.81	104.19	122.14	178.56	41	300	300	PVC	0.35	77.0	57.21	0.81	1.59	0.72		

Definitions:
 Q = 2.78 AIR, where
 Q = Peak Flow in Litres per second (L/s)
 A = Areas in hectares (ha)
 I = Rainfall Intensity (mm/h)
 R = Runoff Coefficient

Notes:
 1) Ottawa Rainfall-Intensity Curve
 2) Min. Velocity = 0.80 m/s

Designed:	SLM	PROJECT:	Richmond Green Lands East and West		
Checked:	ADF	LOCATION:	City of Ottawa		
Dwg. Reference:	3A	File Ref:	20-1183	Date:	26 Feb 2021
				Sheet No.	SHEET 3 OF 3


STORM SEWER CALCULATION SHEET (RATIONAL METHOD)



Local Roads Return Frequency = 2 years
 Collector Roads Return Frequency = 5 years
 Arterial Roads Return Frequency = 10 years

Manning 0.013

Location	LOCATION From Node To Node		AREA (Ha)																FLOW						SEWER DATA													
			2 YEAR				5 YEAR				10 YEAR				100 YEAR				Time of	Intensity	Intensity	Intensity	Intensity	Peak Flow	DIA. (mm)	DIA. (mm)	TYPE	SLOPE (%)	LENGTH (m)	CAPACITY (l/s)	VELOCITY (m/s)	TIME OF (min)	RATIO (Q/Q full)					
			AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	Conc. (min)	2 Year (mm/h)	5 Year (mm/h)	10 Year (mm/h)	100 Year (mm/h)	Q (l/s)	(actual)	(nominal)												
BRUSH LANE																																						
	258	261	0.33	0.75	0.69	0.69																																
To BASCULE PLACE, Pipe 261 - 265						0.69											0.00	0.00	10.00	76.81	104.19	122.14	178.56	53	300	300	PVC	0.40	66.0	61	0.87	1.27	0.86					
CHASING GROVE																																						
			0.03	0.75	0.06	0.06																																
	251	256	0.25	0.72	0.50	0.56											0.00	0.00	10.00	76.81	104.19	122.14	178.56	86	457	450	CONC	0.20	149.5	133	0.81	3.08	0.65					
To BASCULE PLACE, Pipe 256 - 261						1.13											0.00	0.00	13.08																			
TRAMMEL ROAD																																						
	250	252	0.12	0.54	0.18	0.18											0.00	0.00	10.00	76.81	104.19	122.14	178.56	34	300	300	PVC	0.35	51.5	57	0.81	1.06	0.59					
To LATIGO RIDGE, Pipe 252 - 254						0.44											0.00	0.00	11.06																			
	251	252	0.19	0.72	0.38	0.38											0.00	0.00	10.00	76.81	104.19	122.14	178.56	53	300	300	PVC	0.45	65.0	65	0.92	1.18	0.82					
To LATIGO RIDGE, Pipe 252 - 254						0.70											0.00	0.00	11.18																			
			0.03	0.75	0.06	0.06											0.00	0.00																				
			0.13	0.54	0.20	0.26											0.00	0.00																				
			0.07	0.75	0.15	0.40											0.00	0.00																				
	251	263	0.14	0.72	0.28	0.68											0.00	0.00	10.00	76.81	104.19	122.14	178.56	53	300	300	PVC	0.40	68.0	61	0.87	1.31	0.86					
To OLDENBURG AVENUE, Pipe 263 - 264						0.68											0.00	0.00	11.31																			
LATIGO RIDGE																																						
Contribution From TRAMMEL ROAD, Pipe 250 - 252						0.44											0.00	0.00	11.06																			
Contribution From TRAMMEL ROAD, Pipe 251 - 252						0.70											0.00	0.00	11.18																			
	252	254	0.14	0.54	0.21	1.35											0.00	0.00	11.18	72.55	98.35	115.25	163.44	172.74	610	600	CONC	0.15	149.5	249	0.85	2.93	0.69					
To BASCULE PLACE, Pipe 254 - 256						2.37											0.00	0.00	14.11																			
GRISEO WAY																																						
	259	257	0.18	0.75	0.38	0.38											0.00	0.00	10.00	76.81	104.19	122.14	178.56	45	300	300	PVC	0.50	35.0	68	0.97	0.60	0.66					
To BASCULE PLACE, Pipe 257 - 256						0.58											0.00	0.00	10.60																			
BASCULE PLACE																																						
			0.06	0.72	0.12	0.12											0.00	0.00																				
			0.15	0.54	0.23	0.35											0.00	0.00																				
	254	273	0.16	0.75	0.33	0.68											0.00	0.00	10.00	76.81	104.19	122.14	178.56	52	300	300	PVC	0.45	61.0	65	0.92	1.11	0.80					
To VAULTING CRESCENT, Pipe 273 - 275						0.68											0.00	0.00	11.11																			
Contribution From LATIGO RIDGE, Pipe 252 - 254						2.37											0.00	0.00	14.11																			
	254	257	0.16	0.54	0.24	0.24											0.00	0.00	14.11	63.95	86.55	101.37	148.05	172	610	600	CONC	0.15	35.5	249	0.85	0.70	0.69					
Contribution From GRISEO WAY, Pipe 259 - 257						0.58											0.00	0.00	10.60																			
	257	256	0.00	0.72	0.00	0.00											0.00	0.00	14.81	62.23	84.19	98.59	143.98	204	610	600	CONC	0.15	30.0	249	0.85	0.59	0.82					
Contribution From CHASING GROVE, Pipe 255 - 256						1.13											0.00	0.00	13.08																			
	256	261	0.11	0.75	0.23	4.63											0.00	0.00	15.39	60.85	82.30	96.38	140.73	282	686	675	CONC	0.15	33.0	340	0.92	0.60	0.83					
Contribution From BRUSH LANE, Pipe 258 - 261						0.69											0.00	0.00	11.27																			
Contribution From VAULTING CRESCENT, Pipe 260 - 261						0.40											0.00	0.00	10.72																			
	261	265	0.00	0.72	0.00	5.71										0.00	0.00	15.99	59.52	80.48	94.24	137.59	340	838	825	CONC	0.10	35.0	473	0.86	0.68	0.72						
To OLDENBURG AVENUE, Pipe 265 - 266						5.71											0.00	0.00	16.67																			

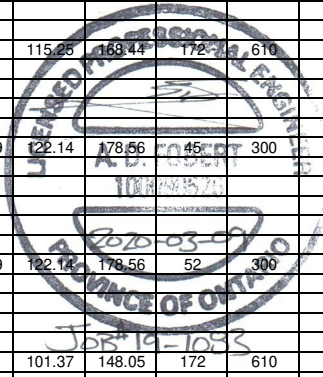

Definitions:
 Q = 2.78 AIR, where
 Q = Peak Flow in Litres per second (L/s)
 A = Areas in hectares (ha)
 I = Rainfall Intensity (mm/h)
 R = Runoff Coefficient

Notes:
 1) Ottawa Rainfall-Intensity Curve
 2) Min. Velocity = 0.80 m/s

Designed:	SLM	PROJECT:	FOX RUN SUBDIVISION PHASE 2 NORTH		
Checked:	ADF	LOCATION:	City of Ottawa		
Dwg. Reference:	Storm Drainage Plan Dwg. No. 30	File Ref:	19-1083	Date:	9-Mar-19
				Sheet No.	SHEET 1 OF 3


STORM SEWER CALCULATION SHEET (RATIONAL METHOD)



Local Roads Return Frequency = 2 years
 Collector Roads Return Frequency = 5 years
 Arterial Roads Return Frequency = 10 years

Manning 0.013

LOCATION			AREA (Ha)																FLOW					SEWER DATA											
			2 YEAR				5 YEAR				10 YEAR				100 YEAR				Time of Conc.	Intensity 2 Year	Intensity 5 Year	Intensity 10 Year	Intensity 100 Year	Peak Flow	DIA. (mm) (actual)	DIA. (mm) (nominal)	TYPE	SLOPE (%)	LENGTH (m)	CAPACITY (l/s)	VELOCITY (m/s)	TIME OF LOW (min)	RATIO Q/Q full		
Location	From Node	To Node	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	(min)	(mm/h)	(mm/h)	(mm/h)	(mm/h)	Q (l/s)											
To Pond Block, Pipe 279 - HW					12.01				0.00					2.06				0.00		21.56															
					0.00	0.00			0.00	0.00			0.00	0.00			0.00	0.00						3240	(DICB 100 Yr Intake)										
Contribution From OLDENBURG AVENUE, Pipe 265 - 266			280	266	0.13	0.54	0.20			0.00	0.00	0.80	0.85	1.89	1.89			0.00	0.00	10.00	76.81	104.19	122.14	178.56	3486	1676	1650	CONC	0.15	44.5	3680	1.67	0.44	0.95	
Contribution From OLDENBURG AVENUE, Pipe 265 - 266					0.00	43.08				3.96				0.08	0.85	0.19	2.08			0.00	0.00														
Contribution From OLDENBURG AVENUE, Pipe 265 - 266			266	267TEE		0.00	43.28			0.00	3.96	0.14	0.85	0.33	2.41			0.00	0.00	20.72	50.90	68.71	80.40	117.30	5909	2134	2100	CONC	0.15	70.5	7009	1.96	0.60	0.84	
Contribution From OLDENBURG AVENUE, Pipe 265 - 266			267TEE	26701		0.00	43.28			0.00	3.96			0.00	2.41			0.00	0.00	21.32	50.00	67.48	78.96	115.18	5861	2134	2100	CONC	0.15	19.0	7009	1.96	0.16	0.84	
To Pond Block, Pipe 267TEE - HW					43.28				3.96					2.41				0.00		21.48															
Pond Block																																			
Contribution From PERTH STREET, Pipe 278 - 279					12.01					0.00				2.06				0.00	0.00	21.56															
Contribution From PERTH STREET, Pipe 278 - 279			279	HW		0.00	12.01			0.00	0.00			0.00	2.06			0.00	0.00	21.56	49.66	67.01	78.41	114.37	758	991	975	CONC	0.20	16.5	1047	1.36	0.20	0.72	
Contribution From PERTH STREET, Pipe 266 - 267TEE					43.28					3.96				2.41				0.00	0.00	21.48															
Contribution From PERTH STREET, Pipe 266 - 267TEE			26701	HW		0.00	43.28			0.00	3.96			0.00	2.41			0.00	0.00	21.48	49.77	67.16	78.58	114.63	5849	2134	2100	CONC	0.15	18.0	7009	1.96	0.15	0.83	
Note:																																			
Contributions to MH 280 per JFSA analysis Table C-1D																																			
100-year 3-hour Chicago 2.60m3/s																																			
100-year 24-Hour SCS Type II 3.24m3/s																																			

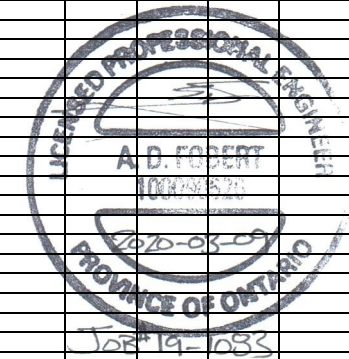

Definitions:
 Q = 2.78 AIR, where
 Q = Peak Flow in Litres per second (L/s)
 A = Areas in hectares (ha)
 I = Rainfall Intensity (mm/h)
 R = Runoff Coefficient

Notes:
 1) Ottawa Rainfall-Intensity Curve
 2) Min. Velocity = 0.80 m/s

Designed: SLM	PROJECT: FOX RUN SUBDIVISION PHASE 2 NORTH
Checked: ADF	LOCATION: City of Ottawa
Dwg. Reference: Storm Drainage Plan Dwg. No. 30	File Ref: 19-1083
	Date: 9-Mar-19
	Sheet No. SHEET 3 OF 3

ANY DISTURBED AREA DURING CONSTRUCTION TO BE RESTORED TO THE ORIGINAL CONDITION OR BETTER TO THE SATISFACTION OF THE AUTHORITIES HAVING JURISDICTION

CONTRACTOR TO VERIFY THE PRECISE LOCATIONS AND INVERT ELEVATIONS OF EX. UNDERGROUND SERVICES AND EX. UTILITIES PRIOR TO STARTING CONSTRUCTION

PERMISSION REQUIRED FOR WORK ON ADJACENT LANDS

NOTE: FOR CROSS SECTION 2-2 AND 3-3, REFER TO DRAWING No. 37

NOTE RE: TEST PIT/BOREHOLE EXCAVATIONS
ANY DISTURBED MATERIAL ENCOUNTERED BELOW THE SUBGRADE LEVEL WITHIN A BUILDING FOOTPRINT TO BE SUB-EXCAVATED AND BACKFILLED WITH COMPACTED ENGINEERED FILL AS PER GEOTECHNICAL ENGINEERS RECOMMENDATION.

NOTE
FOR WATERMAIN CROSSING BELOW AND ABOVE SEWERS, REFER TO CITY STD. W25 AND W25.2, RESPECTIVELY, WHERE APPLICABLE

NOTE
FOR WATERMAIN STUBS, 2.4m MIN. COVER TO BE PROVIDED



NOTE: ICD
FOR ICD APPLICATION, REFER TO DRAWINGS No. 6 TO 7B & 45 TO 46 FOR DETAIL.

NOTE RE: CLAY SEALS
CLAY SEALS SHALL BE CONSTRUCTED IN THE SERVICE TRENCH FOR SANITARY MAIN PIPE, WATERMAIN AND ALL TYPES OF HOUSE CONNECTIONS. CLAY SEALS SHALL NOT BE CONSTRUCTED IN THE SERVICE TRENCH FOR STORM MAIN PIPE, AS PER GEOTECHNICAL CONSULTANT'S RECOMMENDATION.

NOTE RE: WATERMAIN / WATER SERVICE
1. INSULATION REQUIRED FOR WATERMAIN / WATER SERVICE WHERE THE SEPARATION BETWEEN WATERMAIN / WATER SERVICE AND OTHER SERVICES AND STRUCTURES IS LESS THAN 1.2m AND THE COVER IS LESS THAN 2.4m. REFER TO CITY STD. W23 FOR DETAIL.
2. FOR SERVICE INSTALLATION AT SEWER CROSSING, REFER TO CITY STD. W38 FOR DETAIL.

VILLAGE OF RICHMOND SWM POND 1
REFER TO DAVID SCHAEFFER ENGINEERING LTD. PROJECT No. 15-764-BR-CITY OF OTTAWA FILE No. D07-16-11-0014

INTERIM SWM POND 1
PP ELEV 92.35
100 YR. W.L. 93.46 (SUMMER)

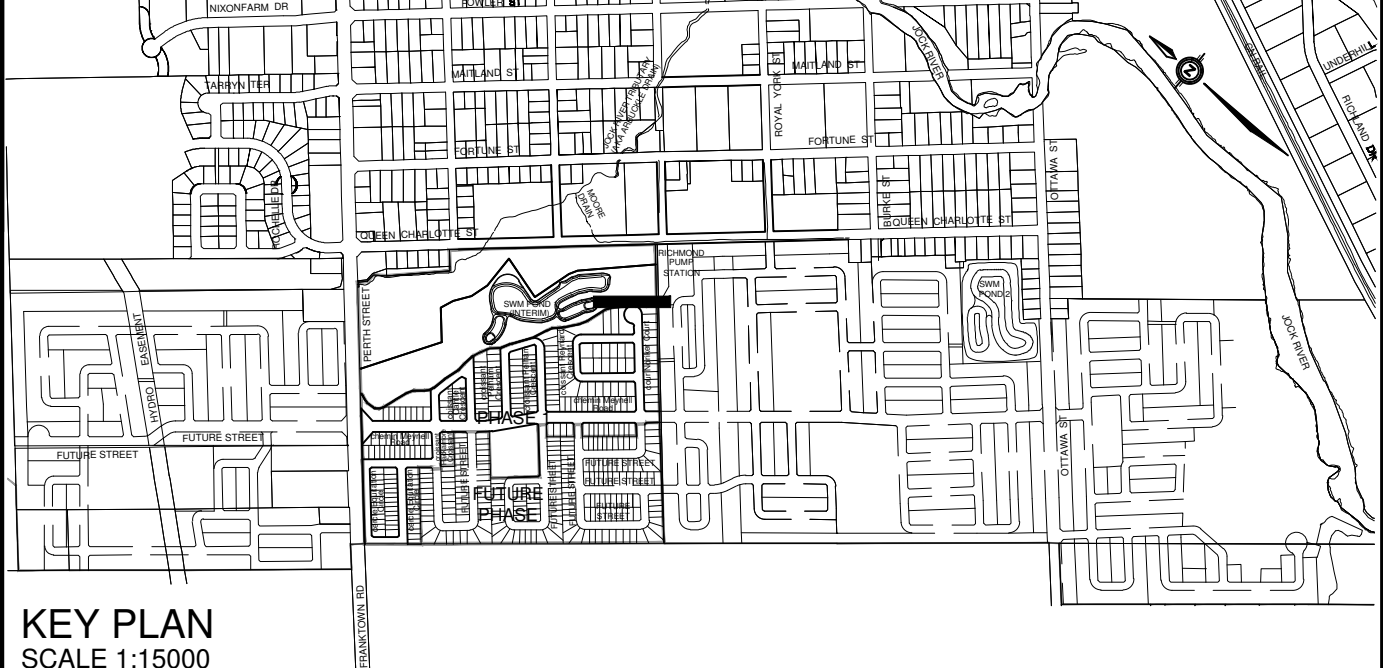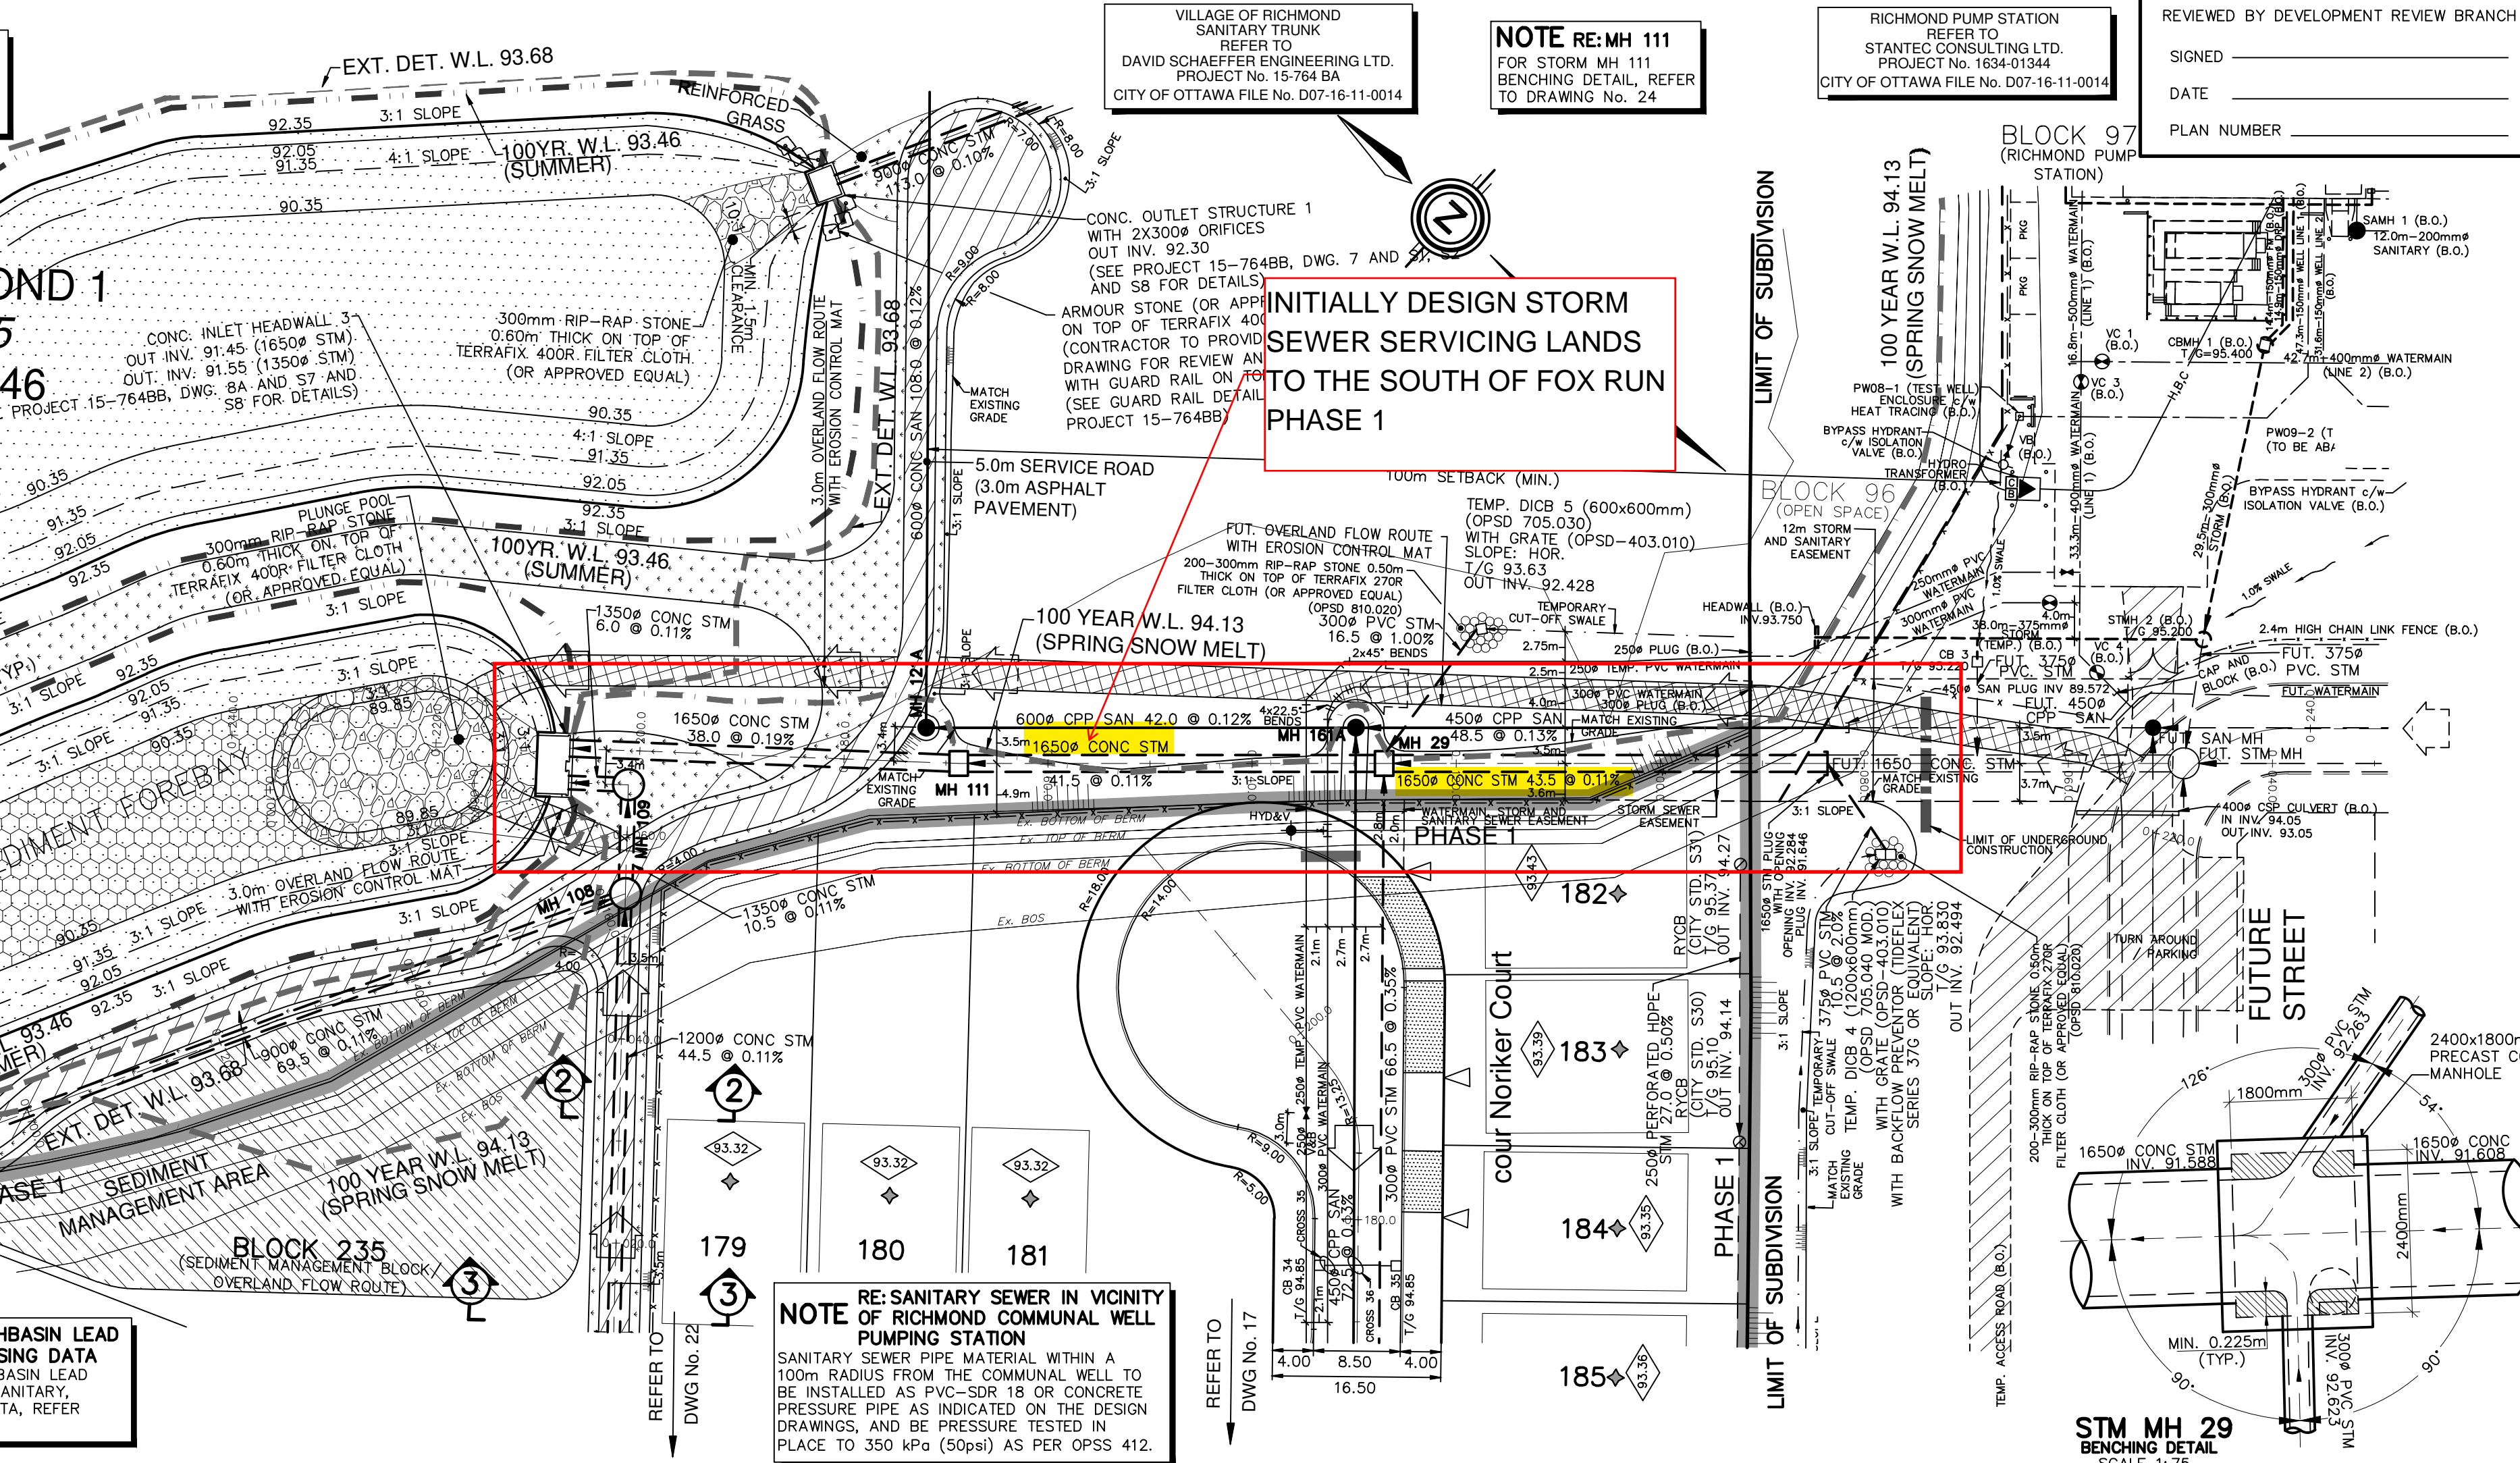

LEGEND


CROSS	45° BEND	LATERAL	HYDRANT, VALVE & VB	TEE	VALVE & VC	VALVE & VB	22.5° BEND	11.25° BEND	REDUCER	CAP	SANITARY MAINTENANCE HOLE	CAP	STREET CATCHBASIN & LEAD	STORM MAINTENANCE HOLE	CURB INLET CATCHBASIN & LEAD	CATCHBASIN / MAINTENANCE HOLE - INTERCONNECTED	CATCH BASIN & LEADS	CAP	SINGLE SERVICE LOCATION (ST, SAN & WM)	EXISTING SINGLE SERVICE LOCATION (ST, SAN & WM)	SINGL SERVICE LOCATION (ST, SAN & WM)	TEE CATCHBASIN	PERFORATED PIPE	ELBOW CATCHBASIN	CABLE PEDESTAL	BELL PEDESTAL	HYDRO TRANSFORMER	CURB & DEPRESSED CURB	ASPHALT SIDEWALK	1.8m CHAIN LINK FENCE (UNLESS OTHERWISE NOTED)	NOISE BARRIER (1.30m UNLESS OTHERWISE NOTED)	WOOD PRIVACY BARRIER	POST AND RAIL FENCE	PHASING LIMITS	PROPERTY BOUNDARY	BORHOLE (BH)	TEST PIT (TP)	AUGER HOLE (AH)	MONITORING WELL LOCATION	CONCEPTUAL WELL LOCATION	TOP OF FOUNDATION ELEVATION	FINISHED FLOOR ELEVATION	UNDERSIDE OF FOOTING ELEVATION	NUMBER OF RISERS	LOTS EQUIPPED WITH SUMP PUMP	WALKOUT UNITS	SLAB ON GRADE	UNITS REQUIRING PRESSURE REDUCING VALVES	OVERLAND FLOW DIRECTION	EXTERNAL OVERLAND FLOW DIRECTION	TACTILE WALKING SURFACE INDICATOR (AS PER CITY OF OTTAWA STD. SC6, SC7, SC7.1, SC7.2, SC7.3)	CLAY SEAL (REFER TO GENERAL NOTES - No.18, ON DWG. No. 1, AND GEOTECHNICAL CONSULTANT'S SPECIFICATIONS)	DITON AND CULVERT	CONCRETE SIDEWALK	INFERRED TOP OF BEDROCK ELEVATION PROVIDED BY GOLDER ASSOCIATES AUGUST 2013	NATURAL GAS LINE	JOINT UTILITY TRENCH (HYDRO, BELL, CABLE)
-------	----------	---------	---------------------	-----	------------	------------	------------	-------------	---------	-----	---------------------------	-----	--------------------------	------------------------	------------------------------	--	---------------------	-----	--	---	---------------------------------------	----------------	-----------------	------------------	----------------	---------------	-------------------	-----------------------	------------------	--	--	----------------------	---------------------	----------------	-------------------	--------------	---------------	-----------------	--------------------------	--------------------------	-----------------------------	--------------------------	--------------------------------	------------------	------------------------------	---------------	---------------	--	-------------------------	----------------------------------	--	---	-------------------	-------------------	---	------------------	---

TOPOGRAPHIC INFORMATION
TOPOGRAPHIC INFORMATION PROVIDED BY J.D. BARNES LIMITED, PROJECT No. 10-10-314-00. DRAWING DATED SEPTEMBER 26, 2012. CITY OF OTTAWA 1:K MAPING, RECEIVED ON MARCH 27, 2013. GIS MAP, RECEIVED ON JANUARY 20, 2009.

LEGAL INFORMATION
M-PLAN PROVIDED BY J.D. BARNES LIMITED, PROJECT No. 10-10-314-00, SURVEY DATED MAY 12, 2017

BENCH MARK No. 0011968U124 ELEVATION = 95.186 m
ELEVATIONS SHOWN ARE GEODETIC AND ARE REFERRED TO BENCHMARK No. 0011968U124 HAVING A PUBLISHED ELEVATION OF 95.186m. LOCATION: BRIDGE OVER JOCK RIVER IN RICHMOND, 0.8 KM SOUTH OF RICHMOND ROAD, BARRIS CAP IN TOP OF EAST WALL, 2.7M FROM NORTH END.

No.	DATE	BY	DESCRIPTION
7	18-06-13	W.L.	MYLARS FOR STORM SEWER COMMENCE WORK
6	18-03-23	W.L.	COMMUNAL WELL SITE INFORMATION UPDATED
5	18-01-25	W.L.	ISSUED FOR FINAL APPROVAL
4	17-11-17	W.L./Z.L.	4th SUBMISSION
3	17-10-13	W.L.	3rd SUBMISSION
2	17-05-19	W.L./Z.L.	2nd SUBMISSION
1	16-12-23	W.L./Z.L.	1st SUBMISSION

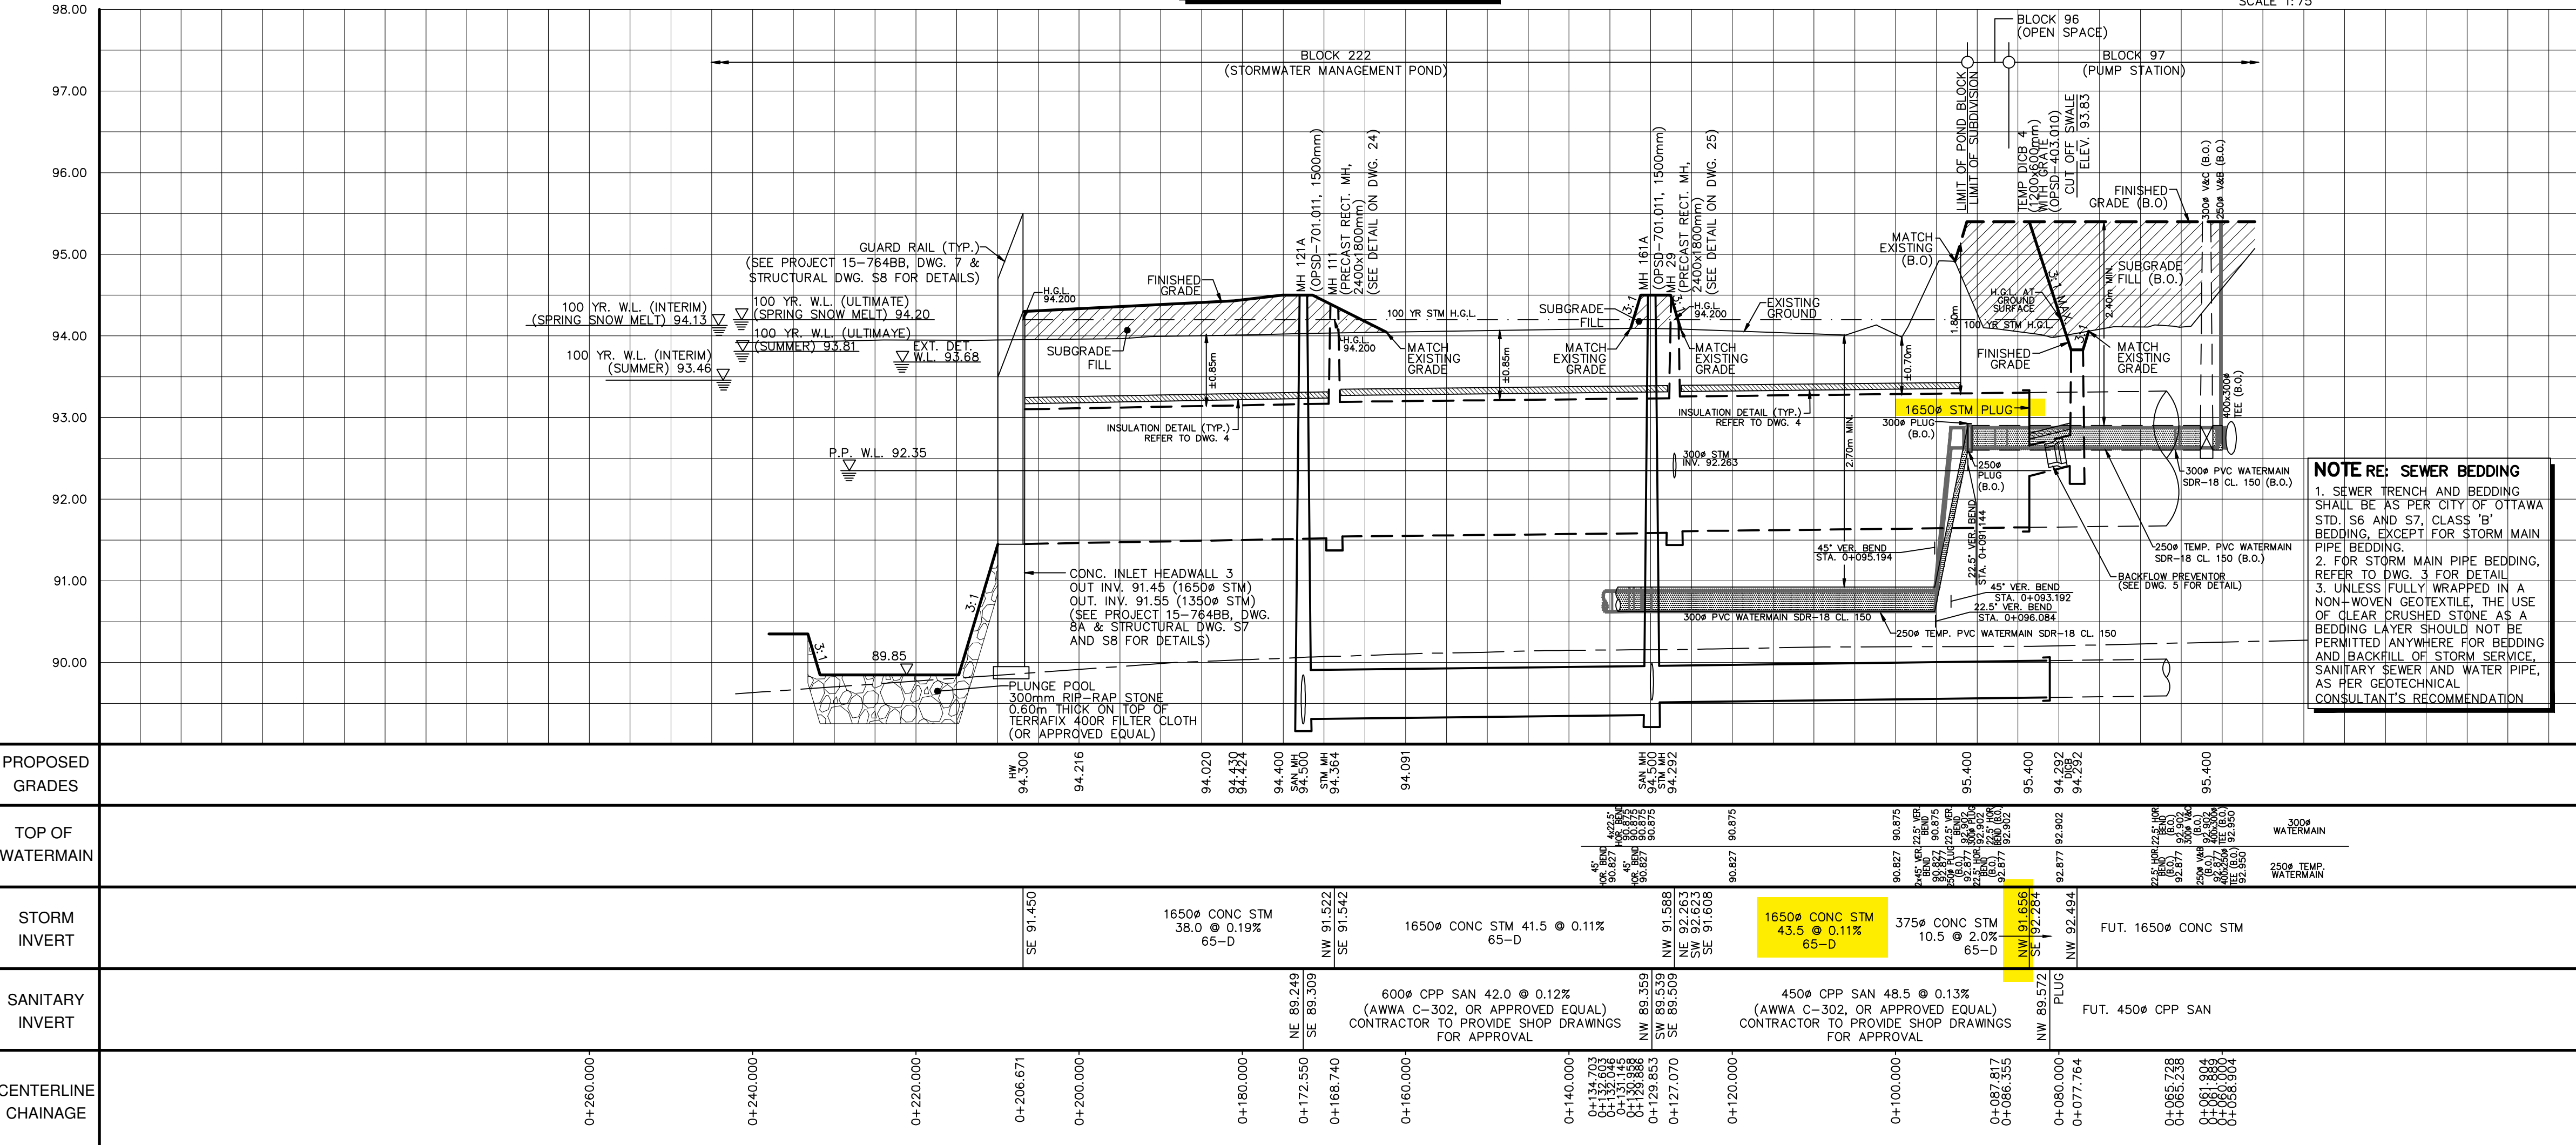

Ottawa CITY OF OTTAWA

PROJECT No. 15-783

W. LIU 100167932
13-06-15
PROVINCE OF ONTARIO

PLAN AND PROFILE OF
POND INLET 3 - STORM TRUNK 2
(STA. 0+060.000 TO STA. 0+260.000) © DSEL

RICHMOND VILLAGE DEVELOPMENT CORPORATION	CAIVAN COMMUNITIES RICHMOND PHASE 1
DSEL david schaeffer engineering ltd	120 Ibor Road, Unit 203 Suttonville, ON K2S 1E9 Tel: (613) 836-0866 Fax: (613) 836-7183 www.DSEL.ca
DRAWN BY: A.B. DESIGNED BY: W.L./P.P.	CHECKED BY: W.L./C.M. CHECKED BY: K.M.
DRAWING NO.	SHEET NO.
SCALE: H=1:500/V=1:50	DATE: DECEMBER 2016
	25

CITY PLAN No. D07-16-11-0014

August 12, 2020
David Schaeffer Engineering Limited
120 Iber Road, Unit 103
Ottawa, Ontario
K2S 1E9

Project Number: P922

Attention: Mr. Adam Fobert, P.Eng.

Subject: Richmond Village Development / Proposed Realignment of the Van Gaal Drain Adjacent to the Green Lands

As requested by your office, we have evaluated the channel dimensions required to contain the 100-year design water levels within the proposed realignment of the Van Gaal Drain adjacent to the Green Lands based on the information provided. This assessment builds on the *Richmond Village Development / Proposed Realignment of the Van Gaal Drain* by JFSA (April 20, 2017). The requested changes to the HEC-RAS models were to adjust cross sections 2478 – 2258 along the Van Gaal Drain Reach 2 as labelled in Figure 1. This section of the channel is immediately downstream of the realignment proposed in the April 2017 *Realignment* memo.

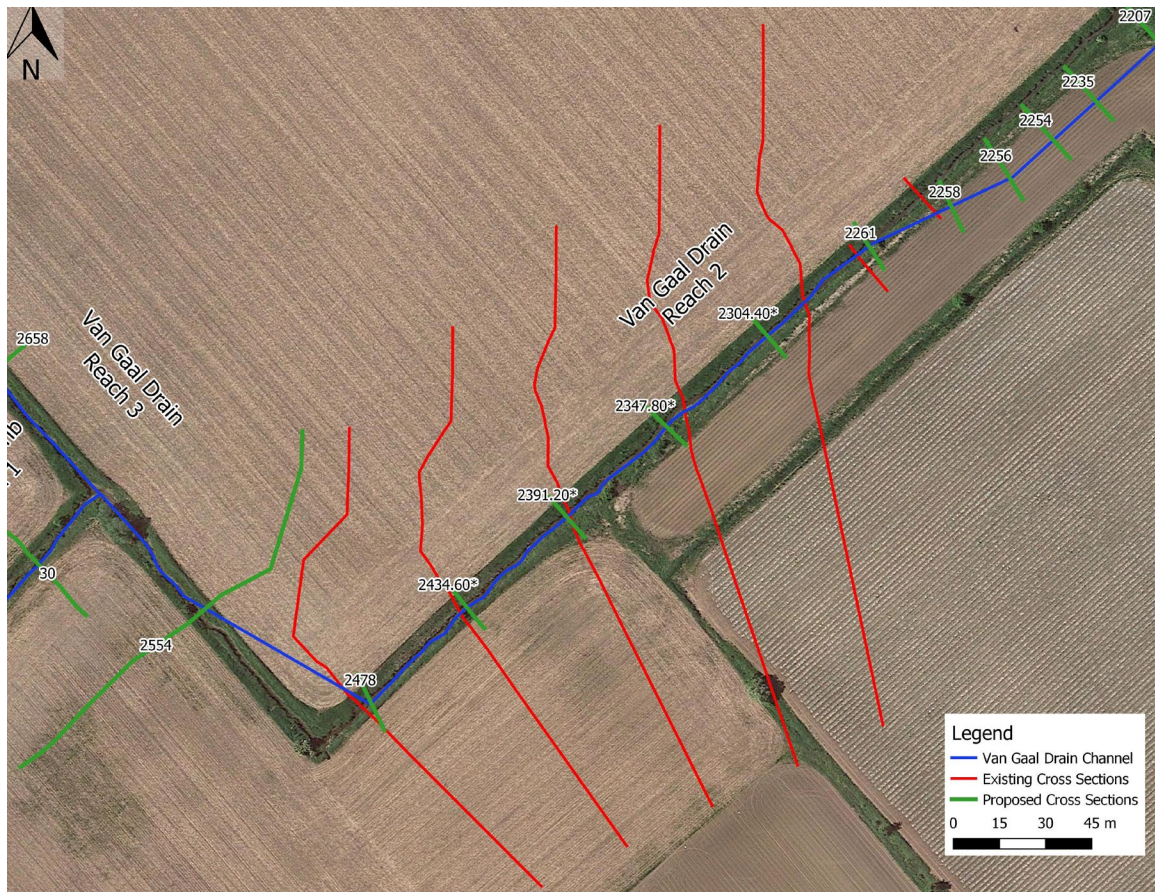


Figure 1: Van Gaal Drain Reach 2 Cross Section Labels

In undertaking this work, the following information was considered;

- 1) HEC-RAS models of Van Gaal Drain under existing conditions (spring and summer) were obtained from the *Floodplain Mapping Report for the Van Gaal Drain and Arbuckle Municipal Drains in the Village of Richmond* (JFSA, November 2009). The November 2009 report defined the maximum flood levels in the Van Gaal Drain based on three scenarios: (1) the Van Gaal Drain 100-year 24-hour SCS peak flow reaches the Jock River; (2) The Van Gaal 100-year spring snowmelt plus rainfall peak flow reaches the Jock River; and (4) The Jock River 100-year spring snowmelt plus rainfall peak flow reaches the outlet of the Van Gaal Drain.
- 2) The HEC-RAS models were modified as described in the April 2017 *Realignment* memo to evaluate the proposed realignment of approximately 900 m of the existing Van Gaal Drain to follow the boundary of the Richmond Village subdivision downstream of the Green Lands and upstream of Perth Street. Please refer to the April 2017 *Realignment* memo for further details of the existing (pre-realignment) and proposed (post-realignment) conditions modelling. Figure 1 of Attachment F in the current memo shows the proposed April 2017 channel realignment and cross-section extents.
- 3) The proposed conditions HEC-RAS models from the April 2017 *Realignment* memo were modified to reflect the current proposed channel realignment adjacent to the Green Lands based on information provided by DSEL. Going forward, this will be referred to as the proposed conditions model.
- 4) The typical proposed conditions channel dimension for updated cross-sections 2478 to 2258 include a 10 m wide floodplain with a cross-slope of 0.5%. The realigned channel is bounded by side slopes at 3H:1V and has a longitudinal slope of 0.4%. The low flow channel is 0.5 m deep with a bottom width of 1.0 m and a top width of 3.0 m. To match existing conditions, Manning's roughness coefficients for the proposed channel were set as 0.035 for the low flow channel, 0.05 for the banks under spring conditions and 0.08 for the banks under summer conditions. However, consistent with the April 2017 *Realignment* memo, we understand that trees and shrubs are to be planted on the banks about the 25 mm water level, and as such the Manning's roughness coefficients for this area of the proposed channel have been set to 0.08 under spring conditions and 0.10 under summer conditions.
- 5) Note that the proposed channel realignment will not significantly impact flows in the Van Gaal Drain. As such, existing conditions flows provided in the April 2017 *Realignment* memo models were also used to model proposed conditions. Consistent with the April 2017 *Realignment* memo, the 2-, 5-, 10-, 25- and 100-year return periods were assessed, as per the flows provided in the *March 26, 2010 P709(02) Richmond 2, 5, 10, 25 Year WSEL Results* email from JFSA to the City of Ottawa (forwarded to RVCA on March 30, 2012). The 25 mm 3-hour Chicago storm flows, as simulated using the March 26, 2010 SWMHYMO models, were also evaluated.
- 6) For the purpose of calculating floodplain elevations, all channel infrastructure was included in the existing and proposed conditions models. Conversely, for the purpose of calculating riparian storage volumes, all channel infrastructure was removed from the models. The existing flow profiles for the 25 mm and 2- to 100-year events were used to compare existing and proposed riparian storage volumes.
- 7) The proposed channel dimensions were set to contain the 100-year flood levels within the channel for all three spring and summer scenarios, and to set the 100-year proposed conditions water levels at comparable cross sections (for the Green lands realignment, cross-sections 2544 and 2478 in the Van Gaal Drain Reach 2) equal to or less than the maximum existing conditions flood levels defined in the November 2009 *Floodplain Mapping Report*. See Table 1 for details.

Based on the above information, 25 mm and 2- to 100-year design water levels and velocities were determined using HEC-RAS under the three spring and summer scenarios and are presented in Attachments A for existing conditions and Attachments C for proposed conditions. The 100-year design water levels for the proposed channel realignment of the Van Gaal Drain are presented in Table 1 and are contained within the proposed channel for all scenarios.

Table 1: Water Levels on Van Gaal Drain Reach 2 to Perth Street Under Proposed Conditions ⁽¹⁾

River Station	Scenario / Water Level (m)			
	1	2	4	Max. Allowable ⁽²⁾
2554	95.90	95.89	95.54	96.28
2478	95.58	95.55	95.20	96.16
2434.60*	95.41	95.39	95.03	N/A
2391.20*	95.27	95.23	94.85	N/A
2347.80*	95.16	95.11	94.68	N/A
2304.40*	95.08	95.03	94.56	N/A
2261	95.03	94.98	94.50	N/A
2258	94.99	94.94	94.46	N/A
2256	94.98	94.92	94.44	N/A
2254	94.96	94.91	94.42	N/A
2235	94.95	94.89	94.40	N/A
2207	94.92	94.87	94.38	95.48
2188	94.88	94.83	94.36	N/A
2163	94.85	94.8	94.33	N/A
2141	94.82	94.77	94.31	N/A
2121	94.80	94.74	94.30	N/A
2101	94.77	94.72	94.28	N/A
2080	94.74	94.69	94.26	N/A
2059	94.71	94.66	94.25	N/A
2038	94.68	94.63	94.23	N/A
2017	94.67	94.62	94.23	N/A
2003	94.66	94.61	94.22	N/A
1982	94.63	94.58	94.21	N/A
1961	94.61	94.56	94.20	N/A
1940	94.58	94.54	94.19	N/A
1919	94.56	94.51	94.18	N/A
1898	94.54	94.49	94.18	N/A
1877	94.52	94.47	94.17	N/A
1857	94.50	94.45	94.17	N/A
1837	94.48	94.44	94.16	N/A
1817	94.46	94.42	94.16	N/A
1797	94.45	94.41	94.16	N/A
1777	94.43	94.39	94.15	N/A
1757	94.42	94.38	94.15	N/A
1736	94.40	94.37	94.15	N/A
1715	94.39	94.36	94.15	N/A
1694	94.38	94.35	94.15	N/A
1673	94.37	94.34	94.14	N/A
1653	94.36	94.33	94.14	N/A
1632	94.35	94.33	94.14	N/A
1615	94.35	94.32	94.14	94.61
1555	94.33	94.31	94.14	94.55
1488	94.31	94.29	94.14	94.45
1416	94.29	94.28	94.13	94.41
1400	94.28	94.27	94.13	94.36
1364	94.28	94.27	94.13	94.31
1340	94.24	94.22	94.13	94.21

- (1) Scenario Descriptions:
1. The Van Gaal Drain 100-year 24-hour SCS peak flow reaches the Jock River.
 2. The Van Gaal Drain 100-year spring snowmelt plus rainfall peak flow reaches the Jock River.
 4. The Jock River 100-year spring snowmelt plus rainfall peak flow reaches the outlet of the Van Gaal Drain.
- (2) Maximum water level at existing cross-sections as per "Floodplain Mapping Report for the Van Gaal and Arbuckle Municipal Drains in the Village of Richmond" (JFSA, November 2009)

As seen in Table 1, the proposed conditions 100-year water levels at comparable cross sections 2554 and 2478 are equal to or less than the flood levels defined in *November 2009 Floodplain Mapping Report*.

An analysis of riparian storage in the channel under existing and proposed conditions was performed using the 25 mm and 2-, 5-, 10-, 25-, and 100-year flows for the three scenarios. All drainage infrastructure was removed from the models for the purpose of this analysis. Refer to Attachments B and D for detailed results under existing and proposed conditions, respectively. Table 2 presents a summary of the riparian storage analysis results.

Table 2: Riparian Storage on Van Gaal Drain Reach 2 ⁽¹⁾

Event	Existing Volume (m ³)			Proposed Volume (m ³)		
	Scenario 1	Scenario 2	Scenario 4	Scenario 1	Scenario 2	Scenario 4
25 mm	3570	N/A	N/A	6800	N/A	N/A
2-Year	7640	12550	11550	14550	19630	18390
5-Year	11950	16610	5890	20230	23500	11060
10-Year	15650	20280	5250	24360	26120	9070
25-Year	22190	26230	9590	29890	30210	15300
100-Year	38090	39190	36830	40630	39360	44560

(1) No channel infrastructure included in Van Gaal Drain for riparian storage analysis.

Scenario Descriptions:

1. The Van Gaal Drain 100-year 24-hour SCS peak flow reaches the Jock River.
2. The Van Gaal Drain 100-year spring snowmelt plus rainfall peak flow reaches the Jock River.
4. The Jock River 100-year spring snowmelt plus rainfall peak flow reaches the outlet of the Van Gaal Drain.

As is seen in Table 2, riparian storage volumes under proposed conditions are equal to or greater than existing riparian storage volumes for all scenarios and return periods, and will not adversely impact downstream flooding.

Yours truly,
J.F Sabourin and Associates Inc.

DRAFT FOR REVIEW

Tamarra Lewis, B.Eng., EIT
Water Resources Engineer-in-Training

DRAFT FOR REVIEW

Laura Pipkins, P.Eng.
Water Resources Engineer

cc: J.F Sabourin, M.Eng, P.Eng
Director of Water Resources Projects

Figures

Figure 1: Van Gaal Drain Reach 2 Cross Section Labels

Tables

Table 1: Water Levels on the Van Gaal Drain Reach 2 to Perth Street Under Proposed Conditions

Table 2: Riparian Storage on Van Gaal Drain Reach 2

Attachments

Attachment A: HEC-RAS Results for Van Gaal Drain Reach 2 Existing Conditions (Floodplain Analysis)

Attachment B: HEC-RAS Results for Van Gaal Drain Reach 2 Existing Conditions (Riparian Storage Analysis)

Attachment C: HEC-RAS Results for Van Gaal Drain Reach 2 Proposed Conditions (Floodplain Analysis)

Attachment D: HEC-RAS Results for Van Gaal Drain Reach 2 Proposed Conditions (Riparian Storage Analysis)

Attachment E: *Richmond Village Development / Proposed Realignment of the Van Gaal Drain* by JFSA (April 20, 2017) Figure 1

Attachment A

HEC-RAS Results for Van Gaal Drain Reach 2
Existing Conditions (Floodplain Analysis)

Table A-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2554	(1) 25 mm	0.72	94.75	95.41	0.41	0.85
2554	(1) 2-Year	1.95	94.75	95.72	0.56	0.70
2554	(1) 5-Year	3.20	94.75	95.93	0.65	0.61
2554	(1) 10-Year	4.11	94.75	96.04	0.71	0.57
2554	(1) 25-Year	5.28	94.75	96.14	0.78	0.55
2554	(1) 100-Year	7.27	94.75	96.26	0.84	0.58
2478	(1) 25 mm	0.72	94.75	95.35	0.42	0.80
2478	(1) 2-Year	1.95	94.75	95.65	0.59	0.66
2478	(1) 5-Year	3.20	94.75	95.85	0.72	0.58
2478	(1) 10-Year	4.11	94.75	95.94	0.82	0.54
2478	(1) 25-Year	5.28	94.75	96.03	0.93	0.53
2478	(1) 100-Year	7.27	94.75	96.12	1.10	0.56
2427.58*	(1) 25 mm	0.72	94.68	95.30	0.43	0.76
2427.58*	(1) 2-Year	1.95	94.68	95.60	0.61	0.64
2427.58*	(1) 5-Year	3.20	94.68	95.79	0.74	0.56
2427.58*	(1) 10-Year	4.11	94.68	95.87	0.84	0.53
2427.58*	(1) 25-Year	5.28	94.68	95.95	0.95	0.52
2427.58*	(1) 100-Year	7.27	94.68	96.04	1.11	0.54
2377.17*	(1) 25 mm	0.72	94.61	95.25	0.44	0.73
2377.17*	(1) 2-Year	1.95	94.61	95.54	0.62	0.61
2377.17*	(1) 5-Year	3.20	94.61	95.72	0.76	0.55
2377.17*	(1) 10-Year	4.11	94.61	95.80	0.86	0.51
2377.17*	(1) 25-Year	5.28	94.61	95.87	0.97	0.50
2377.17*	(1) 100-Year	7.27	94.61	95.95	1.09	0.53
2326.76*	(1) 25 mm	0.72	94.54	95.19	0.46	0.70
2326.76*	(1) 2-Year	1.95	94.54	95.48	0.64	0.59
2326.76*	(1) 5-Year	3.20	94.54	95.65	0.78	0.53
2326.76*	(1) 10-Year	4.11	94.54	95.72	0.88	0.50
2326.76*	(1) 25-Year	5.28	94.54	95.78	0.97	0.49
2326.76*	(1) 100-Year	7.27	94.54	95.85	1.07	0.52
2276.35*	(1) 25 mm	0.72	94.48	95.13	0.49	0.67
2276.35*	(1) 2-Year	1.95	94.48	95.41	0.68	0.57
2276.35*	(1) 5-Year	3.20	94.48	95.57	0.80	0.51
2276.35*	(1) 10-Year	4.11	94.48	95.63	0.89	0.48
2276.35*	(1) 25-Year	5.28	94.48	95.69	0.96	0.47
2276.35*	(1) 100-Year	7.27	94.48	95.77	0.98	0.50
2225.94*	(1) 25 mm	0.72	94.41	95.05	0.54	0.65
2225.94*	(1) 2-Year	1.95	94.41	95.33	0.74	0.55
2225.94*	(1) 5-Year	3.20	94.41	95.48	0.84	0.49
2225.94*	(1) 10-Year	4.11	94.41	95.54	0.88	0.46
2225.94*	(1) 25-Year	5.28	94.41	95.59	0.95	0.46
2225.94*	(1) 100-Year	7.27	94.41	95.66	1.05	0.49
2175.53*	(1) 25 mm	0.72	94.34	94.93	0.68	0.62
2175.53*	(1) 2-Year	1.95	94.34	95.18	0.92	0.53
2175.53*	(1) 5-Year	3.20	94.34	95.33	1.04	0.48

Table A-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2175.53*	(1) 10-Year	4.11	94.34	95.42	0.95	0.45
2175.53*	(1) 25-Year	5.28	94.34	95.47	1.01	0.44
2175.53*	(1) 100-Year	7.27	94.34	95.54	1.07	0.48
2157	(1) 25 mm	0.72	94.31	94.72	1.45	0.62
2157	(1) 2-Year	1.95	94.31	94.93	1.76	0.53
2157	(1) 5-Year	3.20	94.31	95.13	1.64	0.47
2157	(1) 10-Year	4.11	94.31	95.25	1.54	0.44
2157	(1) 25-Year	5.28	94.31	95.37	1.28	0.44
2157	(1) 100-Year	7.27	94.31	95.48	1.13	0.47
2076	(1) 25 mm	1.16	93.86	94.39	0.64	0.60
2076	(1) 2-Year	2.80	93.86	94.74	0.76	0.51
2076	(1) 5-Year	4.41	93.86	94.99	0.82	0.46
2076	(1) 10-Year	5.53	93.86	95.10	0.90	0.43
2076	(1) 25-Year	6.96	93.86	95.20	0.96	0.42
2076	(1) 100-Year	9.54	93.86	95.33	0.99	0.45
1974	(1) 25 mm	1.16	93.68	94.22	0.62	0.55
1974	(1) 2-Year	2.80	93.68	94.61	0.70	0.48
1974	(1) 5-Year	4.41	93.68	94.87	0.75	0.42
1974	(1) 10-Year	5.53	93.68	94.96	0.84	0.39
1974	(1) 25-Year	6.96	93.68	95.05	0.93	0.39
1974	(1) 100-Year	9.54	93.68	95.17	1.02	0.42
1922	(1) 25 mm	1.16	93.59	94.14	0.61	0.53
1922	(1) 2-Year	2.80	93.59	94.56	0.67	0.46
1922	(1) 5-Year	4.41	93.59	94.82	0.74	0.40
1922	(1) 10-Year	5.53	93.59	94.90	0.84	0.38
1922	(1) 25-Year	6.96	93.59	94.97	0.96	0.38
1922	(1) 100-Year	9.54	93.59	95.06	1.11	0.41
1833	(1) 25 mm	1.16	93.44	94.02	0.56	0.49
1833	(1) 2-Year	2.80	93.44	94.48	0.59	0.42
1833	(1) 5-Year	4.41	93.44	94.74	0.61	0.37
1833	(1) 10-Year	5.53	93.44	94.80	0.69	0.35
1833	(1) 25-Year	6.96	93.44	94.86	0.76	0.35
1833	(1) 100-Year	9.54	93.44	94.95	0.85	0.39
1796	(1) 25 mm	1.16	93.37	93.97	0.54	0.47
1796	(1) 2-Year	2.80	93.37	94.45	0.57	0.40
1796	(1) 5-Year	4.41	93.37	94.71	0.64	0.35
1796	(1) 10-Year	5.53	93.37	94.76	0.76	0.33
1796	(1) 25-Year	6.96	93.37	94.80	0.90	0.33
1796	(1) 100-Year	9.54	93.37	94.86	1.13	0.38
1735	(1) 25 mm	1.16	93.26	93.93	0.47	0.44
1735	(1) 2-Year	2.80	93.26	94.42	0.48	0.37
1735	(1) 5-Year	4.41	93.26	94.68	0.51	0.32
1735	(1) 10-Year	5.53	93.26	94.73	0.58	0.31
1735	(1) 25-Year	6.96	93.26	94.77	0.66	0.31
1735	(1) 100-Year	9.54	93.26	94.82	0.79	0.36

Table A-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1728	(1) 25 mm	1.16	93.25	93.91	0.56	0.44
1728	(1) 2-Year	2.80	93.25	94.41	0.60	0.37
1728	(1) 5-Year	4.41	93.25	94.67	0.68	0.32
1728	(1) 10-Year	5.53	93.25	94.71	0.80	0.31
1728	(1) 25-Year	6.96	93.25	94.73	0.96	0.31
1728	(1) 100-Year	9.54	93.25	94.75	1.25	0.36
1727		Culvert				
1717	(1) 25 mm	1.16	93.24	93.79	0.70	0.43
1717	(1) 2-Year	2.80	93.24	94.17	0.85	0.36
1717	(1) 5-Year	4.41	93.24	94.39	0.97	0.32
1717	(1) 10-Year	5.53	93.24	94.51	1.03	0.30
1717	(1) 25-Year	6.96	93.24	94.62	1.13	0.31
1717	(1) 100-Year	9.54	93.24	94.74	1.28	0.35
1615	(1) 25 mm	1.16	93.05	93.64	0.56	0.39
1615	(1) 2-Year	2.80	93.05	94.04	0.64	0.32
1615	(1) 5-Year	4.41	93.05	94.24	0.77	0.28
1615	(1) 10-Year	5.53	93.05	94.36	0.84	0.27
1615	(1) 25-Year	6.96	93.05	94.47	0.87	0.28
1615	(1) 100-Year	9.54	93.05	94.61	0.87	0.33
1555	(1) 25 mm	1.16	92.94	93.58	0.50	0.35
1555	(1) 2-Year	2.80	92.94	93.99	0.59	0.30
1555	(1) 5-Year	4.41	92.94	94.19	0.72	0.26
1555	(1) 10-Year	5.53	92.94	94.29	0.80	0.25
1555	(1) 25-Year	6.96	92.94	94.40	0.86	0.26
1555	(1) 100-Year	9.54	92.94	94.53	0.94	0.31
1488	(1) 25 mm	1.16	92.82	93.53	0.43	0.31
1488	(1) 2-Year	2.80	92.82	93.96	0.53	0.26
1488	(1) 5-Year	4.41	92.82	94.13	0.66	0.23
1488	(1) 10-Year	5.53	92.82	94.23	0.73	0.23
1488	(1) 25-Year	6.96	92.82	94.33	0.82	0.24
1488	(1) 100-Year	9.54	92.82	94.46	0.92	0.29
1416	(1) 25 mm	1.16	92.71	93.48	0.54	0.28
1416	(1) 2-Year	2.80	92.71	93.89	0.73	0.23
1416	(1) 5-Year	4.41	92.71	94.03	0.96	0.21
1416	(1) 10-Year	5.53	92.71	94.10	1.07	0.21
1416	(1) 25-Year	6.96	92.71	94.20	1.13	0.22
1416	(1) 100-Year	9.54	92.71	94.38	0.94	0.27
1400	(1) 25 mm	1.16	92.68	93.47	0.39	0.27
1400	(1) 2-Year	2.80	92.68	93.89	0.47	0.23
1400	(1) 5-Year	4.41	92.68	94.03	0.60	0.20
1400	(1) 10-Year	5.53	92.68	94.11	0.67	0.20
1400	(1) 25-Year	6.96	92.68	94.20	0.75	0.22
1400	(1) 100-Year	9.54	92.68	94.36	0.86	0.27

Table A-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1364	(1) 25 mm	1.16	92.62	93.46	0.34	0.24
1364	(1) 2-Year	2.80	92.62	93.87	0.46	0.20
1364	(1) 5-Year	4.41	92.62	94.00	0.61	0.19
1364	(1) 10-Year	5.53	92.62	94.07	0.71	0.19
1364	(1) 25-Year	6.96	92.62	94.16	0.81	0.20
1364	(1) 100-Year	9.54	92.62	94.31	0.92	0.25
1340	(1) 25 mm	1.53	92.61	93.45	0.37	0.22
1340	(1) 2-Year	3.64	92.61	93.85	0.60	0.19
1340	(1) 5-Year	5.57	92.61	93.97	0.84	0.18
1340	(1) 10-Year	6.92	92.61	94.03	1.00	0.18
1340	(1) 25-Year	8.58	92.61	94.09	1.18	0.20
1340	(1) 100-Year	11.43	92.61	94.21	1.46	0.25
1339		Culvert				
1312	(1) 25 mm	1.53	92.47	93.45	0.32	0.20
1312	(1) 2-Year	3.87	92.47	93.84	0.57	0.18
1312	(1) 5-Year	5.93	92.47	93.95	0.82	0.17
1312	(1) 10-Year	7.38	92.47	94.00	0.99	0.17
1312	(1) 25-Year	9.17	92.47	94.05	1.19	0.19
1312	(1) 100-Year	12.20	92.47	94.14	1.50	0.24
1302	(1) 25 mm	1.53	92.57	93.41	0.83	0.19
1302	(1) 2-Year	3.87	92.57	93.81	0.88	0.17
1302	(1) 5-Year	5.93	92.57	93.92	1.05	0.17
1302	(1) 10-Year	7.38	92.57	93.98	1.15	0.17
1302	(1) 25-Year	9.17	92.57	94.04	1.26	0.19
1302	(1) 100-Year	12.20	92.57	94.15	1.23	0.24
1268	(1) 25 mm	1.53	92.47	93.33	0.79	0.18
1268	(1) 2-Year	3.87	92.47	93.75	0.56	0.16
1268	(1) 5-Year	5.93	92.47	93.88	0.57	0.16
1268	(1) 10-Year	7.38	92.47	93.94	0.60	0.16
1268	(1) 25-Year	9.17	92.47	94.01	0.61	0.18
1268	(1) 100-Year	12.20	92.47	94.14	0.52	0.23
1212	(1) 25 mm	1.53	92.36	93.18	0.86	0.16
1212	(1) 2-Year	3.87	92.36	93.61	0.89	0.14
1212	(1) 5-Year	5.93	92.36	93.78	0.91	0.13
1212	(1) 10-Year	7.38	92.36	93.85	0.93	0.14
1212	(1) 25-Year	9.17	92.36	93.93	0.91	0.16
1212	(1) 100-Year	12.20	92.36	94.10	0.76	0.21
1169	(1) 25 mm	1.53	92.30	93.10	0.69	0.15
1169	(1) 2-Year	3.87	92.30	93.53	0.77	0.13
1169	(1) 5-Year	5.93	92.30	93.70	0.86	0.12
1169	(1) 10-Year	7.38	92.30	93.77	0.91	0.12
1169	(1) 25-Year	9.17	92.30	93.85	0.95	0.14
1169	(1) 100-Year	12.20	92.30	94.04	0.88	0.19
1091	(1) 25 mm	1.53	92.15	92.98	0.65	0.11

Table A-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1091	(1) 2-Year	3.87	92.15	93.40	0.75	0.10
1091	(1) 5-Year	5.93	92.15	93.57	0.82	0.09
1091	(1) 10-Year	7.38	92.15	93.65	0.85	0.10
1091	(1) 25-Year	9.17	92.15	93.75	0.85	0.12
1091	(1) 100-Year	12.20	92.15	93.97	0.83	0.17
1002	(1) 25 mm	1.53	92.06	92.81	0.76	0.08
1002	(1) 2-Year	3.87	92.06	93.21	0.90	0.07
1002	(1) 5-Year	5.93	92.06	93.39	0.98	0.07
1002	(1) 10-Year	7.38	92.06	93.50	0.93	0.07
1002	(1) 25-Year	9.17	92.06	93.65	0.83	0.09
1002	(1) 100-Year	12.20	92.06	93.93	0.65	0.13
961	(1) 25 mm	1.53	91.96	92.77	0.54	0.06
961	(1) 2-Year	3.87	91.96	93.14	0.71	0.05
961	(1) 5-Year	5.93	91.96	93.31	0.76	0.05
961	(1) 10-Year	7.38	91.96	93.44	0.71	0.06
961	(1) 25-Year	9.17	91.96	93.61	0.52	0.07
961	(1) 100-Year	12.20	91.96	93.92	0.35	0.11
910	(1) 25 mm	1.53	91.93	92.72	0.57	0.04
910	(1) 2-Year	3.87	91.93	93.07	0.72	0.03
910	(1) 5-Year	5.93	91.93	93.25	0.73	0.04
910	(1) 10-Year	7.38	91.93	93.40	0.69	0.04
910	(1) 25-Year	9.17	91.93	93.59	0.53	0.05
910	(1) 100-Year	12.20	91.93	93.91	0.33	0.07
840	(1) 25 mm	1.53	91.86	92.64	0.50	0.00
840	(1) 2-Year	3.87	91.86	93.00	0.44	0.00
840	(1) 5-Year	5.93	91.86	93.22	0.37	0.00
840	(1) 10-Year	7.38	91.86	93.38	0.33	0.00
840	(1) 25-Year	9.17	91.86	93.58	0.30	0.00
840	(1) 100-Year	12.20	91.86	93.91	0.25	0.00

⁽¹⁾ All channel infrastructure included in the HEC-RAS model for floodplain analysis.

For Scenario 1 (the Van Gaal Drain 100-year 24-hour SCS peak flow reaches the Jock River).

Table A-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2554	(2) 2-Year	4.13	94.75	96.03	0.71	0.58
2554	(2) 5-Year	5.24	94.75	96.13	0.78	0.55
2554	(2) 10-Year	6.01	94.75	96.18	0.81	0.54
2554	(2) 25-Year	6.94	94.75	96.23	0.83	0.57
2554	(2) 100-Year	8.32	94.75	96.28	0.82	0.68
2554	(4) 2-Year	3.97	94.75	96.02	0.70	0.58
2554	(4) 5-Year	2.02	94.75	95.74	0.56	0.71
2554	(4) 10-Year	1.57	94.75	95.64	0.52	0.82
2554	(4) 25-Year	2.25	94.75	95.78	0.58	0.93
2554	(4) 100-Year	2.86	94.75	95.88	0.63	2.01
2478	(2) 2-Year	4.13	94.75	95.93	0.83	0.55
2478	(2) 5-Year	5.24	94.75	96.02	0.93	0.52
2478	(2) 10-Year	6.01	94.75	96.06	1.00	0.52
2478	(2) 25-Year	6.94	94.75	96.10	1.09	0.55
2478	(2) 100-Year	8.32	94.75	96.14	1.17	0.66
2478	(4) 2-Year	3.97	94.75	95.92	0.81	0.56
2478	(4) 5-Year	2.02	94.75	95.67	0.60	0.67
2478	(4) 10-Year	1.57	94.75	95.57	0.55	0.78
2478	(4) 25-Year	2.25	94.75	95.71	0.63	0.89
2478	(4) 100-Year	2.86	94.75	95.80	0.69	1.98
2427.58*	(2) 2-Year	4.13	94.68	95.86	0.85	0.53
2427.58*	(2) 5-Year	5.24	94.68	95.94	0.95	0.51
2427.58*	(2) 10-Year	6.01	94.68	95.97	1.04	0.51
2427.58*	(2) 25-Year	6.94	94.68	96.01	1.09	0.53
2427.58*	(2) 100-Year	8.32	94.68	96.05	1.16	0.65
2427.58*	(4) 2-Year	3.97	94.68	95.85	0.83	0.54
2427.58*	(4) 5-Year	2.02	94.68	95.61	0.61	0.65
2427.58*	(4) 10-Year	1.57	94.68	95.52	0.56	0.75
2427.58*	(4) 25-Year	2.25	94.68	95.65	0.64	0.87
2427.58*	(4) 100-Year	2.86	94.68	95.74	0.70	1.96
2377.17*	(2) 2-Year	4.13	94.61	95.79	0.87	0.52
2377.17*	(2) 5-Year	5.24	94.61	95.85	0.97	0.49
2377.17*	(2) 10-Year	6.01	94.61	95.88	1.03	0.49
2377.17*	(2) 25-Year	6.94	94.61	95.91	1.08	0.52
2377.17*	(2) 100-Year	8.32	94.61	95.95	1.13	0.63
2377.17*	(4) 2-Year	3.97	94.61	95.78	0.85	0.52
2377.17*	(4) 5-Year	2.02	94.61	95.56	0.63	0.63
2377.17*	(4) 10-Year	1.57	94.61	95.47	0.58	0.73
2377.17*	(4) 25-Year	2.25	94.61	95.60	0.65	0.85
2377.17*	(4) 100-Year	2.86	94.61	95.68	0.72	1.94
2326.76*	(2) 2-Year	4.13	94.54	95.71	0.88	0.50
2326.76*	(2) 5-Year	5.24	94.54	95.76	0.98	0.48
2326.76*	(2) 10-Year	6.01	94.54	95.79	1.02	0.48
2326.76*	(2) 25-Year	6.94	94.54	95.82	1.06	0.51
2326.76*	(2) 100-Year	8.32	94.54	95.85	1.11	0.62
2326.76*	(4) 2-Year	3.97	94.54	95.70	0.87	0.51
2326.76*	(4) 5-Year	2.02	94.54	95.50	0.65	0.61
2326.76*	(4) 10-Year	1.57	94.54	95.41	0.60	0.70

Table A-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2326.76*	(4) 25-Year	2.25	94.54	95.54	0.68	0.83
2326.76*	(4) 100-Year	2.86	94.54	95.61	0.75	1.92
2276.35*	(2) 2-Year	4.13	94.48	95.62	0.90	0.49
2276.35*	(2) 5-Year	5.24	94.48	95.66	0.98	0.46
2276.35*	(2) 10-Year	6.01	94.48	95.69	1.00	0.47
2276.35*	(2) 25-Year	6.94	94.48	95.72	1.00	0.50
2276.35*	(2) 100-Year	8.32	94.48	95.76	0.99	0.61
2276.35*	(4) 2-Year	3.97	94.48	95.61	0.89	0.49
2276.35*	(4) 5-Year	2.02	94.48	95.43	0.69	0.58
2276.35*	(4) 10-Year	1.57	94.48	95.34	0.63	0.68
2276.35*	(4) 25-Year	2.25	94.48	95.46	0.71	0.81
2276.35*	(4) 100-Year	2.86	94.48	95.53	0.77	1.91
2225.94*	(2) 2-Year	4.13	94.41	95.52	0.87	0.47
2225.94*	(2) 5-Year	5.24	94.41	95.56	0.93	0.45
2225.94*	(2) 10-Year	6.01	94.41	95.59	0.97	0.45
2225.94*	(2) 25-Year	6.94	94.41	95.62	1.01	0.48
2225.94*	(2) 100-Year	8.32	94.41	95.65	1.06	0.59
2225.94*	(4) 2-Year	3.97	94.41	95.52	0.86	0.47
2225.94*	(4) 5-Year	2.02	94.41	95.34	0.75	0.57
2225.94*	(4) 10-Year	1.57	94.41	95.26	0.69	0.66
2225.94*	(4) 25-Year	2.25	94.41	95.37	0.77	0.79
2225.94*	(4) 100-Year	2.86	94.41	95.44	0.81	1.89
2175.53*	(2) 2-Year	4.13	94.34	95.43	0.83	0.45
2175.53*	(2) 5-Year	5.24	94.34	95.46	0.92	0.44
2175.53*	(2) 10-Year	6.01	94.34	95.47	0.99	0.44
2175.53*	(2) 25-Year	6.94	94.34	95.49	1.02	0.47
2175.53*	(2) 100-Year	8.32	94.34	95.54	1.02	0.58
2175.53*	(4) 2-Year	3.97	94.34	95.41	0.85	0.46
2175.53*	(4) 5-Year	2.02	94.34	95.19	0.93	0.55
2175.53*	(4) 10-Year	1.57	94.34	95.12	0.86	0.64
2175.53*	(4) 25-Year	2.25	94.34	95.23	0.96	0.77
2175.53*	(4) 100-Year	2.86	94.34	95.30	0.98	1.87
2157	(2) 2-Year	4.13	94.31	95.20	1.80	0.45
2157	(2) 5-Year	5.24	94.31	95.34	1.36	0.43
2157	(2) 10-Year	6.01	94.31	95.38	1.22	0.43
2157	(2) 25-Year	6.94	94.31	95.43	1.14	0.46
2157	(2) 100-Year	8.32	94.31	95.49	1.02	0.58
2157	(4) 2-Year	3.97	94.31	95.17	1.85	0.45
2157	(4) 5-Year	2.02	94.31	94.94	1.78	0.54
2157	(4) 10-Year	1.57	94.31	94.88	1.70	0.64
2157	(4) 25-Year	2.25	94.31	94.97	1.81	0.77
2157	(4) 100-Year	2.86	94.31	95.03	1.89	1.87
2076	(2) 2-Year	5.00	93.86	95.05	0.86	0.43
2076	(2) 5-Year	6.32	93.86	95.16	0.93	0.41
2076	(2) 10-Year	7.24	93.86	95.21	0.95	0.41
2076	(2) 25-Year	8.38	93.86	95.27	0.95	0.44
2076	(2) 100-Year	10.81	93.86	95.35	0.96	0.55

Table A-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2076	(4) 2-Year	4.78	93.86	95.03	0.85	0.44
2076	(4) 5-Year	2.34	93.86	94.65	0.75	0.53
2076	(4) 10-Year	1.78	93.86	94.53	0.71	0.62
2076	(4) 25-Year	2.60	93.86	94.70	0.76	0.75
2076	(4) 100-Year	3.29	93.86	94.85	0.76	1.85
1974	(2) 2-Year	5.00	93.68	94.92	0.80	0.40
1974	(2) 5-Year	6.32	93.68	95.01	0.90	0.38
1974	(2) 10-Year	7.24	93.68	95.06	0.94	0.38
1974	(2) 25-Year	8.38	93.68	95.11	0.98	0.41
1974	(2) 100-Year	10.81	93.68	95.20	1.01	0.53
1974	(4) 2-Year	4.78	93.68	94.90	0.78	0.40
1974	(4) 5-Year	2.34	93.68	94.51	0.70	0.49
1974	(4) 10-Year	1.78	93.68	94.37	0.67	0.58
1974	(4) 25-Year	2.60	93.68	94.57	0.70	0.71
1974	(4) 100-Year	3.29	93.68	94.74	0.68	1.81
1922	(2) 2-Year	5.00	93.59	94.86	0.79	0.38
1922	(2) 5-Year	6.32	93.59	94.93	0.91	0.37
1922	(2) 10-Year	7.24	93.59	94.97	0.99	0.37
1922	(2) 25-Year	8.38	93.59	95.01	1.07	0.40
1922	(2) 100-Year	10.81	93.59	95.08	1.18	0.51
1922	(4) 2-Year	4.78	93.59	94.84	0.77	0.39
1922	(4) 5-Year	2.34	93.59	94.44	0.67	0.47
1922	(4) 10-Year	1.78	93.59	94.30	0.66	0.56
1922	(4) 25-Year	2.60	93.59	94.51	0.67	0.69
1922	(4) 100-Year	3.29	93.59	94.69	0.65	1.79
1833	(2) 2-Year	5.00	93.44	94.78	0.65	0.35
1833	(2) 5-Year	6.32	93.44	94.84	0.71	0.34
1833	(2) 10-Year	7.24	93.44	94.87	0.75	0.34
1833	(2) 25-Year	8.38	93.44	94.90	0.78	0.37
1833	(2) 100-Year	10.81	93.44	94.97	0.82	0.49
1833	(4) 2-Year	4.78	93.44	94.76	0.64	0.35
1833	(4) 5-Year	2.34	93.44	94.35	0.60	0.43
1833	(4) 10-Year	1.78	93.44	94.20	0.59	0.52
1833	(4) 25-Year	2.60	93.44	94.42	0.60	0.65
1833	(4) 100-Year	3.29	93.44	94.63	0.55	1.75
1796	(2) 2-Year	5.00	93.37	94.74	0.70	0.33
1796	(2) 5-Year	6.32	93.37	94.79	0.83	0.32
1796	(2) 10-Year	7.24	93.37	94.80	0.93	0.33
1796	(2) 25-Year	8.38	93.37	94.83	1.04	0.36
1796	(2) 100-Year	10.81	93.37	94.87	1.23	0.48
1796	(4) 2-Year	4.78	93.37	94.73	0.68	0.34
1796	(4) 5-Year	2.34	93.37	94.33	0.57	0.41
1796	(4) 10-Year	1.78	93.37	94.17	0.56	0.50
1796	(4) 25-Year	2.60	93.37	94.40	0.57	0.64
1796	(4) 100-Year	3.29	93.37	94.60	0.55	1.73
1735	(2) 2-Year	5.00	93.26	94.71	0.53	0.31
1735	(2) 5-Year	6.32	93.26	94.76	0.57	0.30

Table A-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1735	(2) 10-Year	7.24	93.26	94.77	0.63	0.31
1735	(2) 25-Year	8.38	93.26	94.79	0.68	0.34
1735	(2) 100-Year	10.81	93.26	94.84	0.74	0.46
1735	(4) 2-Year	4.78	93.26	94.70	0.53	0.31
1735	(4) 5-Year	2.34	93.26	94.29	0.49	0.38
1735	(4) 10-Year	1.78	93.26	94.13	0.49	0.47
1735	(4) 25-Year	2.60	93.26	94.36	0.49	0.61
1735	(4) 100-Year	3.29	93.26	94.58	0.45	1.70
1728	(2) 2-Year	5.00	93.25	94.69	0.73	0.31
1728	(2) 5-Year	6.32	93.25	94.74	0.84	0.30
1728	(2) 10-Year	7.24	93.25	94.74	0.95	0.31
1728	(2) 25-Year	8.38	93.25	94.75	1.07	0.34
1728	(2) 100-Year	10.81	93.25	94.76	1.32	0.46
1728	(4) 2-Year	4.78	93.25	94.68	0.72	0.31
1728	(4) 5-Year	2.34	93.25	94.28	0.61	0.38
1728	(4) 10-Year	1.78	93.25	94.11	0.60	0.47
1728	(4) 25-Year	2.60	93.25	94.35	0.61	0.60
1728	(4) 100-Year	3.29	93.25	94.57	0.58	1.70
1727		Culvert				
1717	(2) 2-Year	5.00	93.24	94.45	1.02	0.30
1717	(2) 5-Year	6.32	93.24	94.57	1.10	0.29
1717	(2) 10-Year	7.24	93.24	94.62	1.17	0.30
1717	(2) 25-Year	8.38	93.24	94.67	1.26	0.34
1717	(2) 100-Year	10.81	93.24	94.74	1.39	0.46
1717	(4) 2-Year	4.78	93.24	94.42	1.01	0.30
1717	(4) 5-Year	2.34	93.24	94.06	0.84	0.37
1717	(4) 10-Year	1.78	93.24	93.94	0.80	0.46
1717	(4) 25-Year	2.60	93.24	94.12	0.86	0.60
1717	(4) 100-Year	3.29	93.24	94.32	0.79	1.69
1615	(2) 2-Year	5.00	93.05	94.29	0.83	0.27
1615	(2) 5-Year	6.32	93.05	94.40	0.88	0.26
1615	(2) 10-Year	7.24	93.05	94.47	0.87	0.28
1615	(2) 25-Year	8.38	93.05	94.53	0.87	0.31
1615	(2) 100-Year	10.81	93.05	94.62	0.82	0.43
1615	(4) 2-Year	4.78	93.05	94.26	0.82	0.27
1615	(4) 5-Year	2.34	93.05	93.92	0.65	0.34
1615	(4) 10-Year	1.78	93.05	93.78	0.63	0.42
1615	(4) 25-Year	2.60	93.05	93.98	0.66	0.56
1615	(4) 100-Year	3.29	93.05	94.24	0.58	1.65
1555	(2) 2-Year	5.00	92.94	94.22	0.79	0.25
1555	(2) 5-Year	6.32	92.94	94.33	0.85	0.25
1555	(2) 10-Year	7.24	92.94	94.39	0.88	0.26
1555	(2) 25-Year	8.38	92.94	94.45	0.91	0.29
1555	(2) 100-Year	10.81	92.94	94.55	0.96	0.41
1555	(4) 2-Year	4.78	92.94	94.19	0.78	0.25
1555	(4) 5-Year	2.34	92.94	93.87	0.59	0.31
1555	(4) 10-Year	1.78	92.94	93.72	0.58	0.40

Table A-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1555	(4) 25-Year	2.60	92.94	93.93	0.60	0.54
1555	(4) 100-Year	3.29	92.94	94.21	0.53	1.62
1488	(2) 2-Year	5.00	92.82	94.16	0.72	0.23
1488	(2) 5-Year	6.32	92.82	94.26	0.81	0.22
1488	(2) 10-Year	7.24	92.82	94.31	0.86	0.24
1488	(2) 25-Year	8.38	92.82	94.37	0.91	0.27
1488	(2) 100-Year	10.81	92.82	94.46	1.00	0.40
1488	(4) 2-Year	4.78	92.82	94.13	0.72	0.23
1488	(4) 5-Year	2.34	92.82	93.82	0.53	0.28
1488	(4) 10-Year	1.78	92.82	93.66	0.51	0.36
1488	(4) 25-Year	2.60	92.82	93.88	0.54	0.50
1488	(4) 100-Year	3.29	92.82	94.18	0.46	1.59
1416	(2) 2-Year	5.00	92.71	94.02	1.09	0.21
1416	(2) 5-Year	6.32	92.71	94.10	1.21	0.20
1416	(2) 10-Year	7.24	92.71	94.17	1.21	0.22
1416	(2) 25-Year	8.38	92.71	94.25	1.12	0.25
1416	(2) 100-Year	10.81	92.71	94.40	0.82	0.37
1416	(4) 2-Year	4.78	92.71	93.99	1.08	0.21
1416	(4) 5-Year	2.34	92.71	93.74	0.74	0.25
1416	(4) 10-Year	1.78	92.71	93.58	0.71	0.33
1416	(4) 25-Year	2.60	92.71	93.81	0.76	0.47
1416	(4) 100-Year	3.29	92.71	94.14	0.58	1.55
1400	(2) 2-Year	5.00	92.68	94.02	0.68	0.20
1400	(2) 5-Year	6.32	92.68	94.11	0.77	0.20
1400	(2) 10-Year	7.24	92.68	94.16	0.82	0.21
1400	(2) 25-Year	8.38	92.68	94.23	0.87	0.25
1400	(2) 100-Year	10.81	92.68	94.36	0.96	0.37
1400	(4) 2-Year	4.78	92.68	93.99	0.68	0.20
1400	(4) 5-Year	2.34	92.68	93.74	0.50	0.24
1400	(4) 10-Year	1.78	92.68	93.58	0.50	0.32
1400	(4) 25-Year	2.60	92.68	93.80	0.50	0.47
1400	(4) 100-Year	3.29	92.68	94.14	0.38	1.54
1364	(2) 2-Year	5.00	92.62	93.99	0.71	0.19
1364	(2) 5-Year	6.32	92.62	94.06	0.82	0.19
1364	(2) 10-Year	7.24	92.62	94.11	0.88	0.20
1364	(2) 25-Year	8.38	92.62	94.18	0.95	0.24
1364	(2) 100-Year	10.81	92.62	94.29	1.06	0.36
1364	(4) 2-Year	4.78	92.62	93.96	0.70	0.19
1364	(4) 5-Year	2.34	92.62	93.72	0.46	0.22
1364	(4) 10-Year	1.78	92.62	93.56	0.44	0.30
1364	(4) 25-Year	2.60	92.62	93.79	0.47	0.45
1364	(4) 100-Year	3.29	92.62	94.13	0.39	1.51
1340	(2) 2-Year	5.79	92.61	93.96	0.88	0.18
1340	(2) 5-Year	7.32	92.61	94.01	1.06	0.18
1340	(2) 10-Year	8.34	92.61	94.05	1.18	0.19
1340	(2) 25-Year	9.65	92.61	94.10	1.33	0.23
1340	(2) 100-Year	11.62	92.61	94.19	1.50	0.35

Table A-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1340	(4) 2-Year	5.26	92.61	93.93	0.81	0.18
1340	(4) 5-Year	2.44	92.61	93.71	0.45	0.21
1340	(4) 10-Year	1.86	92.61	93.55	0.40	0.29
1340	(4) 25-Year	2.71	92.61	93.78	0.47	0.43
1340	(4) 100-Year	3.43	92.61	94.13	0.46	1.50
1339		Culvert				
1312	(2) 2-Year	6.08	92.47	93.94	0.85	0.17
1312	(2) 5-Year	7.69	92.47	93.98	1.04	0.17
1312	(2) 10-Year	8.76	92.47	94.01	1.16	0.19
1312	(2) 25-Year	10.15	92.47	94.04	1.32	0.23
1312	(2) 100-Year	12.20	92.47	94.12	1.51	0.35
1312	(4) 2-Year	5.46	92.47	93.91	0.77	0.17
1312	(4) 5-Year	2.47	92.47	93.71	0.41	0.19
1312	(4) 10-Year	1.87	92.47	93.55	0.35	0.27
1312	(4) 25-Year	2.73	92.47	93.77	0.43	0.41
1312	(4) 100-Year	3.44	92.47	94.12	0.43	1.48
1302	(2) 2-Year	6.08	92.57	93.91	1.03	0.17
1302	(2) 5-Year	7.69	92.57	93.97	1.12	0.17
1302	(2) 10-Year	8.76	92.57	94.00	1.18	0.19
1302	(2) 25-Year	10.15	92.57	94.04	1.26	0.23
1302	(2) 100-Year	12.20	92.57	94.14	1.07	0.35
1302	(4) 2-Year	5.46	92.57	93.89	0.98	0.17
1302	(4) 5-Year	2.47	92.57	93.68	0.77	0.18
1302	(4) 10-Year	1.87	92.57	93.51	0.84	0.26
1302	(4) 25-Year	2.73	92.57	93.75	0.72	0.41
1302	(4) 100-Year	3.44	92.57	94.12	0.33	1.47
1268	(2) 2-Year	6.08	92.47	93.87	0.59	0.15
1268	(2) 5-Year	7.69	92.47	93.93	0.62	0.16
1268	(2) 10-Year	8.76	92.47	93.96	0.64	0.18
1268	(2) 25-Year	10.15	92.47	94.00	0.65	0.22
1268	(2) 100-Year	12.20	92.47	94.14	0.45	0.34
1268	(4) 2-Year	5.46	92.47	93.84	0.57	0.15
1268	(4) 5-Year	2.47	92.47	93.59	0.68	0.17
1268	(4) 10-Year	1.87	92.47	93.44	0.79	0.25
1268	(4) 25-Year	2.73	92.47	93.69	0.51	0.39
1268	(4) 100-Year	3.44	92.47	94.12	0.14	1.43
1212	(2) 2-Year	6.08	92.36	93.78	0.84	0.13
1212	(2) 5-Year	7.69	92.36	93.85	0.85	0.14
1212	(2) 10-Year	8.76	92.36	93.89	0.85	0.15
1212	(2) 25-Year	10.15	92.36	93.94	0.80	0.19
1212	(2) 100-Year	12.20	92.36	94.11	0.56	0.30
1212	(4) 2-Year	5.46	92.36	93.74	0.83	0.13
1212	(4) 5-Year	2.47	92.36	93.41	0.89	0.15
1212	(4) 10-Year	1.87	92.36	93.32	0.81	0.23
1212	(4) 25-Year	2.73	92.36	93.58	0.66	0.37
1212	(4) 100-Year	3.44	92.36	94.12	0.15	1.32

Table A-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1169	(2) 2-Year	6.08	92.30	93.70	0.85	0.12
1169	(2) 5-Year	7.69	92.30	93.76	0.91	0.13
1169	(2) 10-Year	8.76	92.30	93.80	0.94	0.14
1169	(2) 25-Year	10.15	92.30	93.87	0.94	0.18
1169	(2) 100-Year	12.20	92.30	94.08	0.73	0.29
1169	(4) 2-Year	5.46	92.30	93.67	0.83	0.12
1169	(4) 5-Year	2.47	92.30	93.32	0.73	0.13
1169	(4) 10-Year	1.87	92.30	93.26	0.62	0.21
1169	(4) 25-Year	2.73	92.30	93.54	0.53	0.35
1169	(4) 100-Year	3.44	92.30	94.12	0.17	1.25
1091	(2) 2-Year	6.08	92.15	93.57	0.82	0.09
1091	(2) 5-Year	7.69	92.15	93.64	0.85	0.10
1091	(2) 10-Year	8.76	92.15	93.69	0.84	0.12
1091	(2) 25-Year	10.15	92.15	93.78	0.78	0.15
1091	(2) 100-Year	12.20	92.15	94.04	0.57	0.25
1091	(4) 2-Year	5.46	92.15	93.54	0.82	0.09
1091	(4) 5-Year	2.47	92.15	93.19	0.70	0.10
1091	(4) 10-Year	1.87	92.15	93.17	0.55	0.18
1091	(4) 25-Year	2.73	92.15	93.50	0.45	0.30
1091	(4) 100-Year	3.44	92.15	94.12	0.13	1.10
1002	(2) 2-Year	6.08	92.06	93.38	1.02	0.07
1002	(2) 5-Year	7.69	92.06	93.49	0.94	0.07
1002	(2) 10-Year	8.76	92.06	93.59	0.82	0.09
1002	(2) 25-Year	10.15	92.06	93.71	0.70	0.12
1002	(2) 100-Year	12.20	92.06	94.02	0.41	0.20
1002	(4) 2-Year	5.46	92.06	93.33	1.01	0.06
1002	(4) 5-Year	2.47	92.06	93.01	0.83	0.07
1002	(4) 10-Year	1.87	92.06	93.09	0.55	0.13
1002	(4) 25-Year	2.73	92.06	93.47	0.36	0.24
1002	(4) 100-Year	3.44	92.06	94.12	0.09	0.88
961	(2) 2-Year	6.08	91.96	93.28	0.83	0.05
961	(2) 5-Year	7.69	91.96	93.41	0.78	0.06
961	(2) 10-Year	8.76	91.96	93.52	0.65	0.07
961	(2) 25-Year	10.15	91.96	93.69	0.43	0.10
961	(2) 100-Year	12.20	91.96	94.02	0.24	0.17
961	(4) 2-Year	5.46	91.96	93.23	0.82	0.05
961	(4) 5-Year	2.47	91.96	92.97	0.62	0.06
961	(4) 10-Year	1.87	91.96	93.06	0.40	0.11
961	(4) 25-Year	2.73	91.96	93.46	0.25	0.21
961	(4) 100-Year	3.44	91.96	94.12	0.05	0.72
910	(2) 2-Year	6.08	91.93	93.22	0.70	0.03
910	(2) 5-Year	7.69	91.93	93.38	0.63	0.04
910	(2) 10-Year	8.76	91.93	93.49	0.52	0.05
910	(2) 25-Year	10.15	91.93	93.68	0.34	0.06
910	(2) 100-Year	12.20	91.93	94.02	0.20	0.10
910	(4) 2-Year	5.46	91.93	93.17	0.73	0.03
910	(4) 5-Year	2.47	91.93	92.91	0.64	0.03
910	(4) 10-Year	1.87	91.93	93.05	0.35	0.07

Table A-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
910	(4) 25-Year	2.73	91.93	93.46	0.18	0.14
910	(4) 100-Year	3.44	91.93	94.12	0.05	0.44
840	(2) 2-Year	6.08	91.86	93.18	0.41	0.00
840	(2) 5-Year	7.69	91.86	93.35	0.34	0.00
840	(2) 10-Year	8.76	91.86	93.48	0.30	0.00
840	(2) 25-Year	10.15	91.86	93.67	0.26	0.00
840	(2) 100-Year	12.20	91.86	94.02	0.18	0.00
840	(4) 2-Year	5.46	91.86	93.11	0.44	0.00
840	(4) 5-Year	2.47	91.86	92.83	0.47	0.00
840	(4) 10-Year	1.87	91.86	93.03	0.19	0.00
840	(4) 25-Year	2.73	91.86	93.45	0.10	0.00
840	(4) 100-Year	3.44	91.86	94.12	0.04	0.00

⁽¹⁾ All channel infrastructure included in the HEC-RAS model for floodplain analysis.

For Scenario 2 (the Van Gaal Drain 100-year spring snowmelt plus rainfall peak flow reaches the Jock River) and Scenario 4 (the Jock River 100-year spring snowmelt plus rainfall peak flow reaches the outlet of the Van Gaal Drain).

Attachment B

HEC-RAS Results for Van Gaal Drain Reach 2
Existing Conditions (Riparian Storage Analysis)

Table B-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2554	(1) 25 mm	0.72	94.75	95.41	0.41	3.57
2554	(1) 2-Year	1.95	94.75	95.72	0.56	7.64
2554	(1) 5-Year	3.20	94.75	95.93	0.65	11.95
2554	(1) 10-Year	4.11	94.75	96.04	0.71	15.65
2554	(1) 25-Year	5.28	94.75	96.14	0.78	22.19
2554	(1) 100-Year	7.27	94.75	96.26	0.84	38.09
2478	(1) 25 mm	0.72	94.75	95.35	0.42	3.44
2478	(1) 2-Year	1.95	94.75	95.65	0.59	7.39
2478	(1) 5-Year	3.20	94.75	95.85	0.72	11.60
2478	(1) 10-Year	4.11	94.75	95.94	0.82	15.23
2478	(1) 25-Year	5.28	94.75	96.03	0.93	21.64
2478	(1) 100-Year	7.27	94.75	96.12	1.10	37.03
2427.58*	(1) 25 mm	0.72	94.68	95.30	0.43	3.36
2427.58*	(1) 2-Year	1.95	94.68	95.60	0.61	7.23
2427.58*	(1) 5-Year	3.20	94.68	95.79	0.74	11.38
2427.58*	(1) 10-Year	4.11	94.68	95.87	0.84	14.96
2427.58*	(1) 25-Year	5.28	94.68	95.95	0.95	21.30
2427.58*	(1) 100-Year	7.27	94.68	96.04	1.11	36.45
2377.17*	(1) 25 mm	0.72	94.61	95.25	0.44	3.28
2377.17*	(1) 2-Year	1.95	94.61	95.54	0.62	7.07
2377.17*	(1) 5-Year	3.20	94.61	95.72	0.76	11.16
2377.17*	(1) 10-Year	4.11	94.61	95.80	0.86	14.68
2377.17*	(1) 25-Year	5.28	94.61	95.87	0.97	20.90
2377.17*	(1) 100-Year	7.27	94.61	95.95	1.09	35.75
2326.76*	(1) 25 mm	0.72	94.54	95.19	0.46	3.20
2326.76*	(1) 2-Year	1.95	94.54	95.48	0.64	6.91
2326.76*	(1) 5-Year	3.20	94.54	95.65	0.78	10.93
2326.76*	(1) 10-Year	4.11	94.54	95.72	0.88	14.37
2326.76*	(1) 25-Year	5.28	94.54	95.78	0.97	20.42
2326.76*	(1) 100-Year	7.27	94.54	95.85	1.07	34.92
2276.35*	(1) 25 mm	0.72	94.48	95.13	0.49	3.12
2276.35*	(1) 2-Year	1.95	94.48	95.41	0.68	6.77
2276.35*	(1) 5-Year	3.20	94.48	95.57	0.80	10.67
2276.35*	(1) 10-Year	4.11	94.48	95.63	0.89	14.00
2276.35*	(1) 25-Year	5.28	94.48	95.69	0.96	19.84
2276.35*	(1) 100-Year	7.27	94.48	95.77	0.98	33.90
2225.94*	(1) 25 mm	0.72	94.41	95.05	0.54	3.05
2225.94*	(1) 2-Year	1.95	94.41	95.33	0.74	6.63
2225.94*	(1) 5-Year	3.20	94.41	95.48	0.84	10.38
2225.94*	(1) 10-Year	4.11	94.41	95.54	0.88	13.58
2225.94*	(1) 25-Year	5.28	94.41	95.59	0.95	19.24
2225.94*	(1) 100-Year	7.27	94.41	95.66	1.05	32.94
2175.53*	(1) 25 mm	0.72	94.34	94.93	0.68	2.99
2175.53*	(1) 2-Year	1.95	94.34	95.18	0.92	6.51
2175.53*	(1) 5-Year	3.20	94.34	95.33	1.03	10.12

Table B-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2175.53*	(1) 10-Year	4.11	94.34	95.42	0.94	13.14
2175.53*	(1) 25-Year	5.28	94.34	95.47	1.01	18.68
2175.53*	(1) 100-Year	7.27	94.34	95.54	1.07	32.14
2157	(1) 25 mm	0.72	94.31	94.72	1.45	2.98
2157	(1) 2-Year	1.95	94.31	94.93	1.77	6.48
2157	(1) 5-Year	3.20	94.31	95.12	1.71	10.06
2157	(1) 10-Year	4.11	94.31	95.24	1.59	13.03
2157	(1) 25-Year	5.28	94.31	95.37	1.29	18.50
2157	(1) 100-Year	7.27	94.31	95.48	1.13	31.84
2076	(1) 25 mm	1.16	93.86	94.39	0.64	2.89
2076	(1) 2-Year	2.80	93.86	94.71	0.81	6.30
2076	(1) 5-Year	4.41	93.86	94.94	0.89	9.79
2076	(1) 10-Year	5.53	93.86	95.07	0.93	12.67
2076	(1) 25-Year	6.96	93.86	95.19	0.97	17.86
2076	(1) 100-Year	9.54	93.86	95.33	0.99	30.64
1974	(1) 25 mm	1.16	93.68	94.21	0.63	2.71
1974	(1) 2-Year	2.80	93.68	94.54	0.78	5.95
1974	(1) 5-Year	4.41	93.68	94.77	0.86	9.29
1974	(1) 10-Year	5.53	93.68	94.92	0.89	12.06
1974	(1) 25-Year	6.96	93.68	95.04	0.95	16.97
1974	(1) 100-Year	9.54	93.68	95.17	1.02	28.90
1922	(1) 25 mm	1.16	93.59	94.12	0.63	2.62
1922	(1) 2-Year	2.80	93.59	94.46	0.78	5.77
1922	(1) 5-Year	4.41	93.59	94.70	0.87	9.04
1922	(1) 10-Year	5.53	93.59	94.84	0.91	11.76
1922	(1) 25-Year	6.96	93.59	94.95	0.98	16.58
1922	(1) 100-Year	9.54	93.59	95.07	1.10	28.19
1833	(1) 25 mm	1.16	93.44	93.97	0.62	2.45
1833	(1) 2-Year	2.80	93.44	94.33	0.75	5.45
1833	(1) 5-Year	4.41	93.44	94.56	0.81	8.57
1833	(1) 10-Year	5.53	93.44	94.70	0.82	11.18
1833	(1) 25-Year	6.96	93.44	94.82	0.83	15.73
1833	(1) 100-Year	9.54	93.44	94.95	0.84	26.54
1796	(1) 25 mm	1.16	93.37	93.91	0.62	2.38
1796	(1) 2-Year	2.80	93.37	94.28	0.73	5.31
1796	(1) 5-Year	4.41	93.37	94.51	0.83	8.38
1796	(1) 10-Year	5.53	93.37	94.64	0.88	10.95
1796	(1) 25-Year	6.96	93.37	94.75	0.96	15.39
1796	(1) 100-Year	9.54	93.37	94.87	1.11	25.93
1735	(1) 25 mm	1.16	93.26	93.83	0.58	2.27
1735	(1) 2-Year	2.80	93.26	94.21	0.67	5.08
1735	(1) 5-Year	4.41	93.26	94.44	0.74	8.05
1735	(1) 10-Year	5.53	93.26	94.57	0.77	10.56
1735	(1) 25-Year	6.96	93.26	94.69	0.80	14.83
1735	(1) 100-Year	9.54	93.26	94.83	0.76	24.60

Table B-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1728	(1) 25 mm	1.16	93.25	93.81	0.68	2.26
1728	(1) 2-Year	2.80	93.25	94.19	0.84	5.05
1728	(1) 5-Year	4.41	93.25	94.41	0.95	8.01
1728	(1) 10-Year	5.53	93.25	94.53	1.01	10.51
1728	(1) 25-Year	6.96	93.25	94.64	1.11	14.76
1728	(1) 100-Year	9.54	93.25	94.78	1.17	24.43
1717	(1) 25 mm	1.16	93.24	93.79	0.71	2.24
1717	(1) 2-Year	2.80	93.24	94.16	0.86	5.01
1717	(1) 5-Year	4.41	93.24	94.38	0.98	7.96
1717	(1) 10-Year	5.53	93.24	94.50	1.04	10.45
1717	(1) 25-Year	6.96	93.24	94.61	1.14	14.69
1717	(1) 100-Year	9.54	93.24	94.73	1.32	24.28
1615	(1) 25 mm	1.16	93.05	93.63	0.56	2.05
1615	(1) 2-Year	2.80	93.05	94.03	0.65	4.63
1615	(1) 5-Year	4.41	93.05	94.24	0.78	7.45
1615	(1) 10-Year	5.53	93.05	94.35	0.85	9.83
1615	(1) 25-Year	6.96	93.05	94.46	0.89	13.75
1615	(1) 100-Year	9.54	93.05	94.59	0.90	22.47
1555	(1) 25 mm	1.16	92.94	93.57	0.50	1.92
1555	(1) 2-Year	2.80	92.94	93.99	0.60	4.36
1555	(1) 5-Year	4.41	92.94	94.18	0.73	7.10
1555	(1) 10-Year	5.53	92.94	94.28	0.81	9.41
1555	(1) 25-Year	6.96	92.94	94.39	0.88	13.09
1555	(1) 100-Year	9.54	92.94	94.51	0.97	21.28
1488	(1) 25 mm	1.16	92.82	93.53	0.43	1.76
1488	(1) 2-Year	2.80	92.82	93.95	0.53	4.04
1488	(1) 5-Year	4.41	92.82	94.12	0.67	6.69
1488	(1) 10-Year	5.53	92.82	94.22	0.75	8.93
1488	(1) 25-Year	6.96	92.82	94.31	0.83	12.45
1488	(1) 100-Year	9.54	92.82	94.43	0.97	20.32
1416	(1) 25 mm	1.16	92.71	93.47	0.55	1.59
1416	(1) 2-Year	2.80	92.71	93.88	0.74	3.73
1416	(1) 5-Year	4.41	92.71	94.01	0.98	6.31
1416	(1) 10-Year	5.53	92.71	94.08	1.11	8.48
1416	(1) 25-Year	6.96	92.71	94.16	1.22	11.83
1416	(1) 100-Year	9.54	92.71	94.28	1.29	19.29
1400	(1) 25 mm	1.16	92.68	93.46	0.39	1.55
1400	(1) 2-Year	2.80	92.68	93.87	0.48	3.65
1400	(1) 5-Year	4.41	92.68	94.01	0.61	6.21
1400	(1) 10-Year	5.53	92.68	94.08	0.69	8.37
1400	(1) 25-Year	6.96	92.68	94.16	0.79	11.69
1400	(1) 100-Year	9.54	92.68	94.27	0.95	19.07
1364	(1) 25 mm	1.16	92.62	93.45	0.35	1.44
1364	(1) 2-Year	2.80	92.62	93.86	0.46	3.44

Table B-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1364	(1) 5-Year	4.41	92.62	93.98	0.63	5.96
1364	(1) 10-Year	5.53	92.62	94.04	0.73	8.09
1364	(1) 25-Year	6.96	92.62	94.11	0.85	11.37
1364	(1) 100-Year	9.54	92.62	94.20	1.05	18.72
1340	(1) 25 mm	1.53	92.61	93.45	0.19	1.30
1340	(1) 2-Year	3.64	92.61	93.86	0.29	3.22
1340	(1) 5-Year	5.57	92.61	93.98	0.41	5.71
1340	(1) 10-Year	6.92	92.61	94.05	0.48	7.82
1340	(1) 25-Year	8.58	92.61	94.12	0.57	11.09
1340	(1) 100-Year	11.43	92.61	94.21	0.71	18.39
1312	(1) 25 mm	1.53	92.47	93.45	0.29	1.10
1312	(1) 2-Year	3.87	92.47	93.84	0.51	2.91
1312	(1) 5-Year	5.93	92.47	93.96	0.71	5.36
1312	(1) 10-Year	7.38	92.47	94.01	0.84	7.45
1312	(1) 25-Year	9.17	92.47	94.07	1.01	10.69
1312	(1) 100-Year	12.20	92.47	94.13	1.29	17.96
1302	(1) 25 mm	1.53	92.57	93.41	0.83	1.07
1302	(1) 2-Year	3.87	92.57	93.81	0.88	2.84
1302	(1) 5-Year	5.93	92.57	93.92	1.05	5.28
1302	(1) 10-Year	7.38	92.57	93.98	1.15	7.35
1302	(1) 25-Year	9.17	92.57	94.03	1.27	10.58
1302	(1) 100-Year	12.20	92.57	94.11	1.41	17.81
1268	(1) 25 mm	1.53	92.47	93.33	0.79	1.00
1268	(1) 2-Year	3.87	92.47	93.75	0.56	2.62
1268	(1) 5-Year	5.93	92.47	93.88	0.57	4.91
1268	(1) 10-Year	7.38	92.47	93.94	0.60	6.88
1268	(1) 25-Year	9.17	92.47	94.01	0.62	9.89
1268	(1) 100-Year	12.20	92.47	94.10	0.60	16.63
1212	(1) 25 mm	1.53	92.36	93.18	0.86	0.90
1212	(1) 2-Year	3.87	92.36	93.61	0.89	2.25
1212	(1) 5-Year	5.93	92.36	93.77	0.91	4.21
1212	(1) 10-Year	7.38	92.36	93.85	0.93	5.90
1212	(1) 25-Year	9.17	92.36	93.92	0.94	8.43
1212	(1) 100-Year	12.20	92.36	94.04	0.90	14.29
1169	(1) 25 mm	1.53	92.30	93.10	0.69	0.81
1169	(1) 2-Year	3.87	92.30	93.53	0.78	2.01
1169	(1) 5-Year	5.93	92.30	93.70	0.86	3.67
1169	(1) 10-Year	7.38	92.30	93.77	0.92	5.11
1169	(1) 25-Year	9.17	92.30	93.84	0.98	7.33
1169	(1) 100-Year	12.20	92.30	93.94	1.09	12.63
1091	(1) 25 mm	1.53	92.15	92.98	0.65	0.63
1091	(1) 2-Year	3.87	92.15	93.40	0.75	1.62
1091	(1) 5-Year	5.93	92.15	93.57	0.83	2.89
1091	(1) 10-Year	7.38	92.15	93.64	0.87	4.03
1091	(1) 25-Year	9.17	92.15	93.71	0.92	5.91

Table B-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1091	(1) 100-Year	12.20	92.15	93.82	0.97	10.61
1002	(1) 25 mm	1.53	92.06	92.81	0.76	0.44
1002	(1) 2-Year	3.87	92.06	93.21	0.91	1.21
1002	(1) 5-Year	5.93	92.06	93.37	1.02	2.15
1002	(1) 10-Year	7.38	92.06	93.46	1.04	2.97
1002	(1) 25-Year	9.17	92.06	93.55	1.03	4.45
1002	(1) 100-Year	12.20	92.06	93.69	1.02	8.49
961	(1) 25 mm	1.53	91.96	92.77	0.54	0.34
961	(1) 2-Year	3.87	91.96	93.13	0.72	1.01
961	(1) 5-Year	5.93	91.96	93.28	0.80	1.85
961	(1) 10-Year	7.38	91.96	93.37	0.83	2.56
961	(1) 25-Year	9.17	91.96	93.47	0.82	3.85
961	(1) 100-Year	12.20	91.96	93.64	0.64	7.42
910	(1) 25 mm	1.53	91.93	92.72	0.57	0.20
910	(1) 2-Year	3.87	91.93	93.06	0.74	0.62
910	(1) 5-Year	5.93	91.93	93.20	0.81	1.16
910	(1) 10-Year	7.38	91.93	93.30	0.82	1.62
910	(1) 25-Year	9.17	91.93	93.41	0.83	2.38
910	(1) 100-Year	12.20	91.93	93.60	0.68	4.32
840	(1) 25 mm	1.53	91.86	92.65	0.50	0.00
840	(1) 2-Year	3.87	91.86	92.98	0.47	0.00
840	(1) 5-Year	5.93	91.86	93.16	0.43	0.00
840	(1) 10-Year	7.38	91.86	93.26	0.41	0.00
840	(1) 25-Year	9.17	91.86	93.38	0.41	0.00
840	(1) 100-Year	12.20	91.86	93.58	0.39	0.00

⁽¹⁾ All channel infrastructure removed from the HEC-RAS model for riparian storage analysis.

For Scenario 1 (the Van Gaal Drain 100-year 24-hour SCS peak flow reaches the Jock River).

Table B-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2554	(2) 2-Year	4.13	94.75	96.03	0.71	12.55
2554	(2) 5-Year	5.24	94.75	96.13	0.78	16.61
2554	(2) 10-Year	6.01	94.75	96.18	0.81	20.28
2554	(2) 25-Year	6.94	94.75	96.23	0.83	26.23
2554	(2) 100-Year	8.32	94.75	96.28	0.82	39.19
2554	(4) 2-Year	3.97	94.75	96.02	0.70	11.55
2554	(4) 5-Year	2.02	94.75	95.74	0.56	5.89
2554	(4) 10-Year	1.57	94.75	95.64	0.52	5.25
2554	(4) 25-Year	2.25	94.75	95.78	0.58	9.59
2554	(4) 100-Year	2.86	94.75	95.88	0.63	36.83
2478	(2) 2-Year	4.13	94.75	95.93	0.83	12.14
2478	(2) 5-Year	5.24	94.75	96.02	0.93	16.08
2478	(2) 10-Year	6.01	94.75	96.06	1.00	19.63
2478	(2) 25-Year	6.94	94.75	96.10	1.09	25.37
2478	(2) 100-Year	8.32	94.75	96.14	1.17	37.97
2478	(4) 2-Year	3.97	94.75	95.92	0.81	11.15
2478	(4) 5-Year	2.02	94.75	95.67	0.60	5.63
2478	(4) 10-Year	1.57	94.75	95.57	0.55	5.03
2478	(4) 25-Year	2.25	94.75	95.71	0.63	9.31
2478	(4) 100-Year	2.86	94.75	95.80	0.69	36.50
2427.58*	(2) 2-Year	4.13	94.68	95.86	0.85	11.88
2427.58*	(2) 5-Year	5.24	94.68	95.94	0.95	15.75
2427.58*	(2) 10-Year	6.01	94.68	95.97	1.04	19.25
2427.58*	(2) 25-Year	6.94	94.68	96.01	1.09	24.89
2427.58*	(2) 100-Year	8.32	94.68	96.05	1.16	37.34
2427.58*	(4) 2-Year	3.97	94.68	95.85	0.83	10.90
2427.58*	(4) 5-Year	2.02	94.68	95.61	0.61	5.47
2427.58*	(4) 10-Year	1.57	94.68	95.52	0.56	4.88
2427.58*	(4) 25-Year	2.25	94.68	95.65	0.64	9.13
2427.58*	(4) 100-Year	2.86	94.68	95.74	0.70	36.30
2377.17*	(2) 2-Year	4.13	94.61	95.79	0.87	11.60
2377.17*	(2) 5-Year	5.24	94.61	95.85	0.97	15.39
2377.17*	(2) 10-Year	6.01	94.61	95.88	1.03	18.81
2377.17*	(2) 25-Year	6.94	94.61	95.91	1.08	24.33
2377.17*	(2) 100-Year	8.32	94.61	95.95	1.13	36.61
2377.17*	(4) 2-Year	3.97	94.61	95.78	0.85	10.63
2377.17*	(4) 5-Year	2.02	94.61	95.56	0.63	5.30
2377.17*	(4) 10-Year	1.57	94.61	95.47	0.58	4.75
2377.17*	(4) 25-Year	2.25	94.61	95.60	0.65	8.96
2377.17*	(4) 100-Year	2.86	94.61	95.68	0.72	36.10
2326.76*	(2) 2-Year	4.13	94.54	95.71	0.88	11.31
2326.76*	(2) 5-Year	5.24	94.54	95.76	0.98	14.98
2326.76*	(2) 10-Year	6.01	94.54	95.79	1.02	18.30
2326.76*	(2) 25-Year	6.94	94.54	95.82	1.06	23.69
2326.76*	(2) 100-Year	8.32	94.54	95.85	1.11	35.80
2326.76*	(4) 2-Year	3.97	94.54	95.70	0.87	10.35
2326.76*	(4) 5-Year	2.02	94.54	95.50	0.65	5.14
2326.76*	(4) 10-Year	1.57	94.54	95.41	0.60	4.61

Table B-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2326.76*	(4) 25-Year	2.25	94.54	95.54	0.68	8.79
2326.76*	(4) 100-Year	2.86	94.54	95.61	0.75	35.90
2276.35*	(2) 2-Year	4.13	94.48	95.62	0.90	10.97
2276.35*	(2) 5-Year	5.24	94.48	95.66	0.98	14.50
2276.35*	(2) 10-Year	6.01	94.48	95.69	1.00	17.70
2276.35*	(2) 25-Year	6.94	94.48	95.72	1.00	22.95
2276.35*	(2) 100-Year	8.32	94.48	95.76	0.99	34.83
2276.35*	(4) 2-Year	3.97	94.48	95.61	0.89	10.03
2276.35*	(4) 5-Year	2.02	94.48	95.43	0.69	4.99
2276.35*	(4) 10-Year	1.57	94.48	95.34	0.63	4.48
2276.35*	(4) 25-Year	2.25	94.48	95.46	0.71	8.62
2276.35*	(4) 100-Year	2.86	94.48	95.53	0.77	35.68
2225.94*	(2) 2-Year	4.13	94.41	95.52	0.87	10.59
2225.94*	(2) 5-Year	5.24	94.41	95.56	0.93	14.00
2225.94*	(2) 10-Year	6.01	94.41	95.59	0.97	17.11
2225.94*	(2) 25-Year	6.94	94.41	95.62	1.01	22.24
2225.94*	(2) 100-Year	8.32	94.41	95.65	1.06	33.93
2225.94*	(4) 2-Year	3.97	94.41	95.52	0.86	9.67
2225.94*	(4) 5-Year	2.02	94.41	95.34	0.75	4.85
2225.94*	(4) 10-Year	1.57	94.41	95.26	0.69	4.36
2225.94*	(4) 25-Year	2.25	94.41	95.37	0.77	8.46
2225.94*	(4) 100-Year	2.86	94.41	95.44	0.81	35.46
2175.53*	(2) 2-Year	4.13	94.34	95.43	0.83	10.17
2175.53*	(2) 5-Year	5.24	94.34	95.46	0.92	13.49
2175.53*	(2) 10-Year	6.01	94.34	95.47	0.99	16.55
2175.53*	(2) 25-Year	6.94	94.34	95.49	1.02	21.61
2175.53*	(2) 100-Year	8.32	94.34	95.54	1.02	33.17
2175.53*	(4) 2-Year	3.97	94.34	95.42	0.85	9.27
2175.53*	(4) 5-Year	2.02	94.34	95.19	0.93	4.73
2175.53*	(4) 10-Year	1.57	94.34	95.12	0.86	4.26
2175.53*	(4) 25-Year	2.25	94.34	95.23	0.96	8.33
2175.53*	(4) 100-Year	2.86	94.34	95.30	0.98	35.25
2157	(2) 2-Year	4.13	94.31	95.18	1.86	10.06
2157	(2) 5-Year	5.24	94.31	95.34	1.37	13.33
2157	(2) 10-Year	6.01	94.31	95.38	1.22	16.37
2157	(2) 25-Year	6.94	94.31	95.43	1.14	21.39
2157	(2) 100-Year	8.32	94.31	95.49	1.02	32.87
2157	(4) 2-Year	3.97	94.31	95.16	1.91	9.17
2157	(4) 5-Year	2.02	94.31	94.94	1.78	4.70
2157	(4) 10-Year	1.57	94.31	94.88	1.70	4.24
2157	(4) 25-Year	2.25	94.31	94.97	1.81	8.29
2157	(4) 100-Year	2.86	94.31	95.03	1.90	35.20
2076	(2) 2-Year	5.00	93.86	95.01	0.91	9.75
2076	(2) 5-Year	6.32	93.86	95.14	0.95	12.81
2076	(2) 10-Year	7.24	93.86	95.21	0.96	15.68
2076	(2) 25-Year	8.38	93.86	95.27	0.95	20.49
2076	(2) 100-Year	10.81	93.86	95.35	0.96	31.59

Table B-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2076	(4) 2-Year	4.78	93.86	94.98	0.91	8.88
2076	(4) 5-Year	2.34	93.86	94.63	0.77	4.53
2076	(4) 10-Year	1.78	93.86	94.52	0.72	4.10
2076	(4) 25-Year	2.60	93.86	94.67	0.79	8.11
2076	(4) 100-Year	3.29	93.86	94.79	0.83	34.98
1974	(2) 2-Year	5.00	93.68	94.85	0.88	9.20
1974	(2) 5-Year	6.32	93.68	94.99	0.93	12.10
1974	(2) 10-Year	7.24	93.68	95.05	0.96	14.73
1974	(2) 25-Year	8.38	93.68	95.11	0.98	19.20
1974	(2) 100-Year	10.81	93.68	95.20	1.00	29.64
1974	(4) 2-Year	4.78	93.68	94.82	0.88	8.35
1974	(4) 5-Year	2.34	93.68	94.46	0.76	4.23
1974	(4) 10-Year	1.78	93.68	94.35	0.71	3.86
1974	(4) 25-Year	2.60	93.68	94.51	0.78	7.79
1974	(4) 100-Year	3.29	93.68	94.62	0.80	34.59
1922	(2) 2-Year	5.00	93.59	94.77	0.89	8.92
1922	(2) 5-Year	6.32	93.59	94.90	0.94	11.76
1922	(2) 10-Year	7.24	93.59	94.96	1.00	14.32
1922	(2) 25-Year	8.38	93.59	95.01	1.07	18.67
1922	(2) 100-Year	10.81	93.59	95.08	1.18	28.85
1922	(4) 2-Year	4.78	93.59	94.74	0.89	8.08
1922	(4) 5-Year	2.34	93.59	94.37	0.76	4.08
1922	(4) 10-Year	1.78	93.59	94.26	0.71	3.73
1922	(4) 25-Year	2.60	93.59	94.42	0.77	7.62
1922	(4) 100-Year	3.29	93.59	94.55	0.80	34.38
1833	(2) 2-Year	5.00	93.44	94.63	0.82	8.40
1833	(2) 5-Year	6.32	93.44	94.77	0.84	11.10
1833	(2) 10-Year	7.24	93.44	94.83	0.82	13.41
1833	(2) 25-Year	8.38	93.44	94.89	0.80	17.44
1833	(2) 100-Year	10.81	93.44	94.98	0.81	27.04
1833	(4) 2-Year	4.78	93.44	94.60	0.82	7.58
1833	(4) 5-Year	2.34	93.44	94.24	0.73	3.80
1833	(4) 10-Year	1.78	93.44	94.12	0.69	3.51
1833	(4) 25-Year	2.60	93.44	94.29	0.74	7.31
1833	(4) 100-Year	3.29	93.44	94.42	0.76	34.01
1796	(2) 2-Year	5.00	93.37	94.57	0.87	8.19
1796	(2) 5-Year	6.32	93.37	94.70	0.93	10.83
1796	(2) 10-Year	7.24	93.37	94.76	0.99	13.05
1796	(2) 25-Year	8.38	93.37	94.81	1.06	16.97
1796	(2) 100-Year	10.81	93.37	94.88	1.20	26.38
1796	(4) 2-Year	4.78	93.37	94.54	0.86	7.38
1796	(4) 5-Year	2.34	93.37	94.19	0.71	3.68
1796	(4) 10-Year	1.78	93.37	94.06	0.68	3.41
1796	(4) 25-Year	2.60	93.37	94.24	0.73	7.19
1796	(4) 100-Year	3.29	93.37	94.37	0.75	33.85
1735	(2) 2-Year	5.00	93.26	94.50	0.77	7.83
1735	(2) 5-Year	6.32	93.26	94.63	0.80	10.38

Table B-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1735	(2) 10-Year	7.24	93.26	94.70	0.80	12.45
1735	(2) 25-Year	8.38	93.26	94.77	0.74	16.06
1735	(2) 100-Year	10.81	93.26	94.85	0.69	24.90
1735	(4) 2-Year	4.78	93.26	94.47	0.76	7.04
1735	(4) 5-Year	2.34	93.26	94.11	0.66	3.49
1735	(4) 10-Year	1.78	93.26	93.98	0.64	3.26
1735	(4) 25-Year	2.60	93.26	94.17	0.67	6.97
1735	(4) 100-Year	3.29	93.26	94.31	0.67	33.58
1728	(2) 2-Year	5.00	93.25	94.47	1.00	7.79
1728	(2) 5-Year	6.32	93.25	94.59	1.07	10.33
1728	(2) 10-Year	7.24	93.25	94.65	1.14	12.38
1728	(2) 25-Year	8.38	93.25	94.71	1.19	15.95
1728	(2) 100-Year	10.81	93.25	94.81	1.12	24.69
1728	(4) 2-Year	4.78	93.25	94.44	0.99	7.00
1728	(4) 5-Year	2.34	93.25	94.09	0.82	3.46
1728	(4) 10-Year	1.78	93.25	93.96	0.78	3.24
1728	(4) 25-Year	2.60	93.25	94.14	0.84	6.94
1728	(4) 100-Year	3.29	93.25	94.29	0.85	33.55
1717	(2) 2-Year	5.00	93.24	94.44	1.03	7.74
1717	(2) 5-Year	6.32	93.24	94.56	1.11	10.26
1717	(2) 10-Year	7.24	93.24	94.61	1.18	12.30
1717	(2) 25-Year	8.38	93.24	94.66	1.28	15.86
1717	(2) 100-Year	10.81	93.24	94.73	1.45	24.52
1717	(4) 2-Year	4.78	93.24	94.41	1.02	6.94
1717	(4) 5-Year	2.34	93.24	94.06	0.85	3.43
1717	(4) 10-Year	1.78	93.24	93.93	0.81	3.21
1717	(4) 25-Year	2.60	93.24	94.11	0.87	6.91
1717	(4) 100-Year	3.29	93.24	94.26	0.87	33.51
1615	(2) 2-Year	5.00	93.05	94.28	0.84	7.18
1615	(2) 5-Year	6.32	93.05	94.40	0.89	9.52
1615	(2) 10-Year	7.24	93.05	94.46	0.88	11.35
1615	(2) 25-Year	8.38	93.05	94.52	0.88	14.62
1615	(2) 100-Year	10.81	93.05	94.62	0.84	22.57
1615	(4) 2-Year	4.78	93.05	94.25	0.83	6.41
1615	(4) 5-Year	2.34	93.05	93.92	0.65	3.11
1615	(4) 10-Year	1.78	93.05	93.77	0.64	2.96
1615	(4) 25-Year	2.60	93.05	93.97	0.66	6.56
1615	(4) 100-Year	3.29	93.05	94.15	0.65	33.06
1555	(2) 2-Year	5.00	92.94	94.21	0.79	6.82
1555	(2) 5-Year	6.32	92.94	94.33	0.86	9.01
1555	(2) 10-Year	7.24	92.94	94.39	0.89	10.68
1555	(2) 25-Year	8.38	92.94	94.45	0.92	13.73
1555	(2) 100-Year	10.81	92.94	94.54	0.98	21.28
1555	(4) 2-Year	4.78	92.94	94.19	0.79	6.06
1555	(4) 5-Year	2.34	92.94	93.86	0.60	2.89
1555	(4) 10-Year	1.78	92.94	93.71	0.59	2.79
1555	(4) 25-Year	2.60	92.94	93.92	0.61	6.32
1555	(4) 100-Year	3.29	92.94	94.11	0.59	32.74

Table B-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1488	(2) 2-Year	5.00	92.82	94.15	0.73	6.39
1488	(2) 5-Year	6.32	92.82	94.25	0.82	8.47
1488	(2) 10-Year	7.24	92.82	94.31	0.87	10.04
1488	(2) 25-Year	8.38	92.82	94.36	0.93	12.96
1488	(2) 100-Year	10.81	92.82	94.43	1.06	20.28
1488	(4) 2-Year	4.78	92.82	94.12	0.73	5.64
1488	(4) 5-Year	2.34	92.82	93.81	0.54	2.62
1488	(4) 10-Year	1.78	92.82	93.65	0.52	2.58
1488	(4) 25-Year	2.60	92.82	93.88	0.55	6.02
1488	(4) 100-Year	3.29	92.82	94.07	0.53	32.36
1416	(2) 2-Year	5.00	92.71	94.00	1.11	6.00
1416	(2) 5-Year	6.32	92.71	94.08	1.27	8.01
1416	(2) 10-Year	7.24	92.71	94.12	1.34	9.48
1416	(2) 25-Year	8.38	92.71	94.18	1.35	12.25
1416	(2) 100-Year	10.81	92.71	94.28	1.32	19.24
1416	(4) 2-Year	4.78	92.71	93.98	1.11	5.27
1416	(4) 5-Year	2.34	92.71	93.73	0.75	2.36
1416	(4) 10-Year	1.78	92.71	93.57	0.73	2.38
1416	(4) 25-Year	2.60	92.71	93.80	0.77	5.74
1416	(4) 100-Year	3.29	92.71	94.01	0.73	31.99
1400	(2) 2-Year	5.00	92.68	94.00	0.70	5.91
1400	(2) 5-Year	6.32	92.68	94.08	0.80	7.90
1400	(2) 10-Year	7.24	92.68	94.12	0.86	9.35
1400	(2) 25-Year	8.38	92.68	94.17	0.93	12.10
1400	(2) 100-Year	10.81	92.68	94.25	1.10	19.02
1400	(4) 2-Year	4.78	92.68	93.97	0.70	5.18
1400	(4) 5-Year	2.34	92.68	93.73	0.51	2.30
1400	(4) 10-Year	1.78	92.68	93.56	0.51	2.33
1400	(4) 25-Year	2.60	92.68	93.79	0.51	5.67
1400	(4) 100-Year	3.29	92.68	94.01	0.46	31.90
1364	(2) 2-Year	5.00	92.62	93.97	0.73	5.66
1364	(2) 5-Year	6.32	92.62	94.03	0.85	7.62
1364	(2) 10-Year	7.24	92.62	94.06	0.93	9.06
1364	(2) 25-Year	8.38	92.62	94.10	1.03	11.79
1364	(2) 100-Year	10.81	92.62	94.15	1.27	18.68
1364	(4) 2-Year	4.78	92.62	93.94	0.72	4.94
1364	(4) 5-Year	2.34	92.62	93.71	0.47	2.13
1364	(4) 10-Year	1.78	92.62	93.54	0.46	2.20
1364	(4) 25-Year	2.60	92.62	93.77	0.48	5.48
1364	(4) 100-Year	3.29	92.62	93.99	0.46	31.64
1340	(2) 2-Year	5.79	92.61	93.97	0.42	5.41
1340	(2) 5-Year	7.32	92.61	94.04	0.51	7.36
1340	(2) 10-Year	8.34	92.61	94.07	0.57	8.79
1340	(2) 25-Year	9.65	92.61	94.11	0.64	11.50
1340	(2) 100-Year	11.62	92.61	94.16	0.74	18.38
1340	(4) 2-Year	5.26	92.61	93.94	0.40	4.70
1340	(4) 5-Year	2.44	92.61	93.71	0.22	1.94

Table B-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1340	(4) 10-Year	1.86	92.61	93.54	0.20	2.05
1340	(4) 25-Year	2.71	92.61	93.78	0.23	5.28
1340	(4) 100-Year	3.43	92.61	93.99	0.25	31.39
1312	(2) 2-Year	6.08	92.47	93.95	0.71	5.07
1312	(2) 5-Year	7.69	92.47	94.00	0.85	7.00
1312	(2) 10-Year	8.76	92.47	94.03	0.95	8.41
1312	(2) 25-Year	10.15	92.47	94.06	1.08	11.11
1312	(2) 100-Year	12.20	92.47	94.09	1.27	17.96
1312	(4) 2-Year	5.46	92.47	93.92	0.65	4.37
1312	(4) 5-Year	2.47	92.47	93.71	0.36	1.67
1312	(4) 10-Year	1.87	92.47	93.54	0.32	1.82
1312	(4) 25-Year	2.73	92.47	93.77	0.37	4.99
1312	(4) 100-Year	3.44	92.47	93.99	0.39	31.03
1302	(2) 2-Year	6.08	92.57	93.91	1.03	4.98
1302	(2) 5-Year	7.69	92.57	93.97	1.13	6.90
1302	(2) 10-Year	8.76	92.57	94.00	1.18	8.31
1302	(2) 25-Year	10.15	92.57	94.04	1.26	11.00
1302	(2) 100-Year	12.20	92.57	94.07	1.39	17.84
1302	(4) 2-Year	5.46	92.57	93.89	0.98	4.28
1302	(4) 5-Year	2.47	92.57	93.68	0.77	1.62
1302	(4) 10-Year	1.87	92.57	93.50	0.85	1.79
1302	(4) 25-Year	2.73	92.57	93.74	0.73	4.94
1302	(4) 100-Year	3.44	92.57	93.98	0.49	30.93
1268	(2) 2-Year	6.08	92.47	93.87	0.59	4.63
1268	(2) 5-Year	7.69	92.47	93.93	0.62	6.46
1268	(2) 10-Year	8.76	92.47	93.96	0.64	7.77
1268	(2) 25-Year	10.15	92.47	94.00	0.67	10.34
1268	(2) 100-Year	12.20	92.47	94.05	0.64	16.97
1268	(4) 2-Year	5.46	92.47	93.84	0.57	3.96
1268	(4) 5-Year	2.47	92.47	93.59	0.68	1.50
1268	(4) 10-Year	1.87	92.47	93.43	0.81	1.71
1268	(4) 25-Year	2.73	92.47	93.67	0.53	4.78
1268	(4) 100-Year	3.44	92.47	93.98	0.24	30.37
1212	(2) 2-Year	6.08	92.36	93.78	0.84	3.93
1212	(2) 5-Year	7.69	92.36	93.85	0.85	5.52
1212	(2) 10-Year	8.76	92.36	93.88	0.86	6.62
1212	(2) 25-Year	10.15	92.36	93.93	0.84	8.90
1212	(2) 100-Year	12.20	92.36	94.00	0.80	15.05
1212	(4) 2-Year	5.46	92.36	93.74	0.83	3.36
1212	(4) 5-Year	2.47	92.36	93.41	0.89	1.32
1212	(4) 10-Year	1.87	92.36	93.30	0.83	1.58
1212	(4) 25-Year	2.73	92.36	93.54	0.74	4.52
1212	(4) 100-Year	3.44	92.36	93.97	0.24	28.89
1169	(2) 2-Year	6.08	92.30	93.70	0.86	3.39
1169	(2) 5-Year	7.69	92.30	93.76	0.91	4.74
1169	(2) 10-Year	8.76	92.30	93.80	0.95	5.69
1169	(2) 25-Year	10.15	92.30	93.84	0.99	7.77

Table B-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1169	(2) 100-Year	12.20	92.30	93.91	1.04	13.62
1169	(4) 2-Year	5.46	92.30	93.67	0.83	2.90
1169	(4) 5-Year	2.47	92.30	93.32	0.73	1.19
1169	(4) 10-Year	1.87	92.30	93.24	0.65	1.47
1169	(4) 25-Year	2.73	92.30	93.49	0.59	4.33
1169	(4) 100-Year	3.44	92.30	93.97	0.28	27.39
1091	(2) 2-Year	6.08	92.15	93.57	0.83	2.61
1091	(2) 5-Year	7.69	92.15	93.64	0.85	3.66
1091	(2) 10-Year	8.76	92.15	93.68	0.88	4.46
1091	(2) 25-Year	10.15	92.15	93.72	0.91	6.34
1091	(2) 100-Year	12.20	92.15	93.80	0.88	11.79
1091	(4) 2-Year	5.46	92.15	93.53	0.82	2.26
1091	(4) 5-Year	2.47	92.15	93.18	0.71	0.93
1091	(4) 10-Year	1.87	92.15	93.14	0.58	1.23
1091	(4) 25-Year	2.73	92.15	93.42	0.51	3.94
1091	(4) 100-Year	3.44	92.15	93.96	0.19	24.73
1002	(2) 2-Year	6.08	92.06	93.36	1.05	1.89
1002	(2) 5-Year	7.69	92.06	93.45	1.07	2.63
1002	(2) 10-Year	8.76	92.06	93.50	1.06	3.23
1002	(2) 25-Year	10.15	92.06	93.57	0.99	4.82
1002	(2) 100-Year	12.20	92.06	93.70	0.86	9.70
1002	(4) 2-Year	5.46	92.06	93.32	1.03	1.66
1002	(4) 5-Year	2.47	92.06	93.00	0.85	0.65
1002	(4) 10-Year	1.87	92.06	93.04	0.60	0.95
1002	(4) 25-Year	2.73	92.06	93.37	0.47	3.41
1002	(4) 100-Year	3.44	92.06	93.96	0.14	20.76
961	(2) 2-Year	6.08	91.96	93.25	0.88	1.61
961	(2) 5-Year	7.69	91.96	93.33	0.93	2.25
961	(2) 10-Year	8.76	91.96	93.39	0.95	2.77
961	(2) 25-Year	10.15	91.96	93.48	0.88	4.19
961	(2) 100-Year	12.20	91.96	93.67	0.55	8.56
961	(4) 2-Year	5.46	91.96	93.22	0.85	1.41
961	(4) 5-Year	2.47	91.96	92.95	0.64	0.51
961	(4) 10-Year	1.87	91.96	93.02	0.43	0.80
961	(4) 25-Year	2.73	91.96	93.35	0.32	3.09
961	(4) 100-Year	3.44	91.96	93.96	0.08	18.01
910	(2) 2-Year	6.08	91.93	93.17	0.79	0.99
910	(2) 5-Year	7.69	91.93	93.26	0.80	1.41
910	(2) 10-Year	8.76	91.93	93.32	0.77	1.75
910	(2) 25-Year	10.15	91.93	93.43	0.70	2.59
910	(2) 100-Year	12.20	91.93	93.65	0.44	4.99
910	(4) 2-Year	5.46	91.93	93.14	0.78	0.86
910	(4) 5-Year	2.47	91.93	92.89	0.67	0.31
910	(4) 10-Year	1.87	91.93	93.00	0.40	0.51
910	(4) 25-Year	2.73	91.93	93.35	0.24	2.01
910	(4) 100-Year	3.44	91.93	93.96	0.06	10.36
840	(2) 2-Year	6.08	91.86	93.10	0.50	0.00

Table B-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Existing Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
840	(2) 5-Year	7.69	91.86	93.21	0.48	0.00
840	(2) 10-Year	8.76	91.86	93.28	0.46	0.00
840	(2) 25-Year	10.15	91.86	93.41	0.41	0.00
840	(2) 100-Year	12.20	91.86	93.64	0.34	0.00
840	(4) 2-Year	5.46	91.86	93.06	0.51	0.00
840	(4) 5-Year	2.47	91.86	92.80	0.52	0.00
840	(4) 10-Year	1.87	91.86	92.97	0.23	0.00
840	(4) 25-Year	2.73	91.86	93.34	0.12	0.00
840	(4) 100-Year	3.44	91.86	93.96	0.05	0.00

⁽¹⁾ All channel infrastructure removed from the HEC-RAS model for riparian storage analysis.

For Scenario 2 (the Van Gaal Drain 100-year spring snowmelt plus rainfall peak flow reaches the Jock River) and Scenario 4 (the Jock River 100-year spring snowmelt plus rainfall peak flow reaches the outlet of the Van Gaal Drain).

Attachment C

HEC-RAS Results for Van Gaal Drain Reach 2
Proposed Conditions (Floodplain Analysis)

Table C-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2554	(1) 25 mm	0.72	94.75	95.24	0.73	1.06
2554	(1) 2-Year	1.95	94.75	95.45	0.99	0.82
2554	(1) 5-Year	3.20	94.75	95.59	1.18	0.68
2554	(1) 10-Year	4.11	94.75	95.67	1.29	0.62
2554	(1) 25-Year	5.28	94.75	95.76	1.40	0.59
2554	(1) 100-Year	7.27	94.75	95.90	1.55	0.59
2478	(1) 25 mm	0.72	94.46	94.93	0.79	1.03
2478	(1) 2-Year	1.95	94.46	95.14	1.09	0.80
2478	(1) 5-Year	3.20	94.46	95.26	1.27	0.66
2478	(1) 10-Year	4.11	94.46	95.34	1.37	0.61
2478	(1) 25-Year	5.28	94.46	95.44	1.48	0.58
2478	(1) 100-Year	7.27	94.46	95.58	1.63	0.58
2434.60*	(1) 25 mm	0.72	94.28	94.75	0.80	1.01
2434.60*	(1) 2-Year	1.95	94.28	94.96	1.09	0.79
2434.60*	(1) 5-Year	3.20	94.28	95.09	1.27	0.65
2434.60*	(1) 10-Year	4.11	94.28	95.17	1.36	0.60
2434.60*	(1) 25-Year	5.28	94.28	95.26	1.46	0.57
2434.60*	(1) 100-Year	7.27	94.28	95.41	1.59	0.57
2434.60*	(1) 25 mm	0.72	94.10	94.57	0.79	1.00
2434.60*	(1) 2-Year	1.95	94.10	94.78	1.09	0.78
2434.60*	(1) 5-Year	3.20	94.10	94.92	1.25	0.64
2434.60*	(1) 10-Year	4.11	94.10	95.00	1.33	0.59
2391.20*	(1) 25-Year	5.28	94.10	95.11	1.41	0.56
2391.20*	(1) 100-Year	7.27	94.10	95.27	1.52	0.56
2391.20*	(1) 25 mm	0.72	93.93	94.40	0.79	0.98
2391.20*	(1) 2-Year	1.95	93.93	94.61	1.06	0.77
2391.20*	(1) 5-Year	3.20	93.93	94.77	1.16	0.63
2391.20*	(1) 10-Year	4.11	93.93	94.87	1.22	0.58
2391.20*	(1) 25-Year	5.28	93.93	94.98	1.29	0.55
2391.20*	(1) 100-Year	7.27	93.93	95.16	1.39	0.56
2391.20*	(1) 25 mm	0.72	93.75	94.24	0.73	0.97
2347.80*	(1) 2-Year	1.95	93.75	94.49	0.89	0.76
2347.80*	(1) 5-Year	3.20	93.75	94.68	0.97	0.62
2347.80*	(1) 10-Year	4.11	93.75	94.78	1.04	0.57
2347.80*	(1) 25-Year	5.28	93.75	94.90	1.12	0.54
2347.80*	(1) 100-Year	7.27	93.75	95.08	1.23	0.55
2347.80*	(1) 25 mm	0.72	93.57	94.18	0.49	0.95
2347.80*	(1) 2-Year	1.95	93.57	94.44	0.66	0.74
2347.80*	(1) 5-Year	3.20	93.57	94.63	0.78	0.60
2347.80*	(1) 10-Year	4.11	93.57	94.73	0.86	0.55
2347.80*	(1) 25-Year	5.28	93.57	94.85	0.95	0.53
2304.40*	(1) 100-Year	7.27	93.57	95.03	1.07	0.54
2304.40*	(1) 25 mm	0.72	93.57	94.14	0.56	0.93
2304.40*	(1) 2-Year	1.95	93.57	94.41	0.72	0.73
2304.40*	(1) 5-Year	3.20	93.57	94.60	0.82	0.59

Table C-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2304.40*	(1) 10-Year	4.11	93.57	94.70	0.90	0.55
2304.40*	(1) 25-Year	5.28	93.57	94.81	0.99	0.52
2304.40*	(1) 100-Year	7.27	93.57	94.99	1.11	0.53
2304.40*						
2304.40*	(1) 25 mm	0.72	93.49	94.12	0.46	0.92
2256	(1) 2-Year	1.95	93.49	94.39	0.63	0.72
2256	(1) 5-Year	3.20	93.49	94.58	0.75	0.59
2256	(1) 10-Year	4.11	93.49	94.68	0.81	0.54
2256	(1) 25-Year	5.28	93.49	94.80	0.88	0.51
2256	(1) 100-Year	7.27	93.49	94.98	0.96	0.52
2254	(1) 25 mm	0.72	93.46	94.11	0.44	0.91
2254	(1) 2-Year	1.95	93.46	94.38	0.62	0.71
2254	(1) 5-Year	3.20	93.46	94.56	0.73	0.58
2254	(1) 10-Year	4.11	93.46	94.67	0.80	0.53
2254	(1) 25-Year	5.28	93.46	94.78	0.87	0.51
2254	(1) 100-Year	7.27	93.46	94.96	0.95	0.52
2235	(1) 25 mm	0.72	93.44	94.10	0.43	0.90
2235	(1) 2-Year	1.95	93.44	94.36	0.60	0.70
2235	(1) 5-Year	3.20	93.44	94.55	0.72	0.57
2235	(1) 10-Year	4.11	93.44	94.65	0.78	0.53
2235	(1) 25-Year	5.28	93.44	94.77	0.85	0.50
2235	(1) 100-Year	7.27	93.44	94.95	0.94	0.51
2207	(1) 25 mm	0.72	93.40	94.08	0.40	0.88
2207	(1) 2-Year	1.95	93.40	94.35	0.59	0.69
2207	(1) 5-Year	3.20	93.40	94.53	0.71	0.56
2207	(1) 10-Year	4.11	93.40	94.63	0.78	0.52
2207	(1) 25-Year	5.28	93.40	94.74	0.85	0.49
2207	(1) 100-Year	7.27	93.40	94.92	0.94	0.50
2188	(1) 25 mm	1.16	93.37	94.05	0.65	0.87
2188	(1) 2-Year	2.80	93.37	94.31	0.84	0.68
2188	(1) 5-Year	4.41	93.37	94.49	0.98	0.56
2188	(1) 10-Year	5.53	93.37	94.59	1.05	0.51
2188	(1) 25-Year	6.96	93.37	94.71	1.12	0.49
2188	(1) 100-Year	9.54	93.37	94.88	1.23	0.50
2163	(1) 25 mm	1.16	93.34	94.02	0.65	0.86
2163	(1) 2-Year	2.80	93.34	94.28	0.84	0.67
2163	(1) 5-Year	4.41	93.34	94.46	0.97	0.55
2163	(1) 10-Year	5.53	93.34	94.56	1.04	0.50
2163	(1) 25-Year	6.96	93.34	94.67	1.11	0.48
2163	(1) 100-Year	9.54	93.34	94.85	1.22	0.49
2141	(1) 25 mm	1.16	93.31	93.99	0.65	0.85
2141	(1) 2-Year	2.80	93.31	94.25	0.83	0.67
2141	(1) 5-Year	4.41	93.31	94.43	0.97	0.54
2141	(1) 10-Year	5.53	93.31	94.53	1.04	0.50
2141	(1) 25-Year	6.96	93.31	94.65	1.11	0.48
2141	(1) 100-Year	9.54	93.31	94.82	1.22	0.49

Table C-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2121	(1) 25 mm	1.16	93.28	93.96	0.64	0.84
2121	(1) 2-Year	2.80	93.28	94.23	0.83	0.66
2121	(1) 5-Year	4.41	93.28	94.41	0.96	0.54
2121	(1) 10-Year	5.53	93.28	94.51	1.03	0.49
2121	(1) 25-Year	6.96	93.28	94.62	1.11	0.47
2121	(1) 100-Year	9.54	93.28	94.80	1.22	0.48
2101	(1) 25 mm	1.16	93.26	93.94	0.66	0.83
2101	(1) 2-Year	2.80	93.26	94.20	0.84	0.65
2101	(1) 5-Year	4.41	93.26	94.38	0.97	0.53
2101	(1) 10-Year	5.53	93.26	94.48	1.04	0.49
2101	(1) 25-Year	6.96	93.26	94.59	1.12	0.47
2101	(1) 100-Year	9.54	93.26	94.77	1.23	0.48
2080	(1) 25 mm	1.16	93.24	93.90	0.68	0.82
2080	(1) 2-Year	2.80	93.24	94.17	0.85	0.65
2080	(1) 5-Year	4.41	93.24	94.35	0.99	0.52
2080	(1) 10-Year	5.53	93.24	94.45	1.06	0.48
2080	(1) 25-Year	6.96	93.24	94.56	1.14	0.46
2080	(1) 100-Year	9.54	93.24	94.74	1.24	0.47
2059	(1) 25 mm	1.16	93.21	93.87	0.69	0.81
2059	(1) 2-Year	2.80	93.21	94.14	0.85	0.64
2059	(1) 5-Year	4.41	93.21	94.32	0.99	0.52
2059	(1) 10-Year	5.53	93.21	94.42	1.06	0.48
2059	(1) 25-Year	6.96	93.21	94.53	1.14	0.46
2059	(1) 100-Year	9.54	93.21	94.71	1.24	0.47
2038	(1) 25 mm	1.16	93.18	93.84	0.70	0.81
2038	(1) 2-Year	2.80	93.18	94.12	0.84	0.63
2038	(1) 5-Year	4.41	93.18	94.30	0.98	0.51
2038	(1) 10-Year	5.53	93.18	94.40	1.05	0.47
2038	(1) 25-Year	6.96	93.18	94.51	1.12	0.45
2038	(1) 100-Year	9.54	93.18	94.68	1.23	0.46
2017	(1) 25 mm	1.16	93.17	93.82	0.71	0.80
2017	(1) 2-Year	2.80	93.17	94.11	0.85	0.63
2017	(1) 5-Year	4.41	93.17	94.28	1.00	0.51
2017	(1) 10-Year	5.53	93.17	94.38	1.07	0.47
2017	(1) 25-Year	6.96	93.17	94.49	1.14	0.45
2017	(1) 100-Year	9.54	93.17	94.67	1.25	0.46
2003	(1) 25 mm	1.16	93.16	93.81	0.73	0.80
2003	(1) 2-Year	2.80	93.16	94.10	0.86	0.63
2003	(1) 5-Year	4.41	93.16	94.27	1.00	0.51
2003	(1) 10-Year	5.53	93.16	94.37	1.07	0.47
2003	(1) 25-Year	6.96	93.16	94.48	1.15	0.45
2003	(1) 100-Year	9.54	93.16	94.66	1.26	0.46
1982	(1) 25 mm	1.16	93.12	93.77	0.71	0.79
1982	(1) 2-Year	2.80	93.12	94.07	0.82	0.62

Table C-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1982	(1) 5-Year	4.41	93.12	94.25	0.97	0.50
1982	(1) 10-Year	5.53	93.12	94.34	1.04	0.46
1982	(1) 25-Year	6.96	93.12	94.46	1.11	0.44
1982	(1) 100-Year	9.54	93.12	94.63	1.22	0.46
1961	(1) 25 mm	1.16	93.08	93.74	0.70	0.78
1961	(1) 2-Year	2.80	93.08	94.05	0.80	0.62
1961	(1) 5-Year	4.41	93.08	94.22	0.94	0.50
1961	(1) 10-Year	5.53	93.08	94.32	1.01	0.46
1961	(1) 25-Year	6.96	93.08	94.43	1.09	0.44
1961	(1) 100-Year	9.54	93.08	94.61	1.20	0.45
1940	(1) 25 mm	1.16	93.04	93.70	0.68	0.78
1940	(1) 2-Year	2.80	93.04	94.03	0.77	0.61
1940	(1) 5-Year	4.41	93.04	94.20	0.92	0.49
1940	(1) 10-Year	5.53	93.04	94.30	0.99	0.45
1940	(1) 25-Year	6.96	93.04	94.41	1.07	0.43
1940	(1) 100-Year	9.54	93.04	94.58	1.18	0.45
1919	(1) 25 mm	1.16	93.01	93.67	0.68	0.77
1919	(1) 2-Year	2.80	93.01	94.01	0.75	0.60
1919	(1) 5-Year	4.41	93.01	94.18	0.90	0.49
1919	(1) 10-Year	5.53	93.01	94.27	0.97	0.45
1919	(1) 25-Year	6.96	93.01	94.38	1.05	0.43
1919	(1) 100-Year	9.54	93.01	94.56	1.16	0.44
1898	(1) 25 mm	1.16	92.97	93.64	0.66	0.76
1898	(1) 2-Year	2.80	92.97	93.99	0.72	0.59
1898	(1) 5-Year	4.41	92.97	94.16	0.87	0.48
1898	(1) 10-Year	5.53	92.97	94.25	0.94	0.44
1898	(1) 25-Year	6.96	92.97	94.36	1.03	0.42
1898	(1) 100-Year	9.54	92.97	94.54	1.14	0.44
1877	(1) 25 mm	1.16	92.93	93.61	0.64	0.75
1877	(1) 2-Year	2.80	92.93	93.97	0.70	0.59
1877	(1) 5-Year	4.41	92.93	94.14	0.84	0.47
1877	(1) 10-Year	5.53	92.93	94.24	0.91	0.43
1877	(1) 25-Year	6.96	92.93	94.34	1.00	0.42
1877	(1) 100-Year	9.54	92.93	94.52	1.12	0.43
1857	(1) 25 mm	1.16	92.89	93.59	0.62	0.74
1857	(1) 2-Year	2.80	92.89	93.96	0.67	0.58
1857	(1) 5-Year	4.41	92.89	94.12	0.81	0.47
1857	(1) 10-Year	5.53	92.89	94.22	0.89	0.43
1857	(1) 25-Year	6.96	92.89	94.32	0.98	0.41
1857	(1) 100-Year	9.54	92.89	94.50	1.10	0.43
1837	(1) 25 mm	1.16	92.86	93.57	0.60	0.73
1837	(1) 2-Year	2.80	92.86	93.95	0.65	0.57
1837	(1) 5-Year	4.41	92.86	94.11	0.79	0.46
1837	(1) 10-Year	5.53	92.86	94.20	0.87	0.42
1837	(1) 25-Year	6.96	92.86	94.31	0.96	0.40

Table C-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1837	(1) 100-Year	9.54	92.86	94.48	1.08	0.42
1817	(1) 25 mm	1.16	92.81	93.55	0.56	0.72
1817	(1) 2-Year	2.80	92.81	93.94	0.62	0.56
1817	(1) 5-Year	4.41	92.81	94.10	0.76	0.45
1817	(1) 10-Year	5.53	92.81	94.19	0.84	0.41
1817	(1) 25-Year	6.96	92.81	94.29	0.93	0.40
1817	(1) 100-Year	9.54	92.81	94.46	1.05	0.42
1797	(1) 25 mm	1.16	92.77	93.53	0.52	0.71
1797	(1) 2-Year	2.80	92.77	93.93	0.58	0.55
1797	(1) 5-Year	4.41	92.77	94.08	0.73	0.44
1797	(1) 10-Year	5.53	92.77	94.17	0.81	0.41
1797	(1) 25-Year	6.96	92.77	94.27	0.90	0.39
1797	(1) 100-Year	9.54	92.77	94.45	1.03	0.41
1777	(1) 25 mm	1.16	92.73	93.52	0.48	0.70
1777	(1) 2-Year	2.80	92.73	93.92	0.55	0.54
1777	(1) 5-Year	4.41	92.73	94.07	0.69	0.44
1777	(1) 10-Year	5.53	92.73	94.16	0.78	0.40
1777	(1) 25-Year	6.96	92.73	94.26	0.87	0.39
1777	(1) 100-Year	9.54	92.73	94.43	0.99	0.41
1757	(1) 25 mm	1.16	92.69	93.51	0.46	0.69
1757	(1) 2-Year	2.80	92.69	93.91	0.53	0.53
1757	(1) 5-Year	4.41	92.69	94.06	0.67	0.43
1757	(1) 10-Year	5.53	92.69	94.15	0.75	0.39
1757	(1) 25-Year	6.96	92.69	94.25	0.85	0.38
1757	(1) 100-Year	9.54	92.69	94.42	0.98	0.40
1736	(1) 25 mm	1.16	92.66	93.50	0.43	0.68
1736	(1) 2-Year	2.80	92.66	93.91	0.50	0.52
1736	(1) 5-Year	4.41	92.66	94.06	0.65	0.42
1736	(1) 10-Year	5.53	92.66	94.14	0.73	0.39
1736	(1) 25-Year	6.96	92.66	94.24	0.82	0.37
1736	(1) 100-Year	9.54	92.66	94.40	0.95	0.40
1715	(1) 25 mm	1.16	92.62	93.50	0.40	0.66
1715	(1) 2-Year	2.80	92.62	93.90	0.48	0.51
1715	(1) 5-Year	4.41	92.62	94.05	0.61	0.41
1715	(1) 10-Year	5.53	92.62	94.13	0.70	0.38
1715	(1) 25-Year	6.96	92.62	94.23	0.79	0.37
1715	(1) 100-Year	9.54	92.62	94.39	0.92	0.39
1694	(1) 25 mm	1.16	92.58	93.49	0.38	0.65
1694	(1) 2-Year	2.80	92.58	93.90	0.46	0.50
1694	(1) 5-Year	4.41	92.58	94.04	0.59	0.40
1694	(1) 10-Year	5.53	92.58	94.13	0.68	0.37
1694	(1) 25-Year	6.96	92.58	94.22	0.77	0.36
1694	(1) 100-Year	9.54	92.58	94.38	0.90	0.38
1673	(1) 25 mm	1.16	92.53	93.49	0.35	0.63

Table C-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1673	(1) 2-Year	2.80	92.53	93.89	0.43	0.48
1673	(1) 5-Year	4.41	92.53	94.04	0.57	0.39
1673	(1) 10-Year	5.53	92.53	94.12	0.65	0.36
1673	(1) 25-Year	6.96	92.53	94.21	0.74	0.35
1673	(1) 100-Year	9.54	92.53	94.37	0.87	0.38
1653	(1) 25 mm	1.16	92.50	93.48	0.33	0.62
1653	(1) 2-Year	2.80	92.50	93.89	0.41	0.47
1653	(1) 5-Year	4.41	92.50	94.03	0.55	0.38
1653	(1) 10-Year	5.53	92.50	94.11	0.63	0.35
1653	(1) 25-Year	6.96	92.50	94.20	0.72	0.34
1653	(1) 100-Year	9.54	92.50	94.36	0.85	0.37
1632	(1) 25 mm	1.16	92.46	93.48	0.31	0.60
1632	(1) 2-Year	2.80	92.46	93.89	0.40	0.46
1632	(1) 5-Year	4.41	92.46	94.03	0.53	0.37
1632	(1) 10-Year	5.53	92.46	94.11	0.61	0.34
1632	(1) 25-Year	6.96	92.46	94.20	0.71	0.34
1632	(1) 100-Year	9.54	92.46	94.35	0.84	0.36
1615	(1) 25 mm	1.16	92.43	93.48	0.31	0.58
1615	(1) 2-Year	2.80	92.43	93.88	0.38	0.45
1615	(1) 5-Year	4.41	92.43	94.02	0.51	0.36
1615	(1) 10-Year	5.53	92.43	94.10	0.59	0.34
1615	(1) 25-Year	6.96	92.43	94.19	0.68	0.33
1615	(1) 100-Year	9.54	92.43	94.35	0.81	0.36
1555	(1) 25 mm	1.16	92.35	93.47	0.28	0.53
1555	(1) 2-Year	2.80	92.35	93.88	0.35	0.40
1555	(1) 5-Year	4.41	92.35	94.01	0.47	0.33
1555	(1) 10-Year	5.53	92.35	94.09	0.55	0.31
1555	(1) 25-Year	6.96	92.35	94.17	0.64	0.30
1555	(1) 100-Year	9.54	92.35	94.33	0.76	0.34
1488	(1) 25 mm	1.16	92.28	93.46	0.24	0.46
1488	(1) 2-Year	2.80	92.28	93.87	0.32	0.35
1488	(1) 5-Year	4.41	92.28	94.00	0.44	0.29
1488	(1) 10-Year	5.53	92.28	94.08	0.51	0.27
1488	(1) 25-Year	6.96	92.28	94.16	0.60	0.27
1488	(1) 100-Year	9.54	92.28	94.31	0.72	0.31
1416	(1) 25 mm	1.16	92.20	93.46	0.21	0.38
1416	(1) 2-Year	2.80	92.20	93.87	0.30	0.29
1416	(1) 5-Year	4.41	92.20	94.00	0.41	0.25
1416	(1) 10-Year	5.53	92.20	94.07	0.48	0.24
1416	(1) 25-Year	6.96	92.20	94.15	0.57	0.25
1416	(1) 100-Year	9.54	92.20	94.29	0.70	0.29
1400	(1) 25 mm	1.16	92.17	93.46	0.20	0.35
1400	(1) 2-Year	2.80	92.17	93.87	0.29	0.27
1400	(1) 5-Year	4.41	92.17	93.99	0.40	0.23
1400	(1) 10-Year	5.53	92.17	94.06	0.47	0.22

Table C-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1400	(1) 25-Year	6.96	92.17	94.14	0.55	0.23
1400	(1) 100-Year	9.54	92.17	94.28	0.68	0.28
1364	(1) 25 mm	1.16	91.63	93.46	0.08	0.28
1364	(1) 2-Year	2.80	91.63	93.87	0.15	0.22
1364	(1) 5-Year	4.41	91.63	93.99	0.22	0.20
1364	(1) 10-Year	5.53	91.63	94.06	0.26	0.20
1364	(1) 25-Year	6.96	91.63	94.14	0.31	0.21
1364	(1) 100-Year	9.54	91.63	94.28	0.39	0.26
1340	(1) 25 mm	1.53	91.60	93.46	0.18	0.23
1340	(1) 2-Year	3.64	91.60	93.86	0.35	0.20
1340	(1) 5-Year	5.57	91.60	93.98	0.50	0.18
1340	(1) 10-Year	6.92	91.60	94.04	0.61	0.18
1340	(1) 25-Year	8.58	91.60	94.11	0.73	0.20
1340	(1) 100-Year	11.43	91.60	94.24	0.93	0.25
1339		Culvert				
1312	(1) 25 mm	1.53	92.47	93.45	0.32	0.20
1312	(1) 2-Year	3.87	92.47	93.84	0.57	0.18
1312	(1) 5-Year	5.93	92.47	93.95	0.82	0.17
1312	(1) 10-Year	7.38	92.47	94.00	0.99	0.17
1312	(1) 25-Year	9.17	92.47	94.05	1.19	0.19
1312	(1) 100-Year	12.20	92.47	94.13	1.50	0.24
1302	(1) 25 mm	1.53	92.57	93.41	0.83	0.19
1302	(1) 2-Year	3.87	92.57	93.81	0.88	0.17
1302	(1) 5-Year	5.93	92.57	93.92	1.05	0.17
1302	(1) 10-Year	7.38	92.57	93.98	1.15	0.17
1302	(1) 25-Year	9.17	92.57	94.03	1.26	0.19
1302	(1) 100-Year	12.20	92.57	94.15	1.23	0.24
1268	(1) 25 mm	1.53	92.47	93.33	0.79	0.18
1268	(1) 2-Year	3.87	92.47	93.75	0.56	0.16
1268	(1) 5-Year	5.93	92.47	93.88	0.57	0.16
1268	(1) 10-Year	7.38	92.47	93.94	0.60	0.16
1268	(1) 25-Year	9.17	92.47	94.01	0.61	0.18
1268	(1) 100-Year	12.20	92.47	94.14	0.52	0.23
1212	(1) 25 mm	1.53	92.36	93.18	0.86	0.16
1212	(1) 2-Year	3.87	92.36	93.61	0.89	0.14
1212	(1) 5-Year	5.93	92.36	93.77	0.91	0.13
1212	(1) 10-Year	7.38	92.36	93.85	0.93	0.14
1212	(1) 25-Year	9.17	92.36	93.93	0.91	0.16
1212	(1) 100-Year	12.20	92.36	94.10	0.76	0.21
1169	(1) 25 mm	1.53	92.30	93.10	0.69	0.15
1169	(1) 2-Year	3.87	92.30	93.53	0.77	0.13
1169	(1) 5-Year	5.93	92.30	93.70	0.86	0.12
1169	(1) 10-Year	7.38	92.30	93.77	0.91	0.12
1169	(1) 25-Year	9.17	92.30	93.85	0.95	0.14

Table C-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1169	(1) 100-Year	12.20	92.30	94.04	0.88	0.19
1091	(1) 25 mm	1.53	92.15	92.98	0.65	0.11
1091	(1) 2-Year	3.87	92.15	93.40	0.75	0.10
1091	(1) 5-Year	5.93	92.15	93.57	0.82	0.09
1091	(1) 10-Year	7.38	92.15	93.65	0.85	0.10
1091	(1) 25-Year	9.17	92.15	93.75	0.85	0.12
1091	(1) 100-Year	12.20	92.15	93.97	0.82	0.17
1002	(1) 25 mm	1.53	92.06	92.81	0.76	0.08
1002	(1) 2-Year	3.87	92.06	93.21	0.90	0.07
1002	(1) 5-Year	5.93	92.06	93.39	0.98	0.07
1002	(1) 10-Year	7.38	92.06	93.50	0.93	0.07
1002	(1) 25-Year	9.17	92.06	93.65	0.83	0.09
1002	(1) 100-Year	12.20	92.06	93.93	0.64	0.13
961	(1) 25 mm	1.53	91.96	92.77	0.54	0.06
961	(1) 2-Year	3.87	91.96	93.14	0.71	0.05
961	(1) 5-Year	5.93	91.96	93.31	0.76	0.05
961	(1) 10-Year	7.38	91.96	93.44	0.71	0.06
961	(1) 25-Year	9.17	91.96	93.61	0.52	0.07
961	(1) 100-Year	12.20	91.96	93.92	0.35	0.11
910	(1) 25 mm	1.53	91.93	92.72	0.57	0.04
910	(1) 2-Year	3.87	91.93	93.07	0.72	0.03
910	(1) 5-Year	5.93	91.93	93.25	0.73	0.04
910	(1) 10-Year	7.38	91.93	93.40	0.69	0.04
910	(1) 25-Year	9.17	91.93	93.59	0.53	0.05
910	(1) 100-Year	12.20	91.93	93.91	0.33	0.07
840	(1) 25 mm	1.53	91.86	92.64	0.50	0.00
840	(1) 2-Year	3.87	91.86	93.00	0.44	0.00
840	(1) 5-Year	5.93	91.86	93.22	0.36	0.00
840	(1) 10-Year	7.38	91.86	93.38	0.33	0.00
840	(1) 25-Year	9.17	91.86	93.58	0.30	0.00
840	(1) 100-Year	12.20	91.86	93.91	0.25	0.00

⁽¹⁾ All channel infrastructure included in the HEC-RAS model for floodplain analysis.

For Scenario 1 (the Van Gaal Drain 100-year 24-hour SCS peak flow reaches the Jock River).

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2554	(2) 2-Year	4.13	94.75	95.68	1.28	0.69
2554	(2) 5-Year	5.24	94.75	95.77	1.38	0.64
2554	(2) 10-Year	6.00	94.75	95.82	1.44	0.62
2554	(2) 25-Year	6.94	94.75	95.89	1.51	0.63
2554	(2) 100-Year	8.32	94.75	95.98	1.56	0.72
2554	(4) 2-Year	3.97	94.75	95.67	1.26	0.70
2554	(4) 5-Year	2.02	94.75	95.47	1.00	0.92
2554	(4) 10-Year	1.57	94.75	95.40	0.91	1.03
2554	(4) 25-Year	2.25	94.75	95.49	1.04	1.14
2554	(4) 100-Year	2.86	94.75	95.56	1.13	2.31
2478	(2) 2-Year	4.13	94.46	95.34	1.42	0.67
2478	(2) 5-Year	5.24	94.46	95.42	1.54	0.62
2478	(2) 10-Year	6.00	94.46	95.47	1.61	0.61
2478	(2) 25-Year	6.94	94.46	95.53	1.69	0.62
2478	(2) 100-Year	8.32	94.46	95.62	1.79	0.70
2478	(4) 2-Year	3.97	94.46	95.32	1.40	0.68
2478	(4) 5-Year	2.02	94.46	95.14	1.12	0.90
2478	(4) 10-Year	1.57	94.46	95.09	1.03	1.01
2478	(4) 25-Year	2.25	94.46	95.17	1.16	1.12
2478	(4) 100-Year	2.86	94.46	95.23	1.26	2.29
2434.60*	(2) 2-Year	4.13	94.28	95.16	1.35	0.67
2434.60*	(2) 5-Year	5.24	94.28	95.24	1.44	0.61
2434.60*	(2) 10-Year	6.00	94.28	95.30	1.50	0.60
2434.60*	(2) 25-Year	6.94	94.28	95.36	1.56	0.61
2434.60*	(2) 100-Year	8.32	94.28	95.45	1.63	0.70
2434.60*	(4) 2-Year	3.97	94.28	95.15	1.33	0.67
2434.60*	(4) 5-Year	2.02	94.28	94.96	1.10	0.89
2434.60*	(4) 10-Year	1.57	94.28	94.91	1.02	1.00
2434.60*	(4) 25-Year	2.25	94.28	94.99	1.13	1.11
2434.60*	(4) 100-Year	2.86	94.28	95.05	1.21	2.28
2391.20*	(2) 2-Year	4.13	94.10	94.99	1.34	0.66
2391.20*	(2) 5-Year	5.24	94.10	95.08	1.43	0.60
2391.20*	(2) 10-Year	6.00	94.10	95.14	1.48	0.59
2391.20*	(2) 25-Year	6.94	94.10	95.20	1.54	0.60
2391.20*	(2) 100-Year	8.32	94.10	95.30	1.60	0.69
2391.20*	(4) 2-Year	3.97	94.10	94.98	1.32	0.66
2391.20*	(4) 5-Year	2.02	94.10	94.79	1.10	0.88
2391.20*	(4) 10-Year	1.57	94.10	94.73	1.02	0.98
2391.20*	(4) 25-Year	2.25	94.10	94.81	1.13	1.10
2391.20*	(4) 100-Year	2.86	94.10	94.87	1.21	2.27
2347.80*	(2) 2-Year	4.13	93.93	94.84	1.29	0.65
2347.80*	(2) 5-Year	5.24	93.93	94.93	1.37	0.60
2347.80*	(2) 10-Year	6.00	93.93	94.99	1.42	0.58
2347.80*	(2) 25-Year	6.94	93.93	95.06	1.47	0.60
2347.80*	(2) 100-Year	8.32	93.93	95.17	1.52	0.68
2347.80*	(4) 2-Year	3.97	93.93	94.82	1.28	0.65
2347.80*	(4) 5-Year	2.02	93.93	94.61	1.09	0.87
2347.80*	(4) 10-Year	1.57	93.93	94.55	1.02	0.97

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2347.80*	(4) 25-Year	2.25	93.93	94.64	1.12	1.09
2347.80*	(4) 100-Year	2.86	93.93	94.71	1.18	2.26
2304.40*	(2) 2-Year	4.13	93.75	94.72	1.17	0.64
2304.40*	(2) 5-Year	5.24	93.75	94.82	1.25	0.59
2304.40*	(2) 10-Year	6.00	93.75	94.88	1.30	0.57
2304.40*	(2) 25-Year	6.94	93.75	94.95	1.36	0.59
2304.40*	(2) 100-Year	8.32	93.75	95.06	1.41	0.67
2304.40*	(4) 2-Year	3.97	93.75	94.70	1.16	0.64
2304.40*	(4) 5-Year	2.02	93.75	94.47	1.00	0.86
2304.40*	(4) 10-Year	1.57	93.75	94.40	0.95	0.96
2304.40*	(4) 25-Year	2.25	93.75	94.50	1.02	1.07
2304.40*	(4) 100-Year	2.86	93.75	94.58	1.05	2.25
2261	(2) 2-Year	4.13	93.57	94.64	0.99	0.63
2261	(2) 5-Year	5.24	93.57	94.74	1.09	0.58
2261	(2) 10-Year	6.00	93.57	94.80	1.15	0.56
2261	(2) 25-Year	6.94	93.57	94.87	1.22	0.58
2261	(2) 100-Year	8.32	93.57	94.99	1.27	0.66
2261	(4) 2-Year	3.97	93.57	94.62	0.98	0.63
2261	(4) 5-Year	2.02	93.57	94.39	0.78	0.84
2261	(4) 10-Year	1.57	93.57	94.32	0.71	0.94
2261	(4) 25-Year	2.25	93.57	94.42	0.81	1.06
2261	(4) 100-Year	2.86	93.57	94.51	0.85	2.24
2258	(2) 2-Year	4.13	93.57	94.58	1.09	0.62
2258	(2) 5-Year	5.24	93.57	94.67	1.19	0.57
2258	(2) 10-Year	6.00	93.57	94.73	1.26	0.56
2258	(2) 25-Year	6.94	93.57	94.80	1.33	0.57
2258	(2) 100-Year	8.32	93.57	94.92	1.36	0.66
2258	(4) 2-Year	3.97	93.57	94.56	1.08	0.62
2258	(4) 5-Year	2.02	93.57	94.33	0.91	0.83
2258	(4) 10-Year	1.57	93.57	94.26	0.85	0.93
2258	(4) 25-Year	2.25	93.57	94.36	0.93	1.05
2258	(4) 100-Year	2.86	93.57	94.45	0.96	2.23
2256	(2) 2-Year	4.13	93.49	94.56	0.83	0.61
2256	(2) 5-Year	5.24	93.49	94.66	0.88	0.56
2256	(2) 10-Year	6.00	93.49	94.72	0.91	0.55
2256	(2) 25-Year	6.94	93.49	94.79	0.95	0.57
2256	(2) 100-Year	8.32	93.49	94.92	0.95	0.65
2256	(4) 2-Year	3.97	93.49	94.54	0.82	0.62
2256	(4) 5-Year	2.02	93.49	94.30	0.69	0.83
2256	(4) 10-Year	1.57	93.49	94.23	0.66	0.93
2256	(4) 25-Year	2.25	93.49	94.34	0.71	1.04
2256	(4) 100-Year	2.86	93.49	94.44	0.72	2.22
2254	(2) 2-Year	4.13	93.46	94.54	0.81	0.60
2254	(2) 5-Year	5.24	93.46	94.64	0.87	0.56
2254	(2) 10-Year	6.00	93.46	94.70	0.90	0.55
2254	(2) 25-Year	6.94	93.46	94.77	0.94	0.56
2254	(2) 100-Year	8.32	93.46	94.91	0.94	0.65

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2254	(4) 2-Year	3.97	93.46	94.53	0.81	0.61
2254	(4) 5-Year	2.02	93.46	94.28	0.68	0.82
2254	(4) 10-Year	1.57	93.46	94.21	0.65	0.92
2254	(4) 25-Year	2.25	93.46	94.31	0.70	1.04
2254	(4) 100-Year	2.86	93.46	94.42	0.71	2.22
2235	(2) 2-Year	4.13	93.44	94.53	0.80	0.60
2235	(2) 5-Year	5.24	93.44	94.62	0.86	0.55
2235	(2) 10-Year	6.00	93.44	94.68	0.89	0.54
2235	(2) 25-Year	6.94	93.44	94.76	0.92	0.55
2235	(2) 100-Year	8.32	93.44	94.89	0.92	0.64
2235	(4) 2-Year	3.97	93.44	94.51	0.80	0.60
2235	(4) 5-Year	2.02	93.44	94.26	0.68	0.81
2235	(4) 10-Year	1.57	93.44	94.19	0.64	0.91
2235	(4) 25-Year	2.25	93.44	94.29	0.70	1.03
2235	(4) 100-Year	2.86	93.44	94.40	0.69	2.21
2207	(2) 2-Year	4.13	93.40	94.50	0.80	0.59
2207	(2) 5-Year	5.24	93.40	94.60	0.86	0.54
2207	(2) 10-Year	6.00	93.40	94.66	0.89	0.53
2207	(2) 25-Year	6.94	93.40	94.73	0.93	0.55
2207	(2) 100-Year	8.32	93.40	94.87	0.92	0.63
2207	(4) 2-Year	3.97	93.40	94.48	0.80	0.59
2207	(4) 5-Year	2.02	93.40	94.23	0.68	0.80
2207	(4) 10-Year	1.57	93.40	94.16	0.65	0.90
2207	(4) 25-Year	2.25	93.40	94.26	0.70	1.02
2207	(4) 100-Year	2.86	93.40	94.38	0.69	2.20
2188	(2) 2-Year	5.00	93.37	94.47	0.96	0.58
2188	(2) 5-Year	6.32	93.37	94.56	1.03	0.54
2188	(2) 10-Year	7.24	93.37	94.62	1.07	0.53
2188	(2) 25-Year	8.38	93.37	94.69	1.11	0.54
2188	(2) 100-Year	10.81	93.37	94.83	1.20	0.63
2188	(4) 2-Year	4.78	93.37	94.45	0.95	0.59
2188	(4) 5-Year	2.33	93.37	94.20	0.77	0.79
2188	(4) 10-Year	1.78	93.37	94.13	0.71	0.89
2188	(4) 25-Year	2.60	93.37	94.24	0.79	1.01
2188	(4) 100-Year	3.29	93.37	94.36	0.77	2.19
2163	(2) 2-Year	5.00	93.34	94.44	0.95	0.58
2163	(2) 5-Year	6.32	93.34	94.53	1.02	0.53
2163	(2) 10-Year	7.24	93.34	94.59	1.06	0.52
2163	(2) 25-Year	8.38	93.34	94.66	1.10	0.53
2163	(2) 100-Year	10.81	93.34	94.80	1.18	0.62
2163	(4) 2-Year	4.78	93.34	94.42	0.94	0.58
2163	(4) 5-Year	2.33	93.34	94.17	0.77	0.78
2163	(4) 10-Year	1.78	93.34	94.10	0.71	0.88
2163	(4) 25-Year	2.60	93.34	94.20	0.79	1.00
2163	(4) 100-Year	3.29	93.34	94.33	0.75	2.18
2141	(2) 2-Year	5.00	93.31	94.41	0.95	0.57
2141	(2) 5-Year	6.32	93.31	94.50	1.01	0.52

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2141	(2) 10-Year	7.24	93.31	94.56	1.05	0.51
2141	(2) 25-Year	8.38	93.31	94.63	1.10	0.53
2141	(2) 100-Year	10.81	93.31	94.77	1.18	0.62
2141	(4) 2-Year	4.78	93.31	94.39	0.94	0.57
2141	(4) 5-Year	2.33	93.31	94.14	0.76	0.78
2141	(4) 10-Year	1.78	93.31	94.07	0.71	0.87
2141	(4) 25-Year	2.60	93.31	94.17	0.78	0.99
2141	(4) 100-Year	3.29	93.31	94.31	0.74	2.17
2121	(2) 2-Year	5.00	93.28	94.38	0.94	0.56
2121	(2) 5-Year	6.32	93.28	94.48	1.01	0.52
2121	(2) 10-Year	7.24	93.28	94.54	1.05	0.51
2121	(2) 25-Year	8.38	93.28	94.61	1.09	0.52
2121	(2) 100-Year	10.81	93.28	94.74	1.18	0.61
2121	(4) 2-Year	4.78	93.28	94.36	0.93	0.57
2121	(4) 5-Year	2.33	93.28	94.11	0.76	0.77
2121	(4) 10-Year	1.78	93.28	94.04	0.70	0.86
2121	(4) 25-Year	2.60	93.28	94.15	0.78	0.99
2121	(4) 100-Year	3.29	93.28	94.30	0.72	2.17
2101	(2) 2-Year	5.00	93.26	94.35	0.95	0.56
2101	(2) 5-Year	6.32	93.26	94.45	1.02	0.51
2101	(2) 10-Year	7.24	93.26	94.51	1.06	0.50
2101	(2) 25-Year	8.38	93.26	94.58	1.10	0.52
2101	(2) 100-Year	10.81	93.26	94.72	1.19	0.61
2101	(4) 2-Year	4.78	93.26	94.33	0.95	0.56
2101	(4) 5-Year	2.33	93.26	94.09	0.77	0.76
2101	(4) 10-Year	1.78	93.26	94.01	0.72	0.86
2101	(4) 25-Year	2.60	93.26	94.12	0.79	0.98
2101	(4) 100-Year	3.29	93.26	94.28	0.71	2.16
2080	(2) 2-Year	5.00	93.24	94.32	0.97	0.55
2080	(2) 5-Year	6.32	93.24	94.42	1.04	0.51
2080	(2) 10-Year	7.24	93.24	94.48	1.08	0.50
2080	(2) 25-Year	8.38	93.24	94.55	1.12	0.51
2080	(2) 100-Year	10.81	93.24	94.69	1.20	0.60
2080	(4) 2-Year	4.78	93.24	94.30	0.97	0.56
2080	(4) 5-Year	2.33	93.24	94.05	0.80	0.75
2080	(4) 10-Year	1.78	93.24	93.98	0.75	0.85
2080	(4) 25-Year	2.60	93.24	94.09	0.81	0.97
2080	(4) 100-Year	3.29	93.24	94.26	0.71	2.15
2059	(2) 2-Year	5.00	93.21	94.29	0.98	0.55
2059	(2) 5-Year	6.32	93.21	94.39	1.04	0.50
2059	(2) 10-Year	7.24	93.21	94.45	1.08	0.49
2059	(2) 25-Year	8.38	93.21	94.52	1.12	0.51
2059	(2) 100-Year	10.81	93.21	94.66	1.20	0.60
2059	(4) 2-Year	4.78	93.21	94.27	0.97	0.55
2059	(4) 5-Year	2.33	93.21	94.02	0.80	0.75
2059	(4) 10-Year	1.78	93.21	93.94	0.76	0.84
2059	(4) 25-Year	2.60	93.21	94.06	0.81	0.97
2059	(4) 100-Year	3.29	93.21	94.25	0.70	2.14

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
2038	(2) 2-Year	5.00	93.18	94.27	0.96	0.54
2038	(2) 5-Year	6.32	93.18	94.36	1.03	0.50
2038	(2) 10-Year	7.24	93.18	94.43	1.07	0.49
2038	(2) 25-Year	8.38	93.18	94.50	1.11	0.50
2038	(2) 100-Year	10.81	93.18	94.63	1.19	0.59
2038	(4) 2-Year	4.78	93.18	94.25	0.96	0.55
2038	(4) 5-Year	2.33	93.18	93.99	0.80	0.74
2038	(4) 10-Year	1.78	93.18	93.91	0.76	0.83
2038	(4) 25-Year	2.60	93.18	94.03	0.80	0.96
2038	(4) 100-Year	3.29	93.18	94.23	0.67	2.13
2017	(2) 2-Year	5.00	93.17	94.26	0.98	0.54
2017	(2) 5-Year	6.32	93.17	94.35	1.05	0.49
2017	(2) 10-Year	7.24	93.17	94.41	1.09	0.49
2017	(2) 25-Year	8.38	93.17	94.48	1.13	0.50
2017	(2) 100-Year	10.81	93.17	94.62	1.21	0.59
2017	(4) 2-Year	4.78	93.17	94.23	0.98	0.54
2017	(4) 5-Year	2.33	93.17	93.98	0.81	0.74
2017	(4) 10-Year	1.78	93.17	93.90	0.78	0.83
2017	(4) 25-Year	2.60	93.17	94.02	0.82	0.96
2017	(4) 100-Year	3.29	93.17	94.23	0.68	2.13
2003	(2) 2-Year	5.00	93.16	94.24	0.99	0.54
2003	(2) 5-Year	6.32	93.16	94.34	1.06	0.49
2003	(2) 10-Year	7.24	93.16	94.40	1.10	0.48
2003	(2) 25-Year	8.38	93.16	94.47	1.14	0.50
2003	(2) 100-Year	10.81	93.16	94.61	1.22	0.59
2003	(4) 2-Year	4.78	93.16	94.22	0.98	0.54
2003	(4) 5-Year	2.33	93.16	93.97	0.83	0.74
2003	(4) 10-Year	1.78	93.16	93.88	0.81	0.83
2003	(4) 25-Year	2.60	93.16	94.01	0.83	0.95
2003	(4) 100-Year	3.29	93.16	94.22	0.68	2.13
1982	(2) 2-Year	5.00	93.12	94.22	0.95	0.53
1982	(2) 5-Year	6.32	93.12	94.31	1.02	0.49
1982	(2) 10-Year	7.24	93.12	94.38	1.06	0.48
1982	(2) 25-Year	8.38	93.12	94.45	1.10	0.50
1982	(2) 100-Year	10.81	93.12	94.58	1.18	0.59
1982	(4) 2-Year	4.78	93.12	94.20	0.95	0.54
1982	(4) 5-Year	2.33	93.12	93.94	0.79	0.73
1982	(4) 10-Year	1.78	93.12	93.85	0.78	0.82
1982	(4) 25-Year	2.60	93.12	93.98	0.79	0.95
1982	(4) 100-Year	3.29	93.12	94.21	0.63	2.12
1961	(2) 2-Year	5.00	93.08	94.19	0.92	0.52
1961	(2) 5-Year	6.32	93.08	94.29	0.99	0.48
1961	(2) 10-Year	7.24	93.08	94.35	1.03	0.47
1961	(2) 25-Year	8.38	93.08	94.42	1.08	0.49
1961	(2) 100-Year	10.81	93.08	94.56	1.16	0.58
1961	(4) 2-Year	4.78	93.08	94.17	0.92	0.53
1961	(4) 5-Year	2.33	93.08	93.91	0.77	0.72

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1961	(4) 10-Year	1.78	93.08	93.82	0.76	0.81
1961	(4) 25-Year	2.60	93.08	93.96	0.76	0.94
1961	(4) 100-Year	3.29	93.08	94.20	0.60	2.11
1940	(2) 2-Year	5.00	93.04	94.17	0.90	0.52
1940	(2) 5-Year	6.32	93.04	94.27	0.97	0.48
1940	(2) 10-Year	7.24	93.04	94.33	1.01	0.47
1940	(2) 25-Year	8.38	93.04	94.40	1.05	0.48
1940	(2) 100-Year	10.81	93.04	94.54	1.13	0.58
1940	(4) 2-Year	4.78	93.04	94.15	0.89	0.52
1940	(4) 5-Year	2.33	93.04	93.89	0.74	0.71
1940	(4) 10-Year	1.78	93.04	93.78	0.74	0.81
1940	(4) 25-Year	2.60	93.04	93.93	0.73	0.93
1940	(4) 100-Year	3.29	93.04	94.19	0.57	2.10
1919	(2) 2-Year	5.00	93.01	94.15	0.87	0.51
1919	(2) 5-Year	6.32	93.01	94.24	0.94	0.47
1919	(2) 10-Year	7.24	93.01	94.30	0.98	0.46
1919	(2) 25-Year	8.38	93.01	94.38	1.03	0.48
1919	(2) 100-Year	10.81	93.01	94.51	1.11	0.57
1919	(4) 2-Year	4.78	93.01	94.12	0.87	0.52
1919	(4) 5-Year	2.33	93.01	93.86	0.72	0.71
1919	(4) 10-Year	1.78	93.01	93.75	0.73	0.80
1919	(4) 25-Year	2.60	93.01	93.91	0.71	0.93
1919	(4) 100-Year	3.29	93.01	94.18	0.54	2.09
1898	(2) 2-Year	5.00	92.97	94.13	0.84	0.51
1898	(2) 5-Year	6.32	92.97	94.22	0.91	0.46
1898	(2) 10-Year	7.24	92.97	94.28	0.95	0.46
1898	(2) 25-Year	8.38	92.97	94.36	1.00	0.47
1898	(2) 100-Year	10.81	92.97	94.49	1.09	0.57
1898	(4) 2-Year	4.78	92.97	94.11	0.84	0.51
1898	(4) 5-Year	2.33	92.97	93.84	0.69	0.70
1898	(4) 10-Year	1.78	92.97	93.73	0.71	0.79
1898	(4) 25-Year	2.60	92.97	93.90	0.68	0.92
1898	(4) 100-Year	3.29	92.97	94.18	0.51	2.08
1877	(2) 2-Year	5.00	92.93	94.11	0.81	0.50
1877	(2) 5-Year	6.32	92.93	94.21	0.88	0.46
1877	(2) 10-Year	7.24	92.93	94.27	0.92	0.45
1877	(2) 25-Year	8.38	92.93	94.34	0.97	0.47
1877	(2) 100-Year	10.81	92.93	94.47	1.06	0.56
1877	(4) 2-Year	4.78	92.93	94.09	0.81	0.50
1877	(4) 5-Year	2.33	92.93	93.82	0.65	0.69
1877	(4) 10-Year	1.78	92.93	93.70	0.68	0.78
1877	(4) 25-Year	2.60	92.93	93.88	0.64	0.91
1877	(4) 100-Year	3.29	92.93	94.17	0.48	2.07
1857	(2) 2-Year	5.00	92.89	94.10	0.78	0.49
1857	(2) 5-Year	6.32	92.89	94.19	0.86	0.45
1857	(2) 10-Year	7.24	92.89	94.25	0.90	0.44
1857	(2) 25-Year	8.38	92.89	94.32	0.95	0.46

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1857	(2) 100-Year	10.81	92.89	94.45	1.04	0.55
1857	(4) 2-Year	4.78	92.89	94.07	0.78	0.50
1857	(4) 5-Year	2.33	92.89	93.81	0.62	0.68
1857	(4) 10-Year	1.78	92.89	93.68	0.65	0.78
1857	(4) 25-Year	2.60	92.89	93.87	0.62	0.90
1857	(4) 100-Year	3.29	92.89	94.17	0.46	2.06
1837	(2) 2-Year	5.00	92.86	94.08	0.75	0.48
1837	(2) 5-Year	6.32	92.86	94.17	0.83	0.44
1837	(2) 10-Year	7.24	92.86	94.23	0.87	0.44
1837	(2) 25-Year	8.38	92.86	94.30	0.92	0.46
1837	(2) 100-Year	10.81	92.86	94.44	1.01	0.55
1837	(4) 2-Year	4.78	92.86	94.06	0.75	0.49
1837	(4) 5-Year	2.33	92.86	93.79	0.59	0.67
1837	(4) 10-Year	1.78	92.86	93.66	0.63	0.77
1837	(4) 25-Year	2.60	92.86	93.85	0.59	0.89
1837	(4) 100-Year	3.29	92.86	94.16	0.44	2.04
1817	(2) 2-Year	5.00	92.81	94.07	0.72	0.48
1817	(2) 5-Year	6.32	92.81	94.16	0.80	0.44
1817	(2) 10-Year	7.24	92.81	94.22	0.85	0.43
1817	(2) 25-Year	8.38	92.81	94.29	0.90	0.45
1817	(2) 100-Year	10.81	92.81	94.42	0.99	0.54
1817	(4) 2-Year	4.78	92.81	94.04	0.72	0.48
1817	(4) 5-Year	2.33	92.81	93.78	0.56	0.66
1817	(4) 10-Year	1.78	92.81	93.64	0.59	0.76
1817	(4) 25-Year	2.60	92.81	93.84	0.56	0.88
1817	(4) 100-Year	3.29	92.81	94.16	0.42	2.03
1797	(2) 2-Year	5.00	92.77	94.06	0.69	0.47
1797	(2) 5-Year	6.32	92.77	94.15	0.77	0.43
1797	(2) 10-Year	7.24	92.77	94.21	0.82	0.42
1797	(2) 25-Year	8.38	92.77	94.27	0.87	0.44
1797	(2) 100-Year	10.81	92.77	94.41	0.96	0.54
1797	(4) 2-Year	4.78	92.77	94.03	0.69	0.47
1797	(4) 5-Year	2.33	92.77	93.77	0.53	0.65
1797	(4) 10-Year	1.78	92.77	93.63	0.55	0.75
1797	(4) 25-Year	2.60	92.77	93.84	0.53	0.87
1797	(4) 100-Year	3.29	92.77	94.16	0.40	2.02
1777	(2) 2-Year	5.00	92.73	94.05	0.65	0.46
1777	(2) 5-Year	6.32	92.73	94.14	0.73	0.42
1777	(2) 10-Year	7.24	92.73	94.19	0.78	0.42
1777	(2) 25-Year	8.38	92.73	94.26	0.83	0.44
1777	(2) 100-Year	10.81	92.73	94.39	0.93	0.53
1777	(4) 2-Year	4.78	92.73	94.02	0.65	0.47
1777	(4) 5-Year	2.33	92.73	93.77	0.49	0.64
1777	(4) 10-Year	1.78	92.73	93.62	0.51	0.74
1777	(4) 25-Year	2.60	92.73	93.83	0.49	0.86
1777	(4) 100-Year	3.29	92.73	94.15	0.37	2.00
1757	(2) 2-Year	5.00	92.69	94.04	0.63	0.45

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1757	(2) 5-Year	6.32	92.69	94.13	0.71	0.42
1757	(2) 10-Year	7.24	92.69	94.18	0.76	0.41
1757	(2) 25-Year	8.38	92.69	94.25	0.81	0.43
1757	(2) 100-Year	10.81	92.69	94.38	0.90	0.53
1757	(4) 2-Year	4.78	92.69	94.01	0.63	0.46
1757	(4) 5-Year	2.33	92.69	93.76	0.47	0.63
1757	(4) 10-Year	1.78	92.69	93.61	0.48	0.73
1757	(4) 25-Year	2.60	92.69	93.82	0.47	0.85
1757	(4) 100-Year	3.29	92.69	94.15	0.36	1.99
1736	(2) 2-Year	5.00	92.66	94.04	0.60	0.44
1736	(2) 5-Year	6.32	92.66	94.12	0.68	0.41
1736	(2) 10-Year	7.24	92.66	94.18	0.73	0.40
1736	(2) 25-Year	8.38	92.66	94.24	0.78	0.42
1736	(2) 100-Year	10.81	92.66	94.37	0.88	0.52
1736	(4) 2-Year	4.78	92.66	94.01	0.60	0.45
1736	(4) 5-Year	2.33	92.66	93.75	0.44	0.62
1736	(4) 10-Year	1.78	92.66	93.60	0.45	0.71
1736	(4) 25-Year	2.60	92.66	93.82	0.44	0.84
1736	(4) 100-Year	3.29	92.66	94.15	0.34	1.97
1715	(2) 2-Year	5.00	92.62	94.03	0.57	0.43
1715	(2) 5-Year	6.32	92.62	94.11	0.65	0.40
1715	(2) 10-Year	7.24	92.62	94.17	0.69	0.39
1715	(2) 25-Year	8.38	92.62	94.23	0.75	0.42
1715	(2) 100-Year	10.81	92.62	94.36	0.84	0.51
1715	(4) 2-Year	4.78	92.62	94.00	0.57	0.44
1715	(4) 5-Year	2.33	92.62	93.75	0.41	0.60
1715	(4) 10-Year	1.78	92.62	93.59	0.42	0.70
1715	(4) 25-Year	2.60	92.62	93.81	0.41	0.82
1715	(4) 100-Year	3.29	92.62	94.15	0.32	1.95
1694	(2) 2-Year	5.00	92.58	94.02	0.55	0.42
1694	(2) 5-Year	6.32	92.58	94.11	0.63	0.39
1694	(2) 10-Year	7.24	92.58	94.16	0.67	0.39
1694	(2) 25-Year	8.38	92.58	94.22	0.73	0.41
1694	(2) 100-Year	10.81	92.58	94.35	0.82	0.51
1694	(4) 2-Year	4.78	92.58	94.00	0.55	0.43
1694	(4) 5-Year	2.33	92.58	93.74	0.39	0.59
1694	(4) 10-Year	1.78	92.58	93.59	0.40	0.69
1694	(4) 25-Year	2.60	92.58	93.81	0.39	0.81
1694	(4) 100-Year	3.29	92.58	94.15	0.31	1.94
1673	(2) 2-Year	5.00	92.53	94.02	0.52	0.41
1673	(2) 5-Year	6.32	92.53	94.10	0.60	0.38
1673	(2) 10-Year	7.24	92.53	94.15	0.65	0.38
1673	(2) 25-Year	8.38	92.53	94.22	0.70	0.40
1673	(2) 100-Year	10.81	92.53	94.34	0.80	0.50
1673	(4) 2-Year	4.78	92.53	93.99	0.52	0.42
1673	(4) 5-Year	2.33	92.53	93.74	0.37	0.57
1673	(4) 10-Year	1.78	92.53	93.58	0.37	0.67
1673	(4) 25-Year	2.60	92.53	93.81	0.37	0.79

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1673	(4) 100-Year	3.29	92.53	94.14	0.30	1.92
1653	(2) 2-Year	5.00	92.50	94.02	0.50	0.40
1653	(2) 5-Year	6.32	92.50	94.09	0.58	0.37
1653	(2) 10-Year	7.24	92.50	94.15	0.62	0.37
1653	(2) 25-Year	8.38	92.50	94.21	0.68	0.39
1653	(2) 100-Year	10.81	92.50	94.33	0.77	0.49
1653	(4) 2-Year	4.78	92.50	93.99	0.50	0.41
1653	(4) 5-Year	2.33	92.50	93.74	0.35	0.56
1653	(4) 10-Year	1.78	92.50	93.58	0.35	0.66
1653	(4) 25-Year	2.60	92.50	93.80	0.35	0.78
1653	(4) 100-Year	3.29	92.50	94.14	0.28	1.90
1632	(2) 2-Year	5.00	92.46	94.01	0.49	0.39
1632	(2) 5-Year	6.32	92.46	94.09	0.56	0.36
1632	(2) 10-Year	7.24	92.46	94.14	0.61	0.36
1632	(2) 25-Year	8.38	92.46	94.20	0.66	0.38
1632	(2) 100-Year	10.81	92.46	94.33	0.76	0.49
1632	(4) 2-Year	4.78	92.46	93.98	0.48	0.39
1632	(4) 5-Year	2.33	92.46	93.74	0.33	0.54
1632	(4) 10-Year	1.78	92.46	93.58	0.33	0.64
1632	(4) 25-Year	2.60	92.46	93.80	0.33	0.76
1632	(4) 100-Year	3.29	92.46	94.14	0.28	1.88
1615	(2) 2-Year	5.00	92.43	94.01	0.46	0.38
1615	(2) 5-Year	6.32	92.43	94.09	0.53	0.35
1615	(2) 10-Year	7.24	92.43	94.14	0.57	0.35
1615	(2) 25-Year	8.38	92.43	94.20	0.62	0.38
1615	(2) 100-Year	10.81	92.43	94.32	0.71	0.48
1615	(4) 2-Year	4.78	92.43	93.98	0.46	0.38
1615	(4) 5-Year	2.33	92.43	93.73	0.32	0.53
1615	(4) 10-Year	1.78	92.43	93.57	0.32	0.63
1615	(4) 25-Year	2.60	92.43	93.80	0.32	0.75
1615	(4) 100-Year	3.29	92.43	94.14	0.26	1.86
1555	(2) 2-Year	5.00	92.35	94.00	0.42	0.34
1555	(2) 5-Year	6.32	92.35	94.07	0.48	0.32
1555	(2) 10-Year	7.24	92.35	94.13	0.53	0.32
1555	(2) 25-Year	8.38	92.35	94.19	0.57	0.35
1555	(2) 100-Year	10.81	92.35	94.31	0.66	0.45
1555	(4) 2-Year	4.78	92.35	93.97	0.41	0.35
1555	(4) 5-Year	2.33	92.35	93.73	0.28	0.47
1555	(4) 10-Year	1.78	92.35	93.57	0.29	0.57
1555	(4) 25-Year	2.60	92.35	93.79	0.29	0.69
1555	(4) 100-Year	3.29	92.35	94.14	0.24	1.80
1488	(2) 2-Year	5.00	92.28	93.99	0.38	0.30
1488	(2) 5-Year	6.32	92.28	94.07	0.45	0.28
1488	(2) 10-Year	7.24	92.28	94.11	0.49	0.29
1488	(2) 25-Year	8.38	92.28	94.17	0.53	0.32
1488	(2) 100-Year	10.81	92.28	94.29	0.62	0.43
1488	(4) 2-Year	4.78	92.28	93.96	0.38	0.30

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1488	(4) 5-Year	2.33	92.28	93.72	0.25	0.41
1488	(4) 10-Year	1.78	92.28	93.56	0.25	0.50
1488	(4) 25-Year	2.60	92.28	93.79	0.26	0.63
1488	(4) 100-Year	3.29	92.28	94.14	0.22	1.71
1416	(2) 2-Year	5.00	92.20	93.99	0.36	0.25
1416	(2) 5-Year	6.32	92.20	94.06	0.42	0.24
1416	(2) 10-Year	7.24	92.20	94.11	0.46	0.25
1416	(2) 25-Year	8.38	92.20	94.16	0.51	0.28
1416	(2) 100-Year	10.81	92.20	94.28	0.59	0.40
1416	(4) 2-Year	4.78	92.20	93.96	0.35	0.25
1416	(4) 5-Year	2.33	92.20	93.72	0.22	0.33
1416	(4) 10-Year	1.78	92.20	93.56	0.22	0.43
1416	(4) 25-Year	2.60	92.20	93.79	0.23	0.55
1416	(4) 100-Year	3.29	92.20	94.13	0.20	1.63
1400	(2) 2-Year	5.00	92.17	93.98	0.34	0.23
1400	(2) 5-Year	6.32	92.17	94.05	0.41	0.23
1400	(2) 10-Year	7.24	92.17	94.10	0.45	0.23
1400	(2) 25-Year	8.38	92.17	94.16	0.49	0.27
1400	(2) 100-Year	10.81	92.17	94.27	0.58	0.39
1400	(4) 2-Year	4.78	92.17	93.95	0.34	0.23
1400	(4) 5-Year	2.33	92.17	93.72	0.21	0.30
1400	(4) 10-Year	1.78	92.17	93.56	0.20	0.40
1400	(4) 25-Year	2.60	92.17	93.79	0.22	0.52
1400	(4) 100-Year	3.29	92.17	94.13	0.20	1.60
1364	(2) 2-Year	5.00	91.63	93.98	0.23	0.20
1364	(2) 5-Year	6.32	91.63	94.05	0.28	0.20
1364	(2) 10-Year	7.24	91.63	94.10	0.31	0.21
1364	(2) 25-Year	8.38	91.63	94.16	0.35	0.25
1364	(2) 100-Year	10.81	91.63	94.27	0.42	0.37
1364	(4) 2-Year	4.78	91.63	93.95	0.23	0.20
1364	(4) 5-Year	2.33	91.63	93.72	0.13	0.25
1364	(4) 10-Year	1.78	91.63	93.56	0.12	0.34
1364	(4) 25-Year	2.60	91.63	93.79	0.14	0.47
1364	(4) 100-Year	3.29	91.63	94.13	0.14	1.54
1340	(2) 2-Year	5.79	91.60	93.97	0.53	0.18
1340	(2) 5-Year	7.32	91.60	94.03	0.65	0.18
1340	(2) 10-Year	8.33	91.60	94.07	0.72	0.20
1340	(2) 25-Year	9.65	91.60	94.12	0.82	0.23
1340	(2) 100-Year	11.62	91.60	94.22	0.95	0.36
1340	(4) 2-Year	5.26	91.60	93.94	0.48	0.18
1340	(4) 5-Year	2.44	91.60	93.72	0.25	0.21
1340	(4) 10-Year	1.86	91.60	93.56	0.21	0.30
1340	(4) 25-Year	2.71	91.60	93.78	0.27	0.44
1340	(4) 100-Year	3.43	91.60	94.13	0.29	1.51
1339		Culvert				
1312	(2) 2-Year	6.08	92.47	93.94	0.85	0.17

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1312	(2) 5-Year	7.69	92.47	93.98	1.04	0.17
1312	(2) 10-Year	8.76	92.47	94.01	1.16	0.19
1312	(2) 25-Year	10.15	92.47	94.04	1.32	0.23
1312	(2) 100-Year	12.20	92.47	94.12	1.51	0.35
1312	(4) 2-Year	5.46	92.47	93.91	0.77	0.17
1312	(4) 5-Year	2.47	92.47	93.71	0.41	0.19
1312	(4) 10-Year	1.87	92.47	93.55	0.35	0.27
1312	(4) 25-Year	2.73	92.47	93.77	0.43	0.42
1312	(4) 100-Year	3.44	92.47	94.12	0.42	1.49
1302	(2) 2-Year	6.08	92.57	93.91	1.03	0.17
1302	(2) 5-Year	7.69	92.57	93.97	1.12	0.17
1302	(2) 10-Year	8.76	92.57	94.00	1.18	0.19
1302	(2) 25-Year	10.15	92.57	94.04	1.26	0.23
1302	(2) 100-Year	12.20	92.57	94.14	1.07	0.35
1302	(4) 2-Year	5.46	92.57	93.89	0.98	0.17
1302	(4) 5-Year	2.47	92.57	93.68	0.77	0.18
1302	(4) 10-Year	1.87	92.57	93.51	0.84	0.26
1302	(4) 25-Year	2.73	92.57	93.75	0.72	0.41
1302	(4) 100-Year	3.44	92.57	94.12	0.33	1.48
1268	(2) 2-Year	6.08	92.47	93.87	0.59	0.15
1268	(2) 5-Year	7.69	92.47	93.93	0.62	0.16
1268	(2) 10-Year	8.76	92.47	93.96	0.64	0.18
1268	(2) 25-Year	10.15	92.47	94.00	0.65	0.22
1268	(2) 100-Year	12.20	92.47	94.14	0.45	0.34
1268	(4) 2-Year	5.46	92.47	93.84	0.57	0.15
1268	(4) 5-Year	2.47	92.47	93.59	0.68	0.17
1268	(4) 10-Year	1.87	92.47	93.44	0.79	0.25
1268	(4) 25-Year	2.73	92.47	93.69	0.51	0.40
1268	(4) 100-Year	3.44	92.47	94.12	0.13	1.44
1212	(2) 2-Year	6.08	92.36	93.78	0.84	0.13
1212	(2) 5-Year	7.69	92.36	93.85	0.85	0.14
1212	(2) 10-Year	8.76	92.36	93.89	0.85	0.15
1212	(2) 25-Year	10.15	92.36	93.94	0.80	0.19
1212	(2) 100-Year	12.20	92.36	94.11	0.56	0.30
1212	(4) 2-Year	5.46	92.36	93.74	0.83	0.13
1212	(4) 5-Year	2.47	92.36	93.41	0.89	0.15
1212	(4) 10-Year	1.87	92.36	93.32	0.81	0.23
1212	(4) 25-Year	2.73	92.36	93.58	0.66	0.37
1212	(4) 100-Year	3.44	92.36	94.12	0.15	1.33
1169	(2) 2-Year	6.08	92.30	93.70	0.85	0.12
1169	(2) 5-Year	7.69	92.30	93.76	0.91	0.13
1169	(2) 10-Year	8.76	92.30	93.80	0.94	0.14
1169	(2) 25-Year	10.15	92.30	93.87	0.94	0.18
1169	(2) 100-Year	12.20	92.30	94.08	0.72	0.29
1169	(4) 2-Year	5.46	92.30	93.67	0.83	0.12
1169	(4) 5-Year	2.47	92.30	93.32	0.73	0.13
1169	(4) 10-Year	1.87	92.30	93.26	0.62	0.22
1169	(4) 25-Year	2.73	92.30	93.54	0.53	0.35

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
1169	(4) 100-Year	3.44	92.30	94.12	0.17	1.26
1091	(2) 2-Year	6.08	92.15	93.57	0.82	0.09
1091	(2) 5-Year	7.69	92.15	93.64	0.85	0.10
1091	(2) 10-Year	8.76	92.15	93.69	0.84	0.12
1091	(2) 25-Year	10.15	92.15	93.78	0.78	0.15
1091	(2) 100-Year	12.20	92.15	94.04	0.57	0.25
1091	(4) 2-Year	5.46	92.15	93.54	0.82	0.09
1091	(4) 5-Year	2.47	92.15	93.19	0.70	0.10
1091	(4) 10-Year	1.87	92.15	93.17	0.55	0.18
1091	(4) 25-Year	2.73	92.15	93.50	0.45	0.30
1091	(4) 100-Year	3.44	92.15	94.12	0.13	1.11
1002	(2) 2-Year	6.08	92.06	93.38	1.02	0.07
1002	(2) 5-Year	7.69	92.06	93.49	0.94	0.07
1002	(2) 10-Year	8.76	92.06	93.58	0.82	0.09
1002	(2) 25-Year	10.15	92.06	93.71	0.70	0.12
1002	(2) 100-Year	12.20	92.06	94.02	0.41	0.20
1002	(4) 2-Year	5.46	92.06	93.33	1.01	0.06
1002	(4) 5-Year	2.47	92.06	93.01	0.83	0.07
1002	(4) 10-Year	1.87	92.06	93.09	0.55	0.13
1002	(4) 25-Year	2.73	92.06	93.47	0.36	0.24
1002	(4) 100-Year	3.44	92.06	94.12	0.09	0.88
961	(2) 2-Year	6.08	91.96	93.28	0.83	0.05
961	(2) 5-Year	7.69	91.96	93.41	0.78	0.06
961	(2) 10-Year	8.76	91.96	93.52	0.65	0.07
961	(2) 25-Year	10.15	91.96	93.69	0.43	0.10
961	(2) 100-Year	12.20	91.96	94.02	0.24	0.17
961	(4) 2-Year	5.46	91.96	93.23	0.82	0.05
961	(4) 5-Year	2.47	91.96	92.96	0.62	0.06
961	(4) 10-Year	1.87	91.96	93.06	0.40	0.11
961	(4) 25-Year	2.73	91.96	93.46	0.25	0.21
961	(4) 100-Year	3.44	91.96	94.12	0.05	0.72
910	(2) 2-Year	6.08	91.93	93.22	0.70	0.04
910	(2) 5-Year	7.69	91.93	93.38	0.63	0.04
910	(2) 10-Year	8.76	91.93	93.49	0.52	0.05
910	(2) 25-Year	10.15	91.93	93.68	0.34	0.06
910	(2) 100-Year	12.20	91.93	94.02	0.20	0.10
910	(4) 2-Year	5.46	91.93	93.16	0.73	0.03
910	(4) 5-Year	2.47	91.93	92.91	0.64	0.03
910	(4) 10-Year	1.87	91.93	93.05	0.35	0.07
910	(4) 25-Year	2.73	91.93	93.46	0.18	0.14
910	(4) 100-Year	3.44	91.93	94.12	0.05	0.44
840	(2) 2-Year	6.08	91.86	93.18	0.41	0.00
840	(2) 5-Year	7.69	91.86	93.35	0.34	0.00
840	(2) 10-Year	8.76	91.86	93.48	0.30	0.00
840	(2) 25-Year	10.15	91.86	93.67	0.26	0.00
840	(2) 100-Year	12.20	91.86	94.02	0.18	0.00
840	(4) 2-Year	5.46	91.86	93.11	0.44	0.00

Table C-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Floodplain) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Channel Travel Time (h)
840	(4) 5-Year	2.47	91.86	92.83	0.47	0.00
840	(4) 10-Year	1.87	91.86	93.03	0.19	0.00
840	(4) 25-Year	2.73	91.86	93.45	0.10	0.00
840	(4) 100-Year	3.44	91.86	94.12	0.04	0.00

⁽¹⁾ All channel infrastructure included in the HEC-RAS model for floodplain analysis.

For Scenario 2 (the Van Gaal Drain 100-year spring snowmelt plus rainfall peak flow reaches the Jock River) and Scenario 4 (the Jock River 100-year spring snowmelt plus rainfall peak flow reaches the outlet of the Van Gaal Drain).

Attachment D

HEC-RAS Results for Van Gaal Drain Reach 2
Proposed Conditions (Riparian Storage Analysis)

Table D-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2554	(1) 25 mm	0.72	94.75	95.24	0.73	6.80
2554	(1) 2-Year	1.95	94.75	95.45	0.99	14.55
2554	(1) 5-Year	3.20	94.75	95.59	1.18	20.23
2554	(1) 10-Year	4.11	94.75	95.67	1.29	24.36
2554	(1) 25-Year	5.28	94.75	95.76	1.40	29.89
2554	(1) 100-Year	7.27	94.75	95.90	1.55	40.63
2478	(1) 25 mm	0.72	94.46	94.93	0.79	6.72
2478	(1) 2-Year	1.95	94.46	95.14	1.09	14.37
2478	(1) 5-Year	3.20	94.46	95.26	1.27	19.97
2478	(1) 10-Year	4.11	94.46	95.34	1.37	24.04
2478	(1) 25-Year	5.28	94.46	95.44	1.48	29.52
2478	(1) 100-Year	7.27	94.46	95.58	1.63	40.15
2434.60*	(1) 25 mm	0.72	94.28	94.75	0.80	6.68
2434.60*	(1) 2-Year	1.95	94.28	94.96	1.09	14.25
2434.60*	(1) 5-Year	3.20	94.28	95.09	1.27	19.78
2434.60*	(1) 10-Year	4.11	94.28	95.17	1.36	23.81
2434.60*	(1) 25-Year	5.28	94.28	95.26	1.46	29.23
2434.60*	(1) 100-Year	7.27	94.28	95.41	1.59	39.79
2391.20*	(1) 25 mm	0.72	94.10	94.57	0.79	6.64
2391.20*	(1) 2-Year	1.95	94.10	94.78	1.09	14.13
2391.20*	(1) 5-Year	3.20	94.10	94.92	1.25	19.59
2391.20*	(1) 10-Year	4.11	94.10	95.00	1.33	23.58
2391.20*	(1) 25-Year	5.28	94.10	95.11	1.41	28.95
2391.20*	(1) 100-Year	7.27	94.10	95.27	1.52	39.42
2347.80*	(1) 25 mm	0.72	93.93	94.40	0.79	6.60
2347.80*	(1) 2-Year	1.95	93.93	94.61	1.06	14.00
2347.80*	(1) 5-Year	3.20	93.93	94.77	1.16	19.39
2347.80*	(1) 10-Year	4.11	93.93	94.87	1.22	23.33
2347.80*	(1) 25-Year	5.28	93.93	94.98	1.29	28.64
2347.80*	(1) 100-Year	7.27	93.93	95.15	1.39	39.01
2304.40*	(1) 25 mm	0.72	93.75	94.24	0.73	6.56
2304.40*	(1) 2-Year	1.95	93.75	94.49	0.89	13.86
2304.40*	(1) 5-Year	3.20	93.75	94.68	0.98	19.16
2304.40*	(1) 10-Year	4.11	93.75	94.78	1.04	23.05
2304.40*	(1) 25-Year	5.28	93.75	94.90	1.12	28.29
2304.40*	(1) 100-Year	7.27	93.75	95.08	1.23	38.55
2261	(1) 25 mm	0.72	93.57	94.18	0.49	6.49
2261	(1) 2-Year	1.95	93.57	94.44	0.66	13.67
2261	(1) 5-Year	3.20	93.57	94.63	0.78	18.87
2261	(1) 10-Year	4.11	93.57	94.73	0.86	22.70
2261	(1) 25-Year	5.28	93.57	94.85	0.95	27.87
2261	(1) 100-Year	7.27	93.57	95.02	1.07	38.03
2258	(1) 25 mm	0.72	93.57	94.14	0.56	6.44
2258	(1) 2-Year	1.95	93.57	94.41	0.72	13.53
2258	(1) 5-Year	3.20	93.57	94.60	0.82	18.66

Table D-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2258	(1) 10-Year	4.11	93.57	94.70	0.90	22.45
2258	(1) 25-Year	5.28	93.57	94.81	0.99	27.57
2258	(1) 100-Year	7.27	93.57	94.98	1.12	37.66
2256	(1) 25 mm	0.72	93.49	94.12	0.46	6.40
2256	(1) 2-Year	1.95	93.49	94.39	0.63	13.42
2256	(1) 5-Year	3.20	93.49	94.58	0.75	18.50
2256	(1) 10-Year	4.11	93.49	94.68	0.81	22.25
2256	(1) 25-Year	5.28	93.49	94.80	0.88	27.34
2256	(1) 100-Year	7.27	93.49	94.97	0.97	37.35
2254	(1) 25 mm	0.72	93.46	94.11	0.44	6.35
2254	(1) 2-Year	1.95	93.46	94.38	0.62	13.32
2254	(1) 5-Year	3.20	93.46	94.56	0.73	18.35
2254	(1) 10-Year	4.11	93.46	94.67	0.80	22.06
2254	(1) 25-Year	5.28	93.46	94.78	0.87	27.10
2254	(1) 100-Year	7.27	93.46	94.95	0.96	37.05
2235	(1) 25 mm	0.72	93.44	94.10	0.43	6.30
2235	(1) 2-Year	1.95	93.44	94.36	0.60	13.21
2235	(1) 5-Year	3.20	93.44	94.55	0.72	18.20
2235	(1) 10-Year	4.11	93.44	94.65	0.79	21.87
2235	(1) 25-Year	5.28	93.44	94.76	0.86	26.87
2235	(1) 100-Year	7.27	93.44	94.94	0.95	36.74
2207	(1) 25 mm	0.72	93.40	94.08	0.40	6.23
2207	(1) 2-Year	1.95	93.40	94.35	0.59	13.06
2207	(1) 5-Year	3.20	93.40	94.53	0.71	17.96
2207	(1) 10-Year	4.11	93.40	94.63	0.78	21.58
2207	(1) 25-Year	5.28	93.40	94.74	0.85	26.51
2207	(1) 100-Year	7.27	93.40	94.92	0.94	36.28
2188	(1) 25 mm	1.16	93.37	94.05	0.65	6.18
2188	(1) 2-Year	2.80	93.37	94.31	0.84	12.95
2188	(1) 5-Year	4.41	93.37	94.49	0.98	17.80
2188	(1) 10-Year	5.53	93.37	94.59	1.05	21.38
2188	(1) 25-Year	6.96	93.37	94.70	1.13	26.27
2188	(1) 100-Year	9.54	93.37	94.88	1.25	35.98
2163	(1) 25 mm	1.16	93.34	94.02	0.65	6.12
2163	(1) 2-Year	2.80	93.34	94.28	0.84	12.81
2163	(1) 5-Year	4.41	93.34	94.46	0.97	17.60
2163	(1) 10-Year	5.53	93.34	94.56	1.04	21.13
2163	(1) 25-Year	6.96	93.34	94.67	1.12	25.97
2163	(1) 100-Year	9.54	93.34	94.84	1.23	35.59
2141	(1) 25 mm	1.16	93.31	93.99	0.65	6.06
2141	(1) 2-Year	2.80	93.31	94.25	0.84	12.69
2141	(1) 5-Year	4.41	93.31	94.43	0.97	17.42
2141	(1) 10-Year	5.53	93.31	94.53	1.04	20.91
2141	(1) 25-Year	6.96	93.31	94.64	1.11	25.69
2141	(1) 100-Year	9.54	93.31	94.81	1.23	35.23

Table D-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2121	(1) 25 mm	1.16	93.28	93.96	0.64	6.00
2121	(1) 2-Year	2.80	93.28	94.23	0.83	12.58
2121	(1) 5-Year	4.41	93.28	94.41	0.96	17.25
2121	(1) 10-Year	5.53	93.28	94.51	1.03	20.70
2121	(1) 25-Year	6.96	93.28	94.62	1.11	25.44
2121	(1) 100-Year	9.54	93.28	94.79	1.23	34.91
2101	(1) 25 mm	1.16	93.26	93.94	0.66	5.95
2101	(1) 2-Year	2.80	93.26	94.20	0.84	12.46
2101	(1) 5-Year	4.41	93.26	94.38	0.98	17.08
2101	(1) 10-Year	5.53	93.26	94.48	1.05	20.49
2101	(1) 25-Year	6.96	93.26	94.59	1.12	25.18
2101	(1) 100-Year	9.54	93.26	94.76	1.24	34.58
2080	(1) 25 mm	1.16	93.24	93.90	0.68	5.89
2080	(1) 2-Year	2.80	93.24	94.17	0.86	12.34
2080	(1) 5-Year	4.41	93.24	94.35	0.99	16.91
2080	(1) 10-Year	5.53	93.24	94.45	1.06	20.28
2080	(1) 25-Year	6.96	93.24	94.56	1.14	24.93
2080	(1) 100-Year	9.54	93.24	94.72	1.26	34.25
2059	(1) 25 mm	1.16	93.21	93.87	0.70	5.84
2059	(1) 2-Year	2.80	93.21	94.14	0.86	12.23
2059	(1) 5-Year	4.41	93.21	94.32	0.99	16.73
2059	(1) 10-Year	5.53	93.21	94.42	1.06	20.06
2059	(1) 25-Year	6.96	93.21	94.53	1.14	24.66
2059	(1) 100-Year	9.54	93.21	94.69	1.27	33.91
2038	(1) 25 mm	1.16	93.18	93.84	0.70	5.80
2038	(1) 2-Year	2.80	93.18	94.12	0.84	12.12
2038	(1) 5-Year	4.41	93.18	94.29	0.98	16.58
2038	(1) 10-Year	5.53	93.18	94.39	1.05	19.87
2038	(1) 25-Year	6.96	93.18	94.50	1.13	24.44
2038	(1) 100-Year	9.54	93.18	94.67	1.25	33.62
2017	(1) 25 mm	1.16	93.17	93.82	0.71	5.78
2017	(1) 2-Year	2.80	93.17	94.10	0.86	12.08
2017	(1) 5-Year	4.41	93.17	94.28	1.00	16.52
2017	(1) 10-Year	5.53	93.17	94.38	1.07	19.79
2017	(1) 25-Year	6.96	93.17	94.49	1.15	24.33
2017	(1) 100-Year	9.54	93.17	94.65	1.28	33.49
2003	(1) 25 mm	1.16	93.16	93.81	0.73	5.76
2003	(1) 2-Year	2.80	93.16	94.09	0.86	12.04
2003	(1) 5-Year	4.41	93.16	94.27	1.01	16.46
2003	(1) 10-Year	5.53	93.16	94.37	1.08	19.72
2003	(1) 25-Year	6.96	93.16	94.48	1.16	24.24
2003	(1) 100-Year	9.54	93.16	94.64	1.28	33.37
1982	(1) 25 mm	1.16	93.12	93.77	0.71	5.71
1982	(1) 2-Year	2.80	93.12	94.07	0.83	11.93

Table D-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1982	(1) 5-Year	4.41	93.12	94.24	0.97	16.29
1982	(1) 10-Year	5.53	93.12	94.34	1.04	19.51
1982	(1) 25-Year	6.96	93.12	94.45	1.12	23.99
1982	(1) 100-Year	9.54	93.12	94.61	1.25	33.04
1961	(1) 25 mm	1.16	93.08	93.73	0.70	5.66
1961	(1) 2-Year	2.80	93.08	94.04	0.80	11.81
1961	(1) 5-Year	4.41	93.08	94.22	0.95	16.11
1961	(1) 10-Year	5.53	93.08	94.32	1.02	19.29
1961	(1) 25-Year	6.96	93.08	94.42	1.10	23.73
1961	(1) 100-Year	9.54	93.08	94.59	1.24	32.71
1940	(1) 25 mm	1.16	93.04	93.70	0.68	5.61
1940	(1) 2-Year	2.80	93.04	94.02	0.78	11.68
1940	(1) 5-Year	4.41	93.04	94.19	0.92	15.93
1940	(1) 10-Year	5.53	93.04	94.29	1.00	19.07
1940	(1) 25-Year	6.96	93.04	94.40	1.08	23.46
1940	(1) 100-Year	9.54	93.04	94.56	1.22	32.38
1919	(1) 25 mm	1.16	93.01	93.67	0.69	5.56
1919	(1) 2-Year	2.80	93.01	94.00	0.76	11.55
1919	(1) 5-Year	4.41	93.01	94.17	0.90	15.74
1919	(1) 10-Year	5.53	93.01	94.27	0.98	18.84
1919	(1) 25-Year	6.96	93.01	94.37	1.06	23.19
1919	(1) 100-Year	9.54	93.01	94.53	1.20	32.04
1898	(1) 25 mm	1.16	92.97	93.64	0.67	5.51
1898	(1) 2-Year	2.80	92.97	93.98	0.73	11.42
1898	(1) 5-Year	4.41	92.97	94.15	0.87	15.55
1898	(1) 10-Year	5.53	92.97	94.25	0.95	18.61
1898	(1) 25-Year	6.96	92.97	94.35	1.04	22.91
1898	(1) 100-Year	9.54	92.97	94.51	1.18	31.69
1877	(1) 25 mm	1.16	92.93	93.61	0.64	5.45
1877	(1) 2-Year	2.80	92.93	93.97	0.70	11.28
1877	(1) 5-Year	4.41	92.93	94.13	0.84	15.34
1877	(1) 10-Year	5.53	92.93	94.23	0.92	18.36
1877	(1) 25-Year	6.96	92.93	94.33	1.01	22.62
1877	(1) 100-Year	9.54	92.93	94.49	1.16	31.33
1857	(1) 25 mm	1.16	92.89	93.59	0.62	5.39
1857	(1) 2-Year	2.80	92.89	93.95	0.68	11.13
1857	(1) 5-Year	4.41	92.89	94.12	0.82	15.13
1857	(1) 10-Year	5.53	92.89	94.21	0.90	18.11
1857	(1) 25-Year	6.96	92.89	94.31	0.99	22.33
1857	(1) 100-Year	9.54	92.89	94.46	1.14	30.97
1837	(1) 25 mm	1.16	92.86	93.56	0.60	5.33
1837	(1) 2-Year	2.80	92.86	93.94	0.65	10.98
1837	(1) 5-Year	4.41	92.86	94.10	0.80	14.91
1837	(1) 10-Year	5.53	92.86	94.19	0.88	17.86
1837	(1) 25-Year	6.96	92.86	94.29	0.97	22.02

Table D-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1837	(1) 100-Year	9.54	92.86	94.44	1.12	30.60
1817	(1) 25 mm	1.16	92.81	93.54	0.56	5.27
1817	(1) 2-Year	2.80	92.81	93.93	0.62	10.81
1817	(1) 5-Year	4.41	92.81	94.09	0.77	14.68
1817	(1) 10-Year	5.53	92.81	94.18	0.85	17.59
1817	(1) 25-Year	6.96	92.81	94.28	0.94	21.71
1817	(1) 100-Year	9.54	92.81	94.42	1.10	30.23
1797	(1) 25 mm	1.16	92.77	93.53	0.53	5.20
1797	(1) 2-Year	2.80	92.77	93.92	0.59	10.64
1797	(1) 5-Year	4.41	92.77	94.08	0.74	14.44
1797	(1) 10-Year	5.53	92.77	94.17	0.82	17.31
1797	(1) 25-Year	6.96	92.77	94.26	0.92	21.39
1797	(1) 100-Year	9.54	92.77	94.40	1.07	29.85
1777	(1) 25 mm	1.16	92.73	93.52	0.49	5.13
1777	(1) 2-Year	2.80	92.73	93.91	0.56	10.45
1777	(1) 5-Year	4.41	92.73	94.07	0.70	14.19
1777	(1) 10-Year	5.53	92.73	94.15	0.78	17.02
1777	(1) 25-Year	6.96	92.73	94.25	0.88	21.06
1777	(1) 100-Year	9.54	92.73	94.39	1.04	29.45
1757	(1) 25 mm	1.16	92.69	93.51	0.46	5.04
1757	(1) 2-Year	2.80	92.69	93.91	0.53	10.24
1757	(1) 5-Year	4.41	92.69	94.06	0.68	13.92
1757	(1) 10-Year	5.53	92.69	94.14	0.76	16.72
1757	(1) 25-Year	6.96	92.69	94.24	0.86	20.72
1757	(1) 100-Year	9.54	92.69	94.37	1.02	29.05
1736	(1) 25 mm	1.16	92.66	93.50	0.44	4.96
1736	(1) 2-Year	2.80	92.66	93.90	0.51	10.03
1736	(1) 5-Year	4.41	92.66	94.05	0.65	13.65
1736	(1) 10-Year	5.53	92.66	94.13	0.74	16.40
1736	(1) 25-Year	6.96	92.66	94.23	0.83	20.36
1736	(1) 100-Year	9.54	92.66	94.36	1.00	28.63
1715	(1) 25 mm	1.16	92.62	93.49	0.40	4.86
1715	(1) 2-Year	2.80	92.62	93.90	0.48	9.80
1715	(1) 5-Year	4.41	92.62	94.04	0.62	13.35
1715	(1) 10-Year	5.53	92.62	94.12	0.70	16.07
1715	(1) 25-Year	6.96	92.62	94.21	0.80	20.00
1715	(1) 100-Year	9.54	92.62	94.34	0.96	28.20
1694	(1) 25 mm	1.16	92.58	93.48	0.38	4.76
1694	(1) 2-Year	2.80	92.58	93.89	0.46	9.56
1694	(1) 5-Year	4.41	92.58	94.03	0.60	13.05
1694	(1) 10-Year	5.53	92.58	94.12	0.68	15.73
1694	(1) 25-Year	6.96	92.58	94.21	0.78	19.61
1694	(1) 100-Year	9.54	92.58	94.33	0.94	27.76
1673	(1) 25 mm	1.16	92.53	93.48	0.35	4.64

Table D-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1673	(1) 2-Year	2.80	92.53	93.89	0.44	9.30
1673	(1) 5-Year	4.41	92.53	94.03	0.57	12.73
1673	(1) 10-Year	5.53	92.53	94.11	0.66	15.38
1673	(1) 25-Year	6.96	92.53	94.20	0.75	19.22
1673	(1) 100-Year	9.54	92.53	94.32	0.92	27.31
1653	(1) 25 mm	1.16	92.50	93.47	0.33	4.52
1653	(1) 2-Year	2.80	92.50	93.88	0.42	9.02
1653	(1) 5-Year	4.41	92.50	94.02	0.55	12.39
1653	(1) 10-Year	5.53	92.50	94.10	0.64	15.01
1653	(1) 25-Year	6.96	92.50	94.19	0.73	18.81
1653	(1) 100-Year	9.54	92.50	94.31	0.89	26.85
1632	(1) 25 mm	1.16	92.46	93.47	0.31	4.39
1632	(1) 2-Year	2.80	92.46	93.88	0.40	8.74
1632	(1) 5-Year	4.41	92.46	94.02	0.54	12.05
1632	(1) 10-Year	5.53	92.46	94.10	0.62	14.63
1632	(1) 25-Year	6.96	92.46	94.18	0.72	18.39
1632	(1) 100-Year	9.54	92.46	94.30	0.88	26.37
1615	(1) 25 mm	1.16	92.43	93.47	0.31	4.28
1615	(1) 2-Year	2.80	92.43	93.88	0.39	8.49
1615	(1) 5-Year	4.41	92.43	94.01	0.52	11.75
1615	(1) 10-Year	5.53	92.43	94.09	0.60	14.30
1615	(1) 25-Year	6.96	92.43	94.18	0.69	18.04
1615	(1) 100-Year	9.54	92.43	94.29	0.85	25.97
1555	(1) 25 mm	1.16	92.35	93.46	0.28	3.83
1555	(1) 2-Year	2.80	92.35	93.87	0.36	7.55
1555	(1) 5-Year	4.41	92.35	94.00	0.48	10.64
1555	(1) 10-Year	5.53	92.35	94.08	0.56	13.09
1555	(1) 25-Year	6.96	92.35	94.16	0.64	16.71
1555	(1) 100-Year	9.54	92.35	94.27	0.80	24.49
1488	(1) 25 mm	1.16	92.28	93.46	0.25	3.24
1488	(1) 2-Year	2.80	92.28	93.86	0.33	6.40
1488	(1) 5-Year	4.41	92.28	93.99	0.44	9.30
1488	(1) 10-Year	5.53	92.28	94.07	0.52	11.64
1488	(1) 25-Year	6.96	92.28	94.14	0.61	15.14
1488	(1) 100-Year	9.54	92.28	94.24	0.76	22.76
1416	(1) 25 mm	1.16	92.20	93.45	0.21	2.59
1416	(1) 2-Year	2.80	92.20	93.86	0.30	5.23
1416	(1) 5-Year	4.41	92.20	93.99	0.42	7.96
1416	(1) 10-Year	5.53	92.20	94.06	0.49	10.20
1416	(1) 25-Year	6.96	92.20	94.13	0.58	13.61
1416	(1) 100-Year	9.54	92.20	94.22	0.73	21.09
1400	(1) 25 mm	1.16	92.17	93.45	0.20	2.31
1400	(1) 2-Year	2.80	92.17	93.86	0.29	4.76
1400	(1) 5-Year	4.41	92.17	93.98	0.40	7.42
1400	(1) 10-Year	5.53	92.17	94.05	0.48	9.63

Table D-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1400	(1) 25-Year	6.96	92.17	94.12	0.56	12.99
1400	(1) 100-Year	9.54	92.17	94.22	0.72	20.42
1364	(1) 25 mm	1.16	91.63	93.45	0.09	1.80
1364	(1) 2-Year	2.80	91.63	93.86	0.15	3.97
1364	(1) 5-Year	4.41	91.63	93.98	0.22	6.53
1364	(1) 10-Year	5.53	91.63	94.05	0.27	8.69
1364	(1) 25-Year	6.96	91.63	94.12	0.32	12.00
1364	(1) 100-Year	9.54	91.63	94.22	0.41	19.35
1340	(1) 25 mm	1.53	91.60	93.45	0.11	1.42
1340	(1) 2-Year	3.64	91.60	93.86	0.20	3.39
1340	(1) 5-Year	5.57	91.60	93.98	0.28	5.90
1340	(1) 10-Year	6.92	91.60	94.05	0.33	8.02
1340	(1) 25-Year	8.58	91.60	94.12	0.39	11.29
1340	(1) 100-Year	11.43	91.60	94.21	0.50	18.60
1312	(1) 25 mm	1.53	92.47	93.45	0.29	1.10
1312	(1) 2-Year	3.87	92.47	93.84	0.51	2.91
1312	(1) 5-Year	5.93	92.47	93.96	0.71	5.36
1312	(1) 10-Year	7.38	92.47	94.01	0.84	7.45
1312	(1) 25-Year	9.17	92.47	94.07	1.01	10.69
1312	(1) 100-Year	12.20	92.47	94.13	1.29	17.96
1302	(1) 25 mm	1.53	92.57	93.41	0.83	1.07
1302	(1) 2-Year	3.87	92.57	93.81	0.88	2.84
1302	(1) 5-Year	5.93	92.57	93.92	1.05	5.28
1302	(1) 10-Year	7.38	92.57	93.98	1.15	7.35
1302	(1) 25-Year	9.17	92.57	94.03	1.27	10.58
1302	(1) 100-Year	12.20	92.57	94.11	1.41	17.81
1268	(1) 25 mm	1.53	92.47	93.33	0.79	1.00
1268	(1) 2-Year	3.87	92.47	93.75	0.56	2.62
1268	(1) 5-Year	5.93	92.47	93.88	0.57	4.91
1268	(1) 10-Year	7.38	92.47	93.94	0.60	6.88
1268	(1) 25-Year	9.17	92.47	94.01	0.62	9.89
1268	(1) 100-Year	12.20	92.47	94.10	0.60	16.64
1212	(1) 25 mm	1.53	92.36	93.18	0.86	0.90
1212	(1) 2-Year	3.87	92.36	93.61	0.89	2.25
1212	(1) 5-Year	5.93	92.36	93.77	0.91	4.21
1212	(1) 10-Year	7.38	92.36	93.85	0.93	5.90
1212	(1) 25-Year	9.17	92.36	93.92	0.94	8.43
1212	(1) 100-Year	12.20	92.36	94.04	0.90	14.29
1169	(1) 25 mm	1.53	92.30	93.10	0.69	0.81
1169	(1) 2-Year	3.87	92.30	93.53	0.78	2.02
1169	(1) 5-Year	5.93	92.30	93.70	0.86	3.67
1169	(1) 10-Year	7.38	92.30	93.77	0.92	5.11
1169	(1) 25-Year	9.17	92.30	93.84	0.98	7.33
1169	(1) 100-Year	12.20	92.30	93.94	1.09	12.64

Table D-1: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1091	(1) 25 mm	1.53	92.15	92.98	0.65	0.63
1091	(1) 2-Year	3.87	92.15	93.40	0.75	1.62
1091	(1) 5-Year	5.93	92.15	93.57	0.83	2.89
1091	(1) 10-Year	7.38	92.15	93.64	0.87	4.03
1091	(1) 25-Year	9.17	92.15	93.71	0.92	5.91
1091	(1) 100-Year	12.20	92.15	93.82	0.97	10.62
1002	(1) 25 mm	1.53	92.06	92.81	0.76	0.44
1002	(1) 2-Year	3.87	92.06	93.21	0.91	1.21
1002	(1) 5-Year	5.93	92.06	93.37	1.02	2.15
1002	(1) 10-Year	7.38	92.06	93.46	1.04	2.97
1002	(1) 25-Year	9.17	92.06	93.55	1.03	4.45
1002	(1) 100-Year	12.20	92.06	93.69	1.02	8.49
961	(1) 25 mm	1.53	91.96	92.77	0.54	0.34
961	(1) 2-Year	3.87	91.96	93.13	0.72	1.01
961	(1) 5-Year	5.93	91.96	93.28	0.80	1.86
961	(1) 10-Year	7.38	91.96	93.37	0.83	2.56
961	(1) 25-Year	9.17	91.96	93.47	0.82	3.85
961	(1) 100-Year	12.20	91.96	93.64	0.64	7.42
910	(1) 25 mm	1.53	91.93	92.72	0.57	0.20
910	(1) 2-Year	3.87	91.93	93.06	0.74	0.62
910	(1) 5-Year	5.93	91.93	93.20	0.81	1.16
910	(1) 10-Year	7.38	91.93	93.30	0.82	1.62
910	(1) 25-Year	9.17	91.93	93.41	0.83	2.38
910	(1) 100-Year	12.20	91.93	93.60	0.68	4.32
840	(1) 25 mm	1.53	91.86	92.65	0.50	0.00
840	(1) 2-Year	3.87	91.86	92.98	0.47	0.00
840	(1) 5-Year	5.93	91.86	93.16	0.42	0.00
840	(1) 10-Year	7.38	91.86	93.26	0.41	0.00
840	(1) 25-Year	9.17	91.86	93.38	0.41	0.00
840	(1) 100-Year	12.20	91.86	93.58	0.39	0.00

⁽¹⁾ All channel infrastructure removed from the HEC-RAS model for riparian storage analysis.

For Scenario 1 (the Van Gaal Drain 100-year 24-hour SCS peak flow reaches the Jock River).

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2554	(2) 2-Year	4.13	94.75	95.64	1.37	19.63
2554	(2) 5-Year	5.24	94.75	95.72	1.50	23.50
2554	(2) 10-Year	6.00	94.75	95.77	1.58	26.12
2554	(2) 25-Year	6.94	94.75	95.82	1.67	30.21
2554	(2) 100-Year	8.32	94.75	95.89	1.79	39.36
2554	(4) 2-Year	3.97	94.75	95.63	1.35	18.39
2554	(4) 5-Year	2.02	94.75	95.45	1.03	11.06
2554	(4) 10-Year	1.57	94.75	95.40	0.94	9.07
2554	(4) 25-Year	2.25	94.75	95.48	1.08	15.30
2554	(4) 100-Year	2.86	94.75	95.54	1.18	44.56
2478	(2) 2-Year	4.13	94.46	95.30	1.32	19.34
2478	(2) 5-Year	5.24	94.46	95.38	1.41	23.16
2478	(2) 10-Year	6.00	94.46	95.42	1.47	25.75
2478	(2) 25-Year	6.94	94.46	95.48	1.53	29.80
2478	(2) 100-Year	8.32	94.46	95.55	1.61	38.89
2478	(4) 2-Year	3.97	94.46	95.29	1.30	18.11
2478	(4) 5-Year	2.02	94.46	95.13	1.08	10.89
2478	(4) 10-Year	1.57	94.46	95.08	1.00	8.93
2478	(4) 25-Year	2.25	94.46	95.15	1.11	15.11
2478	(4) 100-Year	2.86	94.46	95.20	1.19	44.34
2434.60*	(2) 2-Year	4.13	94.28	95.12	1.32	19.14
2434.60*	(2) 5-Year	5.24	94.28	95.20	1.41	22.92
2434.60*	(2) 10-Year	6.00	94.28	95.25	1.46	25.48
2434.60*	(2) 25-Year	6.94	94.28	95.30	1.52	29.50
2434.60*	(2) 100-Year	8.32	94.28	95.38	1.59	38.54
2434.60*	(4) 2-Year	3.97	94.28	95.11	1.30	17.91
2434.60*	(4) 5-Year	2.02	94.28	94.95	1.08	10.77
2434.60*	(4) 10-Year	1.57	94.28	94.90	1.01	8.83
2434.60*	(4) 25-Year	2.25	94.28	94.97	1.11	14.98
2434.60*	(4) 100-Year	2.86	94.28	95.03	1.19	44.18
2391.20*	(2) 2-Year	4.13	94.10	94.95	1.31	18.93
2391.20*	(2) 5-Year	5.24	94.10	95.03	1.38	22.67
2391.20*	(2) 10-Year	6.00	94.10	95.08	1.43	25.20
2391.20*	(2) 25-Year	6.94	94.10	95.14	1.48	29.19
2391.20*	(2) 100-Year	8.32	94.10	95.23	1.53	38.18
2391.20*	(4) 2-Year	3.97	94.10	94.94	1.30	17.70
2391.20*	(4) 5-Year	2.02	94.10	94.77	1.08	10.65
2391.20*	(4) 10-Year	1.57	94.10	94.72	1.00	8.74
2391.20*	(4) 25-Year	2.25	94.10	94.79	1.11	14.85
2391.20*	(4) 100-Year	2.86	94.10	94.85	1.19	44.02
2347.80*	(2) 2-Year	4.13	93.93	94.79	1.24	18.72
2347.80*	(2) 5-Year	5.24	93.93	94.88	1.30	22.41
2347.80*	(2) 10-Year	6.00	93.93	94.94	1.33	24.91
2347.80*	(2) 25-Year	6.94	93.93	95.01	1.37	28.87
2347.80*	(2) 100-Year	8.32	93.93	95.11	1.40	37.80
2347.80*	(4) 2-Year	3.97	93.93	94.78	1.23	17.50
2347.80*	(4) 5-Year	2.02	93.93	94.59	1.08	10.53
2347.80*	(4) 10-Year	1.57	93.93	94.54	1.01	8.64

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2347.80*	(4) 25-Year	2.25	93.93	94.61	1.11	14.72
2347.80*	(4) 100-Year	2.86	93.93	94.68	1.16	43.87
2304.40*	(2) 2-Year	4.13	93.75	94.69	1.06	18.48
2304.40*	(2) 5-Year	5.24	93.75	94.78	1.12	22.12
2304.40*	(2) 10-Year	6.00	93.75	94.84	1.16	24.59
2304.40*	(2) 25-Year	6.94	93.75	94.91	1.21	28.50
2304.40*	(2) 100-Year	8.32	93.75	95.02	1.24	37.38
2304.40*	(4) 2-Year	3.97	93.75	94.67	1.06	17.27
2304.40*	(4) 5-Year	2.02	93.75	94.44	0.97	10.41
2304.40*	(4) 10-Year	1.57	93.75	94.38	0.94	8.55
2304.40*	(4) 25-Year	2.25	93.75	94.47	0.98	14.58
2304.40*	(4) 100-Year	2.86	93.75	94.55	1.01	43.69
2261	(2) 2-Year	4.13	93.57	94.63	0.85	18.19
2261	(2) 5-Year	5.24	93.57	94.72	0.93	21.77
2261	(2) 10-Year	6.00	93.57	94.78	0.97	24.21
2261	(2) 25-Year	6.94	93.57	94.85	1.02	28.08
2261	(2) 100-Year	8.32	93.57	94.97	1.06	36.88
2261	(4) 2-Year	3.97	93.57	94.61	0.84	16.99
2261	(4) 5-Year	2.02	93.57	94.38	0.70	10.25
2261	(4) 10-Year	1.57	93.57	94.31	0.65	8.42
2261	(4) 25-Year	2.25	93.57	94.41	0.72	14.41
2261	(4) 100-Year	2.86	93.57	94.49	0.77	43.48
2258	(2) 2-Year	4.13	93.57	94.58	0.92	17.98
2258	(2) 5-Year	5.24	93.57	94.68	0.99	21.53
2258	(2) 10-Year	6.00	93.57	94.74	1.03	23.94
2258	(2) 25-Year	6.94	93.57	94.81	1.09	27.79
2258	(2) 100-Year	8.32	93.57	94.93	1.12	36.54
2258	(4) 2-Year	3.97	93.57	94.57	0.91	16.79
2258	(4) 5-Year	2.02	93.57	94.33	0.80	10.13
2258	(4) 10-Year	1.57	93.57	94.26	0.77	8.32
2258	(4) 25-Year	2.25	93.57	94.36	0.82	14.28
2258	(4) 100-Year	2.86	93.57	94.44	0.85	43.32
2256	(2) 2-Year	4.13	93.49	94.56	0.83	17.83
2256	(2) 5-Year	5.24	93.49	94.66	0.88	21.34
2256	(2) 10-Year	6.00	93.49	94.72	0.92	23.73
2256	(2) 25-Year	6.94	93.49	94.79	0.95	27.55
2256	(2) 100-Year	8.32	93.49	94.91	0.96	36.26
2256	(4) 2-Year	3.97	93.49	94.54	0.82	16.64
2256	(4) 5-Year	2.02	93.49	94.30	0.69	10.04
2256	(4) 10-Year	1.57	93.49	94.23	0.66	8.25
2256	(4) 25-Year	2.25	93.49	94.33	0.71	14.19
2256	(4) 100-Year	2.86	93.49	94.42	0.75	43.21
2254	(2) 2-Year	4.13	93.46	94.54	0.82	17.68
2254	(2) 5-Year	5.24	93.46	94.64	0.87	21.16
2254	(2) 10-Year	6.00	93.46	94.70	0.91	23.53
2254	(2) 25-Year	6.94	93.46	94.77	0.94	27.32
2254	(2) 100-Year	8.32	93.46	94.90	0.95	35.98

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2254	(4) 2-Year	3.97	93.46	94.53	0.81	16.50
2254	(4) 5-Year	2.02	93.46	94.28	0.69	9.96
2254	(4) 10-Year	1.57	93.46	94.21	0.65	8.19
2254	(4) 25-Year	2.25	93.46	94.31	0.70	14.10
2254	(4) 100-Year	2.86	93.46	94.40	0.74	43.10
2235	(2) 2-Year	4.13	93.44	94.53	0.80	17.54
2235	(2) 5-Year	5.24	93.44	94.62	0.86	20.98
2235	(2) 10-Year	6.00	93.44	94.68	0.89	23.32
2235	(2) 25-Year	6.94	93.44	94.75	0.93	27.09
2235	(2) 100-Year	8.32	93.44	94.88	0.93	35.69
2235	(4) 2-Year	3.97	93.44	94.51	0.80	16.36
2235	(4) 5-Year	2.02	93.44	94.26	0.68	9.88
2235	(4) 10-Year	1.57	93.44	94.19	0.64	8.12
2235	(4) 25-Year	2.25	93.44	94.29	0.70	14.01
2235	(4) 100-Year	2.86	93.44	94.38	0.73	42.99
2207	(2) 2-Year	4.13	93.40	94.50	0.80	17.32
2207	(2) 5-Year	5.24	93.40	94.59	0.86	20.70
2207	(2) 10-Year	6.00	93.40	94.66	0.89	23.01
2207	(2) 25-Year	6.94	93.40	94.72	0.93	26.74
2207	(2) 100-Year	8.32	93.40	94.86	0.93	35.27
2207	(4) 2-Year	3.97	93.40	94.48	0.80	16.15
2207	(4) 5-Year	2.02	93.40	94.23	0.68	9.76
2207	(4) 10-Year	1.57	93.40	94.16	0.65	8.02
2207	(4) 25-Year	2.25	93.40	94.26	0.70	13.88
2207	(4) 100-Year	2.86	93.40	94.35	0.73	42.83
2188	(2) 2-Year	5.00	93.37	94.47	0.96	17.17
2188	(2) 5-Year	6.32	93.37	94.56	1.03	20.52
2188	(2) 10-Year	7.24	93.37	94.62	1.07	22.81
2188	(2) 25-Year	8.38	93.37	94.69	1.12	26.51
2188	(2) 100-Year	10.81	93.37	94.82	1.21	34.99
2188	(4) 2-Year	4.78	93.37	94.45	0.95	16.01
2188	(4) 5-Year	2.33	93.37	94.20	0.77	9.68
2188	(4) 10-Year	1.78	93.37	94.13	0.71	7.96
2188	(4) 25-Year	2.60	93.37	94.23	0.79	13.79
2188	(4) 100-Year	3.29	93.37	94.32	0.82	42.72
2163	(2) 2-Year	5.00	93.34	94.43	0.95	16.98
2163	(2) 5-Year	6.32	93.34	94.53	1.02	20.29
2163	(2) 10-Year	7.24	93.34	94.59	1.06	22.54
2163	(2) 25-Year	8.38	93.34	94.66	1.11	26.21
2163	(2) 100-Year	10.81	93.34	94.79	1.20	34.62
2163	(4) 2-Year	4.78	93.34	94.42	0.94	15.83
2163	(4) 5-Year	2.33	93.34	94.17	0.77	9.57
2163	(4) 10-Year	1.78	93.34	94.10	0.71	7.87
2163	(4) 25-Year	2.60	93.34	94.20	0.79	13.67
2163	(4) 100-Year	3.29	93.34	94.30	0.81	42.58
2141	(2) 2-Year	5.00	93.31	94.41	0.95	16.81
2141	(2) 5-Year	6.32	93.31	94.50	1.02	20.07

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2141	(2) 10-Year	7.24	93.31	94.56	1.06	22.30
2141	(2) 25-Year	8.38	93.31	94.63	1.11	25.94
2141	(2) 100-Year	10.81	93.31	94.76	1.20	34.30
2141	(4) 2-Year	4.78	93.31	94.39	0.94	15.66
2141	(4) 5-Year	2.33	93.31	94.14	0.77	9.48
2141	(4) 10-Year	1.78	93.31	94.07	0.71	7.79
2141	(4) 25-Year	2.60	93.31	94.17	0.79	13.57
2141	(4) 100-Year	3.29	93.31	94.27	0.80	42.45
2121	(2) 2-Year	5.00	93.28	94.38	0.94	16.65
2121	(2) 5-Year	6.32	93.28	94.48	1.01	19.88
2121	(2) 10-Year	7.24	93.28	94.53	1.05	22.08
2121	(2) 25-Year	8.38	93.28	94.60	1.10	25.70
2121	(2) 100-Year	10.81	93.28	94.73	1.20	34.00
2121	(4) 2-Year	4.78	93.28	94.36	0.94	15.51
2121	(4) 5-Year	2.33	93.28	94.11	0.76	9.39
2121	(4) 10-Year	1.78	93.28	94.04	0.70	7.72
2121	(4) 25-Year	2.60	93.28	94.15	0.78	13.48
2121	(4) 100-Year	3.29	93.28	94.25	0.79	42.34
2101	(2) 2-Year	5.00	93.26	94.35	0.96	16.49
2101	(2) 5-Year	6.32	93.26	94.45	1.03	19.68
2101	(2) 10-Year	7.24	93.26	94.51	1.07	21.86
2101	(2) 25-Year	8.38	93.26	94.57	1.12	25.45
2101	(2) 100-Year	10.81	93.26	94.70	1.21	33.69
2101	(4) 2-Year	4.78	93.26	94.33	0.95	15.36
2101	(4) 5-Year	2.33	93.26	94.09	0.77	9.30
2101	(4) 10-Year	1.78	93.26	94.01	0.72	7.65
2101	(4) 25-Year	2.60	93.26	94.12	0.79	13.38
2101	(4) 100-Year	3.29	93.26	94.23	0.79	42.22
2080	(2) 2-Year	5.00	93.24	94.32	0.98	16.33
2080	(2) 5-Year	6.32	93.24	94.42	1.05	19.48
2080	(2) 10-Year	7.24	93.24	94.48	1.09	21.64
2080	(2) 25-Year	8.38	93.24	94.54	1.14	25.20
2080	(2) 100-Year	10.81	93.24	94.67	1.23	33.39
2080	(4) 2-Year	4.78	93.24	94.30	0.97	15.21
2080	(4) 5-Year	2.33	93.24	94.05	0.80	9.21
2080	(4) 10-Year	1.78	93.24	93.98	0.75	7.58
2080	(4) 25-Year	2.60	93.24	94.09	0.81	13.28
2080	(4) 100-Year	3.29	93.24	94.20	0.80	42.09
2059	(2) 2-Year	5.00	93.21	94.29	0.98	16.17
2059	(2) 5-Year	6.32	93.21	94.39	1.05	19.28
2059	(2) 10-Year	7.24	93.21	94.45	1.09	21.41
2059	(2) 25-Year	8.38	93.21	94.51	1.14	24.94
2059	(2) 100-Year	10.81	93.21	94.63	1.24	33.08
2059	(4) 2-Year	4.78	93.21	94.27	0.97	15.05
2059	(4) 5-Year	2.33	93.21	94.02	0.81	9.13
2059	(4) 10-Year	1.78	93.21	93.94	0.76	7.51
2059	(4) 25-Year	2.60	93.21	94.06	0.82	13.19
2059	(4) 100-Year	3.29	93.21	94.18	0.79	41.96

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
2038	(2) 2-Year	5.00	93.18	94.27	0.97	16.03
2038	(2) 5-Year	6.32	93.18	94.36	1.03	19.10
2038	(2) 10-Year	7.24	93.18	94.42	1.08	21.22
2038	(2) 25-Year	8.38	93.18	94.49	1.13	24.72
2038	(2) 100-Year	10.81	93.18	94.61	1.23	32.81
2038	(4) 2-Year	4.78	93.18	94.24	0.96	14.92
2038	(4) 5-Year	2.33	93.18	93.99	0.80	9.05
2038	(4) 10-Year	1.78	93.18	93.91	0.76	7.45
2038	(4) 25-Year	2.60	93.18	94.03	0.81	13.10
2038	(4) 100-Year	3.29	93.18	94.16	0.77	41.85
2017	(2) 2-Year	5.00	93.17	94.25	0.99	15.96
2017	(2) 5-Year	6.32	93.17	94.35	1.06	19.03
2017	(2) 10-Year	7.24	93.17	94.41	1.10	21.13
2017	(2) 25-Year	8.38	93.17	94.47	1.15	24.62
2017	(2) 100-Year	10.81	93.17	94.59	1.25	32.69
2017	(4) 2-Year	4.78	93.17	94.23	0.98	14.87
2017	(4) 5-Year	2.33	93.17	93.98	0.82	9.02
2017	(4) 10-Year	1.78	93.17	93.90	0.79	7.42
2017	(4) 25-Year	2.60	93.17	94.02	0.82	13.07
2017	(4) 100-Year	3.29	93.17	94.15	0.78	41.81
2003	(2) 2-Year	5.00	93.16	94.24	1.00	15.91
2003	(2) 5-Year	6.32	93.16	94.34	1.07	18.96
2003	(2) 10-Year	7.24	93.16	94.39	1.11	21.05
2003	(2) 25-Year	8.38	93.16	94.46	1.16	24.53
2003	(2) 100-Year	10.81	93.16	94.58	1.26	32.58
2003	(4) 2-Year	4.78	93.16	94.22	0.99	14.81
2003	(4) 5-Year	2.33	93.16	93.97	0.83	8.99
2003	(4) 10-Year	1.78	93.16	93.88	0.81	7.40
2003	(4) 25-Year	2.60	93.16	94.01	0.84	13.03
2003	(4) 100-Year	3.29	93.16	94.14	0.78	41.76
1982	(2) 2-Year	5.00	93.12	94.22	0.96	15.75
1982	(2) 5-Year	6.32	93.12	94.31	1.03	18.76
1982	(2) 10-Year	7.24	93.12	94.37	1.07	20.83
1982	(2) 25-Year	8.38	93.12	94.43	1.12	24.28
1982	(2) 100-Year	10.81	93.12	94.55	1.23	32.28
1982	(4) 2-Year	4.78	93.12	94.19	0.95	14.67
1982	(4) 5-Year	2.33	93.12	93.94	0.79	8.90
1982	(4) 10-Year	1.78	93.12	93.85	0.78	7.34
1982	(4) 25-Year	2.60	93.12	93.98	0.80	12.94
1982	(4) 100-Year	3.29	93.12	94.12	0.74	41.63
1961	(2) 2-Year	5.00	93.08	94.19	0.93	15.59
1961	(2) 5-Year	6.32	93.08	94.28	1.00	18.56
1961	(2) 10-Year	7.24	93.08	94.34	1.05	20.60
1961	(2) 25-Year	8.38	93.08	94.41	1.10	24.03
1961	(2) 100-Year	10.81	93.08	94.52	1.21	31.98
1961	(4) 2-Year	4.78	93.08	94.17	0.93	14.51
1961	(4) 5-Year	2.33	93.08	93.91	0.77	8.82

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1961	(4) 10-Year	1.78	93.08	93.81	0.77	7.27
1961	(4) 25-Year	2.60	93.08	93.95	0.77	12.84
1961	(4) 100-Year	3.29	93.08	94.11	0.71	41.50
1940	(2) 2-Year	5.00	93.04	94.17	0.90	15.42
1940	(2) 5-Year	6.32	93.04	94.26	0.97	18.35
1940	(2) 10-Year	7.24	93.04	94.32	1.02	20.37
1940	(2) 25-Year	8.38	93.04	94.38	1.07	23.77
1940	(2) 100-Year	10.81	93.04	94.50	1.19	31.67
1940	(4) 2-Year	4.78	93.04	94.14	0.90	14.35
1940	(4) 5-Year	2.33	93.04	93.88	0.74	8.72
1940	(4) 10-Year	1.78	93.04	93.78	0.75	7.20
1940	(4) 25-Year	2.60	93.04	93.93	0.74	12.74
1940	(4) 100-Year	3.29	93.04	94.09	0.68	41.36
1919	(2) 2-Year	5.00	93.01	94.15	0.88	15.24
1919	(2) 5-Year	6.32	93.01	94.24	0.95	18.14
1919	(2) 10-Year	7.24	93.01	94.29	1.00	20.13
1919	(2) 25-Year	8.38	93.01	94.36	1.05	23.50
1919	(2) 100-Year	10.81	93.01	94.47	1.17	31.35
1919	(4) 2-Year	4.78	93.01	94.12	0.88	14.18
1919	(4) 5-Year	2.33	93.01	93.86	0.72	8.63
1919	(4) 10-Year	1.78	93.01	93.75	0.74	7.13
1919	(4) 25-Year	2.60	93.01	93.91	0.72	12.63
1919	(4) 100-Year	3.29	93.01	94.08	0.65	41.21
1898	(2) 2-Year	5.00	92.97	94.13	0.85	15.06
1898	(2) 5-Year	6.32	92.97	94.22	0.92	17.91
1898	(2) 10-Year	7.24	92.97	94.27	0.97	19.89
1898	(2) 25-Year	8.38	92.97	94.34	1.03	23.23
1898	(2) 100-Year	10.81	92.97	94.45	1.15	31.03
1898	(4) 2-Year	4.78	92.97	94.10	0.85	14.01
1898	(4) 5-Year	2.33	92.97	93.84	0.69	8.53
1898	(4) 10-Year	1.78	92.97	93.72	0.72	7.06
1898	(4) 25-Year	2.60	92.97	93.89	0.68	12.52
1898	(4) 100-Year	3.29	92.97	94.07	0.62	41.05
1877	(2) 2-Year	5.00	92.93	94.11	0.82	14.86
1877	(2) 5-Year	6.32	92.93	94.20	0.89	17.68
1877	(2) 10-Year	7.24	92.93	94.25	0.94	19.63
1877	(2) 25-Year	8.38	92.93	94.32	1.00	22.95
1877	(2) 100-Year	10.81	92.93	94.42	1.12	30.70
1877	(4) 2-Year	4.78	92.93	94.08	0.81	13.82
1877	(4) 5-Year	2.33	92.93	93.82	0.66	8.43
1877	(4) 10-Year	1.78	92.93	93.69	0.69	6.99
1877	(4) 25-Year	2.60	92.93	93.87	0.65	12.41
1877	(4) 100-Year	3.29	92.93	94.06	0.58	40.88
1857	(2) 2-Year	5.00	92.89	94.09	0.79	14.66
1857	(2) 5-Year	6.32	92.89	94.18	0.87	17.44
1857	(2) 10-Year	7.24	92.89	94.24	0.92	19.37
1857	(2) 25-Year	8.38	92.89	94.30	0.98	22.66

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1857	(2) 100-Year	10.81	92.89	94.40	1.10	30.37
1857	(4) 2-Year	4.78	92.89	94.07	0.79	13.63
1857	(4) 5-Year	2.33	92.89	93.80	0.63	8.32
1857	(4) 10-Year	1.78	92.89	93.67	0.67	6.91
1857	(4) 25-Year	2.60	92.89	93.86	0.62	12.29
1857	(4) 100-Year	3.29	92.89	94.05	0.56	40.69
1837	(2) 2-Year	5.00	92.86	94.08	0.76	14.45
1837	(2) 5-Year	6.32	92.86	94.17	0.84	17.20
1837	(2) 10-Year	7.24	92.86	94.22	0.89	19.10
1837	(2) 25-Year	8.38	92.86	94.28	0.95	22.36
1837	(2) 100-Year	10.81	92.86	94.38	1.08	30.03
1837	(4) 2-Year	4.78	92.86	94.05	0.76	13.43
1837	(4) 5-Year	2.33	92.86	93.79	0.60	8.21
1837	(4) 10-Year	1.78	92.86	93.65	0.64	6.83
1837	(4) 25-Year	2.60	92.86	93.85	0.60	12.16
1837	(4) 100-Year	3.29	92.86	94.04	0.53	40.50
1817	(2) 2-Year	5.00	92.81	94.06	0.73	14.23
1817	(2) 5-Year	6.32	92.81	94.15	0.81	16.94
1817	(2) 10-Year	7.24	92.81	94.20	0.87	18.82
1817	(2) 25-Year	8.38	92.81	94.26	0.93	22.06
1817	(2) 100-Year	10.81	92.81	94.36	1.06	29.68
1817	(4) 2-Year	4.78	92.81	94.04	0.73	13.23
1817	(4) 5-Year	2.33	92.81	93.78	0.57	8.09
1817	(4) 10-Year	1.78	92.81	93.63	0.60	6.75
1817	(4) 25-Year	2.60	92.81	93.84	0.56	12.03
1817	(4) 100-Year	3.29	92.81	94.04	0.50	40.30
1797	(2) 2-Year	5.00	92.77	94.05	0.70	14.00
1797	(2) 5-Year	6.32	92.77	94.14	0.78	16.68
1797	(2) 10-Year	7.24	92.77	94.19	0.83	18.54
1797	(2) 25-Year	8.38	92.77	94.25	0.90	21.74
1797	(2) 100-Year	10.81	92.77	94.34	1.03	29.32
1797	(4) 2-Year	4.78	92.77	94.03	0.70	13.01
1797	(4) 5-Year	2.33	92.77	93.77	0.53	7.97
1797	(4) 10-Year	1.78	92.77	93.62	0.56	6.66
1797	(4) 25-Year	2.60	92.77	93.83	0.53	11.89
1797	(4) 100-Year	3.29	92.77	94.03	0.48	40.08
1777	(2) 2-Year	5.00	92.73	94.04	0.66	13.76
1777	(2) 5-Year	6.32	92.73	94.13	0.74	16.40
1777	(2) 10-Year	7.24	92.73	94.18	0.79	18.23
1777	(2) 25-Year	8.38	92.73	94.24	0.86	21.42
1777	(2) 100-Year	10.81	92.73	94.33	0.99	28.96
1777	(4) 2-Year	4.78	92.73	94.02	0.66	12.77
1777	(4) 5-Year	2.33	92.73	93.76	0.50	7.83
1777	(4) 10-Year	1.78	92.73	93.61	0.52	6.56
1777	(4) 25-Year	2.60	92.73	93.82	0.50	11.73
1777	(4) 100-Year	3.29	92.73	94.03	0.45	39.84
1757	(2) 2-Year	5.00	92.69	94.04	0.64	13.50

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1757	(2) 5-Year	6.32	92.69	94.12	0.72	16.10
1757	(2) 10-Year	7.24	92.69	94.17	0.77	17.92
1757	(2) 25-Year	8.38	92.69	94.22	0.83	21.08
1757	(2) 100-Year	10.81	92.69	94.31	0.97	28.58
1757	(4) 2-Year	4.78	92.69	94.01	0.63	12.53
1757	(4) 5-Year	2.33	92.69	93.75	0.47	7.69
1757	(4) 10-Year	1.78	92.69	93.60	0.49	6.46
1757	(4) 25-Year	2.60	92.69	93.81	0.47	11.57
1757	(4) 100-Year	3.29	92.69	94.02	0.43	39.59
1736	(2) 2-Year	5.00	92.66	94.03	0.61	13.23
1736	(2) 5-Year	6.32	92.66	94.11	0.69	15.80
1736	(2) 10-Year	7.24	92.66	94.16	0.74	17.60
1736	(2) 25-Year	8.38	92.66	94.21	0.81	20.73
1736	(2) 100-Year	10.81	92.66	94.30	0.94	28.19
1736	(4) 2-Year	4.78	92.66	94.00	0.61	12.27
1736	(4) 5-Year	2.33	92.66	93.75	0.45	7.54
1736	(4) 10-Year	1.78	92.66	93.59	0.47	6.35
1736	(4) 25-Year	2.60	92.66	93.81	0.45	11.39
1736	(4) 100-Year	3.29	92.66	94.02	0.41	39.33
1715	(2) 2-Year	5.00	92.62	94.02	0.58	12.95
1715	(2) 5-Year	6.32	92.62	94.10	0.66	15.48
1715	(2) 10-Year	7.24	92.62	94.15	0.71	17.26
1715	(2) 25-Year	8.38	92.62	94.20	0.77	20.37
1715	(2) 100-Year	10.81	92.62	94.29	0.91	27.79
1715	(4) 2-Year	4.78	92.62	93.99	0.57	12.00
1715	(4) 5-Year	2.33	92.62	93.74	0.42	7.37
1715	(4) 10-Year	1.78	92.62	93.58	0.43	6.23
1715	(4) 25-Year	2.60	92.62	93.80	0.42	11.20
1715	(4) 100-Year	3.29	92.62	94.02	0.38	39.05
1694	(2) 2-Year	5.00	92.58	94.02	0.56	12.65
1694	(2) 5-Year	6.32	92.58	94.09	0.64	15.15
1694	(2) 10-Year	7.24	92.58	94.14	0.69	16.91
1694	(2) 25-Year	8.38	92.58	94.19	0.75	19.99
1694	(2) 100-Year	10.81	92.58	94.28	0.89	27.37
1694	(4) 2-Year	4.78	92.58	93.99	0.55	11.72
1694	(4) 5-Year	2.33	92.58	93.74	0.39	7.19
1694	(4) 10-Year	1.78	92.58	93.58	0.41	6.10
1694	(4) 25-Year	2.60	92.58	93.80	0.40	10.99
1694	(4) 100-Year	3.29	92.58	94.01	0.37	38.75
1673	(2) 2-Year	5.00	92.53	94.01	0.53	12.34
1673	(2) 5-Year	6.32	92.53	94.09	0.61	14.81
1673	(2) 10-Year	7.24	92.53	94.13	0.66	16.54
1673	(2) 25-Year	8.38	92.53	94.19	0.72	19.60
1673	(2) 100-Year	10.81	92.53	94.26	0.86	26.95
1673	(4) 2-Year	4.78	92.53	93.98	0.52	11.42
1673	(4) 5-Year	2.33	92.53	93.74	0.37	6.99
1673	(4) 10-Year	1.78	92.53	93.57	0.38	5.97
1673	(4) 25-Year	2.60	92.53	93.80	0.37	10.77

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1673	(4) 100-Year	3.29	92.53	94.01	0.35	38.44
1653	(2) 2-Year	5.00	92.50	94.01	0.51	12.01
1653	(2) 5-Year	6.32	92.50	94.08	0.59	14.45
1653	(2) 10-Year	7.24	92.50	94.13	0.64	16.16
1653	(2) 25-Year	8.38	92.50	94.18	0.70	19.20
1653	(2) 100-Year	10.81	92.50	94.26	0.83	26.51
1653	(4) 2-Year	4.78	92.50	93.98	0.50	11.10
1653	(4) 5-Year	2.33	92.50	93.73	0.35	6.78
1653	(4) 10-Year	1.78	92.50	93.57	0.36	5.82
1653	(4) 25-Year	2.60	92.50	93.79	0.35	10.53
1653	(4) 100-Year	3.29	92.50	94.01	0.33	38.11
1632	(2) 2-Year	5.00	92.46	94.00	0.49	11.68
1632	(2) 5-Year	6.32	92.46	94.08	0.57	14.08
1632	(2) 10-Year	7.24	92.46	94.12	0.62	15.77
1632	(2) 25-Year	8.38	92.46	94.17	0.68	18.78
1632	(2) 100-Year	10.81	92.46	94.25	0.82	26.06
1632	(4) 2-Year	4.78	92.46	93.97	0.49	10.78
1632	(4) 5-Year	2.33	92.46	93.73	0.33	6.56
1632	(4) 10-Year	1.78	92.46	93.56	0.34	5.66
1632	(4) 25-Year	2.60	92.46	93.79	0.34	10.29
1632	(4) 100-Year	3.29	92.46	94.01	0.32	37.77
1615	(2) 2-Year	5.00	92.43	94.00	0.47	11.39
1615	(2) 5-Year	6.32	92.43	94.07	0.55	13.76
1615	(2) 10-Year	7.24	92.43	94.12	0.60	15.44
1615	(2) 25-Year	8.38	92.43	94.17	0.66	18.43
1615	(2) 100-Year	10.81	92.43	94.24	0.79	25.68
1615	(4) 2-Year	4.78	92.43	93.97	0.47	10.50
1615	(4) 5-Year	2.33	92.43	93.73	0.32	6.36
1615	(4) 10-Year	1.78	92.43	93.56	0.32	5.52
1615	(4) 25-Year	2.60	92.43	93.79	0.32	10.07
1615	(4) 100-Year	3.29	92.43	94.01	0.31	37.48
1555	(2) 2-Year	5.00	92.35	93.99	0.42	10.29
1555	(2) 5-Year	6.32	92.35	94.06	0.49	12.57
1555	(2) 10-Year	7.24	92.35	94.10	0.54	14.19
1555	(2) 25-Year	8.38	92.35	94.15	0.59	17.12
1555	(2) 100-Year	10.81	92.35	94.22	0.71	24.27
1555	(4) 2-Year	4.78	92.35	93.96	0.42	9.44
1555	(4) 5-Year	2.33	92.35	93.72	0.29	5.61
1555	(4) 10-Year	1.78	92.35	93.55	0.30	4.97
1555	(4) 25-Year	2.60	92.35	93.79	0.29	9.24
1555	(4) 100-Year	3.29	92.35	94.00	0.27	36.37
1488	(2) 2-Year	5.00	92.28	93.98	0.39	8.97
1488	(2) 5-Year	6.32	92.28	94.05	0.45	11.14
1488	(2) 10-Year	7.24	92.28	94.09	0.50	12.70
1488	(2) 25-Year	8.38	92.28	94.14	0.55	15.56
1488	(2) 100-Year	10.81	92.28	94.20	0.67	22.62
1488	(4) 2-Year	4.78	92.28	93.95	0.38	8.16

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1488	(4) 5-Year	2.33	92.28	93.72	0.26	4.66
1488	(4) 10-Year	1.78	92.28	93.55	0.26	4.26
1488	(4) 25-Year	2.60	92.28	93.78	0.26	8.20
1488	(4) 100-Year	3.29	92.28	94.00	0.25	35.03
1416	(2) 2-Year	5.00	92.20	93.98	0.36	7.64
1416	(2) 5-Year	6.32	92.20	94.04	0.43	9.72
1416	(2) 10-Year	7.24	92.20	94.08	0.47	11.22
1416	(2) 25-Year	8.38	92.20	94.13	0.52	14.02
1416	(2) 100-Year	10.81	92.20	94.18	0.64	21.00
1416	(4) 2-Year	4.78	92.20	93.95	0.35	6.88
1416	(4) 5-Year	2.33	92.20	93.71	0.23	3.69
1416	(4) 10-Year	1.78	92.20	93.54	0.22	3.49
1416	(4) 25-Year	2.60	92.20	93.78	0.23	7.15
1416	(4) 100-Year	3.29	92.20	94.00	0.23	33.68
1400	(2) 2-Year	5.00	92.17	93.97	0.35	7.11
1400	(2) 5-Year	6.32	92.17	94.04	0.41	9.15
1400	(2) 10-Year	7.24	92.17	94.08	0.46	10.63
1400	(2) 25-Year	8.38	92.17	94.12	0.51	13.41
1400	(2) 100-Year	10.81	92.17	94.18	0.62	20.36
1400	(4) 2-Year	4.78	92.17	93.95	0.34	6.36
1400	(4) 5-Year	2.33	92.17	93.71	0.22	3.28
1400	(4) 10-Year	1.78	92.17	93.54	0.21	3.17
1400	(4) 25-Year	2.60	92.17	93.78	0.22	6.71
1400	(4) 100-Year	3.29	92.17	94.00	0.22	33.13
1364	(2) 2-Year	5.00	91.63	93.97	0.24	6.23
1364	(2) 5-Year	6.32	91.63	94.04	0.28	8.22
1364	(2) 10-Year	7.24	91.63	94.08	0.32	9.67
1364	(2) 25-Year	8.38	91.63	94.12	0.36	12.41
1364	(2) 100-Year	10.81	91.63	94.17	0.45	19.32
1364	(4) 2-Year	4.78	91.63	93.94	0.23	5.50
1364	(4) 5-Year	2.33	91.63	93.71	0.13	2.60
1364	(4) 10-Year	1.78	91.63	93.54	0.12	2.60
1364	(4) 25-Year	2.60	91.63	93.78	0.14	5.98
1364	(4) 100-Year	3.29	91.63	94.00	0.15	32.24
1340	(2) 2-Year	5.79	91.60	93.97	0.27	5.60
1340	(2) 5-Year	7.32	91.60	94.04	0.33	7.56
1340	(2) 10-Year	8.33	91.60	94.08	0.37	8.99
1340	(2) 25-Year	9.65	91.60	94.12	0.41	11.71
1340	(2) 100-Year	11.62	91.60	94.17	0.48	18.58
1340	(4) 2-Year	5.26	91.60	93.94	0.25	4.88
1340	(4) 5-Year	2.44	91.60	93.71	0.14	2.09
1340	(4) 10-Year	1.86	91.60	93.54	0.12	2.18
1340	(4) 25-Year	2.71	91.60	93.78	0.15	5.44
1340	(4) 100-Year	3.43	91.60	94.00	0.16	31.59
1312	(2) 2-Year	6.08	92.47	93.95	0.71	5.07
1312	(2) 5-Year	7.69	92.47	94.00	0.85	7.00
1312	(2) 10-Year	8.76	92.47	94.03	0.95	8.41

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1312	(2) 25-Year	10.15	92.47	94.06	1.08	11.11
1312	(2) 100-Year	12.20	92.47	94.09	1.27	17.97
1312	(4) 2-Year	5.46	92.47	93.92	0.65	4.37
1312	(4) 5-Year	2.47	92.47	93.71	0.36	1.67
1312	(4) 10-Year	1.87	92.47	93.54	0.32	1.82
1312	(4) 25-Year	2.73	92.47	93.77	0.37	5.00
1312	(4) 100-Year	3.44	92.47	93.99	0.39	31.05
1302	(2) 2-Year	6.08	92.57	93.91	1.03	4.98
1302	(2) 5-Year	7.69	92.57	93.97	1.13	6.90
1302	(2) 10-Year	8.76	92.57	94.00	1.18	8.31
1302	(2) 25-Year	10.15	92.57	94.04	1.26	11.00
1302	(2) 100-Year	12.20	92.57	94.07	1.39	17.85
1302	(4) 2-Year	5.46	92.57	93.89	0.98	4.29
1302	(4) 5-Year	2.47	92.57	93.68	0.77	1.62
1302	(4) 10-Year	1.87	92.57	93.50	0.85	1.79
1302	(4) 25-Year	2.73	92.57	93.74	0.73	4.94
1302	(4) 100-Year	3.44	92.57	93.98	0.49	30.95
1268	(2) 2-Year	6.08	92.47	93.87	0.59	4.63
1268	(2) 5-Year	7.69	92.47	93.93	0.62	6.46
1268	(2) 10-Year	8.76	92.47	93.96	0.64	7.77
1268	(2) 25-Year	10.15	92.47	94.00	0.67	10.34
1268	(2) 100-Year	12.20	92.47	94.05	0.64	16.97
1268	(4) 2-Year	5.46	92.47	93.84	0.57	3.96
1268	(4) 5-Year	2.47	92.47	93.59	0.68	1.50
1268	(4) 10-Year	1.87	92.47	93.42	0.81	1.71
1268	(4) 25-Year	2.73	92.47	93.67	0.53	4.78
1268	(4) 100-Year	3.44	92.47	93.98	0.24	30.39
1212	(2) 2-Year	6.08	92.36	93.78	0.84	3.93
1212	(2) 5-Year	7.69	92.36	93.85	0.85	5.52
1212	(2) 10-Year	8.76	92.36	93.88	0.86	6.62
1212	(2) 25-Year	10.15	92.36	93.93	0.84	8.90
1212	(2) 100-Year	12.20	92.36	94.00	0.80	15.06
1212	(4) 2-Year	5.46	92.36	93.74	0.83	3.36
1212	(4) 5-Year	2.47	92.36	93.40	0.89	1.32
1212	(4) 10-Year	1.87	92.36	93.30	0.83	1.58
1212	(4) 25-Year	2.73	92.36	93.54	0.74	4.52
1212	(4) 100-Year	3.44	92.36	93.97	0.24	28.91
1169	(2) 2-Year	6.08	92.30	93.70	0.86	3.39
1169	(2) 5-Year	7.69	92.30	93.76	0.91	4.74
1169	(2) 10-Year	8.76	92.30	93.80	0.95	5.69
1169	(2) 25-Year	10.15	92.30	93.84	0.99	7.78
1169	(2) 100-Year	12.20	92.30	93.91	1.04	13.62
1169	(4) 2-Year	5.46	92.30	93.67	0.83	2.90
1169	(4) 5-Year	2.47	92.30	93.32	0.73	1.19
1169	(4) 10-Year	1.87	92.30	93.24	0.65	1.47
1169	(4) 25-Year	2.73	92.30	93.49	0.59	4.34
1169	(4) 100-Year	3.44	92.30	93.97	0.28	27.40

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
1091	(2) 2-Year	6.08	92.15	93.57	0.83	2.61
1091	(2) 5-Year	7.69	92.15	93.64	0.85	3.66
1091	(2) 10-Year	8.76	92.15	93.68	0.88	4.46
1091	(2) 25-Year	10.15	92.15	93.72	0.91	6.34
1091	(2) 100-Year	12.20	92.15	93.80	0.88	11.79
1091	(4) 2-Year	5.46	92.15	93.53	0.82	2.26
1091	(4) 5-Year	2.47	92.15	93.18	0.71	0.93
1091	(4) 10-Year	1.87	92.15	93.14	0.58	1.23
1091	(4) 25-Year	2.73	92.15	93.42	0.51	3.95
1091	(4) 100-Year	3.44	92.15	93.96	0.19	24.74
1002	(2) 2-Year	6.08	92.06	93.36	1.06	1.89
1002	(2) 5-Year	7.69	92.06	93.45	1.07	2.63
1002	(2) 10-Year	8.76	92.06	93.50	1.06	3.23
1002	(2) 25-Year	10.15	92.06	93.57	0.99	4.83
1002	(2) 100-Year	12.20	92.06	93.70	0.86	9.70
1002	(4) 2-Year	5.46	92.06	93.32	1.03	1.66
1002	(4) 5-Year	2.47	92.06	93.00	0.85	0.65
1002	(4) 10-Year	1.87	92.06	93.04	0.60	0.95
1002	(4) 25-Year	2.73	92.06	93.37	0.47	3.42
1002	(4) 100-Year	3.44	92.06	93.96	0.14	20.77
961	(2) 2-Year	6.08	91.96	93.25	0.88	1.61
961	(2) 5-Year	7.69	91.96	93.33	0.93	2.25
961	(2) 10-Year	8.76	91.96	93.38	0.95	2.77
961	(2) 25-Year	10.15	91.96	93.48	0.88	4.20
961	(2) 100-Year	12.20	91.96	93.67	0.55	8.56
961	(4) 2-Year	5.46	91.96	93.22	0.85	1.41
961	(4) 5-Year	2.47	91.96	92.95	0.64	0.51
961	(4) 10-Year	1.87	91.96	93.02	0.43	0.80
961	(4) 25-Year	2.73	91.96	93.35	0.32	3.09
961	(4) 100-Year	3.44	91.96	93.96	0.08	18.02
910	(2) 2-Year	6.08	91.93	93.17	0.79	0.99
910	(2) 5-Year	7.69	91.93	93.26	0.80	1.41
910	(2) 10-Year	8.76	91.93	93.32	0.77	1.75
910	(2) 25-Year	10.15	91.93	93.43	0.70	2.59
910	(2) 100-Year	12.20	91.93	93.65	0.44	5.00
910	(4) 2-Year	5.46	91.93	93.14	0.78	0.86
910	(4) 5-Year	2.47	91.93	92.89	0.67	0.31
910	(4) 10-Year	1.87	91.93	93.00	0.40	0.51
910	(4) 25-Year	2.73	91.93	93.35	0.24	2.01
910	(4) 100-Year	3.44	91.93	93.96	0.06	10.36
840	(2) 2-Year	6.08	91.86	93.10	0.50	
840	(2) 5-Year	7.69	91.86	93.21	0.48	
840	(2) 10-Year	8.76	91.86	93.28	0.46	
840	(2) 25-Year	10.15	91.86	93.41	0.41	
840	(2) 100-Year	12.20	91.86	93.64	0.34	
840	(4) 2-Year	5.46	91.86	93.06	0.51	
840	(4) 5-Year	2.47	91.86	92.80	0.52	
840	(4) 10-Year	1.87	91.86	92.97	0.23	

Table D-2: HEC-RAS Results for Van Gaal Drain Reach 2 Under Proposed Conditions (Riparian) ⁽¹⁾

HEC-RAS River Station	Profile	Flow (m ³ /s)	Minimum Channel Elevation (m)	Water Surface Elevation (m)	Channel Velocity (m/s)	Cumulative Volume (1000 m ³)
840	(4) 25-Year	2.73	91.86	93.34	0.12	
840	(4) 100-Year	3.44	91.86	93.96	0.05	


⁽¹⁾ All channel infrastructure removed from the HEC-RAS model for riparian storage analysis.

For Scenario 2 (the Van Gaal Drain 100-year spring snowmelt plus rainfall peak flow reaches the Jock River) and Scenario 4 (the Jock River 100-year spring snowmelt plus rainfall peak flow reaches the outlet of the Van Gaal Drain).

Attachment E

Figure 1

*Richmond Village Development / Proposed
Realignment of the Van Gaal Drain by JFSA (April
20, 2017).*

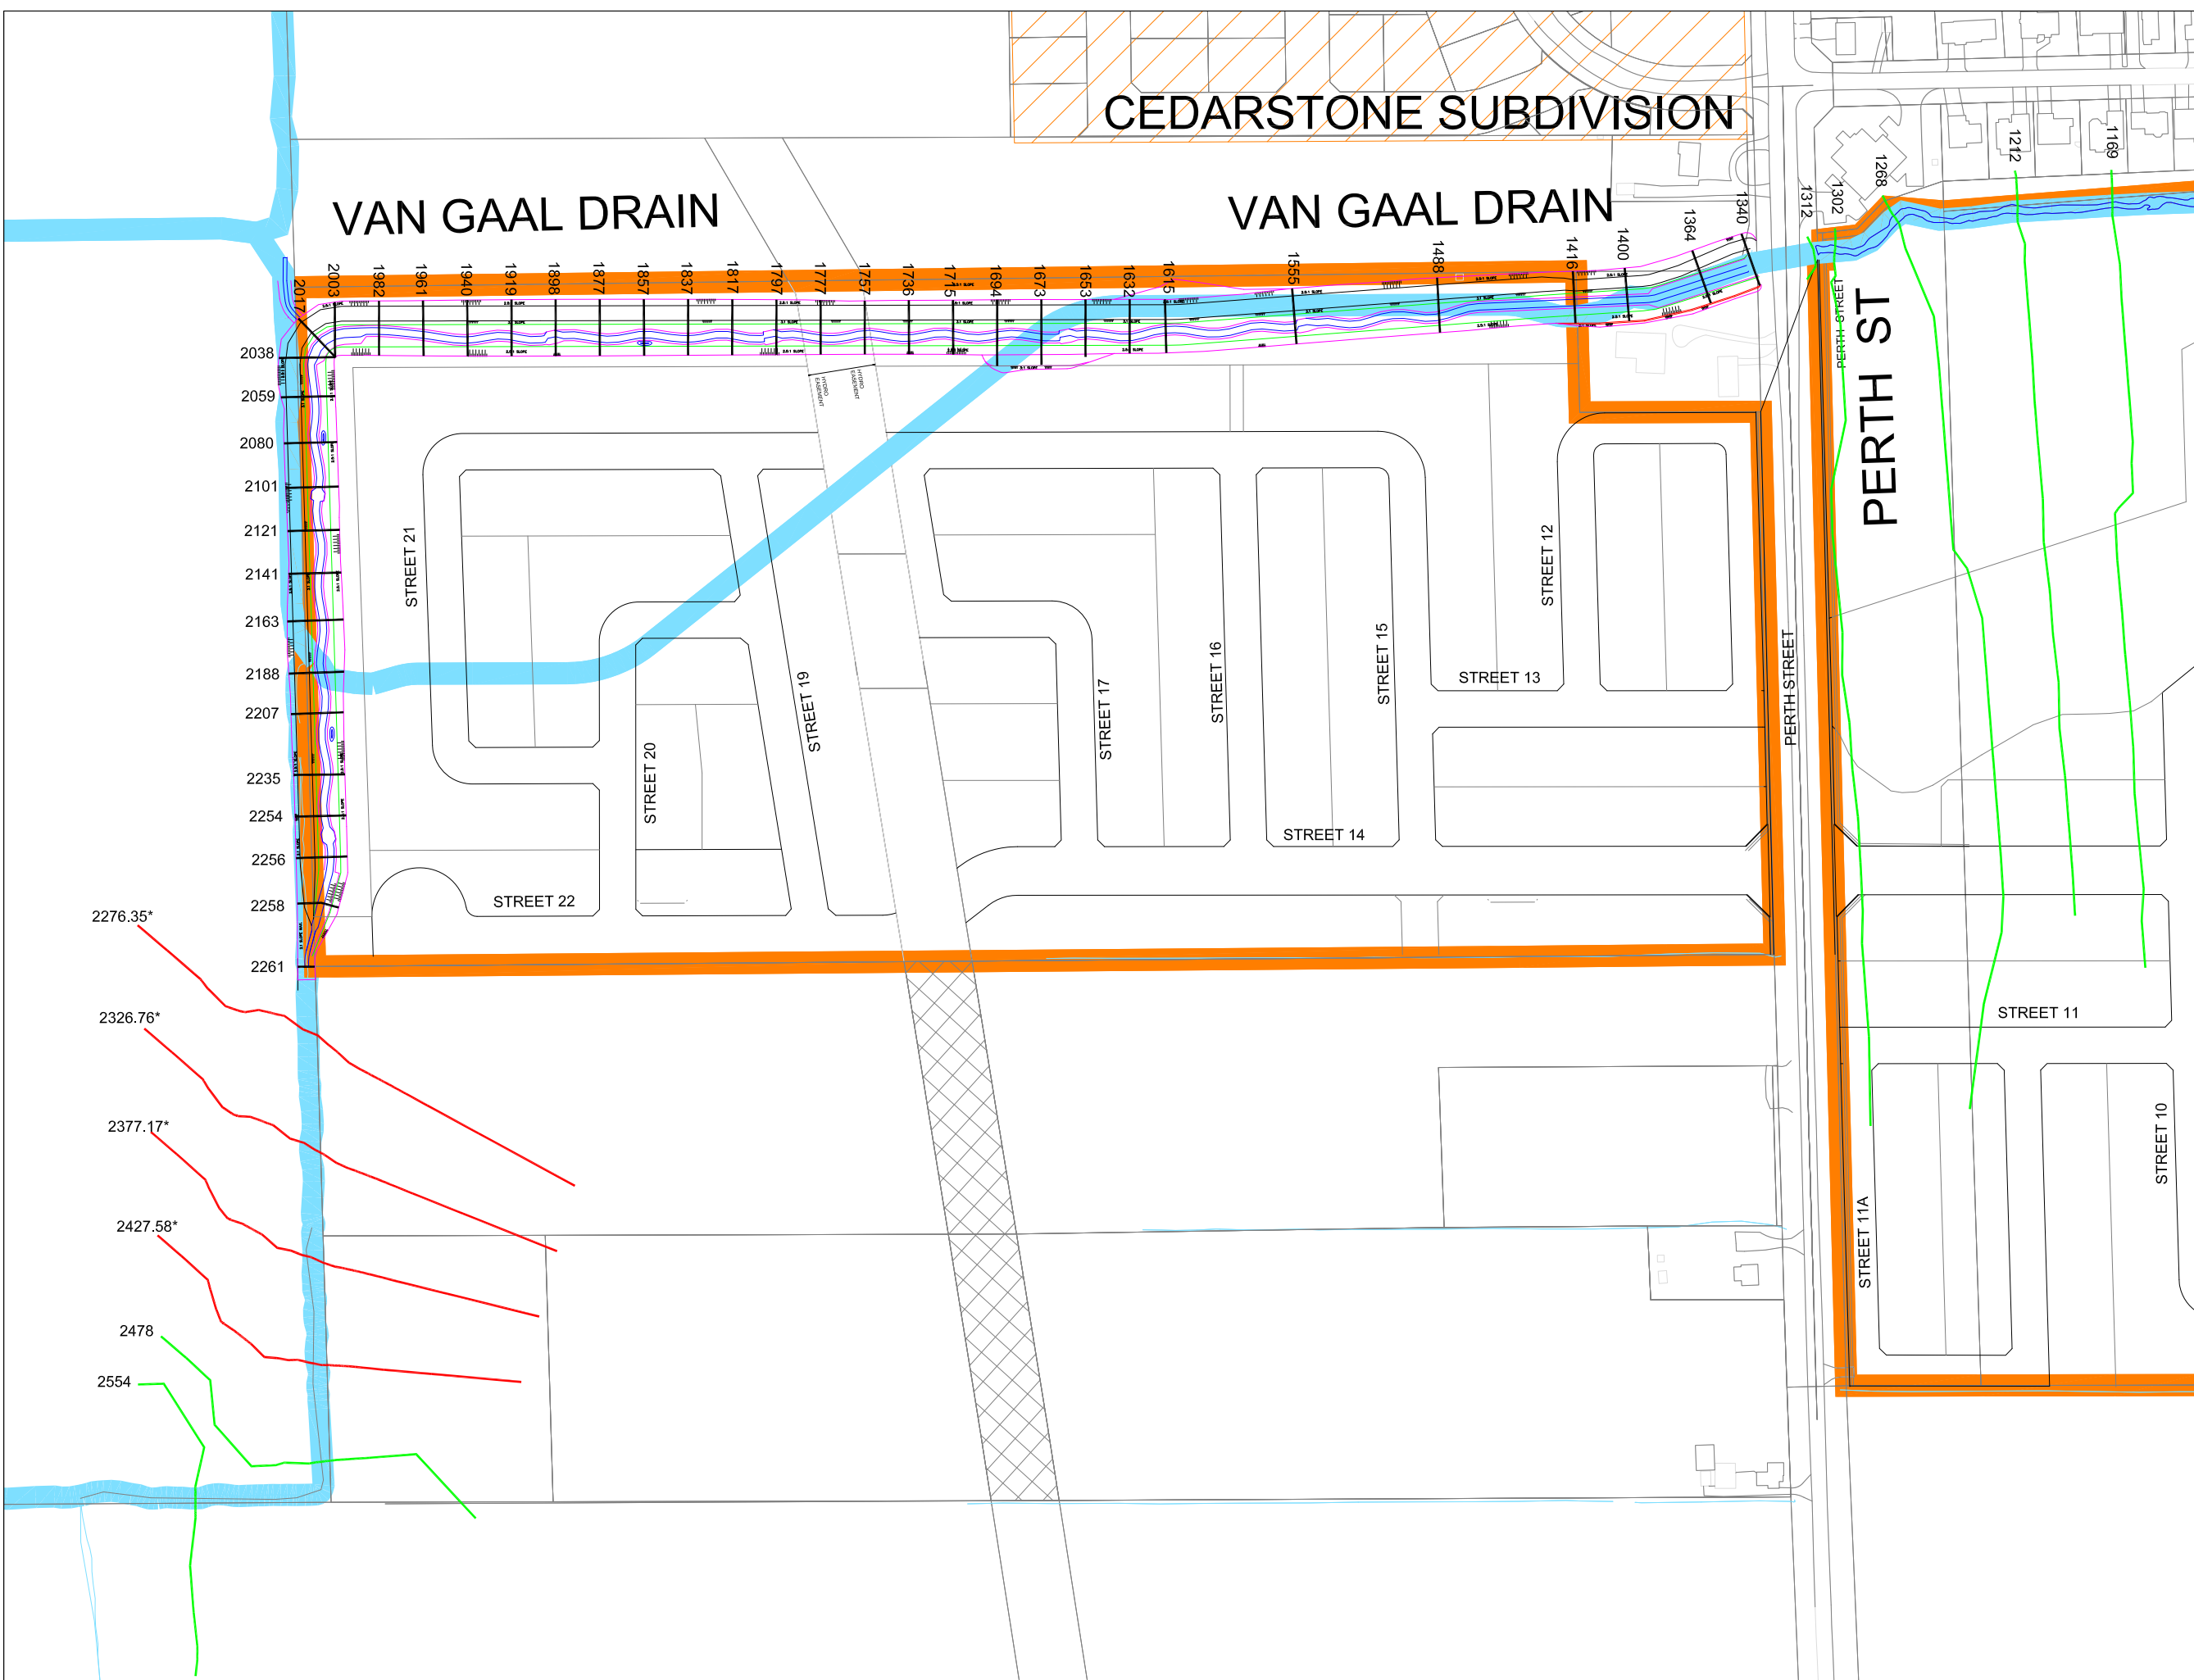



CEDARSTONE SUBDIVISION

VAN GAAL DRAIN

VAN GAAL DRAIN

PERTH ST

- LEGEND :
- LIMITS OF SUBDIVISION
 - PROPOSED CROSS-SECTION
 - EXISTING CROSS-SECTION
 - EXISTING (INTERPOLATED) CROSS-SECTION
 - EXISTING CHANNEL ALIGNMENT

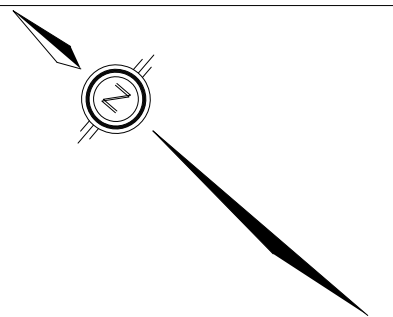

J.F. Sabourin & Associates Inc.
 WATER RESOURCES AND ENVIRONMENTAL CONSULTANTS
 OTTAWA (613) 836-3884
 GATINEAU (819) 243-6858

CLIENT : **DSEL**
David Schaeffer Engineering Ltd
 120 IBER ROAD, UNIT 203
 OTTAWA, ONTARIO, K2S 1E9
 (613) 836-0856

PROJECT : PROPOSED REALIGNMENT OF VAN GAAL DRAIN

BY	DATE	DESCRIPTION	BY

LOCATION OF PROPOSED CROSS-SECTIONS

FIGURE 1	DESIGNED:	
	DRAWN:	LP
	VERIFIED:	JFS
	APPROVED:	JFS
DRAWING REF. 922-11\201701 Channel\Design\CAD\JFSA Figures.dwg	DATE	PROJECT No.
	Apr/17	922-11

- 2276.35*
- 2326.76*
- 2377.17*
- 2427.58*
- 2478
- 2554

- 2038
- 2059
- 2080
- 2101
- 2121
- 2141
- 2163
- 2188
- 2207
- 2235
- 2254
- 2256
- 2258
- 2261

STREET 21

STREET 20

STREET 22

STREET 19

STREET 17

STREET 16

STREET 14

STREET 15

STREET 13

STREET 12


PERTH STREET

STREET 11A

STREET 11

STREET 10

- 2003
- 1982
- 1961
- 1940
- 1919
- 1898
- 1877
- 1857
- 1837
- 1817
- 1797
- 1777
- 1757
- 1736
- 1715
- 1694
- 1673
- 1653
- 1632
- 1615
- 1555
- 1488
- 1416
- 1400
- 1364
- 1340
- 1312
- 1302
- 1288
- 1212
- 1169

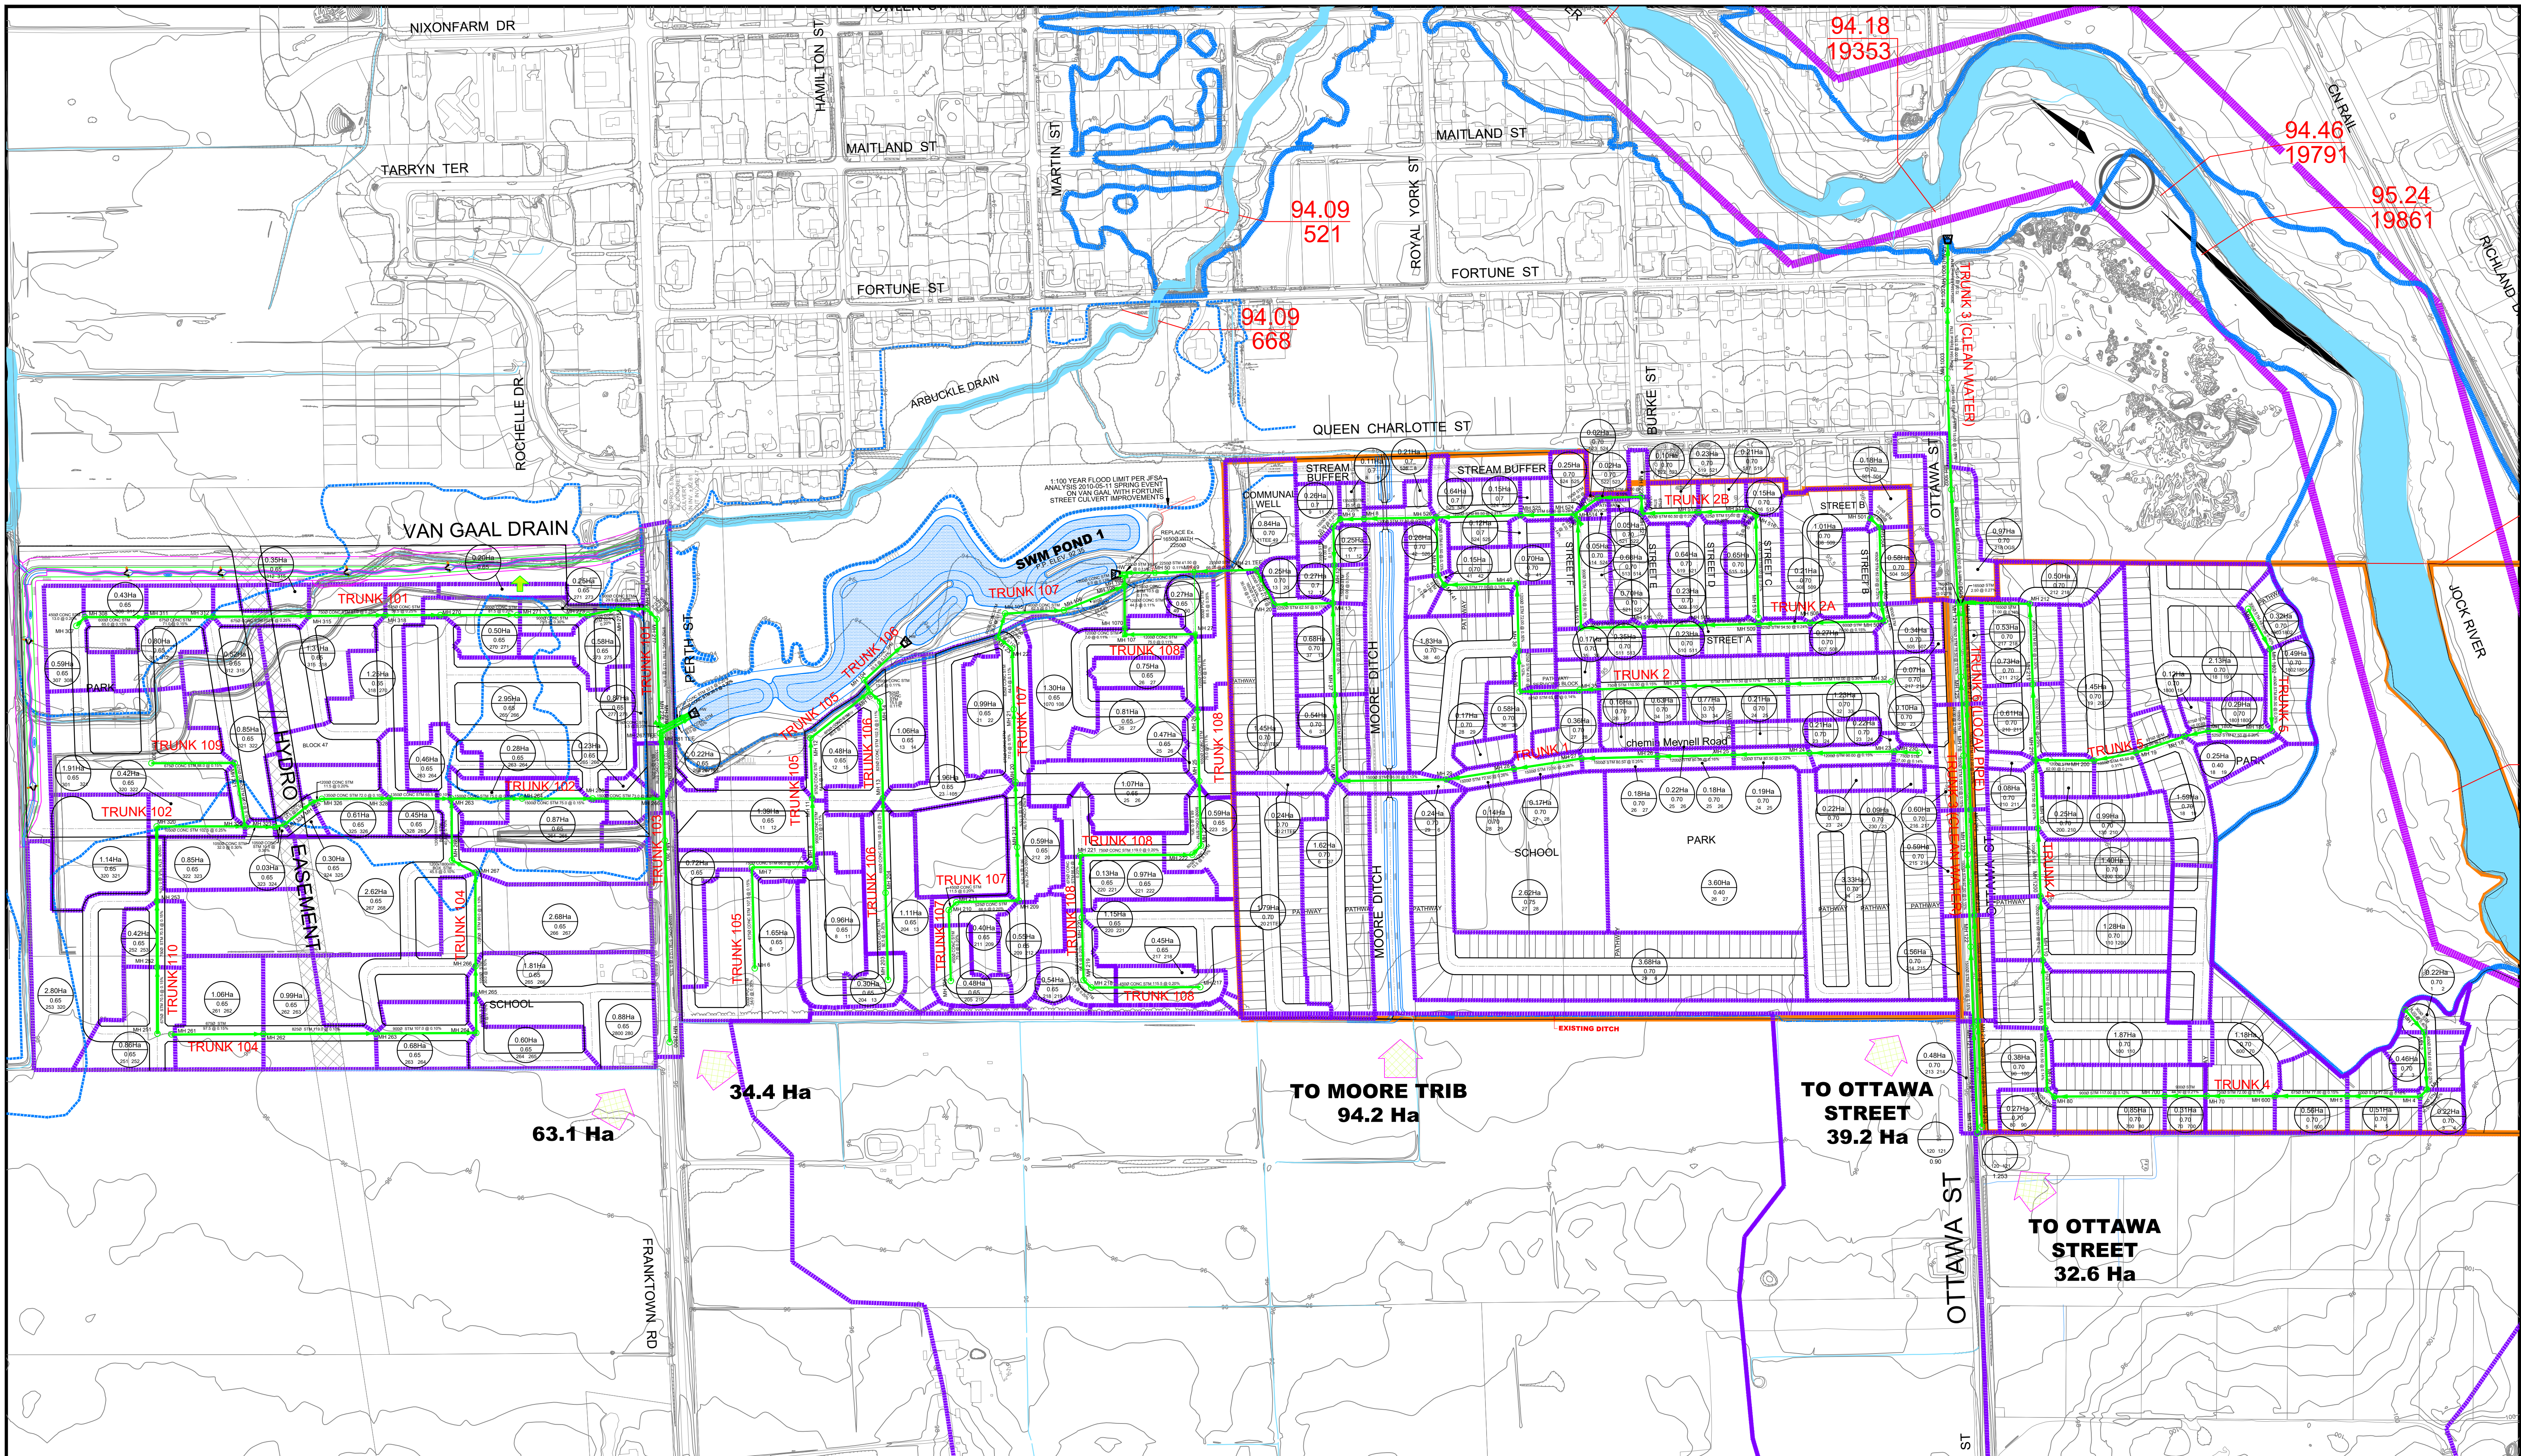

63.1 Ha

34.4 Ha

TO MOORE TRIB
94.2 Ha

TO OTTAWA
STREET
39.2 Ha

TO OTTAWA
STREET
32.6 Ha



120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

WESTERN DEVELOPMENT LANDS
STORM SERVICING PLAN
CITY OF OTTAWA

LEGEND

- STUDY LIMIT
- EXISTING DITCH
- STORM TRIBUTARY AREA
- STORM TRUNK
- LOCAL STORM SEWER
- EXISTING STORM TRUNK
- STORM TRUNK BY OTHERS
- 1:100 YEAR REGULATORY FLOOD LINE PER JFSA NOVEMBER 2009 (BACKWATER FROM JOCK RIVER)
- 8.26Ha
0.62 DRAINAGE AREA IMPERVIOUSNESS
- ↑ EXTERNAL DRAINAGE
- 100 YEAR INTAKE AREA

PROJECT No.: 20-1184

DATE: February 2021

SCALE: 1:3000

DRAWING: 3

The subject lands sloped generally from west to east under pre-development conditions. As described in **Section 3.4**, there are significant areas west of the subject land that drain through the development property under pre-development conditions. As illustrated on **Drawing 3**, the external areas are summarized below:

- 63.1 ha Perth Street road side ditch north;
- 34.4 ha Perth Street road side ditch south;
- 94.2 ha approximately midpoint between Perth and Ottawa Streets;
- 39.2 ha Ottawa Street road side ditch north and;
- 32.6 ha Ottawa Street road side ditch south.

The above external areas will be serviced by the two SWM ponds as they were included in the design of Pond 1 and Pond 2.


Due to anticipated urbanization of Perth Street and Ottawa Street as well as the site at large, these external areas will be collected and conveyed within storm sewers. These areas will be directed through the stormwater management facilities.

6.2.1 Deviations from Design Guidelines

The design of the sewer outfall from SWM Facility #1 (see **Section 7.1** of this report for Facility #1 details) results in a circumstance where it has to cross underneath the existing Moore tributary as noted in the **Ultimate Pond 1 Design Brief**. Due to site constraints (i.e. grading and both conveyances outletting to the same tributary) there is minimum cover between the ditch invert and the obvert of the sewer outfall (0.10 m). In the detailed design of SWM Facility #1, twin 525 mm storm pipes were proposed and installed, crossing under the Moore tributary to mitigate the depth of cover. As a result, some of the storm sewers in the RVDC lands use spring line to spring line connections, deviating from obvert to obvert connections per **Section 6.2.10** of the **Sewer Design Guidelines**. Justification for spring line to spring line connections is provided in **Deviations from Guidelines and Standards Report (Springline Connections) Fox Run Subdivision Richmond – Phase 2 (South)** prepared by DSEL, dated May 31, 2019 for the RVDC lands. If necessary, justification for spring line connections will be provided in the detailed design of the other land holdings within the Western Development Lands.

6.3 Sump Pump Service

The majority of the Village of Richmond is reliant on sump pumps for foundation drainage as discussed in **Section 5.2.4**. The use of sump pumps for the subject lands remains consistent with the existing level of service within the Village of Richmond.

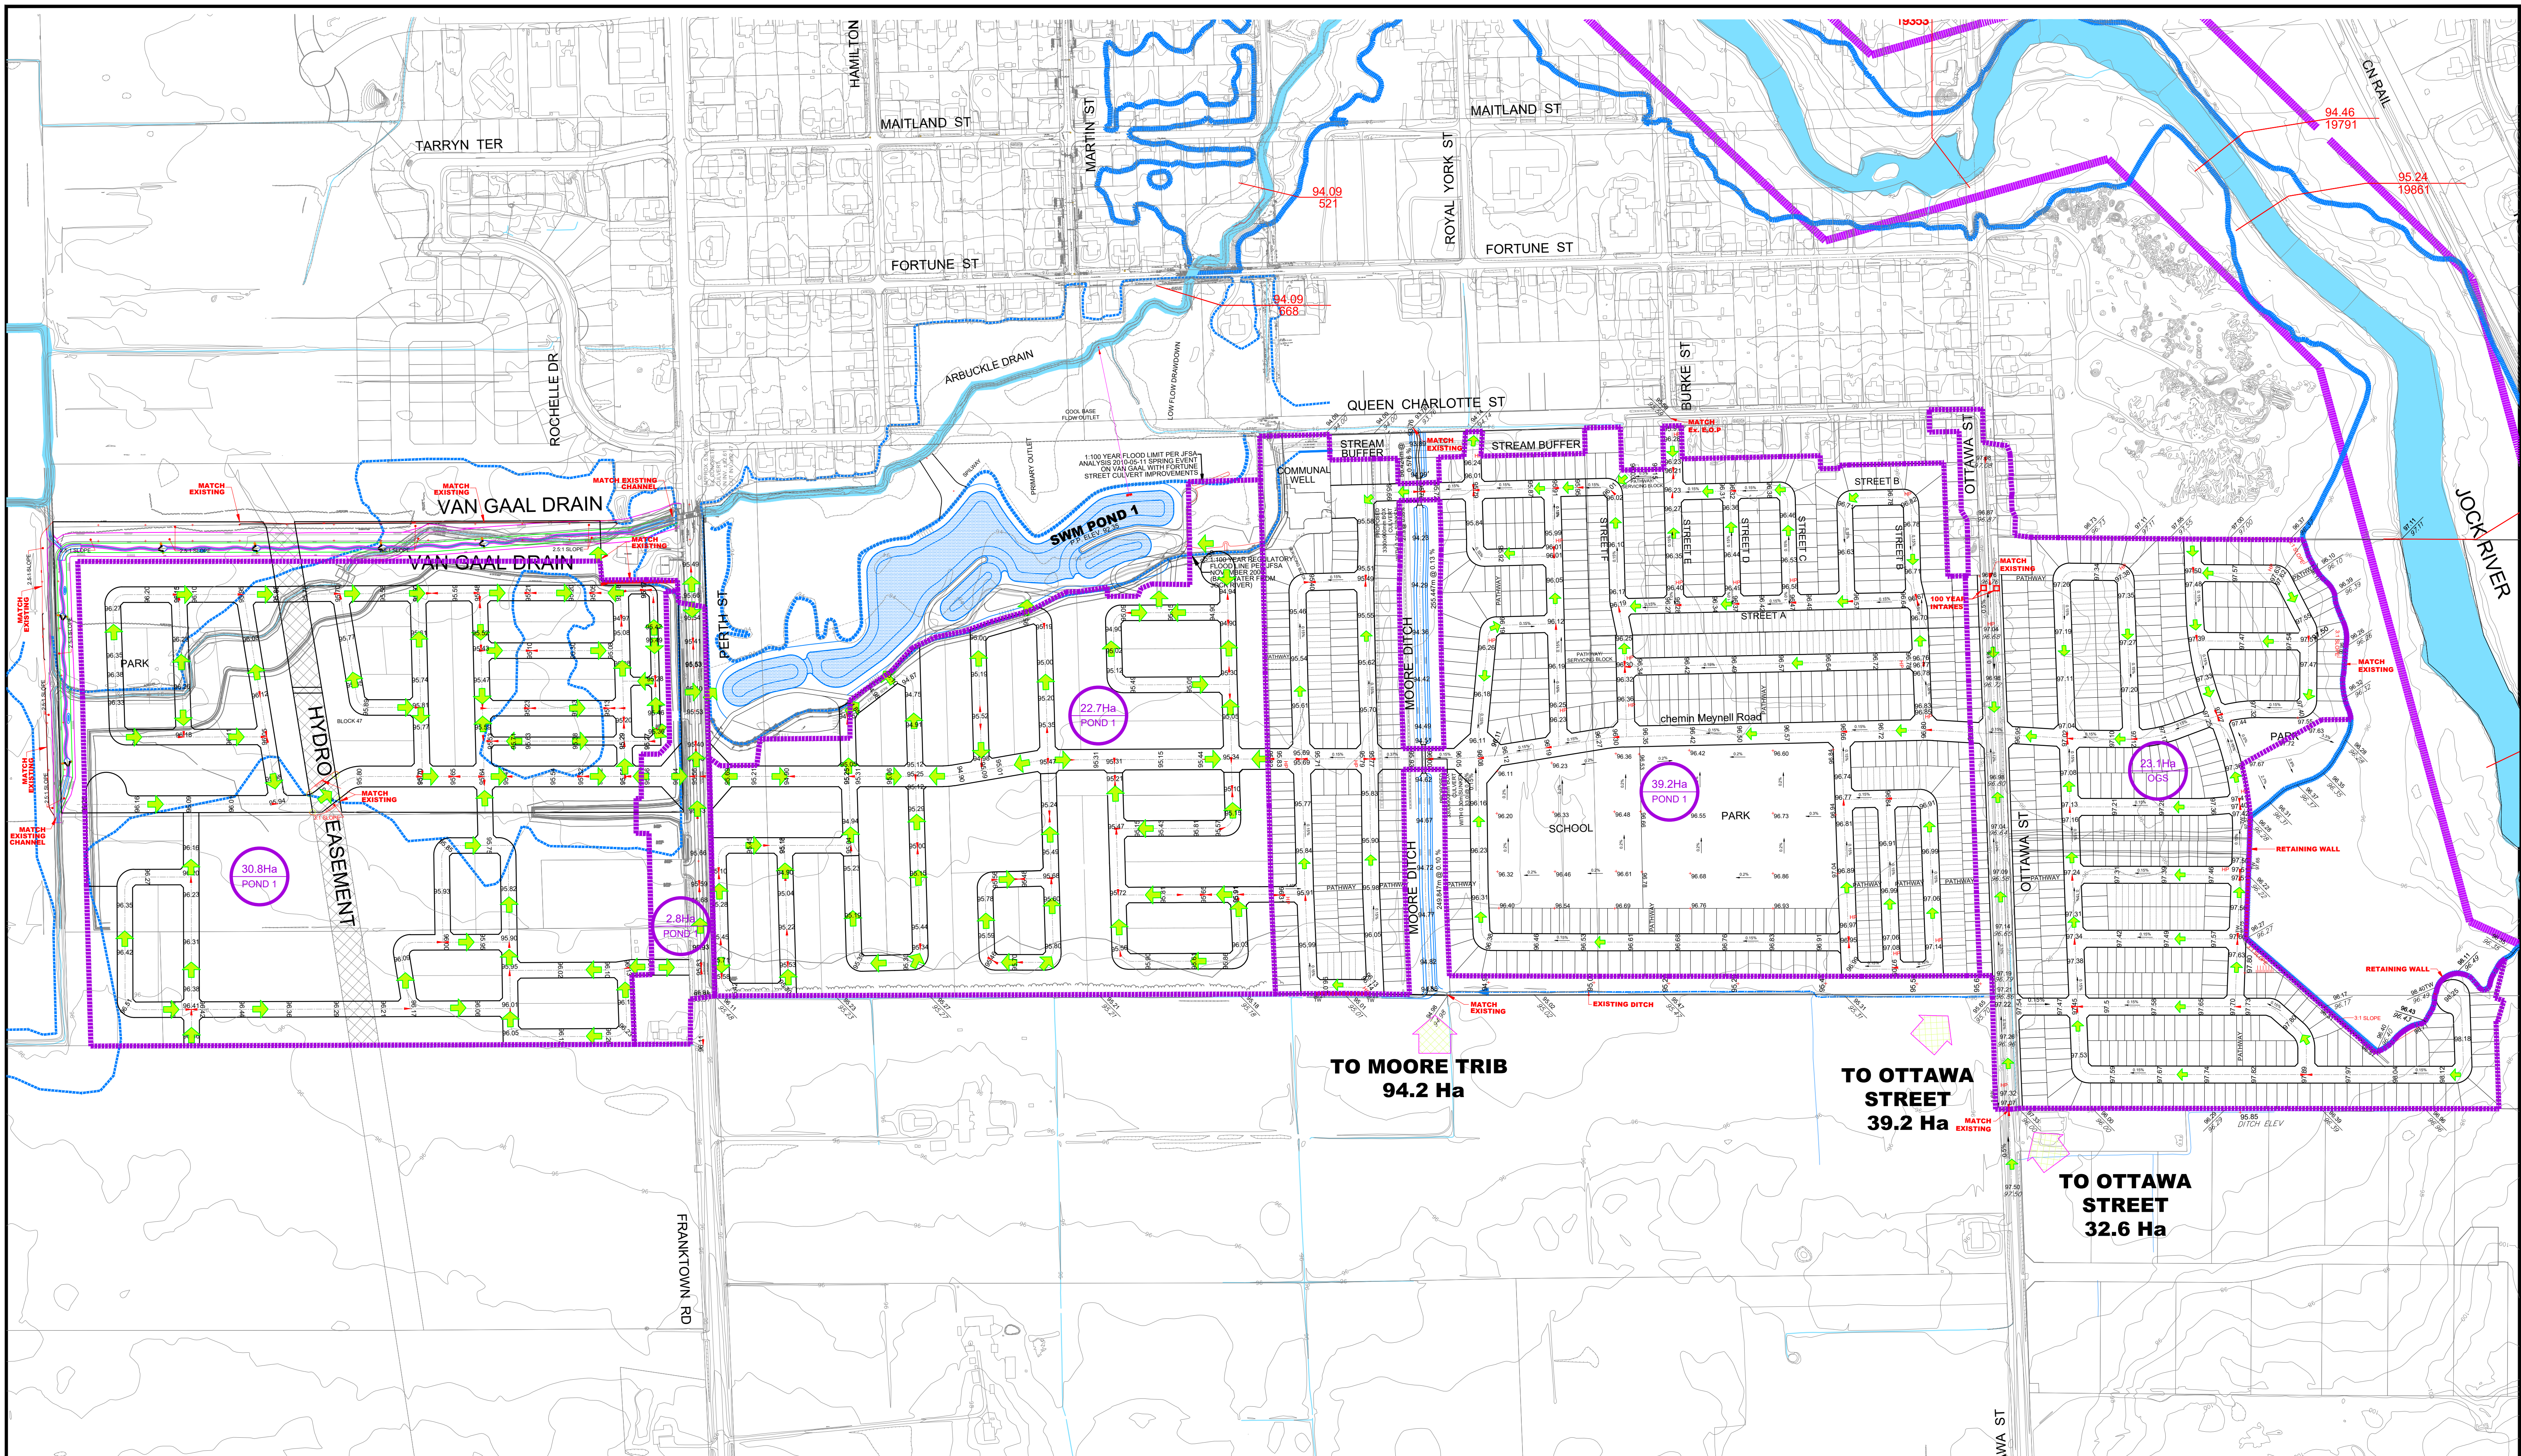

120 Iber Road, Unit 103
 Stittsville, Ontario, K2S 1E9
 Tel. (613) 836-0856
 Fax. (613) 836-7183
 www.DSEL.ca

WESTERN DEVELOPMENT LANDS
 GRADING PLAN
 CITY OF OTTAWA

LEGEND		
	STUDY LIMIT	
	EXISTING DITCH	
	EXISTING ELEVATION CONTOUR	
	MAJOR OVERLAND FLOW	
	EXTERNAL DRAINAGE	
	1:100 YEAR REGULATORY FLOOD LINE PER JFSA NOVEMBER 2009 (BACKWATER FROM JOCK RIVER)	
	EMERGENCY OVERLAND FLOW	
	STORM MAJOR TRIBUTARY AREA	
	30.8Ha DRAINAGE AREA POND 1	
	CUT-FILL DEPTH ALONG CENTER LINE:	
	CUT DEPTH (m)	FILL DEPTH (m)
	0 - 1	0 - 1
	1 - 2	1 - 2
	2 - 3	2 - 3

PROJECT No.: 20-1184
 DATE: February 2021
 SCALE: 1:3000
 DRAWING: 2

CALCULATION SHEET 2E: REQUIRED CAPACITY OF PHASE 2B OVERLAND FLOW ROUTE

OVERLAND FLOW ROUTE FROM POSTILION STREET TO THE VAN GAAL DRAIN - CURB CUT WEIR

Approaching flow =	0.064 m ³ /s for 100-yr storm (with 100% blockage of grates)
	0.186 m ³ /s for 100-yr + 20% stress test (with 100% blockage of grates)
Curb cut width =	3 m as per DSEL grading plan
Spill height =	0.110 m as per DSEL
Maximum flow depth at gutter =	0.350 m
Average head of water over spill point =	0.240 m
Curb cut weir coefficient =	1.84
Maximum flow through curb cut =	0.649 m ³ /s for 100-yr event

Therefore the capacity of the curb cut (0.649 m³/s) is higher than the computed overland flow (0.064 m³/s)

OVERLAND FLOW ROUTE DOWNSTREAM OF CURB CUT (ASSUMED SLOPES)

$$Q = 1/n \times AR^{2/3} S^{1/2}$$

100-Year Storm	Max Slope	Min Slope
normal depth =	0.017 m	0.060
n =	0.03	0.03
Channel width =	3 m	3
A (area of flow) =	0.051 m ²	0.181
wetted perimeter =	3.034 m	3.121
R (hydraulic radius) =	0.017 m	0.058
S (slope) =	0.333 m/m	0.005
Q (flow) =	0.064 m ³ /s	0.064
velocity =	1.26 m/s	0.35

100-Year + 20% Stress Test	Max Slope	Min Slope
normal depth =	0.032 m	0.116
n =	0.03	0.03
Channel width =	3 m	3
A (area of flow) =	0.097 m ²	0.348
wetted perimeter =	3.064 m	3.232
R (hydraulic radius) =	0.032 m	0.108
S (slope) =	0.333 m/m	0.005
Q (flow) =	0.186 m ³ /s	0.186
velocity =	1.92 m/s	0.53



**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION
BASED ON THE RATIONAL RAINFALL METHOD
BASED ON A FINE PARTICLE SIZE DISTRIBUTION**



Project Name: Green Property - Richmond	Engineer: DSEL
Location: Richmond, ON	Contact: S. Merrick, P.Eng
OGS #: OGS	Report Date: 8-Jul-20

Area	2.16 ha	Rainfall Station #	215
Weighted C	0.66	Particle Size Distribution	FINE
CDS Model	3020	CDS Treatment Capacity	57 l/s

<u>Rainfall Intensity¹</u> (mm/hr)	<u>Percent Rainfall Volume¹</u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate</u> (l/s)	<u>Treated Flowrate (l/s)</u>	<u>Operating Rate (%)</u>	<u>Removal Efficiency (%)</u>	<u>Incremental Removal (%)</u>
0.5	9.2%	9.2%	2.0	2.0	3.5	97.9	9.0
1.0	10.6%	19.8%	4.0	4.0	7.0	96.9	10.3
1.5	9.9%	29.7%	5.9	5.9	10.5	95.8	9.5
2.0	8.4%	38.1%	7.9	7.9	14.0	94.8	7.9
2.5	7.7%	45.8%	9.9	9.9	17.5	93.8	7.2
3.0	5.9%	51.7%	11.9	11.9	21.0	92.8	5.5
3.5	4.4%	56.1%	13.9	13.9	24.5	91.8	4.0
4.0	4.7%	60.7%	15.9	15.9	28.0	90.8	4.2
4.5	3.3%	64.0%	17.8	17.8	31.5	89.8	3.0
5.0	3.0%	67.1%	19.8	19.8	35.0	88.8	2.7
6.0	5.4%	72.4%	23.8	23.8	42.0	86.8	4.7
7.0	4.4%	76.8%	27.7	27.7	49.0	84.8	3.7
8.0	3.5%	80.3%	31.7	31.7	56.0	82.8	2.9
9.0	2.8%	83.2%	35.7	35.7	63.0	80.8	2.3
10.0	2.2%	85.3%	39.6	39.6	70.0	78.8	1.7
15.0	7.0%	92.3%	59.4	56.6	100.0	66.9	4.7
20.0	4.5%	96.9%	79.3	56.6	100.0	50.2	2.3
25.0	1.4%	98.3%	99.1	56.6	100.0	40.1	0.6
30.0	0.7%	99.0%	118.9	56.6	100.0	33.4	0.2
35.0	0.5%	99.5%	138.7	56.6	100.0	28.7	0.1
40.0	0.5%	100.0%	158.5	56.6	100.0	25.1	0.1


86.7

Removal Efficiency Adjustment² = 6.5%
Predicted Net Annual Load Removal Efficiency = 80.2%
Predicted % Annual Rainfall Treated = 96.8%

1 - Based on 42 years of hourly rainfall data from Canadian Station 6105976, Ottawa ON
 2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.
 3 - CDS Efficiency based on testing conducted at the University of Central Florida
 4 - CDS design flowrate and scaling based on standard manufacturer model & product specifications



PLAN VIEW

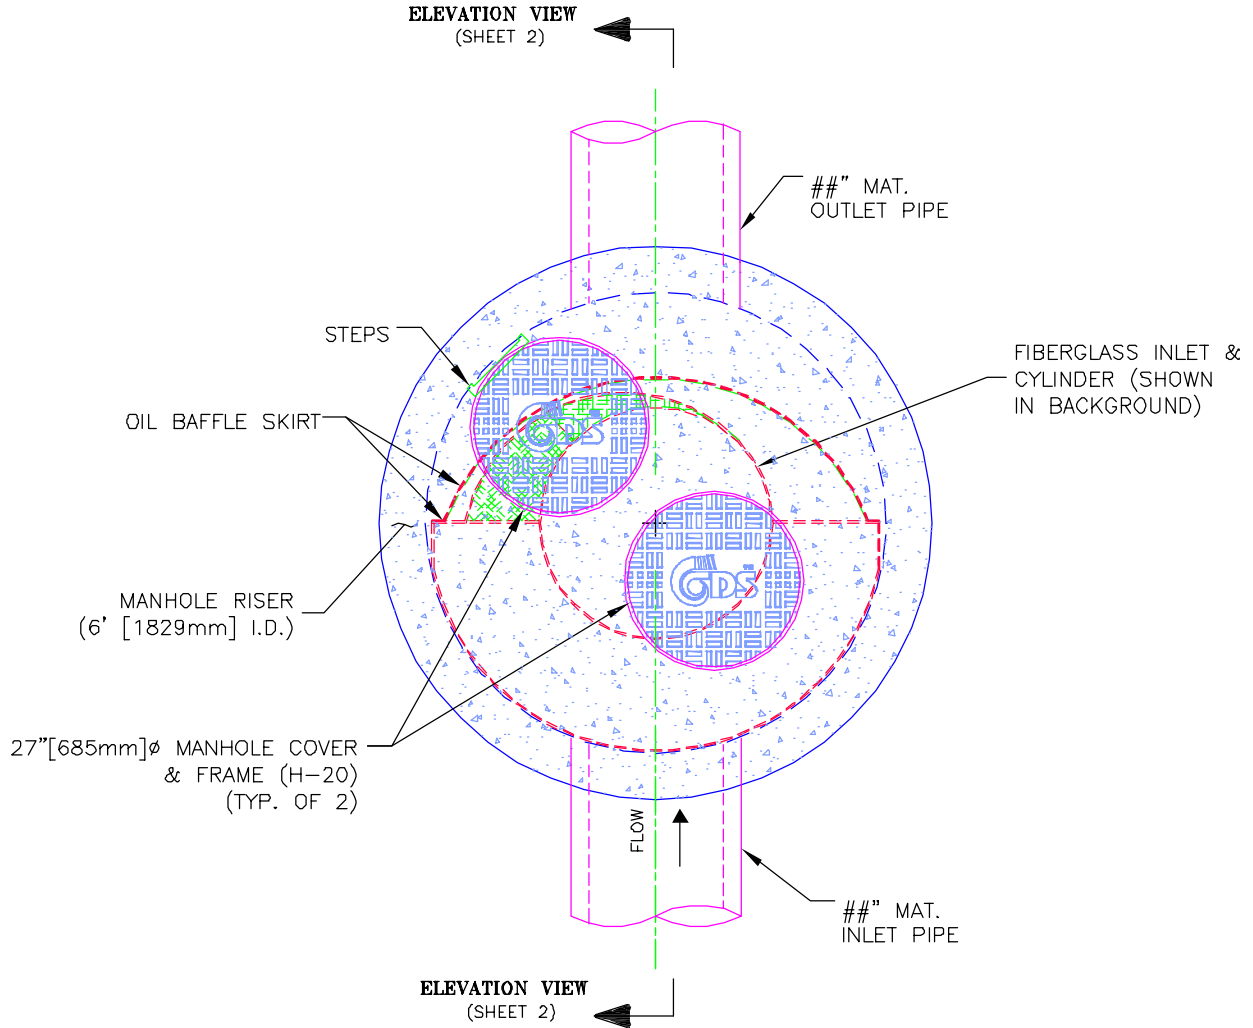

CDS MODEL PMSU30_20m, 2 CFS TREATMENT CAPACITY STORM WATER TREATMENT UNIT



PROJECT NAME
CITY, STATE

JOB# CAN-##-###
DATE ##/##/##
DRAWN INITIALS
APPROV.


SCALE
1" = 2.5'

SHEET

1



ELEVATION VIEW

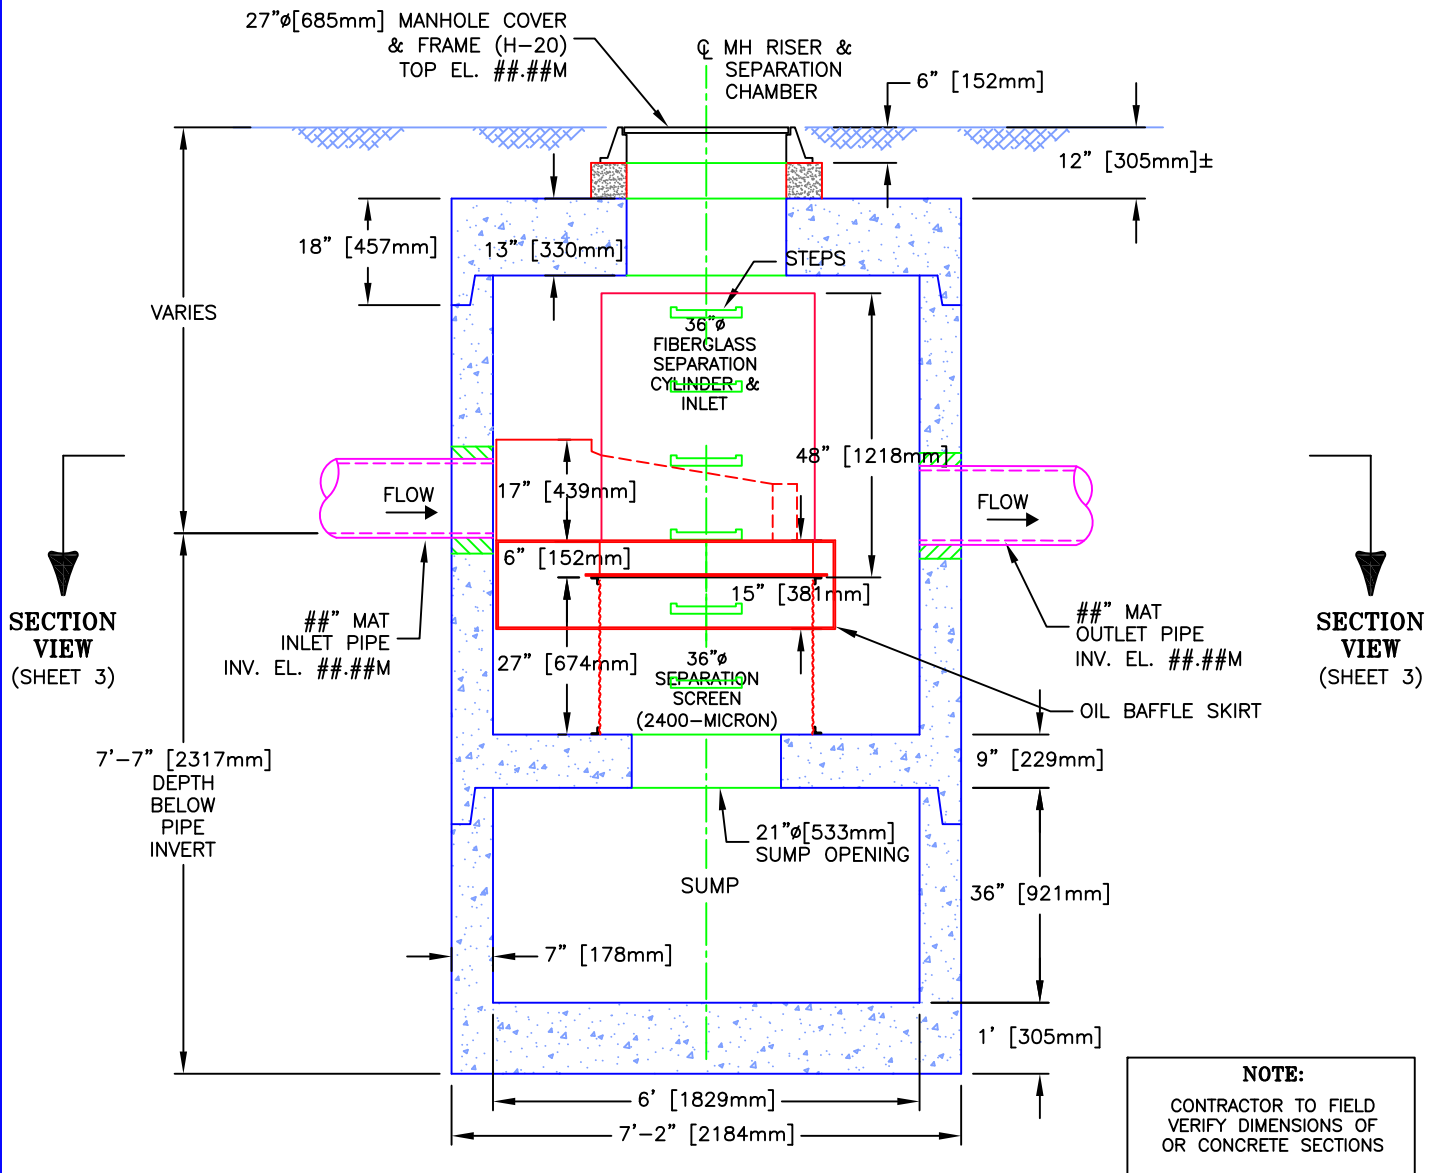

CDS MODEL PMSU30_20m, 2 CFS TREATMENT CAPACITY STORM WATER TREATMENT UNIT

	PROJECT NAME CITY, STATE	JOB# CAN-##-###	SCALE 1" = 3'
		DATE ##/##/##	SHEET
		DRAWN INITIALS	2
		APPROV.	



**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION
BASED ON THE RATIONAL RAINFALL METHOD
BASED ON A FINE PARTICLE SIZE DISTRIBUTION**



Project Name: Ottawa Street	Engineer: DSEL
Location: Richmond, ON	Contact: K. Murphy
OGS #: OGS	Report Date: 24-Feb-21


Area 21.81 ha	Rainfall Station # 215
Weighted C 0.70	Particle Size Distribution FINE
CDS Model 5678 (OFFLINE)	CDS Treatment Capacity 708 l/s

<u>Rainfall Intensity¹</u> (mm/hr)	<u>Percent Rainfall Volume¹</u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate</u> (l/s)	<u>Treated Flowrate (l/s)</u>	<u>Operating Rate (%)</u>	<u>Removal Efficiency (%)</u>	<u>Incremental Removal (%)</u>
0.5	9.2%	9.2%	21.2	21.2	3.0	98.0	9.0
1.0	10.6%	19.8%	42.4	42.4	6.0	97.1	10.3
1.5	9.9%	29.7%	63.7	63.7	9.0	96.3	9.5
2.0	8.4%	38.1%	84.9	84.9	12.0	95.4	8.0
2.5	7.7%	45.8%	106.1	106.1	15.0	94.6	7.3
3.0	5.9%	51.7%	127.3	127.3	18.0	93.7	5.6
3.5	4.4%	56.1%	148.5	148.5	21.0	92.8	4.0
4.0	4.7%	60.7%	169.8	169.8	24.0	92.0	4.3
4.5	3.3%	64.0%	191.0	191.0	27.0	91.1	3.0
5.0	3.0%	67.1%	212.2	212.2	30.0	90.3	2.7
6.0	5.4%	72.4%	254.7	254.7	36.0	88.5	4.8
7.0	4.4%	76.8%	297.1	297.1	42.0	86.8	3.8
8.0	3.5%	80.3%	339.5	339.5	48.0	85.1	3.0
9.0	2.8%	83.2%	382.0	382.0	54.0	83.4	2.4
10.0	2.2%	85.3%	424.4	424.4	59.9	81.7	1.8
15.0	7.0%	92.3%	636.6	636.6	89.9	73.1	5.1
20.0	4.5%	96.9%	848.8	708.0	100.0	58.5	2.7
25.0	1.4%	98.3%	1061.1	708.0	100.0	46.8	0.7
30.0	0.7%	99.0%	1273.3	708.0	100.0	39.0	0.3
35.0	0.5%	99.5%	1485.5	708.0	100.0	33.5	0.2
40.0	0.5%	100.0%	1697.7	708.0	100.0	29.3	0.2
							88.5

Removal Efficiency Adjustment² = 6.5%
Predicted Net Annual Load Removal Efficiency = 82.0%
Predicted % Annual Rainfall Treated = 97.9%

1 - Based on 42 years of hourly rainfall data from Canadian Station 6105976, Ottawa ON
 2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.
 3 - CDS Efficiency based on testing conducted at the University of Central Florida
 4 - CDS design flowrate and scaling based on standard manufacturer model & product specifications

I:\STORMWATER\COM\WOPS\22 CDS\40 STANDARD DRAWINGS\OFFLINE LAYOUTS DWG\OFFLINE CDS-C LAYOUT BYPASS VAULT STRUCTURED.WG 3/12/2013 3:35 PM

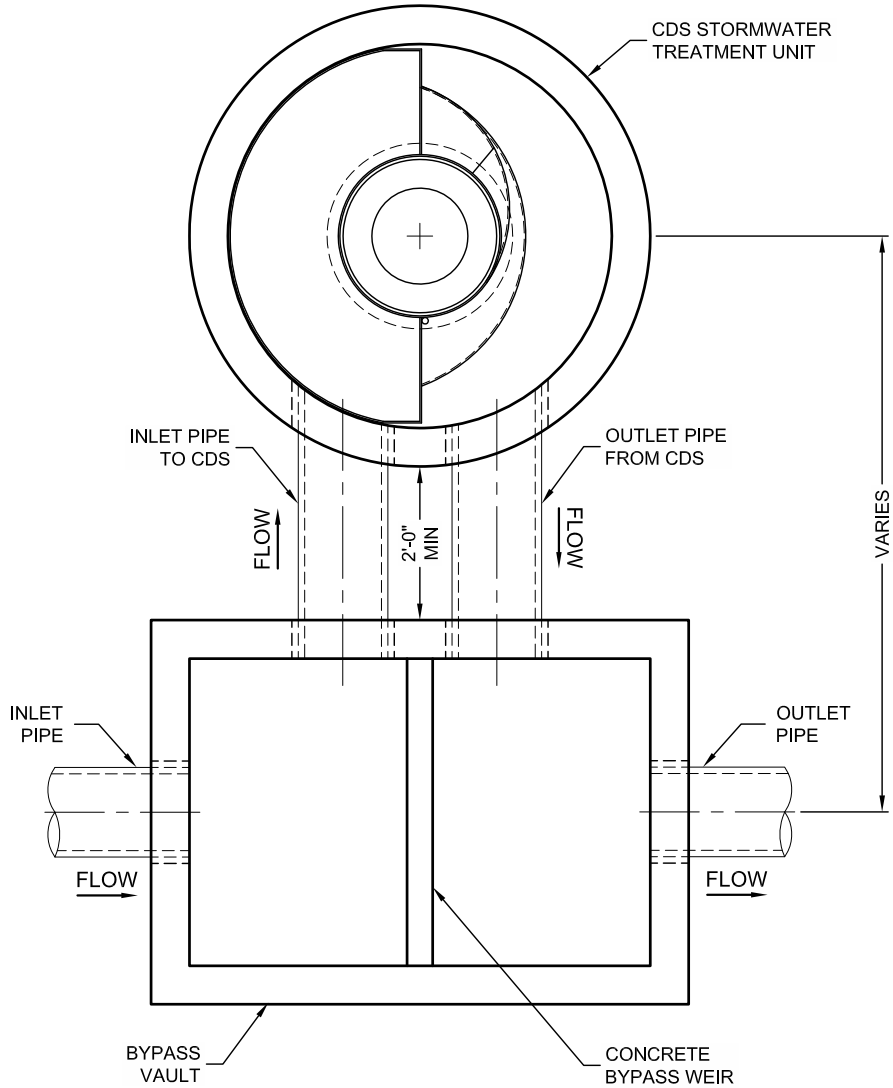

THIS PRODUCT MAY BE PROTECTED BY ONE OR MORE OF THE FOLLOWING U.S. PATENTS: 5,788,848; 6,641,720; 6,511,595; 6,581,783; RELATED FOREIGN PATENTS, OR OTHER PATENTS PENDING.

CONTECH
ENGINEERED SOLUTIONS LLC

www.ContechES.com

9025 Centre Pointe Dr., Suite 400, West Chester, OH 45069

800-338-1122 513-645-7000 513-645-7993 FAX

CDS STORMWATER TREATMENT SYSTEM
TYPICAL OFFLINE LAYOUT
WITH BYPASS VAULT STRUCTURE

DATE:03/12/13

SCALE: NONE

PROJECT No.: N/A


SEQ. No.: N/A

DRAWN: N/A

CHECKED: N/A



PLAN VIEW

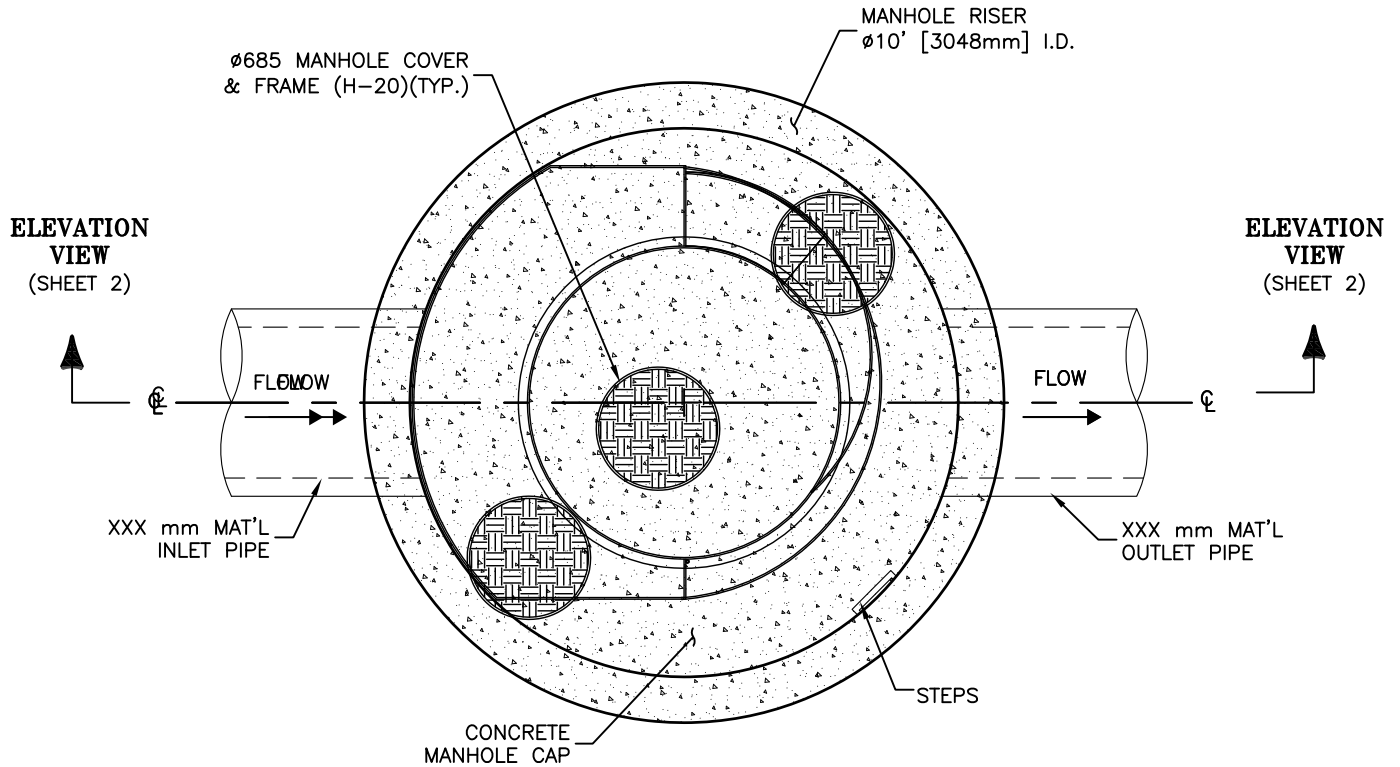

CDS MODEL CDS5678 25 CFS TREATMENT CAPACITY STORM WATER TREATMENT UNIT

ANCHOR

CONTECH
CONSTRUCTION PRODUCTS INC.
 www.contech-cpi.com
 200 Enterprise Drive, Scarborough, ME 04074
 877-907-8676 207-885-9830 207-885-9825 FAX

PROJECT NAME
LOCATION


JOB#	XXXXX-XX
DATE	XX/XX/XX
DRAWN	XXX
APPROV.	

SCALE
1" = 3.5'
SHEET

1



ELEVATION VIEW

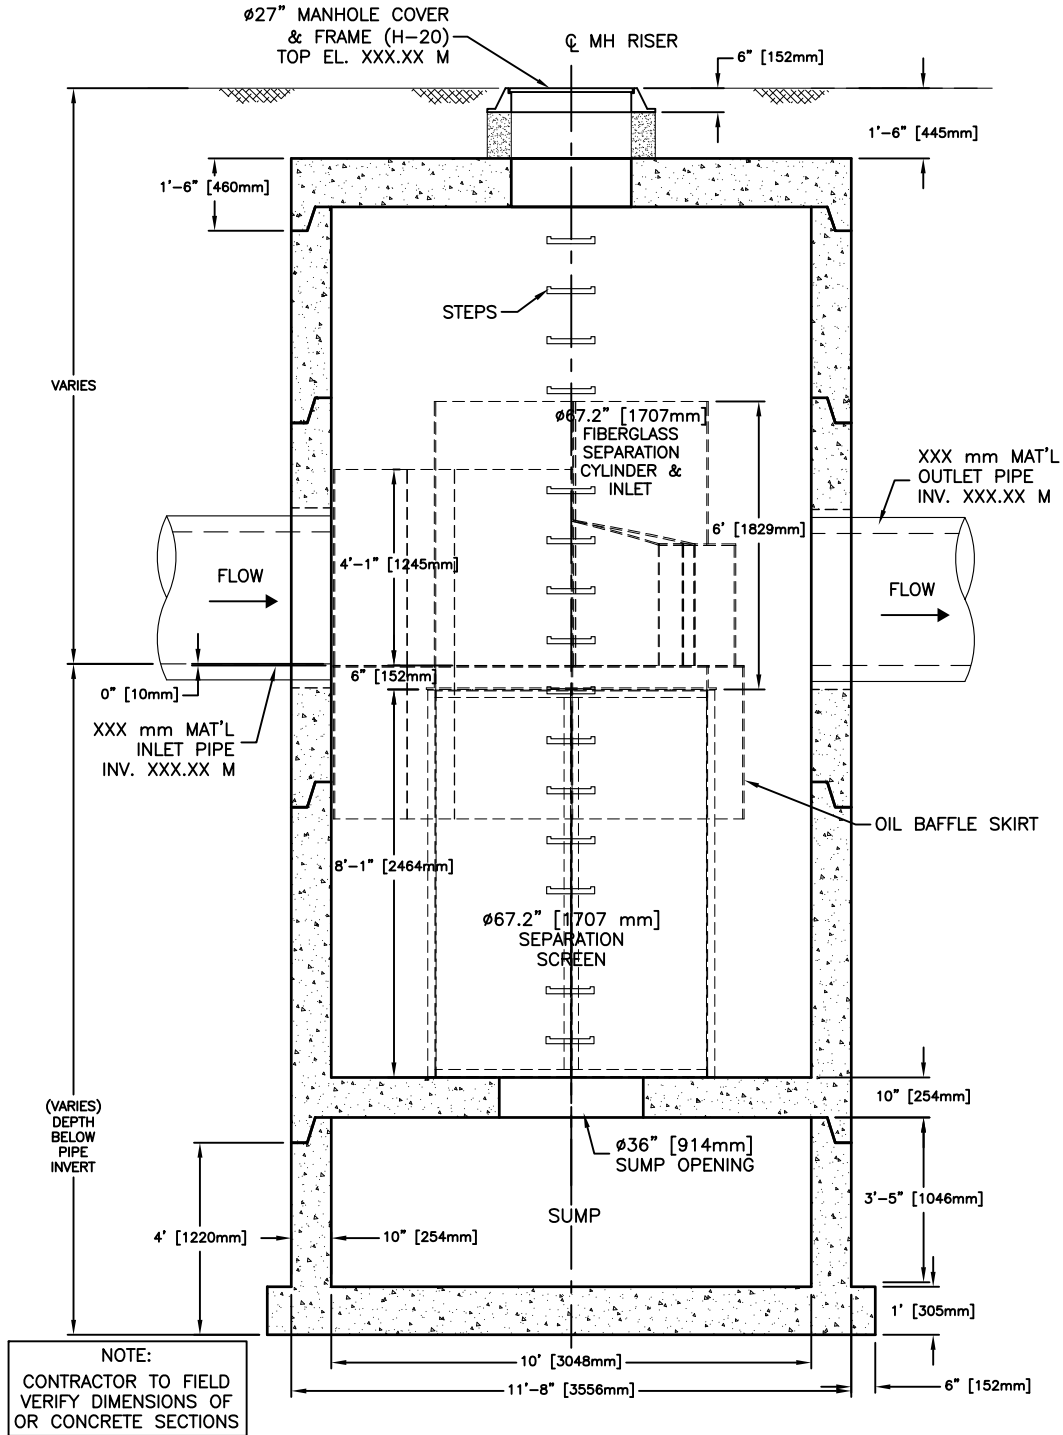

CDS MODEL CDS5678 25 CFS TREATMENT CAPACITY STORM WATER TREATMENT UNIT

ANCHOR

CONTECH
CONSTRUCTION PRODUCTS INC.
 www.contech-cpi.com
 200 Enterprise Drive, Scarborough, ME 04074
 877-907-8676 207-885-9830 207-885-9825 FAX

PROJECT NAME
 LOCATION

JOB# XXXXX-XX
 DATE. XX/XX/XX
 DRAWN XXX
 APPROV.

SCALE
1" = 4'

SHEET

2

CALCULATION SHEET B-2: FOREBAY SIZING FOR SWM FACILITY

WESTERN DEVELOPMENT LANDS - RICHMOND

SWM Pond 1

City of Ottawa

Calculation of Forebay Size

South Forebay

© DSEL

Settling Criteria

From the SWMP Manual, the required length for settling is as follows:

$$L_{\min} = \left(\frac{r Q_p}{V_s} \right)^{0.5}$$

where: r = length to width ratio, at the invert of the inlet pipe.
 Q_p = peak outflow during design quality storm
 V_s = settling velocity

Input: $r = 3.07$ (83 m / 27 m)
 $Q_p = 0.341 \text{ m}^3/\text{s}$ (at elevation 93.68 m)
 $V_s = 0.0003 \text{ m/s}$

$$L_{\min} = 59.11 \text{ m}$$

The peak flow rate from the pond during the quality storm is taken as the flow that would occur just below the quantity controls (Refer to Table B-5 of Appendix B)

Dispersion Criteria

From the SWMP Manual, the required length for dispersion is as follows:

$$L_{\min} = \frac{8Q}{d V_f}$$

where: Q = Inlet flowrate (10-Year, 24-Hour SCS Storm)
 d = depth of permanent pool (forebay)
 V_f = desired final velocity

Input: $Q = 9.223 \text{ m}^3/\text{s}$
 $d = 2.0 \text{ m}$
 $V_f = 0.5 \text{ m/s}$

$$L_{\min} = 73.78 \text{ m}$$

The minimum forebay length is determined by the larger of the settling or dispersion criteria.

Minimum Length of Forebay Required **73.78 m**
Length of Forebay Provided **83.00 m** (at elevation 92.35 m)

Average Forebay Velocity






From the SWMP Manual, the maximum allowable average velocity is 0.15 m/s:

$$V_{\text{avg}} = \frac{Q}{d W_{\text{avg}}}$$

where: Q = Inlet flowrate (10-Year, 24-Hour SCS Storm)
 d = depth of pond during peak 10-year inflow (12h:00min)
 W_{avg} = average width of forebay

Input: $Q = 9.223 \text{ m}^3/\text{s}$
 $d = 2.65 \text{ m}$
 $W_{\text{avg}} = 21 \text{ m}$ (15 m bottom, 27 m permanent pool)

$$V = 0.17 \text{ m/s} > 0.15 \text{ m/s}$$

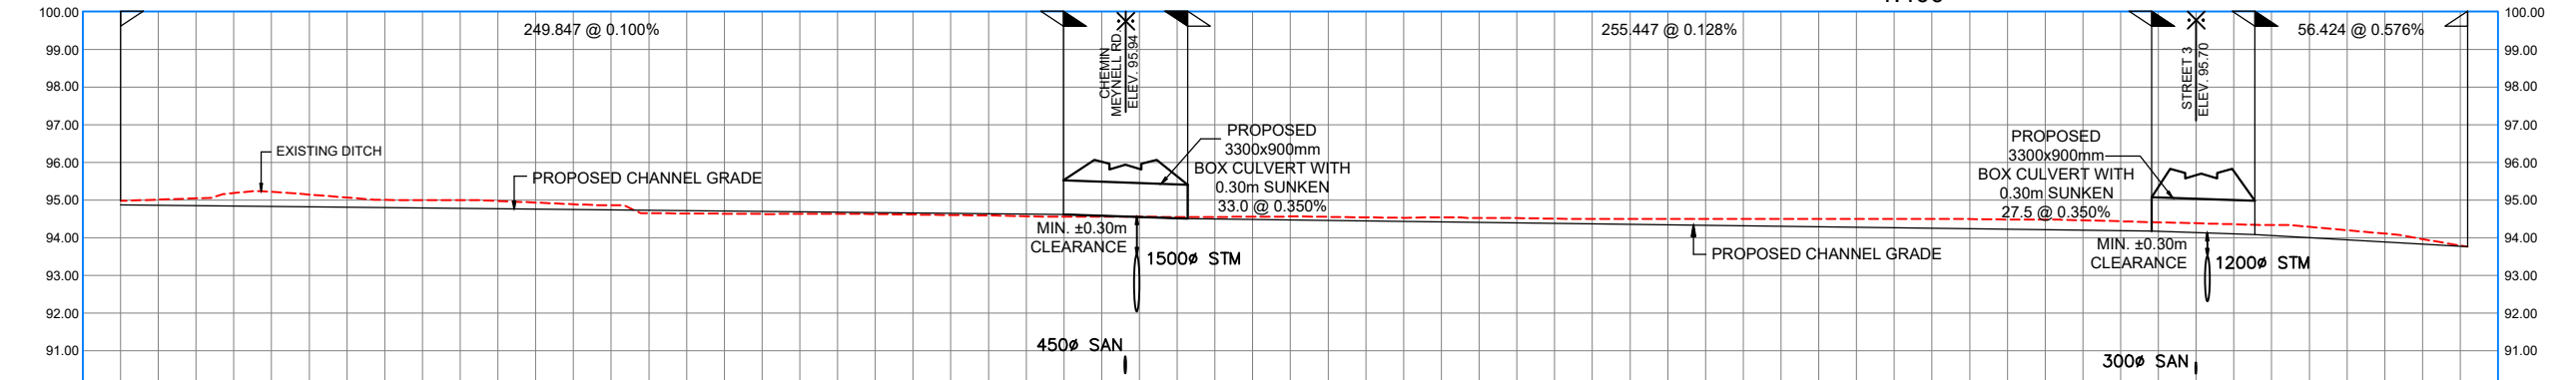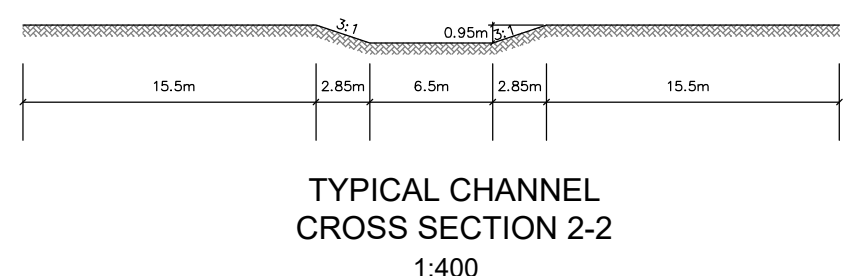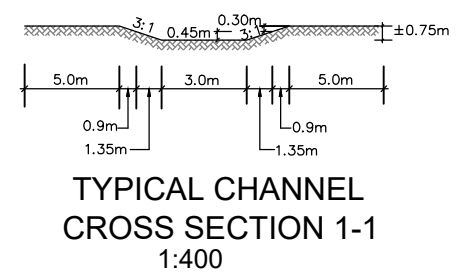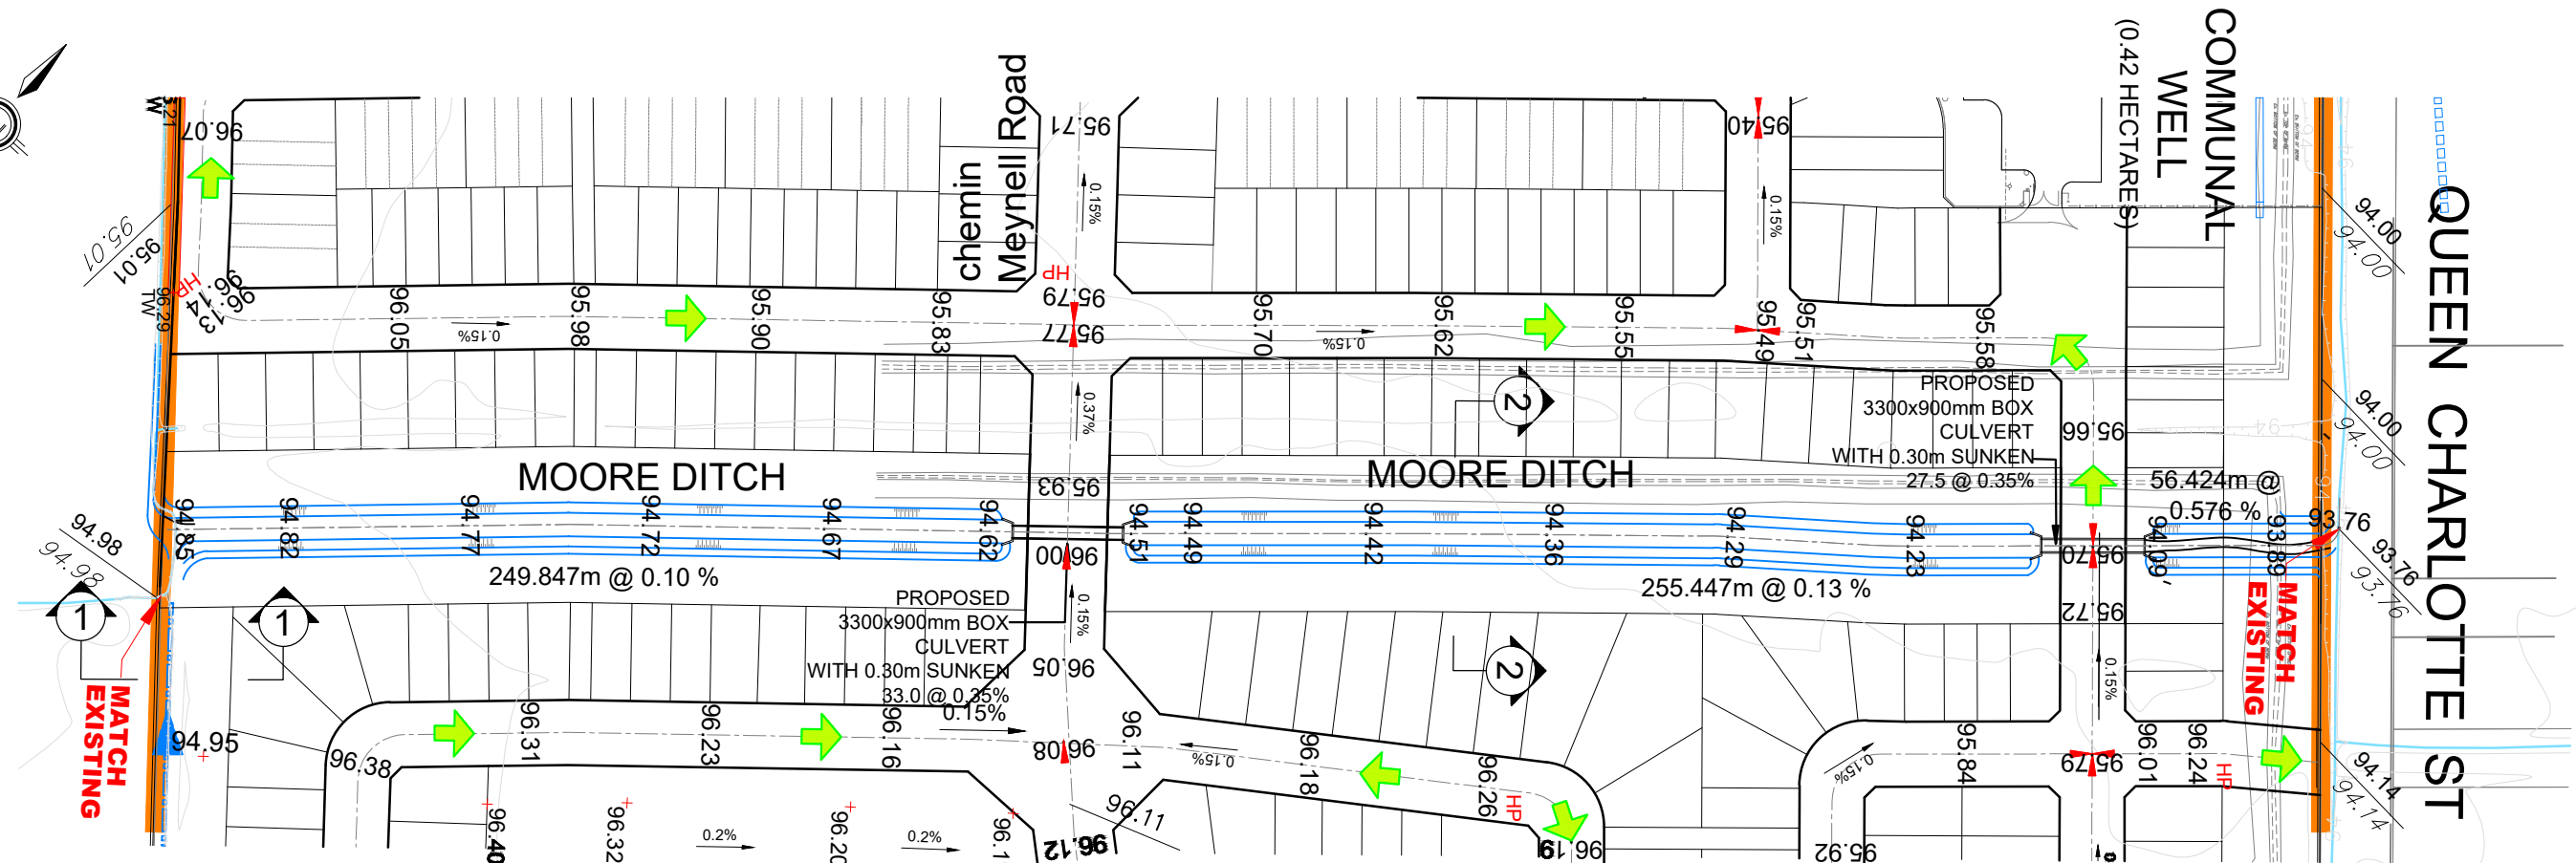

PROPOSED DITCH ELEVATION	CENTERLINE CHAINAGE	PROPOSED DITCH ELEVATION	CENTERLINE CHAINAGE
94.873	0+000.000	93.771	0+620.000
94.853	0+020.000	93.760	0+621.976
94.833	0+040.000		
94.813	0+060.000		
94.793	0+080.000		
94.773	0+100.000		
94.753	0+120.000		
94.733	0+140.000		
94.713	0+160.000		
94.693	0+180.000		
94.673	0+200.000		
94.653	0+220.000		
94.633	0+240.000		
94.623	0+249.847		
94.588	0+260.000		
94.518	0+280.000		
94.508	0+282.760		
94.486	0+300.000		
94.460	0+320.000		
94.435	0+340.000		
94.409	0+360.000		
94.383	0+380.000		
94.357	0+400.000		
94.332	0+420.000		
94.306	0+440.000		
94.280	0+460.000		
94.255	0+480.000		
94.229	0+500.000		
94.203	0+520.000		
94.180	0+538.927		
94.174	0+540.000		
94.104	0+560.000		
94.085	0+566.552		
94.002	0+580.000		
93.887	0+600.000		
93.771	0+620.000		
93.760	0+621.976		



120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

WESTERN DEVELOPMENT LANDS
MOORE TRIBUTARY - PLAN PROFILE
CITY OF OTTAWA

LEGEND

- STUDY LIMIT
- REGULATORY FLOOD LINE
- EXISTING DITCH
- EXISTING ELEVATION CONTOUR
- OVERLAND FLOW DIRECTION

PROJECT No.: 20-1184
DATE: February 2021
SCALE: 1:2000
FIGURE: 22


Date: January, 2019
DSEL File: 17-977

Moore Ditch

Channel Conveyance Calculations

Input:

Bottom Width	6.500 m	
Bottom "n1"	0.035	grass
Side Slope	3 :1	
Side "n2"	0.035	grass
Depth	0.650 m	
Freeboard	0.300 m	
Slope	0.10%	

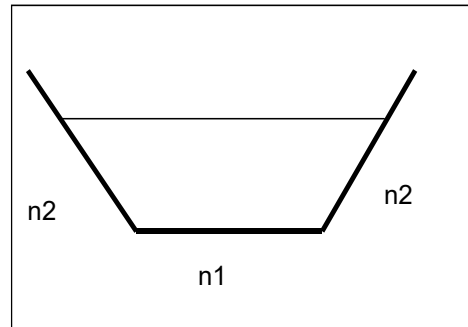

Output:

Flow	3.387 m ³ /s
>	2.793 m ³ /s
	OK

Outflow per JFSA: VG-6 and VG7 - 100 yr 24Hr SCS design flow. Nov 18, 2016

[\\dse-fsm1.dse.ads\design\\$\Design\11468\Others\JF\54_Nov1816_External_Predev](\\dse-fsm1.dse.ads\design$\Design\11468\Others\JF\54_Nov1816_External_Predev)

Velocity	0.62 m/s
----------	----------

Total Width	12.2 m
-------------	--------

STORM SEWER CALCULATION SHEET (RATIONAL METHOD)



Local Roads Return Frequency = 2 years
 Collector Roads Return Frequency = 5 years
 Arterial Roads Return Frequency = 10 years

Manning 0.013

LOCATION			AREA (Ha)																FLOW					SEWER DATA										
			2 YEAR				5 YEAR				10 YEAR				100 YEAR				Time of	Intensity	Intensity	Intensity	Intensity	Peak Flow	DIA. (mm)	DIA. (mm)	TYPE	SLOPE	LENGTH	CAPACITY	VELOCITY	TIME OF	RATIO	
Location	From Node	To Node	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	AREA (Ha)	R	Indiv. 2.78 AC	Accum. 2.78 AC	Conc. (min)	2 Year (mm/h)	5 Year (mm/h)	10 Year (mm/h)	100 Year (mm/h)	Q (l/s)	(actual)	(nominal)		(%)	(m)	(l/s)	(m/s)	LOW (min)	Q/Q full	
External VG-6 to Moore Trib																								1885										
External VG-7 to Pond 2																								908										
Total Flow																								2793	1800		CONC	0.16		4598	1.81	0.00	0.61	
Note: Please see link below for flowrate information (100-yr 24hr SCS for area VG-6 and VG-7) Z:\Projects\17-977 Mattamy Richmond\B Design\B1 Analysis\B1-3 Storm\2018-11-28 markham moore calcs																																		
																									2793	1800x900		CONC	0.35		3304	2.04	0.00	0.85
Ottawa St. Ditch 100 YR																								1154	1050		CONC	0.18		1159	1.34	0.00	1.00	
Ottawa St. Ditch 5 YR																								681	900		CONC	0.18		768	1.21	0.00	0.89	
Note: flows calculated from Upland Method																																		
Ottawa St. Ditch 100 YR																								1259	1050		CONC	0.18		1159	1.34	0.00	1.09	
Ottawa St. Ditch 5 YR																								585	900		CONC	0.18		768	1.21	0.00	0.76	
Note: flows per JFSA email, Nov 18, 2016																																		
Z:\Projects\17-977 Mattamy Richmond\B Design\B1 Analysis\B1-3 Storm\2018-11-28 markham moore calcs																																		

to Moore Ditch

Definitions:
 Q = 2.78 AIR, where
 Q = Peak Flow in Litres per second (L/s)
 A = Areas in hectares (ha)
 I = Rainfall Intensity (mm/h)
 R = Runoff Coefficient

Notes:
 1) Ottawa Rainfall-Intensity Curve
 2) Min. Velocity = 0.80 m/s

Designed:	A.S.	PROJECT:	
Checked:	V.C.	LOCATION:	City of Ottawa
Dwg. Reference:		File Ref:	14-733
		Date:	May, 2018
		Sheet No.	1



February 25, 2021

David Schaeffer Engineering Limited

120 Iber Road, Unit 103
Ottawa, Ontario K2S 1E9

Attention: Mr. Kevin Murphy, P.Eng.

**Subject: Western Development Lands - Richmond /
Expansion of Drainage Area to SWM Facility 1**

our file: 922-11

As requested by your office and based on the available information as described below, we have evaluated the impact of increasing the ultimate conditions drainage area to Stormwater Management (SWM) Facility 1.

SWM Facility 1 is located within the Western Development Lands, within the City of Ottawa, and was designed to service a drainage area of 33.11 ha under interim conditions and 185.19 ha under ultimate conditions (including 99.36 ha external pre-development area), as per the March 2018 *Design Brief for Interim Stormwater Management Pond 1 Western Development Lands - Richmond* and the March 2020 *Design Brief for Stormwater Management Pond 1 Western Development Lands - Richmond*, respectively. SWM Facility 1 provides quality, erosion and quantity control and discharges to the Van Gaal / Arbuttle Drain, and ultimately to the Jock River. The remainder of the proposed development (to the southeast) and 71.80 ha of external pre-development area was designed to be serviced by SWM Facility 2, in accordance with the January 2014 *Richmond Village (South) Limited Subdivision / Preliminary Stormwater Management Plan* memo. Pond 2 discharges to the Jock River, for which only quality control is required. SWM Facility 2 was to be located in the Laffin Lands within the larger Master Drainage Plan.

We understand from your office that you wish to consider a scenario wherein SWM Facility 2 is removed from the design, and additionally the development lands are serviced by ultimate SWM Facility 1, which would have an expanded drainage area of 199.72 ha at 34% imperviousness (including 99.36 ha external pre-development area) under ultimate conditions. Refer to Figure 1 for the proposed expanded drainage area. Note that Pond 1 is currently constructed to the ultimate conditions requirements of the March 2020 *Design Brief* and is operational.

The remaining 23.11 ha of the development (at 71% imperviousness) is located in the southwestern portion of the Western Development Lands on and south of Ottawa Street, and is proposed to be serviced by an oil-and-grit separator for quality control and discharge directly to the Jock River via a trunk sewer on Ottawa Street. No erosion or quantity control is required for this area. A clean water pipe servicing 71.80 ha of external pre-development area will connect to the Ottawa Street trunk sewer downstream of the oil-and-grit separator.

The ultimate conditions development and ultimate Pond 1 were modelled in DDSWMM / SWMHYMO / XPSWMM for the March 2020 *Design Brief for Stormwater Management Pond 1 Western Development Lands - Richmond*. The models were updated to reflect the information presented in Figure 1 as provided by DSEL. Note that, as the DDSWMM program is most appropriate for use in modelling small urban drainage areas, the larger undetailed drainage areas in the expanded portion of the drainage area to Pond 1 were instead modelled using SWMYHMO, and the generated minor system hydrographs then input to XPSWMM. This is also true of other large undetailed drainage areas to Pond 1, including future development north of Perth Street and external pre-development drainage areas to the south of the subject site. Note that modelling of the future development areas north of Perth Street have also been updated in accordance with the latest information provided by DSEL.

100-year capture to the trunk storm sewers on Perth Street and Ottawa Street is required for the 171.16 ha external

pre-development areas (99.36 ha + 71.80 ha).

The proposed subdivision is to be serviced by sump pumps, and as such a hydraulic gradeline in the main storm sewer up to ground level is permitted in accordance with the June 2018 *City of Ottawa Technical Bulletin ISTB-2018-04*. This elevated hydraulic gradeline reduces the differential head acting on an inlet control device (ICD) and / or catchbasin lead pipe, effectively reducing capture through these inlets. As such, no ICDs are proposed within the subdivision, and minor system inflows are controlled by the catchbasin grate capacity, lead pipe capacity, and surface storage above the catchbasin. In undetailed future development areas, where catchbasin details are not available for detailed incorporation in the XPSWMM model, 100-year capture has been modelled with surface storage available above the top of manholes to estimate surface storage above catchbasins.

A summary of drainage areas to ultimate Pond 1 is presented in Attachment A, along with target 2- to 100-year release rates for the pond. Note that the erosion and quantity control target release rates for Pond 1 are based on pre-development drainage to the Van Gaal / Arkbuckle Drain from the subject site, and are unchanged by the proposed increase in post-development drainage area to Pond 1.

The outlet controls for the pond are proposed to be modified in order to meet the target release rates for an expanded drainage area with the same pond stage-storage-area relationship. Namely, erosion control 1 has been revised from a 300 mm diameter circular orifice at an invert of 92.65 m to a 270 mm diameter circular orifice at an invert of 92.65 m. The baseflow control 1 orifice, and quality control 1 orifice, and quantity control 1 weir are unchanged from the March 2020 *Design Brief*. Refer to Calculation Sheet B-1 of Attachment B for the proposed pond outlet controls.

The operation of the SWM facility was analysed using the updated DDSWMM / SWMHYMO / XPSWMM models for the 2- to 100-year 24-hour SCS Type II design storms and the 1979, 1988 and 1996 historical events in accordance with the March 2020 *Design Brief*. Also in accordance with the March 2020 *Design Brief*, the operation of the SWM facility was analysed using a lumped SWMHYMO model for the 100-year 10-day spring snowmelt + rainfall event. The operating characteristics of the SWM facility are summarized below in Table 1A for free outfall conditions, and Table 1B for restrictive downstream conditions. Restrictive downstream conditions were modelled based on the following 100-year flood levels:

- 93.64 m 100-year summer flood level at the outlet from Pond 1 to the Van Gaal Drain, at cross-section 961 per the February 2016 *Richmond Village (South) Limited Subdivision / Fortune Street Culvert Improvements* memo.
- 94.11 m 100-year spring flood level at the outlet from Pond 1 to the Van Gaal Drain, at cross-section 961 per the February 2016 *Richmond Village (South) Limited Subdivision / Fortune Street Culvert Improvements* memo.
- 94.18 m 100-year regulatory flood level at the outfall to the Jock River from Ottawa Street, at cross-section 19353 per the November 2004 *Jock River Flood Risk Mapping (within the City of Ottawa) Hydraulics Report*.

Table 1A: Summary of SWM Pond 1 Operating Characteristics (Free Outfall Conditions)

Pond Component	Pond Level (m)	Allowable Release Rate ⁽¹⁾ (m ³ /s)	Pond Release Rate (m ³ /s)	Volume Used ⁽²⁾ (m ³)
Permanent Pool	92.350	N/A	N/A	45330
Quality Control	92.619	N/A	0.083	7989
Extended Detention	93.680	N/A	0.387	43875
2yr/24hr SCS	93.312	0.330	0.313	30562
5yr/24hr SCS	93.702	4.290	0.748	44720
10yr/24hr SCS	93.736	5.348	1.890	46084
25yr/24hr SCS	93.764	6.694	3.036	47203
50yr/24hr SCS	93.777	7.749	3.685	47745
100yr/24hr SCS	93.804	8.894	5.042	48840
July 1st, 1979	93.830	N/A	6.646	49938
August 4th, 1988	93.798	N/A	4.700	48588
August 8th, 1996	93.779	N/A	3.792	47835
100yr/10day Spring	93.762	N/A	3.013	47130

⁽¹⁾ 2-year erosion control release rate of 330 L/s, and 5- to 100-yr pre-development flows (refer to Table A-3 of Appendix A)

⁽²⁾ Volumes are active storage only for all pond components except the permanent pool.

Table 1B: Summary of SWM Pond 1 Operating Characteristics (Restrictive Downstream Conditions)

Pond Component	Pond Level (m)	Allowable Release Rate ⁽¹⁾ (m ³ /s)	Pond Release Rate (m ³ /s)	Volume Used ⁽²⁾ (m ³)
Permanent Pool	92.350	N/A	N/A	45330
Quality Control	92.619	N/A	0.083	7989
Extended Detention	93.680	N/A	0.387	43875
2yr/24hr SCS	93.623	0.330	0.000	41689
5yr/24hr SCS	93.726	4.290	1.216	45694
10yr/24hr SCS	93.752	5.348	2.096	46706
25yr/24hr SCS	93.772	6.694	3.114	47549
50yr/24hr SCS	93.785	7.749	3.718	48046
100yr/24hr SCS	93.827	8.894	6.114	49793
July 1st, 1979	93.840	N/A	6.934	50348
August 4th, 1988	93.805	N/A	4.756	48865
August 8th, 1996	93.797	N/A	4.313	48540
100yr/10day Spring	94.202	N/A	3.010	66570

⁽¹⁾ 2-year erosion control release rate of 330 L/s, and 5- to 100-yr pre-development flows (refer to Table A-3 of Appendix A)

⁽²⁾ Volumes are active storage only for all pond components except the permanent pool.

The above results show that the actual provided release rates do not exceed the allowable release rates for SWM Pond 1. Note that the maximum 100-year pond levels are 93.827 m for the 100-year SCS event and 94.202 m for the 100-year spring event; above the previously simulated 100-year water levels of 93.791 m and 94.198 m, respectively, from the March 2020 *Design Brief*. A 0.3 m freeboard is provided between these 100-year pond levels and the surrounding residential lots in the subdivision. The berm between the pond and the Van Gaal / Arbuckle Drain is to be raised to provide a 0.3 m freeboard above the 100-year SCS pond level, in accordance with the February 2014 *Richmond Village (South) Limited Subdivision / Hydraulic Analysis of Stormwater Management Pond 1 Berm* memo, without negatively impacting the performance of the pond or water levels on the drain.

Pond 1 has been equipped with three sediment forebays. Calculations for the minimum dispersion length, settling length and the average velocity in the forebays under these expanded conditions are presented in Calculation Sheets B-2, B-3 and B-4 of Attachment B. The forebay dimensions are sufficient to satisfy these MECP standards under the expanded drainage area conditions.

Sediment drying area calculations are also provided in Attachment B; note that the combined sediment drying area volume provided of 1960 m³ is 212 m³ short of the 2172 m³ volume required to provide 10 years of sediment accumulation, but is sufficient to accommodate 9 years of sediment accumulation.

SWM Pond 1 has a permanent pool volume of 45,330 m³, which is more than the minimum permanent pool volume the *SWMP Design Manual* requires for enhanced protection for a wet pond for the 199.723 ha drainage area at 34% imperviousness, as calculated below.

$$(140.00 - 40) \text{ m}^3/\text{ha} \times 199.723 \text{ ha} = 19,972 \text{ m}^3$$

The required quality control volume of 7,989 m³ (40 m³/ha) for the 199.723 ha drainage area is contained within the extended detention volume at an elevation of 92.619 m.

Under 100% blockage of the outlet control structure, the 100-year pond level will be 93.828 m based on the updated modelling. The broad-crested quantity control weir set in the berm of the pond at an elevation of 93.68 m will also function as an emergency overflow weir under these conditions, and the downstream spillway will convey the 100-year outflow of 6.019 m³/s at a velocity of 0.75 m/s and a flow depth of 17.9 cm at a slope of 0.5%, or a velocity of 2.63 m/s and a flow depth of 5.1 cm at a slope of 33.3%.

It may therefore be concluded that the operation of SWM Pond 1, with the expanded drainage area to the southeast, is in conformance with the requirements presented in the March 2020 *Design Brief for Stormwater Management Pond 1 Western Development Lands - Richmond*, with the exception of sediment drying areas, to be re-sized for a minimum of 10 years of sediment accumulation, and the 100-year SCS pond level, for which the berm between the pond and the Van Gaal / Arbuckle Drain is to be raised to provide a 0.3 m freeboard.

The impact of the proposed drainage area expansion on the 100-year hydraulic gradeline elevations within the development was also evaluated using updated DDSWMM / SWMHYMO / XPSWMM models for the 100-year 3-hour Chicago storm and the 100-year 24-hour SCS Type II storm. Table 2 presents the composite hydraulic gradeline results for the 100-year 3-hour Chicago and 100-year 24-hour SCS Type II design storms.

Table 2: Composite Hydraulic Gradeline Results for 100-Year Design Storms (Restr. Downstream Conditions)

U/S MH	D/S MH	Max. U/S HGL (m)	Max. D/S HGL (m)	U/S MH Cover Elev. (m)	D/S MH Cover Elev. (m)	Freeboard ⁽¹⁾ (m)
1	2	94.624	94.624	95.566	95.449	0.942
2	2a	94.624	94.620	95.449	95.449	0.825
2a	3	94.620	94.527	95.449	95.220	N/A
3	4	94.527	94.466	95.220	95.300	0.693
4	7	94.466	94.254	95.300	95.174	0.834
5	5a	94.544	94.543	95.298	95.378	0.754
5a	6	94.543	94.352	95.378	95.378	N/A
6	6a	94.352	94.348	95.378	95.378	1.026
6a	7	94.348	94.254	95.378	95.174	N/A
7	7a	94.254	94.182	95.174	95.174	0.920
7a	8	94.182	94.066	95.174	95.040	N/A
8	8a	94.066	94.052	95.040	95.199	0.974
8a	11	94.052	93.963	95.199	95.199	N/A
9	10	94.246	94.200	95.652	94.963	1.406
10	10a	94.200	94.199	94.963	95.199	0.763
10a	11	94.199	93.963	95.199	95.199	N/A
11	11a	93.963	93.883	95.199	95.199	1.236
11a	12	93.883	93.842	95.199	94.782	N/A
12	12a	93.842	93.836	94.782	94.964	0.940
12a	15	93.836	93.832	94.964	94.964	N/A
13	13a	93.839	93.838	95.250	95.201	1.411
13a	13b	93.838	93.836	95.201	95.201	N/A
13b	14	93.836	93.834	95.201	94.902	N/A
14	15	93.834	93.832	94.902	94.964	1.068
15	104b	93.832	93.829	94.964	94.500	1.132
16	17	94.677	94.534	94.979	95.298	0.302
17	17a	94.534	94.472	95.298	95.298	0.764
17a	18	94.472	94.434	95.298	95.030	N/A
18	19	94.434	94.399	95.030	95.094	0.596
19	23	94.398	94.261	95.094	95.383	0.696
20	20a	94.607	94.585	95.562	95.562	0.955
20	20b	94.607	94.610	95.562	95.562	0.955
20a	21	94.585	94.431	95.562	95.128	N/A
20b	24	94.610	94.418	95.562	95.243	N/A
21	21a	94.431	94.414	95.128	95.198	0.697
21a	22	94.414	94.330	95.198	95.198	N/A
22	23	94.330	94.261	95.198	95.383	0.868
23	105i	94.261	94.116	95.383	94.500	1.122
24	24a	94.418	94.415	95.243	95.320	0.825
24a	25	94.415	94.283	95.320	95.330	N/A
25	25a	94.283	94.277	95.330	95.320	1.047
25a	26	94.277	94.163	95.320	95.212	N/A
26	26a	94.163	94.125	95.212	95.352	1.049
26a	26b	94.125	94.104	95.352	95.352	N/A
26b	27	94.104	93.997	95.352	95.352	N/A
27	27a	93.997	94.019	95.352	95.352	1.355
27	27b	93.997	93.980	95.352	95.352	1.355
27a	B49	94.019	93.832	95.352	95.400	N/A
27b	107i	93.980	93.841	95.352	95.232	N/A
B49	B50	93.832	93.829	95.400	95.400	1.568
30	30a	94.213	94.254	95.372	95.372	1.159
30	31	94.213	94.136	95.372	95.212	1.159
30a	26	94.254	94.163	95.372	95.212	N/A

Table 2: Composite Hydraulic Gradeline Results for 100-Year Design Storms (Restr. Downstream Conditions)

U/S MH	D/S MH	Max. U/S HGL (m)	Max. D/S HGL (m)	U/S MH Cover Elev. (m)	D/S MH Cover Elev. (m)	Freeboard ⁽¹⁾ (m)
31	31a	94.136	94.123	95.212	95.212	1.076
31a	32	94.123	94.051	95.212	94.974	N/A
32	33	94.051	93.997	94.974	95.049	0.923
33	330	93.997	93.880	95.049	95.230	1.052
104b	Pond1	93.829	93.827	94.500	95.500	0.671
105i	106i	94.116	93.966	94.500	94.500	0.384
106i	108i	93.967	93.836	94.500	94.500	0.533
107i	1070	93.841	93.840	95.232	95.055	1.391
108i	109i	93.836	93.827	94.500	94.500	0.664
109i	Pond1	93.827	93.827	94.500	95.500	0.673
B50	Pond1	93.829	93.827	95.400	95.500	1.571
200	201	94.203	94.205	95.389	95.314	1.186
200	202	94.203	94.195	95.389	95.259	1.186
201	201a	94.205	94.206	95.314	95.314	1.109
201a	8	94.206	94.066	95.314	95.040	N/A
202	202a	94.195	94.195	95.259	95.296	1.064
202a	203	94.195	94.078	95.296	95.296	N/A
203	204	94.078	93.989	95.296	95.120	1.218
204	204a	93.989	93.984	95.120	95.250	1.131
204a	204b	93.984	93.841	95.250	95.250	N/A
204b	13	93.841	93.839	95.250	95.250	N/A
205	210	95.042	94.987	95.499	95.671	0.457
206	206a	95.072	95.071	95.476	95.499	0.404
206a	205	95.071	95.042	95.499	95.499	N/A
207	206	95.079	95.072	95.923	95.476	0.844
208	207	95.080	95.079	95.851	95.923	0.771
208	208a	95.080	95.076	95.851	95.851	0.771
208a	209	95.075	94.869	95.851	95.614	N/A
209	212	94.869	94.749	95.614	95.238	0.745
210	211	94.987	94.972	95.671	95.601	0.684
211	211a	94.972	94.960	95.601	95.614	0.629
211a	209	94.960	94.869	95.614	95.614	N/A
212	212a	94.749	94.740	95.238	95.550	0.489
212a	20	94.740	94.607	95.550	95.562	N/A
213	214	95.368	95.286	96.071	95.908	0.703
214	214a	95.286	95.276	95.908	95.918	0.622
214a	215	95.276	95.239	95.918	95.849	N/A
215	215a	95.239	95.176	95.849	95.849	0.610
215a	220	95.176	95.093	95.849	95.723	N/A
216	216a	95.319	95.335	95.972	95.972	0.653
216	217	95.319	95.315	95.972	95.900	0.653
216a	214	95.335	95.286	95.972	95.908	N/A
217	217a	95.315	95.309	95.900	95.900	0.585
217a	218	95.309	95.212	95.900	95.677	N/A
218	219	95.212	95.189	95.677	95.594	0.465
219	219a	95.189	95.178	95.594	95.733	0.405
219a	220	95.178	95.093	95.733	95.723	N/A
220	220a	95.093	94.912	95.723	95.733	0.630
220a	221	94.912	94.796	95.733	95.466	N/A
221	221a	94.796	94.730	95.466	95.515	0.670
221a	222	94.730	94.431	95.515	95.515	N/A
222	223	94.431	94.383	95.515	95.409	1.084
223	223a	94.382	94.346	95.409	95.409	1.027

Table 2: Composite Hydraulic Gradeline Results for 100-Year Design Storms (Restr. Downstream Conditions)

U/S MH	D/S MH	Max. U/S HGL (m)	Max. D/S HGL (m)	U/S MH Cover Elev. (m)	D/S MH Cover Elev. (m)	Freeboard (1) (m)
223a	223b	94.346	94.299	95.409	95.409	N/A
223b	25	94.299	94.283	95.409	95.330	N/A
224	221	94.884	94.796	95.273	95.466	0.389
330	1070	93.880	93.840	95.230	95.055	1.350
1070	108i	93.840	93.836	95.055	94.500	1.215
1600	1600a	94.704	94.691	95.090	95.090	0.386
1600a	16	94.691	94.677	95.090	94.979	N/A
Pond1	Out	93.827	92.350	95.500	94.500	1.673
250	252	95.124	95.019	95.374	95.443	0.250
251	251a	95.056	95.125	95.502	95.502	0.446
251	251b	95.056	95.028	95.502	95.502	0.446
251	251c	95.056	95.061	95.502	95.502	0.446
251a	252	95.125	95.019	95.502	95.443	N/A
251b	251f	95.028	94.821	95.502	95.502	N/A
251c	251d	95.061	95.071	95.502	95.502	N/A
251e	263	95.078	95.054	95.502	95.626	N/A
252	252a	95.019	95.006	95.443	95.394	0.424
252a	252b	95.006	94.934	95.394	95.394	N/A
252b	254	94.934	94.892	95.394	95.182	N/A
254	254a	94.892	94.849	95.182	95.229	0.290
254	254c	94.892	94.922	95.182	95.180	0.290
254a	257	94.849	94.841	95.229	95.184	N/A
259a	257	94.917	94.841	95.282	95.184	N/A
254c	273	94.922	94.904	95.180	95.140	N/A
251f	256	94.821	94.764	95.502	95.262	N/A
256	256a	94.764	94.722	95.262	95.295	0.498
256a	261	94.722	94.648	95.295	95.253	N/A
251d	251e	95.071	95.078	95.502	95.502	N/A
258	258a	94.833	94.815	95.451	95.451	0.618
258a	261	94.815	94.648	95.451	95.253	N/A
259	259a	95.002	94.917	95.282	95.282	0.280
257	256	94.841	94.764	95.184	95.262	0.343
260	260a	94.717	94.716	95.319	95.319	0.602
260a	261	94.716	94.648	95.319	95.253	N/A
261	265	94.648	94.482	95.253	95.555	0.605
263	263a	95.054	94.973	95.626	95.626	0.572
263a	264	94.973	94.777	95.626	95.534	N/A
264	264a	94.777	94.669	95.534	95.534	0.757
264a	265	94.669	94.482	95.534	95.555	N/A
265	265a	94.482	94.231	95.555	95.555	1.073
265a	266	94.231	93.882	95.555	95.544	N/A
266	266a	93.882	93.875	95.544	95.550	1.662
266a	267	93.875	93.864	95.550	95.502	N/A
267	26701	93.864	93.834	95.502	95.532	1.638
270	270a	95.596	95.341	95.502	95.502	-0.094
270a	271	95.341	95.246	95.502	95.318	N/A
271	271a	95.246	95.047	95.318	95.320	0.072
271a	273	95.047	94.904	95.320	95.140	N/A
273	273a	94.904	94.779	95.140	95.140	0.236
273a	275	94.779	94.730	95.140	95.200	N/A
275	276	94.730	94.527	95.200	95.620	0.470
276	277	94.527	94.397	95.620	95.512	1.093
277	277a	94.397	94.257	95.512	95.512	1.115

Table 2: Composite Hydraulic Gradeline Results for 100-Year Design Storms (Restr. Downstream Conditions)

U/S MH	D/S MH	Max. U/S HGL (m)	Max. D/S HGL (m)	U/S MH Cover Elev. (m)	D/S MH Cover Elev. (m)	Freeboard (1) (m)
277a	277b	94.257	94.126	95.512	95.512	N/A
277b	278	94.126	93.930	95.512	95.630	N/A
278	279	93.930	93.863	95.630	95.442	1.700
279	Pond1	93.863	93.827	95.442	95.500	1.579
280	266	93.922	93.882	95.452	95.544	1.530
328	263	95.147	95.054	95.697	95.626	0.550
329	329a	95.772	95.559	95.700	95.700	-0.072
329a	263	95.559	95.054	95.700	95.626	0.141
B1	B2	95.006	95.010	96.160	96.020	1.154
B1	B14	95.006	95.007	96.160	96.090	1.154
B2	B3	95.010	95.005	96.020	95.950	1.010
B3	B3a	95.005	95.000	95.950	95.950	0.945
B3a	B3b	95.000	94.929	95.950	95.950	0.950
B3b	B4	94.929	94.859	95.950	95.890	1.021
B4	B4a	94.859	94.861	95.890	95.890	1.031
B4a	B6	94.861	94.978	95.890	95.780	1.029
B5a	B6	95.059	94.978	95.780	95.780	0.721
B6	B6a	94.977	94.872	95.780	95.780	0.803
B6a	B7	94.873	94.626	95.780	95.630	0.907
B7	B7a	94.627	94.543	95.630	95.630	1.003
B7a	B13	94.542	94.425	95.630	95.490	1.088
B8	B9	95.448	95.229	95.670	95.640	0.222
B9	B11	95.229	95.043	95.640	95.620	0.411
B10	B10a	95.089	95.047	95.610	95.610	0.521
B10a	B11	95.047	95.043	95.610	95.620	0.563
B11	B11a	95.043	94.920	95.620	95.620	0.577
B11a	B12	94.920	94.715	95.620	95.550	0.700
B12	B13	94.714	94.425	95.550	95.490	0.836
B13	B13a	94.426	94.385	95.490	95.490	1.064
B13a	B20	94.385	94.270	95.490	95.400	1.105
B14	B14a	95.007	95.005	96.090	96.090	1.083
B14a	B14b	95.005	94.995	96.090	96.090	1.085
B14b	B14c	94.996	94.938	96.090	96.090	1.094
B14c	B15	94.938	94.853	96.090	95.800	1.152
B15	B15a	94.853	94.844	95.800	95.800	0.947
B15a	B15b	94.844	94.763	95.800	95.800	0.956
B15b	B17	94.763	94.740	95.800	95.600	1.037
B16	B16a	94.804	94.790	95.710	95.710	0.906
B16a	B17	94.790	94.740	95.710	95.600	0.920
B17	B17a	94.740	94.719	95.600	95.600	0.860
B17a	B18	94.719	94.532	95.600	95.430	0.881
B18	B18a	94.532	94.489	95.430	95.490	0.898
B18a	B19	94.489	94.381	95.490	95.490	1.001
B19	B20	94.380	94.270	95.490	95.400	1.110
B20	B21	94.270	94.020	95.400	95.400	1.130
B21	B49	94.020	93.832	95.400	95.400	1.380
26701	Pond1	93.834	93.827	95.532	95.500	1.698
f1	f2	98.272	98.263	98.250	98.230	-0.022
f2	f3	98.260	98.165	98.230	98.150	-0.030
f3	f4	98.165	98.140	98.150	98.130	-0.015
f4	f5	98.140	98.039	98.130	98.020	-0.010
f5	f600	98.039	97.937	98.020	97.900	-0.019
f18	f19	97.305	97.223	97.270	97.190	-0.035

Table 2: Composite Hydraulic Gradeline Results for 100-Year Design Storms (Restr. Downstream Conditions)

U/S MH	D/S MH	Max. U/S HGL (m)	Max. D/S HGL (m)	U/S MH Cover Elev. (m)	D/S MH Cover Elev. (m)	Freeboard ⁽¹⁾ (m)
f19	f200	97.223	97.124	97.190	97.120	-0.033
f23	f24	96.648	96.597	96.800	96.660	0.152
f24	f25	96.596	96.406	96.660	96.550	0.064
f25	f26	96.406	96.082	96.550	96.420	0.144
f26	f27	96.082	96.014	96.420	96.300	0.338
f27	f28	96.014	95.951	96.300	96.200	0.286
f28	f29	95.951	95.952	96.200	96.080	0.249
f29	B5a	95.952	95.059	96.080	95.780	0.128
f32	f33	96.807	96.664	96.760	96.630	-0.047
f33	f34	96.664	96.485	96.630	96.470	-0.034
f34	f35	96.485	96.355	96.470	96.300	-0.015
f35	f36	96.347	96.218	96.300	96.210	-0.047
f36	f38	96.216	96.127	96.210	96.120	-0.006
f38	f40	96.127	96.064	96.120	96.020	-0.007
f40	f41	96.056	95.896	96.020	95.890	-0.036
f41	f42	95.896	95.887	95.890	95.880	-0.006
f42	f526	95.881	95.802	95.880	95.790	-0.001
f70	f700	97.807	97.757	97.790	97.730	-0.017
f76	f125	96.085	95.906	97.020	97.020	0.935
f80	f90	97.583	97.551	97.560	97.540	-0.023
f90	f100	97.551	97.479	97.540	97.450	-0.011
f100	f110	97.479	97.345	97.450	97.340	-0.029
f110	f1200	97.345	97.263	97.340	97.240	-0.005
f120	f121	97.081	97.203	97.080	97.240	-0.001
f121	f122	97.203	96.798	97.240	97.180	0.037
f122	f123	96.798	96.579	97.180	97.100	0.382
f123	f76	96.579	96.085	97.100	97.020	0.521
f124	f1002	95.706	95.257	96.760	96.760	1.054
f125	f124	95.906	95.706	97.020	96.760	1.114
f130	f210	97.134	97.038	97.130	97.040	-0.004
f200	f210	97.125	97.038	97.120	97.040	-0.005
f210	f211	97.038	96.904	97.040	97.150	0.002
f211	f212	96.904	96.697	97.150	97.270	0.246
f212	f218	96.696	96.522	97.270	96.810	0.574
f213	f214	97.268	97.255	97.200	97.240	-0.068
f214	f215	97.251	97.150	97.240	97.150	-0.011
f215	f216	97.160	96.886	97.150	97.070	-0.010
f216	f217	96.886	96.598	97.070	96.980	0.184
f217	f218	96.598	96.522	96.980	96.810	0.382
f218	f800	96.522	96.067	96.810	96.800	0.288
f230	f23	96.824	96.648	96.840	96.800	0.016
f501	f504	96.821	96.833	96.800	96.820	-0.021
f504	f505	96.835	96.708	96.820	96.700	-0.015
f505	f507	96.708	96.678	96.700	96.670	-0.008
f507	f508	96.679	96.562	96.670	96.550	-0.009
f508	f509	96.562	96.507	96.550	96.470	-0.012
f509	f510	96.516	96.388	96.470	96.380	-0.046
f510	f511	96.388	96.299	96.380	96.280	-0.008
f511	f513	96.299	96.194	96.280	96.190	-0.019
f513	f514	96.195	96.011	96.190	96.010	-0.005
f514	f524	96.012	95.976	96.010	96.010	-0.002
f515	f516	96.572	96.427	96.560	96.420	-0.012
f516	f517	96.427	96.405	96.420	96.400	-0.007

Table 2: Composite Hydraulic Gradeline Results for 100-Year Design Storms (Restr. Downstream Conditions)

U/S MH	D/S MH	Max. U/S HGL (m)	Max. D/S HGL (m)	U/S MH Cover Elev. (m)	D/S MH Cover Elev. (m)	Freeboard ⁽¹⁾ (m)
f517	f519	96.405	96.341	96.400	96.320	-0.005
f519	f521	96.341	96.232	96.320	96.230	-0.021
f521	f522	96.233	96.148	96.230	96.210	-0.003
f522	f523	96.148	96.077	96.210	96.090	0.062
f523	f524	96.077	95.976	96.090	96.010	0.013
f524	f525	95.976	95.905	96.010	95.910	0.034
f525	f526	95.905	95.802	95.910	95.790	0.005
f526	B8	95.802	95.448	95.790	95.670	-0.012
f600	f70	97.937	97.807	97.900	97.790	-0.037
f700	f80	97.757	97.583	97.730	97.560	-0.027
f800	f124	96.067	95.706	96.800	96.760	0.733
f1002	f1003	95.256	94.873	96.760	96.760	1.504
f1003	f1007	94.873	94.628	96.760	96.760	1.887
f1007	f1008	94.628	94.180	96.760	96.760	2.132
f1200	f130	97.263	97.134	97.240	97.130	-0.023
f1800	f18	97.312	97.305	97.310	97.270	-0.002
f1801	f1800	97.417	97.312	97.410	97.310	-0.007
f1802	f1801	97.555	97.416	97.540	97.410	-0.015
f1803	f1802	97.627	97.555	97.610	97.540	-0.017

Note: ⁽¹⁾ Freeboard between upstream hydraulic gradeline elevation and upstream manhole cover elevation.
⁽³⁾ Ponding allowed above manholes in undetailed future development areas to represent road surface storage above catchbasins.

As shown in Table 2, a minimum freeboard of 0 m between the 100-year hydraulic gradeline and the top of manhole elevations has been provided throughout the detailed areas of the subdivision, including the proposed Fox Run Phase 1 and Phase 2 subdivision, and the Mattamy Jock River Phase 1 subdivision.

As noted above, surface ponding was allowed in XPSWMM above manholes in future areas where the details of surface storage, catchbasins, etc. were not available for detailed incorporation into the XPSWMM model. The allowed surface ponding is intended to approximate road surface storage above catchbasins, to be confirmed at the detailed design stage. Less than 0 m freeboards were simulated at some future manholes as a result; however, storage used above the future manholes is within a reasonable range of what could feasibly be provided (typically less than what would be required to contain the 100-year flows in a conventional design where minor system capture is limited by inlet control devices), so it is feasible that future areas will perform well if designed similarly to Fox Run Phase 1 and Phase 2 or Mattamy Jock River Phase 1. That is, the 100-year water level would be above the surface at catchbasins, but not at manholes. For scale, a maximum 100-year unit surface storage volume of 81 m³/ha was simulated for the 53.72 ha future development area to the south of the Moore Drain Tributary.

Yours truly,

J.F. Sabourin and Associates Inc.


Laura Pipkins, P.Eng.

cc: J.F. Sabourin, M.Eng, P.Eng.



Director of Water Resources Projects

Attachment A: Drainage Areas and Target Release Rates

Attachment B: Pond Controls - Quality, Extended Detention and Quantity

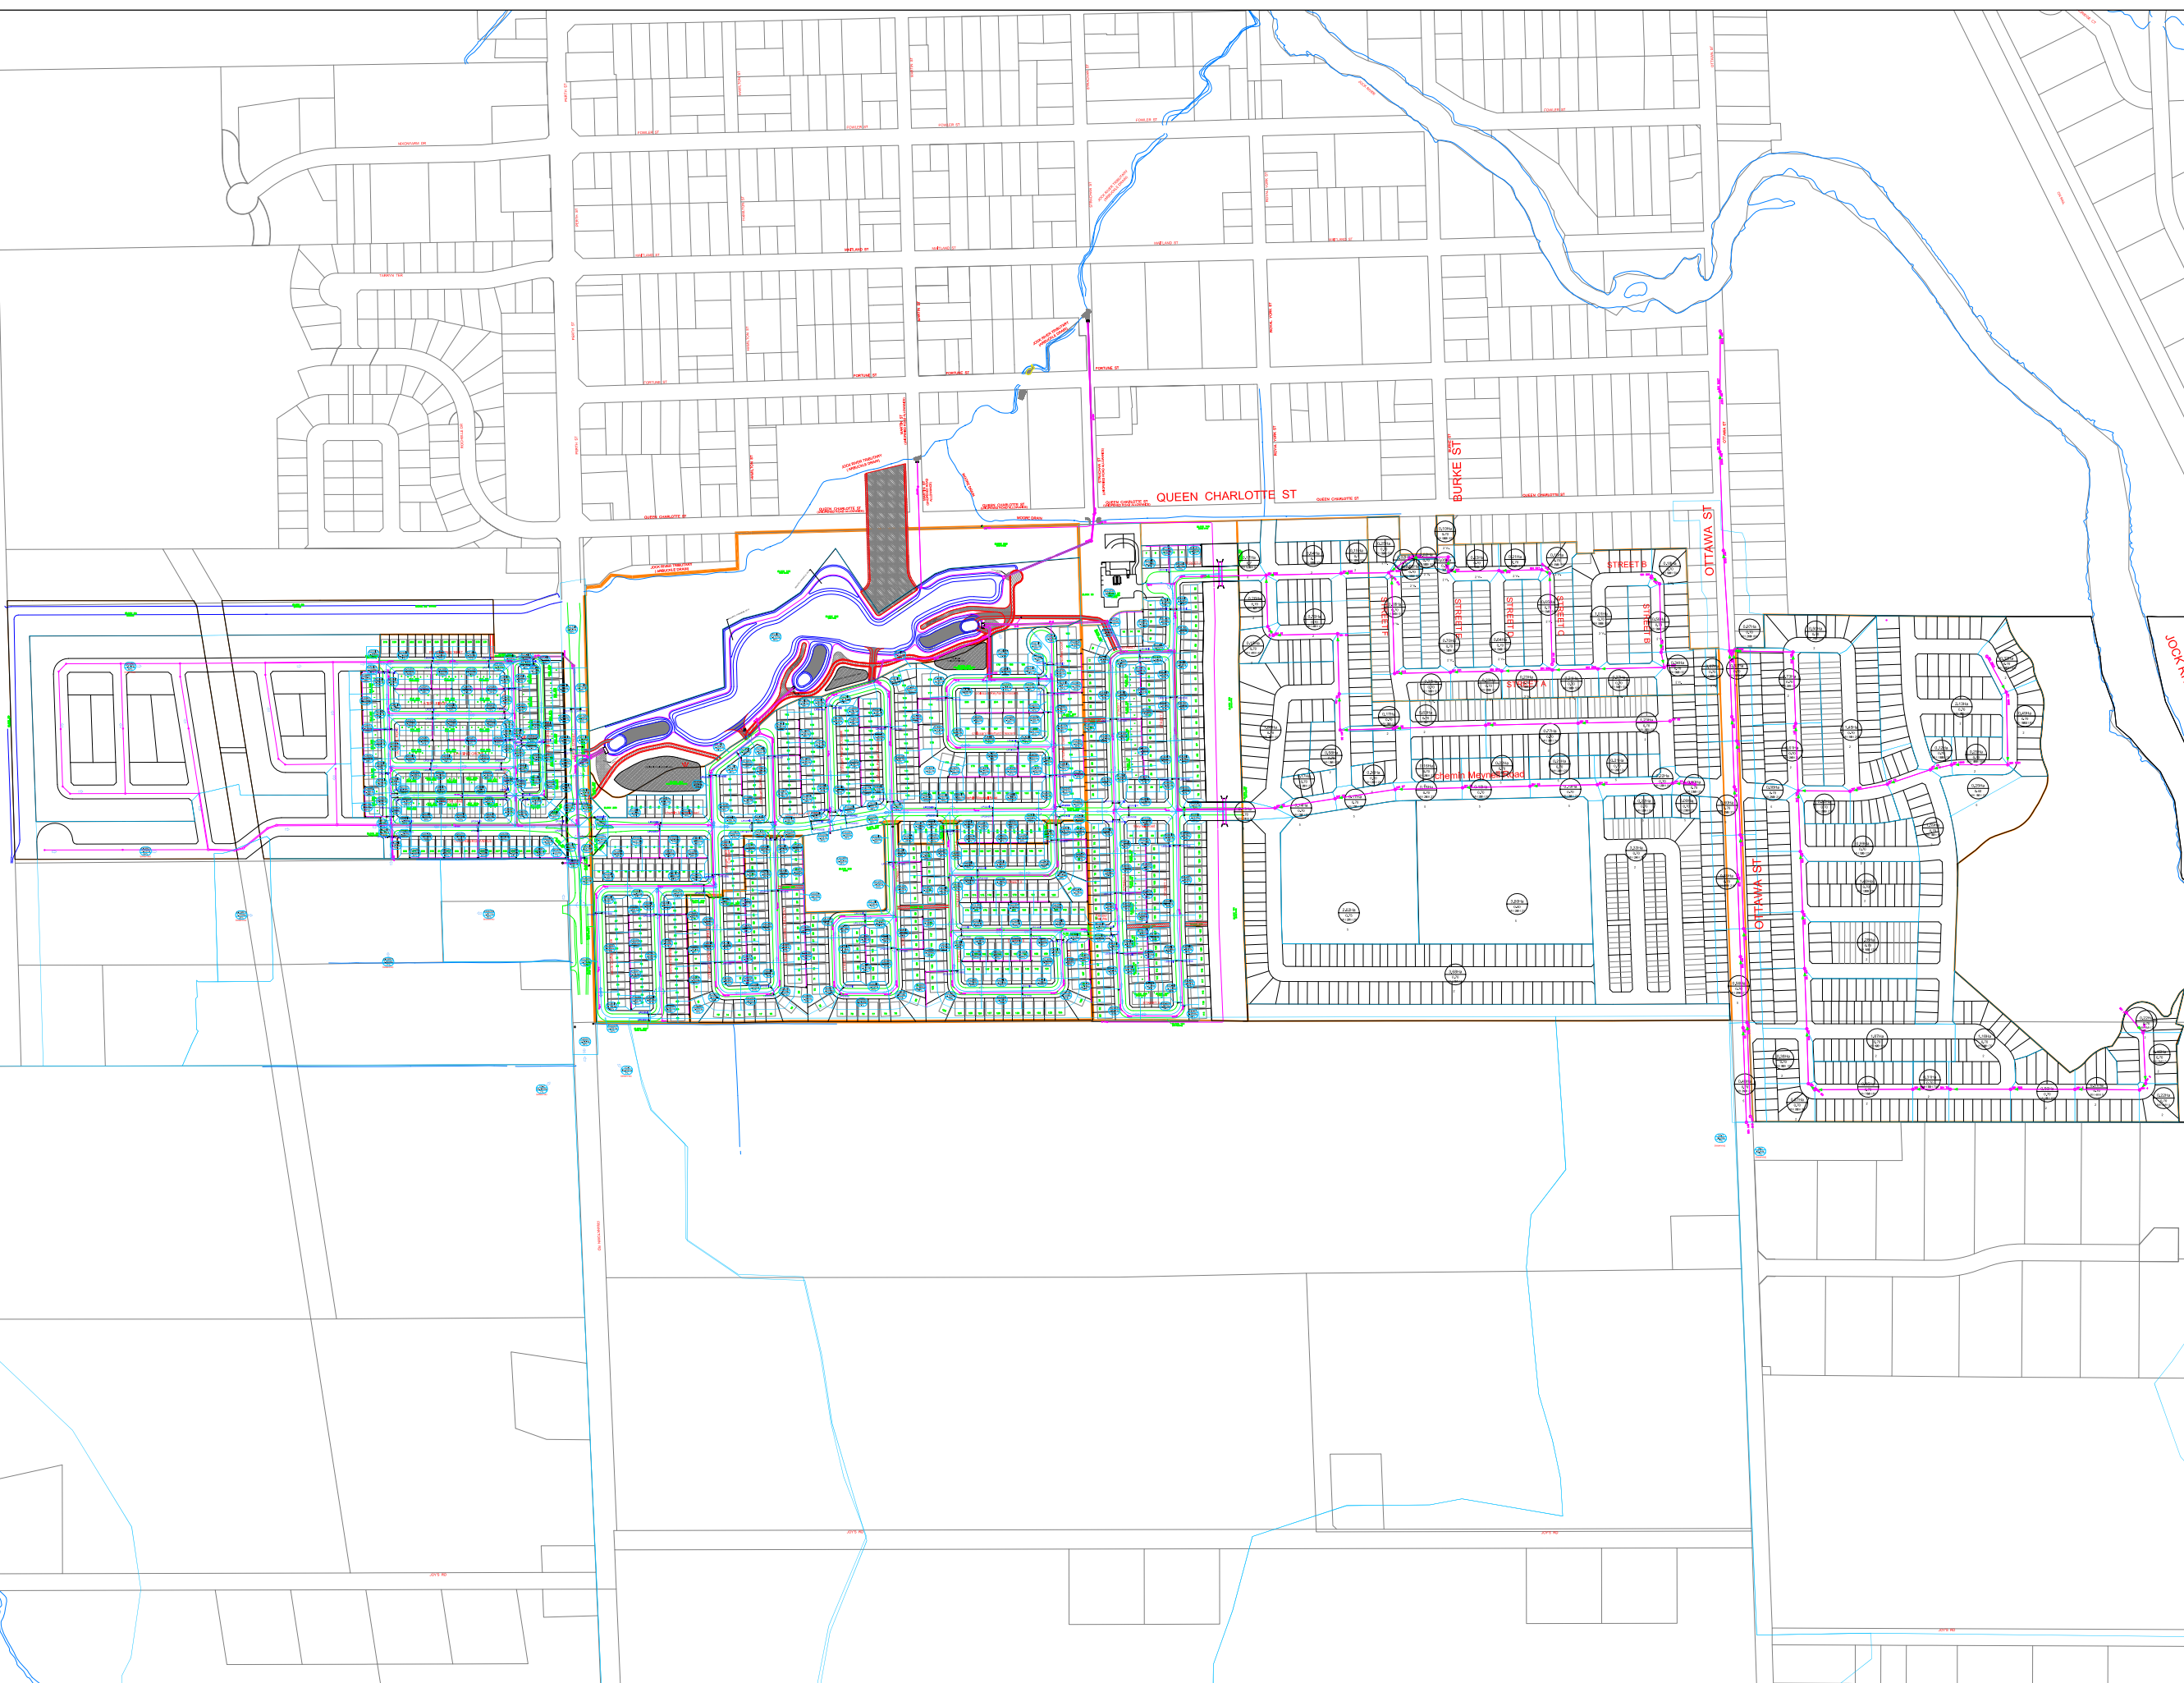

- LEGEND :
- LIMITS OF SUBDIVISION
 - MAJOR SYSTEM SUBCATCHMENT BOUNDARY TO LOW POINTS AND OTHER AREAS
 - ← MAJOR SYSTEM FLOW DIRECTION
 - ↻ FIRST DIRECTION OF EXCESS MAJOR SYSTEM FLOW AT LOW POINT
 - LP009SW LOW POINT
 - A009SW SUB-CATCHMENT ID
 - 0.063 ha SUB-CATCHMENT AREA
 - 43% TOTAL IMPERVIOUSNESS
 - 0.32HA FUTURE SUB-CATCHMENT AREA
 - 0.70 FUTURE SUB-CATCHMENT RUNOFF COEFF.
 - MH1803 MH1862 TRIBUTARY TO MANHOLE ID (U/S, D/S)

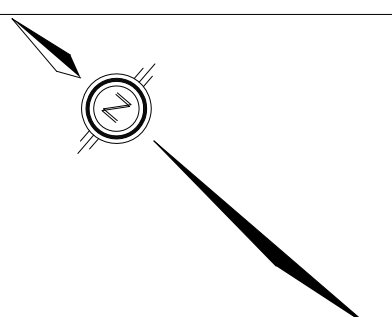

J.F. Sabourin & Associates Inc.
 WATER RESOURCES AND ENVIRONMENTAL CONSULTANTS
 OTTAWA (613) 836-3884
 GATINEAU (819) 243-6858

CLIENT : **DSEL**
David Schaeffer Engineering Ltd
 120 IBER ROAD, UNIT 103
 STITTVILLE, ONTARIO, K2S 1E9
 (613) 836-0856

PROJECT : WESTERN DEVELOPMENT LANDS
 RICHMOND

BY	DATE	DESCRIPTION	BY

EXPANDED DRAINAGE AREA
 TO SWM FACILITY

FIGURE 1

DESIGNED:	LP
DRAWN:	JFS
VERIFIED:	JFS
APPROVED:	JFS

DRAWING REF.	DATE	PROJECT No.
922-11\202101 FSR\Design\CAD\ JFSA Figures.dwg	Feb/21	922-11

ATTACHMENT

A

Drainage Areas and Target Release Rates

JFSA

Water Resources and
Environmental Consultants



Table A-1 : Drainage Area to SWM Facility

Segment ID ⁽¹⁾	Area (ha)	Imperviousness (%)	Area x Imp.
A002NE	0.072	61	4.392
A002NW	0.108	72	7.776
A002SE	0.198	72	14.256
A002SW	0.056	73	4.088
A005NE	0.050	74	3.700
A005NW	0.105	54	5.670
A005SE	0.090	69	6.210
A005SW	0.059	68	4.012
A006N1	0.035	43	1.505
A006NE	0.044	77	3.388
A006NW	0.046	76	3.496
A006R1	0.121	27	3.267
A006R2	0.113	26	2.938
A006R3	0.117	26	3.042
A006R4	0.087	18	1.566
A006R5	0.118	25	2.950
A006R6	0.106	24	2.544
A006R7	0.114	25	2.850
A006R8	0.042	25	1.050
A006SE	0.192	71	13.632
A006SW	0.192	69	13.248
A007NW	0.199	73	14.527
A007SE	0.094	72	6.768
A007SW	0.065	43	2.795
A008NE	0.103	74	7.622
A008NW	0.058	41	2.378
A008R1	0.113	27	3.051
A008R2	0.064	27	1.728
A008SE	0.138	70	9.660
A008SW	0.013	54	0.702
A009NW	0.047	79	3.713
A009SW	0.073	66	4.818
A010NE	0.125	74	9.250
A010NW	0.123	76	9.348
A010R1	0.135	24	3.240
A010R2	0.083	25	2.075
A010R3	0.154	21	3.234
A010SE	0.132	77	10.164
A010SW	0.147	74	10.878
A011NE	0.053	30	1.590
A011NW	0.053	53	2.809
A011SE	0.116	76	8.816
A011SW	0.053	53	2.809
A012NE	0.028	36	1.008
A012R1	0.040	19	0.760

Table A-1 : Drainage Area to SWM Facility

Segment ID ⁽¹⁾	Area (ha)	Imperviousness (%)	Area x Imp.
A012R2	0.138	26	3.588
A013N1	0.154	76	11.704
A013N2	0.045	38	1.710
A013NE	0.027	52	1.404
A013NW	0.052	40	2.080
A013R1	0.106	25	2.650
A013R2	0.128	24	3.072
A013R3	0.116	24	2.784
A013S1	0.155	78	12.090
A013S2	0.153	75	11.475
A013SE	0.027	48	1.296
A013SW	0.051	41	2.091
A016NE	0.087	76	6.612
A016NW	0.096	76	7.296
A017NE	0.073	36	2.628
A017NW	0.060	72	4.320
A017SE	0.172	73	12.556
A017SW	0.171	73	12.483
A020N1	0.039	72	2.808
A020N2	0.025	76	1.900
A020NE	0.049	78	3.822
A020NW	0.083	65	5.395
A020SW	0.109	78	8.502
A021NE	0.151	76	11.476
A021NW	0.087	70	6.090
A021R1	0.087	25	2.175
A021R2	0.147	24	3.528
A021R3	0.070	24	1.680
A021R4	0.052	24	1.248
A021SE	0.166	77	12.782
A021SW	0.168	71	11.928
A024NE	0.135	77	10.395
A024NW	0.122	74	9.028
A024R1	0.109	27	2.943
A024R2	0.114	28	3.192
A024R3	0.067	26	1.742
A024SE	0.127	75	9.525
A024SW	0.102	74	7.548
A025NE	0.078	71	5.538
A025NW	0.035	43	1.505
A025R1	0.156	26	4.056
A025R2	0.125	26	3.250
A025S1	0.076	46	3.496
A025SE	0.075	75	5.625
A025SW	0.066	50	3.300

Table A-1 : Drainage Area to SWM Facility

Segment ID ⁽¹⁾	Area (ha)	Imperviousness (%)	Area x Imp.
A026NE	0.031	74	2.294
A026R1	0.174	26	4.524
A026R2	0.195	17	3.315
A026R3	0.069	28	1.932
A026R4	0.123	28	3.444
A026R5	0.120	27	3.240
A026S1	0.041	41	1.681
A026SE	0.130	75	9.750
A026SW	0.036	42	1.512
A026WK1	0.018	59	1.062
A027N1	0.081	49	3.969
A027N2	0.140	74	10.360
A027NE	0.015	47	0.705
A027NW	0.122	64	7.808
A027S1	0.015	53	0.795
A027S2	0.042	69	2.898
A027SE	0.017	65	1.105
A027SW	0.133	74	9.842
A030NE	0.067	78	5.226
A030NW	0.142	76	10.792
A030R1	0.049	27	1.323
A030R2	0.124	27	3.348
A030R3	0.135	25	3.375
A030R4	0.087	27	2.349
A030SE	0.069	77	5.313
A030SW	0.144	70	10.080
A031NE	0.093	74	6.882
A031NW	0.105	64	6.720
A031R1	0.157	22	3.454
A031R2	0.146	26	3.796
A031R3	0.197	15	2.955
A031SE	0.082	35	2.870
A031SW	0.213	67	14.271
A1600N1	0.015	60	0.900
A1600N2	0.076	43	3.268
A1600NE	0.033	45	1.485
A1600NW	0.058	45	2.610
A1600PK1	0.963	29	27.927
A1600S1	0.018	56	1.008
A1600S2	0.054	59	3.186
A1600SE	0.028	54	1.512
A1600SW	0.055	49	2.695
A201NE	0.079	75	5.925
A201NW	0.079	75	5.925
A201R1	0.085	26	2.210

Table A-1 : Drainage Area to SWM Facility

Segment ID ⁽¹⁾	Area (ha)	Imperviousness (%)	Area x Imp.
A201R2	0.093	29	2.697
A201R3	0.118	26	3.068
A201R4	0.024	30	0.720
A201SE	0.082	64	5.248
A201SW	0.169	72	12.168
A202NE	0.053	76	4.028
A202NW	0.042	41	1.722
A202SE	0.109	70	7.630
A202SW	0.090	73	6.570
A204N1	0.053	80	4.240
A204N2	0.055	76	4.180
A204NE	0.088	74	6.512
A204NW	0.080	72	5.760
A204R1	0.036	28	1.008
A204R2	0.044	27	1.188
A204R3	0.017	26	0.442
A204R4	0.129	28	3.612
A204R5	0.091	26	2.366
A204R6	0.161	20	3.220
A204SE	0.180	75	13.500
A204SW	0.180	72	12.960
A206NE	0.062	40	2.480
A206NW	0.116	73	8.468
A206SE	0.134	73	9.782
A206SW	0.166	74	12.284
A208NE	0.078	73	5.694
A208NW	0.056	73	4.088
A208R1	0.106	27	2.862
A208R2	0.071	28	1.988
A208SE	0.160	72	11.520
A208SW	0.094	77	7.238
A211NE	0.024	77	1.848
A211NW	0.097	69	6.693
A211R1	0.079	28	2.212
A211R2	0.111	28	3.108
A211SE	0.033	43	1.419
A211SW	0.061	56	3.416
A212NE	0.097	63	6.111
A212NW	0.046	59	2.714
A212R1	0.134	28	3.752
A212R2	0.100	27	2.700
A212R3	0.021	28	0.588
A212SE	0.147	70	10.290
A212SW	0.052	60	3.120
A213R1	0.079	25	1.975

Table A-1 : Drainage Area to SWM Facility

Segment ID ⁽¹⁾	Area (ha)	Imperviousness (%)	Area x Imp.
A213R2	0.131	23	3.013
A214NE	0.151	77	11.627
A214NW	0.070	77	5.390
A214R1	0.077	27	2.079
A214R2	0.082	28	2.296
A214R3	0.111	27	2.997
A214R4	0.032	28	0.896
A214SE	0.056	75	4.200
A214SW	0.070	74	5.180
A215NW	0.108	80	8.640
A215SE	0.102	73	7.446
A216NE	0.041	39	1.599
A216NW	0.059	40	2.360
A216SE	0.096	77	7.392
A217NE	0.088	71	6.248
A217NW	0.099	74	7.326
A217SE	0.168	71	11.928
A217SW	0.099	74	7.326
A219NE	0.046	42	1.932
A219NW	0.113	74	8.362
A219R1	0.158	22	3.476
A219SE	0.070	67	4.690
A219SW	0.154	72	11.088
A220NE	0.127	74	9.398
A221N1	0.045	77	3.465
A221NE	0.119	73	8.687
A221NW	0.043	78	3.354
A221R1	0.130	27	3.510
A221R2	0.119	27	3.213
A221R3	0.125	24	3.000
A221SE	0.119	72	8.568
A221SW	0.065	40	2.600
A223N1	0.023	70	1.610
A223N2	0.076	47	3.572
A223NE	0.047	79	3.713
A223NW	0.031	44	1.364
A223R1	0.094	24	2.256
A223R2	0.120	22	2.640
A223R3	0.173	18	3.114
A223SE	0.203	70	14.210
A223SW	0.096	59	5.664
A224NE	0.018	54	0.972
A224NW	0.017	47	0.799
A224R1	0.024	26	0.624
A224SE	0.054	42	2.268

Table A-1 : Drainage Area to SWM Facility

Segment ID ⁽¹⁾	Area (ha)	Imperviousness (%)	Area x Imp.
A224SW	0.101	65	6.565
A250N1	0.066	76	5.016
A250NE	0.048	39	1.872
A250NW	0.018	38	0.684
A250R1	0.073	21	1.533
A250R2	0.051	21	1.071
A251E1	0.105	73	7.665
A251E2	0.114	58	6.612
A251N1	0.029	75	2.175
A251N2	0.031	44	1.364
A251N3	0.063	73	4.599
A251N4	0.046	70	3.220
A251NE	0.064	73	4.672
A251NW	0.084	75	6.300
A251R1	0.120	24	2.880
A251R2	0.088	28	2.464
A251R3	0.086	23	1.978
A251R4	0.047	19	0.893
A251S1	0.011	41	0.451
A251S3	0.062	36	2.232
A251S4	0.033	48	1.584
A251S5	0.066	70	4.620
A251S6	0.055	76	4.180
A251SE	0.075	60	4.500
A251SW	0.085	60	5.100
A251W1	0.038	88	3.344
A251W2	0.037	86	3.182
A252E1	0.014	47	0.658
A252NE	0.078	74	5.772
A252NW	0.102	68	6.936
A252R1	0.142	24	3.408
A252SE	0.078	73	5.694
A252SW	0.084	74	6.216
A252W1	0.078	76	5.928
A252W2	0.079	76	6.004
A254N2	0.016	34	0.544
A254NE	0.054	62	3.348
A254NW	0.030	40	1.200
A254R1	0.129	24	3.096
A254R2	0.029	22	0.638
A254R3	0.089	23	2.047
A254R4	0.057	24	1.368
A254S2	0.029	37	1.073
A254SE	0.103	58	5.974
A254SW	0.035	41	1.435

Table A-1 : Drainage Area to SWM Facility

Segment ID ⁽¹⁾	Area (ha)	Imperviousness (%)	Area x Imp.
A256NE	0.049	57	2.793
A256SE	0.031	63	1.953
A256SW	0.031	46	1.426
A258E1	0.034	47	1.598
A258NE	0.073	88	6.424
A258NW	0.074	91	6.734
A258SE	0.074	88	6.512
A258SW	0.074	91	6.734
A259N1	0.022	63	1.386
A259NE	0.058	94	5.452
A259NW	0.046	94	4.324
A259S1	0.026	63	1.638
A259SE	0.047	89	4.183
A259SW	0.039	93	3.627
A259W1	0.023	44	1.012
A259W2	0.024	43	1.032
A260NE	0.042	86	3.612
A260NW	0.049	72	3.528
A260SE	0.046	92	4.232
A260SW	0.051	57	2.907
A263NE	0.086	58	4.988
A263NW	0.038	64	2.432
A263SE	0.085	72	6.120
A263SW	0.038	69	2.622
A264NE	0.077	60	4.620
A264NW	0.110	60	6.600
A264R1	0.124	24	2.976
A264R2	0.098	24	2.352
A264R3	0.130	24	3.120
A264R4	0.080	23	1.840
A264SE	0.143	72	10.296
A264SW	0.106	66	6.996
A265NE	0.110	69	7.590
A265SW	0.117	75	8.775
A266NE	0.043	79	3.397
A266NW	0.077	63	4.851
A266SE	0.052	85	4.420
A266SW	0.060	51	3.060
A270E1	0.046	75	3.450
A270NE	0.134	73	9.782
A270NW	0.033	73	2.409
A270R1	0.158	24	3.792
A270SE	0.045	76	3.420
A270SW	0.084	74	6.216
A271NE	0.049	51	2.499

Table A-1 : Drainage Area to SWM Facility

Segment ID ⁽¹⁾	Area (ha)	Imperviousness (%)	Area x Imp.
A271NW	0.092	70	6.440
A271S2	0.082	73	5.986
A271SW	0.031	78	2.418
A273NE	0.112	70	7.840
A273NW	0.016	47	0.752
A273SE	0.071	91	6.461
A273SW	0.013	35	0.455
A277N1	0.323	69	22.287
A277N2	0.071	63	4.473
A277N3	0.129	61	7.869
A277NE	0.036	67	2.412
A277NW	0.066	68	4.488
A277S1	0.039	69	2.691
A277S2	0.072	66	4.752
A277SE	0.047	70	3.290
A277SW	0.086	64	5.504
A280N1	0.047	51	2.397
A280NW	0.046	80	3.680
A280R1	0.099	23	2.277
A280R2	0.032	7	0.224
A280S1	0.533	62	33.046
A280S2	0.087	61	5.307
A280SW	0.086	81	6.966
A329NE	0.037	76	2.812
A329NW	0.038	76	2.888
APOND1	6.472	56	362.432
APOND R1	0.138	24	3.312
APOND R2	0.043	19	0.817
APOND R3	0.167	23	3.841
APOND R4	0.022	7	0.154
B003N1	0.101	58	5.858
B003NE	0.106	74	7.844
B003NW	0.106	67	7.102
B003S1	0.075	63	4.725
B003SE	0.115	72	8.280
B003SW	0.087	73	6.351
B004NE	0.180	74	13.320
B004NW	0.060	47	2.820
B004SE	0.180	74	13.320
B004SW	0.067	75	5.025
B005NE	0.061	51	3.111
B005NW	0.061	52	3.172
B006NE	0.095	76	7.220
B006NW	0.099	74	7.326
B006SE	0.069	71	4.899

Table A-1 : Drainage Area to SWM Facility

Segment ID ⁽¹⁾	Area (ha)	Imperviousness (%)	Area x Imp.
B006SW	0.051	47	2.397
B007NE	0.109	73	7.957
B007NW	0.093	72	6.696
B007SE	0.113	72	8.136
B007SW	0.119	72	8.568
B010NE	0.107	70	7.490
B010NW	0.105	37	3.885
B010R1	0.024	28	0.672
B010R2	0.082	27	2.214
B011NE	0.122	63	7.686
B011NW	0.097	58	5.626
B011SE	0.109	70	7.630
B011SW	0.090	74	6.660
B013NE	0.050	54	2.700
B013NW	0.130	68	8.840
B013R1	0.048	29	1.392
B013R2	0.100	26	2.600
B013SE	0.043	41	1.763
B013SW	0.054	54	2.916
B014N1	0.036	62	2.232
B014N2	0.034	70	2.380
B014N3	0.069	72	4.968
B014NE	0.141	64	9.024
B014NW	0.030	42	1.260
B014R1	0.043	26	1.118
B014R2	0.090	26	2.340
B014R3	0.111	23	2.553
B014SE	0.096	69	6.624
B014SW	0.093	74	6.882
B014WK1	0.031	50	1.550
B015NE	0.072	56	4.032
B015NW	0.100	70	7.000
B015R1	0.079	25	1.975
B015R2	0.087	26	2.262
B015R3	0.104	26	2.704
B015R4	0.048	25	1.200
B015S1	0.070	77	5.390
B015S2	0.074	74	5.476
B015SE	0.094	77	7.238
B015SW	0.099	73	7.227
B016NW	0.129	75	9.675
B016SE	0.129	75	9.675
B017NE	0.059	51	3.009
B017SW	0.092	71	6.532
B018NE	0.111	78	8.658

Table A-1 : Drainage Area to SWM Facility

Segment ID ⁽¹⁾	Area (ha)	Imperviousness (%)	Area x Imp.
B018NW	0.115	76	8.740
B018R1	0.104	27	2.808
B018R2	0.108	27	2.916
B018R3	0.105	27	2.835
B018SE	0.130	76	9.880
B018SW	0.131	78	10.218
B018WK1	0.016	50	0.800
B020R1	0.024	7	0.168
B020R2	0.157	20	3.140
B020WK1	0.043	23	0.989
B021PS1	0.837	64	53.568
Undeveloped Areas			
VG-2	64.366	7	450.562
VG-5	34.992	7	244.944
Future Development Areas			
A270RE1	7.813	64	500.032
A328RE1	7.421	64	474.944
A329CM1	1.861	86	160.046
A329PK1	1.078	29	31.262
A329RE1	7.865	64	503.360
f23a	0.220	71	15.620
f23b	0.210	71	14.910
f23c	0.220	71	15.620
f24a	3.330	71	236.430
f24b	0.190	71	13.490
f24c	0.210	71	14.910
f25a	0.180	71	12.780
f25b	0.220	71	15.620
f26a	0.160	71	11.360
f26b	0.180	71	12.780
f26c	3.600	29	104.400
f27a	0.170	71	12.070
f27b	2.620	79	206.980
f27c	0.360	71	25.560
f28a	0.140	71	9.940
f28b	0.170	71	12.070
f29a	0.130	71	9.230
f29b	3.680	71	261.280
f32	1.230	71	87.330
f33	0.770	71	54.670
f34	0.630	71	44.730
f35	0.170	71	12.070
f36	0.580	71	41.180
f38	1.830	71	129.930
f40	0.700	71	49.700

Table A-1 : Drainage Area to SWM Facility

Segment ID ⁽¹⁾	Area (ha)	Imperviousness (%)	Area x Imp.
f41	0.150	71	10.650
f42	0.260	71	18.460
f230a	0.090	71	6.390
f230b	0.100	71	7.100
f501	0.180	71	12.780
f504	0.580	71	41.180
f505	0.340	71	24.140
f507	0.270	71	19.170
f508a	1.010	71	71.710
f508b	0.210	71	14.910
f509	0.230	71	16.330
f510	0.230	71	16.330
f511	0.350	71	24.850
f513	0.680	71	48.280
f514	0.050	71	3.550
f515	0.650	71	46.150
f516	0.150	71	10.650
f517	0.210	71	14.910
f519a	0.640	71	45.440
f519b	0.230	71	16.330
f521a	0.050	71	3.550
f521b	0.700	71	49.700
f522a	0.020	71	1.420
f522b	0.100	71	7.100
f523	0.020	71	1.420
f524a	0.150	71	10.650
f524b	0.250	71	17.750
f525	0.640	71	45.440
f526	0.170	71	12.070
Total	199.723	34	6806.124

⁽¹⁾ Refer to Figure 2

Weighted Average Imperviousness = S(Area x Imp) / Total Area = 6806.124 / 199.723 = 34 %

Table A-2 : Summary of Total Drainage Area

Land Use ⁽¹⁾	Area (ha)	Imperviousness (%)	Area x Imp.
to Pond 1	199.723	34	6806.124

⁽¹⁾ Refer to Figure 2.

Weighted Average Imperviousness = S(Area x Imp) / Total Area = 6806.124 / 199.723 = 34 %

Table A-3: Target Release Rates for SWM Facility

Event	Pre-Development Release Rate ⁽¹⁾ (m ³ /s/ha)	Target Release Rate (m ³ /s)
2-Year, 24-Hour SCS ⁽²⁾	2.767	0.330
5-Year, 24-Hour SCS	4.290	4.290
10-Year, 24-Hour SCS	5.348	5.348
25-Year, 24-Hour SCS	6.694	6.694
50-Year, 24-Hour SCS	7.749	7.749
100-Year, 24-Hour SCS	8.894	8.894

⁽¹⁾ As per pre-development flows modelled in the January 2014 "Richmond Village (South) Limited Subdivision / Preliminary Stormwater Management Plan" memo.

⁽²⁾ Target release rate based on erosion control of 2-year release rate to 330 L/s (per Parish Geomorphic erosion threshold; refer to January 2014 memo).

ATTACHMENT

B

Pond Controls – Quality, Extended Detention and Quantity

Sediment Drying Area Calculations

JFSA

Water Resources and
Environmental Consultants



Table B-1: Criteria for Required Storage Volumes

Pond	Area ⁽¹⁾ (ha)	Imperviousness (%)	Storage Volume for Impervious Level ⁽²⁾ (m ³ /ha)
N/A	N/A	35	140
Pond 1	199.723	34	140.00
N/A	N/A	55	190

⁽¹⁾ Refer to Appendix C for drainage areas to SWM Facility.

⁽²⁾ Protection Level for Wet Pond: Enhanced 80% long-term S.S. removal. SWM Planning & Design Manual, Table 3.2, p.3-10 (March 2003).

Table B-2: Required Storage Volumes for SWM Facility

Pond Component	Required Volume (m ³)	Provided Volume ⁽⁴⁾ (m ³)	Volume Ratio	Provided Area ⁽⁵⁾ (m ²)	Provided Elevation (m)
Permanent Pool (PP) ⁽¹⁾	19972	45330	2.27	28938	92.350
Quality Control ⁽²⁾	7989	7989	1.00	N/A	92.619
Extended Detention ⁽³⁾	N/A	43875	N/A	N/A	93.680
Forebay (20% PP)	3994	N/A	N/A	6199	92.350
PP - Forebay	15978	N/A	N/A	22739	92.350
Area Ratio (%) ⁽⁶⁾ =				21	

⁽¹⁾ Required PP volume based on Table B-1 (140.00 - 40 = 100.00 m³/ha).

⁽²⁾ Required quality control volume based on 40 m³/ha.

⁽³⁾ Extended detention based on 100-year summer flood level at the pond outfall.

⁽⁴⁾ Provided volume based on stage-storage curve and extended detention (refer to Tables B-8 and B-9 of Appendix B).

⁽⁵⁾ Based on grading plan provided by DSEL (refer to Figure 2).

⁽⁶⁾ As per MOE, Maximum Forebay Area: 33% of Total Permanent Pool.

Table B-3: Extended Detention Parameters for SWM Facility

Permanent Pool Parameters		Baseflow Orifice Parameters		Quality Orifice Parameters	
Area (C3)	28938.05 m ²	Diameter	0.100 m	Diameter	0.300 m
Volume	45330.01 m ³				
PP Elev	92.350 m	Area	0.008 m ²	Area	0.071 m ²
QC Elev	92.619 m	Invert	92.100 m	Invert	92.350 m
h (m)	0.269 m	C _o	0.62	C _o	0.62

- Notes:
- C3 is the intercept from the area-depth linear regression.
 - PP Elev indicates the elevation of the permanent pool.
 - QC Elev indicates the elevation of the storage volume required by MOE for quality control.
 - h is the maximum water elevation above the orifice (m).

Table B-4: Extended Detention Drawdown Time for SWM Facility

Elev. (m)	Active Storage			C2 (m ² /m)	Drawdown Time (h)	Drawdown Time (days)	Flow (m ³ /s)	Demarkation Point
	V (m ³)	A (m ²)	depth (m)					
92.35	0.00	28938.05	0.00				0.011	PP Elev
92.40	1447.42	28966.93	0.05	578	16.65	0.69	0.024	
92.45	2921.35	29497.69	0.10	5596	23.69	0.99	0.038	
92.50	4404.39	29790.67	0.15	5684	29.11	1.21	0.051	
92.55	5905.87	30117.00	0.20	5895	33.74	1.41	0.065	
92.60	7419.40	30403.23	0.25	5861	37.84	1.58	0.078	
92.619	7989.00	30511.44	0.27	5857	39.27	1.64	0.083	QC Elev
92.65	8946.63	30693.36	0.30	5851	41.59	1.73	0.091	
92.70	10489.71	30979.41	0.35	5832	45.06	1.88	0.114	
92.75	12047.14	31272.39	0.40	5836	48.33	2.01	0.136	
92.80	13618.54	31567.55	0.45	5843	51.43	2.14	0.156	
92.85	15204.56	31862.53	0.50	5849	54.39	2.27	0.176	
92.90	16806.83	32161.21	0.55	5860	57.23	2.38	0.196	
92.95	18424.87	32459.98	0.60	5870	59.97	2.50	0.214	
93.00	20054.22	32758.57	0.65	5878	62.63	2.61	0.231	
93.05	21698.57	33052.02	0.70	5877	65.20	2.72	0.246	
93.10	23361.36	33349.09	0.75	5881	67.70	2.82	0.260	
93.15	25037.25	33654.51	0.80	5896	70.16	2.92	0.274	
93.20	26728.92	33957.94	0.85	5906	72.55	3.02	0.286	
93.25	28425.62	34260.52	0.90	5914	74.90	3.12	0.298	
93.30	30162.12	34566.80	0.95	5925	77.21	3.22	0.310	
93.35	31900.53	34869.18	1.00	5931	79.47	3.31	0.321	
93.40	33804.14	35199.40	1.05	5963	81.72	3.40	0.332	
93.45	35591.37	35493.24	1.10	5959	83.90	3.50	0.342	
93.50	37203.33	35906.87	1.15	6060	86.17	3.59	0.353	
93.55	39003.77	36110.83	1.20	5977	88.21	3.68	0.362	
93.60	40793.68	38015.11	1.25	7262	91.83	3.83	0.372	
93.640	42324.77	38434.78	1.29	7362	93.70	3.90	0.379	Summer FL
93.65	42707.55	38539.70	1.30	7386	94.16	3.92	0.381	
93.680	43874.50	38970.27	1.33	7543	95.66	3.99	0.387	Ext. Det.
93.70	44652.47	39257.33	1.35	7644	96.66	4.03	0.690	
93.75	46640.54	40265.56	1.40	8091	99.45	4.14	2.359	
93.80	48678.10	41236.84	1.45	8482	102.20	4.26	4.807	
93.85	50750.08	41642.21	1.50	8469	104.37	4.35	7.833	
93.90	52847.68	42261.61	1.55	8596	106.75	4.45	11.341	
93.95	54989.42	43408.35	1.60	9044	109.69	4.57	15.273	
94.00	57180.79	44246.16	1.65	9278	112.30	4.68	19.585	

- Notes:
- C2 is the slope coefficient from the area-depth linear regression.
 - PP Elev indicates the elevation of the permanent pool.
 - QC Elev indicates the elevation of the storage volume required by MOE for quality control, with a 24 to 48 hour drawdown time.

Table B-5: Stage-Storage-Outflow Curve for Ultimate SWM Facility (Free Outfall Conditions)

		Baseflow Control 1		Quality Control 1		Erosion Control 1		Quantity Control 1					
		Vertical Orifice		Vertical Orifice		Vertical Orifice		Rectangular Weir					
		Dia (m)	0.100	Dia (m)	0.300	Dia (m)	0.270	L (m)	67.000	88.5 with 90° angle			
		Area (m ²)	0.008	Area (m ²)	0.071	Area (m ²)	0.057	C _w	1.58				
		Invert (m)	92.10	Invert (m)	92.35	Invert (m)	92.65	Invert (m)	93.68				
		C _o	0.62	C _o	0.62	C _o	0.62	n contr.	2				
		Q @ D	0.005	Q @ D	0.075	Q @ D	0.058						
Elevation	Active Sto.	Notes		Head	Outflow	Head	Outflow	Head	Outflow	Head	Outflow	Outflow	Storage
(m)	(m ³)			(m)	(m ³ /s)	(m)	(m ³ /s)	(m)	(m ³ /s)	(m)	(m ³ /s)	(m ³ /s)	(ha·m)
92.35	0	PP Elev		0.250	0.011	0.000	0.000	0.000	0.000	0.000	0.000	0.011	0.000
92.40	1447			0.300	0.012	0.050	0.013	0.000	0.000	0.000	0.000	0.024	0.145
92.45	2921			0.350	0.013	0.100	0.025	0.000	0.000	0.000	0.000	0.038	0.292
92.50	4404			0.400	0.014	0.150	0.038	0.000	0.000	0.000	0.000	0.051	0.440
92.55	5906			0.450	0.014	0.200	0.050	0.000	0.000	0.000	0.000	0.065	0.591
92.60	7419			0.500	0.015	0.250	0.063	0.000	0.000	0.000	0.000	0.078	0.742
92.619	7989	QC Elev		0.519	0.016	0.269	0.067	0.000	0.000	0.000	0.000	0.083	0.799
92.65	8947			0.550	0.016	0.300	0.075	0.000	0.000	0.000	0.000	0.091	0.895
92.70	10490			0.600	0.017	0.350	0.087	0.050	0.011	0.000	0.000	0.114	1.049
92.75	12047			0.650	0.017	0.400	0.097	0.100	0.021	0.000	0.000	0.136	1.205
92.80	13619			0.700	0.018	0.450	0.106	0.150	0.032	0.000	0.000	0.156	1.362
92.85	15205			0.750	0.019	0.500	0.115	0.200	0.043	0.000	0.000	0.176	1.520
92.90	16807			0.800	0.019	0.550	0.123	0.250	0.053	0.000	0.000	0.196	1.681
92.95	18425			0.850	0.020	0.600	0.130	0.300	0.064	0.000	0.000	0.214	1.842
93.00	20054			0.900	0.020	0.650	0.137	0.350	0.073	0.000	0.000	0.231	2.005
93.05	21699			0.950	0.021	0.700	0.144	0.400	0.081	0.000	0.000	0.246	2.170
93.10	23361			1.000	0.022	0.750	0.150	0.450	0.088	0.000	0.000	0.260	2.336
93.15	25037			1.050	0.022	0.800	0.157	0.500	0.095	0.000	0.000	0.274	2.504
93.20	26729			1.100	0.023	0.850	0.162	0.550	0.101	0.000	0.000	0.286	2.673
93.25	28426			1.150	0.023	0.900	0.168	0.600	0.107	0.000	0.000	0.298	2.843
93.30	30162			1.200	0.024	0.950	0.174	0.650	0.113	0.000	0.000	0.310	3.016
93.35	31901			1.250	0.024	1.000	0.179	0.700	0.118	0.000	0.000	0.321	3.190
93.40	33804			1.300	0.025	1.050	0.184	0.750	0.123	0.000	0.000	0.332	3.380
93.45	35591			1.350	0.025	1.100	0.189	0.800	0.128	0.000	0.000	0.342	3.559
93.50	37203			1.400	0.026	1.150	0.194	0.850	0.133	0.000	0.000	0.353	3.720
93.55	39004			1.450	0.026	1.200	0.199	0.900	0.138	0.000	0.000	0.362	3.900
93.60	40794			1.500	0.026	1.250	0.204	0.950	0.142	0.000	0.000	0.372	4.079
93.64	42325	Summer FL		1.540	0.027	1.290	0.207	0.990	0.145	0.000	0.000	0.379	4.232
93.65	42708			1.550	0.027	1.300	0.208	1.000	0.146	0.000	0.000	0.381	4.271
93.68	43875	Ext. Det.		1.580	0.027	1.330	0.211	1.030	0.149	0.000	0.000	0.387	4.387
93.70	44652			1.600	0.027	1.350	0.213	1.050	0.150	0.020	0.299	0.690	4.465
93.75	46641			1.650	0.028	1.400	0.217	1.100	0.154	0.070	1.960	2.359	4.664
93.80	48678			1.700	0.028	1.450	0.221	1.150	0.158	0.120	4.399	4.807	4.868
93.85	50750			1.750	0.029	1.500	0.226	1.200	0.162	0.170	7.416	7.833	5.075
93.90	52848			1.800	0.029	1.550	0.230	1.250	0.166	0.220	10.916	11.341	5.285
93.95	54989			1.850	0.029	1.600	0.234	1.300	0.170	0.270	14.840	15.273	5.499
94.00	57181			1.900	0.030	1.650	0.238	1.350	0.173	0.320	19.144	19.585	5.718
94.05	59423			1.950	0.030	1.700	0.242	1.400	0.177	0.370	23.799	24.247	5.942
94.10	61714			2.000	0.031	1.750	0.246	1.450	0.180	0.420	28.778	29.234	6.171
94.11	62185	Spring FL		2.010	0.031	1.760	0.246	1.460	0.181	0.430	29.811	30.269	6.218
94.15	64066			2.050	0.031	1.800	0.249	1.500	0.184	0.470	34.062	34.526	6.407
94.20	66471			2.100	0.031	1.850	0.253	1.550	0.187	0.520	39.633	40.105	6.647
94.25	68904			2.150	0.032	1.900	0.257	1.600	0.190	0.570	45.478	45.957	6.890
94.30	71364			2.200	0.032	1.950	0.260	1.650	0.194	0.620	51.584	52.070	7.136
94.35	73853			2.250	0.032	2.000	0.264	1.700	0.197	0.670	57.939	58.433	7.385
94.40	76369			2.300	0.033	2.050	0.268	1.750	0.200	0.720	64.535	65.035	7.637
94.45	78916			2.350	0.033	2.100	0.271	1.800	0.203	0.770	71.362	71.869	7.892
94.50	81485			2.400	0.033	2.150	0.275	1.850	0.206	0.820	78.413	78.927	8.148

- Notes :
- PP Elev indicates the elevation of the permanent pool.
 - QC Elev indicates the elevation of the storage volume required by MOE for quality control.
 - Ext. Det. indicates the elevation of extended detention provided above the 100-year summer flood level at the pond outfall.

Table B-6: Stage-Storage-Outflow Curve for SWM Facility (Restrictive D/S Conditions; Summer Flood Level = 93.64 m)

Elevation (m)	Active Sto. (m ³)	Notes	Baseflow Control 1		Quality Control 1		Erosion Control 1		Quantity Control 1		Outflow (m ³ /s)	Storage (ha·m)
			Vertical Orifice Dia (m) 0.100 Area (m ²) 0.008 Invert (m) 93.64 C _o 0.62 Q @ D 0.005	Vertical Orifice Dia (m) 0.300 Area (m ²) 0.071 Invert (m) 93.64 C _o 0.62 Q @ D 0.075	Vertical Orifice Dia (m) 0.270 Area (m ²) 0.057 Invert (m) 93.64 C _o 0.62 Q @ D 0.058	Rectangular Weir L (m) 67.000 88.5 with 90° angle C _w 1.58 Invert (m) 93.68 n contr. 2						
			Head (m)	Outflow (m ³ /s)	Head (m)	Outflow (m ³ /s)	Head (m)	Outflow (m ³ /s)	Head (m)	Outflow (m ³ /s)		
92.35	0	PP Elev	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.40	1447		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.145
92.45	2921		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.292
92.50	4404		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.440
92.55	5906		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.591
92.60	7419		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.742
92.619	7989	QC Elev	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.799
92.65	8947		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.895
92.70	10490		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	1.049
92.75	12047		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	1.205
92.80	13619		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	1.362
92.85	15205		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	1.520
92.90	16807		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	1.681
92.95	18425		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	1.842
93.00	20054		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.005
93.05	21699		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.170
93.10	23361		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.336
93.15	25037		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.504
93.20	26729		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.673
93.25	28426		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.843
93.30	30162		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	3.016
93.35	31901		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	3.190
93.40	33804		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	3.380
93.45	35591		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	3.559
93.50	37203		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	3.720
93.55	39004		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	3.900
93.60	40794		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	4.079
93.64	42325	Summer FL	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	4.232
93.65	42708		0.010	0.000	0.010	0.003	0.010	0.002	0.000	0.000	0.005	4.271
93.68	43875	Ext. Det.	0.040	0.002	0.040	0.010	0.040	0.009	0.000	0.000	0.021	4.387
93.70	44652		0.060	0.003	0.060	0.015	0.060	0.013	0.020	0.299	0.330	4.465
93.75	46641		0.110	0.005	0.110	0.028	0.110	0.024	0.070	1.960	2.017	4.664
93.80	48678		0.160	0.007	0.160	0.040	0.160	0.034	0.120	4.399	4.480	4.868
93.85	50750		0.210	0.009	0.210	0.053	0.210	0.045	0.170	7.416	7.522	5.075
93.90	52848		0.260	0.010	0.260	0.065	0.260	0.056	0.220	10.916	11.047	5.285
93.95	54989		0.310	0.011	0.310	0.078	0.310	0.066	0.270	14.840	14.994	5.499
94.00	57181		0.360	0.012	0.360	0.089	0.360	0.075	0.320	19.144	19.320	5.718
94.05	59423		0.410	0.013	0.410	0.099	0.410	0.082	0.370	23.799	23.993	5.942
94.10	61714		0.460	0.014	0.460	0.108	0.460	0.090	0.420	28.778	28.990	6.171
94.11	62185	Spring FL	0.470	0.014	0.470	0.110	0.470	0.091	0.430	29.811	30.026	6.218
94.15	64066		0.510	0.015	0.510	0.116	0.510	0.096	0.470	34.062	34.289	6.407
94.20	66471		0.560	0.015	0.560	0.124	0.560	0.103	0.520	39.633	39.876	6.647
94.25	68904		0.610	0.016	0.610	0.132	0.610	0.108	0.570	45.478	45.735	6.890
94.30	71364		0.660	0.017	0.660	0.139	0.660	0.114	0.620	51.584	51.853	7.136
94.35	73853		0.710	0.018	0.710	0.145	0.710	0.119	0.670	57.939	58.222	7.385
94.40	76369		0.760	0.018	0.760	0.152	0.760	0.124	0.720	64.535	64.829	7.637
94.45	78916		0.810	0.019	0.810	0.158	0.810	0.129	0.770	71.362	71.668	7.892
94.50	81485		0.860	0.019	0.860	0.164	0.860	0.134	0.820	78.413	78.730	8.148

- Notes :
- PP Elev indicates the elevation of the permanent pool.
 - QC Elev indicates the elevation of the storage volume required by MOE for quality control.
 - Ext. Det. indicates the elevation of extended detention provided above the 100-year summer flood level at the pond outfall.

Table B-7: Stage-Storage-Outflow Curve for SWM Facility (Restrictive D/S Conditions; Spring Flood Level = 94.11 m)

		Baseflow Control 1		Quality Control 1		Erosion Control 1		Quantity Control 1					
		Vertical Orifice		Vertical Orifice		Vertical Orifice		Rectangular Weir					
		Dia (m)	0.100	Dia (m)	0.300	Dia (m)	0.270	L (m)	67.000				
								88.5 with 90° angle					
		Area (m ²)	0.008	Area (m ²)	0.071	Area (m ²)	0.057	C _w	1.58				
		Invert (m)	94.11	Invert (m)	94.11	Invert (m)	94.11	Invert (m)	94.11				
		C _o	0.62	C _o	0.62	C _o	0.62	n contr.	2				
		Q @ D	0.005	Q @ D	0.075	Q @ D	0.058						
Elevation	Active Sto.	Notes		Head	Outflow	Head	Outflow	Head	Outflow	Head	Outflow	Outflow	Storage
(m)	(m ³)			(m)	(m ³ /s)	(m)	(m ³ /s)	(m)	(m ³ /s)	(m)	(m ³ /s)	(m ³ /s)	(ha·m)
92.35	0	PP Elev		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.40	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.45	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.50	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.55	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.60	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.619	0	QC Elev		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.65	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.70	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.75	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.80	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.85	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.90	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
92.95	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.00	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.05	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.10	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.15	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.20	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.25	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.30	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.35	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.40	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.45	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.50	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.55	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.60	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.64	0	Summer FL		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.65	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.68	0	Ext. Det.		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.70	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.75	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.80	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.85	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.90	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
93.95	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
94.00	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
94.05	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
94.10	0			0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
94.11	0	Spring FL		0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
94.15	1881			0.040	0.002	0.040	0.010	0.040	0.009	0.040	0.847	0.867	0.188
94.20	4286			0.090	0.004	0.090	0.023	0.090	0.019	0.090	2.857	2.904	0.429
94.25	6719			0.140	0.006	0.140	0.035	0.140	0.030	0.140	5.543	5.614	0.672
94.30	9180			0.190	0.008	0.190	0.048	0.190	0.041	0.190	8.762	8.859	0.918
94.35	11668			0.240	0.009	0.240	0.060	0.240	0.051	0.240	12.438	12.559	1.167
94.40	14184			0.290	0.011	0.290	0.073	0.290	0.062	0.290	16.518	16.663	1.418
94.45	16731			0.340	0.012	0.340	0.085	0.340	0.071	0.340	20.966	21.133	1.673
94.50	19300			0.390	0.013	0.390	0.095	0.390	0.079	0.390	25.753	25.940	1.930

Notes :
 - PP Elev indicates the elevation of the permanent pool. Volume below the elevation of the 100-year spring flood level treated as dead storage.
 - QC Elev indicates the elevation of the storage volume required by MOE for quality control.
 - Ext. Det. indicates the elevation of extended detention provided above the 100-year summer flood level at the pond outfall.

CALCULATION SHEET B-1: CONTROLS

Baseflow Control 1			Quality Control 1			Erosion Control 1			Quantity Control 1		
Vertical Circular Orifice			Vertical Circular Orifice			Vertical Circular Orifice			Rectangular Weir		
Diameter	(m)	0.100	Diameter	(m)	0.300	Diameter	(m)	0.270	L	(m)	67.000
A_o	(m ²)	0.008	A_o	(m ²)	0.071	A_o	(m ²)	0.057	C_w		1.58
invert	(m)	92.10	invert	(m)	92.35	Invert	(m)	92.65	Invert	(m)	93.680
C_o		0.62	C_o		0.62	C_o		0.62	n		2
100yr Water Level	(m)	93.827	100yr Water Level	(m)	93.827	100yr Water Level	(m)	93.827	Max Water Level	(m)	93.828
Head of Water	(m)	1.727	Head of Water	(m)	1.477	Head of Water	(m)	1.177	Head of Water	(m)	0.148
Q_o	(m ³ /s)	0.028	Q_o	(m ³ /s)	0.224	Q_o	(m ³ /s)	0.160	Q_w (100% Blockage)	(m ³ /s)	6.019
Orifice Equation: $Q_o = C_o A_o (2gh)^{0.5}$ Not including reverse pipe losses Q_o is the orifice flow C_o is the orifice coefficient A_o is the orifice flow area g is the gravitational constant h is the head of water			Orifice Equation: $Q_o = C_o A_o (2gh)^{0.5}$ Not including reverse pipe losses Q_o is the orifice flow C_o is the orifice coefficient A_o is the orifice flow area g is the gravitational constant h is the head of water			Orifice Equation: $Q_o = C_o A_o (2gh)^{0.5}$ Q_o is the orifice flow C_o is the orifice coefficient A_o is the orifice flow area g is the gravitational constant h is the head of water			Weir Equation: $Q_w = C_w (L - 0.1nh) h^{1.5}$ Q_w is the weir flow C_w is the weir coefficient L is the weir length h is the weir height n is the # of side contractions		
						Spillway Velocity - Minimum Slope			Spillway Velocity - Maximum Slope		
						Restangular Channel Equation: $Q = 1/n \times AR^{2/3} S^{1/2}$			Restangular Channel Equation: $Q = 1/n \times AR^{2/3} S^{1/2}$		
						normal depth	(m)	0.179	normal depth	(m)	0.051
						n (roughness coef.)		0.03	n (roughness coef.)		0.03
						W (width)	(m)	45.000	W (width)	(m)	45.000
						A (area of flow)	(m ²)	8.071	A (area of flow)	(m ²)	2.285
						p (wetted perimeter)	(m)	45.359	p (wetted perimeter)	(m)	45.102
						R (hydraulic radius)	(m)	0.178	R (hydraulic radius)	(m)	0.051
						S (assumed slope)	(m/m)	0.005	S (assumed slope)	(m/m)	0.333
						Q (flow)	(m ³ /s)	6.019	Q (flow)	(m ³ /s)	6.019
						v (velocity)	(m/s)	0.75	v (velocity)	(m/s)	2.63

CALCULATION SHEET B-2: FOREBAY SIZING FOR SWM FACILITY

WESTERN DEVELOPMENT LANDS - RICHMOND

SWM Pond 1

City of Ottawa

Calculation of Forebay Size

South Forebay

© DSEL

Settling Criteria

From the SWMP Manual, the required length for settling is as follows:

$$L_{\min} = \left(\frac{r Q_p}{V_s} \right)^{0.5} \quad \text{where:} \quad \begin{array}{l} r = \text{length to width ratio, at the invert of the inlet pipe.} \\ Q_p = \text{peak outflow during design quality storm} \\ V_s = \text{settling velocity} \end{array}$$

$$\begin{array}{l} \text{Input:} \quad r = \quad 3.07 \quad (83 \text{ m} / 27 \text{ m}) \\ \quad \quad \quad Q_p = \quad 0.387 \text{ m}^3/\text{s} \quad (\text{at elevation } 93.68 \text{ m}) \\ \quad \quad \quad V_s = \quad 0.0003 \text{ m/s} \end{array}$$

$$L_{\min} = 62.95 \text{ m}$$

The peak flow rate from the pond during the quality storm is taken as the flow that would occur just below the quantity controls (Refer to Table B-5 of Appendix B)

Dispersion Criteria

From the SWMP Manual, the required length for dispersion is as follows:

$$L_{\min} = \frac{8Q}{d V_f} \quad \text{where:} \quad \begin{array}{l} Q = \text{Inlet flowrate (10-Year, 24-Hour SCS Storm)} \\ d = \text{depth of permanent pool (forebay)} \\ V_f = \text{desired final velocity} \end{array}$$

$$\begin{array}{l} \text{Input:} \quad Q = \quad 7.762 \text{ m}^3/\text{s} \\ \quad \quad \quad d = \quad 2.0 \text{ m} \\ \quad \quad \quad V_f = \quad 0.5 \text{ m/s} \end{array}$$

$$L_{\min} = 62.09 \text{ m}$$

The minimum forebay length is determined by the larger of the settling or dispersion criteria.

Minimum Length of Forebay Required	62.95 m	
Length of Forebay Provided	83.00 m	(at elevation 92.35 m)

Average Forebay Velocity

From the SWMP Manual, the maximum allowable average velocity is 0.15 m/s:

$$V_{\text{avg}} = \frac{Q}{d W_{\text{avg}}} \quad \text{where:} \quad \begin{array}{l} Q = \text{Inlet flowrate (10-Year, 24-Hour SCS Storm)} \\ d = \text{depth of pond during peak 10-year inflow (12h:00min)} \\ W_{\text{avg}} = \text{average width of forebay} \end{array}$$

$$\begin{array}{l} \text{Input:} \quad Q = \quad 7.762 \text{ m}^3/\text{s} \\ \quad \quad \quad d = \quad 2.58 \text{ m} \\ \quad \quad \quad W_{\text{avg}} = \quad 21 \text{ m} \quad (15 \text{ m bottom, } 27 \text{ m permanent pool}) \end{array}$$

$$V = 0.14 \text{ m/s} < 0.15 \text{ m/s}$$

CALCULATION SHEET B-3: FOREBAY SIZING FOR SWM FACILITY

WESTERN DEVELOPMENT LANDS - RICHMOND

SWM Pond 1

City of Ottawa

Calculation of Forebay Size

West Forebay

© DSEL

Settling Criteria

From the SWMP Manual, the required length for settling is as follows:

$$L_{\min} = \left(\frac{r Q_p}{V_s} \right)^{0.5} \quad \text{where:} \quad \begin{array}{l} r = \text{length to width ratio, at the invert of the inlet pipe.} \\ Q_p = \text{peak outflow during design quality storm} \\ V_s = \text{settling velocity} \end{array}$$

$$\begin{array}{l} \text{Input:} \quad r = \quad 2.39 \quad (67 \text{ m} / 28 \text{ m}) \\ \quad \quad \quad Q_p = \quad 0.387 \text{ m}^3/\text{s} \quad (\text{at elevation } 93.68 \text{ m}) \\ \quad \quad \quad V_s = \quad 0.0003 \text{ m/s} \end{array}$$

$$L_{\min} = 55.54 \text{ m}$$

The peak flow rate from the pond during the quality storm is taken as the flow that would occur just below the quantity controls (Refer to Table B-5 of Appendix B)

Dispersion Criteria

From the SWMP Manual, the required length for dispersion is as follows:

$$L_{\min} = \frac{8Q}{d V_f} \quad \text{where:} \quad \begin{array}{l} Q = \text{Inlet flowrate (10-Year, 24-Hour SCS Storm)} \\ d = \text{depth of permanent pool (forebay)} \\ V_f = \text{desired final velocity} \end{array}$$

$$\begin{array}{l} \text{Input:} \quad Q = \quad 1.094 \text{ m}^3/\text{s} \\ \quad \quad \quad d = \quad 2.0 \text{ m} \\ \quad \quad \quad V_f = \quad 0.5 \text{ m/s} \end{array}$$

$$L_{\min} = 8.75 \text{ m}$$

The minimum forebay length is determined by the larger of the settling or dispersion criteria.

Minimum Length of Forebay Required	55.54 m	
Length of Forebay Provided	67.00 m	(at elevation 92.35 m)

Average Forebay Velocity

From the SWMP Manual, the maximum allowable average velocity is 0.15 m/s:

$$V_{\text{avg}} = \frac{Q}{d W_{\text{avg}}} \quad \text{where:} \quad \begin{array}{l} Q = \text{Inlet flowrate (10-Year, 24-Hour SCS Storm)} \\ d = \text{depth of pond during peak 10-year inflow (12h:00min)} \\ W_{\text{avg}} = \text{average width of forebay} \end{array}$$

$$\begin{array}{l} \text{Input:} \quad Q = \quad 1.094 \text{ m}^3/\text{s} \\ \quad \quad \quad d = \quad 2.58 \text{ m} \\ \quad \quad \quad W_{\text{avg}} = \quad 22 \text{ m} \quad (16 \text{ m bottom, } 28 \text{ m permanent pool}) \end{array}$$

$$V = 0.02 \text{ m/s} < 0.15 \text{ m/s}$$

CALCULATION SHEET B-4: FOREBAY SIZING FOR SWM FACILITY

WESTERN DEVELOPMENT LANDS - RICHMOND

SWM Pond 1

City of Ottawa

Calculation of Forebay Size

North Forebay

© DSEL

Settling Criteria

From the SWMP Manual, the required length for settling is as follows:

$$L_{\min} = \left(\frac{r Q_p}{V_s} \right)^{0.5}$$

where: r = length to width ratio, at the invert of the inlet pipe.
 Q_p = peak outflow during design quality storm
 V_s = settling velocity

Input: $r = 3.04$ (85 m / 28 m)
 $Q_p = 0.387 \text{ m}^3/\text{s}$ (at elevation 93.68 m)
 $V_s = 0.0003 \text{ m/s}$

$$L_{\min} = 62.56 \text{ m}$$

The peak flow rate from the pond during the quality storm is taken as the flow that would occur just below the quantity controls (Refer to Table B-5 of Appendix B)

Dispersion Criteria

From the SWMP Manual, the required length for dispersion is as follows:

$$L_{\min} = \frac{8Q}{d V_f}$$

where: Q = Inlet flowrate (10-Year, 24-Hour SCS Storm)
 d = depth of permanent pool (forebay)
 V_f = desired final velocity

Input: $Q = 5.071 \text{ m}^3/\text{s}$
 $d = 2.0 \text{ m}$
 $V_f = 0.5 \text{ m/s}$

$$L_{\min} = 40.57 \text{ m}$$

The minimum forebay length is determined by the larger of the settling or dispersion criteria.

Minimum Length of Forebay Required **62.56 m**
Length of Forebay Provided **85.00 m** (at elevation 92.35 m)

Average Forebay Velocity

From the SWMP Manual, the maximum allowable average velocity is 0.15 m/s:

$$V_{\text{avg}} = \frac{Q}{d W_{\text{avg}}}$$

where: Q = Inlet flowrate (10-Year, 24-Hour SCS Storm)
 d = depth of pond during peak 10-year inflow (12h:00min)
 W_{avg} = average width of forebay

Input: $Q = 5.071 \text{ m}^3/\text{s}$
 $d = 2.58 \text{ m}$
 $W_{\text{avg}} = 22 \text{ m}$ (16 m bottom, 28 m permanent pool)

$$V = 0.09 \text{ m/s} < 0.15 \text{ m/s}$$

Date: Feb 2021
 File: 15-764BB


WESTERN DEVELOPMENT LANDS - RICHMOND
City of Ottawa
SWM Pond 1
North Sediment Drying Area

As per Table 6.3 in the MOE SWMP Manual, the annual sediment loading for this catchments will be 0.60 m³/ha

Table 6.3 Annual Sediment Loadings			
Catchment Imperviousness	Annual Loading (kg/ha)	Wet Density (kg/m ³)	Annual Loading (m ³ /ha)
35%	770	1230	0.6
55%	2300	1230	1.9
70%	3495	1230	2.8
85%	4680	1230	3.8

Interpolate for Catchment Imperviousness of 22% - Annual Loading = 0.60 m³/ha
 Total Drainage Area = 140.386 ha

Sediment Drying Volume = min 10 yrs accumulation x annual loading x drainage area
Sediment Drying Volume = (10)*(0.6)*(140.386)
= 842 m³

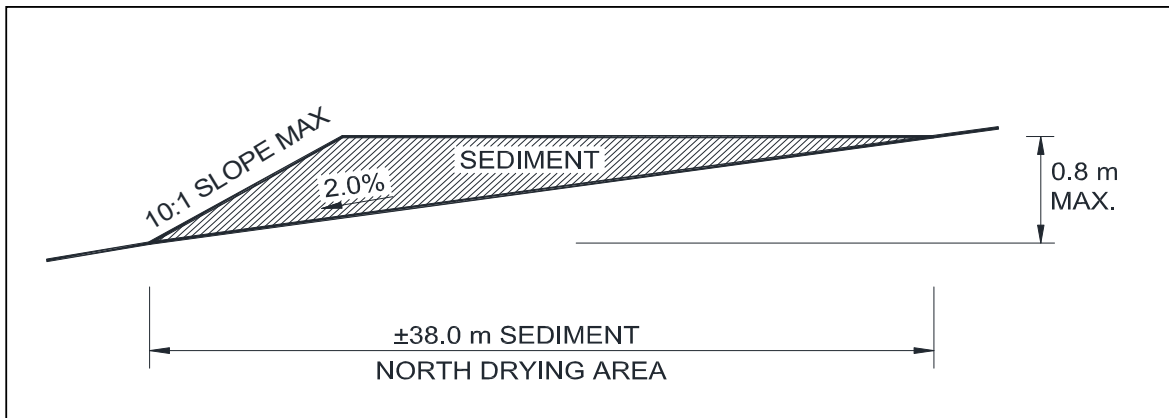

Provided Sediment Drying Area Capacity = 1155 m³

BaseArea= 3800 m²

Date: Feb 2021
 File: 15-764BB


WESTERN DEVELOPMENT LANDS - RICHMOND
City of Ottawa
SWM Pond 1
West Sediment Drying Area

As per Table 6.3 in the MOE SWMP Manual, the annual sediment loading for this catchments will be 1.71 m³/ha

Table 6.3 Annual Sediment Loadings			
Catchment Imperviousness	Annual Loading (kg/ha)	Wet Density (kg/m ³)	Annual Loading (m ³ /ha)
35%	770	1230	0.6
55%	2300	1230	1.9
70%	3495	1230	2.8
85%	4680	1230	3.8

Interpolate for Catchment Imperviousness of 52% - Annual Loading = 1.71 m³/ha
 Total Drainage Area = 7.701 ha

Sediment Drying Volume = min10 yrs accumulation x annual loading x drainage area
Sediment Drying Volume = (10)*(1.71)*(7.701)
= 132 m³

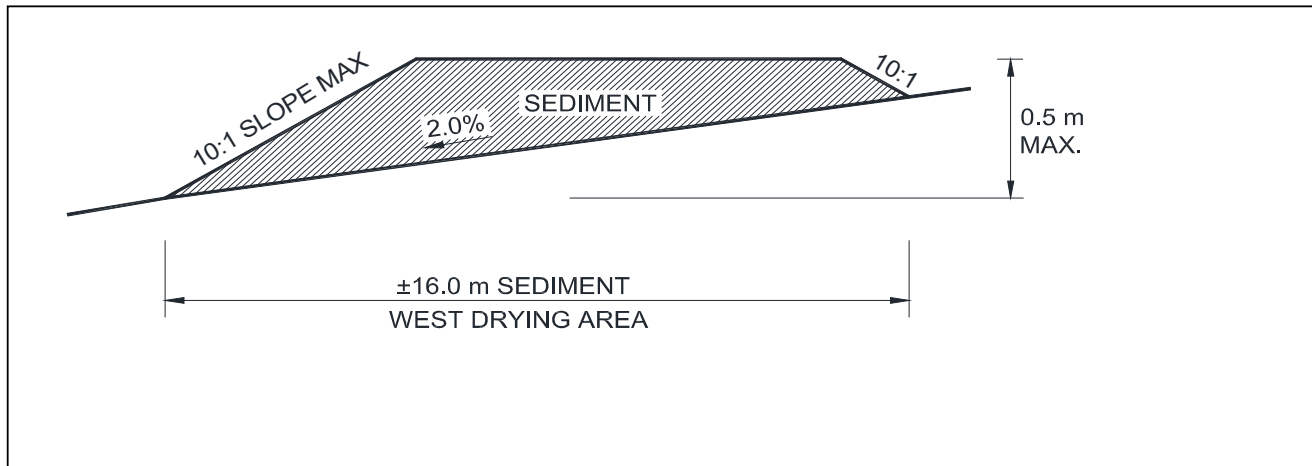

Provided Sediment Drying Area Capacity = 177 m³

BaseArea= 704 m²

Date: Feb 2021
 File: 15-764BB


WESTERN DEVELOPMENT LANDS - RICHMOND
City of Ottawa
SWM Pond 1
South Sediment Drying Area

As per Table 6.3 in the MOE SWMP Manual, the annual sediment loading for this catchments will be 2.32 m³/ha

Table 6.3 Annual Sediment Loadings			
Catchment Imperviousness	Annual Loading (kg/ha)	Wet Density (kg/m ³)	Annual Loading (m ³ /ha)
35%	770	1230	0.6
55%	2300	1230	1.9
70%	3495	1230	2.8
85%	4680	1230	3.8

Interpolate for Catchment Imperviousness of 62% - Annual Loading = 2.32 m³/ha
 Total Drainage Area = 51.636 ha



Sediment Drying Volume = min 10 yrs accumulation x annual loading x drainage area
Sediment Drying Volume = (10)*(2.32)*(51.636)
= 1198 m³

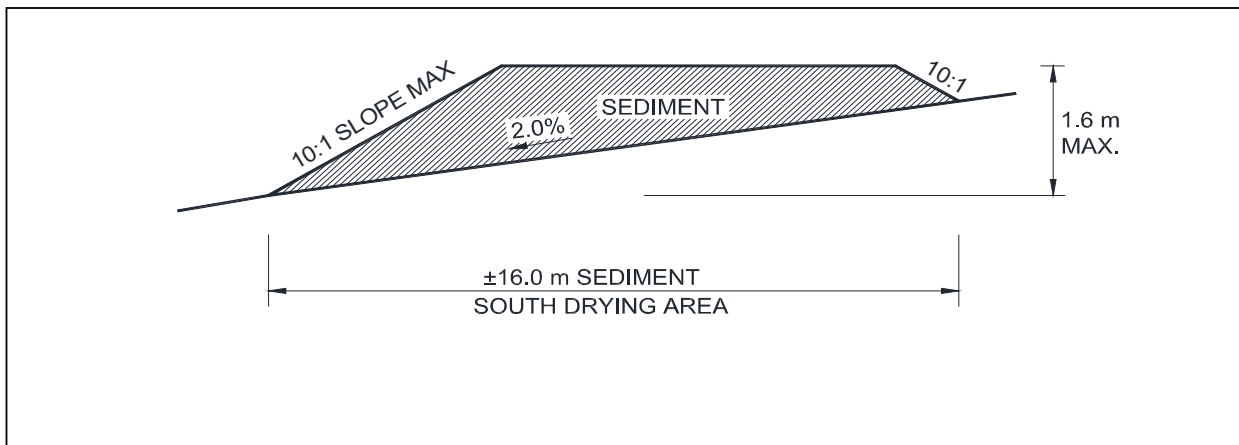

Provided Sediment Drying Area Capacity = 628 m³

BaseArea= 960 m²


APPENDIX F

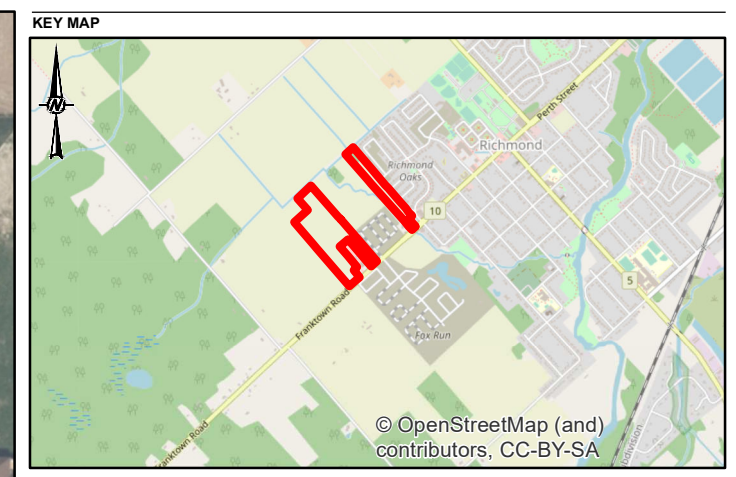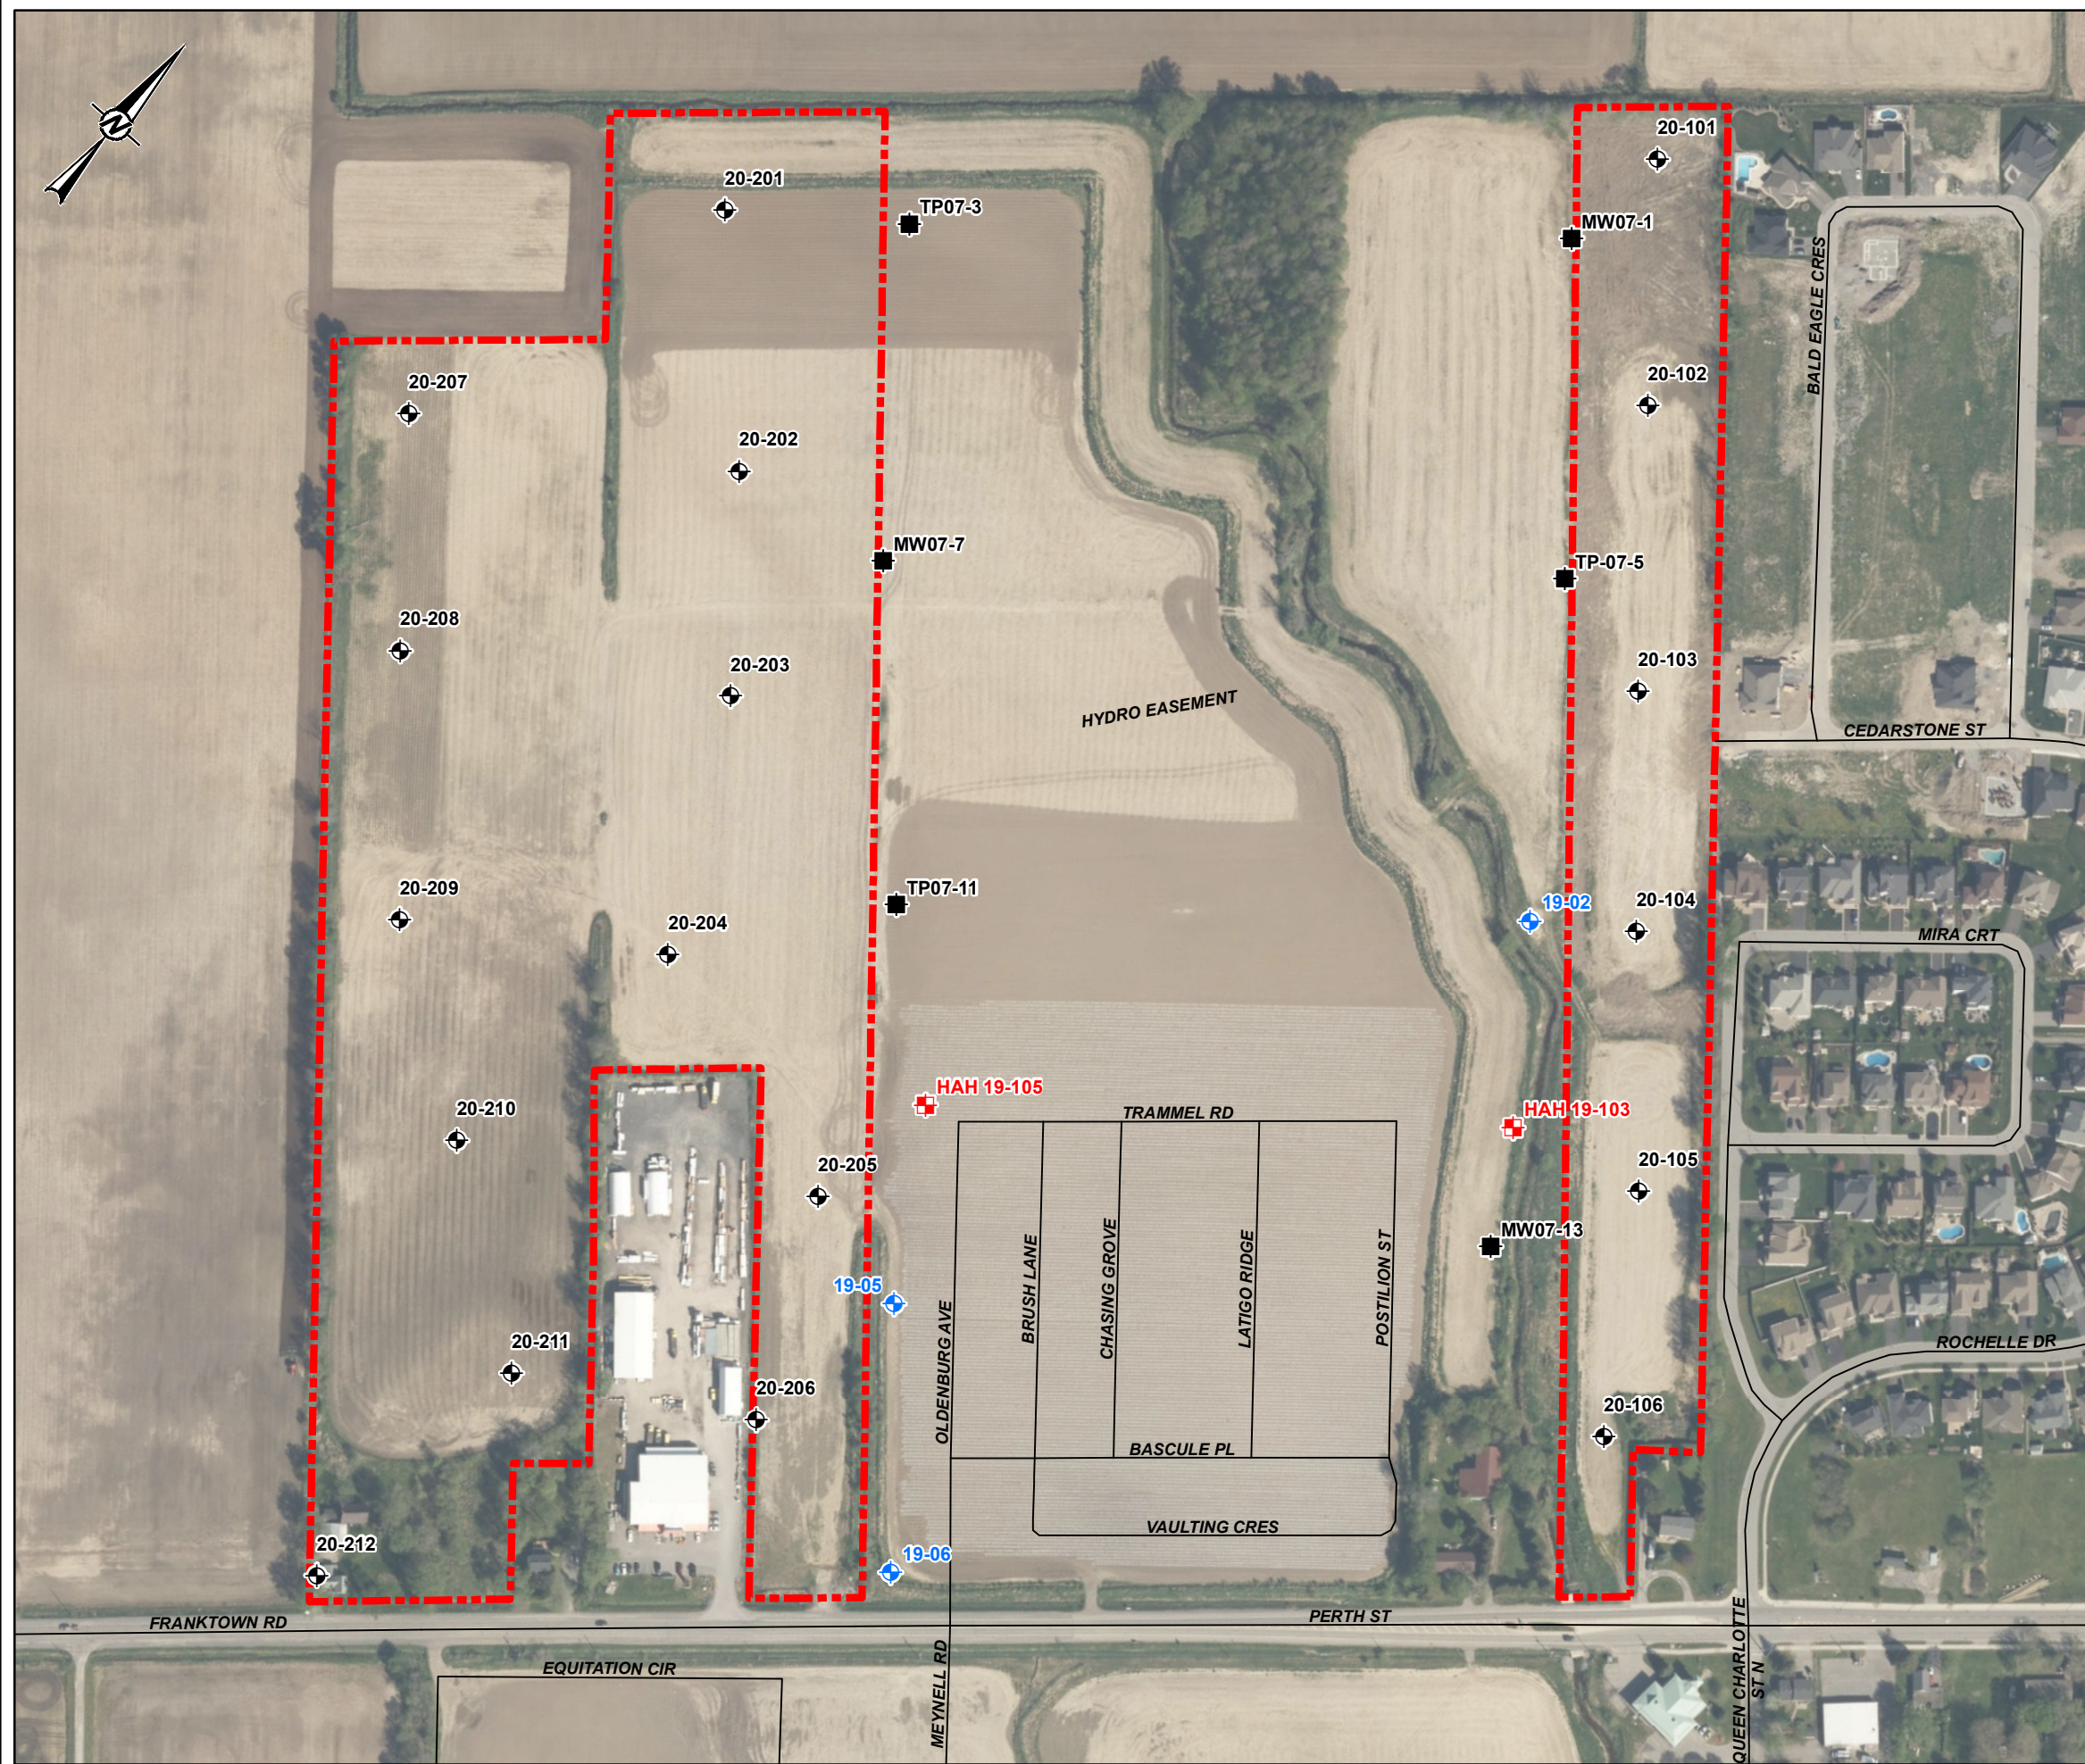

- LEGEND**
- PROPOSED BOREHOLE LOCATION
 - APPROXIMATE HAND AUGERHOLE LOCATION, PREVIOUS INVESTIGATION
 - APPROXIMATE BOREHOLE LOCATION, PREVIOUS INVESTIGATION
 - APPROXIMATE TESTHOLE LOCATION, PREVIOUS INVESTIGATION BY JACQUES WHITFORD, JUNE 2007
 - ROADWAY
 - APPROXIMATE SITE BOUNDARY

NOTE(S)
1. ALL LOCATIONS ARE APPROXIMATE

REFERENCE(S)
1. PROJECTION: TRANSVERSE MERCATOR, DATUM: NAD 83, COORDINATE SYSTEM: MTM ZONE 9, VERTICAL DATUM: CGVD28



CLIENT CAIVAN (RICHMOND NORTH) LIMITED		
PROJECT PRELIMINARY GEOTECHNICAL REPORT GREEN LANDS EAST AND GREEN LANDS WEST		
TITLE SITE PLAN		
CONSULTANT	YYYY-MM-DD	2020-06-29
	DESIGNED	---
	PREPARED	JEM
	REVIEWED	KCP
	APPROVED	WC
PROJECT NO. 20144864	CONTROL 0005	REV. 0
		FIGURE 1

Path: N:\Projects\Spatial_Maps\Richmond\Reports\SMR\190_FR03_20144864_Caivan_Emergency_Geotech_Memo_GreenEYS0144864-0005-BC-0001.mxd

IF THIS MEASUREMENT DOES NOT MATCH WHAT IS SHOWN, THE SHEET SIZE HAS BEEN MODIFIED FROM: 28mm

APPENDIX A

Record of Previous Investigations

DRAFT

LITHOLOGICAL AND GEOTECHNICAL ROCK DESCRIPTION TERMINOLOGY

WEATHERINGS STATE

Fresh: no visible sign of rock material weathering.

Faintly weathered: weathering limited to the surface of major discontinuities.

Slightly weathered: penetrative weathering developed on open discontinuity surfaces but only slight weathering of rock material.

Moderately weathered: weathering extends throughout the rock mass but the rock material is not friable.

Highly weathered: weathering extends throughout rock mass and the rock material is partly friable.

Completely weathered: rock is wholly decomposed and in a friable condition but the rock and structure are preserved.

BEDDING THICKNESS

<u>Description</u>	<u>Bedding Plane Spacing</u>
Very thickly bedded	Greater than 2 m
Thickly bedded	0.6 m to 2 m
Medium bedded	0.2 m to 0.6 m
Thinly bedded	60 mm to 0.2 m
Very thinly bedded	20 mm to 60 mm
Laminated	6 mm to 20 mm
Thinly laminated	Less than 6 mm

JOINT OR FOLIATION SPACING

<u>Description</u>	<u>Spacing</u>
Very wide	Greater than 3 m
Wide	1 m to 3 m
Moderately close	0.3 m to 1 m
Close	50 mm to 300 mm
Very close	Less than 50 mm

GRAIN SIZE

<u>Term</u>	<u>Size*</u>
Very Coarse Grained	Greater than 60 mm
Coarse Grained	2 mm to 60 mm
Medium Grained	60 microns to 2 mm
Fine Grained	2 microns to 60 microns
Very Fine Grained	Less than 2 microns

Note: * Grains greater than 60 microns diameter are visible to the naked eye.

CORE CONDITION

Total Core Recovery (TCR)

The percentage of solid drill core recovered regardless of quality or length, measured relative to the length of the total core run.

Solid Core Recovery (SCR)

The percentage of solid drill core, regardless of length, recovered at full diameter, measured relative to the length of the total core run.

Rock Quality Designation (RQD)

The percentage of solid drill core, greater than 100 mm length, as measured along the centerline axis of the core, relative to the length of the total core run. RQD varies from 0% for completely broken core to 100% for core in solid segments.

DISCONTINUITY DATA

Fracture Index

A count of the number of naturally occurring discontinuities (physical separations) in the rock core. Mechanically induced breaks caused by drilling are not included.

Dip with Respect to Core Axis

The angle of the discontinuity relative to the axis (length) of the core. In a vertical borehole a discontinuity with a 90° angle is horizontal.

Description and Notes

An abbreviation description of the discontinuities, whether naturally occurring separations such as fractures, bedding planes and foliation planes and mechanically separated bedding or foliation surfaces. Additional information concerning the nature of fracture surfaces and infillings are also noted.


Abbreviations

JN Joint	PL Planar
FLT Fault	CU Curved
SH Shear	UN Undulating
VN Vein	IR Irregular
FR Fracture	K Slickensided
SY Stylolite	PO Polished
BD Bedding	SM Smooth
FO Foliation	SR Slightly Rough
CO Contact	RO Rough
AXJ Axial Joint	VR Very Rough
KV Karstic Void	
MB Mechanical Break	

METHOD OF SOIL CLASSIFICATION

The Golder Associates Ltd. Soil Classification System is based on the Unified Soil Classification System (USCS)

Organic or Inorganic	Soil Group	Type of Soil	Gradation or Plasticity	$Cu = \frac{D_{60}}{D_{10}}$	$Cc = \frac{(D_{30})^2}{D_{10} \times D_{60}}$	Organic Content	USCS Group Symbol	Group Name					
INORGANIC (Organic Content ≤30% by mass)	COARSE-GRAINED SOILS (>50% by mass is larger than 0.075 mm)	GRAVELS (>50% by mass of coarse fraction is larger than 4.75 mm)	Poorly Graded	<4	≤1 or ≥3		≤30%	GP	GRAVEL				
			Well Graded	≥4	1 to 3			GW	GRAVEL				
			Below A Line	n/a		GM		SILTY GRAVEL					
			Above A Line	n/a		GC		CLAYEY GRAVEL					
		SANDS (≥50% by mass of coarse fraction is smaller than 4.75 mm)	Poorly Graded	<6	≤1 or ≥3			SP	SAND				
			Well Graded	≥6	1 to 3			SW	SAND				
			Below A Line	n/a		SM		SILTY SAND					
			Above A Line	n/a		SC		CLAYEY SAND					
			Laboratory Tests		Field Indicators					Organic Content	USCS Group Symbol	Primary Name	
					Dilatancy	Dry Strength		Shine Test	Thread Diameter				Toughness (of 3 mm thread)
INORGANIC (Organic Content ≤30% by mass)	FINE-GRAINED SOILS (≥50% by mass is smaller than 0.075 mm)	SILTS (Non-Plastic or PI and LL plot below A-Line on Plasticity Chart below)	Liquid Limit <50	Rapid	None	None	>6 mm	N/A (can't roll 3 mm thread)	<5%	ML	SILT		
				Slow	None to Low	Dull	3mm to 6 mm	None to low	<5%	ML	CLAYEY SILT		
			Liquid Limit ≥50	Slow to very slow	Low to medium	Dull to slight	3mm to 6 mm	Low	5% to 30%	OL	ORGANIC SILT		
				Slow to very slow	Low to medium	Slight	3mm to 6 mm	Low to medium	<5%	MH	CLAYEY SILT		
		CLAYS (PI and LL plot above A-Line on Plasticity Chart below)	Liquid Limit <30	None	Low to medium	Slight to shiny	~ 3 mm	Low to medium	0% to 30% (see Note 2)	CL	SILTY CLAY		
				None	Medium to high	Slight to shiny	1 mm to 3 mm	Medium		CI	SILTY CLAY		
				None	High	Shiny	<1 mm	High		CH	CLAY		
			Liquid Limit ≥30	None	Low to medium	Slight to shiny	~ 3 mm	Low to medium	0% to 30% (see Note 2)	CL	SILTY CLAY		
				None	Medium to high	Slight to shiny	1 mm to 3 mm	Medium		CI	SILTY CLAY		
				None	High	Shiny	<1 mm	High		CH	CLAY		
HIGHLY ORGANIC SOILS (Organic Content >30% by mass)	Peat and mineral soil mixtures						30% to 75%	PT	SILTY PEAT, SANDY PEAT				
	Predominantly peat, may contain some mineral soil, fibrous or amorphous peat						75% to 100%		PEAT				

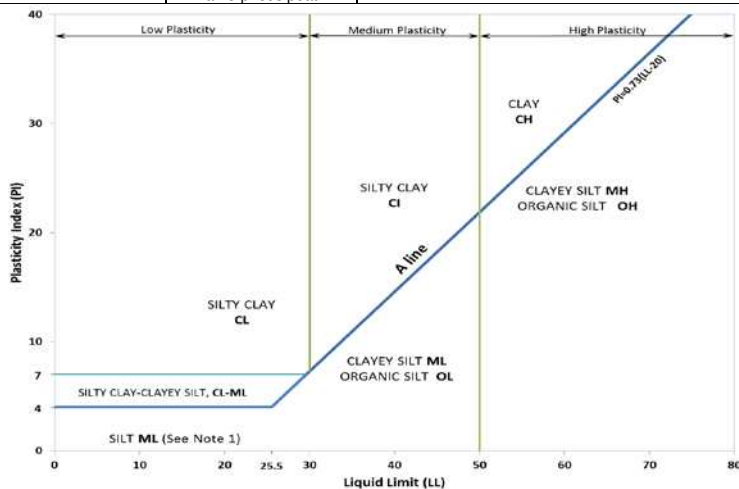

Note 1 – Fine grained materials with PI and LL that plot in this area are named (ML) SILT with slight plasticity. Fine-grained materials which are non-plastic (i.e. a PL cannot be measured) are named SILT.
Note 2 – For soils with <5% organic content, include the descriptor “trace organics” for soils with between 5% and 30% organic content include the prefix “organic” before the Primary name.

Dual Symbol — A dual symbol is two symbols separated by a hyphen, for example, GP-GM, SW-SC and CL-ML. For non-cohesive soils, the dual symbols must be used when the soil has between 5% and 12% fines (i.e. to identify transitional material between “clean” and “dirty” sand or gravel. For cohesive soils, the dual symbol must be used when the liquid limit and plasticity index values plot in the CL-ML area of the plasticity chart (see Plasticity Chart at left).

Borderline Symbol — A borderline symbol is two symbols separated by a slash, for example, CL/CI, GM/SM, CL/ML. A borderline symbol should be used to indicate that the soil has been identified as having properties that are on the transition between similar materials. In addition, a borderline symbol may be used to indicate a range of similar soil types within a stratum.

ABBREVIATIONS AND TERMS USED ON RECORDS OF BOREHOLES AND TEST PITS

PARTICLE SIZES OF CONSTITUENTS

Soil Constituent	Particle Size Description	Millimetres	Inches (US Std. Sieve Size)
BOULDERS	Not Applicable	>300	>12
COBBLES	Not Applicable	75 to 300	3 to 12
GRAVEL	Coarse	19 to 75	0.75 to 3
	Fine	4.75 to 19	(4) to 0.75
SAND	Coarse	2.00 to 4.75	(10) to (4)
	Medium	0.425 to 2.00	(40) to (10)
	Fine	0.075 to 0.425	(200) to (40)
SILT/CLAY	Classified by plasticity	<0.075	< (200)

MODIFIERS FOR SECONDARY AND MINOR CONSTITUENTS

Percentage by Mass	Modifier
>35	Use 'and' to combine major constituents (i.e., SAND and GRAVEL)
> 12 to 35	Primary soil name prefixed with "gravelly, sandy, SILTY, CLAYEY" as applicable
> 5 to 12	some
≤ 5	trace

PENETRATION RESISTANCE

Standard Penetration Resistance (SPT), N:

The number of blows by a 63.5 kg (140 lb) hammer dropped 760 mm (30 in.) required to drive a 50 mm (2 in.) split-spoon sampler for a distance of 300 mm (12 in.). Values reported are as recorded in the field and are uncorrected.

Cone Penetration Test (CPT)

An electronic cone penetrometer with a 60° conical tip and a project end area of 10 cm² pushed through ground at a penetration rate of 2 cm/s. Measurements of tip resistance (q_t), porewater pressure (u) and sleeve frictions are recorded electronically at 25 mm penetration intervals.

Dynamic Cone Penetration Resistance (DCPT); N_d:

The number of blows by a 63.5 kg (140 lb) hammer dropped 760 mm (30 in.) to drive uncased a 50 mm (2 in.) diameter, 60° cone attached to "A" size drill rods for a distance of 300 mm (12 in.).

PH: Sampler advanced by hydraulic pressure

PM: Sampler advanced by manual pressure

WH: Sampler advanced by static weight of hammer

WR: Sampler advanced by weight of sampler and rod

SAMPLES

AS	Auger sample
BS	Block sample
CS	Chunk sample
DD	Diamond Drilling
DO or DP	Seamless open ended, driven or pushed tube sampler – note size
DS	Denison type sample
GS	Grab Sample
MC	Modified California Samples
MS	Modified Shelby (for frozen soil)
RC	Rock core
SC	Soil core
SS	Split spoon sampler – note size
ST	Slotted tube
TO	Thin-walled, open – note size (Shelby tube)
TP	Thin-walled, piston – note size (Shelby tube)
WS	Wash sample

SOIL TESTS

w	water content
PL , w _p	plastic limit
LL , w _L	liquid limit
C	consolidation (oedometer) test
CHEM	chemical analysis (refer to text)
CID	consolidated isotropically drained triaxial test ¹
CIU	consolidated isotropically undrained triaxial test with porewater pressure measurement ¹
D _R	relative density (specific gravity, G _s)
DS	direct shear test
GS	specific gravity
M	sieve analysis for particle size
MH	combined sieve and hydrometer (H) analysis
MPC	Modified Proctor compaction test
SPC	Standard Proctor compaction test
OC	organic content test
SO ₄	concentration of water-soluble sulphates
UC	unconfined compression test
UU	unconsolidated undrained triaxial test
V (FV)	field vane (LV-laboratory vane test)
γ	unit weight

1. Tests anisotropically consolidated prior to shear are shown as CAD, CAU.

NON-COHESIVE (COHESIONLESS) SOILS

Compactness²

Term	SPT 'N' (blows/0.3m) ¹
Very Loose	0 to 4
Loose	4 to 10
Compact	10 to 30
Dense	30 to 50
Very Dense	>50

1. SPT 'N' in accordance with ASTM D1586, uncorrected for the effects of overburden pressure.

2. Definition of compactness terms are based on SPT 'N' ranges as provided in Terzaghi, Peck and Mesri (1996). Many factors affect the recorded SPT 'N' value, including hammer efficiency (which may be greater than 60% in automatic trip hammers), overburden pressure, groundwater conditions, and grain size. As such, the recorded SPT 'N' value(s) should be considered only an approximate guide to the soil compactness. These factors need to be considered when evaluating the results, and the stated compactness terms should not be relied upon for design or construction.

Field Moisture Condition

Term	Description
Dry	Soil flows freely through fingers.
Moist	Soils are darker than in the dry condition and may feel cool.
Wet	As moist, but with free water forming on hands when handled.

COHESIVE SOILS

Consistency

Term	Undrained Shear Strength (kPa)	SPT 'N' ^{1,2} (blows/0.3m)
Very Soft	<12	0 to 2
Soft	12 to 25	2 to 4
Firm	25 to 50	4 to 8
Stiff	50 to 100	8 to 15
Very Stiff	100 to 200	15 to 30
Hard	>200	>30

1. SPT 'N' in accordance with ASTM D1586, uncorrected for overburden pressure effects; approximate only.

2. SPT 'N' values should be considered ONLY an approximate guide to consistency; for sensitive clays (e.g., Champlain Sea clays), the N-value approximation for consistency terms does NOT apply. Rely on direct measurement of undrained shear strength or other manual observations.

Water Content

Term	Description
w < PL	Material is estimated to be drier than the Plastic Limit.
w ~ PL	Material is estimated to be close to the Plastic Limit.
w > PL	Material is estimated to be wetter than the Plastic Limit.

LIST OF SYMBOLS

Unless otherwise stated, the symbols employed in the report are as follows:

I. GENERAL

π	3.1416
$\ln x$	natural logarithm of x
$\log_{10} x$	x or log x, logarithm of x to base 10
g	acceleration due to gravity
t	time

II. STRESS AND STRAIN

γ	shear strain
Δ	change in, e.g. in stress: $\Delta \sigma$
ε	linear strain
ε_v	volumetric strain
η	coefficient of viscosity
ν	Poisson's ratio
σ	total stress
σ'	effective stress ($\sigma' = \sigma - u$)
σ'_{vo}	initial effective overburden stress
$\sigma_1, \sigma_2, \sigma_3$	principal stress (major, intermediate, minor)
σ_{oct}	mean stress or octahedral stress $= (\sigma_1 + \sigma_2 + \sigma_3)/3$
τ	shear stress
u	porewater pressure
E	modulus of deformation
G	shear modulus of deformation
K	bulk modulus of compressibility

III. SOIL PROPERTIES

(a) Index Properties

$\rho(\gamma)$	bulk density (bulk unit weight)*
$\rho_d(\gamma_d)$	dry density (dry unit weight)
$\rho_w(\gamma_w)$	density (unit weight) of water
$\rho_s(\gamma_s)$	density (unit weight) of solid particles
γ'	unit weight of submerged soil ($\gamma' = \gamma - \gamma_w$)
D_R	relative density (specific gravity) of solid particles ($D_R = \rho_s / \rho_w$) (formerly G_s)
e	void ratio
n	porosity
S	degree of saturation

(a) Index Properties (continued)

w	water content
w_l or LL	liquid limit
w_p or PL	plastic limit
I_p or PI	plasticity index = $(w_l - w_p)$
NP	non-plastic
w_s	shrinkage limit
I_L	liquidity index = $(w - w_p) / I_p$
I_C	consistency index = $(w_l - w) / I_p$
e_{max}	void ratio in loosest state
e_{min}	void ratio in densest state
I_D	density index = $(e_{max} - e) / (e_{max} - e_{min})$ (formerly relative density)

(b) Hydraulic Properties

h	hydraulic head or potential
q	rate of flow
v	velocity of flow
i	hydraulic gradient
k	hydraulic conductivity (coefficient of permeability)
j	seepage force per unit volume

(c) Consolidation (one-dimensional)

C_c	compression index (normally consolidated range)
C_r	recompression index (over-consolidated range)
C_s	swelling index
C_α	secondary compression index
m_v	coefficient of volume change
C_v	coefficient of consolidation (vertical direction)
C_h	coefficient of consolidation (horizontal direction)
T_v	time factor (vertical direction)
U	degree of consolidation
σ'_p	pre-consolidation stress
OCR	over-consolidation ratio = σ'_p / σ'_{vo}

(d) Shear Strength

τ_p, τ_r	peak and residual shear strength
ϕ'	effective angle of internal friction
δ	angle of interface friction
μ	coefficient of friction = $\tan \delta$
c'	effective cohesion
c_u, s_u	undrained shear strength ($\phi = 0$ analysis)
p	mean total stress $(\sigma_1 + \sigma_3)/2$
p'	mean effective stress $(\sigma'_1 + \sigma'_3)/2$
q	$(\sigma_1 - \sigma_3)/2$ or $(\sigma'_1 - \sigma'_3)/2$
q_u	compressive strength $(\sigma_1 - \sigma_3)$
S_t	sensitivity

* Density symbol is ρ . Unit weight symbol is γ where $\gamma = \rho g$ (i.e. mass density multiplied by acceleration due to gravity)

Notes: 1
2

$$\tau = c' + \sigma' \tan \phi'$$

$$\text{shear strength} = (\text{compressive strength})/2$$

PROJECT: 1522173

RECORD OF BOREHOLE: 19-02

SHEET 1 OF 1

LOCATION: N 5005908.9 ; E 355900.6

BORING DATE: April 23, 2019

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT				
						20 40 60 80				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
						nat V. + Q - rem V. ⊕ U - ○				Wp ----- W ----- WI					
						20 40 60 80				20 40 60 80					
0		GROUND SURFACE		94.75											
		TOPSOIL- (ML) sandy SILT; dark brown		0.00	1	GRAB	-								
		(CL-ML) CLAYEY SILT to SILTY CLAY; grey brown, fissured, contains silty sand seams (WEATHERED CRUST); cohesive, w<PL, very stiff		0.25											
1				93.38	2	SS	6								Bentonite Seal
		(CI/CH) SILTY CLAY to CLAY; grey brown (WEATHERED CRUST); cohesive, w>PL, stiff		1.37											
2				91.70	3	SS	2								Silica Sand
		(CI/CH) SILTY CLAY to CLAY; grey; cohesive, w>PL, firm		3.05											
3				88.65	4	TP	PH								32 mm Diam. PVC #10 Slot Screen 'B'
				6.10											
4	Power Auger 200 mm Diam. (Hollow Stem)			88.35											
		(CI/CH-ML) SILTY CLAY to CLAYEY SILT; grey; cohesive, w>PL		6.40											
5				6.40	5	SS	WH								
		(ML) sandy SILT; grey; non-cohesive, wet, loose to very loose		6.40											
6				86.52											
				8.23											
7					6	SS	4								
8					7	SS	7								
9					8	SS	2								
10		End of Borehole													

MIS-BHS 001 1522173.GPJ GAL-MIS.GDT 19-6-12 SGL/JM


DEPTH SCALE

1 : 50



LOGGED: PAH

CHECKED: WAM



PROJECT: 1522173

RECORD OF BOREHOLE: 19-06

SHEET 1 OF 1

LOCATION: N 5005503.4 ;E 355883.6


BORING DATE: April 25, 2019

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								Cu, kPa		nat V. +	rem V. ⊕	Q - ●	U - ○	Wp			W
0		GROUND SURFACE		94.25													
		TOPSOIL - (CL) SILTY CLAY; dark brown		0.00	1	AS	-										
		(CI/CH) SILTY CLAY to CLAY; grey brown, contains silty sand seams (WEATHERED CRUST); cohesive, w>PL very stiff to stiff		94.03													
				0.22													
1					2	SS	7										
2					3	SS	5										
3	Power Auger 200 mm Diam. (Hollow Stem)			91.20													
		(CI/CH) SILTY CLAY to CLAY; grey; cohesive, w>PL, firm		3.05	4	SS	1										
4																	
5				89.68													
		(CI/CH-ML) SILTY CLAY, CLAYEY SILT and sandy SILT; grey, laminated; cohesive, w>PL, firm		4.57	5	TP	PH										
6		End of Borehole Auger Refusal		88.31													
				5.94													
7																	
8																	
9																	
10																	

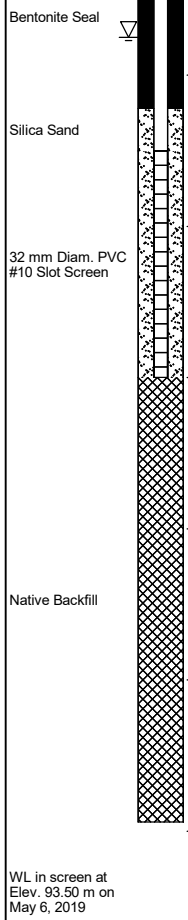

MIS-BHS 001 1522173.GPJ GAL-MIS.GDT 19-6-12 SGL/JM



TABLE 1
RECORD OF HAND AUGERHOLES

<u>Hand Augerhole Number</u>	<u>Depth (metres)</u>	<u>Description</u>	
19-103	0.0 – 0.3	TOPSOIL – (ML) CLAYEY SILT some sand; brown; non-cohesive, moist	
	0.3 – 0.5	(ML) CLAYEY SILT, some sand; brown (WEATHERED CRUST); cohesive, w>PL	
	0.5 – 1.9	(ML-CI/CH) CLAYEY SILT to SILTY CLAY, trace to some sand; grey brown (WEATHERED CRUST); cohesive, w>PL	
	1.9 – 2.5	(CI/CH) SILTY CLAY to CLAY trace sand; grey; cohesive, w>PL	
	2.50	END OF AUGERHOLE	
		Note: water seepage at 1.1 m depth upon completion	
	<u>Sample</u>	<u>Depth (m)</u>	<u>Lab Testing</u>
	1	1.1 – 1.5	w _n = 51%, PI=35%, LL=56%
	2	1.5 – 1.9	
	3	1.9 – 2.3	
	4	2.3 – 2.5	
19-105	0.00 – 0.20	TOPSOIL – (ML) CLAYEY SILT some sand; brown; non-cohesive, moist	
	0.20 – 1.60	(CI/CH-ML) SILTY CLAY to CLAYEY SILT, some sand; grey brown (WEATHERED CRUST); cohesive, w>PL	
	1.60 – 2.00	(CI/CH) SILTY CLAY to CLAY; grey brown (WEATHERED CRUST); cohesive, w>PL	
	2.00 – 2.50	(CI/CH) SILTY CLAY to CLAY; grey; cohesive, w>PL	
	2.50	END OF AUGERHOLE	
		Note: water seepage at 1.1 m depth upon completion	
	<u>Sample</u>	<u>Depth (m)</u>	<u>Lab Testing</u>
	1	0.7 – 1.1	w _n = 43%, PI=27%, LL=52%
	2	1.1 – 1.6	
	3	1.6 – 2.0	
	4	2.0 – 2.5	



MONITORING WELL RECORD

MW07-1

CLIENT Mattamy Homes BOREHOLE No. MW07-1
 LOCATION Proposed Subdivision, Richmond, ON PROJECT No. 1026929
 DATES: BORING June 18, 2007 WATER LEVEL June 20, 2007 DATUM Local

DEPTH (m)	ELEVATION (m)	SOIL DESCRIPTION	STRATA PLOT	WATER LEVEL	SAMPLES				UNDRAINED SHEAR STRENGTH - kPa													
					TYPE	NUMBER	RECOVERY (mm)	N-VALUE OR RQD	WATER CONTENT & ATTERBERG LIMITS													
					50 100 150 200 W _p W W _L * DYNAMIC PENETRATION TEST, BLOWS/0.3m STANDARD PENETRATION TEST, BLOWS/0.3m 10 20 30 40 50 60 70 80 90																	
0	100.32	150 mm TOPSOIL																				
	100.2	Firm to stiff, greyish brown lean CLAY (CL)			SS	1	300	4														
1					SS	2	610	5														
2					SS	3	610	6														
3	97.3	Firm to stiff, grey lean CLAY			SS	4	610	3														
4																						
5					ST	5	610															
6																						
7	93.8	Very loose, grey SANDY SILT (ML)			SS	6	610	2														
	93.6	End of Borehole																				
		Monitoring Well Installed																				
8																						
9																						
10																						

JWL-OLD 1026929.GPJ SMART.GDT 07/06/22

∇ Inferred Groundwater Level
 ▼ Groundwater Level Measured in Standpipe

■ Field Vane Test, kPa
 □ Remoulded Vane Test, kPa App'd _____
 △ Pocket Penetrometer Test, kPa Date _____



MONITORING WELL RECORD

MW07-7

CLIENT Mattamy Homes BOREHOLE No. MW07-7
 LOCATION Proposed Subdivision, Richmond, ON PROJECT No. 1026929
 DATES: BORING June 18, 2007 WATER LEVEL June 20, 2007 DATUM Local

DEPTH (m)	ELEVATION (m)	SOIL DESCRIPTION	STRATA PLOT	WATER LEVEL	SAMPLES				UNDRAINED SHEAR STRENGTH - kPa																		
					TYPE	NUMBER	RECOVERY (mm)	N-VALUE OR RQD	WATER CONTENT & ATTERBERG LIMITS																		
0	100.21	Firm to stiff, greyish brown lean CLAY (CL)																									
1					SS 1	1	610	4																			
2					SS 2	2	610	4																			
3	97.2				Firm to stiff, grey lean CLAY			SS 3	3	610	3																
4																											
5		Loose, grey SANDY SILT (ML)			SS 4	4	610	2																			
6	93.8																										
7	93.5	End of Borehole																									
7		Monitoring Well Installed																									
8																											
9																											
10																											

JWL-OLD 1026929.GPJ SMART.GDT 07/06/22

∇ Inferred Groundwater Level
 ▾ Groundwater Level Measured in Standpipe

■ Field Vane Test, kPa
 □ Remoulded Vane Test, kPa App'd _____
 △ Pocket Penetrometer Test, kPa Date _____



MONITORING WELL RECORD

MW07-13

CLIENT Mattamy Homes BOREHOLE No. MW07-13
 LOCATION Proposed Subdivision, Richmond, ON PROJECT No. 1026929
 DATES: BORING June 18, 2007 WATER LEVEL June 20, 2007 DATUM Local

DEPTH (m)	ELEVATION (m)	SOIL DESCRIPTION	STRATA PLOT	WATER LEVEL	SAMPLES				UNDRAINED SHEAR STRENGTH - kPa									
					TYPE	NUMBER	RECOVERY (mm)	N-VALUE OR RQD	WATER CONTENT & ATTERBERG LIMITS DYNAMIC PENETRATION TEST, BLOWS/0.3m STANDARD PENETRATION TEST, BLOWS/0.3m									
					50 100 150 200													
					10 20 30 40 50 60 70 80 90													
0	99.30	Stiff, greyish brown lean CLAY (CL)			SS	1	120	8										
1					SS	2	75	7										
2					SS	3	610	6										
3	96.3	Firm to stiff, grey lean CLAY			SS	4	40	4										
4					ST	5	610											
6	93.2	Very loose, grey SANDY SILT (ML)			SS	6	300	1										
7	92.6				End of Borehole Monitoring Well Installed													
8																		
9																		
10																		

JWL-OLD 1026929.GPJ SMART_GDT 07/06/22

Inferred Groundwater Level
 Groundwater Level Measured in Standpipe

Field Vane Test, kPa
 Remoulded Vane Test, kPa App'd _____
 Pocket Penetrometer Test, kPa Date _____



TEST PIT RECORD

TP07-5


CLIENT Mattamy Homes BOREHOLE No. TP07-5
 LOCATION Proposed Subdivision, Richmond, ON PROJECT No. 1026929
 DATES: BORING June 16, 2007 WATER LEVEL _____ DATUM Local

DEPTH (m)	ELEVATION (m)	SOIL DESCRIPTION	STRATA PLOT	WATER LEVEL	SAMPLES				UNDRAINED SHEAR STRENGTH - kPa													
					TYPE	NUMBER	RECOVERY (mm)	N-VALUE OR RQD	WATER CONTENT & ATTERBERG LIMITS w_p w w_L DYNAMIC PENETRATION TEST, BLOWS/0.3m * STANDARD PENETRATION TEST, BLOWS/0.3m •													
									50	100	150	200	10	20	30	40	50	60	70	80	90	
0	100.11	250 mm TOPSOIL			BS	1																
	99.9	Stiff, greyish brown lean CLAY (CL)																				
1					BS	2																
2	98.1	Firm, grey lean CLAY (CL)			BS	3																
					BS	4																
3					BS	5																
4	95.9	End of Borehole			BS	6																
5																						
6																						

JWL-OLD 1026929.GPJ SMART.GDT 07/06/21

▽ Inferred Groundwater Level
 ▼ Groundwater Level Measured in Standpipe

■ Field Vane Test, kPa
 □ Remoulded Vane Test, kPa App'd _____
 △ Pocket Penetrometer Test, kPa Date _____

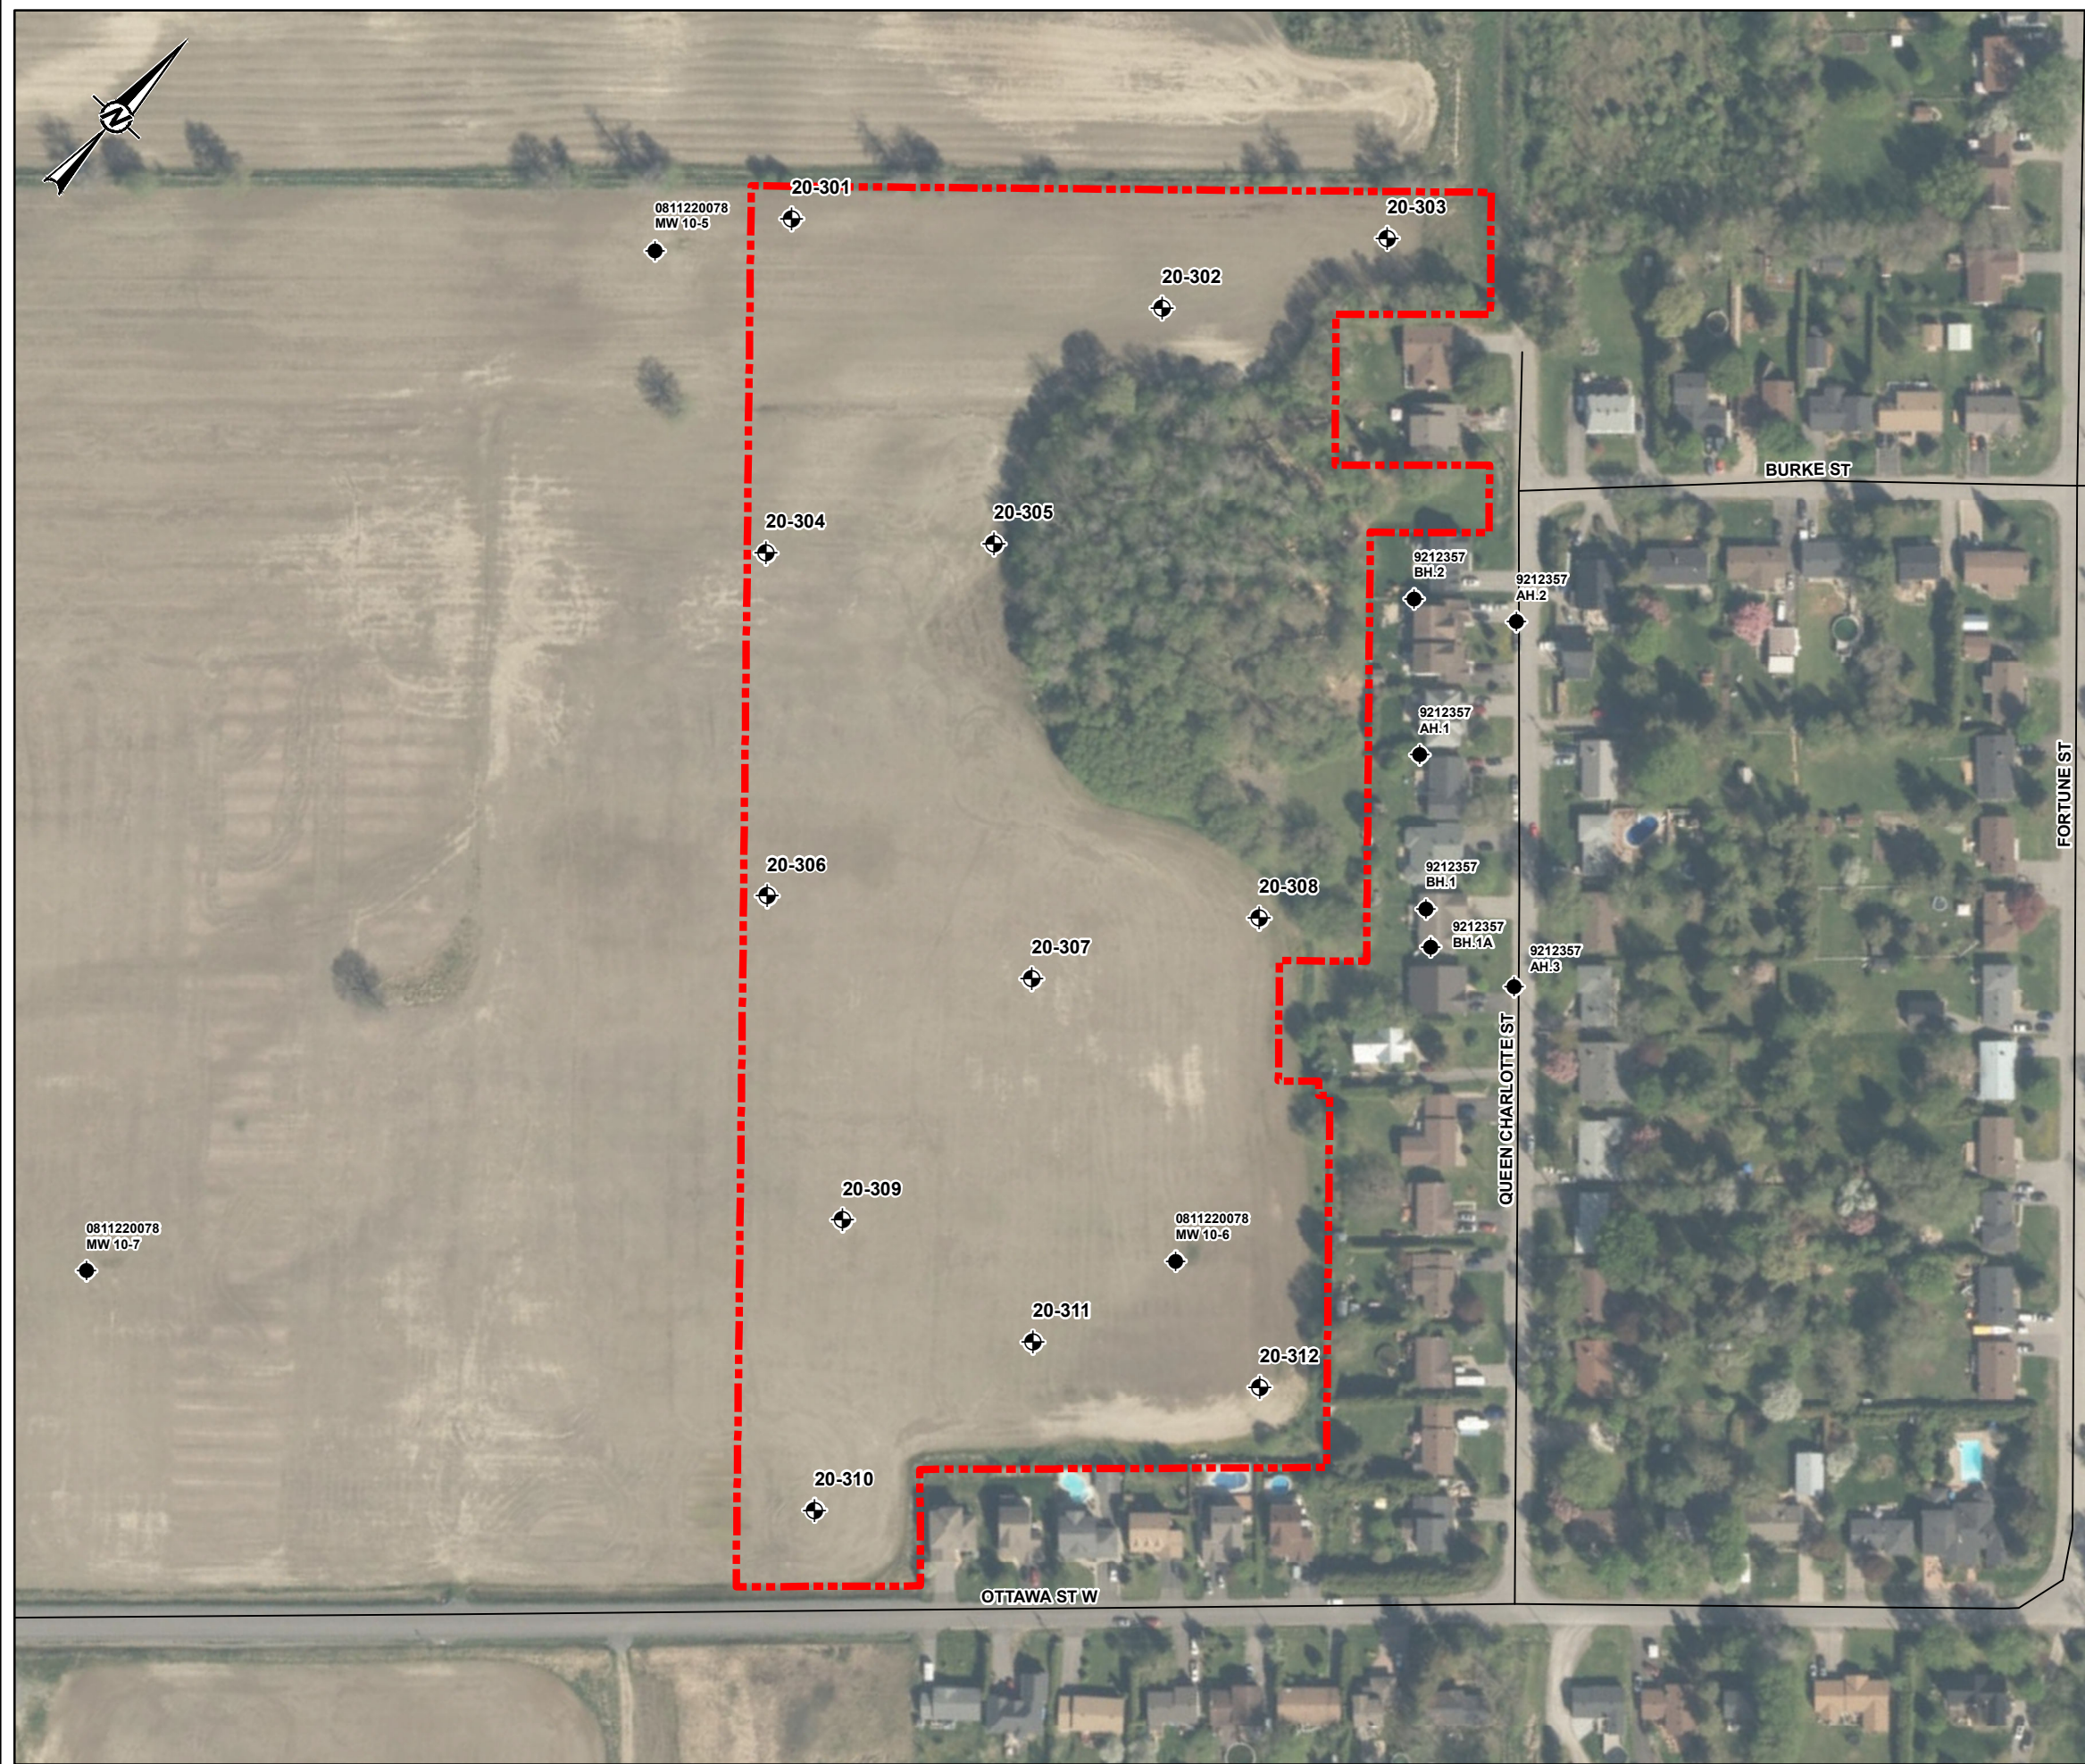

LEGEND

- PROPOSED BOREHOLE LOCATION
- EXISTING BOREHOLE LOCATION
- ROADWAY
- APPROXIMATE SITE BOUNDARY

NOTE(S)
1. ALL LOCATIONS ARE APPROXIMATE

REFERENCE(S)
1. PROJECTION: TRANSVERSE MERCATOR, DATUM: NAD 83,
COORDINATE SYSTEM: MTM ZONE 9, VERTICAL DATUM: CGVD28



CLIENT
CAIVAN (RICHMOND NORTH) LIMITED

PROJECT
PRELIMINARY GEOTECHNICAL REPORT
LAFFIN PARCEL

TITLE
**SITE PLAN, PREVIOUS AND PROPOSED TESTHOLE
LOCATIONS**

CONSULTANT	YYYY-MM-DD	2020-07-01
DESIGNED	---	
PREPARED	JEM	
REVIEWED	KM	
APPROVED	CH	

PROJECT NO. 20144864	CONTROL 0006	REV. A	FIGURE 1
-------------------------	-----------------	-----------	--------------------

Path: N:\Katie\Spatial_Maps\CAIVAN\RichmondNorth\Reports\SWMP\F00_FRCO_20144864_Caivan_Emer0006_Geotech_Prelim_Report_LaffinParcel(20144864-0006-0001.mxd

IF THIS MEASUREMENT DOES NOT MATCH WHAT IS SHOWN, THE SHEET SIZE HAS BEEN MODIFIED FROM: 28mm

APPENDIX A


Record of Previous Investigations

DRAFT

METHOD OF SOIL CLASSIFICATION

The Golder Associates Ltd. Soil Classification System is based on the Unified Soil Classification System (USCS)

Organic or Inorganic	Soil Group	Type of Soil	Gradation or Plasticity	$Cu = \frac{D_{60}}{D_{10}}$	$Cc = \frac{(D_{30})^2}{D_{10} \times D_{60}}$	Organic Content	USCS Group Symbol	Group Name			
INORGANIC (Organic Content ≤30% by mass)	COARSE-GRAINED SOILS (>50% by mass is larger than 0.075 mm)	GRAVELS (>50% by mass of coarse fraction is larger than 4.75 mm)	Poorly Graded	<4	≤1 or ≥3	≤30%	GP	GRAVEL			
			Well Graded	≥4	1 to 3		GW	GRAVEL			
			Below A Line		n/a		GM	SILTY GRAVEL			
			Above A Line		n/a		GC	CLAYEY GRAVEL			
		SANDS (≥50% by mass of coarse fraction is smaller than 4.75 mm)	Poorly Graded	<6	≤1 or ≥3		SP	SAND			
			Well Graded	≥6	1 to 3		SW	SAND			
			Below A Line		n/a		SM	SILTY SAND			
			Above A Line		n/a		SC	CLAYEY SAND			
Organic or Inorganic	Soil Group	Type of Soil	Laboratory Tests	Field Indicators					Organic Content	USCS Group Symbol	Primary Name
				Dilatancy	Dry Strength	Shine Test	Thread Diameter	Toughness (of 3 mm thread)			
INORGANIC (Organic Content ≤30% by mass)	FINE-GRAINED SOILS (≥50% by mass is smaller than 0.075 mm)	SILTS (Non-Plastic or PI and LL plot below A-Line on Plasticity Chart below)	Liquid Limit <50	Rapid	None	None	>6 mm	N/A (can't roll 3 mm thread)	<5%	ML	SILT
				Slow	None to Low	Dull	3mm to 6 mm	None to low	<5%	ML	CLAYEY SILT
			Liquid Limit ≥50	Slow to very slow	Low to medium	Dull to slight	3mm to 6 mm	Low	5% to 30%	OL	ORGANIC SILT
				Slow to very slow	Low to medium	Slight	3mm to 6 mm	Low to medium	<5%	MH	CLAYEY SILT
		CLAYS (PI and LL plot above A-Line on Plasticity Chart below)	Liquid Limit <30	None	Low to medium	Slight to shiny	~ 3 mm	Low to medium	0% to 30% (see Note 2)	CL	SILTY CLAY
				None	Medium to high	Slight to shiny	1 mm to 3 mm	Medium		CI	SILTY CLAY
				None	High	Shiny	<1 mm	High		CH	CLAY
			Liquid Limit ≥30	None	Low to medium	Slight to shiny	~ 3 mm	Low to medium	0% to 30% (see Note 2)	CL	SILTY CLAY
				None	Medium to high	Slight to shiny	1 mm to 3 mm	Medium		CI	SILTY CLAY
				None	High	Shiny	<1 mm	High		CH	CLAY
HIGHLY ORGANIC SOILS (Organic Content >30% by mass)	Peat and mineral soil mixtures						30% to 75%	PT	SILTY PEAT, SANDY PEAT		
		Predominantly peat, may contain some mineral soil, fibrous or amorphous peat					75% to 100%		PEAT		

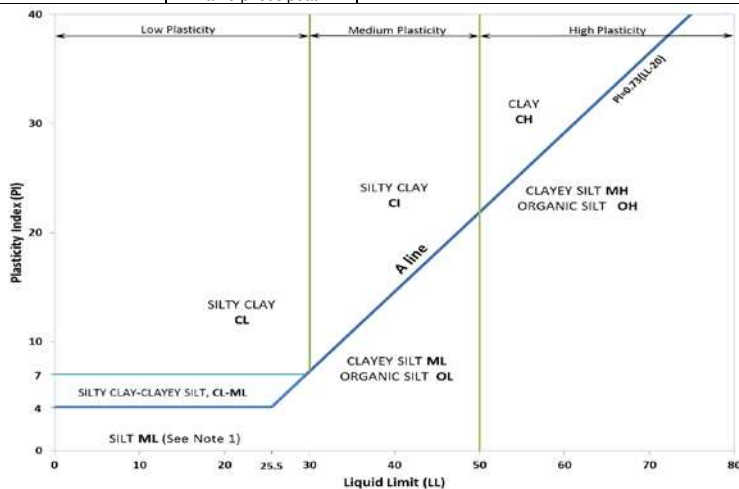

Note 1 – Fine grained materials with PI and LL that plot in this area are named (ML) SILT with slight plasticity. Fine-grained materials which are non-plastic (i.e. a PL cannot be measured) are named SILT.
 Note 2 – For soils with <5% organic content, include the descriptor “trace organics” for soils with between 5% and 30% organic content include the prefix “organic” before the Primary name.

Dual Symbol — A dual symbol is two symbols separated by a hyphen, for example, GP-GM, SW-SC and CL-ML. For non-cohesive soils, the dual symbols must be used when the soil has between 5% and 12% fines (i.e. to identify transitional material between “clean” and “dirty” sand or gravel. For cohesive soils, the dual symbol must be used when the liquid limit and plasticity index values plot in the CL-ML area of the plasticity chart (see Plasticity Chart at left).

Borderline Symbol — A borderline symbol is two symbols separated by a slash, for example, CL/CI, GM/SM, CL/ML. A borderline symbol should be used to indicate that the soil has been identified as having properties that are on the transition between similar materials. In addition, a borderline symbol may be used to indicate a range of similar soil types within a stratum.

ABBREVIATIONS AND TERMS USED ON RECORDS OF BOREHOLES AND TEST PITS

PARTICLE SIZES OF CONSTITUENTS

Soil Constituent	Particle Size Description	Millimetres	Inches (US Std. Sieve Size)
BOULDERS	Not Applicable	>300	>12
COBBLES	Not Applicable	75 to 300	3 to 12
GRAVEL	Coarse	19 to 75	0.75 to 3
	Fine	4.75 to 19	(4) to 0.75
SAND	Coarse	2.00 to 4.75	(10) to (4)
	Medium	0.425 to 2.00	(40) to (10)
	Fine	0.075 to 0.425	(200) to (40)
SILT/CLAY	Classified by plasticity	<0.075	< (200)

MODIFIERS FOR SECONDARY AND MINOR CONSTITUENTS

Percentage by Mass	Modifier
>35	Use 'and' to combine major constituents (i.e., SAND and GRAVEL)
> 12 to 35	Primary soil name prefixed with "gravelly, sandy, SILTY, CLAYEY" as applicable
> 5 to 12	some
≤ 5	trace

PENETRATION RESISTANCE

Standard Penetration Resistance (SPT), N:

The number of blows by a 63.5 kg (140 lb) hammer dropped 760 mm (30 in.) required to drive a 50 mm (2 in.) split-spoon sampler for a distance of 300 mm (12 in.). Values reported are as recorded in the field and are uncorrected.

Cone Penetration Test (CPT)

An electronic cone penetrometer with a 60° conical tip and a project end area of 10 cm² pushed through ground at a penetration rate of 2 cm/s. Measurements of tip resistance (q_t), porewater pressure (u) and sleeve frictions are recorded electronically at 25 mm penetration intervals.

Dynamic Cone Penetration Resistance (DCPT); N_d:

The number of blows by a 63.5 kg (140 lb) hammer dropped 760 mm (30 in.) to drive uncased a 50 mm (2 in.) diameter, 60° cone attached to "A" size drill rods for a distance of 300 mm (12 in.).

PH: Sampler advanced by hydraulic pressure

PM: Sampler advanced by manual pressure

WH: Sampler advanced by static weight of hammer

WR: Sampler advanced by weight of sampler and rod

SAMPLES

AS	Auger sample
BS	Block sample
CS	Chunk sample
DD	Diamond Drilling
DO or DP	Seamless open ended, driven or pushed tube sampler – note size
DS	Denison type sample
GS	Grab Sample
MC	Modified California Samples
MS	Modified Shelby (for frozen soil)
RC	Rock core
SC	Soil core
SS	Split spoon sampler – note size
ST	Slotted tube
TO	Thin-walled, open – note size (Shelby tube)
TP	Thin-walled, piston – note size (Shelby tube)
WS	Wash sample

SOIL TESTS

w	water content
PL, w _p	plastic limit
LL, w _L	liquid limit
C	consolidation (oedometer) test
CHEM	chemical analysis (refer to text)
CID	consolidated isotropically drained triaxial test ¹
CIU	consolidated isotropically undrained triaxial test with porewater pressure measurement ¹
D _R	relative density (specific gravity, G _s)
DS	direct shear test
GS	specific gravity
M	sieve analysis for particle size
MH	combined sieve and hydrometer (H) analysis
MPC	Modified Proctor compaction test
SPC	Standard Proctor compaction test
OC	organic content test
SO ₄	concentration of water-soluble sulphates
UC	unconfined compression test
UU	unconsolidated undrained triaxial test
V (FV)	field vane (LV-laboratory vane test)
γ	unit weight

1. Tests anisotropically consolidated prior to shear are shown as CAD, CAU.

NON-COHESIVE (COHESIONLESS) SOILS

Compactness²

Term	SPT 'N' (blows/0.3m) ¹
Very Loose	0 to 4
Loose	4 to 10
Compact	10 to 30
Dense	30 to 50
Very Dense	>50

1. SPT 'N' in accordance with ASTM D1586, uncorrected for the effects of overburden pressure.

2. Definition of compactness terms are based on SPT 'N' ranges as provided in Terzaghi, Peck and Mesri (1996). Many factors affect the recorded SPT 'N' value, including hammer efficiency (which may be greater than 60% in automatic trip hammers), overburden pressure, groundwater conditions, and grain size. As such, the recorded SPT 'N' value(s) should be considered only an approximate guide to the soil compactness. These factors need to be considered when evaluating the results, and the stated compactness terms should not be relied upon for design or construction.

Field Moisture Condition

Term	Description
Dry	Soil flows freely through fingers.
Moist	Soils are darker than in the dry condition and may feel cool.
Wet	As moist, but with free water forming on hands when handled.

COHESIVE SOILS

Consistency

Term	Undrained Shear Strength (kPa)	SPT 'N' ^{1,2} (blows/0.3m)
Very Soft	<12	0 to 2
Soft	12 to 25	2 to 4
Firm	25 to 50	4 to 8
Stiff	50 to 100	8 to 15
Very Stiff	100 to 200	15 to 30
Hard	>200	>30

1. SPT 'N' in accordance with ASTM D1586, uncorrected for overburden pressure effects; approximate only.

2. SPT 'N' values should be considered ONLY an approximate guide to consistency; for sensitive clays (e.g., Champlain Sea clays), the N-value approximation for consistency terms does NOT apply. Rely on direct measurement of undrained shear strength or other manual observations.

Water Content

Term	Description
w < PL	Material is estimated to be drier than the Plastic Limit.
w ~ PL	Material is estimated to be close to the Plastic Limit.
w > PL	Material is estimated to be wetter than the Plastic Limit.

LIST OF SYMBOLS

Unless otherwise stated, the symbols employed in the report are as follows:

I. GENERAL

π	3.1416
$\ln x$	natural logarithm of x
$\log_{10} x$	x or log x, logarithm of x to base 10
g	acceleration due to gravity
t	time

II. STRESS AND STRAIN

γ	shear strain
Δ	change in, e.g. in stress: $\Delta \sigma$
ε	linear strain
ε_v	volumetric strain
η	coefficient of viscosity
ν	Poisson's ratio
σ	total stress
σ'	effective stress ($\sigma' = \sigma - u$)
σ'_{vo}	initial effective overburden stress
$\sigma_1, \sigma_2, \sigma_3$	principal stress (major, intermediate, minor)
σ_{oct}	mean stress or octahedral stress $= (\sigma_1 + \sigma_2 + \sigma_3)/3$
τ	shear stress
u	porewater pressure
E	modulus of deformation
G	shear modulus of deformation
K	bulk modulus of compressibility

III. SOIL PROPERTIES

(a) Index Properties

$\rho(\gamma)$	bulk density (bulk unit weight)*
$\rho_d(\gamma_d)$	dry density (dry unit weight)
$\rho_w(\gamma_w)$	density (unit weight) of water
$\rho_s(\gamma_s)$	density (unit weight) of solid particles
γ'	unit weight of submerged soil ($\gamma' = \gamma - \gamma_w$)
D_R	relative density (specific gravity) of solid particles ($D_R = \rho_s / \rho_w$) (formerly G_s)
e	void ratio
n	porosity
S	degree of saturation

(a) Index Properties (continued)

w	water content
w_l or LL	liquid limit
w_p or PL	plastic limit
I_p or PI	plasticity index = $(w_l - w_p)$
NP	non-plastic
w_s	shrinkage limit
I_L	liquidity index = $(w - w_p) / I_p$
I_C	consistency index = $(w_l - w) / I_p$
e_{max}	void ratio in loosest state
e_{min}	void ratio in densest state
I_D	density index = $(e_{max} - e) / (e_{max} - e_{min})$ (formerly relative density)

(b) Hydraulic Properties

h	hydraulic head or potential
q	rate of flow
v	velocity of flow
i	hydraulic gradient
k	hydraulic conductivity (coefficient of permeability)
j	seepage force per unit volume

(c) Consolidation (one-dimensional)

C_c	compression index (normally consolidated range)
C_r	recompression index (over-consolidated range)
C_s	swelling index
C_α	secondary compression index
m_v	coefficient of volume change
C_v	coefficient of consolidation (vertical direction)
C_h	coefficient of consolidation (horizontal direction)
T_v	time factor (vertical direction)
U	degree of consolidation
σ'_p	pre-consolidation stress
OCR	over-consolidation ratio = σ'_p / σ'_{vo}

(d) Shear Strength

τ_p, τ_r	peak and residual shear strength
ϕ'	effective angle of internal friction
δ	angle of interface friction
μ	coefficient of friction = $\tan \delta$
c'	effective cohesion
c_u, s_u	undrained shear strength ($\phi = 0$ analysis)
p	mean total stress $(\sigma_1 + \sigma_3)/2$
p'	mean effective stress $(\sigma'_1 + \sigma'_3)/2$
q	$(\sigma_1 - \sigma_3)/2$ or $(\sigma'_1 - \sigma'_3)/2$
q_u	compressive strength $(\sigma_1 - \sigma_3)$
S_t	sensitivity

* Density symbol is ρ . Unit weight symbol is γ where $\gamma = \rho g$ (i.e. mass density multiplied by acceleration due to gravity)

Notes: 1
2

$$\tau = c' + \sigma' \tan \phi'$$

$$\text{shear strength} = (\text{compressive strength})/2$$

LITHOLOGICAL AND GEOTECHNICAL ROCK DESCRIPTION TERMINOLOGY

WEATHERINGS STATE

Fresh: no visible sign of rock material weathering.

Faintly weathered: weathering limited to the surface of major discontinuities.

Slightly weathered: penetrative weathering developed on open discontinuity surfaces but only slight weathering of rock material.

Moderately weathered: weathering extends throughout the rock mass but the rock material is not friable.

Highly weathered: weathering extends throughout rock mass and the rock material is partly friable.

Completely weathered: rock is wholly decomposed and in a friable condition but the rock and structure are preserved.

BEDDING THICKNESS

<u>Description</u>	<u>Bedding Plane Spacing</u>
Very thickly bedded	Greater than 2 m
Thickly bedded	0.6 m to 2 m
Medium bedded	0.2 m to 0.6 m
Thinly bedded	60 mm to 0.2 m
Very thinly bedded	20 mm to 60 mm
Laminated	6 mm to 20 mm
Thinly laminated	Less than 6 mm

JOINT OR FOLIATION SPACING

<u>Description</u>	<u>Spacing</u>
Very wide	Greater than 3 m
Wide	1 m to 3 m
Moderately close	0.3 m to 1 m
Close	50 mm to 300 mm
Very close	Less than 50 mm

GRAIN SIZE

<u>Term</u>	<u>Size*</u>
Very Coarse Grained	Greater than 60 mm
Coarse Grained	2 mm to 60 mm
Medium Grained	60 microns to 2 mm
Fine Grained	2 microns to 60 microns
Very Fine Grained	Less than 2 microns

Note: * Grains greater than 60 microns diameter are visible to the naked eye.

CORE CONDITION

Total Core Recovery (TCR)

The percentage of solid drill core recovered regardless of quality or length, measured relative to the length of the total core run.

Solid Core Recovery (SCR)

The percentage of solid drill core, regardless of length, recovered at full diameter, measured relative to the length of the total core run.

Rock Quality Designation (RQD)

The percentage of solid drill core, greater than 100 mm length, as measured along the centerline axis of the core, relative to the length of the total core run. RQD varies from 0% for completely broken core to 100% for core in solid segments.

DISCONTINUITY DATA

Fracture Index

A count of the number of naturally occurring discontinuities (physical separations) in the rock core. Mechanically induced breaks caused by drilling are not included.

Dip with Respect to Core Axis

The angle of the discontinuity relative to the axis (length) of the core. In a vertical borehole a discontinuity with a 90° angle is horizontal.

Description and Notes

An abbreviation description of the discontinuities, whether naturally occurring separations such as fractures, bedding planes and foliation planes and mechanically separated bedding or foliation surfaces. Additional information concerning the nature of fracture surfaces and infillings are also noted.

Abbreviations

JN Joint	PL Planar
FLT Fault	CU Curved
SH Shear	UN Undulating
VN Vein	IR Irregular
FR Fracture	K Slickensided
SY Stylolite	PO Polished
BD Bedding	SM Smooth
FO Foliation	SR Slightly Rough
CO Contact	RO Rough
AXJ Axial Joint	VR Very Rough
KV Karstic Void	
MB Mechanical Break	

PROJECT: 08-1122-0078

RECORD OF BOREHOLE: 10-5

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: Apr. 30, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								Cu, kPa		nat V. rem V.	+ ⊕	Q - U	• ○	Wp ----- W ----- Wl			
0		GROUND SURFACE		94.82													
		TOPSOIL		0.00													
		Compact grey brown SILTY fine SAND		0.10													
1	Power Auger 200mm Diam. (Hollow Stem)				1	50 DO	15										
2					2	50 DO	5										
		Compact to very dense grey SANDY SILT, some gravel, trace clay (GLACIAL TILL)		92.84	1.99												
3						3	50 DO	15									
4					4	50 DO	>100										
4		End of Borehole		90.86													
				3.96													



DRAFT

MIS-BHS 001_0811220078-9500.GPJ GAL-MIS GDT_5/19/10_JM

DEPTH SCALE
1:50



LOGGED: J.D.
CHECKED: *PPB*

PROJECT: 08-1122-0078

RECORD OF BOREHOLE: 10-6

SHEET 1 OF 2

LOCATION: See Site Plan

BORING DATE: Apr. 30, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								Cu, kPa		nat V. rem V.		+ ⊕				Q - U	
0		GROUND SURFACE		95.67			20	40	60	80	20	40	60	80			
		TOPSOIL		0.00													
		Loose to compact grey brown SANDY SILT to SILTY SAND, trace clay		95.42												Bentonite Seal	
1	Power Auger 200mm Diam. (Hollow Stem)			0.25												Silica Sand	
				93.84	1	50 DO	6									32mm Diam. PVC #10 Slot Screen 'B'	
2		Dense to very dense grey brown SANDY SILT, some gravel, cobbles and boulders (GLACIAL TILL)		1.83												Silica Sand	
				93.84	2	50 DO	27										
				92.60	3	50 DO	68									Bentonite Seal	
3		Thinly to medium bedded light grey interbedded SANDSTONE and DOLOSTONE BEDROCK		3.07		50 DO	>100									Silica Sand	
4	Rotary Drill NQ Core			90.49	C1	NQ RC DD											
5		End of Borehole		5.18	C2	NQ RC DD										32mm Diam. PVC #10 Slot Screen 'A'	
6																	
7																	
8																	
9																	
10																	

MIS-BHS 001_0811220078-9500.GPJ GAL-MIS GDT 5/19/10 JM

DEPTH SCALE

1 : 50



LOGGED: J.D.

CHECKED: *h/b*

PROJECT: 08-1122-0078

RECORD OF DRILLHOLE: 10-6

SHEET 2 OF 2

LOCATION: See Site Plan

DRILLING DATE: Apr. 30, 2010

DATUM:

INCLINATION: -90° AZIMUTH: ---

DRILL RIG: CME 55

DRILLING CONTRACTOR: Marathon Drilling

DEPTH SCALE METRES	DRILLING RECORD	DESCRIPTION	SYMBOLIC LOG	ELEV. DEPTH (m)	RUN No.	PENETRATION RATE (m/min)	FLUSH	COLOUR % RETURN	FR/FX-FRACTURE F-FAULT		SM-SMOOTH		FL-FLEXURED		BC-BROKEN CORE		NOTES WATER LEVELS INSTRUMENTATION		
									CL-CLEAVAGE		J-JOINT		R-ROUGH		UE-UNEVEN			MB-MECH. BREAK	
									SH-SHEAR		P-POLISHED		ST-STEPPED		W-WAVY			B-BEDDING	
									VN-VEIN		S-SLICKENSIDED		PL-PLANAR		C-CURVED				
RECOVERY		R.Q.D. %	FRACT INDEX PER 0.3	DISCONTINUITY DATA		HYDRAULIC CONDUCTIVITY			DIAMETRAL INDEX (MPa)										
TOTAL CORE %	SOLID CORE %			TYPE AND SURFACE DESCRIPTION		K ₁ , cm/sec	K ₂	K ₃											
		0 0 0 0 0 0	0 0 0 0 0 0	0 0 0 0 0 0	0 0 0 0 0 0	0 0 0 0 0 0	0 0 0 0 0 0	0 0 0 0 0 0	0 0 0 0 0 0	0 0 0 0 0 0	0 0 0 0 0 0	0 0 0 0 0 0	0 0 0 0 0 0	0 0 0 0 0 0					
		BEDROCK SURFACE		92.60															
	Relay Drill NQ Core	Thinly to medium bedded light grey interbedded SANDSTONE and DOLOSTONE BEDROCK		3.07	1												Bentonite Seal Silica Sand 32mm Diam. PVC #10 Slot Screen 'A'		
		End of Borehole		90.49 5.18															

MIS-RCK 001 0811220078-9500 (ROCK) GPJ GAL-MISS GDT 5/19/10 JM

DEPTH SCALE
1 : 50



LOGGED: J.D.
CHECKED: *[Signature]*

PROJECT: 08-1122-0078

RECORD OF BOREHOLE: 10-7

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: Apr. 29, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								Cu, kPa		rem V, U - O		Wp		Wi			
0	Power Auger 200mm Diam. (Hollow Stem)	GROUND SURFACE		95.36													
		TOPSOIL		0.00													
		Stiff grey to brown SILT, trace to some clay, trace fine sand		0.08													
1						1	50 DO	5									
2					2	50 DO	9										
		Loose grey brown SILTY fine SAND		93.07													
				2.29													
3					3	50 DO	8										
4					4	50 DO	9										
4		End of Borehole		91.40													
				3.96													

MIS-BHS 001 0811220078-9500.GPJ GAL-MIS.GDT 5/19/10 JM

DEPTH SCALE
1 : 50



LOGGED: J.D.
CHECKED: *[Signature]*

APPENDIX B

Current Investigation - Record of Boreholes

DRAFT

PROJECT: 20144864

RECORD OF BOREHOLE: 20-301

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: June 23, 2020

DATUM:

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m				WATER CONTENT PERCENT					
							20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴			10 ⁻³
0		GROUND SURFACE														
0.11	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL - (SM) SILTY SAND; dark brown, contains organic matter; moist (SM) SILTY SAND; grey brown; non-cohesive, moist, very loose to compact		0.00	1	SS	5									
0.11																
2.13		(SM) gravelly SILTY SAND; grey (GLACIAL TILL); non-cohesive, moist, compact		2.13	2	SS	8									
2.28																
2.28		End of Borehole Auger Refusal		2.28	3	SS	24									
3																
10															Open borehole dry upon completion of drilling	

DRAFT

MIS-BHS 001 20144864.GPJ GAL-MIS.GDT 7/1/20 JIM

DEPTH SCALE

1 : 50



LOGGED: KM

CHECKED:

PROJECT: 20144864

RECORD OF BOREHOLE: 20-302

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: June 23, 2020

DATUM:

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								20 40 60 80		10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³		nat V. + Q - ●				rem V. ⊕ U - ○	
0		GROUND SURFACE															
		TOPSOIL - (SM) SILTY SAND; dark brown; moist		0.00													
		FILL - (SM) SILTY SAND; red brown; non-cohesive, moist, loose		0.11	1	SS	7										
	Power Auger 200 mm Diam. (Hollow Stem)	(SM) SILTY SAND; grey brown; non-cohesive, moist, compact		0.76	2	SS	23										
				0.76	3	SS	30										
		(SM) gravelly SILTY SAND; grey (GLACIAL TILL); non-cohesive, moist, compact to dense		2.29	4	SS	35										
3		End of Borehole Auger Refusal		2.77											Open borehole dry upon completion of drilling		
4																	
5																	
6																	
7																	
8																	
9																	
10																	

DRAFT

MIS-BHS 001 20144864.GPJ GAL-MIS.GDT 7/1/20 JIM

DEPTH SCALE

1 : 50



LOGGED: KM

CHECKED:

PROJECT: 20144864

RECORD OF BOREHOLE: 20-303

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: June 23, 2020

DATUM:

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION				
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m				WATER CONTENT PERCENT								
							SHEAR STRENGTH Cu, kPa		nat V. + rem V. ⊕ ⊙		Q - U -		Wp			W		WI	
0		GROUND SURFACE																	
0.00 - 0.11	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL - (SM) SILTY SAND; dark brown, contains organic matter; moist		0.00	1	SS	5												
0.11 - 0.61		FILL - (SM) SILTY SAND; grey brown, mottled, contains organic matter; non-cohesive, moist, loose		0.11															
0.61 - 1.96		(SM) SILTY SAND; grey brown; non-cohesive, moist, compact to very dense		0.61				2	SS	16									
1.96 - 2.00		End of Borehole Auger Refusal		1.96	3	SS	57/ 0.28												
2.00 - 10.00															Open borehole dry upon completion of drilling				

DRAFT

MIS-BHS 001 20144864.GPJ GAL-MIS.GDT 7/1/20 JIM

DEPTH SCALE

1 : 50



LOGGED: KM

CHECKED:

PROJECT: 20144864

RECORD OF BOREHOLE: 20-304

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: June 24, 2020


DATUM:

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20	40	60	80	nat V. +	rem V. ⊕	Q - ●			U - ○
0		GROUND SURFACE					20	40	60	80	20	40	60	80			
	Power Auger 200 mm Diam. (Hollow Stem)	FILL - (SM) SILTY SAND; grey brown; non-cohesive, moist, loose	[Cross-hatch pattern]	0.00	1	SS	7										
		(SM) SILTY SAND; grey brown; non-cohesive, moist to wet, compact	[Dotted pattern]	0.61	2	SS	10										
					3	SS	20										
		(SM/ML) gravelly SAND and SILT; grey, with cobbles and boulders (GLACIAL TILL); non-cohesive, wet, loose to compact	[Diagonal lines]	2.13	4	SS	4										
					5	SS	16										
					6	SS	17										
					7	SS	16										
5.18		End of Borehole															

DRAFT

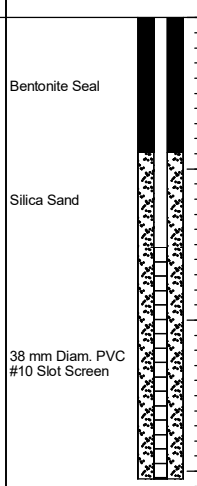

WL in open borehole at 3.57 m depth below ground surface upon completion of drilling

MIS-BHS 001 20144864.GPJ GAL-MIS.GDT 7/1/20 JIM

DEPTH SCALE

1 : 50



LOGGED: DG

CHECKED:

PROJECT: 20144864

RECORD OF BOREHOLE: 20-305

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: June 23, 2020

DATUM:

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m				WATER CONTENT PERCENT					
							SHEAR STRENGTH Cu, kPa		nat V. + rem V. ⊕ Q - U - ⊙		Wp	W	WI			
0		GROUND SURFACE														
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL - (SM) SILTY SAND; dark brown, contains organic; moist	[Cross-hatched pattern]	0.00	1	SS	6									
		FILL - (SM) SILTY SAND; brown, mottled, contains organic matter; non-cohesive, moist, loose		0.10												
1		(SM) SILTY SAND; grey brown; non-cohesive, moist, compact to loose	[Dotted pattern]	0.76	2	SS	10									
2					3	SS	9									
		(SM) gravelly SILTY SAND; grey (GLACIAL TILL); non-cohesive, moist, loose		2.29	4	SS	6									
3		End of Borehole Auger Refusal		3.07	5	SS	50/0.03									
4																
5																
6																
7																
8																
9																
10																

DRAFT

Open borehole dry upon completion

MIS-BHS 001 20144864.GPJ GAL-MIS.GDT 7/1/20 JIM

DEPTH SCALE

1 : 50



LOGGED: KM

CHECKED:

PROJECT: 20144864

RECORD OF BOREHOLE: 20-306

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: June 24, 2020

DATUM:

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
							20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴			10 ⁻³
0		GROUND SURFACE														
	Power Auger 200 mm Diam. (Hollow Stem)	FILL - (SM) SILTY SAND; grey brown; non-cohesive, moist, loose	[Cross-hatch pattern]	0.00	1	SS	6									
		(ML) sandy CLAYEY SILT; grey brown, contains silty sand layers; cohesive, w~PL, stiff	[Dotted pattern]	0.61	2	SS	3									
		(SM/ML) SAND and SILT; grey brown; non-cohesive, wet, compact	[Dotted pattern]	2.90	5	SS	14									
		(SM/ML) gravelly SAND and SILT; grey, with cobbles and boulders (GLACIAL TILL); non-cohesive, wet	[Dotted pattern]	3.66	6	SS	51									
		End of Borehole Auger Refusal		4.26												

DRAFT

WL in open borehole at 3.55 m depth below ground surface upon completion of drilling

MIS-BHS 001 20144864.GPJ GAL-MIS.GDT 7/1/20 JIM

DEPTH SCALE

1 : 50



LOGGED: DG

CHECKED:

PROJECT: 20144864

RECORD OF BOREHOLE: 20-307

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: June 24, 2020

DATUM:

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION			
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH				WATER CONTENT PERCENT							
								20 40 60 80		10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³		nat V. + Q -		rem V. ⊕ U -			W _p W W _i		
0		GROUND SURFACE					20	40	60	80	20	40	60	80					
	Power Auger 200 mm Diam. (Hollow Stem)	FILL - (SM) SILTY SAND; grey brown; non-cohesive, moist, loose		0.00	1	SS	5												
1					(ML) sandy CLAYEY SILT; grey brown, contains silty sand layers; cohesive, w~PL, very stiff	0.76	2	SS	4										
2						3	SS	12											
						4	SS	55/ 0.23											
3	Rotary Drill NQ Core	Fresh, medium bedded, grey, medium to strong LIMESTONE BEDROCK		2.66	5	RC	DD												
4					End of Borehole	4.31													
5																			
6																			
7																			
8																			
9																			
10																			

DRAFT

MIS-BHS 001 20144864.GPJ GAL-MIS.GDT 7/1/20 JIM

DEPTH SCALE

1 : 50



LOGGED: DG

CHECKED:

PROJECT: 20144864

RECORD OF BOREHOLE: 20-308

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: June 23, 2020

DATUM:

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m				WATER CONTENT PERCENT					
							SHEAR STRENGTH Cu, kPa		nat V. rem V.		Q - U		Wp			W
0		GROUND SURFACE														
0.00		TOPSOIL/FILL - (SM) SILTY SAND; dark brown, contains organic matter; non-cohesive, moist	[Cross-hatch pattern]	0.00	1	SS	6									
0.30		(SM) SILTY SAND; grey; non-cohesive, moist, loose to compact	[Dotted pattern]	0.30												
1	Power Auger 200 mm Diam. (Hollow Stem)				2	SS	4									
2					3	SS	16									
2.13			(SM) gravelly SILTY SAND; grey, contains cobbles and boulders (GLACIAL TILL); non-cohesive, moist, very dense	[Cross-hatch pattern]	2.13	4	SS	50/0.25								
2.51		End of Borehole Auger Refusal	[Cross-hatch pattern]	2.51												
3																
4																
5																
6																
7																
8																
9																
10																

DRAFT

WL in open borehole dry upon completion of drilling

MIS-BHS 001 20144864.GPJ GAL-MIS.GDT 7/1/20 JIM

DEPTH SCALE



LOGGED: KM

1 : 50

CHECKED:

PROJECT: 20144864

RECORD OF BOREHOLE: 20-309

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: June 24, 2020

DATUM:

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								20		40		60		80			10 ⁻⁶
0		GROUND SURFACE					20	40	60	80	20	40	60	80			
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL - (SM) SILTY SAND; dark brown, with rootlets; non-cohesive, moist		0.00	1	SS	8										
1		(SM) SILTY SAND; grey brown; non-cohesive, moist to wet, loose to compact		0.61	2	SS	3										
2					3	SS	12										
3					4	SS	10										
3					5	SS	50/ 0.05										
	Rotary Drill NG Core	Slightly weathered to fresh, medium bedded, grey, medium to strong LIMESTONE BEDROCK		3.09	6	RC	DD										
4					7	RC	DD										
5					8	RC	DD										
6																	
7	End of Borehole		6.32														
8																	
9																	
10																	

DRAFT

WL in open borehole at 2.50 m depth below ground surface upon completion of drilling

MIS-BHS 001 20144864.GPJ GAL-MIS.GDT 7/1/20 JIM

DEPTH SCALE

1 : 50



LOGGED: DG

CHECKED:

PROJECT: 20144864

RECORD OF BOREHOLE: 20-310

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: June 24, 2020

DATUM:

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20	40	60	80	nat V. +	Q - ●	rem V. ⊕			U - ○
0		GROUND SURFACE															
0		FILL - (SM) SILTY SAND; brown; non-cohesive, moist, loose		0.00	1	SS	6										
1		(SM) SILTY SAND, fine; grey brown, contains silt layers; non-cohesive, moist to wet, compact		0.76	2	SS	15										
2					3	SS	15										
3		(SM/ML) gravelly SAND and SILT; grey, with cobbles and boulders (GLACIAL TILL); non-cohesive, wet, loose to very dense		2.29	4	SS	9										
4					5	SS	15										
5					6	SS	21										
6					7	SS	92										
6					8	SS	56										
6		End of Borehole		6.09													
7																	
8																	
9																	
10																	

Power Auger
200 mm Diam. (Hollow Stem)

Bentonite Seal

Silica Sand

38 mm Diam. PVC #10 Slot Screen

Water level in open borehole at 1.52 m depth below ground surface upon completion

DRAFT

MIS-BHS 001 20144864.GPJ GAL-MIS.GDT 7/1/20 JIM

DEPTH SCALE

1 : 50



LOGGED: DG

CHECKED:

PROJECT: 20144864

RECORD OF BOREHOLE: 20-311

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: June 23, 2020

DATUM:

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m				WATER CONTENT PERCENT					
							SHEAR STRENGTH Cu, kPa		nat V. + rem V. ⊕ U - ⊙		Wp		W			WI
0		GROUND SURFACE														
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL/FILL - (SM) SILTY SAND; dark brown, contains organic matter; moist	[Cross-hatched pattern]	0.00	1	SS	3									
		(SM) SILTY SAND; grey brown to grey, contains layers of clayey silt; non-cohesive, moist, very loose to loose	[Dotted pattern]	0.30	2	SS	5									
		(SM) gravelly SILTY SAND; grey, contains cobbles and boulders (GLACIAL TILL); non-cohesive, moist, compact to very dense	[Diagonal line pattern]	1.52	3	SS	26									
		End of Borehole Auger Refusal		2.46	4	SS	50/ 0.03									
3															Open borehole dry upon completion of drilling	
4																
5																
6																
7																
8																
9																
10																

DRAFT

MIS-BHS 001 20144864.GPJ GAL-MIS.GDT 7/1/20 JIM

DEPTH SCALE

1 : 50



LOGGED: KM

CHECKED:

PROJECT: 20144864

RECORD OF BOREHOLE: 20-312

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: June 23, 2020

DATUM:

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20		40		60		80			
0		GROUND SURFACE															
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL/FILL - (SM) SILTY SAND; dark brown, contains organic matter; non-cohesive, moist, very loose		0.00	1	SS	4										
1		(SM) gravelly SILTY SAND; grey brown, contains cobbles and boulders (GLACIAL TILL); non-cohesive, moist, compact to very dense		0.61	2	SS	19										
					1.78	3	SS	50/ 0.10									
2		End of Borehole Auger Refusal															
3																	
4																	
5																	
6																	
7																	
8																	
9																	
10																	


DRAFT

Open borehole dry upon completion of drilling

MIS-BHS 001 20144864.GPJ GAL-MIS.GDT 7/1/20 JIM



FIGURES

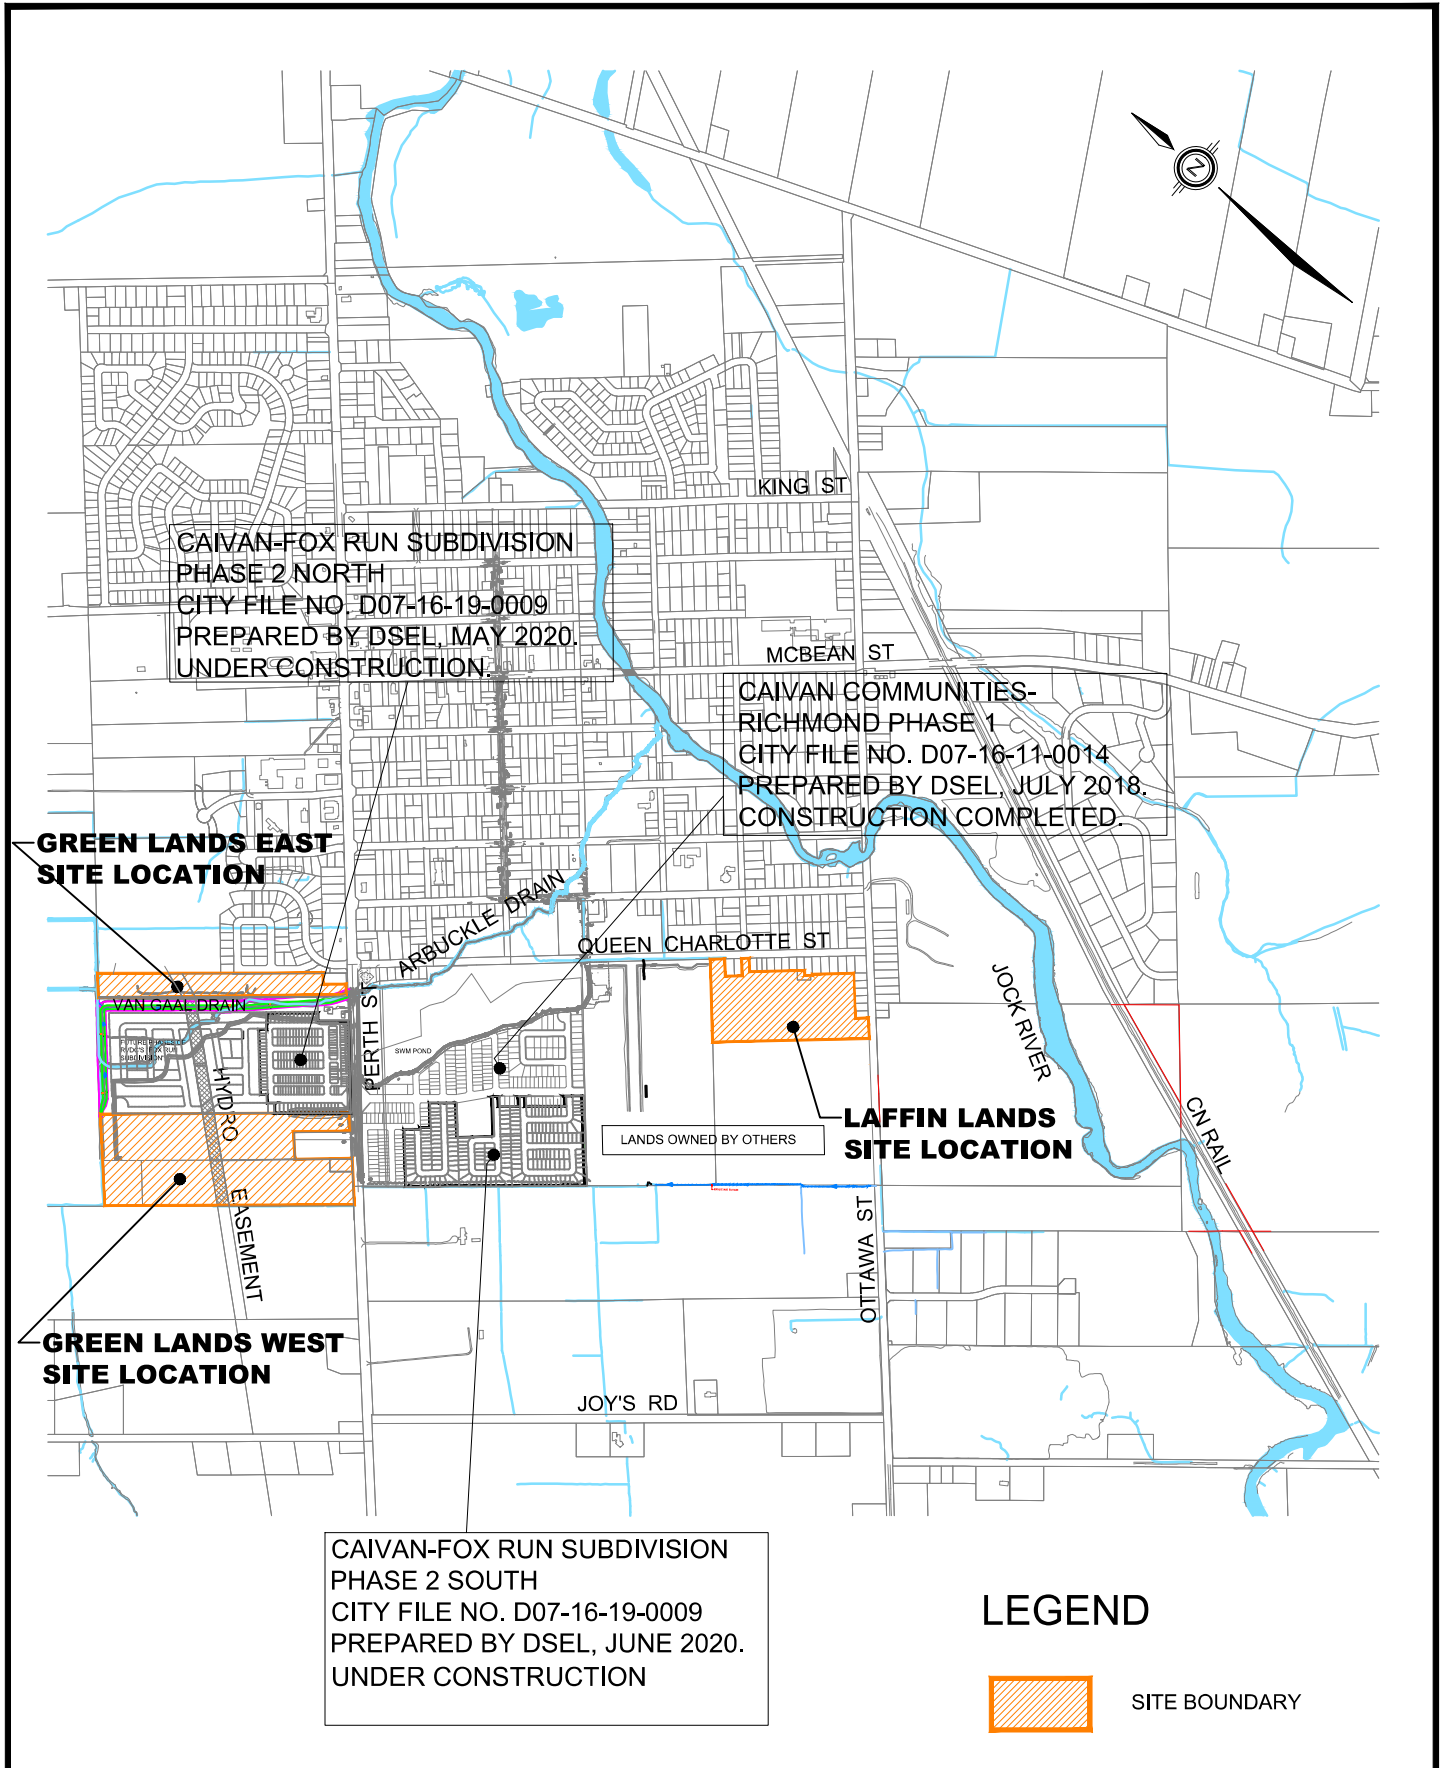

RICHMOND VILLAGE
DEVELOPMENT CORPORATION

SITE LOCATION

SCALE: 1:20,000



120 Iber Road, Unit 103
Stittsville, ON K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

DATE: FEBRUARY 2021

PROJECT No.: 20-1184




FIGURE: 1

GREEN LANDS EAST

LAFFIN LANDS

GREEN LANDS WEST

FIGURE 2

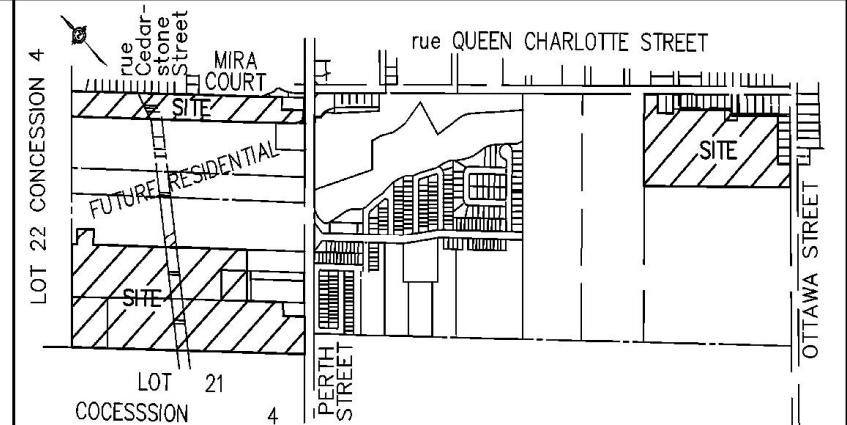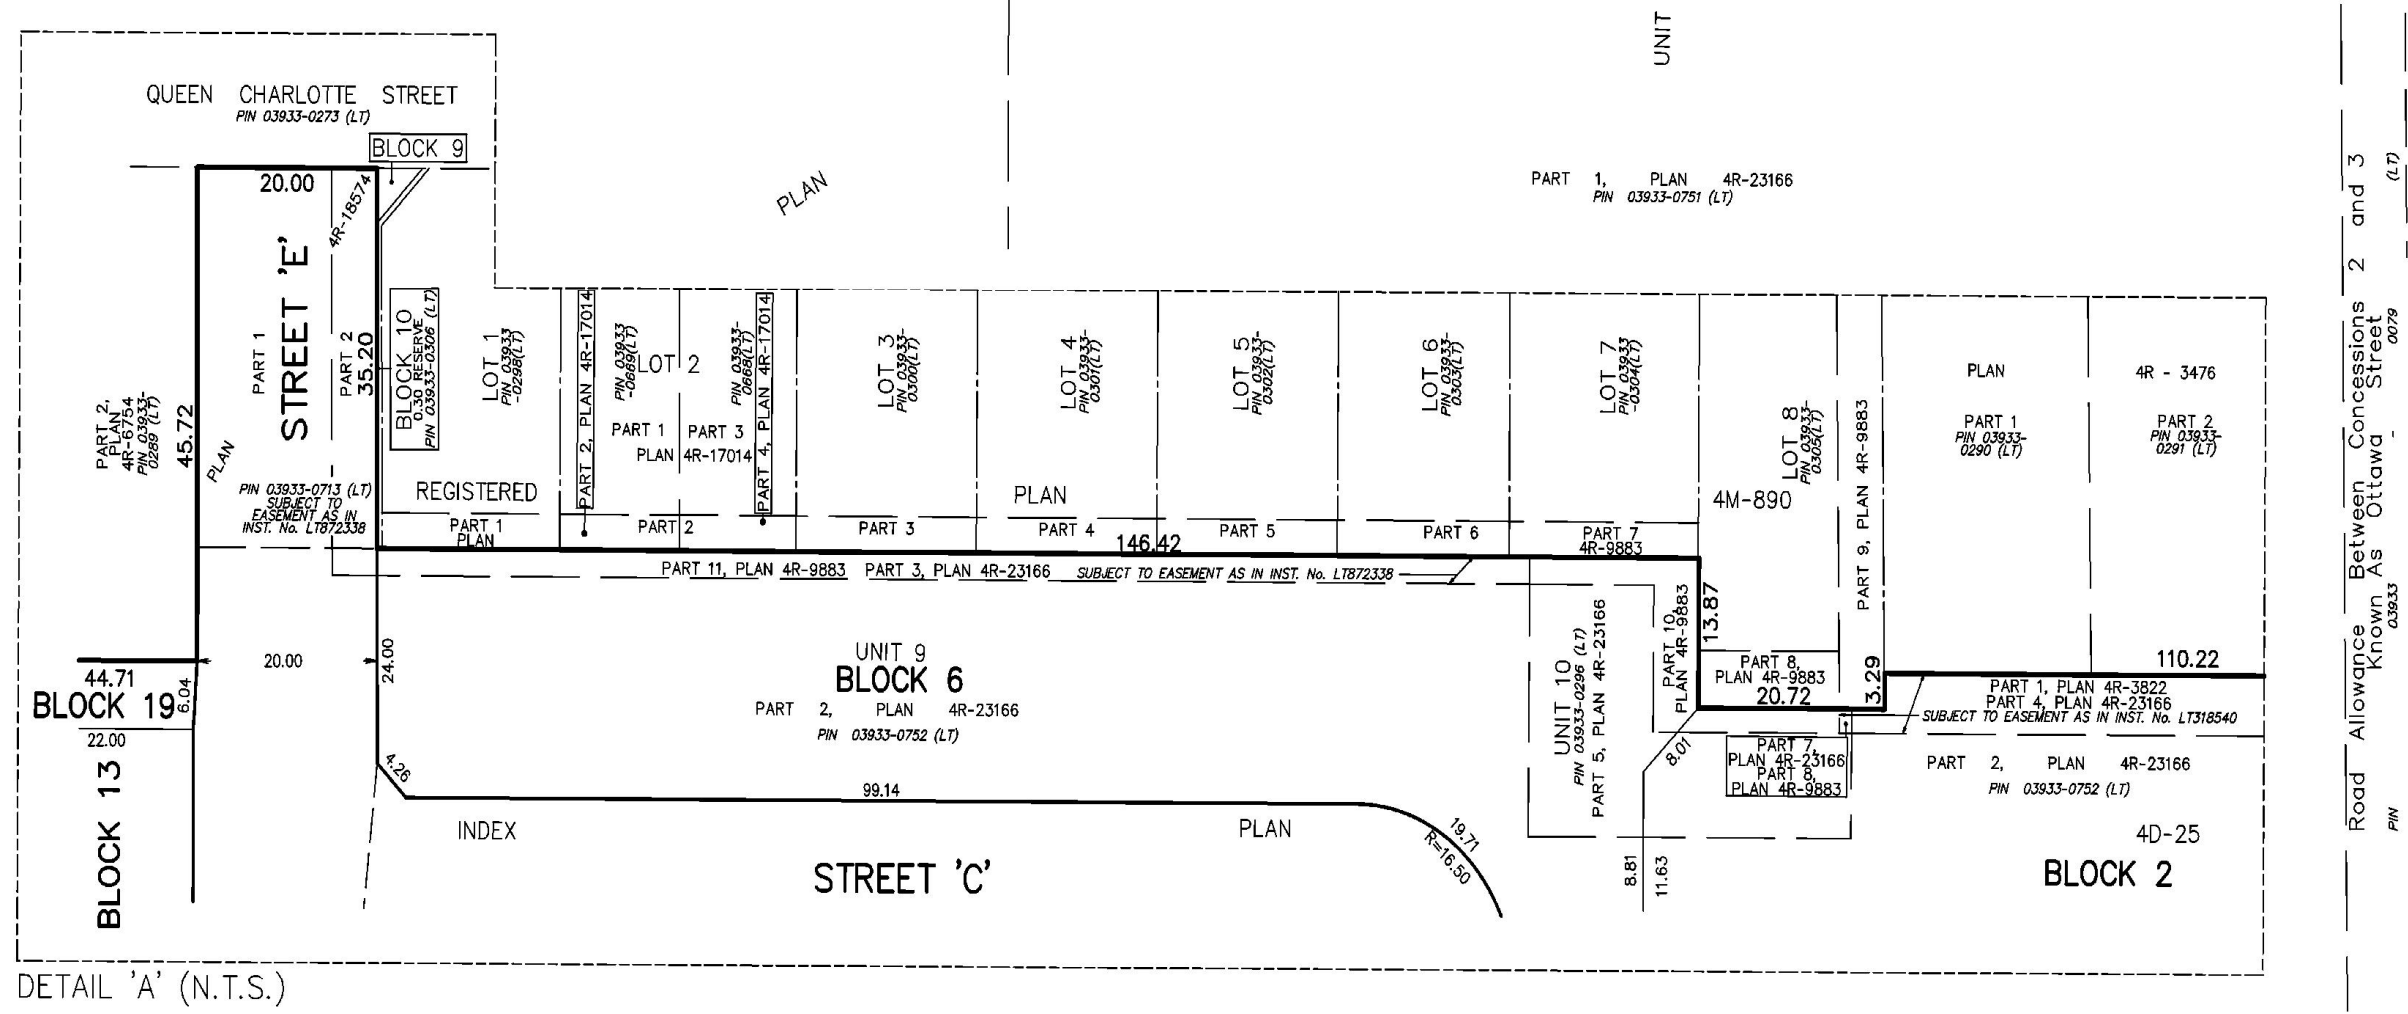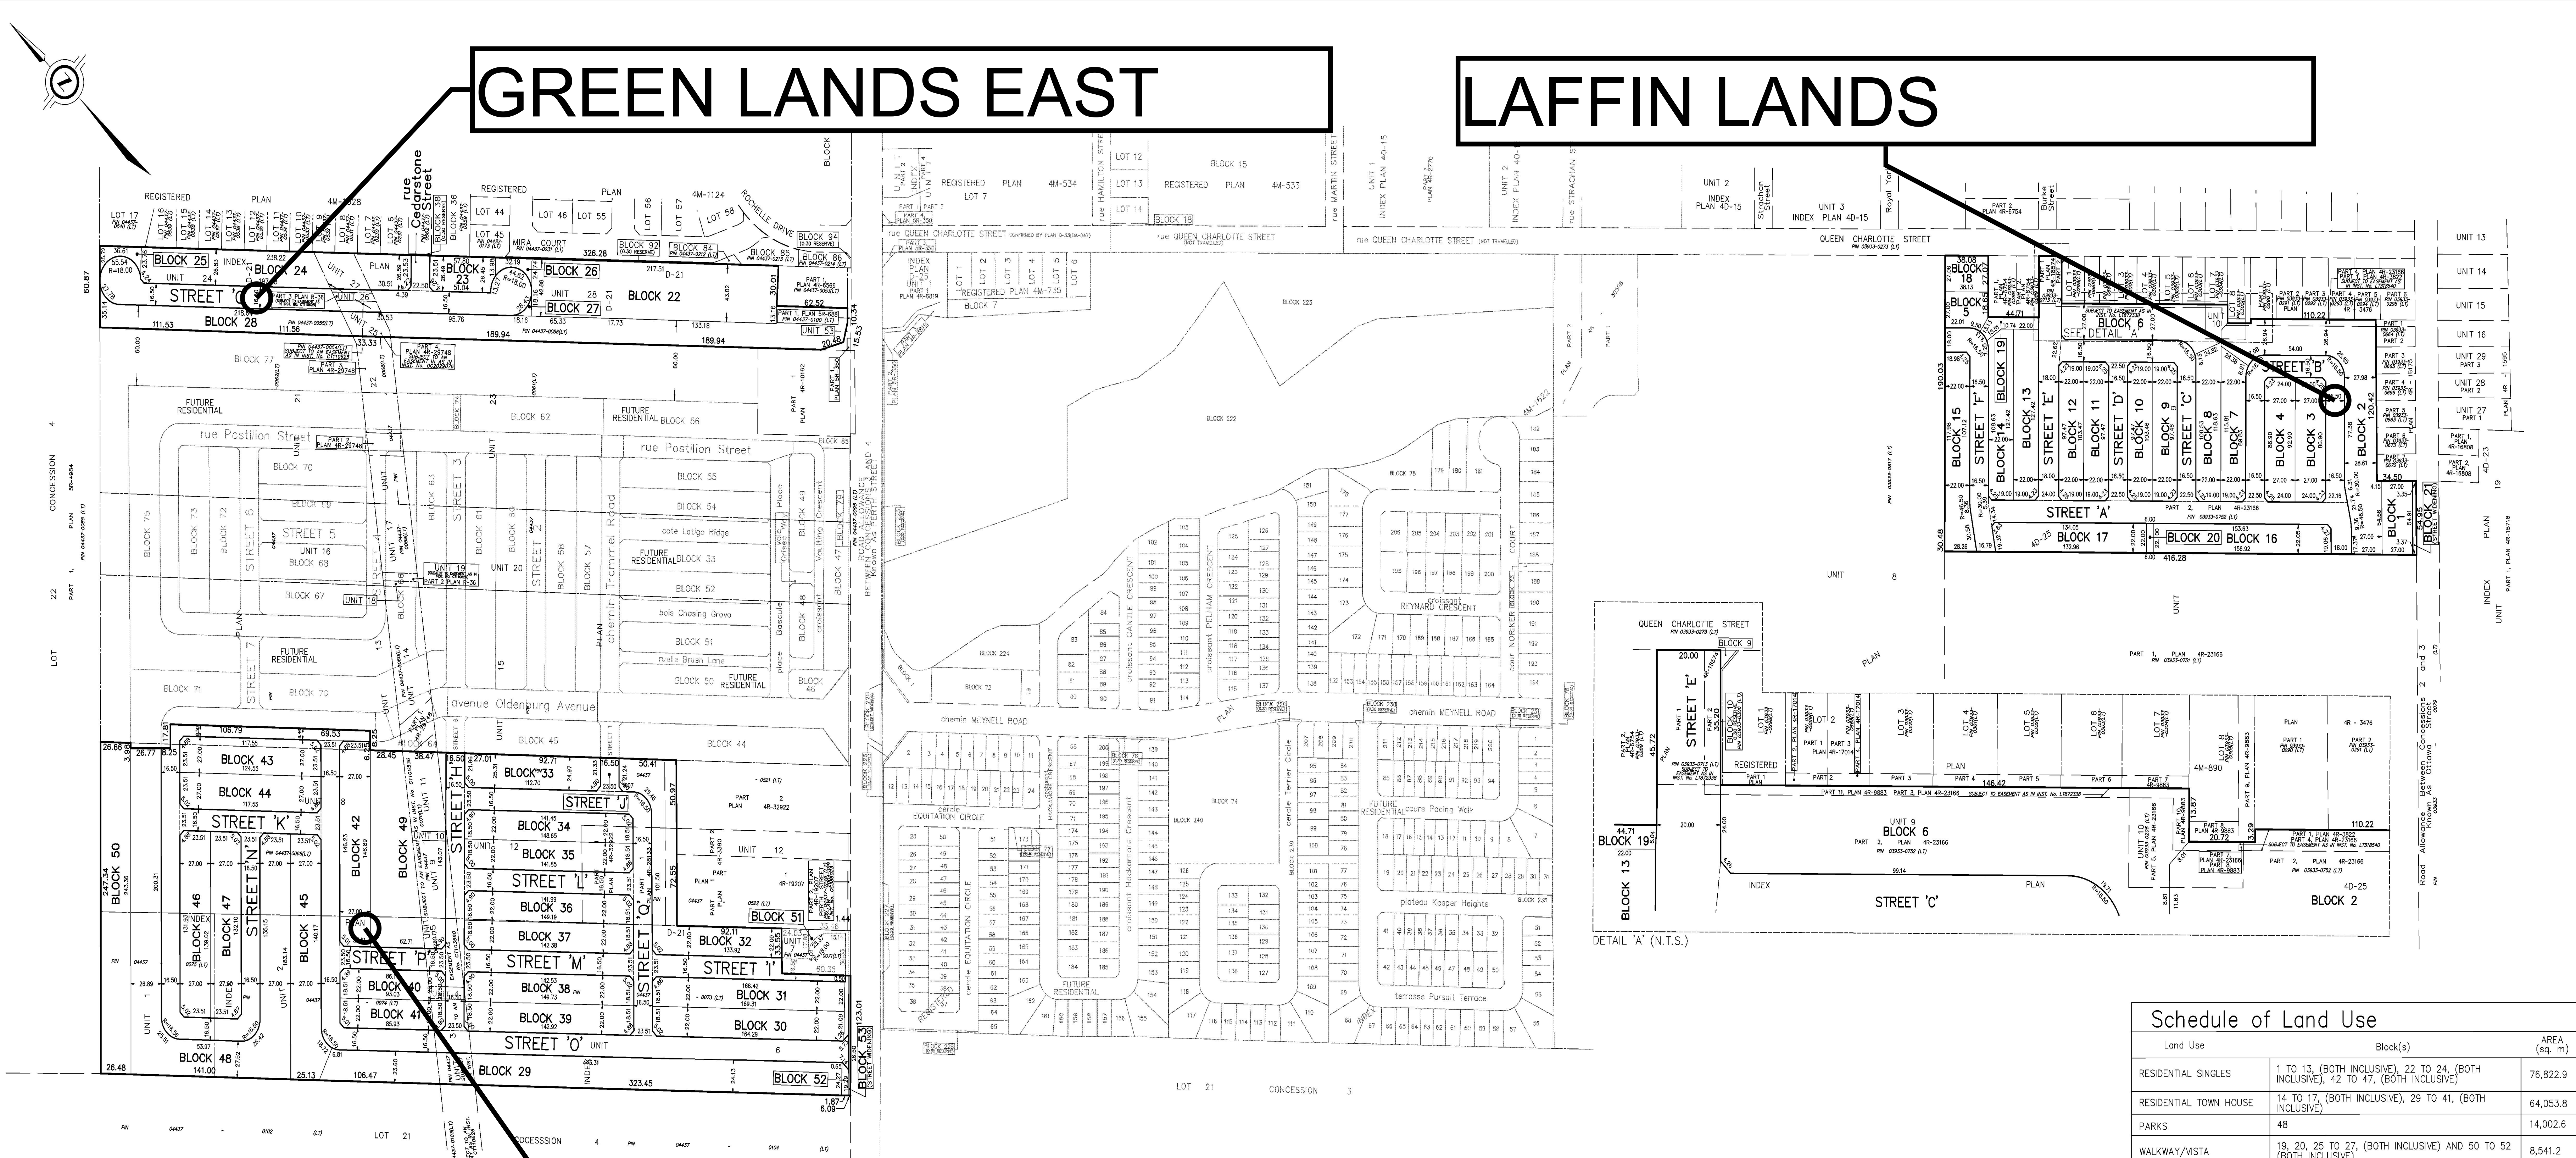

KEY PLAN (NOT TO SCALE)

DRAFT PLAN OF SUBDIVISION OF
**ALL OF UNITS 1, 2, 3, 4, 5, 6, 9,
 10, 11, 24, 25, 26, 27 AND 28 9,
 INDEX PLAN D-21**
 AND
**PART OF UNITS 8, 12 AND 13
 INDEX PLAN D-21**
 AND
**PART OF UNITS 9 AND 10
 INDEX PLAN 4D-25**
 (GEOGRAPHIC TOWNSHIP OF GOULBOURN)
 NOW IN THE
CITY OF OTTAWA
 J. D. BARNES LIMITED
 © COPYRIGHT 2021

ELEVATION NOTE

1. ELEVATIONS SHOWN ON THIS PLAN ARE RELATED TO GEODETIC DATUM AND ARE DERIVED FROM THE MUNICIPALITY'S BENCHMARK NO. 0011980724 HAVING A PUBLISHED ELEVATION OF 95.05 METRES.

2. IT IS THE RESPONSIBILITY OF THE USER OF THIS INFORMATION TO VERIFY THAT THE BENCHMARK HAS NOT BEEN ALTERED OR DISTURBED AND THAT ITS RELATIVE ELEVATION AND DESCRIPTION AGREES WITH THE INFORMATION SHOWN ON THIS DRAWING.

NOTES

DISTANCES ARE GROUND.
 ALL DISTANCES ON CURVES ARE ARC DISTANCES UNLESS OTHERWISE SPECIFIED.

ADDITIONAL INFORMATION
 As required under section 51(17) of the Planning Act R.S.O. 2001

- (a)(b)(i)(ii)(iii) and (i) - As shown on this Plan.
- (c) - As shown on this Draft and Key Plan.
- (d) - Land to be used in accordance with the Schedule of Land Use.
- (i) - Full Municipal Services
- (j) - Ottawa Marine Deposits of clay, silt and sand, Bedrock Ottawa Formation, limestone.

SUBJECT TO THE CONDITIONS, IF ANY, SET FORTH IN OUR LETTER DATED: _____ THIS DRAFT PLAN IS APPROVED BY THE CITY OF OTTAWA UNDER SECTION 51 OF THE PLANNING ACT THIS _____ DAY OF _____, 2021.

LELY XU, MPP, RPP, MANAGER
 DEVELOPMENT REVIEW SOUTH
 PLANNING, INFRASTRUCTURE, AND ECONOMIC DEVELOPMENT DEPARTMENT,
 CITY OF OTTAWA

OWNER'S CERTIFICATE
 RICHMOND VILLAGE DEVELOPMENT CORPORATION, BEING THE REGISTERED OWNER OF THE SUBJECT LANDS HEREBY AUTHORIZES J. D. BARNES LIMITED TO PREPARE AND SUBMIT THIS DRAFT PLAN OF SUBDIVISION FOR APPROVAL.


DATE: _____
 FRANK CARO
 PRESIDENT
 (I HAVE THE AUTHORITY TO BIND THE CORPORATION)
RICHMOND VILLAGE DEVELOPMENT CORPORATION

SURVEYOR'S CERTIFICATE
 I HEREBY CERTIFY THAT THE BOUNDARIES OF THE LAND TO BE SUBDIVIDED ARE CORRECTLY SHOWN.

DATE: _____
 FOR REVIEW
 C.M. FOX
 ONTARIO LAND SURVEYOR


Land Use	Block(s)	AREA (sq. m)
RESIDENTIAL SINGLES	1 TO 13, (BOTH INCLUSIVE), 22 TO 24, (BOTH INCLUSIVE), 42 TO 47, (BOTH INCLUSIVE)	76,822.9
RESIDENTIAL TOWN HOUSE	14 TO 17, (BOTH INCLUSIVE), 29 TO 41, (BOTH INCLUSIVE)	64,053.8
PARKS	48	14,002.6
WALKWAY/VISTA	19, 20, 25 TO 27, (BOTH INCLUSIVE) AND 50 TO 52 (BOTH INCLUSIVE)	8,541.2
NATURAL HERITAGE SYSTEM	18, 28, AND 49	23,757.6
STREETS	'A' TO 'O', (BOTH INCLUSIVE), AND rue Cedarstone Street	70,690.8
STREET WIDENING	21 AND 53	388.0
Total		258,256.9

J.D. BARNES SURVEYING
 LAND INFORMATION SPECIALISTS
 45 STANLEY DRIVE, SUITE 103, KANATA, ON K2K 2A9
 T: (613) 751-7244 F: (613) 254-8809 www.jdbarnes.com

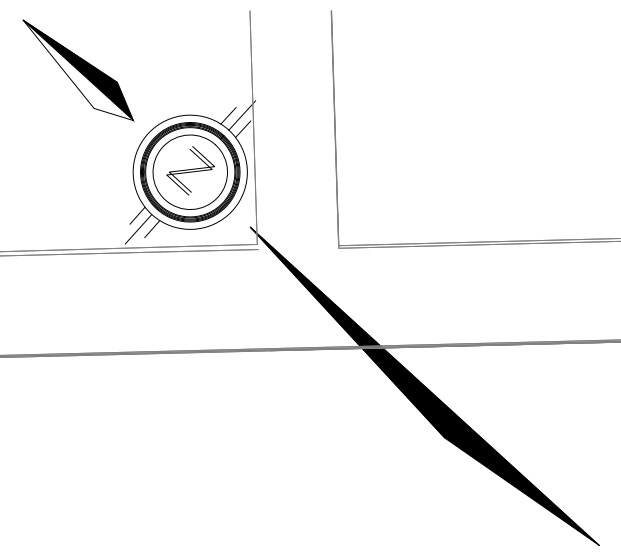





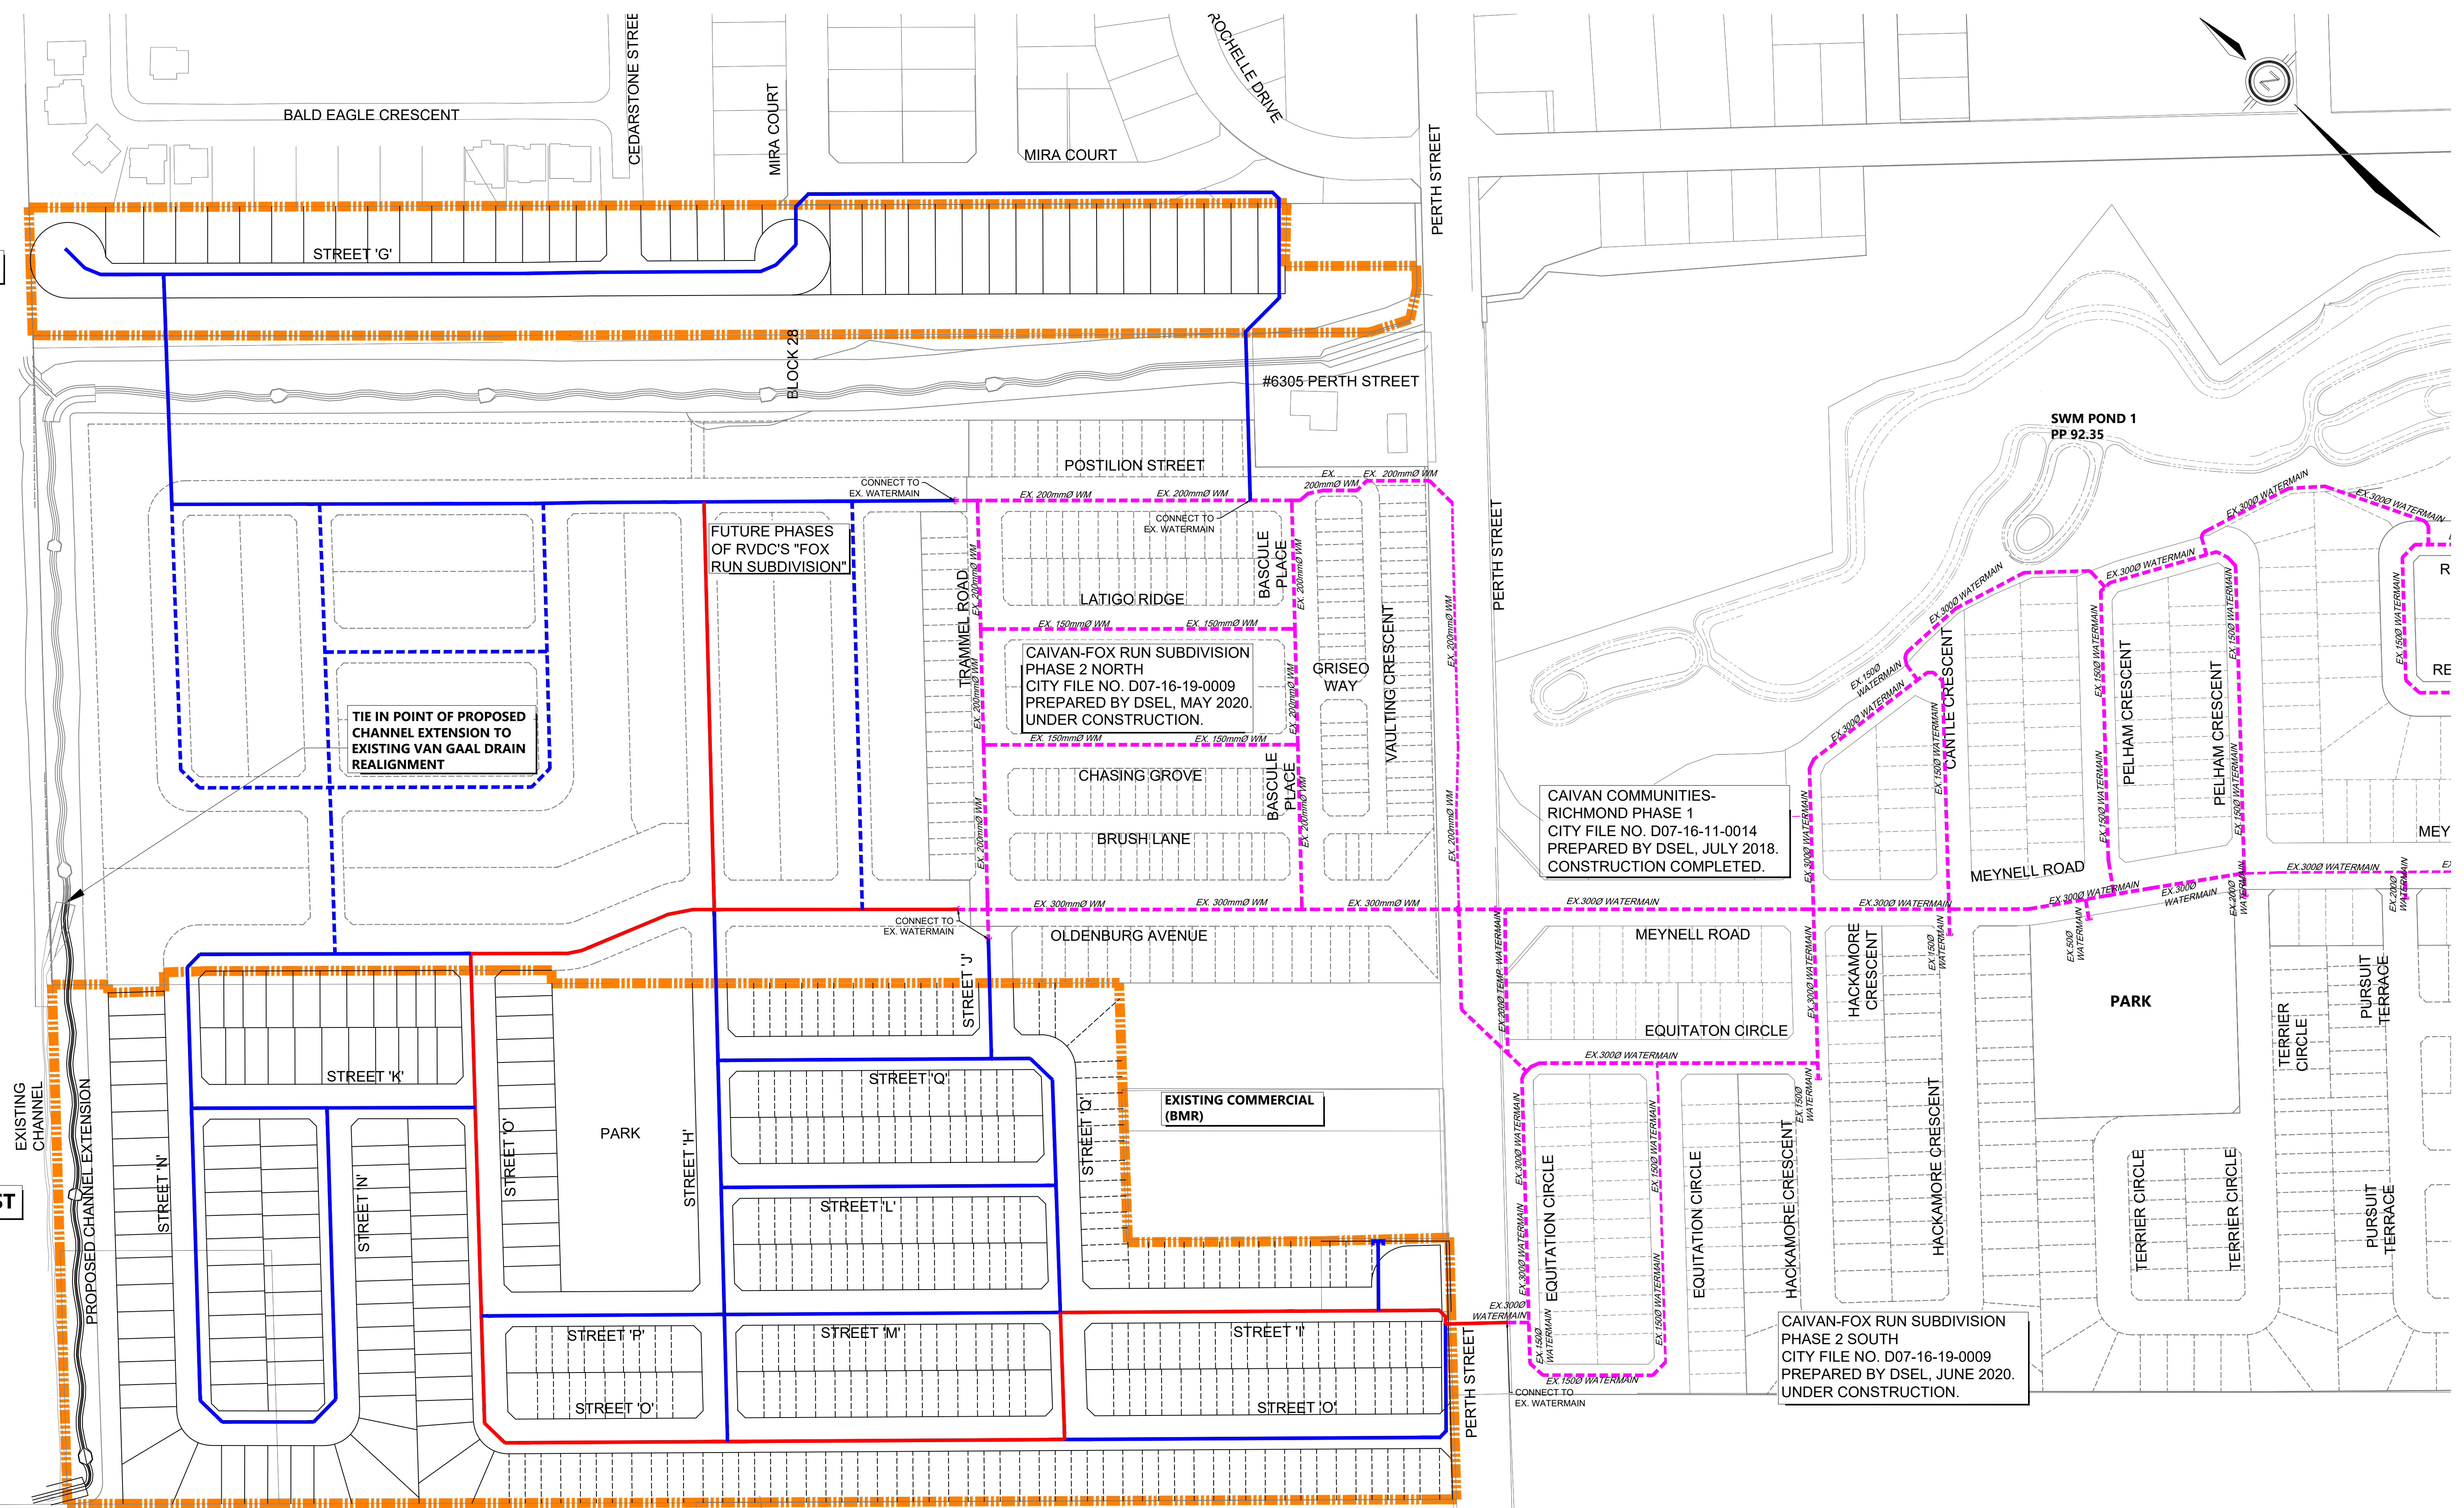


GREEN LANDS EAST

GREEN LANDS WEST



LEGEND


	SUBJECT LANDS		PROPOSED 3000 WATERMAIN
	PROPOSED LOCAL WATERMAIN		PLUG
	EXISTING WATERMAIN		FUTURE 3000 WATERMAIN
			FUTURE LOCAL WATERMAIN

DSEL
 david schaeffer engineering ltd
 120 Iker Road, Unit 103
 Stittsville, Ontario, K2S 1E9
 Tel: (613) 836-8856
 Fax: (613) 836-7183
 www.DSEL.ca

RICHMOND VILLAGE
 DEVELOPMENT
 CORPORATION
 CITY OF OTTAWA

WATERMAIN SERVICING PLAN
 GREEN LANDS WEST AND EAST

SCALE:	1:1500	PROJECT No.:	1183
DATE:	FEBRUARY 2021	FIGURE:	3A

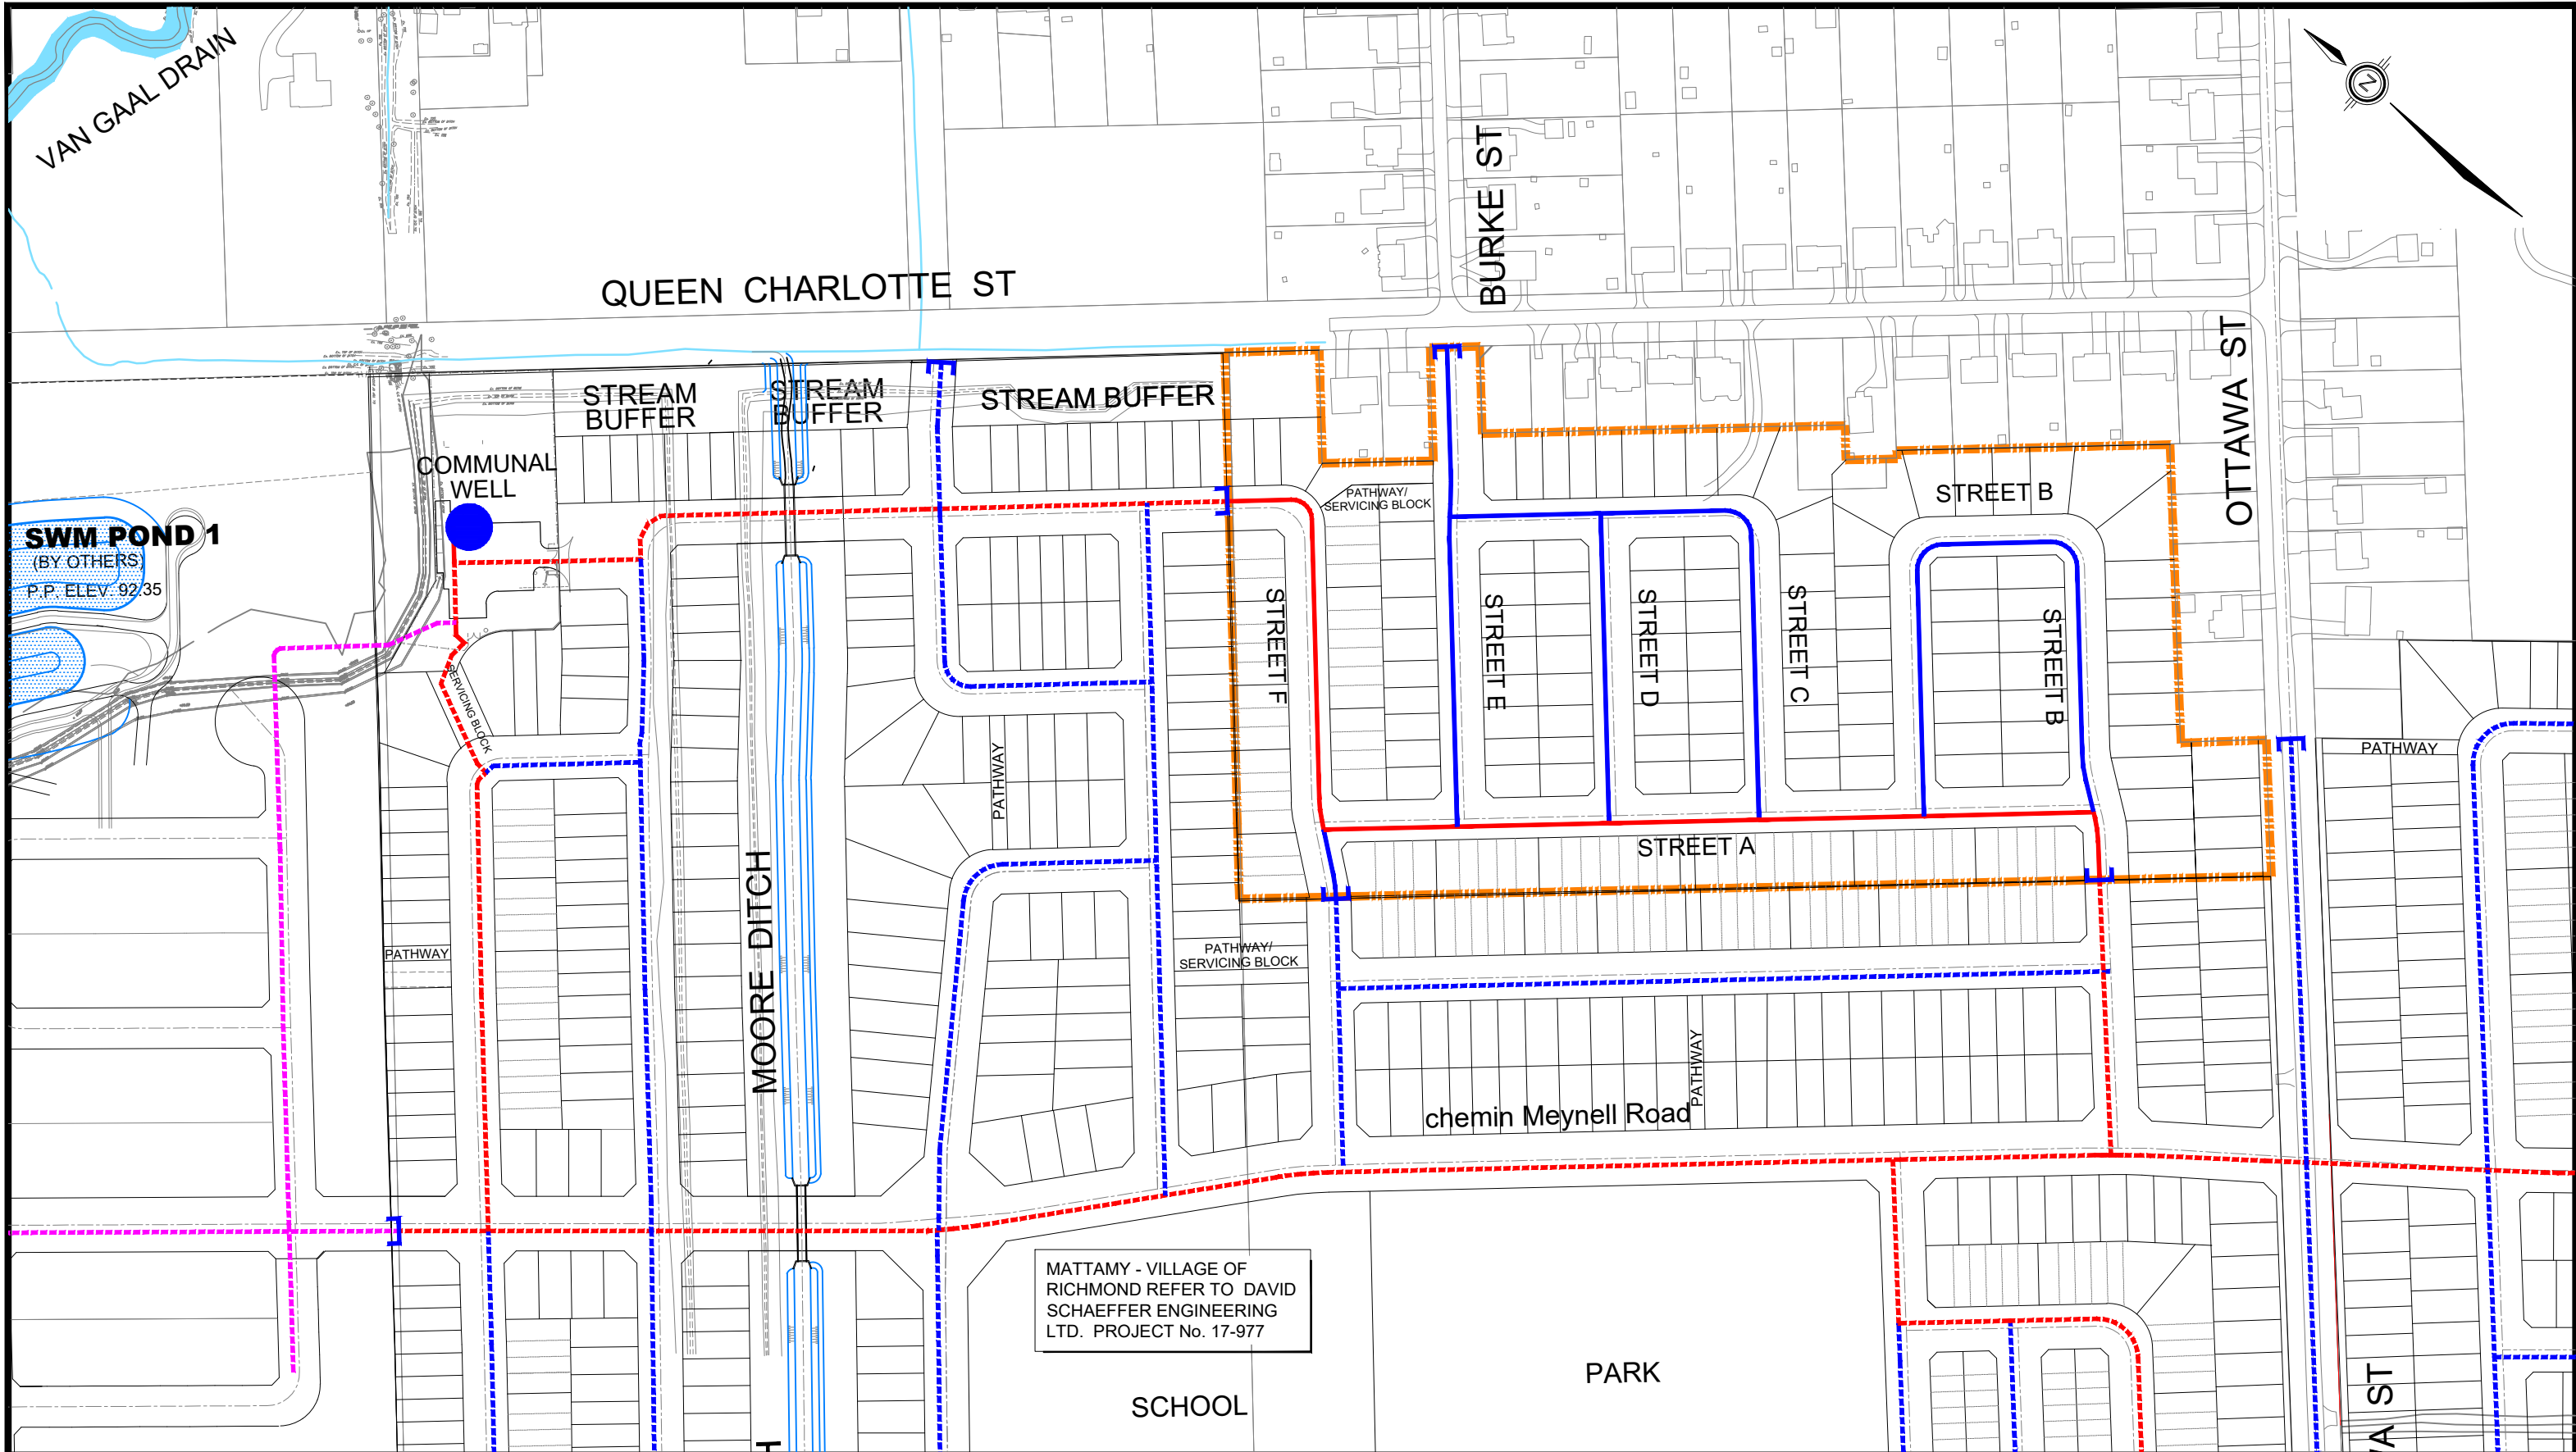

120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca



LEGEND

- - - SUBJECT LANDS
- - - PROP 3000 WATERMAIN
- - - PROP LOCAL WATERMAIN
- - - LOCAL WATERMAIN (BY OTHERS)
- - - 3000 WATERMAIN (BY OTHERS)
- - - EXISTING WATERMAIN
- PLUG
- COMMUNAL WELL

**RICHMOND VILLAGE
DEVELOPMENT CORPORATION
CONCEPTUAL WATERMAIN
CITY OF OTTAWA**

LAFFIN LANDS

PROJECT No.:	20-1184
DATE:	February 2021
SCALE:	1:2500
FIGURE:	3B

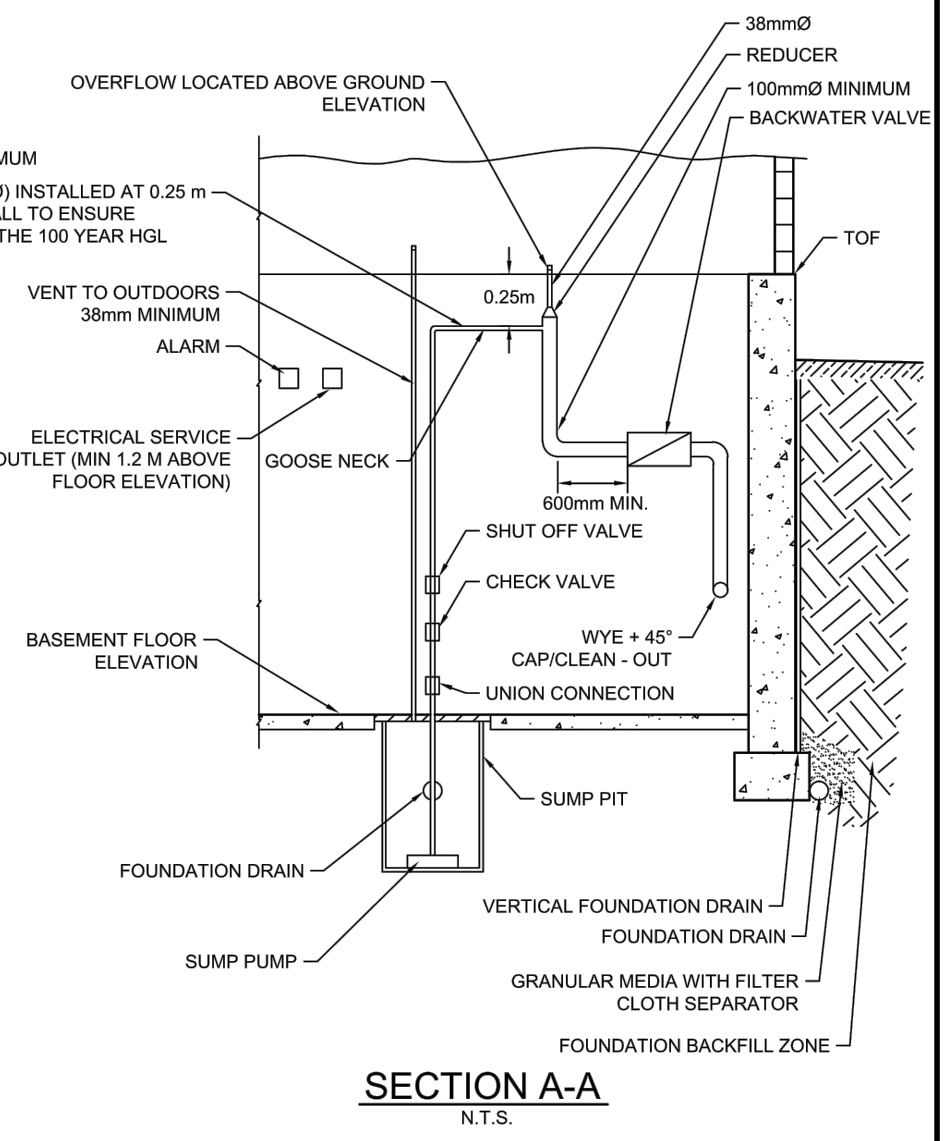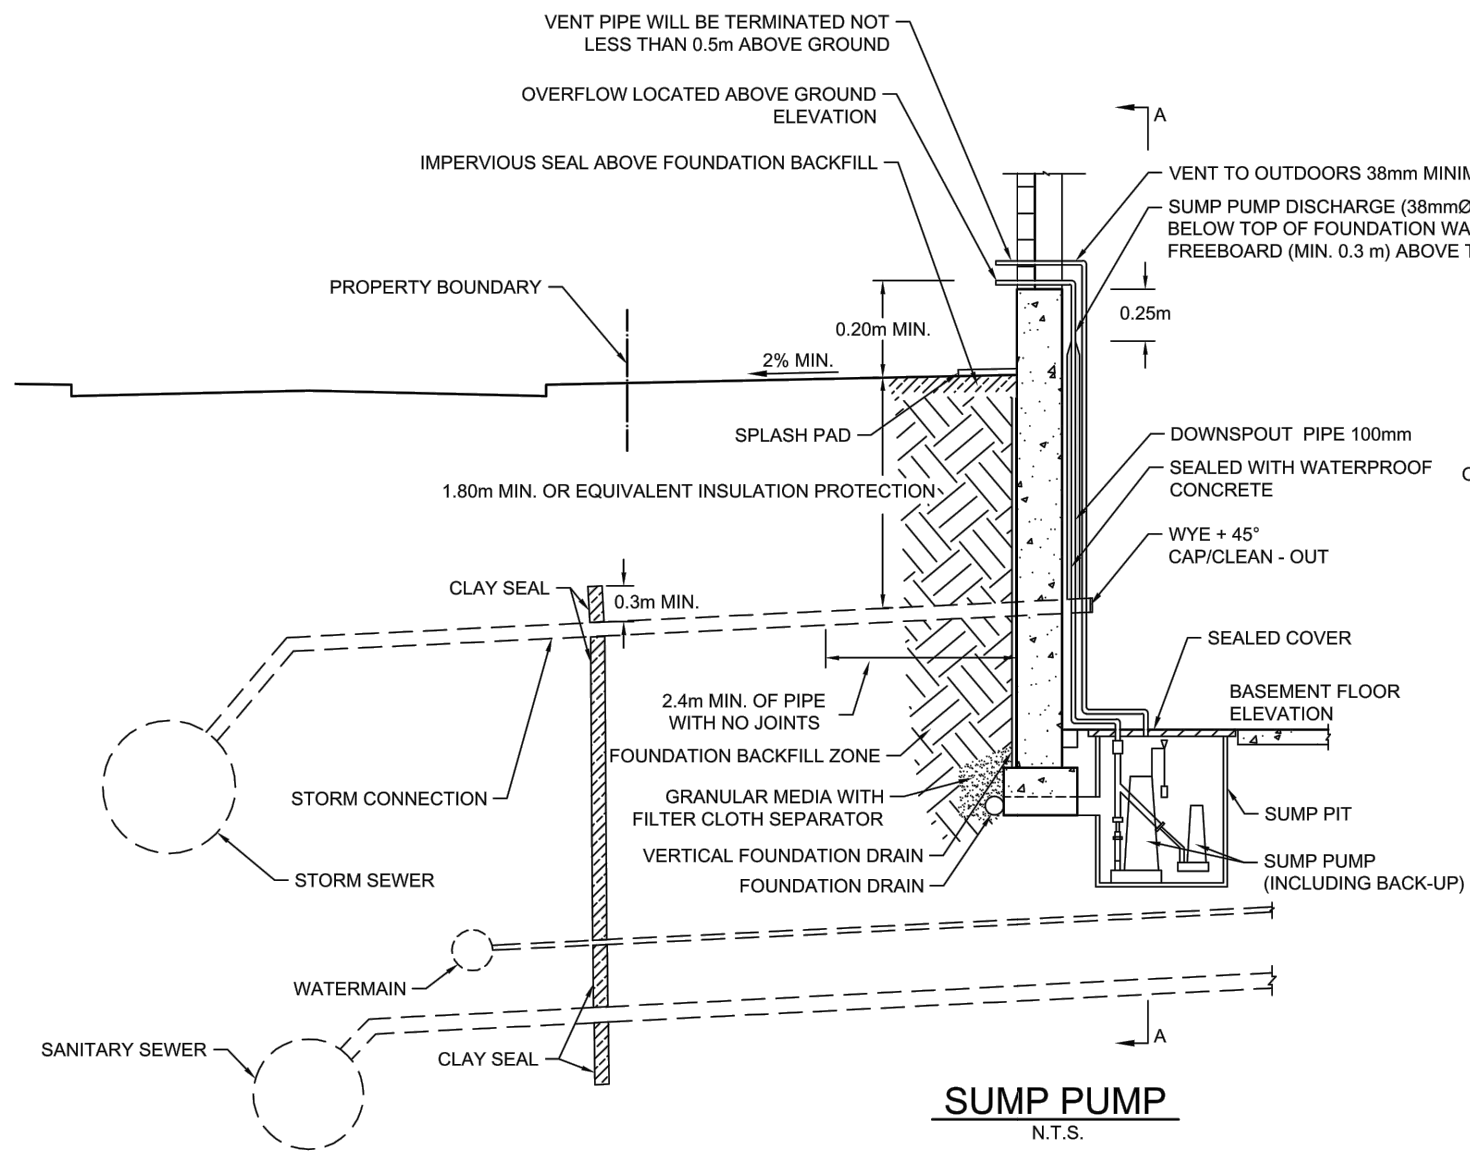

- NOTES:
1. WORKS TO BE COMPLETED IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS, POLICIES AND GUIDELINES.
 2. PRIMARY DISCHARGE TO STORM SEWER WITH OVERFLOW TO GRADE, AS INDICATED.
 3. SERVICE TRENCH WILL HAVE CLAY SEAL TO PREVENT GROUNDWATER FLOW THROUGH SERVICE TRENCH TO FOUNDATION.
 4. INSULATION DETAIL MUST BE PROVIDED BY PROFESSIONAL ENGINEER.
 5. BACKWATER VALVE TO BE CSA APPROVED COMPLETE WITH ADEQUATE SUPPORT FOR PIPING.
 6. REFER TO GUIDELINES FOR SUMP PIT LOCATION.
 7. IMPERVIOUS SEAL TO EXTEND BEYOND THE LINE OF EXCAVATION, SLOPED AWAY FROM BUILDING A MINIMUM OF 2% AFTER SETTLING OF BACKFILL. SEAL CAN BE CLAY, OR A MEMBRANE OR LOW-PERMEABILITY INSULATION BOARD PLACED JUST BELOW GROUND.
 8. FILL PLACED IN SERVICE TRENCH MUST BE COMPACTED TO AT LEAST 98% OF ITS STANDARD PROCTOR MAXIMUM DRY DENSITY.

9. FOUNDATION BACKFILL ZONE WILL CONSIST OF CLAY WITH A MINIMUM HORIZONTAL WIDTH OF 1.5m.
10. VERTICAL FOUNDATION DRAINS ARE REQUIRED ON THE PERIMETER OF THE FOUNDATION.
11. EVERY SERVICE TRENCH REQUIRES CLAY SEAL AS PER CITY STANDARD S8. CLAY SEAL TO EXTEND A MINIMUM 0.3m ABOVE THE OBVERT OF THE STORM SERVICE PIPE.



STANDARD SUMP PUMP CONFIGURATION
GREENFIELD SUBDIVISIONS WITH CLAY SOILS
AND FULL MUNICIPAL SERVICES

DATE:	JUNE 2018
REV. DATE:	JUNE 2018
DWG. No.:	P 01




120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

RICHMOND VILLAGE
DEVELOPMENT CORPORATION
SUMP PUMP DETAIL
CITY OF OTTAWA

LAFFIN LANDS

PROJECT No.:	20-1184
DATE:	February 2021
SCALE:	N.T.S.
FIGURE:	4

DRAWINGS

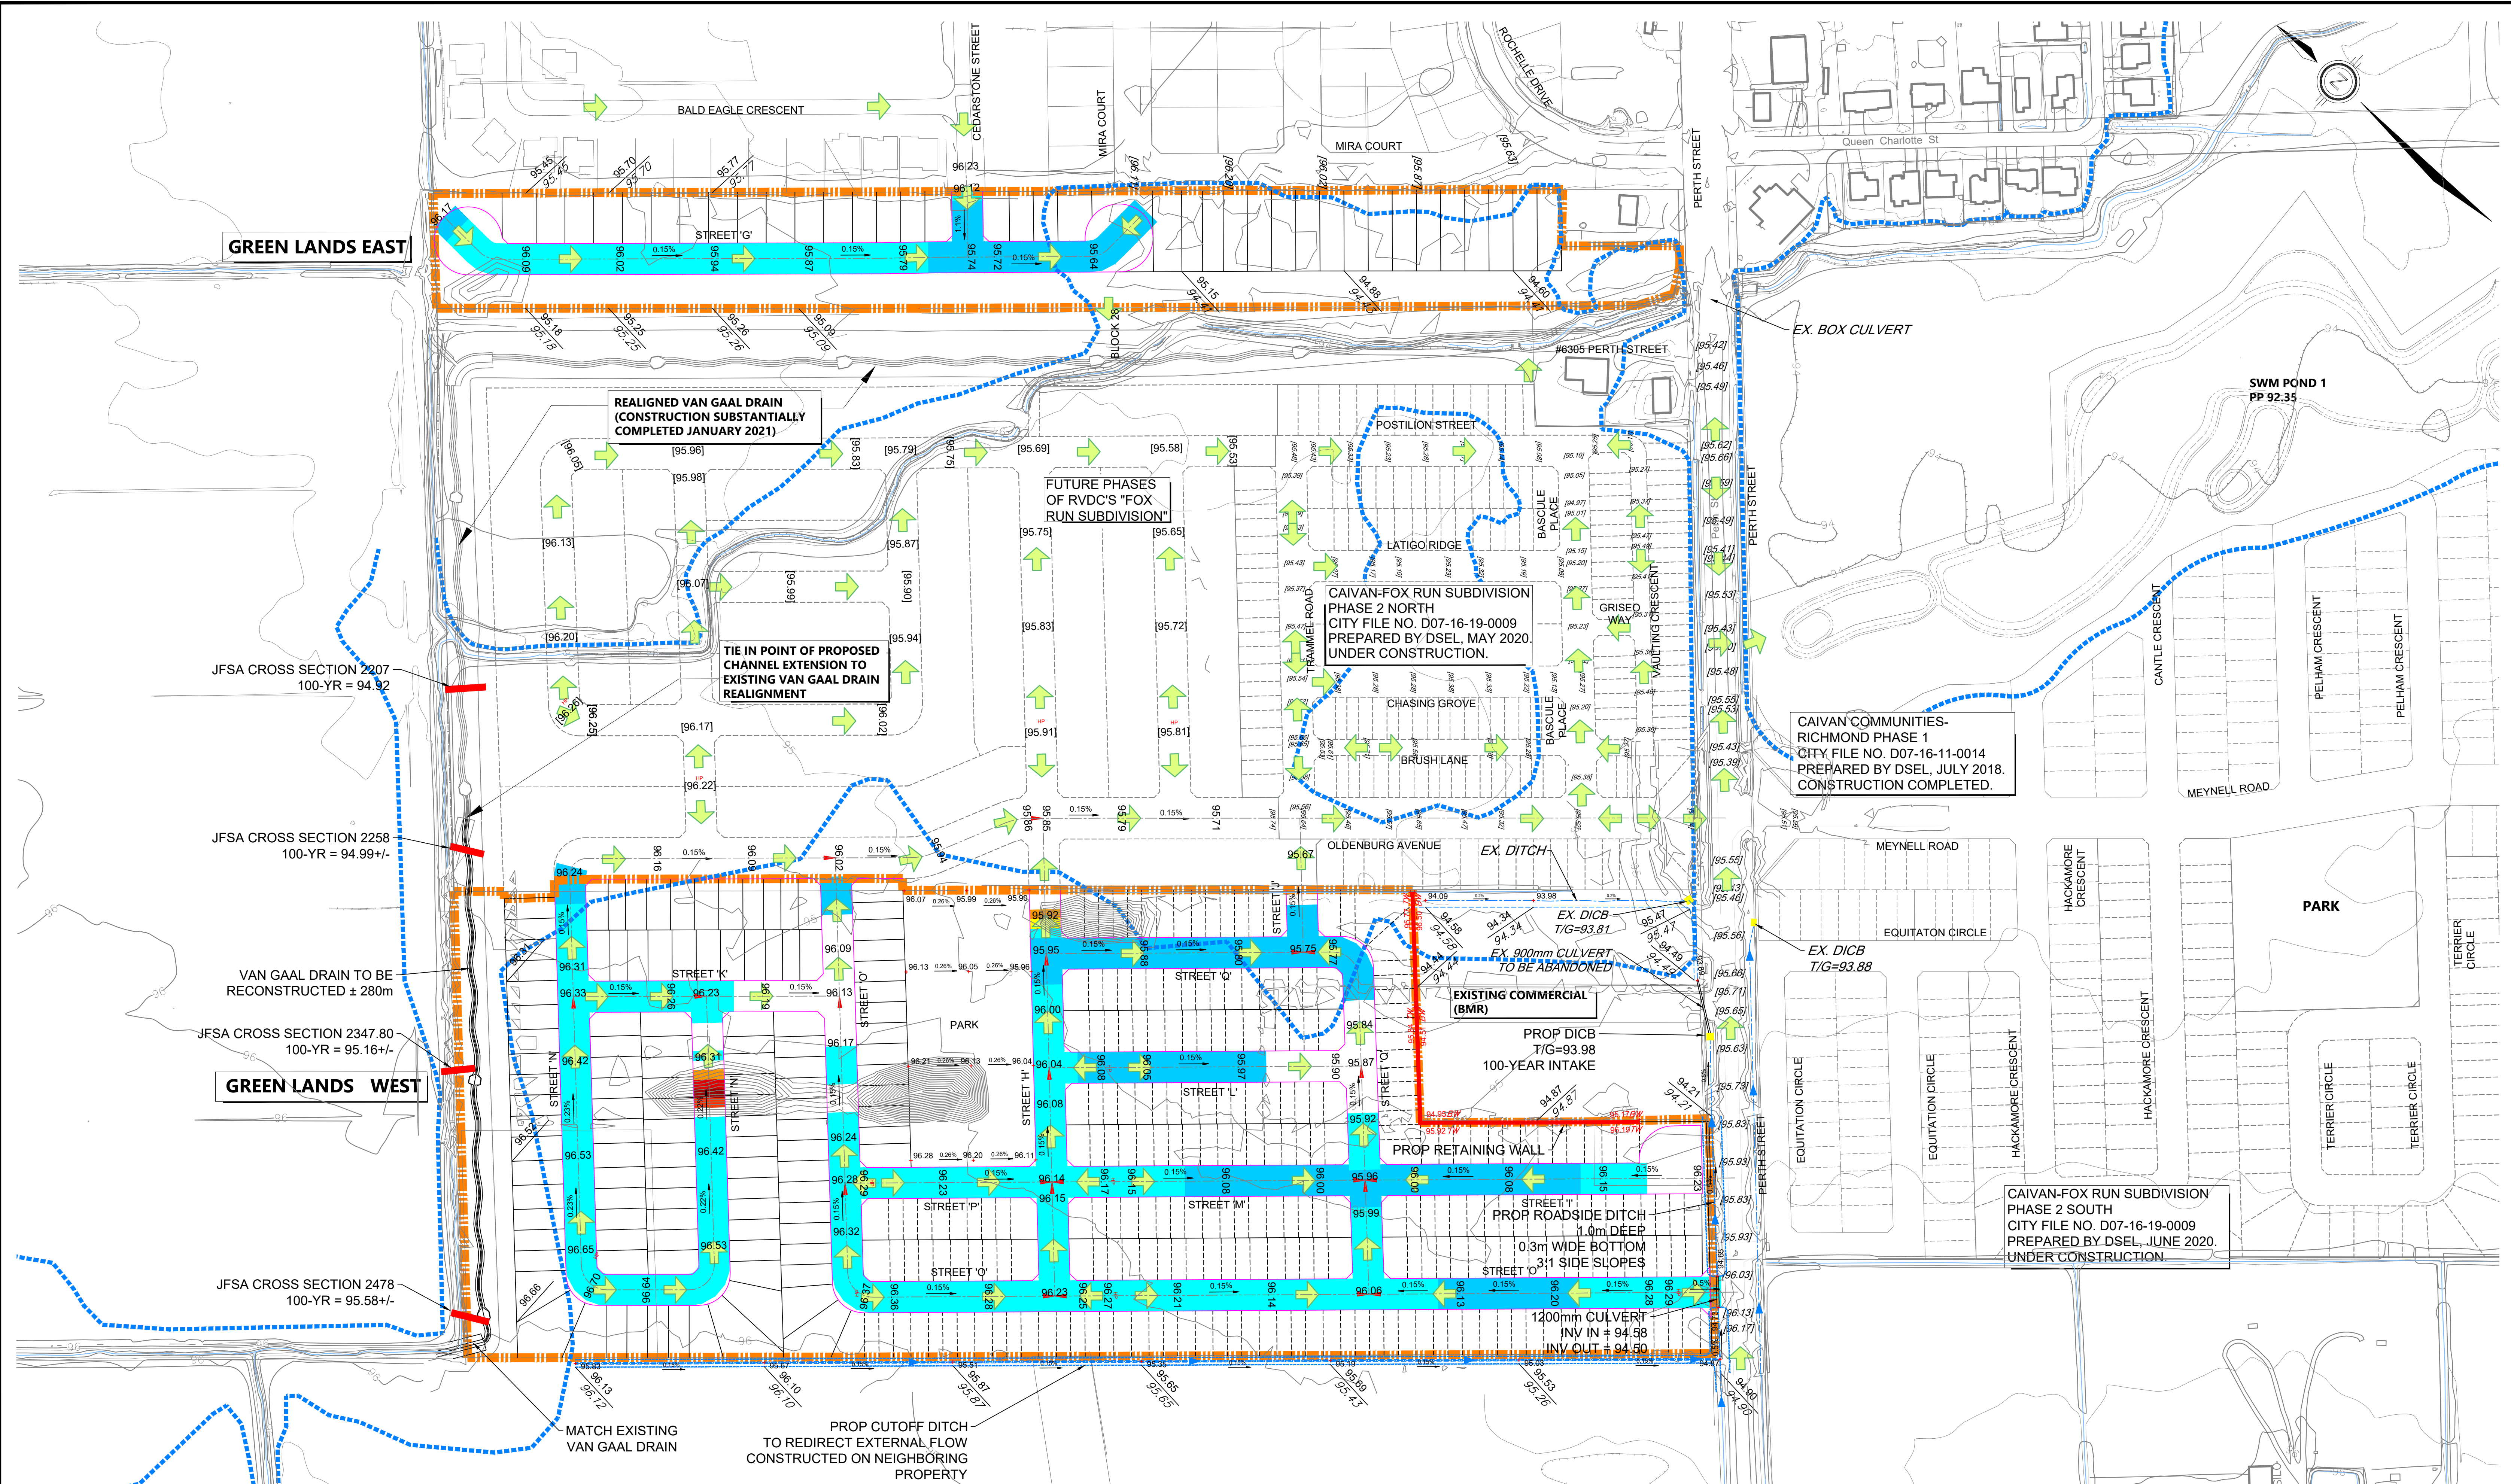

GREEN LANDS EAST

GREEN LANDS WEST

REALIGNED VAN GAAL DRAIN
(CONSTRUCTION SUBSTANTIALLY
COMPLETED JANUARY 2021)

FUTURE PHASES
OF RVDC'S "FOX
RUN SUBDIVISION"

CAIVAN-FOX RUN SUBDIVISION
PHASE 2 NORTH
CITY FILE NO. D07-16-19-0009
PREPARED BY DSEL, MAY 2020.
UNDER CONSTRUCTION.

CAIVAN COMMUNITIES-
RICHMOND PHASE 1
CITY FILE NO. D07-16-11-0014
PREPARED BY DSEL, JULY 2018.
CONSTRUCTION COMPLETED.

CAIVAN-FOX RUN SUBDIVISION
PHASE 2 SOUTH
CITY FILE NO. D07-16-19-0009
PREPARED BY DSEL, JUNE 2020.
UNDER CONSTRUCTION.

JFSA CROSS SECTION 2207
100-YR = 94.92

JFSA CROSS SECTION 2258
100-YR = 94.99+/-

VAN GAAL DRAIN TO BE
RECONSTRUCTED ± 280m

JFSA CROSS SECTION 2347.80
100-YR = 95.16+/-

JFSA CROSS SECTION 2478
100-YR = 95.58+/-

LEGEND

- ▬▬▬▬ SUBJECT LANDS
- ➔ STORM OVERLAND FLOW ARROW
- 192.851 PROPOSED CENTERLINE ELEVATION
- [192.85] FUTURE GRADES (BY OTHERS)
- ▬▬▬▬ 100 YEAR FLOODPLAIN

[192.85]
193.50
193.50
← 1.00m →

EX. GRADES

- PROPOSED ELEVATION
- EXISTING ELEVATION
- EXISTING CONTOUR ELEVATION
- GRADE CHANGE

CUT-FILL DEPTH ALONG CENTER LINE:


CUT DEPTH (m)		FILL DEPTH (m)	
0 - 0.5	 	0 - 0.5	
0.5 - 1.0	 	0.5 - 1.0	
1.0 - 1.5	 	1.0 - 1.5	
1.5 - 2.0	 	1.5 - 2.0	
2.0 - 2.5	 	2.0 - 2.5	
> 2.5	 	> 2.5	

DSEL
david schaeffer engineering ltd
120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel: (613) 836-8856
Fax: (613) 836-7183
www.DSEL.ca

**RICHMOND VILLAGE
DEVELOPMENT
CORPORATION
CITY OF OTTAWA**

**GRADING PLAN
GREEN LANDS WEST AND EAST**

SCALE:	1:1500	PROJECT No.:	1183
DATE:	FEBRUARY 2021	DRAWING:	1A

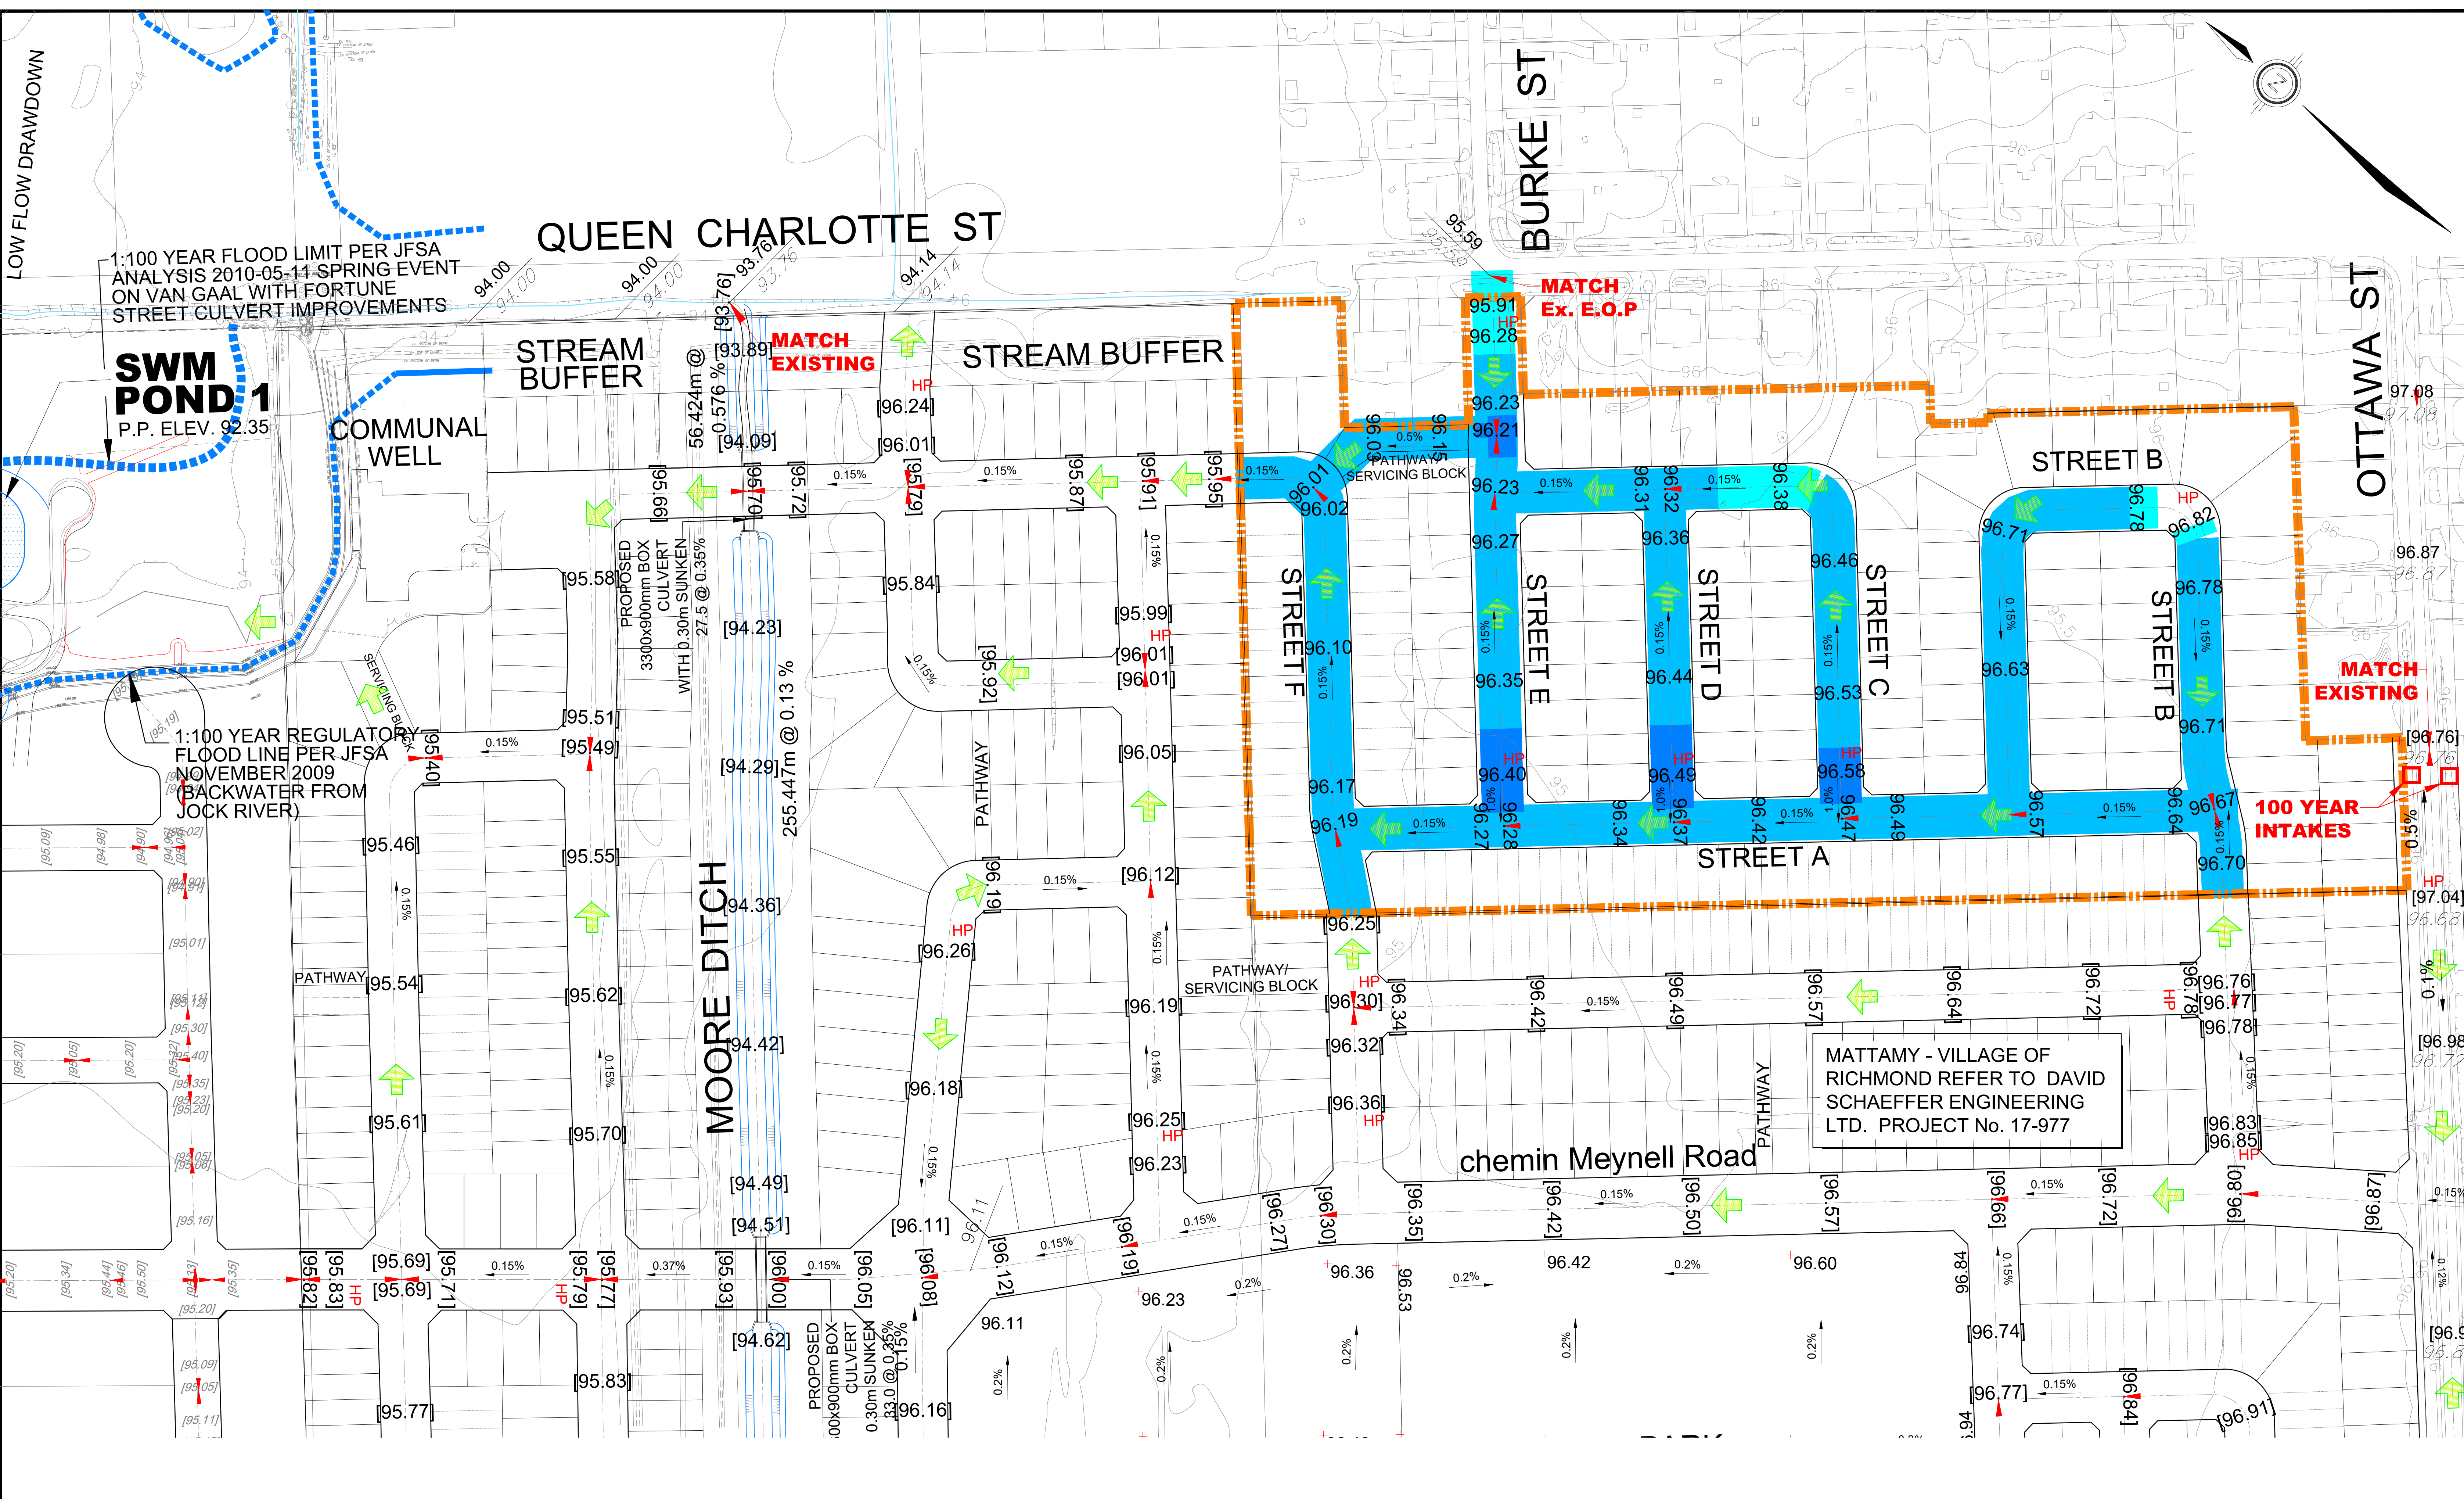

LEGEND

- SUBJECT LANDS
- EXISTING DITCH
- EXISTING ELEVATION CONTOUR
- MAJOR OVERLAND FLOW
- EXTERNAL DRAINAGE
- PROPOSED ELEVATION

96.73 EXISTING ELEVATION
[96.73] FUTURE ELEVATION BY OTHERS

CUT-FILL DEPTH ALONG CENTER LINE:

CUT DEPTH (m)	FILL DEPTH (m)
0.00-0.50	0.00-0.50
0.50-1.00	0.50-1.00
1.00-1.50	1.00-1.50
1.50-2.00	1.50-2.00
>2.00	>2.00

DSEL
david schaeffer engineering ltd
120 Ibro Road, Unit 103
Stittville, Ontario, K2S 1E9
Tel: (613) 836-8856
Fax: (613) 836-7183
www.DSEL.ca


RICHMOND VILLAGE DEVELOPMENT CORPORATION
CITY OF OTTAWA

GRADING PLAN LAFFIN LANDS

SCALE: 1:1000 PROJECT No.: 20-1184
DATE: FEBRUARY 2021 DRAWING: 1B

GREEN LANDS EAST

GREEN LANDS WEST

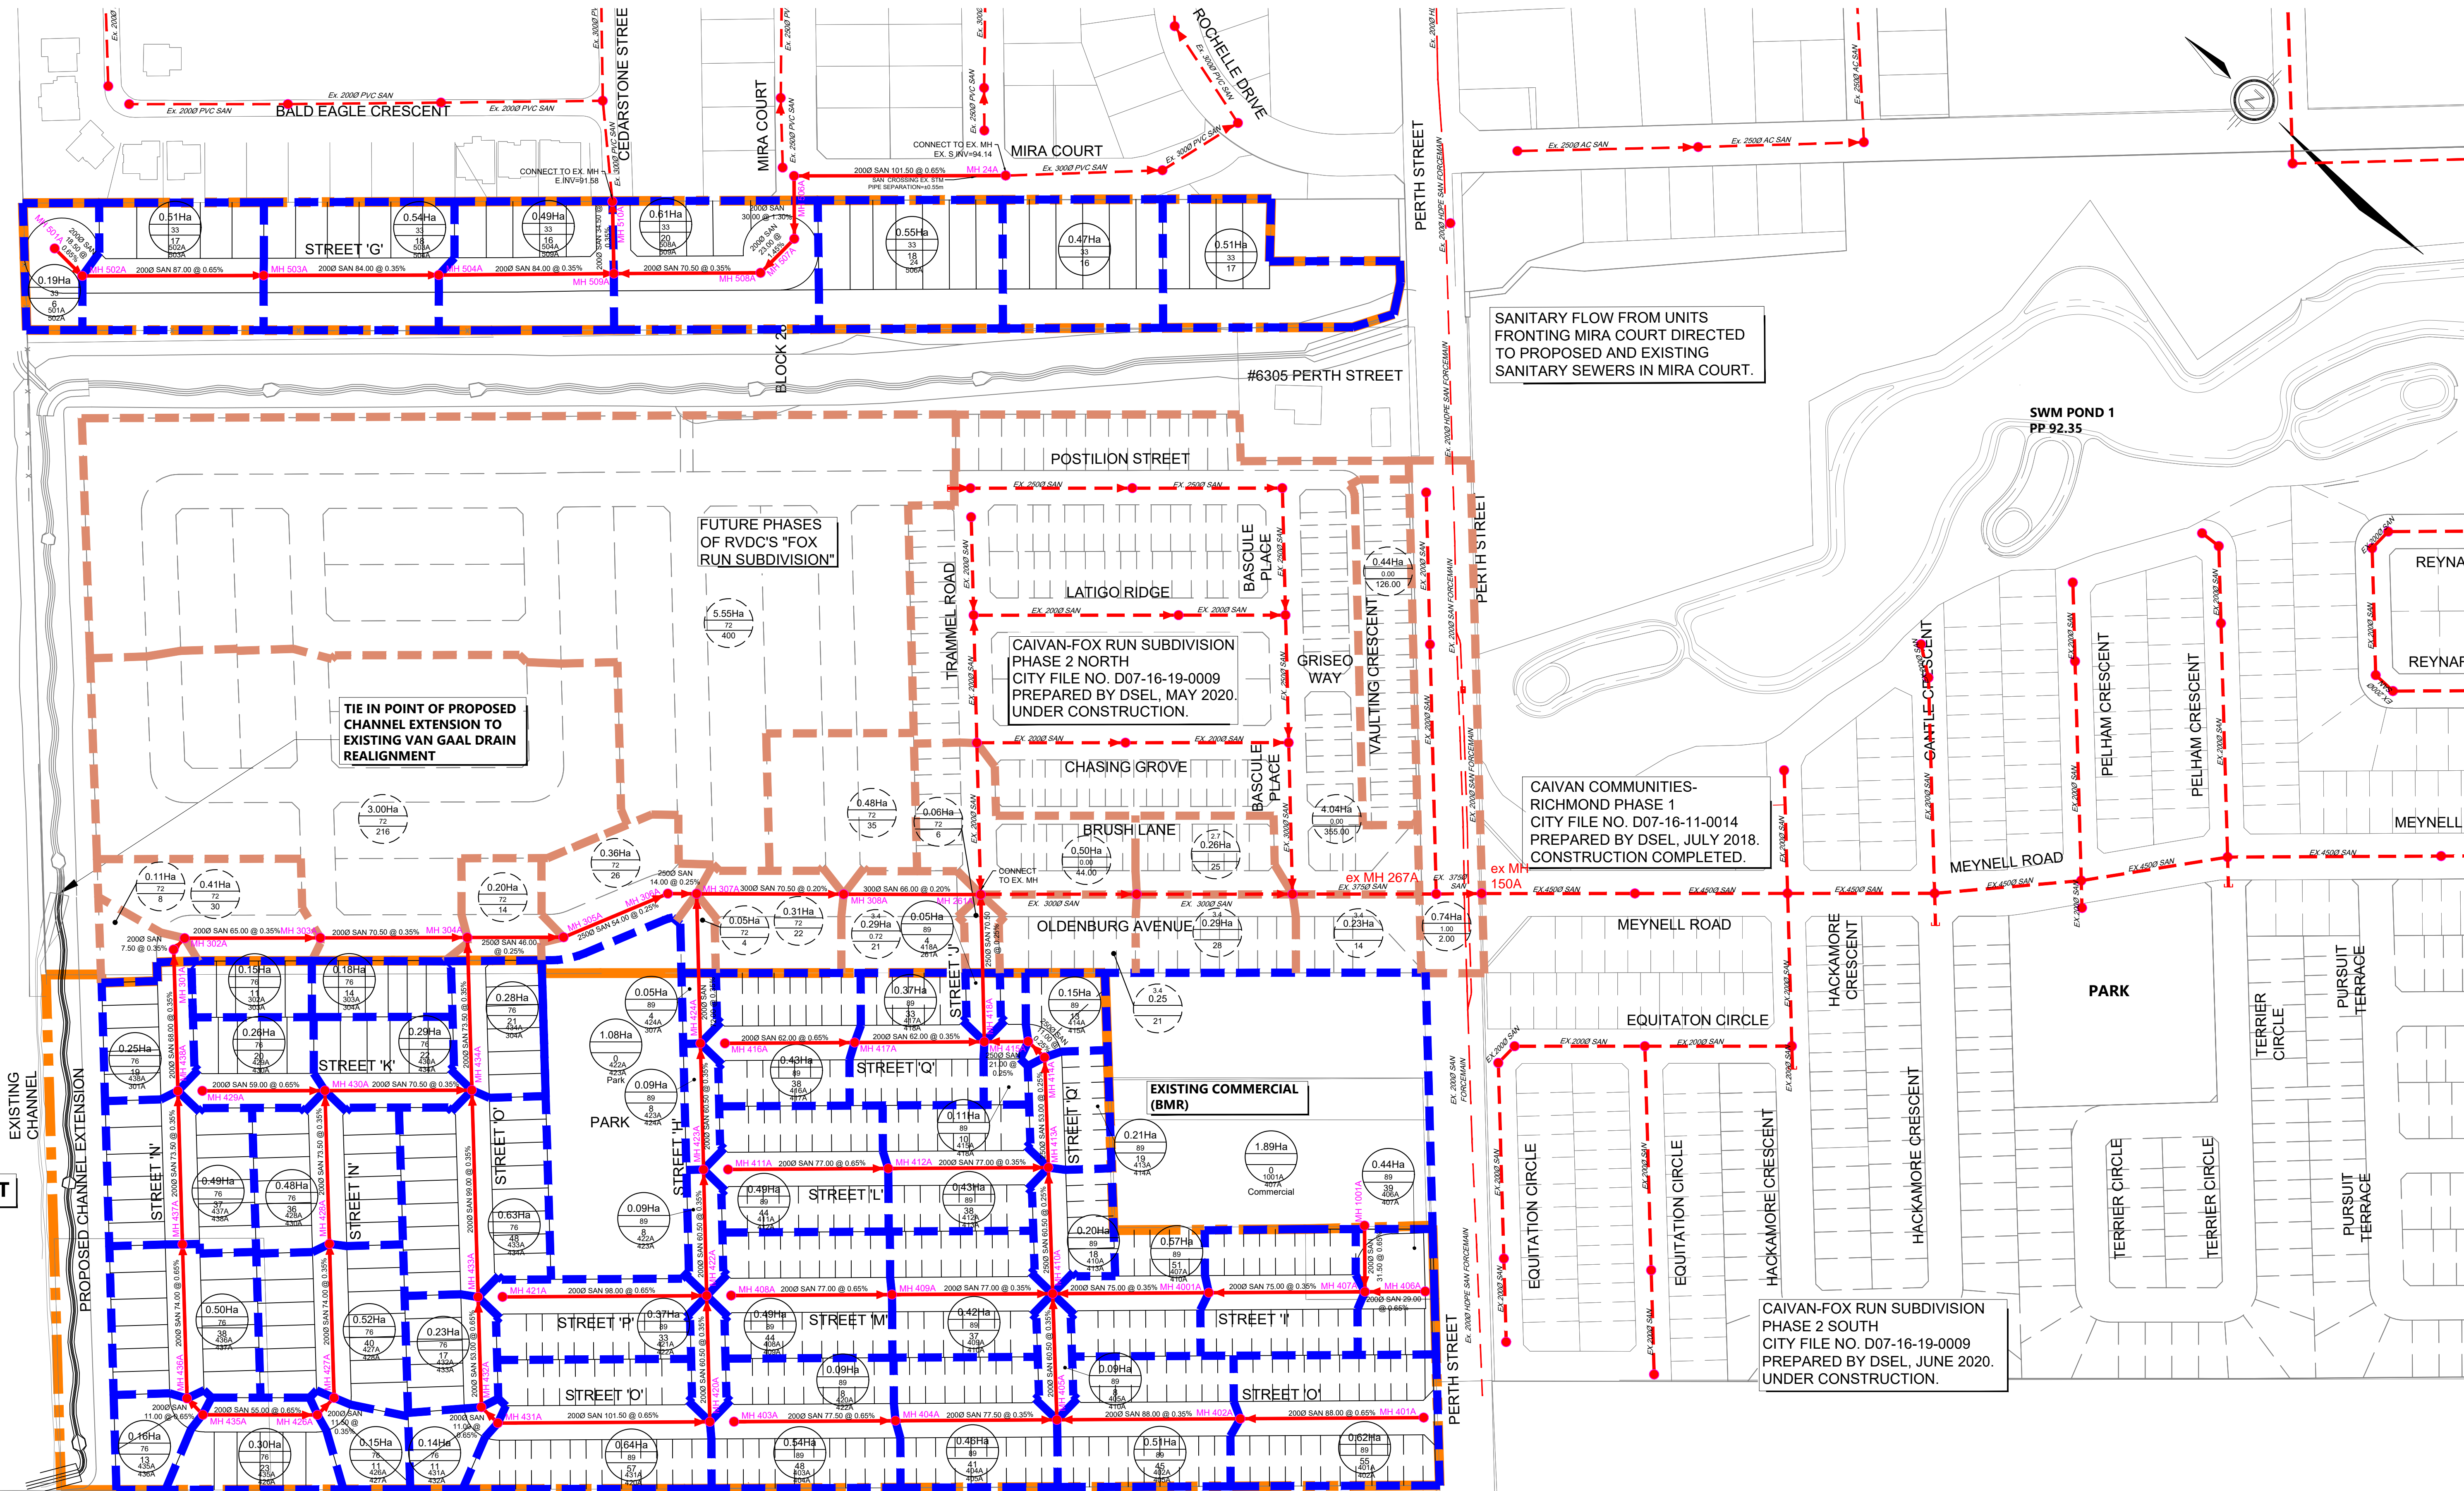

LEGEND



- — — — SUBJECT LANDS
- — — — SANITARY DRAINAGE BOUNDARY
- — — — PROPOSED SANITARY SEWER
- — — — EXTERNAL SANITARY DRAINAGE BOUNDARY
- - - - - EXISTING SANITARY SEWER
- 3.4
0.77
63
11.4 POPULATION PER UNIT
SANITARY DRAINAGE AREA
NUMBER OF UNITS
TOTAL POPULATION
UPSTREAM/DOWNSTREAM MANHOLE
- 3.4
0.30
60
18 POPULATION PER UNIT
EXTERNAL DRAINAGE AREA IN HECTARES
POPULATION PER HA
POPULATION
- SANITARY MANHOLE

DSEL
david schaeffer engineering ltd
120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel: (613) 836-8856
Fax: (613) 836-7183
www.DSEL.ca

RICHMOND VILLAGE
DEVELOPMENT
CORPORATION
CITY OF OTTAWA

SANITARY SERVICING PLAN
GREENLANDS EAST & WEST

SCALE: 1:1500 PROJECT No.: 1183
DATE: FEBRUARY 2021 DRAWING: 2A

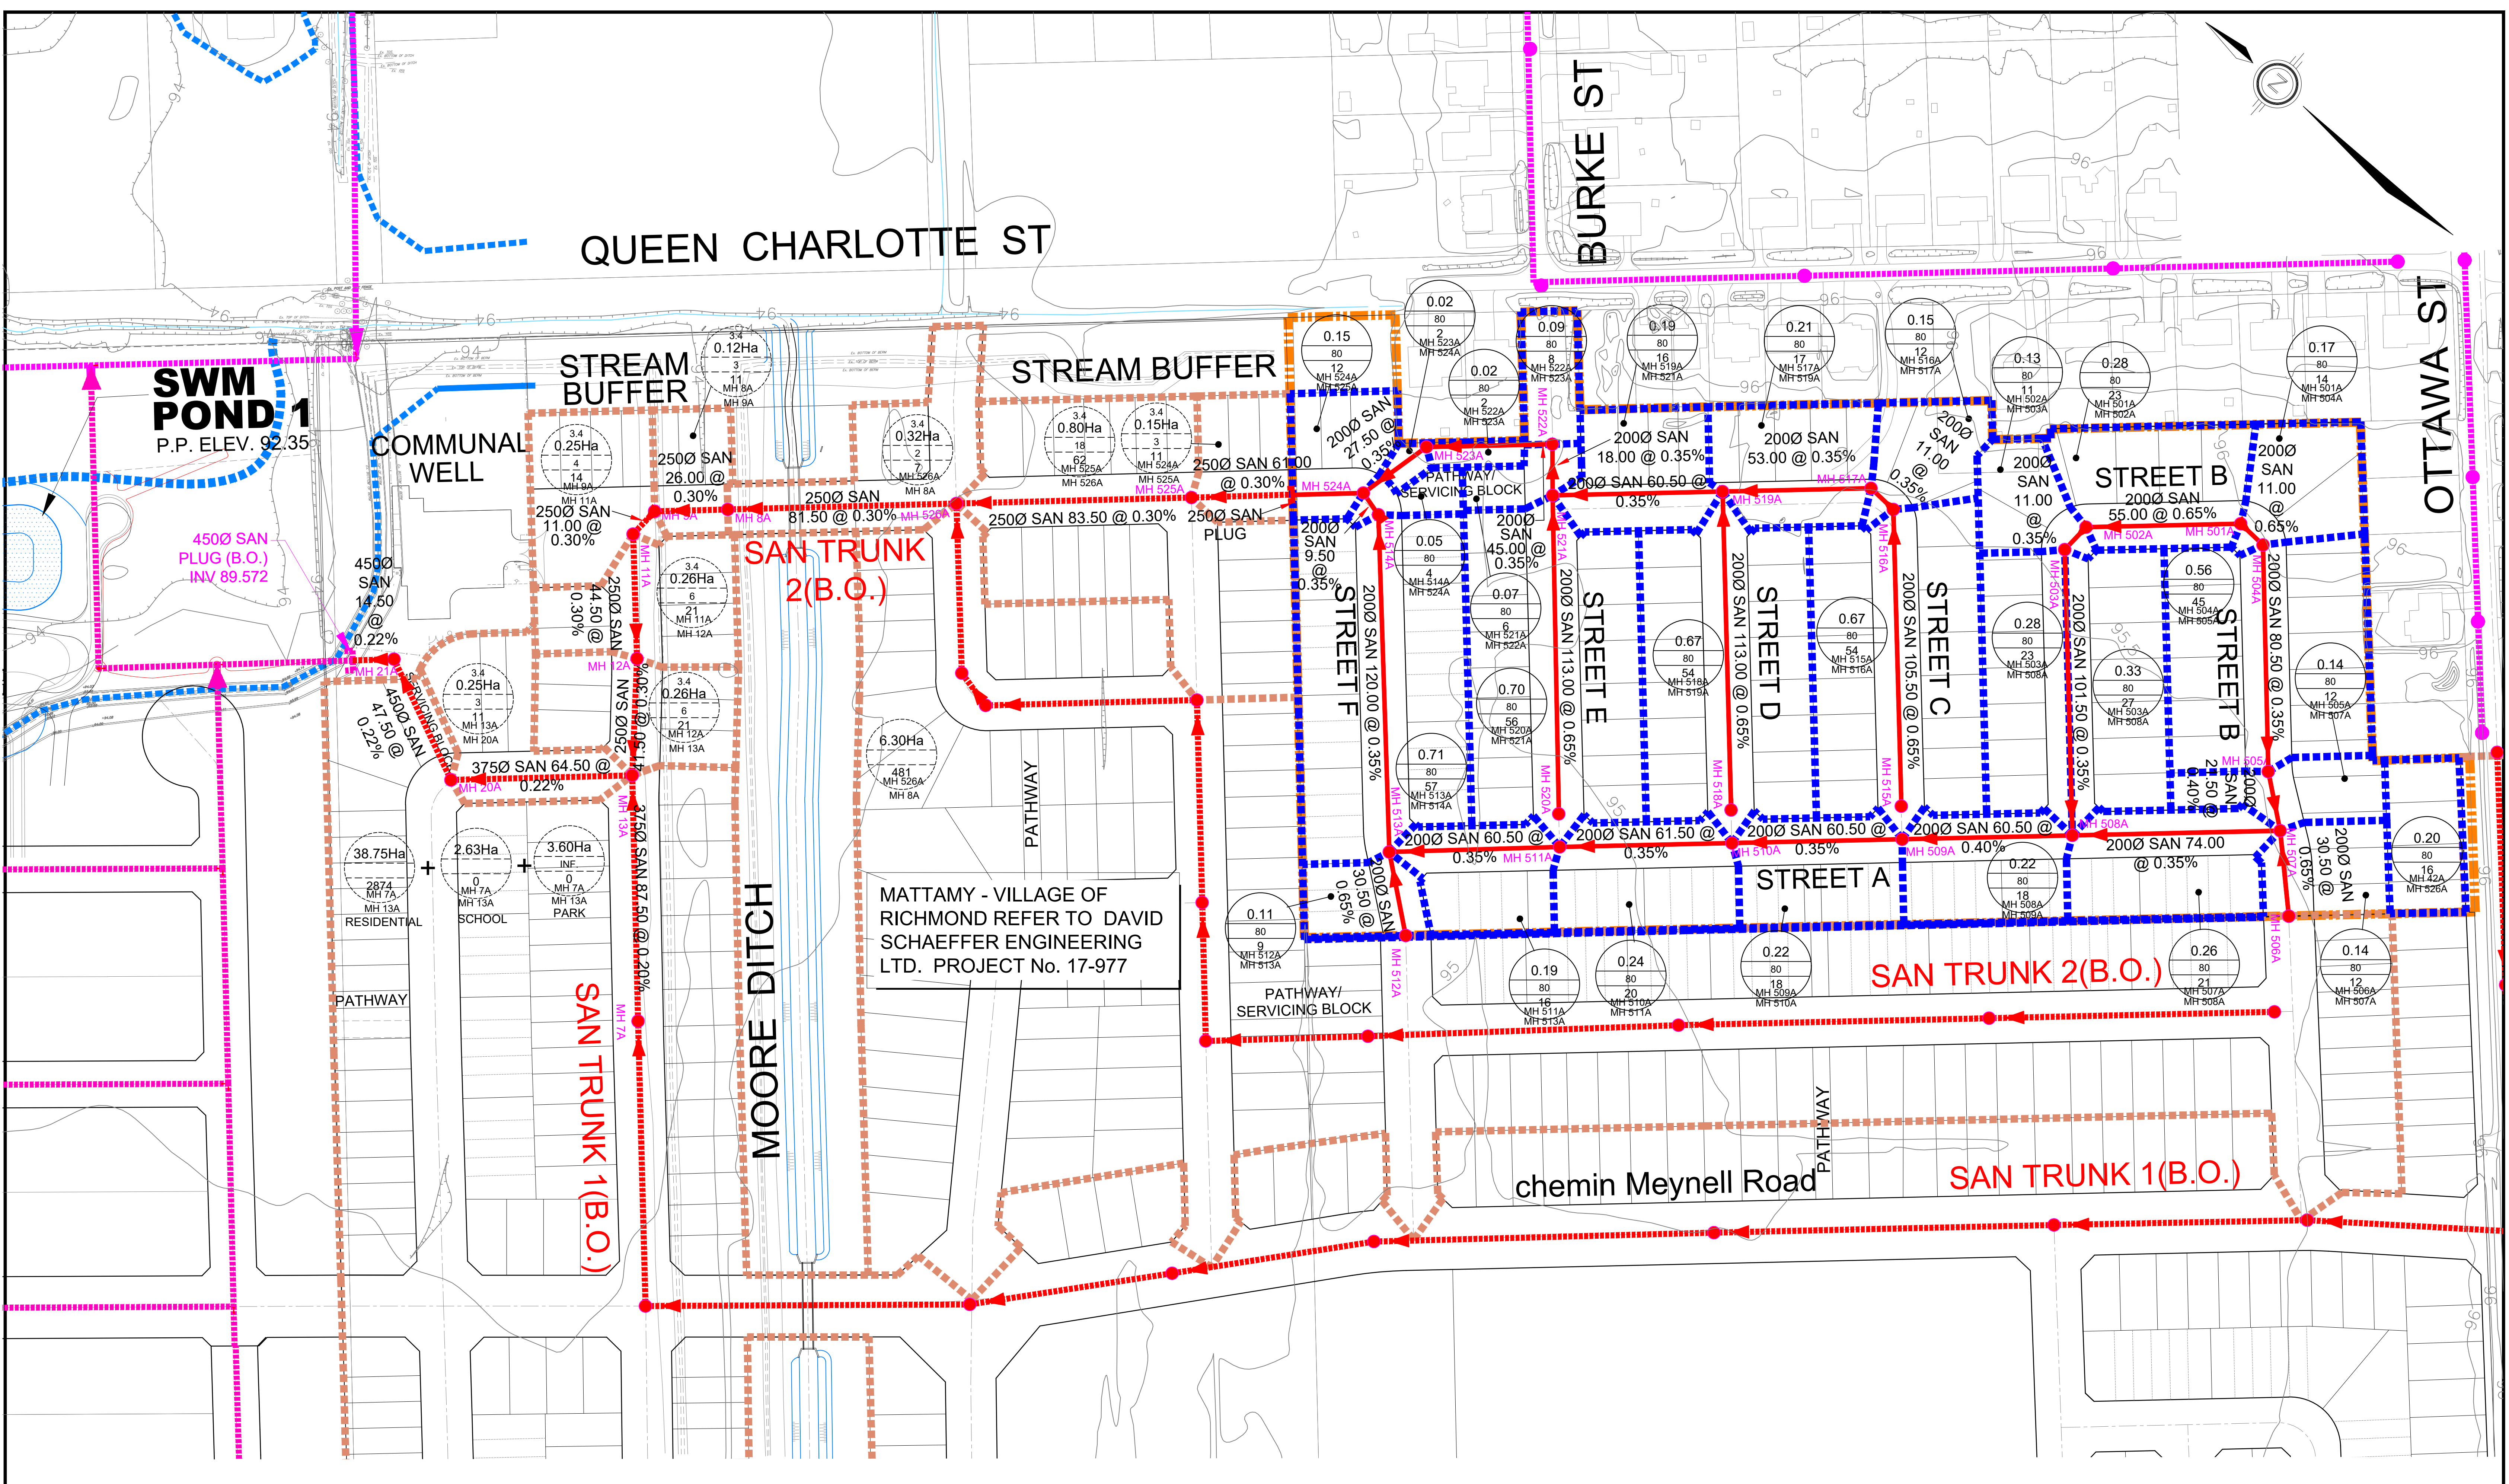



- LEGEND**
- SUBJECT LANDS
 - SANITARY DRAINAGE BOUNDARY
 - EXTERNAL SANITARY DRAINAGE BOUNDARY
 - PROPOSED SANITARY SEWER
 - SAN TRUNK BY OTHERS

<p>3.4 1.63Ha 60 89 MH 13A</p>	<p>POPULATION PER UNIT SANITARY DRAINAGE AREA NUMBER OF UNITS TOTAL POPULATION UPSTREAM/DOWNSTREAM MANHOLE</p>
<p>3.4 1.63Ha 60 89 MH 7A</p>	<p>POPULATION PER UNIT SANITARY DRAINAGE AREA NUMBER OF UNITS TOTAL POPULATION UPSTREAM/DOWNSTREAM MANHOLE</p>

DSEL
 david schaeffer engineering ltd
 120 Iber Road, Unit 103
 Stittsville, Ontario, K2S 1E9
 Tel: (613) 836-0866
 Fax: (613) 836-7183
 www.DSEL.ca

RICHMOND VILLAGE
 DEVELOPMENT
 CORPORATION
 CITY OF OTTAWA

SANITARY SERVICING PLAN LAFFIN LANDS	
SCALE: 1:1000	PROJECT No.: 20-1184
DATE: FEBRUARY 2021	DRAWING: 2B

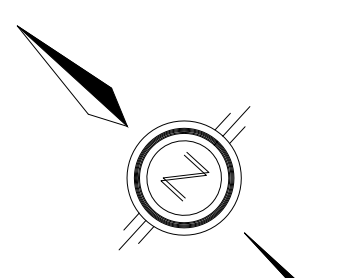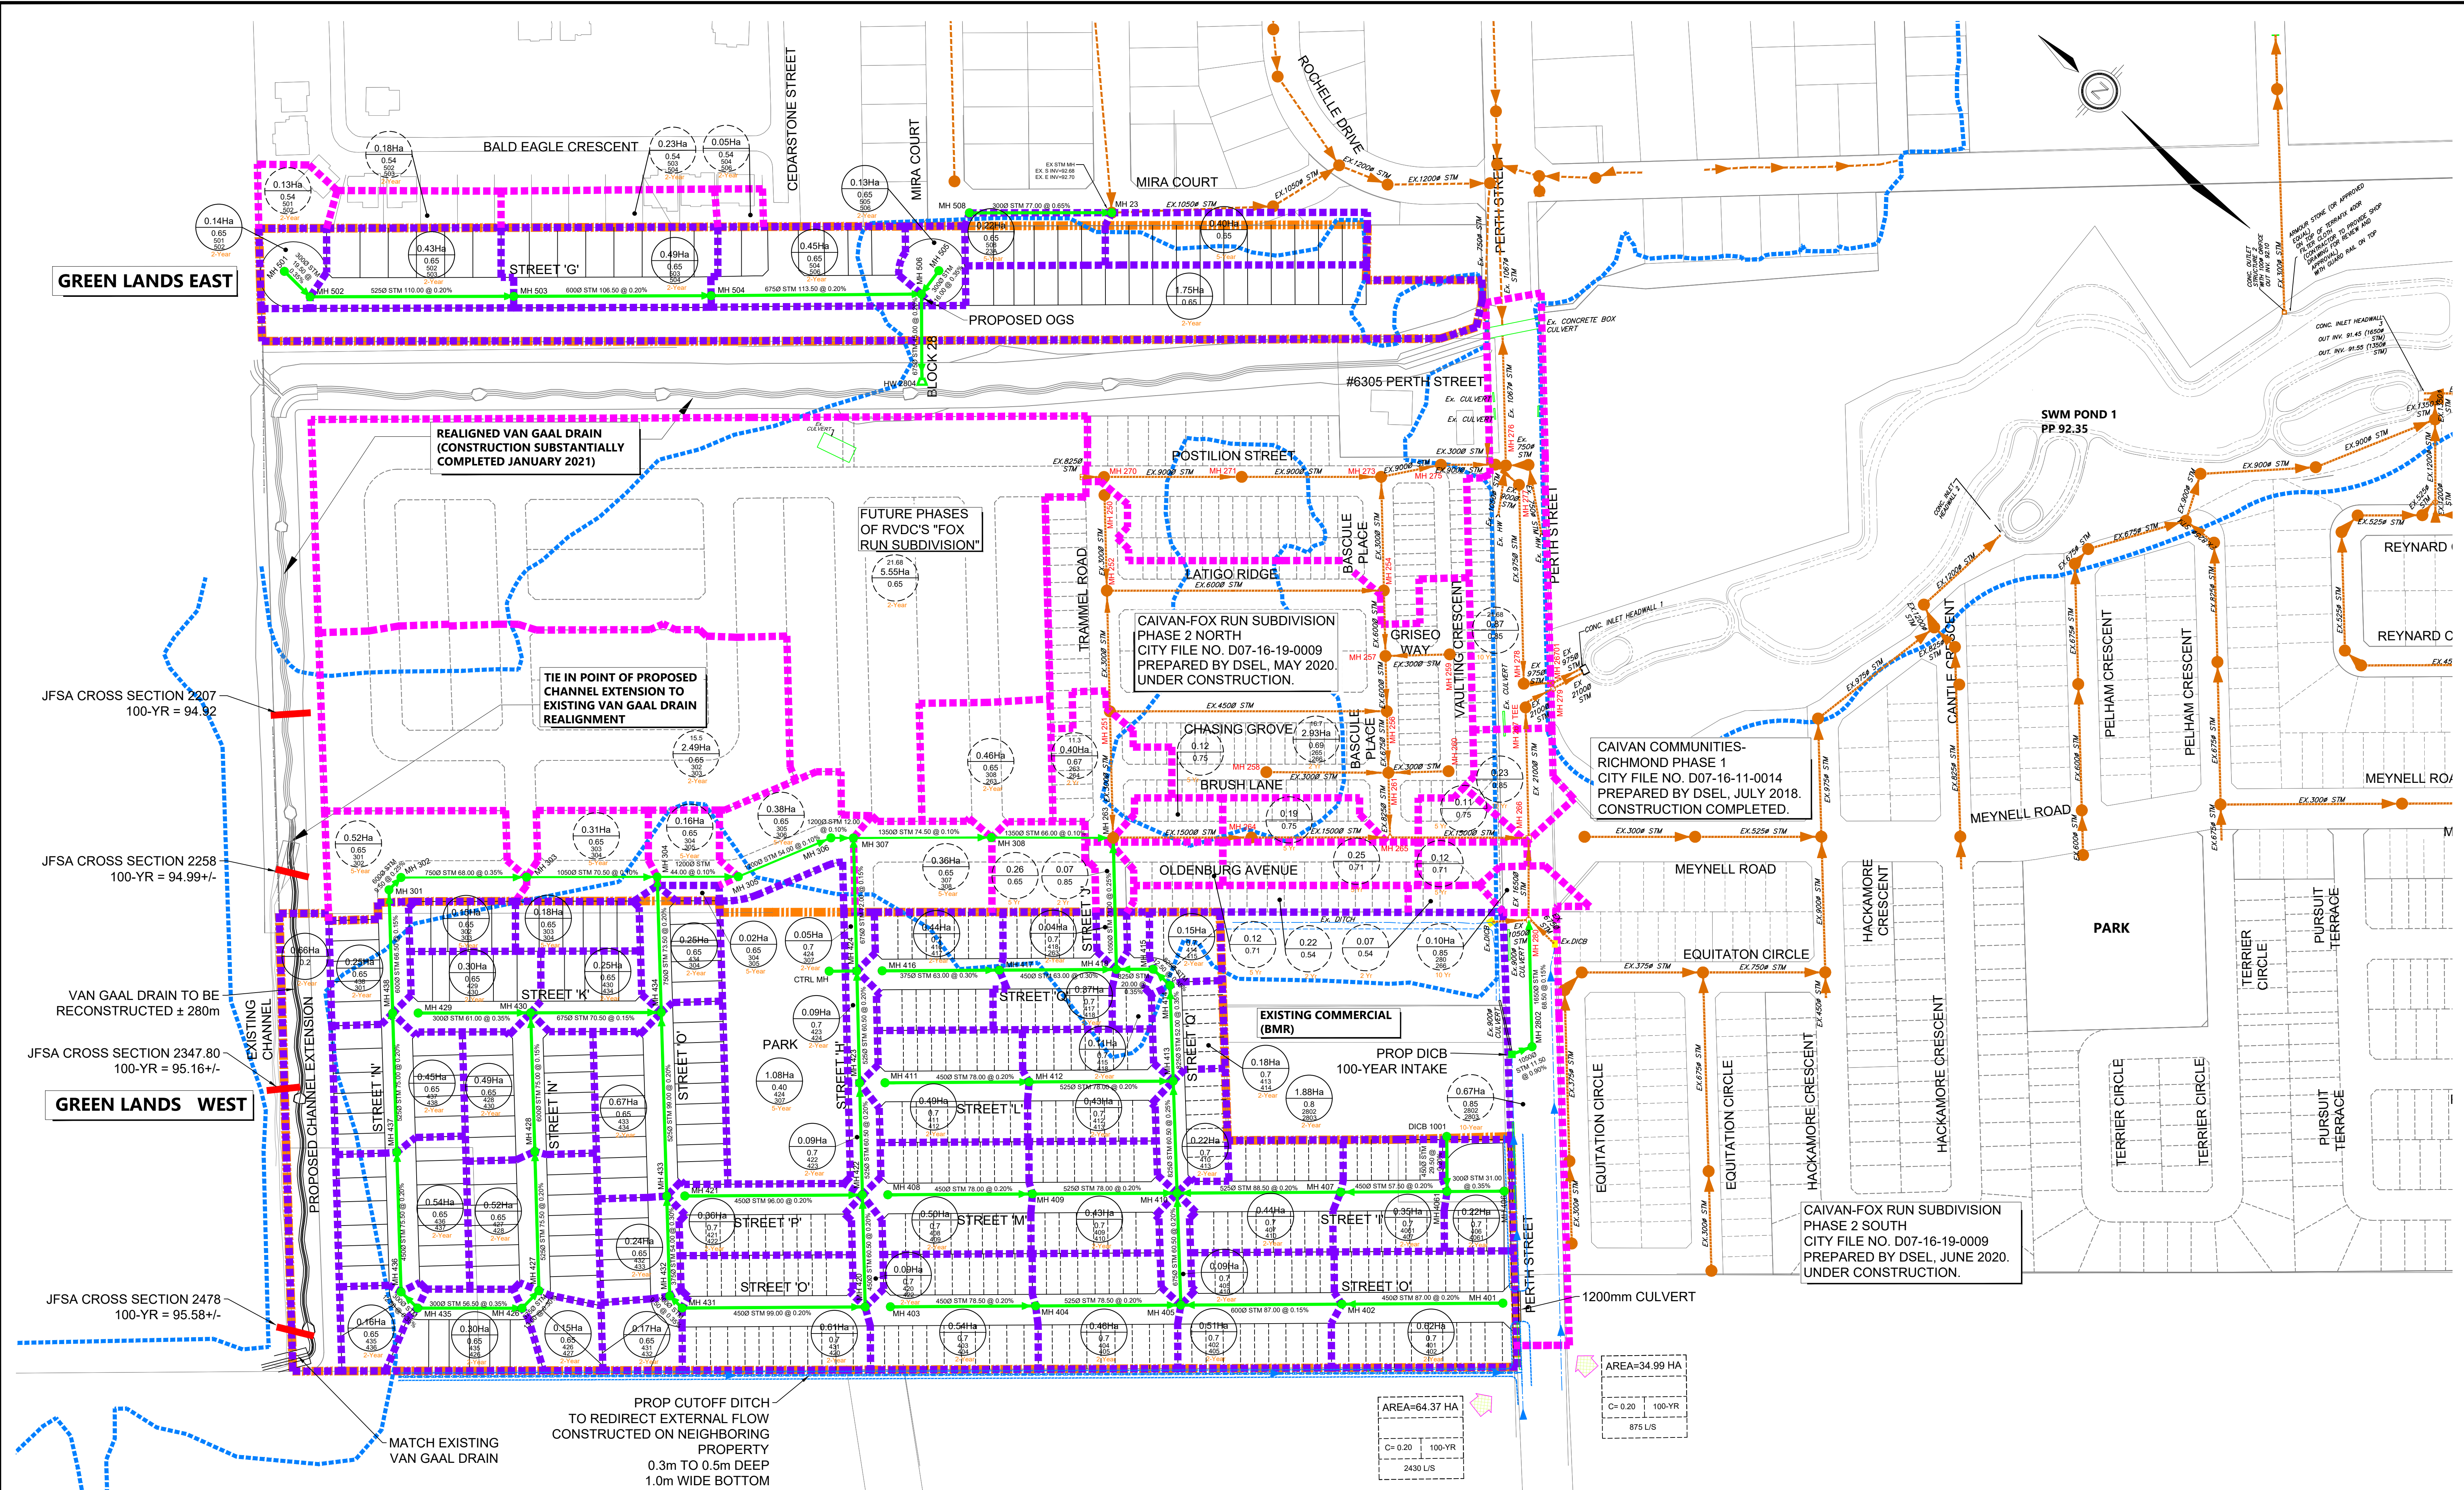

GREEN LANDS EAST

GREEN LANDS WEST

JFSA CROSS SECTION 2207
100-YR = 94.92

JFSA CROSS SECTION 2258
100-YR = 94.99+/-

JFSA CROSS SECTION 2347.80
100-YR = 95.16+/-

JFSA CROSS SECTION 2478
100-YR = 95.58+/-

- LEGEND**
- - - SUBJECT LANDS
 - - - STORM DRAINAGE AREA
 - - - STORM TRUNK
 - - - LOCAL STORM SEWER
 - - - EXISTING STORM SEWER
 - - - FUTURE STORM DRAINAGE AREA
 - - - 100 YEAR FLOODPLAIN
 - - - PROPOSED CUTOFF SWALE
 - - - EXTERNAL DRAINAGE
 - STORM MANHOLE
 - 0.45Ha
0.66
324
2-Year DRAINAGE AREA IMPERVIOUSNESS UPSTREAM/DOWNSTREAM MANHOLE
 - 0.45Ha
0.66
324
2-Year EXTERNAL DRAINAGE AREA IMPERVIOUSNESS UPSTREAM/DOWNSTREAM MANHOLE STORM FREQUENCY

MATCH EXISTING VAN GAAL DRAIN

VAN GAAL DRAIN TO BE RECONSTRUCTED ± 280m

EXISTING CHANNEL EXTENSION

TIE IN POINT OF PROPOSED CHANNEL EXTENSION TO EXISTING VAN GAAL DRAIN REALIGNMENT

REALIGNED VAN GAAL DRAIN (CONSTRUCTION SUBSTANTIALLY COMPLETED JANUARY 2021)

PROPOSED OGS

PROPOSED CUTOFF DITCH TO REDIRECT EXTERNAL FLOW CONSTRUCTED ON NEIGHBORING PROPERTY 0.3m TO 0.5m DEEP 1.0m WIDE BOTTOM

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S

AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

AREA=34.99 HA
C=0.20 | 100-YR
875 L/S


AREA=64.37 HA
C=0.20 | 100-YR
2430 L/S

DSEL
david schaeffer engineering ltd
120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel: (613) 836-8856
Fax: (613) 836-7183
www.DSEL.ca

RICHMOND VILLAGE
DEVELOPMENT
CORPORATION
CITY OF OTTAWA

STORM SERVICING PLAN
GREEN LANDS WEST AND EAST

SCALE:	1:1500	PROJECT No.:	1183
DATE:	FEBRUARY 2021	DRAWING:	3A

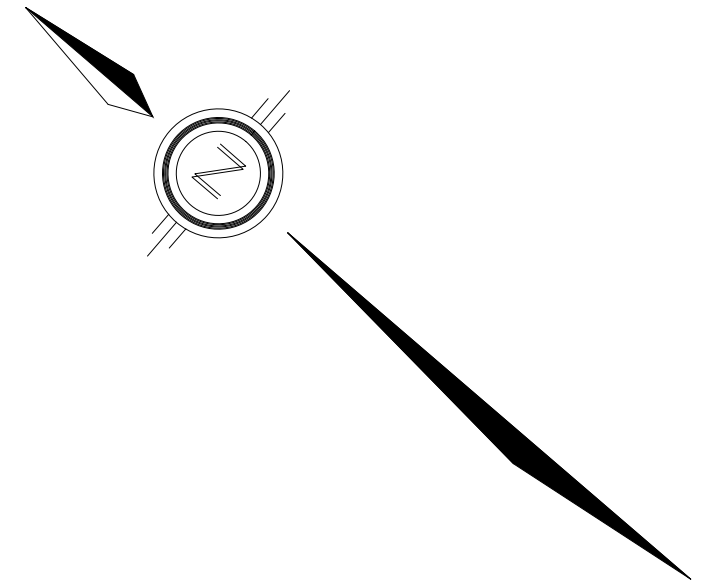


1:100 YEAR FLOOD LIMIT PER JFSA
ANALYSIS 2010-05-11 SPRING EVENT
ON VAN GAAL WITH FORTUNE
STREET CULVERT IMPROVEMENTS

QUEEN CHARLOTTE ST

BURKE ST

OTTAWA ST

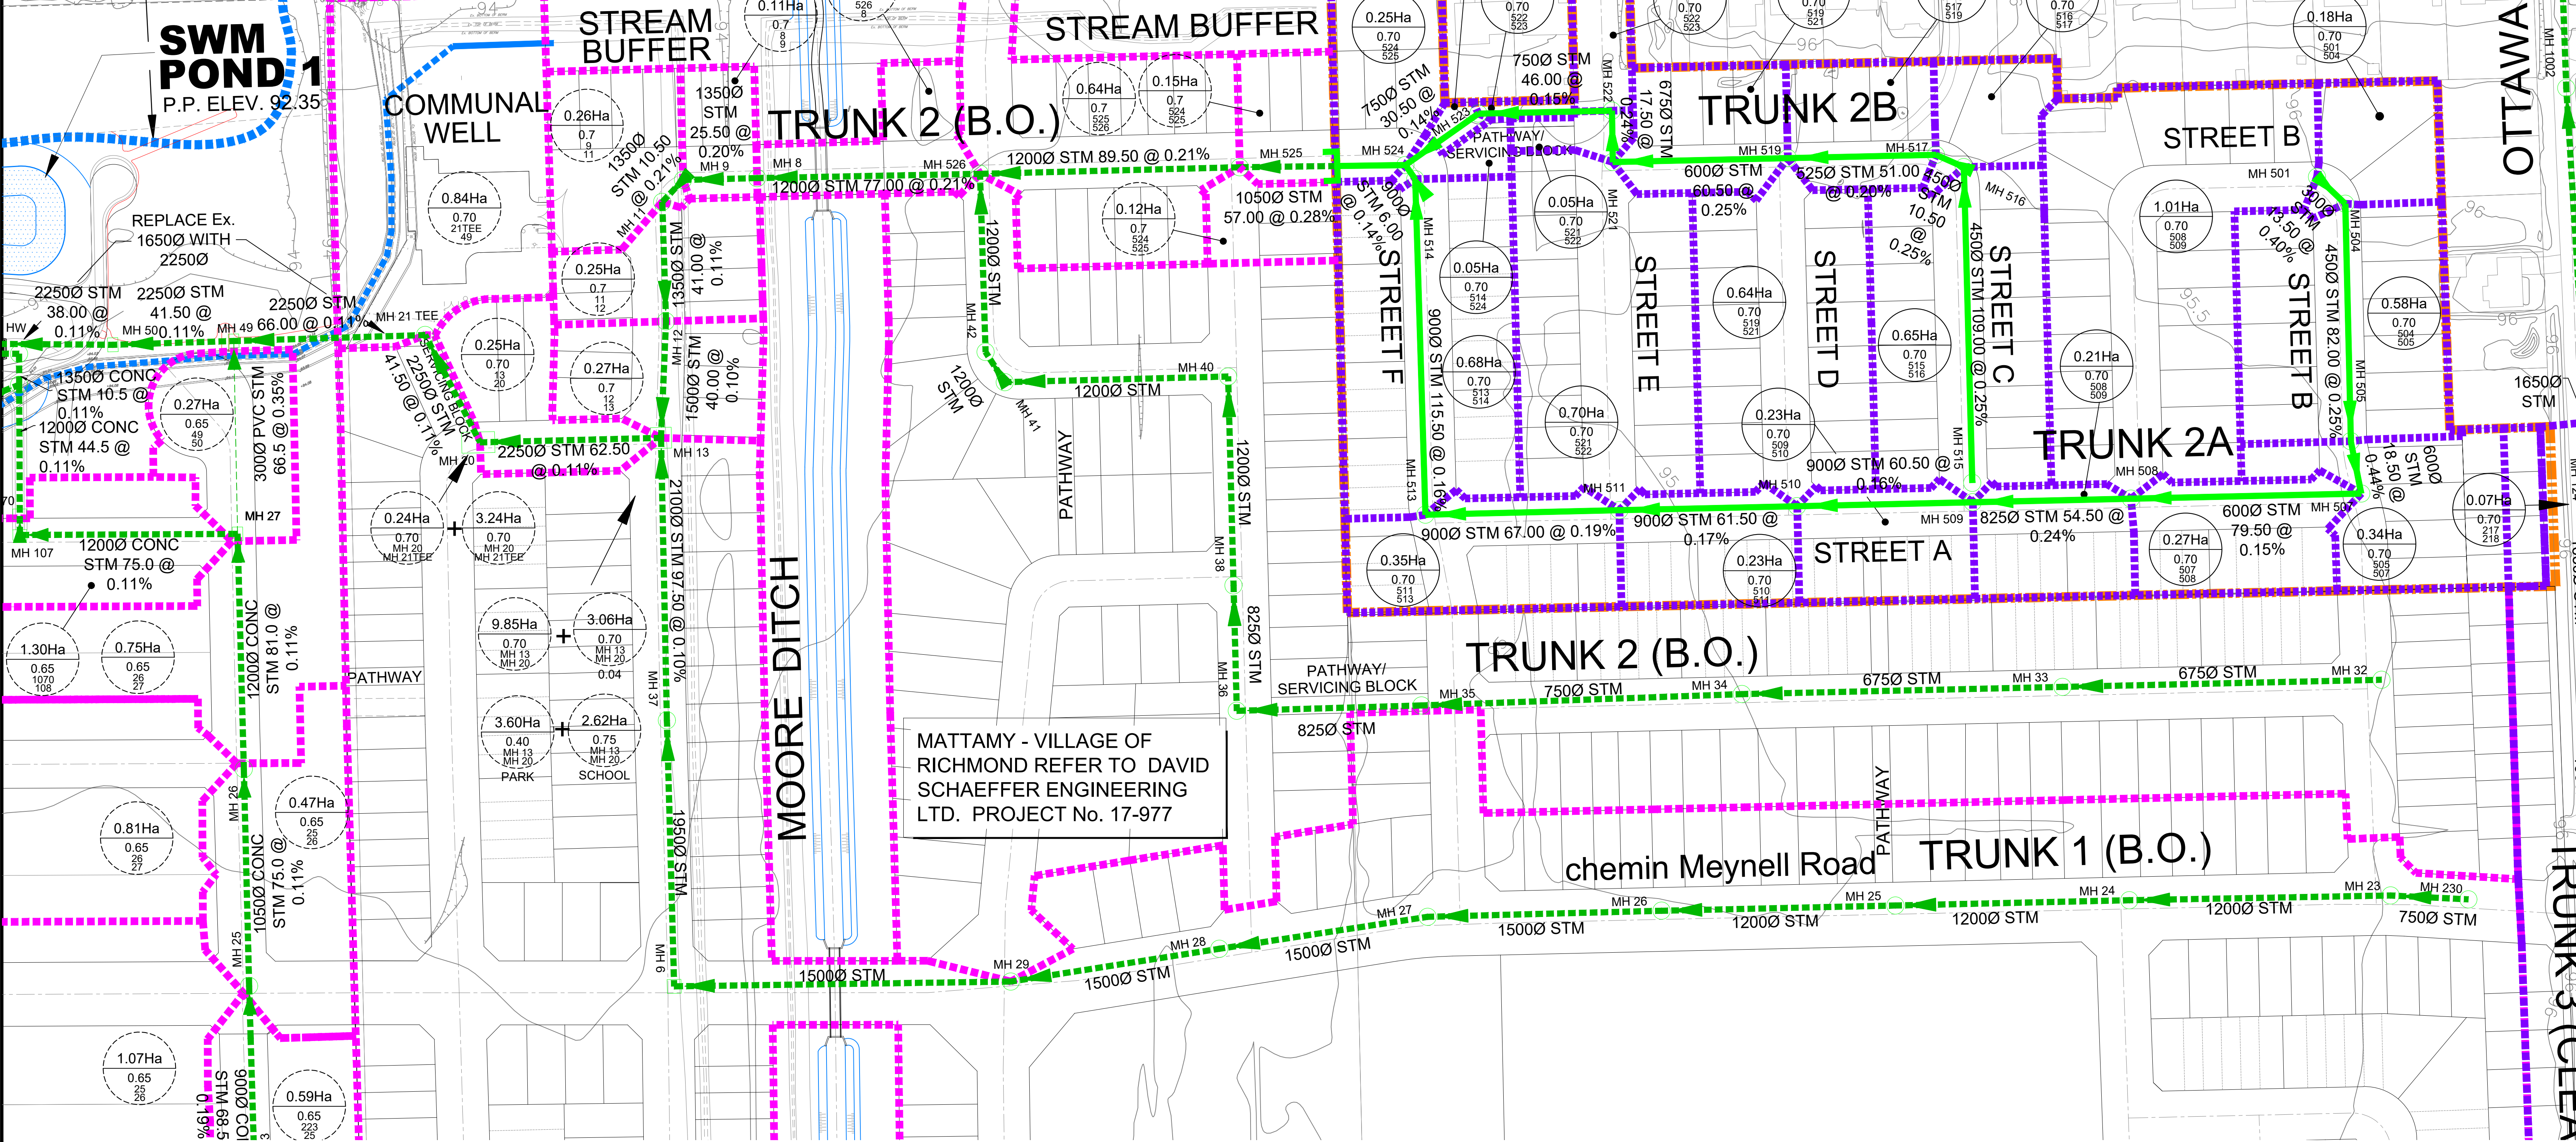

LEGEND










- SUBJECT LANDS
- EXISTING DITCH
- STORM TRIBUTARY AREA
- EXTERNAL STORM TRIBUTARY AREA
- STORM TRUNK
- STORM TRUNK BY OTHERS
- LOCAL STORM SEWER BY OTHERS
- EXTERNAL DRAINAGE
- PLUG
- STORM FREQUENCY
DRAINAGE AREA
RUN-OFF COEFFICIENT
UPSTREAM/DOWNSTREAM
MANHOLE
- STORM FREQUENCY
EXTERNAL DRAINAGE AREA
RUN-OFF COEFFICIENT
UPSTREAM/DOWNSTREAM
MANHOLE

DSEL
david schaeffer engineering ltd
120 Iber Road, Unit 103
Stittville, Ontario, K2S 1E9
Tel: (613) 836-0886
Fax: (613) 836-7183
www.DSEL.ca

RICHMOND VILLAGE
DEVELOPMENT
CORPORATION
CITY OF OTTAWA

STORM SERVICING PLAN
LAFFIN LANDS

SCALE: 1:1000 PROJECT No.: 20-1184
DATE: FEBRUARY 2021 DRAWING: 3B




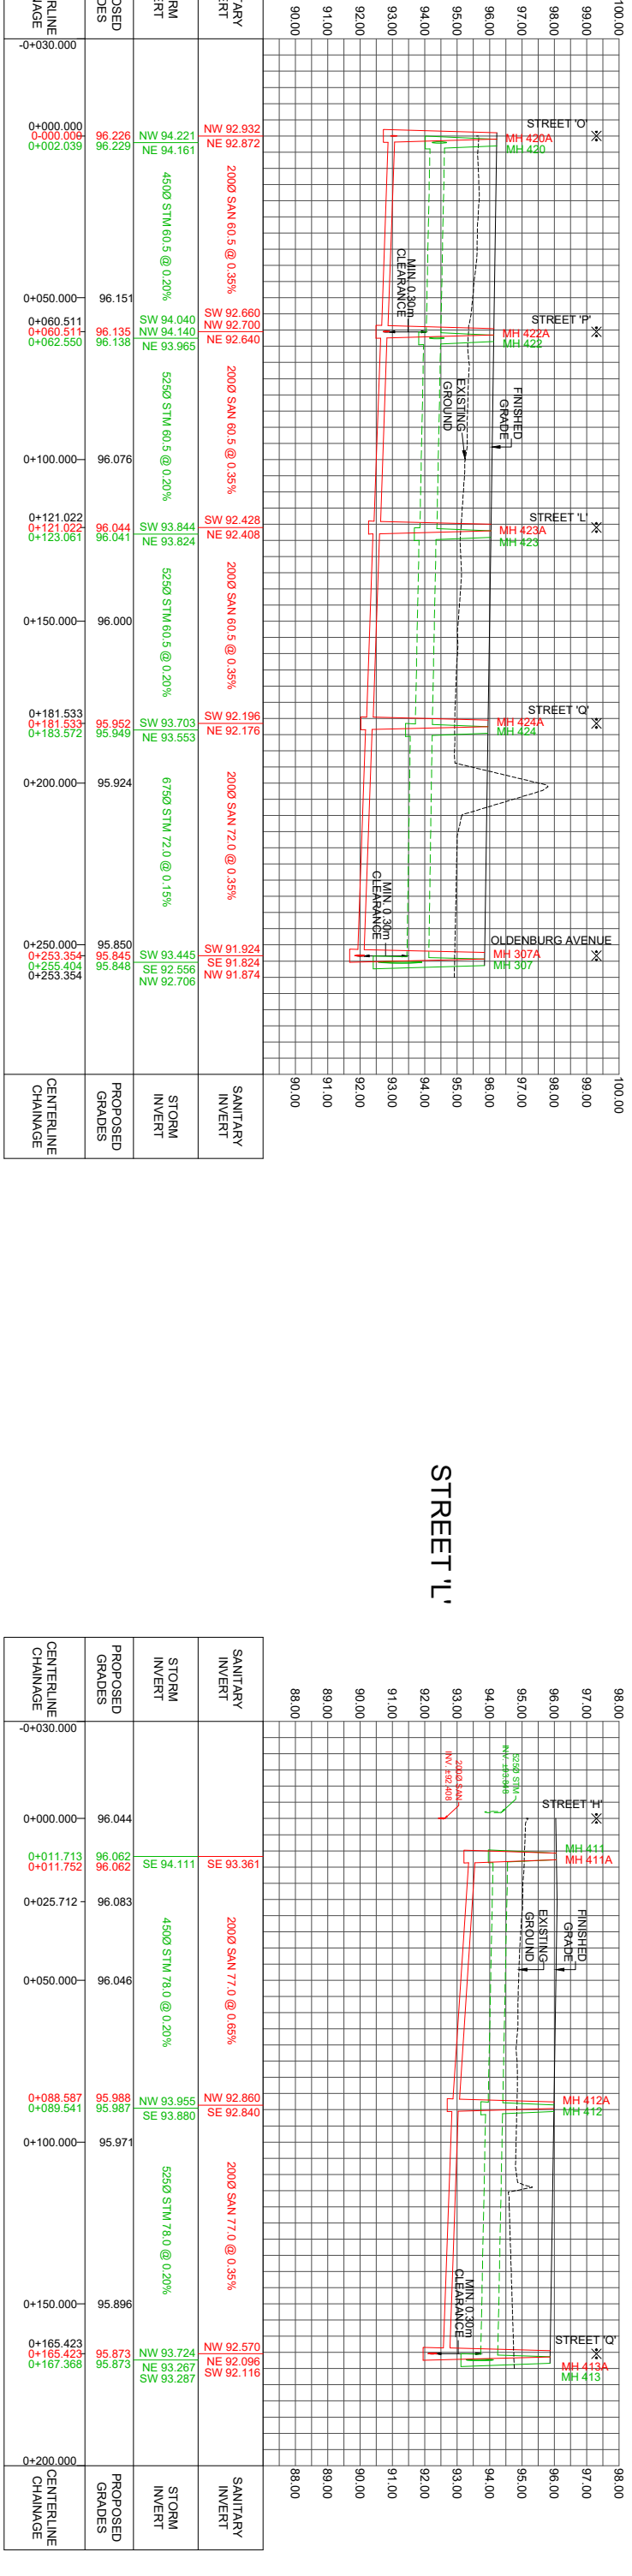
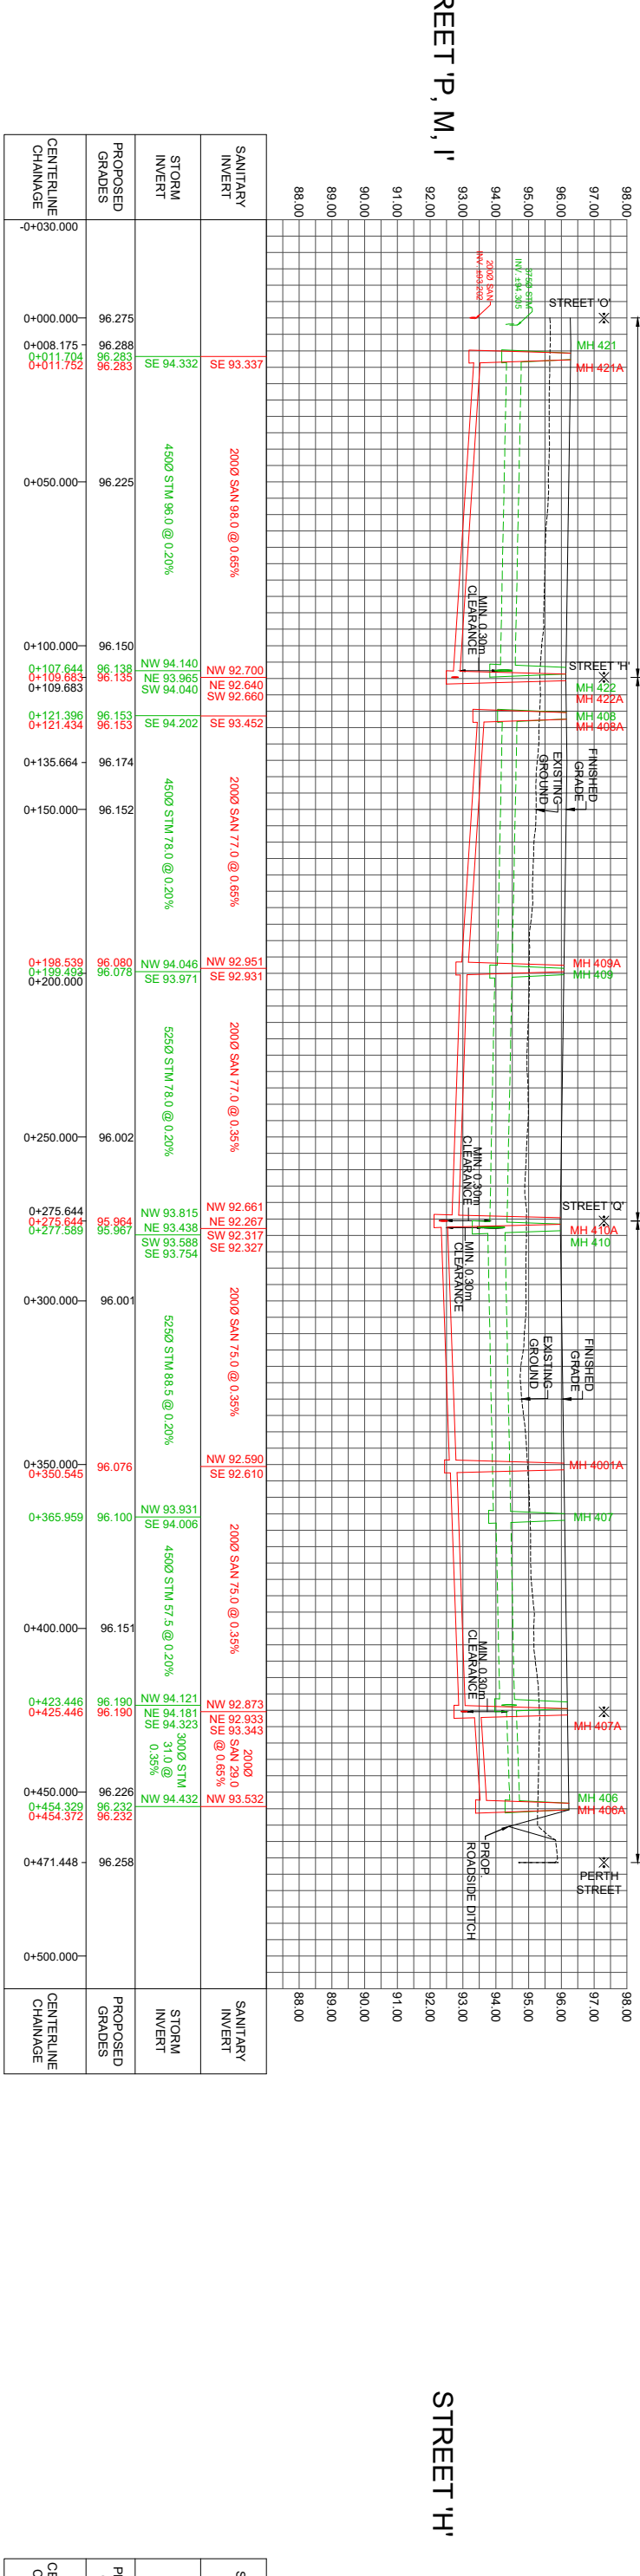
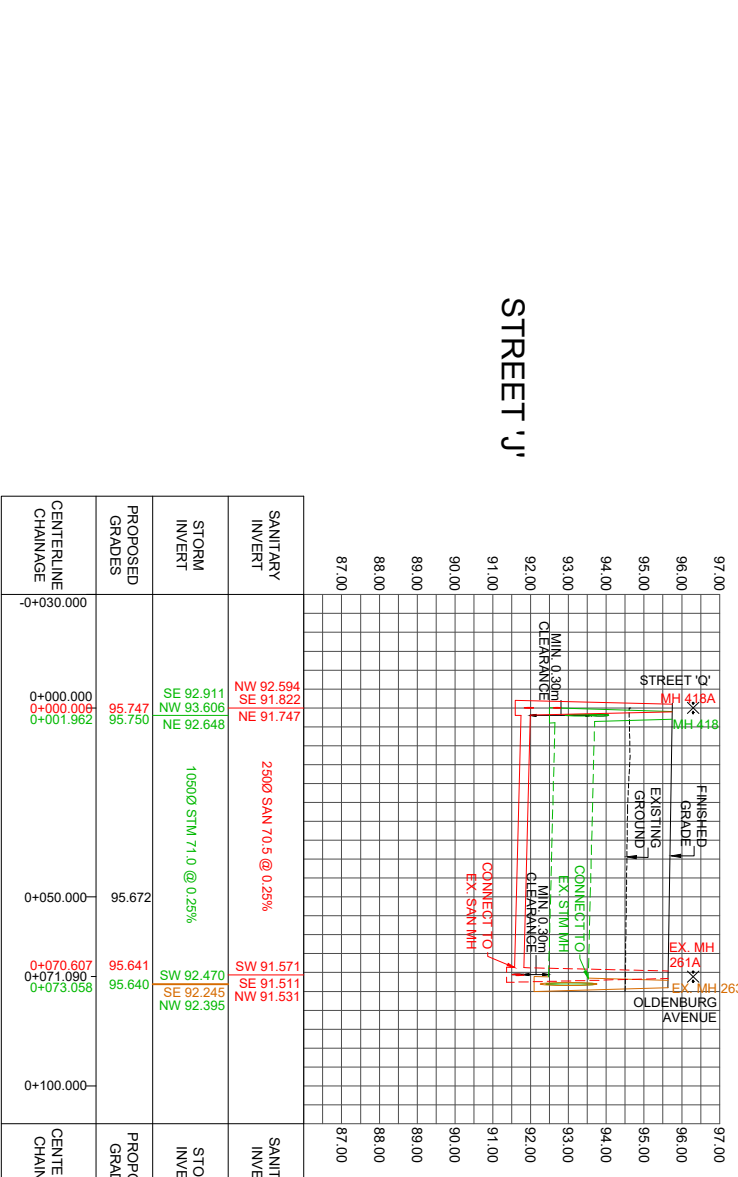
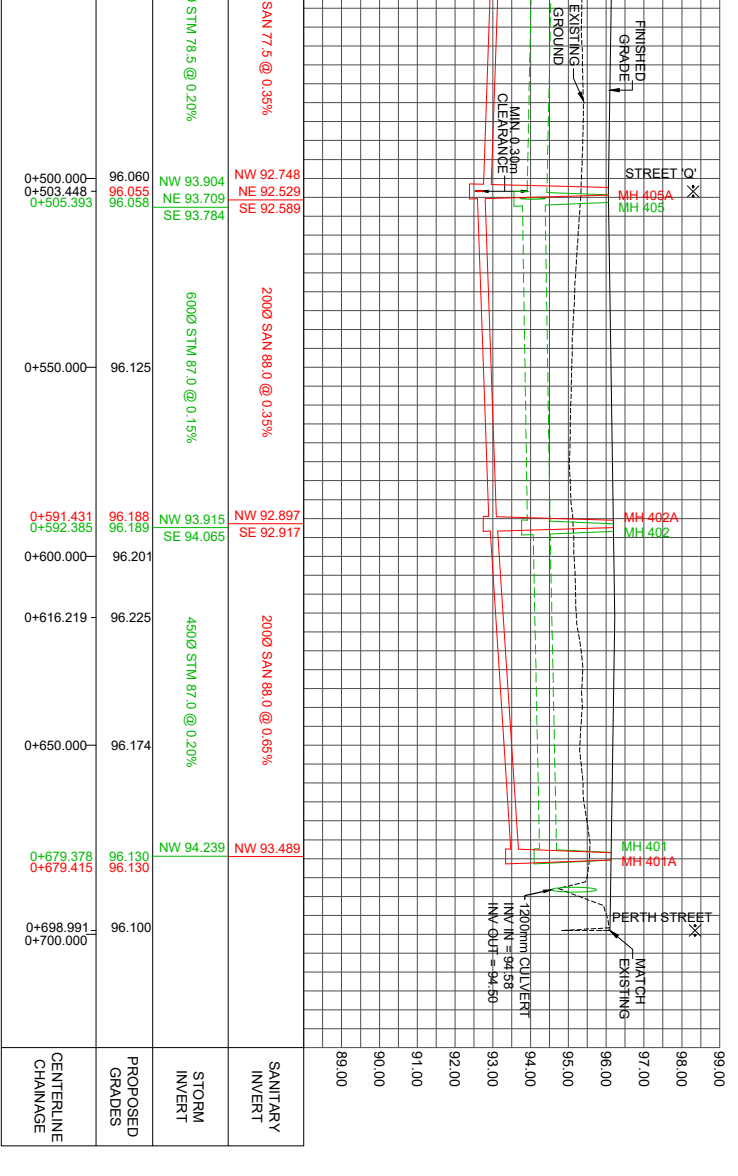
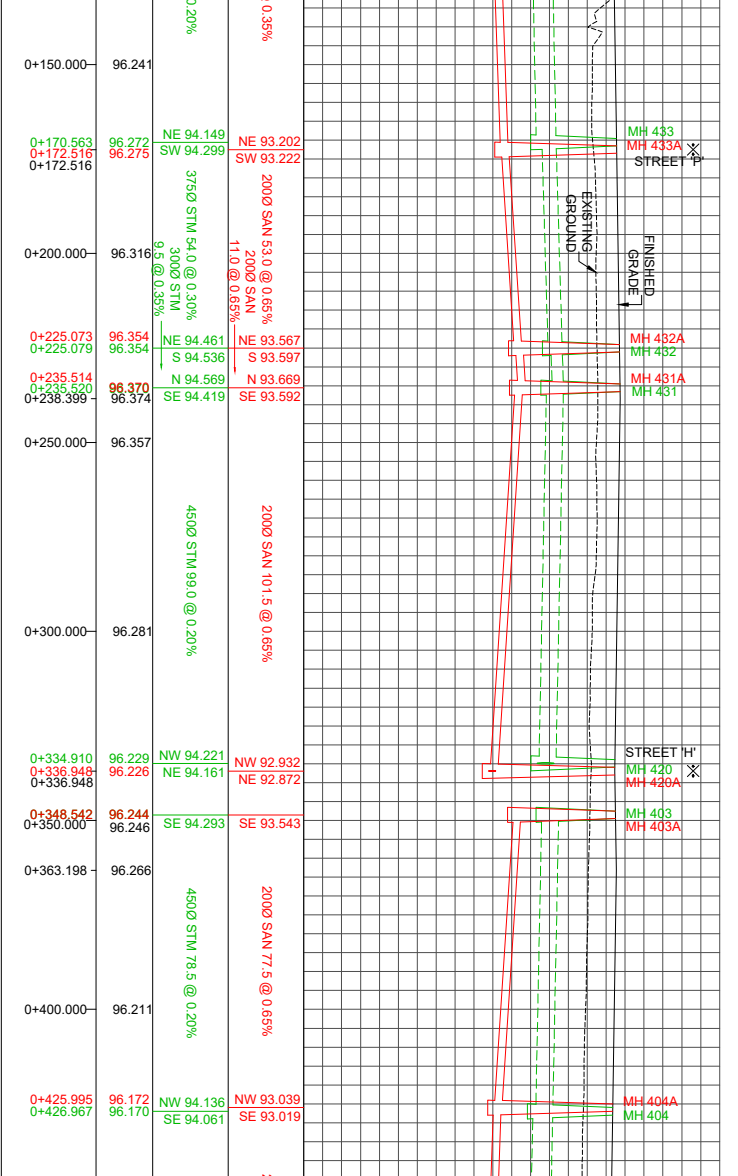
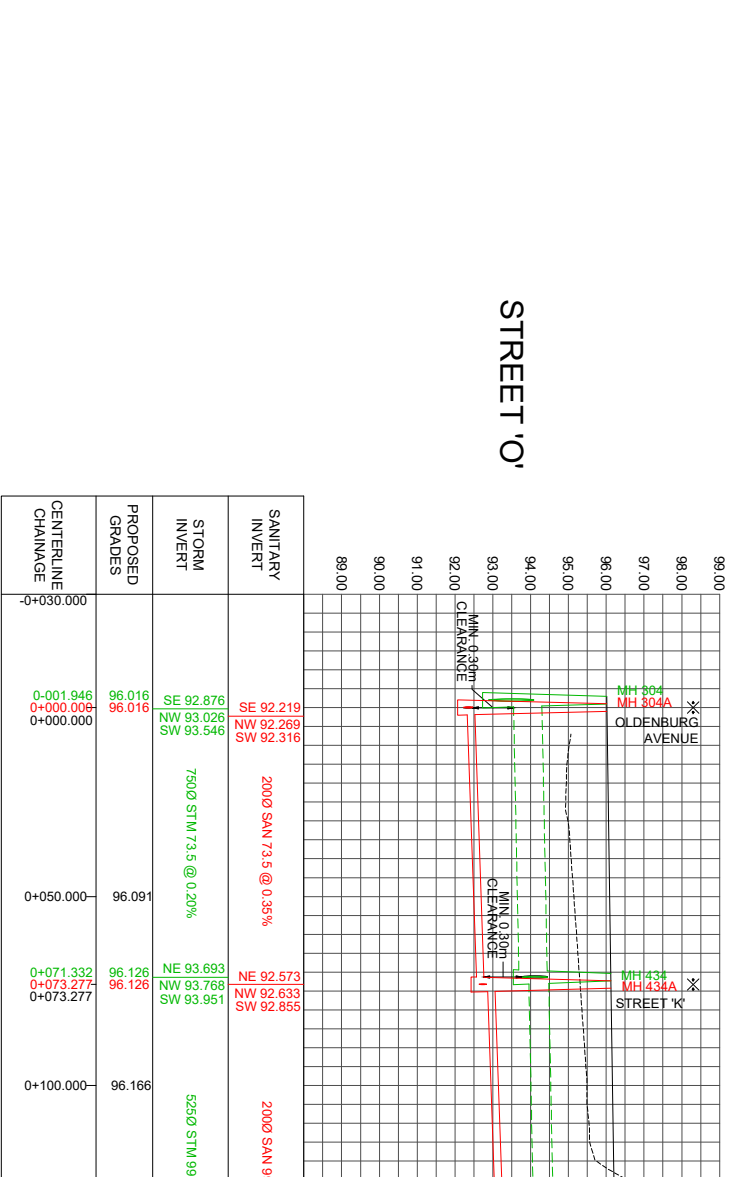
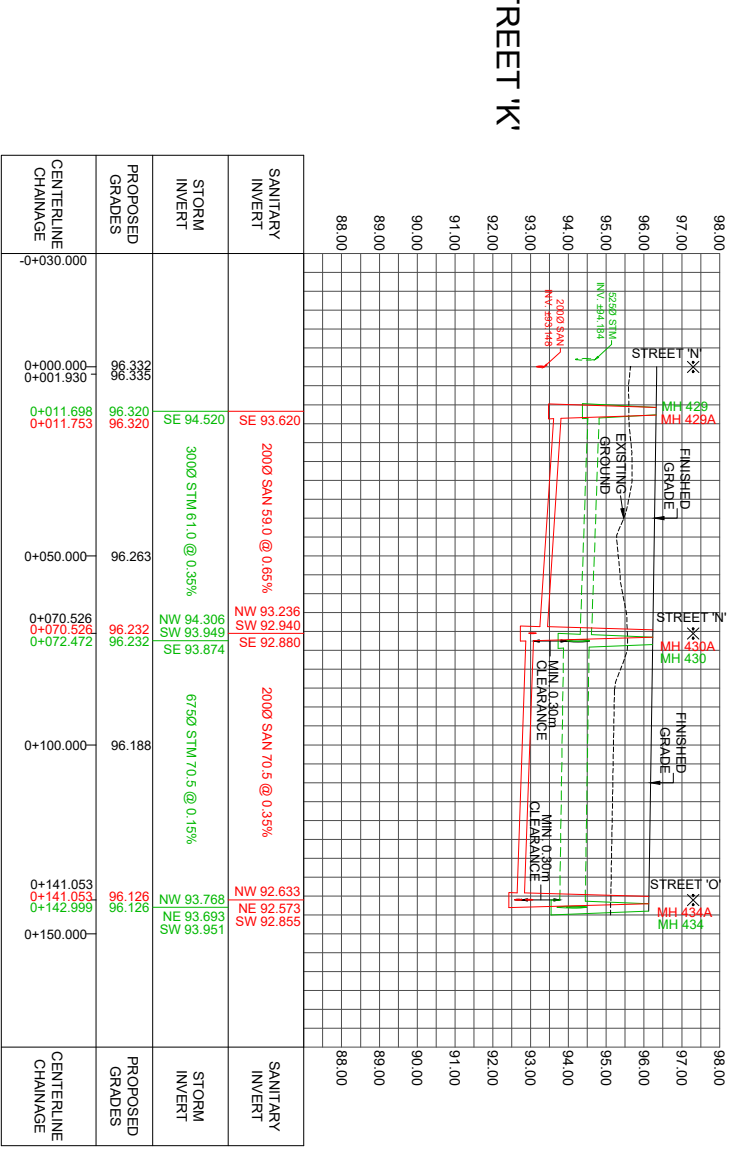
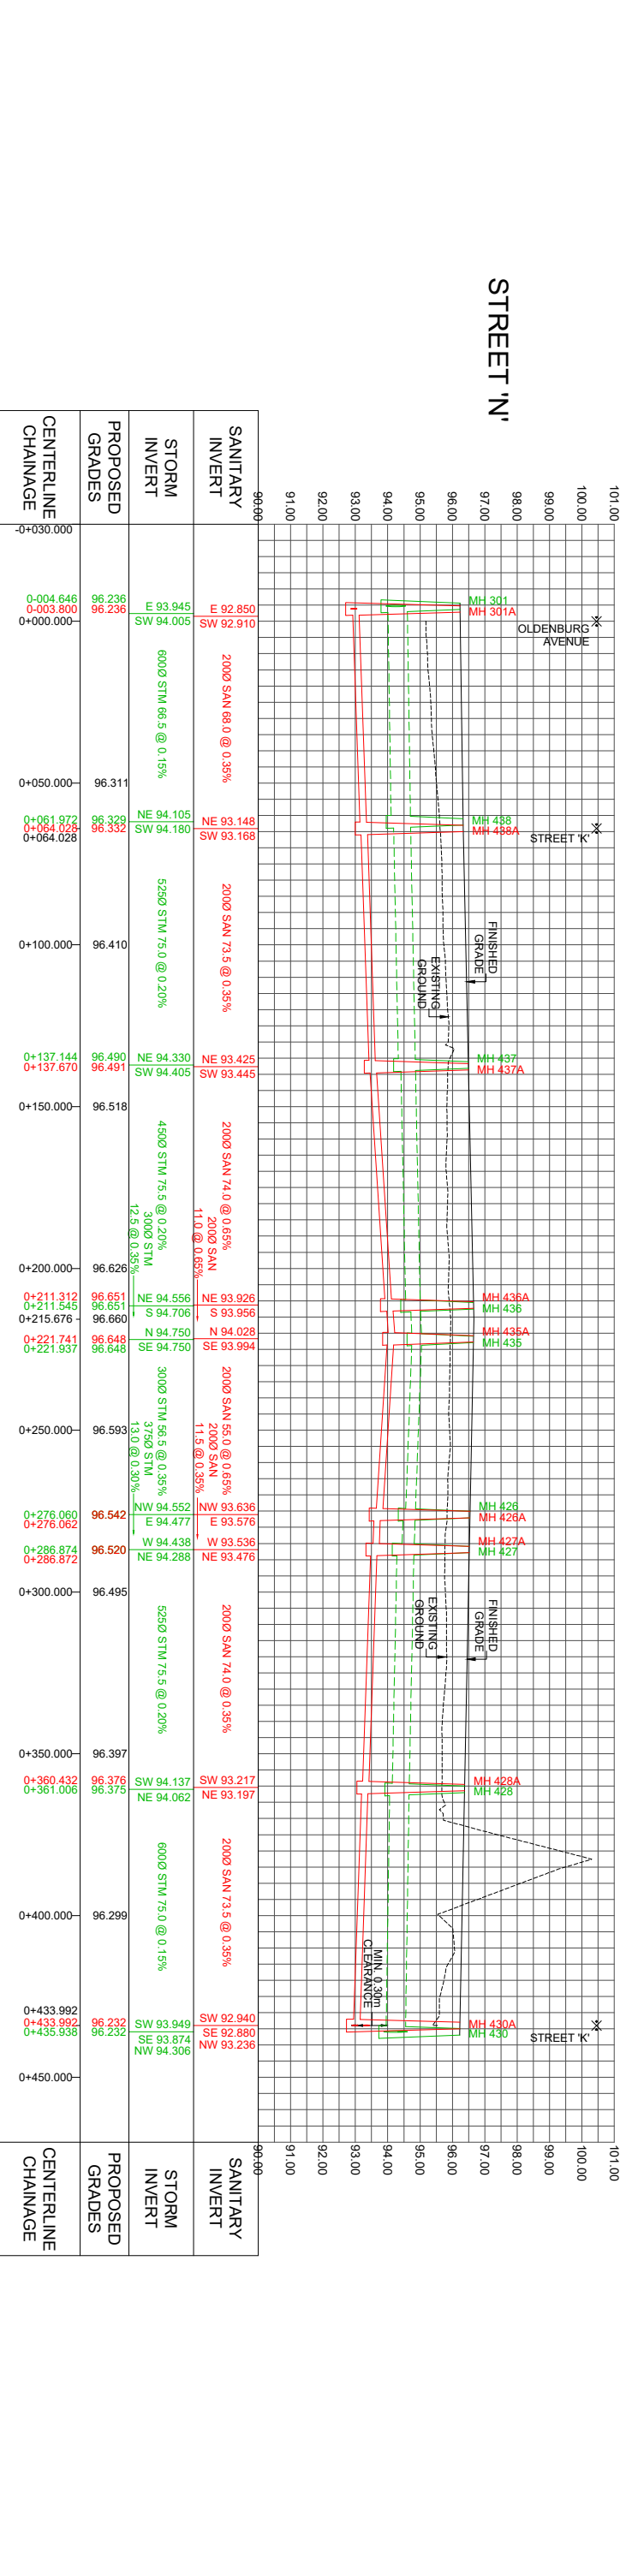
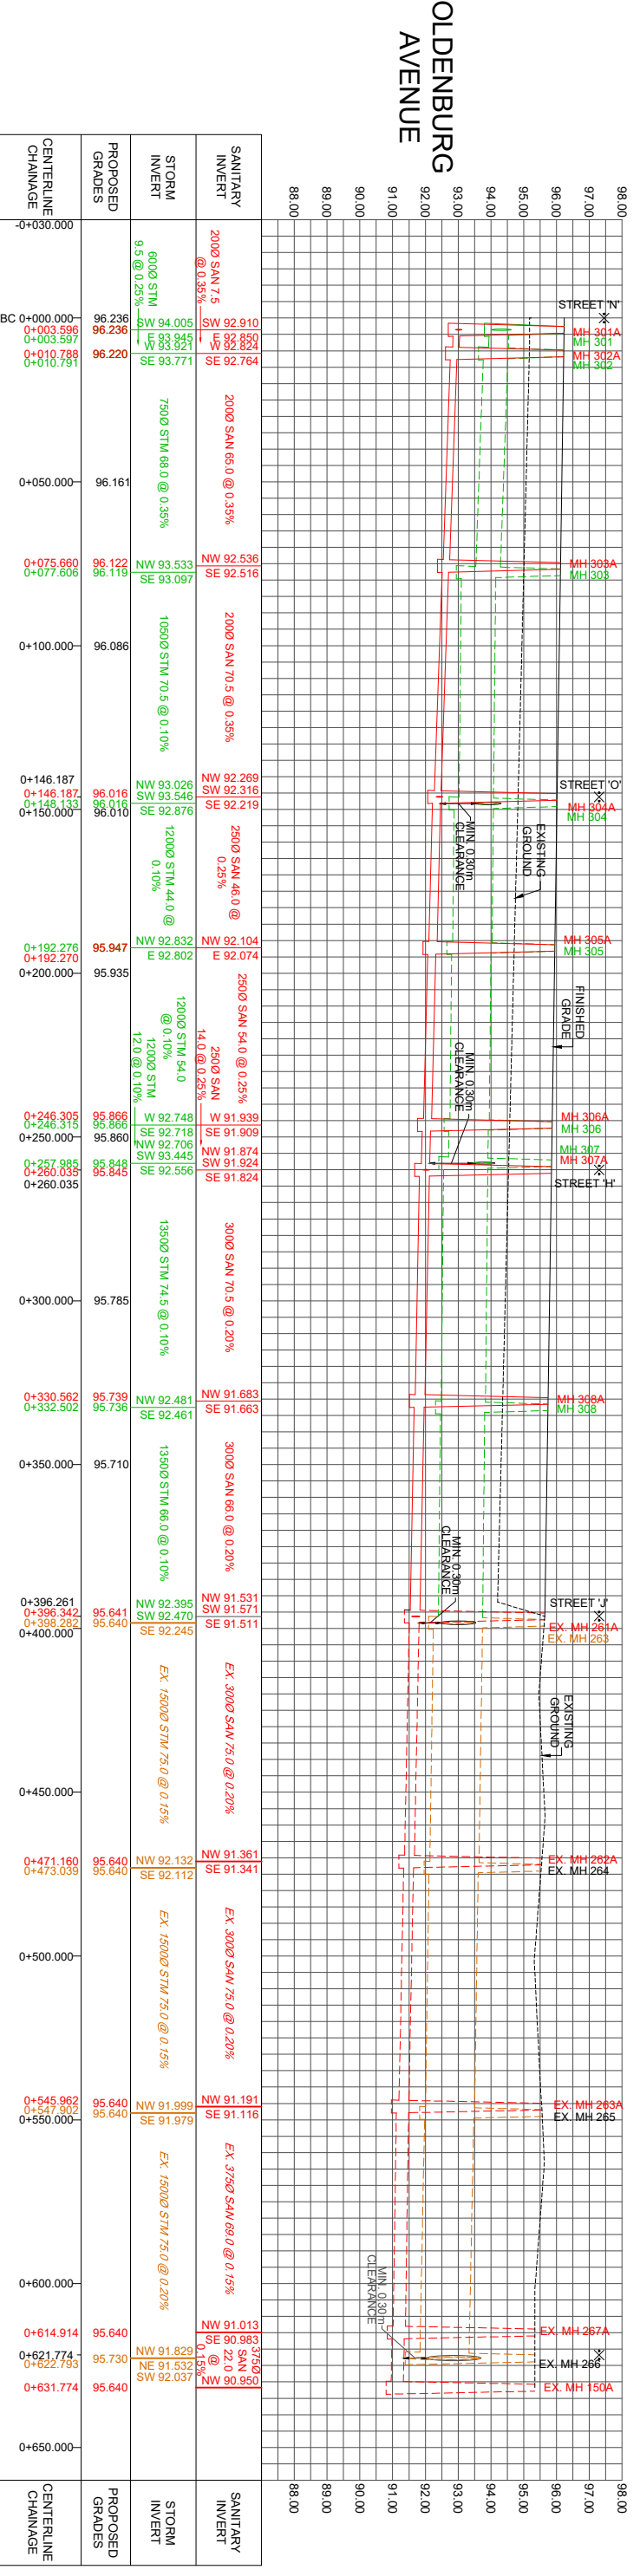



DS&L
 david schaefer engineering ltd
 120 Iber Road, Unit 103
 Stittsville, Ontario, K2S 1E9
 Fax: (613) 526-7183
 www.ds&l.ca

RICHMOND VILLAGE DEVELOPMENT CORPORATION CITY OF OTTAWA

PROFILES GREEN LANDS WEST AND EAST

SCALE: 1:2000
 DATE: FEBRUARY 2021
 PROJECT No.: 1183
 DRAWING: 4A

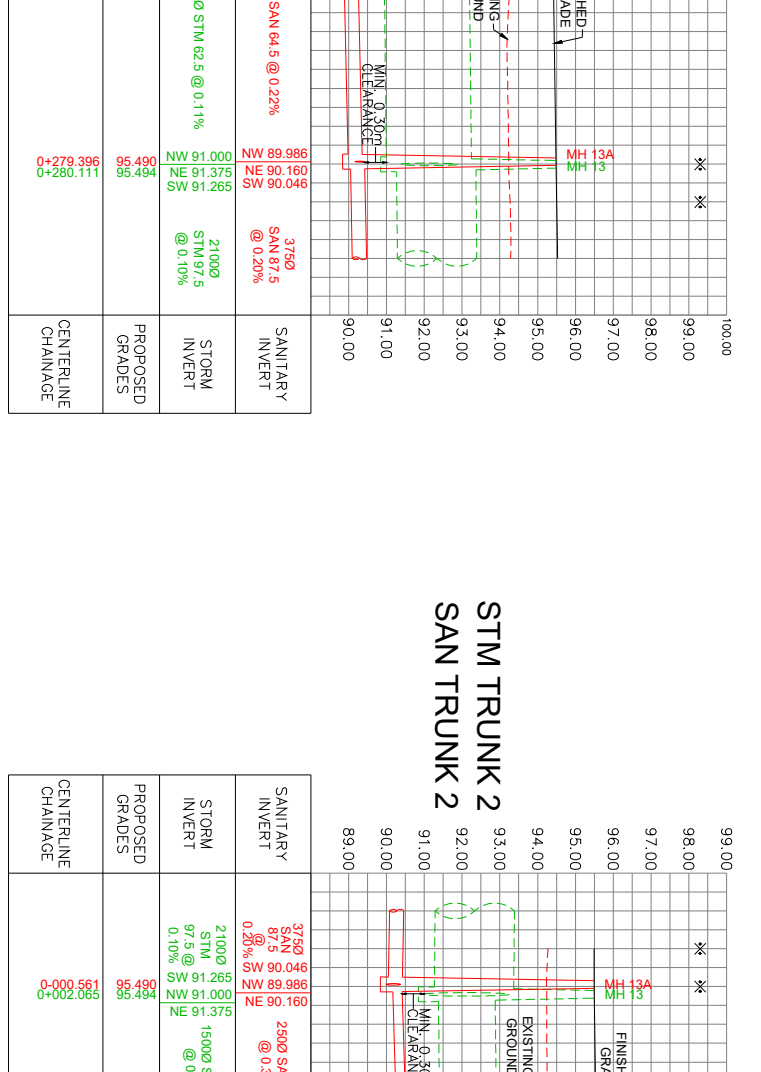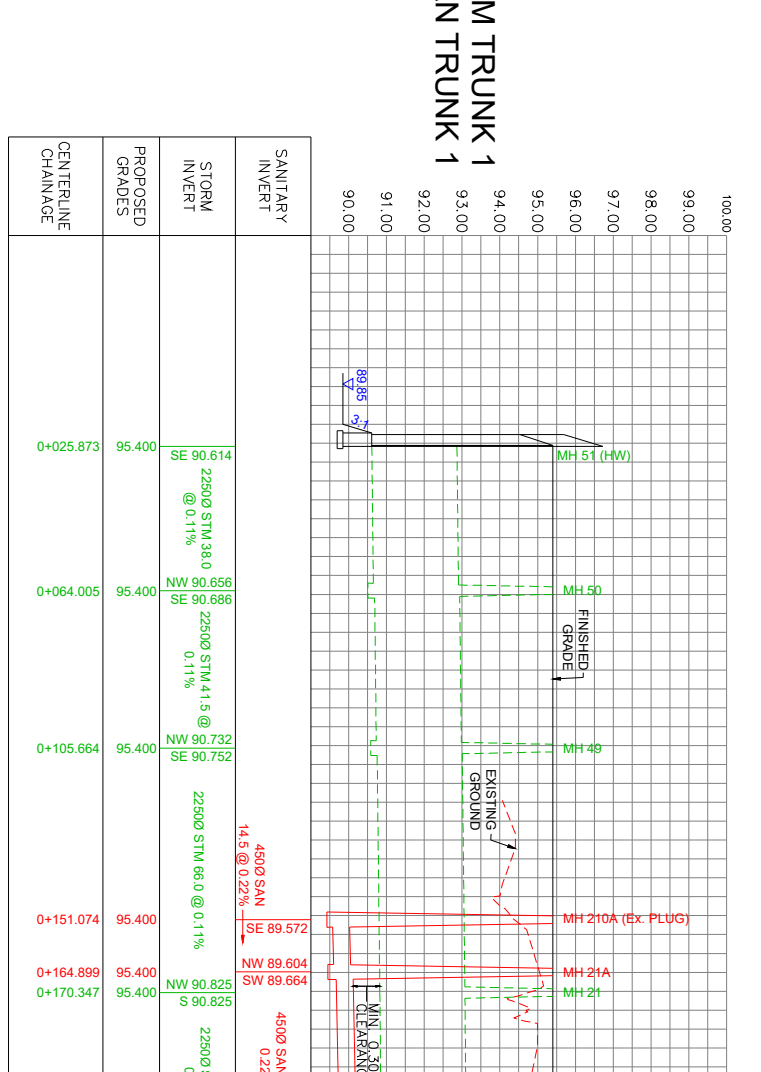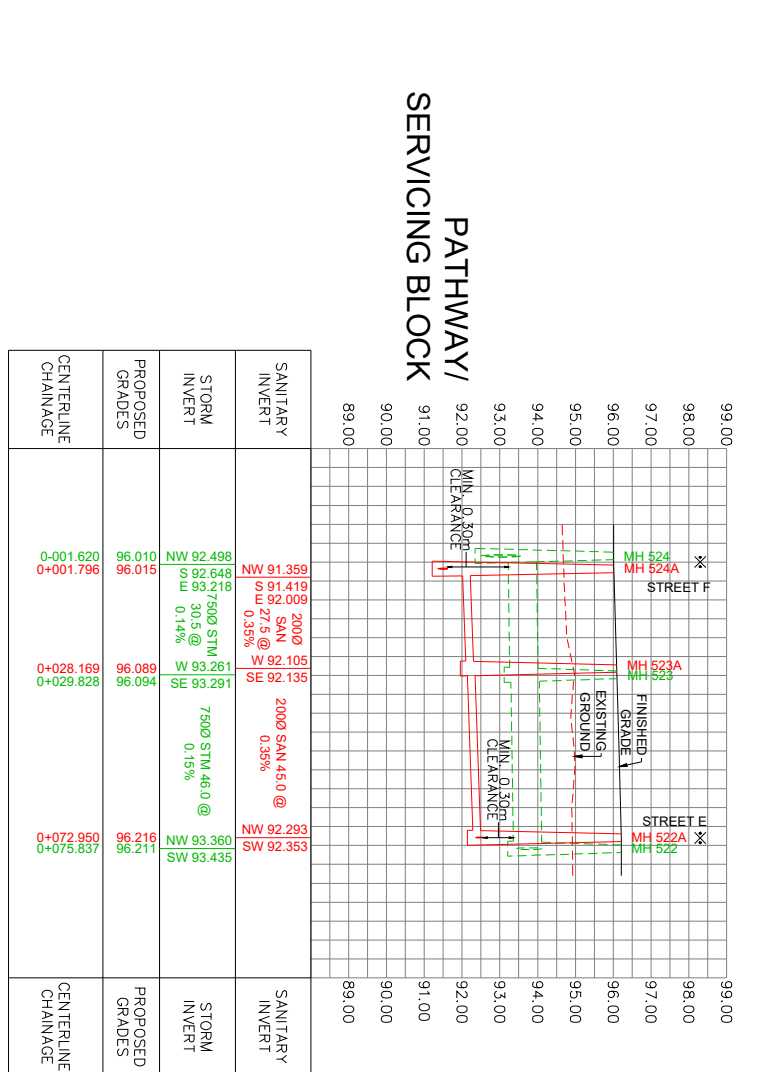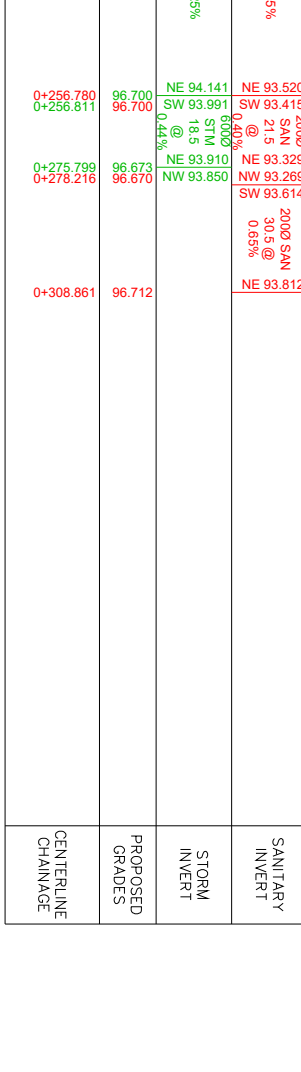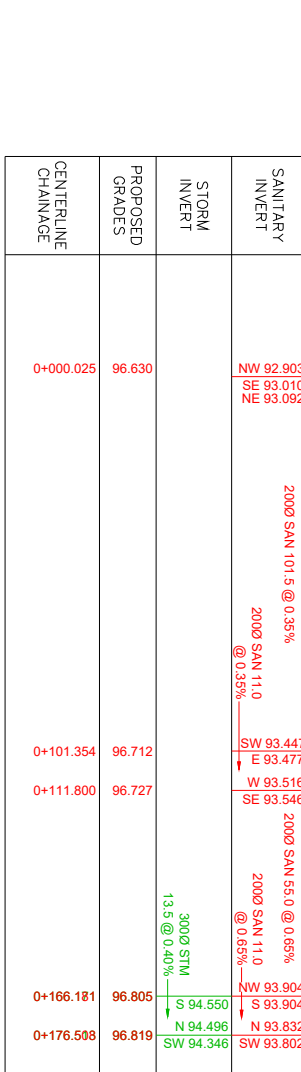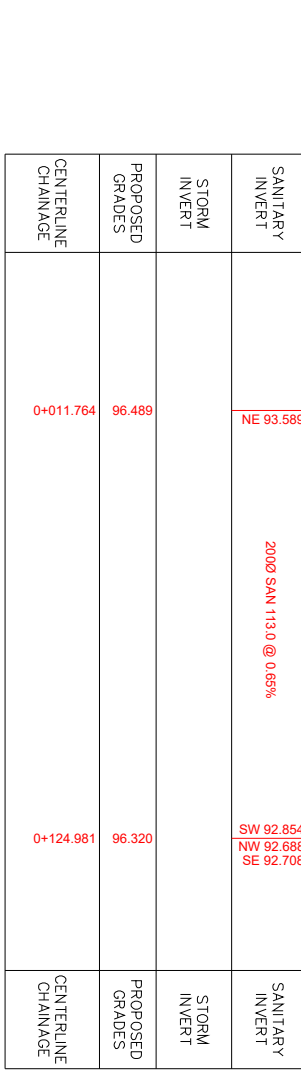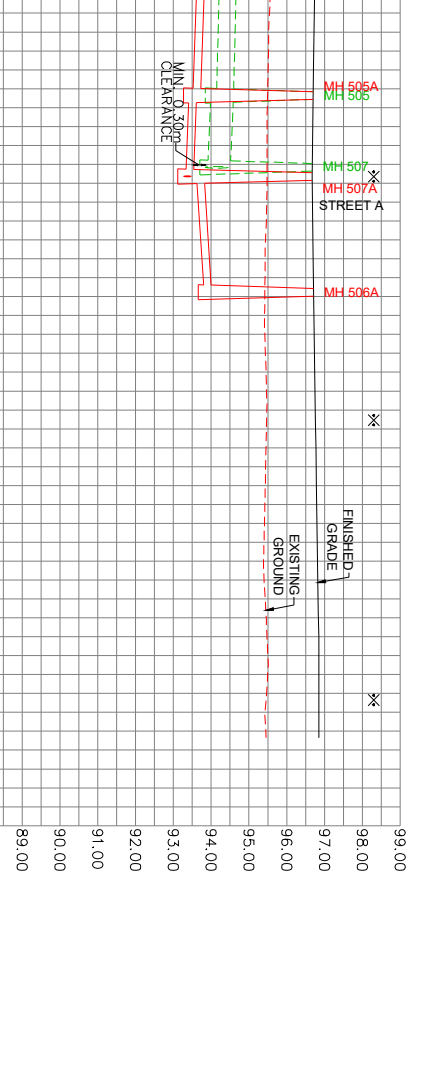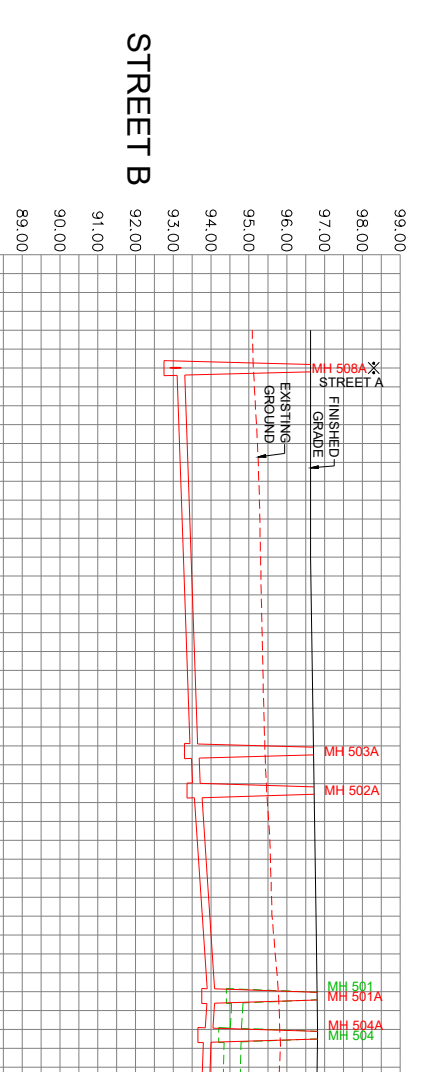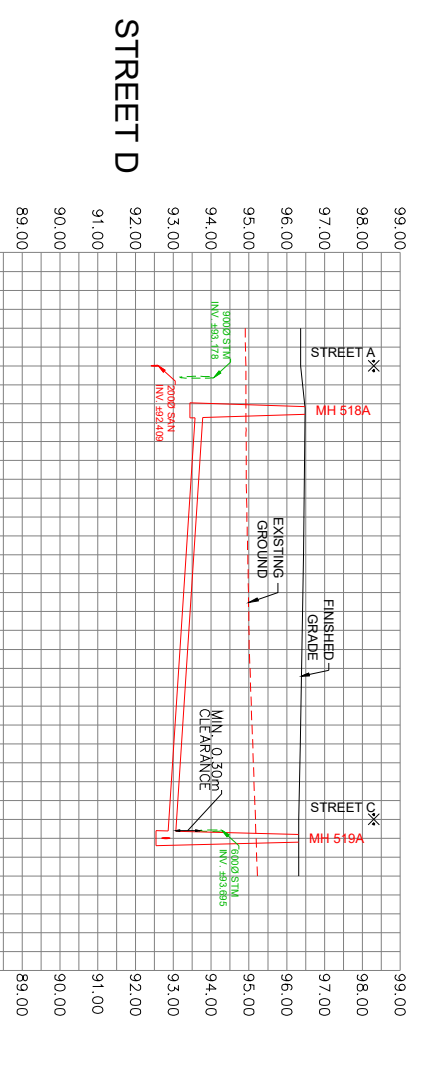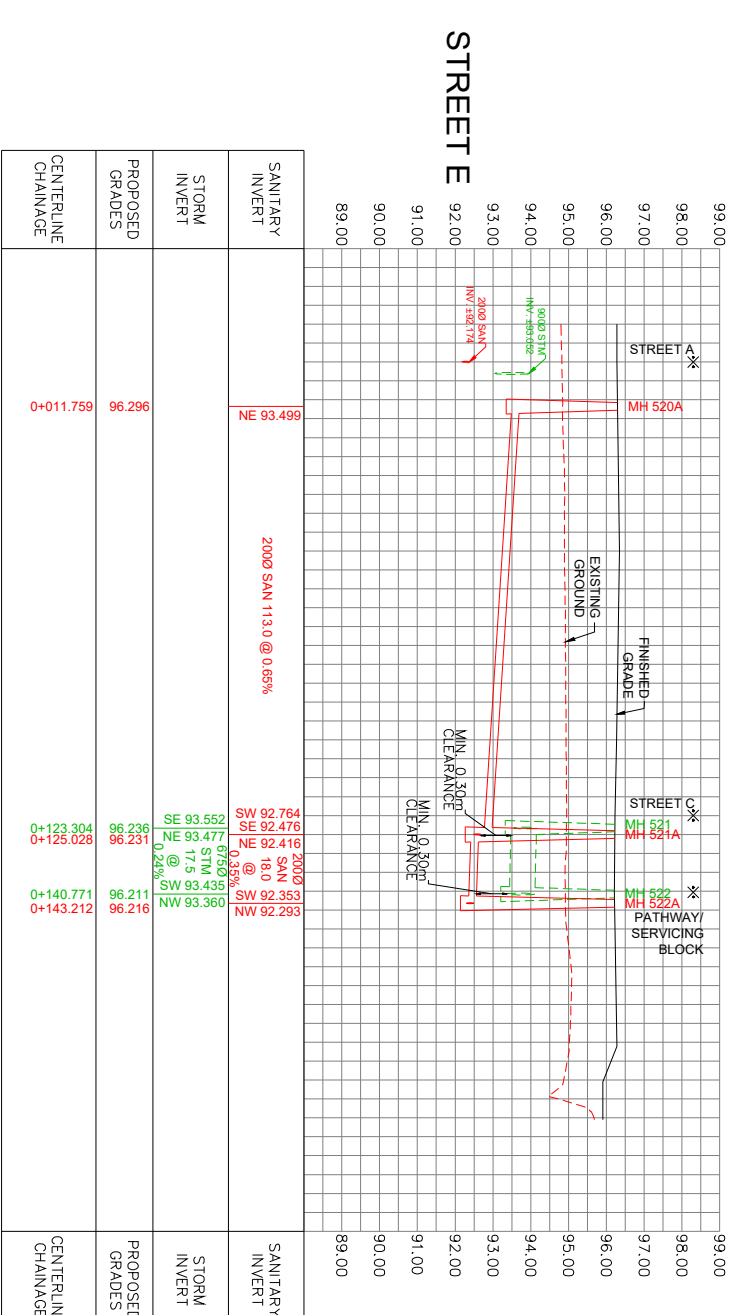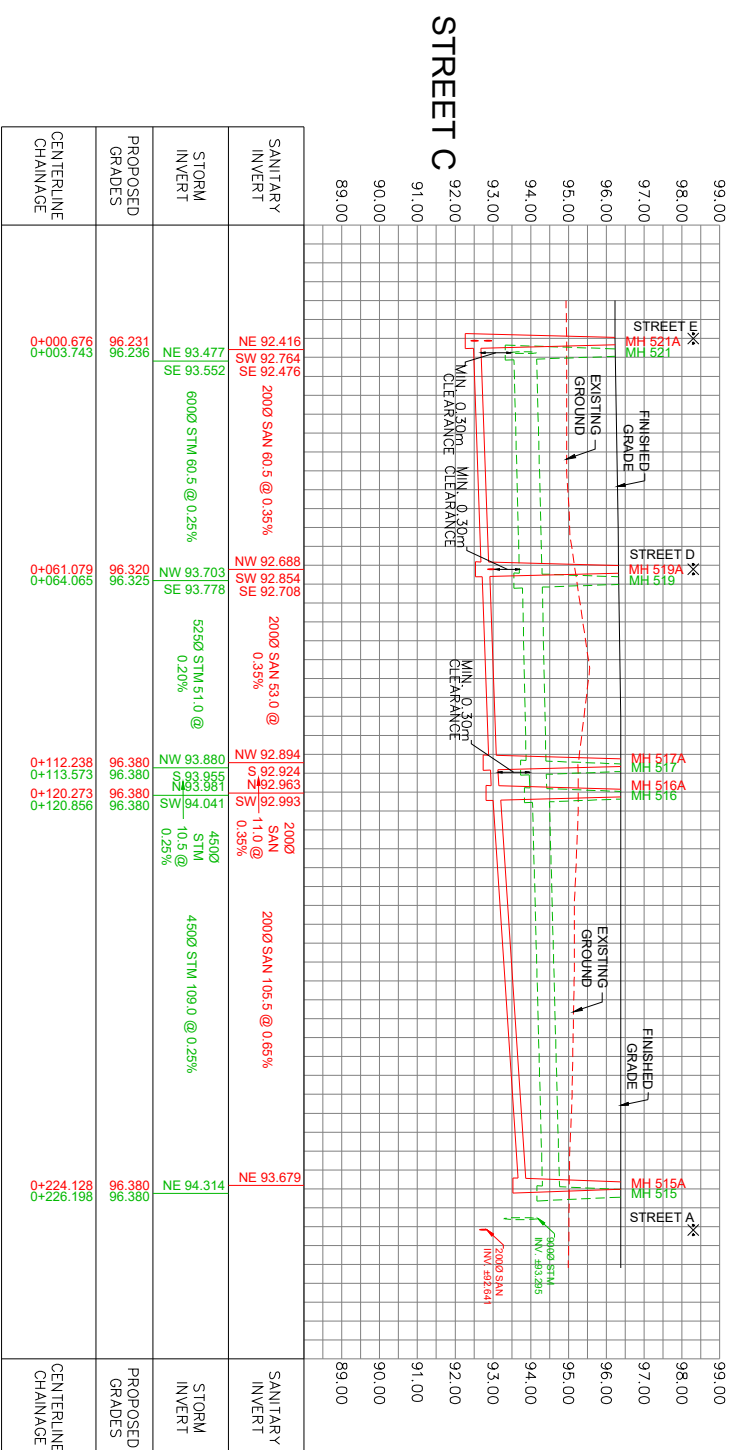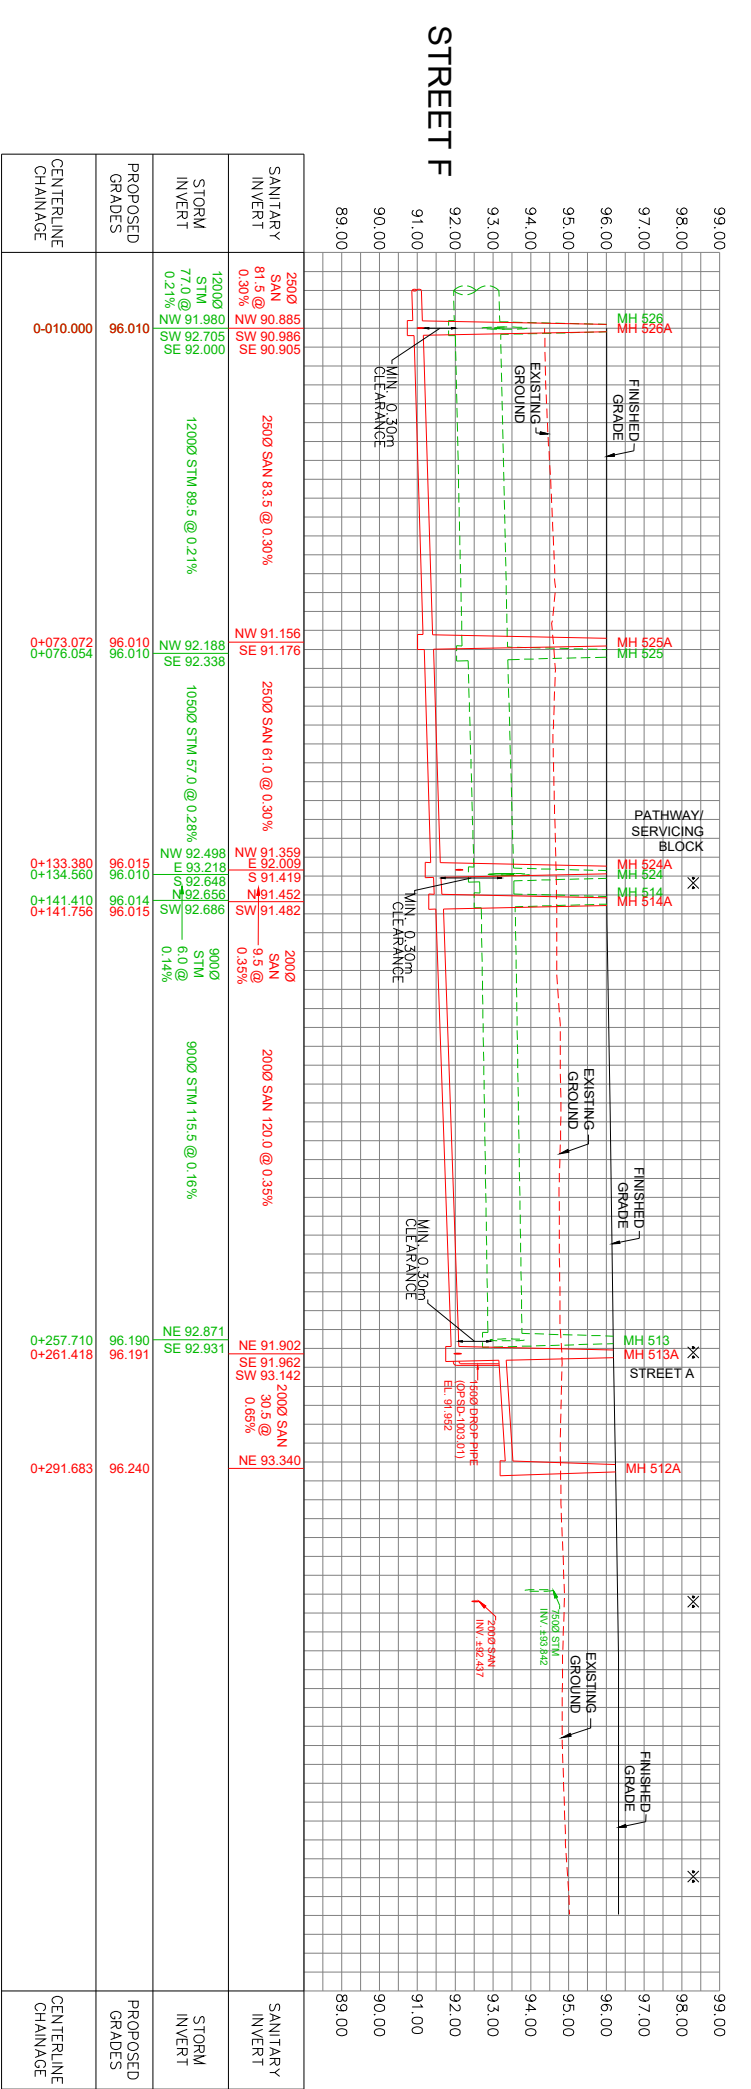

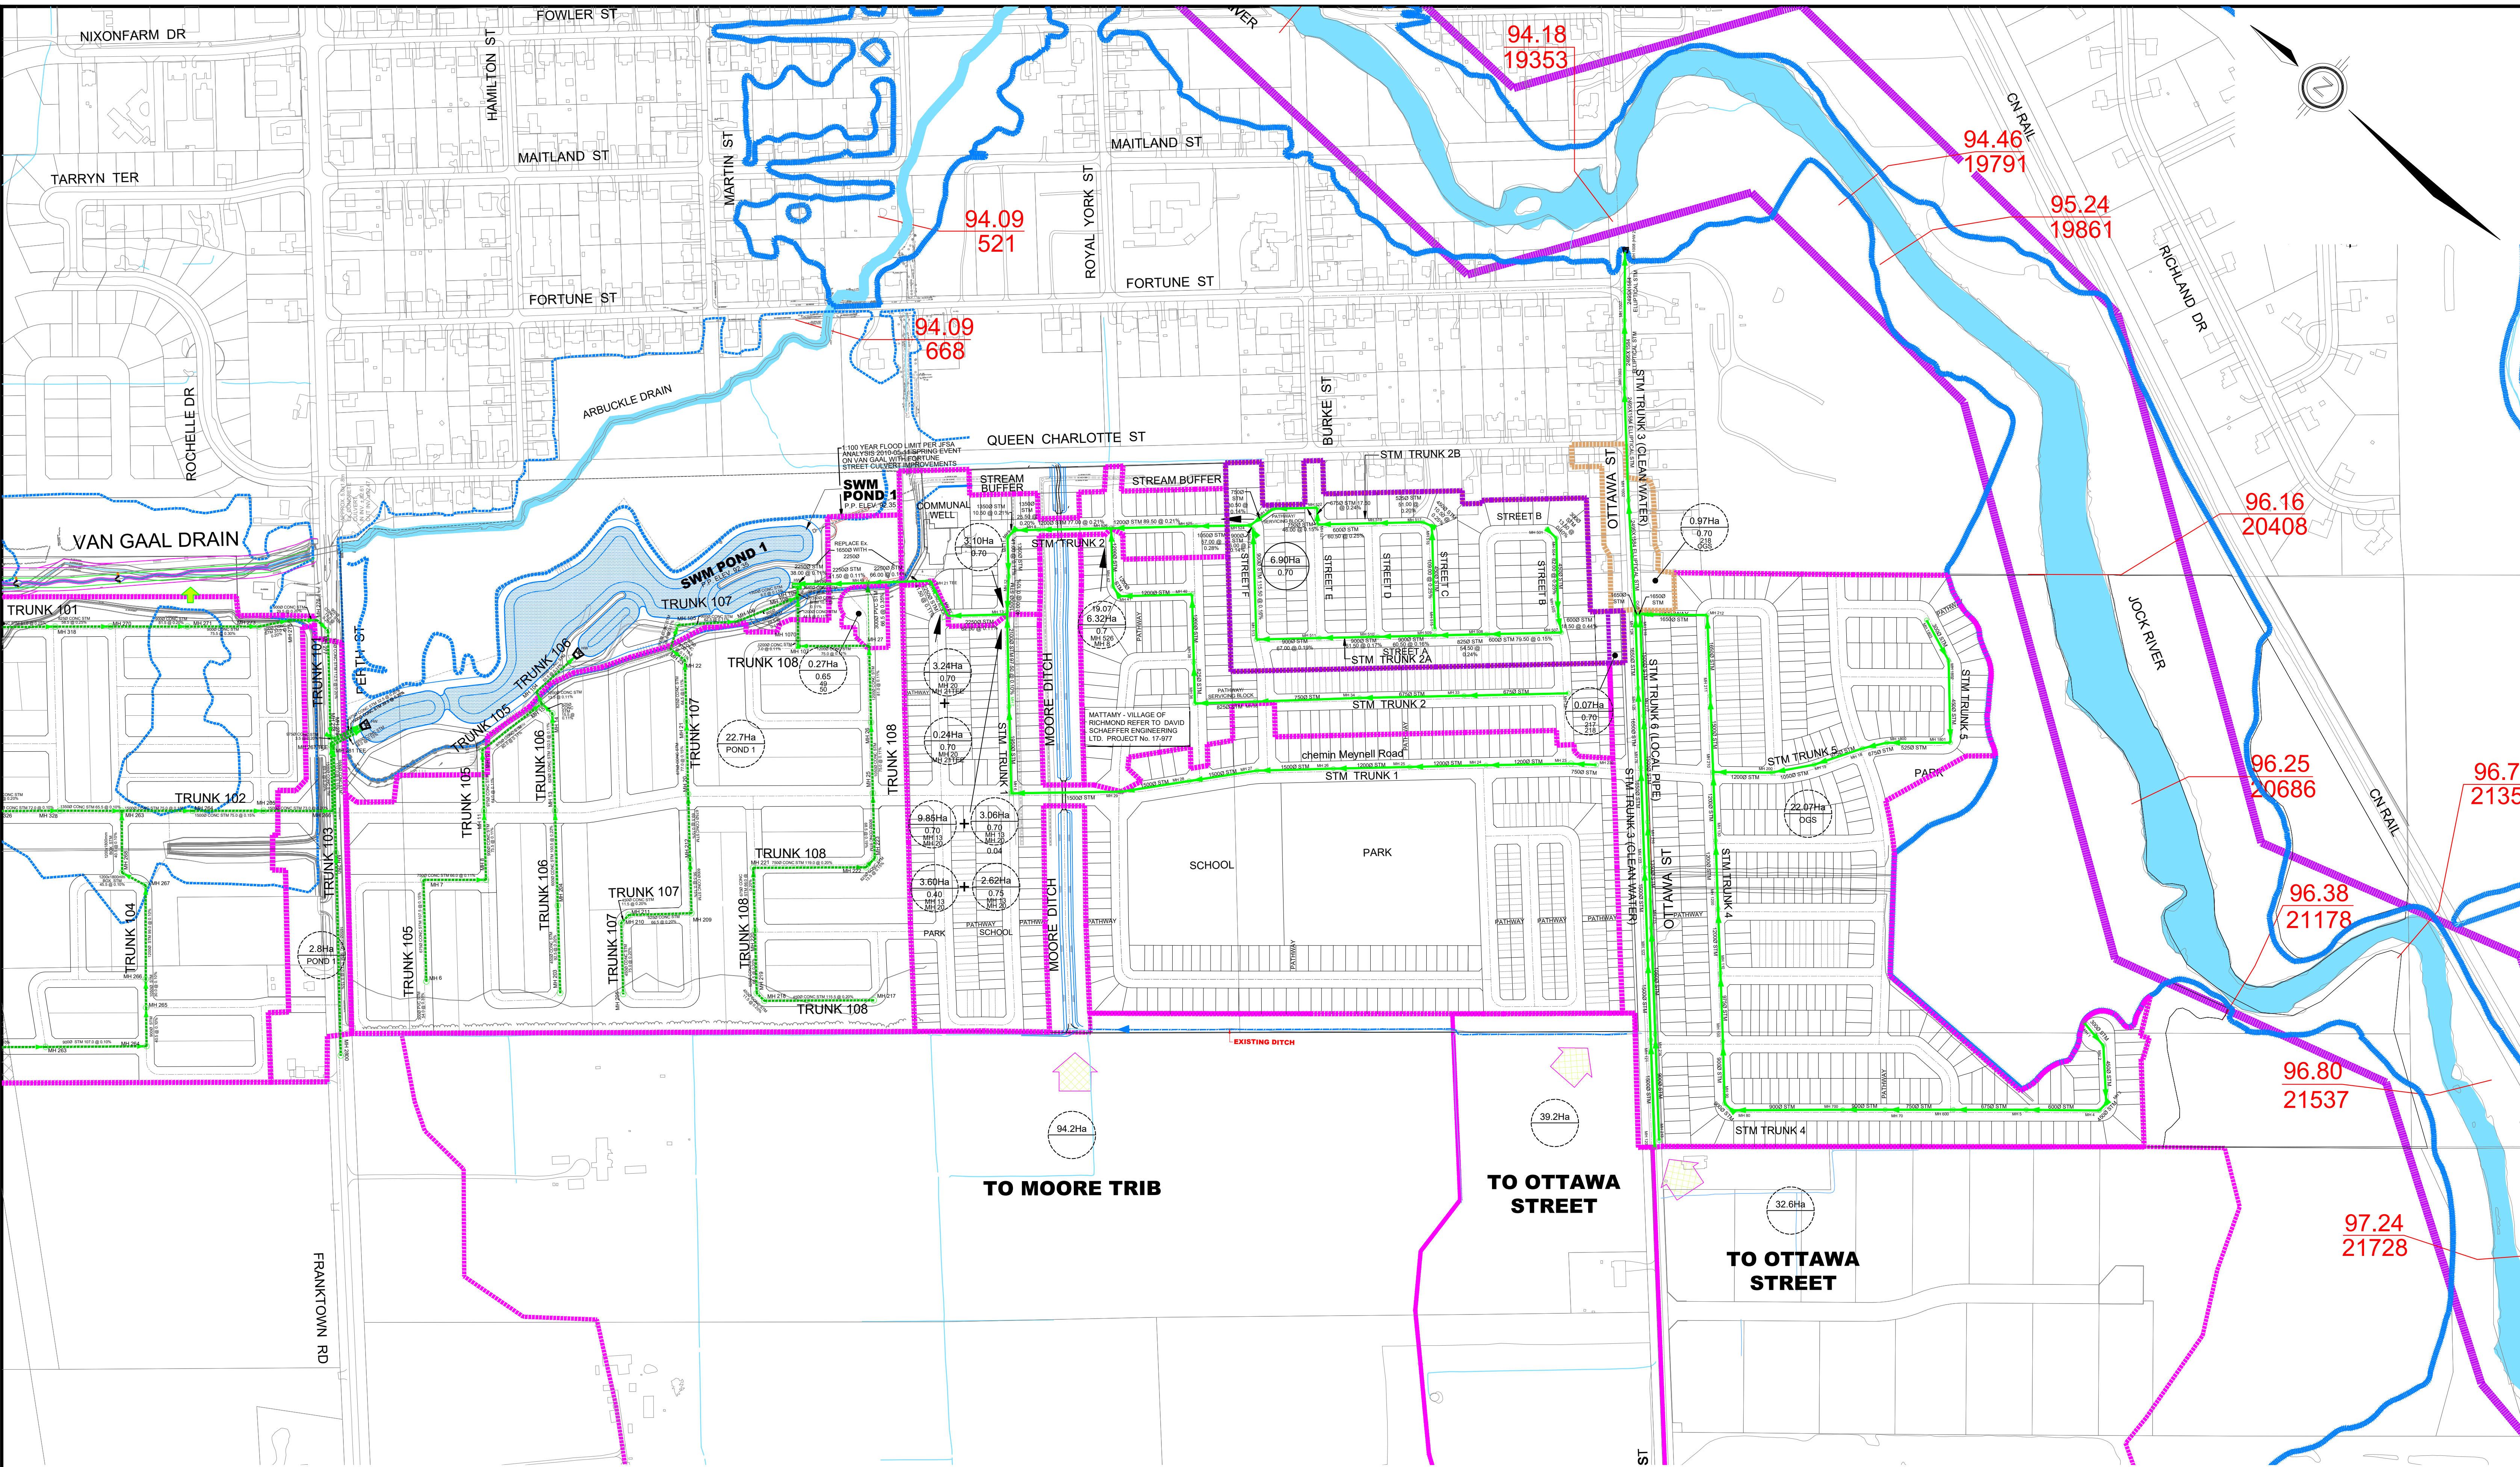

LEGEND

- ▬▬▬▬ SUBJECT LANDS
- ▬▬▬▬ EXISTING DITCH
- ▬▬▬▬ STORM TRIBUTARY AREA
- ▬▬▬▬ EXTERNAL STORM TRIBUTARY AREA
- ▬▬▬▬ STORM TRUNK
- ▬▬▬▬ STORM TRUNK BY OTHERS

0.13Ha
0.70
M1 21.5 STORM FREQUENCY
DRAINAGE AREA
RUN-OFF COEFFICIENT
UPSTREAM/DOWNSTREAM
MANHOLE

0.96Ha
0.7
M1 13 STORM FREQUENCY
EXTERNAL DRAINAGE AREA
RUN-OFF COEFFICIENT
UPSTREAM/DOWNSTREAM
MANHOLE

94.2Ha EXTERNAL DRAINAGE

DSEL
david schaeffer engineering ltd
120 Iber Road, Unit 103
Stittville, Ontario, K2S 1E9
Tel: (613) 836-0856
Fax: (613) 836-7183
www.DSEL.ca

RICHMOND VILLAGE
DEVELOPMENT
CORPORATION
CITY OF OTTAWA

OVERALL STM SERVICING
LAFFIN LANDS

SCALE:	1:3000	PROJECT No.:	20-1184
DATE:	FEBRUARY 2021	DRAWING:	6