


1. STANDARD CROSS-SECTIONS TO BE READ IN CONJUNCTION WITH THE GENERAL STANDARD CROSS-SECTION NOTES AND OTHER APPLICABLE CITY AND UTILITY PLANS AND DETAILS.
2. CONCRETE CURBS TO BE CONSTRUCTED AS PER CITY OF OTTAWA STANDARD DETAILS.
3. TYPICAL FRONT YARD SETBACK IS TO BE CLEAR AND UNENCUMBERED OF ANY SUBSURFACE BUILDING ENCROACHMENTS.
4. FIRE HYDRANTS TO BE LOCATED ON THE WATERMAIN SIDE OF THE STREET.
5. CATCH BASINS TO BE PER CITY OF OTTAWA DETAIL S2.
6. GAS MAIN SHALL HAVE A MINIMUM OF 0.6M CLEARANCE FROM STRUCTURES (E.G. CATCH BASINS AND HYDRANTS) AND 1.2 M FROM TREE ROOT BALL.
7. STREETLIGHTS CAN BE LOCATED ON EITHER SIDE OF THE RIGHT-OF-WAY.
8. GAS MAIN SHALL HAVE A MINIMUM OF 0.6 M CLEARANCE FROM STRUCTURES (E.G. CATCH BASINS AND HYDRANTS) AND 1.2 M FROM TREE ROOT BALL.
9. JOINT-USE UTILITY TRENCH (JUT) UNDER SIDEWALK AS PER DETAIL UDS0049 (REV 22) HELD BY OTTAWA HYDRO.
10. GRADE LEVEL BOX (GLB) AS DRAWN SHOWS GLB3660. EXACT LOCATION TO BE CONFIRMED. THIS CROSS SECTION TO BE USED IF CONCRETE ENCASED HYDRO DUCT OR ANOTHER SEPARATE UTILITY DUCT IS REQUIRED. IF CONCRETE ENCASED HYDRO DUCT IS UTILIZED, INSTALLATION AS PER DETAIL UDS0051.
11. WHEN CONCRETE DUCT BANKS ARE REQUIRED, ADDITIONAL CLEARANCE IS REQUIRED FOR THE INSTALLATION OF A 2.2M X 4.0M MAINTENANCE HOLE PER OTTAWA HYDRO DETAIL UCS0014. LOCATIONS TO BE DETERMINED DURING DESIGN PHASE.
12. TREE CLEARANCES TO HYDRO OTTAWA PLANT SHALL FOLLOW GCS0038.
13. CLEARANCES SHOWN ARE MINIMUMS.

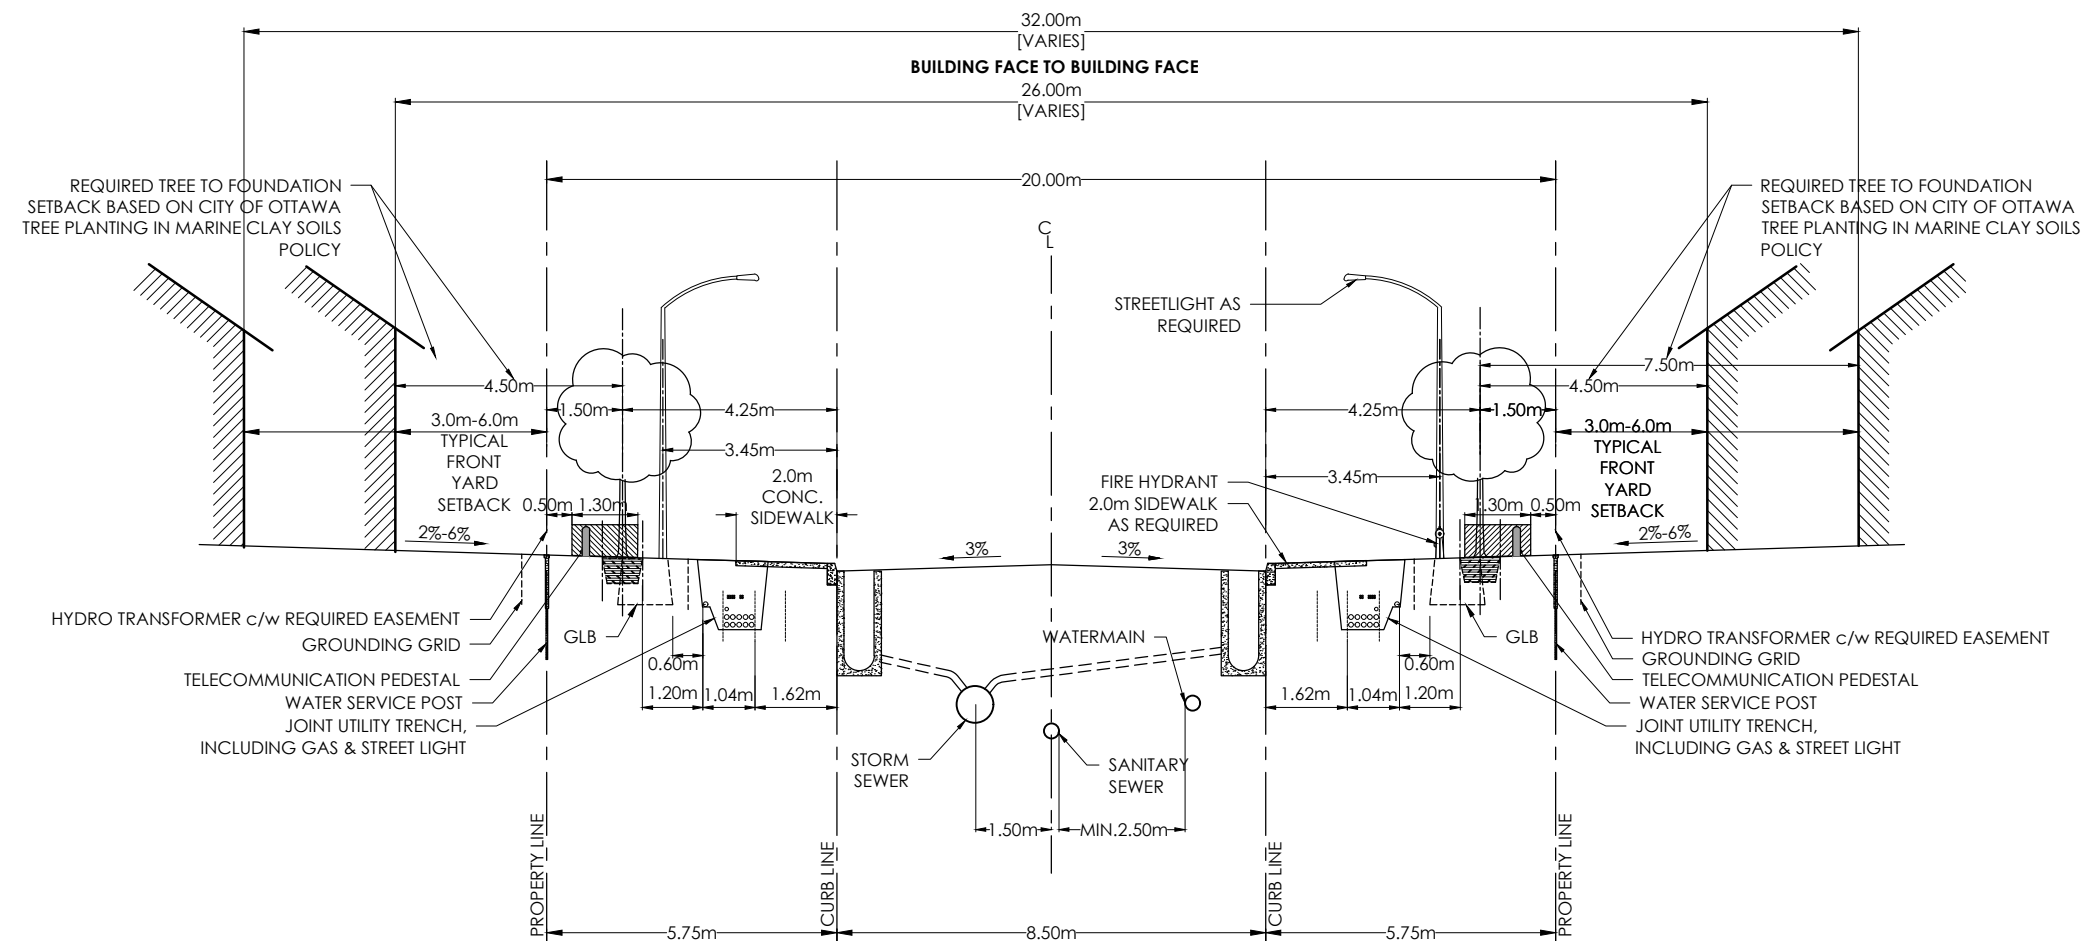

20.0m ROW CROSS SECTION

REV. DATE: AUG. 2022

DWG. No. ROW-20.0