



**Geotechnical Desktop Review:
The LeBreton Flats Plan of
Subdivision. Ottawa. Ontario**

Prepared for:
National Capital Commission

Prepared by:
Stantec Consulting Ltd.
1331 Clyde Avenue
Ottawa, ON K2C 3G4

Project No. 160401780

September 10, 2024



Table of Contents

1.0	INTRODUCTION.....	1
2.0	SITE AND PROJECT DESCRIPTIONS	1
3.0	BACKGROUND INFORMATION	2
3.1	SITE GEOLOGY	3
3.2	SITE TOPOGRAPHY	4
4.0	SUBSURFACE CONDITIONS	6
4.1	GENERAL	6
4.2	OVERBURDEN	6
4.3	BEDROCK	7
4.4	GROUNDWATER CONDITIONS	8
5.0	DISCUSSION AND RECOMMENDATIONS.....	9
5.1	KEY GEOTECHNICAL ISSUES	10
5.2	GEOTECHNICAL MODEL.....	11
5.3	SEISMIC DESIGN CONSIDERATIONS	12
5.3.1	Liquefaction Potential	12
5.3.2	Seismic Site Class	14
5.4	FROST PENETRATION	15
5.5	SITE PREPARATION	16
5.5.1	Site Drainage and Subgrade Protection	17
5.5.2	Grade Raise Restriction	17
5.6	FOUNDATION DESIGN	18
5.6.1	Shallow Foundations	18
5.6.2	Piled Foundations	20
5.6.3	Micropile Foundation System	22
5.6.4	Rock Socketed Caissons	23
5.7	EXCAVATIONS AND RETAINING WALLS	24
5.7.1	Temporary Excavations.....	24
5.7.2	Dewatering.....	27
5.7.3	Earth Pressures on Retaining Walls	27
5.8	PIPE BEDDING AND BACKFILL.....	29
5.9	PAVEMENT DESIGN RECOMMENDATIONS	30
6.0	CONSTRUCTION CONSIDERATIONS AND CONSTRAINTS	31
6.1	UNDERFLOOR DRAINAGE	31
6.2	REUSE OF ON-SITE MATERIALS.....	31
6.3	COLD WEATHER CONSTRUCTION	32
7.0	SUPPLEMENTARY GEOTECHNICAL INVESTIGATION.....	33
8.0	CLOSURE.....	34



LIST OF TABLES

Table 4.1: Summary of the Encountered Bedrock Surface and Auger (or Split-Spoon) Refusal Depth/Elevation and Measured RQD Values	8
Table 4.2: Summary of Groundwater Levels	9
Table 4.3: Stage Elevation of the Ottawa River	9
Table 5.1: Soil and Bedrock Parameters	12
Table 5.2: Preferred Foundation Options	18
Table 5.3: Geotechnical Resistance for Shallow Footings on Competent Native Granular Soils	19
Table 5.4: Geotechnical Resistance for Shallow Footings on Competent Native Cohesive Soils.....	19
Table 5.5: Geotechnical Resistance for Driven Pile at ULS	21
Table 5.6: Micropile Axial Capacities.....	23
Table 5.7: Peak Vibration Limits.....	27
Table 5.8: Non-Seismic Lateral Earth Pressure Parameters (Horizontal Backfill)	28
Table 5.9: Seismic Earth Pressure Parameters (Horizontal Backfill)	29
Table 5.10: Recommended Pavement Structure.....	30

LIST OF APPENDICES

APPENDIX A.....	A.1
A.1 Statement of General Conditions.....	A.1
APPENDIX B.....	B.1
B.1 Drawing No. 1 – Borehole Location Plan	B.1
APPENDIX C.....	C.1
C.1 Borehole Records.....	C.1
APPENDIX D.....	D.1
D.1 Table D.1: Summary of the Encountered Bedrock Surface and Auger (or Split- Spoon) Refusal Depth/Elevation and Measured RQD Values.....	D.1
D.2 Table D.2: Summary of Groundwater Levels	D.1



1.0 INTRODUCTION

Stantec Consulting Ltd. (Stantec) has been retained by National Capital Commission (NCC, the Client) to carry out a geotechnical desktop review for the LeBreton Flats Plan of Subdivision in Ottawa, Ontario. It is understood that a preliminary geotechnical report is required as part of the Plan of Subdivision application to the City of Ottawa.

The geotechnical review was completed to summarize the subsurface conditions at the site and to provide geotechnical recommendations and design parameters. This report presents a summary of the previous investigations at the site and geotechnical design recommendations. Limitations associated with this report and its contents are provided in the Statement of General Conditions included in Appendix A.

2.0 SITE AND PROJECT DESCRIPTIONS

The site is approximately 29 hectare, a largely undeveloped transit oriented brownfield site located at the western edge of the downtown core of Ottawa, within the National Capital Region. The NCC developed a Master Concept Plan (MCP) for LeBreton Flats (approved in April 2021). The MCP area is shown in figure 2.1, the Library Parcel area (665 Albert St., Parcels A9-10) is not included in the MCP. The study area generally bounded by:

- Albert Street and Slater Street to the south;
- Trillium Pathway to the west;
- Sir John A. Macdonald Parkway and Wellington Street to the north; and
- Booth Street, Lett Street, future Empress Avenue extension and the escarpment to the east.

The Confederation Light Rail Transit (LRT) corridor bisects the study area and two O-Train stations, Bayview and Pimisi O-Train, are located within LeBreton Flats. LeBreton Flats is a brownfield site from its industrial legacy, with a portion having been remediated in the mid-2000s.

Two aqueducts cross the site, a partially buried aqueduct (a heritage feature), and a second fully buried aqueduct located on the north side of the LRT corridor between Booth Street and Nepean Bay Inlet. The approximate location of the aqueducts is shown on Drawing No.1 in Appendix B.

The East Flats is an adjacent development east of Booth Street consisting of four to 14 storey residential buildings with a new high rise building currently under construction. To the south of Albert Street is an existing residential neighborhood.

Based on the framework in the MCP, the development will include residential space, office/hotel/loft space and retail space as well as a Park District and open space network comprising approximately 12.5 hectares (43 per cent) of the 29-hectare site. It will include low- to high-rise buildings of up to 45 storeys with underground parking areas, surface pathways and access streets and lanes. The aqueducts will be maintained as a landscaping feature.



The study area is situated in close proximity to major infrastructure. In addition to above-mentioned LRT lines and stations as well as northern covered aqueduct and southern open heritage aqueduct, the following are elements of note:

- Fleet Street Water Pumping Station
- High-Pressure Transmission Watermain
- Low-Pressure Transmission Watermain (within the Open Aqueduct)
- LeBreton Flats Sanitary Pumping Station
- West-Nepean Collector Sewer, Cave Creek Collector Sewer, and Interceptor Outfall Sewer
- Combined Sewage Storage Tunnel
- Miscellaneous Sanitary and Combined Sewer Regulators and Diversion Chambers (Booth-Lloyd and Preston-Lloyd Regulator)



Figure 2.1: LeBreton Flats MCP area

3.0 BACKGROUND INFORMATION

The site was formerly occupied by residences and heavy industries, including a lumber and train yard until the early 1970's. The west portion of the site was formerly part of the Nepean Bay (part of the Ottawa River), which was used as a municipal landfill facility in the late 1950's to the early 1970's. The landfill raised the grade of this land to a level above the Ottawa River and enabled the construction of the Sir John A. Macdonald Parkway. the approximate footprint of the landfill is shown on Drawing No.1 in Appendix B. Most structure were removed from the site in the early 1970's.

A remediation program was conducted in the mid 2010's to remove the contaminated soil located in the central north portion of the site, west of Booth Street. The bedrock surface has been exposed and remains exposed at the time of writing.



The parcels situated south of the LRT alignment are slightly sloped down toward the northwest from Albert Street. The area is generally covered with grass with signs of construction activity and disturbance observed through the area. The west portion of the site, situated south of the Sir John A. Macdonald Parkway and north of the LRT alignment, are generally grass covered with some mature trees dispersed throughout the site.

3.1 SITE GEOLOGY

Based on available information including geological mapping from the Ontario Geological Survey (OGS), available geotechnical reports, historical boreholes, and Stantec's site specific experience, the stratigraphy at the site is generally expected to consist of highly variable fill and overburden native soils, underlain by bedrock.

The bedrock depth varies in different areas of the site and typically ranges from 0 m (existing ground surface) to about 18 m below ground surface. Based on available information obtained from the Geological Survey of Canada (GSC) Surficial Materials and Terrain Features, in the areas to the east of the Nepean Bay to the Pimisi LRT station and to the east of Booth Street Paleozoic bedrock is expected at the ground surface. At the rest of the site, glacial deposits of till (a heterogenous mixture of material ranging from sandy silt to silty sand) on Paleozoic bedrock can be expected.

According to the OGS 1:250 000 scale map of the Bedrock Geology of Ontario, the bedrock at the site is anticipated to be limestone, dolostone, shale, arkose, or sandstone of the Ottawa Group, Simcoe Group, or Shadow Lake Formation. The bedrock geology map produced in Canadian Geology Society, paper 77-11, by Bélanger and Harrison suggests that the site is underlain by limestone and shows a fault (a splay of the regional Gloucester Fault) extending in the east-west direction in the north of the site. The regional Gloucester Fault has a NW-SE strike, extending from Gloucester northwest to Hull. The Gloucester Fault splay at the site area are shown in the following figure. Some of the variations in bedrock surface may be due to presence of these bedrock faulting.





Figure 3.1: The splays of the regional Gloucester Fault at the site area (Bélanger and Harrison, 1976)

A significant number of historical boreholes have been advanced throughout the site. The following studies and reports were reviewed as part of this desktop study:

- Data Gap and Remedial Options Analyses Report, Nepean Bay Sector, LeBreton Flats, Ottawa, ON (Geofirma, 2019)
- Geotechnical Desktop Review Report (Paterson Group, 2020)

3.2 SITE TOPOGRAPHY

Based on the recorded ground surface elevation at the previous borehole locations, ground surface elevation contours provided in Geofirma 2019 report for a western portion of the site (based on City of Ottawa 2006 LiDAR, Light Detection and Ranging, digital elevation survey flown in 2006), and publicly available ground surface (Google Earth) data, the ground surface elevation at the site varied between approximately elevations 52 m to 68 m.

Ground surface elevation contours of a portion of the site to the west of the Nepean Bay and between the Kichi Zibi Mikan (Sir John A. MacDonald Parkway) and the transitway as well as a portion of the site between the transitway and Albert Street and to the west of the access road for the parking lot in the area are provided in Geofirma 2019 report. Topographical relief of this area ranges from a low of about elevation 56 m in the southwest corner to a high of about elevation 67 m in the west part within the footprint of the former landfill. Ground slopes downward from the landfill mound to the southwest and east. Minor elevation highs are also apparent near the western end of this area, along the transitway (elevation 64 m) and in the center of this area, north of the transitway (elevation 63 m). Ground surface elevation of the east of this area ranges from a low of about elevation 53 m in the southeastern part to a high of about elevation 63 m in the center of the area. The central high ground surface is due to landfilling from the landfill



mound ground slopes downward to the north, south and east. South of the transitway, the ground surface slopes gently from a high of about elevation 64 m at the western end to a low of about elevation 58 m along the parking lot access road.



Figure 3.2: Ground surface elevation contours for a portion of the site to the west of the Nepean Bay (Geofirma 2019 report)



4.0 SUBSURFACE CONDITIONS

4.1 GENERAL

Detailed descriptions of the subsurface soil and bedrock conditions are presented on the Borehole Records and Bedrock Core Log provided in Appendix C.

The stratigraphic boundaries on the borehole records are inferred from non-continuous sampling and, therefore, represent transitions between soil types rather than exact boundaries between geological units. The borehole records depict conditions encountered at the specific locations drilled. The subsurface soil and groundwater conditions between boreholes and/or at locations away from the borehole locations will vary from those indicated on the borehole records.

It is noted that information provided in the following sections is intended to summarize the conditions encountered; however, the borehole records provided in Appendix C should be used as the primary source of the subsurface information for the site.

A summary of the subsurface conditions encountered in the boreholes is provided in the following sections. The site has been divided into 4 portions with generally similar subsurface conditions. The site divisions identified as the North Portion, East Portion, South Portion and West Portion are shown on the Borehole Location Plan provided in Appendix B.

4.2 OVERBURDEN

North Portion of Site

Generally, a slightly weathered limestone bedrock was encountered at ground surface at the borehole locations (MW13-1 to MW13-6, MW13-10 to MW13-15, and BH11-21). At other borehole locations, the bedrock was encountered at 2.7 m to 4.8 m depth (or elevations of 50.9 m to 52.4 m). The bedrock contains thin interbeds of dark shale and the rock quality generally increase to good to excellent with depth.

The overburden was removed from the land parcels where a remedial program was completed. A silty sand fill and gravel is overlying the bedrock surface at a small section, where Preston Street formerly extended to the Sir John A. Macdonald Parkway. The buried aqueduct runs from west to east at this portion of the site, the cover material consisted of a silty sand with gravel and cobbles fill material.

South Portion of Site

Boreholes located along Albert Street and south of the transitway alignment generally encountered a loose to compact silty sand fill layer containing gravel, cobbles, boulders, construction debris, such as brick, wood, slag, and ashes. The fill layer was generally underlain by a compact to very dense fluvial deposit of gravel, cobbles and boulders within a silty fine sand soil matrix. However, loose/very loose sand/silty sand was encountered at several boreholes.



A silty clay and clayey silt deposit was encountered underlying the fill material between the old Preston Street extension and former Broad Street. A thin deposit of peat was also encountered at some borehole locations.

Bedrock surface is variable in this portion of the site and bedrock was encountered at 3.5 m to 9.2 m depth (or between elevation 48.1 m and elevation 51.9 m) at borehole locations within this area. The bedrock surface appears to be deeper toward the east within this portion of site.

West Portion of Site

The former Nepean Bay landfill was located at the west portion of the site. A layer of silty sand and gravel fill with various amount of debris, including wood, brick and plastic was encounter at borehole locations in this portion of the site. The fill layer is up to 12 m thick in the central portion of the former landfill and could be as high as 19 m at landfill mounds (Geofirma 2019). The approximate footprint of the former landfill is shown on Drawing No.1 in Appendix C. To the south of the transitway the fill layer is generally 1.5 m to 4.9 m thick.

The fill material was underlain by a variety of deposits. To the north of the transitway, a (0.1 m to 1.5 m thick) peat deposit was encountered at four boreholes (BHW-09, BHW-11, BHW-15, and MW01-7). A firm to stiff silty clay deposit was encountered underlying the fill material in borehole BH10-04 and BH11-17. A compact native grey fluvial deposit of sand, gravel, cobbles and boulders within a silt sand soil matrix was encountered underlying the fill material at the rest of boreholes. Loose/very loose sand/silty sand was encountered at several boreholes. Cobbles and boulders were encountered in some boreholes located south of the transitway (e.g. below 8.5 m at BH10-01, below 4.2 m at BH10-05, and below 3.2 m at BH11-09).

Bedrock, described as a highly weathered black shale, was encountered in some borehole locations in this portion of the site. The bedrock was encountered at 3.7 m to 15.4 m depth (or between elevation 45.0 m to elevation 50.8 m) at borehole locations to the north of the transitway within this portion of the site. To the south of the transitway, the bedrock was encountered at 5.6 m to 11.0 m depth (or between elevation 46.5 m and elevation 50.0 m). No bedrock coring was carried out in boreholes to the west of the City Center Avenue.

East Portion of Site

Generally, a silty sand fill layer overlying a compact native glacial till or bedrock was encountered at boreholes at the east portion of the site, to the east of Booth Street and North of Fleet Street. The bedrock was encountered at 2.2 m to 3.8 m depth (or between elevation 51.5 m to elevation 53.2 m) at the borehole locations within this portion.

At the block situated east of Booth Street and to the south of the open aqueduct, fill material overlain bedrock. Bedrock was cored at one borehole (MW13-8) at 4.9 m (or elevation of 51.0 m). Fill material (3.0 to 4.6 m thick) overlying till were encountered at boreholes located at the parcels situated between Slater Street and Albert Street.

4.3 BEDROCK

Bedrock was proven by rock coring at several boreholes at the site. Bedrock surface depth/elevation encountered along with the measured RQD values are presented in Appendix D. A summary of bedrock surface depth/elevation is presented in the following table. Based on the data provided in the table:

- the bedrock depth ranges from 0 m (existing ground surface) to about 16.6 m below ground surface.
- the bedrock surface was encountered between approximate elevations of 45.0 m and 59.4 m.



Depths/elevations of auger refusal (or split-spoon refusal) encountered at boreholes are also included in the table. Split-spoon driving refusal or auger refusal may be due to the presence of cobbles and boulders or due to the presence of bedrock.

The bedrock encountered in boreholes consisted slightly weathered to fresh, very poor to excellent quality (with Rock Quality Designation, RQD, of zero to 100%), of either limestone with interbedded shale or shale. The RQD reflects the degree of fracturing which is an expression of the cumulated length of the rock pieces longer than 100 mm. The bedrock is generally slightly weathered at and near surface and rock quality increases with depth. Results of two Unconfirmed Compressive Strength (UCS) tests on rock specimens are reported on the available record of boreholes: 75.9 MPa (7.4 m depth, BH13-7) and 127.9 MPa (9.6 m depth, MW13-8). Based on these results, the limestone bedrock at the site could be classified as strong to very strong.

Table 4.1: Summary of the Encountered Bedrock Surface and Auger (or Split-Spoon) Refusal Depth/Elevation and Measured RQD Values

Location	-	Bedrock Surface Depth (m)	Bedrock Surface Elevation (m)
North Portion the Site	Minimum	0.0	50.2
	Maximum	5.5	55.1
	Average	1.3	53.0
South Portion of the Site	Minimum	3.1	48.1
	Maximum	10.1	53.9
	Average	5.3	51.4
East Portion of the Site	Minimum	2.2	51.0
	Maximum	10.0	59.4
	Average	4.8	55.6
West Portion of the Site	Minimum	1.6	45.0
	Maximum	16.6	59.4
	Average	7.7	49.6

4.4 GROUNDWATER CONDITIONS

Several monitoring wells were installed in boreholes previously advanced at the site. The groundwater levels measured in these monitoring and observed during drilling (inferred groundwater level) are provided in Appendix D and are summarized in the following table.



Table 4.2: Summary of Groundwater Levels

Location	-	Groundwater Depth (m)	Groundwater Elevation (m)
North Portion the Site	Minimum	1.1	49.2
	Maximum	6.7	52.3
	Average	3.7	51.4
East Portion of the Site	Minimum	2.1	51.4
	Maximum	5.0	59.6
	Average	3.5	52.9
West Portion of the Site	Minimum	1.7	52.1
	Maximum	9.8	54.1
	Average	5.6	53.1

Based on the data presented in the preceding table, the groundwater elevation range between 49.2 m to 59.6 m at the site. The groundwater was measured at depths between 1.1 m to 9.8 m.

It should be noted that fluctuations in the groundwater levels should be anticipated during and following periods of sustained precipitation and snowmelt as well as throughout the various seasons. As well, lower water levels would be expected during severe drought conditions.

Considering the vicinity of the site to the Ottawa River, the groundwater level at the site should be expected to be affected by the stage elevation of the river. Based on the data provided by Ottawa River Regulation Planning Board¹, the river water level at upstream and downstream of the site are as follows:

Table 4.3: Stage Elevation of the Ottawa River

Stage Elevation of the Ottawa River.	On 2024-01-03	Historic Low	Historic High
Lake Deschenes at Britannia (upstream of the site)	58.3 m	57.4 m - 58.1 m	60.7 m – 58.5 m
Gatineau/Hull (downstream of the site)	41.7 m	41.6 m - 40.9 m	41.6 m – 45.2 m

5.0 DISCUSSION AND RECOMMENDATIONS

This section provides preliminary engineering input related to the geotechnical design aspects of the proposed development based on our interpretation of the available subsurface information described herein and our understanding of the project requirements.

The discussion and recommendations presented in the following sections of this report are intended to provide the designers with preliminary information for planning and design purposes only. Contractors bidding on or undertaking the works should examine the factual results of the investigation, satisfy themselves as to the adequacy of the

¹ <https://ottawariver.ca/conditions/>



information for construction, and make their own interpretation of the data as it affects their proposed construction techniques, schedule, safety, and equipment capabilities.

The following geotechnical input is based on the information that was available at the time of writing this report. As not all details (e.g., final building configurations and site grades, structural loads etc.) related to the proposed development were available at the time of preparation of this report, all geotechnical comments and input provided herein should be reviewed and revised, as required, as the design progresses and once the final plans become available.

5.1 KEY GEOTECHNICAL ISSUES

Key geotechnical issues that require consideration for this project include the following:

- The bedrock was encountered at depths varying from 0 (at ground surface) to 16.6 m at borehole locations at the site.
- The subsurface at the site is consisted of either bedrock or fill and/or native soils overlying bedrock. The proposed buildings could be founded on conventional shallow footings placed on an approved competent native soil subgrade or sound bedrock bearing surface. Where higher geotechnical capacity is required, consideration could be given to deep foundation (caisson, steel pipe or h-pile on bedrock, or micropiles socketed into bedrock): The preferred foundation options for each portion of the site is provided in Table 5.2.
- The overburden at site includes topsoil, fill, occasionally peat deposit and native soils. Topsoil, peat deposit, and all fills mixed with topsoil and organic soils should be removed from the proposed building footprint and paved areas.
- The former Nepean Bay landfill was located at the west portion of the site. Based on the LeBreton Flats Master Concept plan, this portion of site will be redeveloped to a park Districts. As such, building construction is not expected within the former landfill area. Significant debris and waste (including concrete, ash, mortar, wood, wood chips/fragments, glass, brick, slag, asphalt, plastic, rubber, metal, coal, and construction debris of former roadways, buildings, and sidewalks) were found within the fill material across the site.
- As part of the site preparation works, fill material and loose/very loose native soils which is not suitable for founding foundation and construction of slab-on-grade, need to be removed from the building footprint. Alternatively, in-situ densification of soils at the site via shallow surface compaction or dynamic compaction could be considered. Dynamic compaction ground improvement techniques (such as Deep Dynamic Compaction or Rapid Impact Compaction) are effective for compacting fills as well as loose native sandy or relatively free-draining soils.
- Considering the presence of bedrock at ground surface and shallow depths, bedrock removal may be required to construct the proposed underground levels and utilities. Depending on the quantities of bedrock to be removed, hoe ramming (where only small need to be removed) or line drilling and controlled blasting (where large quantities of bedrock need to be removed) is recommended.
- The blasting operations should be planned and completed under the guidance of a professional engineer with experience in blasting operations. Critical infrastructure sensitive to vibrations is present within and near the site, such as the aqueducts, Fleet Street Water Pumping Station, City of Ottawa High-Pressure Transmission Watermain, City of Ottawa Low-Pressure Transmission Watermain and several large diameter sewers. Vibration monitoring will be required during construction.
- It should be anticipated that an underslab drainage system will be required to control groundwater, particularly during wet seasons, where basement/underground floors are proposed.
- It is recommended that a groundwater monitoring program be implemented to help assess variability in the groundwater levels at the site.
- The silty overburden soils at the site are typically expected to be highly frost susceptible. All foundations founded on frost-susceptible materials should be provided with a minimum of 1.8 m of earth cover or equivalent insulation



for frost protection purposes. The bedrock at site could be considered non-frost susceptible provided that the weathered or loose bedrock are removed.

- The liquefaction assessment indicates that a 1.3 m to 1.6 m thick portion of native deposits at the site is considered susceptible to liquefaction at five borehole locations (BH10-1, BH10-2, BH11-18, BH11-19, and BH11-29). Earthquake-induced settlements in the order of 90 mm to 200 mm should be anticipated. For building structures supported on deep foundations, these settlements would apply only to non-pile supported elements, such as the basement floor slab. Shallow foundations are not recommended where soils are considered susceptible to liquefaction. To improve soil resistance against liquefaction consideration could be given to in-situ densification of soils at the site.
- Generally, where liquifiable soils are present, a Site Class F is applicable to the site. If in-situ densification of site soil is conducted, the seismic site class designation could be reviewed based on the results of the final verification testing of the in-situ densification.
- Where soils are not susceptible to liquefaction, the applicable seismic site class to each portion of site is as follows:
 - For the East and North Portions of Site: Where the footing will be placed on bedrock or if the underside of the footings are located within 3 m of the bedrock surface, Site Class 'B' is recommended. If there is more than 3 metres of softer materials present above the bedrock, the use of a Site Class 'C' designation is recommended.
 - For the South Portion of Site: Where the footing will be placed on bedrock or if the underside of the footings are located within 3 m of the bedrock surface, Site Class 'B' is recommended. If there is more than 3 metres of softer materials present above the bedrock, the use of a Site Class 'D' designation is recommended.
 - For the West Portion of Site, the use of a Site Class 'D' designation is recommended.
 - Geophysical testing could be carried out to measure the in-situ shear wave velocity of the subsurface soils and bedrock at the site to potentially improve the recommended Seismic Site Class.

The following sections incorporate the above-mentioned key geotechnical issues.

Based on a recent Methane Monitoring Report for the site (2023 Semi-Annual Nepean Bay Methane Monitoring Report, Former Nepean Bay Landfill, Ottawa, Ontario, NCC Property Asset Numbers 96030 and 96129, prepared by Geofirma, dated January 19, 2024), elevated methane concentrations (above the lower explosive limit, LEL) have been recorded on some monitoring well locations at the site since methane monitoring programs have begun in 1998. The detailed design will need to evaluate the risk of landfill gases presence at the site.

5.2 GEOTECHNICAL MODEL

Based on a compilation of all geotechnical data and testing carried out at the site as presented on the Borehole Records and geotechnical laboratory testing (grain size analyses, Atterberg limits, and moisture contents) carried out at the site. The soil parameters provided in the following table were estimated and were used for geotechnical design in the following section of the report.



Table 5.1: Soil and Bedrock Parameters

Soil/Rock Type	Design Parameters		
	Total Unit Weight, γ (kN/m ³)	Friction Angle, ϕ' (°)	Undrained Shear Strength, S_u (kPa)
Fill	19	30	-
Clay	19	-	50
Till (generally compact to very dense silty sand)	20	30	-
Limestone with interbedded shale or Shale Bedrock ⁽¹⁾	26	UCS = 70 MPa	

Notes:

¹ The bedrock depth ranges from 0 m (existing ground surface) to about 16.6 m below ground surface. The bedrock surface was encountered between approximate elevations of 45.0 m and 59.4 m.

² The groundwater level within the site was approximately 1.1 m to 9.8 m below the ground surface (or at approximate elevations of 49.2 m to 59.6 m).

5.3 SEISMIC DESIGN CONSIDERATIONS

5.3.1 Liquefaction Potential

Loose/very loose sand/silty sand was encountered at several boreholes in southern and west portion of the site (generally south of the transitway between Booth Street and City Center Avenue). Generally, this material if saturated is prone to liquefaction.

The potential liquefaction of the site native soils under seismic loading conditions was assessed using the analysis methodology suggested by Idriss and Boulanger (2008)⁴. The evaluation was completed based on the SPT resistance values (SPT-N values with depth) from the boreholes and based on the following:

- A Site Adjusted PGA of 0.281g.
- An earthquake magnitude of 6.3.

The formulation by Idriss and Boulanger (2008)² compare the earthquake induced cyclic stress ratios (CSR) with the cyclic resistance ratios (CRR) of the soil based on the soil SPT-values. These formulations are discussed in detail in Idriss and Boulanger (2008) with an example illustrated on Page 118 (subsection 3.14).

The factor of Safety values were calculated based on the recorded SPT-N values within the native soils from the different boreholes. The assessment indicates that the native soils are considered susceptible to liquefaction (factor of safety against liquefaction of less than one) at the following depths and locations:

- From 4.3 m to 7.5 m at BH10-1
- From 4.0 m to 7.6 m at BH10-2
- From 4.3 m to 4.9 m, 5.5 m to 6.8 m, and 7.3 m to 8.5 m at BH11-18
- From 4.9 to 7.2 m at BH11-19
- From 1.7 m to 2.4 m and 3.0 m to 3.6 m at BH11-29

² Idriss, I.M. and Boulanger, R.W. (2008). "Soil Liquefaction During Earthquakes", Earthquake Engineering Research Institute, Monograph MNO-12, 2008



As a result of liquefaction, earthquake-induced settlements in the order of 90 mm to 200 mm should be anticipated. For building structures supported on deep foundations, these settlements would apply only to non-pile supported elements, such as the basement floor slab. Shallow foundations are not recommended where soils are considered susceptible to liquefaction (factor of safety against liquefaction of less than one) at the following depths and locations.

Moreover, thin layers of loose sand/silty sand was encountered at several boreholes (such as BH92-C1, BH10-17, BH10-20, MW3-23, BH10-05, BH11-06, BH11-14, BH11-15, BH11-17, BH11-18, BH11-20A, BH11-22, and BH11-28) which should be considered susceptible to liquefaction; however, since the thickness of liquifiable layer is 0.6 m to 0.8 m, the manifestation of liquefaction at surface is less likely and post-liquefaction settlement is expected to be limited.

It should be noted the above assessment was carried out only on native soils, existing loose to very loose sand or silty sand fill, if saturated, will be susceptible to liquefaction at the site.

5.3.1.1 Considerations For In-situ Densification

To improve soil resistance against liquefaction consideration could be given to in-situ densification of soils at the site. Dynamic compaction is a ground improvement technique that is effective for compacting fills as well as loose native soils. The main advantages offered by the process are its low cost, rapidity of execution, and applicability to a large variety of constructed fills and loose natural sandy or relatively free-draining soils. Caution should be applied with other soils.

Dynamic compaction requires a controlled application of dynamic stresses to the ground surface. Dynamic compaction can produce significant vibration outside the treatment area. The effect of this induced vibration on structures must be considered during design.

Deep dynamic compaction (DDC)

One method of dynamic compaction is Deep Dynamic Compaction (DDC) with drop weights, which involves using a crane to drop weights of between 5 to 30 tons, from heights of up to 30 m. DDC compacts to depths of as much as 8–10 m. This technique is best suited to large, open sites where few obstructions are present.

The vibrations caused by dynamic compaction can potentially be detrimental to existing structures. Therefore, it's crucial to conduct a thorough analysis and take necessary precautions when performing dynamic compaction near existing structures to mitigate potential damage. This might include monitoring vibration levels, adjusting the compaction process as needed, and implementing mitigation measures if necessary.

During its execution, the process should be continuously monitored to evaluate the degree of soil improvement being achieved and for other environmental considerations such as potential damage to nearby structures and annoyance to surrounding population from vibrations and noise. Earthworks carried out to level the site after each phase and to replace non-compactable materials with suitable soils are also part of the operation. Final verification testing to ensure that the specification requirements have been fulfilled must be performed upon completion of the treatment.

Rapid impact compaction (RIC)

Rapid impact compaction (RIC) follows the same principles as DDC but utilizes smaller equipment and a faster construction technique that results in compaction depths of up to 6 m. RIC involves the use of a hydraulic



hammer/weight, typically 7.5–12 tonnes, which is dropped from 0.3 to 2 m onto a 1.5–2.0 m diameter plate at a rate of about 40–60 blows per minute.

Like DDC, RIC can produce noise and vibration; however, generally at a higher frequency (lower damage criteria), resulting in a shorter distance propagation than that produced by DDC. An assessment of influence and a vibration study are prudent measures when employing dynamic methods such as DDC and RIC.

Vibration studies involve the identification of the typical zone of influence of a given technique and then, applying a factor of safety, identifying the various receptors, structures, or stakeholder property in the factored zone of influence and determining if further steps are needed, such as site- and structure-specific vibration monitoring during compaction work.

5.3.2 Seismic Site Class

The seismic Site Class value, as defined in Section 4.1.8.4 of the 2012 Ontario Building Code (OBC), contains a seismic analysis and design methodology which uses a seismic site response and site classification system defined by the shear stiffness of the upper 30 m of the ground below the foundation level. There are six site classes (from A to F), decreasing in stiffness from A (hard rock) to E (soft soil); Site Class F denotes problematic soils for which a site-specific evaluation is required.

Generally, where liquifiable soils are present, such as discussed in the previous section, a Site Class F is applicable to the site. Liquifiable soils (more than 0.8 m in thickness) were observed in five boreholes (BH10-1, BH10-2, BH11-18, BH11-19, and BH11-29), and the liquifiable thickness was up to 2.6 m. Considering that the thickness and extend of the liquifiable soil is limited, a site-specific response analysis is not necessary and a Site Class E could be considered in design. If in-situ densification of site soil is conducted, the seismic site class designation could be reviewed based on the results of the final verification testing of the in-situ densification.

The bedrock was encountered at depths varying from 0 (at ground surface) to 16.6 m at borehole locations at the site. Where the footing will be placed on bedrock or if the underside of the footings are located within 3 m of the bedrock surface (i.e. there is 3 metres or less of soil between the bedrock surface and the bottom of the footings), Site Class 'B' is recommended.

Geophysical testing (using the multi-channel analysis of surface waves (MASW) method) could be carried out to measure the in-situ shear wave velocity of the subsurface soils and bedrock at the site to potentially improve the recommended Seismic Site Class.

The seismic site class applicable to the North Portion, East Portion, South Portion and West Portion of the site is discussed in the following paragraphs.

North Portion of Site

Bedrock was generally encountered at ground surface or at 2.7 m to 4.8 m depth at borehole locations. Where the footing will be placed on bedrock or if the underside of the footings are located within 3 m of the bedrock surface (i.e. there is 3 metres or less of soil between the bedrock surface and the bottom of the footings), Site Class 'B' is recommended. If there is more than 3 metres of softer materials (not susceptible to liquefaction) present above the bedrock, the use of a Site Class 'C' designation is recommended.



South Portion of Site

Bedrock surface is variable in this portion of the site and appears to be deeper toward the east within this portion of site. Bedrock was encountered at 3.5 m to 9.2 m depth at borehole locations within this area. Native soil overlain the bedrock generally consisted of a compact to very dense fluvial deposit of gravel, cobbles and boulders within a silty fine sand soil matrix. However, loose/very loose sand/silty sand was encountered at several boreholes

Where the footing will be placed on bedrock or if the underside of the footings are located within 3 m of the bedrock surface (i.e. there is 3 metres or less of soil between the bedrock surface and the bottom of the footings), Site Class 'B' is recommended. If there is more than 3 metres of softer materials (not susceptible to liquefaction) present above the bedrock, the use of a Site Class 'D' designation is recommended.

West Portion of Site - South of the Transitway

To the south of the transitway, the bedrock was encountered at 5.6 m to 11.0 m depth. Considering that loose to compact silty sand and sand deposit was encountered at several borehole within this area of the site, the use of a Site Class 'D' designation is recommended.

A seismic site class cannot be specified for the area to the west of the City Center Avenue as bedrock surface depth was not confirmed by coring in boreholes advanced within this area.

West Portion of Site - South of the Transitway

The bedrock was encountered at 3.7 m to 15.4 m depth at borehole locations to the north of the transitway within this portion of the site. The use of a Site Class 'D' designation is recommended.

East Portion of Site

The bedrock was encountered at 2.2 m to 3.8 m depth at the borehole locations to the east of Booth Street and North of Fleet Street. At the block situated east of Booth Street and to the south of the open aqueduct, bedrock was cored at one borehole (MW13-8) at 4.9 m.

Where the footing will be placed on bedrock or if the underside of the footings are located within 3 m of the bedrock surface (i.e. there is 3 metres or less of soil between the bedrock surface and the bottom of the footings), Site Class 'B' is recommended. If there is more than 3 metres of softer materials (not susceptible to liquefaction) present above the bedrock, the use of a Site Class 'C' designation is recommended.

No borehole was located at the parcels situated between Slater Street and Albert Street. Consequently, a seismic site class cannot be specified for those parcels.

5.4 FROST PENETRATION

The frost penetration depth for foundation design at this site is 1.8 m. All foundations founded on frost-susceptible materials should be provided with a minimum of 1.8 meters of earth cover or equivalent insulation for frost protection purposes.



It is noted that the above frost penetration depth is applicable only to foundation design. Short period deeper frost penetrations, which would have little impacts on foundations, may occur. The typical soil cover for watermain construction is 2.4 m below ground surface in the City of Ottawa.

Exterior slabs-on-grade or slabs-on-grade within unheated areas will also be subject to the risk of heave and deformation/cracking due to frost. Consideration could be given to use rigid insulation to protect structures against frost action; however appropriate frost tapers would need to be incorporated at the ends of the insulation.

The bedrock at site could be considered non-frost susceptible provided that the weathered or loose bedrock are removed.

5.5 SITE PREPARATION

Buildings Footprint

Beneath all building and foundations, all existing surficial topsoil, vegetation, peat/organic material, fill material and/or other deleterious materials (e.g., any loose, wet, and/or otherwise disturbed native materials) should be removed.

Since a relative thick layer of fill materials was encountered at borehole locations in the west and south portions of the site, consideration could be given to conducting soil improvement (such as in-situ densification) to improve the site soils instead of mass fill removal and replacement. Verification tests should be carried to approve improved soil areas as subgrade.

The prepared subgrade soils will require inspection by geotechnical personnel prior to structural fill placement to verify all unsuitable material has been removed.

Beneath all buildings and foundations, site grades should then be raised, if needed, using Structural Fill consisting of Ontario Provincial Standard Specification (OPSS) Granular B Type I or II materials that are placed in lifts no thicker than 300 mm and compacted to at least 100% of the material's Standard Proctor Maximum Dry Density (SPMDD). The final layer of fill should consist of OPSS Granular A materials with a minimum thickness of 300 mm beneath the floor slabs and 200 mm in other areas, excluding basement areas where a drainage system will be required.

Pavement Areas

Beneath pavement areas, all existing surficial topsoil, vegetation, peat/organic material, and other deleterious materials should be removed. Fill material, free of deleterious material, can be left in place and surface compacted to act as a subgrade for the proposed paved areas. However, where layers of fill material are thick (such as the south and west portions of the site) and surface compaction is not effective, consideration could be given to conducting soil improvement (such as in-situ densification) to improve the site soils instead of mass fill removal and replacement. Verification tests should be carried to approve improved soil areas as subgrade.

Beneath pavement and sidewalks, site grades should be raised using OPSS Select Subgrade Material (SSM) compacted in lifts not exceeding 300 mm to 95% of the material's Standard Proctor Maximum Dry Density (SPMDD)



Engineered Fill Placement

The placement of all engineered fill materials should be monitored on a full-time basis by qualified and experienced geotechnical personnel under the supervision of a geotechnical engineer, with the authority to stop the placement of fill at any time when conditions are unacceptable.

All fill materials imported to the site must meet all applicable municipal, provincial, and federal guidelines and requirements associated with environmental characterization of the materials.

Imported fill materials should be tested and approved by a geotechnical engineering firm prior to delivery/use. Monitoring of fill placement and in situ compaction testing should be carried out to confirm that all fill is placed and compacted to the required degree.

5.5.1 Site Drainage and Subgrade Protection

The contractor should be responsible for protecting the subgrade soils from disturbance due to construction traffic. This may require that construction access routes are temporarily overbuilt (i.e., provided with increased granular fill) and/or geotextiles are provided between the granular fill and the subgrade surface.

The clayey/silty soils are susceptible to disturbance due to wet weather and/or construction traffic. Therefore, it is critical to control surface water run-off to prevent pounding of water and/or softening of the underlying soils. The prepared subgrade surface for the site should be shaped to prevent pounding of water. Preparation of subgrade should be scheduled such that the protective cover of overlying granular materials or concrete is placed as quickly as possible after subgrade approval by the geotechnical engineer.

The finished grades should provide surface drainage away from all structures. Within 2 m of structures, the exterior should be graded to slope away from the structure at a sufficient gradient. A gradient of 2% should be used wherever possible.

It should be noted that the surface drainage within the site should be collected and directed towards a storm water management system.

5.5.2 Grade Raise Restriction

A silty clay/clayey silt deposit was encountered at several boreholes, especially at the southern portion. The silty clay/clayey silt deposit was described to have a generally firm to stiff consistency and is 0.3 m 1.5 m. Considering the consistency and thickness of this deposit, the potential settlement of the silty clay/clayey silt deposit at this site due to the placement of the any site grade fill materials is not expected to be significant.

However, in-situ measurement of undrained shear strength of silty clay/clayey silt deposit using field vane test and laboratory testing (plasticity limits and consolidation testing) of silty clay/clayey silt samples are required to assess the compressibility of this deposit and calculation of the potential settlement of due to the placement of any site grade fill.

Large settlements may occur if site grade fills are placed where peat was encountered in boreholes (e.g. BHW-009 BHW-11, BHW-015, MW01-7, etc.)



5.6 FOUNDATION DESIGN

Considering the subsurface conditions encountered at the borehole locations, the foundation options are as follows:

- Shallow footings placed on an approved competent native soil subgrade or sound bedrock bearing surface.
- Deep foundations; The following deep foundation options could be considered.

Driven piles: applicability depend on the bedrock depth (for axially loaded piles, the minimum driven length is typically considered to be 5 m)
Micro-piles: applicable throughout
Caissons: applicable throughout

Considering the presence of relatively thick fill layers at some location at the site and high load expected for the multi-story building, shallow foundation may not be an option throughout the site. Deep foundation systems are considered technically feasible for the proposed development at this site. The buildings could be supported on deep foundations transferring the foundation loads through the fill layers, down to the bedrock surface.

Table 5.2: Preferred Foundation Options

Location	Preferred Foundation Options	
	Shallow Foundations	Deep Foundations
North Portion of Site	On Bedrock	Micro-piles or Caissons
South Portion of Site	On Competent Native Soils	Caissons or Micro-piles
West Portion of Site (north of the transitway)	-	Micro-piles or Caissons (where the bedrock surface is below 5 m depth)
West Portion of Site (south of the transitway)	On Competent Native Soils	Driven Piles or Caisson (where cobbles/boulders may be present in overburden)
East Portion of Site	On Bedrock or Competent Native Soils	Micro-piles or Caissons

5.6.1 Shallow Foundations

5.6.1.1 Geotechnical Bearing Resistances

Based on the subsurface conditions encountered at the boreholes previously advanced at the site, shallow foundations founded on competent native soil (compact to very dense silt sand/sand/till deposit or stiff silty clay/clayey silt), sound bedrock surface, or on structural fill constructed on these natural materials could be considered for buildings at the site; all existing fill materials, disturbed/unsuitable native soils, weathered bedrock will need to be removed as discussed in Section 5.4.

The geotechnical resistance calculations for shallow footings were carried out according to the Canadian Manual of Foundation Engineering, considering a non-inclined and non-eccentric load, for foundations buried at the frost penetration depth or deeper.

The values of the geotechnical bearing resistance (bearing capacity) at the Ultimate Limit States (ULS) and the Serviceability Limit States (SLS), presented in the following table, are recommended for the design of the



foundations founded on the compact to very dense till deposit, stiff silty clay/clayey silt, or on the sound bedrock surface. Alternatively, the building foundations could be founded on structural fill placed on the native soil or bedrock.

Table 5.3: Geotechnical Resistance for Shallow Footings on Competent Native Granular Soils

Footing Type and Width (m)	Minimum Footing Embedment Below Floor Slab Surface (m)	Factored Geotechnical Resistance at SLS (kPa)	Geotechnical Resistance at ULS (kPa)
Square Footings			
0.9 to 2.5	0.9	220	220
	1.8	250	430
Strip Footings			
0.6 to 1.5	0.9	160	160
	1.8	220	290

Table 5.4: Geotechnical Resistance for Shallow Footings on Competent Native Cohesive Soils

Footing Type and Width (m)	Minimum Footing Embedment Below Floor Slab Surface (m)	Factored Geotechnical Resistance at SLS (kPa)	Geotechnical Resistance at ULS (kPa)
Square Footings			
0.9 to 2.5	0.9	180	180
	1.8	180	200
Strip Footings			
0.6 to 1.5	0.9	160	160
	1.8	160	180

Foundations founded on the sound bedrock surface could be designed based on factored geotechnical resistance of 1,000 kPa at ULS conditions for square and strip footings ($0.6 \leq \text{footing width} \leq 5.0$). Rock settlement is considered negligible (less than 10 mm) and the total settlement should correspond to the elastic deformation of the rock mass and for this reason the SLS resistance is not applicable.

Both ULS and SLS factored bearing resistance are based on the unfactored strength properties of the soils. The ULS bearing resistance does not account for inclined or eccentric loading conditions. The ULS values include a resistance factor of 0.5. The geotechnical reaction at SLS typically corresponds to a maximum total settlement of 25 mm and a maximum differential settlement of 20 mm.

The geotechnical resistances in the above tables are provided for the range of footing widths and the minimum footing embedment depths (below the floor slab surface) listed in the above table. Additional input should be provided by the geotechnical engineer if the foundation sizes or embedment depths are outside of the ranges outlined above.

The native soils could be highly susceptible to disturbance by construction activity especially during wet or freezing weather. Care should be taken to preserve the integrity of the materials as bearing strata. It is essential that the founding level for the footings be inspected by the geotechnical engineer prior to placing concrete. If the concrete for



the footings on the native soil cannot be placed immediately after excavation and inspection, it is recommended that a working mat of lean concrete be placed in the excavation to protect the integrity of the bearing stratum.

The unfactored horizontal resistance to sliding of the spread foundations may be calculated using the following unfactored coefficients of friction:

- 0.55 between Structural fill materials and cast-in-place concrete
- 0.40 between native (silty till or cohesive) soil and cast-in-place concrete

In accordance with Table 8.1 of the Canadian Foundation Engineering Manual 4th Edition (CFEM), a resistance factor (ϕ) against sliding of 0.8 should be applied to obtain the factored sliding resistance at ULS.

5.6.1.2 Soil-Bedrock Transition

It should be noted that where footings of a building may cross between subgrade types (i.e. between soil and bedrock), some differential settlement may occur. Such settlements should be accounted for through structural design. Therefore, it may be preferable to have all foundations extend to a bedrock subgrade or on the overburden, in order to avoid potential differential settlements.

Each foundation should be founded on one subgrade material only to limit the differential settlement. Given the variability of rock level, if this is not practical and part of the foundations would be on rock, soil-rock transitions will be required to limit the risk of excessive differential settlement. The transition consists of profiling the bedrock with a slope of 1V:5H and profiling the soils with a slope of 1V:3H, to reach a depth of 600 mm at their contact with the projected level of the foundations. The excavation must be filled with a structural granular material to promote the gradual development of settlements. This backfill should be composed of OPSS Granular A or B Type II materials placed in layers of 300 mm compacted to at least 100% of material's SPMDD. The width of the subexcavation should be at least the proposed footing width plus 0.5 m.

5.6.1.3 Foundation Wall Backfill

To avoid problems with frost adhesion and heaving, foundation walls in these areas should be backfilled with non-frost susceptible granular fill meeting the gradation requirements of OPSS Granular B Type I materials. The fill should be placed in maximum 300-millimetre thick lifts and should be compacted to at least 98 percent of the material's SPMDD using suitable vibratory compaction equipment.

In areas where hard surfacing (e.g., concrete slabs, sidewalks) surround the building, differential frost heaving will occur between the granular fill backfill zone and other areas. To reduce this differential heaving, a frost taper of the granular backfill is recommended. The frost taper should extend up from 1.2 meters below finished exterior grade (at the foundation wall) at a slope of 3 horizontal to 1 vertical, or flatter, to the surface level.

Exterior grades should be sloped away from the building to prevent ponding of water around the buildings.

5.6.2 Piled Foundations

Depth to bedrock is variable at the site. For axially loaded piles, the minimum driven length is typically considered to be 5 m. As such, driven piled foundations are considered suitable only for portion of the building area where bedrock



surface is deeper than 5 m. Where the bedrock is shallower than 5 m or presence of cobble and/or boulder could create heavy driving resistances, impede pile driving, or damage the piles, drilled piles (socketed to bedrock) could be considered.

Suitable pile types for driving would be concrete filled steel pipe piles (driven closed-ended) or H-piles, with the piles end-bearing on bedrock. The piles should be driven to practical refusal within the very dense till or on the bedrock surface. The piles should attain refusal reaching the surface of the bedrock; however, some limited penetration of the piles into the weathered bedrock may occur. Considering the presence of cobbles and boulders in the native till deposit in the South and West portions of the site, some of piles may attain refusal on cobbles or boulders within the till deposit.

Where the quality of the bedrock near surface is poor and/or till (which potentially contains cobbles and/or boulders) is present, it is recommended that rock-points, such as the Titus rock injector points be included to protect the pile tips.

For piles attaining refusal at or slightly below the bedrock surface, settlement at the toe will be negligible and the total pile head settlement will correspond to the elastic deformation of the piles. The ultimate limit states (ULS) axial geotechnical resistance in compression of piles driven to refusal on bedrock (or slightly within) at this site should be considered to be the structural capacity of the pile. For piles driven to refusal within the till deposit, generally, the ULS axial geotechnical resistance in compression is considered to be 80% of the structural capacity of pile.

Due to stresses imposed by the pile driving methods and to avoid damaging the steel during driving, it is recommended that the ULS geotechnical resistance be limited to 140 N/mm^2 of the steel cross-sectional area of the piles. In the case where pipe piles are to be filled with concrete and the pile driving contractor proposes higher capacities to incorporate the structural benefits of the concrete, the contractor would be required to demonstrate that the piles have achieved the proposed higher capacities by field-testing.

Based on a limiting stress value of 140 N/mm^2 against steel cross-sectional area for piles driven to refusal on bedrock (or slightly within), the following ULS geotechnical resistances may be considered. For piles driven to refusal within the till deposit, generally, a lower limiting stress value of 112 N/mm^2 against steel cross-section is used to calculate the ULS geotechnical resistance.

Table 5.5: Geotechnical Resistance for Driven Pile at ULS

Pile Type	ULS geotechnical resistances (kN)	
	piles driven to refusal on bedrock (or slightly within)	piles driven to refusal within till
HP 310x110	1975	1580
Pipe 324 mm diameter, 11 mm thick wall	1530	1220

Note: The sacrificial thickness, if any, does not apply to the geotechnical resistance which will be provided by the bedrock.

The actual piles selected will depend on the pile load requirements and the pile cap configurations. The piles recommended to be spaced at least three diameters apart. Considering that the piles will be on bedrock surface, no group effects is required to be considered in assessment of geotechnical vertical resistance of piles.



For piles driven to bedrock, the geotechnical resistance at serviceability limit state (SLS) exceeds the ULS value and therefore is considered not to be applicable to the design.

The pile driving contractor should be required to submit the following information prior to mobilizing to the site.

- Outline of proposed pile driving equipment
- Pile driving refusal criteria to provide the ULS design value selected for the project

Pile caps/grade beams for unheated areas such as exterior structures should be provided with 1.8 m of soil cover.

10% of the driven piles should be subjected to dynamic pile testing to confirm that they are well seated on bedrock and that the pile driving strategy did not damage the piles upon reaching bedrock. Dynamic testing should be carried out using a Pile Driving Analyser (PDA).

Downdrag due to potential soil liquefaction

The granular native soils underlie the site is sporadically considered potentially susceptible to liquefaction during a design seismic event. Based on the conducted liquefaction analyses, settlements associated with liquefaction could reach 90 mm to 200 mm. Therefore, drag loads should be incorporated in the design where liquefaction is expected.

The structural capacity of the pile would need to account for drag load imposed during a seismic event. The geotechnical capacity is not affected by the drag loads. Drag loads should be considered in detailed design of piles.

As discussed elsewhere in this report, clayey soil consolidation due to potential site grade raise at the site is not expected. Therefore, it has been assumed that drag loads due to soil consolidation settlements may not be considered in the design.

5.6.3 Micropile Foundation System

The elevation of the bedrock surface encountered at the site is highly variable. Therefore, the consideration could be given to using a micropile foundation system as an alternative to the piled foundation design.

The following conditions have been assumed in assessing the micropile capacities:

- Assumed Rock Unconfined Compressive Strength 70 MPa
- $f'_c = 30$ MPa for concrete
- Pile capacity calculated strictly based on the rock socket shaft resistance

For Ultimate Limit States (ULS) design, the unfactored bond strength at the grout/rock interface may be taken as 1,500 kPa. Using a resistance factor of 0.4, the factored ULS bond strength is 600 kPa. If higher factored resistance values are required, on-site testing of the micropiles should be carried out. Based on these values, the factored bearing resistances in the following table may be used for micropile design. As the uppermost 1 m of the bedrock mass is often more heavily fractured and less competent, the first metre of rock should not be included as part of the socket length.



Table 5.6: Micropile Axial Capacities

Pile Diameter (m)	Socket length in Competent Bedrock ⁽¹⁾ (m)	Factored Bearing Resistance at ULS ⁽²⁾ (kN) Socket Friction
0.150	1.00	285
	2.00	565
	3.00	850
0.175	1.00	330
	2.00	660
	3.00	990
0.200	1.00	375
	2.00	750
	3.00	1125
0.225	1.00	425
	2.00	850
	3.00	1275

Notes:

¹ Micropiles should be socketed into competent bedrock. The socket length in the table above represents the depth socketed into competent bedrock; for design purposes, it should be assumed that uppermost metre of the bedrock is not included in the socket length.

² The above geotechnical resistances at ULS include a resistance factor of 0.4 in compression.

³ Negligible axial deformation would occur and therefore, reactions at SLS are not expected to govern.

The following provides additional considerations that should be accounted for in the design and construction of the micropile foundation system:

- The micropiles should be designed and constructed in accordance with standard practices such as those identified in the US Department of Transportation – Federal Highway Administration Publication No. FHWA NHI-05-039 (Micropile Design and Construction Reference Manual).
- Micropiles intended as permanent structural elements should be provided with double corrosion protection.
- In order to limit the potential for differential foundation settlement, all foundations for a building should consist of either shallow foundations bearing on bedrock or micropile foundations socketed into bedrock (i.e. shallow foundations bearing on overburden materials should not be used). In this regard, micropile supported grade beams could be considered around the perimeter of the building.
- The resistance values provided above represent the geotechnical capacity of the micropiles; an assessment should be completed to confirm if the geotechnical or structural capacity of the micropiles will govern. Similarly, the structural design of micropiles should take into account other potential failure mechanisms (e.g. buckling).
- Full-time inspection should be carried out by qualified geotechnical personnel during micropile installation. Additionally, sufficient materials testing (e.g. grout compressive strength testing) should be completed to monitor conformance to the pertinent project specifications.
- Stantec's geotechnical group should review the final drawings and specifications for this project prior to tendering/construction to ensure that the guidelines in this report have been adequately interpreted.

5.6.4 Rock Socketed Caissons

Rock socketed caissons may be considered for foundation design. Depending on the prevailing groundwater level at each building location at the time of construction, the use of a steel liner and the tremie technique would be required due to the presence of the highly permeable silty sand/till deposit.

Given the fracture nature of the bedrock at the site, the following should be considered.

- That the top 1.0 m of the rock socket is not to be included in the calculated capacity.



- That the rock socket length, within the calculated zone, be at least three (3) times the caisson diameter.
- A minimum caisson diameter of 0.9 m be considered.
- A factored geotechnical resistance at the concrete-rock shaft interface at ULS of 700 kPa, which includes a resistance factor of 0.4.
- Negligible axial deformation would occur at the concrete-rock shaft interface and therefore, reactions at SLS are not expected to govern.

Construction Inspection

It is anticipated that contractor would use flight augers to construct the caissons. The following should be anticipated.

- That caissons would need to be clean and dewatered to allow for inspection to ensure that all loose materials are removed and that the sidewalls are free of debris.
- That concrete should not be placed within a dewatered caisson since waterflow from the fractured bedrock would wash out the cement paste from the concrete.
- Where the caisson bottom will be below groundwater level, the caissons would need to be filled with water prior to concreting to allow for use of the tremie method where concrete is pumped underwater, from the bottom of the caisson, while displacing the overlying water.
- That full time inspection by a geotechnical engineer's representative would be required while constructing caissons, including placement of concrete by the tremie method.

5.7 EXCAVATIONS AND RETAINING WALLS

5.7.1 Temporary Excavations

5.7.1.1 Temporary Excavation in Overburden

All temporary excavations should be carried out in accordance with the Occupational Health and Safety Act and Regulations for Construction Projects. Shallow open cut excavations (extended to depths of 3 m or less below existing ground surface) could be conducted following the recommendation provided in this section. The potential for instability of excavations extending to greater depths should be reviewed by a geotechnical engineer.

Based on the boreholes advanced within the site, the overburden soils within upper 3 m of existing site grades could be generally classified as Type 3 soils, as defined by the Occupational Health and Safety Act and Regulations for Construction Projects. Provided that appropriate groundwater control is provided to maintain the water level below the base of the excavation, OHSA indicates that temporary excavations made within Type 3 soils should be developed with side slopes no steeper than 1H:1V.

Very loose or soft/very soft portions of the overburden soils should be classified as Type 4 soils. If infiltration of groundwater is encountered, soils should be considered Type 4. For Type 4 soils, OHSA requires that open cut excavations must be sloped no steeper than 3-horizontal to 1-vertical (3H:1V) from the bottom of the excavation.

Based on OHSA requirements, the soil must be classified as the type with highest classification of the types of soils present if an excavation contains more than one soil type (e.g. if both Type 3 and Type 4 soils are present within the excavation, the excavation must be sloped or supported in accordance with the requirements for Type 4 soils).



Steeper side slopes would require shoring to meet the requirements of the OHSA. The stability of the wall of the excavation can also be affected by:

- Surcharge loads
- Stockpiles
- External loads (e.g. from adjacent buildings foundations)
- Groundwater seepage conditions

Regular inspections by qualified geotechnical engineering personnel must be conducted to confirm that conditions in the excavations are safe and consistent with the requirements of the OH&S Act. Care should be taken to direct surface water away from the open excavations.

Stockpiling of any materials adjacent to excavations should be avoided. Similarly, traffic should not be permitted in proximity to open excavations. For this purpose, it is recommended that all storage of materials and traffic be restricted from a 2 m wide strip around the excavations, measured from the crest of the excavation designed and constructed in accordance with the OH&S Act.

The base of excavations should not be exposed for extended periods of time.

If space is restricted such that the side slope cannot be safely cut back in accordance with the OH&S Act & Regulations, or if sloughing and cave-in are encountered in the excavations, or if the excavations are to remain open for a longer period, a trench box system can be used for shallow localized excavations (such as for service trenches), or a shoring system can be used for larger or deeper excavations to maintain safe working conditions. All shoring systems should be designed and approved by a qualified Professional Engineer.

The contractor is fully responsible for the selection of, and the detailed design and performance of the temporary shoring systems. In general, there are three shoring methods that are commonly used in local construction practice:

- soldier piles and timber lagging;
- driven sheet piles; and
- continuous concrete (e.g. secant pile) walls.

Soldier pile and lagging systems are suitable where the objective is to maintain an essentially vertical excavation wall and the movements above and behind the wall need only be sufficiently limited that relatively flexible features (such as roadways) will not be adversely affected. Where foundations or other deformation-sensitive facilities (such as site services) are present within the zone of influence of the shoring, the shoring system will need to be designed to limit deflections/deformations to tolerable levels. Interlocking steel sheet piling systems with pre-stressed tie backs are often used for these conditions. However, for excavations adjacent to aqueducts, the use of tie-back anchors should be limited due to potential conflicts with the aqueduct structures.

Cobbles, boulders, and/or construction debris were encountered in boreholes advanced at the south and west portions of the site. The presence of cobble, boulders, and /or construction debris could impede installation of sheet piles. Secant pile walls would be appropriate where difficulties may be encountered installing sheet piles, where heavily loaded foundations exist adjacent to the shoring, or where groundwater inflow needs to be controlled.



Underpinning of the existing foundations could also be required if the settlements due to shoring movements would be unacceptable and/or if the loads on the adjacent foundations are large.

Allowance should be made for excavation of cobbles, boulders, construction debris expected to be present both in fill and glacial till at the site, especially at the south and western portion of the site.

5.7.1.2 Temporary Excavation in Bedrock

Bedrock removal may be required for construction of underground structure or utility installation where bedrock is shallow. The bedrock surface was found to be variable and bedrock could also be encountered at shallow depths.

Where the bedrock is highly fractured, it may be possible to carry out the bedrock removal using mechanical methods (such as hydraulic excavators and hoe ramming with pneumatic rock breakers) particularly for shallow bedrock excavation. For deeper excavation or where the bedrock strength and measured RQD values are higher, it is expected that excavation of the majority of the bedrock will require drill and blast techniques or hoe ramming in conjunction with closely spaced line drilling.

Perimeter line drilling should be used to define the excavation limits. Loose rocks should be removed from the sidewalls during excavation.

For shallow localized excavations (such as for service trenches), relatively steep to near-vertical walls in the bedrock should stand unsupported for a short period. The rock walls should be inspected at the time of excavation so that the rock wall stability can be confirmed. Alternatively, work carried out in the excavation can be done within a fully braced, steel trench box for worker safety.

For deeper or larger excavation (such as for the below grade level excavations), the excavation side walls may need to be stabilized with a pattern of grouted rock bolts and dowels. Tieback anchors may also be required to stabilize unstable rock blocks.

Blasting

If blasting is considered, significant caution should be exercised in carrying out the blasting because of the near proximity of underground services and existing buildings. All blasting should therefore be controlled to limit the peak particle velocities at all adjacent structures and services such that blast induced damage will be avoided. This will require blast designs by a specialist in this field.

A pre-construction/blasting survey should be carried out of all of the surrounding structures and utilities. Consideration should be given to monitoring selected existing interior and exterior cracks in the structures identified during the pre-blast survey for lateral or shear movements by means of pins, glass plate telltales and/or movement telltales.

The contractor should be required to submit a complete and detailed blasting design and monitoring proposal prepared by a blasting/vibrations specialist prior to commencing blasting. This would have to be reviewed and accepted in relation to the requirements of the blasting specifications. The contractor should be limited to only small controlled shots. The following frequency dependent peak vibration limits at the nearest structures and services are suggested for all bedrock removal.



Table 5.7: Peak Vibration Limits

Frequency Range (Hz)	Vibration Limits (mm/sec)
< 10	5
10 to 40	5 to 50 (sliding scale)
> 40	50

Note: For sensitive infrastructure, the vibration limit may need to be reduced to 2.5 mm/sec for all frequencies.

It is recommended that the monitoring of ground vibration intensities (peak ground vibrations and accelerations) from the blasting operations be carried out both in the ground adjacent to the closest structures or within the structures themselves on a continuous basis throughout the blasting process.

If practical, blasting should commence at the furthest points from the closest structure or service to assess the ground vibration attenuation characteristics and to confirm the anticipated ground vibration levels based on the contractor's blasting proposal.

Blasting should be carried out in accordance with the City of Ottawa's Special Provision F-1201 which provides the requirements for blast design and submissions, including pre-blast surveys. Vibration monitoring should be carried out by qualified personnel throughout all blasting operations.

5.7.2 Dewatering

Based on the existing water levels measurement at the site, the groundwater elevation at the site range between 49.2 m to 59.6 m corresponding to depths between 1.1 m to 9.8 m.

Considering the nature of overburden soils at the site (fill and native silty sand/till), groundwater inflows into small and shallow excavations of less than 3.0 m deep developed within the fill material and clay deposit could be handled by pumping from filtered sumps within the excavation areas.

More significant groundwater inflows should be expected for deeper or larger excavations, especially extending below the prevailing groundwater level at site at the time of excavation or penetrating layers containing cobbles and/or boulders. Therefore, more extensive dewatering systems could be required for such conditions requiring Ministry of the Environment and Climate Change (MOECC) permitting.

A hydrogeological study is being prepared by Stantec and will be provided in a separate report, which assesses the dewatering requirement and provides guidance for the PTTW application or EASR registration, if necessary. Comments on calculation of groundwater flow rate, recommended depth to lower the water table, and anticipated pumping rates are provided in the hydrogeological report. All the information regarding ground settlements from dewatering is provided in the hydrogeological report. This information should be considered by the contractor while selecting an appropriate groundwater control system.

5.7.3 Earth Pressures on Retaining Walls

Earth pressures will need to be considered in the design of the foundation and basement walls. Any retaining walls should be backfilled with non-frost susceptible granular fill meeting the gradation requirements of OPSS Granular B Type I materials.



The total active (P_A), passive (P_P), and at-rest (P_O) thrusts acting on the walls can be calculated using the following equations:

$$P_A = \frac{1}{2} K_a \gamma H^2$$

$$P_P = \frac{1}{2} K_p \gamma H^2$$

$$P_O = \frac{1}{2} K_o \gamma H^2$$

where;

H = height of the wall

γ = unit weight of the backfill soil

Values for K_a , K_p , K_o and γ for granular backfill material are provided in the table below. These values are based on the assumption that a horizontal back slope is present behind and adjacent to the wall system(s). The earth pressure coefficients need to be adjusted (i.e., increased) where sloping backfill will be present behind the walls.

At-rest earth pressures should be used in the design of walls that are restrained from movement. The thrust acts at a point one third up the height of the wall.

Table 5.8: Non-Seismic Lateral Earth Pressure Parameters (Horizontal Backfill)

Parameter	OPSS Granular B – Type I
Bulk Unit Weight, γ (kN/m ³)	22
Effective Friction Angle	32°
Coefficient of Earth Pressure at Rest (K_o)	0.47
Coefficient of Active Earth Pressure (K_a)	0.31
Coefficient of Passive Earth Pressure (K_p)	3.25

The total active and passive thrusts under earthquake conditions can be calculated using the following equations:

$$P_{AE} = \frac{1}{2} K_{AE} \gamma H^2$$

$$P_{PE} = \frac{1}{2} K_{PE} \gamma H^2$$

where;

K_{AE} = active earth pressure coefficient (combined static and seismic)

K_{PE} = passive earth pressure coefficient (combined static and seismic)

H = height of wall

γ = total unit weight

The recommended seismic earth pressure parameters (based on a seismic Site Class C) are provided in table below. The angle of friction between the soil and the wall has been assumed to be 0° to provide a conservative estimate.



Table 5.9: Seismic Earth Pressure Parameters (Horizontal Backfill)

Parameter	OPSS Granular B – Type I
Bulk Unit Weight, γ (kN/m ³)	22
Effective Friction Angle	32°
Site PGA (g)	0.281
K_{AE} (Non-Yielding Wall)	0.51
Height of Application of P_{AE} from base as a ratio of wall height, (H) – Non-Yielding Wall	0.440
Active Earth Pressure (K_{AE}) – Yielding Wall	0.40
Height of Application of P_{AE} from base as a ratio of wall height, (H) – Yielding Wall	0.393
Passive Earth Pressure, (K_{PE})	2.99
Height of Application of P_{PE} from base as a ratio of wall height, (H)	0.310

In order to use the coefficients of active and at-rest pressures for the granular materials presented in the tables above, the granular backfill must be provided within a wedge extending out from the base of the wall at 45 degrees (or smaller) to the horizontal. The coefficient of passive earth pressure applicable to wall design should be confirmed during detailed design when additional information on wall configuration and depths/founding elevations are determined.

5.8 PIPE BEDDING AND BACKFILL

OPSS Granular A materials should be placed below sewer and water pipes as bedding material. The bedding should have a minimum thickness of 150 mm or more to meet City of Ottawa standards. Where unavoidable disturbance to the subgrade surface does occur, it may be necessary to thicken the bedding layer or provide a sub-bedding layer of compacted Granular B Type II materials. Pipe backfill and cover materials should also consist of OPSS Granular A material. A minimum of 300 mm vertical and side cover should be provided. These materials should be compacted to at least 95% of the material's SPMDD in lifts no greater than 300 mm. Clear crushed stone backfill should not be permitted as pipe bedding materials.

Where the pipe trenches will be covered with hard-surfaced areas, the type of native material placed in the frost zone (i.e. between subgrade level and 1.8 meters depth or the top of the pipe cover materials) should match the soil exposed on the trench walls for frost heave compatibility.

Trench backfill should be placed in maximum 300 mm thick lifts and should be compacted to at least 98 percent of the material's standard Proctor maximum dry density using suitable compaction equipment.

If there is insufficient reusable material at the site, any bulk fill required to raise the site grades should consist of imported granular fill meeting the requirements of OPSS Select Subgrade Material (SSM).

All imported fill materials should be tested and approved by a geotechnical engineering firm prior to delivery to the site.



5.9 PAVEMENT DESIGN RECOMMENDATIONS

Provided that subgrade preparation below pavements will comply with the requirements outlined in Section 5.5 of this report, in the absence of traffic data, the pavement structure provided in the following table may be used for the design of the proposed new streets and parking areas. Where required, site grades below pavement structures are to be raised using imported soils meeting the requirements of OPSS Select Subgrade Material (SSM).

Table 5.10: Recommended Pavement Structure

Location	Asphalt Thickness	Base Thickness OPSS Granular A (mm)	Subbase Thickness Granular B Type II (mm)
Standard Duty Parking Areas	60 mm SP12.5 mm	150	300
Heavy Duty Parking Areas	40 mm SP12.5 mm 50 mm SP SP19.0 mm	150	400
Local Roads (no bus traffic)	50 mm SP 12.5 FC1 or FC2 50 mm SP 19	150	500
Local Roads (with bus traffic)	60 mm SP 12.5 FC1 or FC2 70 mm SP 19	150	600

Notes:

- The above pavement structure assumes that the subgrade will consist of either the surface compacted existing fill materials or compacted OPSS SSM material.
- The pavement subgrade must be proof rolled under the supervision of geotechnical personnel prior to subbase or engineered fill placement. Any soft areas identified during proof rolling may require subexcavation and replacement with additional Granular 'B'. Where required, site grades below pavement structures are to be raised using OPSS SSM fill.
- The finished subgrade surface and the pavement surface should be crowned and graded to direct runoff water away from the development and associated infrastructure.
- Perimeter drains and pavement subdrains connected to catch basins are recommended to promote drainage of the pavement structure. The subdrains should comprise 100 mm or 150 mm diameter perforated corrugated pipes with filter socks bedded in sand. The top of pipe should be below the lower limit of the granular subbase.
- Asphalt performance grade and PG 64-34 should be used for roadways with bus traffic. PG 58-34 should be specified where bus traffic is not anticipated.
- Based on the Ontario Provincial Standard Specification "Material Specification for Superpave and Stone Mastic Asphalt Mixtures" OPSS.MUNI 1151 (April 2018), the following Superpave Traffic Categories are suitable:
 - Traffic Category A for parking areas
 - Traffic Category B for local roads without bus traffic
 - Traffic Category D for local roads with bus traffic
- A tack coat is recommended between asphalt layers and along the edges of any cuts in asphalt.
- In the event that the asphalt layer is not placed at the same time as the granular sub-base/base and the base is left exposed for a period of time, the top layer of granular material should be re-shaped, surface compacted and replaced with a fresh layer of Granular A prior to the placement of the asphalt surface.
- Control of surface water is a critical factor in achieving good performance over the pavement structure life. In this regard, the elevations of the surface of the parking areas should be designed to promote adequate surface drainage.



Compaction Requirements:

- The finished sub-grade surface must be compacted to achieve a minimum of 95% of the materials SPMDD immediately prior to placement of the granular materials.
- All granular materials should be in accordance with the requirements of OPSS Specification. These materials should be compacted to at least 100% of the material's Standard Proctor maximum dry density (SPMDD) in lifts no greater than 300 mm.
- The compaction of the asphalt layers should be to at least 92.5% Maximum Theoretical Relative Density (MTRD) in accordance with OPSS 310.

6.0 CONSTRUCTION CONSIDERATIONS AND CONSTRAINTS

6.1 UNDERFLOOR DRAINAGE

For buildings that include basement/underground level(s), both a perimeter drainage and an under-slab drainage system is recommended to be included in the design. The following is recommended for the underslab drainage system.

- Concrete floor
- Vapour barrier
- 50 mm of compacted OPSS Granular A, as a working surface
- 250 mm of 19 mm clearstone
- 100 mm perforated drains placed up to 6 m apart
- Filtering, non-woven geotextile between the clearstone and the native soil

The underfloor drainage system should be designed to accommodate the highwater levels associated with spring conditions. Unless seasonal water levels are taken, it should be assumed that the water level could be as high as 1 m below ground surface for brief periods of time.

6.2 REUSE OF ON-SITE MATERIALS

The surficial topsoil materials are geotechnically unsuitable for reuse in any application except for general landscaping purposes, however environmental impacts to the soil may restrict the reuse of the material.

The fill material is not considered to be suitable for reuse as engineered/structural fill below or adjacent to new foundations. These materials that are free of organic matter and other deleterious materials, may be considered suitable for reuse as trench backfill (outside of foundation areas) or as general site grade fill (i.e. materials used to raise the site grade to the design elevations outside building footprints).

The ability to compact these materials to required levels is dependent on the moisture content of the materials; thus, the amount of re-useable material will be dependent on the natural moisture content, weather conditions and the construction techniques at the time of excavation and placement. Any boulders or cobbles with dimensions greater than 150 mm should be removed from these materials prior to placement.



6.3 COLD WEATHER CONSTRUCTION

Placement of fill materials in cold weather requires a considerable increase in effort from that required in “better” weather conditions. Additional costs are typically incurred as a result, and general productivity can be expected to suffer. In addition to the prevailing weather conditions, the quantity of fill to be placed, the required lateral extent and thickness, the equipment used for placement and compaction, and the protection methods employed by the contractor, will all have an influence on the success of placing fill in adverse weather conditions.

Notwithstanding the comments provided in the previous sections of this report pertaining to backfilling and engineered fill, when construction is undertaken during periods of inclement weather or when freezing conditions exist, the placement of fill materials for any purpose should consider the comments provided below.

- Foundations/pile caps/slabs shall be constructed on non-frozen ground only; where non-frozen ground includes the material at surface and all underlying soils. The non-frozen nature of the ground must be confirmed by a geotechnical inspection within 1 hour of concrete placement.
- Following construction of foundations/pile caps/slabs, protection measures must be provided to prevent freezing of the foundation subgrade/bearing soils and for protection of the concrete during curing. The protective measures must also keep the subgrade soils beneath the foundations from freezing after the concrete has cured.
- Foundations/pile caps shall be backfilled with free-draining granular material and drainage shall be provided to prevent lifting of the foundations due to adfreeze during the construction period.
- Structural fill shall not be placed on frozen ground and the structural fill materials shall be free of snow and frozen material.
- Overnight frost penetration into the existing sub-grade or the structural fill must be prevented. Alternatively, the frozen fill must be completely removed prior to placing subsequent lifts. Breaking the frost in-situ is not considered acceptable.
- Moisture adjustment of the fill materials (i.e., adding water or allowing fill to dry) is not practical in freezing conditions. Therefore, obtaining the required compaction levels of 100 percent of the materials Standard Proctor maximum dry density for Structural Fill will not be practical if the fill materials are not supplied to the site near their optimum water content for compaction.
- Regular checks of the temperature of the fill should be made. The soil temperature should be greater than +2C to allow for compaction to the specified degree.
- Imported fill should not be stockpiled on site in such a condition where freezing of the material in the stockpile can develop. Direct import, placement, and compaction is recommended.
- Full-time inspection and testing services is required during earthworks in winter conditions.



7.0 SUPPLEMENTARY GEOTECHNICAL INVESTIGATION

The recommendations provided in this report are general in nature and are provided for planning purposes. The provided recommendation and comments should be confirmed to use for final design purposes.

The following should be considered in a supplementary geotechnical investigation:

- The existing borehole data at the site was collected between 1992 and 2018. A new field investigation will provide current geotechnical conditions at the site.
- A supplementary site and project specific geotechnical investigation should be planned for each proposed development at the site once the details (e.g., final building configurations and site grades, structural loads etc.) related to the proposed development are available.
- It is recommended that a groundwater monitoring program be implemented to help assess variability in the groundwater levels at the site. A hydrological investigation is also recommended to assess the dewatering requirements.
- Geophysical testing could be carried out to measure the in-situ shear wave velocity of the subsurface soils and bedrock at the site to potentially improve the recommended Seismic Site Class.
- In-situ measurement of undrained shear strength of silty clay/clayey silt deposit using field vane test and laboratory testing (plasticity limits and consolidation testing) of silty clay/clayey silt samples are required to assess the compressibility of this deposit and calculation of the potential settlement of due to the placement of any site grade fill.
- The bedrock surface was found to be variable, and the bedrock depth ranges from 0 m (existing ground surface) to about 16.6 m below ground surface. Additional boreholes, including bedrock coring and bedrock testing, at each building location to establish the bedrock level at each development and refine the deep foundation recommendations.



8.0 CLOSURE

This report documents work that was performed in accordance with generally accepted professional standards at the time and location in which the services were provided. No other representations, warranties or guarantees are made concerning the accuracy or completeness of the data or conclusions contained within this report, including no assurance that this work has uncovered all potential liabilities associated with the identified property.

This report provides an evaluation of selected geotechnical conditions associated with the identified portion of the property that was assessed at the time the work was conducted and is based on information obtained by and/or provided to Stantec at that time. There are no assurances regarding the accuracy and completeness of this information. All information received from the client or third parties in the preparation of this report has been assumed by Stantec to be correct. Stantec assumes no responsibility for any deficiency or inaccuracy in information received from others.

Conclusions made within this report consist of Stantec's professional opinion as of the time of the writing of this report and are based solely on the scope of work described in the report, the limited data available and the results of the work. They are not a certification of the property's environmental condition. This report should not be construed as legal advice.

This report has been prepared for the exclusive use of the client identified herein and any use by any third party is prohibited. Stantec assumes no responsibility for losses, damages, liabilities, or claims, howsoever arising, from third party use of this report.

Should additional information become available which differs significantly from our understanding of conditions presented in this report, Stantec requests that this information be brought to our attention so that we may reassess the conclusions provided herein.

Respectfully submitted,

STANTEC CONSULTING LTD.



Ramin Ghassemi, Ph.D., P.Eng.
Geotechnical Engineer



Chris McGrath, P.Eng.
Senior Associate, Senior Geotechnical Engineer



APPENDIX A

A.1 STATEMENT OF GENERAL CONDITIONS



STATEMENT OF GENERAL CONDITIONS

USE OF THIS REPORT: This professional work product (“hereinafter referred to as the Report”) has been prepared for the sole benefit of the Client in accordance with Stantec’s contract with the Client. While the Report may be provided by the Client to applicable authorities having jurisdiction and to other third parties in connection with the project, Stantec disclaims any legal duty based upon warranty, reliance, or any other theory to any third party, and will not be liable to such third party for any damages or losses of any kind that may result.

BASIS OF THIS REPORT: This Report relates solely to the site-specific project for which Stantec was retained and the stated purpose for which the Report was prepared. The information, opinions, conclusions and/or recommendations made in this Report are in accordance with Stantec’s present understanding of the site-specific project as described by the Client. The applicability of these is restricted to the site conditions encountered at the time the scope of work was conducted and do not take into account any subsequent changes. If the proposed site-specific project differs or is modified from what is described in this Report or if the site conditions are altered, this Report is no longer valid unless Stantec is requested by the Client to review and revise the Report to reflect the differing or modified project specifics and/or the altered site conditions. This Report is not to be used or relied on for any variation or extension of the project, or for any other project or purpose or site, and any unauthorized use or reliance is at the recipient’s own risk.

STANDARD OF CARE: Preparation of this Report, and all associated work, was carried out in accordance with the normally accepted standard of care in the state or province of execution for the specific professional service provided to the Client. No other warranty is made.

PROVIDED INFORMATION: Stantec has assumed all information received from the Client and third parties in the preparation of this Report to be correct. While Stantec has exercised a customary level of judgment or due diligence in the use of such information, Stantec assumes no responsibility for the consequences of any error or omission contained therein.

INTERPRETATION OF SITE CONDITIONS: Soil, rock, or other material descriptions, and statements regarding their condition, made in this Report are based on site conditions encountered by Stantec at the time of the scope of work and at the specific testing and/or sampling locations. Classifications and statements of condition have been made in accordance with normally accepted practices which are judgmental in nature; no specific description should be considered exact, but rather reflective of the anticipated material behaviour. Extrapolation of in-situ conditions can only be made to some limited extent beyond the sampling or test points. The extent depends on variability of the soil, rock and groundwater conditions as influenced by geological processes, construction activity, and site use.

VARYING OR UNEXPECTED CONDITIONS: Should any site or subsurface conditions be encountered that are different from those described in this Report or encountered at the test and/or sample locations, Stantec must be notified immediately to assess if the varying or unexpected conditions are substantial and if reassessments of the Report conclusions or recommendations are required. Stantec will not be responsible to any party for damages incurred as a result of failing to notify Stantec that differing site or subsurface conditions are present upon becoming aware of such conditions.


PLANNING, DESIGN, OR CONSTRUCTION: Development or design plans and specifications should be reviewed by Stantec geotechnical engineers, sufficiently ahead of initiating the next project stage (e.g., property acquisition, tender, construction, etc.), to confirm that this Report completely addresses the elaborated project specifics and that the contents of this Report have been properly interpreted. Specialty quality assurance services (e.g., field observations and testing) during construction are a necessary part of the evaluation of subsurface conditions and site work. Site work relating to the recommendations included in this Report should only be carried out in the presence of a qualified geotechnical engineer; Stantec cannot be responsible for site work carried out without being present.

APPENDIX B

B.1 DRAWING NO. 1 – BOREHOLE LOCATION PLAN



T:\Autocad\Drawings\Project Drawings\2024\160401780\160401780_Borehole Locations_240410.dwg
Printed: Apr 10, 2024 By: G. Briones

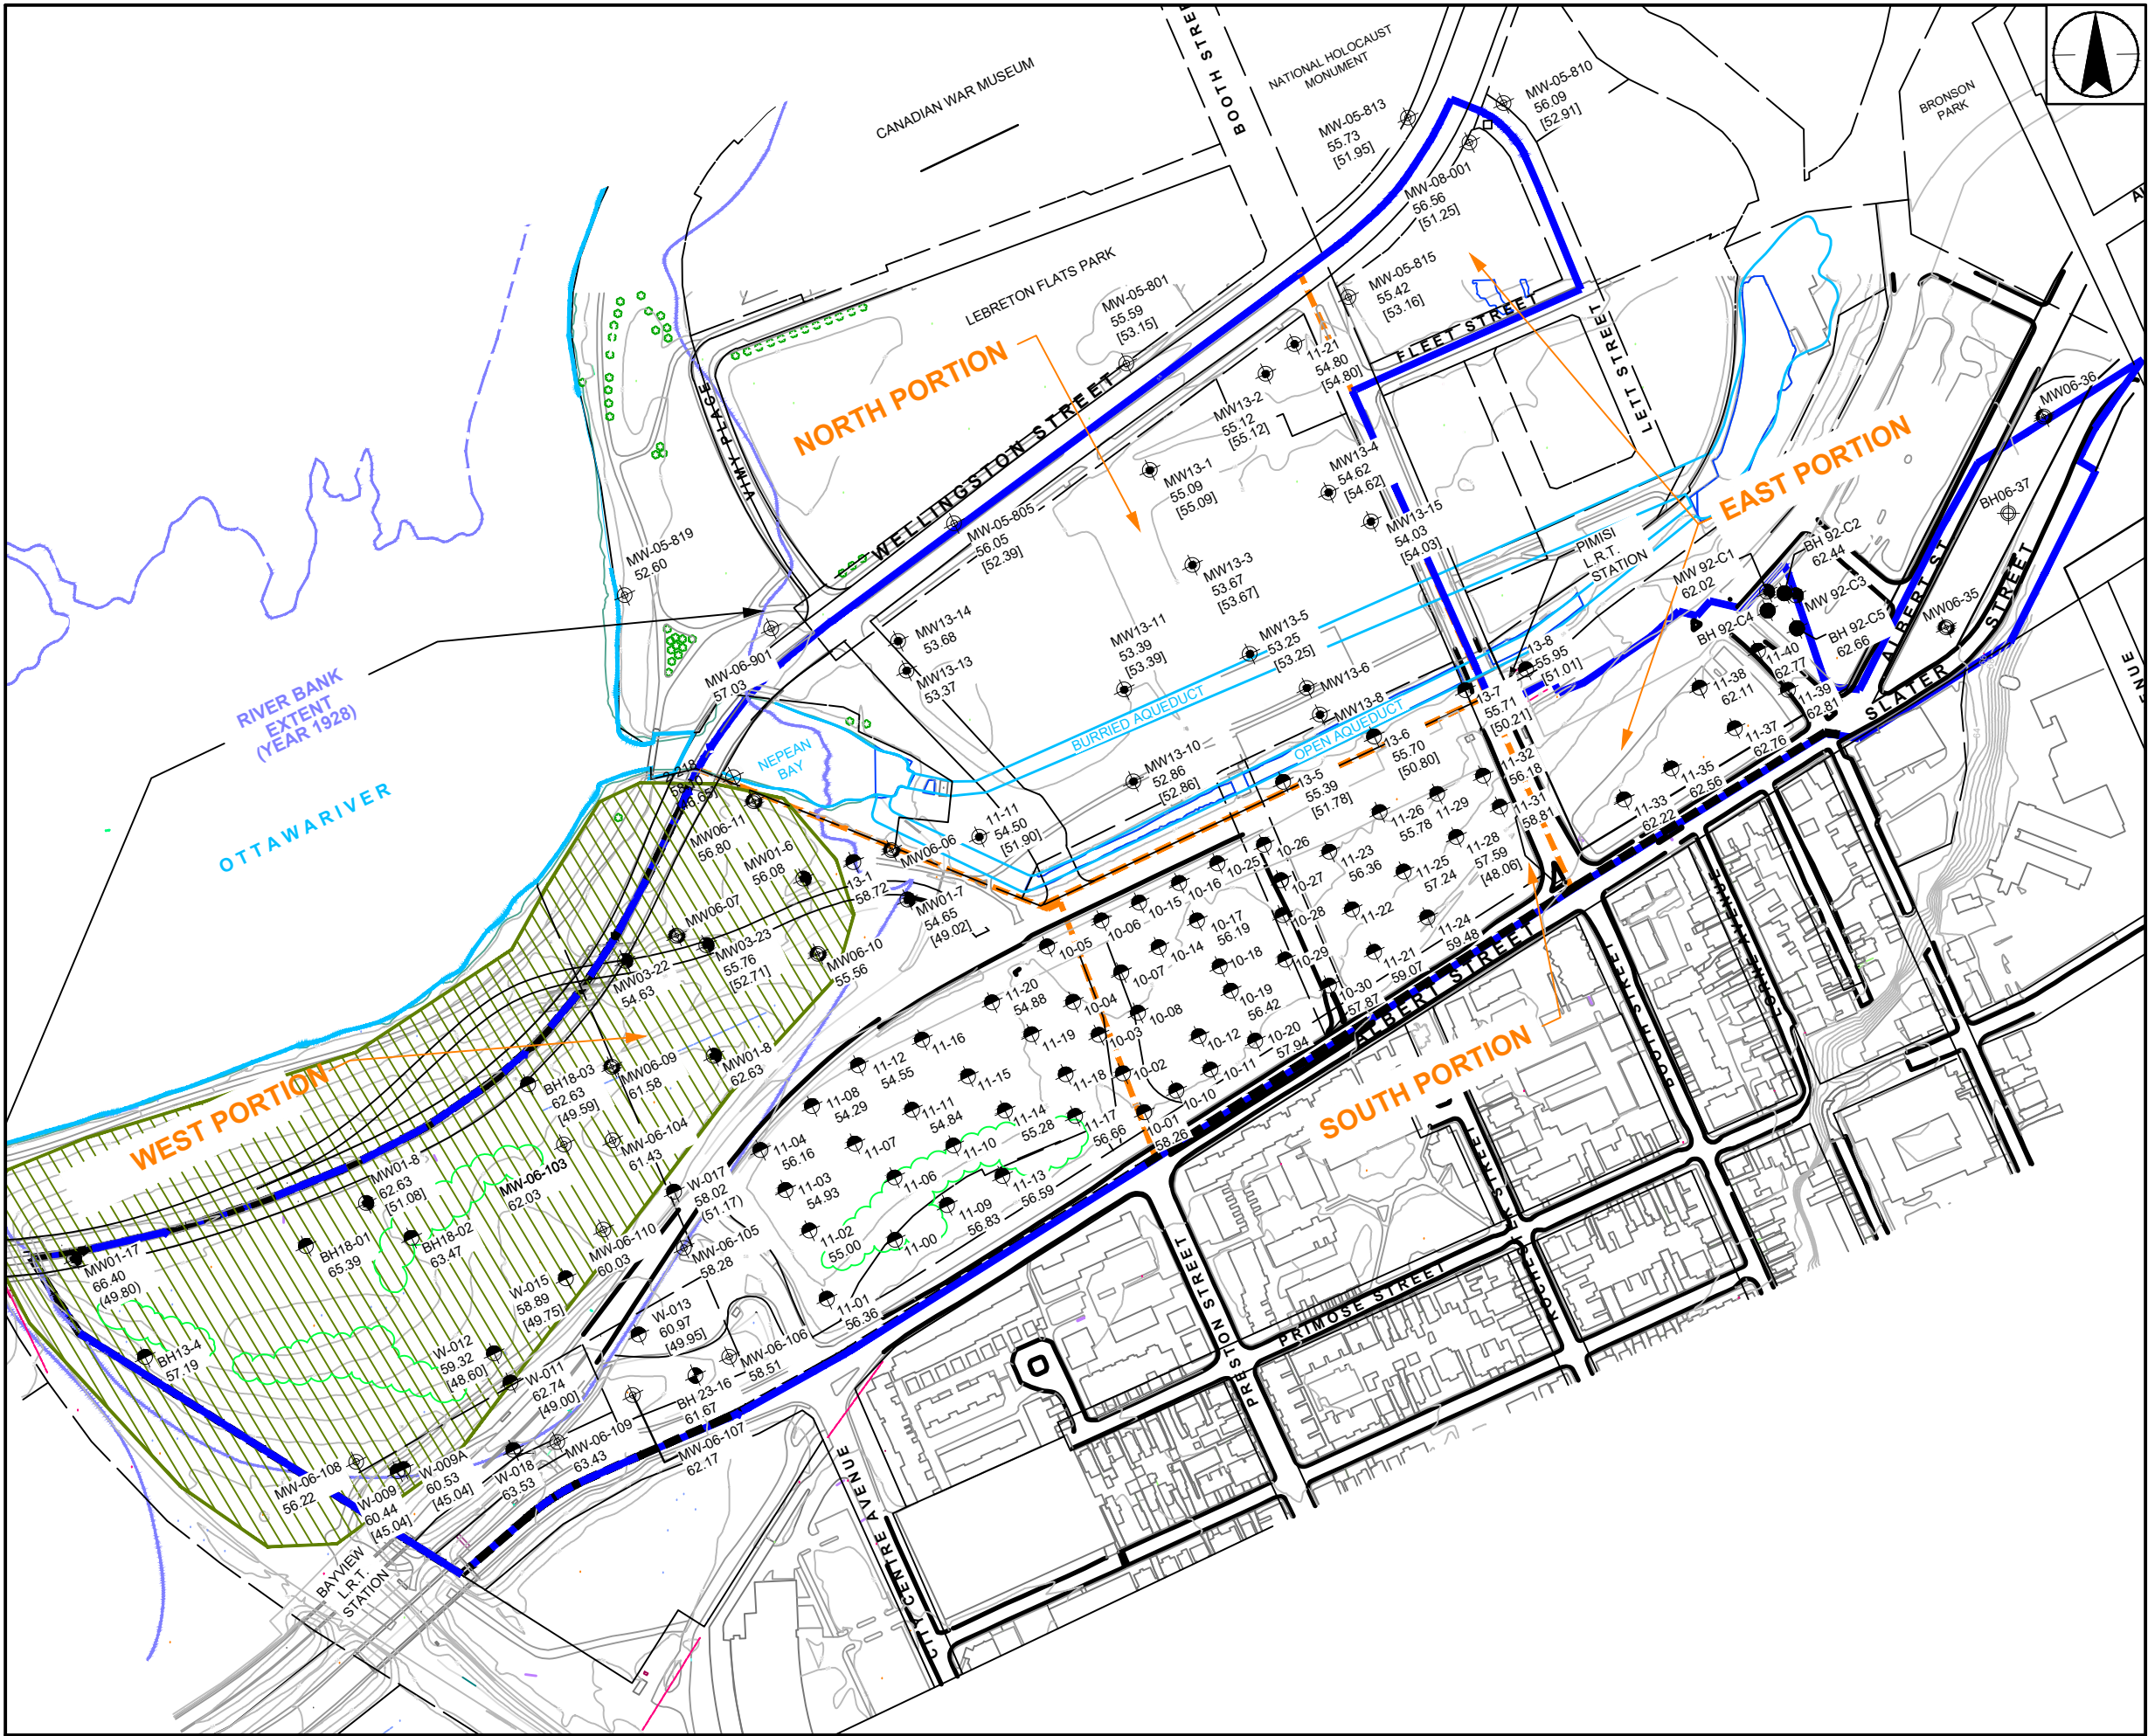


300 - 1331 Clyde Avenue
Ottawa, ON, Canada K2C 3G4
www.stantec.com

LEGEND

- BOREHOLE LOCATION (PATERSON GROUP, 2016)
- BOREHOLE LOCATION (GOLDER, 2010-2013)
- BOREHOLE WITH MONITORING WELL LOCATION (GOLDER, 2010-2013)
- BOREHOLE LOCATION (JACQUES, WHITFORD LIMITED, 2001)
- BOREHOLE WITH MONITORING WELL LOCATION (JACQUES, WHITFORD LIMITED, 2001)
- BOREHOLE LOCATION (TROW, 2002)
- BOREHOLE WITH MONITORING WELL LOCATION (AQUA TERRA, 2005-2008)
- BOREHOLE LOCATION (INTERA, 2006)
- BOREHOLE WITH MONITORING WELL LOCATION (INTERA, 2006)
- FORMER LANDFILL (Ur-06)
- 55.76 GROUND SURFACE ELEVATION (m)
- [52.71] BEDROCK SURFACE ELEVATION (m)

NOTES

- BASEPLAN TAKEN FROM A PDF COPY OF A DRAWING PREPARED BY PATERSON GROUP ENTITLED HISTORICAL TEST HOLE LOCATION PLAN, DATED 29/04/2020.



APRIL 2024
Project No. 106401780

Client/Project	NATIONAL CAPITAL COMMISSION GEOTECHNICAL DESKTOP REVIEW LEBRETON FLATS PLAN OF SUBDIVISION, OTTAWA, ON
Drawing No.	1
Title	BOREHOLE LOCATION PLAN

APPENDIX C

C.1 BOREHOLE RECORDS



SYMBOLS AND TERMS USED ON BOREHOLE AND TEST PIT RECORDS

SOIL DESCRIPTION

Terminology describing common soil genesis:

<i>Rootmat</i>	- vegetation, roots and moss with organic matter and topsoil typically forming a mattress at the ground surface
<i>Topsoil</i>	- mixture of soil and humus capable of supporting vegetative growth
<i>Peat</i>	- mixture of visible and invisible fragments of decayed organic matter
<i>Till</i>	- unstratified glacial deposit which may range from clay to boulders
<i>Fill</i>	- material below the surface identified as placed by humans (excluding buried services)

Terminology describing soil structure:

<i>Desiccated</i>	- having visible signs of weathering by oxidization of clay minerals, shrinkage cracks, etc.
<i>Fissured</i>	- having cracks, and hence a blocky structure
<i>Varved</i>	- composed of regular alternating layers of silt and clay
<i>Stratified</i>	- composed of alternating successions of different soil types, e.g. silt and sand
<i>Layer</i>	- > 75 mm in thickness
<i>Seam</i>	- 2 mm to 75 mm in thickness
<i>Parting</i>	- < 2 mm in thickness

Terminology describing soil types:

The classification of soil types are made on the basis of grain size and plasticity in accordance with the Unified Soil Classification System (USCS) (ASTM D 2487 or D 2488) which excludes particles larger than 75 mm. For particles larger than 75 mm, and for defining percent clay fraction in hydrometer results, definitions proposed by Canadian Foundation Engineering Manual, 4th Edition are used. The USCS provides a group symbol (e.g. SM) and group name (e.g. silty sand) for identification.

Terminology describing cobbles, boulders, and non-matrix materials (organic matter or debris):

Terminology describing materials outside the USCS, (e.g. particles larger than 75 mm, visible organic matter, and construction debris) is based upon the proportion of these materials present:

<i>Trace, or occasional</i>	Less than 10%
<i>Some</i>	10-20%
<i>Frequent</i>	> 20%

Terminology describing compactness of cohesionless soils:

The standard terminology to describe cohesionless soils includes compactness (formerly "relative density"), as determined by the Standard Penetration Test (SPT) N-Value - also known as N-Index. The SPT N-Value is described further on page 3. A relationship between compactness condition and N-Value is shown in the following table.

Compactness Condition	SPT N-Value
<i>Very Loose</i>	<4
<i>Loose</i>	4-10
<i>Compact</i>	10-30
<i>Dense</i>	30-50
<i>Very Dense</i>	>50

Terminology describing consistency of cohesive soils:

The standard terminology to describe cohesive soils includes the consistency, which is based on undrained shear strength as measured by *in situ* vane tests, penetrometer tests, or unconfined compression tests. Consistency may be crudely estimated from SPT N-Value based on the correlation shown in the following table (Terzaghi and Peck, 1967). The correlation to SPT N-Value is used with caution as it is only very approximate.

Consistency	Undrained Shear Strength		Approximate SPT N-Value
	kips/sq.ft.	kPa	
<i>Very Soft</i>	<0.25	<12.5	<2
<i>Soft</i>	0.25 - 0.5	12.5 - 25	2-4
<i>Firm</i>	0.5 - 1.0	25 - 50	4-8
<i>Stiff</i>	1.0 - 2.0	50 - 100	8-15
<i>Very Stiff</i>	2.0 - 4.0	100 - 200	15-30
<i>Hard</i>	>4.0	>200	>30

ROCK DESCRIPTION

Except where specified below, terminology for describing rock is as defined by the International Society for Rock Mechanics (ISRM) 2007 publication "The Complete ISRM Suggested Methods for Rock Characterization, Testing and Monitoring: 1974-2006"

Terminology describing rock quality:

RQD	Rock Mass Quality
0-25	Very Poor Quality
25-50	Poor Quality
50-75	Fair Quality
75-90	Good Quality
90-100	Excellent Quality

Alternate (Colloquial) Rock Mass Quality	
Very Severely Fractured	Crushed
Severely Fractured	Shattered or Very Blocky
Fractured	Blocky
Moderately Jointed	Sound
Intact	Very Sound

RQD (Rock Quality Designation) denotes the percentage of intact and sound rock retrieved from a borehole of any orientation. All pieces of intact and sound rock core equal to or greater than 100 mm (4 in.) long are summed and divided by the total length of the core run. RQD is determined in accordance with ASTM D6032.

SCR (Solid Core Recovery) denotes the percentage of solid core (cylindrical) retrieved from a borehole of any orientation. All pieces of solid (cylindrical) core are summed and divided by the total length of the core run (It excludes all portions of core pieces that are not fully cylindrical as well as crushed or rubble zones).

Fracture Index (FI) is defined as the number of naturally occurring fractures within a given length of core. The Fracture Index is reported as a simple count of natural occurring fractures.

Terminology describing rock with respect to discontinuity and bedding spacing:

Spacing (mm)	Discontinuities	Bedding
>6000	Extremely Wide	-
2000-6000	Very Wide	Very Thick
600-2000	Wide	Thick
200-600	Moderate	Medium
60-200	Close	Thin
20-60	Very Close	Very Thin
<20	Extremely Close	Laminated
<6	-	Thinly Laminated

Terminology describing rock strength:


Strength Classification	Grade	Unconfined Compressive Strength (MPa)
Extremely Weak	R0	<1
Very Weak	R1	1 – 5
Weak	R2	5 – 25
Medium Strong	R3	25 – 50
Strong	R4	50 – 100
Very Strong	R5	100 – 250
Extremely Strong	R6	>250

Terminology describing rock weathering:

Term	Symbol	Description
Fresh	W1	No visible signs of rock weathering. Slight discoloration along major discontinuities
Slightly	W2	Discoloration indicates weathering of rock on discontinuity surfaces. All the rock material may be discolored.
Moderately	W3	Less than half the rock is decomposed and/or disintegrated into soil.
Highly	W4	More than half the rock is decomposed and/or disintegrated into soil.
Completely	W5	All the rock material is decomposed and/or disintegrated into soil. The original mass structure is still largely intact.
Residual Soil	W6	All the rock converted to soil. Structure and fabric destroyed.

STRATA PLOT



Strata plots symbolize the soil or bedrock description. They are combinations of the following basic symbols. The dimensions within the strata symbols are not indicative of the particle size, layer thickness, etc.

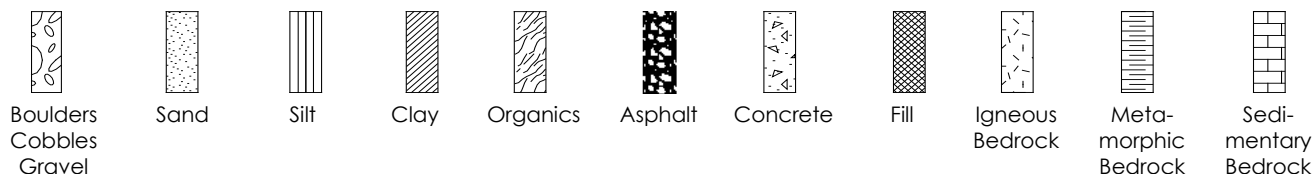

SAMPLE TYPE

SS	Split spoon sample (obtained by performing the Standard Penetration Test)
ST	Shelby tube or thin wall tube
DP	Direct-Push sample (small diameter tube sampler hydraulically advanced)
PS	Piston sample
BS	Bulk sample
HQ, NQ, BQ, etc.	Rock core samples obtained with the use of standard size diamond coring bits.

WATER LEVEL MEASUREMENT



RECOVERY

For soil samples, the recovery is recorded as the length of the soil sample recovered. For rock core, recovery is defined as the total cumulative length of all core recovered in the core barrel divided by the length drilled and is recorded as a percentage on a per run basis.

N-VALUE

Numbers in this column are the field results of the Standard Penetration Test: the number of blows of a 140 pound (63.5 kg) hammer falling 30 inches (760 mm), required to drive a 2 inch (50.8 mm) O.D. split spoon sampler one foot (300 mm) into the soil. In accordance with ASTM D1586, the N-Value equals the sum of the number of blows (N) required to drive the sampler over the interval of 6 to 18 in. (150 to 450 mm). However, when a 24 in. (610 mm) sampler is used, the number of blows (N) required to drive the sampler over the interval of 12 to 24 in. (300 to 610 mm) may be reported if this value is lower. For split spoon samples where insufficient penetration was achieved and N-Values cannot be presented, the number of blows are reported over sampler penetration in millimetres (e.g. 50/75). Some design methods make use of N-values corrected for various factors such as overburden pressure, energy ratio, borehole diameter, etc. No corrections have been applied to the N-values presented on the log.

DYNAMIC CONE PENETRATION TEST (DCPT)

Dynamic cone penetration tests are performed using a standard 60 degree apex cone connected to 'A' size drill rods with the same standard fall height and weight as the Standard Penetration Test. The DCPT value is the number of blows of the hammer required to drive the cone one foot (300 mm) into the soil. The DCPT is used as a probe to assess soil variability.

OTHER TESTS

S	Sieve analysis
H	Hydrometer analysis
k	Laboratory permeability
γ	Unit weight
G_s	Specific gravity of soil particles
CD	Consolidated drained triaxial
CU	Consolidated undrained triaxial with pore pressure measurements
UU	Unconsolidated undrained triaxial
DS	Direct Shear
C	Consolidation
Q_u	Unconfined compression
I_p	Point Load Index (I_p on Borehole Record equals $I_p(50)$ in which the index is corrected to a reference diameter of 50 mm)

	Single packer permeability test; test interval from depth shown to bottom of borehole
	Double packer permeability test; test interval as indicated
	Falling head permeability test using casing
	Falling head permeability test using well point or piezometer

MONITOR WELL RECORD

92-C1

CLIENT National Capital Commission

PROJECT No. 30203

LOCATION Site C - Lebreton Flats, Ottawa, Ontario

DATUM Geodetic

DATES: BORING 92-02-01

WATER LEVEL 92-02-18

TPC ELEV. 61.99

DEPTH (m)	ELEVATION (m)	STRATA DESCRIPTION	STRATA PLOT	WATER LEVEL	DEPTH (ft)	VAPOUR CONCENTRATIONS				SAMPLES		WELL CONSTRUCTION
						● %LEL	▲ ppm			TYPE	N-VALUE OR RQD	
						● 20 40 60 80	▲ 100 200 300 400					
0	62.02	Dark brown, sand and gravel : FILL										
	61.3	Loose, dark brown, SILTY SAND, trace gravel								SS	6	Bentonite Seal
1	60.6	Compact, olive brown, sand and silt, trace gravel : TILL								SS	28	Sand Backfill
2	59.8	Dense, olive brown, sand and silt, trace gravel : TILL								SS	42	Slotted Pipe with Sand Backfill
	59.4	End of Borehole										
3		Auger refusal on possible bedrock										
4												
5												
6												



BOREHOLE RECORD

92-C2

CLIENT National Capital Commission

PROJECT No. 30203

LOCATION Site C - Lebreton Flats, Ottawa, Ontario

DATUM Geodetic

DATES: BORING 92-02-01

WATER LEVEL N.A.

TPC ELEV. N.A.

DEPTH (m)	ELEVATION (m)	STRATA DESCRIPTION	STRATA PLOT	WATER LEVEL	DEPTH (ft)	VAPOUR CONCENTRATIONS				SAMPLES		WELL CONSTRUCTION
						● %LEL	▲ ppm			TYPE	N-VALUE OR RQD	
0	62.44					● 20 40 60 80 ▲ 100 200 300 400						No Monitoring Well Installed
		Dark brown, sand and gravel : FILL										
	61.7				2							
1		Compact, brownish orange, sand and gravel, trace silt : FILL			4		▲			SS	20	
	61.0											
	60.8	Compact, dark brown, sand and gravel : FILL			6		▲			SS	28	
2		Compact, grey, sand and silt, some gravel : TILL										
	60.2				8		▲			SS	62	
3		Very dense, grey, sand and silt, trace gravel : TILL			10		▲			SS	65	
					12							
4					14		▲			SS	83	
					16		▲			SS	*	
5	57.2	End of Borehole			18							
6		* Split spoon refusal on possible bedrock										



MONITOR WELL RECORD

92-C3

CLIENT National Capital Commission

PROJECT No. 30203

LOCATION Site C - Lebreton Flats, Ottawa, Ontario

DATUM Geodetic

DATES: BORING 92-02-01 WATER LEVEL 92-02-18 - Dry

TPC ELEV. 62.12

DEPTH (m)	ELEVATION (m)	STRATA DESCRIPTION	STRATA PLOT	WATER LEVEL	DEPTH (ft)	VAPOUR CONCENTRATIONS				SAMPLES		WELL CONSTRUCTION
						● %LEL	▲ ppm			TYPE	N-VALUE OR RQD	
						● 20 40 60 80	▲ 100 200 300 400					
0	62.25	Very dense, brown to dark brown, sand and gravel with trace organics : FILL										Bentonite Seal
1										SS	51	Sand Backfill
2	60.8	Compact, grey, sand and silt, trace gravel : TILL								SS	27	
3										SS	65	Slotted Pipe with Sand Backfill
4	58.8	End of Borehole								SS	*	
		* Split spoon refusal on possible bedrock										
5												
6												



BOREHOLE RECORD

92-C4

CLIENT National Capital Commission

PROJECT No. 30203

LOCATION Site C - Lebreton Flats, Ottawa, Ontario

DATUM Geodetic

DATES: BORING 92-02-01

WATER LEVEL N.A.

TPC ELEV. N.A.

DEPTH (m)	ELEVATION (m)	STRATA DESCRIPTION	STRATA PLOT	WATER LEVEL	DEPTH (ft)	VAPOUR CONCENTRATIONS				SAMPLES		WELL CONSTRUCTION
						● %LEL	▲ ppm			TYPE	N-VALUE OR RQD	
0	62.00	Brown, sand and gravel, trace silt : FILL				20 40 60 80 ▲ 100 200 300 400						No Monitoring Well Installed
1	61.3	Compact, brown, sand and silt with some brick, wood and slag : FILL								SS	29	
2	60.6	Loose, light brown, sand and some cobbles with some black staining at 2 m below grade : FILL								SS	9	
3	59.8	Dense, grey, sand and silt, trace to some gravel : TILL								SS	52	
										SS	49	
	58.4	End of Borehole								SS	45	
4		Auger refusal on possible bedrock										
5												
6												




BOREHOLE RECORD

92-C5

CLIENT National Capital Commission
LOCATION Site C - Lebreton Flats, Ottawa, Ontario
DATES: BORING 92-02-01 WATER LEVEL N.A.

PROJECT No. 30203
DATUM Geodetic
TPC ELEV. N.A.

DEPTH (m)	ELEVATION (m)	STRATA DESCRIPTION	STRATA PLOT	WATER LEVEL	DEPTH (ft)	VAPOUR CONCENTRATIONS				SAMPLES		WELL CONSTRUCTION				
						● %LEL	▲ ppm			TYPE	N-VALUE OR RQD					
0	62.66					● 20	▲ 100	40	200	60	300	80	400			
		Compact, brown to dark brown, sand and gravel, some brick : FILL														No Monitoring Well Installed
1					2											
	61.2				4		▲							SS	24	
2		Compact to dense, light brown to grey, sand and silt, trace gravel : TILL			6		▲							SS	26	
					8		▲							SS	50	
3					10											
					12		▲							SS	31	
4					14		▲							SS	51	
	58.2				16											
5		End of Borehole			18											
		Auger refusal on possible bedrock														
6																





CLIENT Robinson Consultants Inc.

BOREHOLE No. MW01-6

LOCATION LeBretons Flats, ABC Lines, Ottawa, Ontario

PROJECT No. ONO11359

DATES: BORING 01 04 06

WATER LEVEL 01 04 18

DATUM Geodetic

DEPTH (m)	ELEVATION (m)	SOIL DESCRIPTION	STRATA PLOT	WATER LEVEL	SAMPLES				UNDRAINED SHEAR STRENGTH - kPa									
					TYPE	NUMBER	RECOVERY (mm)	N-VALUE OR RQD	50 100 150 200 WATER CONTENT & ATTERBERG LIMITS DYNAMIC PENETRATION TEST, BLOWS/0.3m STANDARD PENETRATION TEST, BLOWS/0.3m 10 20 30 40 50 60 70 80 90									
0	56.08																	
	56.0	TOPSOIL			AS	1	---	---										
		Compact, brown silt and sand, trace gravel, trace organics, trace clay: FILL			SS	2	200	10										
1																		
	54.6																	
		Stiff, grey brown silty clay, trace gravel, trace organics: FILL			SS	3	250	11										
2																		
	54.0																	
		Dense, grey brown silty sand and gravel: FILL			SS	4	200	27										
3																		
		Frequent cobbles and boulders																
					SS	5	150	36										
4																		
	52.0				SS	6	150	50/280 mm										
		Grey black limestone and shale boulders			NQ	7	100%	63%										
					SS	8	0	50/										
5																		
	50.8				NQ	9	100%	200 mm 100%										
		Void																
6																		
	50.1																	
	49.8	Compact, black silty sand and gravel, trace organics (wood chips): FILL			SS	10	300	19										
7																		
	48.9	Loose, grey SAND, trace to some silt and gravel			SS	11	510	7										
8																		
		Installed Well																
		End of Borehole																
9																		
10																		

A-

▽ Inferred Groundwater Level

▼ Groundwater Level Measured in Standpipe

□ Field Vane Test, kPa

□ Remoulded Vane Test, kPa

△ Pocket Penetrometer Test, kPa



CLIENT Robinson Consultants Inc.

BOREHOLE No. MW01-7

LOCATION LeBretons Flats, ABC Lines, Ottawa, Ontario

PROJECT No. ONO11359

DATES: BORING 01 04 06

WATER LEVEL 01 04 18

DATUM Geodetic

DEPTH (m)	ELEVATION (m)	SOIL DESCRIPTION	STRATA PLOT	WATER LEVEL	SAMPLES				UNDRAINED SHEAR STRENGTH - kPa									
					TYPE	NUMBER	RECOVERY (mm)	N-VALUE OR RQD	50 100 150 200 WATER CONTENT & ATTERBERG LIMITS DYNAMIC PENETRATION TEST, BLOWS/0.3m STANDARD PENETRATION TEST, BLOWS/0.3m 10 20 30 40 50 60 70 80 90									
0	54.65																	
	54.6	TOPSOIL			AS	1	---	---										
	53.9	Loose, brown black silty sand, trace gravel, trace to some clay:																
1		FILL			SS	2	330	4										
		Loose, grey black silty sand, trace clay, debris (plastic): FILL																
2	52.5				SS	3	400	2										
		Soft, black peat, some silt, some sand: ORGANICS			SS	4	260	13										
3					SS	5	270	9										
4	51.0				SS	6	530	10										
		Compact, grey SILTY SAND, some clay, trace gravel			SS	7	410	16										
5	49.2				NQ	8	100%	0%										
6		Severely fractured, grey limestone: BEDROCK			NQ	9	79%	36%										
7	47.2																	
8		Installed Well																
9		End of Borehole																
10																		

A-

▽ Inferred Groundwater Level

▼ Groundwater Level Measured in Standpipe

□ Field Vane Test, kPa

□ Remoulded Vane Test, kPa

△ Pocket Penetrometer Test, kPa



CLIENT Robinson Consultants Inc.

BOREHOLE No. MW01-8

LOCATION LeBretons Flats, ABC Lines, Ottawa, Ontario

PROJECT No. ONO11359

DATES: BORING 01 04 06

WATER LEVEL 01 04 18

DATUM Geodetic

DEPTH (m)	ELEVATION (m)	SOIL DESCRIPTION	STRATA PLOT	WATER LEVEL	SAMPLES				UNDRAINED SHEAR STRENGTH - kPa									
					TYPE	NUMBER	RECOVERY (mm)	N-VALUE OR RQD	50 100 150 200 WATER CONTENT & ATTERBERG LIMITS DYNAMIC PENETRATION TEST, BLOWS/0.3m STANDARD PENETRATION TEST, BLOWS/0.3m 10 20 30 40 50 60 70 80 90									
0	62.63																	
0.6	62.6	TOPSOIL			AS	1	---	---										
0.9	61.9	Firm, brown silty clay, trace gravel, trace organics, trace debris (wood fragments): FILL			SS	2	400	10										
1.1		Firm to stiff, brown grey sandy clay, some silt, trace gravel, trace debris (rubber, brick, wood): FILL			SS	3	520	4										
2.1					SS	4	270	4										
3.1					SS	5	530	35										
4.1					SS	6	140	3										
5.1					SS	7	90	8										
5.3	57.3	Stiff, grey silty clay, some sand, trace gravel, rock fragments, trace debris (wood, plastic): FILL			SS	8	170	3										
6.1					SS	9	310	8										
7.1					SS	10	440	13										
8.1		Sand seam			SS	11	470	8										
9.1	53.6	Compact, grey silty sand, rock fragments, trace debris (glass, brick, wood): FILL			SS	12	470	17										
9.3					SS	13	460	19										
9.7	52.7																	
10.0																		

A-

- ▽ Inferred Groundwater Level
- ▼ Groundwater Level Measured in Standpipe

- Field Vane Test, kPa
- Remoulded Vane Test, kPa
- △ Pocket Penetrometer Test, kPa



CLIENT Robinson Consultants Inc.

BOREHOLE No. MW01-8

LOCATION LeBretons Flats, ABC Lines, Ottawa, Ontario

PROJECT No. ONO11359

DATES: BORING 01 04 06

WATER LEVEL 01 04 18

DATUM Geodetic

DEPTH (m)	ELEVATION (m)	SOIL DESCRIPTION	STRATA PLOT	WATER LEVEL	SAMPLES				UNDRAINED SHEAR STRENGTH - kPa	
					TYPE	NUMBER	RECOVERY (mm)	N-VALUE OR RQD	50	100
10		Decomposed paper, trace wood fragments: FILL			SS	14	540	50/		
								330 mm		
11	51.5	Few cobbles			SS	15	170	27		
		Auger Refusal at 10.52 m, hammered spoon, then continued augering								
	51.1				SS	16	280	50/		
		Dense, grey SILTY SAND, some to trace gravel, trace clay						430 mm		
12		Auger Refusal								
		Inferred Bedrock at 11.55 m								
		Installed Well								
		End of Borehole								
13										
14										
15										
16										
17										
18										
19										
20										

A- ☐ Inferred Groundwater Level

☐ Groundwater Level Measured in Standpipe

☐ Field Vane Test, kPa

☐ Remoulded Vane Test, kPa

☐ Pocket Penetrometer Test, kPa



MONITORING WELL RECORD

MW01-10

CLIENT Robinson Consultants Inc.
LOCATION LeBreton Flats, ABC Lines, Ottawa, Ontario
DATES BORING 2001-04-09 WATER LEVEL 2001-04-18

PROJECT No. ONO11359 ORIGINATED BY BC
DATUM Geodetic COMPILED BY SS
TPC ELEV 60.283 CHECKED BY EG

DEPTH (m)	ELEVATION (m)	STRATA DESCRIPTION	STRATA PLOT	WATER LEVEL	DEPTH (ft)	VAPOUR CONCENTRATIONS ● %LEL ▲ ppmv	SAMPLES TYPE NUMBER N-VALUE	WELL CONSTRUCTION
0	59.45					● 20 40 60 80 ▲ 100 200 300 400		
0	59.4	TOPSOIL. Loose, dark brown silty sand, trace clay: FILL			2	▲	AS 1 ---	Protective Casing and Concrete Seal Bentonite Seal
1	58.2	Firm, grey brown silty clay, trace gravel, trace debris (brick): FILL			4	▲	SS 2 8	51 mm, #10. Slotted PVC Screen with Sandpack
2	57.2	Loose, grey black silty sand, trace gravel, trace debris (steel, wood waste): FILL			6	▲	SS 3 4	
3					8	▲	SS 4 3	
3	56.1	Firm, grey black silty clay, trace debris (brick, glass): FILL			10	▲	SS 5 8	
4					12			
4					14	▲	SS 6 5	
5	54.9	Compact, grey black silty sand, trace debris (brick, wood waste): FILL			16	▲	SS 7 3	
5					18	▲	SS 8 15	
6					20	▲	SS 9 8	
6					22			
7					24	▲	SS 10 5	
8					26	▲	SS 11 4	
8					28	▲	SS 12 50/ 560 mm	
9	50.6 50.3	Compact, grey SAND, some gravel, trace silt Auger Refusal			30			
10		Inferred Bedrock at 9.14 m			32			
LABORATORY ANALYSES: Sample MW01-10 SS10 submitted for laboratory analysis of TPH (gas/diesel), VOCs, PAHs, PCBs, Chloride, Sulphate and Inorganic Soil Decommissioning parameters								
Groundwater Level								



MONITORING WELL RECORD

MW01-17

CLIENT Robinson Consultants Inc.
LOCATION LeBreton Flats, ABC Lines, Ottawa, Ontario
DATES BORING 2001-08-15 WATER LEVEL 2001-08-23

PROJECT No ONO11359
DATUM Geodetic
TPC ELEV 67.315
ORIGINATED BY BC
COMPILED BY SS
CHECKED BY EG

DEPTH (m)	ELEVATION (m)	STRATA DESCRIPTION	STRATA PLOT WATER LEVEL	DEPTH (ft)	VAPOUR CONCENTRATIONS ● %LEL ▲ ppmv	SAMPLES TYPE NUMBER N-VALUE	WELL CONSTRUCTION
0	66.40				● 20 40 60 80 ▲ 100 200 300 400		
0	66.2	200 mm of TOPSOIL/ROOTMAT Compact to dense, brown sand with silt, trace gravel: FILL		2	▲	GS 1 ---	Protective Casing and Bentonite Seal Bentonite Seal
1				4	▲	SS 2 20	Backfill of Auger Cuttings
2				6	▲	SS 3 50/300	
3				8	▲	SS 4 50/250	
4	62.6	Loose, brown sand, trace silt, trace gravel, debris (bricks): FILL		12	▲	SS 5 17	
5				14	▲	SS 6 5	
6	61.1	Firm, grey clay, some gravel: FILL		16	▲	SS 7 5	
7	60.3	Compact, grey brown sand, some silt, trace gravel: FILL		18	▲	SS 8 4	
8				20	▲	SS 9 23	
9				22	▲	SS 10 22	
10				24	▲	SS 11 12	Bentonite Seal
				26	▲	SS 12 3	51 mm, #10, PVC Casing, with Sandpack
				28	▲	SS 13 26	51 mm, #10, Slotted PVC Screen with Sandpack
				30			
				32			

LABORATORY ANALYSES

Groundwater Level

Sample MW 01-17 SS-10 submitted for laboratory analysis of VOC's
sample MW 01-17 SS-17 submitted for analysis of PAH's and sample
MW 01-17 SS-6 submitted for analysis of TPH (gas/diesel)



A=

MONITORING WELL RECORD

MW01-17

CLIENT Robinson Consultants Inc.
LOCATION LeBreton Flats, ABC Lines, Ottawa, Ontario
DATE BORING 2001-08-15 WATER LEVEL 2001-08-23PROJECT No ONO11359 ORIGINATED BY BC
DATUM Geodetic COMPILED BY SS
TPC ELEV 67.315 CHECKED BY FG

DEPTH (m)	ELEVATION (m)	STRATA DESCRIPTION	STRATA PLOT	WATER LEVEL	DEPTH (ft)	VAPOUR CONCENTRATIONS ● %LEL ▲ ppmv	SAMPLES TYPE NUMBER N-VALUE	WELL CONSTRUCTION
10	66.40					● 20 40 60 80 ▲ 100 200 300 400		
11					34	▲	SS 14 33	
12	54.2	Stiff, grey brown silty clay, organics, debris (wood): FILL			36	▲	SS 15 25	
13	53.5	Compact, grey sand, some silt, trace clay, trace gravel, occasional rock fragments and debris : FILL			38	▲	SS 16 31	
14					40	▲	SS 17 50	
15					42			
16	50.6	Dense, grey SILTY SAND, some gravel			44	▲	SS 18 22	
17					46	▲	SS 19 6	
18	49.8	End of Borehole			48	▲	SS 20 50/430	
19					50			
20					52	▲	SS 21 35	
					54	▲	SS 22 61	
					56			
		Auger Refusal on Inferred Bedrock			58			
		Installed Well			60			
					62			
					64			
LABORATORY ANALYSES						Sample MW 01-17 SS-10 submitted for laboratory analysis of VOC's, sample MW 01-17 SS-17 submitted for analysis of PAHs, and sample MW 01-17 SS-6 submitted for analysis of TPH (gas/diesel)		
Groundwater Level								



MONITORING WELL RECORD

MW03-22

CLIENT Robinson Consultants Inc. PROJECT No. ONO11359-4 ORIGINATED BY CM/EK
LOCATION Lemieux Island Low Pressure Transmission Main, Ottawa, ON DATUM Geodetic COMPILED BY JF
DATES: BORING 05-30-03 WATER LEVEL 06-26-03 TPC ELEV. 54.55 CHECKED BY CM

DEPTH (m)	ELEVATION (m)	STRATA DESCRIPTION	STRATA PLOT	WATER LEVEL	DEPTH (ft)	VAPOUR CONCENTRATIONS ● %LEL ▲ ppmv	SAMPLES			WELL CONSTRUCTION
							TYPE	NUMBER	N-VALUE	
0	54.63					● 20 40 60 80 ▲ 100 200 300 400				
0.5	54.5	100 mm ASPHALT					GS	1	---	Protective Casing and Bentonite Seal
0.5	54.4	Granulars								
1		Compact to loose, grey to brown sand and gravel, some brick, some wood: FILL			2	▲	SS	2	21	Bentonite Seal
1					4	▲	SS	3	9	
2					6		SS	4	6	51 mm, Schedule 40, PVC Casing, with Sandpack
2					8					Protective Casing and Concrete Seal
3					10	▲	SS	5	7	
3	51.0				12		SS	6	7	
4		Very loose, sandy gravel, trace organics, wood: FILL			14		SS	7	3	
4	50.4				16	▲	SS	8	2	
5		Very loose to compact, grey clay, trace gravel, wood: FILL			18	▲	SS	9	15	
5	49.1				20		SS	10	21	
6		Compact to dense, grey silty sand, some clay: GLACIAL TILL			22		SS	11	25	
7					24		SS	12	50/80mm	Backfill of Auger Cuttings
7	47.4				26					
8		End of Borehole			28					
8		Auger Refusal on Inferred Bedrock			30					
9		Monitoring Well Installed			32					
10										

LABORATORY ANALYSES:

MW03-22 SS8 submitted for analysis of BTEX, TPH (g, d, ho), and VOCs. MW03-22 SS6 submitted for PAHs. MW03-22 SS2 submitted for analysis of general inorganics.
Groundwater sample submitted for analysis of BTEX, TPH (g, d, ho), VOCs, PAHs and general inorganics.

Groundwater Level

A-



MONITORING WELL RECORD

MW03-23

CLIENT Robinson Consultants Inc.

PROJECT No. ONO11359-4 ORIGINATED BY CM/EK


LOCATION Lemieux Island Low Pressure Transmission Main, Ottawa, ON

DATUM Geodetic COMPILED BY JF

DATES: BORING 05-30-03

WATER LEVEL 06-26-03

TPC ELEV. 55.669 CHECKED BY CM

DEPTH (m)	ELEVATION (m)	STRATA DESCRIPTION	STRATA PLOT	WATER LEVEL	DEPTH (ft)	VAPOUR CONCENTRATIONS				SAMPLES			WELL CONSTRUCTION	
						● %LEL ▲ ppmv				TYPE	NUMBER	N-VALUE		
						● 20	40	60	80					
						▲ 100	200	300	400					
0	55.76													
	55.7	100 mm ASPHALT								GS	1	---	Protective Casing and Bentonite Seal	
	55.6	Grey sand and gravel: FILL												
		Compact, brown sand: FILL			2					SS	2	12	Bentonite Seal	
1	54.5	Compact, grey sand, brick, wood: FILL			4					SS	3	29	51 mm, Schedule 40, PVC Casing, with Auger Cuttings	
	53.9	Dense to loose, brown to grey sand and gravel: FILL			6					SS	4	45		
2					8					SS	5	5		
3					10					SS	6	11		
	52.1	Loose to very loose, grey gravel, some sand, some rock fragments: FILL			12					SS	7	8		
4					14					SS	8	3		
5					16					SS	9	3		
	49.7	Loose to compact, grey silty sand: GLACIAL TILL			18					SS	10	7		
6					20					SS	11	6		
7					22					SS	12	14		
	48.1	Compact to dense, grey to brown silty sand, trace gravel: GLACIAL TILL			24					SS	13	32	Bentonite Seal	
8					26					SS	14	70		
					28					SS	15	50/100mm		
9					30									
	46.0				32									
10														
LABORATORY ANALYSES: MW03-23 SS12 submitted for analysis of BTEX, TPH (g, d, ho), and VOCs. MW03-23 SS3 submitted for analysis of Regulation 347, PAHs and general inorganics. Groundwater sample submitted for analysis of BTEX, TPH (g, d, ho), VOCs. PAHs and general inorganics.														
☒ Groundwater Level														
													A- 	

MW03-23

CLIENT	Robinson Consultants Inc.	PROJECT No.	ON011359-4	ORIGINATED BY	CM/EK
LOCATION	Lemieux Island Low Pressure Transmission Main, Ottawa, ON	DATUM	Geodetic	COMPILED BY	JF
DATES: BORING	05-30-03	WATER LEVEL	06-26-03	TPC ELEV.	55.669
				CHECKED BY	CM

DATE: BORING																
DEPTH (m)	ELEVATION (m)	STRATA DESCRIPTION	STRATA PLOT	WATER LEVEL	DEPTH (ft)	VAPOUR CONCENTRATIONS				SAMPLES			WELL CONSTRUCTION			
						● %LEL	▲ ppmv			TYPE	NUMBER	N-VALUE				
						● 20	40	60	80							
						▲ 100	200	300	400							
10	55.76	Poor to good, light grey limestone with occasional shale interbeds: BEDROCK			34						HQ	16	49 %	 51 mm, Schedule 40, PVC Casing, with Sandpack 51 mm, Schedule 40, slot #10, PVC Screen with Sandpack		
11					36								HQ		17	80 %
	44.0				38											
12		End of Borehole			40											
		Monitoring Well Installed			42											
13					44											
					46											
14					48											
					50											
15					52											
					54											
16					56											
					58											
17					60											
					62											
18					64											
19																
20																
LABORATORY ANALYSES: MW03-23 SS12 submitted for analysis of BTEX, TPH (g, d, ho), and VOCs. MW03-23 SS3 submitted for analysis of Regulation 347, PAHs and general inorganics. Groundwater sample submitted for analysis of BTEX, TPH (g, d, ho), VOCs. PAHs and general inorganics.																
☒ Groundwater Level																
A-																

Borehole/Monitoring Well ID: MW-05-801

Page 1 of 1

Project No.: 97-142H

Client: National Capital Commission

Location: LeBreton Flats, Ottawa

Date Completed: November 2, 2005

Site Datum: IB84 with geodetic elevation of 55.035 m AMSL

ATSI Supervisor: S.Dingee

Drilling Method: HSA/DTH

Borehole Diameter: 203 mm/102 mm

Monitoring Well Diameter: 51 mm


Drilling Company: Downing Drilling Ltd.

Drilling Equipment: CME 55 Truck

Well Casing: PVC Schedule 40

Well Screen: PVC Schedule 40, Slot 10

OVM: Samples not screened

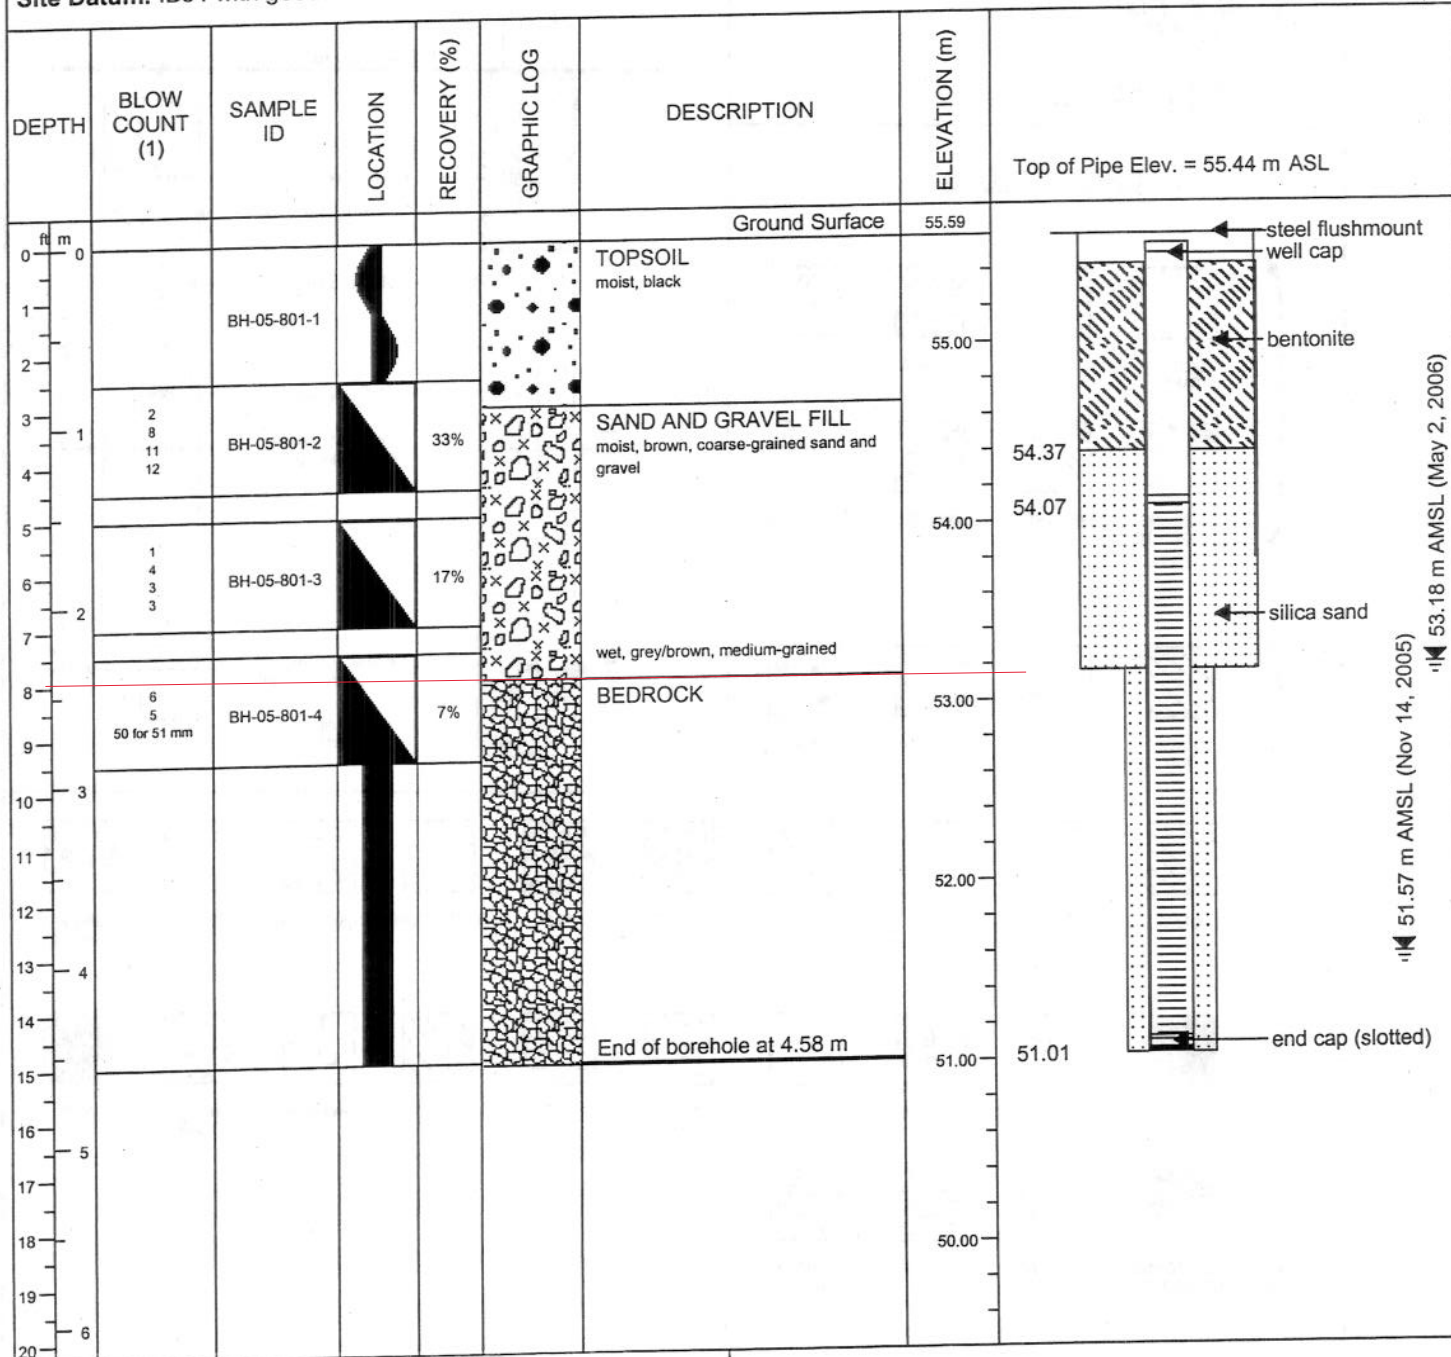

(1) Blow count per 0.15 m using conventional hammer and split spoons

HSA = Hollow Stem Auger
DTH = Down the hole Hammer

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.



Borehole/Monitoring Well ID: MW-05-805

Page 1 of 1

Project No.: 97-142H

Client: National Capital Commission

Location: LeBreton Flats, Ottawa

Date Completed: November 2, 2005

Site Datum: IB84 with geodetic elevation of 55.035 m AMSL

ATSI Supervisor: S.Dingee

Drilling Method: HSA/DTH

Borehole Diameter: 204 mm/102mm

Monitoring Well Diameter: 51 mm

Drilling Company: Downing Drilling Ltd.


Drilling Equipment: CME 55 Truck

Well Casing: PVC Schedule 40

Well Screen: PVC Schedule 40, Slot 10

OVM: Samples not screened

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
								Top of pipe Elev. = 55.96m ASL
0						Ground Surface	56.05	
1				N/A		ASPHALT		
2						SAND AND GRAVEL FILL dry, grey, fine sand, coarse gravel		
3	20	BH-05-805-1		50%			55.00	
4	24							
5	18					clayey, silty, grey		
6	20	BH-05-805-2		46%			54.00	
7								
8	19							
9	18							
10	20	BH-05-805-3		50%		SILTY CLAY moist, grey/brown, with fine sand, trace gravel	53.31	
11	7						53.00	
12	4							
13	4	BH-05-805-4		17%			52.70	
14	7							
15	11					BEDROCK	52.00	
16	1							
17	6							
18	50 for 127 mm							
19								
20								
21								
22								
23								
24								
25								
26								
27								

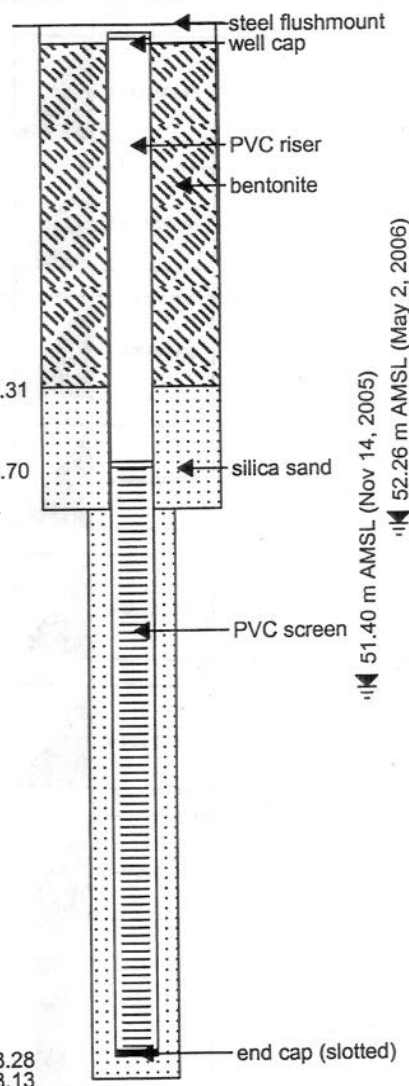

(1) Blow count per 0.15 m using conventional hammer and split spoons

HSA = Hollow Stem Auger
DTH = Down the hole Hammer

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.



Borehole/Monitoring Well ID: MW-05-810

Page 1 of 1

Project No.: 97-142H

Client: National Capital Commission

Location: LeBreton Flats, Ottawa

Date Completed: November 7, 2005

Site Datum: IB84 with geodetic elevation of 55.035 m AMSL

ATSI Supervisor: S.Dingee

Drilling Method: HSA/DTH

Borehole Diameter: 204 mm/102

Monitoring Well Diameter: 51 mm

Drilling Company: Downing Drilling Ltd.


Drilling Equipment: CME 45 Track

Well Casing: PVC Schedule 40

Well Screen: PVC Schedule 40, Slot 10

OVM: Samples not screened

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
								Top of Pipe Elev. = 56.00m ASL
0						Ground Surface	56.09	
1	2 4 7 9	BH-05-810-1		54%	x x x x	SAND AND GRAVEL FILL moist, grey, med to fine sand and fine gravel		
2					x x x x			
3	11 7 4 5	BH-05-810-2		33%	x x x x		55.00	
4					x x x x			
5					x x x x			
6	5 19 18 11	BH-05-810-3		50%	x x x x		54.41	
7					x x x x		54.10	
8					x x x x			
9	3 3 2 4	BH-05-810-4		50%	x x x x	wet		
10					x x x x		53.00	
11	2 50 for 127 mm	BH-05-810-5		25%		BEDROCK		
12								
13							52.00	
14								
15								
16						End of borehole at 5.03m	51.16 51.06	
17								
18								
19								
20							50.00	

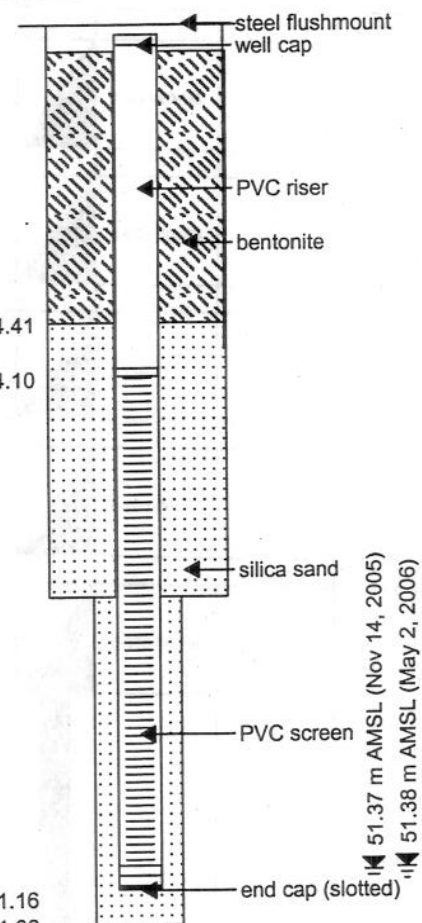

(1) Blow count per 0.15 m using conventional hammer and split spoons

HSA = Hollow Stem Auger
DTH = Down the hole Hammer

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.



Borehole/Monitoring Well ID: MW-05-813

Page 1 of 1

Project No.: 97-142H

Client: National Capital Commission

Location: LeBreton Flats, Ottawa

Date Completed: November 7, 2005

Site Datum: IB84 with geodetic elevation of 55.035 m AMSL

ATSI Supervisor: S.Dingee

Drilling Method: HSA/DTH

Borehole Diameter: 203 mm/102 mm

Monitoring Well Diameter: 51 mm

Drilling Company: Downing Drilling Ltd.


Drilling Equipment: CME 45 Track

Well Casing: PVC Schedule 40

Well Screen: PVC Schedule 40, Slot 10

OVM: Samples not screened

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	Top of Pipe Elev. = 55.60m ASL
0						Ground Surface	55.73	
1	4 7 18 30	BH-05-813-1		58%		SILTY CLAY FILL moist, grey/brown silty clay with some sand		
2						SAND AND GRAVEL FILL dry, grey, med. sand and fine gravel	55.00	
3	4 10 9 11	BH-05-813-2		33%		moist, brown, fine to coarse gravel @ 0.76 m		
4						SAND FILL moist, brown, fine sand, some medium gravel	54.00	
5	2 15 17 19	BH-05-813-3		83%		no gravel	53.60	
6						SILTY SAND FILL moist, clayey, some gravel	53.29	
7	8 11 9 11	BH-05-813-4		100%		BEDROCK	53.00	
8						SILTY SAND FILL moist, clayey, some gravel	52.00	
9	5 6 8 8	BH-05-813-5		67%		BEDROCK	51.00	
10						BEDROCK	50.35	
11						BEDROCK	50.24	
12						BEDROCK	50.00	
13						BEDROCK	50.00	
14						BEDROCK	50.00	
15						BEDROCK	50.00	
16						BEDROCK	50.00	
17						BEDROCK	50.00	
18						BEDROCK	50.00	
19						BEDROCK	50.00	
20						BEDROCK	50.00	

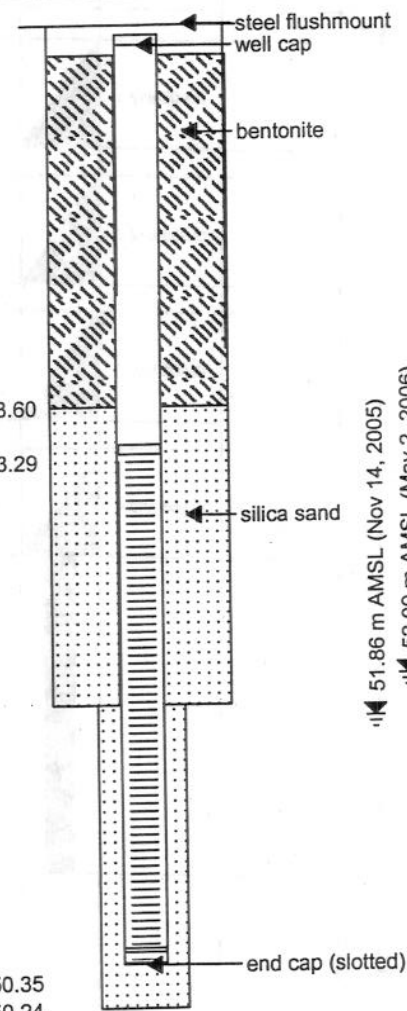

51.86 m AMSL (Nov 14, 2005)
52.09 m AMSL (May 2, 2006)

(1) Blow count per 0.15 m using conventional hammer and split spoons

HSA = Hollow Stem Auger
DTH = Down the hole Hammer

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.



Borehole/Monitoring Well ID: MW-05-819

Page 1 of 1

Project No.: 97-142H

Client: National Capital Commission

Location: LeBreton Flats, Ottawa

Date Completed: November 8, 2005

Site Datum: IB84 with geodetic elevation of 55.035 m AMSL

ATSI Supervisor: S.Dingee

Drilling Method: HSA/DTH

Borehole Diameter: 204 mm/102mm

Monitoring Well Diameter: 51 mm

Drilling Company: Downing Drilling Ltd.

Drilling Equipment: CME 45 Track

Well Casing: PVC Schedule 40

Well Screen: PVC Schedule 40, Slot 10

OVM: Samples not screened

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
						Ground Surface	52.60	Top of Pipe Elev. = 52.80m ASL
0	7	BH-05-819-1		71%		TOPSOIL moist, dark brown		
1	4					SILTY CLAY FILL moist, grey/brown, with sand	52.00	
2	7					SAND FILL moist, brown, med. to fine		
3	12	BH-05-819-2		25%		SHALE AND GRAVEL moist, grey/black shale and grey, coarse gravel		
4	7							
5	6					BOULDER FILL wet, grey/brown, clay infill	51.00	
6								
7								
8								
9								
10								
11								
12						End of borehole at 3.66m	49.00	
13								
14								
15								
16								
17								
18								
19								

(1) Blow count per 0.15 m using conventional hammer and split spoons

HSA = Hollow Stem Auger
DTH = Down the hole Hammer

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.



BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-6/MW06-6

MOE Well ID: A029553

Project Number: 05-215-20

Date Completed: June 20, 2006

Client: National Capital Commission

Supervisor: ADG/TLJ

Site Location: Municipal Lands

Ground Surface Elevation: 54.96 mASL

Coordinates: MTM NAD83 - 366010 E, 5030649 N

Drilling Method: Hollow stem auger with split spoon

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
ft m								
-4								
-3								
-2								
-1								
0							GROUND SURFACE	
0			4				FILL	
1			12	0			Topsoil near surface, underlain by dark brown silty sand fill with trace gravel. Dry, no odour.	
2			15					
3			20					
4								
5			5				Brown silt and sand fill with brick fragments and minor iron staining. Slightly moist, no odour.	
6			9	5				
7			10					
8			8					
9								
10			2				Brown silt and sand fill. Dry, no odour.	
11			4	5				
12			6				9 cm of black slag fill with rock fragments at 2.1 mBGS. Moist, no odour.	
13			18					
14								
15			7				Dark brown silt and sand fill with trace gravel and roots. Wet, no odour.	
16			11	0				
17			1					
18			5					
19								
20			5					
21			12	0				
22			6					
23			4					
24								
25								
26								
27								
28								
29								
30								
31								
32								
33								
34								
35								
36								
37								
38								
39								
40								
41								
42								
43								
44								
45								
46								
47								
48								
49								
50								
51								
52								
53								
54								
55								
56								
57								
58								
59								
60								
61								
62								
63								
64								
65								
66								
67								
68								
69								
70								
71								
72								
73								
74								
75								
76								
77								
78								
79								
80								
81								
82								
83								
84								
85								
86								
87								
88								
89								
90								
91								
92								
93								
94								
95								
96								
97								
98								
99								
100								

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-6/MW06-6

MOE Well ID: A029553

Project Number: 05-215-20

Date Completed: June 20, 2006

Client: National Capital Commission

Supervisor: ADG/TLJ

Site Location: Municipal Lands

Ground Surface Elevation: 54.96 mASL

Coordinates: MTM NAD83 - 366010 E, 5030649 N

Drilling Method: Hollow stem auger with split spoon

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
15							Borehole terminated at 4.6 mBGS.	
16							BOREHOLE TERMINATED	Depth of MW06-6 = 4.6 mBGS
17								
18								
19								
20								
21								
22								
23								
24								
25								
26								
27								
28								
29								
30								
31								
32								

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-7/MW06-7

MOE Well ID: A029553

Project Number: 05-215-20

Date Completed: June 20, 2006

Client: National Capital Commission

Supervisor: ADG/TLJ

Site Location: Municipal Lands

Ground Surface Elevation: 55.24 mASL

Coordinates: MTM NAD83 - 365882 E, 5030604 N

Drilling Method: Hollow stem auger with split spoon

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
ft m								
-4								
-3								
-2								
-1								
0							GROUND SURFACE	
0			3				FILL	
1			5				Brown topsoil.	
2			10	0			Grey/brown silt and sand fill with trace gravel.	
3			12				Slightly moist, no odour.	
4								
5			4					
6			10	0				
7			9					
8			7					
9								
10			3					
11			7				Brown silt and sand fill with black slag, brick and gravel. Slightly moist, no odour.	
12			13	10				
13			9					
14								
15			50	0			Dark brown silt and sand fill. Dry, no odour.	
16								
17			11					
18			18				Dark brown silt and sand fill with black slag fragments. Wet, no odour.	
19			18	0				
20			50					
21								
22			7				Grey and black sand with rock fragments.	
23			16	0				
24			23					
25			13					

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-7/MW06-7

MOE Well ID: A029553

Project Number: 05-215-20

Date Completed: June 20, 2006

Client: National Capital Commission


Supervisor: ADG/TLJ

Site Location: Municipal Lands

Ground Surface Elevation: 55.24 mASL

Coordinates: MTM NAD83 - 365882 E, 5030604 N

Drilling Method: Hollow stem auger with split spoon

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
15	II						Borehole terminated at 4.6 mBGS.	
16							BOREHOLE TERMINATED	Depth of MW06-7 = 4.6 mBGS
17								
18								
19								
20								
21								
22								
23								
24								
25								
26								
27								
28								
29								
30								
31								
32								

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-9/MW06-9

MOE Well ID: A029553

Project Number: 05-215-20

Date Completed: June 21, 2006

Client: National Capital Commission

Supervisor: ADG/SNG


Site Location: Municipal Lands

Ground Surface Elevation: 61.58 mASL

Coordinates: MTM NAD83 - 365843 E, 5030527N

Drilling Method: Hollow stem auger with split spoon

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
ft m								
-4								
-3								
-2								
-1								
0	0		9				GROUND SURFACE	
1			50	0			FILL Brown topsoil.	
2							Brown silty sand fill with organic material near surface. Dry, no odour.	
3	1		7	0			Brown silty sand fill with some clay and trace gravel. Moist, no odour.	
4			21					
5			15					
6			11					
7	2			2			Dark brown sand and gravel fill. Dry, no odour.	
8			7					
9			14				Brown silty sand fill with trace gravel. Dry, no odour.	
10			10	0				
11	3		6					
12			5					
13			7					
			10					
			10					
			8	3			Grey silt fill with some clay. Moist, no odour.	
			24					
			9					
			5					
							Black sand fill with some silt and gravel. Wet, landfill odour.	

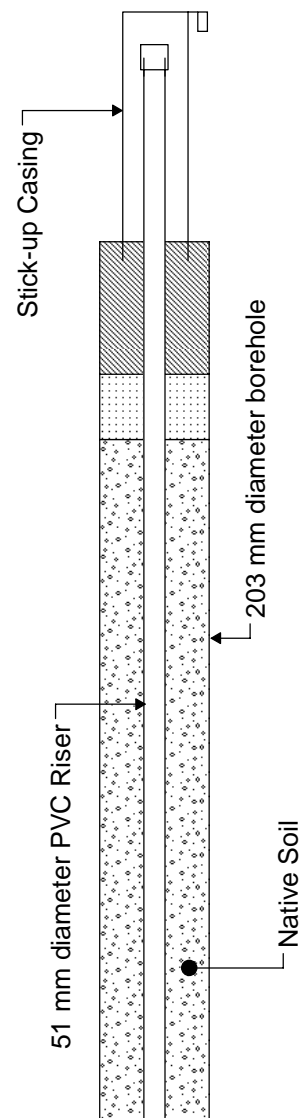

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-9/MW06-9

MOE Well ID: A029553

Project Number: 05-215-20

Date Completed: June 21, 2006

Client: National Capital Commission

Supervisor: ADG/SNG

Site Location: Municipal Lands

Ground Surface Elevation: 61.58 mASL

Coordinates: MTM NAD83 - 365843 E, 5030527N

Drilling Method: Hollow stem auger with split spoon

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
4			3	2				
14			4					
15			3					
16			4	2			Silty sand fill with some clay and wood fragments. Wet, no odour.	
17			4					
18			50				Boulder (no recovery)	
19								
20			50					
21								
22			46	4			Grey sand fill with some gravel. Slightly moist, landfill odour.	
23			20					
24			12					
25			50					
26								
27			25	3				
28			32					
29			43					
30			14					
31								
32			8	35			Minor brick fragments.	
33			6					
34			4					
35			8					
36								
37			15	25			Hydrocarbon odour.	
38			7					
39			5					
40			9					
41								
42								

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-9/MW06-9

MOE Well ID: A029553

Project Number: 05-215-20

Date Completed: June 21, 2006

Client: National Capital Commission




Supervisor: ADG/SNG

Site Location: Municipal Lands

Ground Surface Elevation: 61.58 mASL

Coordinates: MTM NAD83 - 365843 E, 5030527N

Drilling Method: Hollow stem auger with split spoon

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
31			2	50			Sandy fill with glass and paper debris. Wet, landfill odour.	
32			1				Borehole terminated at 9.8 mBGS.	
33	10						BOREHOLE TERMINATED	Depth of MW06-9 = 9.8 mBGS
34								
35								
36	11							
37								
38								
39	12							
40								
41								
42								
43	13							
44								
45								
46	14							
47								

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-10/MW06-10

MOE Well ID: A029553

Project Number: 05-215-20

Date Completed: June 21, 2006

Client: National Capital Commission

Supervisor: ADG

Site Location: LeBreton Flats

Ground Surface Elevation: 55.56 mASL

Coordinates: MTM NAD83 - 365965 E, 5030592 N

Drilling Method: Hollow stem auger with split spoon

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
ft m								
-4								
-3								
-2								
-1								
0							GROUND SURFACE	
0			6				FILL	
1			22	0			Brown sandy topsoil underlain by brown silt and sand fill with trace gravel and brick fragments. Dry, no odour.	
2			30					
3			38					
4								
5			19				Grey/brown silty sand fill with gravel and cobbles. Dry, no odour.	
6			48	0				
7			41					
8			36					
9								
10			5				Grey and black silty sand fill with gravel and wood debris. Dry, no odour.	
11			5	0				
12			12					
13			7					
14								
15								
16								
17								
18								
19								
20								
21								
22								
23								
24								
25								
26								
27								
28								
29								
30								
31								
32								
33								
34								
35								
36								
37								
38								
39								
40								
41								
42								
43								
44								
45								
46								
47								
48								
49								
50								
51								
52								
53								
54								
55								
56								
57								
58								
59								
60								
61								
62								
63								
64								
65								
66								
67								
68								
69								
70								
71								
72								
73								
74								
75								
76								
77								
78								
79								
80								
81								
82								
83								
84								
85								
86								
87								
88								
89								
90								
91								
92								
93								
94								
95								
96								
97								
98								
99								
100								

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-10/MW06-10

MOE Well ID: A029553

Project Number: 05-215-20

Date Completed: June 21, 2006

Client: National Capital Commission

Supervisor: ADG

Site Location: LeBreton Flats

Ground Surface Elevation: 55.56 mASL

Coordinates: MTM NAD83 - 365965 E, 5030592 N

Drilling Method: Hollow stem auger with split spoon

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
15								
16			23	0			Grey clay fill with trace silt and gravel. Wet.	
17			11					
18			3					
19			1					
20			3	0			SAND	
21			9				Grey sand fill with silt seams. Wet, no odour.	
22			14					
23			15				Borehole terminated at 6.1mBGS.	
24								
25								
26								
27								
28								
29								
30								
31								
32								

Depth of MW06-10 = 6.1 mBGS

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-11/MW06-11

MOE Well ID: A029553

Project Number: 05-215-20

Date Completed: June 21, 2006

Client: National Capital Commission

Supervisor: ADG


Site Location: Municipal Lands

Ground Surface Elevation: 56.80 mASL

Coordinates: MTM NAD83 - 365928 E, 5030683 N

Drilling Method: Hollow stem auger with split spoon

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
ft m								
-4								
-3								
-2								
-1								
0							GROUND SURFACE	
0			7				FILL	
1			11	0			Brown sand fill with gravel and brick. Dry, no odour.	
2			50					
3								
4			16					
5			14	0				
6			22					
7			27					
8								
9			1					
10			5	0				
11			5					
12			10					
13								
14			6					
			9	0				
			6					
			10					
			4				Brown sand fill with gravel and minor silt. 12 cm of rock fragments. Dry, no odour.	
			4	0				
			21					
			19					
			20	0			Brown sand and gravel fill. Dry, no odour.	
			50					

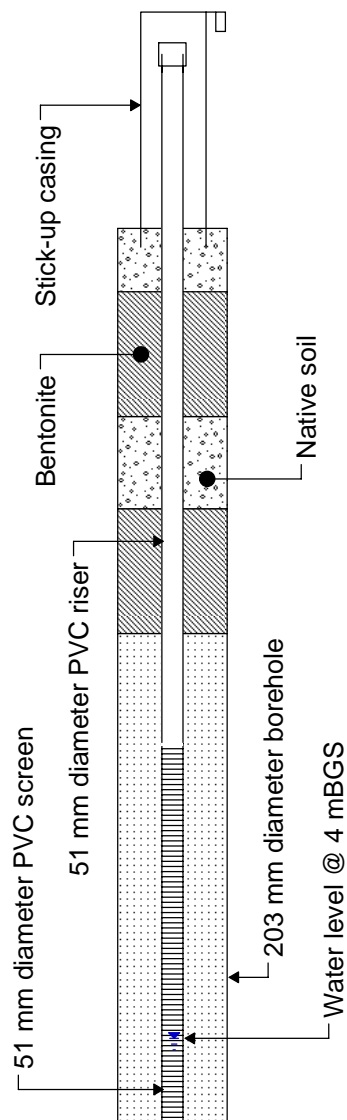

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-11/MW06-11

MOE Well ID: A029553

Project Number: 05-215-20

Date Completed: June 21, 2006

Client: National Capital Commission



Supervisor: ADG

Site Location: Municipal Lands

Ground Surface Elevation: 56.80 mASL

Coordinates: MTM NAD83 - 365928 E, 5030683 N

Drilling Method: Hollow stem auger with split spoon

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
15	5		1	0			Gravel fill with minor sand. Wet, no odour.	
16			9					
17			50					
18	6						Borehole terminated at 5.6 mBGS.	Depth of MW06-11 =5.6 mBGS
19								
20								
21	7						BOREHOLE TERMINATED	
22								
23								
24	8							
25								
26								
27	9							
28								
29								
30								
31								
32								

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH/MW06-35

MOE Well ID: A029553

Project Number: 05-215-23

Date Completed: August 2, 2006

Client: National Capital Commission

Supervisor: TLJ


Site Location: Southern LeBreton Flats

Ground Surface Elevation: 62.608 mASL

Coordinates: MTM NAD83 - 366650 E, 5030786 N

Drilling Method: Hollow stem auger with split spoons

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
ft m								
-4								
-3								
-2								
-1								
0	0		2				GROUND SURFACE	
1			4	0			FILL Brown topsoil underlain with brown silty sand fill. Dry, no odour.	
2			6					
3	1		5				Brown silty sand fill with gravel and bricks. Dry, no odour.	
4			8	40				
5			5				Brown to grey silty sand fill with clay and gravel. Slightly wet, no odour.	
6			5					
7	2		1					
8			2	30				
9			4				Brown and grey silty sand fill with gravel. Dry, no odour.	
10			3					
11	3		5					
12			10	20				
13			9					
14			12					
15			4				TILL Grey clayey silt till with gravel. Moist, no odour.	
16			10	30				
			9					
			8					
	4		2				Grey clayey silt till with gravel. Dry, no odour.	
		X	3	25			Fractured rock at 4.1 mBGS.	
			10					
			15					
			4					
			8	20			Grey clayey silt till with gravel. Moist, no odour.	

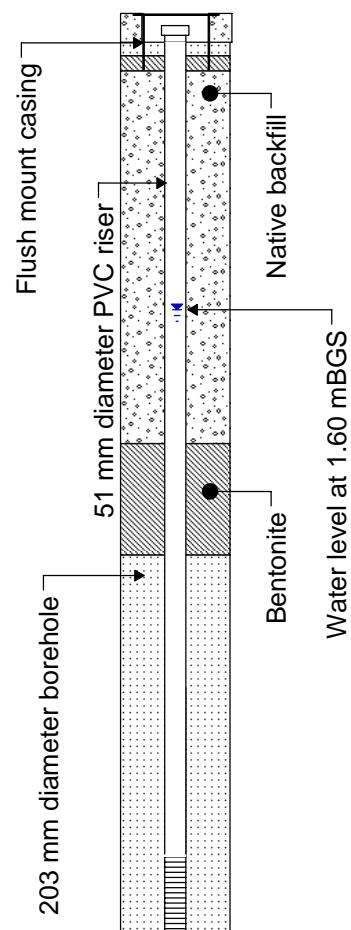

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH/MW06-35

MOE Well ID: A029553

Project Number: 05-215-23

Date Completed: August 2, 2006

Client: National Capital Commission

Supervisor: TLJ

Site Location: Southern LeBreton Flats

Ground Surface Elevation: 62.608 mASL

Coordinates: MTM NAD83 - 366650 E, 5030786 N

Drilling Method: Hollow stem auger with split spoons

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
5	1		50					
17								
18	1		50	20				
19								
20	6							
21	1		15	5			Grey till with gravel. Dry, no odour.	
22			30					
23	7		22	25			Grey sandy till with gravel. Dry, no odour.	
24			50					
25								
26	8		50	--				
27							Borehole terminated at 8.22 mBGS.	
28							BOREHOLE TERMINATED	
29								
30	9							
31								
32								
33	10							
34								
35								
36								

51 mm diameter PVC screen

Silica sand

Depth of MW06-35 = 8.22 mBGS

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH/MW06-36

MOE Well ID: A029553

Project Number: 05-215-23

Date Completed: August 3, 2006

Client: National Capital Commission

Supervisor: TLJ

Site Location: Southern LeBreton Flats

Ground Surface Elevation: 65.47 mASL

Coordinates: MTM NAD83 - 366710 E, 5030912 N

Drilling Method: Hollow stem auger with split spoons and air hammer

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
ft m								
-4								
-3								
-2								
-1								
0	0		12				GROUND SURFACE	
1			14	60			FILL Brown topsoil underlain by rock fragments and brown silty sand fill and gravel. Moist, no odour.	
2			21					
3			10					
4								
5	1		2				Brown and grey silty sand fill with gravel. Minor iron staining. Moist, no odour.	
6			5	70				
7			9					
8			7					
9								
10			2				Brown to grey silty sand fill with gravel. Moist, no odour.	
11		X	19	75				
12	2		18					
13			5					
14			8				Brown and grey silty sand fill with gravel. Moist, no odour.	
15			12					
16			15	55				
17			17					
18	3		10				Grey silty sand fill with clay and gravel. Moist, no odour.	
19			16	55				
20			50					
21								
22								
23								
24	4		50				Rock fragments at 3.78 mBGS.	
25				0				
26								
27								
28								
29								
30								
31								
32								
33								
34								
35								
36								
37								
38								
39								
40								
41								
42								
43								
44								
45								
46								
47								
48								
49								
50								
51								
52								
53								
54								
55								
56								
57								
58								
59								
60								
61								
62								
63								
64								
65								
66								
67								
68								
69								
70								
71								
72								
73								
74								
75								
76								
77								
78								
79								
80								
81								
82								
83								
84								
85								
86								
87								
88								
89								
90								
91								
92								
93								
94								
95								
96								
97								
98								
99								
100								
101								
102								
103								
104								
105								
106								
107								
108								
109								
110								
111								
112								
113								
114								
115								
116								
117								
118								
119								
120								
121								
122								
123								
124								
125								
126								
127								
128								
129								
130								
131								
132								
133								
134								
135								
136								
137								
138								
139								
140								
141								
142								
143								
144								
145								
146								
147								
148								
149								
150								
151								
152								
153								
154								
155								
156								
157								
158								
159								
160								
161								
162								
163								
164								
165								
166								
167								
168								
169								
170								
171								
172								
173								
174								
175								
176								
177								
178								
179								
180								
181								
182								
183								
184								
185								
186								
187								
188								
189								
190								
191								
192								
193								
194								
195								
196								
197								
198								
199								
200								
201								
202								
203								
204								
205								
206								
207								
208								
209								
210								
211								
212								
213								
214								
215								
216								
217								
218								
219								
220								
221								
222								
223								
224								
225								
226								
227								
228								
229								
230								
231								
232								
233								

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH/MW06-36

MOE Well ID: A029553

Project Number: 05-215-23

Date Completed: August 3, 2006

Client: National Capital Commission

Supervisor: TLJ

Site Location: Southern LeBreton Flats

Ground Surface Elevation: 65.47 mASL

Coordinates: MTM NAD83 - 366710 E, 5030912 N

Drilling Method: Hollow stem auger with split spoons and air hammer

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
5								
17								
18			11	60				
19			50					
20								
21			50	10				
22								
23			50	25				
24							Borehole terminated at 7.62 mBGS.	
25								
26							BOREHOLE TERMINATED	
27								
28								
29								
30								
31								
32								
33								
34								
35								
36								

51 mm diameter PVC screen

Silica sand

Depth of MW06-36 = 7.62 mBGS

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-37

MOE Well ID: Not applicable

Project Number: 05-215-23

Date Completed: August 3, 2006

Client: National Capital Commission

Supervisor: TLJ

Site Location: Southern LeBreton Flats

Ground Surface Elevation: 63.47 mBGS

Coordinates: MTM NAD83 - 366688 E, 5030854 N

Drilling Method: Hollow stem auger with split spoons

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
ft m								
-4								
-3								
-2								
-1								
0	0		2				GROUND SURFACE	No monitoring well installed
1		X	3	100			FILL Brown topsoil underlain by silty sand fill with black slag and ash. Minor iron staining. Moist, no odour.	
2			2					
3	1		2	70			Charcoal and ash with brown silty sand fill. Moist, no odour.	
4			3					
5			2					
6	2		4	75			Dark brown silty sand fill with gravel. Trace clay and minor iron staining. Dry, no odour.	
7			4					
8			5					
9			6					
10	3		8	75			Brown silty sand fill with gravel. Minor iron staining and ash, white and black sand. Moist, no odour.	
11			8					
12			6					
13	4		8					
14			1	60			Brown and grey silty sand fill with gravel. Wet, no odour.	
15			2					
16			2					
			3					
			1	50			Grey silty sand fill with gravel and trace clay. Wet, no odour.	
			2					
			1					
			3					
			1					
			3	50			TILL Grey sandy silt till with gravel.	

BOREHOLE STRATIGRAPHIC AND INSTRUMENTATION LOG

Borehole Number: BH06-37

MOE Well ID: Not applicable

Project Number: 05-215-23

Date Completed: August 3, 2006

Client: National Capital Commission

Supervisor: TLJ

Site Location: Southern LeBreton Flats

Ground Surface Elevation: 63.47 mBGS

Coordinates: MTM NAD83 - 366688 E, 5030854 N

Drilling Method: Hollow stem auger with split spoons

DEPTH BGS	SAMPLES	LAB SAMPLE	BLOW COUNT	CGI (ppm)	PID (ppm)	LOG	STRATIGRAPHIC DESCRIPTION	INSTALLATION
5	1		25					
17			36					
18	1		20	55				
19			50					
20	6							
21	1		50	50				
22								
23	7		36	50			Rock fragments at 6.8 mBGS.	
24			50				Borehole terminated at 7.2 mBGS on refusal.	
25							BOREHOLE TERMINATED	
26	8							
27								
28								
29								
30	9							
31								
32								
33	10							
34								
35								
36								



Borehole/Monitoring Well ID: BH/MW-06-103

Page 1 of 2

Project No.: 06-830

ATSI Supervisor: M. Nash

Drilling Company: Downing Drilling

Client: National Capital Commission

Drilling Method: Hollow Stem Auger

Drilling Equipment: CME 55 Truck Mount

Location: Nepean Bay, Ottawa, ON

Borehole Diameter: 203 mm

Well Casing: Stickup

Date Completed: July 19 & 20, 2006


Monitoring Well Diameter: 51 mm

Well Screen: PVC Schedule 40 Slot 10

Site Datum: Nail in tree on south side of Ottawa River Pkwy, Elevation = 62.621 masl

OVM: Gastech 1238 ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVM (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
									Elevation of top of PVC riser = 62.72 masl
-3 m									
-2 m									
-1 m									
0 m							Ground Surface	62.03	
1 m	6 9 12 15	BH-06-103-1		<25	58%		TOPSOIL	62.00	
2 m							FILL		
3 m	4 8 30 34	BH-06-103-2		45	71%		Dry, brown, sand and gravel, with coal, brick fragments, shale and wood	61.00	
4 m									
5 m	7 18 14 14	BH-06-103-3	◆	30	33%		Petroleum odour from 1.5 to 2.9 mbgs	60.00	
6 m									
7 m									
8 m	6 4 9 9	BH-06-103-4	◆	100	62%			60.00	
9 m									
10 m	1 3 7 17	BH-06-103-5		<25	8%			59.00	
11 m									
12 m									
13 m	12 10 11 13	BH-06-103-6		80	58%		Dry, grey, silty clay, with gravel, coal, brick fragments and wood	58.00	
14 m									
15 m	4 5 6 6	BH-06-103-7		90	71%			57.00	
16 m									
17 m									
18 m	3 5 9 4	BH-06-103-8		55	75%		Dry, grey, silty sand and gravel, with brick fragments and wood	56.00	
19 m									
20 m	20 20 7 4	BH-06-103-9		40	50%		Dry, brown to grey, clay and clayey sand with gravel, coal and brick fragments	55.00	
21 m									
22 m									
23 m	7 4 5 6	BH-06-103-10		40	50%		Moist to wet, grey, silty sandy clay and gravel	54.00	
24 m									
25 m									
26 m	3 4 50 for 51 mm	BH-06-103-11		<25	33%				
27 m									

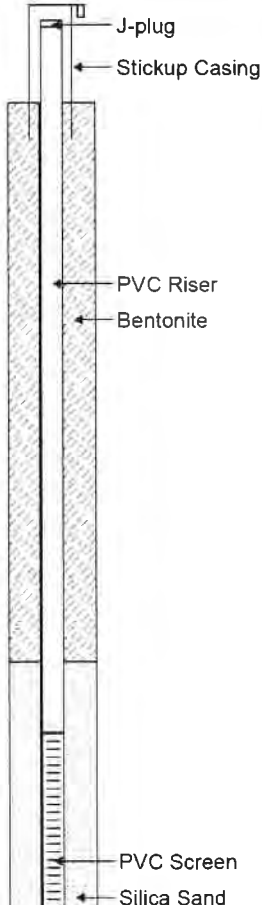

(1) Blow count per 0.15 m using conventional hammer and split spoons
(2) Organic Vapour Meter (OVM) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk

All elevations and locations are approximate

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.

◆ = Sample submitted for laboratory analysis

BH-06-103-3 = VOCs, F1-F4 PHCs, PHC Subfractions, PCBs
BH-06-103-4 = Metals, PAHs

Borehole/Monitoring Well ID: BH/MW-06-103

Page 2 of 2

Project No.: 06-830

Client: National Capital Commission

Location: Nepean Bay, Ottawa, ON

Date Completed: July 19 & 20, 2006

Site Datum: Nail in tree on south side of Ottawa River Pkwy, Elevation = 62.621 masl

ATSI Supervisor: M. Nash

Drilling Method: Hollow Stem Auger

Borehole Diameter: 203 mm

Monitoring Well Diameter: 51 mm

Drilling Company: Downing Drilling

Drilling Equipment: CME 55 Truck Mount

Well Casing: Stickup

Well Screen: PVC Schedule 40 Slot 10

OVM: Gastech 1238 ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVN (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)
28	29							
29	8	BH-06-103-12		<25	8%			
30	10							
31	20							
32	38	BH-06-103-13		200	71%		Mixed debris including wood, cloth, plastic, glass and newspaper	53.00
33	13							
34	11	BH-06-103-14		80	46%		Wet, wood, with some gravel and clay	52.00
35	8							
36	2	BH-06-103-15		<25	<4%			51.00
37	3							
38	4							
39	12	BH-06-103-16		<25	92%		SAND	
40	31						Wet, grey to black, medium to coarse grained, with boulder fragments	50.00
41	50 for 127 mm						End of borehole at 11.86 mbgs	
42								
43								
44								
45								
46								
47								
48								
49								
50								
51								
52								
53								
54								
55								
56								
57								

W 53.47 masl - 25-JUL-06

End Cap

(1) Blow count per 0.15 m using conventional hammer and split spoons
(2) Organic Vapour Meter (OVM) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.

◆ = Sample submitted for laboratory analysis



Borehole/Monitoring Well ID: BH/MW-06-104

Page 1 of 2

Project No.: 06-830

Client: National Capital Commission

Location: Nepean Bay, Ottawa, ON

Date Completed: July 19, 2006

Site Datum: Nail in tree on south side of Ottawa River Pkwy, Elevation = 62.621 masl

ATSI Supervisor: M. Nash

Drilling Method: Hollow Stem Auger

Borehole Diameter: 203 mm

Monitoring Well Diameter: 51 mm

Drilling Company: Downing Drilling

Drilling Equipment: CME 55 Truck Mount

Well Casing: Stickup

Well Screen: PVC Schedule 40 Slot 10

OVN: Gastech 1238 ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVN (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
									Elevation of top of PVC riser = 62.26 masl
-3 m									
-2 m									
-1 m									
0 m							Ground Surface	61.43	
1 m	4 10 24 20	BH-06-104-1		25	62%		TOPSOIL		
2 m							FILL	61.00	
3 m	16 19 24 32	BH-06-104-2		75	62%		Dry, dark brown, sand, with gravel and asphalt pieces		
4 m							Dry, light to dark brown, sand	60.00	
5 m	9 13 16 19	BH-06-104-3		80	96%		Dry, dark brown, sand, with gravel and shale		
6 m								59.00	
7 m									
8 m	10 15 9 8	BH-06-104-4		260	42%		Dry, dark brown, silty sand, with shale, gravel and pebbles, trace coal		
9 m									
10 m	7 7 5 2	BH-06-104-5		50	8%			58.00	
11 m									
12 m									
13 m	31 10 13 12	BH-06-104-6		150	46%		Dry, dark brown, sand, with dark grey clay and gravel		
14 m								57.00	
15 m									
16 m	44 50 for 51 mm	BH-06-104-7			<4%		Refusal on boulder		
17 m									
18 m	1 2 2 1	BH-06-104-8		100	8%		FILL	56.00	
19 m							Moist, black to brown, clayey sand, with gravel, glass, slag and wood		
20 m	1 2 1 3	BH-06-104-9		130	<4%		Gravel, concrete, brick fragments	55.00	
21 m							Wet, grey, clay, with gravel and mixed debris (cloth, glass, wood, paper, coal, plastic, concrete, newspaper)		
22 m	1 4 1 1	BH-06-104-10		100	58%			54.00	
23 m									
24 m									
25 m	1 11 6 7	BH-06-104-11		125	58%				
26 m									
27 m									

54 10 masl - 25-JUL-06



(1) Blow count per 0.15 m using conventional hammer and split spoons
(2) Organic Vapour Meter (OVN) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.

◆ = Sample submitted for laboratory analysis

BH-06-104-2 = Fraction Organic Carbon
BH-06-104-3 = Metals, PAHs
BH-06-104-4 = VOCs, F1-F4 PHCs
BH-06-104-10 = Grain Size, pH
BH-06-104-15 = Grain Size, pH



Borehole/Monitoring Well ID: BH/MW-06-104

Page 2 of 2

Project No.: 06-830

Client: National Capital Commission

Location: Nepean Bay, Ottawa, ON

Date Completed: July 19, 2006

Site Datum: Nail in tree on south side of Ottawa River Pkwy, Elevation = 62.621 masl

ATSI Supervisor: M. Nash

Drilling Method: Hollow Stem Auger

Borehole Diameter: 203 mm

Monitoring Well Diameter: 51 mm

Drilling Company: Downing Drilling


Drilling Equipment: CME 55 Truck Mount

Well Casing: Stickup

Well Screen: PVC Schedule 40 Slot 10

OVM: Gastech 1238 ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVM (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)
28	11	BH-06-104-12		<25	<4%			53.00
29	5							
30	7							
31	5	BH-06-104-13		110	29%			52.00
32	10							
33	4							
34	3	BH-06-104-14		30	4%		Wet, gravel, brick fragments, newspaper	51.00
35	6							
36	12							
37	18	BH-06-104-15		85	83%		SAND Wet, grey, medium to fine grained End of borehole at 11 28 mbgs	50.00
38	9							
39	12							
40	6							49.00
41	3							
42								48.00
43								
44								47.00
45								
46								46.00
47								
48								45.00
49								
50								
51								
52								
53								
54								
55								
56								
57								

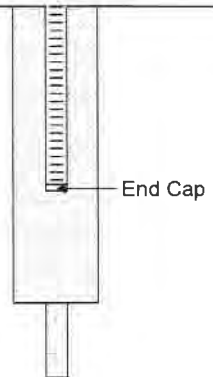

- (1) Blow count per 0.15 m using conventional hammer and split spoons
- (2) Organic Vapour Meter (OVM) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.

◆ = Sample submitted for laboratory analysis

BH-06-104-2 = Fraction Organic Carbon
 BH-06-104-3 = Metals, PAHs
 BH-06-104-4 = VOCs, F1-F4 PHCs
 BH-06-104-10 = Grain Size, pH
 BH-06-104-15 = Grain Size, pH

Project No.: 06-830

ATSI Supervisor: M. Nash

Drilling Company: Downing Drilling

Client: National Capital Commission

Drilling Method: Hollow Stem Auger

Drilling Equipment: CME 55 Truck Mount

Location: Nepean Bay, Ottawa, ON

Borehole Diameter: 203 mm

Well Casing: Flushmount

Date Completed: July 18, 2006


Monitoring Well Diameter: 51 mm

Well Screen: PVC Schedule 40 Slot 10

Site Datum: Nail in tree on south side of Ottawa River Pkwy, Elevation = 62.621 masl

OVM: Gastech 1238 ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVM (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
							Ground Surface	58.28	Elevation of top of PVC riser = 58.28 masl
0	5						TOPSOIL		
1	10						FILL		
2	8	BH-06-105-1		<25	75%		Moist, brown, clayey silty sand, with gravel and trace coals		
3	4						Dry, gravel		
4	33								
5	34	BH-06-105-2		<25	25%				
6	39								
7	15								
8	50 for 152 mm	BH-06-105-3		<25	<4%				
9									
10	12						Brick fragments from 2.3 to 2.9 mbgs		
11	9								
12	3	BH-06-105-4		<25	12%				
13	2								
14	5						Moist, black, sand, with gravel and brick fragments		
15	7								
16	11	BH-06-105-5		40	12%				
17	50 for 102 mm								
18	3						Moist, black, sand, with coal, ash, slag and iron ore		
19	4								
20	4	BH-06-105-6		90	54%				
21	3								
22	2								
23	1	BH-06-105-7A		50	50%				
24	2								
25	2	BH-06-105-7B		<25	50%		Granular black and orange material with slag and coal		
26	2								
27	1						Wet, black to brown, sand, some silt and coal		
28	1								
29	11								
30	13	BH-06-105-9		30	54%		SAND		
31	20						Wet, grey, medium to coarse grained		
32	14								
33	28								
34	27								
35	22	BH-06-105-10		30					
36	14								
37							End of borehole at 7.62 mbgs		
38									
39									
40									
41									
42									
43									
44									
45									
46									
47									
48									
49									
50									

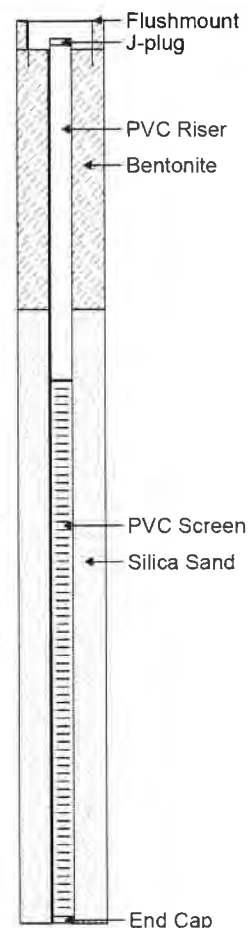

(1) Blow count per 0.15 m using conventional hammer and split spoons
(2) Organic Vapour Meter (OVM) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.

◆ = Sample submitted for laboratory analysis

BH-06-105-6 = VOCs, F1-F4 PHCs, PAHs

BH-06-105-7A = Metals

Project No.: 06-830

ATSI Supervisor: M. Nash

Drilling Company: Downing Drilling

Client: National Capital Commission

Drilling Method: HSA / HQ Coring

Drilling Equipment: CME 55 Truck Mount

Location: Nepean Bay, Ottawa, ON

Borehole Diameter: 203 mm / 96 mm

Well Casing: Stickup

Date Completed: July 18 & 19, 2006


Monitoring Well Diameter: 51 mm

Well Screen: PVC Schedule 40 Slot 10

Site Datum: Nail in tree on south side of Ottawa River Pkwy, Elevation = 62.621 masl

OVM: Gastech 1238 ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVM (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
									Elevation of top of PVC riser = 63.08 masl
-3									
-2									
-1									
0							Ground Surface	62.17	
1	11 16 12 11	BH-06-107-1		<25	71%		TOPSOIL	62.00	
2							FILL		
3	2 3 3	BH-06-107-2		30	25%		Dry to moist, dark brown, sand, with gravel, coal, ash, slag, shale and glass	61.00	
4									
5	1 1 1	BH-06-107-3		125	17%			60.00	
6									
7	3 6 8 6	BH-06-107-4		80	4%		Asphalt pieces, asphalt paper and plastic	59.00	
8									
9	3 3 2 4	BH-06-107-5		110	17%		Moist, black, silty clayey sand, with gravel, coal, cinders, brick fragments, wood, glass, rubber, metal and plastic	58.00	
10									
11	2 1 1 3	BH-06-107-6		80	62%			57.00	
12									
13	2 2 2 5	BH-06-107-7		90	25%			56.00	
14									
15	2 4 4 5	BH-06-107-8		130	46%			55.00	
16									
17									
18									
19									
20									
21							Refusal on boulder	54.00	
22									
23	23 20 11 50 for 25 mm	BH-06-107-10		35	29%		FILL		
24							Moist, black, clayey sand, with gravel, wood and cinders.		
25							Refusal on boulders		
26	10 23 40 50 for 102 mm	BH-06-107-11		25	4%				
27									

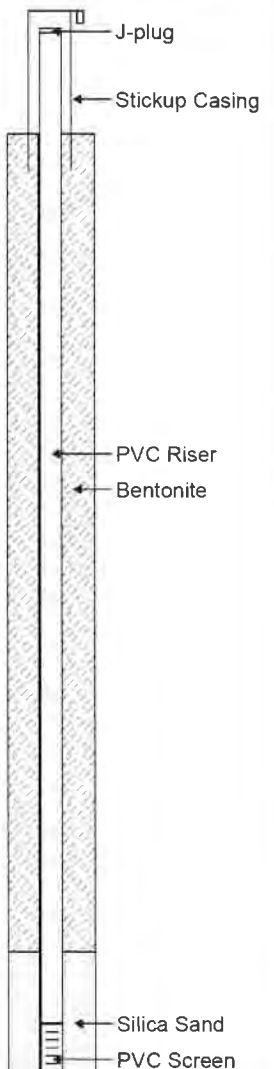

(1) Blow count per 0.15 m using conventional hammer and split spoons
(2) Organic Vapour Meter (OVM) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.

◆ = Sample submitted for laboratory analysis

BH-06-107-3 = Grain Size, pH

BH-06-107-8 = VOCs, F1-F4 PHCs, Metals, PAHs



Borehole/Monitoring Well ID: BH/MW-06-107

Page 2 of 2

Project No.: 06-830

ATSI Supervisor: M. Nash

Drilling Company: Downing Drilling

Client: National Capital Commission

Drilling Method: HSA / HQ Coring

Drilling Equipment: CME 55 Truck Mount

Location: Nepean Bay, Ottawa, ON

Borehole Diameter: 203 mm / 96 mm

Well Casing: Stickup

Date Completed: July 18 & 19, 2006

Monitoring Well Diameter: 51 mm

Well Screen: PVC Schedule 40 Slot 10

Site Datum: Nail in tree on south side of Ottawa River Pkwy, Elevation = 62.621 masl

OVM: Gastech 1238 ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVM (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
28									
29	9						BOULDERS With seams of sand and gravel	53.00	
30									
31									
32									
33	10							52.00	
34									
35							End of borehole at 10.67 mbgs		
36	11							51.00	
37									
38									
39	12							50.00	
40									
41									
42	13							49.00	
43									
44									
45	14							48.00	
46									
47									
48									
49	15							47.00	
50									
51									
52	16							46.00	
53									
54									
55	17							45.00	
56									
57									

52.92 masl - 25-JUL-06

End Cap

(1) Blow count per 0.15 m using conventional hammer and split spoons
(2) Organic Vapour Meter (OVM) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.

= Sample submitted for laboratory analysis

BH-06-107-3 = Grain Size, pH

BH-06-107-8 = VOCs, F1-F4 PHCs, Metals, PAHs

Project No.: 06-830

Client: National Capital Commission

Location: Nepean Bay, Ottawa, ON

Date Completed: July 19, 2006

Site Datum: Nail in tree on south side of Ottawa River Pkwy, Elevation = 62.621 masl

ATSI Supervisor: M. Nash

Drilling Method: Hollow Stem Auger

Borehole Diameter: 203 mm

Monitoring Well Diameter: 51 mm

Drilling Company: Downing Drilling


Drilling Equipment: CME 55 Truck Mount

Well Casing: Flushmount

Well Screen: PVC Schedule 40 Slot 10

OVM: Gastech 1238 ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVM (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
							Ground Surface	56.22	Elevation of top of PVC riser = 56.20 masl
0	4	BH-06-108-1		<25	67%		TOPSOIL		
1	6						FILL		
2	9						Dry, brown to black, sand, with gravel and coal fragments		
3	1	BH-06-108-2		<25	8%		Moist, grey to black, clayey sand and gravel, with slag, glass, plastic, brick fragments and wood	55.00	
4	50 for 127 mm								
5	6			80	54%			54.00	
6	9	BH-06-108-3							
7	11			180	8%			53.00	
8	6	BH-06-108-4							
9	4			275	54%		Moist, dark grey clay with glass		
10	3	BH-06-108-5					Moist to wet, mixed refuse (newspaper, plastic, aluminum sheeting, glass, wood)	52.00	
11	3			<25	4%		Wet, grey, clay, refusal on boulder		
12	6	BH-06-108-6					Wet, grey, sand, medium to coarse grained	51.00	
13	6			<25	75%				
14	50 for 25 mm							50.00	
15	18	BH-06-108-7							
16	6								
17	3	BH-06-108-8							
18	4			<25	46%				
19	2								
20	3								
21	2								
22							PEAT		
23							With wood and sea shells		
24							End of borehole at 6.10 mbgs		
25									
26									
27									
28									
29									
30									

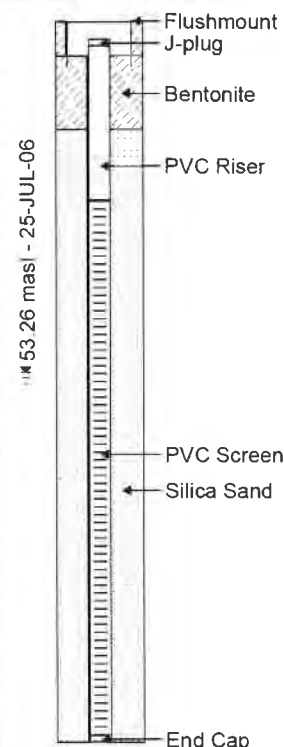

(1) Blow count per 0.15 m using conventional hammer and split spoons
(2) Organic Vapour Meter (OVM) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling

◆ = Sample submitted for laboratory analysis

BH-06-108-3 = Metals, PAHs

BH-06-108-5 = VOCs, F1-F4 PHCs

MOE Well Tag A033435

Project No.: 06-830

ATSI Supervisor: M. Nash

Drilling Company: Downing Drilling

Client: National Capital Commission

Drilling Method: Hollow Stem Auger

Drilling Equipment: CME 55 Truck Mount

Location: Nepean Bay, Ottawa, ON

Borehole Diameter: 203 mm

Well Casing: Stickup

Date Completed: July 20 & 21, 2006

Monitoring Well Diameter: 51 mm

Well Screen: PVC Schedule 40 Slot 10

Site Datum: Nail in tree on south side of Ottawa River Pkwy, Elevation = 62.621 masl

OVM: Gastech 1238 ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVM (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
									Elevation of top of PVC riser = 64.38 masl
0							Ground Surface	63.43	
1	5 6 11 9	BH-06-109-1		<25	62%		TOPSOIL	63.00	
2							FILL		
3	1 2 3 1	BH-06-109-2		50	29%		Dry, brown, sand, with gravel, coal, glass, brick fragments and wood	62.00	
4									
5	1 1 1 2	BH-06-109-3		25	29%		Moist, dark grey, clayey sand, with coal, glass, brick fragments and creosote coated wood	61.00	
6									
7	3 3 5 4	BH-06-109-4		25	29%		Moist, brown to black, silty sand, with gravel, coal, glass and brick fragments	60.00	
8									
9	2 5 4 3	BH-06-109-5		180	21%			59.00	
10									
11	1 2 2 3	BH-06-109-6		140	46%			58.00	
12									
13							Undisturbed sample collected in shelly tube	57.00	
14		BH-06-109-7							
15									
16	4 50 for 127 mm	BH-06-109-8		<25	21%		FILL	56.00	
17							Dry, black, silty clayey sand, with wood and glass		
18	39 50 for 76 mm	BH-06-109-9		<25	17%		5 cm wood, 5 cm boulder fragments		
19									
20	14 19 9 6	BH-06-109-10		<25	8%		2.5 cm brown/grey clayey sand and gravel with brick fragments, 2.5 cm of wood and boulder fragments		
21									
22	9 8 11 14	BH-06-109-11		<25	92%		Moist to wet, grey sand		
23									
24									
25									
26									
27									

(1) Blow count per 0.15 m using conventional hammer and split spoons
(2) Organic Vapour Meter (OVM) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.

◆ = Sample submitted for laboratory analysis

BH-06-109-3 = PAHs
BH-06-109-5 = VOCs, F1-F4 PHCs
BH-06-109-7 = Bulk Soil Physical Properties
BH-06-109-12 = Metals, PAHs

Project No.: 06-830

ATSI Supervisor: M. Nash

Drilling Company: Downing Drilling

Client: National Capital Commission

Drilling Method: Hollow Stem Auger

Drilling Equipment: CME 55 Truck Mount

Location: Nepean Bay, Ottawa, ON

Borehole Diameter: 203 mm

Well Casing: Stickup






Date Completed: July 20 & 21, 2006

Monitoring Well Diameter: 51 mm

Well Screen: PVC Schedule 40 Slot 10

Site Datum: Nail in tree on south side of Ottawa River Pkwy, Elevation = 62.621 masl

OVM: Gastech 1238 ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVM (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
28	5	BH-06-109-12		75	100%		Moist, dark brown to black, silty sand, with coal and brick fragments	55.00	<div>  <p>End Cap</p> </div> <div> <p>DRY - 25/JUL/2006</p> </div>
29	18								
30	40								
31	50 for 102 mm	BH-06-109-13		<25	8%		Moist, brown, sand	54.00	
32	50 for 51 mm								
33							2.5 cm wood, 2.5 cm boulder		
34							End of borehole at 9.20 mbgs		
35									
36									
37									
38									
39									
40									
41									
42									
43									
44									
45									
46									
47									
48									
49									
50									
51									
52									
53									
54									
55									
56									
57									

(1) Blow count per 0.15 m using conventional hammer and split spoons
(2) Organic Vapour Meter (OVM) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.

◆ = Sample submitted for laboratory analysis

BH-06-109-3 = PAHs
BH-06-109-5 = VOCs, F1-F4 PHCs
BH-06-109-7 = Bulk Soil Physical Properties
BH-06-109-12 = Metals, PAHs

Project No.: 06-830

Client: National Capital Commission

Location: Nepean Bay, Ottawa, ON

Date Completed: July 21, 2006

Site Datum: Nail in tree on south side of Ottawa River Pkwy, Elevation = 62.621 masl

ATSI Supervisor: M. Nash

Drilling Method: Hollow Stem Auger

Borehole Diameter: 203 mm

Monitoring Well Diameter: 51 mm

Drilling Company: Downing Drilling

Drilling Equipment: CME 55 Truck Mount

Well Casing: Stickup

Well Screen: PVC Schedule 40 Slot 10

OVM: Gastech 1238 ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVM (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
									Elevation of top of PVC riser = 60.61 masl
ft m									
-2									
-1									
0							Ground Surface	60.03	
1	6 7 5 3	BH-06-110-1		<25	46%		TOPSOIL	60.00	
2							FILL		
3							Dry, brown silty sand, with coal, brick fragments and wood		
4		BH-06-110-2					Undisturbed sample collected in shelly tube	59.00	
5							FILL		
6	3 4 11 12	BH-06-110-3		50	50%		Dry to moist, brown sand, with coal and boulder fragments	58.00	
7									
8	3 5 50 for 102 mm	BH-06-110-4		45	29%		Wet, grey clayey silty sand, with gravel, coal, wood and slag		
9									
10	13 11 8 7	BH-06-110-5		180	54%			57.00	
11									
12									
13	2 1 6 3	BH-06-110-6		175	42%			56.00	
14									
15	5 4 4 3	BH-06-110-7		50	4%			55.00	
16									
17	3 10 16 20	BH-06-110-8		150	67%			54.00	
18									
19	13 11 7 6	BH-06-110-9		400	42%			53.00	
20									
21									
22	8 8 14 10	BH-06-110-10		50	33%		Wet, black sand, with mixed refuse (wood, paper, glass and plastic)		
23									
24	3 50 for 51 mm	BH-06-110-11		75	4%		Wet, grey sand, with wood	52.00	
25							End of borehole at 8.41 mbgs		
26									
27									

#53 28 masl - 25/JUL/2006



(1) Blow count per 0.15 m using conventional hammer and split spoons
(2) Organic Vapour Meter (OVM) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.

◆ = Sample submitted for laboratory analysis

BH-06-110-2 = Bulk Soil Physical Properties

BH-06-110-8 = Metals, PAHs

BH-06-110-9 = VOCs, F1-F4 PHCs

Project No.: 97-142H

ATSI Supervisor: Andrey Belokurov

Drilling Company: Downing Drilling Ltd.

Client: National Capital Commission

Drilling Method: HSA/Air Hammer

Drilling Equipment: CME 55 Truck

Location: LeBreton Flats, Ottawa

Borehole Diameter: 203 mm

Well Casing: PVC Schedule 40

Date Completed: November 8, 2006

Monitoring Well Diameter: 51 mm

Well Screen: PVC Schedule 40, Slot 10

Site Datum: IB84 with geodetic elevation of 55.035 m AMSL

OVM: Gastech 1238ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVN (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	Top of Pipe Elev. = 56.97 m ASL
0							Ground Surface	57.03	
1	2	BH-06-901-1		75	79%		TOPSOIL moist, black		
2	5						SAND AND GRAVEL (FILL) Dry, grey, compact to dense coarse-grained sand, gravel and some cobbles.		
3	7	BH-06-901-2		25	62%			56.00	
4	11								
5	10								
6	2	BH-06-901-3		25	88%				
7	9								
8	12	BH-06-901-4		50	92%			55.00	
9	22								
10	27						From 2.4 to 3.8 m bgs - moist, grey, dense gravel with some sand and silt		
11	25								
12	5	BH-06-901-5		75	88%			54.00	
13	19								
14	30								
15	34								
16	7	BH-06-901-6		75	83%			53.53	
17	11								
18	13								
19	15								
20	4	BH-06-901-7		75	67%		SILT (FILL) Moist, grey, grey/light green, stiff silt, some coarse grey sand.	53.00	
21	4								
22	4								
23	7								
24	11								
25	4	BH-06-901-8		50	100%		SAND AND GRAVEL (FILL) Moist to very wet, grey/brown, compact, coarse gravel with sand and cobbles.	52.92	
26	5								
27	9	BH-06-901-9		5%	67%			52.00	
28	12								
29	10								
30	13								
31	4	BH-06-901-10		50	29%		From 5.5 to 8.5 m bgs - Water	51.00	
32	5								
33	7								
34	7								

(1) Blow count per 0.15 m using conventional hammer and split spoons
(2) Organic Vapour Meter (OVM) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well recorded under MOE Well Tag A045175

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.

ATSI BH / MW IO

Project No.: 97-142H

ATSI Supervisor: A. Scheepers

Drilling Company: Downing

Client: National Capital Commission

Drilling Method: HSA/Air Hammer

Drilling Equipment: CME 75 Truck

Location: LeBreton Flats, Ottawa

Borehole Diameter: 203 mm/96 mm

Well Casing: PVC Stickup

Date Completed: May 7, 2008


Monitoring Well Diameter: 51 mm

Well Screen: PVC Schedule 40, Slot 10

Site Datum: IB84 with geodetic elevation of 55.035m amsl

OVM: Gastech 1238 ME

DEPTH	BLOW COUNT (1)	SAMPLE ID	LOCATION	OVM (2)	RECOVERY (%)	GRAPHIC LOG	DESCRIPTION	ELEVATION (m)	
									Top of PVC Elev = 57.57 m amsl
ft m									
-4									
-3									
-2									
-1									
0							Ground Surface	57.00	
0	6							56.56	
1	8	BH-08-001-1		25	58		SAND AND GRAVEL FILL		
2	9						Moist, brown, compact, medium		
3	10						dark brown		
4	5	BH-08-001-2		25	46				
5	2								
6	7	BH-08-001-3		50	67				
7	8								
8	6								
9	12	BH-08-001-4							
10	16			25	86				
11	24						wet		
12	50 for 51 mm	BH-08-001-5		25	38				
13	11								
14	13	BH-08-001-6		25	37				
15	16								
16	31	BH-08-001-7		25	NR				
17	14								
18	13								
19	14								
20	50 for 25mm								
21									
22	50 for 0 mm								
23									
24									
25									
26									

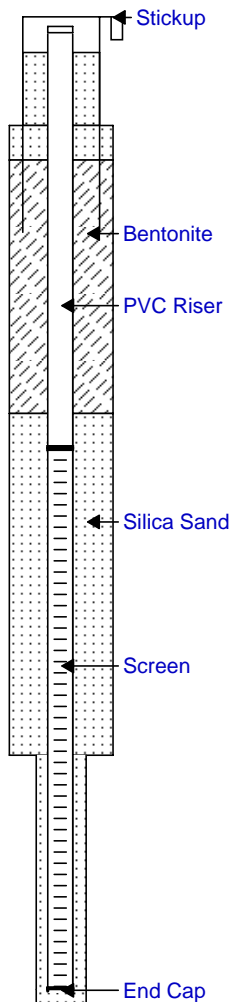

Vertical text label: 51.58 m amsl - May 13, 2008

(1) Blow count per 0.15 m using conventional hammer and split spoons
(2) Organic Vapour Meter (OVM) reading (ppmv unless noted)

The data represented in this borehole log requires interpretation by Aqua Terre personnel. Third parties using this log do so at their own risk.

All elevations and locations are approximate.

Monitoring well equipped with dedicated inertial foot valve and polyethylene tubing for sampling.

◆ = Sample submitted for laboratory analysis

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-01

SHEET 1 OF 2

LOCATION: See Site Plan

BORING DATE: March 17, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		Headspace Org. Vapour Conc. [PPM] ppm				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] ppm				WATER CONTENT PERCENT					
								6	12	18	24	Wp ——— W ——— Wi					
												10 ⁻⁶	10 ⁻⁵	10 ⁻⁴			10 ⁻³
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		58.26													
		TOPSOIL		58.11													
		Compact brown to dark brown silty sand, some gravel, trace clay with brick and concrete (FILL)		0.15	1	50 DO	16	⊕									
1				2	50 DO	21	⊕										
				3	50 DO	21	⊕										
2				4	50 DO	19	⊕										
		Very loose black sand, some gravel (FILL)		55.82													
				2.44													
		Loose grey brown silty clay, trace brick (FILL)		55.52	5	50 DO	2	⊕									
				2.74													
3		Loose to compact grey SILTY SAND, some gravel, trace clay		54.91	6	50 DO	15	⊕									
					3.35												
4				7	50 DO	12	⊕										
				8	50 DO	5	⊕										
5					9	50 DO	5	⊕									
					10	50 DO	1	⊕									
6		Compact brown fine SAND		52.16													
				6.10	11	50 DO	16	⊕									
	Compact grey fine SAND		51.55														
7				6.71	12	50 DO	13	⊕									
	Very dense grey SILTY SAND, some gravel, trace clay		50.64														
				7.62	13	50 DO	64	⊕									
8																	
	COBBLES and BOULDERS		49.75	14	50 DO	50	⊕										
				8.51	15	NQ RC	DD										
9					16	NQ RC	DD										
					17	DD											
10		CONTINUED NEXT PAGE															

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-01

SHEET 2 OF 2



LOCATION: See Site Plan

BORING DATE: March 17, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		Headspace Org. Vapour Conc. [PPM] \oplus				HYDRAULIC CONDUCTIVITY, k , cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	Headspace Comb. Vapour Conc. [%LEL] \square				WATER CONTENT PERCENT					
											Wp ——— W ——— WI					
10	Rotary Drill NW Casing	COBBLES and BOULDERS (continued)			17	NQ RC	DD									
					18	NQ RC	DD									
11	Rotary Drill NQ Core	Fresh grey LIMESTONE BEDROCK with interbedded shale		47.26 11.00	19	NQ RC	DD	T.C.R. (%) 100	S.C.R. (%) 86	R.Q.D. (%) 94						
12		End of Borehole		46.37 11.89												
13																
14																
15																
16																
17																
18																
19																
20																

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-02

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 16, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		Headspace Org. Vapour Conc. [PPM] ppm				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	6 12 18 24				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
								Headspace Comb. Vapour Conc. [%LEL] ppm				WATER CONTENT PERCENT					
								20 40 60 80				10 20 30 40					
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		57.54													
		Black sandy silt with organic matter (TOPSOIL)		57.39													
		Compact brown silty sand, some gravel, trace clay with cobbles and boulders (FILL)		0.15	1	50 DO	16										
1					2	50 DO	55										
					3	50 DO	8										
2					4	50 DO	8										
					5	50 DO	13										
3		Compact black sand, some gravel, trace silt (FILL)		54.80													
				2.74													
		Compact brown silty clay and brown silty sand layers (FILL)		54.49	6	50 DO	22										
				3.05													
4					7	50 DO	20										
		PEAT		53.27	8	50 DO	8										
		Loose grey SILTY fine SAND, trace gravel		4.34													
5					9	50 DO	6										
				10	50 DO	4											
6				11	50 DO	1											
				12	50 DO	3											
7	Loose rusty fine SAND, trace gravel		50.83														
	Loose grey SANDY SILT		50.68														
	Loose to dense brown coarse SAND		50.53														
			7.01														
				13	50 DO	1											
8				14	50 DO	73											
				15	50 DO	65											
	Very dense grey SANDY SILT, some gravel, trace clay		49.34														
			8.20														
9	End of Borehole Auger Refusal		48.80														
			8.74														
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-03

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 9, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		Headspace Org. Vapour Conc. [PPM] \oplus				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] \square				WATER CONTENT PERCENT					
								ppm				Wp — W — Wi					
								6	12	18	24	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴			10 ⁻³
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		57.06													
		Loose black silty clay with organic matter (FILL)		0.00	1	50 DO	13 \oplus										
		Brick (FILL)		56.60													
		Compact brown sand, some gravel, trace clay with some brick and concrete (FILL)		56.45	2	50 DO	21 \oplus										
1				55.84													
		Very dense to compact brown to dark grey sandy silt with cobbles and organic matter (FILL)		1.22	3	50 DO	70 \oplus										
2																	
				54.62	4	50 DO	14 \oplus										
		Compact black sand, some gravel, trace silt (FILL)		2.44													
		Compact, brown, medium to coarse sand (FILL)		54.32	5	50 DO	15 \oplus										
3				2.74													
		Compact black sand, some gravel, trace silt (FILL)		53.71	6	50 DO	13 \oplus										
			53.40														
	Compact, brown, medium to coarse sand (FILL)		3.66	7	50 DO	14 \oplus											
4			52.79														
	Compact grey sand and gravel (FILL)		4.27														
			52.39	8	50 DO	18 \oplus											
	PEAT		52.28														
	Compact grey SILTY CLAY																
5		Compact grey fine SAND		4.88													
			51.73	9	50 DO	18 \oplus											
	Compact grey SILTY SAND, some gravel, trace clay		5.33														
6			50.96														
	Loose to compact, brown, medium to coarse SAND		6.10	11	50 DO	5 \oplus											
7																	
			49.74	12	50 DO	16 \oplus											
			7.32														
	End of Borehole																
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-04

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 8, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			Headspace Org. Vapour Conc. [PPM] \oplus				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] \square				WATER CONTENT PERCENT					
								ppm				Wp — W — Wi					
								6	12	18	24	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		56.57													
		Black sandy silt with organic matter (TOPSOIL)		56.42													
		Dense grey brown silty sand, some gravel (FILL)		0.15	1	50 DO	45 \oplus										
		Compact black sandy silt, some gravel (FILL)		55.99													
				0.58													
1				55.35	2	50 DO	21 \oplus										
				1.22													
		Loose brown silty sand, some gravel (FILL)		54.82	3	50 DO	7 \oplus										
				1.75													
2			Loose to dense black sandy silt, some gravel (FILL)		54.44	4	50 DO	47 \oplus									
			2.13														
		Compact, brown, medium to coarse sand, some gravel (FILL)															
				5	50 DO	13 \oplus											
			53.06	6	50 DO	16 \oplus											
		Stiff grey silty clay (FILL)		3.51													
4				7	50 DO	5 \oplus											
				8	50 DO	5 \oplus											
5		PEAT		51.77													
		Stiff grey SILTY CLAY		4.88													
				51.39	9	50 DO	13 \oplus										
		Compact grey SANDY SILT, some gravel		5.18													
				51.08													
		Compact grey fine SAND		5.49													
				50.65	10	50 DO	17 \oplus										
6		End of Borehole Auger Refusal		5.92													
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-05

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 10, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		Headspace Org. Vapour Conc. [PPM] \oplus				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] \square				WATER CONTENT PERCENT					
								ppm				Wp — \bigcirc W — WI					
								6	12	18	24	10^{-6}	10^{-5}	10^{-4}	10^{-3}		
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		55.61													
		Compact to dense black silty sand, some gravel, trace brick with cobbles and boulders (FILL)		0.00	1	50 DO	25 \oplus										
1					2	50 DO	42 \oplus										
			Dense grey brown sand, trace silt with cobbles and boulders (FILL)		54.39	3	50 DO	36 \oplus									
2						4	50 DO	42 \oplus									
		Compact dark brown sandy silt, some gravel (FILL)		53.17	5	50 DO	18 \oplus										
3					52.59	6	50 DO	8 \oplus									
		Loose black sandy silt, some gravel, trace wood (FILL)		3.02	7	50 DO	6 \oplus										
4				51.95	8	NQ RC	DD	69	17	17							
	Rotary Drill NQ Core	Grey LIMESTONE BEDROCK with interbedded shale		51.42	9	NQ RC	DD										
5					50.00	10	NQ RC	DD									
					48.90	11	NQ RC	DD	100	32	9						
6		End of Borehole		6.71													
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-06

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 8, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			Headspace Org. Vapour Conc. [PPM] ppm				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Org. Vapour Conc. [PPM] ppm				HYDRAULIC CONDUCTIVITY, k, cm/s					
								Headspace Comb. Vapour Conc. [%LEL] ppm				WATER CONTENT PERCENT					
												Wp — W — Wi					
								6	12	18	24	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		55.04													
		Grey sandy silt, some gravel, trace brick (FILL)		0.00	1	50 DO	52 ⊕										
		Black silty sand (FILL)		54.51													
		Loose to compact, brown, medium to coarse sand (FILL)		0.61	2	50 DO	13 ⊕										
1					3	50 DO	5 ⊕										
		Compact coarse grey crushed stone (FILL)		53.21													
2				1.83	4	50 DO	29 ⊕										
		Grey silty clay (FILL)		52.30	5	50 DO	76 ⊕										
3				2.74	6	50 DO											
		End of Borehole Auger Refusal		51.97													
				3.07													
4																	
5																	
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-07

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 8, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			Headspace Org. Vapour Conc. [PPM] ppm				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] ppm				WATER CONTENT PERCENT					
								6	12	18	24	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
								20	40	60	80	10	20	30	40		
0		Ground Surface		55.38													
	Power Auger 200 mm Diam. (Hollow Stem)	Black sandy silt with organic matter (TOPSOIL)		0.05	1	50 DO	23										
		Compact black sand, some gravel (FILL)		54.77													
		Loose to compact, brown, medium to coarse sand, some gravel (FILL)		0.61	2	50 DO	20										
1					3	50 DO	12										
2					4	50 DO	7										
					5	50 DO	22										
3					6	50 DO	17										
		PEAT		51.93													
		Compact grey SILTY CLAY		51.82													
		Dense grey GRAVEL		51.55	7	50 DO	50										
4		End of Borehole Auger Refusal		3.83													
5																	
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-08

SHEET 1 OF 1









LOCATION: See Site Plan

BORING DATE: March 11, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			Headspace Org. Vapour Conc. [PPM] \oplus				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] \square				WATER CONTENT PERCENT					
								6	12	18	24	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		55.98													
		Loose brown fine sand, some silt, trace gravel, brick (FILL)		0.00	1	50 DO	8 \oplus										
				55.37													
		Compact brown silty fine sand, some gravel with cobbles and boulders (FILL)		0.61	2	50 DO	69 \oplus										
1				54.76													
		Compact black sand, some gravel, trace silt, pieces of wood (FILL)		1.22	3	50 DO	27 \oplus										
2					4	50 DO	47 \oplus										
				53.54													
			Firm grey brown SILTY CLAY, some sandy gravel, organic layer from 3.66 to 3.73 m depth		2.44	5	50 DO	6 \oplus									
					6	50 DO	11 \oplus										
				52.25													
		Compact grey SANDY SILT, trace gravel		3.73	7	50 DO	9 \oplus										
					8	50 DO	23 \oplus										
5					9	50 DO	26 \oplus										
				50.49													
		Dense grey SANDY SILT, some gravel, trace clay		5.49	10	50 DO	35 \oplus										
				50.16													
6	Rotary Drill NW Casing	Boulders		5.82	11	NQ RC	DD										
				49.63													
		Grey LIMESTONE BEDROCK with interbedded shale		6.35	12	NQ RC	DD	T.C.R. (%)	100	S.C.R. (%)	23	R.Q.D. (%)	0				
7	Rotary Drill NQ Core																
					13	NQ RC	DD	100		20		0					
				48.36													
		End of Borehole		7.62													
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-09

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 9, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			Headspace Org. Vapour Conc. [PPM] ppm				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] ppm				WATER CONTENT PERCENT					
												Wp — W — Wi					
								6	12	18	24	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
								20	40	60	80	10	20	30	40		
0		Ground Surface		56.97													
	Power Auger 200 mm Diam. (Hollow Stem)	Compact to dense grey brown sandy silt, some gravel, trace clay (FILL)		0.00													
					1	50 DO	9	⊕									
1					2	50 DO	11	⊕									
					3	50 DO	45	⊕									
2					4	50 DO	47	⊕									
			Compact black sand, some gravel, trace clay (FILL)		54.68												
					2.29												
			Dense brown medium sand with cobbles (FILL)		54.33												
					2.64												
3		Loose grey to black SILTY CLAY, trace gravel with organic matter		53.95													
				3.02													
					6	50 DO	9	⊕									
				53.16													
4		Compact brown medium to coarse SAND		53.01													
		Compact to dense grey SANDY SILT, some gravel, trace clay		3.96													
					8	50 DO	20	⊕									
5					9	50 DO	89	⊕									
					10	50 DO	39	⊕									
6					11	50 DO	49	⊕									
					12	50 DO	39	⊕									
7				49.83													
				7.14													
		End of Borehole Auger Refusal															
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-10

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 18, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			Headspace Org. Vapour Conc. [PPM] ppm				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] ppm				WATER CONTENT PERCENT					
								6	12	18	24	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		57.82													
		Black sandy silt with organic matter (TOPSOIL)		0.05	1	50 DO	14										
		Compact grey brown silty sand, some gravel with brick (FILL)															
1					2	50 DO	16										
		Compact black sand, some gravel, with brick and ashes (FILL)		56.60	3	50 DO	23										
				1.22													
2		Compact brown to dark brown SAND, some gravel, trace silt		55.99	4	50 DO	16										
				1.83	5	50 DO	10										
3		Compact brown SAND and GRAVEL		54.77	6	50 DO	16										
				3.05													
		Dense brown coarse SAND		54.16	7	50 DO	50										
				3.66													
4		End of Borhole Auger Refusal		53.88													
				3.94													
5																	
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-11

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 18, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		Headspace Org. Vapour Conc. [PPM] ppm				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	6 12 18 24				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
								Headspace Comb. Vapour Conc. [%LEL] ppm				WATER CONTENT PERCENT					
												Wp ——— W ——— Wi					
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		57.86													
		Black sandy silt with organic matter (TOPSOIL)		0.08	1	50 DO	15										
		Compact brown silty sand, some gravel (FILL)															
1			Dense to loose brown and black sand, some gravel with brick, trace concrete and wood (FILL)		56.87 0.99	2	50 DO	38									
						3	50 DO	57									
2						4	50 DO	6									
			Compact brown silty sand layers, some clay, trace gravel with cobbles and boulders (FILL)		55.42 2.44	5	50 DO	24									
3						6	50 DO	28									
4			Very dense grey CLAYEY SILT, trace very fine sand with cobbles and boulders		54.20 3.66	7	50 DO	53									
						8	50 DO	34									
5						9	50 DO	80									
6						10	50 DO	74									
					11	50 DO	50										
7																	
					12	50 DO	50										
					13	50 DO	79										
8	Rotary Drill NQ Core	Fresh grey LIMESTONE BEDROCK with interbedded shale		49.96 7.90	14	NQ RC	DD	100	29	0							
					15	NQ RC	DD	100	44	28							
					16	NQ RC	DD	100	50	36							
		End of Borehole		48.36 9.50													
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-14

SHEET 1 OF 1






LOCATION: See Site Plan

BORING DATE: March 12, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		Headspace Org. Vapour Conc. [PPM] \oplus				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] \square				WATER CONTENT PERCENT					
								ppm				Wp — W — Wi					
								6	12	18	24	10^{-6}	10^{-5}	10^{-4}	10^{-3}		
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		55.85													
		Dark brown sandy silt with organic matter (TOPSOIL)		0.10	1	50 DO	8 \oplus										
		Compact dark brown sand, some gravel, trace silt and brick (FILL)															
1					2	50 DO	26 \oplus										
		Compact, brown, medium to coarse sand, some gravel, trace silt (FILL)			54.63	3	50 DO	16 \oplus									
				1.22													
2					4	50 DO	17 \oplus										
					5	50 DO	17 \oplus										
3																	
		Compact light brown SANDY SILT		52.50	6	50 DO	12 \oplus										
				3.35													
		Dense coarse SAND, some gravel		52.19	7	50 DO	50 \oplus										
				3.66													
4	Rotary Drill NQ Core	Fresh LIMESTONE BEDROCK with interbedded shale		51.86													
					3.99	8	NQ RC	DD	96	28	16						
5					9	NQ RC	DD	TC.R. (%)	SC.R. (%)	R.Q.D. (%)							
								100	96	96							
6		End of Borehole		49.85													
				6.00													
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-15

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 12, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			Headspace Org. Vapour Conc. [PPM] \oplus				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] \square				WATER CONTENT PERCENT					
								ppm				Wp — W — WI					
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		55.34													
		Dark grey silty sand with organic matter (TOPSOIL)		55.14													
		Compact grey silty sand, some gravel, trace clay with cobbles (FILL)		0.20	1	50 DO	40 \oplus										
				54.63													
		Compact black sand, some gravel, trace silt (FILL)		0.81	2	50 DO	14 \oplus										
1		Loose, brown, fine to medium sand, trace gravel (FILL)															
						3	50 DO	7 \oplus									
					4	50 DO	6 \oplus										
2				52.90													
	Compact dark brown to black silt, trace brick and paper (FILL)		2.44	5	50 DO	20											
3				52.29													
	Loose coarse GRAVEL with dark brown to black silt		3.05	6	50 DO	9											
				51.96													
		End of Borehole Auger Refusal		3.38													
4																	
5																	
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-16

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 12, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			Headspace Org. Vapour Conc. [PPM] \oplus				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	6 12 18 24				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
								Headspace Comb. Vapour Conc. [%LEL] \square				WATER CONTENT PERCENT Wp ———— W ———— WI					
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		55.72													
		Black sandy silt with organic matter (TOPSOIL)		0.08	1	50 DO	22 \oplus										
		Compact dark brown to brown sand, some gravel, trace silt with pieces of concrete (FILL)			2	50 DO	53 \oplus										
1				54.50													
		Loose to compact brown fine sand (FILL)		1.22	3	50 DO	13 \oplus										
2					4	50 DO	4 \oplus										
					5	50 DO	3 \oplus										
3		Peat with sand and wood (FILL)		52.70													
				3.02	6	50 DO	2 \oplus										
					7	50 DO	1 \oplus										
4	Rotary Drill NQ Core	Fresh grey LIMESTONE BEDROCK with interbedded shale		51.73													
				3.99	8	NQ RC	DD	100	91	83							
5					9	NQ RC	DD	100	100	100							
				50.21													
		End of Borehole		5.51													
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-17

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 15, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		Headspace Org. Vapour Conc. [PPM] ppm				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] ppm				WATER CONTENT PERCENT					
												Wp — W — WI					
								6	12	18	24	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		56.19													
		Dark brown silty sand with organic material (TOPSOIL)		56.06													
		Loose to compact dark brown silty sand, some gravel with brick, cobbles and boulders (FILL)		0.13	1	50 DO	13 ⊕										
1					2	50 DO	9 ⊕										
		Compact black sand, some gravel, trace silt (FILL)		55.05													
				1.14													
		Loose to compact, brown, medium to coarse SAND, trace gravel with cobbles and boulders		54.67	3	50 DO	18 ⊕										
2				1.52													
					4	50 DO	7 ⊕										
					5	50 DO	20 ⊕										
3		Compact coarse GRAVEL with dark brown silty sand		53.14													
				3.05	6	50 DO	18 ⊕										
4					7	50 DO	23 ⊕										
				52.08													
		End of Borehole Auger Refusal		4.11													
5																	
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-19

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 16, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20 40 60 80				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
								nat V. + Q - ● rem V. ⊕ U - ○				Wp — W — Wi					
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		56.42													
		Black sandy silt with organic matter (TOPSOIL)		0.10	1	50 DO	14										
		Compact to very dense grey brown silty sand, some gravel with brick, concrete, and asphalt (FILL)			2	50 DO	50										
1					3	50 DO	10										
		Compact black sand, some gravel (FILL)		54.74													
		Compact brown silty sand, some gravel, trace black sand (FILL)		54.59													
2				1.83	4	50 DO	18										
				53.98													
		Dense grey brown silty clay, trace gravel (FILL)		2.44	5	50 DO	36										
				53.45													
3		Dense black SANDY SILT with organic matter		3.11	6	50 DO	50										
		Dense brown fine SAND, some silt		3.25													
		End of Borehole Auger Refusal															
4																	
5																	
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-20

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 22, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		Headspace Org. Vapour Conc. [PPM] \oplus				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] \square				WATER CONTENT PERCENT					
								ppm				Wp — W — WI					
								6	12	18	24	10^{-6}	10^{-5}	10^{-4}	10^{-3}		
								20	40	60	80	10	20	30	40		
0		Ground Surface		57.94													
	Power Auger 200 mm Diam. (Hollow Stem)	Black sandy silt with organic matter (TOPSOIL)		0.08	1	50 DO	18 \oplus										
		Compact dark brown silty sand and brick (FILL)		57.33													
				0.61	2	50 DO	39 \oplus										
1		Compact sand, some gravel, trace concrete and brick (FILL)															
				56.11	3	50 DO	16 \oplus										
				1.83	4	50 DO	8 \oplus										
2		Loose to compact brown SILTY SAND with cobbles and boulders		55.20	5	50 DO	30 \oplus										
				2.74	6	50 DO	66 \oplus										
3	Dense grey SILTY SAND, some gravel, trace clay		54.28	7	50 DO	97 \oplus											
			3.66	8	50 DO	86 \oplus											
4	Very dense grey CLAYEY SILT, some very fine sand, trace gravel		52.86														
			5.08														
5	End of Borehole Auger Refusal																
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-25

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 10, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		Headspace Org. Vapour Conc. [PPM] ppm				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] ppm				WATER CONTENT PERCENT					
												Wp — W — Wi					
								6	12	18	24	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
								20	40	60	80	10	20	30	40		
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		55.79													
		Dark brown silty sand with organic matter (TOPSOIL)		55.64													
		Dense grey brown to brown sand, some gravel, trace silt with cobbles and boulders, trace brick from 1.22 to 1.52 m depth (FILL)		0.15	1	50 DO	29										
1					2	50 DO	46										
		Loose brown fine to medium sand (FILL)		54.27	3	50 DO	15										
2				1.52	4	50 DO	3										
					5	50 DO	4										
3		Wood (FILL)		52.89	6	50 DO											
				2.90	7	50 DO	15										
4		Very dense coarse GRAVEL with dark brown silt (FILL)		52.13													
				3.66													
				51.65	7	50 DO	53										
		End of Borehole Auger Refusal		4.14													
5																	
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-26

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 24, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		Headspace Org. Vapour Conc. [PPM] \oplus				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] \square				WATER CONTENT PERCENT					
								6	12	18	24	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴			10 ⁻³
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		55.27													
		Black sandy silt with organic matter (TOPSOIL)		0.08													
		Compact grey crushed stone, some sand (FILL)		54.81	1	50 DO	20 \oplus										
		Compact black sand, some gravel (FILL)		54.66													
		Compact to dense grey crushed stone, some sand (FILL)		0.61													
1					2	50 DO	27 \oplus										
					3	50 DO	37 \oplus										
2			Compact, brown, medium to coarse sand, trace crushed stone (FILL)		53.44												
					1.83	4	50 DO	14 \oplus									
			Loose grey brown silty sand, trace crushed stone (FILL)		52.83												
				2.44	5	50 DO	6 \oplus										
3	Rotary Drill NQ Core			52.22													
		Peat, trace wood (FILL)		3.05	6	50 DO	50 \oplus										
				51.97													
		Highly weathered LIMESTONE BEDROCK		51.79													
		Grey LIMESTONE BEDROCK with interbedded shale		3.48													
4				7	NQ RC	DD		100		59		27					
				8	NQ RC	DD		100		100		100					
5		End of Borehole		50.22													
				5.05													
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0044

RECORD OF BOREHOLE: 10-28

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 22, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		Headspace Org. Vapour Conc. [PPM] \oplus				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	Headspace Comb. Vapour Conc. [%LEL] \square				WATER CONTENT PERCENT					
								20 40 60 80				10 20 30 40					
0	Power Auger 200 mm Diam. (Hollow Stem)	Ground Surface		56.33													
		Black sandy silt with organic matter (TOPSOIL)		56.20													
		Compact brown coarse sand, some gravel (FILL)		0.13	1	50 DO	17 \oplus										
1				55.42	2	50 DO	22 \oplus										
		Loose to compact black sand, some gravel, some glass, trace wood from 1.83 m depth (FILL)		0.91	3	50 DO	10 \oplus										
2				53.89	4	50 DO	4 \oplus										
		Loose brown to grey brown SILTY CLAY		2.44	5	50 DO	9 \oplus										
3					6	50 DO	6 \oplus										
4			Dense brown SILTY SAND, some gravel with cobbles and boulders		52.67	7	50 DO	\oplus									
					52.09	8	50 DO	60 \oplus									
		End of Borehole Auger Refusal		4.24													
5																	
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: D.G.

CHECKED: K.P.H.

BOREHOLE 1011220044.GPJ HYDROGEO.GDT 7/27/10

PROJECT: 10-1122-0169

RECORD OF BOREHOLE: 11-11

SHEET 1 OF 2



LOCATION: See Site Plan

BORING DATE: Mar. 4, 2011

DATUM: Geodetic

SAMPLER HAMMER, 63.5 kg; DROP, 760 mm

PENETRATION TEST HAMMER, 63.5 kg; DROP, 760 mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								nat V. + Q - rem V. ⊕ U -									
							20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³			
							20	40	60	80	20	40	60	80			
0		GROUND SURFACE		54.5													
	Power Auger 200mm Diam. (Hollow Stem)	Compact black sand and gravel, some silt, trace clay, wood and ash (FILL)		0.0												Cuttings	
				1	50 DO	29											
1							2	50 DO	14								
2																MH	

DEPTH SCALE

1 : 50



LOGGED: DG

CHECKED: SR

MIS-BHS 001 1011220169.GPJ GAL-MIS.GDT 15/06/11 DATA INPUT:

PROJECT: 10-1122-0169

RECORD OF DRILLHOLE: 11-21

SHEET 1 OF 1

LOCATION: See Site Plan

DRILLING DATE: Mar. 1, 2011

DATUM: Geodetic

INCLINATION: -90° AZIMUTH: ---

DRILL RIG: CME 55 Track

DRILLING CONTRACTOR: Marathon Drilling

DEPTH SCALE METRES	DRILLING RECORD	DESCRIPTION	SYMBOLIC LOG	ELEV. DEPTH (m)	RUN No.	PENETRATION RATE (m/min)	FLUSH	COLOUR % RETURN	FR/FX-FRACTURE F-FAULT SM-SMOOTH FL-FLEXURED BC-BROKEN CORE												DIAMETRAL POINT LOAD INDEX (MPa)	NOTES WATER LEVELS INSTRUMENTATION				
									CL-CLEAVAGE J-JOINT R-ROUGH UE-UNEVEN MB-MECH. BREAK				SH-SHEAR P-POLISHED ST-STEPPED W-WAVY B-BEDDING				VN-VEIN S-SLICKENSIDED PL-PLANAR C-CURVED									
									RECOVERY		R.Q.D. %	FRACT. INDEX PER 0.3	DISCONTINUITY DATA		HYDRAULIC CONDUCTIVITY K, cm/sec											
									TOTAL CORE %	SOLID CORE %			DIP w.r.t. CORE AXIS	TYPE AND SURFACE DESCRIPTION												
									80 60 40 20	80 60 40 20	80 60 40 20	5 10 15 20	0 30 60 90	10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³												
0	P.A. (Hollow Stem)	BEDROCK SURFACE		54.8																					Protective Monument	
		Slightly weathered LIMESTONE BEDROCK, with shale interbedding		0.0																						
1					C1		0																		Bentonite Seal	
2	Rotary Drill NQ Coring	Fresh grey medium bedded LIMESTONE BEDROCK, with interbedded shale		53.3 1.5			100																			Silica Sand
3					C3		100																			38mm Diam. PVC #10 Slot Screen
4		End of Borehole		51.1 3.7																						W.L. in Screen at Elev. 52.12 m on March 7, 2011 W.L. in Screen at Elev. 52.44 m on April 19, 2011
5																										
6																										
7																										
8																										
9																										
10																										

DEPTH SCALE

1 : 50



LOGGED: DG

CHECKED: SR

MIS-RCK 001 1011220169 (ROCK) GPJ GAL-MISS.GDT 1506/11 DATA INPUT:

PROJECT: 10-1121-0222

RECORD OF BOREHOLE: W-009

SHEET 1 OF 2

LOCATION: N 5030282 97 ; E 365715 99

BORING DATE: June 2-6, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING			
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m										
								SHEAR STRENGTH				WATER CONTENT PERCENT					
								Cu, kPa				nat V + Q • rem V ⊕ U - ○					
							20	40	60	80	10 ⁻⁸	10 ⁻⁶	10 ⁻⁴	10 ⁻²			
								20	40	60	80	20	40	60	80		
0		GROUND SURFACE		60.44												MON WELL	
		ASPHALTIC CONCRETE		59.88												Flush Mount Protective Casing set in Asphalt	
		Grey sand and gravel (Crushed Stone FILL)		59.58												Silica Sand	
		Compact brown medium sand, trace gravel and silt (FILL)		0.56												Bentonite Seal	
1				59.21	1	50 DO	16										
		Loose to dense grey sand and gravel, some brown sand, with cobbles (Crushed Stone FILL)		1.23													
2					2	50 DO	14									Cave/Backfill	
					3	50 DO	61										
3																	
					4	50 DO	9										
4																	
		Very loose to compact brown sandy silt, some clay, trace gravel, with wood fragments, occasional cobble and boulders with depth (FILL)		56.32	5	50 DO	5									Bentonite Seal	
5				4.12													
					6	50 DO	3										
					7	50 DO	10										
6				54.34												Silica Sand	
		Compact to dense black sandy silt, some wood, trace gravel, ash, glass and fabric, creosote odour (WASTE)		5.10												32mm Diam PVC #10 Slot Screen	
7					8	50 DO	12										
					9	50 DO	41										
8				52.51												Silica Sand	
		Loose brown to grey fine to coarse sand, trace gravel, trace silt (FILL)		7.93												Bentonite Seal	
9					11	50 DO	5										
					12	50 DO	5									Cave	
10																	
					13	50 DO	5										
		CONTINUED NEXT PAGE															

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: SD/HD

OLRT-SOIL 1011210222-1300.GPJ GAL-MIS GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF BOREHOLE: W-009

SHEET 2 OF 2

LOCATION: N 5030282 97 ; E 365715.99

BORING DATE: June 2-6, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m		HYDRAULIC CONDUCTIVITY, k, cm/s		ADDITIONAL LAB TESTING	
		DESCRIPTION	STRATA PLOT ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	20 40 60 80	10 ⁻⁸ 10 ⁻⁶ 10 ⁻⁴ 10 ⁻²	10 ⁻⁸ 10 ⁻⁶ 10 ⁻⁴ 10 ⁻²		
		--- CONTINUED FROM PREVIOUS PAGE ---									MON. WELL
10	Power Auger	Loose brown to grey fine to coarse sand, trace gravel, trace silt (FILL)	50.07	13	50 DO	5					
		Loose dark brown silt, with organic matter, occasional grey fine sand seams (PEAT)	10.37								Cave
		Dense brown SILTY SAND, some gravel	10.52								
11		Dense to very dense grey SILTY SAND to SANDY SILT, some gravel, trace clay, with cobbles and boulders (GLACIAL TILL)	49.54	14	50 DO	50					Bentonite Seal
			10.90								
12				15	NQ RC	DD					
13	Rotary Drill NO Core			16	NQ RC	DD					Cave
14				17	NQ RC	DD					
15				18	NQ RC	DD					Bentonite Seal
		Borehole continued on RECORD OF DRILLHOLE W-009	45.04								W L in Screen at Elev 53.3m on Aug 2, 2011
16											
17											
18											
19											
20											

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: SD/HD

OLRT-SOIL 1011210222-1360.GPJ GAL-MIS GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF DRILLHOLE: W-009

SHEET 1 OF 1

LOCATION: N 5030282 97 ; E 365715 99

DRILLING DATE: June 2-6, 2011


DATUM: Geodetic

INCLINATION: -90°

AZIMUTH: ---

DRILL RIG: CME 75

DRILLING CONTRACTOR: Marathon Drilling

DEPTH SCALE METRES	DRILLING RECORD	DESCRIPTION	SYMBOLIC LOG	ELEV		RUN No	FLUSH RETURN	JN - Joint FLT - Fault SH - Shear VN - Vein CJ - Conjugate BD - Bedding FO - Foliation CO - Contact OR - Orthogonal CL - Clean PL - Planar CU - Curved UN - Undulating ST - Stepped IR - Irregular PO - Polished K - Stickensided SM - Smooth RO - Rough MB - Mechanical Break BR - Broken Rock NOTE: For additional abbreviations refer to list of abbreviations & symbols										NOTES																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																													
				DEPTH (m)	R Q D %			RECOVERY		FRACT INDEX PER 0.25m	DISCONTINUITY DATA	HYDRAULIC CONDUCTIVITY K cm/sec	WEATH- ERING INDEX																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																		
								TOTAL CORE %	SOLID CORE %				TYPE AND SURFACE DESCRIPTION	J1 J2 J3 J4 J5 J6 J7 J8 J9 J10	W1 W2 W3 W4 W5 W6																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																
																99999	99999																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																														
16	Rotary Drill NQ Core	BEDROCK SURFACE Fresh, interbedded sequence of shale and limestone, comprised of dark brownish black, moderately calcareous SHALE BEDROCK, with thinly to medium bedded, dark brownish grey, fine grained, medium strong micritic LIMESTONE BEDROCK LINDSAY FORMATION UNIT 3		45.04 15.40	1	100																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																									

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: SD/HD

OJRT-ROCK 1011210222-1300 GPJ GAL-MISS GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF BOREHOLE: W-009A

SHEET 1 OF 1

LOCATION: N 5030284 17 ; E 365718.48

BORING DATE: June 13, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING	GAS WELL			
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT						
								Cu, kPa	nat V	rem V	+ ⊕	- ⊖	Wp			W	Wi	
								20	40	60	80		10 ⁻⁸	10 ⁻⁶	10 ⁻⁴	10 ⁻²		
								20	40	60	80		20	40	60	80		
0	Power Auger 200mm Diam. (Hollow Stem)	GROUND SURFACE		60.53														
		See RECORD OF BOREHOLE W-009 for subsurface condition details		0.00														
1																		
2																		
3																		
4																		
5																		
6																		
7		End of Borehole		53.67 6.86														
8																		
9																		
10																		

GAS WELL

Flush Mount
Protective Casing
set in Bentonite
Bentonite Seal
Backfill

Pea Gravel

Bentonite Seal

Pea Gravel

20mm Diam. PVC
#10 Slot Screen

Pea Gravel

DEPTH SCALE

1 : 50



LOGGED: CHM
CHECKED: SD/HD

OIRT-SOIL 1011210222-1300.GPJ GAL-MIS GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF BOREHOLE: W-011

SHEET 1 OF 2

LOCATION: N 5030336 81 ;E 365783 53

BORING DATE: June 22-24, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING				
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT						
								Cu, kPa		nat V rem V		+ Q - ⊕ U -			Wp ——— W ——— WI			
								20	40	60	80	10 ⁻⁸	10 ⁻⁶		10 ⁻⁴	10 ⁻²	20	40
0		GROUND SURFACE		52.74														
	Power Auger 200mm Diam (Hollow Stem)	Topsoil (FILL)			0.05													
		Grey to brown sand and gravel (Crushed Stone FILL)			0.05													
1						1	50 DO	10										
		Compact to dense dark brown fine to coarse sand, some silt, trace gravel (FILL)			0.17.44 1.30													
2						2	50 DO	47										
		Compact dark brown silty sand, some gravel, trace organic matter, with brick fragments and pockets of silty clay (FILL)			60.61 2.13													
3						3	50 DO	28										
		Compact dark brown to black sandy silt, some gravel, trace to some clay, trace brick, wood, ash and organic matter (FILL)			59.84 2.90													
4						4	50 DO	26										
		Dense grey sand and gravel, trace silt, occasional cobble (FILL)			59.18 3.56													
5						5	50 DO	31										
		Compact dark brown to black sandy silt, trace to some gravel, trace clay, with wood, brick, ash, organic matter, glass, plastic and pockets of silty clay (WASTE)			57.56 5.18													
6						6	50 DO	46										
7					7	50 DO	29											
					8	50 DO	18											
8					9	50 DO	11											
					10	50 DO	21											
		Compact brown fine to medium sand, trace gravel and silt (WASTE)			54.74 8.00 54.51													
		Compact dark brown silty sand to sandy silt, some gravel, trace clay, ash, brick, ceramics and organic matter (WASTE)			8.23													
9					11	50 DO	27											
					12	50 DO	28											
10					13	50 DO	6											
		Loose to compact dark brown to black sandy silt, some sand, trace paper, fabric, wood, metal and organic matter (WASTE)			53.59 9.15													
		CONTINUED NEXT PAGE																

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: SD/HD

OLRT-SOIL 1011210222-1300.GPJ GAL-MIS GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF BOREHOLE: W-011

SHEET 2 OF 2

LOCATION: N 5030336 81 ;E 365783 53

BORING DATE: June 22-24, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m		HYDRAULIC CONDUCTIVITY, k, cm/s		ADDITIONAL LAB TESTING			
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT	
								20	40			60	80
10	Power Auger 200mm Diam. (Hollow Stem)	— CONTINUED FROM PREVIOUS PAGE —											
		Loose to compact dark brown to black sandy silt, some sand, trace paper, fabric, wood, metal and organic matter (WASTE)			13	50 DO	6						
			51.92										
		Dark brown amorphous PEAT			14	50 DO	13						
			10.82										
		Very stiff grey SILTY CLAY, some organic matter											
			51.69										
			11.05										
			51.31										
		Very dense grey brown fine to coarse SAND, some gravel, some silt, trace clay and pieces of shale (GLACIAL TILL)			15	50 DO	69						
					16	50 DO	53						
13		Highly weathered, black, very weak SHALE BEDROCK			17	50 DO	>86						

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: SD/HD

OLRT-SOIL 1011210222-1300 GPJ GAL-MIS GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF DRILLHOLE: W-011

SHEET 1 OF 1

LOCATION: N 5030336 81 ; E 365783 53

DRILLING DATE: June 22-24, 2011

DATUM: Geodetic

INCLINATION: -90°

AZIMUTH: ---

DRILL RIG: CME 55

DRILLING CONTRACTOR: Downing

DEPTH SCALE METRES	DRILLING RECORD	DESCRIPTION	SYMBOLIC LOG	ELEV DEPTH (m)	RUN NO	FLUSH RETURN	JN - Joint FLT - Fault SH - Shear VN - Vein CJ - Conjugate										BD - Bedding FO - Foliation CO - Contact OR - Orthogonal CL - Clean										PL - Planar CU - Curved UN - Undulating ST - Stepped IR - Irregular										PO - Polished K - Slickensided SM - Smooth RO - Rough MB - Mechanical Break										BR - Broken Rock NOTE: For additional abbreviations refer to list of abbreviations & symbols	NOTES
							RECOVERY		R O D %	FRACT INDEX PER 0.25m	DISCONTINUITY DATA	TYPE AND SURFACE DESCRIPTION	HYDRAULIC CONDUCTIVITY K, cm/sec	WEATH- ERING INDEX																																		
							TOTAL CORE %	SOLID CORE %						W1	W2	W3	W4	W5	W6																													
							14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50					
		BEDROCK SURFACE at 12.96m		49.00																																												
		Highly weathered, black, very weak SHALE BEDROCK		13.74	1	100																																										
		- No recovery from 13.74m to 14.26m		48.46																																												
		Moderately weathered, laminated, black, weak SHALE BEDROCK		14.26	1	100																																										
		BILLINGS FORMATION		48.12																																												
		- Broken core from 14.26m to 14.40m		14.62																																												
		- Broken core from 14.55m to 14.62m																																														
		Fresh, laminated, black, weak SHALE BEDROCK			2	100																																										
		End of Drillhole		46.69																																												
				16.05																																												
17																																																
18																																																
19																																																
20																																																
21																																																
22																																																
23																																																

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: SD/HD

QLRT-ROCK 1011210222-1300.GPJ GAL-MISS.GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF BOREHOLE: W-012

SHEET 1 OF 2

LOCATION: N 5030354 08 ,E 365772 87

BORING DATE: June 7-8, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING					
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT							
								Cu, kPa		nat V rem V		+ Q - ⊕ U - ⊖				Wp — W — Wi			
								20	40	60	80	10 ⁻⁹	10 ⁻⁶			10 ⁻⁴	10 ⁻²	20	40
0		GROUND SURFACE		59.32											MON. WELL				
		Dark brown sandy silt, trace to some gravel and organic matter (TOPSOIL)		0.00											Flush Mount Protective Casing set in Sand				
		Very loose to compact dark brown to black sandy silt to silty sand, trace to some gravel and clay, with silty clay pockets, brick, wood, ash, glass, organic matter, mortar, ceramics, paper and plastic (WASTE)		59.12											Silica Sand				
				0.20															
1					1	50 DO	9								Bentonite Seal				
2					2	50 DO	13												
3					3	50 DO	16								Cave/Backfill				
4					4	50 DO	16												
5					5	50 DO	12								Bentonite Seal				
6					6	50 DO	3								Silica Sand				
7					7	50 DO	18												
8					8	50 DO	19								32mm Diam PVC #10 Slot Screen				
9					9	50 DO	69								Silica Sand				
10					10	50 DO	6												
											</								

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: SD/HD

OLRT-SOIL 10/11210222-1300.GPJ GAL-MIS GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF BOREHOLE: W-012

SHEET 2 OF 2

LOCATION: N 5030354 08 ;E 365772.87

BORING DATE: June 7-8, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa		WATER CONTENT PERCENT				
								20	40	60	80	10 ⁻⁸	10 ⁻⁶	
		— CONTINUED FROM PREVIOUS PAGE —												
10	Power Auger			49.11	13	50								
		Highly weathered, black, weak SHALE BEDROCK		10.21										
				48.60	50									
11		Sampler Refusal at 10.72m Borehole continued on RECORD OF DRILLHOLE W-012												
12														
13														
14														
15														
16														
17														
18														
19														
20														

MON WELL

W L in Screen at
Elev 54.1m on
Aug. 2, 2011

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: SD/HD

CLRT-SOIL 1011210222-1300.GPJ GAL-MIS.GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF DRILLHOLE: W-012

SHEET 1 OF 1

LOCATION: N 5030354 08 , E 365772 87

DRILLING DATE: June 7-8, 2011

DATUM: Geodetic

INCLINATION: -90°

AZIMUTH: ---

DRILL RIG: CME 75

DRILLING CONTRACTOR: Marathon Drilling

DEPTH SCALE METRES	DRILLING RECORD	DESCRIPTION	SYMBOLIC LOG	ELEV	DEPTH (m)	RUN No	FLUSH RETURN	JN - Joint FLT - Fault SH - Shear VN - Vein CJ - Conjugate BD - Bedding FO - Foliation CO - Contact OR - Orthogonal CL - Clean PL - Planar CU - Curved UN - Undulating ST - Stepped IR - Irregular PO - Polished K - Stickensided SM - Smooth RO - Rough MB - Mechanical Break BR - Broken Rock NOTE: For additional abbreviations refer to list of abbreviations & symbols										NOTES						
								RECOVERY		R O D %	FRACT INDEX PER 0.25m CORE AUS	DISCONTINUITY DATA				HYDRAULIC CONDUCTIVITY K cm/sec			WEATH- ERING INDEX					
								TOTAL CORE %	SOLID CORE %			TYPE AND SURFACE DESCRIPTION		Joint Jr	Joint Jk	Joint Jm	Joint Jn		W1	W2	W3	W4	W5	W6
								88888	88888															
		BEDROCK SURFACE at 10.21m		48.60																MON WELL				
11	Rotary Drill NO Core	Fresh, laminated, black, weak SHALE BEDROCK		10.72																				
		BILLINGS FORMATION																						
12		- Subvertical fracture from 11.91m to 12.27m, infilled with calcite (<1mm) - Broken core from 12.04m to 12.10m		47.05																				
		End of Drillhole		12.27																				
13																				W L in Screen at Elev 54.1m on Aug 2, 2011				
14																								
15																								
16																								
17																								
18																								
19																								
20																								

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: SD/HD

OLRT-ROCK 1011210222-1300 GPJ GAL-MISS.GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF BOREHOLE: W-013

SHEET 1 OF 2

LOCATION: N 5030375 10 E 365845.61

BORING DATE: June 22-23, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING		
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
							Cu, kPa		nat V rem V		+ Q - U -		Wp W WI			
							20	40	60	80		10 ⁻⁸	10 ⁻⁶	10 ⁻⁴	10 ⁻²	
0		GROUND SURFACE		60.97												
		ASPHALTIC CONCRETE		0.00												
		Dense to compact grey sand and gravel (Crushed Stone FILL)		0.12												
1					1	50 DO										
					2	50 DO										
2				58.84												
		Compact to dense brown sand and gravel, trace silt, with cobbles (Crushed Stone FILL)		2.13												
					3	50 DO										
3																
					4	50 DO										
4																
					5	50 DO										
5																
					6	50 DO										
6				55.79												
		Loose to compact dark grey to black sandy silt, some clay and organic matter, trace gravel, with wood, glass and brick (WASTE)		5.18												
					7	50 DO										
7																
					8	50 DO										
					9	50 DO										
8				51.50												
		Dark grey to black wood, organic matter plastic, glass, brick and paper, some silty sand (WASTE)		7.47												
					10	50 DO										
9																
					11	50 DO										
		Very dense grey brown fine to medium SAND, some gravel, with cobbles		52.28												
				8.69												
					12	50 DO										
10																
					13	50 DO										

CONTINUED NEXT PAGE

DEPTH SCALE

1:50



LOGGED: HEC

CHECKED: SD/HD

OLRT-SOIL 1011210222-1300 GPJ GAL-MIS GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF BOREHOLE: W-013

SHEET 2 OF 2


LOCATION: N 5030375 10; E 365845 61

BORING DATE: June 22-23, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING		
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								20	40	60	80	nat V Cu, kPa	+ rem V	Q - ⊕			U - ○
								20	40	60	80	20	40	60	80		
10	Power Auger	— CONTINUED FROM PREVIOUS PAGE —															
		Very dense grey brown fine to medium SAND, some gravel, with cobbles		50.46 10.51	13	DO	>100										
		Highly weathered, black, weak SHALE BEDROCK		49.95	14	DO	>100										
11		Borehole continued on RECORD OF DRILLHOLE W-013															
12																	
13																	
14																	
15																	
16																	
17																	
18																	
19																	
20																	

W.L. in open hole
at Elev. 52.8m
upon completion of
drilling

W L in open hole
at Elev. 52.8m
upon completion of
drilling

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: SD/HD

OVRT-SOIL 1011210222-1300 GPJ GAL-MIS GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF DRILLHOLE: W-013

SHEET 1 OF 1

LOCATION: N 5030375 10 E 365845 61

DRILLING DATE: June 22-23, 2011

DATUM: Geodetic

INCLINATION: -90°

AZIMUTH: ---

DRILL RIG: CME 75

DRILLING CONTRACTOR: Downing

DEPTH SCALE METRES	DRILLING RECORD	DESCRIPTION	SYMBOLIC LOG	ELEV DEPTH (m)	RUN No	JN - Joint FLT - Fault SH - Shear VN - Vein CJ - Conjugate BD - Bedding FO - Foliation CO - Contact OR - Orthogonal CL - Clean PL - Planar CU - Curved UN - Undulating ST - Stepped IR - Irregular PO - Polished K - Slickensided SM - Smooth RO - Rough MB - Mechanical Break BR - Broken Rock NOTE: For additional abbreviations refer to list of abbreviations & symbols														NOTES																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																								
						FLUSH RETURN	RECOVERY		R O D %	FRACT INDEX PER 0.25m CORE AXIS	DISCONTINUITY DATA	HYDRAULIC CONDUCTIVITY K, cm/sec			WEATH- ERING INDEX																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																													
							TOTAL CORE %	SOLID CORE %				TYPE AND SURFACE DESCRIPTION	Zone #	JA	10"	10"	10"	W1	W2		W3	W4	W5	W6																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																				
		BEDROCK SURFACE at 10.51m		49.95																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																								

W L in open hole
at Elev 52.8m
upon completion of
drilling

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: SD/HD

OJRT-ROCK 1011210222-1300 GPJ GAL-MISS GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF BOREHOLE: W-015

SHEET 1 OF 1

LOCATION: N 5030400 13 ; E 365816 06

BORING DATE: June 13-14, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING					
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT							
								Cu, kPa		nat V rem V		+ Q - ⊕ U - ⊙				Wp ----- W ----- Wl			
								20	40	60	80	10 ⁻⁵	10 ⁻⁶			10 ⁻⁴	10 ⁻²	20	40
0		GROUND SURFACE		58.89															
		Dark brown sandy silt, trace organic matter and gravel (TOPSOIL)		0.00															
		Grey brown sand and gravel, trace silt, with cobbles (Crushed Stone FILL)		0.08															
				58.08															
		Loose to compact dark brown to black sandy silt, trace to some clay, trace gravel, with ash, wood, brick, organic matter, mortar, glass and plastic (WASTE)		0.81															
1					1	50 DO	11												
					2	50 DO	13												
2																			
					3	50 DO	12												
					4	50 DO	3												
					5	50 DO	7												
					6	50 DO	10												
5		Black wood and organic matter, with plastic, paper, glass, metal and sand (WASTE)		4.57															
					7	50 DO	9												
					8	50 DO	15												
					9	50 DO	16												
7		Dark brown organic matter, trace silt (PEAT)		6.91															
		Compact to dense grey brown fine to medium SAND, some gravel and silt																	
					10	50 DO	>50												
					11	50 DO	>50												
		Highly weathered, black, weak SHALE BEDROCK		8.26															
9																			
		Borehole continued on RECORD OF DRILLHOLE W-015		49.75															
10																			

Power Auger
200mm Diam (Hollow Stem)

W L in open hole
at Elev 52.8m
upon completion of
drilling

DEPTH SCALE

1 : 50



LOGGED: CHM

CHECKED: SD/HD

OLET-SOIL 1011210222-1300 GPJ GAL-MIS GDT 10/18/11 JEM/JM


 W.L. in open hole
at Elev 52.8m
upon completion of
drilling

PROJECT: 10-1121-0222

RECORD OF DRILLHOLE: W-015

SHEET 1 OF 1

LOCATION: N 5030400 13 E 365816.06

DRILLING DATE: June 13-14, 2011

DATUM: Geodetic

INCLINATION: -90° AZIMUTH: ---

DRILL RIG: CME 75

DRILLING CONTRACTOR: Marathon Drilling

DEPTH SCALE METRES	DRILLING RECORD	DESCRIPTION	SYMBOLIC LOG	ELEV DEPTH (m)	RUN No.	FLUSH RETURN	RECOVERY		R Q D %	FRACT INDEX PER 0.25m	DISCONTINUITY DATA	HYDRAULIC CONDUCTIVITY K, cm/sec						WEATH- ERING INDEX						NOTES			
							TOTAL CORE %	SOLID CORE %				TYPE AND SURFACE DESCRIPTION		10 10 10 10		10 10 10 10		W1 W2 W3 W4 W5 W6									
		BEDROCK SURFACE at 8.26m		49.75																							
		Slightly weathered, laminated, dark grey, weak SHALE BEDROCK, with thin cross-cutting veins of calcite		9.14																							
		BILLINGS FORMATION																									
		- Broken core from 9.14m to 9.18m			1	100																					
10		- Broken core from 10.00m to 10.05m																									
		- Broken core from 10.18m to 10.34m																									
		- No recovery from 10.71m to 11.00m			2																						
11		- Broken core from 11.00m to 11.03m			2	100																					
		- Broken core from 11.08m to 11.11m																									
		- Broken core from 11.36m to 11.58m																									
		- Broken core from 11.68m to 11.70m																									
12		- Broken core from 11.85m to 11.91m			3	100																					
		- No recovery from 12.15m to 12.25m			3																						
		- Broken core from 12.21m to 12.28m																									
13		- Broken core from 12.85m to 12.94m			4	100																					
		- Broken core from 13.07m to 13.16m																									
		- Broken core from 13.58m to 13.95m																									
14		- Fracture (25°) from 14.25m to 14.90m			5	100																					
15		- No recovery from 14.93m to 15.12m			5																						
		End of Drillhole		43.56 15.33	5	100																					
16																											
17																											
18																											
19																											

W L in open hole
at Elev 52.8m
upon completion of
drilling

DEPTH SCALE

1 : 50



LOGGED: CHM

CHECKED: SD/HD

OLRT-ROCK 1011210222-1300 GPJ GAL-MISS GDT 10/18/11 JEM/JM

PROJECT: 10-1121-0222

RECORD OF BOREHOLE: W-017

SHEET 1 OF 1

LOCATION: N 5030453.15, E 365880.77

BORING DATE: June 14, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING			
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								Cu, kPa	nat V	+ rem V	Q - U -	●	○			10 ⁻³	10 ⁻⁵
								20	40	60	80						

OLRT-SOIL 1011210222-1300 GPJ GAL-MIS GDT 10/18/11 JEM/JM

DEPTH SCALE

1 : 50



LOGGED: HC

CHECKED: SD/HD

PROJECT: 10-1121-0222

RECORD OF BOREHOLE: W-018

SHEET 1 OF 1

LOCATION: N 5030296 52 ,E 365785 63

BORING DATE: October 28, 2010

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING				
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT						
								Cu, kPa		nat V rem V		+ Q - ⊕ U - ⊙			Wp ——— W ——— WI			
								20	40	60	80	10 ⁻⁸	10 ⁻⁶		10 ⁻⁴	10 ⁻²	20	40
0		GROUND SURFACE		63.53														
		Dark brown silty sand, some gravel and organic matter (TOPSOIL) 0.00m - 0.02m		63.53	0.02	1	50 DO	20										
		Compact brown and dark grey silty fine to coarse sand, some gravel (FILL)																
1				62.70	0.83	2	50 DO	>54										
		Loose brown to dark brown silty fine to coarse sand, some gravel, trace clay, ash, brick and boulders (FILL)																
						3	50 DO	5										
2				61.40	2.13													
		Loose to compact dark brown silty fine to coarse sand to sandy silt, some gravel, trace clay, brick, ash, wood, slag and mortar (FILL)				4	50 DO	27										
						5	50 DO	5										
4	Power Auger 200mm Diam. (Hollow Stem)					6	50 DO	4										
						7	50 DO	6										
5						8	50 DO	21										
6				57.43	6.10													
		Very loose to dense brown silty sand to sandy silt, with gravel layers, cobbles and boulders (FILL)				9	50 DO	>58										
						10	50 DO	3										
8						11	50 DO	31										
		End of Borehole		55.30	8.23													
9																		
10																		

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: HD

DLRT-SOIL 1011210222-1300 GPJ CAL-MIS GDT 10/18/11 JEM/JM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-01

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 23, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20 40 60 80				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
								nat V. + Q - ● rem V. ⊕ U - ○				Wp — W — Wi					
								20	40	60	80	20	40	60	80		
0		GROUND SURFACE		56.36													
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL		0.00													
		Dark brown to black silty sand (FILL)		0.13													
				55.95	1	50 DO	22										
		Compact fine to medium brown silty sand, some gravel, trace brick (FILL)		0.41													
1					2	50 DO	51										
					3	50 DO	24										
					54.53												
		Gravel (FILL)		1.83													
				54.23	4	50 DO	41										
		Dense medium to fine grey to brown sand, trace gravel and silt (FILL)		2.13													
				53.62	5	50 DO	>50										
				2.74													
		GRAVEL and COBBLES (GLACIAL TILL)		53.44													
				2.92													
3		End of Borehole Auger Refusal															
4																	
5																	
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-02

SHEET 1 OF 2

LOCATION: See Site Plan

BORING DATE: November 24, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m										
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ⊙		WATER CONTENT PERCENT					
												Wp — W — Wi					
								20	40	60	80	20	40	60	80		
0		GROUND SURFACE		55.00													
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL		0.00													
		Compact black silty sand, trace ash and clay, occasional layers of medium brown sand and gravel (FILL)		0.15	1	50 DO	12										
1				53.96	2	50 DO	35										
		Compact medium to fine brown sand, some gravel, trace silt (FILL)		1.04	3	50 DO	17										
2					4	50 DO	25										
		Coarse brown sand, some gravel, trace silt and brick, occasional layers of gravel (FILL)		52.61	5	50 DO	38										
3					51.34	6	50 DO	59									
		Compact to dense coarse grey sand, some gravel, trace silt, with cobbles and boulders (FILL)		3.66	7	50 DO	24										
4			COBBLES, BOULDERS, and GRAVEL (GLACIAL TILL)		50.78												
					4.22	C1	NQ RC	DD									
5					49.82												
		Very dense grey coarse SAND, some silt, some gravel (GLACIAL TILL)		5.18	8	50 DO	>50										
6			COBBLES, BOULDERS, and GRAVEL		49.23												
					5.77	C3	NQ RC	DD									
		Very dense grey coarse SAND and GRAVEL, trace cobbles		48.90													
			6.10	9	50 DO	78											
		End of Borehole		48.29													
				6.71													
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

SHEET 2 OF 2

DATUM: Geodetic

DRILLING CONTRACTOR: Marathon Drilling

CHECKED: JW

MIS-RCK 004 111220199.GPJ GAL-MISS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-03

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 28, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	RESISTANCE, BLOWS/0.3m				k, cm/s					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ⊙		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
0		GROUND SURFACE		54.93													
	Power Auger 200 mm Diam. (Hollow Stem)	Compact dark brown silty sand, trace gravel, organics (TOPSOIL)		54.75													
		Compact black silty sand, some gravel, ash, slag (FILL)		54.32	1	50 DO	10										
		Compact brown fine to medium sand, some gravel, some silt, brick (FILL)		54.00													
		Compact to loose black silty sand, some gravel, ash, slag (FILL)		53.58	2	50 DO	14										
1		Loose brown fine to coarse sand, some gravel, trace silt (FILL)		53.10	3	50 DO	9										
		Compact brown medium to coarse sand, some gravel, some fine sand, trace silt (FILL)		52.49	4	50 DO	11										
		Loose dark brown SILTY SAND, some gravel, trace to some clay, organics		52.51	5	50 DO	38										
		Dense to very dense grey brown to brown SILTY SAND, some gravel, with cobbles and boulders			6	50 DO	33										
					7	50 DO	>50										
4																	
		Very dense grey SILTY SAND, some gravel, cobbles, boulders (GLACIAL TILL)		50.36 4.57	8	50 DO	74										
5					9	50 DO	54										
				49.24 5.69	10	50 DO	>50										
6		End of Borehole Auger Refusal Possible Bedrock															
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-04

SHEET 1 OF 1










LOCATION: See Site Plan

BORING DATE: December 1, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20 40 60 80				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
								nat V. + Q - rem V. ⊕ U - ○				Wp — W — Wi					
0		GROUND SURFACE		56.16													
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL		0.00													
		Compact black silty sand, some gravel, trace brick, ash, slag, wood and glass (FILL)		0.15	1	50 DO	8										
1						2	50 DO	16									
						3	50 DO	10									
2			Loose dark brown to red coarse sand, some gravel, trace brick, ash, silt and slag (FILL)		54.33 1.83	4	50 DO	5									
						5	50 DO	3									
3					Loose medium to fine orange sand, trace slag and silt (FILL)		53.42 2.74										
			53.11														
			3.05														
			Very loose red coarse sand, trace silt (FILL)		52.81 3.35	6	50 DO	2									
			Very loose black crushed asphaltic concrete (FILL)														
4						52.20	7	50 DO	2								
				3.96													
			ORGANICS		4.11												
		Grey CLAY	4.27		8	50 DO	>50										
		Grey SILTY SAND, some gravel	51.59 4.57														
5		Compact to dense grey to brown coarse SAND and GRAVEL, trace silt															
					9	50 DO	49										
6					10	50 DO	54										
		Very dense SAND and GRAVEL, some cobbles, trace boulders (GLACIAL TILL)		49.96 6.20													
7																	
8																	
9																	
10		End of Borehole Auger Refusal		46.46 9.70													

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-05

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 23, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	20 40 60 80				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ●		WATER CONTENT PERCENT					
								20 40 60 80		20 40 60 80							
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		56.91													
		TOPSOIL		0.00													
		Dark brown to black silty sand, some gravel, trace brick (FILL)		0.13	1	50 DO	24										
		Compact brown medium to fine sand, some silt, some gravel (FILL)		0.30													
		Dark brown to black silty sand, some gravel (FILL)		56.20	2	50 DO	15										
		Loose to compact light brown fine sand, trace silt (FILL)		0.71 56.00													
1				0.91	3	50 DO	7										
2			Compact brown medium to fine SAND, trace silt, gravel		54.81 2.10	4	50 DO	24									
					5	50 DO	21										
3					6	50 DO	>50										
		End of Borehole Auger Refusal Possible Boulder		53.46 3.45													
4																	
5																	
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-06

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 23, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m											
								SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT						
								20	40	60	80	nat V. rem V.	+ ⊕	Q - U -	● ○			10 ⁻⁶
								20	40	60	80							
0		GROUND SURFACE		54.79														
		Loose dark brown silty sand, trace gravel, organics (TOPSOIL)		0.00														
		Loose black silty sand, some gravel, ash, brick, clay (FILL)		0.13	1	50 DO	9											
				54.03														
1		Loose brown fine to medium sand, some gravel, trace silt (FILL)		0.76	2	50 DO	9											
				53.57														
		Loose black silty sand, some gravel, ash, organics (FILL)		1.22														
		Loose brown SILTY SAND, some gravel		53.27	3	50 DO	6											
				53.27														
				1.52														
2				52.66	4	50 DO	53											
		Very dense brown fine to coarse SAND, some gravel, some silt		2.13														
				52.33														
		End of Borehole Auger Refusal		2.46														
3																		
4																		
5																		
6																		
7																		
8																		
9																		
10																		

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-07

SHEET 1 OF 1









LOCATION: See Site Plan

BORING DATE: November 25 & 28, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION				
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m													
								SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT								
								20	40	60	80	nat V. rem V.	+ ⊕	Q - U -			● ○	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴
								20	40	60	80									
0		GROUND SURFACE		54.92																
	Power Auger 200 mm Diam. (Hollow Stem)	Compact dark brown silty sand, trace gravel, organics (TOPSOIL)		54.92																
		Compact black silty sand, some gravel, ash, slag, organics (FILL)		0.18	1	50 DO	12													
1		Compact to loose brown fine to coarse sand, some gravel, trace silt, occasional brown silt pockets (FILL)		54.01	2	50 DO	19													
					0.91	3	50 DO	6												
2					53.09	4	50 DO	5												
			Loose dark brown silty sand, some gravel, trace to some clay, organics, wood, ash, with brown clayey silt layers (FILL)		52.48	5	50 DO	8												
			Loose dark grey silty clay to clayey silt, trace sand (FILL)		52.18	6	50 DO	94												
			Loose to very dense brown silty sand, some gravel (FILL)		2.89	7	50 DO	127												
3			Very dense to dense grey to brown fine to coarse SAND, some gravel, trace to some silt, with brown medium to coarse sand, trace to some fine sand, trace silt layers, with cobbles and boulders		52.18	8	50 DO	41												
					2.74	9	50 DO	50												
4						52.18	10	50 DO	51											
						52.18	11	50 DO	43											
5						52.18	12	50 DO	63											
						52.18	13	50 DO	63											
6						52.18	14	50 DO	46											
					52.18	15	50 DO	>50												
9		Compact to dense brown medium to coarse SAND, some gravel, trace fine sand, trace silt		46.38																
				8.54																
		End of Borehole Auger Refusal Possible Bedrock		45.95																
				8.97																
10																				

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-08

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 30, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION			
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m													
								SHEAR STRENGTH				WATER CONTENT PERCENT								
								Cu, kPa		nat V. + Q - rem V. ⊕ U - ⊙		Wp		W				Wi		
								20	40	60	80			10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³			
									20	40	60	80			20	40	60	80		
0		GROUND SURFACE		54.29																
	Power Auger 200 mm Diam. (Hollow Stem)	Loose dark brown silty sand and sandy silt, trace gravel, organics (TOPSOIL)		0.00																
				0.13																
		Loose dark brown to black silty sand, some gravel, brick (FILL)		53.88	1	50 DO	8													
				0.41																
		Loose brown silty sand to sandy silt, trace to some gravel (FILL)		53.68																
				0.61																
		Compact brown fine to coarse sand, some gravel, trace to some silt, occasional silty sand seam (FILL)																		
1						2	50 DO	17												
						3	50 DO	16												
2																				
					4	50 DO	15													
		Very loose black silty ORGANICS		51.85																
				2.44																
		Firm grey SILTY SAND, trace sand, trace gravel		2.59	5	50 DO	12													
				2.74																
3		Compact to very dense grey SILTY SAND, some gravel, with cobbles and boulders																		
					6	50 DO	<100													
4					7	50 DO	59													
					8	50 DO	<100													
				49.77																
		End of Borehole Auger Refusal		4.52																
5																				
6																				
7																				
8																				
9																				
10																				

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-09

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 23, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m												
								SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT							
								20	40	60	80	nat V. rem V.	+ ⊕	Q - U -	● ○			10 ⁻⁶	10 ⁻⁵
								20	40	60	80		20	40	60	80			
0		GROUND SURFACE		56.83															
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL		0.00															
		Dark brown to black silty sand (FILL)		0.13															
		Compact dark brown silty sand (FILL)		0.30	1	50 DO	33												
				56.22															
		Loose black silty sand, trace brick and glass (FILL)		0.61															
				55.84	2	50 DO	12												
1		Loose medium to fine brown sand, trace silt (FILL)		0.99															
					3	50 DO	9												
				54.95															
2		Compact medium to fine brown to grey sand, some silt and gravel, trace brick (FILL)		1.88	4	50 DO	39												
				5	50 DO	32													
3			53.78																
		Brown to grey SILTY SAND, trace gravel and clay		3.05	6	50 DO	>50												
		COBBLES and BOULDERS		53.59															
				3.24															
4				52.85	7	50 DO	>60												
		End of Borehole Auger Refusal		3.98															
5																			
6																			
7																			
8																			
9																			
10																			

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-10

SHEET 1 OF 1





LOCATION: See Site Plan

BORING DATE: November 23, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	RESISTANCE, BLOWS/0.3m				k, cm/s					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ⊙		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
0		GROUND SURFACE		54.76													
	Power Auger 200 mm Diam. (Hollow Stem)	Loose dark brown sandy silt, trace gravel, organics (TOPSOIL)		54.58													
		Loose black silty sand, some gravel, ash, slag (FILL)		0.18	1	50 DO	8										
1						2	50 DO	8									
			Very loose brown fine to medium sand, trace to some silt, some gravel, with black silty sand, organic layers (FILL)		53.59												
					1.17												
		Compact to very dense brown SILTY SAND, some gravel		52.93													
2				1.83	4	50 DO	11										
					5	50 DO	41										
3																	
					6	50 DO	>50										
		End of Borehole Auger Refusal		51.33													
				3.43													
4																	
5																	
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-11

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 24 & 25, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20 40 60 80				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
								nat V. + Q - rem V. ⊕ U -				Wp W Wi					
0		GROUND SURFACE		54.84													
	Power Auger 200 mm Diam. (Hollow Stem)	Compact dark brown silty sand, trace gravel, organics (TOPSOIL)		0.00													
		Compact black silty sand, some gravel, mortar, ash, slag (FILL)		0.08	1	50 DO	13										
		Compact brown fine to medium sand, trace gravel, trace silt, some coarse sand, occasional brown silt pocket, occasional black silty sand layer (FILL)		54.21													
				0.63													
1			Compact brown fine to coarse sand, trace silt, trace to some gravel, occasional brown silt pocket (FILL)		53.90	2	50 DO	6									
				0.94													
						3	50 DO	26									
2			Loose grey silty clay, trace gravel, trace sand, black staining, occasional grey silty sand layer (FILL)		53.01	4	50 DO	8									
					1.83												
			Loose dark brown to black silty ORGANICS		52.25												
				2.59	5	50 DO	6										
				2.74													
		Loose grey brown SILTY CLAY and CLAYEY SILT, trace sand		2.82													
3		Loose grey SILTY SAND, some gravel		51.79													
				3.05													
		Compact to very dense brown to grey fine to coarse SAND, trace to some gravel, trace to some silt			6	50 DO	28										
					7	50 DO	40										
					8	50 DO	36										
5					9	50 DO	36										
				49.35													
		Compact to very dense brown medium to coarse SAND, some gravel, trace fine sand, trace silt, occasional fine to medium sand layer, with cobbles and boulders		5.49	10	50 DO	21										
6				48.59													
		Very dense fine to coarse grey and brown SAND, some gravel, trace to some silt, with cobbles and boulders (GLACIAL TILL)		6.25	11	50 DO	53										
				47.98													
		Very dense brown silty fine SAND, occasional grey silt seam (GLACIAL TILL)		6.86	12	50 DO	100										
7				7.01													
		Very dense grey SILTY SAND, some gravel, with cobbles and boulders (GLACIAL TILL)			13	50 DO	>50										
				47.07													
8		End of Borehole Auger Refusal		7.77													
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

SHEET 1 OF 1

DATUM: Geodetic

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

MIS-BHS 001 111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

CHECKED: JW

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-13

SHEET 1 OF 1







LOCATION: See Site Plan

BORING DATE: November 22, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s					ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT						
								nat V. + Q - rem V. ⊕ U - ○				Wp — W — Wi						
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³	20		
0		GROUND SURFACE		56.59														
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL		0.00														
		Dark brown to black silty sand, trace gravel and brick (FILL)		0.15	1	50 DO	9											
1					2	50 DO	17											
		Loose to compact medium to fine brown sand, trace gravel and silt (FILL)		55.37 1.22	3	50 DO	4											
2					4	50 DO	14											
					5	50 DO	14											
3					6	50 DO	46											
		Dense coarse brown to black SAND and GRAVEL, trace cobbles and silt		52.93 3.66	7	50 DO	30											
4					8	50 DO	33											
5					9	50 DO	55											
6					10	50 DO	50											
					11	50 DO	19											
7			Cobbles and boulders (GLACIAL TILL)		49.63 6.96	12	50 DO	>80										
						13	50 DO	105										
8		End of Borehole Auger Refusal		48.61 7.98	14	50 DO	>50											
9																		
10																		

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-14

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 22 & 23, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION				
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	20 40 60 80				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³									
								SHEAR STRENGTH Cu, kPa				nat V. + Q - rem V. ⊕ U - ○						WATER CONTENT PERCENT			
								20 40 60 80				Wp — W — Wl									
0		GROUND SURFACE		55.28																	
	Power Auger 200 mm Diam. (Hollow Stem)	Compact dark brown silty sand, some gravel, organics (TOPSOIL)		0.00	1	50 DO	26														
		Compact dark brown fine to medium sand, some gravel, asphalt pieces (FILL)		54.95 0.33																	
		Compact black to dark brown silty sand, some gravel, ash, coal (FILL)		54.54 0.74	2	50 DO	22														
1				54.06 1.22																	
		Compact brown fine to medium sand, some silt (FILL)		53.66 1.62	3	50 DO	13														
		Compact black silty sand, some gravel, ash (FILL)		53.45 1.83																	
		Compact dark brown sandy silt, some clay, trace to some gravel, organics, occasional brown fine to medium sand, occasional grey brown clayey silt to silty clay layers (FILL)		52.84 2.44	4	50 DO	14														
2			Very loose to dense grey brown fine to medium SAND, some silt, trace gravel		5	50 DO	2														
3				51.93 3.35	6	50 DO	33														
		Dense to compact to very dense brown medium to coarse SAND, some gravel, trace fine sand, trace silt			7	50 DO	15														
4				8	50 DO	85															
5		Very dense grey fine to coarse sand, some gravel, some silt, with cobbles and boulders (GLACIAL TILL)		50.40 4.88	9	50 DO	102														
				49.77																	
6		End of Borehole Auger Refusal		5.51																	
7																					
8																					
9																					
10																					

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-15

SHEET 1 OF 1







LOCATION: See Site Plan

BORING DATE: November 24, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m												
								SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT							
								20	40	60	80	nat V. rem V.	+ ⊕	Q - U -	● ○			10 ⁻⁶	10 ⁻⁵
								20	40	60	80								
0		GROUND SURFACE		54.87															
	Power Auger 200 mm Diam. (Hollow Stem)	Compact dark brown silty sand, trace gravel, organics (TOPSOIL)		0.05															
		Compact black silty sand, some gravel, ash (FILL)		54.54 0.33	1	50 DO	10												
		Compact to very loose brown fine to medium sand, some coarse sand, trace to some gravel, trace to some silt, occasional brown silt pockets, occasional cobble (FILL)			2	50 DO	14												
1				53.55 1.32	3	50 DO	4												
		Very loose dark brown and black silty sand, trace gravel, trace clay, occasional grey silty clay to clayey silt layers (ORGANICS)			4	50 DO	4												
2				52.43 2.44	5	50 DO	9												
		Loose dark brown to black fine to medium SAND, some silt, some gravel, organics			6	50 DO	57												
3			Very dense to compact grey to brown SILTY SAND, some gravel, occasional cobble and boulder, with fine to medium sand, some gravel, some silt layers		51.82 3.05	7	50 DO	14											
4				50.35 4.52	8	50 DO	>50												
		End of Borehole Auger Refusal																	
5																			
6																			
7																			
8																			
9																			
10																			

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-16

SHEET 1 OF 1






LOCATION: See Site Plan

BORING DATE: November 28 & 29, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m										
								SHEAR STRENGTH				WATER CONTENT PERCENT					
								Cu, kPa		nat V. + Q - rem V. ⊕ U - ○		Wp		W			
								20	40	60	80	20	40	60	80		
0		GROUND SURFACE		54.61													
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL		0.00													
		Compact black silty sand, some gravel, trace ash, brick, occasional layers of fine to medium brown sand and gravel (FILL)		0.15	1	50 DO	12										
				2	50 DO	22											
1				53.39													
		Very loose black coarse sand, some ash, gravel, trace silt and brick (FILL)		1.22	3	50 DO	5										
				2													
		Very loose brown to grey coarse sand, trace silt and gravel (FILL)		52.78													
				1.83	4	50 DO	4										
					5	50 DO	5										
3																	
	Compact medium to fine grey SAND, trace silt, trace gravel		51.26	6	50 DO	19											
			3.35														
				7	50 DO	18											
4																	
				8	50 DO	12											
5																	
6																	

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-17

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 21, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION									
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT													
								20		40		60		80			10 ⁻⁶		10 ⁻⁵		10 ⁻⁴		10 ⁻³		
								SHEAR STRENGTH Cu, kPa		nat V. rem V.		+ ⊕		Q - U			● - ○		Wp		W		WI		
								20	40	60	80			20	40	60	80								
0		GROUND SURFACE		56.66																					
	Power Auger 200 mm Diam. (Hollow Stem)	Compact dark grey crushed stone with organics (FILL)		0.00																					
		Compact brown to dark brown silty sand, some gravel, trace clay, brick (FILL)		0.13	1	50 DO	17																		
				56.05																					
		Compact dark brown and black silty sand to sandy silt, some gravel, ash, brick (FILL)		0.61																					
1				55.67	2	50 DO	22																		
		Compact brown sand, some silt, some gravel, with grey brown silty clay layers (FILL)		0.99																					
				54.98	3	50 DO	14																		
				1.68																					
2			Loose to very loose grey brown SILTY CLAY, trace to some sand, trace gravel, occasional sand pockets			4	50 DO	7																	
						5	50 DO	4																	
3																									
				53.46																					
				3.20	6	50 DO	16																		
4			Very dense to loose brown SAND, trace to some silt, some gravel, occasional cobble and boulder, occasional coarse sand layers, occasional silty sand layers, occasional fine sand layers			7	50 DO	34																	
					8	50 DO	46																		
5					9	50 DO	26																		
					10	50 DO	4																		
6					11	50 DO	62																		
					12	50 DO	27																		
7					13	50 DO	104																		
				48.89																					
			7.77		14	50 DO	>100																		
8		Very dense grey SANDY SILT, some gravel, trace clay (GLACIAL TILL)																							
				48.07																					
			8.59	15	50 DO	>70																			
9		End of Borehole Auger Refusal Possible Bedrock																							
10																									

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-18

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 22, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m										
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ⊙		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
								20	40	60	80	20	40	60	80		
0		GROUND SURFACE		56.83													
	Power Auger 200 mm Diam. (Hollow Stem)	Compact dark brown silty sand, trace gravel, organics (TOPSOIL)		0.00													
		Compact dark brown to brown fine to medium sand, some gravel, some silt, ash, brick, with occasional brown clayey silt layers, some sand, trace gravel (FILL)		0.13	1	50 DO	18										
1					2	50 DO	22										
		Compact to dense dark brown to black fine to medium sand, some gravel, some silt, brick, ash, organics, occasional grey brown silty clay layers (FILL)		55.69													
				1.14	3	50 DO	11										
2					4	50 DO	>50										
				54.39													
		Compact grey fine to medium sand, some gravel, some silt, brick (FILL)		2.44													
		Compact black silty sand, some gravel, ash (FILL)		2.59	5	50 DO	16										
3			Compact brown fine to coarse sand, some gravel, trace silt (FILL)		53.93												
			Compact dark brown to black silty sand, some gravel, ash, coal (FILL)		2.90												
			Compact grey brown SILTY CLAY to CLAYEY SILT, some sand, trace gravel, occasional fine to coarse sand layer		3.05	6	50 DO	14									
					53.48												
					3.35												
4		Loose brown sandy silt, some clay, trace to some gravel (FILL)		52.61													
		Loose black silty ORGANICS		4.22	8	50 DO	7										
		Loose to dense brown fine to medium SAND, trace to some silt, trace gravel		52.41													
				4.42													
				4.57													
5		Dense to loose brown medium to coarse SAND, trace gravel, trace silt, trace fine sand		51.65	9	50 DO	30										
				5.18													
6					10	50 DO	6										
		Very loose brown fine to medium SAND, trace silt		50.73													
				6.10	11	50 DO	4										
7					12	50 DO	19										
		Very loose to compact brown medium to coarse SAND, trace fine sand, trace silt, occasional fine to medium sand layer		49.51													
				7.32	13	50 DO	1										
8																	
					14	50 DO	11										
		End of Borehole Auger Refusal		48.29													
				8.54													
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-19

SHEET 2 OF 3

LOCATION: See Site Plan

BORING DATE: November 25 & December 15, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH		WATER CONTENT PERCENT					
								Cu, kPa	nat V. rem V.	+ ⊕	- ⊖	Wp	W		
10	Rotary Drill N.Q. Core	--- CONTINUED FROM PREVIOUS PAGE --- Fresh, grey LIMESTONE BEDROCK		44.17 11.86	C3	NQ RC	DD								
11		C4			NQ RC	DD									
12		End of Borehole													
13															
14															
15															
16															
17															
18															
19															
20															

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF DRILLHOLE: 11-19

SHEET 3 OF 3

LOCATION: See Site Plan

DRILLING DATE: November 25 & December 15, 2011

DATUM: Geodetic

INCLINATION: -90° AZIMUTH: ---

DRILL RIG: CME 850

DRILLING CONTRACTOR: Marathon Drilling

DEPTH SCALE METRES	DRILLING RECORD	DESCRIPTION	SYMBOLIC LOG	ELEV.		RUN No.	COLOUR	FLUSH	RECOVERY				FRACT. INDEX PER 0.3 m	DISCONTINUITY DATA				HYDRAULIC CONDUCTIVITY				Diametral Point Load Index (MPa)	RMC -Q' AVG.						
				DEPTH (m)					JN - Joint FLT - Fault SHR- Shear VN - Vein CJ - Conjugate	BD- Bedding FO- Foliation CO- Contact OR- Orthogonal CL - Cleavage	PL - Planar CU- Curved UN- Undulating ST - Stepped IR - Irregular	PO- Polished K - Slickensided SM- Smooth Ro - Rough MB- Mechanical Break		BR - Broken Rock	NOTE: For additional abbreviations refer to list of abbreviations & symbols.	TOTAL CORE %	SOLID CORE %	R.Q.D. %	TYPE AND SURFACE DESCRIPTION	Jr	Ja			Jn	K, cm/sec	10 ³	10 ²	10 ¹	10 ⁰

8		BEDROCK SURFACE		48.03																			
		Cobbles and boulders (GLACIAL TILL)		8.00	C1																		
9					C2																		
		Fresh, grey LIMESTONE BEDROCK		46.50																			
10				9.53	C3																		
11					C4																		
12		End of Drillhole		44.17																			
				11.86																			
13																							
14																							
15																							
16																							
17																							
18																							

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-RCK 004 1111220199.GPJ GAL-MISS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-20

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 28, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH		WATER CONTENT PERCENT					
								Cu, kPa	nat V. rem V.	+ ⊕	- ⊖	Wp	W		
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		54.88											
		TOPSOIL		54.70											
		Compact dark brown to black silty sand, some gravel, trace ash and brick (FILL)		0.18	1	50 DO	28								
1					2	50 DO	24								
					3	50 DO	>50								
2		End of Borehole Auger Refusal		53.30											
				1.58											
3															
4															
5															
6															
7															
8															
9															
10															

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-20A

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: December 1, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	RESISTANCE, BLOWS/0.3m				k, cm/s					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ○		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
0		GROUND SURFACE		54.88													
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL		54.70													
		Compact dark brown to black silty sand, some gravel, trace ash and brick (FILL)		0.18													
1																	
					53.66												
		Compact to dense brown to grey fine to medium sand, trace silt, some gravel, concrete, asphalt (FILL)		1.22	1	50 DO	21										
2																	
					52.75												
		Dense to loose dark brown with black silty sand, trace to some gravel, trace clay, ash, mica, organics, brick (FILL)		2.13	2	50 DO	35										
3																	
					51.83												
		Compact grey brown clayey silt to silty clay, trace to some sand, trace gravel, wood, sheen, odours (FILL)		3.05													
					51.53												
		Compact black fine to medium sand, trace silt, trace gravel, black staining, odours, sheens (ORGANICS)		3.35	4	50 DO	10										
					51.22												
		Compact grey brown fine SAND, with fine to medium sand seams/layers, trace silt		3.66													
4																	
					50.46												
		Compact grey CLAYEY SILT, some silt		4.42													
				4.57													
	Compact grey brown medium to coarse SAND, trace fine sand		50.00	6	50 DO	14											
5																	
				4.88													
	Loose to very dense grey to brown fine to medium SAND, trace to some coarse sand, trace silt			7	50 DO	7											
6																	
				48.55													
		Very dense grey fine to coarse SAND, some gravel, trace silt		6.33													
				48.27													
7		End of Borehole Auger Refusal		6.61													
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-21

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: December 6, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	RESISTANCE, BLOWS/0.3m				k, cm/s					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ○		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
0		GROUND SURFACE		59.07													
	Power Auger 200 mm Diam. (Hollow Stem)	Loose dark brown silty sand, organics (TOPSOIL)		0.00													
		Compact dark brown silty sand, some gravel, brick, organics, ash (FILL)		58.71	1	50 DO	5										
				0.36	2	50 DO	>50										
					3	50 DO	18										
1																	
		Compact to very dense grey brown SILTY SAND, trace to some gravel		57.24	4	50 DO	15										
				1.83	5	50 DO	54										
					6	50 DO	35										
2																	
		Very dense grey brown SILTY SAND, trace to some gravel (GLACIAL TILL)		55.11	8	50 DO	>75										
				3.96	9	50 DO	>150										
					10	50 DO	>102										
3																	
	Very dense grey SILTY SAND to SANDY SILT, trace to some gravel (GLACIAL TILL)		53.89	11	50 DO	>100											
			5.18	12	50 DO	>85											
4																	
	End of Borehole Auger Refusal			52.62													
				6.45													
5																	
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-22

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: December 7, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	RESISTANCE, BLOWS/0.3m				k, cm/s					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ⊙		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
0		GROUND SURFACE		57.34													
	Power Auger 200 mm Diam. (Hollow Stem)	Very loose dark brown silty sand, organics (TOPSOIL)		0.00													
		Very loose grey brown silty sand to sandy silt, trace to some gravel, trace clay, bricks, organics (FILL)		0.13	1	50 DO	3										
1					2	50 DO	4										
					3	50 DO	4										
2		Loose grey brown silty clay, some sand, trace gravel (FILL)		55.51 1.83	4	50 DO	6										
		Loose dark brown to black silty ORGANICS		54.60 2.74	5	50 DO	7										
3		Loose to dense brown silty fine SAND, trace gravel, black staining (odours)		2.90	6	50 DO	48										
		Dense to very dense grey brown SILTY SAND, trace to some gravel, trace clay, black staining (odours), occasional black fine to medium sand layer		53.83 3.51	7	50 DO	>80										
4		Very dense grey brown silty sand to sandy silt, trace to some gravel, occasional fine to coarse sand layer (GLACIAL TILL)		53.27 4.07	8	50 DO	42										
					9	50 DO	170										
5					10	50 DO	>130										
				11	50 DO	>160											
6		End of Borehole Auger Refusal		51.45 5.89													
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-23

SHEET 1 OF 1








LOCATION: See Site Plan

BORING DATE: December 6, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	20 40 60 80				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ○		WATER CONTENT PERCENT					
												Wp — W — Wi					
								20	40	60	80	20	40	60	80		
0		GROUND SURFACE		56.36													
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL		0.00													
		Compact brown fine to medium sand, trace silt, gravel, clay, brick, ash and mortar (FILL)		0.15	1	50 DO	13										
1				2	50 DO	11											
				3	50 DO	15											
2			54.23	4	50 DO	46											
		Compact gravel layer (FILL)		2.13													
		Compact light brown to grey fine to medium sand, some gravel, trace brick, ash and mortar (FILL)		2.29	5	50 DO	18										
3					53.31	6	50 DO	6									
	Loose layers of brick, brown silty sand, mortar, ash, fine to medium dark brown sand, and concrete, construction debris (FILL)		3.05														
			52.75	7	50 DO	7											
4				52.09	8	50 DO	32										
	Loose black silty sand, trace ash, slag, occasional layers of medium brown sand, gravel, brick, clay (FILL)		3.61														
			52.75														
	Compact dark grey SILTY CLAY, trace gravel, trace brick		4.27														
5				51.46													
	End of Borehole Auger Refusal			4.90													
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-24

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: December 5 & 6, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	RESISTANCE, BLOWS/0.3m				k, cm/s					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ○		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴			10 ⁻³
								20	40	60	80	20	40	60	80		
0		GROUND SURFACE		59.48													
	Power Auger 200 mm Diam. (Hollow Stem)	Very loose dark brown silty sand, trace clay, organics (TOPSOIL) Very loose to very dense dark brown silty sand, trace clay, trace gravel, brick, concrete, mortar, ash, metal, slag, concrete slab, grey crushed stone (FILL)		0.00													
0.10				1	50 DO	4											
				2	50 DO	8											
1				3	50 DO	4											
2				4	50 DO	53											
		Very dense to dense brown grey brown SILTY SAND, some gravel, ashes on top of layer		57.35	5	50 DO	34										
2.13																	
3				56.43	6	50 DO	43										
		Dense to very dense grey SILTY SAND, trace to some gravel, black staining (strong odours) (GLACIAL TILL)		3.05	7	50 DO	>70										
4					8	50 DO	175										
5					54.60	9	50 DO	>150									
		Very dense grey SILTY SAND to SANDY SILT, trace to some gravel, odours (GLACIAL TILL)		4.88	10	50 DO	180										
6					11	50 DO	>150										
7					12	50 DO	>100										
					13	50 DO	>50										
8					51.86	14	50 DO	>100									
		Very dense grey SILTY SAND to SANDY SILT, trace to some gravel, slight odours (GLACIAL TILL)		7.62	15	50 DO	134										
9					16	50 DO	125										
			17	50 DO	>100												
10			49.37	18	50 DO	>50											
		End of Borehole Auger Refusal		10.11													
11																	

DEPTH SCALE

1 : 55



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-25

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: December 7, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	RESISTANCE, BLOWS/0.3m				k, cm/s					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ⊙		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
0		GROUND SURFACE		57.24													
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL		0.00													
		Loose to compact brown fine to medium sand, trace silt, gravel, ash, brick and mortar (FILL)		0.15	1	50 DO	7										
1					2	50 DO	9										
			55.72		3	50 DO	14										
		Compact grey clay (FILL)		1.52													
2		Compact dark brown to black silty sand (FILL)		1.68													
					4	50 DO	40										
			54.80														
		Compact brown fine to medium sand, trace gravel, trace concrete (FILL)		2.44													
		54.50		5	50 DO	14											
3		Compact dark brown to black silty sand, some mica fragments (FILL)		2.74													
				53.89		6	50 DO	8									
		Compact to dense grey fine to medium SAND, some gravel, trace silt (GLACIAL TILL)		3.35													
4					7	50 DO	>50										
					8	50 DO	68										
5					9	50 DO	>50										
				52.01													
		End of Borehole Auger Refusal		5.23													
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-26

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: December 6, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	20 40 60 80				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ●		WATER CONTENT PERCENT					
												Wp ———— W ———— Wi					
								20	40	60	80	20	40	60	80		
0		GROUND SURFACE		55.78													
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL		0.00													
		Loose grey clay, some sand (FILL)		0.13													
				55.32	1	50 DO	9										
		Compact dark brown silty sand, some gravel, trace ash, brick and mortar, occasional layers of fine to coarse sand (FILL)		0.46													
1					2	50 DO	38										
					3	50 DO	25										
2					4	50 DO	14										
					5	50 DO	8										
3			Very loose black silty sand, trace ash, brick, wood and gravel, occasional layers of fine sand (FILL)		53.04 2.74												
					6	50 DO	4										
4				7	50 DO	9											
		Very dense grey brown fine to medium SAND, some silt and gravel (GLACIAL TILL)		51.51 4.27	8	50 DO	110										
5				50.78 5.00	9	50 DO	>75										
		End of Borehole Auger Refusal															
6																	
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-28

SHEET 1 OF 3

LOCATION: See Site Plan

BORING DATE: December 8, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	RESISTANCE, BLOWS/0.3m				k, cm/s					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ⊙		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
0		GROUND SURFACE		57.59													
	Power Auger 200 mm Diam. (Hollow Stem)	Very loose brown medium to fine sand (FILL)		0.00	1	50 DO	2										
		Compact black silty sand, some gravel, trace ash (FILL)		57.13 0.46	2	50 DO	17										
1				56.37 1.22													
		Loose to compact brown medium to fine SAND, some gravel, trace silt and brick			3	50 DO	13										
2					4	50 DO	5										
					54.85 2.74												
3			Very dense brown to grey fine to medium SAND, trace gravel and silt (GLACIAL TILL)			5	50 DO	70									
						6	50 DO	>50									
4					7	50 DO	112										
					8	50 DO	119										
5					9	50 DO	>60										
6					10	50 DO	108										
					11	50 DO	>100										
7																	
					12	50 DO	>90										
8		Compact grey SILTY CLAY, some sand, trace gravel (GLACIAL TILL)		49.97 7.62	13	50 DO	80										
					14	50 DO	42										
9	Rotary Drill NQ Core	Grey CLAYEY SILT, some sand, trace gravel, with cobbles and boulders (GLACIAL TILL)		48.75 8.84	C1	NQ RC	DD										
		Fresh, medium bedded, grey LIMESTONE BEDROCK, with thin beds of black shale		48.06 9.53	C2	NQ RC	DD										
10		CONTINUED NEXT PAGE															

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-28

SHEET 2 OF 3


LOCATION: See Site Plan

BORING DATE: December 8, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵		
		--- CONTINUED FROM PREVIOUS PAGE ---													
10	Rotary Drill NQ Core	Fresh, medium bedded, grey LIMESTONE BEDROCK, with thin beds of black shale													
11				C2	NQ RC	DD									
12		End of Borehole Auger Refusal		45.90 11.69											
13															
14															
15															
16															
17															
18															
19															
20															

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF DRILLHOLE: 11-28

SHEET 3 OF 3

LOCATION: See Site Plan

DRILLING DATE: December 8, 2011

DATUM: Geodetic

INCLINATION: -90° AZIMUTH: ---

DRILL RIG: CME 850

DRILLING CONTRACTOR: Marathon Drilling

DEPTH SCALE METRES	DRILLING RECORD	DESCRIPTION	SYMBOLIC LOG	ELEV. DEPTH (m)	RUN No.	COLOUR % RETURN	JN - Joint FLT - Fault SHR- Shear VN - Vein CJ - Conjugate										BD- Bedding FO- Foliation CO- Contact OR- Orthogonal CL - Cleavage										PL - Planar CU- Curved UN- Undulating ST - Stepped IR - Irregular										PO- Polished K - Slickensided SM- Smooth Ro - Rough MB- Mechanical Break										BR - Broken Rock										NOTE: For additional abbreviations refer to list of abbreviations & symbols.																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																						
							RECOVERY			FRACT. INDEX			DISCONTINUITY DATA										HYDRAULIC CONDUCTIVITY			Diametral Point Load			RMC																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																		
							TOTAL CORE %	SOLID CORE %	R.Q.D. %	PER 0.3 m	B Angle	DIP w.r.t. CORE AXIS	TYPE AND SURFACE DESCRIPTION	Jr	Ja	Jn	K, cm/sec	Index (MPa)	-Q' AVG.																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																												
							FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH	FLUSH

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-RCK 004 1111220199.GPJ GAL-MISS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-29

SHEET 1 OF 1









LOCATION: See Site Plan

BORING DATE: December 5, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	RESISTANCE, BLOWS/0.3m				k, cm/s					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ⊙		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
0		GROUND SURFACE		55.66													
	Power Auger 200 mm Diam. (Hollow Stem)	ORGANICS/TOPSOIL		0.00													
		Compact brown fine to medium sand, trace silt, gravel and ash (FILL)		0.15	1	50 DO	11										
				55.05													
1		Loose to compact dark brown to black silty sand, trace ash and gravel (FILL)		0.61													
				53.98	2	50 DO	11										
				1.68													
2		Loose to very loose brown fine to medium SAND															
				53.37	3	50 DO	3										
				2.29													
			Compact dark brown to black SILTY SAND, trace gravel and clay			4	50 DO	5									
					5	50 DO	14										
3		Loose dark brown SAND and GRAVEL		52.61													
				3.05													
				52.05	6	50 DO	6										
				3.61													
4		Compact dark grey to grey SILTY SAND, trace gravel															
					7	50 DO	28										
					8	50 DO	49										
5		Dense dark grey to grey SILTY SAND, trace gravel (GLACIAL TILL)		50.78													
				4.88													
					9	50 DO	90										
					10	50 DO	42										
6				49.49													
				6.17													
		End of Borehole Auger Refusal															
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-31

SHEET 1 OF 1








LOCATION: See Site Plan

BORING DATE: December 2, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20 40 60 80				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
								nat V. + Q - rem V. ⊕ U - ●				Wp — W — Wi					
0		GROUND SURFACE		58.81													
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL		0.00 58.61													
		Compact fine to medium light brown sand, trace silt (FILL)		0.20	1	50 DO	12										
				58.20													
		Loose dark brown silty sand, trace gravel, ash and brick (FILL)		0.61													
				57.64	2	50 DO	7										
1			Very loose construction debris made up of layers of brick, ash, slag, mortar, insulation, and wood (FILL)		1.17												
				56.37	3	50 DO	2										
				2.44													
		Compact light brown to grey fine to medium SAND, trace silt and gravel			5	50 DO	15										
2					6	50 DO	42										
					55.15												
		Dense to very dense grey brown fine to medium SAND, trace silt and gravel (GLACIAL TILL)		3.66													
				7	50 DO	75											
3				8	50 DO	65											
				53.32													
		Very dense grey fine to coarse SAND, some silt, trace gravel (GLACIAL TILL)		5.49													
				52.18													
4				6.63													
5																	
6																	
7		End of Borehole Auger Refusal															
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-32

SHEET 1 OF 1







LOCATION: See Site Plan

BORING DATE: December 5, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s					ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT						
								nat V. + Q - ● rem V. ⊕ U - ○				Wp — W — WI						
								20	40	60	80		10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
								20	40	60	80		20	40	60	80		
0		GROUND SURFACE		56.18														
	Power Auger 200 mm Diam. (Hollow Stem)	TOPSOIL		0.00														
		Loose brown silty sand, some gravel (FILL)		0.15	1	50 DO	8											
				55.57														
1		Loose to compact brown fine to medium sand, some gravel, trace brick, mortar and slag (FILL)		0.61	2	50 DO	9											
						3	50 DO	20										
2						4	50 DO	4										
					53.74													
		Loose brown to black fine to medium silty sand, occasional wood, brick, mortar, ceramic, trace clay (FILL)		2.44	5	50 DO	4											
3																		
				52.83														
		Compact grey SANDY SILT, trace gravel and clay		3.35	6	50 DO	8											
4					7	50 DO	42											
					8	50 DO	34											
5				51.30														
		Dense grey SANDY SILT, trace gravel and clay (GLACIAL TILL)		4.88	9	50 DO	>50											
					10	50 DO	63											
6		End of Borehole		50.21														
				5.97														
7																		
8																		
9																		
10																		

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-33

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: December 8, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m										
								SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20	40	60	80						
0		GROUND SURFACE		62.22													
	Power Auger 200 mm Diam. (Hollow Stem)	Dense dark grey crushed stone (Gravel lot BASE)		0.08	1	50 DO	46										
		Dense brown fine to medium sand, some coarse sand, some gravel, trace silt (Gravel lot SUBBASE)		61.69													
				0.53													
1		Loose to very dense dark brown silty sand, trace to some gravel, brick, wood, organics, concrete, occasional grey silty clay layer (FILL)			2	50 DO	9										
					3	50 DO	60										
					4	50 DO	12										
2					5	50 DO	56										
					59.32												
3		Compact to very dense brown to grey brown SILTY SAND to SANDY SILT, trace to some gravel (GLACIAL TILL)		2.90	6	50 DO	23										
						7	50 DO	48									
4						8	50 DO	74									
						9	50 DO	49									
5						10	50 DO	55									
						11	50 DO	>89									
6						12	50 DO	>100									
7						13	50 DO	>100									
						14	50 DO	>100									
					54.60												
8		Very dense grey brown SILTY SAND, trace to some gravel, occasional grey silt seam, occasional fine to medium sand seam (GLACIAL TILL)		7.62	15	50 DO	>111										
					16	50 DO	>105										
					17	50 DO	>50										
9																	
					18	50 DO	>100										
					19	50 DO	>50										
					20	50 DO	>110										
10	End of Borehole Split Spoon Refusal		52.26 9.96														
11																	

DEPTH SCALE

1 : 55



LOGGED: RI

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-35

SHEET 1 OF 1





LOCATION: See Site Plan

BORING DATE: December 12, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION				
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³						
								SHEAR STRENGTH Cu, kPa				nat V. + Q - rem V. ⊕ U - ○						WATER CONTENT PERCENT			
																		Wp — W — WI			
								20	40	60	80	20	40	60	80						
0		GROUND SURFACE		62.56																	
	Power Auger 200 mm Diam. (Hollow Stem)	Dense grey sand and gravel (Gravel lot BASE)		0.00																	
		Compact brown medium to fine sand, trace gravel (Gravel lot SUBBASE)		62.25 0.31	1	50 DO	52														
1		Compact dark brown to black silty sand, trace gravel, ash, wood, brick, mortar (FILL)		61.65 0.91	2	50 DO	17														
2		Compact brown fine to medium sand, trace gravel (FILL)		60.88 1.68	3	50 DO	19														

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-37

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: December 12, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m												
								SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT							
								20	40	60	80	nat V. rem V.	+ ⊕	Q - U -	● ○			10 ⁻⁶	10 ⁻⁵
								20	40	60	80								
0		GROUND SURFACE		62.76															
	Power Auger 200 mm Diam. (Hollow Stem)	Compact sand and gravel (Gravel lot BASE)		0.00															
		Compact brown medium to fine sand, trace gravel (Gravel lot SUBBASE)		62.46	1	50 DO	29												
				0.30															
1		Loose dark brown to black silty sand, trace gravel, occasional layers of ash, gravel, sandy mortar, glass, construction debris (FILL)		61.85	2	50 DO	20												
				0.91															
					3	50 DO	6												
2		Compact brown medium to fine sand, trace gravel (FILL)		60.63	4	50 DO	34												
				2.13															
		Dense to very dense grey brown SILTY SAND, some gravel, trace cobbles (GLACIAL TILL)		60.32	5	50 DO	73												
				2.44															
3																			
					6	50 DO	>75												
4					7	50 DO	>65												
					8	50 DO	>75												
5																			
					9	50 DO	40												
6					10	50 DO	>50												
				56.23															
				6.53															
7		End of Borehole Auger Refusal																	
8																			
9																			
10																			

DEPTH SCALE

1 : 50



LOGGED: BM

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-38

SHEET 1 OF 1


LOCATION: See Site Plan

BORING DATE: December 19, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT							
								20	40	60	80	nat V. rem V.	+ ⊕	Q - U -	● ○			10 ⁻⁶	10 ⁻⁵
								20	40	60	80								
0		GROUND SURFACE		62.11															
	Power Auger 200 mm Diam. (Hollow Stem)	Compact to dense brown sand and gravel (Gravel lot BASE) Loose to compact brown medium to fine sand, some gravel (Gravel lot SUBBASE)		0.00															
0.10				1	50 DO	35													
		2		50 DO	8														
1				60.89															
		1.22		3	50 DO	15													
2																			
		59.67		4	50 DO	52													
		Very dense grey brown SILTY SAND, some gravel, medium brown sand seams (GLACIAL TILL)		2.44															
			5	50 DO	61														
3																			
			6	50 DO	112														
4																			

DEPTH SCALE

1 : 50



LOGGED: JDR

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-39

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: December 15, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	RESISTANCE, BLOWS/0.3m				k, cm/s					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ⊙		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³		
0		GROUND SURFACE		62.81													
	Power Auger 200 mm Diam. (Hollow Stem)	Compact sand and gravel (Gravel lot BASE)		0.00													
		Compact brown to red sandy silt, trace gravel (FILL)		0.15	1	50 DO	15										
1		Compact to dense light brown fine to medium sand, trace gravel, silt, and mortar (FILL)		61.90 0.91	2	50 DO	20										
2		Dense sandy gravel to brown fine to medium sand and gravel (FILL)		60.68 2.13	4	50 DO	120										
3						5	50 DO	67									
					6	50 DO	99										
		Compact to very dense grey SILTY SAND, some gravel (GLACIAL TILL)		59.15 3.66													
4					7	50 DO	34										
					8	50 DO	27										
5					9	50 DO	33										
					10	50 DO	>50										
6					11	50 DO	>100										
					12	50 DO	>100										
		End of Borehole Auger Refusal		56.46 6.35													
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: BM/JD

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1122-0199

RECORD OF BOREHOLE: 11-40

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: December 16, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	20 40 60 80				10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³					
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ○		WATER CONTENT PERCENT					
								20 40 60 80				Wp — W — Wi 20 40 60 80					
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		62.77													
		Compact red to fine brown sand, some gravel (Gravel lot BASE)		0.00													
				62.39	1	50 DO	13										
		Compact fine to medium brown sand, some gravel, red brick (FILL)		0.38													
1					2	50 DO	19										
				61.55													
		Compact light brown fine to medium sand, trace gravel, silt, red brick (FILL)		1.22													
					3	50 DO	15										
2					4	50 DO	25										
					5	50 DO	51										
3			Very dense grey brown SAND, some gravel, trace silt (GLACIAL TILL)		59.78												
				2.99													
				59.11	6	50 DO	59										
		Very dense grey brown SILTY SAND, some gravel (GLACIAL TILL)		3.66													
4					7	50 DO	100										
					8	50 DO	>50										
					9	50 DO	>100										
5																	
					10	50 DO	187										
6					11	50 DO	>50										
		End of Borehole Auger Refusal		56.52													
				6.25													
7																	
8																	
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: JD

CHECKED: JW

MIS-BHS 001 1111220199.GPJ GAL-MIS.GDT 1/28/13 JEM

PROJECT: 11-1121-0229

RECORD OF BOREHOLE: 13-1

SHEET 1 OF 2

LOCATION: See Site Plan

BORING DATE: March 8, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION					
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	20 40 60 80				10 ⁻⁸ 10 ⁻⁶ 10 ⁻⁴ 10 ⁻²									
								SHEAR STRENGTH Cu, kPa				nat V. + Q - ● rem V. ⊕ U - ○					WATER CONTENT PERCENT Wp — W Wi				
								20 40 60 80				20 40 60 80									
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		58.72											MON. WELL						
		(SP/GP) SAND and GRAVEL, crushed, inferred presence of cobbles and/or boulders; grey, (FILL); non-cohesive, moist, compact		0.00												Silica Sand					
1					1	SS	28														
		(SM) SILTY SAND, some gravel; grey brown; non-cohesive, moist, compact		57.35																	
				1.37																	
2					2	SS	12														
					3	SS	30									Native Backfill and Bentonite Mix					
3																MH					
			(SM) SILTY SAND, some gravel to gravelly, inferred presence of cobbles and/or boulders; grey brown, (GLACIAL TILL); non-cohesive, moist, dense to very dense		55.67												MH				
				3.05																	
4					4	SS	55														
5					5	SS	>50														
6					6	SS	>50								Bentonite Seal						
															Silica Sand						
7																					
	RD NQ																				
8		Borehole continued on RECORD OF DRILLHOLE 13-1		50.75	C1	NO RC	DD								32 mm Diam. PVC #10 Slot Screen						
9																					
10																					

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: MJK

MIS-BHS 001 1111210229-1000.GPJ GAL-MIS.GDT 06/07/13 PLG

PROJECT: 11-1121-0229

RECORD OF BOREHOLE: 13-5

SHEET 1 OF 2

LOCATION: See Site Plan

BORING DATE: March 13, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m											
								SHEAR STRENGTH				WATER CONTENT PERCENT						
								Cu, kPa		nat V. rem V.		+ ⊕ - ⊙		Q - U -			Wp	
							20	40	60	80		10 ⁻⁸	10 ⁻⁶	10 ⁻⁴	10 ⁻²			
							20	40	60	80		20	40	60	80			
0		GROUND SURFACE		55.39														
	Power Auger 200 mm Diam. (Hollow Stem)	(SM) SILTY SAND, trace gravel; brown, (TOPSOIL); non-cohesive, moist		0.00														
		(SP/GP) SILTY SAND and GRAVEL, crushed; grey, (FILL); non-cohesive, moist, dense to loose		0.15	1	SS	12											
1					2	SS	54											
2					3	SS	13											
					4	SS	9											
3			(SM) SILTY SAND, fine; grey brown, (FILL); non-cohesive, moist, very loose		52.49													
					2.90													
		(OL) ORGANIC SILT; dark brown; non-cohesive, moist, very loose		52.19														
				3.20	5	SS	3											
		LIMESTONE		51.86														
				3.53														
4		Borehole continued on RECORD OF DRILLHOLE 13-5																
5																		
6																		
7																		
8																		
9																		
10																		

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: MJK

MIS-BHS 001 1111210229-1000.GPJ GAL-MIS.GDT 06/07/13 PLG

PROJECT: 11-1121-0229

RECORD OF BOREHOLE: 13-6

SHEET 1 OF 2

LOCATION: See Site Plan

BORING DATE: March 14, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION			
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m												
								SHEAR STRENGTH Cu, kPa		nat V.	+ rem V.	Q - U -	● ○	WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁸	10 ⁻⁶	10 ⁻⁴			10 ⁻²	Wp	W
								20	40	60	80								
0		GROUND SURFACE		55.70											MON. WELL				
	Power Auger 200 mm Diam. (Hollow Stem)	ASPHALTIC CONCRETE		0.00															
		(SP/GP) SAND and GRAVEL, crushed; grey, (FILL); non-cohesive, moist, compact to dense		0.08	1	SS	20												
1					2	SS	45												
2		(CI) SILTY CLAY; grey brown, (FILL); cohesive, moist, very stiff		54.33															
		(SM) SILTY SAND and GRAVEL; grey brown, contains orange brick fragments, (FILL); non-cohesive, moist, loose to compact		1.37															
				1.52	3	SS	9												
															</				

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: MJK

MIS-BHS 001 11-11210229-1000.GPJ GAL-MIS.GDT 06/07/13 PLG

PROJECT: 11-1121-0229

RECORD OF BOREHOLE: 13-7

SHEET 1 OF 2


LOCATION: See Site Plan

BORING DATE: March 11, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION									
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH				WATER CONTENT PERCENT													
								20		40		60		80			10 ⁻⁸		10 ⁻⁶		10 ⁻⁴		10 ⁻²		
								SHEAR STRENGTH Cu, kPa		nat V. + rem V. ⊕		Q - ● U - ○		Wp			W		Wi						
								20	40	60	80	20	40	60	80										
0		GROUND SURFACE		55.71																					
	Power Auger 200 mm Diam. (Hollow Stem)	(SP/GP) SAND and GRAVEL, crushed; grey, (FILL); non-cohesive, moist, compact		0.00	1	GRAB																			
1				2	SS	32																			
2		3		SS	20								○												
				(SM) SILTY SAND; grey brown, contains fly ash and orange brick fragments, (FILL); non-cohesive, moist, loose to compact	53.58 2.13	4	SS	10						○											
3																									
													</												

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: MJK

MIS-BHS 001 1111210229-1000.GPJ GAL-MIS.GDT 06/12/13 PLG

INCLINATION: -90° AZIMUTH: --

DRILLING CONTRACTOR: Downing Drilling

DATUM: Geodetic

1 : 50

MIS-RCK 004 111210229-1000.GPJ GAL-MISS.GDT 06/07/13 PLG

PROJECT: 11-1121-0229

RECORD OF BOREHOLE: 13-8

SHEET 1 OF 2

LOCATION: See Site Plan

BORING DATE: March 5, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION			
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	RESISTANCE, BLOWS/0.3m				k, cm/s							
								SHEAR STRENGTH Cu, kPa		nat V. + rem V. ⊕		Q - ● U - ○		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁸	10 ⁻⁶	10 ⁻⁴			10 ⁻²		
0		GROUND SURFACE		55.95											MON. WELL				
	Power Auger 200 mm Diam. (Hollow Stem)	ASPHALTIC CONCRETE		0.00															
		(SP/GP) SAND and GRAVEL, crushed; grey, (BASE); non-cohesive		55.75															
		(SP/GP) SAND and GRAVEL; brown, (FILL); non-cohesive		0.20															
				0.38															
		(SM) SILTY SAND, some gravel, inferred presence of cobbles and/or boulders; grey, contains asphalt fragments, (FILL); non-cohesive, moist, compact		55.19	1	SS	>50												
				0.76															
1																			
2						2	SS	18											
3					3	SS	11												
		(CI) SILTY CLAY; grey brown; cohesive, moist, stiff to very stiff		52.75	4	SS	7												
				3.20															
4		(SM) SILTY SAND, some gravel to gravelly, inferred presence of cobbles and/or boulders; grey, (GLACIAL TILL); non-cohesive, moist, dense to very dense		52.14	5	SS	32												
				3.81															
					6	SS	33												
5		Borehole continued on RECORD OF DRILLHOLE 13-8		51.01															
6																			
7																			
8																			
9																			
10																			

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: MJK

MIS-BHS 001 1111210229-1000.GPJ GAL-MIS.GDT 06/07/13 PLG

SHEET 2 OF 2

DATUM: Geodetic

DRILLING CONTRACTOR: Downing Drilling

[illegible]

CHECKED: MJK

MIS-RCK 004 1111210229-1000.GPJ GAL-MISS.GDT 06/07/13 PLG

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-01

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 28, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH Cu, kPa		WATER CONTENT PERCENT					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵		
0	Power Auger (Hollow Stem)	GROUND SURFACE		55.09											
	200 mm Diam.	Grey LIMESTONE BEDROCK		0.00											
1															
2															
3															
4	Air Rotary Drill 100 mm Diam. (DHH)														
5															
6															
7															
8															
		End of Drillhole		46.91 8.18											
9															
10															

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-02

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 28, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH		nat V. + Q - rem V. ⊕ U - ●		WATER CONTENT PERCENT						
								Cu, kPa				Wp — W — Wi						
								20	40	60	80	20	40	60	80			
0	Power Auger (Hollow Stem) 200 mm Diam.	GROUND SURFACE		55.12														
		Grey LIMESTONE BEDROCK		0.00														
1																		
2																		
3	Air Rotary Drill 100 mm Diam. (DHH)																	
4																		
5																		
6																		
7																		
8		End of Drillhole		47.37 7.75														
9																		
10																		

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-03

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 28, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH		WATER CONTENT PERCENT					
								Cu, kPa	nat V. + rem V. ⊕	Q - U -	Wp	W	WI		
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		53.67											
		Grey LIMESTONE BEDROCK		0.00											
1															
2															
3															
4	Air Rotary Drill 100 mm Diam. (DHH)														
5															
6															
7															
8		End of Drillhole		46.02 7.65											
9															
10															

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-04

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 27, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m											
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ●		WATER CONTENT PERCENT						
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³			
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		54.62				20	40	60	80	20	40	60	80			
		Grey LIMESTONE BEDROCK		0.00														
1																		
2																		
3																		
4	Air Rotary Drill 100 mm Diam. (DHH)																	
5																		
6																		
7																		
8																		
		End of Drillhole		46.49 8.13														
9																		
10																		

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-05

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 27, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION			
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m													
								SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ●		WATER CONTENT PERCENT								
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴	10 ⁻³					
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		53.25																
		Grey LIMESTONE BEDROCK		0.00																
1	Air Rotary Drill 100 mm Diam. (DHH)																			
2																				
3																				
4																				
5																				
6																				
7																				
8																				
9		End of Drillhole		45.12																
				8.13																
10																				

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-06

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 27, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE			SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m											
								SHEAR STRENGTH Cu, kPa		nat V. + Q - ● rem V. ⊕ U - ○		WATER CONTENT PERCENT						
								20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴				10 ⁻³
								20	40	60	80	20	40	60	80			
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		52.13														
		Grey LIMESTONE BEDROCK		0.00														
1	Air Rotary Drill 100 mm Diam. (DHH)																Bentonite Seal	
2																	Silica Sand	
3																		
4																	51 mm Diam. PVC #10 Slot Screen	
5																	Silica Sand	
6																		
7																	Bentonite Seal	
8		End of Drillhole		44.08 8.05														
9																		
10																		

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-08

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: March 28, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. U -		WATER CONTENT PERCENT Wp I — W — WI					
							20	40	60	80	10 ⁻⁶	10 ⁻⁵	10 ⁻⁴			10 ⁻³
0	Power Auger (Hollow Stem) 200 mm Diam.	GROUND SURFACE		51.82												
		Brown fine to medium sand (Placed FILL)		0.00												
		Grey LIMESTONE BEDROCK		51.52 0.30												
1	Air Rotary Drill 100 mm Diam. (DHH)															
2																
3																
4																
5																
6																
7																
8																
		End of Drillhole		43.77 8.05												
9																
10																

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-10

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: August 15, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. U -		WATER CONTENT PERCENT Wp I — W — WI			
								20	40	60	80	10 ⁻⁶	10 ⁻⁵		
0	Powell Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		52.86											
		Grey LIMESTONE BEDROCK		0.00											Concrete
1															
2															
3															Bentonite Seal
4	Air Rotary Drill 100 mm Diam. (DHH)														
5															Silica Sand
6															
7															
8				44.73 8.13											51 mm Diam. PVC #10 Slot Screen
		End of Drillhole													
9															
10															

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-11

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: August 14, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ⊙		WATER CONTENT PERCENT Wp ——— W ——— WI					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵			10 ⁻⁴	10 ⁻³
0	Powdr Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		53.39													
		Grey LIMESTONE BEDROCK		0.00											Concrete		
1																	
2															Bentonite Seal		
3																	
4	Air Rotary Drill 100 mm Diam. (DHH)																
															Silica Sand		
5																	
6																	
7																	
8		End of Drillhole		45.36 8.03											51 mm Diam. PVC #10 Slot Screen		
9																	
10																	

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-12

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: August 14, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH		WATER CONTENT PERCENT					
								Cu, kPa	nat V. + rem V. ⊕	Q - U -	Wp	W	WI		
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		53.64											
		Grey LIMESTONE BEDROCK		0.00											
1															
2															
3															
4	Air Rotary Drill 100 mm Diam. (DHH)														
5															
6															
7															
8		End of Drillhole		45.74 7.90											
9															
10															

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-13

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: August 14, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ● ○		WATER CONTENT PERCENT Wp ——— W ——— WI			
								20	40	60	80	10 ⁻⁶	10 ⁻⁵		
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		53.37											
		Brown fine to medium sand (FILL)		0.00											
1															
2															
		End of Borehole		51.03 2.34											
3															
4															
5															
6															
7															
8															
9															
10															

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-14

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: August 14, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U -		WATER CONTENT PERCENT Wp — W — Wi			
								20	40	60	80	10 ⁻⁶	10 ⁻⁵		
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		53.68											
		Brown fine to medium sand (FILL)		0.00											
1															
2															
3		End of Borehole		51.24 2.44											
4															
5															
6															
7															
8															
9															
10															

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

PROJECT: 12-1122-0198/8000/8100

RECORD OF BOREHOLE: MW 13-15

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: August 14, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	SHEAR STRENGTH Cu, kPa		nat V. + Q - rem V. ⊕ U - ○		WATER CONTENT PERCENT Wp I — W — WI					
								20	40	60	80	10 ⁻⁶	10 ⁻⁵			10 ⁻⁴	10 ⁻³
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		54.03													
		Grey LIMESTONE BEDROCK		0.00													
1	Air Rotary Drill 100 mm Diam. (DHH)																
2																	
3																	
4																	
5																	
6																	
7																	
8		End of Drillhole		46.02 8.01													
9																	
10																	

Bentonite Seal

Silica Sand

51 mm Diam. PVC
#10 Slot Screen

DEPTH SCALE

1 : 50



LOGGED: RI

CHECKED: KPH

MIS-BHS 001 1211220198-8000-8100.GPJ GAL-MIS.GDT 06/10/14 JEM

PROJECT: 13-1125-0103

RECORD OF BOREHOLE: 13-4

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE December 12, 2013

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH		WATER CONTENT PERCENT					
								Cu, kPa	nat V. + rem V. U.	Wp	W	WI			
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		57.19 0.00											
1															
2															
3															
4															
5															
6															
7															
8															
9															
10															

End of Borehole

Note:
Elevation of top of pipe: 58.13 masl

Bentonite Seal

Silica Sand

50 mm Diam. PVC
#10 Slot Screen

DEPTH SCALE

1:50



LOGGED: JD

CHECKED: *JDH*

MIS-BHS 001 1311250103.GPJ GAL-MIS.GDT 8/12/14 JM

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %				
								20	40	60	80	
GROUND SURFACE												
FILL: Crushed stone with silty sand	0.60	AU	1			0	61.67					
FILL: Black topsoil with organic matter, sand and gravel	1.37	SS	2	50	6	1	60.67					
		SS	3	54	4	2	59.67					
		SS	4	17	4							
		SS	5	25	4	3	58.67					
FILL: Brown silty sand, some clay and gravel		SS	6	33	5	4	57.67					
		SS	7	71	15	5	56.67					
		SS	8	42	24							
		SS	9	58	32	6	55.67					
	6.86	SS	10	58	22	7	54.67					
FILL: Black rail bed material, some coal		SS	11	50	10	8	53.67					
		SS	12	42	26							
	9.60	SS	13	75	16	9	52.67					
FILL: Brown silty sand with gravel, some coal and rail bed material		SS	14	86	86	10	51.67					
	11.23	SS	15	71	24	11	50.67					
		SS	16	75	11	12	49.67					
GLACIAL TILL: Compact to very dense, grey silty sand with gravel, cobbles and boulders		SS	17	83	61							
		SS	18	77	93	13	48.67					
	14.33	SS	19	95	72	14	47.67					
End of Borehole												

20 40 60 80 100

Shear Strength (kPa)

▲ Undisturbed △ Remoulded

PROJECT: 18100285

RECORD OF BOREHOLE: 18-01

SHEET 1 OF 2

LOCATION: N 5030415 3; E 365618 8

BORING DATE: July 21-22, 2018

DATUM: CGVD28

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		HEADSPACE ORGANIC VAPOUR CONCENTRATIONS [PPM] ND = Not Detected	HYDRAULIC CONDUCTIVITY, k, cm/s	WATER CONTENT PERCENT Wp — W — Wi	ADDITIONAL LAB TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT ELEV DEPTH (m)	NUMBER	TYPE	HEADSPACE COMBUSTIBLE VAPOUR CONCENTRATIONS [%LEL] ND = Not Detected				
						20 40 60 80	10 ⁻⁹ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻²	20 40 60 80		
0		GROUND SURFACE	65.39							
		FILL/TOPSOIL - SILTY SAND, trace gravel; brown; non-cohesive, moist.	0.00							
		FILL - (SM) SILTY SAND, some gravel to gravelly; brown, contains brick, asphalt and organic matter (rootlets); non-cohesive, moist, compact (15% debris)	0.15	1	SS	20				
1										
		FILL - (CI/CL) SILTY CLAY, trace sand, trace gravel; grey to grey brown, contains asphalt; cohesive, w>PL, firm to stiff (5% debris)	63.87	2	SS	6				
2			1.52							
				3	SS	3				
3										
		FILL - (SP/GP) SAND and GRAVEL, some silt to silty; dark brown, contains asphalt, cobbles and boulders; non-cohesive, moist (20% debris)	60.82	4	SS	>50				
4			4.57							
		FILL - SILTY SAND and GRAVEL; brown to black, contains asphalt, cobbles and boulders; non-cohesive, moist (20% debris)	60.06							
5			5.33							
		FILL - (SC/ML) CLAYEY SILTY SAND to sandy CLAYEY SILT, some gravel; grey, contains cobbles and wood; non-cohesive, w~PL, compact (5% debris)	59.29	5	SS	17				
6			6.10							
		FILL - (CI/CL) SILTY CLAY, trace to some sand; grey, contains wood; cohesive, w>PL, stiff (5% debris)	57.77	6	SS	6				
7			7.62							
		FILL - (SM) SILTY SAND, trace to some gravel; grey to black, contains brick, asphalt, wood and glass; non-cohesive, wet, compact (30-60% debris)	57.31							
8			8.08							
				7	SS	23				
9										
10										
		CONTINUED NEXT PAGE								

DEPTH SCALE

1: 50



GOLDER

LOGGED: SS

CHECKED: WC

MIS-BHS 001 18100285 GPJ GAL-MIS GDT 8/24/18 ZS

PROJECT: 18100285

RECORD OF BOREHOLE: 18-01

SHEET 2 OF 2



LOCATION: N 5030415 3 ; E 365618 8

BORING DATE: July 21-22, 2018

DATUM: CGVD28

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		HEADSPACE ORGANIC VAPOUR CONCENTRATIONS (PPM) \oplus				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/30 m	HEADSPACE COMBUSTIBLE VAPOUR CONCENTRATIONS [%LEL] ND = Not Detected \square				WATER CONTENT PERCENT					
								ND = Not Detected				Wp — W — Wi					
								20 40 60 80				20 40 60 80					
10		— CONTINUED FROM PREVIOUS PAGE —															
	Power Auger 200 mm Diam (Hollow Stem)	FILL - (SM) SILTY SAND: trace to some gravel; grey to black, contains brick, asphalt, wood and glass; non-cohesive, wet, compact (30-60% debris)															
		(0-5% debris)		54.49	8	SS	>50										
11		FILL - (SM) SILTY SAND: medium to coarse, trace gravel; black, contains asphalt and wood; non-cohesive, wet, compact (20% debris)		10.90													
12																	
						9	SS	22									
13																	
14						10	SS	23									
								ND									
15					50.15 15.24	11	SS	>50									
				FILL - (CI) SILTY CLAY: trace sand; grey, contains wood; cohesive, w>PL (No debris)				ND									
16																	
			48.63 16.76	12	SS	>50											
17		(SM/GM) gravelly SILTY SAND: grey, contains cobbles and boulders (GLACIAL TILL); non-cohesive, wet		48.17													
		End of Borehole		17.22													
18																	
19																	
20																	

DEPTH SCALE

1 : 50

**GOLDER**

LOGGED: SS

CHECKED: WC

MIS-BHS 001 18100285.GPJ CAL MIS GDT 8/24/18 ZS

PROJECT: 18100285

RECORD OF BOREHOLE: 18-02

SHEET 1 OF 2

LOCATION: N 5030424 4 ;E 365719 8

BORING DATE: June 11, 2018

DATUM: CGVD28

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		HEADSPACE ORGANIC VAPOUR CONCENTRATIONS [PPM]	HYDRAULIC CONDUCTIVITY, k, cm/s	ADDITIONAL LAB TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT ELEV DEPTH (m)	NUMBER	TYPE	ND = Not Detected 20 40 60 80			
						HEADSPACE COMBUSTIBLE VAPOUR CONCENTRATIONS [%LEL] ND = Not Detected 20 40 60 80	10 ⁻³ 10 ⁻⁴ 10 ⁻⁵ 10 ⁻⁶		
							Wp ——— W ——— WI		
							20 40 60 80		
0		GROUND SURFACE	63.47						
		FILL/TOPSOIL - (ML) sandy SILT, trace gravel; brown; moist	0.00						
			63.17	1	SS	22			
		FILL - (SM) SILTY SAND, some gravel; brown, contains brick; non-cohesive, moist, compact (No debris)	0.30			ND			
1				2	SS	16			
			62.25			ND			
		FILL - (CL) SILTY CLAY, some sand, some gravel; grey, contains brick; cohesive, w~PL (5% debris)	1.22						
			61.62						
		FILL - (GP) sandy GRAVEL; brown, contains asphalt and brick; non-cohesive, moist, compact (5% debris)	1.65	3	SS	17			
2			61.34			ND			
		FILL - (CL/ML) SILTY CLAY to sandy CLAYEY SILT; brown, contains brick and wood; cohesive, w>PL, stiff to very stiff (10-20% debris)	2.13	4	SS	24			
						ND			
				5	SS	24			
						ND			
4				6	SS	8			
						ND			
			58.90						
		FILL - (SM) GRAVEL and SILTY SAND; brown, contains brick; non-cohesive (5% debris)	4.57	7	SS	>50			
5						ND			
			58.14						
		FILL - (CL) SILTY CLAY and GRAVEL, some sand, brown, contains brick; cohesive, moist, compact (5% debris)	5.33	8	SS	13			
						ND			
			57.37						
		FILL - (SM) SILTY SAND, some gravel; grey brown, contains brick, wood and asphalt; non-cohesive, moist, compact (15% debris)	6.10	9	SS	19			
						ND			
			56.61						
		FILL - (CL) sandy SILTY CLAY; grey brown, contains brick and wood; cohesive, w>PL (5% debris)	6.66	10	SS	32			
7									
			55.85						
		FILL - (SM) SILTY SAND, some gravel; grey, contains brick, asphalt, wood and plastic (garbage); non-cohesive, moist, dense to compact (15-20% debris)	7.62	11	SS	45			
8									
				12	SS	12			
			54.33						
		FILL - (SM) SILTY SAND, trace to some gravel; brown, contains brick, asphalt, wood and mortar; non-cohesive, moist to wet, compact (50% debris)	9.14	13	SS	12			
						ND			
10				14	SS	19			
		CONTINUED NEXT PAGE							

DEPTH SCALE

1 : 50



GOLDER

LOGGED: SS

CHECKED: WC

MIS-BHS 001 18100285 GPJ GAL-MIS GDT 8/24/18 Z/S

PROJECT: 18100285

RECORD OF BOREHOLE: 18-02

SHEET 2 OF 2

LOCATION: N 5030424 4 ;E 365719 8

BORING DATE: June 11, 2018

DATUM: CGVD28

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			HEADSPACE ORGANIC VAPOUR CONCENTRATIONS (PPM) \oplus	HYDRAULIC CONDUCTIVITY, k, cm/s	ADDITIONAL LAB TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	ND = Not Detected			10 ⁻⁸ 10 ⁻⁶ 10 ⁻⁴ 10 ⁻²
								HEADSPACE COMBUSTIBLE VAPOUR CONCENTRATIONS [%LEL] ND = Not Detected \square			WATER CONTENT PERCENT Wp ———— W ———— WI
							20 40 60 80	20 40 60 80			
10	Rotary Drill HW Casing	— CONTINUED FROM PREVIOUS PAGE —									
		FILL - (SM) SILTY SAND, trace to some gravel; brown, contains brick, asphalt, wood and mortar; non-cohesive, moist to wet, compact (50% debris)		14	SS	19	ND				
11		FILL - (SM) SILTY SAND, trace to some gravel; grey brown, contains brick, asphalt, wood, glass, ceramic and aluminum; non-cohesive, wet, compact (70% debris)		15	SS	18	ND				
12											
13	FILL - (CL) SILTY CLAY, some sand; grey, contains brick and plastic (garbage); cohesive, w>PL, very stiff (20% debris) FILL - COBBLES and BOULDERS (ROCK FILL) (No debris)		18	SS	>50	ND					
14											
15											

DEPTH SCALE

1 : 50

**GOLDER**

LOGGED: SS

CHECKED: WC

MIS-BHS 001 18100285 GPJ GAL MIS GDT 8/24/18 ZS

PROJECT: 18100285

RECORD OF BOREHOLE: 18-03

SHEET 1 OF 3

LOCATION: N 5030518.9; E 365789.7

BORING DATE: June 6-7, 2018

DATUM: CGVD28

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		HEADSPACE ORGANIC VAPOUR CONCENTRATIONS [PPM]				HYDRAULIC CONDUCTIVITY, k, cm/s	WATER CONTENT PERCENT	ADDITIONAL LAB TESTING	PIEZOMETER OR STANDPIPE INSTALLATION
		DESCRIPTION	STRATA PLOT ELEV DEPTH (m)	NUMBER	TYPE	BLWS/O 30m	ND = Not Detected	20	40	60	80		
0		GROUND SURFACE	62.63										
		FILL/TOPSOIL - (SM) SILTY SAND, some gravel; dark brown; moist	0.00 62.43										
		FILL - (SM) SILTY SAND, some gravel; grey brown, contains brick; non-cohesive, moist (0-5% debris)	0.20	1	SS	25	ND						
			61.87 0.76	2	SS	39	ND						
1		FILL - (SP) SAND; light brown; non-cohesive, moist, dense (No debris)											
			61.11 1.52	3	SS	>10	ND						
2		FILL - (GP) sandy GRAVEL; brown, contains cobbles; non-cohesive, moist, very dense to compact											
				4	SS	51							
3													
				5	SS	14	ND						
4													
				6	SS	25	ND						
5													
				7	SS	16	ND						
				8	SS	>50							
6		FILL - COBBLES and BOULDERS, some sand and gravel; grey (ROCK FILL) (No debris)	57.45 5.18										
				9	RC	DD							
7													
				10	RC	DD							
8													
				11	RC	DD	ND						
9													
				12	RC	DD							
10													

CONTINUED NEXT PAGE

DEPTH SCALE

1:50



GOLDER

LOGGED: SS

CHECKED: WC

MIS-BHS 001 18100285 GPJ GAL-MIS GDT 8/24/18 ZS

PROJECT: 18100285

RECORD OF BOREHOLE: 18-03

SHEET 2 OF 3

LOCATION: N 5030518 9 ;E 365789 7

BORING DATE: June 6-7, 2018

DATUM: CGVD28

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			HEADSPACE ORGANIC VAPOUR CONCENTRATIONS [PPM] \oplus				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV DEPTH (m)	NUMBER	TYPE	BLOWS/0.30m	HEADSPACE COMBUSTIBLE VAPOUR CONCENTRATIONS [%LEL] ND = Not Detected \square				WATER CONTENT PERCENT						
								ND = Not Detected				Wp — W — WI						
							20	40	60	80	10 ⁻⁸	10 ⁻⁶	10 ⁻⁴	10 ⁻²				
							20	40	60	80	20	40	60	80				
10	Rotary Drill HW Casing	— CONTINUED FROM PREVIOUS PAGE — FILL - COBBLES and BOULDERS, some sand and gravel; grey (ROCK FILL) (No debris)														Bentonite Seal		
																	Silica Sand	
11																		
12																32 mm Diam PVC #10 Slot Screen 'B'		
		FILL - (SM) gravelly SILTY SAND, dark brown to black, contains wood; non-cohesive, wet, dense (5% debris)														Silica Sand		
13		Borehole continued on RECORD OF DRILLHOLE 18-03														Bentonite Seal		
14																		
15																		
16																		
17																		
18																		
19																		
20																		

DEPTH SCALE

1 : 50

**GOLDER**

LOGGED: SS

CHECKED: WC

MIS-BHS 001 18100285.GPJ CAL-MIS GDT 8/24/18 ZS

PROJECT: 18100285

RECORD OF DRILLHOLE: 18-03

SHEET 3 OF 3

LOCATION: N 5030518 9 E 365789 7

DRILLING DATE: June 6-7, 2018

DATUM: CGVD28

INCLINATION: -90° AZIMUTH: --

DRILL RIG: CME Track

DRILLING CONTRACTOR: Downing Drilling

DEPTH SCALE METRES	DRILLING RECORD	DESCRIPTION	SYMBOLIC LOG	ELEV DEPTH (m)	RUN No	COLOUR RETURN FLUSH	JN - Joint FLT - Fault SHR- Shear VN - Vein CJ - Conjugate				BD- Bedding FO- Foliation CO- Contact OR- Orthogonal CL - Cleavage				PL - Planar CU- Curved UN- Undulating ST - Stepped IR - Irregular				PO- Polished K - Slickensided SM- Smooth Ro - Rough MB- Mechanical Break				BR - Broken Rock NOTE: For additional abbreviations refer to list of abbreviations & symbols																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																			
							RECOVERY		R Q D %	FRACT INDEX PER 0.25 m avg	DISCONTINUITY DATA				HYDRAULIC CONDUCTIVITY K, cm/sec				Diameter Point Load Index (MPa)																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																							
							TOTAL CORE %	SOLID CORE %			TYPE AND SURFACE DESCRIPTION	J	U	I	R	J	U	I	R	J	U	I	R																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																			
							100 0.00	100 0.00																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																		
		BEDROCK SURFACE		49.59																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																						</

Bentonite Seal

Silica Sand

32 mm Diam PVC
#10 Slot Screen 'A'

Silica Sand

Bentonite Seal

WL in Screen 'A' at
Elev. 52.77 m on
June 26, 2018WL in Screen 'B' at
Elev. 52.97 m on
June 29, 2018

DEPTH SCALE

1 : 50

**GOLDER**

LOGGED: SS

CHECKED: WC

MIS-RCK 004 18100285 GPJ GAL-MISS GDT 8/24/18 ZS

APPENDIX D

D.1 TABLE D.1: SUMMARY OF THE ENCOUNTERED BEDROCK SURFACE AND AUGER (OR SPLIT-SPOON) REFUSAL DEPTH/ELEVATION AND MEASURED RQD VALUES

D.2 TABLE D.2: SUMMARY OF GROUNDWATER LEVELS



Table D.1: Summary of Encountered Bedrock Surface Depth/Elevation, the Measured RQD Values, and Encountered Depths/Elevations of Auger (or Split-Spoon) Refusal at Boreholes

Borehole No.	Approximate Ground Surface Elevation (m)	Approximate Bedrock Surface Depth (m)	Approximate Bedrock Surface Elevation (m)	Comment
MW-05-805	56.05	3.65	52.4	Bedrock was proven by rock coring
MW-05-801	55.59	2.39	53.2	Bedrock was proven by rock coring
MW-05-810	56.09	3.19	52.9	Bedrock was proven by rock coring
MW-05-813	55.73	3.83	51.9	Bedrock was proven by rock coring
MW-05-815	55.42	2.22	53.2	Bedrock was proven by rock coring
MW-08-001	56.56	5.1	51.46	Bedrock was proven by rock coring
BH10-06	55.04	3.07	51.97	Auger refusal
BH10-07	55.38	3.83	51.55	Auger refusal
BH10-08	55.98	6.35	49.63	Limestone bedrock with interbedded shale (RQD of 0)
BH10-09	56.97	7.14	49.83	Auger refusal
BH10-10	57.82	3.94	53.88	Auger refusal
BH10-11	57.86	7.9	49.96	Limestone bedrock with interbedded shale (RQD of 0, 28%, and 36%)
BH10-14	55.85	3.99	51.86	Limestone bedrock with interbedded shale (RQD of 16% and 96%)
BH10-15	55.34	3.38	51.96	Auger refusal
BH10-16	55.72	3.99	51.73	Limestone bedrock with interbedded shale (RQD of 83% and 100%)
BH10-17	56.19	4.11	52.08	Auger refusal
BH10-19	56.42	3.25	53.17	Auger refusal
BH10-20	57.94	5.08	52.86	Auger refusal
BH10-25	55.79	4.14	51.65	Auger refusal
BH10-26	55.27	3.48	51.79	Limestone bedrock with interbedded shale (RQD of 27% and 100%)
BH10-28	56.33	4.24	52.09	Auger refusal
BH10-29	56.8	4.43	52.37	Auger refusal
BH10-30	57.87	6.68	51.19	Limestone bedrock with interbedded shale (RQD of 100% and 91%)
BH11-11	54.5	2.7	51.9	Limestone bedrock with interbedded shale
BH11-21	54.8	0	54.8	Limestone bedrock with interbedded shale (RQD of 30%, 80%, and 90%)
BHW-009	60.44	15.4	45.04	Interbedded sequence of shale and limestone bedrock (RQD of 90%)

Borehole No.	Approximate Ground Surface Elevation (m)	Approximate Bedrock Surface Depth (m)	Approximate Bedrock Surface Elevation (m)	Comment
BHW-11	62.74	13.74	49	Shale bedrock (RQD of 0%, 30%, and 100%)
BHW-012	59.32	10.72	48.6	Shale bedrock (RQD of 90%)
BHW-013	60.97	10.51	50.46	Shale bedrock (RQD of 70%, 30%, and 0)
BHW-015	58.89	9.14	49.75	Shale bedrock (RQD of 20%, 0, 30%, 20%, 0, 80%, 40%, 0, and 100%)
BHW-017	58.02	6.85	51.17	Auger refusal
BHW-018	63.53	n/a	n/a	n/a
MW92-C3	62.25	3.5	58.75	Split spoon refusal on possible bedrock
MW01-7	54.65	5.45	49.2	Severely fractured limestone Bedrock (RQD of 0 and 36%)
MW01-8	62.63	11.55	51.1	Auger refusal on inferred bedrock
MW01-10	59.45	9.14	50.3	Auger refusal on inferred bedrock
MW01-17	66.4	16.6	49.8	Auger refusal on inferred bedrock
MW03-22	54.63	7.23	47.4	Auger refusal on inferred bedrock
MW03-23	55.76	9.7	46	Limestone with occasional shale interbeds bedrock (RQD of 49% and 80%)
BH06-37	63.47	7.2	56.3	Auger refusal
BH10-01	58.26	11	47.26	Limestone bedrock with interbedded shale (RQD of 94%)
BH10-02	57.54	8.74	48.8	Auger refusal
BH10-04	56.57	5.92	50.65	Auger refusal
BH10-05	55.61	5.61	50	Limestone bedrock with interbedded shale (RQD of 9%)
BH11-01	56.36	2.92	53.44	Auger refusal
BH11-03	54.93	5.69	49.24	Auger refusal on possible bedrock
BH11-04	56.16	9.7	46.46	Auger refusal
BH11-05	56.91	3.45	53.46	Auger refusal on possible bedrock
BH11-06	54.79	2.46	52.33	Auger refusal on possible bedrock
BH11-07	54.92	8.97	45.95	Auger refusal on possible bedrock
BH11-08	54.29	4.52	49.77	Auger refusal
BH11-09	56.83	3.98	52.85	Auger refusal
BH11-10	54.76	3.43	51.33	Auger refusal
BH11-11	54.84	7.77	47.07	Auger refusal
BH11-12	54.55	5.18	49.37	Auger refusal

Borehole No.	Approximate Ground Surface Elevation (m)	Approximate Bedrock Surface Depth (m)	Approximate Bedrock Surface Elevation (m)	Comment
BH11-13	56.59	7.98	48.61	Auger refusal
BH11-14	55.28	5.51	49.77	Auger refusal
BH11-15	54.87	4.52	50.35	Auger refusal
BH11-16	54.61	6.43	48.18	Auger refusal
BH11-17	56.66	8.59	48.07	Auger refusal on possible bedrock
BH11-18	56.83	8.54	48.29	Auger refusal
BH11-19	56.03	9.53	46.5	Limestone bedrock (RQD of 70% and 80%)
BH11-20	54.88	1.58	53.3	Auger refusal
BH11-20A	54.88	6.61	48.27	Auger refusal
BH11-21	59.07	6.45	52.62	Auger refusal
BH11-22	57.34	5.89	51.45	Auger refusal
BH11-23	56.36	4.9	51.46	Auger refusal
BH11-24	59.48	10.11	49.37	Auger refusal
BH11-25	57.24	5.23	52.01	Auger refusal
BH11-26	55.78	5	50.78	Auger refusal
BH11-28	57.59	9.53	48.06	Limestone bedrock
BH11-29	55.66	6.17	49.49	Auger refusal
BH11-31	58.81	6.63	52.18	Auger refusal
BH13-1	58.72	3.65	50.75	Coring
BH13-5	55.39		51.86	Limestone bedrock
MW13-1	55.09	0	55.09	Limestone bedrock
MW13-2	55.12	0	55.12	Limestone bedrock
MW13-3	53.67	0	53.67	Limestone bedrock
MW13-4	54.62	0	54.62	Limestone bedrock
MW13-5	53.25	0	53.25	Limestone bedrock
MW13-6	52.13	0	52.13	Limestone bedrock
MW13-6	55.7	4.8	50.9	Limestone bedrock
BH13-7	55.71	5.5	50.21	Limestone bedrock (RQD of 90%, 80%, 90%, 95%, 0, and 60%)
MW13-8	51.82	0.3	51.52	Limestone bedrock
MW13-10	52.86	0	52.86	Limestone bedrock
MW13-11	53.39	0	53.39	Limestone bedrock
MW13-12	53.64	0	53.64	Limestone bedrock
MW13-15	54.03	0	54.03	Limestone bedrock
MW18-3	62.63	13.04	49.59	Limestone bedrock (RQD of 70%, 65%, 90%, 95%, and 85%)

Borehole No.	Approximate Ground Surface Elevation (m)	Approximate Bedrock Surface Depth (m)	Approximate Bedrock Surface Elevation (m)	Comment
BH92-C1	62.02	2.6	59.42	Auger refusal on possible bedrock
BH92-C2	62.44	4.9	57.54	Split spoon refusal on possible bedrock
BH92-C4	62	3.6	58.4	Auger refusal on possible bedrock
BH92-C5	62.66	4.46	58.2	Auger refusal on possible bedrock
BH11-33	62.22	9.96	52.26	Split Spoon Refusal
BH11-35	62.56	4.4	58.16	Auger refusal
BH11-37	62.76	6.53	56.23	Auger refusal
BH11-38	62.11	4.17	57.94	Auger refusal
BH11-39	62.81	6.35	56.46	Auger refusal
BH11-40	62.77	6.25	56.52	Auger refusal
MW13-8	55.95	4.94	51.01	Limestone bedrock (RQD of 90% and 95%)

Note: bedrock surface depth/elevation confirmed by coring are shown with bold font.

Table D.2: Summary of Groundwater Levels

Borehole No.	Approximate Ground Surface Elevation (m)	Groundwater Depth (m)	Approximate Groundwater Elevation (m)	Date of Measurement
MW-05-805	56.1	4.7	51.4	Measured on Nov 14, 2005
		3.8	52.3	Measured on May 2, 2006
MW92-C1	62.0	2.4	59.6	Measured on Feb 18, 1992
MW-05-801	55.6	4.0	51.6	Measured on Nov 14, 2005
		2.4	53.2	Measured on May 2, 2006
MW-05-810	56.1	4.7	51.4	Measured on Nov 14, 2005
		4.7	51.4	Measured on May 2, 2006
MW-05-813	55.7	3.9	51.9	Measured on Nov 14, 2005
		3.6	52.1	Measured on May 2, 2006
MW-05-815	55.4	2.1	53.3	Measured on Nov 14, 2005
		2.2	53.3	Measured on May 2, 2006
MW-05-819	52.6	1.1	51.5	Measured on Nov 14, 2005
		1.1	51.5	Measured on May 2, 2006
MW06-6	55.0	2.1	52.9	N. A / installed on June 20, 2006
MW06-7	55.2	2.5	52.7	N. A / installed on June 20, 2006
MW06-9	61.6	8.1	53.5	N. A / installed on June 21, 2006
MW06-10	55.6	2.8	52.8	N. A / installed on June 21, 2006
MW06-11	56.8	4.0	52.8	N. A / installed on June 21, 2006
BH/MW06-05	62.6	1.6	61.0	N. A / installed on August 2, 2006

Borehole No.	Approximate Ground Surface Elevation (m)	Groundwater Depth (m)	Approximate Groundwater Elevation (m)	Date of Measurement
BH/MW06-06	65.5	1.9	63.6	N. A / installed on August 3, 2006
MW-06-103	62.0	8.6	53.5	Measured on July 25, 2006
MW-06-104	61.4	7.3	54.1	Measured on July 25, 2006
MW-06-105	58.3	5.2	53.1	Measured on July 25, 2006
MW-06-106	59.4	6.6	52.8	Measured on July 25, 2006
MW-06-107	62.2	9.3	52.9	Measured on July 25, 2006
MW-06-108	56.2	3.0	53.3	Measured on July 25, 2006
MW-06-109	63.4	dry	dry	Dry on July 25, 2006
MW-06-110	60.0	6.8	53.3	Measured on July 25, 2006
MW-06-901	57.0	4.9	52.1	Measured on July 25, 2006
MW-08-001	56.6	5.0	51.6	Measured on May 13, 2008
BHW-009	60.4	7.1	53.3	Measured on August 2, 2011
BHW-012	59.3	7.1	54.1	Measured on August 2, 2011
MW92-C3	62.3	< 3.5	<58.8	Dry on Feb 18, 1992
MW01-6	56.1	3.2	52.9	Measured on April 18, 2001
MW01-7	54.7	1.7	53.0	Measured on April 18, 2001
MW01-8	62.6	9.4	53.2	Measured on April 18, 2001
MW03-22	54.6	1.7	52.9	Inferred at the time of drilling (May 30, 2003)
MW03-23	55.8	2.7	53.1	Inferred at the time of drilling (May 30, 2003)
BHW-013	61.0	8.2	52.8	Inferred at the time of drilling (June 23, 2011)
BHW-015	58.9	6.1	52.8	Inferred at the time of drilling (June 14, 2011)
BHW-017	58.0	5.3	52.7	Inferred at the time of drilling (June 14, 2011)
MW13-1	58.7	6.6	52.1	Inferred at the time of drilling (March 8, 2013)
MW13-6	55.7	3.9	51.8	Inferred at the time of drilling (March 14, 2013)
MW13-8	56.0	6.7	49.2	Measured on March 25, 2013
MW18-3	62.6	9.8	52.9	Measured on June 29, 2018