

## Engineering

Land/Site  
Development  
Municipal  
Infrastructure  
Environmental/  
Water Resources  
Traffic/  
Transportation  
Recreational

## Planning

Land/Site  
Development  
Planning Application  
Management  
Municipal Planning  
Urban Design  
Expert Witness  
(LPAT)  
Wireless Industry

## Landscape Architecture

Streetscapes &  
Public Amenities  
Open Space, Parks &  
Recreation  
Community &  
Residential  
Commercial &  
Institutional  
Environmental  
Restoration

## 2510 St. Laurent Boulevard Servicing and Stormwater Management Report

Prepared for: Claridge Homes

**2510 St. Laurent Boulevard**  
**City of Ottawa**  
**Servicing and Stormwater Management Report**

Prepared By:

**NOVATECH**

Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario  
K2M 1P6

November 1<sup>st</sup>, 2022

Revised: May 30, 2023

Revised: September 29, 2023

Revised: January 31, 2024

Revised: August 13<sup>th</sup>, 2024

Novatech File: 122040

Ref: R-2022-191

August 13<sup>th</sup>, 2024

City of Ottawa  
Planning, Infrastructure and Economic Development Department  
Planning and Infrastructure Approvals Branch  
110 Laurier Avenue West, 4<sup>th</sup> Floor  
Ottawa ON, K1P 1J1

**Attention: Kelby Lodoen Unseth, Planner II**

**Reference: 2510 St. Laurent Boulevard  
Servicing and Stormwater Management Report  
Our File No.: 122040**


---

Please find enclosed the 'Servicing and Stormwater Management Report' for the above noted development located in the City of Ottawa. This report is being submitted in support of the site plan application, and Plan of Condominium for the proposed development.

Should you have any questions or require additional information, please contact the undersigned.

Yours truly,

**NOVATECH**

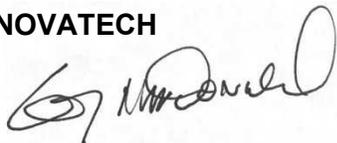

Greg MacDonald, P. Eng.  
Director, Land Development and Public Sector Infrastructure

cc: Vincent Denomme, Claridge Homes

**Table of Contents**

**1.0 INTRODUCTION..... 1**

    1.1 Existing Conditions ..... 1

    1.2 Proposed Development ..... 1

**2.0 SITE CONSTRAINTS..... 2**

**3.0 WATER SERVICING..... 3**

    3.1 Watermain Design Parameters ..... 3

    3.2 Fire Demand..... 4

        3.2.1 2- Storey Townhomes..... 4

        3.2.2 3- Storey Townhomes..... 4

    3.3 Water Demand..... 5

    3.4 System Pressure Modeling and Results..... 6

**4.0 SANITARY SERVICING ..... 6**

**5.0 STORM SERVICING..... 8**

**6.0 STORM DRAINAGE AND STORMWATER MANAGEMENT ..... 9**

    6.1 Design Criteria ..... 9

    6.2 Stormwater Management Modeling ..... 9

        6.2.1 Design Storms ..... 10

        6.2.2 Pre-Development Model – 100-year Allowable Release Rate ..... 10

        6.2.3 Post-Development Model Parameters ..... 11

    6.3 PCSWMM Model Results..... 15

        6.3.1 Summary of Peak Flows ..... 16

        6.3.2 Stormwater Management Systems (Storage)..... 17

        6.3.3 Inlet Control Devices..... 19

        6.3.4 Hydraulic Grade Line (HGL)..... 20

        6.3.5 Major System (Overland Flow)..... 22

    6.4 Stormwater Quality Treatment ..... 23

**7.0 EROSION AND SEDIMENT CONTROL .....24**

**8.0 CONCLUSIONS AND RECOMMENDATIONS .....25**

**9.0 CLOSURE.....26**

**Appendices**

Appendix A Pre - Consultation Meeting Minutes ..... 27  
 Appendix B Water Servicing..... 28  
 Appendix C Sanitary Servicing ..... 29  
 Appendix D Storm Servicing ..... 30  
 Appendix E Stormwater Management..... 31

**Tables**

Table 3-1: Watermain Design Parameters and Criteria ..... 3  
 Table 3-2: Domestic Water Demand Summary..... 5  
 Table 3-3: Water Boundary Conditions..... 5  
 Table 3-4: Water Analysis Summary..... 6  
 Table 4-1: Sanitary Sewer Design Parameters ..... 7  
 Table 6-1: 100-year Allowable Release Rate ..... 10  
 Table 6-2: Subcatchment Parameters ..... 12  
 Table 6-3: 100-year HGL Elevations at Minor System Outfalls ..... 15  
 Table 6-4: Peak Flow Comparison ..... 16  
 Table 6-5: Superpipe Storage ..... 18  
 Table 6-6: Park Storage ..... 18  
 Table 6-7: Perforated Pipe / Trench System (Rear Yards)..... 19  
 Table 6-8: Inlet Control Devices..... 20  
 Table 6-9: 100-year HGL Elevations..... 21  
 Table 6-10: Overland Flow Results ..... 22  
 Table 6-11: Water Quality Treatment Units..... 23

**Figures**

Figure 1 Key Plan  
 Figure 2 Existing Conditions  
 Figure 3 Proposed Site Plan  
 Figure 4 Typical Road Cross-section- 7.0m (Street 2)  
 Figure 5 Typical Road Cross-section– Street 1 Parallel Parking  
 Figure 6 Typical Road Cross-section – Street 3 - Perpendicular Parking (Street 3)

## 1.0 INTRODUCTION

Novatech has been retained to prepare a Servicing and Stormwater Management Report for the proposed condominium development located at 2510 St. Laurent Boulevard, within the City of Ottawa. The proposed site is denoted as part of lots A and 1, concession 4, City of Ottawa. This report is submitted in support the zoning application, site plan application and draft plan of condominium for the subject development. **Figure 1** - Key Plan shows the site location.

### 1.1 Existing Conditions

The subject site is approximately 5.9 hectares (ha.) in size and consists of multiple properties namely 1890, 1900 & 1920 Walkley Road, 2502 & 2510 St. Laurent Boulevard, 2990 & 3000 Conroy Road, and 2425 Don Reid Drive. Historically the site contained four (4) commercial buildings complete with asphalt parking areas. Presently the site is vacant, and covered with vegetation, broken asphalt, and foundation remnants. In the north-east corner of the site there is a private commercial road on the property that provides access to the neighboring commercial buildings addressed 1950 Walkley Road, 1970 Walkley Road, and 2980 Conroy Road.


The site is bound by Walkley Road to the north, an existing commercial plaza to the north-east, Conroy Road to the east, an apartment development to the south-east, St Laurent Boulevard to the south, a commercial office building to the south-west, and Don Reid Drive to the west. The drainage path of the site is not well defined and contains localized depression storage in multiple locations. Overall, the site has a gradual slope from the northwest to the southeast. **Figure 2** shows the existing site conditions.

### 1.2 Proposed Development

It is proposed to develop the site with a private condominium development, a future retirement home/apartment building, and a public park. The future retirement home/apartment block is located in the northwest corner of the site at the intersection of Walkley Road and Don Reid Drive. The future retirement home/apartment will be detailed as part of a separate site plan application and will not be detailed within the following report.

The proposed condominium development will include a total of 155 town home units consisting of sixty-six (66) - 3 storey town homes and eighty-nine (89)-standard 2 storey town homes. The development will include the construction of three (3) new private roads presently named Streets 1 through 3, with a minimum street width of 7.0m. Each unit will have its own garage and driveway to accommodate site vehicle demands in addition to street parking provided on Streets 1 and 3. Access to the site will be provided in three (3) locations, by two (2) entrances on St Laurent Boulevard, and one (1) entrance on Don Reid Drive. The proposed public park will be located in the southwest corner of the property with access from the existing Don Reid Drive and the proposed Street 1. **Figure 3** shows the concept plan for the proposed development, and **Figures 4-6** depict the typical road cross-sections.

Correspondence from the City pre-consultation meeting for the proposed development is included in **Appendix A** for reference.

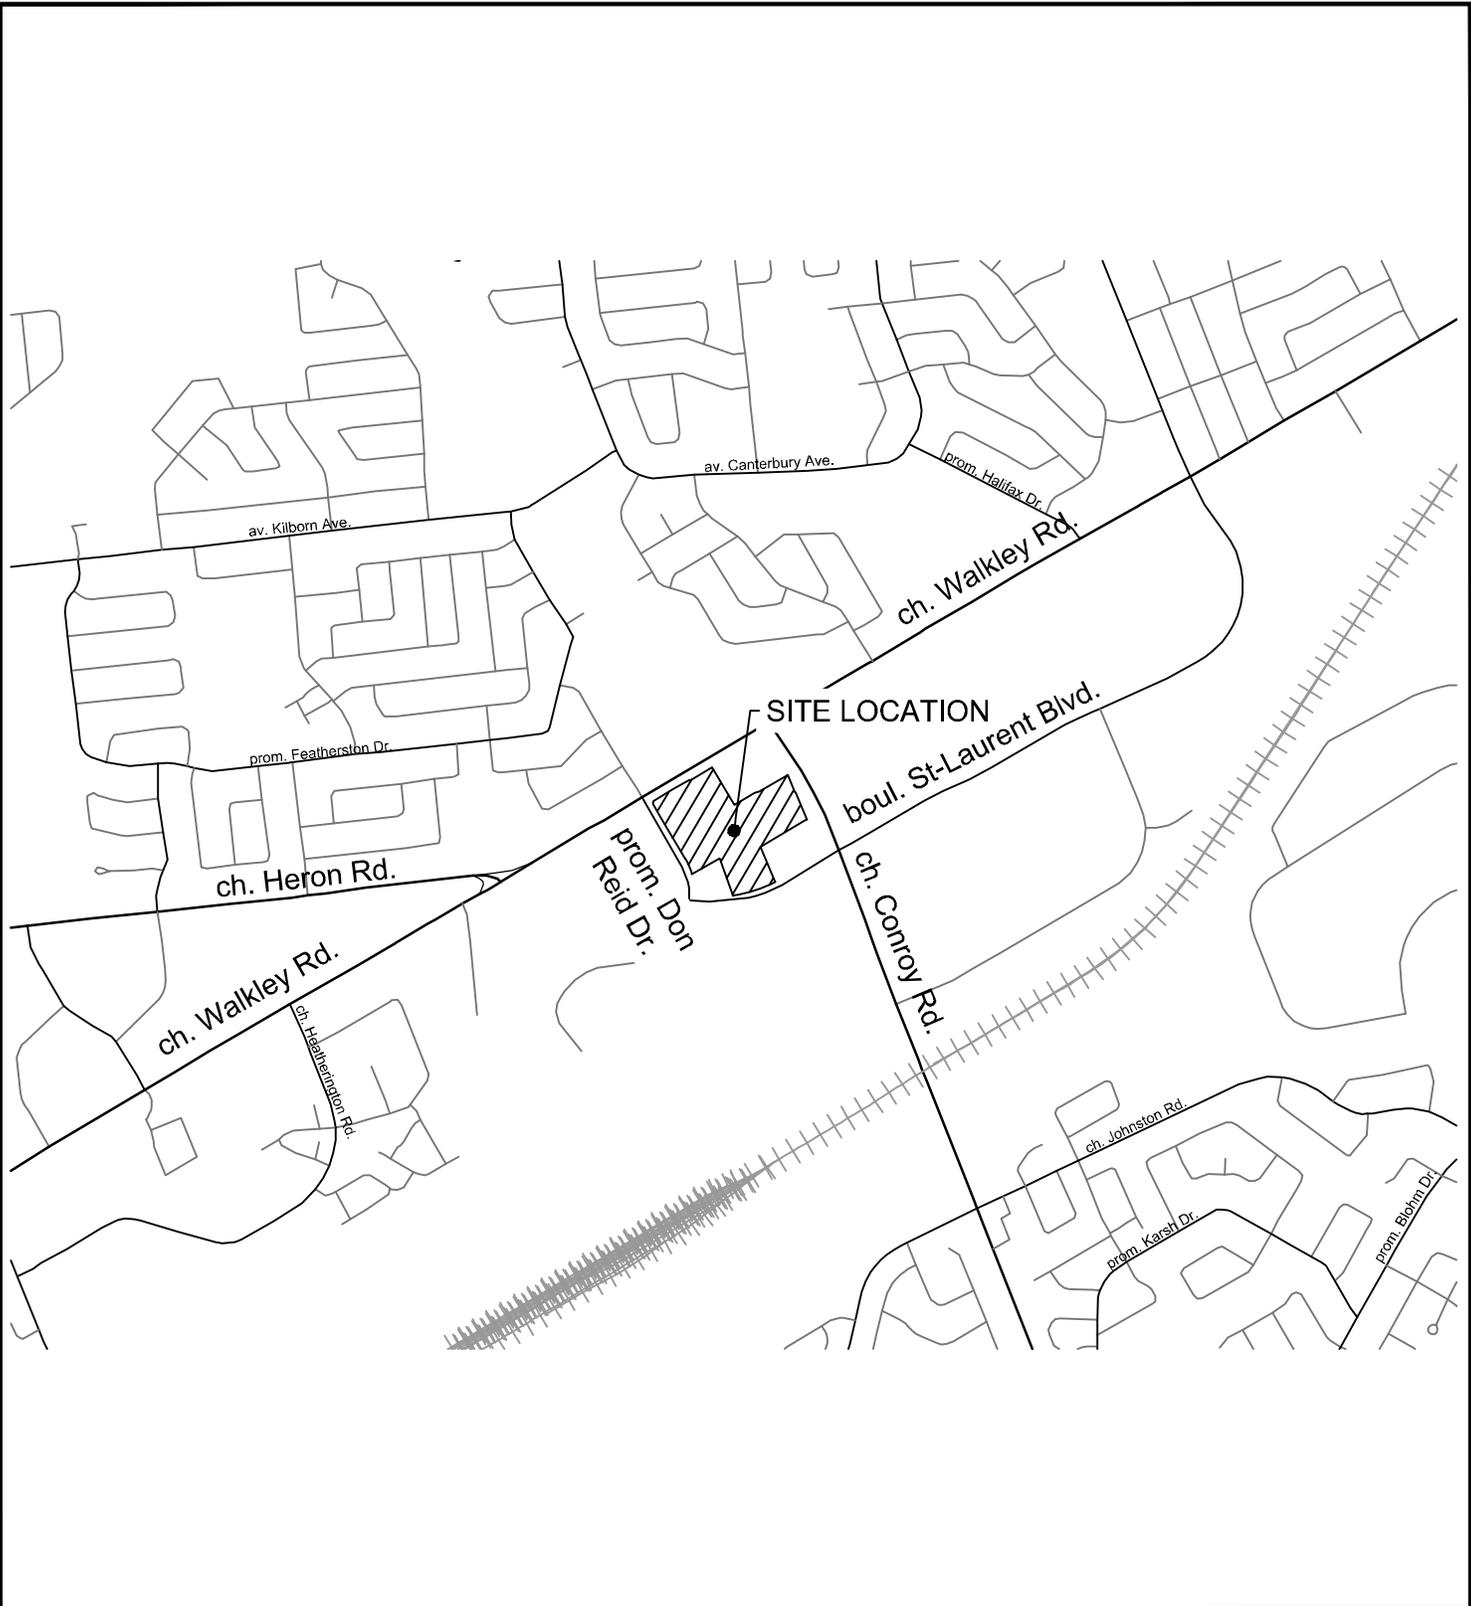

M:\2022\122040\CAD\Civil\122040-KP.dwg, FIGURE 1, Oct 31, 2022 - 10:34am, cferguson



Engineers, Planners & Landscape Architects  
 Suite 200, 240 Michael Cowpland Drive  
 Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
 Facsimile (613) 254-5867  
 Website [www.novatech-eng.com](http://www.novatech-eng.com)



CITY OF OTTAWA  
 2510 St. LAURENT BOULEVARD

**KEY PLAN**

SCALE

N.T.S

DATE

OCT. 2022

JOB

122040

FIGURE

FIGURE 1



**LEGEND**

 PROPOSED DEVELOPMENT BOUNDARY



M:\2022\122040\CAD\Civil\Figures\122040 - PROP RES.dwg, FIGURE 2, Oct 31, 2022 - 12:15pm, cferguson

Microsoft

**NOVATECH**

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website www.novatech-eng.com


CITY OF OTTAWA  
2510 St. LAURENT BOULEVARD

**EXISTING CONDITIONS**

SCALE 1 : 1500 

DATE	JOB	FIGURE
OCT. 2022	122040	FIGURE 2

M:\2022\122040\CAD\Civil\Figures\122040 - PROP RES.dwg, FIGURE 3, Jan 30, 2024 - 4:39pm, amestwarp

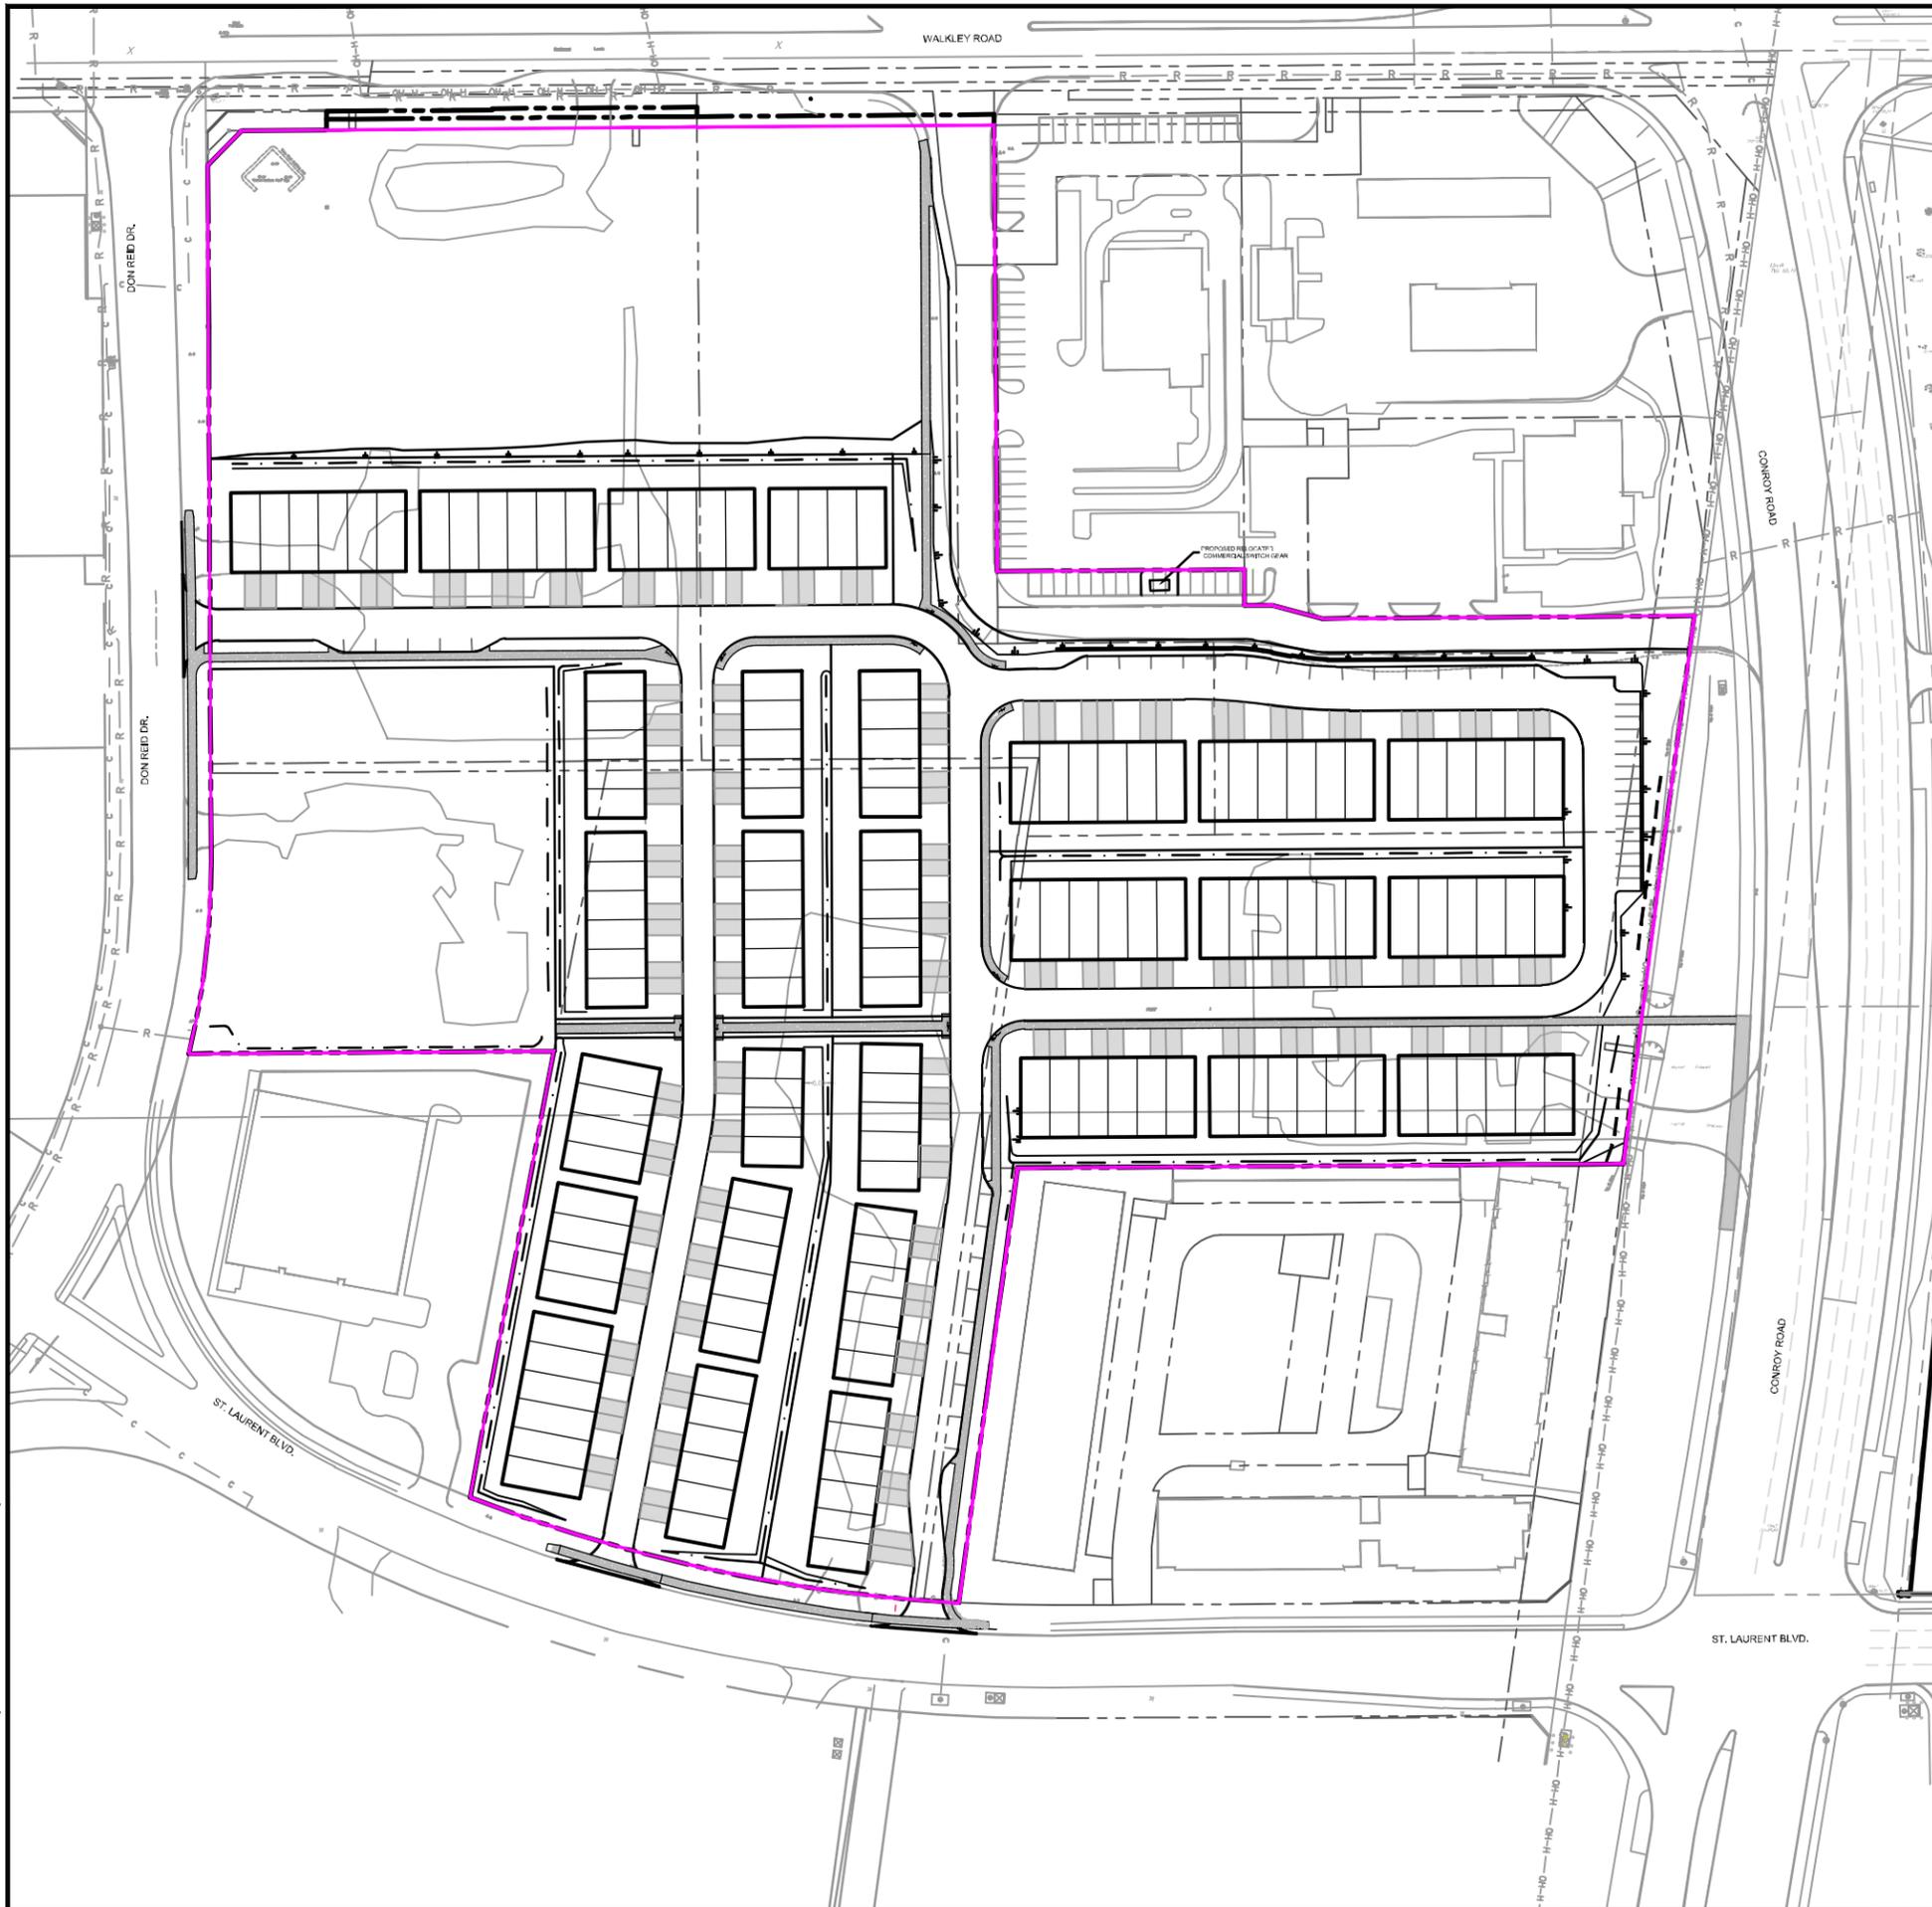

### LEGEND



PROPOSED DEVELOPMENT BOUNDARY



# NOVATECH

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website www.novatech-eng.com

CITY OF OTTAWA  
2510 St. LAURENT BOULEVARD


## PROPOSED SITE PLAN

SCALE 1 : 1500

DATE	JULY 2024	JOB	122040	FIGURE	FIGURE 3
------	-----------	-----	--------	--------	----------



M:\2022\122040\CAD\Civil\122040-ND.dwg, Street1, Jul 05, 2024 - 3:04pm, armestwarp

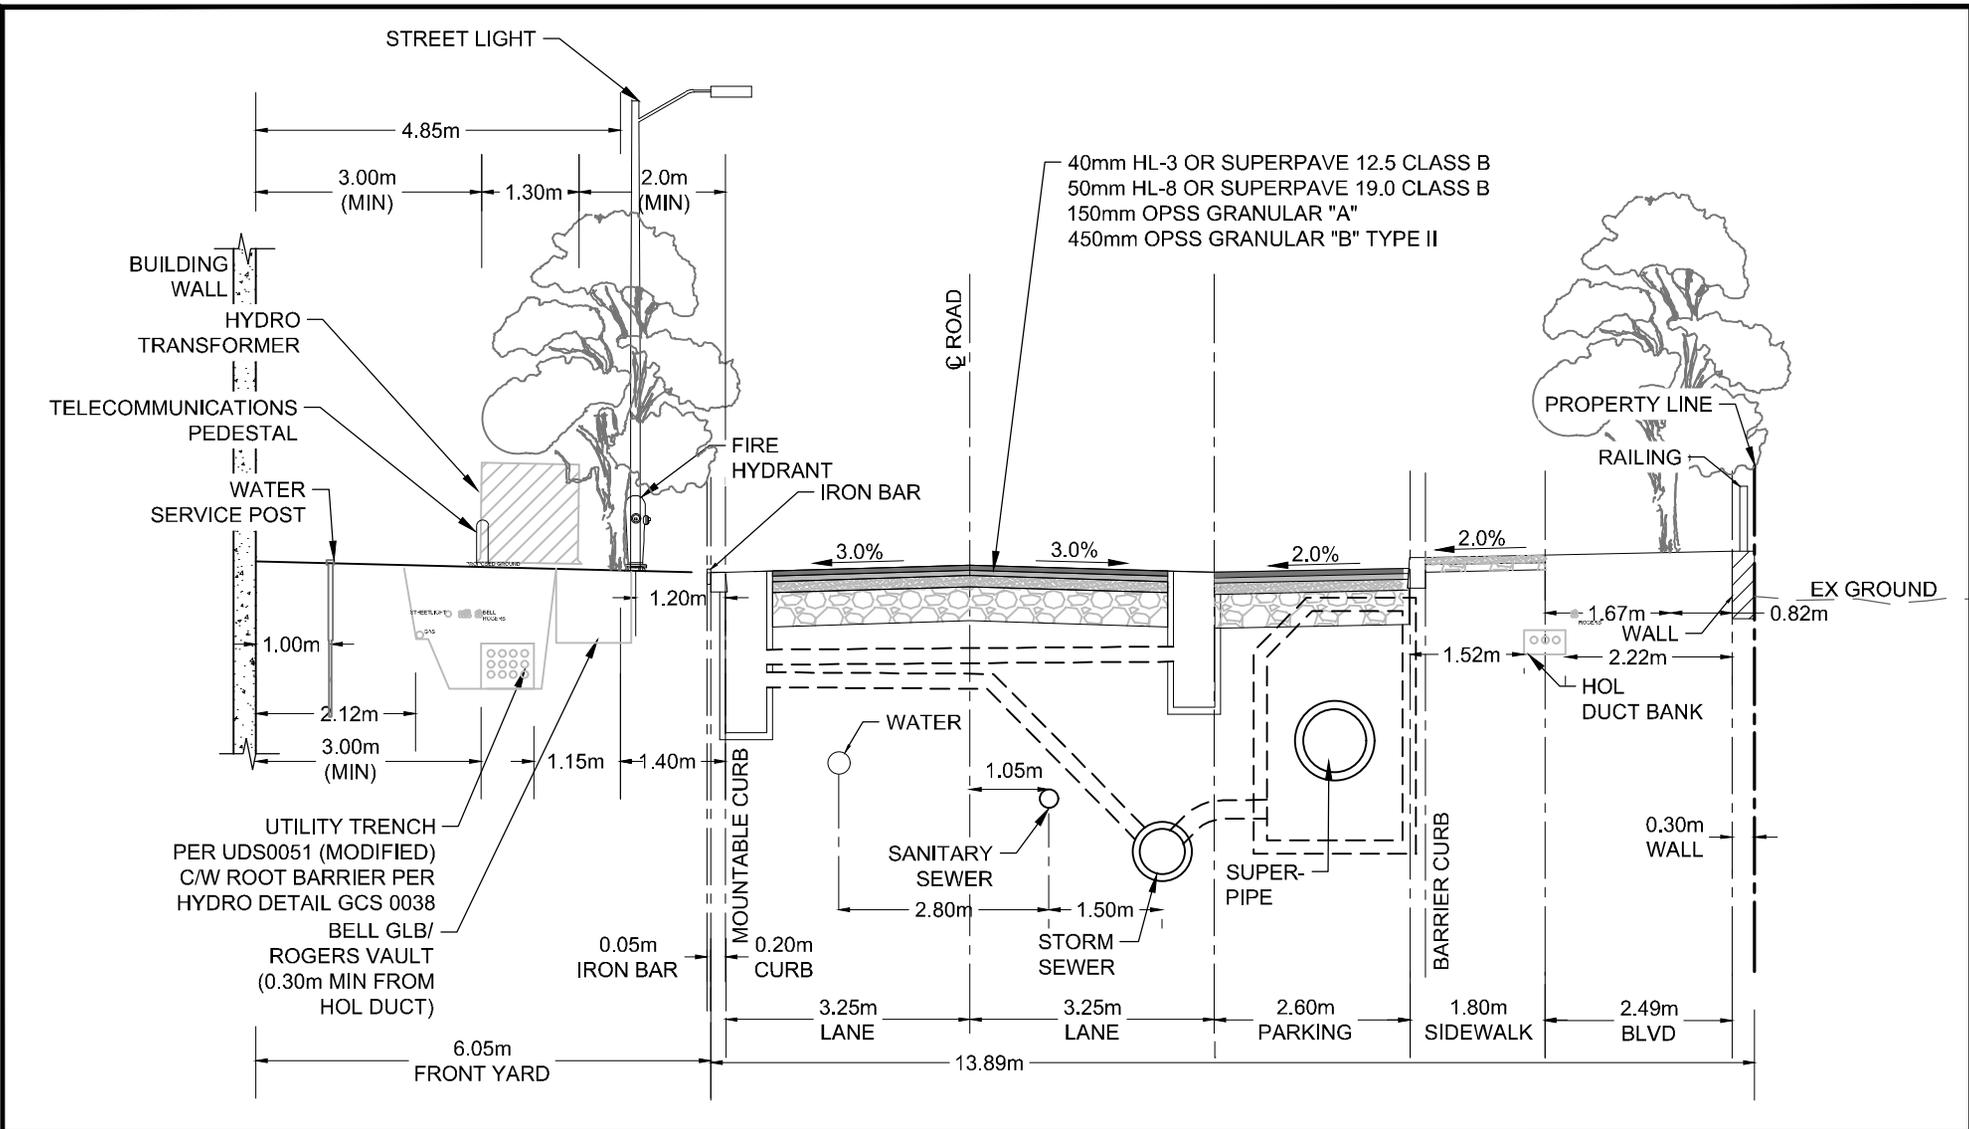

40mm HL-3 OR SUPERPAVE 12.5 CLASS B  
 50mm HL-8 OR SUPERPAVE 19.0 CLASS B  
 150mm OPSS GRANULAR "A"  
 450mm OPSS GRANULAR "B" TYPE II

**NOTE:**

1. BARRIER CURB IS PROPOSED ADJACENT TO ON STREET PARKING AREAS. MOUNTABLE CURB IS PROPOSED IN ALL OTHER AREAS
2. ALL CURB TO BE AS PER CITY DETAIL SC1.1
3. PRIVATE STREETLIGHT CABLES TO MAINTAIN MIN. 300mm HORIZONTAL CLEARANCE FROM HOL DUCT BANK
4. GLB TO MAINTAIN 300mm (MIN) HORIZONTAL CLEARANCE TO HOL DUCT BANK



Engineers, Planners & Landscape Architects  
 Suite 200, 240 Michael Cowpland Drive  
 Ottawa, Ontario, Canada K2M 1P6


Telephone (613) 254-9643  
 Facsimile (613) 254-5867  
 Website www.novatech-eng.com

CITY OF OTTAWA  
 2510 St. LAURENT BOULEVARD

TYPICAL CROSS-SECTION - STREET  
 1- PARALLEL PARKING

SCALE N.T.S

DATE	JULY 2024	JOB	122040	FIGURE	FIGURE 5
------	-----------	-----	--------	--------	----------

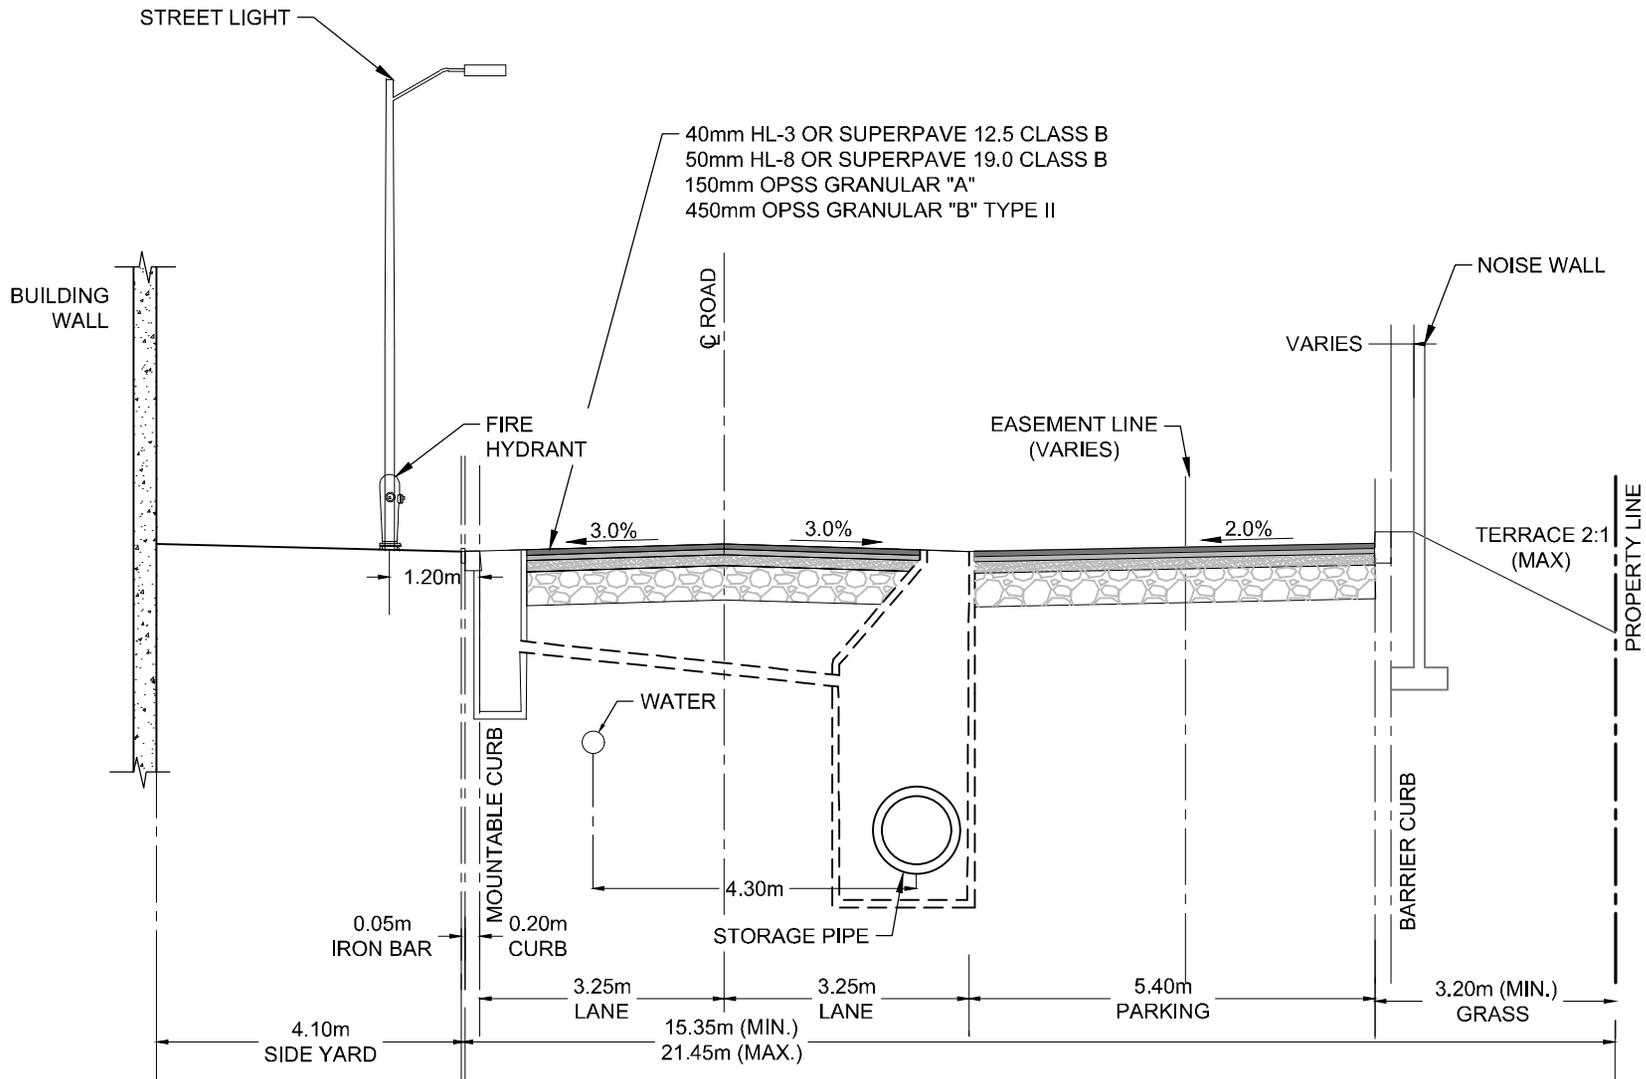

**NOTE:**

1. BARRIER CURB IS PROPOSED ADJACENT TO ON STREET PARKING AREAS. MOUNTABLE CURB IS PROPOSED IN ALL OTHER AREAS
2. ALL CURB TO BE AS PER CITY DETAIL SC1.1
3. PRIVATE STREETLIGHT CABLES TO MAINTAIN MIN. 300mm HORIZONTAL CLEARANCE FROM HOL DUCT BANK
4. GLB TO MAINTAIN 300mm (MIN) HORIZONTAL CLEARANCE TO HOL DUCT BANK



Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website www.novatech-eng.com

CITY OF OTTAWA  
2510 St. LAURENT BOULEVARD

TYPICAL CROSS-SECTION -  
STREET 3 - PERPENDICULAR  
PARKING

SCALE N.T.S

DATE	JULY 2024	JOB	122040	FIGURE	FIGURE 6
------	-----------	-----	--------	--------	----------

## **2.0 SITE CONSTRAINTS**

A geotechnical investigation was completed for the subject development and a report was prepared entitled 'Geotechnical Investigation, Proposed Development, 1890, 1900 & 1920 Walkley Road, 2502 & 2510 St. Laurent Boulevard, 2990 & 3000 Conroy Road, and 2425 Don Reid Drive, City of Ottawa, Ontario, by Paterson Group Inc. dated May 24, 2023 (Report: PG6149-1, Rev 2). The following is a summary of the findings of the report:

- Based on observations at the borehole locations, the groundwater table is expected at an approximate depth between 2.5 and 3.5 m below ground surface. However, it should be noted that groundwater levels are subject to seasonal fluctuations. Therefore, the groundwater levels could be different at the time of construction.
- Under paved areas, existing construction remnants, such as foundation walls, should be excavated to a minimum of 1 m below final grade.
- Due to the presence of a silty clay deposit, a permissible grade raise restriction of 2.0 m is recommended for the grading at the subject site.
- The excavation side slopes above the groundwater level extending to a maximum depth of approximately 3 m should be stable cut back at 1H:1V. Flatter slopes could be required for deeper excavations or for excavations below the groundwater level. Where such side slopes are not permissible or practical, temporary shoring systems should be used.
- The subsoil at this site is considered to be mainly a Type 2 or 3 soil according to the Occupational Health and Safety Act and Regulations for Construction Projects.
- Clay seals should be placed at the site boundaries and at strategic locations at no more than 60 m intervals in the service trenches.
- A temporary Ministry of the Environment, Conservation and Parks (MECP) permit to take water (PTTW) may be required for this project if more than 400,000 L/day of ground and/or surface water is to be pumped during the construction phase. A minimum 4 to 5 months should be allowed for completion of the PTTW application package and issuance of the permit by the MECP.
- For typical ground or surface water volumes being pumped during the construction phase, typically between 50,000 to 400,000 L/day, it is required to register on the Environmental Activity and Sector Registry (EASR). A minimum of two to four weeks should be allotted for completion of the EASR registration and the Water Taking and Discharge Plan to be prepared by a Qualified Person as stipulated under O.Reg. 63/16. If a project qualifies for a PTTW based upon anticipated conditions, an EASR will not be allowed as a temporary dewatering measure while awaiting the MECP review of the PTTW application.
- Tree planting setback limits may be reduced to 4.5 m for small (mature height up to 7.5 m) and medium size trees (mature tree height 7.5 to 14 m), provided that the conditions listed in the geotechnical report are met.

### 3.0 WATER SERVICING

The subject property is within the City of Ottawa 2W2C pressure zone. There are existing City watermains in all rights-of-way fronting the proposed site. There is an existing 400mm diameter (dia.) cast iron watermain within Walkley Road, a 400mm dia. ductile Iron watermain in Conroy Road, a 300mm dia. ductile iron watermain in St. Laurent Avenue, and 300mm dia. ductile iron watermain in Don Reid Drive.

The proposed development will be serviced with a proposed private 200mm diameter watermain system within the proposed rights-of-way. The watermain system will connect to the existing City owned watermain system in three (3) locations for redundancy. There will be two (2) 200mm dia. connections to the existing 300mm dia. watermain within St. Laurent Boulevard, and one (1) connection to the existing 300mm dia. watermain within Don Reid Drive. Additionally, there will be one (1) 50mm dia. water service provided to the proposed parkland block from the existing 300mm dia. watermain within Don Reid Drive for the City to utilize for future park infrastructure. Refer to the General Plan of Services drawing (122040-GP) for servicing details.

### 3.1 Watermain Design Parameters

Water demands have been calculated using criteria from Section 4 of the City of Ottawa Water Distribution Guidelines, and ISTB-2021-03 as follows:

**Table 3-1: Watermain Design Parameters and Criteria**

<b>Domestic Demand Design Parameters</b>	<b>Design Parameters</b>
Unit Population: Semi-Detached /Townhomes	2.7 people/unit
Basic Day Residential Demand (BSDY)	280 L/c/d
Maximum Day Demand (MXDY)	Residential: 2.5 x Basic Day
Peak Hour Demand (PKHR)	Residential: 2.2 x Maximum Day
<b>Fire Demand (FF) Design</b>	<b>Design Flows</b>
Conventional single/town units, unless otherwise noted.	10,000L/min per FUS / OWDG TB-2014-02
Hydrant spacing and coding	90m spacing per OWDG
<b>System Pressure Criteria Design Parameters</b>	<b>Criteria</b>
Maximum Pressure (BSDY) Condition	< 80 psi occupied areas < 100 psi unoccupied areas
Minimum Pressure (PKHR) Condition	> 40 psi
Minimum Pressure (MXDY+FF) Condition	> 20 psi

## 3.2 Fire Demand

The required fire demand was calculated using the Fire Underwriters Survey 2020 (FUS) Guidelines and City of Ottawa ITSB-2014-02. Through correspondence with the builder, it is understood that the proposed buildings are residential occupancy (Limited Combustible) and are composed of wood frame construction.

### 3.2.1 2- Storey Townhomes

For the 2-story townhomes the traditional FUS Table 5 was utilized. The “worst case” for the 2-story townhomes had a building footprint of 457.5 m<sup>2</sup> and a total fire flow requirement of **250L/s** based on the FUS design parameters. Reviewing the site layout and building parameters it was determined that the fire flow demand of the 2-storey Townhomes can be capped at a demand of **167L/s** as per the City of Ottawa guidelines.

The **167 L/s** is in accordance with City of Ottawa water distribution design guidelines (ISTB-2014-02) which outlines the following:

- Where there is a potential for less than 3m of separation between the single family, semi-detached, and row townhome wood-framed buildings, the FUS estimate would require the fire area for multiple buildings to be treated as a contiguous block area and would result in a high fire flow demand which is difficult to attain from existing systems;
- Moreover, to meet the high fire flow demand it would trigger larger diameter watermain size, creating system vulnerabilities such as water age issues;
- As such, fire flows may be capped at 167 L/s (10,000 L/min) for single family, semi-detached, and row townhome, provided certain site criteria are met. The criteria are:
  - For singles: a min separation of 10 m between the backs of adjacent units.
  - Traditional side-by-side semi-detached or row townhomes:
    - a. Firewalls with a min two-hour rating to separate the block into fire areas of no more than the lesser of 7 dwelling units, or 600 m<sup>2</sup> of building area; and
    - b. Min. separation of 10 m between the backs of adjacent units.

Refer to **Appendix B** for detailed Fire flow calculations and building separation figures.

### 3.2.2 3- Storey Townhomes

For the 3-story townhomes FUS Table 6 and ITSB-2014-02 were utilized to calculate the required demands. Table 6 can be utilized when the type of construction of all buildings surrounding the subject building is known.

By using Table 6 the equivalent stories of the 3-level townhome (8.15m from ground to top floor) was determined to be 2.04 stories and the equivalent stories of a 2-level townhome (5.88m from ground to top floor) was calculated to be 1.47 stories. The “worst case” for the 3-story townhomes had a building footprint of 457.5 m<sup>2</sup> and a total fire flow requirements of **267L/s**.

Refer to **Appendix B** for detailed Fire flow calculations, building separation figures and dwelling cross-sections.

### 3.3 Water Demand

The water demand calculations are provided in **Appendix B** for reference. A summary of the calculated water demand and fire flows are provided below in **Table 3.2**.

**Table 3-2: Domestic Water Demand Summary**

Units	Population	Ave. Daily Demand (L/s)	Max. Daily Demand (L/s)	Peak Hour Demand (L/s)	Fire Flow (L/s)
155	419	1.36	3.39	7.46	267

The water demand information was submitted to the City of Ottawa for boundary conditions from the City’s water model based on a previous site plan iteration (unit count of 160). The unit reduction is negligible for demands. Refer to **Table 3.3** for a summary of the boundary conditions.

**Table 3-3: Water Boundary Conditions**

Criteria	Head (m)
<b>Connection 1 (Don Reid Drive)</b>	
Max HGL	130.3
Min HGL	124.5
Max Day + Fire Flow (167L/s)	125.4
Max Day + Fire Flow (267L/s)	123.3
<b>Connection 2 (St. Laurent)</b>	
Max HGL	130.3
Min HGL	124.4
Max Day + Fire Flow (167L/s)	125.2
Max Day + Fire Flow (267L/s)	122.9
<b>Connection 3 (St. Laurent)</b>	
Max HGL	130.3
Min HGL	124.4
Max Day + Fire Flow (167L/s)	125.2
Max Day + Fire Flow (267L/s)	122.9

### 3.4 System Pressure Modeling and Results

The above boundary conditions were used to create a hydraulic model using EPANET for analyzing the performance of the proposed watermain system for three theoretical conditions: 1) High Pressure check under Average Day conditions, 2) Peak Hour Demand, 3) Maximum Day + Fire Flow Demand. The following **Table 3.3** provides a summary of the results from the hydraulic water model.

**Table 3-4: Water Analysis Summary**

Condition	Demand (L/s)	Min/Max Allowable Operating Pressures (psi)	Limits of Design Operating Pressures (psi)	Age (hrs)
High Pressure	1.40L/s	80psi (Max)	55.78psi	2.38
Maximum Daily Demand and Fire Flow	270.50 L/s	20psi (Min)	27.90psi	N/A
Peak Hour	7.70 L/s	40psi (Min)	61.91psi	N/A

The above table lists the worst-case pressures from the water model analysis. The water age was calculated with a boundary age of 0.00hrs

The above model was based on the previous unit count of 160. The hydraulic analysis indicates that the system can provide adequate pressures and flow to meet the domestic and fire flow requirements for the site. As such, the proposed development with a reduced unit count of 155 will slightly increase the pressures but will remain within the limits of design operating pressures.

Refer to **Appendix B** for detailed water demand calculations, model schematic, and City of Ottawa boundary conditions.

### 4.0 SANITARY SERVICING

There are existing sanitary sewers within all rights-of-way fronting the proposed development. There is a 450mm dia. concrete sanitary sewer in the Walkley Road right-of-way, a 750mm dia. concrete sanitary sewer within the Conroy Road right-of-way, a 375mm dia. PVC sanitary sewer in the St. Laurent Boulevard right-of-way, and a 250mm dia. PVC sanitary sewer in the Don Reid Drive right-of-way. It is proposed to service the development with two (2) 250mm dia. PVC sanitary sewers, with independent connections to the existing 375mm sanitary sewer within the St. Laurent Boulevard right-of-way. Additionally, it is proposed to service the park with a 150mm dia. PVC connection to the existing 250mm dia. sanitary sewer within Don Reid Drive for the City to utilize for future park infrastructure.

Sanitary flows for the proposed development were calculated using criteria from Section 4 of the City of Ottawa Sewer Design Guidelines, ITSB-2018-01, and the Ontario Building Code as follows:

Table 4-1: Sanitary Sewer Design Parameters

Design Component	Design Parameter
Unit Population: Semis-Detached /Townhomes	2.7 people/unit
Residential Flow Rate	Design = 280 L/cap/day Annual / Rare = 200 L/cap/day
Residential Peaking Factor	Harmon Equation (min=2.0, max=4.0) Harmon Correction Factor = 0.8m (Design)
Extraneous Flow Rate	Design = 0.33 L/s/ha
Minimum Pipe Size	250mm (Res)
Minimum Velocity <sup>1</sup>	0.6 m/s
Maximum Velocity	3.0 m/s
Minimum Pipe Cover	2.0 m (Unless frost protection provided)

<sup>1</sup>A minimum gradient of 0.65% is required for any initial sewer run with less than 10 residential connections.

The West connection will have a flow of **2.82 L/s** and the East connection will have a flow of **3.20 L/s**. The total peak sanitary flow including infiltration for the development will be **6.02 L/s**. It is understood that there is adequate capacity within the neighboring City infrastructure to service the development.

Detailed sanitary flow calculations are provided in **Appendix C** for reference.

## **5.0 STORM SERVICING**

There are existing storm sewers located within all rights-of-way (ROW) fronting the proposed development:

- 1500mm – 2100mm dia. storm sewers within the Walkley Road ROW;
- 2100mm trunk & 375mm – 450mm dia. storm sewers within the Conroy Road ROW;
- 1500mm dia. storm sewer within the St. Laurent Boulevard ROW; and,
- 375mm – 900mm dia. storm sewers within the Don Reid Drive ROW.

The proposed development area will have five (5) storm outlets connecting to the existing storm sewer systems:

- Residential Component - two (2) storm sewer connections from Streets 1 & 2 to the 1500mm dia. storm sewer on St. Laurent Blvd.
- Park Block – one (1) storm connection to the dia. diameter storm sewer on Don Reid Dr.
- Retirement Residence – future storm connection to the 375mm dia. storm sewer on Don Reid Dr.
- Commercial Rd. – one (1) storm connection to the 450mm diameter storm sewer within the Conroy Rd. ROW.

The proposed development will include underground and surface storage to adhere to the allowable release rate. No surface storage has been assumed in the park block. The proposed storm sewer in the park block is a 375mm PVC storm sewer and provides the only storage required to meet the allowable release rate.

The residential component of the site will include underground storage in the rear yards (600mm dia. perforated pipe / stone trench) and in the roadway (offline upsized storm sewers – ‘superpipe’). Portions of the residential (front / road) drainage will not have underground storage (superpipe) due to infrastructure constraints with the narrow ROW. Due to the infrastructure constraints the ‘pairs’ of roadway catchbasins will need to be interconnected.

The proposed residential and commercial roadways have been graded in a ‘saw-toothed’ pattern to promote surface storage that will be utilized during large storm events. Inlet control devices (ICDs) will be installed within the roadway inlets or structure downstream the superpipe systems. All on-site storm sewers are private. The proposed storm sewer sizes range from 1) 250mm to 600mm dia. for the ‘free-flowing’ storm sewer systems; and, 2) 450mm – 1050mm dia. for the superpipe systems. Refer to the General Plan of Services (drawings 122040-GP1&2) for more details.

The release rate from the commercial road will be controlled via a single ICD installed in the downstream structure. The storm sewer servicing the commercial road has been upsized to provide underground storage.

The retirement residence will require a future site plan approval. It is assumed that the retirement residence will connect to the 375mm dia. storm sewer on Don Reid Drive. The proposed development of this Block will need to adhere to the allocated allowable release rate provided in this report.

## 6.0 STORM DRAINAGE AND STORMWATER MANAGEMENT

The stormwater management (SWM) strategy for the site is based on the established criteria provided by the City of Ottawa.

### 6.1 Design Criteria

The following SWM criteria was established based on correspondence with the City of Ottawa:

- Control post-development peak flows for all storms up to and including the 100-year design event to a 5-year allowable release rate calculated using a runoff coefficient (C) equal to existing conditions but in no case greater than 0.50 and a calculated time of concentration ( $T_c$ ) no less than 10 minutes.
- Ensure the 100-year hydraulic grade line is min. 0.30m from the lowest Underside-of-Footing elevation.
- Limit 100-year dynamic ponding depths within the roadway to 0.35m.
- Ensure the product of the 100-year dynamic flow depth x velocity is less than 0.60.
- Ensure no surface ponding during the 2-year storm event.
- Provide an *Enhanced* level of water quality treatment corresponding to a long-term 80% TSS removal rate.
- Provide source controls which are in conformity with the City of Ottawa requirements, where possible.
- Provide guidelines to ensure that site preparation and construction is in accordance with the current Best Management Practices for Erosion and Sediment Control.

### 6.2 Stormwater Management Modeling

The City of Ottawa Sewer Design Guidelines (October 2012) requires hydrologic / hydraulic modeling for all dual drainage systems. The performance of the proposed storm drainage system was evaluated using the PCSWMM hydrologic / hydraulic model. The results of the analysis were used to:

- Estimate pre-development peak flows (100-year allowable release rate).
- Determine the total runoff from the site.
- Size the required ICDs to ensure no ponding during the 2-year storm event and no off-site major system flows during the 100-year storm event.
- Determine the required underground storage volumes.
- Calculate the storm sewer hydraulic grade line and ponding elevations for the 100-year storm event.

The pre-development & post-development PCSWMM model schematics and 100-year output are provided in **Appendix E**.

**6.2.1 Design Storms**

The PCSWMM model uses synthetic design storms created using the IDF parameters provided in the City of Ottawa Sewer Design Guidelines (October 2012). The hydrologic analysis was completed using the 4-hour Chicago synthetic design storms for the 2-year, 5-year, and 100-year return periods. The model was ‘stress tested’ using a 100-year (+20%) storm event that corresponds to a 100-year storm with a 20% increase in rainfall intensity and volume.

**6.2.2 Pre-Development Model – 100-year Allowable Release Rate**

The 100-year allowable release rate for the site was calculated using a pre-development PCSWMM model. The SCS Curve Number runoff method was used to estimate pre-development peak flows for the total existing undeveloped site area (approx. 5.9 ha).

Under existing conditions the site consists of remnants of parking lots for old buildings that were demolished (circa 2005). Portions of the paved areas are still in place; however, are heavily ‘cracked’ with overgrown vegetation. The existing percent impervious is 39%, which corresponds to a runoff coefficient of 0.47. This is less than the 0.50 runoff coefficient per the SWM criteria.

The surficial soils of the subject site consists of ‘silty clay’ (Hydrologic Soil Group ‘D’), per the Geotechnical Report referenced in Section 2.0. An assumed Curve Number of 86 was chosen based on the existing land use / soils. The Initial Abstraction value was assumed to be 5mm. A time-of-concentration (Tc) of 17 min. was estimated for the overall site using Uplands Method.

The pre-development drainage area plan (**Drawing 122040-EXSWM**), pre-development model parameters & results are provided in **Appendix E**.

Based on the above, pre-development peak runoff for the 5-year storm event (4-hour Chicago) was estimated to be 597 L/s. Per the SWM criteria, this corresponds to the overall 100-year allowable release for the overall subject site.

The overall subject site is divided into four (4) parts. If the overall release rate was equally shared, based on drainage area, each part would have the 100-year allowable release rate shown in **Table 6.1**.

**Table 6-1: 100-year Allowable Release Rate**

Development (Block)	Drainage Area		100-year Allowable Release Rate (L/s)
	(ha)	% of Overall	
<b><i>Future Retirement Residence &amp; Commercial Road</i></b>			
Retirement Residence	1.022	17.4%	103.9
Commercial Road	0.290	4.9%	29.4
<b>SUB-TOTAL</b>	<b>1.312</b>	<b>22.3%</b>	<b>133.3</b>
<b><i>Residential Subdivision &amp; Park</i></b>			
Residential Subdivision	3.966	67.5%	403.0
Park Block <sup>(1)</sup>	0.597	10.2%	60.7
<b>SUB-TOTAL</b>	<b>4.563</b>	<b>77.7%</b>	<b>463.7</b>
<b>OVERALL TOTAL<sup>(1)</sup></b>	<b>5.875</b>	<b>100.0%</b>	<b>597.0</b>

<sup>1)</sup> Overall total does not include existing (off-site) areas (EX-01 = 0.024 ha).

*Retirement Residence & Commercial Road*

The 100-year allowable release rates for the future Retirement Residence Block and Commercial Road are based on area-weighting the overall allowable release rate (597 L/s) based on the drainage area, as summarized below:

<u><i>Development Block</i></u>	<u><i>100-year Allowable Release Rate</i></u>
Retirement Residence	103.9 L/s
Commercial Road	29.4 L/s

The storm servicing and stormwater management design of the future retirement residence will need to adhere to the above 100-year allowable release rate. The storm servicing and stormwater management design for the commercial road is included in this report submission.

*Residential Subdivision & Park Block*

The 100-year allowable release rates for the residential subdivision and park block are based on area-weighting the overall allowable release rate (597 L/s) based on the drainage area, as summarized below:

<u><i>Development Block</i></u>	<u><i>100-year Allowable Release Rate</i></u>
Residential Subdivision	403.0 L/s
Park Block	60.7 L/s

**6.2.3 Post-Development Model Parameters**

The proposed subject site has been divided into subcatchments based on the drainage areas tributary to each inlet of the proposed stormwater management system, delineated based on the proposed grading plan. Refer to the Post-Development Storm Drainage Area Plan (**Drawing 122040-SWM**). A summary of the subcatchment model parameters is provided in **Table 6.2**.

Table 6-2: Subcatchment Parameters

Area ID	Catchment Area (ha)	Runoff Coefficient (C)	Percent Impervious (%)	Zero-Imperv. (%)	Flow Length / Equivalent Width <sup>(1)</sup> (m)	Average Slope (%)
<b>Outlet 'A' – MH201</b>						
A-01	0.151	0.53	47.1	100	12 / 126	2
A-02	0.165	0.76	80	50	13 / 127	2
A-03	0.156	0.76	80	50	14 / 111	2
A-04	0.251	0.46	37.1	100	14 / 179	2
A-05	0.104	0.51	44.3	100	10 / 104	2
A-06	0.149	0.72	74.3	50	12 / 124	2
A-07	0.139	0.73	75.7	50	14 / 99	2
A-08	0.266	0.53	47.1	100	13 / 205	2
A-09	0.065	0.77	81.4	0	7 / 93	2
A-10	0.192	0.74	77.1	50	15 / 128	2
A-11	0.234	0.54	48.6	100	14 / 167	2
<b>Total Outlet 'A'</b>	<b>1.872</b>	<b>0.62</b>	<b>60.0</b>	<b>68</b>	-	-
<b>Outlet 'B' – MH401</b>						
B-01	0.155	0.74	77.1	50	12 / 129	2
B-02	0.097	0.72	74.3	0	10 / 97	2
B-05	0.212	0.50	42.9	100	13 / 163	2
B-06	0.115	0.75	78.6	50	9 / 128	2
B-07	0.118	0.77	81.4	50	14 / 84	2
B-08	0.107	0.75	78.6	50	14 / 76	2
B-09	0.137	0.76	80	50	14 / 98	2
B-10	0.153	0.77	81.4	50	14 / 109	2
B-11	0.349	0.57	52.9	100	14 / 249	2
B-12	0.099	0.71	72.9	50	16 / 62	2
B-13	0.065	0.65	64.3	50	6 / 108	2
B-14	0.021	0.73	75.7	0	5 / 42	2
B-15	0.059	0.78	82.9	50	10 / 59	2
B-16	0.048	0.87	95.7	0	5 / 96	2
B-17	0.14	0.74	77.1	50	15 / 93	2
B-18	0.062	0.69	70	50	10 / 62	2
B-19	0.067	0.78	82.9	0	8 / 84	2
<b>Total Outlet 'B'</b>	<b>2.004</b>	<b>0.69</b>	<b>70.0</b>	<b>39</b>	-	-
<b>Direct Runoff Areas</b>						
D-01	0.012	0.38	25.7	0	4 / 30	2
D-02	0.015	0.46	37.1	0	7 / 21	2

Area ID	Catchment Area (ha)	Runoff Coefficient (C)	Percent Impervious (%)	Zero-Imperv. (%)	Flow Length / Equivalent Width <sup>(1)</sup> (m)	Average Slope (%)
D-03	0.007	0.50	42.9	0	6 / 12	2
D-04	0.002	0.20	0	0	4 / 5	5
D-05	0.054	0.29	12.9	0	8 / 68	5
<b>Total Direct Runoff</b>	<b>0.090</b>	<b>0.34</b>	<b>20.7</b>	<b>0</b>	-	-
<b>Commercial Road – MH600</b>						
C-01	0.081	0.77	81.4	0	15 / 54	2
C-02	0.071	0.71	72.9	0	13 / 55	2
C-03	0.037	0.68	68.6	0	10 / 37	2
C-04	0.035	0.71	72.9	0	10 / 35	2
C-05	0.031	0.73	75.7	0	10 / 31	2
C-06	0.035	0.72	74.3	0	10 / 35	2
<b>Total Commercial Rd.</b>	<b>0.290</b>	<b>0.73</b>	<b>75.2</b>	<b>0</b>	-	-
<b>Park Block – MH801</b>						
PARK	0.597	0.25	7.1	0	75 / 80	2
<b>Retirement Residence</b>						
RETIREMENT	1.022	0.80	85.7	50	65 / 157	2
<b>Existing (Off-Site) Areas</b>						
EX-01	0.024	0.20	0.0	0	4 / 60	5
<b>Overall</b>						
<b>TOTAL</b>	<b>5.899</b>	<b>0.64</b>	<b>62.4</b>	<b>54</b>	-	-

<sup>1)</sup> Equivalent widths are calculated using the methods described in the City of Ottawa Sewer Design Guidelines (October 2012).

### Infiltration

Infiltration losses for all proposed subcatchments were modeled using Horton's infiltration equation, which defines the infiltration capacity of soil over the duration of a precipitation event using a decay function that ranges from an initial maximum infiltration rate to a minimum rate as the storm progresses. The default values provided in the Ottawa Sewer Design Guidelines were used for all catchments.

Horton's Equation:  

$$f(t) = f_c + (f_o - f_c)e^{-k(t)}$$

Initial infiltration rate:  $f_o = 76.2$  mm/hr  
Final infiltration rate:  $f_c = 13.2$  mm/hr  
Decay Coefficient:  $k = 4.14$ /hr

Depression Storage

The default values for depression storage provided in the Ottawa Sewer Design Guidelines were used for all catchments. Rooftops were assumed to provide no depression storage (zero-impervious parameter).

Depression Storage (pervious areas):	4.67 mm
Depression Storage (impervious areas):	1.57 mm

Equivalent Width

'Equivalent Width' refers to the width of the subcatchment flow path. This parameter is calculated as described in Section 5.4.5.6 of the Ottawa Sewer Design Guidelines.

Impervious Values

Runoff coefficients for each subcatchment were determined based on the proposed site plan. Refer to the Storm Drainage Area Plan (Drawing 122040-SWM) for details. Percent impervious values were calculated using the following equation:

$$\%imp = (C - 0.20) / 0.70$$

Exit Losses (Bend Losses)

The storm sewer network includes exit losses (i.e. bend losses) based on the friction and bend loss coefficients per the Ottawa Sewer Design Guidelines (Appendix 6-B, Hydraulic Losses at Bends).

Boundary Conditions (Outfalls)

The 100-year Hydraulic Grade Line (HGL) elevations for the existing off-site storm sewer systems was provided by the City of Ottawa (refer to correspondence / HGL profiles provided in **Appendix E**). The 100-year HGL was estimated for each of the proposed storm sewer outlet connections based on the slope of the HGL and connection distance, as shown in **Table 6.3**.

**Table 6-3: 100-year HGL Elevations at Minor System Outfalls**

Connection	Length (m)	City of Ottawa MH ID's		100-year HGL Elevations (m)		
		U/S MH	D/S MH	U/S MH	D/S MH	HGL Slope (%)
<b>Commercial Road (MH600) Outlet to Conroy Road Storm Sewer</b>						
450mm on Conroy Rd.	113.2	MHST32436	MHST32437	84.11	83.71	0.35%
MH600 Connection	70.5	Connection	MHST32437	<b>83.96</b>	83.71	0.35%
<b>Residential (MH401) Connection to St. Laurent Boulevard Storm Sewer</b>						
1500mm on St. Laurent Blvd.	85.7	MHST31837	MHST31838	82.35	82.31	0.05%
MH401 Connection	29.2	Connection	MHST31838	<b>82.33</b>	82.31	0.05%
<b>Residential (MH201) Connection to St. Laurent Boulevard Storm Sewer</b>						
1500mm on St. Laurent Blvd.	73.6	MHST31836	MHST31837	82.38	82.35	0.04%
MH201 Connection	9.1	Connection	MHST31837	<b>82.36</b>	82.35	0.04%
<b>Park Outlet (MH801) to Don Reid Drive Storm Sewer</b>						
375mm on Don Reid Dr.	47.8	MHST31833	MHST31834	82.44	82.43	0.00%
MH801 Connection	12.5	Connection	MHST31834	<b>82.43</b>	82.43	0.00%

<sup>1)</sup> Highlighted HGL elevations are 'fixed' outfall boundary conditions, with initial depths in upstream nodes.

For the 100-year storm event, the HGL boundary condition was applied as a fixed water elevation at the minor system outfalls. Each of the upstream nodes included an initial depth to account for the fixed downstream HGL.

For the 2-year and 5-year storm events, the model was run using a 'normal' outfall condition for the minor system outfalls. A 'free' outfall condition issued for the major system outfalls and outfalls for direct runoff areas.

A 'normal' outfall condition for the minor system outfalls was used to compare with the 100-year allowable release rate.

Catchbasins (On-Grade)

The inlet capture rate for the catchbasins on-grade is represented using an outlet rating curve. Outlet rating curves were generated based on the inlet curves in Appendix 7a of the City of Ottawa Sewer Design Guidelines (October 2012). Outlet rating curves are provided in **Appendix E**.

**6.3 PCSWMM Model Results**

The results of the post-development PCSWMM model demonstrate that the overall stormwater management strategy for the subject site will conform to the stormwater management criteria outlined in this report.

### 6.3.1 Summary of Peak Flows

The PCSWMM model was used to evaluate the performance of the proposed storm servicing and stormwater management strategy and ensure that peak flows are controlled to the 100-year allowable release rates (**Section 6.2.2**).

**Table 6.4** compares the minor system release rates to the downstream storm sewer systems to the 100-year allowable release rates. For this scenario a 'Normal' outfall condition was used for the minor system outfalls (i.e. no downstream boundary condition).

**Table 6-4: Peak Flow Comparison**

Development (Block)	Peak Flow <sup>(1)</sup> (L/s)			100-year Allowable Release Rate (L/s)
	2-year	5-year	100-year	
<b>Future Retirement Residence &amp; Commercial Road</b>				
Retirement Residence	83.8	92.1	103.8	103.9
Commercial Road (MH600)	17.2	20.3	29.5	29.4
<b>SUB-TOTAL</b>	<b>101.0</b>	<b>112.4</b>	<b>133.3</b>	<b>133.3</b>
<b>Residential Subdivision</b>				
Residential Subdivision Minor System (MH201 + MH401)	153.7 +119.6 273.3	190.6 +130.4 321.0	224.6 +139.7 364.3	403.0
Residential Subdivision Major System (All Outfalls)	0.0	0.0	0.0	
Direct Runoff Areas (All Outfalls)	4.9	15.5	38.7	
<b>SUB-TOTAL</b>	<b>278.2</b>	<b>336.5</b>	<b>403.0</b>	<b>403.0</b>
<b>Park</b>				
Park Block (MH801)	9.2	19.3	60.2	60.7
<b>SUB-TOTAL</b>	<b>9.2</b>	<b>19.3</b>	<b>60.2</b>	<b>60.7</b>
<b>OVERALL TOTAL</b>	<b>388.4</b>	<b>468.2</b>	<b>596.4</b>	<b>597.0</b>

<sup>1)</sup> PCSWMM model results for a 4-hour Chicago storm distribution with 'Normal' minor system outfall condition; values measured at outfalls.

As shown in **Table 6.4**, the overall controlled and uncontrolled peak flows will be less than or equal to the overall 100-year allowable release rates. The PCSWMM model output is provided in **Appendix E**.

Future Retirement Residence (Storage Assumption)

The future Retirement Residence is conceptually represented in the PCSWMM model as a single subcatchment outletting to a storage node with an outlet rating curve. The storage curve and outlet rating curve include the assumed storage and release for the 2-year & 100-year storm events. The release rate for the 2-year storm event was assumed to be 80% of the 100-year allowable release rate to account for the additional ‘head’ within a flow control structure / ICD. The required storage for the 2-year & 100-year storm events is summarized below:

<u>Storm Event</u>	<u>Release Rate</u>	<u>Required Storage</u>
2-year	83.8 L/s	94 m <sup>3</sup> (92 m <sup>3</sup> /ha)
100-year	103.8 L/s	310 m <sup>3</sup> (303 m <sup>3</sup> /ha)

The estimated total required storage for the future Retirement Residence is 310 m<sup>3</sup> (303 m<sup>3</sup>/ha) to adhere to the 100-year allowable release rate. The proposed site plan is currently unknown, but it is assumed that the proposed buildings will include a combination of underground, surface, and rooftop storage.

The stormwater management requirements for the future Retirement Residence (Block) will be dependent on the impervious area of the site and will be re-evaluated and confirmed as part of a future separate site plan application.

**6.3.2 Stormwater Management Systems (Storage)**

Stormwater management is required to adhere to the overall allowable release rate. The PCSWMM model represents both underground and surface storage as summarized below:

- Underground storage: roadway (superpipe) & rear yards (perforated pipe / trench system)
- Surface storage: roadway (road sags)

The model does not provide any surface storage within the Park Block or surface storage in the rear yards. The storage provided for the Future Retirement Residence has been conceptually provided to adhere to the 100-year allowable release rate.

Superpipe

Underground storage will be provided via offline / upsized storm sewers (superpipe system). There will be no foundation drain connections to the superpipe. In areas adjacent the superpipe system the road catchbasins will be directly connected to the superpipe. The remaining road catchbasins connect to the free-flowing storm sewer system. No underground storage is provided for the road catchbasins connecting to the free-flowing storm sewer.

An inlet control device will be installed within the downstream structure of the superpipe system to control peak flows. A summary of the provided storage and 100-year release rate is provided in **Table 6.5** and **Table 6.6**.

**Table 6-5: Superpipe Storage**

Development (Block)	Storm Sewer Info		Storage Provided (m <sup>3</sup> )			100-year Release Rate <sup>(1)</sup> (L/s)
	Size (mm)	Length (mm)	Pipes	Structures <sup>1</sup>	TOTAL	
Commercial Road	450	198.3	31.5	1	32.5	29.5
Street 1	825	66.0	35.3	6	41.3	9.1
Street 1	600	29.5	8.3	6.4	14.7	28.0
Street 3	1050	160.2	138.7	10	148.7	12.4
<b>TOTAL</b>	-	<b>454.0</b>	<b>213.8</b>	<b>23.4</b>	<b>237.2</b>	<b>79.0</b>

<sup>1)</sup>Based on PCSWMM model results for a 4-hour Chicago Storm with 'Normal' minor system outfall condition.

**Table 6-6: Park Storage**

Development (Block)	Storm Sewer Info		Storage Provided (m <sup>3</sup> )			Storage Required (m <sup>3</sup> )	100-year Release Rate <sup>(1)</sup> (L/s)
	Size (mm)	Length (mm)	Pipes	Structures <sup>1</sup>	TOTAL		
Park	375	77.3	8.5	8.4	16.9	13.0	60.2

<sup>1)</sup>Based on PCSWMM model results for a 4-hour Chicago Storm with 'Normal' minor system outfall condition.

Rear Yard Perforated Pipe / Trench System

A perforated pipe / clearstone trench system will be provided in the rear yards. The perforated pipe will be either 600mm or 250mm and surrounded by 25-50mm dia. clearstone that will be wrapped in geotextile.

The primary purpose of the perforated pipe / trench system is to store runoff from the rear yards and rear building rooftops. No additional water quality treatment is required as the runoff is considered 'clean'. Although this system will promote infiltration through the bottom (and sides) of the trench, infiltration has not been accounted for in the PCSWMM model. This includes the storage provided within the 150mm of clearstone below the perforated pipe.

The groundwater table is expected to be at an approximate depth between 2.5m and 3.5m below the ground surface, per the geotechnical report. The invert elevations of the rear yard perforated pipe / clearstone trenches are set higher, as such the estimated groundwater table will not affect the system's storage capacity.

Refer to the Notes and Details (Drawing 122040-ND) for a cross-section of the perforated pipe / trench system.

The rear yard perforated pipe / trench system is represented in the PCSWMM model as rectangular conduits. The conduits have the equivalent length & height as the proposed trenches. The conduit widths are modified to provide the 'equivalent storage' as the perforated pipe / trench system.

A summary of the storage provided in the perforated pipe / trench system is shown in **Table 6.7**.

Table 6-7: Perforated Pipe / Trench System (Rear Yards)

RYCB ID (STM Area ID)	Perf. Pipe Dia.	Trench Dimensions				Storage Volumes			Equiv. Width For Model
		Length	Width	Height	Area	Perf. Pipe	Stone	TOTAL	
	(mm)	(m)	(m)	(m)	(m <sup>2</sup> )	(m <sup>3</sup> )	(m <sup>3</sup> )	(m <sup>3</sup> )	(m)
<b>Outlet 'A'</b>									
RYCB701 (A-04)	600	73.9	1.20	0.90	89	20.9	23.6	44.5	0.67
RYCB702 (A-01)	250	93.4	0.85	0.55	79	4.6	15.6	20.2	0.39
RYCB703 (A-08)	600	100.5	1.20	0.90	121	28.4	32.0	60.5	0.67
RYCB704 (A-05)	250	72.5	0.85	0.55	62	3.6	12.1	15.7	0.39
RYCB705 (A-11)	600	141.2	1.20	0.90	169	39.9	45.0	85.0	0.67
<b>TOTAL (Outlet A)</b>	-	<b>481.5</b>	-	-	<b>578</b>	<b>97.4</b>	<b>128.4</b>	<b>225.8</b>	-
<b>Outlet 'B'</b>									
RYCB708 (B-05)	600	118.5	1.20	0.90	142	33.5	37.8	71.3	0.67
RYCB709 (B-11)	600	115.3	1.20	0.90	138	32.6	36.8	69.4	0.67
<b>TOTAL (Outlet B)</b>	<b>600</b>	<b>233.9</b>	<b>1.20</b>	<b>0.90</b>	<b>281</b>	<b>66.1</b>	<b>74.6</b>	<b>140.7</b>	<b>0.67</b>
<b>OVERALL TOTAL</b>	-	<b>715.4</b>	-	-	<b>858</b>	<b>163.5</b>	<b>203.0</b>	<b>366.5</b>	-

<sup>1)</sup> Height of trench does not include 0.15m of clearstone below the subdrain.

<sup>2)</sup> Assumed 40% void ratio for storage provided in the clearstone.

<sup>3)</sup> The total storage volume is represented in the PCSWMM model as rectangular conduits.

<sup>4)</sup> Equivalent width for model = total storage (subdrain & clearstone) divided by the length and height of the rectangular conduit.

### 6.3.3 Inlet Control Devices

Inlet control devices (ICDs) are provided for road catchbasins outletting to the free-flowing storm sewer, downstream rear yard catchbasins, park flow outletting to the existing storm sewer and for the superpipe systems. The ICDs have been sized to ensure no 2-year surface ponding during and no 100-year major system flows offsite. Standard City of Ottawa ICD sizes (83, 94, 102, 108, 127, 152, 178mm) have been used where possible; however, as the proposed development is a private site custom ICD sizes are required for some structures. Tempest LMF (or approved equivalent) vortex type ICDs are used for sizes smaller than 83mm. The Tempest LMF ICDs are sized to ensure a minimum 100-year release rate of approximately 10 L/s for rear-yard areas. ICD sizes and design flows are provided in **Table 6.8**.

Table 6-8: Inlet Control Devices

Structure ID	ICD Diameter / Model (mm)	2-year Event <sup>(1)</sup>		100-year Event <sup>(1)</sup>	
		Head (m)	Inlet Capture Rate (L/s)	Head (m)	Inlet Capture Rate (L/s)
<b>Superpipe</b>					
MH601 (Commercial Rd.)	102mm	0.67	17.2	1.88	29.5
MH501	83mm	1.92	20.1	3.70	28.0
MH503	Tempest LMF	1.56	6.6	2.97	9.1
MH505	Tempest LMF	1.47	7.7	3.73	12.4
<b>Road Catchbasins</b>					
CB01/02	178mm	0.77	55.6	1.49	79.5
CB03/04	145mm	1.17	46.7	1.51	53.5
CB09	94mm	1.11	19.4	1.32	21.1
CB10/11	121mm	1.56	38.1	1.81	41.1
CB12/13	145mm	1.35	50.5	1.74	57.6
<b>Rear Yard Catchbasins</b>					
RYCB701	83mm	0.44	9.2	1.45	17.4
RYCB702	Tempest LMF	0.43	7.1	1.27	12.6
RYCB703	Tempest LMF	0.52	7.2	1.47	12.5
RYCB704	Tempest LMF	0.29	6.0	0.96	11.5
RYCB705	Tempest LMF	0.50	7.9	1.14	12.2
<b>Park Block</b>					
MH801	138mm	0.13	9.2	2.29	60.2

<sup>1)</sup> Based on PCSWMM results for a 4-hour Chicago storm distribution with 'Normal' minor system outfall condition.

#### 6.3.4 Hydraulic Grade Line (HGL)

The PCSWMM model has been used to perform an HGL analysis of the proposed storm sewer network.

There is no foundation drain connections to the superpipe system. The foundation drains are connected to the 'free-flowing' storm sewer.

The 100-year HGL profile is shown on the Plan and Profile Drawings. The 100-year HGL elevations at each STMMH are provided in **Table 6.9**.

**Table 6-9: 100-year HGL Elevations**

MH ID	Obvert Elev. (m)	T/G Elev. (m)	HGL Elev. <sup>(1)</sup> (m)	Surcharge (m)	Clearance from T/G (m)	HGL in Stress Test <sup>(1)</sup> (m)	Proposed USF Elev. (m)
<b>Free Flowing Sewers</b> <i>(With Foundation Drain Connections)</i>							
MH201	81.53	85.08	82.46	0.93	2.62	82.47	83.35
MH202	82.30	86.01	82.71	0.41	3.30	82.74	83.82
MH203	82.60	86.74	82.88	0.28	3.86	82.92	84.52
MH204	83.27	86.49	82.89	0.00	3.60	82.93	84.67
MH205	82.87	86.51	82.89	0.02	3.62	82.93	84.52
MH401	81.30	85.20	82.35	1.05	2.85	82.35	83.40
MH401b	81.72	85.12	82.36	0.64	2.76	82.36	83.40
MH402	81.97	86.15	82.40	0.43	3.75	82.40	84.02
MH403	82.06	86.11	82.43	0.37	3.68	82.43	83.97
MH404	82.34	85.89	82.56	0.22	3.33	82.57	83.77
MH405	82.57	85.87	82.69	0.12	3.18	82.70	83.77
MH406	82.27	86.63	82.44	0.17	4.19	82.44	84.11
MH407	82.54	86.13	82.44	0.00	3.70	82.44	84.11
MH408	82.78	85.91	82.53	0.00	3.38	82.53	84.11
MH800	83.76	86.13	84.44	0.00	3.38	85.61	-
MH801	82.31	86.46	84.42	2.11	2.04	85.58	-
MH802	84.48	86.48	84.51	0.03	1.97	85.73	-
<b>Superpipe Storage</b> <i>(No Foundation Drain Connections)</i>							
MH501	83.85	86.42	86.39	2.54	0.03	86.44	-
MH502	83.94	86.33	86.39	2.45	-0.06	86.44	-
MH503	83.28	85.13	84.89	1.61	0.24	85.16	-
MH504	83.48	86.07	84.88	1.40	1.19	85.16	-
MH505	83.32	86.57	85.73	2.41	0.84	85.90	-
MH506	83.35	86.44	85.73	2.38	0.71	85.90	-
MH507	83.60	86.16	85.73	2.13	0.43	85.90	-
MH508	83.74	86.15	85.73	1.99	0.42	85.90	-
MH509	83.88	85.69	85.73	1.85	-0.04	85.90	-
MH510	84.00	85.79	85.73	1.73	0.06	85.87	-
MH600	83.58	85.45	83.96	0.38	1.49	83.96	-
MH601	83.62	85.41	85.44	1.82	-0.03	85.47	-
MH602	83.98	85.52	85.44	1.46	0.08	85.48	-
MH603	84.06	85.58	85.44	1.38	0.14	85.48	-
MH604	84.28	85.56	85.45	1.17	0.11	85.49	-

<sup>1)</sup> Based on PCSWMM results for a 4-hour Chicago storm distribution with 'Fixed' minor system outfall condition.

The results of the HGL analysis demonstrate that the proposed storm sewers have sufficient capacity to convey the controlled minor system peak flows up to the 100-year design event. The HGL elevations within the 'free-flowing' storm sewer are more than 0.30m below the minimum underside-of-footing elevation. This minimum clearance is also provided during the 'stress test' event.

### 6.3.5 Major System (Overland Flow)

A major overland flow route will be provided for storms greater than the 100-year storm event to provide conveyance of overland flows. The major overland system is depicted on the Grading Plan (**Drawing 122040-GR**).

The major system network was evaluated using the PCSWMM model to ensure that the overland flow depths and velocities conform to the SWM design criteria. The results of the analysis indicate that the 100-year overland flow depths on all streets will be less than 0.35m (static ponding + dynamic flow), and the product of depth and velocity will be less than 0.60 – refer to **Table 6.10**.

**Table 6-10: Overland Flow Results**

ID	100-year Event <sup>(1)</sup>					100-year (+20%) ‘Stress Test’ Event <sup>(1)</sup>			
	Peak Flow (L/s)	Velocity (m/s)	Static Depth (m)	Dynamic Depth (m)	Velocity x Depth (m <sup>2</sup> /s)	Peak Flow (L/s)	Velocity (m/s)	Dynamic Depth (m)	Velocity x Depth (m <sup>2</sup> /s)
<b>Catchbasins at Low Points</b>									
CB01/02	0	0	0.17	0.17	0	23.3	0.08	0.20	0.02
CB03/04	0	0	0.20	0.18	0	39.2	0.11	0.21	0.02
CB05/06	0	0	0.24	0.15	0	0	0	0.20	0
CB07/08	0	0	0.13	0.00	0	0	0	0.11	0
CB09	19.6	0.10	0.10	0.11	0.01	36.9	0.17	0.13	0.02
CB10/11	26.4	0.11	0.24	0.25	0.03	88.9	0.15	0.27	0.04
CB12/13	21.3	0.13	0.17	0.18	0.02	32.3	0.40	0.21	0.08
CB14/15	0	0	0.20	0.00	0	0	0	0.00	0
CB16	0	0	0.14	0.00	0	0	0	0.00	0
CB19	0	0	0.26	0.04	0	51.1	0.24	0.21	0.05
CB20	1.4	0.02	0.15	0.16	<0.01	15.9	0.05	0.19	0.01
CB21	0	0	0.11	0.10	0	3.1	0.05	0.13	0.01
CB22	0	0	0.15	0.06	0	0	0	0.11	0
CB23	0	0	0.12	0.04	0	0	0	0.09	0
CB24	0	0	0.17	0.04	0	0	0	0.10	0
CB25	0	0	0.14	0.04	0	0	0	0.11	0
<b>High Points</b>									
HP-CB01/02	-	-	-	-	-	23.1	0.08	0.03	<0.01
HP-CB03/04	-	-	-	-	-	43.1	0.11	0.02	<0.01
HP-CB05/06	-	-	-	-	-	-	-	-	-
HP-CB07/08	-	-	-	-	-	67.9	0.09	0.06	<0.01
HP-CB09	19.6	0.10	-	0.01	<0.01	35.7	0.21	0.02	<0.01
HP-CB10/11	26.4	0.11	-	0.01	<0.01	88.2	0.15	0.04	<0.01
HP-CB12/13	21.3	0.13	-	0.01	<0.01	31.8	0.40	0.04	0.02
HP-CB14/15	-	-	-	-	-	-	-	-	-
HP-CB16	-	-	-	-	-	-	-	-	-
HP-CB19	-	-	-	-	-	50.7	0.24	0.11	0.03
HP-CB20	1.4	0.02	-	0.01	<0.01	15.8	0.05	0.04	<0.01
HP-CB21	-	-	-	-	-	3.1	0.05	0.02	<0.01
HP-CB22	-	-	-	-	-	-	-	-	-
HP-CB23	-	-	-	-	-	-	-	-	-
HP-CB24	-	-	-	-	-	-	-	-	-
HP-CB25	-	-	-	-	-	-	-	-	-

<sup>1)</sup> Based on PCSWMM results for a 4-hour Chicago storm distribution with ‘Fixed’ minor system outfall condition.

The road sags, superpipe and rear yard perforated pipe / trench system will provide sufficient storage to contain all runoff from storms up to and including the 100-year storm event, and there will be no major system flows offsite during this event.

Runoff from commercial road is directed towards catchbasins that are connected to the proposed minor system (superpipes). In case catch basins are blocked, overland flow from the existing commercial road (Drainage areas C-01 and C-02) will spill towards adjacent property located in the northeast of the proposed site. Referring to the “General Plan of Services for Walkley-Conroy Commercial Site” drawing designed by Cumming Cockburn Limited on February 2000 (**Appendix E**), the stormwater management design of the adjacent property had accounted for the runoff from the commercial road. Therefore, the proposed development will not cause adverse impacts to the stormwater management of the commercial site.

**6.4 Stormwater Quality Treatment**

Through correspondence with the Rideau Valley Conservation Authority (RVCA), it is understood that the site will require an ‘Enhanced’ level of water quality treatment (80% long-term TSS removal). No water quality controls are provided for the Park Block. The future Retirement Residence will need to provide water quality treatment.

Water Quality Treatment Units (Contech CDS units or approved equivalent) will be provided upstream the minor system connection to the off-site storm sewer. The Water Quality Treatment units have been sized to treat 90% of the runoff and provide 80% long-term TSS removal (based on the ‘fine’ particle size distribution). Refer to correspondence and documentation provided in **Appendix E**. The sizing parameters and corresponding Water Quality Treatment Units are summarized in **Table 6.11**.

**Table 6-11: Water Quality Treatment Units**

Outlet	MH	Drainage Area (ha)	Runoff Coef.	Percent Impervious (%)	Peak Flow <sup>(1)</sup>		WQT Unit Model
					25mm (L/s)	100-year (L/s)	
Conroy Rd.	MH600 <sup>(2)</sup>	0.290	0.73	75.2	15.4	29.5	CDS PMSU2015-4-C
St. Laurent Blvd.	MH201	1.872	0.62	60.0	119.4	224.6	CDS PMSU2025-5-C
St. Laurent Blvd.	MH401	2.004	0.69	70.0	90.7	139.7	CDS PMSU3020-6-C

<sup>1)</sup> Based on PCSWMM model results for a 4-hour Chicago storm with ‘Normal’ outfall condition.

<sup>2)</sup> MH600 on the Commercial Road is downstream an ICD / Superpipe system.

## **7.0 EROSION AND SEDIMENT CONTROL**

Temporary erosion and sediment control measures will be implemented on-site during construction in accordance with the Best Management Practices for Erosion and Sediment Control. This includes the following temporary measures:

- Filter socks (catchbasin inserts) will be placed in existing and proposed catchbasins and catchbasin manholes, and will remain in place until vegetation has been established and construction is completed;
- Silt fencing will be placed along the surrounding construction limits;
- Mud mats will be installed at the site entrances;
- Strawbale or rock check dams will be installed in swales and ditches;
- The contractor will be required to perform regular street sweeping and cleaning as required, to suppress dust and to provide safe and clean roadways adjacent to the construction site;

Erosion and sediment control measures should be inspected daily and after every rain event to determine maintenance, repair or replacement requirements. Sediments or granulars that enter site sewers shall be removed immediately by the contractor. These measures will be implemented prior to the commencement of construction and maintained in good order until vegetation has been established. Refer to the Erosion and Sediment Control Plan (drawing 122040-ESC) for additional information.

## **8.0 CONCLUSIONS AND RECOMMENDATIONS**

### Watermain

The analysis of the existing and proposed watermain network confirms the following:

- The three (3) proposed 200mm dia. watermain services which connect to Don Reid Drive, and St. Laurent Boulevard can service the proposed development.
- There are adequate pressures in the existing watermain infrastructure to meet the required domestic demands for the development.
- There is adequate flow to service the proposed fire protections system.

### Sanitary Servicing

The analysis of the existing and proposed sanitary system confirms the following:

- It is proposed to service the development with a proposed 250mm Sanitary service which will connect to existing sewers within the Don Reid Drive and St. Laurent Boulevard rights-of-way.
- There is adequate capacity within city infrastructure downstream from the development.

### Stormwater Management

The following provides a summary of the storm sewer and stormwater management system:

- The proposed storm sewer system will consist of a 'free-flowing' storm sewer and offline superpipe system.
  - A perforated pipe / trench system will be provided in the rear yards to provide additional storage.
  - The roadway has also been graded to promote surface ponding in the road sags.
  - Inlet control devices will be used to adhere to the 100-year allowable release rate.
  - There will be no offsite major system flows for all storms up-to and including the 100-year storm event.
- There will be no offsite major system flows for all storms up-to and including the 100-year storm event.
- As per the proposed grading plans, major overland flow routes have been provided to the surrounding rights-of-way.
- Stormwater water quality treatment will be provided via Water Quality Treatment Units (Contech CDS units or approved equivalent) installed in the downstream MH for the Commercial Road to Conroy Road and the two (2) residential road connections to St. Laurent Boulevard.

### Erosion and Sediment control

- Erosion and sediment control measures (i.e. filter fabric, catchbasin inserts, silt fences, etc.) will be implemented prior to construction and are to remain in place until vegetation is established.

## 9.0 CLOSURE

This report is respectfully submitted for review and approval. Please contact the undersigned should you have questions or require additional information.

### NOVATECH

Prepared by:



Anthony Mestwarp, P.Eng.  
Project Manager  
Land Development Engineering



Lucas Wilson, P.Eng.  
Project Manager  
Engineering

Report Reviewed by:



Greg MacDONALD, P.Eng.  
Director, Land Development and Public Sector Infrastructure

**Appendix A**  
**Pre - Consultation Meeting Minutes**

## Pre-consultation Notes – Updated June 1, 2022

Meeting: Thursday April 14, 2022 @ 1:30pm

### City Attendees:

Kelby Lodoen Unseth - Planner  
Sharif Sharif – Project Manager  
Mike Giampa – Transportation Project  
Manager  
Environmental Planner – Matthew  
Hayley

Mark Richardson – Forestry  
Phil Castro – Parks and Facilities Planning  
Selma Hassan – Urban Design

### Location:

2510 St. Laurent Blvd. (Conroy & Walkley)

### Property Overview and Discussion:

The properties located on the southwest corner of Conroy Road and Walkley Road, collectively referred to as 2510 St. Laurent Blvd, are currently zoned GM[1327]. The site is also located within the General Urban Area as shown on Schedule B of the Official Plan.

The intent of the GM zone is to:

1. *allow residential, commercial and institutional uses, or mixed use development in the **General Urban Area** and in the **Upper Town, Lowertown and Sandy Hill West Character Areas** of the **Central Area** designations of the Official Plan;*
2. *limit commercial uses to individual occupancies or in groupings in well defined areas such that they do not affect the development of the designated Traditional and Arterial Mainstreets as viable mixed-use areas;*
3. *permit uses that are often large and serve or draw from broader areas than the surrounding community and which may generate traffic, noise or other impacts provided the anticipated impacts are adequately mitigated or otherwise addressed; and*
4. *impose development standards that will ensure that the uses are compatible and complement surrounding land uses.*


Urban Exception 1327 also outlines additional performance standards for the site.

The redevelopment of the subject properties proposes a mix of townhome and back-to-back townhome units, a public park, and retirement home block. All of these uses are permitted within the GM zone, as well as Planned Unit Development.


# Pre-consultation Notes – Updated June 1, 2022

Meeting: Thursday April 14, 2022 @ 1:30pm

Property:

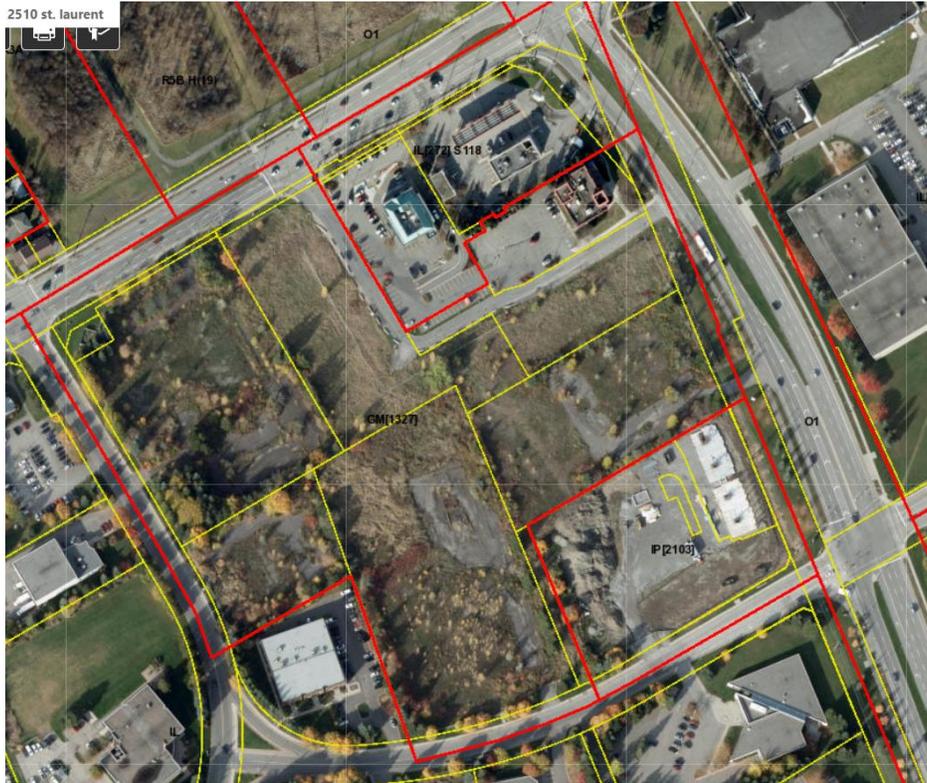

Site Plan Concept:

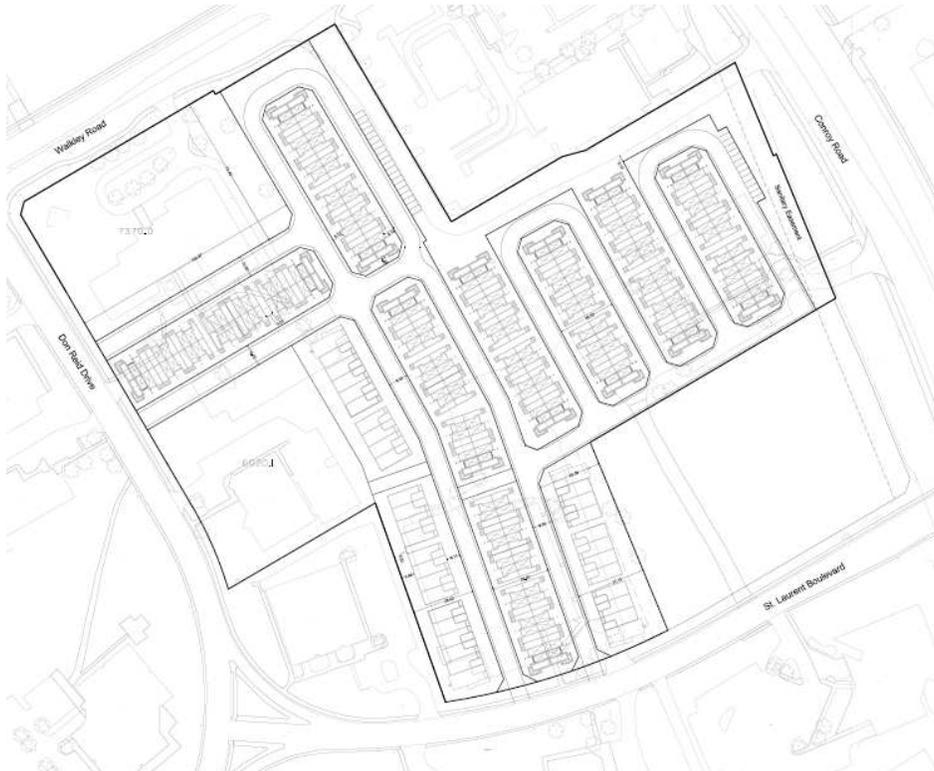

## Pre-consultation Notes – Updated June 1, 2022

Meeting: Thursday April 14, 2022 @ 1:30pm

### **Parks**

- 1) Parks and Facilities Planning is currently undertaking a legislated review for the replacement of the Parkland Dedication By-law, with the new by-law to be considered by City Council in early July 2022. To ensure you are aware of parkland dedication requirements for your proposed development, we encourage you to familiarize yourself with the [existing Parkland Dedication By-law](#) and to sign up for project notifications on the [Engage Ottawa project page](#) or by emailing the project lead at [Kersten.Nitsche@ottawa.ca](mailto:Kersten.Nitsche@ottawa.ca)
- 2) Parkland dedication will be required as a condition of subdivision approval. The determination of the parkland area to be dedicated will be in accordance with the City's Parkland Dedication By-law and would be capped at 10 percent of the land area under consideration for residential apartment purposes. As discussed during the pre-application consultation meeting, the final parkland area to be dedicated will depend upon the future proposed uses and densities. How this is determined and addressed will require further discussion during the review of a formal submission. However, the initial proposed location is appropriate.

### **Environment:**

- 3) RSC  
In this property, it appears there was some sort of commercial office building (note this is solely based on our discussion today and would need to be confirmed through the appropriate Phase I ESA). Change such land use to a more sensitive land use (ie. Residential) requires filing an RSC. The requirement for filing an RSC is based on the actual use rather than the formal zoning.
- 4) Bird Safe Design Guidelines  
If a portion of the development proposal includes any mid to high rise buildings then that part of the proposal will need to review and incorporate bird safe design elements. Some of the risk factors include glass and related design traps such as corner glass and fly-through conditions, ventilation grates and open pipes, landscaping, light pollution. More guidance and solutions are available in the guidelines which can be found here: <https://ottawa.ca/en/planning-development-and-construction/developing-property/development-application-review-process/development-application-submission/guide-preparing-studies-and-plans>
- 5) Butternut trees  
Other than potential butternut trees, there does not seem to be a trigger for an EIS, if butternut are present, it is recommended that they be addressed through the TCR and any potential permit requirements be addressed that way. If that is not possible, the butternut tree, if present, can be addressed through an EIS.

## Pre-consultation Notes – Updated June 1, 2022

Meeting: Thursday April 14, 2022 @ 1:30pm

### **Forestry:**

#### **TCR requirements:**

- 6) A Tree Conservation Report (TCR) must be supplied for review along with the suite of other plans/reports required by the City
  - a) an approved TCR is a requirement of Site Plan approval.
  - b) The TCR may be combined with the LP provided all information is supplied.
- 7) Any removal of privately-owned trees 10cm or larger in diameter, or city-owned trees of any diameter requires a tree permit issued under the Tree Protection Bylaw (Bylaw 2020 – 340); the permit will be based on an approved TCR and made available at or near plan approval.
- 8) The Planning Forester from Planning and Growth Management as well as foresters from Forestry Services will review the submitted TCR
  - a) If tree removal is required, both municipal and privately-owned trees will be addressed in a single permit issued through the Planning Forester
  - b) Compensation may be required for city owned trees – if so, it will need to be paid prior to the release of the tree permit
- 9) The TCR must list all trees on site, as well as off-site trees if the CRZ extends into the developed area, by species, diameter and health condition
- 10) Please identify trees by ownership – private onsite, private on adjoining site, city owned, co-owned (trees on a property line)
- 11) If trees are to be removed, the TCR must clearly show where they are, and document the reason they cannot be retained
- 12) All retained trees must be shown and all retained trees within the area impacted by the development process must be protected as per City guidelines available at Tree Protection Specification or by searching Ottawa.ca
  - a) the location of tree protection fencing must be shown on a plan
  - b) show the critical root zone of the retained trees
  - c) if excavation will occur within the critical root zone, please show the limits of excavation
- 13) The City encourages the retention of healthy trees; if possible, please seek opportunities for retention of trees that will contribute to the design/function of the site.
- 14) For more information on the process or help with tree retention options, contact Mark Richardson [mark.richardson@ottawa.ca](mailto:mark.richardson@ottawa.ca) or on City of Ottawa

## Pre-consultation Notes – Updated June 1, 2022

Meeting: Thursday April 14, 2022 @ 1:30pm

### LP tree planting requirements:

For additional information on the following please contact [tracy.smith@Ottawa.ca](mailto:tracy.smith@Ottawa.ca)

#### 15) Minimum Setbacks

- a) Maintain 1.5m from sidewalk or MUP/cycle track.
- b) Maintain 2.5m from curb
- c) Coniferous species require a minimum 4.5m setback from curb, sidewalk or MUP/cycle track/pathway.
- d) Maintain 7.5m between large growing trees, and 4m between small growing trees. Park or open space planting should consider 10m spacing, except where otherwise approved in naturalization / afforestation areas. Adhere to Ottawa Hydro's planting guidelines (species and setbacks) when planting around overhead primary conductors.

#### 16) Tree specifications

- a) Minimum stock size: 50mm tree caliper for deciduous, 200cm height for coniferous.
- b) Maximize the use of large deciduous species wherever possible to maximize future canopy coverage
- c) Tree planting on city property shall be in accordance with the City of Ottawa's Tree Planting Specification; and include watering and warranty as described in the specification (can be provided by Forestry Services).
- d) Plant native trees whenever possible
- e) No root barriers, dead-man anchor systems, or planters are permitted.
- f) No tree stakes unless necessary (and only 1 on the prevailing winds side of the tree)

#### 17) Hard surface planting

- a) Curb style planter is highly recommended
- b) No grates are to be used and if guards are required, City of Ottawa standard (which can be provided) shall be used.
- c) Trees are to be planted at grade

#### 18) Soil Volume

- a) Please ensure adequate soil volumes are met:

Tree Type/Size	Single Tree Soil Volume (m <sup>3</sup> )	Multiple Tree Soil Volume (m <sup>3</sup> /tree)
Ornamental	15	9
Columnar	15	9
Small	20	12
Medium	25	15
Large	30	18

## Pre-consultation Notes – Updated June 1, 2022

### Meeting: Thursday April 14, 2022 @ 1:30pm

Conifer	25	15
---------	----	----

Please note that these soil volumes are not applicable in cases with Sensitive Marine Clay.

#### 19) Sensitive Marine Clay

- a) Please follow the City's 2017 Tree Planting in Sensitive Marine Clay guidelines

### **Tree Canopy Cover**

- a) The landscape plan shall show how the proposed tree planting will replace and increase canopy cover on the site over time, to support the City's 40% urban forest canopy cover target.
- b) At a site level, efforts shall be made to provide as much canopy cover as possible, through tree planting and tree retention, with an aim of 40% canopy cover at 40 years, as appropriate.
- c) Indicate on the plan the projected future canopy cover at 40 years for the site.

### **Urban Design:**

20) The application says it is for "a mix of Back to Back and Standard Freehold Townhomes on Public streets, a public park and a Retirement Home block"

- o Where is the public park?
- o Where is the retirement home block?
- o The largest ROWs appear to be 10m? Is this a City ROW standard? 192 Back to back units, 36 Standard Townhomes

21) A Design Brief will be required with the application. I have attached a Terms of Reference. All the highlighted items must be addressed, in addition to the comments and questions in this email.

22) It is not clear from the submitted drawing if / where there are sidewalks. The submission needs to show the location of all internal sidewalks. At minimum, there should be sidewalks on the public ROWs and on any roads entering the site from St. Laurent Blvd. or other streets.

23) The road network is circuitous for pedestrians and cyclists without mid-block and pathway connections. These should be added or people will create them anyways. See the purple dashed lines on the attached sketch for locations; these are suggested based on the drawing provided. If the locations of the public park and retirement home block were shown, other connections would likely be warranted and these should be added on the submission with the application.

24) The two roadway entries from St. Laurent Blvd. are only 26m apart. Is this sufficient if both are proposed to be full movement intersections and not right-in

## Pre-consultation Notes – Updated June 1, 2022

### Meeting: Thursday April 14, 2022 @ 1:30pm

right-out access? The applicant could consider a single 20 – 22M ROW access from St. Laurent, that then splits in two (see red lines on attached sketch)

- 25) Can there be vehicular access to the site from Conroy, Don Reid and/or Walkley?
- 26) What traffic calming methods are being proposed for the long, straight stretches of street.
- 27) The development form suggests that there will be little room for trees. The submission is to include a landscape plan that shows tree locations given the locations of all driveways and the information on the composite utility plan.

### **Engineering:**

#### *List of Reports and Plans (Site Plan Control/ Condo):*

- i. Site Servicing Plan
- ii. Grading Plan
- iii. Erosion and Sediment Control Plan
- iv. Storm Drainage and Ponding Plan
- v. Sanitary Drainage Plan
- vi. Stormwater Management and Site Servicing Report
- vii. Geotechnical Investigation Report

Please note the following information regarding the engineering design submissions for the above noted site:

- 28) The Servicing Study Guidelines for Development Applications are available at the following address:  
<https://ottawa.ca/en/city-hall/planning-and-development/how-develop-property/development-application-review-process-2/guide-preparing-studies-and-plans>

- 29) Servicing and site works shall be in accordance with the following documents:
  - Ottawa Sewer Design Guidelines, Second Edition, (October 2012), including Technical Bulletins, ISDTB-2014-01, PI EDTB-2016-01, ISTB 2018-01, ISTB-2018-04, and ISTB-2019-02
  - Ottawa Design Guidelines – Water Distribution, First Edition, (July 2010), including Technical Bulletins ISD-2010-2, ISDTB-2014-02, ISTB-2018-02, and ISTB-2021-03
  - Geotechnical Investigation and Reporting Guidelines for Development Applications in the City of Ottawa (Revised 2008)
  - City of Ottawa Slope Stability Guidelines for Development Applications (Revised 2012)
  - City of Ottawa Environmental Noise Control Guidelines (January, 2016)

## Pre-consultation Notes – Updated June 1, 2022

### Meeting: Thursday April 14, 2022 @ 1:30pm


- City of Ottawa Hydrogeological and Terrain Analysis Guidelines (March 2021)
- City of Ottawa Park and Pathway Development Manual (2012)
- City of Ottawa Accessibility Design Standards (2012)
- Ottawa Standard Tender Documents (latest version)
- Ontario Provincial Standards for Roads & Public Works (2013)

30) Record drawings and utility plans are also available for purchase from the City (Contact the City's Information Centre by email at [InformationCentre@ottawa.ca](mailto:InformationCentre@ottawa.ca) or by phone at (613) 580-2424 x 44455

31) The Stormwater Management Criteria for the subject site is to be based on the following:

- The pre-development runoff coefficient or a maximum equivalent 'C' of 0.5, whichever is less (§ 8.3.7.3).
- For separated sewer system built pre-1970 the design of the storm sewers are based on a 2 year storm.
- Flows to the storm sewer in excess of the 5-year pre-development storm release rate, up to and including the 100-year storm event, must be detained on site
- Ensure no overland flow for all storms up to and including the 100-year event.
- The 5-yr storm event using the IDF information derived from the Meteorological Services of Canada rainfall data, taken from the MacDonald Cartier Airport, collected 1966 to 1997.
- A calculated time of concentration (Cannot be less than 10 minutes).
- No ponding during 2-yr storm event onsite.
- There might be specific design criteria from the "Master Servicing Study" of this area. Consultant to investigate and verify those requirements.
- Quality control requirements to be provided by Rideau Valley Conservation Authority (RVCA)

32) Deep Services:

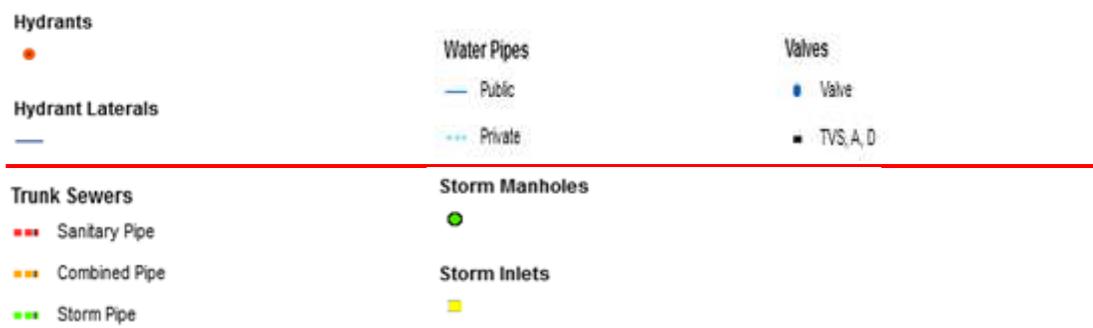

- A plan view of the approximate services may be seen above. Services should ideally be grouped in a common trench to minimize the number of road cuts. The sizing of available future services is:*
  - Connections (St laurent):

## Pre-consultation Notes – Updated June 1, 2022

### Meeting: Thursday April 14, 2022 @ 1:30pm

- i. 300 mm dia. Watermain (DI)
      - ii. 375 mm dia. SAN (PVC)
      - iii. 1500 mm dia. STM (Conc)
    - b) Connections (Don Reid):
      - i. 300 mm dia. Watermain (DI)
      - ii. 250 mm dia. SAN (PVC)
      - iii. 750/900 mm dia. STM (Conc)
  - ii. *Because of the size of this development, it is highly recommended to verify the sanitary and storm discharge with the City to confirm the capacity before finalize the design and submit for review.*
  - iii. *Provide existing servicing information and the recommended location for the proposed connections. Services should ideally be grouped in a common trench to minimize the number of road cuts.*
  - iv. *Connections to trunk sewers and easement sewers are typically not permitted.*
  - v. *Provide information on the monitoring manhole requirements – should be located in an accessible location on private property near the property line (ie. Not in a parking area).*
  - vi. *Review provision of a high-level sewer.*
  - vii. *Provide information on the type of connection permitted*

Sewer connections to be made above the springline of the sewermain as per:

    - a) Std Dwg S11.1 for flexible main sewers – *connections made using approved tee or wye fittings.*
    - b) Std Dwg S11 (For rigid main sewers) – *lateral must be less than 50% the diameter of the sewermain,*
    - c) Std Dwg S11.2 (for rigid main sewers using bell end insert method) – *for larger diameter laterals where manufactured inserts are not available; lateral must be less than 50% the diameter of the sewermain,*
    - d) Connections to manholes permitted when the connection is to rigid main sewers where the lateral exceeds 50% the diameter of the sewermain.  
– Connect obvert to obvert with the outlet pipe unless pipes are a similar size.
    - e) *No submerged outlet connections.*
- 33) Civil consultant must request boundary conditions from the City's assigned Project Manager prior to first submission. Water Boundary condition requests must include the location of the service and the expected loads required by the proposed development. Please provide the following information:
- i. Location of service(s)
  - ii. Type of development and the amount of fire flow required (as per FUS, 1999).
  - iii. Average daily demand: \_\_\_\_ l/s.

## Pre-consultation Notes – Updated June 1, 2022

### Meeting: Thursday April 14, 2022 @ 1:30pm

- iv. Maximum daily demand: \_\_\_ l/s.
- v. Maximum hourly daily demand: \_\_\_ l/s.
- vi. Hydrant location and spacing to meet City's Water Design guidelines.
- vii. Water supply redundancy will be required for more than 50 m<sup>3</sup>/day water demand.

34) Phase 1 ESAs and Phase 2 ESAs must conform to clause 4.8.4 of the Official Plan that requires that development applications conform to Ontario Regulation 153/04.

35) All development applications should be considered for an Environmental Compliance Approval (ECA) by the Ministry of the Environment, Conservation, and Parks (MECP);

- a. The consultants determine if an approval for sewage works under Section 53 of OWRA is required and determines what type of application. The City's project manager may help confirm and coordinate with the MECP as required.
- b. The project will be either transfer of review (standard), transfer of review (additional), direct submission, or exempt as per O. Reg. 525/98.
- c. Pre-consultation is not required if applying for standard or additional works (Schedule A of the Agreement) under Transfer Review.
- d. Pre-consultation with local District office of MECP is recommended for direct submission.
- e. Consultant completes an MECP request form for a pre-consultation. Send request to [moeccottawasewage@ontario.ca](mailto:moeccottawasewage@ontario.ca)
- f. ECA applications are required to be submitted online through the MECP portal. A business account required to submit ECA application. For more information visit <https://www.ontario.ca/page/environmental-compliance-approval>

NOTE: Site Plan Approval, or Draft Approval, is required before an application is sent to the MECP.

36) General Engineering Submission requirements:

- a. As per section 53 of the Professional Engineers Act, O. Reg 941/40, R.S.O. 1990, all documents prepared by engineers must be signed and dated on the seal.
- b. All required plans are to be submitted on standard A1 size sheets (594mm x 841mm) sheets, utilizing a reasonable and appropriate metric scale as per City of Ottawa Servicing and Grading Plan Requirements: title blocks are to be placed on the right of the sheets and not along the bottom. Engineering plans may be combined, but the Site Plans must be provided separately. Plans shall include the survey monument used to confirm datum. Information shall be provided to enable a non-surveyor to locate the survey monument presented by the consultant.

## Pre-consultation Notes – Updated June 1, 2022

### Meeting: Thursday April 14, 2022 @ 1:30pm

- c. All required plans & reports are to be provided in \*.pdf format (at application submission and for any, and all, re-submissions)

#### **Planning:**

- 37) As the property is adjacent to business park and light industrial zones further consideration may be required to separate/buffer the two types of uses.
- 38) The site is not subject to a CDP or Secondary Plan. Within the OP Schedule B identifies the site as General Urban, Schedule C identifies a cross-town bikeway and cycling spine route, and Schedule D identifies a proposed BRT station at Conroy and Walkley.
- 39) It is noted within the New OP under section 5.3.2.4) In the Outer Urban Transect, the Zoning By-law shall provide for a range of dwelling unit sizes in: a) Multi-unit dwellings in Hubs and on Corridors; b) Predominantly ground-oriented forms in Neighbourhoods located away from frequent street transit and Corridors, with Low-rise multi-unit dwellings permitted near rapid transit and frequent street transit routes; and c) In Hubs, a range of housing
- 40) Within the new OP, further policy states:

**Table 3b**

Neighbourhood and Minor Corridor Residential Density and Large Dwelling Targets			
Applicable Area	Target Residential Density Range for Intensification, Dwellings per Net Hectare <sup>1</sup>		Minimum Proportion of Large-household Dwellings within Intensification
Outer Urban Transect	40 to 60		Existing lots with a frontage 15 metres or wider: - Target of 50 per cent for Low-rise buildings; - Target of 5 per cent for Mid-rise or taller buildings;  Minor Corridors: No minimum
Outer Urban Transect	5.3.3(1)	Hubs	Low-rise, Mid-rise and High-rise: minimum 3 storeys and maximum 40 storeys
	5.3.3(3)	Mainstreet Corridors	Low-rise, Mid-rise and High-rise: minimum 2 storeys and maximum 40 storeys, dependent on road width and transition
	5.3.3(4)	Minor Corridors	Low-rise: minimum 2 storeys and maximum 4 storeys
	5.3.4(1)	Neighbourhoods	Low-rise: no minimum and generally, zoning will permit at least 3 storeys but no more than 4 storeys

#### 5.2.3

## Pre-consultation Notes – Updated June 1, 2022

### Meeting: Thursday April 14, 2022 @ 1:30pm

4) All buildings along Mainstreets or Minor Corridors shall have active entrances facing the Mainstreet or Minor Corridor, regardless of use.

41) The application appears to be a Complex Site Plan Control Application.

42) City of Ottawa Accessibility Design Standards:

[https://documents.ottawa.ca/sites/documents/files/documents/accessibility\\_design\\_standards\\_en.pdf](https://documents.ottawa.ca/sites/documents/files/documents/accessibility_design_standards_en.pdf)

43) Please ensure that the Parking, Queuing and Loading Provisions are following and appropriate vehicle and bicycle parking is provided on-site (<https://ottawa.ca/en/part-4-parking-queuing-and-loading-provisions-sections-100-114#bicycle-parking-space-rates-and-provisions-sec-111>).

44) Please ensure that the Landscaping Provisions for Parking Lots is followed (<https://ottawa.ca/en/part-4-parking-queuing-and-loading-provisions-sections-100-114#section-110-landscaping-provisions-parking-lots>).

45) The Planning Rationale Terms of Reference may be found [here](#).

46) For information on Applications, including fees, please visit:

<https://ottawa.ca/en/planning-development-and-construction/developing-property/development-application-review-process/development-application-submission/development-application-forms#site-plan-control>

47) The application processing timeline generally depends on the quality of the submission. For more information on standard processing timelines, please visit:

<https://ottawa.ca/en/city-hall/planning-and-development/information-developers/development-application-review-process/development-application-submission/development-application-forms#site-plan-control>

### **Transportation:**

48) A TIA is warranted, therefore proceed to Step 2-scoping.

49) The application will not be deemed complete until the submission of the draft step 2-4, including the functional draft RMA package (if applicable) and/or monitoring report (if applicable).

50) Although a full review of the TIA Strategy report (Step 4) is not required prior to an application, it is strongly recommended. Synchro files are required at Step 4.

51) ROW protections on both Walkley and Conroy is 44.5 m.

52) Corner sight triangle: 5m x 5m. A Road Noise Impact Study is required.

## Pre-consultation Notes – Updated June 1, 2022

Meeting: Thursday April 14, 2022 @ 1:30pm

### **Prior attachments:**

- Plan and study list
- Urban Design Terms of Reference
- Urban Design Sketch

For any questions, please feel free to contact me at the information below. Please provide all submission documents electronically as paper copies of plans and reports are not being requested at this time.

Best regards,



**Kelby Lodoen Unseth** MCIP, RPP

Planner II | Urbaniste II

Development Review (South Services) | Examen des projets d'aménagement (services sud)

Planning, Infrastructure and Economic Development | Services de planification, d'infrastructure et de développement économique

City of Ottawa | Ville d'Ottawa

☎ 613.580.2424 ext./poste 12852

[ottawa.ca/planning](http://ottawa.ca/planning) / [ottawa.ca/urbanisme](http://ottawa.ca/urbanisme)

Enc.

**Appendix B**  
**Water Servicing**

# WATER DEMAND DESIGN SHEET

Novatech Project #: 122040  
 Project Name: Conroy Walkley  
 Date Prepared: 9/26/2022  
 Date Revised: 10/4/2022  
 Date Revised: 7/6/2023  
 Date Revised: 8/1/2023  
 Date Revised: 6/6/2024  
 Input By: Curtis Ferguson, E.I.T.  
 Reviewed By: Anthony Mestwarp, P.Eng

Legend:

**PROJECT SPECIFIC INFO**  
 USER DESIGN INPUT  
 CALCULATED AVERAGE DAY CELL OUTPUT  
 CALCULATED BASIC DAY CELL OUTPUT  
 CALCULATED MAX DAY CELL OUTPUT  
 CALCULATED PEAK HOUR CELL OUTPUT  
 CALCULATED MAX DAY + RFF CELLOUTPUT



LOCATION		TOTAL WATER DEMAND															
NODE	SMALL SYSTEM *	RESIDENTIAL DEMAND & AVERAGE DEMAND							BASIC DAY DEMAND DAILY VOLUME (m³)	DESIGN FIRE DEMAND							
		SINGLES	SEMIS/TOWNS	APTS (2BR)	APTS (1BR)	APTS (AVG)	POP. EQUIV.	RES. AVERAGE DAY FLOW DEMAND (L/s)		MAXIMUM DAY DEMAND		PEAK HOUR DEMAND		REQUIRED FIRE FLOW (RFF)			MAX DAY + GOVERNING RFF (L/s)
									RES. PEAKING FACTOR	MAX DAY FLOW DEMAND (L/s)	RES. PEAKING FACTOR	PEAK HOUR FLOW DEMAND (L/s)	RFF 1 FUS (L/min)	RFF 2 FUS (L/min)			
N 1-1	NO		155				418.5	1.356	83.7	2.50	3.391	2.20	7.459	17,000	16,000		286.72
<b>SUB-TOTAL</b>	<b>NA</b>	<b>0</b>	<b>155</b>	<b>0</b>			<b>418.5</b>	<b>1.356</b>	<b>83.7</b>	<b>2.50</b>	<b>3.391</b>	<b>2.20</b>	<b>7.459</b>	<b>17,000</b>	<b>16,000</b>		<b>286.72</b>

**DEMAND PARAMETERS**

Residential					
Unit Type Population Equiv.	Singles	Semis/Towns	Apts (2-BR)	Apts (1-BR)	Apts (AVG)
	3.4	2.7	2.1	1.4	1.8
Daily Demand L/per person/day					
Average Demand	280				
Basic Demand	200				
Res. Peaking Factors		Max Day (x Avg Day)	Peak Hour (x Max Day)		
Population > 500 (L/c/day)		2.50	2.20		
Residential Peaking Factors City of Ottawa Water Distribution Guidelines					

**Vulnerable Service Area (VSA) Review \*\*\***  
 < 50 m³/day  
 > 50 m³/day  
 \*\*\*Note: Designer to review Node / Total VSA.

Quick Fire Flow Reference Guide ****			
FUS (L/min)	Comments	OBC (L/min)	Comments
> 2,000	Min FUS	< 9,000	Unsprinklered Non- Combustible
10,000	Low Density - Singles/Towns Complies w/ TB2014-01 Cap. (10m rear spacing, 6 units max, <600 m²)		
13,000	Non-complying w/TB2014-01. Calculate.		
15,000	Medium Density Back-to-back Towns.		
20,000	High Density Wood Frame 4-Storey		
5,000	Fire-Resistive Podium/Multi-Storey		
30,000	High Contiguous / Hazard Areas		
< 45,000	Max FUS		
****Note: Designer to confirm RFF @ each node using FUS / OBC. Use Novatech FUSv2-0 and OBCv2-0 or NFPA.			

# FUS - Fire Flow Calculations

As per 2020 Fire Underwriter's Survey Guidelines



Engineers, Planners & Landscape Architects

Novatech Project #: 122040  
 Project Name: 2510 St. Lawrence Blvd. (Walkely Conroy)  
 Date: 7/8/2024  
 Input By: Curtis Ferguson, E.I.T.  
 Reviewed By: Anthony Mestwarp, P.Eng

Legend

Input by User  
 No Information or Input Required

Building Description: Block 1 - 3 Storey Townhomes  
 Type V - Wood frame

Step	Input		Value Used	Total Fire Flow (L/min)	
<b>Base Fire Flow</b>					
1	<b>Construction Material</b>		<b>Multiplier</b>	1.5	
	<b>Coefficient related to type of construction</b> <b>C</b>	Type V - Wood frame	Yes		1.5
		Type IV - Mass Timber			Varies
		Type III - Ordinary construction			1
		Type II - Non-combustible construction			0.8
Type I - Fire resistive construction (2 hrs)			0.6		
2	<b>Floor Area</b>		1,370	12,000	
	<b>A</b>	Building Footprint (m <sup>2</sup> )			456.59
		Number of Floors/Storeys			3
		Area of structure considered (m <sup>2</sup> )			
<b>F</b>	Base fire flow without reductions				
<b>Reductions or Surcharges</b>					
3	<b>Occupancy hazard reduction or surcharge</b>		<b>FUS Table 3</b>	<b>Reduction/Surcharge</b>	
	<b>(1)</b>	Non-combustible		-25%	
		Limited combustible	Yes	-15%	
		Combustible		0%	
		Free burning		15%	
Rapid burning			25%		
4	<b>Sprinkler Reduction</b>		<b>FUS Table 4</b>	<b>Reduction</b>	
	<b>(2)</b>	Adequately Designed System (NFPA 13)	No	-30%	
		Standard Water Supply	No	-10%	
		Fully Supervised System	No	-10%	
		<b>Cumulative Sub-Total</b>		<b>0%</b>	
<b>Area of Sprinklered Coverage (m<sup>2</sup>)</b>		<b>0</b>	<b>0%</b>		
<b>Cumulative Total</b>			<b>0%</b>		
5	<b>Exposure Surcharge</b>		<b>FUS Table 6</b>	<b>Surcharge</b>	
	<b>(3)</b>	North Side	3.1 - 10 m	16%	
		East Side	10.1 - 20 m	13%	
		South Side	0 - 3 m	21%	
		West Side	10.1 - 20 m	11%	
<b>Cumulative Total</b>		<b>61%</b>			
<b>Results</b>					
6	<b>(1) + (2) + (3)</b>	<b>Total Required Fire Flow, rounded to nearest 1000L/min</b>		<b>L/min</b>	
		(2,000 L/min < Fire Flow < 45,000 L/min)		<b>16,000</b>	
		or	L/s	<b>267</b>	
		or	USGPM	<b>4,227</b>	

**Novatech Project #:** 122040A  
**Project Name:** Walkley Conroy  
**Date:** 7/8/2024  
**Input By:** Curtis Ferguson, E.I.T.  
**Reviewed By:** Anthony Mestwarp, P.Eng

**Building Description:** 6 Unit - 3 Storey Townhouse  
**Type V - Wood Frame**  
 Automatic Sprinklers No

### FUS - Table 6 worksheet

To be used only if adjacent *Exposed Building* construction is known



Calculated Exposure Charges	
Table 6	
North Side	16%
East Side	13%
South Side	21%
West Side	11%
<b>Total</b>	<b>61%</b>

Exposed Building West	
Description/Address	4-unit, 2-Storey Town
Height (storeys*)	1.47
Construction Type	Type V - Wood frame
Protected Openings	No
Length-Height Factor	35.868
Automatic Sprinklers	No
Exposure Surcharge Adjustment	11%

Length (m)

24.4

Distance (m)  
19

Exposed Building North	
Description/Address	4-unit, 3-Storey Town
Height (storeys*)	2.04
Construction Type	Type V - Wood frame
Protected Openings	No
Length-Height Factor	25.5
Automatic Sprinklers	No
Exposure Surcharge Adjustment	16%

Length (m) 12.5

Distance (m)

3.8



Distance (m)

3

Length (m) 12.5

Exposed Building East	
Description/Address	6-unit, 3-Storey Town
Height (storeys*)	2.04
Construction Type	Type V - Wood frame
Protected Openings	No
Length-Height Factor	74.664
Automatic Sprinklers	No
Exposure Surcharge Adjustment	13%

Length (m)

36.6

Distance (m)  
14.4

Exposed Building South	
Description/Address	6-unit, 3-Storey Town
Height (storeys*)	2.04
Construction Type	Type V - Wood frame
Protected Openings	No
Length-Height Factor	25.5
Automatic Sprinklers	No
Exposure Surcharge Adjustment	21%

\* 8.145m

\* Storey assumption is based on 4m or fraction thereof. Adjust number of stories for non-standard storey heights (i.e. 10m single storey warehouse)

Source of Information	

Legend Input by User  
 No Information or Input Required

# FUS - Fire Flow Calculations

As per 2020 Fire Underwriter's Survey Guidelines



Engineers, Planners & Landscape Architects

**Novatech Project #:** 122040  
**Project Name:** 2510 St. Lawrence Blvd. (Walkely Conroy)  
**Date:** 7/11/2023  
**Revised:** 1/16/2024  
**Input By:** Curtis Ferguson, E.I.T.  
**Reviewed By:** Anthony Mestwarp, P.Eng

Legend


Input by User

No Information or Input Required

**Building Description:** Block 2 - Standard Townhomes (2 Storey)

**Type V - Wood frame**

Step	Input		Value Used	Total Fire Flow (L/min)	
<b>Base Fire Flow</b>					
1	<b>Construction Material</b>		<b>Multiplier</b>	1.5	
	<b>Coefficient related to type of construction</b> <b>C</b>	Type V - Wood frame	Yes		1.5
		Type IV - Mass Timber			Varies
		Type III - Ordinary construction			1
		Type II - Non-combustible construction			0.8
Type I - Fire resistive construction (2 hrs)			0.6		
2	<b>Floor Area</b>		915	10,000	
	<b>A</b>	Building Footprint (m <sup>2</sup> )			457.5
		Number of Floors/Storeys			2
		Area of structure considered (m <sup>2</sup> )			
<b>F</b>	Base fire flow without reductions				
<b>Reductions or Surcharges</b>					
3	<b>Occupancy hazard reduction or surcharge</b>		<b>FUS Table 3</b>	<b>Reduction/Surcharge</b>	
	<b>(1)</b>	Non-combustible		-25%	
		Limited combustible	Yes	-15%	
		Combustible		0%	
		Free burning		15%	
Rapid burning			25%		
4	<b>Sprinkler Reduction</b>		<b>FUS Table 4</b>	<b>Reduction</b>	
	<b>(2)</b>	Adequately Designed System (NFPA 13)	No	-30%	
		Standard Water Supply	No	-10%	
		Fully Supervised System	No	-10%	
		<b>Cumulative Sub-Total</b>		<b>0%</b>	
Area of Sprinklered Coverage (m <sup>2</sup> )		0	0%		
<b>Cumulative Total</b>			<b>0%</b>		
5	<b>Exposure Surcharge</b>		<b>FUS Table 5</b>	<b>Surcharge</b>	
	<b>(3)</b>	North Side	10.1 - 20 m	15%	
		East Side	0 - 3 m	25%	
		South Side	20.1 - 30 m	10%	
		West Side	0 - 3 m	25%	
<b>Cumulative Total</b>		<b>75%</b>			
<b>Results</b>					
6	<b>(1) + (2) + (3)</b>	<b>Total Required Fire Flow, rounded to nearest 1000L/min</b>		<b>L/min</b>	
		(2,000 L/min < Fire Flow < 45,000 L/min)		15,000	
		or	L/s	250	
		or	USGPM	3,963	
<b>Flow to be capped at 10,000 L/min (167L/s) per ITSB-2014-02</b>					

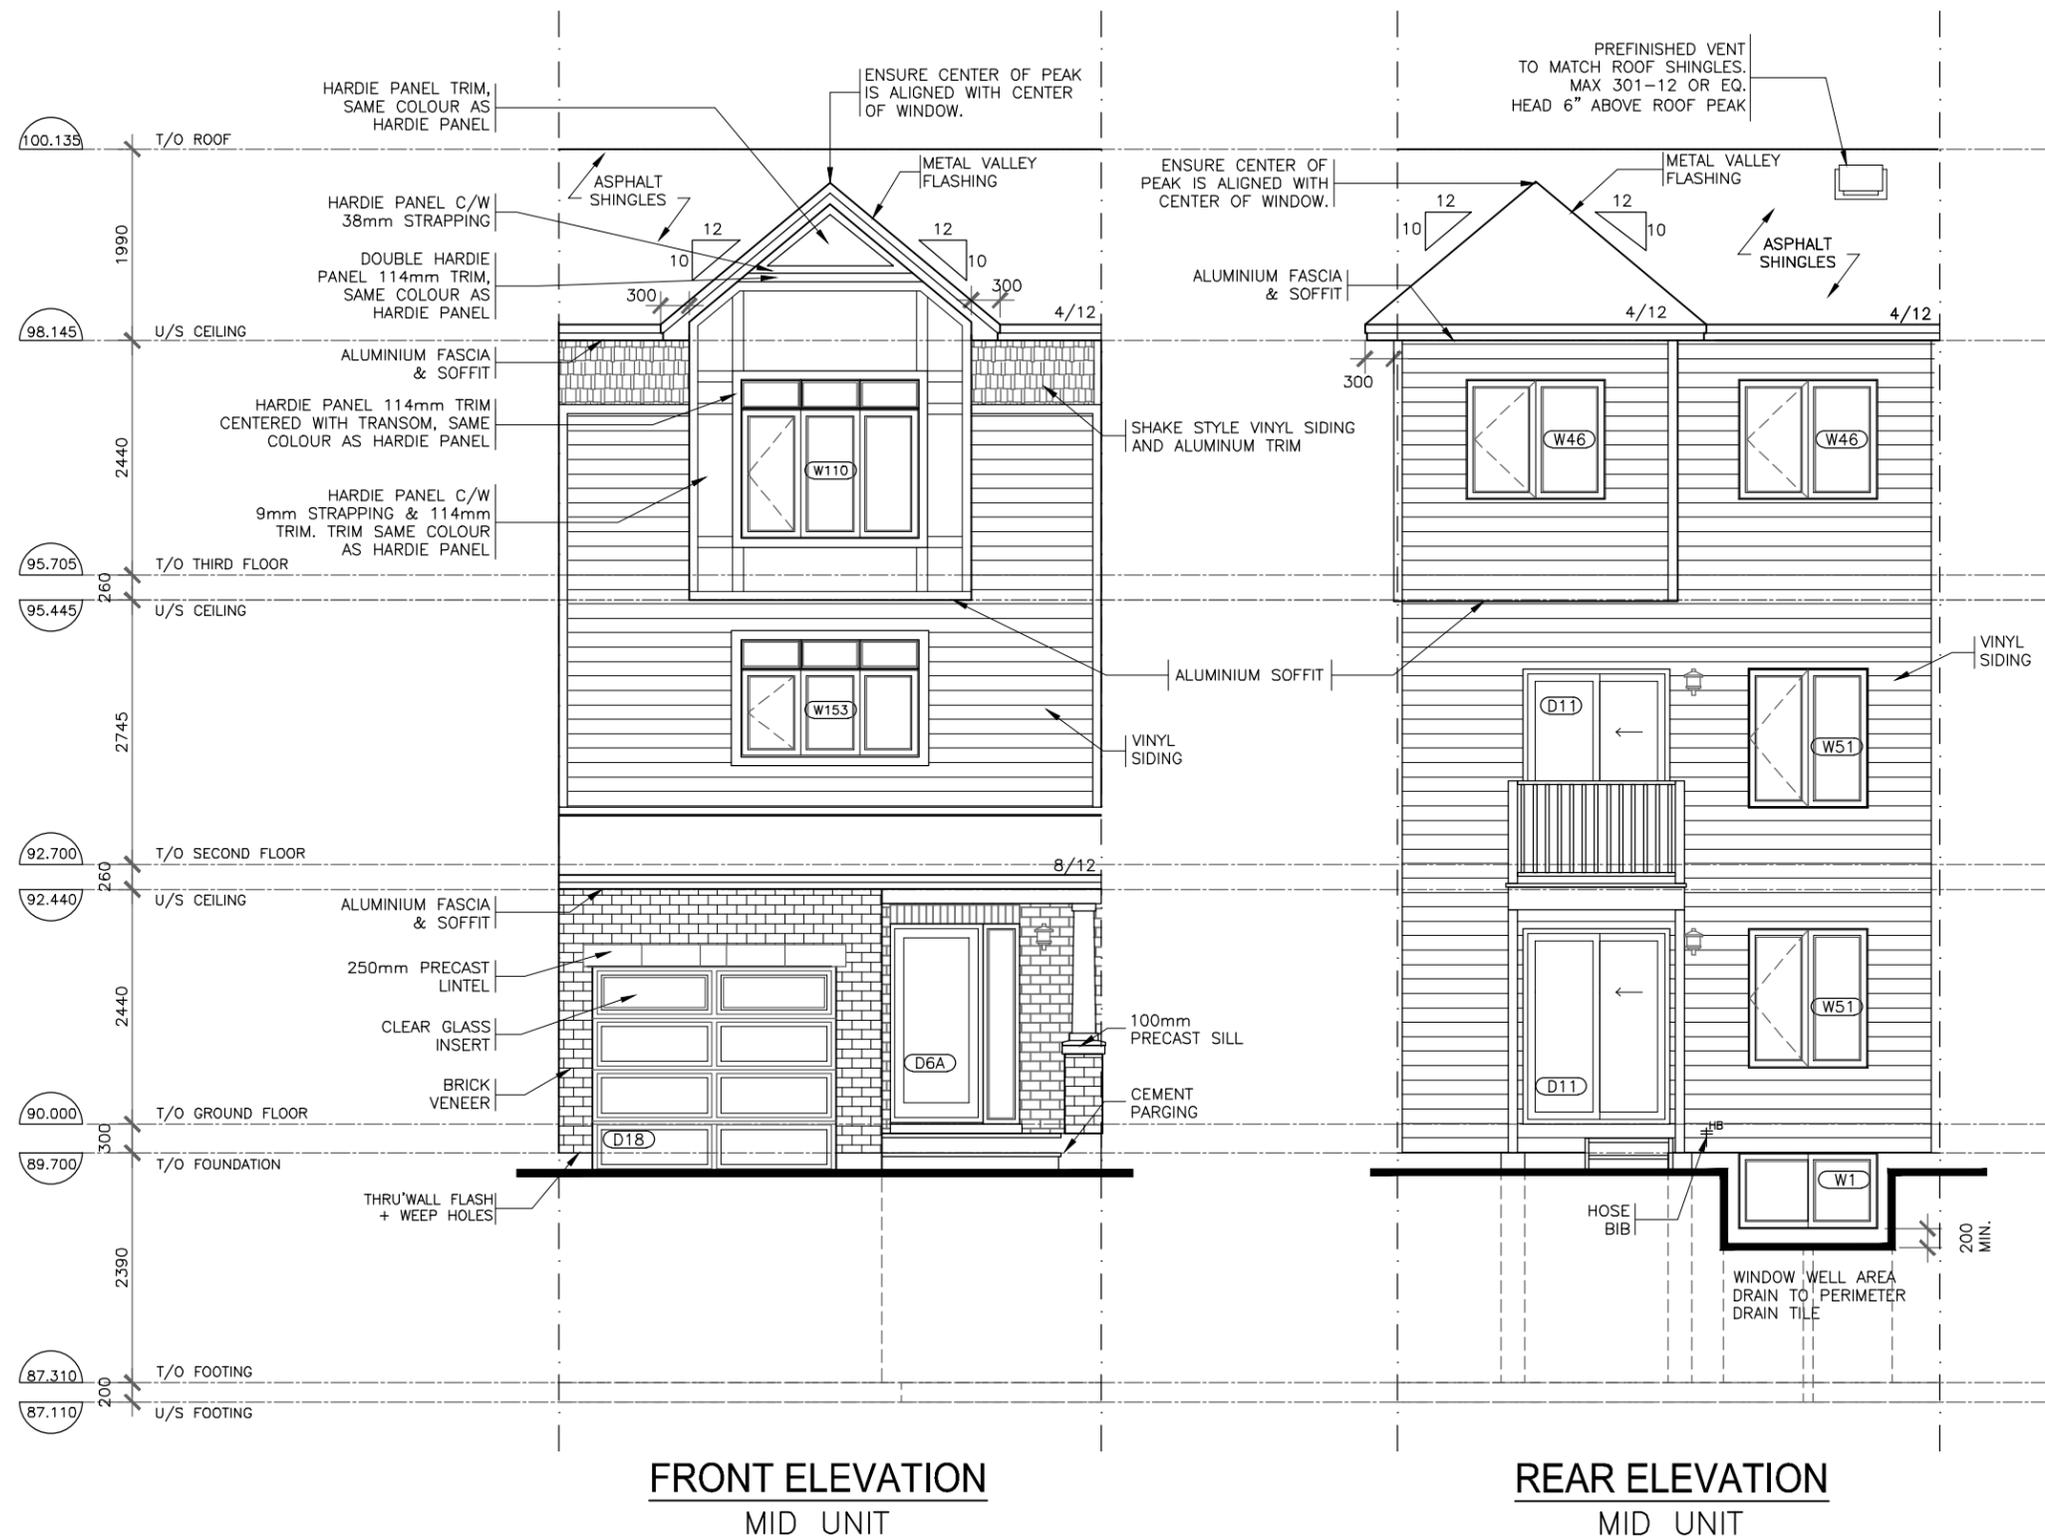

**NOTE:**

- REFER TO DRAWINGS A7, A8 FOR GENERAL NOTES, TABLES SCHEDULES, CONSTRUCTION ASSEMBLY NOTES APPLICABLE TO ALL DRAWINGS AND LEGENDS APPLICABLE TO ALL DRAWINGS.
- ALL CLOSET TO HAVE DROPPED HEADERS.
- ALL VENTILATION FANS TO EXHAUST TO THE EXTERIOR. 6" SMOOTH DUCT, 7" FLEX DUCT.
- BASEMENT: PROVIDE ONE LINE OF PASSAGE FROM UTILITY ROOM TO EXTERIOR WITH ALL DOORWAYS BEING A MINIMUM OF 32" IN WIDTH.
- CERAMIC TILE TO BE INSTALLED AS PER 9.30.6 OF O.B.C. REQUIRES 5/8" UNDERLAY
- FIRE PROTECTION FOR GAS AND ELECTRIC RANGES AS PER 9.10.21 OF O.B.C.
- BATHROOMS: PROVIDE WATERPROOF WALL FINISH AS PER 9.29.2 OF O.B.C.
- PROVIDE STUD WALL REINFORCING IN MAIN BATHROOM FOR FUTURE GRAB BARS, AS PER 9.5.2.3. SEE DWG D1
- TOILET PAPER DISPENSER HEIGHT 660 AFF. TOWEL BAR HEIGHT 762 TO 1220 AFF.
- ATTIC HATCH SHALL BE LOCATED SO AS TO PROVIDE UNOBSTRUCTED ACCESS TO ATTIC SPACE
- PROVIDE WARM AIR SUPPLY GRILLE IN W.I.C. WHEN ADJACENT TO UNHEATED SPACE, EXTERIOR AIR, OR EXTERIOR SOIL
- SMOKE ALARMS LOCATION AND POWER SUPPLY IN DWELLING UNITS WILL COMPLY WITH 9.10.19.3 AND 9.10.19.4. (1).
- INSTALLATION HEIGHT OF CARBON MONOXIDE DETECTORS WILL COMPLY WITH 9.33.4.2.
- THE HEIGHT OF HANDRAILS ON STAIRS AND RAMPS SHALL BE NOT LESS THAN 865 AND NOT MORE THAN 965, AS PER 9.8.7.4. (2).

3	X		X
2	SPEC UNIT SI UPDATED TO #8		X
1	STRUCTURAL REVIEW		AUG.03.16
No.	REVISION		DATE

Model Title:  
**ADELAIDE 2016**  
 FLOOR AREA: 1638 SQ.FT = 152.17 SQ.M  
 BSMT: 0 SQ.FT = 0 SQ.M  
 OTB: 6 SQ.FT = 0.56 SQ.M


Project:  
**SUMMERHILL VILLAGE  
 BLOCK 7 MID UNIT 32**

Title:  
**FRONT AND REAR ELEVATIONS  
 MID UNIT**


AS-BUILT RELEASE No. X DATE  
 BROCHURE DATE XX

Scale: 1:75  
 Drawing No.

Drawn by: DCA  
**A-6a**

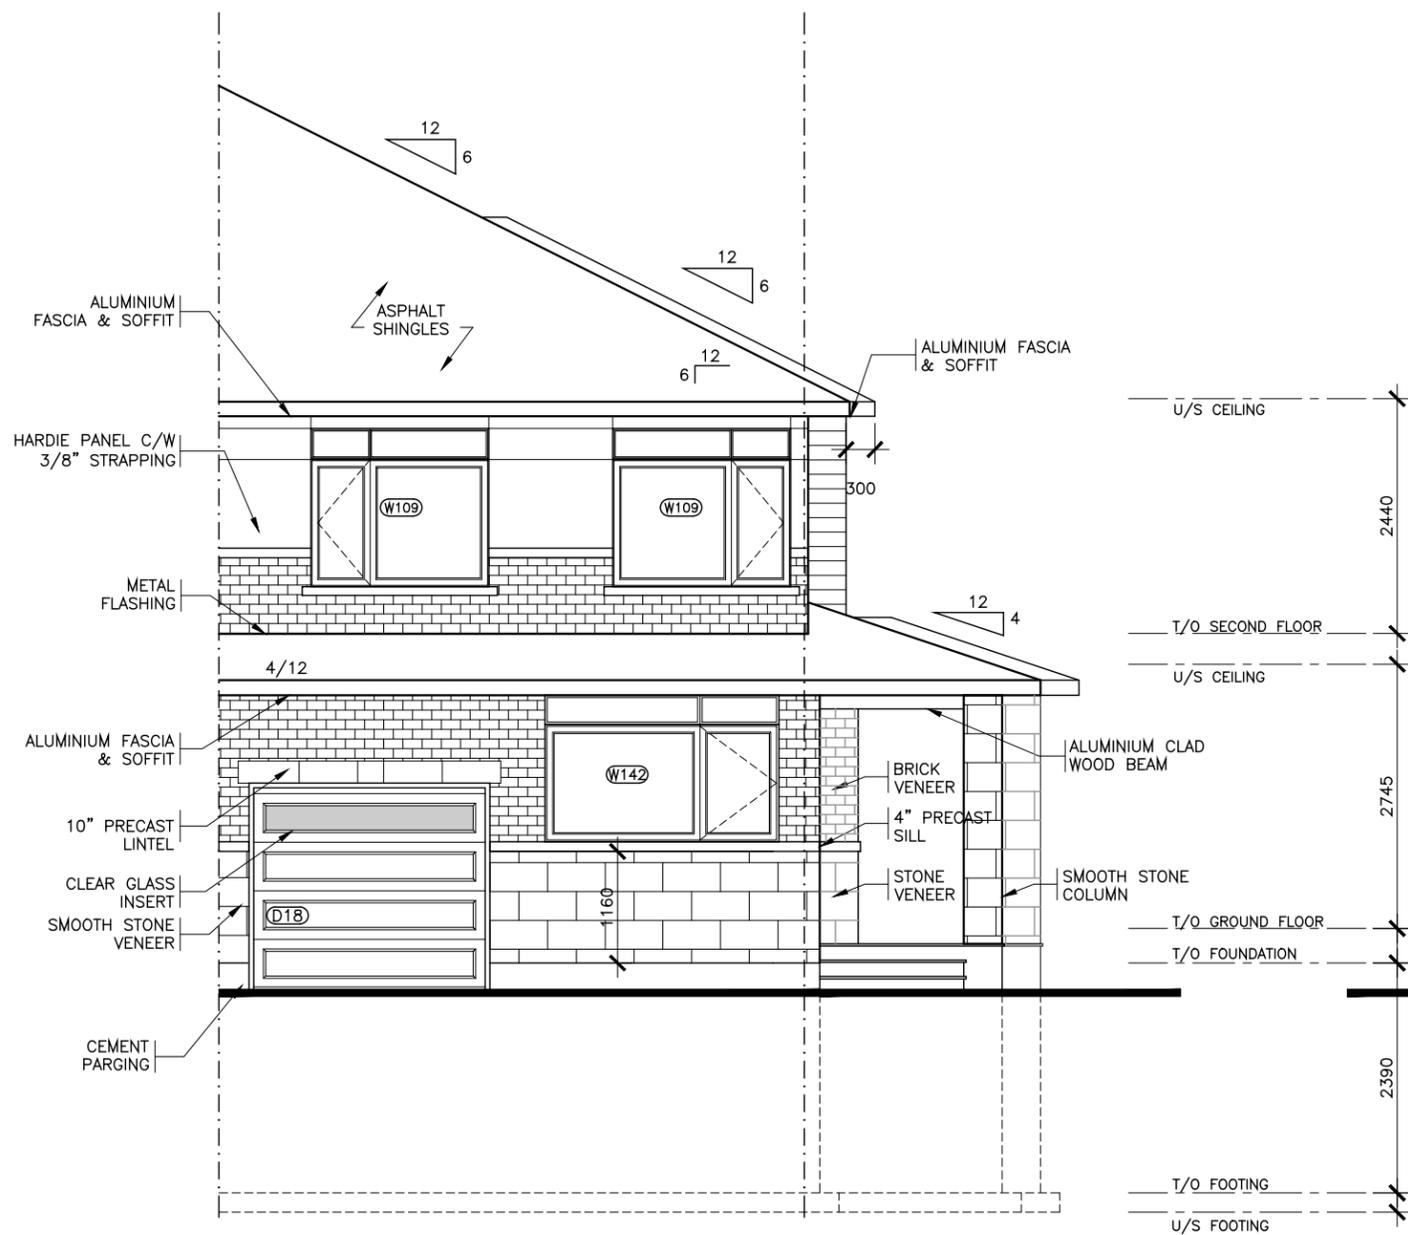

**FRONT ELEVATION**  
STREET END  
CONTEMPORARY

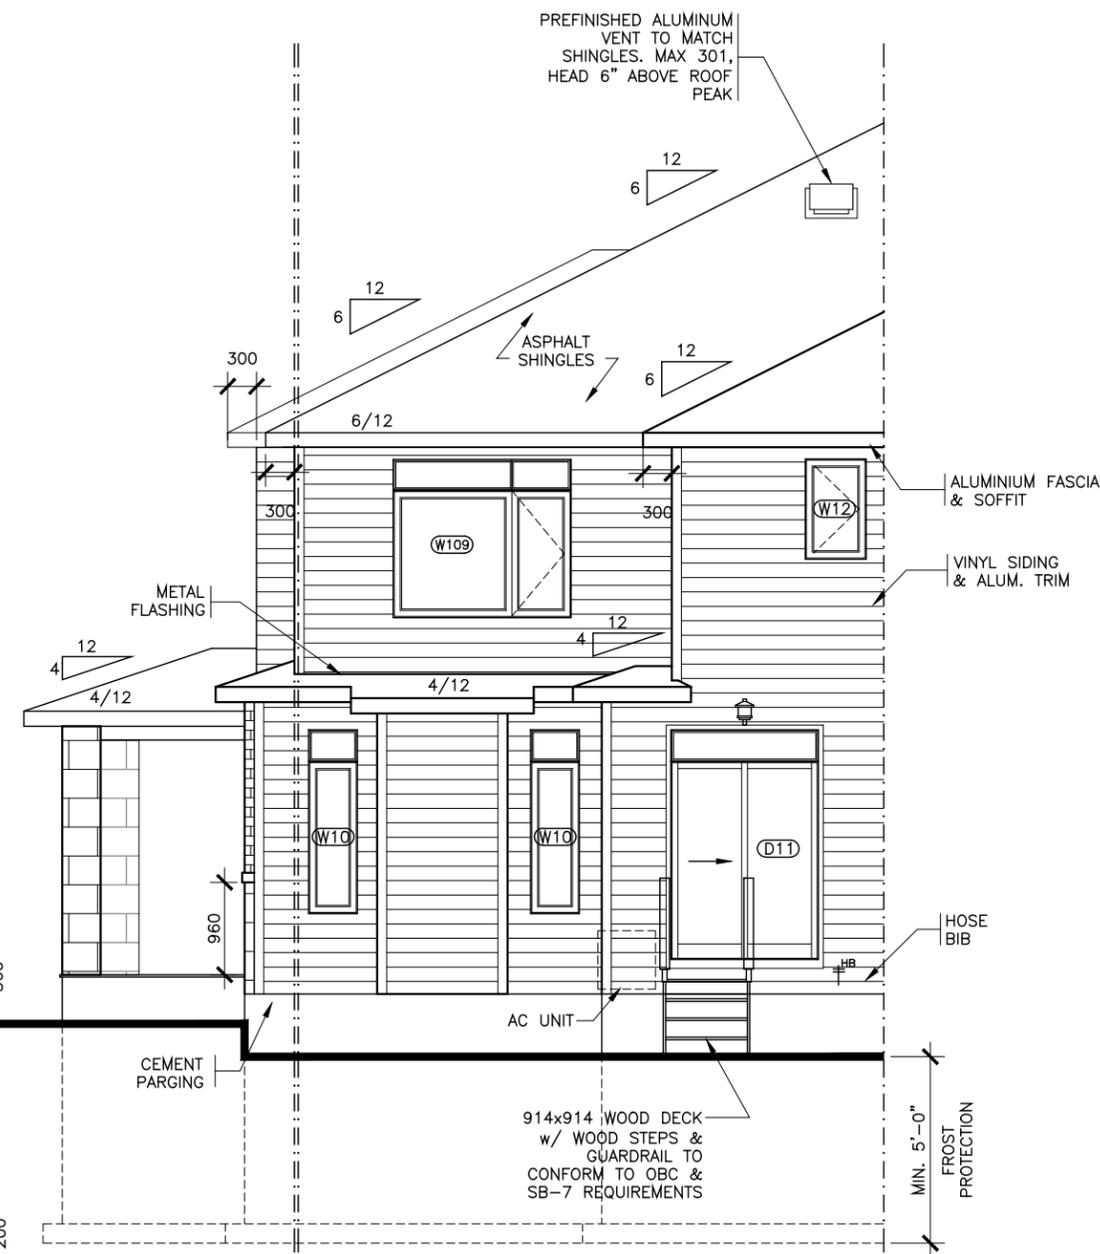

**REAR ELEVATION**  
STREET END  
CONTEMPORARY

**NOTE:**

- 1 REFER TO DRAWING A7 AND DETAIL PAGES FOR GENERAL NOTES, TABLES, SCHEDULES, CONSTRUCTION ASSEMBLY NOTES APPLICABLE TO ALL DRAWINGS AND LEGENDS APPLICABLE TO ALL DRAWINGS.
- 2 ALL CLOSET TO HAVE DROPPED HEADERS.
- 3 ALL VENTILATION FANS TO EXHAUST TO THE EXTERIOR. 6" SMOOTH DUCT, 7" FLEX DUCT.
- 4 BASEMENT: PROVIDE ONE LINE OF PASSAGE FROM UTILITY ROOM TO EXTERIOR WITH ALL DOORWAYS BEING A MINIMUM OF 32" IN WIDTH.
- 5 CERAMIC TILE TO BE INSTALLED AS PER 9.30.6 OF O.B.C, REQUIRES 5/8" UNDERLAY
- 6 FIRE PROTECTION FOR GAS AND ELECTRIC RANGES AS PER 9.10.21 OF O.B.C.
- 7 BATHROOMS: PROVIDE WATERPROOF WALL FINISH AS PER 9.29.2 OF O.B.C.
- 8 PROVIDE STUD WALL REINFORCING IN MAIN BATHROOM FOR FUTURE GRAB BARS, AS PER 9.5.2.3. SEE DWG D1
- 9 TOILET PAPER DISPENSER HEIGHT 660 AFF. TOWEL BAR HEIGHT 762 TO 1220 AFF.
- 10 ATTIC HATCH SHALL BE LOCATED SO AS TO PROVIDE UNOBSTRUCTED ACCESS TO ATTIC SPACE
- 11 PROVIDE WARM AIR SUPPLY GRILLE IN W.I.C. WHEN ADJACENT TO UNHEATED SPACE, EXTERIOR AIR, OR EXTERIOR SOIL
- 12 SMOKE ALARMS LOCATION AND POWER SUPPLY IN DWELLING UNITS WILL COMPLY WITH 9.10.19.3 AND 9.10.19.4. (1).
- 13 INSTALLATION HEIGHT OF CARBON MONOXIDE DETECTORS WILL COMPLY WITH 9.33.4.2.
- 14 THE HEIGHT OF HANDRAILS ON STAIRS AND RAMPS SHALL BE NOT LESS THAN 865 AND NOT MORE THAN 965, AS PER 9.8.7.4. (2).

6	X		X
5	X		X
4	X		X
3	X		X
2	X		X
1	STRUCTURAL REVIEW		AUG.01.22
No.	REVISION		DATE



Model Title:  
**REED 2022**  
FLOOR AREA: 2029 SQ.FT = 188.47 SQ.M  
BSMT: 418 SQ.FT = 38.80 SQ.M  
OTB: 14 SQ.FT = 1.23 SQ.M

Project:  
**PROJECT NAME**  
**BLOCK # UNIT #**

Title:  
**FRONT & REAR ELEVATIONS**

AS-BUILT RELEASE No. X DATE

BROCHURE DATE DATE


Scale: 1 : 75

Drawing No.

Drawn by: DR/IM

**A-5**

M:\2022\122040\CAD\Civil\Figures\Hydraulic\122040-FUS Separation.dwg, SEP1, Jul 08, 2024 - 11:27am, cferguson

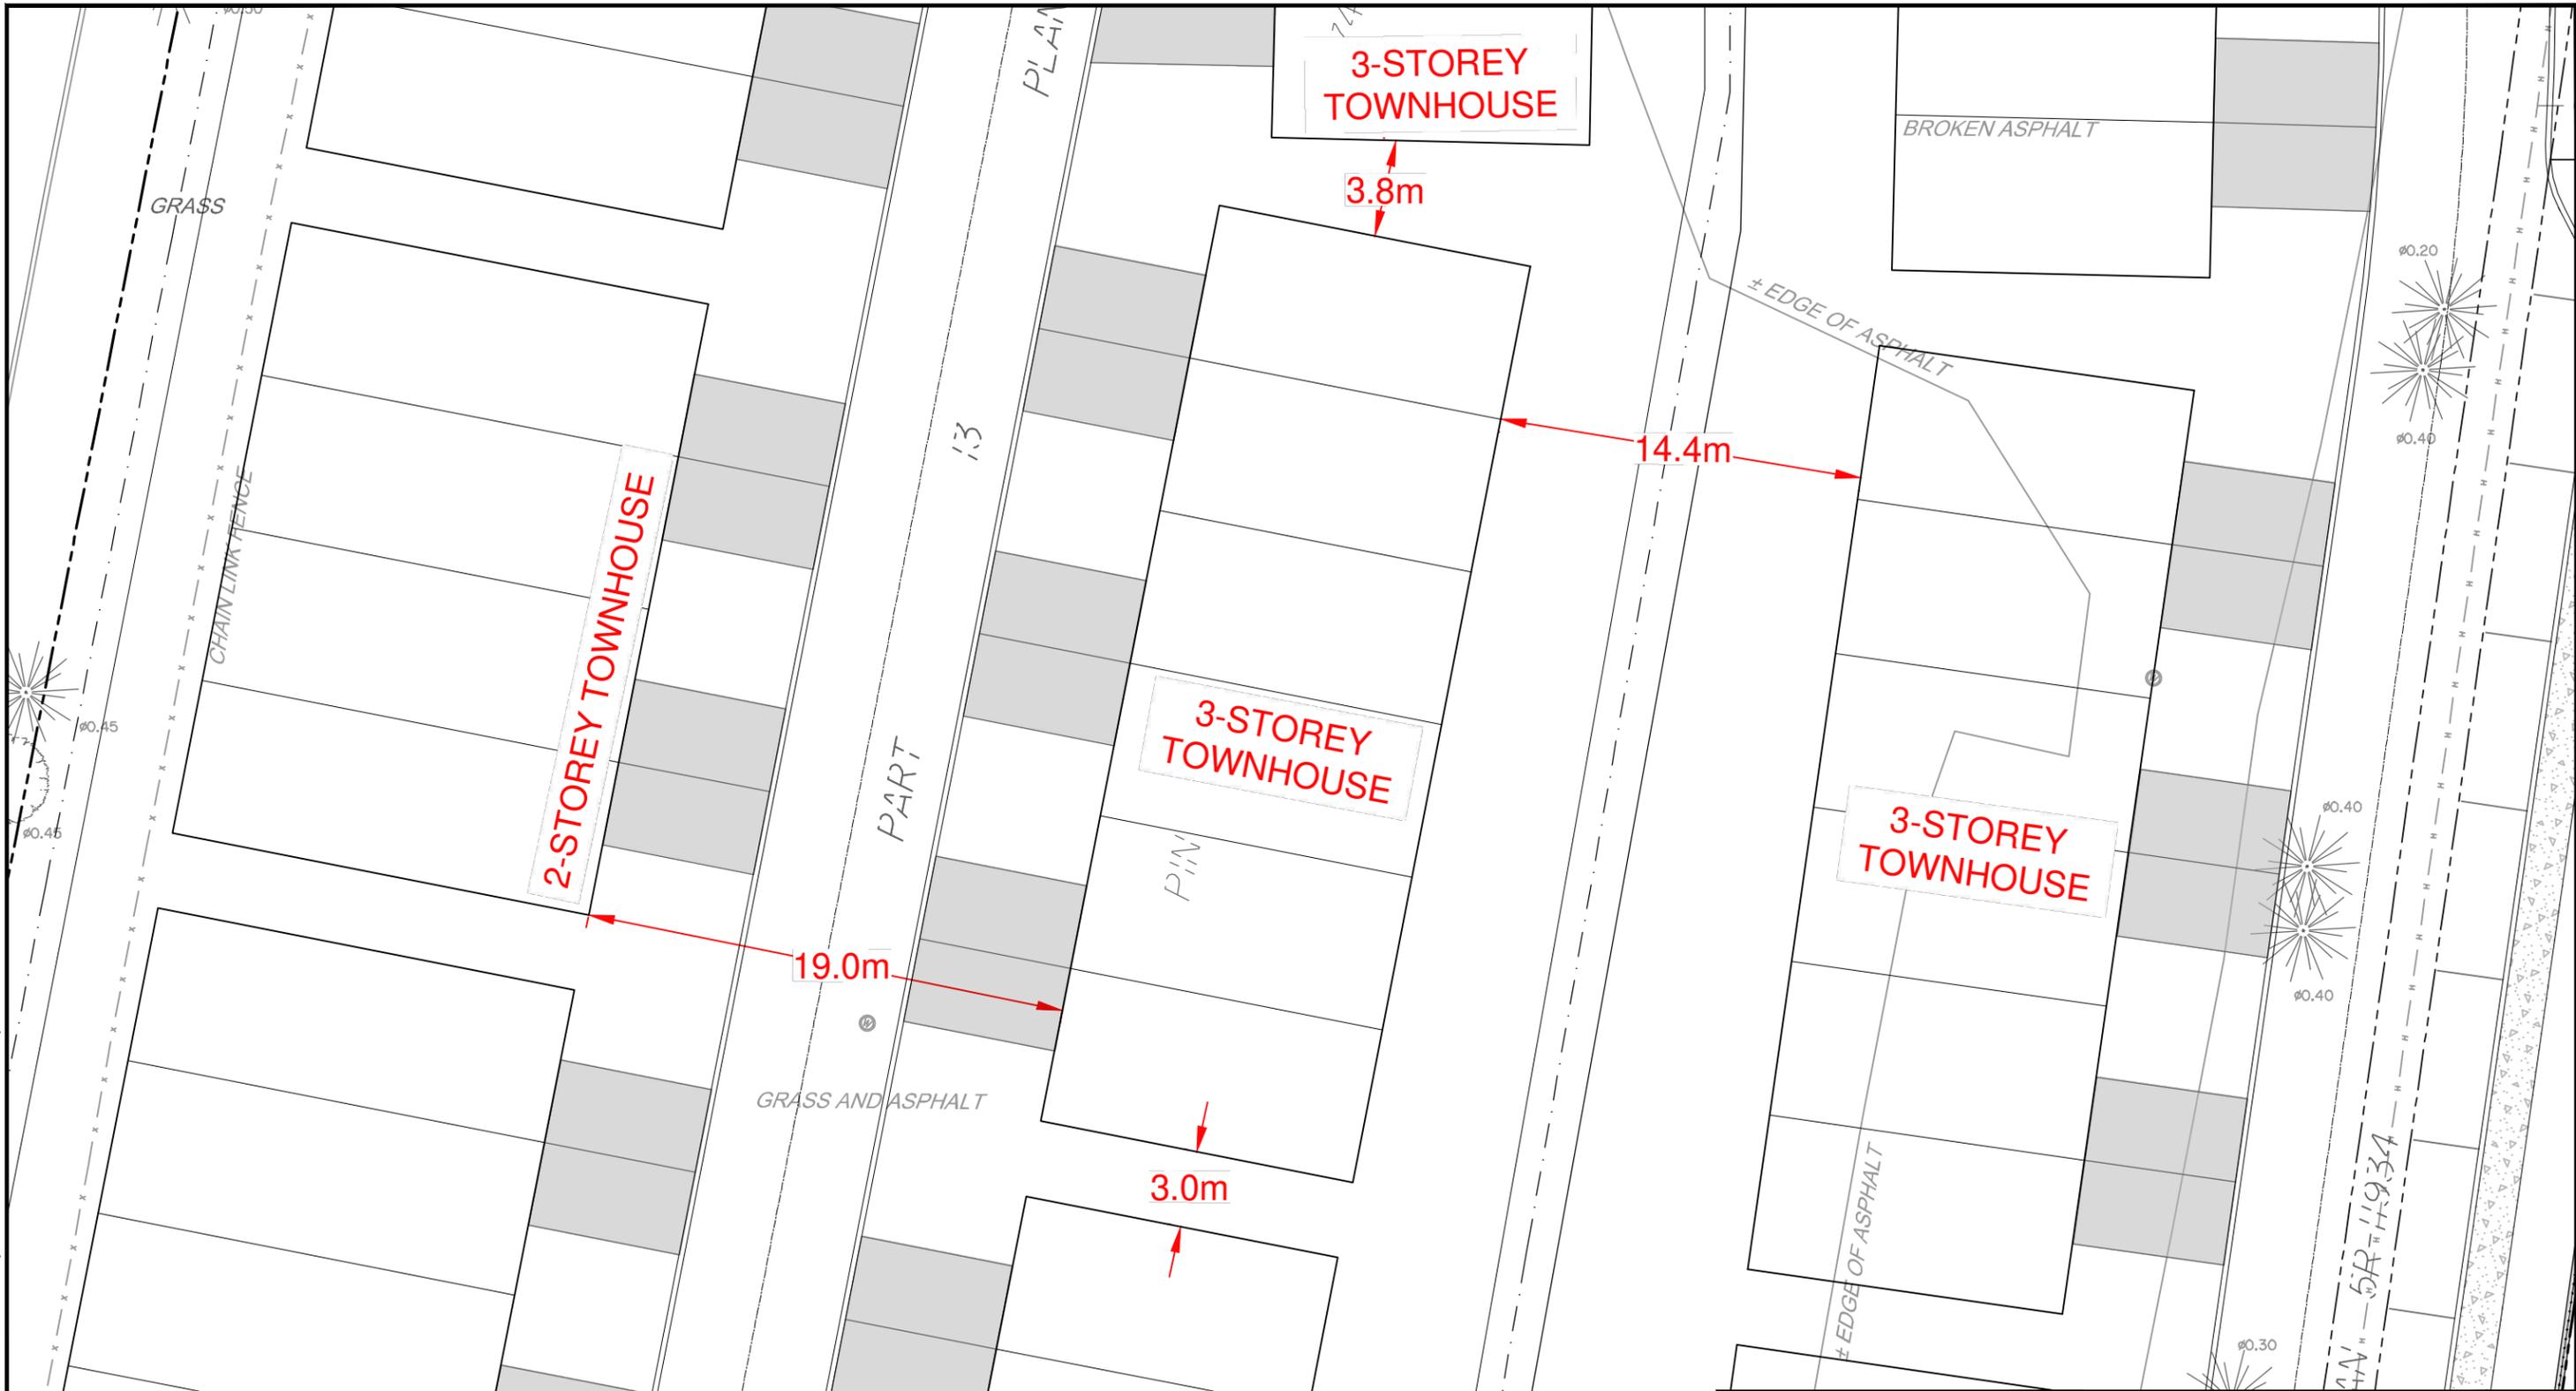

**LEGEND**

-  PROPERTY LINE
-  CURB
-  SIDEWALK
-  DRIVEWAY



**NOVATECH**

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website www.novatech-eng.com

CITY OF OTTAWA  
CONROY WALKLEY

**FUS SEPARATION**

SCALE 1 : 250 

DATE JUL 2024 JOB 122040 FIGURE SEP1

2-STOREY TOWNHOUSE

12.0m

2-STOREY TOWNHOUSE

3.0m

2-STOREY TOWNHOUSE

3.0m

2-STOREY TOWNHOUSE

CONCRETE PAD

20.5m

2-STOREY TOWNHOUSE

**LEGEND**

-  PROPERTY LINE
-  CURB
-  SIDEWALK
-  DRIVEWAY




**NOVATECH**

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website www.novatech-eng.com

CITY OF OTTAWA  
CONROY WALKLEY

**FUS SEPARATION**

SCALE 1 : 250 

DATE JULY 2022 JOB 122040 FIGURE SEP2

Node	Unit Type	Population	Residential Demand (L/s)		
	Townhouse		Avg Day	Max. Daily	Peak Hour
1	13	35	0.11	0.28	0.63
2 (HYD)	18	49	0.16	0.39	0.87
3 (HYD)	18	49	0.16	0.39	0.87
4	13	35	0.11	0.28	0.63
5 (HYD)	6	16	0.05	0.13	0.29
6	3	8	0.03	0.07	0.14
7 (HYD)	4	11	0.04	0.09	0.19
8	7	19	0.06	0.15	0.34
9 (HYD)	6	16	0.05	0.13	0.29
10	10	27	0.09	0.22	0.48
11 (HYD)	6	16	0.05	0.13	0.29
12 (HYD)	8	22	0.07	0.18	0.39
13	3	8	0.03	0.07	0.14
14 (HYD)	6	16	0.05	0.13	0.29
15 (HYD)	9	24	0.08	0.20	0.43
16 (HYD)	12	32	0.11	0.26	0.58
17 (HYD)	18	49	0.16	0.39	0.87
<b>Total</b>	<b>160</b>	<b>432</b>	<b>1.40</b>	<b>3.50</b>	<b>7.70</b>

**Design Parameters:**

- Townhouse **2.7** **persons/unit**
- Average Domestic Flow **280** **L/person/day**

Residential Peaking Factors City of Ottawa Water Distribution Guidelines:

Conditions	Peaking Factor	Units
Maximum Day	2.5 x avg day	L/c/day
Peak Hour	2.2 x max day	L/c/day

**From:** Bramah, Bruce <bruce.bramah@ottawa.ca>  
**Sent:** Thursday, July 27, 2023 2:14 PM  
**To:** Anthony Mestwarp <a.mestwarp@novatech-eng.com>  
**Cc:** Greg MacDonald <g.Macdonald@novatech-eng.com>; Curtis Ferguson <c.ferguson@novatech-eng.com>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

Good afternoon Anthony,

Please see the boundary conditions and fire flow response below.

As per City's Water Master Plan, system-level planning objective for Fire Flow is 13,000 L/min. I would advise reducing the Fire Demand from the 16,020 L/m to City's design objective.

The following are boundary conditions, HGL, for hydraulic analysis at 2510 St-Laurent Boulevard (zone 2W2C) assumed to be a connected at the locations on the figure (see attached PDF for location).

	Connection 1	Connection 2	Connection 3
Min HGL	124.5	124.4	124.4
Max HGL	130.3	130.3	130.3
Max Day + FF (167 L/s)	125.4	125.2	125.2
Max Day + FF (267 L/s)	123.3	122.9	122.9

These are for current conditions and are based on computer model simulation.

*Disclaimer: The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation.*

Regards,

--

**Bruce Bramah, P.Eng**

Project Manager

Planning, Real Estate and Economic Development Department

Development Review - South Branch

City of Ottawa | Ville d'Ottawa

110 Laurier Avenue West Ottawa, ON | 110, avenue. Laurier Ouest. Ottawa (Ontario) K1P 1J1

613.580.2424 ext./poste 29686, [Bruce.Bramah@ottawa.ca](mailto:Bruce.Bramah@ottawa.ca)

**From:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>  
**Sent:** July 12, 2023 9:53 AM  
**To:** Bramah, Bruce <[bruce.bramah@ottawa.ca](mailto:bruce.bramah@ottawa.ca)>  
**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

**CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.**

**ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.**

Hi Bruce,

I understand that you are now the City Engineer overseeing the Conroy-Walkley project.

Based on City comments and the current market conditions the client has made some revisions to the proposed site plan. The proposed development is now a combination of traditional 2-storey townhomes, and 3-storey townhomes.

Can you please provide updated water boundary conditions based on the info provided below and attached.

- i. Three (3) water connections are proposed. Two (2) connections to ST. Laurent, and one (1) connections to Don Reid Dr.
- ii. Required fire flows: 167 L/s (for the 2 -storey town homes, Cap applied) and 267 L/s (3-storey townhomes – cap not applicable). Refer to FUS calcs attached.
- iii. Average demand: 1.36 L/s.
- iv. Maximum demand: 3.39 L/s.
- v. Peak hour demand: 7.46L/s.

If you have any questions, or require additional information, let me know.

Regards,

**Anthony Mestwarp**, P.Eng., Project Engineer | Land Development Engineering  
**NOVATECH**

Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext. 216

The information contained in this email message is confidential and is for exclusive use of the addressee.

**From:** Sharif, Golam <[sharif.sharif@ottawa.ca](mailto:sharif.sharif@ottawa.ca)>  
**Sent:** Wednesday, October 19, 2022 5:32 PM  
**To:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>  
**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Greg Winters <[G.Winters@novatech-eng.com](mailto:G.Winters@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

Hi Anthony,

Here is the requested water boundary condition:

The following are boundary conditions, HGL, for hydraulic analysis at 2510 St-Laurent Boulevard (zone 2W2C) assumed to be a connected at the locations on the figure (see attached PDF for location).

	Connection 1	Connection 2	Connection 3	Connection 4	Connection 5
BSDY - Min	126.2	126.2	126.2	126.1	126.1
BSDY - Max	130.0	130.0	130.0	130.0	130.0
Peak hr- Min	124.5	124.4	124.4	124.3	124.3
Peak hr- Max	130.3	130.3	130.3	130.4	130.4
Max Day + FF (233 L/s)	125.5	124.5	124.4	124.4	124.5

These are for current conditions and are based on computer model simulation.

*Disclaimer: The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation.*


Let me know if you need anything else. Thanks.

Sharif

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.


# Boundary Conditions for 2510 St-Laurent Boulevard

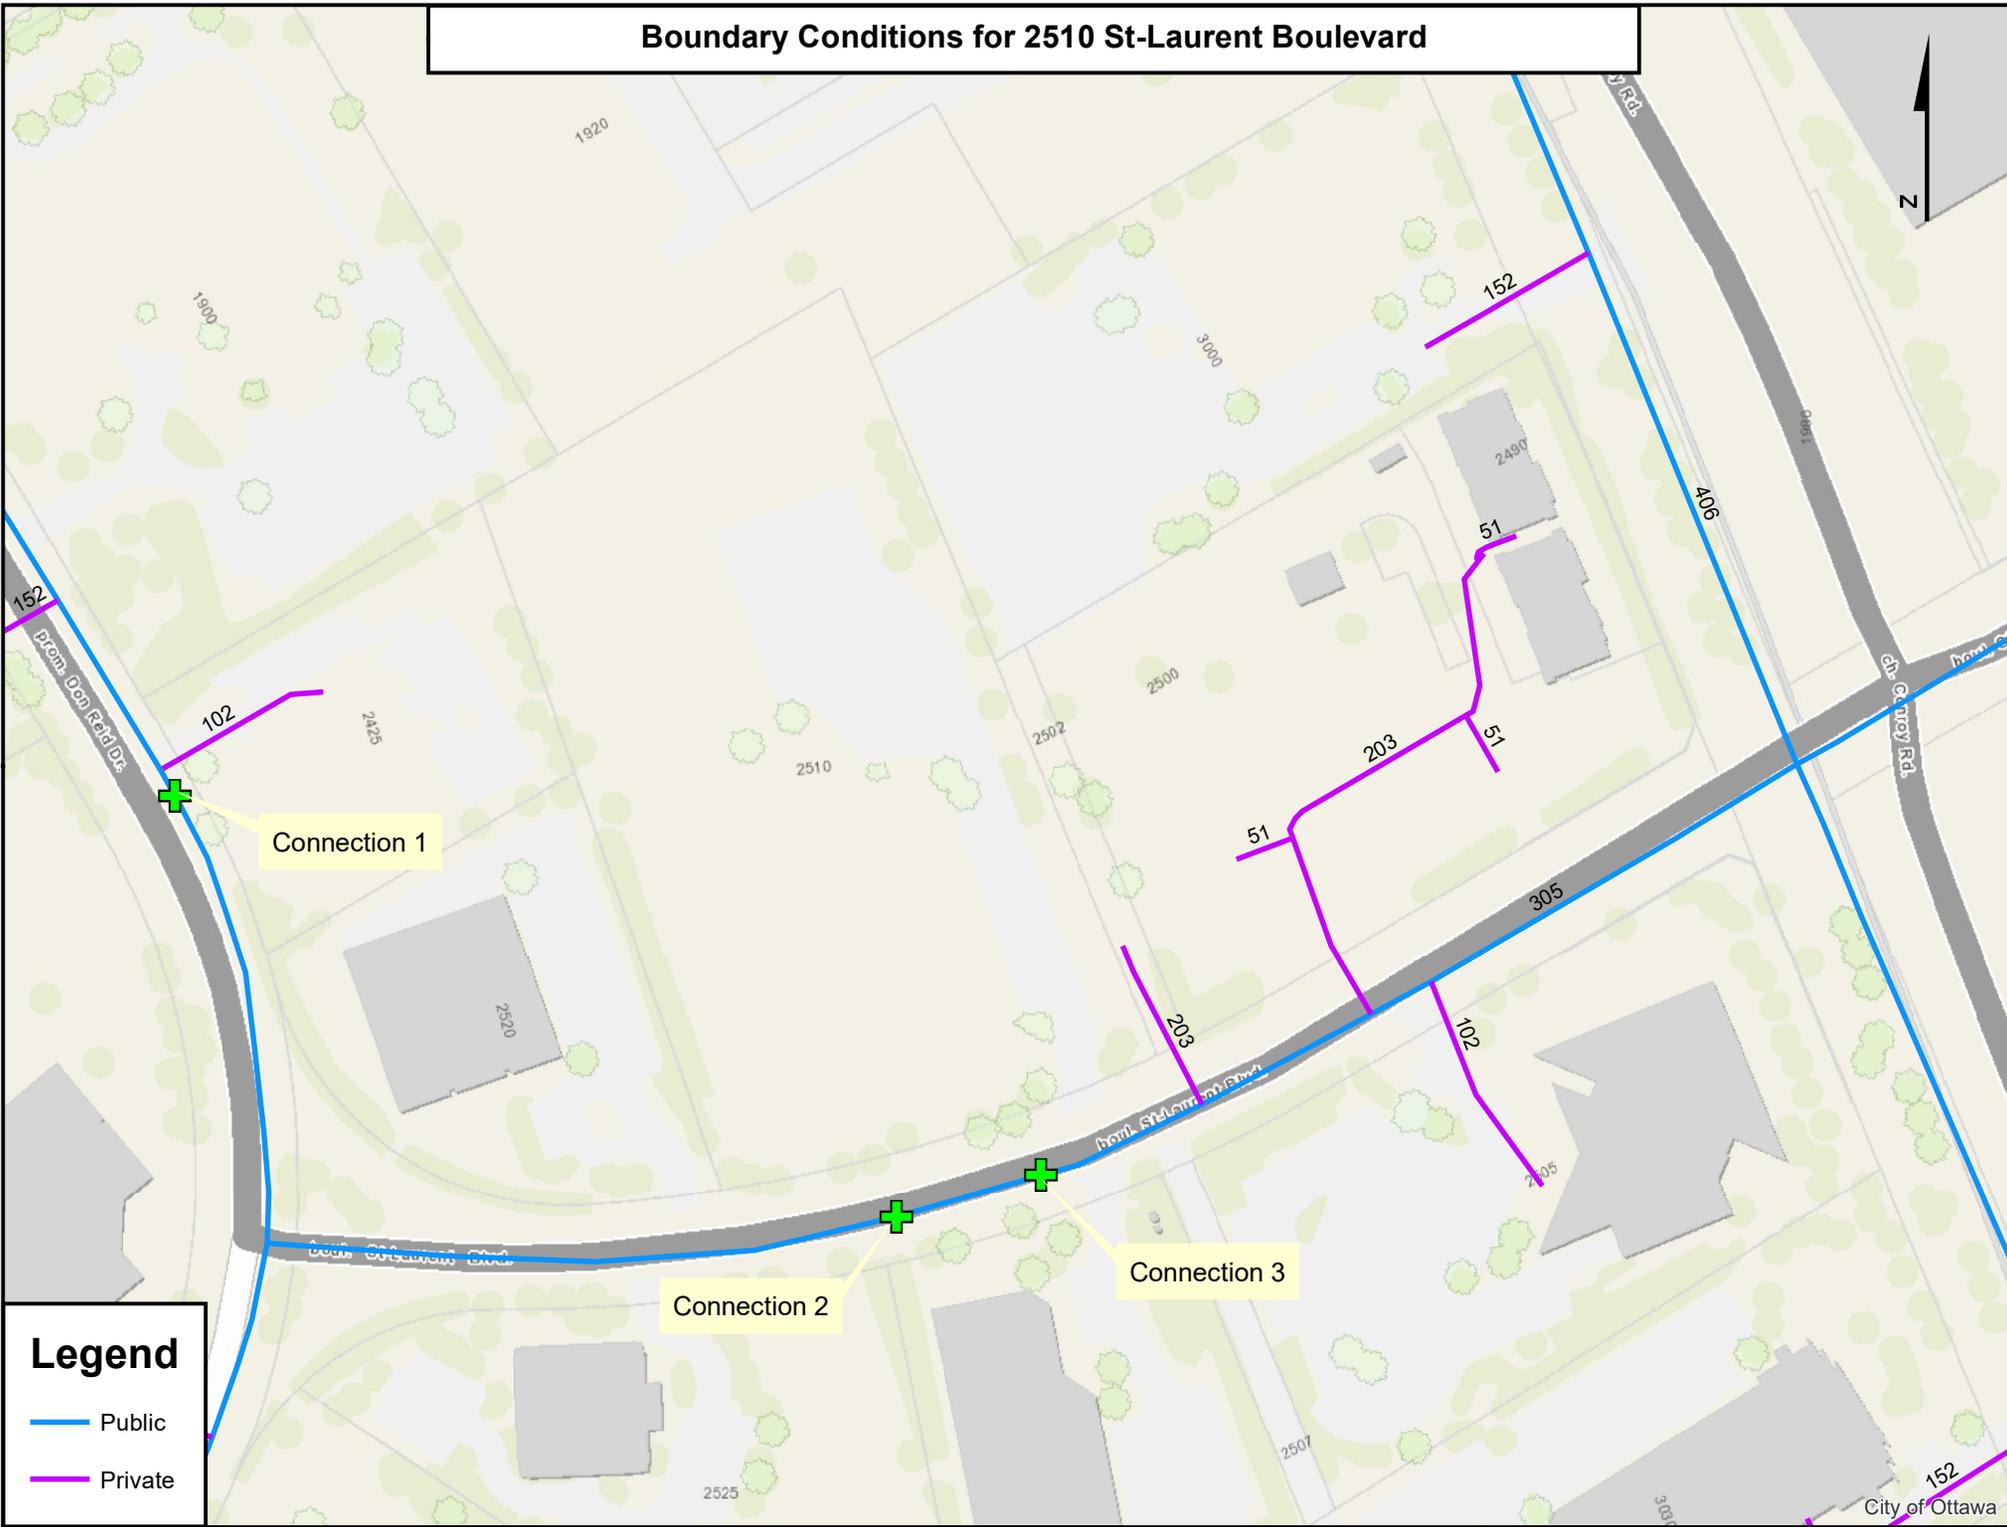

**Legend**

- Public
- Private

M:\2022\122040\CAD\Civil\Figures\122040-EPA.dwg, EPA, Aug 02, 2023 - 5:00pm, cferguson

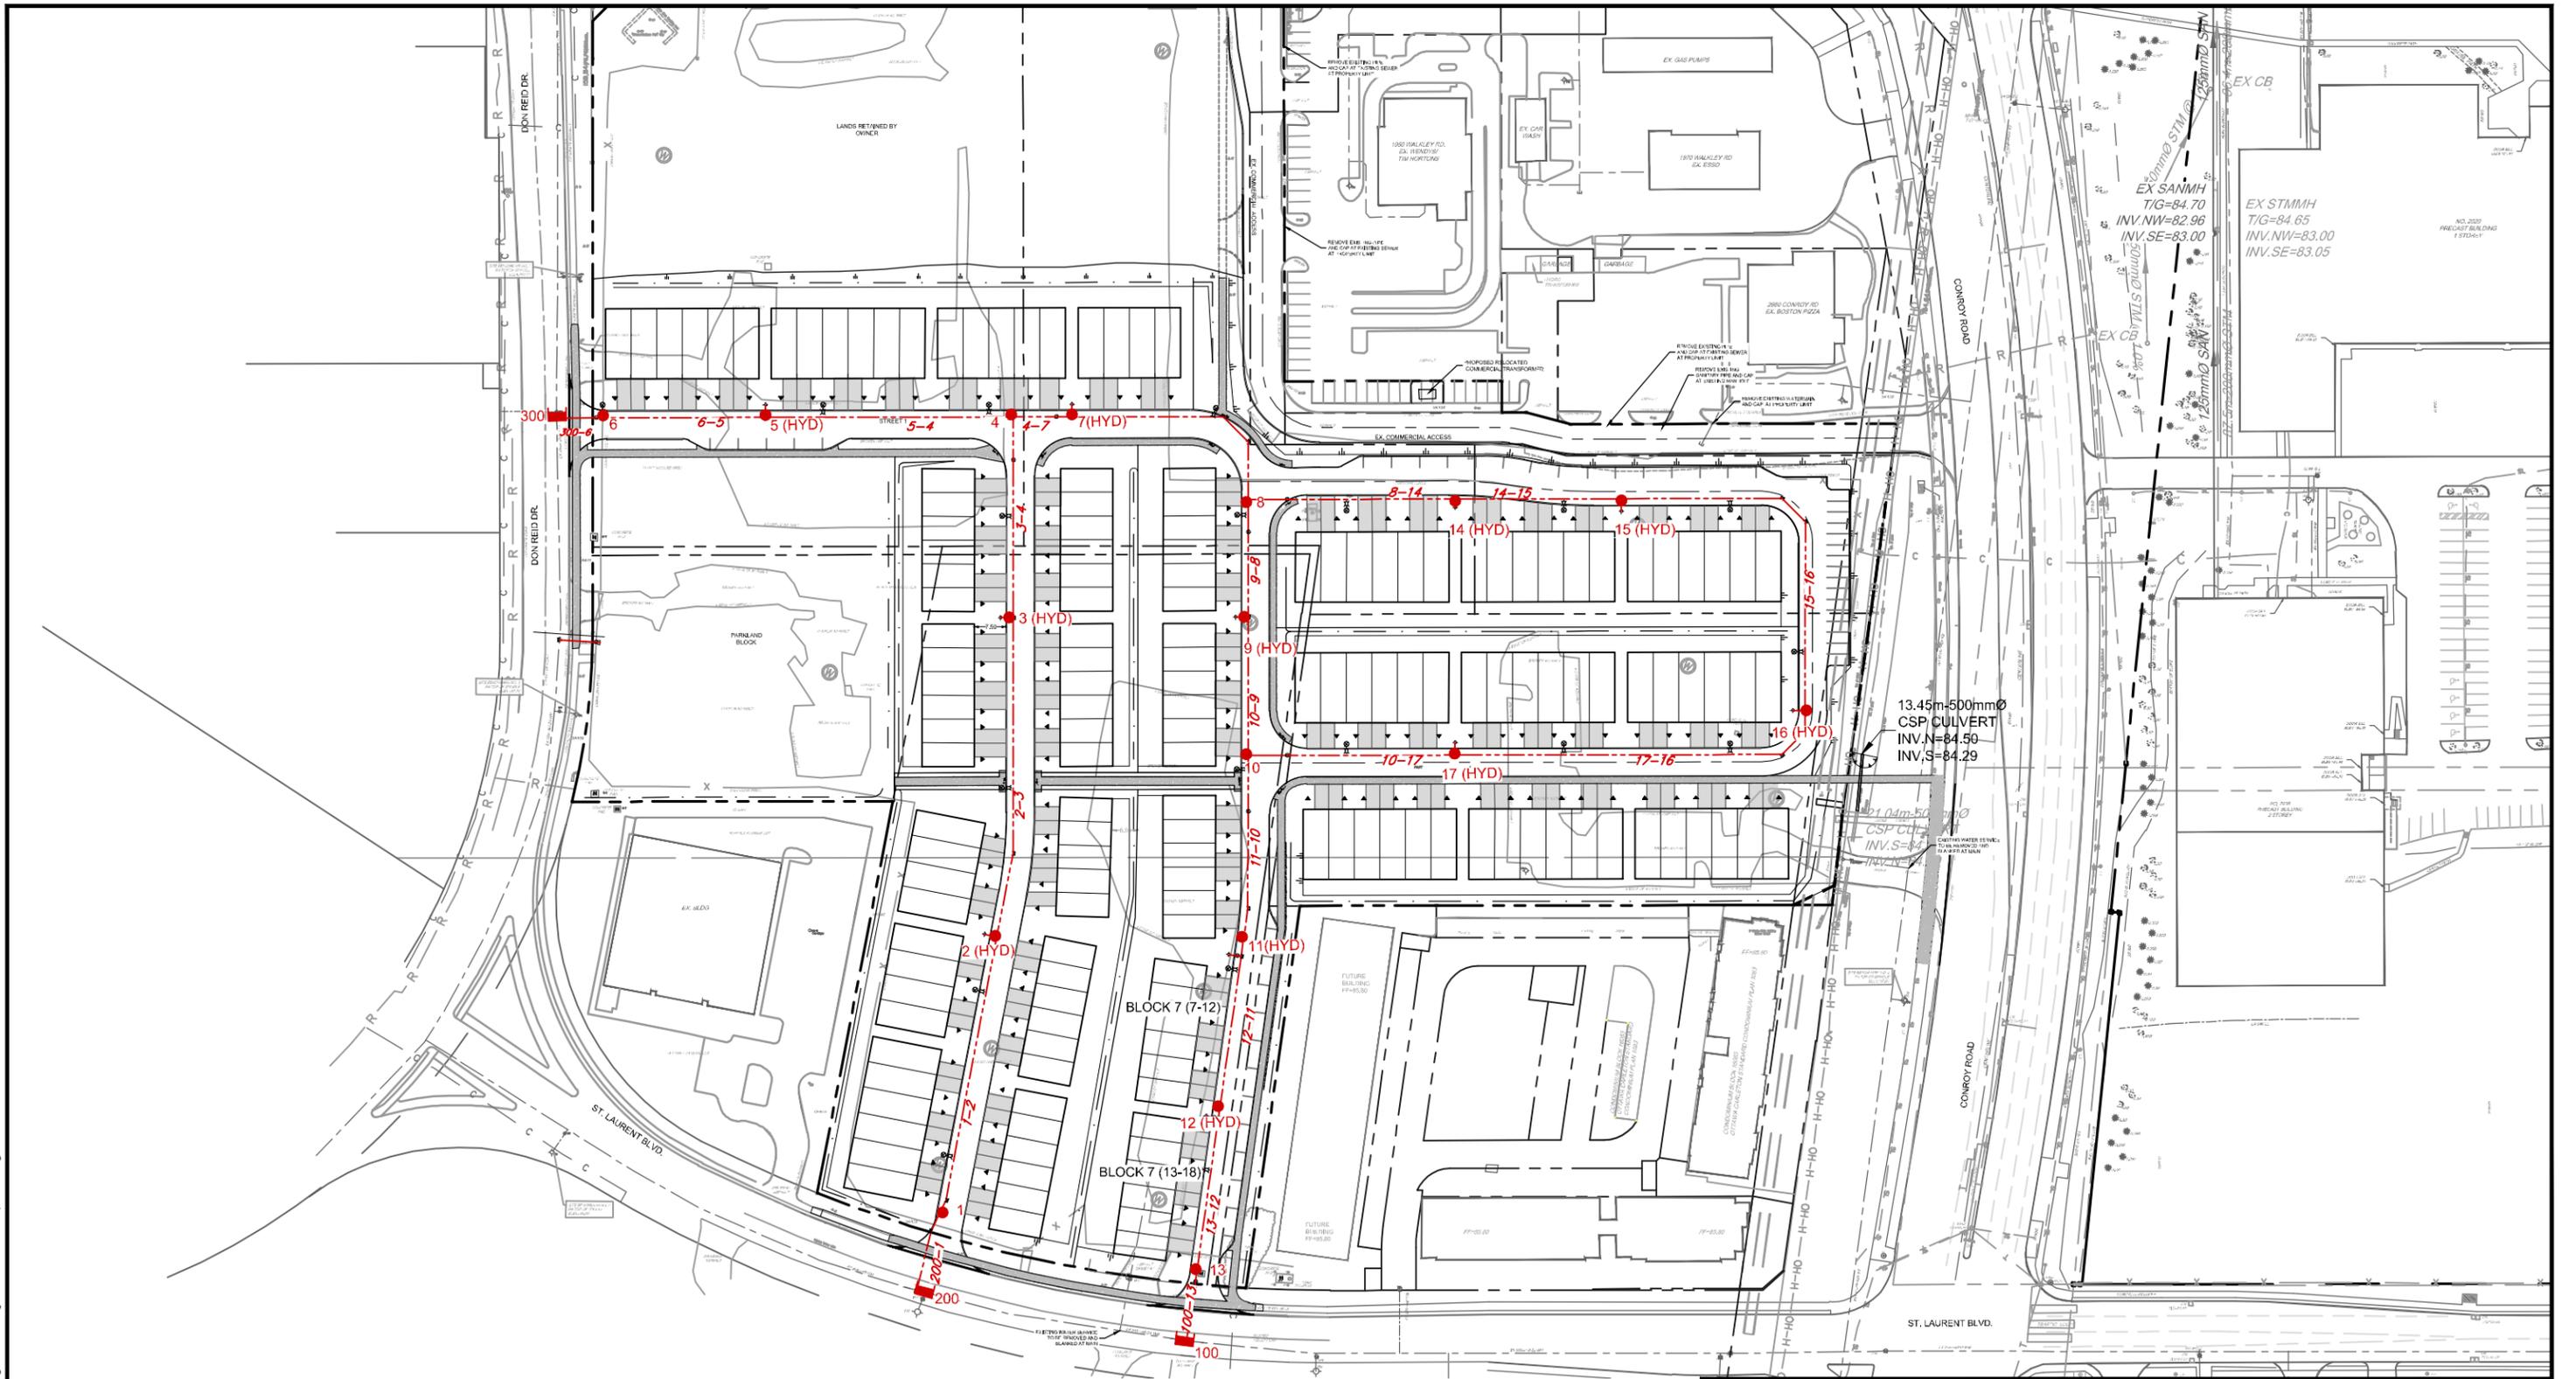

### LEGEND

-  200mmØ WATERMAIN PIPE
-  WATERMAIN NODE
-  RESERVOIR




**NOVATECH**

Engineers, Planners & Landscape Architects  
 Suite 200, 240 Michael Cowpland Drive  
 Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
 Facsimile (613) 254-5867  
 Website www.novatech-eng.com

CITY OF OTTAWA  
 2510 ST. LAURENT BLVD

### WATERMAIN LAYOUT PLAN

SCALE 1 : 1500 

DATE	JOB	FIGURE
AUGUST 2023	122040	EPA

<b>Pipe Data</b>			
<b>Pipe</b>	<b>Length (m)</b>	<b>Diameter (mm)</b>	<b>Roughness Coefficient</b>
1-200	13.2	200	110
1-2	66.9	200	110
2-3	76.1	200	110
3-4	48.3	200	110
4-5	59.1	200	110
5-6	38.7	200	110
6-300	11	200	110
4-7	14	200	110
7-9	57.7	200	110
9-8	30.1	200	110
9-10	32.9	200	110
10-11	43.4	200	110
11-12	40.7	200	110
12-13	39.3	200	110
13-100	17.2	200	110
8-14	49.1	200	110
14-15	39.8	200	110
15-16	90.9	200	110
16-17	90.6	200	110
10-17	49.2	200	110

High Pressure Check						
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure		Age* (hrs)
				(m)	(PSI)	
1	85.17	0.11	124.4	39.23	55.78	0.54
2(HYD)	85.59	0.16	124.41	38.82	55.20	0.38
3(HYD)	86.05	0.16	124.42	38.37	54.56	0.22
4	86.75	0.11	124.43	37.68	53.58	0.11
5(HYD)	86.31	0.05	124.47	38.16	54.26	0.05
6	86.50	0.03	124.49	37.99	54.02	0.01
7(HYD)	86.67	0.04	124.43	37.76	53.69	0.15
8	86.68	0.06	124.42	37.74	53.67	0.27
9(HYD)	86.37	0.05	124.42	38.05	54.11	0.37
10	86.10	0.09	124.42	38.32	54.49	1.08
11(HYD)	86.01	0.05	124.41	38.40	54.60	1.19
12(HYD)	85.21	0.07	124.41	39.20	55.74	1.30
13	85.18	0.03	124.40	39.22	55.77	1.40
14(HYD)	86.56	0.05	124.42	37.86	53.84	0.61
15(HYD)	86.19	0.08	124.42	38.23	54.36	0.90
16(HYD)	85.88	0.11	124.42	38.54	54.80	1.60
17(HYD)	86.15	0.16	124.42	38.27	54.42	2.38
100 (RES)	85.26	3.22	124.40	0.00	0.00	0.00
200 (RES)	85.05	3.69	124.40	0.00	0.00	0.00
300 (RES)	86.46	-8.32	124.50	0.00	0.00	0.00

Maximum Pressure

Maximum Age

\* Age is based on a boundary age of 0 hrs

1m of head = 1.42197 PSI

1.41

Maximum Daily Demand and Fire Flow					
Node 2 (HYD) - 267L/s Fire Demand					
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure	
				(m)	(PSI)
1	85.17	0.28	120.92	35.75	50.84
2(HYD)	85.59	267.00	110.90	25.31	35.99
3(HYD)	86.05	0.39	116.40	30.35	43.16
4	86.75	0.28	119.91	33.16	47.15
5(HYD)	86.31	0.13	121.75	35.44	50.39
6	86.50	0.07	122.96	36.46	51.85
7(HYD)	86.67	0.09	120.07	33.40	47.49
8	86.68	0.15	120.74	34.06	48.43
9(HYD)	86.37	0.13	120.93	34.56	49.14
10	86.10	0.22	121.14	35.04	49.83
11(HYD)	86.01	0.13	121.68	35.67	50.72
12(HYD)	85.21	0.18	122.19	36.98	52.58
13	85.18	0.07	122.68	37.50	53.32
14(HYD)	86.56	0.13	120.80	34.24	48.69
15(HYD)	86.19	0.20	120.85	34.66	49.29
16(HYD)	85.88	0.26	120.96	35.08	49.88
17(HYD)	86.15	0.39	121.07	34.92	49.66
100 (RES)	85.26	-41.96	122.90	0.00	0.00
200 (RES)	85.05	-159.71	122.90	0.00	0.00
300 (RES)	86.46	-68.43	123.30	0.00	0.00

Minimum Pressure

Notes

1m of head = 1.42197 PSI  
 Fire demand based on FUS 2020

Maximum Daily Demand and Fire Flow					
Node 3 (HYD) - 267L/s Fire Demand					
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure	
				(m)	(PSI)
1	85.17	0.28	121.83	36.66	52.13
2(HYD)	85.59	0.39	116.42	30.83	43.84
3(HYD)	86.05	267.00	110.31	24.26	34.50
4	86.75	0.28	117.02	30.27	43.04
5(HYD)	86.31	0.13	120.43	34.12	48.52
6	86.50	0.07	122.66	36.16	51.42
7(HYD)	86.67	0.09	117.34	30.67	43.61
8	86.68	0.15	118.68	32.00	45.50
9(HYD)	86.37	0.13	119.06	32.69	46.48
10	86.10	0.22	119.47	33.37	47.45
11(HYD)	86.01	0.13	120.52	34.51	49.07
12(HYD)	85.21	0.18	121.51	36.30	51.62
13	85.18	0.07	122.48	37.30	53.04
14(HYD)	86.56	0.13	118.80	32.24	45.84
15(HYD)	86.19	0.20	118.89	32.70	46.50
16(HYD)	85.88	0.26	119.11	33.23	47.25
17(HYD)	86.15	0.39	119.34	33.19	47.20
100 (RES)	85.26	-60.11	122.90	0.00	0.00
200 (RES)	85.05	-114.56	122.90	0.00	0.00
300 (RES)	86.46	-95.43	123.30	0.00	0.00

Minimum Pressure

**Notes**

1m of head = 1.42197 PSI  
 Fire demand based on FUS 2020

Maximum Daily Demand and Fire Flow					
Node 5 (HYD) - 267L/s Fire Demand					
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure	
				(m)	(PSI)
1	85.17	0.28	122.63	37.46	53.27
2(HYD)	85.59	0.39	121.30	35.71	50.78
3(HYD)	86.05	0.39	119.81	33.76	48.01
4	86.75	0.28	118.88	32.13	45.69
5(HYD)	86.31	267.00	115.17	28.86	41.04
6	86.50	0.07	121.50	35.00	49.77
7(HYD)	86.67	0.09	119.10	32.43	46.11
8	86.68	0.15	120.01	33.33	47.39
9(HYD)	86.37	0.13	120.26	33.89	48.19
10	86.10	0.22	120.54	34.44	48.97
11(HYD)	86.01	0.13	121.26	35.25	50.12
12(HYD)	85.21	0.18	121.95	36.74	52.24
13	85.18	0.07	122.61	37.43	53.22
14(HYD)	86.56	0.13	120.08	33.52	47.66
15(HYD)	86.19	0.20	120.15	33.96	48.29
16(HYD)	85.88	0.26	120.30	34.42	48.94
17(HYD)	86.15	0.39	120.45	34.30	48.77
100 (RES)	85.26	-49.13	122.90	0.00	0.00
200 (RES)	85.05	-53.89	122.90	0.00	0.00
300 (RES)	86.46	-167.35	123.30	0.00	0.00

Minimum Pressure

**Notes**

1m of head = 1.42197 PSI  
 Fire demand based on FUS 2020

Maximum Daily Demand and Fire Flow					
Node 7 (HYD) - 267L/s Fire Demand					
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure	
				(m)	(PSI)
1	85.17	0.28	122.39	37.22	52.93
2(HYD)	85.59	0.39	119.85	34.26	48.72
3(HYD)	86.05	0.39	116.98	30.93	43.98
4	86.75	0.28	115.17	28.42	40.41
5(HYD)	86.31	0.13	119.58	33.27	47.31
6	86.50	0.07	122.48	35.98	51.16
<b>7(HYD)</b>	<b>86.67</b>	<b>267.00</b>	<b>112.43</b>	<b>25.76</b>	<b>36.63</b>
8	86.68	0.15	114.98	28.30	40.24
9(HYD)	86.37	0.13	115.68	29.31	41.68
10	86.10	0.22	116.46	30.36	43.17
11(HYD)	86.01	0.13	118.44	32.43	46.11
12(HYD)	85.21	0.18	120.30	35.09	49.90
13	85.18	0.07	122.11	36.93	52.51
14(HYD)	86.56	0.13	115.20	28.64	40.73
15(HYD)	86.19	0.20	115.38	29.19	41.51
16(HYD)	85.88	0.26	115.79	29.91	42.53
17(HYD)	86.15	0.39	116.22	30.07	42.76
100 (RES)	85.26	-84.34	122.90	0.00	0.00
200 (RES)	85.05	-76.40	122.90	0.00	0.00
300 (RES)	86.46	-109.66	123.30	0.00	0.00

Minimum Pressure

Notes

1m of head = 1.42197 PSI  
 Fire demand based on FUS 2020

Maximum Daily Demand and Fire Flow					
Node 9 (HYD) - 267L/s Fire Demand					
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure	
				(m)	(PSI)
1	85.17	0.28	122.59	37.42	53.21
2(HYD)	85.59	0.39	121.02	35.43	50.38
3(HYD)	86.05	0.39	119.27	33.22	47.24
4	86.75	0.28	118.16	31.41	44.66
5(HYD)	86.31	0.13	120.95	34.64	49.26
6	86.50	0.07	122.78	36.28	51.59
7(HYD)	86.67	0.09	116.45	29.78	42.35
8	86.68	0.15	109.41	22.73	32.32
9(HYD)	86.37	267.00	105.99	19.62	27.90
10	86.10	0.22	109.34	23.24	33.05
11(HYD)	86.01	0.13	113.52	27.51	39.12
12(HYD)	85.21	0.18	117.44	32.23	45.83
13	85.18	0.07	121.24	36.06	51.28
14(HYD)	86.56	0.13	109.40	22.84	32.48
15(HYD)	86.19	0.20	109.39	23.20	32.99
16(HYD)	85.88	0.26	109.37	23.49	33.40
17(HYD)	86.15	0.39	109.35	23.20	32.99
100 (RES)	85.26	-125.95	122.90	0.00	0.00
200 (RES)	85.05	-58.79	122.90	0.00	0.00
300 (RES)	86.46	-85.62	123.30	0.00	0.00

Minimum Pressure

**Notes**

1m of head = 1.42197 PSI  
 Fire demand based on FUS 2020

Maximum Daily Demand and Fire Flow					
Node 11 (HYD) - 267L/s Fire Demand					
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure	
				(m)	(PSI)
1	85.17	0.28	122.71	37.54	53.38
2(HYD)	85.59	0.39	121.74	36.15	51.40
3(HYD)	86.05	0.39	120.66	34.61	49.21
4	86.75	0.28	119.99	33.24	47.27
5(HYD)	86.31	0.13	121.78	35.47	50.44
6	86.50	0.07	122.96	36.46	51.85
7(HYD)	86.67	0.09	118.91	32.24	45.84
8	86.68	0.15	114.47	27.79	39.52
9(HYD)	86.37	0.13	113.27	26.90	38.25
10	86.10	0.22	111.96	25.86	36.77
<b>11(HYD)</b>	<b>86.01</b>	<b>267.00</b>	<b>108.70</b>	<b>22.69</b>	<b>32.26</b>
12(HYD)	85.21	0.18	114.64	29.43	41.85
13	85.18	0.07	120.38	35.20	50.05
14(HYD)	86.56	0.13	114.08	27.52	39.13
15(HYD)	86.19	0.20	113.76	27.57	39.20
16(HYD)	85.88	0.26	113.04	27.16	38.62
17(HYD)	86.15	0.39	112.33	26.18	37.23
100 (RES)	85.26	-157.46	122.90	0.00	0.00
200 (RES)	85.05	-45.33	122.90	0.00	0.00
300 (RES)	86.46	-67.57	123.30	0.00	0.00

Minimum Pressure

Notes

1m of head = 1.42197 PSI  
 Fire demand based on FUS 2020

Maximum Daily Demand and Fire Flow					
Node 12 (HYD) - 267L/s Fire Demand					
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure	
				(m)	(PSI)
1	85.17	0.28	122.78	37.61	53.48
2(HYD)	85.59	0.39	122.20	36.61	52.06
3(HYD)	86.05	0.39	121.54	35.49	50.47
4	86.75	0.28	121.14	34.39	48.90
5(HYD)	86.31	0.13	122.31	36.00	51.19
6	86.50	0.07	123.08	36.58	52.02
7(HYD)	86.67	0.09	120.46	33.79	48.05
8	86.68	0.15	117.65	30.97	44.04
9(HYD)	86.37	0.13	116.89	30.52	43.40
10	86.10	0.22	116.07	29.97	42.62
11(HYD)	86.01	0.13	114.02	28.01	39.83
12(HYD)	85.21	267.00	112.11	26.90	38.25
13	85.18	0.07	119.61	34.43	48.96
14(HYD)	86.56	0.13	117.40	30.84	43.85
15(HYD)	86.19	0.20	117.20	31.01	44.10
16(HYD)	85.88	0.26	116.74	30.86	43.88
17(HYD)	86.15	0.39	116.30	30.15	42.87
100 (RES)	85.26	-181.85	122.90	0.00	0.00
200 (RES)	85.05	-34.73	122.90	0.00	0.00
300 (RES)	86.46	-53.74	123.30	0.00	0.00

Minimum Pressure

**Notes**

1m of head = 1.42197 PSI  
 Fire demand based on FUS 2020

Maximum Daily Demand and Fire Flow					
Node 14 (HYD) - 167L/s Fire Demand					
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure	
				(m)	(PSI)
1	85.17	0.28	122.77	37.6	53.47
2(HYD)	85.59	0.39	122.11	36.52	51.93
3(HYD)	86.05	0.39	121.38	35.33	50.24
4	86.75	0.28	120.92	34.17	48.59
5(HYD)	86.31	0.13	122.21	35.90	51.05
6	86.50	0.07	123.06	36.56	51.99
7(HYD)	86.67	0.09	120.16	33.49	47.62
8	86.68	0.15	117.05	30.37	43.19
9(HYD)	86.37	0.13	117.22	30.85	43.87
10	86.10	0.22	117.40	31.30	44.51
11(HYD)	86.01	0.13	119.09	33.08	47.04
12(HYD)	85.21	0.18	120.68	35.47	50.44
13	85.18	0.07	122.22	37.04	52.67
14(HYD)	86.56	167.13	112.81	26.25	37.33
15(HYD)	86.19	0.20	113.48	27.29	38.81
16(HYD)	85.88	0.26	115.00	29.12	41.41
17(HYD)	86.15	0.87	116.54	30.39	43.21
100 (RES)	85.26	-77.47	122.90	0.00	0.00
200 (RES)	85.05	-36.93	122.90	0.00	0.00
300 (RES)	86.46	-56.57	123.30	0.00	0.00

Minimum Pressure

**Notes**

1m of head = 1.42197 PSI  
 Fire demand based on FUS 2020

Maximum Daily Demand and Fire Flow					
Node 15 (HYD) - 167L/s Fire Demand					
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure	
				(m)	(PSI)
1	85.17	0.28	122.77	37.6	53.47
2(HYD)	85.59	0.39	122.13	36.54	51.96
3(HYD)	86.05	0.39	121.41	35.36	50.28
4	86.75	0.28	120.96	34.21	48.65
5(HYD)	86.31	0.13	122.23	35.92	51.08
6	86.50	0.07	123.06	36.56	51.99
7(HYD)	86.67	0.09	120.22	33.55	47.71
8	86.68	0.15	117.17	30.49	43.36
9(HYD)	86.37	0.13	117.22	30.85	43.87
10	86.10	0.22	117.27	31.17	44.32
11(HYD)	86.01	0.13	119.00	32.99	46.91
12(HYD)	85.21	0.18	120.63	35.42	50.37
13	85.18	0.07	122.21	37.03	52.66
14(HYD)	86.56	0.13	113.80	27.24	38.73
15(HYD)	86.19	167.20	111.07	24.88	35.38
16(HYD)	85.88	0.26	113.49	27.61	39.26
17(HYD)	86.15	0.87	115.92	29.77	42.33
100 (RES)	85.26	-78.43	122.90	0.00	0.00
200 (RES)	85.05	-36.51	122.90	0.00	0.00
300 (RES)	86.46	-56.03	123.30	0.00	0.00

Minimum Pressure

Notes

1m of head = 1.42197 PSI  
 Fire demand based on FUS 2020

Maximum Daily Demand and Fire Flow					
Node 16 (HYD) - 167L/s Fire Demand					
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure	
				(m)	(PSI)
1	85.17	0.28	122.77	37.6	53.47
2(HYD)	85.59	0.39	122.14	36.55	51.97
3(HYD)	86.05	0.39	121.43	35.38	50.31
4	86.75	0.28	120.99	34.24	48.69
5(HYD)	86.31	0.13	122.24	35.93	51.09
6	86.50	0.07	123.07	36.57	52.00
7(HYD)	86.67	0.09	120.26	33.59	47.76
8	86.68	0.15	117.25	30.57	43.47
9(HYD)	86.37	0.13	117.22	30.85	43.87
10	86.10	0.22	117.18	31.08	44.19
11(HYD)	86.01	0.13	118.94	32.93	46.83
12(HYD)	85.21	0.18	120.59	35.38	50.31
13	85.18	0.07	122.20	37.02	52.64
14(HYD)	86.56	0.13	115.27	28.71	40.82
15(HYD)	86.19	0.20	113.67	27.48	39.08
16(HYD)	85.88	167.26	110.02	24.14	34.33
17(HYD)	86.15	0.87	114.63	28.48	40.50
100 (RES)	85.26	-79.11	122.90	0.00	0.00
200 (RES)	85.05	-36.21	122.90	0.00	0.00
300 (RES)	86.46	-55.64	123.30	0.00	0.00

Minimum Pressure

Notes

1m of head = 1.42197 PSI  
 Fire demand based on FUS 2020

Maximum Daily Demand and Fire Flow					
Node 17 (HYD) - 167L/s Fire Demand					
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure	
				(m)	(PSI)
1	85.17	0.28	122.78	37.61	53.48
2(HYD)	85.59	0.39	122.18	36.59	52.03
3(HYD)	86.05	0.39	121.50	35.45	50.41
4	86.75	0.28	121.09	34.34	48.83
5(HYD)	86.31	0.13	122.29	35.98	51.16
6	86.50	0.07	123.08	36.58	52.02
7(HYD)	86.67	0.09	120.39	33.72	47.95
8	86.68	0.15	117.51	30.83	43.84
9(HYD)	86.37	0.13	117.21	30.84	43.85
10	86.10	0.22	116.88	30.78	43.77
11(HYD)	86.01	0.13	118.73	32.72	46.53
12(HYD)	85.21	0.18	120.47	35.26	50.14
13	85.18	0.07	122.16	36.98	52.58
14(HYD)	86.56	0.13	116.62	30.06	42.74
15(HYD)	86.19	0.20	115.91	29.72	42.26
16(HYD)	85.88	0.26	114.29	28.41	40.40
17(HYD)	86.15	167.87	112.69	26.54	37.74
100 (RES)	85.26	-81.30	122.90	0.00	0.00
200 (RES)	85.05	-35.26	122.90	0.00	0.00
300 (RES)	86.46	-54.41	123.30	0.00	0.00

Minimum Pressure

**Notes**

1m of head = 1.42197 PSI  
 Fire demand based on FUS 2020

PEAK HOUR					
Node	Elevation (m)	Demand (LPS)	Head (m)	Pressure	
				(m)	(PSI)
1	85.17	0.63	130.3	45.13	64.17
2(HYD)	85.59	0.87	130.30	44.71	63.58
3(HYD)	86.05	0.87	130.29	44.24	62.91
4	86.75	0.63	130.29	43.54	61.91
5(HYD)	86.31	0.29	130.30	43.99	62.55
6	86.50	0.14	130.30	43.80	62.28
7(HYD)	86.67	0.19	130.29	43.62	62.03
8	86.68	0.34	130.29	43.61	62.01
9(HYD)	86.37	0.29	130.29	43.92	62.45
10	86.10	0.48	130.29	44.19	62.84
11(HYD)	86.01	0.29	130.29	44.28	62.96
12(HYD)	85.21	0.39	130.30	45.09	64.12
13	85.18	0.14	130.30	45.13	64.17
14(HYD)	86.56	0.29	130.29	43.73	62.18
15(HYD)	86.19	0.43	130.29	44.10	62.71
16(HYD)	85.88	0.58	130.29	44.41	63.15
17(HYD)	86.15	0.87	130.29	44.14	62.77
100 (RES)	85.26	-2.62	130.30	0.00	0.00
200 (RES)	85.05	-2.68	130.30	0.00	0.00
300 (RES)	86.46	-2.42	130.30	0.00	0.00

Minimum Pressure

Notes

1m of head = 1.42197 PSI

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Link - Node Table:

Link ID	Start Node	End Node	Length m	Diameter mm
200-1	200	1	13.2	200
1-2	1	2(HYD)	66.9	200
2-3	2(HYD)	3(HYD)	76.1	200
4	3(HYD)	4	48.3	200
5-4	4	5(HYD)	59.1	200
5-6	5(HYD)	6	38.7	200
300-6	6	300	11	200
4-7	4	7(HYD)	14.0	200
7-8	7(HYD)	8	57.7	200
9-8	8	9(HYD)	30.1	200
10-9	9(HYD)	10	32.9	200
11-10	10	11(HYD)	43.4	200
12-11	11(HYD)	12(HYD)	40.7	200
13-12	12(HYD)	13	39.3	200
100-13	13	100	17.2	200
8-14	8	14(HYD)	49.1	200
14-15	14(HYD)	15(HYD)	39.8	200
15-16	15(HYD)	16(HYD)	90.9	200
17-16	16(HYD)	17(HYD)	90.6	200
10-17	17(HYD)	10	49.2	200

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                 *
*****

```

Node Results (Average Day):

Node ID	Demand LPS	Head m	Pressure m	Quality hours	
1	0.11	124.40	39.23	0.54	
2(HYD)	0.16	124.41	38.82	0.38	
3(HYD)	0.16	124.42	38.37	0.22	
4	0.11	124.43	37.68	0.11	
5(HYD)	0.05	124.47	38.16	0.05	
6	0.03	124.49	37.99	0.01	
7(HYD)	0.04	124.43	37.76	0.15	
8	0.06	124.42	37.74	0.27	
9(HYD)	0.05	124.42	38.05	0.37	
10	0.09	124.42	38.32	1.08	
11(HYD)	0.05	124.41	38.40	1.19	
12(HYD)	0.07	124.41	39.20	1.30	
13	0.03	124.40	39.22	1.40	
14(HYD)	0.05	124.42	37.86	0.61	
15(HYD)	0.08	124.42	38.23	0.90	
16(HYD)	0.11	124.42	38.54	1.60	
17(HYD)	0.16	124.42	38.27	2.38	
100	3.22	124.40	0.00	0.00	Reservoir
200	3.69	124.40	0.00	0.00	Reservoir
300	-8.32	124.50	0.00	0.00	Reservoir

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Link Results (Average Day):

Link ID	Flow LPS	Velocity m/s	Unit Headloss m/km	Status
200-1	3.69	0.12	0.14	Open
1-2	3.80	0.12	0.15	Open
2-3	3.96	0.13	0.16	Open
4	4.12	0.13	0.17	Open
5-4	8.24	0.26	0.62	Open
5-6	8.29	0.26	0.63	Open
300-6	8.32	0.26	0.63	Open
4-7	4.01	0.13	0.16	Open
7-8	3.97	0.13	0.16	Open
9-8	2.65	0.08	0.08	Open
10-9	2.60	0.08	0.07	Open
11-10	3.37	0.11	0.12	Open
12-11	3.32	0.11	0.11	Open
13-12	3.25	0.10	0.11	Open
100-13	3.22	0.10	0.11	Open
8-14	1.26	0.04	0.02	Open
14-15	1.21	0.04	0.02	Open
15-16	1.13	0.04	0.02	Open
17-16	1.02	0.03	0.01	Open
10-17	0.86	0.03	0.01	Open

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Node Results (Max Day + Fire Flow - Node 2):

Node ID	Demand LPS	Head m	Pressure m	Quality	
1	0.28	120.92	35.75	0.00	
2	267.00	110.90	25.31	0.00	
3	0.39	116.40	30.35	0.00	
4	0.28	119.91	33.16	0.00	
5	0.13	121.75	35.44	0.00	
6	0.07	122.96	36.46	0.00	
7	0.09	120.07	33.40	0.00	
8	0.15	120.74	34.06	0.00	
9	0.13	120.93	34.56	0.00	
10	0.22	121.14	35.04	0.00	
11	0.13	121.68	35.67	0.00	
12	0.18	122.19	36.98	0.00	
13	0.07	122.68	37.50	0.00	
14	0.13	120.80	34.24	0.00	
15	0.20	120.85	34.66	0.00	
16	0.26	120.96	35.08	0.00	
17	0.39	121.07	34.92	0.00	
100	-41.96	122.90	0.00	0.00	Reservoir
200	-159.71	122.90	0.00	0.00	Reservoir
300	-68.43	123.30	0.00	0.00	Reservoir

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Link Results (Max Day + Fire Flow - Node 2):

Link ID	Flow LPS	Velocity m/s	Unit Headloss m/km	Status
200-1	159.71	5.08	150.19	Open
1-2	159.43	5.07	149.70	Open
2-3	-107.57	3.42	72.23	Open
4	-107.96	3.44	72.72	Open
5-4	-68.23	2.17	31.09	Open
5-6	-68.36	2.18	31.19	Open
300-6	-68.43	2.18	31.25	Open
4-7	-40.01	1.27	11.57	Open
7-8	-40.10	1.28	11.62	Open
9-8	-28.71	0.91	6.26	Open
10-9	-28.84	0.92	6.31	Open
11-10	-41.58	1.32	12.42	Open
12-11	-41.71	1.33	12.50	Open
13-12	-41.89	1.33	12.60	Open
100-13	-41.96	1.34	12.63	Open
8-14	-11.54	0.37	1.16	Open
14-15	-11.67	0.37	1.18	Open
15-16	-11.87	0.38	1.22	Open
17-16	-12.13	0.39	1.27	Open
10-17	-12.52	0.40	1.35	Open

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Node Results (Max Day + Fire Flow - Node 3):

Node ID	Demand LPS	Head m	Pressure m	Quality	
1	0.28	121.83	36.66	0.00	
2	0.39	116.42	30.83	0.00	
3	267.00	110.31	24.26	0.00	
4	0.28	117.02	30.27	0.00	
5	0.13	120.43	34.12	0.00	
6	0.07	122.66	36.16	0.00	
7	0.09	117.34	30.67	0.00	
8	0.15	118.68	32.00	0.00	
9	0.13	119.06	32.69	0.00	
10	0.22	119.47	33.37	0.00	
11	0.13	120.52	34.51	0.00	
12	0.18	121.51	36.30	0.00	
13	0.07	122.48	37.30	0.00	
14	0.13	118.80	32.24	0.00	
15	0.20	118.89	32.70	0.00	
16	0.26	119.11	33.23	0.00	
17	0.39	119.34	33.19	0.00	
100	-60.11	122.90	0.00	0.00	Reservoir
200	-114.56	122.90	0.00	0.00	Reservoir
300	-95.43	123.30	0.00	0.00	Reservoir

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                *
*****

```

Link Results (Max Day + Fire Flow - Node 3):

Link ID	Flow LPS	Velocity m/s	Unit Headloss m/km	Status
200-1	114.56	3.65	81.17	Open
1-2	114.28	3.64	80.80	Open
2-3	113.89	3.63	80.29	Open
4	-153.11	4.87	138.89	Open
5-4	-95.23	3.03	57.64	Open
5-6	-95.36	3.04	57.79	Open
300-6	-95.43	3.04	57.86	Open
4-7	-58.16	1.85	23.13	Open
7-8	-58.25	1.85	23.19	Open
9-8	-41.52	1.32	12.39	Open
10-9	-41.65	1.33	12.46	Open
11-10	-59.73	1.90	24.30	Open
12-11	-59.86	1.91	24.39	Open
13-12	-60.04	1.91	24.53	Open
100-13	-60.11	1.91	24.58	Open
8-14	-16.88	0.54	2.34	Open
14-15	-17.01	0.54	2.37	Open
15-16	-17.21	0.55	2.42	Open
17-16	-17.47	0.56	2.49	Open
10-17	-17.86	0.57	2.60	Open

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                *
*****

```

Node Results (Max Day + Fire Flow - Node 5):

Node ID	Demand LPS	Head m	Pressure m	Quality	
1	0.28	122.63	37.46	0.00	
2	0.39	121.30	35.71	0.00	
3	0.39	119.81	33.76	0.00	
4	0.28	118.88	32.13	0.00	
5	267.00	115.17	28.86	0.00	
6	0.07	121.50	35.00	0.00	
7	0.09	119.10	32.43	0.00	
8	0.15	120.01	33.33	0.00	
9	0.13	120.26	33.89	0.00	
10	0.22	120.54	34.44	0.00	
11	0.13	121.26	35.25	0.00	
12	0.18	121.95	36.74	0.00	
13	0.07	122.61	37.43	0.00	
14	0.13	120.08	33.52	0.00	
15	0.20	120.15	33.96	0.00	
16	0.26	120.30	34.42	0.00	
17	0.39	120.45	34.30	0.00	
100	-49.13	122.90	0.00	0.00	Reservoir
200	-53.89	122.90	0.00	0.00	Reservoir
300	-167.35	123.30	0.00	0.00	Reservoir

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                 *
*****

```

Link Results (Max Day + Fire Flow - Node 5):

Link ID	Flow LPS	Velocity m/s	Unit Headloss m/km	Status
200-1	53.89	1.72	20.08	Open
1-2	53.61	1.71	19.89	Open
2-3	53.22	1.69	19.62	Open
4	52.83	1.68	19.35	Open
5-4	99.72	3.17	62.78	Open
5-6	-167.28	5.32	163.63	Open
300-6	-167.35	5.33	163.75	Open
4-7	-47.18	1.50	15.70	Open
7-8	-47.27	1.50	15.75	Open
9-8	-33.77	1.07	8.45	Open
10-9	-33.90	1.08	8.51	Open
11-10	-48.75	1.55	16.68	Open
12-11	-48.88	1.56	16.76	Open
13-12	-49.06	1.56	16.88	Open
100-13	-49.13	1.56	16.92	Open
8-14	-13.65	0.43	1.58	Open
14-15	-13.78	0.44	1.61	Open
15-16	-13.98	0.44	1.65	Open
17-16	-14.24	0.45	1.71	Open
10-17	-14.63	0.47	1.79	Open

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Node Results (Max Day + Fire Flow - Node 7):

Node ID	Demand LPS	Head m	Pressure m	Quality	
1	0.28	122.39	37.22	0.00	
2	0.39	119.85	34.26	0.00	
3	0.39	116.98	30.93	0.00	
4	0.28	115.17	28.42	0.00	
5	0.13	119.58	33.27	0.00	
6	0.07	122.48	35.98	0.00	
7	267.00	112.43	25.76	0.00	
8	0.15	114.98	28.30	0.00	
9	0.13	115.68	29.31	0.00	
10	0.22	116.46	30.36	0.00	
11	0.13	118.44	32.43	0.00	
12	0.18	120.30	35.09	0.00	
13	0.07	122.11	36.93	0.00	
14	0.13	115.20	28.64	0.00	
15	0.20	115.38	29.19	0.00	
16	0.26	115.79	29.91	0.00	
17	0.39	116.22	30.07	0.00	
100	-84.34	122.90	0.00	0.00	Reservoir
200	-76.40	122.90	0.00	0.00	Reservoir
300	-109.66	123.30	0.00	0.00	Reservoir

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Link Results (Max Day + Fire Flow - Node 7):

```

-----
Link      Flow  VelocityUnit  Headloss  Status
ID        LPS      m/s          m/km
-----
200-1      76.40     2.43         38.33     Open
1-2        76.12     2.42         38.07     Open
2-3        75.73     2.41         37.71     Open
4          75.34     2.40         37.35     Open
5-4       -109.46    3.48         74.61     Open
5-6       -109.59    3.49         74.77     Open
300-6     -109.66    3.49         74.86     Open
4-7       184.52     5.87        196.23     Open
7-8       -82.48     2.63         44.17     Open
9-8       -58.63     1.87         23.48     Open
10-9      -58.76     1.87         23.58     Open
11-10     -83.96     2.67         45.65     Open
12-11     -84.09     2.68         45.78     Open
13-12     -84.27     2.68         45.96     Open
100-13    -84.34     2.68         46.03     Open
8-14      -24.00     0.76         4.49     Open
14-15     -24.13     0.77         4.53     Open
15-16     -24.33     0.77         4.60     Open
17-16     -24.59     0.78         4.69     Open
10-17     -24.98     0.79         4.83     Open

```

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Node Results (Max Day + Fire Flow - Node 9):

Node ID	Demand LPS	Head m	Pressure m	Quality	
1	0.28	122.59	37.42	0.00	
2	0.39	121.02	35.43	0.00	
3	0.39	119.27	33.22	0.00	
4	0.28	118.16	31.41	0.00	
5	0.13	120.95	34.64	0.00	
6	0.07	122.78	36.28	0.00	
7	0.09	116.45	29.78	0.00	
8	0.15	109.41	22.73	0.00	
9	267.00	105.99	19.62	0.00	
10	0.22	109.34	23.24	0.00	
11	0.13	113.52	27.51	0.00	
12	0.18	117.44	32.23	0.00	
13	0.07	121.24	36.06	0.00	
14	0.13	109.40	22.84	0.00	
15	0.20	109.39	23.20	0.00	
16	0.26	109.37	23.49	0.00	
17	0.39	109.35	23.20	0.00	
100	-125.95	122.90	0.00	0.00	Reservoir
200	-58.79	122.90	0.00	0.00	Reservoir
300	-85.62	123.30	0.00	0.00	Reservoir

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                 *
*****

```

Link Results (Max Day + Fire Flow - Node 9):

```

-----
Link      Flow  VelocityUnit  Headloss  Status
ID        LPS      m/s          m/km
-----
200-1     58.79    1.87         23.59    Open
1-2       58.51    1.86         23.39    Open
2-3       58.12    1.85         23.10    Open
4         57.73    1.84         22.81    Open
5-4      -85.42    2.72         47.13    Open
5-6      -85.55    2.72         47.27    Open
300-6    -85.62    2.73         47.34    Open
4-7      142.87    4.55        122.19    Open
7-8      142.78    4.54        122.04    Open
9-8      137.46    4.38        113.76    Open
10-9     -129.54    4.12        101.91    Open
11-10    -125.57    4.00         96.20    Open
12-11    -125.70    4.00         96.38    Open
13-12    -125.88    4.01         96.64    Open
100-13   -125.95    4.01         96.74    Open
8-14      5.17     0.16         0.26    Open
14-15     5.04     0.16         0.25    Open
15-16     4.84     0.15         0.23    Open
17-16     4.58     0.15         0.21    Open
10-17     4.19     0.13         0.18    Open

```

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Node Results (Max Day + Fire Flow - Node 11):

Node ID	Demand LPS	Head m	Pressure m	Quality	
1	0.28	122.71	37.54	0.00	
2	0.39	121.74	36.15	0.00	
3	0.39	120.66	34.61	0.00	
4	0.28	119.99	33.24	0.00	
5	0.13	121.78	35.47	0.00	
6	0.07	122.96	36.46	0.00	
7	0.09	118.91	32.24	0.00	
8	0.15	114.47	27.79	0.00	
9	0.13	113.27	26.90	0.00	
10	0.22	111.96	25.86	0.00	
11	267.00	108.70	22.69	0.00	
12	0.18	114.64	29.43	0.00	
13	0.07	120.38	35.20	0.00	
14	0.13	114.08	27.52	0.00	
15	0.20	113.76	27.57	0.00	
16	0.26	113.04	27.16	0.00	
17	0.39	112.33	26.18	0.00	
100	-157.46	122.90	0.00	0.00	Reservoir
200	-45.33	122.90	0.00	0.00	Reservoir
300	-67.57	123.30	0.00	0.00	Reservoir

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                 *
*****

```

Link Results (Max Day + Fire Flow - Node 11):

```

-----

```

Link ID	Flow LPS	Velocity m/s	Unit Headloss m/km	Status
200-1	45.33	1.44	14.58	Open
1-2	45.05	1.43	14.41	Open
2-3	44.66	1.42	14.18	Open
4	44.27	1.41	13.95	Open
5-4	-67.37	2.14	30.36	Open
5-6	-67.50	2.15	30.47	Open
300-6	-67.57	2.15	30.53	Open
4-7	111.36	3.54	77.02	Open
7-8	111.27	3.54	76.90	Open
9-8	78.19	2.49	40.01	Open
10-9	78.06	2.48	39.88	Open
11-10	109.79	3.49	75.02	Open
12-11	-157.21	5.00	145.86	Open
13-12	-157.39	5.01	146.17	Open
100-13	-157.46	5.01	146.29	Open
8-14	32.93	1.05	8.07	Open
14-15	32.80	1.04	8.01	Open
15-16	32.60	1.04	7.92	Open
17-16	32.34	1.03	7.80	Open
10-17	31.95	1.02	7.63	Open

```

-----

```

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                *
*                               Analysis for Pipe Networks                  *
*                               Version 2.2                                *
*****

```

Node Results (Max Day + Fire Flow - Node 12):

Node ID	Demand LPS	Head m	Pressure m	Quality	
1	0.28	122.78	37.61	0.00	
2	0.39	122.20	36.61	0.00	
3	0.39	121.54	35.49	0.00	
4	0.28	121.14	34.39	0.00	
5	0.13	122.31	36.00	0.00	
6	0.07	123.08	36.58	0.00	
7	0.09	120.46	33.79	0.00	
8	0.15	117.65	30.97	0.00	
9	0.13	116.89	30.52	0.00	
10	0.22	116.07	29.97	0.00	
11	0.13	114.02	28.01	0.00	
12	267.00	112.11	26.90	0.00	
13	0.07	119.61	34.43	0.00	
14	0.13	117.40	30.84	0.00	
15	0.20	117.20	31.01	0.00	
16	0.26	116.74	30.86	0.00	
17	0.39	116.30	30.15	0.00	
100	-181.85	122.90	0.00	0.00	Reservoir
200	-34.73	122.90	0.00	0.00	Reservoir
300	-53.74	123.30	0.00	0.00	Reservoir

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                 *
*****

```

Link Results (Max Day + Fire Flow - Node 12):

Link ID	Flow LPS	Velocity m/s	Unit Headloss m/km	Status
200-1	34.73	1.11	8.90	Open
1-2	34.45	1.10	8.77	Open
2-3	34.06	1.08	8.59	Open
4	33.67	1.07	8.40	Open
5-4	-53.54	1.70	19.84	Open
5-6	-53.67	1.71	19.93	Open
300-6	-53.74	1.71	19.98	Open
4-7	86.92	2.77	48.68	Open
7-8	86.83	2.76	48.59	Open
9-8	60.93	1.94	25.21	Open
10-9	60.80	1.94	25.11	Open
11-10	85.35	2.72	47.06	Open
12-11	85.22	2.71	46.93	Open
13-12	-181.78	5.79	190.86	Open
100-13	-181.85	5.79	191.00	Open
8-14	25.75	0.82	5.12	Open
14-15	25.62	0.82	5.07	Open
15-16	25.42	0.81	4.99	Open
17-16	25.16	0.80	4.90	Open
10-17	24.77	0.79	4.76	Open

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                *
*****

```

Node Results (Max Day + Fire Flow - Node 14):

Node ID	Demand LPS	Head m	Pressure m	Quality	
1	0.28	122.77	37.60	0.00	
2	0.39	122.11	36.52	0.00	
3	0.39	121.38	35.33	0.00	
4	0.28	120.92	34.17	0.00	
5	0.13	122.21	35.90	0.00	
6	0.07	123.06	36.56	0.00	
7	0.09	120.16	33.49	0.00	
8	0.15	117.05	30.37	0.00	
9	0.13	117.22	30.85	0.00	
10	0.22	117.40	31.30	0.00	
11	0.13	119.09	33.08	0.00	
12	0.18	120.68	35.47	0.00	
13	0.07	122.22	37.04	0.00	
14	167.13	112.81	26.25	0.00	
15	0.20	113.48	27.29	0.00	
16	0.26	115.00	29.12	0.00	
17	0.87	116.54	30.39	0.00	
100	-77.47	122.90	0.00	0.00	Reservoir
200	-36.93	122.90	0.00	0.00	Reservoir
300	-56.57	123.30	0.00	0.00	Reservoir

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Link Results (Max Day + Fire Flow - Node 14):

```

-----

```

Link ID	Flow LPS	Velocity m/s	Unit Headloss m/km	Status
200-1	36.93	1.18	9.97	Open
1-2	36.65	1.17	9.83	Open
2-3	36.26	1.15	9.64	Open
4	35.87	1.14	9.45	Open
5-4	-56.37	1.79	21.83	Open
5-6	-56.50	1.80	21.92	Open
300-6	-56.57	1.80	21.97	Open
4-7	91.96	2.93	54.03	Open
7-8	91.87	2.92	53.93	Open
9-8	-26.70	0.85	5.47	Open
10-9	-26.83	0.85	5.52	Open
11-10	-77.09	2.45	38.97	Open
12-11	-77.22	2.46	39.09	Open
13-12	-77.40	2.46	39.26	Open
100-13	-77.47	2.47	39.33	Open
8-14	118.42	3.77	86.31	Open
14-15	-48.71	1.55	16.65	Open
15-16	-48.91	1.56	16.78	Open
17-16	-49.17	1.56	16.94	Open
10-17	-50.04	1.59	17.50	Open

```

-----

```

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Node Results (Max Day + Fire Flow - Node 15):

Node ID	Demand LPS	Head m	Pressure m	Quality	
1	0.28	122.77	37.60	0.00	
2	0.39	122.13	36.54	0.00	
3	0.39	121.41	35.36	0.00	
4	0.28	120.96	34.21	0.00	
5	0.13	122.23	35.92	0.00	
6	0.07	123.06	36.56	0.00	
7	0.09	120.22	33.55	0.00	
8	0.15	117.17	30.49	0.00	
9	0.13	117.22	30.85	0.00	
10	0.22	117.27	31.17	0.00	
11	0.13	119.00	32.99	0.00	
12	0.18	120.63	35.42	0.00	
13	0.07	122.21	37.03	0.00	
14	0.13	113.80	27.24	0.00	
15	167.20	111.07	24.88	0.00	
16	0.26	113.49	27.61	0.00	
17	0.87	115.92	29.77	0.00	
100	-78.43	122.90	0.00	0.00	Reservoir
200	-36.51	122.90	0.00	0.00	Reservoir
300	-56.03	123.30	0.00	0.00	Reservoir

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                *
*****

```

Link Results (Max Day + Fire Flow - Node 15):

Link ID	Flow LPS	Velocity m/s	Unit Headloss m/km	Status
200-1	36.51	1.16	9.77	Open
1-2	36.23	1.15	9.63	Open
2-3	35.84	1.14	9.44	Open
4	35.45	1.13	9.25	Open
5-4	-55.83	1.78	21.44	Open
5-6	-55.96	1.78	21.53	Open
300-6	-56.03	1.78	21.58	Open
4-7	91.00	2.90	53.00	Open
7-8	90.91	2.89	52.90	Open
9-8	-13.86	0.44	1.62	Open
10-9	-13.99	0.45	1.65	Open
11-10	-78.05	2.48	39.87	Open
12-11	-78.18	2.49	40.00	Open
13-12	-78.36	2.49	40.17	Open
100-13	-78.43	2.50	40.23	Open
8-14	104.62	3.33	68.61	Open
14-15	104.49	3.33	68.45	Open
15-16	-62.71	2.00	26.59	Open
17-16	-62.97	2.00	26.79	Open
10-17	-63.84	2.03	27.48	Open

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Node Results (Max Day + Fire Flow - Node 16):

Node ID	Demand LPS	Head m	Pressure m	Quality	
1	0.28	122.77	37.60	0.00	
2	0.39	122.14	36.55	0.00	
3	0.39	121.43	35.38	0.00	
4	0.28	120.99	34.24	0.00	
5	0.13	122.24	35.93	0.00	
6	0.07	123.07	36.57	0.00	
7	0.09	120.26	33.59	0.00	
8	0.15	117.25	30.57	0.00	
9	0.13	117.22	30.85	0.00	
10	0.22	117.18	31.08	0.00	
11	0.13	118.94	32.93	0.00	
12	0.18	120.59	35.38	0.00	
13	0.07	122.20	37.02	0.00	
14	0.13	115.27	28.71	0.00	
15	0.20	113.67	27.48	0.00	
16	167.26	110.02	24.14	0.00	
17	0.87	114.63	28.48	0.00	
100	-79.11	122.90	0.00	0.00	Reservoir
200	-36.21	122.90	0.00	0.00	Reservoir
300	-55.64	123.30	0.00	0.00	Reservoir

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                 *
*****

```

Link Results (Max Day + Fire Flow - Node 16):

```

-----
Link      Flow  VelocityUnit  Headloss  Status
ID        LPS      m/s          m/km
-----
200-1     36.21    1.15         9.62     Open
1-2       35.93    1.14         9.48     Open
2-3       35.54    1.13         9.29     Open
4         35.15    1.12         9.10     Open
5-4      -55.44    1.76        21.17     Open
5-6      -55.57    1.77        21.26     Open
300-6    -55.64    1.77        21.31     Open
4-7       90.32    2.87        52.26     Open
7-8       90.23    2.87        52.16     Open
9-8       11.49    0.37         1.15     Open
10-9      11.36    0.36         1.12     Open
11-10    -78.73    2.51        40.53     Open
12-11    -78.86    2.51        40.65     Open
13-12    -79.04    2.52        40.82     Open
100-13   -79.11    2.52        40.89     Open
8-14      78.58    2.50        40.38     Open
14-15     78.45    2.50        40.26     Open
15-16     78.25    2.49        40.07     Open
17-16    -89.01    2.83        50.86     Open
10-17    -89.88    2.86        51.79     Open

```

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Node Results (Max Day + Fire Flow - Node 17):

Node ID	Demand LPS	Head m	Pressure m	Quality	
1	0.28	122.78	37.61	0.00	
2	0.39	122.18	36.59	0.00	
3	0.39	121.50	35.45	0.00	
4	0.28	121.09	34.34	0.00	
5	0.13	122.29	35.98	0.00	
6	0.07	123.08	36.58	0.00	
7	0.09	120.39	33.72	0.00	
8	0.15	117.51	30.83	0.00	
9	0.13	117.21	30.84	0.00	
10	0.22	116.88	30.78	0.00	
11	0.13	118.73	32.72	0.00	
12	0.18	120.47	35.26	0.00	
13	0.07	122.16	36.98	0.00	
14	0.13	116.62	30.06	0.00	
15	0.20	115.91	29.72	0.00	
16	0.26	114.29	28.41	0.00	
17	167.87	112.69	26.54	0.00	
100	-81.30	122.90	0.00	0.00	Reservoir
200	-35.26	122.90	0.00	0.00	Reservoir
300	-54.41	123.30	0.00	0.00	Reservoir

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                 *
*****

```

Link Results (Max Day + Fire Flow - Node 17):

Link ID	Flow LPS	Velocity m/s	Unit Headloss m/km	Status
200-1	35.26	1.12	9.15	Open
1-2	34.98	1.11	9.02	Open
2-3	34.59	1.10	8.83	Open
4	34.20	1.09	8.65	Open
5-4	-54.21	1.73	20.30	Open
5-6	-54.34	1.73	20.39	Open
300-6	-54.41	1.73	20.44	Open
4-7	88.13	2.81	49.94	Open
7-8	88.04	2.80	49.84	Open
9-8	37.03	1.18	10.02	Open
10-9	36.90	1.17	9.96	Open
11-10	-80.92	2.58	42.64	Open
12-11	-81.05	2.58	42.76	Open
13-12	-81.23	2.59	42.94	Open
100-13	-81.30	2.59	43.01	Open
8-14	50.86	1.62	18.04	Open
14-15	50.73	1.61	17.96	Open
15-16	50.53	1.61	17.83	Open
17-16	50.27	1.60	17.66	Open
10-17	-117.60	3.74	85.20	Open

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****

```

Node Results (Peak Hour):

Node ID	Demand LPS	Head m	Pressure m	Quality	
1	0.63	130.30	45.13	0.00	
2	0.87	130.30	44.71	0.00	
3	0.87	130.29	44.24	0.00	
4	0.63	130.29	43.54	0.00	
5	0.29	130.30	43.99	0.00	
6	0.14	130.30	43.80	0.00	
7	0.19	130.29	43.62	0.00	
8	0.34	130.29	43.61	0.00	
9	0.29	130.29	43.92	0.00	
10	0.48	130.29	44.19	0.00	
11	0.29	130.29	44.28	0.00	
12	0.39	130.30	45.09	0.00	
13	0.14	130.30	45.13	0.00	
14	0.29	130.29	43.73	0.00	
15	0.43	130.29	44.10	0.00	
16	0.58	130.29	44.41	0.00	
17	0.87	130.29	44.14	0.00	
100	-2.62	130.30	0.00	0.00	Reservoir
200	-2.68	130.30	0.00	0.00	Reservoir
300	-2.42	130.30	0.00	0.00	Reservoir

```



*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                *
*****

```

Link Results (Peak Hour):

Link ID	Flow LPS	Velocity m/s	Unit Headloss m/km	Status
200-1	2.68	0.09	0.08	Open
1-2	2.05	0.07	0.05	Open
2-3	1.18	0.04	0.02	Open
4	0.31	0.01	0.00	Open
5-4	-1.99	0.06	0.04	Open
5-6	-2.28	0.07	0.06	Open
300-6	-2.42	0.08	0.06	Open
4-7	1.67	0.05	0.03	Open
7-8	1.48	0.05	0.03	Open
9-8	0.15	0.00	0.00	Open
10-9	-0.14	0.00	0.00	Open
11-10	-1.80	0.06	0.04	Open
12-11	-2.09	0.07	0.05	Open
13-12	-2.48	0.08	0.07	Open
100-13	-2.62	0.08	0.07	Open
8-14	0.99	0.03	0.01	Open
14-15	0.70	0.02	0.01	Open
15-16	0.27	0.01	0.00	Open
17-16	-0.31	0.01	0.00	Open
10-17	-1.18	0.04	0.02	Open

**Appendix C**  
**Sanitary Servicing**

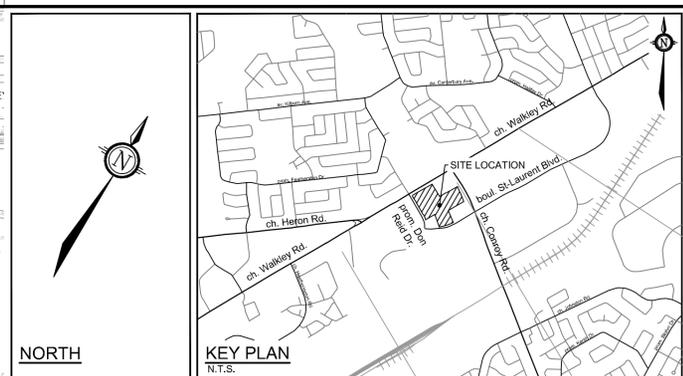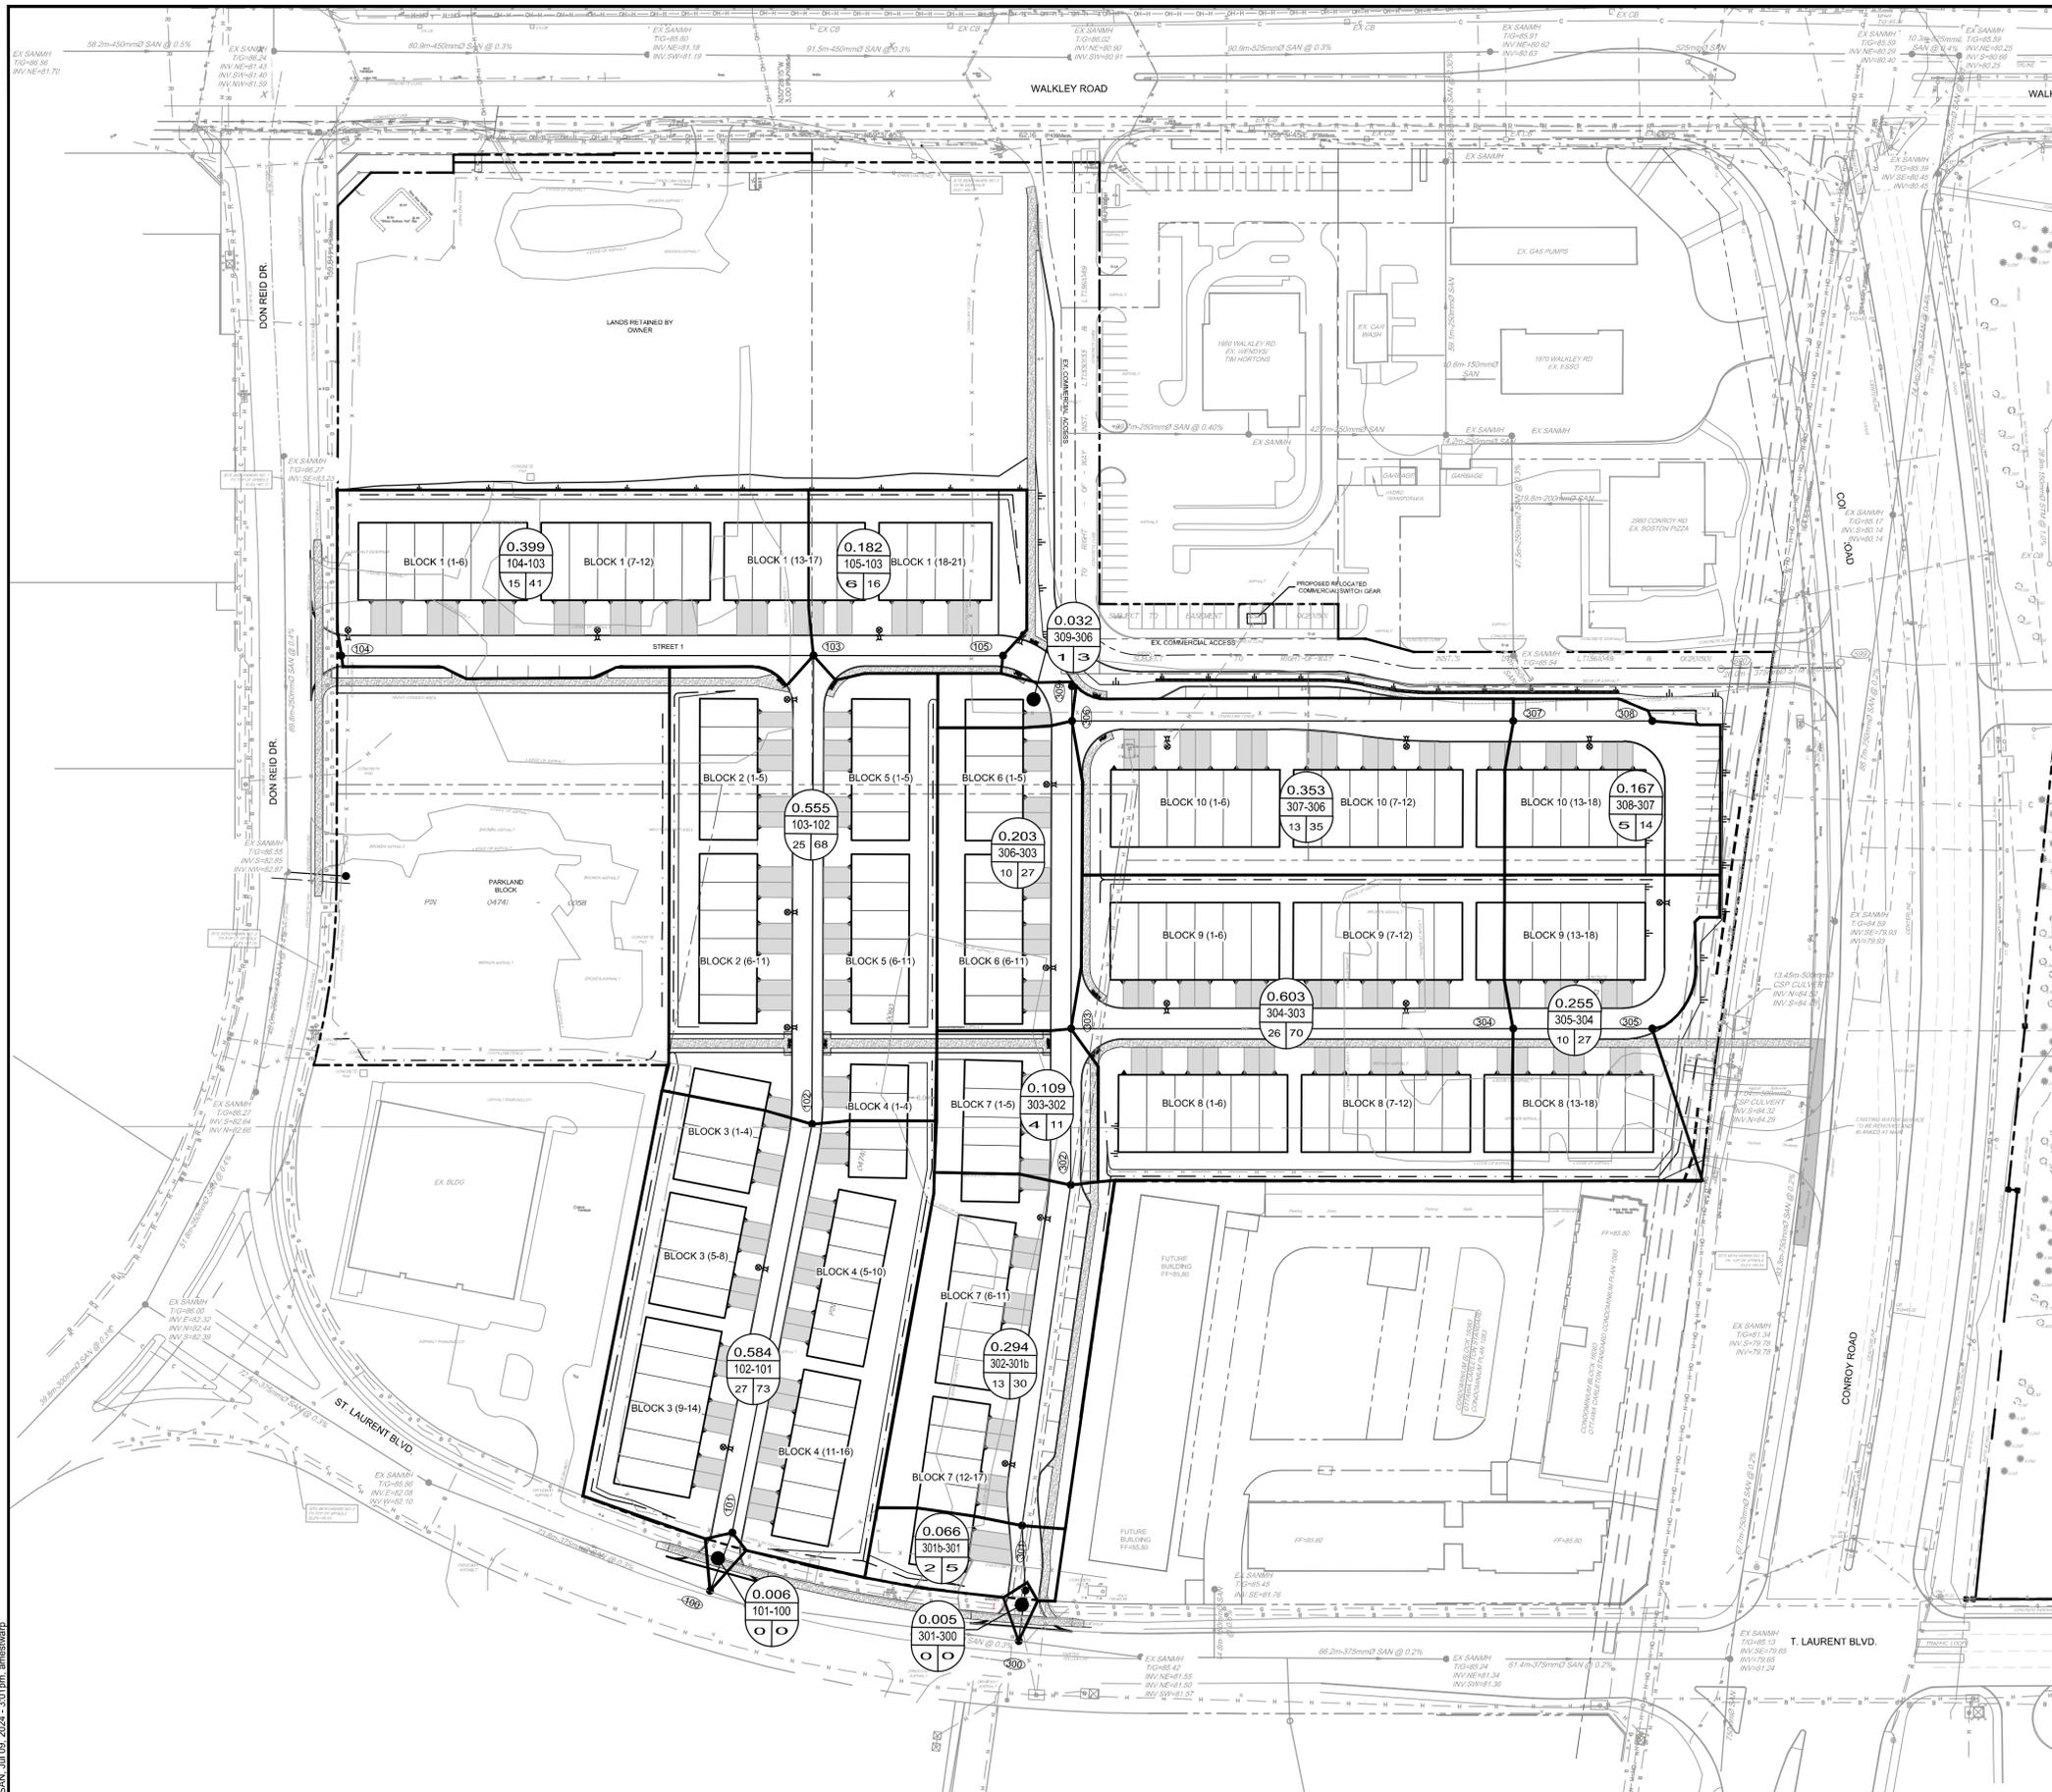

- LEGEND**
- SITE PROPERTY LINE
  - - - MISC LEGAL LINE (EASEMENT, PROPERTY LINES)  
REFER TO LEGAL PLAN FOR DETAILS
  - ▬ TACTILE WALKING SURFACE INDICATOR (TWSI) PER CITY DETAIL SC7.3
  - ▬ PROPOSED SIDEWALK
  - ▬ PROPOSED RETAINING WALL
  - ▬ C/W RAILING
  - ▬ PROPOSED CURB
  - ▬ DC PROPOSED DEPRESSED CURB
  - ▬ PROPOSED ASPHALT DRIVEWAY
  - ▬ SWALE c/w SUBDRAIN AND DIRECTION OF FLOW
  - PROPOSED SANITARY MANHOLE
  - ▬ PROPOSED SANITARY SEWER AND FLOW DIRECTION
  - ▲ PROPOSED SERVICE LATERALS  
REFER TO DETAIL ON DWG. 122040 ND1
  - ▬ SANITARY DRAINAGE AREA BOUNDARY
  - AREA IN HECTARES  
110-108  
24 51
  - MANHOLE TO MANHOLE
  - POPULATION EQUIVALENT
  - SAN.MH. EXISTING SANITARY MANHOLE & SEWER


**NOTE:**  
THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

**CLARIDGE HOMES**  
CLARIDGE HOMES  
505 PRESTON STREET,  
2ND FLOOR  
OTTAWA, ONTARIO  
K1S 4N7.



**NOT FOR CONSTRUCTION**

No.	REVISION	DATE	BY
6.	REVISED SITE PLAN	JULY 12/24	ARM
5.	REVISED PER CITY COMMENTS	JAN 31/24	ARM
4.	REVISED SITE PLAN	SEPT 29/23	ARM
3.	ISSUED FOR UTILITY COORDINATION	SEPT 20/23	ARM
2.	REVISED PER CITY COMMENTS	MAY 26/23	GJM
1.	ISSUED IN SUPPORT OF DEVELOPMENT APPLICATIONS	NOV 01/22	GJM



DESIGN	FOR REVIEW ONLY
ARM	ISSUED FOR REVIEW
GJM	
CJF/ARM	
ARM	
GJM	

**NOVATECH**  
Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website www.novatech-eng.com

LOCATION CITY OF OTTAWA 2510 ST. LAURENT BOULEVARD		PROJECT No. 122040
DRAWING NAME SANITARY DRAINAGE PLAN		REV REV#6
		DRAWING No. 122040-SAN

M:\2024\122040\CAD\Civil\122040-SAN.dwg, SAN, Jul 09, 2024, 3:01 pm, amstswarp

Novatech Project #: 122040  
 Project Name: Conroy Walkey  
 Date Prepared: 9/7/2022  
 Date Revised: 10/24/2022  
 Date Revised: 5/30/2022  
 Date Revised: 7/11/2023  
 Date Revised: 9/27/2023  
 Date Revised: 7/9/2024  
 Input By: Curtis Ferguson  
 Reviewed By: Anthony Mestwarp  
 Drawing Reference: 122040-SAN

Legend: PROJECT SPECIFIC INFO  
 USER DESIGN INPUT  
 CUMULATIVE CELL  
 CALCULATED DESIGN CELL OUTPUT



LOCATION		DEMAND										DESIGN CAPACITY							
FROM MH	TO MH	RESIDENTIAL FLOW					EXTRANEIOUS FLOW					PROPOSED SEWER PIPE SIZING / DESIGN							
		Townhomes	POPULATION (in 1000's)	CUMULATIVE POPULATION (in 1000's)	PEAK FACTOR M	AVG POPULATION FLOW (L/s)	PEAKED DESIGN POP FLOW (L/s)	Total Area (ha.)	Accum. Area (ha.)	DESIGN EXTRAN. FLOW (L/s)	TOTAL DESIGN FLOW (L/s)	PIPE LENGTH (m)	PIPE SIZE (mm) AND MATERIAL	PIPE ID ACTUAL (m)	ROUGH. (n)	DESIGN GRADE (%)	CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	Qpeak Design / Qcap
West Connection (St. Laurent Boulevard)																			
105	103	6	0.016	0.016	3.71	0.05	0.19	0.182	0.182	0.06	0.26	41.0	250 PVC	0.254	0.013	0.65	50.0	0.99	0.5%
104	103	15	0.041	0.041	3.67	0.13	0.48	0.399	0.399	0.13	0.61	102.2	250 PVC	0.254	0.013	0.65	50.0	0.99	1.2%
103	102	25	0.068	0.124	3.57	0.40	1.44	0.555	1.136	0.37	1.81	101.2	250 PVC	0.254	0.013	0.30	34.0	0.67	5.3%
102	101	27	0.073	0.197	3.52	0.64	2.25	0.584	1.720	0.57	2.82	89.9	250 PVC	0.254	0.013	0.30	34.0	0.67	8.3%
101	100	0	0.000	0.197	3.52	0.64	2.25	0.006	1.726	0.57	2.82	13.4	250 PVC	0.254	0.013	0.30	34.0	0.67	8.3%
East Connection (St. Laurent Boulevard)																			
309	306	1	0.003	0.003	3.76	0.01	0.03	0.032	0.032	0.01	0.04	7.5	250 PVC	0.254	0.013	0.65	50.0	0.99	0.1%
308	307	5	0.014	0.014	3.72	0.04	0.16	0.167	0.167	0.06	0.22	30.1	250 PVC	0.254	0.013	0.65	50.0	0.99	0.4%
307	306	13	0.035	0.049	3.65	0.16	0.58	0.353	0.520	0.17	0.75	95.5	250 PVC	0.254	0.013	0.30	34.0	0.67	2.2%
306	303	10	0.027	0.078	3.62	0.25	0.92	0.203	0.755	0.25	1.17	66.4	250 PVC	0.254	0.013	0.30	34.0	0.67	3.4%
305	304	10	0.027	0.027	3.69	0.09	0.32	0.255	0.255	0.08	0.41	30.1	250 PVC	0.254	0.013	0.65	50.0	0.99	0.8%
304	303	26	0.070	0.097	3.60	0.32	1.13	0.603	0.858	0.28	1.42	95.7	250 PVC	0.254	0.013	0.30	34.0	0.67	4.2%
303	302	4	0.011	0.186	3.53	0.60	2.13	0.109	1.722	0.57	2.70	33.8	250 PVC	0.254	0.013	0.30	34.0	0.67	7.9%
302	301b	11	0.030	0.216	3.51	0.70	2.46	0.294	2.016	0.67	3.12	74.4	250 PVC	0.254	0.013	0.30	34.0	0.67	9.2%
301b	301	2	0.005	0.221	3.51	0.72	2.52	0.066	2.082	0.69	3.20	14.0	250 PVC	0.254	0.013	0.30	34.0	0.67	9.4%
301	300	0	0.000	0.221	3.51	0.72	2.52	0.005	2.087	0.69	3.20	11.0	250 PVC	0.254	0.013	0.30	34.0	0.67	9.4%
TOTAL		155	0.419	0.419				3.813			6.02								
<b>Design Parameters:</b> 1. Residential Flows - Townhome                      2.7 Person/ Unit 3. q Avg capita flow                280 L/per/day 4. M = Harmon Formula (maximum of 4.0) 5. K =                                    0.8 6. Commercial Peak Factor -area > 20% of development    1.5 -area < 20% of development    1.0 8. Extraneous Flows =               0.33 L/sec/ha												<b>CAPACITY EQUATION</b> $Q_{full} = (1/n) A R^{(2/3)} S_o^{(1/2)}$  Where : Q full = Capacity (L/s)  n = Manning coefficient of roughness (0.013) A = Flow area (m <sup>2</sup> ) R = Wetted perimeter (m) S <sub>o</sub> = Pipe Slope/gradient							

**Appendix D**  
**Storm Servicing**

STORM SEWER DESIGN SHEET



Novatech Project #: 122040  
 Project Name: 2510 St. Laurent Blvd.  
 Date Prepared: 5/31/2023  
 Date Revised: 9/27/2023  
 Date Revised: 1/16/2024  
 Date Revised: 7/9/2024  
 Input By: Anthony Mestwarp, P.Eng  
 Reviewed By: Greg MacDonald, P.Eng  
 Drawing Reference: 122040-SWM

Legend:  
 PROJECT SPECIFIC INFO  
 USER DESIGN INPUT  
 CUMULATIVE CELL  
 CALCULATED DESIGN CELL OUTPUT  
 USER AS-BUILT INPUT

LOCATION		DEMAND										CAPACITY											
From MH	To MH	Area ID	AREA				FLOW				PROPOSED SEWER PIPE SIZING / DESIGN												
			Hardscape	Landscaping	Total Area	Weighted Runoff Coefficient	Indivi 2.78 AR	Accum 2.78 AR	Time of Concentration (min.)	Rain Intensity (mm/hr)			Peak Flow (L/s)	TOTAL UNRESTRICTED PEAK FLOW (QDesign) (L/s)	PIPE PROPERTIES				CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW (min.)	QPEAK DESIGN / QFULL (%)	
			0.90	0.20	(ha)					2yr	5yr	100yr			LENGTH (m)	SIZE / MATERIAL (mm / type)	ID ACTUAL (m)	ROUGHNESS	DESIGN GRADE (%)				
West System (200 - Series)																							
205	203	A-11	0.113 0.000 0.000	0.121	0.234	0.54	0.35	0.35	10.00	76.81			26.83 0.00 0.00	26.8	41.6	300 PVC	0.3048	0.013	0.65	81.3	1.11	0.62	33.0%
204	203	A-10	0.149 0.000 0.000	0.043	0.192	0.74	0.40																
		A-09	0.053 0.000 0.000	0.012	0.065	0.77	0.14	0.53	10.00	76.81			41.07 0.00 0.00	41.1	102.2	375 PVC	0.381	0.013	0.65	147.5	1.29	1.32	27.8%
203	202	A-08	0.125 0.000 0.000	0.141	0.266	0.53	0.39																
		A-07	0.104 0.000 0.000	0.034	0.139	0.73	0.28																
		A-06	0.110 0.000 0.000	0.039	0.149	0.72	0.30																
		A-05	0.045 0.000 0.000	0.059	0.104	0.51	0.15	2.00	11.32	72.09			144.02 0.00 0.00	144.0	100.9	450 PVC	0.4572	0.013	0.30	162.9	0.99	1.69	88.4%
202	201	A-04	0.092 0.000 0.000	0.159	0.251	0.46	0.32																
		A-03	0.126 0.000 0.000	0.030	0.156	0.76	0.33																
		A-02	0.132 0.000 0.000	0.033	0.165	0.76	0.35																
		A-01	0.071 0.000 0.000	0.080	0.151	0.53	0.22	3.22	13.01	66.90			215.19 0.00 0.00	215.2	90.8	525 CONC	0.5334	0.013	0.30	245.7	1.10	1.38	87.6%
201	EX		0.000 0.000 0.000				0.00	3.22	14.39	63.25			203.46 0.00 0.00	203.5	10.5	525 CONC	0.5334	0.013	0.30	245.7	1.10	0.16	82.8%

STORM SEWER DESIGN SHEET



LOCATION			DEMAND										CAPACITY													
From MH	To MH	Area ID	AREA				FLOW						PROPOSED SEWER PIPE SIZING / DESIGN													
			Hardscape	Landscaping	Total Area	Weighted Runoff Coefficient	Indivi 2.78 AR	Accum 2.78 AR	Time of Concentration (min.)	Rain Intensity (mm/hr)			Peak Flow (L/s)	TOTAL UNRESTRICTED PEAK FLOW (QDesign) (L/s)	PIPE PROPERTIES				CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW (min.)	QPEAK DESIGN / QFULL (%)				
			0.90	0.20	(ha)					2yr	5yr	100yr			LENGTH (m)	SIZE / MATERIAL (mm / type)	ID ACTUAL (m)	ROUGHNESS	DESIGN GRADE (%)							
East System (400 - Series)																										
408	407		0.000				0.00	0.00	10.00					0.00	0.0	35.5	250 PVC	0.254	0.013	0.65	50.0	0.99	0.60	0.0%		
			0.000				0.00	0.00	10.00					0.00												
			0.000				0.00	0.00	10.00					0.00												
407	406		0.000				0.00	0.00	10.65					0.00	0.0	91.6	250 PVC	0.254	0.013	0.30	34.0	0.67	2.28	0.0%		
			0.000				0.00	0.00	10.65					0.00												
			0.000				0.00	0.00	10.65					0.00												
505	406	B-19	0.056	0.011	0.067	0.78	0.15																			
			0.000				0.00																			
			0.000				0.00																			
				B-18	0.044	0.018	0.062	0.69	0.12																	
					0.000				0.00																	
					0.000				0.00																	
				B-17	0.108	0.033	0.140	0.74	0.29																	
					0.000				0.00																	
					0.000				0.00																	
				B-16	0.046	0.002	0.048	0.87	0.12																	
					0.000				0.00																	
					0.000				0.00																	
		B-15	0.049	0.010	0.059	0.78	0.13																			
			0.000				0.00																			
			0.000				0.00																			
		B-14	0.016	0.005	0.021	0.73	0.04																			
			0.000				0.00																			
			0.000				0.00																			
		B-13	0.042	0.023	0.065	0.65	0.12																			
			0.000				0.00																			
			0.000				0.00																			
		B-12	0.072	0.027	0.099	0.71	0.20																			
			0.000				0.00																			
			0.000				0.00																			
		B-11	0.183	0.166	0.349	0.57	0.55	1.70	10.00	76.81				130.91	130.9	3.7	375 PVC	0.381	0.013	1.00	182.9	1.60	0.04	71.6%		
			0.000				0.00	0.00	10.00					0.00												
			0.000				0.00	0.00	10.00					0.00												
406	403	B-06	0.091	0.024	0.115	0.75	0.24	1.95	12.93	67.14				130.59	130.6	69.4	450 PVC	0.4572	0.013	0.30	162.9	0.99	1.17	80.2%		
			0.000				0.00	0.00	12.93				0.00													
			0.000				0.00	0.00	12.93				0.00													
405	404	B-10	0.125	0.029	0.153	0.77	0.33																			
			0.000				0.00																			
			0.000				0.00																			
		B-09	0.110	0.027	0.137	0.76	0.29	0.62	10.00	76.81				47.41	47.4	35.5	300 PVC	0.3048	0.013	0.65	81.3	1.11	0.53	58.3%		
			0.000				0.00	0.00	10.00				0.00													
			0.000				0.00	0.00	10.00				0.00													
404	403	B-08	0.084	0.022	0.107	0.75	0.22																			
			0.000				0.00																			
			0.000				0.00																			
		B-07	0.095	0.023	0.118	0.77	0.25	1.09	10.53	74.83				81.68	81.7	91.8	450 PVC	0.4572	0.013	0.30	162.9	0.99	1.54	50.1%		
			0.000				0.00	0.00	10.53				0.00													
			0.000				0.00	0.00	10.53				0.00													
403	402		0.000				0.00	3.04	14.09	64.00				194.34	194.3	30.4	525 CONC	0.5334	0.013	0.30	245.7	1.10	0.46	79.1%		
			0.000				0.00	0.00	14.09					0.00												
			0.000				0.00	0.00	14.09					0.00												
402	401b	EX-01	0.000	0.024	0.024	0.20	0.01																			
			0.000				0.00																			
			0.000				0.00																			
				B-05	0.092	0.120	0.212	0.50	0.30																	
					0.000				0.00																	
					0.000				0.00																	
		B-02	0.072	0.025	0.097	0.72	0.19																			
			0.000				0.00																			
			0.000				0.00																			
		B-01	0.119	0.035	0.155	0.74	0.32	3.86	14.55	62.84				242.59	242.6	74.5	600 CONC	0.6096	0.013	0.30	350.8	1.20	1.03	69.1%		
			0.000				0.00	0.00	14.55				0.00													
			0.000				0.00	0.00	14.55				0.00													
401b	401		0.000				0.00	3.86	15.59	60.42				233.23	233.2	13.5	600 CONC	0.6096	0.013	0.30	350.8	1.20	0.19	66.5%		
			0.000				0.00	0.00	15.59				0.00													
			0.000				0.00	0.00	15.59				0.00													
401	400		0.000				0.00	3.86	15.77	60.00				231.62	231.6	12.0	600 CONC	0.6096	0.013	0.30	350.8	1.20	0.17	66.0%		
			0.000				0.00	0.00	15.77				0.00													
			0.000				0.00	0.00	15.77				0.00													

STORM SEWER DESIGN SHEET

LOCATION			DEMAND										CAPACITY														
From MH	To MH	Area ID	AREA				FLOW						PROPOSED SEWER PIPE SIZING / DESIGN														
			Hardscape	Landscaping	Total Area	Weighted Runoff Coefficient	Indivi 2.78 AR	Accum 2.78 AR	Time of Concentration (min.)	Rain Intensity (mm/hr)			Peak Flow (L/s)	TOTAL UNRESTRICTED PEAK FLOW (QDesign) (L/s)	PIPE PROPERTIES				CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW (min.)	QPEAK DESIGN / QFULL (%)					
			0.90	0.20	(ha)					2yr	5yr	100yr			LENGTH (m)	SIZE / MATERIAL (mm / type)	ID ACTUAL (m)	ROUGHNESS	DESIGN GRADE (%)								
Commercial Road System (600 - Series)																											
601	600	C-01	0.066	0.015	0.081	0.77	0.17																				
			0.000				0.00																				
			0.000																								
		C-02	0.051	0.020	0.071	0.71	0.14																				
			0.000				0.00																				
			0.000																								
		C-03	0.025	0.012	0.037	0.68	0.07																				
			0.000				0.00																				
			0.000																								
		C-04	0.026	0.010	0.035	0.71	0.07																				
			0.000				0.00																				
			0.000																								
		C-05	0.023	0.008	0.031	0.73	0.06																				
			0.000				0.00																				
			0.000																								
		C-06	0.026	0.009	0.035	0.72	0.07	0.58	10.00	76.81					44.92												
			0.000				0.00	0.00	10.00						44.9	4.7	375 PVC	0.381	0.013	0.50		129.3	1.13	0.07	34.7%		
			0.000																								
600	599		0.000				0.00	0.58	10.07	76.54			44.77														
			0.000				0.00	0.00	10.07				44.8	26.0	375 PVC	0.381	0.013	0.50		129.3	1.13	0.38	34.6%				
			0.000				0.00	0.00	10.07																		

<p><b>DEMAND EQUATION</b>  <math>Q = 2.78 AIR</math></p> <p>Where : Q = Peak flow in litres per second (L/s)          A = Area in hectares (ha)          R = Weighted runoff coefficient (increased by 25% for 100-year)          I = Rainfall intensity in millimeters per hour (mm/hr)          Rainfall Intensity (I) is based on City of Ottawa IDF data presented in the City of Ottawa Sewer Design Guidelines (Oct. 2012)</p>	<p><b>CAPACITY EQUATION</b>  <math>Q_{full} = (1/n) A R^{(2/3)} S_o^{(1/2)}</math></p> <p>Where : Q full = Capacity (L/s)          n = Manning coefficient of roughness (0.013)          A = Flow area (m<sup>2</sup>)          R = Wetted perimeter (m)          S<sub>o</sub> = Pipe Slope/gradient</p>
--	---

**Appendix E**  
**Stormwater Management**

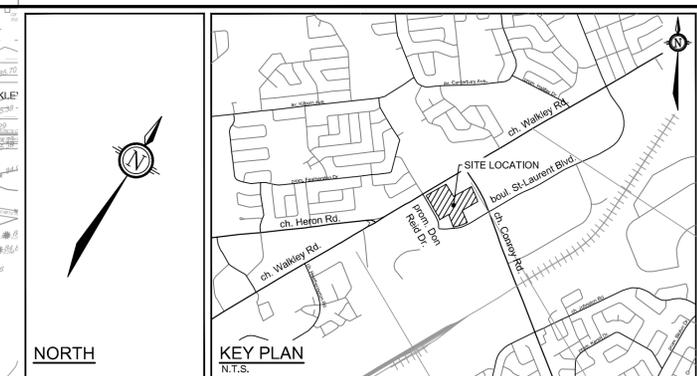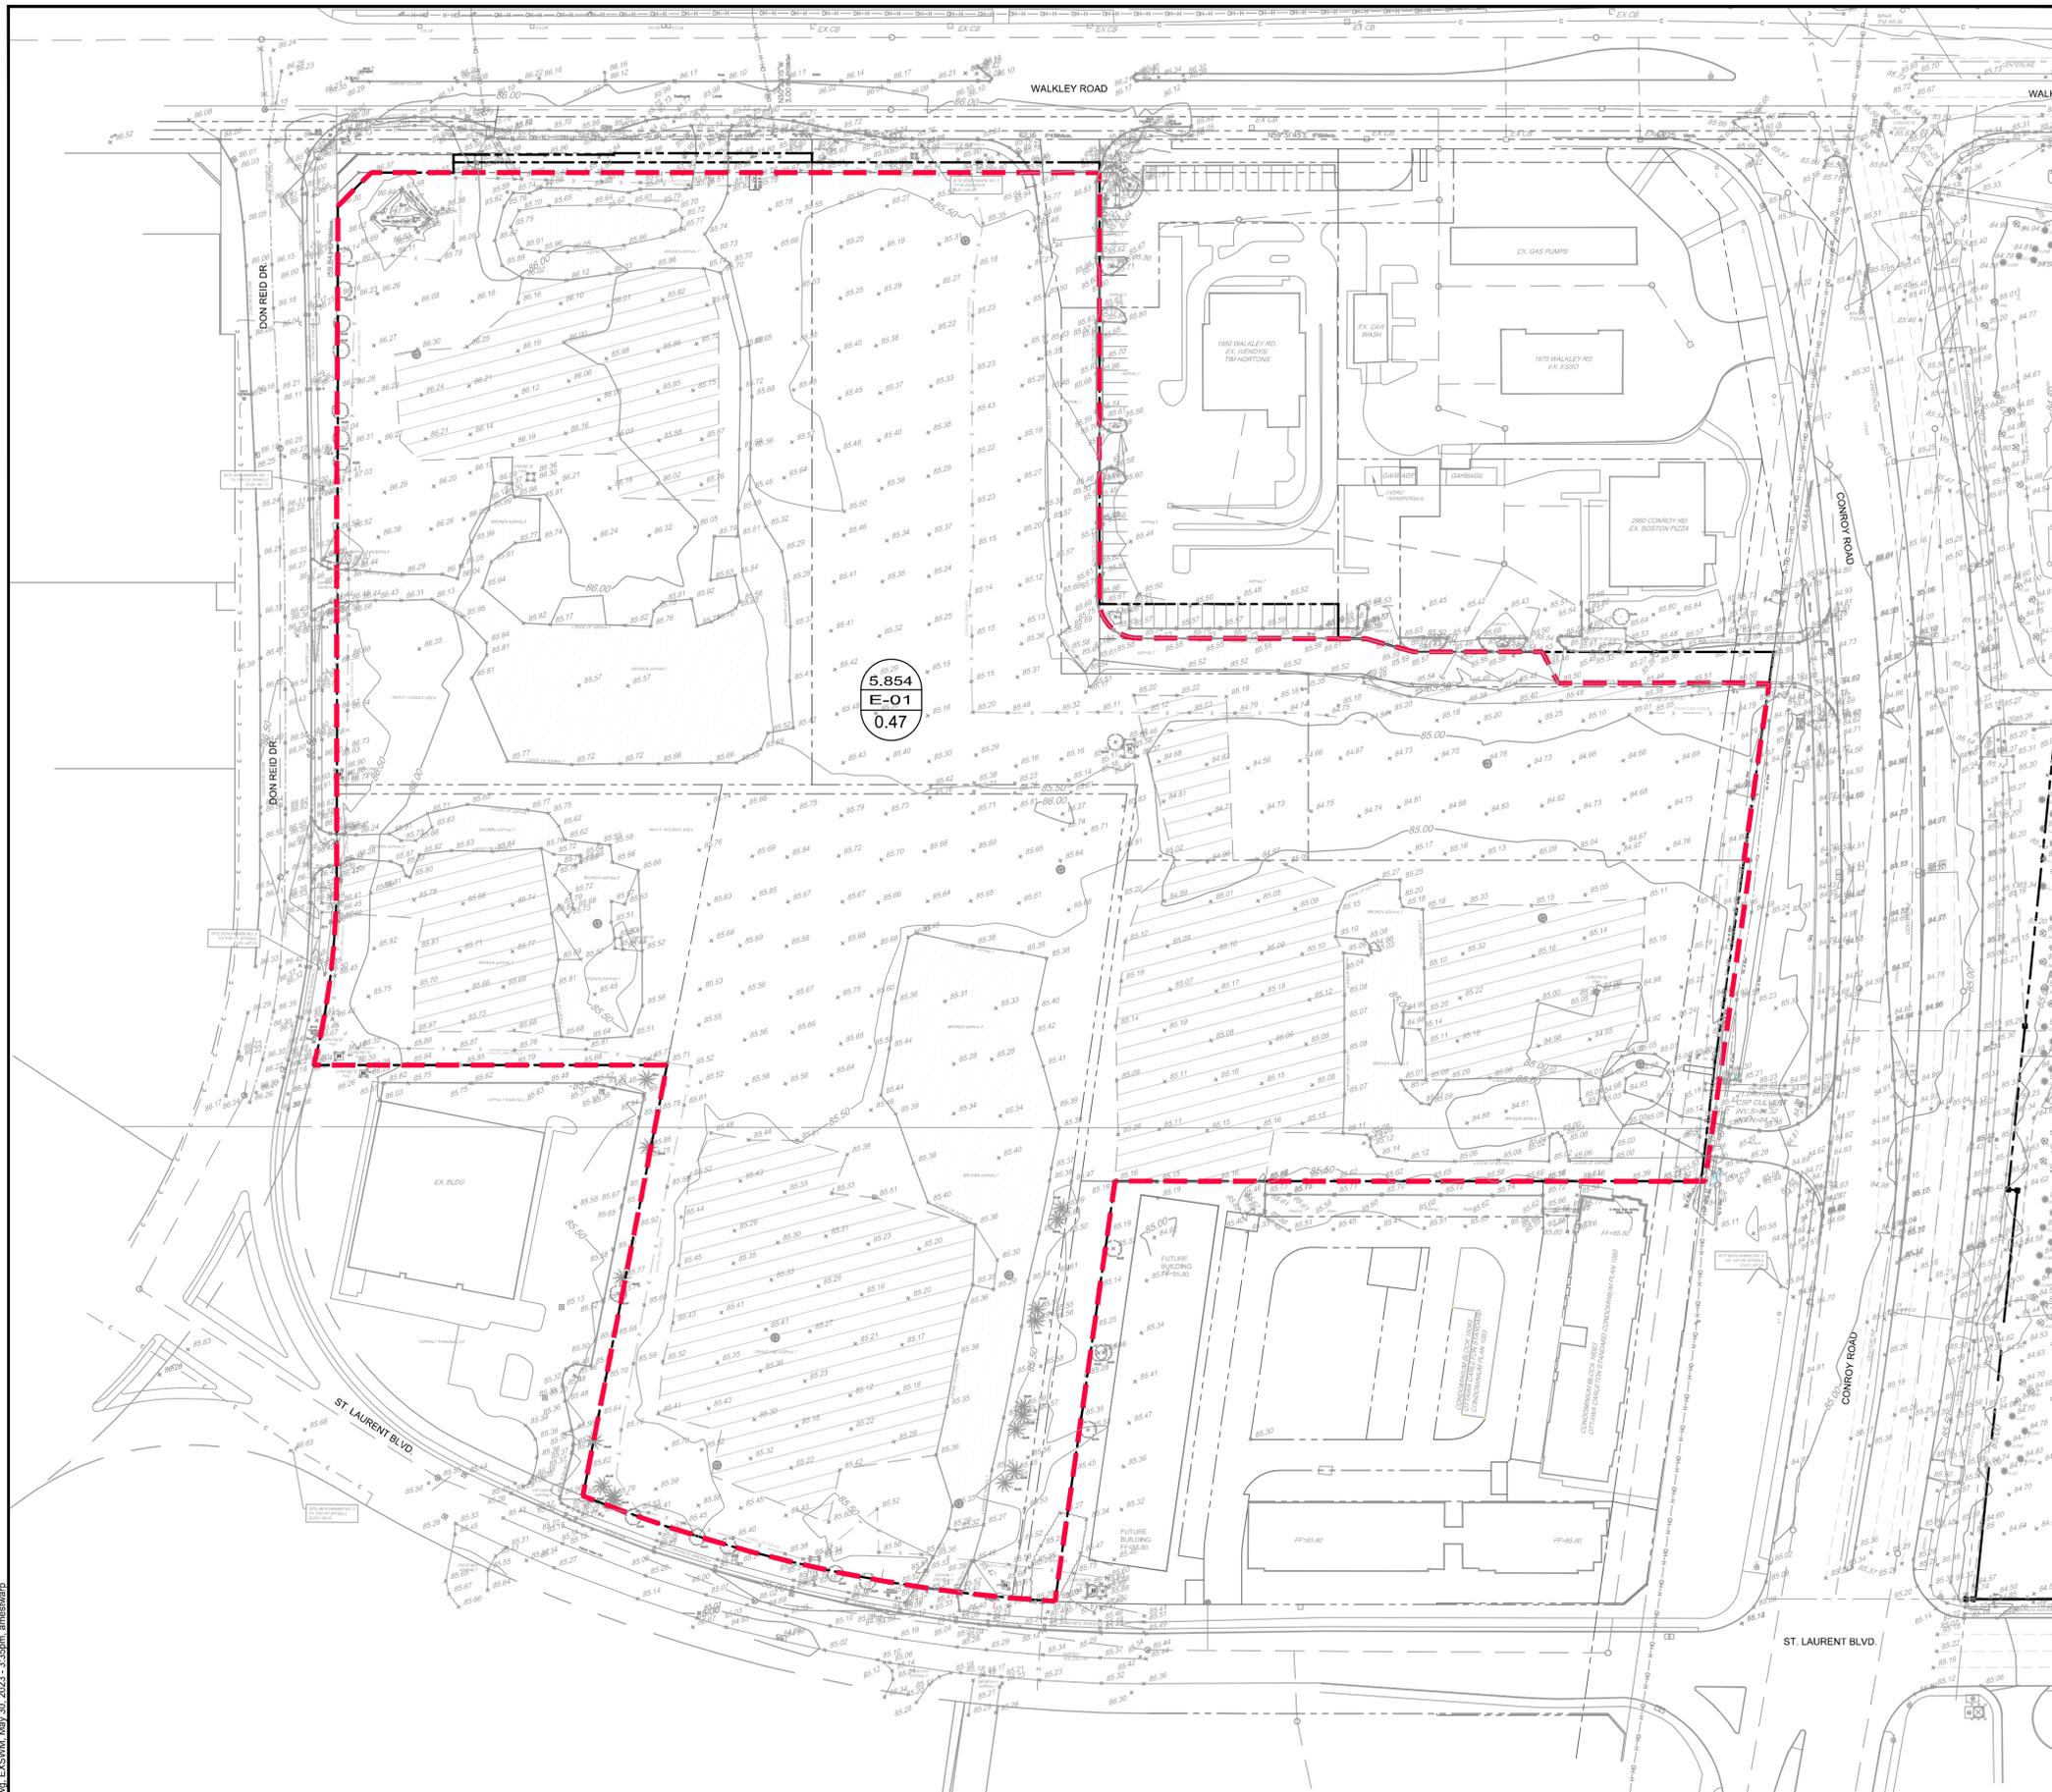

**LEGEND**

- PROPERTY LINE
- EXISTING STORM MANHOLE & SEWER
- EXISTING CATCHBASIN
- STORM SEWER DRAINAGE AREA BOUNDARY
- DRAINAGE AREA (ha)
- DRAINAGE AREA ID
- RUNOFF COEFFICIENT
- EXISTING ASPHALT AREA
- EXISTING GRAVEL/BROKEN ASPHALT AREA

NOTE: EQUIVALENT COEFFICIENT CALCULATED USING SCS. REFER TO PCSWM OUTPUT FOR DETAILS.

NOTE: THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

**CLARIDGE HOMES**  
 CLARIDGE HOMES  
 505 PRESTON STREET,  
 2ND FLOOR  
 OTTAWA, ONTARIO  
 K1S 4N7.



**NOT FOR CONSTRUCTION**

No.	REVISION	DATE	BY
4	REVISED SITE PLAN	SEPT 29/23	ARM
3	ISSUED FOR UTILITY COORDINATION	SEPT 20/23	ARM
2	REVISED PER CITY COMMENTS	MAY 26/23	GJM
1	ISSUED IN SUPPORT OF DEVELOPMENT APPLICATIONS	NOV 01/22	GJM

DESIGN	ARM
CHECKED	GJM
DRAWN	CJF/ARM
CHECKED	ARM
APPROVED	GJM

SCALE: 1:750

FOR REVIEW ONLY



ISSUED FOR REVIEW

ISSUED FOR REVIEW

**NOVATECH**  
 Engineers, Planners & Landscape Architects  
 Suite 200, 240 Michael Cowpland Drive  
 Ottawa, Ontario, Canada K2M 1P6  
 Telephone: (613) 254-9643  
 Facsimile: (613) 254-5867  
 Website: www.novatech-eng.com

LOCATION CITY OF OTTAWA 2510 ST. LAURENT BOULEVARD		PROJECT No. 122040
DRAWING NAME PRE-DEVELOPMENT STORM DRAINAGE AREA PLAN		REV REV#4
		DRAWING No. 122040-EXSWM

M:\2023\122040\CAD\Civil\122040-EXSWM.dwg; EXSWM, May 30, 2023 - 3:35pm, ameshwarp

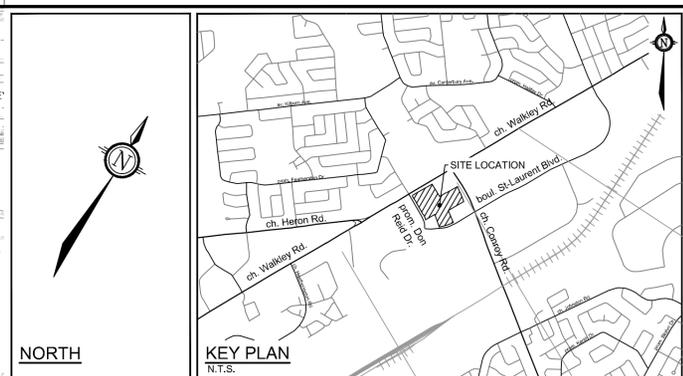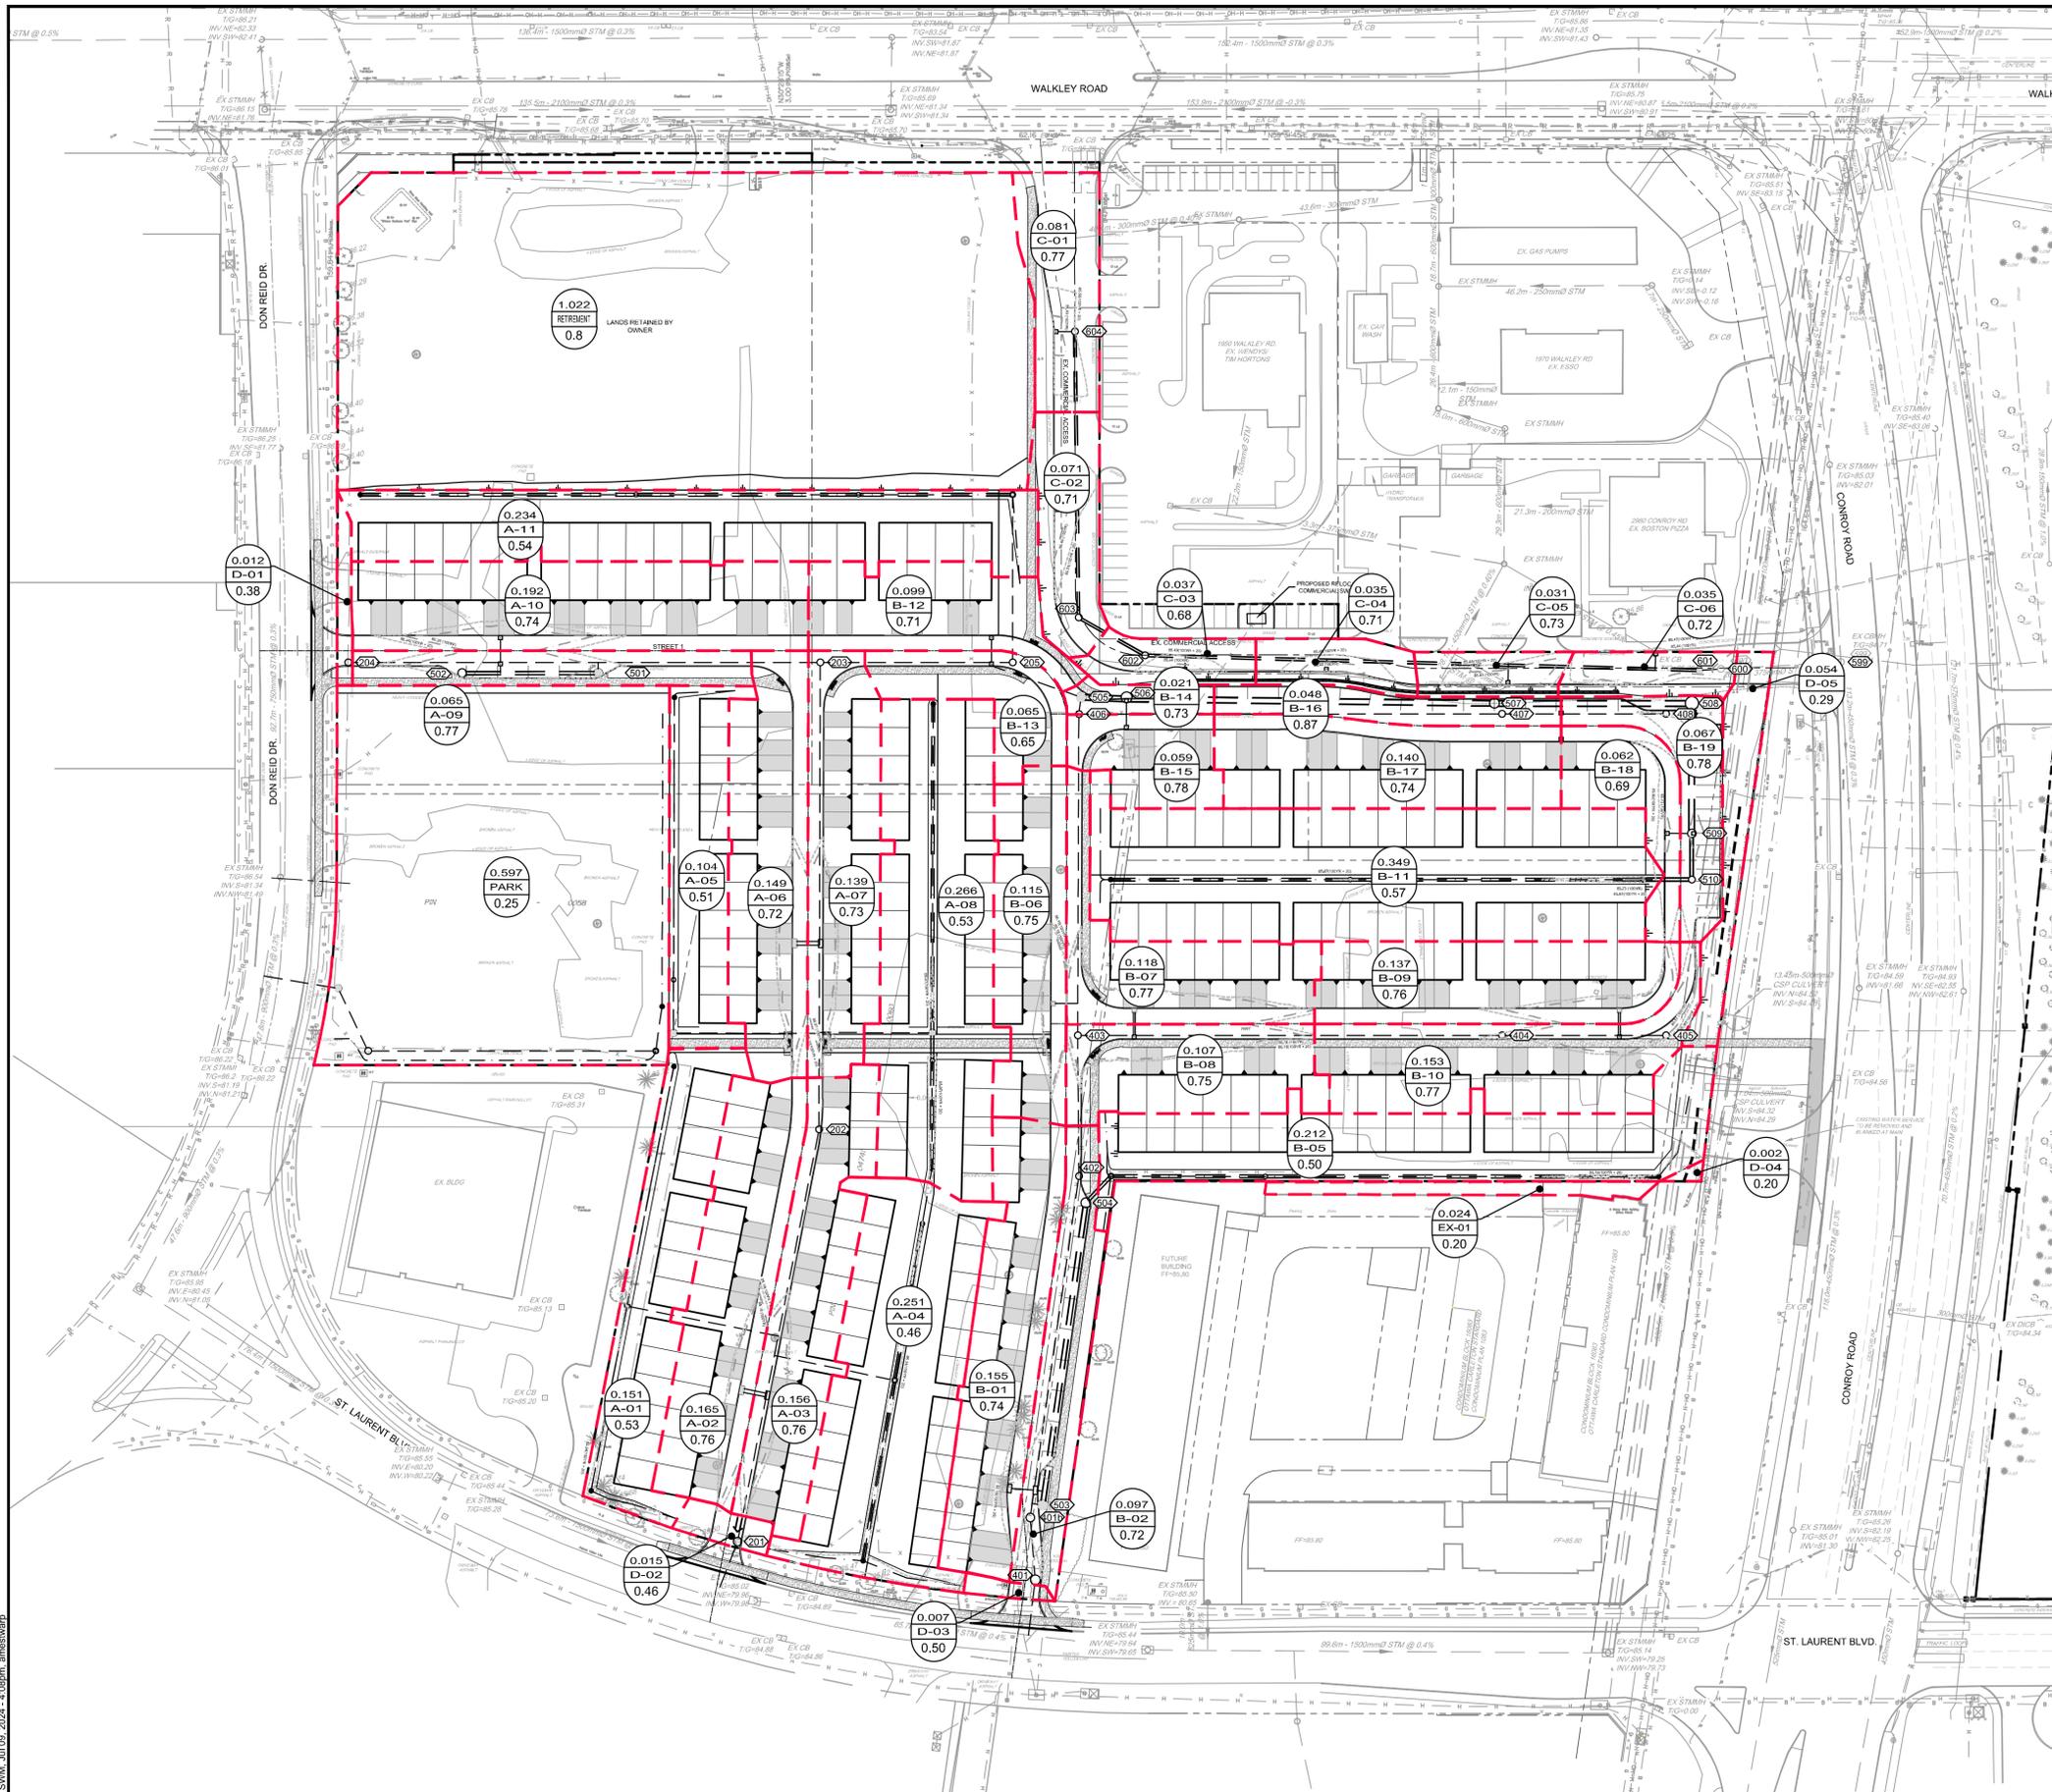

- LEGEND**
- PROPERTY LINE
  - MISC LEGAL LINE (EASEMENT, PROPERTY LINES) REFER TO LEGAL PLAN FOR DETAILS
  - TACTILE WALKING SURFACE INDICATOR (TWSI) PER CITY DETAIL SCT.3
  - PROPOSED SIDEWALK
  - PROPOSED RETAINING WALL
  - PROPOSED RAILING
  - DC --- PROPOSED CURB
  - DC --- PROPOSED DEPRESSED CURB
  - PROPOSED ASPHALT DRIVEWAY
  - SWALE c/w SUBDRAIN AND DIRECTION OF FLOW
  - TERRACING 3:1 SLOPE MAX (UNLESS OTHERWISE INDICATED)
  - STORM SEWER DRAINAGE AREA BOUNDARY
  - 0.085 A-16 0.78 --- DRAINAGE AREA (ha)
  - 0.085 A-16 0.78 --- DRAINAGE AREA ID
  - --- RUNOFF COEFFICIENT
  - --- PROPOSED STORM SEWER AND MANHOLE
  - --- PROPOSED STORM MANHOLE C/W ICD
  - PROPOSED STORMWATER MANAGEMENT PIPE
  - --- PROPOSED CATCHBASIN MANHOLE
  - --- PROPOSED CATCHBASIN MANHOLE C/W ICD
  - --- PROPOSED CATCHBASIN
  - --- PROPOSED CATCHBASIN C/W ICD
  - --- PROPOSED CATCHBASIN
  - --- PROPOSED CATCHBASIN C/W ICD
  - --- PROPOSED LANDSCAPE DRAIN
  - 1:100 YEAR PONDING AREA AND ELEVATION
  - 1:100 YEAR (+20%) PONDING AREA AND ELEVATION
  - MAJOR OVERLAND FLOW ROUTE
  - --- EXISTING STORM MANHOLE & SEWER
  - --- EXISTING CATCHBASIN
  - EXISTING DITCH CENTRELINE


**NOTE:**  
 THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

**CLARIDGE HOMES**  
 505 PRESTON STREET,  
 2ND FLOOR  
 OTTAWA, ONTARIO  
 K1S 4N7.



**NOT FOR CONSTRUCTION**

No.	REVISION	DATE	BY
6.	REVISED SITE PLAN	JULY 12/24	ARM
5.	REVISED PER CITY COMMENTS	JAN 31/24	ARM
4.	REVISED SITE PLAN	SEPT 29/23	ARM
3.	ISSUED FOR UTILITY COORDINATION	SEPT 20/23	ARM
2.	REVISED PER CITY COMMENTS	MAY 26/23	GJM
1.	ISSUED IN SUPPORT OF DEVELOPMENT APPLICATIONS	NOV 01/22	GJM



DESIGN	FOR REVIEW ONLY
ARM	
CHECKED	
GJM	
DRAWN	
CJF/ARM	
CHECKED	
ARM	
APPROVED	
GJM	

ISSUED FOR REVIEW


ISSUED FOR REVIEW

**NOVATECH**  
 Engineers, Planners & Landscape Architects  
 Suite 200, 240 Michael Cowpland Drive  
 Ottawa, Ontario, Canada K2M 1P6  
 Telephone (613) 254-9643  
 Facsimile (613) 254-5867  
 Website www.novatech-eng.com

LOCATION CITY OF OTTAWA 2510 ST. LAURENT BOULEVARD	
DRAWING NAME <b>STORMWATER MANAGEMENT PLAN</b>	PROJECT No. 122040
	REV REV#6
	DRAWING No. 122040-SWM

M:\2024\122040\CAD\Civil\122040-SWM.dwg, SWM, Jul 09, 2024, 4:08pm, ameswarp

# WALKLEY ROAD

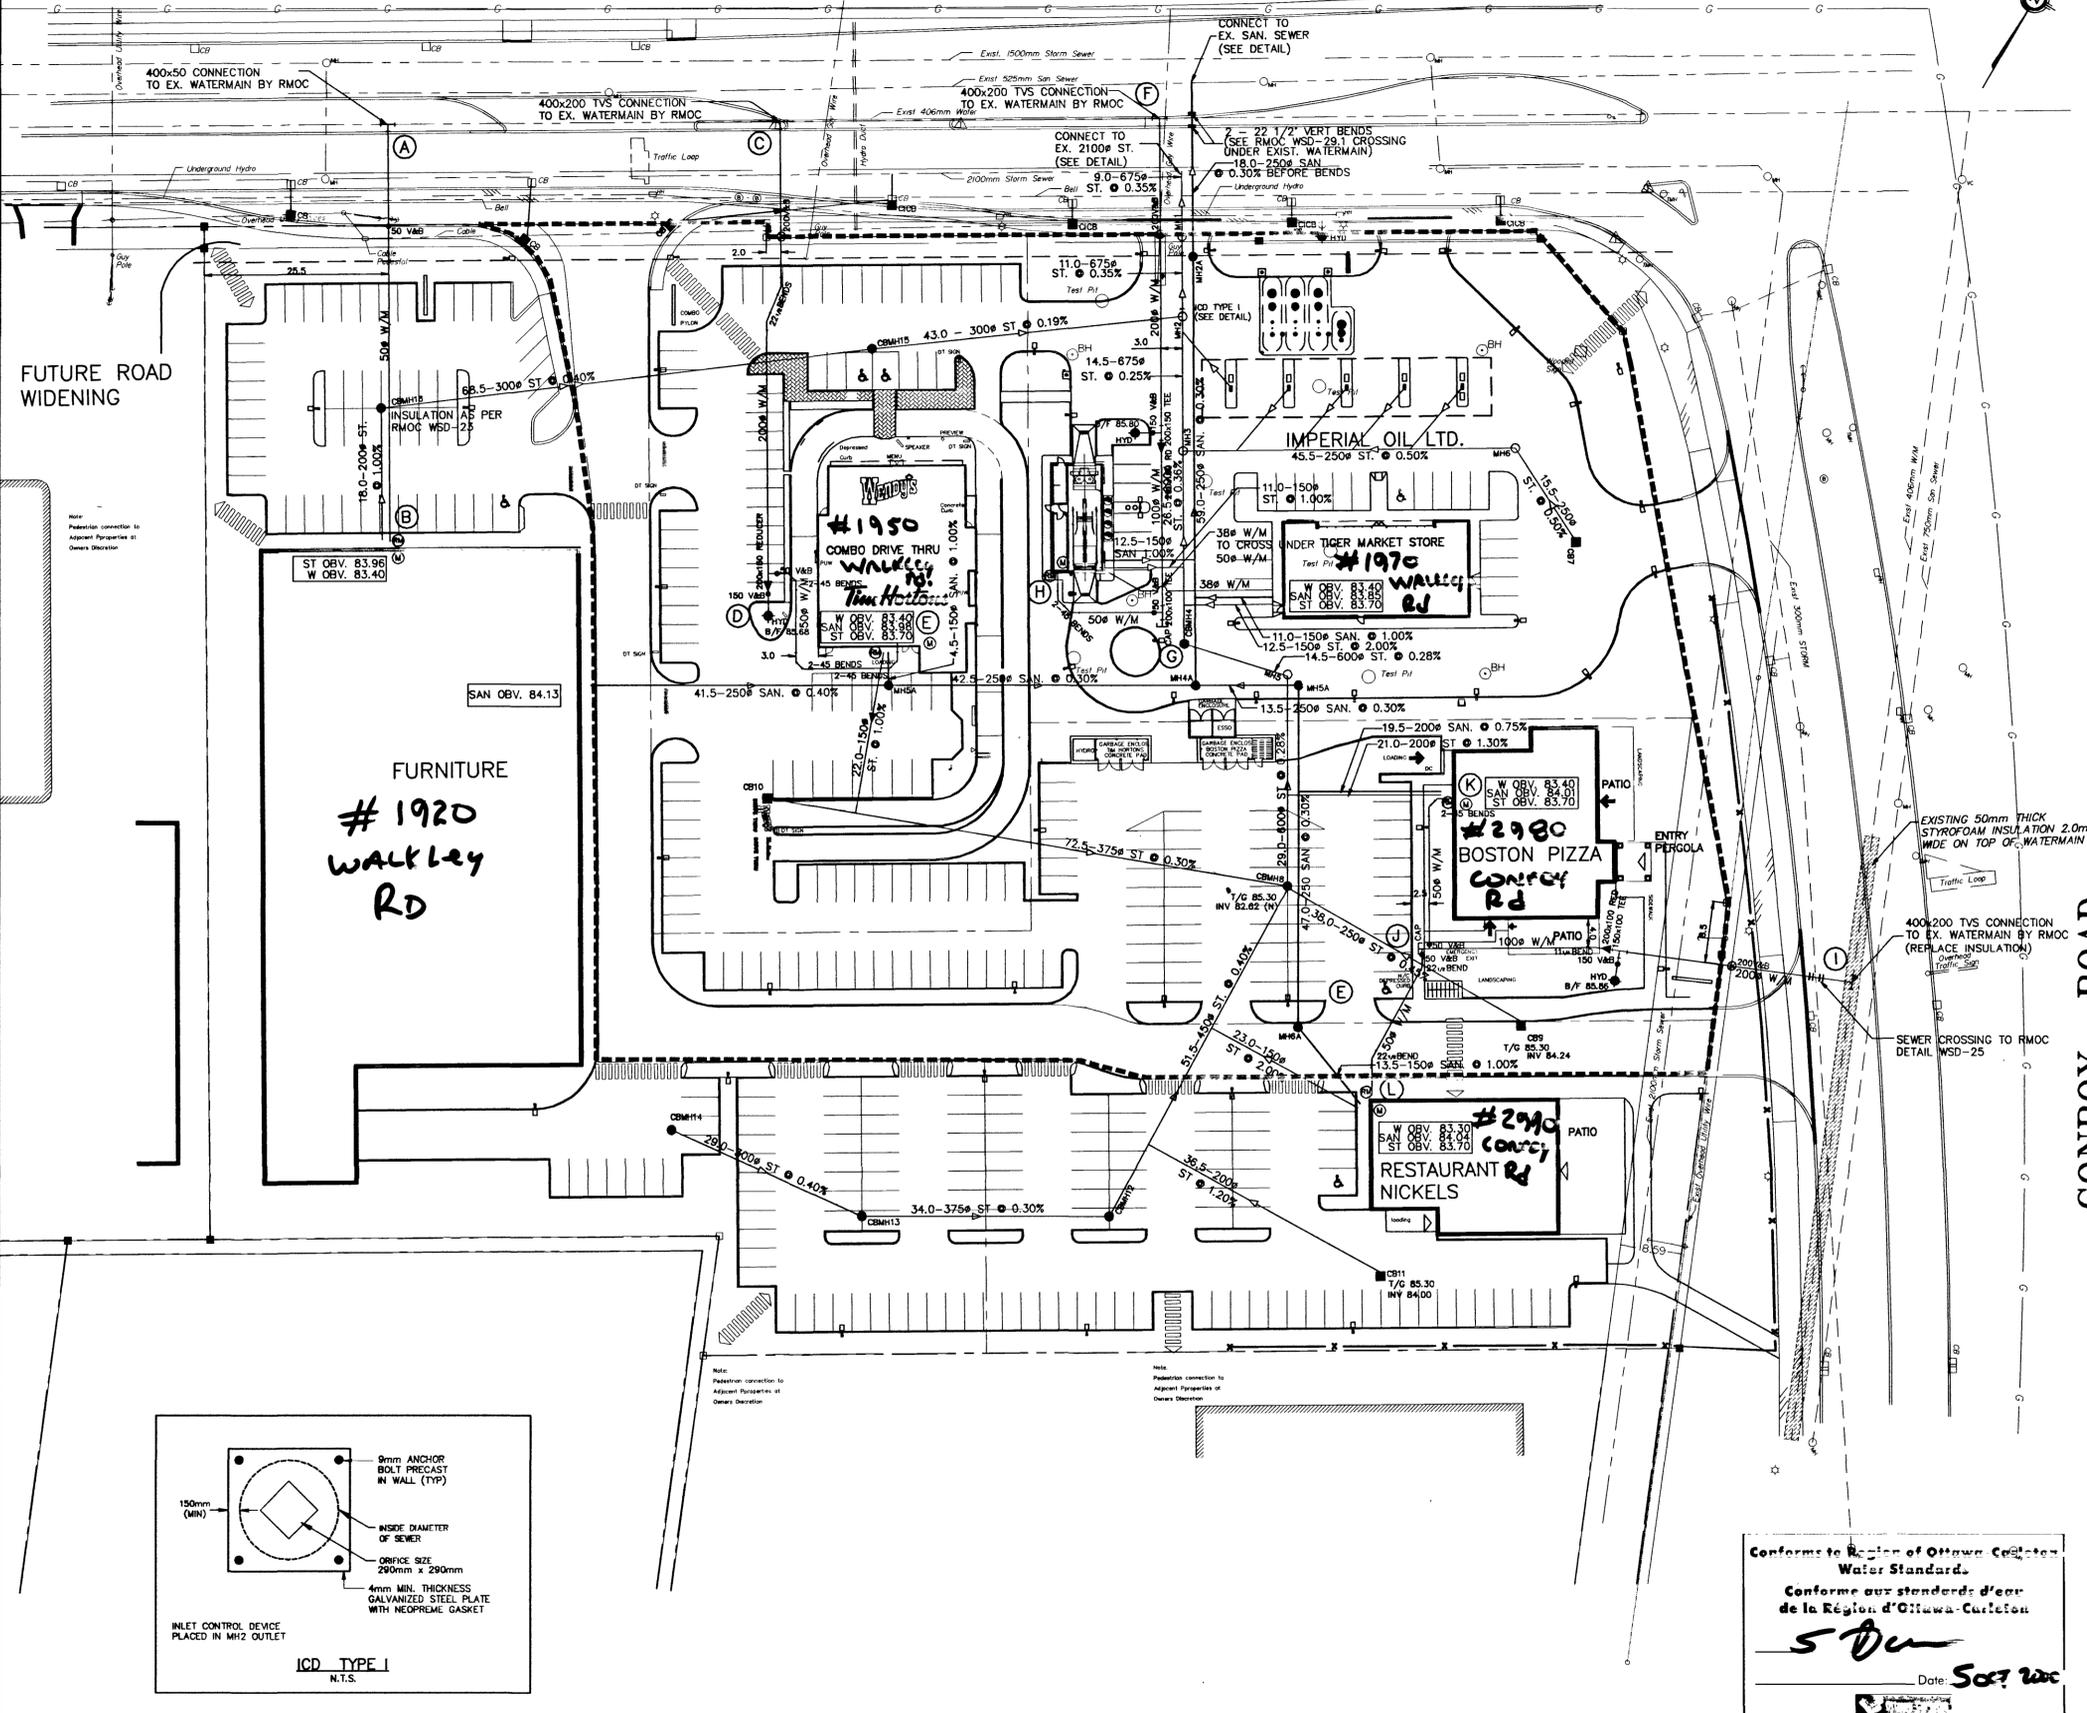


WATERMAIN SCHEDULE				
LOCATION		ELEVATIONS (m)		
STA.	DESCRIPTION	PROPOSED GRADE	TOP OF W/M	ASBUILT TOP OF W/M
A	0+000	400x50TVS	±86.00	±83.80
	0+014	50 V&B	85.90	83.50
	0+025	-	85.70	83.30
B	0+039	STORM SEWER CROSSING	85.31	82.91
	0+057	BUILDING ENTRANCE	85.80	83.40
C	0+000	400x200 TVS	±86.23	±83.80
	0+016	200 V&B	86.10	83.70
	0+023	22 1/2" BEND	85.76	83.36
	0+028	22 1/2" BEND	85.61	83.21
	0+034	STORM SEWER CROSSING	85.45	83.05
	0+050	-	85.80	83.20
D	0+063	50# W/M SERVICE	85.63	83.23
	0+065	200x150 REDUCER	85.63	83.23
E	0+000	50# W/M SERVICE	85.63	83.23
	0+003	45' BEND	85.69	83.29
	0+004.5	45' BEND	85.71	83.31
	0+016.5	45' BEND	85.60	83.20
	0+018	45' BEND	85.60	83.20
	0+028.5	45' BEND	85.70	83.30
	0+030	45' BEND	85.72	83.32
	0+032	BUILDING ENTRANCE	85.75	83.35
F	0+000	400x200 TVS	±86.00	±83.80
	0+016	200 V&B	85.85	83.32
	0+027.5	STORM SEWER CROSSING	85.72	83.32
	0+043	200x150 TEE	85.54	83.14
	0+045.5	200x100 REDUCER	85.54	83.14
	0+068	50# WATER SERVICE	85.39	82.99
	0+070	100# CAP	85.38	82.98
G	0+000	50# WATER SERVICE	85.39	82.99
	0+013	45' BEND	85.60	83.20
	0+015.5	45' BEND	85.75	83.35
H	0+019	BUILDING ENTRANCE	85.80	83.40
I	0+000	400x200 TVS	84.80	82.90
	0+004.5	STORM SEWER CROSSING	84.70	82.70
	0+017	200 V&B	85.48	83.08
	0+032	200x150 TEE	85.78	83.38
	0+034	200x100 REDUCER	85.78	83.38
	0+036	11 1/4" BEND	85.78	83.38
	0+059	50' WATER SERVICE	85.75	83.35
	0+060	50' WATER SERVICE	85.75	83.35
	0+061	100 # CAP	85.75	83.35
J	0+000	50# WATER SERVICE	85.75	83.35
	0+019.5	45' BEND	85.77	83.37
	0+021	45' BEND	85.77	83.37
K	0+023	BUILDING ENTRANCE	85.78	83.38
L	0+000	50# WATER SERVICE	85.75	83.35
	0+002.5	22 1/2" BEND	85.73	83.33
	0+017	22 1/2" BEND	85.55	83.15
	0+022.5	BUILDING ENTRANCE	85.70	83.30

CONROY ROAD

- LEGEND:**
- ☼ EXISTING LIGHT STANDARD
  - EXISTING UTILITY POLE
  - ☐ EXISTING HANDHOLE
  - EXISTING TRAFFIC MANHOLE
  - ⊕ EXISTING BELL MANHOLE
  - ☐ EXISTING CATCHBASIN
  - HYD ○ EXISTING HYDRANT
  - EXISTING MANHOLE
  - M12 PROPOSED STORM MANHOLE
  - CMH18 PROPOSED CATCHBASIN MANHOLE
  - CB1 PROPOSED CATCHBASIN
  - MS4 PROPOSED SANITARY MANHOLE
  - HYD ● B/F 85.90 PROPOSED HYDRANT C/W BOTTOM OF FLANGE
  - ⊕ PROPOSED WATER METER
  - ⊕ PROPOSED WATER REMOTE METER
  - H — EXISTING UNDERGROUND HYDRO
  - B — EXISTING BELL CABLE
  - T — EXISTING CATV CABLE
  - G — EXISTING GAS MAIN

- NOTE:**
- FOR SURFACE PONDING REFER TO DWG. 3305-LD-300
  - SEE DRAWING 3305-LD-100A FOR DETAILS, STORM AND SANITARY SCHEDULES.
  - REFER TO DRAWING 3268-T-03 FOR WIDENING DETAILS ON WALKLEY ROAD
  - REFER TO VINCE P. COLIZZA ARCHITECT DRAWING FOR SITE PLAN INFORMATION.
  - ALL ROAD CUTS IN WALKLEY ROAD AND CONROY ROAD TO BE REPAIRED WITH P.G. GRADE ASPHALT AND ALL ASPHALT RESTORATION WORK TO RMOCC REQUIREMENTS AND STANDARDS.

PHASE I TO INCLUDE SERVICING FOR IMPERIAL OIL, WENDY'S AND TIM HORTONS. ALL WATER AND SEWER SERVICING TO BE CAPPED AT LIMIT OF PHASE 1 CONSTRUCTION LINE FOR FUTURE EXTENSIONS.

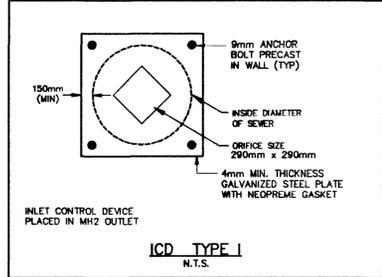

Conforms to Region of Ottawa-Carleton Water Standards.  
 Conforme aux standards d'eau de la Région d'Ottawa-Carleton  
 S. J. Moffatt  
 Date: Sept 2000

5528

THE LOCATION OF UTILITIES IS APPROXIMATE ONLY, AND THE EXACT LOCATION SHOULD BE DETERMINED BY CONSULTING THE MUNICIPAL AUTHORITIES AND UTILITY COMPANIES CONCERNED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ADEQUATE PROTECTION FROM DAMAGE DURING CONSTRUCTION.

NO.	REVISIONS	DATE	INITIAL
8.	REVISED AS PER RMOCC COMMENTS	00/10/02	J.I.M.
7.	REVISED WATERMAIN AS PER COMMENTS	00/09/19	J.I.M.



NO.	REVISIONS	DATE	INITIAL
6.	REVISED SANITARY CONNECTION WALKLEY RD.	00/09/11	J.I.M.
5.	REVISED AS PER RMOCC COMMENTS	00/09/06	J.I.M.
4.	REVISED PHASE 1 LIMITS	00/08/25	J.I.M.
3.	REVISED AS PER CITY COMMENTS	00/08/21	J.I.M.
2.	REVISED AS PER CITY COMMENTS	00/08/04	J.I.M.
1.	REVISED AS PER JUNE SITE PLAN	00/06/07	J.I.M.
0.	ISSUED FOR SITE PLAN APPROVAL	00/02/08	J.I.M.

1374441 ONTARIO INC.  
 COMMERCIAL SITE  
 WALKLEY - CONROY  
 GENERAL PLAN OF SERVICES


**Cumming Cockburn Limited**  
 Consulting Engineers and Planners  
 Ottawa, Kingston, Toronto, Waterloo, London

SCALE: 1:500  
 DRAWN BY: D.D.  
 DESIGN: J.I.M.  
 CHECKED: J.I.M.  
 DATE: FEB 2000  
 DRWS No.: 3305-LD-100

**From:** Bramah, Bruce <[bruce.bramah@ottawa.ca](mailto:bruce.bramah@ottawa.ca)>  
**Sent:** Thursday, September 21, 2023 11:07 AM  
**To:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

Hi Anthony,

Asset Management would prefer a connection to the 450mm rather than the 2100mm trunk on Conroy. Please see the 100yr HGL for the 450mm pipe below:

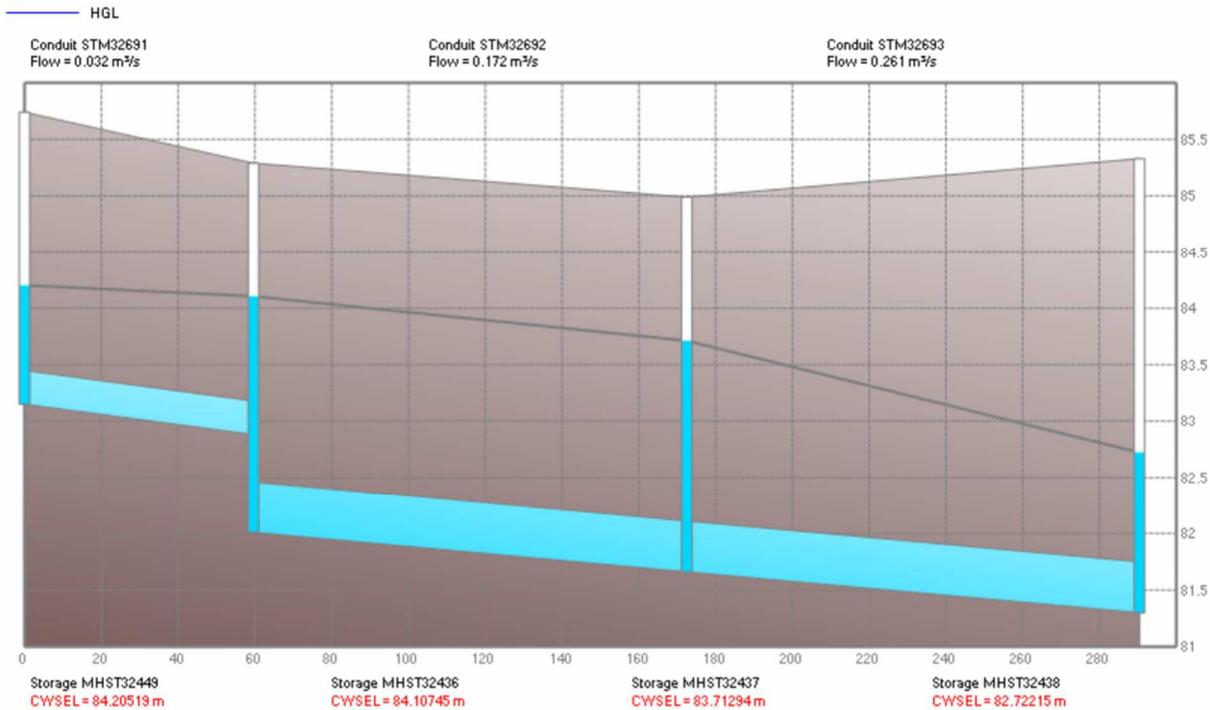

Thanks,

--

**Bruce Bramah, P.Eng**  
Project Manager  
Planning, Real Estate and Economic Development Department  
Development Review - South Branch  
City of Ottawa | Ville d'Ottawa  
110 Laurier Avenue West Ottawa, ON | 110, avenue. Laurier Ouest. Ottawa (Ontario) K1P 1J1  
613.580.2424 ext./poste 29686, [Bruce.Bramah@ottawa.ca](mailto:Bruce.Bramah@ottawa.ca)

**From:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>  
**Sent:** September 20, 2023 9:23 AM  
**To:** Bramah, Bruce <[bruce.bramah@ottawa.ca](mailto:bruce.bramah@ottawa.ca)>  
**Subject:** RE: 2510-St. Laurent Blvd - Confirmation of Flow

Thanks Bruce.

**CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.**  
**ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.**

**Anthony Mestwarp, P.Eng., Project Manager | Land Development Engineering**

**NOVATECH**

Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext. 216


The information contained in this email message is confidential and is for exclusive use of the addressee.

**From:** Bramah, Bruce <[bruce.bramah@ottawa.ca](mailto:bruce.bramah@ottawa.ca)>  
**Sent:** Tuesday, September 19, 2023 1:39 PM  
**To:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>  
**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

Hi Anthony,

I am still waiting for the HGL connection at the road. Please see the park connection below:

The 5 year HGL remains in the pipe. Below is the 100 year.

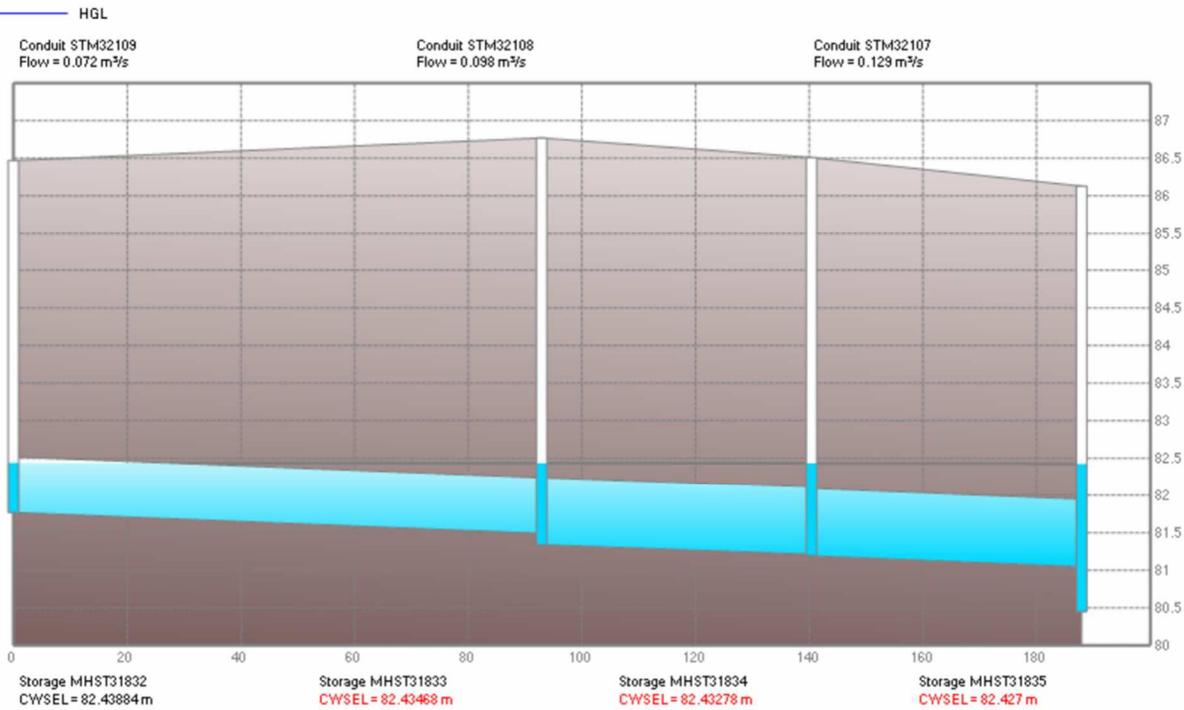

I will forward the remaining information once provided.

Thanks,

--

**Bruce Bramah, P.Eng**

Project Manager

Planning, Real Estate and Economic Development Department

Development Review - South Branch

City of Ottawa | Ville d'Ottawa

110 Laurier Avenue West Ottawa, ON | 110, avenue. Laurier Ouest. Ottawa (Ontario) K1P 1J1

613.580.2424 ext./poste 29686, [Bruce.Bramah@ottawa.ca](mailto:Bruce.Bramah@ottawa.ca)

**From:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>  
**Sent:** September 19, 2023 1:28 PM  
**To:** Bramah, Bruce <[bruce.bramah@ottawa.ca](mailto:bruce.bramah@ottawa.ca)>  
**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

**CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.**  
**ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.**

Hi Bruce,

I hope you are doing well.  
I am following up on the HGL request. Can you please provide a status.

Regards,

**Anthony Mestwarp**, P.Eng., Project Manager | Land Development Engineering

**NOVATECH**

Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext. 216

The information contained in this email message is confidential and is for exclusive use of the addressee.

**From:** Anthony Mestwarp  
**Sent:** Thursday, September 7, 2023 5:11 PM  
**To:** [bruce.bramah@ottawa.ca](mailto:bruce.bramah@ottawa.ca)  
**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>; Vahid Mehdipour <[v.mehdipour@novatech-eng.com](mailto:v.mehdipour@novatech-eng.com)>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

Hi Bruce,

Can you please provide the stormwater HGL for the 100 and 5-yr storm events commercial road connection as indicated below, and on the attached?

Additionally would you be able to provide the HGL boundary condition for the proposed park connection? The park connection between MHST31833 and MHST31832 as depicted on the attached?

Thanks,

**Anthony Mestwarp**, P.Eng., Project Manager | Land Development Engineering

**NOVATECH**

Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext. 216

The information contained in this email message is confidential and is for exclusive use of the addressee.

**From:** Anthony Mestwarp  
**Sent:** Wednesday, July 12, 2023 10:17 AM  
**To:** [bruce.bramah@ottawa.ca](mailto:bruce.bramah@ottawa.ca)  
**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

Hi Bruce,

In addition to the water calculation update can you also provide the existing HGL in the 2100 storm sewer running along Conroy road as highlighted in the attached.

We would like to explore the option of providing an independent storm sewer system for the existing commercial roadway connecting to the 2100 storm sewer. This will eliminate the need to convey the commercial road flows through the proposed Condo system, and avoid any future issues if the client ever decided to sever the Commercial road from the proposed Condo lands.

The connection would be between manholes MHST31492 AND MHST31839, as depicted in the attached.  
Please let me know if you require any further information.

Regards,

**Anthony Mestwarp**, P.Eng., Project Engineer | Land Development Engineering  
**NOVATECH**

Engineers, Planners & Landscape Architects


240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext. 216

The information contained in this email message is confidential and is for exclusive use of the addressee.

**From:** Sharif, Golam <[sharif.sharif@ottawa.ca](mailto:sharif.sharif@ottawa.ca)>  
**Sent:** Wednesday, October 26, 2022 9:42 AM  
**To:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>  
**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Greg Winters <[G.Winters@novatech-eng.com](mailto:G.Winters@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>; Vahid Mehdipour <[v.mehdipour@novatech-eng.com](mailto:v.mehdipour@novatech-eng.com)>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

Hi Anthony,

Here is the HGL information:

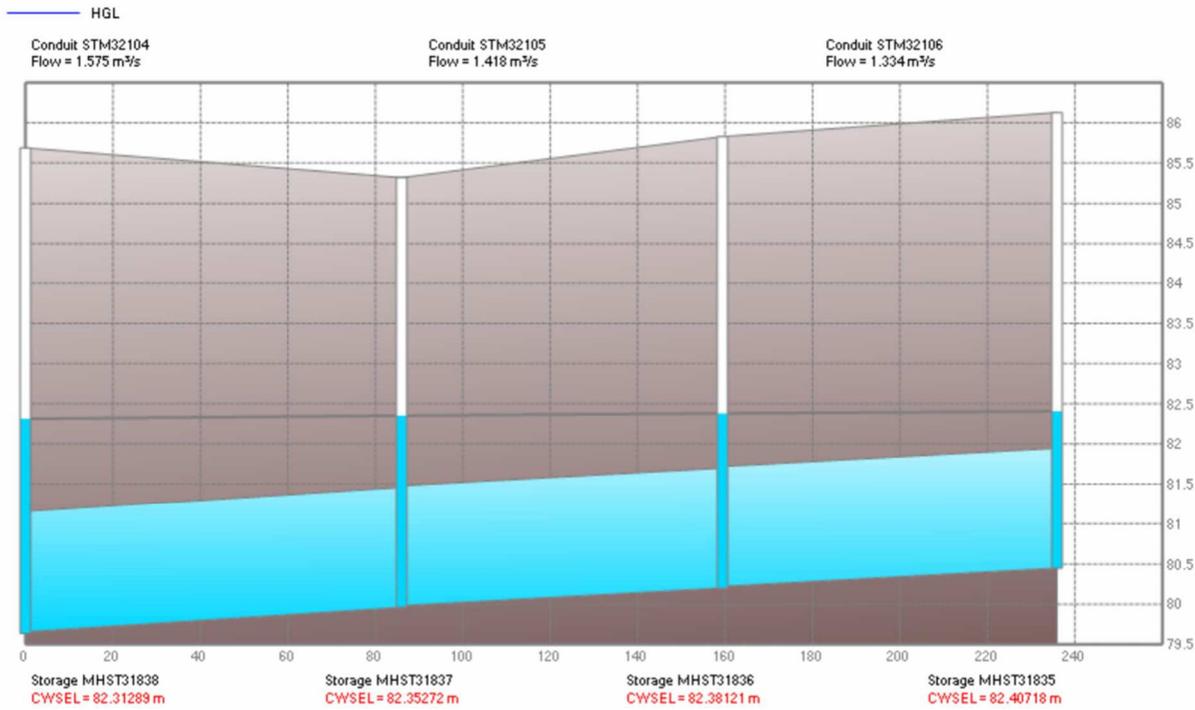

Regards,

Sharif

**From:** Anthony Mestwarp <a.mestwarp@novatech-eng.com>

**Sent:** October 20, 2022 10:45 AM

**To:** Sharif, Golam <sharif.sharif@ottawa.ca>

**Cc:** Greg MacDonald <g.Macdonald@novatech-eng.com>; Greg Winters <g.winters@novatech-eng.com>; Curtis Ferguson <c.ferguson@novatech-eng.com>; Vahid Mehdipour <v.mehdipour@novatech-eng.com>

**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

**CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.**  
**ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.**

Hi Sharif,

Thanks for getting back to me. Did the STM team comment on the elevation of the 100-yr grade line in the STM sewer St. Laurent Blvd (e.g. is it above the obvert of the pipe). We are looking to confirm the downstream conditions for our SWM model.

Thanks,

**Anthony Mestwarp, P.Eng.**, Project Engineer | Land Development Engineering

**NOVATECH** Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext. 216 | Fax: 613.254.5867

The information contained in this email message is confidential and is for exclusive use of the addressee.

**From:** Sharif, Golam <sharif.sharif@ottawa.ca>

**Sent:** Wednesday, October 19, 2022 11:25 AM

**To:** Anthony Mestwarp <a.mestwarp@novatech-eng.com>

**Cc:** Greg MacDonald <g.Macdonald@novatech-eng.com>; Greg Winters <G.Winters@novatech-eng.com>; Curtis Ferguson

[<c.ferguson@novatech-eng.com>](mailto:c.ferguson@novatech-eng.com)

**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

Hi Anthony,

I will follow up with the water boundary condition request. Usually, the water group requires 2 weeks, which will be end of this week.

By the way, I have received the confirmation about the sewers and the proposed sanitary and storm flows are acceptable.

Sharif.

**From:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>

**Sent:** October 19, 2022 10:43 AM

**To:** Sharif, Golam <[sharif.sharif@ottawa.ca](mailto:sharif.sharif@ottawa.ca)>

**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Greg Winters <[g.winters@novatech-eng.com](mailto:g.winters@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>

**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

**CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.**

**ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.**

Hi Sharif,

Following-up the client is really pushing on this one. Do you have an approximate timeline for the water boundary conditions?

Thanks,

**Anthony Mestwarp, P.Eng.**, Project Engineer | Land Development Engineering

**NOVATECH** Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext. 216 | Fax: 613.254.5867

The information contained in this email message is confidential and is for exclusive use of the addressee.

**From:** Sharif, Golam <[sharif.sharif@ottawa.ca](mailto:sharif.sharif@ottawa.ca)>

**Sent:** Monday, October 17, 2022 11:05 AM

**To:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>

**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Greg Winters <[G.Winters@novatech-eng.com](mailto:G.Winters@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>

**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

Hi Anthony,

Sorry, my bad I sent out the request for water boundary condition but never sent out for the sewers capacity! It was just buried under all the emails! I have sent out the request right now. I will follow up as soon as I get something.

Thanks.

Sharif

**From:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>  
**Sent:** October 17, 2022 10:46 AM  
**To:** Sharif, Golam <[sharif.sharif@ottawa.ca](mailto:sharif.sharif@ottawa.ca)>  
**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Greg Winters <[g.winters@novatech-eng.com](mailto:g.winters@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flows

**CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.**  
**ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.**

Hi Sharif,

Can you provide a status update regarding the HGL in the surrounding sewers?

Thanks,

**Anthony Mestwarp, P.Eng.**, Project Engineer | Land Development Engineering

**NOVATECH** Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext. 216 | Fax: 613.254.5867

The information contained in this email message is confidential and is for exclusive use of the addressee.

**From:** Anthony Mestwarp  
**Sent:** Tuesday, September 20, 2022 3:00 PM  
**To:** Sharif, Golam <[sharif.sharif@ottawa.ca](mailto:sharif.sharif@ottawa.ca)>  
**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Greg Winters <[G.Winters@novatech-eng.com](mailto:G.Winters@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flows

Thanks Sharif,

We have already requested road profiles from the City for the surrounding roadways to verify the connection inverts.

Regards,

**Anthony Mestwarp, P.Eng.**, Project Engineer | Land Development Engineering

**NOVATECH** Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext. 216 | Fax: 613.254.5867

The information contained in this email message is confidential and is for exclusive use of the addressee.

**From:** Sharif, Golam <[sharif.sharif@ottawa.ca](mailto:sharif.sharif@ottawa.ca)>  
**Sent:** Tuesday, September 20, 2022 9:34 AM  
**To:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>  
**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Greg Winters <[G.Winters@novatech-eng.com](mailto:G.Winters@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flows

Good morning, Anthony,

Please contact our Geoinformation Center for the as built drawings to verify the inverts. I will coordinate with our modelling group to find out about the capacity.

I do not know the RVCA reviewer on this project. However, you could contact Eric Lalande ([eric.lalande@rvca.ca](mailto:eric.lalande@rvca.ca)) at RVCA to find out about it. Thanks.

Sharif

**From:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>

**Sent:** September 19, 2022 3:12 PM

**To:** Sharif, Golam <[sharif.sharif@ottawa.ca](mailto:sharif.sharif@ottawa.ca)>

**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Greg Winters <[g.winters@novatech-eng.com](mailto:g.winters@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>

**Subject:** 2510 St. Laurent Blvd - Confirmation of Flows

**CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.**  
**ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.**

I am working on the project located at 2510 St. Laurent Blvd. Can you please confirm the existing STM sewer HGL in between manholes : MHST31836 – MHST31838 as shown on the attached GeoOttawa stm connection PDF.

The pre-con notes also recommended that we should verify capacities for the development with the City prior to submitting the design for review, please refer to the below:.

**Storm:**

The proposed development will have the STM flows controlled to the 5-year storm, with a Pre-existing coefficient of **0.43**. Resulting in an allowable stm flow from the site of **490.40 L/s**.

The proposed condo development will be controlled to **432.02L/s**, and the remaining allowable release rate of **58.38 L/s** will be reserved for the future retirement residence proposed in the North-West corner of the site which will have its own individual controls.

The Pre-existing 100-yr flow was approximately **999.1L/s**. The development will be serviced by two (2) connections to the existing 1500 stm sewer within the St. Laurent Right-of-way.

**Sanitary:**

The proposed sanitary servicing for the site will be provided by 2 connections to the existing 375mm sanitary sewer within the St. Laurent Right-of-way. The overall sanitary flow from the development will be **8.19L/s**.

Please refer to the proposed sanitary connection figure for the proposed connection locations.

Can you please confirm that there is capacity for the proposed development.

Could you also please provide the contact information for the reviewer at RVCA for this project so that we can discuss the Quality control requirements for the site.

Thanks,

**Anthony Mestwarp, P.Eng.**, Project Engineer | Land Development Engineering

**NOVATECH** Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext. 216 | Fax: 613.254.5867

The information contained in this email message is confidential and is for exclusive use of the addressee.

,

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

,

**From:** Sharif, Golam <sharif.sharif@ottawa.ca>

**Sent:** Monday, November 7, 2022 3:53 PM

**To:** Anthony Mestwarp <a.mestwarp@novatech-eng.com>

**Cc:** Greg MacDonald <g.Macdonald@novatech-eng.com>; Curtis Ferguson <c.ferguson@novatech-eng.com>

**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

Hi Anthony,

No concern with the 597 L/s discharge. Thanks.

Sharif

**From:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>  
**Sent:** November 04, 2022 2:02 PM  
**To:** Sharif, Golam <[sharif.sharif@ottawa.ca](mailto:sharif.sharif@ottawa.ca)>  
**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>; Curtis Ferguson <[c.ferguson@novatech-eng.com](mailto:c.ferguson@novatech-eng.com)>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of Flow

**CAUTION:** This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

**ATTENTION :** Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Sharif,

We have just recently sent the first submission to the City (Vincent from Claridge sent the submission), which includes detailed calculations.

The overall site is a combination of lands namely: 1890, 1900 & 1920 Walkley Road, 2502 & 2510 St. Laurent Boulevard, 2990 & 3000 Conroy Road, and 2425 Don Reid Drive, for a total area of +/- 5.9 hectares.

Refer to the below for an explanation of the calculation which is also summarized in the recently submitted report:

*"The allowable release rate for the site was calculated using PCSWMM using the SCS analysis method. The existing site has an area of +/-5.9 ha and is undeveloped. As noted within the Geotechnical report, the soils on the subject site consist of Silty Clay. The time of concentration for the site was calculated utilizing the Uplands method. A summary of the pre-development model parameters is provided below:*

**Table 6.1: Pre-Development Parameters**

<b>Design Parameter</b>	<b>Value</b>
Drainage Area	5.9 ha
Time of Concentration	17 min
Hydrologic Soil Group	D
Weighted CN	86
Impervious Percentage	39%
Equivalent Run-off Coefficient	0.47

*Based on the above, the pre-development Runoff Coefficient is less than 0.5 and the allowable release rate for the site was calculated to be 597 L/s based on the PCSWMM model results for the 5-year storm event.*

I hopes this helps provide clarification.

Regards,

**Anthony Mestwarp, P.Eng.**, Project Engineer | Land Development Engineering

**NOVATECH** Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext. 216 | Fax: 613.254.5867

The information contained in this email message is confidential and is for exclusive use of the addressee.

**From:** Eric Lalande <eric.lalande@rvca.ca>  
**Sent:** Tuesday, October 4, 2022 4:14 PM  
**To:** Anthony Mestwarp <a.mestwarp@novatech-eng.com>  
**Cc:** Greg MacDonald <g.Macdonald@novatech-eng.com>; Jamie Batchelor <jamie.batchelor@rvca.ca>  
**Subject:** RE: 2510 St. Laurent Blvd - Confirmation of quality controls

Hi Anthony,

The RVCA typically requires enhanced water quality control (80% TSS removal) for all projects, without further design details I would suggest this will be the requirement from our offices, I would suggest when you have a site plan available, please reach out to Jamie Batchelor, Planner from our office, as he will be the point person on the file if/when it is to be submitted for rezoning/site plan.

Cheers,

**Eric Lalande, MCIP, RPP**  
Planner, RVCA  
613-692-3571 x1137

**From:** Anthony Mestwarp <[a.mestwarp@novatech-eng.com](mailto:a.mestwarp@novatech-eng.com)>  
**Sent:** Tuesday, September 20, 2022 4:50 PM  
**To:** Eric Lalande <[eric.lalande@rvca.ca](mailto:eric.lalande@rvca.ca)>  
**Cc:** Greg MacDonald <[g.Macdonald@novatech-eng.com](mailto:g.Macdonald@novatech-eng.com)>  
**Subject:** 2510 St. Laurent Blvd - Confirmation of quality controls

Hi Eric,

I am working on the project located at 2510 St. Laurent Blvd within the RVCA boundary.

It was noted in the Pre-Con minutes that we should contact the RVCA to confirm the Quality control requirements for the site. The site is Bound by Walkley Road to the North, Conroy Road to the East, St. Laurent Boulevard to the South, and Don Reid Drive to the West.

I have included a copy of the legal plan outlining the limits of the site for your reference.

Can you please advise on the quality control requirements for the site? Please let me know if you require additional information.

Thanks,

**Anthony Mestwarp, P.Eng.**, Project Engineer | Land Development Engineering

**NOVATECH** Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext. 216 | Fax: 613.254.5867

The information contained in this email message is confidential and is for exclusive use of the addressee.



**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION  
BASED ON THE RATIONAL RAINFALL METHOD  
BASED ON A FINE PARTICLE SIZE DISTRIBUTION**



**Project Name:** Walkley-Conroy Project  
**Location:** Ottawa, ON  
**OGS #:** OGS 201

**Engineer:** NOVATECH  
**Contact:** Vahid Mehdipour  
**Report Date:** 5-Oct-23

**Area** 1.859 ha  
**Weighted C** 0.62  
**CDS Model** 2025

**Rainfall Station #** 215  
**Particle Size Distribution** FINE  
**CDS Treatment Capacity** 45 l/s

<u>Rainfall Intensity<sup>1</sup></u> <u>(mm/hr)</u>	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate</u> <u>(l/s)</u>	<u>Treated Flowrate (l/s)</u>	<u>Operating Rate (%)</u>	<u>Removal Efficiency (%)</u>	<u>Incremental Removal (%)</u>
0.5	9.2%	9.2%	1.6	1.6	3.5	97.8	9.0
1.0	10.6%	19.8%	3.2	3.2	7.1	96.8	10.3
1.5	9.9%	29.7%	4.8	4.8	10.6	95.8	9.5
2.0	8.4%	38.1%	6.4	6.4	14.1	94.8	7.9
2.5	7.7%	45.8%	8.0	8.0	17.7	93.8	7.2
3.0	5.9%	51.7%	9.6	9.6	21.2	92.8	5.5
3.5	4.4%	56.1%	11.2	11.2	24.7	91.8	4.0
4.0	4.7%	60.7%	12.8	12.8	28.3	90.7	4.2
4.5	3.3%	64.0%	14.4	14.4	31.8	89.7	3.0
5.0	3.0%	67.1%	16.0	16.0	35.4	88.7	2.7
6.0	5.4%	72.4%	19.2	19.2	42.4	86.7	4.7
7.0	4.4%	76.8%	22.4	22.4	49.5	84.7	3.7
8.0	3.5%	80.3%	25.6	25.6	56.6	82.6	2.9
9.0	2.8%	83.2%	28.8	28.8	63.6	80.6	2.3
10.0	2.2%	85.3%	32.0	32.0	70.7	78.6	1.7
15.0	7.0%	92.3%	48.1	45.3	100.0	66.2	4.6
20.0	4.5%	96.9%	64.1	45.3	100.0	49.6	2.3
25.0	1.4%	98.3%	80.1	45.3	100.0	39.7	0.6
30.0	0.7%	99.0%	96.1	45.3	100.0	33.1	0.2
35.0	0.5%	99.5%	112.1	45.3	100.0	28.4	0.1
40.0	0.5%	100.0%	128.2	45.3	100.0	24.8	0.1
45.0	0.0%	100.0%	144.2	45.3	100.0	22.1	0.0
50.0	0.0%	100.0%	160.2	45.3	100.0	19.9	0.0

86.5

Removal Efficiency Adjustment<sup>2</sup> = 6.5%  
**Predicted Net Annual Load Removal Efficiency = 80%**  
**Predicted Annual Rainfall Treated = 97%**


- 1 - Based on 42 years of hourly rainfall data from Canadian Station 6105976, Ottawa ON
- 2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.
- 3 - CDS efficiency based on testing conducted at the University of Central Florida.
- 4 - CDS design and scaling based on original manufacturer model and product specifications.

## CDS PMSU2025-5-C DESIGN NOTES


THE STANDARD CDS PMSU2025-5-C CONFIGURATION IS SHOWN. ALTERNATE CONFIGURATIONS ARE AVAILABLE AND ARE LISTED BELOW. SOME CONFIGURATIONS MAY BE COMBINED TO SUIT SITE REQUIREMENTS.

### CONFIGURATION DESCRIPTION


- GRATED INLET ONLY (NO INLET PIPE)
- GRATED INLET WITH INLET PIPE OR PIPES
- CURB INLET ONLY (NO INLET PIPE)
- CURB INLET WITH INLET PIPE OR PIPES
- CUSTOMIZABLE SUMP DEPTH AVAILABLE
- ANTI-FLOTATION DESIGN AVAILABLE UPON REQUEST

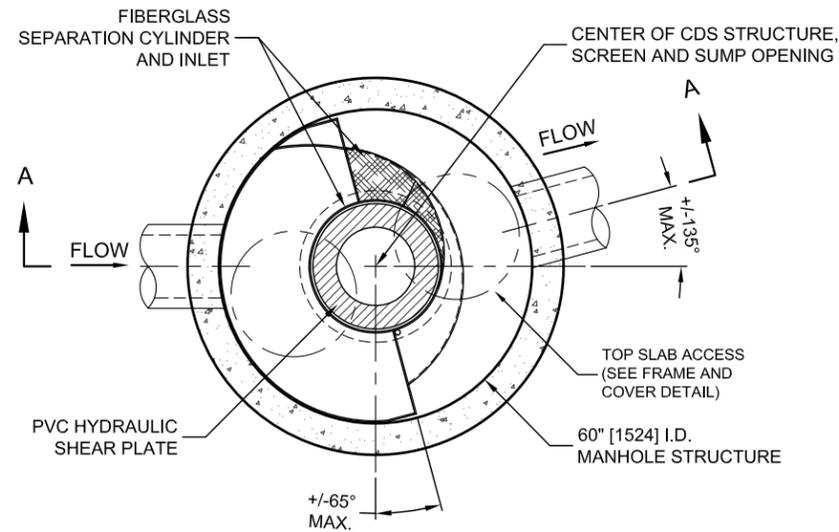

**PLAN VIEW B-B**  
N.T.S.

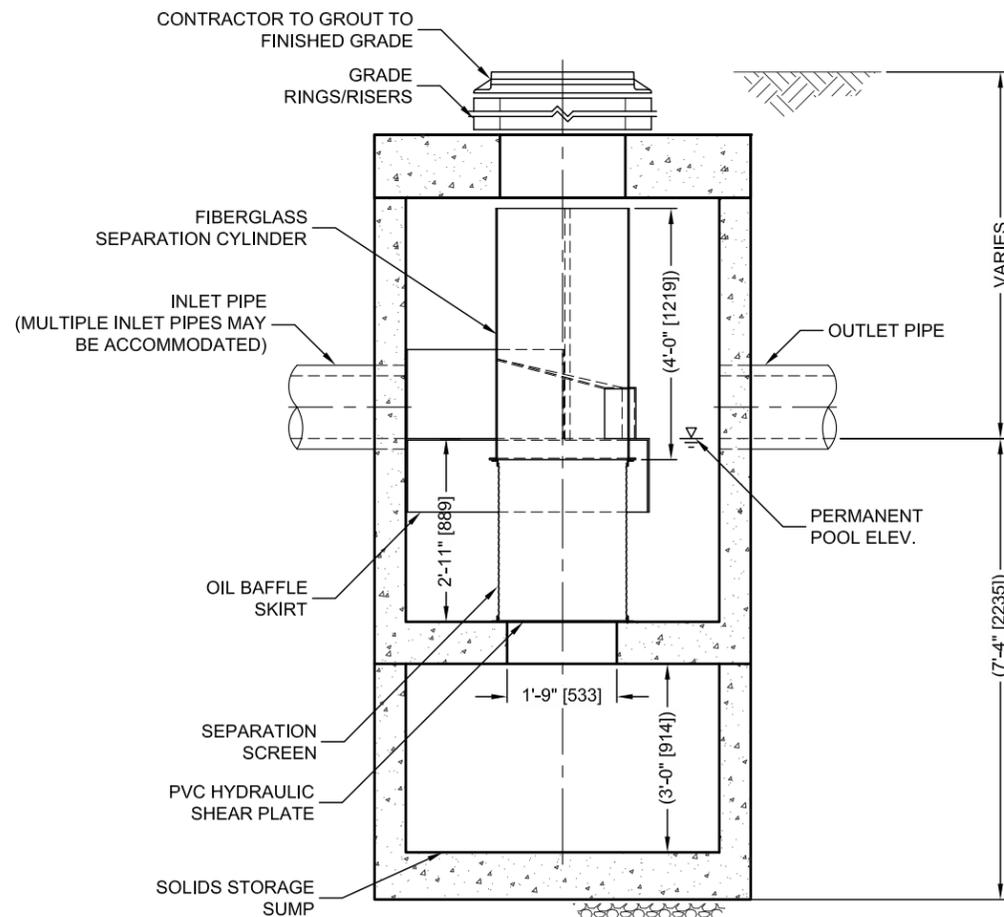

**ELEVATION A-A**  
N.T.S.

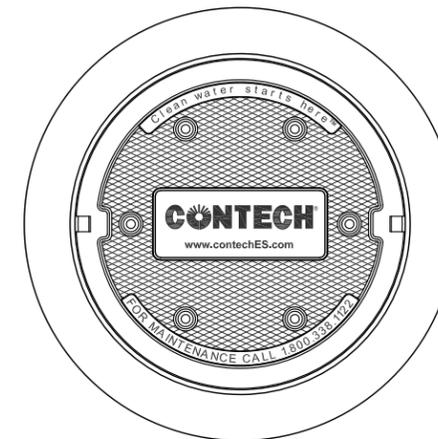

**FRAME AND COVER**  
(DIAMETER VARIES)  
N.T.S.

### SITE SPECIFIC DATA REQUIREMENTS

STRUCTURE ID				
WATER QUALITY FLOW RATE (CFS OR L/s)				*
PEAK FLOW RATE (CFS OR L/s)				*
RETURN PERIOD OF PEAK FLOW (YRS)				*
SCREEN APERTURE (2400 OR 4700)				*
PIPE DATA:	I.E.	MATERIAL	DIAMETER	
INLET PIPE 1	*	*	*	
INLET PIPE 2	*	*	*	
OUTLET PIPE	*	*	*	
RIM ELEVATION				*
ANTI-FLOTATION BALLAST	*	*	WIDTH	HEIGHT
NOTES/SPECIAL REQUIREMENTS:				
* PER ENGINEER OF RECORD				

#### GENERAL NOTES

1. CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
2. DIMENSIONS MARKED WITH ( ) ARE REFERENCE DIMENSIONS. ACTUAL DIMENSIONS MAY VARY.
3. FOR FABRICATION DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHTS, PLEASE CONTACT YOUR CONTECH ENGINEERED SOLUTIONS LLC REPRESENTATIVE. [www.contechES.com](http://www.contechES.com)
4. CDS WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING.
5. STRUCTURE SHALL MEET AASHTO HS20 AND CASTINGS SHALL MEET HS20 (AASHTO M 306) LOAD RATING, ASSUMING GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION.
6. PVC HYDRAULIC SHEAR PLATE IS PLACED ON SHELF AT BOTTOM OF SCREEN CYLINDER. REMOVE AND REPLACE AS NECESSARY DURING MAINTENANCE CLEANING.

#### INSTALLATION NOTES

- A. ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- B. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE CDS MANHOLE STRUCTURE (LIFTING CLUTCHES PROVIDED).
- C. CONTRACTOR TO ADD JOINT SEALANT BETWEEN ALL STRUCTURE SECTIONS, AND ASSEMBLE STRUCTURE.
- D. CONTRACTOR TO PROVIDE, INSTALL, AND GROUT PIPES. MATCH PIPE INVERTS WITH ELEVATIONS SHOWN.
- E. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO ASSURE UNIT IS WATER TIGHT, HOLDING WATER TO FLOWLINE INVERT MINIMUM. IT IS SUGGESTED THAT ALL JOINTS BELOW PIPE INVERTS ARE GROUTED.



[www.contechES.com](http://www.contechES.com)  
9025 Centre Pointe Dr., Suite 400, West Chester, OH 45069  
800-338-1122    513-645-7000    513-645-7993 FAX

**CDS PMSU2025-5-C  
INLINE CDS  
STANDARD DETAIL**





**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION  
BASED ON THE RATIONAL RAINFALL METHOD  
BASED ON A FINE PARTICLE SIZE DISTRIBUTION**



**Project Name:** Walkley-Conroy Project  
**Location:** Ottawa, ON  
**OGS #:** OGS 401

**Engineer:** NOVATECH  
**Contact:** Vahid Mehdipour  
**Report Date:** 5-Oct-23

**Area** 2.01 ha  
**Weighted C** 0.68  
**CDS Model** 3020

**Rainfall Station #** 215  
**Particle Size Distribution** FINE  
**CDS Treatment Capacity** 57 l/s

<u>Rainfall Intensity<sup>1</sup></u> <u>(mm/hr)</u>	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate</u> <u>(l/s)</u>	<u>Treated Flowrate (l/s)</u>	<u>Operating Rate (%)</u>	<u>Removal Efficiency (%)</u>	<u>Incremental Removal (%)</u>
0.5	9.2%	9.2%	1.9	1.9	3.3	97.9	9.0
1.0	10.6%	19.8%	3.8	3.8	6.7	96.9	10.3
1.5	9.9%	29.7%	5.7	5.7	10.0	96.0	9.5
2.0	8.4%	38.1%	7.6	7.6	13.4	95.0	8.0
2.5	7.7%	45.8%	9.5	9.5	16.7	94.1	7.2
3.0	5.9%	51.7%	11.4	11.4	20.1	93.1	5.5
3.5	4.4%	56.1%	13.3	13.3	23.4	92.1	4.0
4.0	4.7%	60.7%	15.2	15.2	26.8	91.2	4.3
4.5	3.3%	64.0%	17.1	17.1	30.1	90.2	3.0
5.0	3.0%	67.1%	19.0	19.0	33.5	89.3	2.7
6.0	5.4%	72.4%	22.8	22.8	40.2	87.3	4.7
7.0	4.4%	76.8%	26.6	26.6	46.9	85.4	3.7
8.0	3.5%	80.3%	30.4	30.4	53.6	83.5	3.0
9.0	2.8%	83.2%	34.1	34.1	60.3	81.6	2.3
10.0	2.2%	85.3%	37.9	37.9	67.0	79.7	1.7
15.0	7.0%	92.3%	56.9	56.6	100.0	69.9	4.9
20.0	4.5%	96.9%	75.9	56.6	100.0	52.4	2.4
25.0	1.4%	98.3%	94.9	56.6	100.0	41.9	0.6
30.0	0.7%	99.0%	113.8	56.6	100.0	34.9	0.2
35.0	0.5%	99.5%	132.8	56.6	100.0	29.9	0.1
40.0	0.5%	100.0%	151.8	56.6	100.0	26.2	0.1
45.0	0.0%	100.0%	170.7	56.6	100.0	23.3	0.0
50.0	0.0%	100.0%	189.7	56.6	100.0	21.0	0.0

87.3

Removal Efficiency Adjustment<sup>2</sup> = 6.5%  
**Predicted Net Annual Load Removal Efficiency = 81%**  
**Predicted Annual Rainfall Treated = 97%**



- 1 - Based on 42 years of hourly rainfall data from Canadian Station 6105976, Ottawa ON
- 2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.
- 3 - CDS efficiency based on testing conducted at the University of Central Florida.
- 4 - CDS design and scaling based on original manufacturer model and product specifications.

## CDS PMSU3020-6-C DESIGN NOTES

THE STANDARD CDS PMSU3020-6-C CONFIGURATION IS SHOWN. ALTERNATE CONFIGURATIONS ARE AVAILABLE AND ARE LISTED BELOW. SOME CONFIGURATIONS MAY BE COMBINED TO SUIT SITE REQUIREMENTS.

### CONFIGURATION DESCRIPTION


- GRATED INLET ONLY (NO INLET PIPE)
- GRATED INLET WITH INLET PIPE OR PIPES
- CURB INLET ONLY (NO INLET PIPE)
- CURB INLET WITH INLET PIPE OR PIPES
- CUSTOMIZABLE SUMP DEPTH AVAILABLE
- ANTI-FLOTATION DESIGN AVAILABLE UPON REQUEST

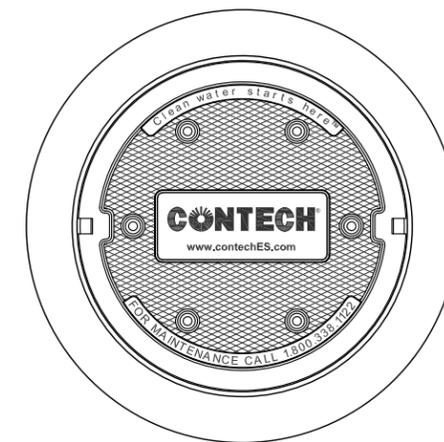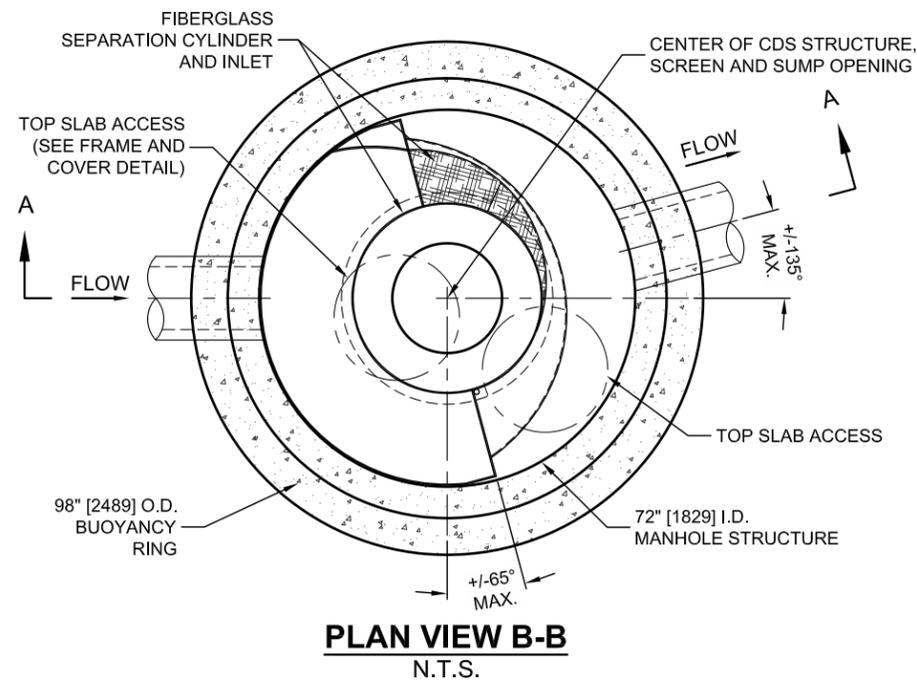

**FRAME AND COVER**  
(DIAMETER VARIES)  
N.T.S.

### SITE SPECIFIC DATA REQUIREMENTS

STRUCTURE ID				
WATER QUALITY FLOW RATE (CFS OR L/s)				*
PEAK FLOW RATE (CFS OR L/s)				*
RETURN PERIOD OF PEAK FLOW (YRS)				*
SCREEN APERTURE (2400 OR 4700)				*
PIPE DATA:	I.E.	MATERIAL	DIAMETER	
INLET PIPE 1	*	*	*	
INLET PIPE 2	*	*	*	
OUTLET PIPE	*	*	*	
RIM ELEVATION				*
ANTI-FLOTATION BALLAST	WIDTH	HEIGHT		
	*	*		
NOTES/SPECIAL REQUIREMENTS:				
* PER ENGINEER OF RECORD				

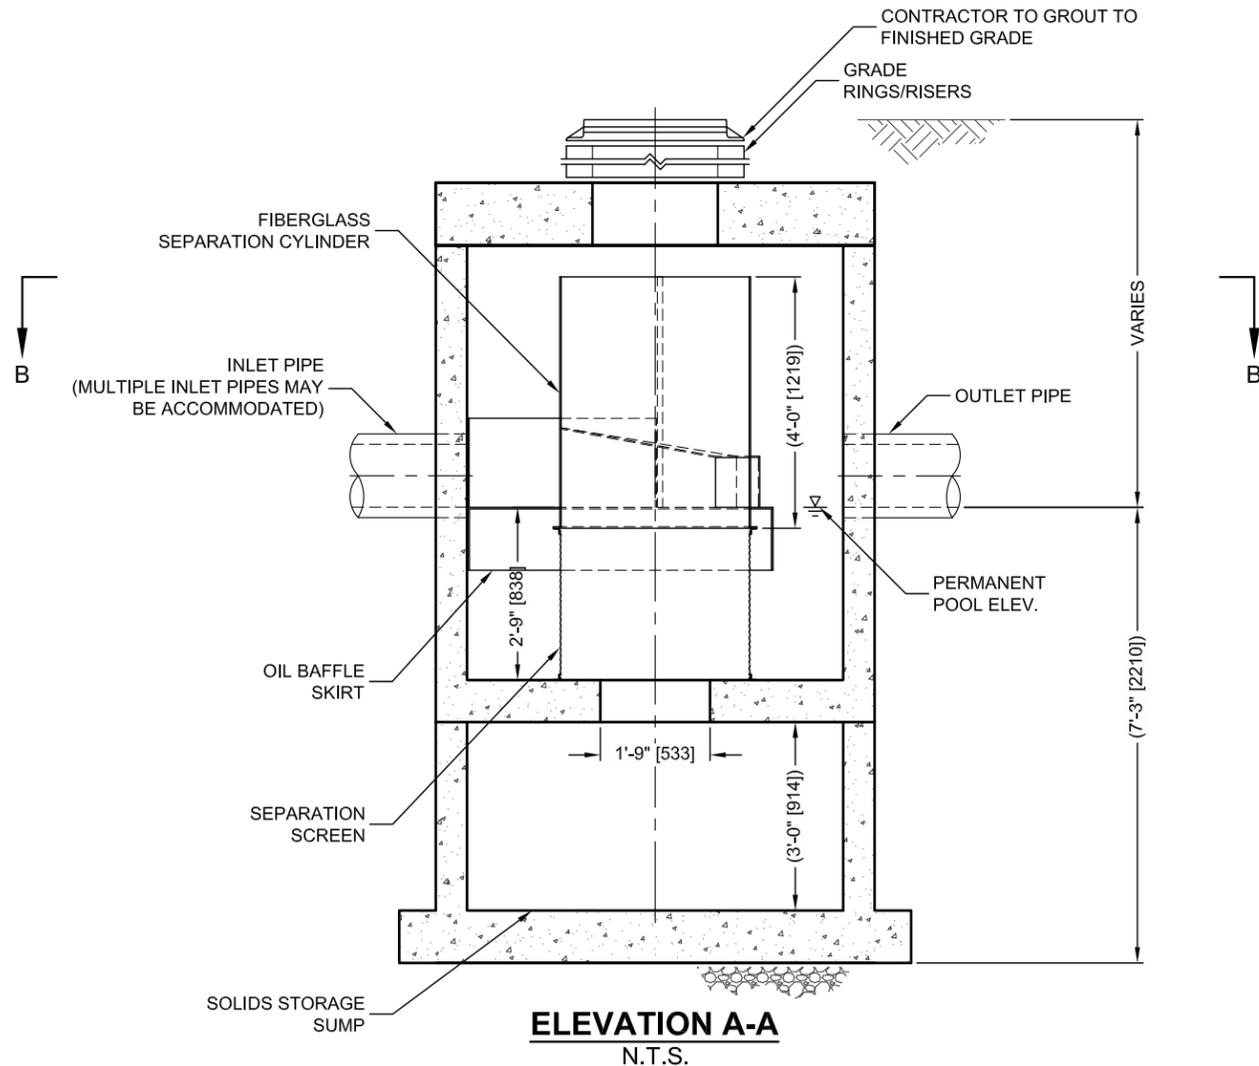

### GENERAL NOTES

1. CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
2. DIMENSIONS MARKED WITH ( ) ARE REFERENCE DIMENSIONS. ACTUAL DIMENSIONS MAY VARY.
3. FOR FABRICATION DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHTS, PLEASE CONTACT YOUR CONTECH ENGINEERED SOLUTIONS LLC REPRESENTATIVE. [www.contechES.com](http://www.contechES.com)
4. CDS WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING.
5. STRUCTURE SHALL MEET AASHTO HS20 AND CASTINGS SHALL MEET HS20 (AASHTO M 306) LOAD RATING, ASSUMING GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION.
6. PVC HYDRAULIC SHEAR PLATE IS PLACED ON SHELF AT BOTTOM OF SCREEN CYLINDER. REMOVE AND REPLACE AS NECESSARY DURING MAINTENANCE CLEANING.

### INSTALLATION NOTES

- A. ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- B. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE CDS MANHOLE STRUCTURE (LIFTING CLUTCHES PROVIDED).
- C. CONTRACTOR TO ADD JOINT SEALANT BETWEEN ALL STRUCTURE SECTIONS, AND ASSEMBLE STRUCTURE.
- D. CONTRACTOR TO PROVIDE, INSTALL, AND GROUT PIPES. MATCH PIPE INVERTS WITH ELEVATIONS SHOWN.
- E. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO ASSURE UNIT IS WATER TIGHT, HOLDING WATER TO FLOWLINE INVERT MINIMUM. IT IS SUGGESTED THAT ALL JOINTS BELOW PIPE INVERTS ARE GROUTED.



[www.contechES.com](http://www.contechES.com)  
9025 Centre Pointe Dr., Suite 400, West Chester, OH 45069  
800-338-1122 513-645-7000 513-645-7993 FAX

**CDS PMSU3020-6-C  
INLINE CDS  
STANDARD DETAIL**





**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION  
BASED ON THE RATIONAL RAINFALL METHOD  
BASED ON A FINE PARTICLE SIZE DISTRIBUTION**



**Project Name:** Walkley-Conroy Project  
**Location:** Ottawa, ON  
**OGS #:** OGS 600

**Engineer:** NOVATECH  
**Contact:** Vahid Mehdipour  
**Report Date:** 5-Oct-23

**Area** 0.290 ha  
**Weighted C** 0.73  
**CDS Model** 2015-4

**Rainfall Station #** 215  
**Particle Size Distribution** FINE  
**CDS Treatment Capacity** 20 l/s

<u>Rainfall Intensity<sup>1</sup></u> <u>(mm/hr)</u>	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate</u> <u>(l/s)</u>	<u>Treated Flowrate (l/s)</u>	<u>Operating Rate (%)</u>	<u>Removal Efficiency (%)</u>	<u>Incremental Removal (%)</u>
0.5	9.2%	9.2%	0.3	0.3	1.5	98.4	9.0
1.0	10.6%	19.8%	0.6	0.6	3.0	98.0	10.4
1.5	9.9%	29.7%	0.9	0.9	4.5	97.6	9.7
2.0	8.4%	38.1%	1.2	1.2	5.9	97.2	8.1
2.5	7.7%	45.8%	1.5	1.5	7.4	96.7	7.4
3.0	5.9%	51.7%	1.8	1.8	8.9	96.3	5.7
3.5	4.4%	56.1%	2.1	2.1	10.4	95.9	4.2
4.0	4.7%	60.7%	2.4	2.4	11.9	95.5	4.5
4.5	3.3%	64.0%	2.6	2.6	13.4	95.0	3.2
5.0	3.0%	67.1%	2.9	2.9	14.8	94.6	2.9
6.0	5.4%	72.4%	3.5	3.5	17.8	93.8	5.1
7.0	4.4%	76.8%	4.1	4.1	20.8	92.9	4.0
8.0	3.5%	80.3%	4.7	4.7	23.8	92.0	3.3
9.0	2.8%	83.2%	5.3	5.3	26.7	91.2	2.6
10.0	2.2%	85.3%	5.9	5.9	29.7	90.3	2.0
15.0	7.0%	92.3%	8.8	8.8	44.5	86.1	6.0
20.0	4.5%	96.9%	11.8	11.8	59.4	81.8	3.7
25.0	1.4%	98.3%	14.7	14.7	74.2	77.6	1.1
30.0	0.7%	99.0%	17.7	17.7	89.1	73.3	0.5
35.0	0.5%	99.5%	20.6	19.8	100.0	67.6	0.3
40.0	0.5%	100.0%	23.5	19.8	100.0	59.1	0.3
45.0	0.0%	100.0%	26.5	19.8	100.0	52.5	0.0
50.0	0.0%	100.0%	29.4	19.8	100.0	47.3	0.0

93.9

Removal Efficiency Adjustment<sup>2</sup> = 6.5%  
**Predicted Net Annual Load Removal Efficiency = 87%**  
**Predicted Annual Rainfall Treated = 100%**




- 1 - Based on 42 years of hourly rainfall data from Canadian Station 6105976, Ottawa ON
- 2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.
- 3 - CDS efficiency based on testing conducted at the University of Central Florida.
- 4 - CDS design and scaling based on original manufacturer model and product specifications.

## CDS PMSU2015-4-C DESIGN NOTES

THE STANDARD CDS PMSU2015-4-C CONFIGURATION IS SHOWN. ALTERNATE CONFIGURATIONS ARE AVAILABLE AND ARE LISTED BELOW. SOME CONFIGURATIONS MAY BE COMBINED TO SUIT SITE REQUIREMENTS.

### CONFIGURATION DESCRIPTION

- GRATED INLET ONLY (NO INLET PIPE)
- GRATED INLET WITH INLET PIPE OR PIPES
- CURB INLET ONLY (NO INLET PIPE)
- CURB INLET WITH INLET PIPE OR PIPES
- CUSTOMIZABLE SUMP DEPTH AVAILABLE
- ANTI-FLOTATION DESIGN AVAILABLE UPON REQUEST

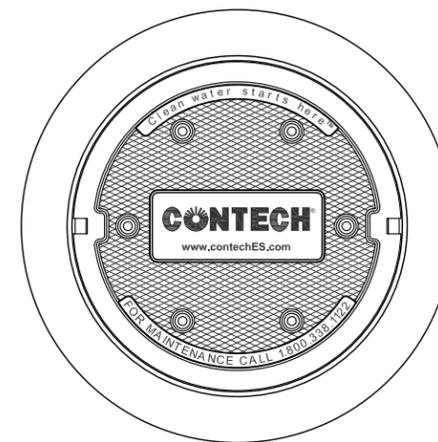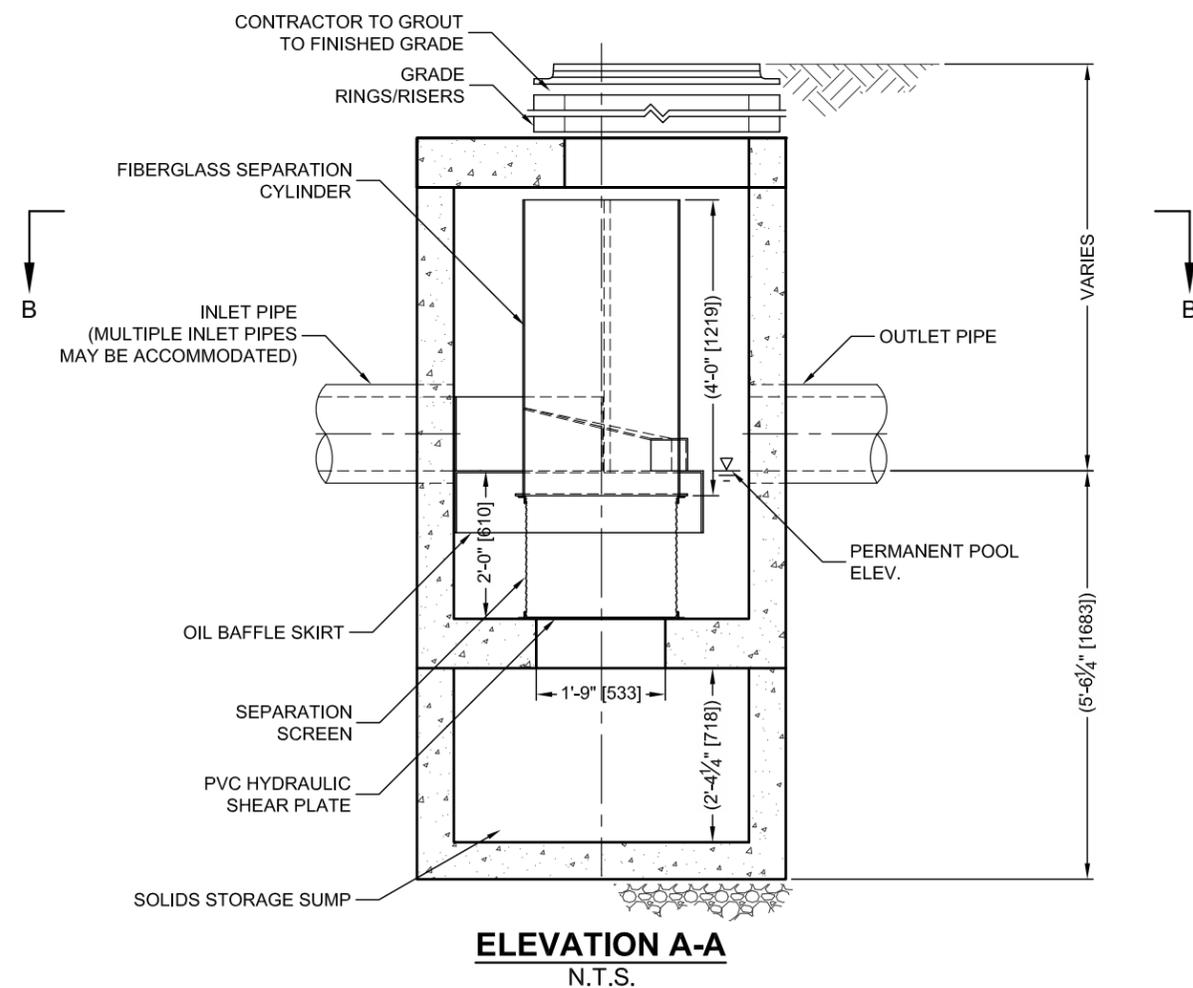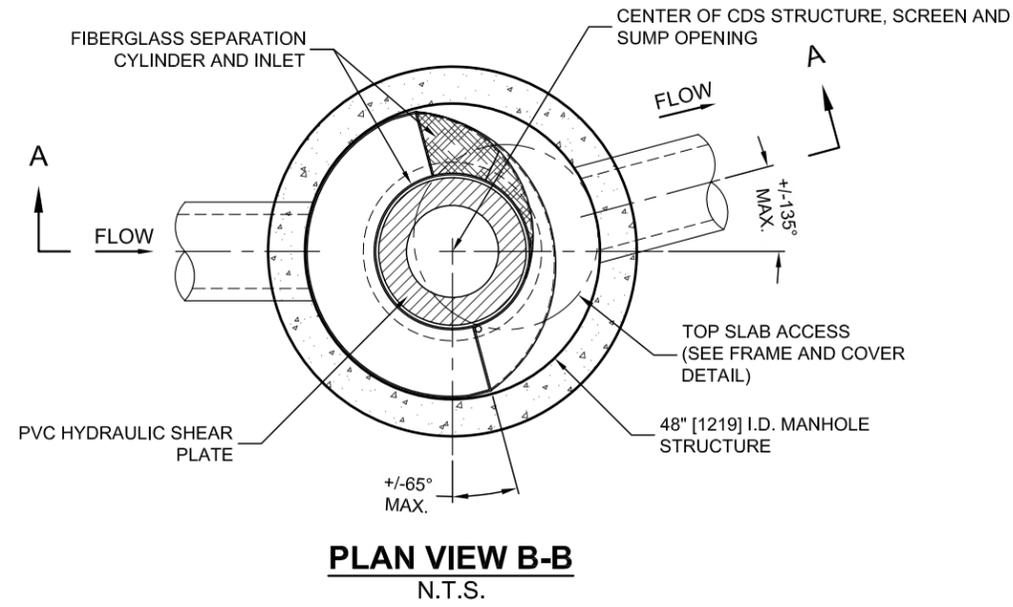

**FRAME AND COVER**  
(DIAMETER VARIES)  
N.T.S.

### SITE SPECIFIC DATA REQUIREMENTS

STRUCTURE ID				
WATER QUALITY FLOW RATE (CFS OR L/s)				*
PEAK FLOW RATE (CFS OR L/s)				*
RETURN PERIOD OF PEAK FLOW (YRS)				*
SCREEN APERTURE (2400 OR 4700)				*
PIPE DATA:	I.E.	MATERIAL	DIAMETER	
INLET PIPE 1	*	*	*	
INLET PIPE 2	*	*	*	
OUTLET PIPE	*	*	*	
RIM ELEVATION				*
ANTI-FLOTATION BALLAST	WIDTH	HEIGHT		
	*	*		
NOTES/SPECIAL REQUIREMENTS:				
* PER ENGINEER OF RECORD				

#### GENERAL NOTES

1. CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
2. DIMENSIONS MARKED WITH ( ) ARE REFERENCE DIMENSIONS. ACTUAL DIMENSIONS MAY VARY.
3. FOR FABRICATION DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHTS, PLEASE CONTACT YOUR CONTECH ENGINEERED SOLUTIONS LLC REPRESENTATIVE. [www.contechES.com](http://www.contechES.com)
4. CDS WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING.
5. STRUCTURE SHALL MEET AASHTO HS20 AND CASTINGS SHALL MEET HS20 (AASHTO M 306) LOAD RATING, ASSUMING GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION.
6. PVC HYDRAULIC SHEAR PLATE IS PLACED ON SHELF AT BOTTOM OF SCREEN CYLINDER. REMOVE AND REPLACE AS NECESSARY DURING MAINTENANCE CLEANING.

#### INSTALLATION NOTES

- A. ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- B. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE CDS MANHOLE STRUCTURE (LIFTING CLUTCHES PROVIDED).
- C. CONTRACTOR TO ADD JOINT SEALANT BETWEEN ALL STRUCTURE SECTIONS, AND ASSEMBLE STRUCTURE.
- D. CONTRACTOR TO PROVIDE, INSTALL, AND GROUT PIPES. MATCH PIPE INVERTS WITH ELEVATIONS SHOWN.
- E. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO ASSURE UNIT IS WATER TIGHT, HOLDING WATER TO FLOWLINE INVERT MINIMUM. IT IS SUGGESTED THAT ALL JOINTS BELOW PIPE INVERTS ARE GROUTED.



[www.contechES.com](http://www.contechES.com)  
9025 Centre Pointe Dr., Suite 400, West Chester, OH 45069  
800-338-1122    513-645-7000    513-645-7993 FAX

**CDS PMSU2015-4-C  
INLINE CDS  
STANDARD DETAIL**



**Walkley-Conroy (122040)**

**Pre-Development Subcatchment Parameters**

**ARM Subcatchments**

Pre-Development

<b>Name</b>	<b>Area (ha)</b>	<b>Flow Length (m)</b>	<b>Slope (%)</b>	<b>Imperv (%)</b>	<b>SCS Curve Number</b>	<b>Time of Concentration (min)</b>	<b>Initial Abstraction (mm)</b>
E-01	5.854	300	0.78	39	86	17	5

Pre-Development Model Schematic



Date: 2023-09-29

M:\2022\122040\DATA\Calculations\SWM\PCSWMM\Model Schematics-Output\Pre-Dev PCSWMM Model Schematics.docx

Pre-Development Model Output

ALTERNATIVE RUNOFF METHOD (ARM) - PCSWMM VERSION 7.4.3202

This is a new version of ARM - your feedback and suggestions are solicited.  
 Create a ticket, post on the PCSWMM feature request forum, or email us directly!

Simulation start time: 10/18/2022 00:00:00  
 Simulation end time: 10/19/2022 00:00:00  
 Runoff wet weather time steps: 300 seconds  
 Report time steps: 60 seconds  
 Number of data points: 1441

\*\*\*\*\*  
 Unit Hydrographs Runoff Method  
 \*\*\*\*\*

Concentration Subcatchment (min)	Time to Peak (min)	Peak Runoff Method	Time after Peak (m <sup>3</sup> /s/mm)	Peak UH Flow Raingage (mm)	Area UH Depth (ha)	Time of (min)
E-01 11.33	78.67	Nash IUH	0.0466	RG 0.998	5.854	17

\*\*\*\*\*  
 ARM Runoff Summary  
 \*\*\*\*\*

Runoff Coeff Subcatchment (fraction)	Total Precip (mm)	Total Losses (mm)	Total Runoff (mm)	Total Runoff 10 <sup>6</sup> ltr	Peak Runoff LPS
E-01 0.655	45.162	15.478	29.604	1.733	596.748

EPA STORM WATER MANAGEMENT MODEL - VERSION 5.1 (Build 5.1.015)

Walkley-Conroy (Existing Condition)  
 Created By Vahid Mehdipour  
 October 25, 2022

\*\*\*\*\*  
 Element Count  
 \*\*\*\*\*  
 Number of rain gages ..... 1  
 Number of subcatchments ... 0

Number of nodes ..... 1  
 Number of links ..... 0  
 Number of pollutants ..... 0  
 Number of land uses ..... 0

\*\*\*\*\*  
 Raingage Summary  
 \*\*\*\*\*

Name	Data Source	Data Type	Recording Interval
RG	C4hr-5yr	INTENSITY	10 min.

\*\*\*\*\*  
 Node Summary  
 \*\*\*\*\*

Name	Type	Invert Elev.	Max. Depth	Ponded Area	External Inflow
StLaurentBlvd	OUTFALL	0.00	0.00	0.0	

\*\*\*\*\*  
 NOTE: The summary statistics displayed in this report are based on results found at every computational time step, not just on results from each reporting time step.  
 \*\*\*\*\*

\*\*\*\*\*  
 Analysis Options  
 \*\*\*\*\*

Flow Units ..... LPS  
 Process Models:  
 Rainfall/Runoff ..... YES  
 RDII ..... NO  
 Snowmelt ..... NO  
 Groundwater ..... NO  
 Flow Routing ..... NO  
 Water Quality ..... NO  
 Surcharge Method ..... EXTRAN  
 Starting Date ..... 10/18/2022 00:00:00  
 Ending Date ..... 10/19/2022 00:00:00  
 Antecedent Dry Days ..... 0.0  
 Report Time Step ..... 00:01:00

	Volume hectare-m	Volume 10^6 ltr
Flow Routing Continuity		
Dry Weather Inflow	0.000	0.000
Wet Weather Inflow	0.000	0.000
Groundwater Inflow	0.000	0.000
RDII Inflow	0.000	0.000
External Inflow	0.173	1.734
External Outflow	0.173	1.734
Flooding Loss	0.000	0.000
Evaporation Loss	0.000	0.000
Exfiltration Loss	0.000	0.000
Initial Stored Volume	0.000	0.000
Final Stored Volume	0.000	0.000

Continuity Error (%) ..... 0.000

Analysis begun on: Tue Oct 25 15:26:54 2022

Analysis ended on: Tue Oct 25 15:26:55 2022

Total elapsed time: 00:00:01

**Overall Model Schematic**



Date: 2024-07-03

M:\2022\122040\DATA\Calculations\SWM\PCSWMM\Model Schematics-Output\Post-Dev PCSWMM Model Schematics.docx

Subcatchments



Date: 2024-07-03

M:\2022\122040\DATA\Calculations\SWM\PCSWMM\Model Schematics-Output\Post-Dev PCSWMM Model Schematics.docx

Storage Nodes & Outfalls



Date: 2024-07-03

M:\2022\122040\DATA\Calculations\SWM\PCSWMM\Model Schematics-Output\Post-Dev PCSWMM Model Schematics.docx

**Walkley-Conroy (122040)**  
**PCSWMM Model Output**  
**100yr 4-Hour Chicago, Fixed**

EPA STORM WATER MANAGEMENT MODEL - VERSION 5.2 (Build 5.2.4)

Walkley-Conroy Subdivision

\*\*\*\*\*  
 Element Count  
 \*\*\*\*\*  
 Number of rain gages ..... 1  
 Number of subcatchments ... 42  
 Number of nodes ..... 119  
 Number of links ..... 135  
 Number of pollutants ..... 0  
 Number of land uses ..... 0

\*\*\*\*\*  
 Rainage Summary  
 \*\*\*\*\*

Name	Data Source	Data Type	Recording Interval
RG	C4hr-100yr	INTENSITY	10 min.

\*\*\*\*\*  
 Subcatchment Summary  
 \*\*\*\*\*

Name	Area	Width	%Imperv	%Slope	Rain Gage	Outlet
A-01	0.15	125.83	47.10	2.0000	RG	RYCB702
A-02	0.17	126.92	80.00	2.0000	RG	CB01/02
A-03	0.16	111.43	80.00	2.0000	RG	CB01/02
A-04	0.25	179.29	37.10	2.0000	RG	RYCB701
A-05	0.10	104.00	44.30	2.0000	RG	RYCB704
A-06	0.15	124.17	74.30	2.0000	RG	CB03/04
A-07	0.14	99.29	75.70	2.0000	RG	CB03/04
A-08	0.27	204.62	47.10	2.0000	RG	RYCB703
A-09	0.07	92.86	81.40	2.0000	RG	CB05/06
A-10	0.19	128.00	77.10	2.0000	RG	CB05/06
A-11	0.23	167.14	48.60	2.0000	RG	RYCB705
B-01	0.15	129.17	77.10	2.0000	RG	CB07/08
B-02	0.10	97.00	74.30	2.0000	RG	CB07/08
B-05	0.21	163.08	42.90	2.0000	RG	RY-1014b
B-06	0.12	127.78	78.60	2.0000	RG	CB09
B-07	0.12	84.29	81.40	2.0000	RG	CB10/11
B-08	0.11	76.43	78.60	2.0000	RG	CB10/11
B-09	0.14	97.86	80.00	2.0000	RG	CB12/13
B-10	0.15	109.29	81.40	2.0000	RG	CB12/13
B-11	0.35	249.29	52.90	2.0000	RG	RYCB709
B-12	0.10	61.88	72.90	2.0000	RG	CB14/15
B-13	0.07	108.33	64.30	2.0000	RG	CB14/15
B-14	0.02	42.00	75.70	2.0000	RG	CB16
B-15	0.06	59.00	82.90	2.0000	RG	CB16
B-16	0.05	96.00	95.70	2.0000	RG	CB17/18
B-17	0.14	93.33	77.10	2.0000	RG	CB17/18
B-18	0.06	62.00	70.00	2.0000	RG	CB19
B-19	0.07	83.75	82.90	2.0000	RG	CB19
C-01	0.08	54.00	81.40	2.0000	RG	CB25
C-02	0.07	54.62	72.90	2.0000	RG	CB24
C-03	0.04	37.00	68.60	2.0000	RG	CB23
C-04	0.04	35.00	72.90	2.0000	RG	CB22
C-05	0.03	31.00	75.70	2.0000	RG	CB21
C-06	0.04	35.00	74.30	2.0000	RG	CB20
D-01	0.01	30.00	25.70	2.0000	RG	D01-OUT
D-02	0.01	15.00	37.10	2.0000	RG	DR02-03-OUT
D-03	0.01	7.78	42.90	2.0000	RG	DR02-03-OUT
D-04	0.00	5.00	0.00	5.0000	RG	D04-05-OUT
D-05	0.05	67.50	12.90	5.0000	RG	D04-05-OUT
EX-01	0.02	60.00	0.00	5.0000	RG	RY-1014a
PARK	0.60	79.60	7.10	2.0000	RG	MH802
RETIREMENT	1.02	157.23	85.70	2.0000	RG	Retirment_Storage

\*\*\*\*\*  
 Node Summary  
 \*\*\*\*\*

Name	Type	Invert Elev.	Max. Depth	Ponded Area	External Inflow
HP-CB01/02	JUNCTION	85.16	1.00	0.0	

HP-CB03/04	JUNCTION	86.09	1.00	0.0
HP-CB05/06	JUNCTION	86.64	1.00	0.0
HP-CB05/06 (2)	JUNCTION	86.48	1.00	0.0
HP-CB07/08	JUNCTION	85.18	1.00	0.0
HP-CB09	JUNCTION	86.16	1.00	0.0
HP-CB09 (2)	JUNCTION	86.21	1.00	0.0
HP-CB10/11	JUNCTION	86.15	1.00	0.0
HP-CB12/13	JUNCTION	85.86	1.00	0.0
HP-CB14/15	JUNCTION	86.64	1.00	0.0
HP-CB14/15 (2)	JUNCTION	86.64	1.00	0.0
HP-CB16	JUNCTION	86.58	1.00	0.0
HP-CB16 (2)	JUNCTION	86.64	1.00	0.0
HP-CB19	JUNCTION	85.79	1.00	0.0
HP-CB20	JUNCTION	85.43	1.00	0.0
HP-CB21	JUNCTION	85.46	1.00	0.0
HP-CB22	JUNCTION	85.53	1.00	0.0
HP-CB23	JUNCTION	85.52	1.00	0.0
HP-CB24	JUNCTION	85.58	1.00	0.0
HP-CB25	JUNCTION	85.59	1.00	0.0
HP-CB25 (2)	JUNCTION	85.77	1.00	0.0
HP-MH509	JUNCTION	85.95	1.00	0.0
HP-RY-1005	JUNCTION	85.86	1.00	0.0
HP-RYCB09	JUNCTION	86.00	1.00	0.0
HP-RYCB704	JUNCTION	85.76	1.00	0.0
HP-RYCB705	JUNCTION	85.97	1.00	0.0
HP-RYCB802	JUNCTION	85.67	1.00	0.0
D01-OUT	OUTFALL	86.40	0.00	0.0
D04-05-OUT	OUTFALL	85.30	0.00	0.0
DR02-03-OUT	OUTFALL	85.00	0.00	0.0
HP-MH509-OUT	OUTFALL	85.25	1.00	0.0
HP-RY-1001	OUTFALL	85.21	1.00	0.0
HP-RY-1003	OUTFALL	85.25	1.00	0.0
MH201Connection	OUTFALL	80.98	0.53	0.0
MH401Connection	OUTFALL	80.66	0.60	0.0
OF-DonReidDr	OUTFALL	86.41	1.00	0.0
OF-MH600	OUTFALL	83.00	0.45	0.0
OF-MJ-CommercialRoad	OUTFALL	85.13	1.00	0.0
OF-Retirement	OUTFALL	87.25	1.00	0.0
OF-RYCB708	OUTFALL	85.16	1.00	0.0
OF-StLaurent1	OUTFALL	85.05	1.00	0.0
OF-StLaurent2	OUTFALL	85.07	1.00	0.0
Park-OUT	OUTFALL	81.76	0.00	0.0
Retirement-OUT	OUTFALL	86.00	0.00	0.0
CB01/02	STORAGE	83.67	2.32	0.0
CB03/04	STORAGE	84.56	2.33	0.0
CB05/06	STORAGE	84.97	2.27	0.0
CB07/08	STORAGE	83.75	2.30	0.0
CB09	STORAGE	84.86	2.20	0.0
CB10/11	STORAGE	84.35	2.56	0.0
CB12/13	STORAGE	84.13	2.56	0.0
CB14/15	STORAGE	85.11	2.33	0.0
CB16	STORAGE	85.24	2.20	0.0
CB17/18	STORAGE	86.02	1.00	0.0
CB19	STORAGE	84.49	2.20	0.0
CB20	STORAGE	84.08	2.20	0.0
CB21	STORAGE	84.15	2.20	0.0
CB22	STORAGE	84.18	2.20	0.0
CB23	STORAGE	84.20	2.20	0.0
CB24	STORAGE	84.21	2.20	0.0
CB25	STORAGE	84.25	2.20	0.0
MH201	STORAGE	81.01	4.08	0.0
MH202	STORAGE	81.77	4.23	0.0
MH203	STORAGE	82.15	4.59	0.0
MH204	STORAGE	82.89	3.60	0.0
MH205	STORAGE	82.57	3.94	0.0
MH401	STORAGE	80.70	4.50	0.0
MH401b	STORAGE	81.12	4.00	0.0
MH402	STORAGE	81.37	4.78	0.0
MH403	STORAGE	81.54	4.57	0.0
MH404	STORAGE	81.89	4.00	0.0
MH405	STORAGE	82.27	3.60	0.0
MH406	STORAGE	81.82	4.81	0.0
MH407	STORAGE	82.29	3.84	0.0
MH408	STORAGE	82.53	3.38	0.0
MH501	STORAGE	82.69	4.73	0.0
MH501Connection	STORAGE	82.54	3.91	0.0
MH502	STORAGE	83.34	3.99	0.0
MH503	STORAGE	81.85	4.28	0.0
MH504	STORAGE	82.65	3.42	0.0
MH505	STORAGE	81.97	4.60	0.0
MH506	STORAGE	82.30	4.14	0.0
MH507	STORAGE	82.55	3.61	0.0

**Walkley-Conroy (122040)**  
**PCSWMM Model Output**  
**100yr 4-Hour Chicago, Fixed**

MH508	STORAGE	82.69	3.46	0.0
MH509	STORAGE	82.83	3.86	0.0
MH510	STORAGE	83.40	3.39	0.0
MH600	STORAGE	83.13	2.32	0.0
MH601	STORAGE	83.16	3.25	0.0
MH602	STORAGE	83.53	2.02	0.0
MH603	STORAGE	83.61	1.97	0.0
MH604	STORAGE	83.83	1.73	0.0
MH800	STORAGE	83.39	2.74	0.0
MH801	STORAGE	81.93	4.42	0.0
MH802	STORAGE	84.10	2.38	0.0
Retirement_Storage	STORAGE	86.00	2.30	0.0
RY-1001	STORAGE	83.79	2.31	0.0
RY-1002	STORAGE	84.08	2.26	0.0
RY-1003	STORAGE	84.15	2.00	0.0
RY-1004	STORAGE	84.44	2.00	0.0
RY-1005	STORAGE	84.60	2.24	0.0
RY-1006	STORAGE	84.47	2.23	0.0
RY-1007	STORAGE	84.59	2.26	0.0
RY-1008	STORAGE	84.94	2.51	0.0
RY-1009	STORAGE	84.39	2.26	0.0
RY-1010	STORAGE	84.71	2.58	0.0
RY-1011	STORAGE	85.20	2.20	0.0
RY-1012	STORAGE	84.89	2.56	0.0
RY-1013	STORAGE	84.64	2.66	0.0
RY-1014a	STORAGE	83.27	2.93	0.0
RY-1014b	STORAGE	83.70	2.30	0.0
RY-1015	STORAGE	84.90	2.23	0.0
RY-1016	STORAGE	84.63	2.22	0.0
RYCB701	STORAGE	83.53	2.57	0.0
RYCB702	STORAGE	83.89	2.36	0.0
RYCB703	STORAGE	84.38	2.66	0.0
RYCB704	STORAGE	84.27	2.52	0.0
RYCB705	STORAGE	84.40	2.40	0.0
RYCB708	STORAGE	83.05	3.35	0.0
RYCB709	STORAGE	83.95	2.75	0.0

\*\*\*\*\*  
 Link Summary  
 \*\*\*\*\*

Name	From Node	To Node	Type	Length	%Slope	Roughness
C1	HP-CB25 (2)	CB25	CONDUIT	17.7	1.8082	0.0350
C10	CB21	HP-CB21	CONDUIT	17.4	-0.6322	0.0350
C11	HP-CB21	CB20	CONDUIT	17.1	1.0527	0.0350
C12	CB20	HP-CB20	CONDUIT	17.9	-0.8380	0.0350
C13	HP-CB20	OF-MJ-CommercialRoad	CONDUIT	31.4	8.1	3.7062 0.0350
C14	CB05/06	HP-CB05/06 (2)	CONDUIT	55.0	-0.7644	0.0350
C15	HP-CB05/06	CB05/06	CONDUIT	55.0	0.7273	0.0350
C16	HP-CB05/06	CB03/04	CONDUIT	64.8	1.1575	0.0160
C17	CB03/04	HP-CB03/04	CONDUIT	29.1	-0.6873	0.0160
C18	HP-CB03/04	CB01/02	CONDUIT	66.2	1.6619	0.0160
C19	CB01/02	HP-CB01/02	CONDUIT	29.1	-0.5842	0.0160
C2	CB25	HP-CB25	CONDUIT	17.2	-0.8140	0.0350
C20	HP-CB01/02	OF-StLaurent1	CONDUIT	6.1	1.8036	0.0160
C21	MH601	CB20	CONDUIT	3.3	4.0032	0.0160
C21_1	CB19	HP-CB19	CONDUIT	3.3	-3.0784	0.0160
C21_2	HP-CB19	MH509	CONDUIT	3.3	3.0784	0.0160
C21_3	MH509	HP-MH509	CONDUIT	5.0	-5.2070	0.0160
C22	HP-CB14/15 (2)	CB14/15	CONDUIT	27.3	0.7326	0.0160
C23	CB14/15	HP-CB14/15	CONDUIT	29.0	-0.6897	0.0160
C24	HP-CB14/15	CB09	CONDUIT	51.1	1.1351	0.0160
C25	CB09	HP-CB09	CONDUIT	4.0	-2.5008	0.0160
C26	RY-1011	RY-1012	CONDUIT	59.7	0.5025	0.0130
C27	HP-CB09 (2)	CB09	CONDUIT	26.3	0.5704	0.0160
C28	HP-MH509	HP-MH509-OUT	CONDUIT	7.0	10.0504	0.0350
C29	CB07/08	HP-CB07/08	CONDUIT	19.8	-0.6566	0.0350
C3	HP-CB25	CB24	CONDUIT	25.5	0.7059	0.0350
C30	HP-CB07/08	OF-StLaurent2	CONDUIT	4.1	2.6839	0.0350
C31	CB12/13	HP-CB12/13	CONDUIT	20.9	-0.8134	0.0160
C32	CB10/11	HP-CB10/11	CONDUIT	39.2	-0.6123	0.0160
C33	HP-CB10/11	CB12/13	CONDUIT	65.3	0.7045	0.0160
C34	HP-CB09	CB10/11	CONDUIT	10.0	2.5008	0.0160
C35	HP-CB12/13	CB19	CONDUIT	23.9	0.7113	0.0350
C36	CB17/18	CB19	CONDUIT	38.1	0.8662	0.0350
C37	HP-CB16	CB17/18	CONDUIT	74.9	0.7477	0.0350
C38	CB16	HP-CB16	CONDUIT	19.2	-0.7292	0.0350
C39	HP-CB16 (2)	CB16	CONDUIT	14.3	1.3987	0.0350
C4	CB24	HP-CB24	CONDUIT	30.0	-0.5667	0.0350
C40	HP-CB05/06 (2)	OF-DonReidDr	CONDUIT	9.4	0.7447	0.0350
C41	MH502	CB05/06	CONDUIT	3.3	2.7703	0.0160

C42	RY-1014a	RYCB708	CONDUIT	33.4	0.4790	0.0130
C43	MH401	MH401Connection	CONDUIT	12.0	0.3333	0.0130
C44	MH510	MH509	CONDUIT	3.3	3.0784	0.0160
C45	RY-1004	RYCB702	CONDUIT	52.7	0.4934	0.0130
C46	RY-1012	RY-1013	CONDUIT	48.1	0.4990	0.0130
C47	RY-1013	RYCB705	CONDUIT	33.4	0.5090	0.0130
C47_1	MH802	HP-RYCB802	CONDUIT	2.0	-9.5432	0.0350
C48	RY-1003	RYCB702	CONDUIT	40.7	0.4914	0.0130
C49	RY-1003	HP-RY-1003	CONDUIT	2.0	-5.0063	0.0350
C5	HP-CB24	CB23	CONDUIT	27.1	0.6642	0.0350
C50	RY-1001	HP-RY-1001	CONDUIT	2.0	-5.5083	0.0350
C51	RY-1005	HP-RY-1005	CONDUIT	2.0	-1.0001	0.0350
C52	HP-RY-1005	RY-1002	CONDUIT	2.0	26.9260	0.0350
C53	HP-RYCB802	RY-1004	CONDUIT	2.0	11.5768	0.0350
C54	RYCB705	HP-RYCB705	CONDUIT	2.0	-8.5309	0.0350
C55	HP-RYCB705	CB24	CONDUIT	2.0	29.1667	0.0350
C56	RYCB709	HP-RYCB09	CONDUIT	3.0	-10.0504	0.0350
C57	HP-RYCB09	CB19	CONDUIT	5.0	6.2120	0.0350
C58	OF-RYCB708	RY-1014b	CONDUIT	2.0	8.0257	0.0350
C59	MH800	MH801	CONDUIT	15.1	0.5298	0.0130
C6	CB23	HP-CB23	CONDUIT	15.2	-0.7895	0.0350
C64	RY-1015	RY-1016	CONDUIT	51.8	0.5019	0.0130
C65	RY-1016	RYCB709	CONDUIT	63.5	0.5039	0.0130
C66	RY-1014b	RY-1014a	CONDUIT	85.2	0.4930	0.0130
C67	RY-1001	RYCB701	CONDUIT	39.6	0.5051	0.0130
C68	RY-1002	RYCB701	CONDUIT	34.3	0.4956	0.0130
C69	RY-1005	RY-1006	CONDUIT	23.3	0.5150	0.0130
C7	HP-CB23	CB22	CONDUIT	15.4	0.9091	0.0350
C70	RY-1006	RYCB703	CONDUIT	6.1	0.4918	0.0130
C71	RY-1007	RYCB703	CONDUIT	3.0	0.3333	0.0130
C72	RY-1008	RY-1007	CONDUIT	68.1	0.4993	0.0130
C73	RYCB704	HP-RYCB704	CONDUIT	2.0	1.5002	0.0350
C74	HP-RYCB704	RY-1004	CONDUIT	2.0	16.2088	0.0350
C75	RY-1010	RY-1009	CONDUIT	61.0	0.5082	0.0130
C76	RY-1009	RYCB704	CONDUIT	11.5	0.5217	0.0130
C77	MH503	CB07/08	CONDUIT	3.3	2.7703	0.0160
C8	CB22	HP-CB22	CONDUIT	19.7	-0.7614	0.0350
C9	HP-CB22	CB21	CONDUIT	19.9	0.9046	0.0350
HP01	HP-CB09 (2)	CB07/08	CONDUIT	79.4	1.4611	0.0350
MH401b-MH401	MH401b	MH401	CONDUIT	13.5	0.2963	0.0130
OR-CB05/06	CB05/06	MH502	CONDUIT	1.6	1.2580	0.0130
OR-CB07/08	CB07/08	MH504	CONDUIT	1.1	0.9091	0.0130
OR-CB14/15	CB14/15	MH505	CONDUIT	20.6	1.0195	0.0130
OR-CB16	CB16	MH506	CONDUIT	6.5	0.9231	0.0130
OR-CB19	CB19	MH509	CONDUIT	6.5	1.0770	0.0130
OR-CB20	CB20	MH602	CONDUIT	3.7	1.0753	0.0130
OR-CB21	CB21	MH602	CONDUIT	4.2	0.9524	0.0130
OR-CB22	CB22	MH602	CONDUIT	2.4	0.8265	0.0130
OR-CB23	CB23	MH602	CONDUIT	3.3	0.9175	0.0130
OR-CB24	CB24	MH604	CONDUIT	5.0	1.0021	0.0130
OR-CB25	CB25	MH604	CONDUIT	4.5	0.8929	0.0130
OR-RYCB708	RYCB708	MH504	CONDUIT	7.9	0.5063	0.0130
OR-RYCB709	RYCB709	MH510	CONDUIT	10.5	0.4766	0.0130
OVF-Retirement	Retirement_Storage	OF-Retirement	CONDUIT	5.0	1.0001	0.0160
STM-213_(STM)	MH802	MH800	CONDUIT	62.2	0.4984	0.0130
STM-253_(STM)	MH405	MH404	CONDUIT	35.5	0.6479	0.0130
STM-254_(STM)	MH404	MH403	CONDUIT	91.8	0.2941	0.0130
STM-255_(STM)	MH403	MH402	CONDUIT	30.4	0.3289	0.0130
STM-256_(STM)	MH402	MH401b	CONDUIT	74.5	0.2953	0.0130
STM-257_(STM)	MH406	MH403	CONDUIT	69.4	0.2882	0.0130
STM-258_(STM)	MH407	MH406	CONDUIT	91.6	0.2948	0.0130
STM-260_(STM)	MH509	MH508	CONDUIT	28.1	0.2847	0.0130
STM-261_(1)_(1)_(STM)	MH506	MH505	CONDUIT	9.8	0.3061	0.0130
STM-261_(1)_(STM)	MH507	MH506	CONDUIT	79.7	0.3011	0.0130
STM-261_(STM)	MH508	MH507	CONDUIT	42.7	0.3045	0.0130
STM-267_(STM)	MH408	MH407	CONDUIT	35.5	0.6479	0.0130
STM-269_(STM)	MH510	MH509	CONDUIT	10.0	0.5000	0.0130
STM-291_(STM)	MH504	MH503	CONDUIT	66.0	0.3030	0.0130
STM-302_(1)_(STM)	MH603	MH602	CONDUIT	16.6	0.3021	0.0130
STM-302_(STM)	MH604	MH603	CONDUIT	61.8	0.3076	0.0130
STM-304_(STM)	MH602	MH601	CONDUIT	120.0	0.3000	0.0130
STM-316_(STM)_1	MH204	MH501Connection	CONDUIT	54.1	0.6470	0.0130
STM-316_(STM)_2	MH501Connection	MH203	CONDUIT	48.1	0.6445	0.0130
STM-317_(STM)	MH203	MH202	CONDUIT	100.9	0.2973	0.0130
STM-318_(1)_(STM)	MH202	MH201	CONDUIT	90.8	0.2974	0.0130
STM-319_(STM)	MH201	MH201Connection	CONDUIT	10.5	0.2857	0.0130
STM-324_(STM)	MH502	MH501	CONDUIT	29.5	0.3051	0.0130
STM-332_(STM)	MH205	MH203	CONDUIT	41.6	0.6491	0.0130
STM-400	MH600	OF-MH600	CONDUIT	26.0	0.4998	0.0130
OR-CB01/02	CB01/02	MH202	ORIFICE			
OR-CB03/04	CB03/04	MH203	ORIFICE			
OR-CB09	CB09	MH406	ORIFICE			

**Walkley-Conroy (122040)**  
**PCSWMM Model Output**  
**100yr 4-Hour Chicago, Fixed**



OR-CB10/11	CB10/11	MH404	ORIFICE
OR-CB12/13	CB12/13	MH405	ORIFICE
OR-MH501	MH501	MH501Connection	ORIFICE
OR-MH503	MH503	MH402	ORIFICE
OR-MH505	MH505	MH406	ORIFICE
OR-MH601	MH601	MH600	ORIFICE
OR-MH801	MH801	Park-OUT	ORIFICE
OR-RYCB701	RYCB701	MH202	ORIFICE
OR-RYCB702	RYCB702	MH202	ORIFICE
OR-RYCB703	RYCB703	MH203	ORIFICE
OR-RYCB704	RYCB704	MH203	ORIFICE
OR-RYCB705	RYCB705	MH205	ORIFICE
OR-CB17/18	CB17/18	MH508	OUTLET
OR-RetirementStorage	Retirement_Storage	Retirement-OUT	OUTLET

\*\*\*\*\*  
**Cross Section Summary**  
 \*\*\*\*\*

Conduit	Shape	Full Depth	Full Area	Hyd. Rad.	Max. Width	No. of Barrels	Full Flow
C1	CommercialAccess (North)	1.00	13.36	1.26	15.60	1	59764.25
C10	CommercialAccess (South)	1.00	7.95	0.90	9.90	1	16869.13
C11	CommercialAccess (South)	1.00	7.95	0.90	9.90	1	21767.92
C12	CommercialAccess (South)	1.00	7.95	0.90	9.90	1	19421.97
C13	CommercialAccess (South)	1.00	7.95	0.90	9.90	1	40844.52
C14	Street-1 (Park)	1.00	16.22	1.15	18.65	1	44394.46
C15	Street-1 (Park)	1.00	16.22	1.15	18.65	1	43304.80
C16	Street-2	1.00	16.17	0.46	19.00	1	64462.93
C17	Street-2	1.00	16.17	0.46	19.00	1	49673.64
C18	Street-2	1.00	16.17	0.46	19.00	1	77241.32
C19	Street-2	1.00	16.17	0.46	19.00	1	45796.68
C2	CommercialAccess (North)	1.00	13.36	1.26	15.60	1	40098.17
C20	Street-2	1.00	16.17	0.46	19.00	1	80467.24
C21	RECT_OPEN	1.00	3.00	0.60	3.00	1	26688.99
C21_1	RECT_OPEN	1.00	3.00	0.60	3.00	1	23403.96
C21_2	RECT_OPEN	1.00	3.00	0.60	3.00	1	23403.96
C21_3	RECT_OPEN	1.00	3.00	0.60	3.00	1	30438.55
C22	Street-2	1.00	16.17	0.46	19.00	1	51285.18
C23	Street-2	1.00	16.17	0.46	19.00	1	49759.21
C24	Street-2	1.00	16.17	0.46	19.00	1	63836.62
C25	RECT_OPEN	1.00	3.00	0.60	3.00	1	21094.35
C26	RECT_CLOSED	0.90	0.60	0.19	0.67	1	1094.55
C27	Street-2	1.00	16.17	0.46	19.00	1	45250.53
C28	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	18784.58
C29	Street-3 (North)	1.00	13.88	0.85	15.55	1	28789.52
C3	CommercialAccess (North)	1.00	13.36	1.26	15.60	1	37341.28
C30	Street-3 (North)	1.00	13.88	0.85	15.55	1	58206.74
C31	Street-3 (South)	1.00	17.40	0.45	20.50	1	57366.89
C32	Street-3 (South)	1.00	17.40	0.45	20.50	1	49770.21
C33	Street-3 (South)	1.00	17.40	0.45	20.50	1	53386.39
C34	RECT_OPEN	1.00	3.00	0.60	3.00	1	21094.35
C35	Street-3 (East)	1.00	14.87	0.86	16.40	1	32511.44
C36	Street-3 (East)	1.00	14.87	0.86	16.40	1	35876.31
C37	Street-3 (North)	1.00	13.88	0.85	15.55	1	30722.02
C38	Street-3 (North)	1.00	13.88	0.85	15.55	1	30339.60
C39	Street-3 (North)	1.00	13.88	0.85	15.55	1	42020.27
C4	CommercialAccess (North)	1.00	13.36	1.26	15.60	1	33456.84
C40	Street-1 (Park)	1.00	16.22	1.15	18.65	1	43820.04
C41	RECT_OPEN	1.00	3.00	0.60	3.00	1	22201.95
C42	RECT_CLOSED	0.90	0.60	0.19	0.67	1	1068.68
C43	CIRCULAR	0.60	0.28	0.15	0.60	1	354.52
C44	RECT_OPEN	1.00	3.00	0.60	3.00	1	23403.96
C45	RECT_CLOSED	0.55	0.21	0.11	0.39	1	272.65
C46	RECT_CLOSED	0.90	0.60	0.19	0.67	1	1090.67
C47	RECT_CLOSED	0.90	0.60	0.19	0.67	1	1101.57
C47_1	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	18304.43
C48	RECT_CLOSED	0.55	0.21	0.11	0.39	1	272.11
C49	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	13257.66
C5	CommercialAccess (South)	1.00	7.95	0.90	9.90	1	17291.12
C50	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	13906.58
C51	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	5925.45
C52	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	30746.54
C53	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	20160.65
C54	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	17306.41
C55	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	32000.27
C56	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	18784.58
C57	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	14768.09
C58	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	16786.20
C59	CIRCULAR	0.38	0.11	0.09	0.38	1	127.63
C6	CommercialAccess (South)	1.00	7.95	0.90	9.90	1	18851.34

C64	RECT_CLOSED	0.90	0.60	0.19	0.67	1	1093.91
C65	RECT_CLOSED	0.90	0.60	0.19	0.67	1	1096.10
C66	RECT_CLOSED	0.90	0.60	0.19	0.67	1	1084.09
C67	RECT_CLOSED	0.90	0.60	0.19	0.67	1	1097.31
C68	RECT_CLOSED	0.90	0.60	0.19	0.67	1	1087.02
C69	RECT_CLOSED	0.90	0.60	0.19	0.67	1	1108.09
C7	CommercialAccess (South)	1.00	7.95	0.90	9.90	1	20229.22
C70	RECT_CLOSED	0.90	0.60	0.19	0.67	1	1082.82
C71	RECT_CLOSED	0.90	0.60	0.19	0.67	1	891.45
C72	RECT_CLOSED	0.90	0.60	0.19	0.67	1	1091.01
C73	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	7257.39
C74	TRAPEZOIDAL	1.00	3.30	0.50	6.30	1	23855.35
C75	RECT_CLOSED	0.55	0.21	0.11	0.39	1	276.72
C76	RECT_CLOSED	0.55	0.21	0.11	0.39	1	280.38
C77	RECT_OPEN	1.00	3.00	0.60	3.00	1	22201.95
C8	CommercialAccess (South)	1.00	7.95	0.90	9.90	1	18513.37
C9	CommercialAccess (South)	1.00	7.95	0.90	9.90	1	20178.33
HP01	Street-3 (North)	1.00	13.88	0.85	15.55	1	42946.97
MH401b-MH401	CIRCULAR	0.60	0.28	0.15	0.60	1	334.25
OR-CB05/06	CIRCULAR	0.30	0.07	0.07	0.30	1	108.47
OR-CB07/08	CIRCULAR	0.30	0.07	0.07	0.30	1	92.21
OR-CB14/15	CIRCULAR	0.30	0.07	0.07	0.30	1	97.64
OR-CB16	CIRCULAR	0.30	0.07	0.07	0.30	1	92.91
OR-CB19	CIRCULAR	0.30	0.07	0.07	0.30	1	100.36
OR-CB20	CIRCULAR	0.20	0.03	0.05	0.20	1	34.01
OR-CB21	CIRCULAR	0.20	0.03	0.05	0.20	1	32.01
OR-CB22	CIRCULAR	0.20	0.03	0.05	0.20	1	29.82
OR-CB23	CIRCULAR	0.20	0.03	0.05	0.20	1	31.42
OR-CB24	CIRCULAR	0.20	0.03	0.05	0.20	1	32.83
OR-CB25	CIRCULAR	0.20	0.03	0.05	0.20	1	30.99
OR-RYCB708	CIRCULAR	0.60	0.28	0.15	0.60	1	436.94
OR-RYCB709	CIRCULAR	0.60	0.28	0.15	0.60	1	423.94
OVF-Retirement	RECT_OPEN	1.00	3.00	0.60	3.00	1	13339.49
STM-213_(STM)	CIRCULAR	0.38	0.11	0.09	0.38	1	123.79
STM-253_(STM)	CIRCULAR	0.30	0.07	0.07	0.30	1	77.84
STM-254_(STM)	CIRCULAR	0.45	0.16	0.11	0.45	1	154.63
STM-255_(STM)	CIRCULAR	0.53	0.22	0.13	0.53	1	246.67
STM-256_(STM)	CIRCULAR	0.60	0.28	0.15	0.60	1	333.69
STM-257_(STM)	CIRCULAR	0.45	0.16	0.11	0.45	1	153.06
STM-258_(STM)	CIRCULAR	0.25	0.05	0.06	0.25	1	32.29
STM-260_(STM)	CIRCULAR	1.05	0.87	0.26	1.05	1	1457.13
STM-261_(1)_1_(STM)	CIRCULAR	1.05	0.87	0.26	1.05	1	1510.96
STM-261_(1)_2_(STM)	CIRCULAR	1.05	0.87	0.26	1.05	1	1498.59
STM-261_(1)_3_(STM)	CIRCULAR	1.05	0.87	0.26	1.05	1	1506.83
STM-267_(STM)	CIRCULAR	0.25	0.05	0.06	0.25	1	47.87
STM-269_(STM)	CIRCULAR	0.60	0.28	0.15	0.60	1	434.20
STM-291_(STM)	CIRCULAR	0.82	0.53	0.21	0.82	1	790.23
STM-302_(1)_1_(STM)	CIRCULAR	0.45	0.16	0.11	0.45	1	156.72
STM-302_(STM)	CIRCULAR	0.45	0.16	0.11	0.45	1	158.13
STM-304_(STM)	CIRCULAR	0.45	0.16	0.11	0.45	1	156.17
STM-316_(STM)_1	CIRCULAR	0.38	0.11	0.09	0.38	1	141.03
STM-316_(STM)_2	CIRCULAR	0.38	0.11	0.09	0.38	1	140.77
STM-317_(STM)	CIRCULAR	0.45	0.16	0.11	0.45	1	155.47
STM-318_(1)_1_(STM)	CIRCULAR	0.53	0.22	0.13	0.53	1	234.53
STM-319_(STM)	CIRCULAR	0.53	0.22	0.13	0.53	1	229.89
STM-324_(STM)	CIRCULAR	0.60	0.28	0.15	0.60	1	339.17
STM-332_(STM)	CIRCULAR	0.30	0.07	0.07	0.30	1	77.91
STM-400	CIRCULAR	0.45	0.16	0.11	0.45	1	201.58

\*\*\*\*\*  
**Transect Summary**  
 \*\*\*\*\*

Transect CommercialAccess (North)					
Area:	0.0008	0.0031	0.0069	0.0123	0.0192
	0.0277	0.0376	0.0494	0.0639	0.0808
	0.0992	0.1192	0.1407	0.1630	0.1853
	0.2076	0.2300	0.2532	0.2766	0.2999
	0.3232	0.3465	0.3699	0.3932	0.4165
	0.4398	0.4632	0.4865	0.5098	0.5332
	0.5565	0.5798	0.6032	0.6265	0.6498
	0.6732	0.6965	0.7199	0.7432	0.7665
	0.7899	0.8132	0.8366	0.8599	0.8833
	0.9066	0.9300	0.9533	0.9767	1.0000
Hrad:	0.0079	0.0158	0.0236	0.0315	0.0394
	0.0473	0.0551	0.0629	0.0702	0.0854
	0.1011	0.1175	0.1345	0.1567	0.1800
	0.2039	0.2232	0.2429	0.2676	0.2924
	0.3173	0.3421	0.3669	0.3916	0.4163

**Walkley-Conroy (122040)**  
**PCSWMM Model Output**  
**100yr 4-Hour Chicago, Fixed**

	0.4409	0.4654	0.4898	0.5141	0.5383
	0.5624	0.5864	0.6104	0.6342	0.6578
	0.6814	0.7049	0.7283	0.7515	0.7746
	0.7977	0.8206	0.8434	0.8661	0.8887
	0.9112	0.9335	0.9558	0.9780	1.0000
Width:	0.0658	0.1316	0.1974	0.2632	0.3291
	0.3949	0.4607	0.5588	0.6892	0.7556
	0.8220	0.8884	0.9548	0.9549	0.9550
	0.9551	0.9770	0.9988	0.9989	0.9989
	0.9989	0.9990	0.9990	0.9990	0.9991
	0.9991	0.9991	0.9992	0.9992	0.9993
	0.9993	0.9993	0.9994	0.9994	0.9994
	0.9995	0.9995	0.9996	0.9996	0.9996
	0.9997	0.9997	0.9997	0.9998	0.9998
	0.9999	0.9999	0.9999	1.0000	1.0000

Transect CommercialAccess (South)

Area:

	0.0013	0.0050	0.0113	0.0202	0.0315
	0.0453	0.0617	0.0794	0.0972	0.1153
	0.1340	0.1528	0.1718	0.1910	0.2104
	0.2300	0.2497	0.2696	0.2897	0.3100
	0.3304	0.3511	0.3719	0.3929	0.4141
	0.4354	0.4570	0.4787	0.5006	0.5227
	0.5449	0.5674	0.5900	0.6128	0.6358
	0.6590	0.6823	0.7058	0.7295	0.7534
	0.7775	0.8017	0.8261	0.8508	0.8755
	0.9004	0.9253	0.9502	0.9751	1.0000

Hrad:

	0.0108	0.0217	0.0325	0.0433	0.0541
	0.0650	0.0758	0.0970	0.1182	0.1361
	0.1572	0.1782	0.1992	0.2201	0.2411
	0.2621	0.2831	0.3041	0.3251	0.3462
	0.3672	0.3882	0.4093	0.4304	0.4515
	0.4726	0.4937	0.5148	0.5360	0.5572
	0.5784	0.5996	0.6208	0.6421	0.6633
	0.6846	0.7059	0.7273	0.7486	0.7700
	0.7914	0.8128	0.8342	0.8557	0.8772
	0.9018	0.9265	0.9510	0.9756	1.0000

Width:

	0.1011	0.2023	0.3034	0.4046	0.5057
	0.6069	0.7080	0.7121	0.7197	0.7453
	0.7526	0.7598	0.7671	0.7743	0.7815
	0.7888	0.7960	0.8033	0.8105	0.8178
	0.8250	0.8322	0.8395	0.8467	0.8540
	0.8612	0.8685	0.8757	0.8830	0.8902
	0.8974	0.9047	0.9119	0.9192	0.9264
	0.9337	0.9409	0.9482	0.9554	0.9626
	0.9699	0.9771	0.9844	0.9916	0.9989
	0.9991	0.9993	0.9995	0.9998	1.0000

Transect NoCurbStreet

Area:

	0.0009	0.0035	0.0081	0.0153	0.0252
	0.0363	0.0485	0.0617	0.0760	0.0914
	0.1078	0.1253	0.1438	0.1634	0.1841
	0.2055	0.2275	0.2499	0.2729	0.2963
	0.3197	0.3431	0.3666	0.3900	0.4135
	0.4369	0.4604	0.4838	0.5073	0.5307
	0.5542	0.5776	0.6011	0.6246	0.6480
	0.6715	0.6949	0.7184	0.7419	0.7653
	0.7888	0.8122	0.8357	0.8592	0.8826
	0.9061	0.9296	0.9531	0.9765	1.0000

Hrad:

	0.0172	0.0344	0.0508	0.0641	0.0841
	0.1094	0.1327	0.1544	0.1746	0.1937
	0.2117	0.2289	0.2453	0.2610	0.2762
	0.2939	0.3117	0.3294	0.3470	0.3660
	0.3867	0.4076	0.4286	0.4498	0.4711
	0.4924	0.5138	0.5352	0.5566	0.5780
	0.5994	0.6208	0.6422	0.6635	0.6849
	0.7062	0.7274	0.7487	0.7698	0.7910
	0.8121	0.8332	0.8542	0.8751	0.8961
	0.9170	0.9378	0.9586	0.9793	1.0000

Width:

	0.0754	0.1507	0.2485	0.3686	0.4512
	0.4964	0.5416	0.5867	0.6319	0.6770
	0.7222	0.7674	0.8125	0.8577	0.9029
	0.9242	0.9454	0.9667	0.9880	0.9987
	0.9987	0.9988	0.9988	0.9989	0.9989
	0.9990	0.9990	0.9990	0.9991	0.9991

	0.9992	0.9992	0.9993	0.9993	0.9993
	0.9994	0.9994	0.9995	0.9995	0.9996
	0.9996	0.9997	0.9997	0.9997	0.9998
	0.9998	0.9999	0.9999	1.0000	1.0000

Transect OnesideCurb-17m

Area:

	0.0009	0.0037	0.0085	0.0173	0.0301
	0.0461	0.0642	0.0835	0.1038	0.1251
	0.1470	0.1688	0.1907	0.2126	0.2344
	0.2563	0.2781	0.3000	0.3219	0.3437
	0.3656	0.3875	0.4093	0.4312	0.4531
	0.4749	0.4968	0.5187	0.5406	0.5624
	0.5843	0.6062	0.6280	0.6499	0.6718
	0.6937	0.7156	0.7374	0.7593	0.7812
	0.8031	0.8249	0.8468	0.8687	0.8906
	0.9125	0.9343	0.9562	0.9781	1.0000

Hrad:

	0.0161	0.0321	0.0464	0.0553	0.0646
	0.0844	0.1034	0.1230	0.1420	0.1605
	0.1815	0.2029	0.2245	0.2462	0.2679
	0.2897	0.3115	0.3333	0.3550	0.3767
	0.3983	0.4199	0.4414	0.4629	0.4843
	0.5057	0.5270	0.5482	0.5694	0.5905
	0.6115	0.6325	0.6534	0.6743	0.6951
	0.7159	0.7365	0.7572	0.7777	0.7982
	0.8187	0.8390	0.8594	0.8796	0.8998
	0.9200	0.9401	0.9601	0.9801	1.0000

Width:

	0.0836	0.1673	0.3040	0.4939	0.6809
	0.7820	0.8563	0.9038	0.9513	0.9989
	0.9989	0.9989	0.9989	0.9990	0.9990
	0.9990	0.9991	0.9991	0.9991	0.9991
	0.9992	0.9992	0.9992	0.9993	0.9993
	0.9993	0.9993	0.9994	0.9994	0.9994
	0.9995	0.9995	0.9995	0.9995	0.9996
	0.9996	0.9996	0.9997	0.9997	0.9997
	0.9997	0.9998	0.9998	0.9998	0.9999
	0.9999	0.9999	0.9999	1.0000	1.0000

Transect OnseSideCurb-20.6m

Area:

	0.0009	0.0035	0.0080	0.0151	0.0249
	0.0361	0.0484	0.0617	0.0760	0.0914
	0.1077	0.1252	0.1436	0.1631	0.1836
	0.2052	0.2277	0.2508	0.2742	0.2976
	0.3210	0.3444	0.3678	0.3912	0.4146
	0.4381	0.4615	0.4849	0.5083	0.5317
	0.5551	0.5785	0.6019	0.6253	0.6487
	0.6721	0.6956	0.7190	0.7424	0.7658
	0.7892	0.8126	0.8361	0.8595	0.8829
	0.9063	0.9297	0.9532	0.9766	1.0000

Hrad:

	0.0172	0.0343	0.0511	0.0649	0.0845
	0.1094	0.1326	0.1542	0.1745	0.1937
	0.2118	0.2292	0.2457	0.2616	0.2770
	0.2918	0.3075	0.3244	0.3446	0.3652
	0.3860	0.4070	0.4282	0.4494	0.4708
	0.4922	0.5136	0.5351	0.5565	0.5780
	0.5994	0.6208	0.6422	0.6636	0.6849
	0.7062	0.7275	0.7487	0.7699	0.7911
	0.8122	0.8332	0.8542	0.8752	0.8961
	0.9170	0.9378	0.9586	0.9793	1.0000

Width:

	0.0757	0.1514	0.2375	0.3644	0.4537
	0.5016	0.5456	0.5897	0.6337	0.6778
	0.7218	0.7659	0.8099	0.8540	0.8980
	0.9421	0.9757	0.9991	0.9991	0.9991
	0.9991	0.9992	0.9992	0.9992	0.9993
	0.9993	0.9993	0.9993	0.9994	0.9994
	0.9994	0.9995	0.9995	0.9995	0.9996
	0.9996	0.9996	0.9996	0.9997	0.9997
	0.9997	0.9998	0.9998	0.9998	0.9999
	0.9999	0.9999	0.9999	1.0000	1.0000

Transect Street-1 (Park)

Area:

	0.0008	0.0032	0.0074	0.0144	0.0244
	0.0365	0.0500	0.0648	0.0810	0.0986
	0.1171	0.1363	0.1561	0.1765	0.1976
	0.2193	0.2417	0.2646	0.2875	0.3105
	0.3335	0.3565	0.3794	0.4024	0.4254

**Walkley-Conroy (122040)  
PCSWMM Model Output  
100yr 4-Hour Chicago, Fixed**

	0.4484	0.4713	0.4943	0.5173	0.5403
	0.5632	0.5862	0.6092	0.6322	0.6552
	0.6782	0.7011	0.7241	0.7471	0.7701
	0.7931	0.8161	0.8391	0.8621	0.8850
	0.9080	0.9310	0.9540	0.9770	1.0000

Hrad:	0.0085	0.0169	0.0242	0.0323	0.0423
	0.0587	0.0753	0.0919	0.1085	0.1252
	0.1466	0.1677	0.1885	0.2088	0.2287
	0.2481	0.2670	0.2883	0.3123	0.3361
	0.3598	0.3834	0.4069	0.4302	0.4535
	0.4766	0.4996	0.5225	0.5453	0.5680
	0.5906	0.6130	0.6354	0.6576	0.6798
	0.7018	0.7238	0.7456	0.7673	0.7890
	0.8105	0.8320	0.8533	0.8745	0.8957
	0.9167	0.9377	0.9586	0.9793	1.0000

Width:	0.0701	0.1403	0.2397	0.3686	0.4974
	0.5565	0.6157	0.6748	0.7339	0.7930
	0.8205	0.8480	0.8754	0.9029	0.9304
	0.9578	0.9853	0.9990	0.9991	0.9991
	0.9991	0.9992	0.9992	0.9992	0.9993
	0.9993	0.9993	0.9993	0.9994	0.9994
	0.9994	0.9995	0.9995	0.9995	0.9996
	0.9996	0.9996	0.9996	0.9997	0.9997
	0.9997	0.9998	0.9998	0.9998	0.9999
	0.9999	0.9999	0.9999	1.0000	1.0000

Transect Street-2					
Area:	0.0008	0.0032	0.0074	0.0141	0.0234
	0.0346	0.0467	0.0599	0.0742	0.0894
	0.1057	0.1230	0.1414	0.1607	0.1811
	0.2025	0.2250	0.2483	0.2718	0.2953
	0.3188	0.3422	0.3657	0.3892	0.4127
	0.4362	0.4597	0.4831	0.5066	0.5301
	0.5536	0.5771	0.6006	0.6241	0.6476
	0.6710	0.6945	0.7180	0.7415	0.7650
	0.7885	0.8120	0.8355	0.8590	0.8825
	0.9060	0.9295	0.9530	0.9765	1.0000

Hrad:	0.0213	0.0425	0.0627	0.0781	0.0925
	0.1226	0.1499	0.1747	0.1975	0.2186
	0.2383	0.2566	0.2739	0.2902	0.3056
	0.3203	0.3344	0.3504	0.3692	0.3885
	0.4082	0.4281	0.4482	0.4685	0.4889
	0.5094	0.5299	0.5505	0.5711	0.5917
	0.6124	0.6330	0.6536	0.6742	0.6948
	0.7154	0.7359	0.7565	0.7769	0.7974
	0.8178	0.8382	0.8586	0.8789	0.8992
	0.9194	0.9396	0.9598	0.9799	1.0000

Width:	0.0688	0.1377	0.2282	0.3403	0.4525
	0.4962	0.5399	0.5836	0.6273	0.6711
	0.7148	0.7585	0.8022	0.8459	0.8896
	0.9334	0.9771	0.9990	0.9990	0.9990
	0.9991	0.9991	0.9991	0.9992	0.9992
	0.9992	0.9993	0.9993	0.9993	0.9994
	0.9994	0.9994	0.9994	0.9995	0.9995
	0.9995	0.9996	0.9996	0.9996	0.9997
	0.9997	0.9997	0.9998	0.9998	0.9998
	0.9999	0.9999	0.9999	1.0000	1.0000

Transect Street-3 (East)					
Area:	0.0015	0.0061	0.0139	0.0250	0.0396
	0.0566	0.0742	0.0922	0.1106	0.1294
	0.1487	0.1684	0.1885	0.2090	0.2298
	0.2511	0.2727	0.2947	0.3167	0.3388
	0.3608	0.3828	0.4049	0.4269	0.4489
	0.4710	0.4930	0.5150	0.5371	0.5591
	0.5811	0.6032	0.6252	0.6473	0.6693
	0.6913	0.7134	0.7354	0.7575	0.7795
	0.8016	0.8236	0.8457	0.8677	0.8897
	0.9118	0.9338	0.9559	0.9779	1.0000

Hrad:	0.0114	0.0229	0.0338	0.0447	0.0559
	0.0748	0.0957	0.1162	0.1362	0.1558
	0.1751	0.1940	0.2126	0.2314	0.2499
	0.2681	0.2861	0.3063	0.3288	0.3513
	0.3736	0.3960	0.4182	0.4405	0.4626
	0.4847	0.5068	0.5288	0.5508	0.5727

	0.5945	0.6163	0.6381	0.6598	0.6814
	0.7030	0.7245	0.7460	0.7675	0.7889
	0.8102	0.8315	0.8527	0.8739	0.8951
	0.9161	0.9372	0.9582	0.9791	1.0000

Width:	0.1394	0.2788	0.4267	0.5832	0.7398
	0.7879	0.8068	0.8258	0.8447	0.8637
	0.8826	0.9015	0.9205	0.9379	0.9553
	0.9727	0.9901	0.9989	0.9989	0.9989
	0.9990	0.9990	0.9990	0.9991	0.9991
	0.9992	0.9992	0.9992	0.9993	0.9993
	0.9993	0.9994	0.9994	0.9994	0.9995
	0.9995	0.9995	0.9996	0.9996	0.9996
	0.9997	0.9997	0.9998	0.9998	0.9998
	0.9999	0.9999	0.9999	1.0000	1.0000

Transect Street-3 (North)					
Area:	0.0017	0.0068	0.0151	0.0260	0.0395
	0.0545	0.0702	0.0865	0.1035	0.1210
	0.1392	0.1580	0.1774	0.1974	0.2180
	0.2392	0.2610	0.2833	0.3057	0.3280
	0.3504	0.3728	0.3952	0.4176	0.4400
	0.4624	0.4848	0.5072	0.5296	0.5519
	0.5743	0.5967	0.6191	0.6415	0.6639
	0.6863	0.7087	0.7311	0.7535	0.7759
	0.7983	0.8207	0.8431	0.8655	0.8880
	0.9104	0.9328	0.9552	0.9776	1.0000

Hrad:	0.0117	0.0233	0.0365	0.0506	0.0640
	0.0829	0.1024	0.1213	0.1397	0.1576
	0.1754	0.1929	0.2100	0.2269	0.2434
	0.2596	0.2756	0.2950	0.3179	0.3408
	0.3636	0.3863	0.4090	0.4316	0.4541
	0.4766	0.4991	0.5215	0.5438	0.5661
	0.5883	0.6104	0.6325	0.6546	0.6766
	0.6985	0.7204	0.7422	0.7640	0.7857
	0.8074	0.8290	0.8506	0.8721	0.8935
	0.9149	0.9363	0.9576	0.9788	1.0000

Width:	0.1507	0.3015	0.4328	0.5448	0.6567
	0.6850	0.7134	0.7417	0.7701	0.7984
	0.8251	0.8518	0.8786	0.9053	0.9320
	0.9587	0.9855	0.9989	0.9989	0.9989
	0.9990	0.9990	0.9990	0.9991	0.9991
	0.9991	0.9992	0.9992	0.9992	0.9993
	0.9993	0.9994	0.9994	0.9994	0.9995
	0.9995	0.9995	0.9996	0.9996	0.9996
	0.9997	0.9997	0.9997	0.9998	0.9998
	0.9999	0.9999	0.9999	1.0000	1.0000

Transect Street-3 (South)					
Area:	0.0008	0.0031	0.0071	0.0136	0.0226
	0.0335	0.0455	0.0585	0.0725	0.0876
	0.1038	0.1210	0.1393	0.1586	0.1790
	0.2004	0.2229	0.2463	0.2698	0.2934
	0.3169	0.3405	0.3640	0.3876	0.4111
	0.4347	0.4582	0.4818	0.5053	0.5289
	0.5524	0.5760	0.5995	0.6231	0.6466
	0.6702	0.6937	0.7173	0.7408	0.7644
	0.7879	0.8115	0.8351	0.8586	0.8822
	0.9057	0.9293	0.9529	0.9764	1.0000

Hrad:	0.0217	0.0435	0.0639	0.0792	0.0935
	0.1236	0.1507	0.1752	0.1978	0.2185
	0.2378	0.2558	0.2727	0.2886	0.3038
	0.3182	0.3319	0.3477	0.3666	0.3859
	0.4056	0.4255	0.4457	0.4660	0.4865
	0.5070	0.5276	0.5482	0.5689	0.5896
	0.6103	0.6310	0.6517	0.6724	0.6931
	0.7138	0.7344	0.7550	0.7756	0.7962
	0.8167	0.8372	0.8577	0.8782	0.8986
	0.9189	0.9392	0.9595	0.9798	1.0000

Width:	0.0658	0.1315	0.2194	0.3296	0.4397
	0.4844	0.5292	0.5739	0.6187	0.6634
	0.7082	0.7529	0.7977	0.8424	0.8872
	0.9319	0.9767	0.9990	0.9991	0.9991
	0.9991	0.9992	0.9992	0.9992	0.9992
	0.9993	0.9993	0.9993	0.9994	0.9994
	0.9994	0.9995	0.9995	0.9995	0.9995

**Walkley-Conroy (122040)**  
**PCSWMM Model Output**  
**100yr 4-Hour Chicago, Fixed**

```

0.9996 0.9996 0.9996 0.9997 0.9997
0.9997 0.9998 0.9998 0.9998 0.9998
0.9999 0.9999 0.9999 1.0000 1.0000

```

```

*****
Analysis Options
*****
Flow Units ..... LPS
Process Models:
  Rainfall/Runoff ..... YES
  RDII ..... NO
  Snowmelt ..... NO
  Groundwater ..... NO
  Flow Routing ..... YES
  Ponding Allowed ..... NO
  Water Quality ..... NO
Infiltration Method ..... HORTON
Flow Routing Method ..... DYNWAVE
Surcharge Method ..... EXTRAN
Starting Date ..... 07/13/2023 00:00:00
Ending Date ..... 07/14/2023 00:00:00
Antecedent Dry Days ..... 0.0
Report Time Step ..... 00:05:00
Wet Time Step ..... 00:01:00
Dry Time Step ..... 00:01:00
Routing Time Step ..... 1.00 sec
Variable Time Step ..... YES
Maximum Trials ..... 8
Number of Threads ..... 8
Head Tolerance ..... 0.001500 m

```

```

*****
Volume      Depth
Runoff Quantity Continuity  hectare-m  mm
*****
Total Precipitation ..... 0.448 76.002
Evaporation Loss ..... 0.000 0.000
Infiltration Loss ..... 0.108 18.335
Surface Runoff ..... 0.338 57.292
Final Storage ..... 0.003 0.463
Continuity Error (%) ..... -0.116

```

```

*****
Volume      Volume
Flow Routing Continuity  hectare-m  10^6 ltr
*****
Dry Weather Inflow ..... 0.000 0.000
Wet Weather Inflow ..... 0.338 3.381
Groundwater Inflow ..... 0.000 0.000
RDII Inflow ..... 0.000 0.000
External Inflow ..... 0.002 0.019
External Outflow ..... 0.340 3.398
Flooding Loss ..... 0.000 0.000
Evaporation Loss ..... 0.000 0.000
Exfiltration Loss ..... 0.000 0.000
Initial Stored Volume .... 0.015 0.147
Final Stored Volume ..... 0.015 0.147
Continuity Error (%) ..... 0.031

```

```

*****
Time-Step Critical Elements
*****
Link OR-CB07/08 (6.15%)

```

```

*****
Highest Flow Instability Indexes
*****
Link OR-MH801 (120)
Link OR-MH601 (5)

```

```

*****
Most Frequent Nonconverging Nodes
*****
Convergence obtained at all time steps.

```

```

*****
Routing Time Step Summary

```

```

*****
Minimum Time Step : 0.50 sec
Average Time Step : 0.98 sec
Maximum Time Step : 1.00 sec
% of Time in Steady State : 0.00
Average Iterations per Step : 2.00
% of Steps Not Converging : 0.00
Time Step Frequencies :
  1.000 - 0.871 sec : 93.69 %
  0.871 - 0.758 sec : 1.12 %
  0.758 - 0.660 sec : 1.62 %
  0.660 - 0.574 sec : 1.05 %
  0.574 - 0.500 sec : 2.52 %

```

```

*****
Subcatchment Runoff Summary
*****

```

-----			Total	Total	Total	Total	Imperv	Perv	Total
Runoff	Peak	Runoff	Precip	Runon	Evap	Infil	Runoff	Runoff	Runoff
Subcatchment			mm	mm	mm	mm	mm	mm	mm
10^6 ltr									
-----			-----						
A-01			76.00	0.00	0.00	25.19	35.85	15.05	50.90
0.08	66.79	0.670	76.00	0.00	0.00	9.45	60.26	5.77	66.04
A-02			76.00	0.00	0.00	9.45	60.26	5.77	66.03
0.11	79.57	0.869	76.00	0.00	0.00	30.11	28.24	17.74	45.97
A-03			76.00	0.00	0.00	26.49	33.72	15.89	49.61
0.10	75.20	0.869	76.00	0.00	0.00	12.16	55.97	7.40	63.38
A-04			76.00	0.00	0.00	11.50	57.03	6.99	64.02
0.12	104.06	0.605	76.00	0.00	0.00	25.22	35.85	15.02	50.87
A-05			76.00	0.00	0.00	8.76	60.68	5.41	66.09
0.05	46.19	0.653	76.00	0.00	0.00	10.84	58.08	6.59	64.67
A-06			76.00	0.00	0.00	24.52	36.99	14.58	51.57
0.09	71.17	0.834	76.00	0.00	0.00	10.82	58.08	6.61	64.69
A-07			76.00	0.00	0.00	12.14	55.39	7.42	62.81
0.09	66.46	0.842	76.00	0.00	0.00	27.25	32.65	16.18	48.83
A-08			76.00	0.00	0.00	10.10	59.21	6.20	65.41
0.14	116.82	0.669	76.00	0.00	0.00	8.79	61.32	5.37	66.69
A-09			76.00	0.00	0.00	10.12	59.21	6.17	65.38
0.04	31.46	0.870	76.00	0.00	0.00	9.45	60.26	5.77	66.03
A-10			76.00	0.00	0.00	8.79	61.32	5.37	66.69
0.12	91.99	0.851	76.00	0.00	0.00	22.44	40.27	13.39	53.65
A-11			76.00	0.00	0.00	12.85	54.91	7.77	62.68
0.12	102.71	0.679	76.00	0.00	0.00	0.06	46.40	0.826	48.83
B-01			76.00	0.00	0.00	10.10	59.21	6.20	65.41
0.10	74.42	0.851	76.00	0.00	0.00	16.85	48.43	10.33	58.76
B-02			76.00	0.00	0.00	30.69	0.773	7.07	63.49
0.06	46.40	0.826	76.00	0.00	0.00	10.09	0.835	8.06	62.45
B-05			76.00	0.00	0.00	28.60	0.887	2.02	71.34
0.10	91.40	0.643	76.00	0.00	0.00	0.03	23.68	0.955	72.60
B-06			76.00	0.00	0.00	0.09	67.08	0.851	64.67
0.08	55.41	0.861	76.00	0.00	0.00				
B-07			76.00	0.00	0.00				
0.08	57.02	0.877	76.00	0.00	0.00				
B-08			76.00	0.00	0.00				
0.07	51.45	0.860	76.00	0.00	0.00				
B-09			76.00	0.00	0.00				
0.09	66.04	0.869	76.00	0.00	0.00				
B-10			76.00	0.00	0.00				
0.10	73.93	0.877	76.00	0.00	0.00				
B-11			76.00	0.00	0.00				
0.19	155.97	0.706	76.00	0.00	0.00				
B-12			76.00	0.00	0.00				
0.06	46.93	0.825	76.00	0.00	0.00				
B-13			76.00	0.00	0.00				
0.04	30.69	0.773	76.00	0.00	0.00				
B-14			76.00	0.00	0.00				
0.01	10.09	0.835	76.00	0.00	0.00				
B-15			76.00	0.00	0.00				
0.04	28.60	0.887	76.00	0.00	0.00				
B-16			76.00	0.00	0.00				
0.03	23.68	0.955	76.00	0.00	0.00				
B-17			76.00	0.00	0.00				
0.09	67.08	0.851	76.00	0.00	0.00				

**Walkley-Conroy (122040)**  
**PCSWMM Model Output**  
**100yr 4-Hour Chicago, Fixed**

B-18	0.04	29.43	0.808	76.00	0.00	0.00	14.19	52.73	8.65	61.38
B-19	0.04	32.49	0.879	76.00	0.00	0.00	8.06	61.80	4.97	66.77
C-01	0.05	39.13	0.869	76.00	0.00	0.00	8.79	60.68	5.37	66.04
C-02	0.04	33.79	0.818	76.00	0.00	0.00	12.83	54.35	7.79	62.14
C-03	0.02	17.52	0.792	76.00	0.00	0.00	14.85	51.14	9.04	60.18
C-04	0.02	16.70	0.818	76.00	0.00	0.00	12.81	54.35	7.82	62.17
C-05	0.02	14.86	0.835	76.00	0.00	0.00	11.48	56.43	7.02	63.46
C-06	0.02	16.74	0.826	76.00	0.00	0.00	12.14	55.39	7.42	62.81
D-01	0.00	5.32	0.534	76.00	0.00	0.00	35.14	19.13	21.42	40.55
D-02	0.01	6.49	0.599	76.00	0.00	0.00	29.95	27.65	17.90	45.55
D-03	0.00	3.12	0.635	76.00	0.00	0.00	27.13	31.97	16.32	48.29
D-04	0.00	0.86	0.380	76.00	0.00	0.00	47.24	0.00	28.88	28.88
D-05	0.02	22.95	0.455	76.00	0.00	0.00	41.32	9.60	24.96	34.57
EX-01	0.01	10.26	0.380	76.00	0.00	0.00	47.24	0.00	28.88	28.88
PARK	0.16	81.58	0.358	76.00	0.00	0.00	48.70	5.29	21.92	27.21
RETIREMENT	0.70	486.75	0.902	76.00	0.00	0.00	6.85	64.51	4.03	68.54

\*\*\*\*\*  
Node Depth Summary  
\*\*\*\*\*

Node	Type	Average Depth Meters	Maximum Depth Meters	Maximum HGL Meters	Time of Max Occurrence days hr:min	Reported Max Depth Meters
HP-CB01/02	JUNCTION	0.00	0.00	85.16	0 00:00	0.00
HP-CB03/04	JUNCTION	0.00	0.00	86.09	0 00:00	0.00
HP-CB05/06	JUNCTION	0.00	0.00	86.64	0 00:00	0.00
HP-CB05/06 (2)	JUNCTION	0.00	0.00	86.48	0 00:00	0.00
HP-CB07/08	JUNCTION	0.00	0.00	85.18	0 00:00	0.00
HP-CB09	JUNCTION	0.00	0.01	86.17	0 01:30	0.01
HP-CB09 (2)	JUNCTION	0.00	0.00	86.21	0 00:00	0.00
HP-CB10/11	JUNCTION	0.00	0.01	86.16	0 01:32	0.01
HP-CB12/13	JUNCTION	0.00	0.01	85.87	0 01:31	0.01
HP-CB14/15	JUNCTION	0.00	0.00	86.64	0 00:00	0.00
HP-CB14/15 (2)	JUNCTION	0.00	0.00	86.64	0 00:00	0.00
HP-CB16	JUNCTION	0.00	0.00	86.58	0 00:00	0.00
HP-CB16 (2)	JUNCTION	0.00	0.00	86.64	0 00:00	0.00
HP-CB19	JUNCTION	0.00	0.00	85.79	0 00:00	0.00
HP-CB20	JUNCTION	0.00	0.01	85.44	0 01:42	0.01
HP-CB21	JUNCTION	0.00	0.00	85.46	0 00:00	0.00
HP-CB22	JUNCTION	0.00	0.00	85.53	0 00:00	0.00
HP-CB23	JUNCTION	0.00	0.00	85.52	0 00:00	0.00
HP-CB24	JUNCTION	0.00	0.00	85.58	0 00:00	0.00
HP-CB25	JUNCTION	0.00	0.00	85.59	0 00:00	0.00
HP-CB25 (2)	JUNCTION	0.00	0.00	85.77	0 00:00	0.00
HP-MH509	JUNCTION	0.00	0.00	85.95	0 00:00	0.00
HP-RY-1005	JUNCTION	0.00	0.00	85.86	0 00:00	0.00
HP-RYCB09	JUNCTION	0.00	0.00	86.00	0 00:00	0.00
HP-RYCB704	JUNCTION	0.00	0.00	85.76	0 00:00	0.00
HP-RYCB705	JUNCTION	0.00	0.00	85.97	0 00:00	0.00
HP-RYCB802	JUNCTION	0.00	0.00	85.67	0 00:00	0.00
D01-OUT	OUTFALL	0.00	0.00	86.40	0 00:00	0.00
D04-05-OUT	OUTFALL	0.00	0.00	85.30	0 00:00	0.00
DR02-03-OUT	OUTFALL	0.00	0.00	85.00	0 00:00	0.00
HP-MH509-OUT	OUTFALL	0.00	0.00	85.25	0 00:00	0.00
HP-RY-1001	OUTFALL	0.00	0.00	85.21	0 00:00	0.00
HP-RY-1003	OUTFALL	0.00	0.00	85.25	0 00:00	0.00
MH201Connection	OUTFALL	1.38	1.38	82.36	0 00:00	1.38
MH401Connection	OUTFALL	1.67	1.67	82.33	0 00:00	1.67
OF-DonReidDr	OUTFALL	0.00	0.00	86.41	0 00:00	0.00
OF-MH600	OUTFALL	0.96	0.96	83.96	0 00:00	0.96
OF-MJ-CommercialRoad	OUTFALL	0.00	0.01	85.14	0 01:42	0.00
OF-Retirement	OUTFALL	0.00	0.00	87.25	0 00:00	0.00

OF-RYCB708	OUTFALL	0.00	0.00	85.16	0 00:00	0.00
OF-StLaurent1	OUTFALL	0.00	0.00	85.05	0 00:00	0.00
OF-StLaurent2	OUTFALL	0.00	0.00	85.07	0 00:00	0.00
Park-OUT	OUTFALL	0.68	0.68	82.44	0 00:00	0.68
Retirement-OUT	OUTFALL	0.00	0.00	86.00	0 00:00	0.00
CB01/02	STORAGE	0.05	1.49	85.16	0 01:30	1.48
CB03/04	STORAGE	0.06	1.51	86.07	0 01:31	1.51
CB05/06	STORAGE	0.07	1.42	86.39	0 01:40	1.42
CB07/08	STORAGE	0.19	1.13	84.88	0 02:20	1.13
CB09	STORAGE	0.05	1.31	86.17	0 01:30	1.31
CB10/11	STORAGE	0.08	1.81	86.16	0 01:31	1.80
CB12/13	STORAGE	0.07	1.74	85.87	0 01:31	1.74
CB14/15	STORAGE	0.09	0.62	85.73	0 02:48	0.62
CB16	STORAGE	0.07	0.49	85.73	0 02:49	0.49
CB17/18	STORAGE	0.00	0.05	86.07	0 01:30	0.05
CB19	STORAGE	0.25	1.24	85.73	0 02:50	1.24
CB20	STORAGE	0.08	1.36	85.44	0 01:42	1.36
CB21	STORAGE	0.07	1.29	85.44	0 01:41	1.29
CB22	STORAGE	0.07	1.26	85.44	0 01:41	1.26
CB23	STORAGE	0.07	1.24	85.44	0 01:40	1.24
CB24	STORAGE	0.07	1.24	85.45	0 01:40	1.24
CB25	STORAGE	0.06	1.25	85.50	0 01:30	1.24
MH201	STORAGE	1.35	1.45	82.46	0 01:43	1.45
MH202	STORAGE	0.60	0.94	82.71	0 01:43	0.94
MH203	STORAGE	0.23	0.73	82.88	0 01:44	0.73
MH204	STORAGE	0.00	0.00	82.89	0 01:44	0.00
MH205	STORAGE	0.02	0.32	82.89	0 01:45	0.32
MH401	STORAGE	1.63	1.65	82.35	0 01:41	1.65
MH401b	STORAGE	1.21	1.24	82.36	0 01:40	1.24
MH402	STORAGE	0.96	1.03	82.40	0 01:40	1.03
MH403	STORAGE	0.79	0.89	82.43	0 01:40	0.89
MH404	STORAGE	0.45	0.67	82.56	0 01:35	0.67
MH405	STORAGE	0.07	0.42	82.69	0 01:35	0.42
MH406	STORAGE	0.51	0.62	82.44	0 01:40	0.62
MH407	STORAGE	0.04	0.15	82.44	0 01:43	0.15
MH408	STORAGE	0.00	0.00	82.53	0 00:00	0.00
MH501	STORAGE	0.22	3.70	86.39	0 01:40	3.70
MH501Connection	STORAGE	0.02	0.35	82.89	0 01:44	0.35
MH502	STORAGE	0.16	3.05	86.39	0 01:40	3.05
MH503	STORAGE	1.23	3.04	84.89	0 02:18	3.03
MH504	STORAGE	0.59	2.23	84.88	0 02:20	2.23
MH505	STORAGE	1.72	3.76	85.73	0 02:49	3.76
MH506	STORAGE	1.39	3.43	85.73	0 02:49	3.43
MH507	STORAGE	1.18	3.18	85.73	0 02:49	3.18
MH508	STORAGE	1.07	3.04	85.73	0 02:50	3.04
MH509	STORAGE	0.98	2.90	85.73	0 02:51	2.90
MH510	STORAGE	0.66	2.33	85.73	0 02:48	2.33
MH600	STORAGE	0.83	0.83	83.96	0 01:29	0.83
MH601	STORAGE	0.89	2.28	85.44	0 01:42	2.28
MH602	STORAGE	0.52	1.91	85.44	0 01:41	1.91
MH603	STORAGE	0.44	1.83	85.44	0 01:40	1.83
MH604	STORAGE	0.22	1.62	85.45	0 01:40	1.62
MH800	STORAGE	0.02	1.05	84.44	0 01:41	1.03
MH801	STORAGE	0.56	2.49	84.42	0 01:41	2.47
MH802	STORAGE	0.01	0.41	84.51	0 01:41	0.40
Retirement_Storage	STORAGE	0.11	1.30	87.30	0 01:42	1.30
RY-1001	STORAGE	0.06	1.20	84.99	0 01:45	1.19
RY-1002	STORAGE	0.04	0.91	84.99	0 01:45	0.90
RY-1003	STORAGE	0.04	1.01	85.16	0 01:42	1.00
RY-1004	STORAGE	0.02	0.72	85.16	0 01:41	0.71
RY-1005	STORAGE	0.11	1.25	85.85	0 01:50	1.24
RY-1006	STORAGE	0.13	1.38	85.85	0 01:51	1.37
RY-1007	STORAGE	0.11	1.26	85.85	0 01:51	1.25
RY-1008	STORAGE	0.06	0.92	85.86	0 01:51	0.91
RY-1009	STORAGE	0.03	0.84	85.23	0 01:39	0.84
RY-1010	STORAGE	0.01	0.53	85.24	0 01:40	0.52
RY-1011	STORAGE	0.01	0.34	85.54	0 01:50	0.34
RY-1012	STORAGE	0.04	0.65	85.54	0 01:50	0.64
RY-1013	STORAGE	0.07	0.90	85.54	0 01:51	0.89
RY-1014a	STORAGE	0.33	1.61	84.88	0 02:20	1.60
RY-1014b	STORAGE	0.20	1.18	84.88	0 02:17	1.18
RY-1015	STORAGE	0.13	0.84	85.74	0 02:44	0.83
RY-1016	STORAGE	0.20	1.10	85.73	0 02:45	1.10
RYCB701	STORAGE	0.09	1.45	84.98	0 01:44	1.45
RYCB702	STORAGE	0.07	1.27	85.16	0 01:41	1.26
RYCB703	STORAGE	0.15	1.47	85.85	0 01:51	1.46
RYCB704	STORAGE	0.04	0.96	85.23	0 01:39	0.96
RYCB705	STORAGE	0.11	1.14	85.54	0 01:48	1.13
RYCB708	STORAGE	0.41	1.83	84.88	0 02:20	1.83
RYCB709	STORAGE	0.44	1.78	85.73	0 02:49	1.78

**Walkley-Conroy (122040)**  
**PCSWMM Model Output**  
**100yr 4-Hour Chicago, Fixed**



\*\*\*\*\*  
Node Inflow Summary  
\*\*\*\*\*

Node	Type	Maximum Lateral Inflow LPS	Maximum Total Inflow LPS	Time of Max Occurrence days hr:min	Lateral Inflow Volume 10^6 ltr	Total Inflow Volume 10^6 ltr	Flow Balance Error Percent
HP-CB01/02	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB03/04	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB05/06	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB05/06(2)	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB07/08	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB09	JUNCTION	0.00	19.59	0 01:30	0	0.00448	0.032
HP-CB09(2)	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB10/11	JUNCTION	0.00	26.42	0 01:31	0	0.00197	88.318
HP-CB12/13	JUNCTION	0.00	21.32	0 01:30	0	0.0014	27.175
HP-CB14/15	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB14/15(2)	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB16	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB16(2)	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB19	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB20	JUNCTION	0.00	1.38	0 01:37	0	0.000269	19.011
HP-CB21	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB22	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB23	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB24	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB25	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-CB25(2)	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-MH509	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-RY-1005	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-RYCB09	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-RYCB704	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-RYCB705	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
Hp-RYCB802	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
D01-OUT	OUTFALL	5.32	5.32	0 01:30	0.00487	0.00487	0.000
D04-05-OUT	OUTFALL	23.80	23.80	0 01:30	0.0193	0.0193	0.000
DR02-03-OUT	OUTFALL	9.61	9.61	0 01:30	0.0102	0.0102	0.000
HP-MH509-OUT	OUTFALL	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-RY-1001	OUTFALL	0.00	0.00	0 00:00	0	0	0.000 ltr
HP-RY-1003	OUTFALL	0.00	0.00	0 00:00	0	0	0.000 ltr
MH201Connection	OUTFALL	0.00	223.04	0 01:43	0	1.09	0.000
MH401Connection	OUTFALL	0.00	138.15	0 01:41	0	1.24	0.000
OF-DonReidDr	OUTFALL	0.00	0.00	0 00:00	0	0	0.000 ltr
OF-MH600	OUTFALL	0.00	26.82	0 01:42	0	0.184	0.000
OF-MJ-CommercialRoad	OUTFALL	0.00	0.24	0 01:42	0	0.000161	0.000
OF-Retirement	OUTFALL	0.00	0.00	0 00:00	0	0	0.000 ltr
OF-RYCB708	OUTFALL	0.00	0.00	0 00:00	0	0	0.000 ltr
OF-StLaurent1	OUTFALL	0.00	0.00	0 00:00	0	0	0.000 ltr
OF-StLaurent2	OUTFALL	0.00	0.00	0 00:00	0	0	0.000 ltr
Park-OUT	OUTFALL	0.00	56.91	0 01:41	0	0.172	0.000
Retirement-OUT	OUTFALL	0.00	103.78	0 01:42	0	0.701	0.000
CB01/02	STORAGE	154.78	154.78	0 01:30	0.212	0.212	0.003
CB03/04	STORAGE	137.64	137.64	0 01:30	0.183	0.183	-0.017
CB05/06	STORAGE	123.45	123.45	0 01:30	0.167	0.167	-0.029
CB07/08	STORAGE	120.82	120.82	0 01:30	0.161	0.161	0.000
CB09	STORAGE	55.41	55.41	0 01:30	0.0752	0.0753	-0.064
CB10/11	STORAGE	108.47	125.68	0 01:30	0.149	0.154	-0.323
CB12/13	STORAGE	139.98	139.98	0 01:30	0.193	0.194	-0.487
CB14/15	STORAGE	77.62	77.62	0 01:30	0.1	0.1	0.207
CB16	STORAGE	38.69	38.69	0 01:30	0.0531	0.0531	0.069
CB17/18	STORAGE	90.76	90.76	0 01:30	0.125	0.125	0.165
CB19	STORAGE	61.92	83.78	0 01:30	0.0828	0.105	0.060
CB20	STORAGE	16.74	33.29	0 01:29	0.022	0.0342	-0.216
CB21	STORAGE	14.86	17.64	0 01:30	0.0197	0.02	-0.065
CB22	STORAGE	16.70	16.70	0 01:30	0.0218	0.0218	-0.025
CB23	STORAGE	17.52	17.52	0 01:30	0.0223	0.0223	-0.015
CB24	STORAGE	33.79	33.79	0 01:30	0.0441	0.0441	0.016
CB25	STORAGE	39.13	39.13	0 01:30	0.0535	0.0535	0.010
MH201	STORAGE	0.00	223.04	0 01:43	0	1.09	0.000
MH202	STORAGE	0.00	223.10	0 01:42	0	1.08	0.011
MH203	STORAGE	0.00	126.53	0 01:48	0	0.668	0.004
MH204	STORAGE	0.00	0.22	0 01:42	0	1.65e-05	2.601 ltr
MH205	STORAGE	0.00	12.21	0 01:49	0	0.121	0.013
MH401	STORAGE	0.00	138.15	0 01:41	0	1.24	0.000
MH401b	STORAGE	0.00	138.15	0 01:41	0	1.24	-0.000
MH402	STORAGE	0.00	138.14	0 01:41	0	1.24	0.000
MH403	STORAGE	0.00	130.21	0 01:39	0	0.967	-0.000
MH404	STORAGE	0.00	98.61	0 01:31	0	0.347	-0.019
MH405	STORAGE	0.00	57.64	0 01:31	0	0.194	-0.001

MH406	STORAGE	0.00	32.07	0 01:45	0	0.625	0.003
MH407	STORAGE	0.00	7.67	0 01:23	0	0.00385	0.006
MH408	STORAGE	0.00	0.00	0 00:00	0	0	0.000 ltr
MH501	STORAGE	0.00	68.20	0 01:23	0	0.167	-0.138
MH501Connection	STORAGE	0.00	27.87	0 01:57	0	0.167	-0.001
MH502	STORAGE	0.00	111.48	0 01:23	0	0.167	0.139
MH503	STORAGE	0.00	79.60	0 01:27	0	0.275	-0.011
MH504	STORAGE	0.00	124.90	0 01:27	0	0.325	-0.021
MH505	STORAGE	0.00	77.50	0 01:30	0	0.587	-0.036
MH506	STORAGE	0.00	130.85	0 01:27	0	0.512	0.051
MH507	STORAGE	0.00	185.69	0 01:24	0	0.426	-0.098
MH508	STORAGE	0.00	255.21	0 01:27	0	0.413	-0.080
MH509	STORAGE	0.00	220.87	0 01:27	0	0.329	-0.035
MH510	STORAGE	0.00	146.07	0 01:27	0	0.232	-0.041
MH600	STORAGE	0.00	26.82	0 01:42	0	0.184	0.004
MH601	STORAGE	0.00	52.61	0 01:28	0	0.184	0.016
MH602	STORAGE	0.00	85.27	0 01:28	0	0.184	-0.014
MH603	STORAGE	0.00	50.27	0 01:28	0	0.0986	-0.007
MH604	STORAGE	0.00	66.83	0 01:28	0	0.0979	-0.089
MH800	STORAGE	0.00	80.09	0 01:30	0	0.161	-0.533
MH801	STORAGE	0.00	61.49	0 01:30	0	0.167	-0.063
MH802	STORAGE	81.58	81.58	0 01:30	0.162	0.162	0.643
Retirement_Storage	STORAGE	486.75	486.75	0 01:30	0.701	0.701	0.001
RY-1001	STORAGE	0.00	36.03	0 01:29	0	0.02	0.015
RY-1002	STORAGE	0.00	31.48	0 01:28	0	0.0138	0.036
RY-1003	STORAGE	0.00	16.41	0 01:30	0	0.00828	-0.012
RY-1004	STORAGE	0.00	21.52	0 01:25	0	0.00789	0.006
RY-1005	STORAGE	0.00	15.32	0 01:30	0	0.012	0.004
RY-1006	STORAGE	0.00	34.12	0 01:30	0	0.0393	0.007
RY-1007	STORAGE	0.00	79.60	0 01:29	0	0.0867	0.008
RY-1008	STORAGE	0.00	50.08	0 01:29	0	0.0342	0.023
RY-1009	STORAGE	0.00	33.06	0 01:29	0	0.0244	0.016
RY-1010	STORAGE	0.00	20.70	0 01:25	0	0.00638	-0.024
RY-1011	STORAGE	0.00	34.77	0 01:29	0	0.0138	0.038
RY-1012	STORAGE	0.00	66.82	0 01:29	0	0.0474	0.007
RY-1013	STORAGE	0.00	84.58	0 01:29	0	0.0879	0.001
RY-1014a	STORAGE	10.26	153.01	0 01:26	0.00694	0.176	-0.976
RY-1014b	STORAGE	91.40	109.29	0 01:28	0.104	0.128	1.810
RY-1015	STORAGE	0.00	54.43	0 01:38	0	0.0306	0.042
RY-1016	STORAGE	0.00	158.65	0 01:31	0	0.0916	0.014
RYCB701	STORAGE	104.06	104.06	0 01:30	0.115	0.149	-0.004
RYCB702	STORAGE	66.79	66.79	0 01:30	0.0769	0.0931	0.000
RYCB703	STORAGE	116.82	116.82	0 01:30	0.135	0.215	-0.007
RYCB704	STORAGE	46.19	46.19	0 01:30	0.0516	0.0697	-0.006
RYCB705	STORAGE	102.71	102.71	0 01:30	0.121	0.175	-0.005
RYCB708	STORAGE	0.00	118.61	0 01:27	0	0.204	-0.201
RYCB709	STORAGE	155.97	208.31	0 01:31	0.187	0.27	0.268

\*\*\*\*\*  
Node Surcharge Summary  
\*\*\*\*\*

No nodes were surcharged.

\*\*\*\*\*  
Node Flooding Summary  
\*\*\*\*\*

No nodes were flooded.

\*\*\*\*\*  
Storage Volume Summary  
\*\*\*\*\*

Storage Unit	Average Volume 1000 m³	Avg Full	Evap Loss	Exfil Loss	Maximum Volume 1000 m³	Max Full	Time of Max Occurrence days hr:min	Maximum Outflow LPS
CB01/02	0.000	2.1	0.0	0.0	0.001	64.1	0 01:30	79.51
CB03/04	0.000	2.6	0.0	0.0	0.001	64.8	0 01:31	53.50
CB05/06	0.000	3.0	0.0	0.0	0.001	62.8	0 01:40	111.48
CB07/08	0.000	8.3	0.0	0.0	0.000	49.1	0 02:20	120.15
CB09	0.000	2.2	0.0	0.0	0.000	59.8	0 01:30	40.71
CB10/11	0.000	2.9	0.0	0.0	0.001	70.5	0 01:31	67.47
CB12/13	0.000	2.6	0.0	0.0	0.001	68.0	0 01:31	78.94
CB14/15	0.000	4.0	0.0	0.0	0.000	26.8	0 02:48	77.50
CB16	0.000	3.0	0.0	0.0	0.000	22.4	0 02:49	38.68
CB17/18	0.000	0.3	0.0	0.0	0.000	5.4	0 01:30	89.02

**Walkley-Conroy (122040)**  
**PCSWMM Model Output**  
**100yr 4-Hour Chicago, Fixed**

CB19	0.000	11.5	0.0	0.0	0.000	56.5	0	02:50	83.94
CB20	0.000	3.5	0.0	0.0	0.000	61.8	0	01:42	13.86
CB21	0.000	3.2	0.0	0.0	0.000	58.8	0	01:41	13.19
CB22	0.000	3.1	0.0	0.0	0.000	57.5	0	01:41	15.58
CB23	0.000	3.0	0.0	0.0	0.000	56.6	0	01:40	16.58
CB24	0.000	3.0	0.0	0.0	0.000	56.5	0	01:40	30.67
CB25	0.000	3.0	0.0	0.0	0.000	56.6	0	01:30	36.16
MH201	0.002	33.2	0.0	0.0	0.003	35.5	0	01:43	223.04
MH202	0.001	14.2	0.0	0.0	0.001	22.2	0	01:43	223.04
MH203	0.000	5.0	0.0	0.0	0.001	15.9	0	01:44	134.85
MH204	0.000	0.0	0.0	0.0	0.000	0.1	0	01:44	0.01
MH205	0.000	0.4	0.0	0.0	0.000	8.0	0	01:45	18.44
MH401	0.003	35.2	0.0	0.0	0.003	36.7	0	01:41	138.15
MH401b	0.002	30.3	0.0	0.0	0.002	31.0	0	01:40	138.15
MH402	0.001	20.1	0.0	0.0	0.001	21.5	0	01:40	138.15
MH403	0.001	17.4	0.0	0.0	0.001	19.4	0	01:40	130.20
MH404	0.001	11.2	0.0	0.0	0.001	16.8	0	01:35	98.64
MH405	0.000	2.0	0.0	0.0	0.000	11.7	0	01:35	57.56
MH406	0.001	10.7	0.0	0.0	0.001	12.8	0	01:40	32.13
MH407	0.000	1.2	0.0	0.0	0.000	3.8	0	01:43	6.28
MH408	0.000	0.0	0.0	0.0	0.000	0.0	0	00:00	0.00
MH501	0.000	4.6	0.0	0.0	0.004	78.3	0	01:40	27.86
MH501Connection	0.000	0.4	0.0	0.0	0.000	9.0	0	01:44	41.66
MH502	0.000	4.0	0.0	0.0	0.003	76.5	0	01:40	68.20
MH503	0.003	28.7	0.0	0.0	0.008	71.0	0	02:18	28.44
MH504	0.001	17.2	0.0	0.0	0.006	65.2	0	02:20	118.61
MH505	0.004	37.3	0.0	0.0	0.010	81.8	0	02:49	66.32
MH506	0.004	33.5	0.0	0.0	0.009	82.9	0	02:49	65.25
MH507	0.003	32.7	0.0	0.0	0.008	88.2	0	02:49	59.90
MH508	0.003	31.1	0.0	0.0	0.008	98.0	0	02:50	182.14
MH509	0.002	25.4	0.0	0.0	0.007	75.2	0	02:51	190.72
MH510	0.001	19.6	0.0	0.0	0.003	68.8	0	02:48	139.60
MH600	0.001	35.8	0.0	0.0	0.001	36.0	0	01:29	26.82
MH601	0.001	27.4	0.0	0.0	0.003	70.1	0	01:42	28.01
MH602	0.001	25.8	0.0	0.0	0.002	94.7	0	01:41	63.64
MH603	0.000	22.4	0.0	0.0	0.002	93.1	0	01:40	41.02
MH604	0.000	12.8	0.0	0.0	0.002	93.4	0	01:40	50.27
MH800	0.000	0.9	0.0	0.0	0.001	38.4	0	01:41	61.49
MH801	0.001	12.6	0.0	0.0	0.003	56.4	0	01:41	56.91
MH802	0.000	0.5	0.0	0.0	0.000	17.4	0	01:41	80.09
Retirment_Storage	0.016	5.1	0.0	0.0	0.310	97.1	0	01:42	103.78
RY-1001	0.000	2.5	0.0	0.0	0.000	51.8	0	01:45	11.29
RY-1002	0.000	1.6	0.0	0.0	0.000	40.1	0	01:45	9.48
RY-1003	0.000	2.2	0.0	0.0	0.000	50.5	0	01:42	3.18
RY-1004	0.000	1.2	0.0	0.0	0.000	36.0	0	01:41	4.62
RY-1005	0.000	4.7	0.0	0.0	0.000	55.9	0	01:50	4.43
RY-1006	0.000	5.8	0.0	0.0	0.000	62.0	0	01:51	15.32
RY-1007	0.000	4.7	0.0	0.0	0.000	55.8	0	01:51	50.08
RY-1008	0.000	2.3	0.0	0.0	0.000	36.5	0	01:51	15.55
RY-1009	0.000	1.3	0.0	0.0	0.000	37.3	0	01:39	20.70
RY-1010	0.000	0.5	0.0	0.0	0.000	20.4	0	01:40	4.31
RY-1011	0.000	0.6	0.0	0.0	0.000	15.6	0	01:50	11.39
RY-1012	0.000	1.6	0.0	0.0	0.000	25.3	0	01:50	34.77
RY-1013	0.000	2.6	0.0	0.0	0.000	33.8	0	01:51	66.82
RY-1014a	0.000	11.3	0.0	0.0	0.000	54.8	0	02:20	53.93
RY-1014b	0.000	8.5	0.0	0.0	0.000	51.5	0	02:17	102.63
RY-1015	0.000	6.0	0.0	0.0	0.000	37.5	0	02:44	27.82
RY-1016	0.000	9.2	0.0	0.0	0.000	49.7	0	02:45	54.43
RYCB701	0.000	3.5	0.0	0.0	0.001	56.5	0	01:44	64.94
RYCB702	0.000	3.1	0.0	0.0	0.000	53.7	0	01:41	42.10
RYCB703	0.000	5.6	0.0	0.0	0.001	55.3	0	01:51	110.49
RYCB704	0.000	1.7	0.0	0.0	0.000	38.3	0	01:39	43.40
RYCB705	0.000	4.6	0.0	0.0	0.000	47.5	0	01:48	95.39
RYCB708	0.000	12.3	0.0	0.0	0.001	54.6	0	02:20	105.97
RYCB709	0.000	15.9	0.0	0.0	0.001	64.9	0	02:49	158.65

\*\*\*\*\*  
 Outfall Loading Summary  
 \*\*\*\*\*

Outfall Node	Flow Freq Pcnt	Avg Flow LPS	Max Flow LPS	Total Volume 10 <sup>6</sup> ltr
D01-OUT	17.23	0.47	5.32	0.005
D04-05-OUT	17.31	1.78	23.80	0.019
DR02-03-OUT	17.36	0.95	9.61	0.010
HP-MH509-OUT	0.00	0.00	0.00	0.000
HP-RY-1001	0.00	0.00	0.00	0.000
HP-RY-1003	0.00	0.00	0.00	0.000

MH201Connection	95.72	14.83	223.04	1.087
MH401Connection	91.67	16.70	138.15	1.239
OF-DonReidDr	0.00	0.00	0.00	0.000
OF-MH600	19.49	11.81	26.82	0.184
OF-MJ-CommercialRoad	1.43	0.09	0.24	0.000
OF-Retirement	0.00	0.00	0.00	0.000
OF-RYCB708	0.00	0.00	0.00	0.000
OF-StLaurent1	0.00	0.00	0.00	0.000
OF-StLaurent2	0.00	0.00	0.00	0.000
Park-OUT	97.09	2.20	56.91	0.172
Retirement-OUT	30.45	29.04	103.78	0.701
System	22.81	77.87	557.33	3.417

\*\*\*\*\*  
 Link Flow Summary  
 \*\*\*\*\*

Link	Type	Maximum [Flow] LPS	Time of Max Occurrence days hr:min	Maximum [Veloc] m/sec	Max/ Full Flow	Max/ Full Depth
C1	CHANNEL	0.00	0 00:00	0.00	0.00	0.02
C10	CHANNEL	0.00	0 00:00	0.00	0.00	0.05
C11	CHANNEL	0.00	0 00:00	0.00	0.00	0.08
C12	CHANNEL	1.38	0 01:37	0.02	0.00	0.08
C13	CHANNEL	0.24	0 01:42	0.19	0.00	0.01
C14	CHANNEL	0.00	0 00:00	0.00	0.00	0.08
C15	CHANNEL	0.00	0 00:00	0.00	0.00	0.08
C16	CHANNEL	0.00	0 00:00	0.00	0.00	0.09
C17	CHANNEL	0.00	0 00:00	0.00	0.00	0.09
C18	CHANNEL	0.00	0 00:00	0.00	0.00	0.08
C19	CHANNEL	0.00	0 00:00	0.00	0.00	0.08
C2	CHANNEL	0.00	0 00:00	0.00	0.00	0.02
C20	CHANNEL	0.00	0 00:00	0.00	0.00	0.00
C21	CONDUIT	11.34	0 01:54	0.05	0.00	0.09
C21_1	CONDUIT	0.00	0 00:00	0.00	0.00	0.02
C21_2	CONDUIT	0.00	0 00:00	0.00	0.00	0.02
C21_3	CONDUIT	0.00	0 00:00	0.00	0.00	0.02
C22	CHANNEL	0.00	0 00:00	0.00	0.00	0.00
C23	CHANNEL	0.00	0 00:00	0.00	0.00	0.00
C24	CHANNEL	0.00	0 00:00	0.00	0.00	0.06
C25	CONDUIT	19.59	0 01:30	0.10	0.00	0.06
C26	CONDUIT	34.77	0 01:29	0.23	0.03	0.54
C27	CHANNEL	0.00	0 00:00	0.00	0.00	0.06
C28	CONDUIT	0.00	0 00:00	0.00	0.00	0.00
C29	CHANNEL	0.00	0 00:00	0.00	0.00	0.00
C3	CHANNEL	0.00	0 00:00	0.00	0.00	0.02
C30	CHANNEL	0.00	0 00:00	0.00	0.00	0.00
C31	CHANNEL	21.32	0 01:30	0.13	0.00	0.10
C32	CHANNEL	26.42	0 01:31	0.11	0.00	0.13
C33	CHANNEL	0.23	0 01:32	0.12	0.00	0.09
C34	CONDUIT	19.49	0 01:30	0.05	0.00	0.13
C35	CHANNEL	0.50	0 01:31	0.07	0.00	0.02
C36	CHANNEL	21.87	0 01:30	0.21	0.00	0.04
C37	CHANNEL	0.00	0 00:00	0.00	0.00	0.03
C38	CHANNEL	0.00	0 00:00	0.00	0.00	0.00
C39	CHANNEL	0.00	0 00:00	0.00	0.00	0.00
C4	CHANNEL	0.00	0 00:00	0.00	0.00	0.02
C40	CHANNEL	0.00	0 00:00	0.00	0.00	0.00
C41	CONDUIT	23.31	0 01:30	0.11	0.00	0.11
C42	CONDUIT	105.97	0 01:27	0.63	0.10	1.00
C43	CONDUIT	138.15	0 01:41	0.49	0.39	1.00
C44	CONDUIT	0.00	0 00:00	0.00	0.00	0.02
C45	CONDUIT	21.52	0 01:25	0.25	0.08	1.00
C46	CONDUIT	66.82	0 01:29	0.33	0.06	0.85
C47	CONDUIT	84.58	0 01:29	0.26	0.08	1.00
C47_1	CONDUIT	0.00	0 00:00	0.00	0.00	0.00
C48	CONDUIT	16.41	0 01:30	0.17	0.06	1.00
C49	CONDUIT	0.00	0 00:00	0.00	0.00	0.00
C5	CHANNEL	0.00	0 00:00	0.00	0.00	0.02
C50	CONDUIT	0.00	0 00:00	0.00	0.00	0.00
C51	CONDUIT	0.00	0 00:00	0.00	0.00	0.01
C52	CONDUIT	0.00	0 00:00	0.00	0.00	0.00
C53	CONDUIT	0.00	0 00:00	0.00	0.00	0.00
C54	CONDUIT	0.00	0 00:00	0.00	0.00	0.00
C55	CONDUIT	0.00	0 00:00	0.00	0.00	0.02
C56	CONDUIT	0.00	0 00:00	0.00	0.00	0.02
C57	CONDUIT	0.00	0 00:00	0.00	0.00	0.02
C58	CONDUIT	0.00	0 00:00	0.00	0.00	0.00

**Walkley-Conroy (122040)**  
**PCSWMM Model Output**  
**100yr 4-Hour Chicago, Fixed**

C59	CONDUIT	61.49	0	01:30	1.03	0.48	1.00
C6	CHANNEL	0.00	0	00:00	0.00	0.00	0.02
C64	CONDUIT	54.43	0	01:38	0.35	0.05	0.96
C65	CONDUIT	158.65	0	01:31	0.56	0.14	1.00
C66	CONDUIT	102.63	0	01:29	0.86	0.09	1.00
C67	CONDUIT	36.03	0	01:29	0.21	0.03	1.00
C68	CONDUIT	31.48	0	01:28	0.25	0.03	1.00
C69	CONDUIT	15.32	0	01:30	0.08	0.01	1.00
C7	CHANNEL	0.00	0	00:00	0.00	0.00	0.03
C70	CONDUIT	34.12	0	01:30	0.12	0.03	1.00
C71	CONDUIT	79.60	0	01:29	0.26	0.09	1.00
C72	CONDUIT	50.08	0	01:29	0.27	0.05	1.00
C73	CONDUIT	0.00	0	00:00	0.00	0.00	0.00
C74	CONDUIT	0.00	0	00:00	0.00	0.00	0.00
C75	CONDUIT	20.70	0	01:25	0.23	0.07	0.98
C76	CONDUIT	33.06	0	01:29	0.33	0.12	1.00
C77	CONDUIT	0.00	0	00:00	0.00	0.00	0.00
C8	CHANNEL	0.00	0	00:00	0.00	0.00	0.03
C9	CHANNEL	0.00	0	00:00	0.00	0.00	0.05
HP01	CHANNEL	0.00	0	00:00	0.00	0.00	0.00
MH401b-MH401	CONDUIT	138.15	0	01:41	0.49	0.41	1.00
OR-CB05/06	CONDUIT	111.48	0	01:23	1.63	1.03	1.00
OR-CB07/08	CONDUIT	120.15	0	01:28	1.74	1.30	1.00
OR-CB14/15	CONDUIT	77.50	0	01:30	1.41	0.79	1.00
OR-CB16	CONDUIT	38.68	0	01:30	1.02	0.42	1.00
OR-CB19	CONDUIT	83.94	0	01:29	1.30	0.84	1.00
OR-CB20	CONDUIT	16.73	0	01:30	0.58	0.49	1.00
OR-CB21	CONDUIT	13.19	0	01:28	0.56	0.41	1.00
OR-CB22	CONDUIT	15.58	0	01:29	0.55	0.52	1.00
OR-CB23	CONDUIT	16.58	0	01:29	0.62	0.53	1.00
OR-CB24	CONDUIT	30.67	0	01:28	0.98	0.93	1.00
OR-CB25	CONDUIT	36.16	0	01:28	1.15	1.17	1.00
OR-RYCB708	CONDUIT	118.61	0	01:27	0.63	0.27	1.00
OR-RYCB709	CONDUIT	146.07	0	01:27	1.09	0.34	1.00
OVF-Retirement	CONDUIT	0.00	0	00:00	0.00	0.00	0.00
STM-213 (STM)	CONDUIT	80.09	0	01:30	1.17	0.65	1.00
STM-253 (STM)	CONDUIT	57.56	0	01:30	0.81	0.74	1.00
STM-254 (STM)	CONDUIT	98.64	0	01:35	0.62	0.64	1.00
STM-255 (STM)	CONDUIT	130.20	0	01:39	0.60	0.53	1.00
STM-256 (STM)	CONDUIT	138.15	0	01:41	0.49	0.41	1.00
STM-257 (STM)	CONDUIT	32.13	0	01:44	0.20	0.21	1.00
STM-258 (STM)	CONDUIT	7.67	0	01:23	0.21	0.24	0.79
STM-260 (STM)	CONDUIT	190.72	0	01:26	0.67	0.13	1.00
STM-261 (1)_ (1)_ (STM)	CONDUIT	57.58	0	01:25	0.07	0.04	1.00
STM-261 (1)_ (STM)	CONDUIT	65.25	0	01:23	0.22	0.04	1.00
STM-261 (STM)	CONDUIT	182.14	0	01:26	0.55	0.12	1.00
STM-267 (STM)	CONDUIT	0.00	0	00:00	0.00	0.00	0.27
STM-269 (STM)	CONDUIT	139.60	0	01:27	1.32	0.32	1.00
STM-291 (STM)	CONDUIT	79.60	0	01:27	0.38	0.10	1.00
STM-302 (1)_ (STM)	CONDUIT	41.02	0	01:29	0.26	0.26	1.00
STM-302 (STM)	CONDUIT	50.27	0	01:28	0.32	0.32	1.00
STM-304 (STM)	CONDUIT	52.61	0	01:28	0.33	0.34	1.00
STM-316 (STM)_1	CONDUIT	0.22	0	01:42	0.00	0.00	0.47
STM-316 (STM)_2	CONDUIT	41.66	0	01:59	0.53	0.30	0.97
STM-317 (STM)	CONDUIT	134.85	0	01:48	0.85	0.87	1.00
STM-318 (1)_ (STM)	CONDUIT	223.04	0	01:43	1.03	0.95	1.00
STM-319 (STM)	CONDUIT	223.04	0	01:43	1.03	0.97	1.00
STM-324 (STM)	CONDUIT	68.20	0	01:23	0.62	0.20	1.00
STM-332 (STM)	CONDUIT	18.44	0	01:59	0.69	0.24	1.00
STM-400	CONDUIT	26.82	0	01:42	0.17	0.13	1.00
OR-CB01/02	ORIFICE	79.51	0	01:30			1.00
OR-CB03/04	ORIFICE	53.50	0	01:31			1.00
OR-CB09	ORIFICE	21.12	0	01:30			1.00
OR-CB10/11	ORIFICE	41.05	0	01:31			1.00
OR-CB12/13	ORIFICE	57.64	0	01:31			1.00
OR-MH501	ORIFICE	27.86	0	01:57			1.00
OR-MH503	ORIFICE	8.48	0	02:14			1.00
OR-MH505	ORIFICE	11.84	0	02:53			1.00
OR-MH601	ORIFICE	26.82	0	01:42			1.00
OR-MH801	ORIFICE	56.91	0	01:41			1.00
OR-RYCB701	ORIFICE	17.36	0	01:44			1.00
OR-RYCB702	ORIFICE	12.55	0	01:41			1.00
OR-RYCB703	ORIFICE	12.46	0	01:51			1.00
OR-RYCB704	ORIFICE	11.49	0	01:39			1.00
OR-RYCB705	ORIFICE	12.21	0	01:49			1.00
OR-CB17/18	DUMMY	67.15	0	01:30			
OR-RetirementStorage	DUMMY	103.78	0	01:42			

\*\*\*\*\*  
Flow Classification Summary  
\*\*\*\*\*

Conduit	Adjusted /Actual Length	Fraction of Time in Flow Class		Up Dry	Down Dry	Sub Crit	Sup Crit	Up Crit	Down Crit	Norm Ltd	Inlet Ctrl
		Up Dry	Down Dry								
C1	1.00	0.99	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C10	1.00	0.97	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C11	1.00	0.97	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C12	1.00	0.06	0.01	0.00	0.02	0.00	0.00	0.00	0.00	0.91	0.02
C13	1.00	0.07	0.00	0.00	0.71	0.22	0.00	0.00	0.00	0.00	0.00
C14	1.00	0.96	0.04	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C15	1.00	0.96	0.04	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C16	1.00	0.97	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C17	1.00	0.97	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C18	1.00	0.98	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C19	1.00	0.98	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C2	1.00	0.99	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C20	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C21	1.00	0.97	0.01	0.00	0.02	0.00	0.00	0.00	0.00	0.00	0.00
C21_1	1.00	0.93	0.07	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C21_2	1.00	0.93	0.07	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C21_3	1.00	0.93	0.07	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C22	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C23	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C24	1.00	0.98	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C25	1.00	0.98	0.01	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.93
C26	1.00	0.72	0.00	0.00	0.10	0.00	0.00	0.00	0.00	0.18	0.04
C27	1.00	0.98	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C28	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C29	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C3	1.00	0.98	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C30	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C31	1.00	0.06	0.01	0.00	0.02	0.00	0.00	0.00	0.00	0.92	0.02
C32	1.00	0.06	0.01	0.00	0.02	0.00	0.00	0.00	0.00	0.92	0.02
C33	1.00	0.06	0.01	0.00	0.02	0.00	0.00	0.00	0.00	0.92	0.02
C34	1.00	0.97	0.02	0.00	0.01	0.00	0.00	0.00	0.00	0.94	0.00
C35	1.00	0.06	0.00	0.00	0.07	0.00	0.00	0.00	0.00	0.86	0.07
C36	1.00	0.73	0.00	0.00	0.07	0.00	0.00	0.00	0.00	0.19	0.07
C37	1.00	0.73	0.27	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C38	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C39	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C4	1.00	0.98	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C40	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C41	1.00	0.96	0.01	0.00	0.02	0.00	0.00	0.00	0.00	0.00	0.00
C42	1.00	0.34	0.00	0.00	0.38	0.00	0.00	0.00	0.00	0.27	0.03
C43	1.00	0.00	0.00	0.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00
C44	1.00	0.93	0.07	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C45	1.00	0.70	0.00	0.00	0.07	0.00	0.00	0.00	0.00	0.23	0.02
C46	1.00	0.62	0.01	0.00	0.12	0.00	0.00	0.00	0.00	0.25	0.02
C47	1.00	0.56	0.02	0.00	0.14	0.00	0.00	0.00	0.00	0.28	0.01
C47_1	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C48	1.00	0.71	0.02	0.00	0.09	0.00	0.00	0.00	0.00	0.18	0.01
C49	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C5	1.00	0.98	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C50	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C51	1.00	0.99	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C52	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C53	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C54	1.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C55	1.00	0.98	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
C56	1.00	0.93	0.07	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

